

ภาคผนวก ข

---

เอกสารประกอบผลการปฏิบัติตาม  
มาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม

## ภาคผนวก ข.1-1

---

ตัวอย่างเอกสารโครงการแจ้งต่อผู้รับเหมา  
เกี่ยวกับข้อกำหนดด้านความปลอดภัย สิ่งแวดล้อม พลังงาน  
และสิทธิมนุษยชน

เอกสารแนบเพิ่มเติม TOR เรื่อง ข้อกำหนดด้านความปลอดภัย

สิ่งแวดล้อม พลังงาน และสิทธิมนุษยชน

ส่วนที่ 1 ข้อกำหนดด้านความปลอดภัย







**ภาคผนวก ข.1-2**

---

**ตัวอย่างเอกสารการบันทึกการตรวจสอบความปลอดภัยในการทำงาน**

 <b>On-Site Verifier (PH-P2-OP)</b> <b>ตรวจสอบก่อนลงนามในใบอนุญาตทำงาน</b>	Main Work No.					
	Cold		Hot		Lifting	
	ใช่	ไม่	ใช่	ไม่	ใช่	ไม่
งาน : .....						
ตรวจสอบ พื้นที่และอุปกรณ์ที่จะทำงานใน PTW กับหน่วยงาน ถูกต้องตรงกัน						
ตรวจสอบ EIC และ BCL รวมถึงอุปกรณ์ตัดแยกระบบตรงตาม Permit						
ตรวจสอบ อุปกรณ์ที่ตัดแยกไม่มีแรงดัน ไม่มีความร้อน ดกค้างอยู่						
ตรวจสอบ อุปกรณ์ที่ตัดแยกไม่มี Hydrocarbon /แก๊ส/ ไอน้ำ/ ดกค้างอยู่						
ตรวจสอบ ผู้ปฏิบัติงานทุกคนต้องสวมใส่ PPE ครบตามที่กำหนด						
ตรวจสอบ การลงชื่อ Job Owner/ หัวหน้างาน/ ผู้อนุญาต เช่นต้นครบ						
ตรวจสอบ การตัดแยก Switch Gear ที่ Sub-Station ได้แขวน Tag และคล้องกุญแจทั้ง O/P และ M/N						
ตรวจสอบ JSEA ตรงกับงานที่ทำ และถูกต้องตามข้อกำหนด						
ตรวจสอบ อุปกรณ์และเครื่องมือวัดที่นำเข้ามาใช้งานได้การตรวจสอบสภาพพร้อมติดสติ๊กเกอร์ได้รับอนุญาตและยังไม่หมดอายุ						
ตรวจสอบ การวัด Gas 0% LEL						
ตรวจสอบ ไม่มีสารเคมีไวไฟหรือวัสดุที่สามารถติดไฟได้ง่ายในพื้นที่ทำงาน						
ตรวจสอบ มีแสงสว่างเพียงพอต่อการปฏิบัติงาน						
ตรวจสอบ มีการระบายอากาศอย่างเพียงพอ กรณีเกิดควันจากงานตัดเชื่อม						
ตรวจสอบ มีการต่อสายกราวด์ตามจุดที่กำหนดเรียบร้อยแล้ว (ห้ามต่อกับกราวด์ของอุปกรณ์/เครื่องจักร)						
ตรวจสอบ มีการจัดเตรียมถังดับเพลิงที่พร้อมใช้งาน (แรงดันถังปกติ)						
ตรวจสอบ อุปกรณ์และเครื่องมือวัดที่นำเข้ามาใช้งานได้การตรวจสอบสภาพพร้อมติดสติ๊กเกอร์ได้รับอนุญาตและยังไม่หมดอายุ						
ตรวจสอบ ผ่ากันไฟอยู่ในสภาพดีและเปิดส้อมทั้ง 4 ด้าน พร้อมปิดรางระบายน้ำ กันสะเกิดไฟกระเด็นออกมาภายนอกได้						
ตรวจสอบ สายเชื่อม/ตัด ด้วยก๊าซมีการติดตั้งอุปกรณ์ป้องกันไฟย้อนกลับ						
ตรวจสอบ มีติดตั้งอุปกรณ์กันประกายไฟครอบที่ท่อไอเสียของเครื่องยนต์/ ยานพาหนะ						
ตรวจสอบ Main Work และ Mobile Lifting Work Permit เป็นงานเดียวกันลงบันทึกเลขอ้างอิงครบ						
ตรวจสอบ Work Permit มีการพิจารณาความเสี่ยงงานยกแล้ว						
ตรวจสอบ งานยกความเสี่ยงสูงต้องมี Lifting Plan และ JSEA						
ตรวจสอบ Work Permit ว่ามีการคำนวณน้ำหนักวัสดุสิ่งของและอุปกรณ์ช่วยยกแล้ว						
ตรวจสอบ Work Permit การลงลายมือชื่อ 4 ผู้ เรียบร้อยแล้ว						
ตรวจสอบ Work Permit PTTGC Job Owner ลงลายมือชื่อเรียบร้อยแล้ว						
ตรวจสอบ มีการปิดกั้นพื้นที่ปฏิบัติงาน ครบถ้วนพร้อมมีการยก						

หมายเหตุ : หัวข้อใดไม่เกี่ยวข้องกับกระบวนการผลิต ให้ทำเครื่องหมาย - ในช่อง ใช่ กับ ไม่

 <b>On-Site Verifier (PH-P2-OP)</b> <b>ตรวจสอบก่อนลงนามในใบอนุญาตทำงาน</b>	Main Work No.							
	Excavation งานขุด		Confined Space		Scaffold		Work at High	
	ใช่	ไม่	ใช่	ไม่	ใช่	ไม่	ใช่	ไม่
งาน : .....								
ตรวจสอบ Main Work และ Excavation Permit เป็นงานเดียวกันลงบันทึกเลขอ้างอิงครบ								
ตรวจสอบ ว่ามีการตรวจสอบด้านเครื่องกล( Mech ),โยธา(Civil)แล้ว พร้อมลงลายมือชื่อ								
ตรวจสอบ ว่ามีการตรวจสอบด้านไฟฟ้า( Electrical)แล้ว พร้อมลงลายมือชื่อแล้ว								
ตรวจสอบ ว่ามีการตรวจสอบด้านเครื่องมือควบคุม( Instrument )แล้ว พร้อมลงลายมือชื่อ								
ตรวจสอบ มีแบบใบอนุญาตทำงานขุดและผู้อนุญาตลงลายมือชื่อแล้ว								
ตรวจสอบ ข้อกำหนดสำหรับวิธีการขุดและข้อกำหนดด้านความปลอดภัยแล้ว (JSEA)								
ตรวจสอบ มีแบบ Plot Plan ตำแหน่งที่จะทำการขุดมาแล้ว								
ตรวจสอบ มีการจัดพื้นที่เพื่อวางกองดินไม่ให้ปนเปื้อนบนพื้นผิวและไหลลงสู่รางระบายน้ำ								
ตรวจสอบ มีการปิดกั้นพื้นที่หรือติดตั้งไฟสัญญาณเตือนบริเวณที่ทำการขุด								
ตรวจสอบ Main Work และ Confined Work Permit เป็นงานเดียวกันลงบันทึกเลขอ้างอิงครบ								
ตรวจสอบ มีรายชื่อผู้เข้าทำงาน Confined แบบใบอนุญาต								
ตรวจสอบ การวัด Gas: 0% LEL, Oxygen 19.5 ถึง 23.5 %, TOXIC GAS: Benzene < 1 ppm, H2S < 5 ppm								
ตรวจสอบ มีการระบายอากาศอย่างเพียงพอ								
ตรวจสอบ มีอุณหภูมิบรรยากาศไม่เกิน 40 °C								
ตรวจสอบ มีแสงสว่างเพียงพอต่อการปฏิบัติงาน (แรงดันไม่เกิน 50 Volt DC.)								
ตรวจสอบ มีผู้ปฏิบัติงานที่ควบคุมก้นตามทีระบุในใบอนุญาต 4 ผู้ และบัตรไม่หมดอายุ								
ตรวจสอบ มีอุปกรณ์ช่วยหายใจอยู่ในสภาพดี								
ตรวจสอบ มี Hold Watch ตรวจนับคนเข้า-ออก และเก็บบัตรไว้ตรงทางเข้า-ออก								
ตรวจสอบ ลงบันทึกช่องทางการติดต่อสื่อสารกรณีมีข้อสงสัยหรือเกิดเหตุการณ์ผิดปกติ								
ตรวจสอบ ทางเข้า-ออก ต้องมีการทำป้ายเตือนว่า "ที่อันตราย อันตราย ห้ามเข้า"								
ตรวจสอบ ตั้งนั่งร้านต้องไม่กีดขวางการทำงานของอุปกรณ์และการทำงาน								
ตรวจสอบ ส่วนที่ยื่นของนั่งร้านตั้งแต่ระดับศีรษะลงมาต้องสวมปลอกกันกระแทก								
ตรวจสอบ นั่งร้านที่ตั้งข้ามถนนหรือเส้นทางสัญจรต้องมีดาข่ายป้องกันสิ่งของตกหล่น								
ตรวจสอบ Tag อนุญาตใช้นั่งร้าน ( สีเขียว ) ต้องไม่เกินเวลาที่กำหนด								
ตรวจสอบ Main Work และ Scaffolding Work Permit เป็นงานเดียวกันลงบันทึกเลขอ้างอิงครบ								
ตรวจสอบ ผู้ปฏิบัติงานทุกคนมีบัตรอนุญาต ไม่หมดอายุ								
ตรวจสอบ Safety Harness เป็น Double Lanyard มีสภาพพร้อมใช้งาน								

หมายเหตุ : หัวข้อใดไม่เกี่ยวข้องกับกระบวนการผลิต ให้ทำเครื่องหมาย - ในช่อง ใช่ กับ ไม่

ภาคผนวก ข.1-3

---

แผนปฏิบัติการฉุกเฉิน





ภาคผนวก ข.1-4

---

## ตัวอย่างใบอนุญาตเข้าทำงาน (Work Permit)

## ใบอนุญาตทำงานทั่วไป (Cold Work Permit)



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

ใบสั่งงานเลขที่ / MOC No.

PH - PP - 2027 / ๑๓๖

ใบอนุญาตเลขที่

11225

Permit Request

Permit Preparation

Permit Approval

กฎระเบียบความปลอดภัย (Safety Rules and Regulations)

การต่ออายุใบอนุญาตทำงาน โดยใบอนุญาตทำงานจะสิ้นสุดลงไม่เกิน 12 ชั่วโมง สามารถต่ออายุใบอนุญาตทำงานได้ไม่เกิน 24 ชั่วโมง (ยกเว้นกรณี Turnaround)

## ใบอนุญาตทำงานที่มีประกายไฟ (Hot Work Permit)



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

ใบทำงานเลขที่ / MOC No.

PH-92-2022/636

ใบอนุญาตเลขที่

104305

Permit Request

Permit Preparation

Permit Approval



## ภาคผนวก ข.1-5

---

เอกสารการตรวจสอบรอยเชื่อมต่างๆ  
ของระบบท่อลำเลียงสารที่ระเหยได้































ภาคผนวก ข.1-6

---

ตัวอย่างใบรับรองแพทย์ของพนักงาน











ภาคผนวก ข.2-1

---

สำเนาหนังสือนำเสนอรายงานผลการปฏิบัติตามมาตรการฯ  
ต่อหน่วยงานอนุญาต



## บริษัท พีทีที ฟีนอล จำกัด

สำนักงานใหญ่ : เลขที่ 555/1 ถนนพหลโยธิน คอมเพล็กซ์  
อาคาร เอ ชั้น 15 ถนนวิภาวดีรังสิต แขวงจตุจักร  
เขตจตุจักร กรุงเทพมหานคร 10900  
โทรศัพท์ : +66 (0)2265-8400  
โทรสาร : +66 (0)2265-8125

สำนักงานระยอง : เลขที่ 9 ซอยจี 9 นิคมอุตสาหกรรมเหมราชตะวันออก  
ถนนแปดกิโลเมตรหน้าเหมราช ตำบลมาบตาพุด  
อำเภอเมืองระยอง จังหวัดระยอง 21150  
โทรศัพท์ : +66 (0)3864-3901  
โทรสาร : +66 (0)3864-3864

ที่ PPCL191/2565

วันที่ 20 มกราคม พ.ศ.2565

เรื่อง นำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงงานผลิตสารบิสฟีนอล เอ บริษัท พีทีที ฟีนอล จำกัด ครั้งที่ 2/2564 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ.2564

เรียน ผู้อำนวยการสำนักงานนิคมอุตสาหกรรมร่วมดำเนินงานกลุ่มมาบตาพุด


สิ่งที่ส่งมาด้วย รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงงานผลิตสารบิสฟีนอล เอ บริษัท พีทีที ฟีนอล จำกัด จำนวน 3 ฉบับ ซีดีรอม จำนวน 4 แผ่น

ตามที่ บริษัท พีทีที ฟีนอล จำกัด ได้รับความเห็นชอบรายงานการประเมินผลกระทบสิ่งแวดล้อม โครงการโรงงานผลิตสารบิสฟีนอล เอ (ส่วนขยาย ครั้งที่ 1) จากสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ตามหนังสือ ที่ ทส 1010.8/13846 ลงวันที่ 4 ตุลาคม พ.ศ.2562 ซึ่งโครงการตั้งอยู่ที่นิคมอุตสาหกรรมดับบลิวเอชเอตะวันออก (มาบตาพุด) เลขที่ 9 ซอย จี 9 ถนนแปดกิโลเมตรหน้าเหมราช ตำบลมาบตาพุด อำเภอเมืองระยอง จังหวัดระยอง น.42(1)-4/2551-ญทอ. นั้น



เพื่อให้เป็นไปตามประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม เรื่อง หลักเกณฑ์ และวิธีการจัดทำรายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการประเมินผลกระทบสิ่งแวดล้อม ซึ่งผู้ดำเนินการ หรือผู้ขออนุญาตจะต้องจัดทำเมื่อได้รับอนุญาตให้ดำเนินโครงการหรือกิจการแล้ว พ.ศ.2561 ทางบริษัท พีทีที ฟีนอล จำกัด จึงขอส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงงานผลิตสารบิสฟีนอล เอ ครั้งที่ 2/2564 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ.2564 ดังรายละเอียดตามสิ่งที่ส่งมาด้วย เพื่อให้หน่วยงานของท่านพิจารณาและดำเนินการตามขั้นตอนต่อไป

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ

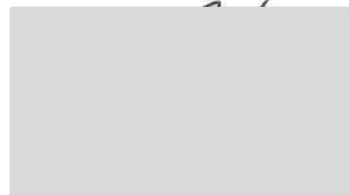

กรรมการผู้จัดการ  
บริษัท พีทีที ฟีนอล จำกัด

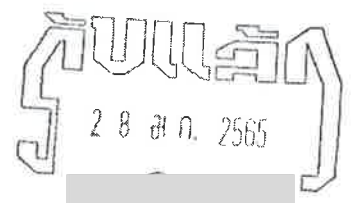

## ภาคผนวก ข.2-2

---

สำเนาหนังสือนำเสนอรายงานผลการดำเนินงาน  
ตามแผนบริหารจัดการความเสี่ยงฯ  
สรุปผลการศึกษา วิเคราะห์  
และทบทวนการดำเนินงานที่มีความเสี่ยง



## บริษัท พีทีที ฟีนอล จำกัด

สำนักงานใหญ่ : เลขที่ 555/1 ศูนย์อเนกประสงค์ คอมเพล็กซ์  
อาคาร เอ ชั้น 15 ถนนวิภาวดีรังสิต แขวงจตุจักร  
เขตจตุจักร กรุงเทพมหานคร 10900  
โทรศัพท์ : +66 (0)2265-8400  
โทรสาร : +66 (0)2265-8125

สำนักงานระยอง : เลขที่ 9 ซอยจ 9 นิคมอุตสาหกรรมเหมราชตะวันออก  
ถนนปิ่นสักมิตรีสายท่าเรือ ตำบลนาตาขวัญ  
อำเภอเมืองระยอง จังหวัดระยอง 21150  
โทรศัพท์ : +66 (0)3864-3901  
โทรสาร : +66 (0)3864-3864

ที่ PPCL362/2564

28 ธันวาคม 2564

เรื่อง นำส่งรายงานผลการดำเนินงานตามแผนบริหารจัดการความเสี่ยงฯ


เรียน ผู้อำนวยการสำนักงานนิคมอุตสาหกรรมร่วมดำเนินงานกลุ่มมาบตาพุด

สิ่งที่ส่งมาด้วย แผ่นบันทึกข้อมูล (CD-ROM) รายงานผลการดำเนินงานตามแผนบริหารจัดการความเสี่ยงฯ ของโรงงานผลิตสารฟีนอลและอะซิโตน จำนวน 1 แผ่น และ โรงงานผลิตบิสฟีนอล เอ จำนวน 1 แผ่น

ตามที่ กนอ. ได้ออกประกาศ กนอ.ที่ 62/2555 เรื่อง การรายงานผลการดำเนินงานตามแผนบริหารจัดการความเสี่ยงตามที่กำหนดไว้ในรายงานการวิเคราะห์ความเสี่ยงอันตรายที่อาจเกิดจากการประกอบกิจการโรงงาน ลงวันที่ 24 กันยายน 2555 นั้น โดยมีการกำหนดให้ผู้ประกอบกิจการโรงงาน นำส่งรายงานผลการดำเนินงานตามแผนบริหารจัดการความเสี่ยงฯ ต่อผู้อำนวยการสำนักงานนิคมอุตสาหกรรมฯ ทุก ๆ 1 ปี

บัดนี้ บริษัท พีทีที ฟีนอล จำกัด โรงงานผลิตสารฟีนอลและอะซิโตน ทะเบียนโรงงานเลขที่ น.42(1)-2/2548-ญหอ. และ โรงงานผลิตสารบิสฟีนอล เอ ทะเบียนโรงงานเลขที่ น.42(1)-4/2551-ญหอ. ได้ดำเนินการจัดทำรายงานผลการดำเนินงานตามแผนบริหารจัดการความเสี่ยงฯ จากอันตรายที่อาจเกิดจากการประกอบกิจการโรงงาน เสร็จเรียบร้อยแล้ว จึงขอส่งรายงานดังกล่าวให้กับสำนักงานนิคมอุตสาหกรรมร่วมดำเนินงาน กลุ่มมาบตาพุดเพื่อดำเนินการต่อไป

จึงเรียนมาเพื่อโปรดทราบ

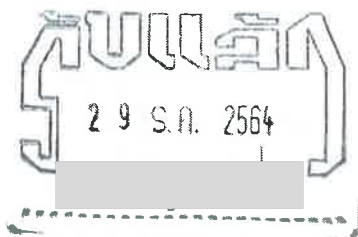

ขอแสดงความนับถือ

กรรมการผู้จัดการ



แจ้งบริษัท ปตท. จำกัด (มหาชน) PTT Phenol (3803)



## PTT Phenol Company Limited

Head Office : 555/1 Energy Complex, Building A,  
15<sup>th</sup> Floor, Vibhavadi Rangsit Road,  
Chatuchak, Chatuchak, Bangkok 10900  
Tel no. : +66 (0)2265-8400  
Fax no. : +66 (0)2265-8125

Rayong Office : 9 Soi G-9, Hemaraj Eastern Industrial Estate,  
Pakorn Songkhraorat Road, Tambon Map Ta Phut,  
Amphur Muang, Rayong 21150, Thailand  
Tel no. : +66 (0)3864-3901  
Fax no. : +66 (0)3864-3864

ที่ PPCL 462/2560

6 ธันวาคม 2560

กรมโรงงานอุตสาหกรรม
เลขที่ 31120
วันที่ 06 ธ.ค. 2560
เวลา 9.35%

เรื่อง นำส่งรายงานผลการทบทวนการวิเคราะห์ความเสี่ยงจากอันตรายที่อาจเกิดจากการประกอบกิจการ โรงงานบิสฟีนอล เอ เลขทะเบียนโรงงาน น.42(1)-4/2551-อุทอ.

เรียน อธิบดีกรมโรงงานอุตสาหกรรม


สิ่งที่ส่งมาด้วย 1. รายงานผลการทบทวนการวิเคราะห์ความเสี่ยงจากอันตรายที่อาจเกิดจากการประกอบกิจการ โรงงาน ของโรงงานผลิตสารบิสฟีนอล เอ จำนวน 13 เล่ม พร้อม CD-ROM จำนวน 2 แผ่น

ตามประกาศกระทรวงอุตสาหกรรม ฉบับที่ 3 (พ.ศ.2542) ออกตามความในพระราชบัญญัติโรงงาน พ.ศ. 2535 เรื่องมาตรการคุ้มครองความปลอดภัยในการดำเนินงาน ซึ่งระบุให้สถานประกอบกิจการต้องมีการทบทวนรายงานการวิเคราะห์ความเสี่ยงทุก ๆ 5 ปี

บัดนี้ บริษัท พีทีที ฟีนอล จำกัด โดยโรงงานผลิตสารบิสฟีนอล เอ เลขทะเบียนโรงงาน น.42(1)-4/2551-อุทอ. ได้ดำเนินการทบทวนรายงานการวิเคราะห์ความเสี่ยงจากอันตรายที่อาจเกิดจากการประกอบกิจการ โรงงานเสร็จเรียบร้อยแล้ว จึงขอ นำส่งรายงานดังกล่าวให้กับกรมโรงงานอุตสาหกรรม เพื่อดำเนินการต่อไป

จึงเรียนมาเพื่อโปรดทราบ

10 ก.ย. 1 95 4 0607

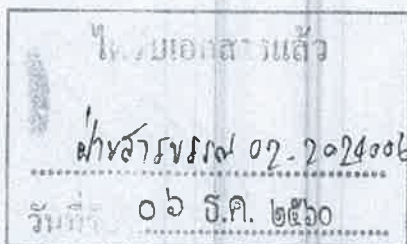

ขอแสดงความนับถือ

กรรมการผู้จัดการ

แจ้งบริษัท ปตท. จำกัด (มหาชน) PTT phenol sr. 07

4 Dec 1 9507

สรุปจำนวน Node และจำนวนแผนควบคุมความเสี่ยง โรงงานผลิตสารบิสฟีนอล เอ

แผนงานบริหารจัดการความเสี่ยง (แผนงานควบคุมความเสี่ยง)  
โรงงานผลิตบิสฟีนอลเอ บริษัท พีทีที ฟีนอล จำกัด

แผนงานบริหารจัดการความเสี่ยง (แผนงานควบคุมความเสี่ยง)


แผนควบคุม (1-4)

HAZOP 1: Feed Preparation Section (Unit 1100) (NODE 4)

หน้าที่ 2/7





















ภาคผนวก ข.2-3

---

สำเนาหนังสือแจ้งแผนการตรวจสอบผลการปฏิบัติตาม  
มาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม  
ประจำปี พ.ศ.2565



## บริษัท พีทีที ฟีนอล จำกัด

สำนักงานใหญ่ : เลขที่ 555/1 ถนนโยนเบอร์รี่ คอมเพล็กซ์  
อาคาร เอ ชั้น 15 ถนนวิภาวดีรังสิต แขวงจตุจักร  
เขตจตุจักร กรุงเทพมหานคร 10900  
โทรศัพท์ : +66 (0)2265-8400  
โทรสาร : +66 (0)2265-8125

สำนักงานระยอง : เลขที่ 9 ซอยจี 9 นิคมอุตสาหกรรมเหมราชตะวันออก  
ถนนปกรณสงเคราะห์ราษฎร์ ตำบลบางตาพูด  
อำเภอเมืองระยอง จังหวัดระยอง 21150  
โทรศัพท์ : +66 (0)3864-3901  
โทรสาร : +66 (0)3864-3864

ที่ PPCL 017/2565

14 มกราคม 2565

เรื่อง ขอส่งหนังสือแจ้งแผนการตรวจสอบผลการปฏิบัติตามมาตรการป้องกันแก้ไขผลกระทบสิ่งแวดล้อม โครงการโรงงานผลิตสารบิสฟีนอล เอ ประจำปี 2565

เรียน ผู้อำนวยการสำนักงานนิคมอุตสาหกรรมดับบลิวเอชเอตะวันออก (มาบตาพุด)

สิ่งที่ส่งมาด้วย 1.แผนการตรวจสอบผลการปฏิบัติตามมาตรการป้องกันแก้ไขผลกระทบสิ่งแวดล้อมโครงการโรงงานผลิตสารบิสฟีนอล เอ ประจำปี 2565

ตามที่บริษัท พีทีที ฟีนอล จำกัด ได้รับความเห็นชอบจากสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อมให้ดำเนินการ โครงการ โรงงานผลิตสารบิสฟีนอล เอ ตั้งอยู่ที่นิคมอุตสาหกรรมดับบลิวเอชเอตะวันออก (มาบตาพุด) เลขที่ 9 ซอยจี 9 ถนน ปกรณสงเคราะห์ราษฎร์ ต. มาบตาพุด อ. เมือง จ. ระยอง ประกอบกิจการปิโตรเคมี ผลิตสารบิสฟีนอล เอ (BPA) ทะเบียนผู้ประกอบการอุตสาหกรรมเลขที่ น.42 (1) -4/2551-ญหอ. และกำหนดให้โครงการต้องจัดทำรายงานสรุปผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม ช่วงก่อสร้างและช่วงดำเนินการ เป็นประจำปีละ 2 ครั้ง

บริษัทฯ จึงได้มอบหมายให้บริษัท เอ็นพีซี เซฟตี้ แอนด์ เอ็นไวรอนเมนทอล เซอร์วิส จำกัด เป็นบริษัทที่ปรึกษา เพื่อติดตามมาตรการป้องกันและแก้ไขผลกระทบด้านสิ่งแวดล้อมฯ รวมถึงจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมฯ ดังกล่าว และบัดนี้บริษัทที่ปรึกษา ได้แจ้งแผนการตรวจสอบผลการปฏิบัติตามมาตรการป้องกันแก้ไขผลกระทบสิ่งแวดล้อม โดยมีรายละเอียดดังสิ่งที่แนบมานี้

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ

ผู้จัดการสิ่งแวดล้อม

รับแล้ว  
14 ม.ค. 2565



แผนการตรวจวัดคุณภาพสิ่งแวดล้อมของโครงการโรงงานผลิตสารบิสฟีนอล เอ (รายงานเปลี่ยนแปลงฯ ครั้งที่ 6) ของบริษัท พีทีที ฟีนอล จำกัด ประจำปีพ.ศ. 2565  
 การตรวจติดตามมาตรการป้องกันและแก้ไขผลกระทบต่อสิ่งแวดล้อม : บริษัท เอ็นพีซี เซฟตี้ แอนด์ เอ็นไวรอนเมนทอล เซอร์วิส จำกัด และ บริษัท ซิโคท จำกัด  
 บริษัทตรวจวัดคุณภาพสิ่งแวดล้อม : บริษัท ซิโคท จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน 2-239

คุณภาพสิ่งแวดล้อม	พารามิเตอร์	สถานีตรวจวัด	ความถี่	ช่วงเวลาทำการตรวจวัด	
ระยะก่อสร้าง					
คุณภาพอากาศในบรรยากาศ	TSP เฉลี่ย 24 ชั่วโมง	พื้นที่ก่อสร้าง	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง		ช่วงที่มีกิจกรรมก่อสร้าง
	PM10 เฉลี่ย 24 ชั่วโมง	พื้นที่ก่อสร้าง	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง		ช่วงที่มีกิจกรรมก่อสร้าง
	WS&WD	พื้นที่ก่อสร้าง	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง		ช่วงที่มีกิจกรรมก่อสร้าง
ระดับเสียง	Leq24 hr, L90	พื้นที่ก่อสร้าง	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง		ช่วงที่มีกิจกรรมก่อสร้าง
ระยะดำเนินการ					
คุณภาพอากาศในบรรยากาศ	Non-methane hydrocarbon, WS&WD	ชุมชนหนองแฟบ (A1)	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง ช่วงเดียวกับการตรวจวัดปล่อย	สัปดาห์ที่ 1-2	พ.ค. และ พ.ย.
	Non-methane hydrocarbon, WS&WD	ชุมชนบางซูลด (A2)	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง ช่วงเดียวกับการตรวจวัดปล่อย	สัปดาห์ที่ 1-2	พ.ค. และ พ.ย.
	Non-methane hydrocarbon, WS&WD	ชุมชนบางซูลด-ซากกลาง (A3)	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง ช่วงเดียวกับการตรวจวัดปล่อย	สัปดาห์ที่ 1-2	พ.ค. และ พ.ย.
คุณภาพอากาศจากปล่อง	Acetone, Phenol	ปล่อง Charcoal Adsorber D-1905	2 ครั้งต่อปี ช่วงเดียวกับการตรวจวัดคุณภาพอากาศในบรรยากาศ	สัปดาห์ที่ 1-2	พ.ค. และ พ.ย.
	Total VOCs	ปล่อง Charcoal Adsorber D-9201	2 ครั้งต่อปี ช่วงเดียวกับการตรวจวัดคุณภาพอากาศในบรรยากาศ	สัปดาห์ที่ 1-2	พ.ค. และ พ.ย.
	Total VOCs	ปล่อง Charcoal Adsorber D-9202	2 ครั้งต่อปี ช่วงเดียวกับการตรวจวัดคุณภาพอากาศในบรรยากาศ	สัปดาห์ที่ 1-2	พ.ค. และ พ.ย.
	Total VOCs	ปล่อง Charcoal Adsorber D-1906	2 ครั้งต่อปี ช่วงเดียวกับการตรวจวัดคุณภาพอากาศในบรรยากาศ	สัปดาห์ที่ 1-2	พ.ค. และ พ.ย. และตรวจวัดกรณีที่มี Shutdown
คุณภาพน้ำ	Acetone	น้ำที่หมุนเวียนในระบบดักจับไอระเหยอะซิโตนด้วยน้ำในระบบ Acetone Scrubber Stack D-1904	2 ครั้งต่อเดือน	พฤหัสบดีที่ 1 ของเดือน และพฤหัสบดีที่ 3 ของเดือน	ม.ค.-ธ.ค.
	Phenol	น้ำที่หมุนเวียนในระบบดักจับไอระเหยฟีนอลด้วยน้ำในระบบ Phenol Scrubber Stack D-1903	2 ครั้งต่อเดือน	พฤหัสบดีที่ 1 ของเดือน และพฤหัสบดีที่ 3 ของเดือน	ม.ค.-ธ.ค.
	pH, Temperature, SS, COD, BOD <sub>5</sub> , TDS, Phenol, Oil&Grease, Ethylbenzene	บริเวณบ่อ Equalization Tank	1 ครั้งต่อเดือน	พฤหัสบดีที่ 1 ของเดือน	ม.ค.-ธ.ค.
	pH, Temperature, SS, COD, BOD <sub>5</sub> , TDS, Phenol, Oil&Grease, Ethylbenzene	บริเวณบ่อพิกษาทิ้ง (Final Polishing Tank) ขนาด 1,200 ลบ.ม.	1 ครั้งต่อเดือน	พฤหัสบดีที่ 1 ของเดือน	ม.ค.-ธ.ค.
คุณภาพดิน	Phenol, Acetone	บ่อสังเคราะห์การ 1 (UW10)	ทุก 3 ปี (ดำเนินการครั้งสุดท้ายปี พ.ศ. 2564)	-	ครบกำหนดครั้งถัดไปในปี พ.ศ. 2567



แผนการตรวจวัดคุณภาพสิ่งแวดล้อมของโครงการโรงงานผลิตสารบิสฟีนอล เอ (รายงานเปลี่ยนแปลง ครั้งที่ 6) ของบริษัท พีทีที ฟีนอล จำกัด ประจำปีพ.ศ. 2565  
 การตรวจติดตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม : บริษัท เอ็นพีซี เซฟตี้ แอนด์ เอ็นไวรอนเมนทอล เซอร์วิส จำกัด และ บริษัท ซิคอท จำกัด  
 บริษัทตรวจวัดคุณภาพสิ่งแวดล้อม : บริษัท ซิคอท จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-239

คุณภาพสิ่งแวดล้อม	พารามิเตอร์	สถานีตรวจวัด	ความถี่	ช่วงเวลาทำการตรวจวัด	
	Phenol, Acetone	บ่อสังเคราะห์ 2 (UW11)	ทุก 3 ปี (ดำเนินการครั้งสุดท้ายปี พ.ศ. 2564)	-	ครบกำหนดครั้งถัดไปในปี พ.ศ. 2567
	Phenol, Acetone	บ่อสังเคราะห์ 3 (UW8)	ทุก 3 ปี (ดำเนินการครั้งสุดท้ายปี พ.ศ. 2564)	-	ครบกำหนดครั้งถัดไปในปี พ.ศ. 2567
คุณภาพน้ำใต้ดิน	Phenol, Acetone	บ่อสังเคราะห์ 1 (UW10)	2 ครั้งต่อปี	สัปดาห์ที่ 1-2	พ.ค. และ ต.ค.
	Phenol, Acetone	บ่อสังเคราะห์ 2 (UW11)	2 ครั้งต่อปี	สัปดาห์ที่ 1-2	พ.ค. และ ต.ค.
	Phenol, Acetone	บ่อสังเคราะห์ 3 (UW8)	2 ครั้งต่อปี	สัปดาห์ที่ 1-2	พ.ค. และ ต.ค.
ระดับเสียง	Leq24 hr	บริเวณริมรั้วโครงการด้านทิศใต้ (N1)	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง	สัปดาห์ที่ 1-2	มี.ค. และ ก.ย.
	Leq24 hr	บริเวณริมรั้วโครงการด้านทิศตะวันออก (N2)	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง	สัปดาห์ที่ 1-2	มี.ค. และ ก.ย.
	Leq24 hr	บริเวณชุมชนหนองแฟบ (N3)	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง	สัปดาห์ที่ 1-2	มี.ค. และ ก.ย.
	ระดับเสียงพื้นฐาน, ระดับเสียงรบกวน	บริเวณชุมชนหนองแฟบ (N3)	2 ครั้งต่อปี ครั้งละ 7 วันต่อเนื่อง	สัปดาห์ที่ 1-2	มี.ค. และ ก.ย.
	Noise Contour Map	ภายในพื้นที่โครงการ	ทบทวนและจัดทำ Noise Contour Map ทุก 3 ปี หรือกรณีที่มีการเปลี่ยนแปลงกระบวนการผลิต ซึ่งอาจส่งผลให้ระดับเสียงในพื้นที่โครงการมีการเปลี่ยนแปลง		ก.ย.
คุณภาพอากาศในสถานประกอบการ	Phenol	บริเวณถังเก็บก๊าซสารฟีนอล	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
	Phenol	บริเวณหน่วยผลิตสารบิสฟีนอล เอ	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
	Acetone	บริเวณถังเก็บก๊าซสารอะซิโตน	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
	Acetone	บริเวณหน่วยผลิตสารบิสฟีนอล เอ	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
	Ethylbenzene	บริเวณถังเก็บก๊าซสารเอทิลเบนซีน	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
	Ethylbenzene	บริเวณระบบบำบัดน้ำเสีย	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
	Non-methane hydrocarbon	บริเวณหน่วยผลิตสารบิสฟีนอล เอ	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
ระดับเสียงในสถานประกอบการ	ระดับเสียงเฉลี่ยตลอดระยะเวลาทำงาน	บริเวณเครื่องอัดอากาศ	2 ครั้งต่อปี		พ.ค. และ พ.ย.
	ระดับเสียงเฉลี่ยตลอดระยะเวลาทำงาน	ระบบหล่อเย็น	2 ครั้งต่อปี		พ.ค. และ พ.ย.
	ปริมาณเสียงสะสมที่ตัวพนักงาน และคำนวณระดับเสียงเฉลี่ยตลอดระยะเวลาการทำงาน (Time Weighted Average-TWA)	พนักงานทุกคนที่ปฏิบัติงานในพื้นที่ที่สัมผัสเสียงดัง	2 ครั้งต่อปี		พ.ค. และ พ.ย.





แผนการตรวจวัดคุณภาพสิ่งแวดล้อมของโครงการโรงงานผลิตสารบิสฟีนอล เอ (รายงานเปลี่ยนแปลงฯ ครั้งที่ 6) ของบริษัท พีทีที ฟีนอล จำกัด ประจำปีพ.ศ. 2565

การตรวจติดตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมฯ : บริษัท เอ็นพีซี เซฟตี้ แอนด์ เอ็นไวรอนเม้นทอล เซอร์วิส จำกัด และ บริษัท ซีคอฟ จำกัด

บริษัทตรวจวัดคุณภาพสิ่งแวดล้อม : บริษัท ซีคอฟ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน 7-239

คุณภาพสิ่งแวดล้อม	พารามิเตอร์	สถานที่ตรวจวัด	ความถี่	ช่วงเวลาทำการตรวจวัด	
ระดับความร้อนในสถานประกอบการ	ระดับ Heat Stress Index ในรูป WBGT	บริเวณหน่วยผลิตสารบิสฟีนอล เอ	ปีละ 1 ครั้ง ในเดือนที่มีอากาศร้อนที่สุดของปี		เม.ย.
ตรวจวัดสารเคมีที่ตัวผู้ปฏิบัติงาน	Phenol, Acetone, Ethylbenzene	พนักงาน OSBL	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
	Phenol, Acetone, Ethylbenzene	พนักงาน ISBL	4 ครั้งต่อปี		ก.พ., พ.ค., ส.ค. และ พ.ย.
การตรวจติดตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมฯ (Audit)			ปีละ 2 ครั้ง		เม.ย.-พ.ค. และ ต.ค.-พ.ย.

## ภาคผนวก ข.2-4

---

หนังสือแจ้งสำนักงานนิคมอุตสาหกรรมร่วมดำเนินงานกลุ่มมาบตาพุด  
กรณีมีการซ่อมบำรุงเครื่องจักรและอุปกรณ์ประจำปี  
(Shutdown/Turnaround)  
และการเริ่มกระบวนการผลิต (Pre-Startup)



## PTT Phenol Company Limited

Head Office : 555/1 Energy Complex, Building A,  
15<sup>th</sup> Floor, Vibhavadi Rangsit Road,  
Chatuchak, Chatuchak, Bangkok 10900  
Tel no. : +66 (0)2265-8400  
Fax no. : +66 (0)2265-8125

Rayong Office : 9 Soi G-9, Hemaraj Eastern Industrial Estate,  
Pakorn Songkhraorat Road, Tambon Map Ta Phut,  
Amphur Muang, Rayong 21150, Thailand  
Tel no. : +66 (0)3864-3901  
Fax no. : +66 (0)3864-3864

ที่ PPCL355/2565

วันที่ 25 กุมภาพันธ์ 2565

เรื่อง ขอแจ้งการดำเนินการงานหยุดซ่อมบำรุงประจำปี (Mini Shutdown) ประจำปี 2565 ของโรงงานผลิตสารบิสฟีนอล เอ ระหว่างวันที่ 15-17 มีนาคม พ.ศ. 2565

เรียน ผู้อำนวยการ สำนักงานนิคมอุตสาหกรรมร่วมดำเนินงานกลุ่มมาบตาพุด

สำเนาถึง ผู้จัดการอาวุโสฝ่ายปฏิบัติการและบำรุงรักษา นิคมอุตสาหกรรมดับบลิวเอชเอ ตะวันออก (มาบตาพุด)

อ้างถึง 1. ประกาศการนิคมอุตสาหกรรมแห่งประเทศไทย ที่ 67/2557 เรื่องการซ่อมบำรุงใหญ่สำหรับผู้ประกอบการกิจการ (Shutdown/Turnaround) ในการนิคมอุตสาหกรรมและท่าเรืออุตสาหกรรมพื้นที่มาบตาพุด

สิ่งที่ส่งมาด้วย

1. แบบรายงานแจ้งการดำเนินการหยุดซ่อมบำรุงใหญ่ ของผู้ประกอบการพื้นที่นิคมอุตสาหกรรม และท่าเรืออุตสาหกรรมมาบตาพุด
2. เอกสารแจ้งกิจกรรมและมาตรการต่างๆของงานงานหยุดซ่อมบำรุงประจำปี (Mini Shutdown) ประจำปี 2565 ของ โรงงานผลิตสารบิสฟีนอล เอ จากระหว่าง วันที่ 15-17 มีนาคม พ.ศ. 2565

เนื่องจาก บริษัท พีทีที ฟีนอล จำกัด จะดำเนินการงานงานซ่อมบำรุงประจำปี (Mini Shutdown) ประจำปี 2565 ของ โรงงานผลิตสารบิสฟีนอล เอ ระหว่างวันที่ 15-17 มีนาคม พ.ศ. 2565

เพื่อความสอดคล้องตามสิ่งที่อ้างถึงข้างต้น ทางบริษัท พีทีที ฟีนอล จำกัด จึงขอส่งเอกสารรายละเอียดการ ดำเนินการและมาตรการต่างๆของงานซ่อมบำรุง ดังที่ได้แนบมาในหนังสือฉบับนี้

ทางบริษัท พีทีที ฟีนอล จำกัด จึงขอแจ้งรายละเอียดเกี่ยวกับการดำเนินงานดังกล่าว ให้กับทางสำนักงานนิคม อุตสาหกรรมดับบลิว เอช เอ ตะวันออก (มาบตาพุด) เพื่อรับทราบ และสื่อสารไปยังหน่วยงานที่เกี่ยวข้องต่อไป

อนึ่งทางบริษัทฯ ได้ทำการแจ้งหน่วยงานอื่นๆ / โรงงานข้างเคียง / ชุมชน ให้ทราบแล้ว

ขอแสดงความนับถือ

ผู้จัดการส่วนความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม

กบแฉก  
25 ก.พ. 2565



## PTT Phenol Company Limited

Head Office : 555/1 Energy Complex, Building A,  
15<sup>th</sup> Floor, Vibhavadi Rangsit Road,  
Chatuchak, Chatuchak, Bangkok 10900  
Tel no. : +66 (0)2265-8400  
Fax no. : +66 (0)2265-8125

Rayong Office : 9 Soi G-9, Hemaraj Eastern Industrial Estate,  
Pakorn Songkhraorat Road, Tambon Map Ta Phut,  
Amphur Muang, Rayong 21150, Thailand  
Tel no. : +66 (0)3864-3901  
Fax no. : +66 (0)3864-3864

ที่ PPCL518/2565

วันที่ 17 มีนาคม 2565

เรื่อง ขอแจ้งการดำเนินการเดินเครื่องตามปกติหลังจากงานหยุดซ่อมบำรุงประจำปี (Mini Shutdown) ประจำปี 2565 ของโรงงานผลิตสารบิสฟีนอล เอ ระหว่างวันที่ 15-17 มีนาคม พ.ศ. 2565

เรียน ผู้อำนวยการ สำนักงานนิคมอุตสาหกรรมร่วมดำเนินงานกลุ่มมาบตาพุด

สำเนาถึง ผู้จัดการอาวุโสฝ่ายปฏิบัติการและบำรุงรักษา นิคมอุตสาหกรรมดับบลิวเอชเอ ตะวันออก (มาบตาพุด) อ้างถึง

1. ประกาศการนิคมอุตสาหกรรมแห่งประเทศไทย ที่ 67/2557 เรื่องการซ่อมบำรุงใหญ่สำหรับผู้ประกอบการ กิจการ (Shutdown/Turnaround) ในการนิคมอุตสาหกรรมและท่าเรืออุตสาหกรรมพื้นที่มาบตาพุด
2. หนังสือขอแจ้งการดำเนินการงานหยุดซ่อมบำรุงประจำปี (Mini Shutdown) ประจำปี 2565 ของ โรงงานผลิตสารบิสฟีนอล เอ ระหว่างวันที่ 15-17 มีนาคม พ.ศ. 2565 (หนังสือเลขที่ PPCL355/2565 ลง วันที่ 25 กุมภาพันธ์ 2565 )

สิ่งที่ส่งมาด้วย

1. เอกสาร Pre-Startup Safety Review (PSSR) ของงานหยุดซ่อมบำรุงประจำปี (Mini Shutdown) ประจำปี 2565 ของโรงงานผลิตสารบิสฟีนอล เอ

เนื่องจากบริษัท พีทีที ฟีนอล จำกัด โรงงานผลิตสารบิสฟีนอล เอ ได้ดำเนินการงานหยุดซ่อมบำรุง ประจำปี (Mini Shutdown) ประจำปี 2565 เสร็จเรียบร้อยแล้วตามแผนงาน และได้เริ่มเดินระบบของโรงงานผลิต สารบิสฟีนอล เอ ตามเอกสารเรียบร้อยแล้ว

บัดนี้ทางบริษัทจึงขอแจ้งการดำเนินการเดินเครื่องตามปกติหลังจากงานหยุดซ่อมบำรุงประจำปี (Mini Shutdown) ประจำปี 2565

ขอแสดงความนับถือ

ผู้จัดการส่วนความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม

รับแล้ว  
17 มี.ค. 2565

ภาคผนวก ข.2-5

---

คู่มือการตรวจประเมินโรงงานตามแผนปฏิบัติการลดและขจัดมลพิษ  
ของผู้ประกอบการกลุ่มอุตสาหกรรมพื้นที่มาบตาพุด

















ภาคผนวก ข.2-6

---

การทบทวนอุบัติภัย/อุบัติเหตุที่มีลักษณะเดียวกับโครงการ

สารจาก QSE อุบัติเหตุชั้นบันทึก รายที่ 9/2565

เรื่อง ผู้รับเหมาล้มตัวลงนอนที่ค้างในอุปกรณ์ (เยื่อตาอักเสบ)

### รายละเอียดของเหตุการณ์ (Incident Description)

ขณะที่ทีมผู้รับเหมา ที่อยู่บน Platform ชั้น 3 ทำการคลายน็อตเพื่อถอดหน้าแปลน nozzle outlet ปรากฏว่ามีน้ำปนเปื้อนที่ค้างในท่อหลังจากการทำความสะอาดอุปกรณ์ ไหลออกมาแล้วกระเด็นถูกผู้บาดเจ็บ ซึ่งนั่งพักที่ Platform ชั้น 2 (สวมใส่แว่นตานิรภัย แต่ไม่ได้ใส่ Face shield) จึงได้ล้างตัว และล้างหน้าด้วยน้ำดื่ม ต่อมามีอาการแสบตา หัวหน้างานพบเห็นจึงพามารับการปฐมพยาบาลที่ห้องพยาบาลแล้วส่งต่อโรงพยาบาลให้แพทย์ประเมินว่าเยื่อตาอักเสบ มีจ่ายยาปฏิชีวนะ จัดเป็น Medical Treatment Case



รูปสีน้ำเงิน แสดงตำแหน่งคนงานเปิดหน้าแปลน 100-E7  
รูปสีน้ำแดง แสดงตำแหน่งผู้บาดเจ็บ



เปิดหน้าแปลน 100-E7



ตำแหน่งผู้บาดเจ็บ

### สาเหตุเกิดจากอะไร?

1. มีน้ำตกค้างจากการทำความสะอาดอุปกรณ์ด้วยไอน้ำ
2. ไม่ได้จัดเตรียมภาชนะหรือถาดรองรับน้ำปนเปื้อนที่อาจตกค้างในอุปกรณ์สำหรับการเปิดหน้าแปลนครั้งแรก (First line breaking)
3. ขาดการสื่อสารให้ผู้ปฏิบัติงานที่อาจได้รับผลกระทบจากน้ำปนเปื้อนที่ตกค้างในอุปกรณ์ได้ทราบและออกจากพื้นที่ในวิธีอันตราย (Line of Fire)

### เราได้เรียนรู้อะไร?

1. การตัดแยก (Isolation) ต้องตรวจสอบการตกค้างของน้ำในอุปกรณ์ ก่อนส่งมอบให้ทีมผู้ปฏิบัติงาน
2. การเปิดหน้าแปลนครั้งแรก (First line breaking) ตระหนักเสมอว่าอาจมีสารตกค้างอยู่ภายในอุปกรณ์ และต้องจัดเตรียมภาชนะรองรับ
3. ต้องประเมินและสื่อสารให้เพื่อนร่วมงานที่อาจได้รับผลกระทบ หรืออยู่ในวิธีอันตรายทราบและเพื่อออกจากบริเวณดังกล่าว

### เราต้องทำอะไร เพื่อป้องกันการเกิดเหตุซ้ำ?

1. Operation ต้องตรวจสอบการตกค้างของน้ำหรือสารเคมีในอุปกรณ์ ในขั้นตอนการตัดแยก เช่น เปิด Low point drain ก่อนส่งมอบให้ผู้ปฏิบัติงาน
2. ประเมินความเสี่ยง (JSEA) และปฏิบัติตามขั้นตอนการดำเนินงาน เปิดหน้าแปลนครั้งแรก (First Line Breaking)
3. ทำ Effective toolbox talk ย้ำเตือนให้ตระหนักเสมอว่าอาจมีสารตกค้างอยู่ภายในอุปกรณ์ และต้องมีมาตรการป้องกัน เช่น เตรียมภาชนะรองรับที่เหมาะสม
4. ปิดล้อมพื้นที่ และสื่อสารแจ้งเตือนเพื่อนร่วมงานให้ออกจากวิธีอันตราย (Line of Fire)

ผู้ช่วยกรรมการผู้จัดการใหญ่

สายงานคุณภาพ ความปลอดภัย อาชีวอนามัยและสิ่งแวดล้อม

**ภาคผนวก ข.2-7**

---

**เกณฑ์การคัดเลือกและประเมินคุณภาพห้องปฏิบัติการวิเคราะห์  
และการควบคุมการดำเนินการตรวจวัดคุณภาพสิ่งแวดล้อม  
ของหน่วยงานกลาง (Third Party)**

















**ภาคผนวก ข.2-8**

---

**ตำแหน่งติดตั้งอุปกรณ์ตรวจจับก๊าซ (Gas Detector)  
ของโครงการโรงงานผลิตสารบิสฟีนอล เอ**





## ภาคผนวก ข.2-9

---

### ระเบียบปฏิบัติ เรื่อง ขั้นตอนการบำรุงรักษา แผนตรวจสอบ/บำรุงรักษาในเชิงป้องกัน (Maintenance Management Procedure)



















Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-6103B	Q1-OSB-T6101-P6103B-PM6103B	PM-6103B-HP C/W Cir Pump	2M Motor Greasing	01-02-2022
Q-1-PM-6102B	Q1-OSB-T6101-P6102B-PM6102B	PM-6102B-C/W Cir Pump	4M Motor Greasing	01-02-2022
Q-1-C-6201	Q1-OSB-X6201-C6201	C-6201-COMPRESSOR	(6M) PM Refrigerator	31-01-2022
Q-1-00B01-VMS	Q1-OSB-5000	Electricity Distribution and Control	(1Y) Backup and Recovery HDD.	18-01-2022
Q-1-FGS	Q1-OSB-5000	Electricity Distribution and Control	(1Y) Backup and Recovery HDD.	18-01-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-P-6501A	Q1-OSB-TX6501-P6501A	P-6501A-Potable Water Pumps	6M Vibration Monitoring	28-01-2022
Q-1-PM-6104A	Q1-OSB-T6102-P6104A-PM6104A	PM-6104A-Reliable C/W calculation Pump	Motor Greasing	01-02-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	3M - PM 8HR (STOP MACHINE)	26-01-2022
Q-1-T-6102-3	Q1-OSB-T6102-T61023	T-6102-3-Reliable Cooling Tower No.3	1M-Replace oil gear box<->->-inspection	31-01-2022
Q-1-PM-1206	Q1-OSB-OX1201-P1206-PM1206	PM-1206-Oxidizer no.1 Pump	Motor Greasing	01-02-2022
Q-1-PM-1208A	Q1-OSB-D1205-P1208A-PM1208A	PM-1208A-Decanter Pump	Motor Greasing	01-02-2022
Q-1-PM-1209A	Q1-OSB-D1206-P1209A-PM1209A	PM-1209A-CHP Sump Pump	Motor Greasing	01-02-2022
Q-1-TM-6101-1	Q1-OSB-T6101-T61011-TM61011	TM-6101-1-Motor for Cooling Fan No.1	Motor Greasing	01-02-2022
Q-1-TM-6101-4	Q1-OSB-T6101-T61014-TM61014	TM-6101-4-Motor for Cooling Fan No.4	Motor Greasing	01-02-2022
Q-1-TM-6101-3	Q1-OSB-T6101-T61013-TM61013	TM-6101-3-Motor for Cooling Fan No.3	Motor Greasing	01-02-2022
Q-1-AP-5001	Q1-OSB-5004MCCAP5001B2-AP51	AP-5001-UPS Cfor Control @ CCR	RCM-3M UPS & DC CHARGER INSPECTION	01-02-2022
Q-1-AP-5002	Q1-OSB-5004MCCAP5002B-AP52	AP-5002-UPS for Swgr Control @ Main S/S	RCM-3M UPS & DC CHARGER INSPECTION	01-02-2022
Q-1-AP-5003	Q1-OSB-5004MCCAP5003B-AP53	AP-5003-DC Charger for Emer.Light @ S/S	RCM-3M UPS & DC CHARGER INSPECTION	01-02-2022
Q-2-PM-6051	Q2-OSB-6000	Phenol I	1M-Equipment Site Patrol	26-01-2022
Q-2-PM-6052	Q2-OSB-6000	Clarified Water System	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-X-2051	Q2-OSB-6000	Clarified Water System	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-X-2052	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) PM Oil Mist	14-01-2022
Q-2-X-2053	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1M) PM Oil Mist	14-01-2022
Q-2-PM-6152A	Q2-OSB-6150	Phenol Recovery Section	(1M) PM Oil Mist	14-01-2022
Q-2-PM-6152B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-PM-6152C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-PM-6152D	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-PM-6154A	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-PM-6154B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-PM-6154C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-LP-6151	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection cleaning re-lighten	28-01-2022
Q-2-WR-6151	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection cleaning re-lighten	28-01-2022
Q-2-TT-22-2003	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2004	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2005	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2006	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2007	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022

3 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-TT-22-2008	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2101	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2102	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2103	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2104	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-C-6251	Q2-OSB-6250	Chilled Water System	(6M) PM Refrigerator	17-12-2021
Q-2-C-5151A	Q2-OSB-5150	Instrument Air and Plant Air Systems	6M Vibration Monitoring	01-02-2022
Q-2-C-5151B	Q2-OSB-5150	Instrument Air and Plant Air Systems	6M Vibration Monitoring	01-02-2022
Q-2-C-5151C	Q2-OSB-5150	Instrument Air and Plant Air Systems	6M Vibration Monitoring	01-02-2022
Q-2-P-6051	Q2-OSB-6000	Clarified Water System	6M Vibration Monitoring	01-02-2022
Q-2-P-6052	Q2-OSB-6650	Steam System and Condensate system	6M Vibration Monitoring	01-02-2022
Q-2-P-6351A	Q2-OSB-6350	Tempered Water System	6M Vibration Monitoring	01-02-2022
Q-2-P-6352A	Q2-OSB-6350	Tempered Water System	6M Vibration Monitoring	01-02-2022
Q-2-PM-2102A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-01-2022
Q-2-PM-2214A	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	28-01-2022
Q-2-PM-2403A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-01-2022
Q-2-PM-4163A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	28-01-2022
Q-2-TM-6152A	Q2-OSB-6150	Phenol Recovery Section	Motor Greasing	28-01-2022
Q-2-TM-6152C	Q2-OSB-6150	Phenol Recovery Section	Motor Greasing	03-01-2022
Q-2-TM-6152D	Q2-OSB-6150	Phenol Recovery Section	Motor Greasing	28-01-2022
Q-2-PM-4162C	Q2-OSB-4100	Tank Gauging System	Motor Greasing	28-01-2022
Q-2-PM-2116A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-01-2022
Q-2-PM-2316A	Q2-OSB-2300	Phenol II Oxidation CDN Section	Motor Greasing	28-01-2022
Q-2-PM-2433A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-01-2022
Q-2-PM-4104A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	28-01-2022
Q-2-PM-6051	Q2-OSB-6000	Clarified Water System	Motor Greasing	28-01-2022
Q-2-PM-6351A	Q2-OSB-6350	Tempered Water System	Motor Greasing	28-01-2022
Q-2-PM-2104A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-01-2022
Q-2-PM-2112A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-01-2022
Q-2-PM-2203A	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	28-01-2022
Q-2-PM-2307A	Q2-OSB-2300	Phenol II Oxidation CDN Section	Motor Greasing	28-01-2022
Q-2-PM-2401A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-01-2022
Q-2-PM-2404A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-01-2022
Q-2-PM-2408A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	28-01-2022
Q-2-PM-4152A	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	28-01-2022
Q-2-PM-6652A	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	28-01-2022
Q-2-PM-6656A	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	28-01-2022
Q-2-AP-5055-01A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	28-01-2022
Q-2-AP-5055-01B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	28-01-2022
Q-2-AP-5055-02	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	28-01-2022
Q-2-AP-5055-03	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	28-01-2022
Q-2-AP-5055-04	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	28-01-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(1M) Archive HIST Data and Config. to CD	10-01-2022
Q-3-Z-1301	Q3-OSB-1300	PURIFICATION	1M-PM Oil Mist System	02-02-2022

2 of 89

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-1105	Q3	BPA	1M-Equipment Site Patrol	27-01-2022
Q-2-P-2418A	Q1-QMX-V1101-P1105-PM1105	PM-1105-Benzene Recycle Wash Pump	4M Motor Greasing	28-01-2022
Q-2-P-2419A	Q2-FRC-2400	Fractionation unit	3M-Relubricant	28-01-2022
Q-2-X-5051	Q2-FRC-2400	Fractionation unit	3M-Relubricant	28-01-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	6M-PM GEN, ENGINE 8HR	28-01-2022
Q-1-PM-6301B	Q2-OSB-5050	Electricity Distribution and Control	6M-PM GEN, ENGINE 8HR	28-01-2022
Q-1-PT-41-0105	Q1-OSB-TK6301-P6301B-PM6301B	PM-6301B-Tempered Water Cir Pump	6M PM AC motor(Visual Inspection)	01-02-2022
Q-1-PT-41-0102	Q1-OSB-TK4101B-PT410106	PT410106-Prop Header Press	4Y Calibration (2 Man / 2 Hr.)	13-01-2022
Q-1-PT-11-0301	Q1-OSB-TK4101B-PT410102	PT410102-TK-4101B Press	4Y Calibration (2 Man / 2 Hr.)	13-01-2022
Q-1-PT-41-0101	Q1-QMX-D1101A-X1102A-PT110301	PT110301-Prop Feed from Prop Feed Filter	4Y Calibration (2 Man / 2 Hr.)	13-01-2022
Q-2-X-2052	Q1-OSB-TK4101A-PT410101	PT410101-TK-4101A Press	4Y Calibration (2 Man / 2 Hr.)	13-01-2022
Q-2-X-2051	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(6M) PM Oil Mist	31-01-2022
Q-2-P-2304A	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(6M) PM Oil Mist	31-01-2022
Q-2-P-2316A	Q2-OCD-2300	Phenol II Oxidation CDN Section	(6M) Re-Lubricant	28-01-2022
Q-1-PVV-41-0901	Q2-OCD-2300	Phenol II Oxidation CDN Section	(6M) Re-Lubricant	28-01-2022
Q-1-PSV-61-0607	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV.2Hr	14-01-2022
Q-1-PM-1109A	Q1-OSB-T6101-P6105-PSV610607	PSV610607-P-6105 Disch	2Y-Test&Calibrate,24Hr	14-01-2022
Q-1-PM-1108A	Q1-QMX-V1102-P1109A-PM1109A	PM-1109A-Cum Colm Bottoms Pump	4M Motor Greasing	28-01-2022
Q-1-C-9132A	Q1-QMX-V1101-P1108A-PM1108A	PM-1108A-Benzene Colm Bottoms Pump	4M Motor Greasing	28-01-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1M-Replace Lube Oil	28-01-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1M-Replace Lube Oil	28-01-2022
Q-1-C-9132D	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1M-Replace Lube Oil	28-01-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	28-01-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	28-01-2022
Q-1-VLP-00-001	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	28-01-2022
Q-1-VLP-00-002	Q1-OSB-FMCCB001-VLP00001	VLP-00-001 VESDA	(2M) PM VESDA Visual Inspection	25-01-2022
Q-1-GD-11-0001	Q1-OSB-6904	Firewater & Raw Water Sys. & Gas Detect.	(2M) PM VESDA Visual Inspection	25-01-2022
Q-1-GD-11-0002	Q1-QMX-GD11-001	GD110001 Multi Sensing Gas DET	6M Calibrate Portabel Gas DET.	25-01-2022
Q-1-GD-11-0003	Q1-QMX-GD11-002	GD110002 Total VOC (Mini REA3000)	6M Calibrate Portabel Gas DET.	25-01-2022
Q-1-GD-11-0004	Q1-QMX-GD11-003	GD110003 Benzene Detector(Ultra REA3000)	6M Calibrate Portabel Gas DET.	25-01-2022
Q-1-GD-14-0001	Q1-QMX-GD11-004	GD110004 Oxygen Alert	6M Calibrate Portabel Gas DET.	25-01-2022
Q-1-GD-14-0002	Q1-FRC-GD14-001	GD140001 Multi Sensing Gas DET	6M Calibrate Portabel Gas DET.	25-01-2022
Q-1-PM-1206	Q1-FRC-GD14-002	GD140002 Total VOC (Mini REA3000)	6M Calibrate Portabel Gas DET.	25-01-2022
Q-2-FRD-20-0003A	Q1-OCD-OX1201-P1206-PM1206	PM-1206-Oxidizer no.1 Pump	4M Motor Greasing	01-02-2022
Q-2-FRD-20-0004A	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	26-01-2022
Q-2-FRD-20-0001B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	26-01-2022
Q-2-FRD-20-0002B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	26-01-2022
Q-2-FRD-20-0003B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	26-01-2022
Q-2-FRD-20-0004B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	26-01-2022
Q-2-FRD-20-0005B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	26-01-2022
Q-2-C-2202A	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(6M) Re-Lubricant 2H	28-01-2022
Q-2-C-2202B	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(6M) Re-Lubricant 2H	28-01-2022
Q-3-P-1872B	Q3-ISB-TK-1872-P-1872B	20 WT% CAUSTIC TRANSFER PUMP B	1Y-PM Metering Pump.3 Hr	28-01-2022

3 of 53

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-C-9601B	Q3-OSB-TK-9601-C-9601B	AIR COMPRESSOR PACKAGE B	1Y-PM Corn screw.8Hr	28-01-2022
Q-3-C-9601A	Q3-OSB-TK-9601-C-9601A	AIR COMPRESSOR PACKAGE A	1Y-PM Corn screw.8Hr	28-01-2022
Q-3-P-1802	Q3-ISB-D-1801-P-1802	PHENOL EVAPORATOR BOTTOM PUMP	6M(Online)- Replace Lube Oil .2Hr	28-01-2022
Q-3-P-1804	Q3-ISB-R-1801-P-1804	PURGE REACTOR BOTTOM CIRC. PUMP	6M(Online)- Replace Lube Oil .2Hr	28-01-2022
Q-3-P-1873A	Q3-ISB-TK-1873-P-1873A	TAR TRUCK LOADING A	6M- Replace Lube Oil .2Hr	28-01-2022
Q-3-P-1873B	Q3-ISB-TK-1873-P-1873B	TAR TRUCK LOADING PUMP B	6M- Replace Lube Oil .2Hr	28-01-2022
Q-1-INST-CAL-0012	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital pressure controller	1Y Calibration (Third Party)	21-01-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(1M) Archive HIST Data and Config. to CD	24-01-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>&<)> FUEL T	01-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>&<)> FUEL T	01-02-2022
Q-3-P-9207	Q3-OSB-Z-9200-P-9207	NEUTRALIZED CATALYST WASHING WATER PUMP	6M- Replace Lube Oil .2Hr	28-01-2022
Q-3-P-9218	Q3-OSB-Z-9200-TK-9203-P-9218	EFFLUENT WATER REUSE PUMP	6M- Replace Lube Oil .2Hr	28-01-2022
Q-3-P-9227	Q3-OSB-Z-9200-TK-9210-P-9227	CATALYST WASHING WATER TANK PUMP	6M- Replace Lube Oil .2Hr	28-01-2022
Q-3-GD-BA-0001	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-3-GD-BA-0002	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-3-GD-BA-0003	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-3-GD-BA-0004	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-3-GD-BA-0005	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-3-GD-BA-0006	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-3-GD-BA-0007	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-3-GD-BA-0008	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portabel Gas DET	26-01-2022
Q-1-PM-1207B	Q1-OCD-OX1202-P1207B-PM1207B	PM-1207B-Oxidizer no.2 Pump	4M Motor Greasing	01-02-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	26-01-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	28-01-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	28-01-2022
Q-1-GD-91-0001	Q1-OSB-GD91-001	GD910001 Multi Sensing Gas DET	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-GD-91-0002	Q1-OSB-GD91-002	GD910002 Total VOC (Mini REA3000)	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-GD-91-0003	Q1-OSB-GD91-003	GD910003 Oxygen Alert	6M Calibrate Portabel Gas DET.(แจ้งเตือน)	26-01-2022
Q-1-GD-91-0004	Q1-OSB-GD91-004	GD910004 Benzene Detector(Ultra REA3000)	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-GD-91-0005	Q1-OSB-GD91-005	GD910005 Single Sensor Gas DET(NH3)	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-GD-91-0006	Q1-OSB-GD91-006	GD910006 Single Sensor Gas DET(NH3)	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Bell Inspection	28-01-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Bell Inspection	28-01-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Bell Inspection	28-01-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	28-01-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	28-01-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	28-01-2022
Q-2-PM-6155A	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6155B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6155C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6156A	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6156B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6156C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6157A	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022

4 of 53

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PM-6157B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6157C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6158A	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6158B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-PM-6158C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-TM-6151A	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-TM-6151B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-TM-6151C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	28-01-2022
Q-2-TT-22-2105	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2106	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2107	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2108	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2601	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TT-22-2603	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TXT-22-0711	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TXT-22-0714	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TXT-22-1001	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-3-L-1602	Q3-ISB-L-1602	BPA PRODUCT CONVEYOR 1	RCM 1M PM Bucket conveyor,2.5Hr	28-01-2022
Q-1-PT-11-0901	Q1-QMX-R1102-PT110901	PT110901-Transkyl.Rea.Efflu.to Ben Col.	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-1-PT-11-1001	Q1-QMX-R1101-PT111001	PT111001-Alkyl Reac Effluent to Ben Colm	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-1-PT-11-1002	Q1-QMX-V1101-PT111002	PT111002-Ben Colm Blmfm	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-1-PT-11-1301	Q1-QMX-V1101-PT111301	PT111301-Ben Colm O/HVapor	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-2-P-2316B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(6M) Re-Lubricant	28-01-2022
Q-2-P-2317A	Q2-OSB-2300	Phenol II Oxidation CDN Section	(6M) Re-Lubricant	28-01-2022
Q-2-X-2053	Q2-OSB-6150	Phenol Recovery Section	(6M) PM Oil Mist	31-01-2022
Q-2-P-2320	Q2-OSB-2300	Phenol II Oxidation CDN Section	(6M) Re-Lubricant	28-01-2022
Q-2-P-2317B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(6M) Re-Lubricant	28-01-2022
Q-3-CM-1201	Q3-ISB-D1TK01-E06-C1201-CM1201	400V AC MOTOR FOR C-1201	RCM 1Y Motor Winding Insul & Starter Un	10-01-2022
Q-1-GD-12-0001	Q1-OSB-D120001	GD120001 Multi Sensing Gas DET	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-GD-12-0002	Q1-OSB-D120002	GD120002 Total VOC (Mini REA3000)	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-GD-12-0003	Q1-OSB-D120003	GD120003 Oxygen Alert	6M Calibrate Portabel Gas(ปรับเครื่อง)	26-01-2022
Q-3-MCC-P-9214A	Q3-OSB-Z00-Z18-P9214AMCC-P9214A	220V MOTOR FEEDER LOC MCC9200-F7-4	2Y PM MCC feeder	11-01-2022
Q-3-MCC-P-9214B	Q3-OSB-Z00-Z18-P9214BMCC-P9214B	220V MOTOR FEEDER LOC MCC9200-F7-5	2Y PM MCC feeder	11-01-2022
Q-3-MCC-9200-IN	Q3-OSB-MCC-9200-MCC-9200-IN	400V INCOMING PANEL LOC MCC9200-NR-1	2Y PM MCC feeder	11-01-2022
Q-3-MCC-9200-TRAFO	Q3-OSB-MCC-9200-MCC-9200-TRAFO	400/220V TRAFO PANEL LOC MCC9200-F5A	2Y PM MCC feeder	11-01-2022
Q-3-MCC-C-9201A	Q3-OSB-Z00-C01A-CM01AMCC-C9201A	400V MOTOR FEEDER LOC MCC9200-F2-4	2Y PM MCC feeder	11-01-2022
Q-3-MCC-C-9201B	Q3-OSB-Z00-C01B-CM01BMCC-C9201B	400V MOTOR FEEDER LOC MCC9200-F2-5	2Y PM MCC feeder	11-01-2022
Q-3-MCC-C-9201C	Q3-OSB-Z00-C01C-CM01CMCC-C9201C	400V MOTOR FEEDER LOC MCC9200-F2-6	2Y PM MCC feeder	11-01-2022
Q-3-MCC-M-9201	Q3-OSB-Z00TK01M01-MM01MCC-M9201	400V MOTOR FEEDER LOC MCC9200-F2-1	2Y PM MCC feeder	11-01-2022
Q-3-MCC-M-9202A	Q3-OSB-Z00-M9202A-MCC-M-9202A	400V MOTOR FEEDER LOC MCC9200-F3-1	2Y PM MCC feeder	11-01-2022
Q-3-MCC-M-9202B	Q3-OSB-Z00-M9202B-MCC-M-9202B	400V MOTOR FEEDER LOC MCC9200-F3-2	2Y PM MCC feeder	11-01-2022
Q-3-MCC-M-9203	Q3-OSB-Z00TK05M03-MM03MCC-M9203	400V MOTOR FEEDER LOC MCC9200-F5-1	2Y PM MCC feeder	11-01-2022
Q-3-MCC-M-9204	Q3-OSB-Z00TK08M04-MM04MCC-M9204	400V MOTOR FEEDER LOC MCC9200-F5-5	2Y PM MCC feeder	11-01-2022
Q-3-MCC-MCC-9200	Q3-OSB-MCC-9200-MCC-MCC-9200	400V POWER FEEDER LOC MCC5002A-SA6	2Y PM MCC feeder	11-01-2022

Page 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-W-1601	Q3-ISB-L-1605-TK-1603-W-1601	ROAD TANKER WEIGHT SCALE	3M-Dust Line Cleaning 24Hr	27-01-2022
Q-3-W-1602	Q3-ISB-L-1605-TK-1604-W-1602	CONTAINER BACK FILL UNIT CHUTE	3M-Dust Line Cleaning 24Hr	27-01-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	3M-Dust Line Cleaning 24Hr	27-01-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	3M-Dust Line Cleaning 24Hr	27-01-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	3M-Dust Line Cleaning 24Hr	27-01-2022
Q-3-W-1601	Q3-ISB-L-1605-TK-1603-W-1601	ROAD TANKER WEIGHT SCALE	3M-S-1601 Filter Cleaning 24Hr	27-01-2022
Q-3-W-1602	Q3-ISB-L-1605-TK-1604-W-1602	CONTAINER BACK FILL UNIT CHUTE	3M-S-1602 Filter Cleaning 24Hr	28-01-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	3M-S-1603 Filter Cleaning 24Hr	27-01-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	3M-S-1604 Filter Cleaning 24Hr	27-01-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	3M-S-1605 Filter Cleaning 24Hr	27-01-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	3M-Bagging Visual Inspection 24Hr	27-01-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	3M-Bagging Visual Inspection 24Hr	27-01-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	3M-Bagging Visual Inspection 24Hr	27-01-2022
Q-3-W-1601	Q3-ISB-L-1605-TK-1603-W-1601	ROAD TANKER WEIGHT SCALE	3M-Visual Inspection 24Hr	27-01-2022
Q-3-W-1602	Q3-ISB-L-1605-TK-1604-W-1602	CONTAINER BACK FILL UNIT CHUTE	3M-Visual Inspection 24Hr	27-01-2022
Q-1-AT-12-0502	Q1-OSB-V1201-AT120502	AT120502-Feed Wash Colm Drain	(4M) clean and Calb AYZ PH	26-01-2022
Q-1-AT-15-0702	Q1-FRC-D1506-AT150702	AT150702-Total Feed to Oil Extrac Colm	(4M) clean and Calb AYZ PH	26-01-2022
Q-1-AT-15-0501	Q1-FRC-D1503-P1506A-AT150501	AT150501-PRU Recy	(4M) clean and Calb AYZ PH	26-01-2022
Q-1-T-6101-1	Q1-OSB-T6101-T61011	T-6101-1-Cooling Tower No.1	1Y-Replace oil gear box&inspection	01-02-2022
Q-1-T-6101-2	Q1-OSB-T6101-T61012	T-6101-2-Cooling Tower No.2	1Y-Replace oil gear box&inspection	01-02-2022
Q-1-T-6102-1	Q1-OSB-T6102-T61021	T-6102-1-Reliable Cooling Tower No.1	1Y-Replace oil gear box&inspection	01-02-2022
Q-1-AT-91-1303	Q1-OSB-TK9141-AT911303	AT911303-TK-9141 pH Measurement	(4M) clean and Calb AYZ PH	26-01-2022
Q-1-AT-15-0701	Q1-FRC-V1502-AT150701	AT150701-Oil Extrac Colm Blm	(4M) clean and Calb AYZ PH	26-01-2022
Q-1-AT-15-0201	Q1-FRC-V1501-AT150201	AT150201-Cum-AMS Caustic Wash Colm Blm	(4M) clean and Calb AYZ PH	26-01-2022
Q-3-ENMCS-EWS-01	Q3-OSB-ENMCS-EWS-01	ENMCS ENGINEERING WORKSTATION 01	3M Clean & Inspect ENMCS Sys.	12-01-2022
Q-3-ENMCS-EWS-02	Q3-OSB-ENMCS-EWS01-ENMCS-EWS02	ENMCS ENGINEERING WORKSTATION 02	3M Clean & Inspect ENMCS Sys.	12-01-2022
Q-3-ENMCS-LP-301	Q3-OSB-ENMCS-EWS01-ENMCS-LP301	ENMCS PANEL CABINET	3M Clean & Inspect ENMCS Sys.	12-01-2022
Q-1-AT-91-1304	Q1-OSB-TK9141-AT911304	AT911304-TK9141 Conductivity Measurement	(2M) clean and Calb AYZ Con (FF)	26-01-2022
Q-1-AT-11-0601B	Q1-QMX-V1103-E1104-AT110601B	AT110601B-Feed to TransAlkyl Reac	(1M) Inspect and Clean Strainer	26-01-2022
Q-1-AT-14-1101	Q1-FRC-V1402-E1405-AT141101	AT141101-Acetone Product Moist Content	(3M) Inspect and Chng.Filler	26-01-2022
Q-1-AT-11-0601A	Q1-QMX-R1101-AT110601A	AT110601A-Fd. to Alk. Reac Moist Content	(1M) Inspect and Clean Strainer	26-01-2022
Q-1-INST-CAL-0011	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-1-INST-CAL-0010	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-1-INST-CAL-0009	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-1-INST-CAL-0008	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	01-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	13-01-2022
Q-3-L-1601	Q3-ISB-L-1601	1ST PRODUCT CONVEYOR	RCM 1M PM Bucket conveyor,2.5Hr	28-01-2022
Q-3-C-9201C	Q3-OSB-Z-9200-C-9201C	SBK TANK BLOWER	3M Replace lube oil 2Hr	28-01-2022
Q-3-C-9201B	Q3-OSB-Z-9200-C-9201B	SBK TANK BLOWER	3M Replace lube oil 2Hr	28-01-2022
Q-3-C-9201A	Q3-OSB-Z-9200-C-9201A	SBK TANK BLOWER	3M Replace lube oil 2Hr	28-01-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBK BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBK BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBK BLOWER	1W-Belt Inspection	28-01-2022

Page 89



Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-BATT-X5001A	Q1-OSB-X5001-X5001A	X-5001A BATTERY EDG STARTER	2Y-Replace Battery (Starter)	01-02-2022
Q-1-BATT-X5001B	Q1-OSB-X5001-X5001B	X-5001B BATTERY EDG STARTER	2Y-Replace Battery (Starter)	01-02-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	28-01-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	28-01-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	28-01-2022
Q-1-OSB-PYL-PIP-14	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	28-01-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	28-01-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Visual Inspection	28-01-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	28-01-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	28-01-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	28-01-2022
Q-1-OSB-PYL-PIP-14	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	28-01-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	28-01-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	28-01-2022
Q-2-TXT-22-1004	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1005	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1006	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1007	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1008	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1009	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1010	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1011	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1012	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TXT-22-1013	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect, Cal&Func, Test Temp Trans	20-01-2022
Q-2-TM-6151D	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-TM-6152A	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-TM-6152B	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-TM-6152C	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-2-TM-6152D	Q2-OSB-6150	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	28-01-2022
Q-3-TCV-100A	Q3-OSB-TK-9402-Z-9401-TCV-100A	OUTLET CONDENSER TO EVAPORATOR MOV	RCM 1Y-Inspection & Loop Calibrate	18-01-2022
Q-3-PCV-112A	Q3-OSB-TK-9402-Z-9401-PCV-112A	VGD MOTOR PCV	RCM 1Y-VGD Inspection & Loop Calibration	17-01-2022
Q-3-C-9401	Q3-OSB-TK-9402-C-9401	REFRIGERATION COMPRESSOR	RCM 1Y-PM Compressor	02-02-2022
Q-3-P-1874B	Q3-ISB-TK-1874-P-1874B	0.2 WT% CAUSTIC TRANSFER PUMP B	1Y-PM Metering Pump.3 Hr	28-01-2022
Q-3-TCV-100	Q3-OSB-TK-9402-Z-9401-TCV-100	PRE-ROTATION VANE MOV	RCM 1Y-PRV Inspection&Loop Cal	11-01-2022
Q-3-C-9401	Q3-OSB-TK-9402-C-9401	REFRIGERATION COMPRESSOR	RCM 1M Oil analysis.1Hr	28-01-2022
Q-1-P-9104A	Q1-OSB-X9103-P9104A	P-9104A-CONTAMINATED WATER PUMP	1M Clean water flushing strainer	28-01-2022
Q-1-P-9103A	Q1-OSB-X9103-P9103A	P-9103A-First 20 Minute Flush Water PIP Pump	1M Clean water flushing strainer	28-01-2022
Q-2-AT-23-1701	Q2-OCD-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	27 01 2022
Q-2-AT-23-1901	Q2-OCD-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	27-01-2022
Q-3-FL-MLP01B-2A04	Q3-OSB-MLP-01-FL-MLP01B-2A-04	EXIT SIGN LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-MLP01B-3A02	Q3-OSB-MLP-01-FL-MLP01B-3A-02	EXIT SIGN LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	17-01-2022

TABLE

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-FL-MLP01B-3A07	Q3-OSB-MLP-01-FL-MLP01B-3A-07	EXIT SIGN LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-MLP01B-2A04	Q3-OSB-MLP-01-FL-MLP01B-2A-04	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-MLP01B-2A06	Q3-OSB-MLP-01-FL-MLP01B-2A-06	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-MLP01B-3A02	Q3-OSB-MLP-01-FL-MLP01B-3A-02	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-MLP01B-3A07	Q3-OSB-MLP-01-FL-MLP01B-3A-07	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP03-3B-08	Q3-OSB-MLP01-LP03-HL-LP03-3B08	EMERGENCY LIGHTING DRIVERS FACI	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-01	Q3-OSB-MLP02-LP04-HL-LP04-4B01	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-03	Q3-OSB-MLP02-LP04-HL-LP04-4B03	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-05	Q3-OSB-MLP02-LP04-HL-LP04-4B05	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-07	Q3-OSB-MLP02-LP04-HL-LP04-4B07	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP05-4A-02	Q3-OSB-MLP02-LP05-HL-LP05-4A02	EMERGENCY LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP05-4A-05	Q3-OSB-MLP02-LP05-HL-LP05-4A05	EMERGENCY LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP05-4A-07	Q3-OSB-MLP02-LP05-HL-LP05-4A07	EMERGENCY LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP06-5B-06	Q3-OSB-MLP02-LP06-HL-LP06-5B06	EMERGENCY LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP06-6A-02	Q3-OSB-MLP02-LP06-HL-LP06-6A02	EMERGENCY LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP06-6A-07	Q3-OSB-MLP02-LP06-HL-LP06-6A07	EMERGENCY LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP15-1B-02	Q3-OSB-MLP02-LP15-HL-LP15-1B02	EMERGENCY LIGHTING WWT PLANT	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP15-2A-02	Q3-OSB-MLP02-LP15-HL-LP15-2A02	EMERGENCY LIGHTING WWT PLANT	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01A-5A-01	Q3-OSBMLP01LP01A-FL-LP01A-5A01	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01A-5B-10	Q3-OSBMLP01LP01A-FL-LP01A-5B10	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01A-6A-02	Q3-OSBMLP01LP01A-FL-LP01A-6A02	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01B-3B-01	Q3-OSBMLP01LP01B-FL-LP01B-3B01	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01B-4B-09	Q3-OSBMLP01LP01B-FL-LP01B-4B09	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP03-3B-05	Q3-OSB-MLP01-LP03-FL-LP03-3B05	EXIT SIGN LIGHTING DRIVERS FACI	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP03-3B-08	Q3-OSB-MLP01-LP03-FL-LP03-3B08	EXIT SIGN LIGHTING DRIVERS FACI	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-02	Q3-OSB-MLP02-LP04-FL-LP04-4B02	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-04	Q3-OSB-MLP02-LP04-FL-LP04-4B04	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-06	Q3-OSB-MLP02-LP04-FL-LP04-4B06	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP04-4B-07	Q3-OSB-MLP02-LP04-FL-LP04-4B07	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP05-4A-02	Q3-OSB-MLP02-LP05-FL-LP05-4A02	EXIT SIGN LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP05-4A-05	Q3-OSB-MLP02-LP05-FL-LP05-4A05	EXIT SIGN LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP06-6A-02	Q3-OSB-MLP02-LP06-FL-LP06-6A02	EXIT SIGN LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP06-6A-07	Q3-OSB-MLP02-LP06-FL-LP06-6A07	EXIT SIGN LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP15-1B-02	Q3-OSB-MLP02-LP15-FL-LP15-1B02	EXIT SIGN LIGHTING WWT PLANT	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP15-2A-02	Q3-OSB-MLP02-LP15-FL-LP15-2A02	EXIT SIGN LIGHTING WWT PLANT	3M PM Lighting system unit	17-01-2022
Q-1-PT-11-1303	Q1-QMX-D1103A-P1111201	P111201-Ben Feed to D-1103A	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-1-PT-11-1401	Q1-QMX-D1106-PT111401	PT111401-Cum Colm S3 Sim Drum	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-1-PT-11-1501	Q1-QMX-V1102-PT111501	PT111501-Cum Colm Blm Drum	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-1-PT-11-1502	Q1-QMX-V1102-PT111502	PT111502-Cum Colm Top	4Y Calibration (2 Man / 2 Hr.)	21-01-2022
Q-3-FL-LP01A-5A-01	Q3-OSBMLP01LP01A-HL-LP01A-5A01	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01A-5A-10	Q3-OSBMLP01LP01A-HL-LP01A-5A10	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01A-5B-10	Q3-OSBMLP01LP01A-HL-LP01A-5B10	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01A-6A-02	Q3-OSBMLP01LP01A-HL-LP01A-6A02	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-FL-LP01A-6A-06	Q3-OSBMLP01LP01A-HL-LP01A-6A06	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022

TABLE

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-HL-LP01A-6A-09	Q3-OSBMLP01LP01A-HL-LP01A-6A09	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-HL-LP01B-3B-01	Q3-OSBMLP01LP01B-HL-LP01B-3B01	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-HL-LP01B-3B-07	Q3-OSBMLP01LP01B-HL-LP01B-3B07	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-HL-LP01B-4A-10	Q3-OSBMLP01LP01B-HL-LP01B-4A10	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-HL-LP01B-4B-02	Q3-OSBMLP01LP01B-HL-LP01B-4B02	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-HL-LP01B-4B-05	Q3-OSBMLP01LP01B-HL-LP01B-4B05	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-HL-LP01B-4B-09	Q3-OSBMLP01LP01B-HL-LP01B-4B09	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	17-01-2022
Q-3-HL-LP03-3B-05	Q3-OSB-MLP01-LP03-HL-LP03-3B05	EMERGENCY LIGHTING DRIVERS FACI	3M PM Lighting system unit	17-01-2022
Q-1-AT-12-1001	Q1-OCD-OX1201-AT121001	AT121001-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	27-01-2022
Q-1-AT-12-1002	Q1-OCD-OX1201-AT121002	AT121002-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	27-01-2022
Q-1-AT-12-1401	Q1-OCD-OX1202-AT121401	AT121401-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	27-01-2022
Q-1-AT-12-1402	Q1-OCD-OX1202-AT121402	AT121402-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	27-01-2022
Q-2-AT-63-5101	Q2-OSB-6350	Tempered Water System	(1M) Inspect, clean and Calb AYZ Hydr	27-01-2022
Q-2-AT-61-5101	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	27-01-2022
Q-2-AT-61-5301	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	27-01-2022
Q-2-AT-66-5301	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	27-01-2022
Q-1-XD-5001B	Q1-OSB-X5001-X5001B-XD5001B	XD-5001B-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	01-02-2022
Q-3-P-1971	Q3-ISB-TK-1971-P-1971	PHENOL DRAIN PUMP	1M-PM Vertical Pump.2Hr	28-01-2022
Q-3-P-1974	Q3-ISB-TK-1974-P-1974	ACETONE DRAIN PUMP (ISBL)	1M-PM Vertical Pump.2Hr	28-01-2022
Q-3-P-1978	Q3-ISB-TK-1978-P-1978	ACETONE DRAIN PUMP (TANKAGE AREA)	1M-PM Vertical Pump.2Hr	28-01-2022
Q-3-P-1972	Q3-ISB-TK-1972-P-1972	ACETONE DRAIN PUMP	1M-PM Vertical Pump.2Hr	28-01-2022
Q-1-P-6901C	Q1-OSB-X6901-P6901C	P-6901C-Fire Water Pumps	1Y-Routine Maintenance	28-01-2022
Q-1-P-6902B	Q1-OSB-X6901-P6902B	P-6902B-Jockey Pumps	1Y-Routine Maintenance	28-01-2022
Q-1-XD-5001A	Q1-OSB-X5001-X5001A-XD5001A	XD-5001A-Emergency Diesel Engine Gen	1Y-PM Gen. Engine 8Hr	28-01-2022
Q-1-XD-5001B	Q1-OSB-X5001-X5001B-XD5001B	XD-5001B-Emergency Diesel Engine Gen	1Y-PM Gen. Engine 8Hr	28-01-2022
Q-1-P-6901B	Q1-OSB-X6901-P6901B	P-6901B-Fire Water Pumps	1Y-Routine Maintenance	28-01-2022
Q-1-P-6902A	Q1-OSB-X6901-P6902A	P-6902A-Jockey Pumps	1Y-Routine Maintenance	28-01-2022
Q-1-P-6901A	Q1-OSB-X6901-P6901A	P-6901A-Fire Water Pumps	1Y-Routine Maintenance	28-01-2022
Q-2-EDG-G-5052	Q2-OSB	Phenol II Outside Battery	RCM-(6M) PM EMERGENCY DIESEL GENERATOR	28-01-2022
Q-2-EDG-G-5051	Q2-OSB	Phenol II Outside Battery	RCM-(6M) PM EMERGENCY DIESEL GENERATOR	28-01-2022
Q-2-EDG-G-5052	Q2-OSB	Phenol II Outside Battery	RCM-(1Y) PM EMERGENCY DIESEL GENERATOR	31-01-2022
Q-2-EDG-G-5051	Q2-OSB	Phenol II Outside Battery	RCM-(1Y) PM EMERGENCY DIESEL GENERATOR	31-01-2022
Q-3-W-1602	Q3-ISB-L-1605-TK-1604-W-1602	CONTAINER BACK FILL UNIT CHUTE	6M-Load Test Chain	20-01-2022
Q-2-AXT-22-1001	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-01-2022
Q-2-AXT-22-1002	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-01-2022
Q-2-AXT-22-1401	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-01-2022
Q-2-AXT-22-1402	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-01-2022
Q-1-INST-CAL-0007	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-1-INST-CAL-0006	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-1-INST-CAL-0005	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-1-INST-CAL-0004	Q1-OSB-CALIBRATOR -INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	21-01-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	01-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	01-02-2022
Q-2-AT-66-5401	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	27-01-2022

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-LCP-Z-9401	Q3-OSB-TK-9402-Z-9401	REFRIGERATE PACKAGE	RCM 1Y-PM Local Panel	21-01-2022
Q-3-VSD-S-1303B	Q3-ISBS1303BSM-1303BVSD-S-1303B	400/230V VSD PANEL FOR S-1303B	RCM 1Y-ReplaceInterPosing & Control relay	21-01-2022
Q-3-MCC-Z-9401	Q3-OSB-TK9402-Z-9401-MCC-Z9401	400V POWER FEEDER LOC MCC5002B-SB4-BA03	RCM 1Y-Power Quality Measurement	21-01-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	27-01-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	27-01-2022
Q-3-RV-1601A	Q3-ISB-L1604TK1601A-RV-1601A	BPA PRODUCT SILO EXIT ROTARY VALVE A	1Y- PM Rotary valve.4Hr	28-01-2022
Q-3-P-1913	Q3-ISB-TK-1910-TK-1913-P-1913	17HC PUMP	3M(Online)- Replace Lube Oil. 2Hr	28-01-2022
Q-3-P-1313B	Q3-ISBS-1303B-TK-1311B-P-1313B	3RD MOTHER LIQUOR PUMP	6M(Online)- Replace Lube Oil. 2Hr	28-01-2022
Q-3-P-1314B	Q3-ISBS-1303B-TK-1312B-P-1314B	P-1314B FILTRATE PUMP	6M(Online)- Replace Lube Oil. 2Hr	28-01-2022
Q-3-RV-1601C	Q3-ISB-L1604TK1601CRV-1601C	BPA PRODUCT SILO EXIT ROTARY VALVE C	1Y- PM Rotary valve.4Hr	28-01-2022
Q-3-RV-1601B	Q3-ISB-L1604TK1601B-RV-1601B	BPA PRODUCT SILO EXIT ROTARY VALVE B	1Y- PM Rotary valve.4Hr	28-01-2022
Q-3-Z-1972	Q3-ISB-TK-1972-Z-1972	ACETONE LOADING ARM	6M-Replace grease at swivel joint. 1Hr	27-01-2022
Q-3-Z-1978	Q3-ISB-TK-1978-Z-1978	ACETONE LOADING ARM (ISBL)	6M-Replace grease at swivel joint. 1Hr	28-01-2022
Q-3-P-1501	Q3-ISB-TK-1551-N-1501-P-1501	REWORK PUMP	6M- Replace Lube Oil. 2Hr	28-01-2022
Q-3-P-1502	Q3-ISB-TK-1551-TK-1502-P-1502	DUST COLLECTOR BPA RECOVERY PUMP	6M- Replace Lube Oil. 2Hr	28-01-2022
Q-3-P-1503	Q3-ISB-D-1501-E-1501-P-1503	E-1501 CHILLED COOLING WATER CIRC. PUMP	6M- Replace Lube Oil. 2Hr	28-01-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	28-01-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-01-2022
Q-2-TXT-22-1014	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TXT-22-1015	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TXT-22-1016	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-2-TXT-22-1017	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	24-01-2022
Q-2-TXT-22-1401	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	24-01-2022
Q-2-TXT-22-1404	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	24-01-2022
Q-2-TXT-22-1405	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	24-01-2022
Q-2-TXT-22-1406	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	25-01-2022
Q-2-TXT-22-1407	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	25-01-2022
Q-2-TXT-22-1408	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	25-01-2022
Q-1-PM-6102A	Q1-OSB-T6101-P6102A-PM6102A	PM-6102A-C/W Cir Pump	4M Motor Greasing	01-02-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine.1.5.Hr	28-01-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine.1.5.Hr	28-01-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	1M-PM Bagging Machine.1.5.Hr	28-01-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFLUENT DISTRIBUTION SYSTEM	(1M) clean and Calb COD AYZ	27-01-2022
Q-3-CM-9601A	Q3-OSB-TK-9601-C-9601A-CM9601A	6.6KV AC MOTOR FOR C-9601A	2M Motor Greasing	24-01-2022
Q-3-PM-9402A	Q3-OSB-TK-9402-P-9402A-PM9402A	6.6KV AC MOTOR FOR P-9402A	2M Motor Greasing	24-01-2022
Q-3-PM-1911A	Q3-ISB-TK-1915-P-1911A-PM1911A	6.6KV AC MOTOR FOR P-1911A	2M Motor Greasing	24-01-2022
Q-3-PM-9502B	Q3-OSB-Z-9501-P-9502B-PM-9502B	400V AC MOTOR FOR P-9502B	2M Motor Greasing	24-01-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filter	1M Inspect and Calb AYZ Hydr 4H	27-01-2022
Q-3-PM-1311	Q3-ISBS1302TK1308-P1311-PM1311	400V AC MOTOR FOR P-1311	2M Motor Greasing	24-01-2022
Q-3-PM-1305	Q3-ISBS1301TK1303-P1305-PM1305	400V AC MOTOR FOR P-1305	2M Motor Greasing	24-01-2022

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-PM-9302C	Q3-OSB-Z-9301C-P-9302C-PM9302C	6.6KV AC MOTOR FOR P-9302C	2M Motor Greasing	24-01-2022
Q-3-PM-9302A	Q3-OSB-Z-9301A-P-9302A-PM9302A	6.6KV AC MOTOR FOR P-9302A	2M Motor Greasing	24-01-2022
Q-3-PM-1904	Q3-ISB-TK-1904-P-1904-PM-1904	400V AC MOTOR FOR P-1904	4M Motor Greasing	24-01-2022
Q-1-C-6201	Q1-OSB-X6201-C6201	C-6201-COMPRESSOR	1M-Check N2 <?&<?> Rotate Shaft spare C	28-01-2022
Q-1-PT-11-1506	Q1-QMX-V1102-PT111506	PT111506-CumCol.Vnt GS toDIPB Col.VacSys	4Y Calibration (2 Man / 2 Hr.)	26-01-2022
Q-1-PT-11-1704	Q1-QMX-V1103-PT111704	PT111704-CumCol.Vnt GS toDIPB Col.VacSys	4Y Calibration (2 Man / 2 Hr.)	26-01-2022
Q-1-PT-16-0301	Q1-OSB-PT160301	PT160301-Makeup Hydrogen Gas	4Y Calibration (2 Man / 2 Hr.)	26-01-2022
Q-1-PT-13-1901	Q1-OSB-D1304-X1310A-PT131901	PT131901-Crude Product to Fraclinat Sect	4Y Calibration (2 Man / 2 Hr.)	26-01-2022
Q-3-PM-1316	Q3-ISB-TK-1351-P-1316-PM-1316	400V AC MOTOR FOR P-1316	4M Motor Greasing	24-01-2022
Q-3-PM-1315A	Q3-ISBS03AN1313AP1315A-PM1315A	400V AC MOTOR FOR P-1315A	4M Motor Greasing	24-01-2022
Q-3-PM-1501	Q3-ISBTK1551N1501-P1501-PM1501	400V AC MOTOR FOR P-1501	4M Motor Greasing	24-01-2022
Q-3-PM-1315B	Q3-ISBS03BN1313BP1315B-PM1315B	400V AC MOTOR FOR P-1315B	4M Motor Greasing	24-01-2022
Q-3-PM-1307B	Q3-ISBQ03E1306B-P1307B-PM1307B	6.6KV AC MOTOR FOR P-1307B	4M Motor Greasing	24-01-2022
Q-3-PM-1307A	Q3-ISBQ03E1306A-P1307A-PM1307A	6.6KV AC MOTOR FOR P-1307A	4M Motor Greasing	24-01-2022
Q-3-PM-1309	Q3-ISB-Q1304-E1307-P1309PM1309	6.6KV AC MOTOR FOR P-1309	4M Motor Greasing	24-01-2022
Q-3-PM-1331	Q3-ISB-S1302-N1310-P1331PM1331	400V AC MOTOR FOR P-1331	4M Motor Greasing	24-01-2022
Q-1-FT-41-0206	Q1-OSB-TK4102A-X4107-FT410206	FT410206-Off-spec Ben Or Ben DIPB Flow	(4M) Inspect, prove and Calb Metering	27-01-2022
Q-1-FT-41-0206	Q1-OSB-TK4102A-X4107-FT410206	FT410206-Off-spec Ben Or Ben DIPB Flow	(1Y) Annual core process inspect	27-01-2022
Q-3-P-1406A	Q3-ISB-D-1401-TK-1406-P-1406A	D-1401 LOWER BEARING SEAL PUMP	6M Vibration Monitoring	25-01-2022
Q-3-P-1871A	Q3-ISB-TK-1871-P-1871A	50 WT% CAUSTIC TRANSFER PUMP A	6M Vibration Monitoring	25-01-2022
Q-3-P-1872A	Q3-ISB-TK-1872-P-1872A	20 WT% CAUSTIC TRANSFER PUMP A	6M Vibration Monitoring	25-01-2022
Q-3-P-1874A	Q3-ISB-TK-1874-P-1874A	0.2 WT% CAUSTIC TRANSFER PUMP A	6M Vibration Monitoring	25-01-2022
Q-3-P-1913	Q3-ISB-TK-1910-TK-1913-P-1913	17HC PUMP	6M Vibration Monitoring	25-01-2022
Q-3-P-1971	Q3-ISB-TK-1971-P-1971	PHENOL DRAIN PUMP	6M Vibration Monitoring	25-01-2022
Q-3-P-1974	Q3-ISB-TK-1974-P-1974	ACETONE DRAIN PUMP (ISBL)	6M Vibration Monitoring	25-01-2022
Q-3-P-9101A	Q3-OSB-TK-9101-P-9101A	CONDENSATE TRANSFER PUMP A	6M Vibration Monitoring	25-01-2022
Q-3-NA-1310	Q3-ISB-S-1302-N-1310-NA-1310	RESLURRY AGITATOR	6M Vibration Monitoring	25-01-2022
Q-1-PM-1110B	Q1-QMX-V1103-P1110B-PM1110B	PM-1110B-DIPB Colm Bottoms Pump	4M Motor Greasing	28-01-2022
Q-3-AP-01	Q3-OSB-AP-01	400V AC UPS FOR INST SYS AND LOCAL PANEL	RCM-3M UPS & DC CHARGER INSPECTION	26-01-2022
Q-3-AP-02	Q3-OSB-AP-02	230V AC UPS FOR ESD AND FGS PANEL	RCM-3M UPS & DC CHARGER INSPECTION	26-01-2022
Q-3-AP-03	Q3-OSB-AP-03	125V DC POWER SUPPLY AND BATTERY CHARGER	RCM-3M UPS & DC CHARGER INSPECTION	26-01-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	1M PM Analyzer COD	27-01-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(1Y) Cleaning, Replace Filter Pack kits	27-01-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(1M) Inspection & Cleaning	27-01-2022
Q-1-XD-5001A	Q1-OSB-X5001-X5001A-XD5001A	XD 5001A-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	01-02-2022
Q-3-Z-9219	Q3-OSB-Z-9200-Z-9219	SLUDE DEWATERING	2M-PM Belt press.4Hr	28-01-2022
Q-3-P-1904	Q3-ISB-TK-1904-P-1904	DRAIN RECEIVER PUMP	1M-PM Vertical Pump.2Hr	01-02-2022
Q-3-P-1809	Q3-ISB-TK-1805-P-1809	TAR DRAIN RECEIVER PUMP	1M-PM Vertical Pump.2Hr	28-01-2022
Q-3-P-1875	Q3-ISB-TK-1875-P-1875	TAR DRAIN RECEIVER PUMP (TANKAGE AREA)	1M-PM Vertical Pump.2Hr	28-01-2022
Q-1-INST-CAL-0003	Q1-OSB-CALIBRATOR-INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	27-01-2022
Q-1-INST-CAL-0002	Q1-OSB-CALIBRATOR-INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	27-01-2022
Q-1-INST-CAL-0001	Q1-OSB-CALIBRATOR-INSTRUMENT	INST-CAL-0001 Digital presure controller	1Y Calibration (Third Party)	27-01-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	01-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	01-02-2022

83-0000

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-RV-1502	Q3-ISB-D-1501-Z-1551-RV-1502	RV-1502 ROTARY VALVE	2M-Grease up.1 Hr	28-01-2022
Q-3-RV-1503	Q3-ISB-D-1501-Z-1501-RV-1503	RV-1503 FEED ROTARY VALVE	2M-Grease up.1 Hr	28-01-2022
Q-3-P-1308	Q3-ISB-Q-1303-E-1314-P-1308	3RD CRYSTALLIZER FINES PUMP	6M(Online)- Replace Lube Oil .2Hr	28-01-2022
Q-1-PM-1206	Q1-OSB-D-1201-P-1206-PM1206	PM-1206-Oxidizer no.1 Pump	4M Motor Greasing	01-02-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	01-02-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	01-02-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	01-02-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	01-02-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	01-02-2022
Q-2-PM-6252	Q2-OSB-6250	Chilled Water System	(1Y) Inspection Megger clean re-lighten	31-01-2022
Q-2-TXT-22-1409	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	18-01-2022
Q-2-TXT-22-1410	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	18-01-2022
Q-2-TXT-22-1411	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	18-01-2022
Q-2-TXT-22-1412	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	18-01-2022
Q-2-TXT-22-1413	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	19-01-2022
Q-2-TXT-22-1414	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	19-01-2022
Q-2-TXT-22-1415	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	19-01-2022
Q-2-TXT-22-1416	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	19-01-2022
Q-2-TXT-22-1420	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	19-01-2022
Q-2-TXT-22-2301	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Inspect,Cal&Func.Test Temp Trans	20-01-2022
Q-3-P-1202	Q3-ISB-D-1201-P-1202	DEHYDRATOR BOTTOM PUMP	3M(Online)- Replace Lube Oil .2Hr	31-01-2022
Q-3-P-1203	Q3-ISB-D-1201-P-1203	DEHYDRATOR REBOILER CIRC. PUMP	3M(Online)- Replace Lube Oil .2Hr	31-01-2022
Q-3-PM-1802	Q3-ISB-D-1801-P-1802-PM-1802	400V AC MOTOR FOR P-1802	4M Motor Greasing	31-01-2022
Q-3-P-1102	Q3-ISB-TK-1152-TK-1103-P-1102	PHENOL FEED PUMP	6M(Online)- Replace Lube Oil .2Hr	31-01-2022
Q-1-PT-13-0701	Q1-OSB-X6605-PT130701	PT130701-Stm to Flash Colm Vaporizer	4Y Calibration (2 Man / 2 Hr.)	31-01-2022
Q-1-PT-13-0501	Q1-OSB-X6605-X6606-PT130501	PT130501-Stm to Preflash Colm Stm Hlr	4Y Calibration (2 Man / 2 Hr.)	31-01-2022
Q-1-PT-14-2805	Q1-FRC-J1402-PT142805	PT142805-Frac Vacuum Producing Equipment	4Y Calibration (2 Man / 2 Hr.)	31-01-2022
Q-1-PT-12-1402	Q1-OSB00-TK6401-P6402-PT121402	PT121402-Water to Oxidi No.2 Spray Nozzl	4Y Calibration (2 Man / 2 Hr.)	31-01-2022
Q-3-P-1922	Q3-ISB-TK-1922-P-1922	WASTE WATER BUFFER TANK PUMP	6M- Replace Lube Oil .2Hr	31-01-2022
Q-3-P-1923	Q3-ISB-TK-1923-P-1923	WASTE WATER TANK PUMP	6M- Replace Lube Oil .2Hr	31-01-2022
Q-1-PM-1601A	Q1-QMX-TK1601-P1601A-PM1601A	PM-1601A-Hydrogenation Charge Pump	2M Motor Greasing	28-02-2022
Q-1-X-9141	Q1-OSB-TK9141-X9141	X-9141-FINAL POLISHING AGITATOR	1Y-CHANGE LUBE OIL GEAR BOX. 3Hr	24-02-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	08-02-2022
Q-1-P-9116C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M-Re Lubricant 2H	28-02-2022
Q-1-P-9119C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M-Re Lubricant 2H	28-02-2022
Q-1-X-9156	Q1-OSB-TK9155-X9156	X-9156-SLUDGE CONDITION MIXER	1Y-CHANGE LUBE OIL GEAR BOX. 3Hr	24-02-2022
Q-1-CM-9132D	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	4M Motor Greasing	28-02-2022
Q-1-PM-9119B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	4M Motor Greasing	28-02-2022
Q-1-PM-9119C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	4M Motor Greasing	28-02-2022
Q-1-CM-9132A	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	4M Motor Greasing	28-02-2022
Q-1-CM-9132B	Q1-OSB-X9134-C9132B-CM9132B	CM-9132B-SBR Blower	4M Motor Greasing	28-02-2022
Q-1-PM-9119A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022
Q-1-PM-9116A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022
Q-1-PM-9118B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022

83-0000



Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-XM-9117	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022
Q-1-XM-9118	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022
Q-1-XM-9119A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022
Q-1-XM-9119B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022
Q-1-XM-9119C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	28-02-2022
Q-1-ELEC-CAL-0001	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0003	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0005	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0006	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0008	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0011	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0012	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0014	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0015	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0016	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	1Y Standard Tool Calibrate	28-02-2022
Q-1-PM-6102C	Q1-OSB-T6101-P6102C-PM6102C	PM-6102C-C/W Cir Pump	Motor Greasing	28-02-2022
Q-1-CM-9132A	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	Motor Greasing	28-02-2022
Q-1-CM-9132B	Q1-OSB-X9134-C9132B-CM9132B	CM-9132B-SBR Blower	Motor Greasing	28-02-2022
Q-1-CM-9132D	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	Motor Greasing	28-02-2022
Q-1-PM-6102A	Q1-OSB-T6101-P6102A-PM6102A	PM-6102A-C/W Cir Pump	Motor Greasing	28-02-2022
Q-1-T-6102-3	Q1-OSB-T6102-T61023	T-6102-3-Reliable Cooling Tower No.3	1M-Replace oil gear box<>&<>-inspection	28-02-2022
Q-1-PM-1102A	Q1-QMX-D1102-P1102A-PM1102A	PM-1102A-Propylene Charge Pump	Motor Greasing	28-02-2022
Q-1-TM-6102-1	Q1-OSB-T6102-T61021-TM61021	TM-6102-1-Motor Reliable Cooling FanNo.1	Motor Greasing	28-02-2022
Q-1-TM-6102-2	Q1-OSB-T6102-T61022-TM61022	TM-6102-2-Motor Reliable Cooling FanNo.2	Motor Greasing	28-02-2022
Q-1-TM-6102-3	Q1-OSB-T6102-T61023-TM61023	TM-6102-3-Motor Reliable Cooling FanNo.3	Motor Greasing	28-02-2022
Q-2-X-2051	Q2-OSB-2200	Phenol I	1M-Equipment Site Patrol	09-02-2022
Q-2-X-2052	Q2-QMX-2100	Phenol II Oxidation Oxidation Section	(1M) PM Oil Mist	24-02-2022
Q-2-X-2053	Q2-OSB-6150	Phenol II QMAX Unit Q-Max Area	(1M) PM Oil Mist	24-02-2022
Q-2-FT-26-0201	Q2-FRC-2600	Phenol Recovery Section	(1M) PM Oil Mist	24-02-2022
Q-2-FT-26-0301	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FT-26-0303	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FT-26-0305	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FT-26-0402	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FT-26-0501	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FT-26-0604	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FXT-26-0302A	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FXT-26-0302B	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FXT-26-0304A	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FXT-26-0304B	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FXT-26-0306A	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-FXT-26-0306B	Q2-FRC-2600	HUEL MSHP Pcess Unit	(2Y) Inspect,Cal&Func.Test Flow Trans	11-02-2022
Q-2-PM-2416A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-02-2022
Q-2-PM-2502A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	28-02-2022

END

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PM-6352A	Q2-OSB-6350	Tempered Water System	Motor Greasing	28-02-2022
Q-2-PM-2106A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-02-2022
Q-2-PM-2108A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-02-2022
Q-2-PM-2111A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-02-2022
Q-2-PM-2113A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	28-02-2022
Q-2-PM-2303A	Q2-OSB-2300	Phenol II Oxidation CDN Section	Motor Greasing	28-02-2022
Q-2-PM-2405A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-02-2022
Q-2-PM-2411A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-02-2022
Q-2-PM-2412A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-02-2022
Q-2-PM-2423A	Q2-FRC-2400	Fractionation unit	Motor Greasing	28-02-2022
Q-2-PM-2506A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	28-02-2022
Q-2-PM-2507A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	28-02-2022
Q-2-PM-2601A	Q2-FRC-2600	HUEL MSHP Pcess Unit	Motor Greasing	28-02-2022
Q-2-PM-4103C	Q2-OSB-4100	Tank Gauging System	Motor Greasing	28-02-2022
Q-2-PM-4151A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	28-02-2022
Q-2-PM-6653	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	28-02-2022
Q-3-DCS-HIS	Q3-OSB-9900	Phenol II	1M-Equipment Site Patrol	18-02-2022
Q-3-P-9216B	Q3-OSB-Z-9200-TK-9202B-P-9216B	EMERGENCY POWER GENERATOR SYSTEM	(1M) Archive HIST Data and Config. to CD	07-02-2022
Q-3-P-9229B	Q3-OSB-Z-9200-TK-9203-P-9229B	SBR DECANter	6M Vibration Monitoring	01-02-2022
Q-3-P-9219B	Q3-OSB-Z-9200-TK-9204-P-9219B	EFFLUENT PUMP	6M Vibration Monitoring	01-02-2022
Q-3-P-9223B	Q3-OSB-Z-9200-TK-9206-P-9223B	DIVERSION TANK PUMP	6M Vibration Monitoring	01-02-2022
Q-3-P-9226B	Q3-OSB-Z-9200-TK-9209-P-9226B	HCL DOSING PUMP	6M Vibration Monitoring	01-02-2022
Q-3-P-9214B	Q3-OSB-Z-9200-Z-9218-P-9214B	H3PO4 DOSING PUMP CATALYST WASHING WATER	6M Vibration Monitoring	01-02-2022
Q-3-P-9207	Q3-OSB-Z-9200-P-9207	PE DOSING PUMP	6M Vibration Monitoring	01-02-2022
Q-3-Z-1301	Q3-ISB-1300	NEUTRALIZED CATALYST WASHING WATER PUMP	6M Vibration Monitoring	01-02-2022
Q-1-AT-61-0601	Q1-OSB-T6101-P6102A-AT610601	PURIFICATION	1M-PM Oil Mist System	01-03-2022
Q-1-AT-11-0601B	Q1-QMX-V1103-E1104-AT110601B	AT610601-C/W Area Limestone Pit	(4M) clean and Calb AYZ PH	24-02-2022
Q-1-AT-61-0602	Q1-OSB-T6102-P6104A-AT610602	AT110601B-Feed to TransAlkyl Reac	(1M) Inspect and Clean Strainer	24-02-2022
Q-1-AT-11-0601A	Q1-QMX-R1101-AT110601A	AT610602-C/W Area Limestone Pit	(4M) clean and Calb AYZ PH	24-02-2022
Q-1-PM-1108B	Q1-QMX-V1101-P1108B-PM1108B	AT110601A-Fd. to Alk. Reac Moist Content	(1M) Inspect and Clean Strainer	24-02-2022
Q-1-ELEC-CAL-0002	Q1-OSB-CALIBRATOR -ELECTRICAL	PM-1108B-Benzene Colm Bottoms Pump	4M Motor Greasing	28-02-2022
Q-1-ELEC-CAL-0004	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	2Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0010	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	2Y Standard Tool Calibrate	28-02-2022
Q-1-ELEC-CAL-0013	Q1-OSB-CALIBRATOR -ELECTRICAL	ELEC-CAL-0001 MEGOHM METER	2Y Standard Tool Calibrate	28-02-2022
Q-1-P-6605B	Q1-OSB-6612	ELEC-CAL-0001 MEGOHM METER	2Y Standard Tool Calibrate	28-02-2022
Q-1-TK-4111	Q1-OSB-TK4111	Condensate Recovery & Storage System	3M-Relubricant	28-02-2022
Q-1-AT-11-1501	Q1-QMX-V1102-AT111501	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	08-02-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT111501-Gas Chromatograph	(3M) Inspect, Cleaning and Cal GC Analyz	24-02-2022
Q-1-AT-14-1102	Q1-FRC-V1402-E1405	AT110901-Gas Chromatograph	(3M) Inspect, Cleaning and Cal GC Analyz	24-02-2022
Q-2-X-5051	Q2-OSB-5050	E-1405-Acetone Product Cooler	(3M) Inspect, Cleaning and Cal GC Analyz	24-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <>&<> FUEL T	28-02-2022
Q-1-AT-14-1501	Q1-FRC-D1405-P1408A-AT141501	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <>&<> FUEL T	28-02-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	AT141501-Gas Chromatograph	(3M) Inspect, Cleaning and Cal GC Analyz	24-02-2022
		Tank Gauging System	(1M) Visual Inspection	09-02-2022

END



Equipment	Functional Loc	Description	Description	Sched. start
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	09-02-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Visual Inspection	09-02-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	09-02-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole,2Hr	09-02-2022
	Q2	Phenol II	1M-Equipment Site Patrol	18-02-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole,2Hr	09-02-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	28-02-2022
Q-1-AT-63-0101	Q1-OSB-TK6301-AT630101	AT630101-Tempered Water Return Line	(6M) Inspect, replace, lub, MN kit AYZ Hydr	24-02-2022
Q-1-AT-63-0101	Q1-OSB-TK6301-AT630101	AT630101-Tempered Water Return Line	(3M) Inspect and Calb AYZ Hydr 4H	24-02-2022
Q-1-PM-1301B	Q1-OSB-V1302-P1301B-PM1301B	PM-1301B-Flash Colm Bottoms Pump	4M Motor Greasing	28-02-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1M-Replace Lube Oil	17-02-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1M-Replace Lube Oil	17-02-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1M-Replace Lube Oil	17-02-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	17-02-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	17-02-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	17-02-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	24-02-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	24-02-2022
Q-3-C-1301	Q3-ISB-C-1301	SEPARATOR VACUUM PUMP	3M-Grease up	24-02-2022
Q-3-C-1801	Q3-ISB-TK-181300-C-1801	PURGE REACTOR VACUUM UNIT	3M(Online)- Replace Lube Oil 1.5Hr	24-02-2022
Q-3-P-1302	Q3-ISB-Q-1301-E-1312-P-1302	1ST CRYSTALLIZER FINES PUMP	6M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-3-P-1304	Q3-ISB-Q-1302-E-1313-P-1304	2ND CRYSTALLIZER FINES PUMP	6M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-3-P-1305	Q3-ISB-S-1301-TK-1303-P-1305	1ST MOTHER LIQUOR PUMP	6M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-3-P-1310	Q3-ISB-Q-1304-E-1315-P-1310	4TH CRYSTALLIZER FINES PUMP	6M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-3-P-1311	Q3-ISB-S-1302-TK-1308-P-1311	2ND MOTHER LIQUOR PUMP	6M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-3-P-1317	Q3-ISB-Q-1301-E-1302-P-1317	CRYSTALLIZER FEED COOLER TCW PUMP	3M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-3-P-1331	Q3-ISB-S-1302-N-1310-P-1331	3RD SEPARATOR FEED PUMP	3M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-3-P-1707	Q3-ISB-D-1703-P-1707	PHENOL COLUMN BOTTOM CIRC. PUMP	6M(Online)- Replace Lube Oil 2Hr	24-02-2022
Q-1-P-1405B	Q1-FRC-D1403-P1405B	P-1405B-FinishAcetoneColumnOverheadPump	1Y-Replace lube oil 2Hr	28-02-2022
Q-1-P-1422B	Q1-FRC-D1403-P1422B	P-1422B-EjectorVentScrubberBottomPump	1Y-Replace lube oil 2Hr	28-02-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Bell Inspection	17-02-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Bell Inspection	17-02-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Bell Inspection	17-02-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	17-02-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	17-02-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	17-02-2022
Q-2-PM-6351A	Q2-OSB-6350	Tempered Water System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6351B	Q2-OSB-6350	Tempered Water System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6352A	Q2-OSB-6350	Tempered Water System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6352B	Q2-OSB-6350	Tempered Water System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-P-2220	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(6M) Re-Lubricant	17-02-2022
Q-2-P-2209A	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(6M) Re-Lubricant	17-02-2022
Q-2-PSV-21-0303A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2Y) Calibration test	08-02-2022
Q-2-LT-26-0201	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Level Trans	11-02-2022

13 of 85

Equipment	Functional Loc	Description	Description	Sched. start
Q-2-LT-26-0202	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Level Trans	11-02-2022
Q-2-LT-26-0601	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Level Trans	11-02-2022
Q-2-LT-26-0602	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Level Trans	11-02-2022
Q-2-PDT-26-0401	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Ins, Cal&Func, Test Press Diff Trans	11-02-2022
Q-2-PDT-26-0501	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Ins, Cal&Func, Test Press Diff Trans	11-02-2022
Q-2-PT-26-0206	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Press Trans	11-02-2022
Q-2-PT-26-0301	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Press Trans	11-02-2022
Q-2-PT-26-0402	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Press Trans	11-02-2022
Q-2-PT-26-0601	Q2-FRC-2600	HUEL MSHPP Process Unit	(2Y) Inspect, Cal&Func, Test Press Trans	11-02-2022
Q-3-P-1872A	Q3-ISB-TK-1872-P-1872A	20 WT% CAUSTIC TRANSFER PUMP A	1Y-PM Metering Pump,3 Hr	24-02-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(1M) Archive HIST Data and Config. to CD	21-02-2022
Q-1-PT-12-1401	Q1-OSB-OX1202-PT121401	PT121401-Oxidi No.2 Press	4Y Calibration (2 Man / 2 Hr.)	24-02-2022
Q-1-PT-12-1002	Q1-OSB00-TK6401-P6402-PT121002	PT121002-Water to Oxidi No.1 Spray Nozzl	4Y Calibration (2 Man / 2 Hr.)	24-02-2022
Q-1-PT-12-1001	Q1-OSB-OX1201-PT121001	PT121001-Oxidi No.1 Press	4Y Calibration (2 Man / 2 Hr.)	24-02-2022
Q-1-PT-12-0301	Q1-OSB-TK1201-P1201A-PT120301	PT120301-P-1201A/B Outlet Press	4Y Calibration (2 Man / 2 Hr.)	24-02-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT,0.5HR	17-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT,0.5HR	17-02-2022
Q-3-PM-9402B	Q3-OSB-TK-9402-P-9402B-PM9402B	6.6KV AC MOTOR FOR P-9402B	2M Motor Greasing	07-02-2022
Q-3-PM-1911B	Q3-ISB-TK-1915-P-1911B-PM1911B	6.6KV AC MOTOR FOR P-1911B	2M Motor Greasing	07-02-2022
Q-3-PM-9502A	Q3-OSB-Z-9501-P-9502A-PM-9502A	400V AC MOTOR FOR P-9502A	2M Motor Greasing	07-02-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	24-02-2022
Q-2-AT-21-1001	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	24-02-2022
Q-1-P-1410B	Q1-FRC-V1404-P1410B	P-1410B-Residue Stripper Bottoms Pumps	1Y-Replace lube oil 2Hr	28-02-2022
Q-1-P-1411B	Q1-FRC-D1407-P1411B	P-1411B-CrudePhenolColumnOverheadPump	1Y-Replace lube oil 2Hr	28-02-2022
Q-2-AT-21-1501	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	24-02-2022
Q-2-AT-21-1502	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	24-02-2022
Q-2-AT-22-2631	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2M) clean and Calb AYZ VOC	24-02-2022
Q-2-AT-21-1801	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	24-02-2022
Q-2-AT-23-1701	Q2-OSB-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	24-02-2022
Q-2-AT-23-1901	Q2-OSB-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	24-02-2022
Q-1-P-1503B	Q1-FRC-D1502-P1503B	P-1503B-Caustic Settler Pumps	1Y-Replace lube oil 2Hr	28-02-2022
Q-1-P-1404B	Q1-FRC-V1402-P1404B	P-1404B-FinishAcetoneColumnBottomsPump	4M- Replace lube oil 2Hr	28-02-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	28-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	28-02-2022
Q-1-AT-91-6401	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(4M) clean and Calb AYZ PH	24-02-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFLUENT DISTRIBUTION SYSTEM	(1M) clean and Calb COD AYZ	24-02-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filler	1M Inspect and Calb AYZ Hydr 4H	24-02-2022
Q-3-LP-01A	Q3-OSB-MLP-01-LP-01A	NON-EX LIGHTING PANEL FOR CCB FL 1	2Y PM MCC feeder	11-02-2022
Q-3-LP-01B	Q3-OSB-MLP-01-LP-01B	NON-EX LIGHTING PANEL FOR CCB FL 2	2Y PM MCC feeder	11-02-2022
Q-3-LP-02	Q3-OSB-MLP-01-LP-02	NON-EX LIGHTING PANEL / GATE HOUSE	2Y PM MCC feeder	11-02-2022
Q-3-LP-03	Q3-OSB-MLP-01-LP-03	NON-EX LIGHTING PANEL /SOLID WASTE	2Y PM MCC feeder	11-02-2022
Q-3-LP-04	Q3-OSB-MLP-02-LP-04	NON-EX LIGHTING PANEL / BIPA WH	2Y PM MCC feeder	11-02-2022
Q-3-LP-05	Q3-OSB-MLP-02-LP-05	NON-EX LIGHTING PANEL / WORKSHOP	2Y PM MCC feeder	11-02-2022
Q-3-LP-06	Q3-OSB-MLP-02-LP-06	NON-EX LIGHTING PANEL / CHEM WH	2Y PM MCC feeder	11-02-2022

14 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-LP-07	Q3-OSB-MLP-01-LP-07	EX LIGHTING PANEL FOR 1F-2F AREA	2Y PM MCC feeder	11-02-2022
Q-3-LP-08	Q3-OSB-MLP-01-LP-08	EX LIGHTING PANEL FOR 2F-6F AREA	2Y PM MCC feeder	11-02-2022
Q-3-LP-09	Q3-OSB-MLP-01-LP-09	EX LIGHTING PANEL FOR 1F-6F AREA	2Y PM MCC feeder	11-02-2022
Q-3-LP-10	Q3-OSB-MLP-01-LP-10	EX LIGHTING PANEL / PRILLING AREA	2Y PM MCC feeder	11-02-2022
Q-3-LP-11	Q3-OSB-MLP-01-LP-11	EX LIGHTING PANEL / PRILLING AREA	2Y PM MCC feeder	11-02-2022
Q-3-MCC-HT-02	Q3-OSB-HT-01-HT-02-MCC-HT-02	400V POWER FEEDER LOC MCC5003A-SA3-FA01	2Y PM MCC feeder	11-02-2022
Q-1-T-6102-2	Q1-OSB-T6102-T61022	T-6102-2-Reliable Cooling Tower No.2	1Y-Replace oil gear box&inspection	28-02-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	17-02-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	17-02-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	17-02-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	17-02-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	17-02-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	17-02-2022
Q-2-PM-6451	Q2-OSB-6400	Process Water System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PSV-21-0303B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2Y) Calibration test	18-02-2022
Q-2-TT-26-0202	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0402	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0404	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0405	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0406	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0408	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0410	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0411	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0412	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0501	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0502	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-PM-6652A	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6652B	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6653	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6656A	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6656B	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6657A	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6657B	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6658A	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6658B	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-6659A	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-AG-6658	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-AG-6659	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-AG-6660	Q2-OSB-6650	Steam System and Condensate system	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-3-P-1307A	Q3-ISB-Q-1303-E-1306A-P-1307A	3RD CRYSTALLIZER CIRC. PUMP A	6M(Online)- Replace Lube Oil .2Hr	24-02-2022
Q-3-P-1307B	Q3-ISB-Q-1303-E-1306B-P-1307B	3RD CRYSTALLIZER CIRC. PUMP B	6M(Online)- Replace Lube Oil .2Hr	24-02-2022
Q-3-P-1301A	Q3-ISB-Q-1301-E-1303A-P-1301A	1ST CRYSTALLIZER CIRC. PUMP A	6M(Online)- Replace Lube Oil .2Hr	24-02-2022
Q-3-P-1301B	Q3-ISB-Q-1301-E-1303B-P-1301B	1ST CRYSTALLIZER CIRC. PUMP B	6M(Online)- Replace Lube Oil .2Hr	24-02-2022
Q-1-AT-61-0101	Q1-OSB-T6101-AT610101	AT610101-Main C/W Return Line	(6M) Inspect, replac,lub,MN kit AYZ Hydr	24-02-2022

17 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-AT-61-0301	Q1-OSB-T6102-AT610301	AT610301-Main Reliable C/W Return Line	(6M) Inspect, replac,lub,MN kit AYZ Hydr	24-02-2022
Q-1-AT-61-0101	Q1-OSB-T6101-AT610101	AT610101-Main C/W Return Line	(3M) Inspect and Calb AYZ Hydr 4H	24-02-2022
Q-1-AT-61-0301	Q1-OSB-T6102-AT610301	AT610301-Main Reliable C/W Return Line	(3M) Inspect and Calb AYZ Hydr 4H	24-02-2022
Q-1-PV-41-0701	Q1-OSB-TK4108-X4101-PV410701	PV410701-X-4101 Back Press Control	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-1-PV-71-0101	Q1-OSB00-D7101-PV710101	PV710101-D-7101 Outlet	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-1-PV-66-0108	Q1-OSB-PV660108	PV660108-BFW to Incinerator	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-1-PV-66-0107	Q1-OSB-PV660107	PV660107-BFW to Incinerator	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-1-AT-12-1001	Q1-OSB-OX1201-AT121001	AT121001-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	24-02-2022
Q-1-AT-12-1002	Q1-OSB-OX1201-AT121002	AT121002-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	24-02-2022
Q-1-AT-12-1401	Q1-OSB-OX1202-AT121401	AT121401-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	24-02-2022
Q-1-AT-12-1402	Q1-OSB-OX1202-AT121402	AT121402-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	24-02-2022
Q-1-P-1402B	Q1-FRC-V1401-P1402B	P-1402B-CrudeAcetoneColumnBottomsPump	4M- Replace lube oil 2Hr	28-02-2022
Q-3-C-9401	Q3-OSB-TK-9402-C-9401	REFRIGERATION COMPRESSOR	RCM 1M Oil analysis.1Hr	28-02-2022
Q-1-XD-5001B	Q1-OSB-X5001-X5001B-XD5001B	XD-5001B-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	24-02-2022
Q-1-P-1207B	Q1-OSB-OX1202-P1207B	P-1207B-Oxidizer No 2 Pumps	4M- Replace lube oil 2Hr	28-02-2022
Q-1-P-9104A	Q1-OSB-X9103-P9104A	P-9104A-CONTAMINATED WATER PUMP	1M Clean water flushing strainer	01-03-2022
Q-1-P-9103A	Q1-OSB-X9103-P9103A	P-9103A-First 20 MinuteFlushWaterPUMP	1M Clean water flushing strainer	01-03-2022
Q-2-AXT-22-1001	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-02-2022
Q-2-AXT-22-1002	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-02-2022
Q-2-AXT-22-1401	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-02-2022
Q-2-AXT-22-1402	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-02-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <*> FUEL T	28-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <*> FUEL T	28-02-2022
Q-2-AT-23-1001	Q2-OSB-2300	Phenol II Oxidation: CDN Section	(2M)Clean Filter & Cal AYZ O2	28-02-2022
Q-3-M-9202B	Q3-OSB-Z-9200-TK-9202B-M-9202B	SBR AERATION MIXER	6M Replace oil gear box.3Hr	28-02-2022
Q-3-M-9204	Q3-OSB-Z-9200-TK-9202B-M-9204	UREA TANK MIXER	6M Replace oil gear box.3Hr	28-02-2022
Q-3-M-9202A	Q3-OSB-Z-9200-TK-9202A-M-9202A	SBR AERATION MIXER	6M Replace oil gear box.3Hr	28-02-2022
Q-3-M-9203	Q3-OSB-Z-9200-TK-9202B-M-9203	SLUDGE TANK MIXER	6M Replace oil gear box.3Hr	28-02-2022
Q-2-AT-21-1901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2M) Clean Filter & Cal AYZ O2	28-02-2022
Q-2-AT-24-1103	Q2-FRC-2400	Fractionation unit	(2M) Clean Filter & Cal AYZ O2	28-02-2022
Q-2-AT-24-2801	Q2-FRC-2400	Fractionation unit	(2M) Clean Filter & Cal AYZ O2	28-02-2022
Q-1-PM-1102B	Q1-QMX-D1102-P1102B-PM1102B	PM-1102B-Propylene Charge Pump	2M Motor Greasing	28-02-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	28-02-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	28-02-2022
Q-3-P-1303	Q3-ISB-Q-1302-E-1304-P-1303	2ND CRYSTALLIZER CIRC. PUMP	6M(Online)- Replace Lube Oil .2Hr	24-02-2022
Q-3-P-1306	Q3-ISB-S-1301-N-1304-P-1306	3RD CRYSTALLIZER FEED PUMP	6M(Online)- Replace Lube Oil .2Hr	24-02-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	24-02-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	24-02-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	24-02-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	24-02-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	24-02-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	24-02-2022
Q-2-TT-26-0505	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	23-02-2022
Q-2-TT-26-0506	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022

18 of 88

Equipment	Functional Loc	Description	Description	Sched. start
Q-2-TT-26-0507	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0508	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0509	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TT-26-0510	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TXT-26-0403	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TXT-26-0407	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TXT-26-0503	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-TXT-26-0504	Q2-FRC-2600	HUEL MSHF Pcess Unit	(2Y) Inspect,Cal&Func,Test Temp Trans	22-02-2022
Q-2-P-2401B	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant 2H	21-02-2022
Q-2-P-2405B	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant 2H	21-02-2022
Q-2-P-2408B	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant 2H	21-02-2022
Q-3-P-1971	Q3-ISB-TK-1971-P-1971	PHENOL DRAIN PUMP	1M-PM Vertical Pump,2Hr	24-02-2022
Q-3-P-1974	Q3-ISB-TK-1974-P-1974	ACETONE DRAIN PUMP (ISBL)	1M-PM Vertical Pump,2Hr	24-02-2022
Q-3-P-1978	Q3-ISB-TK-1978-P-1978	ACETONE DRAIN PUMP (TANKAGE AREA)	1M-PM Vertical Pump,2Hr	24-02-2022
Q-3-P-1972	Q3-ISB-TK-1972-P-1972	ACETONE DRAIN PUMP	1M-PM Vertical Pump,2Hr	24-02-2022
Q-1-CM-1201	Q1-OC-D-1201-STC1201-CM1201	CM-1201-Oxidizer air Comp	RCM-(3M)PM MOTOR AND INSPECTION	28-02-2022
Q-2-AT-63-5101	Q2-OSB-6350	Tempered Water System	(1M) Inspect, clean and Calb AYZ Hydr	28-02-2022
Q-2-AT-61-5101	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	28-02-2022
Q-2-AT-61-5301	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	28-02-2022
Q-3-PM-1315A	Q3-ISBS03AN1313AP1315A-PM1315A	400V AC MOTOR FOR P-1315A	(6M) IR test & PI motor	21-02-2022
Q-1-PM-1102A	Q1-QMX-D1102-P1102A-PM1102A	PM-1102A-Propylene Charge Pump	2M Motor Greasing	28-02-2022
Q-1-PV-53-0101B	Q1-OSB-PV530101B	PV530101B-N2 High Flow	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-1-PV-53-0101A	Q1-OSB-PV530101A	PV530101A-N2 Normal Flow	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-1-PV-41-1403B	Q1-OSB-D4104-PV411403B	PV411403B-D-4104 Vent Gas to Flare	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-1-PV-41-1403A	Q1-OSB-D4104-PV411403A	PV411403A-D-4104 N2 Inlet Control	4Y Calibration (2 Man / 1 Hr.)	24-02-2022
Q-3-FM-200-02	Q3-OSB-FM-200-02	FM200 CONTROL PANEL 02 (SUB)	2Y-Replace Battery	21-02-2022
Q-3-RV-1501	Q3-ISB-TK-1551-RV-1501	RV-1501 ROTARY VALVE	1Y- PM Rotary valve,4Hr	24-02-2022
Q-3-RV-1602	Q3-ISB-L-1602-TK-1602-RV-1602	OFF-SPEC SILO EXIT ROTARY VALVE	1Y- PM Rotary valve,4Hr	24-02-2022
Q-3-FIRE-SYS-01	Q3-OSB-FIRE-SYS-01	FIRE ALARM ADDRESSABLE INTERF & CONT PNL	2Y-Replace Battery	21-02-2022
Q-3-FM-200-01	Q3-OSB-FM-200-01	FM200 CONTROL PANEL 01 (CCB)	2Y-Replace Battery	21-02-2022
Q-1-P-1102B	Q1-QMX-D1102-P1102B	P-1102B-Propylene Charge Pumps	6M-Lubricant and Replace oil filter	28-02-2022
Q-1-P-1301A	Q1-OC-D-V1302-P1301A	P-1301A-Flash Column Bottoms Pumps	4M- Replace lube oil,2Hr	28-02-2022
Q-1-P-1301A	Q1-OC-D-V1302-P1301A	P-1301A-Flash Column Bottoms Pumps	6M(Online)- Replace Lube Oil ,2Hr	28-02-2022
Q-1-P-1104B	Q1-QMX-V1101-P1104	P-1104A-Benzene Recycle Pump	4M-PM Pump,3Hr	28-02-2022
Q-1-P-6102C	Q1-OSB-T6101-P6102C	P-6102C-Cooling Water Circulating Pumps	8M-Replace lube oil,2Hr	28-02-2022
Q-1-P-1504B	Q1-FRC-V1501-P1504B	P-1504B-Cum-AMSCAusticWashColmRecirculat	8M-Replace lube oil,2Hr	28-02-2022
Q-1-P-9157B	Q1-OSB-TK9157-P9157B	P-9157B-WASHING PUMP (Centrifugal)	8M-Replace lube oil,2Hr	28-02-2022
Q-1-P-4110B	Q1-OSB-TK4110-P4110B	P-4110B-ConcentrateSulphuricAcidFeedPump	4M- Replace lube oil,2Hr	28-02-2022
Q-1-P-1108B	Q1-QMX-V1101-P1108B	P-1108B-Benzene Column Bottoms Pumps	8M-Replace lube oil,2Hr	28-02-2022
Q-1-P-1406B	Q1-FRC-D1405-P1406B	P-1406B-ChemTreatmentReactorEffluentPump	1Y-Replace lube oil,2Hr	28-02-2022
Q-1-P-1406B	Q1-FRC-D1405-P1406B	P-1406B-ChemTreatmentReactorEffluentPump	1Y-PM Metering Pump,3 Hr	28-02-2022
Q-1-P-1417B	Q1-FRC-J1402-P1417B	P-1417B-FractionationEjectorCondensPump	1Y-Replace lube oil,2Hr	28-02-2022
Q-1-P-1110B	Q1-QMX-V1103-P1110B	P-1110B-DIPB Column Bottoms Pumps	1Y-Replace lube oil,2Hr	28-02-2022
Q-1-P-6501B	Q1-OSB-TK6501-P6501B	P-6501B-Polable Water Pumps	1Y-Replace lube oil,2Hr	28-02-2022

19 of 83

Equipment	Functional Loc	Description	Description	Sched. start
Q-2-AT-25-0601	Q2-FRC-2500	Phenol Recovery Section	(2M) Calb AYZ PH (FF)	28-02-2022
Q-2-AT-66-5301	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	28-02-2022
Q-2-AT-66-5401	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	28-02-2022
Q-1-XD-5001A	Q1-OSB-X5001-X5001A-XD5001A	XD-5001A-Emergency Diesel Engine Gen	1M-Greasing Universal Joint,0.5Hr	24-02-2022
Q-1-C-6201	Q1-OSB-X6201-C6201	C-6201-COMPRESSOR	1M-Check N2 <(>8<)> Rotale Shaft spare C	24-02-2022
Q-3-AT-1912	Q3-ISB-TK-1910-P-1910A-AT-1912	TK-1910 OUTLET SCR TOC	1M PM Analyzer TOC	28-02-2022
Q-3-AT-9203B	Q3-OSB-Z9200TK9202B-AT-9203B	TK-9202B DISSOLVED OXYGEN ANALYZER	(2M) PM Analyzer Dissolved oxygen	28-02-2022
Q-3-AT-1911	Q3-ISB-TK-1910-P-1910A-AT-1911	TK-1910 OUTLET SCR CONDUCTIVITY	(2M) PM Analyzer Conductivity	28-02-2022
Q-3-AT-9101	Q3-OSB-TK-9101-E-9101-AT-9101	STEAM CONDENSATE RETURN CONDUCTIVITY	(2M) PM Analyzer Conductivity	28-02-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine,1.5 Hr	24-02-2022
Q-3-AT-9203A	Q3-OSB-Z9200TK9202A-AT-9203A	TK-9202A DISSOLVED OXYGEN ANALYZER	(2M) PM Analyzer Dissolved oxygen	28-02-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine,1.5 Hr	24-02-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	1M-PM Bagging Machine,1.5 Hr	24-02-2022
Q-3-AT-1871	Q3-ISB-TK-1871-Z-1871-AT-1871	Z-1871 OUTLET 20% CAUSTIC DENSITY	(3M) PM Analyzer Density	28-02-2022
Q-1-AT-91-6501	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-02-2022
Q-1-AT-91-6502	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-02-2022
Q-1-AT-91-6503	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-02-2022
Q-1-AT-91-6504	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-02-2022
Q-1-AT-91-6505	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-02-2022
Q-1-P-6901C	Q1-OSB-X6901-P6901C	P-6901C-Fire Water Pumps	1Y- REPLACE LUBE OIL, 2Hr	24-02-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>8<)> FUEL T	28-02-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>8<)> FUEL T	01-03-2022
Q-3-P-1313A	Q3-ISBS-1303A-TK-1311A-P-1313A	3RD MOTHER LIQUOR PUMP	6M(Online)- Replace Lube Oil ,2Hr	24-02-2022
Q-3-P-1314A	Q3-ISBS-1303A-TK-1312A-P-1314A	P-1314A FILTRATE PUMP	6M(Online)- Replace Lube Oil ,2Hr	24-02-2022
Q-3-P-1315A	Q3-ISB-S-1303A-N-1313A-P-1315A	MELT PUMP	6M(Online)- Replace Lube Oil ,2Hr	24-02-2022
Q-3-P-1309	Q3-ISB-Q-1304-E-1307-P-1309	4TH CRYSTALLIZER CIRC. PUMP	6M(Online)- Replace Lube Oil ,2Hr	24-02-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	1M PM Analyzer COD	28-02-2022
Q-3-AT-9205	Q3-OSB-TK9203-P9229A-AT-9205	P-9229A CONDUCTIVITY ANALYZER	(2M) PM Analyzer Conductivity	28-02-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(1M) Inspection & Cleaning	28-02-2022
Q-1-LTG-50-5002	Q1-OSB	Phenol I - Outside Battery	2Y-Replace Battery	28-02-2022
Q-3-AT-9302	Q3-OSB-Z-9302-AT-9302	Z-9302 ANALYZER CONDUCTIVITY	(2M) PM Analyzer Conductivity	28-02-2022
Q-3-AT-9601	Q3-OSB-TK-9602-Z-9601A-AT-9601	Z-9601A/B DEW POINT TEMP	(2M) Check and cal analyzer DewPointTemp	28-02-2022
Q-1-AT-51-0101	Q1-OSB-C5101A-X5101A-AT510101	AT510101-DEW POINT	(1Y) Inspect,calibrate or replac AYZ DEW	28-02-2022
Q-1-AT-51-0101	Q1-OSB-C5101A-X5101A-AT510101	AT510101-DEW POINT	(6M) Inspect and validate AYZ DEW	28-02-2022
Q-3-AT-9601	Q3-OSB-TK-9602-Z-9601A-AT-9601	Z-9601A/B DEW POINT TEMP	(6M) Inspect & validate AYZ DEW	28-02-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	28-02-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	28-02-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	28-02-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-02-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-02-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	28-02-2022
Q-2-PM-9101E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-9101F	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-9102E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022

20 of 83



Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PM-9103E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-9104E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-9108E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-9191E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-9193E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PM-9194E	Q2-OSB-9100	Drainage and Effluent Treatment System	(1Y) Inspection Megger clean re-tighten	28-02-2022
Q-2-PCV-23-1003	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Ins, Cal&Func. Test Press CNTL Valve	28-02-2022
Q-2-PCV-23-1507	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Ins, Cal&Func. Test Press CNTL Valve	28-02-2022
Q-2-PCV-23-1909	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Ins, Cal&Func. Test Press CNTL Valve	28-02-2022
Q-2-PDT-23-0301	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Ins, Cal&Func. Test Press Diff Trans	28-02-2022
Q-2-PDT-23-1401	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Ins, Cal&Func. Test Press Diff Trans	28-02-2022
Q-3-P-1904	Q3-ISB-TK-1904-P-1904	DRAIN RECEIVER PUMP	1M-PM Vertical Pump, 2Hr	28-02-2022
Q-3-P-1809	Q3-ISB-TK-1805-P-1809	TAR DRAIN RECEIVER PUMP	1M-PM Vertical Pump, 2Hr	28-02-2022
Q-3-P-1875	Q3-ISB-TK-1875-P-1875	TAR DRAIN RECEIVER PUMP (TANKAGE AREA)	1M-PM Vertical Pump, 2Hr	28-02-2022
Q-1-CM-6201	Q1-OSB-X6201-C6201-CM6201	CM-6201-Refrigerator Package Comp	RCM-(3M) PM MOTOR AND INSPECTION	28-02-2022
Q-1-PM-1103A	Q1-QMX-R1101-P1103A-PM1103A	PM-1103A-Alkylation Reac Recycle Pump	4M Motor Greasing	28-02-2022
Q-1-PM-1411A	Q1-FRC-D1407-P1411A-PM1411A	PM-1411A-Crude Phenol Colm Overhead Pump	4M Motor Greasing	28-02-2022
Q-1-PM-1507B	Q1-FRC-D1507-P1507B-PM1507B	PM-1507B-Solvent Pump	4M Motor Greasing	28-02-2022
Q-1-PV-41-0106	Q1-OSB-TK4101B-PV410106	PV410106-Prop Vapor Header Press Control	4Y Calibration (2 Man / 1 Hr.)	28-02-2022
Q-1-PV-15-0801	Q1-FRC-V1503-PV150801	PV150801-Xtrac OilCaut.Scrub Col.OH Liq	4Y Calibration (2 Man / 1 Hr.)	28-02-2022
Q-1-PV-15-0501	Q1-FRC00-X1502-PV150501	PV150501-Sodm Phent.P Liq Dlay P StalMix	4Y Calibration (2 Man / 1 Hr.)	28-02-2022
Q-1-PV-15-0401	Q1-FRC-D1501-PV150401	PV150401-CumAMS to Fd.TK at Huel MSHP	4Y Calibration (2 Man / 1 Hr.)	28-02-2022
Q-1-PM-1104A	Q1-QMX-V1101-P1104-PM1104	PM-1104-Benzene Recycle Pump	4M Motor Greasing	28-02-2022
Q-1-PM-6103B	Q1-OSB-T6101-P6103B-PM6103B	PM-6103B-HP C/W Cir Pump	2M Motor Greasing	31-03-2022
Q-1-CM-9132C	Q1-OSB-X9134-C9132C-CM9132C	CM-9132C-SBR Blower	4M Motor Greasing	30-03-2022
Q-1-CM-9132E	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	4M Motor Greasing	30-03-2022
Q-1-CM-9132F	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	4M Motor Greasing	30-03-2022
Q-1-X-9117	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	01-03-2022
Q-1-X-9163	Q1-OSB-D9163-X9163	X-9163-N-NUTRIENT MIXER	6M Vibration Monitoring	01-03-2022
Q-1-P-9116B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M-Re-Lubricant 2H	25-03-2022
Q-1-P-1108A	Q1-QMX-V1101-P1108A	P-1108A-Benzene Column Bottoms Pumps	6M Vibration Monitoring	01-03-2022
Q-1-P-1109A	Q1-QMX-V1102-P1109A	P-1109A-Cumene Column Bottoms Pumps	6M Vibration Monitoring	01-03-2022
Q-1-P-1113A	Q1-QMX-V1103-P1113A	P-1113A-DIPB Column Drag Pumps	6M Vibration Monitoring	01-03-2022
Q-1-P-1110A	Q1-QMX-V1103-P1110A	P-1110A-DIPB Column Bottoms Pumps	6M Vibration Monitoring	01-03-2022
Q-1-P-4109A	Q1-OSB-TK4109-P4109A	P-4109A-20 wt% Caustic Transfer Pumps	6M Vibration Monitoring	01-03-2022
Q-1-P-6101A	Q1-OSB-T6102-P6101A	P-6101A-ReliabCoolWaterSlipStreamFillePu	6M Vibration Monitoring	01-03-2022
Q-1-P-6301A	Q1-OSB-TK6301-P6301A	P-6301A-Tempered Water Circulation Pumps	6M Vibration Monitoring	01-03-2022
Q-1-P-9119B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	01-03-2022
Q-1-T-6102-3	Q1-OSB-T6102-T61023	T-6102-3-Reliable Cooling Tower No.3	1M-Replace oil gear box&inspection	25-03-2022
Q-1-PM-6103A	Q1-OSB-T6101-P6103A-PM6103A	PM-6103A-HP C/W Cir Pump	Motor Greasing	31-03-2022
Q-1-PM-6103C	Q1-OSB-T6101-P6103C-PM6103C	PM-6103C-HP C/W Cir Pump	Motor Greasing	31-03-2022
Q-1-CM-9132C	Q1-OSB-X9134-C9132C-CM9132C	CM-9132C-SBR Blower	Motor Greasing	30-03-2022
Q-1-CM-9132E	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	Motor Greasing	30-03-2022
Q-1-CM-9132F	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	Motor Greasing	30-03-2022

21 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-1104A	Q1-QMX-V1101-P1104-PM1104	PM-1104-Benzene Recycle Pump	Motor Greasing	30-03-2022
Q-1-TR-5001A	Q1-OSB-SWJ105-SWJ104-TR5001A	TR-5001A-Transformer 5001A	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5001B	Q1-OSB-SWJ105-SWJ103-TR5001B	TR-5001B-Transformer 5001B	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5001C	Q1-OSB-SWJ105-SWJ102-TR5001C	TR-5001C-Transformer 5001C	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5001D	Q1-OSB-SWJ105-SWJ101-TR5001D	TR-5001D-Transformer 5001D	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5002A	Q1-OSB-SWL112-SWL111-TR5002A	TR-5002A-Transformer 5002A	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5002B	Q1-OSB-SWL11600-SWL117-TR5002B	TR-5002B-Transformer 5002B	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5002C	Q1-OSB-SWL112-SWL109-TR5002C	TR-5002C-Transformer 5002C	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5002D	Q1-OSB-SWL11600-SWL119-TR5002D	TR-5002D-Transformer 5002D	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5003A	Q1-OSB-SWL112-SWL110-TR5003A	TR-5003A-Transformer 5003A	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5003B	Q1-OSB-SWL11600-SWL118-TR5003B	TR-5003B-Transformer 5003B	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5003C	Q1-OSB-SWL206-SWL205-TR5003C	TR-5003C-Transformer 5003C	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5003D	Q1-OSB-SWL210-SWL212-TR5003D	TR-5003D-Transformer 5003D	RCM-3M INSPECTION	31-03-2022
Q-1-TR-5004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-3M INSPECTION	31-03-2022
Q-2-X-2051	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(1M) PM Oil Mist	21-03-2022
Q-2-X-2052	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1M) PM Oil Mist	21-03-2022
Q-2-X-2053	Q2-OSB-6150	Phenol Recovery Section	(1M) PM Oil Mist	21-03-2022
Q-2-P-2108A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	6M Vibration Monitoring	28-03-2022
Q-2-P-2109A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	6M Vibration Monitoring	28-03-2022
Q-2-P-2110A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	6M Vibration Monitoring	28-03-2022
Q-2-P-2601A	Q2-FRC-2600	HUEL MSHP Pcess Unit	6M Vibration Monitoring	21-03-2022
Q-2-P-2602A	Q2-FRC-2600	HUEL MSHP Pcess Unit	6M Vibration Monitoring	21-03-2022
Q-2-P-2603A	Q2-FRC-2600	HUEL MSHP Pcess Unit	6M Vibration Monitoring	11-03-2022
Q-2-FV-23-0403	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-0501	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-0801	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-1001	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-1201	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-1202	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-1205	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-1301	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-1801	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-FV-23-1802	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-PM-2104A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	29-03-2022
Q-2-PM-2112A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	29-03-2022
Q-2-PM-2203A	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	29-03-2022
Q-2-PM-2307A	Q2-OCD-2300	Phenol II Oxidation CDN Section	Motor Greasing	29-03-2022
Q-2-PM-2401A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-03-2022
Q-2-PM-2404A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-03-2022
Q-2-PM-2406A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-03-2022
Q-2-PM-4152A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	29-03-2022
Q-2-PM-6652A	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	29-03-2022
Q-2-PM-6656A	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	29-03-2022
Q-2-PM-2109A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	29-03-2022

22 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PM-2110A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	29-03-2022
Q-2-PM-2208A	Q2-OCN-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	29-03-2022
Q-2-PM-2301A	Q2-OCN-2300	Phenol II Oxidation CDN Section	Motor Greasing	29-03-2022
Q-2-PM-2402A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-03-2022
Q-2-PM-2406A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-03-2022
Q-2-PM-2410A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-03-2022
Q-2-PM-2415A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-03-2022
Q-2-TR-5054A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5054B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5055A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5055B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5056A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5056B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5053A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5053B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5052A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-2-TR-5052B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-03-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(1M) Archive HIST Data and Config. to CD	07-03-2022
Q-3-S-1301	Q3-ISB-S-1301	1ST SEPARATOR	1M-PM Separator,4Hr	23-03-2022
Q-3-S-1302	Q3-ISB-S-1302	2ND SEPARATOR	1M-PM Separator,4Hr	23-03-2022
Q-3-Z-1301	Q3-ISB-1300	PURIFICATION	1M-PM Oil Mist System	28-03-2022
Q-1-GC/GT-00-1100	Q1-QMX-GCGT001100	GC/GT-00-1100 Q-Max Area Gas DET	6M PM Hydro & Toxic Gas DET(Mar&Sep)	30-03-2022
Q-1-GC/GT-00-1214	Q1-OCN-GCGT001214	GC/GT-00-1214 OCN & Phenol Area G/D	6M PM Hydro & Toxic Gas DET(Mar&Sep)	30-03-2022
Q-1-PSH-69-1604	Q1-OSB-FMADM001-PSH691604	PSH691604-Admin Building Inergen Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1603	Q1-OSB-FMWWT001-PSH691603	PSH691603-WWT Building Inergen Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1602	Q1-OSB-FMADM001-PSH691602	PSH691602-Admin Building Inergen Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1601	Q1-OSB-FMCCB001-PSH691601	PSH691601-Control Building Inergen Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1502	Q1-OSB-FMCCB001-PSH691502	PSH691502-Control Building Inergen Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1501	Q1-OSB-FMCCB001-PSH691501	PSH691501-Control Building Inergen Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1404	Q1-OSB-COWWT001-PSH691404	PSH691404-WWT Control Building CO2 Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1403	Q1-OSB-COSUB001-PSH691403	PSH691403-Sub-station Building CO2 Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1402	Q1-OSB-COSUB001-PSH691402	PSH691402-Sub-station Building CO2 Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1401	Q1-OSB-COSUB001-PSH691401	PSH691401-Sub-station Building CO2 Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1303	Q1-OSB-COCCB001-PSH691303	PSH691303-Control Building CO2 Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1302	Q1-OSB-COCCB001-PSH691302	PSH691302-Control Building CO2 Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-PSH-69-1301	Q1-OSB-COCCB001-PSH691301	PSH691301-Control Building CO2 Sys	6M Inspec and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-GC/GT-00-41XX	Q1-OSB-GCGT0041XX	GC/GT-00-41XX OSBL Area Gas DET	6M PM Hydro & Toxic Gas DET(Mar&Sep)	30-03-2022
Q-3-EML-CCB-207	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-208	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-209	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-210	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-101	Q3-OSB-EES-LP01A-5A-01	CCB BPA MAIN ENTRANCE FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-102	Q3-OSB-EES-LP01A-5B-10	CCB BPA SUB ENTRANCE FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-103	Q3-OSB-EES-LP01A-6A-02	CCB BPA INSTRUMENT ROOM FL.1	(3M) Inspection and function test	02-03-2022

23 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-EES-CCB-201	Q3-OSB-EES-LP01B-3B-01	CCB BPA CORRIDOR LAB FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-202	Q3-OSB-EES-LP01B-4B-09	CCB BPA MEETING ROOM3 FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-203	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-204	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-205	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EES-CCB-206	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EES-SUB-101	Q3-OSB-EES-MLP01B-3A-02	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EES-SUB-102	Q3-OSB-EES-MLP01A-2A-04	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EES-SUB-103	Q3-OSB-EES-MLP01B-3A-07	SUB BPA BLDG EDG ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EES-WWT-001	Q3-OSB-EES-LP15-1B-02	WWT BPA BLDG MCC / CONTROL ROOM FL.G	(3M) Inspection and function test	02-03-2022
Q-3-EES-WWT-101	Q3-OSB-EES-LP15-1C-03	WWT BPA BLDG BELT PRESS ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-101	Q3-OSB-EML-LP01A-5A-01	CCB BPA MAIN ENTRANCE FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-102	Q3-OSB-EML-LP01A-6A-09	CCB BPA CORRIDOR FILES ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-103	Q3-OSB-EML-LP01A-5B-10	CCB BPA SUB ENTRANCE FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-104	Q3-OSB-EML-LP01A-6A-06	CCB BPA CORRIDOR CCR FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-105	Q3-OSB-EML-LP01A-5A-10	CCB BPA CCR FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-106	Q3-OSB-EML-LP01A-6A-02	CCB BPA INSTRUMENT ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-201	Q3-OSB-EML-LP01B-4A-10	CCB BPA UP STAIRS FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-202	Q3-OSB-EML-LP01B-4B-05	CCB BPA RECEPTION FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-203	Q3-OSB-EML-LP01B-3B-07	CCB BPA CORRIDOR FILES ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-204	Q3-OSB-EML-LP01B-3B-01	CCB BPA CORRIDOR LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-205	Q3-OSB-EML-LP01B-4B-02	CCB BPA CORRIDOR LAB ROOM FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-CCB-206	Q3-OSB-EML-LP01B-4B-09	CCB BPA MEETING ROOM3 FL.2	(3M) Inspection and function test	02-03-2022
Q-3-EML-SUB-101	Q3-OSB-EML-MLP01B-3A-02	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-SUB-102	Q3-OSB-EML-MLP01A-2A-04	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-SUB-103	Q3-OSB-EML-MLP01A-2A-06	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-SUB-104	Q3-OSB-EML-MLP01B-3A-07	SUB BPA BLDG EDG ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-3-EML-WWT-001	Q3-OSB-EES-LP15-1B-02	WWT BPA BLDG MCC / CONTROL ROOM FL.G	(3M) Inspection and function test	02-03-2022
Q-3-EML-WWT-101	Q3-OSB-EES-LP15-1C-03	WWT BPA BLDG BELT PRESS ROOM FL.1	(3M) Inspection and function test	02-03-2022
Q-1-PM-6201B	Q1-OSB00-TK6201-P6201B-PM6201B	PM-6201B-Chilled Water Transfer Pump	4M Motor Greasing	31-03-2022
Q-1-PM-4112B	Q1-OSB-TK4112A-P4112B-PM4112B	PM-4112B-Phenol Rundown Pump	4M Motor Greasing	31-03-2022
Q-1-P-6113B	Q1-OSB-T6101-P6113B	P-6113B-CoolingWaterSlipStreamFilterPump	1Y-Replace lube oil 2Hr	25-03-2022
Q-1-PM-6301B	Q1-OSB-TK6301-P6301B-PM6301B	PM-6301B-Tempered Water Cir Pump	4M Motor Greasing	31-03-2022
Q-1-PM-6302B	Q1-OSB-TK6301-P6302B-PM6302B	PM-6302B-High Pressure Temper Water Cir	4M Motor Greasing	31-03-2022
Q-1-PM-6113B	Q1-OSB-T6101-P6113B-PM6113B	PM-6113B-C/W Slip Stream Filter Pump	4M Motor Greasing	31-03-2022
Q-1-PM-6401	Q1-OSB00-TK6401-P6401B-PM6401	PM-6401-Process Water Pump	4M Motor Greasing	31-03-2022
Q-1-P-6301B	Q1-OSB-TK6301-P6301B	P-6301B-Tempered Water Circulation Pumps	1Y-Replace lube oil 2Hr	25-03-2022
Q-1-P-6302B	Q1-OSB-TK6301-P6302B	P-6302B-HiPressTemperedWaterCirculationP	1Y-Replace lube oil 2Hr	25-03-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	30-03-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	30-03-2022
Q-3-AT-1912	Q3-ISB-TK-1910-P-1910A-AT-1912	TK-1910 OUTLET SCR TOC	1M PM Analyzer TOC	30-03-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	1M PM Analyzer COD	30-03-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(1M) Inspection & Cleaning	30-03-2022
Q-3-GD-11XX	Q3-ISB-FGS-EWS-FGS-01-SUM-AREA	GAS DETECT FOR Area 1100	6M PM Hydro & Toxic Gas DET(Mar&Sep)	28-03-2022

24 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-1303A	Q1-OCDD-1304-P1303A-PM1303A	PM-1303A-Decomposer Product Pump	4M Motor Greasing	30-03-2022
Q-1-PM-1601B	Q1-QMX-TK1601-P1601B-PM1601B	PM-1601B-Hydrogenation Charge Pump	2M Motor Greasing	31-03-2022
Q-1-EES-SUB-001	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-002	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-003	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-004	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-101	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-102	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-103	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-104	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-SUB-105	Q1-OSB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-TLH-001	Q1-OSB-EES-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-001	Q1-OSB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-002	Q1-OSB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-003	Q1-OSB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-004	Q1-OSB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-005	Q1-OSB-EES-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-006	Q1-OSB-EES-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-101	Q1-OSB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-102	Q1-OSB-EES-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EES-WWT-103	Q1-OSB-EES-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-SUB-001	Q1-OSB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-SUB-002	Q1-OSB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-SUB-003	Q1-OSB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-SUB-004	Q1-OSB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-SUB-005	Q1-OSB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-SUB-006	Q1-OSB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-TLH-001	Q1-OSB-EML-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(3M) Inspection and function test	30-03-2022
Q-1-EML-TLH-002	Q1-OSB-EML-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(3M) Inspection and function test	30-03-2022
Q-1-EML-WWT-001	Q1-OSB-EML-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-WWT-002	Q1-OSB-EML-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	30-03-2022
Q-1-EML-WWT-101	Q1-OSB-EML-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	30-03-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1M-Replace Lube Oil	25-03-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1M-Replace Lube Oil	25-03-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1M-Replace Lube Oil	25-03-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	25-03-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	25-03-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	25-03-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	28-03-2022
Q-2-P-2418A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	30-03-2022
Q-2-P-9101E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	30-03-2022
Q-2-P-9101F	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	30-03-2022
Q-2-P-9191E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	25-03-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	28-03-2022

25 of 45

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-1303B	Q1-OCDD-1304-P1303B-PM1303B	PM-1303B-Decomposer Product Pump	4M Motor Greasing	31-03-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-2-FV-23-2001	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-HV-23-0401	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-HV-23-0601	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-HV-23-0801	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-HV-23-0802	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-HV-23-1001	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-HV-23-1201	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-LV-23-0501	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-LV-23-0601	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-LV-23-0701	Q2-OCDD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test CNTL Valve	21-03-2022
Q-2-PSV-22-0601A	Q2-OCDD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	07-03-2022
Q-2-PSV-22-1001A	Q2-OCDD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	07-03-2022
Q-2-PSV-22-1401A	Q2-OCDD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	07-03-2022
Q-1-00B01-VMS	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	15-03-2022
Q-1-C1201-OXIDIZER	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	15-03-2022
Q-1-D1204-CHARCOAL	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	15-03-2022
Q-1-DCS-HIS	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	15-03-2022
Q-1-FGS	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	15-03-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(1M) Archive HIST Data and Config. to CD	21-03-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	07-03-2022
Q-3-FGS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	07-03-2022
Q-3-VMS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	07-03-2022
Q-3-WWT01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	07-03-2022
Q-2-TGD-20-00XX	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022
Q-2-HGD-20-00XX	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022
Q-2-O2D-20-0003	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022
Q-2-O2D-20-0004	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022
Q-2-O2D-20-0005	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022
Q-1-TDT-13-1809	Q1-OCDD-1304-X1309B-TDT131809	TDT131809-Calorimeter B Differ Temp	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TDT-13-1806	Q1-OCDD-1304-X1309A-TDT131806	TDT131806-Calorimeter A Differ Temp	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TE-00-0001	Q1-OSB-TE000001	TE000001-Temp Sensor	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TE-00-0001A	Q1-OSB-TE000001A	TE000001A-Temp Sensor	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	25-03-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	25-03-2022
Q-2-O2D-20-00XX	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022
Q-2-O2D-20-0006	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022
Q-2-O2D-20-0007	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb GAS DET	30-03-2022

26 of 45



Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-02D-20-0008	Q2-OSB-5050	Electricity Distribution and Control	(6M) Inspect, clean and Calb G	30-03-2022
Q-2-AT-24-1501	Q2-FRC-2400	Fractionation unit	(3M) Inspect, clean and Calb AYZ GC	30-03-2022
Q-1-FSH-65-9102	Q1-OSB-TK6501-FSH659102	FSH659102-Safety Shower ES-9102 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-9101	Q1-OSB-TK6501-FSH659101	FSH659101-Safety Shower ES-9101 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-6002	Q1-OSB-TK6501-FSH656002	FSH656002-Safety Shower ES-6002 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-6001	Q1-OSB-TK6501-FSH656001	FSH656001-Safety Shower ES-6001 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-5002	Q1-OSB-TK6501-FSH655002	FSH655002-Safety Shower ES-5002 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-5001	Q1-OSB-TK6501-FSH655001	FSH655001-Safety Shower ES-5001 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4204	Q1-OSB-TK6501-FSH654204	FSH654204-Safety Shower ES-4204 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4203	Q1-OSB-TK6501-FSH654203	FSH654203-Safety Shower ES-4203 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4202	Q1-OSB-TK6501-FSH654202	FSH654202-Safety Shower ES-4202 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4201	Q1-OSB-TK6501-FSH654201	FSH654201-Safety Shower ES-4201 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4107	Q1-OSB-TK6501-FSH654107	FSH654107-Safety Shower ES-4107 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4106	Q1-OSB-TK6501-FSH654106	FSH654106-Safety Shower ES-4106 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4105	Q1-OSB-TK6501-FSH654105	FSH654105-Safety Shower ES-4105 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4104	Q1-OSB-TK6501-FSH654104	FSH654104-Safety Shower ES-4104 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4103	Q1-OSB-TK6501-FSH654103	FSH654103-Safety Shower ES-4103 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4102	Q1-OSB-TK6501-FSH654102	FSH654102-Safety Shower ES-4102 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-4101	Q1-OSB-TK6501-FSH654101	FSH654101-Safety Shower ES-4101 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	28-03-2022
Q-1-FSH-65-1221	Q1-OSB-TK6501-FSH651221	FSH651221-Safety Shower ES-1221 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1220	Q1-OSB-TK6501-FSH651220	FSH651220-Safety Shower ES-1220 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1219	Q1-OSB-TK6501-FSH651219	FSH65121900-Safety Shower ES-1219 Flow S	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1218	Q1-OSB-TK6501-FSH651218	FSH651218-Safety Shower ES-1218 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1217	Q1-OSB-TK6501-FSH651217	FSH651217-Safety Shower ES-1217 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1216	Q1-OSB-TK6501-FSH651216	FSH65121600-Safety Shower ES-1216 Flow S	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1215	Q1-OSB-TK6501-FSH651215	FSH651215-Safety Shower ES-1215 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1214	Q1-OSB-TK6501-FSH651214	FSH651214-Safety Shower ES-1214 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1213	Q1-OSB-TK6501-FSH651213	FSH65121300-Safety Shower ES-1213 Flow S	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1212	Q1-OSB-TK6501-FSH651212	FSH651212-Safety Shower ES-1212 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1211	Q1-OSB-TK6501-FSH651211	FSH651211-Safety Shower ES-1211 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1210	Q1-OSB-TK6501-FSH651210	FSH651210-Safety Shower ES-1210 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1209	Q1-OSB-TK6501-FSH651209	FSH651209-Safety Shower ES-1209 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1208	Q1-OSB-TK6501-FSH651208	FSH651208-Safety Shower ES-1208 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	29-03-2022
Q-1-FSH-65-1207	Q1-OSB-TK6501-FSH651207	FSH651207-Safety Shower ES-1207 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1206	Q1-OSB-TK6501-FSH651206	FSH651206-Safety Shower ES-1206 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1205	Q1-OSB-TK6501-FSH651205	FSH651205-Safety Shower ES-1205 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1204	Q1-OSB-TK6501-FSH651204	FSH651204-Safety Shower ES-1204 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1203	Q1-OSB-TK6501-FSH651203	FSH651203-Safety Shower ES-1203 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1202	Q1-OSB-TK6501-FSH651202	FSH651202-Safety Shower ES-1202 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1201	Q1-OSB-TK6501-FSH651201	FSH651201-Safety Shower ES-1201 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1109	Q1-OSB-TK6501-FSH651109	FSH651109-Safety Shower ES-1109 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1108	Q1-OSB-TK6501-FSH651108	FSH651108-Safety Shower ES-1108 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1107	Q1-OSB-TK6501-FSH651107	FSH651107-Safety Shower ES-1107 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1106	Q1-OSB-TK6501-FSH651106	FSH651106-Safety Shower ES-1106 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022

27 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-FSH-65-1105	Q1-OSB-TK6501-FSH651105	FSH651105-Safety Shower ES-1105 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1104	Q1-OSB-TK6501-FSH651104	FSH651104-Safety Shower ES-1104 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1103	Q1-OSB-TK6501-FSH651103	FSH651103-Safety Shower ES-1103 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1102	Q1-OSB-TK6501-FSH651102	FSH651102-Safety Shower ES-1102 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-1-FSH-65-1101	Q1-OSB-TK6501-FSH651101	FSH651101-Safety Shower ES-1101 Flow SW.	6M Inspect and Function Test (1 Man/4 Hr)	31-03-2022
Q-3-P-1402	Q3-ISB-D-1405-P-1402	STRIPPER CONDENSATE PUMP	6M(Online)- Replace Lube Oil 2Hr	28-03-2022
Q-3-L-1602	Q3-ISB-L-1602	BPA PRODUCT CONVEYOR 1	RCM 1M PM Bucket conveyor 2.5Hr	23-03-2022
Q-2-AT-23-1701	Q2-OSB-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	30-03-2022
Q-2-AT-23-1901	Q2-OSB-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	30-03-2022
Q-1-PM-1112A	Q1-QMX-D1103-P1112A-PM1112A	PM-1112A-S3 Steam Generator Cir Pump	4M Motor Greasing	30-03-2022
Q-1-PM-1110A	Q1-QMX-V1103-P1110A-PM1110A	PM-1110A-DIPB Colm Bottoms Pump	4M Motor Greasing	30-03-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <P><C> FUEL T	30-03-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <P><C> FUEL T	30-03-2022
Q-3-L-1604	Q3-ISB-L-1604	BPA PRODUCT CONVEYOR 3	RCM 1M PM Bucket conveyor 2.5Hr	23-03-2022
Q-1-PM-1415B	Q1-FRC-V1406-P1415B-PM1415B	PM-1415B-Phenol Recl Bottoms Pump	4M Motor Greasing	31-03-2022
Q-1-P-6601	Q1-OSB00-TK6601-P6601	P-6601-Low Head Condensate Transfer Pump	8M-Replace lube oil 2Hr	25-03-2022
Q-1-P-6604	Q1-OSB00-TK6601-P6604	P-6604-OIL FILTER CIRCULATION PUMP	8M-Replace lube oil 2Hr	25-03-2022
Q-1-GT-00-4206	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	30-03-2022
Q-1-GT-00-4207	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	30-03-2022
Q-1-GT-00-4208	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	30-03-2022
Q-2-P-9102E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	25-03-2022
Q-2-P-9103E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	25-03-2022
Q-2-P-9193E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	25-03-2022
Q-2-P-9194E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	25-03-2022
Q-2-P-4110B	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant 2H	25-03-2022
Q-2-P-4151B	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant	25-03-2022
Q-2-EES-EDG-001	Q2-OSB-EES-ELP-5051-11T-1	PH2 EDG ROOM	(3M) Inspection and function test	30-03-2022
Q-2-EES-IRR-001	Q2-OSB-EES-ELP-5052-05T-5	INSTRUMENT RACK ROOM PH2	(3M) Inspection and function test	30-03-2022
Q-2-EES-IRR-002	Q2-OSB-EES-ELP-5052-05T-4	INSTRUMENT RACK ROOM PH2	(3M) Inspection and function test	30-03-2022
Q-2-EES-IRR-003	Q2-OSB-EES-ELP-5052-05T-1	INST. RACK ROOM PH2 BATTERY ROOM1	(3M) Inspection and function test	30-03-2022
Q-2-EES-IRR-004	Q2-OSB-EES-ELP-5052-05T-2	INST. RACK ROOM PH2 BATTERY ROOM2	(3M) Inspection and function test	30-03-2022
Q-2-EES-IRR-005	Q2-OSB-EES-ELP-5052-05T-3	INST. RACK ROOM PH2 BATTERY ROOM2	(3M) Inspection and function test	30-03-2022
Q-2-EES-SUB-001	Q2-OSB-EES-ELP-5051-09S-5	SUB PH2 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-2-EES-SUB-002	Q2-OSB-EES-ELP-5051-09S-2	SUB PH2 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	30-03-2022
Q-2-EES-SUB-101	Q2-OSB-EES-ELP-5051-09S-4	SUB PH2 BLDG LV SWGR ROOM FL.1	(3M) Inspection and function test	30-03-2022
Q-2-EES-SUB-102	Q2-OSB-EES-ELP-5051-09S-1	SUB PH2 BLDG LV SWGR ROOM FL.1	(3M) Inspection and function test	30-03-2022
Q-2-EES-SUB-201	Q2-OSB-EES-ELP-5051-09S-6	SUB PH2 BLDG MV SWGR ROOM FL.2	(3M) Inspection and function test	30-03-2022
Q-2-EES-SUB-202	Q2-OSB-EES-ELP-5051-09S-3	SUB PH2 BLDG MV SWGR ROOM FL.2	(3M) Inspection and function test	30-03-2022
Q-1-T-6101-3	Q1-OSB-T6101-T61013	T-6101-3-Cooling Tower No.3	1Y-Replace oil gear box&inspecton	25-03-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022

28 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-2-PSV-22-0601B	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	14-03-2022
Q-2-PSV-22-1001B	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	14-03-2022
Q-2-PSV-22-1401B	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	14-03-2022
Q-2-PM-9451	Q2-OSB-9450	Aromatic Closed Drain System	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-9452	Q2-OSB-9450	Aromatic Closed Drain System	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2101	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2102A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2102B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-LV-23-0801	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-LV-23-0803	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-LV-23-1008	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-LV-23-1101	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1001	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1002	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1008	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1101A	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1101B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1202A	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PM-9251	Q2-OSB-9200	Flare and Blown Down System	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-9253	Q2-OSB-9200	Flare and Blown Down System	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-ELP-2101	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection cleaning re-tighten	30-03-2022
Q-2-LP-2101	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection cleaning re-tighten	30-03-2022
Q-2-C2201-OXIDIZER	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	21-03-2022
Q-2-CHARCOAL	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	21-03-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	21-03-2022
Q-2-FGS	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	21-03-2022
Q-2-MMS	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	21-03-2022
Q-3-L-1603	Q3-ISB-L-1603	BPA PRODUCT CONVEYOR 2	RCM 1M PM Bucket conveyor.2.5Hr	23-03-2022
Q-3-L-1601	Q3-ISB-L-1601	1ST PRODUCT CONVEYOR	RCM 1M PM Bucket conveyor.2.5Hr	23-03-2022
Q-3-GD-12XX	Q3-ISBGS-EWS-FGS-01-SUM-AREA	GAS DETECT FOR Area 1200	6M PM Hydro & Toxic Gas DET(Mar&Sep)	30-03-2022
Q-1-TE-71-0104	Q1-OSB00-D7101-X7101-TE710104	TE710104-Run B Natural Gas Metering Skid	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TE-71-0103	Q1-OSB00-D7101-X7101-TE710103	TE710103-Run A Natural Gas Metering Skid	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TI-11-0805	Q1-QMX-V1101-P1104-TI110805	TI110805-P-1104	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TI-95-0104	Q1-OSB-D1414-E1423-TI950104	TI950104-E1423 Hot Side Inlet Temp Gauge	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-3-GD-17XX	Q3-ISBGS-EWS-FGS-01-SUM-AREA	GAS DETECT FOR Area 1200	6M PM Hydro & Toxic Gas DET(Mar&Sep)	30-03-2022
Q-1-PM-4113B	Q1-OSB-TK4113A-P4113B-PM4113B	PM-4113B-Acelone Rundown Pump	4M Motor Greasing	31-03-2022
Q-3-S-1303A	Q3-ISB-S-1303A	3RD SEPARATOR	6M - PM Decantor.8Hr	28-03-2022
Q-3-L-1605	Q3-ISB-L-1605	BPA SHIPPING CONVEYOR	RCM 1M PM Bucket conveyor.2.5Hr	28-03-2022
Q-3-S-1303B	Q3-ISB-S-1303B	3RD SEPARATOR	6M - PM Decantor.8Hr	28-03-2022
Q-3-C-9401	Q3-OSB-TK-9402-C-9401	REFRIGERATION COMPRESSOR	RCM 1M Oil analysis.1Hr	28-03-2022
Q-2-AXT-22-1001	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	30-03-2022
Q-2-AXT-22-1002	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	30-03-2022
Q-2-AXT-22-1401	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	30-03-2022

28 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-AXT-22-1402	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	30-03-2022
Q-1-PM-1101	Q1-QMX-D1101A-P1101-PM1101	PM-1101-Propylene Deinventorying Pump	4M Motor Greasing	30-03-2022
Q-1-XD-5001B	Q1-OSB-X5001-X5001B-XD5001B	XD-5001B-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	28-03-2022
Q-1-P-9104A	Q1-OSB-X9103-P9104A	P-9104A-CONTAMINATED WATER PUMP	1M Clean water flushing strainer	31-03-2022
Q-1-P-9103A	Q1-OSB-X9103-P9103A	P-9103A-First 20 Minute Flush Water Pit Pump	1M Clean water flushing strainer	31-03-2022
Q-1-AT-12-1001	Q1-OSB-OX1201-AT121001	AT121001-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	30-03-2022
Q-1-AT-12-1002	Q1-OSB-OX1201-AT121002	AT121002-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	30-03-2022
Q-1-AT-12-1401	Q1-OSB-OX1202-AT121401	AT121401-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	30-03-2022
Q-1-AT-12-1402	Q1-OSB-OX1202-AT121402	AT121402-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	30-03-2022
Q-3-EDG-SYN-01-PLC	Q3-OSB-Z-9901-EDG001-EDG001-SYN-01	EMER DIESEL GENERATOR AUTO SYNCH PANEL	6M Visual Inspection&Volt Terminal	17-03-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	30-03-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	30-03-2022
Q-3-Z-1501	Q3-ISB-D-1501-Z-1501	PRILL SCREEN	6M(SD)-Inspect,Greasing<?&<?>Belt Check	23-03-2022
Q-3-Z-9301A	Q3-OSB-Z-9301A	COOLING TOWER A	6M-Replace oil gear box. 3Hr	25-03-2022
Q-3-Z-9301B	Q3-OSB-Z-9301B	COOLING TOWER B	6M-Replace oil gear box. 3Hr	25-03-2022
Q-3-Z-9301C	Q3-OSB-Z-9301C	COOLING TOWER C	6M-Replace oil gear box. 3Hr	25-03-2022
Q-3-L-1603	Q3-ISB-L-1603	BPA PRODUCT CONVEYOR 2	SD-Inspect Bucket and Lubrication	28-03-2022
Q-3-L-1604	Q3-ISB-L-1604	BPA PRODUCT CONVEYOR 3	SD-Inspect Bucket and Lubrication	28-03-2022
Q-3-C-1401B	Q3-ISB-D-1401-C-1401B	DEPHENOLATOR VACUUM UNIT B	RCM 1Y- PM Vacuum pump.4Hr	28-03-2022
Q-3-NA-1304	Q3-ISB-S-1301-N-1304-NA-1304	SOLUTION AGITATOR	1Y Replace oil gear box.3Hr	28-03-2022
Q-3-NA-1313A	Q3-ISBS-1303A-N-1313A-NA-1313A	MELT AGITATOR	1Y Replace oil gear box.3Hr	28-03-2022
Q-3-NA-1310	Q3-ISB-S-1302-N-1310-NA-1310	RESLURRY AGITATOR	1Y Replace oil gear box.3Hr	28-03-2022
Q-3-NA-1313B	Q3-ISBS-1303B-N-1313B-NA-1313B	MELT AGITATOR	1Y Replace oil gear box.3Hr	28-03-2022
Q-3-L-1604	Q3-ISB-L-1604	BPA PRODUCT CONVEYOR 3	1Y PM Bucket conveyor.5Hr	28-03-2022
Q-3-C-1401A	Q3-ISB-D-1401-C-1401A	DEPHENOLATOR VACUUM UNIT A	RCM 3M- Replace Lube Oil .1.5Hr	28-03-2022
Q-3-C-1301	Q3-ISB-C-1301	SEPARATOR VACUUM PUMP	1Y- Replace oil gear.2Hr	28-03-2022
Q-3-L-1603	Q3-ISB-L-1603	BPA PRODUCT CONVEYOR 2	1Y PM Bucket conveyor.5Hr	28-03-2022
Q-3-NA-1501	Q3-ISB-TK-1551-N-1501-NA-1501	REWORK AGITATOR	1Y Replace oil gear box.3Hr	28-03-2022
Q-3-D-1401	Q3-ISB-D-1401	DEPHENOLATOR	1Y-Replace oil gear box.3Hr	28-03-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagen&Consumable	30-03-2022
Q-2-P-9105E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	25-03-2022
Q-2-P-9108E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	25-03-2022
Q-2-P-4152B	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant 2H	25-03-2022
Q-2-P-4157	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant 2H	25-03-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagen&Consumable	30-03-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	25-03-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	25-03-2022
Q-2-PV-23-1202B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1301A	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022
Q-2-PV-23-1301B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test CNTL Valve	21-03-2022

30 of 83



Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PV-23-1401	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func, Test CNTL Valve	21-03-2022
Q-2-TV-23-0703	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func, Test CNTL Valve	21-03-2022
Q-2-TV-23-1302A	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func, Test CNTL Valve	21-03-2022
Q-2-TV-23-1302B	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func, Test CNTL Valve	21-03-2022
Q-2-TV-23-1401	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func, Test CNTL Valve	21-03-2022
Q-2-PSV-22-1001C	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	21-03-2022
Q-2-PSV-22-1401C	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	21-03-2022
Q-2-PSV-22-1901A	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	21-03-2022
Q-2-PM-2103A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2103B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2104A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2105	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2106A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2106B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2108A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2108B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2109A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2109B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2110A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2110B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2111A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2111B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-2-PM-2112A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	30-03-2022
Q-3-P-1971	Q3-ISB-TK-1971-P-1971	PHENOL DRAIN PUMP	1M-PM Vertical Pump, 2Hr	28-03-2022
Q-3-P-1974	Q3-ISB-TK-1974-P-1974	ACETONE DRAIN PUMP (ISBL)	1M-PM Vertical Pump, 2Hr	28-03-2022
Q-3-P-1978	Q3-ISB-TK-1978-P-1978	ACETONE DRAIN PUMP (TANKAGE AREA)	1M-PM Vertical Pump, 2Hr	28-03-2022
Q-3-P-1972	Q3-ISB-TK-1972-P-1972	ACETONE DRAIN PUMP	1M-PM Vertical Pump, 2Hr	28-03-2022
Q-3-W-1602	Q3-ISB-L-1605-TK-1604-W-1602	CONTAINER BACK FILL UNIT CHUTE	1Y-Replace Hydraulic Oil	25-03-2022
Q-2-FRD-20-0001A	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-2-FRD-20-0003A	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-2-FRD-20-0004A	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-2-FRD-20-0001B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-2-FRD-20-0002B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-2-FRD-20-0003B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-2-FRD-20-0004B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-2-FRD-20-0005B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	30-03-2022
Q-3-P-9220B	Q3-OSB-Z-9200-TK-9202B-P-9220B	SBR SLUDGE PUMP	6M Vibration Monitoring	21-03-2022
Q-3-P-9227	Q3-OSB-Z-9200-TK-9210-P-9227	CATALYST WASHING WATER TANK PUMP	6M Vibration Monitoring	21-03-2022
Q-3-P-9401A	Q3-OSB-TK-9401-P-9401A	DEMINERALIZED WATER PUMP A	6M Vibration Monitoring	21-03-2022
Q-3-P-9402A	Q3-OSB-TK-9402-P-9402A	CHILLED WATER TRANSFER PUMP A	6M Vibration Monitoring	21-03-2022
Q-3-P-1972	Q3-ISB-TK-1972-P-1972	ACETONE DRAIN PUMP	6M Vibration Monitoring	21-03-2022
Q-3-P-1978	Q3-ISB-TK-1978-P-1978	ACETONE DRAIN PUMP (TANKAGE AREA)	6M Vibration Monitoring	21-03-2022
Q-3-P-9229A	Q3-OSB-Z-9200-TK-9203-P-9229A	EFFLUENT PUMP	6M Vibration Monitoring	21-03-2022
Q-3-P-9219A	Q3-OSB-Z-9200-TK-9204-P-9219A	DIVERSION TANK PUMP	6M Vibration Monitoring	21-03-2022

31 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-P-9224A	Q3-OSB-Z-9200-TK-9207-P-9224A	NAOH DOSING PUMP	6M Vibration Monitoring	21-03-2022
Q-1-TI-95-0101	Q1-OSB-D1108-E1119-TI950101	TI950101-E-1119 Hot Side Inlet Temp. Gauge	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TI-71-0105	Q1-OSB00-D7101-X7101-TI710105	TI710105-Natural Gas Metering Skid	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TI-16-0411	Q1-QMX-R1601-P1602A-TI160411	TI160411-Reac Recy Cooler Temp	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TI-14-0402	Q1-OSB-TK1401B-TI140402	TI140402-Frac Feed Tank B	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-3-RV-1601A	Q3-ISB-L1604TK1601A-RV-1601A	BPA PRODUCT SILO EXIT ROTARY VALVE A	2M-Grease up, 1 Hr	28-03-2022
Q-3-RV-1601C	Q3-ISB-L1603TK1601CRV-1601C	BPA PRODUCT SILO EXIT ROTARY VALVE C	2M-Grease up, 1 Hr	28-03-2022
Q-3-RV-1601B	Q3-ISB-L1604TK1601B-RV-1601B	BPA PRODUCT SILO EXIT ROTARY VALVE B	2M-Grease up, 1 Hr	28-03-2022
Q-1-P-1401B	Q1-FRC-TK1401A-P1401B	P-1401B-CrudeAcetoneColumnChargePump	4M- Replace lube oil, 2Hr	25-03-2022
Q-1-P-1401B	Q1-FRC-TK1401A-P1401B	P-1401B-CrudeAcetoneColumnChargePump	4M- Replace lube oil, 2Hr	25-03-2022
Q-3-C-1201	Q3-ISBD1201-TK1201-E1206-C1201	DEHYDRATOR VACUUM UNIT	3M(Online)- Replace Lube Oil, 1.5Hr	23-03-2022
Q-1-P-1401B	Q1-FRC-TK1401A-P1401B	P-1401B-CrudeAcetoneColumnChargePump	4M- Replace lube oil, 2Hr	25-03-2022
Q-3-S-1301	Q3-ISB-S-1301	1ST SEPARATOR	1M-PM Separator, 4Hr	01-03-2022
Q-3-S-1302	Q3-ISB-S-1302	2ND SEPARATOR	1M-PM Separator, 4Hr	01-03-2022
Q-1-P-1201B	Q1-OCD-TK1201-P1201B	P-1201B-Fresh Feed Pumps	8M-Replace lube oil, 2Hr	25-03-2022
Q-3-L-1602	Q3-ISB-L-1602	BPA PRODUCT CONVEYOR 1	RCM 3M-PM Bucket conveyor, 5Hr	28-03-2022
Q-3-L-1605	Q3-ISB-L-1605	BPA SHIPPING CONVEYOR	RCM 1M PM Bucket conveyor, 2.5Hr	28-03-2022
Q-3-L-1603	Q3-ISB-L-1603	BPA PRODUCT CONVEYOR 2	RCM 1M PM Bucket conveyor, 2.5Hr	28-03-2022
Q-3-L-1601	Q3-ISB-L-1601	1ST PRODUCT CONVEYOR	RCM 3M-PM Bucket conveyor, 5Hr	28-03-2022
Q-3-L-1604	Q3-ISB-L-1604	BPA PRODUCT CONVEYOR 3	RCM 1M PM Bucket conveyor, 2.5Hr	28-03-2022
Q-3-C-1501	Q3-ISB-D-1501-Z-1551-C-1501	PRILL TOWER COOLING N2 BLOWER	3M-Replace lube oil, 2Hr	28-03-2022
Q-1-VLP-00-002	Q1-OSB-6904	Firewater & Raw Water Sys. & Gas Detect.	(2M) PM VESDA Visual Inspection	30-03-2022
Q-3-TR-5001	Q3-OSB-TR-5001	22KV/6.9KV 12.5MVA MAIN PWR TRANSFORMER	RCM-3M INSPECTION	22-03-2022
Q-3-TR-5002	Q3-OSB-TR-5002	22KV/6.9KV 12.5MVA MAIN PWR TRANSFORMER	RCM-3M INSPECTION	22-03-2022
Q-3-TR-5003A	Q3-OSB-TR-5003A	6.9KV/400V DIST TRANSFORMER/MCC-5001B	RCM-3M INSPECTION	22-03-2022
Q-3-TR-5003B	Q3-OSB-TR-5003B	6.9KV/400V DIST TRANSFORMER/MCC-5001A	RCM-3M INSPECTION	22-03-2022
Q-3-TR-5003C	Q3-OSB-TR-5003C	6.9KV/400V DIST TRANSFORMER/MCC-5002A	RCM-3M INSPECTION	22-03-2022
Q-3-TR-5003D	Q3-OSB-TR-5003D	6.9KV/400V DIST TRANSFORMER/MCC-5002B	RCM-3M INSPECTION	22-03-2022
Q-2-AT-61-5101	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	30-03-2022
Q-2-AT-61-5301	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	30-03-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFLUENT DISTRIBUTION SYSTEM	(1M) clean and Calb COD AYZ	30-03-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFLUENT DISTRIBUTION SYSTEM	(3M) Replace wiper blade COD AYZ	30-03-2022
Q-1-XD-5001A	Q1-OSB-X5001-X5001A-XD5001A	XD-5001A-Emergency Diesel Engine Gen	1M-Greasing Universal Joint, 0.5Hr	28-03-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	1Y-PM Bagging machine, 3Hr	25-03-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	1Y-PM Bagging machine, 3Hr	25-03-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	1Y-PM Bagging machine, 3Hr	25-03-2022
Q-1-AT-91-1304	Q1-OSB-TK9141-AT911304	AT911304-TK9141 Conductivity Measurement	(2M) clean and Calb AYZ Con (FF)	30-03-2022
Q-2-AT-63-5101	Q2-OSB-6350	Tempered Water System	(1M) Inspect, clean and Calb AYZ Hydr	30-03-2022
Q-2-AT-66-5301	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	30-03-2022
Q-2-AT-66-5401	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	30-03-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>&<> FUEL T	30-03-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>&<> FUEL T	30-03-2022
Q-3-GD-93XX	Q3-OSB-FGS-EWS-FGS-01-SUM-AREA	GAS DETECT FOR Building Area	6M PM Hydro & Toxic Gas DET(Mar&Sep)	30-03-2022
Q-3-GD-19XX	Q3-ISB-FGS-EWS-FGS-01-SUM-AREA	GAS DETECT FOR Area 1100	6M PM Hydro & Toxic Gas DET(Mar&Sep)	30-03-2022

32 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-C-6201	Q1-OSB-X6201-C6201	C-6201-COMPRESSOR	1M-Check N2 <?&<?> Rotate Shaft spare C	01-04-2022
Q-2-P-9251	Q2-OSB-9200	Flare and Blown Down System	(6M) Re-Lubricant 2H	25-03-2022
Q-2-CM-5151A	Q2-OSB-5150	Instrument Air and Plant Air Systems	(3M) Replace filter	31-03-2022
Q-2-CM-5151B	Q2-OSB-5150	Instrument Air and Plant Air Systems	(3M) Replace filter	31-03-2022
Q-2-CM-5151C	Q2-OSB-5150	Instrument Air and Plant Air Systems	(3M) Replace filter	31-03-2022
Q-1-P-6901B	Q1-OSB-X6901-P6901B	P-6901B-Fire Water Pumps	1Y- REPLACE LUBE OIL, 2Hr	28-03-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	30-03-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	30-03-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	30-03-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	30-03-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	30-03-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	30-03-2022
Q-2-FT-23-0401D	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0403	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0501	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0502	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0701	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0702	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0703	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0801	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0802	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-FT-23-0803	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	31-03-2022
Q-2-PM-2112B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	31-03-2022
Q-2-PM-2113A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	31-03-2022
Q-2-PM-2113B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	31-03-2022
Q-2-PM-2116A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	31-03-2022
Q-2-PM-2116B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	31-03-2022
Q-2-PM-2117A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	31-03-2022
Q-2-PM-2117B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1Y) Inspection Megger clean re-tighten	31-03-2022
Q-2-PSV-22-1001C	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	28-03-2022
Q-2-PSV-22-1901B	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	28-03-2022
Q-3-Z-9219	Q3-OSB-Z-9200-Z-9219	SLUDE DEWATERING	2M-PM Belt press,4Hr	28-03-2022
Q-3-P-1904	Q3-ISB-TK-1904-P-1904	DRAIN RECEIVER PUMP	1M-PM Vertical Pump,2Hr	28-03-2022
Q-3-P-1809	Q3-ISB-TK-1805-P-1809	TAR DRAIN RECEIVER PUMP	1M-PM Vertical Pump,2Hr	28-03-2022
Q-3-P-1875	Q3-ISB-TK-1875-P-1875	TAR DRAIN RECEIVER PUMP (TANKAGE AREA)	1M-PM Vertical Pump,2Hr	28-03-2022
Q-1-PM-1412A	Q1-FRC-D1407-P1412A-PM1412A	PM-1412A-Crude Phenol Colm Sidecut Pump	4M Motor Greasing	31-03-2022
Q-1-P-6902B	Q1-OSB-X6901-P6902B	P-6902B-Jockey Pumps	1Y- Replace lube oil 2Hr	28-03-2022
Q-3-RV-1502	Q3-ISB-D-1501-Z-1551-RV-1502	RV-1502 ROTARY VALVE	2M-Grease up,1 Hr	28-03-2022
Q-3-RV-1503	Q3-ISB-D-1501-Z-1501-RV-1503	RV-1503 FEED ROTARY VALVE	2M-Grease up,1 Hr	28-03-2022
Q-2-AT-21-0601A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	31-03-2022
Q-2-AT-21-0601B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	31-03-2022
Q-2-AT-21-0601C	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	31-03-2022
Q-2-AT-21-0601D	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	31-03-2022
Q-2-AT-24-1101	Q2-FRC-2400	Fractionation unit	(3M) Inspect and ChngFilter AYZ Mois	31-03-2022

33 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-PM-1303	Q3-ISB-Q1302-E1304-P1303PM1303	6.6KV AC MOTOR FOR P-1303	4M Motor Greasing	28-03-2022
Q-3-PM-1306	Q3-ISB-S1301-N1304-P1306PM1306	400V AC MOTOR FOR P-1306	4M Motor Greasing	28-03-2022
Q-1-TI-14-0302	Q1-OSB-TK1401A-TI140302	TI140302-Frac Feed Tank A	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TT-91-1302	Q1-OSB-TK9141-TT911302	TT911302-TK-9141 Temp Measuremel	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TT-66-0104	Q1-OSB-TT660104	TT660104-S18 downstream of X-6602	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-1-TT-66-0102	Q1-OSB-TT660102	TT660102-S40 downstream of X-6601	4Y Calibration (1 Man / 3 Hr.)	28-03-2022
Q-3-PM-1913	Q3-ISBTK1910TK1913P1913-PM1913	400V AC MOTOR FOR P-1913	2M Motor Greasing	28-03-2022
Q-3-PM-1301B	Q3-ISBQ01E1303B-P1301B-PM1301B	6.6KV AC MOTOR FOR P-1301B	4M Motor Greasing	28-03-2022
Q-3-SM-1301	Q3-ISB-S-1301-SM-1301	400V AC MOTOR FOR S-1301	4M Motor Greasing	28-03-2022
Q-3-SM-1302	Q3-ISB-S-1302-SM-1302	400V AC MOTOR FOR S-1302	4M Motor Greasing	28-03-2022
Q-1-FT-41-0110	Q1-OSB-TK4101A	TK-4101A-Propylene Feed Tanks	(4M) Inspect, prove and Calb Metering	31-03-2022
Q-1-AT-11-0601B	Q1-QMX-V1103-E1104-AT110601B	AT110601B-Feed to TransAlkyl Reac	(1M) Inspect and Clean Strainer	31-03-2022
Q-1-AT-11-0601A	Q1-QMX-R1101-AT110601A	AT110601A-Fd. to Alk. Reac Moist Content	(1M) Inspect and Clean Strainer	31-03-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filter	(6M) Inspect, replac,lub,MN kit AYZ Hydr	31-03-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filter	1M Inspect and Calb AYZ Hydr 4H	31-03-2022
Q-1-PM-1602A	Q1-QMX-R1601-P1602A-PM1602A	PM-1602A-Hydrogenation Recycle Pump	4M Motor Greasing	30-03-2022
Q-1-PM-1104B	Q1-QMX-V1101-P1104	P-1104A-Benzene Recycle Pump	4M Motor Greasing	30-03-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	01-04-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	01-04-2022
	Q1	Phenol I	1M-Equipment Site Patrol	20-04-2022
	Q2	Phenol II	1M-Equipment Site Patrol	20-04-2022
Q-1-PM-9154D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9157C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9157D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9158A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9158B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9165C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9145A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9145B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9145C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9164C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	27-04-2022
Q-1-PM-9119A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	4M Motor Greasing	27-04-2022
Q-1-PM-9119B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	28-04-2022
Q-1-PM-9116B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	28-04-2022
Q-1-X-9141	Q1-OSB-TK9141-X9141	X-9141-FINAL POLISHING AGITATOR	6M Vibration Monitoring	29-04-2022
Q-1-X-9153	Q1-OSB-TK9153-X9153	X-9153-SLUDGE FEEDING AGITATOR	6M Vibration Monitoring	29-04-2022
Q-1-X-9154	Q1-OSB-TK9154-X9154	X-9154-POLYMER MIXER	6M Vibration Monitoring	29-04-2022
Q-1-X-9155	Q1-OSB-TK9154-X9155	X-9155-POLYMER PREPARATION UNIT	6M Vibration Monitoring	29-04-2022
Q-1-P-9121	Q1-OSB-TK9121A-P9121	P-9121-ANAEROBIC SLUDGE PUMP (ROTARY)	6M Vibration Monitoring	29-04-2022
Q-1-X-9118	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	29-04-2022
Q-1-X-9151B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	29-04-2022
Q-1-X-9165	Q1-OSB-D9165-X9165	X-9165-FeCl3 MIXER	6M Vibration Monitoring	29-04-2022
Q-1-PM-1103B	Q1-QMX-R1101-P1103B-PM1103B	PM-1103B-Alkylation Reac Recycle Pump	Motor Greasing	27-04-2022
Q-1-PM-1201B	Q1-OCD-TK1201-P1201B-PM1201B	PM-1201B-Fresh Feed Pump	Motor Greasing	27-04-2022

34 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-1207B	Q1-OCD-OX1202-P1207B-PM1207B	PM-1207B-Oxidizer no.2 Pump	Motor Greasing	27-04-2022
Q-1-PM-1301B	Q1-OCD-V1302-P1301B-PM1301B	PM-1301B-Flash Colm Bottoms Pump	Motor Greasing	27-04-2022
Q-1-PM-1302B	Q1-OCD-D1304-P1302B-PM1302B	PM-1302B-Decomposer Cir Pump	Motor Greasing	27-04-2022
Q-1-PM-1401B	Q1-FRC-TK1401A-P1401B-PM1401B	PM-1401B-Crude Acelone Colm Charge P	Motor Greasing	27-04-2022
Q-1-T-6102-3	Q1-OSB-T6102-T61023	T-6102-3-Reliable Cooling Tower No.3	1M-Replace oil gear box&inspection	29-04-2022
Q-1-TM-6101-1	Q1-OSB-T6101-T61011-TM61011	TM-6101-1-Motor for Cooling Fan No.1	Motor Greasing	27-04-2022
Q-1-TM-6101-4	Q1-OSB-T6101-T61014-TM61014	TM-6101-4-Motor for Cooling Fan No.4	Motor Greasing	27-04-2022
Q-1-TM-6101-3	Q1-OSB-T6101-T61013-TM61013	TM-6101-3-Motor for Cooling Fan No.3	Motor Greasing	27-04-2022
Q-1-PM-1103A	Q1-QMX-R1101-P1103A-PM1103A	PM-1103A-Alkylation Reac Recycle Pump	Motor Greasing	27-04-2022
Q-1-PM-1201A	Q1-OCD-TK1201-P1201A-PM1201A	PM-1201A-Fresh Feed Pump	Motor Greasing	27-04-2022
Q-1-PM-1207A	Q1-OCD-OX1202-P1207A-PM1207A	PM-1207A-Oxidizer no.1 Pump	Motor Greasing	27-04-2022
Q-1-PM-1301A	Q1-OCD-V1302-P1301A-PM1301A	PM-1301A-Flash Colm Bottoms Pump	Motor Greasing	27-04-2022
Q-1-PM-1302A	Q1-OCD-D1304-P1302A-PM1302A	PM-1302A-Decomposer Cir Pump	Motor Greasing	27-04-2022
Q-1-PM-1401A	Q1-FRC-TK1401A-P1401A-PM1401A	PM-1401A-Crude Acelone Colm Charge Pump	Motor Greasing	27-04-2022
Q-1-TM-6101-2	Q1-OSB-T6101-T61012-TM61012	TM-6101-2-Motor for Cooling Fan No.2	Motor Greasing	27-04-2022
Q-1-PM-1102B	Q1-QMX-D1102-P1102B-PM1102B	PM-1102B-Propylene Charge Pump	Motor Greasing	27-04-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	27-04-2022
Q-1-AP-5001	Q1-OSB-5004MCCAP5001B2-AP51	AP-5001-UPS Chlor Control @ CCR	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
Q-1-AP-5002	Q1-OSB-5004MCCAP5002B-AP52	AP-5002-UPS for Swgr Control @ Main S/S	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
Q-1-AP-5003	Q1-OSB-5004MCCAP5003B-AP53	AP-5003-DC Charger for Emer.Light @ S/S	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
	Q1	Phenol I	1M-Equipment Site Patrol	20-04-2022
Q-2-X-2051	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(1M) PM Oil Mist	03-05-2022
Q-2-X-2052	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1M) PM Oil Mist	03-05-2022
Q-2-X-2053	Q2-OSB-6150	Phenol Recovery Section	(1M) PM Oil Mist	03-05-2022
Q-2-PSV-22-1001D	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	01-04-2022
Q-2-PSV-22-1202B	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	04-04-2022
Q-2-PSV-22-1401D	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2Y) Calibration test	01-04-2022
Q-2-AT-22-2631	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2M) clean and Calb AYZ VOC	27-04-2022
Q-2-AT-23-1701	Q2-OCD-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	27-04-2022
Q-2-AT-23-1901	Q2-OCD-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	27-04-2022
Q-2-PM-2104B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2106B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2108B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2111B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2113B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2303B	Q2-OCD-2300	Phenol II Oxidation CDN Section	Motor Greasing	27-04-2022
Q-2-PM-2408B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2411B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2412B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2423B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2508B	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	27-04-2022
Q-2-PM-4152B	Q2-OSB-4100	Tank Gauging System	Motor Greasing	27-04-2022
Q-2-PM-6652B	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	27-04-2022
Q-2-PM-6656B	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	27-04-2022

33 of 63

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PM-2109B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2110B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2112B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	27-04-2022
Q-2-PM-2203B	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	27-04-2022
Q-2-PM-2208B	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	27-04-2022
Q-2-PM-2301B	Q2-OCD-2300	Phenol II Oxidation CDN Section	Motor Greasing	27-04-2022
Q-2-PM-2307B	Q2-OCD-2300	Phenol II Oxidation CDN Section	Motor Greasing	27-04-2022
Q-2-PM-2401B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2402B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2404B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2405B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2406B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2410B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2415B	Q2-FRC-2400	Fractionation unit	Motor Greasing	27-04-2022
Q-2-PM-2507B	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	27-04-2022
Q-2-PM-2601B	Q2-FRC-2600	HUEL MSHF Pcess Unit	Motor Greasing	27-04-2022
Q-2-PM-4151B	Q2-OSB-4100	Tank Gauging System	Motor Greasing	27-04-2022
Q-2-PM-4163B	Q2-OSB-4100	Tank Gauging System	Motor Greasing	27-04-2022
Q-2-TM-6152B	Q2-OSB-6150	Phenol Recovery Section	Motor Greasing	27-04-2022
Q-2-TM-6152C	Q2-OSB-6150	Phenol Recovery Section	Motor Greasing	27-04-2022
Q-2-TM-6152D	Q2-OSB-6150	Phenol Recovery Section	Motor Greasing	27-04-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	27-04-2022
Q-2-PM-4162A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	27-04-2022
Q-2-P-2404B	Q2-FRC-2400	Fractionation unit	6M-Relubricant	28-04-2022
Q-2-AP-5055-01A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
Q-2-AP-5055-01B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
Q-2-AP-5055-02	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
Q-2-AP-5055-03	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
Q-2-AP-5055-04	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M UPS & DC CHARGER INSPECTION	27-04-2022
	Q2	Phenol II	1M-Equipment Site Patrol	20-04-2022
Q-3-C-1201	Q3-ISBD1201-TK1201-E1206-C1201	DEHYDRATOR VACUUM UNIT	3M(Online)- Replace Lube Oil .1.5Hr	26-04-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(1M) Archive HIST Data and Config. to CD	04-04-2022
Q-3-S-1301	Q3-ISB-S-1301	1ST SEPARATOR	1M-PM Separator.4Hr	26-04-2022
Q-3-S-1302	Q3-ISB-S-1302	2ND SEPARATOR	1M-PM Separator.4Hr	26-04-2022
Q-3-Z-1301	Q3-ISB-1300	PURIFICATION	1M-PM Oil Mist System	26-04-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	29-04-2022
Q-1-P-1113B	Q1-QMX-V1103-P1113B	P-1113B-DIPB Column Drag Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-1108B	Q1-QMX-V1101-P1108B	P-1108B-Benzene Column Bottoms Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-1109B	Q1-QMX-V1102-P1109B	P-1109B-Cumene Column Bottoms Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-1110B	Q1-QMX-V1103-P1110B	P-1110B-DIPB Column Bottoms Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-1407B	Q1-FRC-V1403-P1407B	P-1407B-ChemicalTreatmentInjectionPump	6M Vibration Monitoring	29-04-2022
Q-1-P-1409B	Q1-FRC-D1405-P1409B	P-1409B-CumeneAMSColumnOverheadWaterPump	6M Vibration Monitoring	29-04-2022
Q-1-P-1422B	Q1-FRC-J1401-P1422B	P-1422B-EjectorVentScrubberBottomPump	6M Vibration Monitoring	29-04-2022
Q-1-P-6605A	Q1-OSB-6612	Condensate Recovery & Storage System	3M-Relubricant	29-04-2022

34 of 63



Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-PT-1612	Q3-ISB-L-1602-TK-1602-PT-1612	TK-1602 PRESSURE INDICATOR	3Y Calibration (2 Man / 3 Hr.)	01-04-2022
Q-3-PT-1613	Q3-ISB-L-1603-TK-1601C-PT-1613	TK-1601C PRESSURE INDICATOR	3Y Calibration (2 Man / 3 Hr.)	01-04-2022
Q-3-PT-1614	Q3-ISB-L-1604-TK-1601B-PT-1614	TK-1601B PRESSURE INDICATOR	3Y Calibration (2 Man / 3 Hr.)	04-04-2022
Q-3-PT-1615	Q3-ISB-L-1604-TK-1601A-PT-1615	TK-1601A PRESSURE INDICATOR	3Y Calibration (2 Man / 3 Hr.)	04-04-2022
Q-3-PT-1616	Q3-ISB-L-1605-TK-1603-PT-1616	TK-1603 PRESSURE INDICATOR	3Y Calibration (2 Man / 3 Hr.)	05-04-2022
Q-3-PT-1617	Q3-ISB-L-1605-TK-1604-PT-1617	TK-1604 PRESSURE INDICATOR	3Y Calibration (2 Man / 3 Hr.)	05-04-2022
Q-3-PDI-1611	Q3-ISB-TK1602-Z1612-PDI1611	TK-1602 DUST COLLECTOR PRESS DIFF	3Y Calibration (2 Man / 3 Hr.)	07-04-2022
Q-3-PDI-1612	Q3-ISB-TK1601CZ1611CPDI1612	TK-1601C DUST COLLECTOR PRESS DIFF	3Y Calibration (2 Man / 3 Hr.)	07-04-2022
Q-3-PDI-1613	Q3-ISB-TK1601B-Z1611B-PDI1613	TK-1601B DUST COLLECTOR PRESS DIFF	3Y Calibration (2 Man / 3 Hr.)	08-04-2022
Q-3-PDI-1614	Q3-ISB-TK1601A-Z1611A-PDI1614	TK-1601A DUST COLLECTOR PRESS DIFF	3Y Calibration (2 Man / 3 Hr.)	08-04-2022
Q-3-PDI-1615	Q3-ISB-TK1603-Z1613-PDI1615	TK-1603 DUST COLLECTOR PRESS DIFF	3Y Calibration (2 Man / 3 Hr.)	11-04-2022
Q-3-PDI-1616	Q3-ISB-TK1604-Z1614-PDI1616	TK-1604 DUST COLLECTOR PRESS DIFF	3Y Calibration (2 Man / 3 Hr.)	11-04-2022
Q-3-TT-1611	Q3-ISB-L-1602-TK-1602-TT-1611	TK-1602 TEMP INDICATOR	3Y Calibration (2 Man / 3 Hr.)	12-04-2022
Q-3-TT-1612	Q3-ISB-L-1603-TK-1601C-TT-1612	TK-1601C TEMP INDICATOR	3Y Calibration (2 Man / 3 Hr.)	12-04-2022
Q-3-TT-1613	Q3-ISB-L-1604-TK-1601B-TT-1613	TK-1601B TEMP INDICATOR	3Y Calibration (2 Man / 3 Hr.)	12-04-2022
Q-3-TT-1614	Q3-ISB-L-1604-TK-1601A-TT-1614	TK-1601A TEMP INDICATOR	3Y Calibration (2 Man / 3 Hr.)	12-04-2022
Q-3-TT-1615	Q3-ISB-L-1605-TK-1603-TT-1615	TK-1603 TEMP INDICATOR	3Y Calibration (2 Man / 3 Hr.)	18-04-2022
Q-3-TT-1616	Q3-ISB-L-1605-TK-1604-TT-1616	TK-1604 TEMP INDICATOR	3Y Calibration (2 Man / 3 Hr.)	18-04-2022
Q-1-P-1112A	Q1-QMX-D1106-P1112A	P-1112A-S3 SteamGeneratorCirculationPump	8M-Replace lube oil.2Hr	29-04-2022
Q-1-P-1405A	Q1-FRC-D1403-P1405A	P-1405A-FinishAcetoneColumnOverheadPump	1Y-Replace lube oil.2Hr	29-04-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-P-1505A	Q1-FRC-V1501-P1505A	P-1505A-SpentCausticRecirculationPump	1Y-Replace lube oil.2Hr	29-04-2022
Q-1-P-1422A	Q1-FRC-J1401-P1422A	P-1422A-EjectorVentScrubberBottomPump	1Y-Replace lube oil.2Hr	29-04-2022
Q-2-P-2418A	Q2-FRC-2400	Fractionation unit	3M-Relubricant	28-04-2022
Q-2-P-2419A	Q2-FRC-2400	Fractionation unit	3M-Relubricant	28-04-2022
Q-2-P-4163B	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant	28-04-2022
Q-2-FT-23-0901	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1001	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1002	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1003	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1004	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1005	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-FT-23-1201	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1202	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1205	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-FT-23-1301	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	12-04-2022
Q-2-P-4151A	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant	28-04-2022
Q-2-P-4152A	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-4162A	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant	28-04-2022

37 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-1208B	Q1-OCD-D1205-P1208B-PM1208B	PM-1208B-Decanter Pump	4M Motor Greasing	27-04-2022
Q-1-P-1301A	Q1-OCD-V1302-P1301A	P-1301A-Flash Column Bottoms Pumps	4M- Replace lube oil.2Hr	29-04-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1M-Replace Lube Oil	29-04-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1M-Replace Lube Oil	29-04-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1M-Replace Lube Oil	29-04-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	29-04-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	29-04-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	29-04-2022
Q-1-TT-95-0105	Q1-OSB-D1414-E1423-TT950105	TT950105-E1423 Hot Sideoutlet Temp Alarm	4Y Calibration (1 Man / 3 Hr.)	07-04-2022
Q-1-TT-95-0102	Q1-OSB-D1108-E1119-TT950102	TT950102-E-1119 Hot Sideoutlet Temp. Ind	4Y Calibration (1 Man / 3 Hr.)	07-04-2022
Q-1-TT-91-0201	Q1-OSB-D9101-P9101A-TT910201	TT910201-D-9101 Outlet	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-TT-71-0106	Q1-OSB00-D7101-TT710106	TT710106-Natural Gas Meter Station Outl.	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-2-AT-61-5101	Q2-OSB-6150	Phenol Recovery Section	(6M) Inspect, replace tubing AYZ Hydr	27-04-2022
Q-2-AT-61-5301	Q2-OSB-6150	Phenol Recovery Section	(6M) Inspect, replace tubing AYZ Hydr	27-04-2022
Q-3-P-1918	Q3-ISB-TK-1910-TK-1918-P-1918	DW PUMP	6M Vibration Monitoring	04-04-2022
Q-3-P-9215A	Q3-OSB-Z-9200-TK-9201-P-9215A	SBR FEED PUMP	6M Vibration Monitoring	04-04-2022
Q-3-P-9216A	Q3-OSB-Z-9200-TK-9202A-P-9216A	SBR DECANter	6M Vibration Monitoring	04-04-2022
Q-3-AP-01	Q3-OSB-AP-01	400V AC UPS FOR INST SYS AND LOCAL PANEL	RCM-3M UPS & DC CHARGER INSPECTION	04-04-2022
Q-3-AP-02	Q3-OSB-AP-02	230V AC UPS FOR ESD AND FGS PANEL	RCM-3M UPS & DC CHARGER INSPECTION	04-04-2022
Q-3-AP-03	Q3-OSB-AP-03	125V DC POWER SUPPLY AND BATTERY CHARGER	RCM-3M UPS & DC CHARGER INSPECTION	04-04-2022
Q-2-AT-61-5101	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	27-04-2022
Q-2-AT-61-5301	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	27-04-2022
Q-1-PM-6102C	Q1-OSB-T6101-P6102C-PM6102C	PM-6102C-CW Cir Pump	4M Motor Greasing	27-04-2022
Q-2-AT-63-5101	Q2-OSB-6350	Tempered Water System	(6M) Inspect, replace tubing AYZ Hydr	27-04-2022
Q-2-AT-66-5301	Q2-OSB-6650	Steam System and Condensate system	(6M) Inspect, replace tubing AYZ Hydr	27-04-2022
Q-2-AT-66-5401	Q2-OSB-6650	Steam System and Condensate system	(6M) Inspect, replace tubing AYZ Hydr	27-04-2022
Q-2-AT-63-5101	Q2-OSB-6350	Tempered Water System	(1M) Inspect, clean and Calb AYZ Hydr	27-04-2022
Q-2-AT-66-5301	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	27-04-2022
Q-2-AT-66-5401	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	27-04-2022
Q-1-P-1104A	Q1-QMX-V1101-P1104	P-1104A-Benzene Recycle Pump	4M-PM Pump.3Hr	29-04-2022
Q-1-P-6204B	Q1-OSB-X6201-P6204B	P-6204B-OIL PUMP	1M-GREASING( High temp). 1Hr	29-04-2022
Q-1-P-6204A	Q1-OSB-X6201-P6204A	P-6204A-OIL PUMP	1M-GREASING( High temp). 1Hr	29-04-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(1M) Archive HIST Data and Config. to CO	18-04-2022
Q-2-AT-22-0501	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-22-0502	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(4M) Inspect, clean and Calb AY	27-04-2022
Q-2-AT-22-0801	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-22-1601	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(2M) Calb AYZ PH (FF)	27-04-2022
Q-2-AT-61-5603	Q2-OSB-6150	Phenol Recovery Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-61-5604	Q2-OSB-6150	Phenol Recovery Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-66-5302	Q2-OSB-6650	Steam System and Condensate system	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>&<)> FUEL T	03-05-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <(>&<)> FUEL T	03-05-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	28-04-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	28-04-2022

38 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-INST-CAL-0001	Q3-OSB-0100	BPA Maintenance	PM Standard Weight BPA Plant 2022	26-04-2022
Q-2-AT-25-0601	Q2-FRC-2500	Phenol Recovery Section	(2M) Calb AYZ PH (FF)	27-04-2022
Q-2-AT-25-0201	Q2-FRC-2500	Phenol Recovery Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-25-0202	Q2-FRC-2500	Phenol Recovery Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-25-0501	Q2-FRC-2500	Phenol Recovery Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-25-0701	Q2-FRC-2500	Phenol Recovery Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-2-AT-25-0702	Q2-FRC-2500	Phenol Recovery Section	(4M) Inspect, clean and Calb AYZ pH	27-04-2022
Q-3-C-1401B	Q3-ISB-D-1401-C-1401B	DEPHENOLATOR VACUUM UNIT B	RCM 3M- Replace Lube Oil ,1.5Hr	26-04-2022
Q-3-C-1401A	Q3-ISB-D-1401-C-1401A	DEPHENOLATOR VACUUM UNIT A	RCM 1Y- PM Vacuum pump,4Hr	26-04-2022
Q-1-P-1108A	Q1-QMX-V1101-P1108A	P-1108A-Benzene Column Bottoms Pumps	8M-Replace lube oil 2Hr	29-04-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-2-P-6155A	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-6155B	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-6155C	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-FT-23-1401	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FT-23-1702	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FT-23-1801	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FT-23-1802	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FT-23-1903	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FT-23-2001	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FXT-23-0401A	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FXT-23-0401B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FXT-23-0401C	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-2-FXT-23-1006	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Flow Trans	22-04-2022
Q-3-L-1602	Q3-ISB-L-1602	BPA PRODUCT CONVEYOR 1	RCM 1M PM Bucket conveyor,2.5Hr	26-04-2022
Q-1-P-1418A	Q1-FRC-D1412-P1418A	P-1418A-Fractionation Sump Pump	8M-Replace lube oil 2Hr	29-04-2022
Q-1-P-1209A	Q1-OSB-D1206-P1209A	P-1209A-CHP Sump Pump	8M-Replace lube oil 2Hr	29-04-2022
Q-1-P-1304A	Q1-OSB-D1307-P1304A	P-1304A-Acid Aromatics Sump Pumps	8M-Replace lube oil 2Hr	29-04-2022
Q-3-L-1604	Q3-ISB-L-1604	BPA PRODUCT CONVEYOR 3	RCM 1M PM Bucket conveyor,2.5Hr	26-04-2022
Q-3-FL-MLP01B-2A04	Q3-OSB-MLP-01-FL-MLP01B-2A-04	EXIT SIGN LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	11-04-2022
Q-3-FL-MLP01B-3A02	Q3-OSB-MLP-01-FL-MLP01B-3A-02	EXIT SIGN LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	11-04-2022
Q-3-FL-MLP01B-3A07	Q3-OSB-MLP-01-FL-MLP01B-3A-07	EXIT SIGN LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-MLP01B-2A04	Q3-OSB-MLP-01-HL-MLP01B-2A-04	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-MLP01B-2A06	Q3-OSB-MLP-01-HL-MLP01B-2A-06	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-MLP01B-3A02	Q3-OSB-MLP-01-HL-MLP01B-3A-02	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-MLP01B-3A07	Q3-OSB-MLP-01-HL-MLP01B-3A-07	EMERGENCY LIGHTING SWG/HVAC/EDG ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP03-3B-08	Q3-OSB-MLP01-LP03-HL-LP03-3B08	EMERGENCY LIGHTING DRIVERS FACI	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP04-4B-01	Q3-OSB-MLP02-LP04-HL-LP04-4B01	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP04-4B-03	Q3-OSB-MLP02-LP04-HL-LP04-4B03	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022

38 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-HL-LP04-4B-05	Q3-OSB-MLP02-LP04-HL-LP04-4B05	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP04-4B-07	Q3-OSB-MLP02-LP04-HL-LP04-4B07	EMERGENCY LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP05-4A-02	Q3-OSB-MLP02-LP05-HL-LP05-4A02	EMERGENCY LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP05-4A-05	Q3-OSB-MLP02-LP05-HL-LP05-4A05	EMERGENCY LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP05-4A-07	Q3-OSB-MLP02-LP05-HL-LP05-4A07	EMERGENCY LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP06-5B-06	Q3-OSB-MLP02-LP06-HL-LP06-5B06	EMERGENCY LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP06-6A-02	Q3-OSB-MLP02-LP06-HL-LP06-6A02	EMERGENCY LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP06-6A-07	Q3-OSB-MLP02-LP06-HL-LP06-6A07	EMERGENCY LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP15-1B-02	Q3-OSB-MLP02-LP15-HL-LP15-1B02	EMERGENCY LIGHTING WWT PLANT	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP15-2A-02	Q3-OSB-MLP02-LP15-HL-LP15-2A02	EMERGENCY LIGHTING WWT PLANT	3M PM Lighting system unit	11-04-2022
Q-1-P-4112B	Q1-OSB-TK4112A-P4112B	P-4112B-Phenol Rundown Pumps	8M-Replace lube oil 2Hr	29-04-2022
Q-1-PM-1405B	Q1-FRC-D1403-P1405B-PM1405B	PM-1405B-Finish Acelone Colm Overhead P	4M Motor Greasing	27-04-2022
Q-1-P-5001	Q1-OSB-TK5001-P5001	P-5001-Diesel Make Up Pump	8M-Replace lube oil 2Hr	29-04-2022
Q-1-P-4113B	Q1-OSB-TK4113A-P4113B	P-4113B-Acelone Rundown Pumps	8M-Replace lube oil 2Hr	29-04-2022
Q-1-TT-71-0101	Q1-OSB00-D7101-TT710101	TT710101-D-7101 Temp. Ind	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-TT-66-0405	Q1-OSB00-D6605-E6602-TT660405	TT660405-Outlet of X-6608	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-TT-66-0304	Q1-OSB-X6605-TT660304	TT660304-Vapor outlet of D-6603	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-TT-66-0303	Q1-OSB-X6605-TT660303	TT660303-Vapor outlet of X-6605	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-P-9131A	Q1-OSB-TK9131-P9131A	P-9131A-SBR FEED PUMP	8M-Replace lube oil 2Hr	29-04-2022
Q-1-P-9157A	Q1-OSB-TK9157-P9157A	P-9157A-WASHING PUMP (Centrifugal)	8M-Replace lube oil 2Hr	29-04-2022
Q-2-AXT-22-1001	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-04-2022
Q-2-AXT-22-1002	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-04-2022
Q-2-AXT-22-1401	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-04-2022
Q-2-AXT-22-1402	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	27-04-2022
Q-3-HL-LP01A-5A-01	Q3-OSBMLP01LP01A-HL-LP01A-5A01	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01A-5A-10	Q3-OSBMLP01LP01A-HL-LP01A-5A10	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01A-5B-10	Q3-OSBMLP01LP01A-HL-LP01A-5B10	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01A-6A-02	Q3-OSBMLP01LP01A-HL-LP01A-6A02	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01A-6A-06	Q3-OSBMLP01LP01A-HL-LP01A-6A06	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01A-6A-09	Q3-OSBMLP01LP01A-HL-LP01A-6A09	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01B-3B-01	Q3-OSBMLP01LP01B-HL-LP01B-3B01	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01B-3B-07	Q3-OSBMLP01LP01B-HL-LP01B-3B07	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01B-4A-10	Q3-OSBMLP01LP01B-HL-LP01B-4A10	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01B-4B-02	Q3-OSBMLP01LP01B-HL-LP01B-4B02	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01B-4B-05	Q3-OSBMLP01LP01B-HL-LP01B-4B05	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP01B-4B-09	Q3-OSBMLP01LP01B-HL-LP01B-4B09	EMERGENCY LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-HL-LP03-3B-05	Q3-OSB-MLP01-LP03-HL-LP03-3B05	EMERGENCY LIGHTING DRIVERS FACI	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP01A-5A-01	Q3-OSBMLP01LP01A-FL-LP01A-5A01	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP01A-5B-10	Q3-OSBMLP01LP01A-FL-LP01A-5B10	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP01A-6A-02	Q3-OSBMLP01LP01A-FL-LP01A-6A02	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP01B-3B-01	Q3-OSBMLP01LP01B-FL-LP01B-3B01	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP01B-4B-09	Q3-OSBMLP01LP01B-FL-LP01B-4B09	EXIT SIGN LIGHTING CONTROL ROOM	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP03-3B-05	Q3-OSB-MLP01-LP03-FL-LP03-3B05	EXIT SIGN LIGHTING DRIVERS FACI	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP03-3B-08	Q3-OSB-MLP01-LP03-FL-LP03-3B08	EXIT SIGN LIGHTING DRIVERS FACI	3M PM Lighting system unit	11-04-2022

39 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-FL-LP04-4B-02	Q3-OSB-MLP02-LP04-FL-LP04-4B02	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP04-4B-04	Q3-OSB-MLP02-LP04-FL-LP04-4B04	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP04-4B-06	Q3-OSB-MLP02-LP04-FL-LP04-4B06	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP04-4B-07	Q3-OSB-MLP02-LP04-FL-LP04-4B07	EXIT SIGN LIGHTING BPA WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP05-4A-02	Q3-OSB-MLP02-LP05-FL-LP05-4A02	EXIT SIGN LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP05-4A-05	Q3-OSB-MLP02-LP05-FL-LP05-4A05	EXIT SIGN LIGHTING MAINTENANCE WORKSHOP	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP06-6A-02	Q3-OSB-MLP02-LP06-FL-LP06-6A02	EXIT SIGN LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP06-6A-07	Q3-OSB-MLP02-LP06-FL-LP06-6A07	EXIT SIGN LIGHTING CHEMICAL WAREHOUSE	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP15-1B-02	Q3-OSB-MLP02-LP15-FL-LP15-1B02	EXIT SIGN LIGHTING WWT PLANT	3M PM Lighting system unit	11-04-2022
Q-3-FL-LP15-2A-02	Q3-OSB-MLP02-LP15-FL-LP15-2A02	EXIT SIGN LIGHTING WWT PLANT	3M PM Lighting system unit	11-04-2022
Q-1-AT-12-1001	Q1-OC-D-0X1201-AT121001	AT121001-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	27-04-2022
Q-1-AT-12-1002	Q1-OC-D-0X1201-AT121002	AT121002-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	27-04-2022
Q-1-AT-12-1401	Q1-OC-D-0X1202-AT121401	AT121401-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	27-04-2022
Q-1-AT-12-1402	Q1-OC-D-0X1202-AT121402	AT121402-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	27-04-2022
Q-1-PM-1408B	Q1-FRC-D1405-P1408B-PM1408B	PM-1408B-Cum-AMS Colm Overhead Pump	4M Motor Greasing	27-04-2022
Q-1-PM-6103C	Q1-OSB-T6101-P6103C-PM6103C	PM-6103C-HP C/W Cir Pump	2M Motor Greasing	27-04-2022
Q-1-XD-5001B	Q1-OSB-X5001-X5001B-XD5001B	XD-5001B-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	29-04-2022
Q-1-P-1303A	Q1-OC-D-D1304-P1303A	P-1303A-Decomposer Product Pumps	8M-Replace lube oil.2Hr	29-04-2022
Q-3-L-1603	Q3-ISB-L-1603	BPA PRODUCT CONVEYOR 2	RCM 1M PM Buckel conveyor.2.5Hr	26-04-2022
Q-3-L-1601	Q3-ISB-L-1601	1ST PRODUCT CONVEYOR	RCM 1M PM Buckel conveyor.2.5Hr	26-04-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	03-05-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	03-05-2022
Q-3-C-9201C	Q3-OSB-Z-9200-C-9201C	SBR TANK BLOWER	3M Replace lube oil.2Hr	26-04-2022
Q-3-C-9201B	Q3-OSB-Z-9200-C-9201B	SBR TANK BLOWER	3M Replace lube oil.2Hr	26-04-2022
Q-3-C-9201A	Q3-OSB-Z-9200-C-9201A	SBR TANK BLOWER	3M Replace lube oil.2Hr	26-04-2022
Q-2-P-2601A	Q2-FRC-2600	HUEL MSHP Pcess Unit	(6M) Re-Lubricant 2H	28-04-2022
Q-2-PSV-23-1801A	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Calibration test	18-04-2022
Q-2-P-2116A	Q2-OC-D-2100	Phenol II Oxidation Q-Max Area	(6M) Re-Lubricant	28-04-2022
Q-2-P-2116B	Q2-OC-D-2100	Phenol II Oxidation Q-Max Area	(6M) Re-Lubricant	28-04-2022
Q-2-P-2117A	Q2-OC-D-2100	Phenol II Oxidation Q-Max Area	(6M) Re-Lubricant	28-04-2022
Q-3-L-1605	Q3-ISB-L-1605	BPA SHIPPING CONVEYOR	RCM 1M PM Buckel conveyor.2.5Hr	26-04-2022
Q-3-C-9401	Q3-OSB-TK-9402-C-9401	REFRIGERATION COMPRESSOR	RCM 1M Oil analysis.1Hr	26-04-2022
Q-1-PM-1410A	Q1-FRC-V1404-P1410A-PM1410A	PM-1410A-Residue Stripper Bottoms Pump	4M Motor Greasing	27-04-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132D	Q1-OSB-X9134-C9132D	C-9132D-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-P-6201A	Q1-OSB00-TK6201-P6201A	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-P-9104A	Q1-OSB-X9103-P9104A	P-6201A-Chilled Water Transfer Pumps	1Y-Replace lube oil.2Hr	29-04-2022
Q-1-P-9103A	Q1-OSB-X9103-P9103A	P-9104A-CONTAMINATED WATER PUMP	1M Clean water flushing strainer	29-04-2022
Q-2-PSV-23-1502	Q2-OC-D-2300	P-9103A-First 20 MinuteFlushWaterPillPump	1M Clean water flushing strainer	29-04-2022
Q-2-FXT-23-1204A	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Calibration test-PM-Overhaul	18-04-2022
		Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022

44 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-FXT-23-1204B	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-FXT-23-1204C	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-FXT-23-1501	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-FXT-23-1601	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-FXT-23-1602	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-FXT-23-1803	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-FXT-23-1804	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Flow Trans	22-04-2022
Q-2-P-6156A	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-6156B	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-6156C	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-1-AT-91-6501	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-04-2022
Q-1-AT-91-6502	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-04-2022
Q-1-AT-91-6503	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-04-2022
Q-1-AT-91-6504	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-04-2022
Q-1-AT-91-6505	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-04-2022
Q-1-P-1302A	Q1-OC-D-D1304-P1302A	P-1302A-Decomposer Circulation Pumps	8M-Replace lube oil.2Hr	29-04-2022
Q-1-PM-1102B	Q1-QMX-D1102-P1102B-PM1102B	PM-1102B-Propylene Charge Pump	2M Motor Greasing	27-04-2022
Q-1-TT-66-0204	Q1-OSB-X6605-TT660204	TT660204-Vapor outlet of D-6602	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-TT-66-0203	Q1-OSB-X6604-TT660203	TT660203-Outlet of X-6604	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-TT-63-0102	Q1-OSB-TK6301-TT630102	TT630102-Main tempered water return line	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-1-TT-63-0101	Q1-OSB-TK6301-TT630101	TT630101-TK-6301	4Y Calibration (1 Man / 3 Hr.)	22-04-2022
Q-2-PM-2401A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	29-04-2022
Q-2-PM-2401B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	29-04-2022
Q-2-PM-2402A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	29-04-2022
Q-2-PM-2402B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	29-04-2022
Q-2-PM-2403A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	29-04-2022
Q-2-PM-2403B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	29-04-2022
Q-2-WR-2401	Q2-FRC-2400	Fractionation unit	(1Y) Inspection cleaning re-tighten	29-04-2022
Q-1-CM-9132B	Q1-OSB-X9134-C9132B-CM9132B	CM-9132B-SBR Blower	2M Motor Greasing	27-04-2022
Q-1-CM-9132C	Q1-OSB-X9134-C9132C-CM9132C	CM-9132C-SBR Blower	2M Motor Greasing	27-04-2022
Q-1-CM-9132E	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	2M Motor Greasing	27-04-2022
Q-1-CM-9132F	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	2M Motor Greasing	27-04-2022
Q-2-AT-21-1901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2M) Clean Filter & Cal AYZ O2	28-04-2022
Q-2-AT-24-1103	Q2-FRC-2400	Fractionation unit	(2M) Clean Filter & Cal AYZ O2	28-04-2022
Q-2-AT-24-2801	Q2-FRC-2400	Fractionation unit	(2M) Clean Filter & Cal AYZ O2	28-04-2022
Q-2-AT-23-1001	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2M)Clean Filter & Cal AYZ O2	28-04-2022
Q-1-P-1208A	Q1-OC-D-D1205-P1208A	P-1208A-Decanter Pumps	8M-Replace lube oil.2Hr	29-04-2022
Q-1-PM-6103A	Q1-OSB-T6101-P6103A-PM6103A	PM-6103A-HP C/W Cir Pump	2M Motor Greasing	27-04-2022
Q-2-P-2108A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	2M-Replace Lube Oil	28-04-2022
Q-3-P-1971	Q3-ISB-TK-1971-P-1971	PHENOL DRAIN PUMP	1M-PM Vertical Pump.2Hr	26-04-2022
Q-3-P-1974	Q3-ISB-TK-1974-P-1974	ACETONE DRAIN PUMP (ISBL)	1M-PM Vertical Pump.2Hr	26-04-2022
Q-3-P-1978	Q3-ISB-TK-1978-P-1978	ACETONE DRAIN PUMP (TANKAGE AREA)	1M-PM Vertical Pump.2Hr	26-04-2022
Q-3-P-1972	Q3-ISB-TK-1972-P-1972	ACETONE DRAIN PUMP	1M-PM Vertical Pump.2Hr	26-04-2022
Q-1-AT-11-0601B	Q1-QMX-V1103-E1104-AT110601B	AT110601B-Feed to TransAlkyl Reac	(1M) Inspect and Clean Strainer	28-04-2022



Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-AT-14-1101	Q1-FRC-V1402-E1405-AT141101	AT141101-Acetone Product Moist Content	(3M) Inspect and Chng. Filter	28-04-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filter	1M Inspect and Calb AYZ Hydr 4H	28-04-2022
Q-1-AT-11-0601A	Q1-QMX-R1101-AT110601A	AT110601A-Fd. to Alk. Reac Moist Content	(1M) Inspect and Clean Strainer	28-04-2022
Q-1-P-1116A	Q1-QMX-D1109-P1116A	P-1116A-DIPB COLUMN VACUUM PUMPS	2M-Greasing, 1Hr	29-04-2022
Q-1-XD-5001A	Q1-OSB-X5001-X5001A-XD5001A	XD-5001A-Emergency Diesel Engine Gen	1M-Greasing Universal Joint, 0.5Hr	29-04-2022
Q-1-P-1412A	Q1-FRC-D1407-P1412A	P-1412A-CrudePhenolColumnSidecutPump	8M-Replace lube oil, 2Hr	29-04-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFILUENT DISTRIBUTION SYSTEM	(1M) clean and Calb COD AYZ	28-04-2022
Q-1-AT-15-0602	Q1-FRC-D1504-AT150602	AT150602-PRU Separator Water Phase	(4M) clean and Calb AYZ PH	28-04-2022
Q-1-AT-15-0202	Q1-FRC-V1501-AT150202	AT150202-CumAMS Causlic Wash Colm Tray 5	(4M) clean and Calb AYZ PH	28-04-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(3M) Inspect, Cleaning and Cal GC Analyz	28-04-2022
Q-1-X-9152	Q1-OSB-TK9152-X9152	X-9152-THICKENER SCRAPER	1Y-CHANGE LUBE OIL GEAR BOX, 3Hr	29-04-2022
Q-1-PM-1404A	Q1-FRC-V1402-P1404A-PM1404A	PM-1404A-Finish Acetone Colm Bottoms P	4M Motor Greasing	27-04-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <P>&<P> FUEL T	03-05-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <P>&<P> FUEL T	03-05-2022
Q-3-VSD-P-1333A	Q3-ISBT-K31P33A-PM33AVSD-P1333A	400/230V VSD PANEL FOR P-1333A	2Y PM VSD unit	21-04-2022
Q-3-VSD-P-1333B	Q3-ISBT-K31P33B-PM33BVSD-P1333B	400/230V VSD PANEL FOR P-1333B	2Y PM VSD unit	21-04-2022
Q-3-VSD-S-1301	Q3-ISB-S1301-SM-1301-VSD-S1301	400/230V VSD PANEL FOR S-1301	2Y PM VSD unit	21-04-2022
Q-3-VSD-S-1302	Q3-ISB-S1302-SM-1302-VSD-S1302	400/230V VSD PANEL FOR S-1302	2Y PM VSD unit	21-04-2022
Q-3-VSD-S-1303A	Q3-ISBS1303ASM-1303AVSD-S1303A	400/230V VSD PANEL FOR S-1303A	2Y PM VSD unit	21-04-2022
Q-3-VSD-S-1303B	Q3-ISBS1303BSM-1303BVSD-S1303B	400/230V VSD PANEL FOR S-1303B	2Y PM VSD unit	21-04-2022
Q-3-P-1913	Q3-ISB-TK-1910-TK-1913-P-1913	17HC PUMP	3M(Online)- Replace Lube Oil, 2Hr	26-04-2022
Q-3-RV-1501	Q3-ISB-TK-1551-RV-1501	RV-1501 ROTARY VALVE	2M-Grease up, 1 Hr	26-04-2022
Q-3-RV-1602	Q3-ISB-L-1602-TK-1602-RV-1602	OFF-SPEC SILO EXIT ROTARY VALVE	2M-Grease up, 1 Hr	26-04-2022
Q-3-D-1401	Q3-ISB-D-1401	DEPHENOLATOR	3M-Replace Oil gear upper bearing, 2Hr	26-04-2022
Q-1-P-1401A	Q1-FRC-TK1401A-P1401A	P-1401A-CrudeAcetoneColumnChargePump	4M- Replace lube oil, 2Hr	29-04-2022
Q-1-P-1104A	Q1-QMX-V1101-P1104	P-1104A-Benzene Recycle Pump	4M-PM Pump, 3Hr	29-04-2022
Q-1-P-1116B	Q1-QMX-D1109-P1116B	P-1116B-DIPB COLUMN VACUUM PUMPS	2M-Greasing, 1Hr	29-04-2022
Q-1-P-1116A	Q1-QMX-D1109-P1116A	P-1116A-DIPB COLUMN VACUUM PUMPS	2M-Greasing, 1Hr	29-04-2022
Q-1-P-1401A	Q1-FRC-TK1401A-P1401A	P-1401A-CrudeAcetoneColumnChargePump	4M- Replace lube oil, 2Hr	29-04-2022
Q-1-P-4115	Q1-OSB-TK4111-P4115	P-411500-Diamine Unloading Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-4116	Q1-OSB-TK4102A-P4116	P-4116-Off-spec Benzene Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-4117	Q1-OSB-TK4103A-P4117	P-4117-Off Spec Cumene Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-4120	Q1-OSB-TK4109-P4120	P-4120-50 %wt Causlic Unloading Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-4121	Q1-OSB-TK4110-P4121	P-4121-ConcentratSulfuricAcidUnloadPump	6M Vibration Monitoring	29-04-2022
Q-1-P-4123	Q1-OSB-TK4112A-P4123	P-4123-Off Spec Phenol Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-4124	Q1-OSB-D4101-P4124	P-4124-Tankage Slops Sump Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-4125	Q1-OSB-D4102-P4125	P-4125-Phenol Slops Sump Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-4126	Q1-OSB-D4103-P4126	P-4126-Acetone Slop Sump Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-6302A	Q1-OSB-TK6301-P6302A	P-6302A-HiPressTemperedWaterCirculationP	6M Vibration Monitoring	22-04-2022
Q-1-P-6601	Q1-OSB00-TK6601-P6601	P-6601-Low Head Condensate Transfer Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-6204B	Q1-OSB-X6201-P6204B	P-6204B-OIL PUMP	1M-GREASING( High temp), 1Hr	29-04-2022
Q-1-P-6204A	Q1-OSB-X6201-P6204A	P-6204A-OIL PUMP	1M-GREASING( High temp), 1Hr	29-04-2022
Q-1-P-1116B	Q1-QMX-D1109-P1116B	P-1116B-DIPB COLUMN VACUUM PUMPS	2M-Greasing, 1Hr	29-04-2022
Q-1-P-1113B	Q1-QMX-V1103-P1113B	P-1113B-DIPB Column Drag Pumps	6M Vibration Monitoring	29-04-2022

49 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-P-1108B	Q1-QMX-V1101-P1108B	P-1108B-Benzene Column Bottoms Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-1109B	Q1-QMX-V1102-P1109B	P-1109B-Cumene Column Bottoms Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-1110B	Q1-QMX-V1103-P1110B	P-1110B-DIPB Column Bottoms Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-1407B	Q1-FRC-V1403-P1407B	P-1407B-ChemicalTreatmentInjectionPump	6M Vibration Monitoring	29-04-2022
Q-1-P-1409B	Q1-FRC-D1405-P1409B	P-1409B-CumeneAMSColumnOverheadWaterPump	6M Vibration Monitoring	22-04-2022
Q-1-P-1422B	Q1-FRC-J1401-P1422B	P-1422B-EjectorVentScrubberBottomPump	6M Vibration Monitoring	29-04-2022
Q-1-P-6301B	Q1-OSB-TK6301-P6301B	P-6301B-Tempered Water Circulation Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-6302B	Q1-OSB-TK6301-P6302B	P-6302B-HiPressTemperedWaterCirculationP	6M Vibration Monitoring	29-04-2022
Q-1-P-9101B	Q1-OSB-D9101-P9101B	P-9101B-Wastewater Treatment Sump Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-9152B	Q1-OSB-TK9152-P9152B	P-9152B-ThickenedSludgePump (Rotary)	6M Vibration Monitoring	28-04-2022
Q-1-P-9153B	Q1-OSB-TK9153-P9153B	P-9153B-SLUDGE FEEDING PUMP (Rotary)	6M Vibration Monitoring	28-04-2022
Q-1-P-6101B	Q1-OSB-T6102-P6101B	P-6101B-ReliabCoolWaterSlipStreamFillePu	6M Vibration Monitoring	29-04-2022
Q-1-P-9204B	Q1-OSB00-D9205-P9204B	P-9204B-Flare Condensate Drum Pumps	6M Vibration Monitoring	29-04-2022
Q-2-P-2108B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	6M Vibration Monitoring	04-04-2022
Q-2-P-2109B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	6M Vibration Monitoring	04-04-2022
Q-2-P-2110B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	6M Vibration Monitoring	04-04-2022
Q-2-P-2410B	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2411B	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2415B	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2416B	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2422B	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2423B	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2601B	Q2-FRC-2600	HUEL MSHF Pcess Unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2602B	Q2-FRC-2600	HUEL MSHF Pcess Unit	6M Vibration Monitoring	04-04-2022
Q-2-P-2603B	Q2-FRC-2600	HUEL MSHF Pcess Unit	6M Vibration Monitoring	04-04-2022
Q-2-P-6351B	Q2-OSB-6350	Tempered Water System	6M Vibration Monitoring	04-04-2022
Q-2-P-6352B	Q2-OSB-6350	Tempered Water System	6M Vibration Monitoring	04-04-2022
Q-3-EDG-001	Q3-OSB-Z9901-EDG-001	400/230V 1250KVA EMER DIESEL GENERATOR	RCM-(6M) PM EMERGENCY DIESEL GENERATOR	22-04-2022
Q-1-P-1102A	Q1-QMX-D1102-P1102A	P-1102A-Propylene Charge Pumps	6M-Lubricant and Replace oil filter	29-04-2022
Q-1-C-9146A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M-Re-Lubricant 2H	29-04-2022
Q-1-C-9146B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M-Re-Lubricant 2H	29-04-2022
Q-1-P-6204B	Q1-OSB-X6201-P6204B	P-6204B-OIL PUMP	1M-GREASING( High temp), 1Hr	29-04-2022
Q-1-P-6204A	Q1-OSB-X6201-P6204A	P-6204A-OIL PUMP	1M-GREASING( High temp), 1Hr	29-04-2022
Q-1-P-1116A	Q1-QMX-D1109-P1116A	P-1116A-DIPB COLUMN VACUUM PUMPS	2M-Greasing, 1Hr	29-04-2022
Q-2-P-2108A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	2M-Replace Lube Oil	28-04-2022
Q-2-P-2405A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-2406A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant 2H	28-04-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	3M-Re-Lubricant 2H	29-04-2022
Q-1-X-9151A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	29-04-2022
Q-1-X-9156	Q1-OSB-TK9155-X9156	X-9156-SLUDGE CONDITION MIXER	6M Vibration Monitoring	29-04-2022
Q-1-P-1115	Q1-QMX-D1108-P1115	P-1115-CumColmSlmGenChemDosingPump	6M Vibration Monitoring	29-04-2022
Q-1-P-4103A	Q1-OSB-TK4103A-P4103A	P-4103A-Cumene Rundown Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-4108A	Q1-OSB-TK4108-P4108A	P-4108A-50 wt% Causlic Transfer Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-9204A	Q1-OSB00-D9205-P9204A	P-9204A-Flare Condensate Drum Pumps	6M Vibration Monitoring	29-04-2022

44 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-P-9116B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	29-04-2022
Q-2-P-2109A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	2M-Replace Lube Oil	28-04-2022
Q-1-P-6204B	Q1-OSB-X6201-P6204B	P-6204B-OIL PUMP	1M-GREASING( High temp). 1Hr	29-04-2022
Q-1-P-6204A	Q1-OSB-X6201-P6204A	P-6204A-OIL PUMP	1M-GREASING( High temp). 1Hr	29-04-2022
Q-1-P-6605A	Q1-OSB-6612	Condensate Recovery & Storage System	3M-Relubricant	29-04-2022
Q-1-P-1116B	Q1-QMX-D1109-P1116B	P-1116B-DIPB COLUMN VACUUM PUMPS	2M-Greasing.1Hr	29-04-2022
Q-1-P-9165C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	29-04-2022
Q-2-P-4162B	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant	29-04-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	29-04-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	29-04-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND CLEANING	29-04-2022
Q-1-P-6101B	Q1-OSB-T6102-P6101B	P-6101B-ReliabCoolWaterSlipStreamFillePu	6M Vibration Monitoring	29-04-2022
Q-1-P-6301B	Q1-OSB-TK6301-P6301B	P-6301B-Tempered Water Circulation Pumps	6M Vibration Monitoring	29-04-2022
Q-1-P-6302B	Q1-OSB-TK6301-P6302B	P-6302B-HiPressTemperedWaterCirculationP	6M Vibration Monitoring	29-04-2022
Q-1-P-9101B	Q1-OSB-D9101-P9101B	P-9101B-Wastewater Treatment Sump Pump	6M Vibration Monitoring	29-04-2022
Q-1-P-9152B	Q1-OSB-TK9152-P9152B	P-9152B-ThickenedSludgePump (Rotary)	6M Vibration Monitoring	28-04-2022
Q-1-P-9153B	Q1-OSB-TK9153-P9153B	P-9153B-SLUDGE FEEDING PUMP (Rotary)	6M Vibration Monitoring	28-04-2022
Q-1-P-9204B	Q1-OSB00-D9205-P9204B	P-9204B-Flare Condensate Drum Pumps	6M Vibration Monitoring	29-04-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	28-04-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	28-04-2022
Q-1-P-6901A	Q1-OSB-X6901-P6901A	P-6901A-Fire Water Pumps	1Y-Fire Pump Performance Test	04-04-2022
Q-1-P-6901B	Q1-OSB-X6901-P6901B	P-6901B-Fire Water Pumps	1Y-Fire Pump Performance Test	04-04-2022
Q-1-P-6901C	Q1-OSB-X6901-P6901C	P-6901C-Fire Water Pumps	1Y-Fire Pump Performance Test	04-04-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	29-04-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-04-2022
Q-2-P-6157A	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-6157B	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-P-6157C	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	28-04-2022
Q-2-LT-23-0402	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	25-04-2022
Q-2-LT-23-0403	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	25-04-2022
Q-2-LT-23-0501	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	25-04-2022
Q-2-LT-23-0601	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	25-04-2022
Q-2-LT-23-0701	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	26-04-2022
Q-2-LT-23-0801	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	26-04-2022
Q-2-LT-23-0803	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	26-04-2022
Q-2-LT-23-1008	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	26-04-2022
Q-2-LT-23-1101	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	26-04-2022
Q-2-LT-23-1301	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	27-04-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine.1.5.Hr	26-04-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine.1.5.Hr	26-04-2022

45 of 63

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	1M-PM Bagging Machine.1.5.Hr	26-04-2022
Q-1-C-6201	Q1-OSB-X6201-C6201	C-6201-COMPRESSOR	1M-Check N2 <(>=>)> Rotate Shaft spare C	03-05-2022
Q-2-PM-2404A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2404B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2405A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2405B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2406A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2406B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2407A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2407B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2408A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-2-PM-2408B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	29-04-2022
Q-1-TT-53-0101	Q1-OSB-TT530101	TT530101-N2 Mainheader Temp. Ind	4Y Calibration (1 Man / 3 Hr.)	25-04-2022
Q-1-TT-41-1002C	Q1-OSB-TK4112B-TT411002C	TT411002C-TK-4112B Temp	4Y Calibration (1 Man / 3 Hr.)	25-04-2022
Q-1-TT-41-1002B	Q1-OSB-TK4112B-TT411002B	TT411002B-TK-4112B Temp	4Y Calibration (1 Man / 3 Hr.)	27-04-2022
Q-1-TT-41-1002A	Q1-OSB-TK4112B-TT411002A	TT411002A-TK-4112B Temp	4Y Calibration (1 Man / 3 Hr.)	27-04-2022
Q-2-P-2109A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	2M-Replace Lube Oil	28-04-2022
Q-3-AT-9227	Q3-OSB-Z-9200-TK-9210-AT-9227	TK-9210 PH INDICATOR	(4M) Inspect, clean and Calb AYZ pH	28-04-2022
Q-3-AT-9202	Q3-OSB-TK9203-P9229A-AT-9202	P-9229A SAMPLE COD ANALYSER TRANSMITTER	(4M) Inspect, clean and Calb AYZ pH	28-04-2022
Q-3-AT-9401	Q3-OSB-TK-9402-AT-9401	TK-9402 PH METER	(4M) Inspect, clean and Calb AYZ pH	28-04-2022
Q-3-AT-9301	Q3-OSB-Z-9302-AT-9301	Z-9302 ANALYZER PH	(4M) Inspect, clean and Calb AYZ pH	28-04-2022
Q-3-MCC-P-9215A	Q3-OSBZ00TK01P9215A-MCC-P9215A	400V MOTOR FEEDER LOC MCC9200-F2-2	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9215B	Q3-OSBZ00TK01P9215B-MCC-P9215B	400V MOTOR FEEDER LOC MCC9200-F2-3	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9216A	Q3-OSB-Z00-P9216A-MCC-P-9216A	400V MOTOR FEEDER LOC MCC9200-F3-3	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9216B	Q3-OSB-Z00-P9216B-MCC-P-9216B	400V MOTOR FEEDER LOC MCC9200-F3-4	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9218	Q3-OSBZ00TK03P18PM18-MCC-P9218	400V MOTOR FEEDER LOC MCC9200-F4-4	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9219A	Q3-OSBZ00TK04P9219A-MCC-P9219A	400V MOTOR FEEDER LOC MCC9200-F4-5	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9219B	Q3-OSBZ00TK04P9219B-MCC-P9219B	400V MOTOR FEEDER LOC MCC9200-F4-6	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9220A	Q3-OSB-Z00-P9220A-MCC-P-9220A	400V MOTOR FEEDER LOC MCC9200-F3-5	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9220B	Q3-OSB-Z00-P9220B-MCC-P-9220B	400V MOTOR FEEDER LOC MCC9200-F3-6	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9220C	Q3-OSB-Z00-P9220C-MCC-P-9220C	400V MOTOR FEEDER LOC MCC9200-F4-1	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9221	Q3-OSBZ00TK05P21-PM21-MCC-P9221	400V MOTOR FEEDER LOC MCC9200-F5-2	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9222A	Q3-OSBZ00-Z14-P9222AMCC-P9222A	400V MOTOR FEEDER LOC MCC9200-F5-3	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9222B	Q3-OSBZ00-Z14-P9222BMCC-P9222B	400V MOTOR FEEDER LOC MCC9200-F5-4	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9223A	Q3-OSBZ00TK06P9223A-MCC-P9223A	220V MOTOR FEEDER LOC MCC9200-F6-1	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9223B	Q3-OSBZ00TK06P9223B-MCC-P9223B	220V MOTOR FEEDER LOC MCC9200-F6-2	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9224A	Q3-OSBZ00TK07P9224A-MCC-P9224A	220V MOTOR FEEDER LOC MCC9200-F6-3	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9224B	Q3-OSBZ00TK07P9224B-MCC-P9224B	220V MOTOR FEEDER LOC MCC9200-F6-4	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9225A	Q3-OSBZ00TK08P9225A-MCC-P9225A	220V MOTOR FEEDER LOC MCC9200-F6-5	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9225B	Q3-OSBZ00TK08P9225B-MCC-P9225B	220V MOTOR FEEDER LOC MCC9200-F7-1	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9226A	Q3-OSBZ00TK09P9226A-MCC-P9226A	220V MOTOR FEEDER LOC MCC9200-F7-2	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9226B	Q3-OSBZ00TK09P9226B-MCC-P9226B	220V MOTOR FEEDER LOC MCC9200-F7-3	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9227	Q3-OSBZ00TK10P27PM27-MCC-P9227	400V MOTOR FEEDER LOC MCC9200-F8-7	2Y PM MCC feeder	25-04-2022
Q-3-MCC-P-9229A	Q3-OSBZ00TK03P9229A-MCC-P9229A	400V MOTOR FEEDER LOC MCC9200-F4-2	2Y PM MCC feeder	25-04-2022

46 of 93



Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-MCC-P-9229B	Q3-OSBZ00TK03P9229B-MCC-P9229B	400V MOTOR FEEDER LOC MCC9200-F4-3	2Y PM MCC feeder	25-04-2022
Q-3-MCC-Z-921B	Q3-OSB-Z-9200-Z-921B-MCC-Z921B	400V POWER FEEDER LOC MCC9200-F8-2	2Y PM MCC feeder	25-04-2022
Q-3-MCC-Z-9219	Q3-OSB-Z-9200-Z-9219-MCC-Z9219	400V POWER FEEDER LOC MCC9200-F8-1	2Y PM MCC feeder	25-04-2022
Q-3-AT-9201	Q3-OSB-Z-9200-TK-9201-AT-9201	TK-9201 ANALYZER PH METER	(4M) Inspect, clean and Calb AYZ pH	28-04-2022
Q-3-PM-9402B	Q3-OSB-TK-9402-P-9402B-PM9402B	6.6KV AC MOTOR FOR P-9402B	2M Motor Greasing	26-04-2022
Q-3-CM-9601B	Q3-OSB-TK-9601-C-9601B-CM9601B	6.6KV AC MOTOR FOR C-9601B	2M Motor Greasing	26-04-2022
Q-3-PM-9302B	Q3-OSB-Z-9301B-P-9302B-PM9302B	6.6KV AC MOTOR FOR P-9302B	2M Motor Greasing	26-04-2022
Q-3-PM-1911B	Q3-ISB-TK-1915-P-1911B-PM1911B	6.6KV AC MOTOR FOR P-1911B	2M Motor Greasing	26-04-2022
Q-3-PM-9502A	Q3-OSB-Z-9501-P-9502A-PM-9502A	400V AC MOTOR FOR P-9502A	2M Motor Greasing	26-04-2022
Q-1-PM-6603A	Q1-OSB00-TK6601-P-6603A-PM6603A	PM-6603A-High Head Condens Transfer Pump	4M Motor Greasing	27-04-2022
Q-3-AT-1912	Q3-ISB-TK-1910-P-1910A-AT-1912	TK-1910 OUTLET SCR TOC	1M PM Analyzer TOC	28-04-2022
Q-3-SM-1303B	Q3-ISB-S-1303B-SM-1303B	400V AC MOTOR FOR S-1303B	2M Motor Greasing	26-04-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	1M PM Analyzer COD	28-04-2022
Q-3-P-1904	Q3-ISB-TK-1904-P-1904	DRAIN RECEIVER PUMP	1M-PM Vertical Pump 2Hr	26-04-2022
Q-3-ZM-9401	Q3-OSB-TK-9402-Z-9401-ZM-9401	6.6KV AC MOTOR FOR Z-9401	2M Motor Greasing	26-04-2022
Q-3-P-1809	Q3-ISB-TK-1805-P-1809	TAR DRAIN RECEIVER PUMP	1M-PM Vertical Pump 2Hr	28-04-2022
Q-3-P-1875	Q3-ISB-TK-1875-P-1875	TAR DRAIN RECEIVER PUMP (TANKAGE AREA)	1M-PM Vertical Pump 2Hr	26-04-2022
Q-3-SM-1303A	Q3-ISB-S-1303A-SM-1303A	400V AC MOTOR FOR S-1303A	2M Motor Greasing	26-04-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(1M) Inspection & Cleaning	28-04-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(3M) Cleaning, Replace seal & maint kits	28-04-2022
Q-1-P-1103A	Q1-QMX-R1101-P1103A	P-1103A-AlkylationReactorEffluentRecyPum	8M-Replace lube oil 2Hr	29-04-2022
Q-1-P-1111A	Q1-QMX-V1103-P1111A	P-1111A-DIPB Column Sidedraw Pumps	8M-Replace lube oil 2Hr	29-04-2022
Q-1-P-1106A	Q1-QMX-D1104-P1106A	P-1106A-Benzene Column Overhead Pumps	8M-Replace lube oil 2Hr	29-04-2022
Q-3-CM-1201	Q3-ISBD01TK01-E06-C1201-CM1201	400V AC MOTOR FOR C-1201	RCM 4M Motor Greasing	27-04-2022
Q-3-AT-1911	Q3-ISB-TK-1910-P-1910A-AT-1911	TK-1910 OUTLET SCR CONDUCTIVITY	(2M) PM Analyzer Conductivity	28-04-2022
Q-3-AT-9101	Q3-OSB-TK-9101-E-9101-AT-9101	STEAM CONDENSATE RETURN CONDUCTIVITY	(2M) PM Analyzer Conductivity	28-04-2022
Q-3-AT-9205	Q3-OSB-TK9203-P9229A-AT-9205	P-9229A CONDUCTIVITY ANALYZER	(2M) PM Analyzer Conductivity	28-04-2022
Q-3-ENMCS-EWS-01	Q3-OSB-ENMCS-EWS-01	ENMCS ENGINEERING WORKSTATION 01	3M Clean & Inspect ENMCS Sys.	27-04-2022
Q-3-ENMCS-EWS-02	Q3-OSB-ENMCS-EWS01-ENMCS-EWS02	ENMCS ENGINEERING WORKSTATION 02	3M Clean & Inspect ENMCS Sys.	27-04-2022
Q-3-ENMCS-LP-301	Q3-OSB-ENMCS-EWS01-ENMCS-LP301	ENMCS PANEL CABINET	3M Clean & Inspect ENMCS Sys.	27-04-2022
Q-3-AT-9302	Q3-OSB-Z-9302-AT-9302	Z-9302 ANALYZER CONDUCTIVITY	(2M) PM Analyzer Conductivity	28-04-2022
Q-1-P-1401A	Q1-FRC-TK1401A-P1401A	P-1401A-CrudeAcetoneColumnChargePump	4M- Replace lube oil 2Hr	29-04-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?><?> FUEL T	03-05-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?><?> FUEL T	03-05-2022
Q-3-AT-9203B	Q3-OSB-Z9200TK9202B-AT-9203B	TK-9202B DISSOLVED OXYGEN ANALYZER	(2M) PM Analyzer Dissolved oxyge	28-04-2022
Q-3-AT-9203A	Q3-OSB-Z9200TK9202A-AT-9203A	TK-9202A DISSOLVED OXYGEN ANALYZER	(2M) PM Analyzer Dissolved oxygen	28-04-2022
Q-1-MOV-41-0502	Q1-OSB-TK4106-P4106-MOV410502	MOV410502-Heavy Aroma Trck Load ShutoffV	6M Inspect and Clean MOV (FF) 2H	29-04-2022
Q-1-P-1402A	Q1-FRC-V1401-P1402A	P-1402A-CrudeAcetoneColumnBottomsPump	4M- Replace lube oil 2Hr	29-04-2022
Q-1-P-1404A	Q1-FRC-V1402-P1404A	P-1404A-FinishAcetoneColumnBottomsPump	4M- Replace lube oil 2Hr	29-04-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Bell Inspection	03-05-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Bell Inspection	03-05-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Bell Inspection	03-05-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	03-05-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	03-05-2022

47 of 63

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X 9101	1W-Bell Inspoition	03-05-2022
Q-3-P-1202	Q3-ISB-D-1201-P-1202	DEHYDRATOR BOTTOM PUMP	3M(Online)- Replace Lube Oil 2Hr	03-05-2022
Q-3-P-1203	Q3-ISB-D-1201-P-1203	DEHYDRATOR REBOILER CIRC. PUMP	3M(Online)- Replace Lube Oil 2Hr	03-05-2022
Q-1-PM-9118A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	31-05-2022
Q-1-P-9165A	Q1-OSB-D9165-P9165A	P-9165A-FacI3 DOSING PUMP (METERING)	6M Vibration Monitoring	02-06-2022
Q-1-P-1104B	Q1-QMX-V1101-P1104	P-1104A-Benzene Recycle Pump	4M-PM Pump 3Hr	02-06-2022
Q-1-PM-9119A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	31-05-2022
Q-1-PM-9116A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	31-05-2022
Q-1-PM-9118B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	31-05-2022
Q-1-CM-9132D	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	1Y Motor Winding Insulation & Starter Un	31-05-2022
Q-1-CM-9132A	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	1Y Motor Winding Insulation & Starter Un	31-05-2022
Q-1-P-9116A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	02-06-2022
Q-1-P-9118A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	02-06-2022
Q-1-P-9119A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M Vibration Monitoring	02-06-2022
Q-1-PM-6104B	Q1-OSB-T6102-P6104B-PM6104B	PM-6104B-Reliable C/W calculation Pump	Motor Greasing	31-05-2022
Q-1-PM-6103B	Q1-OSB-T6101-P6103B-PM6103B	PM-6103B-HP C/W Cir Pump	Motor Greasing	31-05-2022
Q-1-T-6102-3	Q1-OSB-T6102-T61023	T-6102-3-Reliable Cooling Tower No.3	1M-Replace oil gear box&inspection	02-06-2022
Q-1-PM-1206	Q1-OSB-T6102-T61023-PM1206	PM-1206-Oxidizer no.1 Pump	Motor Greasing	31-05-2022
Q-1-PM-1102A	Q1-QMX-D1102-P1102A-PM1102A	PM-1102A-Propylene Charge Pump	Motor Greasing	31-05-2022
Q-1-TM-6102-1	Q1-OSB-T6102-T61021-TM61021	TM-6102-1-Motor Reliable Cooling FanNo.1	Motor Greasing	31-05-2022
Q-1-TM-6102-2	Q1-OSB-T6102-T61022-TM61022	TM-6102-2-Motor Reliable Cooling FanNo.2	Motor Greasing	31-05-2022
Q-1-TM-6102-3	Q1-OSB-T6102-T61023-TM61023	TM-6102-3-Motor Reliable Cooling FanNo.3	Motor Greasing	31-05-2022
Q-1-TR-5001A	Q1-OSB-SWJ105-SWJ104-TR5001A	TR-5001A-Transformer 5001A	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5001B	Q1-OSB-SWJ105-SWJ103-TR5001B	TR-5001B-Transformer 5001B	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5001C	Q1-OSB-SWJ105-SWJ102-TR5001C	TR-5001C-Transformer 5001C	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5001D	Q1-OSB-SWJ105-SWJ101-TR5001D	TR-5001D-Transformer 5001D	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5002A	Q1-OSB-SWL112-SWL111-TR5002A	TR-5002A-Transformer 5002A	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5002B	Q1-OSB-SWL11600-SWL117-TR5002B	TR-5002B-Transformer 5002B	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5002C	Q1-OSB-SWL112-SWL109-TR5002C	TR-5002C-Transformer 5002C	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5002D	Q1-OSB-SWL11600-SWL119-TR5002D	TR-5002D-Transformer 5002D	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5003A	Q1-OSB-SWL112-SWL110-TR5003A	TR-5003A-Transformer 5003A	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5003B	Q1-OSB-SWL11600-SWL118-TR5003B	TR-5003B-Transformer 5003B	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5003C	Q1-OSB-SWL206-SWL205-TR5003C	TR-5003C-Transformer 5003C	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5003D	Q1-OSB-SWL210-SWL212-TR5003D	TR-5003D-Transformer 5003D	RCM-6M THERMO SCAN	31-05-2022
Q-1-TR-5004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-6M THERMO SCAN	31-05-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	02-06-2022
Q-2-LT-23-1501	Q2-OSB-2300	Phenol I Oxidation CDN Section	1M-Equipment Site Patrol	19-05-2022
Q-2-LT-23-1901	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	23-05-2022
Q-2-LT-23-2001	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	23-05-2022
Q-2-LT-23-2002	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	23-05-2022
Q-2-LXT-23-0802	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	23-05-2022
Q-2-LXT-23-1006	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	23-05-2022
Q-2-LXT-23-1007	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Level Trans	23-05-2022

88 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-LXT-23-1201	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test Level Trans	23-05-2022
Q-2-LXT-23-1302	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test Level Trans	23-05-2022
Q-2-LXT-23-1303	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test Level Trans	23-05-2022
Q-2-X-2051	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	(1M) PM Oil Mist	31-05-2022
Q-2-X-2052	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1M) PM Oil Mist	31-05-2022
Q-2-X-2053	Q2-OSB-6150	Phenol Recovery Section	(1M) PM Oil Mist	31-05-2022
Q-2-P-6652A	Q2-OSB-6650	Steam System and Condensate system	6M Vibration Monitoring	02-06-2022
Q-2-P-6656A	Q2-OSB-6650	Steam System and Condensate system	6M Vibration Monitoring	03-05-2022
Q-2-P-9451	Q2-OSB-9450	Aromatic Closed Drain System	6M Vibration Monitoring	02-06-2022
Q-2-P-9452	Q2-OSB-9450	Aromatic Closed Drain System	6M Vibration Monitoring	02-06-2022
Q-2-P-4110A	Q2-OSB-4100	Tank Gauging System	6M Vibration Monitoring	03-05-2022
Q-2-P-6158A	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	31-05-2022
Q-2-P-6158B	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	31-05-2022
Q-2-P-6158C	Q2-OSB-6150	Phenol Recovery Section	(6M) Re-Lubricant 2H	31-05-2022
Q-2-PM-2422A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-PM-2424A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-PM-2425A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-PM-2501A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	30-05-2022
Q-2-PM-2503A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	30-05-2022
Q-2-PM-2509A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	30-05-2022
Q-2-PM-2602A	Q2-FRC-2600	HUEL MSHP Process Unit	Motor Greasing	30-05-2022
Q-2-PM-2603A	Q2-FRC-2600	HUEL MSHP Process Unit	Motor Greasing	30-05-2022
Q-2-PM-6451	Q2-OSB-6400	Process Water System	Motor Greasing	30-05-2022
Q-2-PM-2106A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	30-05-2022
Q-2-PM-2108A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	30-05-2022
Q-2-PM-2111A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	30-05-2022
Q-2-PM-2113A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	30-05-2022
Q-2-PM-2303A	Q2-OCD-2300	Phenol II Oxidation CDN Section	Motor Greasing	30-05-2022
Q-2-PM-2405A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-PM-2411A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-PM-2412A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-PM-2423A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-PM-2506A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	30-05-2022
Q-2-PM-2507A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	30-05-2022
Q-2-PM-2601A	Q2-FRC-2600	HUEL MSHP Process Unit	Motor Greasing	30-05-2022
Q-2-PM-4103C	Q2-OSB-4100	Tank Gauging System	Motor Greasing	30-05-2022
Q-2-PM-4151A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	30-05-2022
Q-2-PM-6653	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	30-05-2022
Q-2-PM-2102A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	30-05-2022
Q-2-PM-2214A	Q2-OCD-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	30-05-2022
Q-2-PM-2403A	Q2-FRC-2400	Fractionation unit	Motor Greasing	30-05-2022
Q-2-TR-5054A	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5054B	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5055A	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022

66 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-TR-5055B	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5056A	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5056B	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5053A	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5053B	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5052A	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-2-TR-5052B	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M THERMO SCAN	30-05-2022
Q-3-DCS-HIS	Q3-OSB-9900	Phenol II EMERGENCY POWER GENERATOR SYSTEM	1M-Equipment Site Patrol (1M) Archive HIST Data and Config. to CD	24-05-2022 03-05-2022
Q-3-S-1301	Q3-ISB-S-1301	1ST SEPARATOR	1M-PM Separator.4Hr	31-05-2022
Q-3-S-1302	Q3-ISB-S-1302	2ND SEPARATOR	1M-PM Separator.4Hr	31-05-2022
Q-3-Z-1301	Q3-ISB-1300	PURIFICATION	1M-PM Oil Mist System	02-06-2022
Q-1-CM-9132A	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	2M Motor Greasing	31-05-2022
Q-1-CM-9132D	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	2M Motor Greasing	31-05-2022
Q-1-PM-1105	Q1-QMX-V1101-P1105-PM1105	PM-1105-Benzene Recycle Wash Pump	4M Motor Greasing	31-05-2022
Q-1-PE-6901C	Q1-OSB-X6901-P6901C-PE1C	PE-6901C BATTERY FIRE PUMP STARTER	2Y-Replace Battery	31-05-2022
Q-1-CM-9131A	Q1-OSBT9131-C9131A-CM9131A	CM-9131A_SBR Influent Blower	6M-Motor (Cancel have FRP)	31-05-2022
Q-1-CM-9131B	Q1-OSBT9131-C9131B-CM9131B	CM-9131B_SBR Influent Blower	6M-Motor (Cancel have FRP)	31-05-2022
Q-1-P-1102B	Q1-QMX-D1102-P1102B	P-1102B-Propylene Charge Pumps	6M-Lubricant and Replace oil filter	03-05-2022
Q-1-P-1601B	Q1-QMX-TK1601-P1601B	P-1601B-Hydrogenation Charge Pumps	6M-Lubricant and Replace oil filter	02-06-2022
Q-1-PE-6901B	Q1-OSB-X6901-P6901B-PE1B	PE-6901B BATTERY FIRE PUMP STARTER	2Y-Replace Battery	31-05-2022
Q-1-P-6605B	Q1-OSB-6612	Condensate Recovery & Storage System	3M-Relubricant	02-06-2022
Q-1-TT-41-1001C	Q1-OSB-TK4112A-TT411001C	TT411001C-TK-4112A Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-1-TT-41-1001B	Q1-OSB-TK4112A-TT411001B	TT411001B-TK-4112A Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-1-TT-41-1001A	Q1-OSB-TK4112A-TT411001A	TT411001A-TK-4112A Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-1-TT-41-0704	Q1-OSB-TK4109-TT410704	TT410704-TK-4109 Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-2-PSV-23-1405B	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Calibration test	03-05-2022
Q-2-PSV-23-1801B	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Calibration test	10-05-2022
Q-2-PSV-23-1802B	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Calibration test	10-05-2022
Q-2-PSV-23-1903B	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Calibration test	03-05-2022
Q-2-PM-2409A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2409B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2410A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2410B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2411A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2411B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2412A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2412B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2415A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2415B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2416A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2416B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2418A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2419A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022

80 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PM-2422A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-lighten	30-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-DV-6911	Q1-OSB-X6901-P6901A-DV6911	DV6911-V-1301	1Y Inspect and clean	26-05-2022
Q-1-DV-6912	Q1-OSB-X6901-P6901A-DV6912	DV6912-P-1208A/B	1Y Inspect and clean	26-05-2022
Q-1-DV-6913	Q1-OSB-X6901-P6901A-DV6913	DV6913-P-1203A/B D-1201	1Y Inspect and clean	26-05-2022
Q-1-DV-6914	Q1-OSB-X6901-P6901A-DV6914	DV6914-P-1206 P-1207A/B	1Y Inspect and clean	26-05-2022
Q-1-DV-6915	Q1-OSB-X6901-P6901A-DV6915	DV6915-0X-1201	1Y Inspect and clean	26-05-2022
Q-1-DV-6906	Q1-OSB-X6901-P6901A-DV6906	DV6906-P-1408A/B D-1405	1Y Inspect and clean	26-05-2022
Q-1-DV-6907	Q1-OSB-X6901-P6901A-DV6907	DV6907-P-1403A/B P-1404A/B V-1402	1Y Inspect and clean	26-05-2022
Q-1-DV-6908	Q1-OSB-X6901-P6901A-DV6908	DV6908-P-1602 P-1504, P-1507, P-1506	1Y Inspect and clean	26-05-2022
Q-1-DV-6909	Q1-OSB-X6901-P6901A-DV6909	DV6909-P-9203 D-9203 D-1306	1Y Inspect and clean	26-05-2022
Q-1-DV-6910	Q1-OSB-X6901-P6901A-DV6910	DV6910-P-1302A/B P-1303A/B D-1301	1Y Inspect and clean	26-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	19-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-PYL-PIP-I4	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Visual Inspection	23-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-PYL-PIP-I4	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	23-05-2022
Q-1-DV-6901	Q1-OSB-X6901-P6901A-DV6901	DV6901-P-1110/P-1111/P-1113/V-1103	1Y Inspect and clean	26-05-2022
Q-1-DV-6902	Q1-OSB-X6901-P6901A-DV6902	DV6902-V-1101/V-1102	1Y Inspect and clean	26-05-2022
Q-1-DV-6903	Q1-OSB-X6901-P6901A-DV6903	DV6903-P-1104 To P-1106, P-1108 To P-1109	1Y Inspect and clean	26-05-2022
Q-1-DV-6904	Q1-OSB-X6901-P6901A-DV6904	DV6904-P-1101A/B Thru P-1103A/B	1Y Inspect and clean	26-05-2022
Q-1-DV-6905	Q1-OSB-X6901-P6901A-DV6905	DV6905-P-1403A/B P-1404A/B V-1402	1Y Inspect and clean	26-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	19-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	19-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-PYL-PIP-I4	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	23-05-2022

32 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Visual Inspection	23-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-PYL-PIP-I4	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	23-05-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	23-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	19-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	19-05-2022
Q-1-PM-1207A	Q1-OSB-OX-1202-P-1207A-PM1207A	PM-1207A-Oxidizer no.1 Pump	4M Motor Greasing	31-05-2022
Q-1-AT-11-0601B	Q1-QMX-V1103-E1104-AT110601B	AT110601B-Feed to TransAlkyl Reac	(1M) Inspect and Clean Strainer	30-05-2022
Q-1-PM-1302A	Q1-OSB-D1304-P1302A-PM1302A	PM-1302A-Decomposer Cir Pump	4M Motor Greasing	31-05-2022
Q-1-PM-1402A	Q1-FRC-V1401-P1402A-PM1402A	PM-1402A-Crude Acetone Colm Bottoms Pump	4M Motor Greasing	31-05-2022
Q-1-DV-6926	Q1-OSB-X6901-P6901A-DV6926	DV6926-TK-4103A	1Y Inspect and clean	26-05-2022
Q-1-DV-6927	Q1-OSB-X6901-P6901A-DV6927	DV6927-P4113, P1601, P4102, P4103, P4116-7	1Y Inspect and clean	26-05-2022
Q-1-DV-6928	Q1-OSB-X6901-P6901A-DV6928	DV6928-TK-4104	1Y Inspect and clean	26-05-2022
Q-1-DV-6929	Q1-OSB-X6901-P6901A-DV6929	DV6929-TK-4104	1Y Inspect and clean	26-05-2022
Q-1-DV-6930	Q1-OSB-X6901-P6901A-DV6930	DV6930-TK-1401A	1Y Inspect and clean	26-05-2022
Q-1-DV-6921	Q1-OSB-X6901-P6901A-DV6921	DV6921-TK-1601	1Y Inspect and clean	26-05-2022
Q-1-DV-6922	Q1-OSB-X6901-P6901A-DV6922	DV6922-TK-4103C	1Y Inspect and clean	26-05-2022
Q-1-DV-6923	Q1-OSB-X6901-P6901A-DV6923	DV6923-TK-4113B	1Y Inspect and clean	26-05-2022
Q-1-DV-6924	Q1-OSB-X6901-P6901A-DV6924	DV6924-TK-4103B	1Y Inspect and clean	26-05-2022
Q-1-DV-6925	Q1-OSB-X6901-P6901A-DV6925	DV6925-TK-4113A	1Y Inspect and clean	26-05-2022
Q-1-DV-6931	Q1-OSB-X6901-P6901A-DV6931	DV6931-TK-1401A	1Y Inspect and clean	26-05-2022
Q-1-DV-6932	Q1-OSB-X6901-P6901A-DV6932	DV6932-TK-1401B	1Y Inspect and clean	26-05-2022
Q-1-DV-6933	Q1-OSB-X6901-P6901A-DV6933	DV6933-TK-1401B	1Y Inspect and clean	26-05-2022
Q-1-DV-6934	Q1-OSB-X6901-P6901A-DV6934	DV6934-TK-1201	1Y Inspect and clean	26-05-2022
Q-1-DV-6935	Q1-OSB-X6901-P6901A-DV6935	DV6935-TK-1201	1Y Inspect and clean	26-05-2022
Q-1-DV-6916	Q1-OSB-X6901-P6901A-DV6916	DV6916-0X-1201	1Y Inspect and clean	26-05-2022
Q-1-DV-6917	Q1-OSB-X6901-P6901A-DV6917	DV6917-0X-1202	1Y Inspect and clean	26-05-2022
Q-1-DV-6918	Q1-OSB-X6901-P6901A-DV6918	DV6918-0X-1202	1Y Inspect and clean	26-05-2022
Q-1-DV-6919	Q1-OSB-X6901-P6901A-DV6919	DV691900-TK-4102A	1Y Inspect and clean	26-05-2022
Q-1-DV-6920	Q1-OSB-X6901-P6901A-DV6920	DV6920-TK-4102B	1Y Inspect and clean	26-05-2022
Q-1-DV-6941	Q1-OSB-X6901-P6901A-DV6941	DV6941-TK-5001	1Y Inspect and clean	26-05-2022
Q-1-DV-6942	Q1-OSB-X6901-P6901A-DV6942	DV6942-P-4105 P-4105	1Y Inspect and clean	26-05-2022
Q-1-DV-6943	Q1-OSB-X6901-P6901A-DV6943	DV6943-TK-4101B	1Y Inspect and clean	26-05-2022
Q-1-DV-6944	Q1-OSB-X6901-P6901A-DV6944	DV6944-P-4101A/B TK-4101A	1Y Inspect and clean	26-05-2022
Q-1-DV-6945	Q1-OSB-X6901-P6901A-DV6945	DV6945-P-9201 D-9201	1Y Inspect and clean	26-05-2022
Q-1-AT-11-0601A	Q1-QMX-R1101-AT110601A	AT110601A-Fd. to Alk. Reac Moist Content	(1M) Inspect and Clean Strainer	30-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	19-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	11-05-2022

32 of 83



Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	11-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	11-05-2022
Q-1-OSB-PYL-PIP-I4	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	12-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	12-05-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Visual Inspection	12-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	12-05-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	12-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	12-05-2022
Q-1-OSB-PYL-PIP-I4	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	12-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	12-05-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	12-05-2022
Q-1-PM-1601B	Q1-QMX-TK1601-P1601B-PM1601B	PM-1601B-Hydrogenation Charge Pump	2M Motor Greasing	31-05-2022
Q-1-PM-1403A	Q1-FRC-D1401-P1403A-PM1403A	PM-1403A-Crude Acetone Colm Overhead P	4M Motor Greasing	31-05-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1M-Replace Lube Oil	02-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1M-Replace Lube Oil	02-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1M-Replace Lube Oil	02-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	02-06-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	02-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	02-06-2022
Q-3-C-1301	Q3-ISB-C-1301	SEPARATOR VACUUM PUMP	3M-Grease up	31-05-2022
Q-3-C-1801	Q3-ISB-TK-181300-C-1801	PURGE REACTOR VACUUM UNIT	3M(Online)- Replace Lube Oil 1.5Hr	31-05-2022
Q-3-P-1317	Q3-ISB-Q-1301-E-1302-P-1317	CRYSTALLIZER FEED COOLER TCWPUMP	3M(Online)- Replace Lube Oil 2Hr	02-06-2022
Q-3-P-1331	Q3-ISB-S-1302-N-1310-P-1331	3RD SEPARATOR FEED PUMP	3M(Online)- Replace Lube Oil 2Hr	02-06-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filter	1M Inspect and Calb AYZ Hydr 4H	30-05-2022
Q-1-AT-61-0101	Q1-OSB-T6101-AT610101	AT610101-Main C/W Return Line	(3M) Inspect and Calb AYZ Hydr 4H	30-05-2022
Q-1-AT-61-0301	Q1-OSB-T6102-AT610301	AT610301-Main Reliable C/W Return Line	(3M) Inspect and Calb AYZ Hydr 4H	30-05-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-1-P-6204B	Q1-OSB-X6201-P6204B	P-6204B-OIL PUMP	1M-GREASING( High temp). 1Hr	02-06-2022
Q-1-P-6204A	Q1-OSB-X6201-P6204A	P-6204A-OIL PUMP	1M-GREASING( High temp). 1Hr	02-06-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	30-05-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(1M) Archive HIST Data and Config. lo CD	17-05-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	30-05-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Bell Inspection	02-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Bell Inspection	02-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Bell Inspection	02-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	02-06-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	02-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	02-06-2022
Q-2-PDXT-23-1012	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PDXT-23-1701A	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PDXT-23-1701B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PDXT-23-1701C	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PT-23-0401	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022

33 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PT-23-0402	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PT-23-0501	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PT-23-0701	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PT-23-0801	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-PT-23-0802	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Press Trans	23-05-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	31-05-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	31-05-2022
Q-2-PM-2422B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2423A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2423B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2424A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2424B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2425A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2425B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2430	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2431A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2431B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2432A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2432B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2433A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2433B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2434A	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-2-PM-2434B	Q2-FRC-2400	Fractionation unit	(1Y) Inspection Megger clean re-tighten	30-05-2022
Q-1-AT-14-1501	Q1-FRC-D1405-P1408A-AT141501	AT141501-Gas Chromatograph	(3M) Inspect, Cleaning and Cal GC Analyz	30-05-2022
Q-1-P-1507B	Q1-FRC-D1507-P1507B	P-1507B-Solvent Pumps	8M-Replace lube oil 2Hr	02-06-2022
Q-1-P-1502B	Q1-FRC00-TK1502-P1502B	P-1502B-Sodium Phenale Pumps	8M-Replace lube oil 2Hr	02-06-2022
Q-1-PE-6902B	Q1-OSB-X6901-P6902B-PE2B	PE-6902B BATTERY JOG. PUMP STARTER	2Y-Replace Battery	01-05-2022
Q-1-TT-41-0703	Q1-OSB-TK4108-E4103A-TT410703	TT410703-E-4103 Outlet Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-1-TT-41-0702	Q1-OSB-TK4108-E4103A-TT410702	TT410702-E-4103 Outlet Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-1-TT-41-0701	Q1-OSB-TK4108-X4101-TT410701	TT410701-E-4103 Inlet Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-1-TT-41-0503	Q1-OSB-TK4107-TT410503	TT410503-TK-4107 Temp	4Y Calibration (1 Man / 3 Hr.)	11-05-2022
Q-1-AT-11-1501	Q1-QMX-V1102-AT111501	AT111501-Gas Chromatograph	(3M) Inspect, Cleaning and Cal GC Analyz	30-05-2022
Q-1-AT-14-1102	Q1-FRC-V1402-E1405	E-1405-Acetone Product Cooler	(3M) Inspect, Cleaning and Cal GC Analyz	30-05-2022
Q-3-P-1315B	Q3-ISB-S-1303B-N-1313B-P-1315B	MELT PUMP	6M(Online)- Replace Lube Oil 2Hr	01-05-2022
Q-3-PM-9502B	Q3-OSB-Z-9501-P-9502B-PM-9502B	400V AC MOTOR FOR P-9502B	2M Motor Greasing	10-05-2022
Q-3-L-1602	Q3-ISB-L-1602	BPA PRODUCT CONVEYOR 1	RCM 3M-PM Bucket conveyor.5Hr	02-06-2022
Q-3-PM-1311	Q3-ISBS1302TK1308-P1311-PM1311	400V AC MOTOR FOR P-1311	2M Motor Greasing	10-05-2022
Q-3-PM-1305	Q3-ISBS1301TK1303-P1305-PM1305	400V AC MOTOR FOR P-1305	2M Motor Greasing	10-05-2022
Q-3-PM-9302C	Q3-OSB-Z-9301C-P-9302C-PM9302C	6.6KV AC MOTOR FOR P-9302C	2M Motor Greasing	10-05-2022
Q-3-PM-9302A	Q3-OSB-Z-9301A-P-9302A-PM9302A	6.6KV AC MOTOR FOR P-9302A	2M Motor Greasing	10-05-2022
Q-3-PM-1913	Q3-ISBTk1910TK1913P1913-PM1913	400V AC MOTOR FOR P-1913	2M Motor Greasing	10-05-2022
Q-1-P-1602B	Q1-QMX-R1601-P1602B	P-1602B-Hydrogenation Recycle Pumps	8M-Replace lube oil 2Hr	02-06-2022
Q-1-PM-6113A	Q1-OSB-T6101-P6113A-PM6113A	PM-6113A-C/W Slip Stream Filter Pump	4M Motor Greasing	31-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	19-05-2022

34 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-CM-9601A	Q3-OSB-TK-9601-C-9601A-CM9601A	6.6KV AC MOTOR FOR C-9601A	2M Motor Greasing	10-05-2022
Q-3-PM-9402A	Q3-OSB-TK-9402-P-9402A-PM9402A	6.6KV AC MOTOR FOR P-9402A	2M Motor Greasing	10-05-2022
Q-3-PM-1911A	Q3-ISB-TK-1915-P-1911A-PM1911A	6.6KV AC MOTOR FOR P-1911A	2M Motor Greasing	10-05-2022
Q-3-L-1604	Q3-ISB-L-1604	BPA PRODUCT CONVEYOR 3	RCM 1M PM Bucket conveyor.2.5Hr	02-06-2022
Q-3-PM-1316	Q3-ISB-TK-1351-P-1316-PM-1316	400V AC MOTOR FOR P-1316	4M Motor Greasing	10-05-2022
Q-3-CM-1301	Q3-ISB-C-1301-CM-1301	6.6KV AC MOTOR FOR C-1301	4M Motor Greasing	10-05-2022
Q-3-PM-1315A	Q3-ISBS03AN1313AP1315A-PM1315A	400V AC MOTOR FOR P-1315A	4M Motor Greasing	10-05-2022
Q-3-PM-1501	Q3-ISBTK1551N1501-P1501-PM1501	400V AC MOTOR FOR P-1501	4M Motor Greasing	10-05-2022
Q-3-PM-1315B	Q3-ISBS03BN1313BP1315B-PM1315B	400V AC MOTOR FOR P-1315B	4M Motor Greasing	10-05-2022
Q-3-PM-1307B	Q3-ISBQ03E1306B-P1307B-PM1307B	6.6KV AC MOTOR FOR P-1307B	4M Motor Greasing	10-05-2022
Q-3-PM-1307A	Q3-ISBQ03E1306A-P1307A-PM1307A	6.6KV AC MOTOR FOR P-1307A	4M Motor Greasing	10-05-2022
Q-3-PM-1102	Q3-ISBTK1152TK1103-P1102PM1102	400V AC MOTOR FOR P-1102	4M Motor Greasing	10-05-2022
Q-3-PM-1309	Q3-ISB-Q1304-E1307-P1309PM1309	6.6KV AC MOTOR FOR P-1309	4M Motor Greasing	10-05-2022
Q-3-PM-1331	Q3-ISB-S1302-N1310-P1331PM1331	400V AC MOTOR FOR P-1331	4M Motor Greasing	10-05-2022
Q-3-PM-1802	Q3-ISB-D-1801-P-1802-PM-1802	400V AC MOTOR FOR P-1802	4M Motor Greasing	10-05-2022
Q-1-AT-91-6801	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(6M) Replac repair kills and Calb AYZ COD	30-05-2022
Q-1-AT-91-6801	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2Y) Replac sample pump & Filter COD AYZ	30-05-2022
Q-1-AT-91-6801	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(3Y) Replac acid&base pump & O2 COD AYZ	30-05-2022
Q-1-AT-91-6801	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) Inspect and Calb AYZ COD 2H	30-05-2022
Q-1-XD-5001B	Q1-OSB-X5001-X5001B-XD5001B	XD-5001B-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	02-06-2022
Q-1-PM-6104B	Q1-OSB-T6102-P6104B-PM6104B	PM-6104B-Reliable C/W calculation Pump	4M Motor Greasing	31-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole.2Hr	19-05-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	30-05-2022
Q-2-AT-21-1001	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	30-05-2022
Q-2-AT-21-1501	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	30-05-2022
Q-2-AT-21-1502	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	30-05-2022
Q-2-AT-21-1801	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect, clean and Calb AYZ GC	30-05-2022
Q-2-AT-23-1701	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	30-05-2022
Q-2-AT-23-1901	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	30-05-2022
Q-3-Z-9901	Q3-OSB-Z-9901	EMER.GEN. BATTERY STARTER	1Y-PM Air com&Engine.14Hr	12-05-2022
Q-1-T-6101-4	Q1-OSB-T6101-T61014	T-6101-4-Cooling Tower No.4	1Y-Replace oil gear box(>6<)->inspection	02-06-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-2-AT-22-2631	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	(1Y) Inspect, replace filter/part of VOC	30-05-2022
Q-2-AT-51-5101A	Q2-OSB-5150	Instrument Air and Plant Air Systems	(6M) Inspect & validate AYZ DEW	30-05-2022
Q-2-AT-51-5101B	Q2-OSB-5150	Instrument Air and Plant Air Systems	(6M) Inspect & validate AYZ DEW	30-05-2022
Q-1-P-1208B	Q1-OC-D-1205-P1208B	P-1208B-Decanter Pumps	8M-Replace lube oil.2Hr	02-06-2022
Q-2-P-6653	Q2-OSB-6650	Steam System and Condensate system	(6M) Re-Lubricant 2H	13-05-2022
Q-2-P-6657A	Q2-OSB-6650	Steam System and Condensate system	(6M) Re-Lubricant 2H	31-05-2022
Q-2-P-6657B	Q2-OSB-6650	Steam System and Condensate system	(6M) Re-Lubricant 2H	31-05-2022
Q-2-P-6658A	Q2-OSB-6650	Steam System and Condensate system	(6M) Re-Lubricant 2H	31-05-2022
Q-2-P-6658B	Q2-OSB-6650	Steam System and Condensate system	(6M) Re-Lubricant 2H	31-05-2022
Q-3-L-1603	Q3-ISB-L-1603	BPA PRODUCT CONVEYOR 2	RCM 1M PM Bucket conveyor.2.5Hr	02-06-2022
Q-3-L-1601	Q3-ISB-L-1601	1ST PRODUCT CONVEYOR	RCM 3M-PM Bucket conveyor.5Hr	02-06-2022

39 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Bell Inspection	02-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Bell Inspection	02-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Bell Inspection	02-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	02-08-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	02-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	02-06-2022
Q-2-PT-23-1002	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PT-23-1008	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PT-23-1011	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PT-23-1101	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PT-23-1202	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PT-23-1301	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PT-23-1401	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PXT-23-1001	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-2-PXT-23-1201	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Press Trans	23-05-2022
Q-1-PM-1401B	Q1-FRC-TK1401A-P1401B-PM1401B	PM-1401B-Crude Acelone Colm Charge P	4M Motor Greasing	31-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	19-05-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	19-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	19-05-2022
Q-1-OSB-PYL-PIP-IA	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	19-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	19-05-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Visual Inspection	19-05-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	19-05-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	19-05-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	19-05-2022
Q-1-OSB-PYL-PIP-IA	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	19-05-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	19-05-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	19-05-2022
Q-2-PSV-25-0401B	Q2-FRC-2500	Phenol Recovery Section	(2Y) Calibration test	17-05-2022
Q-3-L-1605	Q3-ISB-L-1605	BPA SHIPPING CONVEYOR	RCM 1M PM Bucket conveyor.2.5Hr	02-06-2022
Q-3-C-9401	Q3-OSB-TK-9402-C-9401	REFRIGERATION COMPRESSOR	RCM 1M Oil analysis.1Hr	02-06-2022
Q-1-P-9104A	Q1-OSB-X9103-P9104A	P-9104A-CONTAMINATED WATER PUMP	1M Clean water flushing strainer	02-06-2022
Q-1-P-9103A	Q1-OSB-X9103-P9103A	P-9103A-First 20 MinuteFlushWaterPi(Pump	1M Clean water flushing strainer	02-06-2022
Q-1-TT-41-0502	Q1-OSB-TK4106-TT410502	TT410502-TK-4106 Temp	4Y Calibration (1 Man / 3 Hr.)	18-05-2022
Q-1-TT-41-0202	Q1-OSB-TK4102B-TT410202	TT410202-TK-4102B Temp	4Y Calibration (1 Man / 3 Hr.)	18-05-2022
Q-1-TT-41-0201	Q1-OSB-TK4102A-TT410201	TT410201-TK-4102A Temp	4Y Calibration (1 Man / 3 Hr.)	18-05-2022
Q-1-TT-41-0103	Q1-OSB-TK4101A-TT410103	TT410103-TK-4101A,B inlet	4Y Calibration (1 Man / 3 Hr.)	18-05-2022
Q-1-P-6201B	Q1-OSB00-TK6201-P6201B	P-6201B-Chilled Water Transfer Pumps	1Y-Replace lube oil.2Hr	02-06-2022
Q-1-AT-12-1001	Q1-OC-D-OX1201-AT121001	AT121001-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	30-05-2022
Q-1-AT-12-1002	Q1-OC-D-OX1201-AT121002	AT121002-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	30-05-2022
Q-1-AT-12-1401	Q1-OC-D-OX1202-AT121401	AT121401-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	30-05-2022
Q-1-AT-12-1402	Q1-OC-D-OX1202-AT121402	AT121402-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	30-05-2022
Q-1-FI-69-1801	Q1-OSB-X6901-FI691801	FI691801-Fire Water to X-6901	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-1-PSL-69-1908	Q1-OSB-X6901-P6901C-PSL691908	PSL691908-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022

39 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PSL-69-1907	Q1-OSB-X6901-P6901B-PSL691907	PSL691907-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1904	Q1-OSB-X6901-P6901C-XY691904	XY691904-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1903	Q1-OSB-X6901-P6901B-XY691903	XY691903-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1902	Q1-OSB-X6901P6901C-PD1C-XY1902	XY691902-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1901	Q1-OSB-X6901P6901B-PD1B-XY1901	XY691901-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1801	Q1-OSB-X6901P6901A-PE1A-XY1801	XY691801-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1703	Q1-OSB-X6901-P6902B-XY691703	XY691703-Raw water to Jockey P	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1702	Q1-OSB-X6901P6902B-PD2B-XY1702	XY691702-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	23-05-2022
Q-1-XY-69-1701	Q1-OSB-X6901P6902A-PE2A-XY1701	XY691701-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-1-XSH-69-1902	Q1-OSB-X6901-P6901C-XSH691902	XSH691902-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-1-XSH-69-1901	Q1-OSB-X6901-P6901B-XSH691901	XSH691901-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-1-PSL-69-1908	Q1-OSB-X6901-P6901C-PSL691908	PSL691908-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-1-PSL-69-1907	Q1-OSB-X6901-P6901B-PSL691907	PSL691907-Fire Water P Sys	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-1-FI-69-1801	Q1-OSB-X6901-FI691801	FI691801-Fire Water to X-6901	1Y Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-1-PM-4104B	Q1-OSB-TK4104-P4104B-PM4104B	PM-4104B-Cum Storage Pump	4M Motor Greasing	31-05-2022
Q-3-C-1501	Q3-ISB-D-1501-Z-1551-C-1501	PRILL TOWER COOLING N2 BLOWER	3M-Replace lube oil.2Hr	02-06-2022
Q-1-AT-15-0701	Q1-FRC-V1502-AT150701	AT150701-Oil Extrac Colm Blm	(4M) clean and Calb AYZ PH	30-05-2022
Q-1-AT-15-0201	Q1-FRC-V1501-AT150201	AT150201-Cum-AMS Caustic Wash Colm Blm	(4M) clean and Calb AYZ PH	30-05-2022
Q-1-AT-12-0502	Q1-OC-D-1201-AT120502	AT120502-Feed Wash Colm Drain	(4M) clean and Calb AYZ PH	30-05-2022
Q-1-AT-15-0702	Q1-FRC-D1506-AT150702	AT150702-Total Feed to Oil Extrac Colm	(4M) clean and Calb AYZ PH	30-05-2022
Q-1-AT-15-0501	Q1-FRC-D1503-P1506A-AT150501	AT150501-PRU Recy	(4M) clean and Calb AYZ PH	30-05-2022
Q-1-XD-5001A	Q1-OSB-X5001-X5001A-XD5001A	XD-5001A-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	02-06-2022
Q-1-PM-4103B	Q1-OSB-TK4103A-P4103B-PM4103B	PM-4103B-Cum Rundown Pump	4M Motor Greasing	31-05-2022
Q-1-PM-1403B	Q1-FRC-D1401-P1403B-PM1403B	PM-1403B-Crude Acetone Colm Overhead P	4M Motor Greasing	31-05-2022
Q-1-PM-1402B	Q1-FRC-V1401-P1402B-PM1402B	PM-1402B-Crude Acetone Colm Bottoms P	4M Motor Greasing	31-05-2022
Q-1-PM-6301A	Q1-OSB-TK6301-P6301A-PM6301A	PM-6301A-Tempered Water Cir Pump	4M Motor Greasing	31-05-2022
Q-1-FA-00-0001	Q1-OSB-FA000001	FA000001-Fire alarm	6M Inspec and Function Test (1 Man/4 Hr)	30-05-2022
Q-2-AXT-22-1001	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	(1M) Inspec, Clean Filter & Cal AYZ O2	30-05-2022
Q-2-AXT-22-1002	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	(1M) Inspec, Clean Filter & Cal AYZ O2	30-05-2022
Q-2-AXT-22-1401	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	(1M) Inspec, Clean Filter & Cal AYZ O2	30-05-2022
Q-2-AXT-22-1402	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	(1M) Inspec, Clean Filter & Cal AYZ O2	30-05-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-3-P-1971	Q3-ISB-TK-1971-P-1971	PHENOL DRAIN PUMP	1M-PM Vertical Pump.2Hr	02-06-2022
Q-3-P-1974	Q3-ISB-TK-1974-P-1974	ACETONE DRAIN PUMP (ISBL)	1M-PM Vertical Pump.2Hr	02-06-2022
Q-3-EDG-001	Q3-OSB-Z-9901-EDG-001	400/230V 1250KVA EMER DIESEL GENERATOR	2Y PM EDG (Replace Battery)	19-05-2022
Q-3-P-1978	Q3-ISB-TK-1978-P-1978	ACETONE DRAIN PUMP (TANKAGE AREA)	1M-PM Vertical Pump.2Hr	02-06-2022
Q-3-P-1972	Q3-ISB-TK-1972-P-1972	ACETONE DRAIN PUMP	1M-PM Vertical Pump.2Hr	02-06-2022
Q-1-P-6603B	Q1-OSB00-TK6601-P6603B	P-6603B-HighHeadCondensateTransferPump	1Y-Replace lube oil.2Hr	02-06-2022
Q-1-P-1501B	Q1-FRC00-TK1501-P1501B	P-1501B-Phenolic Waste water Pumps	1Y-Replace lube oil.2Hr	02-06-2022
Q-2-P-2213A	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	6M Vibration Monitoring	20-05-2022
Q-1-P-9119B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M-Re-Lubricant 2H	02-06-2022
Q-2-P-2213B	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2215	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	6M Vibration Monitoring	20-05-2022

37 of 38

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-P-6103B	Q1-OSB-T6101-P6103B	P-6103B-HiPressCoolWaterCirculatPump	1Y-Replace lube oil.2Hr	02-06-2022
Q-2-P-4103C	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant 2H	20-05-2022
Q-2-P-4109C	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant 2H	20-05-2022
Q-2-P-4110A	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant 2H	20-05-2022
Q-1-P-4106	Q1-OSB-TK4106-P4106	P-4106-HeavyAromaticsTruckLoadingPump	8M-Replace lube oil.2Hr	02-06-2022
Q-1-P-6402	Q1-OSB00-TK6401-P6402	P-6402-Process Water Emergency Pump	8M-Replace lube oil.2Hr	02-06-2022
Q-2-P-9104E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	31-05-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	6M Vibration Monitoring	02-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	6M Vibration Monitoring	02-06-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	3M - PM 8HR (STOP MACHINE)	02-06-2022
Q-2-P-4163A	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant	20-05-2022
Q-2-P-4162C	Q2-OSB-4100	Tank Gauging System	(6M) Re-Lubricant	20-05-2022
Q-2-P-2410A	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	20-05-2022
Q-2-P-2411A	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	20-05-2022
Q-2-P-2415A	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	20-05-2022
Q-2-P-2416A	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	20-05-2022
Q-2-P-2422A	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	20-05-2022
Q-2-P-2423A	Q2-FRC-2400	Fractionation unit	6M Vibration Monitoring	20-05-2022
Q-2-P-2501A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2502A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2503A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2504A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2505A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2506A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2507A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-2-P-2511A	Q2-FRC-2500	Phenol Recovery Section	6M Vibration Monitoring	20-05-2022
Q-1-P-9111A	Q1-OSB-TK9111-P9111A	P-9111A-BUFFER STORAGE PUMP	8M-Replace lube oil.2Hr	02-06-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(3Y)- OVERHUAL GEAR REDUCER	02-06-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(6M)- CHANGE BEARING ROLLER (1-14)	27-05-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(6M)- CHANGE BEARING ROLLER (29 -42)	30-05-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(6M)- CHANGE BEARING ROLLER (15 -28)	27-05-2022
Q-1-AT-91-1303	Q1-OSB-TK9141-AT911303	AT911303-TK-9141 pH Measurement	(4M) clean and Calb AYZ PH	20-05-2022
Q-1-P-1502A	Q1-FRC00-TK1502-P1502A	P-1502A-Sodium Phenale Pumps	8M-Replace lube oil.2Hr	02-06-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFLUENT DISTRIBUTION SYSTEM	(1M) clean and Calb COD AYZ	30-05-2022
Q-1-P-4110A	Q1-OSB-TK4110-P4110A	P-4110A-ConcentrateSulphuricAcidFeedPump	4M- Replace lube oil.2Hr	20-05-2022
Q-2-P-2601B	Q2-FRC-2600	HUEL MSHP Process Unit	(6M) Re-Lubricant 2H	31-05-2022
Q-2-P-2513	Q2-FRC-2500	Phenol Recovery Section	(2Y) Check Relief valve	20-05-2022
Q-2-P-2514A	Q2-FRC-2500	Phenol Recovery Section	(2Y) Check Relief valve	20-05-2022
Q-2-P-2514B	Q2-FRC-2500	Phenol Recovery Section	(2Y) Check Relief valve	20-05-2022
Q-2-P-2117B	Q2-OC-D-2100	Phenol II Oxidation Q-Max Area	(6M) Re-Lubricant	31-05-2022
Q-3-VSD-Z-9301A	Q3-OSBZ9301A-ZM9301AVSD-Z9301A	400/230V VSD PANEL FOR Z-9301A	2Y PM VSD unit	20-05-2022
Q-3-VSD-Z-9301B	Q3-OSBZ9301B-ZM9301BVSD-Z9301B	400/230V VSD PANEL FOR Z-9301B	2Y PM VSD unit	20-05-2022
Q-3-VSD-Z-9301C	Q3-OSBZ9301C-ZM9301CVSD-Z9301C	400/230V VSD PANEL FOR Z-9301C	2Y PM VSD unit	20-05-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspec carrier Reagent&Consumable	30-05-2022

38 of 38



Equipment	Functional Loc	Description	Description	Sched. start
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	30-05-2022
Q-1-P-1116B	Q1-QMX-D1109-P1116B	P-1116B-DIPB COLUMN VACUUM PUMPS	2M-Greasing,1Hr	02-06-2022
Q-1-CM-1201	Q1-OC-D-1201-STC1201-CM1201	CM-1201-Oxidizer air Comp	RCM-(3M)PM MOTOR AND INSPECTION	31-05-2022
Q-1-AT-91-1304	Q1-OSB-TK9141-AT911304	AT911304-TK9141 Conductivity Measurement	(2M) clean and Calb AYZ Con (FF)	30-05-2022
Q-2-P-2513	Q2-FRC-2500	Phenol Recovery Section	(1Y) Replace oil at power end and liquid	31-05-2022
Q-2-P-2514A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Replace oil at power end and liquid	31-05-2022
Q-2-P-2514B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Replace oil at power end and liquid	20-05-2022
Q-2-P-6659A	Q2-OSB-6650	Steam System and Condensate system	(6M) Re-Lubricant 2H	31-05-2022
Q-2-P-6659B	Q2-OSB-6650	Steam System and Condensate system	(6M) Re-Lubricant 2H	31-05-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	02-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	02-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	02-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	02-06-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	02-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	02-06-2022
Q-2-TDT-23-1806	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	24-05-2022
Q-2-TDT-23-1809	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-0505	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-0601	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-0703	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-0802	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-0803	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-0808	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-0809	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-2-TT-23-1001	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	23-05-2022
Q-3-RV-1601A	Q3-ISB-L1604TK1601A-RV-1601A	BPA PRODUCT SILO EXIT ROTARY VALVE A	2M-Grease up,1 Hr	02-06-2022
Q-3-RV-1601C	Q3-ISB-L1603TK1601CRV-1601C	BPA PRODUCT SILO EXIT ROTARY VALVE C	2M-Grease up,1 Hr	02-06-2022
Q-3-RV-1601B	Q3-ISB-L1604TK1601B-RV-1601B	BPA PRODUCT SILO EXIT ROTARY VALVE B	2M-Grease up,1 Hr	02-06-2022
Q-1-P-1208B	Q1-OC-D-1205-P1208B	P-1208B-Decanter Pumps	8M-Replace lube oil,2Hr	02-06-2022
Q-1-P-1207A	Q1-OC-D-OX1202-P1207A	P-1207A-Oxidizer No 2 Pumps	4M- Replace lube oil 2Hr	01-07-2022
Q-2-EDG-G-5052	Q2-OSB	Phenol II Outside Battery	RCM-(2Y) INSPECTION AND TEST FUEL NOZZLE	16-06-2022
Q-2-EDG-G-5051	Q2-OSB	Phenol II Outside Battery	RCM-(2Y) INSPECTION AND TEST FUEL NOZZLE	16-06-2022
Q-3-EDG-001	Q3-OSB-Z-9901-EDG-001	400/230V 1250KVA EMER DIESEL GENERATOR	RCM-(1Y) PM EMERGENCY DIESEL GENERATOR	23-05-2022
Q-3-EDG-001	Q3-OSB-Z-9901-EDG-001	400/230V 1250KVA EMER DIESEL GENERATOR	RCM-(2Y) INSPECTION AND TEST FUEL NOZZLE	03-05-2022
Q-1-P-4101C	Q1-OSB-TK4101A-P4101C	P-4101C-Propylene Feed Pumps	8M-Replace lube oil,2Hr	02-06-2022
Q-1-P-1206	Q1-OC-D-OX1201-P1206	P-1206-Oxidizer No 1 Pump	4M- Replace lube oil,2Hr	01-07-2022
Q-3-Z-9401	Q3-OSB-TK-9402-Z-9401	REFRIGERATE PACKAGE	(6M) PM Refrigerator	17-12-2021
Q-1-P-1301B	Q1-OC-D-V1302-P1301B	P-1301B-Flash Column Bottoms Pumps	4M- Replace lube oil,2Hr	29-06-2022
Q-2-P-2401A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant 2H	23-05-2022
Q-1-P-1301B	Q1-OC-D-V1302-P1301B	P-1301B-Flash Column Bottoms Pumps	6M(Online)- Replace Lube Oil, 2Hr	29-06-2022
Q-1-P-1207A	Q1-OC-D-OX1202-P1207A	P-1207A-Oxidizer No 2 Pumps	4M- Replace lube oil,2Hr	01-07-2022
Q-1-P-1201A	Q1-OC-D-TK1201-P1201A	P-1201A-Fresh Feed Pumps	8M-Replace lube oil,2Hr	02-06-2022
Q-1-P-6102A	Q1-OSB-T6101-P6102A	P-6102A-Cooling Water Circulating Pumps	8M-Replace lube oil,2Hr	02-06-2022
Q-1-P-1210A	Q1-OC-D-1205-P1210A	P-1210A-Decanter/VentScrubberWater Pump	8M-Replace lube oil,2Hr	02-06-2022

39 of 88

Equipment	Functional Loc	Description	Description	Sched. start
Q-1-P-1206	Q1-OC-D-OX1201-P1206	P-1206-Oxidizer No 1 Pump	4M- Replace lube oil,2Hr	01-07-2022
Q-1-P-1301B	Q1-OC-D-V1302-P1301B	P-1301B-Flash Column Bottoms Pumps	6M(Online)- Replace Lube Oil, 2Hr	29-06-2022
Q-2-P-2431A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	31-05-2022
Q-2-P-2431B	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	31-05-2022
Q-2-P-2432A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	31-05-2022
Q-1-PM-6102A	Q1-OSB-T6101-P6102A-PM6102A	PM-6102A-C/W Cir Pump	4M Motor Greasing	31-05-2022
Q-1-TT-41-0102C	Q1-OSB-TK4101B-TT410102C	TT410102C-TK-4101B Temp	4Y Calibration (1 Man / 3 Hr.)	23-05-2022
Q-1-TT-41-0102B	Q1-OSB-TK4101B-TT410102B	TT410102B-TK-4101B Temp	4Y Calibration (1 Man / 3 Hr.)	23-05-2022
Q-1-TT-41-0102A	Q1-OSB-TK4101B-TT410102A	TT410102A-TK-4101B Temp	4Y Calibration (1 Man / 3 Hr.)	23-05-2022
Q-1-TT-41-0101C	Q1-OSB-TK4101A-TT410101C	TT410101C-TK-4101A Temp	4Y Calibration (1 Man / 3 Hr.)	23-05-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine,1.5.Hr	02-06-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine,1.5.Hr	02-06-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	1M-PM Bagging Machine,1.5.Hr	02-06-2022
Q-1-AT-66-0401	Q1-OSB00-D6605-AT660401	AT660401-D-6605	(2Y) Replac sample pump & Filter TOC AYZ	31-05-2022
Q-1-AT-66-0401	Q1-OSB00-D6605-AT660401	AT660401-D-6605	(3M) Inspect and Calb AYZ TOC 2H	31-05-2022
Q-1-AT-66-0401	Q1-OSB00-D6605-AT660401	AT660401-D-6605	(6M) Replac repair kilns and Calb AYZ TOC	31-05-2022
Q-1-AT-66-0401	Q1-OSB00-D6605-AT660401	AT660401-D-6605	(3Y) Replace acid&base pump & O2 TOC AYZ	31-05-2022
Q-3-Z-1602	Q3-ISB-L-1605-Z-1601-Z-1602	METAL DETECTOR	3Y Calibration (2 Man / 3 Hr.)	23-05-2022
Q-3-AT-1912	Q3-ISB-TK-1910-P-1910A-AT-1912	TK-1910 OUTLET SCR TOC	1M PM Analyzer TOC	31-05-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	1M PM Analyzer COD	31-05-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(1M) Inspection & Cleaning	31-05-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	24-05-2022
Q-1-C-6201	Q1-OSB-X6201-C6201	C-6201-COMPRESSOR	1M-Check N2 & Rotate Shaft spare C-6201	02-06-2022
Q-1-P-4130B	Q1-OSB	Phenol I - Outside Battery	6M-Re-Lubricant 2H	02-06-2022
Q-2-AT-63-5101	Q2-OSB-6350	Tempered Water System	(1M) Inspect, clean and Calb AYZ Hydr	31-05-2022
Q-2-AT-61-5101	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	31-05-2022
Q-1-PM-1110B	Q1-QMX-V1103-P1110B-PM1110B	PM-1110B-DIPB Colm Bottoms Pump	4M Motor Greasing	31-05-2022
Q-1-PM-1410B	Q1-FRC-V1404-P1410B-PM1410B	PM-1410B-Residue Stripper Bottoms Pump	4M Motor Greasing	31-05-2022
Q-1-PM-1409B	Q1-FRC-D1405-P1409B-PM1409B	PM-1409B-Cum-AMS Colm Overhead Water P	4M Motor Greasing	31-05-2022
Q-1-PM-1505B	Q1-FRC-V1501-P1505B-PM1505B	PM-1505B-Spent Caustic Cir Pump	4M Motor Greasing	31-05-2022
Q-1-PM-1505A	Q1-FRC-V1501-P1505A-PM1505A	PM-1505A-Spent Caustic Cir Pump	4M Motor Greasing	31-05-2022
Q-1-P-4110B	Q1-OSB-TK4110-P4110B	P-4110B-ConcentrateSulphuricAcidFeedPump	4M- Replace lube oil,2Hr	02-06-2022
Q-1-PM-1406A	Q1-FRC-D1405-P1406A-PM1406A	PM-1406A-Chem Treatment, Reac Effluent P	4M Motor Greasing	31-05-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole,2Hr	25-05-2022
Q-2-AT-66-5301	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	31-05-2022
Q-2-AT-66-5401	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	31-05-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	02-06-2022
Q-3-Z-9219	Q3-OSB-Z-9200-Z-9219	SLUDE DEWATERING	2M-PM Bolt press,4Hr	02-06-2022
Q-3-P-1904	Q3-ISB-TK-1904-P-1904	DRAIN RECEIVER PUMP	1M-PM Vertical Pump,2Hr	02-06-2022
Q-3-P-1809	Q3-ISB-TK-1805-P-1809	TAR DRAIN RECEIVER PUMP	1M-PM Vertical Pump,2Hr	02-06-2022
Q-3-P-1875	Q3-ISB-TK-1875-P-1875	TAR DRAIN RECEIVER PUMP (TANKAGE AREA)	1M-PM Vertical Pump,2Hr	02-06-2022
Q-1-CM-6201	Q1-OSB-X6201-C6201-CM6201	CM-6201-Refrigerator Package Comp	RCM-(3M) PM MOTOR AND INSPECTION	31-05-2022
Q-3-RV-1502	Q3-ISB-D-1501-Z-1551-RV-1502	RV-1502 ROTARY VALVE	2M-Grease up,1 Hr	02-06-2022

60 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-RV-1503	Q3-ISB-D-1501-Z-1501-RV-1503	RV-1503 FEED ROTARY VALVE	2M-Grease up.1 Hr	02-06-2022
Q-3-SW-C-1301	Q3-ISB-C-1301-CM-1301-SW-C1301	6.6KV MOTER FEEDER SW-5003-L107/ C-1301	2Y PM MV switchgear feeder	27-05-2022
Q-3-SW-P-1301A	Q3-ISBQ01E03A-P1301A-SW-P1301A	6.6KV MOTER FEEDER SW-5003-L110/ P-1301A	2Y PM MV switchgear feeder	27-05-2022
Q-3-SW-P-1301B	Q3-ISBQ01E03B-P1301B-SW-P1301B	6.6KV MOTER FEEDER SW-5003-L120/ P-1301B	2Y PM MV switchgear feeder	27-05-2022
Q-3-SW-P-1303	Q3-ISBQ02E04P03PM1303-SW-P1303	6.6KV MOTER FEEDER SW-5003-L109/ P-1303	2Y PM MV switchgear feeder	27-05-2022
Q-3-SW-P-1307A	Q3-ISBQ03E06A-P1307A-SW-P1307A	6.6KV MOTER FEEDER SW-5003-L108/ P-1307A	2Y PM MV switchgear feeder	27-05-2022
Q-3-SW-P-1307B	Q3-ISBQ03E06B-P1307B-SW-P1307B	6.6KV MOTER FEEDER SW-5003-L121/ P-1307B	2Y PM MV switchgear feeder	27-05-2022
Q-3-SW-P-1309	Q3-ISBQ04E07P09PM1309-SW-P1309	6.6KV MOTER FEEDER SW-5003-L122/ P-1309	2Y PM MV switchgear feeder	27-05-2022
Q-3-AT-1871	Q3-ISB-TK-1871-Z-1871-AT-1871	Z-1871 OUTLET 20% CAUSTIC DENSITY	(3M) PM Analyzer Density	31-05-2022
Q-3-SW-C-1301	Q3-ISB-C-1301-CM-1301-SW-C1301	6.6KV MOTER FEEDER SW-5003-L107/ C-1301	RCM (3.5Y) HV,MV SWITCHGEAR INSPECTION	27-05-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	02-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	02-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	02-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	02-06-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	02-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	02-06-2022
Q-2-TT-23-1302	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1303	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1401	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1403	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1404	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1701	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1702	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1703	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1704	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-2-TT-23-1705	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	30-05-2022
Q-1-PM-1206	Q1-OCD-0X1201-P1206-PM1206	PM-1206-Oxidizer no.1 Pump	4M Motor Greasing	31-05-2022
Q-2-P-2430	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	31-05-2022
Q-2-P-2419A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	30-05-2022
Q-3-P-9218	Q3-OSB-Z-9200-TK-9203-P-9218	EFFLUENT WATER REUSE PUMP	6M Vibration Monitoring	30-05-2022
Q-3-Z-1912	Q3-ISB-TK-1910-TK-1918-Z-1912	3LS DESUPERHEATER	6M Vibration Monitoring	30-05-2022
Q-3-P-9220A	Q3-OSB-Z-9200-TK-9202A-P-9220A	SBR SLUDGE PUMP	6M Vibration Monitoring	30-05-2022
Q-3-P-9225A	Q3-OSB-Z-9200-TK-9208-P-9225A	UREA DOSING PUMP	6M Vibration Monitoring	30-05-2022
Q-3-P-9223A	Q3-OSB-Z-9200-TK-9206-P-9223A	HCL DOSING PUMP	6M Vibration Monitoring	30-05-2022
Q-3-P-9226A	Q3-OSB-Z-9200-TK-9209-P-9226A	H3PO4 DOSING PUMP CATALYST WASHING WATER	6M Vibration Monitoring	30-05-2022
Q-3-P-9214A	Q3-OSB-Z-9200-Z-9218-P-9214A	PE DOSING PUMP	6M Vibration Monitoring	30-05-2022
Q-3-TR-5001	Q3-OSB-TR-5001	22KV/6.9KV 12.5MVA MAIN PWR TRANSFORMER	RCM-6M THERMO SCAN	30-05-2022
Q-3-TR-5002	Q3-OSB-TR-5002	22KV/6.9KV 12.5MVA MAIN PWR TRANSFORMER	RCM-6M THERMO SCAN	30-05-2022
Q-3-TR-5003A	Q3-OSB-TR-5003A	6.9KV/400V DIST TRANSFORMER/MCC-5001B	RCM-6M THERMO SCAN	30-05-2022
Q-3-TR-5003B	Q3-OSB-TR-5003B	6.9KV/400V DIST TRANSFORMER/MCC-5001A	RCM-6M THERMO SCAN	30-05-2022
Q-3-TR-5003C	Q3-OSB-TR-5003C	6.9KV/400V DIST TRANSFORMER/MCC-5002A	RCM-6M THERMO SCAN	30-05-2022
Q-3-TR-5003D	Q3-OSB-TR-5003D	6.9KV/400V DIST TRANSFORMER/MCC-5002B	RCM-6M THERMO SCAN	30-05-2022
Q-1-TT-41-0101B	Q1-OSB-TK4101A-TT410101B	TT410101B-TK-4101A Temp	4Y Calibration (1 Man / 3 Hr.)	31-05-2022
Q-1-TT-41-0101A	Q1-OSB-TK4101A-TT410101A	TT410101A-TK-4101A Temp	4Y Calibration (1 Man / 3 Hr.)	31-05-2022

62 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-TT-16-0506	Q1-QMX-R1602-TT160506	TT160506-Hydro Reactor No.2 Lower Section	4Y Calibration (1 Man / 3 Hr.)	31-05-2022
Q-1-TT-16-0505	Q1-QMX-R1602-TT160505	TT160505-Hydro React No.2 Outlet	4Y Calibration (1 Man / 3 Hr.)	31-05-2022
Q-1-PM-9119B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	30-06-2022
Q-1-PM-9119C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	30-06-2022
Q-1-PM-9116B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	30-06-2022
Q-1-PM-9116C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	6M PM AC Motor (Visual Inspection)	30-06-2022
Q-1-AT-11-0601B	Q1-QMX-V1103-E1104-AT110601B	AT110601B-Feed to TransAlkyl Reac	(1M) Inspect and Clean Strainer	28-06-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	3M-Re-Lubricant 2H	27-06-2022
Q-1-PM-1601A	Q1-QMX-TK1601-P1601A-PM1601A	PM-1601A-Hydrogenation Charge Pump	2M Motor Greasing	29-06-2022
Q-1-PM-1103B	Q1-QMX-R1101-P1103B-PM1103B	PM-1103B-Alkylation Reac Recycle Pump	4M Motor Greasing	30-06-2022
Q-1-AT-11-0601A	Q1-QMX-R1101-AT110601A	AT110601A-Fd. to Alk. Reac Moist Content	(1M) Inspect and Clean Strainer	28-06-2022
Q-1-MOV-41-0503	Q1-OSB-TK4107-P4107-MOV410503	MOV410503-Resid Truck Loading ShutOff	6M Inspect and Clean MOV (FF) 2H	30-06-2022
Q-1-CM-9132D	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	4M Motor Greasing	30-06-2022
Q-1-PM-9119B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	4M Motor Greasing	30-06-2022
Q-1-PM-9119C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	4M Motor Greasing	30-06-2022
Q-1-CM-9132A	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	4M Motor Greasing	30-06-2022
Q-1-CM-9132B	Q1-OSB-X9134-C9132B-CM9132B	CM-9132B-SBR Blower	4M Motor Greasing	30-06-2022
Q-1-PM-9141E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-PM-9142C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-PM-9142D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-PM-9142E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-CM-9132E	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-PM-9158A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-PM-9158B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-PM-9165C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-PM-9164C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-XM-9116A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-XM-9116B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-XM-9117	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-XM-9119A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-XM-9119C	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-XM-9151A	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-CM-9132B	Q1-OSB-X9134-C9132B-CM9132B	CM-9132B-SBR Blower	1Y Motor Winding Insulation & Starter Un	30-06-2022
Q-1-P-1407A	Q1-FRC-V1403-P1407A	P-1407A-ChemicalTreatmentInjectionPump	6M Vibration Monitoring	01-07-2022
Q-1-P-1409A	Q1-FRC-D1405-P1409A	P-1409A-CumeneAMSColumnOverheadWaterPump	6M Vibration Monitoring	01-07-2022
Q-1-P-1422A	Q1-FRC-J1401-P1422A	P-1422A-EjectorVentScrubberBottomPump	6M Vibration Monitoring	01-07-2022
Q-1-P-6602A	Q1-OSB00-D6605-P6602A	P-6602A-Condensate Pumps	6M Vibration Monitoring	01-07-2022
Q-1-P-6603A	Q1-OSB00-TK6601-P6603A	P-6603A-HighHeadCondensateTransferPump	6M Vibration Monitoring	01-07-2022
Q-1-P-9101A	Q1-OSB-D9101-P9101A	P-9101A-Wastewater Treatment Sump Pump	6M Vibration Monitoring	01-07-2022
Q-1-P-9152A	Q1-OSB-TK9152-P9152A	P-9152A-ThickenedSludgePump (Rotary)	6M Vibration Monitoring	01-07-2022
Q-1-P-9153A	Q1-OSB-TK9153-P9153A	P-9153A-SLUDGE FEEDING PUMP (Rotary)	6M Vibration Monitoring	01-07-2022
Q-1-P-1105	Q1-QMX-V1101-P1105	P-1105-Benzene Recycle Wash Pump	6M Vibration Monitoring	01-07-2022
Q-1-PM-6102C	Q1-OSB-T6101-P6102C-PM6102C	PM-6102C-C/W Cir Pump	Motor Greasing	29-06-2022
Q-1-PM-6102B	Q1-OSB-T6101-P6102B-PM6102B	PM-6102B-C/W Cir Pump	Motor Greasing	29-06-2022

62 of 88



Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-CM-9132A	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	Motor Greasing	29-06-2022
Q-1-CM-9132B	Q1-OSB-X9134-C9132B-CM9132B	CM-9132B-SBR Blower	Motor Greasing	29-06-2022
Q-1-CM-9132D	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	Motor Greasing	29-06-2022
Q-1-PM-6102A	Q1-OSB-T6101-P6102A-PM6102A	PM-6102A-C/W Cir Pump	Motor Greasing	29-06-2022
Q-1-PM-6103A	Q1-OSB-T6101-P6103A-PM6103A	PM-6103A-HP C/W Cir Pump	Motor Greasing	29-06-2022
Q-1-PM-6103C	Q1-OSB-T6101-P6103C-PM6103C	PM-6103C-HP C/W Cir Pump	Motor Greasing	29-06-2022
Q-1-TR-5001A	Q1-OSB-SWJ105-SWJ104-TR5001A	TR-5001A-Transformer 5001A	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5001B	Q1-OSB-SWJ105-SWJ103-TR5001B	TR-5001B-Transformer 5001B	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5001C	Q1-OSB-SWJ105-SWJ102-TR5001C	TR-5001C-Transformer 5001C	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5001D	Q1-OSB-SWJ105-SWJ101-TR5001D	TR-5001D-Transformer 5001D	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5002A	Q1-OSB-SWL112-SWL111-TR5002A	TR-5002A-Transformer 5002A	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5002B	Q1-OSB-SWL11600-SWL117-TR5002B	TR-5002B-Transformer 5002B	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5002C	Q1-OSB-SWL112-SWL109-TR5002C	TR-5002C-Transformer 5002C	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5002D	Q1-OSB-SWL11600-SWL119-TR5002D	TR-5002D-Transformer 5002D	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5003A	Q1-OSB-SWL112-SWL110-TR5003A	TR-5003A-Transformer 5003A	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5003B	Q1-OSB-SWL11600-SWL118-TR5003B	TR-5003B-Transformer 5003B	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5003C	Q1-OSB-SWL206-SWL205-TR5003C	TR-5003C-Transformer 5003C	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5003D	Q1-OSB-SWL210-SWL212-TR5003D	TR-5003D-Transformer 5003D	RCM-3M INSPECTION	30-06-2022
Q-1-TR-5004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-3M INSPECTION	30-06-2022
Q-1-AP-5001	Q1-OSB-5004MCCAP5001B2-AP51	AP-5001-UPS Cfor Control @ CCR	RCM-6M CHANGE AIR FILTER	30-06-2022
Q-1-AP-5002	Q1-OSB-5004MCCAP5002B-AP52	AP-5002-UPS for Swgr Control @ Main S/S	RCM-6M CHANGE AIR FILTER	30-06-2022
Q-1-AP-5003	Q1-OSB-5004MCCAP5003B-AP53	AP-5003-DC Charger for Emer Light @ S/S	RCM-6M CHANGE AIR FILTER	30-06-2022
Q-1-X-9157B	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-07-2022
	Q1	Phenol I	1M-Equipment Site Patrol	23-06-2022
Q-2-T-6151A	Q2-OSB-6150	Phenol Recovery Section	1Y-Replace oil gear box&inspection	17-06-2022
Q-2-T-6151B	Q2-OSB-6150	Phenol Recovery Section	1Y-Replace oil gear box<(>=<=>)>inspection	17-06-2022
Q-2-T-6152A	Q2-OSB-6150	Phenol Recovery Section	1Y-Replace oil gear box&inspection	17-06-2022
Q-2-T-6152B	Q2-OSB-6150	Phenol Recovery Section	1Y-Replace oil gear box&inspection	17-06-2022
Q-2-X-2051	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	(1M) PM Oil Mist	16-06-2022
Q-2-X-2052	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(1M) PM Oil Mist	16-06-2022
Q-2-X-2053	Q2-OSB-6150	Phenol Recovery Section	(1M) PM Oil Mist	16-06-2022
Q-2-WR-2501	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection cleaning re-lighten	29-06-2022
Q-2-TT-23-1706	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TT-23-1805	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TT-23-1807	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TT-23-1808	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TT-23-1810	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TT-23-1901	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TXT-23-0404	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TXT-23-0501	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TXT-23-0502A	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-TXT-23-0502B	Q2-OSB-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func,Test Temp Trans	16-06-2022
Q-2-PM-2416A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-06-2022
Q-2-PM-2502A	Q2-FRC-2500	Phenol Recovery Section	Motor Greasing	29-06-2022

88 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-PM-6352A	Q2-OSB-6350	Tempered Water System	Motor Greasing	29-06-2022
Q-2-TM-6152C	Q2-OSB-6150	Phenol Recovery Section	Motor Greasing	29-06-2022
Q-2-PM-2104A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	29-06-2022
Q-2-PM-2112A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	29-06-2022
Q-2-PM-2203A	Q2-OSB-2200	Phenol II Oxidation Oxidation Section	Motor Greasing	29-06-2022
Q-2-PM-2307A	Q2-OSB-2300	Phenol II Oxidation CDN Section	Motor Greasing	29-06-2022
Q-2-PM-2401A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-06-2022
Q-2-PM-2404A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-06-2022
Q-2-PM-2408A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-06-2022
Q-2-PM-4152A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	29-06-2022
Q-2-PM-6652A	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	29-06-2022
Q-2-PM-6656A	Q2-OSB-6650	Steam System and Condensate system	Motor Greasing	29-06-2022
Q-2-PM-2116A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	Motor Greasing	29-06-2022
Q-2-PM-2316A	Q2-OSB-2300	Phenol II Oxidation CDN Section	Motor Greasing	29-06-2022
Q-2-PM-2433A	Q2-FRC-2400	Fractionation unit	Motor Greasing	29-06-2022
Q-2-PM-4104A	Q2-OSB-4100	Tank Gauging System	Motor Greasing	29-06-2022
Q-2-PM-6051	Q2-OSB-6000	Clarified Water System	Motor Greasing	29-06-2022
Q-2-PM-6351A	Q2-OSB-6350	Tempered Water System	Motor Greasing	29-06-2022
Q-2-TR-5054A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5054B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5055A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5055B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5056A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5056B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5053A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5053B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5052A	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-TR-5052B	Q2-OSB-5050	Electricity Distribution and Control	RCM-3M INSPECTION	29-06-2022
Q-2-AP-5055-01A	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M CHANGE AIR FILTER	29-06-2022
Q-2-AP-5055-01B	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M CHANGE AIR FILTER	29-06-2022
Q-2-AP-5055-02	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M CHANGE AIR FILTER	29-06-2022
Q-2-AP-5055-03	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M CHANGE AIR FILTER	29-06-2022
Q-2-AP-5055-04	Q2-OSB-5050	Electricity Distribution and Control	RCM-6M CHANGE AIR FILTER	29-06-2022
	Q2	Phenol II	1M-Equipment Site Patrol	23-06-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(1M) Archive HIST Data and Config. to CD	06-06-2022
Q-3-S-1301	Q3-ISB-S-1301	1ST SEPARATOR	1M-PM Separator.4Hr	02-06-2022
Q-3-S-1302	Q3-ISB-S-1302	2ND SEPARATOR	1M-PM Separator.4Hr	02-06-2022
Q-3-Z-1301	Q3-ISB-1300	PURIFICATION	(6M) PM Oil Mist	02-06-2022
Q-3-P-9401B	Q3-OSB-TK-9401-P-9401B	DEMINEALIZED WATER PUMP B	1Y- Replace Lube Oil .2Hr	02-06-2022
Q-3-P-9402B	Q3-OSB-TK-9402-P-9402B	CHILLED WATER TRANSFER PUMP B	1Y- Replace Lube Oil .2Hr	02-06-2022
Q-3-Z-1301	Q3-ISB-1300	PURIFICATION	1M-PM Oil Mist System	02-06-2022
Q-3-W-1602	Q3-ISB-L-1605-TK-1604-W-1602	CONTAINER BACK FILL UNIT CHUTE	6M-Load Test Chain	02-06-2022
Q-2-FT-21-1005	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	4Y Calibration (2 Man / 2 Hr.)	16-06-2022
Q-2-FT-21-1602	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	4Y Calibration (2 Man / 2 Hr.)	16-06-2022

84 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-FT-24-1803	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-PT-24-0801	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-PT-24-1301	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-PT-24-1803	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-PT-24-1801	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-PT-24-0601	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-PT-24-2601	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-TT-21-1001	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-2-TT-24-2604	Q2-FRC-2400	Fractionation unit	4Y Calibration (2 Man / 2 Hr.)	14-06-2022
Q-1-ZS-91-7001	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZS-91-7002	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZS-91-7003	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZS-91-7004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZS-91-7006	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZS-91-7007	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZT-91-7001	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZT-91-7002	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZT-91-7003	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-ZT-91-7004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND FUNCTION TEST	14-06-2022
Q-1-FT-11-0501	Q1-QMX-D1102-P1102A-FT110501	FT110501-Total Prop Feed	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-11-1201	Q1-QMX-D1103A-FT111201	FT111201-Ben Feed to Ben Feed Htr	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-11-1601	Q1-QMX-V1103-FT111601	FT111601-DIPB Col.Sidrw to Transk.Fd Htr	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-11-1701	Q1-QMX-V1103-FT111701	FT111701-DIPB Colm Internal Reflux	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-0501	Q1-FRC-V1401-P1402A-FT140501	FT140501-Crude Acetone Colm Blm Ps Disch	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-0702	Q1-FRC-D1401-P1403A-FT140702	FT140702-Crude Acetone Colm Reflux	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-0805	Q1-FRC-D1403-P1405A-FT140805	FT140805-Aldahyde Recy to Finish Acet.Col.	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-1001	Q1-FRC-D1403-P1405A-FT141001	FT141001-Finish Acetone Colm Reflux	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-1401	Q1-FRC-V1403-P1306A-FT141401	FT141401-Chem Treat Reac Efflu. Ps Disch	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-1702	Q1-FRC-V1404-P1410A-FT141702	FT141702-Resi Stri Bl->Resi Stri Bl.Cool	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-1803	Q1-FRC-V1404-P1410A-FT141803	FT141803-Resi Stri Bl.to Resi Stri Reboi	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-1903	Q1-FRC-V1404-FT141903	FT141903-Crude Phenol Colm Blm	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-2001	Q1-FRC-D1407-P1412A-FT142001	FT142001-Crud Phenol Col.Sidout Ps Disch	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-FT-14-2101	Q1-FRC-D1407-P1411A-FT142101	FT142101-Crude Phenol Colm Reflux	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-PT-14-1801	Q1-FRC-V1404-V1405-PT141801	PT141801-Resid Strip V-1405	4Y Calibration (2 Man / 2 Hr.)	15-06-2022
Q-1-PT-14-1501	Q1-FRC-D1405-P1408A-FT141501	FT141501-Cum-AMS Colm Reflux	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-FT-14-2601	Q1-FRC-V1406-FT142601	FT142601-Phenol Recti Internal Reflux	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-FT-14-0801	Q1-OSB-TK4109-P4109A-FT140801	FT140801-Fresh Caust to Finish Acet.Colm	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-LT-11-1701	Q1-QMX-V1103-LT111701	LT111701-DIPB Colm BlmIom	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-0601	Q1-FRC-V1401-PT140601	PT140601-Crude Acetone Colm BlmIom	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-0801	Q1-FRC-V1402-PT140801	PT140801-Finish Acetone Colm BlmIom	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-1001	Q1-FRC-V1402-PT141001	PT141001-Finish Acetone Colm O/HVapor	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-1301	Q1-FRC-V1403-PT141301	PT141301-Cum-AMS Colm BlmIom	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-1601	Q1-FRC-V1403-PT141601	PT141601-Cumene-AMS Colm O/HVapor	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-1803	Q1-FRC-V1404-V1405-PT141803	PT141803-Resid Strip BlmIom	4Y Calibration (2 Man / 2 Hr.)	20-06-2022

65 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PT-14-1903	Q1-FRC-V1404-PT141903	PT141903-Crude Phenol Colm BlmIom	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-2101	Q1-FRC-V1404-PT142101	PT142101-Crude Phenol Colm O/HVapor	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-PT-14-2701	Q1-FRC-V1406-E1419-PT142701	PT142701-Phenol Recti O/HVapor Vent	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-TDT-14-1302	Q1-FRC-V1403-TDT141302	TDT141302-CumAMS Col.O/HTray 8 Tmp.Diff.	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-TT-14-0602	Q1-FRC-V1401-TT140602	TT140602-V-1401, Tray 5	4Y Calibration (2 Man / 2 Hr.)	20-06-2022
Q-1-TT-14-0606	Q1-FRC-V1401-TT140606	TT140606-V-1401 Outlet	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TE-14-0810	Q1-FRC-V1402-TE140810	TE140810-V-1402, Tray 57	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TT-14-1301	Q1-FRC-V1403-TT141301	TT141301-Cum-AMS Colm O/HVapor	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TT-14-1307	Q1-FRC-V1403-TT141307	TT141307-V-1403 Outlet	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TT-14-1802	Q1-FRC-V1404-TT141802	TT141802-Crud Pheno Col.Blm toResid Stri	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TT-14-1805	Q1-FRC-V1404-V1405-TT141805	TT141805-Resid Strip Colm Blm	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TT-14-2605	Q1-FRC-V1406-P1415A-TT142605	TT142605-Phenol Recti Blm	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-PT-14-2601	Q1-FRC-V1406-PT142601	PT142601-Phenol Recti BlmIom	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TT-11-1701	Q1-QMX-V1103-TT111701	TT111701-DIPB Colm Tray 46	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-TT-12-0702	Q1-OCD-C1201-TT120702	TT120702-Temp Tx (FF)	4Y Calibration (2 Man / 2 Hr.)	27-06-2022
Q-1-ZS-91-7001	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZS-91-7002	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZS-91-7003	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZS-91-7004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZS-91-7005	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZS-91-7007	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7001	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7002	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7003	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7005	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1Y)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZT-91-7001	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZT-91-7002	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZT-91-7003	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZT-91-7004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7001	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7002	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7003	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7004	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-ZV-91-7005	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	RCM-(1M)-INSPECTION AND CLEANING	01-06-2022
Q-1-PM-1507A	Q1-FRC-D1507-P1507A-PM1507A	PM-1507A-Solvent Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1112B	Q1-QMX-D1106-P1112B-PM1112B	PM-1112B-S3 Steam Generator Cir Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1111B	Q1-QMX-V1103-P1111B-PM1111B	PM-1111B-DIPB Colm Sidedraw Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1106A	Q1-QMX-D1104-P1106A-PM1106A	PM-1106A-Benzene Colm Overhead Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1108B	Q1-QMX-V1101-P1108B-PM1108B	PM-1108B-Benzene Colm Bottoms Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1304A	Q1-OCD-D1307-P1304A-PM1304A	PM-1304A-Acid Aromatics Sump Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1501A	Q1-FRC00-TK1501-P1501A-PM1501A	PM-1501A-Phenolic Waste Water Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1201A	Q1-OCD-TK1201-P1201A-PM1201A	PM-1201A-Fresh Feed Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1209A	Q1-OCD-D1206-P1209A-PM1209A	PM-1209A-CHP Sump Pump	4M Motor Greasing	30-06-2022

66 of 85

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-PM-1203A	Q1-0CD-D1201-P1203A-PM1203A	PM-1203A-Combined Feed Pump	4M Motor Greasing	30-06-2022
Q-1-P-9116A	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	6M-Re-Lubricant 2H	27-06-2022
Q-1-P-9119A	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	6M-Re-Lubricant 2H	27-06-2022
Q-1-PM-1504A	Q1-FRC-V1501-P1504A-PM1504A	PM-1504A-Cum-AMS CaulsicWash Colm Recir	4M Motor Greasing	30-06-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	28-06-2022
Q-2-X-5051	Q2-0SB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	24-06-2022
Q-2-X-5052	Q2-0SB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL <?&<?> FUEL T	24-06-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	28-06-2022
Q-1-EES-SUB-001	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-002	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-003	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-004	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-101	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-102	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-103	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-104	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-SUB-105	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-TLH-001	Q1-0SB-EES-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-001	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-002	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-003	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-004	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-005	Q1-0SB-EES-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-006	Q1-0SB-EES-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-101	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-102	Q1-0SB-EES-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EES-WWT-103	Q1-0SB-EES-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-SUB-001	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-SUB-002	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-SUB-003	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-SUB-004	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-SUB-005	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-SUB-006	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-TLH-001	Q1-0SB-EML-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(1Y) Inspection and function test	29-06-2022
Q-1-EML-TLH-002	Q1-0SB-EML-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(1Y) Inspection and function test	29-06-2022
Q-1-EML-WWT-001	Q1-0SB-EML-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-WWT-002	Q1-0SB-EML-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-EML-WWT-101	Q1-0SB-EML-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(1Y) Inspection and function test	29-06-2022
Q-1-C-9132A	Q1-0SB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	27-06-2022
Q-1-C-9132B	Q1-0SB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	27-06-2022
Q-1-C-9132C	Q1-0SB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	27-06-2022
Q-1-C-9132D	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	27-06-2022
Q-1-C-9132E	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	27-06-2022
Q-1-C-9132F	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	27-06-2022

87 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-EES-SUB-001	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-002	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-003	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-004	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-101	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-102	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-103	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-104	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-SUB-105	Q1-0SB-EES-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-TLH-001	Q1-0SB-EES-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-001	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-002	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-003	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-004	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-005	Q1-0SB-EES-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-006	Q1-0SB-EES-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-101	Q1-0SB-EES-LP-WWT01-2	WWT BLDG MCC ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-102	Q1-0SB-EES-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EES-WWT-103	Q1-0SB-EES-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-SUB-001	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-SUB-002	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-SUB-003	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-SUB-004	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-SUB-005	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-SUB-006	Q1-0SB-EML-LP-SUB01-16	SUB PH1 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-TLH-001	Q1-0SB-EML-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(3M) Inspection and function test	29-06-2022
Q-1-EML-TLH-002	Q1-0SB-EML-ELP-TLH01-3	TRUCK LOADING HOUSE SECURITY ROOM	(3M) Inspection and function test	29-06-2022
Q-1-EML-WWT-001	Q1-0SB-EML-LP-WWT02-05-01	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-WWT-002	Q1-0SB-EML-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	29-06-2022
Q-1-EML-WWT-101	Q1-0SB-EML-LP-WWT02-05-02	WWT2 BLDG MCC ROOM2 FL.G	(3M) Inspection and function test	29-06-2022
Q-1-C-9132A	Q1-0SB-X9134-C9132A	C-9132A-SBR BLOWER	1M-Replace Lube Oil	27-06-2022
Q-1-C-9132B	Q1-0SB-X9134-C9132B	C-9132B-SBR BLOWER	1M-Replace Lube Oil	27-06-2022
Q-1-C-9132C	Q1-0SB-X9134-C9132C	C-9132C-SBR BLOWER	1M-Replace Lube Oil	27-06-2022
Q-1-C-9132D	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	27-06-2022
Q-1-C-9132E	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	27-06-2022
Q-1-C-9132F	Q1-0SB-9101	Waste Water & Effluent Treatment X-9101	1M-Replace Lube Oil	27-06-2022
Q-2-TXT-23-0701	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022
Q-2-TXT-23-0702	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022
Q-2-TXT-23-0805A	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022
Q-2-TXT-23-0805B	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022
Q-2-TXT-23-0901A	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022
Q-2-TXT-23-0901B	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022
Q-2-TXT-23-1006	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022
Q-2-TXT-23-1301A	Q2-0CD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect,Cal&Func.Test Temp Trans	16-06-2022

88 of 88



Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-TXT-23-1301B	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test Temp Trans	16-06-2022
Q-2-TXT-23-1402	Q2-OCD-2300	Phenol II Oxidation CDN Section	(2Y) Inspect, Cal&Func. Test Temp Trans	16-06-2022
Q-2-P-9191E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	17-06-2022
Q-2-PM-2501A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2501B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2502A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2502B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2503A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2503B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2504A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2504B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2505A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2505B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2506A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2506B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2507A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2507B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-2-PM-2509A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-tighten	29-06-2022
Q-1-AT-91-6501	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-06-2022
Q-1-AT-91-6502	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-06-2022
Q-1-AT-91-6503	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-06-2022
Q-1-AT-91-6504	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-06-2022
Q-1-AT-91-6505	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(2M) clean and Calb AYZ DO	28-06-2022
Q-1-00B01-VMS	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	14-06-2022
Q-1-C1201-OXIDIZER	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	14-06-2022
Q-1-D1204-CHARCOAL	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	14-06-2022
Q-1-DCS-HIS	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	14-06-2022
Q-1-FGS	Q1-OSB-5000	Electricity Distribution and Control	(3M) Backup Data and Config.	14-06-2022
Q-1-TT-16-0503	Q1-QMX-R1602-TT160503	TT160503-Hydro Reac No.2 Lower Midd Sect	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-16-0501	Q1-QMX-R1602-TT160501	TT160501-Hydro Reac No.2 Upp Midd Sect	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-16-0408	Q1-QMX-R1601-TT160408	TT160408-Hydro Reac no.1 Outlet	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-16-0402	Q1-OSB-TK1601-P1601A-TT160402	TT160402-Hydro Reac no.1 Inlet	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-P-6204B	Q1-OSB-X6201-P6204B	P-6204B-OIL PUMP	1M-GREASING( High temp), 1Hr	27-06-2022
Q-1-P-6204A	Q1-OSB-X6201-P6204A	P-6204A-OIL PUMP	1M-GREASING( High temp), 1Hr	27-06-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(1M) Archive HIST Data and Config. to CD	20-06-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	06-06-2022
Q-3-FGS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	06-06-2022
Q-3-VMS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	06-06-2022
Q-3-WWT01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(3M) Backup Data and Config.	06-06-2022
Q-3-EML-CCB-207	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-101	Q3-OSB-EES-LP01A-5A-01	CCB BPA MAIN ENTRANCE FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-102	Q3-OSB-EES-LP01A-5B-10	CCB BPA SUB ENTRANCE FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-103	Q3-OSB-EES-LP01A-6A-02	CCB BPA INSTRUMENT ROOM FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-201	Q3-OSB-EES-LP01B-3B-01	CCB BPA CORRIDOOR LAB FL.2	(3M) Inspection and function test	06-06-2022

88 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-EES-CCB-202	Q3-OSB-EES-LP01B-4B-09	CCB BPA MEETING ROOM3 FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-203	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-204	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-205	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-206	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EES-SUB-101	Q3-OSB-EES-MLP01B-3A-02	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EES-SUB-102	Q3-OSB-EES-MLP01A-2A-04	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EES-SUB-103	Q3-OSB-EES-MLP01B-3A-07	SUB BPA BLDG EDG ROOM FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EES-WWT-001	Q3-OSB-EES-LP15-1B-02	WWT BPA BLDG MCC / CONTROL ROOM FL.G	(3M) Inspection and function test	06-06-2022
Q-3-EES-WWT-101	Q3-OSB-EES-LP15-1C-03	WWT BPA BLDG BELT PRESS ROOM FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-101	Q3-OSB-EML-LP01A-5A-01	CCB BPA MAIN ENTRANCE FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-102	Q3-OSB-EML-LP01A-6A-09	CCB BPA CORRIDOOR FILES ROOM FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-103	Q3-OSB-EML-LP01A-5B-10	CCB BPA SUB ENTRANCE FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-104	Q3-OSB-EML-LP01A-6A-06	CCB BPA CORRIDOOR CCR FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-105	Q3-OSB-EML-LP01A-6A-10	CCB BPA CCR FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-106	Q3-OSB-EML-LP01A-6A-02	CCB BPA INSTRUMENT ROOM FL.1	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-201	Q3-OSB-EML-LP01B-4A-10	CCB BPA UP STAIRS FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-202	Q3-OSB-EML-LP01B-4B-05	CCB BPA RECEPTION FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-203	Q3-OSB-EML-LP01B-3B-07	CCB BPA CORRIDOOR FILES ROOM FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-204	Q3-OSB-EML-LP01B-3B-01	CCB BPA CORRIDOOR LAB ROOM FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-205	Q3-OSB-EML-LP01B-4B-02	CCB BPA CORRIDOOR LAB ROOM FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EML-CCB-206	Q3-OSB-EML-LP01B-4B-09	CCB BPA MEETING ROOM3 FL.2	(3M) Inspection and function test	06-06-2022
Q-3-EES-CCB-101	Q3-OSB-EES-LP01A-5A-01	CCB BPA MAIN ENTRANCE FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-102	Q3-OSB-EES-LP01A-5B-10	CCB BPA SUB ENTRANCE FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-103	Q3-OSB-EES-LP01A-6A-02	CCB BPA INSTRUMENT ROOM FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-201	Q3-OSB-EES-LP01B-3B-01	CCB BPA CORRIDOOR LAB FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-202	Q3-OSB-EES-LP01B-4B-09	CCB BPA MEETING ROOM3 FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-203	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-204	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-205	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EES-CCB-206	Q3-OSB-EES-DB-LP2-10	CCB BPA OFFICE LAB ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EES-SUB-101	Q3-OSB-EES-MLP01B-3A-02	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EES-SUB-102	Q3-OSB-EES-MLP01A-2A-04	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EES-SUB-103	Q3-OSB-EES-MLP01B-3A-07	SUB BPA BLDG EDG ROOM FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EES-WWT-001	Q3-OSB-EES-LP15-1B-02	WWT BPA BLDG MCC / CONTROL ROOM FL.G	(1Y) Inspection and function test	06-06-2022
Q-3-EES-WWT-101	Q3-OSB-EES-LP15-1C-03	WWT BPA BLDG BELT PRESS ROOM FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-101	Q3-OSB-EML-LP01A-5A-01	CCB BPA MAIN ENTRANCE FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-102	Q3-OSB-EML-LP01A-6A-09	CCB BPA CORRIDOOR FILES ROOM FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-103	Q3-OSB-EML-LP01A-5B-10	CCB BPA SUB ENTRANCE FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-104	Q3-OSB-EML-LP01A-6A-06	CCB BPA CORRIDOOR CCR FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-105	Q3-OSB-EML-LP01A-6A-10	CCB BPA CCR FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-106	Q3-OSB-EML-LP01A-6A-02	CCB BPA INSTRUMENT ROOM FL.1	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-201	Q3-OSB-EML-LP01B-4A-10	CCB BPA UP STAIRS FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-202	Q3-OSB-EML-LP01B-4B-05	CCB BPA RECEPTION FL.2	(1Y) Inspection and function test	06-06-2022

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-EML-CCB-203	Q3-OSB-EML-LP01B-3B-07	CCB BPA CORRIDOOR FILES ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-204	Q3-OSB-EML-LP01B-3B-01	CCB BPA CORRIDOOR LAB ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-205	Q3-OSB-EML-LP01B-4B-02	CCB BPA CORRIDOOR LAB ROOM FL.2	(1Y) Inspection and function test	06-06-2022
Q-3-EML-CCB-206	Q3-OSB-EML-LP01B-4B-09	CCB BPA MEETING ROOM3 FL.2	(1Y) Inspection and function test	06-06-2022
Q-1-PV4-41-0901	Q1-OSB-TK4111-PV410901	PV410901-Diamine storage TK Breath vent	2W-Clean PVV 2Hr	07-06-2022
Q-1-P-4130A	Q1-OSB	Phenol I - Outside Battery	6M-Re-Lubricant 2H	27-06-2022
Q-2-AT-63-5101	Q2-OSB-6350	Tempered Water System	(1M) Inspect, clean and Calb AYZ Hydr	29-06-2022
Q-2-AT-21-1901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2M) Clean Filter & Cal AYZ O2	28-06-2022
Q-2-AT-24-1103	Q2-FRC-2400	Fractionation unit	(2M) Clean Filter & Cal AYZ O2	28-06-2022
Q-2-AT-24-2801	Q2-FRC-2400	Fractionation unit	(2M) Clean Filter & Cal AYZ O2	28-06-2022
Q-2-AT-23-1001	Q2-OSB-2300	Phenol II Oxidation: CDN Section	(2M)Clean Filter & Cal AYZ O2	28-06-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	24-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1M-GREASING UNIVERSAL JOINT.0.5HR	24-06-2022
Q-3-EML-CCB-208	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(1Y) Inspection and function test	07-06-2022
Q-3-EML-CCB-209	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(1Y) Inspection and function test	07-06-2022
Q-3-EML-CCB-210	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(1Y) Inspection and function test	07-06-2022
Q-3-EML-CCB-207	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	07-06-2022
Q-3-EML-CCB-208	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	07-06-2022
Q-3-EML-CCB-209	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	07-06-2022
Q-3-EML-CCB-210	Q3-OSB-EML-DB-LP2-10	CCB BPA MAIN LAB ROOM FL.2	(3M) Inspection and function test	07-06-2022
Q-3-EML-SUB-101	Q3-OSB-EML-MLP01B-3A-02	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	07-06-2022
Q-3-EML-SUB-102	Q3-OSB-EML-MLP01A-2A-04	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	07-06-2022
Q-3-EML-SUB-103	Q3-OSB-EML-MLP01A-2A-06	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(3M) Inspection and function test	07-06-2022
Q-3-EML-SUB-104	Q3-OSB-EML-MLP01B-3A-07	SUB BPA BLDG EDG ROOM FL.1	(3M) Inspection and function test	07-06-2022
Q-3-EML-WWT-001	Q3-OSB-EES-LP15-1B-02	WWT BPA BLDG MCC / CONTROL ROOM FL.G	(3M) Inspection and function test	07-06-2022
Q-3-EML-WWT-101	Q3-OSB-EES-LP15-1C-03	WWT BPA BLDG BELT PRESS ROOM FL.1	(3M) Inspection and function test	07-06-2022
Q-3-EML-SUB-101	Q3-OSB-EML-MLP01B-3A-02	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(1Y) Inspection and function test	07-06-2022
Q-3-EML-SUB-102	Q3-OSB-EML-MLP01A-2A-04	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(1Y) Inspection and function test	07-06-2022
Q-3-EML-SUB-103	Q3-OSB-EML-MLP01A-2A-06	SUB BPA BLDG MV / LV SWGR ROOM FL.1	(1Y) Inspection and function test	07-06-2022
Q-3-EML-SUB-104	Q3-OSB-EML-MLP01B-3A-07	SUB BPA BLDG EDG ROOM FL.1	(1Y) Inspection and function test	07-06-2022
Q-3-EML-WWT-001	Q3-OSB-EES-LP15-1B-02	WWT BPA BLDG MCC / CONTROL ROOM FL.G	(1Y) Inspection and function test	07-06-2022
Q-3-EML-WWT-101	Q3-OSB-EES-LP15-1C-03	WWT BPA BLDG BELT PRESS ROOM FL.1	(1Y) Inspection and function test	07-06-2022
Q-1-XD-5001B	Q1-OSB-X5001-X5001B-XD5001B	XD-5001B-Emergency Diesel Engine Gen	1M-Greasing Universal Joint.0.5Hr	27-06-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-411100-Diamine Storage Tank	2W-Clean Emergency Manhole 2Hr	23-06-2022
Q-2-AXT-22-1001	Q2-OSB-2200	Phenol II Oxidation: Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-06-2022
Q-2-AXT-22-1002	Q2-OSB-2200	Phenol II Oxidation: Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-06-2022
Q-2-AXT-22-1401	Q2-OSB-2200	Phenol II Oxidation: Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-06-2022
Q-2-AXT-22-1402	Q2-OSB-2200	Phenol II Oxidation: Oxidation Section	(1M) Inspect, Clean Filter & Cal AYZ O2	28-06-2022
Q-1-PM-4103A	Q1-OSB-TK4103A-P4103A-PM4103A	PM-4103A-Cum Rundown Pump	4M Motor Greasing	30-06-2022
Q-1-PM-4101A	Q1-OSB-TK4101A-P4101A-PM4101A	PM-4101A-Propylene Feed Pump	4M Motor Greasing	30-06-2022
Q-1-PM-6402	Q1 OSB00 TK6401 P6402 PM6402	PM 6402 Proocsa Water Emor. Pump	4M Motor Greasing	30 06 2022
Q-1-P-6902A	Q1-OSB-X6901-P6902A	P-6902A-Jockey Pumps	1Y- Replace lube oil 2Hr	29-06-2022
Q-1-PM-4123	Q1-OSB-TK4112A-P4123-PM4123	PM-4123-Off-Spec Phenol Pump	4M Motor Greasing	30-06-2022
Q-1-PM-4112A	Q1-OSB-TK4112A-P4112A-PM4112A	PM-4112A-Phenol Rundown Pump	4M Motor Greasing	30-06-2022

71 of 93

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-P-6901A	Q1-OSB-X6901-P6901A	P-6901A-Fire Water Pumps	1Y- REPLACE LUBE OIL, 2Hr	29-06-2022
Q-1-AT-12-1001	Q1-OSB-OX1201-AT121001	AT121001-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	28-06-2022
Q-1-AT-12-1002	Q1-OSB-OX1201-AT121002	AT121002-Oxidi No.1 Vent Gas O2 Content	(1M) Clean Filter and Cal.	28-06-2022
Q-1-AT-12-1401	Q1-OSB-OX1202-AT121401	AT121401-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	28-06-2022
Q-1-AT-12-1402	Q1-OSB-OX1202-AT121402	AT121402-Oxidi No.2 Oxygen Content	(1M) Clean Filter and Cal.	28-06-2022
Q-1-PM-4117	Q1-OSB-TK4103A-P4117-PM4117	PM-4117-Off-Spec. Cum Pump	4M Motor Greasing	30-06-2022
Q-1-PM-4104A	Q1-OSB-TK4104-P4104A-PM4104A	PM-4104A-Cum Storage Pump	4M Motor Greasing	30-06-2022
Q-1-PM-4113A	Q1-OSB-TK4113A-P4113A-PM4113A	PM-4113A-Acalone Rundown Pump	4M Motor Greasing	30-06-2022
Q-1-PM-4116	Q1-OSB-TK4102A-P4116-PM4116	PM-4116-Off-Spec. Benzene Pump	4M Motor Greasing	30-06-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	24-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	24-06-2022
Q-3-L-1602	Q3-ISB-L-1602	BPA PRODUCT CONVEYOR 1	RCM 1M PM Bucket conveyor.2.5Hr	24-06-2022
Q-1-P-4107	Q1-OSB-TK4107-P4107	P-4107-Residue Truck Loading Pump	8M-Replace lube oil 2Hr	27-06-2022
Q-1-P-1404B	Q1-FRC-V1402-P1404B	P-1404B-FinishAceloneColumnBottomsPump	4M- Replace lube oil 2Hr	27-06-2022
Q-2-AT-24-1101	Q2-FRC-2400	Fractionation unit	(3M) Inspect and ChngFilter AYZ Mois	28-06-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent&Consumable	28-06-2022
Q-3-L-1604	Q3-ISB-L-1604	BPA PRODUCT CONVEYOR 3	RCM 1M PM Bucket conveyor.2.5Hr	24-06-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Bell Inspection	27-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Bell Inspection	27-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Bell Inspection	27-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	27-06-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	27-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Bell Inspection	27-06-2022
Q-2-P-9102E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	17-06-2022
Q-2-P-9103E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	17-06-2022
Q-2-P-9193E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	17-06-2022
Q-2-P-9194E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	17-06-2022
Q-2-EES-EDG-001	Q2-OSB-EES-ELP-5051-11T-1	PH2 EDG ROOM	(1Y) Inspection and function test	29-06-2022
Q-2-EES-IRR-001	Q2-OSB-EES-ELP-5052-05T-5	INSTRUMENT RACK ROOM PH2	(1Y) Inspection and function test	29-06-2022
Q-2-EES-IRR-002	Q2-OSB-EES-ELP-5052-05T-4	INSTRUMENT RACK ROOM PH2	(1Y) Inspection and function test	29-06-2022
Q-2-EES-IRR-003	Q2-OSB-EES-ELP-5052-05T-1	INST. RACK ROOM PH2 BATTERY ROOM1	(1Y) Inspection and function test	29-06-2022
Q-2-EES-IRR-004	Q2-OSB-EES-ELP-5052-05T-2	INST. RACK ROOM PH2 BATTERY ROOM2	(1Y) Inspection and function test	29-06-2022
Q-2-EES-IRR-005	Q2-OSB-EES-ELP-5052-05T-3	INST. RACK ROOM PH2 BATTERY ROOM2	(1Y) Inspection and function test	29-06-2022
Q-2-EES-SUB-001	Q2-OSB-EES-ELP-5051-09S-5	SUB PH2 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-2-EES-SUB-002	Q2-OSB-EES-ELP-5051-09S-2	SUB PH2 BLDG CABLE ROOM FL.G	(1Y) Inspection and function test	29-06-2022
Q-2-EES-SUB-101	Q2-OSB-EES-ELP-5051-09S-4	SUB PH2 BLDG LV SWGR ROOM FL.1	(1Y) Inspection and function test	29-06-2022
Q-2-EES-SUB-102	Q2-OSB-EES-ELP-5051-09S-1	SUB PH2 BLDG LV SWGR ROOM FL.1	(1Y) Inspection and function test	29-06-2022
Q-2-EES-SUB-201	Q2-OSB-EES-ELP-5051-09S-6	SUB PH2 BLDG MV SWGR ROOM FL.2	(1Y) Inspection and function test	29-06-2022
Q-2-EES-SUB-202	Q2-OSB-EES-ELP-5051-09S-3	SUB PH2 BLDG MV SWGR ROOM FL.2	(1Y) Inspection and function test	29-06-2022
Q-2-PCV-41-0531	Q2-OSB-4100	Tank Gauging System	(2Y) Ins, Cal&Func.Test Press CNTL Valve	17-06-2022
Q-2-FV-41-0104	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func.Test CNTL Valve	17-06-2022
Q-2-FV-41-0132	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func.Test CNTL Valve	17-06-2022
Q-2-FV-41-0133	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func.Test CNTL Valve	17-06-2022
Q-2-FV-41-0134	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func.Test CNTL Valve	17-06-2022

72 of 93

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-FV-41-0135	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test CNTL Valve	17-06-2022
Q-2-FV-41-0231	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test CNTL Valve	17-06-2022
Q-2-FV-41-0232	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test CNTL Valve	17-06-2022
Q-2-FV-41-0233	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test CNTL Valve	17-06-2022
Q-2-FV-41-0331	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test CNTL Valve	17-06-2022
Q-2-EES-EDG-001	Q2-OSB-EES-ELP-5051-11T-1	PH2 EDG ROOM	(3M) Inspection and function test	29-06-2022
Q-2-EES-IRR-001	Q2-OSB-EES-ELP-5052-05T-5	INSTRUMENT RACK ROOM PH2	(3M) Inspection and function test	29-06-2022
Q-2-EES-IRR-002	Q2-OSB-EES-ELP-5052-05T-4	INSTRUMENT RACK ROOM PH2	(3M) Inspection and function test	29-06-2022
Q-2-EES-IRR-003	Q2-OSB-EES-ELP-5052-05T-1	INST. RACK ROOM PH2 BATTERY ROOM1	(3M) Inspection and function test	29-06-2022
Q-2-EES-IRR-004	Q2-OSB-EES-ELP-5052-05T-2	INST. RACK ROOM PH2 BATTERY ROOM2	(3M) Inspection and function test	29-06-2022
Q-2-EES-IRR-005	Q2-OSB-EES-ELP-5052-05T-3	INST. RACK ROOM PH2 BATTERY ROOM2	(3M) Inspection and function test	29-06-2022
Q-2-EES-SUB-001	Q2-OSB-EES-ELP-5051-09S-5	SUB PH2 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-2-EES-SUB-002	Q2-OSB-EES-ELP-5051-09S-2	SUB PH2 BLDG CABLE ROOM FL.G	(3M) Inspection and function test	29-06-2022
Q-2-EES-SUB-101	Q2-OSB-EES-ELP-5051-09S-4	SUB PH2 BLDG LV SWGR ROOM FL.1	(3M) Inspection and function test	29-06-2022
Q-2-EES-SUB-102	Q2-OSB-EES-ELP-5051-09S-1	SUB PH2 BLDG LV SWGR ROOM FL.1	(3M) Inspection and function test	29-06-2022
Q-2-EES-SUB-201	Q2-OSB-EES-ELP-5051-09S-6	SUB PH2 BLDG MV SWGR ROOM FL.2	(3M) Inspection and function test	29-06-2022
Q-2-EES-SUB-202	Q2-OSB-EES-ELP-5051-09S-3	SUB PH2 BLDG MV SWGR ROOM FL.2	(3M) Inspection and function test	29-06-2022
Q-1-PM-1208A	Q1-OSB-5000	PM-1208A-Decanter Pump	4M Motor Greasing	30-06-2022
Q-1-C1201-OXIDIZER	Q1-OSB-5000	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	14-06-2022
Q-1-D1204-CHARCOAL	Q1-OSB-5000	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	14-06-2022
Q-1-FGS	Q1-OSB-5000	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	14-06-2022
Q-1-00B01-VMS	Q1-OSB-5000	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	14-06-2022
Q-1-DCS	Q1-OSB-DCS	DCS-Control & Monitoring System	(6M) Change Filter for Console/Cabinet	14-06-2022
Q-1-DCS-HIS	Q1-OSB-5000	Electricity Distribution and Control	(6M) Change Filter for Console/Cabinet	14-06-2022
Q-1-DCS	Q1-OSB-DCS	DCS-Control & Monitoring System	(6M) Cleaning Console & Cabinet	14-06-2022
Q-1-DCS-HIS	Q1-OSB-5000	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	14-06-2022
Q-1-PM-6103C	Q1-OSB-T6101-P6103C-PM6103C	PM-6103C-HP C/W Cir Pump	2M Motor Greasing	29-06-2022
Q-2-PM-2509B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	29-06-2022
Q-2-PM-2511A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	29-06-2022
Q-2-PM-2511B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	29-06-2022
Q-2-PM-2512	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	29-06-2022
Q-2-PM-2513	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	29-06-2022
Q-2-PM-2514A	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	29-06-2022
Q-2-PM-2514B	Q2-FRC-2500	Phenol Recovery Section	(1Y) Inspection Megger clean re-lighten	29-06-2022
Q-3-DCS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Cleaning Console/Cabinet	07-06-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Change Filter for Console/Cabinet	06-06-2022
Q-3-DCS-HIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Cleaning Console/Cabinet	07-06-2022
Q-3-DCS-MR	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Cleaning Console/Cabinet	07-06-2022
Q-3-FGS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Change Filter for Console/Cabinet	06-06-2022
Q-3-FGS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Cleaning Console/Cabinet	07-06-2022
Q-3-SIS	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Cleaning Console/Cabinet	07-06-2022
Q-3-VMS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Change Filter for Console/Cabinet	06-06-2022
Q-3-VMS01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Cleaning Console/Cabinet	07-06-2022
Q-3-WWT01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Change Filter for Console/Cabinet	06-06-2022

38 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-WWT01	Q3-OSB-9900	EMERGENCY POWER GENERATOR SYSTEM	(6M) Cleaning Console/Cabinet	07-06-2022
Q-1-GT-00-4206	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	1Y Sensor Replace & Calibrate	28-06-2022
Q-1-GT-00-4207	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	1Y Sensor Replace & Calibrate	28-06-2022
Q-1-GT-00-4208	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	1Y Sensor Replace & Calibrate	28-06-2022
Q-1-GT-00-4206	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	28-06-2022
Q-1-GT-00-4207	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	28-06-2022
Q-1-GT-00-4208	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	28-06-2022
Q-1-TT-16-0202	Q1-OSB-TK1601-TT160202	TT160202-MSPH Feed Tank	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-13-1901	Q1-OSB-TK1304-X1310A-TT131901	TT131901-Doom Prod. to Direct New Stat. Mix	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-13-1703	Q1-OSB-TK102-TT131703	TT131703-Reliable C/W from Decomp Cooler	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-14-3001	Q1-FRC-D1413-TT143001	TT143001-Phenolic Waste Water Sump	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-2-C2201-OXIDIZER	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	20-06-2022
Q-2-CHARCOAL	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	20-06-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	20-06-2022
Q-2-FGS	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	20-06-2022
Q-2-MMS	Q2-OSB-5050	Electricity Distribution and Control	(3M) Backup Data and Config.	20-06-2022
Q-3-MCC-SGV-D1501A	Q3-ISB-D01-MCC-SGV-D1501A	400V MOTOR FEEDER LOC MCC5002B-SB3-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501B	Q3-ISB-D01-MCC-SGV-D1501B	400V MOTOR FEEDER LOC MCC5002B-SB3-BA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501C	Q3-ISB-D01-MCC-SGV-D1501C	400V MOTOR FEEDER LOC MCC5002B-SB3-BA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501D	Q3-ISB-D01-MCC-SGV-D1501D	400V MOTOR FEEDER LOC MCC5002B-SB3-BA04	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501E	Q3-ISB-D01-MCC-SGV-D1501E	400V MOTOR FEEDER LOC MCC5002B-SB3-DA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501F	Q3-ISB-D01-MCC-SGV-D1501F	400V MOTOR FEEDER LOC MCC5002B-SB3-DA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501G	Q3-ISB-D01-MCC-SGV-D1501G	400V MOTOR FEEDER LOC MCC5002B-SB3-DA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501H	Q3-ISB-D01-MCC-SGV-D1501H	400V MOTOR FEEDER LOC MCC5002B-SB3-DA04	2Y PM MCC feeder	13-06-2022
Q-3-MCC-SGV-D1501I	Q3-ISB-D01-MCC-SGV-D1501I	400V MOTOR FEEDER LOC MCC5002B-SB3-FA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-TK-1502	Q3-ISB-TK02-TKM02-MCCTK1502	400V MOTOR FEEDER LOC MCC5002A-SA3-CC02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-1501	Q3-ISB-Z1501-ZM1501-MCCZ1501	400V MOTOR FEEDER LOC MCC5002A-SA1-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-1503	Q3-ISBT-K51203-ZM1503-MCC-Z1503	400V MOTOR FEEDER LOC MCC5002A-SA2-HA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-1551	Q3-ISB-Z1551-ZM1551-MCCZ1551	400V MOTOR FEEDER LOC MCC5002A-SA3-JC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1101	Q3-ISBD01TK02P01-PM01MCC-P1101	400V MOTOR FEEDER LOC MCC5001B-SB3-CC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1102	Q3-ISBT-K52TK03-P1102-MCC-P1102	400V MOTOR FEEDER LOC MCC5001B-SB2-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1103	Q3-ISBT-K52P03-PM1103-MCC-P1103	400V MOTOR FEEDER LOC MCC5001B-SB4-JC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1104A	Q3-ISBT-K52P04-PM04MCC-P-1104A	400V MOTOR FEEDER LOC MCC5001A-SA5-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1104B	Q3-ISBT-K52P04BPM04BMCC-P-1104B	400V MOTOR FEEDER LOC MCC5001B-SB4-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1105	Q3-ISBD01P1105-PM1105MCC-P1105	400V MOTOR FEEDER LOC MCC5001B-SB4-BA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1106	Q3-ISBD01TK05-P06PM06MCC-P1106	400V MOTOR FEEDER LOC MCC5001B-SB4-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1111	Q3-ISBT-K11P11-PM1111-MCC-P1111	400V MOTOR FEEDER LOC MCC5002B-SB5-JC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1112	Q3-ISBT-K12P12-PM1112-MCC-P1112	400V MOTOR FEEDER LOC MCC5002B-SB5-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1121	Q3-ISBT-K21P21-PM1121-MCC-P1121	400V MOTOR FEEDER LOC MCC5001A-SA5-BA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1171A	Q3-ISBT-K71AP71A-PM71AMCCP1171A	400V MOTOR FEEDER LOC MCC5002A-SA2-JC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1171B	Q3-ISBT-K71AP71B-PM71BMCCP1171B	400V MOTOR FEEDER LOC MCC5002B-SB5-LA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1172A	Q3-ISBT-K71BP72A-PM72AMCCP1172A	400V MOTOR FEEDER LOC MCC5002A-SA1-HA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1172B	Q3-ISBT-K71BP72B-PM72BMCCP1172B	400V MOTOR FEEDER LOC MCC5002B-SB5-TC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1173A	Q3-ISBT-K73AP73A-PM73AMCCP1173A	400V MOTOR FEEDER LOC MCC5002A-SA2-LA01	2Y PM MCC feeder	13-06-2022

38 of 83



Equipment	Functional Loc	Description	Description	Sched. start
Q-3-MCC-P-1173B	Q3-ISBTK73AF73B-PM73BMCCP1173B	400V MOTOR FEEDER LOC MCC5002B-SB6-HA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1174A	Q3-ISBTK73BF74A-PM74BMCCP1174A	400V MOTOR FEEDER LOC MCC5002A-SA1-JC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1174B	Q3-ISBTK73BF74B-PM74BMCCP1174B	400V MOTOR FEEDER LOC MCC5002B-SB6-SA01	2Y PM MCC feeder	13-06-2022
Q-3-L-1603	Q3-ISB-L-1603	BPA PRODUCT CONVEYOR 2	RCM 1M PM Bucket conveyor,2.5Hr	24-06-2022
Q-3-MCC-L-1601	Q3-ISB-L1601-LM-1601-MCC-L1601	400V MOTOR FEEDER LOC MCC5002B-SB5-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-L-1602	Q3-ISB-L1602-LM-1602-MCC-L1602	400V MOTOR FEEDER LOC MCC5002A-SA2-JC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-L-1603	Q3-ISB-L1603-LM-1603-MCC-L1603	400V MOTOR FEEDER LOC MCC5002B-SB6-EA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-L-1604	Q3-ISB-L1604-LM-1604-MCC-L1604	400V MOTOR FEEDER LOC MCC5002B-SB6-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-L-1605	Q3-ISB-L1605-LM-1605-MCC-L1605	400V MOTOR FEEDER LOC MCC5002B-SB5-HA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-RV-1601A	Q3-ISB-L04-RV1601A-MCC-RV1601A	400V MOTOR FEEDER LOC MCC5002A-SA2-FC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-RV-1601B	Q3-ISB-L04-RV1601B-MCC-RV1601B	400V MOTOR FEEDER LOC MCC5002A-SA2-FC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-RV-1601C	Q3-ISB-L03-RV1601C-MCC-RV1601C	400V MOTOR FEEDER LOC MCC5002B-SB5-HA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-RV-1602	Q3-ISB-TK02-RV1602-MCCRV-1602	400V MOTOR FEEDER LOC MCC5002B-SB5-CC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-S-1603	Q3-ISB-TK03-S03-SM03-MCCS1603	400V MOTOR FEEDER LOC MCC5002A-SA3-HA01	2Y PM MCC feeder	13-06-2022
Q-3-L-1601	Q3-ISB-L-1601	1ST PRODUCT CONVEYOR	RCM 1M PM Bucket conveyor,2.5Hr	24-06-2022
Q-3-MCC-C-1401A	Q3-ISBD01-C01A-CM01AMCC-C1401A	400V MOTOR FEEDER LOC MCC5001A-SA6-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-C-1401B	Q3-ISBD01-C01B-CM01BMCC-C1401B	400V MOTOR FEEDER LOC MCC5001B-SB6-EA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-D-1401	Q3-ISB-D1401-LM-1401-MCC-D1401	400V MOTOR FEEDER LOC MCC5001B-SB9	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1401	Q3-ISBD01TK02-P01-PM01MCCP1401	400V MOTOR FEEDER LOC MCC5001A-SA6-FC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1402	Q3-ISBD05P1402-PM1402MCCP1402	400V MOTOR FEEDER LOC MCC5001A-SA4-FC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1403	Q3-ISBD04P1403-PM1403MCCP1403	400V MOTOR FEEDER LOC MCC5001A-SA4-HC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1405A	Q3-ISBD01-TK05-P1405AMCCP1405A	400V MOTOR FEEDER LOC MCC5001A-SA4-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1405B	Q3-ISBD01-TK05-P1405BMCCP1405B	400V MOTOR FEEDER LOC MCC5001B-SB6-BA04	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1406A	Q3-ISBD01-TK06-P1406AMCCP1406A	400V MOTOR FEEDER LOC MCC5001A-SA6-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1406B	Q3-ISBD01-TK06-P1406BMCCP1406B	400V MOTOR FEEDER LOC MCC5001B-SB6-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1409	Q3-ISBD01TK09P09-PM09-MCCP1409	400V MOTOR FEEDER LOC MCC5001B-SB2-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-C-9303	Q3-OSB203C9301-CM9301MCC9303	400V POWER FEEDER LOC MCC5002B-SB3-HA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9308	Q3-OSBT02-P08-PM9308MCC-P9308	400V MOTOR FEEDER LOC MCC5002A-SA2-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-L-1503	Q3-ISBTK51TK53-L1503-MCC-L1503	400V MOTOR FEEDER LOC MCC5002B-SB3-FA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-NA-1501	Q3-ISB-N01-NA1501-MCCNA-1501	400V MOTOR FEEDER LOC MCC5002B-SB5-FC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1501	Q3-ISB-N01-P01-PM01-MCCP1501	400V MOTOR FEEDER LOC MCC5001A-SA6-QC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1502	Q3-ISBTK51TK02-P1502-MCC-P1502	400V MOTOR FEEDER LOC MCC5002B-SB6-JC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1503	Q3-ISB-E01-P03-PM03-MCCP1503	400V MOTOR FEEDER LOC MCC5001A-SA6-EA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-RV-1501	Q3-ISB-RV01-RV01M1-MCCRV-1501	400V MOTOR FEEDER LOC MCC5002A-SA3-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-RV-1502	Q3-ISBD01Z51-RV1502-MCC-RV1502	400V MOTOR FEEDER LOC MCC5002B-SB6-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-RV-1503	Q3-ISBD01Z01-RV1503-MCC-RV1503	400V MOTOR FEEDER LOC MCC5002B-SB5-FC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-W-1602	Q3-ISB-TK04-W02-WM02-MCCW1602	400V POWER FEEDER LOC MCC5002A-SA4-BA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-W-1603	Q3-ISB-TK04-W03-WM03-MCCW1603	400V POWER FEEDER LOC MCC5002A-SA4-BA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-W-1604	Q3-ISB-W1604-WM1604-MCCW-1604	400V POWER FEEDER LOC MCC5002B-SB4-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-W-1605	Q3-ISB-W1605-WM1605-MCCW-1605	400V POWER FEEDER LOC MCC5002B-SB4-BA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-1601	Q3-ISB-L-1605-Z-1601-MCC-Z1601	400V POWER FEEDER LOC MCC5002B-SB3-FA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-1674	Q3-ISBTK74Z74-ZM1674-MCC-Z1674	400V MOTOR FEEDER LOC MCC5002A-SA3-BA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-NA-1304	Q3-ISBS01N04-NA1304-MCC-NA1304	400V MOTOR FEEDER LOC MCC5001B-SB3-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-NA-1310	Q3-ISBS02N10-NA1310-MCC-NA1310	400V MOTOR FEEDER LOC MCC5001B-SB3-EA01	2Y PM MCC feeder	13-06-2022

19 of 88

Equipment	Functional Loc	Description	Description	Sched. start
Q-3-MCC-NA-1313A	Q3-ISBS03AN13A-NA13AMCCNA1313A	400V MOTOR FEEDER LOC MCC5001A-SA6-BA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-NA-1313B	Q3-ISBS03BN13B-NA13BMCCNA1313B	400V MOTOR FEEDER LOC MCC5001B-SB3-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1302	Q3-ISBQ01-E12-P02-PM02MCCP1302	400V MOTOR FEEDER LOC MCC5001A-SA6-PA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1304	Q3-ISBQ02-E13-P04-PM04MCCP1304	400V MOTOR FEEDER LOC MCC5001B-SB3-JC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1305	Q3-ISBS01TK03-P05-PM05MCCP1305	400V MOTOR FEEDER LOC MCC5001A-SA4-KA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1306	Q3-ISBS01-N04-P06-PM06MCCP1306	400V MOTOR FEEDER LOC MCC5001B-SB6-PA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1308	Q3-ISBQ03-E14-P08-PM08MCCP1308	400V MOTOR FEEDER LOC MCC5001B-SB4-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1310	Q3-ISBQ04-E15-P10-PM10MCCP1310	400V MOTOR FEEDER LOC MCC5001A-SA5-PA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1311	Q3-ISBS02TK08-P11-PM11MCCP1311	400V MOTOR FEEDER LOC MCC5001B-SB3-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1313A	Q3-ISB-S03A-P1313A-MCC-P-1313A	400V MOTOR FEEDER LOC MCC5001A-SA5-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1313B	Q3-ISB-S03B-P1313B-MCC-P-1313B	400V MOTOR FEEDER LOC MCC5001B-SB4-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1314A	Q3-ISB-S03A-P1314A-MCC-P-1314A	400V MOTOR FEEDER LOC MCC5001A-SA5-CC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1918	Q3-ISBTK10-TK18-P1918MCC-P1918	400V MOTOR FEEDER LOC MCC5001B-SB2-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1922	Q3-ISBTK22-P22-PM1922MCC-P1922	400V MOTOR FEEDER LOC MCC5002B-SB6-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1923	Q3-ISBTK23-P23-PM1923MCC-P1923	400V MOTOR FEEDER LOC MCC5002A-SA2-EA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1924	Q3-ISBZ03P1924PM1924-MCC-P1924	400V MOTOR FEEDER LOC MCC5001B-SB2-CC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1971	Q3-ISBTK71-P71-PM1971MCC-P1971	400V MOTOR FEEDER LOC MCC5002A-SA2-MC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1972	Q3-ISBTK72-P72-PM1972MCC-P1972	400V MOTOR FEEDER LOC MCC5002B-SB6-LA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1973	Q3-ISBZ73P1973PM1973-MCC-P1973	400V MOTOR FEEDER LOC MCC5002A-SA2-MC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1974	Q3-ISBTK74-P74-PM1974MCC-P1974	400V MOTOR FEEDER LOC MCC5001A-SA6-CC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1975	Q3-ISBZ75P1975PM1975-MCC-P1975	400V MOTOR FEEDER LOC MCC5001A-SA6-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1976	Q3-ISBZ76P1976PM1976-MCC-P1976	400V MOTOR FEEDER LOC MCC5002A-SA2-PA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1978	Q3-ISBTK78-P78-PM1978MCC-P1978	400V MOTOR FEEDER LOC MCC5002A-SA2-PA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1701	Q3-ISBD01P1701PM1701-MCC-P1701	400V MOTOR FEEDER LOC MCC5001B-SB5-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1702	Q3-ISBD02TK01P02PM02-MCC-P1702	400V MOTOR FEEDER LOC MCC5001B-SB5-BA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1703	Q3-ISBD02S02P03-PM03-MCC-P1703	400V MOTOR FEEDER LOC MCC5001B-SB5-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1704	Q3-ISBD02S02P04-PM04-MCC-P1704	400V MOTOR FEEDER LOC MCC5001B-SB5-CC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1705	Q3-ISBTK07P05-PM1705-MCC-P1705	400V MOTOR FEEDER LOC MCC5001B-SB6-FC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1706	Q3-ISBTK07P06-PM1706-MCC-P1706	400V MOTOR FEEDER LOC MCC5001B-SB3-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1707	Q3-ISBD03P1707PM1707-MCC-P1707	400V MOTOR FEEDER LOC MCC5001B-SB5-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1708	Q3-ISBD03TK04P08PM08-MCC-P1708	400V MOTOR FEEDER LOC MCC5001B-SB5-EA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1709	Q3-ISBD03P1709PM1709-MCC-P1709	400V MOTOR FEEDER LOC MCC5001B-SB5-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1710	Q3-ISBD02S06P10-PM10-MCC-P1710	400V MOTOR FEEDER LOC MCC5001B-SB2-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1711	Q3-ISBD02S06P11-PM11-MCC-P1711	400V MOTOR FEEDER LOC MCC5001B-SB6-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-S-1301	Q3-ISB-S1301-SM-1301-MCC-S1301	400V MOTOR FEEDER LOC MCC5001A-SA3-MA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-S-1302	Q3-ISB-S1302-SM-1302-MCC-S1302	400V MOTOR FEEDER LOC MCC5001B-SB8-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-S-1303A	Q3-ISBS-1303A-SM1303AMCCS1303A	400V MOTOR FEEDER LOC MCC5001A-SA4-MA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-S-1303B	Q3-ISBS-1303B-SM1303BMCCS1303B	400V MOTOR FEEDER LOC MCC5001B-SB5-MC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1902A	Q3-ISB-D03P02A-PM02AMCCP1902A	400V MOTOR FEEDER LOC MCC5003A-SA1-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1902B	Q3-ISB-D03P02B-PM02BMCCP1902B	400V MOTOR FEEDER LOC MCC5003B-SB5-CC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1903A	Q3-ISBD04-P03A-PM03AMCC-P1903A	400V MOTOR FEEDER LOC MCC5003A-SA1-FC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1903B	Q3-ISBD04-P03B-PM03BMCC-P1903B	400V MOTOR FEEDER LOC MCC5003B-SB5-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1904	Q3-ISBTK04-P04-PM1904MCC-P1904	400V MOTOR FEEDER LOC MCC5001B-SB6-HA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1910A	Q3-ISBTK10P10APM10A-MCC-P1910A	400V MOTOR FEEDER LOC MCC5001A-SA6-SA01	2Y PM MCC feeder	13-06-2022

19 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-MCC-P-1910B	Q3-ISBTK10P10BPM10B-MCC-P1910B	400V MOTOR FEEDER LOC MCC5001B-SB3-MC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1913	Q3-ISBTK10-TK13-P1913MCC-P1913	400V MOTOR FEEDER LOC MCC5001B-SB6-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1915	Q3-ISBTK15-P15-PM1915MCC-P1915	400V MOTOR FEEDER LOC MCC5001B-SB3-BA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1916	Q3-ISBTK17-P16-PM1916MCC-P1916	400V MOTOR FEEDER LOC MCC5003B-SB5-EA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9301A	Q3-OSBTK01P01A-PM01AMCC-P9301A	400V MOTOR FEEDER LOC MCC5002A-SA1-MC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9301B	Q3-OSBTK01P01B-PM01BMCC-P9301B	400V MOTOR FEEDER LOC MCC5002B-SB6-QC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9303A	Q3-OSB-Z03P03A-PM03AMCC-P9303A	400V MOTOR FEEDER LOC MCC5002A-SA2-QC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9303B	Q3-OSB-Z03P03B-PM03B-CC-P9303B	400V MOTOR FEEDER LOC MCC5002B-SB5-SA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9304	Q3-OSBTK01Z04-P04PM04MCC-P9304	400V MOTOR FEEDER LOC MCC5002A-SA3-LA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9305A	Q3-OSBTK02P05A-PM05AMCC-P9305A	400V MOTOR FEEDER LOC MCC5003A-SA1-HA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-9305B	Q3-OSBTK02P05B-PM05BMCC-P9305B	400V MOTOR FEEDER LOC MCC5003B-SB4-CC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-9301A	Q3-OSBZ9301AZM-9301AMCC-Z9301A	400V MOTOR FEEDER LOC MCC5002A-SA4-MA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-9301B	Q3-OSBZ9301BZM-9301BMCC-Z9301B	400V MOTOR FEEDER LOC MCC5002A-SA4-KA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-9301C	Q3-OSBZ9301CZM-9301CMCC-Z9301C	400V MOTOR FEEDER LOC MCC5002B-SB3-MA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-Z-9302	Q3-OSB-Z-9302-MCC-Z-9302	400V POWER FEEDER LOC MCC5002A-SA4-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1314B	Q3-ISB-S03B-P1314B-MCC-P-1314B	400V MOTOR FEEDER LOC MCC5001B-SB4-FC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1315A	Q3-ISBS03AN13A-P15A-MCC-P1315A	400V MOTOR FEEDER LOC MCC5001A-SA5-QC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1315B	Q3-ISBS03BN13B-P15B-MCC-P1315B	400V MOTOR FEEDER LOC MCC5001B-SB5-JC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1316	Q3-ISBTK51P16-PM1316-MCC-P1316	400V MOTOR FEEDER LOC MCC5001A-SA5-SA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1317	Q3-ISBQ01-E02-P17-PM17MCC-P1317	400V MOTOR FEEDER LOC MCC5001B-SB2-JC01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1319A	Q3-ISBC01-TK15-P1319AMCC-P1319A	400V MOTOR FEEDER LOC MCC5001A-SA5-EA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1319B	Q3-ISBC01-TK15-P1319BMCC-P1319B	400V MOTOR FEEDER LOC MCC5001B-SB4-FC03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1320A	Q3-ISB-S03A-P1320A-MCC-P-1320A	400V MOTOR FEEDER LOC MCC5003A-SA1-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1320B	Q3-ISB-S03A-P1320B-MCC-P-1320B	400V MOTOR FEEDER LOC MCC5003B-SB5-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1321A	Q3-ISB-S03B-P1321A-MCC-P-1321A	400V MOTOR FEEDER LOC MCC5003A-SA1-BA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1321B	Q3-ISB-S03B-P1321B-MCC-P-1321B	400V MOTOR FEEDER LOC MCC5003B-SB5-BA02	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1331	Q3-ISBS02-N10-P31-PM31MCC-P1331	400V MOTOR FEEDER LOC MCC5001A-SA5-EA03	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1333A	Q3-ISBTK31-P33A-PM33AMCC-P1333A	400V MOTOR FEEDER LOC MCC5001A-SA3-BA01	2Y PM MCC feeder	13-06-2022
Q-3-MCC-P-1333B	Q3-ISBTK31-P33B-PM33BMCC-P1333B	400V MOTOR FEEDER LOC MCC5001B-SB7-BA01	2Y PM MCC feeder	13-06-2022
Q-2-AT-61-5301	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	29-06-2022
Q-2-AT-61-5101	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	29-06-2022
Q-2-AT-61-5301	Q2-OSB-6150	Phenol Recovery Section	(1M) Inspect, clean and Calb AYZ Hydr	29-06-2022
Q-3-P-9215B	Q3-OSB-Z-9200-TK-9201-P-9215B	SBR FEED PUMP	1Y- Replace Lube Oil 2Hr	24-06-2022
Q-3-P-9219B	Q3-OSB-Z-9200-TK-9204-P-9219B	DIVERSION TANK PUMP	1Y- Replace Lube Oil 2Hr	24-06-2022
Q-3-P-9220B	Q3-OSB-Z-9200-TK-9202B-P-9220B	SBR SLUDGE PUMP	1Y- Replace Lube Oil 2Hr	24-06-2022
Q-3-P-9221	Q3-OSB-Z-9200-TK-9205-P-9221	THICKENED SLUDGE PUMP	1Y- Replace Lube Oil 2Hr	24-06-2022
Q-3-P-9229B	Q3-OSB-Z-9200-TK-9203-P-9229B	EFFLUENT PUMP	1Y- Replace Lube Oil 2Hr	24-06-2022
Q-1-P-1301B	Q1-OC-D-V1302-P1301B	P-1301B-Flash Column Bottoms Pumps	4M- Replace lube oil 2Hr	27-06-2022
Q-1-XD-5001A	Q1-OSB-X5001-X5001A-XD5001A	XD-5001A-Emergency Diesel Engine Gen	1M-Greasing Universal JointL0.5Hr	27-06-2022
Q-1-P-1402B	Q1-FRC-V1401-P1402B	P-1402B-CrudeAcetoneColumnBottomsPump	4M- Replace lube oil 2Hr	27-06-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	20-06-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	20-06-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	20-06-2022
Q-1-OSB-PYL-PIP-4	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	20-06-2022

77 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Visual Inspection	20-06-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Visual Inspection	20-06-2022
Q-1-OSB-PHL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	20-06-2022
Q-1-OSB-ACL-PIP-TT	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	20-06-2022
Q-1-OSB-ACL-PIP-AC	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	20-06-2022
Q-1-OSB-PYL-PIP-4	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	20-06-2022
Q-1-OSB-BZL-PIP-AR	Q1-OSB	Phenol I - Outside Battery	(1M) Leak detection	20-06-2022
Q-1-OSB-CUM-PIP-PO	Q1-OSB-4100	Tank Gauging System	(1M) Leak detection	20-06-2022
Q-2-AT-21-0601A	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	29-06-2022
Q-2-AT-21-0601B	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	29-06-2022
Q-2-AT-21-0601C	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	29-06-2022
Q-2-AT-21-0601D	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(3M) Inspect and ChngFilter AYZ Mois	29-06-2022
Q-3-L-1605	Q3-ISB-L-1605	BPA SHIPPING CONVEYOR	RCM 1M PM Bucket conveyor.2.5Hr	24-06-2022
Q-3-C-9401	Q3-OSB-TK-9402-C-9401	REFRIGERATION COMPRESSOR	RCM 1M Oil analysis.1Hr	24-06-2022
Q-1-PM-4101B	Q1-OSB-TK4101A-P4101B-PM4101B	PM-4101B-Propylene Feed Pump	4M Motor Greasing	30-06-2022
Q-1-P-1207B	Q1-OC-D-OX1202-P1207B	P-1207B-Oxidizer No 2 Pumps	4M- Replace lube oil 2Hr	27-06-2022
Q-1-P-9104A	Q1-OSB-X9103-P9104A	P-9104A-CONTAMINATED WATER PUMP	1M Clean water flushing strainer	01-07-2022
Q-1-P-9103A	Q1-OSB-X9103-P9103A	P-9103A-First 20 MinuteFlushWaterPitPump	1M Clean water flushing strainer	01-07-2022
Q-2-C2201-OXIDIZER	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-CHARCOAL	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-DCS	Q2-OSB-5050	Electricity Distribution and Control	(6M) Change Filter for Console/Cabinet	21-06-2022
Q-2-DCS	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-DCS-HIS	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-DCS-MR	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-FGS	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-MMS	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-SIS	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-SIS-MR	Q2-OSB-5050	Electricity Distribution and Control	(6M) Cleaning Console & Cabinet	21-06-2022
Q-2-AT-66-5301	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	29-06-2022
Q-2-AT-66-5401	Q2-OSB-6650	Steam System and Condensate system	(1M) Inspect, clean and Calb AYZ Hydr	29-06-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	23-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	23-06-2022
Q-1-LT-41-0503	Q1-OSB-TK4106-LT410503	LT410503-TK-4106 Liq Level	6M Calibration (2 Man / 3 Hr.)	27-06-2022
Q-1-LT-41-0204	Q1-OSB-TK4102B-LT410204	LT410204-TK-4102B Liq Level	6M Calibration (2 Man / 3 Hr.)	27-06-2022
Q-1-LT-41-0201	Q1-OSB-TK4102A-LT410201	LT410201-TK-4102A Liq Level	6M Calibration (2 Man / 3 Hr.)	27-06-2022
Q-1-LT-41-0101	Q1-OSB-TK4101A-LT410101	LT410101-TK-4101A Level	6M Calibration (2 Man / 3 Hr.)	27-06-2022
Q-1-LT-41-0104	Q1-OSB-TK4101B-LT410104	LT410104-TK-4101B Level	6M Calibration (2 Man / 3 Hr.)	27-06-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	29-06-2022
Q-2-AT-22-2631	Q2-OC-D-2200	Phenol II Oxidation Oxidation Section	(2M) clean and Calb AYZ VOC	29-06-2022
Q-2-AT-23-1701	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	29-06-2022
Q-2-AT-23-1901	Q2-OC-D-2300	Phenol II Oxidation CDN Section	(1M) clean & Calb AYZ Sulfuric	29-06-2022
Q-1-FM-CCB-001	Q1-OSB-FMCCB001	FM-CCB-001-FM 200 at Control Bldg	2Y-Replace Battery	29-06-2022
Q-1-CO-SUB-001	Q1-OSB-COSUB001	CO-SUB-001-CO2 at Sub Bldg	2Y-Replace Battery	29-06-2022
Q-1-CO-WWT-001	Q1-OSB-COWWT001	CO-WWT-001-CO2 at WWT Control Bldg	2Y-Replace Battery	29-06-2022

78 of 88



Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-FM-ADM-001	Q1-OSB-FMADM001	FM-ADM-001-FM 200 at Admin Bldg	2Y-Replace Battery	29-06-2022
Q-1-FM-WWT-001	Q1-OSB-FMWWT001	FM-WWT-001 FM 200 at WWT Control Bldg	2Y-Replace Battery	29-06-2022
Q-1-P-1302B	Q1-OSB-D1304-P1302B	P-1302B-Decomposer Circulation Pumps	8M-Replace lube oil 2Hr	27-06-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	27-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	27-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	27-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	27-06-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	27-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	27-06-2022
Q-2-P-9104E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	20-06-2022
Q-2-P-9105E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	20-06-2022
Q-2-P-9108E	Q2-OSB-9100	Drainage and Effluent Treatment System	(3M) Re-Lubricant	20-06-2022
Q-2-FV-41-0332	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-FV-41-0602	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-FV-41-0603	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-FV-41-0701	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-FV-41-0703	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-LV-41-0101	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-LV-41-0104	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-PV-41-0701	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-TV-41-0531	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test CNTL Valve	27-06-2022
Q-2-LT-41-0531	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect, Cal&Func, Test Level Trans	27-06-2022
Q-1-CM-9132B	Q1-OSB-X9134-C9132B-CM9132B	CM-9132B-SBR Blower	2M Motor Greasing	29-06-2022
Q-1-CM-9132C	Q1-OSB-X9134-C9132C-CM9132C	CM-9132C-SBR Blower	2M Motor Greasing	29-06-2022
Q-1-CM-9132E	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	2M Motor Greasing	29-06-2022
Q-1-CM-9132F	Q1-OSB-X9134-C9132A-CM9132A	CM-9132A-SBR Blower	2M Motor Greasing	29-06-2022
Q-1-P-1303B	Q1-OSB-D1304-P1303B	P-1303B-Decomposer Product Pumps	8M-Replace lube oil 2Hr	27-06-2022
Q-1-PM-6103A	Q1-OSB-T6101-P6103A-PM6103A	PM-6103A-HP C/W Cir Pump	2M Motor Greasing	29-06-2022
Q-2-PM-2601A	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection Megger clean re-tighten	30-06-2022
Q-2-PM-2601B	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection Megger clean re-tighten	30-06-2022
Q-2-PM-2602A	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection Megger clean re-tighten	30-06-2022
Q-2-PM-2602B	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection Megger clean re-tighten	30-06-2022
Q-2-PM-2603A	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection Megger clean re-tighten	30-06-2022
Q-2-PM-2603B	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection Megger clean re-tighten	30-06-2022
Q-2-LP-2601	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection cleaning re-tighten	30-06-2022
Q-2-WR-2601	Q2-FRC-2600	HUEL MSHP Process Unit	(1Y) Inspection cleaning re-tighten	30-06-2022
Q-3-P-1971	Q3-ISB-TK-1971-P-1971	PHENOL DRAIN PUMP	6M-PM Vertical Pump, 1.5Hr	24-06-2022
Q-3-P-1974	Q3-ISB-TK-1974-P-1974	ACETONE DRAIN PUMP (ISBL)	6M-PM Vertical Pump, 1.5Hr	24-06-2022
Q-3-P-1978	Q3-ISB-TK-1978-P-1978	ACETONE DRAIN PUMP (TANKAGE AREA)	6M-PM Vertical Pump, 1.5Hr	24-06-2022
Q-3-P-1972	Q3-ISB-TK-1972-P-1972	ACETONE DRAIN PUMP	6M-PM Vertical Pump, 1.5Hr	24-06-2022
Q-2-FRD-20-0001A	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-FRD-20-0003A	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-FRD-20-0004A	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-FRD-20-0001B	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022

79 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-FRD-20-0002B	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-FRD-20-0003B	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-FRD-20-0004B	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-FRD-20-0005B	Q2-OSB-5050	Electricity Distribution and Control	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-FRD-20-0001A	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-2-FRD-20-0003A	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-2-FRD-20-0004A	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-2-FRD-20-0001B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-2-FRD-20-0002B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-2-FRD-20-0003B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-2-FRD-20-0004B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-2-FRD-20-0005B	Q2-OSB-5050	Electricity Distribution and Control	(2M) PM VESDA Visual Inspection	29-06-2022
Q-1-P-1116A	Q1-QMX-D1109-P1116A	P-1116A-DIPB COLUMN VACUUM PUMPS	2M-Greasing, 1Hr	27-06-2022
Q-1-P-9111B	Q1-OSB-TK9111-P9111B	P-9111B-BUFFER STORAGE PUMP	8M-Replace lube oil 2Hr	27-06-2022
Q-1-P-1408B	Q1-FRC-D1405-P1408B	P-1408B-Cumene-AMS Column Overhead Pumps	8M-Replace lube oil 2Hr	27-06-2022
Q-1-P-1412B	Q1-FRC-D1407-P1412B	P-1412B-CrudePhenolColumnSidecutPump	8M-Replace lube oil 2Hr	27-06-2022
Q-1-P-9181B	Q1-OSB-X9134-TK9132B-P9181B	P-9181B-Recirculation Pump	8M- PM Pump, 4Hr	27-06-2022
Q-1-TT-14-2901	Q1-FRC-D1412-TT142901	TT142901-Frac Sump	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-14-2201	Q1-FRC-D1407-E1416-TT142201	TT142201-IX Resin Treat Trim Exch Efflu.	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-14-1903	Q1-FRC-V1404-E1412-TT141903	TT141903-Crude Phenol Colm Reboils Retrm	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-TT-14-1804	Q1-FRC-V1404-V1405-TT141804	TT141804-Resid Strip Reboiler Return	4Y Calibration (1 Man / 3 Hr.)	29-06-2022
Q-1-PM-6204A	Q1-OSB-X6201-P6204A-PM6204A	PM-6204A-Refrigerator Lube Oil Pump	RCM-(6M) PM MOTOR	30-06-2022
Q-1-PM-6204B	Q1-OSB-X6201-P6204B-PM6204B	PM-6204B-Refrigerator Lube Oil Pump	RCM-(6M) PM MOTOR	30-06-2022
Q-2-CH-5151	Q2-OSB-5150	Instrument Air and Plant Air Systems	1Y-Load Test and Inspection	27-06-2022
Q-2-CH-6252	Q2-OSB-6250	Chilled Water System	1Y-Load Test and Inspection	27-06-2022
Q-3-W-1602	Q3-ISB-L-1605-TK-1604-W-1602	CONTAINER BACK FILL UNIT CHUTE	3M-PM container back fill, 2.5 Hr	24-06-2022
Q-3-CM-1201	Q3-ISBD01TK01-E06-C1201-CM1201	400V AC MOTOR FOR C-1201	RCM 6M PM AC motor(Visual Inspection)	20-06-2022
Q-1-FT-41-0206	Q1-OSB-TK4102A-X4107-FT410206	FT410206-Off-spec Ben Or Ben DIPB Flow	(4M) Inspect, prove and Calb Metering	29-06-2022
Q-1-PM-1102A	Q1-QMX-D1102-P1102A-PM1102A	PM-1102A-Propylene Charge Pump	2M Motor Greasing	30-06-2022
Q-1-FQI-71-0103	Q1-OSB00-D7101-X7101-FQI710103	FQI710103-RunA Natural Gas Metering Skid	1Y Calibrate Transmitter 4H	29-06-2022
Q-1-PVV-41-0901	Q1-OSB-TK4111-PVV410901	PVV410901-Diamine storage TK Breath vent	2W-Clean PVV, 2Hr	22-06-2022
Q-3-RV-1501	Q3-ISB-TK-1551-RV-1501	RV-1501 ROTARY VALVE	2M-Grease up, 1 Hr	24-06-2022
Q-3-RV-1602	Q3-ISB-L-1602-TK-1602-RV-1602	OFF-SPEC SILO EXIT ROTARY VALVE	2M-Grease up, 1 Hr	24-06-2022
Q-1-FQI-71-0107	Q1-OSB00-D7101-X7101-FQI710107	FQI710107-RunA Natural Gas Metering Skid	1Y Calibrate Transmitter 4H	29-06-2022
Q-1-FQI-71-0106	Q1-OSB00-D7101-X7101-FQI710106	FQI710106-RunB Natural Gas Metering Skid	1Y Calibrate Transmitter 4H	29-06-2022
Q-1-FQI-71-0104	Q1-OSB00-D7101-X7101-FQI710104	FQI710104-RunB Natural Gas Metering Skid	1Y Calibrate Transmitter 4H	29-06-2022
Q-1-AT-91-6401	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	(4M) clean and Calb AYZ PH	29-06-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filler	1M Inspect and Calb AYZ Hydr 4H	29-06-2022
Q-1-MOV-41-0501	Q1-OSB-D4104-P4105-MOV410501	MOV410501-OffSpec Ben Trick Load Shutloff	6M Inspect and Clean MOV (FF) 2H	30-06-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFLUENT DISTRIBUTION SYSTEM	(1M) clean and Calb COD AYZ	29-06-2022
Q-1-AT-91-1309	Q1-OSB-TK9121A-X9121B	X-9121B-INFLUENT DISTRIBUTION SYSTEM	(3M) Replace wiper blade COD AYZ	29-06-2022
Q-1-TK-4111	Q1-OSB-TK4111	TK-4111-000-Diamine Storage Tank	2W-Clean Emergency Manhole, 2Hr	22-06-2022
Q-2-P-2432B	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	22-06-2022
Q-2-P-2433A	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	22-06-2022

80 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-P-2433B	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	22-06-2022
Q-3-AT-9203B	Q3-OSB-Z9200TK9202B-AT-9203B	TK-9202B DISSOLVED OXYGEN ANALYZER	(2M) PM Analyzer Dissolved oxygen	29-06-2022
Q-3-AT-9203A	Q3-OSB-Z9200TK9202A-AT-9203A	TK-9202A DISSOLVED OXYGEN ANALYZER	(2M) PM Analyzer Dissolved oxygen	29-06-2022
Q-1-AT-66-1301	Q1-OSB00-TK6601-D6608-AT661301	AT661301-Carbon Filter	1M Inspect and Calb AYZ Hydr 4H	29-06-2022
Q-3-HS-060101	Q3-OSB-FIRE-SYS-01-HS-060101	HIGH-SENSITIVITY SMOKE DETECTOR L06 CCB	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-3-HS-060102	Q3-OSB-FIRE-SYS-01-HS-060102	HIGH-SENSITIVITY SMOKE DETECTOR L06 CCB	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-3-HS-060602	Q3-OSB-FIRE-SYS-01-HS-060602	HIGH-SENSITIVITY SMOKE DETECTOR L06 SUB	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-2-AT-24-1102	Q2-FRC-2400	Fractionation unit	(3M) Inspect, clean and Calb AYZ GC	29-06-2022
Q-1-PM-1111A	Q1-QMX-V1103-P1111A-PM1111A	PM-1111A-DIPB Colm Sidedraw Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1411B	Q1-FRC-D1407-P1411B-PM1411B	PM-1411B-Crude Phenol Colm Overhead Pump	4M Motor Greasing	30-06-2022
Q-1-AT-61-0601	Q1-OSB-T6101-P6102A-AT610601	AT610601-C/W Area Limestone Pit	(4M) clean and Calb AYZ PH	29-06-2022
Q-1-AT-61-0602	Q1-OSB-T6102-P6104A-AT610602	AT610602-C/W Area Limestone Pit	(4M) clean and Calb AYZ PH	29-06-2022
Q-1-PM-1201B	Q1-OSB-TK1201-P1201B-PM1201B	PM-1201B-Fresh Feed Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1106B	Q1-QMX-D1104-P1106B-PM1106B	PM-1106B-Benzene Colm Overhead Pump	4M Motor Greasing	30-06-2022
Q-1-PM-1203B	Q1-OSB-D1201-P1203B-PM1203B	PM-1203B-Combined Feed Pump	4M Motor Greasing	30-06-2022
Q-2-AT-24-1501	Q2-FRC-2400	Fractionation unit	(3M) Inspect, clean and Calb AYZ GC	29-06-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	24-06-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	24-06-2022
Q-3-W-1605	Q3-ISB-L-1602-W-1605	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine.1.5.Hr	24-06-2022
Q-3-W-1604	Q3-ISB-L-1604-W-1604	SILO MOBILE FLEXIBLE PACK	1M-PM Bagging Machine.1.5.Hr	24-06-2022
Q-3-W-1603	Q3-ISB-L-1605-TK-1604-W-1603	BPA BAGGING MACHINE	1M-PM Bagging Machine.1.5.Hr	24-06-2022
Q-1-VLP-00-001	Q1-OSB-FMCCB001-VLP00001	VLP-00-001 VESDA	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-1-VLP-00-002	Q1-OSB-6904	Firewater & Raw Water Sys. & Gas Detect.	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-1-VLP-00-001	Q1-OSB-FMCCB001-VLP00001	VLP-00-001 VESDA	(2M) PM VESDA Visual Inspection	29-06-2022
Q-1-VLP-00-002	Q1-OSB-6904	Firewater & Raw Water Sys. & Gas Detect.	(2M) PM VESDA Visual Inspection	29-06-2022
Q-1-AT-63-0101	Q1-OSB-TK6301-AT630101	AT630101-Tempered Water Return Line	(3M) Inspect and Calb AYZ Hydr 4H	29-06-2022
Q-2-AT-25-0601	Q2-FRC-2500	Phenol Recovery Section	(2M) Calb AYZ PH (FF)	29-06-2022
Q-2-AT-21-0901	Q2-QMX-2100	Phenol II QMAX Unit Q-Max Area	(2W) Inspect carrier Reagent/Consumable	29-06-2022
Q-3-P-9305B	Q3-OSB-TK-9302-P-9305B	POTABLE WATER TANK B	1Y- Replace Lube Oil .2Hr	24-06-2022
Q-3-P-9501A	Q3-OSB-Z-9501-P-9501A	FIRE WATER PUMP A	1Y-Routine Maintenance	29-06-2022
Q-3-P-9501B	Q3-OSB-Z-9501-P-9501B	FIRE WATER PUMP B	1Y-Routine Maintenance	24-06-2022
Q-3-P-9501C	Q3-OSB-Z-9501-P-9501C	FIRE WATER PUMP C	1Y-Routine Maintenance	24-06-2022
Q-3-P-1910B	Q3-ISB-TK-1910-P-1910B	STEAM CONDENSATE TRANSFER PUMP B	1Y- Replace Lube Oil .2Hr	24-06-2022
Q-3-P-1911B	Q3-ISB-TK-1915-P-1911B	TCW PUMP B	1Y- Replace Lube Oil .2Hr	24-06-2022
Q-1-C-9132A	Q1-OSB-X9134-C9132A	C-9132A-SBR BLOWER	1W-Belt Inspection	29-06-2022
Q-1-C-9132B	Q1-OSB-X9134-C9132B	C-9132B-SBR BLOWER	1W-Belt Inspection	29-06-2022
Q-1-C-9132C	Q1-OSB-X9134-C9132C	C-9132C-SBR BLOWER	1W-Belt Inspection	29-06-2022
Q-1-C-9132D	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-06-2022
Q-1-C-9132E	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-06-2022
Q-1-C-9132F	Q1-OSB-9101	Waste Water & Effluent Treatment X-9101	1W-Belt Inspection	29-06-2022
Q-2-FT-41-0104	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0132	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0133	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0134	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022

83 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-2-FT-41-0135	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0206	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0231	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0232	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0233	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0331	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-FT-41-0332	Q2-OSB-4100	Tank Gauging System	(2Y) Inspect,Cal&Func.Test Flow Trans	27-06-2022
Q-2-CM-5151A	Q2-OSB-5150	Instrument Air and Plant Air Systems	(3M) Replace filter	30-06-2022
Q-2-CM-5151B	Q2-OSB-5150	Instrument Air and Plant Air Systems	(3M) Replace filter	30-06-2022
Q-2-CM-5151C	Q2-OSB-5150	Instrument Air and Plant Air Systems	(3M) Replace filter	30-06-2022
Q-3-P-1316	Q3-ISB-TK-1351-P-1316	BLOWDOWN TANK PUMP	6M(Online)- Replace Lube Oil .2Hr	27-06-2022
Q-3-P-1904	Q3-ISB-TK-1904-P-1904	DRAIN RECEIVER PUMP	1M-PM Vertical Pump.2Hr	27-06-2022
Q-3-P-1809	Q3-ISB-TK-1805-P-1809	TAR DRAIN RECEIVER PUMP	1M-PM Vertical Pump.2Hr	27-06-2022
Q-3-P-1875	Q3-ISB-TK-1875-P-1875	TAR DRAIN RECEIVER PUMP (TANKAGE AREA)	1M-PM Vertical Pump.2Hr	27-06-2022
Q-3-CM-9601B	Q3-OSB-TK-9601-C-9601B-CM9601B	6.6KV AC MOTOR FOR C-9601B	2M Motor Greasing	27-06-2022
Q-3-AT-1912	Q3-ISB-TK-1910-P-1910A-AT-1912	TK-1910 OUTLET SCR TOC	1M PM Analyzer TOC	29-06-2022
Q-3-SM-1303B	Q3-ISB-S-1303B-SM-1303B	400V AC MOTOR FOR S-1303B	2M Motor Greasing	27-06-2022
Q-3-PM-9302B	Q3-OSB-Z-9301B-P-9302B-PM9302B	6.6KV AC MOTOR FOR P-9302B	2M Motor Greasing	27-06-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	1M PM Analyzer COD	29-06-2022
Q-3-PM-1910B	Q3-ISB-TK-1910-P-1910B-PM1910B	400V AC MOTOR FOR P-1910B	4M Motor Greasing	27-06-2022
Q-3-PM-1320A	Q3-ISB-S03A-P1320A-PM-1320A	400V AC MOTOR FOR P-1320A	4M Motor Greasing	27-06-2022
Q-3-PM-1321A	Q3-ISB-S03B-P1321A-PM-1321A	400V AC MOTOR FOR P-1321A	4M Motor Greasing	27-06-2022
Q-3-PM-9301B	Q3-OSB-TK-9301-P-9301B-PM9301B	400V AC MOTOR FOR P-9301B	4M Motor Greasing	27-06-2022
Q-3-SM-1303A	Q3-ISB-S-1303A-SM-1303A	400V AC MOTOR FOR S-1303A	2M Motor Greasing	27-06-2022
Q-3-AP-01	Q3-OSB-AP-01	400V AC UPS FOR INST SYS AND LOCAL PANEL	RCM-6M CHANGE AIR FILTER	27-06-2022
Q-3-AP-02	Q3-OSB-AP-02	230V AC UPS FOR ESD AND FGS PANEL	RCM-6M CHANGE AIR FILTER	27-06-2022
Q-3-AP-03	Q3-OSB-AP-03	125V DC POWER SUPPLY AND BATTERY CHARGER	RCM-6M CHANGE AIR FILTER	27-06-2022
Q-3-TR-5001	Q3-OSB-TR-5001	22KV/6.9KV 12.5MVA MAIN PWR TRANSFORMER	RCM-3M INSPECTION	27-06-2022
Q-3-TR-5002	Q3-OSB-TR-5002	22KV/6.9KV 12.5MVA MAIN PWR TRANSFORMER	RCM-3M INSPECTION	27-06-2022
Q-3-TR-5003A	Q3-OSB-TR-5003A	6.9KV/400V DIST TRANSFORMER/MCC-5001B	RCM-3M INSPECTION	27-06-2022
Q-3-TR-5003B	Q3-OSB-TR-5003B	6.9KV/400V DIST TRANSFORMER/MCC-5001A	RCM-3M INSPECTION	27-06-2022
Q-3-TR-5003C	Q3-OSB-TR-5003C	6.9KV/400V DIST TRANSFORMER/MCC-5002A	RCM-3M INSPECTION	27-06-2022
Q-3-TR-5003D	Q3-OSB-TR-5003D	6.9KV/400V DIST TRANSFORMER/MCC-5002B	RCM-3M INSPECTION	27-06-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(6M) Cleaning, Replace pump lube kits	29-06-2022
Q-3-AT-9204	Q3-OSB-TK9203-P9229A-AT-9204	P-9229A SAMPLE PH TRANSMITTE	(1M) Inspection & Cleaning	29-06-2022
Q-1-P-1103B	Q1-QMX-R1101-P1103B	P-1103B-AlkylationReactorEffluentRecyPum	8M-Replace lube oil 2Hr	27-06-2022
Q-1-P-1111B	Q1-QMX-V1103-P1111B	P-1111B-DIPB Column Sidedraw Pumps	8M-Replace lube oil 2Hr	27-06-2022
Q-1-P-1106B	Q1-QMX-D1104-P1106B	P-1106B-Benzene Column Overhead Pumps	8M-Replace lube oil 2Hr	27-06-2022
Q-1-TT-14-0501	Q1-OSB-TK1401A-X1401A-TT140501	TT140501-X-1401A/B Outlet	4Y Calibration (1 Man / 3 Hr.)	30-06-2022
Q-1-TT-14-0401	Q1-OSB-TK1401B-TT140401	TT140401-TK-1401B	4Y Calibration (1 Man / 3 Hr.)	30-06-2022
Q-1-TT-14-0301	Q1-OSB-TK1401A-TT140301	TT140301-TK-1401A	4Y Calibration (1 Man / 3 Hr.)	30-06-2022
Q-1-TT-11-0501	Q1-QMX-R1101-E1101-TT110501	TT110501-Alkyl Reac Feed Htr Outlet	4Y Calibration (1 Man / 3 Hr.)	30-06-2022
Q-1-P-1112B	Q1-QMX-D1106-P1112B	P-1112B-S3 SteamGeneratorCirculationPump	8M-Replace lube oil 2Hr	27-06-2022
Q-1-P-4123	Q1-OSB-TK4112A-P4123	P-4123-Off-Spec Phenol Pump	1Y-Replace lube oil.2Hr	27-06-2022

83 of 88

Equipment	Functional Loc.	Description	Description	Sched. start
Q-3-P-1206	Q3-ISB-TK-1251-P-1206	REACTOR BLOWDOWN TANK PUMP	6M(Online)- Replace Lube Oil 2Hr	27-06-2022
Q-3-ZM-9401	Q3-OSB-TK-9402-Z-9401-ZM-9401	6.6KV AC MOTOR FOR Z-9401	2M Motor Greasing	27-06-2022
Q-3-PM-9502B	Q3-OSB-Z-9501-P-9502B-PM-9502B	400V AC MOTOR FOR P-9502B	2M Motor Greasing	27-06-2022
Q-3-AT-1911	Q3-ISB-TK-1910-P-1910A-AT-1911	TK-1910 OUTLET SCR CONDUCTIVITY	(2M) PM Analyzer Conductivity	29-06-2022
Q-3-AT-9101	Q3-OSB-TK-9101-E-9101-AT-9101	STEAM CONDENSATE RETURN CONDUCTIVITY	(2M) PM Analyzer Conductivity	29-06-2022
Q-3-AT-9205	Q3-OSB-TK9203-P9229A-AT-9205	P-9229A CONDUCTIVITY ANALYZER	(2M) PM Analyzer Conductivity	29-06-2022
Q-3-P-9231	Q3-OSB-Z-9222-P-9231	2ND GREEN AREA PIT PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-9401B	Q3-OSB-TK-9401-P-9401B	DEMINERALIZED WATER PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-9402B	Q3-OSB-TK-9402-P-9402B	CHILLED WATER TRANSFER PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-9403	Q3-OSB-TK-9402-P-9403	GLYCOL TOP UP PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-9101B	Q3-OSB-TK-9101-P-9101B	CONDENSATE TRANSFER PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-9215B	Q3-OSB-Z-9200-TK-9201-P-9215B	SBR FEED PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-9220C	Q3-OSB-Z-9200-TK-9202B-P-9220C	SBR SLUDGE PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-9224B	Q3-OSB-Z-9200-TK-9207-P-9224B	NAOH DOSING PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-9225B	Q3-OSB-Z-9200-TK-9208-P-9225B	UREA DOSING PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-1320B	Q3-ISBS-1303A-TK-1321A-P-1320B	S-1303A LUBE OIL PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-1321B	Q3-ISBS-1303B-TK-1321B-P-1321B	S-1303B LUBE OIL PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-1333B	Q3-ISB-TK-1331-P-1333B	DILUTE CAUSTIC SODA SUPPLY PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-1405B	Q3-ISB-D-1401-TK-1405-P-1405B	D-1401 MECHANICAL SEAL PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-1406B	Q3-ISB-D-1401-TK-1406-P-1406B	D-1401 LOWER BEARING SEAL PUMP	6M Vibration Monitoring	28-06-2022
Q-3-P-1871B	Q3-ISB-TK-1871-P-1871B	50 WT% CAUSTIC TRANSFER PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-1872B	Q3-ISB-TK-1872-P-1872B	20 WT% CAUSTIC TRANSFER PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-1874B	Q3-ISB-TK-1874-P-1874B	0.2 WT% CAUSTIC TRANSFER PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-1910B	Q3-ISB-TK-1910-P-1910B	STEAM CONDENSATE TRANSFER PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-1911B	Q3-ISB-TK-1915-P-1911B	TCW PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-P-9302B	Q3-OSB-Z-9301B-P-9302B	COOLING WATER CIRC. PUMP B	6M Vibration Monitoring	28-06-2022
Q-3-AT-9302	Q3-OSB-Z-9302-AT-9302	Z-9302 ANALYZER CONDUCTIVITY	(2M) PM Analyzer Conductivity	29-06-2022
Q-1-LT-41-0401	Q1-OSB-TK4104-LT410401	LT410401-TK-4104 Liq Level	For PR. Internal Dip ATG 10 Tank TK-4163	29-06-2022
Q-2-TGD-20-0008	Q2-OSB-4100	Tank Gauging System	(6M) Open path cal & Lamp rep	29-06-2022
Q-2-TGD-20-0009	Q2-FRC-2400	Fractionation unit	(6M) Open path cal & Lamp rep	29-06-2022
Q-2-TGD-22-0001	Q2-OC2-2200	Phenol II Oxidation Oxidation Section	(6M) Open path cal & Lamp rep	29-06-2022
Q-2-TGD-22-0002	Q2-OC2-2200	Phenol II Oxidation Oxidation Section	(6M) Open path cal & Lamp rep	29-06-2022
Q-3-LCP-Z-9401	Q3-OSB-TK-9402-Z-9401	REFRIGERATE PACKAGE	RCM 6M-PM Local Panel	29-06-2022
Q-3-MCC-C-1201	Q3-ISBD01-TK01-E06-C01MCCC1201	400V MOTOR FEEDER LOC MCC5001B-SB2-EA01	RCM 6M-Thermographic Inspection	29-06-2022
Q-3-MCC-C-1801	Q3-ISBTK1300C01CM1801MCC-C1801	400V MOTOR FEEDER LOC MCC5001B-SB2-EA03	RCM 6M-Thermographic Inspection	29-06-2022
Q-3-MCC-L-1602	Q3-ISB-L1602-LM-1602-MCC-L1602	400V MOTOR FEEDER LOC MCC5002A-SA2-JC01	RCM 6M-Thermographic Inspection	29-06-2022
Q-3-MCC-S-1303B	Q3-ISBS-1303B-SM1303BMCCS1303B	400V MOTOR FEEDER LOC MCC5001B-SB5-MC01	RCM 6M-Thermographic Inspection	29-06-2022
Q-3-MCC-Z-9401	Q3-OSB-TK9402-Z-9401-MCC-Z9401	400V POWER FEEDER LOC MCC5002B-SB4-BA03	RCM 6M-Thermographic Inspection	29-06-2022
Q-1-AT-11-0901	Q1-QMX-R1102-AT110901	AT110901-Gas Chromatograph	(2W) Inspect carrier Reagent&Consumable	29-06-2022
Q-2-P-2434B	Q2-FRC-2400	Fractionation unit	(6M) Re-Lubricant	29-06-2022
Q-1-PM-1210A	Q1-OC2-D1205-P1210A-PM1210A	PM-1210A-Decenter Vent Scrubber Water P	6M PM AC motor(Visual Inspection)	30-06-2022
Q-2-X-5051	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	01-07-2022
Q-2-X-5052	Q2-OSB-5050	Electricity Distribution and Control	1W-CHECK ENGINE OIL LEVEL & FUEL TANK LE	01-07-2022
Q-1-C-6201	Q1-OSB-X6201-C6201	C-6201-COMPRESSOR	1M-Check N2 <(>&<)> Rotate Shaft spare C	25-07-2022

83 of 83

Equipment	Functional Loc.	Description	Description	Sched. start
Q-1-GD-11-0003	Q1-QMX-GD11-003	GD110003 Benzene Detector(Ultra REA3000)	6M Calibrate Portabel Gas DET.	25-01-2022
Q-3-GD-BA-0001	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-3-GD-BA-0002	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-3-GD-BA-0003	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-3-GD-BA-0004	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-3-GD-BA-0005	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-3-GD-BA-0006	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-3-GD-BA-0007	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-3-GD-BA-0008	Q3-OSB-BPA-PORTABLE-GAS-GROUP	GD-BA-0001 VOC Gas Detector ;MiniRAE	6M Calibrate Portable Gas DET	26-01-2022
Q-1-GD-91-0004	Q1-OSB-GD91-004	GD910004 Benzene Detector(Ultra REA3000)	6M Calibrate Portabel Gas DET.	26-01-2022
Q-1-GT-00-4206	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	30-03-2022
Q-1-GT-00-4207	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	30-03-2022
Q-1-GT-00-4208	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	30-03-2022
Q-3-Z-1602	Q3-ISB-L-1605-Z-1601-Z-1602	METAL DETECTOR	3Y Calibration (2 Man / 3 Hr.)	23-05-2022
Q-1-GT-00-4206	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	1Y Sensor Replace & Calibrate	28-06-2022
Q-1-GT-00-4207	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	1Y Sensor Replace & Calibrate	28-06-2022
Q-1-GT-00-4208	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	1Y Sensor Replace & Calibrate	28-06-2022
Q-1-GT-00-4206	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	28-06-2022
Q-1-GT-00-4207	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	28-06-2022
Q-1-GT-00-4208	Q1-OSB-GT1010XX	GT101001-Chlorine Detector No.1	3M Inspection & Calibrate	28-06-2022
Q-3-HS-060101	Q3-OSB-FIRE-SYS-01-HS-060101	HIGH-SENSITIVITY SMOKE DETECTOR L06 CCB	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-3-HS-060102	Q3-OSB-FIRE-SYS-01-HS-060102	HIGH-SENSITIVITY SMOKE DETECTOR L06 CCB	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022
Q-3-HS-060602	Q3-OSB-FIRE-SYS-01-HS-060602	HIGH-SENSITIVITY SMOKE DETECTOR L06 SUB	(6M) PM VESDA Clean, Cal, Back-up Prog	29-06-2022

84 of 83

ภาคผนวก ข.2-10

---

เอกสารขึ้นทะเบียนบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน

ที่ อก ๐๓๑๓/

๓ ๙ ๕ ๖



กรมโรงงานอุตสาหกรรม  
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท  
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๒ ๖ มีนาคม ๒๕๖๕

เรื่อง หนังสือรับแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน

เรียน ผู้รับใบอนุญาตประกอบกิจการโรงงาน บริษัท พีทีที ฟีนอล จำกัด

อ้างถึง คำขอเลขที่ ๐๓๗๑ ลงรับวันที่ ๑๗ มีนาคม ๒๕๖๔

ตามคำขอที่อ้างถึง ท่านแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ของ บริษัท พีทีที ฟีนอล จำกัด ทะเบียนผู้ประกอบการเลขที่ น.๔๒(๑)-๔/๒๕๕๑-ญหอ. ประกอบกิจการ ผลิตผลิตภัณฑ์หลัก ได้แก่ สารบิสฟีนอล เอ และผลิตภัณฑ์พลอยได้ ได้แก่ น้ำมันเบา ตะกอนหนักหรือทาร์ ตั้งอยู่ ณ เลขที่ ๙ ซอยจี-๙ ถนนปภังกรสงเคราะห์ราษฎร์ ตำบลมาบตาพุด อำเภอเมืองระยอง จังหวัดระยอง โทรศัพท์ ๐ ๓๘๖๔ ๓๘๐๐

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว รับแจ้งการให้บุคลากรด้านสิ่งแวดล้อมประจำโรงงาน และให้ท่านยื่นคำขอแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงานครั้งต่อไป ภายในวันที่ ๔ เมษายน ๒๕๖๗ โดยมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ดังนี้



**ภาคผนวก ข.2-11**

---

**ระเบียบปฏิบัติ เรื่อง วิธีปฏิบัติงาน Emergency Shutdown**























ภาคผนวก ข.2-12

---

สำเนาหนังสือคำสั่งและแบบรายงานปริมาณสารอินทรีย์ระเหย  
จากการรั่วซึมของอุปกรณ์ ประจำปี พ.ศ.2565



ที่ PPCL 1727/2565

## PTT Phenol Company Limited

Head Office : 555/1 Energy Complex, Building A,  
15<sup>th</sup> Floor, Vibhavadi Rangsit Road,  
Chatuchak, Chatuchak, Bangkok 10900  
Tel no. : +66 (0)2265-8400  
Fax no. : +66 (0)2265-8125

Rayong Office : 9 Soi G-9, Hemaraj Eastern Industrial Estate,  
Pakorn Songkhraorat Road, Tambon Map Ta Phut,  
Amphur Muang, Rayong 21150, Thailand  
Tel no. : +66 (0)3864-3901  
Fax no. : +66 (0)3864-3864

21 กรกฎาคม 2565

เรื่อง ขอสั่งมอบรายงานปริมาณสารอินทรีย์ระเหยจากโรงงานผลิตสารบิสฟีนอล เอ

เรียน ผู้อำนวยการสำนักงานนิคมอุตสาหกรรมดับบลิวเอชเอ ตะวันออก (มาบตาพุด)

เอกสารแนบ 1. แผนการดำเนินงานการตรวจวัดการรั่วซึมของสารอินทรีย์ระเหย  
2. รายงานตามแบบฟอร์ม แบบรายงานที่ 1 ของโรงงานผลิตสารบิสฟีนอล เอ  
ทะเบียนโรงงานเลขที่ น.42(1) -4/2551-ญหอ.


เพื่อให้เป็นไปตามประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนดหลักเกณฑ์ และวิธีการปฏิบัติ ในการตรวจสอบและควบคุมการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์ในโรงงานอุตสาหกรรม พ.ศ. 2555 และตามข้อ 3.2 ของประกาศกรมโรงงานอุตสาหกรรม เรื่อง การรายงานผลการตรวจวัดการรั่วซึม ของสารอินทรีย์ระเหยจากอุปกรณ์และการซ่อมแซมอุปกรณ์ในโรงงานอุตสาหกรรม พ.ศ. 2556 กำหนดให้มีการจัดส่งรายงานปริมาณสารอินทรีย์ระเหยจากโรงงานส่งให้หน่วยงานที่กำกับดูแลทุก 6 เดือนนั้น

เนื่องจากในช่วง 6 เดือนแรกของปี 2565 (มกราคม – มิถุนายน ) นั้น เป็นการดำเนินการจัดทำ แผนดำเนินการเพื่อให้สอดคล้องกับกฎหมายฉบับดังกล่าว โดยอ้างตามเอกสารแนบ 1 และจะสามารถ รายงานผลการดำเนินงานได้ในรอบการรายงานใน 6 เดือนหลังของปี 2565 (กรกฎาคม – ธันวาคม)


จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ

กบแก้ว  
22 ก.ค. 2565



ผู้จัดการสิ่งแวดล้อม  
บริษัท พีทีที ฟีนอล จำกัด





ที่ PPCL 1727/2565

## PTT Phenol Company Limited

Head Office : 555/1 Energy Complex, Building A,  
15<sup>th</sup> Floor, Vibhavadi Rangsit Road,  
Chatuchak, Chatuchak, Bangkok 10900  
Tel no. : +66 (0)2265-8400  
Fax no. : +66 (0)2265-8125

Rayong Office : 9 Soi G-9, Hemaraj Eastern Industrial Estate,  
Pakorn Songkhraorat Road, Tambon Map Ta Phut,  
Amphur Muang, Rayong 21150, Thailand  
Tel no. : +66 (0)3864-3901  
Fax no. : +66 (0)3864-3864

21 กรกฎาคม 2565


- เรื่อง ขอสั่งมอบรายงานปริมาณสารอินทรีย์ระเหยจากโรงงานผลิตสารบิสฟีนอล เอ
- เรียน ผู้อำนวยการสำนักงานนิคมอุตสาหกรรมดับบลิวเอชเอ ตะวันออก (มาบตาพุด)
- เอกสารแนบ 1. แผนการดำเนินงานการตรวจวัดการรั่วซึมของสารอินทรีย์ระเหย  
2. รายงานตามแบบฟอร์ม แบบรายงานที่ 1 ของโรงงานผลิตสารบิสฟีนอล เอ  
ทะเบียนโรงงานเลขที่ น.42(1) -4/2551-ญหอ.

เพื่อให้เป็นไปตามประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนดหลักเกณฑ์ และวิธีการปฏิบัติ ในการตรวจสอบและควบคุมการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์ใน โรงงานอุตสาหกรรม พ.ศ. 2555 และตามข้อ 3.2 ของประกาศกรมโรงงานอุตสาหกรรม เรื่อง การรายงานผลการตรวจวัดการรั่วซึม ของสารอินทรีย์ระเหยจากอุปกรณ์และการซ่อมแซมอุปกรณ์ใน โรงงานอุตสาหกรรม พ.ศ. 2556 กำหนดให้มีการจัดส่งรายงานปริมาณสารอินทรีย์ระเหยจากโรงงานส่งให้หน่วยงานที่กำกับดูแลทุก 6 เดือนนั้น

เนื่องจากในช่วง 6 เดือนแรกของปี 2565 (มกราคม – มิถุนายน) นั้น เป็นการดำเนินการจัดทำ แผนดำเนินการเพื่อให้สอดคล้องกับกฎหมายฉบับดังกล่าว โดยอ้างตามเอกสารแนบ 1 และจะสามารถ รายงานผลการดำเนินงานได้ในรอบการรายงานใน 6 เดือนหลังของปี 2565 (กรกฎาคม – ธันวาคม)

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ



ผู้จัดการสิ่งแวดล้อม  
บริษัท พีทีที ฟีนอล จำกัด





แผนการดำเนินงานตรวจวัด และจัดทำรายงาน VOCs emission inventory ประจำปี 2565 บริษัท พีทีที ฟีนอล จำกัด

[illegible]

ภาคผนวก ข.2-13

---

บันทึกข้อมูลการทำงานของระบบดักจับไอระเหยสารฟีนอลด้วยน้ำ  
และระบบดักจับไอระเหยสารอะซิโตนด้วยน้ำ



























































































## ภาคผนวก ข.2-14

---

เอกสารตัวอย่างผลการตรวจวัดคุณภาพน้ำเสีย  
ก่อนเข้าระบบบำบัดน้ำเสียที่ Equalization Tank และ  
ผลการตรวจวัดคุณภาพน้ำทิ้ง  
ภายหลังการบำบัดที่ Final Polishing Tank

Sampling Point	Sample Name (Description)	Sample (Status) Request ID	Parameter	Acetone	Ethyl Benzene	Phenol	4,4-BPA	SCOD	pH	Phosphorus	Nitrogen
			Unit	ppm	ppm	ppm	ppm	mg/L		mg/L	mg/L
<b>Specification: BP1-TK9201</b>				Report	<=300	<=600	Report	<=1500	04-Sep	-	-
SC9203	Equalization tank (TK-9201) (Equalization tank (TK-9201) (SCOD, pH))	<b>2206004043</b> <b>(Completed)</b>	03-06-22 13:00	24	≤ 1	317	≤ 1	935	7.45		
	Equalization tank (TK-9201)	<b>2206004781</b> <b>(Completed)</b>	03-06-22 21:00	30	≤ 1	272	≤ 1				
	Equalization tank (TK-9201)	<b>2206005795</b> <b>(Completed)</b>	04-06-22 13:00	31	≤ 1	237	≤ 1				
	Equalization tank (TK-9201)	<b>2206006401</b> <b>(Completed)</b>	04-06-22 21:00	28	≤ 1	188	≤ 1				
Rev No.1 (1/1/2016 12:00:00 AM)											



Sampling Point	Sample Name (Description)	Sample (Status) Request ID	Parameter	Acetone	Ethyl Benzene	Phenol	4,4-BPA	TCOD	pH	TDS	TSS
			Unit	ppm	ppm	ppm	ppm	mg/L		mg/L	mg/L
Specification: BP1-TK9203				Report	<5	<=1	Report	<=750	5.5-9	<=3000	<=200
SC9204	Effluent tank (TK-9203)	2206000387 (Completed)	01-06-22 15:00	≤ 1	≤ 1	≤ 1	≤ 1	19	7.94	304	23
	Effluent tank (TK-9203)	2206002340 (Completed)	02-06-22 15:00	≤ 1	≤ 1	≤ 1	≤ 1	25	8.04	406	
	Effluent tank (TK-9203)	2206004160 (Completed)	03-06-22 15:00	≤ 1	≤ 1	≤ 1	≤ 1	41	7.98	460	
	Effluent tank (TK-9203)	2206005874 (Completed)	04-06-22 15:00	≤ 1	≤ 1	≤ 1	≤ 1	11	8.19	660	
Rev No.1 (1/1/2016 12:00:00 AM)											

ภาคผนวก ข.2-15

---

เอกสารตัวอย่างผลการตรวจวัดน้ำฝนปนเปื้อนของโครงการ

Sample Name (Description)	Sample (Status)  Request ID	Parameter	Acetone	Ethyl Benzene	Phenol	4,4-BPA	TCOD	pH
		Units	ppm	ppm	ppm	ppm	mg/L	
		Specification  (BP1-TK9203)	Report	<5	<=1	Report	<=750	5.5-9
Z-9208  Note: Check component Z-9208	2206041774 (Completed)  I-BPA-2206-002747	24-06-22 9:00	≤ 1	≤ 1	≤ 1	≤ 1	41	7.94

**ภาคผนวก ข.2-16**

---

**เอกสารตัวอย่างผลการตรวจวัดคุณภาพน้ำทิ้ง  
ในถังเติมอากาศแบบ SBR (TK-9202 A/B)  
ก่อนระบายน้ำไปยัง Final Polishing Tank**

Sampling Point	Sample Name (Description)	Sample (Status)	Parameter	Acetone	Ethyl Benzene	Phenol	4,4-BPA	SVI	SV30	MLSS	MLSS	Mixed Liquor Suspended Solids	MLVSS	F/M Ratio
		Request ID	Unit	ppm	ppm	ppm	ppm	mL/g	mL/L	mg/L	mg/L	mg/L	mg/L	KgCOD/KgMLSS
Specification: BP1-TK9202A				Report	<5	<=1	Report	<=250	Report	-	-	2500-4000	-	0.1-0.25
Specification: BP1-RPD				-	-	-	-	-	-	-	-	-	-	-
TK-9202A	SBR A tank (SBR A tank Aeration Step)	2204053381 (Completed)	01-05-22 5:50	≤ 1	≤ 1	≤ 1	≤ 1		520					
	SBR A tank (SBR A tank Aeration Step)	2205000780 (Completed)	01-05-22 17:50	≤ 1	≤ 1	≤ 1	≤ 1		690					
	SBR A tank (SBR A tank Aeration Step)	2205001435 (Completed)	02-05-22 5:50	≤ 1	≤ 1	≤ 1	≤ 1		660					
	SBR A tank (CAL MLSS for 9202A)	2205002435 (Completed)	02-05-22 9:00							3700	3780			
	SBR A tank (SBR A tank Aeration Step-Full Test)	2205002684 (Completed)	02-05-22 17:50	≤ 1	≤ 1	≤ 1	≤ 1	213.1	750				3520	
Rev No.3 (10/3/2019 12:00:00 AM)														

ภาคผนวก ข.2-17

---

แผนผังระบบระบายน้ำ  
ของโครงการโรงงานผลิตสารบิสฟีนอล เอ



ภาคผนวก ข.2-18

---

ระเบียบปฏิบัติ เรื่อง การปฏิบัติงานหน่วยบำบัดน้ำเสีย



































ภาคผนวก ข.2-19

---

สำเนาหนังสือขอความร่วมมือเรื่องการควบคุมการขนส่ง





## บริษัท พีทีที ฟีนอล จำกัด

บริษัทในกลุ่ม ปตท.

ธนาคารพาณิชย์ จำกัด (มหาชน) ชั้น 4

555/1 ถนนวิภาวดีรังสิต แขวงจตุจักร เขตจตุจักร กรุงเทพฯ 10900

โทรศัพท์ : +66(0) 2140-3600-3 โทรสาร : +66(0) 2140-3611

ที่ บล 075/2557

27 ตุลาคม 2557

เรื่อง ขอนแจ้งประกาศฉบับใหม่ ของการนิคมอุตสาหกรรมแห่งประเทศไทย

เรียน บริษัท ชีมคอบชัย สกัดที่ ออชท์ จำกัด

สิ่งที่แนบมาด้วย 1.ประกาศการนิคมอุตสาหกรรมแห่งประเทศไทย ที่ 67/2557

2.ประกาศการนิคมอุตสาหกรรมแห่งประเทศไทย ที่ 68/2557

ด้วยบริษัท พีทีที ฟีนอล จำกัด ได้รับการแจ้งจาก การนิคมอุตสาหกรรมแห่งประเทศไทย(กนอ.)

ได้ออกประกาศนินิคมอุตสาหกรรม จำนวน 2 ฉบับ ดังนี้ โดยมีประกาศที่เกี่ยวข้องกับบริษัทของท่าน คือ ประกาศ ที่ 68/2557 เรื่อง การควบคุมการจราจรในกลุ่มนิคมอุตสาหกรรมและท่าเรืออุตสาหกรรมพื้นที่ มาตาปุด โดยมีสาระสำคัญดังนี้

1. กำหนดความเร็วของยานพาหนะในพื้นที่โดยแยกประเภทของยานพาหนะ

2. รถตู้ รถบัส ห้ามความเร็วไม่เกิน 80 กม./ชม.

3. รถบรรทุก รถบรรทุกหัวขึ้นตราอ รถตู้บรรทุก รถพ่วง รถขนอุปกรณ์พิเศษ ความเร็วไม่เกิน 45 กม./ชม. และห้ามเข้าในชม.เร่งด่วน (07.00-08.00 น. และ 16.30-17.30 น.)

4. กำหนดแนวปฏิบัติเมื่อเกิดอุบัติเหตุทางการจราจร

5. คัดกรองแจ้ง ชนิด ประเภท หมายเลขทะเบียน ชื่อผู้ขับขี่ หรือผู้ครอบครอง และสถานที่ปฏิบัติงาน ประจำ มาถึง กนอ. ในส่วนที่เป็นรถขนส่งวัตถุอันตราย

โดยมีผลบังคับใช้ตั้งแต่วันที่ 17 กรกฎาคม 2557 เป็นต้นไป บริษัท PTT Phenol Company Limited

ให้ท่านปฏิบัติตามประกาศของการนิคมอุตสาหกรรมแห่งประเทศไทยดังกล่าว และพร้อมกันนี้ให้ท่านส่งรายละเอียดตามข้อ 5 เพื่อบริษัทฯ จะได้ทำการรวบรวมและจัดส่งการนิคมอุตสาหกรรมแห่งประเทศไทยต่อไป อนึ่งถ้าพบว่าไม่มีการปฏิบัติตามทางบริษัทฯ ขอสงวนสิทธิ์ในการเข้ามารับผิดชอบ

จึงขอมอบข้อปฏิบัติตามประกาศดังกล่าว

ขอแสดงความนับถือ



ผู้จัดการฝ่ายรับส่งผลิตภัณฑ์

บริษัท PTT Phenol Company Limited