



ภาคผนวก ข

เอกสารรายงานผลวิเคราะห์



ภาคผนวก ข-1

คุณภาพน้ำทิ้ง

ANALYSIS REPORT

PROJECT NAME	: โครงการ EASE พระราม 2	RECEIVED DATE	: JANUARY 25, 2022
CUSTOMER NAME	: EASE RAMA 2 JURISTIC PERSON	ANALYTICAL DATE	: JANUARY 25 - FEBRUARY 2, 2022
ADDRESS	: 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150	REPORT NO.	: 2022-U008859
CONTACT INFORMATION	: TEL : 0 2417 1190 e-mail : era@th.knightfrank.com	WORK NO.	: 2021-007371
SAMPLING SOURCE	: WASTEWATER TREATMENT PLANT OF BUILDING A	ANALYSIS NO.	: T22AB388-0001, T22AB388-0003
SAMPLE TYPE	: WASTEWATER		
SAMPLING DATE	: JANUARY 25, 2022		
SAMPLING TIME	: 1/		
SAMPLING METHOD	: GRAB, GRAB AND STERILE TECHNIQUE		
SAMPLING BY	: MR WEERAYUT MOKKAEW		
ANALYZED BY	: MISS AMONRAT PUTTALEE		

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 13:30 HOUR 1/ T22AB388-0001	2 13:25 HOUR 1/ T22AB388-0003		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.3 (30°C)	5.7 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	66.6	6.4	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	167	21.8	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	371	658	500*	25
SETTLABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	0.4	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	80.0	12.8	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 13:30 HOUR 1/ T22AB388-0001	2 13:25 HOUR 1/ T22AB388-0003		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	1,300	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	2,400	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/CLEAR		
SEDIMENT			YELLOW	BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.


RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร A

RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร A

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.



FEBRUARY 9, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING B
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JANUARY 25, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALEE

RECEIVED DATE : JANUARY 25, 2022
ANALYTICAL DATE : JANUARY 25 - FEBRUARY 2, 2022
REPORT NO. : 2022-U008860
WORK NO. : 2021-007371
ANALYSIS NO. : T22AB388-0002, T22AB388-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 13:20 HOUR 1/ T22AB388-0002	2 13:15 HOUR 1/ T22AB388-0004		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	6.5 (30°C)	6.5 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	59.1	7.8	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	134	24.4	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	408	478	500*	25
SETTLABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	0.5	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	21.3	< LOQ	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 13:20 HOUR 1/ T22AB388-0002	2 13:15 HOUR 1/ T22AB388-0004		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221E)	160,000	7,900	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221B)	160,000	7,900	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID		
SEDIMENT			YELLOW	YELLOW		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร B


RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร B

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

< LOQ : < LEVEL OF QUANTITATION (TOTAL KJELDAHL NITROGEN ≥ 1.5 AND < 5.0 mg/L).



FEBRUARY 9, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : -
SAMPLE TYPE : WATER SUPPLY
SAMPLING DATE : JANUARY 25, 2022
SAMPLING TIME : 13:35 HOUR
SAMPLING METHOD ^c : GRAB
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPIMOL WAENTHONG

RECEIVED DATE : JANUARY 25, 2022
ANALYTICAL DATE : JANUARY 25-29, 2022
REPORT NO. : 2022-U008865
WORK NO. : 2021-007371
ANALYSIS NO. : T22AB388-0007

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ก๊อมน้ำใช้ในโครงการ T22AB388-0007	
TOTAL DISSOLVED SOLIDS ^b	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: 2540 C)	167	25
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

FEBRUARY 9, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING A
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : FEBRUARY 22, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALEE

RECEIVED DATE : FEBRUARY 22, 2022
ANALYTICAL DATE : FEBRUARY 22 - MARCH 1, 2022
REPORT NO. : 2022-U015947
WORK NO. : 2021-007371
ANALYSIS NO. : T22AD225-0001, T22AD225-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:30 HOUR 1/ T22AD225-0001	2 14:15 HOUR 1/ T22AD225-0003		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.2 (30°C)	5.4 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	20.1	15.7	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	40.4	23.9	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	338	670	500*	25
SETTLEABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	< 0.1	0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	50.4	6.3	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:30 HOUR 1/ T22AD225-0001	2 14:15 HOUR 1/ T22AD225-0003		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	220	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	13,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID		
SEDIMENT			BROWN	BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร A

RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร A

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

MARCH 9, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING B
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : FEBRUARY 22, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALEE

RECEIVED DATE : FEBRUARY 22, 2022
ANALYTICAL DATE : FEBRUARY 22 - MARCH 1, 2022
REPORT NO. : 2022-U015948
WORK NO. : 2021-007371
ANALYSIS NO. : T22AD225-0002, T22AD225-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:10 HOUR 1/ T22AD225-0002	2 14:25 HOUR 1/ T22AD225-0004		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	6.4 (30°C)	6.4 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	41.5	8.8	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	114	22.0	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	412	528	500*	25
SETTLABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	2.5	0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	20.0	6.1	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	3	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1	2		
			14:10 HOUR 1/ T22AD225-0002	14:25 HOUR 1/ T22AD225-0004		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221E)	3,900	140	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221B)	>160,000	13,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID		
SEDIMENT			BROWN	BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.


RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร B

RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร B

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED (TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.



MARCH 9, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING B
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MARCH 29, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALEE

RECEIVED DATE : MARCH 29, 2022
ANALYTICAL DATE : MARCH 29 - APRIL 6, 2022
REPORT NO. : 2022-U026658
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG018-0001 - T22AG018-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:05 HOUR 1/ T22AG018-0001	2 14:00 HOUR 1/ T22AG018-0002		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	6.9 (30°C)	6.7 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	155	17.2	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	184	30.2	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	340	460	500*	25
SETTLEABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	0.7	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	38.9	6.1	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3
MICROBIOLOGY						
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	24,000	-	1.8



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:05 HOUR 1/ T22AG018-0001	2 14:00 HOUR 1/ T22AG018-0002		
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	24,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID		
SEDIMENT			BROWN	BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร B

RESULT 2 : ปอดักน้ำทั้งระบบบำบัดน้ำเสีย อาคาร B

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

APRIL 12, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : -
SAMPLE TYPE : WATER SUPPLY
SAMPLING DATE : MARCH 29, 2022
SAMPLING TIME : 14:10 HOUR
SAMPLING METHOD^c : GRAB
SAMPLING BY^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPIMOL WAENTHONG
RECEIVED DATE : MARCH 29, 2022
ANALYTICAL DATE : MARCH 29 -31, 2022
REPORT NO. : 2022-U026662
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG018-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ก๊อปปี้ใช้ในโครงการ T22AG018-0005	
TOTAL DISSOLVED SOLIDS ^b	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: 2540 C)	163	25
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

APRIL 12, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING A
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MARCH 31, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR SUKSAN BOONLEANG
ANALYZED BY : MISS AMONRAT PUTTALAE

RECEIVED DATE : MARCH 31, 2022
ANALYTICAL DATE : MARCH 31 - APRIL 7, 2022
REPORT NO. : 2022-U026280
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG174-0001 - T22AG174-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 16:30 HOUR 1/ T22AG174-0001	2 16:20 HOUR 1/ T22AG174-0002		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.3 (33°C)	6.0 (34°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	188	16.5	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	170	34.4	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	790	1,438	500*	25
SETTLEABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	0.1	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	98.3	< LOQ	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 16:30 HOUR 1/ T22AG174-0001	2 16:20 HOUR 1/ T22AG174-0002		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	>160,000	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	>160,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID SEDIMENT			YELLOW/TURBID BROWN	YELLOW/TURBID BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร A


RESULT 2 : ปอดักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร A

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

< LOQ : < LEVEL OF QUANTITATION (TOTAL KJELDAHL NITROGEN ≥ 1.5 AND < 5.0 mg/L).



APRIL 18, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING A
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : APRIL 26, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALAE

RECEIVED DATE : APRIL 26, 2022
ANALYTICAL DATE : APRIL 26 - MAY 11, 2022
REPORT NO. : 2022-U034370
WORK NO. : 2021-007371
ANALYSIS NO. : T22AH843-0001, T22AH843-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:50 HOUR 1/ T22AH843-0001	2 14:45 HOUR 1/ T22AH843-0003		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.3 (30°C)	6.5 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	160	17.0	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	452	24.0	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	339	781	500*	25
SETTLABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	30.0	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	0.79	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	103	13.5	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	3	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:50 HOUR 1/ T22AH843-0001	2 14:45 HOUR 1/ T22AH843-0003		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	4,900	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	4,900	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID SEDIMENT			YELLOW/TURBID BROWN	YELLOW/CLEAR BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร A

RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร A

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

MAY 13, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING B
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : APRIL 26, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALEE

RECEIVED DATE : APRIL 26, 2022
ANALYTICAL DATE : APRIL 26 - MAY 11, 2022
REPORT NO. : 2022-U034371
WORK NO. : 2021-007371
ANALYSIS NO. : T22AH843-0002, T22AH843-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:40 HOUR 1/ T22AH843-0002	2 14:35 HOUR 1/ T22AH843-0004		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.2 (30°C)	6.2 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	78.2	15.2	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	98.0	27.0	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	360	414	500*	25
SETTLABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	5.0	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	48.7	5.9	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 14:40 HOUR 1/ T22AH843-0002	2 14:35 HOUR 1/ T22AH843-0004		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	3,300	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	4,900	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/CLEAR		
SEDIMENT			BROWN	BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.


RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร B

RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร B

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED (TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.



MAY 13, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING A
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MAY 24, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALEE

RECEIVED DATE : MAY 24, 2022
ANALYTICAL DATE : MAY 24-31, 2022
REPORT NO. : 2022-U041866
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ832-0001, T22AJ832-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 13:30 HOUR 1/ T22AJ832-0001	2 13:25 HOUR 1/ T22AJ832-0003		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.3 (30°C)	5.7 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	283	36.5	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	484	53.5	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	430	853	500*	25
SETTLABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	18.0	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	99.4	12.6	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	7	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1	2		
			13:30 HOUR 1/ T22A832-0001	13:25 HOUR 1/ T22A832-0003		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	54,000	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	54,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID		
SEDIMENT			BROWN	YELLOW		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร A

RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร A

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

JUNE 13, 2022

ANALYSIS REPORT

PROJECT NAME	: โครงการ EASE พระราม 2	RECEIVED DATE	: MAY 24, 2022
CUSTOMER NAME	: EASE RAMA 2 JURISTIC PERSON	ANALYTICAL DATE	: MAY 24-31, 2022
ADDRESS	: 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150	REPORT NO.	: 2022-U041867
CONTACT INFORMATION	: TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com	WORK NO.	: 2021-007371
SAMPLING SOURCE	: WASTEWATER TREATMENT PLANT OF BUILDING B	ANALYSIS NO.	: T22AJ832-0002, T22AJ832-0004
SAMPLE TYPE	: WASTEWATER		
SAMPLING DATE	: MAY 24, 2022		
SAMPLING TIME	: 1/		
SAMPLING METHOD	: GRAB, GRAB AND STERILE TECHNIQUE		
SAMPLING BY	: MR WEERAYUT MOKKAEW		
ANALYZED BY	: MISS AMONRAT PUTTALEE		

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 13:15 HOUR 1/ T22AJ832-0002	2 13:20 HOUR 1/ T22AJ832-0004		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.1 (30°C)	6.4 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	181	15.0	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	161	16.9	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	394	486	500*	25
SETTLEABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	10.0	< 0.1	≤ 0.5	0.1
SULPHIDE ^c	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	ND	ND	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	45.0	< LOQ	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1	2		
			13:15 HOUR 1/ T22A832-0002	13:20 HOUR 1/ T22A832-0004		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	11,000	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	11,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID		
SEDIMENT			YELLOW	YELLOW		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร B


RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร B

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

< LOQ : < LEVEL OF QUANTITATION (TOTAL KJELDAHL NITROGEN ≥ 1.5 AND < 5.0 mg/L).



JUNE 13, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING A
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JUNE 21, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALAE
RECEIVED DATE : JUNE 22, 2022
ANALYTICAL DATE : JUNE 22 - JULY 1, 2022
REPORT NO. : 2022-U051975
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM103-0001 - T22AM103-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 15:25 HOUR 1/ T22AM103-0001	2 15:20 HOUR 1/ T22AM103-0002		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.4 (31°C)	6.7 (30°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	55.8	21.4	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	912	19.4	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	690	740	500*	25
SETTLEABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	< 0.1	< 0.1	≤ 0.5	0.1
SULPHIDE ^b	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	< 0.50	< 0.50	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	60.2	< LOQ	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 15:25 HOUR 1/ T22AM103-0001	2 15:20 HOUR 1/ T22AM103-0002		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	>160,000	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	>160,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID SEDIMENT			YELLOW/TURBID BROWN	YELLOW/TURBID BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร A


RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร A

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.

< LOQ : < LIMIT OF QUANTITATION (TOTAL KJELDAHL NITROGEN ≥ 1.5 AND < 5.0 mg/L).



JULY 7, 2022

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT OF BUILDING B
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JUNE 28, 2022
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS AMONRAT PUTTALEE

RECEIVED DATE : JUNE 28, 2022
ANALYTICAL DATE : JUNE 28-JULY 7, 2022
REPORT NO. : 2022-U053813
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM733-0001 - T22AM733-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1 13:15 HOUR 1/ T22AM733-0001	2 13:20 HOUR 1/ T22AM733-0002		
pH ^a	-	ELECTROMETRIC METHOD AT SITE (SM:4500-H ⁺ B)	7.6 (31°C)	7.8 (31°C)	5-9	-
BIOCHEMICAL OXYGEN DEMAND ^c	mg/L	AZIDE MODIFICATION METHOD (SM: 4500-O C AND 5210 B)	155	29.5	≤ 30	2.0
SUSPENDED SOLIDS ^a	mg/L	SUSPENDED SOLIDS DRIED AT 103-105 °C (SM: 2540 D)	292	59.7	≤ 40	5.0
TOTAL DISSOLVED SOLIDS ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAO.007 (TOTAL DISSOLVED SOLIDS DRIED AT 103-105 °C); SM 2540 C	324	322	500*	25
SETTLABLE SOLIDS ^c	mL/L	IMHOFF CONE (SM: 2540 F)	13.0	0.1	≤ 0.5	0.1
SULPHIDE ^b	mg/L	IODOMETRIC METHOD (SM: 4500-S ²⁻ F)	< 0.50	< 0.50	≤ 1.0	0.50
TOTAL KJELDAHL NITROGEN ^b	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: 4500-Norg C	82.9	58.0	≤ 35	1.5
FAT, OIL AND GREASE ^a	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: 5520 B)	ND	ND	≤ 20	3



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT
			1	2		
			13:15 HOUR 1/ T22AM733-0001	13:20 HOUR 1/ T22AM733-0002		
MICROBIOLOGY						
FAECAL COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 E)	>160,000	17,000	-	1.8
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>160,000	54,000	-	1.8
SAMPLE CONDITION						
WATER'S COLOUR/TURBID SEDIMENT			YELLOW/TURBID BROWN	YELLOW/TURBID BROWN		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

IN-HOUSE : BASED ON STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.


RESULT 1 : ส่วนแยกกากของระบบบำบัดน้ำเสีย อาคาร B

RESULT 2 : บ่อพักน้ำทิ้งระบบบำบัดน้ำเสีย อาคาร B

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS B, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 122, PART 125 D, DATED DECEMBER 29, 2005.

500* : PERMITTED EXCESS VALUE TO TOTAL DISSOLVED SOLIDS OF ACTUAL TAP WATER USED
(TOTAL DISSOLVED SOLIDS STANDARD VALUE OF TAP WATER QUALITY IS 1,000 mg/L).

ND : NON-DETECTABLE.



JULY 14, 2022



ภาคผนวก ข-2

คุณภาพน้ำในสระว่ายนํ้า

ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 6, 2022
SAMPLING TIME : 13:45 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JANUARY 6, 2022
ANALYTICAL DATE : JANUARY 6-9, 2022
REPORT NO. : 2022-U002173
WORK NO. : 2021-007371
ANALYSIS NO. : T22AA173-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AA173-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIEMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



JANUARY 18, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 6, 2022
SAMPLING TIME : 13:50 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JANUARY 6, 2022
ANALYTICAL DATE : JANUARY 6-9, 2022
REPORT NO. : 2022-U002175
WORK NO. : 2021-007371
ANALYSIS NO. : T22AA173-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AA173-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIEMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



JANUARY 18, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 11, 2022
SAMPLING TIME : 13:35 HOUR
SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE
SAMPLING BY ° : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JANUARY 11, 2022
ANALYTICAL DATE : JANUARY 11-17, 2022
REPORT NO. : 2022-U004563
WORK NO. : 2021-007371
ANALYSIS NO. : T22AA476-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALOW ZONE) T22AA476-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JANUARY 25, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 11, 2022
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JANUARY 11, 2022
ANALYTICAL DATE : JANUARY 11-17, 2022
REPORT NO. : 2022-U004564
WORK NO. : 2021-007371
ANALYSIS NO. : T22AA476-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AA476-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JANUARY 25, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 18, 2022
SAMPLING TIME : 12:55 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : JANUARY 18, 2022
ANALYTICAL DATE : JANUARY 18-24, 2022
REPORT NO. : 2022-U006734
WORK NO. : 2021-007371
ANALYSIS NO. : T22AA975-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALOOV ZONE) T22AA975-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

FEBRUARY 2, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 18, 2022
SAMPLING TIME : 13:00 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JANUARY 18, 2022
ANALYTICAL DATE : JANUARY 18-24, 2022
REPORT NO. : 2022-U006735
WORK NO. : 2021-007371
ANALYSIS NO. : T22AA975-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AA975-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

FEBRUARY 2, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 25, 2022
SAMPLING TIME : 13:05 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JANUARY 25, 2022
ANALYTICAL DATE : JANUARY 25 - FEBRUARY 2, 2022
REPORT NO. : 2022-U008863
WORK NO. : 2021-007371
ANALYSIS NO. : T22AB388-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AB388-0005		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

FEBRUARY 9, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 25, 2022
SAMPLING TIME : 13:10 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JANUARY 25, 2022
ANALYTICAL DATE : JANUARY 25 - FEBRUARY 2, 2022
REPORT NO. : 2022-U008864
WORK NO. : 2021-007371
ANALYSIS NO. : T22AB388-0006

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AB388-0006		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIEMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

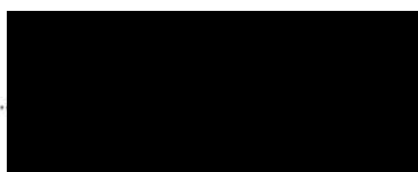

FEBRUARY 9, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 1, 2022
SAMPLING TIME : 14:45 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : FEBRUARY 1, 2022
ANALYTICAL DATE : FEBRUARY 1-8, 2022
REPORT NO. : 2022-U009898
WORK NO. : 2021-007371
ANALYSIS NO. : T22AB766-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AB766-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>23	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	PRESENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



FEBRUARY 11, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : era@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 1, 2022
SAMPLING TIME : 14:50 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : FEBRUARY 1, 2022
ANALYTICAL DATE : FEBRUARY 1-8, 2022
REPORT NO. : 2022-U009899
WORK NO. : 2021-007371
ANALYSIS NO. : T22AB766-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AB766-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	>23	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	PRESENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



FEBRUARY 11, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 8, 2022
SAMPLING TIME : 14:50 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : FEBRUARY 8, 2022
ANALYTICAL DATE : FEBRUARY 8-15, 2022
REPORT NO. : 2022-U011552
WORK NO. : 2021-007371
ANALYSIS NO. : T22AC225-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AC225-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



FEBRUARY 22, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 8, 2022
SAMPLING TIME : 14:55 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : FEBRUARY 8, 2022
ANALYTICAL DATE : FEBRUARY 8-15, 2022
REPORT NO. : 2022-U011553
WORK NO. : 2021-007371
ANALYSIS NO. : T22AC225-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AC225-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

FEBRUARY 22, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 15, 2022
SAMPLING TIME : 14:10 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : FEBRUARY 15, 2022
ANALYTICAL DATE : FEBRUARY 15-18, 2022
REPORT NO. : 2022-U013588
WORK NO. : 2021-007371
ANALYSIS NO. : T22AC766-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AC766-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

FEBRUARY 28, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 15, 2022
SAMPLING TIME : 14:15 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : FEBRUARY 15, 2022
ANALYTICAL DATE : FEBRUARY 15-18, 2022
REPORT NO. : 2022-U013589
WORK NO. : 2021-007371
ANALYSIS NO. : T22AC766-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AC766-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



FEBRUARY 28, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 22, 2022
SAMPLING TIME : 14:40 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : FEBRUARY 22, 2022
ANALYTICAL DATE : FEBRUARY 22-27, 2022
REPORT NO. : 2022-U015949
WORK NO. : 2021-007371
ANALYSIS NO. : T22AD225-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AD225-0005		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MARCH 9, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 22, 2022
SAMPLING TIME : 14:35 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : FEBRUARY 22, 2022
ANALYTICAL DATE : FEBRUARY 22-27, 2022
REPORT NO. : 2022-U015952
WORK NO. : 2021-007371
ANALYSIS NO. : T22AD225-0006

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AD225-0006		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIEMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MARCH 9, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : -
SAMPLE TYPE : WATER SUPPLY
SAMPLING DATE : FEBRUARY 22, 2022
SAMPLING TIME : 14:20 HOUR
SAMPLING METHOD ^c : GRAB
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPIMOL WAENTHONG
RECEIVED DATE : FEBRUARY 22, 2022
ANALYTICAL DATE : FEBRUARY 22-25, 2022
REPORT NO. : 2022-U015953
WORK NO. : 2021-007371
ANALYSIS NO. : T22AD225-0007

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ก๊อปปี้ไว้ในโครงการ T22AD225-0007	
TOTAL DISSOLVED SOLIDS ^b	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: 2540 C)	147	25
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

MARCH 9, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 1, 2022
SAMPLING TIME : 14:35 HOUR
SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE
SAMPLING BY ° : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 1, 2022
ANALYTICAL DATE : MARCH 1-7, 2022
REPORT NO. : 2022-U018167
WORK NO. : 2021-007371
ANALYSIS NO. : T22AD807-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AD807-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



MARCH 16, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 1, 2022
SAMPLING TIME : 14:30 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 1, 2022
ANALYTICAL DATE : MARCH 1-7, 2022
REPORT NO. : 2022-U018168
WORK NO. : 2021-007371
ANALYSIS NO. : T22AD807-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AD807-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)


^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

.....



MARCH 16, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 8, 2022
SAMPLING TIME : 14:45 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 8, 2022
ANALYTICAL DATE : MARCH 8-14, 2022
REPORT NO. : 2022-U019854
WORK NO. : 2021-007371
ANALYSIS NO. : T22AE362-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AE362-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



MARCH 23, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 8, 2022
SAMPLING TIME : 14:50 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAWEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 8, 2022
ANALYTICAL DATE : MARCH 8-14, 2022
REPORT NO. : 2022-U019855
WORK NO. : 2021-007371
ANALYSIS NO. : T22AE362-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AE362-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



MARCH 23, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 15, 2022
SAMPLING TIME : 13:50 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : MARCH 15, 2022
ANALYTICAL DATE : MARCH 15-23, 2022
REPORT NO. : 2022-U022092
WORK NO. : 2021-007371
ANALYSIS NO. : T22AE947-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AE947-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIEMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MARCH 28, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 15, 2022
SAMPLING TIME : 13:55 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : MARCH 15, 2022
ANALYTICAL DATE : MARCH 15-23, 2022
REPORT NO. : 2022-U022093
WORK NO. : 2021-007371
ANALYSIS NO. : T22AE947-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AE947-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MARCH 28, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 22, 2022
SAMPLING TIME : 14:20 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 22, 2022
ANALYTICAL DATE : MARCH 22-28, 2022
REPORT NO. : 2022-U024242
WORK NO. : 2021-007371
ANALYSIS NO. : T22AF534-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AF534-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 5, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 22, 2022
SAMPLING TIME : 14:25 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 22, 2022
ANALYTICAL DATE : MARCH 22-28, 2022
REPORT NO. : 2022-U024243
WORK NO. : 2021-007371
ANALYSIS NO. : T22AF534-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AF534-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 5, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 29, 2022
SAMPLING TIME : 13:50 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 29, 2022
ANALYTICAL DATE : MARCH 29 - APRIL 5, 2022
REPORT NO. : 2022-U026660
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG018-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AG018-0003		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 12, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 29, 2022
SAMPLING TIME : 13:55 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MARCH 29, 2022
ANALYTICAL DATE : MARCH 29 - APRIL 5, 2022
REPORT NO. : 2022-U026661
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG018-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AG018-0004		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 12, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 5, 2022
SAMPLING TIME : 09:26 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAWE
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 5, 2022
ANALYTICAL DATE : APRIL 5-11, 2022
REPORT NO. : 2022-U029591
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG510-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AG510-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	5.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	PRESENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 26, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 5, 2022
SAMPLING TIME : 09:30 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 5, 2022
ANALYTICAL DATE : APRIL 5-10, 2022
REPORT NO. : 2022-U029592
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG510-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AG510-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 26, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 11, 2022
SAMPLING TIME : 14:45 HOUR
SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE
SAMPLING BY ° : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 11, 2022
ANALYTICAL DATE : APRIL 11-15, 2022
REPORT NO. : 2022-U030899
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG980-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AG980-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 29, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 11, 2022
SAMPLING TIME : 14:50 HOUR
SAMPLING METHOD : GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 11, 2022
ANALYTICAL DATE : APRIL 11-15, 2022
REPORT NO. : 2022-U030900
WORK NO. : 2021-007371
ANALYSIS NO. : T22AG980-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AG980-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

APRIL 29, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 19, 2022
SAMPLING TIME : 14:00 HOUR
SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE
SAMPLING BY ° : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 19, 2022
ANALYTICAL DATE : APRIL 19-25, 2022
REPORT NO. : 2022-U032027
WORK NO. : 2021-007371
ANALYSIS NO. : T22AH292-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AH292-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



MAY 6, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 19, 2022
SAMPLING TIME : 14:05 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 19, 2022
ANALYTICAL DATE : APRIL 19-25, 2022
REPORT NO. : 2022-U032028
WORK NO. : 2021-007371
ANALYSIS NO. : T22AH292-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AH292-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION			-		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MAY 6, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 26, 2022
SAMPLING TIME : 14:25 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 26, 2022
ANALYTICAL DATE : APRIL 26 - MAY 3, 2022
REPORT NO. : 2022-U034372
WORK NO. : 2021-007371
ANALYSIS NO. : T22AH843-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AH843-0005		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MAY 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 26, 2022
SAMPLING TIME : 14:30 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : APRIL 26, 2022
ANALYTICAL DATE : APRIL 26 - MAY 3, 2022
REPORT NO. : 2022-U034373
WORK NO. : 2021-007371
ANALYSIS NO. : T22AH843-0006

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AH843-0006		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MAY 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : -
SAMPLE TYPE : WATER SUPPLY
SAMPLING DATE : APRIL 26, 2022
SAMPLING TIME : 14:55 HOUR
SAMPLING METHOD ^c : GRAB
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPIMOL WAENTHONG

RECEIVED DATE : APRIL 26, 2022
ANALYTICAL DATE : APRIL 26-29, 2022
REPORT NO. : 2022-U034374
WORK NO. : 2021-007371
ANALYSIS NO. : T22AH843-0007

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ก๊อปปี้ใช้ในโครงการ T22AH843-0007	
TOTAL DISSOLVED SOLIDS ^b	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: 2540 C)	162	25
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

MAY 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 3, 2022
SAMPLING TIME : 11:55 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 3, 2022
ANALYTICAL DATE : MAY 3-10, 2022
REPORT NO. : 2022-U036587
WORK NO. : 2021-007371
ANALYSIS NO. : T22AI230-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AI230-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MAY 20, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 3, 2022
SAMPLING TIME : 12:00 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 3, 2022
ANALYTICAL DATE : MAY 3-10, 2022
REPORT NO. : 2022-U036588
WORK NO. : 2021-007371
ANALYSIS NO. : T22AI230-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AI230-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MAY 20, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 10, 2022
SAMPLING TIME : 14:00 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 10, 2022
ANALYTICAL DATE : MAY 10-17, 2022
REPORT NO. : 2022-U037668
WORK NO. : 2021-007371
ANALYSIS NO. : T22AI758-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AI758-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MAY 24, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 10, 2022
SAMPLING TIME : 14:05 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 10, 2022
ANALYTICAL DATE : MAY 10-18, 2022
REPORT NO. : 2022-U037669
WORK NO. : 2021-007371
ANALYSIS NO. : T22AI758-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AI758-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
<i>Staphylococcus aureus</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

MAY 24, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 17, 2022
SAMPLING TIME : 14:30 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 18, 2022
ANALYTICAL DATE : MAY 18-23, 2022
REPORT NO. : 2022-U041013
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ310-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AJ310-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	2.2	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	PRESENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 2, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 17, 2022
SAMPLING TIME : 14:35 HOUR
SAMPLING METHOD : GRAB AND STERILE TECHNIQUE
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 18, 2022
ANALYTICAL DATE : MAY 18-23, 2022
REPORT NO. : 2022-U041015
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ310-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AJ310-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 2, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 17, 2022
SAMPLING TIME : 14:30 HOUR
SAMPLING METHOD ^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : MAY 18, 2022
ANALYTICAL DATE : MAY 18-20, 2022
REPORT NO. : 2022-U041016
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ310-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AJ310-0001		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 2, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 17, 2022
SAMPLING TIME : 14:35 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : MAY 18, 2022
ANALYTICAL DATE : MAY 18-20, 2022
REPORT NO. : 2022-U041017
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ310-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AJ310-0002		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 2, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 24, 2022
SAMPLING TIME : 13:05 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAWEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : MAY 24, 2022
ANALYTICAL DATE : MAY 24-30, 2022
REPORT NO. : 2022-U041868
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ832-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AJ832-0005		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 24, 2022
SAMPLING TIME : 13:05 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : MAY 24, 2022
ANALYTICAL DATE : MAY 24-27, 2022
REPORT NO. : 2022-U041869
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ832-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AJ832-0005		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 24, 2022
SAMPLING TIME : 13:10 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 24, 2022
ANALYTICAL DATE : MAY 24-27, 2022
REPORT NO. : 2022-U041870
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ832-0006

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AJ832-0006		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



LABORATORY SUPERVISOR

JUNE 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 24, 2022
SAMPLING TIME : 13:10 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : MAY 24, 2022
ANALYTICAL DATE : MAY 24-27, 2022
REPORT NO. : 2022-U041871
WORK NO. : 2021-007371
ANALYSIS NO. : T22AJ832-0006

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AJ832-0006		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : -
SAMPLE TYPE : WATER SUPPLY
SAMPLING DATE : MAY 24, 2022
SAMPLING TIME : 13:35 HOUR
SAMPLING METHOD ° : GRAB
SAMPLING BY ° : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPIMOL WAENTHONG

RECEIVED DATE : MAY 24, 2022
ANALYTICAL DATE : MAY 24-30, 2022
REPORT NO. : 2022-U041872
WORK NO. : 2021-007371
ANALYSIS NO. : T22A3832-0007


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ก๊อมน้ำใช้ในโครงการ T22A3832-0007	
TOTAL DISSOLVED SOLIDS ^b	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: 2540 C)	183	25
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.



JUNE 13, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 31, 2022
SAMPLING TIME : 14:50 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : MAY 31, 2022
ANALYTICAL DATE : MAY 31-JUNE 13, 2022
REPORT NO. : 2022-U045489
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK354-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AK354-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



JUNE 17, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 31, 2022
SAMPLING TIME : 14:50 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : MAY 31, 2022
ANALYTICAL DATE : MAY 31-JUNE 6, 2022
REPORT NO. : 2022-U045490
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK354-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AK354-0001		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 17, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 31, 2022
SAMPLING TIME : 14:55 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : MAY 31, 2022
ANALYTICAL DATE : MAY 31-JUNE 13, 2022
REPORT NO. : 2022-U045491
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK354-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AK354-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 17, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 31, 2022
SAMPLING TIME : 14:55 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : MAY 31, 2022
ANALYTICAL DATE : MAY 31-JUNE 6, 2022
REPORT NO. : 2022-U045493
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK354-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AK354-0002		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 17, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 7, 2022
SAMPLING TIME : 14:40 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : JUNE 7, 2022
ANALYTICAL DATE : JUNE 7-14, 2022
REPORT NO. : 2022-U046987
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK878-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AK878-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



JUNE 22, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 7, 2022
SAMPLING TIME : 14:40 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAWEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : JUNE 7, 2022
ANALYTICAL DATE : JUNE 7-10, 2022
REPORT NO. : 2022-U046988
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK878-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AK878-0001		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		


^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



JUNE 22, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 7, 2022
SAMPLING TIME : 14:45 HOUR
SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE
SAMPLING BY ° : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JUNE 7, 2022
ANALYTICAL DATE : JUNE 7-14, 2022
REPORT NO. : 2022-U046989
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK878-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AK878-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



JUNE 22, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 7, 2022
SAMPLING TIME : 14:45 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : JUNE 7, 2022
ANALYTICAL DATE : JUNE 7-10, 2022
REPORT NO. : 2022-U046990
WORK NO. : 2021-007371
ANALYSIS NO. : T22AK878-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AK878-0002		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		


^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.



JUNE 22, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 14, 2022
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JUNE 14, 2022
ANALYTICAL DATE : JUNE 14-21, 2022
REPORT NO. : 2022-U049679
WORK NO. : 2021-007371
ANALYSIS NO. : T22AL485-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AL485-0001		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 29, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 14, 2022
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAWE
ANALYZED BY : MISS PAWIDA CHUMPURAT
RECEIVED DATE : JUNE 14, 2022
ANALYTICAL DATE : JUNE 14-21, 2022
REPORT NO. : 2022-U049680
WORK NO. : 2021-007371
ANALYSIS NO. : T22AL485-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AL485-0001		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIEMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 29, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 14, 2022
SAMPLING TIME : 13:45 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAWEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : JUNE 14, 2022
ANALYTICAL DATE : JUNE 14-21, 2022
REPORT NO. : 2022-U049681
WORK NO. : 2021-007371
ANALYSIS NO. : T22AL485-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AL485-0002		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 29, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 14, 2022
SAMPLING TIME : 13:45 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PAWIDA CHUMPURAT

RECEIVED DATE : JUNE 14, 2022
ANALYTICAL DATE : JUNE 14-21, 2022
REPORT NO. : 2022-U049682
WORK NO. : 2021-007371
ANALYSIS NO. : T22AL485-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AL485-0002		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JUNE 29, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 21, 2022
SAMPLING TIME : 15:10 HOUR
SAMPLING METHOD ^a : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JUNE 22, 2022
ANALYTICAL DATE : JUNE 22-28, 2022
REPORT NO. : 2022-U051977
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM103-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AM103-0003		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 7, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 21, 2022
SAMPLING TIME : 15:10 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPAILIN LOYLUEN

RECEIVED DATE : JUNE 22, 2022
ANALYTICAL DATE : JUNE 22-28, 2022
REPORT NO. : 2022-U051978
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM103-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AM103-0003		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 7, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 21, 2022
SAMPLING TIME : 15:15 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JUNE 22, 2022
ANALYTICAL DATE : JUNE 22-28, 2022
REPORT NO. : 2022-U051979
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM103-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AM103-0004		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 7, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 21, 2022
SAMPLING TIME : 15:15 HOUR
SAMPLING METHOD ^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPAILIN LOYLUN

RECEIVED DATE : JUNE 22, 2022
ANALYTICAL DATE : JUNE 22-28, 2022
REPORT NO. : 2022-U051980
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM103-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AM103-0004		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSC)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIKTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 7, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : -
SAMPLE TYPE : WATER SUPPLY
SAMPLING DATE : JUNE 21, 2022
SAMPLING TIME : 15:30 HOUR
SAMPLING METHOD ^c : GRAB
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPIMOL WAENTHONG
RECEIVED DATE : JUNE 22, 2022
ANALYTICAL DATE : JUNE 22-24, 2022
REPORT NO. : 2022-U051981
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM103-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ก๊อปปี้ใช้ในโครงการ T22AM103-0005	
TOTAL DISSOLVED SOLIDS ^b	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: 2540 C)	139	25
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

JULY 7, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 28, 2022
SAMPLING TIME : 13:05 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB

RECEIVED DATE : JUNE 28, 2022
ANALYTICAL DATE : JUNE 28-JULY 6, 2022
REPORT NO. : 2022-U053814
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM733-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AM733-0003		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 14, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 28, 2022
SAMPLING TIME : 13:05 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPAILIN LOYLUEN

RECEIVED DATE : JUNE 28, 2022
ANALYTICAL DATE : JUNE 28-JULY 3, 2022
REPORT NO. : 2022-U053815
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM733-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T22AM733-0003		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMS)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 14, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 28, 2022
SAMPLING TIME : 13:10 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS ITSARIYAPORN BUATIB
RECEIVED DATE : JUNE 28, 2022
ANALYTICAL DATE : JUNE 28-JULY 5, 2022
REPORT NO. : 2022-U053816
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM733-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AM733-0004		
MICROBIOLOGY					
COLIFORM BACTERIA ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: 9221 B)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: 9221 D AND F)	ABSENCE	ABSENCE	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE (ISO 16266)	NOT DETECTED	1/	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRICTIONAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 14, 2022



ANALYSIS REPORT

PROJECT NAME : โครงการ EASE พระราม 2
CUSTOMER NAME : EASE RAMA 2 JURISTIC PERSON
ADDRESS : 2/483 SOI RAMA 2, SOI 54 SAMAE DAM BANG KHUN THIAN BANGKOK 10150
CONTACT INFORMATION : TEL : 0 2417 1190 e-mail : pichit.kingkaew@th.knightfrank.com
SAMPLING SOURCE : SWIMMING POOL
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 28, 2022
SAMPLING TIME : 13:10 HOUR
SAMPLING METHOD^b : GRAB AND STERILE TECHNIQUE
SAMPLING BY^b : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS PORNPAILIN LOYLUEN
RECEIVED DATE : JUNE 28, 2022
ANALYTICAL DATE : JUNE 28-JULY 3, 2022
REPORT NO. : 2022-U053817
WORK NO. : 2021-007371
ANALYSIS NO. : T22AM733-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T22AM733-0004		
MICROBIOLOGY					
<i>Staphylococcus aureus</i> ^a	/100 mL	MEMBRANE FILTER TECHNIQUE (SM: 9213 B)	NOT DETECTED	1/	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT					

^a : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF MEDICAL SCIENCE (DMSQ)

^b : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT STILL NOT ACCREDITED

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 23rd EDITION, 2017.

REGULATORY STANDARD : BANGKOK METROPOLITAN REGULATIONS FOR THE BUSINESS DISTRIMENTAL TO HEALTH, B.E. 2530 (1987).

1/ : DISEASE-CAUSING BACTERIA IS NOT DETECTED.

JULY 14, 2022

