


ข้อมูลผลการตรวจวัดคุณภาพอากาศจากปล่องระบายของโครงการ โดยเครื่อง CEMs ในช่วงเดือน กรกฎาคม - ธันวาคม

2565

			GTG-1A	GTG-1B	Unit
กรกฎาคม	NOx	max	87.06	90.68	ppm
		mean	81.15	85.44	ppm
สิงหาคม	NOx	max	87.20	90.58	ppm
		mean	80.01	87.68	ppm
กันยายน	NOx	max	85.59	90.03	ppm
		mean	78.91	87.11	ppm
ตุลาคม	NOx	max	85.59	90.03	ppm
		mean	78.91	87.11	ppm
พฤศจิกายน	NOx	max	85.59	90.03	ppm
		mean	78.91	87.11	ppm
ธันวาคม	NOx	max	83.62	88.36	ppm
		mean	72.14	78.54	ppm

HRSG 11


Jul-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	13.40	13.50	*	14.90	15.00	15.50	9.50	14.30	14.40	14.90	14.40	14.40	15.00	14.90	14.50	14.50	15.20	14.60	14.50	14.50	14.60	14.60	14.60	15.30	14.70	14.60	14.60	15.20	14.60	14.60	15.20	14.48
NOx Average	69.00	70.00	*	89.00	89.00	94.00	57.00	86.00	80.00	80.00	85.00	86.00	78.00	78.00	80.00	82.00	75.00	80.00	81.00	81.00	81.00	81.00	80.00	71.00	74.00	78.00	74.00	74.00	80.00	77.00	71.00	78.70
CO Average	6.00	7.00	*	9.00	9.00	11.00	5.00	6.00	11.00	11.00	6.00	6.00	14.00	15.00	11.00	8.00	16.00	10.00	7.00	8.00	12.00	8.00	10.00	29.00	20.00	15.00	18.00	23.00	12.00	10.00	20.00	11.77

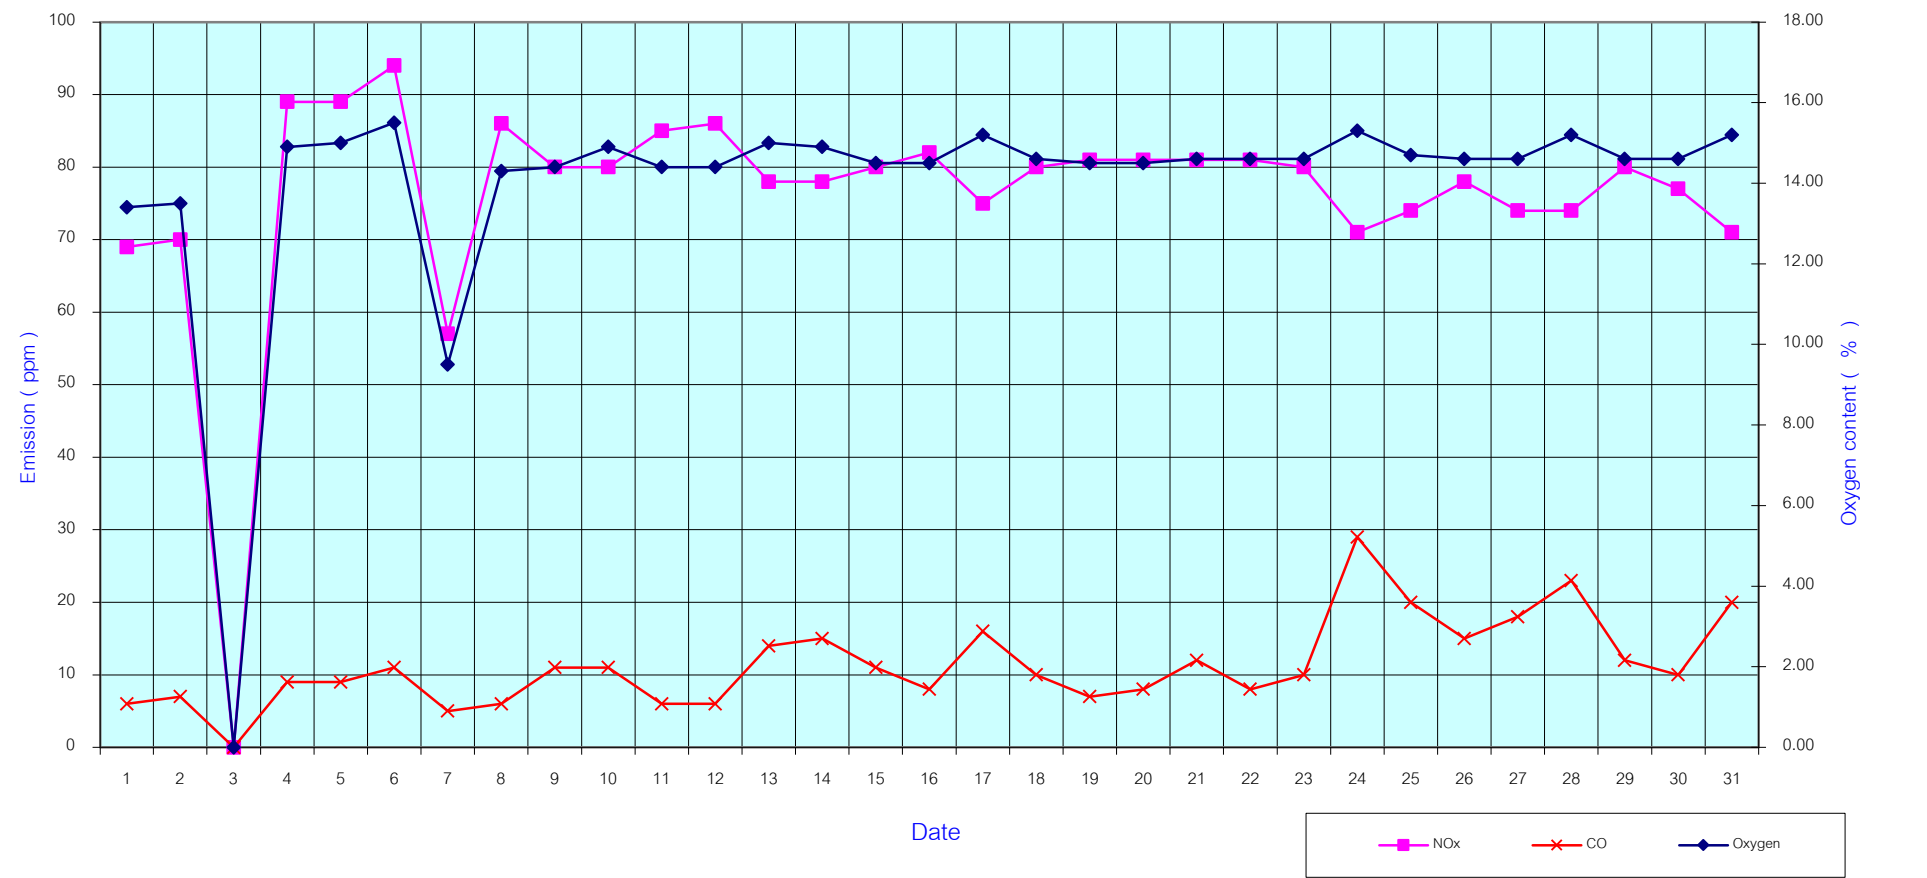

Remark : * = No data


HRSG 12

Jul-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	14.50	14.50	15.10	14.60	14.50	14.50	14.60	14.80	15.00	15.50	14.90	14.80	15.30	15.30	14.80	14.80	15.50	14.90	14.80	14.80	14.80	14.80	14.80	15.50	14.90	14.80	14.80	15.50	14.90	14.80	15.40	14.92
NOx Average	78.00	81.00	71.00	81.00	81.00	82.00	84.00	88.00	86.00	80.00	88.00	89.00	80.00	79.00	86.00	85.00	77.00	83.00	86.00	88.00	85.00	84.00	86.00	80.00	83.00	86.00	83.00	82.00	88.00	86.00	80.00	83.10
CO Average	4.00	5.00	10.00	5.00	5.00	4.00	4.00	5.00	6.00	11.00	5.00	5.00	11.00	10.00	6.00	6.00	14.00	8.00	5.00	5.00	7.00	6.00	6.00	13.00	9.00	6.00	7.00	12.00	6.00	6.00	12.00	7.23

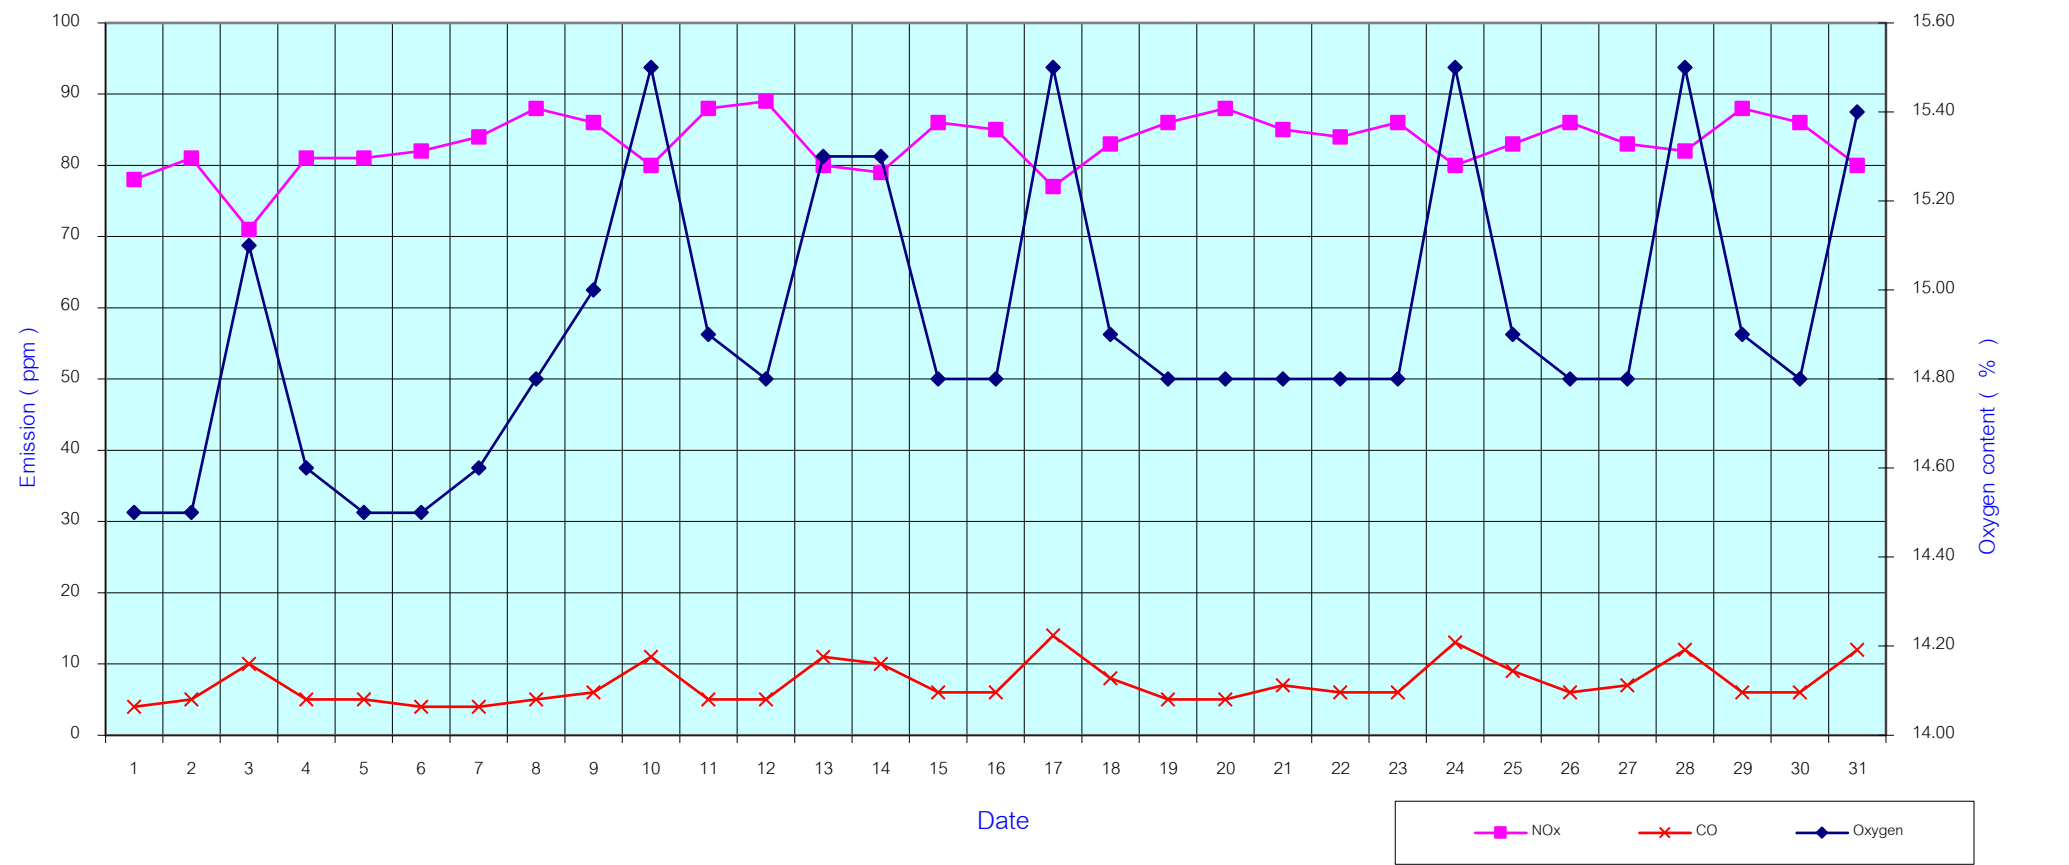


HRSG 11

Aug-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	14.60	14.60	14.60	14.70	14.60	14.60	15.20	14.70	14.60	14.60	14.40	15.10	14.60	20.20	14.60	14.40	14.40	14.50	14.50	14.40	15.00	14.50	14.40	14.40	14.50	14.70	14.80	15.40	14.80	14.90	14.80	14.84
NOx Average	73.00	77.00	81.00	83.00	84.00	84.00	79.00	82.00	83.00	82.00	85.00	81.00	82.00	*	81.00	80.00	80.00	80.00	80.00	82.00	74.00	82.00	80.00	77.00	77.00	74.00	75.00	71.00	71.00	74.00	69.00	78.77
CO Average	19.00	13.00	10.00	9.00	7.00	8.00	12.00	9.00	7.00	8.00	7.00	13.00	11.00	25.00	14.00	12.00	8.00	9.00	10.00	10.00	17.00	9.00	9.00	11.00	13.00	21.00	25.00	32.00	31.00	27.00	27.00	14.29

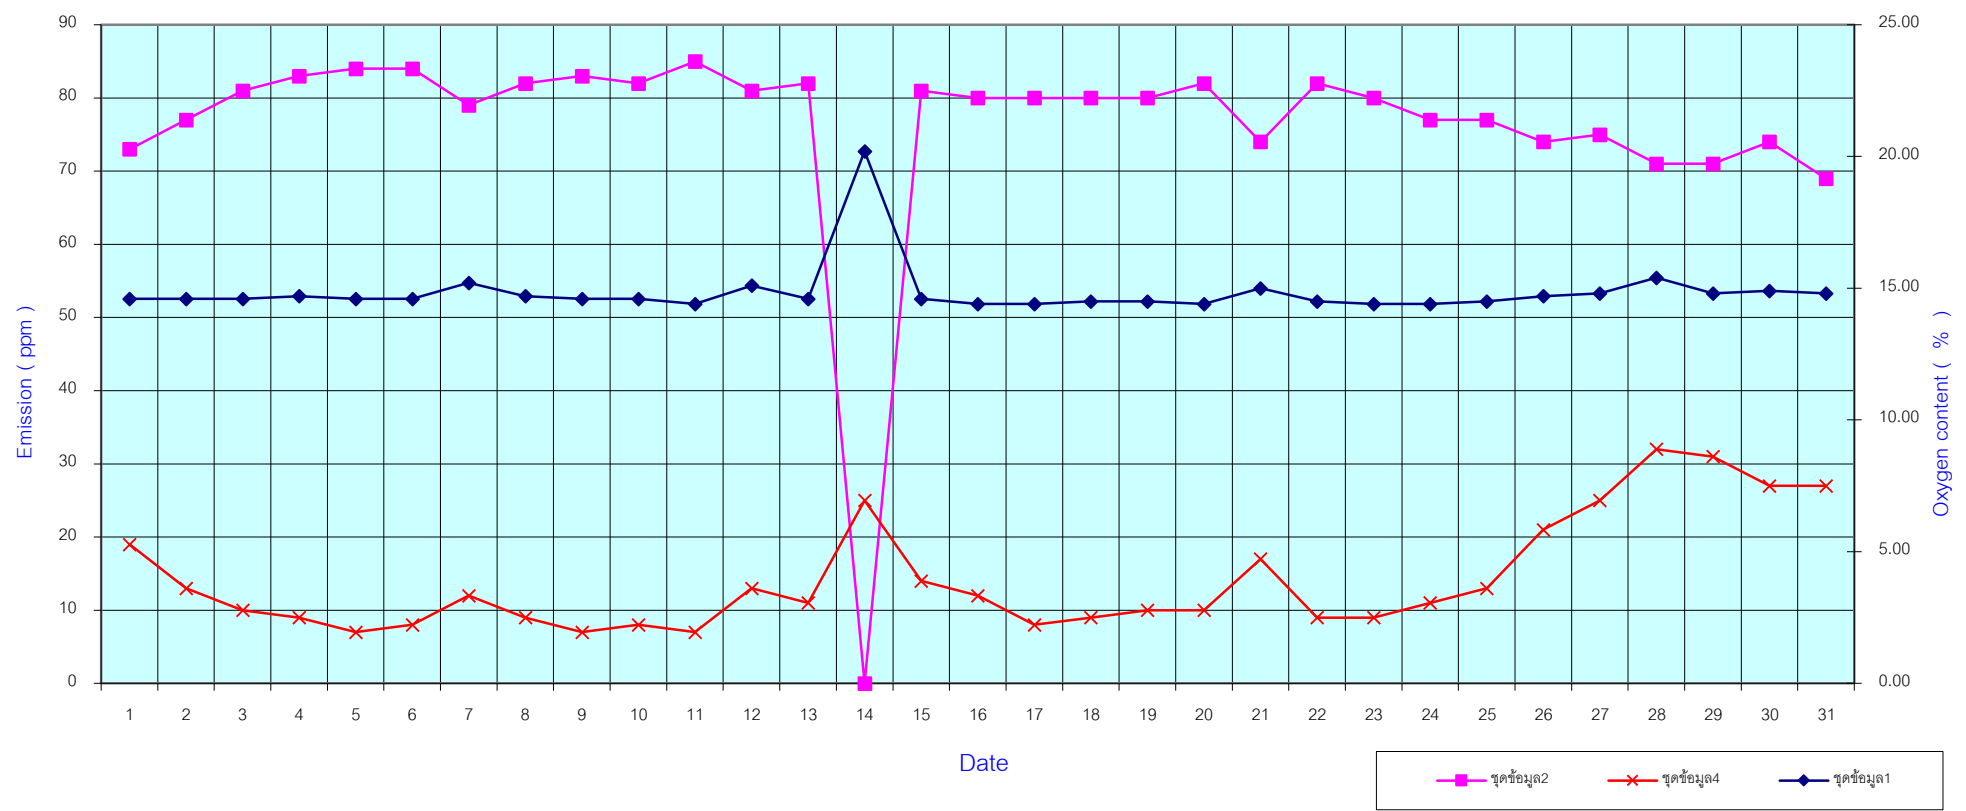


HRSG 12

Aug-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	14.90	14.80	14.80	14.90	14.90	14.90	15.50	15.00	14.90	14.90	14.90	15.60	15.00	14.50	14.80	14.80	14.80	14.90	14.90	14.80	15.40	14.80	14.80	14.80	14.90	15.10	15.10	15.70	15.20	15.20	15.10	14.99
NOx Average	80.00	82.00	84.00	85.00	87.00	85.00	79.00	87.00	88.00	85.00	85.00	84.00	86.00	91.00	85.00	88.00	89.00	85.00	84.00	87.00	81.00	84.00	85.00	87.00	84.00	81.00	83.00	73.00	84.00	82.00	80.00	84.19
CO Average	9.00	8.00	6.00	6.00	6.00	6.00	11.00	7.00	5.00	7.00	5.00	10.00	7.00	1.00	6.00	5.00	5.00	6.00	7.00	5.00	11.00	7.00	6.00	5.00	7.00	9.00	10.00	18.00	10.00	11.00	11.00	7.52

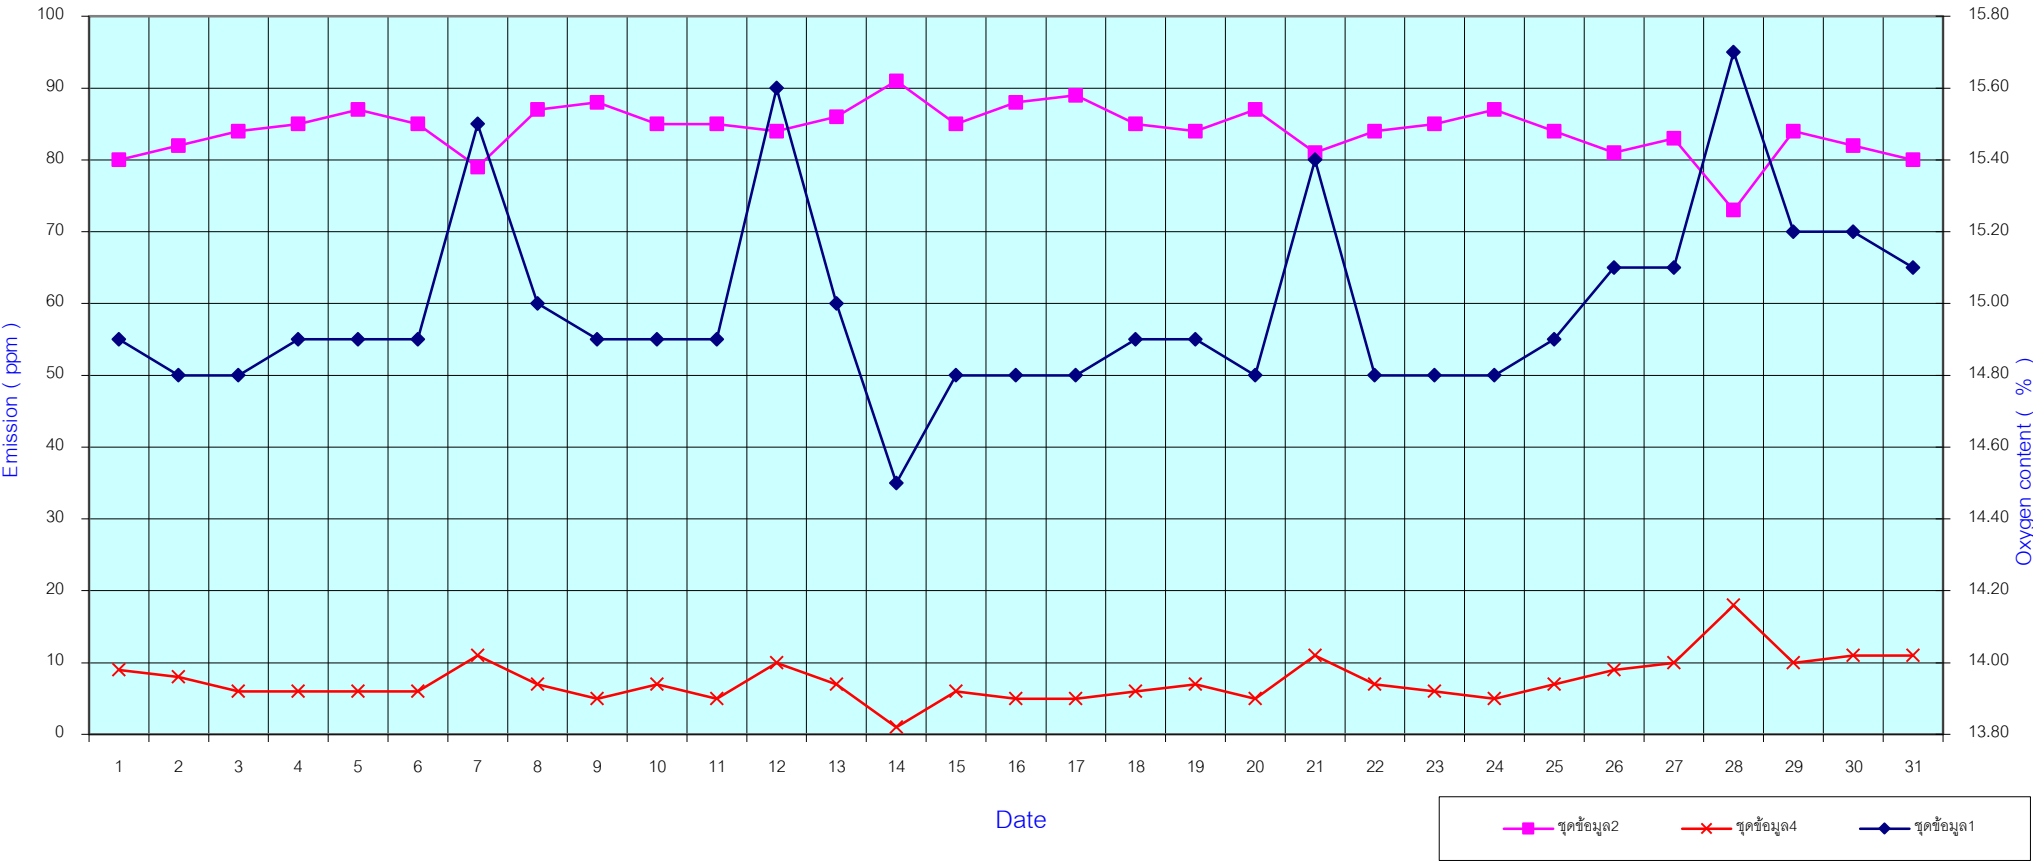


HRSG 11

Sep-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	Average
Oxygen Average	14.80	14.80	14.80	15.40	14.90	14.90	14.70	14.70	14.70	14.60	15.20	14.60	14.50	14.50	14.50	14.50	14.50	15.10	14.60	14.60	18.60	14.40	14.40	14.50	15.20	14.50	14.40	14.30	14.30	14.40	14.80
NOx Average	75.00	73.00	70.00	72.00	76.00	78.00	79.00	76.00	78.00	75.00	72.00	77.00	76.00	81.00	84.00	84.00	82.00	77.00	79.00	79.00	*	81.00	79.00	72.00	68.00	69.00	73.00	78.00	82.00	80.00	76.72
CO Average	21.00	19.00	22.00	25.00	21.00	20.00	15.00	21.00	17.00	20.00	28.00	18.00	23.00	14.00	9.00	6.00	6.00	15.00	18.00	16.00	7.00	13.00	14.00	17.00	27.00	21.00	14.00	10.00	7.00	5.00	16.30

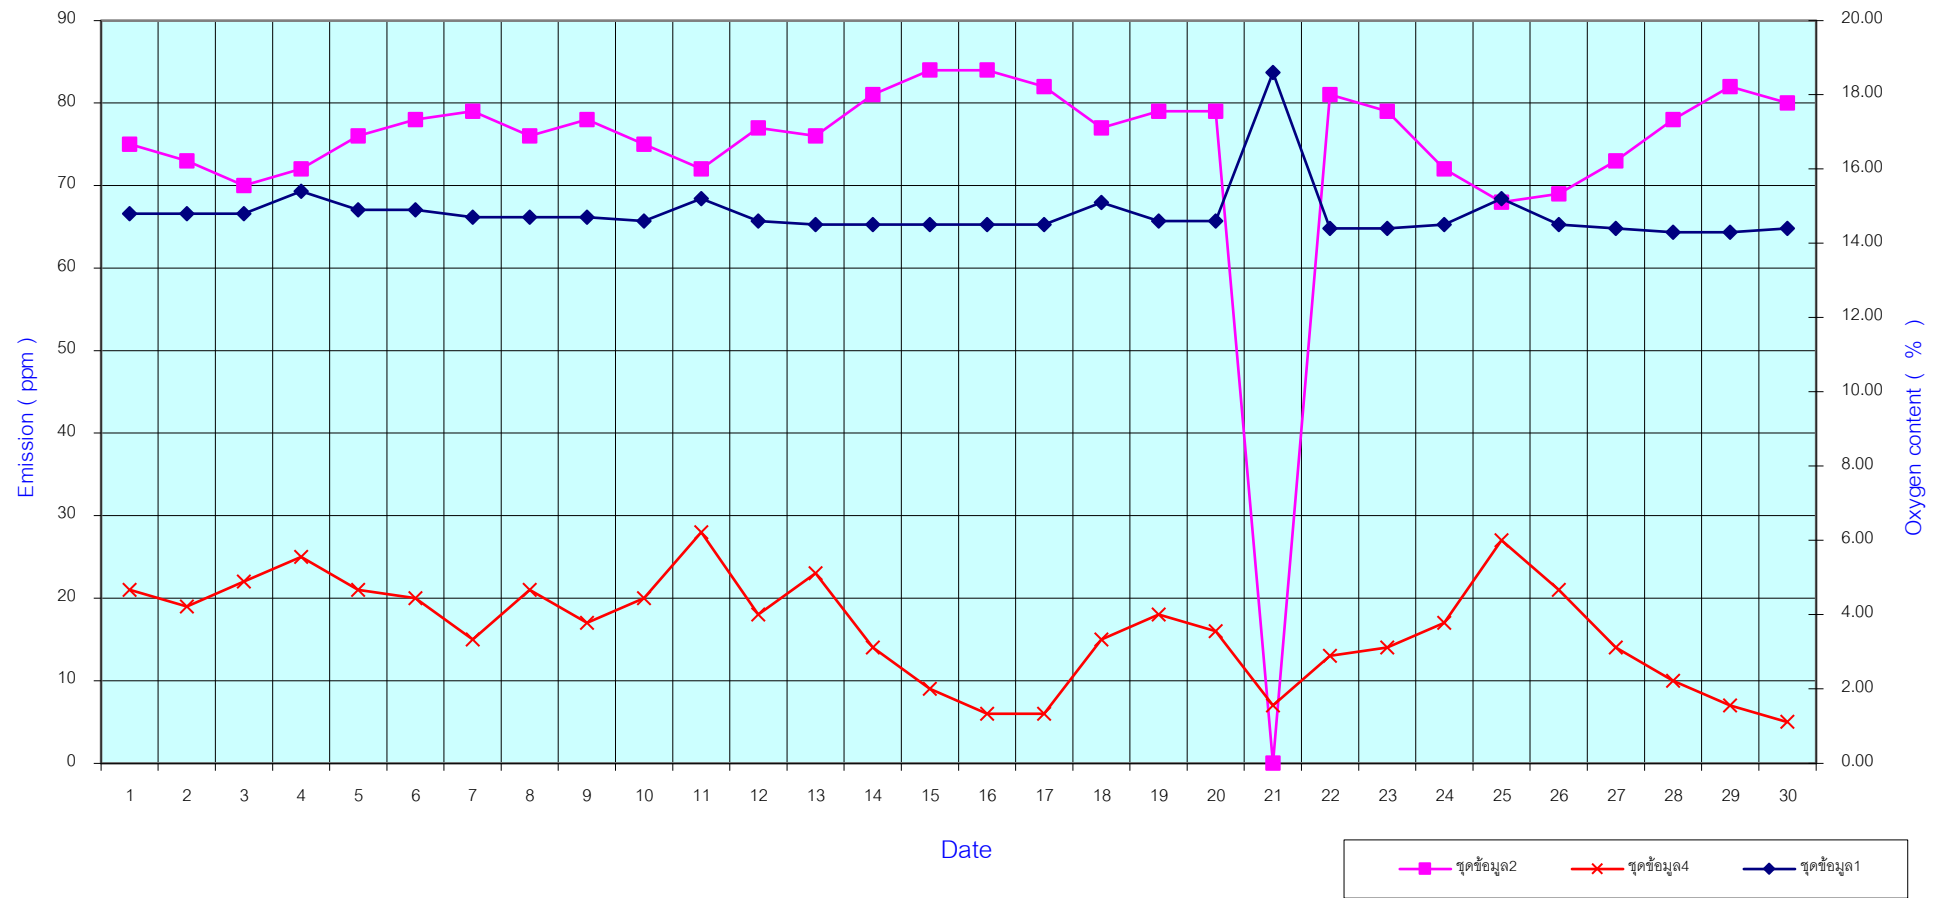

HRSG 12


Sep-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	Average
Oxygen Average	15.10	15.10	15.10	15.70	15.20	15.00	15.00	15.00	15.00	14.90	15.60	14.90	14.80	14.80	14.80	14.80	14.80	15.30	14.80	14.70	14.50	14.70	14.70	14.80	15.50	14.80	14.70	14.70	14.70	14.70	14.94
NOx Average	82.00	81.00	80.00	73.00	83.00	80.00	83.00	83.00	84.00	84.00	77.00	83.00	87.00	87.00	86.00	86.00	88.00	82.00	85.00	86.00	88.00	86.00	86.00	84.00	76.00	79.00	81.00	84.00	84.00	86.00	83.13
CO Average	10.00	10.00	9.00	18.00	10.00	11.00	9.00	8.00	7.00	7.00	14.00	8.00	5.00	5.00	5.00	5.00	4.00	9.00	6.00	5.00	2.00	5.00	5.00	6.00	14.00	8.00	6.00	5.00	5.00	4.00	7.50

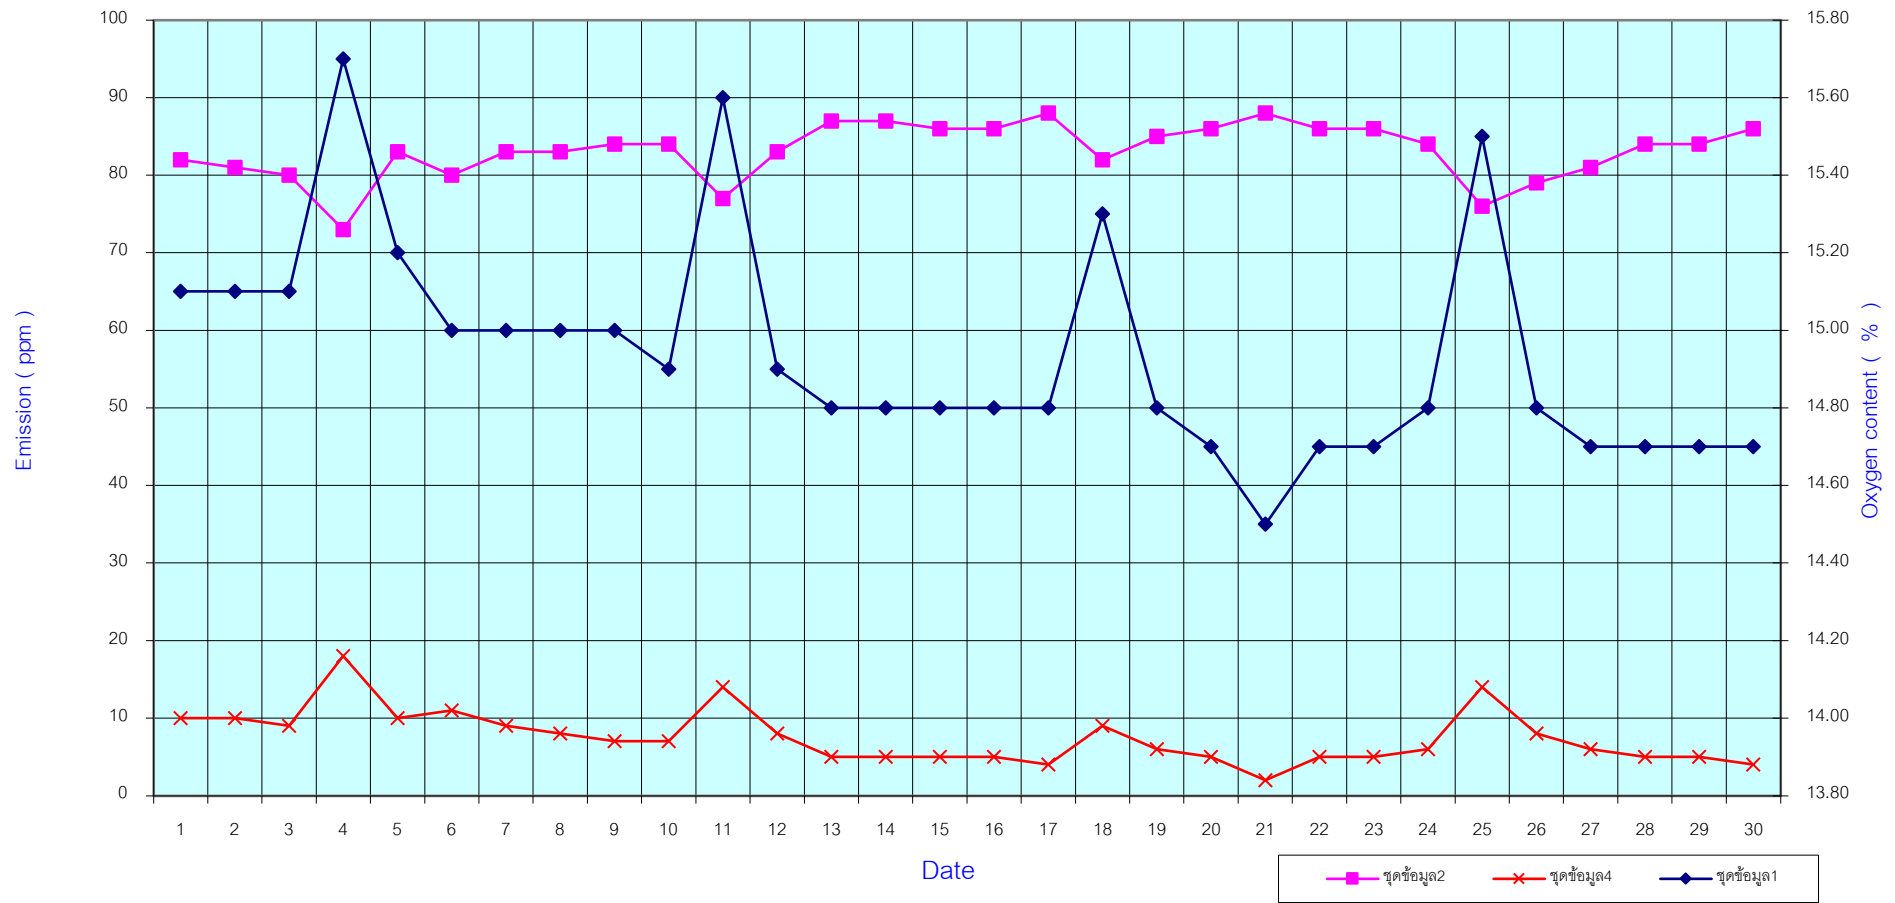

Remark : * = No data

HRSG 11


Oct-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	14.40	15.00	14.50	14.50	14.50	14.40	14.50	14.40	15.10	14.60	14.50	14.50	15.00	14.50	14.60	15.20	14.70	14.50	14.50	14.60	14.60	14.50	14.20	14.10	14.10	14.50	14.50	14.50	14.60	15.20	14.70	14.58
NOx Average	78.00	69.00	70.00	69.00	80.00	81.00	79.00	79.00	69.00	76.00	74.00	78.00	73.00	75.00	75.00	80.00	80.00	81.00	77.00	78.00	70.00	73.00	88.00	88.00	79.00	73.00	69.00	71.00	75.00	78.00	78.00	76.23
CO Average	7.00	21.00	28.00	35.00	22.00	19.00	23.00	17.00	42.00	23.00	27.00	21.00	34.00	28.00	31.00	27.00	20.00	19.00	22.00	21.00	34.00	29.00	9.00	10.00	15.00	25.00	35.00	28.00	34.00	29.00	28.00	24.61

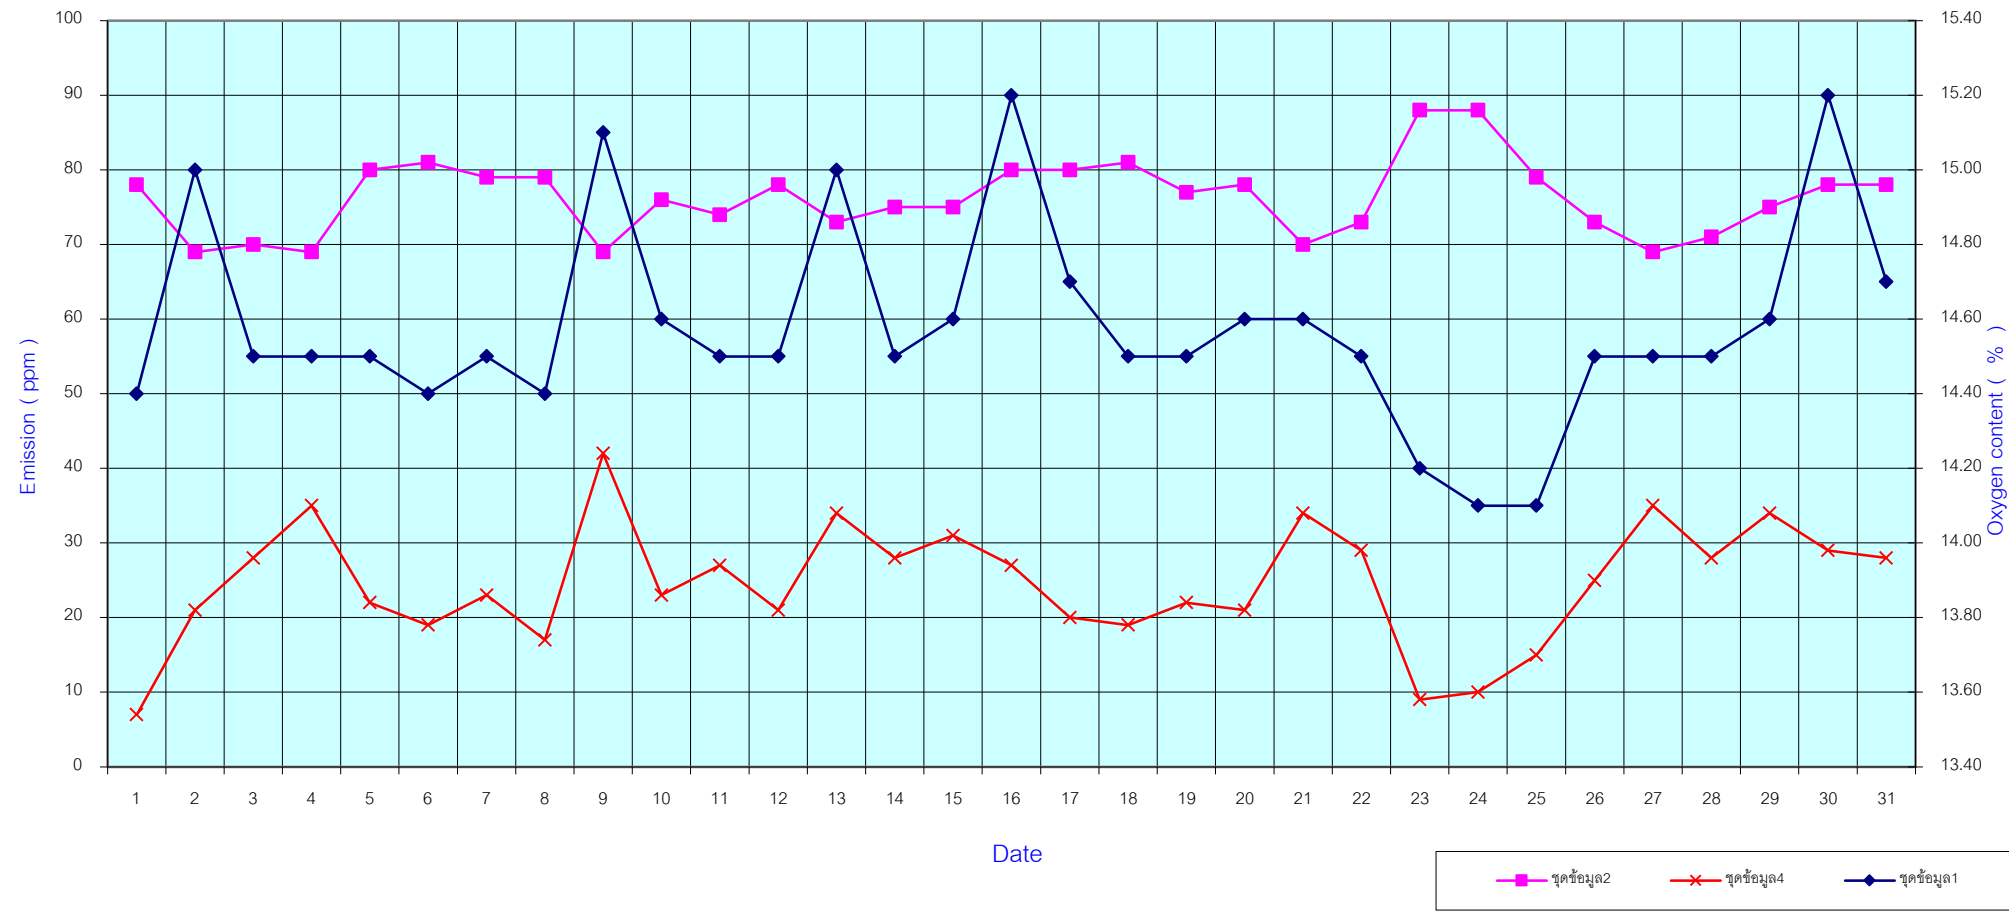

Remark : * = No data


HRS 12

Oct-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	14.70	15.20	14.70	14.60	14.50	14.40	14.50	14.50	15.10	14.60	14.50	14.50	15.00	14.50	14.60	15.20	14.70	14.60	14.60	14.60	14.60	14.60	20.30	20.30	19.70	14.70	14.70	14.70	14.80	15.40	14.90	15.24
NOx Average	83.00	74.00	81.00	84.00	82.00	81.00	77.00	79.00	65.00	74.00	81.00	81.00	73.00	84.00	81.00	75.00	80.00	80.00	80.00	80.00	75.00	78.00	*	*	*	75.00	77.00	77.00	81.00	73.00	80.00	78.25
CO Average	5.00	11.00	6.00	6.00	4.00	5.00	6.00	6.00	14.00	8.00	5.00	5.00	9.00	6.00	7.00	11.00	9.00	8.00	8.00	7.00	8.00	7.00	22.00	23.00	21.00	9.00	9.00	9.00	9.00	15.00	11.00	9.32

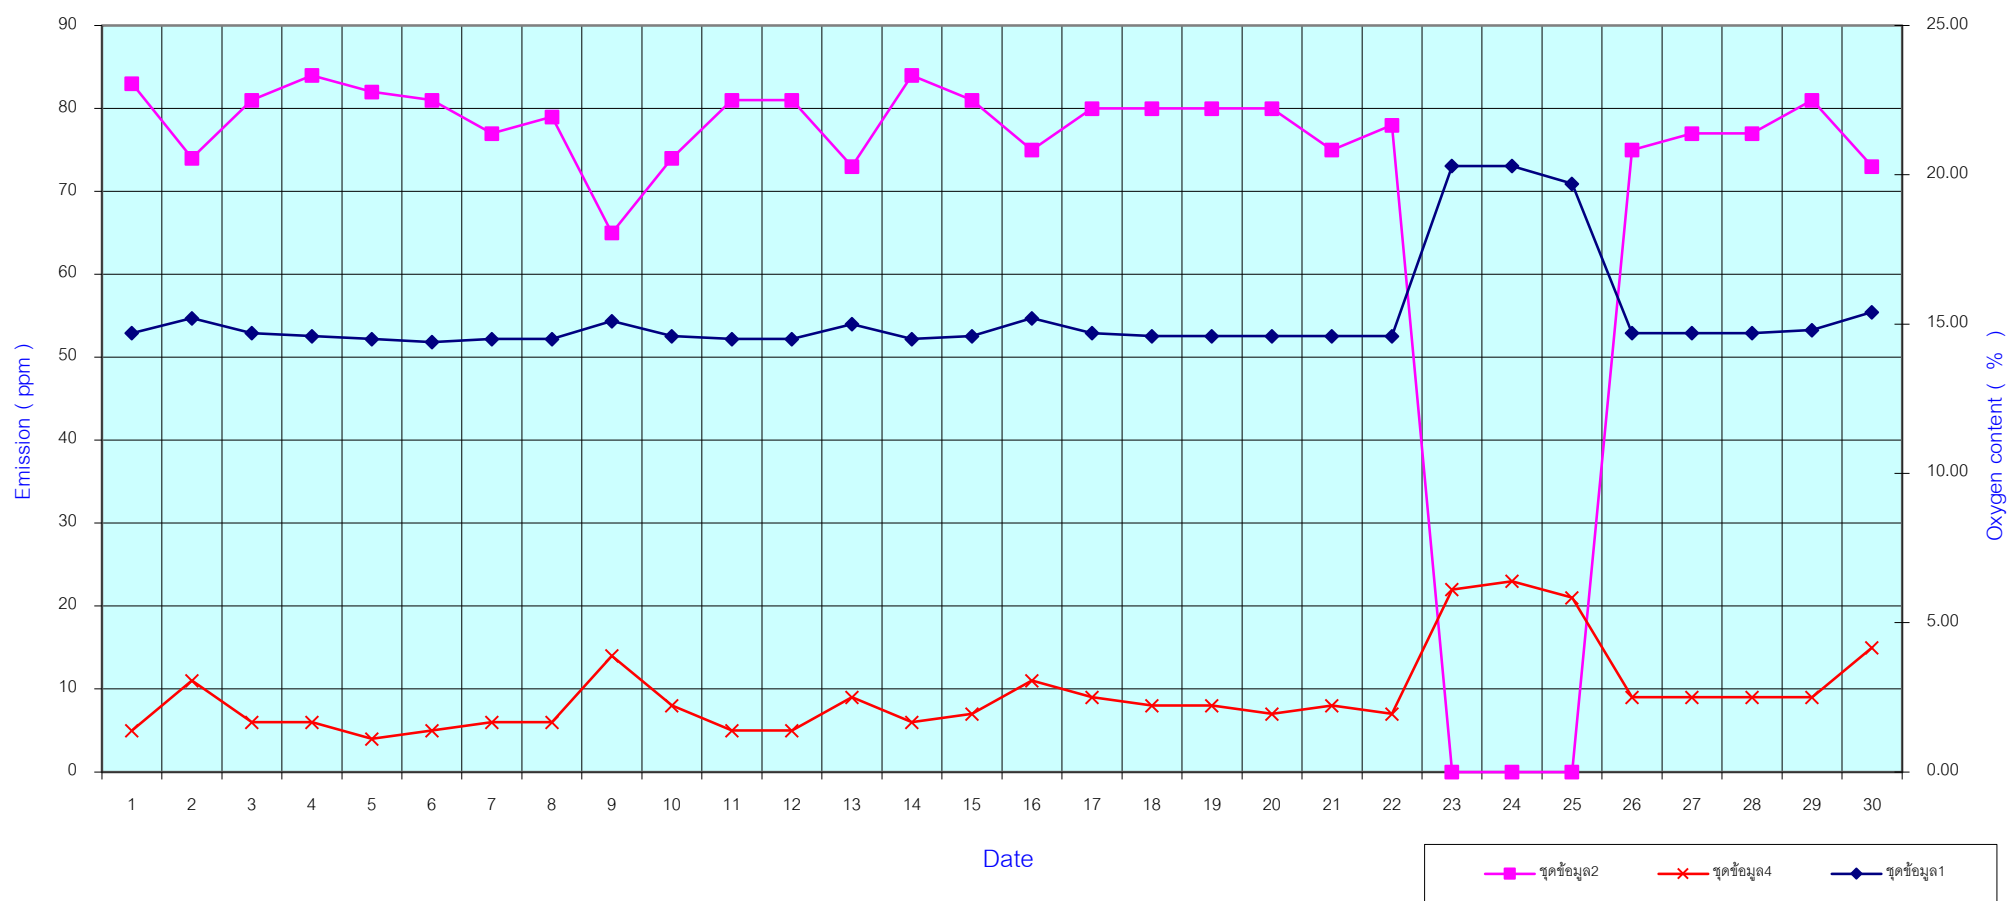


HRSG 11

Nov-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	Average
Oxygen Average	15.00	14.90	14.80	14.80	14.70	15.00	14.70	14.80	14.70	14.60	14.60	14.60	14.90	14.70	14.60	14.60	14.60	14.60	14.60	15.00	14.70	14.60	14.60	14.60	14.60	14.70	14.10	14.60	14.60	14.60	14.68
Nox Average	77.00	82.00	82.00	82.00	77.00	76.00	75.00	76.00	80.00	75.00	74.00	72.00	66.00	66.00	70.00	67.00	68.00	65.00	63.00	62.00	62.00	67.00	59.00	69.00	64.00	68.00	78.00	59.00	61.00	62.00	70.13
CO Average	35.00	27.00	24.00	28.00	29.00	25.00	28.00	25.00	21.00	23.00	20.00	23.00	33.00	31.00	24.00	30.00	23.00	35.00	33.00	36.00	33.00	26.00	42.00	20.00	33.00	23.00	9.00	31.00	33.00	29.00	27.73

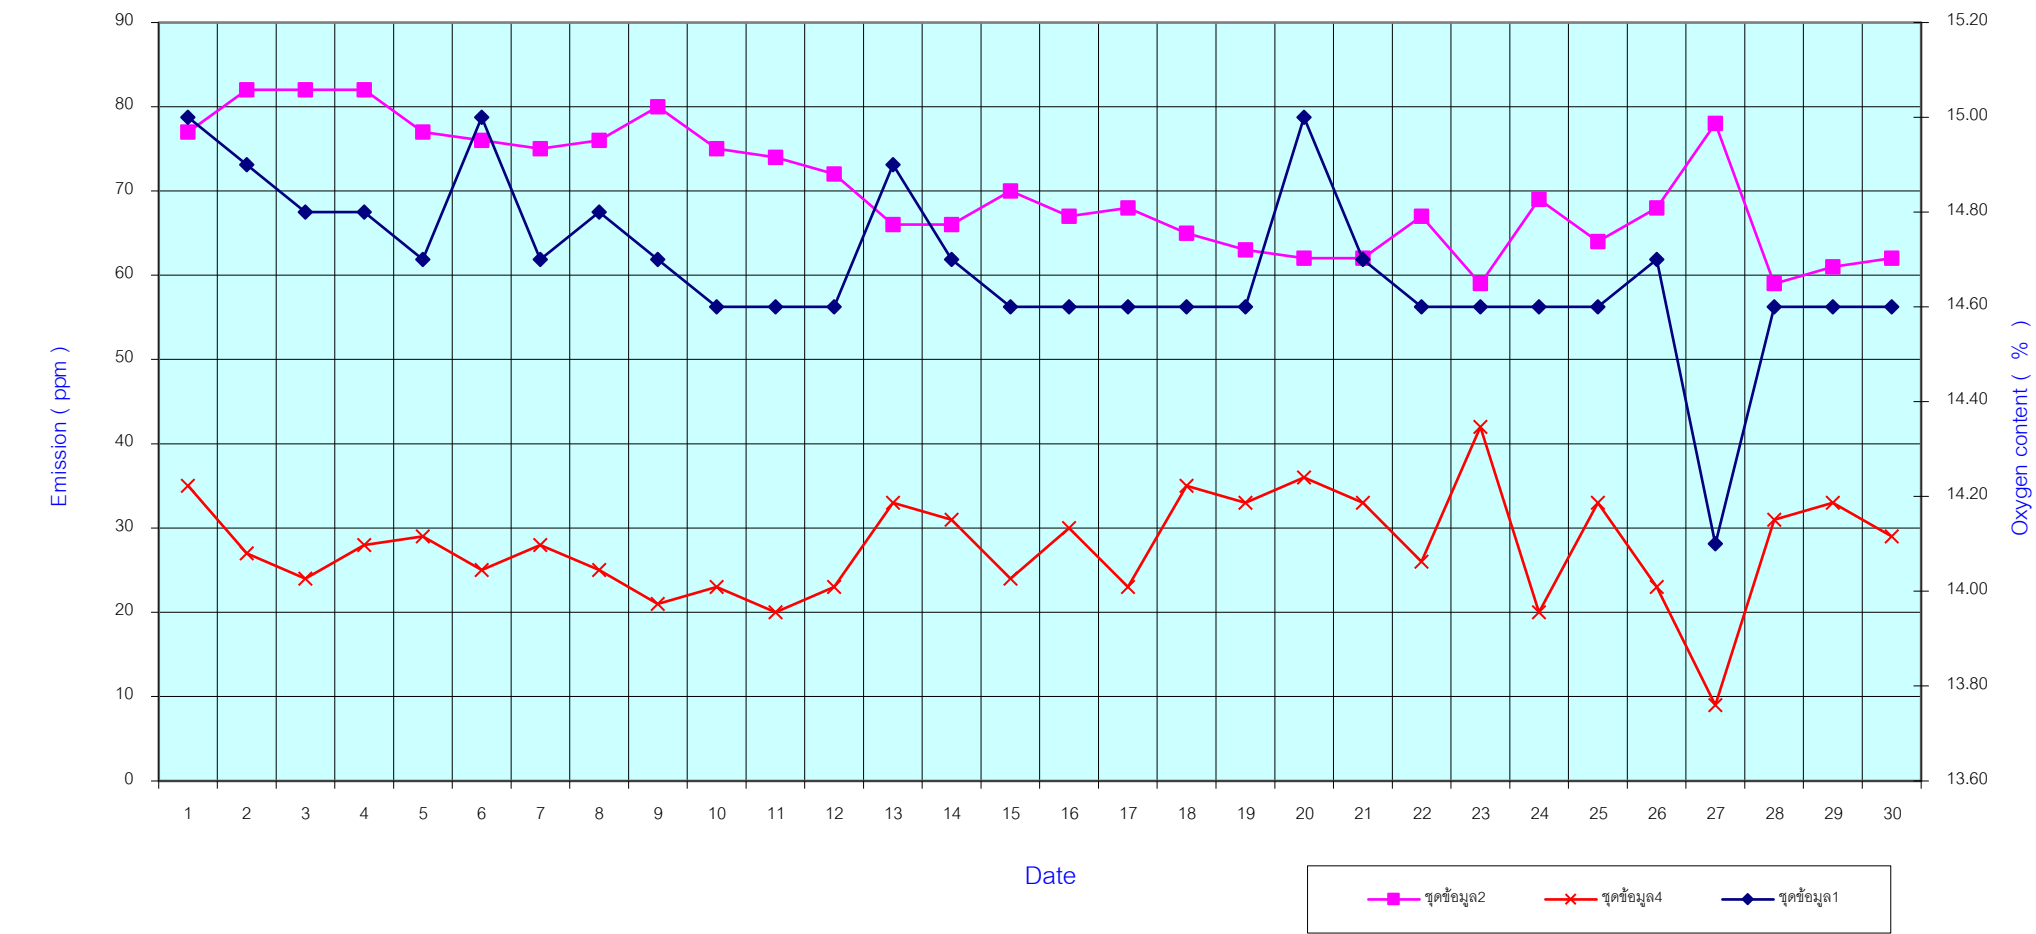


HRSG 12

Oct-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	14.70	15.20	14.70	14.60	14.50	14.40	14.50	14.50	15.10	14.60	14.50	14.50	15.00	14.50	14.60	15.20	14.70	14.60	14.60	14.60	14.60	14.60	20.30	20.30	19.70	14.70	14.70	14.70	14.80	15.40	14.90	15.24
NOx Average	83.00	74.00	81.00	84.00	82.00	81.00	77.00	79.00	65.00	74.00	81.00	81.00	73.00	84.00	81.00	75.00	80.00	80.00	80.00	80.00	75.00	78.00	*	*	*	75.00	77.00	77.00	81.00	73.00	80.00	78.25
CO Average	5.00	11.00	6.00	6.00	4.00	5.00	6.00	6.00	14.00	8.00	5.00	5.00	9.00	6.00	7.00	11.00	9.00	8.00	8.00	7.00	8.00	7.00	22.00	23.00	21.00	9.00	9.00	9.00	9.00	15.00	11.00	9.32

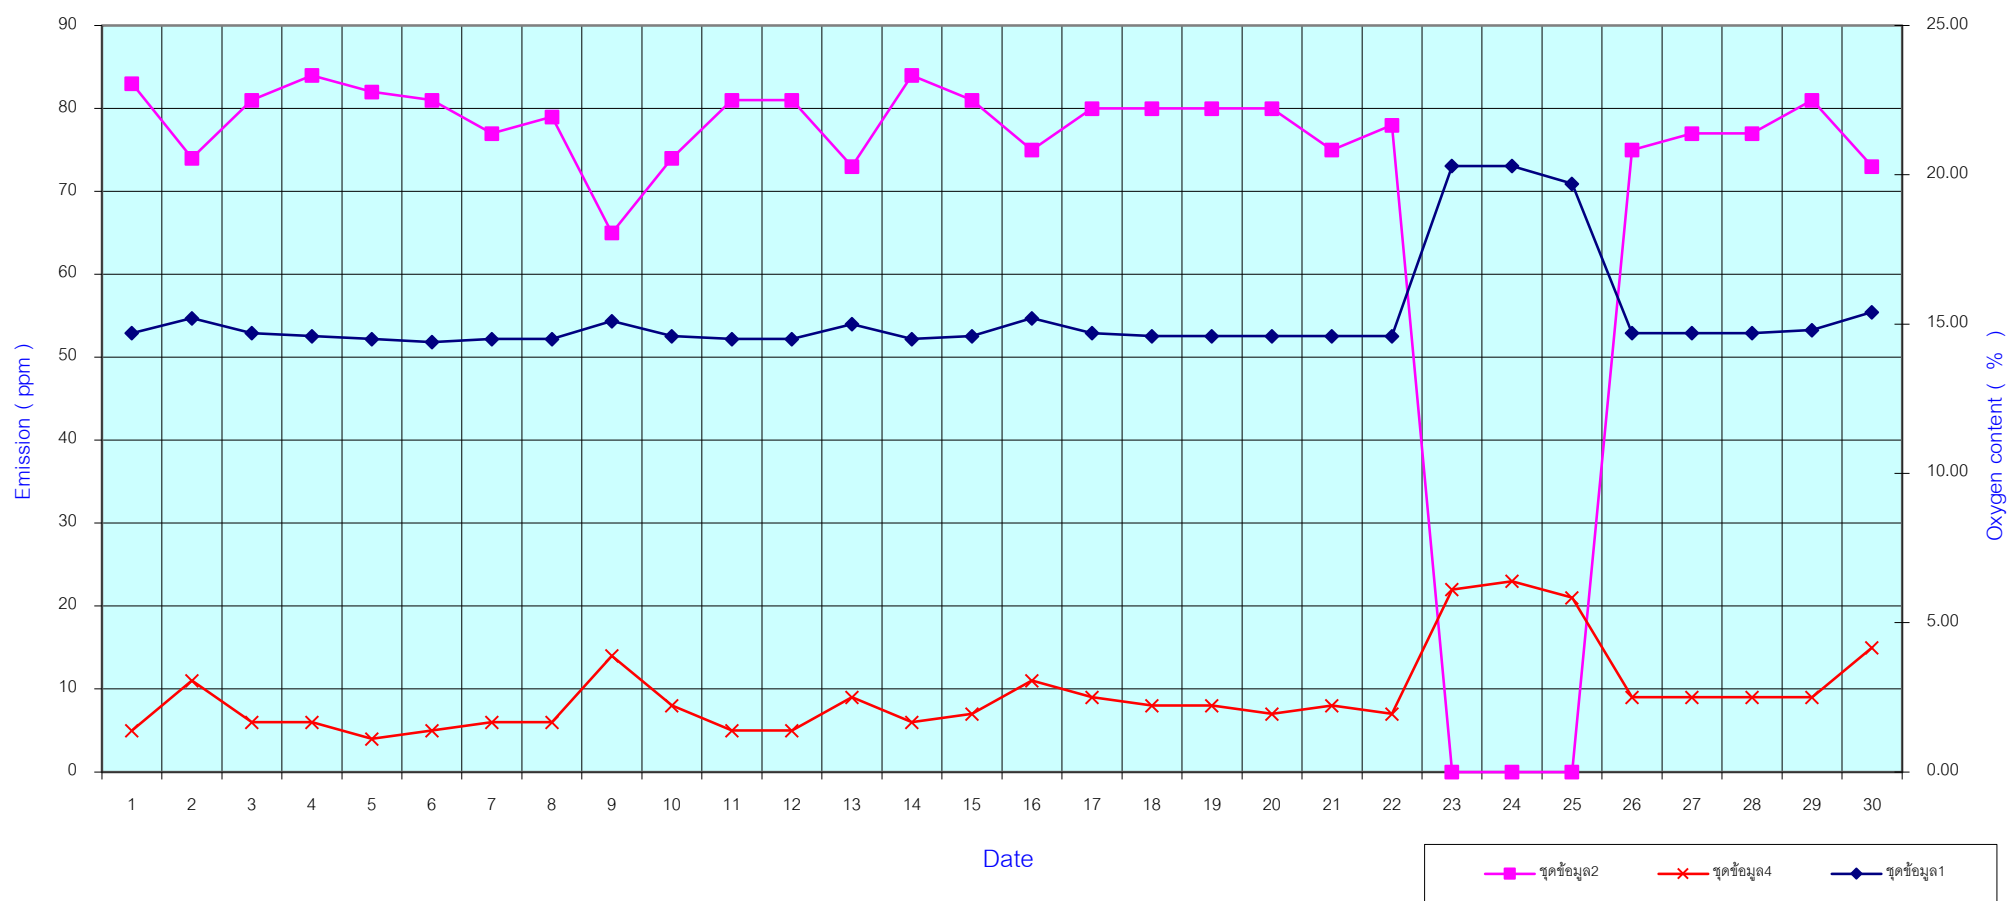


HRSG 11

Dec-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	14.60	14.60	14.50	14.90	14.80	14.60	14.60	14.50	14.70	15.10	15.20	15.10	14.90	14.80	14.70	14.70	16.30	14.90	14.90	14.80	14.80	14.80	14.90	15.30	15.50	18.00	18.20	20.30	20.30	20.30	15.62	
Nox Average	61.00	62.00	65.00	56.00	55.00	61.00	67.00	63.00	73.00	69.00	73.00	73.00	77.00	84.00	83.00	80.00	77.00	75.00	81.00	79.00	76.00	76.00	76.00	72.00	71.00	76.00	*	*	-1.00	-1.00	-1.00	64.07
CO Average	35.00	31.00	29.00	40.00	41.00	39.00	24.00	27.00	23.00	38.00	28.00	38.00	36.00	24.00	21.00	21.00	23.00	37.00	35.00	26.00	25.00	27.00	27.00	39.00	51.00	34.00	21.00	17.00	16.00	17.00	1.00	28.74

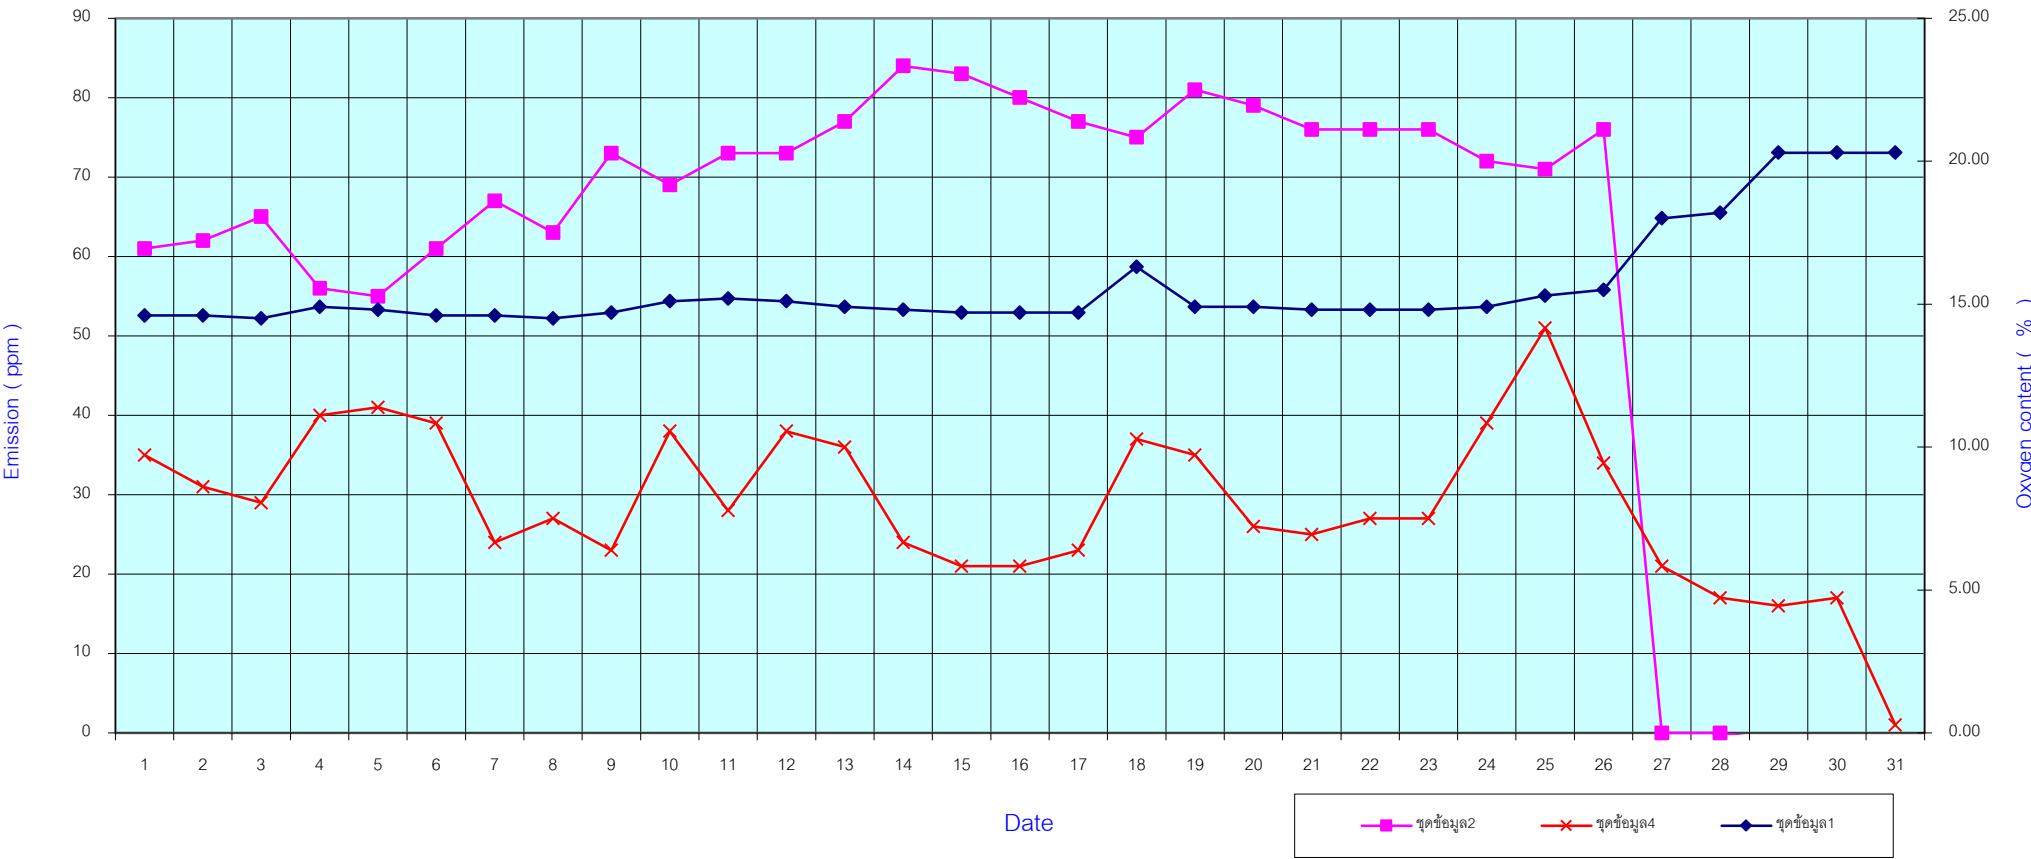

Dec-22	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Oxygen Average	15.10	14.90	14.90	15.30	15.20	15.00	15.00	14.80	15.00	15.70	15.80	15.80	15.50	15.40	15.30	15.30	15.50	15.60	15.50	15.50	15.50	15.40	15.50	15.90	15.50	14.80	14.60	14.10	14.10	14.60	15.21	
NOx Average	67.00	69.00	71.00	66.00	65.00	70.00	70.00	68.00	76.00	75.00	76.00	81.00	86.00	89.00	88.00	83.00	82.00	85.00	89.00	87.00	85.00	80.00	79.00	82.00	81.00	85.00	91.00	89.00	90.00	89.00	83.00	79.90
CO Average	13.00	12.00	10.00	15.00	14.00	12.00	11.00	11.00	10.00	19.00	20.00	17.00	3.00	11.00	10.00	10.00	11.00	13.00	13.00	11.00	12.00	14.00	13.00	14.00	19.00	13.00	3.00	3.00	1.00	1.00	4.00	11.06

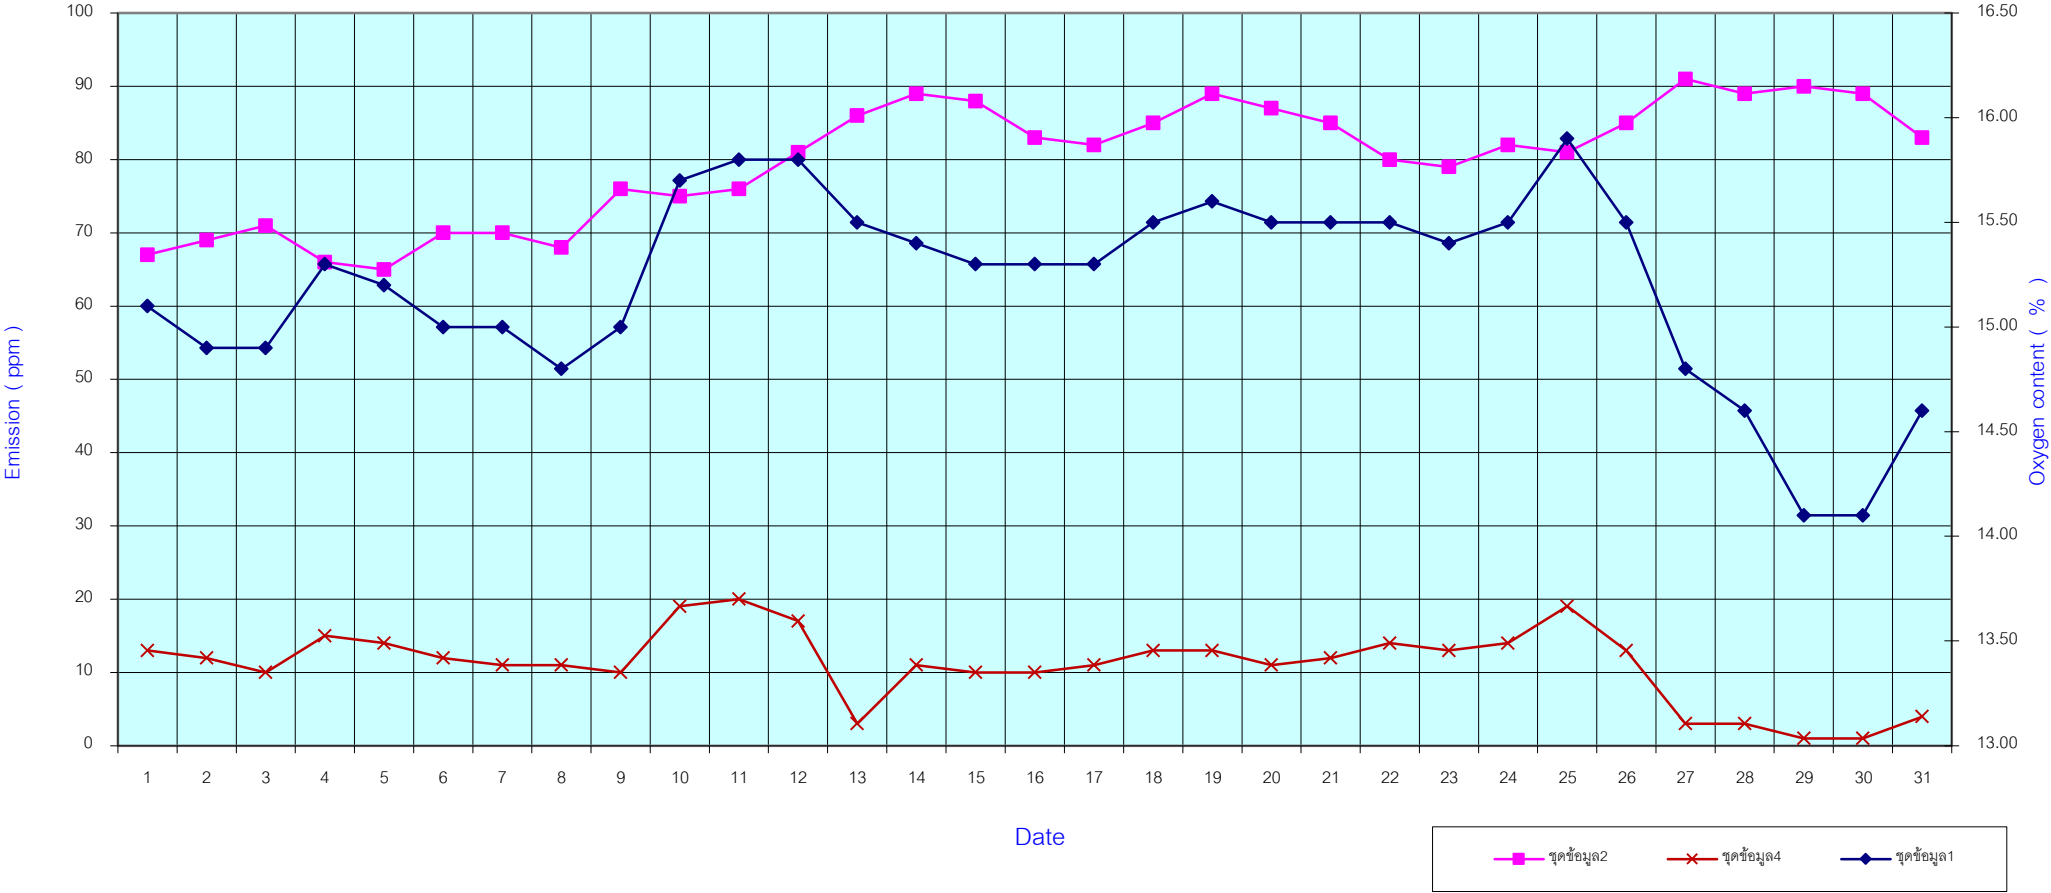

Remark : * = No data