



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925
6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925



TESTING 1661

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660130-191
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66010175
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 18/01/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 19/01/2023 - 30/01/2023
SAMPLING DATE : 18/01/2023 REPORTED DATE : 30/01/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
pH at 25.0 °C ^{/1}	-	4500-H ⁺ B. Electrometric Method	7.75	5.0 - 9.0
Suspended Solids ^{/1,2}	mg/l	2540 D. Total Suspended Solids Dried at 103 - 105 °C	< 10	≤ 40
Sulfide ^{/1}	mg/l	4500-S ²⁻ F. Iodometric Method	0.81	≤ 1.0
TKN-Nitrogen ^{/1}	mg/l	4500-N _{org} B. Macro-Kjeldahl Method	2.24	≤ 35
Fat, Greases & Oil ^{/1}	mg/l	5520 B. Liquid-Liquid, Partition-Gravimetric Method	< 0.2	≤ 20
BOD ^{/1}	mg/l	5210 B. 5-Day BOD Test	2.14	≤ 30
Physical Appearance	Lightly Turbid			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

/1 : Registered by DIW ๖-192

/2 : Accredited by TISI 2017

Analyzed & Reviewed by Phagaporn Wisom cfor
(Mr.Amnad Jarana)
๖ - 192 - ค - 0002
Laboratory Supervisor



Approved by
(Ms. Krittika Thongsombut)
๖ - 192 - ค - 0001
General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY



บริษัท เซาท์เทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

๗10/ ม.๙ ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925

Analysis Report

CUSTOMER : **Siam Estate Co.,Ltd** REPORT NO. : 660130-191
 PROJECT : **BANDARA PHUKET BEACH RESORT** SAMPLE NO. : 66010175
 LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 18/01/2023
 SAMPLING SOURCE : **Effluent Water** TESTED DATE : 19/01/2023 - 30/01/2023
 SAMPLING DATE : 18/01/2023 REPORTED DATE : 30/01/2023
 SAMPLING BY : Kittichai ๖-192-๑-0005
 METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
Total Dissolved Solids	mg/l	Electrometric Method	92	≤ 500*
Settleable Solids	ml/l	2540 F. Settleable Solids	< 0.1	≤ 0.5
Physical Appearance	Lightly Turbid			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7,

B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29,

B.E. 2548 (2005)

* : These values are in addition to the TDS of the water used

Analyzed & Reviewed by Phagapom W.Bom

(Mr.Amnad Jarana)

๖ - 192 - ก - 0002

Laboratory Supervisor



Approved by

(Ms. Kritika Thongsombut)

๖ - 192 - ก - 0001

General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
 REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY

--END OF REPORT--



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925



NSC - TISI - TIS 17025
TESTING 1661

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660223-264
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66020503
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 17/02/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 18/02/2023 - 23/02/2023
SAMPLING DATE : 17/02/2023 REPORTED DATE : 23/02/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
pH at 25.0 °C ^{/1}	-	4500-H ⁺ B. Electrometric Method	6.75	5.0 - 9.0
Suspended Solids ^{/1,2}	mg/l	2540 D. Total Suspended Solids Dried at 103 - 105 °C	< 10	≤ 40
Sulfide ^{/1}	mg/l	4500-S ²⁻ F. Iodometric Method	0.27	≤ 1.0
TKN-Nitrogen ^{/1}	mg/l	4500-N _{org} B. Macro-Kjeldahl Method	6.72	≤ 35
Fat, Greases & Oil ^{/1}	mg/l	5520 B. Liquid-Liquid, Partition-Gravimetric Method	0.20	≤ 20
BOD ^{/1}	mg/l	5210 B. 5-Day BOD Test	10.16	≤ 30
Physical Appearance	Lightly Turbid			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

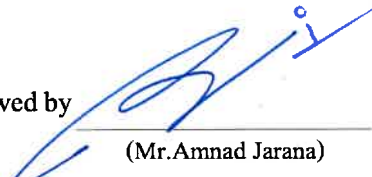
STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

/1 : Registered by DIW ๖-192


/2 : Accredited by TISI 2017

Analyzed & Reviewed by


(Mr. Amnad Jarana)
๖ - 192 - ก - 0002
Laboratory Supervisor



Approved by


(Ms. Krittika Thongsombut)
๖ - 192 - ก - 0001
General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY



บริษัท เซาท์เทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

๖/107 ม.๙ ซอยสาเข็ม ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660223-264
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66020503
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 17/02/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 18/02/2023 - 23/02/2023
SAMPLING DATE : 17/02/2023 REPORTED DATE : 23/02/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
Total Dissolved Solids	mg/l	Electrometric Method	139	≤ 500*
Settleable Solids	ml/l	2540 F. Settleable Solids	< 0.1	≤ 0.5
Physical Appearance	Lightly Turbid			

Remark

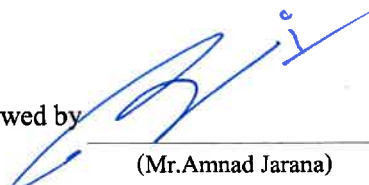
Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7,
B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29,
B.E. 2548 (2005)

* : These values are in addition to the TDS of the water used (TDS of water used is 68.2 mg/l)

Analyzed & Reviewed by


(Mr. Amnad Jarana)
๖ - 192 - ๖ - 0002
Laboratory Supervisor



Approved by


(Ms. Kritika Thongsombut)
๖ - 192 - ๖ - 0001
General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY

--END OF REPORT--



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาชิม ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925



TESTING 1661

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660323-289
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66030767
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 15/03/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 16/03/2023 - 23/03/2023
SAMPLING DATE : 15/03/2023 REPORTED DATE : 23/03/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
pH at 25.0 °C ^{/1}	-	4500-H ⁺ B. Electrometric Method	6.36	5.0 - 9.0
Suspended Solids ^{/1,2}	mg/l	2540 D. Total Suspended Solids Dried at 103 - 105 °C	< 10	≤ 40
Sulfide ^{/1}	mg/l	4500-S ²⁻ F. Iodometric Method	0.27	≤ 1.0
TKN-Nitrogen ^{/1}	mg/l	4500-N _{org} B. Macro-Kjeldahl Method	2.80	≤ 35
Fat, Greases & Oil ^{/1}	mg/l	5520 B. Liquid-Liquid, Partition-Gravimetric Method	< 0.2	≤ 20
BOD ^{/1}	mg/l	5210 B. 5-Day BOD Test	2.14	≤ 30
Physical Appearance	Lightly Turbid			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

/1 : Registered by DIW ๖-192

/2 : Accredited by TISI 2017

Analyzed & Reviewed by

(Mr. Amnad Jarana)

๖ - 192 - ๖ - 0002

Laboratory Supervisor



Approved by

(Ms. Kritika Thongsombut)

๖ - 192 - ๖ - 0001

General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY



บริษัท เซาท์เทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาชემ ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660323-289
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66030767
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 15/03/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 16/03/2023 - 23/03/2023
SAMPLING DATE : 15/03/2023 REPORTED DATE : 23/03/2023
SAMPLING BY : Kittichai 7-192-จ-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
Total Dissolved Solids	mg/l	Electrometric Method	147	≤ 500*
Settleable Solids	ml/l	2540 F. Settleable Solids	< 0.1	≤ 0.5
Fecal Coliform Bacteria	MPN/100ml	Multiple Tube Fermentation Technique	2.0	-
Physical Appearance	Lightly Turbid			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

* : These values are in addition to the TDS of the water used (TDS of water used is 77.5 mg/l)

Analyzed & Reviewed by

(Mr. Amnad Jarana)

จ - 192 - ค - 0002

Laboratory Supervisor



Approved by

(Ms. Krittika Thongsombut)

จ - 192 - ค - 0001

General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT WRITTEN APPROVAL OF THE LABORATORY

REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY

--END OF REPORT--



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925



NSC - TISI - TIS 17025

TESTING 1661

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660410-063
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66040956
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 03/04/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 04/04/2023 - 10/04/2023
SAMPLING DATE : 03/04/2023 REPORTED DATE : 10/04/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
pH at 25.0 °C ^{/1}	-	4500-H ⁺ B. Electrometric Method	7.29	5.0 - 9.0
Suspended Solids ^{/1,2}	mg/l	2540 D. Total Suspended Solids Dried at 103 - 105 °C	< 10	≤ 40
Sulfide ^{/1}	mg/l	4500-S ²⁻ F. Iodometric Method	< 0.10	≤ 1.0
TKN-Nitrogen ^{/1}	mg/l	4500-N _{org} B. Macro-Kjeldahl Method	11.20	≤ 35
Fat, Greases & Oil ^{/1}	mg/l	5520 B. Liquid-Liquid, Partition-Gravimetric Method	< 0.2	≤ 20
BOD ^{/1}	mg/l	5210 B. 5-Day BOD Test	7.94	≤ 30
Physical Appearance	Lightly Turbid			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

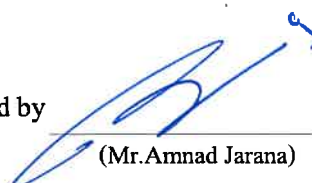
STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

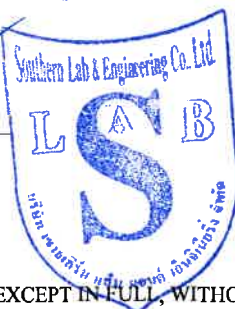
Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

/1 : Registered by DIW ๖-192


/2 : Accredited by TISI 2017

Analyzed & Reviewed by


(Mr. Amnad Jarana)
๖ - 192 - ค - 0002
Laboratory Supervisor



Approved by


(Ms. Krittika Thongsombut)
๖ - 192 - ค - 0001
General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

บ. 10 / ม. 9 ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660410-063
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66040956
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 03/04/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 04/04/2023 - 10/04/2023
SAMPLING DATE : 03/04/2023 REPORTED DATE : 10/04/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
Total Dissolved Solids	mg/l	Electrometric Method	182	≤ 500*
Settleable Solids	ml/l	2540 F. Settleable Solids	< 0.1	≤ 0.5
Fecal Coliform Bacteria	MPN/100ml	Multiple Tube Fermentation Technique	79.0	-
Physical Appearance	Lightly Turbid			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

* : These values are in addition to the TDS of the water used (TDS of water used is 114 mg/l)

Analyzed & Reviewed by

(Mr. Amnad Jarana)

๖ - 192 - ๖ - 0002

Laboratory Supervisor



Approved by

(Ms. Krittika Thongsombut)

๖ - 192 - ๖ - 0001

General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY

REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY

--END OF REPORT--



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาว์เขม ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925

6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925



NSC - TISI - TIS 17025

TESTING 1661

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660519-168
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66051407
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 12/05/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 13/05/2023 - 19/05/2023
SAMPLING DATE : 12/05/2023 REPORTED DATE : 19/05/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
pH at 25.0 °C ^{/1}	-	4500-H ⁺ B. Electrometric Method	6.68	5.0 - 9.0
Suspended Solids ^{/1,2}	mg/l	2540 D. Total Suspended Solids Dried at 103 - 105 ° C	49	≤ 40
Sulfide ^{/1}	mg/l	4500-S ²⁻ F. Iodometric Method	2.80	≤ 1.0
TKN-Nitrogen ^{/1}	mg/l	4500-N _{org} B. Macro-Kjeldahl Method	39.20	≤ 35
Fat, Greases & Oil ^{/1}	mg/l	5520 B. Liquid-Liquid, Partition-Gravimetric Method	1.60	≤ 20
BOD ^{/1}	mg/l	5210 B. 5-Day BOD Test	17.65	≤ 30
Physical Appearance	Turbid, Sediment			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

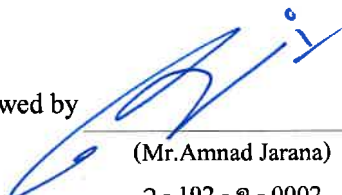
STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

/1 : Registered by DIW ๖-192


/2 : Accredited by TISI 2017

Analyzed & Reviewed by


(Mr. Amnad Jarana)
๖ - 192 - ๖ - 0002
Laboratory Supervisor



Approved by


(Ms. Krittika Thongsombut)
๖ - 192 - ๖ - 0001
General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

๖/๑๐/ ม.๙ ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925
6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925

Analysis Report

CUSTOMER	: Siam Estate Co.,Ltd	REPORT NO.	: 660519-168
PROJECT	: BANDARA PHUKET BEACH RESORT	SAMPLE NO.	: 66051407
LOCATION	: 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket	RECEIVED DATE	: 12/05/2023
SAMPLING SOURCE	: Effluent Water	TESTED DATE	: 13/05/2023 - 19/05/2023
SAMPLING DATE	: 12/05/2023	REPORTED DATE	: 19/05/2023
SAMPLING BY	: Kittichai ๖-192-๑-0005		
METHOD	: GRAB SAMPLING		

PARAMETER	UNIT	METHOD	RESULT	STANDARD
Total Dissolved Solids	mg/l	Electrometric Method	328	≤ 500*
Settleable Solids	ml/l	2540 F. Settleable Solids	0.2	≤ 0.5
Fecal Coliform Bacteria	MPN/100ml	Multiple Tube Fermentation Technique	17	-
Physical Appearance	Turbid, Sediment			

Remark

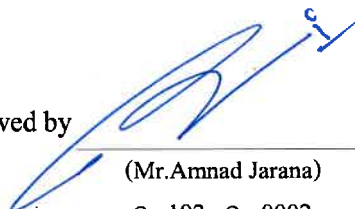
Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7, B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29, B.E. 2548 (2005)

* : These values are in addition to the TDS of the water used (TDS of water used is 112 mg/l)

Analyzed & Reviewed by


(Mr. Amnad Jarana)
๖ - 192 - ๑ - 0002
Laboratory Supervisor



Approved by


(Ms. Krittika Thongsombut)
๖ - 192 - ๑ - 0001
General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY

--END OF REPORT--



บริษัท เซาเทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925
6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925



TESTING 1661

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660619-177
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66061742
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 09/06/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 10/06/2023 - 19/06/2023
SAMPLING DATE : 09/06/2023 REPORTED DATE : 19/06/2023
SAMPLING BY : Kittichai ๓-192-๓-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
pH at 25.0 °C ^{/1}	-	4500-H ⁺ B. Electrometric Method	6.76	5.0 - 9.0
Suspended Solids ^{/1,2}	mg/l	2540 D. Total Suspended Solids Dried at 103 - 105 °C	< 10	≤ 40
Sulfide ^{/1}	mg/l	4500-S ²⁻ F. Iodometric Method	0.27	≤ 1.0
TKN-Nitrogen ^{/1}	mg/l	4500-N _{org} B. Macro-Kjeldahl Method	30.80	≤ 35
Fat, Greases & Oil ^{/1}	mg/l	5520 B. Liquid-Liquid, Partition-Gravimetric Method	1.00	≤ 20
BOD ^{/1}	mg/l	5210 B. 5-Day BOD Test	24.10	≤ 30
Physical Appearance	Turbid, Sediment			

Remark

Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7,
B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29,
B.E. 2548 (2005)

/1 : Registered by DIW ๓-192

/2 : Accredited by TISI 2017

Analyzed & Reviewed by

(Mr. Amnad Jarana)

๓ - 192 - ค - 0002

Laboratory Supervisor



Approved by

(Ms. Kritika Thongsombut)

๓ - 192 - ค - 0001

General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY



บริษัท เซาท์เทิร์น แล็บ แอนด์ เอ็นจิเนียริง จำกัด

Southern Lab & Engineering Co., Ltd.

6/107 ม.9 ซอยเสาช้าง ถนนศักดิ์เดช ต.วิชิต อ.เมือง จ.ภูเก็ต 83000 โทรศัพท์ 076-215-900 โทรสาร 076-215-925
6/107 M.9 Soi Saokhem Sakdided Road Wichit, Maung, Phuket 83000 Tel. 076-215-900 Fax. 076-215-925

Analysis Report

CUSTOMER : Siam Estate Co.,Ltd REPORT NO. : 660619-177
PROJECT : BANDARA PHUKET BEACH RESORT SAMPLE NO. : 66061742
LOCATION : 96, 98 Moo 8 Wichit Subdistrict, Muang, Phuket RECEIVED DATE : 09/06/2023
SAMPLING SOURCE : Effluent Water TESTED DATE : 10/06/2023 - 19/06/2023
SAMPLING DATE : 09/06/2023 REPORTED DATE : 19/06/2023
SAMPLING BY : Kittichai ๖-192-๖-0005
METHOD : GRAB SAMPLING

PARAMETER	UNIT	METHOD	RESULT	STANDARD
Total Dissolved Solids	mg/l	Electrometric Method	311	≤ 500*
Settleable Solids	ml/l	2540 F. Settleable Solids	< 0.1	≤ 0.5
Physical Appearance	Turbid, Sediment			

Remark

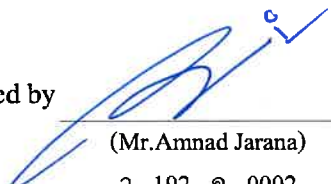
Analysis Method : Standard Methods For the Examination of Water and Wastewater 23rd Edition 2017

STANDARD : Building Effluents Standards : The building type B, Hotel 60 rooms to not greater than 200 rooms

Notification of the Ministry of Natural Resources and Environment : Building Effluents Standards dated November 7,
B.E. 2548 (2005) published in the Royal Government Gazette, Vol. 122 Part 125 D, dated December 29,
B.E. 2548 (2005)


* : These values are in addition to the TDS of the water used (TDS of water used is 122 mg/l)

Analyzed & Reviewed by


(Mr. Amnad Jarana)
๖ - 192 - ค - 0002
Laboratory Supervisor



Approved by


(Ms. Kritika Thongsombut)
๖ - 192 - ค - 0001
General Manager

THIS ANALYSIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY
REPORTED ANALYSIS REFER TO SUBMITTED SAMPLE(S) AND APPLY TO THE SAMPLE AS RECEIVED ONLY

--END OF REPORT--