

ภาคผนวกที่ 3

แบบบันทึกระบบบำบัดน้ำเสีย (ทส.1)

สถิติและข้อมูลที่ได้รับจากแหล่งกำเนิดมลพิษ															
วัน เดือน ปี	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	ลายมือชื่อผู้บันทึก
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบละกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
1/7/23	14	80	60.1	82.24	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	วัชร
2/7/23	14	40	82	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
3/7/23	13	32	45	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
4/7/23	13	45	30	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
5/7/23	14	53	42.8	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
6/7/23	15	62	30.1	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
7/7/23	9	๙4	60.3	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
8/7/23	10	80	50.1	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
9/7/23	14	61	50.3	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
10/7/23	13	92	85.1	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
11/7/23	13	45	23.4	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
12/7/23	14	32	60.1	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
13/7/23	15	40	32.4	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
14/7/23	13	32	32	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
15/7/23	14	40	41	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร
16/7/23	12	41	20	๙๙	-	๙๙	๙๙	๙๙	๙๙	-	๙๙	๙๙	-	-	วัชร

สถิติและข้อมูลที่ได้จากแหล่งกำเนิดมลพิษ

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ															
วัน เดือน ปี	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ ในทุกกิจกรรมของ แหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณสารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัดน้ำเสีย ที่นำไปกำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทางแก้ไข	ลายมือชื่อ ผู้บันทึก
						การบำบัดน้ำเสีย									
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวนผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวนผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบลบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
๗/๗/๒๕	๑๔	๔๑	๒๘	๐๖.๗	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	วัชร
๑๔/๗/๒๕	๑๒	๔๐	๒๐	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๑๗/๗/๒๕	๑๔	๒๒	๔๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๐/๗/๒๕	๑๓	๔๕	๒๒	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๑/๗/๒๕	๑๕	๗๕	๖๐.๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๒/๗/๒๕	๑๔	๔๕	๒๓.๔	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๓/๗/๒๕	๑๓	๑๒	๘๕.๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๔/๗/๒๕	๑๓	๖๑	๓๐	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๕/๗/๒๕	๑๔	๘๐	๔๕	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๖/๗/๒๕	๑๐	๔๒	๕๒.๓	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๗/๗/๒๕	๑	๗๔	๓๒	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๘/๗/๒๕	๑๕	๖๒	๖๐.๓	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๒๙/๗/๒๕	๑๔	๕๓	๔๐	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๓๐/๗/๒๕	๑๐	๔๕	๔๗	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร
๓๑/๗/๒๕	๑	๓๒	๖๐.๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	วัชร

สถิติและข้อมูลที่ได้จากแหล่งกำเนิดมลพิษ															
วัน เดือน ปี	ปริมาณ การใช้ ไฟฟ้าของ ระบบ บำบัดน้ำ เสีย (หน่วย)	ปริมาณ น้ำใช้ ในกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณน้ำ เสียที่เข้า ระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบาย น้ำทิ้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่ไม่ กำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทาง แก้ไข	ลายมือชื่อ ผู้บันทึก
						การบำบัดน้ำเสีย									
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่อง สูบน้ำ (ปกติ/ ผิดปกติ)	เครื่องเติม อากาศ (ปกติ/ ผิดปกติ)	เครื่องกรอง/ ผสมน้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องกรอง/ ผสมสารเคมี (ปกติ/ ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)			
1/8/23	20	46	44.9	ระดม	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
2/8/23	13	41	42	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
3/8/23	14	68	70	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
4/8/23	14	44	48	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
5/8/23	19	49	45	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
6/8/23	28	70	68	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
7/8/23	23	60	56	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
8/8/23	13	141	112.5	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
9/8/23	12	66	42	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
10/8/23	20	49	70	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
11/8/23	14	81	51	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
12/8/23	20	67	65	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
13/8/23	14	90	42	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
14/8/23	13	64	70	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
15/8/23	13	44	45	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	
16/8/23	14	45	75	77	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	

สถิติและข้อมูลที่เกี่ยวข้องกับการดำเนินงานตามแผนลพิษ															
วัน เดือน ปี	ปริมาณ การใช้ ไฟฟ้าของ ระบบ บำบัดน้ำ เสีย (หน่วย)	ปริมาณ น้ำใช้ ในทุกกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณน้ำ เสียที่เข้า ระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบาย น้ำทิ้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การดำเนินงานของระบบบำบัดน้ำเสีย							ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทาง แก้ไข	ลายมือชื่อ ผู้บันทึก
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่อง สูบน้ำ (ปกติ/ ผิดปกติ)	เครื่องเติม อากาศ (ปกติ/ ผิดปกติ)	เครื่องกรอง น้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องสารเคมี (ปกติ/ ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)			
๑๑/๑/๒๖	๑๐	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๒/๑/๒๖	๑๑	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๓/๑/๒๖	๑๒	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๔/๑/๒๖	๑๓	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๕/๑/๒๖	๑๔	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๖/๑/๒๖	๑๕	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๗/๑/๒๖	๑๖	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๘/๑/๒๖	๑๗	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๑๙/๑/๒๖	๑๘	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๐/๑/๒๖	๑๙	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๑/๑/๒๖	๒๐	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๒/๑/๒๖	๒๑	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๓/๑/๒๖	๒๒	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๔/๑/๒๖	๒๓	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๕/๑/๒๖	๒๔	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๖/๑/๒๖	๒๕	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๗/๑/๒๖	๒๖	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๘/๑/๒๖	๒๗	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๒๙/๑/๒๖	๒๘	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๓๐/๑/๒๖	๒๙	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.
๓๑/๑/๒๖	๓๐	๔๕	๖๐	๖๖๖๖	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	จ.ช.ช.

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ															ลายมือชื่อ ผู้บันทึก	
วัน เดือน ปี	ปริมาณ การใช้ ไฟฟ้าของ ระบบ บำบัดน้ำ เสีย (หน่วย)	ปริมาณ น้ำใช้ ในทุกกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณน้ำ เสียที่เข้า ระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบาย น้ำทิ้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สภาพที่ใช้ (ชื่อ/ปริมาณ) (ลดหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่ไม่ กำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทาง แก้ไข		
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่อง สูบน้ำ (ปกติ/ ผิดปกติ)	เครื่องเติม อากาศ (ปกติ/ ผิดปกติ)	เครื่องกรอง น้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องกรอง สารเคมี (ปกติ/ ผิดปกติ)	เครื่องสูบลบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)				
1/1/23	13	60	41	รวม	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
2/1/23	15	41	65	49	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
3/1/23	14	42	41	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
4/1/23	13	53	42	49	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
5/1/23	13	41	70	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
6/1/23	28	40	80	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
7/1/23	23	52	56	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
8/1/23	13	58	45	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
9/1/23	28	48	41	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
10/1/23	15	64	65	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
11/1/23	13	42	42	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
12/1/23	14	41	84.5	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
13/1/23	13	64	41	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
14/1/23	14	48	45	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
15/1/23	25	80	72	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร
16/1/23	13	64	80	41	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	ปกติ	-	-	วัชร

สถิติและข้อมูลที่ได้รับจากแหล่งกำเนิดมลพิษ

วัน เดือน ปี	ปริมาณ การใช้ ไฟฟ้าของ ระบบ บำบัดน้ำ เสีย (หน่วย)	ปริมาณ น้ำใช้ ในกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณน้ำ เสียที่เข้า ระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบาย น้ำทิ้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทาง แก้ไข	ลายมือชื่อ ผู้บันทึก
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่อง สูบน้ำ (ปกติ/ ผิดปกติ)	เครื่องเติม อากาศ (ปกติ/ ผิดปกติ)	เครื่องกวน/ ผสมน้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องกวน/ ผสมสารเคมี (ปกติ/ ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)			
14/1/23	14	66	55.2	85.99	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	ส.ว.
14/1/23	12	42	48.9	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	13	64	60.4	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	15	48	๗6	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	14	๗0	๗0	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	13	64	54	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	14	42	42	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	10	48	60	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	๑	52	42	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	15	48	6๑	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	14	41	52	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	10	43	62	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	๑	64	6๑.2	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
14/1/23	15	81	52.8	๗	-	๗	๗	๗	๗	-	๗	๗	-	-	ส.ว.
															ส.ว.
															ส.ว.

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ

สถิติและข้อมูลที่ได้จากแหล่งกำเนิดมลพิษ															
วันที่ เดือน ปี	ปริมาณ การใช้ ไฟฟ้าของ ระบบ บำบัดน้ำ เสีย (หน่วย)	ปริมาณ น้ำใช้ ในกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณน้ำ เสียที่เข้า ระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบาย น้ำทิ้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่ไม่ กำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทาง แก้ไข	ลายมือชื่อ ผู้บันทึก
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่อง สูบน้ำ (ปกติ/ ผิดปกติ)	เครื่องเติม อากาศ (ปกติ/ ผิดปกติ)	เครื่องกวน/ ผสมน้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องกวน/ ผสมสารเคมี (ปกติ/ ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)			
1/10/23	10	55	63.1	ระบบ	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	วัชร
2/10/23	7	39	80	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
3/10/23	14	60	43	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
4/10/23	13	41	48	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
5/10/23	25	45	43	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
6/10/23	18	80	54	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
7/10/23	14	46	80.5	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
8/10/23	25	39	43	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
9/10/23	14	32	48	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
10/10/23	15	45	43	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
11/10/23	25	40	54	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
12/10/23	8	67	65	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
13/10/23	10	80	63	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
14/10/23	25	45	42	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
15/10/23	14	40	80	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร
16/10/23	13	39	40	พ	-	พ	พ	พ	พ	-	พ	พ	-	-	วัชร

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ

สถิติและข้อมูลสู่ที่เก็บจากแหล่งกำเนิดมลพิษ															
วัน เดือน ปี	ปริมาณ การใช้ ไฟฟ้าของ ระบบ บำบัดน้ำ เสีย (หน่วย)	ปริมาณ น้ำใช้ ในทุกกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณน้ำ เสียที่เข้า ระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบาย น้ำทั้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทาง แก้ไข	ลายมือชื่อ ผู้บันทึก
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่อง สูบน้ำ (ปกติ/ ผิดปกติ)	เครื่องเติม อากาศ (ปกติ/ ผิดปกติ)	เครื่องทวง ผลน้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องทวง ผลสารเคมี (ปกติ/ ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)			
17/10/23	14	41	28	ระบบ	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	วัชร
18/10/23	14	40	20	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
19/10/23	14	32	41	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
20/10/23	13	45	32	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
21/10/23	14	15	60.1	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
22/10/23	15	45	30	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
23/10/23	9	92	45	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
24/10/23	10	61	23.4	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
25/10/23	13	14	50.1	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
26/10/23	14	62	30	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
27/10/23	15	45	42	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
28/10/23	14	32	30	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
29/10/23	13	40	32	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
30/10/23	13	80	85.1	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร
31/10/23	12	53	62.3	ก	-	ก	ก	ก	ก	-	ก	ก	-	-	วัชร

สถิติและข้อมูลที่ได้เก็บจากแหล่งกำเนิดมลพิษ

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ															
วัน เดือน ปี	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	ลายมือชื่อผู้บันทึก
						การบำบัดน้ำเสีย									
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องทวงผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องทวงผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบลำตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
1/11/23	21	90	62	รวม	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	วัชร
2/11/23	11	91	43	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
3/11/23	20	60	54	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
4/11/23	23	85	45.6	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
5/11/23	14	90	72	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
6/11/23	14	67	63	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
7/11/23	15	89	90	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
8/11/23	13	65	42	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
9/11/23	25	98	80	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
10/11/23	12	67	40	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
11/11/23	13	90	54	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
12/11/23	14	45	78	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
13/11/23	25	65	62	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
14/11/23	20	90	72	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
15/11/23	28	90	34	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร
16/11/23	14	98	65	ฯ	-	ฯ	ฯ	ฯ	ฯ	-	ฯ	ฯ	-	-	วัชร

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ																
วัน เดือน ปี	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย/ไม่ระบาย	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย								ปริมาณตะกอนส่วนเกินที่ผลิตขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	ลายมือชื่อผู้บันทึก
						การบำบัดน้ำเสีย										
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องทวงผลน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องทวงผลสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบลบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)				
๓๑/๓/๒๕	๑๐	48	82	รวม ๑๔	-	ปกติ	ปกติ	ปกติ	ปกติ	-	ปกติ	ปกติ	-	-	-	วัชรวิษ
๑๘/๓/๒๕	13	๕1	๗๐	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๑๙/๓/๒๕	14	๕๘	๗9.5	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒๐/๓/๒๕	20	๕4	56	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒1/๓/๒๕	14	๙๙	๕๕.4	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒๒/๓/๒๕	13	๗0	๖8	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒๓/๓/๒๕	14	๕5	56	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒4/๓/๒๕	13	๕6	54	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒5/๓/๒๕	๑0	๗0	110	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒6/๓/๒๕	23	๕4	๗0	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒๗/๓/๒๕	14	๕7	๕๑	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒๘/๓/๒๕	13	๕1	๗0	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๒๙/๓/๒๕	20	๙0	๕5	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ
๓๐/๓/๒๕	28	141	112.5	๓	-	๓	๓	๓	๓	-	๓	๓	-	-	-	วัชรวิษ

สถิติและข้อมูลที่เป็นบางกานแหล่งกำเนิดมลพิษ

สถิติและข้อมูลที่เป็นจากแหล่งกำเนิดมลพิษ															
วัน เดือน ปี	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	ลายมือชื่อผู้บันทึก
						การบำบัดน้ำเสีย									
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องทวนผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องทวนผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบลบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
1/12/23	90	65	62	ระบาย	-	ปกติ	ปกติ	ปกติ	ปกติ	ปกติ	ปกติ	ปกติ	-	-	วัชระ
2/12/23	13	90	43	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
3/12/23	14	70	54	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
4/12/23	14	80	45.6	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
5/12/23	13	85	72	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
6/12/23	14	40	80	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
7/12/23	15	65	65	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
8/12/23	20	99	40	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
9/12/23	13	67	62.8	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
10/12/23	10	59	78	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
11/12/23	14	60	54	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
12/12/23	14	68	43	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
13/12/23	20	95	62	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
14/12/23	12	90	66	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
15/12/23	28	70	42	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ
16/12/23	10	59	40	ก	-	ก	ก	ก	ก	ก	ก	ก	-	-	วัชระ

สถิติและข้อมูลที่ได้มาจากแหล่งกำเนิดมลพิษ																
วัน เดือน ปี	ปริมาณ การใช้ ไฟฟ้าของ ระบบ บำบัดน้ำ เสีย (หน่วย)	ปริมาณ น้ำใช้ ในกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณน้ำ เสียที่เข้า ระบบ บำบัดน้ำเสีย (ลบ.ม.)	การระบาย น้ำทิ้งจากระบบ บำบัดน้ำเสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย								ปริมาณ ตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหา อุปสรรค และ แนวทาง แก้ไข	ลายมือชื่อ ผู้บันทึก
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่อง สูบน้ำ (ปกติ/ ผิดปกติ)	เครื่องเติม อากาศ (ปกติ/ ผิดปกติ)	เครื่องกวน ผสมน้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องกวน ผสมสารเคมี (ปกติ/ ผิดปกติ)	เครื่องสูบลบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)				
๓๑/๑๒/๒๓	๙๐	๔๘	๕๒	๐๕๒๗	-	ปกติ	ปกติ	ปกติ	ปกติ	ปกติ	ปกติ	ปกติ	-	-	-	วัชร
๓๐/๑๒/๒๓	๙๓	๘๑	๔๓	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๙/๑๒/๒๓	๙๔	๕๔	๕๔	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๘/๑๒/๒๓	๙๕	๕๘	๕๘	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๗/๑๒/๒๓	๙๖	๖๐	๖๐.๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๖/๑๒/๒๓	๙๗	๖๑	๖๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๕/๑๒/๒๓	๙๘	๖๒	๖๒.๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๔/๑๒/๒๓	๙๙	๖๓	๖๓	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๓/๑๒/๒๓	๑๐๐	๖๔	๖๔	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๒/๑๒/๒๓	๑๐๑	๖๕	๖๕	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๑/๑๒/๒๓	๑๐๒	๖๖	๖๖	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๒๐/๑๒/๒๓	๑๐๓	๖๗	๖๗	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๙/๑๒/๒๓	๑๐๔	๖๘	๖๘	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๘/๑๒/๒๓	๑๐๕	๖๙	๖๙	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๗/๑๒/๒๓	๑๐๖	๗๐	๗๐	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๖/๑๒/๒๓	๑๐๗	๗๑	๗๑	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๕/๑๒/๒๓	๑๐๘	๗๒	๗๒	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๔/๑๒/๒๓	๑๐๙	๗๓	๗๓	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๓/๑๒/๒๓	๑๑๐	๗๔	๗๔	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๒/๑๒/๒๓	๑๑๑	๗๕	๗๕	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๑/๑๒/๒๓	๑๑๒	๗๖	๗๖	๙๑	-	๙๑	๙๑	๙๑	๙๑	-	๙๑	๙๑	-	-	-	วัชร
๑๐/๑๒/๒๓	๑๑๓	๗๗	๗๗	๙๑	-	๙๑	๙๑	๙๑	๙๑	-						

ภาคผนวกที่ 4

แบบบันทึก Fire Life Safety

Section: 10 – 02 Property: APS
Title: The record of the monthly inspect of all PEFs Date: 31 July 2023
Responsible Person: Pattharak Buranlue Pages: 1 to 3
File Number: 31.07.2023

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use		✓	
9	APS-PFE-009	CO ₂	Exec. Building Gen+MDB Room	Not to use	15 lbs.	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO ₂	Amaya Kitchen	Not to use	15 lbs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use		✓	
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use		✓	
53	APS-PFE-053	CO ₂	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
54	APS-PFE-054	CO ₂	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO ₂	Amaya Audio Room	Not to use	15 lbs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO ₂	Prego- KC	Not to use	15 lbs	Not to use	Product was [2012]

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use		✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO ₂	Fire Cart	Not to use	15 lbs.	Not to use	Product was [2012]
91	APS-PFE-091	CO ₂	Fire Cart	Not to use	10 lbs.	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

Summary

Type	Ready to use	Out Of Oder
Dry Chemical [DC]		75
Carbon Dioxide [CO ₂]		8
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	need install (1)

Name Person Responsible for Security:

Position:

Signature:

Date:

FLS 10-02 PFEs


Amari
 AMARI KOH SAMUI
 DATE 31 July 2023
 SIGNATURE [Signature]
 HEAD OF SECURITY

Section: 10 – 02 Property: APS
Title: The record of the monthly inspect of all PEFs Date: 2023 August
Responsible Person: Chief Engineer / Manager, Security Pages: 1 to 3
File Number: FLS 10-02. 2023.08

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC-003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use	✓	✓	
9	APS-PFE-009	CO ₂	Exec. Building Gen+MDB Room	Not to use	15 lbs	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]

DATE 15 August 2023
SIGNATURE [Signature]
HEAD OF SECURITY

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO ₂	Amaya Kitchen	Not to use	15 lbs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use		✓	
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use		✓	
53	APS-PFE-053	CO ₂	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
54	APS-PFE-054	CO ₂	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO ₂	Amaya Audio Room	Not to use	15 lbs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO ₂	Prego- KC	Not to use	15 lbs	Not to use	Product was [2012]

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use	-	✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO ₂	Fire Cart	Not to use	15 lbs	Not to use	Product was [2012]
91	APS-PFE-091	CO ₂	Fire Cart	Not to use	10 lbs	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

Summary

Type	Ready to use	Out Of Oder
Dry Chemical [DC]	MFG 1994 (2537) Recommended not to use	75
Carbon Dioxide [CO ₂]		8
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	

Name Person Responsible for Chief Engineer/ Manager, Security:

Position:

Signature:

Date:

FLS 10-02 PFEs

Amari
AMARI KOH SAMUI
DATE 16 August 2023
SIGNATURE [Signature]
HEAD OF SECURITY

Section: 10 – 02 Property: APS
Title: The record of the monthly inspect of all PEFs Date: 2023 September
Responsible Person: Chief Engineer / Manager, Security Pages: 1 to 3
File Number: FLS 10-02. 2023.09

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use		✓	
9	APS-PFE-009	CO ₂	Exec. Building Gen+MDB Room	Not to use	151bs	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO ₂	Amaya Kitchen	Not to use	101bs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use		✓	
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use		✓	
53	APS-PFE-053	CO ₂	Amaya back door	Not to use	161bs	Not to use	Product was [2012]
54	APS-PFE-054	CO ₂	Amaya back door	Not to use	151bs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO ₂	Amaya Audio Room	Not to use	101bs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO ₂	Prego- KC	Not to use	151bs	Not to use	Product was [2012]

DATE 16 September 2023
SIGNATURE [Signature]
HEAD OF SECURITY

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use	-	✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO ₂	Fire Cart	Not to use	15lbs	Not to use	Product was [2012]
91	APS-PFE-091	CO ₂	Fire Cart	Not to use	10lbs	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

Summary

Type	Ready to use	Out Of Oder
Dry Chemical [DC]	MFG 1994 < 2537 > Not recommended to use	75
Carbon Dioxide [CO ₂]		5
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	

Name Person Responsible for Chief Engineer/ Manager, Security:

Position:

Signature:

Date:

FLS 10-02 PFEs

Amari
AMARI KOH SAMUI
DATE 16 September 2023
SIGNATURE [Signature]
HEAD OF SECURITY


Section: 10 – 02 Property: APS
Title: The record of the monthly inspect of all PEFs Date: 2023 October
Responsible Person: Chief Engineer / Manager, Security Pages: 1 to 3
File Number: FLS 10-02. 2023.10.18

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use	✓		
9	APS-PFE-009	CO ₂	Exec. Building Gen+MDB Room	Not to use	10 lbs	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]

Amari
AMARI KOH SAMUI
DATE 16 Oct 2023
SIGNATURE [Signature]
HEAD OF SECURITY

ONYX Hospitality Group Fire Life Safety System

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO ₂	Amaya Kitchen	Not to use	15 lbs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use			
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use			
53	APS-PFE-053	CO ₂	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
54	APS-PFE-054	CO ₂	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO ₂	Amaya Audio Room	Not to use	15 lbs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO ₂	Prego- KC	Not to use	15 lbs	Not to use	Product was [2012]


 DATE 16 Oct 2023
 SIGNATURE [Signature]
 HEAD OF SECURITY

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use		✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO ₂	Fire Cart	Not to use	15 lbs	Not to use	Product was [2012]
91	APS-PFE-091	CO ₂	Fire Cart	Not to use	10 lbs	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

Summary

Type	Ready to use	Out Of Oder
Dry Chemical [DC]	MFG 1994 (2537) NOT Recommended to use.	75
Carbon Dioxide [CO ₂]		8
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	-


Name Person Responsible for Chief Engineer/ Manager, Security:

Position: *Manager, Security*

Signature: *Thomas Yim*

Date: *16 October 2023*

FLS 10-02 PFES

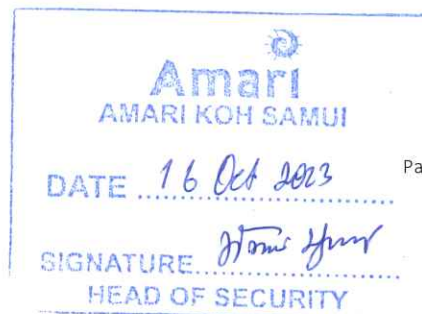

Section: Fire Life Safety
Title: Monthly inspect of all PEFs
Responsible Person: Chief Engineer / Manager, Security
File Number: FLS 10-02

Property: Amari Koh Samui
Date: November, 2023
Pages: 1 to 3

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
1	APS-PFE-001	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
2	APS-PFE-002	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
3	APS-PFE-003	DC	FHC-001 Exec. Building FI1	OK	√	√	Plan to change in early 2024
4	APS-PFE-004	DC	FHC-002 Exec. Building FI2	OK	√	√	Plan to change in early 2024
5	APS-PFE-005	DC	FHC 003 Exec. Building -FI3	OK	√	√	Plan to change in early 2024
6	APS-PFE-006	H	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
7	APS-PFE-007	K	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
8	APS-PFE-008	FBK	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
9	APS-PFE-009	CO ₂	Exec. Building Gen + MDB Room	OK	√	√	Plan to change in early 2024
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	OK	√	√	Plan to change in early 2024
11	APS-PFE-011	DC	FHC-005 HK Store FI1	OK	√	√	Plan to change in early 2024
12	APS-PFE-012	DC	FHC-006 FB Store FI1	OK	√	√	Plan to change in early 2024
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	OK	√	√	Plan to change in early 2024
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	OK	√	√	Plan to change in early 2024
15	APS-PFE-015	DC	FHC-009 HK Store FI2	OK	√	√	Plan to change in early 2024
16	APS-PFE-016	DC	FHC-010 FB Store FI2	OK	√	√	Plan to change in early 2024
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	OK	√	√	Plan to change in early 2024
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	OK	√	√	Plan to change in early 2024
19	APS-PFE-019	DC	FHC-013 HK Store FI3	OK	√	√	Plan to change in early 2024
20	APS-PFE-020	DC	FHC-014 ACC Store FI3	OK	√	√	Plan to change in early 2024
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	OK	√	√	Plan to change in early 2024
22	APS-PFE-022	DC	Next to Room 3109	OK	√	√	Plan to change in early 2024
23	APS-PFE-023	DC	Next to Room 3208	OK	√	√	Plan to change in early 2024
24	APS-PFE-024	DC	Next to Room 3212	OK	√	√	Plan to change in early 2024
25	APS-PFE-025	DC	Next to Room 3111	OK	√	√	Plan to change in early 2024
26	APS-PFE-026	DC	Next to Florist Room	OK	√	√	Plan to change in early 2024
27	APS-PFE-027	DC	Next to Room 3106	OK	√	√	Plan to change in early 2024
28	APS-PFE-028	DC	Next to Room 3204	OK	√	√	Plan to change in early 2024
29	APS-PFE-029	DC	Next to Room 3227	Old & Rusty	√	√	Plan to change in early 2024
30	APS-PFE-030	DC	Next to Room 3124	OK	√	√	Plan to change in early 2024
31	APS-PFE-031	DC	Next to Room 3225	Old & Rusty	√	√	Plan to change in early 2024

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
32	APS-PFE-032	DC	Next to Room 3221	Old & Rusty	√	√	Plan to change in early 2024
33	APS-PFE-033	DC	Next to Room 3129	OK	√	√	Plan to change in early 2024
34	APS-PFE-034	DC	Next to Room 3130	OK	√	√	Plan to change in early 2024
35	APS-PFE-035	DC	Next to Room 3132	Old & Rusty	√	√	Plan to change in early 2024
36	APS-PFE-036	DC	Next to Room 3134	OK	√	√	Plan to change in early 2024
37	APS-PFE-037	DC	Next to Room 3136	OK	√	√	Plan to change in early 2024
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	OK	√	√	Plan to change in early 2024
39	APS-PFE-039	DC	FHC-017 Next to Room 3117	Old & Rusty	√	√	Plan to change in early 2024
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Old & Rusty	√	√	Plan to change in early 2024
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Old & Rusty	√	√	Plan to change in early 2024
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Old & Rusty	√	√	Plan to change in early 2024
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Old & Rusty	√	√	Plan to change in early 2024
44	APS-PFE-044	DC	FHC-022 Next To Room 4110	OK	√	√	Plan to change in early 2024
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	OK	√	√	Plan to change in early 2024
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Old	√	√	Plan to change in early 2024
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Old & Rusty	√	√	Plan to change in early 2024
48	APS-PFE-048	DC	Amaya Toilet [Female]	Old & Rusty	√	√	Plan to change in early 2024
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	OK	√	√	Plan to change in early 2024
50	APS-PFE-050	CO ₂	Amaya Kitchen	OK	√	√	Plan to change in early 2024
51	APS-PFE-051	FBK	Amaya Kitchen	OK	√	√	Plan to change in early 2024
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	OK	√	√	Plan to change in early 2024
53	APS-PFE-053	CO ₂	Amaya back door	OK	√	√	Plan to change in early 2024
54	APS-PFE-054	CO ₂	Amaya back door	OK	√	√	Plan to change in early 2024
55	APS-PFE-055	DC	Amaya Gas Station	OK	√	√	Plan to change in early 2024
56	APS-PFE-056	CO ₂	Amaya Audio Room	OK	√	√	Plan to change in early 2024
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	OK	√	√	Plan to change in early 2024
58	APS-PFE-058	DC	SPA Entrance	OK	√	√	Plan to change in early 2024
59	APS-PFE-059	DC	SPA-Sky Room	OK	√	√	Plan to change in early 2024
60	APS-PFE-060	DC	SPA-Wind Room	OK	√	√	Plan to change in early 2024
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	OK	√	√	Plan to change in early 2024
62	APS-PFE-062	DC	Prego- Pizza Oven	OK	√	√	Plan to change in early 2024
63	APS-PFE-063	DC	Prego- Pizza Oven	OK	√	√	Plan to change in early 2024
64	APS-PFE-064	K	Staff Canteen	OK	√	√	Plan to change in early 2024
65	APS-PFE-065	FBK	Staff Canteen	N/A			Plan to order in early 2024
66	APS-PFE-066	K	Prego- KC Entrance	OK	√	√	Plan to change in early 2024
67	APS-PFE-067	DC	Prego- KC back door	OK	√	√	Plan to change in early 2024
68	APS-PFE-068	CO ₂	Prego- KC	OK	√	√	Plan to change in early 2024

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
69	APS-PFE-069	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
70	APS-PFE-070	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
71	APS-PFE-071	DC	Gas Station – Canteen	OK	✓	✓	Plan to change in early 2024
72	APS-PFE-072	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
73	APS-PFE-073	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
74	APS-PFE-074	DC	Next to MDB A1	OK	✓	✓	Plan to change in early 2024
75	APS-PFE-075	DC	Next to MDB A2	OK	✓	✓	Plan to change in early 2024
76	APS-PFE-076	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
77	APS-PFE-077	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
78	APS-PFE-078	DC	Next to Room 3223	OK	✓	✓	Plan to change in early 2024
79	APS-PFE-079	DC	Kids Club Toilet	OK	✓	✓	Plan to change in early 2024
80	APS-PFE-080	DC	Next to Room 4111	OK	✓	✓	Plan to change in early 2024
81	APS-PFE-081	DC	Next to Room 4116	OK	✓	✓	Plan to change in early 2024
82	APS-PFE-082	DC	Next to Room 4115	OK	✓	✓	Plan to change in early 2024
83	APS-PFE-083	DC	Next to Room 4103	OK	✓	✓	Plan to change in early 2024
84	APS-PFE-084	DC	Next to Room 4202	OK	✓	✓	Plan to change in early 2024
85	APS-PFE-085	DC	Next to Room 4117	OK	✓	✓	Plan to change in early 2024
86	APS-PFE-086	DC	Next to Room 4217	OK	✓	✓	Plan to change in early 2024
87	APS-PFE-087	DC	Next to Room 4109	OK	✓	✓	Plan to change in early 2024
88	APS-PFE-088	DC	Next to Room 4107	OK	✓	✓	Plan to change in early 2024
89	APS-PFE-089	DC	Engineer workshop	Old & Rusty	✓	✓	Plan to change in early 2024
90	APS-PFE-090	CO ₂	Fire Cart	OK	✓	✓	Plan to change in early 2024
91	APS-PFE-091	CO ₂	Fire Cart	OK	✓	✓	Plan to change in early 2024
92	APS-PFE-062	DC	Fire Cart	OK	✓	✓	Plan to change in early 2024
93	APS-PFE-093	H	Fire Cart	OK	✓	✓	Plan to change in early 2024
94	APS-PFE-094	DC	Hotel Van 30-0660	Used	X	✓	Plan to change in early 2024
95	APS-PFE-095	DC	Hotel Van 30-1720	Used	X	✓	Plan to change in early 2024

Summary

Type	Ready to use	Used
Dry Chemical [DC]	74	2
Carbon Dioxide [CO ₂]	8	NA
Halotron [H]	2	NA
Type K	4	NA
Fire Blanket [FBK]	5	NA

Name Person Responsible for Chief Engineer/ Manager, Security:

Position: Manager Security

Signature:

Date: November 18, 2023

FLS 10-02 PFEs


DATE 18 Nov 23
SIGNATURE
HEAD OF SECURITY

Section: **Fire Life Safety**
Title: **Monthly inspect of all PEFs**
Responsible Person: **Chief Engineer / Manager, Security**
File Number: **FLS 10-02**

Property: **Amari Koh Samui**
Date: **December, 2023**
Pages: **1 to 3**

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
1	APS-PFE-001	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
2	APS-PFE-002	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	OK	√	√	Plan to change in early 2024
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	OK	√	√	Plan to change in early 2024
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	OK	√	√	Plan to change in early 2024
6	APS-PFE-006	H	Exec. Building Bakery	Used	X	√	Plan to change in early 2024
7	APS-PFE-007	K	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
8	APS-PFE-008	FBK	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
9	APS-PFE-009	CO ₂	Exec. Building Gen + MDB Room	OK	√	√	Plan to change in early 2024
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	OK	√	√	Plan to change in early 2024
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	OK	√	√	Plan to change in early 2024
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	OK	√	√	Plan to change in early 2024
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	OK	√	√	Plan to change in early 2024
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	OK	√	√	Plan to change in early 2024
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	OK	√	√	Plan to change in early 2024
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	OK	√	√	Plan to change in early 2024
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	OK	√	√	Plan to change in early 2024
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	OK	√	√	Plan to change in early 2024
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	OK	√	√	Plan to change in early 2024
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	OK	√	√	Plan to change in early 2024
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	OK	√	√	Plan to change in early 2024
22	APS-PFE-022	DC	Next to Room 3109	OK	√	√	Plan to change in early 2024
23	APS-PFE-023	DC	Next to Room 3208	OK	√	√	Plan to change in early 2024
24	APS-PFE-024	DC	Next to Room 3212	OK	√	√	Plan to change in early 2024
25	APS-PFE-025	DC	Next to Room 3111	OK	√	√	Plan to change in early 2024
26	APS-PFE-026	DC	Next to Florist Room	OK	√	√	Plan to change in early 2024
27	APS-PFE-027	DC	Next to Room 3106	OK	√	√	Plan to change in early 2024
28	APS-PFE-028	DC	Next to Room 3204	OK	√	√	Plan to change in early 2024
29	APS-PFE-029	DC	Next to Room 3227	Old & Rusty	√	√	Plan to change in early 2024
30	APS-PFE-030	DC	Next to Room 3124	OK	√	√	Plan to change in early 2024
31	APS-PFE-031	DC	Next to Room 3225	Old & Rusty	√	√	Plan to change in early 2024

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
32	APS-PFE-032	DC	Next to Room 3221	Old & Rusty	✓	✓	Plan to change in early 2024
33	APS-PFE-033	DC	Next to Room 3129	OK	✓	✓	Plan to change in early 2024
34	APS-PFE-034	DC	Next to Room 3130	OK	✓	✓	Plan to change in early 2024
35	APS-PFE-035	DC	Next to Room 3132	Old & Rusty	✓	✓	Plan to change in early 2024
36	APS-PFE-036	DC	Next to Room 3134	OK	✓	✓	Plan to change in early 2024
37	APS-PFE-037	DC	Next to Room 3136	OK	✓	✓	Plan to change in early 2024
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	OK	✓	✓	Plan to change in early 2024
39	APS-PFE-039	DC	FHC-017 Next to Room 3117	Old & Rusty	✓	✓	Plan to change in early 2024
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Old & Rusty	✓	✓	Plan to change in early 2024
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Old & Rusty	✓	✓	Plan to change in early 2024
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Old & Rusty	✓	✓	Plan to change in early 2024
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Old & Rusty	✓	✓	Plan to change in early 2024
44	APS-PFE-044	DC	FHC-022 Next To Room 4110	OK	✓	✓	Plan to change in early 2024
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	OK	✓	✓	Plan to change in early 2024
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Old	✓	✓	Plan to change in early 2024
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Old & Rusty	✓	✓	Plan to change in early 2024
48	APS-PFE-048	DC	Amaya Toilet [Female]	Old & Rusty	✓	✓	Plan to change in early 2024
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	OK	✓	✓	Plan to change in early 2024
50	APS-PFE-050	CO ₂	Amaya Kitchen	OK	✓	✓	Plan to change in early 2024
51	APS-PFE-051	FBK	Amaya Kitchen	OK	✓	✓	Plan to change in early 2024
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	OK	✓	✓	Plan to change in early 2024
53	APS-PFE-053	CO ₂	Amaya back door	OK	✓	✓	Plan to change in early 2024
54	APS-PFE-054	CO ₂	Amaya back door	OK	✓	✓	Plan to change in early 2024
55	APS-PFE-055	DC	Amaya Gas Station	OK	✓	✓	Plan to change in early 2024
56	APS-PFE-056	CO ₂	Amaya Audio Room	Used	X	✓	Plan to change in early 2024
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	OK	✓	✓	Plan to change in early 2024
58	APS-PFE-058	DC	SPA Entrance	OK	✓	✓	Plan to change in early 2024
59	APS-PFE-059	DC	SPA-Sky Room	OK	✓	✓	Plan to change in early 2024
60	APS-PFE-060	DC	SPA-Wind Room	OK	✓	✓	Plan to change in early 2024
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	OK	✓	✓	Plan to change in early 2024
62	APS-PFE-062	DC	Prego- Pizza Oven	OK	✓	✓	Plan to change in early 2024
63	APS-PFE-063	DC	Prego- Pizza Oven	OK	✓	✓	Plan to change in early 2024
64	APS-PFE-064	K	Staff Canteen	OK	✓	✓	Plan to change in early 2024
65	APS-PFE-065	FBK	Staff Canteen	N/A			Plan to order in early 2024
66	APS-PFE-066	K	Prego- KC Entrance	OK	✓	✓	Plan to change in early 2024
67	APS-PFE-067	DC	Prego- KC back door	OK	✓	✓	Plan to change in early 2024
68	APS-PFE-068	CO ₂	Prego- KC	OK	✓	✓	Plan to change in early 2024

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
69	APS-PFE-069	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
70	APS-PFE-070	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
71	APS-PFE-071	DC	Gas Station – Canteen	OK	✓	✓	Plan to change in early 2024
72	APS-PFE-072	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
73	APS-PFE-073	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
74	APS-PFE-074	DC	Next to MDB A1	OK	✓	✓	Plan to change in early 2024
75	APS-PFE-075	DC	Next to MDB A2	OK	✓	✓	Plan to change in early 2024
76	APS-PFE-076	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
77	APS-PFE-077	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
78	APS-PFE-078	DC	Next to Room 3223	OK	✓	✓	Plan to change in early 2024
79	APS-PFE-079	DC	Kids Club Toilet	OK	✓	✓	Plan to change in early 2024
80	APS-PFE-080	DC	Next to Room 4111	OK	✓	✓	Plan to change in early 2024
81	APS-PFE-081	DC	Next to Room 4116	OK	✓	✓	Plan to change in early 2024
82	APS-PFE-082	DC	Next to Room 4115	OK	✓	✓	Plan to change in early 2024
83	APS-PFE-083	DC	Next to Room 4103	OK	✓	✓	Plan to change in early 2024
84	APS-PFE-084	DC	Next to Room 4202	OK	✓	✓	Plan to change in early 2024
85	APS-PFE-085	DC	Next to Room 4117	OK	✓	✓	Plan to change in early 2024
86	APS-PFE-086	DC	Next to Room 4217	OK	✓	✓	Plan to change in early 2024
87	APS-PFE-087	DC	Next to Room 4109	OK	✓	✓	Plan to change in early 2024
88	APS-PFE-088	DC	Next to Room 4107	OK	✓	✓	Plan to change in early 2024
89	APS-PFE-089	DC	Engineer workshop	Old & Rusty	✓	✓	Plan to change in early 2024
90	APS-PFE-090	CO ₂	Fire Cart	Used	X	✓	Plan to change in early 2024
91	APS-PFE-091	CO ₂	Fire Cart	Used	X	✓	Plan to change in early 2024
92	APS-PFE-062	DC	Fire Cart	Used	X	✓	Plan to change in early 2024
93	APS-PFE-093	H	Fire Cart	Used	X	✓	Plan to change in early 2024
94	APS-PFE-094	DC	Hotel Van 30-0660	Used	X	✓	Plan to change in early 2024
95	APS-PFE-095	DC	Hotel Van 30-1720	Used	X	✓	Plan to change in early 2024

Summary

Type	Ready to use	Used
Dry Chemical [DC]	73	3
Carbon Dioxide [CO ₂]	5	3
Halotron [H]	NA	2
Type K	4	NA
Fire Blanket [FBK]	5	NA

Name Person Responsible for Chief Engineer/ Manager, Security:

Position: Manager Security

Signature:

Date: December 17, 2023

FLS 10-02 PFEs


DATE 17 Dec 23.....
SIGNATURE.....
HEAD OF SECURITY