

เอกสารตรวจเช็ค Exit sign

North , South

เดือน พฤศจิกายน 2566



ตารางเช็คป้าย Exit ตึก North ประจำเดือน เดือน พฤศจิกายน 2566

Number	Location	Installed	Change	Status		การรับประกัน ( 1 ปี )	Remarks
				Normal	Abnormal		
Condo 1-01	ทางลงลานจอดรถชั้นใต้ดิน	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-02	ทางขึ้นลานจอดรถชั้นใต้ดิน	30/8/2017	30/8/2019	✓			
Condo 1-03	ทางออกประตูหนีไฟ ชั้น 1	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-04	ทางออกประตูหนีไฟ ชั้น 1	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-05	ทางออกประตูหนีไฟ ชั้น 2	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-06	ทางออกประตูหนีไฟ ชั้น 2	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-07	ทางออกประตูหนีไฟ ชั้น 3	30/8/2017	30/8/2019		✓		11.20/1.50
Condo 1-08	ทางออกประตูหนีไฟ ชั้น 3	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-09	ทางออกประตูหนีไฟ ชั้น 4	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-10	ทางออกประตูหนีไฟ ชั้น 4	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-11	ทางออกประตูหนีไฟ ชั้น 5	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-12	ทางออกประตูหนีไฟ ชั้น 5	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-13	ทางออกประตูหนีไฟ ชั้น 6	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-14	ทางออกประตูหนีไฟ ชั้น 6	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 1-15	ทางออกประตูหนีไฟ ชั้น 7	30/8/2017	30/8/2019	✓			
Condo 1-16	ทางออกประตูหนีไฟ ชั้น 7	19/8/2019	19/8/2021	✓		19/8/2020	

ตรวจสอบโดย ..... วันที่ 17-11-66 เวลา 13.00

หัวหน้าช่าง ..... วันที่ 17/11/66 เวลา 13.00 น.

ตารางเช็คป้าย Exit ตึก South ประจำเดือน เดือน พฤศจิกายน 2566

Number	Location	Installed	Change	Status		การรับประกัน ( 1 ปี )	Remarks
				Normal	Abnormal		
Condo 2-17	ทางขึ้นลานจอดรถชั้นใต้ดิน	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-18	ทางลงลานจอดรถชั้นใต้ดิน	30/8/2017	30/8/2019		✓		11/2/2567
Condo 2-19	ทางออกประตูหนีไฟ ชั้น 1	30/8/2017	30/8/2019	✓			
Condo 2-20	ทางออกประตูหนีไฟ ชั้น 1	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-21	ทางออกประตูหนีไฟ ชั้น 2	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-22	ทางออกประตูหนีไฟ ชั้น 2	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-23	ทางออกประตูหนีไฟ ชั้น 3	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-24	ทางออกประตูหนีไฟ ชั้น 3	30/8/2017	30/8/2019	✓			
Condo 2-25	ทางออกประตูหนีไฟ ชั้น 4	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-26	ทางออกประตูหนีไฟ ชั้น 4	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-27	ทางออกประตูหนีไฟ ชั้น 5	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-28	ทางออกประตูหนีไฟ ชั้น 5	30/8/2017	30/8/2019	✓			
Condo 2-29	ทางออกประตูหนีไฟ ชั้น 6	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-30	ทางออกประตูหนีไฟ ชั้น 6	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-31	ทางออกประตูหนีไฟ ชั้น 7	19/8/2019	19/8/2021	✓		19/8/2020	
Condo 2-32	ทางออกประตูหนีไฟ ชั้น 7	19/8/2019	19/8/2021	✓		19/8/2020	

ตรวจสอบโดย ..... วันที่ 17/11/66 เวลา 15.00

หัวหน้าช่าง ..... วันที่ 17/11/66 เวลา 15.00 น .

เอกสารตรวจเช็ค **Exit sign**

**North , South**

เดือน ธันวาคม **2566**



ตารางตรวจเช็คป้ายไฟ Exit อาคาร North ประจำเดือน ธันวาคม 2566

Number	Location	Installed	Change	Status		การรับประกัน (1 ปี)	Remarks
				Normal	Abnormal		
Condo1 - 01	ทางลงถาวรจอร์จชั้นใต้ดิน	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 02	ทางลงถาวรจอร์จชั้นใต้ดิน	8/30/2017	8/30/2019	✓			
Condo1 - 03	ทางออกประตูหนีไฟ ชั้น 1	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 04	ทางออกประตูหนีไฟ ชั้น 1	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 05	ทางออกประตูหนีไฟ ชั้น 2	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 06	ทางออกประตูหนีไฟ ชั้น 2	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 07	ทางออกประตูหนีไฟ ชั้น 3	8/30/2017	8/30/2019		✓		1127156
Condo1 - 08	ทางออกประตูหนีไฟ ชั้น 3	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 09	ทางออกประตูหนีไฟ ชั้น 4	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 10	ทางออกประตูหนีไฟ ชั้น 4	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 11	ทางออกประตูหนีไฟ ชั้น 5	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 12	ทางออกประตูหนีไฟ ชั้น 5	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 13	ทางออกประตูหนีไฟ ชั้น 6	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 14	ทางออกประตูหนีไฟ ชั้น 6	8/19/2019	8/19/2020	✓		8/19/2020	
Condo1 - 15	ทางออกประตูหนีไฟ ชั้น 7	8/30/2017	8/30/2019	✓			
Condo1 - 16	ทางออกประตูหนีไฟ ชั้น 7	8/19/2019	8/19/2020	✓		8/19/2020	

ตรวจสอบโดย.....

วันที่ 18-12-66 เวลา 13.20 น

หัวหน้าช่าง.....

วันที่ 22/12/66 เวลา 19.00 น

ตารางตรวจเช็คป้ายไฟ Exit อาคาร South ประจำเดือน ธันวาคม 2566

Number	Location	Installed	Change	Status		การรับประกัน (1 ปี)	Remarks
				Normal	Abnormal		
Condo2 - 17	ทางลงสถานีจอดรถยนต์ใต้ดิน	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 18	ทางลงสถานีจอดรถยนต์ใต้ดิน	8/30/2017	8/30/2019		✓		11/27/19
Condo2 - 19	ทางออกประตูหนีไฟ ชั้น 1	8/30/2017	8/30/2019	✓			
Condo2 - 20	ทางออกประตูหนีไฟ ชั้น 1	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 21	ทางออกประตูหนีไฟ ชั้น 2	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 22	ทางออกประตูหนีไฟ ชั้น 2	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 23	ทางออกประตูหนีไฟ ชั้น 3	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 24	ทางออกประตูหนีไฟ ชั้น 3	8/30/2017	8/30/2019	✓			
Condo2 - 25	ทางออกประตูหนีไฟ ชั้น 4	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 26	ทางออกประตูหนีไฟ ชั้น 4	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 27	ทางออกประตูหนีไฟ ชั้น 5	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 28	ทางออกประตูหนีไฟ ชั้น 5	8/30/2017	8/30/2019	✓			
Condo2 - 29	ทางออกประตูหนีไฟ ชั้น 6	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 30	ทางออกประตูหนีไฟ ชั้น 6	8/19/2019	8/19/2020	✓		8/19/2020	
Condo2 - 31	ทางออกประตูหนีไฟ ชั้น 7	8/30/2017	8/30/2019	✓		8/19/2020	
Condo2 - 32	ทางออกประตูหนีไฟ ชั้น 7	8/19/2019	8/19/2020	✓		8/19/2020	

ตรวจสอบโดย.....

หัวหน้าช่าง.....

วันที่ 17-12-66 เวลา 15.00 น

วันที่ 22/12/66 เวลา 18.00 น

ภาคผนวกที่ 11

---

แบบบันทึกการตรวจสอบ Fire Life Safety

Section: 10 – 02 Property: APS  
Title: The record of the monthly inspect of all PEFs Date: 31 July 2023  
Responsible Person: Pattharak Buranlue Pages: 1 to 3  
File Number: 31.07.2023

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use		✓	
9	APS-PFE-009	CO <sub>2</sub>	Exec. Building Gen+MDB Room	Not to use	15 lbs.	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO <sub>2</sub>	Amaya Kitchen	Not to use	15 lbs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use		✓	
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use		✓	
53	APS-PFE-053	CO <sub>2</sub>	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
54	APS-PFE-054	CO <sub>2</sub>	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO <sub>2</sub>	Amaya Audio Room	Not to use	15 lbs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO <sub>2</sub>	Prego- KC	Not to use	15 lbs	Not to use	Product was [2012]



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use		✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO <sub>2</sub>	Fire Cart	Not to use	15 lbs.	Not to use	Product was [2012]
91	APS-PFE-091	CO <sub>2</sub>	Fire Cart	Not to use	10 lbs.	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

**Summary**

Type	Ready to use	Out Of Oder
Dry Chemical [DC]		75
Carbon Dioxide [CO <sub>2</sub> ]		8
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	need install (1)


**Name Person Responsible for Security:**

**Position:**

**Signature:**

**Date:**

FLS 10-02 PFEs

  
**Amari**  
 AMARI KOH SAMUI  
 DATE 31 July 2023  
 SIGNATURE [Signature]  
 HEAD OF SECURITY

Section: 10 – 02 Property: APS  
Title: The record of the monthly inspect of all PEFs Date: 2023 August  
Responsible Person: Chief Engineer / Manager, Security Pages: 1 to 3  
File Number: FLS 10-02. 2023.08

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC-003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use	✓	✓	
9	APS-PFE-009	CO <sub>2</sub>	Exec. Building Gen+MDB Room	Not to use	15 lbs	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]

DATE 15 August 2023  
SIGNATURE [Signature]  
HEAD OF SECURITY



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO <sub>2</sub>	Amaya Kitchen	Not to use	15 lbs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use		✓	
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use		✓	
53	APS-PFE-053	CO <sub>2</sub>	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
54	APS-PFE-054	CO <sub>2</sub>	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO <sub>2</sub>	Amaya Audio Room	Not to use	15 lbs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO <sub>2</sub>	Prego- KC	Not to use	15 lbs	Not to use	Product was [2012]

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use	-	✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO <sub>2</sub>	Fire Cart	Not to use	15 lbs	Not to use	Product was [2012]
91	APS-PFE-091	CO <sub>2</sub>	Fire Cart	Not to use	10 lbs	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

#### Summary

Type	Ready to use	Out Of Oder
Dry Chemical [DC]	MFG 1994 (2537) Recommended not to use	75
Carbon Dioxide [CO <sub>2</sub> ]		8
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	

Name Person Responsible for Chief Engineer/ Manager, Security:

Position:

Signature:

Date:

FLS 10-02 PFEs

Amari  
AMARI KOH SAMUI  
DATE 16 August 2023  
SIGNATURE [Signature]  
HEAD OF SECURITY



Section: 10 – 02 Property: APS  
Title: The record of the monthly inspect of all PEFs Date: 2023 September  
Responsible Person: Chief Engineer / Manager, Security Pages: 1 to 3  
File Number: FLS 10-02. 2023.09

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use		✓	
9	APS-PFE-009	CO <sub>2</sub>	Exec. Building Gen+MDB Room	Not to use	151bs	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO <sub>2</sub>	Amaya Kitchen	Not to use	101bs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use		✓	
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use		✓	
53	APS-PFE-053	CO <sub>2</sub>	Amaya back door	Not to use	161bs	Not to use	Product was [2012]
54	APS-PFE-054	CO <sub>2</sub>	Amaya back door	Not to use	151bs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO <sub>2</sub>	Amaya Audio Room	Not to use	151bs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO <sub>2</sub>	Prego- KC	Not to use	151bs	Not to use	Product was [2012]

Amari  
AMARI KOH SAMUI  
DATE 16 September 2023  
SIGNATURE [Signature]  
HEAD OF SECURITY

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use	-	✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO <sub>2</sub>	Fire Cart	Not to use	15lbs	Not to use	Product was [2012]
91	APS-PFE-091	CO <sub>2</sub>	Fire Cart	Not to use	10lbs	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

### Summary

Type	Ready to use	Out Of Oder
Dry Chemical [DC]	MFG 1994 < 2537 > Not recommended to use	75
Carbon Dioxide [CO <sub>2</sub> ]		5
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	

Name Person Responsible for Chief Engineer/ Manager, Security:

Position:

Signature:

Date:

FLS 10-02 PFEs

Amari  
AMARI KOH SAMUI  
DATE 16 September 2023  
SIGNATURE [Signature]  
HEAD OF SECURITY




Section: 10 – 02 Property: APS  
Title: The record of the monthly inspect of all PEFs Date: 2023 October  
Responsible Person: Chief Engineer / Manager, Security Pages: 1 to 3  
File Number: FLS 10-02. 2023.10.18

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
1	APS-PFE-001	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
2	APS-PFE-002	DC	Exec. ACC Office	Not to use	✓	Not to use	Product was 2537 [1994]
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
6	APS-PFE-006	H	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2012]
7	APS-PFE-007	K	Exec. Building Bakery	Not to use	✓	Not to use	Product was [2013]
8	APS-PFE-008	FBK	Exec. Building Bakery	Ready to use	✓		
9	APS-PFE-009	CO <sub>2</sub>	Exec. Building Gen+MDB Room	Not to use	10 lbs	Not to use	Product was [2012]
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	Not to use	✓	Not to use	Product was 2537 [1994]
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	Not to use	✓	Not to use	Product was 2537 [1994]
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	Not to use	✓	Not to use	Product was 2537 [1994]
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	Not to use	✓	Not to use	Product was 2537 [1994]
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	Not to use	✓	Not to use	Product was 2537 [1994]
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	Not to use	✓	Not to use	Product was 2537 [1994]
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	Not to use	✓	Not to use	Product was 2537 [1994]
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	Not to use	✓	Not to use	Product was 2537 [1994]
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	Not to use	✓	Not to use	Product was 2537 [1994]
22	APS-PFE-022	DC	Next to Room 3109	Not to use	✓	Not to use	Product was 2537 [1994]
23	APS-PFE-023	DC	Next to Room 3208	Not to use	✓	Not to use	Product was 2537 [1994]
24	APS-PFE-024	DC	Next to Room 3212	Not to use	✓	Not to use	Product was 2537 [1994]
25	APS-PFE-025	DC	Next to Room 3111	Not to use	✓	Not to use	Product was 2537 [1994]
26	APS-PFE-026	DC	Next to Florist Room	Not to use	✓	Not to use	Product was 2537 [1994]
27	APS-PFE-027	DC	Next to Room 3106	Not to use	✓	Not to use	Product was 2537 [1994]
28	APS-PFE-028	DC	Next to Room 3204	Not to use	✓	Not to use	Product was 2537 [1994]
29	APS-PFE-029	DC	Next to Room 3227	Not to use	✓	Not to use	Product was 2537 [1994]
30	APS-PFE-030	DC	Next to Room 3124	Not to use	✓	Not to use	Product was 2537 [1994]
31	APS-PFE-031	DC	Next to Room 3225	Not to use	✓	Not to use	Product was 2537 [1994]

Amari  
AMARI KOH SAMUI  
DATE 16 Oct 2023  
SIGNATURE [Signature]  
HEAD OF SECURITY

## ONYX Hospitality Group Fire Life Safety System

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
32	APS-PFE-032	DC	Next to Room 3221	Not to use	✓	Not to use	Product was 2537 [1994]
33	APS-PFE-033	DC	Next to Room 3129	Not to use	✓	Not to use	Product was 2537 [1994]
34	APS-PFE-034	DC	Next to Room 3130	Not to use	✓	Not to use	Product was 2537 [1994]
35	APS-PFE-035	DC	Next to Room 3132	Not to use	✓	Not to use	Product was 2537 [1994]
36	APS-PFE-036	DC	Next to Room 3134	Not to use	✓	Not to use	Product was 2537 [1994]
37	APS-PFE-037	DC	Next to Room 3136	Not to use	✓	Not to use	Product was 2537 [1994]
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	Not to use	✓	Not to use	Product was 2537 [1994]
39	APS-PFE-039	DC	FHC-017 Next to Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Not to use	✓	Not to use	Product was 2537 [1994]
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Not to use	✓	Not to use	Product was 2537 [1994]
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Not to use	✓	Not to use	Product was 2537 [1994]
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Not to use	✓	Not to use	Product was 2537 [1994]
44	APS-PFE-044	DC	FHC-022 Next To Room 4210	Not to use	✓	Not to use	Product was 2537 [1994]
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	Not to use	✓	Not to use	Product was 2537 [1994]
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Not to use	✓	Not to use	Product was 2537 [1994]
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Not to use	✓	Not to use	Product was 2537 [1994]
48	APS-PFE-048	K	Amaya Toilet [Female]	Not to use	✓	Not to use	Product was [2013]
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	Not to use	✓	Not to use	Product was 2537 [1994]
50	APS-PFE-050	CO <sub>2</sub>	Amaya Kitchen	Not to use	15 lbs	Not to use	Product was [2012]
51	APS-PFE-051	FBK	Amaya Kitchen	Ready to use			
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	Ready to use			
53	APS-PFE-053	CO <sub>2</sub>	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
54	APS-PFE-054	CO <sub>2</sub>	Amaya back door	Not to use	15 lbs	Not to use	Product was [2012]
55	APS-PFE-055	DC	Amaya Gas Station	Not to use	✓	Not to use	Product was 2537 [1994]
56	APS-PFE-056	CO <sub>2</sub>	Amaya Audio Room	Not to use	15 lbs	Not to use	Product was [2012]
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	Not to use	✓	Not to use	Product was 2537 [1994]
58	APS-PFE-058	DC	SPA Entrance	Not to use	✓	Not to use	Product was 2537 [1994]
59	APS-PFE-059	DC	SPA-Sky Room	Not to use	✓	Not to use	Product was 2537 [1994]
60	APS-PFE-060	DC	SPA-Wind Room	Not to use	✓	Not to use	Product was 2537 [1994]
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	Not to use	✓	Not to use	Product was 2537 [1994]
62	APS-PFE-062	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
63	APS-PFE-063	DC	Prego- Pizza Oven	Not to use	✓	Not to use	Product was 2537 [1994]
64	APS-PFE-064	K	Staff Canteen	Not to use	✓	Not to use	Product was [2013]
65	APS-PFE-065	FBK	Staff Canteen	N/A			Need to in stall
66	APS-PFE-066	K	Prego- KC Entrance	Not to use	✓	Not to use	Product was [2013]
67	APS-PFE-067	DC	Prego- KC back door	Not to use	✓	Not to use	Product was 2537 [1994]
68	APS-PFE-068	CO <sub>2</sub>	Prego- KC	Not to use	15 lbs	Not to use	Product was [2012]

  
 DATE 16 Oct 2023  
 SIGNATURE [Signature]  
 HEAD OF SECURITY



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Result	
						Normal	Improve
69	APS-PFE-069	FBK	Prego- KC-1	Ready to use		✓	
70	APS-PFE-070	FBK	Prego- KC-1	Ready to use		✓	
71	APS-PFE-071	DC	Gas Station – Canteen	Not to use	✓	Not to use	Product was 2537 [1994]
72	APS-PFE-072	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
73	APS-PFE-073	DC	Gas Station – Prego	Not to use	✓	Not to use	Product was 2537 [1994]
74	APS-PFE-074	DC	Next to MDB A1	Not to use	✓	Not to use	Product was 2537 [1994]
75	APS-PFE-075	DC	Next to MDB A2	Not to use	✓	Not to use	Product was 2537 [1994]
76	APS-PFE-076	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
77	APS-PFE-077	DC	Next to MDB A3	Not to use	✓	Not to use	Product was 2537 [1994]
78	APS-PFE-078	DC	Next to Room 3223	Not to use	✓	Not to use	Product was 2537 [1994]
79	APS-PFE-079	DC	Kids Club Toilet	Not to use	✓	Not to use	Product was 2537 [1994]
80	APS-PFE-080	DC	Next to Room 4111	Not to use	✓	Not to use	Product was 2537 [1994]
81	APS-PFE-081	DC	Next to Room 4116	Not to use	✓	Not to use	Product was 2537 [1994]
82	APS-PFE-082	DC	Next to Room 4115	Not to use	✓	Not to use	Product was 2537 [1994]
83	APS-PFE-083	DC	Next to Room 4103	Not to use	✓	Not to use	Product was 2537 [1994]
84	APS-PFE-084	DC	Next to Room 4202	Not to use	✓	Not to use	Product was 2537 [1994]
85	APS-PFE-085	DC	Next to Room 4117	Not to use	✓	Not to use	Product was 2537 [1994]
86	APS-PFE-086	DC	Next to Room 4217	Not to use	✓	Not to use	Product was 2537 [1994]
87	APS-PFE-087	DC	Next to Room 4109	Not to use	✓	Not to use	Product was 2537 [1994]
88	APS-PFE-088	DC	Next to Room 4107	Not to use	✓	Not to use	Product was 2537 [1994]
89	APS-PFE-089	DC	Engineer workshop	Not to use	✓	Not to use	Product was 2537 [1994]
90	APS-PFE-090	CO <sub>2</sub>	Fire Cart	Not to use	15 lbs	Not to use	Product was [2012]
91	APS-PFE-091	CO <sub>2</sub>	Fire Cart	Not to use	10 lbs	Not to use	Product was [2012]
92	APS-PFE-062	DC	Fire Cart	Not to use	✓	Not to use	Product was 2537 [1994]
93	APS-PFE-093	H	Fire Cart	Not to use	✓	Not to use	Product was [2012]
94	APS-PFE-094	DC	Hotel Van 30-0660	Not to use	✓	Not to use	Product was 2537 [1994]
95	APS-PFE-095	DC	Hotel Van 30-1720	Not to use	✓	Not to use	Product was 2537 [1994]

### Summary

Type	Ready to use	Out Of Oder
Dry Chemical [DC]	MFG 1994 (2537) NOT Recommended to use.	75
Carbon Dioxide [CO <sub>2</sub> ]		8
Halotron [H]		2
Type K		4
Fire Blanket [FBK]	5	-


Name Person Responsible for Chief Engineer/ Manager, Security:

Position: *Manager, Security*

Signature: *Thomas Yim*

Date: *16 October 2023*

FLS 10-02 PFEs

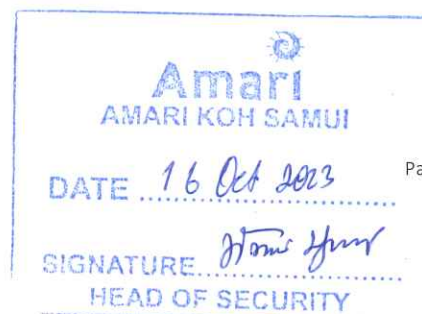



**Section:** Fire Life Safety  
**Title:** Monthly inspect of all PEFs  
**Responsible Person:** Chief Engineer / Manager, Security  
**File Number:** FLS 10-02

**Property:** Amari Koh Samui  
**Date:** November, 2023  
**Pages:** 1 to 3

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
1	APS-PFE-001	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
2	APS-PFE-002	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
3	APS-PFE-003	DC	FHC-001 Exec. Building FI1	OK	√	√	Plan to change in early 2024
4	APS-PFE-004	DC	FHC-002 Exec. Building FI2	OK	√	√	Plan to change in early 2024
5	APS-PFE-005	DC	FHC 003 Exec. Building -FI3	OK	√	√	Plan to change in early 2024
6	APS-PFE-006	H	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
7	APS-PFE-007	K	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
8	APS-PFE-008	FBK	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
9	APS-PFE-009	CO <sub>2</sub>	Exec. Building Gen + MDB Room	OK	√	√	Plan to change in early 2024
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	OK	√	√	Plan to change in early 2024
11	APS-PFE-011	DC	FHC-005 HK Store FI1	OK	√	√	Plan to change in early 2024
12	APS-PFE-012	DC	FHC-006 FB Store FI1	OK	√	√	Plan to change in early 2024
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	OK	√	√	Plan to change in early 2024
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	OK	√	√	Plan to change in early 2024
15	APS-PFE-015	DC	FHC-009 HK Store FI2	OK	√	√	Plan to change in early 2024
16	APS-PFE-016	DC	FHC-010 FB Store FI2	OK	√	√	Plan to change in early 2024
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	OK	√	√	Plan to change in early 2024
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	OK	√	√	Plan to change in early 2024
19	APS-PFE-019	DC	FHC-013 HK Store FI3	OK	√	√	Plan to change in early 2024
20	APS-PFE-020	DC	FHC-014 ACC Store FI3	OK	√	√	Plan to change in early 2024
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	OK	√	√	Plan to change in early 2024
22	APS-PFE-022	DC	Next to Room 3109	OK	√	√	Plan to change in early 2024
23	APS-PFE-023	DC	Next to Room 3208	OK	√	√	Plan to change in early 2024
24	APS-PFE-024	DC	Next to Room 3212	OK	√	√	Plan to change in early 2024
25	APS-PFE-025	DC	Next to Room 3111	OK	√	√	Plan to change in early 2024
26	APS-PFE-026	DC	Next to Florist Room	OK	√	√	Plan to change in early 2024
27	APS-PFE-027	DC	Next to Room 3106	OK	√	√	Plan to change in early 2024
28	APS-PFE-028	DC	Next to Room 3204	OK	√	√	Plan to change in early 2024
29	APS-PFE-029	DC	Next to Room 3227	Old & Rusty	√	√	Plan to change in early 2024
30	APS-PFE-030	DC	Next to Room 3124	OK	√	√	Plan to change in early 2024
31	APS-PFE-031	DC	Next to Room 3225	Old & Rusty	√	√	Plan to change in early 2024

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
32	APS-PFE-032	DC	Next to Room 3221	Old & Rusty	√	√	Plan to change in early 2024
33	APS-PFE-033	DC	Next to Room 3129	OK	√	√	Plan to change in early 2024
34	APS-PFE-034	DC	Next to Room 3130	OK	√	√	Plan to change in early 2024
35	APS-PFE-035	DC	Next to Room 3132	Old & Rusty	√	√	Plan to change in early 2024
36	APS-PFE-036	DC	Next to Room 3134	OK	√	√	Plan to change in early 2024
37	APS-PFE-037	DC	Next to Room 3136	OK	√	√	Plan to change in early 2024
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	OK	√	√	Plan to change in early 2024
39	APS-PFE-039	DC	FHC-017 Next to Room 3117	Old & Rusty	√	√	Plan to change in early 2024
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Old & Rusty	√	√	Plan to change in early 2024
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Old & Rusty	√	√	Plan to change in early 2024
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Old & Rusty	√	√	Plan to change in early 2024
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Old & Rusty	√	√	Plan to change in early 2024
44	APS-PFE-044	DC	FHC-022 Next To Room 4110	OK	√	√	Plan to change in early 2024
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	OK	√	√	Plan to change in early 2024
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Old	√	√	Plan to change in early 2024
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Old & Rusty	√	√	Plan to change in early 2024
48	APS-PFE-048	DC	Amaya Toilet [Female]	Old & Rusty	√	√	Plan to change in early 2024
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	OK	√	√	Plan to change in early 2024
50	APS-PFE-050	CO <sub>2</sub>	Amaya Kitchen	OK	√	√	Plan to change in early 2024
51	APS-PFE-051	FBK	Amaya Kitchen	OK	√	√	Plan to change in early 2024
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	OK	√	√	Plan to change in early 2024
53	APS-PFE-053	CO <sub>2</sub>	Amaya back door	OK	√	√	Plan to change in early 2024
54	APS-PFE-054	CO <sub>2</sub>	Amaya back door	OK	√	√	Plan to change in early 2024
55	APS-PFE-055	DC	Amaya Gas Station	OK	√	√	Plan to change in early 2024
56	APS-PFE-056	CO <sub>2</sub>	Amaya Audio Room	OK	√	√	Plan to change in early 2024
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	OK	√	√	Plan to change in early 2024
58	APS-PFE-058	DC	SPA Entrance	OK	√	√	Plan to change in early 2024
59	APS-PFE-059	DC	SPA-Sky Room	OK	√	√	Plan to change in early 2024
60	APS-PFE-060	DC	SPA-Wind Room	OK	√	√	Plan to change in early 2024
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	OK	√	√	Plan to change in early 2024
62	APS-PFE-062	DC	Prego- Pizza Oven	OK	√	√	Plan to change in early 2024
63	APS-PFE-063	DC	Prego- Pizza Oven	OK	√	√	Plan to change in early 2024
64	APS-PFE-064	K	Staff Canteen	OK	√	√	Plan to change in early 2024
65	APS-PFE-065	FBK	Staff Canteen	N/A			Plan to order in early 2024
66	APS-PFE-066	K	Prego- KC Entrance	OK	√	√	Plan to change in early 2024
67	APS-PFE-067	DC	Prego- KC back door	OK	√	√	Plan to change in early 2024
68	APS-PFE-068	CO <sub>2</sub>	Prego- KC	OK	√	√	Plan to change in early 2024



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
69	APS-PFE-069	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
70	APS-PFE-070	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
71	APS-PFE-071	DC	Gas Station – Canteen	OK	✓	✓	Plan to change in early 2024
72	APS-PFE-072	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
73	APS-PFE-073	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
74	APS-PFE-074	DC	Next to MDB A1	OK	✓	✓	Plan to change in early 2024
75	APS-PFE-075	DC	Next to MDB A2	OK	✓	✓	Plan to change in early 2024
76	APS-PFE-076	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
77	APS-PFE-077	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
78	APS-PFE-078	DC	Next to Room 3223	OK	✓	✓	Plan to change in early 2024
79	APS-PFE-079	DC	Kids Club Toilet	OK	✓	✓	Plan to change in early 2024
80	APS-PFE-080	DC	Next to Room 4111	OK	✓	✓	Plan to change in early 2024
81	APS-PFE-081	DC	Next to Room 4116	OK	✓	✓	Plan to change in early 2024
82	APS-PFE-082	DC	Next to Room 4115	OK	✓	✓	Plan to change in early 2024
83	APS-PFE-083	DC	Next to Room 4103	OK	✓	✓	Plan to change in early 2024
84	APS-PFE-084	DC	Next to Room 4202	OK	✓	✓	Plan to change in early 2024
85	APS-PFE-085	DC	Next to Room 4117	OK	✓	✓	Plan to change in early 2024
86	APS-PFE-086	DC	Next to Room 4217	OK	✓	✓	Plan to change in early 2024
87	APS-PFE-087	DC	Next to Room 4109	OK	✓	✓	Plan to change in early 2024
88	APS-PFE-088	DC	Next to Room 4107	OK	✓	✓	Plan to change in early 2024
89	APS-PFE-089	DC	Engineer workshop	Old & Rusty	✓	✓	Plan to change in early 2024
90	APS-PFE-090	CO <sub>2</sub>	Fire Cart	OK	✓	✓	Plan to change in early 2024
91	APS-PFE-091	CO <sub>2</sub>	Fire Cart	OK	✓	✓	Plan to change in early 2024
92	APS-PFE-062	DC	Fire Cart	OK	✓	✓	Plan to change in early 2024
93	APS-PFE-093	H	Fire Cart	OK	✓	✓	Plan to change in early 2024
94	APS-PFE-094	DC	Hotel Van 30-0660	Used	X	✓	Plan to change in early 2024
95	APS-PFE-095	DC	Hotel Van 30-1720	Used	X	✓	Plan to change in early 2024

**Summary**

Type	Ready to use	Used
Dry Chemical [DC]	74	2
Carbon Dioxide [CO <sub>2</sub> ]	8	NA
Halotron [H]	2	NA
Type K	4	NA
Fire Blanket [FBK]	5	NA

Name Person Responsible for Chief Engineer/ Manager, Security:

Position: Manager Security

Signature:

Date: November 18, 2023

FLS 10-02 PFEs

  
**DATE** ..... 18 Nov 23 .....  
**SIGNATURE** .....  
**HEAD OF SECURITY**

Section: **Fire Life Safety**  
Title: **Monthly inspect of all PEFs**  
Responsible Person: **Chief Engineer / Manager, Security**  
File Number: **FLS 10-02**

Property: **Amari Koh Samui**  
Date: **December, 2023**  
Pages: **1 to 3**

NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
1	APS-PFE-001	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
2	APS-PFE-002	DC	Exec. ACC Office	OK	√	√	Plan to change in early 2024
3	APS-PFE-003	DC	FHC-001 Exec. Building Fl1	OK	√	√	Plan to change in early 2024
4	APS-PFE-004	DC	FHC-002 Exec. Building Fl2	OK	√	√	Plan to change in early 2024
5	APS-PFE-005	DC	FHC 003 Exec. Building -Fl3	OK	√	√	Plan to change in early 2024
6	APS-PFE-006	H	Exec. Building Bakery	Used	X	√	Plan to change in early 2024
7	APS-PFE-007	K	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
8	APS-PFE-008	FBK	Exec. Building Bakery	OK	√	√	Plan to change in early 2024
9	APS-PFE-009	CO <sub>2</sub>	Exec. Building Gen + MDB Room	OK	√	√	Plan to change in early 2024
10	APS-PFE-010	DC	FHC-004 Next to Room 5105	OK	√	√	Plan to change in early 2024
11	APS-PFE-011	DC	FHC-005 HK Store Fl1	OK	√	√	Plan to change in early 2024
12	APS-PFE-012	DC	FHC-006 FB Store Fl1	OK	√	√	Plan to change in early 2024
13	APS-PFE-013	DC	FHC-007 Next to Room 5126	OK	√	√	Plan to change in early 2024
14	APS-PFE-014	DC	FHC-008 Next to Room 5205	OK	√	√	Plan to change in early 2024
15	APS-PFE-015	DC	FHC-009 HK Store Fl2	OK	√	√	Plan to change in early 2024
16	APS-PFE-016	DC	FHC-010 FB Store Fl2	OK	√	√	Plan to change in early 2024
17	APS-PFE-017	DC	FHC-011 Next to Room 5226	OK	√	√	Plan to change in early 2024
18	APS-PFE-018	DC	FHC-012 Next to Room 5305	OK	√	√	Plan to change in early 2024
19	APS-PFE-019	DC	FHC-013 HK Store Fl3	OK	√	√	Plan to change in early 2024
20	APS-PFE-020	DC	FHC-014 ACC Store Fl3	OK	√	√	Plan to change in early 2024
21	APS-PFE-021	DC	FHC-015 Next to Room 5326	OK	√	√	Plan to change in early 2024
22	APS-PFE-022	DC	Next to Room 3109	OK	√	√	Plan to change in early 2024
23	APS-PFE-023	DC	Next to Room 3208	OK	√	√	Plan to change in early 2024
24	APS-PFE-024	DC	Next to Room 3212	OK	√	√	Plan to change in early 2024
25	APS-PFE-025	DC	Next to Room 3111	OK	√	√	Plan to change in early 2024
26	APS-PFE-026	DC	Next to Florist Room	OK	√	√	Plan to change in early 2024
27	APS-PFE-027	DC	Next to Room 3106	OK	√	√	Plan to change in early 2024
28	APS-PFE-028	DC	Next to Room 3204	OK	√	√	Plan to change in early 2024
29	APS-PFE-029	DC	Next to Room 3227	Old & Rusty	√	√	Plan to change in early 2024
30	APS-PFE-030	DC	Next to Room 3124	OK	√	√	Plan to change in early 2024
31	APS-PFE-031	DC	Next to Room 3225	Old & Rusty	√	√	Plan to change in early 2024



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
32	APS-PFE-032	DC	Next to Room 3221	Old & Rusty	✓	✓	Plan to change in early 2024
33	APS-PFE-033	DC	Next to Room 3129	OK	✓	✓	Plan to change in early 2024
34	APS-PFE-034	DC	Next to Room 3130	OK	✓	✓	Plan to change in early 2024
35	APS-PFE-035	DC	Next to Room 3132	Old & Rusty	✓	✓	Plan to change in early 2024
36	APS-PFE-036	DC	Next to Room 3134	OK	✓	✓	Plan to change in early 2024
37	APS-PFE-037	DC	Next to Room 3136	OK	✓	✓	Plan to change in early 2024
38	APS-PFE-038	DC	FHC-016 Next To Room 3135	OK	✓	✓	Plan to change in early 2024
39	APS-PFE-039	DC	FHC-017 Next to Room 3117	Old & Rusty	✓	✓	Plan to change in early 2024
40	APS-PFE-040	DC	FHC-018 Next To Room 3120	Old & Rusty	✓	✓	Plan to change in early 2024
41	APS-PFE-041	DC	FHC-019 Next To HK Store [Linen]	Old & Rusty	✓	✓	Plan to change in early 2024
42	APS-PFE-042	DC	FHC-020 Next To Room 3127	Old & Rusty	✓	✓	Plan to change in early 2024
43	APS-PFE-043	DC	FHC-021 Next To Room 4201	Old & Rusty	✓	✓	Plan to change in early 2024
44	APS-PFE-044	DC	FHC-022 Next To Room 4110	OK	✓	✓	Plan to change in early 2024
45	APS-PFE-045	DC	FHC-023 Next To Room 2108	OK	✓	✓	Plan to change in early 2024
46	APS-PFE-046	DC	FHC-024 Next To Room 2208	Old	✓	✓	Plan to change in early 2024
47	APS-PFE-047	DC	FHC-025 Behind Front Office	Old & Rusty	✓	✓	Plan to change in early 2024
48	APS-PFE-048	DC	Amaya Toilet [Female]	Old & Rusty	✓	✓	Plan to change in early 2024
49	APS-PFE-049	DC	FHC-027 Amaya corridor [walkway]	OK	✓	✓	Plan to change in early 2024
50	APS-PFE-050	CO <sub>2</sub>	Amaya Kitchen	OK	✓	✓	Plan to change in early 2024
51	APS-PFE-051	FBK	Amaya Kitchen	OK	✓	✓	Plan to change in early 2024
52	APS-PFE-052	FBK	Amaya Thai-Kitchen	OK	✓	✓	Plan to change in early 2024
53	APS-PFE-053	CO <sub>2</sub>	Amaya back door	OK	✓	✓	Plan to change in early 2024
54	APS-PFE-054	CO <sub>2</sub>	Amaya back door	OK	✓	✓	Plan to change in early 2024
55	APS-PFE-055	DC	Amaya Gas Station	OK	✓	✓	Plan to change in early 2024
56	APS-PFE-056	CO <sub>2</sub>	Amaya Audio Room	Used	X	✓	Plan to change in early 2024
57	APS-PFE-057	DC	FHC-028 Chef Office/Meeting Room	OK	✓	✓	Plan to change in early 2024
58	APS-PFE-058	DC	SPA Entrance	OK	✓	✓	Plan to change in early 2024
59	APS-PFE-059	DC	SPA-Sky Room	OK	✓	✓	Plan to change in early 2024
60	APS-PFE-060	DC	SPA-Wind Room	OK	✓	✓	Plan to change in early 2024
61	APS-PFE-061	DC	FHC-029 Voyager Lounge walkway	OK	✓	✓	Plan to change in early 2024
62	APS-PFE-062	DC	Prego- Pizza Oven	OK	✓	✓	Plan to change in early 2024
63	APS-PFE-063	DC	Prego- Pizza Oven	OK	✓	✓	Plan to change in early 2024
64	APS-PFE-064	K	Staff Canteen	OK	✓	✓	Plan to change in early 2024
65	APS-PFE-065	FBK	Staff Canteen	N/A			Plan to order in early 2024
66	APS-PFE-066	K	Prego- KC Entrance	OK	✓	✓	Plan to change in early 2024
67	APS-PFE-067	DC	Prego- KC back door	OK	✓	✓	Plan to change in early 2024
68	APS-PFE-068	CO <sub>2</sub>	Prego- KC	OK	✓	✓	Plan to change in early 2024



NO	Register	TYPE	Location	Condition	Pressure/ Weight	Tag	Remark
69	APS-PFE-069	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
70	APS-PFE-070	FBK	Prego- KC-1	OK	✓	✓	Plan to change in early 2024
71	APS-PFE-071	DC	Gas Station – Canteen	OK	✓	✓	Plan to change in early 2024
72	APS-PFE-072	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
73	APS-PFE-073	DC	Gas Station – Prego	OK	✓	✓	Plan to change in early 2024
74	APS-PFE-074	DC	Next to MDB A1	OK	✓	✓	Plan to change in early 2024
75	APS-PFE-075	DC	Next to MDB A2	OK	✓	✓	Plan to change in early 2024
76	APS-PFE-076	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
77	APS-PFE-077	DC	Next to MDB A3	OK	✓	✓	Plan to change in early 2024
78	APS-PFE-078	DC	Next to Room 3223	OK	✓	✓	Plan to change in early 2024
79	APS-PFE-079	DC	Kids Club Toilet	OK	✓	✓	Plan to change in early 2024
80	APS-PFE-080	DC	Next to Room 4111	OK	✓	✓	Plan to change in early 2024
81	APS-PFE-081	DC	Next to Room 4116	OK	✓	✓	Plan to change in early 2024
82	APS-PFE-082	DC	Next to Room 4115	OK	✓	✓	Plan to change in early 2024
83	APS-PFE-083	DC	Next to Room 4103	OK	✓	✓	Plan to change in early 2024
84	APS-PFE-084	DC	Next to Room 4202	OK	✓	✓	Plan to change in early 2024
85	APS-PFE-085	DC	Next to Room 4117	OK	✓	✓	Plan to change in early 2024
86	APS-PFE-086	DC	Next to Room 4217	OK	✓	✓	Plan to change in early 2024
87	APS-PFE-087	DC	Next to Room 4109	OK	✓	✓	Plan to change in early 2024
88	APS-PFE-088	DC	Next to Room 4107	OK	✓	✓	Plan to change in early 2024
89	APS-PFE-089	DC	Engineer workshop	Old & Rusty	✓	✓	Plan to change in early 2024
90	APS-PFE-090	CO <sub>2</sub>	Fire Cart	Used	X	✓	Plan to change in early 2024
91	APS-PFE-091	CO <sub>2</sub>	Fire Cart	Used	X	✓	Plan to change in early 2024
92	APS-PFE-062	DC	Fire Cart	Used	X	✓	Plan to change in early 2024
93	APS-PFE-093	H	Fire Cart	Used	X	✓	Plan to change in early 2024
94	APS-PFE-094	DC	Hotel Van 30-0660	Used	X	✓	Plan to change in early 2024
95	APS-PFE-095	DC	Hotel Van 30-1720	Used	X	✓	Plan to change in early 2024

#### Summary

Type	Ready to use	Used
Dry Chemical [DC]	73	3
Carbon Dioxide [CO <sub>2</sub> ]	5	3
Halotron [H]	NA	2
Type K	4	NA
Fire Blanket [FBK]	5	NA

Name Person Responsible for Chief Engineer/ Manager, Security:

Position: Manager Security

Signature:

Date: December 17, 2023

FLS 10-02 PFEs

Amari  
AMARI KOH SAMUI  
DATE 17 Dec 23  
SIGNATURE  
HEAD OF SECURITY

ภาคผนวกที่ 12

---

แบบบันทึกการตรวจสอบเครื่องกำเนิดไฟฟ้า



บริษัท ทีเค เอ็นจิเนียริง 999 จำกัด

TK ENGINEERING 999 CO., LTD.

471/244 ถ.เพชรเกษม แขวงบางหว้า เขตภาษีเจริญ กรุงเทพมหานคร 10160 Tel/Fax: 02-0033958

---


## รายงานการตรวจสอบเครื่องกำเนิดไฟฟ้าขนาด 66 KVA ตัวที่ 1 ( ตึก North )

### 1. ลักษณะทั่วไป

- 1.1 เครื่องกำเนิดไฟฟ้ารุ่น APD66C หมายเลข 87591714
- 1.2 เครื่องยนต์รุ่น 4BTA3.9 - G2 หมายเลข 87591714
- 1.3 อัลเทอร์เนเตอร์รุ่น AK351 หมายเลข AK13101805 - A
- 1.4 ชุดควบคุมรุ่น DSE หมายเลข -
- 1.5 ชั่วโมงการทำงาน 5610 ชั่วโมง

### 2. เช็กระบบเครื่องยนต์

2.1 ตรวจสอบระบบหล่อเย็น น้ำในหม้อน้ำมีปริมาณปกติ ท่อต่าง ๆ ปกติพร้อมใช้งาน

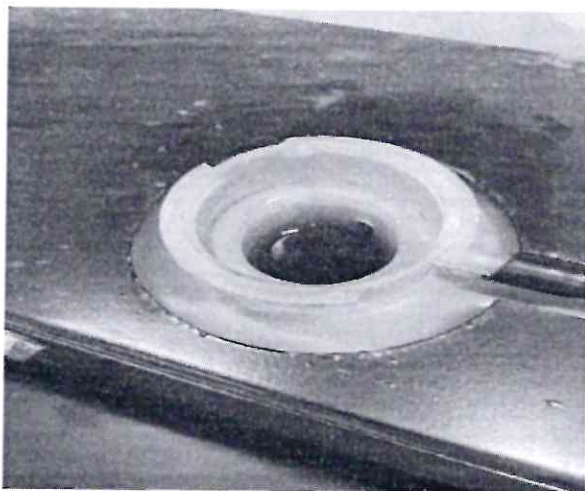


2.2 ตรวจสอบน้ำมันหล่อลื่น น้ำมันหล่อลื่นอยู่ในระดับปกติ กรองน้ำมันหล่อลื่นมีสภาพปกติพร้อมใช้งาน





2.3 ตรวจสอบระบบน้ำมันเชื้อเพลิง ระดับน้ำมันเชื้อเพลิงมี 2/4 ของถัง ตรวจสอบสภาพกรองน้ำมันเชื้อเพลิง ปกติพร้อมใช้งาน



2.4 ตรวจสอบสภาพกรองอากาศ ตรวจสอบสภาพกรองอากาศสภาพดีปกติพร้อมใช้งาน

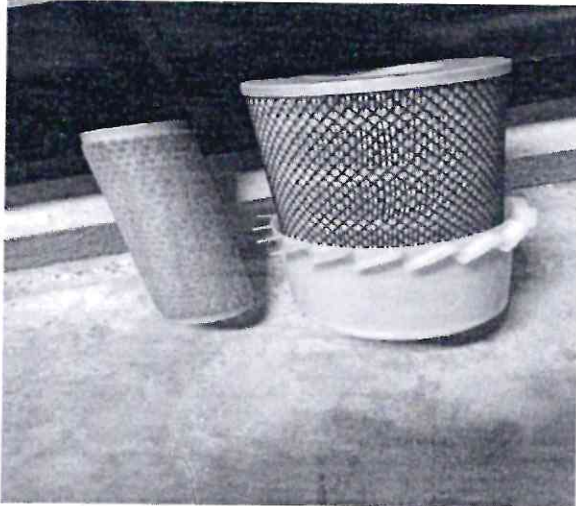

2.5 ตรวจสอบแบตเตอรี่ ระดับน้ำกลั่นปกติ ระบบชาร์จปกติพร้อมใช้งาน

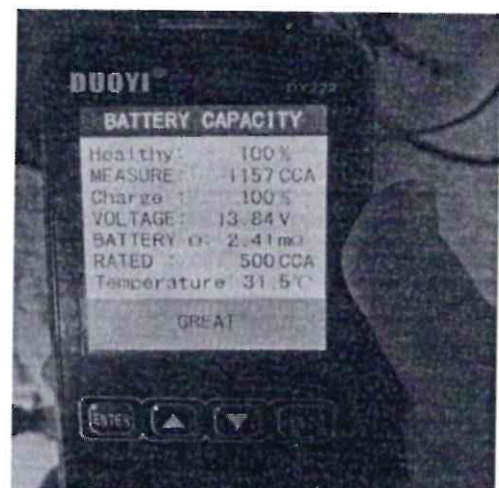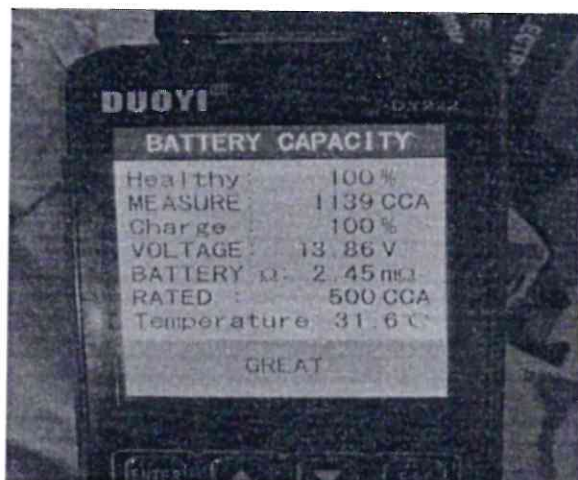

### 3. ตรวจสอบไฟฟ้าเครื่องยนต์

3.1 ตรวจสอบเช็จุดจ่ายน้ำมันเครื่อง ชุดควบคุมความเร็วรอบ ปกติพร้อมใช้งาน

3.2 ตรวจสอบเช็จุดเกวียดต่าง ๆ ปกติพร้อมใช้งาน





#### 4. เช็คตู้ควบคุมเครื่องกำเนิดไฟฟ้า

4.1 ตรวจสอบเช็คชุดควบคุมเครื่องกำเนิดไฟฟ้าและมิเตอร์ต่าง ๆ ทำงานได้ปกติพร้อมใช้งาน



4.2 ทดสอบการทำงานของเครื่อง สามารถทำงานได้ปกติ

4.3 แรงดันน้ำมันเครื่อง 5.23 BAR

4.4 อุณหภูมิน้ำหล่อเย็น 43 °C

4.5 ความเร็วรอบเครื่องยนต์ 1503 RPM 50.1 Hz

4.6 แบตเตอรี่ชาร์จ 28.1 VDC

4.7 ค่าแรงดันไฟฟ้า

233	233	233	402	402	403
-----	-----	-----	-----	-----	-----

## 5. ทำความสะอาดเครื่องกำเนิดไฟฟ้า

ข้อเสนอแนะ

1. ควรให้เครื่องยนต์ทำงานในสภาวะจ่ายโหลดประมาณ 30% ปีละ 1 ครั้ง เป็นเวลา 4 ชั่วโมง เพื่อลดปัญหาการเผาไหม้ไม่หมดของเครื่องยนต์ที่มีการทำงานในสภาวะไร้โหลดเป็นเวลานานๆ
2. แบตเตอรี่ STAND BY มีอายุการใช้งานอยู่ที่ 1 ปี 6 เดือน ถึง 2 ปี ถ้าเกินจากนี้แนะนำให้เปลี่ยนใหม่ เพื่อประสิทธิภาพในการจ่ายกระแสไปให้มอเตอร์สตาร์ทเครื่องยนต์
3. เสนอเปลี่ยนถ่ายน้ำมันเครื่องพร้อมเปลี่ยนกรองและน้ำยาหม้อน้ำประจำปี ๑ ละ 1 ครั้ง

ผู้จัดทำรายงาน

นายกิริติต พรเดชวงศ์

ผู้ตรวจสอบ

บริษัท ทีเค เอ็นจิเนียริง 999 จำกัด

วันที่ 18/8/2566



บริษัท ทีเค เอ็นจิเนียริง 999 จำกัด

TK ENGINEERING 999 CO., LTD.

471/244 ถ.เพชรเกษม แขวงบางหว้า เขตภาษีเจริญ กรุงเทพมหานคร 10160 Tel/Fax: 02-0033958


## รายงานการตรวจสอบเครื่องกำเนิดไฟฟ้าขนาด 66 KVA ตัวที่ 2 ( ตึก South )

### 1. ลักษณะทั่วไป


- 1.1 เครื่องกำเนิดไฟฟ้ารุ่น APD66C หมายเลข 87591778
- 1.2 เครื่องยนต์รุ่น 4BTA3.9 - G2 หมายเลข 87591718
- 1.3 อัลเทอร์เนเตอร์รุ่น AK351 หมายเลข AK13101826 - A
- 1.4 ชุดควบคุมรุ่น DSE หมายเลข -
- 1.5 ชั่วโมงการทำงาน 4695 ชั่วโมง

### 2. เช็กระบบเครื่องยนต์

2.1 ตรวจสอบหล่อเย็น น้ำในหม้อน้ำมีปริมาณปกติ ท่อต่าง ๆ ปกติพร้อมใช้งาน

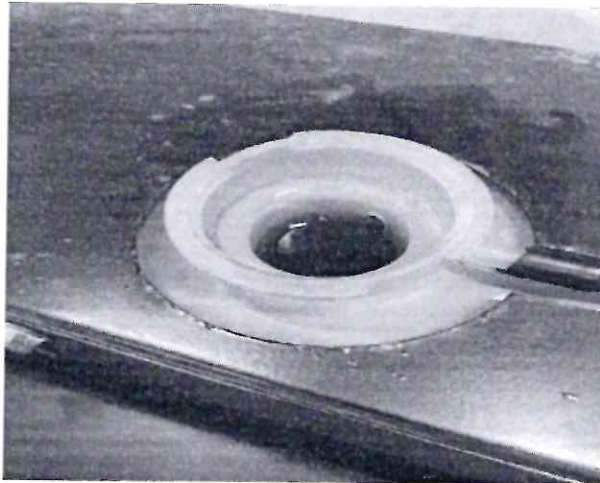


2.2 ตรวจสอบน้ำมันหล่อลื่น น้ำมันหล่อลื่นอยู่ในระดับปกติ กรองน้ำมันหล่อลื่นมีสภาพปกติพร้อมใช้งาน

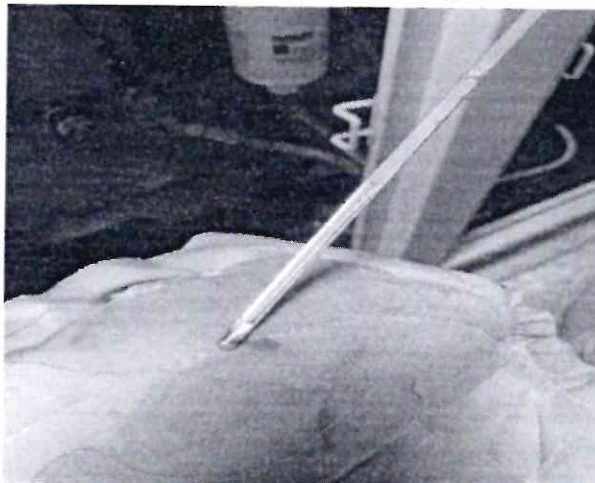


2.3 ตรวจสอบน้ำมันเชื้อเพลิง ระดับน้ำมันเชื้อเพลิงมี 2/4 ของถัง ตรวจสอบสภาพกรองน้ำมันเชื้อเพลิง ปกติพร้อมใช้



2.4 ตรวจสอบสภาพกรองอากาศ ตรวจสอบดูสภาพกรองอากาศปกติพร้อมใช้งาน

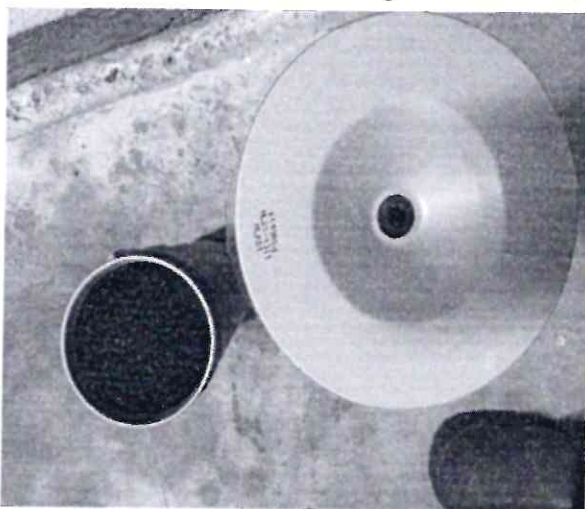

2.5 ตรวจสอบแบตเตอรี่ ระดับน้ำกลั่นปกติ ระบบชาร์จปกติพร้อมใช้งาน

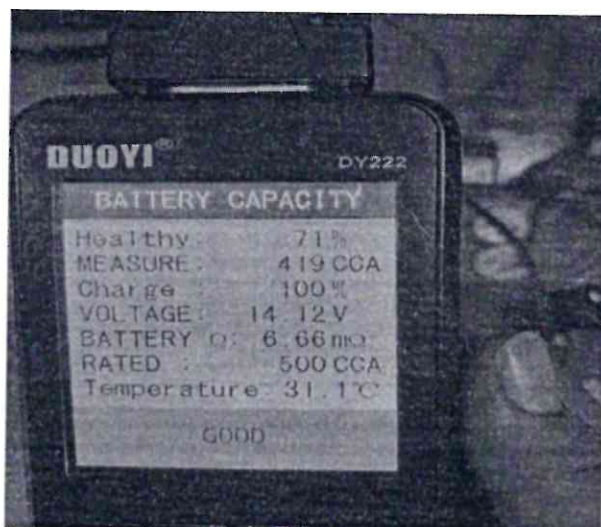

3. ตรวจสอบไฟฟ้าเครื่องยนต์

3.1 ตรวจสอบชุดจ่ายน้ำมันเครื่อง ชุดควบคุมความเร็วรอบ ปกติพร้อมใช้งาน


3.2 ตรวจสอบชุดเกวี่ต่าง ๆ ปกติพร้อมใช้งาน





#### 4. เช็ควัดควบคุมเครื่องกำเนิดไฟฟ้า

4.1 ตรวจสอบเช็คชุดควบคุมเครื่องกำเนิดไฟฟ้าและมิเตอร์ต่าง ๆ ทำงานได้ปกติพร้อมใช้งาน

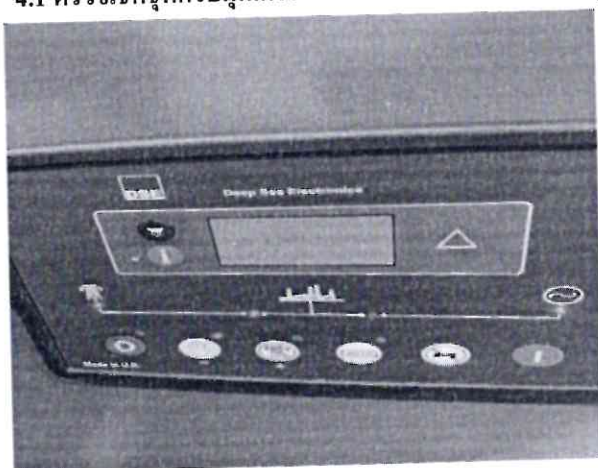

4.2 ทดสอบการทำงานของเครื่อง สามารถทำงานได้ปกติ

4.3 แรงดันน้ำมันเครื่อง 5.23 BAR

4.4 อุณหภูมิน้ำหล่อเย็น 41 °C

4.5 ความเร็วรอบเครื่องยนต์ 1503 RPM 50.1 Hz

4.6 แบตเตอรี่ชาร์จ 28 VDC

4.7 ค่าแรงดันไฟฟ้า

232	232	232	401	402	402
-----	-----	-----	-----	-----	-----

## 5. ทำความสะอาดเครื่องกำเนิดไฟฟ้า

ข้อเสนอแนะ

1. ควรให้เครื่องยนต์ทำงานในสภาวะจ่ายโหลดประมาณ 30 % ปีละ 1 ครั้ง เป็นเวลา 4 ชั่วโมง เพื่อลดปัญหาการเผาไหม้ไม่หมดของเครื่องยนต์ที่มีการทำงานในสภาวะไร้โหลดเป็นเวลานานๆ
2. แบตเตอรี่ STAND BY มีอายุการใช้งานอยู่ที่ 1ปี6เดือน ถึง 2ปี ถ้าเกินจากนี้แนะนำให้เปลี่ยนใหม่ เพื่อประสิทธิภาพในการจ่ายกระแสไปให้มอเตอร์สตาร์ทเครื่องยนต์
- 3.เสนอเปลี่ยนถ่านน้ำมันเครื่องพร้อมเปลี่ยนกรองและน้ำยาหม้อน้ำประจำปี ๑ ละ 1 ครั้ง

ผู้จัดทำรายงาน

นายกิริติต พรเดชวงศ์

ผู้ตรวจสอบ

บริษัท ทีเค เอ็นจิเนียริง 999 จำกัด

วันที่ 18/8/2566





บริษัท ทีเค เอ็นจิเนียริง 999 จำกัด  
TK ENGINEERING 999 CO., LTD.

471/244 อ.เพชรเกษม แขวงบางหว้า เขตภาษีเจริญ กรุงเทพมหานคร 10160 Tel/Fax: 02-0033958, 081-812-0817

ชื่อลูกค้า: <b>เดอะ เพรสซิเดนซ์ รีสอร์ท</b>	เบอร์โทรศัพท์:
ที่อยู่: <b>ด. ทรัพย์</b>	E-mail:
Genset-model: <b>APD 66C</b> SN: <b>87591718</b>	KVA: <b>66</b> Control:
Engine model: <b>4BTA3.9-G2</b> SN: <b>87591718</b>	HOUR: <b>4696h 13m</b> <input checked="" type="checkbox"/> Preventive maintenance
Alternator model: <b>AK 351</b> SN: <b>AK3101826-A</b>	DATE: <b>7/12/66</b> <input type="checkbox"/> Emergency

Item	Description	Check	Remark						
1 ระบบหล่อเย็น (Cooling System)									
1.1	ตรวจสอบระดับน้ำในหม้อน้ำ: (Top up) ตรวจสอบเช็คสภาพของฝาหม้อน้ำ	✓							
1.2	ตรวจสอบเช็คสภาพของ Belt Tension, Thermostat Housing	✓							
1.3	ตรวจสอบเช็คสภาพของ Radiator, Water Pump, การรั่วซึมของหม้อน้ำ, ท่อยาง	✓							
2 ระบบหล่อลื่น (Lubrication System)									
2.1	ตรวจสอบเช็คระดับน้ำมันหล่อลื่น (H: <input checked="" type="checkbox"/> M: <input type="checkbox"/> L: <input type="checkbox"/> )	✓							
2.2	ตรวจสอบเช็คสภาพของ Oil Filter และการรั่วซึมของน้ำมันหล่อลื่นตามจุดต่าง ๆ	✓							
2.3	ตรวจสอบเช็คสภาพของ Breaker Pipe, Oil Sampling Point, Filter Cap	✓							
3 ระบบน้ำมันเชื้อเพลิง (Fuel System)									
3.1	ตรวจสอบเช็คระดับน้ำมันเชื้อเพลิงในถัง ( F: <input type="checkbox"/> M: <input checked="" type="checkbox"/> E: <input type="checkbox"/> )	✓							
3.2	ตรวจสอบเช็คสภาพของ Primary Fuel Filter และ การรั่วซึมของน้ำมันเชื้อเพลิง	✓							
3.3	ตรวจสอบเช็คสภาพของ Fuel Injection Pump, Relief Valve, Fuel Lift Pump	✓							
3.4	ตรวจสอบเช็คสภาพของ Governor, Throttle Lever, Governor Weights	✓							
4 ระบบอากาศ (Air System & Exhaust System)									
4.1	ตรวจสอบเช็คสภาพของ Air Filter Component	✓							
4.2	ตรวจสอบเช็คสภาพของ Turbocharger, Inter Manifold, Exhaust Manifold	✓							
5 ระบบไฟฟ้า (Electric System)									
5.1	ตรวจสอบเช็คสภาพ สายไฟ, จุดต่อสายไฟตามจุดต่าง ๆ	✓	Battery 1: 924CCA / 13.81V. 2: 908CCA / 13.86V.						
5.2	DC: ตรวจสอบเช็คสภาพของแบตเตอรี่, ขั้วแบตเตอรี่, สายไฟ และ สายGround	✓							
5.3	DC: ตรวจสอบเช็คระดับน้ำกรดแบตเตอรี่ ระดับ (Top up) (H: <input checked="" type="checkbox"/> M: <input type="checkbox"/> L: <input type="checkbox"/> )	✓							
5.4	AC: ตรวจสอบเช็คสภาพและการทำงาน Circuit Breaker	✓							
5.5	ตรวจสอบเช็ค AVR	✓							
6 Control Panel Functional Operation									
6.1	ทดสอบหลอดไฟ LED แสดงสัญญาณเตือนต่าง ๆ: (Lamp Test / Reset)	✓							
6.2	เกจวัดแรงดันน้ำมันเครื่อง (...5.02...BAR / PSI)	✓							
6.3	เกจวัดอุณหภูมิหม้อน้ำหล่อเย็น (...43...°C / °F)	✓							
6.4	เกจวัด ความเร็วรอบ (...1500...RPM) (ค่าความถี่: 50...Hz)	✓							
6.5	เกจวัด Battery Charging (DC: 28...Volt)	✓							
6.6	การทำงานของปุ่ม Emergency Stop Push	✓							
6.7	การทำงานของสวิตช์ Start (MAN) Manual (Run) (MAN) Auto (RE) Stop	✓							
7 การทดสอบเครื่องกำเนิดไฟฟ้า									
ค่าแรงดันไฟฟ้า (Volt)		ค่ากระแสไฟฟ้า (Amp)							
สถานะการทำงาน	L1-N	L2-N	L3-N	L1-L2	L2-L3	L3-L1	L1	L2	L3
7.1	232	232	232	401	402	402	0	0	0
8 ตรวจสอบเช็คและทำความสะอาดเครื่องกำเนิดไฟฟ้า				✓					

(ส่วนของลูกค้า)

(ส่วนของพนักงานบริการ)

ลงชื่อ.....

*Imm.*

วันที่ **7** / **12** / **66**

ลงชื่อ.....

*สุรพล, ฉวีสิทธิ์*

วันที่ **7** / **12** / **66**





บริษัท ทีเค เอ็นจิเนียริง 999 จำกัด  
TK ENGINEERING 999 CO., LTD.

471/244 อ.เพชรเกษม แขวงบางหว้า เขตภาษีเจริญ กรุงเทพมหานคร 10160 Tel/Fax: 02-0033958, 081-812-0817

ชื่อลูกค้า: <b>บดะเรลชีเทนซ์ ห้างหุ้น</b>	เบอร์โทรศัพท์:
ที่อยู่: <b>อ. นอร์ท (Gen1 North)</b>	E-mail:
Genset-model: <b>APD 66C</b> SN: <b>87591714</b>	KVA: <b>66</b> Control:
Engine model: <b>AK351</b> SN: <b>AK13101805-A</b>	HOUR: <b>5685h 6m</b> <input checked="" type="checkbox"/> Preventive maintenance
Alternator model: <b>4BTA3.9-G2</b> S/N: <b>87591714</b>	DATE: <b>7/12/66</b> <input type="checkbox"/> Emergency

Item	Description	Check	Remark							
1	ระบบหล่อเย็น (Cooling System)									
1.1	ตรวจสอบระดับน้ำในหม้อน้ำ: (Top up) ตรวจสอบเช็คสภาพของหม้อน้ำ	✓								
1.2	ตรวจสอบเช็คสภาพของ Bell Tension, Thermostat Housing	✓								
1.3	ตรวจสอบเช็คสภาพของ Radiator, Water Pump, การรั่วซึมของหม้อน้ำ, พัดลม	✓								
2	ระบบหล่อลื่น (Lubrication System)									
2.1	ตรวจสอบเช็คระบบน้ำมันหล่อลื่น (H: <input checked="" type="checkbox"/> M: <input type="checkbox"/> L: <input type="checkbox"/> )	✓								
2.2	ตรวจสอบเช็คสภาพของ Oil Filter และการรั่วซึมของน้ำมันหล่อลื่นตามจุดต่าง ๆ	✓								
2.3	ตรวจสอบเช็คสภาพของ Breaker Pipe, Oil Sampling Point, Filler Cap	✓								
3	ระบบน้ำมันเชื้อเพลิง (Fuel System)									
3.1	ตรวจสอบเช็คระดับน้ำมันเชื้อเพลิงในถัง ( F: <input type="checkbox"/> M: <input checked="" type="checkbox"/> E: <input type="checkbox"/> )	✓								
3.2	ตรวจสอบเช็คสภาพของ Primary Fuel Filter และ การรั่วซึมของน้ำมันเชื้อเพลิง	✓								
3.3	ตรวจสอบเช็คสภาพของ Fuel Injection Pump, Relief Valve, Fuel Lift Pump	✓								
3.4	ตรวจสอบเช็คสภาพของ Governor, Throttle Lever, Governor Weights	✓								
4	ระบบอากาศ (Air System & Exhaust System)									
4.1	ตรวจสอบเช็คสภาพของ Air Filter Component	✓								
4.2	ตรวจสอบเช็คสภาพของ Turbocharger, Inter Manifold, Exhaust Manifold	✓								
5	ระบบไฟฟ้า (Electric System)									
5.1	ตรวจสอบเช็คสภาพ สายไฟ, จุดต่อสายไฟตามจุดต่าง ๆ	✓	Battery 1: 1040 CCA / 13.84 V. 2: 1034 CCA / 13.68 V.							
5.2	DC: ตรวจสอบเช็คสภาพของแบตเตอรี่, ขั้วแบตเตอรี่, สายไฟ และ สายGround	✓								
5.3	DC: ตรวจสอบเช็คระดับน้ำกรดแบตเตอรี่ ระดับ (Top up) ( H: <input checked="" type="checkbox"/> M: <input type="checkbox"/> L: <input type="checkbox"/> )	✓								
5.4	AC: ตรวจสอบเช็คสภาพและการทำงาน Circuit Breaker	✓								
5.5	ตรวจสอบเช็ค AVR	✓								
6	Control Panel Functional Operation									
6.1	ทดสอบหลอดไฟ LED แสดงสัญญาณเตือนต่าง ๆ: (Lamp Test / Reset)	✓								
6.2	เกจวัดแรงดันน้ำมันเครื่อง (.....5.16.....BAR / PSI)	✓								
6.3	เกจวัดอุณหภูมิหม้อน้ำหล่อเย็น (.....44.....°C / °F)	✓								
6.4	เกจวัด ความเร็วรอบ (.....1503.....RPM) (ค่าความถี่.....50.2.....Hz)	✓								
6.5	เกจวัด Battery Charging (DC.....28.1 Volt)	✓								
6.6	การทำงานของปุ่ม Emergency Stop Push	✓								
6.7	การทำงานของสวิทช์ Start แบบ Manual (Run) แบบ Auto และ Stop	✓								
7	การทดสอบเครื่องกำเนิดไฟฟ้า									
	ค่าแรงดันไฟฟ้า (V)		ค่ากระแสไฟฟ้า (Amp)							
	ค่าแรงดันที่ทำงาน	L1-N	L2-N	L3-N	L1-L2	L2-L3	L3-L1	L1	L2	L3
7.1	สถานะการทำงาน	233	232	233	402	403	403	0	0	0
8	ตรวจสอบเช็คและทำความสะอาดเครื่องกำเนิดไฟฟ้า									

(ส่วนของพนักงานบริการ)

ลงชื่อ.....

วันที่.....

7 / 12 / 66

ลงชื่อ.....

น.ส.พ.ค. อ.อ.สิริทธิ์

วันที่.....

7 / 12 / 66