


เอกสารแนบที่ 27 บันทึกการทดสอบฝึกบัวฉุกเงิน




Location Description	Cooling tower Chemical dosing	Laboratory room	Water Treatment	HRSG Chemical dosing	Aux. boiler Chemical dosing
Eyewash water Flow	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Eyewash water Temperature	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Shower water Flow	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Shower water Temperature	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Shower control operation	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Environment	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>



Cooling tower  
Chemical dosing

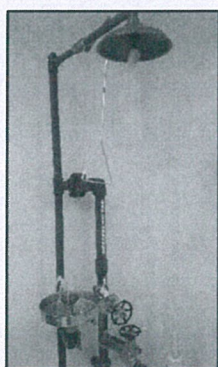


Laboratory room

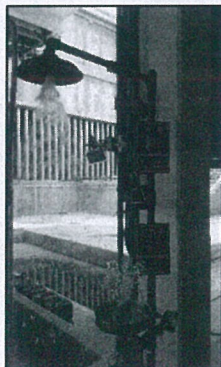

Water Treatment



HRSG  
Chemical dosing

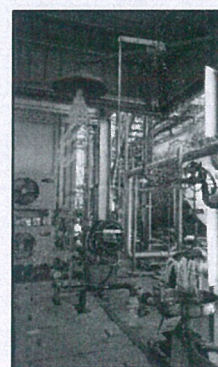

Aux. boiler  
Chemical dosing

Remark:

.....

.....

Recorded by

Received by

Approved by

Field Operator

Shift Supervisor


Operation Manager




Location Description	Cooling tower Chemical dosing		Laboratory room		Water Treatment		HRSG Chemical dosing		Aux. boiler Chemical dosing	
Eyewash water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Eyewash water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower control operation	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Environment	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>



Cooling tower  
Chemical dosing

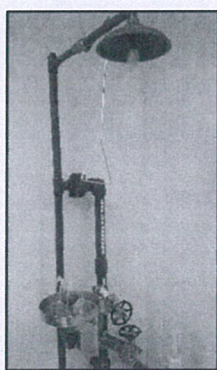


Laboratory room

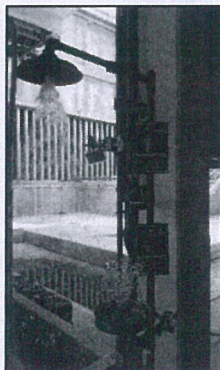

Water Treatment



HRSG  
Chemical dosing

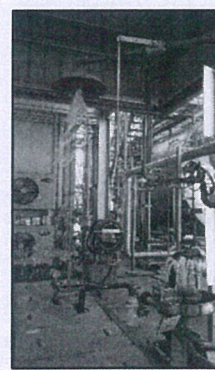

Aux. boiler  
Chemical dosing

Remark:

.....

.....

Recorded by

Received by


Approved by

Field Operator

Shift Supervisor

Operation Manager




 <b>3003.00 W-07B(00)</b>	<b>OPERATION</b> <b>Safety shower and Eye Washer Weekly Test</b>	DATE: 6 / 3 / 2023
---	---	--------------------


Location Description	Cooling tower Chemical dosing	Laboratory room	Water Treatment	HRSG Chemical dosing	Aux. boiler Chemical dosing
Eyewash water Flow	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Eyewash water Temperature	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Shower water Flow	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Shower water Temperature	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Shower control operation	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/> Abnormal <input type="checkbox"/>
Environment	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/>



**Cooling tower  
Chemical dosing**

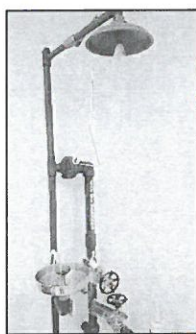

**Laboratory room**

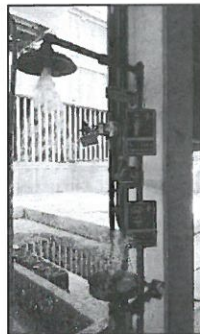

**Water Treatment**



**HRSG  
Chemical dosing**



**Aux. boiler  
Chemical dosing**

Remark:

.....

.....

Recorded by

Received by


Approved by

Field Operator


Shift Supervisor

Operation Manager

Location Description	Cooling tower Chemical dosing		Laboratory room		Water Treatment		HRSG Chemical dosing		Aux. boiler Chemical dosing	
Eyewash water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Eyewash water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower control operation	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Environment	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>

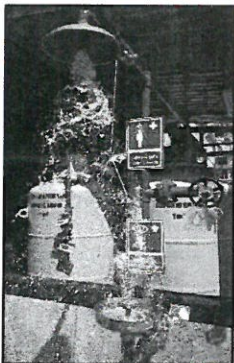


**Cooling tower  
Chemical dosing**

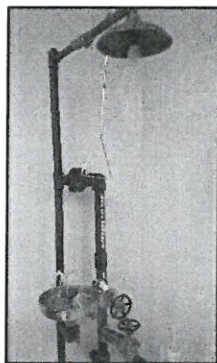


**Laboratory room**



**Water Treatment**

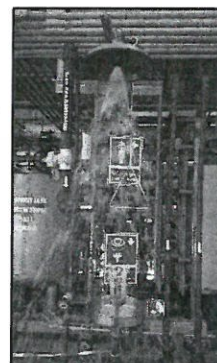

**HRSG  
Chemical dosing**

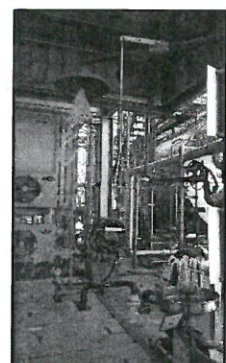

**Aux. boiler  
Chemical dosing**

Remark:

.....

Recorded by

Received by


Approved by

Field Operator


Shift Supervisor

Operation Manager




 <b>3003 00 W-07B (00)</b>	<b>OPERATION</b> <b>Safety shower and Eye Washer Weekly Test</b>	DATE: 1 / 5 / 23
--	---	------------------


Location Description	Cooling tower Chemical dosing		Laboratory room		Water Treatment		HRSG Chemical dosing		Aux. boiler Chemical dosing	
Eyewash water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Eyewash water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower control operation	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Environment	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>

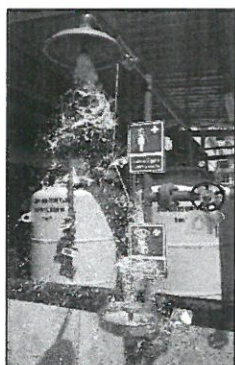

**Cooling tower  
Chemical dosing**

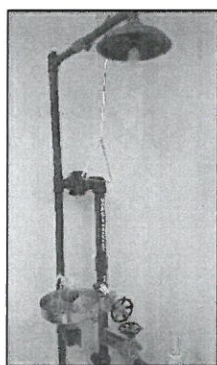


**Laboratory room**

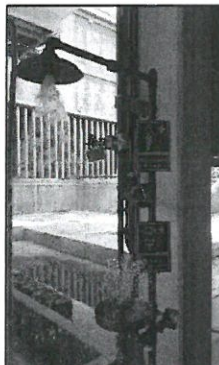

**Water Treatment**



**HRSG  
Chemical dosing**

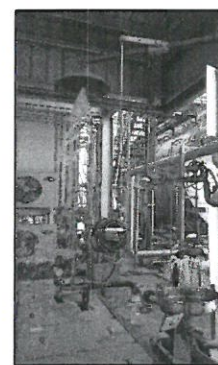

**Aux. boiler  
Chemical dosing**

Remark:

.....

.....

Recorded by

Received by


Approved by

Field Operator


Shift Supervisor

Operation Manager


Location Description	Cooling tower Chemical dosing		Laboratory room		Water Treatment		HRSG Chemical dosing		Aux. boiler Chemical dosing	
Eyewash water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Eyewash water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Flow	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower water Temperature	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Shower control operation	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>	Normal <input checked="" type="checkbox"/>	Abnormal <input type="checkbox"/>
Environment	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>	Clean <input checked="" type="checkbox"/>	Dirty <input type="checkbox"/>

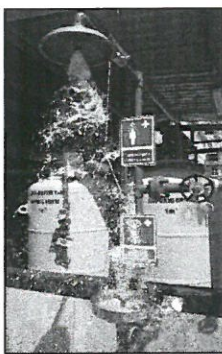


**Cooling tower  
Chemical dosing**

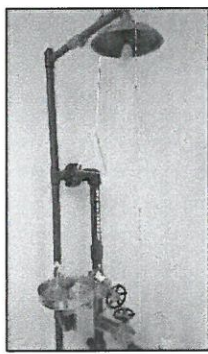


**Laboratory room**

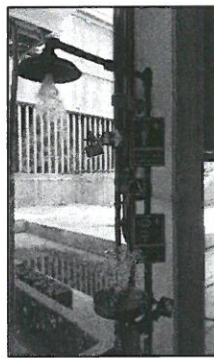

**Water Treatment**

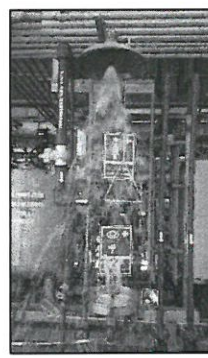

**HRSG  
Chemical dosing**

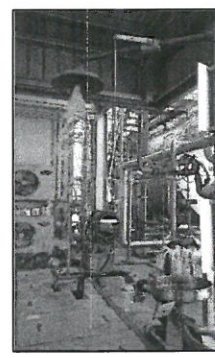

**Aux. boiler  
Chemical dosing**

Remark:

.....

Recorded by

Received by

Approved by

Field Operator

Shift Supervisor

Operation Manager