

## ภาคผนวก

ภาคผนวก ก-1	เอกสารการแจ้ง เปลี่ยนชื่อโครงการ และชื่อบริษัท และสำเนาผลการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โรงไฟฟ้าเชิงรำน้อย
ภาคผนวก ข-1	ตัวอย่างเงื่อนไขในสัญญาจ้างบริษัทผู้รับเหมา
ภาคผนวก ข-2	สำเนาหนังสือนำส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อมระหว่างเดือนกรกฎาคม-ธันวาคม พ.ศ. 2566 (ครั้งที่ 2/2566)
ภาคผนวก ข-3	เอกสารการบำรุง-รักษาระบบหล่อเย็น
ภาคผนวก ข-4	ขั้นตอนการรับเรื่องร้องเรียน และเอกสารสรุปบันทึกการรับข้อร้องเรียนระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567
ภาคผนวก ข-5	เอกสารการออกแบบระบบการใช้ก๊าซธรรมชาติเป็นเชื้อเพลิง
ภาคผนวก ข-6	เอกสารการติดตั้ง Dry Low NOx
ภาคผนวก ข-7	ผลการตรวจวัดคุณภาพอากาศจากปล่องระบายอากาศจาก Continuous Emission Monitoring System (CEMs) ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567
ภาคผนวก ข-8	เอกสารขึ้นทะเบียนบุคลากร ผู้ควบคุมระบบบำบัดมลพิษทางอากาศ
ภาคผนวก ข-9	ข้อมูลจำเพาะของเครื่องจักรและอุปกรณ์ที่มีเสียงดัง
ภาคผนวก ข-10	ผลการตรวจวัดระดับเสียงในสถานประกอบการ (แบบติดตั้งกับพื้นที่)
ภาคผนวก ข-11	เอกสารบุคลากรผู้ควบคุมระบบบำบัดน้ำเสีย
ภาคผนวก ข-12	กิจกรรมชุมชนสัมพันธ์
ภาคผนวก ข-13	เอกสารการติดตั้งท่อชักน้ำดิบ
ภาคผนวก ข-14	กฎระเบียบการจราจรภายในโรงไฟฟ้า
ภาคผนวก ข-15	สถิติอุบัติเหตุ ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567
ภาคผนวก ข-16	แบบบันทึกปริมาณยานพาหนะที่เข้า-ออก โรงไฟฟ้า ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567
ภาคผนวก ข-17	เอกสารการส่งกำจัดขยะมูลฝอย
ภาคผนวก ข-18	หนังสือขออนุญาตนำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วออกนอกบริเวณโรงงาน
ภาคผนวก ข-19	เอกสารการส่งกำจัดกากของเสียอุตสาหกรรม (Manifest)
ภาคผนวก ข-20	เอกสารแผนการซ่อมบำรุงรักษาเครื่องจักร และอุปกรณ์
ภาคผนวก ข-21	เอกสารการอบรมด้านความปลอดภัยแก่พนักงาน
ภาคผนวก ข-22	ทะเบียนรายชื่อสารเคมีและตัวอย่างข้อมูลความปลอดภัยของสารเคมี (SDS)
ภาคผนวก ข-23	เอกสารการจัดตั้งคณะกรรมการด้านความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อมในการทำงาน
ภาคผนวก ข-24	คู่มือความปลอดภัยในการทำงาน
ภาคผนวก ข-25	แบบแจ้งผลการตรวจสุขภาพที่พบความผิดปกติหรือการเจ็บป่วย การให้การรักษาพยาบาล และการป้องกันแก้ไข (จผส.1) และผลตรวจสุขภาพพนักงานใหม่

## ภาคผนวก (ต่อ)

---

ภาคผนวก ข-26	Work Permit
ภาคผนวก ข-27	ระเบียบปฏิบัติด้านความปลอดภัยในการปฏิบัติงานเกี่ยวกับการตัด เชื่อม และการประสาน
ภาคผนวก ข-28	เอกสารการตรวจสอบอุปกรณ์ดับเพลิง
ภาคผนวก ข-29	เอกสารการตรวจสอบ Eye Washer และ Shower
ภาคผนวก ข-30	กิจกรรมส่งเสริมความปลอดภัย ประจำปี พ.ศ. 2566 (ครั้งล่าสุด)
ภาคผนวก ข-31	แผนฉุกเฉินของโรงไฟฟ้า
ภาคผนวก ข-32	กิจกรรมการซ้อมแผนฉุกเฉิน ประจำปี พ.ศ. 2566 (ครั้งล่าสุด)
ภาคผนวก ข-33	เอกสารการประชุมคณะกรรมการด้านความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อมในการทำงาน
ภาคผนวก ข-34	ระเบียบการปฏิบัติงานเรื่อง Safety Inspection (EHS-P-028)
ภาคผนวก ข-35	แผนผังระบบดับเพลิงและอุปกรณ์ชำระล้างฉุกเฉิน
ภาคผนวก ข-36	โครงการ 5ส. ของโรงไฟฟ้า
ภาคผนวก ข-37	เอกสารเผยแพร่รายละเอียดของโรงไฟฟ้า
ภาคผนวก ข-38	เอกสารบันทึกการประชุมคณะกรรมการ ตรวจสอบผลกระทบสิ่งแวดล้อม ของโรงไฟฟ้าเชิงรุกราน้อย
ภาคผนวก ข-39	เอกสารการแต่งตั้งคณะกรรมการตรวจสอบผลกระทบสิ่งแวดล้อม ของโรงไฟฟ้าเชิงรุกราน้อย
ภาคผนวก ค-1	ผลการตรวจสอบความถูกต้องของระบบ CEMs (RAA) ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567

## ภาคผนวก ก-1

---

เอกสารการแจ้ง เปลี่ยนชื่อโครงการ และชื่อบริษัท  
และสำเนาผลการพิจารณารายงานการวิเคราะห์  
ผลกระทบสิ่งแวดล้อม โรงไฟฟ้าเชียงรากน้อย

ที่ พส 1009.7/ 4902



สำนักงานนโยบายและแผน  
ทรัพยากรธรรมชาติและสิ่งแวดล้อม  
60/1 ซอยพิบูลย์วัฒนา 7 ถนนพระรามที่ 6  
กรุงเทพฯ 10400

บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด
วันที่ 21/11/2554 เวลา 15.30 น.
เลขที่เอกสาร GCRN - 5-0781074
ผู้รับ อธิบดีกรมการไฟฟ้า

30 พฤษภาคม 2554

เรื่อง การแจ้งการเปลี่ยนชื่อบริษัทเจ้าของโครงการโรงไฟฟ้าจากบริษัท ปทุม โคเจนเนอเรชั่น จำกัด เป็น  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

เรียน กรรมการผู้จัดการบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

- อ้างถึง 1. หนังสือบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ที่ GCRN O 0211/058 ลงวันที่ 11 มีนาคม 2554  
2. หนังสือบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ที่ GCRN O 0211/078 ลงวันที่ 22 เมษายน 2554

ตามหนังสือที่อ้างถึง 1 และ 2 บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ได้แจ้งสำนักงานนโยบาย  
และแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม (สผ.) ว่า บริษัท ปทุม โคเจนเนอเรชั่น จำกัด ซึ่งเป็นผู้ดำเนินการ  
โครงการโรงไฟฟ้าปทุม โคเจนเนอเรชั่น ตั้งอยู่ที่ตำบลเชียงรากน้อย อำเภอสองโคก จังหวัดปทุมธานี ซึ่งได้รับ  
ความเห็นชอบรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อมจากคณะกรรมการผู้ชำนาญการพิจารณารายงานการ  
วิเคราะห์ผลกระทบสิ่งแวดล้อมแล้ว ได้ทำการจดทะเบียนเปลี่ยนชื่อบริษัทเป็น บริษัท กัลฟ์ เจพี ซีอาร์เอ็น  
จำกัด (Gulf JP CRN Company Limited) โดยการเปลี่ยนแปลงชื่อดังกล่าวเป็นเพียงการเปลี่ยนแปลงชื่อ  
บริษัทฯ เท่านั้น ไม่มีผลกระทบต่อบรรดาสิทธิ และหน้าที่ตามนิติกรรมสัญญาต่าง ๆ ที่บริษัทฯ ได้กระทำ  
ในนามบริษัท ปทุม โคเจนเนอเรชั่น จำกัด บริษัทฯ จึงขอให้ สผ. ใช้ชื่อบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
แทนชื่อเดิมในการติดต่อและประสานงานหรือออกเอกสารสำคัญต่าง ๆ ให้กับบริษัทฯ รวมทั้งการติดต่อใน  
ส่วนของดำเนินการตามมาตรการที่ระบุไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อมของโครงการฯ ด้วย  
โดยบริษัทฯ ได้ยื่นขอประกอบกิจการโรงงานจากกรมโรงงานอุตสาหกรรม และสำนักงานคณะกรรมการกำกับ  
กิจการพลังงาน และได้รับอนุญาตประกอบกิจการโรงงานจากหน่วยงานดังกล่าว รวมทั้งได้แจ้งเปลี่ยนชื่อ  
บริษัทฯ ไปยังหน่วยงานดังกล่าวด้วยแล้ว ความละเอียดแจ้งแล้ว นั้น

สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ได้พิจารณาว่าเรื่องการ  
แจ้งเปลี่ยนชื่อบริษัทดังกล่าว เสนอคณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบ

สิ่งแวดล้อม.

- 2 -

สิ่งแวดล้อม ด้านโรงไฟฟ้าพลังความร้อน ในการประชุมครั้งที่ 10/2554 เมื่อวันที่ 20 พฤษภาคม 2554  
ซึ่งคณะกรรมการผู้ชำนาญการฯ มีมติรับทราบ ทั้งนี้ สำนักงานฯ ได้มีหนังสือแจ้งสำนักงานคณะกรรมการกำกับ  
กิจการพลังงานเพื่อทราบด้วยแล้ว

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

รองอธิการบดี ปฏิบัติราชการแทน  
เลขาธิการสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม

สำนักวิเคราะห์ผลกระทบสิ่งแวดล้อม

โทร. 0 2265 6628

โทรสาร 0 2265 6616

ที่ ทส 1009.7/ 7077



บริษัท กัลป์ เจที ซีอาร์เอ็น จำกัด	
วันที่ 8/6/11	เวลา 8:31 น.
เลขที่เอกสาร GCRN - I-0311/037	
ผู้รับ _____	

สำนักงานนโยบายและแผน  
ทรัพยากรธรรมชาติและสิ่งแวดล้อม  
60/1 ซอยพิบูลวัฒนา 7 ถนนพระรามที่ 6  
กรุงเทพฯ 10400

4 สิงหาคม 2554

เรื่อง การแจ้งเปลี่ยนชื่อโครงการโรงไฟฟ้าปทุม โคเจนเนอเรชั่น เป็น โครงการโรงไฟฟ้าเชียงรากน้อย

เรียน กรรมการผู้จัดการบริษัท กัลป์ เจที ซีอาร์เอ็น จำกัด

อ้างถึง หนังสือบริษัท กัลป์ เจที ซีอาร์เอ็น จำกัด ที่ GCRN O 0611/126 ลงวันที่ 15 มิถุนายน 2554

ตามหนังสือที่อ้างถึง บริษัท กัลป์ เจที ซีอาร์เอ็น จำกัด (เดิมชื่อบริษัท ปทุม โคเจนเนอเรชั่น จำกัด) ซึ่งเป็นผู้ดำเนินการโครงการโรงไฟฟ้าปทุม โคเจนเนอเรชั่น ตั้งอยู่ที่ตำบลเชียงรากน้อย อำเภอสองโคก จังหวัดปทุมธานี ได้แจ้งสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม (สผ.) ว่า ขณะนี้บริษัทฯ ได้เปลี่ยนชื่อโครงการฯ จากเดิม “โครงการโรงไฟฟ้าปทุม โคเจนเนอเรชั่น” เป็น “โครงการโรงไฟฟ้าเชียงรากน้อย” แล้ว จึงขอให้ สผ. ใช้หรืออ้างอิงชื่อ โครงการโรงไฟฟ้าเชียงรากน้อย แทนชื่อเดิมของโครงการฯ ในการติดต่อและประสานงานหรือออกเอกสารสำคัญต่าง ๆ ให้แก่โครงการฯ รวมทั้งการติดต่อในส่วนของการดำเนินการตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมตามที่ระบุไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อมของโครงการฯ ด้วยความละเอียดแจ้งแล้ว นั้น

สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ได้พิจารณานำเรื่องการแจ้งเปลี่ยนชื่อโครงการโรงไฟฟ้าดังกล่าว เสนอคณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม ด้านโรงไฟฟ้าพลังความร้อน ในการประชุมครั้งที่ 14/2554 เมื่อวันที่ 25 กรกฎาคม 2554 ซึ่งคณะกรรมการผู้ชำนาญการฯ มีมติรับทราบ ทั้งนี้ สำนักงานฯ ได้มีหนังสือแจ้งสำนักงานคณะกรรมการกำกับกิจการพลังงานเพื่อทราบด้วยแล้ว

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

สำนักวิเคราะห์ผลกระทบสิ่งแวดล้อม      รองเลขาธิการฯ ปฏิบัติราชการแทน  
เลขาธิการสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม  
โทร. 0 2265 6628  
โทรสาร 0 2265 6616



ที่ สกพ ๕๕๐๒/ ๓๓๙๙

สำนักงานคณะกรรมการกำกับกิจการพลังงาน  
๓๓๙ อาคารจัตุรัสจามจุรี ชั้น ๑๙ ถนนพญาไท  
แขวงพญาไท เขตปทุมวัน กรุงเทพฯ ๑๐๓๓๐

๑๙ พฤษภาคม ๒๕๕๖

เรื่อง แจ้งผลการขอเปลี่ยนแปลงรายละเอียดโครงการในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม  
โครงการโรงไฟฟ้าเชียงรากน้อย

เรียน กรรมการผู้จัดการ บริษัท กัลป์ เจที ซีอาร์เอ็น จำกัด

อ้างถึง หนังสือบริษัท กัลป์ เจที ซีอาร์เอ็น จำกัด ที่ GCRN O ๐๒๑๓/๐๒๑ ลงวันที่ ๔ กุมภาพันธ์ ๒๕๕๖

ตามหนังสือที่อ้างถึงบริษัท กัลป์ เจที ซีอาร์เอ็น จำกัด สดานประกอบกิจการพลังงานตั้งอยู่ เลขที่ ๕๙/๔ หมู่ที่ ๔ ตำบลเชียงรากน้อย อำเภอสองโคก จังหวัดปทุมธานี ได้แจ้งความประสงค์ขอเปลี่ยนแปลงรายละเอียดโครงการในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม (รายงาน EIA) โครงการโรงไฟฟ้าเชียงรากน้อย โดยให้คณะกรรมการกำกับกิจการพลังงาน (กกพ.) ในฐานะผู้อนุญาตพิจารณาให้ความเห็นชอบการเปลี่ยนแปลงดังกล่าว เพื่อให้เป็นไปตามเงื่อนไขที่กำหนดไว้ในรายงาน EIA ความละเอียดแจ้งแล้ว นั้น

ในการนี้ สำนักงาน กกพ. โดยความเห็นชอบของคณะกรรมการกำกับกิจการพลังงาน (กกพ.) พิจารณาแล้วเห็นว่า การเปลี่ยนแปลงแผนผังโครงการเป็นการเปลี่ยนแปลงซึ่งมีสาระสำคัญอันอาจกระทบต่อกำลังการผลิต มาตรฐานความปลอดภัย และสิ่งแวดล้อม ตามความในข้อ ๑๔ วรรคแรก ของระเบียบ กกพ. ว่าด้วยการขอรับใบอนุญาตและการอนุญาตประกอบกิจการพลังงาน พ.ศ. ๒๕๕๑ และไม่มีผลกระทบต่อการประเมินผลกระทบสิ่งแวดล้อมในรายงาน EIA ทั้งนี้ ให้บริษัทดำเนินการแจ้งเปลี่ยนแปลงรายละเอียดดังกล่าวให้สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อมเพื่อทราบต่อไป

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

เลขาธิการสำนักงานคณะกรรมการกำกับกิจการพลังงาน

ลายใบอนุญาต  
โทร. ๐ ๒๒๐๓ ๕๕๐๙ ต่อ ๗๖๖๖  
โทรสาร ๐ ๒๒๐๓ ๓๕๐๖

สกพ.

สกพ. เวชชุดังกล่าวมีขึ้นจากเรื่องข้อพิพาทระหว่างคณะกรรมการกำกับกิจการพลังงานกับ

ที่ ทส 1009.7/ 7861



สำนักงานนโยบายและแผน  
ทรัพยากรธรรมชาติและสิ่งแวดล้อม  
60/1 ซอยพิบูลวัฒนา 7 ถนนพระรามที่ 6  
กรุงเทพฯ 10400

3 กรกฎาคม 2556

เรื่อง การขอเปลี่ยนแปลงรายละเอียดโครงการในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้า  
เขี้ยวรากน้อย ของบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

เรียน กรรมการผู้จัดการบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

อ้างถึง หนังสือบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ที่ GCRN O 0513/071 ลงวันที่ 28 พฤษภาคม 2556

ตามหนังสือที่อ้างถึง บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ได้แจ้งสำนักงานนโยบายและแผน  
ทรัพยากรธรรมชาติและสิ่งแวดล้อมว่า บริษัทฯ ได้ขอเปลี่ยนแปลงรายละเอียดโครงการในรายงานการวิเคราะห์  
ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าเขี้ยวรากน้อย (การเปลี่ยนแปลงแผนผังโครงการ) ต่อคณะกรรมการ  
กำกับกิจการพลังงาน (กกพ.) และต่อมา กกพ. ได้ให้ความเห็นชอบกับการขอเปลี่ยนแปลงรายละเอียดโครงการใน  
รายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อมดังกล่าว เพื่อให้เป็นไปตามเงื่อนไขในแผนปฏิบัติการด้านสิ่งแวดล้อม  
ตามที่กำหนดไว้ในรายงานฯ ที่กำหนดให้บริษัทฯ แจ้งผลการพิจารณาความเห็นชอบของ กกพ. ต่อสำนักงานฯ  
เพื่อทราบ บริษัทฯ จึงได้ส่งสำเนานี้หนังสือเห็นชอบการขอเปลี่ยนแปลงรายละเอียดโครงการในรายงานฯ โครงการ  
โรงไฟฟ้าเขี้ยวรากน้อย ครั้งที่ 1 ของสำนักงานคณะกรรมการกำกับกิจการพลังงานต่อสำนักงานฯ เพื่อทราบ  
 และได้ส่งเล่มรายงานการขอเปลี่ยนแปลงรายละเอียดโครงการ โรงไฟฟ้าเขี้ยวรากน้อย ครั้งที่ 1 (ฉบับเดือนมกราคม  
 2556) และรายงานข้อมูลเพิ่มเติม (ฉบับเดือนเมษายน 2556) ให้สำนักงานฯ ด้วย ความละเอียดแจ้งแล้ว นั้น

สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ได้นำรายงานการขอเปลี่ยนแปลง  
รายละเอียดโครงการ โรงไฟฟ้าเขี้ยวรากน้อย ครั้งที่ 1 (ฉบับเดือนมกราคม 2556) และรายงานข้อมูลเพิ่มเติม  
 (ฉบับเดือนเมษายน 2556) ของบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด พร้อมสำเนานี้หนังสือของบริษัทฯ และสำเนา  
 หนังสือของสำนักงานคณะกรรมการกำกับกิจการพลังงาน เสนอคณะกรรมการผู้ชำนาญการพิจารณารายงานการ  
 วิเคราะห์ผลกระทบสิ่งแวดล้อม ด้านโรงไฟฟ้าพลังความร้อน ในการประชุมครั้งที่ 21/2556 เมื่อวันที่ 20  
 มิถุนายน 2556 ซึ่งคณะกรรมการผู้ชำนาญการฯ มีมติรับทราบ โดยมีข้อสังเกตเกี่ยวกับมาตรการในการ  
 ตรวจวัดคุณภาพอากาศจากปล่องของโครงการโรงไฟฟ้าเขี้ยวรากน้อย ของบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

ซึ่งควร..

- 2 -

ซึ่งควรพิจารณาให้มีการตรวจวัดค่าความเข้มข้นของฝุ่นละออง และก๊าซซัลเฟอร์ไดออกไซด์จากปล่องของ  
โครงการฯ ร่วมด้วย เพื่อให้สามารถเปรียบเทียบกับค่าควบคุมที่กำหนดไว้ในรายงานฯ ได้ต่อไป ทั้งนี้ สำนักงานฯ  
 ได้มีหนังสือแจ้งมติคณะกรรมการผู้ชำนาญการฯ ให้สำนักงานคณะกรรมการกำกับกิจการพลังงาน เพื่อทราบ  
 ด้วยแล้ว

จึงเรียนมาเพื่อโปรดทราบและพิจารณาดำเนินการต่อไป

ขอแสดงความนับถือ

รองเลขาธิการ ปฏิบัติราชการแทน  
เลขาธิการสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม

สำนักวิเคราะห์ผลกระทบสิ่งแวดล้อม

โทร 0 2265 6628

โทรสาร 0 2265 6616

## ภาคผนวก ข-1

---

ตัวอย่างเงื่อนไขในสัญญาจ้างบริษัทผู้รับเหมา

# CONSTRUCTION CONTRACT



between

**PATHUM COGENERATION COMPANY LIMITED**

**(OWNER)**

and

**MIT-POWER (THAILAND) LIMITED**

**(CONTRACTOR)**

dated

**October 1, 2010**

## EPC Contract Content

No.	Description
1	Construction contract agreement
2	Construction contract condition
3	Schedule 1 Form of Advance Payment Security
4	Schedule 2 Form of Performance Security
5	Schedule 3 Performance Guarantee
6	Schedule 4 Plant Test(including PS & CW conditions)
7	Schedule 5 Material and Equipment Sourcing
8	Schedule 6 Payment Milestone Schedule
9	Schedule 7 Project Master Schedule
10	Schedule 8 Contract Management Principles
11	Schedule 9 Permits
12	Schedule 10 Form of Lien Waiver
13	Schedule 11 Form of Construction Notice to Proceed
14	Schedule 12 Insurance
15	Schedule 13 Form of Guarantee Agreement
16.1	Schedule 14 Owner Responsible Documents
16.2	Schedule 15 Form of Pre-Financial Close Certificate
16.3	Schedule 16 Form of Financial Close(Facility Agent) Certificate
16.4	Schedule 17 Form of Financial Close(Owner) Certificate
16.5	Schedule 18 Form of J-Power Guarantee
16.6	Schedule 19 Agreed Payment
17	Section 3 Technical Specification
18	Appendix 1 Drawing and Diagram
	18.1) Power Plant Location 18.2) Power Plant Layout 18.3) Overall Process Flow 18.4) Water Balance 18.5) P&I Diagram 18.6) Design condition for Process Steam & Chilled Water 18.7) Electrical Single Line Diagram 18.8) 115 kV Protection and Metering Diagram 18.9) Instrument System Configuration of Plant Control & Monitoring System(ISC)
19	Appendix 2 Climate Conditions
20	Appendix 3 Natural Gas Specification
21	Appendix 4 Water Analysis
22	Appendix 5 Geotechnical Data

Pathum Cogeneration-Construction Contract

No.	Description
23	Appendix 6 PTT Gas Metering Station
24	Appendix 7 Terminal Points
25	Appendix 8 EIA Report
26	Appendix 9 PPA Requirements
27	Appendix 10 GTG Proposal (Siemens)
28	Appendix 11 HRSG Proposal (DKME)
29	Appendix 12 STG Proposal (MES)
30	Appendix 13 Civil and Architectural Concept 30.1)SPP Concept 4 Administration & Guard House 30.2)SPP Concept 4 30.3)Structural Drawing (SAC-SBC-ICC-CHP) 30.4)Structural Drawing (CCC-PCC-RCC) 30.5)Specification for Civil 1(SPC) 30.6)Specification for Civil 2 (Poyry) 30.7)M&E Dwg for Non-Admin 30.8)M&E Dwg for Administration 30.9)M&E Specification 30.10)Building Lists
31	Appendix 14 Laboratory Equipment

## ภาคผนวก ข-2

---

สำเนาหนังสือนำเสนอรายงานผลการปฏิบัติตามมาตรการ  
ด้านสิ่งแวดล้อมระหว่างเดือนกรกฎาคม-ธันวาคม พ.ศ. 2566  
(ครั้งที่ 2/2566)



ที่ GCRN O 0124/003



17 มกราคม 2567

เรื่อง ขอนำส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566)

เรียน อธิบดีกรมโรงงานอุตสาหกรรม

สิ่งที่ส่งมาด้วย รายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) จำนวน 1 เล่ม  
และซีดีรอม จำนวน 1 แผ่น

ตามที่คณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการด้านโรงไฟฟ้า  
พลังงานความร้อน ตั้งอยู่ 59/4 หมู่ 4 ถนน 347 ตำบลเชียงรำนน้อย อำเภอสามโคก จังหวัดปทุมธานี ได้เห็นชอบรายงานการ  
วิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าเชิงรำนน้อย ครั้งที่ 1 เมื่อวันที่ 30 กันยายน 2551 ครั้งที่ 2  
เมื่อวันที่ 22 กรกฎาคม 2554 และครั้งที่ 3 เมื่อวันที่ 3 กรกฎาคม 2556 โดยมีเลขที่ใบอนุญาตประกอบกิจการพลังงาน  
เลขที่ กภพ 01-1(2)/56-129 โดยได้กำหนดให้โครงการจะต้องจัดส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม  
ต่อหน่วยงานราชการที่เกี่ยวข้อง เป็นประจำทุก 6 เดือน นั้น

บัดนี้ ทางบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ได้จัดทำรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิง  
รำนน้อย ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) เสร็จสิ้นเป็นที่เรียบร้อยแล้ว ทางบริษัทฯ จึงใคร่ขอนำส่ง  
รายงานดังกล่าวให้กับหน่วยงานของท่านเพื่อพิจารณาต่อไป

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ

ผู้จัดการโรงไฟฟ้า  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

ผู้ประสานงาน นายศักดิ์ชัย โอวาทนุพัฒน์  
โทร 083-7772628

Gulf JP CRN  
Company Limited

8<sup>th</sup> Floor, M.Thai Tower, All Seasons Place,  
87 Wireless Road, Lumpini, Pathumwan,  
Bangkok 10330, Thailand

Tel: +66 2080 4499  
Fax: +66 2080 4455  
www.gulf.co.th



ที่ GCRN O 0124/001

17 มกราคม 2567

เรื่อง ขอนำส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566)

เรียน เลขาธิการสำนักงานคณะกรรมการกำกับกิจการพลังงาน

สำเนาเรียน เลขาธิการสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม

สิ่งที่ส่งมาด้วย รายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) จำนวน 3 เล่ม  
และซีดีรอม จำนวน 3 แผ่น

ตามที่คณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการด้านโรงไฟฟ้า  
พลังงานความร้อน ตั้งอยู่ 59/4 หมู่ 4 ถนน 347 ตำบลเชียงรำนน้อย อำเภอสามโคก จังหวัดปทุมธานี ได้เห็นชอบรายงานการ  
วิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าเชิงรำนน้อย ครั้งที่ 1 เมื่อวันที่ 30 กันยายน 2551 ครั้งที่ 2  
เมื่อวันที่ 22 กรกฎาคม 2554 และครั้งที่ 3 เมื่อวันที่ 3 กรกฎาคม 2556 โดยมีเลขที่ใบอนุญาตประกอบกิจการพลังงาน  
เลขที่ กภพ 01-1(2)/56-129 โดยได้กำหนดให้โครงการจะต้องจัดส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม  
ต่อหน่วยงานราชการที่เกี่ยวข้อง เป็นประจำทุก 6 เดือน นั้น

บัดนี้ ทางบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ได้จัดทำรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อมโรงไฟฟ้าเชิง  
รำนน้อย ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) เสร็จสิ้นเป็นที่เรียบร้อยแล้ว ทางบริษัทฯ จึงใคร่ขอนำส่ง  
รายงานดังกล่าวให้กับหน่วยงานของท่านเพื่อพิจารณาต่อไป

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ

ผู้จัดการโรงไฟฟ้า  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

ผู้ประสานงาน นายศักดิ์ชัย โอวาทนุพัฒน์  
โทร 083-7772628

Gulf JP CRN  
Company Limited

8<sup>th</sup> Floor, M.Thai Tower, All Seasons Place,  
87 Wireless Road, Lumpini, Pathumwan,  
Bangkok 10330, Thailand

Tel: +66 2080 4499  
Fax: +66 2080 4455  
www.gulf.co.th

17 มกราคม 2567

เรื่อง ขอนำส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566)

เรียน อุตสาหกรรมจังหวัดปทุมธานี

สิ่งที่ส่งมาด้วย รายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) จำนวน 1 เล่ม  
และซีดีรอม จำนวน 1 แผ่น

ตามที่คณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการด้านโรงไฟฟ้า  
พลังงานความร้อน ตั้งอยู่ 59/4 หมู่ 4 ถนน 347 ตำบลเชียงรำนน้อย อำเภอสวมโคก จังหวัดปทุมธานี ได้เห็นชอบรายงานการ  
วิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าเชิงรำนน้อย ครั้งที่ 1 เมื่อวันที่ 30 กันยายน 2551 ครั้งที่ 2  
เมื่อวันที่ 22 กรกฎาคม 2554 และครั้งที่ 3 เมื่อวันที่ 3 กรกฎาคม 2556 โดยมีเลขที่ใบอนุญาตประกอบกิจการพลังงาน  
เลขที่ กกพ 01-1(2)/56-129 โดยได้กำหนดให้โครงการจะต้องจัดส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม  
ต่อหน่วยงานราชการที่เกี่ยวข้อง เป็นประจำทุก 6 เดือน นั้น

บัดนี้ ทางบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ได้จัดทำรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิง  
รำนน้อย ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) เสร็จสิ้นเป็นที่เรียบร้อยแล้ว ทางบริษัทฯ จึงใคร่ขอนำส่ง  
รายงานดังกล่าวให้กับหน่วยงานของท่านเพื่อพิจารณาต่อไป

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ

ผู้จัดการโรงไฟฟ้า  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

ได้รับ

ผู้ประสานงาน นายศักดิ์ชัย โอวาทพันธุ์  
โทร 083-7772628

เจ้าพนักงานกมลวิมลและปัญญานายงาน

17/1/67

17 มกราคม 2567

เรื่อง ขอนำส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566)

เรียน ผู้ว่าราชการจังหวัดปทุมธานี

สิ่งที่ส่งมาด้วย รายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิงรำนน้อย  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) จำนวน 1 เล่ม  
และซีดีรอม จำนวน 1 แผ่น

ตามที่คณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการด้านโรงไฟฟ้า  
พลังงานความร้อน ตั้งอยู่ 59/4 หมู่ 4 ถนน 347 ตำบลเชียงรำนน้อย อำเภอสวมโคก จังหวัดปทุมธานี ได้เห็นชอบรายงานการ  
วิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าเชิงรำนน้อย ครั้งที่ 1 เมื่อวันที่ 30 กันยายน 2551 ครั้งที่ 2  
เมื่อวันที่ 22 กรกฎาคม 2554 และครั้งที่ 3 เมื่อวันที่ 3 กรกฎาคม 2556 โดยมีเลขที่ใบอนุญาตประกอบกิจการพลังงาน  
เลขที่ กกพ 01-1(2)/56-129 โดยได้กำหนดให้โครงการจะต้องจัดส่งรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม  
ต่อหน่วยงานราชการที่เกี่ยวข้อง เป็นประจำทุก 6 เดือน นั้น

บัดนี้ ทางบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ได้จัดทำรายงานผลการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม โรงไฟฟ้าเชิง  
รำนน้อย ครั้งที่ 2/2566 (เดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566) เสร็จสิ้นเป็นที่เรียบร้อยแล้ว ทางบริษัทฯ จึงใคร่ขอนำส่ง  
รายงานดังกล่าวให้กับหน่วยงานของท่านเพื่อพิจารณาต่อไป

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ

ผู้จัดการโรงไฟฟ้า  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

ผู้ประสานงาน นายศักดิ์ชัย โอวาทพันธุ์  
โทร 083-7772628

17/1/67

## ภาคผนวก ข-3

---

เอกสารการบำรุง-รักษาระบบหล่อเย็น



## INSPECTION SHEET COOLING TOWER FAN 6 MONTHLY

Plant: 1108  
Functional Location: 10PAB91A1201 (Cell 1)  
Description:  
Brand:  
Model:

Form No. FW-MTH-MM-04-01

Work Permit  
Work Order  
Date  
Time  
Work Supervisor

1108015717  
29/11/2016  
11:08  
Theraporn T

No.	Header	Position	Description	Unit	Criteria	Result	Remark
1.	Inspection sheet for Cooling Tower	CT FAN	CHECK CLEANLINESS BAR SCREEN	VI	CLEAN & DIRTY	✓	
			CHECK DRIVE SHAFT AND COUPLING	VI	BOLT TIGHTEN	✓	
			CHECK GEAR BOX	VI	BOLT TIGHTEN	✓	
			CHECK BREATHER LINE	VI	NO DAMAGE, OVER CORROSION	✓	
			CHECK LOOSEN PART	VI	BOLT TIGHTEN	✓	
2.	MEASURE BEARING TEMP	MOTOR DE	REPLACE LUBE OIL	VI	REPLACE LUBE OIL	✓	Plan 14
			MEASURE MOTOR BEARING	°C		✓	51.1
			MEASURE MOTOR BEARING	°C	NORMAL	✓	
			MEASURE MOTOR BEARING	—	NORMAL	✓	40.4
			MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	2.4
3.	MEASURE BEARING VIBRATION	MOTOR DE	MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.5
			MOTOR BEARING VIBRATION HORIZONTAL	—	NORMAL	✓	1.2
			MOTOR BEARING VIBRATION AXIAL	mm/s	NORMAL	✓	0.4
			MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.4
			MOTOR BEARING VIBRATION HORIZONTAL	mm/s	NORMAL	✓	0.6
		MOTOR NOE	MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.4
			MOTOR BEARING VIBRATION HORIZONTAL	—	NORMAL	✓	0.4
			READ GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	2.4
			READ GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	
			READ GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	

Remarks

Accept by



## INSPECTION SHEET COOLING TOWER FAN 6 MONTHLY

Plant: 1108  
Functional Location: 10PAB92A2001 (Cell 2)  
Description:  
Brand:  
Model:

Form No. FW-MTH-MM-04-01

Work Permit  
Work Order  
Date  
Time  
Work Supervisor

1108015717  
29/11/2016  
11:08  
Theraporn T

No.	Header	Position	Description	Unit	Criteria	Result	Remark
1.	Inspection sheet for Cooling Tower	CT FAN	CHECK CLEANLINESS BAR SCREEN	VI	CLEAN & DIRTY	✓	
			CHECK DRIVE SHAFT AND COUPLING	VI	BOLT TIGHTEN	✓	
			CHECK GEAR BOX	VI	BOLT TIGHTEN	✓	
			CHECK BREATHER LINE	VI	NO DAMAGE, OVER CORROSION	✓	
			CHECK LOOSEN PART	VI	BOLT TIGHTEN	✓	
2.	MEASURE BEARING TEMP	MOTOR DE	REPLACE LUBE OIL	VI	REPLACE LUBE OIL	✓	Plan 14
			MEASURE MOTOR BEARING	°C		✓	54.1
			MEASURE MOTOR BEARING	°C	NORMAL	✓	
			MEASURE MOTOR BEARING	—	NORMAL	✓	20.9
			MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	1.0
3.	MEASURE BEARING VIBRATION	MOTOR DE	MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	1.1
			MOTOR BEARING VIBRATION HORIZONTAL	—	NORMAL	✓	1.4
			MOTOR BEARING VIBRATION AXIAL	mm/s	NORMAL	✓	1.4
			MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	1.1
			MOTOR BEARING VIBRATION HORIZONTAL	mm/s	NORMAL	✓	1.1
		MOTOR NOE	MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.4
			MOTOR BEARING VIBRATION HORIZONTAL	—	NORMAL	✓	0.4
			READ GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	1.4
			READ GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	
			READ GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	

Remarks

Accept by



## INSPECTION SHEET COOLING TOWER FAN 6 MONTHLY

Plant: 1108  
Functional Location: 10PAD93AN001 (ce43)  
Description:  
Brand:  
Model:

Form No. FW-MTN-MMP-04-01

Work Permit  
Work Order  
Date  
Time  
Work Supervisor

110801547  
2024/05/20  
2024/05/20  
17:20:00

No.	Header	Position	Description	Unit	Criteria	Result	Remark
1	Inspection sheet for Cooling Tower	CT FAN	CY BASIN	✓	CLEAN IS DIRTY	✓	
			CHECK DRIVE SHAFT AND COUPLING	✓	BOLT TIGHTEN	✓	
			CHECK GEAR BOX	✓	BOLT TIGHTEN	✓	
			CHECK BREATHING LINE	✓	NO DAMAGE, OVER CORROSION	✓	
			CHECK LOOSE PART	✓	BOLT TIGHTEN	✓	
			REPLACE LUBE OIL	✓	REPLACE LUBE OIL	✓	Plan 14
2	MEASURE BEARING TEMP	MOTOR DE	MEASURE MOTOR BEARING	°C		✓	52.2
		MOTOR HD	MEASURE MOTOR BEARING	°C	NORMAL	✓	42.2
3	MEASURE BEARING VIBRATION	MOTOR DE	MEASURE MOTOR BEARING	mm/s	NORMAL	✓	1.3
			MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.6
			MOTOR BEARING VIBRATION HORIZONTAL	mm/s	NORMAL	✓	1.0
			MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.2
			MOTOR BEARING VIBRATION HORIZONTAL	mm/s	NORMAL	✓	0.6
			MOTOR BEARING VIBRATION AXIAL	mm/s	NORMAL	✓	0.3
		MOTOR HD	MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.6
			MOTOR BEARING VIBRATION HORIZONTAL	mm/s	NORMAL	✓	0.3
			MOTOR BEARING VIBRATION VERTICAL	mm/s	NORMAL	✓	0.6
			MOTOR BEARING VIBRATION HORIZONTAL	mm/s	NORMAL	✓	0.3
			MOTOR BEARING VIBRATION AXIAL	mm/s	NORMAL	✓	2.1
			HEAD GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	
4	GEAR BOX VIBRATION	GEAR BOX	HEAD GEAR BOX VIBRATION (DCS)	mm/s	NORMAL	✓	
Remarks							
Accept by							

## ภาคผนวก ข-4

---

ขั้นตอนการรับเรื่องร้องเรียน และเอกสารสรุปบันทึกการรับ  
ข้อร้องเรียน ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567

### 5. ขั้นตอนการปฏิบัติการ

รายละเอียด	ผู้รับผิดชอบ	เอกสารที่เกี่ยวข้อง
<p>1. การรับข้อร้องเรียนด้านสิ่งแวดล้อม</p> <ul style="list-style-type: none"> <li>พนักงานของโรงไฟฟ้า รับแจ้งและบันทึกข้อร้องเรียนจากบุคคล หรือหน่วยงานภายใน และหน่วยงานภายนอก โดยใช้ “บันทึกการรับข้อร้องเรียน” และส่งให้ EMR พิจารณา</li> <li>พิจารณาข้อร้องเรียนดังกล่าวว่า เป็นข้อร้องเรียนด้านสิ่งแวดล้อม หรือไม่ <ul style="list-style-type: none"> <li>กรณีที่เป็น ให้รายงานต่อผู้แทนฝ่ายบริหาร เพื่อพิจารณาข้อร้องเรียน และปฏิบัติตาม ระเบียบปฏิบัติเรื่อง การแก้ไข และป้องกัน (PD-MRT-03)</li> <li>กรณีที่เป็นข้อร้องเรียนอื่นๆ ที่ไม่ใช่ด้านสิ่งแวดล้อม ให้ผู้จัดการส่วนทรัพยากรบุคคลนำเสนอคณะกรรมการด้านความรับผิดชอบต่อสังคม เพื่อพิจารณาส่งเรื่อง ไปยังผู้จัดการส่วนที่ได้รับข้อร้องเรียน เพื่อดำเนินการหาสาเหตุ แก้ไขและป้องกัน ตามขั้นตอนเกี่ยวกับข้อร้องเรียนด้านสิ่งแวดล้อม (โดยให้คณะกรรมการด้านความรับผิดชอบต่อสังคมทำหน้าที่ในส่วนของผู้แทนฝ่ายบริหาร)</li> </ul> </li> </ul>	<p>EMR / ผู้แทนฝ่ายบริหาร</p> <p>ผู้จัดการส่วนทรัพยากรบุคคล/คณะกรรมการด้านความรับผิดชอบต่อสังคม</p>	<p>บันทึกการรับข้อร้องเรียน</p> <p>FP-EHS-06-01</p> <p>การแก้ไขและป้องกัน</p> <p>PD-MRT-03</p>
<p>2. การดำเนินการหาสาเหตุ และทำการแก้ไขและป้องกัน</p> <ul style="list-style-type: none"> <li>ผู้จัดการส่วนที่ได้รับข้อร้องเรียน พิจารณาข้อร้องเรียนที่ได้รับเพื่อหาสาเหตุ และดำเนินการแก้ไขและป้องกัน (PD-MRT-03)</li> <li>ผู้แทนฝ่ายบริหารหรือผู้ที่ได้รับมอบหมาย ชี้แจงผลการแก้ไข และป้องกัน ปัญหาต่อ ผู้ร้องเรียน และบันทึกผลการชี้แจงลงใน “บันทึกการรับข้อร้องเรียน”</li> <li>หัวหน้าส่วนงาน ส่ง “บันทึกการรับข้อร้องเรียน” ที่บันทึกผลการชี้แจงเรียบร้อยแล้ว ให้ EMR/ผู้แทนฝ่ายบริหารทำ “บัญชีรายการรับข้อร้องเรียน” พร้อมทั้งสรุปผลการปฏิบัติงานเพื่อนำเสนอต่อที่ประชุมทบทวนผู้บริหาร</li> </ul>	<p>ผู้แทนฝ่ายบริหาร / ผู้จัดการส่วน</p>	<p>การแก้ไขและป้องกัน</p> <p>PD-MRT-03</p> <p>บันทึกการรับข้อร้องเรียน</p> <p>FP-EHS-06-01</p> <p>บัญชีรายการรับข้อร้องเรียน</p> <p>FP-EHS-06-02</p>
<p>3. การสื่อสาร</p> <ul style="list-style-type: none"> <li>EHS/ผู้แทนฝ่ายบริหารทำหน้าที่ในการสื่อสารประชาสัมพันธ์กิจกรรม งาน ที่เกี่ยวกับด้านสิ่งแวดล้อม ตามตารางการสื่อสาร</li> <li>EHS/คณะกรรมการด้านความรับผิดชอบต่อสังคมทำหน้าที่ในการสื่อสารประชาสัมพันธ์กิจกรรม งานด้านความรับผิดชอบต่อสังคม ตามตารางการสื่อสาร</li> <li>ในกรณีที่ผู้รับเหมาเข้ามาในบริษัทฯ จะต้องทำการอบรมกฎระเบียบพื้นฐาน ด้านสิ่งแวดล้อม อาชีวอนามัยและความปลอดภัย และความรับผิดชอบต่อสังคม พร้อมทั้งลงทะเบียนผู้เข้ารับการอบรม</li> </ul>	<p>ทุกแผนกที่เกี่ยวข้อง</p>	<p>แบบฟอร์มลงทะเบียนอบรมและประเมินผล</p> <p>FP-EHS-06-03</p>

15 ธันวาคม 2561

15 ธันวาคม 2561

15 ธันวาคม 2561

## ภาคผนวก ข-5

เอกสารการออกแบบระบบการใช้

ก๊าซธรรมชาติเป็นเชื้อเพลิง

## Scope of Supply

**Project Name:** Gulf JP, SPPs in Thailand (SBC)  
**Reference Number:** 8-066-0626  
**Turbine Type:** SGT-800

This Scope of Supply is valid for one (1) SGT-800 Gas turbine unless stated otherwise herein.

## Table of contents

<b>SGT-800 GAS TURBINE, GENERATOR DRIVE.</b>	<b>2</b>
<b>SCOPE OF SUPPLY AND TERMINAL POINTS</b>	<b>2</b>
<b>Part 1 General</b>	<b>2</b>
Basic definition:	2
<b>Part 2 Technical specification</b>	<b>2</b>
Terminal Points to Customer	6
Outlets to Atmosphere.	7
<b>Scope of supply</b>	<b>8</b>
<b>Part 3 Gas turbine - Principal components</b>	<b>8</b>
<b>Part 4 - Auxiliary systems</b>	<b>10</b>
<b>Part 5 - Generator</b>	<b>15</b>
<b>Part 6 - Electrical and control equipment</b>	<b>17</b>
<b>Part 7 - Installation and building</b>	<b>22</b>
<b>Part 8 Inspection, erection, testing and commissioning</b>	<b>24</b>
<b>Part 9 Documentation, operation and maintenance</b>	<b>25</b>
<b>Main exclusions</b>	<b>26</b>

## Scope of Supply

*Comment*

## SGT-800 Gas Turbine, Generator Drive.

## Scope of Supply and Terminal Points

### Part 1 General

#### Basic definition:

This Scope of supply forms a functioning unit within the terminal points (utilities/consumables such as auxiliary power, fuel, water, wash detergent, instrument air, lubricating oil and grease are excluded). Alternative configurations are available.

### Part 2 Technical specification

#### Application

- 1 x SGT-800, Onshore (equipment delivery)

#### Operating mode

- Continuous base load

#### Units

- SI-units

#### Design conditions

- +8 to +40°C ambient temperature.
- Moderate dust loading

#### Installation

- Outdoor

#### Wind speed and seismic zone

- <= 40 m/s and UBC code (1997) zone 1, S3 (foundation not considered)

#### Site handling forces

**Scope of Supply****Comment**

- Site 0.5 x g in any horizontal direction and 0.5 x g in vertical direction.

**Area classification**

- Safe area

**Surface treatment**

- Onshore, Corrosivity category C4 high. The internal equipment and the generator are treated for corrosivity category C2.
- Corrosivity factors according to ISO 12944.

**Design sound level**

- 85 dB(A) near field at 1 m distance (outside the GT enclosure wall and 1.5 m above ground level). Measured according to ISO 3746-1995.

**Combustion chamber**

- Dry Low Emission system

**Fuel**

- Gas fuel, fulfilling Supplier gas fuel specifications X241010E/1CS26810

**Lubricating oil cooling**

- Water (water / antifreeze fluid TEMPER or equivalent), cooling media, supply temperature <+40 °C

**Generator cooling / protection form**

- Cooling/protection form: IC8 A1 W7/IP54
- Cooling water temperature to generator, ambient air temperature plus max 10 deg. C.

**Generating voltage / frequency**

- 11.0 kV / 50 Hz

**Auxiliary voltages, frequency and standards for motors**

- 400 VAC, 50 Hz, (TN-C-S system) start motor 690 VAC, 3-phase. 230 VAC UPS. Standards: EN/IEC.

**Emergency battery voltage**

- 440 VDC

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01. General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment****Shutdown system**

- " 1 out of 2" and "1 out of 1"

**Control system**

- Simatic providing a fully automatic unit.

**Vibration probes**

- Vibration transducers (accelerometer type).

**Designation system**

- German based KKS tag number system. The components are identified in a hierarchical system according to the functional placement in the plant.

**Codes and standards**

- Drawings: ISO5457-1980
- Noise emissions: ISO3746-1995 and ANSI S 12.36
- Exhaust emissions: ISO9096-1992 and ISO10849-1996
- Pressure vessels in auxiliary systems: ASME Section VIII (excl. U-stamp).
- CO2 bottles: European Directive 1999/36/EC, on-skid/off-skid
- Pipe fittings: DIN or ANSI, on-skid/off-skid
- Package piping: EN13480
- Interconnecting piping: EN13480 or ASME B31.3 for main gas fuel piping.
- Structural steel: UBC-97 with exception for use of European standards.
- Terminal point flanges: ANSI (fuel systems)
- Pipe coupling threads: ISO 228:1-1994 and SMS 2165
- Fire extinguishing (design): ISO6183:1990 with clarifications
- Gas detection: IEC/EN 50018 Explosion group IIC (zone 1)
- Gas fuel system: Siemens design
- Pumps: DIN and/or ISO
- Bolts/nuts: DIN
- Vibration: ISO10816-4, 1998
- Gear: AGMA 421.06
- Generator: IEC/EN60034-1

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01. General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment**

- MCC: IEC/EN60439 part1,  
IEC/EN60529, IEC/EN60947 part  
2, 3 and 4-1
- Control cubicles: IEC/EN60439 part1,  
IEC/EN60529, IEC/EN60947 part  
2, 3 and 4-1
- Control system: IEC/EN61000-6-4,  
IEC/EN61000-6-2, IEC/EN60068  
part 2, IEC/EN60439-1,  
IEC/EN60950, IEC/EN61010-1
- Power cables: IEC/EN60227, IEC/EN60228,  
IEC/EN60331, IEC/EN60332,  
IEC/EN60502, IEC/EN60811
- Control cables: IEC/EN60227, IEC/EN60228,  
IEC/EN60331, IEC/EN60332,  
IEC/EN60502-1
- Cables joints of MM-  
type: IEC EN50262
- Frequency converters: EN60204 part 1, EN60529,  
EN61800 part 3.
- Other electrical  
equipment: Applicable IEC/EN-code
- Enclosure and base  
frame: BSK-1994 (corresponding to  
ISO2394-1986)
- Balancing: ISO 1940-1 and ISO 11342-1998
- Lubricating oil system: API 614 with E & C
- Gas turbine: API 616 with E & C
- Vibration monitoring: API 670 with E & C
- Welding procedures: EN 287/288 or ASME IV

**Enclosure**

- For the Gas Turbine, speed reduction gear and the  
auxiliaries. Protective roof over generator.

**Electrical and control modules**

- Electrical and control module
- Battery module

**Exhaust direction from the Gas Turbine outlet**

- Horizontal, axial

**Maintenance opening**

- Left side (looking from the exhaust towards the air inlet)

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01. General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment****Delivery**

- DES port of Thailand (INCOTERMS 2000)

**Terminal Points to Customer**

For data at the terminal points, please refer to separate  
document.

**X2201200E**

431

**Gas Fuel System**

- Gas fuel connection, at the gas isolation valve located outside  
GT package, auxiliary skid side acc. to the layout drawing.

442

**Cooling Water System**

- Incoming/outgoing water connection flanges for water cooled  
lube oil cooler located close to the auxiliary skid.
- Incoming/outgoing water connection flanges on generator  
coolers.

482

**Instrument Air**

- Connection located at the GT enclosure wall (auxiliary skid  
side) for the GTG set.

491

**Drains**

- Connection for emptying of the intermediate drain tank  
located at the enclosure wall, maintenance door side.

590

**Medium Voltage**

- Generator main connection (11kV) at terminals located inside  
the Generator MV terminal box (HIGS). Cable connection  
from below.
- Auxiliary feeder connection (11kV) at terminals located  
inside the Generator MV terminal box (HIGS). Cable  
connection from below.
- Starting transformer terminals (6,6 kV)

626

**Auxiliary Power**

- Terminals on motors and heaters
- 690V terminals on starting transformer.
- Terminals in electrical panels.

630

**Control & Instrumentation**

- Terminals in control panels.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01. General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment**

- Terminals on starting transformer.

684

**Grounding**

- Grounding connections on delivered equipment.

720

**Interface to Foundation**

- Lower end of multi point support for the GT and driven equipment
- Lower end of the support structures for:
  - Air intake system.
  - 1x100% watercooled cooler for the lubricating oil system.
  - Gas filter skid for gas fuel system
  - Ventilation system GT
  - Electric start and barring motor
  - Electrical and control module
  - Battery module
  - Starting transformer.
  - Central fire suppression unit.

740

**Exhaust system**

- Exhaust system not included. Delivery limit is the exhaust gas diffuser flange.

**2030040****Outlets to Atmosphere.**

For data at the outlet points, please refer to separate document.

**X2201200E**

410

**Lubricating oil**

- Outlet from lubricating oil system ventilation fan, located on the GT enclosure roof.

423

**Ventilation**

- Outlet from the GT enclosure to atmosphere, downstream the weather louvers

431

**Gas fuel system**

- Gas fuel ventilation, located above the GT enclosure roof.

740

**Gas Turbine exhaust**

- Exhaust gas from the Gas Turbine downstream the delivery limit other than the stack.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01\_General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment****Scope of supply****Part 3 Gas turbine - Principal components**

300

**Industrial design, single shaft with modular concept:**

- Compressor inlet casing and inlet bellmouth casing.
- Thrust bearing #1 (tilting pad, directed mineral oil lubrication) combined with radial journal bearing #1 (tilting pad, directed mineral oil lubrication), located in the inlet bellmouth casing.
- 15-stage axial flow compressor with 3 rows of variable guide vanes (AC servo motor driven), electron-beam welded compressor rotor, inner stator casing with vane carriers forming air flow path, vertically split outer casing
- 2 bleed valves (pneumatically actuated) for air bleed during start-up and shutdown.
- Central casing with diffuser for compressor discharge air.
- High energy spark plug for cross-ignition during engine start-up.
- 3rd generation DLE system with annular combustion chamber, 30 burners and 2 optical flame detectors.
- 3-stage bladed turbine rotor, connected to the intermediate shaft by tie-bolts.
- Turbine casing with gas flow path and 3 stages of turbine guide vanes.
- Radial journal bearing #2 (directed mineral oil lubrication), located in the turbine exhaust diffuser casing.
- Turbine exhaust casing with exhaust diffuser.
- Drain valves (manually operated) from compressor inlet plenum, compressor bleed cavities #1 & #2, central casing and exhaust casing.
- Bently Nevada, accelerometer type, vibration probe: 1 off in bearing #1 and 1 off in bearing #2

330

**Speed reduction gear (6600/1500 rpm), double helical design.**

- High speed side, quillshaft connection to the gas turbine.
- Low speed side, quillshaft connection to the generator.
- Free wheel clutch (SSS-type) for connection of electric start and barring motor
- 4 journal bearings of sleeve type for mineral oil lubrication.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01\_General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment**

- 1 temperature transducer in each of the four bearings
- 1 BN, accelerometer type, vibration probe located on the casing at the high speed (pinion) turbine side.
- 1 BN, accelerometer type, vibration probe located on the casing at the low speed shaft (wheel) turbine side

**Mounting details**

- Pendelum supports, spring loaded supports, fix point support and side support for the gas turbine, down to the main baseframe. Supports for the diffuser, down to the foundation.

**Turbine base frame**

- Welded I-beam baseframe for the GT driver unit

**Insulation**

- Insulation of the Gas Turbine (including exhaust casing) for personnel safety, heat and noise reduction.

**Scope of Supply****Comment****Part 4 - Auxiliary systems**

Some auxiliary systems and parts of the control system are mounted on a separate skid located side by side with the GT unit. See layout and General Arrangement drawings.

**Instrumentation**

- Instrumentation pipes, instrument valves and fittings in 316L stainless steel

**Cooling & Sealing air system**

- Extraction from compressor stage #3 for external turbine stator cooling and sealing air around bearing #2 during operation, including temperature measurement, strainer with diff. pressure transmitter, butterfly valve and orifice.
- Extraction from compressor stage #5 for bleed to exhaust, external turbine stator cooling and sealing air around bearing #2 during start-up and shutdown - and cooling to turbine stator stage #3 during start-up and shutdown, including temperature measurement, strainer with diff. pressure transmitter, butterfly valve, orifice and bleed valve.
- Extraction from compressor stage #10 for bleed to exhaust during start-up and shutdown - and cooling of turbine stator stage #2 and air supply to the balance piston during start-up, operation and shutdown, including temperature measurement, strainer with diff. pressure transmitter, butterfly valve, orifice and bleed valve.
- Instruments and components for cooling and sealing air system

**Electric Start & Barring system**

- Static Frequency Converter (SFC).
  - Electric start and barring motor.
  - Driver shaft of flexible type, steel plate coupling.
  - Emergency barring system (Geared AC motor, 400VAC, on main gearbox).
- The arrangement is based on that the 400VAC emergency services board supplies power to each GT MCC in case of AC failure. A capacity of 80 -100 kW is sufficient to keep one (1) GT-set start prepared in case of a power plant black-out.

**Scope of Supply****Comment**

410

- Instruments and Components for Electric Starting & Barring system

**Lubricating Oil System designed for ISOVG46 mineral oil fulfilling Supplier specification 8121-09**

- Covering:
  - The Gas Turbine
  - The Speed Reduction Gear
  - The Generator
  - Start and barring motor.
- Carbon steel lube oil tank with 2 heaters.
- Supply piping for the lube oil system in carbon steel, stainless steel downstream the filter to the GT.
- Discharge piping in stainless steel.
- Pumps and fan with redundant power supply.
  - 3 x 80% AC motor driven centrifugal type pumps (2 in operation and 1 in stand-by mode). The pumps are normally utilised to 2 x 50% but the SFC's and motors are designed to increase the capacity of the pumps during transfer from the operational to the stand-by pump.
  - 2 x 100 % AC motor driven oil system ventilation fan.
  - Oil system ventilation filter with filter housing in stainless steel

Each pump and the fan is driven by a Static Frequency Converter. DC back-up is provided on each pump and the fan by the 440VDC battery feed to the SFCs.

- 1 x 100 % water cooled lube oil cooler (plate type) designed for +40°C cooling media inlet temperature, including lube oil piping
- 2 x 100 % lube oil filter with delta P transmitter.
- Instruments and Components for standard Lubricating Oil system.

422

**Fire Extinguishing System, CO2**

- Fire detection and extinguishing system for the GT enclosure.
- 1 x 100 % discharge for fire protection as above.
- Piping, valves and nozzles.
- 10 IR detectors, 6 heat detectors covering the gas turbine and auxiliaries located inside the GT enclosure.
- 2 warning lights flashing red, located outside the GT enclosure.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01. General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment**

423

- 2 acoustic alarms (one CO2 driven and one electrically driven), located inside the GT enclosure
- 1 CO2 released status light, 1 CO2 blocked status light and a manual release button, located outside each normal entrance door to the GT enclosure.
- Central fire suppression unit. The central unit is connected to the control system for alarm annunciation.
- Instruments and Components for standard Fire Extinguishing system.

**Ventilation system**

- Weather louvers at the ventilation inlet and outlet of the GT enclosure.
- Silencers as required for the specified sound level, on ventilation inlet and outlet of the GT enclosure.
- 1 stage air filter (barrier type, disposable) for the GT enclosure.
- Shut off fire dampers on the ventilation inlet and the ventilation outlet of the GT enclosure.
- 2 x 100 % AC driven fan placed in the ventilation outlet of the GT enclosure, i.e. GT enclosure subatmospheric pressure.
- Air conditioning unit (1x100%) for the electrical and control module.
- Ventilation ducts in Carbon steel.

424

**Gas detection system**

- 2 semi-conductor gas detectors, located in the ventilation outlet from the GT enclosure (one in low position and one in high position).
- The detectors are connected to the GT control system via the gas detection central unit. Each gas detector has an alarm and an engine shutdown level.

431

**Gas Fuel System**

- Gas fuel unit
- Manual isolation valve
- Gas isolation valve (spring closing, pneumatically operated).
- Strainer, mesh size 200, with local diff. pressure indicator.
- Stainless steel piping downstream strainer.
- Two quick shut-off valves in series (spring closing, pneumatically operated).
- Ventilation valve between the quick shut-off valve.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01. General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment**

- Ventilation valve between the isolation valve and the first quick shut-off valve
- Gas control valve ( AC-servo motor operated) with position feedback, for the 2 pilot gas manifolds.
- 2 pilot gas manifolds with 18 and 12 connection points respectively from each manifold to the 30 burners.
- 1 main gas manifold with 30 connection points to the 30 burners.
- Gas control valve (AC-servo motor operated) with position feedback, for main gas manifold.
- Gas control valve (pneumatic positioner) with position feedback, for central gas manifold..
- 1 central gas manifold with 30 connection points to the 30 burners.
- All piping in gas fuel unit and internal GT-skid piping in stainless steel
- Ventilation lines to atmosphere, standard location above the air intake filter.

439

**Ignition System**

- Piping for natural gas supply from the gas fuel system to burner #26 during startup.
- Shut-off and vent valves (spring closing, pneumatically operated).
- High energy spark plug for cross-ignition (see Item 300)

442

**Cooling water system**

- Terminal point at the lube oil cooler.
- Terminal point on the generator coolers

482

**Instrument air system**

- Internal piping in stainless steel.
- Last chance coalescer filter (0,01 micrometer)
- Instrument air supply by customer.

491

**Compressor washing system**

- Washing unit for compressor washing, consisting of:
  - Water tank with heater, level gauge and temperature gauge. Volyme 80L.
  - Detergent tank with heater, level gauge and temp. gauge. Volyme 80L.
  - Filter.
  - AC driven pump (reciprocating type).

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01. General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment**

- Pressure regulating valve and pressure gauge.
- Piping, inlet manifold and injection nozzles for offline washing.
- 7 manually operated drain valves with piping, to common location at skid edge via the internal drain tank. from the Gas Turbine.
- Internal, intermediate, drain tank including drain pump and level switch. Volyme app. 100L.
- Instrumentation and piping according to P&ID
- Equipment acc. to "Safe area" area classification.

493

**Drying system**

- Dehumidifier for engine dry out, during shut down periods. Automatic start after completed barring.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01. General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply***Comment***Part 5 - Generator**

501

**Generator type AMS 1250 A LF****3BSM006990\_A**

56,25 MVA at 35°C cooling water temperature and P.F. 0.8.

- Frequency / speed / voltage : 50 Hz / 1500 RPM / 11 kV. Standards, IEC.
- Four pole (salient) three phase synchronous generator.
- Cooling form: IC8 A1W7.
- Brushless AC-exciter with rotating rectifier.
- PMG for excitation power supply.
- Insulation according to class F.
- Temperature rise at rated output and P.F. 0.8 within class B absolute according to § 16.3.4 of IEC 34-1 within the ambient temperature range.
- Temperature monitoring by RTD.
- Vibration monitoring by accelerometers.
- Lube oil supply from the turbine system.
- Line and neutral side termination points for MV terminal enclosure.
- Anti condensation heaters in the main machine, exciter and MV terminal box.
- Separate junction boxes for instruments, excitation and heaters.

580

**Excitation and voltage regulator system**

- Dual channel Automatic Voltage Regulator (AVR) including:
- Automatic Voltage Regulator (AVR)
- Built in DC-chopper for regulation of field current
- Power factor control.
- Reactive power control.
- Excitation current limiter with cooling air bias.
- Stator current limiter with cooling air bias
- Under excitation limiter

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01. General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply***Comment*

- Power System Stabilizer  
note: This extra feature will have a basic default setting when delivered. The price quoted excludes time for setting and commissioning the equipment if required on site. The time is further excluded from the 105MW erection and commissioning TFA time provided in the onshore contract and would be payable separately against daily rates.

591

**Higs - Line and neutral cubicle****SLD X501234E**

Highly integrated generator breaker solution. The breaker is directly attached to the generator. Generator neutral, generator circuit breaker, all measuring transformers and earthing switches are included in one unit. The attached control cubicle contains the generator control unit (AVR) and all control equipment necessary for operation in local or remote position where applicable.

- Rated voltage level 12kV, 50Hz
- Basic Insulation Level 75kV
- Rated current 4000A
- Rated Short circuit time withstand current 50 kA, 1 sec
- Neutral Point Resistor 10A,10s.
- Degree of protection: IP54

**Auxiliary transformer compartment**

- Vacuum circuit breaker and disconnecter for outgoing feeder for auxiliary transformer.
- Circuit Breaker 1250A / 63 kA
- Protection relays and remote control is not included

**DC control power**

- Rectifier for internal control power 240VAC//110VDC.

**Main Connection**

- Cable/busbar connection from below. No static load is allowed on the connection bus.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01. General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply***Comment***Part 6 - Electrical and control equipment**

600

**Electrical auxiliary systems**

Electrical auxiliary systems as specified below:

**SLD X620628E**

626

**Motor Control Centre**

Siemens MCC board, Isc=50kA.

Supplies all consumers (except starting system) within the scope of supply and is provided with:

- Fixed mounted circuit breaker incomer.
- Fixed mounted fuseless motor starters and MCCB feeders.
- Dual redundant incomers with automatic transfer.

Protection class IP30.

625

**UMD (Uninterrupted Motor Drive) and UPS (Uninterrupted Power Supply) systems**

The system provides uninterrupted AC and back-up DC power to the AC motor driven lube oil pumps and the oil ventilation fan(s) of the turbine package.

A UPS supply unit (static frequency converter, sine filter and transformer) and a UPS distribution board for supply of the I&amp;C equipment of the turbine is as well integrated within the free standing panel arrangement.

A common battery supply DC power to the UMD and UPS system. (Only to UMD system when UPS supply is provided by others.)

The system is completely self contained and is designed with protection class IP21, (IP20 internally).

The panel arrangement mainly contains the following equipment:

- One AC power distribution board with MCCB breakers supplying the frequency converters, and the battery charger.
- One DC power distribution board with MCCB breakers supplying the frequency converters.
- Static frequency converters for the lube oil pumps and the oil ventilation fan(s).
- Static frequency converter for UPS supply. One hour autonomy time.
- MCB distribution board for I&C equipment. Fed from UPS supply.
- Battery charger, 440 VDC.
- PLC based emergency back-up operation system.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01\_General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply***Comment***Common UMD and UPS battery**

Capacity for one hour with UPS system load and a complete 10h emergency cool down cycle.

629

**Starting transformer**

- Dry insulated, cast resin epoxy type transformer with transformer enclosure.
- Protection class IP54
- 6,6 +- 2 x 2,5% / 0,69 kV, 50 Hz.

629

**Frequency converter(s).**

- Starting frequency converter, Siemens Sinamics S120, 690VAC 50/60 Hz supply, protection class IP21.

630

**Control equipment for automatic start-up, operation and shut down.**

Micro Processor based control, supervision and protection system with a PC based operators station. The system is designed for highest possible operators friendliness with colour process graphics, log and alarm /event displays, printer for lists and hardcopies from the screen. The system has various openings to external computer systems. The system program provided is in the US English language.

PCS7 license for control system programming included in operator station. (At deliveries of more than one GT at the same installation, the tool is common for all GT units).

The following division of functionality described below constitutes the turbine control system:

634

**Operators station**

PC based (Windows XP) operators interface, Simatic WinCC with necessary software to operate the GT in all operation modes. Rack type computer with redundant Hot-Swop, RAID controllers.

The PC based operators interface consists of:

- Rack mounted turbine HMI with 19 inch TFT screen, keyboard, mouse and laser colour printer.
- Additional remote desk mounted turbine HMI with 21 inch TFT screen, keyboard and mouse
- Ethernet interface to turbine controllers

**Common for 2 GTs  
(X630730E)**

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP -  
Thailand\Tender documents\File version\01\_General &  
Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope  
of Supply and Terminal Points (SBC).doc

**Scope of Supply****Comment**

The OS station performs apart from providing normal operators dialogue:

- Trending and storing of process parameters.
- Self diagnostics and displays of system and individual board status.

Other indicators:

- Start counter.
- Operating, equivalent operating hour and cycle counter.

635

**Main process controller Simatic AS400**

The main Simatic controller contain system and application programs to perform both open and closed loop control in order to run the turbogenerator set. The programs are battery backed up for appr. 2 month.. The main tasks of the AS400 controller are:

- Analogue and Binary I/O handling.
- Sequencer for start and stop.
- Gas turbine set monitoring.
- Frequency/load control.
- Gas turbine speed and temperature control.
- Gas turbine acceleration and deceleration control.

631

**Unit protection system**

The unit protection system is built up around one fail safe controller (AS400-F), proven according to IEC61508. All trip signals works with the principle of “fail safe”, i.e. signal loss generates a turbine trip.

The following signals are duplicated and works with the “1 out of 2” principle:

- Turbine overspeed.
- Flame supervision.
- Purge time monitoring.
- Ignition failure.
- High exhaust gas temperature.
- Low lubrication oil pressure.
- High lubrication oil temperature.

All protection system actions are registered and informed to the operator on the main operators station.

**Scope of Supply****Comment**

630

**Communication, Hardwired interface**

I/O interface in turbine control system for signal interfacing with control and monitoring system for plant provided by others.

- 10 Digital inputs, 24VDC
- 10 Digital outputs (potential free relay contacts)
- 5 analog signals
- One signal to the safety system

631

**Generator protection system**

Protection system Siemens Siprotec 4. Protection functions as indicated below.

**SLD X501234E**

	IEEE-code(Sub)
– Differential protection	87G
– Stator earthfault protection	59N
– Voltage restraint over current protection	51V
– Under impedance protection (zone 1)	21
– Negative sequence protection	46
– Under excitation protection	40
– Over/under voltage protection	59/27
– Reverse power protection	32
– Rotating diode fault protection	58*
– Breaker Failure	50BF
– Frequency protection	81

\*) AVR system function

639

**Synchronising equipment**

Automatic and manual (semiautomatic) synchronising system for two circuit breakers, the Generator Circuit Breaker (GCB) and one additional breaker. The system is provided with a "Synchronising by-pass" switch for breaker closing against a "dead bus".

630

**Additional included features for the control system**

- Optical interconnection of two control systems (no cable included) for common access to GT units on the same control network
- Modbus serial link and modem with standard scope of signals for communication with external computer system

---

**Scope of Supply**

---

**Comment**

- Hot replacement of I/O modules
- Interface for IRIG-B (client to connect to terminals in gas turbine control module) to be used for common time system
- PCS7 programming license included in operator station

**Common for 2 GTs****Common for 2 GTs****Electrical installation**

- Control and instrumentation cables on the turbine and auxiliary systems skid.

---

**Scope of Supply**

---

**Comment****Part 7 - Installation and building**

710

**Enclosure**

- Weatherproof, outdoor:
  - Acoustic enclosure for the Gas Turbine Generating set including the speed reduction gear. Weather roof over Electric Generator.
  - Complete with access doors, emergency doors, walkways, stairs, internal lighting and a 8 tonnes maintenance overhead crane in the GT enclosure.

711

**Electrical and control equipment modules**

- Control room;
  - Operators station
  - Control panels.
  - MCC
  - Starting frequency converter
  - Lube oil drive system
  - Emergency back-up battery
  - UPS-unit for turbine controls
  - Fire fighting panel
  - Servo Motor Drivers
- Battery room;
  - Emergency batteries

The modules are provided with internal lighting, heating and air conditioning systems. Systems are tested together with the GT and auxiliary systems (factory tests).

720

**Foundation**

- Outline drawing of the foundation with static and dynamic loads
- Embedded steel plates
- Necessary fasteners to attach included units and equipment to foundation according to valid drawings.

731

**Static air intake system**

- Double sided filter house with disposable 1st and 2nd stage filter. Pre filter class F7, high efficiency filter class H10 (HEPA).
- Ducting for standard outdoor installation with support structure.
- Acoustic-lined duct and silencer for the air intake
- Hoist for filter replacement, hand operated.

Scope of Supply

740

Exhaust gas system

- Insulated exhaust duct (horisontal, axial outlet).

Comment

Scope of Supply

Part 8 Inspection, erection, testing and  
commissioning

810

Transport

- Packaging for sea transport
- Packing for 3 months storage
- Delivery DES port of Thailand, acc. to INCOTERMS 2000.
- The tools for on/off loading during transport and erection period  
are property of Siemens.
- Weatherproof transport/storage cover for main machinery unit  
and auxiliary unit.

820

Inspection

- Quality control acc. to standard Inspection Plan
- Witness point for routine test, Electric Generator (To be agreed)
- Shipment release inspection (To be agreed)

830

Maintenance tools

- GT-tools for A-inspection
- GT-tools for B-, C- and D-inspection.
- Generator maintenance tools
  - Rotor removal rooling tool
  - Service crane
  - Exciter removal tools
  - Generator roll out support.

One set (total 4 sets for 7  
sites)

One set (total 4 sets for 7  
sites)

852

Factory tests

- Balancing and overspeeding of the turbine and generator rotors.
- Standard Gear test at the subsupplier's workshop
- Standard Electric generator routine test at the subsupplier's  
workshop
- Stationary testing:
  - System tests of the assembled equipment, including sequence  
test up to GT ignition (without engine rotation), with contract  
auxilliary systems and contract control equipment available  
at workshop test.

**Scope of Supply***Comment***Part 9 Documentation, operation and maintenance**

940

**Spare parts**

- Operation consumables for 2 years operation
- Operation back-up parts

**One set** (total 4 sets for 7 sites)

980

**Documentation**

The Documentation is divided into five blocks 1, 2, 3, 4 (Operation and Maintenance) and 5 (Quality Documentation). All documentation, with the exception of block 5 is delivered on CD/DVD-ROM. The application uses a standard HTML web-browser and Acrobat Reader.

In addition to the CD/DVD-ROM, copies in paper format will be delivered as well according to the Scope below for the Operation and Maintenance documentation.

**1. Documentation overview.**

This is an introduction to the Operation & Maintenance documentation structure and comprises key information on how to recognize and find the appropriate documents and how to understand the typical symbols used.

- 1 Documentation overview.

**2. Operation & Maintenance Instructions.**

This block serves as the instruction for operation of the gas turbine package and as well as handling the unit in emergencies. The System Descriptions and the System (P&I) Diagrams form an appropriate level of information for understanding the basic systems design and operation. This block also contains instructions for scheduled preventive maintenance.

- 2A Operation instruction, including control system operator interface
- 2B Fault procedures.
- 2C System descriptions
- 2D System (P&I) Descriptions
- 2E Setting list, Electrical load list, Aggregate list and Instrument list.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01\_General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

**Scope of Supply***Comment*

- 2F Maintenance documentation.

**3. Maintenance and Technical Documentation.**

The Technical Documentation contains detailed technical information, mainly intended for the maintenance personnel. The documentation is divided into Electrical-, Control- and Building Items.

- 3A Control documentation.
- 3B Electrical documentation.
- 3C Installation documentation (if applicable)
- 3D Building documentation (if applicable)

**4. Component Documentation.**

The Component Documentation mainly consists of Technical documentation and a limited part of Operation and maintenance documentation.

- 4A Control Components
- 4B Electrical Components
- 4C Mechanical Components

**5. Manufacturing Record Book**

The Manufacturing Record Book includes inspection plans and different types of certificates for the electrical and mechanical equipment.

- Test and inspection documentation.

**Language and number of binders per GT:**

- Documentation language is English
- 2 copies of Electronic documentation (DVD)
- 1 copies of binders for block 1, 2 and 3
- 1 copies of binders for block 5.

**Main exclusions**

- Supply of auxiliary power
- Drain from terminal point
- MV connection (cabling or busduct) between the generator circuit breaker and the step-up transformer.

Siemens Industrial Turbomachinery AB

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01\_General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

## Scope of Supply

---

### Comment

- LV power cables, installation materials and installation external of the GTG package.
- Signal and control cables, installation materials and installation external of the GTG package.
- Earthing network external to GTG set
- Lightning protecting
- All civil works including foundations
- Counterflanges, gaskets and bolts at terminal points - if not specifically agreed in final scope of supply.
- Exhaust system downstream the GT exhaust diffuser flange. The equipment downstream the GT exhaust diffuser flange must be designed and manufactured to meet the overall plant noise requirements.
- On-line washing
- Instrument air compressor
- External gas receiving /pressure control system
- External gas treatment

Project Name: Gulf JP, SPPs in Thailand (CCC)

Reference Number: 8-066-0626

Turbine Type: SGT-800

This Scope of Supply is valid for one (1) SGT-800 Gas turbine unless stated otherwise herein.

## Table of contents

SGT-800 GAS TURBINE, GENERATOR DRIVE.	2
SCOPE OF SUPPLY AND TERMINAL POINTS	2
Part 1 General	2
Basic definition:	2
Part 2 Technical specification	2
Terminal Points to Customer	5
Outlets to Atmosphere.	7
Scope of supply	8
Part 3 Gas turbine - Principal components	8
Part 4 - Auxiliary systems	10
Part 5 - Generator	15
Part 6 - Electrical and control equipment	17
Part 7 - Installation and building	22
Part 8 Inspection, erection, testing and commissioning	24
Part 9 Documentation, operation and maintenance	25
Main exclusions	26

Comment

## SGT-800 Gas Turbine, Generator Drive.

## Scope of Supply and Terminal Points

## Part 1 General

## Basic definition:

This Scope of supply forms a functioning unit within the terminal points (utilities/consumables such as auxiliary power, fuel, water, wash detergent, instrument air, lubricating oil and grease are excluded). Alternative configurations are available.

## Part 2 Technical specification

## Application

- 1 x SGT-800, Onshore (equipment delivery)

## Operating mode

- Continuous base load

## Units

- SI-units

## Design conditions

- +8 to +40°C ambient temperature.
- Moderate dust loading

## Installation

- Outdoor

## Wind speed and seismic zone

- $\leq 40$  m/s and UBC code (1997) zone 1, S3 (foundation not considered)

## Site handling forces

- Site 0.5 x g in any horizontal direction and 0.5 x g in vertical direction.

## Comment

**Area classification**

- Safe area

**Surface treatment**

- Onshore, Corrosivity category C4 high. The internal equipment and the generator are treated for corrosivity category C2.
- Corrosivity factors according to ISO 12944.

**Design sound level**

- 85 dB(A) near field at 1 m distance (outside the GT enclosure wall and 1.5 m above ground level). Measured according to ISO 3746-1995.

**Combustion chamber**

- Dry Low Emission system

**Fuel**

- Gas fuel, fulfilling Supplier gas fuel specifications X241010E/1CS26810

**Lubricating oil cooling**

- Water (water / antifreeze fluid TEMPER or equivalent), cooling media, supply temperature <+40 °C

**Generator cooling / protection form**

- Cooling/protection form: IC8 A1 W7/IP54
- Cooling water temperature to generator, ambient air temperature plus max 10 deg. C.

**Generating voltage / frequency**

- 11.0 kV / 50 Hz

**Auxiliary voltages, frequency and standards for motors**

- 400 VAC, 50 Hz, (TN-C-S system) start motor 690 VAC, 3-phase. 230 VAC UPS. Standards: EN/IEC.

**Emergency battery voltage**

- 440 VDC

**Shutdown system**

- " 1 out of 2" and "1 out of 1"

## Comment

**Control system**

- Simatic providing a fully automatic unit.

**Vibration probes**

- Vibration transducers (accelerometer type).

**Designation system**

- German based KKS tag number system. The components are identified in a hierarchical system according to the functional placement in the plant.

**Codes and standards**

- Drawings: ISO5457-1980
- Noise emissions: ISO3746-1995 and ANSI S 12.36
- Exhaust emissions: ISO9096-1992 and ISO10849-1996
- Pressure vessels in auxiliary systems: ASME Section VIII (excl. U-stamp).
- CO2 bottles: European Directive 1999/36/EC, on-skid/off-skid
- Pipe fittings: DIN or ANSI, on-skid/off-skid
- Package piping: EN13480
- Interconnecting piping: EN13480 or ASME B31.3 for main gas fuel piping.
- Structural steel: UBC-97 with exception for use of European standards.
- Terminal point flanges: ANSI (fuel systems)
- Pipe coupling threads: ISO 228:1-1994 and SMS 2165
- Fire extinguishing (design): ISO6183:1990 with clarifications
- Gas detection: IEC/EN 50018 Explosion group IIC (zone 1)
- Gas fuel system: Siemens design
- Pumps: DIN and/or ISO
- Bolts/nuts: DIN
- Vibration: ISO10816-4, 1998
- Gear: AGMA 421.06
- Generator: IEC/EN60034
- MCC: IEC/EN60439 part1, IEC/EN60529, IEC/EN60947 part 2, 3 and 4-1
- Control cubicles: IEC/EN60439 part1, IEC/EN60529, IEC/EN60947 part 2, 3 and 4-1

## Scope of Supply

## Comment

- Control system: IEC/EN61000-6-4,  
IEC/EN61000-6-2, IEC/EN60068  
part 2, IEC/EN60439-1,  
IEC/EN60950, IEC/EN61010-1
- Power cables: IEC/EN60227, IEC/EN60228,  
IEC/EN60331, IEC/EN60332,  
IEC/EN60502, IEC/EN60811
- Control cables: IEC/EN60227, IEC/EN60228,  
IEC/EN60331, IEC/EN60332,  
IEC/EN60502-1
- Cables joints of MM-  
type: IEC EN50262
- Frequency converters: EN60204 part 1, EN60529,  
EN61800 part 3.
- Other electrical  
equipment: Applicable IEC/EN-code
- Enclosure and base  
frame: BSK-1994 (corresponding to  
ISO2394-1986)
- Balancing: ISO 1940-1 and ISO 11342-1998
- Lubricating oil system: API 614 with E & C
- Gas turbine: API 616 with E & C
- Vibration monitoring: API 670 with E & C
- Welding procedures: EN 287/288 or ASME IV

**Enclosure**

- For the Gas Turbine, speed reduction gear and the  
auxiliaries. Protective roof over generator.

**Electrical and control modules**

- Electrical and control module
- Battery module

**Exhaust direction from the Gas Turbine outlet**

- Horizontal, axial

**Maintenance opening**

- Left side (looking from the exhaust towards the air inlet)

**Delivery**

- DES port of Thailand (INCOTERMS 2000)

**Terminal Points to Customer**

For data at the terminal points, please refer to separate  
document.

X2201200E

## Scope of Supply

## Comment

- 431 **Gas Fuel System**
- Gas fuel connection, at the gas isolation valve located outside  
GT package, auxiliary skid side acc. to the layout drawing.
- 442 **Cooling Water System**
- Incoming/outgoing water connection flanges for water cooled  
lube oil cooler located close to the auxiliary skid.
  - Incoming/outgoing water connection flanges on generator  
coolers.
- 482 **Instrument Air**
- Connection located at the GT enclosure wall (auxiliary skid  
side) for the GTG set.
- 491 **Drains**
- Connection for emptying of the intermediate drain tank  
located at the enclosure wall, maintenance door side.
- 590 **Medium Voltage**
- Generator main connection (11kV) at terminals located inside  
the Generator MV terminal box (HIGS). Cable connection  
from below.
  - Auxiliary feeder connection (11kV) at terminals located  
inside the Generator MV terminal box (HIGS). Cable  
connection from below.
  - Starting transformer terminals (6,6 kV)
- 626 **Auxiliary Power**
- Terminals on motors and heaters
  - 690V terminals on starting transformer.
  - Terminals in electrical panels.
- 630 **Control & Instrumentation**
- Terminals in control panels.
  - Terminals on starting transformer.
- 684 **Grounding**
- Grounding connections on delivered equipment.
- 720 **Interface to Foundation**

## Comment

- Lower end of multi point support for the GT and driven equipment
- Lower end of the support structures for:
  - Air intake system.
  - 1x100% watercooled cooler for the lubricating oil system.
  - Ventilation system GT
  - Electric start and barring motor
  - Electrical and control module
  - Battery module
  - Starting transformer.
  - Central fire suppression unit.

740

**Exhaust system**

- Exhaust system not included. Delivery limit is the exhaust gas diffuser flange.

2030040

**Outlets to Atmosphere.**

For data at the outlet points, please refer to separate document.

410

X2201200E

**Lubricating oil**

- Outlet from lubricating oil system ventilation fan, located on the GT enclosure roof.

423

**Ventilation**

- Outlet from the GT enclosure to atmosphere, downstream the weather louvers

431

**Gas fuel system**

- Gas fuel ventilation, located above the GT enclosure roof.

740

**Gas Turbine exhaust**

- Exhaust gas from the Gas Turbine downstream the delivery limit other than the stack.

## Comment

**Scope of supply****Part 3 Gas turbine - Principal components**

300

**Industrial design, single shaft with modular concept:**

- Compressor inlet casing and inlet bellmouth casing.
- Thrust bearing #1 (tilting pad, directed mineral oil lubrication) combined with radial journal bearing #1 (tilting pad, directed mineral oil lubrication), located in the inlet bellmouth casing.
- 15-stage axial flow compressor with 3 rows of variable guide vanes (AC servo motor driven), electron-beam welded compressor rotor, inner stator casing with vane carriers forming air flow path, vertically split outer casing
- 2 bleed valves (pneumatically actuated) for air bleed during start-up and shutdown.
- Central casing with diffuser for compressor discharge air.
- High energy spark plug for cross-ignition during engine start-up.
- 3rd generation DLE system with annular combustion chamber, 30 burners and 2 optical flame detectors.
- 3-stage bladed turbine rotor, connected to the intermediate shaft by tie-bolts.
- Turbine casing with gas flow path and 3 stages of turbine guide vanes.
- Radial journal bearing #2 (directed mineral oil lubrication), located in the turbine exhaust diffuser casing.
- Turbine exhaust casing with exhaust diffuser.
- Drain valves (manually operated) from compressor inlet plenum, compressor bleed cavities #1 & #2, central casing and exhaust casing.
- Bently Nevada, accelerometer type, vibration probe: 1 off in bearing #1 and 1 off in bearing #2

330

**Speed reduction gear (6600/1500 rpm), double helical design.**

- High speed side, quillshaft connection to the gas turbine.
- Low speed side, quillshaft connection to the generator.
- Free wheel clutch (SSS-type) for connection of electric start and barring motor
- 4 journal bearings of sleeve type for mineral oil lubrication.
- 1 temperature transducer in each of the four bearings

## Comment

- 1 BN, accelerometer type, vibration probe located on the casing at the high speed (pinion) turbine side.
- 1 BN, accelerometer type, vibration probe located on the casing at the low speed shaft (wheel) turbine side

380

**Mounting details**

- Pendulum supports, spring loaded supports, fix point support and side support for the gas turbine, down to the main baseframe. Supports for the diffuser, down to the foundation.

385

**Turbine base frame**

- Welded I-beam baseframe for the GT driver unit

390

**Insulation**

- Insulation of the Gas Turbine (including exhaust casing) for personnel safety, heat and noise reduction.

## Comment

**Part 4 - Auxiliary systems**

Some auxiliary systems and parts of the control system are mounted on a separate skid located side by side with the GT unit. See layout and General Arrangement drawings.

401

**Instrumentation**

- Instrumentation pipes, instrument valves and fittings in 316L stainless steel

402

**Cooling & Sealing air system**

- Extraction from compressor stage #3 for external turbine stator cooling and sealing air around bearing #2 during operation, including temperature measurement, strainer with diff. pressure transmitter, butterfly valve and orifice.
- Extraction from compressor stage #5 for bleed to exhaust, external turbine stator cooling and sealing air around bearing #2 during start-up and shutdown - and cooling to turbine stator stage #3 during start-up and shutdown, including temperature measurement, strainer with diff. pressure transmitter, butterfly valve, orifice and bleed valve.
- Extraction from compressor stage #10 for bleed to exhaust during start-up and shutdown - and cooling of turbine stator stage #2 and air supply to the balance piston during start-up, operation and shutdown, including temperature measurement, strainer with diff. pressure transmitter, butterfly valve, orifice and bleed valve.
- Instruments and components for cooling and sealing air system

403

**Electric Start & Barring system**

- Static Frequency Converter (SFC).
  - Electric start and barring motor.
  - Driver shaft of flexible type, steel plate coupling.
  - Emergency barring system (Geared AC motor, 400VAC, on main gearbox).
- The arrangement is based on that the 400VAC emergency services board supplies power to each GT MCC in case of AC failure. A capacity of 80 -100 kW is sufficient to keep one (1) GT-set start prepared in case of a power plant black-out.
- Instruments and Components for Electric Starting & Barring system

## Comment

410

**Lubricating Oil System designed for ISOVG46 mineral oil fulfilling Supplier specification 8121-09**

- Covering:
  - The Gas Turbine
  - The Speed Reduction Gear
  - The Generator
  - Start and barring motor.
- Carbon steel lube oil tank with 2 heaters.
- Supply piping for the lube oil system in carbon steel, stainless steel downstream the filter to the GT.
- Discharge piping in stainless steel.
- Pumps and fan with redundant power supply.
  - 3 x 80% AC motor driven centrifugal type pumps (2 in operation and 1 in stand-by mode). The pumps are normally utilised to 2 x 50% but the SFC's and motors are designed to increase the capacity of the pumps during transfer from the operational to the stand-by pump.
  - 2 x 100 % AC motor driven oil system ventilation fan.
  - Oil system ventilation filter with filter housing in stainless steel

Each pump and the fan is driven by a Static Frequency Converter. DC back-up is provided on each pump and the fan by the 440VDC battery feed to the SFCs.

- 1 x 100 % water cooled lube oil cooler (plate type) designed for +40°C cooling media inlet temperature, including lub.oil piping
- 2 x 100 % lube oil filter with delta P transmitter.
- Instruments and Components for standard Lubricating Oil system.

422

**Fire Extinguishing System, CO2**

- Fire detection and extinguishing system for the GT enclosure.
- 1 x 100 % discharge for fire protection as above.
- Piping, valves and nozzles.
- 10 IR detectors, 6 heat detectors covering the gas turbine and auxiliaries located inside the GT enclosure.
- 2 warning lights flashing red, located outside the GT enclosure.
- 2 acoustic alarms (one CO2 driven and one electrically driven), located inside the GT enclosure

## Comment

- 1 CO2 released status light, 1 CO2 blocked status light and a manual release button, located outside each normal entrance door to the GT enclosure.
- Central fire suppression unit. The central unit is connected to the control system for alarm annunciation.
- Instruments and Components for standard Fire Extinguishing system.

423

**Ventilation system**

- Weather louvers at the ventilation inlet and outlet of the GT enclosure.
- Silencers as required for the specified sound level, on ventilation inlet and outlet of the GT enclosure.
- 1 stage air filter (barrier type, disposable) for the GT enclosure.
- Shut off fire dampers on the ventilation inlet and the ventilation outlet of the GT enclosure.
- 2 x 100 % AC driven fan placed in the ventilation outlet of the GT enclosure, i.e. GT enclosure subatmospheric pressure.
- Air conditioning unit (1x100%) for the electrical and control module.
- Ventilation ducts in Carbon steel.

424

**Gas detection system**

- 2 semi-conductor gas detectors, located in the ventilation outlet from the GT enclosure (one in low position and one in high position).
- The detectors are connected to the GT control system via the gas detection central unit. Each gas detector has an alarm and an engine shutdown level.

431

**Gas Fuel System**

- Gas fuel unit
- Manual isolation valve
- Gas isolation valve (spring closing, pneumatically operated).
- Strainer, mesh size 200, with local diff. pressure indicator.
- Two quick shut-off valves in series (spring closing, pneumatically operated).
- Ventilation valve between the quick shut-off valve.
- Ventilation valve between the isolation valve and the first quick shut-off valve
- Gas control valve ( AC-servo motor operated) with position feedback, for the 2 pilot gas manifolds.

## Comment

- 2 pilot gas manifolds with 18 and 12 connection points respectively from each manifold to the 30 burners.
- 1 main gas manifold with 30 connection points to the 30 burners.
- Gas control valve (AC-servo motor operated) with position feedback, for main gas manifold.
- Gas control valve (pneumatic positioner) with position feedback, for central gas manifold..
- 1 central gas manifold with 30 connection points to the 30 burners.
- All piping in gas fuel unit and internal GT-skid piping in stainless steel
- Ventilation lines to atmosphere, standard location above the air intake filter.

439

**Ignition System**

- Piping for natural gas supply from the gas fuel system to burner #26 during startup.
- Shut-off and vent valves (spring closing, pneumatically operated).
- High energy spark plug for cross-ignition (see Item 300)

442

**Cooling water system**

- Terminal point at the lube oil cooler.
- Terminal point on the generator coolers

482

**Instrument air system**

- Internal piping in stainless steel.
- Last chance coalescer filter (0,01 micrometer)
- Instrument air supply by customer.

491

**Compressor washing system**

- Washing unit for compressor washing, consisting of:
  - Water tank with heater, level gauge and temperature gauge. Volyme 80L.
  - Detergent tank with heater, level gauge and temp. gauge. Volyme 80L.
  - Filter.
  - AC driven pump (reciprocating type).
  - Pressure regulating valve and pressure gauge.
  - Piping, inlet manifold and injection nozzles for offline washing.

## Comment

- 7 manually operated drain valves with piping, to common location at skid edge via the internal drain tank. from the Gas Turbine.
- Internal, intermediate, drain tank including drain pump and level switch. Volyme app. 100L.
- Instrumentation and piping according to P&ID
- Equipment acc. to "Safe area" area classification.

493

**Drying system**

- Dehumidifier for engine dry out, during shut down periods. Automatic start after completed barring.

## Comment

**Part 5 - Generator**

501

**Generator type AMS 1250 A LF**

3BSM006990\_A

- 56,25 MVA at 35°C cooling water temperature and P.F. 0.8.
- Frequency / speed / voltage : 50 Hz / 1500 RPM / 11 kV. Standards, IEC.
  - Four pole (salient) three phase synchronous generator.
  - Cooling form: IC8 A1W7.
  - Brushless AC-exciter with rotating rectifier.
  - PMG for excitation power supply.
  - Insulation according to class F.
  - Temperature rise at rated output and P.F. 0.8 within class B absolute according to § 16.3.4 of IEC 34-1 within the ambient temperature range.
  - Temperature monitoring by RTD.
  - Vibration monitoring by accelerometers.
  - Lube oil supply from the turbine system.
  - Line and neutral side termination points for MV terminal enclosure.
  - Anti condensation heaters in the main machine, exciter and MV terminal box.
  - Separate junction boxes for instruments, excitation and heaters.

580

**Excitation and voltage regulator system**

- Dual channel Automatic Voltage Regulator (AVR) including:
- Automatic Voltage Regulator (AVR)
- Built in DC-chopper for regulation of field current
- Power factor control.
- Reactive power control.
- Excitation current limiter with cooling air bias.
- Stator current limiter with cooling air bias
- Under excitation limiter

## Comment

- Power System Stabilizer  
note: This extra feature will have a basic default setting when delivered. The price quoted excludes time for setting and commissioning the equipment if required on site. The time is further excluded from the 105MW erection and commissioning TFA time provided in the onshore contract and would be payable separately against daily rates.

591

**Higs - Line and neutral cubicle**

SLD X501234E

Highly integrated generator breaker solution. The breaker is directly attached to the generator. Generator neutral, generator circuit breaker, all measuring transformers and earthing switches are included in one unit. The attached control cubicle contains the generator control unit (AVR) and all control equipment necessary for operation in local or remote position where applicable.

- Rated voltage level 12kV, 50Hz
- Basic Insulation Level 75kV
- Rated current 4000A
- Rated Short circuit time withstand current 50 kA, 1 sec
- Neutral Point Resistor 10A,10s.
- Degree of protection: IP54

**Auxiliary transformer compartment**

- Vacuum circuit breaker and disconnecter for outgoing feeder for auxiliary transformer.
- Circuit Breaker 1250A / 63 kA
- Protection relays and remote control is not included

**DC control power**

- Rectifier for internal control power 240VAC//110VDC.

**Main Connection**

- Cable/busbar connection from below. No static load is allowed on the connection bus.

Comment

**Part 6 - Electrical and control equipment**

600

**Electrical auxiliary systems**

Electrical auxiliary systems as specified below:

SLD X620628E

626

**Motor Control Centre**

Siemens MCC board, Isc=50kA.

Supplies all consumers (except starting system) within the scope of supply and is provided with:

- Fixed mounted circuit breaker incomer.
- Fixed mounted fuseless motor starters and MCCB feeders.
- Dual redundant incomers with automatic transfer.

Protection class IP30.

625

**UMD (Uninterrupted Motor Drive) and UPS (Uninterrupted Power Supply) systems**

The system provides uninterrupted AC and back-up DC power to the AC motor driven lube oil pumps and the oil ventilation fan(s) of the turbine package.

A UPS supply unit (static frequency converter, sine filter and transformer) and a UPS distribution board for supply of the I&amp;C equipment of the turbine is as well integrated within the free standing panel arrangement.

A common battery supply DC power to the UMD and UPS system. (Only to UMD system when UPS supply is provided by others.)

The system is completely self contained and is designed with protection class IP21, (IP20 internally).

The panel arrangement mainly contains the following equipment:

- One AC power distribution board with MCCB breakers supplying the frequency converters, and the battery charger.
- One DC power distribution board with MCCB breakers supplying the frequency converters.
- Static frequency converters for the lube oil pumps and the oil ventilation fan(s).
- Static frequency converter for UPS supply. One hour autonomy time.
- MCB distribution board for I&C equipment. Fed from UPS supply.
- Battery charger, 440 VDC.
- PLC based emergency back-up operation system.

Comment

**Common UMD and UPS battery**

Capacity for one hour with UPS system load and a complete 10h emergency cool down cycle.

629

**Starting transformer**

- Dry insulated, cast resin epoxy type transformer with transformer enclosure.
- Protection class IP54
- 6,6 +- 2 x 2,5% / 0,69 kV, 50 Hz.

629

**Frequency converter(s).**

- Starting frequency converter, Siemens Sinamics S120, 690VAC 50/60 Hz supply, protection class IP21.

630

**Control equipment for automatic start-up, operation and shut down.**

Micro Processor based control, supervision and protection system with a PC based operators station. The system is designed for highest possible operators friendliness with colour process graphics, log and alarm /event displays, printer for lists and hardcopies from the screen. The system has various openings to external computer systems. The system program provided is in the US English language.

PCS7 license for control system programming included in operator station. (At deliveries of more than one GT at the same installation, the tool is common for all GT units).

The following division of functionality described below constitutes the turbine control system:

634

**Operators station**

PC based (Windows XP) operators interface, Simatic WinCC with necessary software to operate the GT in all operation modes. Rack type computer with redundant Hot-Swop, RAID controllers.

The PC based operators interface consists of:

- Rack mounted turbine HMI with 19 inch TFT screen, keyboard, mouse and laser colour printer.
- Additional remote desk mounted turbine HMI with 21 inch TFT screen, keyboard and mouse
- Ethernet interface to turbine controllers

Common for 2 GTs  
(X630730E)

## Comment

The OS station performs apart from providing normal operators dialogue:

- Trending and storing of process parameters.
- Self diagnostics and displays of system and individual board status.

Other indicators:

- Start counter.
- Operating, equivalent operating hour and cycle counter.

635

### Main process controller Simatic AS400

The main Simatic controller contain system and application programs to perform both open and closed loop control in order to run the turbogenerator set. The programs are battery backed up for appr. 2 month.. The main tasks of the AS400 controller are:

- Analogue and Binary I/O handling.
- Sequencer for start and stop.
- Gas turbine set monitoring.
- Frequency/load control.
- Gas turbine speed and temperature control.
- Gas turbine acceleration and deceleration control.

631

### Unit protection system

The unit protection system is built up around one fail safe controller (AS400-F), proven according to IEC61508. All trip signals works with the principle of "fail safe", i.e. signal loss generates a turbine trip.

The following signals are duplicated and works with the "1 out of 2" principle:

- Turbine overspeed.
- Flame supervision.
- Purge time monitoring.
- Ignition failure.
- High exhaust gas temperature.
- Low lubrication oil pressure.
- High lubrication oil temperature.

All protection system actions are registered and informed to the operator on the main operators station.

630

### Communication, Hardwired interface

## Comment

I/O interface in turbine control system for signal interfacing with control and monitoring system for plant provided by others.

- 10 Digital inputs, 24VDC
- 10 Digital outputs (potential free relay contacts)
- 5 analog signals
- One signal to the safety system

631

### Generator protection system

Protection system Siemens Siprotec 4. Protection functions as indicated below.

SLD X501234E

	IEEE-code(Sub)
– Differential protection	87G
– Stator earthfault protection	59N
– Voltage restraint over current protection	51V
– Under impedance protection (zone 1)	21
– Negative sequence protection	46
– Under excitation protection	40
– Over/under voltage protection	59/27
– Reverse power protection	32
– Rotating diode fault protection	58*
– Breaker Failure	50BF
– Frequency protection	81

\*) AVR system function

639

### Synchronising equipment

Automatic and manual (semiautomatic) synchronising system for two circuit breakers, the Generator Circuit Breaker (GCB) and one additional breaker. The system is provided with a "Synchronising by-pass" switch for breaker closing against a "dead bus".

630

### Additional included features for the control system

- Optical interconnection of two control systems (no cable included) for common access to GT units on the same control network
- Modbus serial link and modem with standard scope of signals for communication with external computer system
- Hot replacement of I/O modules
- Interface for IRIG-B (client to connect to terminals in gas turbine control module) to be used for common time system

Common for 2 GTs

**Comment**

- PCS7 programming license included in operator station

Common for 2 GTs

**Electrical installation**

- Control and instrumentation cables on the turbine and auxiliary systems skid.

**Comment****Part 7 - Installation and building**

710

**Enclosure**

- Weatherproof, outdoor:
  - Acoustic enclosure for the Gas Turbine Generating set including the speed reduction gear. Weather roof over Electric Generator.
  - Complete with access doors, emergency doors, walkways, stairs, internal lighting and a 8 tonnes maintenance overhead crane in the GT enclosure.

711

**Electrical and control equipment modules**

- Control room;
  - Operators station
  - Control panels.
  - MCC
  - Starting frequency converter
  - Lube oil drive system
  - Emergency back-up battery
  - UPS-unit for turbine controls
  - Fire fighting panel
  - Servo Motor Drivers
- Battery room;
  - Emergency batteries

The modules are provided with internal lighting, heating and air conditioning systems. Systems are tested together with the GT and auxiliary systems (factory tests).

720

**Foundation**

- Outline drawing of the foundation with static and dynamic loads
- Embedded steel plates
- Necessary fasteners to attach included units and equipment to foundation according to valid drawings.

731

**Static air intake system**

- Double sided filter house with disposable 1st and 2nd stage filter. Pre filter class F7, high efficiency filter class H10 (HEPA).
- Ducting for standard outdoor installation with support structure.
- Acoustic-lined duct and silencer for the air intake
- Hoist for filter replacement, hand operated.

Comment

740

**Exhaust gas system**

- Insulated exhaust duct (horizontal, axial outlet).

Comment

810

**Part 8 Inspection, erection, testing and commissioning****Transport**

- Packaging for sea transport
- Packing for 3 months storage
- Delivery DES port of Thailand, acc. to INCOTERMS 2000.
- The tools for on/off loading during transport and erection period are property of Siemens.
- Weatherproof transport/storage cover for main machinery unit and auxiliary unit.

820

**Inspection**

- Quality control acc. to standard Inspection Plan
- Witness point for routine test, Electric Generator (To be agreed)
- Shipment release inspection (To be agreed)

830

**Maintenance tools**

- GT-tools for A-inspection
- GT-tools for B-, C- and D-inspection.
- Generator maintenance tools
  - Rotor removal rooling tool
  - Service crane
  - Exciter removal tools
  - Generator roll out support.

**One set** (total 4 sets for 7 sites)**One set** (total 4 sets for 7 sites)

852

**Factory tests**

- Balancing and overspeeding of the turbine and generator rotors.
- Standard Gear test at the subsupplier's workshop
- Standard Electric generator routine test at the subsupplier's workshop
- Stationary testing:
  - System tests of the assembled equipment, including sequence test up to GT ignition (without engine rotation), with contract auxilliary systems and contract control equipment available at workshop test.

Comment

## Part 9 Documentation, operation and maintenance

940

### Spare parts

- Operation consumables for 2 years operation
- Operation back-up parts

One set (total 4 sets for 7 sites)

980

### Documentation

The Documentation is divided into five blocks 1, 2, 3, 4 (Operation and Maintenance) and 5 (Quality Documentation). All documentation, with the exception of block 5 is delivered on CD/DVD-ROM. The application uses a standard HTML web-browser and Acrobat Reader.

In addition to the CD/DVD-ROM, copies in paper format will be delivered as well according to the Scope below for the Operation and Maintenance documentation.

#### 1. Documentation overview.

This is an introduction to the Operation & Maintenance documentation structure and comprises key information on how to recognize and find the appropriate documents and how to understand the typical symbols used.

- 1 Documentation overview.

#### 2. Operation & Maintenance Instructions.

This block serves as the instruction for operation of the gas turbine package and as well as handling the unit in emergencies. The System Descriptions and the System (P&I) Diagrams form an appropriate level of information for understanding the basic systems design and operation. This block also contains instructions for scheduled preventive maintenance.

- 2A Operation instruction, including control system operator interface
- 2B Fault procedures.
- 2C System descriptions
- 2D System (P&I) Descriptions
- 2E Setting list, Electrical load list, Aggregate list and Instrument list.
- 2F Maintenance documentation.

Comment

### 3. Maintenance and Technical Documentation.

The Technical Documentation contains detailed technical information, mainly intended for the maintenance personnel. The documentation is divided into Electrical-, Control- and Building Items.

- 3A Control documentation.
- 3B Electrical documentation.
- 3C Installation documentation (if applicable)
- 3D Building documentation (if applicable)

### 4. Component Documentation.

The Component Documentation mainly consists of Technical documentation and a limited part of Operation and maintenance documentation.

- 4A Control Components
- 4B Electrical Components
- 4C Mechanical Components

### 5. Manufacturing Record Book

The Manufacturing Record Book includes inspection plans and different types of certificates for the electrical and mechanical equipment.

- Test and inspection documentation.

### Language and number of binders per GT:

- Documentation language is English
- 2 copies of Electronic documentation (DVD)
- 1 copies of binders for block 1, 2 and 3
- 1 copies of binders for block 5.

### Main exclusions

- Supply of auxiliary power
- Drain from terminal point
- MV connection (cabling or busduct) between the generator circuit breaker and the step-up transformer.
- LV power cables, installation materials and installation external of the GTG package.

---

**Scope of Supply****Comment**

- Signal and control cables, installation materials and installation external of the GTG package.
- Earthing network external to GTG set
- Lightning protecting
- All civil works including foundations
- Counterflanges, gaskets and bolts at terminal points - if not specifically agreed in final scope of supply.
- Exhaust system downstream the GT exhaust diffuser flange. The equipment downstream the GT exhaust diffuser flange must be designed and manufactured to meet the overall plant noise requirements.
- On-line washing
- Instrument air compressor
- External gas receiving /pressure control system
- External gas treatment

## ภาคผนวก ข-6

---

เอกสารการติดตั้ง Dry Low NOx

---

**Scope of Supply***Comment*

## SGT-800 Gas Turbine, Generator Drive.

### Scope of Supply and Terminal Points

#### Part 1 General

**Basic definition:**

This Scope of supply forms a functioning unit within the terminal points (utilities/consumables such as auxiliary power, fuel, water, wash detergent, instrument air, lubricating oil and grease are excluded). Alternative configurations are available.

#### Part 2 Technical specification

**Application**

- 1 x SGT-800, Onshore (equipment delivery)

**Operating mode**

- Continuous base load

**Units**

- SI-units

**Design conditions**

- +8 to +40°C ambient temperature.
- Moderate dust loading

**Installation**

- Outdoor

**Wind speed and seismic zone**

- <= 40 m/s and UBC code (1997) zone 1, S3 (foundation not considered)

**Site handling forces**

---

**Siemens Industrial Turbomachinery AB**

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01. General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

---

**Scope of Supply***Comment*

- Site 0.5 x g in any horizontal direction and 0.5 x g in vertical direction.

**Area classification**

- Safe area

**Surface treatment**

- Onshore, Corrosivity category C4 high. The internal equipment and the generator are treated for corrosivity category C2.
- Corrosivity factors according to ISO 12944.

**Design sound level**

- 85 dB(A) near field at 1 m distance (outside the GT enclosure wall and 1.5 m above ground level). Measured according to ISO 3746-1995.

**Combustion chamber**

- Dry Low Emission system

**Fuel**

- Gas fuel, fulfilling Supplier gas fuel specifications X241010E/1CS26810

**Lubricating oil cooling**

- Water (water / antifreeze fluid TEMPER or equivalent), cooling media, supply temperature <+40 °C

**Generator cooling / protection form**

- Cooling/protection form: IC8 A1 W7/IP54
- Cooling water temperature to generator, ambient air temperature plus max 10 deg. C.

**Generating voltage / frequency**

- 11.0 kV / 50 Hz

**Auxiliary voltages, frequency and standards for motors**

- 400 VAC, 50 Hz, (TN-C-S system) start motor 690 VAC, 3-phase. 230 VAC UPS. Standards: EN/IEC.

**Emergency battery voltage**

- 440 VDC

---

**Siemens Industrial Turbomachinery AB**

M:\N02 Sales Job\IPG\2009 FOFF\SGT-800\Gulf Electric SPP - Thailand\Tender documents\File version\01. General & Commercial\120\_Scope of supply docs\_100330\120\_X1203409E\_2\_Scope of Supply and Terminal Points (SBC).doc

## ภาคผนวก ข-7

---

ผลการตรวจวัดคุณภาพอากาศจากปล่องระบาย  
อากาศจาก Continuous Emission Monitoring System  
(CEMs) ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567


กราฟแสดงผลการตรวจวัดคุณภาพอากาศจากปล่องระบายอากาศ (HRSG 1)

จากระบบการตรวจวัดสารมลพิษแบบต่อเนื่อง


(Continuous Emission Monitoring System : CEMs)

โรงไฟฟ้าเชิงรกรากน้อย ของ บริษัท กัลป์ เจพี ซีอาร์เอ็น จำกัด

ระหว่างเดือนมกราคม ถึง มิถุนายน พ.ศ. 2567

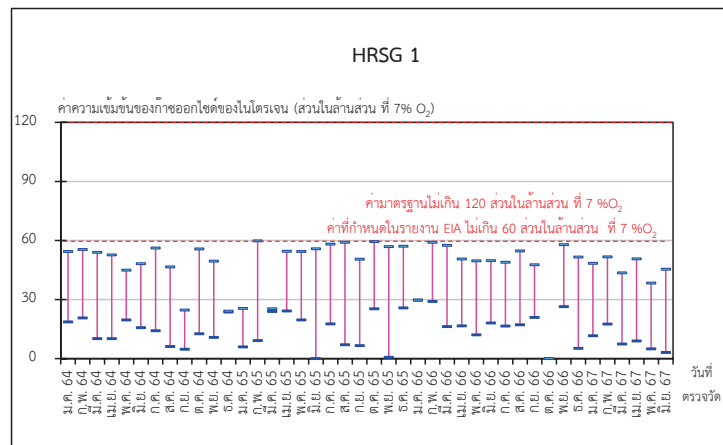

ก๊าซออกไซด์ของไนโตรเจน

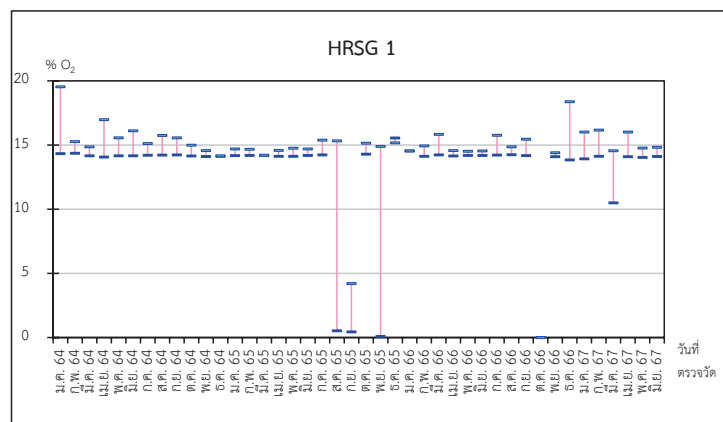

ก๊าซออกซิเจน


กราฟแสดงผลการตรวจวัดคุณภาพอากาศจากปล่องระบายอากาศ (HRSG 2)

จากระบบการตรวจวัดสารมลพิษแบบต่อเนื่อง


(Continuous Emission Monitoring System : CEMs)

โรงไฟฟ้าเชิงรกรากน้อย ของ บริษัท กัลป์ เจพี ซีอาร์เอ็น จำกัด

ระหว่างเดือนมกราคม ถึง มิถุนายน พ.ศ. 2567

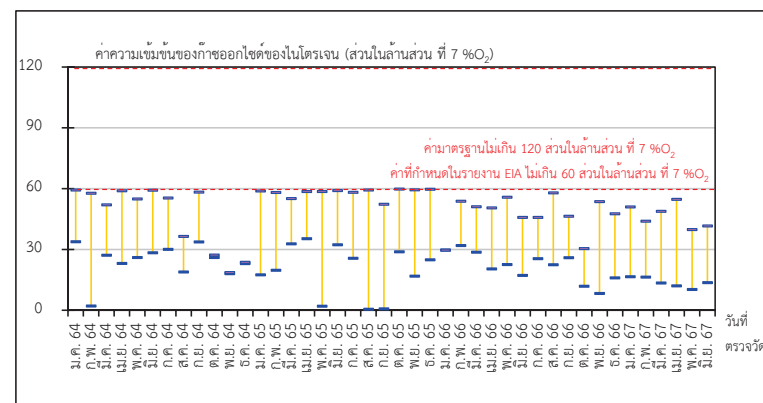

ก๊าซออกไซด์ของไนโตรเจน

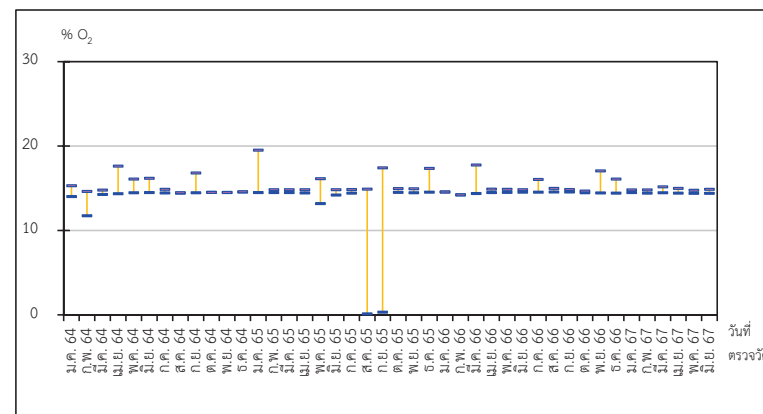

ก๊าซออกซิเจน

## ภาคผนวก ข-8

เอกสารขึ้นทะเบียนบุคลากร

ผู้ควบคุมระบบบำบัดมลพิษทางอากาศ

ที่ ออก ๐๓๑๓/ ๕๘๕๙



กรมโรงงานอุตสาหกรรม  
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท  
เขตราชเทวี กรุงเทพฯ ๑๐๕๐๐

๒๒ เมษายน ๒๕๖๕

เรื่อง หนังสือรับแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน

เรียน ผู้รับใบอนุญาตประกอบกิจการโรงงาน บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด

อ้างถึง คำขอเลขที่ ๐๔๖๙ ลงรับวันที่ ๒๑ เมษายน ๒๕๖๕

ตามคำขอที่อ้างถึง ท่านแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด ทะเบียนโรงงานเลขที่ ๓-๘๘(๒)-๕๘/๕๔ ปท ประกอบกิจการ  
ผลิตพลังงานไฟฟ้า ตั้งอยู่ ณ เลขที่ ๕๙/๔ หมู่ที่ ๔ ถนนทางหลวงหมายเลข ๓๔๗ ตำบลเชียงรากน้อย  
อำเภอสามโคก จังหวัดปทุมธานี โทรศัพท์ ๐ ๒๑๕๙ ๘๕๐๐-๑

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว รับแจ้งการให้ มีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน  
และให้ท่านยื่นคำขอแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงานครั้งต่อไป ภายในวันที่ ๒ มิถุนายน ๒๕๖๘  
โดยมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ดังนี้

ผู้จัดการสิ่งแวดล้อม					
ลำดับ	ผู้ควบคุมระบบบำบัด	เลขทะเบียน	มลพิษน้ำ	มลพิษอากาศ	มลพิษกากอุตสาหกรรม
๑				✓	
ลำดับ	ผู้ปฏิบัติงานประจำระบบบำบัด		มลพิษน้ำ	มลพิษอากาศ	มลพิษกากอุตสาหกรรม
๑				✓	
๒				✓	
๓				✓	
๔				✓	

หมายเหตุ ๑. การแจ้งการมี/ยกเลิก/เพิ่มเติม/เปลี่ยนแปลง บุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ต้องส่งหนังสือฉบับนี้ด้วย  
๒. ยกเลิกหนังสือรับแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ที่ ออก ๐๓๑๓/๗๗๔๓ ลงวันที่ ๓๑ พฤษภาคม ๒๕๖๒

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

ผู้อำนวยการสำนักงานทะเบียนเครื่องจักรกลาง รักษาการแทน  
ผู้อำนวยการกองส่งเสริมเทคโนโลยีสิ่งแวดล้อมโรงงาน  
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองส่งเสริมเทคโนโลยีสิ่งแวดล้อมโรงงาน  
กลุ่มกำกับบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน

โทรศัพท์ ๐ ๒๔๓๐ ๖๓๑๕ ต่อ ๒๔๐๕

โทรสาร ๐ ๒๔๓๐ ๖๓๑๕ ต่อ ๒๔๙๙



ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th





## ภาคผนวก ข-9

---

ข้อมูลจำเพาะของเครื่องจักรและอุปกรณ์ที่มีเสียงดัง

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED	
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	1 of 17




		<b>Gulf JP CRN</b> <b>(Pathum Cogeneration)</b>		 <b>MIT-POWER (THAILAND)</b> <b>LIMITED</b>			
<b>DOC TITLE</b>	<b>Noise Emissions Guarantee Test</b>						
<b>DOC NO.</b>	<b>070010.05-140-152</b>			<b>Rev</b>	<b>B</b>	<b>Page No.</b>	<b>2 of 17</b>

## GCRN Project



### Noise Emissions Guarantee Test

## REVISION HISTORY

Rev No.	Date	Description
A	9 January, 2013	For Approval
B	4 March, 2013	For testing

 <b>Gulf JP GCRN</b> (Pathum Cogeneration)			 MIT-POWER (THAILAND) LIMITED			
			 Pöyry Energy Ltd.			
B	4 March, 2013	For testing				
A	9 January, 2013	For Approval	BEP	ST	BEP	H.N.
Rev	Date	Description	Prepared	Checked	Approved	Authorized

Copyright © Pöyry Energy Ltd.



		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 <b>MIT-POWER (THAILAND) LIMITED</b>			
<b>DOC TITLE</b>		<b>Noise Emissions Guarantee Test</b>					
<b>DOC NO.</b>		<b>070010.05-140-152</b>		<b>Rev</b>	<b>B</b>	<b>Page No.</b>	<b>3 of 17</b>

#### Content

1	INTRODUCTION	4
2	OBJECTIVE OF THE TEST	4
3	GUARANTEES	4
4	NOISE EMISSION GUARANTEE TEST	6
4.1	Near Field Noise Measurement- Respective Equipments	6
4.2	Near Field Noise Measurement of Safety Valve Silencers, Start up Vent	7
4.3	Far Field Noise Measurement-Site Boundary Noise Measurement	7
5	INSTRUMENTATION	8

Attachment:

1: Sound level meter

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED			
DOC TITLE	Noise Emissions Guarantee Test						
DOC NO.	070010.05-140-152			Rev	B	Page No.	4 of 17

#### 1 INTRODUCTION

Per Schedule 4 Plant Tests, Section 5.4.3 of the Construction Contract of Gulf JP CRN Cogeneration project (formerly Pathum Cogeneration), the GCRN power plant shall be in compliance with the Performance Guarantees in Part 2 Table 2.3 Noise Emission of Schedule 3.



#### 2 OBJECTIVE OF THE TEST

The objective of the test is to demonstrate that the GCRN Cogeneration Project is in compliance with the specified near field and far field noise emissions guarantees.

#### 3 GUARANTEES

When the GCRN Power Plant is operating between 71.5-110 MW, the following noise emission limits will not be exceeded

Item	Description	Unit	Guaranteed value
1	Near field noise guarantee ; the surface sound pressure level averaged over the measurement surface at a distance 1 m for the respective equipment acoustical enclosure at 1.5 m aboveground shall not exceed	dB(A)	85
2	Near field noise guarantee of safety valve silencers and start up vent valve silencers as well as steam turbine bypass valves; the sound pressure level at a distance of 1 m from the safety valve silencers and start up vent valve silencers as well as steam turbine bypass valves shall not exceed	dB(A)	95
3	Far field noise guarantee ; the sound pressure level at Power Plant boundary and 1.5 m above the ground shall not exceed	dB(A)	70 (Leq24)



		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 <b>MIT-POWER (THAILAND) LIMITED</b>			
<b>DOC TITLE</b>		<b>Noise Emissions Guarantee Test</b>					
<b>DOC NO.</b>		<b>070010.05-140-152</b>		<b>Rev</b>	<b>B</b>	<b>Page No.</b>	<b>5 of 17</b>

The noise emission guarantee test will be measured at different plant conditions as described in table below

Test#	Test Load	Duration	Test Items
1	Combustion turbine operating at normal plant operation (Base load and Part load)	Base load: at least Leq 30 sec or longer to establish representative equipment noise emission	Near field noise measurement throughout the Plant at locations normally occupied by personnel and in the vicinity of equipment (see paragraph 4.1). (Operational & BG)
2	Transient plant operation - During any plant start	Start up vent valve measurement, Leq10 sec	Near field noise measurement of safety valve silencers, start up silencers and steam turbine bypass valves (See paragraph 4.2)
	Base load combustion turbine operation with the ST bypassed and with stem let down to process	Steam turbine bypass measurement Leq10 sec	
	Require special method to actuate safety valve (will be proposed by TTCL)	Safety valve measurement, Leq 10 sec	
3	Combustion turbine operating at normal plant operation (Base load and Part load)	24 hrs x 5 days	Far field site boundary noise measurement (20 measurements locations agreed upon between contractor and owner) as Leq1 hr, Leq24,L90,Ldn, Lmax (see paragraph 4.3)  Operational & BG, BG as Leq5 min only

BG = Back ground

For the far field site boundary measurements the owner and contractor need to agree on the measurement locations (total 20 locations). Plant layout showing the 20 agreed up on measuring locations will be added when available in the next revision.

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED	
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	6 of 17

#### 4 NOISE EMISSION GUARANTEE TEST

The noise emission guaranty test will be performed according to ISO 3746 procedure and Thai Standard . The following sections described the test procedures to be followed in conducting the noise guaranty test.

##### 4.1 Near Field Noise Measurement- Respective Equipments

**Operational Noise** .The average A-weight sound pressure level at one (1) meter horizontal distance from major surface of the respective equipment or acoustic enclosure at an elevation of one point five (1.5) meter above ground level (such areas shall normally be accessible/occupied by personnel) will be determined . The selected respective equipment that is limited to not more than 25 individual equipment including GTG x 2, STG x 1, Boiler feed water pump 100% x 2 x 2 Units, Main CW pump 50% x 2, Air compressor 100% x 2, Fuel gas compressor 50% x 2, Cooling tower fan 33% x 3, Aux. CW pump 100% x 2, Closed CW pump 100% x 2, Fire water pump x 2, Diesel engine generator x 1. Evaporator plant x 2. And 2 pieces of equipment to be agreed up on between owner and contractor,

Field measurements shall not be performed during periods when unusual activities are taking place that may influence the measured noise levels such as aircraft, construction or nearby extraneous noise events. The A -weighted sound pressure level averaged over the measurement surface shall be logarithmically averaged with the following equation :

$$L_{P_{eqA}} = 10 \times \log \left[ \frac{1}{N} \times \sum_{i=1}^N 10^{0.1 \times L_{P_{eqi}}} \right] \text{ dB}$$



Where,

$L_{P_{eqA}}$  = A-weighted sound pressure level averaged over the measurement surface, in decibels, with the source under test operation

$L_{peq}$  = A-weighted sound pressure level measured at the  $P'$  microphone position, in decibels

$N$  = the number if microphone position

**Background noise** will be obtained at each of measurement position used for operational sound level measurement as described above-but with all of the equipment within TTCL scope of supply not operating.

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 <b>MIT-POWER (THAILAND) LIMITED</b>	
DOC TITLE		Noise Emissions Guarantee Test			
DOC NO.		070010.05-140-152	Rev	B	Page No. 7 of 17

*Corrections for the environment*, for the equipment exceeding 85 dB(A) after correction of background noise, the environment correction, building correction of the reflected or absorbed sound shall be applied following Section A3 of ISO 3746. Then the corrected A-weighted sound pressure level will be determined by correcting the A-weighted sound pressure level averaged over the measurement surface for background noise and for reflected sound /environment. The results shall not exceed 85 dB(A)

#### 4.2 Near Field Noise Measurement of Safety Valve Silencers, Start up Vent Silencers and Steam Turbine Bypass Valves



Noise measurement, as Leq 10 sec in dB(A) shall be made at the Safety Valve Silencers, Start up Vent Silencers and Steam Turbine Bypass Valves using sound level meter that meet the requirements of IEC 651 Type 2. The measurement positions will be within one (1) meter from the surface of any individual equipment and 1.5 m above ground. Such test require transient plant operation that is

- Start up vent measurement shall be collected during any plant start
- ST bypass valve measurement shall be collected during base load combustion turbine operation with the ST bypassed and with steam letdown to process
- Noise measurement during safety valve actuation will require special method which proposed by TTCL

The transient plant operation of which the above noise occurs will be informed in advance.

#### 4.3 Far Field Noise Measurement-Site Boundary Noise Measurement

*Far field noise measurements* Site boundary noise measurements shall be determined as equivalent continuous sound pressure level at outdoor locations agreed between the Owner - TTCL as appropriate for the Site and surrounding environment. Approximately twenty (20) measurement locations along the site boundary such as fence area of the GCRN power plant shall be selected for the measurements. Each location should be measured at an elevation of 1.5 meters above the ground and at a minimum distance of 3.5 meter from any sound reflecting surface. The measurement locations should include locations nearest any noise generating equipment, positions anticipated to produce the highest plant noise and locations towards the closest neighbors (community).

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED	
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	8 of 17



Far field noise along the site boundary will be measured at 1 hr interval over twenty-four (24) consecutive hours to establish the 24 hr-weighted equivalent sound pressure level (Leq24) and 90 percentile sound pressure level (L90). Measurement shall be made during 5 days periods of normal Power Plant operations (Base load and Part load)

*Background for Far filed noise measurement.* Background noise will be measured at 5 minute/locations (Leq5) on the date without power plant operation. The equivalent sound pressure level, Leq24 after applying correction for background noise level will then be compared with the standard of 70 dB(A) as specified in the Notification of National Environment Board No.15 (BE 2540)

## 5 INSTRUMENTATION



All noise measurements will be conducted using RION Model NL-21 sound level meters. The instrument was designed in accordance with IEC 651 Type 2 requirements. The instrument will be calibrated using a sound level calibrator of known sound pressure level (94 dB(A) , frequency of 1000 Hz and accuracy of + 0.5 dB). Calibration will be performed before and after each measurement series and upon any significant change in recording conditions, such as a battery change operation. The calibration level will be constant within 0.1 dB. Calibration sheet of the device will be handed over to owner for review before the start of the test.

Details of RION Model NL-21 sound level meters and its calibrator are shown in Appendix 1.

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 <b>MIT-POWER (THAILAND) LIMITED</b>			
DOC TITLE		Noise Emissions Guarantee Test					
DOC NO.		070010.05-140-152		Rev	B	Page No.	9 of 17

## Attachment 1

### Sound level meter

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED	
DOC TITLE	Noise Emissions Guarantee Test				
DOCNO.	070010.05-140-152	Rev	B	Page No.	10 of 17

## Outline

The Sound Level Meter NL-21 is designed for sound level measurements according to the IEC standard. The following measurements can be made:

- |   |                                  |
|---|----------------------------------|
| • Equivalent continuous sound level         | $L_{eq}$                         |
| • Sound exposure level                      | $L_E$                            |
| • Maximum sound level                       | $L_{max}$                        |
| • Minimum sound level                       | $L_{min}$                        |
| • Percentile sound level                    | $L_N$ (five selectable settings) |
| • Sound level                               | $L_p$                            |
| • C-weighted peak sound level               | $L_{Cpeak}$                      |
| • FLAT peak sound level                     | $L_{peak}$                       |
| • Impulse sound level                       | $L_{Ai}$                         |
| • Impulse equivalent continuous sound level | $L_{Aeq}$                        |
| • Fast-max sound level                      | $L_{Amax}$                       |

Measurement settings and results (level values and bar graph) are shown on the backlit LCD panel.



Measurement data (sound level, processed data, measurement parameters) can be stored in the internal memory of the unit or on a memory card (CompactFlash card optional). The serial interface allows sending measurement data to a printer or computer.

By loading optional filter program, the unit can be used for 1/1 octave or 1/3 octave analysis with a 3rd-order Butterworth high-pass and low-pass filter.

Recorded data can be further processed on a computer.

The following accessories are available, to cover a wide range of application requirements.

- **Printer**                   DPU-414  
Serves to produce hard copy of measurement data (including data stored in memory).
- **Level recorder**       LR-07/LR-20A  
Serves to record sound level changes over time.

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 <b>MIT-POWER (THAILAND) LIMITED</b>	
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	11 of 17

## Specifications

### Applicable standards

IEC 61672-1:2002 class 2

JIS C 1509-1:2005 class 2

IEC 60651 and IEC 60804 was withdrawn and replaced by IEC 61672-1.

JIS C 1502 was withdrawn and replaced by JIS C 1509-1.

### Measurement functions

#### Main processing functions

Simultaneous measurement of all items according to selected time weighting and frequency weighting

Sound level  $L_p$

Equivalent continuous sound level  $L_{eq}$

Sound exposure level  $L_E$

Maximum sound level  $L_{max}$

Minimum sound level  $L_{min}$

Percentile sound level  $L_N$  (5 selectable settings)

#### Auxiliary processing functions

One selectable for simultaneous processing with main measurement processing functions

Peak sound level (FLAT)  $L_{peak}$

C-weighted peak sound level  $L_{Cpeak}$

C-weighted equivalent continuous sound level  $L_{Ceq}$

Power average of maximum sound level in a given interval  $L_{Aint}$

Impulse sound level  $L_{AI}$

Impulse equivalent continuous sound level  $L_{Aeq}$

$L_{Amax}$ ,  $L_{AI}$ , and  $L_{Aeq}$  can only be chosen when A weighting is selected for main processing.

$L_{Ceq}$  can only be chosen when A weighting or FLAT is selected for main processing.

Measurement time: 10 seconds, 1, 5, 10, 15, 30 minutes, 1, 8, 24 hours, and manual (maximum 200 hours)

#### Measurement range



A weighting: 28 dB to 138 dB

C weighting: 33 dB to 138 dB

FLAT: 38 dB to 138 dB

C-weighted peak sound level: 55 dB to 141 dB

Peak sound level (FLAT): 60 dB to 141 dB

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED			
DOC TITLE	Noise Emissions Guarantee Test						
DOC NO.	070010.05-140-152			Rev	B	Page No.	12 of 17

Inherent Noise A weighting: 22 dB or less (19 dB Typ.)

C weighting: 27 dB or less

FLAT: 32 dB or less

Linearity range: 100 dB

Reference sound pressure level: 94 dB

Reference level range: 30 to 120 dB

#### Level range selection

6 ranges in 10-dB steps

20 to 80 dB

20 to 90 dB

20 to 100 dB

20 to 110 dB

30 to 120 dB

40 to 130 dB

7 ranges when optional 1/1, 1/3 Octave Filter Card NX-21SA or optional Universal Filter Card NX-21VA is ON

10 to 70 dB (selectable only when NX-21SA or NX-21VA is ON)

20 to 80 dB

30 to 90 dB

40 to 100 dB

50 to 110 dB

60 to 120 dB

70 to 130 dB

#### Frequency range

Overall characteristics including microphone: 20 to 8000 Hz

Electrical circuit characteristics (AC output): 10 to 20000 Hz

Electrical circuit characteristics (detector): 10 to 20000 Hz

Frequency weighting: A, C, FLAT

RMS detection: Digital processor

Characteristics: Fast, Slow, Impulse

\* Impulse is selectable only for auxiliary processing functions



Calibration: Electrical calibration with 1-kHz sine wave signal from built-in oscillator

Calibration using sound calibrator or pistonphone

Back-erase function: Pause key can be act to erase data from preceding 5 seconds

Processing functions: Digital processing



Sampling interval: 30.3  $\mu$ s ( $L_{eq}$ ,  $L_{max}$ ,  $L_{Aint}$ ,  $L_{AI}$ ) 100 ms ( $L_N$ )

	<b>Gulf JP CRN</b> (Pathum Cogeneration)	 <b>MIT-POWER (THAILAND)</b> <b>LIMITED</b>			
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	13 of 17

#### Data store functions

For manual store, data can be stored either in the internal memory or on the optional CompactFlash card. Auto store is possible only when the CompactFlash card is inserted, because data are stored directly on the card. Multiple data files can be created on the CompactFlash card.

Manual store	Up to 100 data sets (sound level, store time and date, main and auxiliary processing results, processing start time) can be stored manually. Maximum expands to 100 data sets per one file when storing directly to CompactFlash card.
Auto store 1	Sound level or $L_{Aeq,1\text{ sec}}$ can be stored automatically on CompactFlash card every 100 ms, 200 ms, or 1 s. The maximum store time is 200 hours.
Auto store 1 timer function	Serves to set start and end time for auto store 1 measurement. Until the measurement start time, the unit operates in power save mode (power consumption approx. 1/3).
Auto store 2	Main and auxiliary processing results and processing start time are stored on CompactFlash card for each measurement, performed at preset intervals. Max. 99999 data sets can be stored.
Auto store 2 timer function	Serves to set start and end time for auto store 2 measurement. Pause interval between measurements can also be set. During the pause interval, the unit operates in power save mode (power consumption approx. 1/3).
Microphone	1/2-inch prepolarized condenser type Model: UIC-S2 Sensitivity: -33 dB
Preamplifier	NH-21
Display	Backlit LCD (128 × 64 dots + 121 icons)
Display screens	Numeric and bar graph indication of sound level Processing results screen Level-time graph (real-time level recording with 20-second horizontal axis) Menu screens for operation settings
Warning indications	Over-range indication: full-scale +8.5 dB Under-range indication: full-scale -2.6 dB

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED	
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	14 of 17

#### Outputs

##### AC/DC output

Key-selectable AC or DC output

AC output (using selected frequency weighting and filter settings)

Output voltage: 1 Vrms (at full-scale)

Output impedance: 600  $\Omega$

Load impedance: 10 k $\Omega$  or more

DC output

Output voltage: 2.5 V (at full-scale), 0.25 V/10 dB

Output impedance: 50  $\Omega$

Load impedance: 10 k $\Omega$  or more

#### I/O connector

Sound level meter control from and data output to a computer via the RS-232-C interface

Data output to printer DPU-414/CP-11/CP-10

RS-232-C

Transfer principle:	asynchronous
Data word length:	8 bit
Stop bits:	1 bit
Parity check:	none
Baud rate:	4800, 9600 or 19200 bps
Flow control:	yes
	Select X parameter control or RTS/CTS control

#### Comparator output

Open collector output: goes ON when set level is exceeded

Maximum voltage: DC 24 V

Maximum current: DC 60 mA

Level setting range: 30 to 130 dB, 1-dB steps

#### Power requirements

Four IEC R6P (size "AA") batteries

Battery life (23°C)



Approx. 32 h (alkaline batteries),

Approx. 12 h (manganese batteries)

With backlighting, battery life is reduced to about half.

When auxiliary processing functions are enabled, battery life is reduced by about 20%.

When the optional filter is enabled, battery life is reduced by about 20%.

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED	
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	15 of 17

#### AC adapter (option)

NC-34:	100 V AC
NC-34A:	120 V AC
NC-34B:	220 V AC
NC-95A:	100 to 240 V AC (CE-marked)
Current rating	Approx. 55 mA
Current consumption in standby mode is reduced to about one third.	
Operating input voltage: 4.2 V to 6.5 V	

Internal backup battery retains clock for about 1.5 months without external power.

#### Ambient conditions



-10°C to +50°C, 10% to 90% RH (no condensation)

#### Dimensions

Approx. 260 × 76 × 33 mm

#### Weight (including batteries)

Approx. 400 g



		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 MIT-POWER (THAILAND) LIMITED	
DOC TITLE	Noise Emissions Guarantee Test				
DOC NO.	070010.05-140-152	Rev	B	Page No.	16 of 17


#### Supplied accessories

Windscreen	WS-10	1
Carrying case	NL-21-031	1
Connector cover	NL-21-005	1
Hand strap	VM-63-017	1
Batteries	IEC R6P	4
Inspection Certificate		1
Instruction manuals		1 set
(Instruction Manual, Technical Notes, Serial Interface Manual, 1 each)		

#### Optional equipment

1/1, 1/3 Octave Filter Card	NX-21SA
Universal Filter Card	NX-21VA
CompactFlash card	MC-16CF
CF card adapter	MC-CFADP
AC adapter	NC-34 series
AC adapter with CE mark	NC-95A (100 to 240 V, 50/60 Hz)
BNC-to-RCA cable	CC-24
Microphone extension cable	EC-04 series
Serial I/O cable	CC-92
Printer cable	CC-93 (9 pins, for DPU-414) CC-93A (25 pins, for CP-10, CP-11)
Printer	DPU-414
Sound calibrator	NC-74
Pistonphone	NC-72
Level recorder	LR-07/LR-20A
Comparator output cable	CC-94
Windscreen	WS-03E
Battery pack	BP-21
Dry-cell batteries (IEC-R20, size "D") × 4	

		<b>Gulf JP CRN</b> (Pathum Cogeneration)		 <b>MIT-POWER (THAILAND) LIMITED</b>	
<b>DOC TITLE</b>	<b>Noise Emissions Guarantee Test</b>				
<b>DOC NO.</b>	<b>070010.05-140-152</b>	<b>Rev</b>	<b>B</b>	<b>Page No.</b>	<b>17 of 17</b>

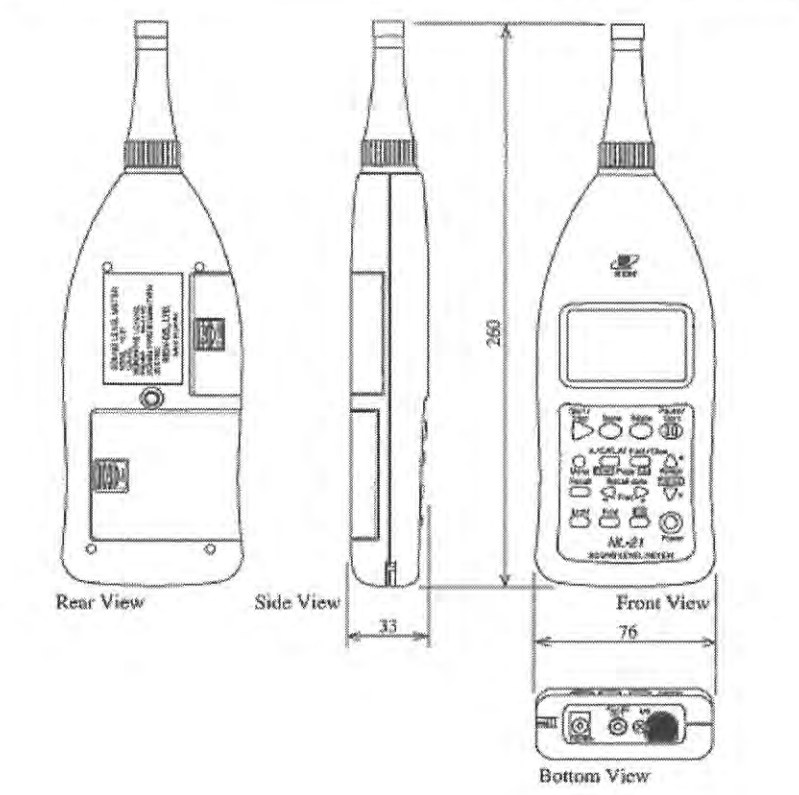

Unit: mm

Dimensional Drawings

## ภาคผนวก ข-10

---

ผลการตรวจวัดระดับเสียงในสถานประกอบการ  
(แบบติดตั้งกับพื้นที่)



## Analysis / Test Report

**Client :** Gulf JP CRN Co., Ltd.

59/4 Moo 4, Chiang Rak Noi, Sam Khok, Pathumthani Thailand 12160

**P/O :** 4108004227

**Project Name :** Monitoring EIA

**Project Location :** GCRN

**Lot ID: 246354**

Date Received : Feb 08, 2024

Date Reported : Feb 13, 2024

Report Number: 2909519-1

Page 1 of 1

**Sample Number** 246354-1  
**Parameter** Noise (Leq 8 hrs.)  
**Location** บริเวณ Gas Turbine 1  
**Measurement Date** Feb 07, 2024  
**Measurement by** Traimonthon Tipwan

Time	Leq (dB(A))	Lmax (dB(A))	L90 (dB(A))
08:19 AM - 09:19 AM	74.9	77.4	74.1
09:19 AM - 10:19 AM	77.6	103.2	74.0
10:19 AM - 11:19 AM	74.4	77.4	73.6
11:19 AM - 12:19 PM	74.7	78.0	73.6
12:19 PM - 01:19 PM	77.0	88.4	74.0
01:19 PM - 02:19 PM	83.4	88.3	80.0
02:19 PM - 03:19 PM	84.3	88.8	81.3
03:19 PM - 04:19 PM	84.6	89.6	82.6

Leq Average 8 hrs. (dB(A)) 80.8

Lmax (dB(A)) 103.2

Standard (dB(A)) 90 140

Reference Method : Based on ISO1996-1 and 1996-2

Standard : ประกาศกระทรวงอุตสาหกรรม เรื่อง มาตรฐานการคุ้มครองความปลอดภัย

ในการประกอบกิจการโรงงานเกี่ยวกับสภาวะแวดล้อมในการทำงาน พ.ศ.๒๕๔๖

Technical Management

*Orawan R.*

Orawan Rakyong  
Scientist (3)

Approved by

*Supot S.*

Supot Salamteh  
Section Head

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

11726-21/ EMAIL

S:\Reports\_Air Noise.rpt (11:00AM)



## Analysis / Test Report

**Client :** Gulf JP CRN Co., Ltd.

59/4 Moo 4, Chiang Rak Noi, Sam Khok, Pathumthani Thailand 12160

**P/O :** 4108004227

**Project Name :** Monitoring EIA

**Project Location :** GCRN

**Lot ID: 246354**

Date Received : Feb 08, 2024

Date Reported : Feb 13, 2024

Report Number: 2909520-1

Page 1 of 1

**Sample Number** 246354-2  
**Parameter** Noise (Leq 8 hrs.)  
**Location** บริเวณ Gas Turbine 2  
**Measurement Date** Feb 07, 2024  
**Measurement by** Traimonthon Tipwan

Time	Leq (dB(A))	Lmax (dB(A))	L90 (dB(A))
08:26 AM - 09:26 AM	70.8	73.7	69.3
09:26 AM - 10:26 AM	69.3	77.0	68.4
10:26 AM - 11:26 AM	68.8	75.9	68.3
11:26 AM - 12:26 PM	69.3	73.3	68.3
12:26 PM - 01:26 PM	70.9	79.3	68.3
01:26 PM - 02:26 PM	75.4	80.3	72.4
02:26 PM - 03:26 PM	76.3	80.5	73.6
03:26 PM - 04:26 PM	77.3	81.8	75.0

Leq Average 8 hrs. (dB(A)) 73.5

Lmax (dB(A)) 81.8

Standard (dB(A)) 90 140

Reference Method : Based on ISO1996-1 and 1996-2

Standard : ประกาศกระทรวงอุตสาหกรรม เรื่อง มาตรฐานการคุ้มครองความปลอดภัย

ในการประกอบกิจการโรงงานเกี่ยวกับสภาวะแวดล้อมในการทำงาน พ.ศ.๒๕๔๖

Technical Management

*Orawan R.*

Orawan Rakyong  
Scientist (3)

Approved by

*Supot S.*

Supot Salamteh  
Section Head

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

11726-21/ EMAIL

S:\Reports\_Air Noise.rpt (11:00AM)



## Analysis / Test Report

**Client :** Gulf JP CRN Co., Ltd.

59/4 Moo 4, Chiang Rak Noi, Sam Khok, Pathumthani Thailand 12160

**P/O :** 4108004227

**Project Name :** Monitoring EIA

**Project Location :** GCRN

**Lot ID: 246354**

Date Received : Feb 08, 2024

Date Reported : Feb 13, 2024

Report Number: 2909521-1

Page 1 of 1

**Sample Number** 246354-3  
**Parameter** Noise (Leq 8 hrs.)  
**Location** บริเวณ Steam Turbine  
**Measurement Date** Feb 07, 2024  
**Measurement by** Traimonthon Tipwan

Time	Leq (dB(A))	Lmax (dB(A))	L90 (dB(A))
08:20 AM - 09:20 AM	81.6	82.6	81.5
09:20 AM - 10:20 AM	81.4	86.5	81.3
10:20 AM - 11:20 AM	81.4	82.0	81.3
11:20 AM - 12:20 PM	81.3	81.9	81.1
12:20 PM - 01:20 PM	81.2	82.0	81.1
01:20 PM - 02:20 PM	81.4	82.8	81.2
02:20 PM - 03:20 PM	81.5	82.5	81.2
03:20 PM - 04:20 PM	81.5	82.6	81.2

Leq Average 8 hrs. (dB(A))

81.4

Lmax (dB(A))

86.5

Standard (dB(A))

90

140

Reference Method : Based on ISO1996-1 and 1996-2

Standard : ประกาศกระทรวงอุตสาหกรรม เรื่อง มาตรฐานการคุ้มครองความปลอดภัย

ในการประกอบกิจการโรงงานเกี่ยวกับสภาวะแวดล้อมในการทำงาน พ.ศ.๒๕๔๖

Technical Management

*Orawan R.*

Orawan Rakyong  
Scientist (3)

Approved by

*Supot S.*

Supot Salamteh  
Section Head

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

11726-21/ EMAIL

S:\Reports\\_Air Noise.rpt (11:00AM)



## Analysis / Test Report

**Client :** Gulf JP CRN Co., Ltd.

59/4 Moo 4, Chiang Rak Noi, Sam Khok, Pathumthani Thailand 12160

**P/O :** 4108004227

**Project Name :** Monitoring EIA

**Project Location :** GCRN

**Lot ID: 246354**

Date Received : Feb 08, 2024

Date Reported : Feb 13, 2024

Report Number: 2909522-1

Page 1 of 1

**Sample Number** 246354-4  
**Parameter** Noise (Leq 8 hrs.)  
**Location** บริเวณ WRSG 1  
**Measurement Date** Feb 07, 2024  
**Measurement by** Traimonthon TipBan

Time	Leq (dx(A))	LmaO(dx(A))	L90 (dx(A))
08:28 AM - 09:28 AM	73.4	76.5	73.0
09:28 AM - 10:28 AM	73.1	76.9	72.7
10:28 AM - 11:28 AM	72.9	78.2	72.4
11:28 AM - 12:28 PM	72.7	75.6	72.2
12:28 PM - 01:28 PM	72.8	76.3	72.2
01:28 PM - 02:28 PM	73.4	80.6	72.9
02:28 PM - 03:28 PM	73.4	79.3	72.8
03:28 PM - 04:28 PM	73.5	76.1	73.1

Leq Average 8 hrs. (dx(A))

73.2

LmaO(dx(A))

80.6

Standard (dx(A))

90

140

Reference Method : xased on ISH1996-1 and 1996-2

Standard : ประกาศกระทรวงอุตสาหกรรม เรื่อง มาตรฐานการคุ้มครองความปลอดภัย

ในการประกอบกิจการโรงงานเกี่ยวกับสภาวะแวดล้อมในการทำงาน พ.ศ.๒๕๔๖

Technical Management

*Orawan R.*

HraBan Rakyong  
Scientist (3)

Approved by

*Supot S.*

Supot Salamteh  
Section wead

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

11726-21/ EMAIL

S:\Reports\\_Air Noise.rpt (11:01AM)



## Analysis / Test Report

**Client :** Gulf JP CRN Co., Ltd.

59/4 Moo 4, Chiang Rak Noi, Sam Khok, Pathumthani Thailand 12160

**P/O :** 4108004227

**Project Name :** Monitoring EIA

**Project Location :** GCRN

**Lot ID: 246354**

Date Received : Feb 08, 2024

Date Reported : Feb 13, 2024

Report Number: 2909523-1

Page 1 of 1

**Sample Number** 246354-5  
**Parameter** Noise (Leq 8 hrs.)  
**Location** บริเวณ WRSO 2  
**Measurement Date** Feb 07, 2024  
**Measurement by** Traimonthon TipBan

Time	Leq (dx(A))	LmaO(dx(A))	L90 (dx(A))
08:22 AM - 09:22 AM	76.0	79.3	75.1
09:22 AM - 10:22 AM	75.5	80.1	74.5
10:22 AM - 11:22 AM	75.1	79.8	74.3
11:22 AM - 12:22 PM	75.1	81.2	74.1
12:22 PM - 01:22 PM	74.9	78.2	73.9
01:22 PM - 02:22 PM	74.8	82.0	74.3
02:22 PM - 03:22 PM	74.8	77.9	74.3
03:22 PM - 04:22 PM	74.6	76.4	74.2

Leq Average 8 hrs. (dx(A))

75.1

LmaO(dx(A))

82.0

Standard (dx(A))

90

140

Reference Method : based on ISH1996-1 and 1996-2

Standard : ประกาศกระทรวงอุตสาหกรรม เรื่อง มาตรฐานการคุ้มครองความปลอดภัย

ในการประกอบกิจการโรงงานเกี่ยวกับสภาวะแวดล้อมในการทำงาน พ.ศ.๒๕๔๖

Technical Management

*Orawan R.*

HraBan Rakyong  
Scientist (3)

Approved by

*Supot S.*

Supot Salamteh  
Section wead

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

11726-21/ EMAIL

S:\Reports\\_Air Noise.rpt (11:01AM)



## Analysis / Test Report

**Client :** Gulf JP CRN Co., Ltd.

59/4 Moo 4, Chiang Rak Noi, Sam Khok, Pathumthani Thailand 12160

**P/O :** 4108004227

**Project Name :** Monitoring EIA

**Project Location :** GCRN

**Lot ID: 246354**

Date Received : Feb 08, 2024

Date Reported : Feb 13, 2024

Report Number: 2909524-1

Page 1 of 1

**Sample Number** 246354-6  
**Parameter** Noise (Leq 8 hrs.)  
**Location** บริเวณ Cooling Tower  
**Measurement Date** Feb 07, 2024  
**Measurement by** Traimonthon Tipwan

Time	Leq (dB(A))	Lmax (dB(A))	L90 (dB(A))
08:25 AM - 09:25 AM	81.8	82.4	81.7
09:25 AM - 10:25 AM	81.6	82.2	81.4
10:25 AM - 11:25 AM	81.4	83.3	81.2
11:25 AM - 12:25 PM	81.3	82.2	81.2
12:25 PM - 01:25 PM	81.3	81.7	81.1
01:25 PM - 02:25 PM	81.2	81.6	81.0
02:25 PM - 03:25 PM	81.1	81.7	81.0
03:25 PM - 04:25 PM	81.1	82.7	81.0

Leq Average 8 hrs. (dB(A))

81.4

Lmax (dB(A))

83.3

Standard (dB(A))

90

140

Reference Method : Based on ISO1996-1 and 1996-2

Standard : ประกาศกระทรวงอุตสาหกรรม เรื่อง มาตรฐานการคุ้มครองความปลอดภัย

ในการประกอบกิจการโรงงานเกี่ยวกับสภาวะแวดล้อมในการทำงาน พ.ศ.๒๕๔๖

Technical Management

*Orawan R.*

Orawan Rakyong  
Scientist (3)

Approved by

*Supot S.*

Supot Salamteh  
Section Head

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

11726-21/ EMAIL

S:\Reports\\_Air Noise.rpt (11:01AM)

## ภาคผนวก ข-11

---

เอกสารบุคลากรผู้ควบคุมระบบบำบัดน้ำเสีย

## ประกาศที่ 011/2563

### เรื่อง แต่งตั้งผู้ปฏิบัติงานประจำระบบบำบัดน้ำเสีย

เพื่อให้การดำเนินงานด้านควบคุมระบบบำบัดน้ำเสีย (ระบบ Thermal Evaporation Plant) และการตรวจสอบคุณภาพน้ำทิ้ง ของบริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด เป็นไปอย่างมีประสิทธิภาพ และสอดคล้องตามมาตรฐานที่กฎหมายกำหนด จึงขอยกเลิกคำสั่งที่ 010/2562 และขอแต่งตั้งผู้ปฏิบัติงานประจำระบบบำบัดน้ำเสีย ดังมีรายชื่อต่อไปนี้

- |    |                   |
|----|-------------------|
| 1. | นักเคมี           |
| 2. | หัวหน้ากะ         |
| 3. | หัวหน้ากะ         |
| 4. | หัวหน้ากะ         |
| 5. | หัวหน้ากะ         |
| 6. | หัวหน้ากะ         |
| 7. | วิศวกรเดินเครื่อง |

โดยผู้ปฏิบัติงานประจำระบบบำบัดน้ำเสีย มีหน้าที่ดังต่อไปนี้

1. กำกับ ดูแล ให้ระบบบำบัดน้ำเสีย (Thermal Evaporation Plant) ทำงานได้อย่างต่อเนื่อง และมีประสิทธิภาพ
2. ควบคุมดูแลมิให้น้ำเสียระบายออกสู่ภายนอกโรงไฟฟ้า
3. ตรวจสอบคุณภาพน้ำทิ้งอย่างต่อเนื่องให้อยู่ในค่าควบคุม และไม่เกินเกณฑ์มาตรฐานกำหนด
4. กรณีที่คุณภาพน้ำทิ้งมีค่าเกินมาตรฐาน ให้ดำเนินการแก้ไข และห้ามระบายน้ำทิ้งที่ยังมิได้แก้ไขออกนอกโรงไฟฟ้า

ทั้งนี้ ตั้งแต่วันที่ 1 มิถุนายน 2563 เป็นต้นไป

ประกาศ ณ วันที่ 1 มิถุนายน 2563

ผู้จัดการ โรงไฟฟ้า



กรมโรงงานอุตสาหกรรม  
DEPARTMENT OF INDUSTRIAL WORKS

ขอมอบวุฒิบัตรให้แก่

เพื่อแสดงว่าได้ผ่านการฝึกอบรม  
โครงการเสริมสร้างศักยภาพผู้ควบคุมระบบบำบัดมลพิษน้ำ  
ในการควบคุมดูแลการเดินระบบบำบัดน้ำเสีย  
ระหว่างวันที่ 26-27 พฤษภาคม 2559

อธิบดีกรมโรงงานอุตสาหกรรม



สภาอุตสาหกรรมแห่งประเทศไทย  
THE FEDERATION OF THAI INDUSTRIES

สถาบันน้ำและสิ่งแวดล้อมเพื่อความยั่งยืน  
สภาอุตสาหกรรมแห่งประเทศไทย

มอบประกาศนียบัตรนี้ไว้เพื่อแสดงว่า

ได้สำเร็จการฝึกอบรมและสอบผ่านในหลักสูตร

“ผู้ควบคุมระบบบำบัดมลพิษน้ำ”

ระหว่างวันที่ ๘ - ๑๒ ตุลาคม ๒๕๖๑

ประธานสภาอุตสาหกรรมแห่งประเทศไทย




กรมโรงงานอุตสาหกรรม  
DEPARTMENT OF INDUSTRIAL WORKS

# ภาคผนวก ข-12

---

กิจกรรมชุมชนสัมพันธ์

## กิจกรรม CR และ CSR ของโรงไฟฟ้า

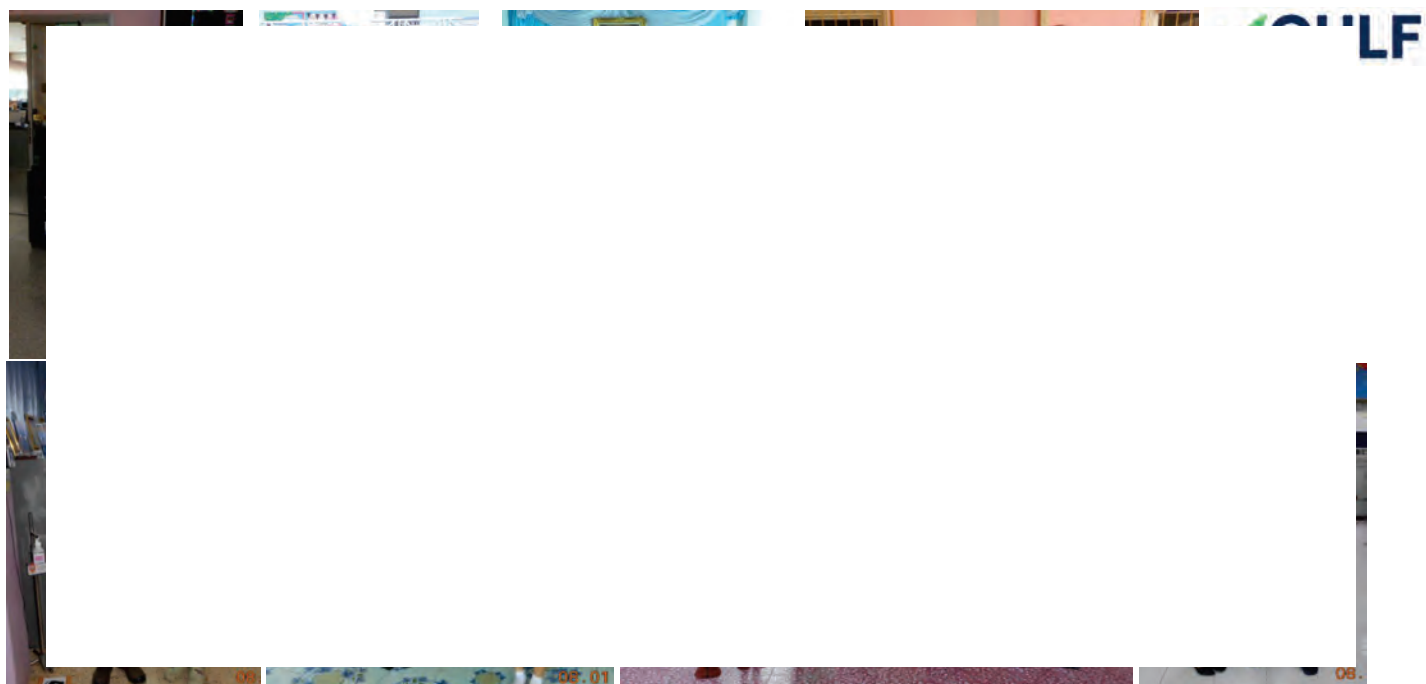

โรงไฟฟ้าเชียงรากน้อย สนับสนุนของรางวัล กิจกรรมวันเด็ก

## โรงไฟฟ้าเชิงรากล้อย สนับสนุนกิจกรรมชุมชน และหน่วยงานราชการ

ที่ ศช ๐๐๑๖.๕๒๖/๒๕๖๓



สำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อม  
กรมทรัพยากรธรณี  
คำชะโนด อำเภอนิคมพัฒนา  
จังหวัดชลบุรี ๒๒๐๐๐

๒๓ พฤษภาคม ๒๕๖๓

เรื่อง ขอขอบคุณ

เรียน ผู้จัดการบริษัท กอล์ฟ เจที ซีอาร์เอ็ม จำกัด

ตามที่ บริษัท กอล์ฟ เจที ซีอาร์เอ็ม จำกัด ได้สนับสนุนงบประมาณให้สำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อมจังหวัดชลบุรี เพื่อเป็นค่าใช้จ่ายในการดำเนินงานเพื่อสนับสนุนการจัดตั้งศูนย์การเรียนรู้ "ศูนย์เรียนรู้วิถีชีวิตและธรรมชาติในชุมชน" ประจำปี ๒๕๖๓ เพื่อสร้างขวัญกำลังใจและสร้างความรู้ความเข้าใจในชุมชน ส่งเสริมให้ประชาชนได้เรียนรู้วิถีชีวิตและธรรมชาติในชุมชน โดยจัดการแข่งขันระหว่างเดือน มิถุนายน ถึง เดือน สิงหาคม ๒๕๖๓ หรือจนเสร็จสิ้นการแข่งขัน นั้น

สำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อมจังหวัดชลบุรี ได้รับการสนับสนุนงบประมาณจากกลุ่ม บริษัท กอล์ฟ เจที ซีอาร์เอ็ม จำกัด เพื่อเป็นค่าใช้จ่ายในการดำเนินงานโครงการดังกล่าวแล้ว ซึ่งขอขอบคุณ ณ โอกาสนี้ และหวังเป็นอย่างยิ่งว่าคงจะได้มีความผูกพันทำงานอีก ในโอกาสต่อไป

ขอแสดงความนับถือ

ส่ง

รองผู้จัดการสำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อม  
ผู้อำนวยการสำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อม  
ผู้อำนวยการแผนก ผู้บังคับการจังหวัดชลบุรี

ฝ่ายอำนวยการ สำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อม  
โทร. ๐ ๒๕๔๖ ๓๖๖๖ โทรสาร ๐ ๒๕๔๖ ๓๖๖๖

ที่ ศช ๐๐๑๖.๕๒๖/๒๕๖๓



สถานีตำรวจภูธรสามโคก  
ตำบลคลองทราย อำเภอสามโคก  
จังหวัดปทุมธานี ๑๒๑๖๐

๑๖ พฤษภาคม ๒๕๖๓

เรื่อง ขอขอบคุณ

เรียน ผู้จัดการโรงไฟฟ้า บริษัท กอล์ฟ เจที ซีอาร์เอ็ม จำกัด (โรงไฟฟ้าเชิงรากล้อย)

ตามที่ท่านได้ให้การสนับสนุนงบประมาณ แก่สถานีตำรวจภูธรสามโคก โครงการแข่งขันฟุตบอลสมัครใจ "ตำรวจภูธรจังหวัดปทุมธานี ศพ" ประจำปี พ.ศ.๒๕๖๓ รวมมูลค่า ๓๐,๐๐๐ บาท (หนึ่งหมื่นบาทถ้วน) โดยจัดการแข่งขันระหว่างเดือน มิถุนายน - สิงหาคม ๒๕๖๓ หรือจนเสร็จสิ้นการแข่งขัน นั้น

สถานีตำรวจภูธรสามโคก ได้รับการสนับสนุนงบประมาณดังกล่าว และขอขอบคุณท่านเป็นอย่างสูง ณ โอกาสนี้และหวังว่าจะได้รับการสนับสนุนจากท่านเป็นอย่างดียิ่งต่อไป

จึงเรียนมาเพื่อโปรดทราบ

ทำ

ผู้กำกับการสถานีตำรวจภูธรสามโคก

สถานีตำรวจภูธรสามโคก  
โทร ๐๒ ๕๖๓ ๓๓๓๓  
โทรสาร ๐๒ ๕๖๓ ๓๓๓๓  
ผู้ประสานงาน ร.ต.อ.สันติ ศาสตร์บุญ รร. สว.ส.สามโคก โทร.๐๒๕๔ ๓๖๖๖ ๐๒๕๔ ๓๖๖๖

## โรงไฟฟ้าเชิงรากล้อย สนับสนุนกิจกรรมสถานีตำรวจภูธรปทุมธานี / สามโคก

ที่ ปท ๐๒๗๓ / ๗๖๗



สำนักงานสาธารณสุขุสามโคก  
ค.สามโคก อ.สามโคก จ.ปทุมธานี  
๑๒๑๒๐

๑๑ มิถุนายน ๒๕๖๗

เรื่อง ขอขอบคุณ

เรียน ผู้จัดการโรงไฟฟ้า บริษัท กัลฟ์ เจที ซีอาร์เอ็น จำกัด

ตามที่ สำนักงานสาธารณสุขุสามโคก ได้ขอสนับสนุนงบประมาณในการจัดทำโครงการพัฒนา  
ศักยภาพบุคลากรสาธารณสุขุ ในสังกัด ให้มีองค์ความรู้ พัฒนาระบบสุขภาพของพื้นที่ ตาม ทรบ.ระบบสุขภาพปทุม  
ธานี พ.ศ.๒๕๖๒ คำนึงถึงการดูแลประชาชน เพื่อให้ประชาชนได้รับบริการสุขภาพปฐมภูมิที่มีประสิทธิภาพ มีความเป็น  
ธรรม มีคุณภาพ และมีมาตรฐาน ซึ่งความสอดคล้องกับพันธกิจที่ได้ในมาตรา ๒๖ ของรัฐธรรมนูญ ปี ๒๕๖๐ แล้วนั้น

ในการนี้ สำนักงานสาธารณสุขุสามโคก ได้วิเลสนับสนุนงบประมาณดังกล่าว จากโรงไฟฟ้า  
บริษัท กัลฟ์ เจที ซีอาร์เอ็น จำกัด เรียบร้อยแล้ว เพื่อเป็นค่าใช้จ่ายกิจกรรมโครงการฯ ดังกล่าว

จึงเรียนมาเพื่อโปรดทราบ และขอขอบพระคุณท่านเป็นอย่างสูง

ขอแสดงความนับถือ

สาธารณสุขุสามโคก

สำนักงานสาธารณสุขุสามโคก  
โทร./โทรสาร ๐๒-๕๖๓๓๓๕๐



โรงไฟฟ้าเชียงรากน้อย สนับสนุนกิจกรรม สำนักงานสาธารณสุขสามโคก

# ภาคผนวก ข-13

---

เอกสารการติดตั้งท่อชักน้ำดิบ








## ภาคผนวก ข-14

---

กฎระเบียบการจราจรภายในโรงไฟฟ้า

## สถานที่ในโรงไฟฟ้า Site Layout and Restrict Area

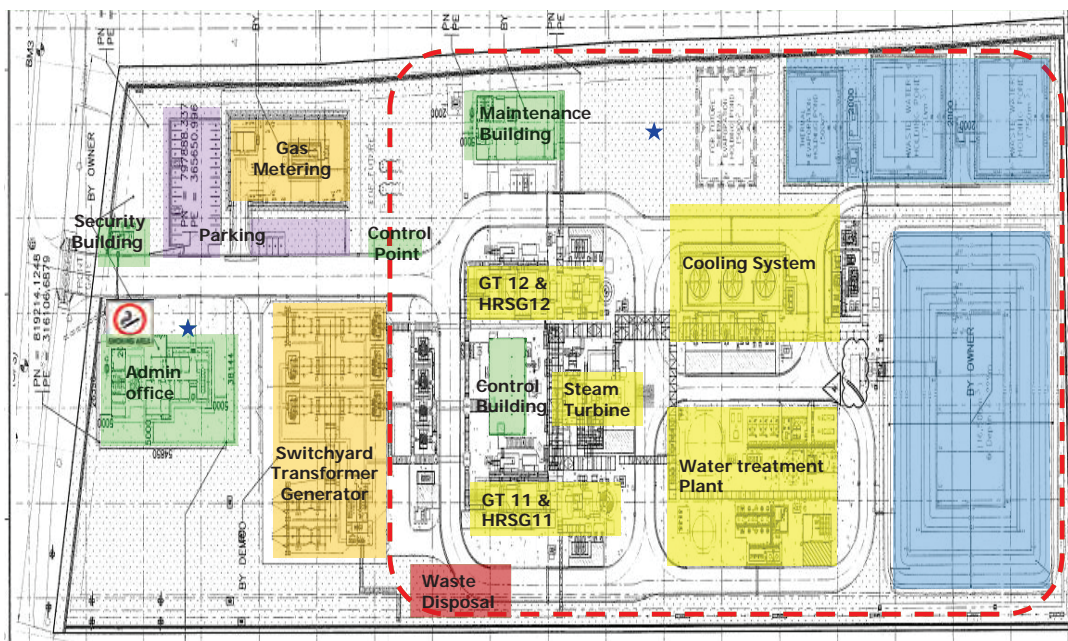


## Safety Induction


### การเข้า-ออกโรงไฟฟ้า Access Control

- ก่อนนำรถเข้า ให้ติดต่อ รปภ. เพื่อแจ้งชื่อหน่วยงาน วัตถุประสงค์ ผู้ที่จะติดต่อ และแลกบัตรเพื่อรับใบขอเข้าบริเวณ โรงไฟฟ้า และต้องให้ผู้ที่จะติดต่อดลงลายมือชื่อก่อนกลับออกจากโรงไฟฟ้า คืนให้กับ รปภ.
- ผู้เข้าโรงไฟฟ้าจะต้องติดต่อลงชื่อ เข้า-ออก ที่ป้อมจุดตรวจทางเข้าโรงไฟฟ้า และแลกบัตร Contractor กับ รปภ. ทุกคน ซึ่งผู้รับเหมาจะต้องติดบัตรไว้ในที่เห็นได้ชัดเจนตลอดเวลาที่อยู่ในโรงไฟฟ้า (อนุญาตให้แลกบัตรประชาชน 1 ใบ/1 กลุ่ม)
- หากเข้าทำงานในพื้นที่ควบคุม ผู้รับเหมาจะต้องลงเวลาเข้า-ออกทุกครั้งที่มีป้อม รปภ. ทางเข้าพื้นที่ควบคุม
- Contact Security to grant Authorization Form, and must be signed by GCRN staff before leaving.
- All contractors must register to guard house to grant Contractor Pass Card which must be posted all time while staying/working in the power plant. (1 ID Card/1 group)
- To access restricted area, contractors must register to guard house at the entrance again.

ใบอนุญาตผ่าน VISITOR / VEHICLE GATE PASS		หมายเลขบัตรผู้มาติดต่อ VISITOR CARD NO.
ชื่อ - สกุล Name - Surname	วันที่เข้า Date In	
บัตรประจำตัวประชาชนเลขที่ / ใบอนุญาตขับรถเลขที่ Identification No. / Driving License No.	ทะเบียนยานพาหนะ Vehicle Registration	
ชื่อบริษัทผู้มาติดต่อ Company's Name		
วัตถุประสงค์การติดต่อ Objective		
ผู้รับการติดต่อ / สถานที่ To Meet Location	แผนก Section	
เวลาเข้า (Time In)	เวลาออก (Time Out)	
ผู้มาติดต่อ Visitor's Signature	พนักงานรักษาความปลอดภัย Security Guard's Signature	ผู้อนุญาตให้เข้าพบ Authorized Person




## การเข้า-ออกโรงไฟฟ้า Site Access

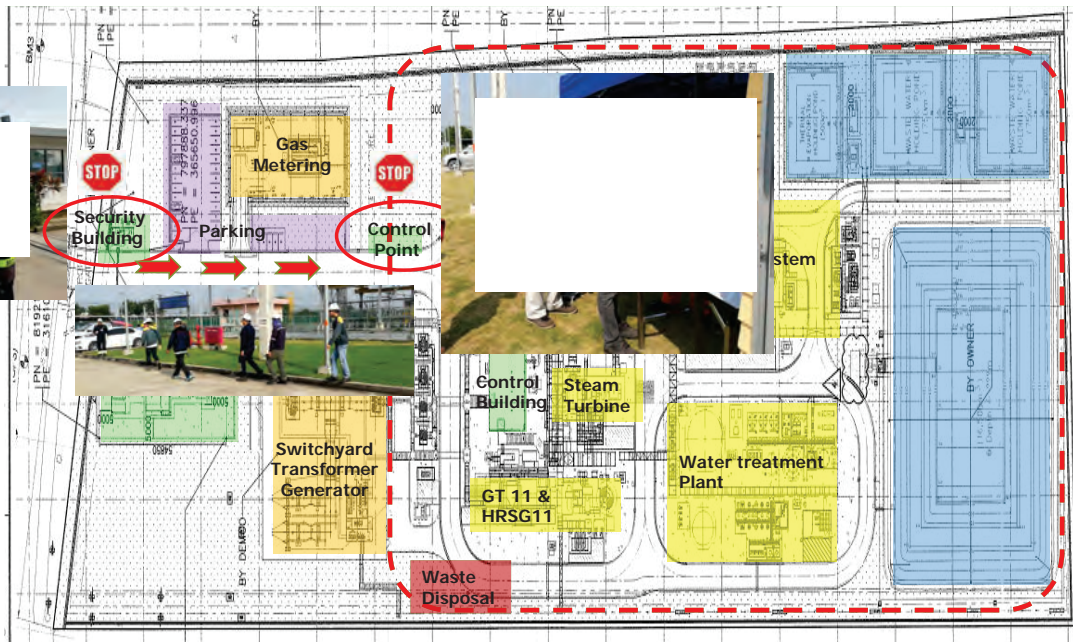


## Safety Induction

### Restrict Area

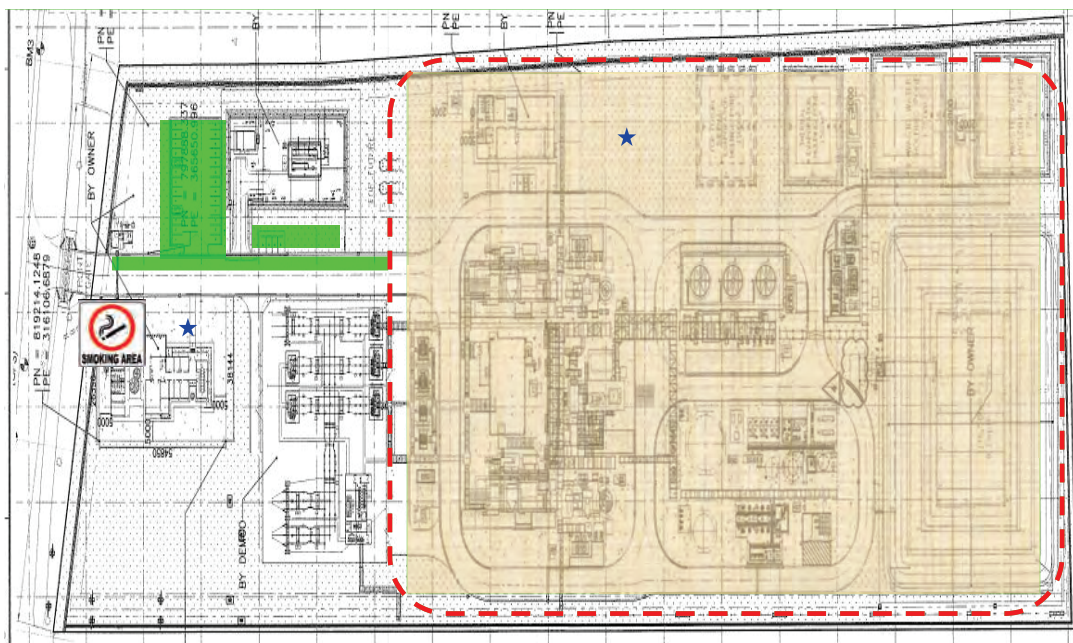

- Restrict Area / No Parking Area
- Parking Area
- ★ Assembly Point

## กฎจราจร

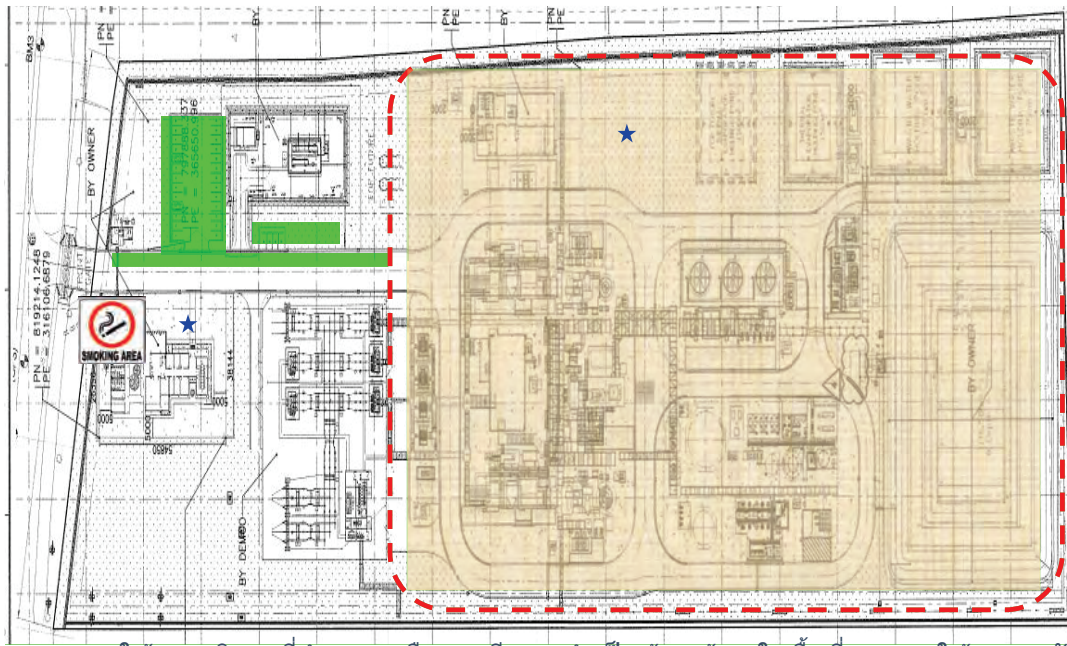

- No Parking Area
- Parking Area

การจอดรถ ให้จอดรถบริเวณที่กำหนด หรือหากมีความจำเป็นต้องเข้ามาในพื้นที่ควบคุม ให้จอดรถหันหน้าออกนอกอาคาร ไม่กีดขวางอุปกรณ์ดับเพลิง ที่เก็บสารเคมี และไม่กีดขวางการจราจร กำหนดความเร็วรถยนต์ที่ถนนหลัก ไม่เกิน 20 กม/ชม และในบริเวณถนนในพื้นที่เขตผลิต และ ไม่เกิน 10 กม/ชม

# ภาคผนวก ข-15

สถิติอุบัติเหตุ

ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567

## รายงานสรุปความปลอดภัยในการทำงาน

### 1. สถิติความปลอดภัยในการทำงาน (After COD July 1<sup>st</sup>, 2014)

เดือน	สถิติความปลอดภัยในการทำงาน	
	Man day (สะสม)	Man hour (สะสม)
มกราคม 2567	679	5,539
กุมภาพันธ์ 2567	661	5,121
มีนาคม 2567	699	5,430
เมษายน 2567	630	4,909
พฤษภาคม 2567	669	5,381
มิถุนายน 2567	650	5,344
กรกฎาคม 2567		
สิงหาคม 2567		
กันยายน 2567		
ตุลาคม 2567		
พฤศจิกายน 2567		
ธันวาคม 2567		
<b>รวม ณ สิ้นเดือนมิถุนายน 2567</b>	<b>91,847</b>	<b>792,869</b>

หมายเหตุ การนับสถิติเริ่มตั้งแต่เดือนแรกที่มีการทำงาน โดยแต่ละโครงการจะแตกต่างกัน ทั้งนี้ ข้อมูลจะต้องเหมือนกับรายงานที่ทางโครงการจัดส่งให้ทางผู้บริหารรับทราบ (weekly report, Monthly report)

## 2. รายละเอียดการเกิดอุบัติเหตุ ปี 2567

รายละเอียด	ม.ค.	ก.พ.	มี.ค.	เม.ย.	พ.ค.	มิ.ย.	ก.ค.	ส.ค.	ก.ย.	ต.ค.	พ.ย.	ธ.ค.	รวม
Death	0	0	0	0	0	0							0
Permanent Disable	0	0	0	0	0	0							0
Lost organ	0	0	0	0	0	0							0
Stop work over 3 day	0	0	0	0	0	0							0
Stop work not exceed 3 day	0	0	0	0	0	0							0
First Aid Case	0	0	0	0	0	0							0
Near miss	0	0	0	0	0	0							0

หมายเหตุ การนับสถิติเริ่มตั้งแต่เดือนแรกที่มีการทำงานโดยแต่ละโครงการจะแตกต่างกัน ทั้งนี้ ข้อมูลจะต้องถูกต้องกับความเป็นจริง จนถึงเดือนมิถุนายน 2567

### 3. รายละเอียดการเกิดอุบัติเหตุแต่ละประเด็น

ประเด็น	วัน เดือน ปี ที่เกิด เหตุการณ์	รายละเอียดเหตุการณ์
Death	0	-
Permanent Disable	0	-
Lost organ	0	-
Stop work over 3 day	0	-
Stop work not exceed 3 day	0	-
First Aid Case	0	-
Near miss	0	-

หมายเหตุ ให้แสดงข้อมูลอย่างคร่าวๆ แต่ตรงตามความเป็นจริง และครบถ้วนทุกกรณีที่เกิดขึ้น นับจนถึง  
เดือนมิถุนายน 2567

## ภาคผนวก ข-16

---

แบบบันทึกปริมาณยานพาหนะที่เข้า-ออก โรงไฟฟ้า  
ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567



ที่	บันทึกเวลาเข้า	บันทึกเวลาออก	ระยะเวลา(ชั่วโมง)
1	05:34:47	19:03:16	13:28
2	05:51:29	19:03:55	13:12
3	05:52:32	19:03:26	13:10
4	06:22:10	19:08:06	12:45
5	06:36:12	19:03:47	12:27
6	06:37:20	16:01:29	09:24
7	06:40:01	17:05:20	10:25
8	06:50:36	19:21:39	12:31
9	06:57:22	17:07:40	10:10
10	07:01:55	17:02:06	10:00
11	07:02:04	19:03:31	12:01
12	07:07:17	17:00:55	09:53
13	07:09:43	18:01:12	10:51
14	07:16:41	17:02:02	09:45
15	07:20:41	17:01:46	09:41
16	07:23:59	17:06:32	09:42
17	07:24:22	12:06:51	04:42
18	07:25:59	17:00:27	09:34
19	07:30:37	18:18:13	10:47
20	07:37:35	17:01:50	09:24
21		07:39:23	
22	07:40:23	17:48:29	10:08
23	07:40:41	17:07:59	09:27
24	07:43:54	17:56:45	10:12
25	07:44:11	17:22:29	09:38
26	07:45:05	17:00:12	09:15
27	07:45:19	17:48:00	10:02
28	07:46:13	17:34:19	09:48
29	07:48:10	17:00:43	09:12
30	07:48:48	17:07:22	09:18
31	07:57:19	17:13:02	09:15
32	07:57:39	17:32:54	09:35
33	07:59:36	15:03:02	07:03
34	08:01:55	17:14:46	09:12
35	08:02:12	17:12:43	09:10
36	08:02:28	17:31:35	09:29
37	08:04:37	17:47:09	09:42
38	08:08:57	17:18:09	09:09
39	08:09:10	17:10:54	09:01
40	08:09:59	18:00:10	09:50
41	08:15:55	17:30:13	09:14
42	08:19:37	19:23:01	11:03
43	08:20:12	17:06:44	08:46
44	08:29:39	17:49:11	09:19
45	08:35:02	17:40:13	09:05
46	08:43:18	13:47:34	05:04
47	08:51:45	09:41:23	00:49
48	09:02:05	13:46:53	04:44
49	09:04:46	16:40:32	07:35
50	09:05:03	16:40:39	07:35
51	09:05:11	16:40:46	07:35
52	09:05:24	16:40:54	07:35
53	09:05:48	16:40:59	07:35
54	09:06:11	16:41:05	07:34
55	09:08:05	10:08:37	01:00
56	09:35:29	10:17:15	00:41
57	09:35:37	10:16:56	00:41
58	10:25:03	11:59:31	01:34
59	10:25:13	11:57:30	01:32
60	10:25:31	11:57:50	01:32
61	10:25:49	11:58:07	01:32
62	10:25:55	11:58:35	01:32
63	10:26:06	11:58:55	01:32
64	10:26:17	11:59:23	01:33
65	10:51:19	11:11:22	00:20
66	15:54:42	16:55:39	01:00
67		16:40:21	
68		16:40:42	
69	17:46:42	07:01:33	-10:45
70	18:06:01	07:01:13	-11:04
71	18:09:12	07:01:52	-11:07
72	18:09:44	07:01:41	-11:08
73	18:29:37		
74	18:58:17	07:43:22	-11:14
75	19:02:25	07:38:37	-11:23
76		19:23:59	

# ภาคผนวก ข-17

---

เอกสารการส่งกำจัดขยะมูลฝอย



ใบเสร็จรับเงิน

เลขที่ RCPT-00500/67

วันที่ 25 มกราคม 2567

องค์การบริหารส่วนตำบลเชิงรึกน้อย

ได้รับเงินจาก บริษัทกอล์ฟ เจพี ซี อาร์ เอ็น จำกัด

ลำดับ	รายการ	รหัสบัญชี	จำนวนเงิน (บาท)	หมายเหตุ
	ที่อยู่ 59/4 ม.4 ม.- ซ.- ถ.เชิงรึกน้อย อ.สาม โคก จ.ปทุมธานี			
1	ค่าธรรมเนียมเก็บและขนมูลฝอย	4401030106.001	2,000.00	ประจำเดือน มค 67
รวมเงิน			2,000.00	

ตัวอักษร (สองพันบาทถ้วน )

ไว้เป็นการถูกต้องแล้ว

ลงชื่อ

ผู้รับเงิน

ผู้ช่วยนักจัดการงานทั่วไป

เงินโอนเข้าบัญชีธนาคารกรุงไทย จำกัด (มหาชน) สาขาอำเภอสามโคก เลขที่บัญชี 1341035581 : 2,000.00 บาท  
วันที่ 25 มกราคม 2567

รวม : 2,000.00 บาท

PAID



ใบเสร็จรับเงิน

เลขที่ RCPT-00590/67

วันที่ 29 กุมภาพันธ์ 2567

องค์การบริหารส่วนตำบลเชิงรึกน้อย

ได้รับเงินจาก บริษัทกอล์ฟ เจพี ซี อาร์ เอ็น จำกัด

ลำดับ	รายการ	รหัสบัญชี	จำนวนเงิน (บาท)	หมายเหตุ
	ที่อยู่ 59/4 ม.4 ม.- ซ.- ถ.เชิงรึกน้อย อ.สาม โคก จ.ปทุมธานี			
1	ค่าธรรมเนียมเก็บและขนมูลฝอย	4401030106.001	2,000.00	ประจำเดือน ก.พ 67
รวมเงิน			2,000.00	

ตัวอักษร (สองพันบาทถ้วน )

ไว้เป็นการถูกต้องแล้ว

ลงชื่อ

ผู้รับเงิน

ผู้ช่วยนักจัดการงานทั่วไป

PAID



ใบเสร็จรับเงิน

เลขที่ RCPT-00803/67

วันที่ 17 พฤษภาคม 2567

องค์การบริหารส่วนตำบลเชิงรวกน้อย

ได้รับเงินจาก บริษัทกอล์ฟ เจพี ซี อาร์ เอ็น จำกัด

ลำดับ	รายการ	รหัสบัญชี	จำนวนเงิน (บาท)	หมายเหตุ
	ที่อยู่ 59/4 ม.4 น.- ซ.- ถ.- ต.เชิงรวกน้อย อ.สาม โคก จ.ปทุมธานี			
1	ค่าธรรมเนียมเก็บและขนมูลฝอย	4401030106.001	2,000.00	ประจำเดือน มี.ค 67
รวมเงิน			2,000.00	

ตัวอักษร (สองพันบาทถ้วน)

ไว้เป็นการถูกต้องแล้ว

ลงชื่อ

ผู้รับเงิน

ผู้ช่วยนักจัดการงานทั่วไป

เงินโอนเข้าบัญชีธนาคารกรุงไทย จำกัด (มหาชน) สาขาอำเภอสามโคก เลขที่บัญชี 1341035581 : 2,000.00 บาท  
วันที่ 17 พฤษภาคม 2567  
รวม : 2,000.00 บาท



ใบเสร็จรับเงิน

เลขที่ RCPT-00804/67

วันที่ 17 พฤษภาคม 2567

องค์การบริหารส่วนตำบลเชิงรวกน้อย

ได้รับเงินจาก บริษัทกอล์ฟ เจพี ซี อาร์ เอ็น จำกัด

ลำดับ	รายการ	รหัสบัญชี	จำนวนเงิน (บาท)	หมายเหตุ
	ที่อยู่ 59/4 ม.4 น.- ซ.- ถ.- ต.เชิงรวกน้อย อ.สาม โคก จ.ปทุมธานี			
1	ค่าธรรมเนียมเก็บและขนมูลฝอย	4401030106.001	2,000.00	ประจำเดือน เม.ย 67
รวมเงิน			2,000.00	

ตัวอักษร (สองพันบาทถ้วน)

ไว้เป็นการถูกต้องแล้ว

ลงชื่อ

ผู้รับเงิน

ผู้ช่วยนักจัดการงานทั่วไป

เงินโอนเข้าบัญชีธนาคารกรุงไทย จำกัด (มหาชน) สาขาอำเภอสามโคก เลขที่บัญชี 1341035581 : 2,000.00 บาท  
วันที่ 17 พฤษภาคม 2567  
รวม : 2,000.00 บาท



ใบเสร็จรับเงิน

เลขที่ RCPT-00805/67  
วันที่ 17 พฤษภาคม 2567

องค์การบริหารส่วนตำบลเชิงรึกน้อย

ได้รับเงินจาก บริษัท กัลป์ เจพี ซี อาร์ เอ็น จำกัด

ลำดับ	รายการ	รหัสบัญชี	จำนวนเงิน (บาท)	หมายเหตุ
	ที่อยู่ 59/4 ม.4 ม.- ซ.- ถ.- ต.เชิงรึกน้อย อ.สามโคก จ.ปทุมธานี			
1	ค่าธรรมเนียมเก็บและขนมูลฝอย	4401030106.001	2,000.00	ประจำเดือน พ.ค 67
รวมเงิน			2,000.00	
ตัวอักษร (สองพันบาทถ้วน )				
ไว้เป็นการถูกต้องแล้ว		ลงชื่อ	ผู้รับเงิน	
			ผู้ช่วยนักจัดการงานทั่วไป	
เงินโอนเข้าบัญชีธนาคารกรุงไทย จำกัด (มหาชน) สาขาอำเภอสามโคก เลขที่บัญชี 1341035581				2,000.00 บาท
วันที่ 17 พฤษภาคม 2567				
รวม :			2,000.00	บาท



ใบเสร็จรับเงิน

เลขที่ RCPT-00905/67  
วันที่ 25 มิถุนายน 2567

องค์การบริหารส่วนตำบลเชิงรึกน้อย

ได้รับเงินจาก บริษัท กัลป์ เจพี ซี อาร์ เอ็น จำกัด

ลำดับ	รายการ	รหัสบัญชี	จำนวนเงิน (บาท)	หมายเหตุ
	ที่อยู่ 59/4 ม.4 ม.- ซ.- ถ.- ต.เชิงรึกน้อย อ.สาม โคก จ.ปทุมธานี			
1	ค่าธรรมเนียมเก็บและขนมูลฝอย	4401030106.001	2,000.00	ค่าขยะประจำเดือน มิถุนายน 2567
รวมเงิน			2,000.00	

ตัวอักษร (สองพันบาทถ้วน)

ไว้เป็นการถูกต้องแล้ว

ลงชื่อ

รับเงิน

นักวิชาการเงินและบัญชีชำนาญการ

## ภาคผนวก ข-18

---

หนังสือขออนุญาตนำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว  
ออกนอกบริเวณโรงงาน



หนังสือแจ้งผลการพิจารณา

การขออนุญาตให้นำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน

กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035

หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ

บริษัท กัลฟ์ เจพี ซีโอาร์เอ็น จำกัด

ทะเบียนโรงงานเลขที่ 10130005825545

โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดการ	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกอนสนิมจากหม้อไอน้ำ	0.007	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	11.860	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	8.232	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.260	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.067	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.167	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	7.628	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	2.333	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	6.920	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.067	042	10190186525629	
11	160215	หลอดฟลูออเรสเซนต์ใช้แล้ว	0.238	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.167	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.033	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	1.280	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.580	042	10250004625603	
16	170405	เศษเหล็ก	0.333	011	10190163025627	
17	170603	จนวนก้นความร้อน	1.108	042	10250004625603	
18	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	13.334	042	10250004625603	
19	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	16.872	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	221.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	40.962	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.400	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	10.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 มกราคม 2567 ถึงวันที่ 31 ธันวาคม 2567

ออกให้ ณ วันที่ 1 มกราคม 2567

โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์

รหัสการจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว

- 011 คัดแยกประเภทเพื่อจำหน่ายต่อ (sorting)  
021 เก็บเก็บในภาชนะบรรจุ (storage) ให้ระบุลักษณะการเก็บและภาชนะบรรจุ  
031 นำกลับมาใช้ซ้ำ (reuse) ตามวัตถุประสงค์เดิมของวัสดุที่ไม่ใช่แล้วอื่น ๆ  
032 ส่งกลับผู้ขายเพื่อกำจัด (return to original producer for disposal) ให้ระบุชื่อผู้ขายที่รับคืน  
033 นำบรรจุคืนเพื่อกลับไปบรรจุใหม่หรือใช้ซ้ำ (reuse container; to be refilled) ให้ระบุชื่อผู้ขายที่รับคืน  
039 นำกลับมาใช้ซ้ำด้วยวิธีอื่น ๆ (other reuse methods) ตามวัตถุประสงค์เดิมของวัสดุที่ไม่ใช่แล้วนั้น ๆ ให้ระบุ  
041 ใช้เป็นเชื้อเพลิงทดแทน (use as fuel substitution or burn for energy recovery) โดยตรงในเตาเผา (incinerator) หรือเตาอุตสาหกรรมซีเมนต์ (cement industrial furnace)  
042 ทำเชื้อเพลิงผสม (fuel blending) เพื่อนำมาใช้เป็นเชื้อเพลิงสำหรับเตาเผา (incinerator) เตาอุตสาหกรรมซีเมนต์ (cement industrial furnace) หรือหม้อไอน้ำและเตาอุตสาหกรรม (boiler and industrial furnace) ระบุปลายทาง  
043 เตาเพื่อใช้เป็นพลังงาน (burn for energy recovery) เฉพาะวัสดุที่ไม่ใช่แล้วที่ไม่เป็นของเสียอันตรายสำหรับเตาไฟ (stove) หรือหม้อไอน้ำและเตาอุตสาหกรรม (boiler and industrial furnace)  
044 ใช้เป็นวัตถุดิบทดแทน (use as raw material substitution) ในเตาอุตสาหกรรมซีเมนต์ (cement industrial furnace)  
045 ทำวัสดุผสม (material blending) เพื่อใช้เป็นวัตถุดิบทดแทน (use as raw material substitution) ในเตาอุตสาหกรรมซีเมนต์ (cement industrial furnace) ระบุปลายทาง  
046 ทำเชื้อเพลิงทดแทนจากรวัสดุที่ไม่ใช่แล้วที่ไม่เป็นของเสียอันตราย สำหรับเตาอุตสาหกรรม เพื่อใช้ผลิตกระแสไฟฟ้าโดยเฉพาะ (use as fuel blending for energy recovery) ระบุปลายทาง  
047 ใช้วัสดุที่ไม่ใช่แล้วที่ไม่เป็นของเสียอันตราย เพื่อใช้เป็นเชื้อเพลิงทดแทนโดยตรงในเตาเผา (incinerator) เพื่อผลิตกระแสไฟฟ้า  
048 ใช้วัสดุที่ไม่ใช่แล้วที่เป็นของเสียอันตราย เพื่อใช้เป็นเชื้อเพลิงทดแทนโดยตรง ในเตาเผา (incinerator) เพื่อผลิตกระแสไฟฟ้า  
049 นำกลับมาใช้ประโยชน์อีกด้วยวิธีอื่น ๆ (other recycle methods)  
051 เข้ากระบวนการนำตัวทำละลายกลับมาใช้ใหม่ (solvent reclamation/regeneration)  
052 เข้ากระบวนการนำโลหะกลับมาใช้ใหม่ (reclamation/regeneration of metal and metal compounds)  
053 เข้ากระบวนการคืนสภาพกรด/ด่าง (acid/base regeneration)  
054 เข้ากระบวนการคืนสภาพตัวเร่งปฏิกิริยา (catalyst regeneration)  
055 เข้ากระบวนการคืนสภาพ ถ่านกัมมันต์ใช้งานแล้ว (spent activated carbon regeneration)  
056 เข้ากระบวนการคืนสภาพเรซินหรือเมมเบรนที่ใช้ไปแล้ว (spent resin or membrane regeneration)

เหตุผลกรณีอื่นๆ

- 01 ผู้รับดำเนินการไม่ได้รับอนุญาตให้ นำบัต/ กำจัด/นำกลับไปใช้ประโยชน์ใหม่  
02 วิธีการนำบัต/กำจัด/นำกลับไปใช้ประโยชน์ใหม่ ไม่เหมาะสม  
03 ผู้รับดำเนินการได้รับคำสั่งปรับปรุงตามมาตร 37 หรือเหตุผลประกอบกิจการตามมาตรา 39 ตามพระราชบัญญัติโรงงาน  
04 ผู้รับดำเนินการไม่ยินยอมรับนำบัต/กำจัด/นำกลับไปใช้ประโยชน์ใหม่  
05 ไม่สามารถยื่นขออนุญาตฯ ผ่านสื่ออิเล็กทรอนิกส์ได้  
06 ผู้ให้บริการยังไม่ได้แจ้งประกอบกิจการโรงงาน หรือไม่ได้แจ้งประกอบในส่วนขยาย  
07 ไม่เข้าข่ายต้องขออนุญาตตามประกาศกระทรวงอุตสาหกรรมเรื่องการจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว พ.ศ. 2566

เหตุผลการไม่อนุญาต

99 อื่นๆ เช่น.....

- 057 เข้ากระบวนการคืนสภาพทรายหล่นแบบที่ใช้ไปแล้ว (spent green sand / no bake sand regeneration)  
059 นำวัสดุที่ไม่ใช่แล้วอื่น ๆ กลับคืนมาใช้ใหม่ (other recovery unlisted materials) ให้ระบุ  
061 นำบัตด้วยวิธีชีวภาพ (biological treatment) หรือวิธีเคมีชีวภาพ (chemical biological treatment)  
062 นำบัตด้วยวิธีชีวภาพ (biological treatment) เพื่อใช้กำจัดชีวภาพหรือกำจัดโลหะหนักเป็นพลังงาน  
063 นำบัตด้วยวิธีทางเคมี (chemical treatment) หรือนำบัตด้วยวิธีทางกายภาพ (physical treatment) หรือนำบัตด้วยวิธีทางเคมีกายภาพ (physico-chemical treatment)  
065 นำบัตน้ำเสียด้วยวิธีทางเคมีกายภาพ (physico-chemical treatment of wastewater)  
066 เขาระบวนำบัตน้ำเสียรวม (discharge into central wastewater treatment plant)  
067 ปรับเปลี่ยนด้วยวิธีทางเคมี (chemical stabilization)  
068 ปรับเปลี่ยนหรือตรึงทางเคมีโดยใช้ขี้เถ้าหรือวัสดุ pozzolanic (chemical fixation using cementitious and/or pozzolanic material)  
069 ใช้วิธีบำบัดอื่น ๆ เพื่อทำลายความเป็นพิษ (other detoxification methods) ให้ระบุ  
071 สกปรกตามหลักสุขาภิบาล (sanitary landfill) เฉพาะสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว ที่ไม่เป็นของเสียอันตรายเท่านั้น  
072 สกปรกอย่างปลอดภัย (secure landfill)  
073 สกปรกอย่างปลอดภัย เมื่อทำการปรับเสถียรหรือทำให้เป็นก้อนแข็งแล้ว (secure landfill of stabilized and/or solidified wastes)  
074 เผาทำลาย (burn for destruction) ในเตาเผาขยะชุมชน หรือเตาเผาเฉพาะสำหรับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วที่ไม่เป็นของเสียอันตรายเท่านั้น  
075 เผาทำลายในเตาเผาเฉพาะสำหรับของเสียอันตราย (burn for destruction in hazardous waste incinerator)  
076 เผาทำลายร่วมในเตาอุตสาหกรรมซีเมนต์ (co-incineration in cement kiln)  
077 ฉีดฉีดลงบ่อใต้ดิน หรือฉีดใต้ทะเล (deep well or underground injection; sea-bed insertion)  
079 กำจัดด้วยวิธีอื่น ๆ (other disposal methods) ให้ระบุ  
081 รวบรวมและส่งออกนอกประเทศ (collect and export)  
082 ถมทะเลหรือฟื้นฟู (land reclamation) เฉพาะวัสดุที่ไม่ใช่แล้วที่ไม่เป็นของเสียอันตรายเท่านั้น  
083 หมักทำปุ๋ยหรือสารปรับปรุงคุณภาพดิน (composting or soil conditioner) เฉพาะสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วที่ไม่เป็นของเสียอันตรายเท่านั้น  
084 ให้อาหารสัตว์ (animal feed) เฉพาะสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วที่ไม่เป็นของเสียอันตรายเท่านั้น  
085 ศึกษา วิจัยและพัฒนา (study research and develop) เพื่อการทดลองในลักษณะโครงการนำร่องเท่านั้น

เหตุผลที่ไม่สามารถพิจารณาได้ เนื่องจากขาดเอกสาร หรือเอกสารไม่สมบูรณ์/ ดังนี้

- 11 สำเนาขออนุญาตประกอบกิจการโรงงานของผู้รับดำเนินการ และหรือ ผู้ถือกำเนิดวัสดุที่ไม่ใช่แล้ว  
12 สำเนาหนังสือรับรองจดทะเบียนนิติบุคคลของผู้รับดำเนินการ และหรือ ผู้ถือกำเนิดวัสดุที่ไม่ใช่แล้ว  
13 สัญญาหรือหนังสือยินยอมการรับบริการระหว่างผู้รับดำเนินการและ ผู้ถือกำเนิดวัสดุที่ไม่ใช่แล้ว  
14 หนังสือการประกันความรับผิด (Liability) ระหว่างผู้รับดำเนินการและ ผู้ถือกำเนิดวัสดุที่ไม่ใช่แล้ว  
15 หนังสือมอบอำนาจให้ผู้อื่นทำนิติกรทำการใดๆ แทนกรรมการผู้มีอำนาจพร้อมติดอากรแสตมป์ของผู้รับดำเนินการ และหรือ ผู้ถือกำเนิดวัสดุที่ไม่ใช่แล้ว  
16 ผลวิเคราะห์ค่าความเข้มข้นทั้งหมดของสิ่งเจือปน (total concentration : mg/kg)  
17 ผลวิเคราะห์ด้วยวิธีการสกัดสาร (waste extraction test : mg/l)  
18 รายละเอียดกระบวนการผลิตพร้อมแสดงจุดที่เกิดของเสีย  
19 รายละเอียดกระบวนการของเสียมากำจัด/นำบัต/นำกลับมาใช้ประโยชน์ใหม่  
20 สำเนาใบอนุญาตส่งออกรีดอุตสาหกรรม (วอ.6)  
21 หนังสือรับรองจากกรมวิชาการเกษตรในการทำปุ๋ยหรือสารปรับปรุงคุณภาพดิน  
22 รหัสประเภทหรือชนิดหรือวัสดุที่ไม่ใช่แล้วไม่ถูกต้อง  
23 รหัสการจัดการไม่ถูกต้อง  
24 การลงนามของกรรมการผู้มีอำนาจในคำขอ/สัญญา ไม่ครบถ้วนตามเงื่อนไขหนังสือรับรองการจดทะเบียนนิติบุคคล  
25 เอกสารข้อมูลความปลอดภัย

หมายเหตุ

- กรณีไม่อนุญาต หากท่านไม่เห็นด้วย สามารถแจ้งเป็นหนังสือพร้อมเหตุผลไปยังอธิบดีกรมโรงงานอุตสาหกรรม ภายใน 15 วัน นับตั้งแต่วันที่ได้รับแจ้งคำสั่งจากการปกครอง
- หากท่านแจ้งคำคืนสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงานโดยไม่ได้รับอนุญาต ถือเป็นการผิดตามมาตรา 45 แห่งพระราชบัญญัติโรงงาน พ.ศ.2535 ต้องระวางโทษปรับไม่เกิน 2 แสนบาท



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.007	042	10250004625603	
2	130208	น้ำมันหล่อลื่นไขแล้ว	2.930	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	2.616	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.260	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.067	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องไขแล้ว	0.167	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องไขแล้ว	2.714	042	10250004625603	
8	150203	กรองอากาศไขแล้ว	2.333	049	10190186525629	
9	150203	กรองอากาศไขแล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.920	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.067	042	10190186525629	
11	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.038	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.167	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.033	021	10190186525629	
14	160605	แบตเตอรี่ไขแล้ว	0.640	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.580	042	10250004625603	
16	170405	เศษเหล็ก	0.333	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.108	042	10250004625603	
18	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	7.167	042	10250004625603	
19	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	16.872	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	41.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	40.962	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 มกราคม 2567 ถึงวันที่ 31 มกราคม 2567

ออกให้ ณ วันที่ 1 มกราคม 2567  
โดยกรมโรงงานอุตสาหกรรม  
  
หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นไขแล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องไขแล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องไขแล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศไขแล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศไขแล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.000	042	10190186525629	
11	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ไขแล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 กุมภาพันธ์ 2567 ถึงวันที่ 29 กุมภาพันธ์ 2567

ออกให้ ณ วันที่ 1 กุมภาพันธ์ 2567  
โดยกรมโรงงานอุตสาหกรรม  
  
หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดการ	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 มีนาคม 2567 ถึงวันที่ 31 มีนาคม 2567

ออกให้ ณ วันที่ 1 มีนาคม 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดการ	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 เมษายน 2567 ถึงวันที่ 30 เมษายน 2567

ออกให้ ณ วันที่ 1 เมษายน 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดฟลูออเรสเซนต์ใช้แล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 พฤษภาคม 2567 ถึงวันที่ 31 พฤษภาคม 2567

ออกให้ ณ วันที่ 1 พฤษภาคม 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดฟลูออเรสเซนต์ใช้แล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 มิถุนายน 2567 ถึงวันที่ 30 มิถุนายน 2567

ออกให้ ณ วันที่ 1 มิถุนายน 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดไฟลูออเรสเซนต์ใช้แล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.200	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	9.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 กรกฎาคม 2567 ถึงวันที่ 31 กรกฎาคม 2567

ออกให้ ณ วันที่ 1 กรกฎาคม 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดไฟลูออเรสเซนต์ใช้แล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบบำบัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 สิงหาคม 2567 ถึงวันที่ 31 สิงหาคม 2567

ออกให้ ณ วันที่ 1 สิงหาคม 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นไขแล้ว	1.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องไขแล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องไขแล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศไขแล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศไขแล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.000	042	10190186525629	
11	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ไขแล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 กันยายน 2567 ถึงวันที่ 30 กันยายน 2567

ออกให้ ณ วันที่ 1 กันยายน 2567  
โดยกรมโรงงานอุตสาหกรรม  
  
หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นไขแล้ว	0.930	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องไขแล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องไขแล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศไขแล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศไขแล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.000	042	10190186525629	
11	160215	หลอดไฟฟลูออเรสเซนต์ไขแล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ไขแล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 ตุลาคม 2567 ถึงวันที่ 31 ตุลาคม 2567

ออกให้ ณ วันที่ 1 ตุลาคม 2567  
โดยกรมโรงงานอุตสาหกรรม  
  
หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	0.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.500	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.400	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	0.500	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดฟลูออเรสเซนต์ใช้แล้ว	0.010	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.000	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.100	042	10250004625603	
18	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.500	042	10250004625603	
19	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	15.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.000	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	0.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 พฤศจิกายน 2567 ถึงวันที่ 30 พฤศจิกายน 2567

ออกให้ ณ วันที่ 1 พฤศจิกายน 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์



หนังสือแจ้งผลการพิจารณา  
การขออนุญาตให้นำสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้วออกนอกบริเวณโรงงาน  
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-30035  
หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ  
บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัด  
ทะเบียนโรงงานเลขที่ 10130005825545  
โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	ปริมาณ(ตัน)	รหัสการจัดกาาร	ผู้รับดำเนินการ	เหตุผล
1	100102	ตะกรันสนิมจากหม้อไอน้ำ	0.000	042	10250004625603	
2	130208	น้ำมันหล่อลื่นใช้แล้ว	0.000	042	10190186525629	
3	150110	ภาชนะปนเปื้อนน้ำมัน / ภาชนะปนเปื้อนสารเคมี	0.616	049	10190186525629	
4	150110	ภาชนะปนเปื้อนสารเคมี	0.000	049	10250004625603	
5	150111	กระป๋องสเปรย์	0.000	049	10250004625603	
6	150202	ไส้กรองน้ำมันเครื่องใช้แล้ว	0.000	042	10190186525629	
7	150202	วัสดุปนเปื้อน / ไส้กรองน้ำมันเครื่องใช้แล้ว	0.914	042	10250004625603	
8	150203	กรองอากาศใช้แล้ว	0.000	049	10190186525629	
9	150203	กรองอากาศใช้แล้ว / สารดูดความชื้น / ไส้กรองน้ำ	1.000	042	10250004625603	
10	160215	หลอดไฟฟลูออเรสเซนต์ใช้แล้ว	0.000	042	10190186525629	
11	160215	หลอดฟลูออเรสเซนต์ใช้แล้ว	0.100	049	10250004625603	
12	160216	อุปกรณ์และชิ้นส่วนอิเล็กทรอนิกส์	0.000	011	10190163025627	
13	160602	ถ่านไฟฉาย	0.000	021	10190186525629	
14	160605	แบตเตอรี่ใช้แล้ว	0.640	021	10190186525629	
15	161001	น้ำเสียจากการล้างเครื่องจักร	0.000	042	10250004625603	
16	170405	เศษเหล็ก	0.000	011	10190163025627	
17	170603	ฉนวนกันความร้อน	0.000	042	10250004625603	
18	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	1.167	042	10250004625603	
19	190814	ตะกอนจากระบบกำจัดน้ำเสียด้วยความร้อน	0.000	083	20720100425452	
20	190902	ตะกอนดินจากการผลิตน้ำประปา	30.000	042	10250004625603	
21	190902	ตะกอนดินจากการผลิตน้ำประปา	0.000	083	20720100425452	
22	150110	ภาชนะปนเปื้อน	0.200	049	10140002825489	
23	170405	สแตนเลส ถังเหล็ก เศษเหล็ก	1.000	011	10140002825489	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 ธันวาคม 2567 ถึงวันที่ 31 ธันวาคม 2567

ออกให้ ณ วันที่ 1 ธันวาคม 2567  
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์

## ภาคผนวก ข-19

---

เอกสารการส่งกำจัดกากของเสียอุตสาหกรรม (Manifest)

เลขที่อ้างอิง 3-25-0167-078563-0-N

แบบ กอ.๒

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเริบ

ชื่อผู้ก่อกำเริบ : บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัดเลขทะเบียนโรงงาน : 10130005825545

รายละเอียดของสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	รหัสประเภท หรือชนิด	ภาษาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	ตะกอนดินจากการผลิตน้ำประปา	190902	กระเบะเหล็ก	1	10.0

ลงชื่อผู้ก่อกำเริบ :

ลายมือชื่อ :

วันที่ :

เลขที่อ้างอิง 3-25-0267-099640-0-N

แบบ กอ.๒

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเริบ

ชื่อผู้ก่อกำเริบ : บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัดเลขทะเบียนโรงงาน : 10130005825545

รายละเอียดของสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	รหัสประเภท หรือชนิด	ภาษาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	ตะกอนดินจากการผลิตน้ำประปา	190902	กระเบะเหล็ก	1	10.0

ลงชื่อผู้ก่อกำเริบ :

ลายมือชื่อ :

วันที่ :

เลขที่อ้างอิง 1-19-0267-139903-0-N

แบบ กอ.๒

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเริบ

ชื่อผู้ก่อกำเริบ : บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัดเลขทะเบียนโรงงาน : 10130005825545

รายละเอียดของสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	รหัสประเภท หรือชนิด	ภาษาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	น้ำมันหล่อลื่นใช้แล้ว	130208	ถังเหล็ก 200 ลิตร	31	1.0
2	ภาชนะปนเปื้อนน้ำมัน	150110	ถังเหล็ก 200 ลิตร	31	0.5

รวมปริมาณทั้งหมด : ของเหลว 1 ตัน ของแข็ง 0.5 ตัน ของแข็งกึ่งเหลว 0 ตัน

[ ] น้ำหนักจริง [ / ] น้ำหนักประมาณการ

ขอควรระวังระหว่างการขนส่ง :

ลงชื่อผู้ก่อกำเริบ :ลายมือชื่อ :วันที่ :

เลขที่อ้างอิง 3-25-0367-100215-0-N

แบบ กอ.๒

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเริบ

ชื่อผู้ก่อกำเริบ : บริษัท กัลฟ์ เจพี ซีอาร์เอ็น จำกัดเลขทะเบียนโรงงาน : 10130005825545

รายละเอียดของสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิภูลหรือวัสดุที่ไม่ใช่แล้ว	รหัสประเภท หรือชนิด	ภาษาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	ตะกอนดินจากการผลิตน้ำประปา	190902	กระเบเหล็ก	1	10.0

แบบ กอ.๒

ส่วนที่ ๑ ผู้ก่อกำเริบ

[illegible]

~~~~~

| ลำดับ | ชื่อสิ่งปลูกสร้างหรือวัสดุที่ไม่ใช่แล้ว | รหัสประเภท หรือชนิด | ลักษณะบรรจุ |       | ปริมาณ (ตัน) |
|-------|-----------------------------------------|---------------------|-------------|-------|--------------|
|       |                                         |                     | ชนิด        | จำนวน |              |
| 1     | กรงอากาศใช้แล้ว                         | 150203              | ถุงพลาสติก  | 40    | 0.5          |

แบบ กอ.๒

ส่วนที่ ๑ ผูก่อกำเนิด

|     |  |
|-----|--|
| 4   |  |
| 5   |  |
| 6   |  |
| 7   |  |
| 8   |  |
| 9   |  |
| 10  |  |
| 11  |  |
| 12  |  |
| 13  |  |
| 14  |  |
| 15  |  |
| 16  |  |
| 17  |  |
| 18  |  |
| 19  |  |
| 20  |  |
| 21  |  |
| 22  |  |
| 23  |  |
| 24  |  |
| 25  |  |
| 26  |  |
| 27  |  |
| 28  |  |
| 29  |  |
| 30  |  |
| 31  |  |
| 32  |  |
| 33  |  |
| 34  |  |
| 35  |  |
| 36  |  |
| 37  |  |
| 38  |  |
| 39  |  |
| 40  |  |
| 41  |  |
| 42  |  |
| 43  |  |
| 44  |  |
| 45  |  |
| 46  |  |
| 47  |  |
| 48  |  |
| 49  |  |
| 50  |  |
| 51  |  |
| 52  |  |
| 53  |  |
| 54  |  |
| 55  |  |
| 56  |  |
| 57  |  |
| 58  |  |
| 59  |  |
| 60  |  |
| 61  |  |
| 62  |  |
| 63  |  |
| 64  |  |
| 65  |  |
| 66  |  |
| 67  |  |
| 68  |  |
| 69  |  |
| 70  |  |
| 71  |  |
| 72  |  |
| 73  |  |
| 74  |  |
| 75  |  |
| 76  |  |
| 77  |  |
| 78  |  |
| 79  |  |
| 80  |  |
| 81  |  |
| 82  |  |
| 83  |  |
| 84  |  |
| 85  |  |
| 86  |  |
| 87  |  |
| 88  |  |
| 89  |  |
| 90  |  |
| 91  |  |
| 92  |  |
| 93  |  |
| 94  |  |
| 95  |  |
| 96  |  |
| 97  |  |
| 98  |  |
| 99  |  |
| 100 |  |

| ลำดับ | ชื่อสิ่งปลูกสร้างหรือ<br>วัสดุที่ไม่ใช้แล้ว | รหัสประเภท หรือชนิด | ภาษาชนบรจุ |       | ปริมาณ (ตัน) |
|-------|---------------------------------------------|---------------------|------------|-------|--------------|
|       |                                             |                     | ชนิด       | จำนวน |              |
| 1     | วัสดุปนเปื้อน                               | 150202              | ถุงพลาสติก | 20    | 0.4          |

|   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |     |
|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|-----|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 | 32 | 33 | 34 | 35 | 36 | 37 | 38 | 39 | 40 | 41 | 42 | 43 | 44 | 45 | 46 | 47 | 48 | 49 | 50 | 51 | 52 | 53 | 54 | 55 | 56 | 57 | 58 | 59 | 60 | 61 | 62 | 63 | 64 | 65 | 66 | 67 | 68 | 69 | 70 | 71 | 72 | 73 | 74 | 75 | 76 | 77 | 78 | 79 | 80 | 81 | 82 | 83 | 84 | 85 | 86 | 87 | 88 | 89 | 90 | 91 | 92 | 93 | 94 | 95 | 96 | 97 | 98 | 99 | 100 |
|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|-----|

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผักกอกำเน็ด

รายละเอียดของสิ่งปกิกลหรือวัสดุที่ไม่ใช่แล้ว ที่ขนส่ง :

| ลำดับ | ชื่อสิ่งปลูกสร้างหรือวัสดุที่ใช้แล้ว | รหัสประเภท หรือชนิด | ลักษณะบรรจุ |       | ปริมาณ (ตัน) |
|-------|--------------------------------------|---------------------|-------------|-------|--------------|
|       |                                      |                     | ชนิด        | จำนวน |              |
| 1     | ตะกอนดินจากการผลิตน้ำประปา           | 190902              | กระเบตตะกอน | 1     | 10.0         |

|     |  |
|-----|--|
| 1   |  |
| 2   |  |
| 3   |  |
| 4   |  |
| 5   |  |
| 6   |  |
| 7   |  |
| 8   |  |
| 9   |  |
| 10  |  |
| 11  |  |
| 12  |  |
| 13  |  |
| 14  |  |
| 15  |  |
| 16  |  |
| 17  |  |
| 18  |  |
| 19  |  |
| 20  |  |
| 21  |  |
| 22  |  |
| 23  |  |
| 24  |  |
| 25  |  |
| 26  |  |
| 27  |  |
| 28  |  |
| 29  |  |
| 30  |  |
| 31  |  |
| 32  |  |
| 33  |  |
| 34  |  |
| 35  |  |
| 36  |  |
| 37  |  |
| 38  |  |
| 39  |  |
| 40  |  |
| 41  |  |
| 42  |  |
| 43  |  |
| 44  |  |
| 45  |  |
| 46  |  |
| 47  |  |
| 48  |  |
| 49  |  |
| 50  |  |
| 51  |  |
| 52  |  |
| 53  |  |
| 54  |  |
| 55  |  |
| 56  |  |
| 57  |  |
| 58  |  |
| 59  |  |
| 60  |  |
| 61  |  |
| 62  |  |
| 63  |  |
| 64  |  |
| 65  |  |
| 66  |  |
| 67  |  |
| 68  |  |
| 69  |  |
| 70  |  |
| 71  |  |
| 72  |  |
| 73  |  |
| 74  |  |
| 75  |  |
| 76  |  |
| 77  |  |
| 78  |  |
| 79  |  |
| 80  |  |
| 81  |  |
| 82  |  |
| 83  |  |
| 84  |  |
| 85  |  |
| 86  |  |
| 87  |  |
| 88  |  |
| 89  |  |
| 90  |  |
| 91  |  |
| 92  |  |
| 93  |  |
| 94  |  |
| 95  |  |
| 96  |  |
| 97  |  |
| 98  |  |
| 99  |  |
| 100 |  |

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผักอกำเนิต

รายละเอียดของสิ่งปลูกสร้างหรือวัสดุที่ไม่ใช่แล้ว ที่ขนส่ง :

| ลำดับ | ข้อสังเกตหรือ<br>วัสดุที่ไม่ใช่แล้ว | รหัสประเภท หรือชนิด | ภาชนะบรรจุ  |       | ปริมาณ (ตัน) |
|-------|-------------------------------------|---------------------|-------------|-------|--------------|
|       |                                     |                     | ชนิด        | จำนวน |              |
| 1     | ตะกอนดินจากการลึ้นน้ำประปา          | 190902              | กระเบะตะกอน | 1     | 10.0         |

[illegible]

ส่วนที่ ๑ ผักกอกำเนิด

| ลำดับ | ชื่อสิ่งปลูกสร้างหรือวัสดุที่ใช้แล้ว | รหัสประเภท หรือชนิด | ลักษณะบรรจุ |       | ปริมาณ (ตัน) |
|-------|--------------------------------------|---------------------|-------------|-------|--------------|
|       |                                      |                     | ชนิด        | จำนวน |              |
| 1     | ตะกอนดินจากการผลิตน้ำประปา           | 190902              | กระเบตะกอน  | 1     | 10.0         |

[illegible]