

## ผลการวิเคราะห์น้ำในสระว่ายนํ้า



บริษัท ดีแอนด์จี คอร์ปอเรชั่น จำกัด  
D&G CORPORATION CO.,LTD.

307/223 ถนนจรัญสนิทวงศ์ แขวงบางขุนศรี เขตบางกอกน้อย กรุงเทพฯ 10700 โทร. 02-868-6654 โทรสาร. 02-868-6543  
307/223 Charansanitwong Rd, Bangkhunsi, Bangkoknoi, Bangkok 10700 Thailand Tel. (662)868-6654 Fax. (662)868-6543

ใบรายงาน/ผลการวิเคราะห์  
ห้องปฏิบัติการวิเคราะห์เอกชน ว-๒๓๘

สถานที่เก็บ : Hyatt Regency  
ที่อยู่ : 1 ซอยสุขุมวิท 13 แขวงคลองเตยเหนือ เขตวัฒนา กรุงเทพมหานคร 10110  
ประเภทตัวอย่าง : น้ำสระว่ายน้ำ วันที่วิเคราะห์ : 06/01/2567  
วิธีเก็บตัวอย่าง : Grab วันที่รายงานผล : 12/01/2567  
วันที่เก็บตัวอย่าง : 06/01/2567 เลขที่รายงาน : WT3931266001  
วันที่รับตัวอย่าง : 06/01/2567

พารามิเตอร์	หน่วย	วิธีทดสอบ**	0090/01/24	มาตรฐานคุณภาพน้ำ ***
			สระว่ายน้ำ	
*pH	-	Electrometric Method	7.2	7.2- 7.8
*Total Dissolved Solids	mg/L	Dried at 108 °C	1,356	ไม่เกิน 3,000
Conductivity	µs/cm	Conductivity Method	2,711	-
Total Hardness	mg/L	Titration Method	90	ไม่เกิน 400
M-Alkalinity	mg/L	Titration Method	87	-
P-Alkalinity	mg/L	Titration Method	<0.50	-
Chloride	mg/L	Titration Method	1,740	-
Total Iron	mg/L	Photometer (Phenanthroline)	ไม่พบ	ไม่เกิน 0.3
Residual Chlorine	mg/L	Photometer (DPD)	1.2	1.0 - 3.0
ลักษณะตัวอย่าง		Observation	ใส	

หมายเหตุ

- (1) \* ชนิดสารเคมีที่ได้รับอนุญาตให้วิเคราะห์ตามที่ขอขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน กรอ.
- (2) \*\* วิธีวิเคราะห์ทดสอบอ้างอิงตาม Standard Methods for The examination of Water & Wastewater 22nd Edition, 2012
- (3) \*\*\* มาตรฐานสระว่ายน้ำ National Spa & Pool Institute (NSPI)

(นางสาวจิรปัญญา ทาระ)

เจ้าหน้าที่วิเคราะห์ทดสอบ

ว-๒๓๘-จ-๐๐๐๒

12/01/2567



(นางสาวศิริเพ็ญ วิถีเทพ)

ผู้ควบคุมห้องปฏิบัติการทดสอบ

ว-๒๓๘-ก-๐๐๐๑

12/01/2567

ห้ามคัดลอกบางส่วน ห้ามขูดขีด ห้ามแก้ไขรายงานนี้



บริษัท ดีแอนด์จี คอร์ปอเรชั่น จำกัด  
D&G CORPORATION CO.,LTD.

307/223 ถนนจรัญสนิทวงศ์ แขวงบางขุนศรี เขตบางกอกน้อย กรุงเทพฯ 10700 โทร. 02-868-6654 โทรสาร. 02-868-6543  
307/223 Charansanitwong Rd, Bangkhunsi, Bangkoknoi, Bangkok 10700 Thailand Tel. (662)868-6654 Fax. (662)868-6543

ใบรายงาน/ผลการวิเคราะห์  
ห้องปฏิบัติการวิเคราะห์เอกชน ว-๒๓๘

สถานที่เก็บ : Hyatt Regency  
ที่อยู่ : 1 ซอยสุขุมวิท 13 แขวงคลองเตยเหนือ เขตวัฒนา กรุงเทพมหานคร 10110  
ประเภทตัวอย่าง : น้ำสระว่ายน้ำ วันที่วิเคราะห์ : 03/02/2567  
วิธีเก็บตัวอย่าง : Grab วันที่รายงานผล : 09/02/2567  
วันที่เก็บตัวอย่าง : 02/02/2567 เลขที่รายงาน : WT3930267001  
วันที่รับตัวอย่าง : 03/02/2567

พารามิเตอร์	หน่วย	วิธีทดสอบ**	0344/02/24	มาตรฐานคุณภาพน้ำ ***
			สระว่ายน้ำ	
*pH	-	Electrometric Method	7.4	7.2- 7.8
*Total Dissolved Solids	mg/L	Dried at 108 °C	1,105	ไม่เกิน 3,000
Conductivity	µs/cm	Conductivity Method	2,210	-
Total Hardness	mg/L	Titration Method	90	ไม่เกิน 400
M-Alkalinity	mg/L	Titration Method	85	-
P-Alkalinity	mg/L	Titration Method	<0.50	-
Chloride	mg/L	Titration Method	950	-
Total Iron	mg/L	Photometer (Phenanthroline)	ไม่พบ	ไม่เกิน 0.3
Residual Chlorine	mg/L	Photometer (DPD)	0.92	1.0 - 3.0
ลักษณะตัวอย่าง		Observation	ใส	

หมายเหตุ

- (1) \* ชนิดสารเคมีที่ได้รับอนุญาตให้วิเคราะห์ตามที่ขอขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน กรอ.
- (2) \*\* วิธีวิเคราะห์ทดสอบอ้างอิงตาม Standard Methods for The examination of Water & Wastewater 22nd Edition, 2012
- (3) \*\*\* มาตรฐานสระว่ายน้ำ National Spa & Pool Institute (NSPI)

(นางสาวจิรปัญญา ทาระ)

เจ้าหน้าที่วิเคราะห์ทดสอบ

ว-๒๓๘-จ-๐๐๐๒

09/02/2567



(นางสาวศิริเพ็ญ วิถีเทพ)

ผู้ควบคุมห้องปฏิบัติการทดสอบ

ว-๒๓๘-ก-๐๐๐๑

09/02/2567

ห้ามคัดลอกบางส่วน ห้ามขูดขีด ห้ามแก้ไขรายงานนี้



**Diversey Hygiene (Thailand) Co., Ltd.**  
33/4 The Nine Tower Grand Rama 9 27th Floor,  
Building B, Rama 9 Road Huai Khwang  
Subdistrict Huai Khwang District Bangkok 10310




**Hyatt Regency Bangkok Sukhumvit**  
1 Soi Sukhumvit 13, Khlong Toei Nuea, Watthana,  
Bangkok, 10110, Thailand


### MONTHLY SERVICE REPORT

<b>Reported by</b> DIVERSEY CC	Albertus G / Kittigunya Vikas M / Piyada / Phatchuka V	<b>Report to</b> Hyatt Regency CC	K. Suwit Polrachom
<b>Latest Data</b>	Sunday, March 31, 2024	<b>Report Date</b>	Friday, April 19, 2024

### Main Pool Water Parameters

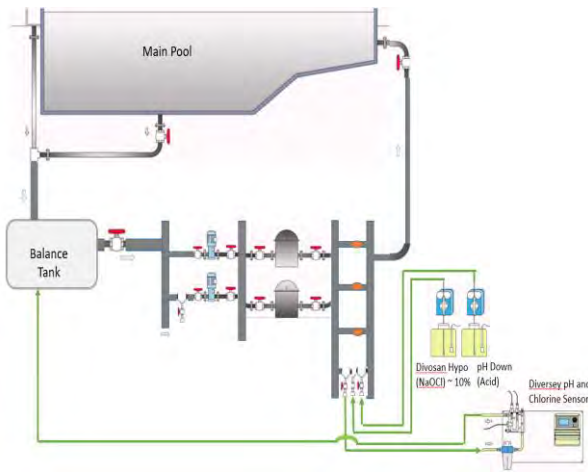Pool Schematic + Diversey Treatment Schematic		Pool Water Quality	Date	21 Mar 2024
		Parameter	Control Limit	Result
		pH	6.8 - 7.8	7.41
		Chlorine Residual	1 - 3 ppm	1.63
		TDS		840 ppm
		Hardness		20 ppm as CaCO <sub>3</sub>
		Escherichia Coli	< 1.1 MPN/100ml	< 1.1 *21 March 2024
		Total Coliform	< 1.1 MPN/100ml	< 1.1 *21 March 2024
		Legionella spp.	< 1 CFU / L	< 1 *21 March 2024
ON CONTROL				

### Pool Water Trending

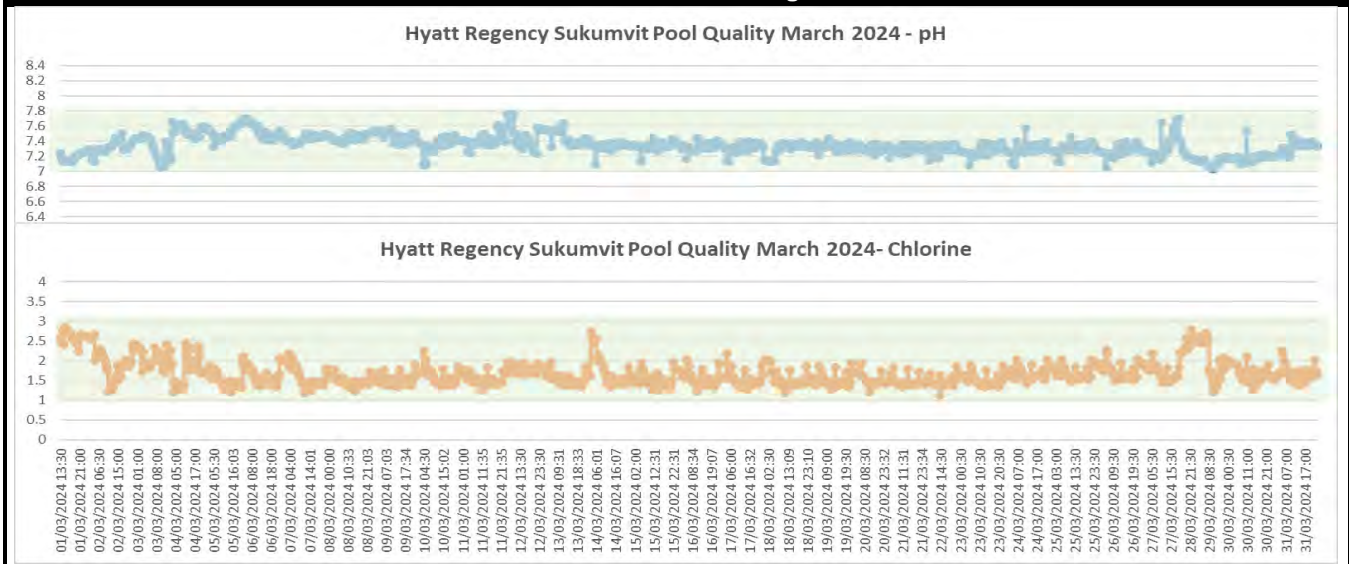

### Comment & Recommendation

- Overall all parameter are in good control, Diversey system running properly to maintain both pH and Free chlorine to meet target control to meet standard safety
- Water sampling was collected on 21 March 2024 for bacteria testing. All testing shows "<" lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting), means excellent result of protection against bacteria.





## Analysis / Test Report

TESTING  
No.0009

**Client :** Diversey Hygiene (Thailand) Co., Ltd.  
33/4 The 9th Tower Grand Rama9, 27th Floor, Tower B, Rama 9 Road., Huaykwang,  
Huaykwang, Bangkok Thailand 10310  
**P/O :** PO262841  
**Project Name :**  
**Project Location :**

**Lot ID: 2430977**

Date Received : Mar 21, 2024  
Date Reported : Apr 01, 2024  
Report Number : 2940742-1

Page 1 of 1

**Sample Number** 2430977-1  
**Sampled Date** Mar 21, 2024 10:55 AM  
**Sample Description** Pool water  
**Location** ชั้น 6  
**Date Analysis Commenced** Mar 22, 2024  
**Condition of Sample** Contained in one plastic bottle, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
<b>Microbiological Testing</b>						
<i>Escherichia coli</i> *	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 F	Bangkok
Total Coliform	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 B	Bangkok

**Sampling By :** Panupong Homewong

Remark :

- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked \* is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Approved by

Tuanjai Thangklang  
Manager

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.



## Analysis / Test Report

**Client :** Diversey Hygiene (Thailand) Co., Ltd.  
33/4 The 9th Tower Grand Rama9, 27th Floor, Tower B, Rama 9 Road., Huaykwang,  
Huaykwang, Bangkok Thailand 10310  
**P/O :** PO262841  
**Project Name :**  
**Project Location :**

**Lot ID: 2430973**

Date Received : Mar 21, 2024

Date Reported : Apr 08, 2024

Report Number : 2940731-1

Page 1 of 1

**Sample Number** 2430973-1  
**Sampled Date** Mar 21, 2024 10:55 AM  
**Sample Description** Pool water  
**Location** ชั้น 6  
**Date Analysis Commenced** Mar 22, 2024  
**Condition of Sample** Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
<b>Microbiological Testing</b>						
<i>Legionella spp.</i>	CFU/L	-	-	<1	ISO 11731 (2017)	Bangkok

**Note :** Microbiological Testing Result <1 mean Bacteria not found in agar plate.

**Sampling By :** Panupong Homewong

Remark :

- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)

Approved by

Suwannee Chuamkeaw  
Section Head

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.





**Diversey Hygiene (Thailand) Co., Ltd.**  
33/4 The Nine Tower Grand Rama 9 27th Floor,  
Building B, Rama 9 Road Huai Khwang  
Subdistrict Huai Khwang District Bangkok 10310



**Hyatt Regency Bangkok Sukhumvit**  
1 Soi Sukhumvit 13, Khlong Toei Nuea, Watthana,  
Bangkok, 10110, Thailand


### MONTHLY SERVICE REPORT

<b>Reported by</b> DIVERSEY CC	Albertus G / Kittigunya Vikas M / Piyada / Phatchuka V	<b>Report to</b> Hyatt Regency CC	K. Suwit Polrachom
<b>Latest Data</b>	Tuesday, April 30, 2024	<b>Report Date</b>	Thursday, May 23, 2024

### Main Pool Water Parameters

Pool Schematic + Diversey Treatment Schematic	Pool Water Quality	Date	30 Apr 2024
	<b>Parameter</b>	<b>Control Limit</b>	<b>Result</b>
	pH	6.8 - 7.8	7.36
	Chlorine Residual	1 - 3 ppm	1.43
	TDS		1562 ppm
	Hardness		50 ppm as CaCO <sub>3</sub>
	Escherichia Coli	< 1.1 MPN/100ml	< 1.1 *24 April 2024
	Total Coliform	< 1.1 MPN/100ml	< 1.1 *24 April 2024
	Legionella spp.	< 1 CFU / L	< 1 *21 March 2024
ON CONTROL			

### Pool Water Trending

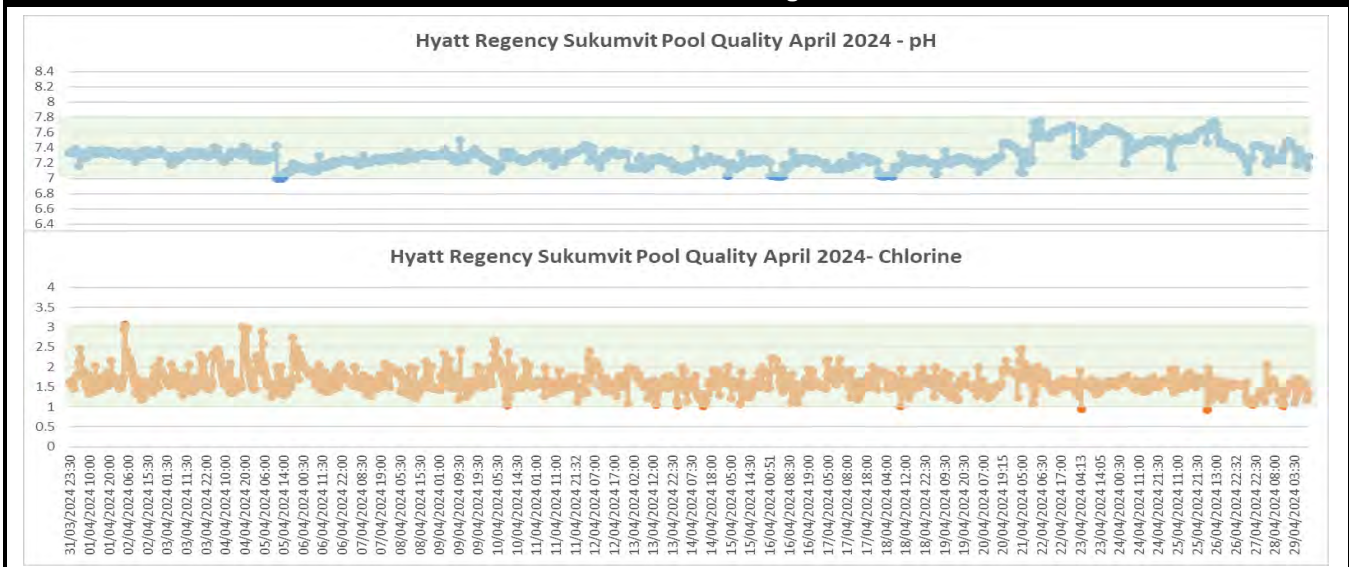

### Comment & Recommendation

- Overall all parameter are in good control, Diversey system running properly to maintain both pH and Free chlorine to meet target control to meet standard safety
- Water sampling was collected on 21 March 2024 for bacteria testing. All testing shows "<" lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting), means excellent result of protection against bacteria.







## Analysis / Test Report

TESTING  
No.0009

**Client :** Diversey Hygiene (Thailand) Co., Ltd.  
33/4 The 9th Tower Grand Rama9, 27th Floor, Tower B, Rama 9 Road., Huaykwang,  
Huaykwang, Bangkok Thailand 10310

**Lot ID: 2440535**

Date Received : Apr 24, 2024

Date Reported : May 06, 2024

Report Number : 2970485-1

**P/O :**

**Project Name :**

**Project Location :**

Page 1 of 1

<b>Sample Number</b>	2440535-1
<b>Sampled Date</b>	Apr 24, 2024 11:05 AM
<b>Sample Description</b>	Pool water
<b>Date Analysis Commenced</b>	Apr 25, 2024
<b>Condition of Sample</b>	Contained in one plastic bottle, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
<b>Microbiological Testing</b>						
<i>Escherichia coli</i>	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 B, F	Bangkok
Total Coliform	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 B	Bangkok

**Sampling By :** Jiranat Khowlaor

Remark :

- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked \* is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Approved by

Suwannee Chuamkeaw  
Section Head

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.



**Diversey Hygiene (Thailand) Co., Ltd.**  
33/4 The Nine Tower Grand Rama 9 27th Floor,  
Building B, Rama 9 Road Huai Khwang  
Subdistrict Huai Khwang District Bangkok 10310



**Hyatt Regency Bangkok Sukhumvit**  
1 Soi Sukhumvit 13, Khlong Toei Nuea, Watthana,  
Bangkok, 10110, Thailand


### MONTHLY SERVICE REPORT

<b>Reported by</b>	Albertus G / Kittigunya	<b>Report to</b>	K. Suwit Polrachom
<b>DIVERSEY CC</b>	Vikas M / Piyada / Phatchuka V	<b>Hyatt Regency CC</b>	
<b>Latest Data</b>	Friday, May 31, 2024	<b>Report Date</b>	Thursday, 20 June 2024

### Main Pool Water Parameters

Pool Schematic + Diversey Treatment Schematic	Pool Water Quality	Date	31 May 2024
	Parameter	Control Limit	Result
	pH	6.8 - 7.8	7.15
	Free Chlorine	1 - 3 ppm	1.56
	TDS		986 ppm
	Hardness		120 ppm as CaCO <sub>3</sub>
	Escherichia Coli	< 1.1 MPN/100ml	< 1.1 *29 May 2024
	Total Coliform	< 1.1 MPN/100ml	< 1.1 *29 May 2024
	Legionella spp.	< 1 CFU / L	< 1 *21 March 2024
	ON CONTROL		

### Pool Water Trending

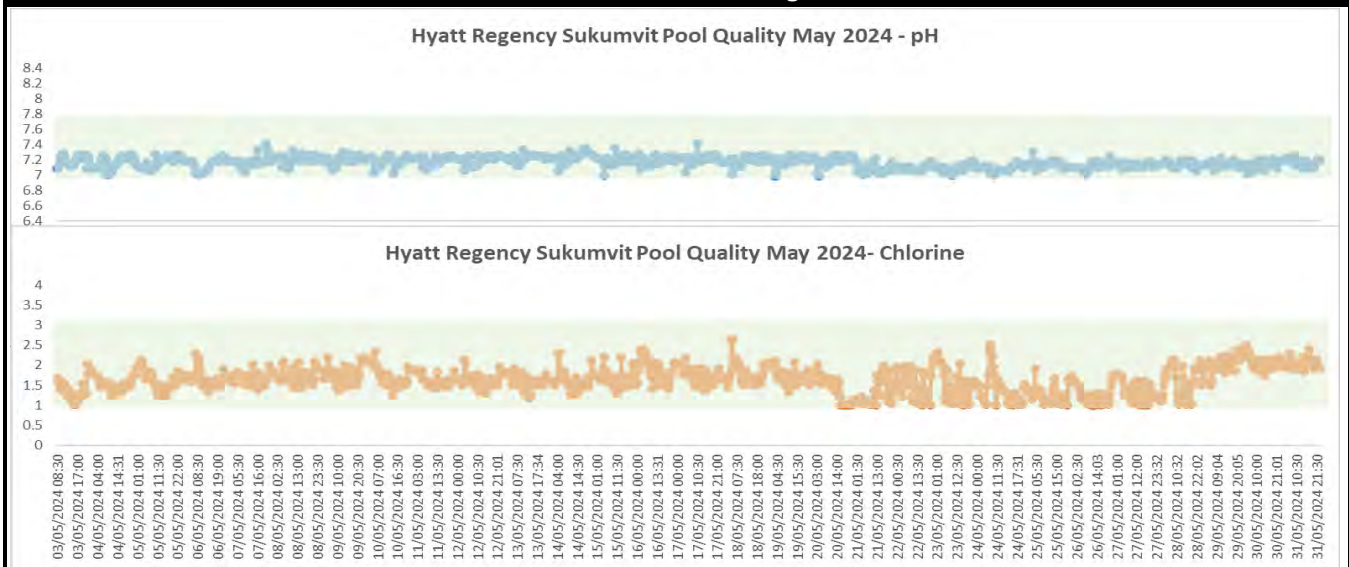

### Comment & Recommendation

- Overall all parameter are in good control, Diversey system running properly to maintain both pH and Free chlorine to meet target control to meet standard safety
- Water sampling was collected on 29 May 2024 for bacteria testing. All testing shows "<" lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting), means excellent result of protection against bacteria.





## Analysis / Test Report

TESTING  
No.0009

**Client :** Diversey Hygiene (Thailand) Co., Ltd.  
33/4 The 9th Tower Grand Rama9, 27th Floor, Tower B, Rama 9 Road., Huaykwang,  
Huaykwang, Bangkok Thailand 10310

**P/O :**

**Project Name :**

**Project Location :**

**Lot ID: 2458745**

Date Received : May 29, 2024

Date Reported : Jun 08, 2024

Report Number : 3006299-1

Page 1 of 1

<b>Sample Number</b>	2458745-1
<b>Sampled Date</b>	May 29, 2024 10:30 AM
<b>Sample Description</b>	Pool water
<b>Date Analysis Commenced</b>	May 30, 2024
<b>Condition of Sample</b>	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
<b>Microbiological Testing</b>						
<i>Escherichia coli</i>	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 F	Bangkok
Total Coliform	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 B	Bangkok
<b>Water Testing</b>						
pH at 25 degree C *		-	-	7.2	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 4500 - H (B)	Bangkok
Residual Free Chlorine *	mg/L	-	0.1	5.8	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 4500-Cl (F)	Bangkok
Total Dissolved solids Dried at 180 degree C *	mg/L	-	5	986	In-house method : STM 04-011 based on Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 2540 C	Bangkok
Total Hardness as CaCO <sub>3</sub> *	mg/L	-	1	120	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 2340 C	Bangkok

**Sampling By :** Chulladet Warin

Remark :

- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked \* is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Approved by

Sithichok T.

Sithichok Thongnguen  
Scientist (3)

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER



**Diversey Hygiene (Thailand) Co., Ltd.**  
33/4 The Nine Tower Grand Rama 9 27th Floor,  
Building B, Rama 9 Road Huai Khwang  
Subdistrict Huai Khwang District Bangkok 10310



**Hyatt Regency Bangkok Sukhumvit**  
1 Soi Sukhumvit 13, Khlong Toei Nuea, Watthana,  
Bangkok, 10110, Thailand


### MONTHLY SERVICE REPORT

<b>Reported by</b> DIVERSEY CC	Albertus G / Kittigunya Vikas M / Piyada / Phatchuka V	<b>Report to</b> Hyatt Regency CC	K. Suwit Polrachom
<b>Latest Data</b>	Sunday, June 30, 2024	<b>Report Date</b>	Thursday, 25 July 2024

### Main Pool Water Parameters

Pool Schematic + Diversey Treatment Schematic	Pool Water Quality	Date	30 Jun 2024
	<b>Parameter</b>	<b>Control Limit</b>	<b>Result</b>
	pH	6.8 - 7.8	7.32
	Free Chlorine	1 - 3 ppm	1.76
	TDS		1086 ppm
	Hardness		121 ppm as CaCO <sub>3</sub>
	Escherichia Coli	< 1.1 MPN/100ml	< 1.1 *28 June 2024
	Total Coliform	< 1.1 MPN/100ml	< 1.1 *28 June 2024
	Legionella spp.	< 1 CFU / L	< 1 *28 June 2024
	<b>ON CONTROL</b>		

### Pool Water Trending

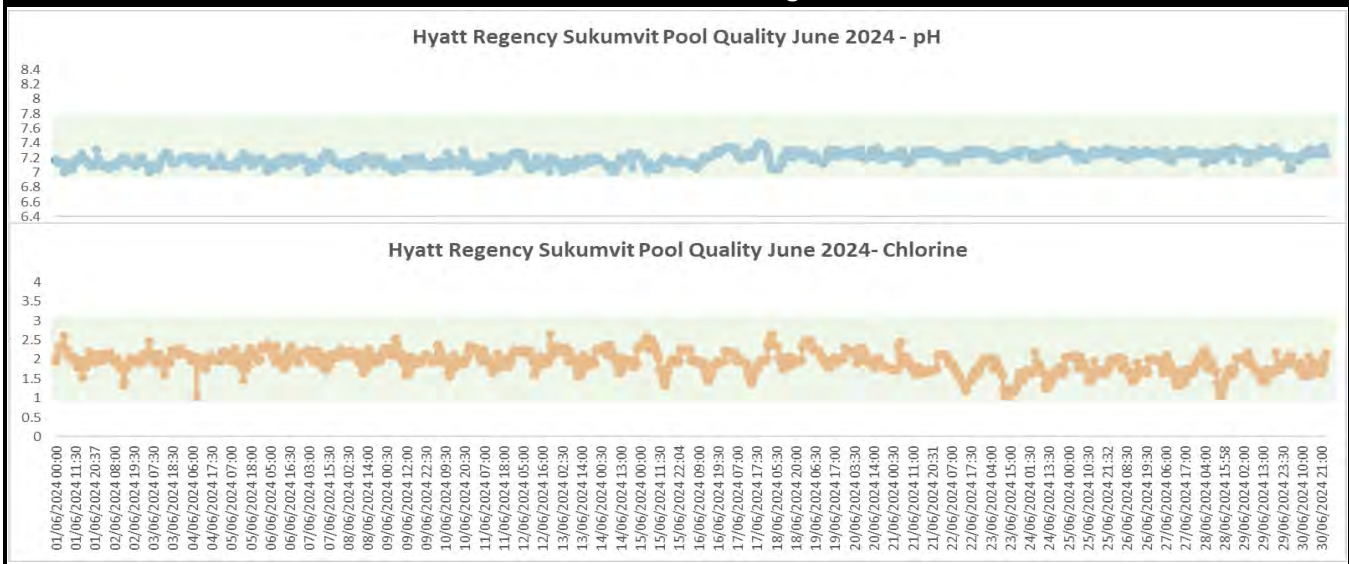

### Comment & Recommendation

- Overall all parameter are in good control, Diversey system running properly to maintain both pH and Free chlorine to meet target control to meet standard safety
- Water sampling was collected on 28 June 2024 for bacteria testing. All testing shows "<" lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting), means excellent result of protection against bacteria.







## Analysis / Test Report

TESTING  
No.0009

**Client :** Diversey Hygiene (Thailand) Co., Ltd.  
33/4 The 9th Tower Grand Rama9, 27th Floor, Tower B, Rama 9 Road., Huaykwang,  
Huaykwang, Bangkok Thailand 10310

**P/O :**

**Project Name :**

**Project Location :**

**Lot ID: 2473797**

Date Received : Jun 28, 2024

Date Reported : Jul 09, 2024

Report Number : 3037785-1

Page 1 of 1

<b>Sample Number</b>	2473797-1
<b>Sampled Date</b>	Jun 28, 2024 10:10 AM
<b>Sample Description</b>	Pool water
<b>Date Analysis Commenced</b>	Jun 28, 2024
<b>Condition of Sample</b>	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
<b>Microbiological Testing</b>						
<i>Escherichia coli</i>	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 B, F	Bangkok
Total Coliform	MPN/100mL	-	-	<1.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 9221 B	Bangkok
<b>Water Testing</b>						
pH at 25 degree C *		-	-	8.1	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 4500 - H (B)	Bangkok
Residual Free Chlorine *	mg/L	-	0.1	1.4	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 4500-Cl (F)	Bangkok
Total Dissolved solids Dried at 180 degree C *	mg/L	-	5	1086	In-house method : STM 04-011 based on Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 2540 C	Bangkok
Total Hardness as CaCO <sub>3</sub> *	mg/L	-	1	121	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 23rd ed., 2017, part 2340 C	Bangkok

**Sampling By :** Panupong Homewong

Remark :

- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked \* is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Approved by

Sithichok T.

Sithichok Thongnguen  
Scientist (3)

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER



## Analysis / Test Report

**Client :** Diversey Hygiene (Thailand) Co., Ltd.  
33/4 The 9th Tower Grand Rama9, 27th Floor, Tower B, Rama 9 Road., Huaykwang,  
Huaykwang, Bangkok Thailand 10310

**P/O :**  
**Project Name :**  
**Project Location :**

**Lot ID: 2473798**

Date Received : Jun 28, 2024  
Date Reported : Jul 16, 2024  
Report Number : 3037786-1

Page 1 of 1

<b>Sample Number</b>	2473798-1
<b>Sampled Date</b>	Jun 28, 2024 10:10 AM
<b>Sample Description</b>	Pool water
<b>Date Analysis Commenced</b>	Jun 28, 2024
<b>Condition of Sample</b>	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
<b>Microbiological Testing</b>						
<i>Legionella spp.</i>	CFU/L	-	-	<1	ISO 11731 (2017)	Bangkok

**Note :** Microbiological Testing Result <1 mean Bacteria not found in agar plate.

**Sampling By :** Panupong Homewong

Remark :

- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)

Approved by

Sithichok T.

Sithichok Thongnguen  
Scientist (3)

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197  
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Life Sciences

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER