ภาคผนวก

ภาคผนวก ก-1	**สำเนาหนังสือแจ้งผลการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าไทยเนชั่นแนล พาวเวอร์ 2 ของบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด ที่ ทส 1009.7/8689 ลงวันที่ 9 พฤศจิกายน 2552**
ภาคผนวก ก-2	**สำเนาหนังสือแจ้งการเปลี่ยนชื่อโครงการและชื่อบริษัท**
ภาคผนวก ข	**เอกสารประกอบมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม**
ภาคผนวก ข-1	สำเนาจดหมายนำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม ฉบับล่าสุด
ภาคผนวก ข-2	แผนบำรุงรักษาเชิงป้องกัน (preventive maintenance program)
ภาคผนวก ข-3	ผลการตรวจวัด *Legionella spp.* ในระบบหล่อเย็น
ภาคผนวก ข-4	ระเบียบปฏิบัติงานระดับองค์กร: การรายงานการกระทำ/สภาพการณ์ที่ต่ำกว่ามาตรฐาน เหตุการณ์เกือบเกิดอุบัติเหตุ อุบัติเหตุ เหตุการณ์ผิดปกติ และการสอบสวน
ภาคผนวก ข-5	ผลการตรวจวัดระดับเสียงเฉลี่ยตลอดระยะเวลาการทำงาน
ภาคผนวก ข-6	แผนการอบรมให้ความรู้ด้านความปลอดภัยและสิ่งแวดล้อม
ภาคผนวก ข-7	เอกสารการตรวจสุขภาพพนักงาน - ผลการตรวจสุขภาพประจำปี พ.ศ. 2566 - ตัวอย่างสมุดสุขภาพประจำตัวลูกจ้างที่ทำงานเกี่ยวกับปัจจัยเสี่ยง
ภาคผนวก ข-8	หนังสือรับรองผู้ควบคุมระบบบำบัดมลพิษน้ำ
ภาคผนวก ข-9	เอกสารรับรอง ISO 14001:2015 และ ISO 45001:2018
ภาคผนวก ข-10	เอกสารประชาสัมพันธ์และการมีส่วนร่วมของชุมชน
ภาคผนวก ข-11	การตรวจสอบและซ่อมบำรุงรักษายานพาหนะของโรงไฟฟ้า
ภาคผนวก ข-12	สถิติอุบัติเหตุ
ภาคผนวก ข-13	การตรวจสอบระบบท่อที่เข้าสู่โรงไฟฟ้าจาก East water
ภาคผนวก ข-14	การจัดการขยะมูลฝอยและกากของเสียของโครงการ - หนังสือแจ้งผลการพิจารณาฯ การขออนุญาตให้นำส่งปฏิกูลใหม่วัสดุที่ไม่ใช้แล้วออกนอกบริเวณโรงงานจากกรมโรงงานอุตสาหกรรม (สก.2) - ปริมาณกากของเสียอุตสาหกรรมและขยะทั่วไป ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567 ตัวอย่างใบกำกับการขนส่งของเสีย
ภาคผนวก ข-15	การตรวจสอบสภาพรางระบายน้ำ/ท่อระบายน้ำ
ภาคผนวก ข-16	เอกสารการจัดประชุมคณะกรรมการพหุภาคี

ภาคผนวก (ต่อ)

ภาคผนวก ข	**(ต่อ) เอกสารประกอบมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม**
ภาคผนวก ข-17	แผนผังแสดงตำแหน่งการติดตั้งระบบป้องกันและเตือนภัยของโรงไฟฟ้า
ภาคผนวก ข-18	ตัวอย่างเอกสารการตรวจสอบอุปกรณ์ชำระล้างฉุกเฉิน
ภาคผนวก ข-19	ตัวอย่างเอกสารการตรวจสอบอุปกรณ์ดับเพลิง
ภาคผนวก ข-20	เอกสารการขอใช้บริการยานพาหนะรับ-ส่งผู้ป่วยหรือผู้บาดเจ็บไว้รองรับในกรณีเกิดเหตุฉุกเฉิน
ภาคผนวก ข-21	เอกสารแสดงเจ้าหน้าที่ความปลอดภัยประจำโรงไฟฟ้า
ภาคผนวก ข-22	เอกสารการจัดตั้งคณะกรรมการความปลอดภัย อาชีวอนามัยและสภาพแวดล้อม
ภาคผนวก ข-23	เอกสารรับรองความปลอดภัยในการใช้หม้อไอน้ำ
ภาคผนวก ข-24	แผนการบำรุงรักษาอุปกรณ์ สถานีควบคุมและวัดปริมาตรก๊าซ
ภาคผนวก ข-25	การปฏิบัติงานภาวะฉุกเฉินของโรงไฟฟ้า - Procedure: Emergency Preparedness and Response
ภาคผนวก ข-26	เอกสารการเชื่อมโยงระบบตรวจวัดคุณภาพอากาศไปยังกรมโรงงานอุตสาหกรรม
ภาคผนวก ค	**เอกสารประกอบมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม**
ภาคผนวก ค-1	ใบรับรองผลการวิเคราะห์
ภาคผนวก ค-2	ผลการตรวจวัดคุณภาพอากาศจากปล่องระบายอากาศแบบต่อเนื่อง (Continuous Emission Monitoring System : CEMs)
ภาคผนวก ค-3	การตรวจสอบความถูกต้องของ CEMS : System Audit
ภาคผนวก ค-4	การตรวจสอบความถูกต้องของ CEMS : Performance Audit
ภาคผนวก ง	**ใบรับรองการสอบเทียบเครื่องมือ**
ภาคผนวก จ	**สำเนาหนังสืออนุญาตขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์**

ภาคผนวก ก-1

สำเนาหนังสือแจ้งผลการพิจารณารายงานการวิเคราะห์ผลกระทบ
สิ่งแวดล้อม โครงการโรงไฟฟ้าไทยเนชั่นแนล พาวเวอร์ 2
ของบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด
ที่ ทส 1009.7/8689 ลงวันที่ 9 พฤศจิกายน 2552

ที่ ทส 1009.7/ 8689

สำนักงานนโยบายและแผน
ทรัพยากรธรรมชาติและสิ่งแวดล้อม
60/1 ซอยพิบูลวัฒนา 7 ถนนพระรามที่ 6
กรุงเทพฯ 10400

9 พฤศจิกายน 2552

เรื่อง แจ้งผลการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าไทยเนชั่นแนล พาวเวอร์ 2 ของบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด

เรียน กรรมการผู้จัดการบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด

อ้างถึง 1. หนังสือบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด ที่ TNPPL/09-053 ลงวันที่ 21 กันยายน 2552
2. หนังสือบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด ที่ TNPPL/09-056 ลงวันที่ 12 ตุลาคม 2552

สิ่งที่ส่งมาด้วย 1. มาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมโครงการโรงไฟฟ้าไทยเนชั่นแนล พาวเวอร์ 2 ของบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด ตั้งอยู่ในเขตประกอบการอุตสาหกรรมสยามอีสเทิร์น อินดัสเตรียล พาร์ค ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง
2. แนวทางการเสนอรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม สำหรับโครงการด้านอุตสาหกรรม โครงการนิคมอุตสาหกรรมหรือโครงการที่มีลักษณะเดียวกับนิคมอุตสาหกรรมและโครงการด้านพลังงาน

ตามหนังสือที่อ้างถึง 1 และ 2 บริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด ได้เสนอรายงานข้อมูลเพิ่มเติม ฉบับที่ 2 และฉบับที่ 3 การวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าไทยเนชั่นแนล พาวเวอร์ 2 ของบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด ตั้งอยู่ในเขตประกอบการอุตสาหกรรมสยามอีสเทิร์น อินดัสเตรียล พาร์ค ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง จัดทำรายงานฯ โดยบริษัท ทีม คอนซัลติ้ง เอนจิเนียริ่ง แอนด์ แมเนจเมนท์ จำกัด ให้สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อมพิจารณา ความละเอียดแจ้งแล้ว นั้น

สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ได้พิจารณานำรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าไทยเนชั่นแนล พาวเวอร์ 2 เสนอคณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม ด้านโรงไฟฟ้าพลังความร้อน ตามขั้นตอนการพิจารณา และในการประชุมคณะกรรมการผู้ชำนาญการฯ ครั้งที่ 7/2552 เมื่อวันที่ 14 ตุลาคม 2552

2/ คณะ...

คณะกรรมการผู้ชำนาญการฯ มีมติให้ความเห็นชอบรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าไทยเนชั่นแนล พาวเวอร์ 2 ของบริษัท ไทย เนชั่นแนล พาวเวอร์ จำกัด ตั้งอยู่ในเขตประกอบการอุตสาหกรรมสยามอีสเทิร์น อินดัสเตรียล พาร์ค ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง โดยให้ปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมอย่างเคร่งครัด ดังรายละเอียดในสิ่งที่ส่งมาด้วย 1 สำหรับการรายงานผลการปฏิบัติตามแผนปฏิบัติการด้านสิ่งแวดล้อมที่นำเสนอไว้ในรายงานฯ ให้เป็นไปตามแนวทางการเสนอรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม ดังรายละเอียดในสิ่งที่ส่งมาด้วย 2 อนึ่ง สำนักงานฯ ขอให้บริษัทฯ ประสาน บริษัท ทีม คอนซัลติ้ง เอนจิเนียริ่ง แอนด์ แมเนจเมนท์ จำกัด จัดทำรายงานฉบับสมบูรณ์พร้อมแผ่นบันทึกข้อมูล ซึ่งได้ดำเนินการตามมติคณะกรรมการผู้ชำนาญการและจัดทำรายงานผนวกรวมเล่ม โดยรวบรวมรายละเอียดข้อมูลทั้งหมดตามลำดับการพิจารณาเสนอให้สำนักงานฯ ภายในเวลา 1 เดือน ทั้งนี้ สำนักงานฯ ได้มีหนังสือแจ้งสำนักงานคณะกรรมการกำกับกิจการพลังงาน เพื่อพิจารณาดำเนินการ และสำเนาแจ้งบริษัท ทีม คอนซัลติ้ง เอนจิเนียริ่ง แอนด์ แมเนจเมนท์ จำกัด เพื่อดำเนินการในส่วนที่เกี่ยวข้องต่อไปด้วยแล้ว

จึงเรียนมาเพื่อโปรดทราบและพิจารณาดำเนินการต่อไป

ขอแสดงความนับถือ

(นายชนินทร์ ทองธรรมชาติ)
รองเลขาธิการฯ รักษาราชการแทน
เลขาธิการสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม

สำนักวิเคราะห์ผลกระทบสิ่งแวดล้อม
โทร 0 2265 6628
โทรสาร 0 2265 6616

สำเนาถูกต้อง

(นางสุปราณี แดงไทย)
เจ้าหน้าที่งานธุรการชำนาญงาน

ภาคผนวก ก-2

สำเนาหนังสือแจ้งการเปลี่ยนชื่อโครงการและชื่อบริษัท

ที่ ทส 1009.7/7163

สำนักงานนโยบายและแผน
ทรัพยากรธรรมชาติและสิ่งแวดล้อม
60/1 ซอยพิบูลวัฒนา 7 ถนนพระรามที่ 6
กรุงเทพฯ 10400

24 มิถุนายน 2557

เรื่อง แจ้งการเปลี่ยนชื่อโครงการและชื่อบริษัทที่รับผิดชอบมาตรการในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 และโครงการท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 ของบริษัท โกลว์ เอสพีพี 11 จำกัด

เรียน กรรมการผู้จัดการบริษัท โกลว์ เอสพีพี 11 จำกัด

อ้างถึง หนังสือบริษัท โกลว์ เอสพีพี 11 จำกัด ที่ GSPP11-14-035 ลงวันที่ 4 มิถุนายน 2557

ตามหนังสือที่อ้างถึง บริษัท โกลว์ เอสพีพี 11 จำกัด ได้แจ้งสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อมว่า บริษัท โกลว์ เอสพีพี 12 จำกัด ได้โอนกิจการให้แก่ บริษัท โกลว์ เอสพีพี 11 จำกัด จึงขอเปลี่ยนชื่อโครงการจาก โครงการโรงไฟฟ้าไทยเนชั่นแนลพาวเวอร์ 2 และโครงการท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าไทยเนชั่นแนลพาวเวอร์ 2 เป็น โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 และโครงการท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 ตามลำดับ และเปลี่ยนชื่อผู้รับผิดชอบมาตรการของโครงการในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม เพื่อให้สอดคล้องกับข้อเท็จจริงจาก บริษัท โกลว์ เอสพีพี 12 จำกัด เป็น บริษัท โกลว์ เอสพีพี 11 จำกัด ความละเอียดแจ้งแล้ว นั้น

สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อมได้นำเรื่อง แจ้งการเปลี่ยนชื่อโครงการและชื่อบริษัทที่รับผิดชอบมาตรการในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 และโครงการท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 ของบริษัท โกลว์ เอสพีพี 11 จำกัด ตั้งอยู่ที่ เขตประกอบการอุตสาหกรรมสยามอีสเทิร์น อินดัสเตรียล พาร์ค ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง เสนอคณะกรรมการผู้ชำนาญการพิจารณารายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม ด้านโรงไฟฟ้าพลังความร้อน ในการประชุมครั้งที่ 18/2557 เมื่อวันที่ 12 มิถุนายน 2557

ซึ่งคณะ...

ซึ่งคณะกรรมการผู้ชำนาญการฯ มีมติรับทราบการเปลี่ยนชื่อโครงการและชื่อบริษัทที่รับผิดชอบมาตรการในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 และโครงการท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 ของบริษัท โกลว์ เอสพีพี 11 จำกัด ทั้งนี้ สำนักงานฯ ได้มีหนังสือแจ้งสำนักงานคณะกรรมการกำกับกิจการพลังงาน กรมโรงงานอุตสาหกรรม และจังหวัดระยอง เพื่อทราบด้วยแล้ว

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

(นางรวีวรรณ ภูริเดช)
รองเลขาธิการฯ ปฏิบัติราชการแทน
เลขาธิการสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม

สำนักวิเคราะห์ผลกระทบสิ่งแวดล้อม
โทร. 0 2265 6628
โทรสาร 0 2265 6616

ภาคผนวก ข

เอกสารประกอบมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม

ภาคผนวก ข-1

สำเนาจดหมายนำส่งรายงาน
ผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบ
สิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบ
สิ่งแวดล้อม ฉบับล่าสุด

GLOW SPP 11 COMPANY LIMITED
555/2 Energy Complex Building B, 5th Floor, Vibhavadi - Rangsit Road
Kwaeng Chatuchak, Khet Chatuchak, Bangkok 10900 Thailand
Tel : +66 (0) 2140 4600 Fax : +66 (0) 2140 4601
www.glow.co.th

บริษัท โกลว์ เอสพีพี 11 จำกัด
555/2 ศูนย์เอนเนอร์ยี่คอมเพล็กซ์ อาคารบี ชั้น 5
ถนนวิภาวดีรังสิต แขวงจตุจักร เขตจตุจักร กรุงเทพฯ 10900
โทรศัพท์ : +66 (0) 2140 4600 โทรสาร : +66 (0) 2140 4601

GSPP11 11000083/001/67 สำนักงานกรุงเทพฯ

วันที่ 4 มกราคม 2567

เรื่อง นำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมโครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566

เรียน ผู้อำนวยการกองบริการงานอนุญาตโรงงาน 2
กรมโรงงานอุตสาหกรรม

สิ่งที่ส่งมาด้วย 1.รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566

ตามที่ สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ("สผ.") ได้แจ้งแนวทางการเสนอรายงานการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมและการปฏิบัติตามแผนการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมสำหรับ โครงการด้านอุตสาหกรรม โครงการนิคมอุตสาหกรรมหรือโครงการที่มีลักษณะเดียวกับนิคมอุตสาหกรรม และโครงการด้านพลังงาน เพื่อให้รูปแบบของรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมฯเป็นไปในแนวทางเดียวกันตามรูปแบบที่ สผ. กำหนด รวมทั้งรายงานที่จัดทำขึ้นจะต้องส่งให้หน่วยงานที่เกี่ยวข้องพิจารณา ความละเอียดทราบแล้วนั้น

ในการนี้ บริษัท โกลว์ เอสพีพี 11 จำกัด ขอนำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566 มาเพื่อทราบ รายละเอียดปรากฏตาม สิ่งที่ส่งมาด้วย

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

นางสาวนงลักษณ์ สุขแจ่ม
พนักงานรัฐกิจสัมพันธ์

นางวราลักษณ์ เจริญวงศ์
ผู้จัดการแผนกรัฐสัมพันธ์

ได้ยื่นเอกสารแล้ว
นลิลาภณ ห้องยิ่งยง
๒๕ ม.ค. ๒๕๖๗

แผนกรัฐสัมพันธ์ ฝ่ายรัฐสัมพันธ์และประชาสัมพันธ์ กลุ่มบริษัทโกลว์
โทรศัพท์ 02-6701500 ต่อ 3104

GLOW SPP 11 COMPANY LIMITED
555/2 Energy Complex Building B, 5th Floor, Vibhavadi - Rangsit Road
Kwaeng Chatuchak, Khet Chatuchak, Bangkok 10900 Thailand
Tel : +66 (0) 2140 4600 Fax : +66 (0) 2140 4601
www.glow.co.th

บริษัท โกลว์ เอสพีพี 11 จำกัด
555/2 ศูนย์เอนเนอร์ยี่คอมเพล็กซ์ อาคารบี ชั้น 5
ถนนวิภาวดีรังสิต แขวงจตุจักร เขตจตุจักร กรุงเทพฯ 10900
โทรศัพท์ : +66 (0) 2140 4600 โทรสาร : +66 (0) 2140 4601

ที่ GSPP11 11000083/002/67 สำนักงานกรุงเทพฯ

วันที่ 4 มกราคม 2567

เรื่อง นำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566

เรียน ผู้อำนวยการเขตประกอบการสยามอีสเทิร์นอินดัสเตรียลพาร์ค

สิ่งที่ส่งมาด้วย 1. รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566

ตามที่ สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ("สผ.") ได้แจ้งแนวทางการเสนอรายงานการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมและการปฏิบัติตามแผนการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมสำหรับ โครงการด้านอุตสาหกรรม โครงการนิคมอุตสาหกรรมหรือโครงการที่มีลักษณะเดียวกับนิคมอุตสาหกรรม และโครงการด้านพลังงาน เพื่อให้รูปแบบของรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมฯเป็นไปในแนวทางเดียวกันตามรูปแบบที่ สผ. กำหนด รวมทั้งรายงานที่จัดทำขึ้นจะต้องส่งให้หน่วยงานที่เกี่ยวข้องพิจารณา ความละเอียดทราบแล้วนั้น

ในการนี้ บริษัท โกลว์ เอสพีพี 11 จำกัด ขอนำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566 มาเพื่อทราบ รายละเอียดปรากฏตามสิ่งที่ส่งมาด้วย

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

นางสาวนงลักษณ์ สุขแจ่ม
พนักงานรัฐกิจสัมพันธ์

นางวราลักษณ์ เจริญวงศ์
ผู้จัดการแผนกรัฐสัมพันธ์

เขตประกอบการอุตสาหกรรมสยามอีสเทิร์นอินดัสเตรียลพาร์ค (SIEP)
บริษัท สยามอินโดรามาแอนด์เทคโนโลยี่ จำกัด (SIEN)
ได้รับเอกสารแล้ว
(นลินภัสสร ยอดวิเชียร)
28.1.67
ผู้รับ

แผนกรัฐสัมพันธ์ ฝ่ายรัฐสัมพันธ์และประชาสัมพันธ์ กลุ่มบริษัทโกลว์
โทรศัพท์ 02-6701500 ต่อ 3104

GLOW SPP 11 COMPANY LIMITED
555/2 Energy Complex Building B, 5th Floor, Vibhavadi - Rangsit Road
Kwaeng Chatuchak, Khet Chatuchak, Bangkok 10900 Thailand
Tel : +66 (0) 2140 4600 Fax : +66 (0) 2140 4601
www.glow.co.th

บริษัท โกลว์ เอสพีพี 11 จำกัด
555/2 ศูนย์เอนเนอร์ยี่คอมเพล็กซ์ อาคารบี ชั้น 5
ถนนวิภาวดีรังสิต แขวงจตุจักร เขตจตุจักร กรุงเทพฯ 10900
โทรศัพท์ : +66 (0) 2140 4600 โทรสาร : +66 (0) 2140 4601

ที่ GSPP11 11000083/003/67 สำนักงานกรุงเทพฯ

วันที่ 4 มกราคม 2567

เรื่อง นำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566

เรียน เลขาธิการสำนักงานคณะกรรมการกำกับกิจการพลังงาน

สำเนาเรียน 1. ผู้อำนวยการสำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อมจังหวัดระยอง
2. เลขาธิการสำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม

สิ่งที่ส่งมาด้วย 1. รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566 จำนวน 3 ชุด
2. แผ่นซีดีรอมรายงานผลการปฏิบัติตามมาตรการฯ จำนวน 3 แผ่น

ตามที่ สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ("สผ.") ได้แจ้งแนวทางการเสนอรายงานการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมและการปฏิบัติตามแผนการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมสำหรับ โครงการด้านอุตสาหกรรม โครงการนิคมอุตสาหกรรมหรือโครงการที่มีลักษณะเดียวกับนิคมอุตสาหกรรม และโครงการด้านพลังงาน เพื่อให้รูปแบบของรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมฯเป็นไปในแนวทางเดียวกันตามรูปแบบที่ สผ. กำหนด รวมทั้งรายงานที่จัดทำขึ้นจะต้องส่งให้หน่วยงานที่เกี่ยวข้องพิจารณา ความละเอียดทราบแล้วนั้น

ในการนี้ บริษัท โกลว์ เอสพีพี 11 จำกัด ตั้งอยู่เขตประกอบการอุตสาหกรรมสยามอีสเทิร์นอินดัสเตรียลพาร์ค เป็นผู้ได้รับใบอนุญาตผลิตไฟฟ้า เลขที่ กกพ 01-1(2)/55-108 ขอนำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566 (ระยะดำเนินการ) มาเพื่อทราบ รายละเอียดปรากฏตามสิ่งที่ส่งมาด้วย

ได้รับเอกสารแล้ว
ลงชื่อ.....
ลงวันที่ 25/1/67

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

นางสาวนงลักษณ์ สุขแจ่ม
พนักงานรัฐกิจสัมพันธ์

นางวราลักษณ์ เจริญวงศ์
ผู้จัดการแผนกรัฐสัมพันธ

แผนกรัฐสัมพันธ์ ฝ่ายรัฐสัมพันธ์และประชาสัมพันธ์ กลุ่มบริษัทโกลว์
โทรศัพท์ 02-6701500 ต่อ 3104

GLOW SPP 11 COMPANY LIMITED
555/2 Energy Complex Building B, 5th Floor, Vibhavadi - Rangsit Road
Kwaeng Chatuchak, Khet Chatuchak, Bangkok 10900 Thailand
Tel : +66 (0) 2140 4600 Fax : +66 (0) 2140 4601
www.glow.co.th

บริษัท โกลว์ เอสพีพี 11 จำกัด
555/2 ศูนย์เอนเนอร์ยี่คอมเพล็กซ์ อาคารบี ชั้น 5
ถนนวิภาวดีรังสิต แขวงจตุจักร เขตจตุจักร กรุงเทพฯ 10900
โทรศัพท์ : +66 (0) 2140 4600 โทรสาร : +66 (0) 2140 4601

ที่ GSPP11 11000083/004/67 สำนักงานกรุงเทพฯ

วันที่ 4 มกราคม 2567

เรื่อง นำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566

เรียน อุตสาหกรรมจังหวัดระยอง

สิ่งที่ส่งมาด้วย 1. รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566 จำนวน 1 ชุด
2. แผ่นซีดีรอมรายงานผลการปฏิบัติตามมาตรการฯ จำนวน 1 แผ่น

ตามที่ สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม ("สผ.") ได้แจ้งแนวทางการเสนอรายงานการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมและการปฏิบัติตามแผนการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมสำหรับ โครงการด้านอุตสาหกรรม โครงการนิคมอุตสาหกรรมหรือโครงการที่มีลักษณะเดียวกับนิคมอุตสาหกรรม และโครงการด้านพลังงาน เพื่อให้รูปแบบของรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมฯเป็นไปในแนวทางเดียวกันตามรูปแบบที่ สผ. กำหนด รวมทั้งรายงานที่จัดทำขึ้นจะต้องส่งให้หน่วยงานที่เกี่ยวข้องพิจารณา ความละเอียดทราบแล้วนั้น

ในการนี้ บริษัท โกลว์ เอสพีพี 11 จำกัด ขอนำส่งรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ 2 บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 ระหว่างเดือนกรกฎาคม ถึง ธันวาคม พ.ศ. 2566 มาเพื่อทราบ รายละเอียดปรากฏตามสิ่งที่ส่งมาด้วย

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

นางสาวนงลักษณ์ สุขแจ่ม
พนักงานรัฐกิจสัมพันธ์

นางวราลักษณ์ เจริญวงศ์
ผู้จัดการแผนกรัฐสัมพันธ์

แผนกรัฐสัมพันธ์ ฝ่ายรัฐสัมพันธ์และประชาสัมพันธ์ กลุ่มบริษัทโกลว์
โทรศัพท์ 02-6701500 ต่อ 3104

ตรวจแล้ว
25 ม.ค. 2567

ภาคผนวก ข-2

แผนบำรุงรักษาเชิงป้องกัน

(preventive maintenance program)

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
1	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074311AB-03	ST300 LO TANK	MECH07-1	4311	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
2	MEC 6Y Air Storage Vessel	P074311AC-01	CAU AIR RECIVER TANK	MECH07-1	4311	A	every 72 months	72	Jan-2024	P											
3	MEC 2M Air Compressor	P074311CA-02	CAU AIR COMPRESSOR B	MECH07-1	4311	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
2	MEC 2M Air Compressor	P074311CA-02	CAU AIR COMPRESSOR A	MECH07-1	4311	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
3	MEC 2M Air Compressor	P074311CA-02	CAU AIR COMPRESSOR C	MECH07-1	4311	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
4	MEC 3M LO sampling(Cooling Fan Gear Box)	P074311CF-01	CTU 900: FAN CELL A - GEARBOX	MECH07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
3	MEC 3M LO sampling(Cooling Fan Gear Box)	P074311CF-01	CTU 900: FAN CELL B - GEARBOX	MECH07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
4	MEC 3M LO sampling(Cooling Fan Gear Box)	P074311CF-01	CTU 900: FAN CELL C - GEARBOX	MECH07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
5	MEC 3M LO sampling(Cooling Fan Gear Box)	P074311CF-01	CTU 900: FAN CELL D - GEARBOX	MECH07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
4	MEC 3M Visual Inspect CT Fan &Air cooler	P074311CF-02	CTU 900: FAN CELL A - GEARBOX	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
5	MEC 3M Visual Inspect CT Fan &Air cooler	P074311CF-03	CTU 900: FAN CELL B - GEARBOX	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
6	MEC 3M Visual Inspect CT Fan &Air cooler	P074311CF-04	CTU 900: FAN CELL C - GEARBOX	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
5	MEC 3M Visual Inspect CT Fan &Air cooler	P074311CF-05	CTU 900: FAN CELL D - GEARBOX	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
6	MEC 1Y Inspection for Heat Exchanger	P074311FC-03	ACH-SINGLE EFFECT STEAM FIRED ABS CHILL1	MECH07-1	4311	C	every 12 months	12	Apr-2024				P								
7	MEC 1Y Inspection for Heat Exchanger	P074311FC-03	ACH-SINGLE EFFECT STEAM FIRED ABS CHILL2	MECH07-1	4311	C	every 12 months	12	Apr-2024				P								
6	MEC 3M Absrobtion Chiller Inspection	P074311FC-04	ACH-SINGLE EFFECT STEAM FIRED ABS CHILL1	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
7	MEC 3M Absrobtion Chiller Inspection	P074311FC-04	ACH-SINGLE EFFECT STEAM FIRED ABS CHILL2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
8	MEC 3M Pump Inspection	P074311FL-02	FIRE WATER ELECTRIC FIRE PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
7	MEC 3M Pump Inspection	P074311FL-04	FIRE WATER DIESEL DRIVEN PUMP	MECH07-1	4311	C	every 6 months	6	Apr-2024				P						P		
8	MEC 1M Diesel Engine Inspection	P074311FL-05	FIRE WATER DIESEL DRIVEN PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
9	MEC 3M Pump Inspection	P074311FL-06	FIRE WATER ELECTRIC FIRE PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
8	MEC 3M Pump Inspection	P074311FL-07	FIRE WATER ELECTRIC FIRE PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
9	GSPP11 MEC JP Quaterly for Pump and Rota	P074311FL-11	FIRE WATER ELECTRIC FIRE PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
10	GSPP11 MEC JP Quaterly for Pump and Rota	P074311FL-11	FIRE WATER DIESEL DRIVEN PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
9	GSPP11 MEC JP Quaterly for Pump and Rota	P074311FL-11	FIRE WATER ELECTRIC FIRE PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
10	GSPP11 MEC JP Quaterly for Pump and Rota	P074311FL-11	FIRE WATER ELECTRIC FIRE PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
11	MEC 3M Pump Inspection	P074311IC-15	GT100 HYDRAULIC RATCHET PUMP	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
10	MEC 3M Pump Inspection	P074311ID-08	ACH-CHILLED PRIMARY FEED PUMP THERMAX1	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
11	MEC 3M Pump Inspection	P074311ID-09	ACH-CHILLED PRIMARY FEED PUMP THERMAX1	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
12	MEC 3M Pump Inspection	P074311ID-10	ACH-CONDENSATE PUMP FOR THERMAX #1,#2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
11	MEC 3M Pump Inspection	P074311ID-11	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
12	MEC 3M Pump Inspection	P074311ID-12	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
13	MEC 3M Pump Inspection	P074311ID-13	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
12	MEC 3M Pump Inspection	P074311ID-14	ACH-CONDENSATE PUMP FOR THERMAX #1,#2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
13	GSPP11 MEC JP Quaterly for Pump and Rota	P074311ID-15	ACH-CHILLED PRIMARY FEED PUMP THERMAX1	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
14	GSPP11 MEC JP Quaterly for Pump and Rota	P074311ID-15	ACH-CHILLED PRIMARY FEED PUMP THERMAX1	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
13	GSPP11 MEC JP Quaterly for Pump and Rota	P074311ID-15	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
14	GSPP11 MEC JP Quaterly for Pump and Rota	P074311ID-15	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
15	GSPP11 MEC JP Quaterly for Pump and Rota	P074311ID-15	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
14	GSPP11 MEC JP Quaterly for Pump and Rota	P074311ID-15	ACH-CONDENSATE PUMP FOR THERMAX #1,#2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
15	GSPP11 MEC JP Quaterly for Pump and Rota	P074311ID-15	ACH-CONDENSATE PUMP FOR THERMAX #1,#2	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
16	MEC 1Y Inspection for Heat Exchanger	P074311JC-02	GT100 LUBE OIL COOLER2	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
15	MEC 1Y Inspection for Heat Exchanger	P074311JC-02	GT100 LUBE OIL COOLER1	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
16	MEC 1Y Inspection for Heat Exchanger	P074311JC-04	GT200 LUBE OIL COOLER1	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
17	MEC 1Y Inspection for Heat Exchanger	P074311JC-04	GT200 LUBE OIL COOLER2	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
16	MEC 1Y Inspection for Heat Exchanger	P074311JC-06	ST300 LO COOLER B	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
17	MEC 1Y Inspection for Heat Exchanger	P074311JC-06	ST300 LO COOLER A	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
18	MEC 1Y Inspection for Heat Exchanger	P074311JF-01	CTU 900: AUXILIARY CW EXCHANGER A	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
17	MEC 1Y Inspection for Heat Exchanger	P074311JF-01	CTU 900: AUXILIARY CW EXCHANGER B	MECH07-1	4311	C	every 12 months	12	Feb-2024		P										
18	MEC 1Y Inspection for Heat Exchanger	P074311JF-02	ACH-HEAT PLATE EXCHANGER FOR PTL	MECH07-1	4311	C	every 12 months	12	Apr-2024				P								
19	MEC 3M Crane Inspection	P074311LA-01	JIB CRANE GT200 SWL 100 KGS	MECH07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
18	MEC 2M Fogging System	P074311PA-02	GT200 FOG PUMP No.4	MECH07-1	4311	C	every 2 months	2	Feb-2024		P		P		P		P		P		P
19	MEC 2M Fogging System	P074311PA-05	GT100 FOG PUMP No.1	MECH07-1	4311	C	every 2 months	2	Feb-2024		P		P		P		P		P		P
20	MEC 2M Fogging System	P074311PA-05	GT100 FOG PUMP No.2	MECH07-1	4311	C	every 2 months	2	Feb-2024		P		P		P		P		P		P
19	MEC 2M Fogging System	P074311PA-05	GT100 FOG PUMP No.3	MECH07-1	4311	C	every 2 months	2	Feb-2024		P		P		P		P		P		P
20	MEC 2M Fogging System	P074311PA-05	GT100 FOG PUMP No.4	MECH07-1	4311	C	every 2 months	2	Feb-2024		P		P		P		P		P		P
21	MEC 3M Pump Inspection	P074311PA-07	DMU REGENERATION PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
20	MEC 3M Pump Inspection	P074311PA-08	ACH-CHILLER PRIMARY FEED PUMP TO YORK A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
21	MEC 3M Pump Inspection	P074311PA-09	ACH-CHILLED SECOND FEED PUMP B TO META	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
22	MEC 3M Pump Inspection	P074311PA-10	ACH-CHILLED SECOND FEED PUMP B TO PTL	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
21	MEC 3M Pump Inspection	P074311PA-11	ACH-CHILLED SECOND FEED PUMP TO HX-4001	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
22	MEC 3M Pump Inspection	P074311PA-12	DMU DEMIN WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
23	MEC 3M Pump Inspection	P074311PA-13	ST300 CONDENSATE PUMP A	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
22	MEC 3M Pump Inspection	P074311PA-14	ST300 CONDENSATE PUMP B	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
23	MEC 3M Pump Inspection	P074311PA-15	ST300 RECIRCULATION PUMP	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
24	MEC 3M Pump Inspection	P074311PA-16	HRSG CONDENSATE RECIRCULATION PUMP A	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
23	MEC 3M Pump Inspection	P074311PA-17	HRSG CONDENSATE RECIRCULATION PUMP B	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
24	MEC 3M Pump Inspection	P074311PA-18	DMU REGENERATION PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
25	MEC 3M Pump Inspection	P074311PA-19	ACH-CHILLED SECOND FEED PUMP A TO META	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
24	MEC 3M Pump Inspection	P074311PA-20	ACH-CHILLED SECOND FEED PUMP B TO TNP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
25	MEC 3M Pump Inspection	P074311PA-21	ACH-CHILLED PRIMARY FEED PUMP TO YORK B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
26	MEC 3M Pump Inspection	P074311PA-22	ACH-CHILLED SECOND FEED PUMP A TO PTL	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
25	MEC 3M Pump Inspection	P074311PA-23	ACH-CHILLED SECOND FEED PUMP A TO TNP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
26	MEC 3M Chemical Dosing Pump Inspection	P074311PA-24	ACH-SCALE&CORREOS INHIBIT FEED TO TK4004	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
27	MEC 3M Pump Inspection	P074311PA-25	CTU 900: COOLING WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
26	MEC 3M Pump Inspection	P074311PA-26	CTU 900: COOLING WATER PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
27	MEC 3M Pump Inspection	P074311PA-27	CTU 900: COOLING WATER PUMP C	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
28	MEC 3M Pump Inspection	P074311PA-28	CTU 900: AUXILIARY CW PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
27	MEC 3M Pump Inspection	P074311PA-29	CTU 900: AUXILIARY CW PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
28	MEC 3M Pump Inspection	P074311PA-30	DMU DEMIN WATER PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
29	MEC 3M Pump Inspection	P074311PA-31	WTP EAST WATER FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
28	MEC 3M Pump Inspection	P074311PA-32	WTP EAST WATER FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
29	MEC 3M Pump Inspection	P074311PA-33	WTP SEIP WATER FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
30	MEC 3M Pump Inspection	P074311PA-34	WTP SEIP WATER FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
29	MEC 3M Pump Inspection	P074311PA-35	WTP FILTER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
30	MEC 3M Pump Inspection	P074311PA-36	WTP FILTER PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
31	MEC 3M Pump Inspection	P074311PA-37	WTP BACKWASH PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
30	MEC 3M Pump Inspection	P074311PA-38	WTP CT MAKE-UP PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
31	MEC 3M Pump Inspection	P074311PA-39	WTP CT MAKE-UP PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
32	MEC 3M Pump Inspection	P074311PA-40	WTP DEMIN PLANT FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
31	MEC 3M Pump Inspection	P074311PA-41	WTP DEMIN PLANT FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
32	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLER PRIMARY FEED PUMP TO YORK A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
33	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED PRIMARY FEED PUMP TO YORK B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
32	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED SECOND FEED PUMP A TO META	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
33	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED SECOND FEED PUMP B TO META	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
34	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED SECOND FEED PUMP A TO PTL	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
33	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED SECOND FEED PUMP B TO PTL	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
34	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED SECOND FEED PUMP A TO TNP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
35	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED SECOND FEED PUMP B TO TNP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
34	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ACH-CHILLED SECOND FEED PUMP TO HX-4001	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
35	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ST300 CONDENSATE PUMP B	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
36	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	CTU 900: COOLING WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
35	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ST300 CONDENSATE PUMP A	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
36	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	ST300 RECIRCULATION PUMP	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
37	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	CTU 900: COOLING WATER PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
36	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	CTU 900: COOLING WATER PUMP C	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
37	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	CTU 900: AUXILIARY CW PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
38	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	CTU 900: AUXILIARY CW PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
37	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	DMU DEMIN WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
38	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	DMU DEMIN WATER PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
39	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	DMU REGENERATION PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
38	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	DMU REGENERATION PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
39	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	HRSG CONDENSATE RECIRCULATION PUMP A	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
40	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	HRSG CONDENSATE RECIRCULATION PUMP B	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
39	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP EAST WATER FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
40	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP EAST WATER FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
41	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP SEIP WATER FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
40	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP SEIP WATER FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
41	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP FILTER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
42	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP FILTER PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
41	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP BACKWASH PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
42	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP CT MAKE-UP PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
43	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP CT MAKE-UP PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
42	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP DEMIN PLANT FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
43	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PA-42	WTP DEMIN PLANT FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
44	MEC 3M Pump Inspection	P074311PB-02	ST300 LO EMERGENCY OIL PUMP	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
43	MEC 3M Pump Inspection	P074311PB-03	GT200 HYDRAULIC RATCHET PUMP	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
44	MEC 3M Pump Inspection	P074311PB-04	ST300 HYD MAIN OIL PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
45	MEC 3M Pump Inspection	P074311PB-05	ST300 HYD MAIN OIL PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
44	MEC 3M Pump Inspection	P074311PB-06	ST300 LO PURIFIER PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
45	MEC 3M Chemical Dosing Pump Inspection	P074311PB-07	HRSG HP DRUM PHOSPHATE FEED PUMP A	MECH07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
46	MEC 3M Chemical Dosing Pump Inspection	P074311PB-08	HRSG HP DRUM PHOSPHATE FEED PUMP A	MECH07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
45	MEC 3M Pump Inspection	P074311PC-01	ST300 BOOSTER PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
46	MEC 3M Pump Inspection	P074311PC-02	ST300 BOOSTER PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
47	MEC 3M Pump Inspection	P074311PC-03	CTU 900: SLIP STREAM BOOSTER PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
46	MEC 3M Pump Inspection	P074311PC-04	CTU 900: SLIP STREAM BOOSTER PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
47	MEC 3M Pump Inspection	P074311PC-05	CTU 900: AUXILIARY CW BOOSTER PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
48	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PC-06	ST300 BOOSTER PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
47	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PC-06	ST300 BOOSTER PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
48	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PC-06	CTU 900: SLIP STREAM BOOSTER PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
49	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PC-06	CTU 900: SLIP STREAM BOOSTER PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
48	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PC-06	CTU 900: AUXILIARY CW BOOSTER PUMP	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
49	MEC 3M Chemical Dosing Pump Inspection	P074311PE-01	CTU NaOCL SUBMERSIBLE PUMP	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
50	MEC 3M Pump Inspection	P074311PF-01	DMU DEGASSED WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
49	MEC 3M Pump Inspection	P074311PF-02	DMU DEGASSED WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
50	MEC 3M Chemical Dosing Pump Inspection	P074311PF-03	DMU HCL FEED PUMP	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
51	MEC 3M Chemical Dosing Pump Inspection	P074311PF-04	ACH-H2SO4 CHEMICAL FEED PUMP TO TK-4005	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
50	MEC 3M Chemical Dosing Pump Inspection	P074311PF-05	ACH-NaOCL CHEMICAL FEED PUMP TO TK-4006	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
51	MEC 3M Chemical Dosing Pump Inspection	P074311PF-06	HRSG MORPHOLINE FEED PUMP	MECH07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
52	MEC 3M Chemical Dosing Pump Inspection	P074311PF-07	HRSG DEOXIDIZER FEED PUMP	MECH07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
51	MEC 3M Chemical Dosing Pump Inspection	P074311PF-08	CTU SULFURIC ACID (H2SO4) DOSING PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
52	MEC 3M Chemical Dosing Pump Inspection	P074311PF-09	CTU SULFURIC ACID (H2SO4) DOSING PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
53	MEC 3M Chemical Dosing Pump Inspection	P074311PF-10	CTU SCALE&CORROS INHIBIT DOSING PUMP	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
52	MEC 3M Chemical Dosing Pump Inspection	P074311PF-11	DMU HCL FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
53	MEC 3M Chemical Dosing Pump Inspection	P074311PF-12	DMU HCL FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
54	MEC 3M Chemical Dosing Pump Inspection	P074311PF-13	DMU NaOH FEED PUMP A	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
53	MEC 3M Chemical Dosing Pump Inspection	P074311PF-14	DMU NaOH FEED PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
54	MEC 3M Chemical Dosing Pump Inspection	P074311PF-16	WTP NaOCL DOSING PUMP A	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
55	MEC 3M Chemical Dosing Pump Inspection	P074311PF-17	WTP NaOCL DOSING PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
54	MEC 3M Chemical Dosing Pump Inspection	P074311PF-18	WTP PAC DOSING PUMP A	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
55	MEC 3M Chemical Dosing Pump Inspection	P074311PF-19	WTP PAC DOSING PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
56	MEC 3M Chemical Dosing Pump Inspection	P074311PF-20	WTP NaOH DOSING PUMP A	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
55	MEC 3M Chemical Dosing Pump Inspection	P074311PF-21	WTP NaOH DOSING PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
56	MEC 3M Chemical Dosing Pump Inspection	P074311PF-22	WTP POLYMER DOSING PUMP A	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
57	MEC 3M Chemical Dosing Pump Inspection	P074311PF-23	WTP POLYMER DOSING PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
56	MEC 3M Chemical Dosing Pump Inspection	P074311PF-24	WTP PRESS AID DOSING PUMP A	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
57	MEC 3M Chemical Dosing Pump Inspection	P074311PF-25	WTP PRESS AID DOSING PUMP B	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
58	MEC 3M Chemical Dosing Pump Inspection	P074311PF-26	WTP POLYMER TRANSFER PUMP	MECH07-1	4311	C	every 3 months	3	Feb-2024		P			P			P			P	
57	MEC 3M Pump Inspection	P074311PF-27	WWU EFFLUENT DISPOSAL PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
58	MEC 3M Pump Inspection	P074311PF-28	WWU EFFLUENT DISPOSAL PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
59	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PF-29	DMU DEGASSED WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
58	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PF-29	DMU DEGASSED WATER PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
59	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PF-29	WWU EFFLUENT DISPOSAL PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
60	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PF-29	WWU EFFLUENT DISPOSAL PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
59	MEC 3M Pump Inspection	P074311PG-02	HRSG HP BOILER FEED PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
60	MEC 3M Suction strainer & foot valve	P074311PG-03	HRSG HP BOILER FEED PUMP A	MECH07-1	4311	A	every 3 months	3	Mar-2024			P			P			P			P
61	MEC 3M Pump Inspection	P074311PG-04	HRSG HP BOILER FEED PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
60	MEC 3M Suction strainer & foot valve	P074311PG-05	HRSG HP BOILER FEED PUMP B	MECH07-1	4311	A	every 3 months	3	Mar-2024			P			P			P			P
61	MEC 3M Pump Inspection	P074311PG-06	HRSG LP BOILER FEED PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
62	MEC 3M Suction strainer & foot valve	P074311PG-07	HRSG LP BOILER FEED PUMP A	MECH07-1	4311	A	every 3 months	3	Mar-2024			P			P			P			P
61	MEC 3M Pump Inspection	P074311PG-08	HRSG LP BOILER FEED PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
62	MEC 3M Suction strainer & foot valve	P074311PG-09	HRSG LP BOILER FEED PUMP B	MECH07-1	4311	A	every 3 months	3	Mar-2024			P			P			P			P
63	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PG-10	HRSG LP BOILER FEED PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
62	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PG-10	HRSG HP BOILER FEED PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
63	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PG-10	HRSG HP BOILER FEED PUMP B	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
64	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PG-10	HRSG LP BOILER FEED PUMP A	MECH07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
63	MEC 3M Pump Inspection	P074311PH-01	ST300 VACUUM LIQUID RING PUMP A	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
64	MEC 3M Pump Inspection	P074311PH-02	ST300 VACUUM LIQUID RING PUMP B	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
65	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PH-03	ST300 VACUUM LIQUID RING PUMP A	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
64	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PH-03	ST300 VACUUM LIQUID RING PUMP B	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
65	MEC 3M Chemical Dosing Pump Inspection	P074311PI-01	HRSG LP DRUM PHOSPHATE FEED PUMP A	MECH07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
66	MEC 3M Chemical Dosing Pump Inspection	P074311PI-02	HRSG LP DRUM PHOSPHATE FEED PUMP A	MECH07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
65	MEC 3M Pump Inspection	P074311PJ-01	AUXHYDRAULIC OIL SUPPLY PUMP	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
66	MEC 3M Pump Inspection	P074311PJ-02	AUXHYDRAULIC OIL SUPPLY PUMP	MECH07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
67	MEC 3M Pump Inspection	P074311PJ-03	WTP SLUDGE PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
66	MEC 3M Pump Inspection	P074311PJ-04	WTP SLUDGE PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
67	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PJ-05	WTP SLUDGE PUMP A	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
68	GSPP11 MEC JP Quaterly for Pump and Rota	P074311PJ-05	WTP SLUDGE PUMP B	MECH07-1	4311	C	every 3 months	3	Jan-2024	P			P			P			P		
67	MEC 2M Inspection Filter House	P074311SH-01	GT100 AIR INLET PRE FILTER	MECH07-1	4311	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
68	MEC 2M Inspection Filter House	P074311SH-02	GT200 AIR INLET PRE FILTER	MECH07-1	4311	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
69	MEC 6M Hydraulic filter press	P074311SN-01	WTP FILTER PRESS A	MECH07-1	4311	C	every 6 months	6	Jan-2024	P						P					

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
68	MEC 6M Hydraulic filter press	P074311SN-01	WTP FILTER PRESS B	MECH07-1	4311	C	every 6 months	6	Jan-2024	P						P					
69	MEC 1Y On-Line Safety Valve Testing	P074311VL-01	HRSG400 CPH PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
70	MEC 1Y On-Line Safety Valve Testing	P074311VL-02	LP SHSTEAM OUTLET	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
69	MEC 1Y On-Line Safety Valve Testing	P074311VL-03	HP ECON-3 FW	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
70	MEC 1Y On-Line Safety Valve Testing	P074311VL-04	CAU AIR RECIVER TANK RELIEF VALVE	MECH07-1	4311	A	every 12 months	12	Feb-2024		P										
71	MEC 1Y On-Line Safety Valve Testing	P074311VL-05	HRSG400 HP SH PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
70	MEC 1Y On-Line Safety Valve Testing	P074311VL-06	HRSG400 LP DRUM PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
71	MEC 1Y On-Line Safety Valve Testing	P074311VL-07	HRSG400 HP DRUM PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
72	MEC 1Y On-Line Safety Valve Testing	P074311VL-08	HP ECON-3 FW	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
71	MEC 1Y On-Line Safety Valve Testing	P074311VL-09	LP ECON-3 FW PRESS	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
72	MEC 1Y On-Line Safety Valve Testing	P074311VL-10	HRSG500 CPH PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
73	MEC 1Y On-Line Safety Valve Testing	P074311VL-11	LP SHSTEAM OUTLET	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
72	MEC 1Y On-Line Safety Valve Testing	P074311VL-12	HRSG500 HP SH PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
73	MEC 1Y On-Line Safety Valve Testing	P074311VL-13	HRSG500 LP DRUM PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
74	MEC 1Y On-Line Safety Valve Testing	P074311VL-14	HRSG DEAERATOR OUTLET RELIEF VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
73	MEC 1Y On-Line Safety Valve Testing	P074311VL-15	LP ECON-3 FW PRESS	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
74	MEC 1Y On-Line Safety Valve Testing	P074311VL-16	HRSG500 HP DRUM PRESSURE SAFETY VALVE	MECH07-1	4311	S	every 12 months	12	Feb-2024		P										
75	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074312AB-02	RG LO TANK	MECH07-1	4312	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
74	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074312AB-03	RG LO TANK	MECH07-1	4312	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
75	MEC 3M Diesel and Lube Oil Tank Inspect	P074312AB-04	ST LO TANK	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
76	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074312AB-05	ST LO TANK	MECH07-1	4312	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
75	MEC 3M LO sampling (Gas Comp GEG1-4)	P074312AB-06	ST CONTROL OIL TANK (CONTROL OIL TANK)	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
76	MEC 3M Diesel and Lube Oil Tank Inspect	P074312AB-07	DEMIN STORAGE TANK	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
77	MEC 3M Pump & Rotating Vibration Measure	P074312AB-08	DEMIN NEUTRALIZE PUMP WWT HOLDING POND	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
76	MEC 3M Diesel and Lube Oil Tank Inspect	P074312AB-09	FIRE WATER DIESEL DAY TANK	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
77	MEC 6Y Air Storage Vessel	P074312AC-01	CAU COMPRESSED AIR RECEIVER TANK	MECH07-1	4312	A	every 6 months	6	Jan-2024	P						P					
78	MEC 3M Fan and Blower	P074312BC-01	ENCLOSURE VENTILATION FAN A/B	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
77	MEC 3M Fan and Blower	P074312BC-02	RG LO TANK MIST EXTRACT FAN	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
78	MEC 3M Fan and Blower	P074312BC-03	ENCLOSURE VENTILATION FAN A/B	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
79	MEC 3M Fan and Blower	P074312BC-04	RG LO TANK MIST EXTRACT FAN	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
78	MEC 3M Fan and Blower	P074312BC-05	STG ENCLOSURE VENT FAN A 1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
79	MEC 2M Air Compressor	P074312CA-01	CAU AIR COMP 1 SINGLE STAGE OIL INJECTED	MECH07-1	4312	B	every 2 months	2	Jan-2024	P		P		P		P		P		P	
80	MEC 6M Air Compressor	P074312CA-02	CAU AIR COMP 1 SINGLE STAGE OIL INJECTED	MECH07-1	4312	B	every 6 months	6	Jan-2024	P						P					
79	MEC 3Y Air Compressor	P074312CA-03	CAU AIR COMP 1 SINGLE STAGE OIL INJECTED	MECH07-1	4312	B	every 36 months	36	Jan-2024	P											
80	MEC 2M Air Compressor	P074312CA-04	CAU AIR COMP 2 SINGLE STAGE OIL INJECTED	MECH07-1	4312	B	every 2 months	2	Jan-2024	P		P		P		P		P		P	
81	MEC 6M Air Compressor	P074312CA-05	CAU AIR COMP 2 SINGLE STAGE OIL INJECTED	MECH07-1	4312	B	every 6 months	6	Jan-2024	P						P					
80	MEC 3Y Air Compressor	P074312CA-06	CAU AIR COMP 2 SINGLE STAGE OIL INJECTED	MECH07-1	4312	B	every 36 months	36	Jan-2024	P											
81	MEC 3M Pump & Rotating Vibration Measure	P074312CB-01	GAS COMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
82	MEC 1Y Gas Compressor Inspection	P074312CB-02	GAS COMP 1	MECH07-1	4312	B	every 12 months	12	Jan-2024	P											
81	MEC 3M LO sampling (Gas Comp GEG1-4)	P074312CB-03	GAS COMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
82	MEC 1Y Inspection for Heat Exchanger	P074312CB-04	GAS COMP 1	MECH07-1	4312	B	every 12 months	12	Jan-2024	P											
83	MEC 3M ST Lube Oil and Hydraulic Filter	P074312CB-05	GAS COMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
82	MEC 3M Pump & Rotating Vibration Measure	P074312CB-06	GAS COMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
83	MEC 1Y Inspection for Heat Exchanger	P074312CB-07	GAS COMP 2	MECH07-1	4312	B	every 12 months	12	Jan-2024	P											
84	MEC 3M LO sampling (Gas Comp GEG1-4)	P074312CB-08	GAS COMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
83	MEC 1Y Inspection for Heat Exchanger	P074312CB-09	GAS COMP 2	MECH07-1	4312	B	every 12 months	12	Jan-2024	P											
84	MEC 1Y Gas Compressor Inspection	P074312CB-10	GAS COMP 2	MECH07-1	4312	B	every 12 months	12	Jan-2024	P											
85	MEC 3M ST Lube Oil and Hydraulic Filter	P074312CB-11	GAS COMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
84	MEC 1Y Inspection for Heat Exchanger	P074312CE-01	ST CONTROL OIL COOLER FAN	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
85	MEC 3M Fan and Blower	P074312CE-02	ST CONTROL OIL COOLER FAN	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
86	MEC 3Y Visual Inspection Cooling Fan	P074312CE-03	CT FAN 1	MECH07-1	4312	B	every 3 years	36	Jan-2024	P											
85	MEC 3M Pump Inspection	P074312ED-02	WATER WASHING PUMP POWER FEEDER	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
86	MEC 3M Pump & Rotating Vibration Measure	P074312FL-03	FIRE WATER DIESEL FIRE PUMP	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
87	MEC 1M Diesel Engine Inspection	P074312FL-04	FIRE WATER DIESEL FIRE PUMP	MECH07-1	4312	S	every 6 months	6	Jan-2024	P						P					
86	MEC 1Y Diesel Engine Inspection	P074312FL-05	FIRE WATER DIESEL FIRE PUMP	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
87	MEC 3Y Diesel Engine Inspection	P074312FL-06	FIRE WATER DIESEL FIRE PUMP	MECH07-1	4312	S	every 36 months	36	Jan-2024	P											
88	MEC 3M Pump Inspection	P074312FL-07	FIRE WATER DIESEL FIRE PUMP	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
87	MEC 3M Pump & Rotating Vibration Measure	P074312FL-09	FIRE WATER MOTOR FIRE PUMP (ELEC)	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
88	MEC 3M Pump Inspection	P074312FL-10	FIRE WATER MOTOR FIRE PUMP (ELEC)	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
89	MEC 3M Pump & Rotating Vibration Measure	P074312FL-11	FIRE WATER JOCKEY PUMP	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
88	MEC 3M Pump Inspection	P074312FL-12	FIRE WATER JOCKEY PUMP	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
89	MEC 1Y On-Line Safety Valve Testing	P074312FL-13	FIRE WATER DIESEL DRIVEN PUMP PRV VALVE	MECH07-1	4312	C	every 12 months	12	Jan-2024	P											
90	MEC 1Y On-Line Safety Valve Testing	P074312FL-14	FIRE WATER ELEC PUMP PRV	MECH07-1	4312	C	every 12 months	12	Jan-2024	P											
89	MEC 1Y On-Line Safety Valve Testing	P074312FL-15	FIRE WATER JOCKEY PUMP PRV VALVE	MECH07-1	4312	C	every 12 months	12	Jan-2024	P											
90	MEC 3M Pump & Rotating Vibration Measure	P074312GB-01	CT FAN 1 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
91	MEC 3M LO sampling(Cooling Fan Gear Box)	P074312GB-02	CT FAN 1 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
90	MEC 3M Pump & Rotating Vibration Measure	P074312GB-03	CT FAN 2 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
91	MEC 3M LO sampling(Cooling Fan Gear Box)	P074312GB-04	CT FAN 2 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
92	MEC 3M Pump & Rotating Vibration Measure	P074312GB-05	CT FAN 3 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
91	MEC 3M LO sampling(Cooling Fan Gear Box)	P074312GB-06	CT FAN 3 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
92	MEC 3M Pump & Rotating Vibration Measure	P074312GB-07	CT FAN 4 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
93	MEC 3M LO sampling(Cooling Fan Gear Box)	P074312GB-08	CT FAN 4 GEARREDUCTOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
92	MEC 3M Pump Inspection	P074312GE-01	VG HYDRAULIC PUMP AND HCU	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
93	MEC 3M Pump Inspection	P074312GE-02	HYDROLIC STARTING OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
94	MEC 1Y Inspection for Heat Exchanger	P074312JC-01	INLET AIR HEATER	MECH07-1	4312	C	every 12 months	12	Jan-2024	P											
93	MEC 1Y Inspection for Heat Exchanger	P074312JC-02	LO COOLER	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
94	MEC 1Y Inspection for Heat Exchanger	P074312JC-03	INLET AIR HEATER	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
95	MEC 1Y Inspection for Heat Exchanger	P074312JC-04	LO COOLER	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
94	MEC 1Y Inspection for Heat Exchanger	P074312JF-02	RG LO LO COOLER	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
95	MEC 1Y Inspection for Heat Exchanger	P074312JF-03	INLET AIR COOLING COIL A	MECH07-1	4312	B	every 12 months	12	Jan-2024	P											
96	MEC 1Y Inspection for Heat Exchanger	P074312JF-05	RG LO LO COOLER	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
95	MEC 1Y Inspection for Heat Exchanger	P074312JF-06	INLET AIR COOLING COIL	MECH07-1	4312	B	every 12 months	12	Jan-2024	P											
96	MEC 1Y Inspection for Heat Exchanger	P074312JF-07	ST LO COOLER	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
97	MEC 3M Pump & Rotating Vibration Measure	P074312JJ-01	SPRINT WATER PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
96	MEC 2M Fogging System	P074312JJ-02	SPRINT WATER PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
97	MEC 6M Fogging System	P074312JJ-03	SPRINT WATER PUMP	MECH07-1	4312	B	every 6 months	6	Jan-2024	P						P					
98	MEC 3M Crane Inspection	P074312LA-01	CRANE ELEC WORK SHOP 2 TONS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
99	MEC 3M Crane Inspection	P074312LA-03	HOIST ELEC INLET FILTER HOUSE 380 KGS	MECH07-1	4312	C	every 3 months	3	Mar-2024			P			P			P			P
100	MEC 3M Crane Inspection	P074312LA-06	CHAIN BLOCK ENCLOSURE 3 TONS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
99	MEC 3M Crane Inspection	P074312LA-08	CHAIN BLOCK ENCLOSURE 5 TONS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
98	MEC 1M Fork Lift Inspection	P074312LA-05	CHAIN BLOCK ENCLOSURE 3 TONS	MECH07-1	4312	S	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
99	MEC 3M Crane Inspection	P074312LA-10	CHAIN BLOCK ENCLOSURE 10 TONS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
100	MEC 3M Crane Inspection	P074312LA-12	HOIST ELEC INLET FILTER HOUSE 380 KGS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
101	MEC 3M Crane Inspection	P074312LA-14	CHAIN BLOCK ENCLOSURE 3 TONS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
102	MEC 3M Crane Inspection	P074312LA-17	CHAIN BLOCK ENCLOSURE 10 TONS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
103	MEC 3M Crane Inspection	P074312LA-19	CHAIN BLOCKGMRS 2 TONS	MECH07-1	4312	S	every 3 months	3	Mar-2024			P			P			P			P
104	MEC 3M Crane Inspection	P074312ZL-01	HAND LIFT OFFLINE COMP WASH 1 TONS	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
105	MEC 6M Crane Inspection and Load Test	P074312LA-09	CHAIN BLOCK ENCLOSURE 5 TONS	MECH07-1	4312	S	every 6 months	6	Jan-2024	P						P					
100	MEC 6M Crane Inspection and Load Test	P074312LA-11	CHAIN BLOCK ENCLOSURE 10 TONS	MECH07-1	4312	S	every 6 months	6	Jan-2024	P						P					
101	MEC 3M Crane Inspection	P074312LA-16	CHAIN BLOCK ENCLOSURE 5 TONS	MECH07-1	4312	S	every 6 months	6	Jan-2024	P						P					
102	MEC 6M Crane Inspection and Load Test	P074312LA-18	CHAIN BLOCK ENCLOSURE 10 TONS	MECH07-1	4312	S	every 6 months	6	Jan-2024	P						P					
97	MEC 1Y Crane Inspection and Load Test	P074312LA-02	CRANE ELEC WORK SHOP 2 TONS	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
98	MEC 1Y Crane Inspection and Load Test	P074312LA-04	HOIST ELEC INLET FILTER HOUSE 380 KGS	MECH07-1	4312	C	every 12 months	12	Jan-2024	P											
99	MEC 1Y Crane Inspection and Load Test	P074312LA-07	CHAIN BLOCK ENCLOSURE 3 TONS	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
100	MEC 1Y Crane Inspection and Load Test	P074312LA-13	HOIST ELEC INLET FILTER HOUSE 380 KGS	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
101	MEC 1Y Crane Inspection and Load Test	P074312LA-15	CHAIN BLOCK ENCLOSURE 3 TONS	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
102	MEC 3M Pump & Rotating Vibration Measure	P074312PA-02	CHILLED CIRCURATION PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
103	MEC 3M Pump Inspection	P074312PA-03	CHILLED CIRCURATION PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
104	MEC 3M Pump & Rotating Vibration Measure	P074312PA-04	LP ECO RECIR PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
105	MEC 3M Pump Inspection	P074312PA-05	LP ECO RECIR PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
106	MEC 3M Pump & Rotating Vibration Measure	P074312PA-06	CHILLED CIRCURATION PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
105	MEC 3M Pump Inspection	P074312PA-07	CHILLED CIRCURATION PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
106	MEC 3M Pump & Rotating Vibration Measure	P074312PA-08	LP ECO RECIR PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
107	MEC 3M Pump & Rotating Vibration Measure	P074312PA-09	LP ECO RECIR PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
106	MEC 3M Pump Inspection	P074312PA-10	LP ECO RECIR PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
107	MEC 3M Pump & Rotating Vibration Measure	P074312PA-11	CT ACW+ABS CW PUMP 1	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
108	MEC 3M Pump Inspection	P074312PA-12	CT ACW+ABS CW PUMP 1	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
107	MEC 3M Pump & Rotating Vibration Measure	P074312PA-13	CT ACW+ABS CW PUMP 2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
108	MEC 3M Pump Inspection	P074312PA-14	CT ACW+ABS CW PUMP 2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
109	MEC 3M Pump & Rotating Vibration Measure	P074312PA-15	CT CHILLER CW PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
108	MEC 3M Pump Inspection	P074312PA-16	CT CHILLER CW PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
109	MEC 3M Pump & Rotating Vibration Measure	P074312PA-17	CT CHILLER CW PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
110	MEC 3M Pump Inspection	P074312PA-18	CT CHILLER CW PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
109	MEC 3M Pump & Rotating Vibration Measure	P074312PA-19	DEMIN TRANSFER PUMP1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
110	MEC 3M Pump Inspection	P074312PA-20	DEMIN TRANSFER PUMP1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
111	MEC 3M Pump & Rotating Vibration Measure	P074312PA-21	DEMIN TRANSFER PUMP2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
110	MEC 3M Pump Inspection	P074312PA-22	DEMIN TRANSFER PUMP2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
111	MEC 3M Pump & Rotating Vibration Measure	P074312PA-23	NEUTRALIZATION BASIN TRANSFER PUMP	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
112	MEC 3M Pump Inspection	P074312PA-24	NEUTRALIZATION BASIN TRANSFER PUMP	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
111	MEC 3M Pump & Rotating Vibration Measure	P074312PA-25	DEMIN SYS REGEN WATER PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
112	MEC 3M Pump Inspection	P074312PA-26	DEMIN SYS REGEN WATER PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
113	MEC 3M Pump & Rotating Vibration Measure	P074312PA-27	DEMIN SYS REGEN WATER PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
112	MEC 3M Pump Inspection	P074312PA-28	DEMIN SYS REGEN WATER PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
113	MEC 3M Pump & Rotating Vibration Measure	P074312PA-29	DEMIN SYS NEUTRALIZATION PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
114	MEC 3M Pump Inspection	P074312PA-30	DEMIN SYS NEUTRALIZATION PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
113	MEC 3M Pump & Rotating Vibration Measure	P074312PA-31	DEMIN SYS NEUTRALIZATION PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
114	MEC 3M Pump Inspection	P074312PA-32	DEMIN SYS NEUTRALIZATION PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
115	MEC 3M Pump & Rotating Vibration Measure	P074312PA-33	WTU: FILTER FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
114	MEC 3M Pump Inspection	P074312PA-34	WTU: FILTER FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
115	MEC 3M Pump & Rotating Vibration Measure	P074312PA-35	WTU: RAW WATER PUMP 1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
116	MEC 3M Pump Inspection	P074312PA-36	WTU: RAW WATER PUMP 1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
115	MEC 3M Pump Inspection	P074312PA-37	WTU: RAW WATER PUMP 1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
116	MEC 3M Pump & Rotating Vibration Measure	P074312PA-38	WTU: RAW WATER PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
117	MEC 3M Pump Inspection	P074312PA-39	WTU: RAW WATER PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
116	MEC 3M Pump Inspection	P074312PA-40	WTU: RAW WATER PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
117	MEC 3M Pump & Rotating Vibration Measure	P074312PA-41	WTU: FILTER FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
118	MEC 3M Pump Inspection	P074312PA-42	WTU: FILTER FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
117	MEC 3M Pump & Rotating Vibration Measure	P074312PA-43	WASTE WATER DISCHARGE PUMP 1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
118	MEC 3M Pump & Rotating Vibration Measure	P074312PA-44	WASTE WATER DISCHARGE PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
119	MEC 3M Pump Inspection	P074312PA-45	WASTE WATER DISCHARGE PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
118	MEC 3M Pump Inspection	P074312PB-01	LO SUPPLY AND SCAVENT PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
119	MEC 3M Pump Inspection	P074312PB-02	VG HYDRAULIC PUMP AND HCU	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
120	MEC 3M Pump Inspection	P074312PB-03	RG MAIN OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
119	MEC 3M Pump Inspection	P074312PB-04	RG BACK UP OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
120	MEC 3M Pump Inspection	P074312PB-05	RG EMERGENCY OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
121	MEC 3M Pump Inspection	P074312PB-06	HYDROLIC STARTING OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
120	MEC 3M Pump Inspection	P074312PB-07	LO SUPPLY AND SCAVENT PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
121	MEC 3M Pump Inspection	P074312PB-08	RG MAIN OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
122	MEC 3M Pump Inspection	P074312PB-09	RG BACK UP OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
121	MEC 3M Pump Inspection	P074312PB-10	RG EMERGENCY OIL PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
122	MEC 3M Pump Inspection	P074312PB-11	ST LO AUX. PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
123	MEC 3M Pump Inspection	P074312PB-12	ST LO MAIN PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
122	MEC 3M Pump Inspection	P074312PB-14	ST LO EMERGENCY PUMP	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
123	MEC 3M Pump Inspection	P074312PB-15	ST LO TURNING PUMP	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
124	MEC 3M Pump Inspection	P074312PB-16	ST CONTROL OIL PUMP A	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
123	MEC 3M Pump Inspection	P074312PB-17	ST CONTROL OIL PUMP B	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
124	MEC 3M Pump Inspection	P074312PB-18	ST LO PURIFIER PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
125	MEC 3M Pump & Rotating Vibration Measure	P074312PD-01	SPRINT WATER PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
124	MEC 2M Fogging System	P074312PD-02	SPRINT WATER PUMP	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
125	MEC 6M Fogging System	P074312PD-03	SPRINT WATER PUMP	MECH07-1	4312	B	every 6 months	6	Jan-2024	P						P					
126	MEC 3M Pump & Rotating Vibration Measure	P074312PD-04	CT MAIN CW PUMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
125	MEC 3M Pump Inspection	P074312PD-05	CT MAIN CW PUMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
126	MEC 3M Pump & Rotating Vibration Measure	P074312PD-06	CT MAIN CW PUMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
127	MEC 3M Pump Inspection	P074312PD-07	CT MAIN CW PUMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
126	MEC 3M Chemical Dosing Pump Inspection	P074312PD-08	DEMIN SYS ANTI-SCALE DOSING PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
127	MEC 3M Chemical Dosing Pump Inspection	P074312PD-09	DEMIN SYS ANTI-SCALE DOSING PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
128	MEC 3M Pump Inspection	P074312PD-10	DEMIN SYS RO FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
127	MEC 3M Pump & Rotating Vibration Measure	P074312PD-11	DEMIN SYS RO FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
128	MEC 3M Pump Inspection	P074312PD-12	DEMIN SYS RO FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
129	MEC 3M Pump & Rotating Vibration Measure	P074312PD-13	DEMIN SYS HIGH PRESSURE PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
128	MEC 3M Pump Inspection	P074312PD-14	DEMIN SYS HIGH PRESSURE PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
129	MEC 3M Pump & Rotating Vibration Measure	P074312PD-15	DEMIN SYS HIGH PRESSURE PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
130	MEC 3M Pump Inspection	P074312PD-16	DEMIN SYS HIGH PRESSURE PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
129	MEC 3M Pump & Rotating Vibration Measure	P074312PD-17	DEMIN SYS CIP PUMP	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
130	MEC 3M Pump Inspection	P074312PD-18	DEMIN SYS CIP PUMP	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
131	MEC 3M Pump & Rotating Vibration Measure	P074312PD-19	DEMIN SYS BACK WASH PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
130	MEC 3M Pump Inspection	P074312PD-20	DEMIN SYS BACK WASH PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
131	MEC 3M Pump & Rotating Vibration Measure	P074312PD-21	DEMIN SYS BACK WASH PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
132	MEC 3M Pump Inspection	P074312PD-22	DEMIN SYS BACK WASH PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
131	MEC 3M Pump & Rotating Vibration Measure	P074312PD-23	DEMIN SYS MIXED BED FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
132	MEC 3M Pump Inspection	P074312PD-24	DEMIN SYS MIXED BED FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
133	MEC 3M Pump & Rotating Vibration Measure	P074312PD-25	DEMIN SYS MIXED BED FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
132	MEC 3M Pump Inspection	P074312PD-26	DEMIN SYS MIXED BED FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
133	MEC 3M Pump Inspection	P074312PD-27	BLOWDOWN SUMP PUMP 1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
134	MEC 3M Pump & Rotating Vibration Measure	P074312PD-28	BLOWDOWN SUMP PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
133	MEC 3M Pump Inspection	P074312PD-29	BLOWDOWN SUMP PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
134	MEC 3M Pump Inspection	P074312PE-01	WASTE OILWATER SEPARATOR SUMP PUMP 1	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
135	MEC 3M Pump Inspection	P074312PE-02	WASTE OILWATER SEPARATOR SUMP PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
134	MEC 3M Pump Inspection	P074312PE-03	WASTE OILWATER SEPARATOR SUMP PUMP 2	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
135	MEC 3M Chemical Dosing Pump Inspection	P074312PF-01	PHOSPHATE DOSING PUMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
136	MEC 3M Chemical Dosing Pump Inspection	P074312PF-02	PHOSPHATE DOSING PUMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
135	MEC 3M Chemical Dosing Pump Inspection	P074312PF-03	PHOSPHATE DOSING PUMP 3	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
136	MEC 3M Chemical Dosing Pump Inspection	P074312PF-04	DOSING ANTIOXIDANT DOSING PUMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
137	MEC 3M Chemical Dosing Pump Inspection	P074312PF-05	DOSING ANTIOXIDANT DOSING PUMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
136	MEC 3M Chemical Dosing Pump Inspection	P074312PF-06	DOSING ANTIOXIDANT DOSING PUMP 3	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
137	MEC 3M Chemical Dosing Pump Inspection	P074312PF-07	DOSING AMINE DOSING PUMP 1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
138	MEC 3M Chemical Dosing Pump Inspection	P074312PF-08	DOSING AMINE DOSING PUMP 2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
137	MEC 3M Chemical Dosing Pump Inspection	P074312PF-09	CT COPPER CORROS INHIBIT INJECT PUMP1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
138	MEC 3M Chemical Dosing Pump Inspection	P074312PF-10	CT COPPER CORROS INHIBIT INJECT PUMP2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
139	MEC 3M Chemical Dosing Pump Inspection	P074312PF-11	CT DOSING NaOCl INJECTION PUMP1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
138	MEC 3M Chemical Dosing Pump Inspection	P074312PF-12	CT DOSING NaOCl INJECTION PUMP2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
139	MEC 3M Chemical Dosing Pump Inspection	P074312PF-13	CT SCALE/CORROS INHIBIT INJECT PUMP1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
140	MEC 3M Chemical Dosing Pump Inspection	P074312PF-14	CT SCALE/CORROS INHIBIT INJECT PUMP2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
139	MEC 3M Chemical Dosing Pump Inspection	P074312PF-15	CT DOSING ACID INJECTION PUMP1	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
140	MEC 3M Chemical Dosing Pump Inspection	P074312PF-16	CT DOSING ACID INJECTION PUMP2	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
141	MEC 3M Chemical Dosing Pump Inspection	P074312PF-17	DEMIN SYS SMBS BISULFITE DOSING PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
140	MEC 3M Chemical Dosing Pump Inspection	P074312PF-18	DEMIN SYS SMBS BISULFITE DOSING PUMP B	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
141	MEC 3M Chemical Dosing Pump Inspection	P074312PF-19	DEMIN SYS CAUSTIC SODA DOSING PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
142	MEC 3M Chemical Dosing Pump Inspection	P074312PF-20	DEMIN SYS CAUSTIC SODA DOSING PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
141	MEC 3M Chemical Dosing Pump Inspection	P074312PF-21	DEMIN SYS REGEN HCl ACID DOSING PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
142	MEC 3M Chemical Dosing Pump Inspection	P074312PF-22	DEMIN SYS REGEN HCl ACID DOSING PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
143	MEC 3M Chemical Dosing Pump Inspection	P074312PF-23	WTU: NaOCL FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
142	MEC 3M Chemical Dosing Pump Inspection	P074312PF-24	WTU: NaOCL FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
143	MEC 3M Chemical Dosing Pump Inspection	P074312PF-25	WTU: PAC FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
144	MEC 3M Chemical Dosing Pump Inspection	P074312PF-26	WTU: PAC FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
143	MEC 3M Chemical Dosing Pump Inspection	P074312PF-27	POLYMER FEED PUMP A (CLARIFIER COMMON)	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
144	MEC 3M Pump & Rotating Vibration Measure	P074312PG-01	FEED WATER PUMP2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
145	MEC 3M Pump Inspection	P074312PG-02	FEED WATER PUMP2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
144	MEC 3M Pump & Rotating Vibration Measure	P074312PG-03	FEED WATER PUMP2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
145	MEC 3M Pump Inspection	P074312PG-04	FEED WATER PUMP2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
146	MEC 3M Pump & Rotating Vibration Measure	P074312PG-05	FEED WATER PUMP1	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
145	MEC 3M Pump Inspection	P074312PG-06	FEED WATER PUMP1	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
146	MEC 3M Pump & Rotating Vibration Measure	P074312PG-07	FEED WATER PUMP2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
147	MEC 3M Pump Inspection	P074312PG-08	FEED WATER PUMP2	MECH07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
146	MEC 3M Pump Inspection	P074312PJ-01	WTU: SLUDGE FEED PUMP A	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
147	MEC 3M Pump Inspection	P074312PJ-02	WTU: SLUDGE FEED PUMP B	MECH07-1	4312	C	every 3 months	3	Jan-2024	P			P			P			P		
148	MEC 3M Fan and Blower	P074312SA-01	ST LO TANK VENT FAN	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
147	MEC 3M ST Lube Oil and Hydraulic Filter	P074312SA-02	ST LO PURIFIER OIL/WATER SEPARATOR	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
148	MEC 2M Inspection Filter House	P074312SH-01	INLET AIR PRE-FILTERS	MECH07-1	4312	B	every 2 months	2	Jan-2024	P		P		P		P		P		P	
149	MEC 2M Inspection Filter House	P074312SH-02	INLET AIR PRE-FILTERS	MECH07-1	4312	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
148	MEC 3M GT Lube Oil and Hydraulic Filter	P074312SI-01	LO SUPPLY FILTER	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
149	MEC 3M GT Lube Oil and Hydraulic Filter	P074312SI-02	HYDRAULIC CONTROL UNIT FILTER	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
150	MEC 3M GT Lube Oil and Hydraulic Filter	P074312SI-03	LO SUPPLY FILTER	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
149	MEC 3M GT Lube Oil and Hydraulic Filter	P074312SI-04	HYDRAULIC CONTROL UNIT FILTER	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
150	MEC 3M ST Lube Oil and Hydraulic Filter	P074312SI-05	ST LO FILTER A	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
151	MEC 3M ST Lube Oil and Hydraulic Filter	P074312SI-06	ST CONTROL OIL SUCTION FILTER A	MECH07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
150	MEC 3M Fan and Blower	P074312SN-01	WTU: MAXXFIL CHAMBER FILTER PRESS	MECH07-1	4312	C	every 6 months	6	Jan-2024	P						P					
151	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074312TA-02	GAS TURBINE (LM6000 PF)	MECH07-1	4312	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
152	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074312TA-04	GAS TURBINE (LM6000 PF)	MECH07-1	4312	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
151	MEC 3M Diesel and Lube Oil Tank Inspect	P074312TC-02	EDG DIESEL ENGINE, PERKIN, MODEL	MECH07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
152	MEC 1M Diesel Engine Inspection	P074312TC-03	EDG DIESEL ENGINE, PERKIN, MODEL	MECH07-1	4312	S	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
153	MEC 1Y Diesel Engine Inspection	P074312TC-04	EDG DIESEL ENGINE, PERKIN, MODEL	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
152	MEC 3Y Diesel Engine Inspection	P074312TC-05	EDG DIESEL ENGINE, PERKIN, MODEL	MECH07-1	4312	S	every 36 months	36	Jan-2024	P											
153	MEC 1Y On-Line Safety Valve Testing	P074312VL-01	PRIMARY DISCH COALESCER SAFETY VALVE 1	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
154	MEC 1Y On-Line Safety Valve Testing	P074312VL-02	LP ECO FEED WATER SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
153	MEC 1Y On-Line Safety Valve Testing	P074312VL-03	HP FEED WATER TO HP ECON SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
154	MEC 1Y On-Line Safety Valve Testing	P074312VL-04	LP DRUM PRESSURE RELIEF VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
155	MEC 1Y On-Line Safety Valve Testing	P074312VL-05	HP DRUM SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
154	MEC 1Y On-Line Safety Valve Testing	P074312VL-06	LP SUPERHEAT STEAM OUTLET SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
155	MEC 1Y On-Line Safety Valve Testing	P074312VL-07	HP SH2 STEAM OUTLET PRV	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
156	MEC 1Y On-Line Safety Valve Testing	P074312VL-08	PRIMARY DISCH COALESCER SAFETY VALVE 2	MECH07-1	4312	C	every 12 months	12	Jan-2024	P											
155	MEC 1Y On-Line Safety Valve Testing	P074312VL-09	LP ECO FEED WATER SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
156	MEC 1Y On-Line Safety Valve Testing	P074312VL-10	LP SUPERHEAT STEAM OUTLET SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
157	MEC 1Y On-Line Safety Valve Testing	P074312VL-11	HP FEED WATER TO HP ECON SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
156	MEC 1Y On-Line Safety Valve Testing	P074312VL-12	LP DRUM PRESSURE RELIEF VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
157	MEC 1Y On-Line Safety Valve Testing	P074312VL-13	HP DRUM SAFETY VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
158	MEC 1Y On-Line Safety Valve Testing	P074312VL-14	HP SH2 STEAM OUTLET PRV	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
157	MEC 1Y On-Line Safety Valve Testing	P074312VL-15	ST LP STEAM FLASH CHAMBER PRV	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											

No.	PM Descriptions	Plan in SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
158	MEC 1Y On-Line Safety Valve Testing	P074312VL-16	ST SH HP STEAM RELIEF VALVE	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
159	MEC 1Y On-Line Safety Valve Testing	P074312VL-17	CAU COMPRESSED AIR RECEIVER TANK PRV	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
158	MEC 1Y On-Line Safety Valve Testing	P074312VM-01	GAS COMP RECEIVER SAFETY VALVE 1 & 2	MECH07-1	4312	A	every 12 months	12	Jan-2024	P											
103	MEC 1Y Crane Inspection and Load Test	P074312LA-20	CHAIN BLOCKGMRS 2 TONS	MECH07-1	4312	S	every 12 months	12	Jan-2024	P											
104	MEC 1Y Inspection for Heat Exchanger	P074313EW-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
159	MEC 1Y Inspection for Heat Exchanger	P074313EW-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
160	MEC 3M Pump & Rotating Vibration Measure	P074313FL-01	FIRE WATER ELECTRIC FIRE PUMP	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
161	MEC 3M Pump & Rotating Vibration Measure	P074313FL-01	FIRE WATER DIESEL DRIVEN PUMP	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
160	MEC 3M Pump & Rotating Vibration Measure	P074313FL-01	FIRE WATER ELECTRIC FIRE PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
161	MEC 3M Pump & Rotating Vibration Measure	P074313FL-01	FIRE WATER ELECTRIC FIRE PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
162	MEC 3M Pump & Rotating Vibration Measure	P074313ID-01	ACH-CHILLED PRIMARY FEED PUMP THERMAX1	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
161	MEC 3M Pump & Rotating Vibration Measure	P074313ID-01	ACH-CHILLED PRIMARY FEED PUMP THERMAX1	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
162	MEC 3M Pump & Rotating Vibration Measure	P074313ID-01	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
163	MEC 3M Pump & Rotating Vibration Measure	P074313ID-01	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
162	MEC 3M Pump & Rotating Vibration Measure	P074313ID-01	ACH-CW PUMP FOR ABS THERMAX CHILLER 1,2	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
163	MEC 3M Pump & Rotating Vibration Measure	P074313ID-01	ACH-CONDENSATE PUMP FOR THERMAX #1,#2	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
164	MEC 3M Pump & Rotating Vibration Measure	P074313ID-01	ACH-CONDENSATE PUMP FOR THERMAX #1,#2	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
163	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLER PRIMARY FEED PUMP TO YORK A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
164	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED PRIMARY FEED PUMP TO YORK B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
165	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED SECOND FEED PUMP A TO META	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
164	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED SECOND FEED PUMP B TO META	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
165	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED SECOND FEED PUMP A TO PTL	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
166	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED SECOND FEED PUMP B TO PTL	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
165	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED SECOND FEED PUMP A TO TNP	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
166	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED SECOND FEED PUMP B TO TNP	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
167	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ACH-CHILLED SECOND FEED PUMP TO HX-4001	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
166	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ST300 CONDENSATE PUMP B	MECH07-1	4313	B	every 3 months	3	Jan-2024	P			P			P			P		
167	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	CTU 900: COOLING WATER PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
168	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ST300 CONDENSATE PUMP A	MECH07-1	4313	B	every 3 months	3	Jan-2024	P			P			P			P		
167	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	ST300 RECIRCULATION PUMP	MECH07-1	4313	B	every 3 months	3	Jan-2024	P			P			P			P		
168	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	CTU 900: COOLING WATER PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
169	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	CTU 900: COOLING WATER PUMP C	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
168	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	CTU 900: AUXILIARY CW PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
169	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	CTU 900: AUXILIARY CW PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
170	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	DMU DEMIN WATER PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
169	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	DMU DEMIN WATER PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
170	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	DMU REGENERATION PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
171	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	DMU REGENERATION PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
170	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	HRSG CONDENSATE RECIRCULATION PUMP A	MECH07-1	4313	B	every 3 months	3	Jan-2024	P			P			P			P		
171	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	HRSG CONDENSATE RECIRCULATION PUMP B	MECH07-1	4313	B	every 3 months	3	Jan-2024	P			P			P			P		
172	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP EAST WATER FEED PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
171	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP EAST WATER FEED PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
172	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP SEIP WATER FEED PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
173	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP SEIP WATER FEED PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
172	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP FILTER PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
173	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP FILTER PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
174	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP BACKWASH PUMP	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
173	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP CT MAKE-UP PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
174	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP CT MAKE-UP PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
175	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP DEMIN PLANT FEED PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
174	MEC 3M Pump & Rotating Vibration Measure	P074313PA-01	WTP DEMIN PLANT FEED PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
175	MEC 3M Pump & Rotating Vibration Measure	P074313PC-01	ST300 BOOSTER PUMP A	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
176	MEC 3M Pump & Rotating Vibration Measure	P074313PC-01	ST300 BOOSTER PUMP B	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
175	MEC 3M Pump & Rotating Vibration Measure	P074313PC-01	CTU 900: SLIP STREAM BOOSTER PUMP A	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
176	MEC 3M Pump & Rotating Vibration Measure	P074313PC-01	CTU 900: SLIP STREAM BOOSTER PUMP B	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
177	MEC 3M Pump & Rotating Vibration Measure	P074313PC-01	CTU 900: AUXILIARY CW BOOSTER PUMP	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
176	MEC 3M Pump & Rotating Vibration Measure	P074313PF-01	DMU DEGASSED WATER PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
177	MEC 3M Pump & Rotating Vibration Measure	P074313PF-01	DMU DEGASSED WATER PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
178	MEC 3M Pump & Rotating Vibration Measure	P074313PF-01	WWU EFFLUENT DISPOSAL PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
177	MEC 3M Pump & Rotating Vibration Measure	P074313PF-01	WWU EFFLUENT DISPOSAL PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
178	MEC 3M Pump & Rotating Vibration Measure	P074313PG-01	HRSG LP BOILER FEED PUMP B	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
179	MEC 3M Pump & Rotating Vibration Measure	P074313PG-01	HRSG HP BOILER FEED PUMP A	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
178	MEC 3M Pump & Rotating Vibration Measure	P074313PG-01	HRSG HP BOILER FEED PUMP B	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
179	MEC 3M Pump & Rotating Vibration Measure	P074313PG-01	HRSG LP BOILER FEED PUMP A	MECH07-1	4313	A	every 3 months	3	Jan-2024	P			P			P			P		
180	MEC 3M Pump & Rotating Vibration Measure	P074313PH-01	ST300 VACUUM LIQUID RING PUMP A	MECH07-1	4313	B	every 3 months	3	Jan-2024	P			P			P			P		
179	MEC 3M Pump & Rotating Vibration Measure	P074313PH-01	ST300 VACUUM LIQUID RING PUMP B	MECH07-1	4313	B	every 3 months	3	Jan-2024	P			P			P			P		
180	MEC 3M Pump & Rotating Vibration Measure	P074313PJ-01	WTP SLUDGE PUMP A	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		

No.	PM Descriptions	Plan In SAP	Functional Location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
181	MEC 3M Pump & Rotating Vibration Measure	P074313PJ-01	WTP SLUDGE PUMP B	MECH07-1	4313	C	every 3 months	3	Jan-2024	P			P			P			P		
180	MEC 1Y Inspection for Heat Exchanger	P074313RG-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
181	MEC 1Y Inspection for Heat Exchanger	P074313RG-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
182	MEC 1Y Inspection for Heat Exchanger	P074313RK-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
181	MEC 1Y Inspection for Heat Exchanger	P074313RK-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
182	MEC 1Y Inspection for Heat Exchanger	P074313RK-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
183	MEC 1Y Inspection for Heat Exchanger	P074313RK-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
182	MEC 1Y Inspection for Heat Exchanger	P074313RL-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
183	MEC 1Y Inspection for Heat Exchanger	P074313RL-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
184	MEC 1Y Inspection for Heat Exchanger	P074313RN-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
183	MEC 1Y Inspection for Heat Exchanger	P074313RN-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
184	MEC 1Y Inspection for Heat Exchanger	P074313RN-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
185	MEC 1Y Inspection for Heat Exchanger	P074313RN-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
184	MEC 1Y Inspection for Heat Exchanger	P074313RO-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
185	MEC 1Y Inspection for Heat Exchanger	P074313RO-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
186	MEC 1Y Inspection for Heat Exchanger	P074313RZ-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
185	MEC 1Y Inspection for Heat Exchanger	P074313RZ-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
186	MEC 1Y Inspection for Heat Exchanger	P074313RZ-01	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
187	MEC 1Y Inspection for Heat Exchanger	P074313RZ-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
186	MEC 1Y Inspection for Heat Exchanger	P074313RZ-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
187	MEC 1Y Inspection for Heat Exchanger	P074313RZ-02	Exchanger, Plate Heat, Primary CW Cooler	MECH07-1	4313	A	every 12 months	12	Jan-2024	P											
188	MEC 2M Air Compressor	P074314CA-01	GSPP11 New Gas Engine INT Air Unit 1	MECH07-1	4314	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
187	MEC 2M Air Compressor	P074314CA-02	GSPP11 New Gas Engine INT Air Unit 2	MECH07-1	4314	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
188	MEC 1Y Air Storage Vessel	P074314CA-03	STARTING AIR COMPRESSOR UNIT	MECH07-1	4314	C	every 12 months	12	Jan-2024	P											
189	MEC 1Y Air Storage Vessel	P074314CA-04	STARTING AIR COMPRESSOR UNIT	MECH07-1	4314	C	every 12 months	12	Jan-2024	P											
188	MEC 2M Air Compressor	P074314CA-05	STARTING AIR COMPRESSOR UNIT	MECH07-1	4314	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
189	MEC 2M Air Compressor	P074314CA-06	STARTING AIR COMPRESSOR UNIT	MECH07-1	4314	C	every 2 months	2	Jan-2024	P		P		P		P		P		P	
190	MEC 6M Heat Exchanges Cleaning	P074314PA-01	centrifugal pump assembly exp. vessel	MECH07-1	4314	C	every 6 months	6	Jan-2024	P						P					
189	MEC 3M Pump Inspection	P074314PA-02	CENTRIFUGAL PUMP ASSEMBLY CIR PREHEATING	MECH07-1	4314	A	every 3 months	3	Jan-2024	P			P			P			P		
190	MEC 6M Heat Exchanges Cleaning	P074314PA-03	Assembly water from exp. vessel	MECH07-1	4314	C	every 6 months	6	Jan-2024	P						P					
191	MEC 3M Pump Inspection	P074314PA-04	CENTRIFUGAL PUMP ASSEMBLY CIR PREHEATING	MECH07-1	4314	C	every 3 months	3	Jan-2024	P			P			P			P		
190	MEC 1M Diesel Engine Inspection	P074314TC-01	Internal combust GEG5 Wartsila W20V34SG	MECH07-1	4314	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
191	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074314TC-02	Internal combust GEG5 Wartsila W20V34SG	MECH07-1	4314	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
192	MEC 1M Diesel Engine Inspection	P074314TC-23	Internal combustion GEG6 model W20V34SG	MECH07-1	4314	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
191	MEC 1M Lube Oil Sampling (GT,ST, GEG5-6)	P074314TC-24	Internal combustion GEG6 model W20V34SG	MECH07-1	4314	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P

No.	PM Descriptions	Plan in SAP	functional location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
1	ELC 2M motor inspection	P074311MB-01	TURBINE COMPARTMENT MOTOR-1	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
2	ELC 2M motor inspection	P074311MB-01	TURBINE COMPARTMENT MOTOR-2	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
3	ELC 2M motor inspection	P074311MB-01	LUBE MIST SEPARATOR OR ELIMINATOR MOTOR	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
4	ELC 2M motor inspection	P074311MB-01	SHELL & EXHAUST FRAME BLOWER	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
5	ELC 2M motor inspection	P074311MB-01	LOAD COMPARTMENT COOLING AIR FAN MOTOR	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
6	ELC 2M motor inspection	P074311MB-01	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
7	ELC 2M motor inspection	P074311MB-01	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
8	ELC 2M motor inspection	P074311MB-01	GT100 HYDRAULIC SUPPLY PUMP MOTOR	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
9	ELC 2M motor inspection	P074311MB-01	GT100 AUXILIARY LUBE OIL PUMP MOTOR	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
10	ELC 2M motor inspection	P074311MC-01	GT100 DIESEL ENGINE STARTER	ELEC07-1	4311	B	every 3 months	3	Feb-2024		P			P			P			P	
11	ELC 2M motor inspection	P074311MC-01	GT100 HYDRAULIC RATCHET PUMP MOTOR	ELEC07-1	4311	A	every 3 months	3	Feb-2024		P			P			P			P	
12	ELC 2M motor inspection	P074311MC-01	GT100: MOTOR, EMERGENCY LUBE OIL PUMP	ELEC07-1	4311	S	every 3 months	3	Feb-2024		P			P			P			P	
13	ELC 2M motor inspection	P074311MB-02	TURBINE COMPARTMENT VENT FAN MOTOR-1	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
14	ELC 2M motor inspection	P074311MB-02	TURBINE COMPARTMENT VENT FAN MOTOR-2	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
15	ELC 2M motor inspection	P074311MB-02	LUBE MIST SEPARATOR OR ELIMINATOR MOTOR	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
16	ELC 2M motor inspection	P074311MB-02	SHELL & EXHAUST FRAME BLOWER	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
17	ELC 2M motor inspection	P074311MB-02	LOAD COMPARTMENT COOLING AIR FAN MOTOR	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
18	ELC 2M motor inspection	P074311MB-02	LOAD COMPARTMENT COOLING AIR FAN MOTOR	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
19	ELC 2M motor inspection	P074311MB-02	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
20	ELC 2M motor inspection	P074311MB-02	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
21	ELC 2M motor inspection	P074311MB-02	GT200 HYDRAULIC SUPPLY PUMP MOTOR HEATER	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
22	ELC 2M motor inspection	P074311MB-02	GT200 HYDRAULIC SUPPLY PUMP MOTOR	ELEC07-1	4311	A	every 3 months	3	Mar-2024			P			P			P			P
23	ELC 2M motor inspection	P074311MB-02	GT200 AUXILIARY LUBE OIL PUMP MOTOR	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
24	ELC 2M motor inspection	P074311MC-02	GT200 HYDRAULIC RATCHET PUMP MOTOR	ELEC07-1	4311	A	every 3 months	3	Mar-2024			P			P			P			P
25	ELC 2M motor inspection	P074311MC-02	GT200: MOTOR, EMERGENCY LUBE OIL PUMP	ELEC07-1	4311	S	every 3 months	3	Mar-2024			P			P			P			P
26	ELC 2M motor inspection	P074311MB-05	GT100 FOG PUMP MOTOR No.1	ELEC07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
27	ELC 2M motor inspection	P074311MB-05	GT100 FOG PUMP MOTOR No.2	ELEC07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
28	ELC 2M motor inspection	P074311MB-05	GT100 FOG PUMP MOTOR No.3	ELEC07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
29	ELC 2M motor inspection	P074311MB-05	GT100 FOG PUMP MOTOR No.4	ELEC07-1	4311	B	every 3 months	3	Jan-2024	P			P			P			P		
30	ELC 2M motor inspection	P074311MB-06	GT200 FOG PUMP MOTOR No.1	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
31	ELC 2M motor inspection	P074311MB-06	GT200 FOG PUMP MOTOR No.2	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
32	ELC 2M motor inspection	P074311MB-06	GT200 FOG PUMP MOTOR No.3	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
33	ELC 2M motor inspection	P074311MB-06	GT200 FOG PUMP MOTOR No.4	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
34	ELC 3M Transformer inspection	P074311EB-03	GEN200 GSUT2 STEPUP TRANSFORMER	ELEC07-1	4311	B	every 3 months	3	Apr-2024				P			P			P		
35	ELC 3M Transformer inspection	P074311EB-09	GEN100 GSUT1 STEPUP TRANSFORMER	ELEC07-1	4311	A	every 3 months	3	Apr-2024				P			P			P		
36	ELC 3M Transformer inspection	P074311EB-10	GEN300 GSUT3 STEPUP TRANSFORMER	ELEC07-1	4311	A	every 3 months	3	Apr-2024				P			P			P		
37	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION ADMIN & FINANCE	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
38	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION OPERATION MGR.	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
39	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION MAINTENANCE MGR.	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
40	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION CONFERENCE ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
41	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION CANTEEN	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
42	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION COPY ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
43	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION SUPERVISOR ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
44	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION SAFETY ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
45	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION PLANT MANAGER ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
46	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION CONFERENCE ROOM 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
47	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION LIBRARY ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
48	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION SERVER ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
49	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION STORE ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
50	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION ADMIN FIRST FLOOR	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
51	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION ADMIN SECOND FLOOR	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
52	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION WORK SHOP	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
53	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION ADMIN LOBBY	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
54	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION MCC CHILLER PLANT	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
55	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW WAREHOUSE 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
56	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW WAREHOUSE 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
57	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW WAREHOUSE 3	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
58	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW WAREHOUSE 4	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
59	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW WAREHOUSE 5	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
60	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW WAREHOUSE 6	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
61	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION CEM HRSG-400	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
62	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION CEM HRSG-500	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
63	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION SHIFT TEAM 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
64	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION SHIFT TEAM 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
65	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION RECEPTION AREA	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
66	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION CONTROL ROOM 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
67	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION CONTROL ROOM 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
68	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION MCC ROOM 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
69	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION MCC ROOM 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
70	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION I/O ROOM 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
71	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION I/O ROOM 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
72	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION FIRST AID	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
73	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION LABORATORY ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
74	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION BATTERY ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
75	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION MCC ROOM 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
76	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION MCC ROOM 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
77	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION TOOLS ROOM	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
78	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION WORK SHOP	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
79	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION GAS TURBINE 100-1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P

No.	PM Descriptions	Plan in SAP	functional location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
80	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION GAS TURBINE 100-2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
81	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION GAS TURBINE 200-1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
82	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION GAS TURBINE 200-2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
83	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION PTT GAS METERING 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
84	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION PTT GAS METERING 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
85	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW 22 KV SUBSTATION 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
86	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION NEW 22 KV SUBSTATION 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
87	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION 22KV SUBSTATION 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
88	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION 22KV SUBSTATION 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
89	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION 22KV SUBSTATION 3	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
90	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION WATER TREATMENT PLANT 1	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
91	Running test consist of I, V, P , coil	P074311BA-01	AIR CONDITION WATER TREATMENT PLANT 2	ELEC07-1	4311	C	every 3 months	3	Mar-2024			P			P			P			P
92	ELC 2M motor inspection	P074312MB-01	FEED WATER PUMP1 MOTOR	ELEC07-1	4312	B	every 3 months	3	Mar-2024			P			P			P			P
93	ELC 2M motor inspection	P074312MB-01	FEED WATER PUMP2 MOTOR	ELEC07-1	4312	B	every 3 months	3	Mar-2024			P			P			P			P
94	ELC 2M motor inspection	P074312MB-01	LP ECO RECIR PUMP MOTOR	ELEC07-1	4312	B	every 3 months	3	Mar-2024			P			P			P			P
95	ELC 2M motor inspection	P074312MB-02	FEED WATER PUMP1 MOTOR	ELEC07-1	4312	B	every 3 months	3	Mar-2024			P			P			P			P
96	ELC 2M motor inspection	P074312MB-02	FEED WATER PUMP2 MOTOR	ELEC07-1	4312	B	every 3 months	3	Mar-2024			P			P			P			P
97	ELC 2M motor inspection	P074312MB-02	LP ECO RECIR PUMP MOTOR	ELEC07-1	4312	B	every 3 months	3	Mar-2024			P			P			P			P
98	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 115KV SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
99	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 115KV SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
100	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 115KV SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
101	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 22KV SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
102	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 22KV SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
103	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
104	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
105	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
106	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
107	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
108	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
109	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
110	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
111	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
112	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
113	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 2ND FLOOR BATTERY ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
114	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
115	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
116	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
117	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
118	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
119	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
120	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
121	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
122	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
123	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
124	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
125	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
126	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
127	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION 1ST FLOOR CONTROL ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
128	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
129	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
130	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
131	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
132	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
133	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
134	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION OF REMOTE I/O PANEL PLANT1	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
135	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION OF REMOTE I/O PANEL PLANT2	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
136	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION OF REMOTE I/O PANEL PLANT3	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
137	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION ST SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
138	ELC 1M HVAC System Inspection	P074312BA-01	AIR CONDITION ST SWITCH GEAR ROOM	ELEC07-1	4312	C	every 9 months	9	Jun-2024						P						
139	ELC 2M Excitor and AVR Inspection	P074314IV-01	PLATE, AVR	ELEC07-1	4314	A	every 6 months	6	Mar-2024			P						P			
140	MEC 3M Absrobtion Chiller Inspection	P074312JF-01	CHILLER	ELEC07-1	4312	A	every 2 months	2	Feb-2024		P		P		P		P		P		P
141	ELC 2M Excitor and AVR Inspection	P074311EW-02	GEN100 EXCITATION CONTROL PANEL	ELEC07-1	4311	B	every 2 months	2	Jan-2024	P		P		P		P		P		P	
142	MEC 3M Absrobtion Chiller Inspection	P074312JF-04	CHILLER	ELEC07-1	4312	A	every 2 months	2	Feb-2024		P		P		P		P		P		P
143	ELC 2M Excitor and AVR Inspection	P074314IV-02	PLATE, AVR	ELEC07-1	4314	C	every 6 months	6	Feb-2024		P						P				
144	ELC 2M Excitor and AVR Inspection	P074311EW-01	GEN200 EXCITATION CONTROL PANEL	ELEC07-1	4311	B	every 3 months	3	Mar-2024			P			P			P			P
145	ELC 2M motor inspection	P074312MB-05	POLYMER DISSOLVING TANK AGITATOR MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
146	ELC 2M motor inspection	P074312MB-05	SLUDGE FEED THICKENER AGITATOR MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
147	ELC 2M motor inspection	P074312MB-05	WTU: FILTER FEED PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
148	ELC 2M motor inspection	P074312MB-05	WTU: NaOCL FEED PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
149	ELC 2M motor inspection	P074312MB-05	WTU: NaOCL FEED PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
150	ELC 2M motor inspection	P074312MB-05	WTU: PAC FEED PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
151	ELC 2M motor inspection	P074312MB-05	WTU: PAC FEED PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
152	ELC 2M motor inspection	P074312MB-05	WTU: RAW WATER PUMP 1 MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
153	ELC 2M motor inspection	P074312MB-05	WTU: RAW WATER PUMP 2 MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
154	ELC 2M motor inspection	P074312MB-05	WTU: FILTER FEED PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
155	ELC 2M motor inspection	P074312MB-05	WTU: SLUDGE FEED PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
156	ELC 2M motor inspection	P074312MB-05	POLYMER FEED PUMP D MOTOR (CLARIFIER)	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
157	ELC 2M motor inspection	P074312MB-05	POLYMER FEED PUMP E MOTOR (CLARIFIER)	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
158	ELC 2M motor inspection	P074312MB-05	POLYMER FEED PUMP A MOTOR (CLARIFIER)	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	

No.	PM Descriptions	Plan in SAP	functional location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
159	ELC 2M motor inspection	P074312MB-05	POLYMER FEED PUMP B MOTOR (FILTER PRESS)	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
160	ELC 2M motor inspection	P074312MB-05	POLYMER FEED PUMP C MOTOR (FILTER PRESS)	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
161	ELC 2M motor inspection	P074312MB-04	DEMIN TRANSFER PUMP MOTOR1	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
162	ELC 2M motor inspection	P074312MB-04	DEMIN TRANSFER PUMP MOTOR2	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
163	ELC 2M motor inspection	P074312MB-04	DEMIN SYS RO FEED PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
164	ELC 2M motor inspection	P074312MB-04	DEMIN SYS RO FEED PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
165	ELC 2M motor inspection	P074312MB-04	DEMIN SYS ANTI-SCALE DOSING PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
166	ELC 2M motor inspection	P074312MB-04	DEMIN SYS ANTI-SCALE DOSING PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
167	ELC 2M motor inspection	P074312MB-04	DEMIN SYS CIP PUMP MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
168	ELC 2M motor inspection	P074312MB-04	DEMIN CAUSTIC SODA DOSING PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
169	ELC 2M motor inspection	P074312MB-04	DEMIN CAUSTIC SODA DOSING PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
170	ELC 2M motor inspection	P074312MB-04	DEMIN SYS BACK WASH PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
171	ELC 2M motor inspection	P074312MB-04	DEMIN SYS BACK WASH PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
172	ELC 2M motor inspection	P074312MB-04	DEMIN SYS MIXED BED FEED PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
173	ELC 2M motor inspection	P074312MB-04	DEMIN SYS MIXED BED FEED PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
174	ELC 2M motor inspection	P074312MB-04	DEMIN SYS NEUTRALIZATION PUMP A MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
175	ELC 2M motor inspection	P074312MB-04	DEMIN SYS NEUTRALIZATION PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
176	ELC 2M motor inspection	P074312MB-04	DEMIN SYS REGEN WATER PUMP B MOTOR	ELEC07-1	4312	C	every 3 months	3	Feb-2024		P			P			P			P	
177	ELC 2M motor inspection	P074312MB-06	WASTE OILWATER SEPARATE SUMP PUMP1 MOTOR	ELEC07-1	4312	B	every 3 months	3	Feb-2024		P			P			P			P	
178	ELC 2M motor inspection	P074312MB-06	WASTE OILWATER SEPARATE SUMP PUMP2 MOTOR	ELEC07-1	4312	B	every 3 months	3	Feb-2024		P			P			P			P	
179	ELC 2M motor inspection	P074312MB-06	WASTE WATER DISCHARGE PUMP 1 MOTOR	ELEC07-1	4312	B	every 3 months	3	Feb-2024		P			P			P			P	
180	ELC 2M motor inspection	P074312MB-06	WASTE WATER DISCHARGE PUMP 2 MOTOR	ELEC07-1	4312	B	every 3 months	3	Feb-2024		P			P			P			P	
181	ELC 2M motor inspection	P074312MB-03	CT FAN 1 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
182	ELC 2M motor inspection	P074312MB-03	CT FAN 2 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
183	ELC 2M motor inspection	P074312MB-03	CT FAN 3 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
184	ELC 2M motor inspection	P074312MB-03	CT FAN 4 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
185	ELC 2M motor inspection	P074312MB-03	CT MAIN CW PUMP 1 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
186	ELC 2M motor inspection	P074312MB-03	CT MAIN CW PUMP 2 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
187	ELC 2M motor inspection	P074312MB-03	CT ACW+ABS CW PUMP 1 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
188	ELC 2M motor inspection	P074312MB-03	CT ACW+ABS CW PUMP 2 MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
189	ELC 2M motor inspection	P074312MB-03	CT CHILLER CW PUMP MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
190	ELC 2M motor inspection	P074312MB-03	CT CHILLER CW PUMP MOTOR	ELEC07-1	4312	B	every 3 months	3	Jan-2024	P			P			P			P		
191	ELC 3M VRLA type battery inspection	P074312EP-01	125VDC BATTERY CHARGER 1	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
192	ELC 3M VRLA type battery inspection	P074312EP-01	125VDC BATTERY BANK 1	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
193	ELC 3M VRLA type battery inspection	P074312EP-01	125VDC BATTERY CHARGER 2	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
194	ELC 3M VRLA type battery inspection	P074312EP-01	125VDC BATTERY BANK 2	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
195	ELC 3M VRLA type battery inspection	P074312EP-01	EDG BATTERY, 12V, 200AH	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
196	ELC 3M VRLA type battery inspection	P074312ED-01	MCC 125V BATTERY CHARGER 1 POWER FEEDER	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
197	ELC 3M VRLA type battery inspection	P074312ED-01	MCC 125V BATTERY CHARGER 2 POWER FEEDER	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
198	ELC 3M VRLA type battery inspection	P074312EQ-01	UPS 230V DC 220V BATTERY RACK -108 CELLS	ELEC07-1	4312	S	every 3 months	3	Jan-2024	P			P			P			P		
199	ELC 3M UPS& Charger inspection	P074311EP-01	GT100 CHARGER	ELEC07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
200	ELC 3M UPS& Charger inspection	P074311EP-01	GT200 CHARGER	ELEC07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
201	ELC 3M UPS& Charger inspection	P074311EE-01	DB1202 UPS-1201,230Vac UPS.	ELEC07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
202	ELC 3M UPS& Charger inspection	P074311EE-01	DB1202 DC-1201,CHARGER-220Vdc	ELEC07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
203	ELC 3M UPS& Charger inspection	P074311EE-01	DB1202 DC-1202,CHARGER-220Vdc	ELEC07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
204	ELC 3M UPS& Charger inspection	P074311EE-01	DB1202 UPS-1201,230Vac UPS.	ELEC07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
205	ELC 3M UPS& Charger inspection	P074311EE-01	DB1202 DC-1203,CHARGER-24Vdc	ELEC07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
206	ELC 3M UPS& Charger inspection	P074311EE-01	DB1202 DC-1204,CHARGER-24Vdc.	ELEC07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
207	ELC 3M UPS& Charger inspection	P074311EE-01	DB1204 230VAC UPS SYSTEM	ELEC07-1	4311	S	every 3 months	3	Jan-2024	P			P			P			P		
208	ELC 3M UPS& Charger inspection	P074311EE-01	DB1204 INCOMING FROM UPS-1201	ELEC07-1	4311	A	every 3 months	3	Jan-2024	P			P			P			P		
209	ELC 3M Transformer inspection	P074312EA-01	GTG1 STEPUP TRANSFORMER1	ELEC07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
210	ELC 3M Transformer inspection	P074312EA-01	STEPUP TRANSFORMER2	ELEC07-1	4312	A	every 3 months	3	Jan-2024	P			P			P			P		
211	ELC 3Y Motor Inspection (Shut down)	P074311MB-07	ST300 LUBE OIL VENT FAN - MOTOR	ELEC07-1	4311	B	every 3 years	36	Jan-2024	P											
212	ELC 3Y Motor Inspection (Shut down)	P074311MB-08	ST300 TURNING DEVICE - MOTOR	ELEC07-1	4311	A	every 3 years	36	Jan-2024	P											
213	ELC 1Y Motor Inspection	P074311MB-09	LUBE MIST SEPARATOR OR ELIMINATOR MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
214	ELC 3Y Motor Inspection (Shut down)	P074311MB-10	ST300 LO PURIFIER PUMP MOTOR	ELEC07-1	4311	B	every 3 years	36	Jan-2024	P											
215	ELC 1Y Motor Inspection	P074311MB-11	SHELL & EXHAUST FRAME BLOWER	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
216	ELC 1Y Motor Inspection	P074311MB-12	SHELL & EXHAUST FRAME BLOWER	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
217	ELC 3Y Motor Inspection (Shut down)	P074311MB-13	ST300 CONDENSATE PUMP A - MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
218	ELC 3Y Motor Inspection (Shut down)	P074311MB-14	ST300 CONDENSATE PUMP B - MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
219	ELC 1Y Motor Inspection	P074311MB-15	LOAD COMPARTMENT COOLING AIR FAN MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
220	ELC 3Y Motor Inspection (Shut down)	P074311MB-16	ST300 RECIRCULATION PUMP - MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
221	ELC 1Y Motor Inspection	P074311MB-17	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
222	ELC 3Y Motor Inspection (Shut down)	P074311MB-18	ST300 VENTILATION FAN MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
223	ELC 1Y Motor Inspection	P074311MB-19	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
224	ELC 3Y Motor Inspection (Shut down)	P074311MB-20	ST300 GLAND CONDENSER FAN - MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
225	ELC 3Y Motor Inspection (Shut down)	P074311MB-21	ST300 VACUUM LIQUID RING PUMP A MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
226	ELC 1Y Motor Inspection	P074311MB-22	HRSG HP BOILER FEED PUMP MOTOR A	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
227	ELC 1Y Motor Inspection	P074311MB-23	CTU900 SLIP STREAM BOOSTER PUMP B -MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
228	ELC 1Y Motor Inspection	P074311MB-24	HRSG HP BOILER FEED PUMP MOTOR B	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
229	ELC 1Y Motor Inspection	P074311MB-25	CTU 900: SUMP PUMP - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
230	ELC 1Y Motor Inspection	P074311MB-26	CTU H2SO4 DOSING PUMP MOTOR A	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
231	ELC 1Y Motor Inspection	P074311MB-27	CTU SCALE&CORROS INHIBIT DOSING PUMP	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
232	ELC 1Y Motor Inspection	P074311MB-28	CTU H2SO4 DOSING PUMP MOTOR B	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
233	ELC 1Y Motor Inspection	P074311MB-29	CTU 900: AUXILIARY CW PUMP A - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
234	ELC 1Y Motor Inspection	P074311MB-30	CTU 900: AUXILIARY CW PUMP B - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
235	ELC 3Y Motor Inspection (Shut down)	P074311MB-31	ST300 LO EMERGENCY OIL PUMP MOTOR	ELEC07-1	4311	S	every 3 years	36	Jun-2024						P						
236	ELC 1Y Motor Inspection	P074311MB-32	CTU 900 AUX CW BOOSTER PUMP - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
237	ELC 1Y Motor Inspection	P074311MB-33	DMU DEMIN WATER PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						

No.	PM Descriptions	Plan in SAP	functional location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
238	ELC 1Y Motor Inspection	P074311MB-34	ACH-MOTOR CHILLED SECOND FEED PUMP B PTL	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
239	ELC 1Y Motor Inspection	P074311MB-35	ACH-MOTOR CHILLED SECOND FEED PUMP A TNP	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
240	ELC 1Y Motor Inspection	P074311MB-36	ACH-MOTOR CHILLED SECOND FEED PUMP B TNP	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
241	ELC 1Y Motor Inspection	P074311MB-37	ACH-MOTOR CHILLED 2ND FEED PUMP HX-4001	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
242	ELC 1Y Motor Inspection	P074311MB-38	GT100 FOG PUMP MOTOR No.1	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
243	ELC 1Y Motor Inspection	P074311MB-39	DMU REGENERATION PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
244	ELC 1Y Motor Inspection	P074311MB-40	DMU REGENERATION PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
245	ELC 1Y Motor Inspection	P074311MB-41	ACH-MOTOR CONDENSATE PUMP THERMAX 1,2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
246	ELC 1Y Motor Inspection	P074311MB-42	ACH-MOTOR CONDENSATE PUMP THERMAX 1,2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
247	ELC 1Y Motor Inspection	P074311MB-43	GT100 FOG PUMP MOTOR No.2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
248	ELC 1Y Motor Inspection	P074311MB-44	TURBINE COMPARTMENT MOTOR-1	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
249	ELC 1Y Motor Inspection	P074311MB-45	TURBINE COMPARTMENT MOTOR-2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
250	ELC 1Y Motor Inspection	P074311MB-46	LUBE MIST SEPARATOR OR ELIMINATOR MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
251	ELC 1Y Motor Inspection	P074311MB-47	SHELL & EXHAUST FRAME BLOWER	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
252	ELC 1Y Motor Inspection	P074311MB-48	SHELL & EXHAUST FRAME BLOWER	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
253	ELC 3Y Motor Inspection (Shut down)	P074311MB-49	ST300 VACUUM LIQUID RING PUMP B MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
254	ELC 1Y Motor Inspection	P074311MB-50	LOAD COMPARTMENT COOLING AIR FAN MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
255	ELC 1Y Motor Inspection	P074311MB-51	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
256	ELC 1Y Motor Inspection	P074311MB-52	GAS VALVE COMPARTMENT VENT FAN MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
257	ELC 1Y Motor Inspection	P074311MB-53	ACH-MOTOR CW 2ND FEED PUMP THERMAX 1,2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
258	ELC 1Y Motor Inspection	P074311MB-54	TURBINE COMPARTMENT VENT FAN MOTOR-1	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
259	ELC 1Y Motor Inspection	P074311MB-55	TURBINE COMPARTMENT VENT FAN MOTOR-2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
260	ELC 1Y Motor Inspection	P074311MB-56	ACH-MOTOR BLOWER CT-4002A (CT CELL A)	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
261	ELC 1Y Motor Inspection	P074311MB-57	ACH-MOTOR BLOWER CT-4002B (CT CELL B)	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
262	ELC 1Y Motor Inspection	P074311MB-58	ACH-MOTOR BLOWER CT-4002C (CT CELL C)	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
263	ELC 1Y Motor Inspection	P074311MB-59	ACH-MOTOR BLOWER CT-4002D (CT CELL D)	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
264	ELC 1Y Motor Inspection	P074311MB-60	ACH-MOTOR CHILLED PRIMARY FEED THERMAX1	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
265	ELC 1Y Motor Inspection	P074311MB-61	ACH-MOTOR CHILLED PRIMARY FEED THERMAX2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
266	ELC 1Y Motor Inspection	P074311MB-62	ACH-MOTOR CHILLED PRIMARY FEED YORK A	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
267	ELC 1Y Motor Inspection	P074311MB-63	ACH-MOTOR CHILLED PRIMARY FEED YORK B	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
268	ELC 1Y Motor Inspection	P074311MB-64	ACH-MOTOR CHILLED 2ND FEED PUMP A META	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
269	ELC 1Y Motor Inspection	P074311MB-65	ACH-MOTOR CHILLED 2ND FEED PUMP B META	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
270	ELC 1Y Motor Inspection	P074311MB-66	ACH-MOTOR CHILLED SECOND FEED PUMP A PTL	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
271	ELC 1Y Motor Inspection	P074311MB-67	ACH-MOTOR CW 2ND FEED PUMP THERMAX 1,2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
272	ELC 1Y Motor Inspection	P074311MB-68	ACH-MOTOR CW 2ND FEED PUMP THERMAX 1,2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
273	ELC 1Y Motor Inspection	P074311MB-69	CTU900 SLIP STREAM BOOSTER PUMP A-MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
274	ELC 1Y Motor Inspection	P074311MB-70	GT100 FOG PUMP MOTOR No.3	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
275	ELC 1Y Motor Inspection	P074311MB-71	GT100 FOG PUMP MOTOR No.4	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
276	ELC 1Y Motor Inspection	P074311MB-72	GT100 HYDRAULIC SUPPLY PUMP MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
277	ELC 1Y Motor Inspection	P074311MB-73	GT100 AUXILIARY LUBE OIL PUMP MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
278	ELC 1Y Motor Inspection	P074311MB-74	HRSG DEOXIDIZER AGITATOR - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
279	ELC 1Y Motor Inspection	P074311MB-75	HRSG MORPHOLINE AGITATOR - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
280	ELC 1Y Motor Inspection	P074311MB-76	CTU 900: FAN CELL A - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
281	ELC 1Y Motor Inspection	P074311MB-77	CTU 900: FAN CELL B - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
282	ELC 1Y Motor Inspection	P074311MB-78	CTU 900: FAN CELL C - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
283	ELC 1Y Motor Inspection	P074311MB-79	CTU 900: FAN CELL D - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
284	ELC 1Y Motor Inspection	P074311MB-80	CTU 900: COOLING WATER PUMP A - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
285	ELC 1Y Motor Inspection	P074311MB-81	CTU 900: COOLING WATER PUMP B - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
286	ELC 1Y Motor Inspection	P074311MB-82	CTU 900: COOLING WATER PUMP C - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
287	ELC 3Y Motor Inspection (Shut down)	P074311MB-83	ST300 HYD MAIN OIL PUMP A MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
288	ELC 1Y Motor Inspection	P074311MB-84	DMU DEMIN WATER PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
289	ELC 1Y Motor Inspection	P074311MB-85	GT200 FOG PUMP MOTOR No.1	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
290	ELC 1Y Motor Inspection	P074311MB-86	GT200 FOG PUMP MOTOR No.2	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
291	ELC 1Y Motor Inspection	P074311MB-87	GT200 FOG PUMP MOTOR No.3	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
292	ELC 1Y Motor Inspection	P074311MB-88	GT200 FOG PUMP MOTOR No.4	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
293	ELC 1Y Motor Inspection	P074311MB-89	HRSG LP BOILER FEED PUMP MOTOR A	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
294	ELC 2M motor inspection	P074311MB-90	HRSG LP BOILER FEED PUMP MOTOR B	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
295	ELC 1Y Motor Inspection	P074311MB-91	HRSG CONDENSATE RECIR PUMP A - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
296	ELC 1Y Motor Inspection	P074311MB-92	HRSG CONDENSATE RECIR PUMP B - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
297	ELC 1Y Motor Inspection	P074311MB-93	MORPHOLINE/DEOXIDIZER FEED PUMP - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
298	ELC 1Y Motor Inspection	P074311MB-94	HP DRUM PHOSPHATE FEED PUMP A - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
299	ELC 1Y Motor Inspection	P074311MB-95	HP DRUM PHOSPHATE FEED PUMP B - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
300	ELC 1Y Motor Inspection	P074311MB-96	LP DRUM PHOSPHATE FEED PUMP A - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
301	ELC 1Y Motor Inspection	P074311MB-97	LP DRUM PHOSPHATE FEED PUMP B - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
302	ELC 1Y Motor Inspection	P074311MB-98	HRSG PHOSPHATE AGITATOR - MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
303	ELC 3Y Motor Inspection (Shut down)	P074311MB-99	ST300 HYD MAIN OIL PUMP B MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
304	ELC 1Y Motor Inspection	P074311MB-AA	DMU NaOH FEED PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
305	ELC 1Y Motor Inspection	P074311MB-AB	DMU DEGASSER BLOWER A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
306	ELC 1Y Motor Inspection	P074311MB-AC	DMU DEGASSER BLOWER B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
307	ELC 1Y Motor Inspection	P074311MB-AD	DMU DEGASSED WATER PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
308	ELC 1Y Motor Inspection	P074311MB-AE	DMU DEGASSED WATER PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
309	ELC 1Y Motor Inspection	P074311MB-AF	DMU HCL FEED PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
310	ELC 1Y Motor Inspection	P074311MB-AG	DMU HCL FEED PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
311	ELC 1Y Motor Inspection	P074311MB-AH	DMU NaOH FEED PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
312	ELC 3Y Motor Inspection (Shut down)	P074311MB-AI	ST300 BOOSTER PUMP A-MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
313	ELC 3Y Motor Inspection (Shut down)	P074311MB-AJ	ST300 BOOSTER PUMP B-MOTOR	ELEC07-1	4311	B	every 3 years	36	Jun-2024						P						
314	ELC 1Y Motor Inspection	P074311MB-AK	GT200 HYDRAULIC SUPPLY PUMP MOTOR	ELEC07-1	4311	A	every 1 year	12	Jun-2024						P						
315	ELC 1Y Motor Inspection	P074311MB-AL	GT200 AUXILIARY LUBE OIL PUMP MOTOR	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
316	ELC 1Y Motor Inspection	P074311MB-AM	WTP BACKWASH BLOWER A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						

No.	PM Descriptions	Plan in SAP	functional location	ain work cent	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
317	ELC 1Y Motor Inspection	P074311MB-AN	WTP BACKWASH BLOWER B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
318	ELC 1Y Motor Inspection	P074311MB-AO	WTP CLARIFIER AGITATOR - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
319	ELC 1Y Motor Inspection	P074311MB-AP	WTP SLUDGE AGITATOR - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
320	ELC 1Y Motor Inspection	P074311MB-AQ	WTP POLYMER DAY AGITATOR - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
321	ELC 1Y Motor Inspection	P074311MB-AR	WTP PRESS AID AGITATOR - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
322	ELC 1Y Motor Inspection	P074311MB-AS	WTP POLYMER AGITATOR - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
323	ELC 1Y Motor Inspection	P074311MB-AT	WTP EAST WATER FEED PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
324	ELC 1Y Motor Inspection	P074311MB-AU	WTP EAST WATER FEED PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
325	ELC 1Y Motor Inspection	P074311MB-AV	WTP SEIP WATER FEED PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
326	ELC 1Y Motor Inspection	P074311MB-AW	WTP SEIP WATER FEED PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
327	ELC 1Y Motor Inspection	P074311MB-AX	WTP FILTER PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
328	ELC 1Y Motor Inspection	P074311MB-AY	WTP FILTER PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
329	ELC 1Y Motor Inspection	P074311MB-AZ	WTP BACKWASH PUMP - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
330	ELC 1Y Motor Inspection	P074311MB-BA	WTP SLUDGE PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
331	ELC 1Y Motor Inspection	P074311MB-BB	WTP SLUDGE PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
332	ELC 1Y Motor Inspection	P074311MB-BC	WTP NaOCL DOSING PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
333	ELC 1Y Motor Inspection	P074311MB-BD	WTP NaOCL DOSING PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
334	ELC 1Y Motor Inspection	P074311MB-BE	WTP PAC DOSING PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
335	ELC 1Y Motor Inspection	P074311MB-BF	WTP PAC DOSING PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
336	ELC 1Y Motor Inspection	P074311MB-BG	WTP NaOH DOSING PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
337	ELC 1Y Motor Inspection	P074311MB-BH	WTP NaOH DOSING PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
338	ELC 1Y Motor Inspection	P074311MB-BI	WTP POLYMER DOSING PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
339	ELC 1Y Motor Inspection	P074311MB-BJ	WTP POLYMER DOSING PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
340	ELC 1Y Motor Inspection	P074311MB-BK	WTP PRESS AID DOSING PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
341	ELC 1Y Motor Inspection	P074311MB-BL	WTP PRESS AID DOSING PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
342	ELC 1Y Motor Inspection	P074311MB-BM	WTP POLYMER TRANSFER PUMP - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
343	ELC 1Y Motor Inspection	P074311MB-BN	WTP CT MAKE-UP PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
344	ELC 1Y Motor Inspection	P074311MB-BO	WTP CT MAKE-UP PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
345	ELC 1Y Motor Inspection	P074311MB-BP	WTP DEMIN PLANT FEED PUMP A - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
346	ELC 1Y Motor Inspection	P074311MB-BQ	WTP DEMIN PLANT FEED PUMP B - MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
347	ELC 1Y Motor Inspection	P074311MB-BR	WWU EFFLUENT DISPOSAL PUMP A-MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
348	ELC 1Y Motor Inspection	P074311MB-BS	WWU EFFLUENT DISPOSAL PUMP B-MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
349	ELC 1Y Motor Inspection	P074311MB-BT	WWU HCL DOSING PUMP-MOTOR	ELEC07-1	4311	C	every 1 year	12	Jun-2024						P						
350	ELC 1Y Transformer Inspection	P074311EB-04	AUX. TR FEEDER FROM 52G	ELEC07-1	4311	A	every 1 year	12	Jun-2024						P						
351	ELC 1Y Transformer Inspection	P074311EB-05	115KV STEP DOWN TR 1 FOR 22KV.SWGEAR	ELEC07-1	4311	A	every 1 year	12	Jun-2024						P						
352	ELC 1Y Transformer Inspection	P074311EB-06	115KV STEP DOWN TR 2 FOR 22KV.SWGEAR	ELEC07-1	4311	A	every 1 year	12	Jun-2024						P						
353	ELC 1Y Transformer Inspection	P074311EB-07	115KV STEP DOWN TR 3 FOR 22KV.SWGEAR	ELEC07-1	4311	A	every 1 year	12	Jun-2024						P						
354	ELC 1Y Motor Inspection	P074311MC-04	GT100: MOTOR, EMERGENCY LUBE OIL PUMP	ELEC07-1	4311	S	every 1 year	12	Jun-2024						P						
355	ELC 1Y Motor Inspection	P074311MC-06	GT200: MOTOR, EMERGENCY LUBE OIL PUMP	ELEC07-1	4311	S	every 1 year	12	Jun-2024						P						
#REF!	ELC 1Y Motor Inspection	P074311MC-08	GT100 HYDRAULIC RATCHET PUMP MOTOR	ELEC07-1	4311	A	every 1 year	12	Jun-2024						P						
#REF!	ELC 1Y Motor Inspection	P074311MC-09	GT200 DIESEL ENGINE STARTER	ELEC07-1	4311	B	every 1 year	12	Jun-2024						P						
#REF!	ELC 1Y Motor Inspection	P074311MC-10	GT200 HYDRAULIC RATCHET PUMP MOTOR	ELEC07-1	4311	A	every 1 year	12	Jun-2024						P						
#REF!	ELC 1Y Transformer Inspection	P074314RG-01	CHECKSYNCHROSCOPE WITH SYNCH CHECK RELAY	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RO-01	POWER MONITORING UNIT	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RZ-01	RELAY, GEN. PROTECTION	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RZ-01	RELAY, GEN. DIFFERENTIAL CURRENT	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RZ-01	RELAY, SAFETY RELAY	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314EW-01	PANEL, Ctrl	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RN-01	METER, ACTIVE POWER METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RN-01	METER, POWER FACTOR METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RL-01	METER, VOLTAGE METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RK-01	METER, A-METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RK-01	METER, A-METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RG-02	CHECKSYNCHROSCOPE WITH SYNCH CHECK RELAY	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RO-02	METER, POWER FACTOR METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RZ-02	RELAY, GEN. PROTECTION	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RZ-02	RELAY, GEN. DIFFERENTIAL CURRENT	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RZ-02	RELAY, SAFETY RELAY	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314EW-02	PANEL, Ctrl	ELEC07-1	4314	A	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RN-02	POWER MONITORING UNIT	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RN-02	METER, ACTIVE POWER METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RL-02	METER, VOLTAGE METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RK-02	METER, A-METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 1Y Transformer Inspection	P074314RK-02	METER, A-METER	ELEC07-1	4314	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 6M Generator Inspection	P074314MD-01	GENERATOR, GENERATOR NO.5	ELEC07-1	4314	A	every 1 year	12	Jan-2024	P											
#REF!	ELC 6M Generator Inspection	P074314MD-02	GENERATOR, GENERATOR NO.6	ELEC07-1	4314	A	every 1 year	12	Jan-2024	P											
#REF!	ELC 3Y Busbar inspection	P074311ME-01	GEN300 GENERATOR EXCITATOR	ELEC07-1	4311	A	every 3 years	36	Jun-2024						P						
#REF!	ELC 1Y Motor Inspection	P074311EX-01	GROUNDING P-1004A DIESEL FEED PUMP A	ELEC07-1	4311	B	every 1 year	12	Mar-2024			P									
#REF!	ELC 1Y Motor Inspection	P074311EX-03	GROUNDING P-1004B DIESEL FEED PUMP B	ELEC07-1	4311	B	every 1 year	12	Mar-2024			P									
#REF!	ELC 1Y Motor Inspection	P074311PF-15	ACH-NaOCL CHEMICAL FEED PUMP TO TK-4006	ELEC07-1	4311	C	every 1 year	12	Jul-2024							P					
#REF!	ELC 2M motor inspection	P074311FL-08	FIRE WATER ELECTRIC FIRE PUMP MOTOR	ELEC07-1	4311	S	every 1 year	12	Nov-2024											P	
#REF!	ELC 2M motor inspection	P074311EX-02	GROUNDING P-1602 DIESEL FIRE WATER PUMP	ELEC07-1	4311	B	every 1 year	12	Nov-2024											P	
#REF!	ELC 2M motor inspection	P074311FL-09	FIRE WATER ELECTRIC FIRE PUMP MOTOR A	ELEC07-1	4311	S	every 1 year	12	Nov-2024											P	
#REF!	ELC 2M motor inspection	P074311FL-10	FIRE WATER ELECTRIC FIRE PUMP MOTOR B	ELEC07-1	4311	S	every 1 year	12	Nov-2024											P	
#REF!	ELC 1Y Transformer Inspection	P074311EB-08	AUX TR FEEDER FROM 52G	ELEC07-1	4311	A	every 1 year	12	May-2024					P							
#REF!	ELC 1Y Transformer Inspection	P074311IU-01	AUX TR 22KV/0.4KV, 3pH, 4W 2500 KVA.	ELEC07-1	4311	A	every 1 year	12	Mar-2024			P									
#REF!	ELC 1Y Transformer Inspection	P074311IU-02	AUX TR 22KV/0.4KV, 3pH, 4W 2500 KVA.	ELEC07-1	4311	A	every 1 year	12	Mar-2024			P									

No.	PM Descriptions	Plan in SAP	functional location	Main work center	Plant	abc	Freq(SAP)	Freq(Month)	Start Month	Jan-2024	Feb-2024	Mar-2024	Apr-2024	May-2024	Jun-2024	Jul-2024	Aug-2024	Sep-2024	Oct-2024	Nov-2024	Dec-2024
1	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-01	pH ANALYZERHPSTEAM/HP SATSTEAM	INST07-1	4311	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
2	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-01	pH ANALYZERHPSTEAM DRUM FW	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
3	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-01	pH ANALYZERLPSTEAM DRUM FW	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
4	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-02	pH ANALYZERHPSTEAM/HP SATSTEAM	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
5	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-02	pH ANALYZERHPSTEAM DRUM FW	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
6	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-02	pH ANALYZERLPSTEAM DRUM FW	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
7	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-03	DMU pH ANALYZER NEUTRALIZE BASIN TANK	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
8	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-04	DEAERATOR PH ANALYZER CONDENSATE RETURN	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
9	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-05	PH ANALYZER AT WASTE WATER PIT (OUTSIDE)	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
10	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-06	ACH pH ANALYZER FOR COOLING WATER	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
11	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-07	CTU 900: pH ANALYZER CW RETURN	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
12	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-08	RO ORP ANALYZER AFTER FILTER	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
13	INT 1M PH/ORP Analyzer & Indicator Cal	P074311II-09	WTP pH ANALYZER CLARIFIED WATER OUTLET	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
14	INT 1M Dissolved O2 analyzer Inspect&Cal	P074311IJ-01	DEAERATOR O2 ANALYZER CONDENSATE RETURN	INST07-1	4311	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
15	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-01	CONDUCT ANALYZERHPSTEAM/HP SATSTEAM	INST07-1	4311	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
16	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-02	CONDUCT ANALYZERHPSTEAM/HP SATSTEAM	INST07-1	4311	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
17	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-02	CONDUCT ANALYZERHPSTEAM DRUM WATER	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
18	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-02	CONDUCT ANALYZERHPSTEAM DRUM FW	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
19	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-02	CONDUCT ANALYZERLPSTEAM DRUM FW	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
20	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-03	ACH-CONDUCT ANALYZER FOR CW	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
21	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-04	DMU CONDUCT ANALYZE MIXED BED EXCHANGE A	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
22	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-05	DEAE CONDUCT ANALYZE CONDENSATE RETURN	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
23	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-05	HRSG CONDENSATE RETURN WATER CONDUCT	INST07-1	4311	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
24	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-06	CONDUCT ANALYZE WATE WATER PIT (OUTSIDE)	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
25	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-07	CTU 900: CONDUCTIVITY ANALYZER CW.RETURN	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
26	INT 1M Conducti Analyzer Inspect & Cal	P074311IL-08	RO EC METER FOR RO-B	INST07-1	4311	C	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
27	INT 1M Silica Analyzer Calibration	P074311IM-01	DMU SILICA ANALYZE DEMIN SiO2 TRAIN A	INST07-1	4311	B	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
28	INT 1M CEMS Analyzer Calibration	P074311IO-01	HRSG400 CEMS SYSTEM	INST07-1	4311	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
29	INT 1M CEMS Analyzer Calibration	P074311IO-02	HRSG500 CEMS SYSTEM	INST07-1	4311	A	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
30	INT 1M CEMS Analyzer Calibration	P074314IO-01	CEMS ANALYZER	INST07-1	4314	S	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
31	INT 1M CEMS Analyzer Calibration	P074314IO-02	CEMS ANALYZER	INST07-1	4314	S	every 1 month	1	Jan-2024	P	P	P	P	P	P	P	P	P	P	P	P
33	INT 3Y GT Flame detector Inspect & Test	P074311AH-02	GT200 FLAME DETECTOR COMBUSTION CHAMBER2	INST07-1	4311	A	every 3 years	36	Jan-2024	P											
35	INT 3Y Solenoid Valve Inspection & test	P074311EB-02	EARTH FAULT RESISTOR NEUTRAL SIDE	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
37	INT 1Y Methane Gas detector Cal&Inspect	P074311FC-01	GAS DETECT BASE GAS MODULE	INST07-1	4311	S	every 1 year	12	Oct-2024												
38	INT 1Y Methane Gas detector Cal&Inspect	P074311FC-02	GAS DETECT BASE GAS MODULE	INST07-1	4311	B	every 1 year	12	Nov-2024											P	
39	INT 3Y Ignitor Inspection and test	P074311HA-01	GT200 COMBUSTIBLE CHAMBER SPARK PLUG	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
41	INT 3Y Flow Transmitter Calibration	P074311IA-02	HP SHSTEAM OUTLET FLOW TRANS	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
42	INT 3Y Flow Transmitter Calibration	P074311IA-03	CPH INLET - FLOW TRANS	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
43	INT 1Y Flow Computer Calibration	P074311IA-04	ACH-FLOW COM LP STEAM TO ABS CHILLER	INST07-1	4311	B	every 1 year	12	Dec-2024												P
45	INT 3Y Level Transmitter Calibration	P074311IB-02	LP DRUM WATER COLUMN LEVEL GAUGE AT	INST07-1	4311	C	every 3 years	36	Jan-2024	P											
46	INT 1Y Level switch Inspection and Test	P074311IB-03	ACH-LEVEL SWCW CELL A (CT4020A)	INST07-1	4311	B	every 1 year	12	Dec-2024												P
47	INT 1Y Level Transmitter Inspection	P074311IB-04	ACH-LT CONDENSATE TANK 4003 FROM THERMAX	INST07-1	4311	B	every 1 year	12	Dec-2024												P
48	INT 3Y Level Transmitter Calibration	P074311IB-05	ST300 LO TANK LEVEL INDICATOR SWITCH	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
51	INT 3Y Pressure Transmitter Calibration	P074311IC-05	COMPRESSOR DSCH PRESS TRANS	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
52	INT 3Y Pressure Transmitter Calibration	P074311IC-06	FLUE GAS INLETHP SH PRESS TRANS	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
53	INT 3Y Pressure Indicator calibration	P074311IC-07	LO MAIN OIL PUMP AUTO START PRESS	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
54	INT 3Y Pressure Transmitter Calibration	P074311IC-09	MAIN CONDENSER PRESS TRANS	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
55	INT 1Y Pressure switch calibrate	P074311IC-10	ACH-DIFF PRESS TRANS CHILL WATER SUPPLY	INST07-1	4311	B	every 1 year	12	Dec-2024												P
56	INT 1Y Pressure Indicator Calibration	P074311IC-11	ACH-PRESS IND LP STEAM TO ABS CHILLER	INST07-1	4311	C	every 1 year	12	Dec-2024												P
57	INT 1Y Pressure Transmitter Inspection	P074311IC-12	ACH-PRESS TRANS CTRL LP STEAM TO CHILLER	INST07-1	4311	B	every 1 year	12	Dec-2024												P
58	INT 3Y Pressure Indicator calibration	P074311IC-13	HRSG HP BFP A SUCTION DIFF PRESS GAUGE	INST07-1	4311	C	every 3 years	36	Jan-2024	P											
59	INT 3Y Pressure Transmitter Calibration	P074311IC-14	HRSG DEAERATOR PRESSURE TRANSMITTER	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
61	INT 3Y Temperature Indicator	P074311ID-02	SAMPLING COOLER A pH/CONDUCT TEMP	INST07-1	4311	C	every 3 years	36	Jan-2024	P											
62	INT 3Y Temperature Indicator	P074311ID-03	SAMPLING COOLER A pH/CONDUCT TEMP	INST07-1	4311	C	every 3 years	36	Jan-2024	P											
63	INT 1Y Temperature Indicator	P074311ID-04	ACH-TEMP IND LP STEAM AFTER PV 40001	INST07-1	4311	C	every 1 year	12	Dec-2024												P
64	INT 3Y Temperature Indicator	P074311ID-05	CONDENSATE RETURN CONDUCT SAMPLING TEMP	INST07-1	4311	C	every 3 years	36	Jan-2024	P											
66	INT 3Y Temperature Indicator	P074311ID-07	GT200 ATOMIZING AIR TEMP SWITCH	INST07-1	4311	A	every 3 years	36	Jan-2024	P											
68	INT 3Y Position feedback & element Test	P074311IE-02	STEAM INJECT DRAIN VALVE-1 LIMIT SW	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
69	INT 3Y Speed&Key Phaser Sensor Vibration	P074311IE-03	STEAM TURBINE DIFF EXPANSION	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
70	INT 3Y Position feedback & element Test	P074311IE-05	ST300 MIXING STOP VALVE TEST	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
71	INT 3Y Position feedback & element Test	P074311IE-06	GT200 FUEL GAS CONTROL VALVE LVDT	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
73	INT 3Y Speed&Key Phaser Sensor Vibration	P074311IF-02	HIGH PRESS SET MAGNETIC PICKUP-SPEED	INST07-1	4311	S	every 3 years	36	Jan-2024	P											
74	INT 3Y Speed&Key Phaser Sensor Vibration	P074311IF-03	ST300 TURBINE SPEED INDICATOR	INST07-1	4311	A	every 3 years	36	Jan-2024	P											
76	INT 3Y Vibration&Element Shaker Inspect	P074311IG-02	AXIAL POS. TRANS-LOAD GEAR	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
78	INT 3Y Vibration&Element Shaker Inspect	P074311IG-04	GEN300 SHAFT VIBRATION A: TURBINE SIDE	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
79	INT 3Y MKV HMI Controller Clean &Inspect	P074311IV-01	GT200 MKV LOCAL I COMPUTER	INST07-1	4311	A	every 3 years	36	Jan-2024	P											
81	INT 3Y Control Valve Inspection and test	P074311VJ-01	HP STEAM BYP DESUP PCV	INST07-1	4311	A	every 3 years	36	Jan-2024	P											
82	INT 3Y Temperature Indicator	P074311VJ-02	LO TEMP OUTLET TEMP	INST07-1	4311	A	every 3 years	36	Jan-2024	P											
83	INT 1Y Control Valve Inspection and test	P074311VJ-03	ACH-STEAM LP STEAM INLET CH-40001	INST07-1	4311	B	every 1 year	12	Dec-2024												P
84	INT 1Y Temp Transmitter Inspection	P074311VJ-04	ACH-TEMP TRANS TV40001	INST07-1	4311	B	every 1 year	12	Dec-2024												P
85	INT 3Y Motor Operated Valve Inspect&test	P074311VK-01	HP DRUM CONTINUOUS BD MOV	INST07-1	4311	B	every 3 years	36	Oct-2024												
87	INT 3Y Motor Operated Valve Inspect&test	P074311VK-03	HP DRUM CONTINUOUS BD MOV	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
88	INT 3Y Motor Operated Valve Inspect&test	P074311VK-04	STEAM TURBINE MAINSTEAM BLOW VALVE	INST07-1	4311	B	every 3 years	36	Jan-2024	P											
89	INT 1Y Motor Operated Valve test	P074311VK-05	ACH-MOV CHILLER WATER INLET CHILLER-1	INST07-1	4311	B	every 1 year	12	Dec-2024												P
91	INT 1Y GT Heat detector Inspection &Test	P074311VN-01	FIRE PROTECT RELEASE SOLENOID VALVE 1	INST07-1	4311	S	every 1 year	12	Oct-2024												
92	INT 1Y GT Heat detector Inspection &Test	P074311VN-02	FIRE PROTECT - RELEASE SOLENOID VALVE 1	INST07-1	4311	S	every 1 year	12	Nov-2024											P	
94	INT 3Y Control Valve Inspection and test	P074311VT-02	HP SH DESUP TEMERATURE	INST07-1	4311	B	every 3 years	36	Jan-2024	P											

ภาคผนวก ข-3

ผลการตรวจวัด *Legionella spp.* ในระบบหล่อเย็น

Accreditation No. 1031/47

Analysis / Test Report

Client : Glow SPP 11 Co., Ltd.
250 Moo3, Siam Eastern Industrial Park, Mapyangporn, Pluak Daeng, Rayong Thailand 21140
P/O : GLOW-OM-22-103
Project Name :
Project Location : Glow SPP11_Plant 2

Lot ID: 2412279
Date Received :Feb 08, 2024
Date Reported :Feb 27, 2024
Report Number :2899151-1

Sample Number	2412279-1
Sampled Date	Feb 08, 2024 2:20 PM
Sample Description	Cooling Water
Location	Main cooling tower
Date Analysis Commenced	Feb 09, 2024
Condition of Sample	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
Microbiological Testing						
Legionella spp.	CFU/L	-	-	<1	ISO 11731 (2017)	Bangkok

Note : Microbiological Testing Result <1 mean Bacteria not found in agar plate.

Sampling By : Narunat thammasaro

Remark :
- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked * is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

Approved by
Tuanjai Thangklang
Manager

Accreditation No. 1031/47

Analysis / Test Report

Client : Glow SPP 11 Co., Ltd.
250 Moo3, Siam Eastern Industrial Park, Mapyangporn, Pluak Daeng, Rayong Thailand 21140
P/O : GLOW-OM-22-103
Project Name :
Project Location : Glow SPP11_Plant 2

Lot ID: 2412279
Date Received :Feb 08, 2024
Date Reported :Feb 27, 2024
Report Number :2899151-1

Sample Number	2412279-2
Sampled Date	Feb 08, 2024 1:55 PM
Sample Description	Cooling Water
Location	Eye wash 1
Date Analysis Commenced	Feb 09, 2024
Condition of Sample	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
Microbiological Testing						
Legionella spp.	CFU/L	-	-	<1	ISO 11731 (2017)	Bangkok

Note : Microbiological Testing Result <1 mean Bacteria not found in agar plate.

Sampling By : Narunat thammasaro

Remark :
- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked * is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

Approved by
Tuanjai Thangklang
Manager

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company
Life Sciences www.alsglobal.com
RIGHT SOLUTIONS RIGHT PARTNER
19562-21/ EMAIL S:\Reports_All_NoGL.rpt (6:42PM)

Accreditation No. 1031/47

Analysis / Test Report

Client : Glow SPP 11 Co., Ltd.
250 Moo3, Siam Eastern Industrial Park, Mapyangporn, Pluak Daeng, Rayong Thailand 21140
P/O : GLOW-OM-22-103
Project Name :
Project Location : Glow SPP11_Plant 2

Lot ID: 2412279
Date Received :Feb 08, 2024
Date Reported :Feb 27, 2024
Report Number :2899151-1

Sample Number	2412279-3
Sampled Date	Feb 08, 2024 2:00 PM
Sample Description	Cooling Water
Location	Eye wash 2
Date Analysis Commenced	Feb 09, 2024
Condition of Sample	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
Microbiological Testing						
Legionella spp.	CFU/L	-	-	<1	ISO 11731 (2017)	Bangkok

Note : Microbiological Testing Result <1 mean Bacteria not found in agar plate.

Sampling By : Narunat thammasaro

Remark :
- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked * is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

Approved by
Tuanjai Thangklang
Manager

Accreditation No. 1031/47

Analysis / Test Report

Client : Glow SPP 11 Co., Ltd.
250 Moo3, Siam Eastern Industrial Park, Mapyangporn, Pluak Daeng, Rayong Thailand 21140
P/O : GLOW-OM-22-103
Project Name :
Project Location : Glow SPP11_Plant 2

Lot ID: 2412279
Date Received :Feb 08, 2024
Date Reported :Feb 27, 2024
Report Number :2899151-1

Sample Number	2412279-4
Sampled Date	Feb 08, 2024 2:05 PM
Sample Description	Cooling Water
Location	Eye wash 3
Date Analysis Commenced	Feb 09, 2024
Condition of Sample	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
Microbiological Testing						
Legionella spp.	CFU/L	-	-	<1	ISO 11731 (2017)	Bangkok

Note : Microbiological Testing Result <1 mean Bacteria not found in agar plate.

Sampling By : Narunat thammasaro

Remark :
- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked * is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

Approved by
Tuanjai Thangklang
Manager

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company
Life Sciences www.alsglobal.com
RIGHT SOLUTIONS RIGHT PARTNER
19562-21/ EMAIL S:\Reports_All_NoGL.rpt (6:42PM)

Accreditation No. 1031/47

Analysis / Test Report

Client : Glow SPP 11 Co., Ltd.
250 Moo3, Siam Eastern Industrial Park, Mapyangporn, Pluak Daeng, Rayong Thailand 21140
P/O : GLOW-OM-22-103
Project Name :
Project Location : Glow SPP11_Plant 2

Lot ID: 2412279
Date Received :Feb 08, 2024
Date Reported :Feb 27, 2024
Report Number :2899151-1

Sample Number	2412279-5
Sampled Date	Feb 08, 2024 2:10 PM
Sample Description	Cooling Water
Location	Supply water at CCR
Date Analysis Commenced	Feb 09, 2024
Condition of Sample	Contained in two plastic bottles, sample containers comply to pretreatment - preservation standards (APHA, USEPA)

Analyte	Unit	LOD	LOQ (LOR)	Result	Method	Testing Location
Microbiological Testing						
Legionella spp.	CFU/L	-	-	<1	ISO 11731 (2017)	Bangkok

Note : Microbiological Testing Result <1 mean Bacteria not found in agar plate.

Sampling By : Narunat thammasaro

Remark :
- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)
- Analyte(s) marked * is/are not included in scope of Accreditation ISO/IEC 17025.
- The laboratory has been accepted as an accredited laboratory complying with the ISO/IEC 17025.

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

Approved by

Tuanjai Thangklang
Manager

ADDRESS 104 Phatthanakan 40, Phatthanakan Rd., Khwaeng Phatthanakan, Khet Suan Luang, Bangkok 10250 Thailand | PHONE +66 0 2760 3000 | FAX +66 0 2760 3197
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

ภาคผนวก ข-4

ระเบียบปฏิบัติงานระดับองค์กร: การรายงานการกระทำ/สภาพการณ์ที่ต่ำกว่ามาตรฐาน เหตุการณ์เกือบเกิดอุบัติเหตุ อุบัติเหตุ เหตุการณ์ผิดปกติ และการสอบสวน

GPSC Global Power Synergy Public Company Limited	**ระเบียบปฏิบัติงานระดับองค์กร** **(Corporate Procedure)**

ข้อมูลเอกสารฉบับล่าสุด

หมายเลขเอกสาร	HES-CP-0028	**สายงาน**	COO	**Dep/Div.**	HES
ชื่อเอกสาร	การรายงานการกระทำ/สภาพการณ์ที่ต่ำกว่ามาตรฐาน เหตุการณ์เกือบเกิดอุบัติเหตุ อุบัติเหตุ เหตุการณ์ผิดปกติ และการสอบสวน			**สถานะ**	ประกาศใช้
Revision	01	**วันที่ประกาศใช้**	15 เมษายน 2565	**จำนวนหน้า**	28
Softcopy Location:	GPSC Corporate Document Management System (CDMS) / HES / Procedure				

ระบบมาตรฐานที่อ้างอิง / มาตรฐานและข้อกำหนดที่เกี่ยวข้อง

ที่	ระบบ / มาตรฐาน	ข้อกำหนด
1	ISO45001 : Occupational Health & Safety Management	10.2 อุบัติการณ์ ความไม่สอดคล้อง และการปฏิบัติการแก้ไข
2	PTT Group SHE Performance Measurement & Reporting Guideline	5.7.3) Data Reporting Procedures
3	แนวทางการจัดการอุบัติการณ์ กลุ่ม ปตท.	4a. Incident Management
4	Global reporting initiative (GRI) Standards, 2016 and 2018	102-8 , 403-2 306-3

เอกสารที่เกี่ยวข้อง

ที่	ประเภทเอกสาร	หมายเลขเอกสาร	ชื่อเอกสาร	วันประกาศใช้
1	เอกสารสนับสนุน	SQM-WI-000	GPSC Group SHE Performance Measurement and Reporting Guideline	
2	แบบฟอร์ม	SQM-F-0008	แบบรายงานเหตุการณ์ที่ต่ำกว่ามาตรฐาน (Sub-Standard)	
3	แบบฟอร์ม	SQM-F-0009	แบบรายงานเหตุการณ์เกือบเกิดอุบัติเหตุ (Near Miss)	
4	แบบฟอร์ม	SQM-F-0010	แบบรายงานเหตุการณ์การเกิดอุบัติเหตุ (Accident)	

การควบคุมเอกสาร :

ผู้จัดทำเอกสาร:

ชื่อ – นามสกุล	ชื่อตำแหน่ง	วัน / เดือน / ปี
-	คณะทำงาน GPSC SSHE Culture Taskforce	8 กุมภาพันธ์ 2565

ผู้ทบทวนเอกสาร:

ชื่อ – นามสกุล	ชื่อตำแหน่ง	วัน / เดือน / ปี
นางนัทธรีรัญา บัวสรวง	ผู้จัดการส่วนความมั่นคงปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม พื้นที่มาบตาพุด	1 มีนาคม 2565
นายวัลลพ กล้าหาญ	รักษาการผู้จัดการส่วนความมั่นคงปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม พื้นที่อื่นๆ	1 มีนาคม 2565
นายธนาวุฒิ ชัยเบญจกุล	ผู้จัดการส่วนบริหารระบบคุณภาพองค์กร	1 มีนาคม 2565
นายเสาร์ชัย สุขเกษม	ผู้จัดการฝ่ายอาวุโสความมั่นคงปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม	1 มีนาคม 2565

ผู้อนุมัติเอกสาร:

ชื่อ – นามสกุล	ชื่อตำแหน่ง
นายศิริมธ ลีภากรณ์	ประธานเจ้าหน้าที่ปฏิบัติการ

ผู้ประกาศใช้เอกสาร:

ชื่อ – นามสกุล	ชื่อตำแหน่ง
นายสุรชัย ชาติวิทยา	พนักงานความมั่นคงปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม

การแจกจ่ายเอกสาร :

ตารางต่อไปนี้เป็นหน่วยงานที่จะได้รับการแจกจ่ายเอกสารฉบับนี้ (และ เอกสารฉบับใหม่เมื่อมีการแก้ไข)

ที่	หน่วยงาน	รูปแบบเอกสาร
1	ทุกหน่วยงานที่เกี่ยวข้อง	Electronic

บันทึกการแก้ไขเอกสาร :

ตารางต่อไปนี้แสดงบันทึกการแก้ไขเอกสารฉบับนี้

Revision No.	DAR No.	Owner / Requestor	รายละเอียดที่แก้ไขเอกสาร	วันที่ประกาศใช้เอกสาร
01	DAR-2021-00074	Panya	1.เปลี่ยนแบบฟอร์ม Procedure 2.แก้ไขเนื้อหาทั้งหมด	15 เมษายน 2565

หน่วยงานที่เกี่ยวข้องกับเอกสารฉบับนี้ (พื้นที่ที่นำเอกสารนี้ไปปฏิบัติ):

ตารางต่อไปนี้แสดงรายการหน่วยงานที่นำเอกสารฉบับนี้ไปปฏิบัติ

ที่	หน่วยงาน	ชื่อย่อหน่วยงาน
1	ทุกหน่วยงาน	All

การฝึกอบรม

[ ]	ไม่ต้องฝึกอบรม	เหตุผล	หมายเหตุ
[✓]	ต้องฝึกอบรมหน่วยงานที่เกี่ยวข้อง	หน่วยงาน	1.พนักงานทั้งองค์กร

สารบัญ

1.วัตถุประสงค์ 5
2.ขอบเขต 5
3.คำศัพท์และคำนิยาม 5
4. บทบาทหน้าที่ และความรับผิดชอบ 11
5.รายละเอียดกระบวนการ 14
5.1 การรายงานเหตุการณ์ 14
5.2 การทบทวนรายงาน 16
5.3 การแต่งตั้งทีมวิเคราะห์เหตุการณ์ 16
5.4 การพิจารณาระดับความรุนแรง 17
5.5 เทคนิคการสอบสวนเพื่อวิเคราะห์หาสาเหตุ (Root Cause) 22
5.6 การสอบสวนและยืนยันความเสียหาย 22
5.7 การมอบหมายการแก้ไข 23
5.8 การบันทึกผลการสอบสวน 23
5.9 การบันทึกผลการแก้ไข 23
5.10 การตรวจรับการแก้ไข 23
5.11 การจัดเก็บและการจัดทำสถิติและการสื่อสารเพื่อถอดบทเรียน 24
5.12 สรุปหน้าที่ความรับผิดชอบในการดำเนินการ 24
6. การทบทวนวิธีปฏิบัติงาน 25
7. ภาคผนวก 26
7.1 ขั้นตอนการรายงานอุบัติเหตุ 26
7.2 ขั้นตอนการรายงานเหตุการณ์เกือบเกิดอุบัติเหตุ 27
7.3 ขั้นตอนการรายงานเหตุการณ์ที่ต่ำกว่ามาตรฐาน 28

ภาคผนวก ข-5

ผลการตรวจวัดระดับเสียงเฉลี่ยตลอดระยะเวลาการทำงาน

Analysis / Test Report

Client : Glow SPP 11 Co., Ltd.
250 Moo3, Siam Eastern Industrial Park, Mapyangporn, Pluak Daeng, Rayong Thailand 21140
P/O : GLOW-OM-22-103
Project Name :
Project Location : Glow SPP11_Plant 2

Lot ID: 2451137
Date Received : May 10, 2024
Date Reported : May 14, 2024
Report Number : 2984857-1

Sample Number	2451137-1
Sampled Date	May 09, 2024
Sample Description	Noise Dose
Location	Operation staff
Personal Sampling	คุณผดุงสิทธิ์ สงสัย
Date Analysis Commenced	May 13, 2024

Analyte	Sampled Date/time	Unit	LOD	LOQ (LOR)	Result	Guideline Limit	Method	Guideline	Testing Location
Air Testing									
Noise Dose (12 hrs.) (Calculated from Lavg)	07:00 AM - 07:00 PM	%	-	1	8.1	No Standard	MOL, Department Labour Protection and Welfare (B.E.2561)	MOL	Rayong
Noise Dose (8 hrs.)	07:00 AM - 07:00 PM	%	-	1	7.6	No Standard	MOL, Department Labour Protection and Welfare (B.E.2561)	MOL	Rayong
TWA (12 hrs.) (Calculated from Lavg)	07:00 AM - 07:00 PM	dB(A)	-	-	72.1	83*	MOL, Department Labour Protection and Welfare (B.E.2561)	MOL	Rayong
TWA (8 hrs.)	07:00 AM - 07:00 PM	dB(A)	-	-	73.8	85	MOL, Department Labour Protection and Welfare (B.E.2561)	MOL	Rayong

Guideline :

MOL : 1. Notification of Department Labour Protection and Welfare on the Criteria and Procedures for Measurement and Analysis of Working Conditions in relation to Heat, Light or Noise Levels, including Duration and Types of Business that must perform (B.E. 2561)
2. Notification of Department of Labour Protection and Welfare on the Standard of Time Weighted Average (TWA) Noise Level (B.E. 2561)
* MOL: Recommended guideline limit for 12 working hours should not be over 83 dB(A)

Sampled By : Tinnakorn Kumpasee

Remark :
- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)

Approved by

Supot Salamteh
Section Head

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

ADDRESS 616/10 Moo 5 T. Maenam Khu A. Pluakdaeng Rayong 21140 Thailand | PHONE +66 0 3304 8555 | FAX +66 0 3304 8556
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

Analysis / Test Report

Client : Glow SPP 11 Co., Ltd.
250 Moo3, Siam Eastern Industrial Park, Mapyangporn, Pluak Daeng, Rayong Thailand 21140
P/O : GLOW-OM-22-103
Project Name :
Project Location : Glow SPP11_Plant 2

Lot ID: 2451137
Date Received : May 10, 2024
Date Reported : May 14, 2024
Report Number : 2984857-1

Sample Number	2451137-2
Sampled Date	May 09, 2024
Sample Description	Noise Dose
Location	Maintenance staff
Personal Sampling	คุณปฏิภาณ คำบุญ
Date Analysis Commenced	May 13, 2024

Analyte	Sampled Date/time	Unit	LOD	LOQ (LOR)	Result	Guideline Limit	Method	Guideline	Testing Location
Air Testing									
Noise Dose (8 hrs.)	09:00 AM - 05:00 PM	%	-	1	10.5	No Standard	MOL, Department Labour Protection and Welfare (B.E.2561)	MOL	Rayong
TWA (8 hrs.)	09:00 AM - 05:00 PM	dB(A)	-	-	75.2	85	MOL, Department Labour Protection and Welfare (B.E.2561)	MOL	Rayong

Guideline :
MOL : 1. Notification of Department Labour Protection and Welfare on the Criteria and Procedures for Measurement and Analysis of Working Conditions in relation to Heat, Light or Noise Levels, including Duration and Types of Business that must perform (B.E. 2561)
2. Notification of Department of Labour Protection and Welfare on the Standard of Time Weighted Average (TWA) Noise Level (B.E. 2561)
Sampled By : Tinnakorn Kumpasee

Remark :
- LOD : Limit of Detection
- "<" : Lower than LOQ (Limit of Quantitation) / LOR (Limit of Reporting)

Approved by
Supot Salamteh
Section Head

Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. No part of this report may be reproduced in any form without written consent from the laboratory. ALS Laboratory Group (Thailand) strongly recommends that this report is not reproduced except in full.

ADDRESS 616/10 Moo 5 T. Maenam Khu A. Pluakdaeng Rayong 21140 Thailand | PHONE +66 0 3304 8555 | FAX +66 0 3304 8556
ALS LABORATORY GROUP (THAILAND) CO., LTD. An ALS Limited Company

ภาคผนวก ข-6

แผนการอบรมให้ความรู้ด้านความปลอดภัยและสิ่งแวดล้อม

ข้อบังคับด้านความมั่งคง ความปลอดภัย อาชีวอนามัยและสิ่งแวดล้อม

บริษัท โกบอล เพาเวอร์ ซินเนอร์ยี่ จำกัด (มหาชน)

กรุณาเปิดกล้องและอยู่หน้ากล้องตลอดการอบรม

งดใช้โทรศัพทมือถือเข้าร่วมการอบรม!!!

กรุณาตั้งใจฟังและมีส่วนร่วมในการฝึกอบรม

ช่วงท้ายของการฝึกอบรม

<u>ต้องผ่านเกิน **90%** ในการทดสอบ</u>

บริษัท โกบอล เพาเวอร์ ซินเนอร์ยี่ จำกัด (มหาชน)
Global Power Synergy Public Company Limited

- GPSC CUP1
- GPSC CUP2
- GPSC CUP3
- GSPC CUP4
- SRC
- RDF
- Glow Energy Solar
- GSPP2&3
- GHECO-1
- Glow Energy Phase 2
- GSPP11 Plant 1
- GSPP11 Plant 2
- GIPP

ศูนย์ผลิตสาธารณูปการแห่งที่ 1 _ GPSC CUP-1

นิคมอุตสาหกรรมดับบลิวเอชเอ ตะวันออก(มาบตาพุด) จังหวัดระยอง

ศูนย์ผลิตสาธารณูปการแห่งที่ 2 _ GPSC CUP-2

บริเวณใกล้เคียงนิคมอุตสาหกรรมอาร์ไอแอล จังหวัดระยอง

ศูนย์ผลิตสาธารณูปการแห่งที่ 3 _ GPSC CUP-3

นิคมอุตสาหกรรมเหมราชตะวันออก (มาบตาพุด) จังหวัดระยอง

ศูนย์ผลิตสาธารณูปการแห่งที่ 4 _ GPSC CUP-4

นิคมอุตสาหกรรมเอเชีย จังหวัดระยอง

โรงไฟฟ้าศรีราชา SRC

ศรีราชา จังหวัดชลบุรี

โรงไฟฟ้าโกลว์ ไอพีพี GLOW IPP

นิคมอุตสาหกรรมดับบลิวเอชเอ ชลบุรี 1 จังหวัดชลบุรี

นิยาม

- ผู้รับเหมา (Contractor) หมายถึง บุคคล บริษัท หรือนิติบุคคลที่ GPSC Group ได้ว่าจ้างให้มาดำเนินการอย่างใดอย่างหนึ่งใน GPSC Group ตามสัญญาการให้บริการ หรือเอกสารการว่าจ้างอื่นๆ และให้หมายรวมถึงบุคคล บริษัทหรือนิติบุคคลที่รับเหมาช่วง ทั้งนี้ไม่ว่าจะเหมาช่วงกันกี่ช่วงก็ตาม

นิยาม

- ผู้รับเหมาประจำ (Supervised Contractor) หมายถึง ผู้รับเหมาที่ GPSC Group มีการตกลงว่าจ้างหรือมีการทำสัญญาจ้างให้ปฏิบัติงานแก่ GPSC Group ดังนี้
  - เป็นลักษณะการตกลงว่าจ้างปีต่อปี หรือมากกว่า 1 ปีขึ้นไป และต้องปฏิบัติงานประจำในพื้นที่ที่ถูกกำกับดูแลและรับผิดชอบโดย GPSC Group
  - ผ่านขั้นตอนการสรรหาตามระเบียบ GPSC Group และมีการทำสัญญาหรือเอกสารการจ้าง <u>เพื่อปฏิบัติงานประจำในพื้นที่ที่ถูกกำกับดูแล</u> และรับผิดชอบโดย GPSC Group

นิยาม

- <u>ผู้รับเหมาทั่วไป (Independent Contractor)</u> หมายถึง ผู้รับเหมาที่ GPSC Group มีการตกลงว่าจ้างให้เข้ามาปฏิบัติงานเป็นครั้งคราว หรือเป็นโครงการระยะสั้น หรือระยะยาว โดยแบ่งเป็น
  - <u>ผู้รับเหมาระยะสั้น</u> (Short Term Independent Contractor) หมายถึง ผู้รับเหมาทั่วไปที่เข้ามาปฏิบัติงานภายในระยะเวลาไม่เกิน 15 วัน
  - <u>ผู้รับเหมาระยะยาว</u> (Long Term Independent Contractor) หมายถึง ผู้รับเหมาทั่วไปที่เข้ามาปฏิบัติงานมากกว่า 15 วัน แต่ไม่เข้าข่ายผู้รับเหมาประเภท ผู้รับเหมาประจำ (Supervised Contractor)

มาตราการรักษาความปลอดภัย (Security)

ระดับการเตือนภัย		สี	ความเสี่ยง
ระดับ 1	ระดับปกติ	เขียว	สภาวะความเสี่ยงต่ำ
ระดับ 2	ระดับเฝ้าระวัง	เหลือง	สภาวะความเสี่ยงปานกลาง
ระดับ 3	ระดับวุฒหรง	ส้ม	สภาวะความเสี่ยงสูง
ระดับ 4	ระดับวุฒหรงสูงสุด	แดง	สภาวะความเสี่ยงวุฒหรง

มาตราการรักษาความปลอดภัย (Security)

Level 1	• ไม่มีเหตุละเมิด หรือมีสัญญาณความสูญเสียต่ำ เช่น เหตุลักขโมยเล็กน้อย • ไม่มีข้อวุฒหรงที่น่าเชื่อถือ	ตรวจสอบสติ๊กเกอร์ยานพาหนะ และบัตรบุคคลตามปกติ
Level 2	• มีเหตุละเมิดที่มีสัญญาณความสูญเสียปานกลาง เช่น มีเหตุจารกรรมมากขึ้น บ่อยขึ้น • มีข้อวุฒหรงที่น่าเชื่อถือ ทางภาครัฐเตือนให้เฝ้าระวังเหตุต้องสงสัย หรือมีโอกาสสำคัญ	ยกระดับและความเข้มการตรวจค้นบุคคล สัมภาระ / ยานพาหนะ
Level 3	• มีเหตุละเมิดด้วยสัญญาณความสูญเสียสูง • มีข้อวุฒหรงที่ยืนยันได้ ภาครัฐเตือนให้เฝ้าระวังภัย	เพิ่มจำนวน รปภ. จำกัดบุคคล ยานพาหนะในการเข้า-ออก, ไม่อนุญาตผู้มาติดต่อออกในการยื่นหน้าที่ตามแผนลูกเดิน เพิ่มแผงกั้นด้านหน้าก่อนประตูหลัก
Level 4	• มีเหตุละเมิดด้วยสัญญาณความสูญเสียใหญ่หลวง เกิดเหตุรุนแรงล้อง่ชีวิต • ส่งผลกระทบต่อการดำเนินธุรกิจของ PTTUT	ปิดสถานที่ทำงานชั่วคราว เฉพาะผู้ปฏิบัติงานที่จำเป็นเท่านั้น ไม่อนุญาตยานพาหนะผ่านเข้า-ออก เพิ่มเครื่องมือตรวจ

กำหนดพื้นที่และมาตรการรักษาความปลอดภัย

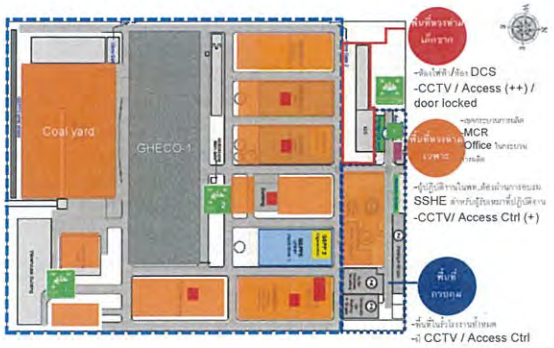

มาตรการรักษาความปลอดภัยบุคคล

แบบอนุญาตผ่านเข้า-ออกโรงงาน

- กรณีนำวัสดุ อุปกรณ์ เครื่องมือ<u>ผ่านเข้าและนำออกภายในวันเดียวกัน</u> ไม่ต้องทำการขออนุมัตินำออก แต่ต้องผ่านการตรวจสอบโดยพนักงานควบคุมงาน และผู้นำของออกต้องมีรายการถูกต้องตามสำเนาที่ปิดมรปก.
- กรณีนำวัสดุ อุปกรณ์ เครื่องมือผ่านออก<u>คนละวันกับวันที่นำเข้า หรือเป็นการนำออกไปเพื่อวัตถุประสงค์อื่นที่เกี่ยวข้องกับการปฏิบัติงานของ GPSC ให้เขียนใบนำของออกใหม่</u>โดยต้องผ่านการตรวจสอบโดยพนักงานและได้รับการอนุมัตินำออกจาก<u>ผู้อนุมัตินำออก</u> และผู้นำของออกต้องมีรายการถูกต้องตามใบนำของเข้า กรณี<u>นำของออกบางรายการ</u> ให้<u>ขออนุมัตินำออกตามรายการที่ต้องการ</u>โดย<u>ถ่ายเอกสาร</u>ใบนำของเข้านนบให้อนุมัติ และแจ้งที่ป้อมรปก. ส่วนต้นฉบับใบนำของเข้าตัวจริง ให้แนบกับกับของออกในวันที่นำออกครบทุกรายการ
- กำหนดให้<u>ผู้จัดการแผนกขึ้นไป เจ้าของงานเป็นผู้อนุมัตินำออก</u> กรณีผู้อนุมัตินำออกของหน่วยงานไม่มีอยู่ในพื้นที่ ให้ผู้จัดการแผนกอื่นในสังกัดฝ่ายเดียวกันอนุมัตินำออกแทนได้

การผ่านเข้า-ออกสำหรับยานพาหนะ

ต้อง<u>แลกบัตร</u>ทุกครั้งที่ผ่าน

- จอดเฉพาะพื้นที่ควบคุม (ด้านนอก)
- เฉพาะพื้นที่ทั่วไปของ พื้นที่หวงห้าม เช่น วางบิล / ดูหน้างาน !!!ห้ามปฏิบัติงานเด็ดขาด

Rayong Facility

ต้อง<u>แลกบัตร</u>ทุกครั้งที่ผ่าน

- จอดในพื้นที่กำหนดเขตหวงห้าม
- จอดได้ไม่เกิน 1 ชั่วโมง เช่นวางบิล/ส่งของ
- สำหรับพนักงานขอแลกบัตรเป็นกรณี
- ห้ามจอดนอกพื้นที่ที่กำหนด

ต้อง<u>แลกบัตร</u>ทุกครั้งที่ผ่าน

- จอดในพื้นที่กำหนดเขตหวงห้าม
- ขอแลกบัตรเป็นกรณี หรือตาม PTW
- ห้ามจอดนอกพื้นที่ที่กำหนด

ข้อบังคับทั่วไป

ข้อบังคับทั่วไป

GPSC

❑ บัตรประจำตัวผู้รับเหมาประจำ (Supervised Contractor)

แสกนบัตรเข้า-ออก ทุกครั้ง

บัตรหมดอายุ ต้องส่งคืน GPSC

!!! บัตรหายส่งอบรมใหม่

ติดบัตรประจำตัวทุกครั้งเมื่อเข้าพื้นที่โรงไฟฟ้า

ข้อบังคับทั่วไป

GPSC

❑ บัตรประจำตัวผู้รับเหมาทั่วไป (Independent Contractor

แสกนบัตรเข้า-ออก ทุกครั้ง

บัตรหมดอายุ ต้องส่งคืน GPSC

!!! บัตรหายส่งอบรมใหม่

ติดบัตรประจำตัวทุกครั้งเมื่อเข้าพื้นที่โรงไฟฟ้า

Contractor EHS Passport

GPSC

4. งานใช้ Forklift
5. งานเฝ้าระวังไฟ
6. งานประดาน้ำ
7. งานนั่งร้าน
8. งานฉายรังสี
9. งานไฟฟ้า

- หลักฐานการฝึกอบรมตามกฎหมาย
- หลักฐานการตรวจสุขภาพ

ป้อมหน้า GPSC CUP2

GPSC

อุปกรณ์ป้องกันอันตรายส่วนบุคคล

Personal Protective Equipment :PPE

GPSC

PPE พื้นฐาน ผู้รับเหมาต้องสวมใส่ตลอดเวลาเมื่ออยู่พื้นที่โรงไฟฟ้า

ANSI Z89.1	ANSI Z87.1	ANSI Z41
หรือเทียบเท่า พร้อมสายรัดคาง	ห้ามสีชาหรือดำ ในพื้นที่ที่แสงสว่างไม่เพียงพอ	หรือเทียบเท่า

อุปกรณ์ป้องกันอันตรายส่วนบุคคล

Personal Protective Equipment :PPE

GPSC

PPE อื่นๆ ผู้รับเหมาต้องสวมใส่ตาม ป้ายบังคับ,ใบขออนุญาตการทำงาน หรือลักษณะงาน

ข้อบังคับทั่วไป

GPSC

ข้อบังคับทั่วไป

GPSC

ข้อบังคับทั่วไป

GPSC

JSEA & Work plan → ใบขออนุญาตทำงาน → Onsite JSEA and Safety Toolbox talk → ทำงาน

ห้ามทำงานโดยไม่มีใบอนุญาตการทำงานเด็ดขาด!!!

ภาคผนวก ข-7

เอกสารการตรวจสุขภาพพนักงาน

ผลการตรวจสุขภาพประจำปี พ.ศ. 2566

บริษัท โกลว์ เอสพีพี 11 จำกัด

ภาพรวมการตรวจสุขภาพประจำปี 2566

บริษัท โกลว์ เอสพีพี 11 จำกัด **วันที่ 8 พฤษภาคม 2566 ถึง วันที่ 18 สิงหาคม 2566**

ลำดับ	รายการตรวจสุขภาพ	จำนวนผู้เข้าตรวจ	ผลปกติ	% ปกติ	ผลผิดปกติ	% ผิดปกติ
1	ผลการตรวจร่างกายโดยแพทย์ (PE)	32	32	100.00%	0	0.00%
2	ผลการตรวจดัชนีมวลกาย (BMI)	32	3	9.38%	29	90.63%
3	ผลการตรวจวัดความดันโลหิต (BP)	32	27	84.38%	5	15.63%
4	ผลการตรวจวัดชีพจร (Pulse)	32	32	100.00%	0	0.00%
5	ผลการตรวจวัดรอบเอว (Waist)	32	21	65.63%	11	34.38%
6	ผลการตรวจความสมบูรณ์ของเม็ดเลือด (CBC)	32	27	84.38%	5	15.63%
7	ผลการตรวจระดับน้ำตาลในเลือด (FBS)	32	25	78.13%	7	21.88%
8	ผลการตรวจระดับไขมันคอลเลสเตอรอล (Cholesterol)	32	12	37.50%	20	62.50%
9	ผลการตรวจระดับไขมันไตรกลีเซอไรด์ในเลือด (Triglyceride)	32	18	56.25%	14	43.75%
10	ผลการตรวจไขมันคอเลสเตอรอลชนิดดี (HDL) ในเลือด	32	21	65.63%	11	34.38%
11	ผลการตรวจไขมันคอเลสเตอรอลชนิดความหนาแน่นต่ำ (LDL Direct) ในเลือด	32	11	34.38%	21	65.63%
12	ผลการตรวจการทำงานของไต (BUN/Creatinine)	32	28	87.50%	4	12.50%
13	ผลการตรวจการทำงานของตับ (SGPT/SGOT)	32	21	65.63%	11	34.38%
14	ผลการตรวจกรดยูริค (Uric Acid) ในเลือด	32	20	62.50%	12	37.50%
15	ผลการตรวจหาสารบ่งชี้มะเร็งตับ (AFP) ในเลือด	24	23	95.83%	1	4.17%
16	ผลการตรวจหาสารบ่งชี้มะเร็งลำไส้ใหญ่ (CEA) ในเลือด	24	23	95.83%	1	4.17%
17	ผลการตรวจหาสารบ่งชี้มะเร็งต่อมลูกหมาก (PSA) ในเลือด	24	23	95.83%	1	4.17%
18	ผลการตรวจปัสสาวะสมบูรณ์แบบ (Urine Examination)	32	32	100.00%	0	0.00%
19	ผลการตรวจหาสารแอมเฟตามีนในปัสสาวะ (Amphetamine)	32	32	100.00%	0	0.00%
20	ผลการตรวจเอ็กซเรย์ทรวงอก (Chest X-ray)	32	26	81.25%	6	18.75%
21	ผลการตรวจคลื่นไฟฟ้าหัวใจ (EKG)	32	29	90.63%	3	9.38%
22	ผลการตรวจอัลตร้าซาวด์ช่องท้องส่วนบนและส่วนล่าง (U/S Whole Abdomen)	14	0	0.00%	14	100.00%
23	ผลการตรวจวัดความดันลูกตา	30	30	100.00%	0	0.00%

ตัวอย่างสมุดสุขภาพประจำตัวลูกจ้างที่ทำงาน
เกี่ยวกับปัจจัยเสี่ยง

สมุดสุขภาพประจำตัวของลูกจ้าง
ที่ทำงานเกี่ยวกับปัจจัยเสี่ยง

ตามกฎกระทรวงกำหนดหลักเกณฑ์

และวิธีการตรวจสุขภาพของลูกจ้าง

และส่งผลการตรวจแก่พนักงานตรวจแรงงาน พ.ศ. 2547

ชื่อ ..... **นามสกุล** .....

ชื่อสถานประกอบกิจการ บริษัท โกลว์ เอสพีพี 11 จำกัด

รัฐมนตรีว่าการกระทรวงแรงงานออกกฎกระทรวงกำหนดหลักเกณฑ์และวิธีการตรวจสุขภาพของลูกจ้าง และส่งผลการตรวจแก่พนักงานตรวจแรงงาน พ.ศ. 2547 โดยกำหนดให้นายจ้างจัดให้มีสมุดสุขภาพประจำตัวของลูกจ้างที่ทำงานกับปัจจัยเสี่ยงตามแบบที่อธิบดีประกาศกำหนด และให้นายจ้างบันทึกผลการตรวจสุขภาพของลูกจ้างในสมุดสุขภาพประจำตัวของลูกจ้างตามผลการตรวจของแพทย์ทุกครั้งที่มีการตรวจสุขภาพ

งานเกี่ยวกับปัจจัยเสี่ยง หมายความว่า งานที่ลูกจ้างทำเกี่ยวกับ

1. สารเคมีอันตรายตามที่รัฐมนตรีประกาศกำหนด
2. จุลชีวันเป็นพิษซึ่งอาจเป็นเชื้อไวรัส แบคทีเรียราหรือสารชีวภาพอื่นตามที่รัฐมนตรีประกาศกำหนด
3. กัมมันตภาพรังสี
4. ความร้อน ความเย็น ความสั่นสะเทือน ความกดดันบรรยากาศ แสง เสียง หรือสภาพแวดล้อมอื่นที่อาจเป็นอันตราย ทั้งนี้ ตามที่รัฐมนตรีประกาศกำหนด

ประวัติส่วนตัว

ชื่อ – นามสกุล .....

วัน เดือน ปี เกิด ..... **เพศ** ☐ ชาย ☑ หญิง

วันที่เข้าทำงาน พฤศจิกายน 2003.....

1. **เลขที่บัตรประจำตัวประชาชน** .....
2. **ที่อยู่ตามบัตรประชาชน เลขที่** ..... **หมู่** .....2..... **ซอย** .....-.....
   ถนน .....-..... **ตำบล (แขวง)** .....
   อำเภอ (เขต) ..... **จังหวัด** .....
   รหัสไปรษณีย์ ...21140..... **โทรศัพท์** .....
3. **ที่อยู่ที่สามารถติดต่อได้ เลขที่** ..... **หมู่** .....2..... **ซอย** .....-.....
   ถนน .....-..... **ตำบล (แขวง)** .....
   อำเภอ (เขต) .....เมือง..... **จังหวัด** ...ระยอง.....
   รหัสไปรษณีย์ ..... **โทรศัพท์** .....081.....
4. **สถานประกอบกิจการ** บริษัท ไทยเนชั่นแนล พาวเวอร์ จำกัด **เลขที่** 60/19
   หมู่ 3 **ซอย** - **ถนน** -
   ตำบล (แขวง) มาบยางพร **อำเภอ (เขต)** ปลวกแดง
   จังหวัด ระยอง **รหัสไปรษณีย์** 21140
   โทรศัพท์ 038-891324-8

ประวัติการทำงาน

ประวัติการทำงานตั้งแต่อดีตถึงปัจจุบัน

ชื่อสถานประกอบกิจการ/แผนก	ประเภทกิจการ	ลักษณะงานที่ทำ	ระยะเวลาที่ทำ (ว/ด/ป – ว/ด/ป)	ปัจจัยที่เสี่ยงต่อสุขภาพ	มีใช้อุปกรณ์ป้องกันอันตราย (ระบุชนิด)
บ. ไทยเนชั่นแนล พาวเวอร์ จก. เปลี่ยนชื่อเป็น บ. โกลว์ เอสพีพี 11 จำกัด	กระแสไฟฟ้า	จ น ท . ค ว า ม ป ล อ ด ภั ย แ ล ะ สิ่งแวดล้อม	2003-ปัจจุบัน	- เสียงดัง	- หมวกนิรภัย - รองเท้านิรภัย - แว่นตา - ที่อุดหู,ที่ครอบหู

ภาคผนวก ข-8

หนังสือรับรองผู้ควบคุมระบบบำบัดมลพิษน้ำ

ที่ อก ๐๓๑๓/ ๑๗๔๕๒

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๒๘ ธันวาคม ๒๕๖๖

เรื่อง หนังสือรับแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน

เรียน ผู้รับใบอนุญาตประกอบกิจการโรงงาน บริษัท โกลว์ เอสพีพี ๑๑ จำกัด

อ้างถึง คำขอเลขที่ ๑๖๕๗ ลงรับวันที่ ๒๖ ธันวาคม ๒๕๖๖

ตามคำขอที่อ้างถึง ท่านแจ้งการเพิ่มเติมบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ของ บริษัท โกลว์ เอสพีพี ๑๑ จำกัด ทะเบียนโรงงานเลขที่
ประกอบกิจการ ผลิตไฟฟ้า ตั้งอยู่ ณ เลขที่ ๒๕๐ หมู่ที่ ๓ ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง โทรศัพท์ ๐ ๓๘๘๙ ๑๓๒๔ ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว รับแจ้งการเพิ่มเติมบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน และให้ท่านยื่นคำขอแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงานครั้งต่อไป ภายในวันที่ ๔ มีนาคม ๒๕๖๘ โดยมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ดังนี้

ผู้จัดการสิ่งแวดล้อม	

ลำดับ	ผู้ควบคุมระบบบำบัด	เลขทะเบียน	มลพิษน้ำ	มลพิษอากาศ	มลพิษกากอุตสาหกรรม
๑				✓	
๒				✓	

ลำดับ	ผู้ปฏิบัติงานประจำระบบบำบัด	มลพิษน้ำ	มลพิษอากาศ	มลพิษกากอุตสาหกรรม
๑			✓	
๒			✓	
๓			✓	

ลำดับ ๔...

ลำดับ	ผู้ปฏิบัติงานประจำระบบบำบัด	มลพิษน้ำ	มลพิษอากาศ	มลพิษกากอุตสาหกรรม
๔			✓	
๕			✓	
๖			✓	

หมายเหตุ ๑. การแจ้งการมี/ยกเลิก/เพิ่มเติม/เปลี่ยนแปลง บุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ต้องส่งหนังสือฉบับนี้ด้วย

๒. ยกเลิกหนังสือรับแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ที่ อก ๐๓๑๓/๓๒๒๑ ลงวันที่ ๑๑ มีนาคม ๒๕๖๕

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

(นางสาวปัทมวรรณ คุณประเสริฐ)
ผู้อำนวยการกองส่งเสริมเทคโนโลยีสิ่งแวดล้อมโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองส่งเสริมเทคโนโลยีสิ่งแวดล้อมโรงงาน
กลุ่มกำกับบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน
โทร. ๐ ๒๔๓๐ ๖๓๑๕ ต่อ ๒๔๐๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๕ ต่อ ๒๔๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

ภาคผนวก ข-9

เอกสารรับรอง ISO 14001:2015 และ ISO 45001:2018

CERTIFICATION INTERNATIONAL

SOCOTEC

CERTIFICATE

No. SCUK004684E

certifies that :

Glow SPP 11 Company Limited (Plant 2)

250 Moo 3, Tambol Mabyangporn, Amphur Pluakdaeng, Rayong 21140 Thailand

operates a management system that has been assessed as conforming to :

ISO 14001:2015

for the scope of activities :

Production of Electric Power

Issue date : 19 February 2021
Valid until : 17 December 2023 (Subject to adherence to the agreed ongoing programme, successful endorsement of certification following each audit and compliance with the terms and conditions of certification.)
Original date of certification : 17 December 2017

Mo Ghaus Operations Director SOCOTEC Certification UK

UKAS MANAGEMENT SYSTEMS 0063

IAF MEMBER OF MULTILATERAL RECOGNITION ARRANGEMENT

SOCOTEC Certification UK Ltd, 6 Gordano Court
Serbert Close, Portishead, Bristol BS20 7FS
UNITED KINGDOM
http://socotec-certification-international.co.uk

CERTIFICATION INTERNATIONAL

SOCOTEC

CERTIFICATE

No. SCUK0046830H

certifies that :

Glow SPP 11 Company Limited (Plant 2)

250 Moo 3, Tambol Mabyangporn, Amphur Pluakdaeng, Rayong 21140 Thailand

operates a management system that has been assessed as conforming to :

ISO 45001:2018

for the scope of activities :

Production of Electric Power

Issue date : 19 February 2021
Valid until : 09 January 2024 (Subject to adherence to the agreed ongoing programme, successful endorsement of certification following each audit and compliance with the terms and conditions of certification.)
Original date of certification : 10 January 2018

Mo Ghaus Operations Director SOCOTEC Certification UK

UKAS MANAGEMENT SYSTEMS 0063

IAF MEMBER OF MULTILATERAL RECOGNITION ARRANGEMENT

SOCOTEC Certification UK Ltd, 6 Gordano Court
Serbert Close, Portishead, Bristol BS20 7FS
UNITED KINGDOM
http://socotec-certification-international.co.uk

ภาคผนวก ข-10

เอกสารประชาสัมพันธ์และการมีส่วนร่วมของชุมชน

D. ตารางสรุปผลการดำเนินงานส่วนกิจการเพื่อสังคม - แผนกชุมชนสัมพันธ์
พื้นที่: อ. ปลวกแดง

No.	ภาพกิจกรรม	รายละเอียด
1		**ชื่อกิจกรรม/โครงการ:** วันเด็กหรรษากับโรงไฟฟ้า GPSC พื้นที่อื่นๆ (GSPP11+GIPP+SRC) **สถานที่:** โรงเรียนบ้านคลองกรำ ต.ตาสิทธิ์ อ.ปลวกแดง **วันที่ดำเนินกิจกรรม:** 12 มกราคม 2567 **วัตถุประสงค์:** เพื่อส่งเสริมภาพลักษณ์และความสัมพันธ์อันดีกับกลุ่มผู้มีส่วนได้เสีย สถานศึกษา ท้องถิ่น ผู้นำชุมชน **ผู้รับผิดชอบหลัก:** วสันต์ สุสุนทร **งบประมาณที่ใช้:** 30,000 บาท
2		**ชื่อกิจกรรม/โครงการ:** สนับสนุนของขวัญสำหรับจัดกิจกรรมวันเด็กให้แก่โรงเรียนที่อยู่ในพื้นที่รอบโรงไฟฟ้า GSPP11 **สถานที่:** โรงเรียน พื้นที่รอบโรงไฟฟ้า GSPP11 **วันที่ดำเนินกิจกรรม:** 8 - 11 มกราคม 2567 **วัตถุประสงค์:** : เพื่อสร้างสัมพันธ์ที่ยั่งยืนและสนับสนุนกิจกรรมที่มีต่อเยาวชน **ผู้รับผิดชอบหลัก:** วสันต์ สุสุนทร / พิพัฒน์ ฐิติพัฒน์สกุล **งบประมาณที่ใช้:** -

D. ตารางสรุปผลการดำเนินงานส่วนกิจการเพื่อสังคม - แผนกชุมชนสัมพันธ์
พื้นที่: อ. ปลวกแดง

No.	ภาพกิจกรรม	รายละเอียด
3		**ชื่อกิจกรรม/โครงการ:** สนับสนุนโครงการเฝ้าระวังเพื่อป้องกันและลดอุบัติเหตุทางถนนในช่วงเทศกาลสงกรานต์ 2567 อบต.มาบยางพร **สถานที่:** จุดตรวจเฝ้าระวังเขตอบต.มาบยางพร อ.ปลวกแดง **วันที่ดำเนินกิจกรรม:** 12 เมษายน 2567 **วัตถุประสงค์:** เพื่อส่งเสริมกิจกรรมด้านความปลอดภัย และสร้างความสัมพันธ์อันดีกับองค์กรปกครองส่วนท้องถิ่นรอบโรงไฟฟ้า **ผู้รับผิดชอบหลัก:** วสันต์ สุสุนทร **งบประมาณที่ใช้:** 3,000 บาท
4		**ชื่อกิจกรรม/โครงการ:** สนับสนุนของขวัญกิจกรรมสงกรานต์และผู้สูงอายุ **สถานที่:** อบต.มาบยางพร อ.ปลวกแดง **วันที่ดำเนินกิจกรรม:** 10 เมษายน 2567 **วัตถุประสงค์:** เพื่อสนับสนุนกิจกรรมประเพณีและสร้างความสัมพันธ์อันดีกับองค์กรปกครองส่วนท้องถิ่นและชุมชนรอบโรงไฟฟ้า **ผู้รับผิดชอบหลัก:** วสันต์ สุสุนทร **งบประมาณที่ใช้:** -

D. ตารางสรุปผลการดำเนินงานส่วนกิจการเพื่อสังคม - แผนกชุมชนสัมพันธ์
พื้นที่: อ. ปลวกแดง

No.	ภาพกิจกรรม	รายละเอียด
5		**ชื่อกิจกรรม/โครงการ**: สนับสนุนของขวัญกิจกรรมสงกรานต์และผู้สูงอายุ **สถานที่**: อบต.ปลวกแดง อ.ปลวกแดง **วันที่ดำเนินกิจกรรม**: 10 เมษายน 2567 **วัตถุประสงค์**: เพื่อสนับสนุนกิจกรรมประเพณีและสร้างความสัมพันธ์อันดีกับองค์กรปกครองส่วนท้องถิ่นและชุมชนรอบโรงไฟฟ้า **ผู้รับผิดชอบหลัก**: วสันต์ สุสุนทร **งบประมาณที่ใช้**: -
6		**ชื่อกิจกรรม/โครงการ:** การประชุมคณะกรรมการพหุภาคีร่วม และคณะกรรมการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมโครงการโรงไฟฟ้าพลังความร้อนร่วม บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566 **สถานที่**: ห้องประชุมชั้น 2 ที่ว่าการอำเภอปลวกแดง **วันที่ดำเนินกิจกรรม:** 19 เมษายน 2567 **วัตถุประสงค์:** ติดตามคุณภาพสิ่งแวดล้อมและการมีส่วนร่วมของชุมชน **ผู้รับผิดชอบหลัก:** วสันต์ สุสุนทร / พิพัฒน์ ฐิติพัฒน์สกุล **งบประมาณที่ใช้:** 25,000 บาท

D. ตารางสรุปผลการดำเนินงานส่วนกิจการเพื่อสังคม - แผนกชุมชนสัมพันธ์
พื้นที่: อ. ปลวกแดง

No.	ภาพกิจกรรม	รายละเอียด
7		**ชื่อกิจกรรม/โครงการ**: โครงการอนุรักษ์พันธุ์สัตว์น้ำจืด **สถานที่**: อ่างเก็บน้ำหนองปลาไหล อ.ปลวกแดง จ.ระยอง **วันที่ดำเนินกิจกรรม**: 18 มิถุนายน 2567 **วัตถุประสงค์**: เพื่ออนุรักษ์พันธุ์ปลาน้ำจืด ส่งเสริมอาชีพประมง และส่งเสริมการท่องเที่ยวในอ่างเก็บน้ำฯ รวมถึงสร้างความสัมพันธ์อันดีกับองค์กรปกครองส่วนท้องถิ่นและชุมชนรอบโรงไฟฟ้า **ผู้รับผิดชอบหลัก**: วสันต์ สุสุนทร **งบประมาณที่ใช้**: 12,500 บาท
8		

ภาคผนวก ข-11

การตรวจสอบและซ่อมบำรุงรักษายานพาหนะของโรงไฟฟ้า

บริษัท ทีซี คาร์ โซลูชั่นส์ (ไทยแลนด์) จำกัด
TC CAR SOLUTIONS (THAILAND) CO.,LTD.
Head Office: 1550 Thanapoom Tower 22Fl., New Petchburi Rd., Makkasan, Ratthawi, Bangkok 10400 Tel. 0-2037-6333 Fax. 0-2037-6336
Rama 3: 650 Nonsri Rd., Chongnonsri, Yannawa, Bangkok 10120 Tel. 0-2027-7810 Fax. 0-2294-8962
Rayong: ESIE Plaza 2, 300/7 Moo 1 Tasit, Pluak Daeng, Rayong 21140 Tel. 0-3895-0461-2 Fax. 0-3895-0463

TCCS

ใบรับรถ/รายงานตรวจสภาพรถ
VEHICLE RECEIPT/INSPECTION REPORT

เลขที่/NUMBER HBRZ404-0892

สัญญาเช่าเลขที่ / CONTRACT NO. TCM2000646 ระยะเวลาที่เช่า / PERIOD 60

ผู้เช่า / CUSTOMER เสิ่งฮั โกลบอล เพาเวอร์ ซัพเพอร์ท จำกัด (มหาชน) ชื่อผู้ติดต่อ / CONTACT PERSON คุณปลื้มจาวี คุณปิติพันพ์ / มิญชิตาเงิน

ที่อยู่ / ADDRESS 555/2 ตึกแกรนเดอร์ คอมพลีกซ์ ถนนสุขุมวิท ซอย 5 ถนนวิภาวดีรังสิต แขวงจตุจักร เขตจตุจักร กรุงเทพฯ 10900 โทรศัพท์ / TELEPHONE 02-140-4635 / 02-140-4637

ยี่ห้อ/รุ่น CAR MAKE & MODEL: TOYOTA/Alphard 2.8 Premium	เกียร์ TRANSMITTION: ☐ MANUAL ☐ AUTOMATIC	เลขเครื่อง ENGINE NO. 1GD8577611
ทะเบียน REGISTRATION NO.: 9154 White	☐ NEW รถใหม่ ☐ USED รถใช้แล้ว	หมายเลขตัวถัง CHASSIS NO. JTFXBGAP108004581

ตรวจสภาพเพื่อ ☐ ปล่อยเช่า / LEASE ☐ ทดแทน / REPLACE (.....) ☐ คืนลูกค้า / RETURN ☐ รับเข้า - ซ่อมบำรุง / MAINTENANCE ☐ รับคืน-สิ้นสุดสัญญาเช่า / RETURN - EXPIRY ☐ รับเข้า - อุบัติเหตุ / ACCIDENT ☐ อื่นๆ / OTHER .....

รถ	วันที่ DATE	เวลา TIME	เลขไมล์ MILEAGE	ปริมาณน้ำมัน / SCALE OF FUEL
เข้า / IN	22/04/22	12:00	2 1 0 7 1 8	E F หรือ.....ถัง
ออก / OUT	6/6/24	11:00	2 1 1 0 2 4	E F หรือ.....ถัง

สภาพ / DESCRIPTION

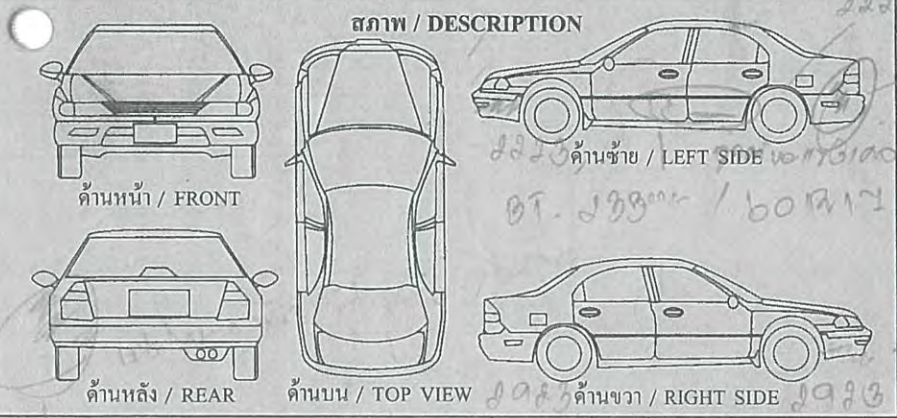

ตรวจเช็ค (Request for check)	สาเหตุ (Cause)

เครื่องมือและอุปกรณ์ TOOL KIT	จำนวนที่มี ส่งมอบ	จำนวนที่มี รับเข้า	ไม่มี NO.	สิ่งประดับและตกแต่ง ACCESSORIES	จำนวนที่มี ส่งมอบ	จำนวนที่มี รับเข้า	ไม่มี NO.
1. แม่แรง (JACK) + มือหมุนแม่แรง (TOOL JACK)				1. เข็มขัดนิรภัย (SAFETY BELT)			
2. เครื่องมือ (TOOLS)				2. ที่จุดบุหรี่ (LIGHTER)			
3. กุญแจ + รีโมท (KEY+REMOTE).....ชุด				3. เครื่องเสียง (AUDIO SET)			
4. ฝาครอบล้อ (WHEEL CAP).....อัน				4. สมุดคู่มือการใช้รถ (CAR MANUAL)			
5. บังกันโคลน (MUD GUARD).....อัน				5. สมุดบริการ (WARRANTY BOOK)			
6. ยางปูพื้น (FLOOR MAT).....อัน				6. สำเนาเล่มทะเบียน (CAR REGISTRATION)			
7. ฟิล์มหน้าเต็ม/ลาดบน (FULL FRONT FILM/TOP STRIFE).....%				7. ทะเบียนรถ (TAX PAYMENT STICKER)			
8. ฟิล์มขอบข้าง (SIDE FILM).....%				8. พ.ร.บ. (COMPULSORY MOTOR INSURANCE)			
9. อื่นๆ (OTHER)							

Please check all of your belongings upon returning out vehicles to the company. We will not take any responsibilities in all damages or lost of your belongings at any reason.
โปรดตรวจทรัพย์สินมีค่าในรถทุกครั้ง เมื่อคืนรถเก่าบริษัทฯ บริษัทฯ ไม่รับผิดชอบในความเสียหาย หรือการสูญหายของทรัพย์สินของท่าน ไม่ว่ากรณีใดๆทั้งสิ้น

รถออก Car (Out) ☐ รถลูกค้า Customer Car / ☐ สำรอง Spare Car / ☐ รถใหม่ New Car
เลขไมล์รถ ออก (Mileage Out) _____ เลขไมล์รถ เข้า (Mileage In) _____
รถเข้า Car (In) ☐ รถลูกค้า Customer Car / ☐ สำรอง Spare Car / ☐ รถใหม่ New Car
เลขไมล์รถ เข้า (Mileage In) _____ เลขไมล์รถ ออก (Mileage Out) _____

อนุญาตให้ Approve Khun _____ เส้นทางจาก _____ ถึง _____
นำรถออกไปเพื่อ Take the car out for _____

VEHICLE RECIPIENT

I, the undersigned, acknowledge the receipt of vehicle in complete and satisfactory condition, with tools and accessories as mentioned above.
Please return the car with full tank of gasoline.

เข้า IN	ออก OUT
Deliver	Deliver .....
Date	Date .....

เข้า IN	ออก OUT	APPROVED BY	APPROVED BY
Driver or Receipter.....	Driver or Receipter.....	.....	.....
Date	Date	( )	( )
REMARK			

A3-20586

บริษัท ทีซี คาร์ โซลูชั่นส์ (ไทยแลนด์) จำกัด
TC CAR SOLUTIONS (THAILAND) CO.,LTD.
Head Office: 1550 Thanapoom Tower 22Fl., New Petchburi Rd., Makkasan, Ratthawi, Bangkok 10400 Tel. 0-2037-6333 Fax. 0-2037-6336
Rama 3: 650 Nonsri Rd., Chongnonsri, Yannawa, Bangkok 10120 Tel. 0-2027-7810 Fax. 0-2294-8962
Rayong: ESIE Plaza 2, 300/7 Moo 1 Tasit, Pluak Daeng, Rayong 21140 Tel. 0-3895-0461-2 Fax. 0-3895-0463

TCCS

ใบรับรถ/รายงานตรวจสภาพรถ
VEHICLE RECEIPT/INSPECTION REPORT

เลขที่/NUMBER VCR2406-0613

สัญญาเช่าเลขที่ / CONTRACT NO. TCM2000646 ระยะเวลาที่เช่า / PERIOD 60

ผู้เช่า / CUSTOMER บริษัท โกลบอล เพาเวอร์ ซินแนอร์ยี่ จำกัด (มหาชน) ชื่อผู้ติดต่อ / CONTACT PERSON คุณปุณยาวีร์ , คุณเปิดปันท์ / บัญชีการเงิน

ที่อยู่ / ADDRESS 555/2 ศูนย์ลอนแอร์ยี่ คอมเพล็กซ์ อาคารบี ชั้น 5 ถนนวิภาวดีรังสิต แขวง[illegible] เขต[illegible] กรุงเทพมหานคร โทรศัพท์ / TELEPHONE 02-140-4675 / 02-140-4627

ยี่ห้อ/รุ่น 10900 CAR MAKE & MODEL ทะเบียน กข 8T-617 REGISTRATION NO.	เกียร์ TRANSMITTION ☐ MANUAL ☑ AUTOMATIC ☐ NEW รถใหม่ ☑ USED รถใช้แล้ว	เลขเครื่อง 1KD2372343 ENGINE NO. หมายเลขตัวถัง MPRT13P308000159 CHASSIS NO.

ตรวจสภาพเพื่อ ☐ ปล่อยเช่า / LEASE ☑ ทดแทน / REPLACE (ขว-9154) ☐ คืนลูกค้า / RETURN ☐ รับเข้า - ซ่อมบำรุง / MAINTENANCE
☐ รับคืน-สิ้นสุดสัญญาเช่า / RETURN - EXPIRY ☐ รับเข้า - อุบัติเหตุ / ACCIDENT ☐ อื่นๆ / OTHER

รถ	วันที่ DATE	เวลา TIME	เลขไมล์ MILEAGE	ปริมาณน้ำมัน / SCALE OF FUEL
เข้า / IN	...../...../.....			E F หรือ.....ถัง
ออก / OUT	14/06/2024	15:30	224766	E F หรือ.....ถัง

สภาพ / DESCRIPTION

ตรวจเช็ค (Request for check)	สาเหตุ (Cause)

เครื่องมือและอุปกรณ์ TOOL KIT	จำนวนที่มี ส่งมอบ	จำนวนที่มี รับเข้า	ไม่มี NO.	สิ่งประดับและตกแต่ง ACCESSORIES	จำนวนที่มี ส่งมอบ	จำนวนที่มี รับเข้า	ไม่มี NO.
1. แม่แรง (JACK) + มือหมุนแม่แรง (TOOL JACK)	/			1. เข็มขัดนิรภัย (SAFETY BELT)	/		
2. เครื่องมือ (TOOLS)	/			2. ที่จุดบุหรี่ (LIGHTER)			/
3. กุญแจ + รีโมท (KEY+REMOTE).....ชุด	/			3. เครื่องเสียง (AUDIO SET)	/		
4. ฝาครอบล้อ (WHEEL CAP).....อัน	/			4. สมุดคู่มือการใช้รถ (CAR MANUAL)	/		
5. ยางกันโคลน (MUD GUARD).....อัน	/			5. สมุดบริการ (WARRANTY BOOK)	/		
6. ยางปูพื้น (FLOOR MAT).....อัน	/			6. สำเนาเล่มทะเบียน (CAR REGISTRATION)	/		
7. ฟิล์มหน้าเต็ม/ฉาดบน (FULL FRONT FILM/TOP STRIFE).....%	/			7. ทะเบียนรถ (TAX PAYMENT STICKER)	/		
8. ฟิล์มขอบข้าง (SIDE FILM).....%	/			8. พ.ร.บ. (COMPULSORY MOTOR INSURANCE)	/		
9. อื่นๆ (OTHER) ยางอะไหล่ 1 เส้น							

Please check all of your belongings upon returning out vehicles to the company. We will not take any responsibilities in all damages or lost of your belongings at any reason.
โปรดตรวจทรัพย์สินมีค่าในรถทุกครั้ง เมื่อคืนรถเก่าบริษัทฯ บริษัทฯ ไม่รับผิดชอบในความเสียหาย หรือการสูญหายของทรัพย์สินของท่าน ไม่ว่ากรณีใดๆทั้งสิ้น

รถออก Car (Out) ☐ รถลูกค้า Customer Car / ☑ สำรอง Spare Car / ☐ รถใหม่ New Car
เลขไมล์รถ ออก (Mileage Out) 224730 F เลขไมล์รถ เข้า (Mileage In) _____
รถเข้า Car (In) ☐ รถลูกค้า Customer Car / ☐ สำรอง Spare Car / ☐ รถใหม่ New Car
เลขไมล์รถ เข้า (Mileage In) _____ เลขไมล์รถ ออก (Mileage Out) _____

อนุญาตให้ Approve Khun Pirak เส้นทางจาก TCCS ขอวัน ถึง บ. โกลบอล เพาเวอร์
นำรถออกไปเพื่อ Take the car out for ทดแทน

VEHICLE RECIPIENT

I, the undersigned, acknowledge the receipt of vehicle in complete and satisfactory condition, with tools and accessories as mentioned above.
Please return the car with full tank of gasoline.

เข้า IN	ออก OUT
Deliver	Deliver Pirak
Date	Date 14-06-2024

เข้า IN	ออก OUT	APPROVED BY	APPROVED BY
Driver or Receipter	Driver or Receipter	.....	.....
Date	Date	( )	( )
REMARK			

A3-20586

ภาคผนวก ข-12

สถิติอุบัติเหตุ

Here We Safe Performance	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24	Sep-24	Oct-24	Nov-24	Dec-24
Result Base Score	5	5	5	5	5	5	5	5	5	5	5	5
Activity Base Score	2	3	1	1	5	5	1	1	1	1	1	1
HWS Score	2	4	1	1	5	5	1	1	1	1	1	1

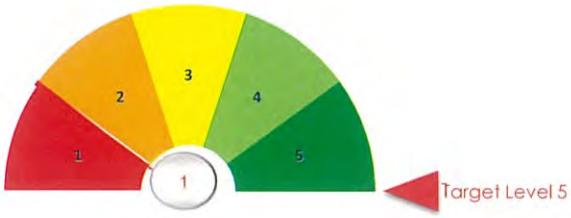

HWS Score
[YTD at end June 2024]

Safety

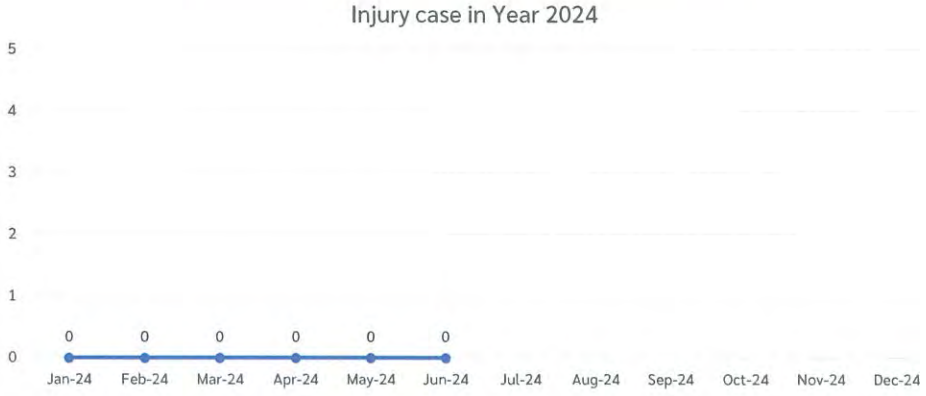

ภาคผนวก ข-13

การตรวจสอบระบบท่อที่เข้าสู่โรงไฟฟ้าจาก East water

แบบฟอร์มแสดงผลการตรวจสอบอุปกรณ์ ประจำเดือน มกราคม 2567

ท่อแยกจ่ายน้ำ บริษัท โกล์ว เอสพี พี (11,12) จำกัด

รายการตรวจเช็ค		รายการอุปกรณ์						
		MV	AV	BO	BN	FLOW	GV	รวม
จำนวนอุปกรณ์	แผน	2	7	5				14
	พบ	2	7	5				14
	ใช้ได้	2	6	5				13
	ใช้ไม่ได้		1					1
จำนวนอุปกรณ์ที่ใช้ได้	%	100.00%	85.71%	100.00%				92.86%
หล่อลื่น								
งานตัดหญ้า			3	4				
งานสูบน้ำ								
งานทำความสะอาด			5					
ระบายตะกอน								
ทดสอบการทำงาน			4	4				

หมายเหตุ

อุปกรณ์	ปัญหาและอุปสรรค
BO No.3	โดนกลบเนื่องร้านขายวัสดุก่อสร้างปรับปรุงภูมิทัศน์หน้าร้าน
AV No.8	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.6	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.10	ถอดตัว Air ออกเหลือแค่ Gate valve

รายงานโดย บรรเจิด ศรีรัตน์

(นายบรรเจิด ศรีรัตน์)

หจก.สตีลเซอร์วิส แอนด์ คอนสตรักชั่น

รับรองโดย

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

EastWater : Water solution for all.

FM_CS_052-006_RV01 : รายการตรวจเช็คอุปกรณ์ระบบท่อส่งน้ำ

ชื่อระบบท่อ : ท่อแยกจ่ายน้ำ บริษัท โกล์ว เอสพี พี (11,12) จำกัด (พื้นที่ ระยอง)	ผู้ปฏิบัติงาน : นาย บรรเจิด ศรีรัตน์
ระบบท่อหลัก :	ผู้ตรวจสอบ : นาย สุริยา สมานราษฎร์
พื้นที่บริการ : ระยอง	แผนก/หน่วยงาน :
วันที่ปฏิบัติงาน : 20-01-67	เอกสารอ้างอิง :
ระยะทางประมาณ 12 กม. (STEEL PIPE Ø 500 MM.)	

ลำดับ	ชื่ออุปกรณ์	STA.	หมายเลข/รหัส	รายการบำรุงรักษา						ตรวจสอบด้วยสายตา								วันที่ทำงาน	หมายเหตุ
				หล่อลื่น	งานตัดหญ้า	งานสูบน้ำ	งานทำความสะอาด	ระบายตะกอน	ทดสอบการทำงาน	อุปกรณ์ใช้งานได้	อุปกรณ์ใช้งานไม่ได้	สีชำรุด	เกิดเสนิม	รอยเชื่อมแตก	ฝาบ่อชำรุด	ชิ้นส่วนวาล์วเสียหาย	ประเภทชิ้นส่วนวาล์วเสียหาย		
1	Blow Off No.2	4+750	04 - 2 - 05 - BO - 302		✓				✓	✓								20-1-67	
2	Air Valve No.5	4+780	04 - 2 - 05 - AV - 305		✓		✓		✓	✓								ๆ	ไม่มีอาคาร
3	Air Valve No.6	5+425	04 - 2 - 05 - AV - 306																ถอดอุปกรณ์ออก ยกเลิก
4	Blow Off No.3	6+050	04 - 2 - 05 - BO - 303																โดนกลบ
5	Air Valve No.7	6+305	04 - 2 - 05 - AV - 307				✓		✓	✓									อยู่บนปูน
6	Blow Off No.4	7+750	04 - 2 - 05 - BO - 304		✓				✓	✓								ๆ	
7	Air Valve No.8	7+780	04 - 2 - 05 - AV - 308																ยกเลิก
8	Air Valve No.9	8+500	04 - 2 - 05 - AV - 309		✓		✓		✓	✓								ๆ	
9	Air Valve No.10	8+800	04 - 2 - 05 - AV - 310				✓			✓									หน้าร้านขายปลา
10	Blow Off No.5	9+595	04 - 2 - 05 - BO - 305		✓				✓	✓								ๆ	
11	Air Valve No.11	9+815	04 - 2 - 05 - AV - 311																อยู่ในผิวจราจร
12	Blow Off No.6	9+975	04 - 2 - 05 - BO - 306																อยู่บนปูน
13	Air Valve No.12	10+700	04 - 2 - 05 - AV - 312																อยู่ในผิวจราจร
14	Blow Off No.7	11+380	04 - 2 - 05 - BO - 307		✓				✓	✓								ๆ	
15	Air Valve No.13	11+650	04 - 2 - 05 - AV - 313		✓		✓		✓	✓								ๆ	
16	Main Valve No.3	12+050	04 - 2 - 05 - MV - 302																อยู่ในผิวจราจร
17	Main Valve No.4	12+050	04 - 2 - 05 - MV - 302																อยู่ในสถานีลูกค้า

บันทึก : AV No.8 ยกเลิก ไม่นำมาคำนวณ %การใช้งาน เนื่องจากติดขัดงานขยายผิวจราจร

AV No.10 ถอดตัวแอร์ออกเหลือแค่ Gate Valve

รายงานโดย บรรเจิด ศรีรัตน์

(นาย บรรเจิด ศรีรัตน์)

หจก.สตีลเซอร์วิส แอนด์ คอนสตรักชั่น

รับรองโดย

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

แบบฟอร์มแสดงผลการตรวจสอบอุปกรณ์ ประจำเดือน กุมภาพันธ์ 2567

ท่อแยกจ่ายน้ำ บริษัท โกล้ว เอสพี พี (11,12) จำกัด

รายการตรวจเช็ค		รายการอุปกรณ์						
		MV	AV	BO	BN	FLOW	GV	รวม
จำนวนอุปกรณ์	แผน	2	7	5				14
	พบ	2	7	5				14
	ใช้ได้	2	6	5				13
	ใช้ไม่ได้		1					1
จำนวนอุปกรณ์ที่ใช้ได้	%	100.00%	85.71%	100.00%				92.86%
หล่อลื่น								
งานตัดหญ้า			3	4				
งานสูบน้ำ								
งานทำความสะอาด			7					
ระบายตะกอน								
ทดสอบการทำงาน			7					

หมายเหตุ

อุปกรณ์	ปัญหาและอุปสรรค
BO No.3	โดนกลบเนื่องร้านขายวัสดุก่อสร้างปรับปรุงภูมิทัศน์หน้าร้าน
AV No.8	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.6	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.10	ถอดตัว Air ออกเหลือแต่ Gate valve

รายงานโดย บรรเจิด ศรีรัตน์

(นายบรรเจิด ศรีรัตน์)

หจก.สตีลเซอร์วิส แอนด์ คอนสตรักชั่น

รับรองโดย.....

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

EastWater Water solution for all.

FM_CS_052-006_RV01 : รายการตรวจเช็คอุปกรณ์ระบบท่อส่งน้ำ

ชื่อระบบท่อ : ท่อแยกจ่ายน้ำ บริษัท โกล้ว เอสพี พี (11,12) จำกัด (พื้นที่ ระยอง)	ผู้ปฏิบัติงาน : นาย บรรเจิด ศรีรัตน์
ระบบท่อหลัก :	ผู้ตรวจสอบ : นาย สุริยา สมานราษฎร์
พื้นที่บริการ : ระยอง	แผนก/หน่วยงาน :
วันที่ปฏิบัติงาน : 12-02-67	เอกสารอ้างอิง :

ระยะทางประมาณ 12 กม. (STEEL PIPE Ø 500 MM.)

ลำดับ	ชื่ออุปกรณ์	STA.	หมายเลขรหัส	รายการบำรุงรักษา					ตรวจสอบด้วยสายตา							วันที่ทำงาน	หมายเหตุ
				หล่อลื่น	งานตัดหญ้า	งานสูบน้ำ	งานทำความสะอาด	ระบาย	ทดสอบการทำงาน	อุปกรณ์ใช้งานได้	อุปกรณ์ใช้งานไม่ได้	สีชำรุด	เกิดสนิม	รอยเชื่อมแตก	ฝาบ่อชำรุด	ชิ้นส่วนวาล์วเสียหาย	ประเภทชิ้นส่วนวาล์วเสียหาย		
1	Blow Off No.2	4+750	04 - 2 - 05 - BO - 302		✓				✓	✓								12-2-67	
2	Air Valve No.5	4+780	04 - 2 - 05 - AV - 305		✓		✓		✓	✓								ๆ	ไม่มีอาคาร
3	Air Valve No.6	5+425	04 - 2 - 05 - AV - 306																ถอดอุปกรณ์ออก ยกเลิก
4	Blow Off No.3	6+050	04 - 2 - 05 - BO - 303																โดนกลบ
5	Air Valve No.7	6+305	04 - 2 - 05 - AV - 307				✓		✓	✓								ๆ	อยู่บนปูน
6	Blow Off No.4	7+750	04 - 2 - 05 - BO - 304		✓				✓	✓								ๆ	
7	Air Valve No.8	7+780	04 - 2 - 05 - AV - 308																ยกเลิก
8	Air Valve No.9	8+500	04 - 2 - 05 - AV - 309		✓		✓		✓	✓								ๆ	
9	Air Valve No.10	8+800	04 - 2 - 05 - AV - 310				✓		✓	✓								ๆ	หน้าร้านขายปลา
10	Blow Off No.5	9+595	04 - 2 - 05 - BO - 305		✓				✓	✓								ๆ	
11	Air Valve No.11	9+815	04 - 2 - 05 - AV - 311				✓		✓	✓								ๆ	อยู่ในผิวจราจร
12	Blow Off No.6	9+975	04 - 2 - 05 - BO - 306																อยู่บนปูน
13	Air Valve No.12	10+700	04 - 2 - 05 - AV - 312		✓		✓		✓	✓								ๆ	อยู่ในผิวจราจร
14	Blow Off No.7	11+380	04 - 2 - 05 - BO - 307		✓				✓	✓								ๆ	
15	Air Valve No.13	11+650	04 - 2 - 05 - AV - 313				✓		✓	✓								ๆ	
16	Main Valve No.3	12+050	04 - 2 - 05 - MV - 302							✓								ๆ	อยู่ในผิวจราจร
17	Main Valve No.4	12+050	04 - 2 - 05 - MV - 302							✓								ๆ	อยู่ในสถานีลูกค้า

บันทึก : AV No.8 ยกเลิก ไม่นำมาคำนวณ %การใช้งาน เนื่องจากติดขัดงานขายผิวจราจร

AV No.10 ถอดตัวแอร์ออกเหลือแต่ Gate Valve

รายงานโดย บรรเจิด ศรีรัตน์

(นาย บรรเจิด ศรีรัตน์)

หจก.สตีลเซอร์วิส แอนด์ คอนสตรักชั่น

รับรองโดย.....

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

แบบฟอร์มแสดงผลการตรวจสอบอุปกรณ์ ประจำเดือน มีนาคม 2567

ท่อแยกจ่ายน้ำ บริษัท โกล์ว เอสพี พี (11,12) จำกัด

รายการตรวจเช็ค		รายการอุปกรณ์						
		MV	AV	BO	BN	FLOW	GV	รวม
จำนวนอุปกรณ์	แผน	2	7	5				14
	พบ	2	7	5				14
	ใช้ได้	2	6	5				13
	ใช้ไม่ได้		1					1
จำนวนอุปกรณ์ที่ใช้ได้	%	100.00%	85.71%	100.00%				92.86%
หล่อลื่น								
งานตัดหญ้า			5	5				
งานสูบน้ำ								
งานทำความสะอาด			7					
ระบายตะกอน								
ทดสอบการทำงาน			6	4				

หมายเหตุ

อุปกรณ์	ปัญหาและอุปสรรค
BO No.3	โดนกลบเนื่องร้านขายวัสดุก่อสร้างปรับปรุงภูมิทัศน์หน้าร้าน
AV No.8	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.6	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.10	ถอดตัว Air ออกเหลือแค่ Gate valve

รายงานโดย บรรเจิด ศรีรัตน์

(นายบรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

EastWater : Water solution for all.

FM_CS_052-006_RV01 : รายการตรวจเช็คอุปกรณ์ระบบท่อส่งน้ำ

ชื่อระบบท่อ : ท่อแยกจ่ายน้ำ บริษัท โกล์ว เอสพี พี (11,12) จำกัด (พื้นที่ ระยอง)	ผู้ปฏิบัติงาน : นาย บรรเจิด ศรีรัตน์
ระบบท่อหลัก :	ผู้ตรวจสอบ : นาย สุริยา สมานราษฎร์
พื้นที่บริการ : ระยอง	แผนก/หน่วยงาน :
วันที่ปฏิบัติงาน : 19-03-67	เอกสารอ้างอิง :
ระยะทางประมาณ 12 กม. (STEEL PIPE Ø 500 MM.)	

ลำดับ	ชื่ออุปกรณ์	STA.	หมายเลข/รหัส	รายการบำรุงรักษา						ตรวจสอบด้วยสายตา								วันที่ทำงาน	หมายเหตุ
				หล่อลื่น	งานตัดหญ้า	งานสูบน้ำ	งานทำความสะอาด	ระบายตะกอน	ทดสอบการทำงาน	อุปกรณ์ใช้งานได้	อุปกรณ์ใช้งานไม่ได้	สีชำรุด	เกิดสนิม	รอยเชื่อมแตก	ฝาบ่อชำรุด	ชิ้นส่วนวาล์วเสียหาย	ประเภทชิ้นส่วนวาล์วเสียหาย		
1	Blow Off No.2	4+750	04 - 2 - 05 - BO - 302		✓				✓	✓								19-3-67	
2	Air Valve No.5	4+780	04 - 2 - 05 - AV - 305		✓		✓		✓	✓								"	ไม่มีอาคาร
3	Air Valve No.6	5+425	04 - 2 - 05 - AV - 306																ถอดอุปกรณ์ออก ยกเลิก
4	Blow Off No.3	6+050	04 - 2 - 05 - BO - 303																โดนกลบ
5	Air Valve No.7	6+305	04 - 2 - 05 - AV - 307				✓		✓	✓								"	อยู่บนปูน
6	Blow Off No.4	7+750	04 - 2 - 05 - BO - 304		✓				✓	✓								"	
7	Air Valve No.8	7+780	04 - 2 - 05 - AV - 308																ยกเลิก
8	Air Valve No.9	8+500	04 - 2 - 05 - AV - 309		✓		✓		✓	✓								"	
9	Air Valve No.10	8+800	04 - 2 - 05 - AV - 310		✓		✓				✓							"	หน้าร้านขายปลา
10	Blow Off No.5	9+595	04 - 2 - 05 - BO - 305		✓				✓	✓								"	
11	Air Valve No.11	9+815	04 - 2 - 05 - AV - 311				✓		✓	✓								"	อยู่ในผิวจราจร
12	Blow Off No.6	9+975	04 - 2 - 05 - BO - 306		✓					✓								"	อยู่บนปูน
13	Air Valve No.12	10+700	04 - 2 - 05 - AV - 312		✓		✓		✓	✓								"	อยู่ในผิวจราจร
14	Blow Off No.7	11+380	04 - 2 - 05 - BO - 307		✓				✓	✓								"	
15	Air Valve No.13	11+650	04 - 2 - 05 - AV - 313		✓		✓		✓	✓								"	
16	Main Valve No.3	12+050	04 - 2 - 05 - MV - 302							✓								"	อยู่ในผิวจราจร
17	Main Valve No.4	12+050	04 - 2 - 05 - MV - 302							✓								"	อยู่ในสถานีลูกค้า

บันทึก : AV No.8 ยกเลิก ไม่นำมาคำนวณ %การใช้งาน เนื่องจากติดขัดงานขยายผิวจราจร

AV No.10 ถอดตัวแอร์ออกเหลือแค่ Gate Valve

BO No.5 ปะเก็นวาล์วขาด เปลี่ยนปะเก็นใหม่

รายงานโดย บรรเจิด ศรีรัตน์

(นาย บรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

แบบฟอร์มแสดงผลการตรวจสอบอุปกรณ์ ประจำเดือน เมษายน 2567

ท่อแยกจ่ายน้ำ บริษัท โกล์ว เอสพี พี (11,12) จำกัด

รายการตรวจเช็ค		รายการอุปกรณ์						
		MV	AV	BO	BN	FLOW	GV	รวม
จำนวนอุปกรณ์	แผน	2	7	5				14
	พบ	2	7	5				14
	ใช้ได้	2	6	5				13
	ใช้ไม่ได้		1					1
จำนวนอุปกรณ์ที่ใช้ได้	%	100.00%	85.71%	100.00%				92.86%
หล่อลื่น								
งานตัดหญ้า			7	4				
งานสูบน้ำ								
งานทำความสะอาด		1	7					
ระบายตะกอน								
ทดสอบการทำงาน			6	3				

หมายเหตุ

อุปกรณ์	ปัญหาและอุปสรรค
BO No.3	โดนกลบเนื่องร้านขายวัสดุก่อสร้างปรับปรุงภูมิทัศน์หน้าร้าน
AV No.8	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.6	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.10	ถอดตัว Air ออกเหลือแค่ Gate valve

รายงานโดย บรรเจิด ศรีรัตน์

(นายบรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

EastWater Water solution for all.

FM_CS_052-006_RV01 : รายการตรวจเช็คอุปกรณ์ระบบท่อส่งน้ำ

ชื่อระบบท่อ : ท่อแยกจ่ายน้ำ บริษัท โกล์ว เอสพี พี (11,12) จำกัด (พื้นที่ ระยอง)	ผู้ปฏิบัติงาน : นาย บรรเจิด ศรีรัตน์
ระบบท่อหลัก :	ผู้ตรวจสอบ : นาย สุริยา สมานราษฎร์
พื้นที่บริการ : ระยอง	แผนก/หน่วยงาน :
วันที่ปฏิบัติงาน : 09-04-67	เอกสารอ้างอิง :
ระยะทางประมาณ 12 กม. (STEEL PIPE Ø 500 MM.)	

ลำดับ	ชื่ออุปกรณ์	STA.	หมายเลข/รหัส	รายการบำรุงรักษา						ตรวจสอบด้วยสายตา								วันที่ทำงาน	หมายเหตุ
				หล่อลื่น	งานตัดหญ้า	งานสูบน้ำ	งานทำความสะอาด	ระบายตะกอน	ทดสอบการทำงาน	อุปกรณ์ใช้งานได้	อุปกรณ์ใช้งานไม่ได้	สีชำรุด	เกิดสนิม	รอยเชื่อมแตก	ฝาบ่อชำรุด	ชิ้นส่วนวาล์วเสียหาย	ประเภทชิ้นส่วนวาล์วเสียหาย		
1	Blow Off No.2	4+750	04 - 2 - 05 - BO - 302		✓				✓	✓								9-4-67	
2	Air Valve No.5	4+780	04 - 2 - 05 - AV - 305		✓		✓		✓	✓								ๆ	ไม่มีอาคาร
3	Air Valve No.6	5+425	04 - 2 - 05 - AV - 306																ถอดอุปกรณ์ออก ยกเลิก
4	Blow Off No.3	6+050	04 - 2 - 05 - BO - 303																โดนกลบ
5	Air Valve No.7	6+305	04 - 2 - 05 - AV - 307				✓		✓	✓								ๆ	อยู่บนปูน
6	Blow Off No.4	7+750	04 - 2 - 05 - BO - 304		✓				✓	✓								ๆ	
7	Air Valve No.8	7+780	04 - 2 - 05 - AV - 308																ยกเลิก
8	Air Valve No.9	8+500	04 - 2 - 05 - AV - 309		✓		✓		✓	✓								ๆ	
9	Air Valve No.10	8+800	04 - 2 - 05 - AV - 310				✓		✓		✓							ๆ	หน้าร้านขายปลา
10	Blow Off No.5	9+595	04 - 2 - 05 - BO - 305		✓														แกนวาล์วหาย
11	Air Valve No.11	9+815	04 - 2 - 05 - AV - 311				✓		✓	✓								ๆ	อยู่ในผิวจราจร
12	Blow Off No.6	9+975	04 - 2 - 05 - BO - 306							✓									อยู่บนปูน
13	Air Valve No.12	10+700	04 - 2 - 05 - AV - 312				✓		✓	✓								ๆ	อยู่ในผิวจราจร
14	Blow Off No.7	11+380	04 - 2 - 05 - BO - 307		✓				✓	✓								ๆ	
15	Air Valve No.13	11+650	04 - 2 - 05 - AV - 313		✓		✓		✓	✓								ๆ	
16	Main Valve No.3	12+050	04 - 2 - 05 - MV - 302				✓			✓								ๆ	อยู่ในผิวจราจร
17	Main Valve No.4	12+050	04 - 2 - 05 - MV - 302																อยู่ในสถานีลูกค้า

บันทึก : AV No.8 ยกเลิก ไม่นำมาคำนวณ %การใช้งาน เนื่องจากติดขัดงานขยายผิวจราจร

AV No.10 ถอดตัวแอร์ออกเหลือแค่ Gate Valve

BO No.5 ปะเก็นวาล์วขาด เปลี่ยนปะเก็นใหม่

รายงานโดย บรรเจิด ศรีรัตน์

(นาย บรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

แบบฟอร์มแสดงผลการตรวจสอบอุปกรณ์ ประจำเดือน พฤษภาคม 2567

ท่อแยกจ่ายน้ำ บริษัท โกล้ว เอสพี พี (11,12) จำกัด

รายการตรวจเช็ค		รายการอุปกรณ์						
		MV	AV	BO	BN	FLOW	GV	รวม
จำนวนอุปกรณ์	แผน	2	7	5				14
	พบ	2	7	5				14
	ใช้ได้	2	6	5				13
	ใช้ไม่ได้		1					1
จำนวนอุปกรณ์ที่ใช้ได้	%	100.00%	85.71%	100.00%				92.86%
หล่อลื่น								
งานตัดหญ้า		1	5	4				
งานสูบน้ำ								
งานทำความสะอาด			7					
ระบายตะกอน								
ทดสอบการทำงาน		1	7	4				

หมายเหตุ

อุปกรณ์	ปัญหาและอุปสรรค
BO No.3	โตนกลบเนื่องร้านขายวัสดุก่อสร้างปรับปรุงภูมิทัศน์หน้าร้าน
AV No.8	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.6	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.10	ถอดตัว Air ออกเหลือแค่ Gate valve

รายงานโดย บรรเจิด ศรีรัตน์

(นายบรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย Th. for.

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

EastWater Water solution for all.

FM_CS_052-006_RV01 : รายการตรวจเช็คอุปกรณ์ระบบท่อส่งน้ำ

ชื่อระบบท่อ : ท่อแยกจ่ายน้ำ บริษัท โกล้ว เอสพี พี (11,12) จำกัด (พื้นที่ ระยอง)	ผู้ปฏิบัติงาน : นาย บรรเจิด ศรีรัตน์
ระบบท่อหลัก :	ผู้ตรวจสอบ : นาย สุริยา สมานราษฎร์
พื้นที่บริการ : ระยอง	แผนก/หน่วยงาน :
วันที่ปฏิบัติงาน :	เอกสารอ้างอิง :

ระยะทางประมาณ 12 กม. (STEEL PIPE Ø 500 MM.)

ลำดับ	ชื่ออุปกรณ์	STA.	หมายเลขพาหัส	รายการบำรุงรักษา					ตรวจสอบด้วยสายตา								วันที่ทำงาน	หมายเหตุ
				หล่อลื่น	งานตัดหญ้า	งานสูบน้ำ	งานทำความสะอาด	ระบายตะกอน	ทดสอบการทำงาน	อุปกรณ์ใช้งานได้	อุปกรณ์ใช้งานไม่ได้	สีชำรุด	เกิดสนิม	รอยเชื่อมแตก	ฝาบ่อชำรุด	จีบส่วนวาล์วเสียหาย	ประเภทชิ้นส่วนวาล์วเสียหาย		
1	Blow Off No.2	4+750	04 - 2 - 05 - BO - 302		✓				✓	✓									
2	Air Valve No.5	4+780	04 - 2 - 05 - AV - 305		✓		✓		✓	✓									ไม่มีอาคาร
3	Air Valve No.6	5+425	04 - 2 - 05 - AV - 306																ถอดอุปกรณ์ออก ยกเลิก
4	Blow Off No.3	6+050	04 - 2 - 05 - BO - 303																โตนกลบ
5	Air Valve No.7	6+305	04 - 2 - 05 - AV - 307				✓		✓	✓									อยู่บนปูน
6	Blow Off No.4	7+750	04 - 2 - 05 - BO - 304		✓				✓	✓									
7	Air Valve No.8	7+780	04 - 2 - 05 - AV - 308																ยกเลิก
8	Air Valve No.9	8+500	04 - 2 - 05 - AV - 309		✓		✓		✓	✓									
9	Air Valve No.10	8+800	04 - 2 - 05 - AV - 310		✓		✓		✓	✓									หน้าร้านขายปลา
10	Blow Off No.5	9+595	04 - 2 - 05 - BO - 305		✓				✓	✓									
11	Air Valve No.11	9+815	04 - 2 - 05 - AV - 311				✓		✓	✓									อยู่ในผิวจราจร
12	Blow Off No.6	9+975	04 - 2 - 05 - BO - 306		✓														อยู่บนปูน
13	Air Valve No.12	10+700	04 - 2 - 05 - AV - 312		✓		✓		✓	✓									
14	Blow Off No.7	11+380	04 - 2 - 05 - BO - 307						✓	✓									
15	Air Valve No.~~13~~	11+650	04 - 2 - 05 - AV - 313		✓		✓		✓	✓									
16	Main Valve No.3	~~12+050~~	04 - 2 - 05 - MV - 302							✓									อยู่ในผิวจราจร
17	Main Valve No.4	12+050	04 - 2 - 05 - MV - 302		✓				✓	✓									อยู่ในสถานีถูกค้า

บันทึก : AV No.8 ยกเลิก ไม่นำมาคำนวณ %การใช้งาน เนื่องจากติดขัดงานขยายผิวจราจร

AV No.10 ถอดตัวแอร์ออกเหลือแค่ Gate Valve

BO No.5 ปะเก็นวาล์วขาด เปลี่ยนปะเก็นใหม่

รายงานโดย บรรเจิด ศรีรัตน์

(นาย บรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย Th. for.

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

แบบฟอร์มแสดงผลการตรวจสอบอุปกรณ์ ประจำเดือน มิถุนายน 2567

ท่อแยกจ่ายน้ำ บริษัท โกล้ว เอสพี พี (11,12) จำกัด

รายการตรวจเช็ค		รายการอุปกรณ์						
		MV	AV	BO	BN	FLOW	GV	รวม
จำนวนอุปกรณ์	เผน	2	7	5				14
	พบ	2	7	5				14
	ใช้ได้	2	6	5				13
	ใช้ไม่ได้		1					1
จำนวนอุปกรณ์ที่ใช้ได้	%	100.00%	85.71%	100.00%				92.86%
หล่อลื่น								
งานตัดหญ้า		1	5	4				
งานสูบน้ำ								
งานทำความสะอาด		2	7					
ระบายตะกอน								
ทดสอบการทำงาน			6	5				

หมายเหตุ

อุปกรณ์	ปัญหาและอุปสรรค
BO No.3	โดนกลบเนื่องร้านขายวัสดุก่อสร้างปรับปรุงภูมิทัศน์หน้าร้าน
AV No.8	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.6	ยกเลิก ไม่นำมาคำนวณ %การใช้งาน
AV No.10	ถอดตัว Air ออกเหลือแค่ Gate valve

รายงานโดย.....

(นายบรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย.....

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

EastWater : Water solution for all.

FM_CS_052-006_RV01 : รายการตรวจเช็คอุปกรณ์ระบบท่อส่งน้ำ

ชื่อระบบท่อ : ท่อแยกจ่ายน้ำ บริษัท โกล้ว เอสพี พี (11,12) จำกัด (พื้นที่ ระยอง)	ผู้ปฏิบัติงาน : นาย บรรเจิด ศรีรัตน์
ระบบท่อหลัก :	ผู้ตรวจสอบ : นาย สุริยา สมานราษฎร์
พื้นที่บริการ : ระยอง	แผนก/หน่วยงาน :
วันที่ปฏิบัติงาน : 24-06-67	เอกสารอ้างอิง :
ระยะทางประมาณ 12 กม. (STEEL PIPE Ø 500 MM.)	

ลำดับ	ชื่ออุปกรณ์	STA.	หมายเลขพัสดุ	รายการบำรุงรักษา					ตรวจสอบด้วยสายตา								วันที่ทำงาน	หมายเหตุ
				หล่อลื่น	งานตัดหญ้า	เบรกน้ำ	ทดลองทำงาน	ทดสอบการทำงาน	อุปกรณ์ใช้งานได้	อุปกรณ์ใช้งานไม่ได้	ตีสีวาล์ว	เกิดสนิม	รอยเชื่อมแตก	ฝาบ่อชำรุด	ซึมสำมาตัวเสียหาย	ประเภทชิ้นส่วนวาล์วเสียหาย		
1	Blow Off No.2	4+750	04 - 2 - 05 - BO - 302		✓			✓	✓								24-6-67	
2	Air Valve No.5	4+780	04 - 2 - 05 - AV - 305		✓		✓	✓	✓								"	ไม่มีอาการ
3	Air Valve No.6	5+425	04 - 2 - 05 - AV - 306															ถอดอุปกรณ์ออก ยกเลิก
4	Blow Off No.3	6+050	04 - 2 - 05 - BO - 303															โดนกลบ
5	Air Valve No.7	6+305	04 - 2 - 05 - AV - 307		✓		✓	✓	✓								๓	อยู่บนปูน
6	Blow Off No.4	7+750	04 - 2 - 05 - BO - 304		✓			✓	✓								๑	
7	Air Valve No.8	7+780	04 - 2 - 05 - AV - 308															ยกเลิก
8	Air Valve No.9	8+500	04 - 2 - 05 - AV - 309		✓		✓	✓	✓								๓	
9	Air Valve No.10	8+800	04 - 2 - 05 - AV - 310				✓										๑	หน้าร้านขายปลา
10	Blow Off No.5	9+595	04 - 2 - 05 - BO - 305					✓	✓								๓	
11	Air Valve No.11	9+815	04 - 2 - 05 - AV - 311				✓	✓	✓								๘	อยู่ในผิวจราจร
12	Blow Off No.6	9+975	04 - 2 - 05 - BO - 306		✓				✓									อยู่บนปูน
13	Air Valve No.12	10+700	04 - 2 - 05 - AV - 312		✓		✓	✓	✓								๓	อยู่ในผิวจราจร
14	Blow Off No.7	11+380	04 - 2 - 05 - BO - 307		✓			✓	✓								๑	
15	Air Valve No.13	11+650	04 - 2 - 05 - AV - 313		✓		✓	✓	✓								๓	
16	Main Valve No.3	12+050	04 - 2 - 05 - MV - 302		✓		✓		✓								๑	อยู่ในผิวจราจร 100 %
17	Main Valve No.4	12+050	04 - 2 - 05 - MV - 302				✓		✓								๘	อยู่ในสถานีลูกค้า 100 %

บันทึก : AV No.8 ยกเลิก ไม่นำมาคำนวณ %การใช้งาน เนื่องจากติดขัดงานขยายผิวจราจร

AV No.10 ถอดตัวแอร์ออกเหลือแค่ Gate Valve

BO No.5 ปะเก็นวาล์วขาด เปลี่ยนปะเก็นใหม่

รายงานโดย.....

(นาย บรรเจิด ศรีรัตน์)

บจก.สตีลเซอร์วิส แอนด์ คอนสตรัคชั่น

รับรองโดย.....

(นาย สุริยา สมานราษฎร์)

ผู้ควบคุมงาน

ภาคผนวก ข-14

การจัดการขยะมูลฝอยและกากของเสียของโครงการ

หนังสือแจ้งผลการพิจารณาฯ การขออนุญาต
ให้นำส่งปฏิกูลใหม่วัสดุที่ไม่ใช้แล้วออกนอกบริเวณโรงงาน
จากกรมโรงงานอุตสาหกรรม (สก.2)

หนังสือแจ้งผลการพิจารณา
การขออนุญาตให้นำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วออกนอกบริเวณโรงงาน
กรมโรงงานอุตสาหกรรม

เลขที่ 2567-O-7565

หนังสือฉบับนี้ออกให้เพื่อแจ้งผลการพิจารณาของ

บริษัท โกลว์ เอสพีพี 11 จำกัด

ทะเบียนโรงงานเลขที่ 91060004325555

โดยมีรายละเอียดผลการพิจารณาดังนี้

ลำดับที่	รหัสสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	ปริมาณ(ตัน)	รหัสการจัดการ	ผู้รับดำเนินการ	เหตุผล
1	130208	น้ำมันหล่อลื่นที่ไม่ใช้แล้ว	3.333	049	10110005525493	
2	130208	น้ำมันหล่อลื่นที่ไม่ใช้แล้ว	3.333	049	10200100725609	
3	130701	Used Diesel oil น้ำมันดีเซลใช้แล้ว	0.667	042	10110005525493	
4	130701	น้ำมันดีเซลใช้แล้ว	0.667	049	10200100725609	
5	150101	กระดาษ	0.667	011	10210004225564	
6	150101	กระดาษ	0.667	011	20210004125515	
7	150101	Paper and cardboard packaging	3.333	071	72080000125604	
8	150102	Plastic packaging	3.333	071	72080000125604	
9	150110	Empty Contaminated Container ภาชนะบรรจุสารเคมีเปล่า	1.667	049	10110005525493	
10	150110	ถังสารเคมีเปล่า / ถังสารเคมี/ภาชนะปนเปื้อน Empty Contaminated Container	5.000	049	10740004025572	
11	150110	Empty Contaminated Container ภาชนะบรรจุสารเคมีเปล่า	1.247	049	72080000125455	
12	150202	Contaminated Waste	3.070	042	72080000125455	
13	150203	Air Filter	3.333	074	72020000125477	
14	150203	Air Filter	1.717	071	72080000125604	
15	160213	Electronics Waste อุปกรณ์อิเล็กทรอนิกส์	3.333	049	72080000125455	
16	160215	Fluorescent lamp หลอดไฟฟ้าใช้แล้ว	0.317	049	72080000125455	
17	160216	ทองแดง	0.667	011	10210004225564	
18	160216	ทองแดง	0.667	011	20210004125515	
19	160601	แบตเตอรี่เก่าชนิดตะกั่ว	1.667	021	10110005525493	
20	160601	แบตเตอรี่เก่าชนิดตะกั่ว	0.667	049	10110100825152	
21	161001	Contaminated Wastewater/น้ำปนตัวทำละลาย	40.000	075	72020000125477	
22	161001	Off line compressor washing	37.017	042	72080000125455	
23	170201	เศษไม้	0.667	011	10210004225564	
24	170201	เศษไม้	0.667	011	20210004125515	
25	170203	พลาสติก	0.667	011	10210004225564	
26	170203	พลาสติก	0.667	011	20210004125515	
27	170203	Fill pack	6.667	071	72080000125604	
28	170401	ทองเหลือง	0.667	011	10210004225564	

29	170401	ทองเหลือง	0.667	011	20210004125515	
30	170402	อลูมิเนียม	0.667	011	10210004225564	
31	170402	อลูมิเนียม	0.667	011	20210004125515	
32	170405	เศษเหล็ก / สแตนเลส	4.000	011	10210004225564	
33	170405	เศษเหล็ก / สแตนเลส	1.667	011	20210004125515	
34	170604	Insulation ฉนวนกันความร้อน	6.667	071	72080000125604	
35	170904	Conceate Waste	66.667	071	72080000125604	
36	190901	Sand filtration from raw water/ทรายกรองน้ำดี	16.667	071	72080000125604	
37	190902	Waste water Sludge	14.673	044	72080000125455	
38	190902	Wastewater Sludge	36.573	071	72080000125604	
39	190905	Used resin	13.333	071	72080000125604	
40	191204	แผ่นยาง ท่อยาง	0.667	011	10210004225564	
41	191204	แผ่นยาง ท่อยาง	0.667	011	20210004125515	
42	150110	ถังน้ำมันเปล่าใช้แล้ว	5.000	039	10740004025572	
43	190901	Sand filtration from raw water	50.000	042	72080000125455	
44	190905	Resin Waste	40.000	042	72080000125455	
45	190902	Slurry Sludge	100.000	042	72080000125455	
46	100122	Sulfur Waste	3.000	045	72080000125455	
47	170405	เศษเหล็ก	20.000	011	10210001025587	
48	170604	Insulation ฉนวนกันความร้อน	20.000	074	72020000125477	

รายการที่ได้รับอนุญาตมีผลบังคับใช้ตั้งแต่วันที่ 1 มกราคม 2567 ถึงวันที่ 31 ธันวาคม 2567

ออกให้ ณ วันที่ 1 มกราคม 2567
โดยกรมโรงงานอุตสาหกรรม

หนังสือแจ้งผลการพิจารณาฉบับนี้อนุญาตโดยใช้ระบบอิเล็กทรอนิกส์

ปริมาณกากของเสียอุตสาหกรรมและขยะทั่วไป
ระหว่างเดือนมกราคม-มิถุนายน พ.ศ. 2567

รายละเอียดเกี่ยวกับสิ่งปฏิกูล หรือ วัสดุที่ไม่ใช้แล้ว และวิธีการกำจัด ประจำปี 2567

GSPP11_P2

ลำดับที่ Item	รหัส Waste code	ชื่อและคำบรรยาย Type of waste	วิธีการกำจัด Disposal code	ผู้ขนส่ง/จัดการ Disposed by	ม.ค.	ก.พ.	มี.ค.	เม.ย.	พ.ค.	มิ.ย.	ก.ค.	ส.ค.	ก.ย.	ต.ค.	พ.ย.	ธ.ค.	รวม (ตัน)	ปริมาณที่ได้รับการอนุญาต (ตัน)	ปริมาณคงเหลือ (ตัน) Remain Volume
ขยะอันตราย (Hazardous waste)																			
Disposal Method (Domestic waste, Reuse, Recycle, Recovery, Landfill, Other Disposal)																			
1) Reuse																			
1																			
2) Recycle																			
1	130208	Used Lube Oil	049	บ.ยูนิ รีไซเคิล กรีน จำกัด/บริษัท อีสต์ ออย จำกัด	0.00	0.00	0.00	0.00	0.00	0.00							0	3	3
2	130701	Used Diesel oil	049	บ.ยูนิ รีไซเคิล กรีน จำกัด/บริษัท อีสต์ ออย จำกัด	0.00	0.00	0.00	0.00	0.00	0.00							0	3	3
4	150110	Empty Contaminated Container	049	บ.ยูนิ รีไซเคิล กรีน จำกัด/บริษัท อีสต์ ออย จำกัด	0.00	0.172	0.00	0.00	0.00	0.00							0.17	1	0.83
5	150110	Empty Contaminated Container	049	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด3-106-40/57กท/บริษัท เวสท์ แมเนจเม้นท์ สยาม	0.00	0.00	0.00	0.00	0.40	0.00							0.40	10	9.60
6	150110	Empty Contaminated Container	049	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด3-106-40/57กท/บริษัท [illegible]	0.00	0.00	0.00	0.00	0.00	0.00							0.00	5	5.00
7	160215	Fluorescent lamp	049	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด(น.105-1/2545-ฉชฯ)/บริษัท เวสท์ แมเนจเม้นท์	0.00	0.00	0.00	0.00	0.045	0.00							0.045	1	0.96
8	160213	Electonic waste	049	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด(น.105-1/2545-ฉชฯ)/บริษัท เวสท์ แมเนจเม้นท์	0.00	0.00	0.00	0.00	0.00	0.00							0.000	3	3.00
																	0.000		
				Total	0.00	0.17	0.00	0.00	0.45	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.62	26.00	25.38
3) Recovery																			
1	150202	Contaminated waste	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์(น.105-1/2545-ฉชฯ)	0.00	0.085	0.00	0.28	0.00	0.255							0.62	3	2.38
3	161001	Off line compressor washing	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์(น.105-1/2545-ฉชฯ)	0.00	11.37	0.00	11.82	0.00	0.00							23.19	120	96.81
4	161001	Contaminated Waste water	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด/บริษัท เวสท์ แมเนจเม้นท์ สยาม จำกัด	0.00	0.00	0.00	0.00	0.00	0.00							0.00	0	0
				Total	0.00	11.46	0.00	12.10	0.00	0.26	0.00	0.00	0.00	0.00	0.00	0.00	23.81	123	99.19
4) Landfill * (Zero Landfill only)																			
1																			
				Total	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5) Composting																			
1																			
				Total	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
6) Incineration (mass burn)																			
1	161001	Contaminated Waste water	075	บริษัท บางปู เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด/บริษัท เวสท์ แมเนจเม้นท์ สยาม จำกัด	0.00	0.00	0.00	0.00	0.00	0.00							0.00	40	40
				Total	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	40.00	40.00
7) Deep Well																			
1																		0		
8) Other																			
ขยะไม่อันตราย (Non Hazardous)																			
Disposal Method (Domestic waste, Reuse, Recycling, Recovery, Landfill, Other Disposal)																			
Domestic waste																			
1	190902	Domestic waste	071	บริษัท ทรานส์เอ็นไวรอนเมนทอลเทคโนโลยี จำกัด	0.214	0.180	0.089	0.059	0.060	0.145							0.75		-0.745
Reuse																			
1																	0		
Recycle																			
1	170405	เศษเหล็ก	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	10	10
2	170405	สแตนเลส	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
3	160216	ทองแดง	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
4	170401	ทองเหลือง	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
5	170402	อลูมิเนียม	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
6	170203	พลาสติก	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
7	191204	แผ่นยาง ท่อยาง	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
8	170201	เศษไม้	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
9	150101	เศษกระดาษ	011	(3-105-42/5638) บริษัท 3K Recycle	0.00	0.00	0.00	0.00	0.00	0.00							0	2	2
10	170405	เศษเหล็ก	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
11	170405	สแตนเลส	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
12	160216	ทองแดง	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
13	170401	ทองเหลือง	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
14	170402	อลูมิเนียม	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
15	170203	พลาสติก	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
16	191204	แผ่นยาง ท่อยาง	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
17	170201	เศษไม้	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
18	150101	เศษกระดาษ	011	ส.โชคชัย รวมเศษ (93-105-41/5138)	0.00	0.00	0.00	0.00	0.00	0.00									
19	170405	เศษเหล็ก	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
20	170405	สแตนเลส	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
21	160216	ทองแดง	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
22	170401	ทองเหลือง	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
23	170402	อลูมิเนียม	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
24	170203	พลาสติก	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
25	191204	แผ่นยาง ท่อยาง	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
26	170201	เศษไม้	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
27	150101	เศษกระดาษ	011	บ.มาบตาพุดรวมเศษ จำกัด (93-64(12)-1/4338)	0.00	0.00	0.00	0.00	0.00	0.00									
28	190902	Wastewater treatment sludge	044	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด (น.105-1/2545-ฉชฯ)	0.00	4.455	0.00	2.20	0.00	3.61							10.27	50	39.74
				Total	0.00	4.46	0.00	2.20	0.00	3.61	0.00	0.00	0.00	0.00	0.00	0.00	10.27	76.00	65.74
Recovery																			
1	170203	Fill pack	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด (น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	0.00	0.00	0.00							0.00	20	20.00
2	190902	Slurry Sludge	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด (น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	0.00	0.00	0.00							0	0	0.00
3	190901	Activated carbon	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด (น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	0.00	0.00	0.00							0	0	0.00
4	190901	Sand Filtration From raw Water	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด(น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	0.00	0.00	0.00							0	50	50.00
5	190905	Used Resin	042	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด(น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	0.00	0.00	0.00							0	40	40.00
6	100122	Sulfur Waste	045	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด(น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	0.00	0.00	0.00							0	3	3.00
				Total	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	110.00	110.00
Landfill																			
				Total	0.00	0.00	0.00	0.00	0.00	0.00							0.00	0	0.00
Composting																			
1																	0		0
Incineration																			
1	150203	Air filter	074	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด (น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	4.32	0.00	0.00							4.32	10	5.68
2	170604	Insulation	074	บ.อีสเทิร์นซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด(น.105-1/2560-ฉชฯ)	0.00	0.00	0.00	0.00	0.00	0.00							0	20	20.00
				Total	0.00	0.00	0.00	4.32	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.32	10.00	5.68
Deep Well Injection																			
1																	0		0
Other																			
1	N/A	Infection waste	-	ห้างหุ้นส่วนจำกัด มิตรไบโอเทค เฮลท์แคร์	0	0	0	0	0	0	0	0	0	0	0	0	0	No permit from DIW	
				Total															

ตัวอย่างใบกำกับการขนส่งของเสีย

แบบ กอ.๒

เลขที่อ้างอิง 1-20-0267-051227-0-N

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555

สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :

ชื่อผู้ขับขี่ : นายสุรินทร์ จันทร์ทอง เลขทะเบียนพาหนะ : 98-1323 กท พาหนะที่ใช้ : รถบรรทุก

โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Contaminated Waste	150202	1.5 คิว	1	1.5

รวมปริมาณทั้งหมด : ของเหลว 0 ตัน ของแข็ง 1.5 ตัน ของแข็งกึ่งเหลว 0 ตัน

[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 12/2/24

ปริมาณที่ส่งมอบ : 1.5 ตัน

วันที่ส่งมอบ : 12/02/2567

เวลาที่ส่งมอบ : 16.00 น

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ขับขี่ : นายสุรินทร์ จันทร์ทอง ลายมือชื่อ : [signature] วันที่ : 12/2/24

[ ] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๓ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature]

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี

ใช้ระยะเวลา : 1 วัน

วันที่มาถึง : 13/2/24

เวลาที่มาถึง : 05:00

ส่วนที่ ๓/๒

คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 13/2/24

ปริมาณที่รับมอบ : 0.025 ตัน

[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ

วันที่รับมอบ : 13/2/24 เวลาที่มอบ : 06:42

[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ

[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 14/2/24

ปริมาณที่จัดการแล้วเสร็จ : 0.025 ตัน

วันที่จัดการแล้วเสร็จ : 14/2/24 เวลาที่จัดการแล้วเสร็จ : 16:17

ปริมาณคงเหลือ : 0 ตัน

[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น

[/] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)

[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)

[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)

ลงชื่อผู้ก่อกำเนิด : นายเอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 20/2/67

Glow Spp 11 Co,.Ltd. February 12 ,2024

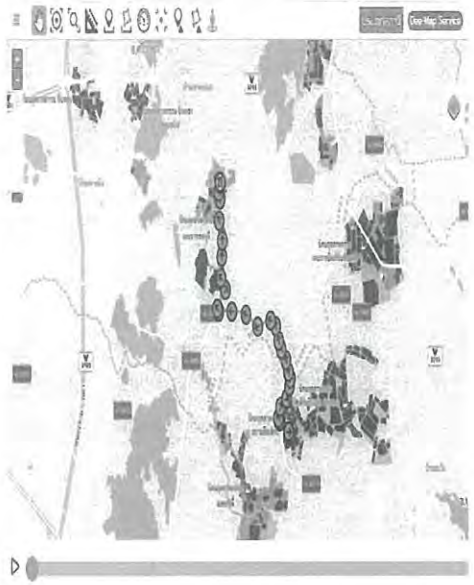

แบบ กอ.๒

เลขที่อ้างอิง 3-20-0267-051361-0-N

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555

สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :

ชื่อผู้ขับขี่ : นายสุรินทร์ จันทร์ทอง เลขทะเบียนพาหนะ : 98-1323 กท พาหนะที่ใช้ : รถบรรทุก

โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Waste water Sludge	190902	1.5 คิว	5	8.0

รวมปริมาณทั้งหมด : ของเหลว 0 ตัน ของแข็ง 8 ตัน ของแข็งกึ่งเหลว 0 ตัน

[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 12/2/24

ปริมาณที่ส่งมอบ : 8 ตัน

วันที่ส่งมอบ : 12/02/2567

เวลาที่ส่งมอบ : 16.00 น.

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ขับขี่ : นายสุรินทร์ จันทร์ทอง ลายมือชื่อ : สุรินทร์ วันที่ : 12/2/24

[ ] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๑ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑

คำรับรอง : ข้าพเจ้าขอรับรองว่ารับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature]

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี

ใช้ระยะเวลา : 2 วัน

วันที่มาถึง : 13/2/24

เวลาที่มาถึง : 09.00

ส่วนที่ ๓/๒

คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 13/2/24

ปริมาณที่รับมอบ : 4.455 ตัน

[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ

วันที่รับมอบ : 13/2/24 เวลาที่มอบ : 05:00

[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ

[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 14/2/24

ปริมาณที่จัดการแล้วเสร็จ : 4.455 ตัน

วันที่จัดการแล้วเสร็จ : 14/2/24 เวลาที่จัดการแล้วเสร็จ : 16:17

ปริมาณคงเหลือ : 0 ตัน

[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น

[/] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)

[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)

[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)

ลงชื่อผู้ก่อกำเนิด : นายเอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 20/2/67

Glow Spp 11 Co,.Ltd. February 12,2024

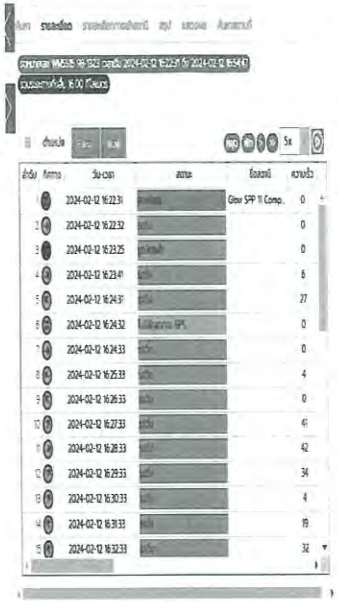

แบบ กอ.๒

เลขที่อ้างอิง 1-20-0267-144419-0-N

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555

สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :

ชื่อผู้ขับขี่ : นาย อนุชิต ทองบุราณ เลขทะเบียนพาหนะ : 99-9485 กท พาหนะที่ใช้ : รถแทงค์

โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Off line compressor washing	161001	แทงค์	-1	10.0

รวมปริมาณทั้งหมด : ของเหลว 10 ตัน ของแข็ง 0 ตัน ของแข็งกึ่งเหลว 0 ตัน

[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ก่อกำเนิด : กมลทิพย์ คงสนิท ลายมือชื่อ [signature] วันที่ : 29/2/24

ปริมาณที่ส่งมอบ : 10 ตัน

วันที่ส่งมอบ : 29/02/2567

เวลาที่ส่งมอบ : 18.00 น.

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ขับขี่ : นาย อนุชิต ทองบุราณ ลายมือชื่อ : อนุชิต ทองบุราณ วันที่ : 29/2/67

[/] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๑ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature]

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี

ใช้ระยะเวลา : 1 วัน

วันที่มาถึง : 29/2/24 เวลาที่มาถึง : 18:30

ส่วนที่ ๓/๒

คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 29/2/24

ปริมาณที่รับมอบ : 11.37 ตัน

[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ

วันที่รับมอบ : 29/2/24 เวลาที่มอบ : 18:30

[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ

[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 01/03/24

ปริมาณที่จัดการแล้วเสร็จ : 11.37 ตัน

วันที่จัดการแล้วเสร็จ : 01/03/24 เวลาที่จัดการแล้วเสร็จ : 06:48

ปริมาณคงเหลือ : 0 ตัน

[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)

[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)

[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)

ลงชื่อผู้ก่อกำเนิด : [signature] ลายมือชื่อ : [signature] วันที่ : 8/5/24

Glow Spp 11 Co,.Ltd. February 29 ,2024

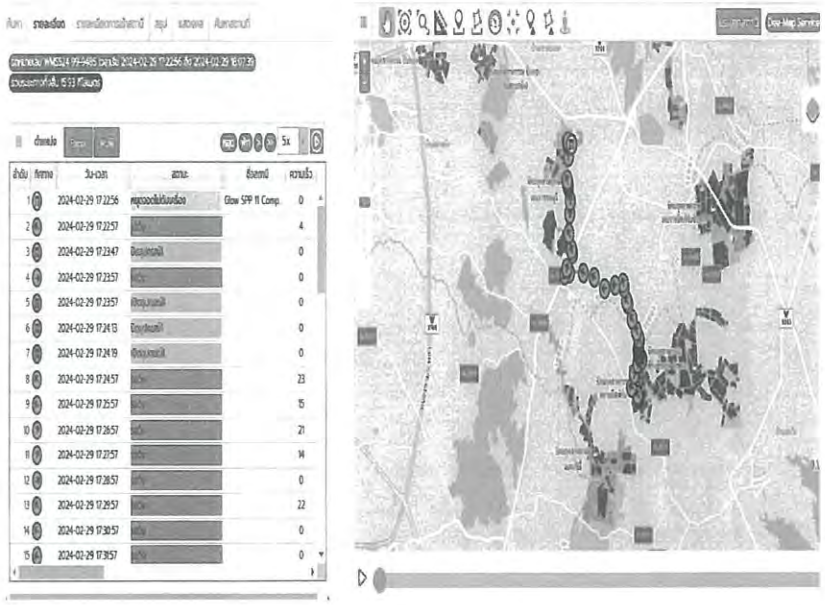

แบบ กอ.๒

เลขที่อ้างอิง 1-20-0467-026377-0-N

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555
สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140
เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :
ชื่อผู้ขับขี่ : นายกิตติ ศรีสุวรรณ เลขทะเบียนพาหนะ : 51-0713 กท พาหนะที่ใช้ : รถบรรทุก
โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455
สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230
เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Contaminated Waste	150202	box 1.5 คิว	2	1.0

รวมปริมาณทั้งหมด : ของเหลว 0 ตัน ของแข็ง 1 ตัน ของแข็งกึ่งเหลว 0 ตัน
[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ
ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 5/4/24

ปริมาณที่ส่งมอบ : 1 ตัน
วันที่ส่งมอบ : 05/04/2567
เวลาที่ส่งมอบ : 15.50 น.

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ
ลงชื่อผู้ขับขี่ : นายกิตติ ศรีสุวรรณ ลายมือชื่อ : [signature] วันที่ : 5-4-67

[ ] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๓ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑
คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ
ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature]

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี
ใช้ระยะเวลา : 1 วัน
วันที่มาถึง : 6/4/24
เวลาที่มาถึง : 05:00

ส่วนที่ ๓/๒
คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม
ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 6/4/24

ปริมาณที่รับมอบ : 0.28 ตัน
[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ
วันที่รับมอบ : 6/4/24 เวลาที่มอบ : 9:00 น.
[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ
[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓
คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต
ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 6/4/24

ปริมาณที่จัดการแล้วเสร็จ : 0.28 ตัน
วันที่จัดการแล้วเสร็จ : 6/4/24 เวลาที่จัดการแล้วเสร็จ : 10:30 น.
ปริมาณคงเหลือ : 0 ตัน
[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น
[/] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)
[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)
[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)
[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)
ลงชื่อผู้ก่อกำเนิด : นายเอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 20/4/24

Glow Spp 11 Co,.Ltd. April 5 ,2024

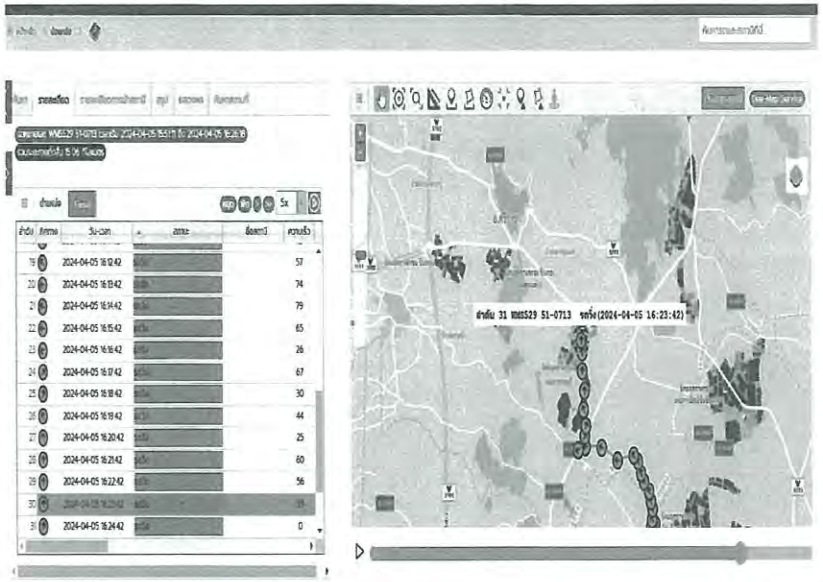

เลขที่อ้างอิง 3-20-0467-026422-0-N

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555
สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140
เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :
ชื่อผู้ขับขี่ : นายกิตติ ศรีสุวรรณ เลขทะเบียนพาหนะ : 51-0713 กท พาหนะที่ใช้ : รถบรรทุก
โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455
สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230
เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Waste water Sludge	190902	box 1.5 คิว	2	2.4

รวมปริมาณทั้งหมด : ของเหลว 0 ตัน ของแข็ง 2.4 ตัน ของแข็งกึ่งเหลว 0 ตัน
[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ
ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 5/4/24

ปริมาณที่ส่งมอบ : 2.4 ตัน
วันที่ส่งมอบ : 05/04/2567
เวลาที่ส่งมอบ : 15.50 น.

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ
ลงชื่อผู้ขับขี่ : นายกิตติ ศรีสุวรรณ ลายมือชื่อ : [signature] วันที่ : 5-4-67
[ ] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๑ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑
คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ
ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature]
ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี
ใช้ระยะเวลา : 1 วัน
วันที่มาถึง : 6/4/24
เวลาที่มาถึง : 05:00

ส่วนที่ ๓/๒
คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม
ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 6/4/24
ปริมาณที่รับมอบ : 2.2 ตัน
[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ
วันที่รับมอบ : 6/4/24 เวลาที่มอบ : 08:00 น.
[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ
[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓
คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต
ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 6/4/24
ปริมาณที่จัดการแล้วเสร็จ : 2.2 ตัน
วันที่จัดการแล้วเสร็จ : 6/4/24 เวลาที่จัดการแล้วเสร็จ : 8:30 น.
ปริมาณคงเหลือ : 0 ตัน
[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น
[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)
[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)
[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)
[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)
ลงชื่อผู้ก่อกำเนิด : นายเอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 8/5/24

Glow Spp 11 Co,.Ltd. April 5 ,2024

เลขที่อ้างอิง 3-11-0467-060163-0-N

แบบ กอ.๒

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้กอกำเนิด

ชื่อผู้กอกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555

สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :

ชื่อผู้ขับขี่ : ชัยยา มิ่งพา เลขทะเบียนพาหนะ : 64-3492 กท พาหนะที่ใช้ : รถพ่วง

โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : สมุทรปราการ ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท บางปู เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72020000125477

สถานที่ตั้ง : 965 หมู่ที่ 2 ถนนสุขุมวิท ตำบลบางปูใหม่ อำเภอเมืองสมุทรปราการ จังหวัดสมุทรปราการ 10280

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Air Filter	150203	Roll off Box 22 คิว	2	20.0

รวมปริมาณทั้งหมด : ของเหลว 0 ตัน ของแข็ง 20 ตัน ของแข็งกึ่งเหลว 0 ตัน

[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้กอกำเนิด : กมลทิพย์ คงสนิท ลายมือชื่อ Kamlatip K. วันที่ : 12/04/67

ปริมาณที่ส่งมอบ : 20 ตัน

วันที่ส่งมอบ : 12/04/2567

เวลาที่ส่งมอบ : 18.20 น.

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ขับขี่ : ชัยยา มิ่งพา ลายมือชื่อ : ชัยยา มิ่งพา วันที่ : 12-4-24

[/] ผู้กอกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๑ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท บางปู เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72020000125477

ส่วนที่ ๓/๑

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ

ลงชื่อผู้รับดำเนินการ : ลายมือชื่อ :

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : สมุทรปราการ

ใช้ระยะเวลา : 1 วัน

วันที่มาถึง : 12/4/24

เวลาที่มาถึง : 18.00

ส่วนที่ ๓/๒

คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม

ลงชื่อผู้รับดำเนินการ : ลายมือชื่อ : วันที่ : 12/4/24

ปริมาณที่รับมอบ : 4.32 ตัน

[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ

วันที่รับมอบ : 12/4/24 เวลาที่มอบ : 18.00

[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ

[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต

ลงชื่อผู้รับดำเนินการ : ลายมือชื่อ : วันที่ : 12/4/24

ปริมาณที่จัดการแล้วเสร็จ : 4.32 ตัน

วันที่จัดการแล้วเสร็จ : 12/4/24 เวลาที่จัดการแล้วเสร็จ : 18.20

ปริมาณคงเหลือ : 0 ตัน

[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้กอกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)

[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)

[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)

ลงชื่อผู้กอกำเนิด : Kamlatip K. ลายมือชื่อ : Kamlatip K. วันที่ : 8/5/67

Glow Spp 11 Co,.Ltd. April 12 ,2024

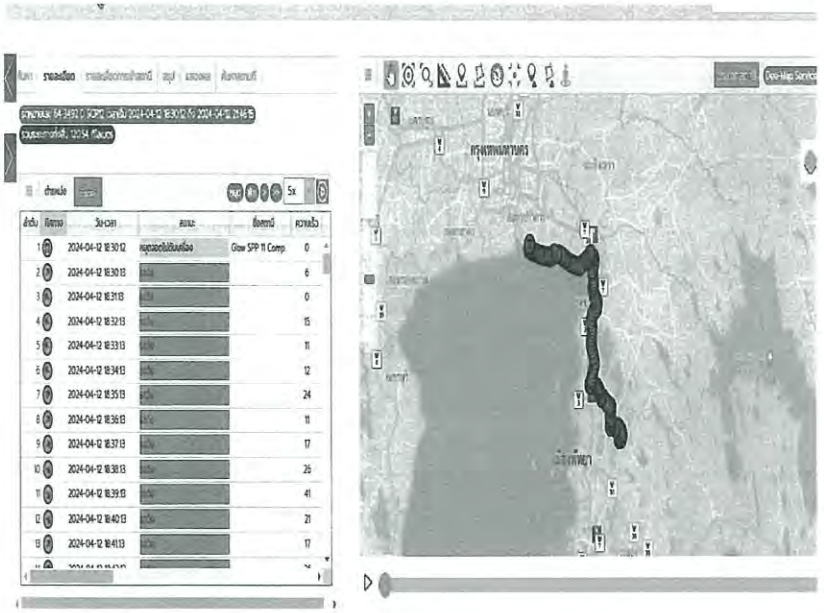

เลขที่อ้างอิง 1-20-0467-084716-0-N

แบบ กอ.๒

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555
สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140
เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :
ชื่อผู้ขับขี่ : อนุชิต ทองบุราณ เลขทะเบียนพาหนะ : 99-9485 กท พาหนะที่ใช้ : รถแทงค์
โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455
สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230
เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Off line compressor washing	161001	Tanker truck	1	9.0

รวมปริมาณทั้งหมด : ของเหลว 9 ตัน ของแข็ง 0 ตัน ของแข็งกึ่งเหลว 0 ตัน
[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ
ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 22/4/24

ปริมาณที่ส่งมอบ : 9 ตัน
วันที่ส่งมอบ : 22/04/2567
เวลาที่ส่งมอบ : 15.00 น.

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ
ลงชื่อผู้ขับขี่ : อนุชิต ทองบุราณ ลายมือชื่อ : อนุชิต ทองบุราณ วันที่ : 22/4/67

[ ] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๑ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑
คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ
ลงชื่อผู้รับดำเนินการ : เอกสิทธิ์ ลายมือชื่อ : เอกสิทธิ์

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี
ใช้ระยะเวลา : 1 วัน
วันที่มาถึง : 22/4/24
เวลาที่มาถึง : 10.40

ส่วนที่ ๓/๒
คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม
ลงชื่อผู้รับดำเนินการ : รานา ลายมือชื่อ : รานา วันที่ : 22/4/24

ปริมาณที่รับมอบ : 11.82 ตัน
[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ
วันที่รับมอบ : 22/4/24 เวลาที่มอบ : 15:41 น.
[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ
[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓
คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต
ลงชื่อผู้รับดำเนินการ : รานา ลายมือชื่อ : รานา วันที่ : 23/4/24

ปริมาณที่จัดการแล้วเสร็จ : 11.82 ตัน
วันที่จัดการแล้วเสร็จ : 23/4/24 เวลาที่จัดการแล้วเสร็จ : 06:44 น.
ปริมาณคงเหลือ : ตัน
[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น
[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)
[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)
[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)
[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)
ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 23/5/24

Glow Spp 11 Co,.Ltd. April 22 ,2024

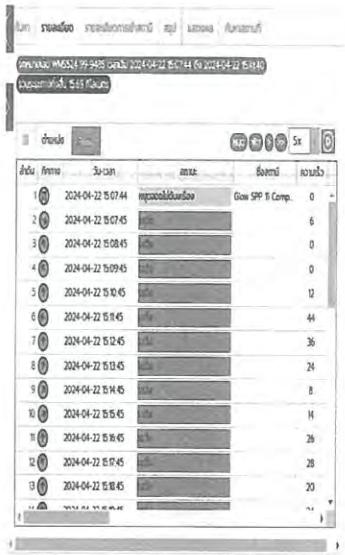

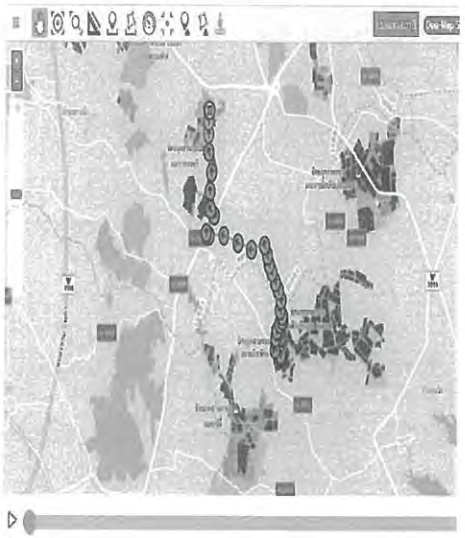

แบบ กอ.๒

เลขที่อ้างอิง 1-20-0567-105569-0-N

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555

สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :

ชื่อผู้ขับขี่ : สุรินทร์ จันทร์ทอง เลขทะเบียนพาหนะ : 98-1323 กท พาหนะที่ใช้ : รถพ่วง

โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Empty Contaminated Container ภาชนะบรรจุสารเคมีเปล่า	150110	ถัง	2	1.0

รวมปริมาณทั้งหมด : ของเหลว 0 ตัน ของแข็ง 1 ตัน ของแข็งกึ่งเหลว 0 ตัน

[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 24/5/67

ปริมาณที่ส่งมอบ : 1 ตัน

วันที่ส่งมอบ : 24/05/2567

เวลาที่ส่งมอบ : 14.40

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ขับขี่ : สุรินทร์ จันทร์ทอง ลายมือชื่อ : [signature] วันที่ : 20/5/24

[ ] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๑ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature]

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี

ใช้ระยะเวลา : 1 วัน

วันที่มาถึง : 24/5/24

เวลาที่มาถึง : 15:13

ส่วนที่ ๓/๒

คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 24/5/24

ปริมาณที่รับมอบ : 0.4 ตัน

[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ

วันที่รับมอบ : 24/5/24 เวลาที่มอบ : 15:30 น.

[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ

[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต

ลงชื่อผู้รับดำเนินการ : [signature] ลายมือชื่อ : [signature] วันที่ : 30/5/24

ปริมาณที่จัดการแล้วเสร็จ : 0.4 ตัน

วันที่จัดการแล้วเสร็จ : 30/5/24 เวลาที่จัดการแล้วเสร็จ : 10:50 น.

ปริมาณคงเหลือ : 0 ตัน

[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)

[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)

[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)

ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : [signature] วันที่ : 8/6/67

Glow Spp 11 Co,.Ltd. May 24 ,2024

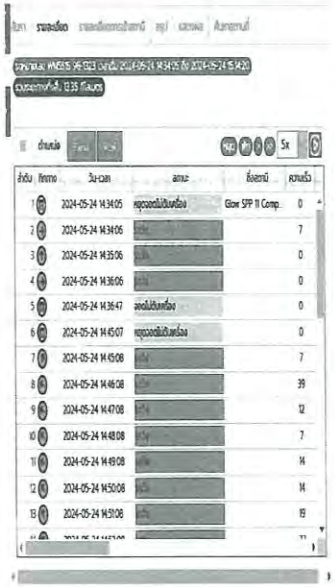

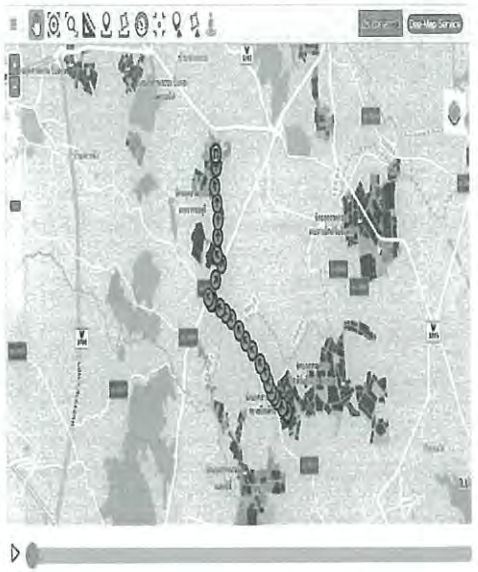

แบบ กอ.๒

เลขที่อ้างอิง 1-20-0567-114917-0-N

เอกสารแสดงการจัดการ (Manifest Form)

ส่วนที่ ๑ ผู้ก่อกำเนิด

ชื่อผู้ก่อกำเนิด : บริษัท โกลว์ เอสพีพี 11 จำกัด เลขทะเบียนโรงงาน : 91060004325555

สถานที่ตั้งโรงงาน : 250 สยามอินดัสเตรียลพาร์ค หมู่ที่ 3 ถนน ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

ผู้ได้รับมอบหมายให้ขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว :

ชื่อผู้ขับขี่ : ศักดิ์สิทธิ์ ดอนหลาบคำ เลขทะเบียนพาหนะ : 3ฒต76 กท พาหนะที่ใช้ : รถบรรทุก

โดยขนส่งจากจังหวัด : ระยอง ไปยังจังหวัด : ชลบุรี ใช้ระยะเวลาประมาณ : 1 วัน

ผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

สถานที่ตั้ง : 88 หมู่ที่ 8 ถนนทางหลวง 331 กิโลเมตร 91-92 ตำบลบ่อวิน อำเภอศรีราชา จังหวัดชลบุรี 20230

เบอร์โทรติดต่อ : เบอร์โทรติดต่อฉุกเฉิน :

รายละเอียดของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ที่ขนส่ง :

ลำดับ	ชื่อสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว	รหัสประเภท หรือชนิด	ภาชนะบรรจุ		ปริมาณ (ตัน)
			ชนิด	จำนวน	
1	Fluorescent lamp หลอดไฟฟ้าใช้แล้ว	160215	แกลลอน	1	0.3

รวมปริมาณทั้งหมด : ของเหลว 0 ตัน ของแข็ง 0.3 ตัน ของแข็งกึ่งเหลว 0 ตัน

[ ] น้ำหนักชั่งจริง [/] น้ำหนักประมาณการ

ข้อควรระวังระหว่างการขนส่ง :

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้ส่งมอบสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : วันที่ : 27/5/24

ปริมาณที่ส่งมอบ : 0.3 ตัน
วันที่ส่งมอบ : 27/05/2567
เวลาที่ส่งมอบ : 14.16

ส่วนที่ ๒ รายละเอียดการขนส่งสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้รับสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม และการขนส่งจะปฏิบัติตามข้อกำหนดของกฎหมายทุกประการ

ลงชื่อผู้ขับขี่ : ศักดิ์สิทธิ์ ดอนหลาบคำ ลายมือชื่อ : วันที่ : 27/5/67

[ ] ผู้ก่อกำเนิดได้แนบภาพถ่ายเอกสารการจัดการที่มีการลงนามในส่วนที่ ๑ และส่วนที่ ๒ ครบถ้วนถูกต้องแล้ว

ส่วนที่ ๓ ผู้รับดำเนินการ

ชื่อผู้รับดำเนินการ : บริษัท อีสเทิร์น ซีบอร์ด เอนไวรอนเมนทอล คอมเพล็กซ์ จำกัด เลขทะเบียนโรงงาน (ถ้ามี) : 72080000125455

ส่วนที่ ๓/๑

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นมาถึงสถานที่รับจัดการ

ลงชื่อผู้รับดำเนินการ : ลายมือชื่อ :

ขนส่งจากจังหวัด : ระยอง มายังจังหวัด : ชลบุรี
ใช้ระยะเวลา : 1 วัน
วันที่มาถึง : 27/5/24
เวลาที่มาถึง : 14:38

ส่วนที่ ๓/๒

คำรับรอง : ข้าพเจ้าขอรับรองว่ารับจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น ซึ่งมีการบรรจุ ติดป้าย หรือฉลากอย่างเหมาะสม

ลงชื่อผู้รับดำเนินการ : ลายมือชื่อ : วันที่ : 27/5/24

ปริมาณที่รับมอบ : 0.045 ตัน
[/] น้ำหนักชั่งจริง [ ] น้ำหนักประมาณการ
วันที่รับมอบ : 27/5/24 เวลาที่มอบ : 14.38 น.
[/] ภาพถ่ายสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และ/หรือ
[ ] เอกสารแสดงลักษณะสำคัญของสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว

ส่วนที่ ๓/๓

คำรับรอง : ข้าพเจ้าขอรับรองว่าได้จัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามที่ระบุข้างต้นแล้วเสร็จตามที่ได้รับอนุญาต

ลงชื่อผู้รับดำเนินการ : ลายมือชื่อ : วันที่ : 29/5/24

ปริมาณที่จัดการแล้วเสร็จ : 0.045 ตัน
วันที่จัดการแล้วเสร็จ : 29/5/24 เวลาที่จัดการแล้วเสร็จ : 15:14น.
ปริมาณคงเหลือ : 0 ตัน
[/] ภาพถ่ายเอกสารการจัดการที่ลงนามครบถ้วนถูกต้อง

ส่วนที่ ๔ ผู้ก่อกำเนิดสรุปผลการจัดการ

คำรับรอง : ข้าพเจ้าขอรับรองว่าสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วตามที่ระบุข้างต้น

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๓)

[ ] ได้รับการจัดการแล้วเสร็จตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๕)

[ ] ได้รับคืนจากผู้รับดำเนินการแล้ว (ส่วนที่ ๖)

[ ] ได้รับการจัดการแล้วเสร็จโดยผู้รับจัดการรายใหม่ตามที่ได้รับอนุญาตแล้ว (ส่วนที่ ๗)

ลงชื่อผู้ก่อกำเนิด : เอกชัย วิมูล ลายมือชื่อ : วันที่ : 8/6/67

Glow Spp 11 Co,.Ltd. May 27 ,2024

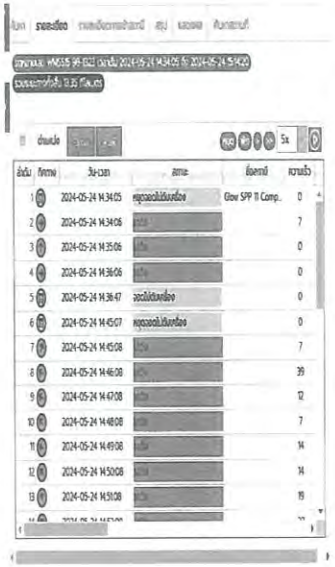

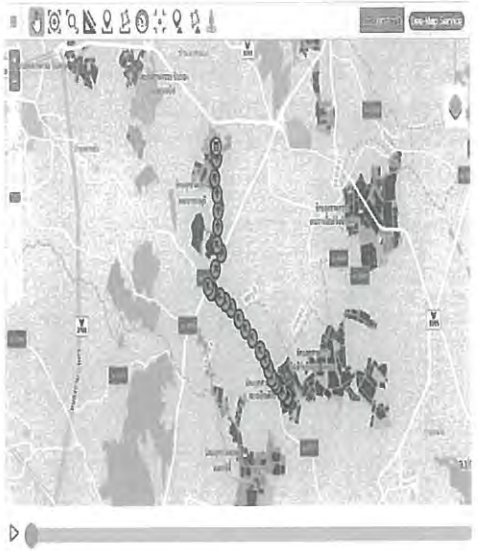

ภาคผนวก ข-15

การตรวจสอบสภาพรางระบายน้ำ/ท่อระบายน้ำ

บันทึกการตรวจด้านความปลอดภัยและสภาพแวดล้อมของพนักงานรักษาความปลอดภัย

GPSC

บริษัท : โกลว์เอสพีพี 11 จำกัด (โรงงาน 2)

เดือน มกราคม. ปี 2024

No	รายการตรวจงานด้านความปลอดภัยและสภาพแวดล้อม	Total	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
A	**รายละเอียดการตรวจบุคคล**																																
1	การไม่สวมใส่ PPE เข้าบริเวณ Restricted Area ทั้งพนักงาน และบุคคลภายนอก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2	การขับรถเร็วเกินกว่าที่กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
3	การสูบบุหรี่ในที่ที่ไม่ได้กำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
4	การกินอาหารในบริเวณที่ไม่ได้กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
5	การทะเลาะวิวาทหรือใช้วาจาไม่สุภาพ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
6	การเล่นการพนัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
7	การเสพหรือนำยาเสพติดเข้ามาในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
8	การลักขโมย ทรัพย์สินทั้งส่วนบุคคลและของผู้ว่าจ้าง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
9	การจอดรถกีดขวางอุปกรณ์ดับเพลิง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	การจอดรถบนลานหินกรวด โดยไม่ได้รับอนุญาต	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
11	การจอดรถในที่ห้ามจอด หรือขับรถฝ่าฝืนเครื่องกั้นจราจร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
12	การดื่มสุราภายในโรงไฟฟ้าหรือพบปริมาณแอลกอฮอล์ในบุคคล ก่อนเข้าพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
13	การลวนลามหรือคุกคามทางเพศต่อสุภาพสตรี ทั้งทางกายและวาจา	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
14	การประท้วง หรือบุกรุกพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
15	การวางระเบิด การพกอาวุธ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
16	การจอดรถบนฝาปิดสายส่งไฟฟ้าใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
17	พบก้นบุหรี่ ขวดสุรา ขวดเบียร์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
18	พบเศษสายไฟ เศษชิ้นทองแดงซึ่งมีสภาพโดนตัด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
19	พบท่อส่งผลิตภัณฑ์นอกโรงไฟฟ้า ชำรุด ชิ้นส่วนถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
20	พบโครงสร้างสายส่งไฟฟ้าแรงสูงชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
21	พบทรัพย์สินของผู้ว่าจ้างนอกโรงไฟฟ้าชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
22	วัสดุต้องสงสัยวางทิ้งไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
23	พบบุคคลต้องห้าม ฝ่าฝืนเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
24	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
B	**การตรวจสภาพสิ่งผิดปกติหรือสภาพความไม่ปลอดภัย**																																
1	พบควันไฟหรือไฟไหม้ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2	พบสารเคมีรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
3	พบน้ำมันรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
4	พบการล้นของน้ำในขบวนการผลิตของบริษัทฯ ไหลลงรางระบายน้ำ	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
5	พบปรากฏการณ์ผิดปกติทางไฟฟ้า เช่น ฟ้าผ่า , เสียงโคโรนา , อาร์คแฟลช	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
6	พบเหตุการณ์เครื่องจักร อุปกรณ์ โครงสร้าง หรืออาคารชำรุดเสียหาย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
7	ได้รับกลิ่นก๊าซหรือสารเคมีรั่วไหล จากนอกพื้นที่โรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
8	ได้รับกลิ่นผิดปกติซึ่งเกิดภายในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
9	พบเหตุการณ์ไฟไหม้บริเวณนอกโรงไฟฟ้าหรือใกล้เคียง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	พบการจัดเก็บเศษวัสดุหรือเศษขยะไม่เป็นระเบียบเรียบร้อยภายในบริเวณพื้นที่รับผิดชอบและตรวจสอบการรั่วไหลของของเสียบริเวณอาคารหรือสถานที่เก็บของเสีย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
11	พบเห็นพงหญ้ารกบริเวณแนวใต้สายส่ง,ใต้แนวสายพานถ่านหิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
12	พบเห็นสัตว์เลื้อยคลานมีพิษภายในบริเวณพื้นที่รับผิดชอบ	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-
13	พบเห็นสัตว์ต่างๆเข้ามาในบริเวณพื้นที่รับผิดชอบ	1	-	-	1	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-
14	พบผู้ทำงานบนนั่งร้าน ที่สูง ไม่สวมใส่อุปกรณ์กันตก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
15	พบการละเลยไม่มีการปิดกั้นพื้นที่ ขณะทำงาน เครน , งานนั่งร้าน , งานขุด และงานขนถ่ายสารเคมี	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
16	พบการทำงานที่ก่อให้เกิดประกายไฟใกล้วัสดุไวไฟ โดยไม่มีถังดับเพลิงหรือฉากป้องกัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
17	พบเห็นการเกิดอุบัติภัยหรืออุบัติเหตุ ใน ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
18	พบผู้รับเหมาไม่ใช้กะบังหน้าขณะทำงานตัด เชื่อม หรือเจียร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
19	พบเห็นควันสีดำผิดปกติออกจากปล่องเครื่องจักรของบริษัทโกลว์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
20	พบเห็นคราบน้ำมันในรางหรือคลองระบายน้ำทิ้ง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
21	พบฝุ่นถ่านหิน ฝุ่นหินปูน หรือฝุ่นขี้เถ้า ฟุ้งกระจายในอากาศอย่างผิดปกติ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
22	พบงานเครนใต้สายส่งไฟฟ้าแรงสูง หรืองานขุดใกล้แนวสายส่งใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
23	ถุงแสดงทิศทางลมขาดชำรุด ป้ายเตือนความปลอดภัยชำรุด เครื่องหมายจราจรชำรุด	0	-	-	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
24	พบรถบรรทุกสารเคมี รถบรรทุกท่อก๊าซแรงดันสูงบรรทุกในสภาพไม่ปลอดภัย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
25	พบรถบรรทุกขี้เถ้า รถบรรทุกไม้ชีวมวลทำของตกหล่นตามพื้นถนน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
26	สัญญาณฉุกเฉินทำงาน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
27	เหตุการณ์ภัยธรรมชาติ อาทิ พายุฝนฟ้าคะนอง ลมแรง น้ำท่วม	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
28	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	1	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
29	สภาพความสะอาด ชำรุด ของรางระบายน้ำรอบโรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

บันทึกการตรวจด้านความปลอดภัยและสภาพแวดล้อมของพนักงานรักษาความปลอดภัย

GPSC

บริษัท : โกลว์เอสพีพี 11 จำกัด (โรงงาน 2)

เดือน กุมภาพันธ์. ปี 2024

No	รายการตรวจงานด้านความปลอดภัยและสภาพแวดล้อม	Total	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29		
A	**รายละเอียดการตรวจบุคคล**																																
1	การไม่สวมใส่ PPE เข้าบริเวณ Restricted Area ทั้งพนักงาน และบุคคลภายนอก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
2	การขับรถเร็วเกินกว่าที่กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
3	การสูบบุหรี่ในที่ที่ไม่ได้กำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
4	การกินอาหารในบริเวณที่ไม่ได้กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
5	การทะเลาะวิวาทหรือใช้วาจาไม่สุภาพ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
6	การเล่นการพนัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
7	การเสพหรือนำยาเสพติดเข้ามาในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
8	การลักขโมย ทรัพย์สินทั้งส่วนบุคคลและของผู้ว่าจ้าง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
9	การจอดรถกีดขวางอุปกรณ์ดับเพลิง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
10	การจอดรถบนลานหินกรวด โดยไม่ได้รับอนุญาต	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
11	การจอดรถในที่ห้ามจอด หรือขับรถฝ่าฝืนเครื่องกั้นจราจร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
12	การดื่มสุราภายในโรงไฟฟ้าหรือพบปริมาณแอลกอฮอล์ในบุคคล ก่อนเข้าพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
13	การลวนลามหรือคุกคามทางเพศต่อสุภาพสตรี ทั้งทางกายและวาจา	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
14	การประท้วง หรือบุกรุกพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
15	การวางระเบิด การพกอาวุธ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
16	การจอดรถบนฝาปิดสายส่งไฟฟ้าใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
17	พบก้นบุหรี่ ขวดสุรา ขวดเบียร์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
18	พบเศษสายไฟ เศษชิ้นทองแดงซึ่งมีสภาพโดนตัด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
19	พบท่อส่งผลิตภัณฑ์นอกโรงไฟฟ้า ชำรุด ชิ้นส่วนถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
20	พบโครงสร้างสายส่งไฟฟ้าแรงสูงชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
21	พบทรัพย์สินของผู้ว่าจ้างนอกโรงไฟฟ้าชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
22	วัสดุต้องสงสัยวางทิ้งไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
23	พบบุคคลต้องห้าม ฝ่าฝืนเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
24	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
B	**การตรวจสภาพสิ่งผิดปกติหรือสภาพความไม่ปลอดภัย**																																
1	พบควันไฟหรือไฟไหม้ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
2	พบสารเคมีรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
3	พบน้ำมันรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
4	พบการล้นของน้ำในขบวนการผลิตของบริษัทฯ ไหลลงรางระบายน้ำ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
5	พบปรากฏการณ์ผิดปกติทางไฟฟ้า เช่น ฟ้าผ่า , เสียงโคโรนา , อาร์คแฟลช	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
6	พบเหตุการณ์เครื่องจักร อุปกรณ์ โครงสร้าง หรืออาคารชำรุดเสียหาย	2	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-		
7	ได้รับกลิ่นก๊าซหรือสารเคมีรั่วไหล จากนอกพื้นที่โรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
8	ได้รับกลิ่นผิดปกติซึ่งเกิดภายในพื้นที่รับผิดชอบ	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-		
9	พบเหตุการณ์ไฟไหม้บริเวณนอกโรงไฟฟ้าหรือใกล้เคียง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
10	พบการจัดเก็บเศษวัสดุหรือเศษขยะไม่เป็นระเบียบเรียบร้อยภายในบริเวณพื้นที่รับผิดชอบและตรวจสอบการรั่วไหลของของเสียบริเวณอาคารหรือสถานที่เก็บของเสีย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
11	พบเห็นพงหญ้ารกบริเวณแนวใต้สายส่ง,ใต้แนวสายพานถ่านหิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
12	พบเห็นสัตว์เลื้อยคลานมีพิษภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
13	พบเห็นสัตว์ต่างๆเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
14	พบผู้ทำงานบนนั่งร้าน ที่สูง ไม่สวมใส่อุปกรณ์กันตก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
15	พบการละเลยไม่มีการปิดกั้นพื้นที่ ขณะทำงาน เครน , งานนั่งร้าน , งานขุด และงานขนถ่ายสารเคมี	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
16	พบการทำงานที่ก่อให้เกิดประกายไฟใกล้วัสดุไวไฟ โดยไม่มีถังดับเพลิงหรือฉากป้องกัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
17	พบเห็นการเกิดอุบัติภัยหรืออุบัติเหตุ ใน ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
18	พบผู้รับเหมาไม่ใช้กะบังหน้าขณะทำงานตัด เชื่อม หรือเจียร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
19	พบเห็นควันสีดำผิดปกติออกจากปล่องเครื่องจักรของบริษัทโกลว์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
20	พบเห็นคราบน้ำมันในรางหรือคลองระบายน้ำทิ้ง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
21	พบฝุ่นถ่านหิน ฝุ่นหินปูน หรือฝุ่นขี้เถ้า ฟุ้งกระจายในอากาศอย่างผิดปกติ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
22	พบงานเครนใต้สายส่งไฟฟ้าแรงสูง หรืองานขุดใกล้แนวสายส่งใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
23	ถุงแสดงทิศทางลมขาดชำรุด ป้ายเตือนความปลอดภัยชำรุด เครื่องหมายจราจรชำรุด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
24	พบรถบรรทุกสารเคมี รถบรรทุกท่อก๊าซแรงดันสูงบรรทุกในสภาพไม่ปลอดภัย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
25	พบรถบรรทุกขี้เถ้า รถบรรทุกไม้ชีวมวลทำของตกหล่นตามพื้นถนน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
26	สัญญาณฉุกเฉินทำงาน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
27	เหตุการณ์ภัยธรรมชาติ อาทิ พายุฝนฟ้าคะนอง ลมแรง น้ำท่วม	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
28	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
29	สภาพความสะอาด ชำรุด ของรางระบายน้ำรอบโรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		

บันทึกการตรวจด้านความปลอดภัยและสภาพแวดล้อมของพนักงานรักษาความปลอดภัย

GPSC

บริษัท : โกลว์เอสพีพี 11 จำกัด (โรงงาน 2)

No	รายการตรวจงานด้านความปลอดภัยและสภาพแวดล้อม	Total	เดือน มีนาคม. ปี 2024																													
			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
A	รายละเอียดการตรวจบุคคล																																	
1	การไม่สวมใส่ PPE เข้าบริเวณ Restricted Area ทั้งพนักงาน และบุคคลภายนอก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2	การขับรถเร็วเกินกว่าที่กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
3	การสูบบุหรี่ในที่ที่ไม่ได้กำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
4	การกินอาหารในบริเวณที่ไม่ได้กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
5	การทะเลาะวิวาทหรือใช้วาจาไม่สุภาพ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
6	การเล่นการพนัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
7	การเสพหรือนำยาเสพติดเข้ามาในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
8	การลักขโมย ทรัพย์สินทั้งส่วนบุคคลและของผู้ว่าจ้าง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
9	การจอดรถกีดขวางอุปกรณ์ดับเพลิง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	การจอดรถบนลานหินกรวด โดยไม่ได้รับอนุญาต	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
11	การจอดรถในที่ห้ามจอด หรือขับรถฝ่าฝืนเครื่องกั้นจราจร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
12	การดื่มสุราภายในโรงไฟฟ้าหรือพบปริมาณแอลกอฮอลล์ในบุคคล ก่อนเข้าพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
13	การลวนลามหรือคุกคามทางเพศต่อสุภาพสตรี ทั้งทางกายและวาจา	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
14	การประท้วง หรือบุกรุกพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
15	การวางระเบิด การพกอาวุธ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
16	การจอดรถบนฝาปิดสายส่งไฟฟ้าใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
17	พบก้นบุหรี่ ขวดสุรา ขวดเบียร์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
18	พบเศษสายไฟ เศษชิ้นทองแดงซึ่งมีสภาพโดนตัด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
19	พบท่อส่งผลิตภัณฑ์นอกโรงไฟฟ้า ชำรุด ชิ้นส่วนถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
20	พบโครงสร้างสายส่งไฟฟ้าแรงสูงชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
21	พบทรัพย์สินของผู้ว่าจ้างนอกโรงไฟฟ้าชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
22	วัสดุต้องสงสัยวางทิ้งไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
23	พบบุคคลต้องห้าม ฝ่าฝืนเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
24	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
B	การตรวจสภาพสิ่งผิดปกติหรือสภาพความไม่ปลอดภัย																																	
1	พบควันไฟหรือไฟไหม้ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2	พบสารเคมีรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
3	พบน้ำมันรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
4	พบการล้นของน้ำในขบวนการผลิตของบริษัทฯ ไหลลงรางระบายน้ำ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
5	พบปรากฏการณ์ผิดปกติทางไฟฟ้า เช่น ฟ้าผ่า , เสียงโคโรนา , อาร์คแฟลช	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
6	พบเหตุการณ์เครื่องจักร อุปกรณ์ โครงสร้าง หรืออาคารชำรุดเสียหาย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
7	ได้รับกลิ่นก๊าซหรือสารเคมีรั่วไหล จากนอกพื้นที่โรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
8	ได้รับกลิ่นผิดปกติซึ่งเกิดภายในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
9	พบเหตุการณ์ไฟไหม้บริเวณนอกโรงไฟฟ้าหรือใกล้เคียง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	พบการจัดเก็บเศษวัสดุหรือเศษขยะไม่เป็นระเบียบเรียบร้อยภายในบริเวณพื้นที่รับผิดชอบและตรวจสอบการรั่วไหลของของเสียบริเวณอาคารหรือสถานที่เก็บของเสีย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
11	พบเห็นพงหญ้ารกบริเวณแนวใต้สายส่ง,ใต้แนวสายพานถ่านหิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
12	พบเห็นสัตว์เลื้อยคลานมีพิษภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
13	พบเห็นสัตว์ต่างๆเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
14	พบผู้ทำงานบนนั่งร้าน ที่สูง ไม่สวมใส่อุปกรณ์กันตก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
15	พบการละเลยไม่มีการปิดกั้นพื้นที่ ขณะทำงาน เครน , งานนั่งร้าน , งานขุด และงานขนถ่ายสารเคมี	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
16	พบการทำงานที่ก่อให้เกิดประกายไฟใกล้วัตถุไวไฟ โดยไม่มีถังดับเพลิงหรือฉากป้องกัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
17	พบเห็นการเกิดอุบัติภัยหรืออุบัติเหตุ ใน ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
18	พบผู้รับเหมาไม่ใช้กระบังหน้าขณะทำงานตัด เชื่อม หรือเจียร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
19	พบเห็นควันสีดำผิดปกติออกจากปล่องเครื่องจักรของบริษัทโกลว์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
20	พบเห็นคราบน้ำมันในรางหรือคลองระบายน้ำทิ้ง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
21	พบฝุ่นถ่านหิน ฝุ่นหินปูน หรือฝุ่นขี้เถ้า ฟุ้งกระจายในอากาศอย่างผิดปกติ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
22	พบงานเครนใต้สายส่งไฟฟ้าแรงสูง หรืองานขุดใกล้แนวสายส่งใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
23	ถุงแสดงทิศทางลมขาดชำรุด ป้ายเตือนความปลอดภัยชำรุด เครื่องหมายจราจรชำรุด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
24	พบรถบรรทุกสารเคมี รถบรรทุกท่อก๊าซแรงดันสูงบรรทุกในสภาพไม่ปลอดภัย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
25	พบรถบรรทุกขี้เถ้า รถบรรทุกไม่ขึงมวลทำของตกหล่นตามพื้นถนน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
26	สัญญาณฉุกเฉินทำงาน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
27	เหตุการณ์ภัยธรรมชาติ อาทิ พายุฝนฟ้าคะนอง ลมแรง น้ำท่วม	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
28	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
29	สภาพความสะอาด ชำรุด ของรางระบายน้ำรอบโรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

บันทึกการตรวจด้านความปลอดภัยและสภาพแวดล้อมของพนักงานรักษาความปลอดภัย

GPSC

บริษัท : โกลว์เอสพีพี 11 จำกัด (โรงงาน 2)

No	รายการตรวจงานด้านความปลอดภัยและสภาพแวดล้อม	Total	เดือน เมษายน. ปี 2024																													
			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	
A	รายละเอียดการตรวจบุคคล																																	
1	การไม่สวมใส่ PPE เข้าบริเวณ Restricted Area ทั้งพนักงาน และบุคคลภายนอก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
2	การขับรถเร็วเกินกว่าที่กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
3	การสูบบุหรี่ในที่ที่ไม่ได้กำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
4	การกินอาหารในบริเวณที่ไม่ได้กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
5	การทะเลาะวิวาทหรือใช้วาจาไม่สุภาพ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
6	การเล่นการพนัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
7	การเสพหรือนำยาเสพติดเข้ามาในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
8	การลักขโมย ทรัพย์สินทั้งส่วนบุคคลและของผู้ว่าจ้าง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
9	การจอดรถกีดขวางอุปกรณ์ดับเพลิง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
10	การจอดรถบนลานหินกรวด โดยไม่ได้รับอนุญาต	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
11	การจอดรถในที่ห้ามจอด หรือขับรถฝ่าฝืนเครื่องกั้นจราจร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
12	การดื่มสุราภายในโรงไฟฟ้าหรือพบปริมาณแอลกอฮอลล์ในบุคคล ก่อนเข้าพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
13	การลวนลามหรือคุกคามทางเพศต่อสุภาพสตรี ทั้งทางกายและวาจา	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
14	การประท้วง หรือบุกรุกพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
15	การวางระเบิด การพกอาวุธ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
16	การจอดรถบนฝาปิดสายส่งไฟฟ้าใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
17	พบก้นบุหรี่ ขวดสุรา ขวดเบียร์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
18	พบเศษสายไฟ เศษชิ้นทองแดงซึ่งมีสภาพโดนตัด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
19	พบท่อส่งผลิตภัณฑ์นอกโรงไฟฟ้า ชำรุด ชิ้นส่วนถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
20	พบโครงสร้างสายส่งไฟฟ้าแรงสูงชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
21	พบทรัพย์สินของผู้ว่าจ้างนอกโรงไฟฟ้าชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
22	วัสดุต้องสงสัยวางทิ้งไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
23	พบบุคคลต้องห้าม ฝ่าฝืนเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
24	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
B	การตรวจสภาพสิ่งผิดปกติหรือสภาพความไม่ปลอดภัย																																	
1	พบควันไฟหรือไฟไหม้ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
2	พบสารเคมีรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
3	พบน้ำมันรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
4	พบการล้นของน้ำในขบวนการผลิตของบริษัทฯ ไหลลงรางระบายน้ำ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
5	พบปรากฏการณ์ผิดปกติทางไฟฟ้า เช่น ฟ้าผ่า , เสียงโคโรนา , อาร์คแฟลช	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
6	พบเหตุการณ์เครื่องจักร อุปกรณ์ โครงสร้าง หรืออาคารชำรุดเสียหาย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
7	ได้รับกลิ่นก๊าซหรือสารเคมีรั่วไหล จากนอกพื้นที่โรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
8	ได้รับกลิ่นผิดปกติซึ่งเกิดภายในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
9	พบเหตุการณ์ไฟไหม้บริเวณนอกโรงไฟฟ้าหรือใกล้เคียง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
10	พบการจัดเก็บเศษวัสดุหรือเศษขยะไม่เป็นระเบียบเรียบร้อยภายในบริเวณพื้นที่รับผิดชอบและตรวจสอบการรั่วไหลของของเสียบริเวณอาคารหรือสถานที่เก็บของเสีย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
11	พบเห็นพงหญ้ารกบริเวณแนวใต้สายส่ง,ใต้แนวสายพานถ่านหิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
12	พบเห็นสัตว์เลื้อยคลานมีพิษภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
13	พบเห็นสัตว์ต่างๆเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
14	พบผู้ทำงานบนนั่งร้าน ที่สูง ไม่สวมใส่อุปกรณ์กันตก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
15	พบการละเลยไม่มีการปิดกั้นพื้นที่ ขณะทำงาน เครน , งานนั่งร้าน , งานขุด และงานขนถ่ายสารเคมี	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
16	พบการทำงานที่ก่อให้เกิดประกายไฟใกล้วัตถุไวไฟ โดยไม่มีถังดับเพลิงหรือฉากป้องกัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
17	พบเห็นการเกิดอุบัติภัยหรืออุบัติเหตุ ใน ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
18	พบผู้รับเหมาไม่ใช้กระบังหน้าขณะทำงานตัด เชื่อม หรือเจียร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
19	พบเห็นควันสีดำผิดปกติออกจากปล่องเครื่องจักรของบริษัทโกลว์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
20	พบเห็นคราบน้ำมันในรางหรือคลองระบายน้ำทิ้ง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
21	พบฝุ่นถ่านหิน ฝุ่นหินปูน หรือฝุ่นขี้เถ้า ฟุ้งกระจายในอากาศอย่างผิดปกติ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
22	พบงานเครนใต้สายส่งไฟฟ้าแรงสูง หรืองานขุดใกล้แนวสายส่งใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
23	ถุงแสดงทิศทางลมขาดชำรุด ป้ายเตือนความปลอดภัยชำรุด เครื่องหมายจราจรชำรุด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	
24	พบรถบรรทุกสารเคมี รถบรรทุกท่อก๊าซแรงดันสูงบรรทุกในสภาพไม่ปลอดภัย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
25	พบรถบรรทุกขี้เถ้า รถบรรทุกไม่ขึงมวลทำของตกหล่นตามพื้นถนน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
26	สัญญาณฉุกเฉินทำงาน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
27	เหตุการณ์ภัยธรรมชาติ อาทิ พายุฝนฟ้าคะนอง ลมแรง น้ำท่วม	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	
28	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
29	สภาพความสะอาด ชำรุด ของรางระบายน้ำรอบโรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	

บันทึกการตรวจด้านความปลอดภัยและสภาพแวดล้อมของพนักงานรักษาความปลอดภัย

บริษัท : โกลว์เอสพีพี 11 จำกัด (โรงงาน 2)

No	รายการตรวจงานด้านความปลอดภัยและสภาพแวดล้อม	Total	เดือน พฤษภาคม. ปี 2024																													
			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
A	รายละเอียดการตรวจบุคคล																																
1	การไม่สวมใส่ PPE เข้าบริเวณ Restricted Area ทั้งพนักงาน และบุคคลภายนอก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2	การขับรถเร็วเกินกว่าที่กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
3	การสูบบุหรี่ในที่ที่ไม่ได้กำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
4	การกินอาหารในบริเวณที่ไม่ได้กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
5	การทะเลาะวิวาทหรือใช้วาจาไม่สุภาพ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
6	การเล่นการพนัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
7	การเสพหรือนำยาเสพติดเข้ามาในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
8	การลักโขมย ทรัพย์สินทั้งส่วนบุคคลและของผู้ว่าจ้าง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
9	การจอดรถกีดขวางอุปกรณ์ดับเพลิง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	การจอดรถบนลานหินกรวด โดยไม่ได้รับอนุญาต	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
11	การจอดรถในที่ห้ามจอด หรือขับรถฝ่าฝืนเครื่องกั้นจราจร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
12	การดื่มสุราภายในโรงไฟฟ้าหรือพบปริมาณแอลกอฮอลล์ในบุคคล ก่อนเข้าพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
13	การลวนลามหรือคุกคามทางเพศต่อสุภาพสตรี ทั้งทางกายและวาจา	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
14	การประท้วง หรือบุกรุกพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
15	การวางระเบิด การพกอาวุธ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
16	การจอดรถบนฝาปิดสายส่งไฟฟ้าใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
17	พบก้นบุหรี่ ขวดสุรา ขวดเบียร์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
18	พบเศษสายไฟ เศษชิ้นทองแดงซึ่งมีสภาพโดนตัด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
19	พบท่อส่งผลิตภัณฑ์นอกโรงไฟฟ้า ชำรุด ชิ้นส่วนถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
20	พบโครงสร้างสายส่งไฟฟ้าแรงสูงชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
21	พบทรัพย์สินของผู้ว่าจ้างนอกโรงไฟฟ้าชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
22	วัสดุต้องสงสัยวางทิ้งไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
23	พบบุคคลต้องห้าม ฝ่าฝืนเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
24	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
B	การตรวจสภาพสิ่งผิดปกติหรือสภาพความไม่ปลอดภัย																																
1	พบควันไฟหรือไฟไหม้ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2	พบสารเคมีรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	1	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
3	พบน้ำมันรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
4	พบการล้นของน้ำในขบวนการผลิตของบริษัทฯ ไหลลงรางระบายน้ำ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
5	พบปรากฎการณ์ผิดปกติทางไฟฟ้า เช่น ฟ้าผ่า , เสียงโคโรนา , อ๊าคแฟลช	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
6	พบเหตุการณ์เครื่องจักร อุปกรณ์ โครงสร้าง หรืออาคารชำรุดเสียหาย	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-
7	ได้รับกลิ่นก๊าซหรือสารเคมีรั่วไหล จากนอกพื้นที่โรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
8	ได้รับกลิ่นผิดปกติซึ่งเกิดภายในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
9	พบเหตุการณ์ไฟไหม้บริเวณนอกโรงไฟฟ้าหรือใกล้เคียง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	พบการจัดเก็บเศษวัสดุหรือเศษขยะไม่เป็นระเบียบเรียบร้อยภายในบริเวณพื้นที่รับผิดชอบและตรวจสอบการรั่วไหลของของเสียบริเวณอาคารหรือสถานที่เก็บของเสีย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
11	พบเห็นพงหญ้ารกบริเวณแนวใต้สายส่ง,ใต้แนวสายพานถ่านหิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
12	พบเห็นสัตว์เลื้อยคลานมีพิษภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
13	พบเห็นสัตว์ต่างๆเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
14	พบผู้ทำงานบนนั่งร้าน ที่สูง ไม่สวมใส่อุปกรณ์กันตก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
15	พบการละเลยไม่มีการปิดกั้นพื้นที่ ขณะทำงาน เครน , งานนั่งร้าน , งานขุด และงานขนถ่ายสารเคมี	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
16	พบการทำงานที่ก่อให้เกิดประกายไฟใกล้วัตถุไวไฟ โดยไม่มีถังดับเพลิงหรือฉากป้องกัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
17	พบเห็นการเกิดอุบัติภัยหรืออุบัติเหตุ ใน ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
18	พบผู้รับเหมาไม่ใช้กะบังหน้าขณะทำงานตัด เชื่อม หรือเจียร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
19	พบเห็นควันสีดำผิดปกติออกจากปล่องเครื่องจักรของบริษัทโกลว์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
20	พบเห็นคราบน้ำมันในรางหรือคลองระบายน้ำทิ้ง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
21	พบฝุ่นถ่านหิน ฝุ่นหินปูน หรือฝุ่นขี้เถ้า ฟุ้งกระจายในอากาศอย่างผิดปกติ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
22	พบงานเครนใต้สายส่งไฟฟ้าแรงสูง หรืองานขุดใกล้แนวสายส่งใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
23	ถุงแสดงทิศทางลมขาดชำรุด ป้ายเตือนความปลอดภัยชำรุด เครื่องหมายจราจรชำรุด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
24	พบรถบรรทุกสารเคมี รถบรรทุกท่อก๊าซแรงดันสูงบรรทุกในสภาพไม่ปลอดภัย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
25	พบรถบรรทุกขี้เถ้า รถบรรทุกไม่ปิดวมวดทำของตกหล่นตามพื้นถนน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
26	สัญญาณฉุกเฉินทำงาน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
27	เหตุการณ์ภัยธรรมชาติ อาทิ พายุฝนฟ้าคะนอง ลมแรง น้ำท่วม	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
28	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	1	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
29	สภาพความสะอาด ชำรุด ของรางระบายน้ำรอบโรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

บันทึกการตรวจด้านความปลอดภัยและสภาพแวดล้อมของพนักงานรักษาความปลอดภัย

บริษัท : โกลว์เอสพีพี 11 จำกัด (โรงงาน 2)

No	รายการตรวจงานด้านความปลอดภัยและสภาพแวดล้อม	Total	เดือน มิถุนายน. ปี 2024																													
			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	
A	รายละเอียดการตรวจบุคคล																																
1	การไม่สวมใส่ PPE เข้าบริเวณ Restricted Area ทั้งพนักงาน และบุคคลภายนอก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
2	การขับรถเร็วเกินกว่าที่กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
3	การสูบบุหรี่ในที่ที่ไม่ได้กำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
4	การกินอาหารในบริเวณที่ไม่ได้กำหนดไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
5	การทะเลาะวิวาทหรือใช้วาจาไม่สุภาพ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
6	การเล่นการพนัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
7	การเสพหรือนำยาเสพติดเข้ามาในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
8	การลักโขมย ทรัพย์สินทั้งส่วนบุคคลและของผู้ว่าจ้าง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
9	การจอดรถกีดขวางอุปกรณ์ดับเพลิง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
10	การจอดรถบนลานหินกรวด โดยไม่ได้รับอนุญาต	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
11	การจอดรถในที่ห้ามจอด หรือขับรถฝ่าฝืนเครื่องกั้นจราจร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
12	การดื่มสุราภายในโรงไฟฟ้าหรือพบปริมาณแอลกอฮอลล์ในบุคคล ก่อนเข้าพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
13	การลวนลามหรือคุกคามทางเพศต่อสุภาพสตรี ทั้งทางกายและวาจา	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
14	การประท้วง หรือบุกรุกพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
15	การวางระเบิด การพกอาวุธ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
16	การจอดรถบนฝาปิดสายส่งไฟฟ้าใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
17	พบก้นบุหรี่ ขวดสุรา ขวดเบียร์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
18	พบเศษสายไฟ เศษชิ้นทองแดงซึ่งมีสภาพโดนตัด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
19	พบท่อส่งผลิตภัณฑ์นอกโรงไฟฟ้า ชำรุด ชิ้นส่วนถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
20	พบโครงสร้างสายส่งไฟฟ้าแรงสูงชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
21	พบทรัพย์สินของผู้ว่าจ้างนอกโรงไฟฟ้าชำรุด หรือถูกขโมย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
22	วัสดุต้องสงสัยวางทิ้งไว้	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
23	พบบุคคลต้องห้าม ฝ่าฝืนเข้ามาในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
24	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
B	การตรวจสภาพสิ่งผิดปกติหรือสภาพความไม่ปลอดภัย																																
1	พบควันไฟหรือไฟไหม้ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
2	พบสารเคมีรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
3	พบน้ำมันรั่วไหลออกจากถังเก็บ , ข้อต่อหรือหน้าแปลน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
4	พบการล้นของน้ำในขบวนการผลิตของบริษัทฯ ไหลลงรางระบายน้ำ	3	-	-	-	-	1	-	-	-	-	-	-	1	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
5	พบปรากฎการณ์ผิดปกติทางไฟฟ้า เช่น ฟ้าผ่า , เสียงโคโรนา , อ๊าคแฟลช	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
6	พบเหตุการณ์เครื่องจักร อุปกรณ์ โครงสร้าง หรืออาคารชำรุดเสียหาย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
7	ได้รับกลิ่นก๊าซหรือสารเคมีรั่วไหล จากนอกพื้นที่โรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
8	ได้รับกลิ่นผิดปกติซึ่งเกิดภายในพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
9	พบเหตุการณ์ไฟไหม้บริเวณนอกโรงไฟฟ้าหรือใกล้เคียง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
10	พบการจัดเก็บเศษวัสดุหรือเศษขยะไม่เป็นระเบียบเรียบร้อยภายในบริเวณพื้นที่รับผิดชอบและตรวจสอบการรั่วไหลของของเสียบริเวณอาคารหรือสถานที่เก็บของเสีย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
11	พบเห็นพงหญ้ารกบริเวณแนวใต้สายส่ง,ใต้แนวสายพานถ่านหิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
12	พบเห็นสัตว์เลื้อยคลานมีพิษภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
13	พบเห็นสัตว์ต่างๆเข้ามาในบริเวณพื้นที่รับผิดชอบ	1	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
14	พบผู้ทำงานบนนั่งร้าน ที่สูง ไม่สวมใส่อุปกรณ์กันตก	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
15	พบการละเลยไม่มีการปิดกั้นพื้นที่ ขณะทำงาน เครน , งานนั่งร้าน , งานขุด และงานขนถ่ายสารเคมี	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
16	พบการทำงานที่ก่อให้เกิดประกายไฟใกล้วัตถุไวไฟ โดยไม่มีถังดับเพลิงหรือฉากป้องกัน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
17	พบเห็นการเกิดอุบัติภัยหรืออุบัติเหตุ ใน ภายในบริเวณพื้นที่รับผิดชอบ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
18	พบผู้รับเหมาไม่ใช้กะบังหน้าขณะทำงานตัด เชื่อม หรือเจียร	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
19	พบเห็นควันสีดำผิดปกติออกจากปล่องเครื่องจักรของบริษัทโกลว์	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
20	พบเห็นคราบน้ำมันในรางหรือคลองระบายน้ำทิ้ง	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
21	พบฝุ่นถ่านหิน ฝุ่นหินปูน หรือฝุ่นขี้เถ้า ฟุ้งกระจายในอากาศอย่างผิดปกติ	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
22	พบงานเครนใต้สายส่งไฟฟ้าแรงสูง หรืองานขุดใกล้แนวสายส่งใต้ดิน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
23	ถุงแสดงทิศทางลมขาดชำรุด ป้ายเตือนความปลอดภัยชำรุด เครื่องหมายจราจรชำรุด	2	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1	-	-	-	-	
24	พบรถบรรทุกสารเคมี รถบรรทุกท่อก๊าซแรงดันสูงบรรทุกในสภาพไม่ปลอดภัย	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
25	พบรถบรรทุกขี้เถ้า รถบรรทุกไม่ปิดวมวดทำของตกหล่นตามพื้นถนน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
26	สัญญาณฉุกเฉินทำงาน	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
27	เหตุการณ์ภัยธรรมชาติ อาทิ พายุฝนฟ้าคะนอง ลมแรง น้ำท่วม	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
28	ลักษณะการตรวจอื่น ๆ ตามที่ผู้ว่าจ้างกำหนด	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
29	สภาพความสะอาด ชำรุด ของรางระบายน้ำรอบโรงไฟฟ้า	0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	

หมายเหตุ.

ภาคผนวก ข-16

เอกสารการจัดประชุมคณะกรรมการพหุภาคี

(ร่าง) รายงานการประชุม
คณะกรรมการพหุภาคีร่วม และคณะกรรมการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม
โครงการโรงไฟฟ้าพลังความร้อมร่วม บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 2/2566
วันศุกร์ที่ 19 เมษายน พ.ศ. 2567 เวลา 10.00 -12.00 น.
ณ ห้องประชุมชั้น 2 ที่ว่าการอำเภอปลวกแดง จังหวัดระยอง

<u>รายชื่อคณะกรรมการฯ ที่เข้าร่วมประชุม</u>

1.	นายอำเภอปลวกแดง	ประธานกรรมการ
2.	(แทน) พลังงานจังหวัดระยอง	กรรมการ
3.	ผู้อำนวยการโรงพยาบาลส่งเสริมสุขภาพตำบลมาบยางพร	กรรมการ
4.	ผู้อำนวยการโรงเรียนบ้านมาบยางพรวิทยาคม ต.มาบยางพร อ.ปลวกแดง	กรรมการ
5.	ประธานชมรมกำนัน ผู้ใหญ่บ้าน อ.ปลวกแดง	กรรมการ
6.	ผู้ทรงคุณวุฒิด้านสิ่งแวดล้อมและสุขภาพ	กรรมการ
7.	ตัวแทนภาคประชาชน ต.ปลวกแดง อ.ปลวกแดง	กรรมการ
8.	ตัวแทนภาคประชาชน ต.ปลวกแดง อ.ปลวกแดง	กรรมการ
9.	ตัวแทนภาคประชาชน ต.ปลวกแดง หมู่ที่ 4	กรรมการ
10	ตัวแทนภาคประชาชน ต.ปลวกแดง หมู่ที่ 4	กรรมการ
11	ตัวแทนภาคประชาชน ต.มาบยางพร หมู่ที่ 2	กรรมการ
12	ตัวแทนภาคประชาชน ต.ตาสิทธิ์ หมู่ที่ 1	กรรมการ
13	ตัวแทนภาคประชาชน ต.ตาสิทธิ์ หมู่ที่ 1	กรรมการ
14	ตัวแทนภาคประชาชน ต.บ่อวิน หมู่ที่ 3	กรรมการ
15	ผู้แทนฝ่ายบริหารบริษัท โกลว์ เอสพีพี 11 จำกัด	กรรมการ
16	ผู้แทนฝ่ายมวลชนสัมพันธ์บริษัท โกลว์ เอสพีพี 11 จำกัด	กรรมการ
17	ผู้แทนฝ่ายสิ่งแวดล้อมบริษัท โกลว์ เอสพีพี 11 จำกัด	เลขานุการ/ กรรมการ

<u>รายชื่อคณะกรรมการฯ ที่ไม่ได้เข้าร่วมประชุม เนื่องจากติดภาระกิจ</u>

1. นายอำเภอศรีราชา	กรรมการ
2. นายแพทย์สาธารณสุขจังหวัดระยอง	กรรมการ
3. ผู้อำนวยการสำนักงานทรัพยากรธรรมชาติและสิ่งแวดล้อม จ.ระยอง	กรรมการ
4. ผู้อำนวยการโรงพยาบาลส่งเสริมสุขภาพตำบลบ่อวิน	กรรมการ
5. ผู้กำกับการ สภ.ปลวกแดง	กรรมการ
6. ผู้กำกับการ สภ. บ่อวิน	กรรมการ
7. ผู้ทรงคุณวุฒิด้านการเกษตร	กรรมการ
8. กำนันต.บ่อวิน อ.ศรีราชา	กรรมการ
9. นายกองค์การบริหารส่วนตำบลปลวกแดง	กรรมการ
10. ผู้แทนองค์การบริหารส่วนตำบลมาบยางพร	กรรมการ
11. ผู้แทนองค์การบริหารส่วนตำบลบ่อวิน	กรรมการ
12. ตัวแทนภาคประชาชน ต.มาบยางพร หมู่ที่ 3	กรรมการ
13. ตัวแทนภาคประชาชน ต.มาบยางพร หมู่ที่ 2	กรรมการ
14. ตัวแทนภาคประชาชน ต.มาบยางพร หมู่ที่ 3	กรรมการ
15. ตัวแทนภาคประชาชน ต.มาบยางพร หมู่ที่ 3	กรรมการ
16. ตัวแทนภาคประชาชน ต.มาบยางพร หมู่ที่ 4	กรรมการ
17. ตัวแทนภาคประชาชน ต.มาบยางพร หมู่ที่ 6	กรรมการ
18. ตัวแทนภาคประชาชน ต.บ่อวิน อ.ศรีราชา	กรรมการ
19. ตัวแทนภาคประชาชน ต.บ่อวิน อ.ศรีราชา	กรรมการ
20. ตัวแทนภาคประชาชน ต.บ่อวิน หมู่ที่ 3	กรรมการ
21. ตัวแทนภาคประชาชน ต.บ่อวิน หมู่ที่ 7	กรรมการ

<u>รายนามผู้เข้าร่วมสังเกตการณ์</u>

1.	ผู้ช่วยผู้จัดการฝ่ายมวลชนสัมพันธ์	บริษัท โกลว์ เอสพีพี 11 จำกัด
2.	ผู้จัดการฝ่ายสิ่งแวดล้อม	บริษัท โกลว์ เอสพีพี 11 จำกัด
3.	ผู้ช่วยผู้จัดการฝ่ายสิ่งแวดล้อม	บริษัท โกลว์ เอสพีพี 11 จำกัด
4.	นักวิชาการสิ่งแวดล้อม	บริษัท เอแอลเอส แลบอราทอรี กรุ๊ป (ประเทศไทย) จำกัด (บริษัทที่ปรึกษาฯ)
5.	นักวิชาการสิ่งแวดล้อม	บริษัท เอแอลเอส แลบอราทอรี กรุ๊ป (ประเทศไทย) จำกัด (บริษัทที่ปรึกษาฯ)
6.	นักวิชาการสิ่งแวดล้อม	บริษัท เอ็นไว เวิร์ค จำกัด
7.	นักวิชาการสิ่งแวดล้อม	บริษัท เอ็นไว เวิร์ค จำกัด

วาระที่ 1 เรื่องที่ประธานแจ้งให้ทราบ

ลำดับที่	รายละเอียด	หมายเหตุ
1	❑ ประธานแจ้งให้ทราบ - ไม่มี	

วาระที่ 2 รับรองรายงานการประชุม

ลำดับที่	รายละเอียด	หมายเหตุ
2.1	❑ **รับรองรายงานการประชุมคณะกรรมการพหุภาคีร่วม และคณะกรรมการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมโครงการโรงไฟฟ้า บริษัท โกลว์ เอสพีพี 11 จำกัด ครั้งที่ 1/2566 เมื่อวันที่ 28 เมษายน 2566**	

วาระที่ 3 เรื่องแจ้งเพื่อทราบ

ลำดับที่	รายละเอียด	หมายเหตุ
3.1	❑ **ผลการดำเนินงานโรงไฟฟ้าพลังความร้อนร่วม บริษัท โกลว์ เอสพีพี 11 จำกัด (โครงการ 1 และ 2) (ระยะดำเนินการ) ช่วงเวลาเดือนมกราคม-ธันวาคม พ.ศ. 2566** ➢ **นายวสันต์ สุสุนทร ผู้แทนฝ่ายมวลชนสัมพันธ์** : นำเสนอข้อมูลดังต่อไปนี้ - ข้อมูล ที่ตั้งโรงไฟฟ้า บริษัท โกลว์ เอสพีพี 11 จำกัด (โครงการ 1 และ 2) - กระบวนการผลิตกระแสไฟฟ้า - ปริมาณการผลิตกระแสไฟฟ้าขั้นต้นระหว่างเดือนมกราคม-ธันวาคม พ.ศ. 2566 ทั้งโครงการ 1 และ โครงการ 2 - ปริมาณการใช้ก๊าซธรรชาติเป็นเชื้อเพลิงในการผลิตกระแสไฟฟ้าระหว่างเดือนมกราคม--ธันวาคม พ.ศ. 2566 ทั้งโครงการ 1 และ โครงการ 2 - มีปริมาณการใช้น้ำดิบระหว่างเดือนมกราคม-ธันวาคม พ.ศ. 2566 ทั้งโครงการ 1 และโครงการ 2 - สถิติความปลอดภัยระหว่างเดือนมกราคม-ธันวาคม พ.ศ. 2566 มีอุบัติเหตุเกิดขึ้นจำนวน 1 ครั้ง ในวันที่ 4 พฤศจิกายน พ.ศ. 2566 ซึ่งดำเนินการสอบสวนหาสาเหตุและดำเนินการกำหนดมาตรการแก้ไขเรียบร้อยแล้ว	รายละเอียดตามเอกสารประกอบการประชุม เมื่อวันที่ 19 เมษายน พ.ศ. 2567
3.2	❑ **ผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม** **รายงานผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมโครงการโรงไฟฟ้าพลังความร้อนร่วม (ระยะดำเนินการ) บริษัท โกลว์ เอสพีพี 11 จำกัด (โครงการ 1 และ 2) ช่วงระหว่างเดือนพฤษภาคม-ธันวาคม พ.ศ. 2566** ➢ **นางสาววรณิชชา ชาติวันชัย นักวิชาการสิ่งแวดล้อม บริษัท เอแอลเอส แลบอราทอรี กรุ๊ป (ประเทศไทย) จำกัด (บริษัทที่ปรึกษาฯ)** : นำเสนอผลการปฏิบัติตามมาตรการและผลการตรวจวัดคุณภาพสิ่งแวดล้อม จำนวน 6 ด้าน คือ 1. ด้านคุณภาพอากาศจากปล่องระบายอากาศ 2. ด้านคุณภาพอากาศในบรรยากาศ 3. ด้านระดับเสียงในบรรยากาศ 4. ด้านคุณภาพน้ำ 5. ด้านสาธารณสุข/อาชีวอนามัยและความปลอดภัย และ 6.ด้านสังคม-เศรษฐกิจ ซึ่งมีรายละเอียดดังต่อไปนี้	รายละเอียดตามเอกสารประกอบการประชุม เมื่อวันที่ 19 เมษายน พ.ศ. 2567

ลำดับที่	รายละเอียด	หมายเหตุ
3.2 (ต่อ)	**ด้านคุณภาพอากาศจากปล่องระบายอากาศ** ผลการตรวจวัดคุณภาพอากาศจากปล่องระบายอากาศ	รายละเอียดตามเอกสารประกอบการประชุม เมื่อวันที่ 19 เมษายน พ.ศ. 2567

คุณภาพอากาศจากปล่องระบายอากาศ

บริษัท โกลว์ เอสพีพี 11 จำกัด	ตำแหน่งตรวจวัด	พารามิเตอร์	ความถี่
โครงการ 1	1. ปล่อง HRSG 400 2. ปล่อง HRSG 500 3. ปล่อง GEG 1 4. ปล่อง GEG 2 5. ปล่อง GEG 3 6. ปล่อง GEG 4 7. ปล่อง GEG 5 8. ปล่อง GEG 6	- ก๊าซออกไซด์ของไนโตรเจน (NO_x) - ก๊าซซัลเฟอร์ไดออกไซด์ (SO_2) - ฝุ่นละออง	ปีละ 2 ครั้ง (ทุก 6 เดือน)
โครงการ 2	1. ปล่อง HRSG 1 2. ปล่อง HRSG 2	- ก๊าซออกไซด์ของไนโตรเจน (NO_x) - ก๊าซซัลเฟอร์ไดออกไซด์ (SO_2) - ฝุ่นละออง	ปีละ 2 ครั้ง (ทุก 6 เดือน)

ผลการตรวจวัดฯ ทุกพารามิเตอร์ไม่เกินค่าที่กำหนดไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม (EIA) และไม่เกินค่ามาตรฐานตามประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม พ.ศ. 2553

ด้านคุณภาพอากาศในบรรยากาศ

ผลการตรวจวัดคุณภาพอากาศในบรรยากาศ

คุณภาพอากาศในบรรยากาศ

บริษัท โกลว์ เอสพีพี 11 จำกัด	ตำแหน่งตรวจวัด	พารามิเตอร์	ความถี่
โครงการ 1	1. หมู่ที่ 6 บ้านมาบยางพรใหม่	- ความเร็วและทิศทางลม	ปีละ 2 ครั้ง (ทุก 6 เดือน) ครั้งละ 7 วันต่อเนื่อง
	1. หมู่ที่ 6 บ้านมาบยางพรใหม่ 2. หมู่ที่ 4 บ้านวังตาผิน 3. หมู่ที่ 3 บ้านมาบยางพร	- ก๊าซไนโตรเจนไดออกไซด์ (เฉลี่ย 1 ชั่วโมง) - ก๊าซซัลเฟอร์ไดออกไซด์ (เฉลี่ย 1 ชั่วโมง) - ก๊าซซัลเฟอร์ไดออกไซด์ (เฉลี่ย 24 ชั่วโมง) - ฝุ่นละอองรวม (เฉลี่ย 24 ชั่วโมง) - ฝุ่นละอองขนาดไม่เกิน 10 ไมครอน (เฉลี่ย 24 ชั่วโมง)	
โครงการ 2	1. รพ.สต. มาบยางพร 2. หมู่ที่ 3 ต.บ่อวิน อ.ศรีราชา จ.ชลบุรี	- ความเร็วและทิศทางลม - ก๊าซไนโตรเจนไดออกไซด์ (เฉลี่ย 1 ชั่วโมง) - ก๊าซซัลเฟอร์ไดออกไซด์ (เฉลี่ย 1 ชั่วโมง) - ก๊าซซัลเฟอร์ไดออกไซด์ (เฉลี่ย 24 ชั่วโมง) - ฝุ่นละอองรวม (เฉลี่ย 24 ชั่วโมง)	ปีละ 2 ครั้ง (ทุก 6 เดือน) ครั้งละ 7 วันต่อเนื่อง

ผลการตรวจวัดฯ ทุกพารามิเตอร์ไม่เกินค่าที่กำหนดตามประกาศคณะกรรมการสิ่งแวดล้อมแห่งชาติ ฉบับที่ 33 (พ.ศ. 2552), ฉบับที่ 21 (พ.ศ. 2544) และฉบับที่ 24 (พ.ศ. 2547)

ลำดับที่	รายละเอียด	หมายเหตุ
3.2 (ต่อ)		รายละเอียดตามเอกสารประกอบการประชุม เมื่อวันที่ 19 เมษายน พ.ศ. 2567

ด้านระดับเสียงในบรรยากาศ

ผลการตรวจวัดระดับเสียงในบรรยากาศ

ระดับเสียงในบรรยากาศ

บริษัท โกลว์ เอสพีพี 11 จำกัด	ตำแหน่งตรวจวัด	พารามิเตอร์	ความถี่
โครงการ 1	1. บริเวณริมรั้วด้านทิศเหนือ 2. บริเวณริมรั้วด้านทิศตะวันออก 3. บริเวณริมรั้วด้านทิศตะวันตก 4. บริเวณริมรั้วด้านทิศใต้ 5. บริเวณหมู่ที่ 3 บ้านมาบยางพร จุด 1 6. บริเวณหมู่ที่ 3 บ้านมาบยางพร จุด 2	- ระดับเสียงเฉลี่ย 24 ชั่วโมง (Leq (24))	ปีละ 4 ครั้ง (ครั้งละ 5 วันต่อเนื่อง)
โครงการ 2	1. บริเวณริมรั้วด้านทิศเหนือ 2. บริเวณริมรั้วด้านทิศใต้ 3. บริเวณริมรั้วด้านทิศตะวันออก 4. บริเวณริมรั้วด้านทิศตะวันตก	- ระดับเสียงเฉลี่ย 24 ชั่วโมง (Leq (24))	ทุก 6 เดือน (3 วันต่อเนื่อง)

ผลการตรวจวัดฯ ทุกพารามิเตอร์ไม่เกินค่าที่กำหนดตามประกาศคณะกรรมการสิ่งแวดล้อมแห่งชาติ ฉบับที่ 15 (พ.ศ. 2540)

ด้านคุณภาพน้ำ

ผลการตรวจวัดคุณภาพน้ำ

คุณภาพน้ำทิ้ง

บริษัท โกลว์ เอสพีพี 11 จำกัด	ตำแหน่งตรวจวัด	พารามิเตอร์	ความถี่
โครงการ 1	1. น้ำทิ้งจากอาคารสำนักงาน (Admin Building Sampling Pond)	- อัตราการไหล (Flow rate) - สารแขวนลอย (SS) - ไขมันและน้ำมัน (Oil & Grease) - ความต้องการออกซิเจนทางชีวเคมี (BOD_5)	ทุกเดือน
	2. น้ำทิ้งจากกระบวนการผลิต (Retention Pond)	- อัตราการไหล (Flow rate) - อุณหภูมิ - ความเป็นกรด-ด่าง (pH) - สารที่ละลายได้ทั้งหมด (TDS) - ปริมาณคลอรีนอิสระ - ไขมันและน้ำมัน (Oil & Grease) - เหล็ก (Fe) - แมงกานีส (Mn) - โครเมียมเฮกซะวาเลนท์ (Cr^{6+}) - โครเมียมไตรวาเลนท์ (Cr^{3+})	
โครงการ 2	1. บ่อพักน้ำทิ้ง (Holding Pond)	- อัตราการไหล (Flow rate) - อุณหภูมิ - ความเป็นกรด-ด่าง (pH) - ค่าการนำไฟฟ้า - สารแขวนลอย (SS) - ไขมันและน้ำมัน (Oil & Grease) - ความต้องการออกซิเจนทางชีวเคมี (BOD_5) - ปริมาณคลอรีนอิสระ - ตะกั่ว (Pb) - ปรอท (Hg) - แคดเมียม (Cd)	ทุกเดือน

ผลการตรวจวัดฯ ทุกพารามิเตอร์ไม่เกินค่าควบคุมคุณภาพน้ำทิ้งตามข้อกำหนดของเขตประกอบการอุตสาหกรรมสยามอีสเทิร์นอินดัสเตรียลพาร์ค

ลำดับที่	รายละเอียด	หมายเหตุ
3.2 (ต่อ)	**ด้านสาธารณสุข อาชีวอนามัยและความปลอดภัย** ❖ <u>ทำการรวบรวมสถิติการเจ็บป่วยตามกลุ่มสาเหตุ (298 กลุ่มโรค) จากโรงพยาบาลส่งเสริมสุขภาพตำบลบ้านมาบยางพร, โรงพยาบาลปลวกแดง และโรงพยาบาลส่งเสริมสุขภาพตำบลบ้านบ่อวิน ประจำปี พ.ศ. 2566</u>	รายละเอียดตามเอกสารประกอบการประชุม เมื่อวันที่ 19 เมษายน พ.ศ. 2567

❖ <u>ระดับเสียงในสถานประกอบการ</u>

บริษัท โกลว์ เอสพีพี 11 จำกัด	ตำแหน่งตรวจวัด	พารามิเตอร์	ความถี่
โครงการ 1	1. Air Compressor 2. Gas turbine generator 3. Cooling tower	- ระดับเสียงเฉลี่ย 8 ชั่วโมง (Leq (8))	ทุก 3 เดือน (ปีละ 4 ครั้ง)
โครงการ 2	1. Control room 2. Cooling tower 3. Gas turbine generator (นอกเหนือจากมาตรการฯ)	- ระดับเสียงเฉลี่ย 8 ชั่วโมง (Leq (8))	ทุก 3 เดือน (ปีละ 4 ครั้ง)

<u>ผลการตรวจวัดฯ ทุกสถานีมีค่าไม่เกินกำหนดตามประกาศกระทรวงอุตสาหกรรม เรื่องมาตรการคุ้มครองความปลอดภัยในการประกอบกิจการโรงงาน เกี่ยวกับสภาวะแวดล้อมในการทำงาน พ.ศ. 2546</u>

❖ <u>การตรวจวัดความร้อนในสถานประกอบการ</u>

บริษัท โกลว์ เอสพีพี 11 จำกัด	ตำแหน่งตรวจวัด	พารามิเตอร์	ความถี่
โครงการ 1	1. บริเวณเครื่องกำเนิดไฟฟ้าแบบกังหันก๊าซ 2. บริเวณเครื่องกำเนิดไฟฟ้าแบบกังหันไอน้ำ 3. บริเวณเครื่องกำเนิดไฟฟ้าแบบเครื่องยนต์ก๊าซ 4. บริเวณหน่วยผลิตไอน้ำ	- WBGT	ทุก 6 เดือน

<u>ผลการตรวจวัดฯ ทุทุกสถานีมีค่าไม่เกินกำหนดตามกฎกระทรวงแรงงาน กำหนดมาตรฐานในการบริหารจัดการ และดำเนินการด้านความปลอดภัย อาชีวอนามัยและสภาพแวดล้อมในการทำงานเกี่ยวกับความร้อน แสงสว่าง และเสียง พ.ศ. 2559</u>

❖ <u>การตรวจวัดความเข้มของแสงในสถานประกอบการ</u>

บริษัท โกลว์ เอสพีพี 11 จำกัด	ตำแหน่งตรวจวัด	พารามิเตอร์	ความถี่
โครงการ 1	1. บริเวณอาคารสำนักงาน 2. บริเวณพื้นที่กระบวนการผลิต 3. พื้นที่ทั่วไป	- Lux	ทุก 6 เดือน

<u>ผลการตรวจวัดฯ ทุกสถานีมีค่าไม่เกินกำหนดตามประกาศกรมสวัสดิการและคุ้มครองแรงงาน เรื่องมาตรฐานความเข้มของแสงสว่าง พ.ศ. 2561</u>

<table>
<tr><th>ลำดับที่</th><th>รายละเอียด</th><th>หมายเหตุ</th></tr>
<tr><td>3.2
(ต่อ)</td><td>❖ <u>คุณภาพอากาศในสถานประกอบการ (สารเคมี)</u>
<table>
<tr><th>บริษัท โกลว์ เอสพีพี 11 จำกัด</th><th>ตำแหน่งตรวจวัด</th><th>พารามิเตอร์</th><th>ความถี่</th></tr>
<tr><td>โครงการ 2</td><td>1. ภายในพื้นที่โครงการ</td><td>- สารเคมีต่างๆ ภายในสถานประกอบการ</td><td>2 ครั้ง/ปี
(มาตรการกำหนด ปีละ 1 ครั้ง)</td></tr>
</table>
<u>ผลการตรวจวัดฯ ทุกพารามิเตอร์ไม่เกินค่าที่กำหนดตามประกาศกรมสวัสดิการและคุ้มครองแรงงาน เรื่อง ขีดจำกัดความเข้มข้นของสารเคมีอันตราย พ.ศ. 2560</u>

ด้านสังคม-เศรษฐกิจ
ดำเนินการสำรวจสภาพสังคม-เศรษฐกิจ และความคิดเห็น ในช่วงระหว่างวันที่ 7-8 กันยายน พ.ศ. 2566

ตำแหน่งชุมชนรอบพื้นที่โรงไฟฟ้าในรัศมี 5 กิโลเมตร

ตำแหน่งชุมชนรอบพื้นที่โรงไฟฟ้าในรัศมี 5 กิโลเมตร
<u>มติที่ประชุม</u>
ที่ประชุมรับทราบ</td><td>รายละเอียดตามเอกสารประกอบการประชุม เมื่อวันที่ 19 เมษายน พ.ศ. 2567</td></tr>
<tr><td>3.3</td><td>❑ <u>ผลการดำเนินงานด้านชุมชนสัมพันธ์ และความรับผิดชอบต่อสังคม ประจำปี พ.ศ. 2566</u>
➢ นายวสันต์ สุสุนทร ผู้แทนฝ่ายมวลชนสัมพันธ์ : นำเสนอข้อมูลดังต่อไปนี้
ผลการดำเนินงานด้านชุมชนสัมพันธ์ และความรับผิดชอบต่อสังคม ระหว่างเดือนมกราคมถึงเดือนธันวาคม พ.ศ. 2566 ประกอบด้วย
- ด้านการสร้างความสัมพันธ์ที่ยั่งยืน
- ด้านการยกระดับคุณภาพชีวิต
- ด้านสิ่งแวดล้อม
- ด้านการศึกษาและกีฬา
<u>มติที่ประชุม</u>
ที่ประชุมรับทราบ</td><td>รายละเอียดตามเอกสารประกอบการประชุม เมื่อวันที่ 19 เมษายน พ.ศ. 2567</td></tr>
</table>

วาระที่ 4 เรื่องสืบเนื่องเพื่อติดตาม

ลำดับที่	รายละเอียด	หมายเหตุ
4.1	❑ **การแต่งตั้งคณะกรรมการพหุภาคีร่วม และคณะกรรมการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โครงการโรงไฟฟ้าพลังความร้อนร่วม บริษัท โกลว์ เอสพีพี 11 จำกัด**	

➢ **นายวสันต์ สุสุนทร ผู้แทนฝ่ายมวลชนสัมพันธ์:** นำเสนอข้อมูลดังนี้

การดำรงตำแหน่งของคณะกรรมการพหุภาคีร่วมติดตามตรวจสอบการดำเนินงานของโครงการโรงไฟฟ้าพลังความร้อนร่วม (ระยะดำเนินการ) บริษัท โกลว์ เอสพีพี 11 จำกัด ทั้งโครงการ 1 และโครงการ 2 ที่ผ่านมาได้หมดวาระแล้ว ปัจจุบันอยู่ระหว่างการสรรหาเพื่อนำเสนอแต่งตั้งต่อไป

ประเด็น

1. คณะกรรมการพหุภาคีร่วมติดตามตรวจสอบการดำเนินงาน โครงการโรงไฟฟ้าโกลว์เอสพีพี 11 โครงการ2 ในส่วนของภาคประชาชน ได้ครบวาระครั้งที่ 2 เมื่อ 17 สิงหาคม 2558 และยังไม่ได้มีการต่อวาระ ต้องการจะให้คณะกรรมการของโครงการ 2 ที่ครบวาระแล้ว ยังดำรงตำแหน่งต่อไป มีผลจนถึง 3 มีนาคม 2561 เพื่อให้ครบวาระพร้อมกับคณะกรรมการโครงการที่ 1 แล้วจึงขอมติให้แต่งตั้งคณะกรรมการวันเดียวกันทั้ง 2 โครงการ

ข้อเท็จจริง :

1) คณะกรรมการพหุภาคีร่วมติดตามตรวจสอบการดำเนินงาน โรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ2
- มีวาระการดำรงตำแหน่ง 2 ปี ไม่เกิน 2 วาระติดต่อกัน (ผู้แทนหน่วยงานราชการดำรงตำแหน่งตลอดช่วงอายุการทำงาน)
- คณะกรรมการพหุภาคีฯ (โครงการ2) เริ่มแต่งตั้งครั้งแรก เมื่อวันที่ 18 สิงหาคม 2554
- ครบวาระที่ 1 เมื่อ 17 สิงหาคม 2556 และมติที่ประชุมให้ดำรงตำแหน่งต่อไปอีกวาระ จนครบวาระที่ 2 เมื่อ 17 สิงหาคม 2558

2) คณะกรรมการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โรงไฟฟ้าโกลว์ เอสพีพี 11 โครงการ1
- มีวาระการดำรงตำแหน่ง 4 ปี ไม่เกิน 2 วาระติดต่อกัน
- คณะกรรมการพหุภาคีฯ (โครงการ1) เริ่มแต่งตั้งครั้งแรก เมื่อวันที่ 4 มีนาคม 2557
- ครบวาระที่ 1 ในวันที่ 3 มีนาคม 2561
- ครบวาระที่ 2 ในวันที่ 3 มีนาคม 2565

2. ปัจจุบัน โรงไฟฟ้าโกลว์เอสพีพี 11 มีการจัดทำรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม (EIA) 2 ฉบับ และมีการแต่งตั้งคณะกรรมการพหุภาคีไม่พร้อมกัน และวาระการดำรงตำแหน่งของทั้ง 2 คณะ มีระยะเวลาไม่เท่ากัน จึงขอมติที่ประชุมแก้ไขระเบียบเรื่องวาระการดำรงตำแหน่งของคณะกรรมการฯ โครงการ2 จาก วาระละ 2 ปี เป็น วาระละ 4 ปี ติดต่อกันไม่เกินสองวาระ

3. ขอมติที่ประชุมปรับปรุงจำนวนคณะกรรมการภาคประชาชนทั้ง 2 คณะ ที่มีการซ้ำซ้อนกัน ให้เป็นตัวแทนของแต่ละตำบล โดยไม่ซ้ำซ้อนกัน ตามตารางดังนี้

	รายละเอียด	GSPP 11		GSPP 11	หมายเหตุ
		โครงการ 1 (เดิม)	โครงการ 2 (เดิม)	**โครงการ 1 + 2**	
1	ชื่อคณะกรรมการ	คณะกรรมการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม	คณะกรรมการพหุภาคีร่วมติดตามตรวจสอบการดำเนินงาน	คณะกรรมการพหุภาคีร่วมติดตามตรวจสอบการดำเนินงานผลกระทบสิ่งแวดล้อม	
2	**จำนวนกรรมการ**	**20 คน**	**29 คน**	**35 คน**	
2.1	จำนวนกรรมการ **ภาครัฐ**	* 5 คน	* 15 คน	* 13 คน	• นายอำเภอปลวกแดงเป็นประธาน
2.2	จำนวนกรรมการภาคประชาชน	13 คน -ม.1 **ต.ตาสิทธิ์ (2คน)** -ม.3 ม 7 **ต.ป่อวิน(3คน)** -ม.4 **ต.ปลวกแดง(2คน)** -ม.2,3,4,6 **ต.มาบยางพร (6คน)**	9 คน -ม.3 ม 7 **ต.ป่อวิน (3คน)** -ม.4 **ต.ปลวกแดง (3คน)** -ม.2,3 **ต.มาบยางพร (3 คน)**	15 คน -ม.1 ต.ตาสิทธิ์ **(2คน)** -ม.4 ต.ปลวกแดง **(3คน)** -ม.2,3,4,6 ต.มาบยางพร **(6คน)** -ม.3 ม.6 ม 7 ต.ป่อวิน **(4คน)**	**(จำนวนกรรมการ)**
2.3	องค์กรอื่นๆ	-	2 คน	4 คน -ประธานชมรมกำนัน ผู้ใหญ่บ้าน อ.ปลวกแดง -ประธานชมรมกำนัน ผู้ใหญ่บ้าน อ .ศรีราชา -กรรมาธิการทรัพยากรธรรมชาติและสิ่งแวดล้อม วุฒิสภา -ผู้ทรงคุณวุฒิด้านการเกษตร	
2.4	ตัวแทนโรงไฟฟ้า	2 คน	3 คน	3 คน	
3	วาระการดำรงตำแหน่ง	4 ปี ไม่เกิน 2 วาระติดต่อกัน	2 ปี ไม่เกิน 2 วาระติดต่อกัน	* 4 ปี ไม่เกิน 2 วาระติดต่อกัน	
4	การเปลี่ยนแปลงระเบียบ	มติของคณะกรรมการ	มติ 2 ใน 3 ของคณะกรรมการที่เข้าประชุม	มติ 2 ใน 3 ของ คณะกรรมการที่เข้าประชุม	
5	ระยะเวลาการประชุม	ทุกๆ 6 เดือน	ทุกๆ 6 เดือน	ไม่น้อยกว่า ปีละ 2 ครั้ง	

	โดยการสรรหาคณะกรรมการภาคประชาชนชุดใหม่จะใช้วิธีการสรรหาโดยนายอำเภอปลวกแดงและนายอำเภอศรีราชา เป็นผู้ดำเนินการและแจ้งให้บริษัทฯทราบต่อไป **<u>มติที่ประชุม</u>** ที่ประชุมรับทราบ	

<u>วาระที่ 5 เรื่องเพื่อพิจารณา</u>

ลำดับที่	รายละเอียด	หมายเหตุ
5.1	❑ **<u>โครงการก่อสร้างโรงไฟฟ้าใหม่ทดแทนโรงไฟฟ้าเดิม และการเปลี่ยนแปลงรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม ของบริษัท โกลว์ เอสพีพี 11 จำกัด</u>** ➢ **คุณพจณีย์ ปานธรรม ผู้จัดการโครงการ :** นำเสนอข้อมูลดังต่อไปนี้ **ความเป็นมาของโรงไฟฟ้าพลังความร้อนร่วม (โครงการปัจจุบัน)** 1) ปี พ.ศ. 2543 เริ่มเปิดดำเนินการผลิตไฟฟ้า 2) โครงการปัจจุบันตั้งอยู่ในเขตประกอบการอุตสาหกรรมสยาม อีสเทิร์น อินดัสเตรียล พาร์ค ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 3) โครงการปัจจุบันจำหน่ายกระแสไฟฟ้าให้กับการไฟฟ้าฝ่ายผลิตแห่งประเทศไทย (กฟผ.) เป็นหลัก และจำหน่ายกระแสไฟฟ้าส่วนที่เหลือให้กับโรงงานอุตสาหกรรมที่อยู่บริเวณใกล้เคียง 4) ปัจจุบันมีหน่วยผลิตไฟฟ้าแบบกังหันก๊าซและแบบกังหันไอน้ำ จำนวน 1 ชุด และเครื่องผลิตไฟฟ้าแบบเครื่องยนต์ก๊าซ จำนวน 6 ชุด (ใช้ก๊าซธรรมชาติเป็นเชื้อเพลิง) **มีกำลังการผลิตไฟฟ้าโดยรวม 164 เมกะวัตต์** **ประเด็นเปลี่ยนแปลงรายละเอียดโครงการครั้งนี้** มี 2 ประเด็นหลักดังนี้ 1) **ยกเลิกและหยุดการผลิตไฟฟ้าหน่วยผลิตไฟฟ้าแบบกังหันก๊าซและแบบกังหันไอน้ำ (กำลังการผลิตไฟฟ้า 121 เมกะวัตต์) เนื่องจากหมดสัญญาจำหน่ายไฟฟ้าให้กับ กฟผ. (หมดสัญญาภายในปี พ.ศ. 2568) และเป็นหน่วยผลิตไฟฟ้าที่ใช้งานมาประมาณ 25 ปี โดยที่โครงการจะดำเนินการรื้อถอน 1 ชุด และนำมาใช้เป็นชุดสำรอง 1 ชุด** 2) **ติดตั้งเครื่องผลิตไฟฟ้าแบบเครื่องยนต์ก๊าซ (Gas Engine Generator; GEG) เพิ่มเติม จำนวน 2 ชุด (GEG 7-8) ที่กำลังการผลิตไฟฟ้า 15.6 เมกะวัตต์ (เครื่องละ 7.8 เมกะวัตต์)**	

ลำดับที่	รายละเอียด	หมายเหตุ
5.1 (ต่อ)		

หน่วยผลิตไฟฟ้าและกำลังการผลิตไฟฟ้าของโครงการก่อนและหลังเปลี่ยนแปลงรายละเอียดโครงการ

หน่วยผลิตไฟฟ้าของโครงการ	กำลังการผลิตติดตั้งโดยรวม (เมกะวัตต์)	
	โครงการปัจจุบัน	เมื่อเปลี่ยนแปลงรายละเอียดโครงการ
1. หน่วยผลิตไฟฟ้าแบบพลังความร้อนร่วม	121	81
1.1 หน่วยผลิตไฟฟ้าแบบกังหันก๊าซ (GTG) ขนาด 40 เมกะวัตต์ จำนวน 2 ชุด	80	40 ใช้เป็นหน่วยผลิตไฟฟ้าสำรอง 1 ชุด และรื้อถอน 1 ชุด
1.2 หน่วยผลิตไฟฟ้าแบบ HRSG จำนวน 2 ชุด	-	ใช้เป็นหน่วยผลิตไฟฟ้าสำรอง 1 ชุด และรื้อถอน 1 ชุด
1.3 หน่วยผลิตไฟฟ้าแบบกังหันไอน้ำ (STG) ขนาด 41 เมกะวัตต์ จำนวน 1 ชุด	41	41 ใช้เป็นหน่วยผลิตไฟฟ้าสำรอง
2. หน่วยผลิตไฟฟ้าแบบเครื่องยนต์ก๊าซ (GEG 1-4)	23	23
3. หน่วยผลิตไฟฟ้าแบบเครื่องยนต์ก๊าซ (GEG 5-6)	20	20
4. หน่วยผลิตไฟฟ้าแบบเครื่องยนต์ก๊าซ (GEG 7-8)	-	20
กำลังการผลิตไฟฟ้าโดยรวม	164	144

แผนการดำเนินการก่อสร้างเครื่องยนต์ก๊าซ (GEG7-8)

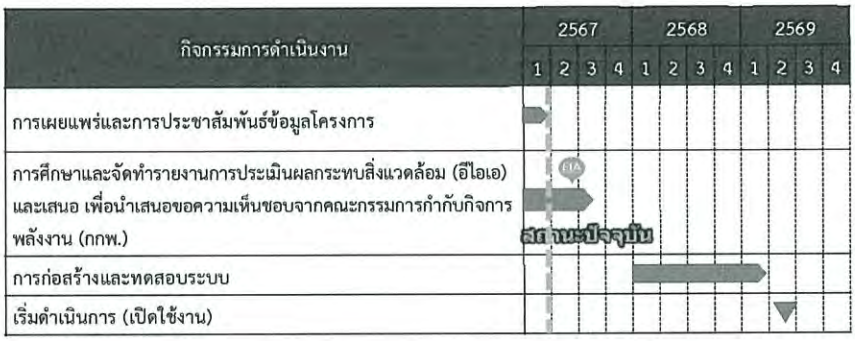

<u>หมายเหตุ</u> : เริ่มพัฒนาโครงการในส่วนที่เปลี่ยนแปลงหลังรายงานการประเมินผลกระทบสิ่งแวดล้อม (อีไอเอ) ได้รับความเห็นชอบจากหน่วยงานอนุญาตที่เกี่ยวข้องเท่านั้น

สรุปรายละเอียดโครงการก่อนและหลังเปลี่ยนแปลง

รายละเอียด	หน่วย	ปัจจุบัน	ภายหลังการเปลี่ยนแปลง	ระดับผลกระทบ
<u>รายละเอียดโครงการ</u>				
พื้นที่ของโครงการ	ไร่	29.2	ไม่เปลี่ยนแปลงจากเดิม	-
กำลังการผลิตไฟฟ้า	เมกกะวัตต์	164	58.6 (ลดลง 105.4)	↓
ปริมาณน้ำใช้	ลูกบาศก์เมตร	5,216.8	ลดลงจากเดิม	↓
ปริมาณน้ำทิ้ง	ลูกบาศก์เมตร	1,220	ลดลงจากเดิม	↓
การระบายมลสารทางอากาศ	กรัมต่อวินาที	- ก๊าซออกไซด์ของไนโตรเจน 31.48 - ก๊าซซัลเฟอร์ไดออกไซด์ 2.18 - ฝุ่นละออง 1.60	ลดลงจากเดิม	↓

<u>มติที่ประชุม</u>

ที่ประชุมรับทราบ

<u>วาระที่ 6 เรื่องอื่นๆ</u>

ลำดับที่	รายละเอียด	หมายเหตุ
6.1	❑ <u>กองทุนพัฒนาไฟฟ้าระยอง 1</u> ➢ **นายวสันต์ สุสุนทร ผู้แทนฝ่ายมวลชนสัมพันธ์** : นำเสนอข้อมูลดังต่อไปนี้ - เดือนมกราคม ถึงเดือนธันวาคม 2566 โรงไฟฟ้า โกลว์ เอสพีพี 11 สมทบเงินเข้ากองทุนพัฒนาไฟฟ้า จ.ระยอง 1 เป็นเงินจำนวน 15,395,319.52 บาท (ข้อมูลสิ้นสุด ณ วันที่ 31 ธันวาคม 2566)	

นายวสันต์ สุสุนทร

ผู้บันทึกรายงานการประชุม

ภาคผนวก ข-17

แผนผังแสดงตำแหน่งการติดตั้งระบบป้องกันและ
เตือนภัยของโรงไฟฟ้า

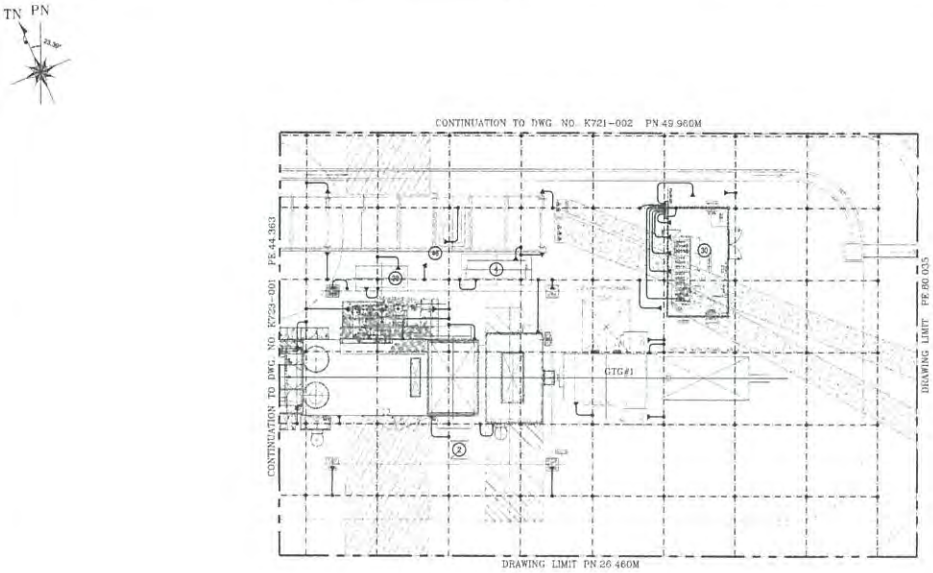

GROUNDING LAYOUT GTG#1 AREA

SCALE 1:100

GENERAL NOTES

1) THE GROUNDING LAYOUT SHOWN IS DIAGRAMATIC ONLY AND MAY BE MODIFIED MARGINALLY TO SUIT SITE CONDITION.
2) ALL EQUIPMENT EVEN IF NOT SPECIFICALLY SHOWN IN THIS DRAWING SHALL BE GROUNDED WITH APPROPRIATE CONDUCTOR SIZE AS SPECIFIED.
3) THE GROUNDING SYSTEM SHALL COMPLY TO LOCAL CODES OF PRACTICE AND STANDARDS.
4) OVERALL RESISTANCE TO GROUND SHALL BE LESS THAN 5.0 OHMS.
5) THE LOCATION OF EARTH PIT IS INDICATIVE ONLY. THE CONTRACTOR SHALL CONSULT THE SITE ENGINEER FOR EXACT LOCATION OF EARTH PIT.
6) AT THE EARTHING INSPECTION PIT THE CONDUCTOR SHALL BE LUG CRIMPED AND CONNECTED TO AN EARTH BAR INSIDE THE PIT.
7) ALL TAPS AND CROSSING SHALL BE EXOTHERMIC WELDED.
8) THE GRID CONDUCTOR SHALL BE LAID AT A LEVEL OF 600mm BELOW GRADE LEVEL WHENEVER EQUIPMENT FOUNDATION BECOME A POINT OF INTERFACE, THE CONDUCTOR SHALL BE PASS THROUGH THE FOUNDATION.
9) GRID CONDUCTOR WHICH ARE LAID THROUGH THE FOUNDATION SHALL BE EXOTHERMIC WELDED AT TWO POINTS WITH THE REINFORCED STEEL REBAR.
10) ALL CONNECTION TO THE STRUCTURE AND EQUIPMENT SHALL BE BOLTED TYPE. THE CONNECTIONS BETWEEN CONDUCTOR AND LUG SHALL BE CRIMPED TYPE.
11) ALL RIGID MOUNTED EQUIPMENT PACKAGES SHALL BE GROUNDED AT THE SKID BASE FRAME.
12) THE LIGHTNING PROTECTION SYSTEM SHOULD BE BONDED TO MAIN GRID EARTHING SYSTEM.
13) FOR DETAIL GROUNDING OF INDIVIDUAL AREA/EQUIPMENT REFER TO THE GROUNDING DRAWINGS OF RESPECTIVE AREA AS POINTED IN THE REFERENCES DRAWINGS HERE.
14) THE INTERNAL GROUNDING SYSTEM (INSTRUMENT GROUND OF CONTROL PANELS SHALL BE SEPARATED FROM PANEL BODY GROUND. THE INSTRUMENT GROUNDING CONDUCTOR SHALL BE LAID IN DIRECT TO CONNECT WITH THE INSTRUMENT GROUNDING SYSTEM AND THE PANEL BODY GROUND SHALL BE CONNECTED TO THE PLANT GROUNDING SYSTEM.
15) ALL DIMENSION ARE IN MM UNLESS OTHERWISE SPECIFIED.

GENERAL LEGEND

SYMBOL	DESCRIPTION
— · — · —	70sq.mm BARE COPPER GROUND CONDUCTOR UNLESS OTHERWISE SPECIFIED.
———	35sq.mm BARE COPPER GROUND CONDUCTOR
	95sq.mm BARE COPPER GROUND CONDUCTOR
	GROUNDING BUSBAR 25mm (W) x 5mm (TH)
▲	GROUND CONNECTION TO EQUIPMENT OR STEEL COLUMN
★	EXOTHERMAL WELD CONNECTION
ⓣ	EARTH ROD WITHOUT EARTH PIT
☒	EARTH ROD WITH EARTH PIT FOR INSPECTION

DESCRIPTION OF ITEM TO BE GROUNDED	CABLE SIZE
MOTORS (MD)	95mm2 Al. 4sq.mm - 70sq.mm
STEEL STRUCTURES	70sq.mm
INSTRUMENT SUPPORTS	35sq.mm

REFERENCE DRAWINGS

1)	30309-0107-001 GROUNDING GRID CALCULATION
2)	30309-0121-001 EQUIPMENT PLANT LAYOUT
3)	30309-0707-001 MAIN GROUNDING GRID LAYOUT
4)	30309-0723-001 GROUNDING LAYOUT FOR HRSG#1 AREA
5)	30309-0721-001 GROUNDING LAYOUT FOR GTG#1 AREA
6)	30309-0723-002 GROUNDING LAYOUT FOR HRSG#2 AREA
7)	30309-0724-001 GROUNDING LAYOUT FOR STG AREA
8)	30309-0725-001 GROUNDING LAYOUT FOR ELECTRICAL ROOMS & TRANSFORMER AREA
9)	30309-0725-002 GROUNDING LAYOUT FOR COOLING TOWER AREA
10)	30309-0725-003 GROUNDING LAYOUT FOR GAS COMPRESSOR AREA
11)	30309-0725-004 GROUNDING LAYOUT FOR CHILLER BUILDING AREA
12)	30309-0725-005 GROUNDING LAYOUT FOR WATER TREATMENT AREA AND WORKSHOP BUILDING AREA

ITEM	DESCRIPTION
1	GT DRAIN PIT
2	GT CO2 BOTTLE BANK
3	GT SWITCHGEAR
4	SPRINT VALVE BAD
5	SPRINT PUMP BAD

AS BUILT

REV.	DATE	DESCRIPTION	DRAWN	DESIGNED	CHECKED	APPROVED	STATUS
1	03-01-13	AS-BUILT	NW	JEL/PP	SYLVA	NAUSHAD	AB
0	29-04-11	REVISED AS PER MAIN GROUNDING GRID UPDATED AND ISSUED FOR CONSTRUCTION	MARDI	MARDI	SELVA	NAUSHAD	C
A	29-11-10	ISSUE FOR INFORMATION	MARDI	MARDI	SELVA	NAUSHAD	I

SCALE 1 : 100

CLIENT : THAI NATIONAL POWER 2 Co.LTD.

PROJECT : THAI NATIONAL POWER 2 SPP POWER PROJECT

TITLE : GROUNDING LAYOUT GTG#1 AREA

IHI POWER SYSTEMS DIV PROJECT DEPT

JEL JURONG ENGG. LTD. ENGINEERING DEPT

JOB NO. 30308 SHEET 11

DRAWING NO. K721-001 REV. 1

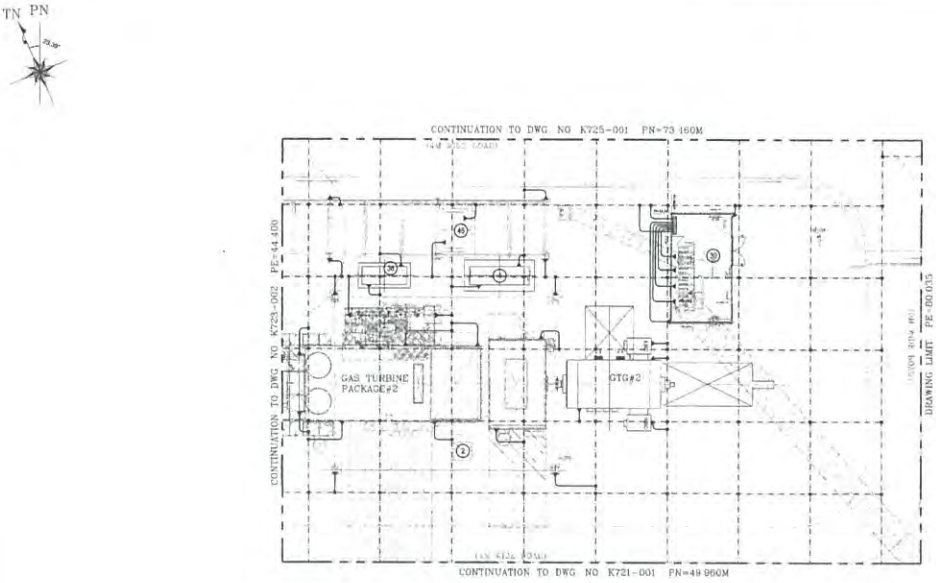

GROUNDING LAYOUT GTG#2 AREA

SCALE 1:100

KEY PLAN



GENERAL NOTES

1) THE GROUNDING LAYOUT SHOWN IS DIAGRAMATIC ONLY AND MAY BE MODIFIED MARGINALLY TO SUIT SITE CONDITION.
2) ALL EQUIPMENT EVEN IF NOT SPECIFICALLY SHOWN IN THIS DRAWING SHALL BE GROUNDED WITH APPROPRIATE CONDUCTOR SIZE AS SPECIFIED.
3) THE GROUNDING SYSTEM SHALL COMPLY TO LOCAL CODES OF PRACTICE AND STANDARDS.
4) OVERALL RESISTANCE TO GROUND SHALL BE LESS THAN 5.0 OHMS.
5) THE LOCATION OF EARTH PIT IS INDICATIVE ONLY. THE CONTRACTOR SHALL CONSULT THE SITE ENGINEER FOR EXACT LOCATION OF EARTH PIT.
6) AT THE EARTHING INSPECTION PIT THE CONDUCTOR SHALL BE LUG CRIMPED AND CONNECTED TO AN EARTH BAR INSIDE THE PIT.
7) ALL TAPS AND CROSSING SHALL BE EXOTHERMIC WELDED.
8) THE GRID CONDUCTOR SHALL BE LAID AT A LEVEL OF 600mm BELOW GRADE LEVEL WHENEVER EQUIPMENT FOUNDATION BECOME A POINT OF INTERFACE, THE CONDUCTOR SHALL BE PASS THROUGH THE FOUNDATION.
9) GRID CONDUCTOR WHICH ARE LAID THROUGH THE FOUNDATION SHALL BE EXOTHERMIC WELDED AT TWO POINTS WITH THE REINFORCED STEEL REBAR.
10) ALL CONNECTION TO THE STRUCTURE AND EQUIPMENT SHALL BE BOLTED TYPE. THE CONNECTIONS BETWEEN CONDUCTOR AND LUG SHALL BE CRIMPED TYPE.
11) ALL RIGID MOUNTED EQUIPMENT PACKAGES SHALL BE GROUNDED AT THE SKID BASE FRAME.
12) THE LIGHTNING PROTECTION SYSTEM SHOULD BE BONDED TO MAIN GRID EARTHING SYSTEM.
13) FOR DETAIL GROUNDING OF INDIVIDUAL AREA/EQUIPMENT REFER TO THE GROUNDING DRAWINGS OF RESPECTIVE AREA AS POINTED IN THE REFERENCES DRAWINGS HERE.
14) THE INTERNAL GROUNDING SYSTEM (INSTRUMENT GROUND OF CONTROL PANELS SHALL BE SEPARATED FROM PANEL BODY GROUND. THE INSTRUMENT GROUNDING CONDUCTOR SHALL BE LAID IN DIRECT TO CONNECT WITH THE INSTRUMENT GROUNDING SYSTEM AND THE PANEL BODY GROUND SHALL BE CONNECTED TO THE PLANT GROUNDING SYSTEM.
15) ALL DIMENSION ARE IN MM UNLESS OTHERWISE SPECIFIED.

GENERAL LEGEND

SYMBOL	DESCRIPTION
— · — · —	70sq.mm BARE COPPER GROUND CONDUCTOR UNLESS OTHERWISE SPECIFIED.
———	35sq.mm BARE COPPER GROUND CONDUCTOR
	95sq.mm BARE COPPER GROUND CONDUCTOR
	GROUNDING BUSBAR 25mm (W) x 5mm (TH)
▲	GROUND CONNECTION TO EQUIPMENT OR STEEL COLUMN
★	EXOTHERMAL WELD CONNECTION
ⓣ	EARTH ROD WITHOUT EARTH PIT
☒	EARTH ROD WITH EARTH PIT FOR INSPECTION

DESCRIPTION OF ITEM TO BE GROUNDED	CABLE SIZE
MOTORS (MD)	95mm2 Al. 4sq.mm - 70sq.mm
STEEL STRUCTURES	70sq.mm
INSTRUMENT SUPPORTS	35sq.mm

REFERENCE DRAWINGS

1)	30309-0107-001 GROUNDING GRID CALCULATION
2)	30309-0121-001 EQUIPMENT PLANT LAYOUT
3)	30309-0707-001 MAIN GROUNDING GRID LAYOUT
4)	30309-0727-001 GROUNDING LAYOUT FOR GTG#2 AREA
5)	30309-0723-001 GROUNDING LAYOUT FOR HRSG#1 AREA
6)	30309-0723-002 GROUNDING LAYOUT FOR HRSG#2 AREA
7)	30309-0724-001 GROUNDING LAYOUT FOR STG AREA
8)	30309-0725-001 GROUNDING LAYOUT FOR ELECTRICAL ROOMS & TRANSFORMER AREA
9)	30309-0725-002 GROUNDING LAYOUT FOR COOLING TOWER AREA
10)	30309-0725-003 GROUNDING LAYOUT FOR GAS COMPRESSOR AREA
11)	30309-0725-004 GROUNDING LAYOUT FOR CHILLER BUILDING AREA
12)	30309-0725-005 GROUNDING LAYOUT FOR WATER TREATMENT AREA AND WORKSHOP BUILDING AREA

ITEM	DESCRIPTION
1	GT DRAIN PIT
2	GT CO2 BOTTLE BANK
3	GT SWITCHGEAR
4	SPRINT VALVE BAD
5	SPRINT PUMP BAD

AS BUILT

REV.	DATE	DESCRIPTION	DRAWN	DESIGNED	CHECKED	APPROVED	STATUS
1	03-01-13	AS-BUILT	NW	JEL/PP	SYLVA	NAUSHAD	AB
0	06-06-11	REVISED AS PER MAIN GROUNDING GRID UPDATED AND ISSUED FOR CONSTRUCTION	MARDI	MARDI	SELVA	NAUSHAD	C
A	29-11-10	ISSUE FOR INFORMATION	MARDI	MARDI	SELVA	NAUSHAD	I

SCALE 1 : 100

CLIENT : THAI NATIONAL POWER 2 Co.LTD.

PROJECT : THAI NATIONAL POWER 2 SPP POWER PROJECT

TITLE : GROUNDING LAYOUT GTG#2 AREA

IHI POWER SYSTEMS DIV PROJECT DEPT

JEL JURONG ENGG. LTD. ENGINEERING DEPT

JOB NO. 30308 SHEET A1

DRAWING NO. K721-002 REV. 1

ภาคผนวก ข-18

ตัวอย่างเอกสารการตรวจสอบอุปกรณ์ชำระล้างฉุกเฉิน

GPSC
JAN 2024

Eye wash & shower

EHS Monthly Inspection
GSPP11 (Plant 2)

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	1-1-24	Page : 1/1
	Inspector	Parinya	(OPS)

Week 1

Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	9-01-24	Page : 1/1
	Inspector	Artit	(OPS)

Week 2

Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

\\thbws002.glow.co.th\Groups\Grp_Pool\EKW\08.Safety\22.EHS Monthly Report\Form\Plant 2\P2_Eye wash and Shower inspection_R5_19Dec2020.docx

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	16-01-23	Page : 1/1
	Inspector	Antit	(OPS)

Week 3				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	23/01/2024	Page : 1/1
	Inspector	Arnon C.	(OPS)

Week 4				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	31/01/2024	Page : 1/1
	Inspector	Arnon C.	(OPS)

Week 5				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GPSC

MAR 2024

EHS Monthly Inspection GSPP11 (Plant 2)

Eye wash & shower

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	5-3-24	Page : 1/1
	Inspector	Natthaphong	(OPS)

Week 1				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	12-3-24	Page : 1/1
	Inspector	Natthaphong	(OPS)

Week 2				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	19-3-24	Page : 1/1
	Inspector	Natthaphong	(OPS)

Week 3				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

Eye wash & shower

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	26 - 3 - 24	Page : 1/1
	Inspector	Pornchai T.	(OPS)

Week 4				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	7/5/24	Page : 1/1
	Inspector	Pakungsit.	(OPS)

Week 1				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	14/5/24	Page : 1/1
	Inspector	Pakorn t.	(OPS)

Week 2				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	21/5/24	Page : 1/1
	Inspector	Pakorn t.	(OPS)

Week 3				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

GSPP11 Plant 2 Eye wash and Shower inspection

GPSC	Job Title	Eye wash & Shower	Rev no.5
	Period of Inspection	Weekly	Rev date : 19 Dec 2020
	Inspection date	28-5-24	Page : 1/1
	Inspector	จิตรา	(OPS)

Week 4				
Item.	Location	Inspection criteria	Result	Remark
1.	Boiler chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
2.	Cooling tower chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	
3.	Water treatment plant chemical area	Overall condition in good condition	S	
		Inlet valve must open	S	
		Pressure of water outlet. (enough to clean)	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

ภาคผนวก ข-19

ตัวอย่างเอกสารการตรวจสอบอุปกรณ์ดับเพลิง

Fire Hydrant

GSPP11 Plant 2 Fire fighting equipment inspection

GPSC	Job Title	Fire Hydrant (FH)	Rev no.5
	Period of Inspection	Monthly	Rev date : 19 Dec 2020
	Inspection date	9-1-24	
	Inspector	Parinya	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
1.	FH-1 Side of PTT Gas metering.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
2.	FH-2 Behind HRSG1 stack.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
3.	FH-3 Behind steam turbine.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
4.	FH-4 Behind GT2.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
5.	FH-5 Behind cooling tower.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

.....

\\thbws002.glow.co.th\Groups\Grp_Pool\EKW\08.Safety\22.EHS Monthly Report\Form\Plant 2\P2_Fire hydrant_R5_19Dec2020.docx

Fire hose system

GSPP11 Plant2 Firefighting equipment inspection

GPSC	Job Title	Fire hose system	Rev no.8
	Period of Inspection	Monthly	Rev Date : 19 Dec 2020
	Inspection date	9-1-24	Page : 1/2
	Inspector	Parinya	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
1.	FH-1 Side of PTT Gas metering.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	-	
2.	FH-2 Behind HRSG1 stack.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	-	
3.	FH-3 Behind steam turbine.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 1.5" 2 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	-	

\\thbws002.glow.co.th\Groups\Grp_Pool\EKW\08.Safety\22.EHS Monthly Report\Form\Plant 2\P2_Fire hose system_R8_19Dec2020.docx

GSPP11 Plant2 Firefighting equipment inspection

GPSC	Job Title	Fire hose system	Rev no.8
	Period of Inspection	Monthly	Rev Date : 19 Dec 2020
	Inspection date	3-1-24	Page : 2/2
	Inspector	Parinya	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
4.	FH-4 Behind GT2	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	-	
5.	FH-5 Behind cooling tower	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hoses in good condition	S	
		Fire hose 1.5" 1 hoses in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	-	
6	FHC-1 Work shop	Overall cabinet in good condition, no corrosion, no rusty	S	
		Automatic fire hose in good condition (Excise test in January and July)	-	
		No any obstruct	S	
7	FHC-2 Work shop office	Overall cabinet in good condition, no corrosion, no rusty	S	
		Automatic fire hose in good condition (Excise test in January and July)	-	[illegible]
		No any obstruct	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

\\thbws002.glow.co.th\Groups\Grp_Pool\EKW\08.Safety\22.EHS Monthly Report\Form\Plant 2\P2_Fire hose system_R8_19Dec2020.docx

Fire Hydrant

GSPP11 Plant 2 Fire fighting equipment inspection

GPSC	Job Title	Fire Hydrant (FH)	Rev no.5
	Period of Inspection	Monthly	Rev date : 19 Dec 2020
	Inspection date	8/2/24	
	Inspector	Chalwet	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
1.	FH-1 Side of PTT Gas metering.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
2.	FH-2 Behind HRSG1 stack.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
3.	FH-3 Behind steam turbine.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
4.	FH-4 Behind GT2.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
5.	FH-5 Behind cooling tower.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

.....

\\thbws002.glow.co.th\Groups\Grp_Pool\EKW\08.Safety\22.EHS Monthly Report\Form\Plant 2\P2_Fire hydrant_R5_19Dec2020.docx

Fire hose system

GPSC	Job Title	Fire hose system	Rev no.8
	Period of Inspection	Monthly	Rev Date : 19 Dec 2020
	Inspection date	8-3-2024	Page : 1/2
	Inspector	Chainat	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
1.	FH-1 Side of PTT Gas metering.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	–	
2.	FH-2 Behind HRSG1 stack.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	–	
3.	FH-3 Behind steam turbine.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 1.5" 2 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	–	

GPSC	Job Title	Fire hose system	Rev no.8
	Period of Inspection	Monthly	Rev Date : 19 Dec 2020
	Inspection date	8-3-2024	Page : 2/2
	Inspector	Chainat	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
4.	FH-4 Behind GT2	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	–	
5.	FH-5 Behind cooling tower	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hoses in good condition	S	
		Fire hose 1.5" 1 hoses in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	–	
6	FHC-1 Work shop	Overall cabinet in good condition, no corrosion, no rusty	S	
		Automatic fire hose in good condition (Excise test in January and July)	S	
		No any obstruct	S	
7	FHC-2 Work shop office	Overall cabinet in good condition, no corrosion, no rusty	S	
		Automatic fire hose in good condition (Excise test in January and July)	S –	ไม่ต่อสายฉีด
		No any obstruct	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

Fire Hydrant

GPSC	Job Title	Fire Hydrant (FH)	Rev no.5
	Period of Inspection	Monthly	Rev date : 19 Dec 2020
	Inspection date	1/5/24	
	Inspector	Pordungsit	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
1.	FH-1 Side of PTT Gas metering.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
2.	FH-2 Behind HRSG1 stack.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
3.	FH-3 Behind steam turbine.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
4.	FH-4 Behind GT2.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	
5.	FH-5 Behind cooling tower.	Overall no any leaked.	S	
		Branch valve were closed (hand wheel).	S	
		Outlet cap must plug.	S	
		Any seal in good condition.	S	
		Main inlet valve must open (after wheel).	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark.

Remark : .....

Fire hose system

GPSC	Job Title	Fire hose system	Rev no.8
	Period of Inspection	Monthly	Rev Date : 19 Dec 2020
	Inspection date	1/5/24	Page : 1/2
	Inspector	Padungsit.	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
1.	FH-1 Side of PTT Gas metering.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	—	
2.	FH-2 Behind HRSG1 stack.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	—	
3.	FH-3 Behind steam turbine.	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 1.5" 2 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	—	

GSPP11 Plant2 Firefighting equipment inspection

GPSC	Job Title	Fire hose system	Rev no.8
	Period of Inspection	Monthly	Rev Date : 19 Dec 2020
	Inspection date	1/5/24	Page : 2/2
	Inspector	Padungsit	(OPS)

Item.	Equipment	Inspection criteria	Result	Remark
4.	FH-4 Behind GT2	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hose in good condition	S	
		Fire hose 1.5" 1 hose in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	—	
5.	FH-5 Behind cooling tower	Overall cabinet in good condition, no corrosion, no rusty	S	
		1 Nozzle in good condition	S	
		Fire hose 2.5" 1 hoses in good condition	S	
		Fire hose 1.5" 1 hoses in good condition	S	
		Connecting wrench in good condition	S	
		1 axe in good condition	S	
		1 crowbar in good condition	S	
		No any obstruct	S	
		Exercise test in January and July	~~S~~	
6	FHC-1 Work shop	Overall cabinet in good condition, no corrosion, no rusty	S	
		Automatic fire hose in good condition (Excise test in January and July)	S	
		No any obstruct	S	
7	FHC-2 Work shop office	Overall cabinet in good condition, no corrosion, no rusty	S	
		Automatic fire hose in good condition (Excise test in January and July)	V	[illegible]
		No any obstruct	S	

* Result : S = Satisfy, U = Unsatisfied please give more detail in remark

Remark : .....

\\thbws002.glow.co.th\Groups\Grp_Pool\EKW\08.Safety\22.EHS Monthly Report\Form\Plant 2\P2_Fire hose system_R8_19Dec2020.docx

ภาคผนวก ข-20

เอกสารการขอใช้บริการยานพาหนะรับ-ส่งผู้ป่วยหรือผู้บาดเจ็บไว้รองรับในกรณีเกิดเหตุฉุกเฉิน

ทันฉบับ

ข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 4
สำหรับสัญญาบริการผู้ป่วยฉุกเฉิน
ฉบับลงวันที่ 26 ตุลาคม 2558 เลขที่ GLOW-OM-15-111

ทำที่นิคมอุตสาหกรรมมาบตาพุด จังหวัดระยอง

วันที่ 31 มี.ค. 2565

ข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 4 ของสัญญาบริการผู้ป่วยฉุกเฉิน เลขที่ GLOW-OM-15-111 ฉบับลงวันที่ 26 ตุลาคม 2558 ฉบับนี้ (ต่อไปในข้อตกลงนี้จะเรียกว่า "***ข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 4***") ทำขึ้นระหว่าง

1. **บริษัท โกลว์ พลังงาน จำกัด (มหาชน)**
บริษัท โกลว์ เอสพีพี 2 จำกัด
บริษัท โกลว์ เอสพีพี 3 จำกัด
บริษัท ไอพีพี จำกัด สำนักงานใหญ่ตั้งอยู่เลขที่ 1 อาคารเอ็มไพร์ ทาวเวอร์ ชั้น 38 พาร์ควิง ถนนสาทรใต้ แขวงยานนาวา เขตสาทร กรุงเทพมหานคร 10120
บริษัท เก็คโค่-วัน จำกัด สำนักงานใหญ่ตั้งอยู่เลขที่ 11 ถนนไอ-5 นิคมอุตสาหกรรมมาบตาพุด อำเภอเมือง จังหวัดระยอง 21150
บริษัท โกลว์ เอสพีพี 11 จำกัด สำนักงานแห่งใหญ่ตั้งอยู่เลขที่ 60/19 หมู่ 3 นิคมอุตสหากรรมสยามอินดัสเตรียลพาร์ค ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง 21140 และ
บริษัท โกลบอล เพาเวอร์ ซินเนอร์ยี่ จำกัด (มหาชน) สำนักงานใหญ่ตั้งอยู่เลขที่ 555/2 อาคารศูนย์เอนเนอร์ยี่คอมเพล็กซ์ อาคารบี ชั้นที่ 5 ถนนวิภาวดีรังสิต แขวงจตุจักร กรุงเทพมหานคร
ซึ่งต่อไปในข้อตกลงแก้ไขเพิ่มเติมฉบับนี้จะรวมเรียกว่า "**ผู้รับบริการ**" ฝ่ายหนึ่งกับ

2. **บริษัท โรงพยาบาลกรุงเทพระยอง จำกัด** สำนักงานเลขที่ 8 หมู่ที่ 2 ถนนแสงจันทร์เนรมิตร ตำบลเนินพระ อำเภอเมืองระยอง จังหวัดระยอง ซึ่งต่อไปในข้อตกลงแก้ไขเพิ่มเติมฉบับนี้จะเรียกว่า "**ผู้ให้บริการ**" อีกฝ่ายหนึ่ง

โดยที่คู่สัญญาทั้งสองฝ่ายได้ทำสัญญาบริการผู้ป่วยฉุกเฉิน เลขที่ GLOW-OM-15-111ฉบับลงวันที่ 26 ตุลาคม 2558 ข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 1 ลงวันที่ 14 กุมภาพันธ์ 2562 ข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 2 ลงวันที่ 20 มีนาคม 2562 และข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 3 ลงวันที่ 5 มิถุนายน 2563 ซึ่งต่อไปในข้อตกลงแก้ไขเพิ่มเติมฉบับนี้จะรวมเรียกว่า "***สัญญาบริการ***" เพื่อมาให้บริการรถฉุกเฉิน (Ambulance) กรณีเกิดเหตุฉุกเฉินกับพนักงานของผู้รับบริการ รวมทั้งการบริการเกี่ยวกับการให้คำปรึกษาด้านสุขภาพ ร่วมซ้อมแผนฉุกเฉิน และการจัดฝึกอบรมต่างๆ ให้แก่พนักงานของผู้รับบริการ ณ สถานที่ตั้งของผู้รับบริการนั้น

โดยที่คู่สัญญาทั้งสองฝ่ายตกลงให้ขยายระยะเวลาของสัญญาบริการ ดังนั้นสัญญาทั้งสองฝ่ายจึงตกลงทำข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 4 นี้ขึ้น โดยมีข้อความดังต่อไปนี้

ข้อ 1. คู่สัญญาทั้งสองฝ่ายตกลงให้ขยายระยะเวลาของสัญญาบริการออกไปจนถึงวันที่ 28 กุมภาพันธ์ 2568

ข้อ 2. ผู้ให้บริการจะต้องทำใบเรียกเก็บเงินโดยอ้างอิงเลขที่ใบสั่งซื้อ DA31019193 ทุกครั้งที่มีการเรียกเก็บเงินตามสัญญาบริการนี้

ข้อ 3. คู่สัญญาทั้งสองฝ่ายตกลงให้ข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 4 นี้ มีผลบังคับใช้นับตั้งแต่วันที่ 1 มีนาคม 2565 เป็นต้นไปจนกว่าระยะเวลาของสัญญาบริการจะสิ้นสุดลงตามที่กำหนดในข้อ 1

ข้อ 4. คู่สัญญาตกลงให้ถือว่าข้อตกลงแก้ไขเพิ่มเติมฉบับที่ 4 นี้เป็นส่วนหนึ่งของสัญญาบริการ โดยข้อตกลงและเงื่อนไขนอกเหนือจากที่ระบุในข้อตกลงแก้ไขเพิ่มเติมฉบับนี้แล้วคู่สัญญาทั้งสองฝ่ายตกลงให้เป็นไปตามเงื่อนไขและข้อตกลงเดิมที่ระบุในสัญญาบริการทุกประการ

ภาคผนวก ข-21

เอกสารแสดงเจ้าหน้าที่ความปลอดภัยประจำโรงไฟฟ้า

คำสั่ง บริษัท โกลว์ เอสพีพี 11 จำกัด

ที่ COO-024/66

เรื่อง แต่งตั้งเจ้าหน้าที่ความปลอดภัยในการทำงานและหัวหน้าหน่วยงานความปลอดภัย

ประจำ บริษัท โกลว์ เอสพีพี 11 จำกัด

เพื่อให้สอดคล้องตามกฎกระทรวงแรงงาน เรื่อง การจัดให้มีเจ้าหน้าที่ความปลอดภัยในการทำงานบุคลากร หน่วยงาน หรือคณะบุคคลเพื่อดำเนินการด้านความปลอดภัยในสถานประกอบกิจการ พ.ศ. 2565 ลงวันที่ 2 มิถุนายน พ.ศ. 2565 กำหนดให้นายจ้างแต่งตั้งลูกจ้างซึ่งมีคุณสมบัติเฉพาะตามกฎกระทรวงฯ เป็นเจ้าหน้าที่ความปลอดภัยระดับวิชาชีพ เจ้าหน้าที่ความปลอดภัยระดับบริหาร และหัวหน้าหน่วยงานความปลอดภัยประจำสถานประกอบกิจการ เพื่อปฏิบัติงานด้านความปลอดภัยนั้น บริษัทฯ จึงมีคำสั่งดังนี้

ข้อ 1 ยกเลิกคำสั่ง บริษัทฯ ที่ COO-024/65 เรื่อง แต่งตั้งเจ้าหน้าที่ความปลอดภัยในการทำงาน และหัวหน้าหน่วยงานความปลอดภัย ประจำบริษัท โกลว์ เอสพีพี 11 จำกัด ลงวันที่ 23 สิงหาคม พ.ศ. 2565

ข้อ 2 แต่งตั้งบุคคลดังต่อไปนี้เป็นเจ้าหน้าที่ความปลอดภัยในการทำงานระดับวิชาชีพ ระดับหัวหน้างาน ระดับบริหาร และหัวหน้าหน่วยงานความปลอดภัยประจำสถานประกอบกิจการ

เจ้าหน้าที่ความปลอดภัยในการทำงานระดับวิชาชีพ

1. ผู้จัดการคุณภาพ ความมั่นคงปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม
2. พนักงานคุณภาพ ความมั่นคงปลอดภัย อาชีวอนามัย และ สิ่งแวดล้อม

ให้เจ้าหน้าที่ความปลอดภัยในการทำงานระดับวิชาชีพมีหน้าที่ดังต่อไปนี้

1. ตรวจสอบและเสนอแนะให้นายจ้างปฏิบัติตามกฎหมายเกี่ยวกับความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงาน
2. วิเคราะห์งานเพื่อชี้บ่งอันตราย รวมทั้งกำหนดมาตรการป้องกันหรือขั้นตอนการทำงานอย่างปลอดภัยเสนอต่อนายจ้าง
3. ประเมินความเสี่ยงด้านความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงาน
4. วิเคราะห์แผนงานโครงการ รวมทั้งข้อเสนอแนะของหน่วยงานต่างๆและเสนอแนะมาตรการความปลอดภัยในการทำงานต่อนายจ้าง
5. ตรวจประเมินการปฏิบัติงานของสถานประกอบกิจการให้เป็นไปตามแผนงาน โครงการหรือมาตรการความปลอดภัยในการทำงาน

/6. แนะนำ...

6. แนะนำให้ลูกจ้างปฏิบัติตามข้อบังคับและคู่มือว่าด้วยความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงานของสถานประกอบกิจการ
7. แนะนำ ฝึกสอน อบรมลูกจ้าง เพื่อให้การปฏิบัติงานปลอดจากเหตุอันจะทำให้เกิดความไม่ปลอดภัยในการทำงาน
8. ตรวจวัดและประเมินสภาพแวดล้อมในการทำงาน หรือดำเนินการร่วมกับบุคคลหรือนิติบุคคลที่ขึ้นทะเบียนหรือได้รับใบอนุญาตตามกฎหมายว่าด้วยความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงาน หรือกฎหมายอื่นที่เกี่ยวข้อง เป็นผู้รับรองหรือตรวจสอบเอกสารหลักฐานรายงานในการตรวจสอบสภาพแวดล้อมในการทำงานภายในสถานประกอบกิจการ
9. เสนอแนะต่อนายจ้างเพื่อให้มีการจัดการด้านความปลอดภัยในการทำงานที่เหมาะสมกับสถานประกอบกิจการ และพัฒนาให้มีประสิทธิภาพอย่างต่อเนื่อง
10. ตรวจสอบหาสาเหตุ และวิเคราะห์การประสบอันตราย การเจ็บป่วยหรือการเกิดเหตุเดือดร้อนรำคาญอันเนื่องจากการทำงาน และรายงานผลการตรวจสอบ รวมทั้งเสนอแนะแนวทางการแก้ไขปัญหาต่อนายจ้างเพื่อป้องกันการเกิดเหตุโดยไม่ชักช้า
11. รวบรวมสถิติ วิเคราะห์ข้อมูล จัดทำรายงาน และข้อเสนอแนะเกี่ยวกับการประสบอันตราย การเจ็บป่วย หรือการเกิดเหตุเดือดร้อนรำคาญอันเนื่องจากการทำงานของลูกจ้างต่อนายจ้าง
12. ให้ความรู้และอบรมด้านโรคจากการประกอบอาชีพและสิ่งแวดล้อมแก่ลูกจ้างก่อนเข้าทำงานและระหว่างทำงาน เพื่อทบทวนความรู้อย่างน้อยปีละ 1 ครั้ง
13. ปฏิบัติงานด้านความปลอดภัยในการทำงานอื่นตามที่นายจ้างมอบหมาย

เจ้าหน้าที่ความปลอดภัยในการทำงานระดับหัวหน้างาน

1. ผู้จัดการแผนกบำรุงรักษาระบบวัดคุม
2. ผู้จัดการแผนกบำรุงรักษาเครื่องกล
3. ผู้จัดการแผนกบำรุงรักษาไฟฟ้า
4. ผู้จัดการแผนกปฏิบัติการกะ
5. ผู้จัดการแผนกปฏิบัติการกะ
6. ผู้จัดการแผนกปฏิบัติการกะ
7. ผู้จัดการแผนกปฏิบัติการกะ
8. ผู้จัดการแผนกปฏิบัติการกะ

/ ให้เจ้าหน้าที่...

ให้เจ้าหน้าที่ความปลอดภัยในการทำงานระดับหัวหน้างานมีหน้าที่ดังต่อไปนี้

1. กำกับดูแลลูกจ้างในหน่วยงานที่รับผิดชอบให้ปฏิบัติตามคู่มือว่าด้วยความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงานของสถานประกอบกิจการ
2. วิเคราะห์งานในหน่วยงานที่รับผิดชอบเพื่อค้นหาความเสี่ยงหรืออันตรายเบื้องต้นจากการทำงาน
3. จัดทำคู่มือว่าด้วยความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงานของหน่วยงานที่รับผิดชอบ
4. สอนวิธีการปฏิบัติงานที่ถูกต้องแก่ลูกจ้างในหน่วยงานที่รับผิดชอบเพื่อให้เกิดความปลอดภัยในการทำงาน
5. ตรวจสอบสภาพการทำงานของเครื่องจักร เครื่องมือ และอุปกรณ์ให้อยู่ในสภาพที่ปลอดภัยก่อนลงมือปฏิบัติงานประจำวัน
6. กำกับดูแลการใช้อุปกรณ์คุ้มครองความปลอดภัยส่วนบุคคลของลูกจ้างในหน่วยงานที่รับผิดชอบ
7. รายงานการประสบอันตราย การเจ็บป่วย หรือการเกิดเหตุเดือดร้อนรำคาญอันเนื่องจากการทำงานของลูกจ้างต่อนายจ้าง และแจ้งต่อเจ้าหน้าที่ความปลอดภัยในการทำงานระดับวิชาชีพ
8. ตรวจสอบหาสาเหตุการประสบอันตราย การเจ็บป่วย หรือการเกิดเหตุเดือดร้อนรำคาญอันเนื่องจากการทำงานของลูกจ้างร่วมกับเจ้าหน้าที่ความปลอดภัยในการทำงานระดับวิชาชีพ และรายงานผลการตรวจสอบ รวมทั้งเสนอแนะแนวทางการแก้ไขปัญหาต่อนายจ้าง เพื่อป้องกันการเกิดเหตุโดยไม่ชักช้า
9. ส่งเสริมและสนับสนุนกิจกรรมความปลอดภัยในการทำงาน
10. ปฏิบัติงานด้านความปลอดภัยในการทำงานอื่นตามที่นายจ้างหรือเจ้าหน้าที่ความปลอดภัยในการทำงานระดับบริหารมอบหมาย

เจ้าหน้าที่ความปลอดภัยในการทำงานระดับบริหาร

1. ผู้จัดการโรงไฟฟ้าโกลว์เอสพีพี 11
2. ผู้จัดการปฏิบัติการผลิตโรงไฟฟ้าโกลว์เอสพีพี 11
3. ผู้จัดการส่วนซ่อมบำรุงโรงโกลว์เอสพีพี 11

/ ให้เจ้าหน้าที่...

ให้เจ้าหน้าที่ความปลอดภัยในการทำงานระดับบริหารมีหน้าที่ดังต่อไปนี้

1. กำกับ ดูแล เจ้าหน้าที่ความปลอดภัยในการทำงานทุกระดับซึ่งอยู่ในบังคับบัญชาของเจ้าหน้าที่ความปลอดภัยในการทำงานระดับบริหาร
2. เสนอแผนงานโครงการด้านความปลอดภัยในการทำงานในหน่วยงานที่รับผิดชอบต่อนายจ้าง
3. ส่งเสริม สนับสนุน และติดตามการดำเนินงานเกี่ยวกับความปลอดภัยในการทำงานให้เป็นไปตามแผนงานโครงการเพื่อให้มีการจัดการด้านความปลอดภัยในการทำงานที่เหมาะสมกับสถานประกอบกิจการ
4. กำกับ ดูแล และติดตามให้มีการแก้ไขข้อบกพร่องเพื่อความปลอดภัยของลูกจ้างตามที่ได้รับรายงานหรือตามข้อเสนอแนะของเจ้าหน้าที่ความปลอดภัยในการทำงาน คณะกรรมการ หรือหน่วยงานความปลอดภัย

หัวหน้าหน่วยงานความปลอดภัย

1. ผู้จัดการฝ่ายอาวุโสคุณภาพ ความมั่นคงปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม

ให้เจ้าหน้าที่ความปลอดภัยในการทำงานและหัวหน้าหน่วยงานความปลอดภัยที่ได้รับการแต่งตั้งดังกล่าวข้างต้นมีหน้าที่บังคับบัญชาและ รับผิดชอบในการปฏิบัติงานของหน่วยงานความปลอดภัยตามที่กฎหมายกำหนด

ทั้งนี้ให้มีผลบังคับใช้ตั้งแต่ วันที่ 28 มิถุนายน พ.ศ. 2566 เป็นต้นไป

สั่ง ณ วันที่ 28 มิถุนายน พ.ศ. 2566

(นายศิริเมธ ลี้ภากรณ์)
ประธานเจ้าหน้าที่ปฏิบัติการ

ภาคผนวก ข-22

เอกสารการจัดตั้งคณะกรรมการความปลอดภัย

อาชีวอนามัยและสภาพแวดล้อม

คำสั่ง บริษัท โกลว์ เอสพีพี 11 จำกัด

ที่ 003/65

เรื่อง แต่งตั้งคณะกรรมการความปลอดภัย อาชีวอนามัยและสภาพแวดล้อมในการทำงาน

ประจำพื้นที่ โรงไฟฟ้า โกลว์ เอสพีพี 11

เพื่อให้การดำเนินงานสอดคล้องตามและกฎกระทรวงแรงงาน เรื่อง กำหนดมาตรฐานในการบริหารและการจัดการด้านความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงาน พ.ศ. 2549 กำหนดให้สถานประกอบกิจการที่มีลูกจ้างตั้งแต่ห้าสิบคนขึ้นไป จัดให้มีคณะกรรมการความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงานประจำสถานประกอบกิจการนั้น บริษัทฯ จึงมีคำสั่ง ดังนี้

ข้อ 1 แต่งตั้งบุคคลดังต่อไปนี้ ปฏิบัติหน้าที่คณะกรรมการความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงานประจำสถานประกอบกิจการ

1. ประธานกรรมการ
2. กรรมการผู้แทนระดับบังคับบัญชา
3. กรรมการผู้แทนระดับบังคับบัญชา
4. กรรมการผู้แทนลูกจ้างระดับปฏิบัติการ
5. กรรมการผู้แทนลูกจ้างระดับปฏิบัติการ
6. กรรมการผู้แทนลูกจ้างระดับปฏิบัติการ
7. กรรมการและเลขานุการ

ข้อ 2 ให้คณะกรรมการความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงานประจำสถานประกอบกิจการมีหน้าที่ตามที่กฎหมายกำหนดดังนี้

1. พิจารณานโยบายและแผนงานด้านความปลอดภัยในการทำงาน รวมทั้งความปลอดภัยนอกงาน เพื่อป้องกันและลดการเกิดอุบัติเหตุ การประสบอันตราย การเจ็บป่วยหรือการเกิดเหตุเดือดร้อนรำคาญ อันเนื่องจากการทำงาน หรือความไม่ปลอดภัยในการทำงานเสนอต่อนายจ้าง

2. รายงานและเสนอแนะมาตรการหรือแนวทางปรับปรุงแก้ไขให้ถูกต้องตามกฎหมายเกี่ยวกับความปลอดภัยในการทำงาน และมาตรฐานความปลอดภัยในการทำงานต่อนายจ้าง เพื่อความปลอดภัยในการทำงานของลูกจ้าง ผู้รับเหมาและบุคคลภายนอกที่เข้ามาปฏิบัติงานหรือเข้ามา ใช้บริการในสถานประกอบกิจการ

/ 3. ส่งเสริม...

3. ส่งเสริม สนับสนุน กิจกรรมด้านความปลอดภัยในการทำงานของสถานประกอบกิจการ

4. พิจารณาข้อบังคับและคู่มือว่าด้วยความปลอดภัยในการทำงานของสถานประกอบกิจการ รวมทั้ง มาตรฐานด้านความปลอดภัยในการทำงานของสถานประกอบกิจการเสนอต่อนายจ้าง

5. สำรวจการปฏิบัติด้านความปลอดภัยในการทำงาน และตรวจสอบสถิติการประสบอันตรายที่เกิดขึ้นในสถานประกอบกิจการนั้นอย่างน้อยเดือนละหนึ่งครั้ง

6. พิจารณาโครงการหรือแผนการฝึกอบรมเกี่ยวกับความปลอดภัยในการทำงาน รวมถึงโครงการหรือ แผนการฝึกอบรมเกี่ยวกับบทบาทหน้าที่ความรับผิดชอบในด้านความปลอดภัยของลูกจ้าง หัวหน้างาน ผู้บริหาร นายจ้าง และบุคลากรทุกระดับเพื่อเสนอความเห็นต่อนายจ้าง

7. วางระบบการรายงานสภาพการทำงานที่ไม่ปลอดภัยให้เป็นหน้าที่ของลูกจ้างทุกคนทุกระดับต้องปฏิบัติ

8. ติดตามผลความคืบหน้าเรื่องที่เสนอนายจ้าง

9. รายงานผลการปฏิบัติงานประจำปีรวมทั้งระบุปัญหาอุปสรรค และข้อเสนอแนะในการปฏิบัติหน้าที่ของคณะกรรมการเมื่อปฏิบัติหน้าที่ครบหนึ่งปีเพื่อเสนอต่อนายจ้าง

10. ประเมินผลการดำเนินงานด้านความปลอดภัยในการทำงานของสถานประกอบกิจการ

11. ปฏิบัติงานด้านความปลอดภัยในการทำงานอื่นตามที่นายจ้างมอบหมาย

ทั้งนี้ให้มีสิทธิและหน้าที่ในฐานะคณะกรรมการความปลอดภัย อาชีวอนามัย และสภาพแวดล้อมในการทำงานของสถานประกอบกิจการ ตั้งแต่วันที่ 1 กรกฎาคม 2565 ถึงวันที่ 30 มิถุนายน 2567 หรือจนกว่าจะมีคำสั่งแต่งตั้งคณะกรรมการความปลอดภัย อาชีวอนามัยและสภาพแวดล้อมในการทำงานชุดใหม่ทดแทน

สั่ง ณ วันที่ 20 มิถุนายน พ.ศ. 2565

(นายวรวัฒน์ พิทยศิริ)

ประธานเจ้าหน้าที่บริหารและกรรมการผู้จัดการใหญ่

ภาคผนวก ข-23

เอกสารรับรองความปลอดภัยในการใช้หม้อไอน้ำ

ที่ อก ๐๓๑๒/ ๑๓๗๕๔

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๒๖ กันยายน ๒๕๖๕

เรื่อง เห็นชอบในการตรวจสอบภายในหม้อน้ำทุกระยะเวลาเกินกว่า ๑ ปี แต่ไม่เกิน ๕ ปีต่อการตรวจสอบหนึ่งครั้ง

เรียน ผู้ประกอบกิจการโรงงาน บริษัท โกลว์ เอสพีพี ๑๑ จำกัด

อ้างถึง หนังสือ บริษัท โกลว์ เอสพีพี ๑๑ จำกัด ที่ (

ตามหนังสือที่อ้างถึง บริษัท โกลว์ เอสพีพี ๑๑ จำกัด โรงงานตั้งอยู่เลขที่ ๒๕๐หมู่ที่ ๓ เขตประกอบการอุตสาหกรรม สยามอีสเทิร์นอินดัสเตรียลพาร์ค ตำบลมาบยางพร อำเภอปลวกแดง จังหวัดระยอง ประกอบกิจการผลิตไฟฟ้า ทะเบียนโรงงานเลขที่ ๙๑๐๖๐๐๐๔๓๒๕๕๕๕ (ข๓-๘๘-๔๓/๕๕ รย) ได้ยื่นคำขอความเห็นชอบในการตรวจสอบภายในหม้อน้ำทุกระยะเวลาเกินกว่า ๑ ปี แต่ไม่เกิน ๕ ปี ต่อการตรวจสอบหนึ่งครั้งต่อ กรมโรงงานอุตสาหกรรม นั้น

กรมโรงงานอุตสาหกรรม พิจารณาแล้วเห็นชอบให้ท่านตรวจสอบภายในหม้อน้ำทุกระยะเวลาเกินกว่า ๑ ปี แต่ไม่เกิน ๓ ปี ต่อการตรวจสอบหนึ่งครั้ง ดังนี้

ลำดับ	หม้อน้ำ หมายเลข	หม้อน้ำ หมายเลขเครื่อง	อัตราการผลิตไอน้ำ (ตันต่อชั่วโมง)	ตรวจสอบภายในหม้อน้ำครั้งต่อไป ไม่เกินวันที่	หมายเหตุ
๑				๒๕ กรกฎาคม ๒๕๖๗	๓ ปี
๒				๒๘ กรกฎาคม ๒๕๖๗	๓ ปี

ทั้งนี้ ท่านจะต้องปฏิบัติตามประกาศ กรมโรงงานอุตสาหกรรม ว่าด้วยหลักเกณฑ์และวิธีการให้ความเห็นชอบในการตรวจสอบภายในหม้อน้ำทุกระยะเวลาเกินกว่า ๑ ปี แต่ไม่เกิน ๕ ปี ต่อการตรวจสอบหนึ่งครั้ง พ.ศ. ๒๕๕๙ อย่างเคร่งครัด และเมื่อครบกำหนดการให้ความเห็นชอบในการตรวจสอบภายในหม้อน้ำดังกล่าวแล้ว ท่านจะต้องยื่นคำขอความเห็นชอบในการตรวจสอบภายในหม้อน้ำทุกระยะเวลาเกินกว่า ๑ ปี แต่ไม่เกิน ๕ ปี ต่อการตรวจสอบหนึ่งครั้ง อีกครั้งต่อ กรมโรงงานอุตสาหกรรม

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

(นายศุภกิจ บุญศิริ)
รองอธิบดี ปฏิบัติราชการแทน
อธิบดีกรมโรงงานอุตสาหกรรม

กองส่งเสริมเทคโนโลยีความปลอดภัยโรงงาน
โทร. ๐ ๒๔๓๐ ๖๓๑๔ ต่อ ๒๓๐๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๔ ต่อ ๒๓๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

ภาคผนวก ข-24

แผนการบำรุงรักษาอุปกรณ์

สถานีควบคุมและวัดปริมาตรก๊าซ

บริษัท ปตท. จำกัด (มหาชน)
555 ถนนวิภาวดีรังสิต เขตจตุจักร
กรุงเทพฯ 10900
โทรศัพท์ : +66 (0) 2537-2000
โทรสาร : +66 (0) 2537-3498-9
www.pttplc.com

PTT Public Company Limited
555 Vibhavadi Rangsit Rd., Chatuchak,
Bangkok 10900 THAILAND.
Tel : +66 (0) 2537-2000
Fax : +66 (0) 2537-3498-9
www.pttplc.com

ที่ 80001503/ 281

30 มกราคม 2567

เรื่อง แจ้งแผนการเข้าปฏิบัติการและบำรุงรักษาอุปกรณ์และวัดปริมาณก๊าซธรรมชาติ

เรียน คุณเกรียงศักดิ์ สันติกันต์

ผู้จัดการโรงไฟฟ้า บริษัท โกลว์ เอสพีพี 12 จำกัด

สิ่งที่ส่งมาด้วย 1. แผนการเข้าปฏิบัติงานดูแลรักษา ประจำปี 2567

2. ช่องทางติดต่อ ฝ่ายตลาดก๊าซธรรมชาติ บริษัท ปตท. จำกัด (มหาชน)

ฝ่ายตลาดก๊าซธรรมชาติ บริษัท ปตท. จำกัด (มหาชน) (ปตท.) มุ่งเน้นการให้บริการ ดูแลกลุ่มลูกค้าโรงไฟฟ้า เพื่อให้การดำเนินงานร่วมกันเป็นไปอย่างราบรื่นและมีประสิทธิภาพ โดย ปตท. มอบหมายให้หน่วยงานผู้ให้บริการระบบโครงข่ายก๊าซธรรมชาติ (Transmission System Operator: TSO) ทำหน้าที่เป็นผู้ดำเนินการเข้าบำรุงรักษาอุปกรณ์สถานีควบคุมและวัดปริมาณก๊าซธรรมชาติมาโดยตลอด

ในการนี้ ปตท. ขอเรียนแจ้งแผนการเข้าปฏิบัติการฯ ประจำปี 2567 สำหรับบริษัท โกลว์ เอสพีพี 12 จำกัด ซึ่งหากมีการเปลี่ยนแปลง ปตท. จะเรียนให้ทราบผ่านจดหมายแจ้งแผนการเข้าปฏิบัติการฯ รายเดือน พร้อมทั้ง ทีมปฏิบัติการของ TSO จะติดต่อนัดหมายกำหนดวันเข้าปฏิบัติงานกับทีมของท่านต่อไป

อย่างไรก็ตาม ท่านสามารถสอบถามข้อมูลเพิ่มเติมผ่านผู้จัดการเขตการขาย ฝ่ายตลาดก๊าซธรรมชาติ ปตท. หรือช่องทางออนไลน์ได้แก่ Line official PTT Natural Gas (@ptt_gsm) และเว็บไซต์ **ศูนย์บริการลูกค้าโรงไฟฟ้าและตลาดค้าส่งก๊าซธรรมชาติ** https://gsm.pttplc.com โดยช่องทางนี้ให้บริการข้อมูลที่เป็นประโยชน์ อาทิ ราคาพลังงานโลกและบทวิเคราะห์ กำหนดการฝึกอบรมหลักสูตรเกี่ยวกับก๊าซธรรมชาติ ความรู้เกี่ยวกับก๊าซธรรมชาติ เป็นต้น

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ

(นายภาสพงษ์ แสงพฤกษ์)

ผู้จัดการฝ่ายตลาดก๊าซธรรมชาติ

เอกสารแนบ 1

ptt	**สายงานระบบท่อส่งก๊าซธรรมชาติ บริษัท ปตท. จำกัด (มหาชน)**	ส่วนปฏิบัติการระบบท่อเขต 1
	แผนปฏิบัติการและบำรุงรักษาอุปกรณ์สถานีควบคุมและวัดปริมาตรก๊าซสำหรับลูกค้า ประจำปี 2567	หน่วย/แผนก ปท.1-2
ชื่อลูกค้า :	**โกลว์ เอสพีพี 11 (Glow SPP 11) Plant 2**	Plan Revision 1/2024

แผนกิจกรรม	ประเภทงาน / ระดับงาน CM หรือ PM (ML1, ML2, ML3)	Functional Location	Year 2024												ผู้รับผิดชอบ
			Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
อุปกรณ์															
1. เก็บ report ตัดยอดใช้ก๊าซฯ	ML1	TSO-GLOW12	1/15	1/15	1/15	1/15	1/15	1/15	1/15	1/15	1/15	1/15	1/15	1/15	1. คุณศุภฤกษ์ กันตรัตนากุล
2. สอบเทียบอุปกรณ์การวัดปริมาณก๊าซ Transmitter-F/C	ML2	TSO-GLOW12		Q			Q			Q			Q		โทร. 089-816-5056
3. Gas Turbine Meter Calibration & Flow Computer															
3.1 Turbine-A + Flow comp run A	ML3	TSO-GLOW12								3Y(67)					2.คุณศราวุฒิ คล่องกำไร
3.2 Turbine-B + Flow comp run B	ML3	TSO-GLOW12		3Y(67)											โทร. 085-145-1637
4.บำรุงรักษาอุปกรณ์ระบบวัดควบคุม (Inspection)	ML1	TSO-GLOW12	M	M	M	M	M	M	M	M	M	M	M	M	
5.บำรุงรักษาอุปกรณ์ระบบวัดควบคุม (Test & Adjustment)	ML2	TSO-GLOW12					H						H,Y		
6.ทำความสะอาดสถานี	ML2	TSO-GLOW12					H						H		
7. ระบบไฟฟ้าCharger UPS,Air condition,Fire Alarm,RTU	ML2	TSO-GLOW12					H						H		
8.บำรุงรักษาอุปกรณ์ PCV,PSV,SSV (Overhaul)	ML3	TSO-GLOW12							2Y(68)						
9.บำรุงรักษาอุปกรณ์ HOV (Overhaul)	ML3	TSO-GLOW12										5Y(67)			
10.PM ML3 RTU system	ML3	TSO-GLOW12								3Y(67)					
11.PM ML3 Battery Charger and Battery	ML3	TSO-GLOW12								3Y(67)					
12.ตรวจสภาพและทดสอบเครน/รอกโซ่	PM	P_GLOW12										Y			
14. Unplan CM & others	Unplan CM & others	P_GLOW12													
ท่อฯ															
Patrolling Survey	PM	TSO-Glow12-IFD	2/W	2/W	2/W	2/W	2/W	2/W	2/W	2/W	2/W	2/W	2/W	2/W	1. คุณเจตุรงค์ พานทองชัย
Insulation Flange & Joint Inspection	PM	TSO-Glow12-DCD			Y										เวลาทำการ 08.00 - 17.00 น.
DC Decoupler Inspection	PM	TSO-Glow12-CUS			Y										โทร. 0868434601
Coating Inspection	PM	TSO-Glow12-STA			Y										chaturong.p@pttplc.com
Soil to Air Inspection	PM	TSO-Glow12-CI			Y										
Corrosion Under Pipe Support Inspecton	PM	TSO-Glow12-PAT			Y										
Wall Thickness Inspection	PM	TSO-Glow12-P/S													
Cathodic Protection Inspection (Pipe to Soil Inspection)	PM	TSO-Glow12-CPOnline				H						H			
Transformer Rectifier Inspection	PM	P-Glow12-CIPSDCVG	M	M	M	M	M	M	M	M	M	M	M	M	
Anode Groundbed Inspection	PM	TSO-Glow12-AnodeGB										Y			
CP Online Calibration	PM	TSO-Glow12-TR													นอกเวลาทำการ
CIPS-DCVG	PM	TSO-Glow12-BB													โทร. 02-537-2000
ทำจัดวัชพืช	PM	P-Glow12-GPAT	M	M	M	M	M	M	M	M	M	M	M	M	ต่อ 35103 - 35105
	รวมงบประมาณ														

Definition

M = Monthly
Q = Quarterly
H = Half of Year
Y = Yearly

3Y = 3 Years
3Y(XX) = 3 Years (year to target)
xY = x Years

Preventive Maintenance Interval สำหรับ Gas Sale Equipment และอุปกรณ์ความปลอดภัย
- Gas Turbine Meter & Flow computer calculation test ทุก 3 ปี
- อุปกรณ์การวัดปริมาณก๊าซ Transmitter & Flow computor สอบเทียบทุก 3 เดือน
- อุปกรณ์ PSV & SSV ทดสอบทุก 1 ปี

รับทราบโดย

ผู้จัดทำ	ผู้จัดทำ	ผู้ตรวจสอบ	ผู้อนุมัติ	วันที่อนุมัติ
(นายศราวุฒิ คล่องกำไร) วิศวกร	(นายนันทวัฒน์ ทัศนชูเกียรติ) วิศวกร	(นายวินัย อินทรวิเชียร) หน.ปท. 1-2	(นายทองพูน กมเลศร์) ผจ.ปท.1	4/1/2024

ภาคผนวก ข-25

การปฏิบัติงานภาวะฉุกเฉินของโรงไฟฟ้า

Procedure: Emergency Preparedness and Response