ภาคผนวก

ภาคผนวก ก	สำเนาหนังสือการขอเปลี่ยนแปลงชื่อบริษัท และสำเนาหนังสือเห็นชอบจาก สผ. และเงื่อนไขที่โครงการต้องปฏิบัติตามรายงานการประเมินผลกระทบสิ่งแวดล้อม
ภาคผนวก ข	เอกสารประกอบมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม
ภาคผนวก ข-1	ระเบียบปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา
ภาคผนวก ข-2	แผนการตรวจสอบสภาพและบำรุงรักษา ดูแลการทำงานของระบบหล่อเย็น
ภาคผนวก ข-3	เอกสารประชาสัมพันธ์รายละเอียดโครงการ
ภาคผนวก ข-4	แผนขั้นตอนการรับเรื่องร้องเรียน
ภาคผนวก ข-5	สำเนาจดหมายนำส่งรายงานผลการปฏิบัติตามมาตรการฯ
ภาคผนวก ข-6	เอกสารสอบเทียบระบบ CEMs
ภาคผนวก ข-7	บันทึกผล CEMs
ภาคผนวก ข-8	แผนการเดินเครื่อง CEMs
ภาคผนวก ข-9	ระเบียบปฏิบัติงาน เรื่อง การจัดการมลพิษทางอากาศ และวิธีปฏิบัติงาน เรื่อง การควบคุมระบบมลภาวะทางอากาศ Emission Control
ภาคผนวก ข-10	เอกสารการขึ้นทะเบียนบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน
ภาคผนวก ข-11	อะไหล่สำรองสำหรับซ่อมบำรุงอุปกรณ์ต่าง ๆ
ภาคผนวก ข-12	แผนการตรวจสอบและบำรุงรักษาเชิงป้องกันเครื่องจักร
ภาคผนวก ข-13	บันทึกการตรวจสอบคราบน้ำมัน-ไขมัน
ภาคผนวก ข-14	หนังสือแจ้งรับทราบการนำน้ำทิ้งบางส่วนกลับมาใช้ประโยชน์โดยการรดน้ำต้นไม้ในโครงการ
ภาคผนวก ข-15	เอกสารตรวจสอบการทำความสะอาดรางระบายน้ำ
ภาคผนวก ข-16	ระเบียบปฏิบัติงาน เรื่อง การขออนุญาตทำงาน (Permit to work)
ภาคผนวก ข-17	ระเบียบปฏิบัติงาน เรื่อง โครงการอนุรักษ์สมรรถภาพการได้ยิน
ภาคผนวก ข-18	Noise Contour Map
ภาคผนวก ข-19	คู่มือ ความปลอดภัยและสิ่งแวดล้อม และเอกสารการฝึกอบรมพนักงานขับรถ
ภาคผนวก ข-20	ข้อกำหนดมาตรฐานด้านความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อมสำหรับงานจัดซื้อ-จัดจ้าง
ภาคผนวก ข-21	เอกสารควบคุมน้ำหนักรถในการขนส่ง
ภาคผนวก ข-22	แบบตอบกลับรายงานสิ่งปฏิกูลและมูลฝอย
ภาคผนวก ข-23	เอกสารบันทึกการจัดเก็บน้ำมันหล่อลื่นเก่า
ภาคผนวก ข-24	บันทึกชนิด/ปริมาณกากของเสียที่เกิดขึ้นภายในโครงการ
ภาคผนวก ข-25	ใบกำกับการขนส่งวัสดุที่ไม่ใช้แล้ว

ภาคผนวก (ต่อ)

ภาคผนวก ข-26 ใบอนุญาตให้นำสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้วออกนอกโรงงาน
ภาคผนวก ข-27 เอกสารการจัดตั้งคณะกรรมการด้านอาชีวอนามัย และความปลอดภัย
ภาคผนวก ข-28 แผนงานด้านอาชีวอนามัยและความปลอดภัย
ภาคผนวก ข-29 เอกสารการอบรมด้านอาชีวอนามัยและความปลอดภัย
ภาคผนวก ข-30 การติดตั้งอุปกรณ์ดับเพลิงตามมาตรฐาน NFPA
ภาคผนวก ข-31 แผนปฏิบัติการกรณีเกิดเหตุฉุกเฉิน
ภาคผนวก ข-32 รายงานการฝึกซ้อมแผนฉุกเฉิน
ภาคผนวก ข-32-1 รายงานการฝึกซ้อมแผนฉุกเฉินกรณีหม้อไอน้ำทำงานผิดปกติ
ภาคผนวก ข-33 รายงานการตรวจสอบความปลอดภัยระบบไฟฟ้า ประจำปี พ.ศ. 2566
ภาคผนวก ข-34 รายงานสรุปผลการตรวจสุขภาพพนักงาน ประจำปี พ.ศ. 2566 และแผนตรวจสุขภาพพนักงาน ประจำปี พ.ศ. 2567
ภาคผนวก ข-35 ระเบียบปฏิบัติงาน เรื่อง การตรวจสุขภาพพนักงานตามปัจจัยเสี่ยง
ภาคผนวก ข-36 ระเบียบปฏิบัติงาน เรื่อง การเฝ้าระวังและการตรวจวัด
ภาคผนวก ข-37 บันทึกสถิติการเกิดอุบัติเหตุ
ภาคผนวก ข-38 การจัดกิจกรรมส่งเสริมความปลอดภัย
ภาคผนวก ข-39 ระเบียบปฏิบัติงาน เรื่อง การชี้บ่งอันตราย การประเมินความเสี่ยง และโอกาสด้านอาชีวอนามัยและความปลอดภัย
ภาคผนวก ข-40 เอกสารการชี้บ่งอันตรายและการประเมินความเสี่ยง
ภาคผนวก ข-41 รายงานการตรวจสอบสถานที่ใช้ก๊าซธรรมชาติ
ภาคผนวก ข-42 หนังสือเห็นชอบในการตรวจสอบภายในหม้อน้ำทุกระยะเวลา 3 ปี
ภาคผนวก ข-43 เอกสารรับรองความปลอดภัยของหม้อไอน้ำ
ภาคผนวก ข-44 วิธีการปฏิบัติงานที่ปลอดภัยในการใช้หม้อไอน้ำ
ภาคผนวก ข-45 เอกสารผู้ควบคุมหม้อไอน้ำ
ภาคผนวก ข-46 บันทึกสถิติด้านสุขภาพของชุมชนโดยรอบโครงการ
ภาคผนวก ข-47 แผนมวลชนสัมพันธ์ ประจำปี พ.ศ. 2567
ภาคผนวก ข-48 การจัดกิจกรรมมวลชนสัมพันธ์
ภาคผนวก ข-49 เอกสารการอบรมการปฐมพยาบาลเบื้องต้น
ภาคผนวก ข-50 เอกสารประชาสัมพันธ์ให้ความรู้ด้านสุขภาพ
ภาคผนวก ข-51 พนักงานในท้องถิ่น
ภาคผนวก ข-52 เอกสารการแต่งตั้งคณะทำงานมวลชนสัมพันธ์
ภาคผนวก ข-53 เอกสารการแต่งตั้งคณะกรรมการ เพื่อการพัฒนาชุมชนและสิ่งแวดล้อม
ภาคผนวก ข-54 Lay Out พื้นที่สีเขียวของโครงการ

ภาคผนวก (ต่อ)

ภาคผนวก ข-55	สัญญาว่าจ้างผู้รับเหมาในการดูแลพื้นที่สีเขียว
ภาคผนวก ข-56	รายงานสรุปผลการสำรวจความคิดเห็นของประชาชน ประจำปี พ.ศ. 2566
ภาคผนวก ข-57	ระเบียบปฏิบัติงาน เรื่อง การบริหารจัดการสารเคมีอันตราย วัตถุอันตราย และยุทธภัณฑ์
ภาคผนวก ค	ผลการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม
ภาคผนวก ค-1	คุณภาพอากาศจากปล่องระบาย
ภาคผนวก ค-2	คุณภาพอากาศในบรรยากาศ
ภาคผนวก ค-3	ความเร็วลมและทิศทางลม
ภาคผนวก ค-4	คุณภาพน้ำทิ้ง
ภาคผนวก ค-5	ระดับเสียงในบรรยากาศ
ภาคผนวก ค-6	ระดับเสียงรบกวน
ภาคผนวก ค-7	ระดับเสียงในพื้นที่ทำงาน
ภาคผนวก ค-8	ระดับความร้อนในพื้นที่ทำงาน
ภาคผนวก ง	เอกสารขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
ภาคผนวก จ	ใบรับรองความสามารถห้องปฏิบัติการวิเคราะห์
ภาคผนวก ฉ	เอกสารอุปกรณ์สอบเทียบเครื่องมือ

ภาคผนวก ฉ

เอกสารอุปกรณ์สอบเทียบเครื่องมือ

ANALYTICAL BALANCE (DU)

Model : XS205DU

Serial No. : 1126323724

CERTIFICATE OF CALIBRATION

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapibarn 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : EASTERN THAI CONSULTING 1992 CO., LTD.
(Analytical Balance Room)

Equipment : ELECTRONIC BALANCE

Manufacturer : METTLER TOLEDO

Model : XS205DU

Serial No. : 1126323724

ID No. : LABE 05/1

Date of Receipt : 22 December 2023

Date of Calibration : 22 December 2023

Calibrated by Mr. Somwang Sangdee
Scientist

Approved by (Mr. Somchai Neampunt)
Signed for Director

Issue date 25 December 2023

COPY

The uncertainties are for a confidence probability of approximately 95%.

The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Equipment : ELECTRONIC BALANCE
Manufacturer : METTLER TOLEDO
Model : XS205DU
Capacity : Max 81 g / 220 g
Resolution : 0.01 mg / 0.1 mg
Serial No. : 1126323724
ID No. : LABE 05/1

Result of Calibration

1.Test weight and repeatability of reading

Repeatability is a measure of the ability of a balance to supply the same result in repetitive weighings with one and the same load under the same measurement condition. The measurement of the repeatability must include both the balance specifications and the ambient (vibration, fluctuating air current/temperature/humidity,etc.) Operator handling of the balance is also included in the standard deviation.

Unit : g — Range : 80

☐ No adjustment
☑ Adjustment

	☑ Before adjustment		☑ After adjustment	
Nominal value	40	80	40	80
Standard weight	40.000054	80.000048	40.000054	80.000048
Average reading of indicator	40.00026	80.00037	40.00017	80.00017
Standard deviation	0.000015	0.000016	0.000008	0.000009

Unit : g — Range : 200

☐ No adjustment
☑ Adjustment

	☑ Before adjustment		☑ After adjustment	
Nominal value	100	200	100	200
Standard weight	100.000042	200.000041	100.000042	200.000041
Average reading of indicator	100.0003	200.0004	100.0001	200.0001
Standard deviation	0.00005	0.00005	0.00003	0.00005

COPY

REPORT OF CALIBRATION

Result of Calibration

2. Sensitivity or value of a scale division

Change in the output variable of a measuring instrument divided by the associated change in the input variable.

Unit : g

Range : 80

Test Point	Sensitivity, S
0	1.00748
40	0.98753
80	0.99751

Range : 200

Test Point	Sensitivity, S
0	1.0274
100	0.9975
200	0.9975

3. Departure of indication from nominal value, Linearity

Unit : g

Nominal Value	Standard Value	Average Reading of Indicator	Correction Value	Expanded Uncertainty	Coverage Factor (k)
Unload	0.0000000	0.00000	0.00000	0.000012	2.05
0.01	0.0100025	0.01000	0.00000	0.000012	2.05
0.1	0.1000019	0.10001	-0.00001	0.000013	2.03
1	1.0000125	1.00001	0.00000	0.000015	2.02
5	5.0000208	5.00004	-0.00002	0.000021	2.00
10	10.000004	10.00008	-0.00008	0.000026	2.00
20	20.000030	20.00011	-0.00008	0.000036	2.00
50	50.000014	50.00014	-0.00013	0.000068	2.00
100	100.000042	100.0001	-0.0001	0.00016	2.00
150	150.000056	150.0001	0.0000	0.00022	2.00
200	200.000041	200.0002	-0.0002	0.00027	2.00

COPY

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003.

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

Certificate No. : 23-148799
Sample Code : 23-56200-001

REPORT OF CALIBRATION

Result of Calibration :

4. Eccentric or off-centre loading

Deviation of the measurement value through off - center (eccentric) loading. The corner load increases with the weight of the load and its removal from the center of the pan support.

Weighing pan: ○ Circle ○ Triangular ◉ Rectangular

Test weight : 50 and 100 Unit : g

Range	80	200
Position	Reading of indicator	Reading of indicator
1	50.00015	100.0001
2	50.00022	100.0001
3	50.00008	100.0001
4	50.00002	100.0000
5	50.00016	100.0002
6	50.00014	100.0001
Maximum difference	0.00013	0.0001

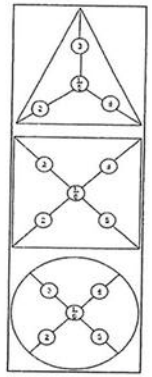

Condition of Calibration

1. Calibration Method : WI-CL-004 base on UKAS LAB 14: 2019
2. This result of calibration was found accurate as shown on date and place of calibration only.
3. Condition of Calibration item: Normal
4. This certification is traceable to the International System of Unit maintained at : - Through the reference standard laboratory of Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (Instrument number 1).
5. Reference standard instrument :

Instrument	Class	ID No.	Certificate No.	Due Date
1) STANDARD WEIGHT 1 mg to 1 kg	E2	LB-WE-79	23-105642	10 September 2024

6.

Ambient conditions	Min	Max
Temperature (°C)	22.8	23.0
Relative Humidity (%Rh)	43.5	51.1
Air pressure (hPa)	1012.5	1014.5

- End of Report -

COPY

361 Soi Ladprao 122, Ladprao Road,
Phlabphla, Wang Thonglang, Bangkok 10310
FM-CL-064

TEL 02-516-2422
FAX 02-516-6949
Rev.03

CONTACT@AMARC.CO.TH
WWW.AMARC.CO.TH
Effective Date. 15/10/21

ANALYTICAL BALANCE

Model : MS204TS/00

Serial No. : B904136539

METTLER TOLEDO

Mettler-Toledo (Thailand) Ltd.
846/4 - 846/5 Lasalle Rd., Bangna Tai Sub-District
Bangna Distnct, Bangkok 10260
+66 2723 0382
MT-TH.ServiceSupport@mt.com

NSC-TISI-TIS 17025
CALIBRATION 0062

Accuracy Calibration Certificate

Customer

Company:	EASTERN THAI CONSULTING 1992 CO., LTD.		
Address:	683 Moo 11, Sukhaphiban 8 Rd., Nong Kham		
City:	Sriracha	**Contact:**	Sasiporn N.
Zip / Postal:	20230		
State / Province:	Chonburi		
Order Number:	0332980040		

Weighing Device

Manufacturer:	Mettler Toledo	**Instrument Type:**	Weighing Instrument
Model:	MS204TS/00	**Asset Number:**	LABE 05/4
Serial No.:	B904136539	**Terminal Model:**	N/A
Building:	Laboratory	**Terminal Serial No.:**	N/A
Floor:	1	**Terminal Asset No.:**	N/A
Room:	Balance		

Range	Max. Capacity	Readability (d)
1	220 g	0.0001 g

Procedure

Calibration Guideline: EURAMET cg-18 v. 4.0 (11/2015)

METTLER TOLEDO Work Instruction: CP/W002/20

This calibration certificate contains measurements for As Found and As Left calibrations.

The sensitivity/span of the weighing instrument was adjusted before As Found and As Left calibrations with a built-in weight.

In accordance with EURAMET cg-18 (11/2015), the test loads were selected to reflect the specific use of the weighing device or to accommodate specific calibration conditions.

	Temperature		Humidity	
As Found	Start: 23.4 °C	End: 23.4 °C	Start: 50.6 %	End: 50.6 %
As Left	Start: 23.8 °C	End: 23.4 °C	Start: 51.8 %	End: 51.2 %

As Found Calibration Date: 05-Feb-2024

As Left Calibration Date: 05-Feb-2024

Issue Date: 05-Feb-2024

Calibrator: Sathaporn Tabsen

Approved Signatory: Technical Manager / Head of Calibration Center

COPY

Software Version 1.23.2.187
Report Version 2.17.16
Form Number F103C

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

METTLER TOLEDO Service

Measurement Results

Repeatability

Test Load: 100 g

	As Found	As Left
1	99.9996 g	100.0001 g
2	99.9997 g	100.0001 g
3	99.9997 g	100.0000 g
4	99.9996 g	100.0001 g
5	99.9997 g	100.0001 g
6	99.9996 g	100.0000 g
7	99.9997 g	100.0001 g
8	99.9996 g	100.0000 g
9	99.9996 g	100.0001 g
10	99.9996 g	100.0001 g
Standard Deviation	0.00005 g	0.00005 g

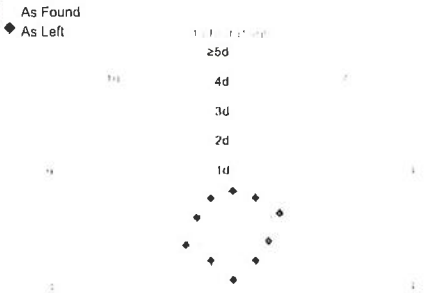

The "d" in the graph represents the readability of the range/interval in which the test was performed.

The results of this graph are based upon the absolute values of the differences from the mean value.

Eccentricity

Test Load: 100 g

Position	As Found	As Left
1	99.9996 g	100.0000 g
2	99.9996 g	100.0000 g
3	99.9997 g	100.0001 g
4	99.9996 g	100.0001 g
5	99.9996 g	100.0000 g
Maximum Deviation	0.0001 g	0.0001 g

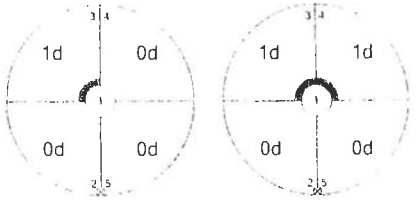

As Found As Left

The "d" in the graph represents the readability of the range/interval in which the test was performed.

COPY

Software Version 1.23.2.187
Report Version 2.17.16
Form Number F103C

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

Error of Indication

As Found

	Reference Value	Indication	Error of Indication	Expanded Uncertainty	k
1	0,0000 g	0,0000 g	0,0000 g	0,12 mg	2
2	0,0100 g	0,0100 g	0,0000 g	0,13 mg	2
3	0,0500 g	0,0499 g	-0,0001 g	0,13 mg	2
4	0,1000 g	0,0999 g	-0,0001 g	0,13 mg	2
5	1,0000 g	0,9999 g	-0,0001 g	0,13 mg	2
6	5,0000 g	4,9999 g	-0,0001 g	0,14 mg	2
7	10,0000 g	9,9999 g	-0,0001 g	0,14 mg	2
8	50,0000 g	49,9997 g	-0,0003 g	0,16 mg	2
9	100,0000 g	99,9995 g	-0,0005 g	0,20 mg	2
10 [1]	149,9999 g	149,9993 g	-0,0006 g	0,31 mg	2
11 [1]	199,9998 g	199,9990 g	-0,0008 g	0,35 mg	2

As Left

	Reference Value	Indication	Error of Indication	Expanded Uncertainty	k
1	0,0000 g	0,0000 g	0,0000 g	0,11 mg	2
2	0,0100 g	0,0100 g	0,0000 g	0,13 mg	2
3	0,0500 g	0,0500 g	0,0000 g	0,13 mg	2
4	0,1000 g	0,1000 g	0,0000 g	0,13 mg	2
5	1,0000 g	1,0001 g	0,0001 g	0,13 mg	2
6	5,0000 g	5,0000 g	0,0000 g	0,13 mg	2
7	10,0000 g	10,0001 g	0,0001 g	0,14 mg	2
8	50,0000 g	50,0001 g	0,0001 g	0,15 mg	2
9 [1]	100,0000 g	100,0001 g	0,0001 g	0,20 mg	2
10 [1]	149,9999 g	150,0000 g	0,0001 g	0,31 mg	2
11 [1]	199,9998 g	199,9999 g	0,0001 g	0,35 mg	2

[1]The calculated uncertainty was replaced by the CMC (Calibration and Measurement Capabilities) value because the calculated uncertainty was smaller than the CMC value.

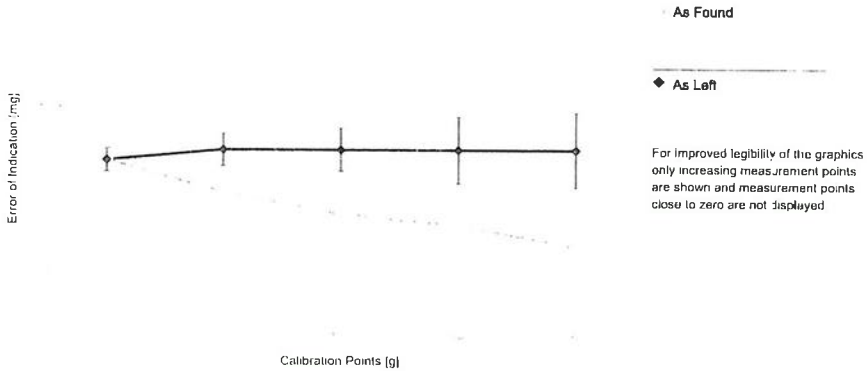

For improved legibility of the graphics only increasing measurement points are shown and measurement points close to zero are not displayed

The uncertainty stated is the expanded uncertainty at calibration obtained by multiplying the standard combined uncertainty by the coverage factor k – which can be larger than 2 according to EURAMET cg-18. The value of the measurand lies within the assigned range of values with a probability of approximately 95%.

The user is responsible for maintaining environmental conditions and the settings of the weighing instrument when it was calibrated.

COPY

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

The results of this calibration certificate relate only to the calibrated item.

Test Equipment

All weights used for metrological testing are traceable to national or international standards. The weights were calibrated and certified by an accredited calibration laboratory.

Weight Set 1: OIML E2

Weight Set No.:	WS32	Date of Issue:	25-Sep-2023
Certificate Number:	188109	Calibration Due Date:	25-Mar-2025

Weight Set 2: OIML E2

Weight Set No.:	WS85	Date of Issue:	27-Sep-2023
Certificate Number:	188113	Calibration Due Date:	26-Mar-2025

Thermo Baro Hygrometer

Equipment No.:	IN74	Date of Issue:	19-May-2023
Certificate Number:	SG-H-00418/66	Calibration Due Date:	18-May-2024

Remarks

FACT adjustment functionality activated

Equipment condition: Good

Next calibration according to customer's procedure

Calibration data not decide by calibration laboratory

End of Accredited Section

The information below and any attachments to this calibration certificate are not part of the accredited calibration.

COPY

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

Measurement Uncertainty of the Weighing Instrument in Use

Stated is the expanded uncertainty with k=2 in use. The formula shall be used for the estimation of the uncertainty under consideration of the errors of indication. The value R represents the net load indication in the unit of measure of the device.

Temperature coefficient for the evaluation of the measurement uncertainty in use: $1.5 \cdot 10^{-6}$ / K

Temperature range on site for the evaluation of the measurement uncertainty in use: 5 K

Linearization of Uncertainty Equation

	Range		As Found	As Left
	d	Max		
1	0.0001 g	220 g	U_i = 0.13 mg + 0.0101 mg/g · R	U_i = 0.13 mg + 0.00616 mg/g · R

To optimize the stability of the linearization, besides of the zero load only increasing measurement points with a test load of 5% of the measurement range or larger are taken for the calculation of the linear equation.

Absolute and Relative Measurement Uncertainty in Use for Various Net Indications (Examples)

Net Indication	As Found		As Left	
0.0220 g	0.13 mg	0.59%	0.13 mg	0.59%
0.2200 g	0.13 mg	0.060%	0.13 mg	0.060%
2.2000 g	0.15 mg	0.0069%	0.14 mg	0.0065%
22.0000 g	0.35 mg	0.0016%	0.27 mg	0.0012%
220.0000 g	2.4 mg	0.0011%	1.5 mg	0.00068%

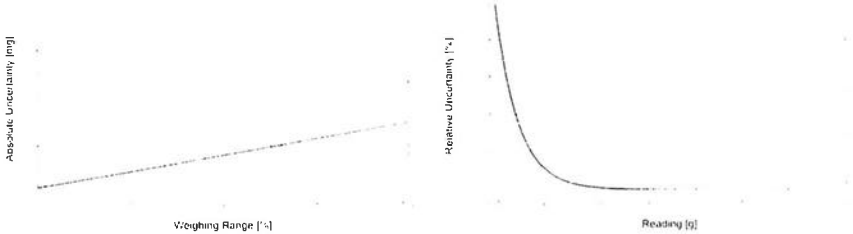

As Found As Left

COPY

Software Version 1.23.2.187
Report Version 2.17.16
Form Number F103C

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

GWP® Certificate

As Found ✓

The weighing device meets the given process requirements.

As Left ✓

The weighing device meets the given process requirements.

Tests Performed: As Found As Left

Process Requirements

Weighing Tolerance: 1% | Smallest Net Weight: 1.0000 g | Safety Factor: 2

Safe Weighing Range

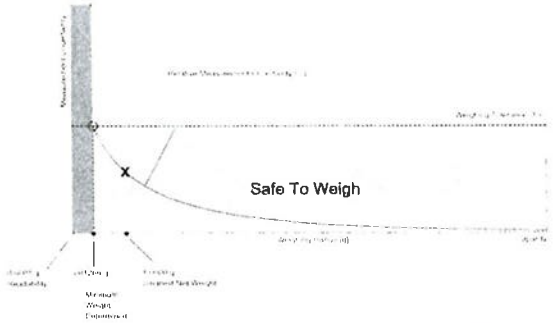

While the values in this graph reflect the actual calibration results, the measurement uncertainty curves are simply a visual representation. This graph reflects As Left testing, unless only As Found was performed.

COPY

Software Version: 1.23.2.187
Report Version: 2.17.16
Form Number: F103C

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

Minimum Weight

As Found Minimum Weight Table

Minimum weights for different weighing tolerances and safety factors					
	Safety Factor				
Tolerance	1	2	3	5	10
0.1%	0.13300 g	0.26873 g	0.40728 g	0.69320 g	1.46405 g
0.2%	0.06616 g	0.13300 g	0.20051 g	0.33764 g	0.69320 g
0.5%	0.02638 g	0.05288 g	0.07947 g	0.13300 g	0.26873 g
1%	0.01318 g	0.02638 g	0.03962 g	0.06616 g	0.13300 g
2%	0.00659 g	0.01318 g	0.01978 g	0.03300 g	0.06615 g
5%	0.00263 g	0.00527 g	0.00790 g	0.01318 g	0.02633 g

✓ Pass: The determined minimum weight meets the requirement for the smallest net weight.

As Left Minimum Weight Table

Minimum weights for different weighing tolerances and safety factors					
	Safety Factor				
Tolerance	1	2	3	5	10
0.1%	0.12728 g	0.25614 g	0.38662 g	0.65256 g	1.34797 g
0.2%	0.06344 g	0.12728 g	0.19151 g	0.32118 g	0.65256 g
0.5%	0.02533 g	0.05072 g	0.07618 g	0.12728 g	0.25614 g
1%	0.01266 g	0.02533 g	0.03802 g	0.06344 g	0.12728 g
2%	0.00633 g	0.01266 g	0.01899 g	0.03167 g	0.06344 g
5%	0.00253 g	0.00506 g	0.00759 g	0.01266 g	0.02533 g

✓ Pass: The determined minimum weight meets the requirement for the smallest net weight.

At these net minimum weight values, the measurement uncertainty of the weighing device is equal to or less than 1/1 (no safety factor), 1/2, 1/3, 1/5, or 1/10 of the required tolerance. The values are calculated with k = 2 and based on the linear formula of the measurement uncertainty of the weighing device in use.

The safety factor for As Found is always 1. This implies no safety factor. As Found testing looks at the behavior of the instrument from the past until test occurred. For the past, it is necessary to know that the tolerance was met, but not the safety factor. The safety factor is a proactive measure to apply for future measurements.

Notes on minimum weight values in above table:

1. If "N/A" is shown above, no appropriate value could be calculated.
2. METTLER TOLEDO is not responsible for the definition of the process requirements.

COPY

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

Measurement Results

Results Summary

	Repeatability	Eccentricity	Error of Indication
As Found	✓	✓	✓
As Left	✓	✓	✓

✓ = Passed
✗ = Failed
! = Safety Factor not met

Repeatability

Test Load: 100 g

		As Found		As Left	
Tolerance	Control Limit	Std. Deviation	Result	Std. Deviation	Result
0.1%	0.00050 g	0.00005 g	✓	0.00005 g	✓
0.2%	0.00100 g		✓		✓
0.5%	0.00250 g		✓		✓
1%	0.00500 g		✓		✓
2%	0.01000 g		✓		✓
5%	0.02500 g		✓		✓

The weighing tolerance is met if the standard deviation is less than or equal to the corresponding control limit.

Eccentricity

Test Load: 100 g

		As Found		As Left	
Tolerance	Control Limit	Deviation	Result	Deviation	Result
0.1%	0.0500 g	0.0001 g	✓	0.0001 g	✓
0.2%	0.1000 g		✓		✓
0.5%	0.2500 g		✓		✓
1%	0.5000 g		✓		✓
2%	1.0000 g		✓		✓
5%	2.5000 g		✓		✓

The weighing tolerance is met if the deviation is less than or equal to the corresponding control limit.

COPY

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

METTLER TOLEDO Service

Error of Indication

As Found

		Control limits for various weighing tolerances					
Reference Value	Error	0.1%	0.2%	0.5%	1%	2%	5%
0.0000 g	0.0000 g	N/A	N/A	N/A	N/A	N/A	N/A
50.0000 g	-0.0003 g	0.0250 g	0.0500 g	0.1250 g	0.2500 g	0.5000 g	1.2500 g
100.0000 g	-0.0005 g	0.0500 g	0.1000 g	0.2500 g	0.5000 g	1.0000 g	2.5000 g
149.9999 g	-0.0006 g	0.0750 g	0.1500 g	0.3750 g	0.7500 g	1.5000 g	3.7500 g
199.9998 g	-0.0008 g	0.1000 g	0.2000 g	0.5000 g	1.0000 g	2.0000 g	5.0000 g
Result		✓	✓	✓	✓	✓	✓

As Left

		Control limits for various weighing tolerances					
Reference Value	Error	0.1%	0.2%	0.5%	1%	2%	5%
0.0000 g	0.0000 g	N/A	N/A	N/A	N/A	N/A	N/A
50.0000 g	0.0001 g	0.0250 g	0.0500 g	0.1250 g	0.2500 g	0.5000 g	1.2500 g
100.0000 g	0.0001 g	0.0500 g	0.1000 g	0.2500 g	0.5000 g	1.0000 g	2.5000 g
149.9999 g	0.0001 g	0.0750 g	0.1500 g	0.3750 g	0.7500 g	1.5000 g	3.7500 g
199.9998 g	0.0001 g	0.1000 g	0.2000 g	0.5000 g	1.0000 g	2.0000 g	5.0000 g
Result		✓	✓	✓	✓	✓	✓

The weighing tolerance is met if the error (of indication) for each test point is less than or equal to the corresponding control limit for that particular weighing tolerance. Results at or close to the zero point cannot be assessed.

COPY

© METTLER TOLEDO
This is an original document and may not be partially reproduced without the written permission of the issuing calibration laboratory

Area Heat Stress Monitor

Model : HD32.2

Serial No. : 22004316

Jiranatee Associates Co.,Ltd
63/14-15, 67/35-36
Petchkasem 7,7/1, Rd Watchapra, Bangkokya,
Bangkok 10600(Thailand)
Tel: +6608680812
Mobile: +66863999453
E-mail: jnac-calibration@jiranatee.com
Web site: www.jiranatee.com

Accredited calibration laboratory
ISO/IEC 17025:2017
NSC-TISI-TIS 17025
CALIBRATION 0367

Temperature measurement laboratory
Calibration services department.

NSC – TISI – TIS 17025
CALIBRATION 0367

CERTIFICATE OF CALIBRATION

Certificate No. : CDT-040-67

MEASUREMENT ITEM	: Heat Stress Monitor
MANUFACTURER	: Delta OHM
MODEL/TYPE	: HD32.2
SERIAL NUMBER	: 22004316
ID NUMBER	: -
CONDITION AS-RECEIVED	: Used item
CUSTOMER	: Eastern thai consulting 1992 Co.,Ltd. 683 Moo 11, Sukhapibarn 8 Rd, Nongkham, Sriracha, Chonburi 20230
RECEIVED DATE	: 08 Feb 2024
MEASUREMENT DATE	: 12 Feb 2024
ISSUE DATE	: 16 Feb 2024

ENVIRONMENTAL CONDITIONS:
Ambient condition in the laboratory are as follow:

Temperature	: 23.0 ± 3.0	°C
Relative Humidity	: 55.0 ± 15.0	%RH

NOTED: The certificate is valid only to the item calibrated on date and place of calibration.

TABULATION OF RESULTS:
The table on next page give the measured values.

Calibration procedure:
The temperature calibration was done by In-House calibration method as WI-CL-001 according to comparison method with standard digital temperature indicator and standard temperature probe. The temperature scale use was based on ITS-90.

Traceability:
The measurement results are traceable to the international system of units (SI) through National Institute of Metrology Thailand (NIMT) Certificate number: TT-0038-23, Certificate number: ER-0101-23

Reference Used During Calibration:
1. Standard Temperature Probe
Model: STS-100 AS00, Serial No.: 667682-09, Due date: 28 Mar 2024
2. Digital Temperature Indicator
Model: DTI-1000-A MK II, Serial No.: 671407-00591 Due date: 14 Sep 2024

Uncertainty of Measurement:
The reported uncertainty of measurement is based on the standard uncertainty multiplied by a coverage factor k=2, Which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty has been determined in accordance with the GUM 'Evaluation of measurement data - Guide to the expression of uncertainty in measurement'

Calibrated by:
☐ Mr. Sorawit Thachalad
☐ Miss Jittraporn Lertsomphol
☑ Miss Ruangrumpai Phoommit

JIRANATEE ASSOCIATES CO.,LTD

Approved signatory: .....
Mr. Parinya Booncharoen
Calibration Department Manager

COPY

THIS CERTIFICATE MAY NOT BE REPRODUCED EXCEPT IN FULL UNLESS PERMISSION FOR REPRODUCTION HAS BEEN OBTAINED IN WRITING FROM THE LABORATORY

Result of Calibration: ☑ Without Adjustment ☐ With Adjustment

Calibration Range: 20 – 40 °C

Function:

Table 1: This equipment was connected with wet bulb probe Model: HP3201.2 S/N: 22010213, Dimension: Diameter 3.3 mm. Length 170 mm.

Immersion Depth (mm)	Standard Reading (°C)	UUC Reading (°C)	Error (°C)	Uncertainty (°C)
80	20.052	20.1	0.0	0.099
80	25.057	25.1	0.0	0.099
80	30.042	30.1	0.1	0.099
80	35.032	35.1	0.1	0.099
80	40.018	40.1	0.1	0.099

Table 2: This equipment was connected with Globe thermometer probe Model: TP3276.2 S/N: 22014923, Dimension: Diameter 3.3 mm. Length 205 mm.

Immersion Depth (mm)	Standard Reading (°C)	UUC Reading (°C)	Error (°C)	Uncertainty (°C)
110	20.052	20.1	0.0	0.099
110	25.057	25.1	0.0	0.099
110	30.042	30.1	0.1	0.099
110	35.032	35.1	0.1	0.099
110	40.018	40.1	0.1	0.099

Table 3: This equipment was connected with temperature probe Model: TP3207.2 S/N: 22015193, Dimension: Diameter 14 mm. Length 150 mm.

Immersion Depth (mm)	Standard Reading (°C)	UUC Reading (°C)	Error (°C)	Uncertainty (°C)
75	20.052	20.0	-0.1	0.099
75	25.057	25.0	-0.1	0.099
75	30.043	29.9	-0.1	0.099
75	35.032	34.9	-0.1	0.099
75	40.017	39.8	-0.2	0.099

UUC*: Unit Under Calibration

End of Certificate of Calibration

JIRANATEE ASSOCIATES CO.,LTD

COPY

Area Heat Stress Monitor

Model : HD32.2

Serial No. : 22004318

Jiranatee Associates Co.,Ltd
63/14-15, 67/35-36
Petchkasem 7,7/1, Rd Watthapra, Bangkokyai,
Bangkok 10600(Thailand)
Tel +6608680812
Mobile: +66863999453
E-mail :jnac-calibration@jiranatee.com
Web site :www.jiranatee.com

Accredited calibration laboratory
ISO/IEC 17025:2017
NSC-TISI-TIS 17025
CALIBRATION 0367

Temperature measurement laboratory
Calibration services department.

NSC – TISI – TIS 17025
CALIBRATION 0367

CERTIFICATE OF CALIBRATION

Certificate No. : CDT-041-67

MEASUREMENT ITEM	: Heat Stress Monitor
MANUFACTURER	: Delta OHM
MODEL/TYPE	: HD32.2
SERIAL NUMBER	: 22004318
ID NUMBER	: -
CONDITION AS-RECEIVED	: Used item
CUSTOMER	: Eastern thai consulting 1992 Co.,Ltd. 683 Moo 11, Sukhapibarn 8 Rd, Nongkham, Sriracha, Chonburi 20230

RECEIVED DATE	: 08 Feb 2024
MEASUREMENT DATE	: 12 Feb 2024
ISSUE DATE	: 16 Feb 2024

ENVIRONMENTAL CONDITIONS:
Ambient condition in the laboratory are as follow:

Temperature	: 23.0 ± 3.0	°C
Relative Humidity	: 55.0 ± 15.0	%RH

NOTED: The certificate is valid only to the item calibrated on date and place of calibration.

TABULATION OF RESULTS:
The table on next page give the measured values.

Calibration procedure:
The temperature calibration was done by In-House calibration method as WI-CL-001 according to comparison method with standard digital temperature indicator and standard temperature probe. The temperature scale use was based on ITS-90.

Traceability:
The measurement results are traceable to the international system of units (SI) through National Institute of Metrology Thailand (NIMT) Certificate number: TT-0038-23, Certificate number: ER-0101-23

Reference Used During Calibration:
1. Standard Temperature Probe
Model: STS-100 A500, Serial No.: 667682-09, Due date: 28 Mar 2024
2. Digital Temperature Indicator
Model: DTI-1000-A MK II, Serial No.: 671407-00591 Due date: 14 Sep 2024

Uncertainty of Measurement:
The reported uncertainty of measurement is based on the standard uncertainty multiplied by a coverage factor k=2, Which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty has been determined in accordance with the GUM 'Evaluation of measurement data - Guide to the expression of uncertainty in measurement'

Calibrated by:
☐ Mr. Sorawit Thachalad
☐ Miss Jittraporn Lertsomphol
☑ Miss Ruangrumpai Phoommit

JIRANATEE ASSOCIATES CO.,LTD

Approved signatory: .....
Mr. Parinya Booncharoen
Calibration Department Manager

COPY

THIS CERTIFICATE MAY NOT BE REPRODUCED EXCEPT IN FULL UNLESS PERMISSION FOR REPRODUCTION HAS BEEN OBTAINED IN WRITING FROM THE LABORATORY

Result of Calibration: ☑ Without Adjustment ☐ With Adjustment

Calibration Range: 20 – 40 °C

Function:

Table 1: This equipment was connected with wet bulb probe Model: HP3201.2 S/N: 22010215.
Dimension: Diameter 3.3 mm. Length 170 mm.

Immersion Depth (mm)	Standard Reading (°C)	UUC Reading (°C)	Error (°C)	Uncertainty (°C)
80	20.052	20.0	-0.1	0.099
80	25.057	25.0	-0.1	0.099
80	30.042	30.0	0.0	0.099
80	35.031	35.0	0.0	0.099
80	40.017	40.0	0.0	0.099

Table 2: This equipment was connected with Globe thermometer probe Model: TP3276.2 S/N: 22014940.
Dimension: Diameter 3.3 mm. Length 205 mm.

Immersion Depth (mm)	Standard Reading (°C)	UUC Reading (°C)	Error (°C)	Uncertainty (°C)
110	20.052	20.1	0.0	0.099
110	25.057	25.1	0.0	0.099
110	30.042	30.1	0.1	0.099
110	35.032	35.1	0.1	0.099
110	40.017	40.1	0.1	0.099

Table 3: This equipment was connected with temperature probe Model: TP3207.2 S/N: 22003554.
Dimension: Diameter 14 mm. Length 150 mm.

Immersion Depth (mm)	Standard Reading (°C)	UUC Reading (°C)	Error (°C)	Uncertainty (°C)
75	20.052	20.1	0.0	0.099
75	25.057	25.0	-0.1	0.16
75	30.041	29.8	-0.2	0.099
75	35.031	34.7	-0.3	0.099
75	40.017	39.6	-0.4	0.099

UUC*: Unit Under Calibration
Remark: The reported uncertainty of measurement is 0.16, based on standard uncertainty multiplied by a coverage factor k=2.21 providing a level of confidence of approximately 95%.

End of Certificate of Calibration

JIRANATEE ASSOCIATES CO.,LTD

COPY

BAROMETER

Equipment : Analog Barometer

ID No. / Tag No. : BM001/41

MIRACLE INTERNATIONAL TECHNOLOGY CO.,LTD
214 Bangwaek Rd. Bangpai Bangkae Bangkok 10160
Tel.: 0-2865-4647-8 Fax: 0-2865-4649 http://www.mit.in.th

ISO/IEC 17025 CALIBRATION 0052

CALIBRATION CERTIFICATE

Certificate No. : L202305085-002
Date Issued : 16-May-23

Customer : Eastern Thai Consulting 1992 Co., Ltd.
683 Moo 11 Sukhapibarn 8 Rd., Nongkham, Sriracha, Chonburi 20230

Equipment : Analog Barometer

Manufacturer : Barigo
Model : -
Serial No. : -
ID No./Tag No. : BM001/41
Date Received : 11-May-23
Date Calibrated : 15-May-23

Calibrated by : Mr. Jame Khaothong

Calibration Method or Calibration Procedure Used

In-house method : CP-21 base on DKD-R 6-1: Edition 3 2014.

This certificate is traceable to national standards, which realize the units of measurement according to the International System of Units (SI).

Result of Calibration

The reported uncertainty of measurement was based on standard uncertainty multiplied by a coverage factor k = 2, providing a level confidence approximately 95 percent.

This certificate may not be reproduced other than in full except with the prior written approval of the Miracle International Technology Company Limited.

Approved by: Sarayuth T.
(Mr. Sarayuth Tochua)

CERTIFIED MIT

COPY

Certificate No : L202305085-002

Environment Ambient Temperature : (25 ± 2)°C
Relative Humidity : (50 ± 15)%RH

STD Reading mbar	UUC Reading (mbar) Before Adjusted	UUC Reading (mbar) After Adjusted	UUC Error mbar	Uncertainty ± mbar
990.00	990.0	-	0.00	0.61
1000.00	1000.0	-	0.00	0.61
1010.00	1010.0	-	0.00	0.61
1020.00	1020.0	-	0.00	0.61
1030.00	1030.0	-	0.00	0.61

STD = Standard

UUC = Unit Under Calibration

Calibrated condition :

Pressure Medium	Air : Density = 1.19 kg/m³ @ 20°C, 1 bar
Mounting Position	Vertical
Reference Level	at center of its dial
Conversion Factor	Multiply by 1.0 E+02 - Pa unit

Description of UUC :

Range	990 - 1030	mbar Absolute
Calibration Range	990 - 1030	mbar Absolute
Scale Interval	1	mbar
Resolution	0.5	mbar Absolute

Condition As-Received : Used Item
The measurment results and statements of conformity with specification only relate to the item calibrated.

Measurement Standards Used & Traceability :

The International System of Units (SI) through

iRPC Certificate No. CL1-P220104 for Reference Pressure Monitor Serial No. 1598, Due 11-Nov-23

End of Certificate

COPY

CERTIFICATE OF ANALYSIS

EPA PROTOCAL GAS

Cylinder No. : EB0145030

Airgas
an Air Liquide company

Airgas Specialty Gases
Airgas USA, LLC
6141 Easton Road
Bldg 2
Plumsteadville, PA 18949
Airgas.com

CERTIFICATE OF ANALYSIS

Grade of Product: EPA Protocol

Part Number:	E03NI99E15AC0U4	Reference Number:	160-402242242-1
Cylinder Number:	EB0145030	Cylinder Volume:	144.4 CF
Laboratory:	124 - Plumsteadville - PA	Cylinder Pressure:	2015 PSIG
PGVP Number:	A12021	Valve Outlet:	350
Gas Code:	CH4,PPN,BALN	Certification Date:	Oct 15, 2021

Expiration Date: Oct 15, 2029

Certification performed in accordance with "EPA Traceability Protocol for Assay and Certification of Gaseous Calibration Standards (May 2012)" document EPA 600/R-12/531, using the assay procedures listed. Analytical Methodology does not require correction for analytical interference. This cylinder has a total analytical uncertainty as stated below with a confidence level of 95%. There are no significant impurities which affect the use of this calibration mixture. All concentrations are on a mole/mole basis unless otherwise noted.

Do Not Use This Cylinder below 100 psig, i.e. 0.7 megapascals.

ANALYTICAL RESULTS

Component	Requested Concentration	Actual Concentration	Protocol Method	Total Relative Uncertainty	Assay Dates
METHANE	180.0 PPM	177.0 PPM	G1	+/- 1.0% NIST Traceable	10/15/2021
PROPANE	185.0 PPM	187.0 PPM	G1	+/- 1.0% NIST Traceable	10/15/2021
NITROGEN	Balance				

CALIBRATION STANDARDS

Type	Lot ID	Cylinder No	Concentration	Uncertainty	Expiration Date
NTRM	08011503	K002564	246.7 PPM METHANE/AIR	+/- 0.6%	May 15, 2025
NTRM	200602-06	6162660Y	243.3 PPM PROPANE/AIR	+/- 0.5%	Mar 17, 2027

ANALYTICAL EQUIPMENT

Instrument/Make/Model	Analytical Principle	Last Multipoint Calibration
Nicolet iS50 FTIR AUP2110295 CH4	FTIR	Oct 13, 2021
Nicolet iS50 FTIR AUP2110295 C3H8	FTIR	Oct 14, 2021

Triad Data Available Upon Request

NOTES:

Gross Weight: 28.0 Kg
Net Weight: 4.9 Kg
PO# 5221004861

Approved for Release

ACCREDITED
CERT 3082.05

COPY

CERTIFICATE OF ANALYSIS

EPA PROTOCOL GAS

Cylinder No. : EB0062815

Airgas
an Air Liquide company

Airgas Specialty Gases
Airgas USA, LLC
600 Union Landing Road
Cinnaminson, NJ 08077-0000
Airgas.com

CERTIFICATE OF ANALYSIS

Grade of Product: EPA Protocol

Part Number:	E04NI99E15ACX9C	Reference Number:	82-401135335-1
Cylinder Number:	EB0062815	Cylinder Volume:	144.4 CF
Laboratory:	124 - Riverton (SAP) - NJ	Cylinder Pressure:	2015 PSIG
PGVP Number:	B52018	Valve Outlet:	660
Gas Code:	CO,NO,NOX,SO2,BALN	Certification Date:	Mar 13, 2018

Expiration Date: Mar 13, 2026

Certification performed in accordance with "EPA Traceability Protocol for Assay and Certification of Gaseous Calibration Standards (May 2012)" document EPA 600/R-12/531, using the assay procedures listed. Analytical Methodology does not require correction for analytical interference. This cylinder has a total analytical uncertainty as stated below with a confidence level of 95%. There are no significant impurities which effect the use of this calibration mixture. All concentrations are on a volume/volume basis unless otherwise noted.

Do Not Use This Cylinder below 100 psig, i.e. 0.7 megapascals.

ANALYTICAL RESULTS

Component	Requested Concentration	Actual Concentration	Protocol Method	Total Relative Uncertainty	Assay Dates
NOX	50.00 PPM	50.55 PPM	G1	+/- 1.4% NIST Traceable	03/06/2018, 03/13/2018
NITRIC OXIDE	50.00 PPM	50.50 PPM	G1	+/- 1.4% NIST Traceable	03/06/2018, 03/13/2018
SULFUR DIOXIDE	50.00 PPM	51.01 PPM	G1	+/- 1.0% NIST Traceable	03/06/2018, 03/13/2018
CARBON MONOXIDE	2000 PPM	1977 PPM	G1	+/- 1.0% NIST Traceable	03/06/2018
NITROGEN	Balance				

CALIBRATION STANDARDS

Type	Lot ID	Cylinder No	Concentration	Uncertainty	Expiration Date
NTRM	18060607	CC442564	50.42 PPM NITRIC OXIDE/NITROGEN	+/- 0.8%	Jun 27, 2020
PRM	12367	APEX1099237	9.82 PPM NITROGEN DIOXIDE/AIR	+/- 2.0%	Jun 02, 2017
GMIS	0315201604	CC503358	4.975 PPM NITROGEN DIOXIDE/NITROGEN	+/- 1.6%	Mar 15, 2019
NTRM	16011025	CC473218	49.02 PPM SULFUR DIOXIDE/NITROGEN	+/- 0.8%	Jun 07, 2022
NTRM	12060735	CC356192	2498 PPM CARBON MONOXIDE/NITROGEN	+/- 0.6%	Dec 14, 2026

The SRM, PRM or RGM noted above is only in reference to the GMIS used in the assay and not part of the analysis.

ANALYTICAL EQUIPMENT

Instrument/Make/Model	Analytical Principle	Last Multipoint Calibration
Nicolet 6700 APW1100391 CO	FTIR	Feb 08, 2018
Nicolet 6700 APW1100391 NO	FTIR	Feb 15, 2018
Nicolet 6700 APW1100391 NO2	FTIR	Feb 16, 2018
Nicolet 6700 APW1100391 SO2	FTIR	Mar 01, 2018

Triad Data Available Upon Request

NOTES:NET WEIGHT: 10.43lbs
GROSS WEIGHT: 60.93lbs
PO# 5218000763

This calibration std. has been certified in accordance with the May 2012 EPA Traceability Protocol, Document EPA-600/R-12/531. All testing processes and measurements conform to the req... ISO/IEC 17025 and to Airgas ISO 9001:2000 and relate only to items identified on this certi... are certified to be NIST Traceable with total uncertainty as detailed under Analytical Uncer... document shall not be reproduced in full without written approval of the issuer.

ACCREDITED

TESTING CERT No. 3082.05

Approved for Release

COPY

DRY GAS METER XC-572-OV

Serial No. : A2204323

WDS
WISDOM SCIENCE

Certificate Of Calibration

Method 5 Pre-Test Console Calibration - Cubic meter (m³)

Meter Console Information

Console Model :	XC-572-OV
Console serial :	A2204323
DGM Model #:	SK25EX
DGM Serial #:	00008294

Calibration Condition

Calibration Date:	2-May-2023
Due Date :	1-May-2024
Cal. Report No. :	WDS-SV660066
Ambient Temp (°C):	25
Pressure (mm Hg):	758
Relative Humidity (%):	55

Factors/Conversion

Std. Temp. (°K):	298
Std. Pressure (mm Hg):	760
K_1 (K/mm Hg):	0.3857

Reference Equipment

WTM Model:	W-NKoDa-5B	WTM Cal. Date:	22-Nov-2022
WTM Serial:	600245	Gamma:	1.0000

UUT Meter (DGM) / Reference Meter (WTM)

Run Time (minutes)	DGM Orifice (mm H_2O)	UUT Meter (DGM) Volume		UUT Meter (DGM) Outlet Temp		Reference Meter (WTM) Volume		Reference Meter (WTM) Outlet Temp	
		Initial	Final	Initial	Final	Initial	Final	Initial	Final
θ	$P_{m(g)}$	V_{mi}	V_{mf}	t_{mi}	t_{mf}	V_{wi}	V_{wf}	t_{wi}	t_{wf}
15.00	13.0	18.0685	18.2252	25	26	17.55844	17.71573	25	25
10.00	25.0	18.2477	18.3984	25	26	17.73837	17.88948	25	25
8.00	50.0	18.4339	18.6056	25	26	17.92517	18.09730	25	25
7.00	80.0	18.6458	18.8344	25	27	18.13775	18.32707	25	25
5.00	120.0	18.8839	19.0510	25	27	18.37705	18.54528	25	25

Standardized Data / Calibration Results

Test Meter Std. Volume $V_{m(std)}$ (m^3)	Test Meter Std. Flow Rate $Q_{m(std)}$ m^3/min	Reference Meter Std. Volume $V_{w(std)}$ (m^3)	Reference Meter Std. Flow Rate $Q_{w(std)}$ m3/min	Correction Factor "Gamma" (Y)	Correction Factor Variation (ΔY)	Flow Rate Std & Corr $Q_{m(std)(corr)}$	ΔH@ (mm H_2O) 0.0212 SCMM $\Delta H_@$	ΔH@ (mm H_2O) Variation $\Delta\Delta H_@$
0.154	0.010	0.154	0.010	1.004	0.003	0.010	54.437	3.293
0.148	0.015	0.148	0.015	1.002	0.001	0.015	50.528	-0.616
0.169	0.021	0.169	0.021	0.999	-0.001	0.021	50.086	-1.058
0.186	0.027	0.186	0.027	0.999	-0.001	0.027	50.928	-0.216
0.165	0.033	0.165	0.033	0.999	-0.002	0.033	49.741	-1.403
				1.001	= Y Avg.		**51.144**	= ΔH@ Avg.

Pass/Fail Result: PASS

Note: For Calibration Factor Y, the ratio of the reading of the calibration meter to the dry gas meter, acceptable tolerance of individual values from the average is ±0.02

Note: For $\Delta H_@$, orifice pressure differential that equates to 0.75cfm (0.0212m^3/min) at standard temperature and pressure, acceptable tolerance of individual values from the average is ±0.2inches (5.1mm) H_2O.

WISDOM SCIENCE
บริษัท วิสดอม ไซน์แอนซ์ เซลล์ แอนด์ เซอร์วิส กรุ๊ป จำกัด
WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

COPY

Approved By: _____ Date 2-May-2023

(Patpasu Chaisana)

Service Manager

Meter Gamma vs Flowrate

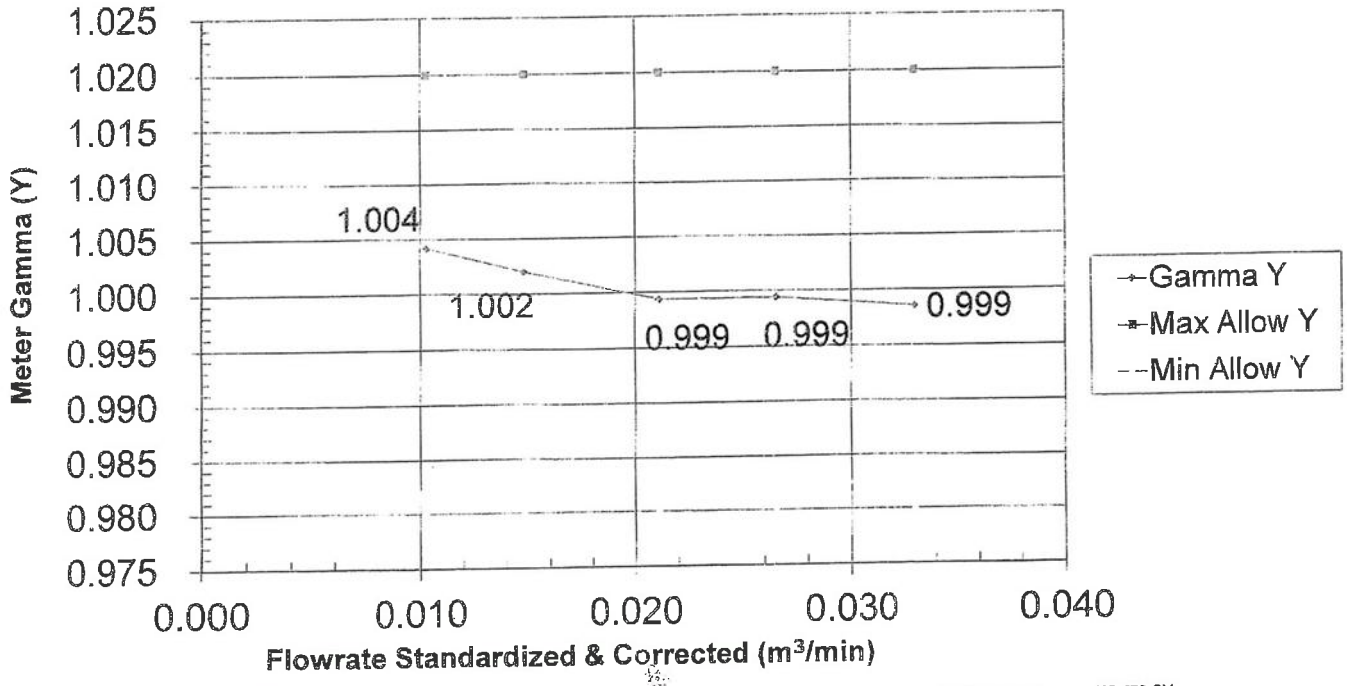

Console Serial: A2204323

Console Model: XC-572-OV

WISDOM SCIENCE
บริษัท วิสดอม ไซน์แอนซ์ เซลล์ แอนด์ เซอร์วิส กรุ๊ป จำกัด
WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

COPY

WDS
WISDOM SCIENCE

TEMPERATURE DISPLAY CALIBRATION

Meter Console Information

Console Model :	XC-572-OV
Console Serial :	A2204323
Temp Indicator Model :	765-KF
Temp. Indicator Serial :	JC19022

Calibration Conditions

Cal. Date :	2-May-2023
Due Date :	1-May-2024
Cal. Report No. :	WDS-SV660066
Ambient Temp. (°C) :	25
Pressure (mm Hg) :	758
Humidity (%) :	55

Reference Equipment

Temp. Simulator Model :	FLUKE 714B
Serial No. :	60590035
Calibration Date.:	14-Feb-2023

Temperature Sensor Calibration

Reference Point	Ref. Thermometer Temperature	Thermocouple Display Temperature	Temperature Difference
#	°C	°C	°C
1	-18.0	-17.0	1.0
2	25.0	25.0	0.0
3	90.0	90.0	0.0
4	120.0	120.0	0.0
5	250.0	249.0	1.0
6	380.0	380.0	0.0
7	500.0	500.0	0.0
8	620.0	620.0	0.0
9	740.0	739.0	1.0
10	860.0	860.0	0.0
		Maximum [1]	1.0

PASS

Note

[1] For valid test results , the maximum difference between temperature readings should ≤1.0°C (EPA Method 5, Section 6.1.1.8). Perform AUX, STACK, PROBE, OVEN, FILTER, EXIT. Except meter (DGM) channel

DGM Out Temperature Sensor Calibration

Temperature point	Ref Thermometer Temperature	Thermocouple Display Temperature	Temperature Difference
#	°C	°C	°C
Ambient	28.8	29.0	-0.2
Heat	100.0	101.3	-1.3

Difference Rang

DGM Out Temp. Diff. ±3 °C

PASS

Approved By : (Patpasu Chalsana)

Service Manager

WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

COPY

Console Serial: A2204323 Console Model: XC-572-OV

WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

COPY

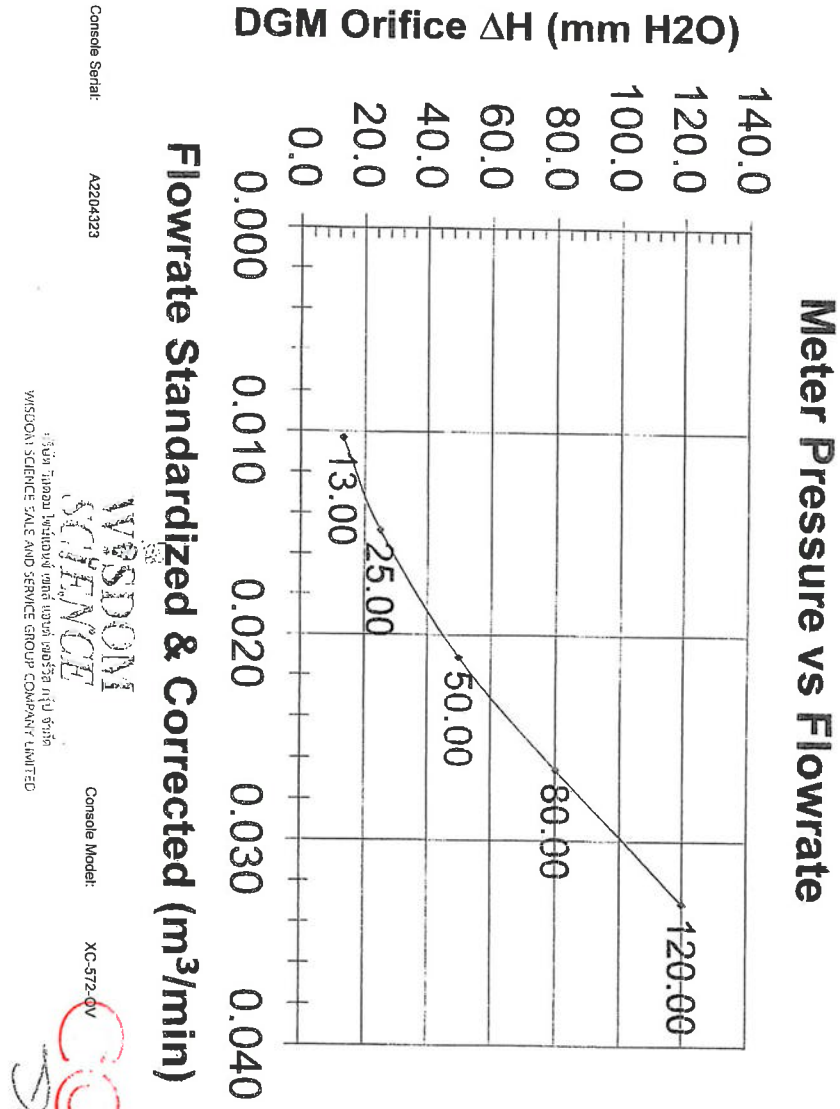

DRY GAS METER XC572V

Serial No. : 1110070

WDS

WISDOM SCIENCE

Certificate Of Calibration

Method 5 Pre-Test Console Calibration - Cubic meter (m3)

Meter Console Information

Console Model	XC572V
Console serial	1110070
DGM Model #	SK25EX
DGM Serial #	0005413

Calibration Condition

Calibration Date	3-Jul-23
Due Date	2-Jul-24
Cal. Report No.	WDS-SV660107
Ambient Temp (°C)	25
Pressure (mm Hg)	758
Relative Humidity (%)	60

Factors/Conversion

Std. Temp. (°K)	298
Std. Pressure (mm Hg)	760
K_1 (K/mm Hg)	0.3857

Reference Equipment

WTM Model	W-NKoDa-5B	WTM Cal. Due Date:	Nov. 2022
WTM Serial	600245	Gamma	1.0000

Run Time (minutes)	DGM Orifice ($mm H_2O$)	UUT Meter (DGM) Volume Initial	UUT Meter (DGM) Volume Final	UUT Meter (DGM) Outlet Temp Initial	UUT Meter (DGM) Outlet Temp Final	Reference Meter (WTM) Volume Initial	Reference Meter (WTM) Volume Final	Reference Meter (WTM) Outlet Temp Initial	Reference Meter (WTM) Outlet Temp Final
θ	P_{mid}	V_m	V_{mf}	t_{mi}	t_{mf}	V_{wi}	V_{wf}	t_{wi}	t_{wf}
15.00	13.0	599.3828	599.5462	27	27	20.05690	20.22163	28	27
10.00	25.0	599.5689	599.7246	27	26	20.24425	20.39999	27	27
8.00	50.0	599.7405	599.9176	26	25	20.41592	20.59344	27	27
7.00	80.0	599.9333	600.1337	26	26	20.60920	20.81034	27	27
5.00	120.0	600.1559	600.3319	26	26	20.83271	21.00950	27	27

Standardized Data: Test Meter Std. Volume V_{mstd} (m^3)	Test Meter Std. Flow Rate Q_{mstd} m^3/min	Reference Meter Std. Volume V_{wstd} (m^3)	Reference Meter Std. Flow Rate Q_{wstd} m3/min	Correction Factor "Gamma" (Y)	Correction Factor Variation (ΔY)	Calibration Results Flow Rate Std. & Corr. $Q_{wstdcorr}$	$\Delta H@$ ($mm H_2O$) 0.0212 SCMM $\Delta H_@$	$\Delta H@$ ($mm H_2O$) Variation $\Delta\Delta H_@$
0.159	0.011	0.160	0.011	1.005	0.010	0.011	50.191	2.747
0.152	0.015	0.152	0.015	0.996	0.000	0.015	48.096	0.652
0.174	0.022	0.173	0.022	0.995	-0.001	0.022	47.605	0.171
0.197	0.028	0.196	0.028	0.993	-0.003	0.028	45.688	-1.747
0.174	0.035	0.172	0.034	0.990	-0.006	0.034	45.602	-1.832
				0.996	= Y Avg		47.434	= ΔH@ Avg

Pass/Fail Result: Pass

Note: For Calibration Factor Y: the ratio of the reading of the calibration meter to the dry gas meter, acceptable tolerance ±0.02 individual values from the average is ±0.02

Note: For $\Delta H_@$: orifice pressure differential that equates to 0.75cfm (0.0212m^3/min) at standard temperature and pr... individual values from the average is ±0.2inches (5.1mm) H_2O

Approved By: _____

(Patpasu Chaisana)

Service Manager

WISDOM SCIENCE

บริษัท วิสดอม ไซเอนซ์ เซลส์ แอนด์ เซอร์วิส กรุ๊ป จำกัด

WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

Date 3-Jun-23

COPY

WDS

WISDOM SCIENCE

TEMPERATURE DISPLAY CALIBRATION

Meter Console Information

Console Model	XC572V
Console serial	1110070
Temp Indicator Model	765-KF
Temp Indicator Serial	JC17852

Calibration Conditions

Cal. Date	3-Jul-23
Due Date	2-Jul-24
Cal. Report No	WDS-SV660107
Ambient Temp (°C)	25
Pressure (mm Hg)	758
Humidity (%)	60

Reference Equipment

Temp. Simulator Model	FLUKE 714B
Serial No	60590035

Temperature Sensor Calibration

Reference Point #	Ref. Thermometer Temperature °C	Thermocouple Display Temperature °C	Temperature Difference °C
1	-18.0	-17.0	1.0
2	38.0	37.0	1.0
3	93.0	93.0	0.0
4	149.0	149.0	0.0
5	260.0	259.0	1.0
6	371.0	372.0	-1.0
7	482.0	482.0	0.0
8	593.0	594.0	-1.0
9	816.0	816.0	0.0
10	1038.0	1039.0	-1.0
		Maximum '	1.0

PASS

Note

' For valid test results , the maximum difference between temperature readings should ≤1.0°C (EPA Method 5, Section 6.1.1.8)

Perform all TC Channel calibrations Except meter (DGM) channel

DGM Out Temperature Sensor Calibration

Temperature point #	Ref.Thermometer Temperature °C	Thermocouple Display Temperature °C	Temperature Difference °C
Ambient	26.5	27.0	-0.5
Heat	100.5	102.5	-2.0

PASS

Difference Rang

DGM Out Temp. Diff. ±3 °C

Approved By : _____

(Patpasu Chaisana)

Service Manager

WISDOM SCIENCE

บริษัท วิสดอม ไซเอนซ์ เซลส์ แอนด์ เซอร์วิส กรุ๊ป จำกัด

WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

COPY

WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

Address 9/118 Lumpini Town Ville Ratchaphruek-Pinklao Village No 4 Bang Khanun Bang Kruai Nonthaburi 11130 Thailand

Tel 090 660 1392 084 598 1944 084 704 1620

WDS
WISDOM SCIENCE

ELAPSED TIMER CALIBRATION

Meter Console Information

Model #	XC572V
Serial #:	1110070
Elapsed Timer Model #	C342-1464
Elapsed Timer Serial #:	-

Calibration Conditions

Cal. Date :	03-Jul-23
Due Date	02-Jul-24
Cal. Report No.	WDS-SV660107
Ambient Temp. (°C) :	25
Pressure (mm Hg) :	758
Humidity (%) :	60

Reference Equipment

Calibration Standard:	JS-307
Method Reference:	Compare

Calibration Results

Run Time	Elapsed Timer				Average Time	Deviation
Elapsed STD.	1	2	3	4		
Minute	Minute	Minute	Minute	Minute	Minute	Minute
2.00	2.00	2.00	2.00	2.00	2.000	0.000
3.00	3.00	3.00	3.00	3.00	3.000	0.000
5.00	5.00	5.00	5.00	5.00	5.000	0.000
7.00	7.00	7.00	7.00	7.00	7.000	0.000
9.00	9.00	9.00	9.00	9.00	9.000	0.000

Approved By

(Patpasu Chaisana)
Service Engineer

WISDOM SCIENCE
WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED

COPY

WISDOM SCIENCE SALE AND SERVICE GROUP COMPANY LIMITED
Address 9/115 Lumpini Town Ville Ratchaphruek-Pinklao Village,No. 4, Bang Khanun, Bang Kruai, Nonthaburi 11130 Thailand
Tel 090 660-1392, 084-598-1944, 084-704-1620

Flue gas Analyzer

Testo 350 NEW

Serial No. 63455616/0722

ENTECH
Where

Calibration Certificate

Certificate No: G 660489
Date of issue : 17-Aug-23

Instrument description	:	Flue Gas Analyzer
Instrument model	:	Testo 350 New
Instrument serial no.	:	63455616/0722
Control unit serial no.	:	03600177/0722
ID no. or control no.	:	-
Manufacturer	:	Testo SE & Co. KGaA
Probe description	:	-
Probe model	:	-
Probe serial	:	-
Customer name	:	Eastern Thai Consulting 1992 Company Limited
Customer address	:	683 Moo 11, Sukhapibarn 8 Road, Nongkham, Si Racha, Chon Buri 20280
Total pages of certificate	:	2 Pages
Receiving no.	:	L-232625
Receiving date.	:	10-Aug-23
Parameter of calibration	:	Gas Calibration(Oxygen 2.498,10.04,21.02 %vol, Carbon Monoxide 80.14,302,1003 ppm, Nitrogen Dioxide 80.96 ppm, Nitric Oxide 151.5 ppm, Sulphur Dioxide 100.8 ppm)
Condition of UUC.	:	Used
Ambient condition	:	All of the Measurment ware carled out the stabilized labotary Temperature : 23 ±5 °C Humidity : 55 ± 15 %RH
Calibration place	:	17/121 Soi Ngamwongwan 47 Yaek 48, Toongsonghong, Laksi, Bangkok 10210
Calibration procedure no.	:	This instrument was calibrated by comparison with Standard gas mixture according to calibration work instration no. WI-CL-28-C

The calibration certificate expanded uncertainty of measurement is stated as the standard uncertainty of measurent Multiplied by coverage factor k=2, which for a normal distribution corresponds to a coverage probability of approximately 95%.

This certificate is applied only to item under test Environmental condition.

This Calibration Certificate may not be reporduced other than in full except with the permission of the issuing laboratory. Calibration certificates without signature and seal not valid and The results relate only to the items tested/calibrated.

This calibration certificate documents are tracebilty to national standards, which realize measurement according to the International System of Units (SI).

Date of calibration : 17-Aug-23

Mr. Kwanchai Khamdoung
Calibration Technician

Mrs. Nongluck Wongsellee
Technical Manager

COPY

Entech Industrial Solution Co.,Ltd.
17/121 Soi Ngamwongwan 47 Yaek 48, Toongsonghong, Laksi, Bangkok 10210 THAILAND Tel 0-2779-8888 Calibration@entech.co.th
Tax ID 0105536035591 www.entech.co.th

ENTECH
Where

Calibration Certificate

Certificate No.: G 660489

Standard References (Table 1)

Standard	Certificate No.	Vendor	Due date
Oxygen (O2) 2.498 % Vol	4219/21	Linde	30-Sep-25
Oxygen (O2) 10.04 % Vol	CG-0153-21	Nimt	18-Nov-26
Oxygen (O2) 21.02 % Vol	CG-0041-22	Nimt	10-Feb-27
Carbon monoxide (CO) 80.14 ppm	CG-0040-22	Nimt	14-Feb-27
Carbon monoxide (CO) 302 ppm	1915/23	Linde	16-Jun-25
Carbon monoxide (CO) 1003 ppm	2583/22	Linde	09-Aug-24
Nitrogen Dioxide (NO2) 80.96 ppm	3240/21	Linde	26-Jun-24
Nitric Oxide (NO) 151.5 ppm	0161/23	Linde	22-Jan-25
Sulphur Dioxide (SO2) 100.8 ppm	3507/22	Linde	09-Nov-24

Measured room conditions

Temperature : 23.8 °C Humidity : 62.1 %RH Pressure : 1008.9 mbar

Calibration conditions

Gas Temperature : 24 °C Flow rate : 1,300 ml/min Gas pressure : 1016.8 mbar

Calibration Results (Without adjustment) (Table 2)

Parameter of Standard	Standard Values	Mean of UUC	Error	Uncertainty (±)
O2 (%Vol)	2.498	2.55	0.052	0.15
O2 (%Vol)	10.04	10.11	0.07	0.20
O2 (%Vol)	21.02	21.14	0.12	0.30
CO (ppm)	80.14	80	-0.14	3.0
CO (ppm)	302	302	0	6.0
CO (ppm)	1003	999	-4	12
*NO2 (ppm)	80.96	81.5	0.54	8.0
*NO (ppm)	151.5	150	-1.5	8.0
*SO2 (ppm)	100.8	100	-0.8	6.0

Remark : 1 cmol/mol = 1 %vol. 1 µmol/mol = 1 ppm.
* Calibrations marked Not TISI Accredited "in this Certificate have been included for completeness."

End of Report

COPY

Entech Industrial Solution Co.,Ltd.
17/121 Soi Ngamwongwan 47 Yaek 48, Toongsonghong, Laksi, Bangkok 10210 THAILAND Tel 0-2779-8888 Calibration@entech.co.th
Tax ID 0105536035591 www.entech.co.th

Hot Air Oven

Model : UFE 500

Serial No. : G511.0182

CERTIFICATE OF CALIBRATION

Certificate No. : 23-148804

Sample Code : 23-56200-006

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapibarn 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : EASTERN THAI CONSULTING 1992 CO., LTD.
(Hot Lab)

Equipment : Temperature controlled enclosures (Hot air oven)

Manufacturer : Memmert Model : UFE 500

Serial No. : G511.0182 ID No. : LABE 17/4

Date of Receipt : 22 December 2023 Date of Calibration : 22 December 2023

Condition of Calibration

1. Environment
   - 1.1 Ambient temperature : Maximum 30.9 °C ; Minimum 29.6 °C
   - 1.2 Relative humidity : Maximum 54.5 % ; Minimum 46.8 %
   - 1.3 Line voltage supplied : Maximum 227.6 VAC ; Minimum 224.2 VAC
2. Calibration method
   TLAS-G-20: Guidelines for calibration and checks of temperature controlled enclosures.
3. Reference standard instrument

Instrument	ID No.	Certificate No.	Due Date
Data Acquisition With Sensor (RTD-Pt100)	LB-DA-08 (RTD-248 to RTD-256)	23-084070	06 August 2024

4. This certificate is traceable to the international system of unit (SI Unit).
   The measurement is traceable to Asia Medical and Agricultural Laboratory and Research Center Public Company Limited.
5. This result of calibration was found accurate as shown on date and place of calibration only.
6. Condition of calibration item : Normal

Calibrated by Mr. Pisek Into
Scientist

Approved by (Mr. Somchai Neampunt)
Signed for Director

Issue date 25 December 2023

COPY

The uncertainties are for a confidence probability of approximately 95%
The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC)

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Certificate No. : 23-148804

Sample Code : 23-56200-006

Results of Calibration

Resolution : 0.5 °C

1. Reporting of Temperature

Calibration point (°C)	UUC* setting (°C)	UUC* reading (°C)	Measured temperature at each positions (°C)									Uncertainty ± (°C)	Coverage factor *k*
			# 1	# 2	# 3	# 4	# 5	# 6	# 7	# 8	# 9 Ref		
104	103.5	103.5	104.11	103.94	103.85	103.84	103.97	103.93	103.64	103.51	104.23	0.47	2.00

2. Characterization results

Calibration point (°C)	Stability ± (°C)	Uniformity (°C)	Overall variation (°C)
104	0.04	0.78	0.81

Notes

UUC* = Unit Under Calibration

COPY

REPORT OF CALIBRATION

Certificate No. : 23-148804

Sample Code : 23-56200-006

Results of Calibration

Notes

1. Sensor installation locations
   1.1 All sensors at any corners or walls should be positioned 5 cm (a x b x c) from the wall.
   1.2 The reference sensor is preferably located of the geometric center of the chamber.
2. Interior dimensions approx of chamber :
   W = 56 cm ; D = 40 cm ; H = 48 cm
3. Air valve or fresh air level : Off
4. Fan level : Open
5. The quoted uncertainty includes" Stability of chamber and loading effect in chamber at 20% of uniformity ".

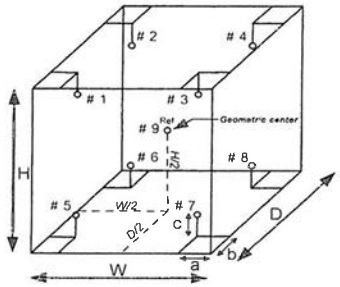

Figure: Example of sensor installation Positions

6. Uniformity - the maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
7. Stability - one-half of the greatest maximum difference of measured temperatures at any one sensor.
8. Overall variation - the difference of the maximum and the minimum measured temperatures throughout observation time.
9. UUC" reading - the average reading of indicating device that forms the integral part of the enclosure.
10. Calibration results without adjustment.

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003.

- End of Report -

COPY

ORIFICE TRANSFER STANDARD CERTIFICATION

WORKSHEET TE-5025A

ROOTSMETER S/N 0438320

TISCH Environmental

TISCH ENVIRONMENTAL, INC.
145 SOUTH MIAMI AVE
VILLAGE OF CLEVES, OH
45002
513.467.9000
877.263.7610 TOLL FREE
513.467.9009 FAX

ORIFICE TRANSFER STANDARD CERTIFICATION WORKSHEET TE-5025A

Date - Mar 24, 2016 Rootsmeter S/N 0438320 Ta (K) - 295
Operator Tisch Orifice I.D. - 0136 Pa (mm) - 742.95

PLATE OR Run #	VOLUME START (m3)	VOLUME STOP (m3)	DIFF VOLUME (m3)	DIFF TIME (min)	METER DIFF Hg (mm)	ORFICE DIFF H2O (in.)
1	NA	NA	1.00	1.3400	3.2	2.00
2	NA	NA	1.00	0.9510	6.3	4.00
3	NA	NA	1.00	0.8510	7.8	5.00
4	NA	NA	1.00	0.8130	8.6	5.50
5	NA	NA	1.00	0.6690	12.6	8.00

DATA TABULATION

Vstd	(x axis) Qstd	(y axis)		Va	(x axis) Qa	(y axis)
0.9832	0.7337	1.4054		0.9957	0.7430	0.8911
0.9791	1.0296	1.9875		0.9915	1.0426	1.2503
0.9770	1.1481	2.2221		0.9894	1.1626	1.4090
0.9760	1.2006	2.3305		0.9884	1.2157	1.4778
0.9707	1.4510	2.8107		0.9830	1.4694	1.7823
Qstd slope (m) =		1.96262		Qa slope (m) =		1.22896
intercept (b) =		-0.03249		intercept (b) =		-0.02060
coefficient (r) =		0.99993		coefficient (r) =		0.99993
y axis = SQRT[H2O(Pa/760)(298/Ta)]				y axis = SQRT[H2O(Ta/Pa)]		

CALCULATIONS

Vstd = Diff. Vol[(Pa-Diff. Hg)/760](298/Ta)
Qstd = Vstd/Time

Va = Diff Vol [(Pa-Diff Hg)/Pa]
Qa = Va/Time

For subsequent flow rate calculations:

Qstd = 1/m{[SQRT(H2O(Pa/760)(298/Ta))]- b}
Qa = 1/m{[SQRT H2O(Ta/Pa)]- b}

COPY

THERMO-HYGROMETER

Model : 608-H1

Serial No. : 45106737

CERTIFICATE OF CALIBRATION

Certificate No. : 23-055203

Sample Code : 23-21440-001

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapibarn 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : Asia Medical and Agricultural Laboratory and Research Center Public Company Limited
(Calibration laboratory)

Equipment : Digital thermo-hygrometer

Manufacturer : testo — Model : 608-H1

Serial No. : 45106737 — ID No. : LABE 09/7

Date of Receipt : 25 May 2023 — Date of Calibration : 29 May 2023

Condition of Calibration

1. Environment
   1.1 Ambient temperature : 23.0 °C ± 3.0 °C
   1.2 Relative humidity : 55.0 % ± 15.0 %

2. Calibration method
   2.1 In-house method: WI-CL-045 By comparison with thermometer standard / chilled mirror hygrometer in controlled chamber.
   2.2 The calibration by comparison unit under calibration (UUC) to the thermometer standard / chilled mirror hygrometer in a chamber at the controlled temperature / relative humidity.

3. Reference standard instrument

Instrument	Model	ID No.	Certificate No.	Due Date
3.1 Chilled Mirror	Optidew Vision	LB-DP-02 & LB-DP-02 (DP)	TH-0157-22	05 December 2023
3.2 Digital Thermometer	Optidew Vision	LB-DP-02 & LB-DP-02 (Temp.)	23-014916	12 February 2024
3.3 Digital Thermometer	34972A	LB-DA-07 with RTD-89	22-095535	06 September 2023

4. This certificate is traceable to the international system of unit (SI Unit).
   4.1 Instrument No. 3.1 through National Institute of Metrology (Thailand).
   4.2 Instrument No. 3.2 and 3.3 through Asia Medical and Agricultural Laboratory and Research Center Public Company Limited.
5. This result of calibration was found accurate as shown on date and place of calibration only.
6. Condition of calibration item : Normal

Calibrated by : Miss Pornsuda Lohabal, Scientist

Approved by : (Mr . Somchai Neampunt), Signed for Director

Issue date : 31 May 2023

COPY

The uncertainties are for a confidence probability of approximately 95%
The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC)

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

ilac-MRA THAILAND
NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Certificate No. : 23-055203

Sample Code : 23-21440-001

Results of Calibration

Temperature measurement

Resolution : 0.1 °C

Range : 0 °C to 50 °C

Calibration point	Average of standard reading		Unit under calibration		Expanded uncertainty
	Controlled humidity	Temperature	Average reading	Correction value	
°C	%RH	°C	°C	°C	°C
20	50	20.00	20.0	0.00	± 0.39
25	50	25.02	25.1	- 0.08	± 0.39
30	50	30.00	30.0	0.00	± 0.39

Humidity measurement

Resolution : 0.1 %RH

Range : 10 %RH to 95 %RH

Calibration point	Average of standard reading		Unit under calibration		Expanded uncertainty
	Air temperature	Calculated humidity	Average reading	Correction value	
%RH	°C	%RH	%RH	%RH	%RH
45	25.00	45.18	53.5	- 8.32	± 1.3
60	25.00	60.03	68.3	- 8.27	± 1.5
75	25.00	75.20	83.2	- 8.00	± 1.7

Notes

- Calibration results without adjustment.

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003

- End of Report -

COPY

361 Soi Ladprao 122, Ladprao Road,
Phlabphla, Wang Thonglang, Bangkok 10310
TEL 02 516-2422
FAX 02-516-6949
CONTACT@AMARC.CO.TH
WWW.AMARC.CO.TH
FM-CL-018

UV/VIS SPECTROPHOTOMETER

Model : UV - 1800

Serial No. : A11635101643 CD

Bara Scientific Co., Ltd.
968 U Chu Liang Building Floor7 Rama4 Road
Silom Bangrak Bangkok Thailand 10500
Tel : 02-6324300 Fax : 02-6375496-7
www.barascientific.com

Bara Scientific

NSC-TISI-TIS 17025 CALIBRATION 0209

Certificate of Calibration

Certificate No.	BSCC-UV-152/23
Equipment	UV/Vis Spectrophotometer
Model	UV-1800
Manufacturer	Shimadzu
Serial No.	A11635101643 CD
ID No.	N/A
Date of receipt	25 April 2023
Date of calibration	25 April 2023
Date of issue	27 April 2023
Customer name	Eastern Thai Consulting 1992 Co.,Ltd
Address	683 Moo 11, Sukkhaphibarn 8 Rd., Nongkham, Sriracha, Chonburi 20230
Temperature	(22.4-23.1) °C (On site)
Humidity	(44.5-45.2) %RH (On site)
Equipment condition	Good Operation
Calibration Location	Analysis Department
Calibration Procedure	In-house method WI-UV-702-01 based on ASTM E275-01
Traceability	Wavelength Accuracy is traceable to certificate No. 94780 and 94775 Photometric Accuracy is traceable to certificate No. 94808 and 100147 Stray Light is traceable to certificate No. 94791 The above certificate are traceble to SI unit through Starna Scientific Ltd. (UKAS accredited calibration laboratory NO. 0659)
Calibrated by	Mr.Pannaphong Phanmekakul

Approved by

Mr.Kanchit Choothep
Technical Manager

The above results are valid exclusively for the calibrated item(s) as mention in this report / certificate.
Advertising the report / Certificate and publicity of the results are prohibited and also shall not be reproduced except in full, without written approval of the Bara Scientific Co., Ltd

COPY

Bara Scientific Co., Ltd.
968 U Chu Liang Building Floor7 Rama4 Road
Silom Bangrak Bangkok Thailand 10500
Tel : 02-6324300 Fax : 02-6375496-7
www.barascientific.com

Bara Scientific
Solution of Success

NSC-TISI-TIS 17025 CALIBRATION 0209

Certificate of Calibration

Calibration Results:

1.Wavelength Accuracy

Certified Wavelength (nm)	UUC (nm)	Error (nm)	Uncertainty (±nm)
287.71	287.65	-0.06	0.18
445.82	445.80	-0.02	0.18
536.52	536.35	-0.17	0.18
741.02	740.99	-0.03	0.18
879.41	879.27	-0.14	0.18

2.Photometric Accuracy (UV)

Wavelength (nm)	Certified Absorbance (A)	UUC (A)	Error (A)	Uncertainty (±A)
235	0.0000	0.0000	0.0000	0.0075
	0.7311	0.7313	0.0002	0.0075
257	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
313	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
350	0.0000	0.0000	0.0000	0.0075
	0.6306	0.6314	0.0008	0.0075

*CNR = Customer not request

COPY

The above results are valid exclusively for the calibrated item(s) as mention in this report / certificate.
Advertising the report / Certificate and publicity of the results are prohibited and also shall not be reproduced except in full, without written approval of the Bara Scientific Co., Ltd.

Bara Scientific
Solution of Success

Bara Scientific Co., Ltd.
968 U Chu Liang Building Floor7 Rama4 Road
Silom Bangrak Bangkok Thailand 10500
Tel : 02-6324300 Fax : 02-6375496-7
www.barascientific.com

NSC-TISI-TIS 17025
CALIBRATION 0209

Certificate of Calibration

Certificate No. BSCC-UV-152/23

Number of Page(s) 3 of 3

Calibration Results:

3.Photometric Accuracy (Visible)

Wavelength (nm)	Certified Absorbance (A)	UUC (A)	Error (A)	Uncertainty (±A)
420.0	0.0000	0.0000	0.0000	0.0042
	0.5488	0.5508	0.0020	0.0042
	0.7527	0.7535	0.0008	0.0042
	1.0756	1.0758	0.0002	0.0042
440.0	0.0000	0.0000	0.0000	0.0042
	0.5391	0.5406	0.0015	0.0042
	0.7355	0.7360	0.0005	0.0042
	1.0509	1.0501	-0.0008	0.0042
465.0	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
546.1	0.0000	0.0000	0.0000	0.0042
	0.5045	0.5044	-0.0001	0.0042
	0.6884	0.6885	0.0001	0.0042
	0.9816	0.9808	-0.0008	0.0042
590.0	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
	CNR	CNR	CNR	CNR
635.0	0.0000	0.0000	0.0000	0.0042
	0.5183	0.5178	-0.0005	0.0042
	0.6864	0.6868	0.0004	0.0042
	0.9747	0.9739	-0.0008	0.0042

*CNR = Customer not request

4.Stray Light*

Standard	Unit Under Calibration(UUC)		
cut-off wavelenght (nm)	Wavelength (nm)	Transmission (%T)	Absorbance (A)
200.75±0.11nm	200.72	0.9630	2.0164

The Stray light transmission reference is less than 1.0%T and Stray light absorbance reference is greater than 2.00A
***Stray Light not NSC-ONSC Accredited.**

The measurement uncertainty is base on a standard uncertainty multiplied by a coverage factor k=2 providing a level of confidence of approximately 95%

*****End of Certificate*****

The above results are valid exclusively for the calibrated item(s) as mention in this report / certificate. Advertising the report / Certificate and publicity of the results are prohibited and also shall not be reproduced except in full, without written approval of the Bara Scientific Co., Ltd

COPY

SOUND LEVEL CALIBRATOR

MODEL : NC-75

SERIAL No. : 34802645

SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Rd.,Bangbumru, Bangplud Bangkok 10700 THAILAND.
Tel.0-2435-8800 Fax.0-2433-1679 e-mail:cal-center@sithiphorn.com http://www.sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACC23037
Pages : 1 of 3

Calibration Certificate

Equipment : SOUND CALIBRATOR
Manufacturer : RION
Model : NC-75
Serial No.: 34802645
ID No.: -

Condition As Found : GOOD

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
SAHA GROUP INDUSTRIAL PARK, 683 MOO 1,
NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.

Location : -
Ambient Temperature : (23.0 ±3) °C
Pressure : (101.3 ±3) kPa
Relative Humidity : (50.0 ±20) %

Received Date : 06 SEPTEMBER 2023
Calibration Date : 12 OCTOBER 2023
Date of Issue : 16 OCTOBER 2023

Calibrated by : Nathakorn Pisutpaisan

Approved by : T. Petchurai
(Thanakul Petchurai)

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

COPY

Calibration Procedure : CP-AC-03

Calibration Method :
This equipment was calibrated by based on IEC-60942-2003 Standard.
The sound pressure level, frequency and total distortion of the sound calibrator was measured using the reference microphone.

Condition of this result of calibration :
1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33511B	MY52302742	EF-0010-23	07-FEB-24
Digital Multimeter	33461A	MY53220104	EEL.BP 30/0266	13-FEB-24
Digital Multimeter	33461A	MY53220076	EEL.BP 30/0267	13-FEB-24
Digital Multimeter	33461A	MY60024273	EEL.BP 31/0266	14-FEB-24
Programmable Attenuator	MAT-1070	62100114	EF-0011-23	08-FEB-24
Condenser Microphone	4180	2977900	AA-1001-23	14-FEB-24
Measuring Amplifier	NA-42KAI	34560495	AA-3002-23	14-FEB-24
Audio Analyzer	AVR-3360A	V744B6069	EF-0012-23	10-FEB-24

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   3.1 National Institute of Metrology (Thailand).
   3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

T. Petchurai

SITHIPORN Associates

SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

Cert. No. : ACC23037
Job No. : VC66AC0097
Pages : 3 of 3

Result of calibration :

1. Sound pressure level

Specified sound pressure level (dB)	Measured value (dB)	Deviated value (dB)	Uncertainty (dB)	Acceptance limit (dB)
94	93.94	-0.06	0.14	0.40

2. Frequency

Specified Frequency (Hz)	Measured value (Hz)	Deviated value (%)	Uncertainty (%)	Acceptance limit (%)
1000	1000.0	0.0	0.1	1.0

3. Total distortion

Measured value (%)	Uncertainty (%)	Acceptance limit (%)
0.24	0.10	3.0

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

T. Petch

SOUND LEVEL METER

MODEL : NL-52A

SERIAL No. : 01120953

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Pages : 1 of 8

Calibration Certificate

Equipment :	SOUND LEVEL METER
Manufacturer :	RION
Model :	NL-52A / Microphone UC-59 / Preamplifier NH-25
Serial No.:	01120953 / 22355 / 22342
ID No.:	-

Condition As Found : GOOD

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
SAHA GROUP INDUSTRIAL PARK, 683 MOO 11,
NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.

Location :	-	
Ambient Temperature :	(23.0 ± 3)	°C
Pressure :	(101.3 ± 3)	kPa
Relative Humidity :	(50.0 ± 20)	%

Received Date :	11 JANUARY 2024
Calibration Date :	16 - 17 JANUARY 2024
Date of Issue :	18 JANUARY 2024

Calibrated by : Nathakorn Pisutpaisan

Approved by : T. Petchurai.
(Thanakul Petchurai)

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Job No. : VC67AC0042
Pages : 2 of 8

Calibration Procedure : CP-AC-01

Calibration Method :

This equipment was calibrated by follow on IEC-61672-3 (2013) Standard for sound level meter (SLM).
The SLM had tests to Acoustical and Electrical signal tests of frequency weighting with Anechoic chamber and Reference Standard Instruments.
For tests results of each items were made by observation of each Instruments display and also with SLM's display.

Condition of this result of calibration :

1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33210A	MY48017076	EF-0009-23	07-FEB-24
Waveform Generator	33511B	MY52302742	EF-0010-23	07-FEB-24
Digital Multimeter	33461A	MY53220104	EEL.BP 30/0266	13-FEB-24
Digital Multimeter	33461A	MY53220076	EEL.BP 29/0266	13-FEB-24
Digital Multimeter	34461A	MY60024273	EEL.BP 31/0266	14-FEB-24
Programmable Attenuator	MAT-1070	62100114	EF-0011-23	08-FEB-24
Condenser Microphone	4180	2977900	AA-1001-23	14-FEB-24
Measuring Amplifier	NA-42KAI	34560495	AA-3002-23	14-FEB-24

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   3.1 National Institute of Metrology (Thailand).
   3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

T. Petchurai.

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Job No. : VC67AC0042
Pages : 3 of 8

Summary of Measurement Result :

Parameter	Uncertainty (dB)	Maximum-permitted uncertainty of measurement (dB)
1. Absolute sensitivity	0.2	N/A
2. Self-generated noise	0.2	N/A
3. Acoustical signal tests of frequency weightings		
125 Hz	0.3	0.6
1000 Hz	0.3	0.6
8000 Hz	0.3	0.7
4. Electrical signal tests of frequency weightings		
For 10 Hz to 4 kHz	0.3	0.6
For > 4 kHz to 10 kHz	0.3	0.7
For > 10 kHz to 20 kHz	0.3	1.0
5. Frequency and time weightings at 1 kHz	0.2	0.2
6. Long - term stability	0.1	0.1
7. Level linearity on the reference level range	0.2	0.3
8. Level linearity including the level range control	0.2	0.3
9. Tone burst response	0.2	0.3
10. Peak C sound level	0.2	0.35
11. Overload indication	0.2	0.25
12. High level stability	0.1	0.1

COPY

T. Ketchan

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Job No. : VC67AC0042
Pages : 4 of 8

Result of calibration :

1. Absolute sensitivity

Reference Acoustic Signal (dB)	Measured Valuc (dB)	Deviation (dB)	Acceptance Limit (dB)
93.9 (93.98)	94.0	0.0	±0.3

2. Self-generated noise

2.1 Normal test

Measured Value (dB)
13.4

2.2 The microphone of the sound level meter was replaced by electrical signal input device.

Frequency Weighting	Measured value (dB)
A - weight	9.9
C - weight	14.8
Flat	20.7

3. Acoustical signal tests of frequency weightings

Meter free-field acoustic response at a level of 84 dB

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
125	0.1	0.1	0.1	± 1.0
1000	0.1	0.1	0.1	± 0.7
8000	0.1	0.2	0.2	+ 1.5, - 2.5

COPY

T. Ketchan

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Job No. : VC67AC0042
Pages : 5 of 8

4. Electrical signal tests of frequency weightings

Weighting network response with relative to 1 kHz.

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
63	0.0	0.0	0.0	±1.0
125	0.0	0.1	0.1	±1.0
250	0.1	0.0	0.0	±1.0
500	0.1	0.1	0.0	±1.0
1000	0.0	0.0	0.0	±1.0
2000	0.0	0.1	0.0	±1.0
4000	0.0	0.1	0.0	±1.0
8000	0.0	0.1	0.1	+ 1.5, - 2.5
16000	0.0	-1.2	-1.1	+ 2.5, -16.0

5. Frequency and time weightings at 1 kHz

5.1 Frequency weightings at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.2
C - weight	94.0	94.0	0.0	± 0.2
Flat	94.0	94.0	0.0	± 0.2

5.2 Time weighting at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	94.0	94.0	0.0	± 0.1
Slow	94.0	94.0	0.0	+ 0.1
Leq	94.0	94.0	0.0	± 0.1

6. Long - term stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.1	0.1	± 0.1

COPY

T. Retch.

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Job No. : VC67AC0042
Pages : 6 of 8

7. Level linearity on the reference level range

Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
137.0	137.1	0.1	±0.8
136.0	136.1	0.1	±0.8
135.0	135.1	0.1	±0.8
134.0	134.1	0.1	±0.8
133.0	133.0	0.0	±0.8
132.0	132.0	0.0	±0.8
131.0	131.0	0.0	±0.8
129.0	129.0	0.0	±0.8
124.0	124.0	0.0	±0.8
119.0	119.0	0.0	±0.8
114.0	114.0	0.0	±0.8
109.0	109.0	0.0	±0.8
104.0	104.1	0.1	±0.8
99.0	99.0	0.0	±0.8
94.0	94.0	0.0	±0.8
89.0	89.0	0.0	±0.8
84.0	84.0	0.0	±0.8
79.0	79.0	0.0	±0.8
74.0	74.0	0.0	±0.8
69.0	69.0	0.0	±0.8
64.0	64.0	0.0	±0.8
59.0	59.0	0.0	±0.8
54.0	54.0	0.0	±0.8
49.0	49.0	0.0	±0.8
44.0	44.0	0.0	±0.8
39.0	39.0	0.0	±0.8
34.0	34.0	0.0	±0.8
30.0	30.0	0.0	±0.8
29.0	29.0	0.0	±0.8
28.0	28.0	0.0	±0.8
27.0	27.0	0.0	±0.8
26.0	26.0	0.0	±0.8
25.0	24.9	-0.1	±0.8

COPY

T. Retch.

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Job No. : VC67AC0042
Pages : 7 of 8

8. Level linearity including the level range control

Range	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Auto	94.0	94.0	0.0	±0.8

9. Tone burst response

Time Weighting	Tone burst duration, Tb (ms)	Cycle	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	0.25	1	108.0	107.9	-0.1	1.0 ; -3.0
	2	8	117.0	116.9	-0.1	1.0 ; -1.5
	200	800	134.0	134.0	0.0	±0.5
Slow	2	8	108.0	108.0	0.0	1.0 ; -3.0
	200	800	127.6	127.6	0.0	±0.5
SEL	0.25	1	99.0	98.8	-0.2	1.0 ; -3.0
	2	8	108.0	107.9	-0.1	1.0 ; -1.5
	200	800	128.0	128.0	0.0	±0.5

10. Peak C sound level

Number of cycle in test signal	Anticipated Value (dB)	Measured Value, Lcpeak (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±2.0
One	136.4	135.3	-1.1	±2.0

Number of cycle in test signal	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±1.0
Positive half cycle	135.4	135.1	-0.3	±1.0
Negative half cycle	135.4	135.1	-0.3	±1.0

COPY

T. Ketch.

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24046
Job No. : VC67AC0042
Pages : 8 of 8

11. Overload indication

Measured value (dB)		Deviated Value (dB)	Acceptance Limits (dB)
Positive one-half cycle	Negative one-half cycle		
89.6	89.7	0.1	±1.5

12. High level stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	137.0	137.0	0.0	±0.1

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

T. Ketch.

SOUND LEVEL METER

MODEL : NL-52A

SERIAL No. : 01120952

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24045
Pages : 1 of 8

Calibration Certificate

Equipment :	SOUND LEVEL METER
Manufacturer :	RION
Model :	NL-52A / Microphone UC-59 / Preamplifier NH-25
Serial No.:	01120932 / 22709 / 22427
ID No.:	-

Condition As Found : GOOD

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
SAHA GROUP INDUSTRIAL PARK, 683 MOO 11,
NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.

Location :	-	
Ambient Temperature :	(23.0 ± 3)	°C
Pressure :	(101.3 ± 3)	kPa
Relative Humidity :	(50.6 ± 20)	%

Received Date :	11 JANUARY 2024
Calibration Date :	16 - 17 JANUARY 2024
Date of Issue :	18 JANUARY 2024

Calibrated by : Nathakorn Pisutpaisan

Approved by :

(Thanakul Petchurai)

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Calibration Procedure : CP-AC-01

Calibration Method :

This equipment was calibrated by follow on IEC-61672-3 (2013) Standard for sound level meter (SLM).

The SLM had tests to Acoustical and Electrical signal tests of frequency weighting with Anechoic chamber and Reference Standard Instruments.

For tests results of each items were made by observation of each Instruments display and also with SLM's display.

Condition of this result of calibration :

1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33210A	MY48017076	EF-0009-23	07-FEB-24
Waveform Generator	33511B	MY52302742	EF-0010-23	07-FEB-24
Digital Multimeter	33461A	MY53220104	EEL.BP 30/0266	13-FEB-24
Digital Multimeter	33461A	MY53220076	EEL.BP 29/0266	13-FEB-24
Digital Multimeter	34461A	MY60024273	EEL.BP 31/0266	14-FEB-24
Programmable Attenuator	MAT-1070	62100114	EF-0011-23	08-FEB-24
Condenser Microphone	4180	2977900	AA-1001-23	14-FEB-24
Measuring Amplifier	NA-42KAI	34560495	AA-3002-23	14-FEB-24

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   3.1 National Institute of Metrology (Thailand).
   3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24045
Job No. : VC67AC0042
Pages : 3 of 8

Summary of Measurement Result :

Parameter	Uncertainty (dB)	Maximum-permitted uncertainty of measurement (dB)
1. Absolute sensitivity	0.2	N/A
2. Self-generated noise	0.2	N/A
3. Acoustical signal tests of frequency weightings		
125 Hz	0.3	0.5
1000 Hz	0.3	0.5
8000 Hz	0.3	0.7
4. Electrical signal tests of frequency weightings		
For 10 Hz to 4 kHz	0.3	0.6
For > 4 kHz to 10 kHz	0.3	0.7
For > 10 kHz to 20 kHz	0.3	1.0
5. Frequency and time weightings at 1 kHz	0.2	0.2
6. Long - term stability	0.1	0.1
7. Level linearity on the reference level range	0.2	0.3
8. Level linearity including the level range control	0.2	0.3
9. Tone burst response	0.2	0.3
10. Peak C sound level	0.2	0.35
11. Overload indication	0.2	0.25
12. High level stability	0.1	0.1

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24045
Job No. : VC67AC0042
Pages : 4 of 8

Result of calibration :

1. Absolute sensitivity

Reference Acoustic Signal (dB)	Measured Value (dB)	Deviation (dB)	Acceptance Limit (dB)
93.9 (93.98)	94.0	0.0	±0.3

2. Self-generated noise

2.1 Normal test

Measured Value (dB)
13.6

2.2 The microphone of the sound level meter was replaced by electrical signal input device.

Frequency Weighting	Measured value (dB)
A - weight	9.2
C - weight	14.3
Flat	20.0

3. Acoustical signal tests of frequency weightings

Meter free-field acoustic response at a level of 84 dB

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
125	0.1	0.2	0.2	± 1.0
1000	0.1	0.1	0.1	± 0.7
8000	0.6	0.7	0.7	+ 1.5, - 2.5

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24045
Job No. : VC67AC0042

4. Electrical signal tests of frequency weightings

Weighting network response with relative to 1 kHz.

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
63	0.0	-0.1	0.0	±1.0
125	0.0	0.0	0.0	±1.0
250	0.0	0.0	0.0	±1.0
500	0.0	0.0	0.0	±1.0
1000	0.0	0.0	0.0	±1.0
2000	0.0	0.0	0.0	±1.0
4000	0.0	0.0	0.0	±1.0
8000	0.0	0.1	0.1	+1.5, -2.5
16000	0.0	-1.2	-1.2	+2.5, -16.0

5. Frequency and time weightings at 1 kHz

5.1 Frequency weightings at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.2
C - weight	94.0	94.0	0.0	± 0.2
Flat	94.0	94.0	0.0	± 0.2

5.2 Time weighting at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	94.0	94.0	0.0	± 0.1
Slow	94.0	94.0	0.0	± 0.1
Leq	94.0	94.0	0.0	± 0.1

6. Long - term stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.1

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24045
Job No. : VC67AC0042

7. Level linearity on the reference level range

Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
137.0	137.0	0.0	±0.8
136.0	136.0	0.0	±0.8
135.0	135.0	0.0	±0.8
134.0	134.0	0.0	±0.8
133.0	133.0	0.0	±0.8
132.0	132.0	0.0	±0.8
131.0	131.0	0.0	±0.8
129.0	129.0	0.0	±0.8
124.0	124.0	0.0	±0.8
119.0	119.0	0.0	±0.8
114.0	114.0	0.0	±0.8
109.0	109.0	0.0	±0.8
104.0	104.0	0.0	±0.8
99.0	99.0	0.0	±0.8
94.0	94.0	0.0	±0.8
89.0	89.0	0.0	±0.8
84.0	84.0	0.0	±0.8
79.0	79.0	0.0	±0.8
74.0	74.0	0.0	±0.8
69.0	69.0	0.0	±0.8
64.0	64.0	0.0	±0.8
59.0	59.0	0.0	±0.8
54.0	54.0	0.0	±0.8
49.0	49.0	0.0	±0.8
44.0	44.0	0.0	±0.8
39.0	39.0	0.0	±0.8
34.0	34.0	0.0	±0.8
30.0	30.0	0.0	±0.8
29.0	29.0	0.0	±0.8
28.0	28.0	0.0	±0.8
27.0	27.0	0.0	±0.8
26.0	26.0	0.0	±0.8
25.0	25.0	0.0	±0.8

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24045
Job No. : VC67AC0042
Pages : 7 of 8

8. Level linearity including the level range control

Range	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Auto	94.0	94.0	0.0	±0.8

9. Tone burst response

Time Weighting	Tone burst duration, Tb (ms)	Cycle	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	0.25	1	108.0	107.9	-0.1	1.0 ; -3.0
	2	8	117.0	117.0	0.0	1.0 ; -1.5
	200	800	134.0	134.0	0.0	±0.5
Slow	2	8	108.0	108.0	0.0	1.0 ; -3.0
	200	800	127.6	127.6	0.0	±0.5
SEL	0.25	1	98.0	98.0	-0.1	1.0 ; -3.0
	2	8	108.0	108.0	0.0	1.0 ; -1.5
	200	800	128.0	128.0	0.0	±0.5

10. Peak Sound level

Number of cycle in test signal	Anticipated Value (dB)	Measured Value, Lepeak (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±2.0
One	136.4	136.3	-0.1	±2.0

Number of cycle in test signal	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	132.9	-0.1	±1.0
Positive half cycle	135.4	135.1	-0.3	±1.0
Negative half cycle	135.4	135.1	-0.3	±1.0

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24045
Job No. : VC67AC0042
Pages : 8 of 8

11. Overload indication

Measured value (dB)		Deviated Value (dB)	Acceptance Limits (dB)
Positive one-half cycle	Negative one-half cycle		
89.6	89.5	-0.1	±1.5

12. High level stability

Frequency Weighting	SLM Display at Initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	137.0	137.0	0.0	±0.1

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

SOUND LEVEL METER

MODEL : NL-42

SERIAL No. : 01147299

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Pages : 1 of 8

Calibration Certificate

Equipment :	SOUND LEVEL METER
Manufacturer :	RION
Model :	NL-42 / Microphone UC-52 / Preamplifier NH-24
Serial No.:	01147299 / 133107 / 46657
ID No.:	-
Condition As Found :	GOOD
Customer :	EASTERN THAI CONSULTING 1992 CO., LTD. SAHA GROUP INDUSTRIAL PARK, 683 MOO 11, NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.
Location :	-
Ambient Temperature :	(23.0 ± 3) °C
Pressure :	(101.3 ± 3) kPa
Relative Humidity :	(50.0 ± 20) %
Received Date :	18 DECEMBER 2023
Calibration Date :	10 JANUARY 2024
Date of Issue :	12 JANUARY 2024

Calibrated by : Nathakorn Pisutpaisan

Approved by :

(Thanakul Petchurai)

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Job No. : VC67AC0039
Pages : 2 of 8

Calibration Procedure : CP-AC-01

Calibration Method :

This equipment was calibrated by follow on IEC-61672-3 (2013) Standard for sound level meter (SLM).
The SLM had tests to Acoustical and Electrical signal tests of frequency weighting with Anechoic chamber and Reference Standard Instruments.
For tests results of each items were made by observation of each Instruments display and also with SLM's display.

Condition of this result of calibration :

1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33210A	MY48017076	EF-0009-23	07-FEB-24
Waveform Generator	33511B	MY52302742	EF-0010-23	07-FEB-24
Digital Multimeter	33461A	MY53220104	EEL.BP 30/0266	13-FEB-24
Digital Multimeter	33461A	MY53220076	EEL.BP 29/0266	13-FEB-24
Digital Multimeter	34461A	MY60024273	EEL.BP 31/0266	14-FEB-24
Programmable Attenuator	MAT-1070	62100114	EF-0011-23	08-FEB-24
Condenser Microphone	4180	2977900	AA-1001-23	14-FEB-24
Measuring Amplifier	NA-42KAI	34560495	AA-3002-23	14-FEB-24

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   - 3.1 National Institute of Metrology (Thailand).
   - 3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Job No. : VC67AC0039
Pages : 3 of 8

Summary of Measurement Result :

Parameter	Uncertainty (dB)	Maximum-permitted uncertainty of measurement (dB)
1. Absolute sensitivity	0.2	N/A
2. Self-generated noise	0.2	N/A
3. Acoustical signal tests of frequency weightings		
125 Hz	0.3	0.6
1000 Hz	0.3	0.6
8000 Hz	0.3	0.7
4. Electrical signal tests of frequency weightings		
For 10 Hz to 4 kHz	0.3	0.6
For > 4 kHz to 10 kHz	0.3	0.7
For > 10 kHz to 20 kHz	-	1.0
5. Frequency and time weightings at 1 kHz	0.2	0.2
6. Long - term stability	0.1	0.1
7. Level linearity on the reference level range	0.2	0.3
8. Level linearity including the level range control	0.2	0.3
9. Tone burst response	0.2	0.3
10. Peak C sound level	0.2	0.35
11. Overload indication	0.2	0.25
12. High level stability	0.1	0.1

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Job No. : VC67AC0039
Pages : 4 of 8

Result of calibration :

1. Absolute sensitivity

Reference Acoustic Signal (dB)	Measured Value (dB)	Deviation (dB)	Acceptance Limit (dB)
93.9 (93.98)	93.9	0.0	±0.3

2. Self-generated noise

2.1 Normal test

Measured Value (dB)
24.2

2.2 The microphone of the sound level meter was replaced by electrical signal input device.

Frequency Weighting	Measured value (dB)
A - weight	18.3
C - weight	24.4
Flat	29.9

3. Acoustical signal tests of frequency weightings

Meter free-field acoustic response at a level of 84 dB

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
125	0.3	0.4	0.4	± 1.5
1000	-0.4	-0.4	-0.4	± 1.0
8000	-3.6	-3.5	-3.5	±5.0

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiporn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Job No. : VC67AC0039

4. Electrical signal tests of frequency weightings

Weighting network response with relative to 1 kHz.

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
63	0.0	0.0	0.0	±2.0
125	0.0	0.0	-0.1	±1.5
250	0.0	0.0	-0.1	±1.5
500	0.0	0.0	-0.1	±1.5
1000	0.0	0.0	0.0	±1.0
2000	0.0	0.0	0.0	±2.0
4000	0.0	0.0	0.0	±3.0
8000	0.0	0.0	0.0	±5.0

5. Frequency and time weightings at 1 kHz

5.1 Frequency weightings at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.2
C - weight	94.0	94.0	0.0	± 0.2
Flat	94.0	94.0	0.0	± 0.2

5.2 Time weighting at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	94.0	94.0	0.0	± 0.1
Slow	94.0	94.0	0.0	± 0.1
Leq	94.0	94.0	0.0	± 0.1

6. Long - term stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.3

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiporn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Job No. : VC67AC0039

7. Level linearity on the reference level range

Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
137.0	137.0	0.0	± 1.1
136.0	136.0	0.0	± 1.1
135.0	135.1	0.1	± 1.1
134.0	134.1	0.1	± 1.1
133.0	133.0	0.0	± 1.1
132.0	132.0	0.0	± 1.1
131.0	131.0	0.0	± 1.1
129.0	129.0	0.0	± 1.1
124.0	124.0	0.0	± 1.1
119.0	119.1	0.1	± 1.1
114.0	114.1	0.1	± 1.1
109.0	109.0	0.0	± 1.1
104.0	104.1	0.1	± 1.1
99.0	99.0	0.0	± 1.1
94.0	94.0	0.0	± 1.1
89.0	89.0	0.0	± 1.1
84.0	84.0	0.0	± 1.1
79.0	79.0	0.0	± 1.1
74.0	74.0	0.0	± 1.1
69.0	69.0	0.0	± 1.1
64.0	64.0	0.0	± 1.1
59.0	59.0	0.0	± 1.1
54.0	54.0	0.0	± 1.1
49.0	49.0	0.0	± 1.1
44.0	44.0	0.0	± 1.1
39.0	39.0	0.0	± 1.1
34.0	34.0	0.0	± 1.1
30.0	30.0	0.0	± 1.1
29.0	29.1	0.1	± 1.1
28.0	28.2	0.2	± 1.1
27.0	27.3	0.3	± 1.1
26.0	26.3	0.3	± 1.1
25.0	25.4	0.4	± 1.1

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Job No. : VC67AC0039
Pages : 7 of 8

8. Level linearity including the level range control

Range	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Auto	94.0	94.0	0.0	±1.1

9. Tone burst response

Time Weighting	Tone burst duration, Tb (ms)	Cycle	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	0.25	1	108.0	107.9	-0.1	1.5 ; -5.0
	2	8	117.0	116.9	-0.1	1.0 ; -2.5
	200	800	134.0	134.0	0.0	±1.0
Slow	2	8	108.0	108.0	0.0	1.5 ; -5.0
	200	800	127.6	127.6	0.0	±1.0
SEL	0.25	1	99.0	98.8	-0.2	1.5 ; -5.0
	2	8	108.0	107.9	-0.1	1.0 ; -2.5
	200	800	128.0	128.0	0.0	±1.0

10. Peak C sound level

Number of cycle in test signal	Anticipated Value (dB)	Measured Value, Lcpeak (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±3.0
One	136.4	135.8	-0.6	±3.0

Number of cycle in test signal	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±2.0
Positive half cycle	135.4	135.1	-0.3	±2.0
Negative half cycle	135.4	135.1	-0.3	±2.0

COPY

T. Ketch

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY
451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24022
Job No. : VC67AC0039
Pages : 8 of 8

11. Overload indication

Measured value (dB)		Deviated Value (dB)	Acceptance Limits (dB)
Positive one-half cycle	Negative one-half cycle		
89.5	89.5	0.0	±1.5

12. High level stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	137.0	137.0	0.0	±0.3

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

T. Ketch

SOUND LEVEL METER

MODEL : NL-42A

SERIAL No. : 00322745

SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Rd.,Bangbumru, Bangplud Bangkok 10700 THAILAND.
Tel.0-2435-8800 Fax.0-2433-1679 e-mail:cal-center@sithiphorn.com http://www.sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Calibration Certificate

Equipment :	SOUND LEVEL METER
Manufacturer :	RION
Model :	NL-42A/ Microphone UC-52 / Preamplifier NH-24
Serial No.:	00322745 / 196468 / 15477
ID No.:	-
Condition As Found :	GOOD
Customer :	EASTERN THAI CONSULTING 1992 CO., LTD. SAHA GROUP INDUSTRIAL PARK, 683 MOO 11, NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.
Location :	-
Ambient Temperature :	(23.0 ± 3) °C
Pressure :	(101.3 ± 3) kPa
Relative Humidity :	(50.0 ± 20) %
Received Date :	10 MAY 2023
Calibration Date :	17 -18 MAY 2023
Date of Issue :	24 MAY 2023

Calibrated by : Nathakorn Pisutpaisan

Approved by : T. Petchurai

(Thanakul Petchurai)

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

COPY

Calibration Procedure : CP-AC-01

Calibration Method :

This equipment was calibrated by based on IEC-61672-3 (2013) Standard for sound level meter (SLM).
The SLM had tests to Acoustical and Electrical signal tests of frequency weighting with Anechoic chamber and Reference Standard Instruments.
For tests results of each items were made by observation of each Instruments display and also with SLM's display.

Condition of this result of calibration :

1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33210A	MY48017076	EF-0009-23	07-FEB-24
Waveform Generator	33511B	MY52302742	EF-0010-23	07-FEB-24
Digital Multimeter	33461A	MY53220104	EEL.BP 30/0266	13-FEB-24
Digital Multimeter	33461A	MY53220076	EEL.BP 29/0266	13-FEB-24
Digital Multimeter	34461A	MY60024273	EEL.BP 31/0266	14-FEB-24
Programmable Attenuator	MAT-1070	62100114	EF-0011-23	08-FEB-24
Condenser Microphone	4180	2977900	AA-1001-23	14-FEB-24
Measuring Amplifier	NA-42KAI	34560495	AA-3002-23	14-FEB-24

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   - 3.1 National Institute of Metrology (Thailand).
   - 3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

Summary of Measurement Result :

Parameter	Pass	Fail	Uncertainty (dB)	Maximum-permitted uncertainty of measurement (dB)
1. Absolute sensitivity	✓	-	0.2	N/A
2. Self-generated noise	✓	-	0.2	N/A
3. Acoustical signal tests of frequency weightings				
125 Hz	✓	-	0.3	0.6
1000 Hz	✓	-	0.3	0.6
8000 Hz	✓	-	0.3	0.7
4. Electrical signal tests of frequency weightings				
For 10 Hz to 4 kHz	✓	-	0.3	0.6
For > 4 kHz to 10 kHz	✓	-	0.3	0.7
For > 10 kHz to 20 kHz	-	-	-	1.0
5. Frequency and time weightings at 1 kHz	✓	-	0.2	0.2
6. Long - term stability	✓	-	0.1	0.1
7. Level linearity on the reference level range	✓	-	0.2	0.3
8. Level linearity including the level range control	✓	-	0.2	0.3
9. Tone burst response	✓	-	0.2	0.3
10. Peak C sound level	✓	-	0.2	0.35
11. Overload indication	✓	-	0.2	0.25
12. High level stability	✓	-	0.1	0.1

Note : Pass/Fail evaluation for each parameter,
will be considered together from the acceptance limit and the Maximum-permitted uncertainty of measurement.

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

Cert. No. : ACL23166
Job No. : VC66AC0058
Pages : 4 of 8

Result of calibration :

1. Absolute sensitivity

Reference Acoustic Signal (dB)	Measured Value (dB)	Deviation (dB)	Acceptance Limit (dB)
93.9 (93.98)	93.9	0.0	±0.3

2. Self-generated noise

2.1 Normal test

Measured Value (dB)
14.8

2.2 The microphone of the sound level meter was replaced by electrical signal input device.

Frequency Weighting	Measured value (dB)
A - weight	10.8
C - weight	17.2
Flat	23.0

3. Acoustical signal tests of frequency weightings

Meter free-field acoustic response at a level of 84 dB

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
125	0.2	0.3	0.3	± 1.5
1000	0.0	0.0	0.0	± 1.0
8000	0.5	0.6	0.6	±5.0

COPY

QF-TS12-04-04-020664

4. Electrical signal tests of frequency weightings

Weighting network response with relative to 1 kHz.

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
63	0.0	-0.1	0.0	±2.0
125	0.0	0.0	0.0	±1.5
250	0.0	0.0	0.0	±1.5
500	0.0	0.0	0.0	±1.5
1000	0.0	0.0	0.0	±1.0
2000	0.0	0.0	0.0	±2.0
4000	0.0	0.0	0.0	±3.0
8000	0.0	0.1	0.1	±5.0

5. Frequency and time weightings at 1 kHz

5.1 Frequency weightings at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.2
C - weight	94.0	94.0	0.0	± 0.2
Flat	94.0	94.0	0.0	± 0.2

5.2 Time weighting at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	94.0	94.0	0.0	± 0.1
Slow	94.0	94.0	0.0	± 0.1
Leq	94.0	94.0	0.0	± 0.1

6. Long - term stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.3

COPY

SITHIPORN Associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

7. Level linearity on the reference level range

Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
137.0	137.0	0.0	± 1.1
136.0	136.0	0.0	± 1.1
135.0	135.0	0.0	± 1.1
134.0	134.0	0.0	± 1.1
133.0	133.0	0.0	± 1.1
132.0	132.0	0.0	± 1.1
131.0	131.0	0.0	± 1.1
129.0	129.0	0.0	± 1.1
124.0	124.0	0.0	± 1.1
119.0	119.0	0.0	± 1.1
114.0	114.0	0.0	± 1.1
109.0	109.0	0.0	± 1.1
104.0	104.0	0.0	± 1.1
99.0	99.0	0.0	± 1.1
94.0	94.0	0.0	± 1.1
89.0	89.0	0.0	± 1.1
84.0	84.0	0.0	± 1.1
79.0	79.0	0.0	± 1.1
74.0	74.0	0.0	± 1.1
69.0	69.0	0.0	± 1.1
64.0	64.0	0.0	± 1.1
59.0	59.0	0.0	± 1.1
54.0	53.9	-0.1	± 1.1
49.0	49.0	0.0	± 1.1
44.0	44.0	0.0	± 1.1
39.0	38.9	-0.1	± 1.1
34.0	33.9	-0.1	± 1.1
30.0	29.9	-0.1	± 1.1
29.0	28.9	-0.1	± 1.1
28.0	28.0	0.0	± 1.1
27.0	27.0	0.0	± 1.1
26.0	26.1	0.1	± 1.1
25.0	25.0	0.0	± 1.1

COPY

8. Level linearity including the level range control

Range	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Auto	94.0	94.0	0.0	±1.1

9. Tone burst response

Time Weighting	Tone burst duration, Tb (ms)	Cycle	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	0.25	1	108.0	107.9	-0.1	1.5 ; -5.0
	2	8	117.0	117.0	0.0	1.0 ; -2.5
	200	800	134.0	134.0	0.0	±1.0
Slow	2	8	108.0	108.0	0.0	1.5 ; -5.0
	200	800	127.6	127.6	0.0	±1.0
SEL	0.25	1	99.0	98.9	-0.1	1.5 ; -5.0
	2	8	108.0	108.0	0.0	1.0 ; -2.5
	200	800	128.0	128.0	0.0	±1.0

10. Peak C sound level

Number of cycle in test signal	Anticipated Value (dB)	Measured Value, Lcpeak (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±3.0
One	136.4	136.2	-0.2	±3.0

Number of cycle in test signal	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±2.0
Positive half cycle	135.4	135.2	-0.2	±2.0
Negative half cycle	135.4	135.2	-0.2	±2.0

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

11. Overload indication

Measured value (dB)		Deviated Value (dB)	Acceptance Limits (dB)
Positive one-half cycle	Negative one-half cycle		
89.8	89.6	-0.2	±1.5

12. High level stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	137.0	137.0	0.0	±0.3

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

SOUND LEVEL METER

MODEL : NL-42A

SERIAL No. : 00322752

SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Rd.,Bangbumru, Bangplud Bangkok 10700 THAILAND.
Tel.0-2435-8800 Fax.0-2433-1679 e-mail:cal-center@sithiphorn.com http://www.sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL23141
Pages : 1 of 8

Calibration Certificate

Equipment : SOUND LEVEL METER
Manufacturer : RION
Model : NL-42A/ Microphone UC-52 / Preamplifier NH-24
Serial No.: 00322752 / 196475 / 15484
ID No.: -

Condition As Found : GOOD

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
SAHA GROUP INDUSTRIAL PARK, 683 MOO 11,
NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.

Location : -
Ambient Temperature : (23.0 ±3) °C
Pressure : (101.3 ±3) kPa
Relative Humidity : (50.0 ±20) %

Received Date : 02 MAY 2023
Calibration Date : 02 -04 MAY 2023
Date of Issue : 05 MAY 2023

Calibrated by : Nathakorn Pisutpaisan

Approved by : T. Petchurai.
(Thanakul Petchurai)

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

COPY

Calibration Procedure : CP-AC-01

Calibration Method :

This equipment was calibrated by based on IEC-61672-3 (2013) Standard for sound level meter (SLM).
The SLM had tests to Acoustical and Electrical signal tests of frequency weighting with Anechoic chamber and Reference Standard Instruments.
For tests results of each items were made by observation of each Instruments display and also with SLM's display.

Condition of this result of calibration :

1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33210A	MY48017076	EF-0009-23	07-FEB-24
Waveform Generator	33511B	MY52302742	EF-0010-23	07-FEB-24
Digital Multimeter	33461A	MY53220104	EEL.BP 30/0266	13-FEB-24
Digital Multimeter	33461A	MY53220076	EEL.BP 29/0266	13-FEB-24
Digital Multimeter	34461A	MY60024273	EEL.BP 31/0266	14-FEB-24
Programmable Attenuator	MAT-1070	62100114	EF-0011-23	08-FEB-24
Condenser Microphone	4180	2977900	AA-1001-23	14-FEB-24
Measuring Amplifier	NA-42KAI	34560495	AA-3002-23	14-FEB-24

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   3.1 National Institute of Metrology (Thailand).
   3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

Summary of Measurement Result :

Parameter	Pass	Fail	Uncertainty (dB)	Maximum-permitted uncertainty of measurement (dB)
1. Absolute sensitivity	✓	-	0.2	N/A
2. Self-generated noise	✓	-	0.2	N/A
3. Acoustical signal tests of frequency weightings				
125 Hz	✓	-	0.3	0.6
1000 Hz	✓	-	0.3	0.6
8000 Hz	✓	-	0.3	0.7
4. Electrical signal tests of frequency weightings				
For 10 Hz to 4 kHz	✓	-	0.3	0.6
For > 4 kHz to 10 kHz	✓	-	0.3	0.7
For > 10 kHz to 20 kHz	-	-	-	1.0
5. Frequency and time weightings at 1 kHz	✓	-	0.2	0.2
6. Long - term stability	✓	-	0.1	0.1
7. Level linearity on the reference level range	✓	-	0.2	0.3
8. Level linearity including the level range control	✓	-	0.2	0.3
9. Tone burst response	✓	-	0.2	0.3
10. Peak C sound level	✓	-	0.2	0.35
11. Overload indication	✓	-	0.2	0.25
12. High level stability	✓	-	0.1	0.1

Note : Pass/Fail evaluation for each parameter,
will be considered together from the acceptance limit and the Maximum-permitted uncertainty of measurement.

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

Result of calibration :

1. Absolute sensitivity

Reference Acoustic Signal (dB)	Measured Value (dB)	Deviation (dB)	Acceptance Limit (dB)
93.9 (93.98)	93.9	0.0	±0.3

2. Self-generated noise

2.1 Normal test

Measured Value (dB)
14.6

2.2 The microphone of the sound level meter was replaced by electrical signal input device.

Frequency Weighting	Measured value (dB)
A - weight	9.9
C - weight	16.8
Flat	22.6

3. Acoustical signal tests of frequency weightings

Meter free-field acoustic response at a level of 84 dB

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
125	0.3	0.3	0.3	± 1.5
1000	0.0	0.0	0.0	± 1.0
8000	0.9	1.0	1.0	±5.0

COPY

Continuation of Calibration Certificate

Cert. No. : ACL23141
Job No. : VC66AC0047
Pages : 5 of 8

4. Electrical signal tests of frequency weightings

Weighting network response with relative to 1 kHz.

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
63	0.0	-0.1	-0.1	±2.0
125	0.0	0.0	0.0	±1.5
250	0.0	0.0	-0.1	±1.5
500	0.0	0.0	0.0	±1.5
1000	0.0	0.0	0.0	±1.0
2000	0.0	0.0	0.0	±2.0
4000	0.0	0.0	0.0	±3.0
8000	0.0	0.1	0.1	±5.0

5. Frequency and time weightings at 1 kHz

5.1 Frequency weightings at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.2
C - weight	94.0	94.0	0.0	± 0.2
Flat	94.0	94.0	0.0	± 0.2

5.2 Time weighting at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	94.0	94.0	0.0	± 0.1
Slow	94.0	94.0	0.0	± 0.1
Leq	94.0	94.0	0.0	± 0.1

6. Long - term stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.3

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

Cert. No. : ACL23141
Job No. : VC66AC0047
Pages : 6 of 8

7. Level linearity on the reference level range

Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
137.0	137.0	0.0	± 1.1
136.0	136.0	0.0	± 1.1
135.0	135.0	0.0	± 1.1
134.0	134.0	0.0	± 1.1
133.0	133.0	0.0	± 1.1
132.0	132.0	0.0	± 1.1
131.0	131.0	0.0	± 1.1
129.0	129.0	0.0	± 1.1
124.0	124.0	0.0	± 1.1
119.0	119.0	0.0	± 1.1
114.0	114.0	0.0	± 1.1
109.0	109.0	0.0	± 1.1
104.0	104.0	0.0	± 1.1
99.0	99.0	0.0	± 1.1
94.0	94.0	0.0	± 1.1
89.0	89.1	0.1	± 1.1
84.0	84.1	0.1	± 1.1
79.0	79.1	0.1	± 1.1
74.0	74.1	0.1	± 1.1
69.0	69.1	0.1	± 1.1
64.0	64.0	0.0	± 1.1
59.0	59.1	0.1	± 1.1
54.0	54.0	0.0	± 1.1
49.0	49.0	0.0	± 1.1
44.0	44.0	0.0	± 1.1
39.0	39.0	0.0	± 1.1
34.0	34.0	0.0	± 1.1
30.0	29.9	-0.1	± 1.1
29.0	28.9	-0.1	± 1.1
28.0	27.9	-0.1	± 1.1
27.0	26.9	-0.1	± 1.1
26.0	25.9	-0.1	± 1.1
25.0	24.9	-0.1	± 1.1

COPY

8. Level linearity including the level range control

Range	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Auto	94.0	94.0	0.0	±1.1

9. Tone burst response

Time Weighting	Tone burst duration, Tb (ms)	Cycle	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	0.25	1	108.0	107.9	-0.1	1.5 ; -5.0
	2	8	117.0	117.0	0.0	1.0 ; -2.5
	200	800	134.0	134.0	0.0	±1.0
Slow	2	8	108.0	108.0	0.0	1.5 ; -5.0
	200	800	127.6	127.6	0.0	±1.0
SEL	0.25	1	99.0	98.9	-0.1	1.5 ; -5.0
	2	8	108.0	108.0	0.0	1.0 ; -2.5
	200	800	128.0	128.1	0.1	±1.0

10. Peak C sound level

Number of cycle in test signal	Anticipated Value (dB)	Measured Value, Lcpeak (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±3.0
One	136.4	136.1	-0.3	±3.0

Number of cycle in test signal	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.1	0.1	±2.0
Positive half cycle	135.4	135.3	-0.1	±2.0
Negative half cycle	135.4	135.3	-0.1	±2.0

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

11. Overload indication

Measured value (dB)		Deviated Value (dB)	Acceptance Limits (dB)
Positive one-half cycle	Negative one-half cycle		
89.5	89.7	0.2	±1.5

12. High level stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	137.0	137.0	0.0	±0.3

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

SOUND LEVEL METER

MODEL : NL-42A

SERIAL No. : 00322755

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 117/0266

CALIBRATION CERTIFICATE

Submitted by : Eastern Thai Consulting 1992 Co., Ltd.

Address : 683 Moo 11, Sukhapibarn 8 Rd., Nongkham, Sriracha, Chonburi, 20230

Calibrated at : Electrical and Electronic Standards Laboratory, Industrial Metrology and Testing Service Centre.
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Rd., A.Muang, Samutprakan 10280.

Instrument Calibrated :

Description	: Sound Level Meter
Manufacturer	: Rion
Model	: NL-42A
Serial No.	: 00322755 (No.50)
Microphone	: UC-52 No.196478
Preamplifier	: NH-24 No.15487

Ambient Environment

Temperature	: (23 ± 3) °C
Relative Humidity	: (50 ± 15) %
Ambient Pressure	: (101.325±1.5) kPa

Standards used :

1. Band Pass Filter Stanford Research Systems SR 650 S/N 28712.
2. Condenser Microphone Brüel&Kjær 4180 S/N 2889871.
3. Decade Attenuator Ando AL-205 S/N 00464602.
4. Function/Arbitrary Waveform Generator Agilent 33220A S/N MY44042668.
5. Digital Function Synthesizer NF Electronic Instruments DF-193A S/N 122037.
6. Digital Multimeter Fluke 8520A S/N 4985007.
7. Pistonphone Rion NC-72 S/N 00402446.
8. Measuring Amplifier Brüel&Kjær 2636 S/N 1537484.

Date of Receipt : 20 Feb. 2023

Date of Calibration : 17 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
65 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

ว.ว.TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 117/0266

9. Power Amplifier Brüel&Kjær 2706 S/N 1517650.
10. Speaker Tannoy Limited, Great Britain British Patent No. 215300.
11. Digital Multimeter Agilent 34401A S/N MY44005560.
12. Programmable Attenuator Tamagawa TPA-303A S/N 2212.

Calibration Procedure :

This instrument was calibrated by using calibration procedures no CP-102-02 and CP-102-03, which were based on IEC 61672-3 Electroacoustics - Sound Level Meters - Part 3 : Periodic tests (2013). These calibration procedures were related to the electrical and acoustic signal tests. The electrical signal test was carried out with the direct measurement method. The acoustic signal test was performed in an anechoic room with the comparison measurement method.

This instrument has been calibrated against standards maintained at the Electrical and Electronic Standards Laboratory (EEL), which are traceable to the International System of Units through the National Institute of Metrology (Thailand).

The information on actual reading is attached herewith and the uncertainty limits quoted refer to the measured values only.

The reported expanded uncertainty is based upon a standard uncertainty multiplied by a coverage factor k=2, providing a level of confidence of approximately 95%.

Date of Calibration : 17 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

FM.BL.MTC.002 Rev.

Head Office
65 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 117/0266

1. Absolute Sensitivity

Reference Acoustic Signal (dB)	Measured value (dB)		Deviation value(dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	Before adjust	After adjust				
113.99	114.1	114.0	0.0	1.0	0.30	N/A

Note: The external calibration adjustment was firstly performed. The internal calibration adjustment was then completed at the display of 114.0 dB.

2. Self-generated noise

2.1 Normal test

Measured value (dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
14.5	0.10	N/A

2.2 The microphone of the sound level meter was replaced by electrical signal input device

Frequency Weighting	Measured value (dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
A-Weight	12.1	0.10	N/A
C-Weight	20.7	0.10	N/A
Flat	23.8	0.10	N/A

Date of Calibration : 17 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 1090
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

วว.TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 117/0266

3. Acoustical signal test of frequency weightings

Frequency (Hz)	Deviation from frequency response curve(dB)			Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	A-weight	C-weight	Flat			
125	0.3	0.5	0.5	1.5	0.45	0.6
1 000	0.0	0.0	0.0	1.0	0.45	0.6
8 000	0.9	0.9	0.9	5.0	0.45	0.7

4. Electrical signal test of frequency weightings

Frequency (Hz)	Deviation from frequency response curve(dB)			Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	A-weight	C-weight	Flat			
63	0.0	0.0	-0.1	2.0	0.20	0.6
125	-0.1	0.0	0.0	1.5	0.20	0.6
250	-0.1	0.0	0.0	1.5	0.20	0.6
500	0.0	0.0	0.0	1.5	0.20	0.6
1 000	0.0	0.0	0.0	1.0	0.20	0.6
2 000	0.0	0.0	0.0	2.0	0.20	0.6
4 000	-0.1	0.0	0.0	3.0	0.20	0.6
8 000	0.0	0.0	0.0	5.0	0.20	0.7

Date of Calibration : 17 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592

5. Long-term stability

Time	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Begin	94.0	0.0	0.3	0.10	0.1
End	94.0				

6. Frequency and time weightings at 1 kHz

6.1 Frequency weightings at 1 kHz

Frequency Weighting	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
A-weight	94.0	0.0	0.2	0.20	0.2
C-weight	94.0	0.0	0.2	0.20	0.2
Flat	94.0	0.0	0.2	0.20	0.2

6.2 Time weightings at 1 kHz

Frequency Weighting	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Fast	94.0	0.0	0.1	0.20	0.2
Slow	94.0	0.0	0.1	0.20	0.2
Leq	94.0	0.0	0.1	0.20	0.2

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

ว๊ว๐TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 117/0266

7. Level linearity on the reference level range

Anticipated value (dB)	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
128	128.1	0.1	1.1	0.30	0.3
127	127.1	0.1	1.1	0.30	0.3
126	126.1	0.1	1.1	0.30	0.3
125	125.0	0.0	1.1	0.30	0.3
124	124.0	0.0	1.1	0.30	0.3
119	119.0	0.0	1.1	0.30	0.3
114	114.0	0.0	1.1	0.30	0.3
109	109.0	0.0	1.1	0.30	0.3
104	104.0	0.0	1.1	0.30	0.3
99	99.0	0.0	1.1	0.30	0.3
94	94.0	0.0	1.1	0.30	0.3
89	89.0	0.0	1.1	0.30	0.3
84	84.0	0.0	1.1	0.30	0.3
79	79.1	0.1	1.1	0.30	0.3
74	74.0	0.0	1.1	0.30	0.3
69	69.0	0.0	1.1	0.30	0.3
64	64.0	0.0	1.1	0.30	0.3
59	59.0	0.0	1.1	0.30	0.3
54	53.9	-0.1	1.1	0.30	0.3
49	49.0	0.0	1.1	0.30	0.3

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

FM.BL.MTC.002 Rev

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 117/0266

7. Level linearity on the reference level range (cont.)

Anticipated value (dB)	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
44	43.9	-0.1	1.1	0.30	0.3
39	39.0	0.0	1.1	0.30	0.3
34	34.0	0.0	1.1	0.30	0.3
29	29.0	0.0	1.1	0.30	0.3
28	28.0	0.0	1.1	0.30	0.3
27	27.0	0.0	1.1	0.30	0.3
26	26.0	0.0	1.1	0.30	0.3
25	24.9	-0.1	1.1	0.30	0.3

8. Level linearlity including the level range control

At reference sound level on the reference level range

Range	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
40-130	94.0	94.0	0.0	1.1	0.30	0.3
30-120	94.0	94.0	0.0	1.1	0.30	0.3
20-110	94.0	94.0	0.0	1.1	0.30	0.3
20-100	94.0	94.0	0.0	1.1	0.30	0.3

Date of Calibration : 17 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 1090
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

ว๊ว.TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 117/0266

8. Level linearlity including the level range control

At reference level at 5 dB greater than the under-range on a level range

Range	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
40-130	45	45.0	0.0	1.1	0.30	0.3
30-120	35	35.0	0.0	1.1	0.30	0.3
20-110	25	25.0	0.0	1.1	0.30	0.3
20-100	25	25.0	0.0	1.1	0.30	0.3
20-90	25	25.0	0.0	1.1	0.30	0.3
20-80	25	25.0	0.0	1.1	0.30	0.3

9. Tone burst response

Time Weighting	Toneburst Duration, Tb(ms)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Fast	200	116.0	0.0	±1.0	0.20	0.3
	2	99.0	0.0	+1.0; -2.5	0.20	0.3
	0.25	89.9	-0.1	+1.5; -5.0	0.20	0.3
Slow	200	109.6	0.0	±1.0	0.20	0.3
	2	90.0	0.0	+1.0; -5.0	0.20	0.3
SEL	200	110.1	0.1	±1.0	0.20	0.3
	2	90.0	0.0	+1.0; -2.5	0.20	0.3
	0.25	80.9	-0.1	+1.5; -5.0	0.20	0.3

Date of Calibration : 17 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

FM.BL.MTC.002 Rev

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592

SOUND LEVEL METER

MODEL : NL-42A

SERIAL No. : 00322755

Acoustic Laboratory (Thailand) Co., Ltd.
6/57 Soi Phoem Sin 42, Sai Mai, Sai Mai, Bangkok 10220
Tel: (+66) 02-1296780 Email: info@altbkk.com

Certificate of Calibration

Certificate No.: S2402-0651-01

Customer: Eastern Thai Consulting 1992 Co., Ltd.
683 Moo 11, Sukhapibarn 8 Rd,
Nongkham, Sriracha, Chonburi 20230

Date of calibration: 2024-03-04
2024-03-26
Date of issue: 2024-03-26
Instrument Calibrated: Sound Level Meter
Manufacturer: Rion
Model: NL-42A (Meter), UC-59 (Microphone), NH-25 (Preamplifier)
Serial no: 00322755 (Meter), 21960 (Microphone), 22336 (Preamplifier)

Calibration and verification performed:
Acoustical levels are stated relative to 20μPa. Other dB levels are relative values.
The reported expanded uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor k, which with the reported effective degree of freedom corresponds to coverage probability of approximately 95%.
The sound level meter instrument submitted for periodic testing following the periodic tests of IEC 61672-3 : 2013.

Preconditioning:
The equipment was preconditioned for more than 16 hours at the specified calibration temperature and humidity.

Instruments and Program:
A complete list of instruments, hardware, and software, that has been used for this calibration is separately available from the calibration laboratory.

Equipment standards used:
- Sound measuring equipment calibration unit 483B S/N31083
- Digital multimeter Keysight S/N HP34401A
- Ultra-low distortion function generator Stanford SRS DS360 S/N123625
- Acoustic sound calibrator class 1 Nor1256 S/N125626542
- Combined Pressure, Humidity and Temperature Transmitter PTU300 S/NM2520568

Traceability
The measured values are traceable to following the ISO/IEC 17025 laboratories:
Sound Pressure Level: EEI, Thailand
Reference Pressure, Humidity and Temperature: TPA, Thailand
Voltage: TPA, Thailand
Frequency: TPA, Thailand

COPY

This certificate of calibration is issued by Acoustic Laboratory Thailand (ALT) It also states that the laboratory has a satisfactory quality assurance system and traceability to accredited or national calibration laboratories This certificate may not be reproduced other than in full

	Pressure:	Temperature:	Relative humidity:
Environmental conditions:			
Reference conditions:	101.325 kPa	23.0 °C	50 %RH
Measurement conditions:	100.87 ± 0.10 kPa	23.5 ± 1.0 °C	57.0 ± 2.0 %RH

1. Indication at the calibration check frequency

Reference Acoustic Signal (dB)	Measured value (dB)		Deviated value (dB)	Acceptance limit (dB)
	Before adjust	After adjust		
93.9	93.9	93.9	0.0	±1.0

Note: Indication at the checked calibration frequency was adjusted to 93.9 dB by the sound calibrator Type NC-75 S/N: 34234715

2. Self-generated noise

Frequency weightings	Measured value (dB)
A-Weighting	10.8
C-Weighting	15.3
Z-Weighting	20.7

3. Electrical signal test of frequency weighting at 91 dB

Frequency (Hz)	Deviation from various frequency weighting response curve			
	A-Weighting (dB)	C-Weighting (dB)	Z-Weighting (dB)	Acceptance limit (dB)
63	0.0	0.0	0.0	±2.0
125	0.1	0.1	0.0	±1.5
250	0.0	0.0	0.0	±1.5
500	0.1	0.1	0.1	±1.5
1000	0.0	0.0	0.0	±1.0
2000	-0.1	-0.1	-0.2	±2.0
4000	-0.3	-0.3	-0.3	±3.0
8000	0.1	0.1	0.0	±5.0

Date of calibration : 2024-03-04
2024-03-26
Date of issue : 2024-03-26

COPY

4. Frequency and time weighting at 1 kHz

4.1 Frequency weighting at 1 kHz

Frequency weightings	Measured value (dB)	Deviated value (dB)	Acceptance limit (dB)
A	94.0	0.0	±0.3
C	94.0	0.0	±0.3
Z	94.0	0.0	±0.3

4.2 Time weighting at 1 kHz

Time weightings	Measured value (dB)	Deviated value (dB)	Acceptance limit (dB)
Fast	94.0	0.0	±0.3
Slow	94.0	0.0	±0.3
LAeq	94.0	0.0	±0.3

5. Long term stability

Time interval (mm:ss)	Start level (dB)	Stop level (dB)	Deviated value (dB)	Acceptance limit (dB)
28:58	94.0	94.0	0.0	±0.3

Date of calibration : 2024-03-04
2024-03-26
Date of issue : 2024-03-26

COPY

ALT
Certificate No.: S2402-0651-01

6. Level linearity on the reference level range

6.1 Measured at 31.5 Hz

Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit (dB)
84.0	84.0	0.0	±1.1
89.0	89.0	0.0	±1.1
92.6	92.6	0.0	±1.1
93.6	93.6	0.0	±1.1
94.6	94.6	0.0	±1.1
95.6	95.6	0.0	±1.1
96.6	96.6	0.0	±1.1
84.0	84.0	0.0	±1.1
79.0	79.0	0.0	±1.1
74.0	74.0	0.0	±1.1
69.0	69.0	0.0	±1.1
64.0	64.0	0.0	±1.1
59.0	59.0	0.0	±1.1
54.0	54.0	0.0	±1.1
49.0	49.0	0.0	±1.1
44.0	44.1	0.1	±1.1
40.0	39.9	-0.1	±1.1
39.0	38.9	-0.1	±1.1
38.0	38.0	0.0	±1.1
37.0	37.0	0.0	±1.1
36.0	36.0	0.0	±1.1

Date of calibration : 2024-03-04
2024-03-26
Date of issue : 2024-03-26

COPY

Registration number 0105564086235
6/57 Poemsin Soi 42, Sai Mai, 10220 Bangkok Thailand
Tel (+66) 02-1296780 Email info@altbkk.com
www.altbkk.com

6.2 Measured at 1 kHz

Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit (dB)
94.0	94.0	0.0	±1.1
99.0	99.0	0.0	±1.1
104.0	104.0	0.0	±1.1
109.0	109.0	0.0	±1.1
114.0	114.0	0.0	±1.1
119.0	119.0	0.0	±1.1
124.0	124.0	0.0	±1.1
129.0	129.0	0.0	±1.1
132.0	132.0	0.0	±1.1
133.0	133.0	0.0	±1.1
134.0	134.0	0.0	±1.1
135.0	135.0	0.0	±1.1
136.0	136.0	0.0	±1.1
94.0	94.0	0.0	±1.1
89.0	89.0	0.0	±1.1
84.0	84.0	0.0	±1.1
79.0	79.0	0.0	±1.1
74.0	74.0	0.0	±1.1
69.0	69.0	0.0	±1.1
64.0	64.0	0.0	±1.1
59.0	59.0	0.0	±1.1
54.0	54.0	0.0	±1.1
49.0	49.0	0.0	±1.1
44.0	44.0	0.0	±1.1
40.0	40.0	0.0	±1.1
39.0	38.9	-0.1	±1.1
38.0	38.0	0.0	±1.1
37.0	36.9	-0.1	±1.1
36.0	35.9	-0.1	±1.1

Date of calibration : 2024-03-04
2024-03-26
Date of issue : 2024-03-26

COPY

ALT
Acoustic Laboratory Thailand
Certificate No.: S2402-0651-01

6.3 Measured at 8 kHz

Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit (dB)
94.0	94.0	0.0	±1.1
99.0	99.0	0.0	±1.1
104.0	104.0	0.0	±1.1
109.0	109.0	0.0	±1.1
114.0	114.0	0.0	±1.1
119.0	119.0	0.0	±1.1
124.0	124.0	0.0	±1.1
129.0	129.0	0.0	±1.1
130.9	130.9	0.0	±1.1
131.9	131.9	0.0	±1.1
132.9	132.8	-0.1	±1.1
133.9	133.9	0.0	±1.1
94.0	94.0	0.0	±1.1
89.0	89.0	0.0	±1.1
84.0	84.0	0.0	±1.1
79.0	78.9	-0.1	±1.1
74.0	74.0	0.0	±1.1
69.0	69.0	0.0	±1.1
64.0	63.9	-0.1	±1.1
59.0	59.0	0.0	±1.1
54.0	53.9	-0.1	±1.1
49.0	48.9	-0.1	±1.1
44.0	43.9	-0.1	±1.1
40.0	39.9	-0.1	±1.1
39.0	38.9	-0.1	±1.1
38.0	37.9	-0.1	±1.1
37.0	36.9	-0.1	±1.1
36.0	35.9	-0.1	±1.1

Date of calibration : 2024-03-04
2024-03-26
Date of issue : 2024-03-26

COPY

Registration number 0105564086235
6/57 Poemsin Soi 42, Sai Mai, 10220 Bangkok Thailand
Tel (+66) 02-1296780 Email info@altbkk.com
www.altbkk.com

7. Tone burst response

Time weightings	Tone burst duration, Tb duration, Tb (ms)	Measured value (dB)	Deviated value (dB)	Acceptance limit (dB)
Fast	200	133.0	0.0	±1.0
	2	116.0	0.0	+1.0,-2.5
	0.25	107.0	0.0	+1.5,-5.0
Slow	200	126.6	0.0	±1.0
	2	107.0	0.0	+1.0,-5.0
SEL	200	127.0	0.0	±1.0
	2	107.0	0.0	+1.0,-2.5
	0.25	97.9	-0.1	+1.5,-5.0

8. Peak C sound level

Number of cycles in test signal	Anticipated Value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit (dB)
Complete cycle	128.4	127.4	-1.0	±3.0
Positive half cycle	130.4	130.1	-0.3	±2.0
Negative half cycle	130.4	130.1	-0.3	±2.0

9. Overload indication

Measured value (dB)		Deviated value (dB)	Acceptance limit (dB)
Positive one half cycle	Negative one half cycle		
139.1	138.9	0.2	±1.5

10. High level stability

Initial level (dB)	Final level (dB)	Deviated value (dB)	Acceptance limit (dB)
135.0	135.0	0.0	±0.3

Date of calibration : 2024-03-04
2024-03-26
Date of issue : 2024-03-26

COPY

ALT
Acoustic Laboratory Thailand
Certificate No.: S2402-0651-01

Uncertainty of measurement

Parameters	Uncertainty
1. Indication at the calibration check frequency	0.12 dB
2. Self-generated noise	
- Frequency Weighting A	0.090 dB
- Frequency Weighting C	0.13 dB
- Frequency Weighting Z	0.090 dB
3. Electrical signal test of frequency weighting	0.13 dB
4. Frequency and time weightings at 1 kHz	0.13 dB
5. Long term stability test	0.10 dB
6. Level linearity on the reference level range	0.14 dB
7. Tone burst response	0.14 dB
8. Peak C sound level	0.13 dB
9. Overload indication	0.13 dB
10. High level stability test	0.10 dB

The reported expanded uncertainty is based upon a standard uncertainty multiplied by a coverage factor k = 2, providing a level of confidence of approximately 95%

Remark : The acoustical signal test of frequency weighting at 125Hz, 1kHz, and 8kHz is not included, along with correction values for environmental conditions in a free-field or diffuse field, and the effect of reflection and diffraction on the measurement microphone and the sound level meter.

Replacement Calibration Certificate for calibration certificate number S2402-0651

Calibrated By: ..... (Mr.Athakom Sumphan)

Approved By: ..... (Mr.Pitupong Sarapho)

Date of calibration : 2024-03-04
2024-03-26
Date of issue : 2024-03-26

------- End of Certificate of Calibration -------

COPY

SOUND LEVEL METER

MODEL : NL-42

SERIAL No. : 01147298

Request No. 21-66/0321 **MTC No.** EEL. BP. 113/0266

CALIBRATION CERTIFICATE

Submitted by : Eastern Thai Consulting 1992 Co., Ltd.

Address : 683 Moo 11, Sukhapibarn 8 Rd., Nongkham, Sriracha, Chonburi, 20230

Calibrated at : Electrical and Electronic Standards Laboratory, Industrial Metrology and Testing Service Centre.
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Rd., A.Muang, Samutprakan 10280.

Instrument Calibrated :

Description : Sound Level Meter
Manufacturer : Rion
Model : NL-42
Serial No. : 01147298 (No.25)
Microphone : UC-52 No.191028
Preamplifier : NH-24 No.47531

Ambient Environment

Temperature : (23 ± 3) °C
Relative Humidity : (50 ± 15) %
Ambient Pressure : (101.325±1.5) kPa

Standards used :

1. Band Pass Filter Stanford Research Systems SR 650 S/N 28712.
2. Condenser Microphone Brüel&Kjær 4180 S/N 2889871.
3. Decade Attenuator Ando AL-205 S/N 00464602.
4. Function/Arbitrary Waveform Generator Agilent 33220A S/N MY44042668.
5. Digital Function Synthesizer NF Electronic Instruments DF-193A S/N 122037.
6. Digital Multimeter Fluke 8520A S/N 4985007.
7. Pistonphone Rion NC-72 S/N 00402446.
8. Measuring Amplifier Brüel&Kjær 2636 S/N 1537484.

Date of Receipt : 20 Feb. 2023

Date of Calibration : 15 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

ว.ว.-TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 113/0266

9. Power Amplifier Brüel&Kjær 2706 S/N 1517650.
10. Speaker Tannoy Limited, Great Britain British Patent No. 215300.
11. Digital Multimeter Agilent 34401A S/N MY44005560.
12. Programmable Attenuator Tamagawa TPA-303A S/N 2212.

Calibration Procedure :

This instrument was calibrated by using calibration procedures no CP-102-02 and CP-102-03, which were based on IEC 61672-3 Electroacoustics - Sound Level Meters - Part 3 : Periodic tests (2013). These calibration procedures were related to the electrical and acoustic signal tests. The electrical signal test was carried out with the direct measurement method. The acoustic signal test was performed in an anechoic room with the comparison measurement method.

This instrument has been calibrated against standards maintained at the Electrical and Electronic Standards Laboratory (EEL), which are traceable to the International System of Units through the National Institute of Metrology (Thailand).

The information on actual reading is attached herewith and the uncertainty limits quoted refer to the measured values only.

The reported expanded uncertainty is based upon a standard uncertainty multiplied by a coverage factor k=2, providing a level of confidence of approximately 95%.

Date of Calibration : 15 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 113/0266

1. Absolute Sensitivity

Reference Acoustic Signal (dB)	Measured value (dB)		Deviation value(dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	Before adjust	After adjust				
113.97	114.1	114.0	0.0	1.0	0.30	N/A

Note: The external calibration adjustment was firstly performed. The internal calibration adjustment was then completed at the display of 113.9 dB.

2. Self-generated noise

2.1 Normal test

Measured value (dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
15.7	0.10	N/A

2.2 The microphone of the sound level meter was replaced by electrical signal input device

Frequency Weighting	Measured value (dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
A-Weight	11.8	0.10	N/A
C-Weight	17.5	0.10	N/A
Flat	22.9	0.10	N/A

Date of Calibration : 15 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 1090(
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

สวทช.TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 113/0266

3. Acoustical signal test of frequency weightings

Frequency (Hz)	Deviation from frequency response curve(dB)			Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	A-weight	C-weight	Flat			
125	0.2	0.3	0.3	1.5	0.45	0.6
1 000	-0.2	-0.2	-0.1	1.0	0.45	0.6
8 000	1.4	1.4	1.3	5.0	0.45	0.7

4. Electrical signal test of frequency weightings

Frequency (Hz)	Deviation from frequency response curve(dB)			Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	A-weight	C-weight	Flat			
63	0.0	0.1	0.1	2.0	0.20	0.6
125	0.0	0.1	0.1	1.5	0.20	0.6
250	0.0	0.1	0.1	1.5	0.20	0.6
500	0.0	0.1	0.1	1.5	0.20	0.6
1 000	0.0	0.0	0.0	1.0	0.20	0.6
2 000	-0.2	-0.1	-0.2	2.0	0.20	0.6
4 000	-0.3	-0.3	-0.3	3.0	0.20	0.6
8 000	0.0	0.0	0.0	5.0	0.20	0.7

Date of Calibration : 15 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 113/0266

5. Long-term stability

Time	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Begin	94.0	0.0	0.3	0.10	0.1
End	94.0				

6. Frequency and time weightings at 1 kHz

6.1 Frequency weightings at 1 kHz

Frequency Weighting	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
A-weight	94.0	0.0	0.2	0.20	0.2
C-weight	94.0	0.0	0.2	0.20	0.2
Flat	94.0	0.0	0.2	0.20	0.2

6.2 Time weightings at 1 kHz

Frequency Weighting	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Fast	94.0	0.0	0.1	0.20	0.2
Slow	94.0	0.0	0.1	0.20	0.2
Leq	94.0	0.0	0.1	0.20	0.2

COPY

Date of Calibration : 15 Mar. 2023

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

ว.ว.TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 113/0266

7. Level linearity on the reference level range

Anticipated value (dB)	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
128	128.1	0.1	1.1	0.30	0.3
127	127.1	0.1	1.1	0.30	0.3
126	126.1	0.1	1.1	0.30	0.3
125	125.1	0.1	1.1	0.30	0.3
124	124.0	0.0	1.1	0.30	0.3
119	119.1	0.1	1.1	0.30	0.3
114	114.0	0.0	1.1	0.30	0.3
109	109.1	0.1	1.1	0.30	0.3
104	104.1	0.1	1.1	0.30	0.3
99	99.0	0.0	1.1	0.30	0.3
94	94.0	0.0	1.1	0.30	0.3
89	89.0	0.0	1.1	0.30	0.3
84	84.0	0.0	1.1	0.30	0.3
79	79.1	0.1	1.1	0.30	0.3
74	74.1	0.1	1.1	0.30	0.3
69	69.0	0.0	1.1	0.30	0.3
64	64.0	0.0	1.1	0.30	0.3
59	59.0	0.0	1.1	0.30	0.3
54	53.9	-0.1	1.1	0.30	0.3
49	49.0	0.0	1.1	0.30	0.3

COPY

Date of Calibration : 15 Mar. 2023

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

7. Level linearity on the reference level range (cont.)

Anticipated value (dB)	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
44	44.0	0.0	1.1	0.30	0.3
39	39.0	0.0	1.1	0.30	0.3
34	34.0	0.0	1.1	0.30	0.3
29	29.0	0.0	1.1	0.30	0.3
28	28.0	0.0	1.1	0.30	0.3
27	27.0	0.0	1.1	0.30	0.3
26	26.0	0.0	1.1	0.30	0.3
25	24.9	-0.1	1.1	0.30	0.3

8. Level linearlity including the level range control

At reference sound level on the reference level range

Range	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
40-130	94.0	94.0	0.0	1.1	0.30	0.3
30-120	94.0	94.0	0.0	1.1	0.30	0.3
20-110	94.0	94.0	0.0	1.1	0.30	0.3
20-100	94.0	94.0	0.0	1.1	0.30	0.3

Date of Calibration : 15 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : pumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 109(
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321 **MTC No.** EEL. BP. 113/0266

8. Level linearlity including the level range control

At reference level at 5 dB greater than the under-range on a level range

Range	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
40-130	45	45.0	0.0	1.1	0.30	0.3
30-120	35	35.0	0.0	1.1	0.30	0.3
20-110	25	25.0	0.0	1.1	0.30	0.3
20-100	25	25.0	0.0	1.1	0.30	0.3
20-90	25	25.0	0.0	1.1	0.30	0.3
20-80	25	25.0	0.0	1.1	0.30	0.3

9. Tone burst response

Time Weighting	Toneburst Duration, Tb(ms)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Fast	200	116.0	0.0	±1.0	0.20	0.3
	2	98.9	-0.1	+1.0; -2.5	0.20	0.3
	0.25	89.9	-0.1	+1.5; -5.0	0.20	0.3
Slow	200	109.5	-0.1	+1.0	0.20	0.3
	2	90.0	0.0	+1.0; -5.0	0.20	0.3
SEL	200	110.0	0.0	±1.0	0.20	0.3
	2	90.0	0.0	+1.0; -2.5	0.20	0.3
	0.25	80.9	-0.1	+1.5; -5.0	0.20	0.3

Date of Calibration : 15 Mar. 2023

COPY

The results relate only to the items tested/calibrated or value assigned
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

FM.BL.MTC.002 Rev.4

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : pumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-66/0321

MTC No. EEL. BP. 113/0266

10. Peak C sound level

Number of cycles in test signal	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Complete cycle	125.4	125.3	-0.1	3.0	0.20	0.35
Positive half cycle	124.4	124.1	-0.3	2.0	0.20	0.35
Negative half cycle	124.4	124.1	-0.3	2.0	0.20	0.35

11. Overload indication

Measured value (dB)		Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Positive one-half cycle	Negative one-half cycle				
136.5	136.5	0.0	1.5	0.20	0.25

12. High-level stability

Time	Measured value (dB)	Deviated (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Begin	129.0	0.0	0.3	0.10	0.1
End	129.0				

Calibrated by : Wittawat Supanich

(Mr. Wittawat Supanich)

Approved by : Prawate Kluaypa

(Mr. Prawate Kluaypa)

Director

Electrical and Electronic Standards Laboratory

Industrial Metrology and Testing Service Centre

Date of Calibration : 15 Mar. 2023

Date of Issue : 16 Mar. 2023

Ref : 2011266022000725001

End of Certificate

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

SOUND LEVEL METER

MODEL : NL-42

SERIAL No. : 01147298

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

CALIBRATION CERTIFICATE

Submitted by : Eastern Thai Consulting 1992 Co., Ltd.

Address : 683 Moo 11, Sukhapibarn 8 Rd., Nongkham, Sriracha, Chonburi, 20230

Calibrated at : Electrical and Electronic Standards Laboratory, Industrial Metrology and Testing Service Centre.
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Rd., A.Muang, Samutprakan 10280.

Instrument Calibrated :

Description	: Sound Level Meter
Manufacturer	: Rion
Model	: NL-42
Serial No.	: 01147298
Microphone	: UC-52 No.179113
Preamplifier	: NH-24 No.87521

Ambient Environment

Temperature	: (23 ± 3) °C
Relative Humidity	: (50 ± 15) %
Ambient Pressure	: (101.325±1.5) kPa

Standards used :

1. Band Pass Filter Wavetek 752A S/N 90010494.
2. Condenser Microphone Brüel&Kjær 4180 S/N 2889871
3. Decade Attenuator Ando AL-205 S/N 00464602.
4. Function/Arbitrary Waveform Generator Agilent 33220A S/N MY44042668.
5. Digital Function Synthesizer NF Electronic Instruments DF-193A S/N 122037.
6. Digital Multimeter Fluke 8520A S/N 4985007.
7. Pistonphone Rion NC-72 S/N 00402446.
8. Measuring Amplifier Brüel&Kjær 2636 S/N 1537484.

Date of Receipt : 5 Feb. 2024

Date of Calibration : 1 Mar. 2024

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

9. Power Amplifier Brüel&Kjær 2706 S/N 1517650.
10. Speaker Tannoy Limited, Great Britain British Patent No. 215300.
11. Digital Multimeter Agilent 34401A S/N MY44005560.
12. Programmable Attenuator Tamagawa TPA-303A S/N 2212.

Calibration Procedure :

This instrument was calibrated by using calibration procedures no CP-102-02 and CP-102-03, which were based on IEC 61672-3 Electroacoustics - Sound Level Meters - Part 3 : Periodic tests (2013). These calibration procedures were related to the electrical and acoustic signal tests. The electrical signal test was carried out with the direct measurement method. The acoustic signal test was performed in an anechoic room with the comparison measurement method.

This instrument has been calibrated against standards maintained at the Electrical and Electronic Standards Laboratory (EEL), which are traceable to the International System of Units through the National Institute of Metrology (Thailand).

The information on actual reading is attached herewith and the uncertainty limits quoted refer to the measured values only.

The reported expanded uncertainty is based upon a standard uncertainty multiplied by a coverage factor k=2, providing a level of confidence of approximately 95%.

Date of Calibration : 1 Mar. 2024

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

FM.BL.MTC.002 Rev.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

1. Absolute Sensitivity

Reference Acoustic Signal (dB)	Measured value (dB)		Deviation value(dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	Before adjust	After adjust				
113.92	114.2	113.9	0.0	1.0	0.30	N/A

Note: The external calibration adjustment was firstly performed. The internal calibration adjustment was then completed at the display of 113.9 dB.

2. Self-generated noise

2.1 Normal test

Measured value (dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
25.8	0.10	N/A

2.2 The microphone of the sound level meter was replaced by electrical signal input device

Frequency Weighting	Measured value (dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
A-Weight	20.1	0.10	N/A
C-Weight	40.2	0.10	N/A
Flat	41.3	0.10	N/A

Date of Calibration : 1 Mar. 2024

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang, Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road, Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900, Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592

NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

3. Acoustical signal test of frequency weightings

Frequency (Hz)	Deviation from frequency response curve(dB)			Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	A-weight	C-weight	Flat			
125	0.0	0.2	0.2	1.5	0.45	0.6
1 000	0.0	0.0	0.0	1.0	0.45	0.6
8 000	1.8	1.8	1.7	5.0	0.45	0.7

4. Electrical signal test of frequency weightings

Frequency (Hz)	Deviation from frequency response curve(dB)			Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
	A-weight	C-weight	Flat			
63	0.0	0.1	0.0	2.0	0.20	0.6
125	0.0	0.1	0.0	1.5	0.20	0.6
250	0.0	0.0	0.0	1.5	0.20	0.6
500	0.0	0.0	0.0	1.5	0.20	0.6
1 000	0.0	0.0	0.0	1.0	0.20	0.6
2 000	-0.2	-0.1	-0.2	2.0	0.20	0.6
4 000	-0.3	-0.3	-0.3	3.0	0.20	0.6
8 000	0.0	0.0	-0.1	5.0	0.20	0.7

Date of Calibration : 1 Mar. 2024

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

FM.BL.MTC.002 Rev.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang, Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road, Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900, Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592

5. Long-term stability

Time	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Begin	94.0	0.0	0.3	0.10	0.1
End	94.0				

6. Frequency and time weightings at 1 kHz

6.1 Frequency weightings at 1 kHz

Frequency Weighting	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
A-weight	94.0	0.0	0.2	0.20	0.2
C-weight	94.0	0.0	0.2	0.20	0.2
Flat	94.0	0.0	0.2	0.20	0.2

6.2 Time weightings at 1 kHz

Frequency Weighting	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Fast	94.0	0.0	0.1	0.20	0.2
Slow	94.0	0.0	0.1	0.20	0.2
Leq	94.0	0.0	0.1	0.20	0.2

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : sumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

7. Level linearity on the reference level range

Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
137	137.1	0.1	1.1	0.30	0.3
136	136.1	0.1	1.1	0.30	0.3
135	135.1	0.1	1.1	0.30	0.3
134	134.1	0.1	1.1	0.30	0.3
129	129.1	0.1	1.1	0.30	0.3
124	124.0	0.0	1.1	0.30	0.3
119	119.0	0.0	1.1	0.30	0.3
114	114.0	0.0	1.1	0.30	0.3
109	109.0	0.0	1.1	0.30	0.3
104	104.0	0.0	1.1	0.30	0.3
99	99.0	0.0	1.1	0.30	0.3
94	94.0	0.0	1.1	0.30	0.3
89	89.0	0.0	1.1	0.30	0.3
84	84.0	0.0	1.1	0.30	0.3
79	79.0	0.0	1.1	0.30	0.3
74	74.0	0.0	1.1	0.30	0.3
69	69.0	0.0	1.1	0.30	0.3
64	63.9	-0.1	1.1	0.30	0.3

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

FM.BL.MTC.002 Rev.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : sumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

7. Level linearity on the reference level range (cont.)

Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
59	58.9	-0.1	1.1	0.30	0.3
54	53.9	-0.1	1.1	0.30	0.3
49	48.9	-0.1	1.1	0.30	0.3
44	43.9	-0.1	1.1	0.30	0.3
39	38.9	-0.1	1.1	0.30	0.3
34	33.9	-0.1	1.1	0.30	0.3
29	28.9	-0.1	1.1	0.30	0.3
28	27.9	-0.1	1.1	0.30	0.3
27	26.9	-0.1	1.1	0.30	0.3
26	25.9	-0.1	1.1	0.30	0.3
25	24.9	-0.1	1.1	0.30	0.3

8. Level linearlity including the level range control

At reference sound level on the reference level range

Range	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
30-130	94.0	94.0	0.0	1.1	0.30	0.3

Date of Calibration : 1 Mar. 2024

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009
E-mail : rumpai@tistr.or.th Website:www.tistr.or.th

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165
E-mail : mtc@tistr.or.th

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

สวทช TISTR
NSC-TISI-TIS 17025
CALIBRATION 0037

THAILAND INSTITUTE OF SCIENTIFIC AND TECHNOLOGICAL RESEARCH (TISTR)

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

8. Level linearlity including the level range control

At reference level at 5 dB greater than the under-range on a level range

Range	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
30-130	35	35.0	0.0	1.1	0.30	0.3

9. Tone burst response

Time Weighting	Toneburst Duration, Tb(ms)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Fast	200	126.0	0.0	±1.0	0.20	0.3
	2	108.9	-0.1	+1.0; -2.5	0.20	0.3
	0.25	99.9	-0.1	+1.5; -5.0	0.20	0.3
Slow	200	119.5	-0.1	±1.0	0.20	0.3
	2	99.9	-0.1	+1.0; -5.0	0.20	0.3
SEL	200	120.0	0.0	±1.0	0.20	0.3
	2	100.0	0.0	+1.0; -2.5	0.20	0.3
	0.25	90.9	-0.1	+1.5; -5.0	0.20	0.3

Date of Calibration : 1 Mar. 2024

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592

Request No. 21-67/0252 **MTC No.** EEL. BP. 9/0267

10. Peak C sound level

Number of cycles in test signal	Anticipated value (dB)	Measured value (dB)	Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Complete cycle	125.4	125.3	-0.1	3.0	0.20	0.35
Positive half cycle	124.4	124.1	-0.3	2.0	0.20	0.35
Negative half cycle	124.4	124.1	-0.3	2.0	0.20	0.35

11. Overload indication

Measured value (dB)		Deviated value (dB)	Acceptance limit class 2(±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Positive one-half cycle	Negative one-half cycle				
136.5	136.5	0.0	1.5	0.20	0.25

12. High-level stability

Time	Measured valuc (dB)	Deviated value (dB)	Acceptance limit class 2 (±dB)	Uncertainty (±dB)	Maximum-permitted uncertainty of measurement (±dB)
Begin	129.0	0.0	0.3	0.10	0.1
End	129.0				

Calibrated by : Wittawat Supanich

(Mr. Wittawat Supanich)

Approved by : Prawate Kluaypa

(Mr. Prawate Kluaypa)

Director

Electrical and Electronic Standards Laboratory

Industrial Metrology and Testing Service Centre

Date of Calibration : 1 Mar. 2024

Date of Issue : 4 Mar. 2024

Ref : 20112670205005030O1

End of Certificate

COPY

The results relate only to the items tested/calibrated or value assigned.
Advertising the Report/Certificate and publicity of the results except in full are prohibited unless written permission is obtained from the governor of TISTR.

Head Office
35 Mu 3 Tambon Khlong Ha, Amphoe Khlong Luang,
Changwat Pathumthani 12120, Thailand
Tel. (66) 0 2577 9000
Fax. (66) 0 2577 9009

Office/Laboratory
Soi 1C, Bangpoo Industrial Estate, Sukhumvit Road,
Amphoe Muang, Changwat Samutprakan 10280, Thailand
Tel. (66) 0 2323 1672-80 ext. 115, 116
Fax. (66) 0 2323 9165

Office
196 Phahonyothin Road, Chatuchak, Bangkok 10900,
Thailand
Tel. (66) 0 2579 1121-30 ext. 5219, 5225, 5217
Fax. (66) 0 2579 8592
E-mail : sumalee@tistr.or.th

SOUND LEVEL METER

MODEL : NL-42A

SERIAL No. : 00322748

SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Rd.,Bangbumru, Bangplud Bangkok 10700 THAILAND.
Tel.0-2435-8800 Fax.0-2433-1679 e-mail:cal-center@sithiphorn.com http://www.sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL23139
Pages : 1 of 8

Calibration Certificate

Equipment :	SOUND LEVEL METER
Manufacturer :	RION
Model :	NL-42A/ Microphone UC-52 / Preamplifier NH-24
Serial No.:	00322748 / 196471 / 15480
ID No.:	-
Condition As Found :	GOOD
Customer :	EASTERN THAI CONSULTING 1992 CO., LTD. SAHA GROUP INDUSTRIAL PARK, 683 MOO 11, NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.
Location :	-
Ambient Temperature :	(23.0 ± 3) °C
Pressure :	(101.3 ± 3) kPa
Relative Humidity :	(50.0 ± 20) %
Received Date :	02 MAY 2023
Calibration Date :	02 -04 MAY 2023
Date of Issue :	05 MAY 2023

Calibrated by : Nathakorn Pisutpaisan

Approved by :

(Thanakul Petchurai)

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

COPY

Calibration Procedure : CP-AC-01

Calibration Method :

This equipment was calibrated by based on IEC-61672-3 (2013) Standard for sound level meter (SLM).
The SLM had tests to Acoustical and Electrical signal tests of frequency weighting with Anechoic chamber and Reference Standard Instruments.
For tests results of each items were made by observation of each Instruments display and also with SLM's display.

Condition of this result of calibration :

1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33210A	MY48017076	EF-0009-23	07-FEB-24
Waveform Generator	33511B	MY52302742	EF-0010-23	07-FEB-24
Digital Multimeter	33461A	MY53220104	EEL.BP 30/0266	13-FEB-24
Digital Multimeter	33461A	MY53220076	EEL.BP 29/0266	13-FEB-24
Digital Multimeter	34461A	MY60024273	EEL.BP 31/0266	14-FEB-24
Programmable Attenuator	MAT-1070	62100114	EF-0011-23	08-FEB-24
Condenser Microphone	4180	2977900	AA-1001-23	14-FEB-24
Measuring Amplifier	NA-42KAI	34560495	AA-3002-23	14-FEB-24

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   - 3.1 National Institute of Metrology (Thailand).
   - 3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

Summary of Measurement Result :

Parameter	Pass	Fail	Uncertainty (dB)	Maximum-permitted uncertainty of measurement (dB)
1. Absolute sensitivity	✓	-	0.2	N/A
2. Self-generated noise	✓	-	0.2	N/A
3. Acoustical signal tests of frequency weightings				
125 Hz	✓	-	0.3	0.6
1000 Hz	✓	-	0.3	0.6
8000 Hz	✓	-	0.3	0.7
4. Electrical signal tests of frequency weightings				
For 10 Hz to 4 kHz	✓	-	0.3	0.6
For > 4 kHz to 10 kHz	✓	-	0.3	0.7
For > 10 kHz to 20 kHz	-	-	-	1.0
5. Frequency and time weightings at 1 kHz	✓	-	0.2	0.2
6. Long - term stability	✓	-	0.1	0.1
7. Level linearity on the reference level range	✓	-	0.2	0.3
8. Level linearity including the level range control	✓	-	0.2	0.3
9. Tone burst response	✓	-	0.2	0.3
10. Peak C sound level	✓	-	0.2	0.35
11. Overload indication	✓	-	0.2	0.25
12. High level stability	✓	-	0.1	0.1

Note : Pass/Fail evaluation for each parameter,
will be considered together from the acceptance limit and the Maximum-permitted uncertainty of measurement.

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

Result of calibration :

1. Absolute sensitivity

Reference Acoustic Signal (dB)	Measured Value (dB)	Deviation (dB)	Acceptance Limit (dB)
93.9 (93.98)	93.9	0.0	±0.3

2. Self-generated noise

2.1 Normal test

Measured Value (dB)
14.8

2.2 The microphone of the sound level meter was replaced by electrical signal input device.

Frequency Weighting	Measured value (dB)
A - weight	11.2
C - weight	17.2
Flat	23.0

3. Acoustical signal tests of frequency weightings

Meter free-field acoustic response at a level of 84 dB

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
125	0.2	0.2	0.2	± 1.5
1000	0.0	0.0	0.0	± 1.0
8000	0.1	0.2	0.2	±5.0

COPY

4. Electrical signal tests of frequency weightings

Weighting network response with relative to 1 kHz.

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
63	0.0	-0.1	0.0	±2.0
125	0.0	0.0	0.0	±1.5
250	0.0	0.0	0.0	±1.5
500	0.0	0.0	0.0	±1.5
1000	0.0	0.0	0.0	±1.0
2000	0.0	0.1	0.0	±2.0
4000	0.0	0.0	0.0	±3.0
8000	0.0	0.1	0.1	±5.0

5. Frequency and time weightings at 1 kHz

5.1 Frequency weightings at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.2
C - weight	94.0	94.0	0.0	± 0.2
Flat	94.0	94.0	0.0	± 0.2

5.2 Time weighting at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	94.0	94.0	0.0	± 0.1
Slow	94.0	94.0	0.0	± 0.1
Leq	94.0	94.0	0.0	± 0.1

6. Long - term stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.3

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

7. Level linearity on the reference level range

Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
137.0	137.0	0.0	± 1.1
136.0	136.0	0.0	± 1.1
135.0	135.0	0.0	± 1.1
134.0	134.0	0.0	± 1.1
133.0	133.0	0.0	± 1.1
132.0	132.0	0.0	± 1.1
131.0	131.0	0.0	± 1.1
129.0	129.0	0.0	± 1.1
124.0	124.0	0.0	± 1.1
119.0	119.0	0.0	± 1.1
114.0	114.0	0.0	± 1.1
109.0	109.0	0.0	± 1.1
104.0	104.1	0.1	± 1.1
99.0	99.0	0.0	± 1.1
94.0	94.0	0.0	± 1.1
89.0	89.0	0.0	± 1.1
84.0	84.0	0.0	± 1.1
79.0	79.0	0.0	± 1.1
74.0	74.0	0.0	± 1.1
69.0	69.0	0.0	± 1.1
64.0	64.0	0.0	± 1.1
59.0	59.0	0.0	± 1.1
54.0	54.0	0.0	± 1.1
49.0	49.0	0.0	± 1.1
44.0	44.0	0.0	± 1.1
39.0	39.0	0.0	± 1.1
34.0	34.0	0.0	± 1.1
30.0	30.0	0.0	± 1.1
29.0	28.9	-0.1	± 1.1
28.0	28.0	0.0	± 1.1
27.0	27.0	0.0	± 1.1
26.0	26.0	0.0	± 1.1
25.0	24.9	-0.1	± 1.1

COPY

8. Level linearity including the level range control

Range	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Auto	94.0	94.0	0.0	±1.1

9. Tone burst response

Time Weighting	Tone burst duration, Tb (ms)	Cycle	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	0.25	1	108.0	107.9	-0.1	1.5 ; -5.0
	2	8	117.0	117.0	0.0	1.0 ; -2.5
	200	800	134.0	134.1	0.1	±1.0
Slow	2	8	108.0	108.0	0.0	1.5 ; -5.0
	200	800	127.6	127.6	0.0	±1.0
SEL	0.25	1	99.0	98.9	-0.1	1.5 ; -5.0
	2	8	108.0	108.0	0.0	1.0 ; -2.5
	200	800	128.0	128.1	0.1	±1.0

10. Peak C sound level

Number of cycle in test signal	Anticipated Value (dB)	Measured Value, Lcpeak (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±3.0
One	136.4	136.1	-0.3	±3.0

Number of cycle in test signal	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±2.0
Positive half cycle	135.4	135.2	-0.2	±2.0
Negative half cycle	135.4	135.2	-0.2	±2.0

COPY

SITHIPORN associates SITHIPORN ASSOCIATES CO.,LTD.
CALIBRATION LABORATORY

Continuation of Calibration Certificate

11. Overload indication

Measured value (dB)		Deviated Value (dB)	Acceptance Limits (dB)
Positive one-half cycle	Negative one-half cycle		
89.7	89.7	0.0	±1.5

12. High level stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	137.0	137.0	0.0	±0.3

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

SOUND LEVEL METER

MODEL : NL-42A

SERIAL No. : 00322748

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24136
Pages : 1 of 8

Calibration Certificate

Equipment : SOUND LEVEL METER
Manufacturer : RION
Model : NL-42A / Microphone UC-52 / Preamplifier NH-24
Serial No.: 00322748 / 196471 / 15480
ID No.: -

Condition As Found : GOOD

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
SAHA GROUP INDUSTRIAL PARK, 683 MOO 11,
NONGKHAM, SIRACHA, CHONBURI 20230 THAILAND.

Location : -
Ambient Temperature : (23.0 ±3) °C
Pressure : (101.3 ±3) kPa
Relative Humidity : (50.0 ±20) %

Received Date : 29 APRIL 2024
Calibration Date : 13-17 MAY 2024
Date of Issue : 20 MAY 2024

Calibrated by : Nathakorn Pisutpaisan

Approved by : T. Petchurai
(Thanakul Petchurai)

COPY

This certificate is issued in accordance with the requirements of ISO/IEC 17025 standard, may not be reproduced other than in full, except with the prior written approval of the head of Calibration Laboratory.

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

NSC-TISI-TIS 17025
CALIBRATION 0394

Calibration Procedure : CP-AC-01

Calibration Method :

This equipment was calibrated by follow on IEC-61672-3 (2013) Standard for sound level meter (SLM).

The SLM had tests to Acoustical and Electrical signal tests of frequency weighting with Anechoic chamber and Reference Standard Instruments.

For tests results of each items were made by observation of each Instruments display and also with SLM's display.

Condition of this result of calibration :

1. Reference Standard Instruments :

Instrument	Model	Serial No.	Cert. No.	Due Date
Waveform Generator	33210A	MY48017076	EF-0009-4	05-FEB-25
Waveform Generator	33511B	MY52302742	EF-0007-24	05-FEB-25
Digital Multimeter	33461A	MY53220104	EEL.BP 21/0267	13-FEB-25
Digital Multimeter	33461A	MY53220076	EEL.BP 20/0267	15-FEB-25
Digital Multimeter	34461A	MY60024273	EEL.BP 22/0267	15-FEB-25
Programmable Attenuator	MAT-1070	62100114	EF-0008-24	05-FEB-25
Condenser Microphone	4180	2977900	AA-1001-24	12-FEB-25
Measuring Amplifier	NA-42KAI	34560495	AA-3001-24	05-FEB-25

2. This result of calibration was found accurate as shown on date and place of calibration for this calibrated item only.
3. This certificate is traceable to the international system of unit maintained at :
   3.1 National Institute of Metrology (Thailand).
   3.2 Thailand Institute of Scientific and Technological Research (TISTR).

COPY

T. Petchurai

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24136
Job No. : VC67AC0083
Pages : 3 of 8

Summary of Measurement Result :

Parameter	Uncertainty (dB)	Maximum-permitted uncertainty of measurement (dB)
1. Absolute sensitivity	0.2	N/A
2. Self-generated noise	0.2	N/A
3. Acoustical signal tests of frequency weightings		
125 Hz	0.3	0.6
1000 Hz	0.3	0.6
8000 Hz	0.3	0.7
4. Electrical signal tests of frequency weightings		
For 10 Hz to 4 kHz	0.3	0.6
For > 4 kHz to 10 kHz	0.3	0.7
For > 10 kHz to 20 kHz	-	1.0
5. Frequency and time weightings at 1 kHz	0.2	0.2
6. Long - term stability	0.1	0.1
7. Level linearity on the reference level range	0.2	0.3
8. Level linearity including the level range control	0.2	0.3
9. Tone burst response	0.2	0.3
10. Peak C sound level	0.2	0.35
11. Overload indication	0.2	0.25
12. High level stability	0.1	0.1

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24136
Job No. : VC67AC0083
Pages : 4 of 8

Result of calibration :

1. Absolute sensitivity

Reference Acoustic Signal (dB)	Measured Value (dB)	Deviation (dB)	Acceptance Limit (dB)
93.9 (93.98)	93.9	0.0	±0.3

2. Self-generated noise

2.1 Normal test

Measured Value (dB)
15.1

2.2 The microphone of the sound level meter was replaced by electrical signal input device.

Frequency Weighting	Measured value (dB)
A - weight	13.2
C - weight	19.3
Flat	24.0

3. Acoustical signal tests of frequency weightings

Meter free-field acoustic response at a level of 84 dB

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
125	0.0	0.1	0.1	± 1.5
1000	-0.1	-0.1	-0.1	± 1.0
8000	0.6	0.7	0.7	±5.0

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24136
Job No. : VC67AC0083

4. Electrical signal tests of frequency weightings

Weighting network response with relative to 1 kHz.

Frequency (Hz)	Deviation from various frequency weighting response curve (dB)			
	Flat	C-weight	A-weight	Acceptance Limits
63	0.0	-0.1	-0.1	±2.0
125	0.0	0.0	0.0	±1.5
250	0.0	0.0	-0.1	±1.5
500	0.0	0.0	-0.1	±1.5
1000	0.0	0.0	0.0	±1.0
2000	0.0	0.0	0.0	±2.0
4000	0.0	0.0	0.0	±3.0
8000	0.0	0.1	0.1	±5.0

5. Frequency and time weightings at 1 kHz

5.1 Frequency weightings at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.2
C - weight	94.0	94.0	0.0	± 0.2
Flat	94.0	94.0	0.0	± 0.2

5.2 Time weighting at 1 kHz

Frequency Weighting	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	94.0	94.0	0.0	± 0.1
Slow	94.0	94.0	0.0	± 0.1
Leq	94.0	94.0	0.0	± 0.1

6. Long - term stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	94.0	94.0	0.0	± 0.3

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24136
Job No. : VC67AC0083

7. Level linearity on the reference level range

Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
137.0	137.0	0.0	± 1.1
136.0	136.0	0.0	± 1.1
135.0	135.0	0.0	± 1.1
134.0	134.0	0.0	± 1.1
133.0	133.0	0.0	± 1.1
132.0	131.9	-0.1	± 1.1
131.0	131.0	0.0	± 1.1
129.0	129.0	0.0	± 1.1
124.0	124.0	0.0	± 1.1
119.0	119.0	0.0	± 1.1
114.0	114.0	0.0	± 1.1
109.0	109.0	0.0	± 1.1
104.0	104.0	0.0	± 1.1
99.0	99.0	0.0	± 1.1
94.0	94.0	0.0	± 1.1
89.0	89.0	0.0	± 1.1
84.0	84.0	0.0	± 1.1
79.0	79.0	0.0	± 1.1
74.0	74.0	0.0	± 1.1
69.0	69.0	0.0	± 1.1
64.0	64.0	0.0	± 1.1
59.0	59.0	0.0	± 1.1
54.0	54.0	0.0	± 1.1
49.0	49.0	0.0	± 1.1
44.0	44.0	0.0	± 1.1
39.0	39.0	0.0	± 1.1
34.0	34.0	0.0	± 1.1
30.0	30.0	0.0	± 1.1
29.0	29.0	0.0	± 1.1
28.0	28.0	0.0	± 1.1
27.0	27.0	0.0	± 1.1
26.0	26.0	0.0	± 1.1
25.0	25.0	0.0	± 1.1

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24136
Job No. : VC67AC0083
Pages : 7 of 8

8. Level linearity including the level range control

Range	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Auto	94.0	94.0	0.0	±1.1

9. Tone burst response

Time Weighting	Tone burst duration, Tb (ms)	Cycle	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Fast	0.25	1	108.0	107.9	-0.1	1.5 ; -5.0
	2	8	117.0	117.0	0.0	1.0 ; -2.5
	200	800	134.0	134.0	0.0	±1.0
Slow	2	8	108.0	108.0	0.0	1.5 ; -5.0
	200	800	127.6	127.6	0.0	±1.0
SEL	0.25	1	99.0	98.9	-0.1	1.5 ; -5.0
	2	8	108.0	108.0	0.0	1.0 ; -2.5
	200	800	128.0	128.0	0.0	±1.0

10. Peak C sound level

Number of cycle in test signal	Anticipated Value (dB)	Measured Value, Lcpeak (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±3.0
One	136.4	136.4	0.0	±3.0

Number of cycle in test signal	Anticipated Value (dB)	Measured Value (dB)	Deviated Value (dB)	Acceptance Limits (dB)
Continuous	133.0	133.0	0.0	±2.0
Positive half cycle	135.4	135.1	-0.3	±2.0
Negative half cycle	135.4	135.1	-0.3	±2.0

COPY

SITHIPORN ASSOCIATES CO., LTD.
CALIBRATION LABORATORY

451-451/1 Sirinthorn Road, Bangbumru, Bangplud, Bangkok, 10700 Thailand
Tel. +66 2433 8331 Email : calibration@sithiphorn.com

SITHIPORN associates

NSC-TISI-TIS 17025
CALIBRATION 0394

Cert. No. : ACL24136
Job No. : VC67AC0083
Pages : 8 of 8

11. Overload indication

Measured value (dB)		Deviated Value (dB)	Acceptance Limits (dB)
Positive one-half cycle	Negative one-half cycle		
89.6	89.5	-0.1	±1.5

12. High level stability

Frequency Weighting	SLM Display at initial (dB)	SLM Display at final (dB)	Deviated Value (dB)	Acceptance Limits (dB)
A - weight	137.0	137.0	0.0	±0.3

The reported uncertainty is based on a standard uncertainty multiplied by coverage factor $k = 2$ or any value following calculation,providing a lavel of confidence of approximately 95 %

End of Calibration Certificate

COPY

ANALYTICAL BALANCE (DU)

Model : XS205DU

Serial No. : 1126323724

Certificate No. : 23-148799
Sample Code : 23-56200-001

CERTIFICATE OF CALIBRATION

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapibarn 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : EASTERN THAI CONSULTING 1992 CO., LTD.
(Analytical Balance Room)

Equipment : ELECTRONIC BALANCE

Manufacturer : METTLER TOLEDO

Model : XS205DU

Serial No. : 1126323724

ID No. : LABE 05/1

Date of Receipt : 22 December 2023

Date of Calibration : 22 December 2023

Calibrated by : Mr. Somwang Sangdee
Scientist

Approved by : (Mr. Somchai Neampunt)
Signed for Director

Issue date : 25 December 2023

The uncertainties are for a confidence probability of approximately 95%.

The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

COPY

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

Certificate No. : 23-148799
Sample Code : 23-56200-001

REPORT OF CALIBRATION

Equipment : ELECTRONIC BALANCE
Manufacturer : METTLER TOLEDO
Model : XS205DU
Capacity : Max 81 g / 220 g
Resolution : 0.01 mg / 0.1 mg
Serial No. : 1126323724
ID No. : LABE 05/1

Result of Calibration

1.Test weight and repeatability of reading

Repeatability is a measure of the ability of a balance to supply the same result in repetitive weighings with one and the same load under the same measurement condition. The measurement of the repeatability must include both the balance specifications and the ambient (vibration, fluctuating air current/temperature/humidity,etc.) Operator handling of the balance is also included in the standard deviation.

Unit : g — Range : 80

☐ No adjustment
☑ Adjustment

	☑ Before adjustment		☑ After adjustment	
Nominal value	40	80	40	80
Standard weight	40.000054	80.000048	40.000054	80.000048
Average reading of indicator	40.00026	80.00037	40.00017	80.00017
Standard deviation	0.000015	0.000016	0.000008	0.000009

Unit : g — Range : 200

☐ No adjustment
☑ Adjustment

	☑ Before adjustment		☑ After adjustment	
Nominal value	100	200	100	200
Standard weight	100.000042	200.000041	100.000042	200.000041
Average reading of indicator	100.0003	200.0004	100.0001	200.0001
Standard deviation	0.00005	0.00005	0.00003	0.00005

COPY

REPORT OF CALIBRATION

Result of Calibration

2. Sensitivity or value of a scale division

Change in the output variable of a measuring instrument divided by the associated change in the input variable.

Unit : g

Range : 80		Range : 200	
Test Point	Sensitivity, S	Test Point	Sensitivity, S
0	1.00748	0	1.0274
40	0.98753	100	0.9975
80	0.99751	200	0.9975

3. Departure of indication from nominal value, Linearity

Unit : g

Nominal Value	Standard Value	Average Reading of Indicator	Correction Value	Expanded Uncertainty	Coverage Factor (k)
Unload	0.0000000	0.00000	0.00000	0.000012	2.05
0.01	0.0100025	0.01000	0.00000	0.000012	2.05
0.1	0.1000019	0.10001	-0.00001	0.000013	2.03
1	1.0000125	1.00001	0.00000	0.000015	2.02
5	5.0000208	5.00004	-0.00002	0.000021	2.00
10	10.000004	10.00008	-0.00008	0.000026	2.00
20	20.000030	20.00011	-0.00008	0.000036	2.00
50	50.000014	50.00014	-0.00013	0.000068	2.00
100	100.000042	100.0001	-0.0001	0.00016	2.00
150	150.000056	150.0001	0.0000	0.00022	2.00
200	200.000041	200.0002	-0.0002	0.00027	2.00

COPY

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003.

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

Certificate No. : 23-148799
Sample Code : 23-56200-001

REPORT OF CALIBRATION

Result of Calibration :

4. Eccentric or off-centre loading

Deviation of the measurement value through off - center (eccentric) loading. The corner load increases with the weight of the load and its removal from the center of the pan support.

Weighing pan : ○ Circle ○ Triangular ◉ Rectangular

Test weight : 50 and 100 Unit : g

Range	80	200
Position	Reading of indicator	Reading of indicator
1	50.00015	100.0001
2	50.00022	100.0001
3	50.00008	100.0001
4	50.00002	100.0000
5	50.00016	100.0002
6	50.00014	100.0001
Maximum difference	0.00013	0.0001

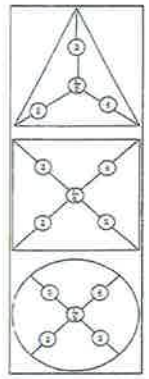

Condition of Calibration

1. Calibration Method : WI-CL-004 base on UKAS LAB 14: 2019
2. This result of calibration was found accurate as shown on date and place of calibration only.
3. Condition of Calibration item: Normal
4. This certification is traceable to the International System of Unit maintained at : -

- Through the reference standard laboratory of Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (instrument number 1).

5. Reference standard instrument :

Instrument	Class	ID No.	Certificate No.	Due Date
1) STANDARD WEIGHT 1 mg to 1 kg	E2	LB-WE-79	23-105642	10 September 2024

6.

Ambient conditions	Min	Max
Temperature (°C)	22.8	23.0
Relative Humidity (%Rh)	43.5	51.1
Air pressure (hPa)	1012.5	1014.5

- End of Report -

COPY

361 Soi Ladprao 122, Ladprao Road,
Phlabphla, Wang Thonglang, Bangkok 10310
FM-CL-064

TEL 02-516-2422
FAX 02-516-6949
Rev.03

CONTACT@AMARC.CO.TH
WWW.AMARC.CO.TH
Effective Date 15/10/21

ANALYTICAL BALANCE

Model : SECURA224-1S

Serial No. : 0036707137

CERTIFICATE OF CALIBRATION

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapibarn 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : EASTERN THAI CONSULTING 1992 CO., LTD.
(Analytical Balance Room)

Equipment : ELECTRONIC BALANCE

Manufacturer : SARTORIUS

Model : SECURA224-1S

Serial No. : 0036707137

ID No. : LABE 05/2

Date of Receipt : 22 December 2023

Date of Calibration : 22 December 2023

Calibrated by Mr. Somwang Sangdee
Scientist

Approved by (Mr. Somchai Neampunt)
Signed for Director

Issue date 25 December 2023

COPY

The uncertainties are for a confidence probability of approximately 95%.

The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

REPORT OF CALIBRATION

Equipment : ELECTRONIC BALANCE
Manufacturer : SARTORIUS
Model : SECURA224-1S
Capacity : Max 220 g
Resolution : 0.0001 g
Serial No. : 0036707137
ID No. : LABE 05/2

Result of Calibration

1.Test weight and repeatability of reading

Repeatability is a measure of the ability of a balance to supply the same result in repetitive weighings with one and the same load under the same measurement condition. The measurement of the repeatability must include both the balance specifications and the ambient (vibration, fluctuating air current/temperature/humidity,etc.) Operator handling of the balance is also included in the standard deviation.

Unit : g
Range : 220

☐ No adjustment
☑ Adjustment

	☑ Before adjustment		☑ After adjustment	
Nominal value	100	200	100	200
Standard weight	100.000042	200.000041	100.000042	200.000041
Average reading of indicator	99.9998	199.9998	100.0000	200.0000
Standard deviation	0.00006	0.00007	0.00003	0.00007

Unit : -
Range : -

☐ No adjustment
☐ Adjustment

	☐ Before adjustment		☐ After adjustment	
Nominal value	-	-	-	-
Standard weight	-	-	-	-
Average reading of indicator	-	-	-	-
Standard deviation	-	-	-	-

COPY

REPORT OF CALIBRATION

Result of Calibration

2. Sensitivity or value of a scale division

Change in the output variable of a measuring instrument divided by the associated change in the input variable.

Unit : g

Range : 220 Range : -

Test Point	Sensitivity, S	Test Point	Sensitivity, S
0	0.7980	-	-
100	0.8978	-	-
200	0.8978	-	-

3. Departure of indication from nominal value, Linearity

Unit : g

Nominal Value	Standard Value	Average Reading of Indicator	Correction Value	Expanded Uncertainty	Coverage Factor (k)
Unload	0.0000000	0.0000	0.0000	0.000086	2.00
0.01	0.0100025	0.0100	0.0000	0.000086	2.00
0.1	0.1000019	0.1000	0.0000	0.000087	2.00
1	1.0000125	1.0000	0.0000	0.000087	2.00
2	2.0000089	2.0000	0.0000	0.000087	2.00
5	5.0000208	5.0001	-0.0001	0.000088	2.00
10	10.000004	10.0000	0.0000	0.000090	2.00
20	20.000030	20.0000	0.0000	0.000093	2.00
50	50.000014	50.0000	0.0000	0.00011	2.00
100	100.000042	100.0000	0.0000	0.00016	2.00
200	200.000041	200.0000	0.0000	0.00028	2.00

COPY

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003.

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Result of Calibration :

4. Eccentric or off-centre loading

Deviation of the measurement value through off - center (eccentric) loading. The corner load increases with the weight of the load and its removal from the center of the pan support.

Weighing pan: (●) Circle ( ) Triangular ( ) Rectangular

Test weight : 100 Unit : g

Range	220	-
Position	Reading of indicator	Reading of indicator
1	100.0000	-
2	100.0000	-
3	100.0000	-
4	99.9999	-
5	100.0000	-
6	100.0000	-
Maximum difference	0.0001	-

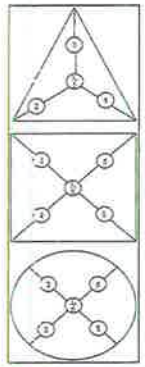

Condition of Calibration

1. Calibration Method : WI-CL-004 base on UKAS LAB 14: 2019
2. This result of calibration was found accurate as shown on date and place of calibration only.
3. Condition of Calibration item: Normal
4. This certification is traceable to the International System of Unit maintained at :
- Through the reference standard laboratory of Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (Instrument number 1)
5. Reference standard instrument :

Instrument	Class	ID No.	Certificate No.	Due Date
1) STANDARD WEIGHT 1 mg to 1 kg	E2	LB-WE-79	23-105642	10 September 2024

6.

Ambient conditions	Min	Max
Temperature (°C)	24.4	24.8
Relative Humidity (%Rh)	39.9	41.1
Air pressure (hPa)	1012.2	1012.8

- End of Report -

COPY

361 Soi Ladprao 122, Ladprao Road,
Phlabphla, Wang Thonglang, Bangkok 10310
FM-CL-064

TEL 02-516-2422
FAX 02-516-6949
Rev.03

CONTACT@AMARC.CO.TH
WWW.AMARC.CO.TH
Effective Date 15/10/21

BOD INCUBATOR

Model : TC445S

Serial No. : 0223/007275

S K SALES AND SERVICE CO.,LTD.
194/56, 194/57 Thakham Rd. Samae Dam
Bang Khun Thian Bangkok 10150
Tel. : 02-417-2144 Fax : 02-417-2155

ISO/IEC 17025 TISI 17025
CALIBRATION 0261

Certificate of Calibration

Reference No.	:	C03190/2309-025	Certificate No. :	S2309-3014
Customer	:	Eastern Thai Consulting 1992 Co.,Ltd.		Page 1 of 2
	:	683 Moo 11, Sukhaphiban 8, Tambol Nongkham,		
	:	Siracha District, Chonburi 20230, Thailand		
Equipment	:	Incubator		
Manufacturer	:	Lovibond		
Model	:	TC445S		
Serial No.	:	0223/007275		
ID No.	:	-		
Received Date	:	15 September 2023		
Calibrated Date	:	15 September 2023		
Issued Date	:	18 September 2023		

Environment

	Minimum Value	Maximum Value
Ambient Temperature (°C)	27.5	28.1
Relative Humidity (% RH)	57	58
AC Line Voltage (VAC)	224	226

Place Of Calibration : Production Line

Calibrated by : Mr. Teerasak Chaiyaporn

Calibration Method

In-house method : SK-WI-23 base on Thai Laboratory Accreditation Scheme Publication Reference G-20

Condition of this result of calibration

1. Reference standard instrument

	Instrument	Serial No.	Certificate No.	Due Date
1)	Data acquisition/Switch unit	MY44047397	L2305-268	4 November 2023
2)	Multiplexer Module	MY41105123	L2305-268	4 November 2023

2. This result of calibration was found accurate as shown on date and place of calibration only

3. This certificate can be traceable to International System of Unit :

- Through Thailand Institute of Scientific And Technological Research (TISTR)

Approved by :

☐ Mr.Suphachai Saksri ☐ Mr.Phayak Toolit ☐ Miss Tantaraporn Pettong

The reported uncertainty is based on a standard uncertainty multiplied by a coverage factor k = 2.0 ,providing a level of confidence level of approximately 95 %

COPY

This certificate may not be reproduced other than in full except with the prior written approval of the S K Sales And Service Company Limited.

Table1 General Information

Working Area (W*L*H)	60 *56 *145 cm
Fresh Air	OFF

Table2 Chamber Perfomance

Setting Temperature (°C)	Average Indicating Temperature (°C)	Measured Stability (± °C)	Measured Uniformity (°C)	Overall Variation (°C)
20.0	20.0	0.37	0.64	0.98

Table3 Temperature Distribution

Setting Temperature (°C)	Average Standard Reading (°C)									Uncertainty (± °C)
	No. 1	No. 2	No. 3	No. 4	No. 5	No. 6	No. 7	No. 8	No. 9	
20.0	19.52	19.40	19.70	19.43	19.33	19.39	19.45	19.58	19.67	0.55

Resolution : 0.1 (°C)

* Probe No. 9 is Reference Probe



Notes : 1. The temperature stability is the one-half of greatest maximum difference of measured temperatures at any one probe.

2. The temperature uniformity is the maximum difference of measured temperatures between of any probes and the measured temperature at the reference location which are observed at same time

3. Overall variation is the difference of maximum and minimum measured temperatures throughout observation time.

4. The reported uncertainty of measurement were excluded Uniformity and Stability

** End of Calibration Report **

COPY

BOD INCUBATOR

ID No. : LABE 19/5

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

ilac-MRA THAILAND NSC-TISI-TIS17025 CALIBRATION 0152

CERTIFICATE OF CALIBRATION

Certificate No. : 23-040768

Sample Code : 23-16178-002

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapiban 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : EASTERN THAI CONSULTING 1992 CO., LTD.
(Laboratory)

Equipment : Temperature controlled enclosures (Incubator)

Manufacturer : Lovibond Model : Tc445S

Serial No. : 0520/005227 ID No. : LABE 19/5

Date of Receipt : 21 April 2023 Date of Calibration : 21 April 2023

Condition of Calibration

1. Environment
   - 1.1 Ambient temperature : Maximum 36.1 °C : Minimum 34.5 °C
   - 1.2 Relative humidity : Maximum 51.8 % : Minimum 49.3 %
   - 1.3 Line voltage supplied : Maximum 224.7 VAC : Minimum 221.9 VAC

2. **Calibration method**
   TLAS-G-20: Guidelines for calibration and checks of temperature controlled enclosures.

3. **Reference standard instrument**

Instrument	ID No.	Certificate No.	Due Date
Data Acquisition With Sensor (RTD-Pt100)	LB-DA-08 (RTD-239 to RTD-247)	22-077888	09 August 2023

4. **This certificate is traceable to the international system of unit (SI Unit).**
   The measurement is traceable to Asia Medical and Agricultural Laboratory and Research Center Public Company Limited.

5. **This result of calibration was found accurate as shown on date and place of calibration only.**

6. **Condition of calibration item** : Normal

Calibrated by : Mr. Sarawoot Thammo
Scientist

Approved by : (Mr. Somchai Neampunt)
Signed for Director

Issue date : 24 April 2023

COPY

The uncertainties are for a confidence probability of approximately 95%
The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC)

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

ilac-MRA THAILAND NSC-TISI-TIS17025 CALIBRATION 0152

REPORT OF CALIBRATION

Certificate No. : 23-040768

Sample Code : 23-16178-002

Results of Calibration

Resolution : 0.1 °C

1. Reporting of Temperature

Calibration point (°C)	UUC* setting (°C)	UUC* reading (°C)	Measured temperature at each positions (°C)									Uncertainty ± (°C)	Coverage factor *k*
			# 1	# 2	# 3	# 4	# 5	# 6	# 7	# 8	# 9 Ref		
20	20.0	20.0	20.06	19.92	19.96	19.89	19.93	20.08	19.97	19.79	19.86	0.42	2.00

2. Characterization results

Calibration point (°C)	Stability ± (°C)	Uniformity (°C)	Overall variation (°C)
20	0.32	0.37	0.85

Notes
- UUC* = Unit Under Calibration

COPY

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Certificate No. : 23-040768

Sample Code : 23-16178-002

Results of Calibration

Notes

1. Sensor installation locations
   1.1 All sensors at any corners or walls should be positioned 5 cm (a x b x c) from the wall.
   1.2 The reference sensor is preferably located of the geometric center of the chamber.
2. Interior dimensions approx of chamber :
   W = 60 cm ; D = 56 cm ; H = 146 cm
3. Air valve or fresh air level : Off
4. Fan level : Open
5. The quoted uncertainty includes" Stability of chamber and loading effect in chamber at 20% of uniformity ".

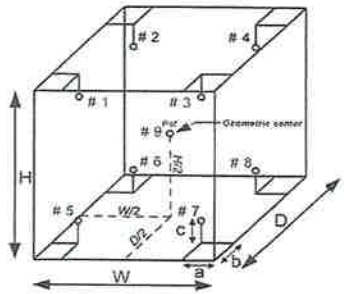

Figure: Example of sensor installation Positions

6. Uniformity - the maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
7. Stability - one-half of the greatest maximum difference of measured temperatures at any one sensor.
8. Overall variation - the difference of the maximum and the minimum measured temperatures throughout observation time.
9. UUC* reading - the average reading of indicating device that forms the integral part of the enclosure.
10. Calibration results without adjustment.

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor k, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003

- End of Report -

COPY

361 Soi Ladprao 122, Ladprao Road,
Phlabphla, Wang Thonglang, Bangkok 10310
TEL 02-516-2422
FAX 02-516-6949
CONTACT@AMARC.CO.TH
WWW.AMARC.CO.TH

BOD INCUBATOR

ID No. : LABE 19/5

CERTIFICATE OF CALIBRATION

Certificate No. : 24-046203

Sample Code : 24-18906-002

Customer	:	EASTERN THAI CONSULTING 1992 CO., LTD. 683 Moo 11, Sukhapibarn 8 Rd., Nongkham, Sriracha, Chonburi 20230			
Location of Calibration	:	EASTERN THAI CONSULTING 1992 CO., LTD. (Laboratory)			
Equipment	:	Temperature controlled enclosures (Incubator)			
Manufacturer	:	Lovibond	Model	:	Tc445S
Serial No.	:	0520/005227	ID No.	:	LABE 19/5
Date of Receipt	:	18 April 2024	Date of Calibration	:	18 April 2024

Condition of Calibration

1. Environment
   - 1.1 Ambient temperature : Maximum 35.0 °C ; Minimum 33.7 °C
   - 1.2 Relative humidity : Maximum 69.1 % ; Minimum 50.0 %
   - 1.3 Line voltage supplied : Maximum 222.5 VAC ; Minimum 218.8 VAC
2. Calibration method

   TLAS-G-20: Guidelines for calibration and checks of temperature controlled enclosures.
3. Reference standard instrument

Instrument	ID No.	Certificate No.	Due Date
Data Acquisition With Sensor (RTD-Pt100)	LB-DA-08 (RTD-248 to RTD-256)	23-084070	06 August 2024

4. This certificate is traceable to the international system of unit (SI Unit).

   The measurement is traceable to Asia Medical and Agricultural Laboratory and Research Center Public Company Limited.
5. This result of calibration was found accurate as shown on date and place of calibration only.
6. Condition of calibration item : Normal

Calibrated by : Mr. Sarawoot Thammo
Scientist

Issue date : 19 April 2024

Approved by : (Mr. Nuttaput Timula)
Signed for Director

COPY

The uncertainties are for a confidence probability of approximately 95%.
The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Certificate No. : 24-046203

Sample Code : 24-18906-002

Results of Calibration

Resolution : 0.1 °C

1. Reporting of Temperature

Calibration point (°C)	UUC* setting (°C)	UUC* reading (°C)	Measured temperature at each positions (°C)									Uncertainty ± (°C)	Coverage factor *k*
			# 1	# 2	# 3	# 4	# 5	# 6	# 7	# 8	# 9 Ref		
20	20.5	20.0	20.28	19.86	19.90	19.91	19.82	20.10	20.01	19.89	19.75	0.59	2.00

2. Characterization results

Calibration point (°C)	Stability ± (°C)	Uniformity (°C)	Overall variation (°C)
20	0.45	0.85	1.31

Notes

- UUC* = Unit Under Calibration

COPY

361 Soi Ladprao 122, Ladprao Road,
Phlabphla, Wang Thonglang, Bangkok 10310
FM-CL-018

TEL 02-516-2422
FAX 02-516-6949
Rev.09

CONTACT@AMARC.CO.TH
WWW.AMARC.CO.TH
Effective Date 15/10/21

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Certificate No. : 24-046203

Sample Code : 24-18906-002

Results of Calibration

Notes

1. Sensor installation locations
   1.1 All sensors at any corners or walls should be positioned 5 cm (a x b x c) from the wall.
   1.2 The reference sensor is preferably located of the geometric center of the chamber.
2. Interior dimensions approx of chamber :
   W = 60 cm ; D = 56 cm ; H = 146 cm
3. Air valve or fresh air level : Off
4. Fan level : Open
5. The quoted uncertainty includes" Stability of chamber and loading effect in chamber at 20% of uniformity ".

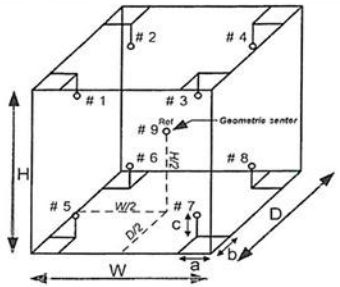

Figure: Example of sensor installation Positions

6. Uniformity - the maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
7. Stability - one-half of the greatest maximum difference of measured temperatures at any one sensor.
8. Overall variation - the difference of the maximum and the minimum measured temperatures throughout observation time.
9. UUC* reading - the average reading of indicating device that forms the integral part of the enclosure.
10. Calibration results without adjustment.

The result expanded uncertainty of measurement U is stated as the standard uncertainty of measurement multiplied by the coverage factor k, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003.

- End of Report -

COPY

Hot Air Oven

Model : UM 400

Serial No. : 900982

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

CERTIFICATE OF CALIBRATION

Certificate No. : 24-001944

Sample Code : 24-00963-001

Customer	:	EASTERN THAI CONSULTING 1992 CO., LTD. 683 Moo 11, Sukhapibarn 8 Rd., Nongkham, Sriracha, Chonburi 20230			
Location of Calibration	:	EASTERN THAI CONSULTING 1992 CO., LTD. (Hot Lab)			
Equipment	:	Temperature controlled enclosures (Hot air oven)			
Manufacturer	:	Memmert	Model	:	UM 400
Serial No.	:	900982	ID No.	:	LABE 17/1
Date of Receipt	:	09 January 2024	Date of Calibration	:	09 January 2024

Condition of Calibration

1. Environment
   - 1.1 Ambient temperature : Maximum 30.6 °C ; Minimum 29.2 °C
   - 1.2 Relative humidity : Maximum 57.5 % ; Minimum 46.4 %
   - 1.3 Line voltage supplied : Maximum 229.5 VAC ; Minimum 222.5 VAC
2. Calibration method

   TLAS-G-20: Guidelines for calibration and checks of temperature controlled enclosures.
3. Reference standard instrument

Instrument	ID No.	Certificate No.	Due Date
Data Acquisition With Sensor (RTD-Pt100)	LB-DA-10 (RTD-257 to RTD-265)	23-066256	29 June 2024

4. This certificate is traceable to the international system of unit (SI Unit).

   The measurement is traceable to Asia Medical and Agricultural Laboratory and Research Center Public Company Limited.
5. This result of calibration was found accurate as shown on date and place of calibration only.
6. Condition of calibration item : Normal

Calibrated by : Mr. Sarawoot Thammo, Scientist

Approved by : (Mr. Somchai Neampunt) Signed for Director

Issue date : 09 January 2024

COPY

The uncertainties are for a confidence probability of approximately 95%.
The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Certificate No. : 24-001944

Sample Code : 24-00963-001

Results of Calibration

Resolution : 0.1 °C

1. Reporting of Temperature

Calibration point (°C)	UUC* setting (°C)	UUC* reading (°C)	Measured temperature at each positions (°C)									Uncertainty ± (°C)	Coverage factor *k*
			#1	#2	#3	#4	#5	#6	#7	#8	#9 Ref		
60	60.0	60.0	60.04	59.90	59.81	59.84	59.47	59.91	60.08	59.98	59.87	0.25	2.00
85	85.0	85.0	86.07	85.75	85.58	85.62	84.69	85.83	86.28	85.94	85.77	0.34	2.00

2. Characterization results

Calibration point (°C)	Stability ± (°C)	Uniformity (°C)	Overall variation (°C)
60	0.11	0.49	0.80
85	0.09	1.13	1.72

Notes

- UUC* = Unit Under Calibration

COPY

361 Soi Ladprao 122, Ladprao Road,
Phlabphla, Wang Thonglang, Bangkok 10310
TEL 02-516-2422
FAX 02-516-6949
CONTACT@AMARC.CO.TH
WWW.AMARC.CO.TH
FM-CL-018 Rev.09 Effective Date: 15/10/21

REPORT OF CALIBRATION

Certificate No. : 24-001944

Sample Code : 24-00963-001

Results of Calibration

Notes

1. Sensor installation locations
   - 1.1 All sensors at any corners or walls should be positioned 5 cm (a x b x c) from the wall.
   - 1.2 The reference sensor is preferably located of the geometric center of the chamber.
2. Interior dimensions approx of chamber :
   W = 40 cm ; D = 28 cm ; H = 39 cm
3. Air valve or fresh air level : Off
4. Fan level : Open
5. The quoted uncertainty includes" Stability of chamber and loading effect in chamber at 20% of uniformity ".
6. Uniformity - the maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
7. Stability - one-half of the greatest maximum difference of measured temperatures at any one sensor.
8. Overall variation - the difference of the maximum and the minimum measured temperatures throughout observation time.
9. UUC' reading - the average reading of indicating device that forms the integral part of the enclosure.
10. Calibration results without adjustment.

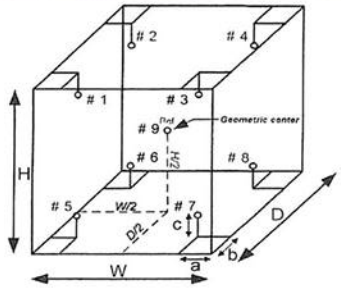

Figure: Example of sensor installation Positions

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003.

- End of Report -

COPY

LIQUID IN GLASS THERMOMETER

Model : Total Immersion

Serial No. : 43560

QUALITY CALIBRATION CO.,LTD.
235 Petchkasem 63/2 Road, Laksong, Bangkae, Bangkok 10160
Tel (662) 421-5402, (662) 444-0152-3, Fax (662) 809-4584
www.qcalibration.com

NSC-TISI-TIS17025 CALIBRATION 0049

CERTIFICATE No : 23T10864
REFERENCE No : 71117-1

Certificate of Calibration

EQUIPMENT	:	LIQUID IN GLASS THERMOMETER
MANUFACTURER	:	PRECISION
MODEL	:	0 °C TO 100 °C
SERIAL No	:	43560
ID No	:	LABE 16/1
RESOLUTION	:	0.1 °C
TYPE	:	TOTAL IMMERSION
CONDITION AS RECEIVED	:	USED ITEM
SUBMITTED BY	:	EASTERN THAI CONSULTING 1992 CO., LTD. 683 MOO 11, SUKHAPIBAN 8 ROAD, NONGKHAM, SRIRACHA, CHONBURI 20230

CALIBRATED BY	:	CHARUKIT L.
CALIBRATION DATE	:	09-Nov-23
APPROVED BY	:	PONGSAK J.
ISSUED DATE	:	09-Nov-23
RECEIVED DATE	:	02-Nov-23

COPY

THIS CERTIFICATE MAY NOT BE REPRODUCED OTHER THAN IN FULL EXCEPT WITH THE PRIOR WRITTEN APPROVAL OF QUALITY CALIBRATION CO., LTD.

QUALITY CALIBRATION CO.,LTD.
235 Petchkasem 63/2 Road, Laksong, Bangkae, Bangkok 10160
Tel (662) 421-5402, (662) 444-0152-3, Fax (662) 809-4584
www.qcalibration.com

Calibration Report

EQUIPMENT	:	LIQUID IN GLASS THERMOMETER			
MANUFACTURER	:	PRECISION			
MODEL	:	0 °C TO 100 °C			
ID No	:	LABE 16/1	**SERIAL NUMBER**	:	43560
RESOLUTION	:	0.1 °C	**TYPE**	:	TOTAL IMMERSION
RECEIVED DATE	:	02-Nov-23	**CALIBRATION DATE**	:	09-Nov-23
AMBIENT TEMPERATURE	:	23 °C ± 3 °C	**RELATIVE HUMIDITY**	:	50 %RH ± 20 %RH

CONDITION OF THIS RESULTS OF CALIBRATION

1. THIS INSTRUMENT WAS CALIBRATED BASED ON ASTM E77:1992 BY COMPARISON WITH STANDARD PLATINUM RESISTANCE THERMOMETER (SPRT) INTO LIQUID BATH TEMPERATURE CONTROLLER. THE TEMPERATURE SCALE USED WAS BASED ON ITS-90.
2. REFERENCE STANDARD INSTRUMENTS :-

INSTRUMENT	MODEL	SERIAL No	CERTIFICATE No	DUE DATE
1) STANDARD THERMOMETER	1502	77964	23T3927	08-Mar-24
2) SPRT PROBE	5614	636626	23T3927	08-Mar-24
3) PRECISION BATH	7320	A21105	22T13199	14-Dec-23
4) PRECISION BATH	CTR-40	A68155	22T13198	09-Dec-23
5) PRECISION BATH	6045	3C023	22T13200	19-Dec-23

3. THE CERTIFICATE IS VALID FOR THE ITEM CALIBRATED AS SHOWN ON THE DATE AND PLACE OF CALIBRATION ONLY.
4. THIS RESULT EXCLUDE LONG TERM STABILITY OF THE UNIT UNDER CALIBRATION.
5. THIS CERTIFICATE IS TRACEABLE TO THE INTERNATIONAL SYSTEM OF UNIT MAINTAINED AT:-
   - NATIONAL INSTITUTE OF METROLOGY (THAILAND).

RESULT OF CALIBRATION : WITHOUT ADJUSTMENT

STANDARD READING (°C)	UUC* READING (°C)	IMMERSION DEPTH (mm)	CORRECTION (°C)	EMERGENT STEM TEMPERATURE (°C)	UNCERTAINTY OF MEASUREMENT (±°C)
0.009	0.0	60	0.0090	N/A	0.26
25.01	25.0	165	0.0050	N/A	0.26
50.00	50.0	275	0.0040	N/A	0.26
99.991	100.0	360	-0.009	29.3	0.26

UUC* : UNIT UNDER CALIBRATION

THE REPORTED UNCERTAINTY OF MEASUREMENT WAS BASED ON A STANDARD UNCERTAINTY MULTIPLIED BY A COVERAGE FACTOR k =2, PROVIDING A LEVEL OF CONFIDENCE APPROXIMATELY 95%.

END OF CALIBRATION REPORT

COPY

pH Meter

Model. : SevenCompact S220

Serial No. : B448305208

CERTIFICATE OF CALIBRATION

Certificate No. : 23-011524

Sample Code : 23-04833-001

Customer	:	EASTERN THAI CONSULTING 1992 CO., LTD. 683 Moo 11, Sukhapiban 8 Rd., Nongkham, Sriracha, Chonburi 20230			
Location of Calibration	:	Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (Calibration Laboratory)			
Equipment	:	pH Meter			
Manufacturer	:	METTLER TOLEDO	Model	:	SevenCompact S220
Serial No.	:	B448305208	ID No.	:	LABE 11/4
Date of Receipt	:	01 February 2023	Date of Calibration	:	01 February 2023

Condition of Calibration

1. Environment

1.1 Ambient temperature : 25.0 ± 2.5 °C 1.2 Relative humidity : 55.0 % ± 15.0 %

2. Calibration method

In house method WI-CL-019: based on direct measurement by using standard voltage calibrator and using certified reference material (CRM).

3. Reference standard / Certified reference material

Instrument		ID No.	Certificate No.	Due Date
3.1 Voltage Calibrator		LB-AMC-01	22E3240	03 October 2023
3.2 Digital Thermometer		LB-TH-33	22-107027	02 October 2023
Certified Reference Material		Lot. No.	Ref No.	Expire Date
3.3 Buffer Solution pH	4.008	838357	PH216.L5	15 September 2024
3.4 Buffer Solution pH	6.985	838358	PH107.L5	15 September 2023
3.5 Buffer Solution pH	10.008	838359	PH220.L5	15 September 2023

4. This certificate is traceable to the international system of unit (SI Unit).

4.1 Instrument No. 3.1 through Technology Promotion Association (Thailand-Japan).

4.2 Instrument No. 3.2 through Asia Medical and Agricultural Laboratory and Research Center Public Company Limited.

4.3 Buffer Solution No. 3.3 and No. 3.5 traceable to CPA chem (through primary measurement method-Harned cell using calibrated thermometer, barometer, and nanovoltmeter Accredited laboratory ISO/IEC 17025 and ISO/IEC 17034).

4.4 Buffer Solution No. 3.4 traceable to CPA chem (BIM RefN HI-27 LotN 04.06.2021 ; BIM RefN HI-28 LotN 28.05.2021 ; BIM RefN HI-27 LotN 04.06.2021 ; BIM RefN HI-28 LotN 28.05.2021 Accredited laboratory ISO/IEC 17025 and ISO/IEC 17034).

5. This result of calibration was found accurate as shown on date and place of calibration only.

6. Condition of calibration item : Normal

Calibrated by Mr.Anupong Lakawin
Scientist

Approved by (Ms. Pawana Pan-on)
Signed for Director

Issue date 03 February 2023

The uncertainties are for a confidence probability of approximately 95%
The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only

COPY

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC)

REPORT OF CALIBRATION

Certificate No. : 23-011524

Sample Code : 23-04833-001

Equipment	:	pH Meter	Resolution	:	0.01 pH ; 0.1 mV ; 0.1°C
Manufacturer	:	METTLER TOLEDO	Model	:	SevenCompact S220
Serial No.	:	B448305208	ID No.	:	LABE 11/4
Range	:	-2.000 pH to 20.000 pH ; ± 2000.0 mV ; -5.0°C to 130.0°C			

Results of Calibration

Part 1. DC Voltage measurement

pH Meter Serial No. : B448305208

Nominal Value	Applied DC Voltage	Average indicator reading		Uncertainty	Coverage factor
pH	mV	mV	pH	mV	*k*
0	414.113	414.0	0.00	± 0.083	2.00
4	177.477	177.5	4.00	± 0.083	2.00
7	0.000	0.1	7.00	± 0.083	2.00
10	-177.477	-178.3	10.00	± 0.083	2.00
14	-414.113	-413.8	14.00	± 0.083	2.00

Part 2. Performance of Electrode system

Electrode Manufacturer : METTLER TOLEDO Model : InLab Expert Pro-ISM

Electrode Serial No. : 2365921

Three-Point Calibration at pH4 and pH7 Percent Slope : 99.6 , at pH7 and pH10 Percent Slope : 98.4

Standard Buffer Solution	Average indicator reading		Error Value	Uncertainty	Coverage factor
pH (@ 25 °C)	pH	mV	pH	pH	*k*
4.008	4.01	184.2	0.002	± 0.011	2.00
6.985	6.99	8.9	0.005	± 0.010	2.00
10.008	10.01	-166.8	0.002	± 0.010	2.00

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k* which for a normal distribution corresponds to a coverage probability of approximately 95% The standard uncertainty of measurement has been determined in accordance with UKAS M3003

COPY

REPORT OF CALIBRATION

Certificate No. : 23-011524

Sample Code : 23-04833-001

Equipment	: pH Meter (Digital Thermometer with sensor)		
Thermometer readout			
Manufacturer	: METTLER TOLEDO	Model	: SevenCompact S220
Serial No.	: B448305208	ID No.	: LABE 11/4
Resolution	: 0.1 °C	Range	: -5.0 °C to 130.0 °C
Thermometer sensor			
Manufacturer	: METTLER TOLEDO	Model	: InLab Expert Pro-ISM
Serial No.	: 2365921	ID No.	: N/A

Condition of Calibration

1. Environment
   - 1.1 Ambient temperature : 23.0 °C ± 3.0 °C
   - 1.2 Relative humidity : 55.0 % ± 15.0 %
2. Calibration method
   - 2.1 The calibration use in house method WI-CL-021 : by comparison with standard thermometer
   - 2.2 The calibration by comparison unit under calibration (*UUC*) to the standard thermometer in a calibration bath at the controlled temperature.
   - 2.3 The temperature scale in use of this laboratory is the international temperature scale of 1990 (ITS-90).
3. Reference standard instrument

Instrument	Model	ID. No.	Certificate No.	Due date
3.1 Platinum Resistance Thermometer	PT-100	RTD-90	22-107027	02 October 2023
3.2 Thermometer Readout	GT-11	LB-TH-33	22-107027	02 October 2023

4. This certificate is traceable to the international system of unit (SI Unit).
   Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (Accreditation Under TLAS Laboratory Calibration No.0152)
5. This result of calibration was found accurate as shown on date and place of calibration only.
6. Condition of Calibration item : Normal

Results of Calibration

Calibration point °C	Average of standard reading °C	Unit under calibration			Expanded uncertainty °C	Coverage factor *k*
		Immersion depth mm	Average reading °C	Correction value °C		
25	25.002	120	25.0	+ 0.002	± 0.13	2.00

Notes

- Calibration results without adjustment

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M:3003

- End of report -

COPY

pH Meter

Model : SevenCompact S220

Serial No. : B448305208

CERTIFICATE OF CALIBRATION

Supersede to Calibration Certificate No. 24-001949

Certificate No. : 24-001949/1

Sample Code : 24-00963-006

Customer	:	EASTERN THAI CONSULTING 1992 CO., LTD. 683 Moo 11, Sukhapibarn 8 Rd., Nongkham, Sriracha, Chonburi 20230			
Location of Calibration	:	EASTERN THAI CONSULTING 1992 CO., LTD. (Laboratory)			
Equipment	:	pH Meter			
Manufacturer	:	METTLER TOLEDO	Model	:	SevenCompact S220
Serial No.	:	B448305208	ID No.	:	LABE 11/4
Date of Receipt	:	*09 January 2024*	Date of Calibration	:	*09 January 2024*

Condition of Calibration

1. Environment

   1.1 Ambient temperature : 22.4 ± 0.2 °C 1.2 Relative humidity : 56.4 % ± 2.1 %

2. Calibration method

   In house method WI-CL-019: based on direct measurement by using standard voltage calibrator and using certified reference material (CRM).

3. Reference standard / Certified reference material

Instrument	ID No.	Certificate No.	Due Date
3.1 Voltage Calibrator	LB-AMC-01	23E3244	03 October 2024
3.2 Digital Thermometer	LB-TH-33	23-098974	25 August 2024
Certified Reference Material	**Lot. No.**	**Ref No.**	**Expire Date**
3.3 Buffer Solution pH 4.008	919273	PH216.L5	24 September 2025
3.4 Buffer Solution pH 6.986	941727	PH107.L5	06 November 2024
3.5 Buffer Solution pH 9.997	919278	PH220.L5	24 September 2024

4. This certificate is traceable to the international system of unit (SI Unit).

   4.1 Instrument No. 3.1 through Technology Promotion Association (Thailand-Japan).

   4.2 Instrument No. 3.2 through Asia Medical and Agricultural Laboratory and Research Center Public Company Limited.

   4.3 Buffer Solution No. 3.3 and No. 3.5 traceable to CPA chem (through primary measurement method-Harned cell using calibrated thermometer, barometer, and nanovoltmeter Accredited laboratory ISO/IEC 17025 and ISO/IEC 17034).

   4.4 Buffer Solution No. 3.4 traceable to CPA chem (CPA RefN HARNED CELL LotN 61275737; CPA RefN HARNED CELL LotN 61273986 Accredited laboratory ISO/IEC 17025 and ISO/IEC 17034).

5. This result of calibration was found accurate as shown on date and place of calibration only.

6. Condition of calibration item : Normal

Calibrated by Mr. Nuttaput Timula
Scientist

Approved by (Mr. Somchai Neampunt)
Signed for Director

Issue date 31 January 2024

The uncertainties are for a confidence probability of approximately 95%.
The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only

COPY

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC)

REPORT OF CALIBRATION

Supersede to Calibration Certificate No. 24-001949

Certificate No. : 24-001949/1

Sample Code : 24-00963-006

Equipment	:	pH Meter	Resolution	:	0.01 pH ; 0.1 mV ; 0.1 °C
Manufacturer	:	METTLER TOLEDO	Model	:	SevenCompact S220
Serial No.	:	B448305208	ID No.	:	LABE 11/4
Range	:	-2.000 pH to 20.000 pH ; ± 2000.0 mV ; -5.0°C to 130.0°C			

Results of Calibration

Part 1. DC Voltage measurement

pH Meter Serial No. : B448305208

Nominal Value	Applied DC Voltage	Average indicator reading		Uncertainty	Coverage factor
pH	mV	mV	pH	mV	*k*
0	414.113	413.9	0.00	± 0.083	2.00
4	177.477	177.4	4.00	± 0.083	2.00
7	0.000	0.1	7.00	± 0.083	2.00
10	-177.477	-177.3	10.00	± 0.083	2.00
14	-414.113	-413.8	14.00	± 0.083	2.00

Part 2. Performance of Electrode system

Electrode Manufacturer : METTLER TOLEDO Model : InLab Expert Pro-ISM

Electrode Serial No. : 2453982

Three-Point Calibration at pH4, pH7 and pH10 Percent Slope : 98.3

Standard Buffer Solution	Average indicator reading		Error Value	Uncertainty	Coverage factor
pH (@ 25 °C)	pH	mV	pH	pH	*k*
4.008	4.01	182.1	0.002	± 0.010	2.00
6.986	7.00	7.8	0.014	± 0.011	2.00
9.997	10.01	-167.2	0.013	± 0.011	2.00

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003.

COPY

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

REPORT OF CALIBRATION

Supersede to Calibration Certificate No. 24-001949

Certificate No. : 24-001949/1

Sample Code : 24-00963-006

Equipment : pH Meter (Digital Thermometer with sensor)

Thermometer readout

Manufacturer	: METTLER TOLEDO	**Model**	: SevenCompact S220
Serial No.	: B448305208	**ID No.**	: LABE 11/4
Resolution	: 0.1 °C	**Range**	: -5.0 °C to 130.0 °C

Thermometer sensor

Manufacturer	: METTLER TOLEDO	**Model**	: InLab Expert Pro-ISM
Serial No.	: 2453982	**ID No.**	: N/A

Condition of Calibration

1. **Environment**
   - 1.1 Ambient temperature : 22.6 °C ± 0.1 °C
   - 1.2 Relative humidity : 55.1 % ± 3.3 %
2. **Calibration method**
   - 2.1 The calibration use in house method WI-CL-021 : by comparison with standard thermometer
   - 2.2 The calibration by comparison unit under calibration (*UUC*) to the standard thermometer in a calibration bath at the controlled temperature.
   - 2.3 The temperature scale in use of this laboratory is the international temperature scale of 1990 (ITS-90).
3. **Reference standard instrument**

Instrument	Model	ID. No.	Certificate No.	Due date
3.1 Resistance Thermometer	PT-100	RTD-90	23-098974	25 August 2024
3.2 Thermometer Readout	GT-11	LB-TH-33	23-098974	25 August 2024

4. **This certificate is traceable to the international system of unit (SI Unit).**
   Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (Accreditation Under TLAS Laboratory Calibration No.0152)
5. **This result of calibration was found accurate as shown on date and place of calibration only.**
6. **Condition of Calibration item** : Normal

Results of Calibration

Calibration point °C	Average of standard reading °C	Unit under calibration			Expanded uncertainty °C	Coverage factor *k*
		Immersion depth mm	Average reading °C	Correction value °C		
25	25.000	120	25.0	0.000	± 0.14	2.00

Notes

- Calibration results without adjustment

The result expanded uncertainty of measurement *U* is stated as the standard uncertainty of measurement multiplied by the coverage factor *k*, which for a normal distribution corresponds to a coverage probability of approximately 95% The standard uncertainty of measurement has been determined in accordance with UKAS M3003

- End of report -

COPY

STANDARD WEIGHT 50 g

Certificate No. : 22-052238

Sample Code : 22-19150-003

CERTIFICATE OF CALIBRATION

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapiban 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : Asia Medical and Agricultural Laboratory and Research Center Public Company Limited
(Calibration Laboratory)

Equipment : Standard Weight 50 g

Manufacturer : METTLER TOLEDO

Class : F1

Serial No. : N/A

ID No. : LABE 10/1

Date of Receipt : 18 May 2022

Date of Calibration : 30 May 2022

Calibrated by : Mr. Somwang Sangdee
Scientist

Approved by : (Mr. Somchai Neampunt)
Signed for Director

Issue date : 31 May 2022

COPY

The uncertainties are for a confidence probability of approximately 95%.

The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

NSC-TISI-TIS17025
CALIBRATION 0152

Certificate No. : 22-052238

Sample Code : 22-19150-003

REPORT OF CALIBRATION

Equipment : Standard Weight 50 g

Manufacturer : METTLER TOLEDO

Class F1

Serial No. : N/A

ID No. : LABE 10/1

Result of Calibration : ◉ Without adjustment ○ Adjustment

Conventional value of the result of weighing in air. For a weight taken at a reference temperature (t_{ref}) of 20°C, the conventional mass is the mass of a reference weight of a density (ρ_{ref}) of 8000 kg.m^{-3} which it balances in air of a reference density (ρ_0) of 1.2 kg.m^{-3}

Description	Deviation (mg)	Conventional Mass	Expanded Uncertainty (mg)	Maximum Permissible Error ± (mg)	ID No.
50 g	-0.324	49.999676 g	0.10	0.30	LABE 10/1

The result expanded uncertainty of measurement U is stated as the standard uncertainty of measurement multiplied by the coverage factor $k = 2.0$, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003

COPY

Certificate No. : 22-052238

Sample Code : 22-19150-003

REPORT OF CALIBRATION

Condition of Calibration

1. Ambient Conditions : Temperature 20 °C ± 1.5°C, Relative humidity 50% ± 10% and air density 1.20 kg/m^3

2. Calibration Method : Direct comparison weighing according to OIML R111-1 : 2004(E)

3. Reference standard instrument

Instrument	Class	ID No.	Certificate No.	Due Date
1) Standard Weight 1 mg to 1 kg	E2	LB-WE-79	21-079366	22 September 2022

4. This certification is traceable to the International System of Unit maintained at : -

Asia Medical and Agricultural Laboratory and Research Center Public Company Limited

(Instrument number 1).

5. Condition of Calibration item: Normal

6. Description of Calibrated Item :	
Type and Nominal Value :	Standard Weight 50 g
Shape :	Cylindrical weight with knob
Material :	Stainless steel
Case :	Wooden Box
Comments :	Recalibration

- End of Report -

COPY

STANDARD WEIGHT 100 g

Certificate No. : 22-052239
Sample Code : 22-19150-004

CERTIFICATE OF CALIBRATION

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapiban 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : Asia Medical and Agricultural Laboratory and Research Center Public Company Limited
(Calibration Laboratory)

Equipment : Standard Weight 100 g

Manufacturer : N/A

Class : N/A

Serial No. : N/A

ID No. : LABE 10/2

Date of Receipt : 18 May 2022

Date of Calibration : 30 May 2022

Calibrated by : Mr. Somwang Sangdee
Scientist

Approved by : (Mr. Somchai Neampunt)
Signed for Director

Issue date : 31 May 2022

COPY

The uncertainties are for a confidence probability of approximately 95%.

The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

Certificate No. : 22-052239
Sample Code : 22-19150-004

REPORT OF CALIBRATION

Equipment : Standard Weight 100 g

Manufacturer : N/A

Class N/A

Serial No. : N/A

ID No. : LABE 10/2

Result of Calibration : ◉ Without adjustment ○ Adjustment

Conventional value of the result of weighing in air. For a weight taken at a reference temperature (t_{ref}) of 20°C, the conventional mass is the mass of a reference weight of a density (ρ_{ref}) of 8000 kg.m^{-3} which it balances in air of a reference density (ρ_0) of 1.2 kg.m^{-3}

Description	Deviation (mg)	Conventional Mass	Expanded Uncertainty (mg)	Maximum Permissible Error ± (mg)	ID No.
100 g	-0.171	99.999829 g	0.16	0.50	LABE 10/2

The result expanded uncertainty of measurement U is stated as the standard uncertainty of measurement multiplied by the coverage factor $k = 2.0$, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003

COPY

Certificate No. : 22-052239

Sample Code : 22-19150-004

REPORT OF CALIBRATION

Condition of Calibration

1. Ambient Conditions : Temperature 20 °C ± 1.5°C, Relative humidity 50% ± 10% and air density 1.18 kg/m^3

2. Calibration Method : WI-CL-007 base on OIML R 111-1 : 2004(E)

3. Reference standard instrument

Instrument	Class	ID No.	Certificate No.	Due Date
1) Standard Weight 1 mg to 1 kg	E2	LB-WE-79	21-079366	22 September 2022

4. This certification is traceable to the International System of Unit maintained at : -

Asia Medical and Agricultural Laboratory and Research Center Public Company Limited

(Instrument number 1).

5. Condition of Calibration item: Normal

6. Description of Calibrated Item :	
Type and Nominal Value :	Standard Weight 100 g
Shape :	Cylindrical weight with knob
Material :	Stainless steel
Case :	Wooden Box
Comments :	Recalibration

- End of Report -

COPY

STANDARD WEIGHT 50 g

Certificate No. : 22-052237

Sample Code : 22-19150-002

CERTIFICATE OF CALIBRATION

Customer : EASTERN THAI CONSULTING 1992 CO., LTD.
683 Moo 11, Sukhapiban 8 Rd., Nongkham,
Sriracha, Chonburi 20230

Location of Calibration : Asia Medical and Agricultural Laboratory and Research Center Public Company Limited
(Calibration Laboratory)

Equipment : Standard Weight 50 g

Manufacturer : N/A

Class : N/A

Serial No. : N/A

ID No. : LABE 10/4

Date of Receipt : 18 May 2022

Date of Calibration : 30 May 2022

Calibrated by Mr. Somwang Sangdee
Scientist

Approved by (Mr. Somchai Neampunt)
Signed for Director

Issue date 31 May 2022

COPY

The uncertainties are for a confidence probability of approximately 95%.

The calibration result is applied only to the above calibrated item and was found accurate as shown on date and place of calibration only.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the unit of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the Asia Medical and Agricultural Laboratory and Research Center Public Company Limited (AMARC).

AMARC | ASIA MEDICAL AND AGRICULTURAL LABORATORY AND RESEARCH CENTER

ilac-MRA THAILAND NSC-TISI-TIS17025 CALIBRATION 0152

Certificate No. : 22-052237

Sample Code : 22-19150-002

REPORT OF CALIBRATION

Equipment : Standard Weight 50 g

Manufacturer : N/A

Class N/A

Serial No. : N/A

ID No. : LABE 10/4

Result of Calibration : ◉ Without adjustment ○ Adjustment

Conventional value of the result of weighing in air. For a weight taken at a reference temperature (t_{ref}) of 20°C, the conventional mass is the mass of a reference weight of a density (ρ_{ref}) of 8000 kg.m^{-3} which it balances in air of a reference density (ρ_0) of 1.2 kg.m^{-3}

Description	Deviation (mg)	Conventional Mass	Expanded Uncertainty (mg)	Maximum Permissible Error ± (mg)	ID No.
50 g	-0.111	49.999889 g	0.10	0.30	LABE 10/4

The result expanded uncertainty of measurement U is stated as the standard uncertainty of measurement multiplied by the coverage factor $k = 2.0$, which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty of measurement has been determined in accordance with UKAS M3003

COPY

Certificate No. : 22-052237

Sample Code : 22-19150-002

REPORT OF CALIBRATION

Condition of Calibration

1. Ambient Conditions : Temperature 20 °C ± 1.5°C, Relative humidity 50% ± 10% and air density 1.18 kg/m^3

2. Calibration Method : WI-CL-007 base on OIML R 111-1 : 2004(E)

3. Reference standard instrument

Instrument	Class	ID No.	Certificate No.	Due Date
1) Standard Weight 1 mg to 1 kg	E2	LB-WE-79	21-079366	22 September 2022

4. This certification is traceable to the International System of Unit maintained at : -

Asia Medical and Agricultural Laboratory and Research Center Public Company Limited

(Instrument number 1).

5. Condition of Calibration item: Normal

6. Description of Calibrated Item :	
Type and Nominal Value :	Standard Weight 50 g
Shape :	Cylindrical weight with knob
Material :	Stainless steel
Case :	Wooden Box
Comments :	Recalibration

- End of Report -

COPY

บริษัท อีสเทิร์น ไทย คอนซัลติ้ง 1992 จำกัด
สวนอุตสาหกรรมเครือสหพัฒน์ (ศรีราชา) 683 หมู่ 11 ถนนสุขาภิบาล 8
ตำบลหนองขาม อำเภอศรีราชา จังหวัดชลบุรี 20230