

ภาคผนวก ข.1

---

ระเบียบปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา





คำร้องขอดำเนินการด้านเอกสาร

DOCUMENT ACTION REQUEST (DAR)

DAR NO.

67/213

หมายเลขเอกสารเดิม

PD-SE-007, Rev.05

หมายเลขเอกสารใหม่

PD-SE-007, Rev.06

ชื่อเอกสารเดิม

การควบคุมผู้รับเหมา

ชื่อเอกสารใหม่

การควบคุมผู้รับเหมา

วัตถุประสงค์/เหตุผล

ขอแก้ไขเอกสารปรับปรุงเนื้อหาให้สอดคล้องกับการปฏิบัติงาน ABPR1-5

ประเภทเอกสาร

☐

คู่มือบริหารระบบ

☒

ระเบียบปฏิบัติงาน

☐

วิธีปฏิบัติงาน

☐

เอกสารสนับสนุน

☐

แบบบันทึก

☐

อื่น ๆ \_\_\_\_\_

ประเภทการขอเปลี่ยนแปลงเอกสาร

☐

ขอแก้ไขเอกสารในระบบ

☒

ขอเอกสารแก้ไข

☐

ขอทำลายเอกสาร

☐

ขอเอกสารสำเนาเพิ่มเติม จำนวน \_\_\_\_ ชุด

☐

ขอยกเลิกเอกสาร

☐

อื่น ๆ \_\_\_\_\_



รายละเอียดการขอเปลี่ยนแปลง

แก้ไข Work Flow Diagram ให้สอดคล้องกับการปฏิบัติ แก้ไขรายการเอกสารที่เกี่ยวข้อง และแก้ไข

รายละเอียดการควบคุมบันทึก

ผู้ขอ / ผู้จัดทำ	การพิจารณาทบทวน
ลงนาม ตำแหน่ง วันที่	
อนุมัติมีผลบังคับใช้วันที่ ลงนาม ตำแหน่ง	




		<b>AMATA B.GRIMM POWER (RAYONG) LIMITED</b>		<b>Doc. No. PD-SE-007</b>	
Document Owner:		Revision:		Document Type:	
Safety and Environment		06		Procedure	
Status:		<b>DAR No. 67/213</b>			
Prepared by:					
Ratchaneekorn Sakornnoi					
Date : 13/06/2024					
Valid for:		<b>ABPR1, ABPR2, ABPR3, ABPR4, ABPR5</b>			
This is computer generated signature and approve online.					

ระเบียบปฏิบัติงาน

เรื่อง การควบคุมผู้รับเหมา (Contractor Control)




	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 2 Doc. No. PD-SE-007
---	-----------------	---	----------------------------------

## ประวัติการแก้ไขเอกสาร

แก้ไขครั้งที่	วันที่เริ่มใช้	คำอธิบาย	DAR เลขที่	ตรวจสอบ	อนุมัติ
00	29/10/2557	การควบคุมผู้รับเหมา	57/108		
01	12/02/2559	แก้ไขข้อมูลเพื่อให้เหมาะสมกับการปฏิบัติงานจริง	59/081		
02	03/04/2562	ขยายขอบเขตครอบคลุม ABPR1-5	62/170		
03	14/04/2563	ขอแก้ไขเอกสารปรับปรุงเนื้อหาให้สอดคล้องกับการปฏิบัติงาน ABPR1-5	63/142		
04	27/09/2564	แก้ไขปรับปรุงเอกสารให้สอดคล้องกับการปฏิบัติงานใน ABPR1-5 ในปัจจุบัน	64/302		
05	16/05/2567	ขอแก้ไขเอกสารปรับปรุงเนื้อหาให้สอดคล้องกับการปฏิบัติงาน ABPR1-5	67/186		
06	17/06/2567	แก้ไข Work Flow Diagram ให้สอดคล้องกับการปฏิบัติ แก้ไขรายการเอกสารที่เกี่ยวข้อง และแก้ไขรายละเอียดการควบคุมบันทึก	67/213		




	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 3 <b>Doc. No. PD-SE-007</b>
---	-----------------	---	---

## สารบัญ

หน้า

1	วัตถุประสงค์.....	4
2	ขอบเขต .....	4
3	นิยาม.....	4
4	เอกสารที่เกี่ยวข้อง .....	5
5	รายละเอียดการดำเนินงาน.....	5
6.	ผังกระบวนการ .....	8
7.	การควบคุมบันทึก.....	11
8.	เอกสารแนบท้าย.....	11



	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 4 <b>Doc. No. PD-SE-007</b>
---	-----------------	---	---

## 1 วัตถุประสงค์

เพื่อเป็นแนวทางในการควบคุมการปฏิบัติงานของผู้รับเหมาจากหน่วยงานภายนอกในการป้องกันควบคุม ผลกระทบ ด้านสิ่งแวดล้อม อุบัติเหตุ ความเสี่ยงด้านอาชีวอนามัย ความปลอดภัย และความต่อเนื่องทางธุรกิจจากกิจกรรมที่ปฏิบัติ ให้สอดคล้องตามข้อกำหนดที่เกี่ยวข้องกับระบบการจัดการตามมาตรฐานสากลที่องค์กรประยุกต์ใช้ และความเสี่ยงอันเกิดจากการปฏิบัติงานของผู้รับเหมา

## 2 ขอบเขต

เอกสารระเบียบปฏิบัติงานนี้ใช้สำหรับการควบคุมการปฏิบัติของผู้รับเหมาจากหน่วยงานภายนอกที่เข้ามาปฏิบัติงาน ให้กับกลุ่มโรงไฟฟ้า อมตะ บี. กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยองเท่านั้น

## 3 นิยาม

3.1 พนักงานโรงไฟฟ้า (Staff of Amata B.Grimm Power Rayong ) หมายถึง พนักงานของโรงไฟฟ้าอมตะ บี.กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยอง

3.2 เจ้าของงาน/ ผู้ควบคุมงาน (Project Owner) หมายถึง พนักงานของโรงไฟฟ้าอมตะ บี. กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยอง ที่ดูแลรับผิดชอบที่ได้รับมอบหมาย ที่มีหน้าที่ในการดูแลการปฏิบัติงานของผู้รับเหมาหรือผู้รับเหมาช่วงให้ปฏิบัติตาม นโยบายสิ่งแวดล้อม ความปลอดภัย อาชีวอนามัย และความต่อเนื่องทางธุรกิจ

3.3 เจ้าหน้าที่ความปลอดภัยฯ (Safety & Environmen Officer) หมายถึง พนักงานของโรงไฟฟ้าอมตะ บี. กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยอง มีหน้าที่ในการอบรม ตรวจสอบผู้รับเหมาหรือผู้รับเหมาช่วงที่เข้ามาทำงานภายในโรงไฟฟ้า


3.4 หัวหน้าส่วนงานปฏิบัติการงานกะ (Operation Section Manager : OSM) หมายถึง พนักงานของโรงไฟฟ้าอมตะ บี. กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยอง ที่เป็นผู้ที่ได้รับมอบหมายให้เป็นผู้อนุญาตในการทำงาน และเป็นผู้ที่ได้รับมอบหมายให้สามารถดำเนินการอบรมผู้รับเหมาหรือผู้รับเหมาช่วง ในกรณีที่เจ้าหน้าที่ความปลอดภัยฯ ไม่สามารถปฏิบัติหน้าที่ได้

3.5 ผู้รับเหมา (**Contractor**) หมายถึง ผู้รับเหมา หรือผู้รับเหมาช่วงซึ่งเป็นบุคคลหรือนิติบุคคลจากภายนอกที่เข้ามาติดต่อเพื่อทำงานหรือโครงการภายในบริษัท โดยมีเจ้าหน้าที่ของกลุ่มโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ ในนิคมอุตสาหกรรม .อมตะซิตี้ระยองเป็นผู้ดูแล

3.6 หัวหน้างาน/ผู้ควบคุมงานของผู้รับเหมา (Foreman) หมายถึง หัวหน้างานหรือผู้ควบคุมงานของผู้รับเหมาที่มีหน้าที่ในการควบคุมงานผู้ปฏิบัติงานของผู้รับเหมาให้ปฏิบัติตามกฎระเบียบของโรงไฟฟ้าซึ่งปฏิบัติงานอยู่ในเขตพื้นที่ความรับผิดชอบของกลุ่มโรงไฟฟ้า อมตะ บี. กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยอง

3.7 การอบรมด้านความปลอดภัยและสิ่งแวดล้อม หมายถึง การอบรมด้านความปลอดภัยและสิ่งแวดล้อมแก่ผู้รับเหมา ก่อนเข้าปฏิบัติงานในโรงไฟฟ้า โดยเจ้าหน้าที่ความปลอดภัยฯ หรือผู้ที่ได้รับมอบหมาย



	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 5 <b>Doc. No. PD-SE-007</b>
---	-----------------	---	---

3.8 ระบบการจัดการตามมาตรฐานสากลที่องค์กรประยุกต์ใช้ หมายถึง ระบบการจัดการทางด้านสิ่งแวดล้อม อาชีวอนามัย และความปลอดภัย / ระบบการบริหารความต่อเนื่องทางธุรกิจ


#### 4 เอกสารที่เกี่ยวข้อง

- 4.1 PD-SE-012 ระเบียบปฏิบัติ เรื่อง การขออนุญาตทำงาน
- 4.2 PD-PC-001 ระเบียบปฏิบัติ เรื่อง การจัดซื้อจัดจ้าง
- 4.3 PD-SE-014 Security Control
- 4.4 SU-SE-032 แนวทางคู่มือในการปฏิบัติงานในพื้นที่โรงไฟฟ้า กลุ่ม บริษัท บี.กริม เพาเวอร์
- 4.5 SU-SE-053 ข้อกำหนดมาตรฐานด้านความปลอดภัยอาชีวอนามัยและสิ่งแวดล้อม สำหรับงานจัดซื้อ-จัดจ้าง
- 4.6 FM-SE-013 แบบการชี้บ่งอันตรายและการประเมินความเสี่ยงด้วยวิธี (Job Safety & Environment Analysis: JSEA)
- 4.7 FM-SE-064 แบบทดสอบการอบรมความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม และหนังสือยินยอม PDPA
- 4.8 FM-SE-015 แบบบันทึกการอบรม
- 4.9 FM-SE-014 บันทึกเวลาผู้รับเหมา
- 4.10 FM-SE-065 Contractor Specific Skill Form

#### 5 รายละเอียดการดำเนินงาน

- 5.1) การจัดจ้างผู้รับเหมาที่ทางสำนักงานใหญ่เป็นผู้ทำการคัดเลือก ก่อนการเริ่มงานจะกำหนดให้มีการประชุมก่อนการเริ่มงาน (Kick- Off Meeting) ระหว่างเจ้าของงาน/ผู้ควบคุมงาน (Project Owner), เจ้าหน้าที่ความปลอดภัย (Safety Officer) และผู้เกี่ยวข้องก่อนการเริ่มปฏิบัติงาน
- 5.2) การจัดจ้างผู้รับเหมาโดยกลุ่ม โรงไฟฟ้า อมตะ บี. กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยอง เป็นผู้คัดเลือกให้ดำเนินการตั้งแต่ ข้อ 5.2.1 เป็นต้นไป
  - 5.2.1) เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) กำหนดขอบเขตของงานและรายละเอียดสำหรับจัดจ้างผู้รับเหมา
  - 5.2.2) เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) หรือ เจ้าหน้าที่จัดซื้อ (Purchasing) ส่งเอกสาร SU-SE-053 ข้อกำหนดมาตรฐานด้านความปลอดภัยอาชีวอนามัยและสิ่งแวดล้อม สำหรับงานจัดซื้อ-จัดจ้าง) ให้ผู้รับเหมาสำหรับการเสนอราคาการดำเนินการ
  - 5.2.3) ผู้รับเหมาเสนอราคาการดำเนินงานให้กับทางเจ้าของงาน/ผู้ควบคุมงาน (Project Owner) และเจ้าหน้าที่จัดซื้อ (Purchasing) โดยพิจารณาจากระดับความสามารถในการควบคุมผลกระทบด้านสิ่งแวดล้อม อันตรายและความเสี่ยงด้านอาชีวอนามัย ความปลอดภัย และความต่อเนื่องทางธุรกิจ จากกิจกรรมที่ปฏิบัติ ดังหัวข้อดังต่อไปนี้



	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 6 <b>Doc. No. PD-SE-007</b>
---	-----------------	---	---


- ก. มีมาตรการที่ชัดเจนในการควบคุมผลกระทบด้านสิ่งแวดล้อม อันตรายและความเสี่ยงด้านอาชีวอนามัยและความปลอดภัย และความต่อเนื่องทางธุรกิจ ได้แก่
- การจัดการของเสีย น้ำเสีย และเหตุรำคาญต่างๆ ที่เกิดขึ้นจากการปฏิบัติงาน (เสียง, ฝุ่น เป็นต้น)
  - การป้องกันการหกรั่วไหลของสารเคมี เช่น การจัดเตรียมภาชนะรองรับขณะสูบล้าง หรือจัดเก็บ รวมถึงการจัดเตรียมวัสดุดูดซับเพื่อรองรับกรณีที่มีการหกรั่วไหล เป็นต้น
  - การป้องกันผลกระทบที่อาจเกิดการหยุดชะงักของกระบวนการผลิตและจำหน่ายไฟฟ้า และไอน้ำ
- ข. การจัดเตรียมและใช้อุปกรณ์ PPE รวมถึงอุปกรณ์ป้องกันและระงับเหตุฉุกเฉิน เช่น ถังดับเพลิง เป็นต้น
- ค. สภาพความพร้อมใช้งานของเครื่องจักร และ อุปกรณ์ที่นำมาใช้งาน โดยต้องอยู่ในสภาพที่สมบูรณ์ มีความปลอดภัย และไม่มีการหกรั่วไหลของน้ำมัน รวมถึงไม่ก่อให้เกิดเหตุรำคาญต่างๆ
- ง. มีเครื่องมือ อุปกรณ์ มาตรฐานวิธีการปฏิบัติงานงาน และมีบุคลากรที่มีคุณสมบัติตามที่กฎหมายกำหนดสำหรับงานที่มีอันตรายและความเสี่ยงสูง ซึ่งถูกควบคุมด้วยข้อกำหนดของกฎหมายที่เกี่ยวข้อง
- จ. ผลงานเดิมที่ผ่านมา ได้แก่
- การปฏิบัติตามกฎระเบียบของบริษัทฯตามที่ได้มีการชี้แจง/ฝึกอบรมก่อนเริ่มปฏิบัติงาน
  - มีประวัติ/บันทึกการเกิดอุบัติเหตุ/เหตุการณ์ฉุกเฉินอันเนื่องมาจากการปฏิบัติงาน

5.2.4) หลังทำการคัดเลือกผู้รับเหมา เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ทำการแนบเอกสาร SU-SE-053 ข้อกำหนดมาตรฐานด้านความปลอดภัยอาชีวอนามัยและสิ่งแวดล้อม สำหรับงานจัดซื้อ-จัดจ้าง ตามข้อตกลงในระบบการขอซื้อ (Purchase Request)

### 5.3) ก่อนเริ่มปฏิบัติงาน

5.3.1) ผู้รับเหมา, เจ้าของงาน/ผู้ควบคุมงาน (Project Owner), เจ้าหน้าที่ความปลอดภัย ฯ (Safety Officer) และหัวหน้าส่วนงานปฏิบัติการงานกะ (OSM) ทำการวิเคราะห์อันตรายเพื่อความปลอดภัย และสิ่งแวดล้อม รวมถึงกระบวนการผลิต (Job Safety & Environment Analysis, JSEA) หรือประเมินความเสี่ยง พร้อมกับกำหนดมาตรการในการควบคุมความเสี่ยงด้านสิ่งแวดล้อม อาชีวอนามัยความปลอดภัยและป้องกันผลกระทบต่อกระบวนการผลิต



	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 7 <b>Doc. No. PD-SE-007</b>
---	-----------------	---	---

5.3.2) เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ประสานงานกับเจ้าหน้าที่ความปลอดภัยฯ (Safety Officer) วางแผนวันและเวลาการเข้าอบรมความปลอดภัยฯ การตรวจสอบอุปกรณ์ และวันเริ่มงาน

5.3.3) ผู้รับเหมาส่งแจ้งรายชื่อผู้ปฏิบัติงานพร้อมส่งเอกสารให้แก่เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ได้แก่ สำเนาบัตรประชาชนผู้รับเหมา, เอกสารที่เกี่ยวข้องกับงานตามกฎหมาย เช่น หลักฐานการผ่านการอบรม, หลักฐานการตรวจสอบเครื่องจักร เป็นต้น และเอกสารอื่นๆ ที่ทางโรงไฟฟ้าร้องขอ

5.3.4) เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ส่งเอกสารตามรายละเอียดข้อ 5.3.3 ให้แก่เจ้าหน้าที่ความปลอดภัยฯ (Safety Officer) พิจารณา ตรวจสอบเอกสาร พร้อมทำการสรุปลงในแบบฟอร์ม FM-SE-065 Contractor Specific Skill Form และดำเนินการอบรมผู้รับเหมาตามวันและเวลาที่วางแผน

5.3.5) ผู้รับเหมาผ่านเกณฑ์การอบรมด้านความปลอดภัยฯ ตามแบบฟอร์ม FM-SE-064 แบบทดสอบการอบรมความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม และหนังสือยินยอม PDPA ในระบบ Microsoft Form

5.3.6) การเข้า-ออกโรงไฟฟ้าเพื่อเข้าปฏิบัติงานของผู้รับเหมา รวมถึงการขออนุญาตนำของเข้า-ออกในโรงไฟฟ้า เป็นไปตามระเบียบปฏิบัติ PD-SE-014 Security Control (อุปกรณ์เครื่องมือ เครื่องจักรของผู้รับเหมาจะต้องได้รับการตรวจสอบโดยเจ้าหน้าที่ความปลอดภัย หรือหน่วยงานที่ได้รับอนุญาต)


5.3.7) เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ดำเนินการขออนุญาตการทำงาน (Permit to Work) ตามเอกสารวิธีปฏิบัติงาน PD-SE -012 “การขออนุญาตทำงาน”

#### 5.4) ระหว่างปฏิบัติงาน

5.4.1) ผู้รับเหมาต้องได้รับใบอนุญาตการทำงาน (Permit to Work) จากเจ้าของงาน/ผู้ควบคุมงาน (Project Owner) พร้อมนำใบอนุญาตการทำงานติดไว้ที่บริเวณพื้นที่ปฏิบัติงานให้เห็นชัดเจน หรือตามรูปแบบที่ทางโรงไฟฟ้ากำหนด

5.4.2) เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ดำเนินการตรวจสอบและประเมินผลการปฏิบัติงานของผู้รับเหมาในด้านการควบคุมผลกระทบต่อสิ่งแวดล้อม การควบคุมความเสี่ยงด้านอาชีวอนามัย ความปลอดภัย และความต่อเนื่องทางธุรกิจ รวมถึงการปฏิบัติตามกฎระเบียบของบริษัท เพื่อป้องกันไม่ให้เกิดเหตุการณ์ที่อาจก่อให้เกิดผลกระทบต่างๆเกิดขึ้น และเพื่อนำมาใช้เป็นข้อมูลในการประเมินผลการปฏิบัติงานของผู้รับเหมา




	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 8 <b>Doc. No. PD-SE-007</b>
---	-----------------	---	---

### 5.5) หลังเสร็จสิ้นการปฏิบัติงาน

5.5.1) ผู้รับเหมา (Contractor) ตรวจสอบบริเวณพื้นที่ปฏิบัติงานของตนเองให้อยู่ในสภาวะปกติ ก่อนทำการแจ้งเจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ให้ทำการขอปิด Permit to Work

5.5.2) เจ้าของงาน/ผู้ควบคุมงาน (Project Owner) ทำการประเมินผลการปฏิบัติงานของผู้รับเหมา และแจ้งผลการประเมินแก่เจ้าหน้าที่จัดซื้อ (Purchasing) เพื่อเป็นข้อมูลในการพิจารณาคัดเลือกผู้รับเหมาในครั้งถัดไป

## 6. ผังกระบวนการ

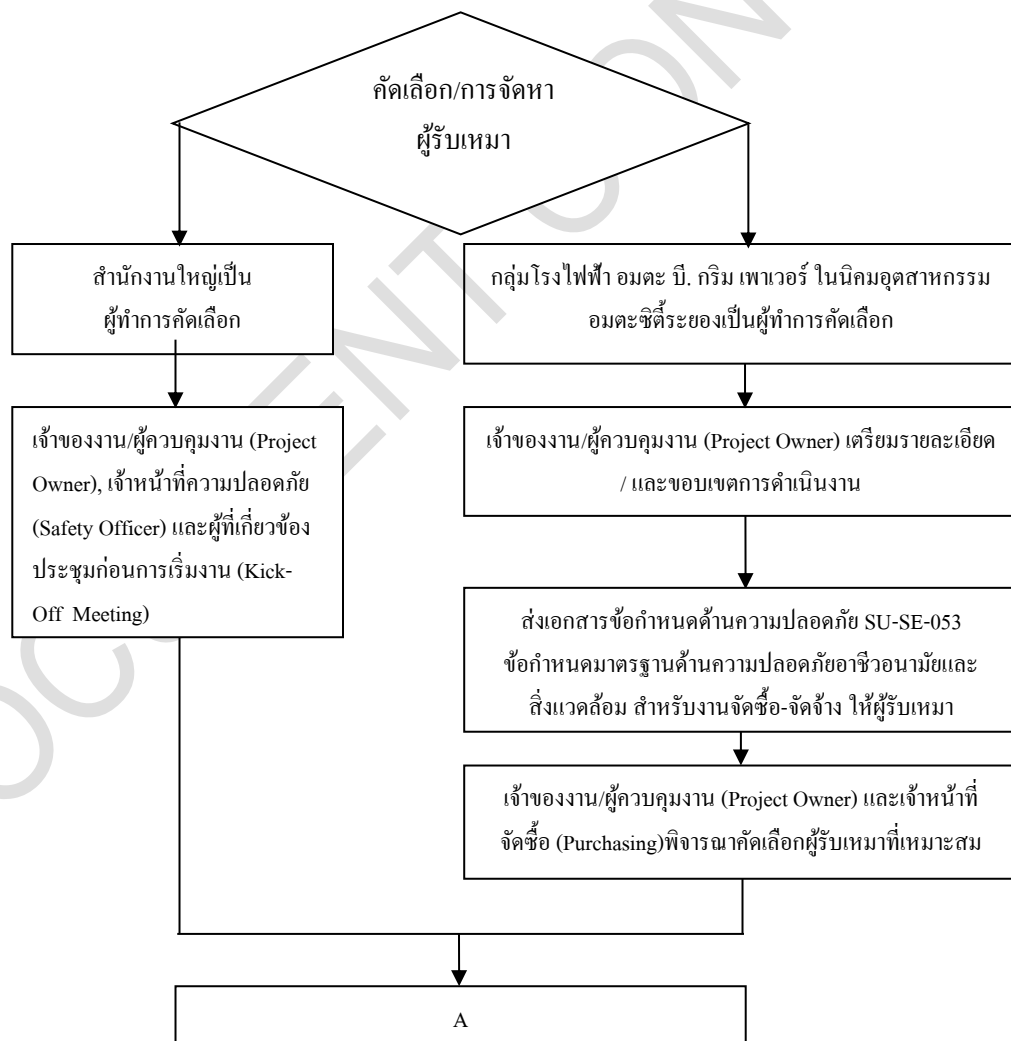





## หน่วยงาน/ผู้เกี่ยวข้อง


## ขั้นตอนการดำเนินการ

## เอกสารที่เกี่ยวข้อง

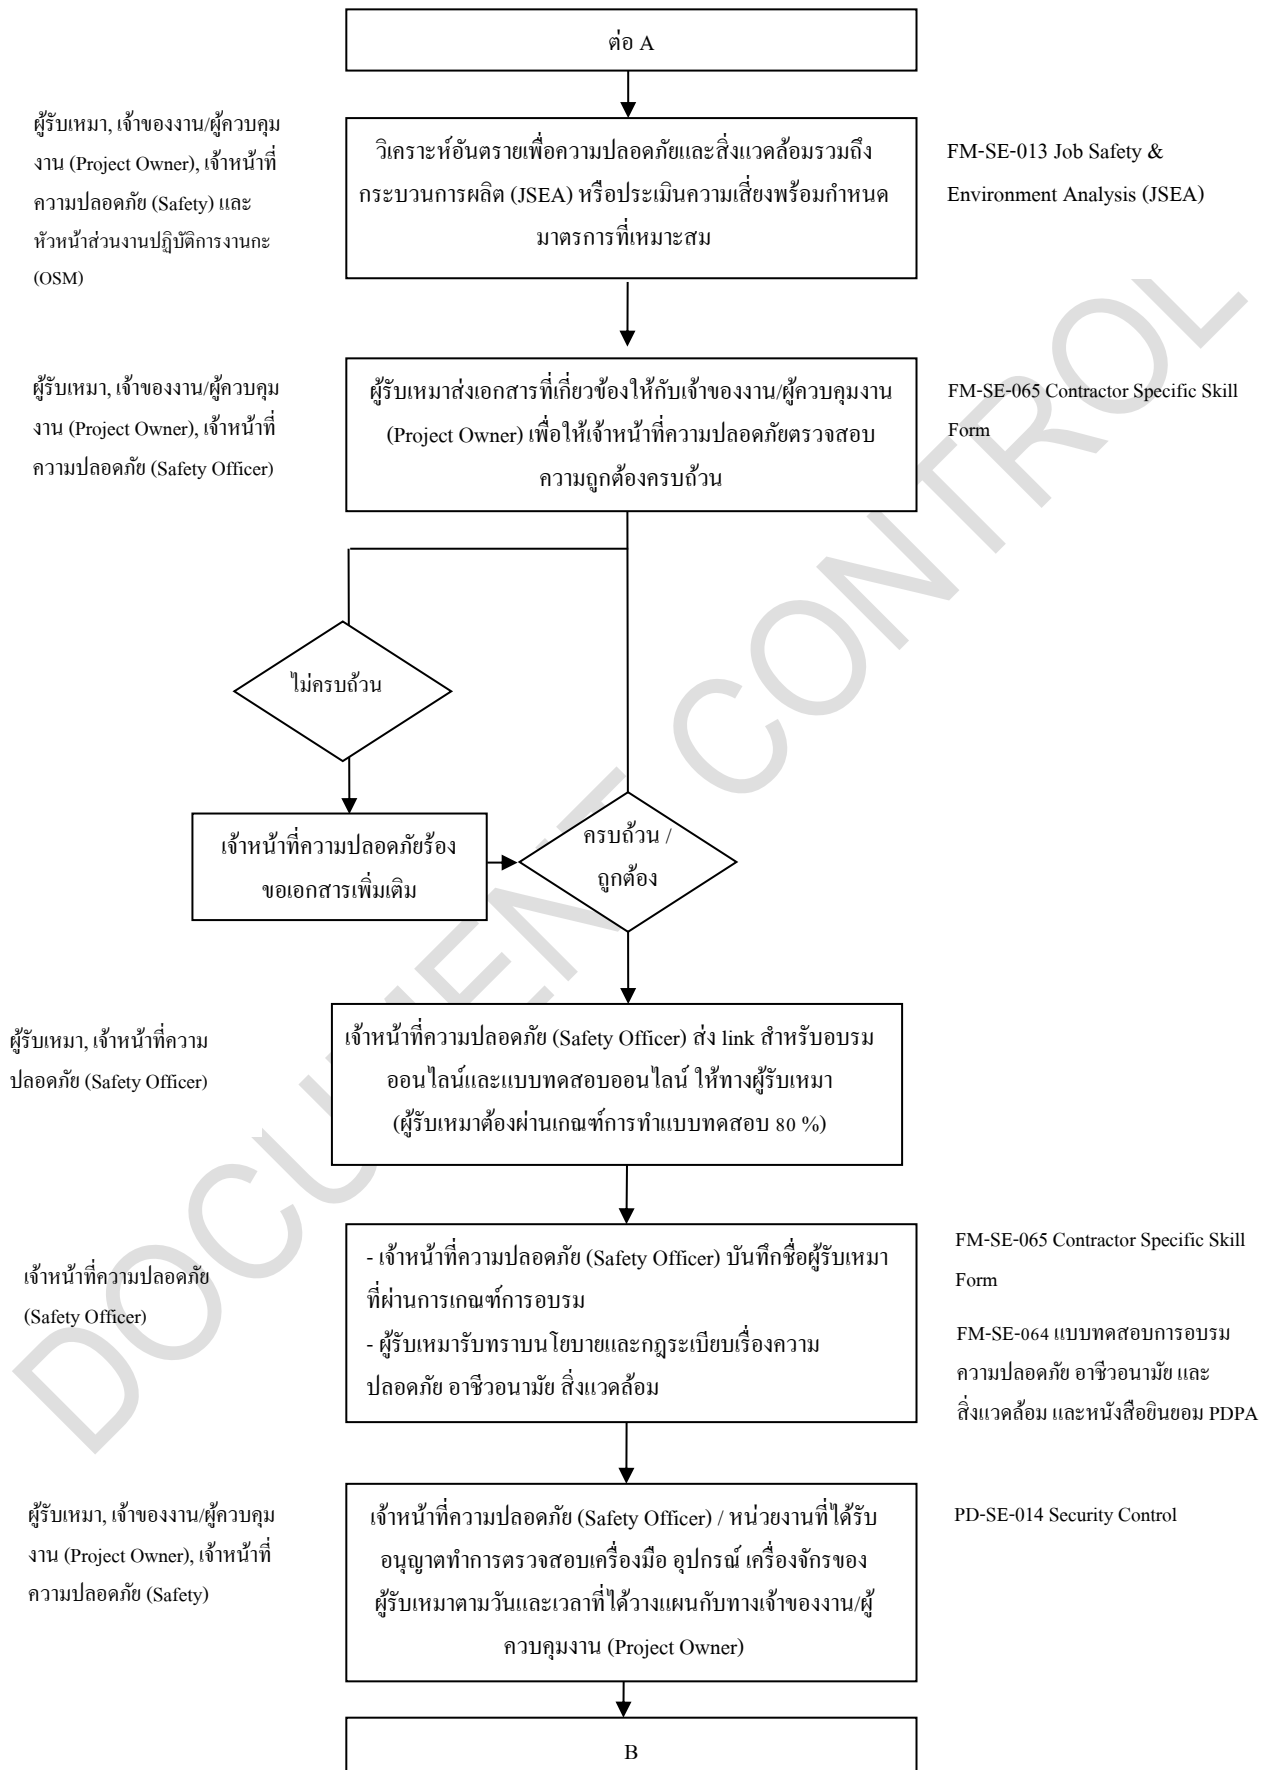




	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 10 Doc. No. PD-SE-007
---	--------------	--	--------------------------------

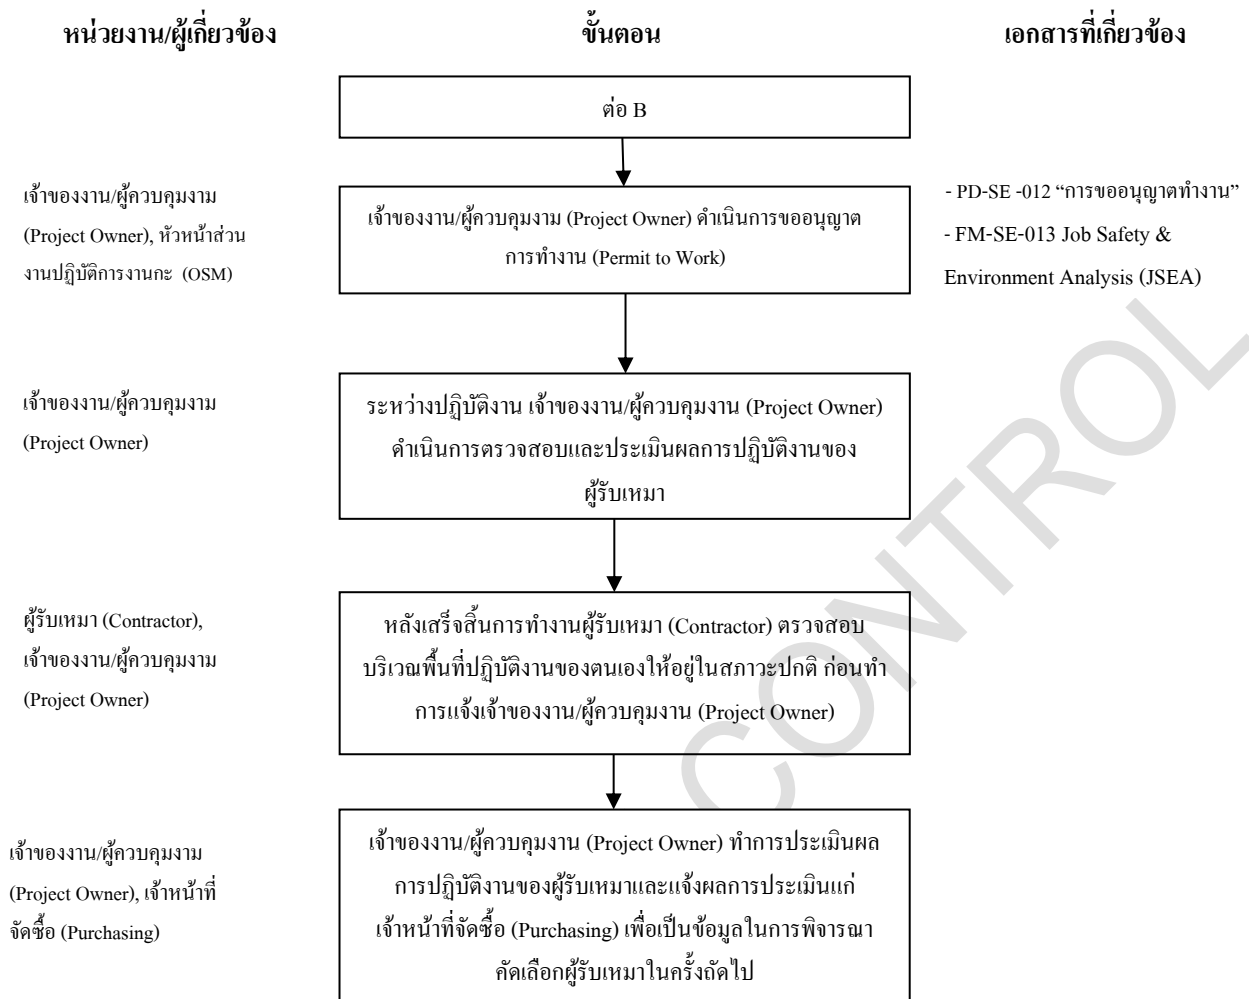



	Revision: 06	Title: วิธีปฏิบัติงาน เรื่อง การควบคุมผู้รับเหมา	Page: 11 <b>Doc. No. PD-SE-007</b>
---	-----------------	---	--

7. การควบคุมบันทึก

รหัสเอกสาร	ชื่อเอกสาร	ระยะเวลาจัดเก็บ	เจ้าของงาน/ผู้ควบคุมงาน (Project Owner)
FM-SE-013	แบบการชี้บ่งอันตรายและการประเมินความเสี่ยง ด้วยวิธี Job Safety & Environment Analysis	3 ปี	Safety & Environment
FM-SE-014	แบบบันทึกการเข้า - ออก ผู้รับเหมา	1 ปี	Safety & Environment
FM-SE-015	แบบบันทึกการอบรม	3 ปี	Safety & Environment
FM-SE-065	Contractor Specific Skill Form	3 ปี	Safety & Environment
FM-SE-064	แบบทดสอบการอบรมความปลอดภัย อาชีวอนามัย และสิ่งแวดล้อม และหนังสือยินยอม PDPA	3 ปี	Safety & Environment

8. เอกสารแนบท้าย

ไม่มี



---

สำเนาหนังสือนำเสนอรายงานฯ ระหว่างเดือนกรกฎาคม-ธันวาคม พ.ศ. 2566





บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด  
Amata B.Grimm Power (Rayong) 5 Limited

5 ถนนกรุงเทพกรีฑา แขวงหัวหมาก  
เขตบางกะปิ กรุงเทพฯ 10240  
5 Krungthepkreetha Road, Huamark,  
Bangkapi, Bangkok 10240  
Tel. +66 (0) 2710 3400, Fax +66 (0) 2379 4257  
เลขประจำตัวผู้เสียภาษีอากร 0105553104393

ที่ อบพร5. 002\_2/2567

25 มกราคม 2567

เรื่อง ขอนำส่งรายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม  
โครงการโรงไฟฟ้าก๊าซธรรมชาติ ของบริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด ฉบับประจำเดือน  
กรกฎาคม-ธันวาคม 2566

เรียน เลขาธิการสำนักงานคณะกรรมการกำกับกิจการพลังงาน

สิ่งที่ส่งมาด้วย 1. รายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการวิเคราะห์ผลกระทบ  
สิ่งแวดล้อม ระยะดำเนินการ ฉบับประจำเดือนกรกฎาคม-ธันวาคม 2566 จำนวน 3 เล่ม  
2. แผ่นแม่เหล็กบันทึกข้อมูล จำนวน 3 แผ่น

ตามที่ โครงการโรงไฟฟ้าก๊าซธรรมชาติ บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด ตั้งอยู่  
ในนิคมอุตสาหกรรมอมตะซิตี้ ระยอง ตำบลมาบยางพร อำเภอบลุกแดง จังหวัดระยอง ใบอนุญาตผลิตไฟฟ้า  
เลขที่ กกพ 01-1(2)/61-255 ทะเบียนโรงงาน 82250600225587(น.88(2)-2/2558-นอต.) และได้รับความ  
เห็นชอบในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อมซึ่งต้องจัดทำรายงานผลการปฏิบัติตามมาตรการที่กำหนด  
ไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม เสนอต่อหน่วยงานที่เกี่ยวข้องทราบเป็นประจำทุก 6 เดือน นั้น

บริษัทฯ ดำเนินการจัดทำรายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการ  
วิเคราะห์ผลกระทบสิ่งแวดล้อม ฉบับประจำเดือนกรกฎาคม-ธันวาคม 2566 แล้วเสร็จ จึงขอส่งรายงาน  
ดังกล่าวให้สำนักงานคณะกรรมการกำกับกิจการพลังงานพิจารณา รายละเอียดตามสิ่งที่ส่งมาด้วย 1 และ 2

จึงเรียนมาเพื่อโปรดพิจารณา

ดู

ฝ่ายลูกค้าสัมพันธ์ และปฏิบัติการ 2 - สิ่งแวดล้อม ความปลอดภัย และสภาพภูมิอากาศ

ผู้ประสานงานโครงการ : นางสาวประกายมาศ โพธา /โทร 0 2710 3411, 085-702-5252, Prakaimas.p@bgrimmpower.com





บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด  
Amata B.Grimm Power (Rayong) 5 Limited

5 ถนนกรุงเทพกรีฑา แขวงหัวหมาก  
เขตบางกะปิ กรุงเทพฯ 10240  
5 Krungthepkreetha Road, Huamark,  
Bangkapi, Bangkok 10240  
Tel. +66 (0) 2710 3400, Fax +66 (0) 2379 4257  
เลขประจำตัวผู้เสียภาษีอากร 0105553104393

ที่ อบพร5. 002\_3/2567

25 มกราคม 2567


เรื่อง ขอนำส่งรายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม  
โครงการโรงไฟฟ้าก๊าซธรรมชาติ ของบริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด ฉบับประจำเดือน  
กรกฎาคม-ธันวาคม 2566

เรียน นายกองค์การบริหารส่วนตำบลมาบยางพร

สิ่งที่ส่งมาด้วย 1. รายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการวิเคราะห์ผลกระทบ  
สิ่งแวดล้อม ฉบับประจำเดือนกรกฎาคม-ธันวาคม 2566 จำนวน 1 เล่ม  
2. แผนแม่เหล็กบันทึกข้อมูล จำนวน 1 แผน

ตามที่ โครงการโรงไฟฟ้าก๊าซธรรมชาติ บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด  
ตั้งอยู่ในนิคมอุตสาหกรรมอมตะซิตี้ ระยอง ตำบลมาบยางพร อำเภอบลุกแดง จังหวัดระยอง ใบอนุญาตผลิตไฟฟ้า  
เลขที่ กกพ 01-1(2)/61-255 ทะเบียนโรงงาน 82250600225587(น.88(2)-2/2558-นอต.) และได้รับความ  
เห็นชอบในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อมซึ่งต้องจัดทำรายงานผลการปฏิบัติตามมาตรการที่  
กำหนดไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม เสนอต่อหน่วยงานที่เกี่ยวข้องทราบเป็นประจำทุก 6  
เดือน นั้น

บริษัทฯ ดำเนินการจัดทำรายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการ  
วิเคราะห์ผลกระทบสิ่งแวดล้อม ฉบับประจำเดือนกรกฎาคม-ธันวาคม 2566 แล้วเสร็จ จึงขอส่งรายงาน  
ดังกล่าวให้องค์การบริหารส่วนตำบลมาบยางพรพิจารณา รายละเอียดตามสิ่งที่ส่งมาด้วย 1 และ 2



ฝ่ายลูกค้าสัมพันธ์ และปฏิบัติการ 2 - สิ่งแวดล้อม ความปลอดภัย และสภาพภูมิอากาศ

ผู้ประสานงานโครงการ : นางสาวประกายมาศ โพธา /โทร 0 2710 3411, 085-702-5252, Prakaimas.p@bgrimmpower.com







บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด  
Amata B.Grimm Power (Rayong) 5 Limited

5 ถนนกรุงเทพกรีฑา แขวงหัวหมาก  
เขตบางกะปิ กรุงเทพฯ 10240  
5 Krungthepkreetha Road, Huamark,  
Bangkapi, Bangkok 10240  
Tel. +66 (0) 2710 3400, Fax +66 (0) 2379 4257  
เลขประจำตัวผู้เสียภาษีอากร 0105553104393

ที่ อบพร5. 002/2567

25 มกราคม 2567

เรื่อง ขอนำส่งรายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม  
โครงการโรงไฟฟ้าก๊าซธรรมชาติ ของบริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด ฉบับประจำเดือน  
กรกฎาคม-ธันวาคม 2566

เรียน ผู้อำนวยการสำนักงานนิคมอุตสาหกรรมอมตะซิตี้ ระยอง

สิ่งที่ส่งมาด้วย 1. สำเนาหนังสือ บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด ที่ อบพร5.  
002\_2/2567 ลงวันที่ 25 มกราคม 2567  
2. แผ่นแม่เหล็กบันทึก ข้อมูล (CD) จำนวน 2 แผ่น

ตามที่ โครงการโรงไฟฟ้าก๊าซธรรมชาติ บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด ตั้งอยู่  
ในนิคมอุตสาหกรรมอมตะซิตี้ ระยอง ตำบลมาบยางพร อำเภอลวกแดง จังหวัดระยอง ใบอนุญาตผลิตไฟฟ้า  
เลขที่ กกพ 01-1(2)/61-255 ทะเบียนโรงงาน 82250600225587(น.88(2)-2/2558-นอต.) และได้รับความ  
เห็นชอบในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อมซึ่งต้องจัดทำรายงานผลการปฏิบัติตามมาตรการที่กำหนด  
ไว้ในรายงานการวิเคราะห์ผลกระทบสิ่งแวดล้อม เสนอต่อหน่วยงานที่เกี่ยวข้องทราบเป็นประจำทุก 6 เดือน นั้น

บริษัทฯ ดำเนินการจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบ  
สิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม ฉบับประจำเดือนกรกฎาคม-ธันวาคม 2566  
และได้นำส่งสำนักงานคณะกรรมการกำกับกิจการพลังงาน ซึ่งเป็นหน่วยงานอนุญาตเรียบร้อยแล้ว จึงขอส่ง  
สำเนาหลักฐานการจัดส่งรายงานผลการปฏิบัติตามมาตรการฯ ดังกล่าว และรายงานในรูปแบบไฟล์  
อิเล็กทรอนิกส์บรรจุใส่แผ่นซีดี ให้สำนักงานนิคมอุตสาหกรรมอมตะซิตี้ ระยอง พิจารณา รายละเอียดตามสิ่งที่  
ส่งมาด้วย 1 และ 2

ฝ่ายลูกค้าสัมพันธ์ และปฏิบัติการ 2 - สิ่งแวดล้อม ความปลอดภัย และสภาพภูมิอากาศ

ผู้ประสานงานโครงการ : นางสาวประกายมาศ โพธา /โทร 0 2710 3411, 085-702-5252, Prakaimas.p@bgrimpower.com



---

แผนการตรวจสอบสภาพและบำรุงรักษาดูแลการทำงานของระบบหล่อเย็น



ABPR5 ES PM Plan Cooling Tower					
Item	Equipment No	Equipment Desc	Work Spec Desc	Frequency Period	Frequency Unit
1	0115-51MKA10AG001	GAS TURBINE GENERATOR GTG#51	VISUAL INSPECTION	30	Days
2	0115-51MKA10AG001	GAS TURBINE GENERATOR GTG#51	THERMOSCAN	180	Days
3	0115-51MKA10AG001	GAS TURBINE GENERATOR GTG#51	GENERATOR MINOR INSPECTION	365	Days
4	0115-51MKA10AG001	GAS TURBINE GENERATOR GTG#51	GENERATOR MAJOR INSPECTION	1095	Days
5	0115-52MKA10AG001	GAS TURBINE GENERATOR GTG#52	VISUAL INSPECTION	30	Days
6	0115-52MKA10AG001	GAS TURBINE GENERATOR GTG#52	THERMOSCAN	180	Days
7	0115-52MKA10AG001	GAS TURBINE GENERATOR GTG#52	GENERATOR MINOR INSPECTION	365	Days
8	0115-52MKA10AG001	GAS TURBINE GENERATOR GTG#52	GENERATOR MAJOR INSPECTION	1095	Days
9	0115-50MKA10AG001	STEAM TURBINE GENERATOR	VISUAL INSPECTION	30	Days
10	0115-50MKA10AG001	STEAM TURBINE GENERATOR	GENERATOR MINOR INSPECTION	180	Days
11	0115-50MKA10AG001	STEAM TURBINE GENERATOR	GENERATOR MAJOR INSPECTION	1095	Days
12	0115-51BAT10	GTG 51 STEP-UP TRANSFORMER	VISUAL INSPECTION	30	Days
13	0115-52BAT10	GTG 52 STEP-UP TRANSFORMER	VISUAL INSPECTION	30	Days
14	0115-50BAT10	STG 50 STEP-UP TRANSFORMER	VISUAL INSPECTION	30	Days
15	0115-51BAT10	GTG 51 STEP-UP TRANSFORMER	THERMOSCAN	180	Days
16	0115-52BAT10	GTG 52 STEP-UP TRANSFORMER	THERMOSCAN	180	Days
17	0115-50BAT10	STG 50 STEP-UP TRANSFORMER	THERMOSCAN	180	Days
18	0115-51BAT10	GTG 51 STEP-UP TRANSFORMER	TRANSFORMER OIL SAMPLING TEST	365	Days
19	0115-52BAT10	GTG 52 STEP-UP TRANSFORMER	TRANSFORMER OIL SAMPLING TEST	365	Days
20	0115-50BAT10	STG 50 STEP-UP TRANSFORMER	TRANSFORMER OIL SAMPLING TEST	365	Days
21	0115-51BAT10	GTG 51 STEP-UP TRANSFORMER	TRANSFORMER MINOR INSPECTION	365	Days
22	0115-52BAT10	GTG 52 STEP-UP TRANSFORMER	TRANSFORMER MINOR INSPECTION	365	Days
23	0115-51BAT10	GTG 51 STEP-UP TRANSFORMER	TRANSFORMER MAJOR INSPECTION	1095	Days
24	0115-52BAT10	GTG 52 STEP-UP TRANSFORMER	TRANSFORMER MAJOR INSPECTION	1095	Days
25	0115-50BAT10	STG 50 STEP-UP TRANSFORMER	TRANSFORMER MAJOR INSPECTION	1095	Days



## Plan P.M. Cooling Tower ABPR.5

Item.	Equipment No	Equipment Desc	Work Spec Desc	Frequency Period	Frequency Unit
1	135-50PAC10AH001	COOLING TOWER CELL 1	VIBRATION MEASUREMENT AND ANALYSIS PUMP AND MOTOR	30	Days
2	135-50PAC11AH001	COOLING TOWER CELL 2	VIBRATION MEASUREMENT AND ANALYSIS PUMP AND MOTOR	30	Days
3	135-50PAC10AH001	COOLING TOWER CELL 1	REPLACE LUBE OIL/GREASE AND INSPECTION ( MOBIL SHC 630 ISO.220 50 L. 8 APPLY GREASE 65 G.)	180	Days
4	135-50PAC11AH001	COOLING TOWER CELL 2	REPLACE LUBE OIL/GREASE AND INSPECTION ( MOBIL SHC 630 ISO.220 50 L. 8 APPLY GREASE 65 G.)	180	Days
5	135-50PAC10AH001	COOLING TOWER CELL 1	SAMPLING LUBE OIL GEAR BOX CT.FAN ANALYSIS AND RECORD.	180	Days
6	135-50PAC11AH001	COOLING TOWER CELL 2	SAMPLING LUBE OIL GEAR BOX CT.FAN ANALYSIS AND RECORD.	180	Days



ABPR5 ES PM Plan Cooling Tower					
Item	Equipment No	Equipment Desc	Work Spec Desc	Frequency Period	Frequency Unit
1	0115-50PAC10AH001	COOLING TOWER CELL 1	VISUAL INSPECTION	90	Day
2	0115-50PAC11AH001	COOLING TOWER CELL 2	VISUAL INSPECTION	90	Day
3	0115-50PAC10AH001	COOLING TOWER CELL 1	OVERHAUL	1095	Day
4	0115-50PAC11AH001	COOLING TOWER CELL 2	OVERHAUL	1095	Day
5	0115-05PAC11AP001	MAIN COOLING WATER PUMP 1	VISUAL INSPECTION	90	Day
6	0115-05PAC12AP001	MAIN COOLING WATER PUMP 2	VISUAL INSPECTION	90	Day
7	0115-05PAC11AP001	MAIN COOLING WATER PUMP 1	OVERHAUL	1095	Day
8	0115-05PAC12AP001	MAIN COOLING WATER PUMP 2	OVERHAUL	1095	Day



**Plan PM C&I Equipment for Cooling Tower ABPR5**

Item	Equipment No	Equipment Description	Work Spec Description	Frequency Period	Frequency Unit
1	0115-50PAC10CL202	CT FAN GEARBOX 1 LUBE OIL LEVEL SWITCH	VISUAL CHECK, CLEAN, CALIBRATION AND TIGHTEN SIGNAL CABLE FOR INSTRUMENT SWITCH	3	Years
2	0115-50PAC11CL202	CT FAN GEARBOX 2 LUBE OIL LEVEL SWITCH	VISUAL CHECK, CLEAN, CALIBRATION AND TIGHTEN SIGNAL CABLE FOR INSTRUMENT SWITCH	3	Years
3	0115-50PAC10CY201	COOLING FAN A VIBRATION SWITCH	VISUAL CHECK, CLEAN, CALIBRATION AND TIGHTEN SIGNAL CABLE FOR INSTRUMENT SWITCH	3	Years
4	0115-50PAC11CY201	COOLING FAN B VIBRATION SWITCH	VISUAL CHECK, CLEAN, CALIBRATION AND TIGHTEN SIGNAL CABLE FOR INSTRUMENT SWITCH	3	Years



ภาคผนวก ข.4

---

แบบฟอร์มใบแจ้งข้อร้องเรียน





<b>ใบแจ้งข้อร้องเรียน / ข้อเสนอแนะ</b>		เลขที่ ...../...../.....
<input type="checkbox"/> ABPR1,2 <input type="checkbox"/> ABPR3,4 <input type="checkbox"/> ABPR5		
รายละเอียดการแจ้งข้อร้องเรียน/ข้อเสนอแนะ มีดังนี้ ..... ..... .....		
<input type="checkbox"/> ผู้แจ้งภายในบริษัท วันที่แจ้ง...../...../..... ชื่อ - นามสกุล ..... หน่วยงาน .....	<input type="checkbox"/> ผู้แจ้งภายนอกบริษัท วันที่แจ้ง...../...../..... ชื่อ - นามสกุล ..... บริษัท/ชุมชน ..... โทรศัพท์ ..... <hr/> ลงชื่อพนักงานผู้รับแจ้ง ..... (กรณีได้รับแจ้งโดยตรงจากผู้แจ้งภายนอก)	
<b>ผู้จัดการแผนกบริหาร: รับเรื่อง และตรวจสอบ :</b> วันที่รับเรื่อง ...../...../..... ลักษณะการแจ้งโดย <input type="checkbox"/> ใบแจ้งข้อร้องเรียนฯ <input type="checkbox"/> วาจา <input type="checkbox"/> โทรศัพท์ <input type="checkbox"/> จดหมาย/Email <input type="checkbox"/> รูปถ่าย <input type="checkbox"/> อื่นๆ ..... ผลการตรวจสอบเบื้องต้น วันที่ตรวจสอบ ...../...../..... <input type="checkbox"/> เป็นจริงตามที่แจ้ง <input type="checkbox"/> ไม่เป็นไปตามที่แจ้ง    ลงชื่อ ..... ผู้รับเรื่องและตรวจสอบ หมายเหตุ : กรณีรอผลการตรวจสอบโปรกระบุ : จะทราบผลการตรวจสอบภายในวันที่ ...../...../.....		
<b>เสนอ MD/PPM รับทราบและกำหนดผู้รับผิดชอบแก้ไขข้อร้องเรียน / ข้อเสนอแนะ (ภายใน 3 วัน)</b> PPM..... MD..... วันที่รับทราบ ...../...../.....    วันที่รับทราบ ...../...../.....		
<b>การดำเนินการแก้ไข (MD/PPM สั่งการกำหนดผู้รับผิดชอบแก้ไข)</b> ผู้รับผิดชอบแก้ไข(MD/PPM ระบุ)..... และแจ้งวิธีการแก้ไขให้ทราบภายในวันที่...../...../..... การวิเคราะห์สาเหตุของปัญหา ..... ..... ..... ..... วิธีการแก้ไข..... ..... ..... ..... กำหนดแล้วเสร็จวันที่ ...../...../.....    ลงนาม ..... ผู้รับผิดชอบแก้ไข ความเห็น MD/PPM ..... MD/PPM ลงนาม อนุมัติดำเนินการ ..... วันที่...../...../.....		
ผู้จัดการแผนกบริหารแจ้งให้ผู้ร้องเรียน/เสนอแนะทราบโดยเร็วที่สุด เมื่อรับทราบวิธีการดำเนินการแก้ไขและกำหนดแล้วเสร็จ หรือ กรณีต้องรอผลการตรวจสอบ หรือการปรับปรุงแก้ไขใช้เวลานาน ให้แจ้งความคืบหน้าให้ผู้ร้องเรียนฯทราบเป็นระยะๆตามความเหมาะสม		
<b>การตรวจสอบโดยผู้จัดการแผนกบริหารและผู้ร่วมตรวจสอบ</b> <input type="checkbox"/> การแก้ไขเป็นไปตามที่กำหนดและมีประสิทธิภาพ <input type="checkbox"/> การแก้ไขไม่เป็นไปตามที่กำหนด <input type="checkbox"/> วิธีการแก้ไขไม่มีประสิทธิภาพ วันที่ตรวจสอบใหม่ ...../...../..... ..... ผู้จัดการแผนกบริหาร ..... ผู้ร่วมตรวจสอบ วันที่...../...../.....    วันที่...../...../.....		
<b>การรายงานกลับไปยังผู้ร้องเรียน</b> ..... วันที่รายงาน .....ลงนาม .....ผู้รายงาน		



ภาคผนวก ข.5

---

ขั้นตอนการรับเรื่องร้องเรียนของโครงการ





## คำร้องขอดำเนินการด้านเอกสาร

### DOCUMENT ACTION REQUEST (DAR)

DAR NO.

65/151

หมายเลขเอกสารเดิม

PD-MG-006, Rev.03

หมายเลขเอกสารใหม่

PD-MG-006, Rev.04

ชื่อเอกสารเดิม

Communication Procedure

ชื่อเอกสารใหม่

การสื่อสาร, การให้ปรึกษา และความร่วมมือร่วม

วัตถุประสงค์/เหตุผล

ยกเลิกบทบาทหน้าที่รองกรรมการผู้จัดการ

#### ประเภทเอกสาร

☐

คู่มือบริหารระบบ

☒

ระเบียบปฏิบัติงาน

☐

วิธีปฏิบัติงาน

☐

เอกสารสนับสนุน

☐

แบบบันทึก

☐

อื่น ๆ \_\_\_\_\_

#### ประเภทการขอเปลี่ยนแปลงเอกสาร

☐

ขอนำเอกสารเข้าระบบ

☒

ขอเอกสารแก้ไข

☐

ขอทำลายเอกสาร

☐

ขอเอกสารสำเนาเพิ่มเติม จำนวน \_\_\_\_ ชุด

☐

ขอยกเลิกเอกสาร

☐


อื่น ๆ \_\_\_\_\_

รายละเอียดการขอเปลี่ยนแปลง

ยกเลิกบทบาทหน้าที่รองกรรมการผู้จัดการ

ผู้ขอ / ผู้จัดทำ		การพิจารณาทบทวน	
ลงนาม	Thitirat Charoenrat	อนุมัติผลบังคับใช้วันที่	11/05/2022
ตำแหน่ง	SEDM	ลงนาม	Thitirat Charoenrat
วันที่	11/05/2022	ตำแหน่ง	SEDM
การพิจารณาอนุมัติ		บันทึกการควบคุมเอกสาร	
อนุมัติผลบังคับใช้วันที่	11/05/2022	ลงนาม	Tidaporn Chalitaporn
ลงนาม	Thitirat Charoenrat	ตำแหน่ง	เจ้าหน้าที่ควบคุมเอกสาร
ตำแหน่ง	MR	วันที่บันทึก	17/05/2022



		<b>AMATA B. GRIMM POWER (RAYONG) LIMITED</b>		<b>Doc. No. PD-MG-006</b>
Document Owner:	Revision:	Document Type:	Status:	
Management	04	Procedure	<b>DAR No. 65/151</b>	
Prepared by:	Checked:	Approved	Page:	
Thitirat Charoenrat	Thitirat Charoenrat	Thitirat Charoenrat	1-10	
Date : 11/05/2022	Date : 11/05/2022	Date: 11/05/2022		
Valid for:  <p style="text-align: center;"><b>ABPR1, ABPR2, ABPR3, ABPR4, ABPR5</b></p> This is computer generated signature and approve online.				

## ระเบียบปฏิบัติงาน


เรื่อง การสื่อสาร, การให้ปรึกษา และความร่วมมือส่วนร่วม

### Communication Procedure

#### ประวัติการแก้ไขเอกสาร

แก้ไขครั้งที่	วันที่เริ่มใช้	คำอธิบาย
00	19/11/2557	การสื่อสาร
01	23/04/2561	ปรับให้สอดคล้องตามข้อกำหนดของ ISO 14001:2015 และ ISO 45001:2018 และ เปลี่ยนชื่อเอกสารจาก “การสื่อสาร” เป็น “การสื่อสาร, การให้ปรึกษา และความร่วมมือส่วนร่วม”
02	25/03/2562	ขยายขอบเขตให้ครอบคลุม ABPR1-5
03	07/04/2563	เพิ่มบทบาทหน้าที่รองกรรมการผู้จัดการ
04	17/05/2565	ยกเลิกบทบาทหน้าที่รองกรรมการผู้จัดการ




	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือส่วนร่วม	Page: 2 <b>Doc. No. PD-MG-006</b>
---	-----------------	--	---

## สารบัญ

หน้า

1	วัตถุประสงค์.....	3
2	ขอบเขต.....	3
3	นิยาม .....	3
4	เอกสารที่เกี่ยวข้อง.....	3
5	รายละเอียดการดำเนินงาน .....	3
6	ผังกระบวนการ .....	7
7	การควบคุมบันทึก.....	10
8	เอกสารแนบท้าย .....	10



	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือร่วม	Page: 3	Doc. No. PD-MG-006
---	-----------------	--	------------	--------------------

## 1 วัตถุประสงค์

เพื่ออธิบายถึงขั้นตอนการดำเนินงานและความรับผิดชอบ ในการสื่อสารข่าวสารข้อมูลต่างๆ ที่เกี่ยวข้องกับการปฏิบัติงานภายในของบริษัทฯ และระบบการจัดการตามมาตรฐานสากลที่องค์กรประยุกต์ใช้ เพื่อให้มั่นใจว่าพนักงานทุกคนและบุคคลภายนอกที่เกี่ยวข้อง ทราบถึงข้อมูลข่าวสารที่เกี่ยวข้องกับการปฏิบัติงานภายในของบริษัทฯ และด้านสิ่งแวดล้อม ความปลอดภัย และอาชีวอนามัย และความต่อเนื่องทางธุรกิจที่จำเป็น เพื่อให้มีการปฏิบัติงานที่ถูกต้อง และสอดคล้องกับการทำระบบการจัดการสิ่งแวดล้อม ความปลอดภัย และอาชีวอนามัยและความต่อเนื่องทางธุรกิจโดยสามารถใช้ช่องทางในการสื่อสารต่างๆ ได้อย่างถูกต้อง และมีประสิทธิภาพ

## 2 ขอบเขต

ครอบคลุมถึงการสื่อสารภายในกลุ่มโรงไฟฟ้า อมตะ บี. กริม เพาเวอร์ ในนิคมอุตสาหกรรมอมตะซิตี้ระยอง และการติดต่อสื่อสารกับบุคคลหรือองค์กรภายนอกที่เกี่ยวข้อง ซึ่งได้แก่ ลูกค้า, บริษัทฯ ใกล้เคียง, ชุมชนใกล้เคียง, ผู้รับเหมา, Supplier หรือสาธารณะชนที่มีความสนใจในการดำเนินระบบการจัดการสิ่งแวดล้อม ความปลอดภัย อาชีวอนามัย และความต่อเนื่องทางธุรกิจ

## 3 นิยาม

ระบบการจัดการตามมาตรฐานสากลที่องค์กรประยุกต์ใช้ หมายถึง ระบบการจัดการทางด้านสิ่งแวดล้อม อาชีวอนามัย ความปลอดภัย และระบบการบริหารความต่อเนื่องทางธุรกิจ

## 4 เอกสารที่เกี่ยวข้อง

ไม่มี


## 5 รายละเอียดการดำเนินงาน

ให้หัวหน้าส่วนงานบริหารเป็นผู้รับผิดชอบในการจัดทำแผนประชาสัมพันธ์ประจำปีของบริษัทฯ นำเสนอกรรมการผู้จัดการ (MD) อนุมัติ ภายในเดือนมกราคมของทุกปี โดยมุ่งเน้นให้พนักงานทุกคนในองค์กร และบุคคลภายนอกได้รับทราบข้อมูลข่าวสารต่างๆ ที่เกี่ยวข้องหรือที่จำเป็นของบริษัทฯ และเพื่อเผยแพร่การประชาสัมพันธ์บริษัทฯ โดยเฉพาะด้านการจัดการสิ่งแวดล้อม ความปลอดภัย อาชีวอนามัย และความต่อเนื่องทางธุรกิจ

### 5.1 การสื่อสารภายใน และภายนอก องค์กร

- 5.1.1 กำหนดให้หัวหน้าส่วนงานบริหารร่วมกับ ตัวแทนฝ่ายบริหารเป็นผู้รับผิดชอบในการดำเนินงานและประสานงานด้านการสื่อสารประชาสัมพันธ์ภายในองค์กร โดยให้มั่นใจว่าพนักงานทุกคนได้รับทราบข้อมูลตามตารางแสดงรายละเอียดการสื่อสารสำหรับพนักงาน ภายในบริษัทฯ อย่างครบถ้วน
- 5.1.2 กำหนดให้ผู้บริหาร ร่วมกับหัวหน้าส่วนงานบริหารและ ตัวแทนฝ่ายบริหาร เป็นผู้รับผิดชอบในการดำเนินงานด้านการสื่อสารประชาสัมพันธ์ภายนอกองค์กร โดยให้มั่นใจว่าบุคคลภายนอกที่เกี่ยวข้องได้รับทราบข้อมูลตามตารางแสดงรายละเอียดการสื่อสารสำหรับบุคคลภายนอกบริษัทฯ อย่างครบถ้วน ส่วนในเรื่องของผลกระทบต่อสิ่งแวดล้อมที่มีนัยสำคัญ กำหนดให้กรรมการผู้จัดการ (Managing Director) เป็นผู้ตัดสินใจว่าจะสื่อสาร



	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือร่วม	Page: 4	Doc. No. PD-MG-006
---	-----------------	--	------------	--------------------


ประชาสัมพันธ์สู่ภายนอกองค์กรหรือไม่ โดยชี้แจงเหตุผลในการตัดสินใจในกรณีที่ไม่ต้องการสื่อสาร หรือถ้าต้องการสื่อสารจะสื่อสารโดยวิธีใดตามตารางแสดงรายละเอียดการสื่อสารสำหรับบุคคลภายนอกบริษัทฯ โดยแจ้งต่อที่ประชุมคณะกรรมการสิ่งแวดล้อม หรือการประชุมทบทวนโดยฝ่ายบริหาร (Management Review) เพื่อจัดทำเป็นบันทึก

- 5.1.3 ผู้รับผิดชอบการสื่อสารตามตารางแสดงรายละเอียดการสื่อสารทั้งสำหรับพนักงานภายในบริษัทฯ และสำหรับบุคคล ภายนอกบริษัทฯ สามารถเลือกใช้ช่องทางการสื่อสารทางใดทางหนึ่งหรือหลายช่องทางก็ได้ โดยต้องมั่นใจว่าผู้รับการสื่อสารได้รับข้อมูลข่าวสารนั้นแล้ว

## 5.2 การแจ้งข้อร้องเรียนหรือข้อเสนอแนะ

- 5.2.1 พนักงานหรือบุคคลภายนอก สามารถแจ้งข้อร้องเรียน หรือข้อเสนอแนะได้ โดยใช้ช่องทางการสื่อสารหรือวิธีใดก็ได้ตามความสะดวกและเหมาะสม
- 5.2.2 กรณีแจ้งข้อร้องเรียนหรือข้อเสนอแนะ โดยใช้ใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ
- ให้ส่งใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ ที่หัวหน้าส่วนงานบริหาร
  - หัวหน้าส่วนงานบริหาร ลงเลขที่โดยใช้ตัวอักษร “ I / ” นำหน้าหมายเลขกรณีเป็นการแจ้งจากภายใน และใช้ตัวอักษร “ O / ” กรณีเป็นการแจ้งจากภายนอก โดยเรียงตามลำดับนับจาก 001...และตามด้วย ปีพ.ศ. (เลขที่ I/ หรือ O/xxx / ปี พ.ศ.), ลงวันที่รับเรื่องร้องเรียนฯ , ทำการตรวจสอบเบื้องต้นโดยเร็วที่สุดแต่อย่างช้าต้องไม่เกิน 3 วันนับจากวันที่รับเรื่อง ลงวันที่ตรวจสอบ และลงบันทึกในบันทึกการติดตามข้อร้องเรียน/ข้อเสนอแนะ
  - ในกรณีที่ข้อร้องเรียนหรือข้อเสนอแนะเกี่ยวข้องกับด้านสิ่งแวดล้อม ความปลอดภัย อาชีวอนามัย และความต่อเนื่องทางธุรกิจให้ เสนอ ตัวแทนฝ่ายบริหาร(MR) และ กรรมการผู้จัดการ (MD)/ ผู้จัดการ โรงไฟฟ้า (PPM) รับทราบ และให้กรรมการผู้จัดการ (MD)/ ผู้จัดการ โรงไฟฟ้า (PPM) กำหนดผู้รับผิดชอบการแก้ไข และกำหนดวันที่ส่งแนวทางการแก้ไข โดยให้หัวหน้าส่วนงานบริหารจัดทำสำเนาเก็บเป็นบันทึกในบันทึกการติดตามข้อร้องเรียน/ข้อเสนอแนะ และส่งต้นฉบับให้กับผู้ที่ กรรมการผู้จัดการ (MD)/ ผู้จัดการ โรงไฟฟ้า (PPM) กำหนดให้เป็นผู้รับผิดชอบการแก้ไขโดยเร็วที่สุดแต่อย่างช้าต้องไม่เกิน 3 วันนับจากวันที่ตรวจสอบแล้วเสร็จ
  - ผู้รับผิดชอบการแก้ไข ทำการวิเคราะห์สาเหตุ หาแนวทางการแก้ไข และกำหนดวันที่ดำเนินการแล้วเสร็จ ส่งให้ หัวหน้าส่วนงานบริหารเพื่อนำเสนอ MD/ PPM พิจารณา ให้เสร็จภายในวันที่ MD/ PPM ได้กำหนดไว้
  - เมื่อ MD/ PPM พิจารณานุมัติดำเนินการ ให้หัวหน้าส่วนงานบริหารจัดทำสำเนาส่งแจ้งผู้รับผิดชอบเพื่อดำเนินการ แก้ไข และต้นฉบับจัดเก็บเป็นบันทึกในบันทึกการติดตามข้อร้องเรียน/ข้อเสนอแนะ
  - เมื่อทราบถึงวิธีการแก้ไขและวันกำหนดแล้วเสร็จ ตามที่ได้รับอนุมัติแล้ว ให้หัวหน้าส่วนงานบริหารดำเนินการแจ้งให้ผู้ร้องเรียนฯทราบโดยเร็วที่สุดด้วยวิธีการใดก็ได้ตามความเหมาะสม พร้อมลงบันทึกการแจ้งในบันทึกการติดตามข้อร้องเรียน/ข้อเสนอแนะ
  - กรณีต้องรอผลการตรวจสอบ หรือการปรับปรุงแก้ไขใช้เวลานาน ให้แจ้งความคืบหน้าให้ผู้ร้องเรียนฯทราบเป็นระยะๆตามความเหมาะสม พร้อมลงบันทึกการแจ้งในบันทึกการติดตามข้อร้องเรียน/ข้อเสนอแนะ
  - ในกรณีที่ข้อร้องเรียนหรือข้อเสนอแนะเกี่ยวข้องกับด้านสิ่งแวดล้อม ความปลอดภัย อาชีวอนามัย และความต่อเนื่องทางธุรกิจ เมื่อครบกำหนดแล้วเสร็จตามวันที่แจ้งในการดำเนินการแก้ไข ให้หัวหน้าส่วนงานบริหาร



	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือส่วนร่วม	Page: 5	Doc. No. PD-MG-006
---	-----------------	--	------------	--------------------

ร่วมกับ ตัวแทนฝ่ายบริหาร ตรวจสอบโดยเร็วที่สุดแต่อย่างช้าต้องไม่เกิน 3 วันนับจากวันที่กำหนด ว่าการแก้ไขเป็นไปตามที่กำหนดและมีประสิทธิภาพแล้วหรือไม่ กรณีไม่เป็นไปตามที่กำหนด หรือวิธีการแก้ไขไม่มีประสิทธิภาพ ให้ผู้รับผิดชอบแก้ไขกำหนดวันนัดตรวจสอบใหม่อีกครั้ง) กรณีที่ไม่เกี่ยวข้องกับด้านสิ่งแวดล้อมหัวหน้าส่วนงานบริหารอาจตรวจสอบร่วมกับผู้ที่เกี่ยวข้องอื่นหรือไม่ก็ได้ตามความเหมาะสม)

- หัวหน้าส่วนงานบริหารแจ้งความคืบหน้าให้ผู้ร้องเรียนทราบหลังจากตรวจสอบแล้ว พร้อมลงบันทึกการแจ้งในบันทึกการติดตามข้อร้องเรียน/ข้อเสนอแนะ
- เมื่อการแก้ไขตามข้อร้องเรียนหรือข้อเสนอแนะได้ดำเนินการเรียบร้อยแล้ว โดยเป็นไปตามที่กำหนดและมีประสิทธิภาพ ให้หัวหน้าส่วนงานบริหารจัดทำเอกสารแจ้งผู้ร้องเรียนเป็นลายลักษณ์อักษรเพื่อทราบ และจัดเก็บเป็นบันทึกในบันทึกการติดตามข้อร้องเรียน/ข้อเสนอแนะ

#### 5.2.3 กรณีการแจ้งข้อร้องเรียนหรือข้อเสนอแนะ โดยวิธีการอย่างอื่นที่ไม่ใช่การแจ้งโดยใช้ใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ

- **กรณีผู้แจ้งภายในบริษัทฯ**
  - ให้แจ้งได้โดยตรงที่หัวหน้าส่วนงานบริหาร
  - หัวหน้าส่วนงานบริหารลงรายละเอียดการแจ้ง วันที่แจ้ง ชื่อ-สกุลและหน่วยงานผู้แจ้ง ลงรายละเอียดข้อร้องเรียนหรือข้อเสนอแนะ ในใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ พร้อมแนบเอกสารหรือหลักฐานการแจ้งถ้ามี
  - ดำเนินการต่อไปตามขั้นตอนตามข้อ 5.2.2 การแจ้งโดยใช้ใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ
- **- กรณีผู้แจ้งภายนอกบริษัท**
  - ให้พนักงานที่เป็นผู้รับแจ้งบันทึกการแจ้งโดยใช้ใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ บันทึกรายละเอียดการแจ้ง วันที่แจ้ง ชื่อ-สกุล บริษัทหรือชุมชนที่อยู่ของผู้แจ้ง หมายเลขโทรศัพท์ที่ติดต่อได้ ลงรายละเอียดข้อร้องเรียนหรือข้อเสนอแนะ พร้อมแนบเอกสารหรือหลักฐานการแจ้งถ้ามี และลงชื่อผู้รับแจ้ง ส่งต่อให้หัวหน้าส่วนงานบริหาร เพื่อดำเนินการตามขั้นตอนตามข้อ 5.2.2 การแจ้งโดยใช้ใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ ต่อไป
  - หรือพนักงานผู้รับแจ้ง แจ้งรายละเอียดต่างๆ ให้หัวหน้าส่วนงานบริหาร เป็นผู้ทำการบันทึกรายละเอียดการแจ้งในใบแจ้งข้อร้องเรียน/ข้อเสนอแนะ แทนก็ได้

### 5.3 การให้บริการ และความร่วมมือส่วนร่วม


ในกระบวนการให้คำปรึกษา และสร้างความร่วมมือส่วนร่วมของบุคลากรในองค์กรให้เป็นไปอย่างมีประสิทธิภาพทางบริษัทฯ โดยทุกส่วนงานที่เกี่ยวข้อง โดยจัดรูปแบบของการให้คำปรึกษา ในรูปแบบที่เหมาะสมกับสถานการณ์ เช่น การจัดประชุม, การฝึกอบรม เป็นต้น พร้อมทั้งจัดให้มี สิ่งดังต่อไปนี้

- การนำเสนอข้อมูลที่เป็นจริง มีรูปแบบที่เหมาะสมกับพื้นฐานของพนักงานแต่ละระดับ และสามารถได้ทันท่วงที, ชัดเจน, เข้าใจง่าย และมีเกี่ยวข้องกับระบบการจัดการทั้งทางด้านสิ่งแวดล้อม อาชีวอนามัยและความปลอดภัย และความต่อเนื่องทางธุรกิจ
- มีทรัพยากรที่จำเป็น สำหรับการให้คำปรึกษา และความร่วมมือส่วนร่วม;

#### 5.3.1 การจัดให้มีการให้คำปรึกษา กับพนักงานที่ไม่ใช่ระดับบริหาร ในเรื่องดังต่อไปนี้:

ผู้บริหารแต่ละส่วนงาน จะจัดให้มีแนวทางในการให้คำปรึกษา และบุคลากร ที่ไม่ใช่ระดับบริหาร ในประเด็นดังต่อไปนี้



	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือส่วนร่วม	Page: 6 <b>Doc. No. PD-MG-006</b>
---	-----------------	--	---


- ให้คำปรึกษาต่อการกำหนดความต้องการ และความคาดหวังของผู้มีส่วนได้เสีย
- ให้คำปรึกษาต่อบทบาทหน้าที่ความรับผิดชอบ ที่พวกเขามีอย่างเหมาะสม
- ให้คำปรึกษาต่อการวิธีการปฏิบัติตามข้อกำหนดทางกฎหมาย และข้อกำหนดอื่นๆ
- ให้คำปรึกษาต่อการวัตถุประสงค์ และแผนดำเนินการให้บรรลุผล
- ให้คำปรึกษาต่อมาตรการควบคุมการจัดซื้อ และผู้รับเหมา ที่ตนมีส่วนเกี่ยวข้อง
- ให้คำปรึกษาต่อสิ่งที่ต้องได้รับการเฝ้าระวัง ตรวจสอบ และประเมินผล

#### 5.3.2 การสร้างความมีส่วนร่วมงาน ของผู้ที่ไม่ใช่ผู้บริหาร ในในเรื่องต่อไปนี้

ผู้บริหารแต่ละส่วนงาน จะจัดให้บุคลากร ที่ไม่ใช่ระดับบริหาร มีส่วนร่วมต่อการบริหารระบบการจัดการฯ ในประเด็นดังต่อไปนี้ :

- ร่วมกำหนดกลไกในการให้คำปรึกษา และความร่วมมือ;
- ร่วมชี้บ่งอันตราย และการประเมินความเสี่ยง และโอกาส
- ร่วมพิจารณาการดำเนินการเพื่อกำจัดอันตราย และลดความเสี่ยงด้าน OH&S
- ร่วมกำหนดความต้องการความต้องการการฝึกอบรม, จัดฝึกอบรม และประเมินผลการอบรม
- ร่วมกำหนดสิ่งที่ต้องได้รับการสื่อสาร และวิธีการสื่อสาร
- ร่วมกำหนดมาตรการควบคุม และการนำไปใช้งานอย่างมีประสิทธิภาพ
- การตรวจสอบอุบัติการณ์ และความไม่เป็นไปตามข้อกำหนด และการพิจารณาแก้ไข (ดูข้อ 10.2) ฝั่งกระบวนการ




	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือร่วม	Page: 7 Doc. No. PD-MG-006
---	-----------------	--	----------------------------------

## 6 ผังกระบวนการ

### ตารางแสดงรายละเอียดการสื่อสาร สำหรับพนักงานภายในบริษัทฯ

หัวข้อการสื่อสาร	ผู้รับผิดชอบการสื่อสาร	ความถี่	ช่องทางการสื่อสาร	ผู้รับการสื่อสาร
นโยบายบริษัทฯ สิ่งแวดล้อมความปลอดภัย และอาชีวอนามัย, ความ ต่อเนื่องทางธุรกิจ	ผู้บริหาร ADM	- ประกาศใช้ - มีการเปลี่ยนแปลง	ประกาศบริษัทฯ ชี้แจงหรืออบรม	พนักงานทุกคน
สาเหตุที่ก่อให้เกิดผลกระทบ ต่อสิ่งแวดล้อมความปลอดภัย และอาชีวอนามัย, ความ ต่อเนื่องทางธุรกิจ ที่สำคัญ ของส่วนงาน	ตัวแทนฝ่ายบริหาร (MR) หัวหน้าส่วนงาน	- มีกิจกรรมใหม่ - มีการเปลี่ยนแปลง	ประชุมชี้แจง	พนักงานและ ผู้จัดการฝ่าย ของส่วนงานที่เกี่ยวข้อง
วัตถุประสงค์และ เป้าหมายโครงการจัดการ สิ่งแวดล้อมความปลอดภัย และอาชีวอนามัย, ความ ต่อเนื่องทางธุรกิจ	ตัวแทนฝ่ายบริหาร (MR) หัวหน้าส่วนงาน	- มีการจัดทำใหม่ - มีการเปลี่ยนแปลง	ประชุมชี้แจง	พนักงานทุกคน
กฎหมายที่เกี่ยวข้อง	ตัวแทนฝ่ายบริหาร (MR) คณะกรรมการฝ่ายกฎหมาย	- ประกาศใช้ - มีการเปลี่ยนแปลง	Lotus Note รับทราบเอกสาร ประชุมชี้แจง	พนักงานที่เกี่ยวข้อง หัวหน้าส่วนงานที่เกี่ยวข้อง ผู้บริหาร
โครงสร้างหน้าที่ และความ รับผิดชอบ	ADM	- ประกาศใช้ - มีการเปลี่ยนแปลง	ประกาศบริษัทฯ ชี้แจงหรืออบรม รับทราบเอกสาร	พนักงานทุกคน
แผนและผลการ Internal Audit	ตัวแทนฝ่ายบริหาร (MR) Lead Auditor	- มีการจัดทำ	ประชุมชี้แจง	พนักงานทุกคน
ข้อร้องเรียน และ ข้อเสนอแนะ	พนักงานทุกคน	- เมื่อต้องการร้องเรียน หรือ เสนอแนะ	ใบร้องเรียน Lotus Note แจ้งโดยวาจา	หัวหน้าส่วนงานบริหาร ตัวแทนฝ่ายบริหาร (MR) ผู้จัดการโรงไฟฟ้า กรรมการผู้จัดการ
การสื่อสาร และ ช่องทางการสื่อสาร	หัวหน้าส่วนงานบริหาร ตัวแทนฝ่ายบริหาร (MR)	- ประกาศใช้ - มีการเปลี่ยนแปลง	ชี้แจงหรืออบรม รับทราบเอกสาร Lotus Note	พนักงานทุกคน
การควบคุมและ การดำเนินการ ในการปฏิบัติงาน	หัวหน้าส่วนงาน ที่เกี่ยวข้อง	- มีการจัดทำ - มีการเปลี่ยนแปลง	ชี้แจงหรืออบรม รับทราบเอกสาร	พนักงานที่เกี่ยวข้อง ผู้จัดการฝ่ายที่เกี่ยวข้อง
การติดตามและ การตรวจวัด	ตัวแทนฝ่ายบริหาร (MR)	- มีการจัดทำ - มีการเปลี่ยนแปลง	ประชุมชี้แจง	พนักงานที่เกี่ยวข้อง
รายงานการประชุม Management Review	ตัวแทนฝ่ายบริหาร (MR)	- มีการจัดทำ	รับทราบเอกสาร	ผู้บริหารทุกท่าน




	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือส่วนร่วม	Page: 8	Doc. No. PD-MG-006
---	-----------------	--	------------	--------------------

**ตารางแสดงรายละเอียดการสื่อสาร สำหรับบุคคลภายนอกบริษัทฯ**

หัวข้อการสื่อสาร	ผู้รับผิดชอบการสื่อสาร	ความถี่	ช่องทางการสื่อสาร	ผู้รับการสื่อสาร
นโยบายสิ่งแวดล้อม ความปลอดภัยและอาชีวอนามัย	ผู้บริหาร ตัวแทนฝ่ายบริหาร (MR) หัวหน้าส่วนงานบริหาร	- ประกาศใช้ - มีการเปลี่ยนแปลง	เอกสารชี้แจง แผ่นพับประชาสัมพันธ์ อบรมชี้แจง	ลูกค้า ชุมชนใกล้เคียง บริษัทฯ ใกล้เคียง ผู้รับเหมา และ Supplier
การสื่อสาร และ ช่องทางการสื่อสาร	ผู้บริหาร ตัวแทนฝ่ายบริหาร (MR) หัวหน้าส่วนงานบริหาร	- ประกาศใช้ - มีการเปลี่ยนแปลง	เอกสารชี้แจง แผ่นพับประชาสัมพันธ์ อบรมชี้แจง	ลูกค้า ชุมชนใกล้เคียง บริษัทฯ ใกล้เคียง ผู้รับเหมา และ Supplier
ข้อร้องเรียน และ ข้อเสนอแนะ	ลูกค้า ชุมชนใกล้เคียง บริษัทฯ ใกล้เคียง ผู้รับเหมา และ Supplier	- เมื่อต้องการร้องเรียน หรือ เสนอแนะ	ใบร้องเรียน Email แจ้งโดยวาจา จดหมาย	หัวหน้าส่วนงานบริหาร EMR ผู้จัดการ โรงไฟฟ้า กรรมการผู้จัดการ
การควบคุมและ การดำเนินการ ในการปฏิบัติงาน	Safety & Environment หัวหน้าส่วนงาน ที่เกี่ยวข้อง	- มีการเข้ามปฏิบัติงาน - มีการเปลี่ยนแปลง	เอกสารชี้แจง ชี้แจงหรืออบรม รับทราบเอกสาร	ผู้รับเหมา และ Supplier
ผลกระทบต่อสิ่งแวดล้อมที่มี นัยสำคัญ	Managing Director	- เมื่อประเมินพบทวน/ กิจกรรมที่มีผลกระทบต่อ สิ่งแวดล้อมที่มีนัยสำคัญ และพิจารณาว่าควรสื่อสาร ต่อหน่วยงานภายนอก	เอกสารชี้แจง ส่งโทรสาร ส่ง E-Mail แจ้ง หรือแจ้งตามที่ระบุไว้ ในวาระการประชุม	ลูกค้า ชุมชนใกล้เคียง บริษัทฯ ใกล้เคียง ผู้รับเหมา และ Supplier




	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือส่วนร่วม	Page: 9	Doc. No. PD-MG-006
---	-----------------	--	------------	--------------------

**ตารางแสดงรายละเอียดการสื่อสารในภาวะฉุกเฉินวิกฤต (Emergency/Crisis Communication)**

ผู้จัดการบริหารความต่อเนื่องทางธุรกิจ ดำเนินการแจ้งหัวหน้าทีมสื่อสารเพื่อดำเนินการสื่อสารข้อมูลให้กับพนักงานภายในและบุคคลหรือหน่วยงานภายนอก โดยข้อมูลที่จะสื่อสารต้องผ่านการอนุมัติจากผู้จัดการบริหารความต่อเนื่องทางธุรกิจ แล้วโดยมีรายละเอียดการสื่อสารดังนี้

ลำดับ	การดำเนินงาน	ช่องทางการสื่อสาร	ทีมสื่อสาร	ผู้รับการสื่อสาร	
				ภายใน	ภายนอก
1	คณะทำงานเตรียมพร้อมเปิดโทรศัพท์มือถือตลอดเวลา	- โทรศัพท์มือถือ - Line	-	บริหารและพนักงาน	-
2	การประกาศสถานการณ์ภาวะฉุกเฉิน	- Intercom - โทรศัพท์มือถือ - SMS	Emergency Commander	ผู้บริหารและพนักงาน	-
3	ประกาศใช้แผนความต่อเนื่องทางธุรกิจ	- Intercom - SMS - Line	OSM OSM Admin	ผู้บริหารและพนักงาน	โรงไฟฟ้าที่เกี่ยวข้องในการใช้กลยุทธ์
	กรณีเกิดเหตุสุดวิสัยตามที่อ้างถึงในสัญญาซื้อขายไฟฟ้ากับ กฟผต้องแจ้งอีกฝ่ายหนึ่งรับทราบทันทีที่สามารถทำได้ พร้อมทั้งแจ้งระยะเวลาที่จำเป็นจะต้องใช้ในการแก้ไขความเสียหาย	- DRCS (Web page)/โทรศัพท์	OM/OSM	-	EGAT
4	แนวทางและผลการปฏิบัติงาน - ความคืบหน้า - การควบคุมสถานการณ์ - ความเสียหาย - การกลับคืนสู่สภาพเดิม	- วิทยุสื่อสาร - โทรศัพท์ - E-mail - Line	OSM OSM Admin,PR Admin,PR	ผู้บริหารและพนักงาน	-
5	ประชุมหาหรือผู้เกี่ยวข้องเพื่อรวบรวมข้อมูลที่เกิดขึ้น	- ประชุม	BCM Committee	ผู้บริหารและพนักงาน	-



	Revision: 04	Title: ระเบียบปฏิบัติงาน เรื่อง การสื่อสาร, การให้บริการ และความร่วมมือร่วม	Page: 10 Doc. No. PD-MG-006
---	--------------	---	--------------------------------

ลำดับ	การดำเนินงาน	ช่องทางการสื่อสาร	ทีมสื่อสาร	ผู้รับการสื่อสาร	
				ภายใน	ภายนอก
	เพื่อเตรียมข้อมูลชี้แจงพนักงาน สื่อมวลชน และผู้ได้รับผลกระทบ				
6	สื่อสารให้รับทราบข้อเท็จจริงที่เกิดขึ้น รวมถึงการตัดสินใจของฝ่ายบริหาร และขอความร่วมมือต่างๆ	- Intercom - SMS - E-mail - ประชุม - Line	MD/ผู้จัดการความต่อเนื่องทางธุรกิจ	ผู้บริหารและพนักงาน	-
7	สื่อสารกับครอบครัวพนักงานที่ได้รับผลกระทบ	- HR			
8	สื่อสารกับหน่วยงานที่ได้รับผลกระทบ	ปฏิบัติตามข้อกำหนด crisis communication ขององค์กร	-	1. ลูกค้า (CS) ผู้นำชุมชน (PR) 3.Outsource (OM) /Supplier (จัดซื้อ) 4.หน่วยงานราชการ (รอกทม.) 5.การนิคมฯ 6.ตลาดหลักทรัพย์	
9	ชี้แจงข้อเท็จจริง เผยแพร่ให้ข่าวในสื่อต่าง รับทราบผลการปฏิบัติงาน	ปฏิบัติตามข้อกำหนด crisis communication ขององค์กร			นักข่าว

## 7 การควบคุมบันทึก

รหัสเอกสาร	ชื่อเอกสาร	ระยะเวลาจัดเก็บ	หน่วยงานที่รับผิดชอบ
FM-MG-016	ใบแจ้งข้อร้องเรียน / ข้อเสนอแนะ	3 ปี	Admin

## 8 เอกสารแนบท้าย

ไม่มี







# ABP-RAYONG

## กิจกรรมมวลชนสัมพันธ์

โรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) เป็นผู้ผลิตและจำหน่ายกระแสไฟฟ้ารายเล็ก (Small Power Producer, SPP) ตั้งอยู่ในนิคมอุตสาหกรรมอมตะซิตี้ โดยใช้ก๊าซธรรมชาติเป็นเชื้อเพลิงในการผลิตกระแสไฟฟ้า ส่งให้การไฟฟ้าฝ่ายผลิตแห่งประเทศไทย (EGAT) และโรงงานอุตสาหกรรมต่างๆ ภายในนิคมอุตสาหกรรมอมตะ ซิตี้ ระยอง ในปัจจุบัน กลุ่มโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) มีโรงไฟฟ้าทั้งหมด 5 แห่ง ดังนี้

อมตะ บี.กริม เพาเวอร์ (ระยอง) 1,2 จำกัด

- เปิดขายไฟเชิงพาณิชย์แล้ว

ตั้งอยู่ที่ 7/316-317 ม.6 ต.มาบยางพร อ.ปลวกแดง

จ.ระยอง 21140

- โครงการวางท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าเพื่ออุตสาหกรรมทั้ง

2 แห่ง ภายในนิคมอุตสาหกรรมอมตะซิตี้(ระยอง)

อมตะ บี.กริม เพาเวอร์ (ระยอง) 3,4 จำกัด

- เปิดขายไฟเชิงพาณิชย์แล้ว

ตั้งอยู่ที่ 7/491-2 ม.6 ต.มาบยางพร อ.ปลวกแดง

จ.ระยอง 21140

- โครงการท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าก๊าซธรรมชาติ ของ

บริษัท อมตะ บี.กริม เพาเวอร์ (ระยอง) 4 จำกัด

อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด

- เปิดขายไฟเชิงพาณิชย์แล้ว

ตั้งอยู่ที่ 7/507 ม.6 ต.มาบยางพร อ.ปลวกแดง

จ.ระยอง 21140

- โครงการท่อส่งก๊าซธรรมชาติไปยังโรงไฟฟ้าก๊าซธรรมชาติ บริษัท

อมตะ บี.กริม เพาเวอร์ (ระยอง) 5 จำกัด

ช่องทางการรับข้อมูลข่าวสาร



Scan Me



page : โรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง)

Amata B.Grimm Power Rayong


ฝ่ายมวลชนสัมพันธ์ นางสาวเปรมกมล กร่างสละ โทรศัพท์ 088-9169266

ติดตามข่าวสารของเราได้ที่ โรงไฟฟ้าอมตะ บี.กริม เพาเวอร์ ระยอง Amata B.Grimm Power Rayong



# Corporate Social Responsibility (CSR)

## เอกสารประชาสัมพันธ์รายละเอียดโครงการ (QR Code)

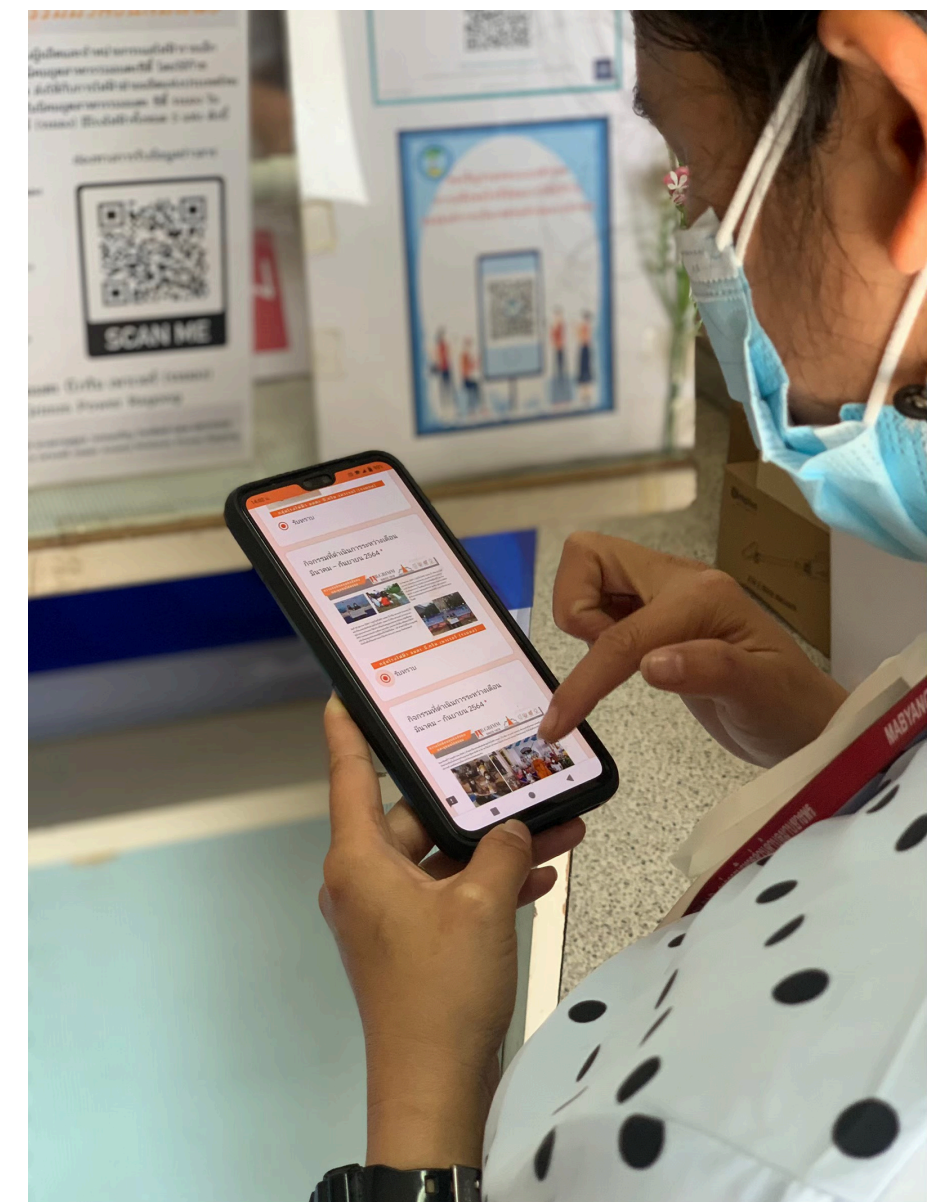

"สร้างพลังให้สังคมโลก ด้วยความโอบอ้อมอารี"



ภาคผนวก ข.7

---

แผนการเดินทางเครื่องของโครงการ



แผนเดินเครื่องประจำเดือน มกราคม 2567 ของโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) 5

	Date	HRSG unit	Start up period	Remark	HRSG unit	Shut down period	Remark
S	1-ม.ค.-24	GT51	17:15 -18:15	S/U	GT52	20:45 - 21:45	Reserve S/D
S	2-ม.ค.-24	GT52	17:15 -18:15	S/U	GT51	20:45 - 21:45	Reserve S/D
S	3-ม.ค.-24	GT51	17:15 -18:15	S/U			
	4-ม.ค.-24						
	5-ม.ค.-24				GT52	22:15 -23:15	Reserve S/D
	6-ม.ค.-24	GT52	12:45 - 13:45	S/U	GT51	22:15 -23:15	Reserve S/D
S	7-ม.ค.-24	GT51	17:15 -18:15	S/U	GT52	20:45 - 21:45	Reserve S/D
	8-ม.ค.-24	GT52	12:45 - 13:45	S/U	GT51	22:15 -23:15	Reserve S/D
	9-ม.ค.-24	GT51	12:45 - 13:45	S/U	GT51	22:15 -23:15	Reserve S/D
	10-ม.ค.-24	GT51	12:45 - 13:45	S/U	GT51	22:15 -23:15	Reserve S/D
	11-ม.ค.-24	GT51	12:45 - 13:45	S/U	GT51	22:15 -23:15	Reserve S/D
	12-ม.ค.-24	GT51	12:45 - 13:45	S/U	GT51	22:15 -23:15	Reserve S/D
	13-ม.ค.-24	GT51	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
S	14-ม.ค.-24	GT52	17:15 -18:15	S/U	GT51	20:45 - 21:45	Reserve S/D
	15-ม.ค.-24	GT51	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	16-ม.ค.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	17-ม.ค.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	18-ม.ค.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	19-ม.ค.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	20-ม.ค.-24	GT52	12:45 - 13:45	S/U			
S	21-ม.ค.-24						
	22-ม.ค.-24						
	23-ม.ค.-24						
	24-ม.ค.-24						
	25-ม.ค.-24						
	26-ม.ค.-24						
	27-ม.ค.-24						
S	28-ม.ค.-24						
	29-ม.ค.-24						
	30-ม.ค.-24						
	31-ม.ค.-24						

Remark \*S/U = Start up

\*S/D = Shut down

\*GT = Gas turbine

\*HRSG = Heat Recovery Steam Generator

\*ABPR = Amata B.Grimm Power (Rayong)

\*แผน S/D ที่ระบุเครื่อง GT ของโรงไฟฟ้า ABPR 5 ข้างต้นเป็นการวางแผน S/D GT

1 เครื่องในแต่ละวัน หลังจากช่วง Peak ตามแผนการรับซื้อไฟฟ้าในแต่ละเดือนของ กฟผ.

ทั้งนี้หมายเลข GT ที่จะทำการ S/D อาจมีการเปลี่ยนแปลงหมายเลขของ GT ที่จะ S/D



แผนเดินเครื่องประจำเดือน กุมภาพันธ์ 2567 ของโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) 5

	Date	HRS unit	Start up period	Remark	HRS unit	Shut down period	Remark
	1-ก.พ.-24				GT52	22:15 -23:15	Reserve S/D
	2-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	3-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT51	22:15 -23:15	Reserve S/D
S	4-ก.พ.-24	GT51	17:15 -18:15	S/U	GT52	20:45 - 21:45	Reserve S/D
	5-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	6-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	7-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	8-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	9-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	10-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
S	11-ก.พ.-24	GT52	17:15 -18:15	S/U	GT51	20:45 - 21:45	Reserve S/D
	12-ก.พ.-24	GT51	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	13-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	14-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	15-ก.พ.-24	GT52	12:45 - 13:45	S/U	GT52	22:15 -23:15	Reserve S/D
	16-ก.พ.-24	GT52	12:45 - 13:45	S/U			
	17-ก.พ.-24						
S	18-ก.พ.-24						
	19-ก.พ.-24						
	20-ก.พ.-24						
	21-ก.พ.-24						
	22-ก.พ.-24						
	23-ก.พ.-24						
	24-ก.พ.-24						
S	25-ก.พ.-24						
	26-ก.พ.-24						
	27-ก.พ.-24						
	28-ก.พ.-24						
	29-ก.พ.-24						

Remark \*S/U = Start up

\*S/D = Shut down

\*GT = Gas turbine

\*HRS = Heat Recovery Steam Generator

\*ABPR = Amata B.Grimm Power (Rayong)

\*แผน S/D ที่ระบุเครื่อง GT ของโรงไฟฟ้า ABPR 5 ข้างต้นเป็นการวางแผน S/D GT

1 เครื่องในแต่ละวัน หลังจากช่วง Peak ตามแผนการรับซื้อไฟฟ้าในแต่ละเดือนของ กฟผ.

ทั้งนี้หมายเลข GT ที่จะทำการ S/D อาจมีการเปลี่ยนแปลงหมายเลขของ GT ที่จะ S/D



แผนเดินเครื่องประจำเดือน มีนาคม 2567 ของโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) 5

	Date	HRS SG unit	Start up period	Remark	HRS SG unit	Shut down period	Remark
	1-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	2-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
S	3-มี.ค.-24	GT52	17:45 - 18:45	S/U	GT51	22:30 - 23:00	Reserve S/D
	4-มี.ค.-24	GT51	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	5-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	6-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	7-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	8-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	9-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
S	10-มี.ค.-24	GT52	17:45 - 18:45	S/U	GT51	22:30 - 23:00	Reserve S/D
	11-มี.ค.-24	GT51	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	12-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	13-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	14-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	15-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	16-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
S	17-มี.ค.-24	GT52	17:45 - 18:45	S/U	GT51	22:30 - 23:00	Reserve S/D
	18-มี.ค.-24	GT51	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	19-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	20-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	21-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	22-มี.ค.-24	GT52	08:15 - 9:15	S/U	GT52	23:45 - 00:45	Reserve S/D
	23-มี.ค.-24	GT52	08:15 - 9:15	S/U			
S	24-มี.ค.-24						
	25-มี.ค.-24						
	26-มี.ค.-24						
	27-มี.ค.-24						
	28-มี.ค.-24						
	29-มี.ค.-24						
	30-มี.ค.-24						
S	31-มี.ค.-24						

Remark \*S/U = Start up

\*S/D = Shut down

\*GT = Gas turbine

\*HRS = Heat Recovery Steam Generator

\*ABPR = Amata B.Grimm Power (Rayong)

\*แผน S/D ที่ระบุเครื่อง GT ของโรงไฟฟ้า ABPR 5 ข้างต้นเป็นการวางแผน S/D GT

1 เครื่องในแต่ละวัน หลังจากช่วง Peak ตามแผนการรับซื้อไฟฟ้าในแต่ละเดือนของ กฟผ.

ทั้งนี้หมายเลข GT ที่จะทำการ S/D อาจมีการเปลี่ยนแปลงหมายเลขของ GT ที่จะ S/D



แผนเดินเครื่องประจำเดือน เมษายน 2567 ของโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) 5

	Date	HRS G unit	Start up period	Remark	HRS G unit	Shut down period	Remark
	1-เม.ย.-24				GT52	24:00-01:00	Reserve S/D
	2-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
	3-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
	4-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
	5-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
	6-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT51	24:00-01:00	Reserve S/D
S	7-เม.ย.-24						
	8-เม.ย.-24	GT51	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
	9-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
	10-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
	11-เม.ย.-24	GT52	07:30 - 08:30	S/U	GT52	24:00-01:00	Reserve S/D
S	12-เม.ย.-24	GT52	17:30 - 18:30	S/U	GT51	23:00 - 24:00	Reserve S/D
S	13-เม.ย.-24	GT51	17:30 - 18:30	S/U	GT52	23:00 - 24:00	Reserve S/D
S	14-เม.ย.-24	GT52	17:30 - 18:30	S/U	GT51	23:00 - 24:00	Reserve S/D
S	15-เม.ย.-24	GT51	17:30 - 18:30	S/U	GT52	23:00 - 24:00	Reserve S/D
S	16-เม.ย.-24	GT52	17:30 - 18:30	S/U	GT51	23:00 - 24:00	Reserve S/D
S	17-เม.ย.-24	GT51	17:30 - 18:30	S/U			
	18-เม.ย.-24						
	19-เม.ย.-24						
	20-เม.ย.-24						
S	21-เม.ย.-24						
	22-เม.ย.-24						
	23-เม.ย.-24						
	24-เม.ย.-24						
	25-เม.ย.-24						
	26-เม.ย.-24						
	27-เม.ย.-24						
S	28-เม.ย.-24						
	29-เม.ย.-24						
	30-เม.ย.-24						

Remark \*S/U = Start up

\*S/D = Shut down

\*GT = Gas turbine

\*HRS G = Heat Recovery Steam Generator

\*ABPR = Amata B.Grimm Power (Rayong)

\*แผน S/D ที่ระบุเครื่อง GT ของโรงไฟฟ้า ABPR 5 ข้างต้นเป็นการวางแผน S/D GT

1 เครื่องในแต่ละวัน หลังจากช่วง Peak ตามแผนการรับซื้อไฟฟ้าในแต่ละเดือนของ กฟผ.

ทั้งนี้หมายเลข GT ที่จะทำการ S/D อาจมีการเปลี่ยนแปลงหมายเลขของ GT ที่จะ S/D



แผนเดินเครื่องประจำเดือน พฤษภาคม 2567 ของโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) 5

	Date	HRS G unit	Start up period	Remark	HRS G unit	Shut down period	Remark
S	1-พ.ค.-24			S/U	GT51	22:00 - 23:00	Reserve S/D
	2-พ.ค.-24	GT51	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	3-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	4-พ.ค.-24	GT52	08:45-09:45	S/U	GT51	23:30 - 00:30	Reserve S/D
S	5-พ.ค.-24	GT51	18:00-19:00	S/U	GT52	22:00 - 23:00	Reserve S/D
	6-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	7-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	8-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	9-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	10-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	11-พ.ค.-24	GT52	08:45-09:45	S/U	GT51	23:30 - 00:30	Reserve S/D
S	12-พ.ค.-24	GT51	18:00-19:00	S/U	GT52	22:00 - 23:00	Reserve S/D
	13-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	14-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	15-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	16-พ.ค.-24	GT52	08:45-09:45	S/U	GT52	23:30 - 00:30	Reserve S/D
	17-พ.ค.-24	GT52	08:45-09:45	S/U			
	18-พ.ค.-24						
S	19-พ.ค.-24						
	20-พ.ค.-24						
	21-พ.ค.-24						
	22-พ.ค.-24						
	23-พ.ค.-24						
	24-พ.ค.-24						
	25-พ.ค.-24						
S	26-พ.ค.-24						
	27-พ.ค.-24						
	28-พ.ค.-24						
	29-พ.ค.-24						
	30-พ.ค.-24						
	31-พ.ค.-24						

Remark \*S/U = Start up

\*S/D = Shut down

\*GT = Gas turbine

\*HRS G = Heat Recovery Steam Generator

\*ABPR = Amata B.Grimm Power (Rayong)

\*แผน S/D ที่ระบุเครื่อง GT ของโรงไฟฟ้า ABPR 5 ข้างต้นเป็นการวางแผน S/D GT

1 เครื่องในแต่ละวัน หลังจากช่วง Peak ตามแผนการรับซื้อไฟฟ้าในแต่ละเดือนของ กฟผ.

ทั้งนี้หมายเลข GT ที่จะทำการ S/D อาจมีการเปลี่ยนแปลงหมายเลขของ GT ที่จะ S/D



แผนเดินเครื่องประจำเดือนมิถุนายน 2567 ของโรงไฟฟ้า อมตะ บี.กริม เพาเวอร์ (ระยอง) 5

	Date	HRSG unit	Start up period	Remark	HRSG unit	Shut down period	Remark
	1-มิ.ย.-24	-	-	-	-	-	-
S	2-มิ.ย.-24	-	-	-	-	-	-
	3-มิ.ย.-24	-	-	-	-	-	-
	4-มิ.ย.-24	-	-	-	-	-	-
	5-มิ.ย.-24	-	-	-	-	-	-
	6-มิ.ย.-24	-	-	-	-	-	-
	7-มิ.ย.-24	-	-	-	-	-	-
	8-มิ.ย.-24	-	-	-	-	-	-
S	9-มิ.ย.-24	-	-	-	-	-	-
	10-มิ.ย.-24	-	-	-	-	-	-
	11-มิ.ย.-24	-	-	-	-	-	-
	12-มิ.ย.-24	-	-	-	-	-	-
	13-มิ.ย.-24	-	-	-	-	-	-
	14-มิ.ย.-24	-	-	-	-	-	-
	15-มิ.ย.-24	-	-	S/U	GT51	23:15 - 00:15	Reserve S/D
S	16-มิ.ย.-24	GT51	17:45-18:45	S/U	GT52	22:00 - 23:00	Reserve S/D
	17-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	18-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	19-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	20-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	21-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	22-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
S	23-มิ.ย.-24	GT52	17:45-18:45	S/U	GT51	22:00 - 23:00	Reserve S/D
	24-มิ.ย.-24	GT51	08:15-09:15	S/U	GT51	23:15 - 00:15	Reserve S/D
	25-มิ.ย.-24	GT51	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	26-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	27-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	28-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
	29-มิ.ย.-24	GT52	08:15-09:15	S/U	GT52	23:15 - 00:15	Reserve S/D
S	30-มิ.ย.-24	-	-	-	-	-	-

Remark    \*S/U = Start up  
                  \*S/D = Shut down  
                  \*GT = Gas turbine  
                  \*HRSG = Heat Recovery Steam Generator  
                  \*ABPR = Amata B.Grimm Power (Rayong)  
                  \*แผน S/D ที่ระบุเครื่อง GT ของโรงไฟฟ้า ABPR 5 ข้างต้นเป็นการวางแผน S/D GT  
                  1 เครื่องในแต่ละวัน หลังจากช่วง Peak ตามแผนการรับซื้อไฟฟ้าในแต่ละเดือนของ กฟผ.  
                  ทั้งนี้หมายเลข GT ที่จะทำการ S/D อาจมีการเปลี่ยนแปลงหมายเลขของ GT ที่จะ S/D



ภาคผนวก ข.8

---

บันทึกผล CEMs



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 01/01/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
01/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 18:00	Shutdown	0.5	Shutdown	12.85	Shutdown	Shutdown	Shutdown
01/01/2024 19:00	14.12	0.31	433281.9	35.53	0	0	22.3
01/01/2024 20:00	14.1	0.27	426891.3	35.11	0	0	22.6
01/01/2024 21:00	14.1	0.27	428145.7	35.35	0	0	22.5
01/01/2024 22:00	14.11	0.32	475998.9	40.88	0	0	28.5
01/01/2024 23:00	13.98	0.36	534411.8	48.93	0	0	31.6
01/01/2024 24:00	13.97	0.32	534306.6	49.01	0	0	31.7
Minimum	13.97	0.01	426891.3	0	0	0	22.3
MinDate		01/01/2024 1:00:00	01/01/2024 20:00:00	01/01/2024 1:00:00	01/01/2024 19:00:00	01/01/2024 19:00:00	01/01/2024 19:00:00
Maximum	14.12	0.5	534411.8	49.01	0	0	31.7
MaxDate	01/01/2024 19:00:00	01/01/2024 18:00:00	01/01/2024 23:00:00		01/01/2024 19:00:00	01/01/2024 19:00:00	
Avg	14.06	0.11	472172.8	10.74	0	0	26.5
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0.1	0.2	51478.1	18.2	0	0	4.6
Site ABPR52 Daily: 01/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
01/01/2024 01:00	14.44	0.32	538282.1	49.3	0.3	0.4	33.8
01/01/2024 02:00	14.43	0.17	537895.1	49.28	0.4	0.5	33.9
01/01/2024 03:00	14.41	0.27	536859.1	49.27	0.1	0.5	34
01/01/2024 04:00	14.41	0.4	536627.4	49.25	0.1	0.5	34.2
01/01/2024 05:00	14.4	0.5	537559.2	49.27	0.1	0.5	34
01/01/2024 06:00	14.42	0.46	538365.8	49.32	0	0.6	34.1
01/01/2024 07:00	14.41	0.52	539586.3	49.37	0	0.6	33.9
01/01/2024 08:00	14.4	0.55	538641.4	49.27	0	0.6	34
01/01/2024 09:00	14.41	0.54	536894.6	49.17	0	0.5	34.6
01/01/2024 10:00	14.43	0.54	536467.9	49.15	0	0.5	35
01/01/2024 11:00	14.47	0.7	536284.8	49.15	0	0.4	35.2
01/01/2024 12:00	14.5	0.65	534958.8	49.14	0.1	0.4	35.5
01/01/2024 13:00	14.47	0.53	534600.4	49.06	0.1	0.3	35.7
01/01/2024 14:00	14.5	0.58	535668.1	49.1	0.1	0.4	35.9
01/01/2024 15:00	14.48	0.42	534650.3	49.09	0.1	0.4	36
01/01/2024 16:00	14.45	0.22	533469.8	48.9	0	0.4	35.4
01/01/2024 17:00	14.45	0.29	533495.8	48.93	0	0.4	35.1
01/01/2024 18:00	14.48	0.37	509314.9	45.41	0	0.4	30.4
01/01/2024 19:00	14.43	0.44	425251.8	35.68	0	0.4	25.5
01/01/2024 20:00	14.48	0.55	422795.7	35.2	0	0.4	26.3
01/01/2024 21:00	14.47	0.5	424149.8	35.43	0	0.4	26.2
01/01/2024 22:00	Shutdown	0.79	Shutdown	12.12	Shutdown	Shutdown	Shutdown
01/01/2024 23:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
01/01/2024 24:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.4	0.04	422795.7	0	0	0.3	25.5
MinDate	01/01/2024 5:00:00	01/01/2024 23:00:00	01/01/2024 20:00:00	01/01/2024 23:00:00	01/01/2024 6:00:00	01/01/2024 13:00:00	01/01/2024 19:00:00
Maximum	14.5	0.79	539586.3	49.37	0.4	0.6	36
MaxDate	01/01/2024 12:00:00	01/01/2024 22:00:00	01/01/2024 7:00:00	01/01/2024 7:00:00	01/01/2024 2:00:00	01/01/2024 6:00:00	01/01/2024 15:00:00
Avg	14.44	0.43	519134.3	41.66	0.1	0.5	33.3
Num	21	24	21	24	21	21	21
Data[%]	88	100	88	100	88	88	88
STD	0	0.2	40238.8	15.4	0.1	0.1	3.3
Site ABPR51 Daily: 02/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
02/01/2024 01:00	13.99	0.28	535321.4	49.11	0	0	31.7
02/01/2024 02:00	14.01	0.37	536600.8	49.13	0	0	31.6
02/01/2024 03:00	13.98	0.42	535938.9	49.13	0	0	31.3
02/01/2024 04:00	14.01	0.34	537110.6	49.15	0	0	31.3
02/01/2024 05:00	14.03	0.33	537462.5	49.15	0	0	31.6
02/01/2024 06:00	14.03	0.39	538038.1	49.24	0	0	31.7
02/01/2024 07:00	14.03	0.45	537635.1	49.18	0	0	31.5
02/01/2024 08:00	14.03	0.44	537535.9	49.18	0	0	31.5
02/01/2024 09:00	13.97	0.5	534695	49.09	0	0	32.1
02/01/2024 10:00	13.98	0.63	533840.8	48.83	0	0	31.8
02/01/2024 11:00	14.02	0.63	533397.5	48.75	0	0	32.1
02/01/2024 12:00	14.03	0.36	533420.5	48.74	0	0	32.4
02/01/2024 13:00	14.03	0.49	533750.1	48.79	0	0	32.9
02/01/2024 14:00	14.03	0.25	534091.9	48.84	0	0	33.4
02/01/2024 15:00	14.03	0.31	533941.1	48.8	0	0	33.2
02/01/2024 16:00	14.03	0.4	534729	48.86	0	0	33.3
02/01/2024 17:00	14.02	0.34	533821.2	48.8	0	0	32.9
02/01/2024 18:00	14.04	0.24	495369.8	43.75	0	0	27.8
02/01/2024 19:00	14.05	0.29	448091	37.99	0	0	20.6
02/01/2024 20:00	14.07	0.32	447348.8	37.73	0	0	21.5
02/01/2024 21:00	14.09	0.3	445830.1	37.53	0	0	22.3
02/01/2024 22:00	Shutdown	0.41	Shutdown	13.46	Shutdown	Shutdown	Shutdown
02/01/2024 23:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 24:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	13.97	0.01	445830.1	0	0	0	20.6
MinDate	01/02/2024 9:00:00	01/02/2024 23:00:00	01/02/2024 21:00:00	01/02/2024 23:00:00	01/02/2024 1:00:00	01/02/2024 1:00:00	01/02/2024 19:00:00
Maximum	14.09	0.63	538038.1	49.24	0	0	33.4
MaxDate	01/02/2024 21:00:00	01/02/2024 10:00:00	01/02/2024 6:00:00	01/02/2024 6:00:00	01/02/2024 1:00:00	01/02/2024 1:00:00	01/02/2024 14:00:00
Avg	14.02	0.35	520855.8	41.8	0	0	30.4
Num	21	24	21	24	21	21	21



Data[%]	88	100	88	100	88	88	88
STD	0	0.1	32096.4	15.1	0	0	3.9
Site ABPR52 Daily: 02/01/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
02/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 04:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 05:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 06:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 10:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 11:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 12:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 13:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 14:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 15:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 16:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 17:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
02/01/2024 18:00	Shutdown	0.58	Shutdown	16.37	Shutdown	Shutdown	Shutdown
02/01/2024 19:00	14.53	0.17	454180.6	38.06	0	0.3	25.1
02/01/2024 20:00	14.47	0.31	448164	37.81	0	0.3	25.5
02/01/2024 21:00	14.47	0.38	445119.4	37.61	0	0.4	25.6
02/01/2024 22:00	14.48	0.47	479918.9	41.57	0.1	0.4	31.7
02/01/2024 23:00	14.4	0.5	537736.6	49.19	0.1	0.4	34.9
02/01/2024 24:00	14.42	0.48	538187.6	49.28	0.3	0.5	34.9
Minimum	14.4	0	445119.4	0	0	0.3	25.1
MinDate	01/02/2024 23:00:00	01/02/2024 7:00:00	01/02/2024 21:00:00	01/02/2024 1:00:00	01/02/2024 19:00:00	01/02/2024 19:00:00	01/02/2024 19:00:00
Maximum	14.53	0.58	538187.6	49.28	0.3	0.5	34.9
MaxDate	01/02/2024 19:00:00	01/02/2024 18:00:00					01/02/2024 23:00:00
Avg	14.46	0.15	483884.5	11.25	0.1	0.4	29.6
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.2	43648	18.8	0.1	0.1	4.8
Site ABPR51 Daily: 03/01/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
03/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/01/2024 18:00	Shutdown	0.51	Shutdown	20.21	Shutdown	Shutdown	Shutdown
03/01/2024 19:00	14.27	0.25	479159.5	40.18	0	0	22.3
03/01/2024 20:00	14.22	0.59	474890.8	40.17	0	0	22.4
03/01/2024 21:00	14.17	0.48	466972.8	39.54	0	0	22.3
03/01/2024 22:00	14.32	0.5	395513.7	29.5	0	0	30.4
03/01/2024 23:00	14.38	0.44	369722.4	25.99	0	0	33.2
03/01/2024 24:00	14.36	0.18	369522.1	26.02	0	0	33.1
Minimum	14.17	0.01	369522.1	0	0	0	22.3
MinDate	01/03/2024 21:00:00	01/03/2024 1:00:00		01/03/2024 1:00:00	01/03/2024 19:00:00	01/03/2024 19:00:00	01/03/2024 19:00:00
Maximum	14.38	0.59	479159.5	40.18	0	0	33.2
MaxDate	01/03/2024 23:00:00	01/03/2024 20:00:00	01/03/2024 19:00:00	01/03/2024 19:00:00	01/03/2024 19:00:00	01/03/2024 19:00:00	01/03/2024 23:00:00
Avg	14.29	0.13	425963.5	9.23	0	0	27.3
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0.1	0.2	53256.8	15.3	0	0	5.5
Site ABPR52 Daily: 03/01/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
03/01/2024 01:00	14.44	0.59	538952.1	49.32	0.3	0.5	34.7
03/01/2024 02:00	14.44	0.54	538874.8	49.32	0.4	0.6	34.5
03/01/2024 03:00	14.44	0.53	539658.9	49.35	0.5	0.6	34.4
03/01/2024 04:00	14.41	0.48	540171.9	49.37	0.2	0.6	34.4
03/01/2024 05:00	14.43	0.44	540786.3	49.39	0.2	0.7	34.2
03/01/2024 06:00	14.41	0.38	541349.9	49.42	0	0.7	34.4
03/01/2024 07:00	14.41	0.35	542565.4	49.39	0	0.7	34.5
03/01/2024 08:00	14.45	0.27	541875.8	49.38	0	0.7	34.7
03/01/2024 09:00	14.4	0.38	540850.1	50	0.1	0.6	38.2
03/01/2024 10:00	14.43	0.24	539253.1	49.78	0	0.5	38.3
03/01/2024 11:00	14.46	0.14	538708.4	49.67	0.1	0.5	38.4
03/01/2024 12:00	14.48	0.21	538730.8	49.65	0.2	0.4	38.4
03/01/2024 13:00	14.54	0.43	538945.3	49.65	0.2	0.4	38.7
03/01/2024 14:00	14.57	0.36	539100.9	49.57	0.3	0.4	38.6
03/01/2024 15:00	14.56	0.37	538843.6	49.58	0.2	0.3	38.7
03/01/2024 16:00	14.54	0.57	538761.1	49.56	0.2	0.3	38.7
03/01/2024 17:00	14.44	0.32	536047.5	49.21	0	0.2	37.2
03/01/2024 18:00	14.44	0.44	501879.6	44.63	0	0.2	33.4
03/01/2024 19:00	14.46	0.43	468534.4	40.26	0	0.2	24.8
03/01/2024 20:00	14.49	0.43	471288.2	40.25	0	0.3	25.5
03/01/2024 21:00	14.47	0.37	464622.7	39.64	0	0.3	25.5
03/01/2024 22:00	14.63	0.44	390805.3	29.58	0	0.4	31.7
03/01/2024 23:00	14.7	0.4	364427.5	26.04	0	0.5	32.6
03/01/2024 24:00	14.71	0.35	364452.8	26.08	0	0.5	32.3
Minimum	14.4	0.14	364427.5	26.04	0	0.2	24.8
MinDate	01/03/2024 9:00:00	01/03/2024 11:00:00	01/03/2024 23:00:00	01/03/2024 23:00:00	01/03/2024 6:00:00	01/03/2024 17:00:00	01/03/2024 19:00:00
Maximum	14.71	0.59	542565.4	50	0.5	0.7	38.7
MaxDate		01/03/2024 1:00:00	01/03/2024 7:00:00	01/03/2024 9:00:00	01/03/2024 3:00:00	01/03/2024 5:00:00	01/03/2024 13:00:00
Avg	14.49	0.39	508312	45.34	0.1	0.5	34.5



Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	57787.4	7.7	0.1	0.2	4.2
Site ABPR51 Daily: 04/01/2024 Type: AVG							
Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
04/01/2024 01:00	14.36	0.27	368919.5	25.92	0	0	33.9
04/01/2024 02:00	14.34	0.15	369414.3	26.14	0	0	34
04/01/2024 03:00	14.35	0.13	369949.9	26.25	0	0	34.5
04/01/2024 04:00	14.35	0.18	369382.1	26.13	0	0	35.7
04/01/2024 05:00	14.35	0.19	369393.7	26.16	0	0	36
04/01/2024 06:00	14.3	0.22	376124.7	27.35	0	0	30.7
04/01/2024 07:00	14.33	0.3	373681.9	26.93	0	0	31.7
04/01/2024 08:00	14.37	0.32	371550.2	26.49	0	0	34
04/01/2024 09:00	14.35	0.22	377180.6	27.47	0	0	29.1
04/01/2024 10:00	14.3	0.04	386117.1	29.08	0	0	27.6
04/01/2024 11:00	14.29	0.18	389580.7	29.66	0	0	28.6
04/01/2024 12:00	14.28	0.25	393226.3	30.13	0	0	29.4
04/01/2024 13:00	14.29	0.12	392324.6	30.03	0	0	29.4
04/01/2024 14:00	14.35	0.26	443728.7	35.78	0	0	28.3
04/01/2024 15:00	14.31	0.12	464688.7	38.71	0	0	25.3
04/01/2024 16:00	14.31	0.11	474759.6	39.63	0	0	24.1
04/01/2024 17:00	14.27	0.17	465096	38.87	0	0	24.1
04/01/2024 18:00	14.23	0.28	463120.5	38.79	0	0	23.9
04/01/2024 19:00	14.21	0.33	462506.8	38.91	0	0	23.9
04/01/2024 20:00	14.16	0.33	455627.4	38.33	0	0	23.5
04/01/2024 21:00	14.15	0.28	450594.1	37.88	0	0	23.4
04/01/2024 22:00	14.15	0.31	455427	38.4	0	0	23.1
04/01/2024 23:00	14.17	0.26	439280.8	36.13	0	0	24.3
04/01/2024 24:00	14.18	0.13	390092.1	29.96	0	0	25.6
Minimum	14.15	0.04	368919.5	25.92	0	0	23.1
MinDate	01/04/2024 21:00:00	01/04/2024 10:00:00	01/04/2024 1:00:00	01/04/2024 1:00:00	01/04/2024 1:00:00	01/04/2024 1:00:00	01/04/2024 22:00:00
Maximum	14.37	0.33	474759.6	39.63	0	0	36
MaxDate	01/04/2024 8:00:00	01/04/2024 19:00:00	01/04/2024 16:00:00	01/04/2024 16:00:00	01/04/2024 1:00:00	01/04/2024 1:00:00	01/04/2024 5:00:00
Avg	14.28	0.21	411323.6	32.05	0	0	28.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	41063.5	5.5	0	0	4.4
Site ABPR52 Daily: 04/01/2024 Type: AVG							

Date & Time	52HRSG_O2	52HRSG_DUST	52HRSG_FLOW	GT_LOAD	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
04/01/2024 01:00	14.71	0.33	363905	25.99	0	0.6	33.4
04/01/2024 02:00	14.69	0.2	365017	26.21	0	0.6	33
04/01/2024 03:00	14.71	0.17	365533	26.31	0.1	0.7	33.4
04/01/2024 04:00	14.71	0.27	364597.6	26.19	0	0.7	34.7
04/01/2024 05:00	14.7	0.26	364640.5	26.22	0	0.7	35.2
04/01/2024 06:00	14.62	0.32	371092.6	27.42	0	0.7	30.3
04/01/2024 07:00	14.63	0.24	368513.1	26.99	0	0.7	31.3
04/01/2024 08:00	14.66	0.23	366760.2	26.56	0	0.6	33.3
04/01/2024 09:00	14.67	0.33	372941.5	27.53	0	0.6	28.7
04/01/2024 10:00	14.66	0.34	382718.9	29.16	0	0.5	28.6
04/01/2024 11:00	14.67	0.54	386270.7	29.72	0.1	0.5	29.7
04/01/2024 12:00	14.74	0.63	389796	30.2	0.2	0.4	30.6
04/01/2024 13:00	14.76	0.36	389498.2	30.1	0.1	0.4	30.6
04/01/2024 14:00	14.84	0.51	440155	35.82	0.2	0.5	29
04/01/2024 15:00	14.82	0.21	461740.7	38.8	0.1	0.5	27.3
04/01/2024 16:00	14.79	0.13	470435.7	39.72	0.2	0.5	26.6
04/01/2024 17:00	14.71	0.15	461446.5	38.96	0.1	0.5	26.9
04/01/2024 18:00	14.63	0.21	459946.1	38.89	0	0.5	26.9
04/01/2024 19:00	14.59	0.29	459708.9	38.98	0	0.4	26.8
04/01/2024 20:00	14.49	0.36	453186.8	38.42	0	0.5	26.4
04/01/2024 21:00	14.48	0.55	448520	37.96	0	0.5	26.3
04/01/2024 22:00	14.5	0.55	454084.6	38.49	0	0.5	25.9
04/01/2024 23:00	14.51	0.52	437070.4	36.22	0	0.6	26.9
04/01/2024 24:00	14.52	0.45	386668.8	30.02	0	0.6	27.3
Minimum	14.48	0.13	363905	25.99	0	0.4	25.9
MinDate	01/04/2024 21:00:00	01/04/2024 16:00:00	01/04/2024 1:00:00	01/04/2024 1:00:00	01/04/2024 1:00:00	01/04/2024 12:00:00	01/04/2024 22:00:00
Maximum	14.84	0.63	470435.7	39.72	0.2	0.7	35.2
MaxDate	01/04/2024 14:00:00	01/04/2024 12:00:00	01/04/2024 16:00:00	01/04/2024 16:00:00	01/04/2024 12:00:00	01/04/2024 3:00:00	01/04/2024 5:00:00
Avg	14.66	0.34	407677	32.12	0	0.6	29.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	41780.6	5.5	0.1	0.1	3
Site ABPR51 Daily: 05/01/2024 Type: AVG							

Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
05/01/2024 01:00	14.19	0.17	388017.2	29.6	0	0	25.3
05/01/2024 02:00	14.19	0.28	387065.8	29.51	0	0	25.4
05/01/2024 03:00	14.17	0.23	388228.5	29.72	0	0	25.5
05/01/2024 04:00	14.18	0.19	386090.6	29.35	0	0	25.1
05/01/2024 05:00	14.18	0.16	386183.1	29.42	0	0	25.4
05/01/2024 06:00	14.22	0.17	384179.6	28.98	0	0	25.8
05/01/2024 07:00	14.25	0.24	385378.3	29.06	0	0	26.9
05/01/2024 08:00	14.24	0.05	386732.1	29.31	0	0	27.2
05/01/2024 09:00	14.17	0.07	399498.4	31.51	0	0	28.5
05/01/2024 10:00	14.19	0.05	400860.1	31.58	0	0	28.8
05/01/2024 11:00	14.22	0.18	401376.7	31.49	0	0	28.5
05/01/2024 12:00	14.24	0.15	402171.3	31.5	0	0	28.6
05/01/2024 13:00	14.28	0.38	396861.6	30.65	0	0	30.3
05/01/2024 14:00	14.38	0.31	450850.1	36.33	0	0	28
05/01/2024 15:00	14.36	0.36	474703.8	39.33	0	0	25.3
05/01/2024 16:00	14.33	0.16	470673.3	39.14	0	0	24.9
05/01/2024 17:00	14.26	0.14	465284.5	38.94	0	0	23.5
05/01/2024 18:00	14.22	0.29	459763.3	38.55	0	0	23.3
05/01/2024 19:00	14.21	0.33	462213.8	38.9	0	0	23.4
05/01/2024 20:00	14.16	0.33	462039.5	39.04	0	0	22.7
05/01/2024 21:00	14.14	0.28	455445.6	38.48	0	0	22.7
05/01/2024 22:00	14.15	0.27	456012.4	38.6	0	0	23
05/01/2024 23:00	14.19	0.39	433204.4	34.5	0	0	26.7
05/01/2024 24:00	14.23	0.35	492479.2	42.42	0	0	23.2
Minimum	14.14	0.05	384179.6	28.98	0	0	22.7
MinDate	01/05/2024 21:00:00	01/05/2024 8:00:00	01/05/2024 6:00:00	01/05/2024 6:00:00	01/05/2024 1:00:00	01/05/2024 1:00:00	01/05/2024 20:00:00
Maximum	14.38	0.39	492479.2	42.42	0	0	30.3
MaxDate	01/05/2024 14:00:00	01/05/2024 23:00:00			01/05/2024 1:00:00	01/05/2024 1:00:00	01/05/2024 13:00:00



Avg	14.22	0.23	423971.4	34	0	0	25.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	37463.7	4.5	0	0	2.2
Site ABPR52 Daily: 05/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
05/01/2024 01:00	14.55	0.53	384462.7	29.67	0	0.6	26.8
05/01/2024 02:00	14.55	0.52	384339	29.58	0	0.7	26.6
05/01/2024 03:00	14.54	0.39	384878.2	29.8	0	0.7	26.9
05/01/2024 04:00	14.53	0.34	382664.3	29.42	0	0.8	26.4
05/01/2024 05:00	14.53	0.3	383372.5	29.5	0	0.8	26.6
05/01/2024 06:00	14.56	0.24	380729.9	29.05	0	0.8	26.7
05/01/2024 07:00	14.58	0.18	381479.4	29.14	0	0.8	27.6
05/01/2024 08:00	14.55	0.1	382516.2	29.39	0	0.7	28.2
05/01/2024 09:00	14.5	0.14	396417.3	31.58	0	0.7	30.6
05/01/2024 10:00	14.55	0.16	397867.3	31.65	0	0.6	31.1
05/01/2024 11:00	14.59	0.31	397694.2	31.58	0	0.6	31
05/01/2024 12:00	14.64	0.27	398381.3	31.56	0	0.5	30.6
05/01/2024 13:00	14.72	0.42	393497.3	30.73	0.1	0.5	31.9
05/01/2024 14:00	14.81	0.34	446420.2	36.41	0.1	0.5	29.4
05/01/2024 15:00	14.78	0.44	469098.3	39.42	0.1	0.5	27.7
05/01/2024 16:00	14.79	0.32	466687.9	39.23	0.2	0.5	27.4
05/01/2024 17:00	14.7	0.19	462149.2	39.01	0	0.5	26.6
05/01/2024 18:00	14.56	0.29	456765.6	38.65	0	0.4	26.5
05/01/2024 19:00	14.52	0.41	459124.3	39	0	0.4	26.5
05/01/2024 20:00	14.48	0.37	459984	39.13	0	0.4	25.8
05/01/2024 21:00	14.46	0.36	453480.2	38.56	0	0.4	25.7
05/01/2024 22:00	14.51	0.36	455461.3	38.68	0	0.5	25.6
05/01/2024 23:00	14.48	0.62	442966.6	32.52	0	0.5	25.8
05/01/2024 24:00	Shutdown	0.36	Shutdown	0.28	Shutdown	Shutdown	Shutdown
Minimum	14.46	0.1	380729.9	0.28	0	0.4	25.6
MinDate	01/05/2024 21:00:00	01/05/2024 8:00:00	01/05/2024 6:00:00		01/05/2024 1:00:00	01/05/2024 18:00:00	01/05/2024 22:00:00
Maximum	14.81	0.62	469098.3	39.42	0.2	0.8	31.9
MaxDate	01/05/2024 14:00:00	01/05/2024 23:00:00	01/05/2024 15:00:00	01/05/2024 15:00:00	01/05/2024 16:00:00	01/05/2024 4:00:00	01/05/2024 13:00:00
Avg	14.59	0.33	418279.9	32.23	0	0.6	27.7
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	35695.4	8	0.1	0.1	2
Site ABPR51 Daily: 06/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
06/01/2024 01:00	14.22	0.15	492850.3	42.8	0	0	22.5
06/01/2024 02:00	14.21	0.19	493038.7	42.84	0	0	22.6
06/01/2024 03:00	14.2	0.29	492588.4	42.87	0	0	22.7
06/01/2024 04:00	14.2	0.16	492683.1	42.88	0	0	22.5
06/01/2024 05:00	14.2	0.21	493061.8	42.88	0	0	22.6
06/01/2024 06:00	14.22	0.38	493204.5	42.87	0	0	23.3
06/01/2024 07:00	14.23	0.39	493386.8	42.84	0	0	23.9
06/01/2024 08:00	14.26	0.31	493477.1	42.79	0	0	24.3
06/01/2024 09:00	14.29	0.18	496462.7	42.79	0	0	24.4
06/01/2024 10:00	14.34	0.06	499794.4	42.77	0	0	24.6
06/01/2024 11:00	14.38	0.31	503914.2	42.84	0	0	25.5
06/01/2024 12:00	14.41	0.23	505471.9	42.82	0	0	26.4
06/01/2024 13:00	14.4	0.19	499534.4	42.16	0	0	27.2
06/01/2024 14:00	14.24	0.09	430437.8	35.14	0	0	25.1
06/01/2024 15:00	14.29	0.19	448141.6	36.83	0	0	25.5
06/01/2024 16:00	14.32	0.16	451541.2	37.15	0	0	25.7
06/01/2024 17:00	14.26	0.13	454246.8	37.67	0	0	24.1
06/01/2024 18:00	14.23	0.27	447959	37.14	0	0	24.4
06/01/2024 19:00	14.17	0.18	451799.1	37.87	0	0	22.9
06/01/2024 20:00	14.14	0.26	449828	37.82	0	0	22.7
06/01/2024 21:00	14.14	0.3	452044.7	38.05	0	0	22.5
06/01/2024 22:00	14.13	0.27	450609.7	37.93	0	0	22.5
06/01/2024 23:00	14.13	0.34	445407.8	32.3	0	0	22.5
06/01/2024 24:00	Shutdown	0.12	Shutdown	0.3	Shutdown	Shutdown	Shutdown
Minimum	14.13	0.06	430437.8	0.3	0	0	22.5
MinDate	01/06/2024 22:00:00	01/06/2024 10:00:00	01/06/2024 14:00:00		01/06/2024 1:00:00	01/06/2024 1:00:00	01/06/2024 1:00:00
Maximum	14.41	0.39	505471.9	42.88	0	0	27.2
MaxDate	01/06/2024 12:00:00	01/06/2024 7:00:00	01/06/2024 12:00:00	01/06/2024 4:00:00	01/06/2024 1:00:00	01/06/2024 1:00:00	01/06/2024 13:00:00
Avg	14.24	0.22	475281.9	38.51	0	0	23.9
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	24892.7	8.7	0	0	1.4
Site ABPR52 Daily: 06/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
06/01/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 04:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 05:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 07:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 11:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 12:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
06/01/2024 13:00	Shutdown	0.79	Shutdown	1.07	Shutdown	Shutdown	Shutdown
06/01/2024 14:00	14.74	0.33	434669.2	34.23	0.6	0.6	30
06/01/2024 15:00	14.76	0.38	445833.8	36.92	0.2	0.5	28.2
06/01/2024 16:00	14.77	0.3	448222.9	37.25	0.1	0.5	28.1
06/01/2024 17:00	14.62	0.02	451483.5	37.76	0	0.5	27.1
06/01/2024 18:00	14.54	0.15	443809.6	37.22	0	0.4	27.5
06/01/2024 19:00	14.49	0.21	449329.2	37.96	0	0.4	26.1
06/01/2024 20:00	14.44	0.31	447726.7	37.89	0	0.4	25.7
06/01/2024 21:00	14.45	0.4	449754.5	38.12	0	0.5	25.5
06/01/2024 22:00	14.45	0.48	448096	38.02	0	0.5	25.3
06/01/2024 23:00	14.52	0.58	427333.6	34.86	0	0.5	29.7
06/01/2024 24:00	14.55	0.55	488073.1	42.22	0	0.6	25.4
Minimum	14.44	0	427333.6	0	0	0.4	25.3
MinDate	01/06/2024 20:00:00	01/06/2024 1:00:00	01/06/2024 23:00:00	01/06/2024 1:00:00	01/06/2024 17:00:00	01/06/2024 18:00:00	01/06/2024 22:00:00
Maximum	14.77	0.79	488073.1	42.22	0.6	0.6	30



MaxDate	01/06/2024 16:00:00	01/06/2024 13:00:00			01/06/2024 14:00:00	01/06/2024 14:00:00	01/06/2024 14:00:00
Avg	14.58	0.19	448575.6	17.23	0.1	0.5	27.1
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.2	14987.3	19.1	0.2	0.1	1.7
Site ABPR51 Daily: 07/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
07/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 18:00	Shutdown	0.3	Shutdown	18.97	Shutdown	Shutdown	Shutdown
07/01/2024 19:00	14.22	0.54	443566.1	36.45	0	0	22.2
07/01/2024 20:00	14.18	0.64	440758.8	36.41	0	0	22.7
07/01/2024 21:00	14.17	0.72	440599.7	36.49	0	0	23
07/01/2024 22:00	14.29	0.71	448362.4	36.5	0	0	26.7
07/01/2024 23:00	14.24	0.4	494377.1	42.7	0	0	22.6
07/01/2024 24:00	14.22	0.26	493604.6	42.8	0	0	22.4
Minimum	14.17	0.01	440599.7	0	0	0	22.2
MinDate	01/07/2024 21:00:00	01/07/2024 1:00:00	01/07/2024 21:00:00	01/07/2024 1:00:00	01/07/2024 19:00:00	01/07/2024 19:00:00	01/07/2024 19:00:00
Maximum	14.29	0.72	494377.1	42.8	0	0	26.7
MaxDate	01/07/2024 22:00:00	01/07/2024 21:00:00	01/07/2024 23:00:00		01/07/2024 19:00:00	01/07/2024 19:00:00	01/07/2024 22:00:00
Avg	14.22	0.16	460211.4	10.43	0	0	23.3
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.3	26317.5	17.1	0	0	1.7
Site ABPR52 Daily: 07/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
07/01/2024 01:00	14.56	0.54	490263.1	42.78	0	0.6	25
07/01/2024 02:00	14.56	0.3	489720.6	42.76	0	0.7	25
07/01/2024 03:00	14.57	0.3	490421.3	42.72	0	0.7	25
07/01/2024 04:00	14.53	0.29	490255.9	42.77	0	0.8	24.3
07/01/2024 05:00	14.53	0.32	489418.3	42.78	0	0.8	24.3
07/01/2024 06:00	14.53	0.27	488229.2	42.72	0	0.8	24.4
07/01/2024 07:00	14.52	0.25	488342.8	42.67	0	0.8	25.4
07/01/2024 08:00	14.52	0.24	488524.1	42.62	0	0.8	26.1
07/01/2024 09:00	14.57	0.21	490691.4	42.62	0	0.7	26.8
07/01/2024 10:00	14.63	0.24	492504.5	42.61	0	0.7	27.4
07/01/2024 11:00	14.68	0.33	494201.8	42.6	0	0.6	28
07/01/2024 12:00	14.73	0.38	495214.4	42.6	0.1	0.6	28.2
07/01/2024 13:00	14.8	0.31	497048.4	42.62	0.1	0.6	28.4
07/01/2024 14:00	14.82	0.17	498084.6	42.67	0.1	0.6	28.5
07/01/2024 15:00	14.79	0.16	498153.2	42.57	0	0.6	28.5
07/01/2024 16:00	14.8	0.39	498993.4	42.59	0.1	0.6	28.8
07/01/2024 17:00	14.76	0.28	498981.6	42.61	0	0.6	28.7
07/01/2024 18:00	14.67	0.3	442501.6	36.33	0	0.5	28.6
07/01/2024 19:00	14.5	0.5	435471.1	36.51	0	0.5	26.7
07/01/2024 20:00	14.47	0.5	434569.4	36.48	0	0.5	26.6
07/01/2024 21:00	14.48	0.48	435440.7	36.59	0	0.5	26.7
07/01/2024 22:00	Shutdown	0.98	Shutdown	12.63	Shutdown	Shutdown	Shutdown
07/01/2024 23:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/01/2024 24:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.47	0	434569.4	0	0	0.5	24.3
MinDate	01/07/2024 20:00:00		01/07/2024 20:00:00	01/07/2024 23:00:00	01/07/2024 1:00:00	01/07/2024 18:00:00	01/07/2024 4:00:00
Maximum	14.82	0.98	498993.4	42.78	0.1	0.8	28.8
MaxDate	01/07/2024 14:00:00	01/07/2024 22:00:00	01/07/2024 16:00:00	01/07/2024 1:00:00	01/07/2024 12:00:00	01/07/2024 4:00:00	01/07/2024 16:00:00
Avg	14.62	0.32	482239.6	36.83	0	0.6	26.7
Num	21	24	21	24	21	21	21
Data[%]	88	100	88	100	88	88	88
STD	0.1	0.2	22823.5	13	0	0.1	1.6
Site ABPR51 Daily: 08/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
08/01/2024 01:00	14.22	0.22	493418.9	42.86	0	0	22.3
08/01/2024 02:00	14.22	0.29	493478.7	42.88	0	0	22.2
08/01/2024 03:00	14.19	0.24	493079.8	42.91	0	0	22
08/01/2024 04:00	14.21	0.21	492773.1	42.87	0	0	22.1
08/01/2024 05:00	14.21	0.19	492819.6	42.88	0	0	22.4
08/01/2024 06:00	14.18	0.26	492567.5	42.99	0	0	22.4
08/01/2024 07:00	14.17	0.28	491130.9	42.82	0	0	22.6
08/01/2024 08:00	14.22	0.32	491965.5	42.8	0	0	23
08/01/2024 09:00	14.27	0.34	496173.9	42.81	0	0	23.6
08/01/2024 10:00	14.33	0.3	500318.7	42.82	0	0	24.4
08/01/2024 11:00	14.4	0.42	504406.1	42.83	0	0	25.2
08/01/2024 12:00	14.41	0.3	506356.8	42.89	0	0	25.7
08/01/2024 13:00	14.42	0.29	500916.8	42.1	0	0	26.4
08/01/2024 14:00	14.37	0.15	473903.7	39.11	0	0	26.2
08/01/2024 15:00	14.41	0.12	494263.7	41.09	0	0	25
08/01/2024 16:00	14.38	0.01	489577.4	40.8	0	0	23.3
08/01/2024 17:00	14.34	0.11	482073.7	40.32	0	0	22.8
08/01/2024 18:00	14.31	0.23	480995.2	40.45	0	0	23.3
08/01/2024 19:00	14.28	0.31	482702.4	40.78	0	0	23.2
08/01/2024 20:00	14.27	0.34	484117.2	41.08	0	0	23.1
08/01/2024 21:00	14.25	0.34	485034	41.28	0	0	22.9
08/01/2024 22:00	14.22	0.33	483096.3	41.22	0	0	22.5
08/01/2024 23:00	14.21	0.38	473144	34.91	0	0	22.6
08/01/2024 24:00	Shutdown	0.17	Shutdown	0.69	Shutdown	Shutdown	Shutdown
Minimum	14.17	0.01	473144	0.69	0	0	22
MinDate	01/08/2024 7:00:00	01/08/2024 16:00:00	01/08/2024 23:00:00		01/08/2024 1:00:00	01/08/2024 1:00:00	01/08/2024 3:00:00



Maximum	14.42	0.42	506356.8	42.99	0	0	26.4
MaxDate	01/08/2024 13:00:00	01/08/2024 11:00:00	01/08/2024 12:00:00	01/08/2024 6:00:00	01/08/2024 1:00:00	01/08/2024 1:00:00	01/08/2024 13:00:00
Avg	14.28	0.26	490361.4	39.92	0	0	23.4
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	8696.1	8.6	0	0	1.4

Site ABPR52 Daily: 08/01/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
08/01/2024 01:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 02:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 03:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 04:00	Shutdown	0.39	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 05:00	Shutdown	0.52	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 06:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 10:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 11:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/01/2024 13:00	Shutdown	0.47	Shutdown	1.27	Shutdown	Shutdown	Shutdown
08/01/2024 14:00	14.89	0.53	475379.6	38.79	0.6	0.6	31.6
08/01/2024 15:00	14.95	0.44	492771.7	41.18	0.2	0.6	28
08/01/2024 16:00	14.85	0.11	486917.3	40.92	0.1	0.6	26.6
08/01/2024 17:00	14.75	0.29	479226.5	40.41	0.1	0.6	26.3
08/01/2024 18:00	14.67	0.24	478144.3	40.55	0	0.5	26.7
08/01/2024 19:00	14.61	0.23	479980.9	40.88	0	0.5	26.6
08/01/2024 20:00	14.56	0.27	482217.5	41.18	0	0.5	26.4
08/01/2024 21:00	14.53	0.31	483402.2	41.38	0	0.5	26.2
08/01/2024 22:00	14.52	0.46	481609.4	41.3	0	0.5	25.7
08/01/2024 23:00	14.52	0.58	463658.8	36.71	0	0.5	28
08/01/2024 24:00	14.55	0.52	488270.5	42.18	0	0.5	28
Minimum	14.52	0	463658.8	0	0	0.5	25.7
MinDate	01/08/2024 22:00:00	01/08/2024 7:00:00	01/08/2024 23:00:00	01/08/2024 1:00:00	01/08/2024 18:00:00	01/08/2024 18:00:00	01/08/2024 22:00:00
Maximum	14.95	0.58	492771.7	42.18	0.6	0.6	31.6
MaxDate	01/08/2024 15:00:00	01/08/2024 23:00:00	01/08/2024 15:00:00		01/08/2024 14:00:00	01/08/2024 14:00:00	01/08/2024 14:00:00
Avg	14.67	0.25	481052.6	18.61	0.1	0.5	27.3
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.2	0.2	7606.6	20.6	0.2	0.1	1.6

Site ABPR51 Daily: 09/01/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
09/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/01/2024 13:00	Shutdown	0.27	Shutdown	3.8	Shutdown	Shutdown	Shutdown
09/01/2024 14:00	14.4	0.23	479540.1	38.54	0	0	22.9
09/01/2024 15:00	14.36	0.04	497845.5	41.52	0	0	21.4
09/01/2024 16:00	14.32	0.04	494835	41.45	0	0	20.9
09/01/2024 17:00	14.29	0.08	493366.6	41.56	0	0	20.8
09/01/2024 18:00	14.26	0.1	491383.1	41.58	0	0	20.6
09/01/2024 19:00	14.22	0.13	491450.2	41.78	0	0	20.4
09/01/2024 20:00	14.22	0.25	489059.1	41.63	0	0	20.5
09/01/2024 21:00	14.19	0.26	484131.9	41.28	0	0	20.2
09/01/2024 22:00	14.17	0.21	481714.2	41.15	0	0	20.1
09/01/2024 23:00	14.17	0.34	469794.2	34.45	0	0	20.5
09/01/2024 24:00	Shutdown	0.09	Shutdown	0.21	Shutdown	Shutdown	Shutdown
Minimum	14.17	0.01	469794.2	0	0	0	20.1
MinDate	01/09/2024 22:00:00	01/09/2024 1:00:00	01/09/2024 23:00:00	01/09/2024 1:00:00	01/09/2024 14:00:00	01/09/2024 14:00:00	01/09/2024 22:00:00
Maximum	14.4	0.34	497845.5	41.78	0	0	22.9
MaxDate	01/09/2024 14:00:00	01/09/2024 23:00:00	01/09/2024 15:00:00	01/09/2024 19:00:00	01/09/2024 14:00:00	01/09/2024 14:00:00	01/09/2024 14:00:00
Avg	14.26	0.09	487311.9	17.04	0	0	20.8
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.1	8498.1	20.3	0	0	0.8

Site ABPR52 Daily: 09/01/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
09/01/2024 01:00	14.53	0.59	490808.9	42.77	0	0.6	26
09/01/2024 02:00	14.53	0.6	489870.6	42.76	0	0.5	26.2
09/01/2024 03:00	14.54	0.52	489727.5	42.75	0	0.5	26.2
09/01/2024 04:00	14.53	0.43	489967.9	42.77	0	0.6	26
09/01/2024 05:00	14.53	0.53	489019.4	42.76	0	0.6	25.9
09/01/2024 06:00	14.52	0.42	489001.1	42.87	0	0.6	25.9
09/01/2024 07:00	14.5	0.51	488529.8	42.69	0	0.6	25.7
09/01/2024 08:00	14.53	0.42	489462.5	42.66	0.7	0.6	25.6
09/01/2024 09:00	14.6	0.58	490116.4	42.65	0.2	0.6	24.9
09/01/2024 10:00	14.69	0.55	492760.2	42.66	0.1	0.6	26.1
09/01/2024 11:00	14.81	0.66	495084.3	42.64	0.2	0.6	26.8
09/01/2024 12:00	14.85	0.57	496774.8	42.69	0.2	0.5	27.4
09/01/2024 13:00	14.84	0.42	475602.7	39.89	0.3	0.5	28.2
09/01/2024 14:00	14.85	0.48	466071.3	38.57	0.1	0.6	28.3
09/01/2024 15:00	14.76	0.24	491105.6	41.64	0.1	0.6	25.6
09/01/2024 16:00	14.73	0.34	488803.8	41.54	0.1	0.6	24.9
09/01/2024 17:00	14.68	0.29	488877.3	41.67	0	0.6	24.8
09/01/2024 18:00	14.63	0.27	488063.8	41.66	0	0.6	24.6
09/01/2024 19:00	14.58	0.22	488704.4	41.88	0	0.6	24.5
09/01/2024 20:00	14.55	0.4	485714.6	41.73	0	0.6	24.4
09/01/2024 21:00	14.52	0.32	481883.6	41.39	0	0.6	24
09/01/2024 22:00	14.48	0.33	480620.7	41.23	0	0.7	23.8
09/01/2024 23:00	14.53	0.59	447850.3	36.97	0	0.7	28
09/01/2024 24:00	14.53	0.52	492495.9	42.65	0	0.7	25.1
Minimum	14.48	0.22	447850.3	36.97	0	0.5	23.8



MinDate	01/09/2024 22:00:00	01/09/2024 19:00:00	01/09/2024 23:00:00	01/09/2024 23:00:00	01/09/2024 1:00:00	01/09/2024 2:00:00	01/09/2024 22:00:00
Maximum	14.85	0.66	496774.8	42.87	0.7	0.7	28.3
MaxDate	01/09/2024 12:00:00	01/09/2024 11:00:00	01/09/2024 12:00:00	01/09/2024 6:00:00	01/09/2024 8:00:00	01/09/2024 22:00:00	01/09/2024 14:00:00
Avg	14.62	0.45	486121.6	41.81	0.1	0.6	25.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	10358.1	1.5	0.2	0.1	1.3
Site ABPR51 Daily: 10/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
10/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/01/2024 13:00	Shutdown	0.46	Shutdown	2.58	Shutdown	Shutdown	Shutdown
10/01/2024 14:00	14.38	0.29	475879.5	38.29	0	0	22.8
10/01/2024 15:00	14.31	0.03	489893	40.93	0	0	19.7
10/01/2024 16:00	14.25	0.01	483006.4	40.73	0	0	19.1
10/01/2024 17:00	14.24	0.06	483992.8	40.89	0	0	19.4
10/01/2024 18:00	14.26	0.15	484015.6	40.77	0	0	20.6
10/01/2024 19:00	14.23	0.2	478298	40.39	0	0	21
10/01/2024 20:00	14.23	0.21	484826	41.09	0	0	21.1
10/01/2024 21:00	14.2	0.14	482205.4	40.98	0	0	20.4
10/01/2024 22:00	14.2	0.23	487316.1	41.59	0	0	20.3
10/01/2024 23:00	14.22	0.23	452093.7	37.13	0	0	24.4
10/01/2024 24:00	14.19	0.15	493267.9	42.61	0	0	20.9
Minimum	14.19	0.01	452093.7	0	0	0	19.1
MinDate		01/10/2024 1:00:00	01/10/2024 23:00:00	01/10/2024 1:00:00	01/10/2024 14:00:00	01/10/2024 14:00:00	01/10/2024 16:00:00
Maximum	14.38	0.46	493267.9	42.61	0	0	24.4
MaxDate	01/10/2024 14:00:00	01/10/2024 13:00:00			01/10/2024 14:00:00	01/10/2024 14:00:00	01/10/2024 23:00:00
Avg	14.25	0.1	481345	18.67	0	0	20.9
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.1	10842.2	20.5	0	0	1.5
Site ABPR52 Daily: 10/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
10/01/2024 01:00	14.53	0.54	490937.8	42.85	0	0.8	24.6
10/01/2024 02:00	14.53	0.73	490903	42.84	0	0.8	24.5
10/01/2024 03:00	14.53	0.44	490559.5	42.84	0	0.8	24.6
10/01/2024 04:00	14.53	0.52	489755.8	42.85	0	0.9	24.3
10/01/2024 05:00	14.52	0.58	489885.9	42.83	0	0.9	24.3
10/01/2024 06:00	14.52	0.56	490399.8	42.93	0	0.9	24.3
10/01/2024 07:00	14.51	0.55	489111.1	42.79	0.1	1	24.1
10/01/2024 08:00	14.52	0.61	489119.9	42.77	0.4	0.9	24.5
10/01/2024 09:00	14.6	0.55	490716.9	42.74	0.5	0.9	24.2
10/01/2024 10:00	14.71	0.64	493230.2	42.75	0.2	0.8	24.9
10/01/2024 11:00	14.8	0.65	496479.8	42.73	0.3	0.7	26.4
10/01/2024 12:00	14.83	0.47	497970.8	42.72	0.3	0.7	26.8
10/01/2024 13:00	14.79	0.58	483022.9	40.76	0.1	0.7	27.9
10/01/2024 14:00	14.77	0.49	461088.8	38.09	0.1	0.7	27.1
10/01/2024 15:00	14.67	0.31	484263.7	41.03	0.1	0.7	24.1
10/01/2024 16:00	14.61	0.17	480025	40.84	0	0.7	23
10/01/2024 17:00	14.59	0.38	481679.5	40.99	0	0.7	23.2
10/01/2024 18:00	14.58	0.37	480440.3	40.88	0	0.7	24.3
10/01/2024 19:00	14.51	0.35	475567.1	40.49	0	0.7	24.5
10/01/2024 20:00	14.52	0.44	482235	41.21	0	0.7	24.7
10/01/2024 21:00	14.53	0.4	480354.1	41.11	0	0.7	24
10/01/2024 22:00	14.5	0.31	485227.5	41.7	0	0.7	23.9
10/01/2024 23:00	14.47	0.7	469491.6	34.69	0	0.7	24.1
10/01/2024 24:00	Shutdown	0.38	Shutdown	0.19	Shutdown	Shutdown	Shutdown
Minimum	14.47	0.17	461088.8	0.19	0	0.7	23
MinDate	01/10/2024 23:00:00	01/10/2024 16:00:00	01/10/2024 14:00:00	01/10/2024 1:00:00	01/10/2024 1:00:00	01/10/2024 11:00:00	01/10/2024 16:00:00
Maximum	14.83	0.73	497970.8	42.93	0.5	1	27.9
MaxDate	01/10/2024 12:00:00	01/10/2024 2:00:00	01/10/2024 12:00:00	01/10/2024 6:00:00	01/10/2024 9:00:00	01/10/2024 7:00:00	01/10/2024 13:00:00
Avg	14.59	0.49	485324.6	39.82	0.1	0.8	24.7
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	8527.6	8.6	0.1	0.1	1.2
Site ABPR51 Daily: 11/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
11/01/2024 01:00	14.17	0.3	493207.3	42.86	0	0	20.8
11/01/2024 02:00	14.17	0.2	493580.4	42.88	0	0	20.6
11/01/2024 03:00	14.16	0.13	493394.8	42.93	0	0	20.2
11/01/2024 04:00	14.15	0.06	493263.1	42.96	0	0	20.1
11/01/2024 05:00	14.15	0.11	493197.7	42.95	0	0	19.9
11/01/2024 06:00	14.16	0.25	493855.6	43.07	0	0	19.8
11/01/2024 07:00	14.15	0.25	492886.1	42.91	0	0	19.6
11/01/2024 08:00	14.15	0.17	493029.3	42.9	0	0	19.3
11/01/2024 09:00	14.16	0.27	494279.7	42.91	0	0	19.1
11/01/2024 10:00	14.2	0.09	496240.4	42.92	0	0	19.7
11/01/2024 11:00	14.24	0.07	499455	42.96	0	0	20.9
11/01/2024 12:00	14.32	0.11	502627.3	42.91	0	0	22.6
11/01/2024 13:00	14.36	0.38	500502.1	42.25	0	0	23.6
11/01/2024 14:00	14.3	0.23	472491.5	39.28	0	0	23.5
11/01/2024 15:00	14.24	0.05	486679.1	41.19	0	0	19.7
11/01/2024 16:00	14.22	0.11	488377.1	41.36	0	0	19.5
11/01/2024 17:00	14.22	0.19	485473	41.26	0	0	20.1
11/01/2024 18:00	14.22	0.25	485099	41.16	0	0	19.7
11/01/2024 19:00	14.19	0.24	482108.6	40.99	0	0	19.6
11/01/2024 20:00	14.15	0.19	472076.8	40.05	0	0	20.2
11/01/2024 21:00	14.16	0.2	485731.8	41.47	0	0	19.2
11/01/2024 22:00	14.16	0.24	492383.2	42.28	0	0	19.5
11/01/2024 23:00	14.2	0.19	459129	37.93	0	0	23
11/01/2024 24:00	14.17	0.14	489893.6	42.27	0	0	19.2



Minimum	14.15	0.05	459129	37.93	0	0	19.1
MinDate	01/11/2024 4:00:00	01/11/2024 15:00:00	01/11/2024 23:00:00	01/11/2024 23:00:00	01/11/2024 1:00:00	01/11/2024 1:00:00	01/11/2024 9:00:00
Maximum	14.36	0.38	502627.3	43.07	0	0	23.6
MaxDate	01/11/2024 13:00:00	01/11/2024 13:00:00	01/11/2024 12:00:00	01/11/2024 6:00:00	01/11/2024 1:00:00	01/11/2024 1:00:00	01/11/2024 13:00:00
Avg	14.2	0.18	489123.4	41.94	0	0	20.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	9804.8	1.4	0	0	1.4

Site ABPR52 Daily: 11/01/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
11/01/2024 01:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 02:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 03:00	Shutdown	0.37	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 04:00	Shutdown	0.74	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 05:00	Shutdown	0.88	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 06:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 07:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 08:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 09:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 10:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 11:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 12:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
11/01/2024 13:00	Shutdown	0.8	Shutdown	1.05	Shutdown	Shutdown	Shutdown
11/01/2024 14:00	14.74	0.41	478353.4	38.19	0.5	0.9	29.4
11/01/2024 15:00	14.64	0.11	487960.5	41.31	0	0.9	23.7
11/01/2024 16:00	14.65	0.33	487977.2	41.46	0	0.8	23.5
11/01/2024 17:00	14.56	0.35	485348.8	41.35	0	0.8	23.9
11/01/2024 18:00	14.53	0.55	484031.3	41.25	0	0.8	23.5
11/01/2024 19:00	14.51	0.49	481305.6	41.09	0	0.8	23.3
11/01/2024 20:00	14.47	0.52	470294.2	40.12	0	0.8	24.1
11/01/2024 21:00	14.51	0.57	484263.3	41.57	0	0.8	23
11/01/2024 22:00	14.51	0.44	491731.4	42.37	0	0.9	23.1
11/01/2024 23:00	14.47	0.53	477590.2	35.73	0	0.9	23
11/01/2024 24:00	Shutdown	0.36	Shutdown	0.42	Shutdown	Shutdown	Shutdown
Minimum	14.47	0.02	470294.2	0	0	0.8	23
MinDate	01/11/2024 20:00:00	01/11/2024 12:00:00	01/11/2024 20:00:00	01/11/2024 1:00:00	01/11/2024 15:00:00	01/11/2024 16:00:00	01/11/2024 21:00:00
Maximum	14.74	0.88	491731.4	42.37	0.5	0.9	29.4
MaxDate	01/11/2024 14:00:00	01/11/2024 5:00:00	01/11/2024 22:00:00	01/11/2024 22:00:00	01/11/2024 14:00:00	01/11/2024 14:00:00	01/11/2024 14:00:00
Avg	14.56	0.34	482885.6	16.91	0.1	0.8	24.1
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	6228.5	20.4	0.2	0.1	1.9



Source.Name	Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
CEMS 51...xls	Site ABPR51 Daily: 12/01/2024 Type: AVG							
CEMS 51...xls	Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
CEMS 51...xls		%VOL	MG/M3	M3/HR	MW			
CEMS 51...xls	12/01/2024 01:00	14.15	0.09	492702.6	42.85	0	0	18.9
CEMS 51...xls	12/01/2024 02:00	14.15	0.09	492776.2	42.85	0	0	18.7
CEMS 51...xls	12/01/2024 03:00	14.16	0.13	493747.5	42.94	0	0	18.4
CEMS 51...xls	12/01/2024 04:00	14.15	0.23	494045.8	42.97	0	0	18.6
CEMS 51...xls	12/01/2024 05:00	14.16	0.15	494336.6	42.99	0	0	18.4
CEMS 51...xls	12/01/2024 06:00	14.15	0.14	493727.4	42.95	0	0	18.4
CEMS 51...xls	12/01/2024 07:00	14.15	0.21	493815.1	42.93	0	0	18.3
CEMS 51...xls	12/01/2024 08:00	14.15	0.22	493355.4	42.92	0	0	18.5
CEMS 51...xls	12/01/2024 09:00	14.15	0.12	494184.4	42.93	0	0	18.3
CEMS 51...xls	12/01/2024 10:00	14.17	0.04	496283.5	42.94	0	0	19
CEMS 51...xls	12/01/2024 11:00	14.25	0.06	500241.4	42.97	0	0	21
CEMS 51...xls	12/01/2024 12:00	14.32	0.27	504109	42.93	0	0	22.5
CEMS 51...xls	12/01/2024 13:00	14.36	0.38	500820.3	42.28	0	0	23.5
CEMS 51...xls	12/01/2024 14:00	14.29	0.25	478824.3	39.93	0	0	23.3
CEMS 51...xls	12/01/2024 15:00	14.23	0.05	484693.2	41.03	0	0	19.6
CEMS 51...xls	12/01/2024 16:00	14.15	0.02	485494.4	41.58	0	0	18
CEMS 51...xls	12/01/2024 17:00	14.16	0.08	485284.7	41.34	0	0	18.3
CEMS 51...xls	12/01/2024 18:00	14.15	0.18	481417.8	41.02	0	0	18.2
CEMS 51...xls	12/01/2024 19:00	14.16	0.22	481866.9	41.01	0	0	19.1
CEMS 51...xls	12/01/2024 20:00	14.15	0.25	480548.7	40.97	0	0	18.7
CEMS 51...xls	12/01/2024 21:00	14.13	0.25	477106.4	40.74	0	0	18.4
CEMS 51...xls	12/01/2024 22:00	14.12	0.23	476822.9	40.7	0	0	18.2
CEMS 51...xls	12/01/2024 23:00	14.17	0.19	451282.1	37.19	0	0	21.5
CEMS 51...xls	12/01/2024 24:00	14.15	0.15	492940.8	42.63	0	0	18.6
CEMS 51...xls	Minimum	14.12	0.02	451282.1	37.19	0	0	18
CEMS 51...xls	MinDate	01/12/2024 22:00:00	01/12/2024 16:00:00	01/12/2024 23:00:00	01/12/2024 23:00:00	01/12/2024 1:00:00	01/12/2024 1:00:00	01/12/2024 16:00:00
CEMS 51...xls	Maximum	14.36	0.38	504109	42.99	0	0	23.5
CEMS 51...xls	MaxDate	01/12/2024 13:00:00	01/12/2024 13:00:00	01/12/2024 12:00:00	01/12/2024 5:00:00	01/12/2024 1:00:00	01/12/2024 1:00:00	01/12/2024 13:00:00
CEMS 51...xls	Avg	14.18	0.17	488351.2	41.9	0	0	19.4
CEMS 51...xls	Num	24	24	24	24	24	24	24
CEMS 51...xls	Data[%]	100	100	100	100	100	100	100
CEMS 51...xls	STD	0.1	0.1	11010	1.4	0	0	1.7
CEMS 52...xls	Site ABPR52 Daily: 12/01/2024 Type: AVG							
CEMS 52...xls	Date & Time	52HRSG_O2	52HRSG_DUST	52HRSG_FLOW	GT_LOAD	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
CEMS 52...xls		%VOL	MG/M3	MG/HR	MW			
CEMS 52...xls	12/01/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 03:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 05:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 06:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 07:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 08:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 09:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 10:00	Shutdown	0.36	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 11:00	Shutdown	0.28	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 12:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 13:00	Shutdown	0.9	Shutdown	1.02	Shutdown	Shutdown	Shutdown
CEMS 52...xls	12/01/2024 14:00	14.76	0.47	482658.9	38.6	0.5	1	29.8
CEMS 52...xls	12/01/2024 15:00	14.62	0.09	486198.7	41.13	0	0.9	23.7
CEMS 52...xls	12/01/2024 16:00	14.53	0.13	487170.3	41.68	0	0.9	22.2
CEMS 52...xls	12/01/2024 17:00	14.57	0.26	484994.8	41.45	0	0.9	22.4
CEMS 52...xls	12/01/2024 18:00	14.56	0.4	481207.8	41.13	0	0.9	22.3
CEMS 52...xls	12/01/2024 19:00	14.53	0.46	481089.2	41.11	0	0.9	23
CEMS 52...xls	12/01/2024 20:00	14.49	0.55	479971.4	41.08	0	0.9	22.5
CEMS 52...xls	12/01/2024 21:00	14.47	0.54	476693.8	40.83	0	0.9	22.4
CEMS 52...xls	12/01/2024 22:00	14.46	0.58	475947.8	40.79	0	0.9	22.3
CEMS 52...xls	12/01/2024 23:00	14.45	0.74	468500.6	34.68	0	0.9	22.3
CEMS 52...xls	12/01/2024 24:00	Shutdown	0.34	Shutdown	0.14	Shutdown	Shutdown	Shutdown
CEMS 52...xls	Minimum	14.45	0	468500.6	0	0	0.9	22.2
CEMS 52...xls	MinDate	01/12/2024 23:00:00	01/12/2024 1:00:00	01/12/2024 23:00:00	01/12/2024 1:00:00	01/12/2024 15:00:00	01/12/2024 15:00:00	01/12/2024 16:00:00
CEMS 52...xls	Maximum	14.76	0.9	487170.3	41.68	0.5	1	29.8
CEMS 52...xls	MaxDate	01/12/2024 14:00:00	01/12/2024 13:00:00	01/12/2024 16:00:00	01/12/2024 16:00:00	01/12/2024 14:00:00	01/12/2024 14:00:00	01/12/2024 14:00:00
CEMS 52...xls	Avg	14.54	0.29	480443.3	16.82	0.1	0.9	23.3
CEMS 52...xls	Num	10	24	10	24	10	10	10
CEMS 52...xls	Data[%]	42	100	42	100	42	42	42
CEMS 52...xls	STD	0.1	0.2	5598.4	20.3	0.2	0	2.3



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 13/01/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
13/01/2024 01:00	14.15	0.19	494139.2	42.9	0	0	18.7
13/01/2024 02:00	14.16	0.11	494281	42.94	0	0	18.6
13/01/2024 03:00	14.16	0.15	494780.3	43.01	0	0	18.7
13/01/2024 04:00	14.15	0.16	494570.4	43.03	0	0	18.4
13/01/2024 05:00	14.15	0.26	494093.6	43.01	0	0	18.3
13/01/2024 06:00	14.15	0.25	493554.9	43.01	0	0	18.4
13/01/2024 07:00	14.14	0.29	493569	42.98	0	0	18.3
13/01/2024 08:00	14.14	0.21	492891.7	42.93	0	0	18.3
13/01/2024 09:00	14.15	0.27	494100.6	42.92	0	0	18.2
13/01/2024 10:00	14.19	0.14	496229.9	42.9	0	0	19.7
13/01/2024 11:00	14.26	0.29	499739.5	42.86	0	0	21.4
13/01/2024 12:00	14.29	0.31	502105.8	42.93	0	0	22
13/01/2024 13:00	14.29	0.34	496591.2	42.24	0	0	21.8
13/01/2024 14:00	14.19	0.35	463307.6	38.84	0	0	20.9
13/01/2024 15:00	14.25	0.4	479374.4	40.31	0	0	20.1
13/01/2024 16:00	14.19	0.17	480979	40.87	0	0	19.7
13/01/2024 17:00	14.11	0.23	470277.3	40.19	0	0	19.2
13/01/2024 18:00	14.08	0.27	460811.1	39.21	0	0	19.2
13/01/2024 19:00	14.09	0.3	460844.7	39.14	0	0	19.1
13/01/2024 20:00	14.08	0.24	461248.7	39.16	0	0	18.7
13/01/2024 21:00	14.09	0.21	464037.8	39.49	0	0	18.8
13/01/2024 22:00	14.09	0.26	459419	39.07	0	0	19
13/01/2024 23:00	14.09	0.4	457722.3	33.53	0	0	18.8
13/01/2024 24:00	Shutdown	0.08	Shutdown	0.14	Shutdown	Shutdown	Shutdown
Minimum	14.08	0.08	457722.3	0.14	0	0	18.2
MinDate	01/13/2024 18:00:00		01/13/2024 23:00:00		01/13/2024 1:00:00	01/13/2024 1:00:00	01/13/2024 9:00:00
Maximum	14.29	0.4	502105.8	43.03	0	0	22
MaxDate	01/13/2024 12:00:00	01/13/2024 15:00:00	01/13/2024 12:00:00	01/13/2024 4:00:00	01/13/2024 1:00:00	01/13/2024 1:00:00	01/13/2024 12:00:00
Avg	14.16	0.25	482550.9	39.48	0	0	19.3
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	16050.9	8.7	0	0	1.2
Site ABPR52 Daily: 13/01/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
13/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 02:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 03:00	Shutdown	0.33	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 04:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 05:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 06:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 10:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 11:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 12:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
13/01/2024 13:00	Shutdown	0.89	Shutdown	1.08	Shutdown	Shutdown	Shutdown
13/01/2024 14:00	14.68	0.69	469002.2	37.76	0.5	1	27.5
13/01/2024 15:00	14.68	0.58	479417	40.42	0	0.9	24.7
13/01/2024 16:00	14.55	0.13	480923.1	40.96	0	0.9	23.9
13/01/2024 17:00	14.45	0.28	470552	40.27	0	0.9	23.3
13/01/2024 18:00	14.44	0.45	460590.3	39.31	0	0.9	23.3
13/01/2024 19:00	14.45	0.43	460303.4	39.23	0	0.9	23.1
13/01/2024 20:00	14.42	0.41	460445.3	39.25	0	0.9	22.8
13/01/2024 21:00	14.43	0.38	463846.1	39.58	0	0.9	22.7
13/01/2024 22:00	14.43	0.38	458891.4	39.14	0	1	22.9
13/01/2024 23:00	14.5	0.35	439520.3	36.32	0	1	26.6
13/01/2024 24:00	14.49	0.39	491847.5	42.71	0	1	22.7
Minimum	14.42	0	439520.3	0	0	0.9	22.7
MinDate	01/13/2024 20:00:00	01/13/2024 4:00:00	01/13/2024 23:00:00	01/13/2024 1:00:00	01/13/2024 15:00:00	01/13/2024 15:00:00	01/13/2024 21:00:00
Maximum	14.68	0.89	491847.5	42.71	0.5	1	27.5
MaxDate	01/13/2024 14:00:00	01/13/2024 13:00:00			01/13/2024 14:00:00	01/13/2024 14:00:00	01/13/2024 14:00:00
Avg	14.5	0.25	466849	18.17	0	0.9	24
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.3	13934.7	20.1	0.2	0.1	1.7



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 14/01/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
14/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 03:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 04:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 05:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 06:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 18:00	Shutdown	0.36	Shutdown	19.27	Shutdown	Shutdown	Shutdown
14/01/2024 19:00	14.11	0.27	461428.1	38.81	0	0	17.9
14/01/2024 20:00	14.11	0.28	454851	38.26	0	0	19.3
14/01/2024 21:00	14.1	0.3	454920.4	38.4	0	0	19.1
14/01/2024 22:00	14.2	0.29	455578.9	37.6	0	0	22.8
14/01/2024 23:00	14.15	0.41	492275.6	42.71	0	0	18.9
14/01/2024 24:00	14.15	0.49	492872.3	42.82	0	0	19.3
Minimum	14.1	0.01	454851	0	0	0	17.9
MinDate	01/14/2024 21:00:00	01/14/2024 1:00:00	01/14/2024 20:00:00	01/14/2024 1:00:00	01/14/2024 19:00:00	01/14/2024 19:00:00	01/14/2024 19:00:00
Maximum	14.2	0.49	492872.3	42.82	0	0	22.8
MaxDate	01/14/2024 22:00:00				01/14/2024 19:00:00	01/14/2024 19:00:00	01/14/2024 22:00:00
Avg	14.14	0.12	468654.4	10.74	0	0	19.6
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.2	18691.5	17.6	0	0	1.7
Site ABPR52 Daily: 14/01/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
14/01/2024 01:00	14.48	0.35	490540.8	42.85	0	1	22.9
14/01/2024 02:00	14.47	0.5	490272.6	42.83	0	1.1	22.9
14/01/2024 03:00	14.5	0.54	490239.4	42.83	0	1.1	22.8
14/01/2024 04:00	14.51	0.49	489729.4	42.83	0	1.1	22.8
14/01/2024 05:00	14.51	0.47	489242.8	42.8	0	1.2	22.5
14/01/2024 06:00	14.5	0.51	489269.8	42.8	0	1.2	22.5
14/01/2024 07:00	14.48	0.4	492160.7	43.08	0	1.2	22.8
14/01/2024 08:00	14.46	0.59	494355.7	43.18	0	1.2	23.2
14/01/2024 09:00	14.51	0.52	496360.3	43.23	0	1.1	23.4
14/01/2024 10:00	14.55	0.38	498028.9	43.18	0	1.1	23.9
14/01/2024 11:00	14.61	0.39	499716.8	43.16	0	1	25.3
14/01/2024 12:00	14.68	0.6	502343.1	43.14	0	1	26.5
14/01/2024 13:00	14.73	0.53	503351.3	43.16	0	1	27
14/01/2024 14:00	14.77	0.45	503611.8	43.02	0	1	27.3
14/01/2024 15:00	14.77	0.28	500221.1	42.74	0	1	27.4
14/01/2024 16:00	14.72	0.31	498724.7	42.59	0	1	27.4
14/01/2024 17:00	14.66	0.24	495652	42.6	0	0.9	26.7
14/01/2024 18:00	14.5	0.18	459528.8	39.02	0	0.9	25.7
14/01/2024 19:00	14.4	0.36	456564.3	38.92	0	0.9	23.2
14/01/2024 20:00	14.41	0.49	451643.9	38.36	0	0.9	23.7
14/01/2024 21:00	14.42	0.54	452497.2	38.48	0	0.9	23.6
14/01/2024 22:00	Shutdown	0.86	Shutdown	14.01	Shutdown	Shutdown	Shutdown
14/01/2024 23:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
14/01/2024 24:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.4	0.04	451643.9	0	0	0.9	22.5
MinDate	01/14/2024 19:00:00	01/14/2024 23:00:00	01/14/2024 20:00:00	01/14/2024 23:00:00	01/14/2024 1:00:00	01/14/2024 17:00:00	01/14/2024 5:00:00
Maximum	14.77	0.86	503611.8	43.23	0	1.2	27.4
MaxDate	01/14/2024 14:00:00	01/14/2024 22:00:00	01/14/2024 14:00:00	01/14/2024 9:00:00	01/14/2024 1:00:00	01/14/2024 5:00:00	01/14/2024 15:00:00
Avg	14.55	0.42	487812.2	37.45	0	1	24.5
Num	21	24	21	24	21	21	21
Data[%]	88	100	88	100	88	88	88
STD	0.1	0.2	16993.7	13	0	0.1	1.9
Site ABPR51 Daily: 15/01/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
15/01/2024 01:00	14.16	0.45	493006.7	42.84	0	0	19.6
15/01/2024 02:00	14.16	0.36	492818.7	42.84	0	0	19.6
15/01/2024 03:00	14.16	0.27	492934.3	42.86	0	0	19.5
15/01/2024 04:00	14.16	0.36	492881.7	42.87	0	0	19.8
15/01/2024 05:00	14.2	0.41	494007	42.91	0	0	20.6
15/01/2024 06:00	14.22	0.48	495269.3	43.05	0	0	21.5
15/01/2024 07:00	14.22	0.35	493122	42.85	0	0	21.6
15/01/2024 08:00	14.22	0.45	492452	42.83	0	0	21.8
15/01/2024 09:00	14.24	0.19	494344.8	42.83	0	0	22
15/01/2024 10:00	14.29	0.06	496560.8	42.86	0	0	22.3
15/01/2024 11:00	14.31	0.13	499491.6	42.85	0	0	22.8
15/01/2024 12:00	14.34	0.11	501397.4	42.78	0	0	23.2
15/01/2024 13:00	14.36	0.14	501880.1	42.51	0	0	23.9
15/01/2024 14:00	14.31	0.17	475664	39.55	0	0	24.1
15/01/2024 15:00	14.37	0.35	497902.3	41.68	0	0	23.5
15/01/2024 16:00	14.38	0.34	497789.4	41.57	0	0	23.7
15/01/2024 17:00	14.41	0.58	503513.8	42.03	0	0	24.2
15/01/2024 18:00	14.34	0.66	496344.9	41.72	0	0	23.1
15/01/2024 19:00	14.22	0.28	485458.8	41.25	0	0	20.7
15/01/2024 20:00	14.2	0.36	484885.6	41.36	0	0	20.6
15/01/2024 21:00	14.18	0.44	486813.9	41.67	0	0	20.3
15/01/2024 22:00	14.17	0.41	486488.1	41.65	0	0	20.1
15/01/2024 23:00	14.23	0.38	463870.7	38.47	0	0	24.4
15/01/2024 24:00	14.17	0.38	491880.8	42.54	0	0	20.1
Minimum	14.16	0.06	463870.7	38.47	0	0	19.5
MinDate	01/15/2024 1:00:00	01/15/2024 10:00:00	01/15/2024 23:00:00	01/15/2024 23:00:00	01/15/2024 1:00:00	01/15/2024 1:00:00	01/15/2024 3:00:00
Maximum	14.41	0.66	503513.8	43.05	0	0	24.4
MaxDate	01/15/2024 17:00:00	01/15/2024 18:00:00	01/15/2024 17:00:00	01/15/2024 6:00:00	01/15/2024 1:00:00	01/15/2024 1:00:00	01/15/2024 23:00:00
Avg	14.25	0.34	492115.8	42.1	0	0	21.8
Num	24	24	24	24	24	24	24



Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	8634	1.1	0	0	1.7
Site ABPR52 Daily: 15/01/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
15/01/2024 01:00	Shutdown	0.34	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 02:00	Shutdown	1.25	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 03:00	Shutdown	1.5	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 04:00	Shutdown	1.62	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 05:00	Shutdown	1.55	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 06:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 10:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 11:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 12:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/01/2024 13:00	Shutdown	0.4	Shutdown	0.94	Shutdown	Shutdown	Shutdown
15/01/2024 14:00	14.73	0.16	477822.5	38.83	0.3	1	30.9
15/01/2024 15:00	14.76	0.25	496338.5	41.78	0	0.9	27.8
15/01/2024 16:00	14.74	0.22	493541.8	41.68	0	0.9	27.8
15/01/2024 17:00	14.71	0.38	498118.6	42.13	0	0.9	28.4
15/01/2024 18:00	14.65	0.34	491753.5	41.81	0	0.8	27.3
15/01/2024 19:00	14.54	0.26	483355.5	41.36	0	0.8	25
15/01/2024 20:00	14.5	0.51	483662.2	41.45	0	0.9	24.9
15/01/2024 21:00	14.49	0.55	486094.2	41.75	0	0.9	24.6
15/01/2024 22:00	14.49	0.56	484930.6	41.73	0	0.9	24.4
15/01/2024 23:00	14.51	0.78	480610.7	36.24	0	0.9	24.8
15/01/2024 24:00	Shutdown	0.43	Shutdown	0.24	Shutdown	Shutdown	Shutdown
Minimum	14.49	0	477822.5	0	0	0.8	24.4
MinDate	01/15/2024 21:00:00	01/15/2024 7:00:00	01/15/2024 14:00:00	01/15/2024 1:00:00	01/15/2024 15:00:00	01/15/2024 18:00:00	01/15/2024 22:00:00
Maximum	14.76	1.62	498118.6	42.13	0.3	1	30.9
MaxDate	01/15/2024 15:00:00	01/15/2024 4:00:00	01/15/2024 17:00:00	01/15/2024 17:00:00	01/15/2024 14:00:00	01/15/2024 14:00:00	01/15/2024 14:00:00
Avg	14.61	0.46	487622.8	17.08	0	0.9	26.6
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.5	6887.4	20.6	0.1	0.1	2.2
Site ABPR51 Daily: 16/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
16/01/2024 01:00	14.16	0.35	491712.5	42.82	0	0	19.9
16/01/2024 02:00	14.16	0.28	492993.4	42.93	0	0	19.8
16/01/2024 03:00	14.16	0.33	491799.5	42.88	0	0	19.8
16/01/2024 04:00	14.18	0.26	492628.6	42.87	0	0	20.2
16/01/2024 05:00	14.2	0.39	492966.3	42.87	0	0	20.7
16/01/2024 06:00	14.19	0.32	493096.5	42.95	0	0	21.2
16/01/2024 07:00	14.22	0.14	493246.4	42.87	0	0	22
16/01/2024 08:00	14.22	0.3	492833.7	42.82	0	0	22.1
16/01/2024 09:00	14.26	0.23	494265.3	42.77	0	0	22.2
16/01/2024 10:00	14.29	0.16	497306.3	42.78	0	0	22.6
16/01/2024 11:00	14.35	0.12	501038.9	42.86	0	0	23.2
16/01/2024 12:00	14.39	0.23	505250.7	42.86	0	0	23.7
16/01/2024 13:00	14.4	0.22	502258	42.4	0	0	24.9
16/01/2024 14:00	14.37	0.34	474665.6	39.16	0	0	25.6
16/01/2024 15:00	14.42	0.32	500322.7	41.75	0	0	25.1
16/01/2024 16:00	14.42	0.34	506725.4	42.2	0	0	25.6
16/01/2024 17:00	14.42	0.36	505838.7	42.17	0	0	25.6
16/01/2024 18:00	14.37	0.48	500406.2	42.04	0	0	23.5
16/01/2024 19:00	14.28	0.28	494143.9	41.97	0	0	21.5
16/01/2024 20:00	14.23	0.65	491319.7	41.91	0	0	20.9
16/01/2024 21:00	14.22	0.77	488379.9	41.74	0	0	20.6
16/01/2024 22:00	14.22	0.91	490593.3	41.95	0	0	20.7
16/01/2024 23:00	14.26	0.77	462442	38.22	0	0	24.5
16/01/2024 24:00	14.21	0.59	493238.1	42.56	0	0	20.6
Minimum	14.16	0.12	462442	38.22	0	0	19.8
MinDate	01/16/2024 1:00:00	01/16/2024 11:00:00	01/16/2024 23:00:00	01/16/2024 23:00:00	01/16/2024 1:00:00	01/16/2024 1:00:00	01/16/2024 2:00:00
Maximum	14.42	0.91	506725.4	42.95	0	0	25.6
MaxDate	01/16/2024 15:00:00	01/16/2024 22:00:00	01/16/2024 16:00:00	01/16/2024 6:00:00	01/16/2024 1:00:00	01/16/2024 1:00:00	01/16/2024 14:00:00
Avg	14.28	0.38	493728	42.18	0	0	22.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	9493.6	1.2	0	0	2
Site ABPR52 Daily: 16/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
16/01/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 04:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 05:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 10:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 11:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 12:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/01/2024 13:00	Shutdown	0.39	Shutdown	1.01	Shutdown	Shutdown	Shutdown
16/01/2024 14:00	14.8	0.44	479128.4	38.75	0.3	0.9	31.8
16/01/2024 15:00	14.85	0.35	499668.8	41.84	0	0.9	29.4
16/01/2024 16:00	14.85	0.42	504036.6	42.29	0	0.8	29.7
16/01/2024 17:00	14.8	0.47	502606.4	42.27	0	0.8	29.6
16/01/2024 18:00	14.67	0.43	496414.4	42.13	0	0.7	28
16/01/2024 19:00	14.58	0.38	492208.8	42.06	0	0.7	26.3
16/01/2024 20:00	14.53	0.38	489562.3	42.02	0	0.7	25.8
16/01/2024 21:00	14.53	0.42	487604.3	41.83	0	0.7	25.2
16/01/2024 22:00	14.53	0.29	488990.7	42.05	0	0.8	25.4
16/01/2024 23:00	14.51	0.58	477102.4	35.98	0	0.8	25.3
16/01/2024 24:00	Shutdown	0.34	Shutdown	0.22	Shutdown	Shutdown	Shutdown
Minimum	14.51	0	477102.4	0	0	0.7	25.2
MinDate	01/16/2024 23:00:00	01/16/2024 1:00:00	01/16/2024 23:00:00	01/16/2024 1:00:00	01/16/2024 15:00:00	01/16/2024 18:00:00	01/16/2024 21:00:00
Maximum	14.85	0.58	504036.6	42.29	0.3	0.9	31.8
MaxDate	01/16/2024 15:00:00	01/16/2024 23:00:00	01/16/2024 16:00:00	01/16/2024 16:00:00	01/16/2024 14:00:00	01/16/2024 14:00:00	01/16/2024 14:00:00
Avg	14.67	0.2	491732.3	17.19	0	0.8	27.7



Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.2	9171.7	20.7	0.1	0.1	2.4
Site ABPR51 Daily: 17/01/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
17/01/2024 01:00	14.21	0.55	492772.9	42.8	0	0	20.9
17/01/2024 02:00	14.22	0.52	492904.5	42.83	0	0	20.9
17/01/2024 03:00	14.2	0.36	492836.3	42.95	0	0	20.8
17/01/2024 04:00	14.21	0.33	492102.1	42.84	0	0	21.3
17/01/2024 05:00	14.22	0.39	492554.5	42.86	0	0	22
17/01/2024 06:00	14.27	0.46	494888.3	42.9	0	0	22.8
17/01/2024 07:00	14.26	0.49	495200.8	42.94	0	0	22.7
17/01/2024 08:00	14.26	0.28	494407.5	42.87	0	0	22.5
17/01/2024 09:00	14.27	0.18	494767.5	42.83	0	0	22.2
17/01/2024 10:00	14.29	0.21	496523.3	42.76	0	0	22.5
17/01/2024 11:00	14.34	0.35	499686.3	42.76	0	0	23.1
17/01/2024 12:00	14.35	0.52	502703.4	42.86	0	0	23.9
17/01/2024 13:00	14.39	0.5	500964.2	42.47	0	0	24.4
17/01/2024 14:00	14.31	0.34	480876.1	40.33	0	0	25.3
17/01/2024 15:00	14.38	0.38	495906.8	41.48	0	0	23.6
17/01/2024 16:00	14.36	0.06	500355.9	42.18	0	0	22.8
17/01/2024 17:00	14.31	0.22	493681.3	41.67	0	0	22.1
17/01/2024 18:00	14.28	0.29	490526.2	41.57	0	0	21.7
17/01/2024 19:00	14.25	0.34	491275.3	41.84	0	0	21.3
17/01/2024 20:00	14.22	0.37	488793.9	41.74	0	0	21
17/01/2024 21:00	14.21	0.32	483801.5	41.3	0	0	20.4
17/01/2024 22:00	14.21	0.31	485654.1	41.55	0	0	20.5
17/01/2024 23:00	14.23	0.32	454128	37.38	0	0	24.9
17/01/2024 24:00	14.19	0.27	490995.4	42.46	0	0	20.9
Minimum	14.19	0.06	454128	37.38	0	0	20.4
MinDate		01/17/2024 16:00:00	01/17/2024 23:00:00	01/17/2024 23:00:00	01/17/2024 1:00:00	01/17/2024 1:00:00	01/17/2024 21:00:00
Maximum	14.39	0.55	502703.4	42.95	0	0	25.3
MaxDate	01/17/2024 13:00:00	01/17/2024 1:00:00	01/17/2024 12:00:00	01/17/2024 3:00:00	01/17/2024 1:00:00	01/17/2024 1:00:00	01/17/2024 14:00:00
Avg	14.27	0.35	491596	42.09	0	0	22.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	9494.8	1.2	0	0	1.4
Site ABPR52 Daily: 17/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
17/01/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 04:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 05:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 06:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 10:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 12:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
17/01/2024 13:00	Shutdown	0.61	Shutdown	0.66	Shutdown	Shutdown	Shutdown
17/01/2024 14:00	14.78	0.62	486547.6	39.14	0.3	0.8	32.6
17/01/2024 15:00	14.86	0.66	495645.5	41.58	0	0.8	27.9
17/01/2024 16:00	14.8	0.09	499760.7	42.28	0	0.8	27.3
17/01/2024 17:00	14.74	0.24	491814.1	41.76	0	0.8	26.5
17/01/2024 18:00	14.66	0.24	488794.8	41.65	0	0.8	26.2
17/01/2024 19:00	14.6	0.27	489121.8	41.93	0	0.7	25.9
17/01/2024 20:00	14.57	0.33	487418.6	41.84	0	0.7	25.4
17/01/2024 21:00	14.53	0.36	482735.8	41.4	0	0.7	24.8
17/01/2024 22:00	14.55	0.36	484756	41.67	0	0.8	24.9
17/01/2024 23:00	14.51	0.67	473783.4	35.19	0	0.8	24.9
17/01/2024 24:00	Shutdown	0.31	Shutdown	0.14	Shutdown	Shutdown	Shutdown
Minimum	14.51	0	473783.4	0	0	0.7	24.8
MinDate	01/17/2024 23:00:00	01/17/2024 1:00:00	01/17/2024 23:00:00	01/17/2024 1:00:00	01/17/2024 15:00:00	01/17/2024 19:00:00	01/17/2024 21:00:00
Maximum	14.86	0.67	499760.7	42.28	0.3	0.8	32.6
MaxDate	01/17/2024 15:00:00	01/17/2024 23:00:00	01/17/2024 16:00:00	01/17/2024 16:00:00	01/17/2024 14:00:00	01/17/2024 14:00:00	01/17/2024 14:00:00
Avg	14.66	0.2	488037.8	17.05	0	0.8	26.6
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.2	7115.1	20.6	0.1	0	2.3
Site ABPR51 Daily: 18/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
18/01/2024 01:00	14.17	0.22	491471.3	42.81	0	0	20.4
18/01/2024 02:00	14.17	0.1	491277	42.87	0	0	20.6
18/01/2024 03:00	14.16	0.21	491055.5	42.89	0	0	20.5
18/01/2024 04:00	14.16	0.37	490905.8	42.89	0	0	20.5
18/01/2024 05:00	14.16	0.34	490956.2	42.89	0	0	20.5
18/01/2024 06:00	14.16	0.29	492216.1	43.01	0	0	20.6
18/01/2024 07:00	14.16	0.33	490336	42.83	0	0	20.6
18/01/2024 08:00	14.18	0.3	490775.9	42.83	0	0	21
18/01/2024 09:00	14.24	0.33	494128.5	42.82	0	0	21.8
18/01/2024 10:00	14.34	0.29	499530.7	42.83	0	0	23.5
18/01/2024 11:00	14.37	0.22	503226.8	42.85	0	0	23.8
18/01/2024 12:00	14.4	0.38	505737.2	42.89	0	0	24.4
18/01/2024 13:00	14.42	0.26	503101	42.36	0	0	25.7
18/01/2024 14:00	14.39	0.24	475655.1	39.14	0	0	25.4
18/01/2024 15:00	14.43	0.42	499353	41.44	0	0	25
18/01/2024 16:00	14.42	0.34	498702.3	41.52	0	0	24.9
18/01/2024 17:00	14.35	0.23	498373	41.99	0	0	22.8
18/01/2024 18:00	14.28	0.32	489192	41.29	0	0	21.8
18/01/2024 19:00	14.28	0.35	488170.4	41.44	0	0	21.7
18/01/2024 20:00	14.22	0.38	484798.2	41.4	0	0	20.6
18/01/2024 21:00	14.17	0.37	479425.3	40.92	0	0	19.5
18/01/2024 22:00	14.19	0.32	480714.5	41	0	0	20.1
18/01/2024 23:00	14.24	0.54	451878.1	37.21	0	0	23.5
18/01/2024 24:00	14.22	0.38	494238.9	42.69	0	0	20.5
Minimum	14.16	0.1	451878.1	37.21	0	0	19.5
MinDate	01/18/2024 3:00:00	01/18/2024 2:00:00	01/18/2024 23:00:00	01/18/2024 23:00:00	01/18/2024 1:00:00	01/18/2024 1:00:00	01/18/2024 21:00:00
Maximum	14.43	0.54	505737.2	43.01	0	0	25.7
MaxDate	01/18/2024 15:00:00	01/18/2024 23:00:00	01/18/2024 12:00:00	01/18/2024 6:00:00	01/18/2024 1:00:00	01/18/2024 1:00:00	01/18/2024 13:00:00



Avg	14.26	0.31	490634	41.95	0	0	22.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	11123.7	1.4	0	0	1.9
Site ABPR52 Daily: 18/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
18/01/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 02:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 03:00	Shutdown	0.33	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 04:00	Shutdown	0.83	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 05:00	Shutdown	0.98	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 06:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 07:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 11:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 12:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
18/01/2024 13:00	Shutdown	0.42	Shutdown	1.04	Shutdown	Shutdown	Shutdown
18/01/2024 14:00	14.85	0.33	479856.9	38.78	0.3	0.9	31.5
18/01/2024 15:00	14.85	0.39	498003.5	41.54	0	0.9	29.1
18/01/2024 16:00	14.8	0.28	496142.2	41.63	0	0.9	28.8
18/01/2024 17:00	14.65	0.13	495381.8	42.07	0	0.8	27.5
18/01/2024 18:00	14.61	0.38	486599.3	41.38	0	0.8	26.4
18/01/2024 19:00	14.61	0.46	486580.1	41.53	0	0.8	26.2
18/01/2024 20:00	14.54	0.45	484621.1	41.5	0	0.8	25.1
18/01/2024 21:00	14.49	0.55	478610.1	41.02	0	0.8	24.3
18/01/2024 22:00	14.53	0.55	479961	41.08	0	0.9	24.7
18/01/2024 23:00	14.53	0.99	468418.6	34.01	0	0.9	25
18/01/2024 24:00	Shutdown	0.35	Shutdown	0.08	Shutdown	Shutdown	Shutdown
Minimum	14.49	0.01	468418.6	0	0	0.8	24.3
MinDate	01/18/2024 21:00:00	01/18/2024 1:00:00	01/18/2024 23:00:00	01/18/2024 1:00:00	01/18/2024 15:00:00	01/18/2024 17:00:00	01/18/2024 21:00:00
Maximum	14.85	0.99	498003.5	42.07	0.3	0.9	31.5
MaxDate	01/18/2024 14:00:00	01/18/2024 23:00:00	01/18/2024 15:00:00	01/18/2024 17:00:00	01/18/2024 14:00:00	01/18/2024 14:00:00	01/18/2024 14:00:00
Avg	14.65	0.33	485417.4	16.9	0	0.9	26.9
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	9266.2	20.4	0.1	0.1	2.3
Site ABPR51 Daily: 19/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
19/01/2024 01:00	14.21	0.18	491949.6	42.82	0	0	20.7
19/01/2024 02:00	14.21	0.27	491972.5	42.85	0	0	20.7
19/01/2024 03:00	14.21	0.2	492547.2	42.89	0	0	20.9
19/01/2024 04:00	14.22	0.22	492735.4	42.91	0	0	21.1
19/01/2024 05:00	14.2	0.28	492371.6	42.9	0	0	20.8
19/01/2024 06:00	14.2	0.28	493547.8	43.06	0	0	20.9
19/01/2024 07:00	14.19	0.28	491576.7	42.87	0	0	21
19/01/2024 08:00	14.2	0.24	491753.5	42.81	0	0	21.2
19/01/2024 09:00	14.25	0.27	495289.7	42.84	0	0	21.2
19/01/2024 10:00	14.34	0.37	501562.3	42.85	0	0	22.3
19/01/2024 11:00	14.41	0.47	506173.7	42.84	0	0	24.1
19/01/2024 12:00	14.44	0.28	507366.4	42.89	0	0	25.3
19/01/2024 13:00	14.43	0.33	502160.3	42.31	0	0	26.9
19/01/2024 14:00	14.38	0.29	466107.2	38.23	0	0	26.1
19/01/2024 15:00	14.39	0.28	488833.2	40.75	0	0	23.7
19/01/2024 16:00	14.34	0.13	488592.7	40.94	0	0	21.3
19/01/2024 17:00	14.29	0.19	483937.8	40.62	0	0	20.8
19/01/2024 18:00	14.28	0.25	481497.5	40.53	0	0	20.6
19/01/2024 19:00	14.25	0.29	481589.6	40.76	0	0	20.5
19/01/2024 20:00	14.22	0.29	477438.7	40.48	0	0	20.2
19/01/2024 21:00	14.22	0.28	477280.4	40.53	0	0	19.9
19/01/2024 22:00	14.2	0.31	477105.2	40.66	0	0	19.9
19/01/2024 23:00	14.21	0.21	449252.7	37.04	0	0	24.4
19/01/2024 24:00	14.2	0.19	492336.1	42.6	0	0	20.3
Minimum	14.19	0.13	449252.7	37.04	0	0	19.9
MinDate	01/19/2024 7:00:00	01/19/2024 16:00:00	01/19/2024 23:00:00	01/19/2024 23:00:00	01/19/2024 1:00:00	01/19/2024 1:00:00	01/19/2024 21:00:00
Maximum	14.44	0.47	507366.4	43.06	0	0	26.9
MaxDate	01/19/2024 12:00:00	01/19/2024 11:00:00	01/19/2024 12:00:00	01/19/2024 6:00:00	01/19/2024 1:00:00	01/19/2024 1:00:00	01/19/2024 13:00:00
Avg	14.27	0.27	488124.1	41.67	0	0	21.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	12750.8	1.6	0	0	2
Site ABPR52 Daily: 19/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
19/01/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 03:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 04:00	Shutdown	0.33	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 05:00	Shutdown	0.37	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 06:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 10:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 11:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
19/01/2024 13:00	Shutdown	0.61	Shutdown	1.02	Shutdown	Shutdown	Shutdown
19/01/2024 14:00	14.85	0.64	472205.6	37.96	0.3	0.8	32
19/01/2024 15:00	14.81	0.45	488755.8	40.85	0	0.7	27.8
19/01/2024 16:00	14.75	0.25	486221.4	41.03	0	0.7	26
19/01/2024 17:00	14.7	0.29	481438.2	40.72	0	0.7	25.4
19/01/2024 18:00	14.65	0.26	478892.7	40.62	0	0.7	25.3
19/01/2024 19:00	14.59	0.28	479954.2	40.84	0	0.7	25.1
19/01/2024 20:00	14.55	0.39	475862.8	40.57	0	0.7	24.9
19/01/2024 21:00	14.53	0.48	475733.8	40.62	0	0.7	24.7
19/01/2024 22:00	14.53	0.55	476516.2	40.75	0	0.8	24.5
19/01/2024 23:00	14.5	0.75	464770.4	34.7	0	0.8	24.8
19/01/2024 24:00	Shutdown	0.35	Shutdown	0.12	Shutdown	Shutdown	Shutdown
Minimum	14.5	0	464770.4	0	0	0.7	24.5
MinDate	01/19/2024 23:00:00	01/19/2024 1:00:00	01/19/2024 23:00:00	01/19/2024 1:00:00	01/19/2024 15:00:00	01/19/2024 15:00:00	01/19/2024 22:00:00
Maximum	14.85	0.75	488755.8	41.03	0.3	0.8	32



MaxDate	01/19/2024 14:00:00	01/19/2024 23:00:00	01/19/2024 15:00:00	01/19/2024 16:00:00	01/19/2024 14:00:00	01/19/2024 14:00:00	01/19/2024 14:00:00
Avg	14.65	0.26	478035.1	16.66	0	0.7	26.1
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.2	6833.1	20.1	0.1	0	2.3
Site ABPR51 Daily: 20/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
20/01/2024 01:00	14.16	0.21	490935.5	42.8	0	0	19.8
20/01/2024 02:00	14.16	0.22	491005.4	42.83	0	0	19.6
20/01/2024 03:00	14.16	0.22	491961.4	42.85	0	0	19.5
20/01/2024 04:00	14.16	0.18	491907.6	42.86	0	0	19.3
20/01/2024 05:00	14.16	0.28	492214.5	42.92	0	0	19.2
20/01/2024 06:00	14.15	0.29	493037.4	43.07	0	0	19.2
20/01/2024 07:00	14.16	0.25	491560.7	42.92	0	0	19.2
20/01/2024 08:00	14.16	0.3	491281.1	42.88	0	0	19
20/01/2024 09:00	14.16	0.26	491445.6	42.84	0	0	18.5
20/01/2024 10:00	14.19	0.16	494070.4	42.87	0	0	18.7
20/01/2024 11:00	14.28	0.12	498684	42.85	0	0	20.8
20/01/2024 12:00	14.38	0.28	504172	42.85	0	0	23.3
20/01/2024 13:00	14.38	0.39	500242.9	42.22	0	0	24.8
20/01/2024 14:00	14.3	0.24	435179.8	35.29	0	0	22.8
20/01/2024 15:00	14.1	0.01	442643.1	37.22	0	0	17.7
20/01/2024 16:00	14.14	0.08	442430.9	36.82	0	0	19.2
20/01/2024 17:00	14.16	0.11	441515.8	36.69	0	0	20
20/01/2024 18:00	14.14	0.15	440098.2	36.57	0	0	20.2
20/01/2024 19:00	14.1	0.17	437239.8	36.44	0	0	20.1
20/01/2024 20:00	14.09	0.12	437125.3	36.52	0	0	20
20/01/2024 21:00	14.09	0.16	436715.8	36.45	0	0	20
20/01/2024 22:00	14.09	0.14	436602.5	36.53	0	0	20
20/01/2024 23:00	14.12	0.2	422961.7	34.55	0	0	21.8
20/01/2024 24:00	14.13	0.2	392962.6	30.6	0	0	22
Minimum	14.09	0.01	392962.6	30.6	0	0	17.7
MinDate	01/20/2024 20:00:00	01/20/2024 15:00:00			01/20/2024 1:00:00	01/20/2024 1:00:00	01/20/2024 15:00:00
Maximum	14.38	0.39	504172	43.07	0	0	24.8
MaxDate	01/20/2024 12:00:00	01/20/2024 13:00:00	01/20/2024 12:00:00	01/20/2024 6:00:00	01/20/2024 1:00:00	01/20/2024 1:00:00	01/20/2024 13:00:00
Avg	14.17	0.2	466166.5	39.6	0	0	20.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	32521.2	3.8	0	0	1.6
Site ABPR52 Daily: 20/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
20/01/2024 01:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 02:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 03:00	Shutdown	0.32	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 04:00	Shutdown	0.61	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 05:00	Shutdown	0.77	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 06:00	Shutdown	0.63	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 07:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 08:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 09:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 10:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 12:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
20/01/2024 13:00	Shutdown	0.45	Shutdown	1.33	Shutdown	Shutdown	Shutdown
20/01/2024 14:00	14.77	0.45	440742.7	34.82	0.1	1	28.6
20/01/2024 15:00	14.55	0.08	443146.3	37.31	0	0.9	23.1
20/01/2024 16:00	14.55	0.33	441041.4	36.92	0	0.9	24.2
20/01/2024 17:00	14.55	0.47	439986.6	36.77	0	0.9	24.8
20/01/2024 18:00	14.52	0.46	438094	36.66	0	0.9	24.9
20/01/2024 19:00	14.47	0.52	435301.6	36.52	0	0.9	24.8
20/01/2024 20:00	14.47	0.5	435941.2	36.61	0	0.9	24.5
20/01/2024 21:00	14.44	0.47	434838.1	36.55	0	0.9	24.6
20/01/2024 22:00	14.42	0.38	434978.7	36.61	0	0.9	24.6
20/01/2024 23:00	14.43	0.21	421486.4	34.7	0	0.9	26.1
20/01/2024 24:00	14.43	0.31	390467.2	30.67	0	0.9	25.9
Minimum	14.42	0.01	390467.2	0	0	0.9	23.1
MinDate	01/20/2024 22:00:00	01/20/2024 11:00:00		01/20/2024 1:00:00	01/20/2024 15:00:00	01/20/2024 15:00:00	01/20/2024 15:00:00
Maximum	14.77	0.77	443146.3	37.31	0.1	1	28.6
MaxDate	01/20/2024 14:00:00	01/20/2024 5:00:00	01/20/2024 15:00:00	01/20/2024 15:00:00	01/20/2024 14:00:00	01/20/2024 14:00:00	01/20/2024 14:00:00
Avg	14.51	0.31	432365.8	16.48	0	0.9	25.1
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.2	15036.6	18.2	0	0	1.4
Site ABPR51 Daily: 21/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
21/01/2024 01:00	14.14	0.12	390767.2	30.23	0	0	21.3
21/01/2024 02:00	14.1	0.1	393708.3	30.73	0	0	21.7
21/01/2024 03:00	14.1	0.1	394209.9	30.9	0	0	21.5
21/01/2024 04:00	14.1	0.14	394895.8	30.97	0	0	21.2
21/01/2024 05:00	14.12	0.09	392021.5	30.46	0	0	21
21/01/2024 06:00	14.11	0.13	394686.9	30.83	0	0	21.3
21/01/2024 07:00	14.1	0.1	395610.8	31.11	0	0	21.8
21/01/2024 08:00	14.15	0.09	389057	29.84	0	0	20.9
21/01/2024 09:00	14.12	0.14	396304.8	31.15	0	0	21.9
21/01/2024 10:00	14.14	0.1	401554.6	31.83	0	0	23.7
21/01/2024 11:00	14.15	0.1	403415.5	32.1	0	0	23.9
21/01/2024 12:00	14.15	0.16	406329.2	32.42	0	0	22.7
21/01/2024 13:00	14.18	0.27	404021.9	32	0	0	23.1
21/01/2024 14:00	14.15	0.02	411343.9	33.2	0	0	21.6
21/01/2024 15:00	14.11	0.06	414379.3	33.7	0	0	21.2
21/01/2024 16:00	14.16	0.06	411596.9	33.14	0	0	22
21/01/2024 17:00	14.19	0.01	402703	31.85	0	0	23.4
21/01/2024 18:00	14.29	0.02	407751.3	31.9	0	0	27
21/01/2024 19:00	14.19	0.15	447823.4	37.42	0	0	21.1
21/01/2024 20:00	14.11	0.21	436982.2	36.43	0	0	21
21/01/2024 21:00	14.12	0.25	445753.5	37.4	0	0	20.5
21/01/2024 22:00	14.16	0.15	411486.1	32.88	0	0	24.1
21/01/2024 23:00	14.07	0.21	406472.6	32.89	0	0	23.3
21/01/2024 24:00	14.08	0.16	405683.3	32.64	0	0	23.6
Minimum	14.07	0.01	389057	29.84	0	0	20.5
MinDate	01/21/2024 23:00:00	01/21/2024 17:00:00	01/21/2024 8:00:00	01/21/2024 8:00:00	01/21/2024 1:00:00	01/21/2024 1:00:00	01/21/2024 21:00:00



Maximum	14.29	0.27	447823.4	37.42	0	0	27
MaxDate	01/21/2024 18:00:00	01/21/2024 13:00:00	01/21/2024 19:00:00	01/21/2024 19:00:00	01/21/2024 1:00:00	01/21/2024 1:00:00	01/21/2024 18:00:00
Avg	14.14	0.12	406606.6	32.42	0	0	22.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	16075.3	2.1	0	0	1.5

Site ABPR52 Daily: 21/01/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
21/01/2024 01:00	14.44	0.38	388040.8	30.29	0	0.9	25.2
21/01/2024 02:00	14.43	0.44	391112	30.81	0	1	25.6
21/01/2024 03:00	14.46	0.47	392228.1	30.97	0	1	25.7
21/01/2024 04:00	14.47	0.51	392659.9	31.05	0	1	25.4
21/01/2024 05:00	14.47	0.46	389136.4	30.53	0	1	25.1
21/01/2024 06:00	14.45	0.61	391898.3	30.9	0	1	25.4
21/01/2024 07:00	14.45	0.66	393628.9	31.19	0	1	25.9
21/01/2024 08:00	14.52	0.62	386335.8	29.93	0	1.1	24.6
21/01/2024 09:00	14.55	0.66	394495.7	31.23	0	1.1	25.9
21/01/2024 10:00	14.57	0.66	399839.8	31.91	0	1	27.9
21/01/2024 11:00	14.62	0.68	402212	32.17	0	1	27.9
21/01/2024 12:00	14.61	0.61	404463.7	32.5	0	1	27
21/01/2024 13:00	14.65	0.53	401695.6	32.06	0	0.9	27.4
21/01/2024 14:00	14.57	0.11	409046.9	33.27	0	1	25.7
21/01/2024 15:00	14.49	0.23	411593.5	33.78	0	0.9	25.5
21/01/2024 16:00	14.59	0.46	408700.9	33.21	0	0.9	26.2
21/01/2024 17:00	14.62	0.29	400328.3	31.91	0	0.9	27.6
21/01/2024 18:00	14.67	0.31	405037.5	31.95	0	0.9	31.2
21/01/2024 19:00	14.55	0.51	445655.5	37.5	0	0.9	26.1
21/01/2024 20:00	14.45	0.48	434545.1	36.5	0	0.9	25.9
21/01/2024 21:00	14.44	0.55	443829.8	37.49	0	0.9	25.4
21/01/2024 22:00	14.47	0.51	408982.9	32.96	0	0.9	28.3
21/01/2024 23:00	14.42	0.41	404881.3	32.96	0	0.9	27.7
21/01/2024 24:00	14.41	0.41	403525.2	32.72	0	0.9	27.9
Minimum	14.41	0.11	386335.8	29.93	0	0.9	24.6
MinDate			01/21/2024 14:00:00	01/21/2024 8:00:00	01/21/2024 1:00:00	01/21/2024 1:00:00	01/21/2024 8:00:00
Maximum	14.67	0.68	445655.5	37.5	0	1.1	31.2
MaxDate	01/21/2024 18:00:00	01/21/2024 11:00:00	01/21/2024 19:00:00	01/21/2024 19:00:00	01/21/2024 1:00:00	01/21/2024 8:00:00	01/21/2024 18:00:00
Avg	14.52	0.48	404328.1	32.49	0	1	26.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	16136.6	2.1	0	0.1	1.5

Site ABPR51 Daily: 22/01/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
22/01/2024 01:00	14.07	0.13	404864.8	32.62	0	0	23.2
22/01/2024 02:00	14.04	0.18	407023.7	32.97	0	0	21.6
22/01/2024 03:00	14.04	0.28	406683.9	32.89	0	0	21.7
22/01/2024 04:00	14.04	0.14	405534.2	32.68	0	0	21.8
22/01/2024 05:00	14.07	0.2	401264.8	32	0	0	22.1
22/01/2024 06:00	14.02	0.24	409287.5	33.38	0	0	21.2
22/01/2024 07:00	14.01	0.16	412726.2	33.85	0	0	20.5
22/01/2024 08:00	14.02	0.23	409026.6	33.33	0	0	21.4
22/01/2024 09:00	14.03	0.08	412851.6	33.83	0	0	20.1
22/01/2024 10:00	14.05	0.08	424253.9	35.09	0	0	19.6
22/01/2024 11:00	14.09	0.11	429927.8	35.6	0	0	19.9
22/01/2024 12:00	14.13	0.12	427532.7	35.15	0	0	21.1
22/01/2024 13:00	14.14	0.08	424194.3	34.74	0	0	20.7
22/01/2024 14:00	14.24	0.03	451956.4	37.28	0	0	20.2
22/01/2024 15:00	14.23	0.01	472280	39.84	0	0	18.8
22/01/2024 16:00	14.2	0.07	468931.2	39.53	0	0	18.8
22/01/2024 17:00	14.21	0.07	471704.4	39.86	0	0	19
22/01/2024 18:00	14.22	0.1	479806.7	40.63	0	0	19.4
22/01/2024 19:00	14.22	0.21	479597.6	40.69	0	0	19.8
22/01/2024 20:00	14.22	0.28	480396.2	40.81	0	0	19.7
22/01/2024 21:00	14.2	0.44	476434.8	40.55	0	0	19.2
22/01/2024 22:00	14.17	0.58	481120.2	41.08	0	0	18.5
22/01/2024 23:00	14.18	0.57	455929	37.99	0	0	20.7
22/01/2024 24:00	14.06	0.25	415286.4	34.03	0	0	21.5
Minimum	14.01	0.01	401264.8	32	0	0	18.5
MinDate	01/22/2024 7:00:00	01/22/2024 15:00:00	01/22/2024 5:00:00	01/22/2024 5:00:00	01/22/2024 1:00:00	01/22/2024 1:00:00	01/22/2024 22:00:00
Maximum	14.24	0.58	481120.2	41.08	0	0	23.2
MaxDate	01/22/2024 14:00:00	01/22/2024 22:00:00	01/22/2024 22:00:00	01/22/2024 22:00:00	01/22/2024 1:00:00	01/22/2024 1:00:00	01/22/2024 1:00:00
Avg	14.12	0.19	437858.9	36.27	0	0	20.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	30817.5	3.3	0	0	1.2

Site ABPR52 Daily: 22/01/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
22/01/2024 01:00	14.39	0.31	403075.6	32.7	0	0.9	27.3
22/01/2024 02:00	14.37	0.43	405177.2	33.04	0	1	26.2
22/01/2024 03:00	14.39	0.48	404941.5	32.97	0	1	26.4
22/01/2024 04:00	14.4	0.41	403594.9	32.76	0	1	26.2
22/01/2024 05:00	14.43	0.51	399393.1	32.06	0	1.1	26.7
22/01/2024 06:00	14.39	0.53	407508.1	33.46	0	1.1	25.7
22/01/2024 07:00	14.39	0.5	411066.4	33.94	0	1.1	25
22/01/2024 08:00	14.4	0.65	407384	33.4	0	1.1	25.9
22/01/2024 09:00	14.45	0.62	411028.1	33.91	0	1.1	24.7
22/01/2024 10:00	14.46	0.57	422098.7	35.16	0	1.1	24.3
22/01/2024 11:00	14.5	0.65	427189.9	35.66	0	1.1	24.8
22/01/2024 12:00	14.55	0.69	424081.9	35.21	0	1.1	25.8
22/01/2024 13:00	14.61	0.47	421108.1	34.83	0	1.1	25.4
22/01/2024 14:00	14.67	0.25	449622.2	37.29	0	1.1	24.6
22/01/2024 15:00	14.66	0.08	470322	39.9	0	1.1	23.7
22/01/2024 16:00	14.61	0.24	466640.7	39.63	0	1.1	23.8
22/01/2024 17:00	14.62	0.29	470416.2	39.95	0	1	23.9
22/01/2024 18:00	14.63	0.32	478139.7	40.74	0	1	24.4
22/01/2024 19:00	14.59	0.53	477556.5	40.78	0	1	24.8
22/01/2024 20:00	14.55	0.57	478530.9	40.9	0	0.9	24.6
22/01/2024 21:00	14.49	0.61	475108.3	40.66	0	0.9	24.4
22/01/2024 22:00	14.47	0.56	479712.4	41.17	0	0.9	23.6
22/01/2024 23:00	14.48	0.52	453845.9	38.11	0	1	25.5
22/01/2024 24:00	14.38	0.48	412974.2	34.1	0	1	26.1
Minimum	14.37	0.08	399393.1	32.06	0	0.9	23.6



MinDate	01/22/2024 2:00:00	01/22/2024 15:00:00	01/22/2024 5:00:00	01/22/2024 5:00:00	01/22/2024 1:00:00	01/22/2024 1:00:00	01/22/2024 22:00:00
Maximum	14.67	0.69	479712.4	41.17	0	1.1	27.3
MaxDate	01/22/2024 14:00:00	01/22/2024 12:00:00	01/22/2024 22:00:00	01/22/2024 22:00:00	01/22/2024 1:00:00	01/22/2024 5:00:00	01/22/2024 1:00:00
Avg	14.5	0.47	435854.8	36.35	0	1	25.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	30919.3	3.3	0	0.1	1
Site ABPR51 Daily: 23/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
23/01/2024 01:00	14.06	0.25	411497	33.54	0	0	21.6
23/01/2024 02:00	14.03	0.22	419338.1	34.6	0	0	20.3
23/01/2024 03:00	14.03	0.13	418300.4	34.52	0	0	20.5
23/01/2024 04:00	14.05	0.27	418458.2	34.44	0	0	20.6
23/01/2024 05:00	14.07	0.17	404435.1	32.51	0	0	22.4
23/01/2024 06:00	14.04	0.36	412438	33.71	0	0	21.5
23/01/2024 07:00	14.03	0.53	413812.4	33.95	0	0	20.7
23/01/2024 08:00	14.03	0.58	414204.3	33.98	0	0	20.4
23/01/2024 09:00	14.05	0.35	425041.2	35.19	0	0	19.6
23/01/2024 10:00	14.08	0.63	430292.4	35.74	0	0	20
23/01/2024 11:00	14.1	0.43	427102.1	35.22	0	0	20.2
23/01/2024 12:00	14.12	0.52	428905.3	35.38	0	0	20.3
23/01/2024 13:00	14.12	0.45	424622	34.91	0	0	20.5
23/01/2024 14:00	14.16	0.26	419478.7	33.95	0	0	21.7
23/01/2024 15:00	14.09	0.25	418840.9	34.29	0	0	20.7
23/01/2024 16:00	14.1	0.17	455669	38.62	0	0	24.3
23/01/2024 17:00	14.08	0.38	528235.6	47.25	0	0	32.2
23/01/2024 18:00	14.05	0.41	528894.8	47.48	0	0	31.6
23/01/2024 19:00	14.14	0.37	488062.6	42.06	0	0	21.2
23/01/2024 20:00	14.15	0.23	473713.8	40.36	0	0	18.7
23/01/2024 21:00	14.11	0.22	462009.2	39.28	0	0	18.4
23/01/2024 22:00	14.11	0.37	459990.5	39.06	0	0	18.6
23/01/2024 23:00	14.12	0.4	443689.5	36.97	0	0	19.4
23/01/2024 24:00	14.05	0.13	408814.5	33.1	0	0	21
Minimum	14.03	0.13	404435.1	32.51	0	0	18.4
MinDate	01/23/2024 2:00:00	01/23/2024 3:00:00	01/23/2024 5:00:00	01/23/2024 5:00:00	01/23/2024 1:00:00	01/23/2024 1:00:00	01/23/2024 21:00:00
Maximum	14.16	0.63	528894.8	47.48	0	0	32.2
MaxDate	01/23/2024 14:00:00	01/23/2024 10:00:00	01/23/2024 18:00:00	01/23/2024 18:00:00	01/23/2024 1:00:00	01/23/2024 1:00:00	01/23/2024 17:00:00
Avg	14.08	0.34	438993.6	36.67	0	0	21.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	35194.2	4.1	0	0	3.4
Site ABPR52 Daily: 23/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
23/01/2024 01:00	14.39	0.5	409387	33.62	0	1	26.2
23/01/2024 02:00	14.37	0.34	417364.1	34.68	0	1	24.9
23/01/2024 03:00	14.41	0.23	416642.6	34.59	0	1	25
23/01/2024 04:00	14.41	0.34	416114.9	34.51	0	1.1	25
23/01/2024 05:00	14.43	0.3	402521.8	32.6	0	1.1	27
23/01/2024 06:00	14.41	0.33	410697.5	33.8	0	1.1	26.1
23/01/2024 07:00	14.36	0.37	411393.7	34.02	0	1.1	25.3
23/01/2024 08:00	14.36	0.41	411843.3	34.05	0	1.1	25.3
23/01/2024 09:00	14.37	0.41	422399.4	35.27	0	1	25
23/01/2024 10:00	14.41	0.46	427264.5	35.81	0	1	25.5
23/01/2024 11:00	14.45	0.51	423584.3	35.3	0	1.1	25.6
23/01/2024 12:00	14.49	0.54	425451.3	35.47	0	1	25.5
23/01/2024 13:00	14.47	0.55	420994	34.97	0	1.1	25.7
23/01/2024 14:00	14.48	0.67	493584.7	43.02	0	1	33
23/01/2024 15:00	14.39	0.73	530404	47.9	0	1	37.3
23/01/2024 16:00	14.42	0.61	488687.7	42.82	0	1	33.7
23/01/2024 17:00	14.47	0.54	407499.5	33.07	0	1	27.3
23/01/2024 18:00	14.45	0.51	407224.8	33.14	0	1	26.5
23/01/2024 19:00	14.5	0.43	466725.8	39.66	0	1	23.8
23/01/2024 20:00	14.5	0.46	473030.5	40.46	0	1	23.7
23/01/2024 21:00	14.48	0.41	460547.6	39.36	0	1	23.4
23/01/2024 22:00	14.5	0.4	459059.3	39.13	0	1	23.6
23/01/2024 23:00	14.51	0.38	442165.1	37.04	0	1	24.4
23/01/2024 24:00	14.41	0.22	406426.6	33.18	0	1	25.9
Minimum	14.36	0.22	402521.8	32.6	0	1	23.4
MinDate	01/23/2024 7:00:00		01/23/2024 5:00:00	01/23/2024 5:00:00	01/23/2024 1:00:00	01/23/2024 1:00:00	01/23/2024 21:00:00
Maximum	14.51	0.73	530404	47.9	0	1.1	37.3
MaxDate	01/23/2024 23:00:00	01/23/2024 15:00:00	01/23/2024 15:00:00	01/23/2024 15:00:00	01/23/2024 1:00:00	01/23/2024 4:00:00	01/23/2024 15:00:00
Avg	14.44	0.44	435459	36.56	0	1	26.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	33960.6	3.9	0	0	3.4
Site ABPR51 Daily: 24/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
24/01/2024 01:00	14.08	0.13	407620.6	32.89	0	0	21.6
24/01/2024 02:00	14.05	0.12	415914.3	34.09	0	0	20.8
24/01/2024 03:00	14.05	0.2	412937.4	33.79	0	0	21
24/01/2024 04:00	14.1	0.05	411815.2	33.54	0	0	23.8
24/01/2024 05:00	14.15	0.05	403714.5	32.36	0	0	27.8
24/01/2024 06:00	14.13	0.04	407463.4	33	0	0	27.8
24/01/2024 07:00	14.13	0.04	409005.2	33.22	0	0	26.8
24/01/2024 08:00	14.15	0.05	407536.4	33	0	0	27.6
24/01/2024 09:00	14.14	0.05	412115.2	33.62	0	0	26.9
24/01/2024 10:00	14.17	0.01	419472.1	34.57	0	0	24.8
24/01/2024 11:00	14.17	0.01	418602.8	34.3	0	0	24.5
24/01/2024 12:00	14.17	0.04	413624	33.56	0	0	25.2
24/01/2024 13:00	14.18	0.08	408186.8	32.74	0	0	26.3
24/01/2024 14:00	14.32	0.43	450435.1	36.89	0	0	23.9
24/01/2024 15:00	14.29	0.55	470241.1	39.48	0	0	22.2
24/01/2024 16:00	14.29	0.53	469890.3	39.53	0	0	22.3
24/01/2024 17:00	14.28	0.37	470075.3	39.54	0	0	22.1
24/01/2024 18:00	14.27	0.29	469094.3	39.49	0	0	21.9
24/01/2024 19:00	14.21	0.17	464325.6	39.25	0	0	21.4
24/01/2024 20:00	14.22	0.3	461693.6	38.98	0	0	22.1
24/01/2024 21:00	14.22	0.24	457987.8	38.62	0	0	22.3
24/01/2024 22:00	14.23	0.31	458807	38.62	0	0	22.7
24/01/2024 23:00	14.25	0.35	437649.5	35.91	0	0	25.3
24/01/2024 24:00	14.16	0.08	406304.1	32.68	0	0	28.7



Minimum	14.05	0.01	403714.5	32.36	0	0	20.8
MinDate	01/24/2024 2:00:00	01/24/2024 10:00:00	01/24/2024 5:00:00	01/24/2024 5:00:00	01/24/2024 1:00:00	01/24/2024 1:00:00	01/24/2024 2:00:00
Maximum	14.32	0.55	470241.1	39.54	0	0	28.7
MaxDate	01/24/2024 14:00:00	01/24/2024 15:00:00	01/24/2024 15:00:00	01/24/2024 17:00:00	01/24/2024 1:00:00	01/24/2024 1:00:00	
Avg	14.18	0.19	431854.7	35.57	0	0	24.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	26264.3	2.8	0	0	2.5
Site ABPR52 Daily: 24/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
24/01/2024 01:00	14.41	0.19	405147.5	32.99	0	1.1	26.2
24/01/2024 02:00	14.4	0.35	413032.3	34.16	0	1.1	25.5
24/01/2024 03:00	14.4	0.23	410667.5	33.87	0	1.1	25.6
24/01/2024 04:00	14.43	0.27	409388	33.61	0	1.1	28.2
24/01/2024 05:00	14.45	0.35	400749.4	32.44	0	1.1	31.3
24/01/2024 06:00	14.42	0.34	404878.1	33.07	0	1	31.8
24/01/2024 07:00	14.42	0.37	406740.9	33.3	0	1	31.1
24/01/2024 08:00	14.43	0.42	405162	33.07	0	0.9	31.9
24/01/2024 09:00	14.45	0.4	410091	33.7	0	0.8	31
24/01/2024 10:00	14.46	0.26	417156.1	34.63	0	0.8	29.1
24/01/2024 11:00	14.46	0.37	415324.2	34.38	0	0.7	29
24/01/2024 12:00	14.48	0.46	410550.7	33.62	0	0.7	29.9
24/01/2024 13:00	14.51	0.54	405050	32.81	0	0.6	30.8
24/01/2024 14:00	14.62	0.68	446850.4	36.99	0	0.6	28.6
24/01/2024 15:00	14.6	0.69	466589.2	39.58	0	0.6	27.5
24/01/2024 16:00	14.6	0.65	466231.3	39.61	0	0.6	27.6
24/01/2024 17:00	14.6	0.67	466875.2	39.62	0	0.6	27.4
24/01/2024 18:00	14.59	0.6	465997.4	39.58	0	0.5	27.1
24/01/2024 19:00	14.56	0.32	462228.1	39.34	0	0.5	26.4
24/01/2024 20:00	14.58	0.3	459918.5	39.09	0	0.5	26.9
24/01/2024 21:00	14.58	0.17	456420.8	38.72	0	0.6	27.1
24/01/2024 22:00	14.57	0.28	456378.8	38.7	0	0.6	27.5
24/01/2024 23:00	14.56	0.3	434903.9	36	0	0.6	29.6
24/01/2024 24:00	14.48	0.2	403726.8	32.76	0	0.5	32
Minimum	14.4	0.17	400749.4	32.44	0	0.5	25.5
MinDate	01/24/2024 2:00:00	01/24/2024 21:00:00	01/24/2024 5:00:00	01/24/2024 5:00:00	01/24/2024 1:00:00	01/24/2024 18:00:00	01/24/2024 2:00:00
Maximum	14.62	0.69	466875.2	39.62	0	1.1	32
MaxDate	01/24/2024 14:00:00	01/24/2024 15:00:00	01/24/2024 17:00:00	01/24/2024 17:00:00	01/24/2024 1:00:00	01/24/2024 1:00:00	
Avg	14.5	0.39	429169.1	35.65	0	0.8	28.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	26161.4	2.8	0	0.2	2.1
Site ABPR51 Daily: 25/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
25/01/2024 01:00	14.19	0.04	399613.2	31.72	0	0	29.1
25/01/2024 02:00	14.15	0.06	407256	32.99	0	0	28.9
25/01/2024 03:00	14.15	0.11	405289.4	32.68	0	0	28.8
25/01/2024 04:00	14.16	0.12	402768.7	32.27	0	0	28.5
25/01/2024 05:00	14.21	0.08	392728.1	30.64	0	0	27.9
25/01/2024 06:00	14.15	0.05	402091.3	32.23	0	0	28.9
25/01/2024 07:00	14.14	0.13	403360.6	32.47	0	0	29
25/01/2024 08:00	14.16	0.07	402767	32.31	0	0	28.7
25/01/2024 09:00	14.18	0.01	405504.2	32.67	0	0	28.1
25/01/2024 10:00	14.19	0.05	416654.4	33.89	0	0	24.6
25/01/2024 11:00	14.2	0.2	416769.5	33.84	0	0	24.6
25/01/2024 12:00	14.21	0.29	411781.4	33.19	0	0	25.3
25/01/2024 13:00	14.22	0.21	408833.2	32.72	0	0	26.1
25/01/2024 14:00	14.32	0.18	439058.1	35.61	0	0	24.1
25/01/2024 15:00	14.3	0.2	464509.3	38.86	0	0	22.3
25/01/2024 16:00	14.3	0.26	462640	38.61	0	0	22.4
25/01/2024 17:00	14.25	0.24	455993.8	38.17	0	0	21.6
25/01/2024 18:00	14.2	0.26	452306.2	37.94	0	0	21.2
25/01/2024 19:00	14.16	0.27	448981.3	37.73	0	0	20.9
25/01/2024 20:00	14.16	0.47	449157.3	37.71	0	0	21
25/01/2024 21:00	14.16	0.82	449130.1	37.67	0	0	20.4
25/01/2024 22:00	14.19	0.47	451271.7	37.92	0	0	21.6
25/01/2024 23:00	14.24	0.33	439818.1	36.23	0	0	24.3
25/01/2024 24:00	14.15	0.06	403086	32.23	0	0	27.7
Minimum	14.14	0.01	392728.1	30.64	0	0	20.4
MinDate	01/25/2024 7:00:00	01/25/2024 9:00:00	01/25/2024 5:00:00	01/25/2024 5:00:00	01/25/2024 1:00:00	01/25/2024 1:00:00	01/25/2024 21:00:00
Maximum	14.32	0.82	464509.3	38.86	0	0	29.1
MaxDate	01/25/2024 14:00:00	01/25/2024 21:00:00	01/25/2024 15:00:00	01/25/2024 15:00:00	01/25/2024 1:00:00	01/25/2024 1:00:00	01/25/2024 1:00:00
Avg	14.2	0.21	424640.4	34.68	0	0	25.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	24077.6	2.7	0	0	3.2
Site ABPR52 Daily: 25/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
25/01/2024 01:00	14.49	0.26	397232.4	31.81	0	0.5	32.2
25/01/2024 02:00	14.46	0.25	405296.8	33.08	0	0.5	32.1
25/01/2024 03:00	14.45	0.31	403530.4	32.75	0	0.4	32.4
25/01/2024 04:00	14.46	0.35	400368.7	32.34	0	0.4	32.3
25/01/2024 05:00	14.51	0.35	390322.3	30.7	0	0.4	30.9
25/01/2024 06:00	14.46	0.31	399764.5	32.31	0	0.4	32.8
25/01/2024 07:00	14.44	0.35	401238.1	32.55	0	0.3	32.7
25/01/2024 08:00	14.44	0.34	400325.2	32.38	0	0.3	32.5
25/01/2024 09:00	14.46	0.38	403708.4	32.75	0	0.3	32.4
25/01/2024 10:00	14.48	0.5	413550.9	33.94	0	0.3	29.4
25/01/2024 11:00	14.51	0.54	413347.2	33.91	0	0.3	29.5
25/01/2024 12:00	14.53	0.6	408785.2	33.26	0	0.3	29.9
25/01/2024 13:00	14.56	0.61	405786.3	32.8	0	0.3	30.3
25/01/2024 14:00	14.68	0.54	435260.9	35.67	0	0.4	28.5
25/01/2024 15:00	14.67	0.49	461389.9	38.96	0	0.4	27.3
25/01/2024 16:00	14.68	0.51	459395.5	38.7	0	0.4	27.4
25/01/2024 17:00	14.59	0.26	452878.9	38.26	0	0.4	26.8
25/01/2024 18:00	14.54	0.34	449393.2	38.02	0	0.4	26.4
25/01/2024 19:00	14.52	0.35	446920	37.81	0	0.5	25.9
25/01/2024 20:00	14.51	0.43	446838.3	37.79	0	0.5	25.9
25/01/2024 21:00	14.47	0.35	445909.8	37.76	0	0.6	25.7
25/01/2024 22:00	14.49	0.25	448410.7	38	0	0.7	26.5
25/01/2024 23:00	14.53	0.27	437268.1	36.32	0	0.7	28.6



25/01/2024 24:00	14.48	0.23	400168.3	32.31	0	0.7	31.1
Minimum	14.44	0.23	390322.3	30.7	0	0.3	25.7
MinDate	01/25/2024 7:00:00		01/25/2024 5:00:00	01/25/2024 5:00:00	01/25/2024 1:00:00	01/25/2024 7:00:00	01/25/2024 21:00:00
Maximum	14.68	0.61	461389.9	38.96	0	0.7	32.8
MaxDate	01/25/2024 14:00:00	01/25/2024 13:00:00	01/25/2024 15:00:00	01/25/2024 15:00:00	01/25/2024 1:00:00	01/25/2024 22:00:00	01/25/2024 6:00:00
Avg	14.52	0.38	421962.1	34.76	0	0.4	29.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	23833.6	2.7	0	0.1	2.6
Site ABPR51 Daily: 26/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
26/01/2024 01:00	14.17	0.07	400876.5	31.97	0	0	28.1
26/01/2024 02:00	14.15	0.12	402905	32.32	0	0	28.3
26/01/2024 03:00	14.15	0.16	403766.4	32.45	0	0	28.2
26/01/2024 04:00	14.14	0.26	404063	32.53	0	0	28.2
26/01/2024 05:00	14.19	0.2	395890	31.18	0	0	27.8
26/01/2024 06:00	14.15	0.18	402366.2	32.32	0	0	28.5
26/01/2024 07:00	14.15	0.09	402802.2	32.38	0	0	28.7
26/01/2024 08:00	14.18	0.01	398635.3	31.69	0	0	28.1
26/01/2024 09:00	14.17	0.01	403055.9	32.33	0	0	28
26/01/2024 10:00	14.14	0.06	410744	33.57	0	0	27.1
26/01/2024 11:00	14.16	0.03	412380.9	33.51	0	0	25.7
26/01/2024 12:00	14.19	0.07	405510.5	32.49	0	0	26.5
26/01/2024 13:00	14.22	0.18	401385.3	31.64	0	0	27.2
26/01/2024 14:00	14.35	0.37	442542.1	35.81	0	0	23.8
26/01/2024 15:00	14.34	0.52	467803.3	38.95	0	0	21.8
26/01/2024 16:00	14.35	0.41	468335.7	38.96	0	0	21.8
26/01/2024 17:00	14.32	0.21	463393.6	38.64	0	0	21.7
26/01/2024 18:00	14.27	0.07	457377.8	38.27	0	0	21.6
26/01/2024 19:00	14.24	0.29	459557.8	38.66	0	0	21.1
26/01/2024 20:00	14.17	0.26	455137.5	38.4	0	0	20.7
26/01/2024 21:00	14.15	0.32	451835.5	38.18	0	0	20.4
26/01/2024 22:00	14.14	0.29	450278.8	38.04	0	0	20.3
26/01/2024 23:00	14.16	0.25	435340.5	35.91	0	0	22.1
26/01/2024 24:00	14.11	0.53	401891.2	32.06	0	0	24.3
Minimum	14.11	0.01	395890	31.18	0	0	20.3
MinDate		01/26/2024 8:00:00	01/26/2024 5:00:00	01/26/2024 5:00:00	01/26/2024 1:00:00	01/26/2024 1:00:00	01/26/2024 22:00:00
Maximum	14.35	0.53	468335.7	38.96	0	0	28.7
MaxDate	01/26/2024 14:00:00		01/26/2024 16:00:00	01/26/2024 16:00:00	01/26/2024 1:00:00	01/26/2024 1:00:00	01/26/2024 7:00:00
Avg	14.2	0.21	424911.5	34.68	0	0	25
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	27130.8	3	0	0	3.2
Site ABPR52 Daily: 26/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
26/01/2024 01:00	14.5	0.4	398724.2	32.03	0	0.6	31.8
26/01/2024 02:00	14.47	0.42	401260.5	32.39	0	0.5	32.4
26/01/2024 03:00	14.44	0.34	401191.5	32.53	0	0.5	32.1
26/01/2024 04:00	14.44	0.4	401785.5	32.61	0	0.5	31.8
26/01/2024 05:00	14.49	0.37	393302.3	31.24	0	0.5	31
26/01/2024 06:00	14.45	0.37	400666	32.4	0	0.4	32.1
26/01/2024 07:00	14.45	0.35	400495.8	32.46	0	0.4	32.3
26/01/2024 08:00	14.46	0.33	396445.4	31.76	0	0.4	31.3
26/01/2024 09:00	14.44	0.42	400358.9	32.4	0	0.3	31.8
26/01/2024 10:00	14.43	0.48	408958.7	33.64	0	0.3	30.8
26/01/2024 11:00	14.46	0.53	409581.4	33.58	0	0.3	29.8
26/01/2024 12:00	14.51	0.53	403404.9	32.56	0	0.4	30.4
26/01/2024 13:00	14.59	0.58	398003.7	31.71	0	0.4	30.9
26/01/2024 14:00	14.7	0.59	438588	35.87	0	0.5	27.9
26/01/2024 15:00	14.73	0.68	463309.1	39.03	0	0.5	26.7
26/01/2024 16:00	14.72	0.59	463433.3	39.05	0	0.5	26.7
26/01/2024 17:00	14.68	0.36	459429	38.72	0	0.5	26.5
26/01/2024 18:00	14.61	0.12	454728.5	38.36	0	0.5	26.3
26/01/2024 19:00	14.57	0.39	457068.5	38.74	0	0.5	26.1
26/01/2024 20:00	14.52	0.28	452428.4	38.49	0	0.5	25.3
26/01/2024 21:00	14.48	0.34	449890.9	38.26	0	0.5	25
26/01/2024 22:00	14.48	0.44	448589.7	38.13	0	0.6	24.8
26/01/2024 23:00	14.51	0.44	433606.7	36.01	0	0.7	26.2
26/01/2024 24:00	14.45	0.57	399878.2	32.14	0	0.7	28.3
Minimum	14.43	0.12	393302.3	31.24	0	0.3	24.8
MinDate	01/26/2024 10:00:00	01/26/2024 18:00:00	01/26/2024 5:00:00	01/26/2024 5:00:00	01/26/2024 1:00:00	01/26/2024 9:00:00	01/26/2024 22:00:00
Maximum	14.73	0.68	463433.3	39.05	0	0.7	32.4
MaxDate	01/26/2024 15:00:00	01/26/2024 15:00:00	01/26/2024 16:00:00	01/26/2024 16:00:00	01/26/2024 1:00:00	01/26/2024 23:00:00	01/26/2024 2:00:00
Avg	14.52	0.43	422297.1	34.75	0	0.5	29.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	26665.7	3	0	0.1	2.7
Site ABPR51 Daily: 27/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
27/01/2024 01:00	14.15	0.65	397207.8	31.34	0	0	24.1
27/01/2024 02:00	14.13	0.5	399306.6	31.7	0	0	24
27/01/2024 03:00	14.1	0.38	401948.4	32.12	0	0	24.2
27/01/2024 04:00	14.13	0.2	398686.7	31.58	0	0	24.3
27/01/2024 05:00	14.17	0.25	393333.4	30.79	0	0	25
27/01/2024 06:00	14.17	0.25	395371.5	31.11	0	0	25.5
27/01/2024 07:00	14.2	0.32	392350.9	30.46	0	0	25.5
27/01/2024 08:00	14.25	0.21	386300.8	29.28	0	0	24.7
27/01/2024 09:00	14.29	0.13	383855.9	28.83	0	0	24.3
27/01/2024 10:00	14.28	0.05	388160.1	29.54	0	0	25.1
27/01/2024 11:00	14.28	0.04	389623	29.8	0	0	25.2
27/01/2024 12:00	14.29	0.16	389564	29.58	0	0	25.3
27/01/2024 13:00	14.34	0.33	384643.4	28.65	0	0	24.5
27/01/2024 14:00	14.33	0.34	414557.2	32.37	0	0	26.9
27/01/2024 15:00	14.25	0.24	429105.6	34.98	0	0	22.3
27/01/2024 16:00	14.22	0.21	423732	34.39	0	0	22.3
27/01/2024 17:00	14.24	0.33	425673	34.6	0	0	22.1
27/01/2024 18:00	14.11	0.11	422103.2	34.74	0	0	19.9
27/01/2024 19:00	14.16	0.24	423254	34.74	0	0	21.5
27/01/2024 20:00	14.14	0.28	423881.2	34.9	0	0	21.5
27/01/2024 21:00	14.1	0.21	420700.7	34.65	0	0	21.3
27/01/2024 22:00	14.09	0.25	421484.4	34.75	0	0	20.9



27/01/2024 23:00	14.16	0.18	404752.3	32.07	0	0	24.6
27/01/2024 24:00	14.3	0.16	378014.7	27.73	0	0	23.6
Minimum	14.09	0.04	378014.7	27.73	0	0	19.9
MinDate	01/27/2024 22:00:00	01/27/2024 11:00:00			01/27/2024 1:00:00	01/27/2024 1:00:00	01/27/2024 18:00:00
Maximum	14.34	0.65	429105.6	34.98	0	0	26.9
MaxDate	01/27/2024 13:00:00	01/27/2024 1:00:00	01/27/2024 15:00:00	01/27/2024 15:00:00	01/27/2024 1:00:00	01/27/2024 1:00:00	01/27/2024 14:00:00
Avg	14.2	0.25	403650.4	31.86	0	0	23.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	16335.6	2.4	0	0	1.8
Site ABPR52 Daily: 27/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
27/01/2024 01:00	14.46	0.49	394756.8	31.42	0	0.8	27.7
27/01/2024 02:00	14.44	0.59	397017.7	31.77	0	0.8	27.8
27/01/2024 03:00	14.43	0.59	399793.6	32.21	0	0.9	28.2
27/01/2024 04:00	14.44	0.42	396159.4	31.65	0	0.9	28.3
27/01/2024 05:00	14.48	0.45	390786.6	30.86	0	0.9	28.7
27/01/2024 06:00	14.49	0.47	392880.6	31.18	0	0.9	31.3
27/01/2024 07:00	14.5	0.48	388741.8	30.53	0	0.8	29
27/01/2024 08:00	14.55	0.42	382255.1	29.35	0	0.8	27.8
27/01/2024 09:00	14.59	0.43	380095.3	28.92	0	0.8	27.1
27/01/2024 10:00	14.59	0.4	384602.4	29.6	0	0.8	28.2
27/01/2024 11:00	14.6	0.39	387015.5	29.86	0	0.8	28.5
27/01/2024 12:00	14.63	0.52	385678.7	29.65	0	0.8	28.5
27/01/2024 13:00	14.71	0.6	381029.2	28.73	0	0.8	27.1
27/01/2024 14:00	14.71	0.64	410070.1	32.47	0	0.8	31.5
27/01/2024 15:00	14.62	0.4	424046.5	35.05	0	0.8	27.4
27/01/2024 16:00	14.6	0.4	418761	34.45	0	0.8	27.4
27/01/2024 17:00	14.59	0.44	420716	34.66	0	0.8	27.2
27/01/2024 18:00	14.49	0.13	418132.5	34.79	0	0.7	25.1
27/01/2024 19:00	14.48	0.21	419984	34.81	0	0.7	26.3
27/01/2024 20:00	14.45	0.43	420247.1	34.98	0	0.7	26.2
27/01/2024 21:00	14.41	0.49	418006.6	34.72	0	0.7	25.9
27/01/2024 22:00	14.41	0.6	418686.8	34.82	0	0.8	25.5
27/01/2024 23:00	14.49	0.53	402221.1	32.14	0	0.8	28.9
27/01/2024 24:00	14.61	0.52	374034.7	27.79	0	0.9	26
Minimum	14.41	0.13	374034.7	27.79	0	0.7	25.1
MinDate	01/27/2024 21:00:00	01/27/2024 18:00:00			01/27/2024 1:00:00	01/27/2024 18:00:00	01/27/2024 18:00:00
Maximum	14.71	0.64	424046.5	35.05	0	0.9	31.5
MaxDate	01/27/2024 13:00:00	01/27/2024 14:00:00	01/27/2024 15:00:00	01/27/2024 15:00:00	01/27/2024 1:00:00	01/27/2024 3:00:00	01/27/2024 14:00:00
Avg	14.53	0.46	400238.3	31.93	0	0.8	27.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	16077.9	2.4	0	0.1	1.6
Site ABPR51 Daily: 28/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
28/01/2024 01:00	14.3	0.22	376875.8	27.59	0	0	23.5
28/01/2024 02:00	14.24	0.21	383129.9	28.74	0	0	21.7
28/01/2024 03:00	14.23	0.23	383902.7	28.88	0	0	21.8
28/01/2024 04:00	14.24	0.24	382114.8	28.53	0	0	21.3
28/01/2024 05:00	14.28	0.16	376476.9	27.63	0	0	23
28/01/2024 06:00	14.25	0.15	379590.5	28.22	0	0	22.3
28/01/2024 07:00	14.27	0.24	378409.5	27.98	0	0	22.4
28/01/2024 08:00	14.27	0.18	379338	28.03	0	0	21.8
28/01/2024 09:00	14.32	0.28	380030.6	28.05	0	0	23.2
28/01/2024 10:00	14.31	0.09	384976.5	28.86	0	0	23.8
28/01/2024 11:00	14.31	0.18	387482.3	29.16	0	0	24.5
28/01/2024 12:00	14.33	0.21	385719	28.84	0	0	24.1
28/01/2024 13:00	14.39	0.18	380345.5	27.72	0	0	23.3
28/01/2024 14:00	14.31	0.23	388552.4	29.42	0	0	24.6
28/01/2024 15:00	14.32	0.28	386652.9	28.96	0	0	24
28/01/2024 16:00	14.33	0.06	383416.9	28.42	0	0	22.5
28/01/2024 17:00	14.29	0.05	385442.3	28.92	0	0	22
28/01/2024 18:00	14.27	0.05	394731.2	29.63	0	0	25.3
28/01/2024 19:00	14.11	0.03	418111.2	34.31	0	0	20.5
28/01/2024 20:00	14.11	0.01	417676	34.38	0	0	20.5
28/01/2024 21:00	14.1	0.02	417513.3	34.37	0	0	20.5
28/01/2024 22:00	14.29	0.08	384241.4	28.55	0	0	24.7
28/01/2024 23:00	14.33	0.17	376476.5	27.28	0	0	22.2
28/01/2024 24:00	14.33	0.15	374324.9	26.95	0	0	23.8
Minimum	14.1	0.01	374324.9	26.95	0	0	20.5
MinDate	01/28/2024 21:00:00	01/28/2024 20:00:00			01/28/2024 1:00:00	01/28/2024 1:00:00	01/28/2024 19:00:00
Maximum	14.39	0.28	418111.2	34.38	0	0	25.3
MaxDate	01/28/2024 13:00:00	01/28/2024 9:00:00	01/28/2024 19:00:00	01/28/2024 20:00:00	01/28/2024 1:00:00	01/28/2024 1:00:00	01/28/2024 18:00:00
Avg	14.27	0.15	386897.1	29.14	0	0	22.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	12758.3	2.1	0	0	1.4
Site ABPR52 Daily: 28/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
28/01/2024 01:00	14.62	0.54	373204.7	27.65	0	0.9	25.7
28/01/2024 02:00	14.56	0.46	379479.7	28.82	0	1	24.6
28/01/2024 03:00	14.57	0.53	380608.3	28.96	0	1	24.8
28/01/2024 04:00	14.58	0.5	378370.1	28.61	0	1	24.3
28/01/2024 05:00	14.59	0.37	373430.5	27.7	0	1	25.1
28/01/2024 06:00	14.58	0.35	376322.4	28.29	0	1	24.9
28/01/2024 07:00	14.59	0.36	375176.5	28.06	0	1	24.9
28/01/2024 08:00	14.6	0.18	375347.8	28.1	0	1	24.4
28/01/2024 09:00	14.63	0.2	375991.4	28.12	0	1	25.6
28/01/2024 10:00	14.65	0.19	381066.3	28.93	0	1	26.7
28/01/2024 11:00	14.66	0.32	383234.5	29.24	0	0.9	27.4
28/01/2024 12:00	14.72	0.44	382126.9	28.91	0	0.9	26.7
28/01/2024 13:00	14.78	0.39	375811.3	27.79	0	0.9	25.5
28/01/2024 14:00	14.72	0.47	385461.1	29.48	0	0.9	27.7
28/01/2024 15:00	14.71	0.61	382737.2	29.03	0	0.9	27.2
28/01/2024 16:00	14.73	0.37	379184.1	28.48	0	0.9	25.5
28/01/2024 17:00	14.67	0.45	382098.5	28.99	0	0.9	25.4
28/01/2024 18:00	14.63	0.38	392377.8	29.66	0	0.9	29
28/01/2024 19:00	14.48	0.25	415544.1	34.38	0	0.9	25.1
28/01/2024 20:00	14.47	0.17	416001	34.46	0	0.9	25.1
28/01/2024 21:00	14.46	0.15	415994.6	34.44	0	0.9	25



28/01/2024 22:00	14.63	0.26	380253.2	28.61	0	0.9	28.4
28/01/2024 23:00	14.66	0.38	371884.9	27.34	0	1	24.5
28/01/2024 24:00	14.67	0.4	370284.7	27	0	1	25.9
Minimum	14.46	0.15	370284.7	27	0	0.9	24.3
MinDate	01/28/2024 21:00:00	01/28/2024 21:00:00			01/28/2024 1:00:00	01/28/2024 1:00:00	01/28/2024 4:00:00
Maximum	14.78	0.61	416001	34.46	0	1	29
MaxDate	01/28/2024 13:00:00	01/28/2024 15:00:00	01/28/2024 20:00:00	01/28/2024 20:00:00	01/28/2024 1:00:00	01/28/2024 2:00:00	01/28/2024 18:00:00
Avg	14.62	0.36	383416.3	29.21	0	0.9	25.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	13402	2.1	0	0.1	1.3
Site ABPR51 Daily: 29/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
29/01/2024 01:00	14.31	0.09	375382.8	27.15	0	0	23.3
29/01/2024 02:00	14.29	0.06	378295.7	27.78	0	0	20.3
29/01/2024 03:00	14.28	0.09	378823	27.85	0	0	20.9
29/01/2024 04:00	14.3	0.21	378285.8	27.71	0	0	22.3
29/01/2024 05:00	14.34	0.11	375841.4	27.27	0	0	25.2
29/01/2024 06:00	14.29	0.13	381894.1	28.56	0	0	23.8
29/01/2024 07:00	14.2	0.28	391964.8	30.46	0	0	25
29/01/2024 08:00	14.28	0.31	382011.8	28.54	0	0	23.8
29/01/2024 09:00	14.21	0.14	396778.7	31.08	0	0	25.5
29/01/2024 10:00	14.17	0.31	419722.1	34.24	0	0	23
29/01/2024 11:00	14.19	0.42	422019.3	34.43	0	0	22.5
29/01/2024 12:00	14.19	0.48	416609.9	33.78	0	0	23.3
29/01/2024 13:00	14.21	0.38	414672.4	33.39	0	0	23.8
29/01/2024 14:00	14.35	0.35	438686.9	35.25	0	0	24.3
29/01/2024 15:00	14.31	0.39	462431.2	38.52	0	0	21.2
29/01/2024 16:00	14.25	0.12	462218.7	38.78	0	0	20.3
29/01/2024 17:00	14.22	0.21	455598.6	38.11	0	0	20.6
29/01/2024 18:00	14.18	0.17	444420.3	37.08	0	0	20.9
29/01/2024 19:00	14.16	0.18	444633.6	37.2	0	0	20.4
29/01/2024 20:00	14.15	0.23	444463.4	37.28	0	0	20.1
29/01/2024 21:00	14.15	0.27	443813.8	37.26	0	0	20.5
29/01/2024 22:00	14.16	0.15	455562.1	38.49	0	0	20
29/01/2024 23:00	14.17	0.18	442445.9	36.71	0	0	20.8
29/01/2024 24:00	14.1	0.17	404980.8	32.46	0	0	23.3
Minimum	14.1	0.06	375382.8	27.15	0	0	20
MinDate		01/29/2024 2:00:00	01/29/2024 1:00:00	01/29/2024 1:00:00	01/29/2024 1:00:00	01/29/2024 1:00:00	01/29/2024 22:00:00
Maximum	14.35	0.48	462431.2	38.78	0	0	25.5
MaxDate	01/29/2024 14:00:00	01/29/2024 12:00:00	01/29/2024 15:00:00	01/29/2024 16:00:00	01/29/2024 1:00:00	01/29/2024 1:00:00	01/29/2024 9:00:00
Avg	14.23	0.23	417148.2	33.31	0	0	22.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	31448.4	4.2	0	0	1.8
Site ABPR52 Daily: 29/01/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
29/01/2024 01:00	14.65	0.36	370586.2	27.22	0	1	25.5
29/01/2024 02:00	14.61	0.3	374197.1	27.85	0	1	23.1
29/01/2024 03:00	14.62	0.36	374888.1	27.92	0	1	23.6
29/01/2024 04:00	14.6	0.41	373355.6	27.78	0	1	24.9
29/01/2024 05:00	14.61	0.4	370766.1	27.33	0	1	27.4
29/01/2024 06:00	14.58	0.39	378303.6	28.63	0	1	26.5
29/01/2024 07:00	14.5	0.44	388868.4	30.53	0	1	28.6
29/01/2024 08:00	14.56	0.48	378120.1	28.61	0	1	26.6
29/01/2024 09:00	14.52	0.54	393395.5	31.16	0	1	29.3
29/01/2024 10:00	14.48	0.63	415724.3	34.33	0	0.9	27.8
29/01/2024 11:00	14.51	0.61	417474.5	34.52	0	0.9	27.3
29/01/2024 12:00	14.53	0.66	412664.1	33.85	0	0.9	27.8
29/01/2024 13:00	14.61	0.7	410470.1	33.46	0	0.9	28.2
29/01/2024 14:00	14.77	0.58	433960.5	35.28	0	1	28.2
29/01/2024 15:00	14.71	0.53	457996.4	38.61	0	0.9	26.2
29/01/2024 16:00	14.64	0.14	459469.3	38.88	0	0.9	25.2
29/01/2024 17:00	14.63	0.25	452205.7	38.2	0	0.9	25.4
29/01/2024 18:00	14.57	0.21	441908.3	37.15	0	0.9	25.6
29/01/2024 19:00	14.53	0.28	442661.3	37.28	0	0.9	25.2
29/01/2024 20:00	14.5	0.39	442858.8	37.38	0	0.9	24.8
29/01/2024 21:00	14.48	0.54	441870.4	37.35	0	0.9	25.1
29/01/2024 22:00	14.52	0.44	454235.1	38.57	0	0.9	24.6
29/01/2024 23:00	14.54	0.44	441073	36.82	0	1	25.1
29/01/2024 24:00	14.48	0.58	402714.6	32.54	0	1	27.5
Minimum	14.48	0.14	370586.2	27.22	0	0.9	23.1
MinDate	01/29/2024 10:00:00	01/29/2024 16:00:00	01/29/2024 1:00:00	01/29/2024 1:00:00	01/29/2024 1:00:00	01/29/2024 10:00:00	01/29/2024 2:00:00
Maximum	14.77	0.7	459469.3	38.88	0	1	29.3
MaxDate	01/29/2024 14:00:00	01/29/2024 13:00:00	01/29/2024 16:00:00	01/29/2024 16:00:00	01/29/2024 1:00:00	01/29/2024 1:00:00	01/29/2024 9:00:00
Avg	14.57	0.44	413740.3	33.39	0	0.9	26.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	32110.6	4.2	0	0.1	1.6
Site ABPR51 Daily: 30/01/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
30/01/2024 01:00	14.12	0.16	403535.4	32.3	0	0	23.3
30/01/2024 02:00	14.08	0.17	410823.8	33.44	0	0	22.1
30/01/2024 03:00	14.08	0.17	412780.3	33.71	0	0	21.9
30/01/2024 04:00	14.1	0.11	405684.3	32.63	0	0	23
30/01/2024 05:00	14.11	0.28	400557.2	31.92	0	0	23.2
30/01/2024 06:00	14.07	0.66	406020.9	32.86	0	0	22.8
30/01/2024 07:00	14.07	0.28	404940.4	32.57	0	0	22.8
30/01/2024 08:00	14.08	0.38	405753.8	32.73	0	0	23
30/01/2024 09:00	14.08	0.52	409662.2	33.28	0	0	21.7
30/01/2024 10:00	14.09	0.47	414873	33.93	0	0	20.7
30/01/2024 11:00	14.16	0.51	419845.2	34.25	0	0	21.7
30/01/2024 12:00	14.18	0.51	413690.8	33.43	0	0	22.3
30/01/2024 13:00	14.18	0.39	407817.8	32.63	0	0	23.5
30/01/2024 14:00	14.28	0.25	441210	35.85	0	0	22.2
30/01/2024 15:00	14.14	0.21	461747.2	39.27	0	0	18.3
30/01/2024 16:00	14.1	0.27	457011.5	38.86	0	0	18
30/01/2024 17:00	14.14	0.26	460978.5	39.2	0	0	18.3
30/01/2024 18:00	14.15	0.24	459993.6	38.96	0	0	18.9
30/01/2024 19:00	14.17	0.03	461053.2	39.16	0	0	19
30/01/2024 20:00	14.14	0.13	456145.6	38.69	0	0	19.3



30/01/2024 21:00	14.11	0.24	452899.3	38.38	0	0	19.2
30/01/2024 22:00	14.1	0.27	451305.5	38.26	0	0	19
30/01/2024 23:00	14.13	0.1	431503.3	35.59	0	0	21.2
30/01/2024 24:00	14.11	0.15	401599.2	32	0	0	22.8
Minimum	14.07	0.03	400557.2	31.92	0	0	18
MinDate	01/30/2024 6:00:00	01/30/2024 19:00:00	01/30/2024 5:00:00	01/30/2024 5:00:00	01/30/2024 1:00:00	01/30/2024 1:00:00	01/30/2024 16:00:00
Maximum	14.28	0.66	461747.2	39.27	0	0	23.5
MaxDate	01/30/2024 14:00:00	01/30/2024 6:00:00	01/30/2024 15:00:00	01/30/2024 15:00:00	01/30/2024 1:00:00	01/30/2024 1:00:00	01/30/2024 13:00:00
Avg	14.12	0.28	427143	35.16	0	0	21.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.2	23846.1	2.8	0	0	1.9

Site ABPR52 Daily: 30/01/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
30/01/2024 01:00	14.48	0.51	401523.6	32.38	0	1	27.6
30/01/2024 02:00	14.42	0.43	408238.1	33.53	0	1	26.6
30/01/2024 03:00	14.42	0.43	410703.5	33.78	0	1	26.4
30/01/2024 04:00	14.45	0.23	402746	32.7	0	1.1	27.2
30/01/2024 05:00	14.48	0.4	398426.8	31.99	0	1.1	27.2
30/01/2024 06:00	14.41	0.28	403594.7	32.93	0	1.1	27.3
30/01/2024 07:00	14.41	0.37	401606.6	32.63	0	1.1	27.3
30/01/2024 08:00	14.42	0.3	402969	32.82	0	1.1	27.2
30/01/2024 09:00	14.42	0.5	407468.9	33.36	0	1.1	26.2
30/01/2024 10:00	14.46	0.52	412556	34	0	1.1	25.4
30/01/2024 11:00	14.57	0.67	416294.8	34.32	0	1.1	26.4
30/01/2024 12:00	14.61	0.63	410333.2	33.51	0	1.1	26.9
30/01/2024 13:00	14.62	0.63	405293.9	32.71	0	1.1	27.7
30/01/2024 14:00	14.68	0.42	438215.8	35.94	0	1.1	26.4
30/01/2024 15:00	14.51	0.24	460477.4	39.34	0	1	23.2
30/01/2024 16:00	14.49	0.56	456139.5	38.95	0	1	22.9
30/01/2024 17:00	14.53	0.49	460406.6	39.29	0	1.1	23.3
30/01/2024 18:00	14.54	0.4	458899	39.03	0	1.1	23.7
30/01/2024 19:00	14.54	0.15	460928.8	39.25	0	1.1	23.8
30/01/2024 20:00	14.51	0.19	455453.2	38.78	0	1.1	24
30/01/2024 21:00	14.48	0.3	451942.2	38.47	0	1.1	23.9
30/01/2024 22:00	14.47	0.25	450359.3	38.35	0	1.1	23.9
30/01/2024 23:00	14.5	0.24	430225.2	35.68	0	1.1	25.9
30/01/2024 24:00	14.48	0.52	399673.2	32.08	0	1.1	27.2
Minimum	14.41	0.15	398426.8	31.99	0	1	22.9
MinDate	01/30/2024 6:00:00	01/30/2024 19:00:00	01/30/2024 5:00:00	01/30/2024 5:00:00	01/30/2024 1:00:00	01/30/2024 1:00:00	01/30/2024 16:00:00
Maximum	14.68	0.67	460928.8	39.34	0	1.1	27.7
MaxDate	01/30/2024 14:00:00	01/30/2024 11:00:00	01/30/2024 19:00:00	01/30/2024 15:00:00	01/30/2024 1:00:00	01/30/2024 4:00:00	01/30/2024 13:00:00
Avg	14.5	0.4	425186.5	35.24	0	1.1	25.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24611.5	2.8	0	0	1.7

Site ABPR51 Daily: 31/01/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW
31/01/2024 01:00	14.1	0.17	400311.3	31.88
31/01/2024 02:00	14.07	0.18	403048.2	32.37
31/01/2024 03:00	14.06	0.25	403650.6	32.45
31/01/2024 04:00	14.07	0.2	400430.9	31.99
31/01/2024 05:00	14.1	0.2	395322.1	31.12
31/01/2024 06:00	14.06	0.26	403331.8	32.4
31/01/2024 07:00	14.06	0.36	402061.2	32.21
31/01/2024 08:00	14.07	0.36	401503.4	32.11
31/01/2024 09:00	14.05	0.25	406623.5	32.88
31/01/2024 10:00	14.07	0.31	407657.2	33.05
31/01/2024 11:00	14.11	0.04	410963.9	33.41
31/01/2024 12:00	14.15	0.21	405314.8	32.33
31/01/2024 13:00	14.18	0.31	404140.9	32.09
31/01/2024 14:00	14.26	0.06	431127	34.91
31/01/2024 15:00	14.19	0.05	449904.2	37.59
31/01/2024 16:00	14.19	0.13	451886.7	37.79
31/01/2024 17:00	14.18	0.19	450562.8	37.68
31/01/2024 18:00	14.16	0.2	440255.7	36.71
31/01/2024 19:00	14.15	0.25	447722	37.56
31/01/2024 20:00	14.12	0.29	445265.8	37.41
31/01/2024 21:00	14.11	0.31	445829	37.56
31/01/2024 22:00	14.09	0.35	444082.8	37.42
31/01/2024 23:00	14.14	0.31	437304	36.18
31/01/2024 24:00	14.1	0.16	400408	31.8
Minimum	14.05	0.04	395322.1	31.12
MinDate	01/31/2024 9:00:00	01/31/2024 11:00:00	01/31/2024 5:00:00	01/31/2024 5:00:00
Maximum	14.26	0.36	451886.7	37.79
MaxDate	01/31/2024 14:00:00	01/31/2024 7:00:00	01/31/2024 16:00:00	01/31/2024 16:00:00
Avg	14.12	0.23	420362.9	34.29
Num	24	24	24	24
Data[%]	100	100	100	100
STD	0.1	0.1	21334.2	2.5

Site ABPR52 Daily: 31/01/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
31/01/2024 01:00	14.45	0.47	397840.2	31.95	0	1.2	26.3
31/01/2024 02:00	14.44	0.55	401205.3	32.45	0	1.2	26.3
31/01/2024 03:00	14.43	0.65	401622.9	32.52	0	1.2	26.8
31/01/2024 04:00	14.44	0.53	398630.4	32.06	0	1.2	26.3
31/01/2024 05:00	14.46	0.55	392962.9	31.19	0	1.2	25.2
31/01/2024 06:00	14.42	0.53	401448	32.48	0	1.3	26.3
31/01/2024 07:00	14.43	0.56	399629.4	32.29	0	1.3	26.2
31/01/2024 08:00	14.43	0.53	399392.7	32.18	0	1.3	26.1
31/01/2024 09:00	14.44	0.53	404015.7	32.96	0	1.3	24.9
31/01/2024 10:00	14.52	0.65	405814.8	33.12	0	1.2	24.9
31/01/2024 11:00	14.63	0.34	409290.8	33.48	0	1.3	25.1
31/01/2024 12:00	14.72	0.53	402711.4	32.38	0	1.2	26.5
31/01/2024 13:00	14.66	0.45	401769.4	32.17	0	1.2	27.4
31/01/2024 14:00	14.66	0.18	429647.2	35.04	0	1.2	26.7
31/01/2024 15:00	14.64	0.33	447915.8	37.68	0	1.2	24.2
31/01/2024 16:00	14.66	0.41	449294.4	37.87	0	1.2	24.2
31/01/2024 17:00	14.59	0.5	448023.1	37.76	0	1.1	24.4
31/01/2024 18:00	14.55	0.47	438052.8	36.79	0	1.1	24.9
31/01/2024 19:00	14.52	0.51	445302.5	37.65	0	1.1	24.5



31/01/2024 20:00	14.48	0.45	443419.7	37.5	0	1.1	24.5
31/01/2024 21:00	14.45	0.38	443957.5	37.64	0	1.1	24.5
31/01/2024 22:00	14.42	0.38	441837.1	37.52	0	1.1	24.4
31/01/2024 23:00	14.44	0.36	435103.7	36.28	0	1.1	25.3
31/01/2024 24:00	14.42	0.32	397893.6	31.86	0	1.1	26.8
Minimum	14.42	0.18	392962.9	31.19	0	1.1	24.2
MinDate	01/31/2024 6:00:00	01/31/2024 14:00:00	01/31/2024 5:00:00	01/31/2024 5:00:00	01/31/2024 1:00:00	01/31/2024 17:00:00	01/31/2024 15:00:00
Maximum	14.72	0.65	449294.4	37.87	0	1.3	27.4
MaxDate	01/31/2024 12:00:00	01/31/2024 3:00:00	01/31/2024 16:00:00	01/31/2024 16:00:00	01/31/2024 1:00:00	01/31/2024 6:00:00	01/31/2024 13:00:00
Avg	14.51	0.46	418199.3	34.37	0	1.2	25.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	21341.5	2.5	0	0.1	1



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 01/02/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
01/02/2024 01:00	14.1	0.17	399724.3	31.79	0	0	22.4
01/02/2024 02:00	14.04	0.19	408407.5	33.21	0	0	21.6
01/02/2024 03:00	14.05	0.19	407160.6	33	0	0	21.3
01/02/2024 04:00	14.07	0.18	402912.3	32.25	0	0	21.5
01/02/2024 05:00	14.1	0.19	397212	31.36	0	0	21.4
01/02/2024 06:00	14.1	0.21	398542.7	31.55	0	0	21.8
01/02/2024 07:00	14.09	0.33	399049.3	31.69	0	0	22
01/02/2024 08:00	14.12	0.18	393246.8	30.73	0	0	21.3
01/02/2024 09:00	14.1	0.13	400436.1	31.85	0	0	21.7
01/02/2024 10:00	14.1	0.14	406856.1	32.78	0	0	22.4
01/02/2024 11:00	14.11	0.13	409718.2	33.13	0	0	21.6
01/02/2024 12:00	14.16	0.11	405301.1	32.3	0	0	22.8
01/02/2024 13:00	14.16	0.07	405692.3	32.35	0	0	22.1
01/02/2024 14:00	14.22	0.13	432583.4	35.15	0	0	21.2
01/02/2024 15:00	14.15	0.24	453026.1	38.14	0	0	18.6
01/02/2024 16:00	14.15	0.21	450163.6	37.8	0	0	18.7
01/02/2024 17:00	14.16	0.24	458012.2	38.65	0	0	18.5
01/02/2024 18:00	14.15	0.26	451541.8	37.97	0	0	19.1
01/02/2024 19:00	14.12	0.3	443961.4	37.27	0	0	19.2
01/02/2024 20:00	14.1	0.27	443747.4	37.28	0	0	19.5
01/02/2024 21:00	14.1	0.23	445113.5	37.5	0	0	19.4
01/02/2024 22:00	14.11	0.19	448036.6	37.8	0	0	19.5
01/02/2024 23:00	14.16	0.17	424986	34.56	0	0	22.4
01/02/2024 24:00	14.18	0.26	490728.4	42.41	0	0	18.5
Minimum	14.04	0.07	393246.8	30.73	0	0	18.5
MinDate	02/01/2024 2:00:00	02/01/2024 13:00:00	02/01/2024 8:00:00	02/01/2024 8:00:00	02/01/2024 1:00:00	02/01/2024 1:00:00	02/01/2024 17:00:00
Maximum	14.22	0.33	490728.4	42.41	0	0	22.8
MaxDate	02/01/2024 14:00:00	02/01/2024 7:00:00			02/01/2024 1:00:00	02/01/2024 1:00:00	02/01/2024 12:00:00
Avg	14.12	0.2	424006.6	34.69	0	0	20.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	26387.6	3.2	0	0	1.5
Site ABPR52 Daily: 01/02/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
01/02/2024 01:00	14.42	0.32	397795.1	31.86	0	1.1	26.7
01/02/2024 02:00	14.37	0.33	406205.2	33.27	0	1.1	26.3
01/02/2024 03:00	14.38	0.41	405076.6	33.08	0	1.2	26
01/02/2024 04:00	14.41	0.46	400132.6	32.32	0	1.2	25.8
01/02/2024 05:00	14.44	0.47	395091.4	31.45	0	1.2	25.6
01/02/2024 06:00	14.44	0.55	395689.5	31.61	0	1.2	25.9
01/02/2024 07:00	14.45	0.69	396742.6	31.75	0	1.2	26.1
01/02/2024 08:00	14.48	0.53	390964.2	30.8	0.1	1.3	25.1
01/02/2024 09:00	14.49	0.61	398334	31.92	0	1.3	26
01/02/2024 10:00	14.54	0.67	404586.8	32.86	0	1.2	26.7
01/02/2024 11:00	14.57	0.64	407877.7	33.21	0	1.2	25.9
01/02/2024 12:00	14.62	0.65	402988.2	32.38	0	1.2	27
01/02/2024 13:00	14.62	0.42	402960.7	32.41	0	1.2	26.4
01/02/2024 14:00	14.61	0.19	429750.6	35.19	0	1.2	25.7
01/02/2024 15:00	14.53	0.32	451285.1	38.22	0	1.2	23.4
01/02/2024 16:00	14.54	0.4	448112.8	37.88	0	1.2	23.5
01/02/2024 17:00	14.52	0.48	456382.7	38.75	0	1.1	23.5
01/02/2024 18:00	14.52	0.44	449765.4	38.05	0	1.1	24
01/02/2024 19:00	14.45	0.37	442659.1	37.38	0	1.1	24.2
01/02/2024 20:00	14.43	0.48	442027.8	37.36	0	1.1	24.4
01/02/2024 21:00	14.42	0.52	444133.3	37.58	0	1.1	24.3
01/02/2024 22:00	14.44	0.52	446263.4	37.87	0	1.2	24.3
01/02/2024 23:00	14.42	0.8	434593.3	31.17	0	1.1	24.3
01/02/2024 24:00	Shutdown	0.34	Shutdown	0.17	Shutdown	Shutdown	Shutdown
Minimum	14.37	0.19	390964.2	0.17	0	1.1	23.4
MinDate	02/01/2024 2:00:00	02/01/2024 14:00:00	02/01/2024 8:00:00		02/01/2024 1:00:00	02/01/2024 1:00:00	02/01/2024 15:00:00
Maximum	14.62	0.8	456382.7	38.75	0.1	1.3	27
MaxDate	02/01/2024 12:00:00	02/01/2024 23:00:00	02/01/2024 17:00:00	02/01/2024 17:00:00	02/01/2024 8:00:00	02/01/2024 8:00:00	02/01/2024 12:00:00
Avg	14.48	0.48	419539.9	32.86	0	1.2	25.3
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	23241.7	7.5	0	0.1	1.1
Site ABPR51 Daily: 02/02/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
02/02/2024 01:00	14.17	0.23	489871.2	42.54	0	0	18.5
02/02/2024 02:00	14.16	0.2	490230.1	42.61	0	0	18.2
02/02/2024 03:00	14.17	0.25	490266.7	42.64	0	0	18.4
02/02/2024 04:00	14.16	0.26	490147.6	42.65	0	0	18.2
02/02/2024 05:00	14.16	0.26	489951.4	42.67	0	0	18.1
02/02/2024 06:00	14.16	0.24	491249.8	42.81	0	0	18.2
02/02/2024 07:00	14.16	0.23	490007	42.64	0	0	18.2
02/02/2024 08:00	14.16	0.25	489998.2	42.66	0	0	18.1
02/02/2024 09:00	14.17	0.22	491786.2	42.77	0	0	18
02/02/2024 10:00	14.22	0.15	493633.8	42.76	0	0	18.7
02/02/2024 11:00	14.23	0.18	495454.4	42.77	0	0	19.4
02/02/2024 12:00	14.28	0.16	497524.7	42.82	0	0	20
02/02/2024 13:00	14.31	0.19	476087	39.66	0	0	21.8
02/02/2024 14:00	14.24	0.12	447716.2	36.87	0	0	20.3
02/02/2024 15:00	14.17	0.2	463853	39.06	0	0	18.1
02/02/2024 16:00	14.16	0.3	458780.1	38.63	0	0	18.3
02/02/2024 17:00	14.13	0.39	460920.2	38.94	0	0	17.6
02/02/2024 18:00	14.14	0.23	454982	38.37	0	0	18.1
02/02/2024 19:00	14.13	0.25	455978.5	38.5	0	0	18.1
02/02/2024 20:00	14.1	0.3	447808	37.71	0	0	18.8
02/02/2024 21:00	14.1	0.23	450509.5	38.05	0	0	18.4
02/02/2024 22:00	14.09	0.27	445713.8	37.59	0	0	18.5
02/02/2024 23:00	14.1	0.24	453115.3	38.4	0	0	18
02/02/2024 24:00	14.08	0.28	447878.6	37.86	0	0	18.2
Minimum	14.08	0.12	445713.8	36.87	0	0	17.6
MinDate		02/02/2024 14:00:00	02/02/2024 22:00:00	02/02/2024 14:00:00	02/02/2024 1:00:00	02/02/2024 1:00:00	02/02/2024 17:00:00
Maximum	14.31	0.39	497524.7	42.82	0	0	21.8
MaxDate	02/02/2024 13:00:00	02/02/2024 17:00:00	02/02/2024 12:00:00	02/02/2024 12:00:00	02/02/2024 1:00:00	02/02/2024 1:00:00	02/02/2024 13:00:00
Avg	14.16	0.23	473477.7	40.5	0	0	18.6
Num	24	24	24	24	24	24	24



Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	19622.6	2.3	0	0	0.9
Site ABPR52 Daily: 02/02/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
02/02/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 02:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 03:00	Shutdown	3.34	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 04:00	Shutdown	5.08	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 05:00	Shutdown	5.35	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 06:00	Shutdown	2.47	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 07:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 08:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 09:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 10:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 11:00	Shutdown	0.48	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 12:00	Shutdown	0.94	Shutdown	0	Shutdown	Shutdown	Shutdown
02/02/2024 13:00	Shutdown	1.04	Shutdown	4.53	Shutdown	Shutdown	Shutdown
02/02/2024 14:00	14.73	0.5	452872.6	36.86	0	1.2	24.5
02/02/2024 15:00	14.64	0.38	465514	39.15	0	1.2	23
02/02/2024 16:00	14.56	0.49	459388.7	38.71	0	1.2	23.4
02/02/2024 17:00	14.52	0.41	461174.8	39.02	0	1.1	22.6
02/02/2024 18:00	14.53	0.23	454885	38.45	0	1.1	22.8
02/02/2024 19:00	14.53	0.27	455248	38.59	0	1.1	22.9
02/02/2024 20:00	14.48	0.26	446956.8	37.8	0	1.1	23.5
02/02/2024 21:00	14.44	0.31	449735.2	38.14	0	1.1	23.1
02/02/2024 22:00	14.42	0.41	444676.8	37.64	0	1.1	23.2
02/02/2024 23:00	14.43	0.45	452690.3	38.48	0	1.2	22.8
02/02/2024 24:00	14.42	0.47	447228.8	37.94	0	1.2	23
Minimum	14.42	0	444676.8	0	0	1.1	22.6
MinDate	02/02/2024 22:00:00	02/02/2024 1:00:00	02/02/2024 22:00:00	02/02/2024 1:00:00	02/02/2024 14:00:00	02/02/2024 17:00:00	02/02/2024 17:00:00
Maximum	14.73	5.35	465514	39.15	0	1.2	24.5
MaxDate	02/02/2024 14:00:00	02/02/2024 5:00:00	02/02/2024 15:00:00	02/02/2024 15:00:00	02/02/2024 14:00:00	02/02/2024 14:00:00	02/02/2024 14:00:00
Avg	14.52	0.99	453670.1	17.72	0	1.1	23.2
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	1.5	6463.8	19.3	0	0.1	0.5
Site ABPR51 Daily: 03/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
03/02/2024 01:00	14.21	0.29	461414.2	38.43	0	0	21.1
03/02/2024 02:00	14.16	0.23	491988.1	42.78	0	0	17.6
03/02/2024 03:00	14.16	0.25	492202.3	42.84	0	0	17.6
03/02/2024 04:00	14.16	0.24	492101.8	42.86	0	0	17.5
03/02/2024 05:00	14.16	0.24	492279	42.88	0	0	17.7
03/02/2024 06:00	14.16	0.26	494250.5	43.03	0	0	17.7
03/02/2024 07:00	14.16	0.23	492892.7	42.91	0	0	17.9
03/02/2024 08:00	14.16	0.22	491882.8	42.87	0	0	17.8
03/02/2024 09:00	14.16	0.18	492240.5	42.83	0	0	17.8
03/02/2024 10:00	14.21	0.18	494168.6	42.86	0	0	18.6
03/02/2024 11:00	14.25	0.17	496960.7	42.86	0	0	19.4
03/02/2024 12:00	14.3	0.15	499646.9	42.86	0	0	20.3
03/02/2024 13:00	14.33	0.13	480159.9	40.06	0	0	22.1
03/02/2024 14:00	14.24	0.09	413839.4	32.95	0	0	22.1
03/02/2024 15:00	14.11	0.09	421187.6	34.53	0	0	19.8
03/02/2024 16:00	14.12	0.15	421506.7	34.46	0	0	19.9
03/02/2024 17:00	14.07	0.15	420286.4	34.58	0	0	18.6
03/02/2024 18:00	14.1	0.21	421931.8	34.62	0	0	19.8
03/02/2024 19:00	14.09	0.25	419723.4	34.46	0	0	19.9
03/02/2024 20:00	14.06	0.21	420866.5	34.7	0	0	19.4
03/02/2024 21:00	14.05	0.21	420950.3	34.77	0	0	19.3
03/02/2024 22:00	14.03	0.19	418084.8	34.54	0	0	19.1
03/02/2024 23:00	14.04	0.35	416152.3	29.26	0	0	19
03/02/2024 24:00	Shutdown	0.09	Shutdown	0.14	Shutdown	Shutdown	Shutdown
Minimum	14.03	0.09	413839.4	0.14	0	0	17.5
MinDate	02/03/2024 22:00:00	02/03/2024 14:00:00	02/03/2024 14:00:00	02/03/2024 1:00:00	02/03/2024 1:00:00	02/03/2024 1:00:00	02/03/2024 4:00:00
Maximum	14.33	0.35	499646.9	43.03	0	0	22.1
MaxDate	02/03/2024 13:00:00	02/03/2024 23:00:00	02/03/2024 12:00:00	02/03/2024 6:00:00	02/03/2024 1:00:00	02/03/2024 1:00:00	02/03/2024 13:00:00
Avg	14.15	0.2	459422.5	37.05	0	0	19.1
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	36589.7	9	0	0	1.4
Site ABPR52 Daily: 03/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
03/02/2024 01:00	Shutdown	0.76	Shutdown	3.5	Shutdown	Shutdown	Shutdown
03/02/2024 02:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 03:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 04:00	Shutdown	0.43	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 05:00	Shutdown	1.45	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 06:00	Shutdown	0.82	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 07:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 08:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 09:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 10:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 11:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 12:00	Shutdown	0.68	Shutdown	0	Shutdown	Shutdown	Shutdown
03/02/2024 13:00	Shutdown	0.82	Shutdown	4.1	Shutdown	Shutdown	Shutdown
03/02/2024 14:00	14.74	0.51	417714.7	33.02	0	1.2	25.8
03/02/2024 15:00	14.58	0.41	420934.1	34.6	0	1.2	25.1
03/02/2024 16:00	14.59	0.55	419294.8	34.54	0	1.1	25.1
03/02/2024 17:00	14.5	0.56	419004.4	34.67	0	1.1	24.1
03/02/2024 18:00	14.48	0.49	419769.1	34.68	0	1.1	24.9
03/02/2024 19:00	14.45	0.46	417196.4	34.55	0	1.1	24.8
03/02/2024 20:00	14.41	0.46	418410.4	34.78	0	1.1	24.4
03/02/2024 21:00	14.4	0.41	419087.4	34.86	0	1.1	24.2
03/02/2024 22:00	14.39	0.37	416553.7	34.61	0	1.1	23.9
03/02/2024 23:00	14.48	0.39	402480.2	32.2	0	1.1	27.5
03/02/2024 24:00	14.52	0.44	489533.4	42.53	0	1.1	23.2
Minimum	14.39	0.06	402480.2	0	0	1.1	23.2
MinDate	02/03/2024 22:00:00	02/03/2024 2:00:00	02/03/2024 23:00:00	02/03/2024 2:00:00	02/03/2024 14:00:00	02/03/2024 16:00:00	
Maximum	14.74	1.45	489533.4	42.53	0	1.2	27.5
MaxDate	02/03/2024 14:00:00	02/03/2024 5:00:00			02/03/2024 14:00:00	02/03/2024 14:00:00	02/03/2024 23:00:00
Avg	14.5	0.45	423634.5	16.36	0	1.1	24.8



Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.3	22421	17.6	0	0	1.1
Site ABPR51 Daily: 04/02/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
04/02/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 03:00	Shutdown	0.8	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 04:00	Shutdown	2.54	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 05:00	Shutdown	2.92	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 06:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 18:00	<Samp	0.29	<Samp	20.02	<Samp	<Samp	<Samp
04/02/2024 19:00	14.16	0.23	437399.6	36.03	0	0	18.6
04/02/2024 20:00	14.12	0.24	434903.2	36.07	0	0	18.7
04/02/2024 21:00	14.08	0.22	429865.8	35.7	0	0	18.1
04/02/2024 22:00	14.21	0.29	445834.7	36.53	0	0	21
04/02/2024 23:00	14.18	0.28	493890.1	42.83	0	0	17.5
04/02/2024 24:00	14.17	0.25	494004.6	42.91	0	0	17.5
Minimum	14.08	0.01	429865.8	0	0	0	17.5
MinDate	02/04/2024 21:00:00	02/04/2024 1:00:00	02/04/2024 21:00:00	02/04/2024 1:00:00	02/04/2024 19:00:00	02/04/2024 19:00:00	02/04/2024 23:00:00
Maximum	14.21	2.92	494004.6	42.91	0	0	21
MaxDate	02/04/2024 22:00:00	02/04/2024 5:00:00			02/04/2024 19:00:00	02/04/2024 19:00:00	02/04/2024 22:00:00
Avg	14.15	0.34	455983	10.42	0	0	18.6
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.8	29858.3	17	0	0	1.3
Site ABPR52 Daily: 04/02/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
04/02/2024 01:00	14.51	0.53	490316.3	42.75	0	1.1	22.9
04/02/2024 02:00	14.52	0.65	490512.9	42.75	0	1.2	22.9
04/02/2024 03:00	14.52	0.6	489922.2	42.81	0	1.2	22.9
04/02/2024 04:00	14.52	0.59	490010.8	42.81	0	1.2	22.8
04/02/2024 05:00	14.52	0.64	490064.7	42.77	0	1.3	22.6
04/02/2024 06:00	14.53	0.69	492842.5	43.01	0	1.3	22.8
04/02/2024 07:00	14.55	0.61	495077.1	43.16	0	1.3	22.7
04/02/2024 08:00	14.56	0.6	496495.1	43.28	0	1.3	22.9
04/02/2024 09:00	14.55	0.66	497383.6	43.27	0	1.3	23
04/02/2024 10:00	14.6	0.64	499007.9	43.23	0	1.2	24
04/02/2024 11:00	14.68	0.63	500444	43.19	0	1.2	24.9
04/02/2024 12:00	14.75	0.56	501581.4	43.21	0	1.3	24.9
04/02/2024 13:00	14.75	0.27	500736.8	43.28	0	1.2	24
04/02/2024 14:00	14.66	0.48	499534.3	43.26	0	1.2	24.1
04/02/2024 15:00	14.7	0.63	501730.8	43.2	0	1.2	25.3
04/02/2024 16:00	14.76	0.56	502578.8	43.08	0	1.2	25.2
04/02/2024 17:00	14.8	0.36	499523.5	42.87	0	1.2	25.8
04/02/2024 18:00	14.78	0.48	436896.7	35.48	0	1.2	27.6
04/02/2024 19:00	14.56	0.52	431106.6	36.12	0	1.1	24.5
04/02/2024 20:00	14.48	0.38	431010.9	36.16	0	1.1	24.2
04/02/2024 21:00	14.39	0.34	426503.2	35.78	0	1.1	23.5
04/02/2024 22:00	Shutdown	0.73	Shutdown	12.15	Shutdown	Shutdown	Shutdown
04/02/2024 23:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
04/02/2024 24:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.39	0.02	426503.2	0	0	1.1	22.6
MinDate	02/04/2024 21:00:00	02/04/2024 23:00:00	02/04/2024 21:00:00	02/04/2024 23:00:00	02/04/2024 1:00:00	02/04/2024 1:00:00	02/04/2024 5:00:00
Maximum	14.8	0.73	502578.8	43.28	0	1.3	27.6
MaxDate	02/04/2024 17:00:00	02/04/2024 22:00:00	02/04/2024 16:00:00	02/04/2024 8:00:00	02/04/2024 1:00:00	02/04/2024 5:00:00	02/04/2024 18:00:00
Avg	14.6	0.51	483965.8	36.98	0	1.2	24
Num	21	24	21	24	21	21	21
Data[%]	88	100	88	100	88	88	88
STD	0.1	0.2	26534.5	13.2	0	0.1	1.3
Site ABPR51 Daily: 05/02/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
05/02/2024 01:00	14.17	0.29	494116.8	42.96	0	0	17.5
05/02/2024 02:00	14.16	0.24	493878.2	42.95	0	0	17.5
05/02/2024 03:00	14.16	0.22	494280.9	42.96	0	0	17.3
05/02/2024 04:00	14.16	0.22	494551.9	43.01	0	0	17.2
05/02/2024 05:00	14.16	0.2	494044.9	43.02	0	0	17.3
05/02/2024 06:00	14.16	0.33	493954.8	43.03	0	0	17.4
05/02/2024 07:00	14.16	0.35	493704.6	42.98	0	0	17.5
05/02/2024 08:00	14.16	0.37	493242.5	42.97	0	0	17.3
05/02/2024 09:00	14.16	0.28	493558.1	42.96	0	0	16.8
05/02/2024 10:00	14.18	0.18	494410.3	42.89	0	0	17.3
05/02/2024 11:00	14.26	0.17	497542.7	42.85	0	0	18.9
05/02/2024 12:00	14.32	0.17	501534.5	42.87	0	0	20.3
05/02/2024 13:00	14.35	0.09	482984.5	40.29	0	0	21.3
05/02/2024 14:00	14.31	0.08	449817	36.83	0	0	20.8
05/02/2024 15:00	14.23	0.16	458503.3	38.24	0	0	18.7
05/02/2024 16:00	14.21	0.15	452688.2	37.66	0	0	18.9
05/02/2024 17:00	14.23	0.18	455017.3	37.9	0	0	19.4
05/02/2024 18:00	14.25	0.2	459596.1	38.38	0	0	19.9
05/02/2024 19:00	14.21	0.26	465335.6	39.21	0	0	18.9
05/02/2024 20:00	14.16	0.29	466588.3	39.57	0	0	17.9
05/02/2024 21:00	14.15	0.28	470578.9	40.06	0	0	17.2
05/02/2024 22:00	14.12	0.41	464741.1	39.57	0	0	17.2
05/02/2024 23:00	14.18	0.16	442125.7	36.3	0	0	20.5
05/02/2024 24:00	14.16	0.22	491129.1	42.5	0	0	16.9
Minimum	14.12	0.08	442125.7	36.3	0	0	16.8
MinDate	02/05/2024 22:00:00	02/05/2024 14:00:00	02/05/2024 23:00:00	02/05/2024 23:00:00	02/05/2024 1:00:00	02/05/2024 1:00:00	02/05/2024 9:00:00
Maximum	14.35	0.41	501534.5	43.03	0	0	21.3
MaxDate	02/05/2024 13:00:00	02/05/2024 22:00:00	02/05/2024 12:00:00	02/05/2024 6:00:00	02/05/2024 1:00:00	02/05/2024 1:00:00	02/05/2024 13:00:00



Avg	14.2	0.23	479080.3	40.92	0	0	18.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	18821.2	2.4	0	0	1.4

Site ABPR52 Daily: 05/02/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
05/02/2024 01:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 02:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 03:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 04:00	Shutdown	0.34	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 05:00	Shutdown	0.55	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 06:00	Shutdown	0.59	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 07:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 08:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 09:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 10:00	Shutdown	0.35	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 11:00	Shutdown	0.68	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 12:00	Shutdown	0.46	Shutdown	0	Shutdown	Shutdown	Shutdown
05/02/2024 13:00	Shutdown	0.67	Shutdown	3.57	Shutdown	Shutdown	Shutdown
05/02/2024 14:00	14.85	0.41	455461.9	37.1	0	1.3	24.7
05/02/2024 15:00	14.77	0.5	458396.7	38.3	0	1.3	23.6
05/02/2024 16:00	14.72	0.52	451791.1	37.73	0	1.2	23.8
05/02/2024 17:00	14.7	0.58	453370.5	37.99	0	1.2	24.2
05/02/2024 18:00	14.68	0.64	457848.4	38.47	0	1.2	24.4
05/02/2024 19:00	14.62	0.6	463738.6	39.28	0	1.1	23.6
05/02/2024 20:00	14.5	0.54	465678.2	39.66	0	1.1	22.6
05/02/2024 21:00	14.46	0.6	469528.5	40.15	0	1.1	22.2
05/02/2024 22:00	14.45	0.54	464587.6	39.65	0	1.1	22.1
05/02/2024 23:00	14.44	0.65	457519.4	33.85	0	1.1	22
05/02/2024 24:00	Shutdown	0.41	Shutdown	0.23	Shutdown	Shutdown	Shutdown
Minimum	14.44	0.04	451791.1	0	0	1.1	22
MinDate	02/05/2024 23:00:00	02/05/2024 2:00:00	02/05/2024 16:00:00	02/05/2024 1:00:00	02/05/2024 14:00:00	02/05/2024 19:00:00	02/05/2024 23:00:00
Maximum	14.85	0.68	469528.5	40.15	0	1.3	24.7
MaxDate	02/05/2024 14:00:00	02/05/2024 11:00:00	02/05/2024 21:00:00	02/05/2024 21:00:00	02/05/2024 14:00:00	02/05/2024 14:00:00	02/05/2024 14:00:00
Avg	14.62	0.44	459792.1	16.08	0	1.2	23.3
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.2	5799.5	19.2	0	0.1	1

Site ABPR51 Daily: 06/02/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
06/02/2024 01:00	14.16	0.21	493172.7	42.86	0	0	17.3
06/02/2024 02:00	14.16	0.24	493407.8	42.89	0	0	17.2
06/02/2024 03:00	14.16	0.22	494396.6	43.01	0	0	17
06/02/2024 04:00	14.16	0.23	494267	42.97	0	0	16.9
06/02/2024 05:00	14.16	0.23	494373.6	42.99	0	0	16.7
06/02/2024 06:00	14.16	0.2	494121.8	43	0	0	17
06/02/2024 07:00	14.16	0.28	493375.4	42.93	0	0	17.1
06/02/2024 08:00	14.16	0.38	492165.1	42.8	0	0	16.7
06/02/2024 09:00	14.15	0.16	491901.7	42.73	0	0	16.3
06/02/2024 10:00	14.2	0.18	493200.6	42.73	0	0	17.5
06/02/2024 11:00	14.28	0.17	497003.8	42.68	0	0	19.7
06/02/2024 12:00	14.29	0.17	498644.1	42.79	0	0	20.1
06/02/2024 13:00	14.33	0.26	493171	41.87	0	0	20.4
06/02/2024 14:00	14.3	0.21	477252.4	39.78	0	0	21.1
06/02/2024 15:00	14.3	0.27	496998.3	41.99	0	0	19.3
06/02/2024 16:00	14.32	0.34	494649.4	41.55	0	0	19.9
06/02/2024 17:00	14.33	0.24	503299.3	42.45	0	0	20.1
06/02/2024 18:00	14.27	0.28	493017.4	41.76	0	0	18.8
06/02/2024 19:00	14.25	0.23	496445.9	42.3	0	0	18.6
06/02/2024 20:00	14.19	0.24	484692.5	41.43	0	0	17.9
06/02/2024 21:00	14.16	0.22	480876.5	41.16	0	0	17
06/02/2024 22:00	14.16	0.23	483718.7	41.52	0	0	16.8
06/02/2024 23:00	14.19	0.25	463749.8	38.49	0	0	19.9
06/02/2024 24:00	14.17	0.24	493633.7	42.76	0	0	17.1
Minimum	14.15	0.16	463749.8	38.49	0	0	16.3
MinDate	02/06/2024 9:00:00	02/06/2024 9:00:00	02/06/2024 23:00:00	02/06/2024 23:00:00	02/06/2024 1:00:00	02/06/2024 1:00:00	02/06/2024 9:00:00
Maximum	14.33	0.38	503299.3	43.01	0	0	21.1
MaxDate	02/06/2024 13:00:00	02/06/2024 8:00:00	02/06/2024 17:00:00	02/06/2024 3:00:00	02/06/2024 1:00:00	02/06/2024 1:00:00	02/06/2024 14:00:00
Avg	14.22	0.24	491314	42.14	0	0	18.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	8162.6	1.1	0	0	1.5

Site ABPR52 Daily: 06/02/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
06/02/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 02:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 03:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 04:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 05:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 06:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 07:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 08:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 09:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 10:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 11:00	Shutdown	0.37	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 12:00	Shutdown	0.31	Shutdown	0	Shutdown	Shutdown	Shutdown
06/02/2024 13:00	Shutdown	0.99	Shutdown	1.08	Shutdown	Shutdown	Shutdown
06/02/2024 14:00	14.79	0.68	484377.2	38.89	0.3	1.3	27.8
06/02/2024 15:00	14.75	0.37	497348	42.1	0	1.3	24.6
06/02/2024 16:00	14.71	0.55	493106.6	41.63	0	1.2	24.9
06/02/2024 17:00	14.74	0.49	501464.8	42.54	0	1.2	25.1
06/02/2024 18:00	14.71	0.53	491773.9	41.89	0	1.2	23.8
06/02/2024 19:00	14.64	0.62	494853.8	42.39	0	1.2	23.8
06/02/2024 20:00	14.53	0.69	484995.4	41.56	0	1.1	23
06/02/2024 21:00	14.48	0.71	480283.9	41.24	0	1.1	22.2
06/02/2024 22:00	14.48	0.7	483634.6	41.62	0	1.1	22
06/02/2024 23:00	14.48	0.91	477248.3	35.28	0	1.2	22.3
06/02/2024 24:00	Shutdown	0.48	Shutdown	0.18	Shutdown	Shutdown	Shutdown
Minimum	14.48	0.01	477248.3	0	0	1.1	22
MinDate	02/06/2024 21:00:00	02/06/2024 1:00:00	02/06/2024 23:00:00	02/06/2024 1:00:00	02/06/2024 15:00:00	02/06/2024 20:00:00	02/06/2024 22:00:00
Maximum	14.79	0.99	501464.8	42.54	0.3	1.3	27.8



MaxDate	02/06/2024 14:00:00	02/06/2024 13:00:00	02/06/2024 17:00:00	02/06/2024 17:00:00	02/06/2024 14:00:00	02/06/2024 14:00:00	02/06/2024 14:00:00
Avg	14.63	0.4	488908.7	17.1	0	1.2	24
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	7912.8	20.6	0.1	0.1	1.8
Site ABPR51 Daily: 07/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
07/02/2024 01:00	14.17	0.22	493278.2	42.88	0	0	17.3
07/02/2024 02:00	14.16	0.21	492874.3	42.88	0	0	17
07/02/2024 03:00	14.16	0.23	493100.5	42.92	0	0	16.9
07/02/2024 04:00	14.16	0.25	494120.3	43	0	0	16.9
07/02/2024 05:00	14.16	0.24	494565.1	43.08	0	0	16.9
07/02/2024 06:00	14.16	0.27	493432.8	42.96	0	0	16.8
07/02/2024 07:00	14.16	0.31	492537.5	42.94	0	0	16.8
07/02/2024 08:00	14.16	0.34	492182.3	42.88	0	0	16.7
07/02/2024 09:00	14.17	0.17	493144.1	42.87	0	0	16.8
07/02/2024 10:00	14.22	0.16	494630.3	42.84	0	0	17.9
07/02/2024 11:00	14.27	0.17	497003	42.82	0	0	18.9
07/02/2024 12:00	14.33	0.16	501798.4	42.9	0	0	20.2
07/02/2024 13:00	14.33	0.14	493751	41.91	0	0	20.2
07/02/2024 14:00	14.19	0.1	472453.1	40.08	0	0	19
07/02/2024 15:00	14.2	0.46	487694.9	41.62	0	0	17.2
07/02/2024 16:00	14.26	0.37	490637.2	41.49	0	0	18.2
07/02/2024 17:00	14.28	0.28	492158.4	41.57	0	0	18.4
07/02/2024 18:00	14.28	0.32	487325.7	41.19	0	0	18.5
07/02/2024 19:00	14.22	0.33	485131.2	41.3	0	0	17.9
07/02/2024 20:00	14.21	0.32	489158.1	41.82	0	0	17.9
07/02/2024 21:00	14.16	0.32	480921	41.17	0	0	17
07/02/2024 22:00	14.16	0.28	485068.2	41.65	0	0	16.6
07/02/2024 23:00	14.18	0.26	452528.8	37.04	0	0	19.6
07/02/2024 24:00	14.16	0.24	492202.2	42.6	0	0	16.7
Minimum	14.16	0.1	452528.8	37.04	0	0	16.6
MinDate	02/07/2024 2:00:00	02/07/2024 14:00:00	02/07/2024 23:00:00	02/07/2024 23:00:00	02/07/2024 1:00:00	02/07/2024 1:00:00	02/07/2024 22:00:00
Maximum	14.33	0.46	501798.4	43.08	0	0	20.2
MaxDate	02/07/2024 12:00:00	02/07/2024 15:00:00	02/07/2024 12:00:00	02/07/2024 5:00:00	02/07/2024 1:00:00	02/07/2024 1:00:00	02/07/2024 12:00:00
Avg	14.2	0.26	489237.3	42.02	0	0	17.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	9724.5	1.3	0	0	1.1
Site ABPR52 Daily: 07/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
07/02/2024 01:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 02:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 03:00	Shutdown	0.44	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 04:00	Shutdown	0.93	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 05:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 06:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 10:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 11:00	Shutdown	0.26	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 12:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
07/02/2024 13:00	Shutdown	0.89	Shutdown	1.11	Shutdown	Shutdown	Shutdown
07/02/2024 14:00	14.7	0.46	481051.2	39.1	0.3	1.3	25.4
07/02/2024 15:00	14.55	0.74	490432.4	41.74	0	1.2	22.6
07/02/2024 16:00	14.66	0.77	490237.4	41.54	0	1.2	23.6
07/02/2024 17:00	14.71	0.6	490628.9	41.64	0	1.3	23.6
07/02/2024 18:00	14.68	0.47	485687.4	41.27	0	1.3	23.5
07/02/2024 19:00	14.59	0.46	484998.8	41.44	0	1.2	22.9
07/02/2024 20:00	14.54	0.49	488699.5	41.92	0	1.3	23
07/02/2024 21:00	14.51	0.54	481085.7	41.26	0	1.2	22.1
07/02/2024 22:00	14.49	0.62	485452.2	41.73	0	1.2	21.8
07/02/2024 23:00	14.46	0.82	465009.7	34.4	0	1.2	21.6
07/02/2024 24:00	Shutdown	0.52	Shutdown	0.29	Shutdown	Shutdown	Shutdown
Minimum	14.46	0	465009.7	0	0	1.2	21.6
MinDate	02/07/2024 23:00:00	02/07/2024 9:00:00	02/07/2024 23:00:00	02/07/2024 1:00:00	02/07/2024 15:00:00	02/07/2024 15:00:00	02/07/2024 23:00:00
Maximum	14.71	0.93	490628.9	41.92	0.3	1.3	25.4
MaxDate	02/07/2024 17:00:00	02/07/2024 4:00:00	02/07/2024 17:00:00	02/07/2024 20:00:00	02/07/2024 14:00:00	02/07/2024 14:00:00	02/07/2024 14:00:00
Avg	14.59	0.4	484328.3	16.98	0	1.2	23
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	7668.2	20.5	0.1	0.1	1.1
Site ABPR51 Daily: 08/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
08/02/2024 01:00	14.16	0.23	493406.2	42.88	0	0	16.7
08/02/2024 02:00	14.16	0.27	493013.6	42.89	0	0	16.7
08/02/2024 03:00	14.16	0.27	494570.8	43.04	0	0	16.6
08/02/2024 04:00	14.16	0.26	493872.7	42.93	0	0	16.5
08/02/2024 05:00	14.16	0.25	493285.3	42.97	0	0	16.5
08/02/2024 06:00	14.16	0.25	494156.9	43.05	0	0	16.6
08/02/2024 07:00	14.16	0.34	492567.3	42.91	0	0	16.7
08/02/2024 08:00	14.16	0.31	492205.9	42.9	0	0	16.6
08/02/2024 09:00	14.17	0.2	493266.5	42.89	0	0	16.6
08/02/2024 10:00	14.22	0.1	496109.8	42.9	0	0	17.8
08/02/2024 11:00	14.28	0.17	499483.7	42.9	0	0	19
08/02/2024 12:00	14.32	0.18	502474.8	43.01	0	0	19.7
08/02/2024 13:00	14.34	0.2	492810.5	41.54	0	0	20.9
08/02/2024 14:00	14.31	0.16	460777.8	37.96	0	0	19.4
08/02/2024 15:00	14.32	0.11	486272.7	40.76	0	0	19
08/02/2024 16:00	14.31	0.12	485161.5	40.69	0	0	19.3
08/02/2024 17:00	14.29	0.13	482549.1	40.63	0	0	19.2
08/02/2024 18:00	14.28	0.21	484692.8	40.97	0	0	19.2
08/02/2024 19:00	14.22	0.2	481468.6	40.97	0	0	18.2
08/02/2024 20:00	14.18	0.32	478034.4	40.79	0	0	17.6
08/02/2024 21:00	14.16	0.26	481918.9	41.24	0	0	17.1
08/02/2024 22:00	14.15	0.27	478623.9	41.02	0	0	16.5
08/02/2024 23:00	14.18	0.2	448477	36.89	0	0	20.4
08/02/2024 24:00	14.17	0.24	494022	42.79	0	0	17
Minimum	14.15	0.1	448477	36.89	0	0	16.5
MinDate	02/08/2024 22:00:00	02/08/2024 10:00:00	02/08/2024 23:00:00	02/08/2024 23:00:00	02/08/2024 1:00:00	02/08/2024 1:00:00	02/08/2024 4:00:00



Maximum	14.34	0.34	502474.8	43.05	0	0	20.9
MaxDate	02/08/2024 13:00:00	02/08/2024 7:00:00	02/08/2024 12:00:00	02/08/2024 6:00:00	02/08/2024 1:00:00	02/08/2024 1:00:00	02/08/2024 13:00:00
Avg	14.22	0.22	487217.6	41.73	0	0	17.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	12045.9	1.6	0	0	1.4

Site ABPR52 Daily: 08/02/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
08/02/2024 01:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 02:00	Shutdown	0.41	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 03:00	Shutdown	0.46	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 04:00	Shutdown	0.32	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 05:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 06:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 07:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 08:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 09:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 11:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 12:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
08/02/2024 13:00	Shutdown	0.62	Shutdown	1.92	Shutdown	Shutdown	Shutdown
08/02/2024 14:00	14.8	0.65	466719	37.77	0.1	1.3	26.2
08/02/2024 15:00	14.73	0.55	487215.8	40.83	0	1.2	24.6
08/02/2024 16:00	14.69	0.65	484697.2	40.79	0	1.2	24.9
08/02/2024 17:00	14.65	0.61	482118	40.73	0	1.2	24.5
08/02/2024 18:00	14.61	0.59	483655.5	41.07	0	1.2	24.6
08/02/2024 19:00	14.54	0.58	480868.4	41.06	0	1.2	23.5
08/02/2024 20:00	14.51	0.58	478246.3	40.89	0	1.1	22.9
08/02/2024 21:00	14.5	0.61	482065.1	41.34	0	1.1	22.6
08/02/2024 22:00	14.49	0.53	478956.5	41.12	0	1.1	22.1
08/02/2024 23:00	14.47	0.73	461728.3	34.25	0	1.1	22.4
08/02/2024 24:00	Shutdown	0.35	Shutdown	0.19	Shutdown	Shutdown	Shutdown
Minimum	14.47	0.01	461728.3	0	0	1.1	22.1
MinDate	02/08/2024 23:00:00	02/08/2024 10:00:00	02/08/2024 23:00:00	02/08/2024 1:00:00	02/08/2024 15:00:00	02/08/2024 20:00:00	02/08/2024 22:00:00
Maximum	14.8	0.73	487215.8	41.34	0.1	1.3	26.2
MaxDate	02/08/2024 14:00:00	02/08/2024 23:00:00	02/08/2024 15:00:00	02/08/2024 21:00:00	02/08/2024 14:00:00	02/08/2024 14:00:00	02/08/2024 14:00:00
Avg	14.6	0.39	478627.1	16.75	0	1.2	23.8
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.2	8112.5	20.1	0	0.1	1.3

Site ABPR51 Daily: 09/02/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
09/02/2024 01:00	14.18	0.25	493530	42.93	0	0	17.3
09/02/2024 02:00	14.17	0.26	493222.6	42.91	0	0	17.4
09/02/2024 03:00	14.16	0.23	492632.7	42.92	0	0	17.2
09/02/2024 04:00	14.17	0.3	494042.7	43.05	0	0	17.1
09/02/2024 05:00	14.16	0.3	493258.3	42.92	0	0	17.2
09/02/2024 06:00	14.16	0.34	493550.1	42.95	0	0	17.1
09/02/2024 07:00	14.16	0.29	493004	42.94	0	0	17.1
09/02/2024 08:00	14.16	0.41	492932.9	42.91	0	0	16.9
09/02/2024 09:00	14.2	0.21	493634.2	42.89	0	0	17
09/02/2024 10:00	14.22	0.21	495374.7	42.85	0	0	17.7
09/02/2024 11:00	14.27	0.22	497878.6	42.83	0	0	18.6
09/02/2024 12:00	14.29	0.14	501142.6	42.99	0	0	19.2
09/02/2024 13:00	14.32	0.21	488742.2	41.23	0	0	20.2
09/02/2024 14:00	14.33	0.19	474719	39.37	0	0	20.6
09/02/2024 15:00	14.32	0.16	491901.2	41.37	0	0	19.2
09/02/2024 16:00	14.31	0.15	497761	42	0	0	19.2
09/02/2024 17:00	14.27	0.3	491681	41.67	0	0	18.5
09/02/2024 18:00	14.22	0.34	486395.2	41.33	0	0	17.8
09/02/2024 19:00	14.22	0.35	488705.3	41.82	0	0	17.7
09/02/2024 20:00	14.18	0.39	482950.3	41.31	0	0	17.3
09/02/2024 21:00	14.16	0.31	480108.7	41.08	0	0	16.8
09/02/2024 22:00	14.17	0.35	486461.4	41.77	0	0	16.9
09/02/2024 23:00	14.2	0.29	467207.1	38.27	0	0	20
09/02/2024 24:00	14.21	0.27	493179.6	42.66	0	0	17.3
Minimum	14.16	0.14	467207.1	38.27	0	0	16.8
MinDate	02/09/2024 3:00:00	02/09/2024 12:00:00	02/09/2024 23:00:00	02/09/2024 23:00:00	02/09/2024 1:00:00	02/09/2024 1:00:00	02/09/2024 21:00:00
Maximum	14.33	0.41	501142.6	43.05	0	0	20.6
MaxDate	02/09/2024 14:00:00	02/09/2024 8:00:00	02/09/2024 12:00:00	02/09/2024 4:00:00	02/09/2024 1:00:00	02/09/2024 1:00:00	02/09/2024 14:00:00
Avg	14.22	0.27	490167.3	42.04	0	0	18
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	7582.1	1.2	0	0	1.2

Site ABPR52 Daily: 09/02/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
09/02/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 03:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 04:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 07:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 08:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 09:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 10:00	Shutdown	0.31	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 11:00	Shutdown	0.55	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 12:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
09/02/2024 13:00	Shutdown	0.77	Shutdown	2.34	Shutdown	Shutdown	Shutdown
09/02/2024 14:00	14.78	0.74	480383.2	39.33	0.1	1.3	26.7
09/02/2024 15:00	14.75	0.51	492808.3	41.46	0	1.2	24.6
09/02/2024 16:00	14.7	0.42	497178.8	42.05	0	1.2	24.3
09/02/2024 17:00	14.64	0.37	491280.7	41.73	0	1.2	23.6
09/02/2024 18:00	14.59	0.41	485634.6	41.43	0	1.1	23.1
09/02/2024 19:00	14.56	0.4	489115.8	41.92	0	1.1	23.1
09/02/2024 20:00	14.53	0.55	483381.8	41.42	0	1.1	22.6
09/02/2024 21:00	14.52	0.59	479801.1	41.18	0	1.1	22.2
09/02/2024 22:00	14.53	0.67	486904.2	41.86	0	1.2	22.3
09/02/2024 23:00	14.53	0.91	477567.1	35.94	0	1.2	22.6
09/02/2024 24:00	Shutdown	0.5	Shutdown	0.24	Shutdown	Shutdown	Shutdown
Minimum	14.52	0.01	477567.1	0	0	1.1	22.2



MinDate	02/09/2024 21:00:00	02/09/2024 1:00:00	02/09/2024 23:00:00	02/09/2024 1:00:00	02/09/2024 15:00:00	02/09/2024 18:00:00	02/09/2024 21:00:00
Maximum	14.78	0.91	497178.8	42.05	0.1	1.3	26.7
MaxDate	02/09/2024 14:00:00	02/09/2024 23:00:00	02/09/2024 16:00:00	02/09/2024 16:00:00	02/09/2024 14:00:00	02/09/2024 14:00:00	02/09/2024 14:00:00
Avg	14.61	0.35	486405.5	17.12	0	1.2	23.5
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	6296	20.5	0	0.1	1.4
Site ABPR51 Daily: 10/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
10/02/2024 01:00	14.2	0.21	493232.9	42.85	0	0	17.2
10/02/2024 02:00	14.19	0.18	492746	42.84	0	0	17
10/02/2024 03:00	14.19	0.24	493808.8	42.91	0	0	16.9
10/02/2024 04:00	14.19	0.23	492743.5	42.84	0	0	16.9
10/02/2024 05:00	14.18	0.25	492957.9	42.87	0	0	16.9
10/02/2024 06:00	14.19	0.36	493809.2	42.95	0	0	16.8
10/02/2024 07:00	14.17	0.2	492424.9	42.86	0	0	16.9
10/02/2024 08:00	14.18	0.27	492570.8	42.83	0	0	16.9
10/02/2024 09:00	14.21	0.2	493607.5	42.82	0	0	17.7
10/02/2024 10:00	14.26	0.27	498955.5	43.11	0	0	19.1
10/02/2024 11:00	14.28	0.63	500251.5	43.12	0	0	19.4
10/02/2024 12:00	14.3	0.19	498545.3	42.87	0	0	19.2
10/02/2024 13:00	14.27	0.19	485808.8	41.41	0	0	19.2
10/02/2024 14:00	14.28	0.51	461902.3	38.4	0	0	18.9
10/02/2024 15:00	14.22	0.44	480785.7	40.9	0	0	17.9
10/02/2024 16:00	14.16	0.49	476578.5	40.83	0	0	16.3
10/02/2024 17:00	14.16	0.48	478534	40.96	0	0	16
10/02/2024 18:00	14.22	0.43	478559	40.61	0	0	17.9
10/02/2024 19:00	14.2	0.43	475503.9	40.42	0	0	17.9
10/02/2024 20:00	14.18	0.44	476162.8	40.7	0	0	17.2
10/02/2024 21:00	14.14	0.44	471555.1	40.28	0	0	17
10/02/2024 22:00	14.14	0.37	470357.8	40.2	0	0	16.7
10/02/2024 23:00	14.19	0.34	442763.4	36.45	0	0	19.9
10/02/2024 24:00	14.23	0.44	493343.8	42.66	0	0	18.5
Minimum	14.14	0.18	442763.4	36.45	0	0	16
MinDate	02/10/2024 21:00:00	02/10/2024 2:00:00	02/10/2024 23:00:00	02/10/2024 23:00:00	02/10/2024 1:00:00	02/10/2024 1:00:00	02/10/2024 17:00:00
Maximum	14.3	0.63	500251.5	43.12	0	0	19.9
MaxDate	02/10/2024 12:00:00	02/10/2024 11:00:00	02/10/2024 11:00:00	02/10/2024 11:00:00	02/10/2024 1:00:00	02/10/2024 1:00:00	02/10/2024 23:00:00
Avg	14.21	0.34	484479.6	41.61	0	0	17.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	13704.1	1.7	0	0	1.1
Site ABPR52 Daily: 10/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
10/02/2024 01:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 02:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 03:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 04:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 05:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 06:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 11:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 12:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
10/02/2024 13:00	Shutdown	0.69	Shutdown	1.86	Shutdown	Shutdown	Shutdown
10/02/2024 14:00	14.65	0.53	467968.9	38.55	0.2	1.3	25.3
10/02/2024 15:00	14.63	0.55	482905	41	0	1.2	23.7
10/02/2024 16:00	14.58	0.58	477466.1	40.91	0	1.2	22.4
10/02/2024 17:00	14.59	0.67	478714.2	41.05	0	1.2	21.9
10/02/2024 18:00	14.68	0.55	477582.2	40.71	0	1.2	23.1
10/02/2024 19:00	14.67	0.64	475065.2	40.51	0	1.2	23
10/02/2024 20:00	14.6	0.55	475934.9	40.78	0	1.2	22.3
10/02/2024 21:00	14.55	0.65	470996.6	40.36	0	1.2	22.3
10/02/2024 22:00	14.55	0.52	470499.8	40.28	0	1.2	21.9
10/02/2024 23:00	14.56	0.58	458422.8	33.63	0	1.2	22.1
10/02/2024 24:00	Shutdown	0.27	Shutdown	0.19	Shutdown	Shutdown	Shutdown
Minimum	14.55	0	458422.8	0	0	1.2	21.9
MinDate	02/10/2024 21:00:00	02/10/2024 7:00:00	02/10/2024 23:00:00	02/10/2024 1:00:00	02/10/2024 15:00:00	02/10/2024 15:00:00	02/10/2024 17:00:00
Maximum	14.68	0.69	482905	41.05	0.2	1.3	25.3
MaxDate	02/10/2024 18:00:00	02/10/2024 13:00:00	02/10/2024 15:00:00	02/10/2024 17:00:00	02/10/2024 14:00:00	02/10/2024 14:00:00	02/10/2024 14:00:00
Avg	14.61	0.31	473555.6	16.66	0	1.2	22.8
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0	0.3	6907.7	20	0.1	0	1.1
Site ABPR51 Daily: 11/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
11/02/2024 01:00	14.28	0.41	493666.4	42.8	0	0	20.4
11/02/2024 02:00	14.28	0.46	492667.1	42.77	0	0	21
11/02/2024 03:00	14.28	0.45	491958.1	42.76	0	0	21.3
11/02/2024 04:00	14.28	0.41	491531.3	42.78	0	0	21.3
11/02/2024 05:00	14.28	0.37	491381.6	42.8	0	0	21.2
11/02/2024 06:00	14.27	0.22	492148.5	42.91	0	0	21.1
11/02/2024 07:00	14.28	0.16	494523.2	43.08	0	0	21
11/02/2024 08:00	14.28	0.12	496287.4	43.16	0	0	21
11/02/2024 09:00	14.29	0.05	497459.8	43.18	0	0	21.3
11/02/2024 10:00	14.32	0.07	498843.9	43.18	0	0	21.8
11/02/2024 11:00	14.34	0.26	501927.2	43.17	0	0	22.1
11/02/2024 12:00	14.39	0.37	505082.5	43.19	0	0	22.1
11/02/2024 13:00	14.41	0.47	508929.1	43.24	0	0	22.6
11/02/2024 14:00	14.44	0.42	510368.2	43.19	0	0	23.3
11/02/2024 15:00	14.46	0.47	510155.1	43.13	0	0	23.8
11/02/2024 16:00	14.45	0.34	505329	42.76	0	0	24
11/02/2024 17:00	14.42	0.18	503930.3	42.74	0	0	23.4
11/02/2024 18:00	14.38	0.23	447778.5	36.33	0	0	24.2
11/02/2024 19:00	14.2	0.4	454994.4	38.48	0	0	19.9
11/02/2024 20:00	14.17	0.49	453279.8	38.24	0	0	20.1
11/02/2024 21:00	14.16	0.44	451156.3	38.05	0	0	20.2
11/02/2024 22:00	14.24	0.32	402656.9	31.41	0	0	23.7
11/02/2024 23:00	14.27	0.29	385778.6	29.16	0	0	23.1
11/02/2024 24:00	14.31	0.29	383518.4	28.74	0	0	24



Minimum	14.16	0.05	383518.4	28.74	0	0	19.9
MinDate	02/11/2024 21:00:00	02/11/2024 9:00:00			02/11/2024 1:00:00	02/11/2024 1:00:00	02/11/2024 19:00:00
Maximum	14.46	0.49	510368.2	43.24	0	0	24.2
MaxDate	02/11/2024 15:00:00	02/11/2024 20:00:00	02/11/2024 14:00:00	02/11/2024 13:00:00	02/11/2024 1:00:00	02/11/2024 1:00:00	02/11/2024 18:00:00
Avg	14.31	0.32	477722.9	40.47	0	0	22
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	38608.2	4.6	0	0	1.4
Site ABPR52 Daily: 11/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
11/02/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 03:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 04:00	Shutdown	0.35	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 05:00	Shutdown	0.85	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 06:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 10:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 11:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 12:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 13:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 14:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 15:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 16:00	Shutdown	0.24	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 17:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
11/02/2024 18:00	<Samp	0.97	<Samp	19.59	<Samp	<Samp	<Samp
11/02/2024 19:00	14.57	0.28	459145.5	38.56	0	0.8	25.2
11/02/2024 20:00	14.53	0.55	453811	38.33	0	0.8	26
11/02/2024 21:00	14.52	0.63	450636.3	38.14	0	0.8	25.8
11/02/2024 22:00	14.6	0.5	400172.5	31.45	0	0.8	28.3
11/02/2024 23:00	14.65	0.39	383173.9	29.22	0	0.9	26.7
11/02/2024 24:00	14.65	0.3	380351.3	28.82	0	0.9	27.2
Minimum	14.52	0	380351.3	0	0	0.8	25.2
MinDate	02/11/2024 21:00:00	02/11/2024 1:00:00		02/11/2024 1:00:00	02/11/2024 19:00:00	02/11/2024 19:00:00	02/11/2024 19:00:00
Maximum	14.65	0.97	459145.5	38.56	0	0.9	28.3
MaxDate	02/11/2024 23:00:00	02/11/2024 18:00:00	02/11/2024 19:00:00	02/11/2024 19:00:00	02/11/2024 19:00:00	02/11/2024 23:00:00	02/11/2024 22:00:00
Avg	14.59	0.25	421215.1	9.34	0	0.8	26.5
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0.1	0.3	37219.9	15.3	0	0.1	1.1
Site ABPR51 Daily: 12/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
12/02/2024 01:00	14.31	0.2	382035.1	28.51	0	0	24.1
12/02/2024 02:00	14.27	0.27	386693.2	29.46	0	0	25.1
12/02/2024 03:00	14.28	0.38	385360.8	29.23	0	0	25.2
12/02/2024 04:00	14.28	0.42	384171.5	29	0	0	25.2
12/02/2024 05:00	14.32	0.39	380033.2	28.24	0	0	24.9
12/02/2024 06:00	14.26	0.26	389304.3	29.97	0	0	26.2
12/02/2024 07:00	14.21	0.16	395351	31.01	0	0	27.1
12/02/2024 08:00	14.26	0.13	387274.3	29.53	0	0	25.4
12/02/2024 09:00	14.23	0.02	395406.4	30.96	0	0	25.9
12/02/2024 10:00	14.19	0.07	404849.8	32.44	0	0	26.2
12/02/2024 11:00	14.21	0.16	402453.1	31.99	0	0	26.3
12/02/2024 12:00	14.19	0.29	406228	32.54	0	0	24.9
12/02/2024 13:00	14.24	0.58	403905.4	31.97	0	0	25.5
12/02/2024 14:00	14.35	0.46	453811.2	37.14	0	0	22.6
12/02/2024 15:00	14.36	0.5	480420.9	40.23	0	0	21.9
12/02/2024 16:00	14.39	0.32	484235.5	40.49	0	0	22.1
12/02/2024 17:00	14.39	0.31	481975.3	40.29	0	0	22.6
12/02/2024 18:00	14.36	0.22	483355.9	40.65	0	0	22
12/02/2024 19:00	14.35	0.27	487130.8	41.13	0	0	22
12/02/2024 20:00	14.33	0.39	484800.3	41.18	0	0	21.8
12/02/2024 21:00	14.31	0.36	480447.9	40.79	0	0	21.4
12/02/2024 22:00	14.31	0.49	484655.8	41.29	0	0	21.2
12/02/2024 23:00	14.33	0.5	452111.2	36.94	0	0	26.1
12/02/2024 24:00	14.32	0.36	487198	41.72	0	0	23.6
Minimum	14.19	0.02	380033.2	28.24	0	0	21.2
MinDate	02/12/2024 10:00:00	02/12/2024 9:00:00	02/12/2024 5:00:00	02/12/2024 5:00:00	02/12/2024 1:00:00	02/12/2024 1:00:00	02/12/2024 22:00:00
Maximum	14.39	0.58	487198	41.72	0	0	27.1
MaxDate	02/12/2024 16:00:00	02/12/2024 13:00:00			02/12/2024 1:00:00	02/12/2024 1:00:00	02/12/2024 7:00:00
Avg	14.29	0.31	431800.4	34.86	0	0	24.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	44897.3	5.2	0	0	1.9
Site ABPR52 Daily: 12/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
12/02/2024 01:00	14.65	0.31	378560.2	28.58	0	0.9	27
12/02/2024 02:00	14.59	0.34	383699.9	29.53	0	0.8	28.3
12/02/2024 03:00	14.59	0.31	382355.7	29.31	0	0.8	28.2
12/02/2024 04:00	14.59	0.37	381002	29.07	0	0.8	28
12/02/2024 05:00	14.62	0.4	376667.8	28.31	0	0.7	27.5
12/02/2024 06:00	14.57	0.41	386826.3	30.05	0	0.7	29.4
12/02/2024 07:00	14.51	0.44	392330.6	31.09	0	0.6	30.8
12/02/2024 08:00	14.55	0.48	383875.8	29.6	0	0.6	28.7
12/02/2024 09:00	14.53	0.48	392399.8	31.03	0	0.5	30.1
12/02/2024 10:00	14.5	0.46	402277.4	32.53	0	0.5	30.7
12/02/2024 11:00	14.55	0.5	400373.5	32.05	0	0.6	30.6
12/02/2024 12:00	14.57	0.61	404260.8	32.61	0	0.6	29.5
12/02/2024 13:00	14.66	0.76	401705.6	32.05	0	0.6	29.9
12/02/2024 14:00	14.76	0.69	451804	37.24	0	0.7	27
12/02/2024 15:00	14.79	0.73	478356.4	40.35	0	0.7	26.5
12/02/2024 16:00	14.78	0.53	481461.3	40.54	0	0.7	26.8
12/02/2024 17:00	14.75	0.53	478933.1	40.35	0	0.6	27.1
12/02/2024 18:00	14.7	0.36	481553.8	40.76	0	0.6	26.8
12/02/2024 19:00	14.67	0.31	484793.2	41.24	0	0.6	27
12/02/2024 20:00	14.64	0.27	483609.9	41.26	0	0.5	26.9
12/02/2024 21:00	14.61	0.27	478575.9	40.88	0	0.5	26.6
12/02/2024 22:00	14.6	0.4	483106.5	41.37	0	0.5	26.6
12/02/2024 23:00	14.58	0.53	469036.1	35.09	0	0.5	26.7



12/02/2024 24:00	Shutdown	0.41	Shutdown	0.5	Shutdown	Shutdown	Shutdown
Minimum	14.5	0.27	376667.8	0.5	0	0.5	26.5
MinDate	02/12/2024 10:00:00	02/12/2024 20:00:00	02/12/2024 5:00:00		02/12/2024 1:00:00	02/12/2024 9:00:00	02/12/2024 15:00:00
Maximum	14.79	0.76	484793.2	41.37	0	0.9	30.8
MaxDate	02/12/2024 15:00:00	02/12/2024 13:00:00	02/12/2024 19:00:00	02/12/2024 22:00:00	02/12/2024 1:00:00	02/12/2024 1:00:00	02/12/2024 7:00:00
Avg	14.62	0.45	427720.3	33.14	0	0.6	28.1
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	45333.6	8.6	0	0.1	1.5
Site ABPR51 Daily: 13/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
13/02/2024 01:00	14.28	0.48	492337.6	42.72	0	0	21.1
13/02/2024 02:00	14.28	0.42	491976.3	42.73	0	0	21.1
13/02/2024 03:00	14.28	0.5	492213.2	42.76	0	0	21.3
13/02/2024 04:00	14.28	0.48	493132.4	42.84	0	0	21.4
13/02/2024 05:00	14.28	0.47	492276.5	42.78	0	0	21.5
13/02/2024 06:00	14.28	0.41	492456.8	42.84	0	0	21.6
13/02/2024 07:00	14.28	0.49	491988.4	42.79	0	0	21.7
13/02/2024 08:00	14.29	0.46	492458	42.74	0	0	21.8
13/02/2024 09:00	14.34	0.22	494007.5	42.78	0	0	22
13/02/2024 10:00	14.35	0.14	497142.1	42.76	0	0	22
13/02/2024 11:00	14.39	0.26	499437.9	42.74	0	0	22.4
13/02/2024 12:00	14.43	0.35	503810.9	42.82	0	0	23.2
13/02/2024 13:00	14.45	0.5	486722.2	40.56	0	0	24.5
13/02/2024 14:00	14.45	0.43	473520.4	39.03	0	0	26
13/02/2024 15:00	14.44	0.42	487327.2	40.55	0	0	23
13/02/2024 16:00	14.45	0.56	490660.1	40.86	0	0	23.2
13/02/2024 17:00	14.38	0.27	488005.3	40.92	0	0	21.4
13/02/2024 18:00	14.34	0.35	483753.8	40.75	0	0	20.9
13/02/2024 19:00	14.34	0.39	487631.7	41.23	0	0	21.1
13/02/2024 20:00	14.3	0.44	483851.6	41.03	0	0	20.1
13/02/2024 21:00	14.23	0.42	482272.5	41.12	0	0	18
13/02/2024 22:00	14.24	0.54	491229.8	42.07	0	0	18.2
13/02/2024 23:00	14.27	0.46	457119.1	37.4	0	0	22.3
13/02/2024 24:00	14.23	0.28	491700.3	42.49	0	0	18.1
Minimum	14.23	0.14	457119.1	37.4	0	0	18
MinDate	02/13/2024 21:00:00	02/13/2024 10:00:00	02/13/2024 23:00:00	02/13/2024 23:00:00	02/13/2024 1:00:00	02/13/2024 1:00:00	02/13/2024 21:00:00
Maximum	14.45	0.56	503810.9	42.84	0	0	26
MaxDate	02/13/2024 13:00:00	02/13/2024 16:00:00	02/13/2024 12:00:00	02/13/2024 4:00:00	02/13/2024 1:00:00	02/13/2024 1:00:00	02/13/2024 14:00:00
Avg	14.33	0.41	489043	41.72	0	0	21.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	9064.2	1.4	0	0	1.8
Site ABPR52 Daily: 13/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
13/02/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 02:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 03:00	Shutdown	0.82	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 05:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 06:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 07:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 09:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 11:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 12:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
13/02/2024 13:00	Shutdown	0.89	Shutdown	3.07	Shutdown	Shutdown	Shutdown
13/02/2024 14:00	14.91	0.73	477511.2	39.06	0.1	0.7	29.1
13/02/2024 15:00	14.91	0.66	487681.5	40.65	0	0.6	27.5
13/02/2024 16:00	14.87	0.67	489310.8	40.93	0	0.6	27.7
13/02/2024 17:00	14.78	0.23	486991.2	41.02	0	0.6	26.4
13/02/2024 18:00	14.72	0.37	482169.7	40.84	0	0.6	26.1
13/02/2024 19:00	14.72	0.45	485944.3	41.33	0	0.6	26.2
13/02/2024 20:00	14.65	0.47	481873.3	41.11	0	0.5	25.5
13/02/2024 21:00	14.55	0.6	480993.3	41.24	0	0.5	23.6
13/02/2024 22:00	14.58	0.8	490073.6	42.16	0	0.6	23.6
13/02/2024 23:00	14.55	0.88	473862.9	35.5	0	0.7	23.4
13/02/2024 24:00	Shutdown	0.49	Shutdown	0.25	Shutdown	Shutdown	Shutdown
Minimum	14.55	0	473862.9	0	0	0.5	23.4
MinDate	02/13/2024 21:00:00	02/13/2024 9:00:00	02/13/2024 23:00:00	02/13/2024 1:00:00	02/13/2024 15:00:00	02/13/2024 20:00:00	02/13/2024 23:00:00
Maximum	14.91	0.89	490073.6	42.16	0.1	0.7	29.1
MaxDate	02/13/2024 14:00:00	02/13/2024 13:00:00	02/13/2024 22:00:00	02/13/2024 22:00:00	02/13/2024 14:00:00	02/13/2024 14:00:00	02/13/2024 14:00:00
Avg	14.72	0.36	483641.2	16.97	0	0.6	25.9
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	5287.9	20.3	0	0.1	1.9
Site ABPR51 Daily: 14/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
14/02/2024 01:00	14.22	0.32	491917.7	42.83	0	0	17.8
14/02/2024 02:00	14.22	0.51	491291.6	42.78	0	0	17.8
14/02/2024 03:00	14.22	0.37	491905.2	42.91	0	0	17.7
14/02/2024 04:00	14.22	0.43	491512.8	42.85	0	0	17.8
14/02/2024 05:00	14.21	0.62	490829.4	42.86	0	0	17.8
14/02/2024 06:00	14.21	0.39	490985	42.91	0	0	17.8
14/02/2024 07:00	14.22	0.37	490513.2	42.82	0	0	18.1
14/02/2024 08:00	14.22	0.41	489989.4	42.72	0	0	18.3
14/02/2024 09:00	14.27	0.68	492846.3	42.71	0	0	19.4
14/02/2024 10:00	14.3	0.54	495456.8	42.68	0	0	19.3
14/02/2024 11:00	14.39	0.46	499673.2	42.66	0	0	20.9
14/02/2024 12:00	14.4	0.37	502200.4	42.71	0	0	21.5
14/02/2024 13:00	14.41	0.43	496466	41.93	0	0	22.3
14/02/2024 14:00	14.37	0.5	480665.3	40.1	0	0	23
14/02/2024 15:00	14.36	0.35	485440.4	40.63	0	0	19.9
14/02/2024 16:00	14.3	0.22	488197.9	41.05	0	0	17.2
14/02/2024 17:00	14.28	0.31	488225.4	41.26	0	0	16.7
14/02/2024 18:00	14.27	0.33	490752.4	41.64	0	0	16.9
14/02/2024 19:00	14.22	0.35	481595.1	40.92	0	0	16.6
14/02/2024 20:00	14.21	0.41	483154.9	41.23	0	0	16.6
14/02/2024 21:00	14.19	0.41	477184.2	40.72	0	0	16.6
14/02/2024 22:00	14.18	0.44	476568.4	40.68	0	0	16.7



14/02/2024 23:00	14.22	0.34	457937.6	36.77	0	0	19.5
14/02/2024 24:00	14.23	0.29	489702.3	42.16	0	0	18.4
Minimum	14.18	0.22	457937.6	36.77	0	0	16.6
MinDate	02/14/2024 22:00:00	02/14/2024 16:00:00	02/14/2024 23:00:00	02/14/2024 23:00:00	02/14/2024 1:00:00	02/14/2024 1:00:00	02/14/2024 19:00:00
Maximum	14.41	0.68	502200.4	42.91	0	0	23
MaxDate	02/14/2024 13:00:00	02/14/2024 9:00:00	02/14/2024 12:00:00	02/14/2024 3:00:00	02/14/2024 1:00:00	02/14/2024 1:00:00	02/14/2024 14:00:00
Avg	14.26	0.41	488125.5	41.77	0	0	18.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	8982.9	1.4	0	0	1.8
Site ABPR52 Daily: 14/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
14/02/2024 01:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 02:00	Shutdown	0.33	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 03:00	Shutdown	0.31	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 04:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 05:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 06:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 07:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 08:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 09:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 10:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 11:00	Shutdown	0.22	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/02/2024 13:00	Shutdown	0.78	Shutdown	1.03	Shutdown	Shutdown	Shutdown
14/02/2024 14:00	14.82	0.64	488005.7	39.02	0.4	1.2	29.7
14/02/2024 15:00	14.8	0.62	485883.8	40.75	0	1.2	25.5
14/02/2024 16:00	14.74	0.44	486505.3	41.14	0	1.2	23.2
14/02/2024 17:00	14.68	0.6	486358.7	41.34	0	1.2	22.6
14/02/2024 18:00	14.65	0.55	489072.7	41.74	0	1.2	22.7
14/02/2024 19:00	14.6	0.54	480144.1	41.02	0	1.2	22.2
14/02/2024 20:00	14.57	0.53	482567.5	41.32	0	1.1	22.2
14/02/2024 21:00	14.51	0.39	476842	40.81	0	1.2	22.3
14/02/2024 22:00	14.5	0.54	475906.6	40.77	0	1.2	22.3
14/02/2024 23:00	14.51	0.76	467657.1	35.1	0	1.2	22.3
14/02/2024 24:00	Shutdown	0.54	Shutdown	0.48	Shutdown	Shutdown	Shutdown
Minimum	14.5	0.01	467657.1	0	0	1.1	22.2
MinDate	02/14/2024 22:00:00	02/14/2024 12:00:00	02/14/2024 23:00:00	02/14/2024 1:00:00	02/14/2024 15:00:00	02/14/2024 20:00:00	02/14/2024 19:00:00
Maximum	14.82	0.78	489072.7	41.74	0.4	1.2	29.7
MaxDate	02/14/2024 14:00:00	02/14/2024 13:00:00	02/14/2024 18:00:00	02/14/2024 18:00:00	02/14/2024 14:00:00	02/14/2024 14:00:00	02/14/2024 14:00:00
Avg	14.64	0.37	481894.3	16.86	0	1.2	23.5
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.2	6778.4	20.3	0.1	0	2.4
Site ABPR51 Daily: 15/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
15/02/2024 01:00	14.22	0.24	493100.9	42.81	0	0	16.9
15/02/2024 02:00	14.2	0.22	491956.9	42.83	0	0	16.9
15/02/2024 03:00	14.2	0.25	491675.2	42.85	0	0	17
15/02/2024 04:00	14.21	0.33	491433.9	42.83	0	0	17.1
15/02/2024 05:00	14.2	0.27	491549.9	42.84	0	0	17.1
15/02/2024 06:00	14.2	0.33	492066.3	42.93	0	0	17.1
15/02/2024 07:00	14.19	0.65	491302.5	42.84	0	0	16.8
15/02/2024 08:00	14.18	0.43	491085.6	42.83	0	0	16.6
15/02/2024 09:00	14.21	0.38	492538.4	42.85	0	0	16.4
15/02/2024 10:00	14.22	0.12	494368.2	42.85	0	0	16.6
15/02/2024 11:00	14.28	0.15	498191.7	42.85	0	0	18
15/02/2024 12:00	14.36	0.25	503299.8	42.9	0	0	19.5
15/02/2024 13:00	14.41	0.45	497318.4	41.83	0	0	20.9
15/02/2024 14:00	14.33	0.28	474709.8	39.5	0	0	21
15/02/2024 15:00	14.26	0.02	484270.4	41.06	0	0	16.2
15/02/2024 16:00	14.2	0.34	489904.5	41.92	0	0	15.5
15/02/2024 17:00	14.16	0.36	482362	41.25	0	0	15.4
15/02/2024 18:00	14.2	0.29	484451.9	41.35	0	0	15.7
15/02/2024 19:00	14.19	0.34	486147.1	41.54	0	0	15.9
15/02/2024 20:00	14.2	0.38	487488.4	41.75	0	0	16.3
15/02/2024 21:00	14.18	0.41	488996	42	0	0	16.3
15/02/2024 22:00	14.18	0.35	489188.3	42	0	0	16.1
15/02/2024 23:00	14.21	0.35	453451	37.5	0	0	20
15/02/2024 24:00	14.19	0.25	492520	42.63	0	0	16.3
Minimum	14.16	0.02	453451	37.5	0	0	15.4
MinDate	02/15/2024 17:00:00	02/15/2024 15:00:00	02/15/2024 23:00:00	02/15/2024 23:00:00	02/15/2024 1:00:00	02/15/2024 1:00:00	02/15/2024 17:00:00
Maximum	14.41	0.65	503299.8	42.93	0	0	21
MaxDate	02/15/2024 13:00:00	02/15/2024 7:00:00	02/15/2024 12:00:00	02/15/2024 6:00:00	02/15/2024 1:00:00	02/15/2024 1:00:00	02/15/2024 14:00:00
Avg	14.22	0.31	488890.7	42.02	0	0	17.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	9425.7	1.3	0	0	1.6
Site ABPR52 Daily: 15/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
15/02/2024 01:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 02:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 03:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 04:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 05:00	Shutdown	0.35	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 06:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 07:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 08:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 09:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 10:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 11:00	Shutdown	0.44	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 12:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
15/02/2024 13:00	Shutdown	0.98	Shutdown	1.19	Shutdown	Shutdown	Shutdown
15/02/2024 14:00	14.83	0.64	481057.3	38.46	0.4	1.4	27.8
15/02/2024 15:00	14.71	0.1	486429.7	41.15	0	1.4	22
15/02/2024 16:00	14.59	0.47	490387.6	42	0	1.3	21.4
15/02/2024 17:00	14.51	0.75	482387.4	41.33	0	1.3	21.1
15/02/2024 18:00	14.57	0.69	484500.6	41.44	0	1.3	21.2
15/02/2024 19:00	14.56	0.65	485443	41.64	0	1.3	21.4
15/02/2024 20:00	14.53	0.58	486847.7	41.86	0	1.3	21.7
15/02/2024 21:00	14.52	0.48	488525.4	42.07	0	1.3	21.7



15/02/2024 22:00	14.5	0.54	489131.4	42.12	0	1.3	21.6
15/02/2024 23:00	14.49	0.78	469534.5	35.34	0	1.3	21.6
15/02/2024 24:00	Shutdown	0.34	Shutdown	0.16	Shutdown	Shutdown	Shutdown
Minimum	14.49	0.04	469534.5	0	0	1.3	21.1
MinDate	02/15/2024 23:00:00	02/15/2024 1:00:00	02/15/2024 23:00:00	02/15/2024 1:00:00	02/15/2024 15:00:00	02/15/2024 16:00:00	02/15/2024 17:00:00
Maximum	14.83	0.98	490387.6	42.12	0.4	1.4	27.8
MaxDate	02/15/2024 14:00:00	02/15/2024 13:00:00	02/15/2024 16:00:00	02/15/2024 22:00:00	02/15/2024 14:00:00	02/15/2024 14:00:00	02/15/2024 14:00:00
Avg	14.58	0.38	484424.4	17.03	0	1.3	22.2
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	5986.8	20.5	0.1	0	2
Site ABPR51 Daily: 16/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
16/02/2024 01:00	14.19	0.22	493383.1	42.88	0	0	16.3
16/02/2024 02:00	14.18	0.23	492902.4	42.87	0	0	16.2
16/02/2024 03:00	14.18	0.19	493843.3	42.99	0	0	16.2
16/02/2024 04:00	14.2	0.21	493253.3	42.9	0	0	16.4
16/02/2024 05:00	14.19	0.3	493677.6	42.95	0	0	16.3
16/02/2024 06:00	14.19	0.38	493867.8	43.02	0	0	16.2
16/02/2024 07:00	14.18	0.44	493231.2	42.9	0	0	16.1
16/02/2024 08:00	14.18	0.27	492667.9	42.88	0	0	16.1
16/02/2024 09:00	14.21	0.2	493265.2	42.87	0	0	16.7
16/02/2024 10:00	14.23	0.15	494857.7	42.87	0	0	17.3
16/02/2024 11:00	14.26	0.19	496778.2	42.85	0	0	17.7
16/02/2024 12:00	14.3	0.33	500421.8	42.94	0	0	18.3
16/02/2024 13:00	14.33	0.45	494661.5	41.93	0	0	19.2
16/02/2024 14:00	14.31	0.24	471936.4	39.13	0	0	19.3
16/02/2024 15:00	14.29	0.17	495547	41.88	0	0	17.8
16/02/2024 16:00	14.28	0.24	496053.1	42.07	0	0	17.6
16/02/2024 17:00	14.28	0.28	499086.3	42.45	0	0	17.9
16/02/2024 18:00	14.23	0.27	488732.3	41.6	0	0	17
16/02/2024 19:00	14.22	0.34	490833.6	41.93	0	0	17.4
16/02/2024 20:00	14.21	0.4	486501.2	41.66	0	0	17.1
16/02/2024 21:00	14.21	0.42	491832.7	42.25	0	0	17.1
16/02/2024 22:00	14.2	0.37	488112.1	41.87	0	0	16.9
16/02/2024 23:00	14.23	0.29	454916.1	37.51	0	0	19.9
16/02/2024 24:00	14.22	0.25	492292.5	42.58	0	0	17.1
Minimum	14.18	0.15	454916.1	37.51	0	0	16.1
MinDate	02/16/2024 2:00:00	02/16/2024 10:00:00	02/16/2024 23:00:00	02/16/2024 23:00:00	02/16/2024 1:00:00	02/16/2024 1:00:00	02/16/2024 7:00:00
Maximum	14.33	0.45	500421.8	43.02	0	0	19.9
MaxDate	02/16/2024 13:00:00	02/16/2024 13:00:00	02/16/2024 12:00:00	02/16/2024 6:00:00	02/16/2024 1:00:00	02/16/2024 1:00:00	02/16/2024 23:00:00
Avg	14.23	0.28	490943.9	42.16	0	0	17.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	9357.8	1.3	0	0	1.1
Site ABPR52 Daily: 16/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
16/02/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 02:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 04:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 05:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 06:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 07:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 08:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 09:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 10:00	Shutdown	0.31	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 11:00	Shutdown	0.66	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 12:00	Shutdown	0.42	Shutdown	0	Shutdown	Shutdown	Shutdown
16/02/2024 13:00	Shutdown	0.89	Shutdown	1.23	Shutdown	Shutdown	Shutdown
16/02/2024 14:00	14.8	0.48	477901.7	38.55	0.4	1.5	26.8
16/02/2024 15:00	14.77	0.32	495332.7	41.92	0	1.4	23.4
16/02/2024 16:00	14.73	0.44	495587.1	42.17	0	1.4	23.1
16/02/2024 17:00	14.69	0.46	498144.6	42.54	0	1.4	23.3
16/02/2024 18:00	14.62	0.53	487753.9	41.72	0	1.3	22.4
16/02/2024 19:00	14.6	0.58	489899.5	42.06	0	1.3	22.7
16/02/2024 20:00	14.54	0.52	486345.5	41.75	0	1.3	22.3
16/02/2024 21:00	14.52	0.62	491321.6	42.33	0	1.3	22.5
16/02/2024 22:00	14.53	0.73	487811.2	41.95	0	1.3	22.2
16/02/2024 23:00	14.51	0.77	474337.6	35.15	0	1.3	22
16/02/2024 24:00	Shutdown	0.36	Shutdown	0.15	Shutdown	Shutdown	Shutdown
Minimum	14.51	0	474337.6	0	0	1.3	22
MinDate	02/16/2024 23:00:00	02/16/2024 1:00:00	02/16/2024 23:00:00	02/16/2024 1:00:00	02/16/2024 15:00:00	02/16/2024 18:00:00	02/16/2024 23:00:00
Maximum	14.8	0.89	498144.6	42.54	0.4	1.5	26.8
MaxDate	02/16/2024 14:00:00	02/16/2024 13:00:00	02/16/2024 17:00:00	02/16/2024 17:00:00	02/16/2024 14:00:00	02/16/2024 14:00:00	02/16/2024 14:00:00
Avg	14.63	0.37	488443.5	17.15	0	1.4	23.1
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	7591.7	20.7	0.1	0.1	1.4
Site ABPR51 Daily: 17/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
17/02/2024 01:00	14.21	0.23	493205.4	42.88	0	0	16.7
17/02/2024 02:00	14.2	0.24	493045.7	42.88	0	0	16.5
17/02/2024 03:00	14.2	0.2	493414.1	42.91	0	0	16.3
17/02/2024 04:00	14.2	0.2	493899.8	42.94	0	0	16.4
17/02/2024 05:00	14.21	0.24	494327.9	42.99	0	0	16.6
17/02/2024 06:00	14.2	0.23	494099.9	42.95	0	0	16.5
17/02/2024 07:00	14.2	0.25	492980.3	42.91	0	0	16.5
17/02/2024 08:00	14.21	0.24	493113.8	42.89	0	0	16.6
17/02/2024 09:00	14.21	0.2	493217.8	42.89	0	0	16.7
17/02/2024 10:00	14.23	0.2	495108.5	42.88	0	0	17.5
17/02/2024 11:00	14.28	0.2	497505.3	42.88	0	0	18.2
17/02/2024 12:00	14.28	0.14	499741.6	42.99	0	0	18.4
17/02/2024 13:00	14.28	0.15	491221.2	41.91	0	0	18.6
17/02/2024 14:00	14.21	0.06	435222.1	35.7	0	0	17.8
17/02/2024 15:00	14.18	0.14	447930.5	37.37	0	0	17.6
17/02/2024 16:00	14.2	0.16	451128.3	37.69	0	0	17.7
17/02/2024 17:00	14.16	0.03	448273.3	37.59	0	0	17.3
17/02/2024 18:00	14.15	0.13	447774.3	37.61	0	0	17.5
17/02/2024 19:00	14.15	0.14	446456.6	37.57	0	0	17.9
17/02/2024 20:00	14.12	0.15	443546.9	37.25	0	0	17.9



17/02/2024 21:00	14.11	0.15	444856.3	37.43	0	0	17.6
17/02/2024 22:00	14.13	0.15	445068.4	37.47	0	0	17.9
17/02/2024 23:00	14.14	0.29	441849.4	31.76	0	0	18.2
17/02/2024 24:00	Shutdown	0.09	Shutdown	0.18	Shutdown	Shutdown	Shutdown
Minimum	14.11	0.03	435222.1	0.18	0	0	16.3
MinDate	02/17/2024 21:00:00	02/17/2024 17:00:00	02/17/2024 14:00:00		02/17/2024 1:00:00	02/17/2024 1:00:00	02/17/2024 3:00:00
Maximum	14.28	0.29	499741.6	42.99	0	0	18.6
MaxDate	02/17/2024 11:00:00	02/17/2024 23:00:00	02/17/2024 12:00:00	02/17/2024 5:00:00	02/17/2024 1:00:00	02/17/2024 1:00:00	02/17/2024 13:00:00
Avg	14.19	0.18	472912.5	38.52	0	0	17.3
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0	0.1	25053.9	8.8	0	0	0.7
Site ABPR52 Daily: 17/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
17/02/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 03:00	Shutdown	0.24	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 04:00	Shutdown	1.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 05:00	Shutdown	1.92	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 06:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 07:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 08:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 09:00	Shutdown	0.24	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 10:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 11:00	Shutdown	0.45	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 12:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
17/02/2024 13:00	Shutdown	0.89	Shutdown	1.27	Shutdown	Shutdown	Shutdown
17/02/2024 14:00	14.63	0.43	439294.9	35.05	0.4	1.5	25.7
17/02/2024 15:00	14.58	0.42	447499.5	37.47	0	1.4	23.5
17/02/2024 16:00	14.57	0.46	450019.6	37.77	0	1.4	23.5
17/02/2024 17:00	14.51	0.41	446657.3	37.67	0	1.4	23
17/02/2024 18:00	14.48	0.52	446802.6	37.75	0	1.4	23.2
17/02/2024 19:00	14.47	0.57	445735.3	37.69	0	1.4	23.3
17/02/2024 20:00	14.47	0.61	442010	37.34	0	1.4	23.3
17/02/2024 21:00	14.46	0.65	443365.3	37.52	0	1.4	23.2
17/02/2024 22:00	14.46	0.65	443749	37.57	0	1.4	23.3
17/02/2024 23:00	14.53	0.65	423875.8	34.51	0	1.4	26.4
17/02/2024 24:00	14.58	0.78	490710.6	42.41	0	1.5	23.8
Minimum	14.46	0	423875.8	0	0	1.4	23
MinDate	02/17/2024 21:00:00	02/17/2024 1:00:00	02/17/2024 23:00:00	02/17/2024 1:00:00	02/17/2024 15:00:00	02/17/2024 15:00:00	02/17/2024 17:00:00
Maximum	14.63	1.92	490710.6	42.41	0.4	1.5	26.4
MaxDate	02/17/2024 14:00:00	02/17/2024 5:00:00			02/17/2024 14:00:00	02/17/2024 14:00:00	02/17/2024 23:00:00
Avg	14.52	0.49	447247.2	17.25	0	1.4	23.8
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.4	16012.4	19.1	0.1	0	1.1
Site ABPR51 Daily: 18/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
18/02/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 03:00	Shutdown	1.66	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 04:00	Shutdown	3.6	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 05:00	Shutdown	3.36	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 06:00	Shutdown	0.91	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 18:00	<Samp	0.37	<Samp	20.35	<Samp	<Samp	<Samp
18/02/2024 19:00	14.2	0.28	447415.2	37.21	0	0	17.9
18/02/2024 20:00	14.16	0.36	443253.8	36.99	0	0	18
18/02/2024 21:00	14.15	0.37	443307.6	37.1	0	0	17.9
18/02/2024 22:00	14.27	0.31	448797.2	36.75	0	0	21.9
18/02/2024 23:00	14.22	0.23	494395.3	42.8	0	0	18.1
18/02/2024 24:00	14.22	0.25	493746.6	42.85	0	0	18.2
Minimum	14.15	0.01	443253.8	0	0	0	17.9
MinDate	02/18/2024 21:00:00	02/18/2024 1:00:00	02/18/2024 20:00:00	02/18/2024 1:00:00	02/18/2024 19:00:00	02/18/2024 19:00:00	02/18/2024 19:00:00
Maximum	14.27	3.6	494395.3	42.85	0	0	21.9
MaxDate	02/18/2024 22:00:00	02/18/2024 4:00:00	02/18/2024 23:00:00		02/18/2024 19:00:00	02/18/2024 19:00:00	02/18/2024 22:00:00
Avg	14.2	0.49	461819.3	10.59	0	0	18.7
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	1	25080.6	17.3	0	0	1.6
Site ABPR52 Daily: 18/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
18/02/2024 01:00	14.59	0.79	490649.5	42.74	0	1.4	23.1
18/02/2024 02:00	14.57	0.67	490323.8	42.74	0	1.4	23.1
18/02/2024 03:00	14.55	0.69	490369.3	42.75	0	1.4	23.1
18/02/2024 04:00	14.56	0.69	490067.2	42.71	0	1.4	23
18/02/2024 05:00	14.57	0.61	490241.2	42.73	0	1.4	22.9
18/02/2024 06:00	14.57	0.57	491111.6	42.85	0	1.4	22.9
18/02/2024 07:00	14.57	0.51	489701.6	42.74	0	1.5	22.8
18/02/2024 08:00	14.56	0.53	489602.9	42.7	0	1.5	22.8
18/02/2024 09:00	14.59	0.56	490617.7	42.67	0	1.4	23.3
18/02/2024 10:00	14.65	0.62	492609.8	42.7	0	1.4	23.9
18/02/2024 11:00	14.68	0.74	493447.8	42.68	0	1.4	24.5
18/02/2024 12:00	14.7	0.76	494966	42.67	0	1.4	25
18/02/2024 13:00	14.74	0.76	496456.5	42.67	0	1.4	25.2
18/02/2024 14:00	14.72	0.62	496556.1	42.67	0	1.4	25.3
18/02/2024 15:00	14.72	0.65	497882.1	42.69	0	1.4	25.6
18/02/2024 16:00	14.7	0.48	497019.2	42.69	0	1.4	25.3
18/02/2024 17:00	14.65	0.39	495964.2	42.82	0	1.4	24.8
18/02/2024 18:00	14.62	0.38	434579.4	35.41	0	1.3	26.3
18/02/2024 19:00	14.49	0.38	442092	37.3	0	1.3	24



18/02/2024 20:00	14.47	0.36	439624.4	37.07	0	1.3	23.5
18/02/2024 21:00	14.47	0.46	439900.5	37.18	0	1.3	23.4
18/02/2024 22:00	Shutdown	0.87	Shutdown	12.88	Shutdown	Shutdown	Shutdown
18/02/2024 23:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
18/02/2024 24:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.47	0.04	434579.4	0	0	1.3	22.8
MinDate	02/18/2024 20:00:00	02/18/2024 23:00:00	02/18/2024 18:00:00	02/18/2024 23:00:00	02/18/2024 1:00:00	02/18/2024 18:00:00	02/18/2024 7:00:00
Maximum	14.74	0.87	497882.1	42.85	0	1.5	26.3
MaxDate	02/18/2024 13:00:00	02/18/2024 22:00:00	02/18/2024 15:00:00	02/18/2024 6:00:00	02/18/2024 1:00:00	02/18/2024 7:00:00	02/18/2024 18:00:00
Avg	14.61	0.56	482561.1	36.92	0	1.4	24
Num	21	24	21	24	21	21	21
Data[%]	88	100	88	100	88	88	88
STD	0.1	0.2	21829.4	13	0	0.1	1.1
Site ABPR51 Daily: 19/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
19/02/2024 01:00	14.22	0.27	493183.4	42.83	0	0	18
19/02/2024 02:00	14.22	0.27	493417.3	42.85	0	0	17.9
19/02/2024 03:00	14.22	0.32	493145	42.87	0	0	17.8
19/02/2024 04:00	14.22	0.28	493240.9	42.88	0	0	17.6
19/02/2024 05:00	14.22	0.28	493603.7	42.89	0	0	17.8
19/02/2024 06:00	14.22	0.27	494456.1	42.98	0	0	17.9
19/02/2024 07:00	14.22	0.38	493302.3	42.88	0	0	17.9
19/02/2024 08:00	14.22	0.46	493640	42.9	0	0	17.8
19/02/2024 09:00	14.23	0.22	494284.3	42.86	0	0	18.1
19/02/2024 10:00	14.28	0.14	495884.3	42.77	0	0	18.8
19/02/2024 11:00	14.32	0.15	499587.7	42.84	0	0	19.9
19/02/2024 12:00	14.35	0.13	501616.8	42.87	0	0	20.5
19/02/2024 13:00	14.34	0.14	494556.7	41.96	0	0	20.8
19/02/2024 14:00	14.33	0.11	473429.1	39.25	0	0	20.3
19/02/2024 15:00	14.34	0.17	493863.8	41.58	0	0	19.5
19/02/2024 16:00	14.31	0.19	492896.1	41.64	0	0	19.4
19/02/2024 17:00	14.32	0.27	496845	42.04	0	0	19.8
19/02/2024 18:00	14.28	0.23	492858.7	41.86	0	0	19
19/02/2024 19:00	14.23	0.38	483909.2	41.22	0	0	17.9
19/02/2024 20:00	14.21	0.47	482380.4	41.2	0	0	17.3
19/02/2024 21:00	14.18	0.42	473809.7	40.36	0	0	17.1
19/02/2024 22:00	14.17	0.34	475406.6	40.58	0	0	16.9
19/02/2024 23:00	14.24	0.31	451573.1	36.98	0	0	20.4
19/02/2024 24:00	14.23	0.26	488587.5	42.05	0	0	19.4
Minimum	14.17	0.11	451573.1	36.98	0	0	16.9
MinDate	02/19/2024 22:00:00	02/19/2024 14:00:00	02/19/2024 23:00:00	02/19/2024 23:00:00	02/19/2024 1:00:00	02/19/2024 1:00:00	02/19/2024 22:00:00
Maximum	14.35	0.47	501616.8	42.98	0	0	20.8
MaxDate	02/19/2024 12:00:00	02/19/2024 20:00:00	02/19/2024 12:00:00	02/19/2024 6:00:00	02/19/2024 1:00:00	02/19/2024 1:00:00	02/19/2024 13:00:00
Avg	14.26	0.27	489144.9	41.88	0	0	18.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	11002.5	1.4	0	0	1.2
Site ABPR52 Daily: 19/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
19/02/2024 01:00	Shutdown	0.52	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 02:00	Shutdown	1.77	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 03:00	Shutdown	2.54	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 04:00	Shutdown	2.55	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 05:00	Shutdown	2.6	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 06:00	Shutdown	0.89	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 07:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 08:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 09:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
19/02/2024 13:00	Shutdown	0.7	Shutdown	1.26	Shutdown	Shutdown	Shutdown
19/02/2024 14:00	14.73	0.46	479069.7	38.99	0.3	1.4	27.8
19/02/2024 15:00	14.72	0.52	494375.9	41.68	0	1.4	24.6
19/02/2024 16:00	14.67	0.53	492629.6	41.75	0	1.4	24.5
19/02/2024 17:00	14.65	0.56	495022.7	42.14	0	1.4	25
19/02/2024 18:00	14.61	0.58	491193.8	41.96	0	1.3	24.3
19/02/2024 19:00	14.57	0.52	483311.7	41.32	0	1.3	23.3
19/02/2024 20:00	14.54	0.54	481576.5	41.3	0	1.3	22.8
19/02/2024 21:00	14.52	0.57	473256.2	40.46	0	1.3	22.6
19/02/2024 22:00	14.53	0.56	475019	40.66	0	1.3	22.4
19/02/2024 23:00	14.52	0.73	471268.6	34.95	0	1.4	22.5
19/02/2024 24:00	Shutdown	0.32	Shutdown	0.15	Shutdown	Shutdown	Shutdown
Minimum	14.52	0.01	471268.6	0	0	1.3	22.4
MinDate	02/19/2024 21:00:00	02/19/2024 10:00:00	02/19/2024 23:00:00	02/19/2024 1:00:00	02/19/2024 15:00:00	02/19/2024 18:00:00	02/19/2024 22:00:00
Maximum	14.73	2.6	495022.7	42.14	0.3	1.4	27.8
MaxDate	02/19/2024 14:00:00	02/19/2024 5:00:00	02/19/2024 17:00:00	02/19/2024 17:00:00	02/19/2024 14:00:00	02/19/2024 14:00:00	02/19/2024 14:00:00
Avg	14.61	0.74	483672.3	16.94	0	1.4	24
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.8	9088	20.4	0.1	0.1	1.7
Site ABPR51 Daily: 20/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
20/02/2024 01:00	14.22	0.5	493497.4	42.83	0	0	17.2
20/02/2024 02:00	14.22	0.37	493405.5	42.86	0	0	17.1
20/02/2024 03:00	14.22	0.29	493632.1	42.88	0	0	16.9
20/02/2024 04:00	14.22	0.24	494362.5	42.92	0	0	16.8
20/02/2024 05:00	14.22	0.28	494525.2	42.96	0	0	16.6
20/02/2024 06:00	14.21	0.28	495151.7	43.04	0	0	16.7
20/02/2024 07:00	14.22	0.29	494059.5	42.94	0	0	16.9
20/02/2024 08:00	14.22	0.26	493739.7	42.94	0	0	16.9
20/02/2024 09:00	14.22	0.21	494746.2	42.9	0	0	17.2
20/02/2024 10:00	14.27	0.19	497388.1	42.87	0	0	18.3
20/02/2024 11:00	14.32	0.21	500009.9	42.82	0	0	19.3
20/02/2024 12:00	14.37	0.18	503023.2	42.82	0	0	20.7
20/02/2024 13:00	14.38	0.19	482833	40.22	0	0	21.5
20/02/2024 14:00	14.33	0.19	467800.2	38.71	0	0	21.4
20/02/2024 15:00	14.33	0.2	487631.1	40.95	0	0	18.8
20/02/2024 16:00	14.3	0.18	483749.8	40.73	0	0	18.6
20/02/2024 17:00	14.28	0.2	478674.3	40.36	0	0	18.5
20/02/2024 18:00	14.26	0.21	480206.4	40.65	0	0	18



20/02/2024 19:00	14.21	0.17	478211	40.69	0	0	17.4
20/02/2024 20:00	14.2	0.26	478617	40.82	0	0	17.1
20/02/2024 21:00	14.19	0.29	472662.6	40.2	0	0	17
20/02/2024 22:00	14.2	0.37	479050	40.9	0	0	17
20/02/2024 23:00	14.24	0.27	456268.3	36.78	0	0	20.4
20/02/2024 24:00	14.23	0.24	489918.6	42.19	0	0	18.3
Minimum	14.19	0.17	456268.3	36.78	0	0	16.6
MinDate	02/20/2024 21:00:00	02/20/2024 19:00:00	02/20/2024 23:00:00	02/20/2024 23:00:00	02/20/2024 1:00:00	02/20/2024 1:00:00	02/20/2024 5:00:00
Maximum	14.38	0.5	503023.2	43.04	0	0	21.5
MaxDate	02/20/2024 13:00:00	02/20/2024 1:00:00	02/20/2024 12:00:00	02/20/2024 6:00:00	02/20/2024 1:00:00	02/20/2024 1:00:00	02/20/2024 13:00:00
Avg	14.25	0.25	486798.5	41.58	0	0	18.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	11176.7	1.6	0	0	1.5

Site ABPR52 Daily: 20/02/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
20/02/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 03:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 04:00	Shutdown	0.26	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 05:00	Shutdown	0.74	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 06:00	Shutdown	0.47	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 07:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 08:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 09:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 10:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 11:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 12:00	Shutdown	0.22	Shutdown	0	Shutdown	Shutdown	Shutdown
20/02/2024 13:00	Shutdown	0.67	Shutdown	3.57	Shutdown	Shutdown	Shutdown
20/02/2024 14:00	14.74	0.46	472220.8	38.73	0	1.4	25.8
20/02/2024 15:00	14.74	0.42	487998.8	41.05	0	1.4	24.3
20/02/2024 16:00	14.69	0.4	483516.4	40.83	0	1.4	23.9
20/02/2024 17:00	14.64	0.45	477704	40.45	0	1.4	23.7
20/02/2024 18:00	14.6	0.53	479184	40.75	0	1.3	23.3
20/02/2024 19:00	14.55	0.59	477745.3	40.78	0	1.3	22.6
20/02/2024 20:00	14.53	0.68	478323.8	40.92	0	1.3	22.4
20/02/2024 21:00	14.52	0.67	471943.8	40.29	0	1.4	22.4
20/02/2024 22:00	14.54	0.68	479086.9	41.01	0	1.4	22.4
20/02/2024 23:00	14.54	0.8	468503.6	34.96	0	1.4	22.5
20/02/2024 24:00	Shutdown	0.54	Shutdown	0.36	Shutdown	Shutdown	Shutdown
Minimum	14.52	0	468503.6	0	0	1.3	22.4
MinDate	02/20/2024 21:00:00	02/20/2024 1:00:00	02/20/2024 23:00:00	02/20/2024 1:00:00	02/20/2024 14:00:00	02/20/2024 18:00:00	02/20/2024 20:00:00
Maximum	14.74	0.8	487998.8	41.05	0	1.4	25.8
MaxDate	02/20/2024 14:00:00	02/20/2024 23:00:00	02/20/2024 15:00:00	02/20/2024 15:00:00	02/20/2024 14:00:00	02/20/2024 14:00:00	02/20/2024 14:00:00
Avg	14.61	0.38	477622.7	16.82	0	1.4	23.3
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	5699.4	20	0	0	1.1

Site ABPR51 Daily: 21/02/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
21/02/2024 01:00	14.22	0.31	493640.9	42.87	0	0	17.1
21/02/2024 02:00	14.22	0.32	493752	42.87	0	0	16.9
21/02/2024 03:00	14.21	0.34	493754.6	42.88	0	0	16.7
21/02/2024 04:00	14.2	0.35	493859.9	42.9	0	0	16.4
21/02/2024 05:00	14.2	0.35	493778	42.94	0	0	16.4
21/02/2024 06:00	14.2	0.31	493883.9	42.94	0	0	16.4
21/02/2024 07:00	14.22	0.25	493884.3	42.92	0	0	16.7
21/02/2024 08:00	14.22	0.29	494005.4	42.91	0	0	16.7
21/02/2024 09:00	14.24	0.23	496186.6	42.95	0	0	17.6
21/02/2024 10:00	9.37	0.24	497884.3	42.92	27	2.4	31.9
21/02/2024 11:00	15.51	0.24	501366.9	42.89	6.5	1.7	30.8
21/02/2024 12:00	14.32	0.16	502203	42.91	0	0	33.3
21/02/2024 13:00	14.32	0.16	486545.5	40.76	0	0	34.4
21/02/2024 14:00	14.33	0.22	468542.2	38.62	0	0	36.1
21/02/2024 15:00	14.32	0.2	483026.9	40.43	0	0.1	32.4
21/02/2024 16:00	14.29	0.25	484539.7	40.69	0	0.1	32.2
21/02/2024 17:00	14.27	0.27	488612.9	41.23	0	0	31.9
21/02/2024 18:00	14.21	0.18	483432.8	40.98	0	0	31
21/02/2024 19:00	14.18	0.23	483710.3	41.24	0	0.1	30
21/02/2024 20:00	14.16	0.28	482822	41.27	0	0.1	29.9
21/02/2024 21:00	14.15	0.3	477318.6	40.71	0	0.1	29.7
21/02/2024 22:00	14.15	0.38	484253	41.43	0	0.1	29.6
21/02/2024 23:00	14.2	0.36	451015.1	36.82	0	0.1	33.6
21/02/2024 24:00	14.17	0.32	491920.3	42.49	0	0.2	30.4
Minimum	9.37	0.16	451015.1	36.82	0	0	16.4
MinDate	02/21/2024 10:00:00	02/21/2024 12:00:00	02/21/2024 23:00:00	02/21/2024 23:00:00	02/21/2024 1:00:00	02/21/2024 1:00:00	02/21/2024 4:00:00
Maximum	15.51	0.38	502203	42.95	27	2.4	36.1
MaxDate	02/21/2024 11:00:00	02/21/2024 22:00:00	02/21/2024 12:00:00	02/21/2024 9:00:00	02/21/2024 10:00:00	02/21/2024 10:00:00	02/21/2024 14:00:00
Avg	14.08	0.27	488080.8	41.73	1.4	0.2	26.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	1	0.1	11057.6	1.6	5.6	0.6	7.6

Site ABPR52 Daily: 21/02/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
21/02/2024 01:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 02:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 03:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 04:00	Shutdown	0.54	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 05:00	Shutdown	0.63	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 06:00	Shutdown	0.38	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 07:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 08:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 09:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 10:00	Shutdown	0.42	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 11:00	Shutdown	0.44	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 12:00	Shutdown	0.4	Shutdown	0	Shutdown	Shutdown	Shutdown
21/02/2024 13:00	Shutdown	0.89	Shutdown	3	Shutdown	Shutdown	Shutdown
21/02/2024 14:00	14.98	0.63	472777.8	38.57	0	0.7	41.7
21/02/2024 15:00	8.78	0.62	482807.3	40.52	13.4	2.3	24.4
21/02/2024 16:00	9.46	0.6	483645.3	40.78	0	0.4	21.1
21/02/2024 17:00	14.54	0.56	487204.2	41.3	0	0.6	32.1



21/02/2024 18:00	14.49	0.52	483100.8	41.11	0	0.5	30.9
21/02/2024 19:00	14.45	0.45	483609.2	41.35	0	0.5	29.7
21/02/2024 20:00	14.43	0.49	482959.4	41.36	0	0.5	29.3
21/02/2024 21:00	14.42	0.46	476796.4	40.81	0	0.5	29.1
21/02/2024 22:00	14.42	0.46	483921.3	41.54	0	0.6	28.9
21/02/2024 23:00	14.41	0.67	466752.2	34.93	0	0.5	29.1
21/02/2024 24:00	Shutdown	0.37	Shutdown	0.21	Shutdown	Shutdown	Shutdown
Minimum	8.78	0.03	466752.2	0	0	0.4	21.1
MinDate	02/21/2024 15:00:00	02/21/2024 1:00:00	02/21/2024 23:00:00	02/21/2024 1:00:00	02/21/2024 14:00:00	02/21/2024 16:00:00	02/21/2024 16:00:00
Maximum	14.98	0.89	487204.2	41.54	13.4	2.3	41.7
MaxDate	02/21/2024 14:00:00	02/21/2024 13:00:00	02/21/2024 17:00:00	02/21/2024 22:00:00	02/21/2024 15:00:00	02/21/2024 15:00:00	02/21/2024 14:00:00
Avg	13.44	0.43	480357.4	16.9	1.3	0.7	29.6
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	2.3	0.2	6292.1	20.2	4.2	0.6	5.3

Site ABPR51 Daily: 22/02/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
22/02/2024 01:00	14.16	0.22	493285.3	42.87	0	0.3	29.7
22/02/2024 02:00	14.15	0.26	493012	42.83	0	0.3	29.5
22/02/2024 03:00	14.16	0.28	493254.1	42.84	0	0.3	29.5
22/02/2024 04:00	14.16	0.27	492879.9	42.85	0	0.3	29.4
22/02/2024 05:00	14.16	0.25	493375.5	42.92	0	0.4	29.2
22/02/2024 06:00	14.16	0.31	494060.1	42.95	0	0.4	29.2
22/02/2024 07:00	14.16	0.32	493870.4	42.91	0	0.4	29.3
22/02/2024 08:00	14.16	0.31	493177.3	42.87	0	0.4	29.3
22/02/2024 09:00	14.18	0.16	494721.1	42.86	0	0.4	29.8
22/02/2024 10:00	14.24	0.11	498038.1	42.88	0	0.4	31.5
22/02/2024 11:00	14.29	0.15	501307.5	42.85	0	0.4	32.9
22/02/2024 12:00	14.34	0.2	504042.5	42.86	0	0.3	34.3
22/02/2024 13:00	14.37	0.25	494774.4	41.83	0	0.1	33.4
22/02/2024 14:00	14.29	0.15	469539.6	39.03	0	0	31.7
22/02/2024 15:00	14.29	0.16	483117.1	40.44	0	0	30.4
22/02/2024 16:00	14.27	0.16	480280.7	40.35	0	0	29.8
22/02/2024 17:00	14.27	0.18	482558.8	40.65	0	0	30.3
22/02/2024 18:00	14.22	0.21	480424.3	40.68	0	0	29.5
22/02/2024 19:00	14.18	0.34	479560.8	40.83	0	0	28.9
22/02/2024 20:00	14.15	0.34	478420.3	40.9	0	0	28.4
22/02/2024 21:00	14.15	0.31	478731	40.9	0	0	28.4
22/02/2024 22:00	14.15	0.33	479163	40.99	0	0	28.3
22/02/2024 23:00	14.18	0.32	460831.1	37.9	0	0	31.8
22/02/2024 24:00	14.17	0.29	494802.1	42.76	0	0	28.7
Minimum	14.15	0.11	460831.1	37.9	0	0	28.3
MinDate	02/22/2024 2:00:00	02/22/2024 10:00:00	02/22/2024 23:00:00	02/22/2024 23:00:00	02/22/2024 1:00:00	02/22/2024 14:00:00	02/22/2024 22:00:00
Maximum	14.37	0.34	504042.5	42.95	0	0.4	34.3
MaxDate	02/22/2024 13:00:00	02/22/2024 19:00:00	02/22/2024 12:00:00	02/22/2024 6:00:00	02/22/2024 1:00:00	02/22/2024 5:00:00	02/22/2024 12:00:00
Avg	14.21	0.25	487801.1	41.74	0	0.2	30.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	10385	1.4	0	0.2	1.6

Site ABPR52 Daily: 22/02/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
22/02/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 02:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 03:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 04:00	Shutdown	0.31	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 05:00	Shutdown	0.43	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 06:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 07:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 08:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 09:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 10:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 11:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 12:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
22/02/2024 13:00	Shutdown	0.89	Shutdown	1.23	Shutdown	Shutdown	Shutdown
22/02/2024 14:00	14.97	0.47	475037.5	38.22	0.3	0.2	31.6
22/02/2024 15:00	14.91	0.47	483177.7	40.52	0	0.3	26.4
22/02/2024 16:00	14.88	0.44	479938.3	40.45	0	0.3	24.9
22/02/2024 17:00	14.85	0.52	481750.4	40.75	0	0.3	25.3
22/02/2024 18:00	14.78	0.46	479715	40.74	0	0.2	24.7
22/02/2024 19:00	14.73	0.57	479388.2	40.9	0	0.2	24.3
22/02/2024 20:00	14.71	0.63	478565.1	40.98	0	0.2	24.1
22/02/2024 21:00	14.7	0.66	478501.3	40.98	0	0.3	23.8
22/02/2024 22:00	14.7	0.65	479650.9	41.1	0	0.3	23.4
22/02/2024 23:00	14.7	0.86	472732.6	34.97	0	0.3	23.6
22/02/2024 24:00	Shutdown	0.36	Shutdown	0.11	Shutdown	Shutdown	Shutdown
Minimum	14.7	0	472732.6	0	0	0.2	23.4
MinDate	02/22/2024 21:00:00	02/22/2024 1:00:00	02/22/2024 23:00:00	02/22/2024 1:00:00	02/22/2024 15:00:00	02/22/2024 14:00:00	02/22/2024 22:00:00
Maximum	14.97	0.89	483177.7	41.1	0.3	0.3	31.6
MaxDate	02/22/2024 14:00:00	02/22/2024 13:00:00	02/22/2024 15:00:00	02/22/2024 22:00:00	02/22/2024 14:00:00	02/22/2024 15:00:00	02/22/2024 14:00:00
Avg	14.79	0.36	478845.7	16.71	0	0.3	25.2
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	3021.3	20.1	0.1	0.1	2.4

Site ABPR51 Daily: 23/02/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
23/02/2024 01:00	14.16	0.28	493171.9	42.83	0	0	28.7
23/02/2024 02:00	14.16	0.28	493289.9	42.82	0	0	28.6
23/02/2024 03:00	14.16	0.31	493320.9	42.85	0	0	28.4
23/02/2024 04:00	14.16	0.28	493410.6	42.86	0	0	28
23/02/2024 05:00	14.16	0.3	494064.7	42.89	0	0	28.3
23/02/2024 06:00	14.16	0.33	494348.8	42.95	0	0	28.3
23/02/2024 07:00	14.16	0.33	493980.4	42.94	0	0	28.3
23/02/2024 08:00	14.16	0.32	493408.8	42.89	0	0	28.4
23/02/2024 09:00	14.17	0.27	494861.9	42.92	0	0	28.7
23/02/2024 10:00	14.22	0.27	496999.6	42.96	0	0	29.7
23/02/2024 11:00	14.25	0.26	499021.7	42.85	0	0	30.6
23/02/2024 12:00	14.28	0.16	501371.8	42.86	0	0	31.5
23/02/2024 13:00	14.26	0.22	491550.3	41.85	0	0	31.2
23/02/2024 14:00	14.25	0.26	469396.8	39.1	0	0	30.9
23/02/2024 15:00	14.26	0.23	489460.8	41.32	0	0	30.3
23/02/2024 16:00	14.25	0.24	491323.3	41.57	0	0	30



23/02/2024 17:00	14.24	0.34	489357.1	41.42	0	0	30
23/02/2024 18:00	14.22	0.35	483203.2	40.98	0	0	29.4
23/02/2024 19:00	14.2	0.38	486354.1	41.44	0	0	29.4
23/02/2024 20:00	14.17	0.34	486747.8	41.59	0	0	28.9
23/02/2024 21:00	14.15	0.33	477712.9	40.81	0	0	28.5
23/02/2024 22:00	14.15	0.32	478546.3	40.84	0	0	28.3
23/02/2024 23:00	14.2	0.33	449612.7	37.02	0	0	32.2
23/02/2024 24:00	14.17	0.25	495100.9	42.73	0	0	28.8
Minimum	14.15	0.16	449612.7	37.02	0	0	28
MinDate	02/23/2024 21:00:00	02/23/2024 12:00:00	02/23/2024 23:00:00	02/23/2024 23:00:00	02/23/2024 1:00:00	02/23/2024 1:00:00	02/23/2024 4:00:00
Maximum	14.28	0.38	501371.8	42.96	0	0	32.2
MaxDate	02/23/2024 12:00:00	02/23/2024 19:00:00	02/23/2024 12:00:00	02/23/2024 10:00:00	02/23/2024 1:00:00	02/23/2024 1:00:00	02/23/2024 23:00:00
Avg	14.2	0.29	488734.1	41.89	0	0	29.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	11013.3	1.4	0	0	1.2
Site ABPR52 Daily: 23/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
23/02/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 03:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 04:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 05:00	Shutdown	0.45	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 06:00	Shutdown	0.59	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 07:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 09:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 10:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 11:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 12:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
23/02/2024 13:00	Shutdown	1.03	Shutdown	1.33	Shutdown	Shutdown	Shutdown
23/02/2024 14:00	14.93	0.8	476384.8	38.52	0.2	0.4	28.4
23/02/2024 15:00	14.92	0.53	490291.8	41.41	0	0.4	25.4
23/02/2024 16:00	14.86	0.48	491418.5	41.67	0	0.4	24.8
23/02/2024 17:00	14.84	0.44	488724.7	41.52	0	0.4	24.8
23/02/2024 18:00	14.8	0.38	482438.6	41.08	0	0.4	24.3
23/02/2024 19:00	14.76	0.45	485230.4	41.5	0	0.4	24.4
23/02/2024 20:00	14.73	0.66	486579.3	41.69	0	0.4	24.2
23/02/2024 21:00	14.71	0.66	477042.6	40.89	0	0.4	24.1
23/02/2024 22:00	14.71	0.66	478106	40.95	0	0.4	24.2
23/02/2024 23:00	14.7	0.93	465870.9	34.49	0	0.4	24.4
23/02/2024 24:00	Shutdown	0.41	Shutdown	0.11	Shutdown	Shutdown	Shutdown
Minimum	14.7	0	465870.9	0	0	0.4	24.1
MinDate	02/23/2024 23:00:00	02/23/2024 1:00:00	02/23/2024 23:00:00	02/23/2024 1:00:00	02/23/2024 15:00:00	02/23/2024 14:00:00	02/23/2024 21:00:00
Maximum	14.93	1.03	491418.5	41.69	0.2	0.4	28.4
MaxDate	02/23/2024 14:00:00	02/23/2024 13:00:00	02/23/2024 16:00:00	02/23/2024 20:00:00	02/23/2024 14:00:00	02/23/2024 14:00:00	02/23/2024 14:00:00
Avg	14.8	0.39	482208.8	16.88	0	0.4	24.9
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	7925.5	20.3	0.1	---	1.3
Site ABPR51 Daily: 24/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
24/02/2024 01:00	14.16	0.23	494002	42.83	0	0	28.9
24/02/2024 02:00	14.16	0.28	493410.6	42.83	0	0	28.6
24/02/2024 03:00	14.15	0.33	493315.4	42.85	0	0	28.5
24/02/2024 04:00	14.16	0.31	493485.3	42.88	0	0	28.3
24/02/2024 05:00	14.16	0.33	493361.8	42.9	0	0	28
24/02/2024 06:00	14.16	0.31	493875.2	42.99	0	0	28
24/02/2024 07:00	14.16	0.32	493554.3	42.9	0	0	27.9
24/02/2024 08:00	14.16	0.29	493077.3	42.87	0	0	28.1
24/02/2024 09:00	14.16	0.23	493896.8	42.84	0	0	28.3
24/02/2024 10:00	14.23	0.16	496213.8	42.81	0	0	30
24/02/2024 11:00	14.27	0.2	498548.9	42.8	0	0	31.1
24/02/2024 12:00	14.3	0.21	500955	42.8	0	0	31.7
24/02/2024 13:00	14.33	0.28	490784.9	41.39	0	0	32.9
24/02/2024 14:00	14.26	0.16	438051	35.67	0	0	31.3
24/02/2024 15:00	14.16	0.17	446210.6	37.19	0	0	28.8
24/02/2024 16:00	14.14	0.25	444571.7	36.95	0	0	28.9
24/02/2024 17:00	14.16	0.14	448384.3	37.36	0	0	29.6
24/02/2024 18:00	14.15	0.27	446172.3	37.25	0	0	29.9
24/02/2024 19:00	14.1	0.35	436172.8	36.22	0	0	30.1
24/02/2024 20:00	14.09	0.32	435134.3	36.22	0	0	29.7
24/02/2024 21:00	14.07	0.35	434174.4	36.16	0	0	29.4
24/02/2024 22:00	14.06	0.36	436074.7	36.44	0	0	29.1
24/02/2024 23:00	14.12	0.34	418882.3	33.75	0	0	31.5
24/02/2024 24:00	14.26	0.23	378952.3	27.75	0	0	29.2
Minimum	14.06	0.14	378952.3	27.75	0	0	27.9
MinDate	02/24/2024 22:00:00	02/24/2024 17:00:00			02/24/2024 1:00:00	02/24/2024 1:00:00	02/24/2024 7:00:00
Maximum	14.33	0.36	500955	42.99	0	0	32.9
MaxDate	02/24/2024 13:00:00	02/24/2024 22:00:00	02/24/2024 12:00:00	02/24/2024 6:00:00	02/24/2024 1:00:00	02/24/2024 1:00:00	02/24/2024 13:00:00
Avg	14.17	0.27	466302.5	39.44	0	0	29.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	33959.4	4.1	0	0	1.4
Site ABPR52 Daily: 24/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
24/02/2024 01:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 02:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 03:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 04:00	Shutdown	0.42	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 05:00	Shutdown	0.58	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 06:00	Shutdown	0.31	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 09:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 11:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 12:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
24/02/2024 13:00	Shutdown	0.94	Shutdown	2.04	Shutdown	Shutdown	Shutdown
24/02/2024 14:00	14.97	0.72	441352	35.17	0	0.5	28.4
24/02/2024 15:00	14.84	0.7	446572.9	37.29	0	0.4	24.9



24/02/2024 16:00	14.78	0.64	443510.6	37.02	0	0.4	25.1
24/02/2024 17:00	14.8	0.51	447175	37.46	0	0.4	25.4
24/02/2024 18:00	14.74	0.4	444901	37.33	0	0.4	25.9
24/02/2024 19:00	14.67	0.32	434386.3	36.3	0	0.4	26.2
24/02/2024 20:00	14.65	0.42	433310.9	36.28	0	0.3	25.9
24/02/2024 21:00	14.63	0.5	432371.2	36.23	0	0.3	25.6
24/02/2024 22:00	14.64	0.54	434711.7	36.52	0	0.3	25.3
24/02/2024 23:00	14.69	0.63	416686.7	33.81	0	0.4	27.5
24/02/2024 24:00	14.81	0.65	374764.2	27.83	0	0.4	23.3
Minimum	14.63	0.01	374764.2	0	0	0.3	23.3
MinDate	02/24/2024 21:00:00	02/24/2024 7:00:00		02/24/2024 1:00:00	02/24/2024 14:00:00	02/24/2024 20:00:00	
Maximum	14.97	0.94	447175	37.46	0	0.5	28.4
MaxDate	02/24/2024 14:00:00	02/24/2024 13:00:00	02/24/2024 17:00:00	02/24/2024 17:00:00	02/24/2024 14:00:00	02/24/2024 14:00:00	02/24/2024 14:00:00
Avg	14.75	0.37	431794.8	16.39	0	0.4	25.8
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.3	20865.8	18.1	0	0.1	1.3
Site ABPR51 Daily: 25/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
25/02/2024 01:00	14.28	0.2	374486.8	26.93	0	0	31.9
25/02/2024 02:00	14.29	0.19	374610.1	26.94	0	0	32.1
25/02/2024 03:00	14.28	0.16	374719.8	27.03	0	0	31.2
25/02/2024 04:00	14.28	0.16	374277.3	26.89	0	0	31.8
25/02/2024 05:00	14.28	0.16	374985.3	27.02	0	0	31.5
25/02/2024 06:00	14.28	0.16	373929.8	26.82	0	0	32.9
25/02/2024 07:00	14.28	0.15	373811.7	26.86	0	0	32.9
25/02/2024 08:00	14.29	0.19	372921	26.73	0	0	33.1
25/02/2024 09:00	14.34	0.1	371910.2	26.48	0	0	33.8
25/02/2024 10:00	14.28	0.07	380227.1	27.93	0	0	30
25/02/2024 11:00	14.28	0.12	383449.3	28.41	0	0	30.6
25/02/2024 12:00	14.3	0.17	383242.6	28.27	0	0	31.2
25/02/2024 13:00	14.39	0.14	377330.3	27.09	0	0	31.4
25/02/2024 14:00	14.33	0.07	382709.1	28.22	0	0	31
25/02/2024 15:00	14.23	0.04	384062.1	28.74	0	0	28.6
25/02/2024 16:00	14.24	0.09	381008.7	28.11	0	0	28.3
25/02/2024 17:00	14.25	0.12	383389.5	28.47	0	0	29.4
25/02/2024 18:00	14.26	0.22	394909	29.96	0	0	33.8
25/02/2024 19:00	14.08	0.29	431919.1	35.94	0	0	29
25/02/2024 20:00	14.04	0.31	426103	35.34	0	0	28.5
25/02/2024 21:00	14.03	0.31	422781.9	35	0	0	28.2
25/02/2024 22:00	Shutdown	0.36	Shutdown	11.46	Shutdown	Shutdown	Shutdown
25/02/2024 23:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
25/02/2024 24:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.03	0.01	371910.2	0	0	0	28.2
MinDate	02/25/2024 21:00:00	02/25/2024 23:00:00	02/25/2024 9:00:00	02/25/2024 23:00:00	02/25/2024 1:00:00	02/25/2024 1:00:00	02/25/2024 21:00:00
Maximum	14.39	0.36	431919.1	35.94	0	0	33.8
MaxDate	02/25/2024 13:00:00	02/25/2024 22:00:00	02/25/2024 19:00:00	02/25/2024 19:00:00	02/25/2024 1:00:00	02/25/2024 1:00:00	02/25/2024 9:00:00
Avg	14.25	0.16	385561.1	25.61	0	0	31
Num	21	24	21	24	21	21	21
Data[%]	88	100	88	100	88	88	88
STD	0.1	0.1	18201.7	9.1	0	0	1.8
Site ABPR52 Daily: 25/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
25/02/2024 01:00	14.84	0.66	369919.8	27	0	0.4	25.5
25/02/2024 02:00	14.85	0.69	370195.9	27	0	0.4	25.6
25/02/2024 03:00	14.87	0.68	370489	27.09	0	0.5	24.6
25/02/2024 04:00	14.88	0.59	369886.1	26.95	0	0.5	25.3
25/02/2024 05:00	14.87	0.56	370591.6	27.09	0	0.5	24.9
25/02/2024 06:00	14.87	0.52	369664.6	26.88	0	0.5	26.4
25/02/2024 07:00	14.88	0.47	369748.1	26.93	0	0.5	26.3
25/02/2024 08:00	14.9	0.54	368826.8	26.8	0	0.5	26.5
25/02/2024 09:00	14.99	0.45	367530.2	26.55	0	0.5	26.6
25/02/2024 10:00	15.01	0.56	376574.1	28	0	0.5	23.4
25/02/2024 11:00	15	0.74	379924.8	28.49	0	0.5	24
25/02/2024 12:00	15.05	0.92	379875.9	28.34	0	0.4	24.5
25/02/2024 13:00	15.14	0.8	373349.3	27.16	0	0.4	23.8
25/02/2024 14:00	15.04	0.45	378992.9	28.3	0	0.4	24.1
25/02/2024 15:00	14.87	0.33	380471.5	28.82	0	0.4	22.4
25/02/2024 16:00	14.88	0.53	376999	28.17	0	0.4	21.5
25/02/2024 17:00	14.89	0.43	379159.6	28.54	0	0.4	22.8
25/02/2024 18:00	14.83	0.38	390937	29.98	0	0.4	28
25/02/2024 19:00	14.63	0.41	429467	36.01	0	0.4	24.2
25/02/2024 20:00	14.59	0.48	423485.4	35.42	0	0.4	23.6
25/02/2024 21:00	14.58	0.54	420250.1	35.07	0	0.4	23.3
25/02/2024 22:00	14.72	0.74	442614.6	36.68	0	0.4	26.7
25/02/2024 23:00	14.72	0.71	490675.9	42.75	0	0.4	22.6
25/02/2024 24:00	14.72	0.71	490991.2	42.79	0	0.4	23
Minimum	14.58	0.33	367530.2	26.55	0	0.4	21.5
MinDate	02/25/2024 21:00:00	02/25/2024 15:00:00	02/25/2024 9:00:00	02/25/2024 9:00:00	02/25/2024 1:00:00	02/25/2024 1:00:00	02/25/2024 16:00:00
Maximum	15.14	0.92	490991.2	42.79	0	0.5	28
MaxDate	02/25/2024 13:00:00	02/25/2024 12:00:00			02/25/2024 1:00:00	02/25/2024 3:00:00	02/25/2024 18:00:00
Avg	14.86	0.58	393359.2	30.28	0	0.4	24.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	36902.5	5	0	0	1.6
Site ABPR51 Daily: 26/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
26/02/2024 01:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 02:00	Shutdown	1.48	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 03:00	Shutdown	2.2	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 04:00	Shutdown	2.35	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 05:00	Shutdown	2.2	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 06:00	Shutdown	1.1	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/02/2024 13:00	Shutdown	0.37	Shutdown	2.99	Shutdown	Shutdown	Shutdown
26/02/2024 14:00	14.29	0.42	445904	35.59	0	0	30



26/02/2024 15:00	14.25	0.15	453823.9	37.43	0	0	28.3
26/02/2024 16:00	14.17	0.07	448960.4	37.31	0	0	27.4
26/02/2024 17:00	14.14	0.24	448485.8	37.3	0	0	27.6
26/02/2024 18:00	14.06	0.34	444156	37.27	0	0	27.6
26/02/2024 19:00	14.04	0.32	443723.3	37.13	0	0	27.1
26/02/2024 20:00	14.05	0.35	444189.4	37.2	0	0	27.2
26/02/2024 21:00	14.07	0.31	441521.2	36.94	0	0	28.4
26/02/2024 22:00	14.07	0.26	439680.5	36.7	0	0	28.6
26/02/2024 23:00	14.14	0.23	425092.3	34.49	0	0	31.5
26/02/2024 24:00	14.17	0.32	495526.2	42.75	0	0	28.2
Minimum	14.04	0.01	425092.3	0	0	0	27.1
MinDate	02/26/2024 19:00:00	02/26/2024 7:00:00	02/26/2024 23:00:00	02/26/2024 1:00:00	02/26/2024 14:00:00	02/26/2024 14:00:00	02/26/2024 19:00:00
Maximum	14.29	2.35	495526.2	42.75	0	0	31.5
MaxDate	02/26/2024 14:00:00	02/26/2024 4:00:00			02/26/2024 14:00:00	02/26/2024 14:00:00	02/26/2024 23:00:00
Avg	14.13	0.54	448278.5	17.21	0	0	28.4
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0.1	0.7	17264.7	18.9	0	0	1.3
Site ABPR52 Daily: 26/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
26/02/2024 01:00	14.71	0.68	490992.9	42.79	0	0.5	23.1
26/02/2024 02:00	14.72	0.72	490314.8	42.74	0	0.5	22.9
26/02/2024 03:00	14.71	0.62	490471.2	42.74	0	0.5	22.8
26/02/2024 04:00	14.74	0.56	489971.1	42.74	0	0.5	22.9
26/02/2024 05:00	14.77	0.54	490182.3	42.73	0	0.4	23.2
26/02/2024 06:00	14.78	0.51	490872.5	42.86	0	0.5	23
26/02/2024 07:00	14.73	0.36	490262.6	42.77	0	0.5	22.9
26/02/2024 08:00	14.77	0.3	489733.6	42.7	0	0.5	22.6
26/02/2024 09:00	14.86	0.64	490733.9	42.68	0	0.5	22.8
26/02/2024 10:00	14.91	0.78	491923.9	42.64	0	0.5	23.2
26/02/2024 11:00	14.95	0.82	492834.9	42.62	0	0.5	24.2
26/02/2024 12:00	14.99	0.88	495322.1	42.52	0	0.5	25.9
26/02/2024 13:00	15.01	0.85	480194.1	40.43	0	0.5	27
26/02/2024 14:00	14.98	0.81	431070.6	35.02	0	0.5	26
26/02/2024 15:00	14.91	0.45	447931.3	37.51	0	0.5	24
26/02/2024 16:00	14.84	0.26	445163.7	37.4	0	0.4	22.7
26/02/2024 17:00	14.79	0.42	444666.4	37.38	0	0.4	22.9
26/02/2024 18:00	14.62	0.34	441049.3	37.35	0	0.4	22.6
26/02/2024 19:00	14.63	0.54	440505	37.21	0	0.4	22.2
26/02/2024 20:00	14.64	0.59	440578.6	37.31	0	0.4	22.1
26/02/2024 21:00	14.63	0.58	438553.2	37.02	0	0.4	23.1
26/02/2024 22:00	14.61	0.67	436399	36.8	0	0.4	23.6
26/02/2024 23:00	14.61	0.89	433445.1	30.65	0	0.4	23.8
26/02/2024 24:00	Shutdown	0.35	Shutdown	0.04	Shutdown	Shutdown	Shutdown
Minimum	14.61	0.26	431070.6	0.04	0	0.4	22.1
MinDate	02/26/2024 22:00:00	02/26/2024 16:00:00	02/26/2024 14:00:00		02/26/2024 1:00:00	02/26/2024 5:00:00	02/26/2024 20:00:00
Maximum	15.01	0.89	495322.1	42.86	0	0.5	27
MaxDate	02/26/2024 13:00:00	02/26/2024 23:00:00	02/26/2024 12:00:00	02/26/2024 6:00:00	02/26/2024 1:00:00	02/26/2024 1:00:00	02/26/2024 13:00:00
Avg	14.78	0.59	468398.8	38.19	0	0.5	23.5
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.2	25867.4	8.8	0	0	1.2
Site ABPR51 Daily: 27/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
27/02/2024 01:00	14.16	0.29	494342.1	42.83	0	0	28.4
27/02/2024 02:00	14.16	0.37	494091.9	42.83	0	0	28.2
27/02/2024 03:00	14.16	0.29	494052.3	42.85	0	0	28.1
27/02/2024 04:00	14.16	0.32	493742.2	42.86	0	0	27.8
27/02/2024 05:00	14.16	0.33	494439.6	42.88	0	0	27.7
27/02/2024 06:00	14.16	0.17	494998.5	42.98	0	0	27.8
27/02/2024 07:00	14.16	0.23	494377.5	42.91	0	0	27.7
27/02/2024 08:00	14.16	0.29	494070.3	42.89	0	0	28
27/02/2024 09:00	14.16	0.4	494448.7	42.87	0	0	28.1
27/02/2024 10:00	14.22	0.68	496571	42.83	0	0	28.9
27/02/2024 11:00	14.28	0.35	498729.1	42.78	0	0	30.6
27/02/2024 12:00	14.32	0.41	502185.3	42.81	0	0	31.9
27/02/2024 13:00	14.31	0.46	506989.3	43.48	0	0	37.5
27/02/2024 14:00	14.25	0.4	484460.2	41.2	0	0	40.7
27/02/2024 15:00	14.09	0.15	518453.4	45.85	0	0	41.6
27/02/2024 16:00	14.07	0.22	480680	41.36	0	0	37.1
27/02/2024 17:00	14.12	0.16	401424.5	31.7	0	0	31.3
27/02/2024 18:00	14.13	0.21	400056.5	31.45	0	0	31.9
27/02/2024 19:00	14.14	0.3	456910.9	38.39	0	0	28.4
27/02/2024 20:00	14.1	0.34	453102.2	38.16	0	0	28.7
27/02/2024 21:00	14.11	0.36	456938	38.62	0	0	28.7
27/02/2024 22:00	14.11	0.34	460628.9	39.06	0	0	28.4
27/02/2024 23:00	14.19	0.38	436645.3	35.42	0	0	32.2
27/02/2024 24:00	14.16	0.33	492009.8	42.57	0	0	30.6
Minimum	14.07	0.15	400056.5	31.45	0	0	27.7
MinDate	02/27/2024 16:00:00	02/27/2024 15:00:00	02/27/2024 18:00:00	02/27/2024 18:00:00	02/27/2024 1:00:00	02/27/2024 1:00:00	02/27/2024 5:00:00
Maximum	14.32	0.68	518453.4	45.85	0	0	41.6
MaxDate	02/27/2024 12:00:00	02/27/2024 10:00:00	02/27/2024 15:00:00	02/27/2024 15:00:00	02/27/2024 1:00:00	02/27/2024 1:00:00	02/27/2024 15:00:00
Avg	14.17	0.32	478931.1	40.9	0	0	30.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30863.2	3.7	0	0	4.2
Site ABPR52 Daily: 27/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
27/02/2024 01:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 02:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 03:00	Shutdown	0.87	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 04:00	Shutdown	1.83	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 05:00	Shutdown	1.82	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 06:00	Shutdown	1.31	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 07:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 09:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 10:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 11:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 12:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
27/02/2024 13:00	Shutdown	0.83	Shutdown	2.27	Shutdown	Shutdown	Shutdown



27/02/2024 14:00	15	0.77	416110.2	32.71	0.1	0.5	29.9
27/02/2024 15:00	14.9	0.33	410730.7	32.94	0	0.4	25.7
27/02/2024 16:00	14.81	0.52	453763.5	38.38	0	0.4	28.2
27/02/2024 17:00	14.67	0.59	528104.3	47.5	0	0.4	37.4
27/02/2024 18:00	14.65	0.62	530852.8	47.72	0	0.4	37.7
27/02/2024 19:00	14.73	0.51	470762.3	40.28	0	0.4	25
27/02/2024 20:00	14.71	0.46	451357.1	38.25	0	0.4	23.3
27/02/2024 21:00	14.68	0.46	455869.2	38.71	0	0.4	23.2
27/02/2024 22:00	14.67	0.51	460524.6	39.13	0	0.4	23
27/02/2024 23:00	14.66	0.75	452556.1	33.17	0	0.4	23
27/02/2024 24:00	Shutdown	0.35	Shutdown	0.13	Shutdown	Shutdown	Shutdown
Minimum	14.65	0.02	410730.7	0	0	0.4	23
MinDate	02/27/2024 18:00:00	02/27/2024 8:00:00	02/27/2024 15:00:00	02/27/2024 1:00:00	02/27/2024 15:00:00	02/27/2024 15:00:00	02/27/2024 22:00:00
Maximum	15	1.83	530852.8	47.72	0.1	0.5	37.7
MaxDate	02/27/2024 14:00:00	02/27/2024 4:00:00	02/27/2024 18:00:00	02/27/2024 18:00:00	02/27/2024 14:00:00	02/27/2024 14:00:00	02/27/2024 18:00:00
Avg	14.75	0.55	463063.1	16.3	0	0.4	27.6
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.5	39750.4	19.8	0	0	5.7
Site ABPR51 Daily: 28/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
28/02/2024 01:00	14.16	0.27	494230.3	42.82	0	0	28.6
28/02/2024 02:00	14.16	0.31	494125.2	42.85	0	0	28.4
28/02/2024 03:00	14.16	0.29	493718.3	42.86	0	0	28.2
28/02/2024 04:00	14.16	0.29	493864.1	42.86	0	0	28.4
28/02/2024 05:00	14.16	0.32	493993.8	42.86	0	0	28.3
28/02/2024 06:00	14.15	0.25	495166.9	42.95	0	0	28.5
28/02/2024 07:00	14.16	0.24	494223.4	42.87	0	0	28.7
28/02/2024 08:00	14.16	0.26	494892.7	42.9	0	0	28.6
28/02/2024 09:00	14.21	0.2	495881.5	42.89	0	0	28.9
28/02/2024 10:00	14.23	0.15	497930.5	42.88	0	0	29.6
28/02/2024 11:00	14.3	0.23	501474	42.88	0	0	30.9
28/02/2024 12:00	14.35	0.29	504161.4	42.86	0	0	32.4
28/02/2024 13:00	14.34	0.32	485357.9	40.38	0	0	32.8
28/02/2024 14:00	14.19	0.22	455206.1	37.9	0	0	29.9
28/02/2024 15:00	14.16	0.37	470307.8	39.74	0	0	27.9
28/02/2024 16:00	14.21	0.27	473761.2	39.92	0	0	27.9
28/02/2024 17:00	14.2	0.31	472659.3	39.8	0	0	28.6
28/02/2024 18:00	14.17	0.35	463897	39.06	0	0	28.8
28/02/2024 19:00	14.14	0.38	465721	39.41	0	0	28
28/02/2024 20:00	14.13	0.4	464635.4	39.38	0	0	28.2
28/02/2024 21:00	14.1	0.41	461727.3	39.17	0	0	28
28/02/2024 22:00	14.11	0.4	463669	39.36	0	0	27.8
28/02/2024 23:00	14.17	0.36	438765.8	35.63	0	0	31.9
28/02/2024 24:00	14.16	0.31	491998	42.51	0	0	29.7
Minimum	14.1	0.15	438765.8	35.63	0	0	27.8
MinDate	02/28/2024 21:00:00	02/28/2024 10:00:00	02/28/2024 23:00:00	02/28/2024 23:00:00	02/28/2024 1:00:00	02/28/2024 1:00:00	02/28/2024 22:00:00
Maximum	14.35	0.41	504161.4	42.95	0	0	32.8
MaxDate	02/28/2024 12:00:00	02/28/2024 21:00:00	02/28/2024 12:00:00	02/28/2024 6:00:00	02/28/2024 1:00:00	02/28/2024 1:00:00	02/28/2024 13:00:00
Avg	14.19	0.3	481723.7	41.11	0	0	29.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	17636.3	2.1	0	0	1.5
Site ABPR52 Daily: 28/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
28/02/2024 01:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 02:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 03:00	Shutdown	0.24	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 04:00	Shutdown	0.61	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 05:00	Shutdown	0.89	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 06:00	Shutdown	0.47	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 07:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 08:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 09:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 10:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 11:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 12:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
28/02/2024 13:00	Shutdown	0.79	Shutdown	3.37	Shutdown	Shutdown	Shutdown
28/02/2024 14:00	14.79	0.18	462121.3	38.08	0	0.5	23.5
28/02/2024 15:00	14.76	0.76	472194.5	39.84	0	0.4	22.9
28/02/2024 16:00	14.85	0.66	473591.9	40.02	0	0.4	22.7
28/02/2024 17:00	14.85	0.58	471683.3	39.88	0	0.4	23.2
28/02/2024 18:00	14.76	0.51	462601.7	39.11	0	0.4	23.3
28/02/2024 19:00	14.7	0.44	465359.4	39.48	0	0.4	22.7
28/02/2024 20:00	14.67	0.35	464194.1	39.48	0	0.4	22.7
28/02/2024 21:00	14.65	0.34	461954.1	39.26	0	0.4	22.6
28/02/2024 22:00	14.66	0.52	463408.4	39.44	0	0.4	22.4
28/02/2024 23:00	14.66	0.69	455744.9	33.67	0	0.4	22.5
28/02/2024 24:00	Shutdown	0.38	Shutdown	0.13	Shutdown	Shutdown	Shutdown
Minimum	14.65	0.03	455744.9	0	0	0.4	22.4
MinDate	02/28/2024 21:00:00	02/28/2024 1:00:00	02/28/2024 23:00:00	02/28/2024 1:00:00	02/28/2024 14:00:00	02/28/2024 15:00:00	02/28/2024 22:00:00
Maximum	14.85	0.89	473591.9	40.02	0	0.5	23.5
MaxDate	02/28/2024 16:00:00	02/28/2024 5:00:00	02/28/2024 16:00:00	02/28/2024 16:00:00	02/28/2024 14:00:00	02/28/2024 14:00:00	02/28/2024 14:00:00
Avg	14.74	0.37	465285.3	16.32	0	0.4	22.9
Num	10	24	10	24	10	10	10
Data[%]	42	100	42	100	42	42	42
STD	0.1	0.3	5595.6	19.5	0	0	0.4
Site ABPR51 Daily: 29/02/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
29/02/2024 01:00	14.16	0.27	494476.3	42.87	0	0	28.2
29/02/2024 02:00	14.16	0.28	494223.7	42.88	0	0	28.3
29/02/2024 03:00	14.16	0.31	494369.5	42.89	0	0	28
29/02/2024 04:00	14.16	0.31	494682.5	42.92	0	0	27.9
29/02/2024 05:00	14.16	0.28	494868	42.94	0	0	28
29/02/2024 06:00	14.16	0.28	495656.2	43.04	0	0	28.2
29/02/2024 07:00	14.16	0.18	494360.3	42.95	0	0	28.8
29/02/2024 08:00	14.19	0.31	493321.7	42.89	0	0	29.8
29/02/2024 09:00	14.22	0.25	494690.3	42.86	0	0	29.8
29/02/2024 10:00	14.22	0.19	495714.1	42.88	0	0	29.2
29/02/2024 11:00	14.22	0.2	497972.1	42.88	0	0	29.6
29/02/2024 12:00	14.26	0.2	499890.4	42.91	0	0	30.2



29/02/2024 13:00	14.25	0.14	485175.2	41.04	0	0	30.4
29/02/2024 14:00	14.18	0.22	447069.4	37.09	0	0	30.5
29/02/2024 15:00	14.1	0.43	458890.6	38.88	0	0	27.6
29/02/2024 16:00	14.15	0.33	461310.4	38.81	0	0	28.4
29/02/2024 17:00	14.16	0.34	460802.1	38.78	0	0	28
29/02/2024 18:00	14.16	0.26	457624	38.49	0	0	28.8
29/02/2024 19:00	14.15	0.32	457331.6	38.55	0	0	29
29/02/2024 20:00	14.14	0.3	457055.8	38.57	0	0	29
29/02/2024 21:00	14.11	0.36	454526.9	38.32	0	0	29.1
29/02/2024 22:00	14.12	0.34	460174.3	38.97	0	0	28.6
29/02/2024 23:00	14.11	0.33	457432.5	38.67	0	0	28.8
29/02/2024 24:00	14.1	0.37	454113.6	38.4	0	0	28.8
Minimum	14.1	0.14	447069.4	37.09	0	0	27.6
MinDate	02/29/2024 15:00:00	02/29/2024 13:00:00	02/29/2024 14:00:00	02/29/2024 14:00:00	02/29/2024 1:00:00	02/29/2024 1:00:00	02/29/2024 15:00:00
Maximum	14.26	0.43	499890.4	43.04	0	0	30.5
MaxDate	02/29/2024 12:00:00	02/29/2024 15:00:00	02/29/2024 12:00:00	02/29/2024 6:00:00	02/29/2024 1:00:00	02/29/2024 1:00:00	02/29/2024 14:00:00
Avg	14.17	0.28	477322.2	40.81	0	0	28.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	19481.7	2.2	0	0	0.8
Site ABPR52 Daily: 29/02/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
29/02/2024 01:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 02:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 03:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 04:00	Shutdown	0.63	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 05:00	Shutdown	0.85	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 06:00	Shutdown	0.62	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 08:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 09:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 10:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 11:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 12:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
29/02/2024 13:00	Shutdown	0.62	Shutdown	2.66	Shutdown	Shutdown	Shutdown
29/02/2024 14:00	14.77	0.28	452807.2	37.09	0	0.5	24.8
29/02/2024 15:00	14.66	0.68	461137	38.96	0	0.5	22.8
29/02/2024 16:00	14.74	0.62	461595.2	38.92	0	0.5	23.2
29/02/2024 17:00	14.74	0.58	460725.3	38.89	0	0.5	23.2
29/02/2024 18:00	14.72	0.62	456932.8	38.56	0	0.5	23.5
29/02/2024 19:00	14.7	0.55	456286.9	38.62	0	0.5	23.6
29/02/2024 20:00	14.68	0.58	456541.3	38.68	0	0.5	23.6
29/02/2024 21:00	14.67	0.67	453306	38.39	0	0.5	23.5
29/02/2024 22:00	14.69	0.64	459388.6	39.07	0	0.5	23.2
29/02/2024 23:00	14.68	0.56	456390.9	38.76	0	0.5	23.4
29/02/2024 24:00	14.68	0.54	453116.4	38.49	0	0.5	23.4
Minimum	14.66	0.01	452807.2	0	0	0.5	22.8
MinDate	02/29/2024 15:00:00	02/29/2024 7:00:00	02/29/2024 14:00:00	02/29/2024 1:00:00	02/29/2024 14:00:00	02/29/2024 14:00:00	02/29/2024 15:00:00
Maximum	14.77	0.85	461595.2	39.07	0	0.5	24.8
MaxDate	02/29/2024 14:00:00	02/29/2024 5:00:00	02/29/2024 16:00:00	02/29/2024 22:00:00	02/29/2024 14:00:00	02/29/2024 14:00:00	02/29/2024 14:00:00
Avg	14.7	0.41	457111.6	17.8	0	0.5	23.5
Num	11	24	11	24	11	11	11
Data[%]	46	100	46	100	46	46	46
STD	0	0.3	3241.5	19.5	0	0	0.5



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 01/03/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
01/03/2024 01:00	14.21	0.32	448888.5	36.9	0	0	33.6
01/03/2024 02:00	14.16	0.31	493775.4	42.82	0	0	28.6
01/03/2024 03:00	14.16	0.32	494024.6	42.89	0	0	28.7
01/03/2024 04:00	14.17	0.34	494281.3	42.88	0	0	28.7
01/03/2024 05:00	14.16	0.29	494748.3	42.9	0	0	28.5
01/03/2024 06:00	14.16	0.27	495817.5	43.02	0	0	28.5
01/03/2024 07:00	14.16	0.23	494623.2	42.9	0	0	28.6
01/03/2024 08:00	14.18	0.25	494134.8	42.88	0	0	28.7
01/03/2024 09:00	14.17	0.21	448411.9	37.27	0	0	29.6
01/03/2024 10:00	14.12	0.27	452099.1	38.03	0	0	29
01/03/2024 11:00	14.17	0.28	453769	38.04	0	0	29.7
01/03/2024 12:00	14.2	0.23	454551.5	37.85	0	0	29.9
01/03/2024 13:00	14.52	0.15	363609.6	24.36	0	0	46.7
01/03/2024 14:00	14.23	0.21	461356.4	38.52	0	0	29.2
01/03/2024 15:00	14.17	0.18	458626.7	38.46	0	0	28.6
01/03/2024 16:00	14.14	0.26	453917.6	38.12	0	0	28.6
01/03/2024 17:00	14.14	0.28	453267.7	38	0	0	28.6
01/03/2024 18:00	14.16	0.33	452800.2	37.88	0	0	29.7
01/03/2024 19:00	14.14	0.36	451386.5	37.8	0	0	29.2
01/03/2024 20:00	14.12	0.4	455508.7	38.4	0	0	28.7
01/03/2024 21:00	14.11	0.3	456582.4	38.53	0	0	28.4
01/03/2024 22:00	14.1	0.29	459142.1	38.81	0	0	28.2
01/03/2024 23:00	14.11	0.33	459881.5	38.97	0	0	27.9
01/03/2024 24:00	14.1	0.33	461156.5	39.09	0	0	27.8
Minimum	14.1	0.15	363609.6	24.36	0	0	27.8
MinDate	03/01/2024 22:00:00	03/01/2024 13:00:00	03/01/2024 13:00:00	03/01/2024 13:00:00	03/01/2024 1:00:00	03/01/2024 1:00:00	
Maximum	14.52	0.4	495817.5	43.02	0	0	46.7
MaxDate	03/01/2024 13:00:00	03/01/2024 20:00:00	03/01/2024 6:00:00	03/01/2024 6:00:00	03/01/2024 1:00:00	03/01/2024 1:00:00	03/01/2024 13:00:00
Avg	14.17	0.28	462765	38.97	0	0	29.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	28030.7	3.8	0	0	3.8
Site ABPR52 Daily: 01/03/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
01/03/2024 01:00	Shutdown	0.8	Shutdown	12.91	Shutdown	Shutdown	Shutdown
01/03/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
01/03/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
01/03/2024 04:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
01/03/2024 05:00	Shutdown	0.35	Shutdown	0	Shutdown	Shutdown	Shutdown
01/03/2024 06:00	Shutdown	0.45	Shutdown	0	Shutdown	Shutdown	Shutdown
01/03/2024 07:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
01/03/2024 08:00	Shutdown	0.91	Shutdown	0	Shutdown	Shutdown	Shutdown
01/03/2024 09:00	Shutdown	1.13	Shutdown	17.88	Shutdown	Shutdown	Shutdown
01/03/2024 10:00	14.83	0.85	455365	38.14	0	0.6	23.7
01/03/2024 11:00	14.87	0.93	453752.7	38.12	0	0.6	24.6
01/03/2024 12:00	14.91	0.8	452935.5	37.9	0	0.6	24.5
01/03/2024 13:00	15.2	0.8	359348.6	24.45	0	0.6	40.5
01/03/2024 14:00	14.97	0.73	459904.5	38.55	0	0.6	23.4
01/03/2024 15:00	14.87	0.42	457591.3	38.55	0	0.5	22.8
01/03/2024 16:00	14.77	0.65	452864.2	38.19	0	0.5	22.9
01/03/2024 17:00	14.77	0.72	452086.4	38.09	0	0.5	22.9
01/03/2024 18:00	14.75	0.63	451143.6	37.96	0	0.5	24
01/03/2024 19:00	14.71	0.55	449974.2	37.91	0	0.5	23.6
01/03/2024 20:00	14.67	0.59	454293.7	38.46	0	0.5	23.1
01/03/2024 21:00	14.65	0.59	455203.5	38.6	0	0.5	22.9
01/03/2024 22:00	14.66	0.52	458451.6	38.92	0	0.5	22.7
01/03/2024 23:00	14.66	0.53	459004.8	39.02	0	0.5	22.5
01/03/2024 24:00	14.66	0.54	460329.5	39.19	0	0.5	22.4
Minimum	14.65	0	359348.6	0	0	0.5	22.4
MinDate	03/01/2024 21:00:00	03/01/2024 2:00:00	03/01/2024 13:00:00	03/01/2024 2:00:00	03/01/2024 10:00:00	03/01/2024 15:00:00	
Maximum	15.2	1.13	460329.5	39.19	0	0.6	40.5
MaxDate	03/01/2024 13:00:00	03/01/2024 9:00:00			03/01/2024 10:00:00	03/01/2024 10:00:00	03/01/2024 13:00:00
Avg	14.8	0.57	448816.6	24.7	0	0.5	24.4
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.2	0.3	24960.9	17.6	0	0	4.5
Site ABPR51 Daily: 02/03/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
02/03/2024 01:00	14.2	0.3	457514.9	37.4	0	0	32.5
02/03/2024 02:00	14.16	0.3	494008	42.79	0	0	28.3
02/03/2024 03:00	14.16	0.32	493856.4	42.84	0	0	28.4
02/03/2024 04:00	14.16	0.31	493986.2	42.83	0	0	28.3
02/03/2024 05:00	14.16	0.32	493994.7	42.85	0	0	28.3
02/03/2024 06:00	14.16	0.27	494298.8	42.89	0	0	28.3
02/03/2024 07:00	14.16	0.28	493760.7	42.87	0	0	28.6
02/03/2024 08:00	14.16	0.29	493769.1	42.83	0	0	28.4
02/03/2024 09:00	14.16	0.26	445852.7	36.96	0	0	30.2
02/03/2024 10:00	14.11	0.27	449707.4	37.83	0	0	28.7
02/03/2024 11:00	14.15	0.28	452602	37.95	0	0	29.1
02/03/2024 12:00	14.18	0.24	457868.1	38.28	0	0	29.1
02/03/2024 13:00	14.5	0.1	364279.6	24.39	0	0	45.2
02/03/2024 14:00	14.15	0.13	454430.3	38.12	0	0	27.8
02/03/2024 15:00	14.18	0.17	451100.1	37.57	0	0	29.2
02/03/2024 16:00	14.15	0.12	452817.2	37.97	0	0	29
02/03/2024 17:00	14.12	0.37	449135.3	37.78	0	0	30
02/03/2024 18:00	14.16	0.34	450866.2	37.68	0	0	29.9
02/03/2024 19:00	14.15	0.41	455141.2	38.23	0	0	29.1
02/03/2024 20:00	14.12	0.5	454355.8	38.28	0	0	28.6
02/03/2024 21:00	14.09	0.51	445838.2	37.43	0	0	28.6
02/03/2024 22:00	14.09	0.45	449618.8	37.85	0	0	28.1
02/03/2024 23:00	14.08	0.41	446809.4	37.56	0	0	28.1
02/03/2024 24:00	14.08	0.4	448787.5	37.78	0	0	27.8
Minimum	14.08	0.1	364279.6	24.39	0	0	27.8
MinDate	03/02/2024 23:00:00	03/02/2024 13:00:00	03/02/2024 13:00:00	03/02/2024 13:00:00	03/02/2024 1:00:00	03/02/2024 1:00:00	03/02/2024 14:00:00
Maximum	14.5	0.51	494298.8	42.89	0	0	45.2
MaxDate	03/02/2024 13:00:00	03/02/2024 21:00:00	03/02/2024 6:00:00	03/02/2024 6:00:00	03/02/2024 1:00:00	03/02/2024 1:00:00	03/02/2024 13:00:00
Avg	14.16	0.31	460183.3	38.71	0	0	29.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	28460.8	3.8	0	0	3.5



Site ABPR52 Daily: 02/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
02/03/2024 01:00	Shutdown	0.84	Shutdown	14.07	Shutdown	Shutdown	Shutdown
02/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/03/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
02/03/2024 04:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
02/03/2024 05:00	Shutdown	0.85	Shutdown	0	Shutdown	Shutdown	Shutdown
02/03/2024 06:00	Shutdown	0.88	Shutdown	0	Shutdown	Shutdown	Shutdown
02/03/2024 07:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
02/03/2024 08:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
02/03/2024 09:00	Shutdown	1.13	Shutdown	18.39	Shutdown	Shutdown	Shutdown
02/03/2024 10:00	14.8	0.77	452617.3	37.93	0	0.6	23.4
02/03/2024 11:00	14.83	0.85	452587.1	38.02	0	0.6	24.1
02/03/2024 12:00	14.87	0.67	457161.5	38.32	0	0.6	23.7
02/03/2024 13:00	15.17	0.65	360212.7	24.43	0	0.7	38.8
02/03/2024 14:00	14.84	0.55	454092.2	38.25	0	0.6	22.5
02/03/2024 15:00	14.87	0.5	449556.8	37.66	0	0.6	23.4
02/03/2024 16:00	14.8	0.45	450991.4	38.06	0	0.5	23.3
02/03/2024 17:00	14.65	0.64	448351.8	37.89	0	0.5	24.3
02/03/2024 18:00	14.76	0.7	448446.6	37.76	0	0.5	24
02/03/2024 19:00	14.71	0.55	453127.2	38.3	0	0.5	23.4
02/03/2024 20:00	14.67	0.6	452928.7	38.38	0	0.5	23.1
02/03/2024 21:00	14.64	0.62	443284.6	37.51	0	0.5	23.1
02/03/2024 22:00	14.64	0.66	447280.8	37.9	0	0.5	22.7
02/03/2024 23:00	14.64	0.63	444692.9	37.64	0	0.6	22.7
02/03/2024 24:00	14.64	0.55	446422.3	37.85	0	0.6	22.7
Minimum	14.64	0.01	360212.7	0	0	0.5	22.5
MinDate	03/02/2024 21:00:00	03/02/2024 2:00:00	03/02/2024 13:00:00	03/02/2024 2:00:00	03/02/2024 10:00:00	03/02/2024 16:00:00	03/02/2024 14:00:00
Maximum	15.17	1.13	457161.5	38.38	0	0.7	38.8
MaxDate	03/02/2024 13:00:00	03/02/2024 9:00:00	03/02/2024 12:00:00	03/02/2024 20:00:00	03/02/2024 10:00:00	03/02/2024 13:00:00	03/02/2024 13:00:00
Avg	14.77	0.57	444116.9	24.52	0	0.6	24.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	23516.3	17.3	0	0.1	4

Site ABPR51 Daily: 03/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
03/03/2024 01:00	Shutdown	0.44	Shutdown	13.13	Shutdown	Shutdown	Shutdown
03/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 04:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 05:00	Shutdown	0.58	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 10:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 11:00	Shutdown	0.4	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 12:00	Shutdown	0.41	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 13:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 14:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
03/03/2024 18:00	Shutdown	0.37	Shutdown	4.25	Shutdown	Shutdown	Shutdown
03/03/2024 19:00	14.17	0.38	418757.4	33.08	0	0	30.2
03/03/2024 20:00	14.1	0.35	430642.6	35.44	0	0	28.1
03/03/2024 21:00	14.08	0.32	432221.2	35.72	0	0	27.9
03/03/2024 22:00	14.07	0.31	432874	35.86	0	0	27.9
03/03/2024 23:00	14.06	0.32	433436.9	35.91	0	0	27.8
03/03/2024 24:00	14.23	0.38	466410.6	38.73	0	0	31.1
Minimum	14.06	0.01	418757.4	0	0	0	27.8
MinDate	03/03/2024 23:00:00	03/03/2024 2:00:00	03/03/2024 19:00:00	03/03/2024 2:00:00	03/03/2024 19:00:00	03/03/2024 19:00:00	03/03/2024 23:00:00
Maximum	14.23	0.58	466410.6	38.73	0	0	31.1
MaxDate		03/03/2024 5:00:00			03/03/2024 19:00:00	03/03/2024 19:00:00	
Avg	14.12	0.2	435723.8	9.67	0	0	28.8
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0.1	0.2	16005.7	15.7	0	0	1.4

Site ABPR52 Daily: 03/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
03/03/2024 01:00	14.74	0.52	455661.9	37.58	0	0.6	26.9
03/03/2024 02:00	14.73	0.57	490837.5	42.79	0	0.6	22.3
03/03/2024 03:00	14.74	0.56	490916.9	42.84	0	0.6	22.3
03/03/2024 04:00	14.76	0.66	490963.6	42.82	0	0.6	22.4
03/03/2024 05:00	14.78	0.59	491477.3	42.85	0	0.6	22.4
03/03/2024 06:00	14.79	0.63	491005.8	42.8	0	0.7	22.4
03/03/2024 07:00	14.77	0.59	490392.2	42.76	0	0.6	22.3
03/03/2024 08:00	14.78	0.84	490649	42.77	0	0.7	22
03/03/2024 09:00	14.87	0.79	491754.4	42.75	0	0.7	22.4
03/03/2024 10:00	14.96	0.82	492816.3	42.7	0	0.7	22.9
03/03/2024 11:00	15.04	0.89	494802.1	42.67	0	0.7	23.6
03/03/2024 12:00	15.05	0.77	496336.2	42.7	0	0.6	24.4
03/03/2024 13:00	15.02	0.45	496931.3	42.71	0	0.6	24.3
03/03/2024 14:00	14.88	0.22	493540.3	42.78	0	0.6	22.7
03/03/2024 15:00	14.83	0.48	494588.4	42.86	0	0.6	23.2
03/03/2024 16:00	14.88	0.68	495708.8	42.73	0	0.6	23.8
03/03/2024 17:00	14.89	0.66	496593.8	42.78	0	0.6	23.7
03/03/2024 18:00	14.82	0.6	468399.3	39.59	0	0.6	23.2
03/03/2024 19:00	14.73	0.58	410989.7	33.17	0	0.5	23.8
03/03/2024 20:00	14.61	0.6	425709.6	35.52	0	0.5	23.6
03/03/2024 21:00	14.59	0.58	427439	35.79	0	0.6	23.2
03/03/2024 22:00	14.59	0.5	428559.4	35.94	0	0.5	23
03/03/2024 23:00	14.59	0.48	429441.2	36	0	0.6	22.8
03/03/2024 24:00	Shutdown	0.7	Shutdown	3.03	Shutdown	Shutdown	Shutdown
Minimum	14.59	0.22	410989.7	3.03	0	0.5	22
MinDate	03/03/2024 21:00:00	03/03/2024 14:00:00	03/03/2024 19:00:00		03/03/2024 1:00:00	03/03/2024 19:00:00	03/03/2024 8:00:00
Maximum	15.05	0.89	496931.3	42.86	0	0.7	26.9
MaxDate	03/03/2024 12:00:00	03/03/2024 11:00:00	03/03/2024 13:00:00	03/03/2024 15:00:00	03/03/2024 1:00:00	03/03/2024 6:00:00	03/03/2024 1:00:00
Avg	14.8	0.61	475457.2	39.21	0	0.6	23.2
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	29194.4	8.3	0	0.1	1.1



Site ABPR51 Daily: 04/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
04/03/2024 01:00	14.17	0.41	495761.3	42.84	0	0	28
04/03/2024 02:00	14.17	0.4	495785.4	42.8	0	0	28
04/03/2024 03:00	14.16	0.42	495820.6	42.87	0	0	27.7
04/03/2024 04:00	14.16	0.44	495976.3	42.91	0	0	27.5
04/03/2024 05:00	14.16	0.39	495793	42.91	0	0	27.8
04/03/2024 06:00	14.16	0.35	496569.5	42.98	0	0	27.9
04/03/2024 07:00	14.16	0.4	495724.9	42.87	0	0	27.9
04/03/2024 08:00	14.16	0.39	495354	42.86	0	0	27.6
04/03/2024 09:00	14.18	0.3	439724.4	35.91	0	0	29.3
04/03/2024 10:00	14.09	0.36	440131.8	36.66	0	0	28.7
04/03/2024 11:00	14.1	0.36	437843	36.33	0	0	28.9
04/03/2024 12:00	14.14	0.36	437018.4	36.12	0	0	29.1
04/03/2024 13:00	14.58	0.28	352126.8	22.52	0	0	50.6
04/03/2024 14:00	14.18	0.3	443550.9	36.64	0	0	29.8
04/03/2024 15:00	14.15	0.31	439254.7	36.3	0	0	29.1
04/03/2024 16:00	14.12	0.27	436577.5	36.08	0	0	29.2
04/03/2024 17:00	14.12	0.27	439617.5	36.37	0	0	29.1
04/03/2024 18:00	14.11	0.22	440563.8	36.53	0	0	29.1
04/03/2024 19:00	14.09	0.22	436756.4	36.29	0	0	28.8
04/03/2024 20:00	14.08	0.26	436838.8	36.38	0	0	28.6
04/03/2024 21:00	14.04	0.28	434239.6	36.19	0	0	28
04/03/2024 22:00	14.05	0.34	436317.4	36.38	0	0	28.2
04/03/2024 23:00	14.05	0.33	437159.4	36.47	0	0	28.2
04/03/2024 24:00	14.06	0.35	438983.8	36.66	0	0	28.2
Minimum	14.04	0.22	352126.8	22.52	0	0	27.5
MinDate	03/04/2024 21:00:00	03/04/2024 18:00:00	03/04/2024 13:00:00	03/04/2024 13:00:00	03/04/2024 1:00:00	03/04/2024 1:00:00	03/04/2024 4:00:00
Maximum	14.58	0.44	496569.5	42.98	0	0	50.6
MaxDate	03/04/2024 13:00:00	03/04/2024 4:00:00	03/04/2024 6:00:00	03/04/2024 6:00:00	03/04/2024 1:00:00	03/04/2024 1:00:00	03/04/2024 13:00:00
Avg	14.14	0.33	453895.4	37.95	0	0	29.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	34987.7	4.5	0	0	4.6

Site ABPR52 Daily: 04/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
04/03/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 03:00	Shutdown	0.7	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 04:00	Shutdown	1.79	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 05:00	Shutdown	2.1	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 06:00	Shutdown	1.21	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 07:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 08:00	Shutdown	0.22	Shutdown	0	Shutdown	Shutdown	Shutdown
04/03/2024 09:00	Shutdown	1.05	Shutdown	17.91	Shutdown	Shutdown	Shutdown
04/03/2024 10:00	14.8	0.66	441197.6	36.74	0	0.7	23.4
04/03/2024 11:00	14.81	0.73	436100.6	36.42	0	0.6	24
04/03/2024 12:00	14.85	0.77	434881.8	36.18	0	0.6	23.9
04/03/2024 13:00	15.26	0.71	346370	22.54	0	0.7	47.2
04/03/2024 14:00	14.87	0.5	441555.9	36.72	0	0.6	24.1
04/03/2024 15:00	14.8	0.45	436662.4	36.38	0	0.6	23.3
04/03/2024 16:00	14.71	0.52	434470.2	36.15	0	0.6	23.4
04/03/2024 17:00	14.7	0.59	436722.1	36.44	0	0.5	23.3
04/03/2024 18:00	14.7	0.62	437901.1	36.61	0	0.5	23.2
04/03/2024 19:00	14.65	0.6	434237.4	36.36	0	0.5	22.9
04/03/2024 20:00	14.64	0.62	434524.8	36.47	0	0.5	22.7
04/03/2024 21:00	14.61	0.6	431883	36.25	0	0.5	22.4
04/03/2024 22:00	14.63	0.62	434200.7	36.46	0	0.5	22.4
04/03/2024 23:00	14.64	0.67	435109.4	36.56	0	0.6	22.2
04/03/2024 24:00	14.64	0.6	436849.4	36.74	0	0.6	22.2
Minimum	14.61	0	346370	0	0	0.5	22.2
MinDate	03/04/2024 21:00:00	03/04/2024 1:00:00	03/04/2024 13:00:00	03/04/2024 1:00:00	03/04/2024 10:00:00	03/04/2024 17:00:00	03/04/2024 23:00:00
Maximum	15.26	2.1	441555.9	36.74	0	0.7	47.2
MaxDate	03/04/2024 13:00:00	03/04/2024 5:00:00	03/04/2024 14:00:00	03/04/2024 10:00:00	03/04/2024 10:00:00	03/04/2024 10:00:00	03/04/2024 13:00:00
Avg	14.75	0.68	430177.8	22.96	0	0.6	24.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.2	0.5	23326.9	17.2	0	0.1	6.3

Site ABPR51 Daily: 05/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
05/03/2024 01:00	14.19	0.41	453323.5	37.39	0	0	31
05/03/2024 02:00	14.17	0.43	495906.1	42.82	0	0	28.1
05/03/2024 03:00	14.17	0.41	495598.8	42.85	0	0	28.4
05/03/2024 04:00	14.18	0.38	495671.3	42.86	0	0	28.5
05/03/2024 05:00	14.16	0.38	495680	42.88	0	0	28.3
05/03/2024 06:00	14.17	0.33	495917	42.94	0	0	28.3
05/03/2024 07:00	14.18	0.37	495439.4	42.86	0	0	28.5
05/03/2024 08:00	14.17	0.35	496299.8	42.91	0	0	28.4
05/03/2024 09:00	14.2	0.27	445625.5	36.63	0	0	29.4
05/03/2024 10:00	14.1	0.3	442282.7	36.88	0	0	28.9
05/03/2024 11:00	14.12	0.35	441218.8	36.68	0	0	29.1
05/03/2024 12:00	14.14	0.32	441170.8	36.57	0	0	29.1
05/03/2024 13:00	14.53	0.25	356503.1	23.17	0	0	47.1
05/03/2024 14:00	14.19	0.27	454453.3	37.81	0	0	29
05/03/2024 15:00	14.21	0.28	454986.6	37.82	0	0	29.2
05/03/2024 16:00	14.22	0.34	460704	38.41	0	0	28.7
05/03/2024 17:00	14.19	0.34	459168.2	38.34	0	0	28.6
05/03/2024 18:00	14.16	0.28	454028.5	37.93	0	0	28.6
05/03/2024 19:00	14.13	0.25	456413.9	38.38	0	0	27.9
05/03/2024 20:00	14.14	0.28	465979.1	39.37	0	0	27.3
05/03/2024 21:00	14.1	0.28	456922.5	38.49	0	0	27.6
05/03/2024 22:00	14.13	0.38	468851.1	39.72	0	0	26.9
05/03/2024 23:00	14.13	0.4	471349.8	40.01	0	0	26.8
05/03/2024 24:00	14.13	0.45	472830.8	40.14	0	0	26.8
Minimum	14.1	0.25	356503.1	23.17	0	0	26.8
MinDate	03/05/2024 10:00:00	03/05/2024 13:00:00	03/05/2024 13:00:00	03/05/2024 13:00:00	03/05/2024 1:00:00	03/05/2024 1:00:00	03/05/2024 23:00:00
Maximum	14.53	0.45	496299.8	42.94	0	0	47.1
MaxDate	03/05/2024 13:00:00		03/05/2024 8:00:00	03/05/2024 6:00:00	03/05/2024 1:00:00	03/05/2024 1:00:00	03/05/2024 13:00:00
Avg	14.18	0.34	463596.8	38.91	0	0	29.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30333.8	4.1	0	0	3.9



Site ABPR52 Daily: 05/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
05/03/2024 01:00	Shutdown	0.8	Shutdown	12.23	Shutdown	Shutdown	Shutdown
05/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/03/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/03/2024 04:00	Shutdown	0.28	Shutdown	0	Shutdown	Shutdown	Shutdown
05/03/2024 05:00	Shutdown	1.04	Shutdown	0	Shutdown	Shutdown	Shutdown
05/03/2024 06:00	Shutdown	0.77	Shutdown	0	Shutdown	Shutdown	Shutdown
05/03/2024 07:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
05/03/2024 08:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
05/03/2024 09:00	Shutdown	1	Shutdown	17.37	Shutdown	Shutdown	Shutdown
05/03/2024 10:00	14.78	0.66	444233.8	36.97	0	0.6	23.3
05/03/2024 11:00	14.8	0.75	440154.7	36.74	0	0.6	23.8
05/03/2024 12:00	14.84	0.85	439397.8	36.67	0	0.6	23.5
05/03/2024 13:00	15.19	0.76	351374.8	23.22	0	0.7	41.3
05/03/2024 14:00	14.87	0.57	452824	37.87	0	0.6	22.8
05/03/2024 15:00	14.88	0.6	452888.4	37.86	0	0.6	22.9
05/03/2024 16:00	14.89	0.51	458728.5	38.48	0	0.6	22.4
05/03/2024 17:00	14.82	0.5	456828.7	38.43	0	0.6	22.4
05/03/2024 18:00	14.76	0.55	452179.4	38.02	0	0.6	22.5
05/03/2024 19:00	14.71	0.62	454784.4	38.48	0	0.6	22.1
05/03/2024 20:00	14.69	0.65	464151.8	39.46	0	0.6	21.7
05/03/2024 21:00	14.66	0.64	454999.3	38.58	0	0.6	21.7
05/03/2024 22:00	14.69	0.69	467304.1	39.82	0	0.6	21.3
05/03/2024 23:00	14.7	0.69	469245.2	40.08	0	0.6	21.2
05/03/2024 24:00	14.71	0.72	470786.1	40.21	0	0.6	21.1
Minimum	14.66	0.01	351374.8	0	0	0.6	21.1
MinDate	03/05/2024 21:00:00	03/05/2024 2:00:00	03/05/2024 13:00:00	03/05/2024 2:00:00	03/05/2024 10:00:00	03/05/2024 10:00:00	
Maximum	15.19	1.04	470786.1	40.21	0	0.7	41.3
MaxDate	03/05/2024 13:00:00	03/05/2024 5:00:00			03/05/2024 10:00:00	03/05/2024 13:00:00	03/05/2024 13:00:00
Avg	14.8	0.57	448658.7	24.6	0	0.6	23.6
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	28581.2	17.6	0	0	5

Site ABPR51 Daily: 06/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
06/03/2024 01:00	14.21	0.4	454161	37.32	0	0	31.9
06/03/2024 02:00	14.17	0.39	496103.6	42.86	0	0	27.9
06/03/2024 03:00	14.16	0.37	496140.1	42.91	0	0	27.8
06/03/2024 04:00	14.16	0.32	495976.6	42.92	0	0	27.6
06/03/2024 05:00	14.16	0.43	495637.6	42.94	0	0	27.6
06/03/2024 06:00	14.16	0.41	496903	43.01	0	0	27.6
06/03/2024 07:00	14.16	0.45	495514.3	42.92	0	0	27.7
06/03/2024 08:00	14.16	0.53	495766.2	42.94	0	0	27.5
06/03/2024 09:00	14.17	0.32	465334.3	38.96	0	0	28.3
06/03/2024 10:00	14.16	0.28	462801.1	39.06	0	0	27.8
06/03/2024 11:00	14.18	0.3	460108.9	38.52	0	0	28.4
06/03/2024 12:00	14.22	0.34	463363.8	38.68	0	0	28.8
06/03/2024 13:00	14.44	0.14	367828.5	25.41	0	0	37.3
06/03/2024 14:00	14.28	0.15	478330.2	39.86	0	0	28.7
06/03/2024 15:00	14.28	0.27	475998.4	39.56	0	0	28.8
06/03/2024 16:00	14.29	0.3	479824.3	39.91	0	0	29
06/03/2024 17:00	14.25	0.28	475706.2	39.73	0	0	28.2
06/03/2024 18:00	14.22	0.24	474094.9	39.8	0	0	28
06/03/2024 19:00	14.17	0.26	471157.9	39.74	0	0	27.6
06/03/2024 20:00	14.14	0.31	471224.5	39.86	0	0	27.2
06/03/2024 21:00	14.15	0.32	470082.4	39.84	0	0	26.9
06/03/2024 22:00	14.14	0.44	471776.3	40.03	0	0	27
06/03/2024 23:00	14.15	0.41	479085.1	40.78	0	0	27
06/03/2024 24:00	14.15	0.4	483480.8	41.24	0	0	26.7
Minimum	14.14	0.14	367828.5	25.41	0	0	26.7
MinDate	03/06/2024 20:00:00	03/06/2024 13:00:00	03/06/2024 13:00:00	03/06/2024 13:00:00	03/06/2024 1:00:00	03/06/2024 1:00:00	
Maximum	14.44	0.53	496903	43.01	0	0	37.3
MaxDate	03/06/2024 13:00:00	03/06/2024 8:00:00	03/06/2024 6:00:00	03/06/2024 6:00:00	03/06/2024 1:00:00	03/06/2024 1:00:00	03/06/2024 13:00:00
Avg	14.2	0.34	474016.7	39.95	0	0	28.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	26188.8	3.5	0	0	2.2

Site ABPR52 Daily: 06/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
06/03/2024 01:00	Shutdown	0.93	Shutdown	13.36	Shutdown	Shutdown	Shutdown
06/03/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/03/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
06/03/2024 04:00	Shutdown	0.24	Shutdown	0	Shutdown	Shutdown	Shutdown
06/03/2024 05:00	Shutdown	0.96	Shutdown	0	Shutdown	Shutdown	Shutdown
06/03/2024 06:00	Shutdown	0.36	Shutdown	0	Shutdown	Shutdown	Shutdown
06/03/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/03/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
06/03/2024 09:00	Shutdown	0.95	Shutdown	19.74	Shutdown	Shutdown	Shutdown
06/03/2024 10:00	14.88	0.71	465941.1	39.11	0	0.7	22
06/03/2024 11:00	14.85	0.75	460129.1	38.61	0	0.7	23.1
06/03/2024 12:00	14.9	0.86	461739.5	38.76	0	0.7	23.2
06/03/2024 13:00	15.11	0.67	363396.3	25.46	0	0.8	29.5
06/03/2024 14:00	14.95	0.69	475300.2	39.92	0	0.7	23
06/03/2024 15:00	14.94	0.55	472488.3	39.65	0	0.7	22.9
06/03/2024 16:00	14.92	0.47	475841.3	40.02	0	0.7	23.1
06/03/2024 17:00	14.85	0.45	472548.2	39.82	0	0.7	22.4
06/03/2024 18:00	14.8	0.52	472017.8	39.88	0	0.6	22.3
06/03/2024 19:00	14.73	0.57	469389.9	39.83	0	0.6	22
06/03/2024 20:00	14.7	0.66	469112.8	39.95	0	0.6	21.7
06/03/2024 21:00	14.7	0.65	468718	39.94	0	0.6	21.4
06/03/2024 22:00	14.71	0.74	469811.7	40.11	0	0.6	21.5
06/03/2024 23:00	14.73	0.69	477795.5	40.89	0	0.6	21.3
06/03/2024 24:00	14.71	0.63	482392.2	41.33	0	0.7	21
Minimum	14.7	0	363396.3	0	0	0.6	21
MinDate	03/06/2024 20:00:00	03/06/2024 2:00:00	03/06/2024 13:00:00	03/06/2024 2:00:00	03/06/2024 10:00:00	03/06/2024 18:00:00	
Maximum	15.11	0.96	482392.2	41.33	0	0.8	29.5
MaxDate	03/06/2024 13:00:00	03/06/2024 5:00:00			03/06/2024 10:00:00	03/06/2024 13:00:00	03/06/2024 13:00:00
Avg	14.83	0.55	463774.8	25.68	0	0.7	22.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	28362.5	18.2	0	0.1	2



Site ABPR51 Daily: 07/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
07/03/2024 01:00	14.18	0.41	461063.8	38.36	0	0	30.2
07/03/2024 02:00	14.16	0.42	495317	42.86	0	0	27.4
07/03/2024 03:00	14.16	0.41	495523.3	42.89	0	0	27.5
07/03/2024 04:00	14.16	0.31	495811.6	42.9	0	0	27.6
07/03/2024 05:00	14.16	0.34	495790.1	42.91	0	0	27.5
07/03/2024 06:00	14.16	0.41	496507.2	43.03	0	0	27.8
07/03/2024 07:00	14.16	0.43	495619.1	42.94	0	0	27.6
07/03/2024 08:00	14.16	0.4	496246.8	43.01	0	0	27.5
07/03/2024 09:00	14.2	0.21	455318.7	37.58	0	0	30.7
07/03/2024 10:00	14.2	0.31	484753.3	41.19	0	0	27.3
07/03/2024 11:00	14.26	0.42	489476.3	41.23	0	0	29.1
07/03/2024 12:00	14.3	0.41	487146.7	40.8	0	0	30.3
07/03/2024 13:00	14.42	0.15	374723.6	26.55	0	0	33.9
07/03/2024 14:00	14.34	0.26	491649.8	40.98	0	0	30.9
07/03/2024 15:00	14.35	0.25	489779.6	40.65	0	0	30.6
07/03/2024 16:00	14.34	0.25	498255.4	41.53	0	0	31
07/03/2024 17:00	14.33	0.33	498878.5	41.79	0	0	30.9
07/03/2024 18:00	14.29	0.44	498481.5	41.97	0	0	30.2
07/03/2024 19:00	14.22	0.51	490403.3	41.62	0	0	28.6
07/03/2024 20:00	14.18	0.47	487404.6	41.52	0	0	27.8
07/03/2024 21:00	14.16	0.44	485904.1	41.37	0	0	27.4
07/03/2024 22:00	14.16	0.5	486050.9	41.45	0	0	26.8
07/03/2024 23:00	14.15	0.44	483177	41.2	0	0	26.6
07/03/2024 24:00	14.16	0.37	493404.5	42.2	0	0	26.9
Minimum	14.15	0.15	374723.6	26.55	0	0	26.6
MinDate	03/07/2024 23:00:00	03/07/2024 13:00:00	03/07/2024 13:00:00	03/07/2024 13:00:00	03/07/2024 1:00:00	03/07/2024 1:00:00	03/07/2024 23:00:00
Maximum	14.42	0.51	498878.5	43.03	0	0	33.9
MaxDate	03/07/2024 13:00:00	03/07/2024 19:00:00	03/07/2024 17:00:00	03/07/2024 6:00:00	03/07/2024 1:00:00	03/07/2024 1:00:00	03/07/2024 13:00:00
Avg	14.22	0.37	484445.3	40.94	0	0	28.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	25692.7	3.4	0	0	1.9

Site ABPR52 Daily: 07/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
07/03/2024 01:00	Shutdown	0.95	Shutdown	13.89	Shutdown	Shutdown	Shutdown
07/03/2024 02:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
07/03/2024 03:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
07/03/2024 04:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
07/03/2024 05:00	Shutdown	0.85	Shutdown	0	Shutdown	Shutdown	Shutdown
07/03/2024 06:00	Shutdown	0.32	Shutdown	0	Shutdown	Shutdown	Shutdown
07/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/03/2024 08:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
07/03/2024 09:00	<Samp	0.79	<Samp	22.01	<Samp	<Samp	<Samp
07/03/2024 10:00	14.86	0.56	488088.8	41.28	0	0.7	21.9
07/03/2024 11:00	14.93	0.69	488339.3	41.3	0	0.7	23.5
07/03/2024 12:00	14.99	0.81	485267.6	40.85	0	0.7	24.2
07/03/2024 13:00	15.14	0.67	370459.5	26.62	0	0.7	25.9
07/03/2024 14:00	15.03	0.82	488534.3	41.09	0	0.7	24.8
07/03/2024 15:00	15	0.71	485918.9	40.75	0	0.7	24.6
07/03/2024 16:00	14.94	0.53	494441.4	41.6	0	0.7	24.8
07/03/2024 17:00	14.89	0.49	495604.9	41.89	0	0.7	24.8
07/03/2024 18:00	14.86	0.4	495881.8	42.09	0	0.6	24.3
07/03/2024 19:00	14.79	0.4	489327.2	41.72	0	0.6	22.9
07/03/2024 20:00	14.75	0.46	486745.9	41.63	0	0.6	22.1
07/03/2024 21:00	14.72	0.66	484954.3	41.46	0	0.6	21.7
07/03/2024 22:00	14.72	0.63	484592.7	41.56	0	0.6	21.2
07/03/2024 23:00	14.72	0.73	482008.1	41.3	0	0.6	21
07/03/2024 24:00	14.73	0.72	492090.8	42.31	0	0.6	21.3
Minimum	14.72	0.01	370459.5	0	0	0.6	21
MinDate	03/07/2024 21:00:00	03/07/2024 7:00:00	03/07/2024 13:00:00	03/07/2024 2:00:00	03/07/2024 10:00:00	03/07/2024 18:00:00	03/07/2024 23:00:00
Maximum	15.14	0.95	495881.8	42.31	0	0.7	25.9
MaxDate	03/07/2024 13:00:00	03/07/2024 1:00:00	03/07/2024 18:00:00	03/07/2024 10:00:00	03/07/2024 10:00:00	03/07/2024 10:00:00	03/07/2024 13:00:00
Avg	14.87	0.53	480817.1	26.81	0	0.7	23.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	30812.9	18.9	0	0.1	1.6

Site ABPR51 Daily: 08/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
08/03/2024 01:00	14.21	0.31	467273.9	37.86	0	0	30.5
08/03/2024 02:00	14.16	0.3	496412.2	42.87	0	0	26.9
08/03/2024 03:00	14.16	0.36	496157.4	42.91	0	0	27.2
08/03/2024 04:00	14.16	0.36	496309.6	42.9	0	0	27.3
08/03/2024 05:00	14.16	0.31	495937	42.91	0	0	27.3
08/03/2024 06:00	14.18	0.31	497295.5	42.95	0	0	27.5
08/03/2024 07:00	14.17	0.46	496396.9	42.94	0	0	27.2
08/03/2024 08:00	14.17	0.33	495771.7	42.9	0	0	27.1
08/03/2024 09:00	14.21	0.17	458593.3	37.91	0	0	30.9
08/03/2024 10:00	14.26	0.29	500336.9	42.46	0	0	29
08/03/2024 11:00	14.28	0.35	498942.9	42.11	0	0	29.7
08/03/2024 12:00	<Samp	0.36	<Samp	42.29	<Samp	<Samp	<Samp
08/03/2024 13:00	14.32	0.1	383777.2	28.34	0	0	32.1
08/03/2024 14:00	14.32	0.23	502375.7	42.35	0	0	31.4
08/03/2024 15:00	14.33	0.27	504705.6	42.41	0	0	30.9
08/03/2024 16:00	14.31	0.31	501502.2	42.19	0	0	31
08/03/2024 17:00	14.28	0.33	501675.5	42.44	0	0	30
08/03/2024 18:00	14.22	0.38	489893.3	41.57	0	0	28.4
08/03/2024 19:00	14.22	0.37	490232.5	41.63	0	0	28.3
08/03/2024 20:00	14.18	0.5	485479.6	41.38	0	0	27.4
08/03/2024 21:00	14.18	0.45	491877.3	41.99	0	0	27.4
08/03/2024 22:00	14.16	0.43	485083.4	41.42	0	0	26.9
08/03/2024 23:00	14.19	0.44	494725.6	42.34	0	0	27.4
08/03/2024 24:00	14.19	0.47	494931.1	42.33	0	0	27.4
Minimum	14.16	0.1	383777.2	28.34	0	0	26.9
MinDate	03/08/2024 2:00:00	03/08/2024 13:00:00	03/08/2024 13:00:00	03/08/2024 13:00:00	03/08/2024 1:00:00	03/08/2024 1:00:00	03/08/2024 2:00:00
Maximum	14.33	0.5	504705.6	42.95	0	0	32.1
MaxDate	03/08/2024 15:00:00	03/08/2024 20:00:00	03/08/2024 15:00:00	03/08/2024 6:00:00	03/08/2024 1:00:00	03/08/2024 1:00:00	03/08/2024 13:00:00
Avg	14.22	0.34	488073.3	41.39	0	0	28.7
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	25137.2	3.1	0	0	1.7



Site ABPR52 Daily: 08/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
08/03/2024 01:00	Shutdown	0.96	Shutdown	14.99	Shutdown	Shutdown	Shutdown
08/03/2024 02:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
08/03/2024 03:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
08/03/2024 04:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
08/03/2024 05:00	Shutdown	0.7	Shutdown	0	Shutdown	Shutdown	Shutdown
08/03/2024 06:00	Shutdown	0.96	Shutdown	0	Shutdown	Shutdown	Shutdown
08/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/03/2024 08:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
08/03/2024 09:00	<Samp	0.75	<Samp	22.27	<Samp	<Samp	<Samp
08/03/2024 10:00	14.89	0.53	502977.8	42.51	0	0.8	23.8
08/03/2024 11:00	14.92	0.58	497263.8	42.2	0	0.7	24.5
08/03/2024 12:00	<Samp	0.61	<Samp	42.37	<Samp	<Samp	<Samp
08/03/2024 13:00	14.98	0.61	380307.6	28.43	0	0.7	25.2
08/03/2024 14:00	14.95	0.67	500650.2	42.47	0	0.7	25.8
08/03/2024 15:00	14.93	0.7	501918.4	42.48	0	0.7	25.1
08/03/2024 16:00	14.9	0.67	498523.4	42.26	0	0.7	25.2
08/03/2024 17:00	14.85	0.63	498268.4	42.43	0	0.7	24.2
08/03/2024 18:00	14.79	0.6	488228.7	41.66	0	0.7	22.7
08/03/2024 19:00	14.78	0.54	488343.2	41.74	0	0.7	22.7
08/03/2024 20:00	14.75	0.4	484466.5	41.46	0	0.6	21.9
08/03/2024 21:00	14.76	0.47	490448.4	42.1	0	0.6	21.9
08/03/2024 22:00	14.75	0.46	484357.9	41.52	0	0.7	21.4
08/03/2024 23:00	14.77	0.47	493768.1	42.44	0	0.7	21.9
08/03/2024 24:00	14.77	0.53	493646.9	42.43	0	0.7	22
Minimum	14.75	0.01	380307.6	0	0	0.6	21.4
MinDate	03/08/2024 20:00:00	03/08/2024 7:00:00	03/08/2024 13:00:00	03/08/2024 2:00:00	03/08/2024 10:00:00	03/08/2024 20:00:00	03/08/2024 22:00:00
Maximum	14.98	0.96	502977.8	42.51	0	0.8	25.8
MaxDate	03/08/2024 13:00:00	03/08/2024 1:00:00	03/08/2024 10:00:00	03/08/2024 10:00:00	03/08/2024 10:00:00	03/08/2024 10:00:00	03/08/2024 14:00:00
Avg	14.84	0.51	485940.7	27.32	0	0.7	23.5
Num	14	24	14	24	14	14	14
Data[%]	58	100	58	100	58	58	58
STD	0.1	0.3	31027.3	19.2	0	0	1.5

Site ABPR51 Daily: 09/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
09/03/2024 01:00	14.23	0.4	463589.8	38.44	0	0	30.3
09/03/2024 02:00	14.19	0.33	495904.4	42.79	0	0	27.5
09/03/2024 03:00	14.2	0.31	495626.3	42.82	0	0	27.6
09/03/2024 04:00	14.21	0.33	495897.8	42.83	0	0	27.8
09/03/2024 05:00	14.2	0.37	495587.6	42.88	0	0	27.7
09/03/2024 06:00	14.21	0.34	496591.6	42.94	0	0	27.8
09/03/2024 07:00	14.2	0.38	495831.2	42.91	0	0	27.8
09/03/2024 08:00	14.21	0.38	495779.5	42.86	0	0	27.7
09/03/2024 09:00	14.18	0.35	453577.8	37.76	0	0	28.5
09/03/2024 10:00	14.15	0.41	475485.5	40.53	0	0	26.2
09/03/2024 11:00	14.2	0.4	479760.5	40.66	0	0	28
09/03/2024 12:00	14.21	0.38	474375.3	39.93	0	0	28.1
09/03/2024 13:00	14.41	0.27	372903.9	25.84	0	0	38.7
09/03/2024 14:00	14.21	0.38	476680.1	40.23	0	0	27
09/03/2024 15:00	14.2	0.35	475066	40.11	0	0	27.2
09/03/2024 16:00	14.21	0.3	475449.2	40.14	0	0	27.3
09/03/2024 17:00	14.21	0.33	480323.8	40.65	0	0	27.2
09/03/2024 18:00	14.2	0.34	481207.4	40.84	0	0	27
09/03/2024 19:00	14.17	0.45	481133.2	40.87	0	0	26.6
09/03/2024 20:00	14.16	0.46	481504.5	41.04	0	0	26.5
09/03/2024 21:00	14.15	0.39	481257.8	41.06	0	0	26.3
09/03/2024 22:00	14.15	0.44	481224.5	41.08	0	0	26.5
09/03/2024 23:00	14.16	0.45	481643	41.1	0	0	26.5
09/03/2024 24:00	14.16	0.42	478756.9	40.75	0	0	26.9
Minimum	14.15	0.27	372903.9	25.84	0	0	26.2
MinDate	03/09/2024 10:00:00	03/09/2024 13:00:00	03/09/2024 13:00:00	03/09/2024 13:00:00	03/09/2024 1:00:00	03/09/2024 1:00:00	03/09/2024 10:00:00
Maximum	14.41	0.46	496591.6	42.94	0	0	38.7
MaxDate	03/09/2024 13:00:00	03/09/2024 20:00:00	03/09/2024 6:00:00	03/09/2024 6:00:00	03/09/2024 1:00:00	03/09/2024 1:00:00	03/09/2024 13:00:00
Avg	14.2	0.37	477714.9	40.46	0	0	27.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24847.1	3.4	0	0	2.5

Site ABPR52 Daily: 09/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
09/03/2024 01:00	Shutdown	0.87	Shutdown	14.41	Shutdown	Shutdown	Shutdown
09/03/2024 02:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
09/03/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
09/03/2024 04:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
09/03/2024 05:00	Shutdown	0.85	Shutdown	0	Shutdown	Shutdown	Shutdown
09/03/2024 06:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
09/03/2024 07:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
09/03/2024 08:00	Shutdown	0.38	Shutdown	0	Shutdown	Shutdown	Shutdown
09/03/2024 09:00	Shutdown	1.24	Shutdown	19.63	Shutdown	Shutdown	Shutdown
09/03/2024 10:00	14.82	0.66	478505.1	40.63	0	0.7	21.3
09/03/2024 11:00	14.86	0.6	479827.8	40.74	0	0.7	23.1
09/03/2024 12:00	14.86	0.63	474717.4	40.15	0	0.8	23.1
09/03/2024 13:00	15.03	0.51	367697.1	25.89	0	0.8	31.7
09/03/2024 14:00	14.85	0.65	474403.6	40.25	0	0.7	21.5
09/03/2024 15:00	14.8	0.62	473647.5	40.2	0	0.7	21.9
09/03/2024 16:00	14.81	0.66	473968.4	40.27	0	0.7	21.9
09/03/2024 17:00	14.79	0.69	478623.9	40.74	0	0.8	21.8
09/03/2024 18:00	14.78	0.67	479869.2	40.93	0	0.7	21.4
09/03/2024 19:00	14.75	0.66	479022.8	40.96	0	0.7	21.1
09/03/2024 20:00	14.75	0.66	480136.5	41.11	0	0.7	21.2
09/03/2024 21:00	14.74	0.6	479425	41.11	0	0.7	20.9
09/03/2024 22:00	14.74	0.6	480723.8	41.18	0	0.8	21
09/03/2024 23:00	14.75	0.56	480313.3	41.21	0	0.7	21.1
09/03/2024 24:00	14.76	0.47	477058.8	40.84	0	0.7	21.4
Minimum	14.74	0.02	367697.1	0	0	0.7	20.9
MinDate	03/09/2024 21:00:00	03/09/2024 2:00:00	03/09/2024 13:00:00	03/09/2024 2:00:00	03/09/2024 10:00:00	03/09/2024 10:00:00	03/09/2024 21:00:00
Maximum	15.03	1.24	480723.8	41.21	0	0.8	31.7
MaxDate	03/09/2024 13:00:00	03/09/2024 9:00:00	03/09/2024 22:00:00	03/09/2024 23:00:00	03/09/2024 10:00:00	03/09/2024 12:00:00	03/09/2024 13:00:00
Avg	14.81	0.54	470529.4	26.26	0	0.7	22.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	28556.4	18.6	0	0	2.7



Site ABPR51 Daily: 10/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
10/03/2024 01:00	14.13	0.38	416308.6	33.36	0	0	29.6
10/03/2024 02:00	14.05	0.35	410375.3	33.28	0	0	29.2
10/03/2024 03:00	14.07	0.36	408062.6	32.92	0	0	30
10/03/2024 04:00	14.12	0.26	401058.7	31.71	0	0	30.8
10/03/2024 05:00	14.17	0.29	391618.5	30.13	0	0	30.6
10/03/2024 06:00	14.21	0.46	388038.8	29.48	0	0	30
10/03/2024 07:00	14.18	0.38	390399.5	29.97	0	0	30.4
10/03/2024 08:00	14.21	0.24	386854.7	29.22	0	0	29.7
10/03/2024 09:00	14.21	0.28	388604.4	29.56	0	0	30.1
10/03/2024 10:00	14.21	0.17	391870.8	30.03	0	0	30.9
10/03/2024 11:00	14.22	0.2	392521.3	30.13	0	0	31.4
10/03/2024 12:00	14.22	0.22	392600.8	30.11	0	0	31.4
10/03/2024 13:00	14.27	0.2	387894.7	29.17	0	0	30.5
10/03/2024 14:00	14.22	0.05	390428.5	29.75	0	0	30
10/03/2024 15:00	14.22	0.12	391097.5	29.85	0	0	30.5
10/03/2024 16:00	14.24	0.11	389425.7	29.5	0	0	30.6
10/03/2024 17:00	14.23	0.16	391549.4	29.91	0	0	31.2
10/03/2024 18:00	14.19	0.25	394876.8	30.52	0	0	31.1
10/03/2024 19:00	14.2	0.36	429166.9	34.69	0	0	30.3
10/03/2024 20:00	14.11	0.43	449519.4	37.79	0	0	27.8
10/03/2024 21:00	14.09	0.35	447027.3	37.58	0	0	27.6
10/03/2024 22:00	14.09	0.3	444782.2	37.38	0	0	27.7
10/03/2024 23:00	14.09	0.32	443627.8	37.23	0	0	27.8
10/03/2024 24:00	Shutdown	0.31	Shutdown	3.56	Shutdown	Shutdown	Shutdown
Minimum	14.05	0.05	386854.7	3.56	0	0	27.6
MinDate	03/10/2024 2:00:00	03/10/2024 14:00:00	03/10/2024 8:00:00		03/10/2024 1:00:00	03/10/2024 1:00:00	03/10/2024 21:00:00
Maximum	14.27	0.46	449519.4	37.79	0	0	31.4
MaxDate	03/10/2024 13:00:00	03/10/2024 6:00:00	03/10/2024 20:00:00	03/10/2024 20:00:00	03/10/2024 1:00:00	03/10/2024 1:00:00	03/10/2024 11:00:00
Avg	14.17	0.27	405117.9	30.7	0	0	30
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	21921.5	6.5	0	0	1.2

Site ABPR52 Daily: 10/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
10/03/2024 01:00	14.74	0.5	413655.2	33.39	0	0.7	23.9
10/03/2024 02:00	14.67	0.49	407177.3	33.36	0	0.7	23.8
10/03/2024 03:00	14.68	0.53	405154	33.01	0	0.7	24.9
10/03/2024 04:00	14.71	0.55	397910.3	31.79	0	0.9	25
10/03/2024 05:00	14.76	0.62	388210.4	30.2	0	0.8	24.3
10/03/2024 06:00	14.81	0.74	384228.3	29.55	0	0.8	23.2
10/03/2024 07:00	14.8	0.65	387577.1	30.04	0	0.8	23.9
10/03/2024 08:00	14.8	0.56	383083.6	29.28	0	0.8	22.7
10/03/2024 09:00	14.81	0.69	385242.2	29.64	0	0.8	23.3
10/03/2024 10:00	14.83	0.68	388461.7	30.11	0	0.8	24.5
10/03/2024 11:00	14.87	0.69	389278.1	30.2	0	0.7	25
10/03/2024 12:00	14.88	0.59	389185	30.17	0	0.7	25
10/03/2024 13:00	14.94	0.57	383848.7	29.23	0	0.7	23.5
10/03/2024 14:00	14.84	0.47	386665.7	29.81	0	0.7	23.5
10/03/2024 15:00	14.83	0.59	387653.6	29.91	0	0.7	24.2
10/03/2024 16:00	14.87	0.55	385793.3	29.58	0	0.7	24
10/03/2024 17:00	14.85	0.61	388414.9	29.98	0	0.7	24.7
10/03/2024 18:00	14.81	0.59	391189.6	30.57	0	0.6	25
10/03/2024 19:00	14.8	0.6	426763.3	34.78	0	0.6	24.4
10/03/2024 20:00	14.71	0.61	447352.6	37.87	0	0.6	22.4
10/03/2024 21:00	14.68	0.62	445184	37.67	0	0.7	22.2
10/03/2024 22:00	14.68	0.59	443057.2	37.47	0	0.6	22.4
10/03/2024 23:00	14.68	0.51	441493.8	37.32	0	0.6	22.5
10/03/2024 24:00	14.81	0.52	466005.3	38.68	0	0.7	26.1
Minimum	14.67	0.47	383083.6	29.23	0	0.6	22.2
MinDate	03/10/2024 2:00:00	03/10/2024 14:00:00	03/10/2024 8:00:00	03/10/2024 13:00:00	03/10/2024 1:00:00	03/10/2024 18:00:00	03/10/2024 21:00:00
Maximum	14.94	0.74	466005.3	38.68	0	0.9	26.1
MaxDate	03/10/2024 13:00:00	03/10/2024 6:00:00			03/10/2024 1:00:00	03/10/2024 4:00:00	
Avg	14.79	0.59	404691	32.23	0	0.7	23.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	25613.5	3.3	0	0.1	1

Site ABPR51 Daily: 11/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
11/03/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 03:00	Shutdown	0.54	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 04:00	Shutdown	1.95	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 05:00	Shutdown	2.31	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 06:00	Shutdown	0.56	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
11/03/2024 09:00	Shutdown	0.51	Shutdown	18.51	Shutdown	Shutdown	Shutdown
11/03/2024 10:00	14.21	0.44	468936.8	39.25	0	0	25.8
11/03/2024 11:00	14.22	0.38	464713.9	38.86	0	0	27.4
11/03/2024 12:00	14.25	0.35	464974.9	38.75	0	0	28
11/03/2024 13:00	14.51	0.22	366172.5	24.86	0	0	40.6
11/03/2024 14:00	14.27	0.25	468708	39.06	0	0	28.6
11/03/2024 15:00	14.23	0.26	465959	38.88	0	0	28.1
11/03/2024 16:00	14.14	0.33	461035.6	38.85	0	0	26.6
11/03/2024 17:00	14.13	0.54	460784.1	38.8	0	0	26.8
11/03/2024 18:00	14.19	0.31	466389.3	39.2	0	0	27.9
11/03/2024 19:00	14.16	0.34	467146.6	39.45	0	0	27.5
11/03/2024 20:00	14.15	0.35	465818.6	39.36	0	0	27.2
11/03/2024 21:00	14.15	0.43	466171.8	39.45	0	0	27.1
11/03/2024 22:00	14.16	0.51	469110.3	39.77	0	0	27
11/03/2024 23:00	14.15	0.45	468344.8	39.71	0	0	26.8
11/03/2024 24:00	14.15	0.43	468732.8	39.74	0	0	26.8
Minimum	14.13	0.01	366172.5	0	0	0	25.8
MinDate	03/11/2024 17:00:00	03/11/2024 1:00:00	03/11/2024 13:00:00	03/11/2024 1:00:00	03/11/2024 10:00:00	03/11/2024 10:00:00	03/11/2024 10:00:00
Maximum	14.51	2.31	469110.3	39.77	0	0	40.6
MaxDate	03/11/2024 13:00:00	03/11/2024 5:00:00	03/11/2024 22:00:00	03/11/2024 22:00:00	03/11/2024 10:00:00	03/11/2024 10:00:00	03/11/2024 13:00:00
Avg	14.2	0.48	459533.3	24.69	0	0	28.1
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.5	25956.6	18.5	0	0	3.5



Site ABPR52 Daily: 11/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
11/03/2024 01:00	14.8	0.62	491364.8	42.8	0	0.7	22.1
11/03/2024 02:00	14.8	0.51	490929.2	42.81	0	0.7	22.1
11/03/2024 03:00	14.77	0.54	490768.4	42.78	0	0.7	21.9
11/03/2024 04:00	14.76	0.58	490604.3	42.78	0	0.7	21.9
11/03/2024 05:00	14.77	0.66	490595.8	42.77	0	0.7	21.7
11/03/2024 06:00	14.77	0.71	491331.3	42.86	0	0.7	21.7
11/03/2024 07:00	14.77	0.72	490061.7	42.77	0	0.7	21.5
11/03/2024 08:00	14.78	0.79	490480.9	42.76	0	0.7	21.5
11/03/2024 09:00	14.83	0.74	445994.5	37.14	0	0.7	22
11/03/2024 10:00	14.82	0.71	463157.2	39.34	0	0.7	21.6
11/03/2024 11:00	14.89	0.79	460451.4	38.95	0	0.7	22.5
11/03/2024 12:00	14.95	0.74	460732.9	38.84	0	0.8	23
11/03/2024 13:00	15.21	0.68	360137.3	24.9	0	0.8	32.8
11/03/2024 14:00	14.98	0.52	465030	39.19	0	0.8	22.5
11/03/2024 15:00	14.86	0.62	461210.8	38.93	0	0.7	22.4
11/03/2024 16:00	14.78	0.55	459013.8	38.94	0	0.7	20.8
11/03/2024 17:00	14.72	0.75	458414.5	38.88	0	0.7	21.1
11/03/2024 18:00	14.76	0.61	463554.2	39.29	0	0.7	22.2
11/03/2024 19:00	14.73	0.6	464886.1	39.55	0	0.7	21.9
11/03/2024 20:00	14.71	0.65	463836.4	39.47	0	0.7	21.6
11/03/2024 21:00	14.72	0.59	463838	39.53	0	0.7	21.6
11/03/2024 22:00	14.73	0.56	466410.9	39.85	0	0.7	21.6
11/03/2024 23:00	14.73	0.49	466227.8	39.81	0	0.7	21.4
11/03/2024 24:00	14.73	0.43	466629.3	39.84	0	0.7	21.5
Minimum	14.71	0.43	360137.3	24.9	0	0.7	20.8
MinDate	03/11/2024 20:00:00		03/11/2024 13:00:00	03/11/2024 13:00:00	03/11/2024 1:00:00	03/11/2024 1:00:00	03/11/2024 16:00:00
Maximum	15.21	0.79	491364.8	42.86	0	0.8	32.8
MaxDate	03/11/2024 13:00:00		03/11/2024 8:00:00	03/11/2024 1:00:00	03/11/2024 6:00:00	03/11/2024 1:00:00	03/11/2024 12:00:00
Avg	14.81	0.63	467319.3	39.78	0	0.7	22.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	26936.2	3.6	0	0	2.3

Site ABPR51 Daily: 12/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
12/03/2024 01:00	14.24	0.44	457704.5	37.64	0	0	30.7
12/03/2024 02:00	14.22	0.46	494612.6	42.71	0	0	28
12/03/2024 03:00	14.22	0.42	495066.1	42.76	0	0	28
12/03/2024 04:00	14.22	0.42	494801.7	42.8	0	0	28.2
12/03/2024 05:00	14.22	0.47	494660.3	42.81	0	0	28.2
12/03/2024 06:00	14.22	0.45	495170.7	42.89	0	0	28.2
12/03/2024 07:00	14.22	0.46	495259	42.81	0	0	28.3
12/03/2024 08:00	14.21	0.41	494979.3	42.85	0	0	28
12/03/2024 09:00	14.21	0.41	452004.9	37.35	0	0	28.3
12/03/2024 10:00	14.16	0.4	471206.4	39.96	0	0	26.7
12/03/2024 11:00	14.19	0.41	472002.4	39.91	0	0	27.3
12/03/2024 12:00	14.23	0.44	480154.3	40.53	0	0	27.7
12/03/2024 13:00	14.34	0.32	379223.2	27.58	0	0	31
12/03/2024 14:00	14.27	0.47	488711.1	41.29	0	0	29.6
12/03/2024 15:00	14.28	0.48	485713.8	40.75	0	0	28.9
12/03/2024 16:00	14.29	0.44	493238.6	41.6	0	0	29.5
12/03/2024 17:00	14.28	0.52	494748.9	41.82	0	0	29.3
12/03/2024 18:00	14.27	0.42	499261.4	42.38	0	0	29.3
12/03/2024 19:00	14.22	0.45	496089	42.25	0	0	28.4
12/03/2024 20:00	14.22	0.55	495488.9	42.29	0	0	28.3
12/03/2024 21:00	14.21	0.57	491073.7	41.9	0	0	27.6
12/03/2024 22:00	14.21	0.41	492037.3	42.13	0	0	28
12/03/2024 23:00	14.18	0.6	492963.1	42.25	0	0	27.1
12/03/2024 24:00	14.18	0.52	494650.4	42.38	0	0	27.1
Minimum	14.16	0.32	379223.2	27.58	0	0	26.7
MinDate	03/12/2024 10:00:00		03/12/2024 13:00:00	03/12/2024 13:00:00	03/12/2024 1:00:00	03/12/2024 1:00:00	03/12/2024 10:00:00
Maximum	14.34	0.6	499261.4	42.89	0	0	31
MaxDate	03/12/2024 13:00:00		03/12/2024 23:00:00	03/12/2024 18:00:00	03/12/2024 6:00:00	03/12/2024 1:00:00	03/12/2024 1:00:00
Avg	14.23	0.46	483367.5	40.99	0	0	28.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	25443.8	3.2	0	0	1.1

Site ABPR52 Daily: 12/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
12/03/2024 01:00	Shutdown	0.85	Shutdown	13.78	Shutdown	Shutdown	Shutdown
12/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
12/03/2024 03:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
12/03/2024 04:00	Shutdown	0.75	Shutdown	0	Shutdown	Shutdown	Shutdown
12/03/2024 05:00	Shutdown	2.72	Shutdown	0	Shutdown	Shutdown	Shutdown
12/03/2024 06:00	Shutdown	1.95	Shutdown	0	Shutdown	Shutdown	Shutdown
12/03/2024 07:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
12/03/2024 08:00	Shutdown	0.28	Shutdown	0	Shutdown	Shutdown	Shutdown
12/03/2024 09:00	Shutdown	0.9	Shutdown	18.7	Shutdown	Shutdown	Shutdown
12/03/2024 10:00	14.82	0.68	474074.8	40.04	0	0.8	21.4
12/03/2024 11:00	14.86	0.64	471644.6	40	0	0.7	22.4
12/03/2024 12:00	14.91	0.58	478717.6	40.64	0	0.7	22.4
12/03/2024 13:00	15.01	0.53	375321.4	27.64	0	0.8	23.8
12/03/2024 14:00	14.92	0.52	486545.2	41.42	0	0.7	24.1
12/03/2024 15:00	14.91	0.59	482492.2	40.85	0	0.7	23.3
12/03/2024 16:00	14.9	0.56	490494.7	41.69	0	0.7	23.8
12/03/2024 17:00	14.86	0.68	491672.1	41.93	0	0.7	23.8
12/03/2024 18:00	14.84	0.72	496081.2	42.46	0	0.7	23.7
12/03/2024 19:00	14.79	0.57	493388.4	42.35	0	0.7	22.9
12/03/2024 20:00	14.78	0.58	492910.2	42.4	0	0.7	22.8
12/03/2024 21:00	14.78	0.65	488553.5	42	0	0.7	22
12/03/2024 22:00	14.77	0.49	489940.8	42.21	0	0.7	22.4
12/03/2024 23:00	14.75	0.51	490996.3	42.36	0	0.7	21.7
12/03/2024 24:00	14.77	0.52	492139.8	42.48	0	0.7	21.9
Minimum	14.75	0.01	375321.4	0	0	0.7	21.4
MinDate	03/12/2024 23:00:00		03/12/2024 2:00:00	03/12/2024 13:00:00	03/12/2024 2:00:00	03/12/2024 10:00:00	03/12/2024 11:00:00
Maximum	15.01	2.72	496081.2	42.48	0	0.8	24.1
MaxDate	03/12/2024 13:00:00		03/12/2024 5:00:00	03/12/2024 18:00:00	03/12/2024 10:00:00	03/12/2024 10:00:00	03/12/2024 14:00:00
Avg	14.84	0.69	479664.9	26.79	0	0.7	22.8
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.6	29764.1	19.1	0	0	0.9



Site ABPR51 Daily: 13/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
13/03/2024 01:00	14.21	0.48	466199.3	38.85	0	0	29.7
13/03/2024 02:00	14.17	0.42	493726.5	42.74	0	0	27
13/03/2024 03:00	14.18	0.35	494205.7	42.8	0	0	27.3
13/03/2024 04:00	14.18	0.37	494244.1	42.82	0	0	27.5
13/03/2024 05:00	14.21	0.33	494372.9	42.83	0	0	27.9
13/03/2024 06:00	14.21	0.39	495033.7	42.93	0	0	28.2
13/03/2024 07:00	14.2	0.41	494453.7	42.85	0	0	27.9
13/03/2024 08:00	14.22	0.33	495707.4	42.87	0	0	28.5
13/03/2024 09:00	14.2	0.31	448547	37.01	0	0	28.9
13/03/2024 10:00	14.14	0.33	438627.3	36.49	0	0	29.1
13/03/2024 11:00	14.16	0.24	437761.5	36.29	0	0	29.5
13/03/2024 12:00	14.18	0.32	442164	36.6	0	0	29.7
13/03/2024 13:00	14.38	0.16	377767	27.22	0	0	34.3
13/03/2024 14:00	14.17	0.4	514878	44.99	0	0	37.8
13/03/2024 15:00	14.09	0.41	523490.8	46.38	0	0	42.2
13/03/2024 16:00	14.11	0.48	495686.7	42.97	0	0	39
13/03/2024 17:00	14.15	0.28	420836.8	34.22	0	0	30.2
13/03/2024 18:00	14.15	0.2	415975.2	33.58	0	0	30.6
13/03/2024 19:00	14.23	0.34	485764.5	41.15	0	0	28.5
13/03/2024 20:00	14.22	0.4	488909.1	41.65	0	0	28.6
13/03/2024 21:00	14.22	0.43	493763.6	42.19	0	0	29
13/03/2024 22:00	14.21	0.45	490063.2	41.9	0	0	28.1
13/03/2024 23:00	14.2	0.47	493404.4	42.24	0	0	27.7
13/03/2024 24:00	14.21	0.52	490500.4	41.92	0	0	27.8
Minimum	14.09	0.16	377767	27.22	0	0	27
MinDate	03/13/2024 15:00:00	03/13/2024 13:00:00	03/13/2024 13:00:00	03/13/2024 13:00:00	03/13/2024 1:00:00	03/13/2024 1:00:00	03/13/2024 2:00:00
Maximum	14.38	0.52	523490.8	46.38	0	0	42.2
MaxDate	03/13/2024 13:00:00		03/13/2024 15:00:00	03/13/2024 15:00:00	03/13/2024 1:00:00	03/13/2024 1:00:00	03/13/2024 15:00:00
Avg	14.19	0.37	474420.1	40.23	0	0	30.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	35472.4	4.4	0	0	4

Site ABPR52 Daily: 13/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
13/03/2024 01:00	Shutdown	0.81	Shutdown	13.7	Shutdown	Shutdown	Shutdown
13/03/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
13/03/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/03/2024 04:00	Shutdown	0.29	Shutdown	0	Shutdown	Shutdown	Shutdown
13/03/2024 05:00	Shutdown	1.27	Shutdown	0	Shutdown	Shutdown	Shutdown
13/03/2024 06:00	Shutdown	0.81	Shutdown	0	Shutdown	Shutdown	Shutdown
13/03/2024 07:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
13/03/2024 08:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
13/03/2024 09:00	Shutdown	1.13	Shutdown	17.9	Shutdown	Shutdown	Shutdown
13/03/2024 10:00	14.8	0.68	440143.4	36.57	0	0.8	23.8
13/03/2024 11:00	14.83	0.71	436291.5	36.36	0	0.8	24.8
13/03/2024 12:00	14.85	0.68	439812	36.68	0	0.8	24.7
13/03/2024 13:00	15.03	0.62	373072.9	27.24	0	0.8	27.5
13/03/2024 14:00	14.86	0.48	456899.6	38.35	0	0.8	25.3
13/03/2024 15:00	14.78	0.47	424919.3	35.1	0	0.8	24.9
13/03/2024 16:00	14.77	0.47	456591.2	38.78	0	0.7	27.8
13/03/2024 17:00	14.71	0.67	524878.4	46.88	0	0.7	38.2
13/03/2024 18:00	14.68	0.69	526996.4	47.28	0	0.7	38.1
13/03/2024 19:00	14.79	0.6	493268.5	42.48	0	0.7	25.3
13/03/2024 20:00	14.79	0.66	487263.2	41.75	0	0.8	23.2
13/03/2024 21:00	14.79	0.73	491645.3	42.29	0	0.8	23.8
13/03/2024 22:00	14.78	0.65	488952.5	42.03	0	0.8	22.9
13/03/2024 23:00	14.77	0.65	491489.6	42.33	0	1	22.5
13/03/2024 24:00	14.78	0.65	488663.1	42.03	0	0.8	22.4
Minimum	14.68	0	373072.9	0	0	0.7	22.4
MinDate	03/13/2024 18:00:00	03/13/2024 2:00:00	03/13/2024 13:00:00	03/13/2024 2:00:00	03/13/2024 10:00:00	03/13/2024 16:00:00	
Maximum	15.03	1.27	526996.4	47.28	0	1	38.2
MaxDate	03/13/2024 13:00:00	03/13/2024 5:00:00	03/13/2024 18:00:00	03/13/2024 18:00:00	03/13/2024 10:00:00	03/13/2024 23:00:00	03/13/2024 17:00:00
Avg	14.8	0.58	468059.1	26.16	0	0.8	26.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	40882.4	18.8	0	0.1	5

Site ABPR51 Daily: 14/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
14/03/2024 01:00	14.26	0.4	459071.1	37.55	0	0	35.9
14/03/2024 02:00	14.22	0.39	495397.6	42.77	0	0	28.4
14/03/2024 03:00	14.22	0.42	494636.1	42.84	0	0	28.3
14/03/2024 04:00	14.22	0.4	494058.5	42.85	0	0	28
14/03/2024 05:00	14.21	0.38	494041.2	42.83	0	0	28
14/03/2024 06:00	14.22	0.37	495301.2	42.92	0	0	27.8
14/03/2024 07:00	14.22	0.35	494786.6	42.82	0	0	27.8
14/03/2024 08:00	14.22	0.32	496022.8	42.83	0	0	28
14/03/2024 09:00	14.22	0.36	468495.2	39.22	0	0	28.6
14/03/2024 10:00	14.26	0.43	491924.6	41.77	0	0	28.4
14/03/2024 11:00	14.28	0.43	486313.6	41.02	0	0	29.1
14/03/2024 12:00	14.29	0.41	487096.3	40.98	0	0	29.3
14/03/2024 13:00	14.4	0.26	373996.1	26.51	0	0	34.2
14/03/2024 14:00	14.34	0.41	495474.7	41.57	0	0	30
14/03/2024 15:00	14.32	0.42	494768.4	41.54	0	0	29.8
14/03/2024 16:00	14.32	0.43	495990.8	41.62	0	0	29.7
14/03/2024 17:00	14.3	0.34	494526.2	41.59	0	0	29.4
14/03/2024 18:00	14.28	0.32	493772.9	41.78	0	0	29.1
14/03/2024 19:00	14.23	0.33	488591	41.44	0	0	28.5
14/03/2024 20:00	14.21	0.4	488837.3	41.61	0	0	28
14/03/2024 21:00	14.19	0.37	485029.6	41.36	0	0	26.9
14/03/2024 22:00	14.17	0.43	483511.3	41.23	0	0	26.7
14/03/2024 23:00	14.19	0.48	489302.9	41.78	0	0	27
14/03/2024 24:00	14.19	0.47	492685.2	42.15	0	0	27.1
Minimum	14.17	0.26	373996.1	26.51	0	0	26.7
MinDate	03/14/2024 22:00:00	03/14/2024 13:00:00	03/14/2024 13:00:00	03/14/2024 13:00:00	03/14/2024 1:00:00	03/14/2024 1:00:00	03/14/2024 22:00:00
Maximum	14.4	0.48	496022.8	42.92	0	0	35.9
MaxDate	03/14/2024 13:00:00	03/14/2024 23:00:00	03/14/2024 8:00:00	03/14/2024 6:00:00	03/14/2024 1:00:00	03/14/2024 1:00:00	03/14/2024 1:00:00
Avg	14.25	0.39	484734.6	41.02	0	0	28.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	25203	3.3	0	0	2.1



Site ABPR52 Daily: 14/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
14/03/2024 01:00	Shutdown	0.91	Shutdown	15.1	Shutdown	Shutdown	Shutdown
14/03/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/03/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/03/2024 04:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
14/03/2024 05:00	Shutdown	1.46	Shutdown	0	Shutdown	Shutdown	Shutdown
14/03/2024 06:00	Shutdown	0.95	Shutdown	0	Shutdown	Shutdown	Shutdown
14/03/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/03/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/03/2024 09:00	Shutdown	0.79	Shutdown	20.02	Shutdown	Shutdown	Shutdown
14/03/2024 10:00	14.95	0.63	494207.8	41.88	0	0.8	23.3
14/03/2024 11:00	15	0.73	485479.4	41.12	0	0.8	24.1
14/03/2024 12:00	15	0.72	484742.6	41.08	0	0.8	23.8
14/03/2024 13:00	15.07	0.71	370025	26.64	0	0.8	26.7
14/03/2024 14:00	15	0.75	492295.3	41.64	0	0.7	24.7
14/03/2024 15:00	14.97	0.53	491536.9	41.65	0	0.7	24.4
14/03/2024 16:00	14.97	0.55	492461.5	41.71	0	0.7	24.1
14/03/2024 17:00	14.92	0.47	490801	41.67	0	0.7	23.7
14/03/2024 18:00	14.86	0.61	490490.3	41.87	0	0.7	23.5
14/03/2024 19:00	14.81	0.56	485577.4	41.54	0	0.8	22.9
14/03/2024 20:00	14.78	0.7	486774.3	41.73	0	0.7	22.7
14/03/2024 21:00	14.76	0.62	483337.7	41.45	0	0.7	21.5
14/03/2024 22:00	14.75	0.62	482190.9	41.33	0	0.7	21.3
14/03/2024 23:00	14.77	0.72	487154.4	41.87	0	0.7	21.6
14/03/2024 24:00	14.77	0.67	490636.5	42.24	0	0.7	21.6
Minimum	14.75	0	370025	0	0	0.7	21.3
MinDate	03/14/2024 22:00:00	03/14/2024 2:00:00	03/14/2024 13:00:00	03/14/2024 2:00:00	03/14/2024 10:00:00	03/14/2024 14:00:00	03/14/2024 22:00:00
Maximum	15.07	1.46	494207.8	42.24	0	0.8	26.7
MaxDate	03/14/2024 13:00:00	03/14/2024 5:00:00	03/14/2024 10:00:00		03/14/2024 10:00:00	03/14/2024 10:00:00	03/14/2024 13:00:00
Avg	14.89	0.58	480514.1	26.86	0	0.7	23.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	30785.1	19	0	0	1.5

Site ABPR51 Daily: 15/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
15/03/2024 01:00	14.23	0.47	465294.7	38.64	0	0	30.2
15/03/2024 02:00	14.19	0.39	494885.5	42.8	0	0	27
15/03/2024 03:00	14.19	0.37	495028.1	42.86	0	0	27
15/03/2024 04:00	14.19	0.38	495319.8	42.87	0	0	27
15/03/2024 05:00	14.19	0.37	495081.2	42.88	0	0	27
15/03/2024 06:00	14.2	0.33	496590.2	43	0	0	27.1
15/03/2024 07:00	14.18	0.33	494852.5	42.87	0	0	27.1
15/03/2024 08:00	14.2	0.38	495578.5	42.87	0	0	27.1
15/03/2024 09:00	14.21	0.34	459785.6	38.26	0	0	29.9
15/03/2024 10:00	14.24	0.36	489430.8	41.53	0	0	27.3
15/03/2024 11:00	14.23	0.42	483076.3	40.86	0	0	27.3
15/03/2024 12:00	14.27	0.35	485739	40.89	0	0	28
15/03/2024 13:00	14.37	0.15	377199.9	27.14	0	0	31.3
15/03/2024 14:00	14.29	0.31	492691.3	41.46	0	0	29.2
15/03/2024 15:00	14.29	0.26	486149.9	40.7	0	0	28.6
15/03/2024 16:00	14.3	0.36	496907.9	41.77	0	0	29.3
15/03/2024 17:00	14.27	0.42	491630.4	41.49	0	0	28.7
15/03/2024 18:00	14.26	0.47	493982.2	41.89	0	0	28.4
15/03/2024 19:00	14.21	0.28	486777.5	41.32	0	0	27.4
15/03/2024 20:00	14.19	0.34	483799.1	41.09	0	0	26.8
15/03/2024 21:00	14.19	0.35	482161.2	41.06	0	0	26.8
15/03/2024 22:00	14.17	0.32	479145.6	40.74	0	0	26.8
15/03/2024 23:00	14.2	0.38	491988.9	42.01	0	0	27
15/03/2024 24:00	14.18	0.5	484856.2	41.33	0	0	26.8
Minimum	14.17	0.15	377199.9	27.14	0	0	26.8
MinDate	03/15/2024 22:00:00	03/15/2024 13:00:00	03/15/2024 13:00:00	03/15/2024 13:00:00	03/15/2024 1:00:00	03/15/2024 1:00:00	03/15/2024 20:00:00
Maximum	14.37	0.5	496907.9	43	0	0	31.3
MaxDate	03/15/2024 13:00:00	03/15/2024 16:00:00	03/15/2024 6:00:00	03/15/2024 1:00:00	03/15/2024 1:00:00	03/15/2024 1:00:00	03/15/2024 13:00:00
Avg	14.23	0.36	483248	40.93	0	0	27.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	24465.3	3.2	0	0	1.3

Site ABPR52 Daily: 15/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
15/03/2024 01:00	Shutdown	0.93	Shutdown	14.43	Shutdown	Shutdown	Shutdown
15/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/03/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/03/2024 04:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
15/03/2024 05:00	Shutdown	1.05	Shutdown	0	Shutdown	Shutdown	Shutdown
15/03/2024 06:00	Shutdown	0.55	Shutdown	0	Shutdown	Shutdown	Shutdown
15/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/03/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
15/03/2024 09:00	<Samp	0.85	<Samp	20.48	<Samp	<Samp	<Samp
15/03/2024 10:00	14.96	0.63	492309.1	41.64	0	0.8	22
15/03/2024 11:00	14.92	0.67	482785.8	40.95	0	0.8	22.1
15/03/2024 12:00	14.93	0.61	485351	41.06	0	0.8	22.6
15/03/2024 13:00	15.02	0.87	373182	27.22	0	0.9	23.9
15/03/2024 14:00	14.93	0.67	490770.4	41.64	0	0.8	23.7
15/03/2024 15:00	14.93	0.58	482834.7	40.8	0	0.8	23.1
15/03/2024 16:00	14.93	0.42	493529.3	41.86	0	0.8	23.6
15/03/2024 17:00	14.89	0.51	489277.4	41.6	0	0.8	23.1
15/03/2024 18:00	14.87	0.55	490923.3	41.99	0	0.8	22.9
15/03/2024 19:00	14.81	0.44	484391.3	41.42	0	0.8	21.9
15/03/2024 20:00	14.77	0.61	481516.1	41.21	0	0.8	21.3
15/03/2024 21:00	14.76	0.65	480243.2	41.15	0	0.7	21.4
15/03/2024 22:00	14.76	0.63	476883.2	40.83	0	0.7	21.3
15/03/2024 23:00	14.78	0.64	490275.4	42.12	0	0.8	21.8
15/03/2024 24:00	14.79	0.72	482936.5	41.43	0	0.8	21.3
Minimum	14.76	0.01	373182	0	0	0.7	21.3
MinDate	03/15/2024 21:00:00	03/15/2024 2:00:00	03/15/2024 13:00:00	03/15/2024 2:00:00	03/15/2024 10:00:00	03/15/2024 21:00:00	03/15/2024 20:00:00
Maximum	15.02	1.05	493529.3	42.12	0	0.9	23.9
MaxDate	03/15/2024 13:00:00	03/15/2024 5:00:00	03/15/2024 16:00:00	03/15/2024 23:00:00	03/15/2024 10:00:00	03/15/2024 13:00:00	03/15/2024 13:00:00
Avg	14.87	0.53	478480.6	26.74	0	0.8	22.4
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	29546.2	18.9	0	0	0.9



Site ABPR51 Daily: 16/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
16/03/2024 01:00	14.24	0.44	460009	37.97	0	0	30.4
16/03/2024 02:00	14.21	0.42	495025.3	42.78	0	0	26.8
16/03/2024 03:00	14.2	0.36	495686.6	42.84	0	0	26.8
16/03/2024 04:00	14.2	0.36	495805.6	42.85	0	0	26.8
16/03/2024 05:00	14.21	0.31	495359.1	42.81	0	0	27
16/03/2024 06:00	14.2	0.22	495609.8	42.91	0	0	27.1
16/03/2024 07:00	14.17	0.06	492141.7	42.87	0	0	27.7
16/03/2024 08:00	14.16	0.23	491792	42.89	0	0	27.5
16/03/2024 09:00	14.17	0.37	456833	38.37	0	0	29.9
16/03/2024 10:00	14.15	0.55	469745.8	40.02	0	0	27.7
16/03/2024 11:00	14.17	0.58	469865.9	39.95	0	0	27.9
16/03/2024 12:00	14.21	0.57	476474.2	40.4	0	0	28.4
16/03/2024 13:00	14.38	0.36	375129.5	26.79	0	0	33.8
16/03/2024 14:00	14.23	0.51	478997.3	40.52	0	0	27.8
16/03/2024 15:00	14.22	0.5	481649.4	40.71	0	0	27.6
16/03/2024 16:00	14.26	0.55	485496.4	40.97	0	0	28.3
16/03/2024 17:00	14.28	0.58	491105.2	41.53	0	0	29
16/03/2024 18:00	14.23	0.58	485545	41.15	0	0	28.2
16/03/2024 19:00	14.17	0.5	480276.9	40.96	0	0	26.8
16/03/2024 20:00	14.22	0.56	489665.1	41.76	0	0	28.1
16/03/2024 21:00	14.18	0.54	482124	41.07	0	0	27.4
16/03/2024 22:00	14.17	0.52	486134.4	41.56	0	0	27
16/03/2024 23:00	14.15	0.52	480487.9	41.03	0	0	26.8
16/03/2024 24:00	14.15	0.49	481151.9	41.09	0	0	26.6
Minimum	14.15	0.06	375129.5	26.79	0	0	26.6
MinDate	03/16/2024 10:00:00	03/16/2024 7:00:00	03/16/2024 13:00:00	03/16/2024 13:00:00	03/16/2024 1:00:00	03/16/2024 1:00:00	
Maximum	14.38	0.58	495805.6	42.91	0	0	33.8
MaxDate	03/16/2024 13:00:00	03/16/2024 11:00:00	03/16/2024 4:00:00	03/16/2024 6:00:00	03/16/2024 1:00:00	03/16/2024 1:00:00	03/16/2024 13:00:00
Avg	14.21	0.45	478838	40.66	0	0	28
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24614.7	3.3	0	0	1.6

Site ABPR52 Daily: 16/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
16/03/2024 01:00	Shutdown	0.97	Shutdown	14.07	Shutdown	Shutdown	Shutdown
16/03/2024 02:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
16/03/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
16/03/2024 04:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
16/03/2024 05:00	Shutdown	0.89	Shutdown	0	Shutdown	Shutdown	Shutdown
16/03/2024 06:00	Shutdown	0.91	Shutdown	0	Shutdown	Shutdown	Shutdown
16/03/2024 07:00	Shutdown	0.4	Shutdown	0	Shutdown	Shutdown	Shutdown
16/03/2024 08:00	Shutdown	1.14	Shutdown	0	Shutdown	Shutdown	Shutdown
16/03/2024 09:00	Shutdown	0.8	Shutdown	19	Shutdown	Shutdown	Shutdown
16/03/2024 10:00	14.81	0.41	473129.8	40.12	0	0.9	22.4
16/03/2024 11:00	14.82	0.47	470338.3	40.04	0	0.9	23
16/03/2024 12:00	14.88	0.57	475472.4	40.51	0	0.9	23.1
16/03/2024 13:00	15.11	0.62	369866.3	26.82	0	1	26.5
16/03/2024 14:00	14.95	0.62	477514.2	40.61	0	0.9	22.4
16/03/2024 15:00	14.92	0.64	479446.8	40.8	0	0.9	22.3
16/03/2024 16:00	14.91	0.69	482533	41.04	0	0.9	22.8
16/03/2024 17:00	14.91	0.63	488377.2	41.64	0	0.9	23.3
16/03/2024 18:00	14.87	0.6	482124.8	41.18	0	0.9	22.8
16/03/2024 19:00	14.78	0.54	478410	41.08	0	0.8	21.8
16/03/2024 20:00	14.8	0.49	487352.4	41.85	0	0.8	22.7
16/03/2024 21:00	14.77	0.48	480067.3	41.17	0	0.8	22.2
16/03/2024 22:00	14.77	0.51	484471.8	41.67	0	0.9	21.8
16/03/2024 23:00	14.76	0.52	478514.6	41.14	0	0.8	21.7
16/03/2024 24:00	14.76	0.59	478719.5	41.19	0	0.9	21.3
Minimum	14.76	0.02	369866.3	0	0	0.8	21.3
MinDate	03/16/2024 23:00:00	03/16/2024 2:00:00	03/16/2024 13:00:00	03/16/2024 2:00:00	03/16/2024 10:00:00	03/16/2024 19:00:00	
Maximum	15.11	1.14	488377.2	41.85	0	1	26.5
MaxDate	03/16/2024 13:00:00	03/16/2024 8:00:00	03/16/2024 17:00:00	03/16/2024 20:00:00	03/16/2024 10:00:00	03/16/2024 13:00:00	03/16/2024 13:00:00
Avg	14.85	0.57	472422.6	26.41	0	0.9	22.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	28781.1	18.7	0	0.1	1.2

Site ABPR51 Daily: 17/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
17/03/2024 01:00	14.24	0.47	457613.9	37.8	0	0	31.9
17/03/2024 02:00	14.21	0.45	493136.2	42.74	0	0	28.1
17/03/2024 03:00	14.21	0.45	493474.3	42.81	0	0	28.4
17/03/2024 04:00	14.21	0.41	493311.6	42.82	0	0	28.3
17/03/2024 05:00	14.21	0.41	493360.1	42.8	0	0	28
17/03/2024 06:00	14.21	0.57	494089.7	42.87	0	0	27.9
17/03/2024 07:00	14.19	0.5	492647.3	42.83	0	0	27.8
17/03/2024 08:00	14.21	0.5	493551.4	42.84	0	0	28
17/03/2024 09:00	14.24	0.31	495557	42.81	0	0	28.5
17/03/2024 10:00	14.29	0.22	498653.4	42.77	0	0	30
17/03/2024 11:00	14.34	0.28	500778.2	42.74	0	0	30.9
17/03/2024 12:00	14.39	0.33	502979	42.76	0	0	32.1
17/03/2024 13:00	14.39	0.3	503475.6	42.74	0	0	32.3
17/03/2024 14:00	14.38	0.36	503971.9	42.73	0	0	32.4
17/03/2024 15:00	14.37	0.26	504387.3	42.75	0	0	32.2
17/03/2024 16:00	14.36	0.31	504709.8	42.78	0	0	32.2
17/03/2024 17:00	14.34	0.27	503428.1	42.8	0	0	32.3
17/03/2024 18:00	14.3	0.4	480262.4	40.47	0	0	31.6
17/03/2024 19:00	14.22	0.44	440239.9	36.15	0	0	31.2
17/03/2024 20:00	14.16	0.47	459056.1	38.75	0	0	28.3
17/03/2024 21:00	14.15	0.41	457430.6	38.65	0	0	27.8
17/03/2024 22:00	14.13	0.4	459710.6	38.89	0	0	27.3
17/03/2024 23:00	14.11	0.38	456575.7	38.57	0	0	27.1
17/03/2024 24:00	Shutdown	0.33	Shutdown	4.06	Shutdown	Shutdown	Shutdown
Minimum	14.11	0.22	440239.9	4.06	0	0	27.1
MinDate	03/17/2024 23:00:00	03/17/2024 10:00:00	03/17/2024 19:00:00		03/17/2024 1:00:00	03/17/2024 1:00:00	03/17/2024 23:00:00
Maximum	14.39	0.57	504709.8	42.87	0	0	32.4
MaxDate	03/17/2024 12:00:00	03/17/2024 6:00:00	03/17/2024 16:00:00	03/17/2024 6:00:00	03/17/2024 1:00:00	03/17/2024 1:00:00	03/17/2024 14:00:00
Avg	14.25	0.38	486191.4	39.91	0	0	29.8
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	19985.7	7.9	0	0	2



Site ABPR52 Daily: 17/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
17/03/2024 01:00	Shutdown	0.96	Shutdown	14.45	Shutdown	Shutdown	Shutdown
17/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 03:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 04:00	Shutdown	0.34	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 05:00	Shutdown	1.21	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 06:00	Shutdown	1	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 07:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 08:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 09:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 10:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 11:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 12:00	Shutdown	0.38	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 13:00	Shutdown	0.56	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 14:00	Shutdown	0.54	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 15:00	Shutdown	0.24	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 16:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 17:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
17/03/2024 18:00	Shutdown	1.11	Shutdown	2.92	Shutdown	Shutdown	Shutdown
17/03/2024 19:00	14.82	0.46	445070	36.24	0.1	0.7	25.9
17/03/2024 20:00	14.77	0.49	460162.8	38.85	0	0.7	23.6
17/03/2024 21:00	14.73	0.48	457450	38.74	0	0.8	23.2
17/03/2024 22:00	14.72	0.46	458919.5	38.98	0	0.8	22.5
17/03/2024 23:00	14.72	0.46	455635.3	38.66	0	0.8	22.2
17/03/2024 24:00	14.81	0.56	459972.5	38.42	0	0.8	26.7
Minimum	14.72	0.01	445070	0	0	0.7	22.2
MinDate	03/17/2024 22:00:00	03/17/2024 2:00:00	03/17/2024 19:00:00	03/17/2024 2:00:00	03/17/2024 20:00:00	03/17/2024 19:00:00	03/17/2024 23:00:00
Maximum	14.82	1.21	460162.8	38.98	0.1	0.8	26.7
MaxDate	03/17/2024 19:00:00	03/17/2024 5:00:00	03/17/2024 20:00:00	03/17/2024 22:00:00	03/17/2024 19:00:00	03/17/2024 21:00:00	
Avg	14.76	0.42	456201.7	10.3	0	0.8	24
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.3	5713.5	16.8	0	0.1	1.9

Site ABPR51 Daily: 18/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
18/03/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 03:00	Shutdown	0.69	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 04:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
18/03/2024 09:00	Shutdown	0.61	Shutdown	17.4	Shutdown	Shutdown	Shutdown
18/03/2024 10:00	14.07	0.39	441828.2	36.31	0	0	26.3
18/03/2024 11:00	14.09	0.3	440485.4	36.24	0	0	26.9
18/03/2024 12:00	14.14	0.36	445123.7	36.45	0	0	27.4
18/03/2024 13:00	14.39	0.22	373542.2	25.74	0	0	35.6
18/03/2024 14:00	14.2	0.4	480392	39.9	0	0	26.5
18/03/2024 15:00	14.14	0.33	474501.6	39.77	0	0	26
18/03/2024 16:00	14.1	0.48	473076.8	40.09	0	0	26.1
18/03/2024 17:00	14.14	0.53	475262.8	39.98	0	0	24.9
18/03/2024 18:00	14.2	0.43	473712.4	39.97	0	0	26.3
18/03/2024 19:00	14.23	0.39	481247.8	40.76	0	0	27.6
18/03/2024 20:00	14.22	0.53	485826.7	41.32	0	0	27.4
18/03/2024 21:00	14.2	0.55	486872.8	41.53	0	0	27
18/03/2024 22:00	14.16	0.45	481190.3	40.99	0	0	26.2
18/03/2024 23:00	14.17	0.44	485127.1	41.37	0	0	26.6
18/03/2024 24:00	14.18	0.43	489330.3	41.79	0	0	26.8
Minimum	14.07	0.01	373542.2	0	0	0	24.9
MinDate	03/18/2024 10:00:00	03/18/2024 1:00:00	03/18/2024 13:00:00	03/18/2024 1:00:00	03/18/2024 10:00:00	03/18/2024 10:00:00	03/18/2024 17:00:00
Maximum	14.39	0.69	489330.3	41.79	0	0	35.6
MaxDate	03/18/2024 13:00:00	03/18/2024 3:00:00			03/18/2024 10:00:00	03/18/2024 10:00:00	03/18/2024 13:00:00
Avg	14.18	0.32	465834.7	24.98	0	0	27.2
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.2	30350.2	18.8	0	0	2.4

Site ABPR52 Daily: 18/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
18/03/2024 01:00	14.77	0.66	491518.1	42.82	0	0.8	22.2
18/03/2024 02:00	14.78	0.73	491220.3	42.84	0	0.9	21.9
18/03/2024 03:00	14.79	0.73	491014.7	42.81	0	0.9	21.7
18/03/2024 04:00	14.77	0.77	491619.3	42.92	0	0.9	21.6
18/03/2024 05:00	14.77	0.77	491088.2	42.84	0	1	21.5
18/03/2024 06:00	14.75	0.76	491440.9	42.87	0	1	21.4
18/03/2024 07:00	14.78	0.66	490539.9	42.8	0	1	21.4
18/03/2024 08:00	14.82	0.69	489867.6	42.68	0	1	21.1
18/03/2024 09:00	14.86	0.5	432304.2	35.64	0	1	23
18/03/2024 10:00	14.76	0.6	433731	36.39	0	1	22.2
18/03/2024 11:00	14.89	0.64	434484.6	36.32	0	1	22.2
18/03/2024 12:00	14.94	0.74	439026.9	36.48	0	1	22.4
18/03/2024 13:00	15.19	0.69	366736.2	25.75	0	1	29
18/03/2024 14:00	14.94	0.69	473136.3	40.03	0	0.9	21.1
18/03/2024 15:00	14.84	0.51	460580.3	39.14	0	0.9	21.7
18/03/2024 16:00	14.71	0.54	469202.3	40.23	0	0.9	21.8
18/03/2024 17:00	14.79	0.81	471030.8	40.14	0	0.9	20.6
18/03/2024 18:00	14.8	0.56	468244.3	39.79	0	0.9	21.2
18/03/2024 19:00	14.79	0.5	479093.1	40.93	0	0.9	22.4
18/03/2024 20:00	14.77	0.38	483096.7	41.38	0	0.9	22
18/03/2024 21:00	14.76	0.46	484442.8	41.64	0	0.9	21.8
18/03/2024 22:00	14.74	0.51	478874	41.09	0	0.9	21
18/03/2024 23:00	14.75	0.56	482525.9	41.48	0	0.9	21.5
18/03/2024 24:00	14.75	0.61	486460.2	41.89	0	1	21.7
Minimum	14.71	0.38	366736.2	25.75	0	0.8	20.6
MinDate	03/18/2024 16:00:00	03/18/2024 20:00:00	03/18/2024 13:00:00	03/18/2024 13:00:00	03/18/2024 1:00:00	03/18/2024 1:00:00	03/18/2024 17:00:00
Maximum	15.19	0.81	491619.3	42.92	0	1	29
MaxDate	03/18/2024 13:00:00	03/18/2024 17:00:00	03/18/2024 4:00:00	03/18/2024 4:00:00	03/18/2024 1:00:00	03/18/2024 5:00:00	03/18/2024 13:00:00
Avg	14.81	0.63	469636.7	40.04	0	0.9	22
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	29659	3.8	0	0.1	1.6



Site ABPR51 Period: 19/03/2024 00:00-20/03/2024 00:00 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
19/03/2024 01:00	14.23	0.38	464408.4	38.58	0	0	30.1
19/03/2024 02:00	14.19	0.42	495294.2	42.81	0	0	27
19/03/2024 03:00	14.18	0.4	494938.7	42.86	0	0	27.1
19/03/2024 04:00	14.19	0.4	495053.3	42.87	0	0	27.2
19/03/2024 05:00	14.2	0.37	495276.5	42.86	0	0	27.4
19/03/2024 06:00	14.21	0.41	495780.3	42.95	0	0	27.5
19/03/2024 07:00	14.19	0.41	494916.6	42.86	0	0	27.4
19/03/2024 08:00	14.19	0.41	494985.4	42.87	0	0	27.3
19/03/2024 09:00	14.2	0.36	451459.3	37.37	0	0	27.6
19/03/2024 10:00	14.16	0.42	467668.5	39.54	0	0	27
19/03/2024 11:00	14.18	0.42	468852.4	39.54	0	0	27.1
19/03/2024 12:00	14.2	0.29	465184.7	39.15	0	0	27.6
19/03/2024 13:00	14.43	0.23	368513.7	25.48	0	0	37
19/03/2024 14:00	14.24	0.31	472378.5	39.65	0	0	28.2
19/03/2024 15:00	14.25	0.36	477228.2	40.13	0	0	27.7
19/03/2024 16:00	14.23	0.42	475966.4	40.1	0	0	27.7
19/03/2024 17:00	14.2	0.31	474967.2	40.22	0	0	27.6
19/03/2024 18:00	14.16	0.21	465356.8	39.55	0	0	27.6
19/03/2024 19:00	14.16	0.4	473426.7	40.32	0	0	27.5
19/03/2024 20:00	14.16	0.53	473870.7	40.37	0	0	27.5
19/03/2024 21:00	14.15	0.62	477526.2	40.73	0	0	26.6
19/03/2024 22:00	14.16	0.44	483801.3	41.35	0	0	26.4
19/03/2024 23:00	14.16	0.81	484109.1	41.41	0	0	26.2
19/03/2024 24:00	14.15	0.44	479784	40.97	0	0	26.2
Minimum	14.15	0.21	368513.7	25.48	0	0	26.2
MinDate	03/19/2024 21:00:00	03/19/2024 18:00:00	03/19/2024 13:00:00	03/19/2024 13:00:00	03/19/2024 1:00:00	03/19/2024 1:00:00	03/19/2024 23:00:00
Maximum	14.43	0.81	495780.3	42.95	0	0	37
MaxDate	03/19/2024 13:00:00	03/19/2024 23:00:00	03/19/2024 6:00:00	03/19/2024 6:00:00	03/19/2024 1:00:00	03/19/2024 1:00:00	03/19/2024 13:00:00
Avg	14.2	0.41	474614.4	40.19	0	0	27.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	25826.3	3.5	0	0	2.1

Site ABPR52 Period: 19/03/2024 00:00-20/03/2024 00:00 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
19/03/2024 01:00	Shutdown	0.86	Shutdown	14.3	Shutdown	Shutdown	Shutdown
19/03/2024 02:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
19/03/2024 03:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
19/03/2024 04:00	Shutdown	1.31	Shutdown	0	Shutdown	Shutdown	Shutdown
19/03/2024 05:00	Shutdown	2.89	Shutdown	0	Shutdown	Shutdown	Shutdown
19/03/2024 06:00	Shutdown	1.39	Shutdown	0	Shutdown	Shutdown	Shutdown
19/03/2024 07:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
19/03/2024 08:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
19/03/2024 09:00	<Samp	0.95	<Samp	19.43	<Samp	<Samp	<Samp
19/03/2024 10:00	14.9	0.57	470680.5	39.68	0	0.9	21.5
19/03/2024 11:00	14.9	0.57	468727.3	39.63	0	0.9	22
19/03/2024 12:00	14.86	0.57	464785.8	39.27	0	0.9	22.2
19/03/2024 13:00	15.07	0.56	363470.5	25.48	0	1	29.8
19/03/2024 14:00	14.88	0.61	471169.8	39.78	0	0.9	22.6
19/03/2024 15:00	14.86	0.61	474898.8	40.21	0	0.9	22.3
19/03/2024 16:00	14.83	0.65	473764.9	40.2	0	0.9	22.3
19/03/2024 17:00	14.82	0.52	473033.2	40.3	0	0.9	22.2
19/03/2024 18:00	14.77	0.49	463885.8	39.65	0	0.9	22.3
19/03/2024 19:00	14.78	0.43	472052.1	40.42	0	0.9	22.2
19/03/2024 20:00	14.78	0.6	472461.8	40.45	0	0.9	22.2
19/03/2024 21:00	14.75	0.62	476425.5	40.85	0	0.9	21.4
19/03/2024 22:00	14.75	0.48	482545.1	41.46	0	0.9	21.2
19/03/2024 23:00	14.73	0.5	482220	41.52	0	0.9	21.1
19/03/2024 24:00	14.73	0.38	478025.4	41.06	0	0.9	20.9
Minimum	14.73	0.06	363470.5	0	0	0.9	20.9
MinDate	03/19/2024 23:00:00	03/19/2024 2:00:00	03/19/2024 13:00:00	03/19/2024 2:00:00	03/19/2024 10:00:00	03/19/2024 10:00:00	03/19/2024 10:00:00
Maximum	15.07	2.89	482545.1	41.52	0	1	29.8
MaxDate	03/19/2024 13:00:00	03/19/2024 5:00:00	03/19/2024 22:00:00	03/19/2024 23:00:00	03/19/2024 10:00:00	03/19/2024 13:00:00	03/19/2024 13:00:00
Avg	14.83	0.68	465876.5	25.99	0	0.9	22.4
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.6	28823.5	18.4	0	0	2.1

Site ABPR51 Period: 20/03/2024 00:00-21/03/2024 00:00 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
20/03/2024 01:00	14.19	0.55	466013.2	37.76	0	0	29.2
20/03/2024 02:00	14.16	0.48	493840.3	42.77	0	0	26.7
20/03/2024 03:00	14.16	0.46	493412.8	42.83	0	0	26.8
20/03/2024 04:00	14.16	0.45	492976.1	42.84	0	0	26.8
20/03/2024 05:00	14.16	0.41	493556.8	42.84	0	0	26.9
20/03/2024 06:00	14.16	0.5	494573.2	42.95	0	0	26.9
20/03/2024 07:00	14.16	0.48	493444.3	42.85	0	0	26.9
20/03/2024 08:00	14.17	0.37	493204.3	42.87	0	0	26.9
20/03/2024 09:00	14.19	0.24	451347.8	37.56	0	0	28.3
20/03/2024 10:00	14.16	0.15	476647.8	40.83	0	0	26.6
20/03/2024 11:00	14.15	0.58	475519.2	40.66	0	0	26.6
20/03/2024 12:00	14.16	0.65	481285.1	41.25	0	0	27
20/03/2024 13:00	14.3	0.19	376481.8	27.36	0	0	34.1
20/03/2024 14:00	14.19	0.62	493577.4	42.55	0	0	29.3
20/03/2024 15:00	14.23	0.41	517937.7	44.87	0	0	29.6
20/03/2024 16:00	14.16	0.39	484566.5	41.64	0	0	27.7
20/03/2024 17:00	14.17	0.33	484594.6	41.61	0	0	27.9
20/03/2024 18:00	14.16	0.36	479701.6	41.1	0	0	27.4
20/03/2024 19:00	14.15	0.39	479624.8	41.08	0	0	26.9
20/03/2024 20:00	14.15	0.38	484835.2	41.69	0	0	27
20/03/2024 21:00	14.16	0.41	480075.5	41.16	0	0	26.8
20/03/2024 22:00	14.16	0.58	482825.5	41.49	0	0	26.8
20/03/2024 23:00	14.16	0.57	481733.9	41.33	0	0	26.9
20/03/2024 24:00	14.16	0.51	479708	41.1	0	0	27.1
Minimum	14.15	0.15	376481.8	27.36	0	0	26.6
MinDate	03/20/2024 11:00:00	03/20/2024 10:00:00	03/20/2024 13:00:00	03/20/2024 13:00:00	03/20/2024 1:00:00	03/20/2024 1:00:00	03/20/2024 10:00:00
Maximum	14.3	0.65	517937.7	44.87	0	0	34.1
MaxDate	03/20/2024 13:00:00	03/20/2024 12:00:00	03/20/2024 15:00:00	03/20/2024 15:00:00	03/20/2024 1:00:00	03/20/2024 1:00:00	03/20/2024 13:00:00
Avg	14.17	0.44	480478.5	41.04	0	0	27.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	25325.5	3.3	0	0	1.6



Site ABPR52 Period: 20/03/2024 00:00-21/03/2024 00:00 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
20/03/2024 01:00	Shutdown	0.87	Shutdown	14.3	Shutdown	Shutdown	Shutdown
20/03/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
20/03/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
20/03/2024 04:00	Shutdown	0.36	Shutdown	0	Shutdown	Shutdown	Shutdown
20/03/2024 05:00	Shutdown	1.78	Shutdown	0	Shutdown	Shutdown	Shutdown
20/03/2024 06:00	Shutdown	1.26	Shutdown	0	Shutdown	Shutdown	Shutdown
20/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
20/03/2024 08:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
20/03/2024 09:00	<Samp	0.72	<Samp	19.25	<Samp	<Samp	<Samp
20/03/2024 10:00	14.78	0.29	481101.3	40.93	0	1	21.4
20/03/2024 11:00	14.76	0.32	476941.5	40.79	0	1	21.8
20/03/2024 12:00	14.77	0.33	481631	41.35	0	1	21.8
20/03/2024 13:00	14.85	0.35	373043.4	27.47	0	1	27.8
20/03/2024 14:00	14.7	0.53	472913.2	40.51	0	1	22.1
20/03/2024 15:00	14.74	0.25	453987.1	38.61	0	1	22.5
20/03/2024 16:00	14.81	0.32	484463.4	41.73	0	1.1	21.9
20/03/2024 17:00	14.81	0.32	484452.9	41.73	0	1.1	22.3
20/03/2024 18:00	14.79	0.35	479149.6	41.18	0	1.1	21.8
20/03/2024 19:00	14.78	0.4	478505.3	41.17	0	1	21.6
20/03/2024 20:00	14.78	0.42	484359.6	41.79	0	1	21.6
20/03/2024 21:00	14.77	0.48	479290.5	41.25	0	1	21.4
20/03/2024 22:00	14.77	0.59	481994.8	41.57	0	1	21.4
20/03/2024 23:00	14.78	0.52	480581.9	41.44	0	1.1	21.5
20/03/2024 24:00	14.79	0.49	478653.3	41.22	0	1.1	21.6
Minimum	14.7	0	373043.4	0	0	1	21.4
MinDate	03/20/2024 14:00:00	03/20/2024 2:00:00	03/20/2024 13:00:00	03/20/2024 2:00:00	03/20/2024 10:00:00	03/20/2024 10:00:00	03/20/2024 10:00:00
Maximum	14.85	1.78	484463.4	41.79	0	1.1	27.8
MaxDate	03/20/2024 13:00:00	03/20/2024 5:00:00	03/20/2024 16:00:00	03/20/2024 20:00:00	03/20/2024 10:00:00	03/20/2024 16:00:00	03/20/2024 13:00:00
Avg	14.78	0.46	471404.6	26.51	0	1	22.2
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0	0.4	28208.2	18.8	0	0	1.6

Site ABPR51 Daily: 21/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
21/03/2024 01:00	14.22	0.43	457395.6	38.04	0	0	31.9
21/03/2024 02:00	14.21	0.42	492896	42.78	0	0	28
21/03/2024 03:00	14.19	0.47	492782.7	42.82	0	0	27.8
21/03/2024 04:00	14.21	0.43	492832.5	42.84	0	0	28
21/03/2024 05:00	14.2	0.37	492453.1	42.83	0	0	28
21/03/2024 06:00	14.22	0.4	493108.3	42.91	0	0	28.5
21/03/2024 07:00	14.22	0.37	492620.3	42.82	0	0	29.3
21/03/2024 08:00	14.22	0.21	492491	42.87	0	0	29.7
21/03/2024 09:00	14.22	0.31	456865.3	38.33	0	0	31
21/03/2024 10:00	14.22	0.32	480449.2	40.95	0	0	29.1
21/03/2024 11:00	14.25	0.29	479990.3	40.73	0	0	29.4
21/03/2024 12:00	14.27	0.29	475187.1	40.06	0	0	29.2
21/03/2024 13:00	14.41	0.3	373219.7	26.51	0	0	33.9
21/03/2024 14:00	14.3	0.61	478393.7	40.08	0	0	28.8
21/03/2024 15:00	14.29	0.64	476480.8	39.87	0	0	28.6
21/03/2024 16:00	14.31	0.65	479584.6	40.19	0	0	28.7
21/03/2024 17:00	14.24	0.47	479883	40.53	0	0	27.8
21/03/2024 18:00	14.22	0.5	479344.2	40.56	0	0	27.2
21/03/2024 19:00	14.22	0.55	480318.2	40.76	0	0	27.3
21/03/2024 20:00	14.19	0.55	474516.7	40.3	0	0	27.2
21/03/2024 21:00	14.16	0.57	474470.3	40.36	0	0	26.9
21/03/2024 22:00	14.15	0.57	475664.2	40.56	0	0	26.5
21/03/2024 23:00	14.15	0.59	476975.5	40.7	0	0	26.7
21/03/2024 24:00	14.16	0.54	480515.9	41.05	0	0	27
Minimum	14.15	0.21	373219.7	26.51	0	0	26.5
MinDate	03/21/2024 22:00:00	03/21/2024 8:00:00	03/21/2024 13:00:00	03/21/2024 13:00:00	03/21/2024 1:00:00	03/21/2024 1:00:00	03/21/2024 22:00:00
Maximum	14.41	0.65	493108.3	42.91	0	0	33.9
MaxDate	03/21/2024 13:00:00	03/21/2024 16:00:00	03/21/2024 6:00:00	03/21/2024 6:00:00	03/21/2024 1:00:00	03/21/2024 1:00:00	03/21/2024 13:00:00
Avg	14.23	0.45	476184.9	40.39	0	0	28.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24104.8	3.3	0	0	1.7

Site ABPR52 Daily: 21/03/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
21/03/2024 01:00	Shutdown	0.85	Shutdown	13.87	Shutdown	Shutdown	Shutdown
21/03/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
21/03/2024 03:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
21/03/2024 04:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
21/03/2024 05:00	Shutdown	1.37	Shutdown	0	Shutdown	Shutdown	Shutdown
21/03/2024 06:00	Shutdown	1.12	Shutdown	0	Shutdown	Shutdown	Shutdown
21/03/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
21/03/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
21/03/2024 09:00	Shutdown	0.65	Shutdown	18.87	Shutdown	Shutdown	Shutdown
21/03/2024 10:00	14.85	0.22	484676.9	41.04	0	1.1	23.4
21/03/2024 11:00	14.86	0.19	480398.1	40.82	0	1.1	24
21/03/2024 12:00	14.89	0.25	474457.6	40.16	0	1.1	23.8
21/03/2024 13:00	15.04	0.37	369329.5	26.58	0	1.1	26.4
21/03/2024 14:00	15	0.53	495108.6	41.96	0	1.1	24.5
21/03/2024 15:00	14.98	0.61	490082	41.56	0	1.1	24.3
21/03/2024 16:00	14.98	0.57	483924	41	0	1	24.1
21/03/2024 17:00	14.87	0.44	477554.3	40.62	0	1	22.5
21/03/2024 18:00	14.87	0.61	477334.6	40.66	0	1	21.8
21/03/2024 19:00	14.87	0.7	478578.1	40.87	0	1	21.8
21/03/2024 20:00	14.82	0.6	472673.3	40.38	0	1	21.7
21/03/2024 21:00	14.78	0.59	472753.2	40.45	0	1	21.6
21/03/2024 22:00	14.77	0.47	475208.8	40.73	0	1	21.2
21/03/2024 23:00	14.72	0.32	475561.5	40.79	0	1	21.4
21/03/2024 24:00	14.76	0.51	480130.6	41.18	0	1	21.6
Minimum	14.72	0	369329.5	0	0	1	21.2
MinDate	03/21/2024 23:00:00	03/21/2024 2:00:00	03/21/2024 13:00:00	03/21/2024 2:00:00	03/21/2024 10:00:00	03/21/2024 16:00:00	03/21/2024 22:00:00
Maximum	15.04	1.37	495108.6	41.96	0	1.1	26.4
MaxDate	03/21/2024 13:00:00	03/21/2024 5:00:00	03/21/2024 14:00:00	03/21/2024 14:00:00	03/21/2024 10:00:00	03/21/2024 10:00:00	03/21/2024 13:00:00
Avg	14.87	0.47	472518.1	26.31	0	1	22.9
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	29241	18.7	0	0.1	1.5

Site ABPR51 Daily: 22/03/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
22/03/2024 01:00	14.24	0.5	455911.8	37.51	0	0	32.8
22/03/2024 02:00	14.2	0.44	493822.7	42.82	0	0	27.4
22/03/2024 03:00	14.19	0.43	493894.6	42.85	0	0	27.4
22/03/2024 04:00	14.19	0.41	493961.8	42.86	0	0	27.4
22/03/2024 05:00	14.17	0.43	493965.7	42.88	0	0	27.2
22/03/2024 06:00	14.17	0.41	495260.3	43.01	0	0	27.1
22/03/2024 07:00	14.16	0.47	493435.3	42.89	0	0	27.1



22/03/2024 08:00	14.16	0.54	493771	42.88	0	0	26.7
22/03/2024 09:00	14.19	0.31	460541.2	38.65	0	0	27.7
22/03/2024 10:00	14.23	0.34	479220.6	40.68	0	0	26.8
22/03/2024 11:00	14.26	0.41	481453.7	40.71	0	0	27.5
22/03/2024 12:00	14.27	0.42	485678.7	40.96	0	0	27.9
22/03/2024 13:00	14.37	0.15	373310.4	26.58	0	0	31.9
22/03/2024 14:00	14.19	0.31	483564	41.21	0	0	26.8
22/03/2024 15:00	14.16	0.48	478842.8	40.78	0	0	26
22/03/2024 16:00	14.22	0.45	484629.1	41.1	0	0	26.8
22/03/2024 17:00	14.22	0.42	485790.6	41.15	0	0	27.5
22/03/2024 18:00	14.22	0.36	487005.5	41.28	0	0	27.4
22/03/2024 19:00	14.19	0.28	474893.9	40.33	0	0	26.9
22/03/2024 20:00	14.15	0.31	481684.2	41.15	0	0	26.3
22/03/2024 21:00	14.15	0.3	479939.5	40.97	0	0	26.1
22/03/2024 22:00	14.15	0.3	479809.4	41	0	0	26.2
22/03/2024 23:00	14.15	0.36	476190.9	40.65	0	0	26.8
22/03/2024 24:00	14.15	0.41	476995.9	40.73	0	0	26.6
Minimum	14.15	0.15	373310.4	26.58	0	0	26
MinDate	03/22/2024 20:00:00	03/22/2024 13:00:00	03/22/2024 13:00:00	03/22/2024 13:00:00	03/22/2024 1:00:00	03/22/2024 1:00:00	03/22/2024 15:00:00
Maximum	14.37	0.54	495260.3	43.01	0	0	32.8
MaxDate	03/22/2024 13:00:00	03/22/2024 8:00:00	03/22/2024 6:00:00	03/22/2024 6:00:00	03/22/2024 1:00:00	03/22/2024 1:00:00	03/22/2024 1:00:00
Avg	14.2	0.39	478482.3	40.65	0	0	27.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24555.4	3.3	0	0	1.6
Site ABPR52 Daily: 22/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
22/03/2024 01:00	Shutdown	0.83	Shutdown	14.11	Shutdown	Shutdown	Shutdown
22/03/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
22/03/2024 03:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
22/03/2024 04:00	Shutdown	0.73	Shutdown	0	Shutdown	Shutdown	Shutdown
22/03/2024 05:00	Shutdown	2.24	Shutdown	0	Shutdown	Shutdown	Shutdown
22/03/2024 06:00	Shutdown	0.49	Shutdown	0	Shutdown	Shutdown	Shutdown
22/03/2024 07:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
22/03/2024 08:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
22/03/2024 09:00	Shutdown	1.09	Shutdown	19.32	Shutdown	Shutdown	Shutdown
22/03/2024 10:00	15	0.77	482352.6	40.77	0	1.2	21
22/03/2024 11:00	15.02	0.85	481328.4	40.8	0	1.2	22.2
22/03/2024 12:00	15.01	0.8	484181.3	41.06	0	1.2	22.3
22/03/2024 13:00	15.08	0.34	369761.2	26.73	0	1.2	24.4
22/03/2024 14:00	14.76	0.26	483033.3	41.28	0	1	21.6
22/03/2024 15:00	14.69	0.48	478093.9	40.87	0	1	20.9
22/03/2024 16:00	14.75	0.65	483511	41.22	0	1.1	21.7
22/03/2024 17:00	14.78	0.67	484288.5	41.24	0	1.1	22.2
22/03/2024 18:00	14.78	0.65	485230.9	41.37	0	1	22
22/03/2024 19:00	14.73	0.55	473399.1	40.43	0	1	21.6
22/03/2024 20:00	14.7	0.64	481018.5	41.25	0	1	21.1
22/03/2024 21:00	14.7	0.64	478779.6	41.06	0	1	21
22/03/2024 22:00	14.71	0.62	479003.3	41.1	0	1	21
22/03/2024 23:00	14.7	0.59	474828.5	40.72	0	1.1	21.6
22/03/2024 24:00	14.71	0.6	476577.6	40.84	0	1.1	21.4
Minimum	14.69	0	369761.2	0	0	1	20.9
MinDate	03/22/2024 15:00:00	03/22/2024 2:00:00	03/22/2024 13:00:00	03/22/2024 2:00:00	03/22/2024 10:00:00	03/22/2024 14:00:00	03/22/2024 15:00:00
Maximum	15.08	2.24	485230.9	41.37	0	1.2	24.4
MaxDate	03/22/2024 13:00:00	03/22/2024 5:00:00	03/22/2024 18:00:00	03/22/2024 18:00:00	03/22/2024 10:00:00	03/22/2024 10:00:00	03/22/2024 13:00:00
Avg	14.81	0.61	473025.8	26.42	0	1.1	21.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	28791.1	18.7	0	0.1	0.9
Site ABPR51 Daily: 23/03/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
23/03/2024 01:00	14.23	0.45	458585.4	37.94	0	0	30.7
23/03/2024 02:00	14.2	0.31	493499.4	42.81	0	0	27.4
23/03/2024 03:00	14.22	0.43	495119	42.84	0	0	28.1
23/03/2024 04:00	14.22	0.42	494545	42.86	0	0	28.4
23/03/2024 05:00	14.22	0.43	494787.3	42.86	0	0	28.6
23/03/2024 06:00	14.22	0.42	496048.8	43	0	0	28.7
23/03/2024 07:00	14.21	0.41	494746	42.9	0	0	28
23/03/2024 08:00	14.21	0.5	494689	42.9	0	0	27.4
23/03/2024 09:00	14.21	0.67	453552.5	37.54	0	0	29.5
23/03/2024 10:00	14.17	0.54	473898.8	40.19	0	0	25.7
23/03/2024 11:00	14.22	0.41	474195.1	39.92	0	0	26.7
23/03/2024 12:00	14.27	0.34	481151.7	40.41	0	0	27.5
23/03/2024 13:00	14.39	0.16	374734.6	26.73	0	0	31.7
23/03/2024 14:00	14.22	0.26	487484.3	41.36	0	0	28.4
23/03/2024 15:00	14.17	0.23	474407.4	40.18	0	0	25.1
23/03/2024 16:00	14.22	0.19	476718.9	40.14	0	0	26.4
23/03/2024 17:00	14.2	0.27	472828.4	39.92	0	0	26.2
23/03/2024 18:00	14.2	0.3	472010.8	39.83	0	0	26.3
23/03/2024 19:00	14.17	0.32	472336.9	40.03	0	0	26
23/03/2024 20:00	14.15	0.34	473010.2	40.16	0	0	25.8
23/03/2024 21:00	14.15	0.34	472060.5	40.11	0	0	25.9
23/03/2024 22:00	14.16	0.38	479347.6	40.88	0	0	26.1
23/03/2024 23:00	14.14	0.42	469519.1	39.9	0	0	26.3
23/03/2024 24:00	14.15	0.41	472063	40.12	0	0	26.2
Minimum	14.14	0.16	374734.6	26.73	0	0	25.1
MinDate	03/23/2024 23:00:00	03/23/2024 13:00:00	03/23/2024 13:00:00	03/23/2024 13:00:00	03/23/2024 1:00:00	03/23/2024 1:00:00	03/23/2024 15:00:00
Maximum	14.39	0.67	496048.8	43	0	0	31.7
MaxDate	03/23/2024 13:00:00	03/23/2024 9:00:00	03/23/2024 6:00:00	03/23/2024 6:00:00	03/23/2024 1:00:00	03/23/2024 1:00:00	03/23/2024 13:00:00
Avg	14.21	0.37	475055.8	40.23	0	0	27.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24506.8	3.3	0	0	1.7
Site ABPR52 Daily: 23/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
23/03/2024 01:00	Shutdown	0.87	Shutdown	13.62	Shutdown	Shutdown	Shutdown
23/03/2024 02:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
23/03/2024 03:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
23/03/2024 04:00	Shutdown	0.85	Shutdown	0	Shutdown	Shutdown	Shutdown
23/03/2024 05:00	Shutdown	2.35	Shutdown	0	Shutdown	Shutdown	Shutdown
23/03/2024 06:00	Shutdown	1.45	Shutdown	0	Shutdown	Shutdown	Shutdown
23/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
23/03/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
23/03/2024 09:00	<Samp	0.8	<Samp	20.51	<Samp	<Samp	<Samp
23/03/2024 10:00	14.83	0.52	476944.9	40.29	0	1.1	20.6
23/03/2024 11:00	14.86	0.47	473546.2	40.01	0	1.1	21.9
23/03/2024 12:00	14.9	0.63	479340.7	40.51	0	1.1	22.3
23/03/2024 13:00	15.02	0.6	371716.7	26.85	0	1.1	24
23/03/2024 14:00	14.83	0.66	487210.5	41.53	0	1	23.3
23/03/2024 15:00	14.75	0.67	472484.1	40.27	0	1	20.5
23/03/2024 16:00	14.79	0.6	474675.3	40.21	0	1	21.2
23/03/2024 17:00	14.76	0.6	471036.8	40.02	0	1	21.1
23/03/2024 18:00	14.76	0.58	470493.1	39.94	0	1	21.1



23/03/2024 19:00	14.75	0.52	471069.7	40.11	0	1	21
23/03/2024 20:00	14.73	0.5	471555	40.25	0	1	20.7
23/03/2024 21:00	14.73	0.46	470670	40.19	0	1	20.9
23/03/2024 22:00	14.75	0.45	478799.7	40.99	0	1	21.1
23/03/2024 23:00	14.73	0.41	468597.1	39.99	0	1	21.2
23/03/2024 24:00	14.74	0.5	470840.2	40.2	0	1	21
Minimum	14.73	0.01	371716.7	0	0	1	20.5
MinDate	03/23/2024 20:00:00	03/23/2024 7:00:00	03/23/2024 13:00:00	03/23/2024 2:00:00	03/23/2024 10:00:00	03/23/2024 14:00:00	03/23/2024 15:00:00
Maximum	15.02	2.35	487210.5	41.53	0	1.1	24
MaxDate	03/23/2024 13:00:00	03/23/2024 5:00:00	03/23/2024 14:00:00	03/23/2024 14:00:00	03/23/2024 10:00:00	03/23/2024 10:00:00	03/23/2024 13:00:00
Avg	14.8	0.61	467265.3	26.06	0	1	21.5
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.5	26867.4	18.4	0	0	1
Site ABPR51 Daily: 24/03/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
24/03/2024 01:00	14.13	0.45	420695.5	33.91	0	0	29.6
24/03/2024 02:00	14.05	0.45	409199.1	33.09	0	0	28.9
24/03/2024 03:00	14.04	0.47	410703.4	33.3	0	0	28.5
24/03/2024 04:00	14.07	0.43	404500.1	32.33	0	0	29.3
24/03/2024 05:00	14.09	0.38	401979.3	31.94	0	0	29.7
24/03/2024 06:00	14.09	0.4	400233.2	31.7	0	0	29.5
24/03/2024 07:00	14.11	0.36	394420.2	30.76	0	0	29.1
24/03/2024 08:00	14.19	0.33	385496.3	29.1	0	0	29.4
24/03/2024 09:00	14.25	0.21	382583.3	28.48	0	0	29.2
24/03/2024 10:00	14.25	0.24	387752.9	29.29	0	0	29.3
24/03/2024 11:00	14.28	0.26	387965.3	29.2	0	0	30.2
24/03/2024 12:00	14.28	0.26	390106.5	29.54	0	0	30.6
24/03/2024 13:00	14.32	0.22	385818.6	28.72	0	0	29.9
24/03/2024 14:00	14.23	0.1	388059.5	29.6	0	0	28.9
24/03/2024 15:00	14.19	0.51	386560	29.43	0	0	28.8
24/03/2024 16:00	14.24	0.36	384804.1	28.83	0	0	28.9
24/03/2024 17:00	14.24	0.28	388918.6	29.38	0	0	29
24/03/2024 18:00	14.22	0.19	393680.4	30.28	0	0	30.1
24/03/2024 19:00	14.22	0.28	431184.2	34.93	0	0	29.2
24/03/2024 20:00	14.12	0.36	449614.2	37.78	0	0	27.8
24/03/2024 21:00	14.1	0.38	450257.8	37.87	0	0	26.3
24/03/2024 22:00	14.1	0.41	449179.8	37.82	0	0	26.4
24/03/2024 23:00	14.09	0.43	450308.5	37.86	0	0	26.2
24/03/2024 24:00	14.28	0.33	377646.8	27.44	0	0	29.8
Minimum	14.04	0.1	377646.8	27.44	0	0	26.2
MinDate	03/24/2024 3:00:00	03/24/2024 14:00:00			03/24/2024 1:00:00	03/24/2024 1:00:00	03/24/2024 23:00:00
Maximum	14.32	0.51	450308.5	37.87	0	0	30.6
MaxDate	03/24/2024 13:00:00	03/24/2024 15:00:00	03/24/2024 23:00:00	03/24/2024 21:00:00	03/24/2024 1:00:00	03/24/2024 1:00:00	03/24/2024 12:00:00
Avg	14.17	0.34	404652.8	31.77	0	0	28.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24134.9	3.3	0	0	1.2
Site ABPR52 Daily: 24/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
24/03/2024 01:00	14.73	0.49	417945.6	34.01	0	1	24.1
24/03/2024 02:00	14.67	0.42	406526.2	33.16	0	1	23.7
24/03/2024 03:00	14.66	0.49	407795.6	33.37	0	1	23.2
24/03/2024 04:00	14.68	0.59	401261.2	32.42	0	1.1	23.7
24/03/2024 05:00	14.71	0.55	399426.3	32.02	0	1.1	23.9
24/03/2024 06:00	14.7	0.65	397634.3	31.77	0	1.1	23.7
24/03/2024 07:00	14.73	0.61	391702.8	30.83	0	1.1	23.2
24/03/2024 08:00	14.8	0.64	382283.4	29.18	0	1.1	23.1
24/03/2024 09:00	14.9	0.69	379492	28.57	0	1.1	22.5
24/03/2024 10:00	14.91	0.75	385024.7	29.36	0	1.1	22.6
24/03/2024 11:00	14.97	0.7	384897.2	29.27	0	1.1	23.5
24/03/2024 12:00	15.02	0.66	387244.4	29.61	0	1.1	24.1
24/03/2024 13:00	15.08	0.59	382444.2	28.79	0	1.1	22.7
24/03/2024 14:00	14.9	0.16	384345.5	29.67	0	1	22.5
24/03/2024 15:00	14.76	0.62	383360.4	29.5	0	1	22.6
24/03/2024 16:00	14.8	0.77	380886.8	28.9	0	1	22.1
24/03/2024 17:00	14.89	0.78	385127.5	29.45	0	1	22.5
24/03/2024 18:00	14.84	0.59	390514.3	30.34	0	1.1	24.3
24/03/2024 19:00	14.8	0.55	429059.1	34.97	0	1	23.8
24/03/2024 20:00	14.7	0.54	448034.7	37.87	0	1.1	23.2
24/03/2024 21:00	14.68	0.48	448032.2	37.96	0	1	21.6
24/03/2024 22:00	14.68	0.44	447970.3	37.91	0	1	21.5
24/03/2024 23:00	14.68	0.45	447872.4	37.96	0	1	21.5
24/03/2024 24:00	14.87	0.47	373251.3	27.49	0	1	23.3
Minimum	14.66	0.16	373251.3	27.49	0	1	21.5
MinDate	03/24/2024 3:00:00	03/24/2024 14:00:00			03/24/2024 1:00:00	03/24/2024 1:00:00	03/24/2024 22:00:00
Maximum	15.08	0.78	448034.7	37.96	0	1.1	24.3
MaxDate	03/24/2024 13:00:00	03/24/2024 17:00:00	03/24/2024 20:00:00	03/24/2024 21:00:00	03/24/2024 1:00:00	03/24/2024 4:00:00	03/24/2024 18:00:00
Avg	14.8	0.57	401755.5	31.85	0	1.1	23
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24717.9	3.4	0	0.1	0.8
Site ABPR51 Daily: 25/03/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
25/03/2024 01:00	14.24	0.26	380992.5	28.26	0	0	26.6
25/03/2024 02:00	14.21	0.33	383846.9	28.85	0	0	27.1
25/03/2024 03:00	14.22	0.33	382923.4	28.62	0	0	26.8
25/03/2024 04:00	14.2	0.3	384031.2	28.84	0	0	27
25/03/2024 05:00	14.26	0.3	376756	27.45	0	0	26.8
25/03/2024 06:00	14.23	0.3	381482.5	28.37	0	0	26.6
25/03/2024 07:00	14.22	0.32	382235.6	28.51	0	0	26.6
25/03/2024 08:00	14.21	0.45	384169.5	28.8	0	0	26.5
25/03/2024 09:00	14.19	0.3	407254	31.83	0	0	27.6
25/03/2024 10:00	14.15	0.35	463300.3	39.1	0	0	25.2
25/03/2024 11:00	14.17	0.36	462951	38.9	0	0	25.9
25/03/2024 12:00	14.22	0.42	462267.4	38.5	0	0	26.7
25/03/2024 13:00	14.49	0.24	367005.5	24.71	0	0	39.3
25/03/2024 14:00	14.21	0.24	461698.7	38.57	0	0	26
25/03/2024 15:00	14.16	0.24	463046.2	39	0	0	26.1
25/03/2024 16:00	14.22	0.37	465633.1	38.93	0	0	26.3
25/03/2024 17:00	14.22	0.33	464535.6	38.77	0	0	26.5
25/03/2024 18:00	14.2	0.42	458797.1	38.36	0	0	26.5
25/03/2024 19:00	14.15	0.34	458029.4	38.41	0	0	26.1
25/03/2024 20:00	14.11	0.35	454209.7	38.2	0	0	25.9
25/03/2024 21:00	14.1	0.3	454479.2	38.28	0	0	25.4
25/03/2024 22:00	14.1	0.36	457223.2	38.61	0	0	25.2
25/03/2024 23:00	14.1	0.38	457573	38.66	0	0	25.4
25/03/2024 24:00	14.11	0.32	458325.8	38.7	0	0	25.6
Minimum	14.1	0.24	367005.5	24.71	0	0	25.2
MinDate	03/25/2024 21:00:00	03/25/2024 13:00:00	03/25/2024 13:00:00	03/25/2024 13:00:00	03/25/2024 1:00:00	03/25/2024 1:00:00	03/25/2024 10:00:00
Maximum	14.49	0.45	465633.1	39.1	0	0	39.3
MaxDate	03/25/2024 13:00:00	03/25/2024 8:00:00	03/25/2024 16:00:00	03/25/2024 10:00:00	03/25/2024 1:00:00	03/25/2024 1:00:00	03/25/2024 13:00:00
Avg	14.2	0.33	428031.9	34.38	0	0	26.8



Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	39411.2	5.3	0	0	2.7
Site ABPRS2 Daily: 25/03/2024 Type: AVG							
Date & Time	52HRSG_O2	52HRSG_DUST	52HRSG_FLOW	GT_LOAD	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
	%VOL	MG/M3	MG/HR	MW			
25/03/2024 01:00	14.82	0.45	377374.8	28.33	0	1	19.7
25/03/2024 02:00	14.78	0.53	380780.1	28.92	0	1.1	20.6
25/03/2024 03:00	14.78	0.54	379309.9	28.68	0	1.1	20.2
25/03/2024 04:00	14.77	0.61	380285.4	28.92	0	1.1	20.5
25/03/2024 05:00	14.83	0.67	372323.1	27.52	0	1.1	19.5
25/03/2024 06:00	14.82	0.71	377809.8	28.44	0	1.1	19.7
25/03/2024 07:00	14.82	0.65	378822	28.58	0	1.1	19.8
25/03/2024 08:00	14.85	0.77	380195.9	28.88	0	1.1	19.7
25/03/2024 09:00	14.9	0.62	404691.8	31.95	0	1.2	21.2
25/03/2024 10:00	14.84	0.59	462084.6	39.19	0	1.1	19.7
25/03/2024 11:00	14.85	0.62	461237.3	38.99	0	1.1	20.4
25/03/2024 12:00	14.9	0.71	459499	38.57	0	1.1	21.1
25/03/2024 13:00	15.17	0.67	361926.3	24.79	0	1.2	33.2
25/03/2024 14:00	14.88	0.5	460429.9	38.68	0	1.1	20.4
25/03/2024 15:00	14.86	0.45	462404.5	39.11	0	1.2	20.3
25/03/2024 16:00	14.93	0.71	463324.6	39.02	0	1.2	20.5
25/03/2024 17:00	14.86	0.58	461902.5	38.86	0	1.3	20.8
25/03/2024 18:00	14.8	0.44	456898.3	38.45	0	1.2	21
25/03/2024 19:00	14.74	0.36	455405.3	38.51	0	1.2	20.8
25/03/2024 20:00	14.71	0.47	452275.8	38.27	0	1.2	20.7
25/03/2024 21:00	14.7	0.47	453093.3	38.38	0	1.3	20.3
25/03/2024 22:00	14.7	0.48	456398	38.71	0	1.2	20.1
25/03/2024 23:00	14.71	0.57	457133.1	38.73	0	1.3	20.3
25/03/2024 24:00	14.72	0.51	456985	38.79	0	1.3	20.3
Minimum	14.7	0.36	361926.3	24.79	0	1	19.5
MinDate	03/25/2024 21:00:00	03/25/2024 19:00:00	03/25/2024 13:00:00	03/25/2024 13:00:00	03/25/2024 1:00:00	03/25/2024 1:00:00	03/25/2024 5:00:00
Maximum	15.17	0.77	463324.6	39.19	0	1.3	33.2
MaxDate	03/25/2024 13:00:00	03/25/2024 8:00:00	03/25/2024 16:00:00	03/25/2024 10:00:00	03/25/2024 1:00:00	03/25/2024 17:00:00	03/25/2024 13:00:00
Avg	14.82	0.57	425524.6	34.47	0	1.2	20.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	40495.1	5.3	0	0.1	2.7
Site ABPRS1 Daily: 26/03/2024 Type: AVG							
Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
26/03/2024 01:00	14.16	0.26	408512.6	32.24	0	0	28.8
26/03/2024 02:00	14.1	0.28	400395.6	31.6	0	0	29
26/03/2024 03:00	14.12	0.36	395783.5	30.83	0	0	28.4
26/03/2024 04:00	14.15	0.36	392730	30.35	0	0	27.9
26/03/2024 05:00	14.16	0.33	389860.3	29.86	0	0	27.5
26/03/2024 06:00	14.1	0.36	399747.2	31.57	0	0	28.4
26/03/2024 07:00	14.05	0.35	405597.1	32.53	0	0	28.4
26/03/2024 08:00	14.15	0.28	392605.8	30.35	0	0	27.9
26/03/2024 09:00	14.22	0.17	406776	31.7	0	0	28.8
26/03/2024 10:00	14.17	0.31	459824.9	38.69	0	0	26.5
26/03/2024 11:00	14.2	0.32	459471.4	38.53	0	0	26.8
26/03/2024 12:00	14.22	0.36	472510.4	39.67	0	0	26.5
26/03/2024 13:00	14.47	0.21	368980.3	25.27	0	0	38.7
26/03/2024 14:00	14.25	0.33	466171.4	38.92	0	0	26.5
26/03/2024 15:00	14.25	0.25	471333.2	39.46	0	0	26.7
26/03/2024 16:00	14.22	0.28	472239.3	39.63	0	0	26.2
26/03/2024 17:00	14.22	0.42	473720	39.87	0	0	26.1
26/03/2024 18:00	14.21	0.35	472471	39.82	0	0	26.2
26/03/2024 19:00	14.16	0.51	465081.3	39.26	0	0	26.1
26/03/2024 20:00	14.15	0.53	467528.5	39.58	0	0	25.8
26/03/2024 21:00	14.12	0.51	454692.9	38.33	0	0	26
26/03/2024 22:00	14.13	0.51	460062.9	38.9	0	0	25.6
26/03/2024 23:00	14.14	0.53	466702.8	39.57	0	0	25.5
26/03/2024 24:00	14.13	0.48	463829.5	39.29	0	0	25.7
Minimum	14.05	0.17	368980.3	25.27	0	0	25.5
MinDate	03/26/2024 7:00:00	03/26/2024 9:00:00	03/26/2024 13:00:00	03/26/2024 13:00:00	03/26/2024 1:00:00	03/26/2024 1:00:00	03/26/2024 23:00:00
Maximum	14.47	0.53	473720	39.87	0	0	38.7
MaxDate	03/26/2024 13:00:00	03/26/2024 20:00:00	03/26/2024 17:00:00	03/26/2024 17:00:00	03/26/2024 1:00:00	03/26/2024 1:00:00	03/26/2024 13:00:00
Avg	14.18	0.36	436942.8	35.66	0	0	27.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	36265.8	4.5	0	0	2.6
Site ABPRS2 Daily: 26/03/2024 Type: AVG							
Date & Time	52HRSG_O2	52HRSG_DUST	52HRSG_FLOW	GT_LOAD	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
	%VOL	MG/M3	MG/HR	MW			
26/03/2024 01:00	14.74	0.56	405587.2	32.34	0	1.3	23.3
26/03/2024 02:00	14.71	0.6	397745.3	31.69	0	1.4	23.7
26/03/2024 03:00	14.74	0.69	392474.6	30.89	0	1.3	22.7
26/03/2024 04:00	14.75	0.66	389336.8	30.43	0	1.4	21.9
26/03/2024 05:00	14.76	0.65	385998.9	29.94	0	1.4	21.3
26/03/2024 06:00	14.71	0.65	397059.5	31.65	0	1.4	23.1
26/03/2024 07:00	14.68	0.61	402853.3	32.61	0	1.4	23.3
26/03/2024 08:00	14.77	0.53	389640.1	30.41	0	1.4	21.8
26/03/2024 09:00	14.87	0.44	404211.6	31.8	0	1.4	22.6
26/03/2024 10:00	14.82	0.42	459361.7	38.78	0	1.4	21.1
26/03/2024 11:00	14.83	0.55	458261.6	38.64	0	1.4	21.5
26/03/2024 12:00	14.87	0.64	470482.6	39.73	0	1.4	21.1
26/03/2024 13:00	15.09	0.68	364471.8	25.42	0	1.4	31.7
26/03/2024 14:00	14.92	0.73	463723.2	39	0	1.4	21.1
26/03/2024 15:00	14.88	0.64	468771.8	39.56	0	1.4	21.2
26/03/2024 16:00	14.84	0.54	469673.9	39.71	0	1.3	20.9
26/03/2024 17:00	14.83	0.43	471563.5	39.97	0	1.3	20.7
26/03/2024 18:00	14.8	0.39	470730.2	39.92	0	1.3	21
26/03/2024 19:00	14.76	0.31	462901.7	39.34	0	1.2	20.9
26/03/2024 20:00	14.75	0.37	466039.6	39.64	0	1.2	20.7
26/03/2024 21:00	14.73	0.45	453215.7	38.44	0	1.2	21
26/03/2024 22:00	14.74	0.46	458369.2	38.95	0	1.3	20.6
26/03/2024 23:00	14.75	0.66	465301.1	39.64	0	1.3	20.4
26/03/2024 24:00	14.74	0.67	462355.4	39.37	0	1.3	20.6
Minimum	14.68	0.31	364471.8	25.42	0	1.2	20.4
MinDate	03/26/2024 7:00:00	03/26/2024 19:00:00	03/26/2024 13:00:00	03/26/2024 13:00:00	03/26/2024 1:00:00	03/26/2024 19:00:00	03/26/2024 23:00:00
Maximum	15.09	0.73	471563.5	39.97	0	1.4	31.7
MaxDate	03/26/2024 13:00:00	03/26/2024 14:00:00	03/26/2024 17:00:00	03/26/2024 17:00:00	03/26/2024 1:00:00	03/26/2024 2:00:00	03/26/2024 13:00:00
Avg	14.8	0.56	434588.8	35.74	0	1.3	22
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	36982.7	4.5	0	0.1	2.3
Site ABPRS1 Daily: 27/03/2024 Type: AVG							
Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
27/03/2024 01:00	14.15	0.4	409942.8	32.56	0	0	28.7
27/03/2024 02:00	14.07	0.36	405849.7	32.62	0	0	28.6
27/03/2024 03:00	14.06	0.36	407548.3	32.84	0	0	28.2
27/03/2024 04:00	14.08	0.36	405193.6	32.45	0	0	28.7



27/03/2024 05:00	14.11	0.35	399368.8	31.44	0	0	28.8
27/03/2024 06:00	14.1	0.35	402352.9	31.97	0	0	29
27/03/2024 07:00	14.09	0.42	402167.3	31.89	0	0	28.8
27/03/2024 08:00	14.11	0.5	399276.8	31.5	0	0	28.7
27/03/2024 09:00	14.16	0.37	413166.7	32.87	0	0	29.6
27/03/2024 10:00	14.13	0.49	459259.9	38.87	0	0	26.2
27/03/2024 11:00	14.22	0.6	467941.1	39.42	0	0	26.5
27/03/2024 12:00	14.23	0.63	471739	39.74	0	0	26.6
27/03/2024 13:00	14.4	0.28	369552.8	25.88	0	0	34
27/03/2024 14:00	14.23	0.5	473655.6	39.98	0	0	26.5
27/03/2024 15:00	14.25	0.43	470993.3	39.53	0	0	27
27/03/2024 16:00	14.25	0.37	472044.5	39.66	0	0	26.5
27/03/2024 17:00	14.21	0.49	475651.6	40.19	0	0	25.8
27/03/2024 18:00	14.23	0.5	472777.2	39.73	0	0	26.7
27/03/2024 19:00	14.21	0.47	472698.4	39.92	0	0	26.7
27/03/2024 20:00	14.17	0.49	471151	39.92	0	0	26.1
27/03/2024 21:00	14.15	0.46	462143.5	39.07	0	0	26
27/03/2024 22:00	14.15	0.47	462714.7	39.18	0	0	25.8
27/03/2024 23:00	14.12	0.52	458825.5	38.81	0	0	25.9
27/03/2024 24:00	14.14	0.48	462814	39.17	0	0	25.7
Minimum	14.06	0.28	369552.8	25.88	0	0	25.7
MinDate	03/27/2024 3:00:00	03/27/2024 13:00:00	03/27/2024 13:00:00	03/27/2024 13:00:00	03/27/2024 1:00:00	03/27/2024 1:00:00	
Maximum	14.4	0.63	475651.6	40.19	0	0	34
MaxDate	03/27/2024 13:00:00	03/27/2024 12:00:00	03/27/2024 17:00:00	03/27/2024 17:00:00	03/27/2024 1:00:00	03/27/2024 1:00:00	03/27/2024 13:00:00
Avg	14.17	0.44	440367.9	36.22	0	0	27.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	34713.8	4.2	0	0	1.9
Site ABPR52 Daily: 27/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
27/03/2024 01:00	14.76	0.68	407051.1	32.58	0	1.3	23.3
27/03/2024 02:00	14.7	0.66	403469.2	32.7	0	1.3	23.7
27/03/2024 03:00	14.68	0.65	404721.7	32.91	0	1.3	23.2
27/03/2024 04:00	14.7	0.64	402897.7	32.53	0	1.3	23.4
27/03/2024 05:00	14.76	0.56	396613.2	31.52	0	1.4	23.4
27/03/2024 06:00	14.73	0.51	399385.7	32.04	0	1.4	23.6
27/03/2024 07:00	14.73	0.55	398976.9	31.97	0	1.4	23
27/03/2024 08:00	14.72	0.48	396776.1	31.57	0	1.4	23
27/03/2024 09:00	14.73	0.4	410151.3	32.92	0	1.3	24.1
27/03/2024 10:00	14.75	0.42	457403.9	38.95	0	1.4	21.1
27/03/2024 11:00	14.93	0.63	465359.7	39.49	0	1.4	21.4
27/03/2024 12:00	14.94	0.58	468900.2	39.84	0	1.4	21.3
27/03/2024 13:00	15.06	0.47	364243.9	25.96	0	1.4	27.1
27/03/2024 14:00	14.93	0.74	471544.5	40.06	0	1.4	21.1
27/03/2024 15:00	14.96	0.87	468334.4	39.61	0	1.4	21.6
27/03/2024 16:00	14.98	0.52	468972.4	39.73	0	1.4	21
27/03/2024 17:00	14.84	0.54	473145.3	40.28	0	1.3	20.5
27/03/2024 18:00	14.85	0.39	469352.4	39.81	0	1.3	21.4
27/03/2024 19:00	14.79	0.38	470070.1	40.01	0	1.3	21.5
27/03/2024 20:00	14.74	0.5	468595.2	40.02	0	1.2	21.1
27/03/2024 21:00	14.72	0.6	460522	39.17	0	1.3	21.2
27/03/2024 22:00	14.72	0.58	461083.4	39.26	0	1.3	21
27/03/2024 23:00	14.72	0.72	456806.2	38.88	0	1.3	20.9
27/03/2024 24:00	14.75	0.71	460800.6	39.26	0	1.3	20.5
Minimum	14.68	0.38	364243.9	25.96	0	1.2	20.5
MinDate	03/27/2024 3:00:00	03/27/2024 19:00:00	03/27/2024 13:00:00	03/27/2024 13:00:00	03/27/2024 1:00:00	03/27/2024 20:00:00	03/27/2024 17:00:00
Maximum	15.06	0.87	473145.3	40.28	0	1.4	27.1
MaxDate	03/27/2024 13:00:00	03/27/2024 15:00:00	03/27/2024 17:00:00	03/27/2024 17:00:00	03/27/2024 1:00:00	03/27/2024 5:00:00	03/27/2024 13:00:00
Avg	14.8	0.57	437715.7	36.29	0	1.3	22.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	35084.4	4.2	0	0.1	1.6
Site ABPR51 Daily: 28/03/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
28/03/2024 01:00	14.16	0.4	410193.7	32.49	0	0	29.1
28/03/2024 02:00	14.1	0.37	402480.3	31.98	0	0	29.2
28/03/2024 03:00	14.1	0.4	402470.6	32.05	0	0	29.2
28/03/2024 04:00	14.07	0.38	404652.7	32.43	0	0	28.4
28/03/2024 05:00	14.11	0.36	398946.5	31.42	0	0	28.8
28/03/2024 06:00	14.12	0.38	397845.6	31.24	0	0	28.7
28/03/2024 07:00	14.1	0.37	399911.1	31.58	0	0	29
28/03/2024 08:00	14.09	0.35	401060.8	31.78	0	0	28.4
28/03/2024 09:00	14.17	0.3	413685.7	32.83	0	0	28.3
28/03/2024 10:00	14.21	0.36	468755.8	39.46	0	0	26
28/03/2024 11:00	14.27	0.38	471873.7	39.51	0	0	27.6
28/03/2024 12:00	14.35	0.38	478277.3	39.82	0	0	28.1
28/03/2024 13:00	14.5	0.21	369845.3	25.64	0	0	35.2
28/03/2024 14:00	14.34	0.33	479476.1	39.89	0	0	28
28/03/2024 15:00	14.28	0.3	471821.2	39.24	0	0	27.2
28/03/2024 16:00	14.29	0.29	471887.2	39.3	0	0	27.4
28/03/2024 17:00	14.27	0.36	472811.3	39.55	0	0	27
28/03/2024 18:00	14.24	0.4	473647.9	39.8	0	0	27
28/03/2024 19:00	14.17	0.4	465931.9	39.31	0	0	26
28/03/2024 20:00	14.15	0.42	463204.6	39.16	0	0	25.6
28/03/2024 21:00	14.14	0.32	461296.3	38.95	0	0	25.4
28/03/2024 22:00	14.14	0.36	463692.4	39.21	0	0	25.4
28/03/2024 23:00	14.13	0.34	460058.1	38.88	0	0	25.4
28/03/2024 24:00	14.13	0.36	462980.2	39.2	0	0	25.1
Minimum	14.07	0.21	369845.3	25.64	0	0	25.1
MinDate	03/28/2024 4:00:00	03/28/2024 13:00:00	03/28/2024 13:00:00	03/28/2024 13:00:00	03/28/2024 1:00:00	03/28/2024 1:00:00	
Maximum	14.5	0.42	479476.1	39.89	0	0	35.2
MaxDate	03/28/2024 13:00:00	03/28/2024 20:00:00	03/28/2024 14:00:00	03/28/2024 14:00:00	03/28/2024 1:00:00	03/28/2024 1:00:00	03/28/2024 13:00:00
Avg	14.19	0.36	440283.5	36.03	0	0	27.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0	35760.9	4.3	0	0	2.1
Site ABPR52 Daily: 28/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
28/03/2024 01:00	14.8	0.66	406890.4	32.56	0	1.3	23.6
28/03/2024 02:00	14.73	0.57	399539	32.06	0	1.3	23.6
28/03/2024 03:00	14.71	0.48	399807	32.12	0	1.3	23.9
28/03/2024 04:00	14.69	0.49	401907.8	32.51	0	1.3	23.3
28/03/2024 05:00	14.77	0.54	396149.6	31.5	0	1.4	23
28/03/2024 06:00	14.76	0.48	394856.4	31.31	0	1.4	23.1
28/03/2024 07:00	14.71	0.48	396593.7	31.65	0	1.4	23.6
28/03/2024 08:00	14.72	0.63	397882.3	31.86	0	1.4	22.9
28/03/2024 09:00	14.83	0.7	410980.8	32.89	0	1.4	22
28/03/2024 10:00	14.93	0.82	466512.9	39.55	0	1.4	20.3
28/03/2024 11:00	14.99	0.84	468516.8	39.6	0	1.4	21.8
28/03/2024 12:00	15.08	0.86	473845.6	39.91	0	1.4	22
28/03/2024 13:00	15.26	0.57	364973.7	25.69	0	1.5	26.7
28/03/2024 14:00	15.02	0.59	475333.5	39.96	0	1.4	22.1
28/03/2024 15:00	14.92	0.65	467797.8	39.33	0	1.4	21.5



28/03/2024 16:00	14.89	0.65	467842.3	39.38	0	1.3	21.7
28/03/2024 17:00	14.86	0.58	470172.6	39.64	0	1.3	21.4
28/03/2024 18:00	14.83	0.49	471389	39.91	0	1.3	21.4
28/03/2024 19:00	14.75	0.41	464080.5	39.4	0	1.2	20.7
28/03/2024 20:00	14.72	0.47	462337.7	39.25	0	1.2	20.4
28/03/2024 21:00	14.72	0.46	460390	39.06	0	1.2	20.2
28/03/2024 22:00	14.72	0.44	462444.7	39.31	0	1.3	20
28/03/2024 23:00	14.72	0.41	459180.9	38.97	0	1.3	20.1
28/03/2024 24:00	14.72	0.45	461981.5	39.29	0	1.3	19.8
Minimum	14.69	0.41	364973.7	25.69	0	1.2	19.8
MinDate	03/28/2024 4:00:00	03/28/2024 19:00:00	03/28/2024 13:00:00	03/28/2024 13:00:00	03/28/2024 1:00:00	03/28/2024 19:00:00	
Maximum	15.26	0.86	475333.5	39.96	0	1.5	26.7
MaxDate	03/28/2024 13:00:00	03/28/2024 12:00:00	03/28/2024 14:00:00	03/28/2024 14:00:00	03/28/2024 1:00:00	03/28/2024 13:00:00	03/28/2024 13:00:00
Avg	14.83	0.57	437558.7	36.11	0	1.3	22
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	36084.7	4.3	0	0.1	1.6
Site ABPR51 Daily: 29/03/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
29/03/2024 01:00	14.15	0.32	411295.3	32.67	0	0	28.3
29/03/2024 02:00	14.08	0.32	404531.3	32.32	0	0	27.8
29/03/2024 03:00	14.08	0.35	403742.5	32.25	0	0	27.9
29/03/2024 04:00	14.1	0.32	399723.6	31.55	0	0	27.8
29/03/2024 05:00	14.12	0.31	396218.5	30.95	0	0	27.8
29/03/2024 06:00	14.1	0.36	399170.6	31.46	0	0	28.2
29/03/2024 07:00	14.1	0.25	400698.7	31.74	0	0	28.3
29/03/2024 08:00	14.1	0.28	399927.5	31.6	0	0	28.2
29/03/2024 09:00	14.18	0.26	397158	30.45	0	0	30.7
29/03/2024 10:00	14.08	0.23	414268	33.72	0	0	26.4
29/03/2024 11:00	14.11	0.18	416202.3	33.8	0	0	27.5
29/03/2024 12:00	14.15	0.22	418323.8	33.91	0	0	27.7
29/03/2024 13:00	<Samp	0.44	<Samp	21.33	<Samp	<Samp	<Samp
29/03/2024 14:00	14.33	0.41	473955.3	39.32	0	0	27.3
29/03/2024 15:00	14.28	0.26	471423.9	39.16	0	0	26.9
29/03/2024 16:00	14.26	0.23	469849	39.14	0	0	26.7
29/03/2024 17:00	14.23	0.33	463951.4	38.8	0	0	26.8
29/03/2024 18:00	14.22	0.31	463753.2	38.81	0	0	26.9
29/03/2024 19:00	14.21	0.38	466600.5	39.2	0	0	26.4
29/03/2024 20:00	14.16	0.39	462694.1	39.02	0	0	25.9
29/03/2024 21:00	14.14	0.34	462320.1	39.06	0	0	25.2
29/03/2024 22:00	14.13	0.35	463165.6	39.19	0	0	25.1
29/03/2024 23:00	14.13	0.43	463564.4	39.25	0	0	25
29/03/2024 24:00	14.14	0.49	467024.3	39.54	0	0	24.9
Minimum	14.08	0.18	396218.5	21.33	0	0	24.9
MinDate	03/29/2024 2:00:00	03/29/2024 11:00:00	03/29/2024 5:00:00	03/29/2024 13:00:00	03/29/2024 1:00:00	03/29/2024 1:00:00	
Maximum	14.33	0.49	473955.3	39.54	0	0	30.7
MaxDate	03/29/2024 14:00:00		03/29/2024 14:00:00		03/29/2024 1:00:00	03/29/2024 1:00:00	03/29/2024 9:00:00
Avg	14.16	0.32	434328.8	34.93	0	0	27.1
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	31808.8	4.6	0	0	1.4
Site ABPR52 Daily: 29/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
29/03/2024 01:00	14.73	0.45	408751.7	32.77	0	1.3	23
29/03/2024 02:00	14.68	0.56	401961.5	32.4	0	1.3	22.8
29/03/2024 03:00	14.7	0.54	401397.3	32.32	0	1.3	22.8
29/03/2024 04:00	14.7	0.57	396896.6	31.63	0	1.4	22.4
29/03/2024 05:00	14.74	0.66	393302.8	31.02	0	1.4	22.1
29/03/2024 06:00	14.75	0.7	396268.3	31.53	0	1.4	22.8
29/03/2024 07:00	14.77	0.52	398415	31.81	0	1.4	22.8
29/03/2024 08:00	14.8	0.72	397253.2	31.67	0	1.4	22.7
29/03/2024 09:00	14.88	0.64	394244.7	30.51	0	1.4	25.7
29/03/2024 10:00	14.77	0.57	411573.4	33.79	0	1.4	21.3
29/03/2024 11:00	14.8	0.47	413204.2	33.9	0	1.4	22.3
29/03/2024 12:00	14.83	0.51	414939.8	34	0	1.4	22.5
29/03/2024 13:00	<Samp	0.7	341959.3	21.35	0	1.5	55.8
29/03/2024 14:00	14.98	0.64	469906	39.37	0	1.4	21.6
29/03/2024 15:00	14.92	0.65	467436.9	39.27	0	1.4	21.4
29/03/2024 16:00	14.88	0.57	466447.1	39.23	0	1.3	21.1
29/03/2024 17:00	14.84	0.48	461675.5	38.9	0	1.3	21.3
29/03/2024 18:00	14.81	0.48	461947.3	38.9	0	1.3	21.5
29/03/2024 19:00	14.79	0.44	464460.9	39.31	0	1.3	21.1
29/03/2024 20:00	14.75	0.38	462283.1	39.16	0	1.2	20.5
29/03/2024 21:00	14.73	0.49	461702.3	39.23	0	1.2	20
29/03/2024 22:00	14.72	0.44	462171.6	39.28	0	1.2	19.8
29/03/2024 23:00	14.73	0.45	463096.3	39.38	0	1.3	19.7
29/03/2024 24:00	14.76	0.64	465503.9	39.66	0	1.3	19.6
Minimum	14.68	0.38	341959.3	21.35	0	1.2	19.6
MinDate	03/29/2024 2:00:00	03/29/2024 20:00:00	03/29/2024 13:00:00	03/29/2024 13:00:00	03/29/2024 1:00:00	03/29/2024 20:00:00	
Maximum	14.98	0.72	469906	39.66	0	1.5	55.8
MaxDate	03/29/2024 14:00:00	03/29/2024 8:00:00	03/29/2024 14:00:00		03/29/2024 1:00:00	03/29/2024 13:00:00	03/29/2024 13:00:00
Avg	14.79	0.55	428200	35.02	0	1.3	23.2
Num	23	24	24	24	24	24	24
Data[%]	96	100	100	100	100	100	100
STD	0.1	0.1	36401.7	4.6	0	0.1	7.1
Site ABPR51 Daily: 30/03/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
30/03/2024 01:00	14.16	0.39	410496.5	32.44	0	0	28.2
30/03/2024 02:00	14.09	0.36	402520.1	32.05	0	0	28
30/03/2024 03:00	14.09	0.39	401884	31.91	0	0	28
30/03/2024 04:00	14.13	0.35	396428.6	30.95	0	0	27.8
30/03/2024 05:00	14.15	0.33	392562.3	30.33	0	0	27.4
30/03/2024 06:00	14.13	0.38	394272.3	30.64	0	0	27.7
30/03/2024 07:00	14.14	0.38	392958.3	30.44	0	0	27.6
30/03/2024 08:00	14.18	0.29	387417.3	29.43	0	0	26.6
30/03/2024 09:00	14.25	0.26	392948.8	29.74	0	0	28.2
30/03/2024 10:00	14.12	0.25	429542.8	35.45	0	0	26.6
30/03/2024 11:00	14.15	0.27	428534	35.18	0	0	27.2
30/03/2024 12:00	14.18	0.26	430078.2	35.14	0	0	27.9
30/03/2024 13:00	14.64	0.24	349883.4	21.7	0	0	50.1
30/03/2024 14:00	14.15	0.31	433333.3	35.8	0	0	27
30/03/2024 15:00	14.11	0.24	430313.4	35.57	0	0	25.7
30/03/2024 16:00	14.22	0.3	432119.1	35.31	0	0	28.7
30/03/2024 17:00	14.22	0.27	434049.7	35.56	0	0	28.6
30/03/2024 18:00	14.17	0.34	431527.6	35.49	0	0	28
30/03/2024 19:00	14.12	0.29	430038.9	35.43	0	0	27.4
30/03/2024 20:00	14.09	0.31	429515.3	35.51	0	0	26.5
30/03/2024 21:00	14.09	0.29	427655.5	35.42	0	0	26.3
30/03/2024 22:00	14.08	0.31	426785.8	35.33	0	0	26.3
30/03/2024 23:00	14.09	0.34	428358.8	35.46	0	0	26.1
30/03/2024 24:00	14.08	0.41	429142.3	35.56	0	0	26.1
Minimum	14.08	0.24	349883.4	21.7	0	0	25.7
MinDate	03/30/2024 22:00:00	03/30/2024 13:00:00	03/30/2024 13:00:00	03/30/2024 13:00:00	03/30/2024 1:00:00	03/30/2024 1:00:00	03/30/2024 15:00:00



Maximum	14.64	0.41	434049.7	35.8	0	0	50.1
MaxDate	03/30/2024 13:00:00		03/30/2024 17:00:00	03/30/2024 14:00:00	03/30/2024 1:00:00	03/30/2024 1:00:00	03/30/2024 13:00:00
Avg	14.16	0.32	414265.3	33.16	0	0	28.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	21691.5	3.4	0	0	4.7
Site ABPRS2 Daily: 30/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
30/03/2024 01:00	14.79	0.62	406960.9	32.5	0	1.3	22.6
30/03/2024 02:00	14.7	0.63	399609.5	32.12	0	1.3	22.9
30/03/2024 03:00	14.7	0.7	398695.3	31.98	0	1.3	22.8
30/03/2024 04:00	14.74	0.7	393161	31.03	0	1.3	22.2
30/03/2024 05:00	14.74	0.64	389083.2	30.4	0	1.4	21.4
30/03/2024 06:00	14.73	0.61	390745.2	30.7	0	1.4	21.9
30/03/2024 07:00	14.74	0.58	389452.3	30.51	0	1.4	21.6
30/03/2024 08:00	14.79	0.52	383895.7	29.5	0	1.4	19.9
30/03/2024 09:00	14.92	0.63	389335.5	29.81	0	1.4	21.4
30/03/2024 10:00	14.88	0.62	427384.3	35.53	0	1.4	21.2
30/03/2024 11:00	14.89	0.62	425445.8	35.26	0	1.4	22.1
30/03/2024 12:00	14.91	0.7	426748.9	35.22	0	1.4	22.8
30/03/2024 13:00	15.31	0.85	344126.6	21.77	0	1.5	47.2
30/03/2024 14:00	14.83	0.67	430640.5	35.9	0	1.3	22.2
30/03/2024 15:00	14.74	0.59	427156.5	35.65	0	1.3	21.3
30/03/2024 16:00	14.85	0.54	428434.6	35.39	0	1.3	23.7
30/03/2024 17:00	14.84	0.41	430143.6	35.65	0	1.3	23.5
30/03/2024 18:00	14.76	0.37	428181.2	35.57	0	1.2	23
30/03/2024 19:00	14.71	0.47	427090.3	35.52	0	1.2	22.5
30/03/2024 20:00	14.67	0.51	426659	35.6	0	1.2	21.7
30/03/2024 21:00	14.65	0.65	425881.3	35.51	0	1.2	21.6
30/03/2024 22:00	14.65	0.6	424782.7	35.4	0	1.2	21.5
30/03/2024 23:00	14.66	0.62	426038.9	35.57	0	1.2	21.7
30/03/2024 24:00	14.66	0.66	426111.2	35.65	0	1.2	21.6
Minimum	14.65	0.37	344126.6	21.77	0	1.2	19.9
MinDate	03/30/2024 21:00:00	03/30/2024 18:00:00	03/30/2024 13:00:00	03/30/2024 13:00:00	03/30/2024 1:00:00	03/30/2024 18:00:00	03/30/2024 8:00:00
Maximum	15.31	0.85	430640.5	35.9	0	1.5	47.2
MaxDate	03/30/2024 13:00:00	03/30/2024 13:00:00	03/30/2024 14:00:00	03/30/2024 14:00:00	03/30/2024 1:00:00	03/30/2024 13:00:00	03/30/2024 13:00:00
Avg	14.79	0.6	411073.5	33.24	0	1.3	23.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	22217.7	3.4	0	0.1	5.2
Site ABPRS1 Daily: 31/03/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
31/03/2024 01:00	Shutdown	0.47	Shutdown	12.05	Shutdown	Shutdown	Shutdown
31/03/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 04:00	Shutdown	0.87	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 05:00	Shutdown	4.73	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 06:00	Shutdown	0.53	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 09:00	Shutdown	0.29	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 10:00	Shutdown	1.1	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 11:00	Shutdown	2.17	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 12:00	Shutdown	2.27	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 13:00	Shutdown	1.73	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 14:00	Shutdown	1.32	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 15:00	Shutdown	0.81	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 16:00	Shutdown	0.44	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 17:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
31/03/2024 18:00	Shutdown	0.2	Shutdown	3.13	Shutdown	Shutdown	Shutdown
31/03/2024 19:00	14.21	0.22	420007.4	33.2	0	0	27.2
31/03/2024 20:00	14.11	0.34	423394.6	34.68	0	0	25.7
31/03/2024 21:00	14.09	0.36	424422.6	34.89	0	0	25.6
31/03/2024 22:00	14.1	0.32	422898.7	34.73	0	0	26
31/03/2024 23:00	14.1	0.3	426357.1	35.11	0	0	25.9
31/03/2024 24:00	14.37	0.32	370628.2	26.09	0	0	31.8
Minimum	14.09	0.01	370628.2	0	0	0	25.6
MinDate	03/31/2024 21:00:00	03/31/2024 2:00:00		03/31/2024 2:00:00	03/31/2024 19:00:00	03/31/2024 19:00:00	03/31/2024 21:00:00
Maximum	14.37	4.73	426357.1	35.11	0	0	31.8
MaxDate		03/31/2024 5:00:00	03/31/2024 23:00:00	03/31/2024 23:00:00	03/31/2024 19:00:00	03/31/2024 19:00:00	
Avg	14.16	0.79	414618.1	8.91	0	0	27
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0.1	1.1	21650.5	14.6	0	0	2.4
Site ABPRS2 Daily: 31/03/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
31/03/2024 01:00	14.8	0.64	443983.6	36.66	0	1.3	23.8
31/03/2024 02:00	14.81	0.54	491669.4	42.77	0	1.3	20.1
31/03/2024 03:00	14.79	0.54	491434	42.83	0	1.3	20.2
31/03/2024 04:00	14.81	0.6	491214	42.78	0	1.4	20
31/03/2024 05:00	14.8	0.55	491292.4	42.77	0	1.4	20.2
31/03/2024 06:00	14.78	0.55	492101.3	42.85	0	1.4	20.3
31/03/2024 07:00	14.79	0.59	491104.5	42.75	0	1.4	20.3
31/03/2024 08:00	14.82	0.64	491575	42.76	0	1.4	20.1
31/03/2024 09:00	14.87	0.73	493197.2	42.73	0	1.4	20.6
31/03/2024 10:00	14.95	0.81	494579.4	42.64	0	1.4	22.2
31/03/2024 11:00	15.03	0.75	496397.2	42.58	0	1.4	23.5
31/03/2024 12:00	15.09	0.72	498534.6	42.6	0	1.4	24.6
31/03/2024 13:00	15.09	0.66	499555.3	42.59	0	1.4	24.8
31/03/2024 14:00	15.05	0.57	500312	42.63	0	1.4	24.6
31/03/2024 15:00	15.03	0.66	500425.3	42.62	0	1.3	24.5
31/03/2024 16:00	15.02	0.62	500904.5	42.65	0	1.3	24.2
31/03/2024 17:00	14.95	0.56	501863.5	42.89	0	1.3	23.7
31/03/2024 18:00	14.87	0.54	479800.7	40.69	0	1.2	23.6
31/03/2024 19:00	14.77	0.47	411533.9	33.08	0	1.2	24.7
31/03/2024 20:00	14.66	0.39	419381.9	34.76	0	1.2	22.1
31/03/2024 21:00	14.66	0.37	421384.7	34.96	0	1.2	21.8
31/03/2024 22:00	14.66	0.45	420091	34.81	0	1.2	22
31/03/2024 23:00	14.67	0.41	423307.4	35.19	0	1.2	21.8
31/03/2024 24:00	14.91	0.43	365475.3	26.2	0	1.3	25.6
Minimum	14.66	0.37	365475.3	26.2	0	1.2	20
MinDate	03/31/2024 20:00:00	03/31/2024 21:00:00			03/31/2024 1:00:00	03/31/2024 18:00:00	03/31/2024 4:00:00
Maximum	15.09	0.81	501863.5	42.89	0	1.4	25.6
MaxDate	03/31/2024 12:00:00	03/31/2024 10:00:00	03/31/2024 17:00:00	03/31/2024 17:00:00	03/31/2024 1:00:00	03/31/2024 4:00:00	
Avg	14.86	0.57	471296.6	39.99	0	1.3	22.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	39146.2	4.5	0	0.1	1.9



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 01/04/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
01/04/2024 01:00	14.34	0.24	374083.1	26.8	0	0	29.8
01/04/2024 02:00	14.27	0.26	381000	28.15	0	0	25.7
01/04/2024 03:00	14.28	0.26	380310.1	28.05	0	0	25.5
01/04/2024 04:00	14.25	0.25	381211.9	28.3	0	0	25.5
01/04/2024 05:00	14.27	0.21	378349.4	27.73	0	0	25.2
01/04/2024 06:00	14.14	0.31	394574.2	30.74	0	0	27.1
01/04/2024 07:00	14.2	0.28	386952.2	29.32	0	0	26.3
01/04/2024 08:00	14.29	0.16	376908.3	27.42	0	0	27.9
01/04/2024 09:00	14.14	0.24	446833.2	37.32	0	0	24.7
01/04/2024 10:00	14.17	0.29	450108.3	37.54	0	0	25.2
01/04/2024 11:00	14.24	0.32	458540	38.19	0	0	25.8
01/04/2024 12:00	14.29	0.31	463159	38.51	0	0	26.2
01/04/2024 13:00	14.53	0.21	365872.3	24.68	0	0	36.1
01/04/2024 14:00	14.31	0.23	466814.6	38.73	0	0	25.9
01/04/2024 15:00	14.3	0.31	464011.5	38.43	0	0	25.6
01/04/2024 16:00	14.24	0.32	464755.2	38.77	0	0	24.5
01/04/2024 17:00	14.26	0.26	470579.1	39.28	0	0	24.6
01/04/2024 18:00	14.22	0.21	471402.5	39.51	0	0	24.1
01/04/2024 19:00	14.17	0.21	465631.4	39.2	0	0	23.8
01/04/2024 20:00	14.16	0.25	465893.6	39.4	0	0	23.8
01/04/2024 21:00	14.12	0.23	458625.2	38.72	0	0	23.7
01/04/2024 22:00	14.12	0.27	458651	38.7	0	0	23.7
01/04/2024 23:00	14.11	0.25	454985.6	38.32	0	0	23.7
01/04/2024 24:00	14.13	0.43	461887.9	38.99	0	0	23.4
Minimum	14.11	0.16	365872.3	24.68	0	0	23.4
MinDate	04/01/2024 23:00:00	04/01/2024 8:00:00	04/01/2024 13:00:00	04/01/2024 13:00:00	04/01/2024 1:00:00	04/01/2024 1:00:00	
Maximum	14.53	0.43	471402.5	39.51	0	0	36.1
MaxDate	04/01/2024 13:00:00		04/01/2024 18:00:00	04/01/2024 18:00:00	04/01/2024 1:00:00	04/01/2024 1:00:00	04/01/2024 13:00:00
Avg	14.23	0.26	430880.8	34.62	0	0	25.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	40959.7	5.4	0	0	2.7
Site ABPR52 Daily: 01/04/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
01/04/2024 01:00	14.9	0.46	368804.8	26.87	0	1.4	23.2
01/04/2024 02:00	14.83	0.51	376921.8	28.22	0	1.4	19.4
01/04/2024 03:00	14.83	0.56	376163.6	28.12	0	1.4	19.2
01/04/2024 04:00	14.82	0.6	377603.7	28.38	0	1.4	19.4
01/04/2024 05:00	14.84	0.54	374250.3	27.8	0	1.4	18.6
01/04/2024 06:00	14.74	0.63	391613.1	30.82	0	1.4	22.3
01/04/2024 07:00	14.79	0.61	383182.7	29.4	0	1.5	20.7
01/04/2024 08:00	14.89	0.58	373235.6	27.53	0	1.5	22
01/04/2024 09:00	14.79	0.63	445865.8	37.44	0	1.4	20
01/04/2024 10:00	14.84	0.56	448545.2	37.62	0	1.4	20.7
01/04/2024 11:00	14.97	0.61	455702.6	38.3	0	1.4	21.1
01/04/2024 12:00	15.05	0.73	460220.3	38.61	0	1.4	21
01/04/2024 13:00	15.31	0.71	360945	24.74	0	1.5	29.6
01/04/2024 14:00	15.11	0.63	464449.7	38.82	0	1.4	20.3
01/04/2024 15:00	15.07	0.76	460404.7	38.53	0	1.4	20.5
01/04/2024 16:00	14.9	0.53	461992.5	38.85	0	1.3	19.8
01/04/2024 17:00	14.85	0.46	467836.7	39.39	0	1.3	19.8
01/04/2024 18:00	14.8	0.36	469073.6	39.62	0	1.3	19.5
01/04/2024 19:00	14.74	0.36	463501.8	39.28	0	1.3	19.4
01/04/2024 20:00	14.72	0.4	464976.9	39.47	0	1.3	19.3
01/04/2024 21:00	14.71	0.47	458083.5	38.8	0	1.3	19.1
01/04/2024 22:00	14.71	0.5	457754.2	38.78	0	1.3	19.2
01/04/2024 23:00	14.71	0.56	454072.8	38.41	0	1.3	19.3
01/04/2024 24:00	14.72	0.57	460553.6	39.07	0	1.3	19
Minimum	14.71	0.36	360945	24.74	0	1.3	18.6
MinDate	04/01/2024 21:00:00	04/01/2024 18:00:00	04/01/2024 13:00:00	04/01/2024 13:00:00	04/01/2024 1:00:00	04/01/2024 16:00:00	04/01/2024 5:00:00
Maximum	15.31	0.76	469073.6	39.62	0	1.5	29.6
MaxDate	04/01/2024 13:00:00	04/01/2024 15:00:00	04/01/2024 18:00:00	04/01/2024 18:00:00	04/01/2024 1:00:00	04/01/2024 7:00:00	04/01/2024 13:00:00
Avg	14.86	0.56	428156.5	34.7	0	1.4	20.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	41997.9	5.4	0	0.1	2.2
Site ABPR51 Daily: 02/04/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
02/04/2024 01:00	14.2	0.41	438168.3	35.59	0	0	29.7
02/04/2024 02:00	14.21	0.4	496553.2	42.79	0	0	24.1
02/04/2024 03:00	14.21	0.34	496220.1	42.89	0	0	24
02/04/2024 04:00	14.21	0.37	496085.8	42.91	0	0	24
02/04/2024 05:00	14.21	0.28	495731.6	42.93	0	0	24.1
02/04/2024 06:00	14.22	0.34	497220.6	43.02	0	0	24.4
02/04/2024 07:00	14.22	0.33	495925.2	42.92	0	0	24.5
02/04/2024 08:00	14.19	0.27	455814.6	38.08	0	0	25.5
02/04/2024 09:00	14.16	0.29	467266.6	39.59	0	0	24.2
02/04/2024 10:00	14.23	0.33	464654.2	39.05	0	0	26.1
02/04/2024 11:00	14.27	0.26	469533.5	39.36	0	0	26
02/04/2024 12:00	14.29	0.22	469049.5	39.04	0	0	26.2
02/04/2024 13:00	14.5	0.14	369076.9	25.34	0	0	35.8
02/04/2024 14:00	14.29	0.29	470209.7	39.13	0	0	25.4
02/04/2024 15:00	14.29	0.26	470906.3	39.17	0	0	25.8
02/04/2024 16:00	14.33	0.24	479889.3	40.01	0	0	26.3
02/04/2024 17:00	14.25	0.2	472209.8	39.53	0	0	25.2
02/04/2024 18:00	14.22	0.21	469048.7	39.46	0	0	24.5
02/04/2024 19:00	14.19	0.24	469061.1	39.59	0	0	24.4
02/04/2024 20:00	14.17	0.28	467941.9	39.63	0	0	24.3
02/04/2024 21:00	14.15	0.35	466251.8	39.53	0	0	24.1
02/04/2024 22:00	14.15	0.28	465785.7	39.47	0	0	24
02/04/2024 23:00	14.14	0.32	462694.8	39.22	0	0	23.9
02/04/2024 24:00	14.15	0.33	464837.7	39.42	0	0	23.8
Minimum	14.14	0.14	369076.9	25.34	0	0	23.8
MinDate	04/02/2024 23:00:00	04/02/2024 13:00:00	04/02/2024 13:00:00	04/02/2024 13:00:00	04/02/2024 1:00:00	04/02/2024 1:00:00	
Maximum	14.5	0.41	497220.6	43.02	0	0	35.8
MaxDate	04/02/2024 13:00:00	04/02/2024 1:00:00	04/02/2024 6:00:00	04/02/2024 6:00:00	04/02/2024 1:00:00	04/02/2024 1:00:00	04/02/2024 13:00:00
Avg	14.23	0.29	469589.1	39.49	0	0	25.4
Num	24	24	24	24	24	24	24



Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	26211.7	3.5	0	0	2.6
Site ABPR52 Daily: 02/04/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
02/04/2024 01:00	<Samp	0.96	<Samp	23.55	<Samp	<Samp	<Samp
02/04/2024 02:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
02/04/2024 03:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
02/04/2024 04:00	Shutdown	1.7	Shutdown	0	Shutdown	Shutdown	Shutdown
02/04/2024 05:00	Shutdown	6.96	Shutdown	0	Shutdown	Shutdown	Shutdown
02/04/2024 06:00	Shutdown	2.77	Shutdown	0	Shutdown	Shutdown	Shutdown
02/04/2024 07:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
02/04/2024 08:00	Shutdown	1.1	Shutdown	8.64	Shutdown	Shutdown	Shutdown
02/04/2024 09:00	14.87	0.53	473819.7	39.67	0	1.5	19
02/04/2024 10:00	14.92	0.59	466486.6	39.16	0	1.5	21.4
02/04/2024 11:00	14.97	0.69	469296.2	39.4	0	1.5	21.1
02/04/2024 12:00	14.99	0.74	468597.8	39.13	0	1.5	21.1
02/04/2024 13:00	15.16	0.7	365909.7	25.43	0	1.5	29.3
02/04/2024 14:00	14.94	0.62	468827.2	39.21	0	1.4	20.5
02/04/2024 15:00	14.91	0.62	468948	39.26	0	1.4	20.9
02/04/2024 16:00	14.91	0.49	477420.9	40.1	0	1.4	21.4
02/04/2024 17:00	14.85	0.4	470435.3	39.62	0	1.4	20.3
02/04/2024 18:00	14.81	0.39	468341.6	39.54	0	1.3	19.8
02/04/2024 19:00	14.78	0.39	468388.9	39.68	0	1.3	19.7
02/04/2024 20:00	14.76	0.42	467803.5	39.74	0	1.3	19.6
02/04/2024 21:00	14.75	0.5	466089.9	39.62	0	1.3	19.4
02/04/2024 22:00	14.75	0.47	465614.3	39.53	0	1.3	19.4
02/04/2024 23:00	14.73	0.57	462825.1	39.3	0	1.4	19.1
02/04/2024 24:00	14.74	0.56	464187.9	39.47	0	1.4	19.2
Minimum	14.73	0.23	365909.7	0	0	1.3	19
MinDate	04/02/2024 23:00:00	04/02/2024 2:00:00	04/02/2024 13:00:00	04/02/2024 2:00:00	04/02/2024 9:00:00	04/02/2024 18:00:00	04/02/2024 9:00:00
Maximum	15.16	6.96	477420.9	40.1	0	1.5	29.3
MaxDate	04/02/2024 13:00:00	04/02/2024 5:00:00	04/02/2024 16:00:00	04/02/2024 16:00:00	04/02/2024 9:00:00	04/02/2024 9:00:00	04/02/2024 13:00:00
Avg	14.87	0.96	462062.1	27.09	0	1.4	20.7
Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.1	1.4	25875.6	17.5	0	0.1	2.4
Site ABPR51 Daily: 03/04/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
03/04/2024 01:00	14.2	0.37	454046.3	37.05	0	0	27.3
03/04/2024 02:00	14.22	0.39	496075.5	42.85	0	0	24.6
03/04/2024 03:00	14.22	0.36	496052.4	42.93	0	0	24.6
03/04/2024 04:00	14.22	0.32	495663.8	42.94	0	0	24.7
03/04/2024 05:00	14.22	0.35	495841.2	42.93	0	0	24.8
03/04/2024 06:00	14.22	0.4	495086	42.96	0	0	24.7
03/04/2024 07:00	14.22	0.31	496244.9	43.07	0	0	24.7
03/04/2024 08:00	14.2	0.21	456271.9	38.19	0	0	26
03/04/2024 09:00	14.19	0.27	473512.2	40.22	0	0	24.1
03/04/2024 10:00	14.22	0.28	473084.6	39.94	0	0	24.6
03/04/2024 11:00	14.24	0.31	472907.7	39.76	0	0	25.3
03/04/2024 12:00	14.28	0.33	475874.5	39.82	0	0	25.8
03/04/2024 13:00	14.44	0.1	374187.6	26.08	0	0	31.9
03/04/2024 14:00	14.27	0.28	462793.9	38.59	0	0	25
03/04/2024 15:00	14.23	0.22	462229.8	38.49	0	0	25.1
03/04/2024 16:00	14.22	0.18	461513.7	38.61	0	0	25.1
03/04/2024 17:00	14.22	0.21	459032.9	38.46	0	0	25.2
03/04/2024 18:00	14.21	0.24	459252.2	38.57	0	0	25.1
03/04/2024 19:00	14.18	0.29	464742.7	39.25	0	0	24.5
03/04/2024 20:00	14.16	0.3	459764.5	38.86	0	0	24.8
03/04/2024 21:00	14.14	0.25	454653.7	38.38	0	0	24.6
03/04/2024 22:00	14.13	0.26	452552.4	38.16	0	0	24.5
03/04/2024 23:00	14.13	0.31	455891.8	38.57	0	0	24.3
03/04/2024 24:00	14.15	0.41	463340.7	39.26	0	0	24
Minimum	14.13	0.1	374187.6	26.08	0	0	24
MinDate	04/03/2024 22:00:00	04/03/2024 13:00:00	04/03/2024 13:00:00	04/03/2024 13:00:00	04/03/2024 1:00:00	04/03/2024 1:00:00	
Maximum	14.44	0.41	496244.9	43.07	0	0	31.9
MaxDate	04/03/2024 13:00:00		04/03/2024 7:00:00	04/03/2024 7:00:00	04/03/2024 1:00:00	04/03/2024 1:00:00	04/03/2024 13:00:00
Avg	14.21	0.29	467109	39.33	0	0	25.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	25388.6	3.4	0	0	1.6
Site ABPR52 Daily: 03/04/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
03/04/2024 01:00	<Samp	0.93	<Samp	23.71	<Samp	<Samp	<Samp
03/04/2024 02:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
03/04/2024 03:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
03/04/2024 04:00	Shutdown	0.56	Shutdown	0	Shutdown	Shutdown	Shutdown
03/04/2024 05:00	Shutdown	4.22	Shutdown	0	Shutdown	Shutdown	Shutdown
03/04/2024 06:00	Shutdown	7.34	Shutdown	0	Shutdown	Shutdown	Shutdown
03/04/2024 07:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
03/04/2024 08:00	Shutdown	0.94	Shutdown	8.92	Shutdown	Shutdown	Shutdown
03/04/2024 09:00	14.89	0.5	480848.4	40.32	0	1.5	18.9
03/04/2024 10:00	14.89	0.48	475730.3	40.1	0	1.5	20.2
03/04/2024 11:00	14.9	0.52	473579.5	39.93	0	1.5	20.7
03/04/2024 12:00	14.93	0.65	474791.7	39.82	0	1.5	21.4
03/04/2024 13:00	15.11	0.63	371787.4	26.26	0	1.5	25.3
03/04/2024 14:00	14.96	0.66	495115.5	41.79	0	1.5	22.1
03/04/2024 15:00	14.88	0.67	472155.1	39.72	0	1.4	20.8
03/04/2024 16:00	14.89	0.58	483761.8	40.89	0	1.4	21.2
03/04/2024 17:00	14.85	0.55	476859.5	40.33	0	1.4	21.1
03/04/2024 18:00	14.82	0.46	468027.8	39.63	0	1.4	20.4
03/04/2024 19:00	14.79	0.39	469157.3	39.81	0	1.4	20.1
03/04/2024 20:00	14.76	0.42	459628.8	38.94	0	1.4	20.1
03/04/2024 21:00	14.74	0.39	454754.8	38.47	0	1.3	20
03/04/2024 22:00	14.72	0.39	452445	38.26	0	1.3	19.9
03/04/2024 23:00	14.73	0.39	456175.3	38.66	0	1.4	19.8
03/04/2024 24:00	14.74	0.4	462735.7	39.37	0	1.4	19.4
Minimum	14.72	0.05	371787.4	0	0	1.3	18.9
MinDate	04/03/2024 22:00:00	04/03/2024 7:00:00	04/03/2024 13:00:00	04/03/2024 2:00:00	04/03/2024 9:00:00	04/03/2024 21:00:00	04/03/2024 9:00:00
Maximum	15.11	7.34	495115.5	41.79	0	1.5	25.3
MaxDate	04/03/2024 13:00:00	04/03/2024 6:00:00	04/03/2024 14:00:00	04/03/2024 14:00:00	04/03/2024 9:00:00	04/03/2024 9:00:00	04/03/2024 13:00:00
Avg	14.85	0.93	464222.2	27.29	0	1.4	20.7



Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.1	1.6	27161.1	17.6	0	0.1	1.5
Site ABPR51 Daily: 04/04/2024 Type: AVG							
Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
04/04/2024 01:00	14.22	0.42	453225.8	37.46	0	0	27.6
04/04/2024 02:00	14.22	0.39	495155	42.79	0	0	24.8
04/04/2024 03:00	14.22	0.45	495726.2	42.89	0	0	24.9
04/04/2024 04:00	14.22	0.37	495517.2	42.9	0	0	24.8
04/04/2024 05:00	14.22	0.36	495177.5	42.92	0	0	24.7
04/04/2024 06:00	14.22	0.46	496457.8	43.01	0	0	24.5
04/04/2024 07:00	14.22	0.46	495466.5	42.97	0	0	24.6
04/04/2024 08:00	14.21	0.36	456331.9	37.97	0	0	25
04/04/2024 09:00	14.16	0.31	465692.9	39.46	0	0	24.5
04/04/2024 10:00	14.2	0.21	469302.7	39.5	0	0	24.5
04/04/2024 11:00	14.19	0.32	469031	39.62	0	0	23.8
04/04/2024 12:00	14.14	0.27	462463.2	39.08	0	0	22.5
04/04/2024 13:00	14.35	0.17	367509.5	25.7	0	0	30.6
04/04/2024 14:00	14.18	0.26	474426.1	40.13	0	0	22.1
04/04/2024 15:00	14.15	0.28	468364.8	39.6	0	0	22.1
04/04/2024 16:00	14.14	0.23	464860	39.24	0	0	22.1
04/04/2024 17:00	14.15	0.24	469990	39.82	0	0	22.8
04/04/2024 18:00	14.14	0.24	465027.4	39.34	0	0	22.8
04/04/2024 19:00	14.17	0.28	463392.5	39.07	0	0	24.3
04/04/2024 20:00	14.15	0.3	458624.5	38.68	0	0	24.6
04/04/2024 21:00	14.14	0.28	457647.1	38.64	0	0	24.4
04/04/2024 22:00	14.15	0.35	460869.1	38.98	0	0	24.2
04/04/2024 23:00	14.14	0.42	461420.2	39.03	0	0	24.2
04/04/2024 24:00	14.13	0.39	458942.8	38.77	0	0	24.3
Minimum	14.13	0.17	367509.5	25.7	0	0	22.1
MinDate		04/04/2024 13:00:00	04/04/2024 13:00:00	04/04/2024 13:00:00	04/04/2024 1:00:00	04/04/2024 1:00:00	04/04/2024 14:00:00
Maximum	14.35	0.46	496457.8	43.01	0	0	30.6
MaxDate	04/04/2024 13:00:00	04/04/2024 6:00:00	04/04/2024 6:00:00	04/04/2024 6:00:00	04/04/2024 1:00:00	04/04/2024 1:00:00	04/04/2024 13:00:00
Avg	14.18	0.33	467525.9	39.48	0	0	24.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	25967.9	3.4	0	0	1.8
Site ABPR52 Daily: 04/04/2024 Type: AVG							

Date & Time	52HRSG_O2	52HRSG_DUST	52HRSG_FLOW	GT_LOAD	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
	%VOL	MG/M3	MG/HR	MW			
04/04/2024 01:00	<Samp	0.86	<Samp	23.76	<Samp	<Samp	<Samp
04/04/2024 02:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
04/04/2024 03:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
04/04/2024 04:00	Shutdown	0.39	Shutdown	0	Shutdown	Shutdown	Shutdown
04/04/2024 05:00	Shutdown	3	Shutdown	0	Shutdown	Shutdown	Shutdown
04/04/2024 06:00	Shutdown	2.47	Shutdown	0	Shutdown	Shutdown	Shutdown
04/04/2024 07:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
04/04/2024 08:00	Shutdown	0.84	Shutdown	9.03	Shutdown	Shutdown	Shutdown
04/04/2024 09:00	14.91	0.69	472549.5	39.55	0	1.6	19
04/04/2024 10:00	14.88	0.6	470331.2	39.61	0	1.6	19.9
04/04/2024 11:00	14.9	0.61	471147.3	39.7	0	1.5	20
04/04/2024 12:00	14.9	0.57	466358.6	39.15	0	1.5	20.1
04/04/2024 13:00	15.11	0.53	366086.2	25.79	0	1.6	23.1
04/04/2024 14:00	14.93	0.52	480031.9	40.49	0	1.5	21.4
04/04/2024 15:00	14.91	0.64	472587.5	39.71	0	1.5	20.3
04/04/2024 16:00	14.87	0.65	468262.7	39.38	0	1.4	20.1
04/04/2024 17:00	14.85	0.61	473363.3	39.95	0	1.4	20.6
04/04/2024 18:00	14.82	0.55	466388.5	39.43	0	1.4	19.7
04/04/2024 19:00	14.79	0.55	465961.6	39.43	0	1.3	19.6
04/04/2024 20:00	14.76	0.52	463173.3	39.28	0	1.3	19.6
04/04/2024 21:00	14.75	0.47	458825.9	38.87	0	1.4	19.7
04/04/2024 22:00	14.75	0.46	460603.1	39.02	0	1.3	19.4
04/04/2024 23:00	14.76	0.47	462028.2	39.2	0	1.3	19.6
04/04/2024 24:00	14.77	0.45	460936.6	39.1	0	1.3	19.4
Minimum	14.75	0.09	366086.2	0	0	1.3	19
MinDate	04/04/2024 21:00:00	04/04/2024 7:00:00	04/04/2024 13:00:00	04/04/2024 2:00:00	04/04/2024 9:00:00	04/04/2024 19:00:00	04/04/2024 9:00:00
Maximum	15.11	3	480031.9	40.49	0	1.6	23.1
MaxDate	04/04/2024 13:00:00	04/04/2024 5:00:00	04/04/2024 14:00:00	04/04/2024 14:00:00	04/04/2024 9:00:00	04/04/2024 9:00:00	04/04/2024 13:00:00
Avg	14.85	0.7	461164.7	27.1	0	1.4	20.1
Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.1	0.7	25983	17.5	0	0.1	1
Site ABPR51 Daily: 05/04/2024 Type: AVG							

Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
05/04/2024 01:00	14.22	0.4	445528.8	36.44	0	0	28.4
05/04/2024 02:00	14.22	0.39	496525.9	42.82	0	0	24.4
05/04/2024 03:00	14.22	0.4	495856.4	42.88	0	0	24.5
05/04/2024 04:00	14.22	0.37	495393.2	42.89	0	0	24.4
05/04/2024 05:00	14.22	0.33	495066.6	42.9	0	0	24.4
05/04/2024 06:00	14.22	0.43	495892.6	42.97	0	0	24.1
05/04/2024 07:00	14.21	0.53	495583.6	42.94	0	0	23.9
05/04/2024 08:00	14.21	0.27	455110.2	37.87	0	0	24.7
05/04/2024 09:00	14.14	0.22	461388.8	39.1	0	0	23.5
05/04/2024 10:00	14.2	0.3	461344.6	38.84	0	0	24.5
05/04/2024 11:00	14.15	0.22	454246.8	38.21	0	0	23.7
05/04/2024 12:00	14.14	0.25	456451.8	38.51	0	0	22.8
05/04/2024 13:00	14.4	0.15	364394	25.07	0	0	34.4
05/04/2024 14:00	14.16	0.32	465768.5	39.35	0	0	22.3
05/04/2024 15:00	14.15	0.27	462846.1	39.06	0	0	22
05/04/2024 16:00	14.15	0.27	462202.4	38.98	0	0	22.3
05/04/2024 17:00	14.15	0.25	463657.9	39.17	0	0	22.6
05/04/2024 18:00	14.15	0.22	465104.8	39.36	0	0	22.5
05/04/2024 19:00	14.14	0.3	467013.4	39.58	0	0	22.6
05/04/2024 20:00	14.14	0.35	464411.6	39.26	0	0	23.3
05/04/2024 21:00	14.12	0.3	456420.3	38.53	0	0	23.4
05/04/2024 22:00	14.1	0.3	453779.3	38.3	0	0	23.2
05/04/2024 23:00	14.1	0.28	456534.6	38.59	0	0	22.9
05/04/2024 24:00	14.1	0.33	458103.2	38.72	0	0	22.9
Minimum	14.1	0.15	364394	25.07	0	0	22
MinDate	04/05/2024 22:00:00	04/05/2024 13:00:00	04/05/2024 13:00:00	04/05/2024 13:00:00	04/05/2024 1:00:00	04/05/2024 1:00:00	04/05/2024 15:00:00
Maximum	14.4	0.53	496525.9	42.97	0	0	34.4
MaxDate	04/05/2024 13:00:00	04/05/2024 7:00:00	04/05/2024 2:00:00	04/05/2024 6:00:00	04/05/2024 1:00:00	04/05/2024 1:00:00	04/05/2024 13:00:00



Avg	14.18	0.31	464526	39.18	0	0	24.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	27034.4	3.6	0	0	2.6
Site ABPR52 Daily: 05/04/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
05/04/2024 01:00	<Samp	0.92	<Samp	24	<Samp	<Samp	<Samp
05/04/2024 02:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
05/04/2024 03:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
05/04/2024 04:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
05/04/2024 05:00	Shutdown	2.05	Shutdown	0	Shutdown	Shutdown	Shutdown
05/04/2024 06:00	Shutdown	3.22	Shutdown	0	Shutdown	Shutdown	Shutdown
05/04/2024 07:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
05/04/2024 08:00	Shutdown	0.76	Shutdown	9.26	Shutdown	Shutdown	Shutdown
05/04/2024 09:00	14.84	0.69	470763.3	39.37	0	1.5	18.2
05/04/2024 10:00	14.88	0.7	463202.2	38.92	0	1.5	20
05/04/2024 11:00	14.92	0.64	459018.8	38.46	0	1.5	20.4
05/04/2024 12:00	14.95	0.67	461378.9	38.62	0	1.5	20.4
05/04/2024 13:00	15.17	0.57	362195.8	25.13	0	1.6	27.2
05/04/2024 14:00	14.96	0.46	471238.4	39.48	0	1.5	20
05/04/2024 15:00	14.91	0.51	467464.5	39.2	0	1.5	19.8
05/04/2024 16:00	14.9	0.5	466437.5	39.1	0	1.5	20.2
05/04/2024 17:00	14.89	0.53	466527.2	39.19	0	1.4	20.5
05/04/2024 18:00	14.84	0.51	467781.5	39.44	0	1.4	20
05/04/2024 19:00	14.79	0.54	469820.8	39.83	0	1.4	19.1
05/04/2024 20:00	14.76	0.67	466119.8	39.54	0	1.4	18.7
05/04/2024 21:00	14.75	0.61	468470.7	39.82	0	1.4	18.5
05/04/2024 22:00	14.75	0.59	471706.3	40.15	0	1.4	18.4
05/04/2024 23:00	14.75	0.55	472549.8	40.31	0	1.4	18.3
05/04/2024 24:00	14.77	0.56	481275.9	41.12	0	1.4	18.3
Minimum	14.75	0.05	362195.8	0	0	1.4	18.2
MinDate	04/05/2024 21:00:00	04/05/2024 3:00:00	04/05/2024 13:00:00	04/05/2024 2:00:00	04/05/2024 9:00:00	04/05/2024 17:00:00	04/05/2024 9:00:00
Maximum	15.17	3.22	481275.9	41.12	0	1.6	27.2
MaxDate	04/05/2024 13:00:00	04/05/2024 6:00:00			04/05/2024 9:00:00	04/05/2024 13:00:00	04/05/2024 13:00:00
Avg	14.86	0.7	461622	27.12	0	1.5	19.9
Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.1	0.7	26996	17.5	0	0.1	2.1
Site ABPR51 Daily: 06/04/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
06/04/2024 01:00	14.2	0.38	452490.4	37.34	0	0	25.5
06/04/2024 02:00	14.22	0.37	495701.6	42.77	0	0	23.7
06/04/2024 03:00	14.22	0.32	496011.9	42.85	0	0	24.2
06/04/2024 04:00	14.22	0.31	495388.3	42.86	0	0	24.2
06/04/2024 05:00	14.22	0.28	495390.9	42.86	0	0	24.3
06/04/2024 06:00	14.22	0.27	495728.7	42.91	0	0	24.4
06/04/2024 07:00	14.22	0.31	495586.4	42.89	0	0	24.5
06/04/2024 08:00	14.23	0.22	457775.2	37.97	0	0	25.7
06/04/2024 09:00	14.14	0.2	430587.9	35.64	0	0	25.7
06/04/2024 10:00	14.16	0.22	430815.7	35.5	0	0	25.5
06/04/2024 11:00	14.16	0.23	430163.1	35.41	0	0	25.6
06/04/2024 12:00	14.17	0.28	435938.1	35.95	0	0	25.4
06/04/2024 13:00	14.56	0.22	351078.3	22.12	0	0	45.2
06/04/2024 14:00	14.1	0.32	428121	35.39	0	0	23.8
06/04/2024 15:00	14.09	0.25	427528.6	35.31	0	0	22.9
06/04/2024 16:00	14.09	0.21	431907.4	35.83	0	0	22.6
06/04/2024 17:00	14.1	0.28	434509.3	36.1	0	0	22.8
06/04/2024 18:00	14.09	0.23	433144.1	36.01	0	0	23.1
06/04/2024 19:00	14.08	0.31	431309.8	35.83	0	0	23.7
06/04/2024 20:00	14.09	0.35	434349.4	36.13	0	0	24.4
06/04/2024 21:00	14.09	0.31	431938.5	35.81	0	0	24.3
06/04/2024 22:00	14.09	0.37	429266.3	35.53	0	0	24.5
06/04/2024 23:00	14.09	0.36	429619.4	35.59	0	0	24.4
06/04/2024 24:00	14.09	0.36	431663.4	35.87	0	0	24.4
Minimum	14.08	0.2	351078.3	22.12	0	0	22.6
MinDate	04/06/2024 19:00:00	04/06/2024 9:00:00	04/06/2024 13:00:00	04/06/2024 13:00:00	04/06/2024 1:00:00	04/06/2024 1:00:00	04/06/2024 16:00:00
Maximum	14.56	0.38	496011.9	42.91	0	0	45.2
MaxDate	04/06/2024 13:00:00	04/06/2024 1:00:00	04/06/2024 3:00:00	04/06/2024 6:00:00	04/06/2024 1:00:00	04/06/2024 1:00:00	04/06/2024 13:00:00
Avg	14.16	0.29	446083.8	37.1	0	0	25.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	34423.8	4.4	0	0	4.4
Site ABPR52 Daily: 06/04/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
06/04/2024 01:00	<Samp	0.9	<Samp	23.16	<Samp	<Samp	<Samp
06/04/2024 02:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
06/04/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
06/04/2024 04:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
06/04/2024 05:00	Shutdown	1.54	Shutdown	0	Shutdown	Shutdown	Shutdown
06/04/2024 06:00	Shutdown	2.93	Shutdown	0	Shutdown	Shutdown	Shutdown
06/04/2024 07:00	0	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/04/2024 08:00	Shutdown	0.7	Shutdown	7.97	Shutdown	Shutdown	Shutdown
06/04/2024 09:00	14.85	0.6	435441.4	35.77	0	1.6	20.4
06/04/2024 10:00	14.86	0.64	431094	35.59	0	1.5	21.5
06/04/2024 11:00	14.88	0.64	429363.9	35.51	0	1.5	21.5
06/04/2024 12:00	14.89	0.72	435028.2	36.07	0	1.5	21
06/04/2024 13:00	15.29	0.79	345017.8	21.7	0	1.6	44.7
06/04/2024 14:00	14.85	0.6	428402.3	35.43	0	1.5	21.4
06/04/2024 15:00	14.76	0.45	425196.8	35.38	0	1.4	19.3
06/04/2024 16:00	14.83	0.42	433249.7	35.91	0	1.4	20.6
06/04/2024 17:00	14.83	0.41	435623.9	36.17	0	1.4	20.8
06/04/2024 18:00	14.79	0.46	434115.1	36.1	0	1.4	20.7
06/04/2024 19:00	14.73	0.49	430538.6	35.9	0	1.4	20.5
06/04/2024 20:00	14.71	0.6	433256	36.21	0	1.4	20
06/04/2024 21:00	14.7	0.64	429766.8	35.91	0	1.4	20
06/04/2024 22:00	14.7	0.6	426410.7	35.59	0	1.4	20.2
06/04/2024 23:00	14.71	0.65	427111.7	35.68	0	1.4	20.2
06/04/2024 24:00	14.72	0.64	430051.3	35.94	0	1.5	20.1
Minimum	14.7	0	345017.8	0	0	1.4	19.3
MinDate	04/06/2024 21:00:00	04/06/2024 7:00:00	04/06/2024 13:00:00	04/06/2024 2:00:00	04/06/2024 9:00:00	04/06/2024 15:00:00	04/06/2024 15:00:00
Maximum	15.29	2.93	435623.9	36.21	0	1.6	44.7



MaxDate	04/06/2024 13:00:00	04/06/2024 6:00:00	04/06/2024 17:00:00	04/06/2024 20:00:00	04/06/2024 9:00:00	04/06/2024 9:00:00	04/06/2024 13:00:00
Avg	14.82	0.65	425604.3	24.58	0	1.5	22.1
Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.1	0.6	21735.3	15.9	0	0.1	6.1
Site ABPR51 Daily: 07/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
07/04/2024 01:00	<Samp	0.45	<Samp	21.07	<Samp	<Samp	<Samp
07/04/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 04:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 05:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 18:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 19:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 20:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 21:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 22:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 23:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/04/2024 24:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	---	0.01	---	0	---	---	---
MinDate	04/07/2024 1:00:00	04/07/2024 2:00:00	04/07/2024 1:00:00	04/07/2024 2:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00
Maximum	---	0.45	---	21.07	---	---	---
MaxDate	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00
Avg	---	0.04	---	0.88	---	---	---
Num	0	24	0	24	0	0	0
Data[%]	---	100	---	100	---	---	---
STD	---	0.1	---	4.3	---	---	---
Site ABPR52 Daily: 07/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
07/04/2024 01:00	14.81	0.54	431603.4	35.32	0	1.5	22.1
07/04/2024 02:00	14.84	0.48	495820.4	42.84	0	1.5	19.6
07/04/2024 03:00	14.84	0.53	495173.7	42.91	0	1.5	19.8
07/04/2024 04:00	14.84	0.53	494924.3	42.92	0	1.5	19.8
07/04/2024 05:00	14.84	0.52	494560.5	42.89	0	1.5	19.7
07/04/2024 06:00	14.82	0.58	494059.5	42.86	0	1.5	19.7
07/04/2024 07:00	14.82	0.66	495280.4	43	0	1.5	19.7
07/04/2024 08:00	14.86	0.75	494703.2	42.84	0	1.5	19.5
07/04/2024 09:00	14.9	0.7	495341.5	42.75	0	1.5	19.9
07/04/2024 10:00	14.97	0.76	497850.4	42.73	0	1.5	21.8
07/04/2024 11:00	14.99	0.67	498564.7	42.7	0	1.5	22
07/04/2024 12:00	15.03	0.62	500231.9	42.72	0	1.5	22.1
07/04/2024 13:00	15.05	0.57	500387.4	42.75	0	1.5	21.9
07/04/2024 14:00	15.07	0.61	501269.4	42.75	0	1.5	21.6
07/04/2024 15:00	15.04	0.67	500366.2	42.73	0	1.5	21.2
07/04/2024 16:00	15.05	0.68	500654	42.74	0	1.5	21.1
07/04/2024 17:00	15.05	0.59	501097.4	42.77	0	1.5	21.4
07/04/2024 18:00	14.95	0.41	501687	43.06	0	1.4	22
07/04/2024 19:00	14.66	0.39	522870.1	47.34	0	1.3	31.7
07/04/2024 20:00	14.59	0.46	529885.4	48.26	0	1.3	32.3
07/04/2024 21:00	14.59	0.62	528651.8	48.27	0	1.3	32.3
07/04/2024 22:00	14.59	0.68	529198.7	48.33	0	1.4	32.3
07/04/2024 23:00	14.6	0.72	529658.2	48.34	0	1.4	32.3
07/04/2024 24:00	14.68	0.74	510798.2	45.54	0	1.5	26
Minimum	14.59	0.39	431603.4	35.32	0	1.3	19.5
MinDate	04/07/2024 20:00:00	04/07/2024 19:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 19:00:00	04/07/2024 8:00:00
Maximum	15.07	0.76	529885.4	48.34	0	1.5	32.3
MaxDate	04/07/2024 14:00:00	04/07/2024 10:00:00	04/07/2024 20:00:00	04/07/2024 23:00:00	04/07/2024 1:00:00	04/07/2024 1:00:00	04/07/2024 20:00:00
Avg	14.85	0.6	501859.9	43.72	0	1.5	23.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.2	0.1	19669	2.8	0	0.1	4.8
Site ABPR51 Daily: 08/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
08/04/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/04/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/04/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/04/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/04/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/04/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/04/2024 07:00	Shutdown	1.25	Shutdown	1.15	Shutdown	Shutdown	Shutdown
08/04/2024 08:00	14.39	11.14	361739.9	21.53	0.2	0	40
08/04/2024 09:00	14.22	1.22	459819.9	38.46	0	0	23.8
08/04/2024 10:00	14.22	1.08	466158.8	39.39	0	0	23
08/04/2024 11:00	14.22	1.05	465261.1	39.32	0	0	23.6
08/04/2024 12:00	14.25	1.07	463503.4	39.06	0	0	24.1
08/04/2024 13:00	14.44	1.01	363102.9	25.07	0	0	41.3
08/04/2024 14:00	14.23	1.24	465021.8	39.23	0	0	24.4
08/04/2024 15:00	14.22	1.19	467741.1	39.53	0	0	24.2
08/04/2024 16:00	14.22	1.04	470642.8	39.86	0	0	23.2
08/04/2024 17:00	14.22	1.13	474385.5	40.22	0	0	23
08/04/2024 18:00	14.19	1.17	465994.2	39.41	0	0	23.6
08/04/2024 19:00	14.2	1.3	477089.1	40.68	0	0	23
08/04/2024 20:00	14.24	1.39	476057	40.3	0	0	24.4
08/04/2024 21:00	14.22	1.45	472569.3	40	0	0	24.7
08/04/2024 22:00	14.21	1.51	469467.3	39.7	0	0	24
08/04/2024 23:00	14.19	1.6	469193.1	39.77	0	0	23.7
08/04/2024 24:00	14.16	1.36	460722.6	39.01	0	0	23.8
Minimum	14.16	0.01	361739.9	0	0	0	23
MinDate		04/08/2024 1:00:00	04/08/2024 8:00:00	04/08/2024 1:00:00	04/08/2024 9:00:00	04/08/2024 8:00:00	04/08/2024 10:00:00



Maximum	14.44	11.14	477089.1	40.68	0.2	0	41.3
MaxDate	04/08/2024 13:00:00	04/08/2024 8:00:00	04/08/2024 19:00:00	04/08/2024 19:00:00	04/08/2024 8:00:00	04/08/2024 8:00:00	04/08/2024 13:00:00
Avg	14.24	1.34	455792.3	26.74	0	0	25.8
Num	17	24	17	24	17	17	17
Data[%]	71	100	71	100	71	71	71
STD	0.1	2.2	35483.6	18	0	0	5.6
Site ABPR52 Daily: 08/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
08/04/2024 01:00	14.81	0.69	494458.8	42.82	0	1.5	19.6
08/04/2024 02:00	14.82	0.62	493954	42.84	0	1.5	19.6
08/04/2024 03:00	14.82	0.74	493840.1	42.86	0	1.5	19.5
08/04/2024 04:00	14.82	0.68	493308.6	42.85	0	1.5	19.4
08/04/2024 05:00	14.83	0.64	493863.8	42.89	0	1.5	19.4
08/04/2024 06:00	14.83	0.54	493427.3	42.89	0	1.5	19.5
08/04/2024 07:00	14.83	0.57	486685.7	42.14	0	1.5	19.6
08/04/2024 08:00	15	0.56	377761.9	27.91	0	1.6	28.3
08/04/2024 09:00	14.9	0.58	457760.4	38.57	0	1.5	19.7
08/04/2024 10:00	14.97	0.72	468348.5	39.51	0	1.5	20.8
08/04/2024 11:00	15.06	0.79	469118.2	39.39	0	1.5	22.3
08/04/2024 12:00	15.14	0.83	467900.6	39.1	0	1.5	23.3
08/04/2024 13:00	15.32	0.66	362246.1	25.13	0	1.6	32.3
08/04/2024 14:00	15.08	0.6	470893.4	39.3	0	1.5	23.5
08/04/2024 15:00	15.05	0.67	475112.1	39.61	0	1.4	23.6
08/04/2024 16:00	14.99	0.62	476144.3	39.87	0	1.4	22.4
08/04/2024 17:00	14.96	0.63	480788.6	40.32	0	1.3	22.1
08/04/2024 18:00	14.91	0.53	471917	39.64	0	1.3	22
08/04/2024 19:00	14.87	0.42	481425.2	40.75	0	1.3	21.2
08/04/2024 20:00	14.83	0.4	476144.2	40.4	0	1.3	20.3
08/04/2024 21:00	14.83	0.51	484610.3	41.3	0	1.3	20.3
08/04/2024 22:00	14.82	0.56	488150.4	41.66	0	1.3	20.1
08/04/2024 23:00	14.82	0.61	479444.5	40.9	0	1.3	19.3
08/04/2024 24:00	14.81	0.58	475645.5	40.53	0	1.4	19.1
Minimum	14.81	0.4	362246.1	25.13	0	1.3	19.1
MinDate	04/08/2024 1:00:00	04/08/2024 20:00:00	04/08/2024 13:00:00	04/08/2024 13:00:00	04/08/2024 1:00:00	04/08/2024 17:00:00	
Maximum	15.32	0.83	494458.8	42.89	0	1.6	32.3
MaxDate	04/08/2024 13:00:00	04/08/2024 12:00:00	04/08/2024 1:00:00	04/08/2024 5:00:00	04/08/2024 1:00:00	04/08/2024 8:00:00	04/08/2024 13:00:00
Avg	14.92	0.61	471372.8	39.72	0	1.4	21.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	32923.3	4.3	0	0.1	3.1
Site ABPR51 Daily: 09/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
09/04/2024 01:00	14.25	1.46	424354.4	26.32	0	0	29.6
09/04/2024 02:00	Shutdown	2.17	Shutdown	1.95	Shutdown	Shutdown	Shutdown
09/04/2024 03:00	Shutdown	2.2	Shutdown	1.92	Shutdown	Shutdown	Shutdown
09/04/2024 04:00	Shutdown	2.14	Shutdown	1.93	Shutdown	Shutdown	Shutdown
09/04/2024 05:00	Shutdown	2.04	Shutdown	4.65	Shutdown	Shutdown	Shutdown
09/04/2024 06:00	14.38	1.23	358103.3	23.9	0	0	36.7
09/04/2024 07:00	14.36	1.08	302247.2	27.18	0.4	0	34.2
09/04/2024 08:00	14.21	1.25	470359.4	39.33	0	0	25.7
09/04/2024 09:00	14.2	1.17	472300.8	40.11	0	0	24.2
09/04/2024 10:00	14.24	1.13	467702.5	39.32	0	0	24.2
09/04/2024 11:00	14.18	1.09	465871.4	39.48	0	0	22.4
09/04/2024 12:00	14.2	1.1	469570.1	39.73	0	0	21.9
09/04/2024 13:00	14.36	0.86	369018.4	26.08	0	0	30.3
09/04/2024 14:00	14.18	1.06	474249.3	40.2	0	0	21.6
09/04/2024 15:00	14.17	1.1	471843.1	39.92	0	0	21.4
09/04/2024 16:00	14.16	1.06	472247.3	40.02	0	0	21.2
09/04/2024 17:00	14.16	1.14	476537.2	40.52	0	0	21.3
09/04/2024 18:00	14.15	1.19	476297.8	40.51	0	0	21.4
09/04/2024 19:00	14.15	1.28	474573.7	40.37	0	0	21.8
09/04/2024 20:00	14.18	1.28	466382.9	39.38	0	0	23.3
09/04/2024 21:00	14.19	1.29	466937.5	39.48	0	0	23.6
09/04/2024 22:00	14.18	1.28	467018.3	39.49	0	0	23.6
09/04/2024 23:00	14.16	1.19	466739.8	39.5	0	0	23.6
09/04/2024 24:00	14.16	1.3	465625.9	39.44	0	0	23.4
Minimum	14.15	0.86	302247.2	1.92	0	0	21.2
MinDate	04/09/2024 18:00:00	04/09/2024 13:00:00	04/09/2024 7:00:00	04/09/2024 3:00:00	04/09/2024 1:00:00	04/09/2024 1:00:00	04/09/2024 16:00:00
Maximum	14.38	2.2	476537.2	40.52	0.4	0	36.7
MaxDate	04/09/2024 6:00:00	04/09/2024 3:00:00	04/09/2024 17:00:00	04/09/2024 17:00:00	04/09/2024 7:00:00	04/09/2024 1:00:00	04/09/2024 6:00:00
Avg	14.21	1.34	448899.1	31.28	0	0	24.8
Num	20	24	20	24	20	20	20
Data[%]	83	100	83	100	83	83	83
STD	0.1	0.4	48262.7	14.1	0.1	0	4.4
Site ABPR52 Daily: 09/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
09/04/2024 01:00	<Samp	1.09	<Samp	23.41	<Samp	<Samp	<Samp
09/04/2024 02:00	Shutdown	0.33	Shutdown	0	Shutdown	Shutdown	Shutdown
09/04/2024 03:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
09/04/2024 04:00	Shutdown	0.48	Shutdown	0	Shutdown	Shutdown	Shutdown
09/04/2024 05:00	Shutdown	3.8	Shutdown	0	Shutdown	Shutdown	Shutdown
09/04/2024 06:00	Shutdown	2.27	Shutdown	0	Shutdown	Shutdown	Shutdown
09/04/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
09/04/2024 08:00	Shutdown	0.57	Shutdown	8.26	Shutdown	Shutdown	Shutdown
09/04/2024 09:00	14.87	0.56	477362.3	40.18	0	1.5	19.3
09/04/2024 10:00	14.93	0.57	470006.5	39.45	0	1.6	19.8
09/04/2024 11:00	15	0.67	471723	39.54	0	1.6	20.2
09/04/2024 12:00	15.07	0.81	476441.2	39.82	0	1.6	20.4
09/04/2024 13:00	15.17	0.62	367785.6	26.16	0	1.6	22
09/04/2024 14:00	14.96	0.62	479456.4	40.36	0	1.5	20.1
09/04/2024 15:00	14.94	0.68	478332.2	40.15	0	1.5	20
09/04/2024 16:00	14.92	0.53	477374.6	40.15	0	1.5	19.6
09/04/2024 17:00	14.9	0.47	481054.4	40.61	0	1.4	19.4
09/04/2024 18:00	14.88	0.42	479194	40.61	0	1.4	19.1
09/04/2024 19:00	14.84	0.45	481278.6	40.92	0	1.4	19.1
09/04/2024 20:00	14.84	0.63	494047.1	42.2	0	1.4	19.9
09/04/2024 21:00	14.84	0.64	492188.7	42.11	0	1.4	20
09/04/2024 22:00	14.83	0.69	492020.8	42.13	0	1.4	19.8
09/04/2024 23:00	14.83	0.69	496912.2	42.59	0	1.4	20.2
09/04/2024 24:00	14.81	0.6	493252.8	42.23	0	1.4	19.7
Minimum	14.81	0	367785.6	0	0	1.4	19.1



MinDate		04/09/2024 7:00:00	04/09/2024 13:00:00	04/09/2024 2:00:00	04/09/2024 9:00:00	04/09/2024 17:00:00	04/09/2024 18:00:00
Maximum	15.17	3.8	496912.2	42.59	0	1.6	22
MaxDate	04/09/2024 13:00:00	04/09/2024 5:00:00	04/09/2024 23:00:00	04/09/2024 23:00:00	04/09/2024 9:00:00	04/09/2024 10:00:00	04/09/2024 13:00:00
Avg	14.91	0.76	475526.9	27.95	0	1.5	19.9
Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.1	0.8	29917.3	18.2	0	0.1	0.7
Site ABPR51 Daily: 10/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
10/04/2024 01:00	14.24	1.23	453861.8	36.33	0	0	26.5
10/04/2024 02:00	14.28	1.11	497571.6	42.82	0	0	26.1
10/04/2024 03:00	14.28	1.36	496957	42.87	0	0	27
10/04/2024 04:00	14.28	1.12	496053.7	42.88	0	0	26.4
10/04/2024 05:00	14.27	1.17	495579.2	42.89	0	0	25.9
10/04/2024 06:00	14.24	1.19	495823.6	42.91	0	0	25.2
10/04/2024 07:00	14.22	1.18	496301.9	42.98	0	0	24.2
10/04/2024 08:00	14.2	1.12	459583.9	38.55	0	0	25.1
10/04/2024 09:00	14.2	1.18	477509.5	40.61	0	0	22.9
10/04/2024 10:00	14.22	1.3	474507.5	40.11	0	0	23.3
10/04/2024 11:00	14.26	1.3	473920.4	39.81	0	0	23.8
10/04/2024 12:00	14.27	1.41	479712.2	40.37	0	0	23.7
10/04/2024 13:00	14.35	1.22	372888.7	26.58	0	0	28.4
10/04/2024 14:00	14.18	0.88	473959.9	40.2	0	0	21
10/04/2024 15:00	14.17	0.9	475813.3	40.51	0	0	21.4
10/04/2024 16:00	14.16	1.3	471458.2	40.43	0	0	24.4
10/04/2024 17:00	14.19	1.2	472441.8	40.3	0	0	24.8
10/04/2024 18:00	14.26	1.18	472816.5	39.94	0	0	25.9
10/04/2024 19:00	14.28	1.19	484184.3	40.98	0	0	25.8
10/04/2024 20:00	14.23	1.27	485066	41.3	0	0	23.6
10/04/2024 21:00	14.21	1.31	479212.4	40.81	0	0	23
10/04/2024 22:00	14.21	1.3	482045.9	41.08	0	0	23.3
10/04/2024 23:00	14.19	1.26	478545.4	40.75	0	0	23.1
10/04/2024 24:00	14.2	1.18	484333.2	41.36	0	0	23
Minimum	14.16	0.88	372888.7	26.58	0	0	21
MinDate	04/10/2024 16:00:00	04/10/2024 14:00:00	04/10/2024 13:00:00	04/10/2024 13:00:00	04/10/2024 1:00:00	04/10/2024 1:00:00	04/10/2024 14:00:00
Maximum	14.35	1.41	497571.6	42.98	0	0	28.4
MaxDate	04/10/2024 13:00:00	04/10/2024 12:00:00	04/10/2024 2:00:00	04/10/2024 7:00:00	04/10/2024 1:00:00	04/10/2024 1:00:00	04/10/2024 13:00:00
Avg	14.23	1.2	476256.1	40.31	0	0	24.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	24872.9	3.3	0	0	1.8
Site ABPR52 Daily: 10/04/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
10/04/2024 01:00	<Samp	0.87	<Samp	24.63	<Samp	<Samp	<Samp
10/04/2024 02:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
10/04/2024 03:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
10/04/2024 04:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
10/04/2024 05:00	Shutdown	2.72	Shutdown	0	Shutdown	Shutdown	Shutdown
10/04/2024 06:00	Shutdown	5.58	Shutdown	0	Shutdown	Shutdown	Shutdown
10/04/2024 07:00	Shutdown	2.59	Shutdown	0	Shutdown	Shutdown	Shutdown
10/04/2024 08:00	Shutdown	1.06	Shutdown	9.02	Shutdown	Shutdown	Shutdown
10/04/2024 09:00	14.9	0.68	490140.8	41.21	0	1.5	18.2
10/04/2024 10:00	14.91	0.82	478167.7	40.31	0	1.5	19.2
10/04/2024 11:00	15	0.83	480159.4	40.45	0	1.6	19.5
10/04/2024 12:00	15.02	0.81	493376.4	41.83	0	1.5	22.7
10/04/2024 13:00	15.2	0.82	374375	26.94	0	1.6	22.8
10/04/2024 14:00	15.05	0.28	498102.7	42.11	0	1.5	21
10/04/2024 15:00	15.05	0.25	496069.8	42.11	0	1.5	20.3
10/04/2024 16:00	14.81	0.38	487522	41.92	0	1.4	22
10/04/2024 17:00	14.82	0.58	489692.9	41.99	0	1.4	22
10/04/2024 18:00	14.88	0.69	491671.5	42.06	0	1.4	22.5
10/04/2024 19:00	14.87	0.79	489323.9	41.73	0	1.4	21.9
10/04/2024 20:00	14.81	0.68	483519	41.42	0	1.4	19.1
10/04/2024 21:00	14.77	0.6	478293	40.91	0	1.4	18.6
10/04/2024 22:00	14.77	0.65	481156.9	41.16	0	1.4	18.9
10/04/2024 23:00	14.77	0.7	476989.1	40.84	0	1.4	18.6
10/04/2024 24:00	14.77	0.55	483301.8	41.46	0	1.5	18.5
Minimum	14.77	0.05	374375	0	0	1.4	18.2
MinDate	04/10/2024 21:00:00	04/10/2024 3:00:00	04/10/2024 13:00:00	04/10/2024 2:00:00	04/10/2024 9:00:00	04/10/2024 16:00:00	04/10/2024 9:00:00
Maximum	15.2	5.58	498102.7	42.11	0	1.6	22.8
MaxDate	04/10/2024 13:00:00	04/10/2024 6:00:00	04/10/2024 14:00:00	04/10/2024 14:00:00	04/10/2024 9:00:00	04/10/2024 11:00:00	04/10/2024 13:00:00
Avg	14.9	0.97	479491.4	28.42	0	1.5	20.4
Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.1	1.2	28790.8	18.4	0	0.1	1.7
Site ABPR51 Daily: 11/04/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
11/04/2024 01:00	14.23	1.1	456870	37.77	0	0	26.4
11/04/2024 02:00	14.22	1.03	495367.7	42.81	0	0	23.7
11/04/2024 03:00	14.22	0.98	495559.3	42.9	0	0	23.9
11/04/2024 04:00	14.22	0.91	494412.7	42.92	0	0	23.7
11/04/2024 05:00	14.22	1	495206.6	42.91	0	0	23.6
11/04/2024 06:00	14.22	0.98	495897.9	43	0	0	23.5
11/04/2024 07:00	14.22	1.04	495225.2	42.94	0	0	23.6
11/04/2024 08:00	14.2	0.95	457885.1	38.45	0	0	24.7
11/04/2024 09:00	14.18	0.95	471707.5	40.16	0	0	22.7
11/04/2024 10:00	14.23	0.94	468610.8	39.67	0	0	23.2
11/04/2024 11:00	14.28	1.04	469510.7	39.56	0	0	23.7
11/04/2024 12:00	14.32	1.04	473784	39.57	0	0	24.8
11/04/2024 13:00	14.49	0.92	371532.5	25.46	0	0	30.5
11/04/2024 14:00	14.33	1.02	476229.1	39.7	0	0	24.2
11/04/2024 15:00	14.13	0.95	457297.4	38.68	0	0	21.5
11/04/2024 16:00	14.12	0.96	455307.4	38.39	0	0	21.1
11/04/2024 17:00	14.12	0.92	453724.1	38.27	0	0	21.3
11/04/2024 18:00	14.1	1	450064.5	37.94	0	0	21.9
11/04/2024 19:00	14.13	1.11	450223.3	37.95	0	0	23.1
11/04/2024 20:00	14.14	1.17	450497.2	37.98	0	0	23.8
11/04/2024 21:00	14.14	1.12	446532.8	37.57	0	0	24.3
11/04/2024 22:00	14.14	1.11	445931.3	37.5	0	0	24.3
11/04/2024 23:00	14.12	1.09	444801.2	37.38	0	0	24.2
11/04/2024 24:00	14.12	1.05	445157.7	37.4	0	0	24



Minimum	14.1	0.91	371532.5	25.46	0	0	21.1
MinDate	04/11/2024 18:00:00	04/11/2024 4:00:00	04/11/2024 13:00:00	04/11/2024 13:00:00	04/11/2024 1:00:00	04/11/2024 1:00:00	04/11/2024 16:00:00
Maximum	14.49	1.17	495897.9	43	0	0	30.5
MaxDate	04/11/2024 13:00:00	04/11/2024 20:00:00	04/11/2024 6:00:00	04/11/2024 6:00:00	04/11/2024 1:00:00	04/11/2024 1:00:00	04/11/2024 13:00:00
Avg	14.2	1.02	463222.3	39.04	0	0	23.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	27186.6	3.6	0	0	1.9
Site ABPR52 Daily: 11/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
11/04/2024 01:00	<Samp	0.82	<Samp	24.65	<Samp	<Samp	<Samp
11/04/2024 02:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
11/04/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/04/2024 04:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
11/04/2024 05:00	Shutdown	1.15	Shutdown	0	Shutdown	Shutdown	Shutdown
11/04/2024 06:00	Shutdown	1.92	Shutdown	0	Shutdown	Shutdown	Shutdown
11/04/2024 07:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
11/04/2024 08:00	Shutdown	1.02	Shutdown	8.68	Shutdown	Shutdown	Shutdown
11/04/2024 09:00	14.94	0.66	480012.3	40.43	0	1.6	17.9
11/04/2024 10:00	15.06	0.61	471723.2	39.83	0	1.6	18.7
11/04/2024 11:00	15.12	0.6	474171.5	40.03	0	1.7	19.2
11/04/2024 12:00	15.1	0.54	481062.5	40.37	0	1.6	20.5
11/04/2024 13:00	15.25	0.61	367290.4	25.73	0	1.7	25.5
11/04/2024 14:00	15.03	0.59	478129.5	40.11	0	1.6	19.7
11/04/2024 15:00	14.9	0.46	461100.9	38.81	0	1.5	19.1
11/04/2024 16:00	14.89	0.67	458959.3	38.51	0	1.5	18.8
11/04/2024 17:00	14.92	0.5	456856.3	38.36	0	1.5	19
11/04/2024 18:00	14.82	0.41	451874.6	38.03	0	1.4	19.3
11/04/2024 19:00	14.72	0.28	450813.1	38.02	0	1.4	19.2
11/04/2024 20:00	14.7	0.35	450175.7	38.06	0	1.4	19.5
11/04/2024 21:00	14.7	0.47	446364.7	37.66	0	1.4	19.8
11/04/2024 22:00	14.7	0.67	445416.8	37.59	0	1.4	19.8
11/04/2024 23:00	14.7	0.63	443958.4	37.45	0	1.4	19.7
11/04/2024 24:00	14.69	0.63	444132.6	37.47	0	1.5	19.7
Minimum	14.69	0	367290.4	0	0	1.4	17.9
MinDate		04/11/2024 3:00:00	04/11/2024 13:00:00	04/11/2024 2:00:00	04/11/2024 9:00:00	04/11/2024 18:00:00	04/11/2024 9:00:00
Maximum	15.25	1.92	481062.5	40.43	0	1.7	25.5
MaxDate	04/11/2024 13:00:00	04/11/2024 6:00:00	04/11/2024 12:00:00	04/11/2024 9:00:00	04/11/2024 9:00:00	04/11/2024 11:00:00	04/11/2024 13:00:00
Avg	14.89	0.58	453877.6	26.66	0	1.5	19.7
Num	16	24	16	24	16	16	16
Data[%]	67	100	67	100	67	67	67
STD	0.2	0.4	26675	17.2	0	0.1	1.7
Site ABPR51 Daily: 12/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
12/04/2024 01:00	14.15	1.12	452370.3	38.03	0	0	28.1
12/04/2024 02:00	13.98	1.16	529423.6	48.29	0	0	34.2
12/04/2024 03:00	13.98	1.16	529071.8	48.35	0	0	34.4
12/04/2024 04:00	13.98	1.1	529433.3	48.37	0	0	34.4
12/04/2024 05:00	14.01	1.09	528362.3	48.33	0	0	35.1
12/04/2024 06:00	14.01	1.14	528669.3	48.35	0	0	35.2
12/04/2024 07:00	14	1.15	529449.1	48.43	0	0	35.2
12/04/2024 08:00	14	1.04	528383.4	48.28	0	0	35.1
12/04/2024 09:00	14.02	1	527281.1	48.22	0	0	34.9
12/04/2024 10:00	14.03	0.99	527797	48.19	0	0	34.9
12/04/2024 11:00	14.03	0.95	527719.8	48.16	0	0	34.8
12/04/2024 12:00	14.03	0.96	528808.3	48.14	0	0	34.8
12/04/2024 13:00	14.05	0.96	527897.8	47.96	0	0	34.5
12/04/2024 14:00	14.05	0.92	526678	47.74	0	0	33.8
12/04/2024 15:00	14.03	0.88	525464.8	47.62	0	0	33
12/04/2024 16:00	14.03	0.97	526256.8	47.79	0	0	33.9
12/04/2024 17:00	14.03	0.99	527055.4	47.87	0	0	33.9
12/04/2024 18:00	14.07	1.03	487453.9	42.62	0	0	31.6
12/04/2024 19:00	14.1	1.05	438597.9	36.85	0	0	23.2
12/04/2024 20:00	14.06	1.08	434496.4	36.4	0	0	22.8
12/04/2024 21:00	14.05	1.1	434710.6	36.44	0	0	22.7
12/04/2024 22:00	14.06	1.06	439561.5	36.99	0	0	22.4
12/04/2024 23:00	14.04	1.04	439174	36.96	0	0	22.2
12/04/2024 24:00	<Samp	1.17	<Samp	21.68	<Samp	<Samp	<Samp
Minimum	13.98	0.88	434496.4	21.68	0	0	22.2
MinDate	04/12/2024 2:00:00	04/12/2024 15:00:00	04/12/2024 20:00:00		04/12/2024 1:00:00	04/12/2024 1:00:00	04/12/2024 23:00:00
Maximum	14.15	1.17	529449.1	48.43	0	0	35.2
MaxDate	04/12/2024 1:00:00		04/12/2024 7:00:00	04/12/2024 7:00:00	04/12/2024 1:00:00	04/12/2024 1:00:00	04/12/2024 6:00:00
Avg	14.03	1.05	503222.5	44	0	0	31.5
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0	0.1	39551	6.8	0	0	5
Site ABPR52 Daily: 12/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
12/04/2024 01:00	<Samp	0.91	<Samp	23.89	<Samp	<Samp	<Samp
12/04/2024 02:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 03:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 04:00	Shutdown	0.23	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 05:00	Shutdown	1.35	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 06:00	Shutdown	1.34	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 09:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 10:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 11:00	Shutdown	1.06	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 12:00	Shutdown	1.93	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 13:00	Shutdown	2.17	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 14:00	Shutdown	2.11	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 15:00	Shutdown	1.65	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 16:00	Shutdown	1.49	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 17:00	Shutdown	0.99	Shutdown	0	Shutdown	Shutdown	Shutdown
12/04/2024 18:00	Shutdown	0.8	Shutdown	9.64	Shutdown	Shutdown	Shutdown
12/04/2024 19:00	14.77	0.44	446164.6	36.9	0	1.4	20.1
12/04/2024 20:00	14.7	0.56	437370.8	36.5	0	1.3	20.7
12/04/2024 21:00	14.68	0.59	436679.8	36.56	0	1.4	20.1
12/04/2024 22:00	14.69	0.59	441147.4	37.07	0	1.4	19.8
12/04/2024 23:00	14.68	0.56	440729	37.03	0	1.4	19.5



12/04/2024 24:00	14.74	0.52	447444.1	37.43	0	1.5	24.3
Minimum	14.68	0	436679.8	0	0	1.3	19.5
MinDate	04/12/2024 21:00:00	04/12/2024 7:00:00	04/12/2024 21:00:00	04/12/2024 2:00:00	04/12/2024 19:00:00	04/12/2024 20:00:00	04/12/2024 23:00:00
Maximum	14.77	2.17	447444.1	37.43	0	1.5	24.3
MaxDate	04/12/2024 19:00:00	04/12/2024 13:00:00			04/12/2024 19:00:00		
Avg	14.71	0.83	441589.3	10.63	0	1.4	20.8
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.7	4432.9	16.3	0	0.1	1.8

Site ABPR51 Daily: 13/04/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
13/04/2024 01:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 05:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 06:00	Shutdown	0.51	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 07:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 08:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 09:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 10:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 11:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 12:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 13:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 14:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 15:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 16:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/04/2024 18:00	Shutdown	0.84	Shutdown	9.35	Shutdown	Shutdown	Shutdown
13/04/2024 19:00	14.12	0.96	438556.4	36.28	0	0	22.2
13/04/2024 20:00	14.13	0.98	432044.4	35.77	0	0	23.8
13/04/2024 21:00	14.1	0.98	431582.3	35.76	0	0	23.7
13/04/2024 22:00	14.09	0.99	429689.3	35.61	0	0	23.7
13/04/2024 23:00	14.08	1.01	431019.3	35.91	0	0	23.2
13/04/2024 24:00	14.09	1.04	448127.5	37.68	0	0	26.8
Minimum	14.08	0.01	429689.3	0	0	0	22.2
MinDate	04/13/2024 23:00:00	04/13/2024 2:00:00	04/13/2024 22:00:00	04/13/2024 1:00:00	04/13/2024 19:00:00	04/13/2024 19:00:00	04/13/2024 19:00:00
Maximum	14.13	1.04	448127.5	37.68	0	0	26.8
MaxDate	04/13/2024 20:00:00				04/13/2024 19:00:00	04/13/2024 19:00:00	
Avg	14.1	0.35	435169.9	9.43	0	0	23.9
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.4	7061.6	15.9	0	0	1.5

Site ABPR52 Daily: 13/04/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
13/04/2024 01:00	14.59	0.56	531073.6	48.4	0	1.5	31.5
13/04/2024 02:00	14.58	0.57	531099.4	48.48	0	1.5	31.9
13/04/2024 03:00	14.58	0.63	530707.9	48.52	0	1.5	31.9
13/04/2024 04:00	14.59	0.71	530955.8	48.55	0	1.5	31.9
13/04/2024 05:00	14.58	0.72	531207	48.61	0	1.5	32
13/04/2024 06:00	14.58	0.78	530481.1	48.61	0	1.5	32
13/04/2024 07:00	14.59	0.8	531775.6	48.62	0	1.5	31.9
13/04/2024 08:00	14.61	0.82	531580.3	48.58	0	1.5	31.7
13/04/2024 09:00	14.68	0.77	530582.5	48.48	0	1.6	31.6
13/04/2024 10:00	14.71	0.76	530733.7	48.47	0	1.6	32
13/04/2024 11:00	14.73	0.77	530377	48.37	0	1.5	32
13/04/2024 12:00	14.78	0.78	529896.7	48.22	0	1.5	31.6
13/04/2024 13:00	14.72	0.71	528614.3	48.13	0	1.5	31.5
13/04/2024 14:00	14.69	0.74	530007.9	48.24	0	1.5	32.1
13/04/2024 15:00	14.65	0.7	530011.9	48.29	0	1.5	32.3
13/04/2024 16:00	14.64	0.7	530419.5	48.32	0	1.4	32.5
13/04/2024 17:00	14.64	0.64	530903.2	48.39	0	1.4	32.7
13/04/2024 18:00	14.66	0.47	493304.5	43.45	0	1.4	29.2
13/04/2024 19:00	14.65	0.41	432452.8	36.35	0	1.4	19.7
13/04/2024 20:00	14.66	0.39	429253.6	35.85	0	1.4	20.4
13/04/2024 21:00	14.66	0.46	428923.9	35.86	0	1.4	20.2
13/04/2024 22:00	14.65	0.58	427301.3	35.69	0	1.4	20
13/04/2024 23:00	14.67	0.64	430576.8	36.03	0	1.4	19.7
13/04/2024 24:00	<Samp	1.02	<Samp	22.1	<Samp	<Samp	<Samp
Minimum	14.58	0.39	427301.3	22.1	0	1.4	19.7
MinDate	04/13/2024 2:00:00	04/13/2024 20:00:00	04/13/2024 22:00:00		04/13/2024 1:00:00	04/13/2024 16:00:00	04/13/2024 19:00:00
Maximum	14.78	1.02	531775.6	48.62	0	1.6	32.7
MaxDate	04/13/2024 12:00:00		04/13/2024 7:00:00	04/13/2024 7:00:00	04/13/2024 1:00:00	04/13/2024 9:00:00	04/13/2024 17:00:00
Avg	14.65	0.67	507054	44.53	0	1.5	29.2
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0.1	0.1	42407.4	7	0	0.1	5

Site ABPR51 Daily: 14/04/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
14/04/2024 01:00	13.97	1.18	529292.9	48.22	0	0	33.6
14/04/2024 02:00	13.97	1.12	528575.1	48.25	0	0	33.6
14/04/2024 03:00	13.97	1.12	528120.6	48.3	0	0	33.6
14/04/2024 04:00	13.97	1.07	527871.5	48.27	0	0	33.7
14/04/2024 05:00	13.97	1.12	527744.4	48.26	0	0	33.4
14/04/2024 06:00	13.97	1.07	527689.1	48.31	0	0	33.6
14/04/2024 07:00	13.97	1.11	529047.4	48.36	0	0	33.8
14/04/2024 08:00	13.97	1.05	528649.8	48.3	0	0	33.6
14/04/2024 09:00	13.98	0.97	527522.4	48.17	0	0	33.2
14/04/2024 10:00	14.01	1.01	527253.7	48.06	0	0	33.1
14/04/2024 11:00	14.03	0.99	527685.8	48	0	0	33.1
14/04/2024 12:00	14.03	0.95	527658.1	47.94	0	0	33
14/04/2024 13:00	14.03	0.9	526916.1	47.82	0	0	32.7
14/04/2024 14:00	14.03	0.9	526927.1	47.83	0	0	32.7
14/04/2024 15:00	14.03	0.94	526527.6	47.8	0	0	32.9
14/04/2024 16:00	14.03	0.97	527434.1	47.87	0	0	33.1
14/04/2024 17:00	14.03	0.93	528072.3	47.95	0	0	33.2
14/04/2024 18:00	14.07	0.89	503223.6	44.61	0	0	31.8
14/04/2024 19:00	14.09	0.94	434725.9	36.45	0	0	23.4
14/04/2024 20:00	14.05	1.03	431243.1	36.03	0	0	23
14/04/2024 21:00	14.03	0.96	429202.5	35.8	0	0	22.8
14/04/2024 22:00	14.03	0.98	430320.6	35.95	0	0	22.7



14/04/2024 23:00	14.03	1.02	429386.2	35.93	0	0	22.7
14/04/2024 24:00	<Samp	1.13	<Samp	21.38	<Samp	<Samp	<Samp
Minimum	13.97	0.89	429202.5	21.38	0	0	22.7
MinDate	04/14/2024 1:00:00	04/14/2024 18:00:00	04/14/2024 21:00:00		04/14/2024 1:00:00	04/14/2024 1:00:00	04/14/2024 22:00:00
Maximum	14.09	1.18	529292.9	48.36	0	0	33.8
MaxDate	04/14/2024 19:00:00	04/14/2024 1:00:00	04/14/2024 1:00:00	04/14/2024 7:00:00	04/14/2024 1:00:00	04/14/2024 1:00:00	04/14/2024 7:00:00
Avg	14.01	1.01	505699.6	44.33	0	0	31
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0	0.1	40605	7	0	0	4.4
Site ABPR52 Daily: 14/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
14/04/2024 01:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 02:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 03:00	Shutdown	0.66	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 04:00	Shutdown	2.26	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 05:00	Shutdown	3.25	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 06:00	Shutdown	2.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 08:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 09:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 10:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 11:00	Shutdown	0.38	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 12:00	Shutdown	0.31	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 13:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 14:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 15:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 16:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 17:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
14/04/2024 18:00	Shutdown	0.87	Shutdown	6.72	Shutdown	Shutdown	Shutdown
14/04/2024 19:00	14.78	0.37	442702.4	36.51	0	1.4	20.4
14/04/2024 20:00	14.72	0.53	434339.4	36.18	0	1.4	21.2
14/04/2024 21:00	14.69	0.59	431173.8	35.96	0	1.4	20.6
14/04/2024 22:00	14.68	0.63	431824.1	36.11	0	1.4	20.2
14/04/2024 23:00	14.67	0.66	430655.5	36.04	0	1.4	20
14/04/2024 24:00	14.72	0.68	446506.7	37.59	0	1.4	23.6
Minimum	14.67	0.01	430655.5	0	0	1.4	20
MinDate	04/14/2024 23:00:00	04/14/2024 7:00:00	04/14/2024 23:00:00	04/14/2024 1:00:00	04/14/2024 19:00:00	04/14/2024 19:00:00	04/14/2024 23:00:00
Maximum	14.78	3.25	446506.7	37.59	0	1.4	23.6
MaxDate	04/14/2024 19:00:00	04/14/2024 5:00:00			04/14/2024 19:00:00	04/14/2024 19:00:00	
Avg	14.71	0.61	436200.3	9.38	0	1.4	21
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.8	6738.5	16	0	0	1.3
Site ABPR51 Daily: 15/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
15/04/2024 01:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 04:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 05:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 10:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 11:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 12:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 13:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/04/2024 18:00	Shutdown	0.79	Shutdown	8.96	Shutdown	Shutdown	Shutdown
15/04/2024 19:00	14.19	0.97	45090.4	37.3	0	0	22.5
15/04/2024 20:00	14.14	1.03	439997.8	36.61	0	0	23.1
15/04/2024 21:00	14.11	1.02	436674.6	36.39	0	0	23.1
15/04/2024 22:00	14.1	0.98	439414	36.71	0	0	23
15/04/2024 23:00	14.1	0.99	440031	36.81	0	0	23.1
15/04/2024 24:00	14.15	0.89	451490.3	37.81	0	0	26.8
Minimum	14.1	0.01	436674.6	0	0	0	22.5
MinDate	04/15/2024 22:00:00	04/15/2024 2:00:00	04/15/2024 21:00:00	04/15/2024 1:00:00	04/15/2024 19:00:00	04/15/2024 19:00:00	04/15/2024 19:00:00
Maximum	14.19	1.03	451490.3	37.81	0	0	26.8
MaxDate	04/15/2024 19:00:00	04/15/2024 20:00:00			04/15/2024 19:00:00	04/15/2024 19:00:00	
Avg	14.13	0.3	443085.3	9.61	0	0	23.6
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.4	6407.4	16.2	0	0	1.6
Site ABPR52 Daily: 15/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
15/04/2024 01:00	14.6	0.76	530738.7	48.48	0	1.4	31.7
15/04/2024 02:00	14.59	0.68	530431.1	48.53	0	1.4	31.8
15/04/2024 03:00	14.59	0.63	530248.3	48.54	0	1.5	31.7
15/04/2024 04:00	14.6	0.55	530629.7	48.56	0	1.5	31.9
15/04/2024 05:00	14.59	0.56	531062.6	48.61	0	1.5	32
15/04/2024 06:00	14.59	0.62	530967.8	48.62	0	1.5	32.1
15/04/2024 07:00	14.6	0.67	531449.6	48.69	0	1.5	32.2
15/04/2024 08:00	14.63	0.8	530765.7	48.61	0	1.5	32
15/04/2024 09:00	14.67	0.88	530818.4	48.46	0	1.5	31.6
15/04/2024 10:00	14.7	0.87	530644.9	48.44	0	1.5	31.8
15/04/2024 11:00	14.7	0.82	530355.8	48.41	0	1.5	32
15/04/2024 12:00	14.72	0.71	530312.4	48.34	0	1.5	32.1
15/04/2024 13:00	14.72	0.63	529401.8	48.26	0	1.5	31.9
15/04/2024 14:00	14.69	0.7	528739.4	48.14	0	1.5	31.8
15/04/2024 15:00	14.67	0.7	529333.6	48.19	0	1.5	32.1
15/04/2024 16:00	14.65	0.69	529952.3	48.25	0	1.4	32.2
15/04/2024 17:00	14.64	0.67	529942.6	48.32	0	1.4	32.2
15/04/2024 18:00	14.65	0.64	495539.1	43.85	0	1.4	29.4
15/04/2024 19:00	14.68	0.46	442201.8	37.37	0	1.4	18.7
15/04/2024 20:00	14.69	0.45	437559.3	36.8	0	1.4	19.4
15/04/2024 21:00	14.7	0.46	434758.6	36.5	0	1.4	19.6



15/04/2024 22:00	14.72	0.46	437784.5	36.83	0	1.4	19.4
15/04/2024 23:00	14.71	0.48	438840	36.94	0	1.5	19.3
15/04/2024 24:00	<Samp	0.77	<Samp	23.15	<Samp	<Samp	<Samp
Minimum	14.59	0.45	434758.6	23.15	0	1.4	18.7
MinDate	04/15/2024 2:00:00	04/15/2024 20:00:00	04/15/2024 21:00:00		04/15/2024 1:00:00	04/15/2024 1:00:00	04/15/2024 19:00:00
Maximum	14.72	0.88	531449.6	48.69	0	1.5	32.2
MaxDate	04/15/2024 12:00:00	04/15/2024 9:00:00	04/15/2024 7:00:00	04/15/2024 7:00:00	04/15/2024 1:00:00	04/15/2024 3:00:00	04/15/2024 7:00:00
Avg	14.66	0.65	508803.5	44.79	0	1.5	29.1
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0	0.1	38729.8	6.6	0	0	5.3
Site ABPR51 Daily: 16/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
16/04/2024 01:00	13.99	1.04	529917.8	48.33	0	0	33.6
16/04/2024 02:00	13.97	1.05	529710.4	48.41	0	0	34
16/04/2024 03:00	13.97	1.01	530453.5	48.42	0	0	34.1
16/04/2024 04:00	13.97	0.96	530025.8	48.43	0	0	34
16/04/2024 05:00	13.97	0.98	530153.4	48.42	0	0	34
16/04/2024 06:00	13.97	1	528910.9	48.47	0	0	34.1
16/04/2024 07:00	13.98	1.05	530262.5	48.57	0	0	34.3
16/04/2024 08:00	13.97	0.96	528948.6	48.41	0	0	34
16/04/2024 09:00	14.02	0.89	529023	48.31	0	0	33.8
16/04/2024 10:00	14.03	0.88	529138.3	48.26	0	0	34.2
16/04/2024 11:00	14.03	0.87	529897.3	48.28	0	0	34.3
16/04/2024 12:00	14.04	0.85	529644.5	48.22	0	0	34.4
16/04/2024 13:00	14.04	0.89	529454.6	48.11	0	0	34.2
16/04/2024 14:00	14.03	0.95	527739.9	47.91	0	0	33.7
16/04/2024 15:00	14.04	0.91	527503	47.77	0	0	33.8
16/04/2024 16:00	14.04	0.9	527255.2	47.77	0	0	34
16/04/2024 17:00	14.03	0.88	527362.3	47.86	0	0	34
16/04/2024 18:00	14.08	0.94	487940.1	42.69	0	0	31.1
16/04/2024 19:00	14.1	0.84	441584.2	37.17	0	0	23.1
16/04/2024 20:00	14.09	0.85	436463.7	36.62	0	0	22.9
16/04/2024 21:00	14.08	0.98	436321.9	36.59	0	0	23
16/04/2024 22:00	14.08	0.93	431922.8	36.13	0	0	23.3
16/04/2024 23:00	14.06	0.96	427458.9	35.68	0	0	23.5
16/04/2024 24:00	<Samp	1.08	<Samp	21.5	<Samp	<Samp	<Samp
Minimum	13.97	0.84	427458.9	21.5	0	0	22.9
MinDate	04/16/2024 2:00:00	04/16/2024 19:00:00	04/16/2024 23:00:00		04/16/2024 1:00:00	04/16/2024 1:00:00	04/16/2024 20:00:00
Maximum	14.1	1.08	530453.5	48.57	0	0	34.4
MaxDate	04/16/2024 19:00:00		04/16/2024 3:00:00	04/16/2024 7:00:00	04/16/2024 1:00:00	04/16/2024 1:00:00	04/16/2024 12:00:00
Avg	14.03	0.94	506830.1	44.43	0	0	31.5
Num	23	24	23	24	23	23	23
Data[%]	96	100	96	100	96	96	96
STD	0	0.1	39844.8	6.9	0	0	4.6
Site ABPR52 Daily: 16/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
16/04/2024 01:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 02:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 03:00	Shutdown	0.45	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 04:00	Shutdown	2.31	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 05:00	Shutdown	3.45	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 06:00	Shutdown	0.39	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 07:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 08:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 09:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 10:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 11:00	Shutdown	0.28	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 12:00	Shutdown	0.63	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 13:00	Shutdown	1.09	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 14:00	Shutdown	0.98	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 15:00	Shutdown	0.67	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 16:00	Shutdown	0.65	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 17:00	Shutdown	0.37	Shutdown	0	Shutdown	Shutdown	Shutdown
16/04/2024 18:00	Shutdown	0.68	Shutdown	10.25	Shutdown	Shutdown	Shutdown
16/04/2024 19:00	14.79	0.35	448569.3	37.1	0	1.4	19.7
16/04/2024 20:00	14.73	0.42	439989.8	36.74	0	1.4	20.6
16/04/2024 21:00	14.71	0.47	438275.5	36.67	0	1.4	20.3
16/04/2024 22:00	14.71	0.54	433244.3	36.22	0	1.4	20.4
16/04/2024 23:00	14.69	0.63	428326.1	35.75	0	1.4	20.4
16/04/2024 24:00	14.74	0.71	446242.6	37.44	0	1.4	25
Minimum	14.69	0.06	428326.1	0	0	1.4	19.7
MinDate	04/16/2024 23:00:00	04/16/2024 2:00:00	04/16/2024 23:00:00	04/16/2024 1:00:00	04/16/2024 19:00:00	04/16/2024 19:00:00	04/16/2024 19:00:00
Maximum	14.79	3.45	448569.3	37.44	0	1.4	25
MaxDate	04/16/2024 19:00:00	04/16/2024 5:00:00	04/16/2024 19:00:00		04/16/2024 19:00:00	04/16/2024 19:00:00	
Avg	14.73	0.66	439107.9	9.59	0	1.4	21.1
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.8	7650.7	16.1	0	0	2
Site ABPR51 Daily: 17/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
17/04/2024 01:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 11:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 13:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/04/2024 18:00	Shutdown	0.74	Shutdown	13.75	Shutdown	Shutdown	Shutdown
17/04/2024 19:00	14.23	0.88	461237.7	38.49	0	0	23.7
17/04/2024 20:00	14.16	0.94	455037.9	38.33	0	0	23



17/04/2024 21:00	14.15	0.99	453726.1	38.28	0	0	22.3
17/04/2024 22:00	14.13	0.93	453336	38.26	0	0	22.4
17/04/2024 23:00	14.12	0.95	451790.2	38.14	0	0	22.4
17/04/2024 24:00	14.2	0.96	418268.2	33.35	0	0	25.6
Minimum	14.12	0.01	418268.2	0	0	0	22.3
MinDate	04/17/2024 23:00:00	04/17/2024 2:00:00		04/17/2024 1:00:00	04/17/2024 19:00:00	04/17/2024 19:00:00	04/17/2024 21:00:00
Maximum	14.23	0.99	461237.7	38.49	0	0	25.6
MaxDate	04/17/2024 19:00:00	04/17/2024 21:00:00	04/17/2024 19:00:00	04/17/2024 19:00:00	04/17/2024 19:00:00	04/17/2024 19:00:00	
Avg	14.17	0.28	448899.4	9.94	0	0	23.2
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.4	15357.9	16.5	0	0	1.3
Site ABPR52 Daily: 17/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
17/04/2024 01:00	14.64	0.73	526406.3	47.73	0	1.4	33
17/04/2024 02:00	14.63	0.75	526490.7	47.82	0	1.4	33.2
17/04/2024 03:00	14.63	0.72	528014.3	48.05	0	1.4	33.2
17/04/2024 04:00	14.65	0.67	528178	48.08	0	1.5	33.2
17/04/2024 05:00	14.64	0.57	528021.2	48.1	0	1.5	33.2
17/04/2024 06:00	14.63	0.55	528345.8	48.19	0	1.5	33.2
17/04/2024 07:00	14.6	0.63	531269.7	48.63	0	1.5	32.5
17/04/2024 08:00	14.65	0.69	530622.2	48.49	0	1.5	32.2
17/04/2024 09:00	14.68	0.67	530960.5	48.42	0	1.5	32.3
17/04/2024 10:00	14.72	0.76	531062.6	48.44	0	1.5	32.9
17/04/2024 11:00	14.75	0.89	531569.4	48.54	0	1.5	33.4
17/04/2024 12:00	14.79	0.82	531576.9	48.51	0	1.5	33.5
17/04/2024 13:00	14.79	0.68	531136.6	48.42	0	1.5	33.2
17/04/2024 14:00	14.73	0.56	529847.1	48.28	0	1.4	33
17/04/2024 15:00	14.71	0.61	530092.8	48.24	0	1.4	33.1
17/04/2024 16:00	14.69	0.62	530626.9	48.29	0	1.4	33.3
17/04/2024 17:00	14.66	0.7	531354.2	48.45	0	1.4	33.8
17/04/2024 18:00	14.69	0.66	482460.7	42.3	0	1.4	30.2
17/04/2024 19:00	14.73	0.62	454337.7	38.57	0	1.4	20.1
17/04/2024 20:00	14.71	0.58	452399.7	38.41	0	1.4	19.2
17/04/2024 21:00	14.69	0.45	452201.3	38.38	0	1.3	18.6
17/04/2024 22:00	14.69	0.43	451744.2	38.36	0	1.4	18.3
17/04/2024 23:00	14.69	0.43	450484.5	38.22	0	1.4	18.2
17/04/2024 24:00	14.77	0.44	416381.6	33.45	0	1.4	20.7
Minimum	14.6	0.43	416381.6	33.45	0	1.3	18.2
MinDate	04/17/2024 7:00:00	04/17/2024 22:00:00			04/17/2024 1:00:00	04/17/2024 21:00:00	04/17/2024 23:00:00
Maximum	14.79	0.89	531576.9	48.63	0	1.5	33.8
MaxDate	04/17/2024 12:00:00	04/17/2024 11:00:00	04/17/2024 12:00:00	04/17/2024 7:00:00	04/17/2024 1:00:00	04/17/2024 4:00:00	04/17/2024 17:00:00
Avg	14.69	0.63	506899.4	45.35	0	1.4	29.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	37681.7	4.8	0	0.1	6.1
Site ABPR51 Daily: 18/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
18/04/2024 01:00	14.23	0.85	382188.6	28.59	0	0	24.3
18/04/2024 02:00	14.22	0.85	382938.6	28.77	0	0	24.6
18/04/2024 03:00	14.24	0.83	380370.3	28.31	0	0	24.2
18/04/2024 04:00	14.26	0.86	378576.7	27.95	0	0	24.1
18/04/2024 05:00	14.27	0.89	379215.3	28.02	0	0	24.3
18/04/2024 06:00	14.22	0.88	383244.5	28.92	0	0	25.1
18/04/2024 07:00	14.22	0.77	383624.6	28.9	0	0	25.2
18/04/2024 08:00	14.24	0.75	381047.9	28.43	0	0	27.8
18/04/2024 09:00	14.11	0.86	443823.5	37.29	0	0	22.8
18/04/2024 10:00	14.15	0.86	450843.1	37.95	0	0	22.7
18/04/2024 11:00	14.16	0.86	451751.3	37.99	0	0	23
18/04/2024 12:00	14.16	0.86	449517.4	37.55	0	0	22.9
18/04/2024 13:00	14.45	0.6	361238.7	24.11	0	0	38.5
18/04/2024 14:00	14.11	1.39	448054.6	37.89	0	0	25.1
18/04/2024 15:00	14.14	1.2	454663.5	38.27	0	0	22.7
18/04/2024 16:00	14.16	0.94	459150.6	38.53	0	0	22.3
18/04/2024 17:00	14.16	0.99	461265.7	38.78	0	0	22.2
18/04/2024 18:00	14.15	0.94	459429.5	38.63	0	0	22.4
18/04/2024 19:00	14.13	1	457167.2	38.44	0	0	22.5
18/04/2024 20:00	14.12	0.99	458791	38.67	0	0	22.5
18/04/2024 21:00	14.12	0.98	458056	38.6	0	0	22.5
18/04/2024 22:00	14.12	1.1	459887.6	38.87	0	0	22.4
18/04/2024 23:00	14.13	1.06	461120.4	38.98	0	0	22.6
18/04/2024 24:00	14.14	1.09	462730.8	39.09	0	0	22.6
Minimum	14.11	0.6	361238.7	24.11	0	0	22.2
MinDate	04/18/2024 9:00:00	04/18/2024 13:00:00	04/18/2024 13:00:00	04/18/2024 13:00:00	04/18/2024 1:00:00	04/18/2024 1:00:00	04/18/2024 17:00:00
Maximum	14.45	1.39	462730.8	39.09	0	0	38.5
MaxDate	04/18/2024 13:00:00	04/18/2024 14:00:00			04/18/2024 1:00:00	04/18/2024 1:00:00	04/18/2024 13:00:00
Avg	14.18	0.93	427029	34.48	0	0	24.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	38352.7	5.2	0	0	3.3
Site ABPR52 Daily: 18/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
18/04/2024 01:00	14.8	0.43	378926.9	28.66	0	1.5	17.8
18/04/2024 02:00	14.81	0.51	380264.6	28.85	0	1.5	18.3
18/04/2024 03:00	14.82	0.52	377385	28.38	0	1.5	17.6
18/04/2024 04:00	14.83	0.55	375110.8	28.01	0	1.5	17.2
18/04/2024 05:00	14.84	0.6	375414.6	28.08	0	1.5	17.4
18/04/2024 06:00	14.8	0.59	380555.4	29	0	1.6	18.7
18/04/2024 07:00	14.81	0.56	380541.5	28.98	0	1.6	18.7
18/04/2024 08:00	14.88	0.6	378458.6	28.47	0	1.6	22.3
18/04/2024 09:00	14.86	0.5	452201.9	38.03	0	1.6	18.8
18/04/2024 10:00	14.9	0.59	454644.1	38.17	0	1.6	19.4
18/04/2024 11:00	15	0.64	455379.7	38.14	0	1.6	19.7
18/04/2024 12:00	15	0.7	460725.6	38.47	0	1.6	20
18/04/2024 13:00	15.1	0.48	360975.5	24.68	0	1.6	31.8
18/04/2024 14:00	14.73	1.22	460997.8	39.16	0	1.4	21
18/04/2024 15:00	14.83	1	456712.3	38.36	0	1.5	19.8
18/04/2024 16:00	14.88	0.68	461144.4	38.7	0	1.6	19.8
18/04/2024 17:00	14.86	0.64	464450.8	38.98	0	1.6	19.8
18/04/2024 18:00	14.82	0.54	461120.3	38.82	0	1.5	19.8
18/04/2024 19:00	14.78	0.45	457648.2	38.56	0	1.5	19.5



18/04/2024 20:00	14.76	0.44	458763.1	38.78	0	1.5	19.3
18/04/2024 21:00	14.75	0.4	457398.7	38.7	0	1.5	19.2
18/04/2024 22:00	14.75	0.43	459979.2	38.96	0	1.5	19.1
18/04/2024 23:00	14.76	0.51	461270.8	39.07	0	1.6	19.2
18/04/2024 24:00	14.77	0.45	462042.1	39.17	0	1.6	19.1
Minimum	14.73	0.4	360975.5	24.68	0	1.4	17.2
MinDate	04/18/2024 14:00:00	04/18/2024 21:00:00	04/18/2024 13:00:00	04/18/2024 13:00:00	04/18/2024 1:00:00	04/18/2024 14:00:00	04/18/2024 4:00:00
Maximum	15.1	1.22	464450.8	39.17	0	1.6	31.8
MaxDate	04/18/2024 13:00:00	04/18/2024 14:00:00	04/18/2024 17:00:00		04/18/2024 1:00:00	04/18/2024 6:00:00	04/18/2024 13:00:00
Avg	14.84	0.58	428004.7	34.72	0	1.5	19.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	41068.2	5.3	0	0.1	2.8
Site ABPR51 Daily: 19/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
19/04/2024 01:00	14.16	0.99	428291	34.7	0	0	25
19/04/2024 02:00	14.09	0.93	399666.8	31.58	0	0	26.9
19/04/2024 03:00	14.1	0.94	399314.3	31.49	0	0	26.7
19/04/2024 04:00	14.12	0.92	395970.4	30.95	0	0	26.3
19/04/2024 05:00	14.15	0.87	392958.7	30.42	0	0	25.9
19/04/2024 06:00	14.16	0.86	390399.1	30.04	0	0	25.4
19/04/2024 07:00	14.16	0.87	391907.6	30.24	0	0	25.6
19/04/2024 08:00	14.22	0.81	384481.1	28.83	0	0	28
19/04/2024 09:00	14.14	0.98	454950.2	38.27	0	0	22.3
19/04/2024 10:00	14.15	1	457076.9	38.36	0	0	22.5
19/04/2024 11:00	14.15	0.98	457853.9	38.45	0	0	22.4
19/04/2024 12:00	14.15	0.99	455420.3	38.02	0	0	22.3
19/04/2024 13:00	14.45	0.87	362371.6	24.36	0	0	38.8
19/04/2024 14:00	14.15	0.96	452511.4	37.85	0	0	21.9
19/04/2024 15:00	14.22	0.98	458335.5	38.12	0	0	23.3
19/04/2024 16:00	14.27	0.9	459749.2	38.11	0	0	24.6
19/04/2024 17:00	14.28	0.93	464153.9	38.52	0	0	24.9
19/04/2024 18:00	14.26	0.88	464440.6	38.7	0	0	24.6
19/04/2024 19:00	14.21	0.88	459522.2	38.44	0	0	23.9
19/04/2024 20:00	14.16	0.92	458025.7	38.35	0	0	23.7
19/04/2024 21:00	14.16	0.95	456813.7	38.28	0	0	23.7
19/04/2024 22:00	14.16	0.97	458116.1	38.42	0	0	23.6
19/04/2024 23:00	14.16	1.03	458253.7	38.51	0	0	23.5
19/04/2024 24:00	14.16	1.1	461749.6	38.85	0	0	23.1
Minimum	14.09	0.81	362371.6	24.36	0	0	21.9
MinDate	04/19/2024 2:00:00	04/19/2024 8:00:00	04/19/2024 13:00:00	04/19/2024 13:00:00	04/19/2024 1:00:00	04/19/2024 1:00:00	04/19/2024 14:00:00
Maximum	14.45	1.1	464440.6	38.85	0	0	38.8
MaxDate	04/19/2024 13:00:00		04/19/2024 18:00:00		04/19/2024 1:00:00	04/19/2024 1:00:00	04/19/2024 13:00:00
Avg	14.18	0.94	434263.9	35.33	0	0	25
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	33570.7	4.3	0	0	3.4
Site ABPR52 Daily: 19/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
19/04/2024 01:00	14.79	0.56	426822.6	34.77	0	1.6	20.6
19/04/2024 02:00	14.74	0.56	397780.3	31.66	0	1.6	22.5
19/04/2024 03:00	14.75	0.65	397521.9	31.57	0	1.6	22.1
19/04/2024 04:00	14.77	0.65	393961.5	31.02	0	1.6	21.2
19/04/2024 05:00	14.78	0.59	390393.3	30.49	0	1.7	21
19/04/2024 06:00	14.8	0.58	388339.8	30.11	0	1.7	20.4
19/04/2024 07:00	14.8	0.5	389367.3	30.32	0	1.7	20.6
19/04/2024 08:00	14.9	0.5	380342.4	28.67	0	1.7	23.3
19/04/2024 09:00	14.86	0.48	462010.5	38.95	0	1.6	18.7
19/04/2024 10:00	14.89	0.55	458443	38.53	0	1.6	19.4
19/04/2024 11:00	14.92	0.63	460741.1	38.65	0	1.6	19.5
19/04/2024 12:00	14.96	0.7	465533	38.96	0	1.6	19.9
19/04/2024 13:00	15.2	0.81	360164.1	24.62	0	1.7	32.3
19/04/2024 14:00	14.93	0.69	458149.7	38.25	0	1.6	19
19/04/2024 15:00	14.92	0.66	458413.9	38.29	0	1.6	19.4
19/04/2024 16:00	14.9	0.44	457748.5	38.25	0	1.6	19.6
19/04/2024 17:00	14.9	0.49	463460.9	38.77	0	1.6	20
19/04/2024 18:00	14.86	0.41	462322.8	38.8	0	1.5	19.6
19/04/2024 19:00	14.8	0.45	458271.8	38.57	0	1.5	18.9
19/04/2024 20:00	14.78	0.55	456138.5	38.45	0	1.5	18.7
19/04/2024 21:00	14.77	0.54	455314.8	38.37	0	1.5	18.8
19/04/2024 22:00	14.77	0.67	456516.6	38.52	0	1.5	18.7
19/04/2024 23:00	14.77	0.64	457202.2	38.6	0	1.5	18.6
19/04/2024 24:00	14.77	0.63	460074.7	38.93	0	1.5	17.9
Minimum	14.74	0.41	360164.1	24.62	0	1.5	17.9
MinDate	04/19/2024 2:00:00	04/19/2024 18:00:00	04/19/2024 13:00:00	04/19/2024 13:00:00	04/19/2024 1:00:00	04/19/2024 18:00:00	
Maximum	15.2	0.81	465533	38.96	0	1.7	32.3
MaxDate	04/19/2024 13:00:00	04/19/2024 13:00:00	04/19/2024 12:00:00	04/19/2024 12:00:00	04/19/2024 1:00:00	04/19/2024 5:00:00	04/19/2024 13:00:00
Avg	14.85	0.58	433959.8	35.51	0	1.6	20.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	35120.6	4.4	0	0.1	2.9
Site ABPR51 Daily: 20/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
20/04/2024 01:00	14.18	0.99	425633.7	34.2	0	0	25
20/04/2024 02:00	14.15	0.95	398849.2	31.24	0	0	26.7
20/04/2024 03:00	14.16	0.9	398100.9	31.09	0	0	26.6
20/04/2024 04:00	14.15	0.88	396878.4	30.85	0	0	26.4
20/04/2024 05:00	14.16	0.89	395122.1	30.59	0	0	25.8
20/04/2024 06:00	14.15	0.89	395848.7	30.79	0	0	25.5
20/04/2024 07:00	14.15	0.91	397244.8	31	0	0	25.6
20/04/2024 08:00	14.21	0.9	390349.9	29.73	0	0	27.1
20/04/2024 09:00	14.16	0.97	456895.1	38.28	0	0	22.5
20/04/2024 10:00	14.19	0.97	451601.4	37.58	0	0	23.9
20/04/2024 11:00	14.27	0.88	451577.3	37.31	0	0	25.1
20/04/2024 12:00	14.3	0.9	454571.1	37.53	0	0	24.8
20/04/2024 13:00	14.54	0.8	362951.8	24.31	0	0	36
20/04/2024 14:00	14.22	0.97	454892.4	37.76	0	0	22.6
20/04/2024 15:00	14.15	1.11	450862.5	37.61	0	0	21.2
20/04/2024 16:00	14.13	1.14	451256.7	37.71	0	0	20.9
20/04/2024 17:00	14.12	0.88	452634.4	37.84	0	0	20.9
20/04/2024 18:00	14.13	0.78	452137.7	37.82	0	0	21.8



20/04/2024 19:00	14.13	0.83	454568	38.12	0	0	21.8
20/04/2024 20:00	14.15	0.92	455772.4	38.15	0	0	22.4
20/04/2024 21:00	14.15	0.83	452475.5	37.9	0	0	22.3
20/04/2024 22:00	14.13	0.83	450729.7	37.72	0	0	22.4
20/04/2024 23:00	14.12	0.86	451071.5	37.79	0	0	22.4
20/04/2024 24:00	14.14	0.97	455962	38.26	0	0	22.4
Minimum	14.12	0.78	362951.8	24.31	0	0	20.9
MinDate	04/20/2024 17:00:00	04/20/2024 18:00:00	04/20/2024 13:00:00	04/20/2024 13:00:00	04/20/2024 1:00:00	04/20/2024 1:00:00	04/20/2024 16:00:00
Maximum	14.54	1.14	456895.1	38.28	0	0	36
MaxDate	04/20/2024 13:00:00	04/20/2024 16:00:00	04/20/2024 9:00:00	04/20/2024 9:00:00	04/20/2024 1:00:00	04/20/2024 1:00:00	04/20/2024 13:00:00
Avg	14.18	0.91	431582.8	35.05	0	0	24.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	29967.9	4	0	0	3.2
Site ABPR52 Daily: 20/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
20/04/2024 01:00	14.8	0.63	423366.8	34.29	0	1.6	19.4
20/04/2024 02:00	14.77	0.61	395950.7	31.32	0	1.6	21.1
20/04/2024 03:00	14.78	0.53	395184.8	31.17	0	1.6	21
20/04/2024 04:00	14.78	0.46	393652.1	30.93	0	1.7	20.7
20/04/2024 05:00	14.79	0.47	391633.4	30.66	0	1.7	20.1
20/04/2024 06:00	14.79	0.48	393315.7	30.86	0	1.7	20
20/04/2024 07:00	14.79	0.56	394447.5	31.07	0	1.7	20.2
20/04/2024 08:00	14.88	0.64	386576.7	29.8	0	1.7	21.5
20/04/2024 09:00	14.87	0.64	456265.1	38.36	0	1.7	17.5
20/04/2024 10:00	14.91	0.76	449533.4	37.67	0	1.7	19.1
20/04/2024 11:00	15.05	0.89	448786.1	37.4	0	1.7	20
20/04/2024 12:00	15.12	0.66	451525.8	37.61	0	1.7	19.7
20/04/2024 13:00	15.26	0.52	357832.7	24.37	0	1.8	28.6
20/04/2024 14:00	14.96	0.68	451118.1	37.8	0	1.7	17.8
20/04/2024 15:00	14.91	0.8	448239.4	37.69	0	1.6	17.3
20/04/2024 16:00	14.9	0.74	452531.8	37.8	0	1.6	18.2
20/04/2024 17:00	14.85	0.53	452630.6	37.94	0	1.6	18.3
20/04/2024 18:00	14.83	0.49	453127.7	37.91	0	1.6	19.1
20/04/2024 19:00	14.78	0.48	455388.5	38.26	0	1.6	18.7
20/04/2024 20:00	14.74	0.46	454003.4	38.26	0	1.5	17.9
20/04/2024 21:00	14.72	0.4	450990.2	38.01	0	1.5	17.9
20/04/2024 22:00	14.72	0.39	449691.5	37.9	0	1.6	18
20/04/2024 23:00	14.72	0.42	450321.7	37.98	0	1.6	17.9
20/04/2024 24:00	14.74	0.42	455086.9	38.43	0	1.6	17.7
Minimum	14.72	0.39	357832.7	24.37	0	1.5	17.3
MinDate	04/20/2024 21:00:00	04/20/2024 22:00:00	04/20/2024 13:00:00	04/20/2024 13:00:00	04/20/2024 1:00:00	04/20/2024 20:00:00	04/20/2024 15:00:00
Maximum	15.26	0.89	456265.1	38.43	0	1.8	28.6
MaxDate	04/20/2024 13:00:00	04/20/2024 11:00:00	04/20/2024 9:00:00		04/20/2024 1:00:00	04/20/2024 13:00:00	04/20/2024 13:00:00
Avg	14.85	0.57	429633.4	35.15	0	1.6	19.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	31082.5	4	0	0.1	2.3
Site ABPR51 Daily: 21/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW MG/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
21/04/2024 01:00	14.17	0.91	423084.9	33.89	0	0	25
21/04/2024 02:00	14.15	0.87	398080.8	31.14	0	0	26.2
21/04/2024 03:00	14.16	0.82	395524.8	30.7	0	0	26.2
21/04/2024 04:00	14.21	0.8	388657.8	29.55	0	0	25.5
21/04/2024 05:00	14.24	0.76	384551	28.73	0	0	24.5
21/04/2024 06:00	14.21	0.86	388587.9	29.54	0	0	25
21/04/2024 07:00	14.21	0.87	389338.2	29.56	0	0	24.8
21/04/2024 08:00	14.23	0.82	387056.4	29.12	0	0	24.3
21/04/2024 09:00	14.25	0.82	389579.3	29.47	0	0	25.4
21/04/2024 10:00	14.26	0.8	394300	30.3	0	0	28.5
21/04/2024 11:00	14.34	0.72	393278.8	29.94	0	0	29.8
21/04/2024 12:00	14.41	0.72	391524.8	29.57	0	0	29.3
21/04/2024 13:00	14.45	0.58	385662.2	28.58	0	0	29.2
21/04/2024 14:00	14.38	0.73	395090.8	30.12	0	0	31.7
21/04/2024 15:00	14.36	0.76	396560.2	30.35	0	0	32.1
21/04/2024 16:00	14.4	0.6	395254.3	30.07	0	0	33.1
21/04/2024 17:00	14.41	0.52	393801	29.88	0	0	34
21/04/2024 18:00	14.36	0.57	388983.7	29.14	0	0	32.1
21/04/2024 19:00	14.22	0.66	446818.1	37.01	0	0	24.8
21/04/2024 20:00	14.17	0.77	447777.5	37.24	0	0	24.2
21/04/2024 21:00	14.16	0.83	448967	37.51	0	0	23.5
21/04/2024 22:00	14.16	0.8	449511.5	37.53	0	0	23.6
21/04/2024 23:00	14.16	0.84	452417.3	37.88	0	0	23.7
21/04/2024 24:00	14.24	0.74	414864.5	32.6	0	0	26.3
Minimum	14.15	0.52	384551	28.58	0	0	23.5
MinDate	04/21/2024 2:00:00	04/21/2024 17:00:00	04/21/2024 5:00:00	04/21/2024 13:00:00	04/21/2024 1:00:00	04/21/2024 1:00:00	04/21/2024 21:00:00
Maximum	14.45	0.91	452417.3	37.88	0	0	34
MaxDate	04/21/2024 13:00:00	04/21/2024 1:00:00	04/21/2024 23:00:00	04/21/2024 23:00:00	04/21/2024 1:00:00	04/21/2024 1:00:00	04/21/2024 17:00:00
Avg	14.26	0.76	405803.1	31.64	0	0	27.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24227.8	3.2	0	0	3.4
Site ABPR52 Daily: 21/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
21/04/2024 01:00	14.78	0.42	420126.9	34.03	0	1.6	19.6
21/04/2024 02:00	14.76	0.51	395372.4	31.21	0	1.6	21
21/04/2024 03:00	14.78	0.51	392168.3	30.77	0	1.7	20.6
21/04/2024 04:00	14.81	0.58	385363.4	29.62	0	1.7	19.2
21/04/2024 05:00	14.85	0.61	381033.3	28.8	0	1.8	17.9
21/04/2024 06:00	14.82	0.61	385057.6	29.6	0	1.7	18.9
21/04/2024 07:00	14.83	0.69	385102.2	29.64	0	1.7	18.6
21/04/2024 08:00	14.89	0.65	383369.3	29.18	0	1.7	17.8
21/04/2024 09:00	14.92	0.59	386169.7	29.54	0	1.7	19.1
21/04/2024 10:00	15	0.58	391440.7	30.36	0	1.7	22.3
21/04/2024 11:00	15.15	0.64	390245.3	30.01	0	1.8	23.1
21/04/2024 12:00	15.26	0.76	388633.4	29.64	0	1.8	22.5
21/04/2024 13:00	15.27	0.48	382422.6	28.65	0	1.8	21.6
21/04/2024 14:00	15.19	0.66	391770.1	30.18	0	1.7	25.1
21/04/2024 15:00	15.15	0.59	393548.5	30.42	0	1.7	25.7
21/04/2024 16:00	15.18	0.42	391615.9	30.13	0	1.6	26.8
21/04/2024 17:00	15.15	0.41	390507.5	29.95	0	1.6	27.6



21/04/2024 18:00	15.04	0.55	385216.8	29.18	0	1.5	26.2
21/04/2024 19:00	14.77	0.55	444431.1	37.07	0	1.4	20.1
21/04/2024 20:00	14.7	0.63	446470.9	37.44	0	1.4	19.6
21/04/2024 21:00	14.68	0.67	448050.2	37.68	0	1.4	18.7
21/04/2024 22:00	14.69	0.69	446840.5	37.6	0	1.4	18.8
21/04/2024 23:00	14.7	0.63	451689.4	38.04	0	1.4	18.7
21/04/2024 24:00	14.78	0.49	412667	32.7	0	1.5	20.7
Minimum	14.68	0.41	381033.3	28.65	0	1.4	17.8
MinDate	04/21/2024 21:00:00	04/21/2024 17:00:00	04/21/2024 5:00:00	04/21/2024 13:00:00	04/21/2024 1:00:00	04/21/2024 19:00:00	04/21/2024 8:00:00
Maximum	15.27	0.76	451689.4	38.04	0	1.8	27.6
MaxDate	04/21/2024 13:00:00	04/21/2024 12:00:00	04/21/2024 23:00:00	04/21/2024 23:00:00	04/21/2024 1:00:00	04/21/2024 5:00:00	04/21/2024 17:00:00
Avg	14.92	0.58	402888	31.73	0	1.6	21.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.2	0.1	24968.8	3.3	0	0.1	3

Site ABPR51 Daily: 22/04/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
22/04/2024 01:00	14.25	0.71	386147.3	29.02	0	0	25.4
22/04/2024 02:00	14.18	0.8	392446.5	30.27	0	0	26.5
22/04/2024 03:00	14.19	0.81	391922.8	30.14	0	0	26.7
22/04/2024 04:00	14.18	0.87	391920	30.22	0	0	26.6
22/04/2024 05:00	14.22	0.81	387594.6	29.37	0	0	25.6
22/04/2024 06:00	14.22	0.79	389628.1	29.74	0	0	26
22/04/2024 07:00	14.17	0.87	391797.1	30.21	0	0	26.2
22/04/2024 08:00	14.24	0.76	386854.7	29.1	0	0	26.9
22/04/2024 09:00	14.23	0.82	469594.5	39.37	0	0	23.1
22/04/2024 10:00	14.27	0.88	471182.4	39.35	0	0	23.6
22/04/2024 11:00	14.3	0.82	472930.7	39.3	0	0	23.8
22/04/2024 12:00	14.34	0.85	477314.6	39.57	0	0	24.3
22/04/2024 13:00	14.48	0.69	371668.5	25.91	0	0	29.3
22/04/2024 14:00	14.39	0.89	495586.1	41.13	0	0	26.7
22/04/2024 15:00	14.4	0.94	499926.7	41.49	0	0	26.7
22/04/2024 16:00	14.31	0.77	491186	41.2	0	0	24.1
22/04/2024 17:00	14.2	0.78	480903.7	40.71	0	0	20.9
22/04/2024 18:00	14.21	0.87	483288.8	40.92	0	0	21.2
22/04/2024 19:00	14.18	0.8	485048.7	41.19	0	0	20.9
22/04/2024 20:00	14.2	0.87	492416.7	41.99	0	0	21.5
22/04/2024 21:00	14.17	0.88	489069.6	41.66	0	0	21.2
22/04/2024 22:00	14.18	0.93	491445.5	41.88	0	0	21.2
22/04/2024 23:00	14.19	0.95	488983	41.65	0	0	21.5
22/04/2024 24:00	14.21	0.98	490531.5	41.63	0	0	22.5
Minimum	14.17	0.69	371668.5	25.91	0	0	20.9
MinDate	04/22/2024 7:00:00	04/22/2024 13:00:00	04/22/2024 13:00:00	04/22/2024 13:00:00	04/22/2024 1:00:00	04/22/2024 1:00:00	04/22/2024 17:00:00
Maximum	14.48	0.98	499926.7	41.99	0	0	29.3
MaxDate	04/22/2024 13:00:00		04/22/2024 15:00:00	04/22/2024 20:00:00	04/22/2024 1:00:00	04/22/2024 1:00:00	04/22/2024 13:00:00
Avg	14.25	0.84	448724.5	36.54	0	0	24.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	48908	5.8	0	0	2.5

Site ABPR52 Daily: 22/04/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
22/04/2024 01:00	14.78	0.43	382260.6	29.09	0	1.5	19
22/04/2024 02:00	14.74	0.48	389280.8	30.34	0	1.6	20.7
22/04/2024 03:00	14.76	0.48	388407.8	30.21	0	1.6	20.6
22/04/2024 04:00	14.75	0.45	388481.6	30.29	0	1.6	20.5
22/04/2024 05:00	14.78	0.44	383955.8	29.43	0	1.6	19.2
22/04/2024 06:00	14.78	0.52	385903.2	29.81	0	1.7	19.8
22/04/2024 07:00	14.76	0.56	388793.2	30.29	0	1.7	20.3
22/04/2024 08:00	14.83	0.69	382981.3	29.16	0	1.7	20.7
22/04/2024 09:00	14.85	0.7	467829.1	39.43	0	1.7	17.8
22/04/2024 10:00	14.88	0.71	468514.1	39.43	0	1.7	18.6
22/04/2024 11:00	14.93	0.7	469604.4	39.37	0	1.7	18.9
22/04/2024 12:00	14.96	0.67	473106.8	39.63	0	1.7	19.5
22/04/2024 13:00	15.11	0.56	367079.8	25.98	0	1.7	21.5
22/04/2024 14:00	14.99	0.62	493399.5	41.34	0	1.6	21.7
22/04/2024 15:00	14.97	0.66	496536	41.6	0	1.6	21.8
22/04/2024 16:00	14.94	0.68	491571.1	41.31	0	1.6	21
22/04/2024 17:00	14.88	0.67	484569.9	40.81	0	1.6	19.6
22/04/2024 18:00	14.87	0.63	486206.2	41.01	0	1.6	19.6
22/04/2024 19:00	14.82	0.49	486340.2	41.29	0	1.5	18.5
22/04/2024 20:00	14.79	0.54	492821.8	42.08	0	1.5	18.7
22/04/2024 21:00	14.78	0.49	488771.6	41.75	0	1.5	18.1
22/04/2024 22:00	14.79	0.48	491657.5	41.98	0	1.6	18.2
22/04/2024 23:00	14.79	0.49	488400.4	41.75	0	1.6	18
22/04/2024 24:00	14.79	0.53	488324.5	41.72	0	1.6	17.9
Minimum	14.74	0.43	367079.8	25.98	0	1.5	17.8
MinDate	04/22/2024 2:00:00	04/22/2024 1:00:00	04/22/2024 13:00:00	04/22/2024 13:00:00	04/22/2024 1:00:00	04/22/2024 1:00:00	04/22/2024 9:00:00
Maximum	15.11	0.71	496536	42.08	0	1.7	21.8
MaxDate	04/22/2024 13:00:00	04/22/2024 10:00:00	04/22/2024 15:00:00	04/22/2024 20:00:00	04/22/2024 1:00:00	04/22/2024 6:00:00	04/22/2024 15:00:00
Avg	14.85	0.57	446866.5	36.63	0	1.6	19.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	50390.3	5.8	0	0.1	1.3

Site ABPR51 Daily: 23/04/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
23/04/2024 01:00	14.18	0.92	446460.4	36.65	0	0	23.8
23/04/2024 02:00	14.05	0.9	419422.9	34.39	0	0	23.4
23/04/2024 03:00	14.04	0.96	419037.2	34.32	0	0	23.3
23/04/2024 04:00	14.05	0.86	415337.8	33.81	0	0	23.3
23/04/2024 05:00	14.09	0.81	407094.8	32.61	0	0	24.8
23/04/2024 06:00	14.06	0.84	416022.4	33.93	0	0	23.7
23/04/2024 07:00	14.06	0.85	419058.9	34.36	0	0	23.4
23/04/2024 08:00	14.11	0.65	408193.8	32.63	0	0	24.2
23/04/2024 09:00	14.25	0.87	485756.4	41.03	0	0	23.3
23/04/2024 10:00	14.28	0.87	478405.6	40.04	0	0	24.1
23/04/2024 11:00	14.33	0.75	468885.4	38.87	0	0	24.9
23/04/2024 12:00	14.36	0.75	473735.5	39.13	0	0	24.9
23/04/2024 13:00	14.53	0.58	366639.8	25	0	0	33.9
23/04/2024 14:00	14.2	0.85	502524.3	43.25	0	0	32.8
23/04/2024 15:00	14.16	0.87	515925.4	45	0	0	36.3
23/04/2024 16:00	14.17	0.77	480099.2	40.74	0	0	33



23/04/2024 17:00	14.19	0.57	412785.7	32.93	0	0	26
23/04/2024 18:00	14.17	0.57	410732.3	32.81	0	0	26.1
23/04/2024 19:00	14.22	0.7	461888.3	38.57	0	0	23.3
23/04/2024 20:00	14.23	0.78	486554.6	41.13	0	0	23.1
23/04/2024 21:00	14.22	0.83	485672.3	41.14	0	0	23
23/04/2024 22:00	14.25	0.88	495778.6	42.14	0	0	23.6
23/04/2024 23:00	14.24	0.97	496374.4	42.15	0	0	23.8
23/04/2024 24:00	14.24	0.95	498278.1	42.39	0	0	23.7
Minimum	14.04	0.57	366639.8	25	0	0	23
MinDate	04/23/2024 3:00:00	04/23/2024 17:00:00	04/23/2024 13:00:00	04/23/2024 13:00:00	04/23/2024 1:00:00	04/23/2024 1:00:00	04/23/2024 21:00:00
Maximum	14.53	0.97	515925.4	45	0	0	36.3
MaxDate	04/23/2024 13:00:00	04/23/2024 23:00:00	04/23/2024 15:00:00	04/23/2024 15:00:00	04/23/2024 1:00:00	04/23/2024 1:00:00	04/23/2024 15:00:00
Avg	14.2	0.81	452944.4	37.46	0	0	25.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	41082.6	4.8	0	0	3.9
Site ABPR52 Daily: 23/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
23/04/2024 01:00	14.77	0.53	444584.3	36.83	0	1.6	18.9
23/04/2024 02:00	14.68	0.52	416930.1	34.47	0	1.6	18.6
23/04/2024 03:00	14.67	0.58	416530.1	34.4	0	1.6	18.5
23/04/2024 04:00	14.66	0.66	412604.4	33.88	0	1.6	18.4
23/04/2024 05:00	14.7	0.68	404199.3	32.69	0	1.6	19.9
23/04/2024 06:00	14.68	0.66	413519.6	33.99	0	1.6	18.8
23/04/2024 07:00	14.68	0.64	416828.7	34.43	0	1.6	18.6
23/04/2024 08:00	14.76	0.66	405465.7	32.68	0	1.7	18.9
23/04/2024 09:00	14.89	0.5	484844.3	41.22	0	1.7	18.4
23/04/2024 10:00	14.96	0.53	475777.1	40.1	0	1.7	19.1
23/04/2024 11:00	15	0.63	465687.4	38.94	0	1.7	20
23/04/2024 12:00	15.02	0.67	469221	39.23	0	1.7	20
23/04/2024 13:00	15.17	0.67	361798.8	25.05	0	1.7	26.4
23/04/2024 14:00	14.87	0.71	422840.2	34.35	0	1.6	20.9
23/04/2024 15:00	14.83	0.65	406511.1	32.51	0	1.6	20.8
23/04/2024 16:00	14.81	0.61	443783.2	36.86	0	1.6	24.4
23/04/2024 17:00	14.72	0.63	519262.5	45.93	0	1.5	33.7
23/04/2024 18:00	14.69	0.55	520910.9	46.4	0	1.5	33.5
23/04/2024 19:00	14.78	0.42	475647.3	40.52	0	1.5	21
23/04/2024 20:00	14.8	0.43	484331	41.24	0	1.5	18.5
23/04/2024 21:00	14.79	0.45	484185.6	41.23	0	1.6	18.3
23/04/2024 22:00	14.81	0.46	494548.1	42.24	0	1.6	19.1
23/04/2024 23:00	14.81	0.53	493303.8	42.25	0	1.6	19.2
23/04/2024 24:00	14.81	0.56	496075.7	42.49	0	1.6	19.2
Minimum	14.66	0.42	361798.8	25.05	0	1.5	18.3
MinDate	04/23/2024 4:00:00	04/23/2024 19:00:00	04/23/2024 13:00:00	04/23/2024 13:00:00	04/23/2024 1:00:00	04/23/2024 17:00:00	04/23/2024 21:00:00
Maximum	15.17	0.71	520910.9	46.4	0	1.7	33.7
MaxDate	04/23/2024 13:00:00	04/23/2024 14:00:00	04/23/2024 18:00:00	04/23/2024 18:00:00	04/23/2024 1:00:00	04/23/2024 8:00:00	04/23/2024 17:00:00
Avg	14.81	0.58	451224.6	37.66	0	1.6	21
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	42667.4	5	0	0.1	4.3
Site ABPR51 Daily: 24/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
24/04/2024 01:00	14.17	0.88	456666.5	37.91	0	0	24.5
24/04/2024 02:00	14.09	0.83	426463.6	35.16	0	0	24
24/04/2024 03:00	14.08	0.76	424376.5	34.92	0	0	23.9
24/04/2024 04:00	14.08	0.74	416250.6	33.9	0	0	24.2
24/04/2024 05:00	14.09	0.78	407509.5	32.69	0	0	25.3
24/04/2024 06:00	14.08	0.71	411978.3	33.38	0	0	24.9
24/04/2024 07:00	14.07	0.67	415190.7	33.86	0	0	24.3
24/04/2024 08:00	14.14	0.59	406872.4	32.37	0	0	25.3
24/04/2024 09:00	14.27	0.77	488651.5	41.27	0	0	23.7
24/04/2024 10:00	14.21	0.71	477221.1	40.41	0	0	21.9
24/04/2024 11:00	14.22	0.68	270255.5	39.26	0	0	19.8
24/04/2024 12:00	17	0.7	411738.4	39.09	0	0	12
24/04/2024 13:00	14.91	0.69	362934	25.03	0.1	0	25.3
24/04/2024 14:00	14.17	0.82	457267.2	38.43	0	0	20.3
24/04/2024 15:00	14.16	0.87	456174.9	38.33	0	0	20.2
24/04/2024 16:00	14.18	0.7	439631.2	38.7	0	0	19.7
24/04/2024 17:00	14.19	0.67	470955.3	39.73	0	0	19.1
24/04/2024 18:00	14.17	0.71	469715.6	39.61	0	0	19.1
24/04/2024 19:00	14.16	0.78	473448.2	40.11	0	0	18.8
24/04/2024 20:00	14.17	0.91	481446.6	40.92	0	0	18.7
24/04/2024 21:00	14.18	0.91	485285.9	41.33	0	0	18.7
24/04/2024 22:00	14.21	0.93	494104.3	42.18	0	0	19
24/04/2024 23:00	14.18	0.98	490764.8	41.88	0	0	18.8
24/04/2024 24:00	14.18	0.95	489759.8	41.8	0	0	18.7
Minimum	14.07	0.59	270255.5	25.03	0	0	12
MinDate	04/24/2024 7:00:00	04/24/2024 8:00:00	04/24/2024 11:00:00	04/24/2024 13:00:00	04/24/2024 1:00:00	04/24/2024 1:00:00	04/24/2024 12:00:00
Maximum	17	0.98	494104.3	42.18	0.1	0	25.3
MaxDate	04/24/2024 12:00:00	04/24/2024 23:00:00	04/24/2024 22:00:00	04/24/2024 22:00:00	04/24/2024 13:00:00	04/24/2024 1:00:00	04/24/2024 5:00:00
Avg	14.31	0.78	441027.6	37.59	0	0	21.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.6	0.1	50806.7	4.1	0	0	3.3
Site ABPR52 Daily: 24/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
24/04/2024 01:00	14.76	0.61	453941.3	37.98	0	1.6	19.4
24/04/2024 02:00	14.68	0.61	423812.8	35.22	0	1.6	19.1
24/04/2024 03:00	14.68	0.68	421604.3	34.98	0	1.7	18.7
24/04/2024 04:00	14.68	0.65	413716	33.98	0	1.7	19
24/04/2024 05:00	14.69	0.62	404880.7	32.77	0	1.7	20.3
24/04/2024 06:00	14.69	0.55	409549.5	33.45	0	1.7	19.6
24/04/2024 07:00	14.68	0.51	413033.9	33.93	0	1.7	18.9
24/04/2024 08:00	14.77	0.5	404510.2	32.44	0	1.8	19.5
24/04/2024 09:00	14.91	0.55	486789.1	41.32	0	1.8	18.3
24/04/2024 10:00	14.97	0.57	480390.6	40.44	0	1.8	19.1
24/04/2024 11:00	14.99	0.56	469450.3	39.35	0	1.8	19.6
24/04/2024 12:00	14.99	0.62	467931.3	39.17	0	1.8	19.6
24/04/2024 13:00	15.19	0.73	361610.5	25.02	0	1.8	26.8
24/04/2024 14:00	15.79	0.75	462328.5	38.47	0.3	1.4	13.9
24/04/2024 15:00	14.77	0.77	461281.3	38.42	0.2	2.7	5.5



24/04/2024 16:00	14.54	0.62	464474.6	38.76	0	2.6	0.5
24/04/2024 17:00	14.9	0.53	474882.7	39.82	0	2	19.5
24/04/2024 18:00	14.85	0.43	471425.6	39.69	0	1.9	19.6
24/04/2024 19:00	14.8	0.36	474736.7	40.19	0	1.9	18.7
24/04/2024 20:00	14.8	0.38	482574.2	41.01	0	1.9	18.5
24/04/2024 21:00	14.8	0.51	486575.7	41.45	0	1.9	18.4
24/04/2024 22:00	14.81	0.55	495271.8	42.29	0	1.9	18.9
24/04/2024 23:00	14.81	0.67	491058.8	42	0	1.9	18.1
24/04/2024 24:00	14.81	0.67	491084.7	42.02	0	1.9	17.8
Minimum	14.54	0.36	361610.5	25.02	0	1.4	0.5
MinDate	04/24/2024 16:00:00	04/24/2024 19:00:00	04/24/2024 13:00:00	04/24/2024 13:00:00	04/24/2024 1:00:00	04/24/2024 14:00:00	04/24/2024 16:00:00
Maximum	15.79	0.77	495271.8	42.29	0.3	2.7	26.8
MaxDate	04/24/2024 14:00:00	04/24/2024 15:00:00	04/24/2024 22:00:00	04/24/2024 22:00:00	04/24/2024 14:00:00	04/24/2024 15:00:00	04/24/2024 13:00:00
Avg	14.85	0.58	452788.2	37.67	0	1.9	17.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.2	0.1	36436.4	4.2	0.1	0.3	5
Site ABPR51 Daily: 25/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
25/04/2024 01:00	14.15	0.85	450515.2	37.3	0	0	19.9
25/04/2024 02:00	14.05	0.76	425652.7	35.15	0	0	19.8
25/04/2024 03:00	14.05	0.73	425682.8	35.17	0	0	19.8
25/04/2024 04:00	14.04	0.75	420587.6	34.62	0	0	19.9
25/04/2024 05:00	14.03	0.78	413661.3	33.85	0	0	20.5
25/04/2024 06:00	14.03	0.79	412563.1	33.63	0	0	21
25/04/2024 07:00	14.03	0.75	415650.5	34.04	0	0	20.5
25/04/2024 08:00	14.08	0.61	408885.1	32.85	0	0	21.3
25/04/2024 09:00	14.18	0.78	479144	40.72	0	0	18.2
25/04/2024 10:00	15.3	0.78	485846.2	41.32	0	0	15.4
25/04/2024 11:00	17.92	0.76	482790.6	40.94	0	0	7.6
25/04/2024 12:00	14.62	0.82	482140.3	40.8	37.9	15.3	42.2
25/04/2024 13:00	14.34	0.69	373227.1	26.74	0	0	37.1
25/04/2024 14:00	14.23	0.8	490328.7	41.62	0	0	30.6
25/04/2024 15:00	14.22	0.83	486354.1	41.2	0	0	30.7
25/04/2024 16:00	14.22	0.73	491190.7	41.72	0.3	0.3	31
25/04/2024 17:00	14.22	0.73	493641.4	41.97	0.3	0.3	31.4
25/04/2024 18:00	14.22	0.87	496953.6	42.34	0.3	0.3	31.7
25/04/2024 19:00	14.21	0.91	491988.1	41.96	0.2	0.2	31.6
25/04/2024 20:00	14.2	1.03	490590.9	41.84	0.2	0.2	31.7
25/04/2024 21:00	14.16	0.93	481083	40.86	0.3	0.3	31.3
25/04/2024 22:00	14.17	0.9	482915.5	41.11	0.2	0.3	31.2
25/04/2024 23:00	14.17	0.92	486237	41.46	0.3	0.3	31.2
25/04/2024 24:00	14.19	0.96	489059.5	41.79	0.4	0.3	31.5
Minimum	14.03	0.61	373227.1	26.74	0	0	7.6
MinDate	04/25/2024 5:00:00	04/25/2024 8:00:00	04/25/2024 13:00:00	04/25/2024 13:00:00	04/25/2024 1:00:00	04/25/2024 1:00:00	04/25/2024 11:00:00
Maximum	17.92	1.03	496953.6	42.34	37.9	15.3	42.2
MaxDate	04/25/2024 11:00:00	04/25/2024 20:00:00	04/25/2024 18:00:00	04/25/2024 18:00:00	04/25/2024 12:00:00	04/25/2024 12:00:00	04/25/2024 12:00:00
Avg	14.38	0.81	460695.3	38.54	1.7	0.7	26.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.8	0.1	37350.9	4.2	7.7	3.1	8
Site ABPR52 Daily: 25/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
25/04/2024 01:00	14.77	0.61	449404.5	37.36	0	2	18.4
25/04/2024 02:00	14.69	0.6	424334.9	35.21	0	2	18.3
25/04/2024 03:00	14.68	0.57	424656.8	35.24	0	2	18.2
25/04/2024 04:00	14.68	0.52	419693.2	34.67	0	2	18.2
25/04/2024 05:00	14.68	0.42	412379.2	33.89	0	2	18.3
25/04/2024 06:00	14.69	0.47	411173.8	33.71	0	2	18.4
25/04/2024 07:00	14.71	0.45	414650.7	34.11	0	2	18.3
25/04/2024 08:00	14.76	0.45	407667.8	32.9	0	2	18.8
25/04/2024 09:00	14.87	0.56	481308.4	40.85	0	2.1	17.2
25/04/2024 10:00	14.95	0.68	437610	41.4	0	2.1	19.4
25/04/2024 11:00	15.01	0.75	151995.4	41.04	0	2.1	19.5
25/04/2024 12:00	15.05	0.84	488408.7	40.94	0	2.1	20.8
25/04/2024 13:00	12.92	0.78	373862.6	26.85	32.4	17.8	52
25/04/2024 14:00	14.65	0.7	497192.2	41.66	0	2.1	34.2
25/04/2024 15:00	14.59	0.56	493671.8	41.31	0	2.3	32.9
25/04/2024 16:00	14.61	0.46	498087.8	41.81	0	2.2	33.3
25/04/2024 17:00	14.59	0.49	499948.1	42.09	0	2.2	33.3
25/04/2024 18:00	14.57	0.38	502298.1	42.43	0	2.2	32.9
25/04/2024 19:00	14.51	0.38	495401.9	42.1	0	2.1	31.4
25/04/2024 20:00	14.47	0.51	492427	41.95	0	2.1	30.8
25/04/2024 21:00	14.46	0.67	482802.8	40.96	0	2.2	29.8
25/04/2024 22:00	14.46	0.63	484634.1	41.22	0	2.2	29.7
25/04/2024 23:00	14.46	0.67	488010.2	41.56	0	2.2	29.7
25/04/2024 24:00	14.47	0.67	491193.8	41.88	0	2.2	29.9
Minimum	12.92	0.38	151995.4	26.85	0	2	17.2
MinDate	04/25/2024 13:00:00	04/25/2024 18:00:00	04/25/2024 11:00:00	04/25/2024 13:00:00	04/25/2024 1:00:00	04/25/2024 1:00:00	04/25/2024 9:00:00
Maximum	15.05	0.84	502298.1	42.43	32.4	17.8	52
MaxDate	04/25/2024 12:00:00	04/25/2024 12:00:00	04/25/2024 18:00:00	04/25/2024 18:00:00	04/25/2024 13:00:00	04/25/2024 13:00:00	04/25/2024 13:00:00
Avg	14.6	0.58	446783.9	38.63	1.4	2.8	26
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.4	0.1	74045.7	4.2	6.6	3.2	8.6
Site ABPR51 Daily: 26/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
26/04/2024 01:00	14.15	0.88	447996.5	37.09	0.3	0.3	33.2
26/04/2024 02:00	14.05	0.81	421949.6	34.75	0.3	0.3	32.8
26/04/2024 03:00	14.06	0.85	427733.3	35.39	0.3	0.4	32.6
26/04/2024 04:00	14.05	0.85	421174.3	34.69	0.3	0.4	32.8
26/04/2024 05:00	14.05	0.79	407699.1	32.88	0.3	0.4	34.6
26/04/2024 06:00	14.03	0.79	414808.4	33.95	0.3	0.4	33
26/04/2024 07:00	14.04	0.89	412491.9	33.59	0.4	0.4	33.3
26/04/2024 08:00	14.11	0.63	402726.1	31.97	0.4	0.4	34.4
26/04/2024 09:00	14.19	0.64	475560.3	40.26	0.4	0.5	30.6
26/04/2024 10:00	14.21	0.68	477200.2	40.4	0.3	0.4	30.7
26/04/2024 11:00	14.22	0.7	479920.2	40.65	0.3	0.3	31
26/04/2024 12:00	14.22	0.75	477544.2	40.25	0.3	0.2	31.5
26/04/2024 13:00	14.47	0.69	364994.9	24.51	0.1	0.2	48
26/04/2024 14:00	14.31	0.81	465731.1	38.63	0.4	0.1	33.4



26/04/2024 15:00	14.19	0.76	461707	38.7	0.3	0.1	31.4
26/04/2024 16:00	14.2	0.69	462312	38.82	0.3	0	31.4
26/04/2024 17:00	14.2	0.7	462593.1	38.93	0.3	0	32
26/04/2024 18:00	14.16	0.69	458085	38.44	0.3	0	31.3
26/04/2024 19:00	14.16	0.71	462624.2	38.96	0.2	0	31.1
26/04/2024 20:00	14.16	0.78	466842.3	39.42	0.2	0	30.9
26/04/2024 21:00	14.15	0.78	465007.9	39.34	0.2	0	30.7
26/04/2024 22:00	14.15	0.77	469904.7	39.8	0.2	0.1	30.5
26/04/2024 23:00	14.16	0.76	471475.7	39.99	0.2	0.1	30.6
26/04/2024 24:00	14.15	0.79	473398	40.13	0.2	0.1	30.5
Minimum	14.03	0.63	364994.9	24.51	0.1	0	30.5
MinDate	04/26/2024 6:00:00	04/26/2024 8:00:00	04/26/2024 13:00:00	04/26/2024 13:00:00	04/26/2024 13:00:00	04/26/2024 16:00:00	04/26/2024 22:00:00
Maximum	14.47	0.89	479920.2	40.65	0.4	0.5	48
MaxDate	04/26/2024 13:00:00	04/26/2024 7:00:00	04/26/2024 11:00:00	04/26/2024 11:00:00	04/26/2024 7:00:00	04/26/2024 9:00:00	04/26/2024 13:00:00
Avg	14.16	0.76	447978.3	37.15	0.3	0.2	32.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30783.6	3.8	0.1	0.2	3.5

Site ABPR52 Daily: 26/04/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
26/04/2024 01:00	14.44	0.53	448585.6	37.18	0	2.2	30.8
26/04/2024 02:00	14.35	0.44	421745	34.83	0	2.2	30.3
26/04/2024 03:00	14.35	0.44	427825.8	35.47	0	2.2	30.2
26/04/2024 04:00	14.34	0.48	420977.7	34.75	0	2.3	30.1
26/04/2024 05:00	14.35	0.47	406581.1	32.95	0	2.3	31.3
26/04/2024 06:00	14.33	0.6	414686.8	34.02	0	2.3	30
26/04/2024 07:00	14.35	0.69	412464.5	33.67	0	2.3	30.2
26/04/2024 08:00	14.45	0.66	403694.1	32.17	0	2.3	31.1
26/04/2024 09:00	14.58	0.76	498073.8	42.29	0	2.4	30.9
26/04/2024 10:00	15.61	0.67	479123.3	40.23	1.1	1.8	26.1
26/04/2024 11:00	14.59	0.68	455315.6	37.8	0	0	31.3
26/04/2024 12:00	14.65	0.66	467609.7	38.99	0	0	32.5
26/04/2024 13:00	14.86	0.61	365485.8	24.82	0	0	41.4
26/04/2024 14:00	14.65	0.59	470464.7	39.01	0	0	31.7
26/04/2024 15:00	14.58	0.53	455375.4	37.69	0	0	31.9
26/04/2024 16:00	14.58	0.6	467653.1	38.88	0	0	32.1
26/04/2024 17:00	14.58	0.59	472000.3	39.36	0	0	32.6
26/04/2024 18:00	14.53	0.63	476134.2	39.96	0	0	31.5
26/04/2024 19:00	14.48	0.56	471235.2	39.62	0	0	30.8
26/04/2024 20:00	14.44	0.61	468875.8	39.54	0	0	29.9
26/04/2024 21:00	14.41	0.56	467255.8	39.44	0	0	29.4
26/04/2024 22:00	14.42	0.46	471291.3	39.89	0	0	29.1
26/04/2024 23:00	14.44	0.43	473146.2	40.06	0	0	29.2
26/04/2024 24:00	14.43	0.43	474565.5	40.21	0	0	28.9
Minimum	14.33	0.43	365485.8	24.82	0	0	26.1
MinDate	04/26/2024 6:00:00	04/26/2024 23:00:00	04/26/2024 13:00:00	04/26/2024 13:00:00	04/26/2024 1:00:00	04/26/2024 11:00:00	04/26/2024 10:00:00
Maximum	15.61	0.76	498073.8	42.29	1.1	2.4	41.4
MaxDate	04/26/2024 10:00:00	04/26/2024 9:00:00	04/26/2024 9:00:00	04/26/2024 9:00:00	04/26/2024 10:00:00	04/26/2024 9:00:00	04/26/2024 13:00:00
Avg	14.53	0.57	449590.3	37.2	0	0.9	31
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.3	0.1	32356.8	3.8	0.2	1.1	2.6

Site ABPR51 Daily: 27/04/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
27/04/2024 01:00	14.15	0.71	433761.5	35.34	0.2	0.2	33
27/04/2024 02:00	14.05	0.71	408121.2	32.89	0.4	0.2	33.3
27/04/2024 03:00	14.05	0.8	408328.8	32.95	0.3	0.2	33.1
27/04/2024 04:00	14.07	0.75	403653.8	32.23	0.3	0.3	33.6
27/04/2024 05:00	14.1	0.79	401070.4	31.81	0.3	0.3	34.3
27/04/2024 06:00	14.08	0.8	402901.1	32.04	0.4	0.3	34.3
27/04/2024 07:00	14.09	0.7	400754.8	31.68	0.4	0.4	34.6
27/04/2024 08:00	14.18	0.54	389635.3	29.79	0.4	0.3	35.3
27/04/2024 09:00	14.15	0.72	463065.3	39.08	0.3	0.3	29.9
27/04/2024 10:00	14.15	0.68	463157.3	39.03	0.3	0.2	30
27/04/2024 11:00	14.16	0.7	463204.9	38.94	0.3	0.1	30
27/04/2024 12:00	14.12	0.65	427811.9	34.9	0.3	0.1	31.2
27/04/2024 13:00	14.55	0.68	352290.7	22.04	0.1	0.1	53.3
27/04/2024 14:00	14.1	0.71	429422.7	35.27	0.3	0	31
27/04/2024 15:00	14.09	0.71	433624.5	35.8	0.3	0	30.7
27/04/2024 16:00	14.1	0.6	435581	36.07	0.3	0	30.5
27/04/2024 17:00	14.15	0.71	453905.4	37.93	0.3	0	30.6
27/04/2024 18:00	14.15	0.66	456987	38.37	0.3	0	30.7
27/04/2024 19:00	14.13	0.68	457776.1	38.49	0.2	0	30.6
27/04/2024 20:00	14.15	0.79	466441.5	39.38	0.3	0	30.3
27/04/2024 21:00	14.13	0.91	460810.3	38.86	0.3	0	30.3
27/04/2024 22:00	14.14	0.89	463858	39.2	0.2	0	30.2
27/04/2024 23:00	14.12	0.85	458354.8	38.61	0.2	0	30.3
27/04/2024 24:00	14.13	0.87	461086.7	38.86	0.2	0	30.2
Minimum	14.05	0.54	352290.7	22.04	0.1	0	29.9
MinDate	04/27/2024 2:00:00	04/27/2024 8:00:00	04/27/2024 13:00:00	04/27/2024 13:00:00	04/27/2024 13:00:00	04/27/2024 14:00:00	04/27/2024 9:00:00
Maximum	14.55	0.91	466441.5	39.38	0.4	0.4	53.3
MaxDate	04/27/2024 13:00:00	04/27/2024 21:00:00	04/27/2024 20:00:00	04/27/2024 20:00:00	04/27/2024 2:00:00	04/27/2024 7:00:00	04/27/2024 13:00:00
Avg	14.14	0.73	433150.2	35.4	0.3	0.1	32.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	31014.6	4.2	0.1	0.1	4.8

Site ABPR52 Daily: 27/04/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
27/04/2024 01:00	14.42	0.32	434481.8	35.46	0	0	30.5
27/04/2024 02:00	14.35	0.36	407356.3	32.97	0	0	30.4
27/04/2024 03:00	14.36	0.5	407611.9	33.03	0	0	30.3
27/04/2024 04:00	14.38	0.45	403037.9	32.32	0	0	30.8
27/04/2024 05:00	14.38	0.52	399918.6	31.88	0	0	31.3
27/04/2024 06:00	14.38	0.66	401695.3	32.12	0	0	31.1
27/04/2024 07:00	14.4	0.65	399484.3	31.76	0	0	31.3
27/04/2024 08:00	14.53	0.67	388160.8	29.78	0	0	32.1
27/04/2024 09:00	14.52	0.72	467297.7	39.38	0	0	28.2
27/04/2024 10:00	14.52	0.7	451401.3	37.76	0	0	28.8
27/04/2024 11:00	14.59	0.57	443483.7	36.73	0	0	30
27/04/2024 12:00	14.58	0.58	431228.4	35.13	0	0	30.7
27/04/2024 13:00	15	0.77	348883.7	21.88	0	0	52.1



27/04/2024 14:00	14.57	0.65	441514.9	36.27	0	0	30.5
27/04/2024 15:00	14.53	0.68	437839.7	35.95	0	0	30.6
27/04/2024 16:00	14.53	0.59	440797.8	36.32	0	0	30.4
27/04/2024 17:00	14.55	0.56	457906.9	38.08	0	0	30.3
27/04/2024 18:00	14.53	0.48	464538.5	38.82	0	0	30.2
27/04/2024 19:00	14.48	0.35	469387.2	39.5	0	0	29.5
27/04/2024 20:00	14.45	0.39	468662.2	39.48	0	0	28.9
27/04/2024 21:00	14.43	0.39	462580.1	38.95	0	0	28.6
27/04/2024 22:00	14.44	0.48	465860.1	39.28	0	0	28.5
27/04/2024 23:00	14.42	0.52	459653.3	38.71	0	0	28.3
27/04/2024 24:00	14.43	0.61	462349.9	38.94	0	0	28.1
Minimum	14.35	0.32	348883.7	21.88	0	0	28.1
MinDate	04/27/2024 2:00:00	04/27/2024 1:00:00	04/27/2024 13:00:00	04/27/2024 13:00:00	04/27/2024 1:00:00	04/27/2024 1:00:00	
Maximum	15	0.77	469387.2	39.5	0	0	52.1
MaxDate	04/27/2024 13:00:00	04/27/2024 13:00:00	04/27/2024 19:00:00	04/27/2024 19:00:00	04/27/2024 1:00:00	04/27/2024 1:00:00	04/27/2024 13:00:00
Avg	14.49	0.55	433963.8	35.44	0	0	30.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	32293.5	4.2	0	0	4.7
Site ABPR51 Daily: 28/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
28/04/2024 01:00	14.13	0.9	426721.1	34.54	0.2	0.1	32.9
28/04/2024 02:00	14.08	0.82	402439.8	31.93	0.2	0.1	33.7
28/04/2024 03:00	14.07	0.73	405791.8	32.57	0.3	0.2	33.7
28/04/2024 04:00	14.11	0.75	400146.2	31.59	0.3	0.2	34.4
28/04/2024 05:00	14.12	0.75	396116.5	30.93	0.2	0.1	34.3
28/04/2024 06:00	14.11	0.71	397934.4	31.26	0.3	0.2	34.4
28/04/2024 07:00	14.14	0.67	393586.6	30.53	0.4	0.2	34
28/04/2024 08:00	14.23	0.53	384377	28.84	0.3	0.1	32.6
28/04/2024 09:00	14.26	0.54	382058.7	28.4	0.2	0.1	33
28/04/2024 10:00	14.25	0.55	382967.4	28.6	0.2	0	33
28/04/2024 11:00	14.24	0.58	384176.5	28.85	0.2	0	33.6
28/04/2024 12:00	14.25	0.59	383649.5	28.7	0.2	0	33.6
28/04/2024 13:00	14.31	0.59	376657.3	27.35	0.1	0	33.1
28/04/2024 14:00	14.26	0.67	382316.9	28.47	0.2	0	33
28/04/2024 15:00	14.22	0.66	385384.8	29	0.2	0	33.3
28/04/2024 16:00	14.22	0.58	385051.8	28.92	0.2	0	33.4
28/04/2024 17:00	14.22	0.58	385132	28.98	0.2	0	33.3
28/04/2024 18:00	14.21	0.53	386285.8	29.27	0.2	0	33.7
28/04/2024 19:00	14.25	0.78	515902.2	44.18	0.2	0	32.3
28/04/2024 20:00	14.24	0.85	515180.8	44.09	0.2	0	31.7
28/04/2024 21:00	14.22	0.87	512887.2	43.97	0.2	0	31.5
28/04/2024 22:00	14.22	0.85	512415.8	43.95	0.2	0	31.7
28/04/2024 23:00	14.22	0.86	512116.1	43.93	0.2	0	31.5
28/04/2024 24:00	14.23	0.84	445785	35.94	0.2	0	32.8
Minimum	14.07	0.53	376657.3	27.35	0.1	0	31.5
MinDate	04/28/2024 3:00:00	04/28/2024 8:00:00	04/28/2024 13:00:00	04/28/2024 13:00:00	04/28/2024 13:00:00	04/28/2024 10:00:00	04/28/2024 21:00:00
Maximum	14.31	0.9	515902.2	44.18	0.4	0.2	34.4
MaxDate	04/28/2024 13:00:00	04/28/2024 1:00:00	04/28/2024 19:00:00	04/28/2024 19:00:00	04/28/2024 7:00:00	04/28/2024 3:00:00	04/28/2024 4:00:00
Avg	14.2	0.7	418961.8	33.12	0.2	0.1	33.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	51923.6	6.1	0.1	0.1	0.9
Site ABPR52 Daily: 28/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
28/04/2024 01:00	14.43	0.62	425803.3	34.59	0	0	30
28/04/2024 02:00	14.39	0.64	400680	32.01	0	0	30.8
28/04/2024 03:00	14.38	0.6	405365.3	32.63	0	0	30.7
28/04/2024 04:00	14.43	0.51	399334.7	31.66	0	0	31.4
28/04/2024 05:00	14.44	0.44	395166.4	31.01	0	0	31.4
28/04/2024 06:00	14.43	0.45	396996.4	31.32	0	0	31.5
28/04/2024 07:00	14.46	0.47	392835.3	30.59	0	0	30.9
28/04/2024 08:00	14.57	0.44	383340.2	28.91	0	0	29.3
28/04/2024 09:00	14.65	0.54	381382.8	28.48	0	0	30.2
28/04/2024 10:00	14.7	0.65	383386.5	28.68	0	0	31
28/04/2024 11:00	14.73	0.7	385523.6	28.93	0	0	32.1
28/04/2024 12:00	14.76	0.72	385042.2	28.76	0	0	32.6
28/04/2024 13:00	14.79	0.58	376864.7	27.42	0	0	30.9
28/04/2024 14:00	14.68	0.53	383288.5	28.53	0	0	31.8
28/04/2024 15:00	14.64	0.54	385960.6	29.08	0	0	32.4
28/04/2024 16:00	14.63	0.54	385497.2	28.99	0	0	32.3
28/04/2024 17:00	14.6	0.62	385815.8	29.05	0	0	32
28/04/2024 18:00	14.57	0.58	386586.5	29.32	0	0	32.1
28/04/2024 19:00	14.54	0.57	518325.8	44.23	0	0	33.2
28/04/2024 20:00	14.5	0.58	501841.6	42.68	0	0	30.5
28/04/2024 21:00	14.43	0.52	470063.9	39.68	0	0	28.5
28/04/2024 22:00	14.48	0.47	497902.4	42.47	0	0	29.5
28/04/2024 23:00	14.48	0.43	493796.9	42.04	0	0	29.5
28/04/2024 24:00	14.5	0.37	434402.6	34.92	0	0	29.7
Minimum	14.38	0.37	376864.7	27.42	0	0	28.5
MinDate	04/28/2024 3:00:00		04/28/2024 13:00:00	04/28/2024 13:00:00	04/28/2024 1:00:00	04/28/2024 1:00:00	04/28/2024 21:00:00
Maximum	14.79	0.72	518325.8	44.23	0	0	33.2
MaxDate	04/28/2024 13:00:00	04/28/2024 12:00:00	04/28/2024 19:00:00	04/28/2024 19:00:00	04/28/2024 1:00:00	04/28/2024 1:00:00	04/28/2024 19:00:00
Avg	14.55	0.55	414800.1	32.75	0	0	31
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	45352	5.3	0	0	1.2
Site ABPR51 Daily: 29/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
29/04/2024 01:00	14.25	0.73	380597.2	27.99	0.1	0	31.8
29/04/2024 02:00	14.2	0.69	386179.7	29.1	0.1	0	32.2
29/04/2024 03:00	14.22	0.7	383889.9	28.69	0.1	0	31.9
29/04/2024 04:00	14.24	0.71	382002.6	28.31	0.2	0	31.7
29/04/2024 05:00	14.28	0.66	377054.8	27.34	0.2	0	31.7
29/04/2024 06:00	14.24	0.74	382768	28.5	0.2	0	32.3
29/04/2024 07:00	14.23	0.65	383016.6	28.51	0.2	0	32.2
29/04/2024 08:00	14.29	0.54	377779.4	27.63	0.2	0	36.3
29/04/2024 09:00	14.11	0.64	438188.9	36.45	0.3	0	31.3
29/04/2024 10:00	14.14	0.59	440885.8	36.7	0.3	0	31.4
29/04/2024 11:00	14.16	0.66	442833.5	36.88	0.4	0	31.8
29/04/2024 12:00	14.21	0.71	454214.1	37.95	0.3	0	31.1



29/04/2024 13:00	14.44	0.65	363870.1	24.83	0.1	0	43.4
29/04/2024 14:00	14.21	0.84	463696.4	38.79	0.3	0	30.8
29/04/2024 15:00	14.16	0.73	450816	37.59	0.3	0	31
29/04/2024 16:00	14.18	0.68	457210.3	38.27	0.3	0	30.9
29/04/2024 17:00	14.19	0.67	464552.5	39	0.3	0	30.5
29/04/2024 18:00	14.2	0.72	469142	39.48	0.3	0	30.6
29/04/2024 19:00	14.17	0.69	465571.6	39.27	0.3	0	30.4
29/04/2024 20:00	14.15	0.75	460697.3	38.83	0.2	0	30.2
29/04/2024 21:00	14.13	0.73	460361.1	38.81	0.3	0	30.1
29/04/2024 22:00	14.13	0.76	460212.3	38.83	0.3	0	30
29/04/2024 23:00	14.13	0.8	459500.7	38.77	0.3	0	30.1
29/04/2024 24:00	14.14	0.86	462059.1	39	0.3	0	30.1
Minimum	14.11	0.54	363870.1	24.83	0.1	0	30
MinDate	04/29/2024 9:00:00	04/29/2024 8:00:00	04/29/2024 13:00:00	04/29/2024 13:00:00	04/29/2024 1:00:00	04/29/2024 1:00:00	04/29/2024 22:00:00
Maximum	14.44	0.86	469142	39.48	0.4	0	43.4
MaxDate	04/29/2024 13:00:00		04/29/2024 18:00:00	04/29/2024 18:00:00	04/29/2024 11:00:00	04/29/2024 1:00:00	04/29/2024 13:00:00
Avg	14.2	0.7	427795.8	34.4	0.2	0	31.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	38969.1	5.3	0.1	0	2.8
Site ABPR52 Daily: 29/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
29/04/2024 01:00	14.54	0.36	377979.7	28.06	0	0	28.1
29/04/2024 02:00	14.5	0.43	384392.8	29.17	0	0	29.1
29/04/2024 03:00	14.52	0.52	381812.7	28.76	0	0	28.6
29/04/2024 04:00	14.53	0.57	379324.8	28.38	0	0	28.1
29/04/2024 05:00	14.58	0.58	374427.7	27.41	0	0	27.3
29/04/2024 06:00	14.53	0.63	380738.4	28.58	0	0	28.7
29/04/2024 07:00	14.53	0.64	381233	28.58	0	0	28.6
29/04/2024 08:00	14.62	0.62	376513.4	27.7	0	0	32.6
29/04/2024 09:00	14.52	0.66	440973.2	36.53	0	0	29.7
29/04/2024 10:00	14.61	0.54	444953	36.79	0	0	30.6
29/04/2024 11:00	14.68	0.62	447553.7	36.97	0	0	31.4
29/04/2024 12:00	14.79	0.73	459398.3	38.05	0	0	31.1
29/04/2024 13:00	14.93	0.77	363482.8	24.94	0	0	36.6
29/04/2024 14:00	14.66	0.75	468276.3	38.87	0	0	31.4
29/04/2024 15:00	14.61	0.65	456114.8	37.68	0	0	31.1
29/04/2024 16:00	14.61	0.58	462778.9	38.34	0	0	31
29/04/2024 17:00	14.6	0.49	469921.9	39.09	0	0	30.6
29/04/2024 18:00	14.57	0.41	473485.2	39.57	0	0	30.3
29/04/2024 19:00	14.49	0.36	470677.3	39.56	0	0	29.3
29/04/2024 20:00	14.45	0.43	475115.6	40.13	0	0	28.6
29/04/2024 21:00	14.43	0.58	470922.7	39.81	0	0	28.4
29/04/2024 22:00	14.4	0.6	454422.6	38.18	0	0	28.4
29/04/2024 23:00	14.42	0.57	461600.4	38.86	0	0	28.2
29/04/2024 24:00	14.43	0.66	465520.4	39.31	0	0	28
Minimum	14.4	0.36	363482.8	24.94	0	0	27.3
MinDate	04/29/2024 22:00:00	04/29/2024 1:00:00	04/29/2024 13:00:00	04/29/2024 13:00:00	04/29/2024 1:00:00	04/29/2024 1:00:00	04/29/2024 5:00:00
Maximum	14.93	0.77	475115.6	40.13	0	0	36.6
MaxDate	04/29/2024 13:00:00	04/29/2024 13:00:00	04/29/2024 20:00:00	04/29/2024 20:00:00	04/29/2024 1:00:00	04/29/2024 1:00:00	04/29/2024 13:00:00
Avg	14.56	0.57	430067.5	34.56	0	0	29.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	42373.8	5.3	0	0	2
Site ABPR51 Daily: 30/04/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
30/04/2024 01:00	14.15	0.87	427225.5	34.63	0.2	0	33
30/04/2024 02:00	14.04	0.79	411021.9	33.38	0.3	0	32.3
30/04/2024 03:00	14.04	0.77	412223.1	33.51	0.3	0	32.2
30/04/2024 04:00	14.07	0.81	406109.4	32.59	0.3	0	33.3
30/04/2024 05:00	14.11	0.74	400085.7	31.61	0.3	0	34.1
30/04/2024 06:00	14.09	0.72	403234.3	32.12	0.3	0	33.7
30/04/2024 07:00	14.06	0.68	406832.4	32.71	0.3	0	33.2
30/04/2024 08:00	14.18	0.55	392516.6	30.14	0.2	0	35.3
30/04/2024 09:00	14.16	0.76	465263.4	39.19	0.3	0	30
30/04/2024 10:00	14.16	0.65	460760.4	38.71	0.3	0	30.3
30/04/2024 11:00	14.16	0.6	452419.1	37.81	0.4	0	30.4
30/04/2024 12:00	14.17	0.64	455152.3	38.06	0.3	0	30.1
30/04/2024 13:00	14.46	0.6	361534.4	24.23	0.1	0	45.4
30/04/2024 14:00	14.19	0.71	464930.1	38.94	0.3	0	29.9
30/04/2024 15:00	14.17	0.82	456400.7	38.18	0.3	0	30
30/04/2024 16:00	14.16	0.71	458398.9	38.36	0.4	0	30
30/04/2024 17:00	14.16	0.63	461834.8	38.74	0.3	0	29.8
30/04/2024 18:00	14.14	0.63	457268.8	38.3	0.3	0	29.9
30/04/2024 19:00	14.14	0.64	459549.7	38.65	0.3	0	29.9
30/04/2024 20:00	14.13	0.69	459444.6	38.69	0.2	0	30
30/04/2024 21:00	14.12	0.7	457118.3	38.48	0.2	0	30
30/04/2024 22:00	14.13	0.67	459466.3	38.67	0.2	0	30.1
30/04/2024 23:00	14.13	0.7	460042.7	38.76	0.3	0	30.1
30/04/2024 24:00	14.14	0.79	458891.3	38.69	0.3	0	30.3
Minimum	14.04	0.55	361534.4	24.23	0.1	0	29.8
MinDate	04/30/2024 2:00:00	04/30/2024 8:00:00	04/30/2024 13:00:00	04/30/2024 13:00:00	04/30/2024 13:00:00	04/30/2024 1:00:00	04/30/2024 17:00:00
Maximum	14.46	0.87	465263.4	39.19	0.4	0	45.4
MaxDate	04/30/2024 13:00:00	04/30/2024 1:00:00	04/30/2024 9:00:00	04/30/2024 9:00:00	04/30/2024 11:00:00	04/30/2024 1:00:00	04/30/2024 13:00:00
Avg	14.14	0.7	437821.9	35.96	0.3	0	31.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30153.8	3.9	0.1	0	3.4
Site ABPR52 Daily: 30/04/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
30/04/2024 01:00	14.44	0.62	435979.9	35.78	0	0	29.6
30/04/2024 02:00	14.35	0.62	410526.9	33.46	0	0	29.1
30/04/2024 03:00	14.35	0.55	411943.3	33.6	0	0	29.1
30/04/2024 04:00	14.37	0.49	405437.5	32.67	0	0	30
30/04/2024 05:00	14.41	0.44	398895.6	31.69	0	0	30.7
30/04/2024 06:00	14.39	0.43	402504	32.2	0	0	30.4
30/04/2024 07:00	14.38	0.47	406233.8	32.77	0	0	29.9
30/04/2024 08:00	14.51	0.58	390948.6	30.16	0	0	31.8
30/04/2024 09:00	14.56	0.66	468417.5	39.28	0	0	28.4
30/04/2024 10:00	14.63	0.78	464842.8	38.79	0	0	29.2
30/04/2024 11:00	14.7	0.8	456594.7	37.9	0	0	29.8



30/04/2024 12:00	14.7	0.67	459267	38.13	0	0	29.7
30/04/2024 13:00	14.89	0.58	359355.3	24.3	0	0	39.5
30/04/2024 14:00	14.61	0.64	468942	39.04	0	0	29.6
30/04/2024 15:00	14.59	0.65	461296.3	38.27	0	0	29.7
30/04/2024 16:00	14.59	0.64	462534.6	38.45	0	0	29.7
30/04/2024 17:00	14.56	0.63	465939.7	38.85	0	0	29.1
30/04/2024 18:00	14.5	0.54	460233.8	38.4	0	0	28.7
30/04/2024 19:00	14.46	0.47	461406.7	38.74	0	0	28.2
30/04/2024 20:00	14.43	0.47	461092.8	38.77	0	0	28
30/04/2024 21:00	14.42	0.43	459045	38.58	0	0	27.9
30/04/2024 22:00	14.44	0.41	460857	38.76	0	0	27.9
30/04/2024 23:00	14.45	0.37	461955.8	38.85	0	0	27.9
30/04/2024 24:00	14.46	0.4	462437.3	38.9	0	0	28
Minimum	14.35	0.37	359355.3	24.3	0	0	27.9
MinDate	04/30/2024 2:00:00	04/30/2024 23:00:00	04/30/2024 13:00:00	04/30/2024 13:00:00	04/30/2024 1:00:00	04/30/2024 1:00:00	04/30/2024 21:00:00
Maximum	14.89	0.8	468942	39.28	0	0	39.5
MaxDate	04/30/2024 13:00:00	04/30/2024 11:00:00	04/30/2024 14:00:00	04/30/2024 9:00:00	04/30/2024 1:00:00	04/30/2024 1:00:00	04/30/2024 13:00:00
Avg	14.51	0.56	439862	36.1	0	0	29.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	32066.8	3.9	0	0	2.3



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 01/05/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
01/05/2024 01:00	14.15	0.64	394985.4	30.65	0.4	0	34.5
01/05/2024 02:00	14.07	0.68	405424.2	32.5	0.4	0	33.2
01/05/2024 03:00	14.07	0.64	405170.5	32.39	0.3	0	33.1
01/05/2024 04:00	14.1	0.69	400920.9	31.68	0.3	0	33.7
01/05/2024 05:00	14.13	0.66	396287.2	30.97	0.3	0	33.7
01/05/2024 06:00	14.14	0.7	395587.6	30.79	0.3	0	33.4
01/05/2024 07:00	14.2	0.65	385911.8	29.09	0.2	0	32.1
01/05/2024 08:00	14.31	0.64	373021.7	26.57	0.2	0	33
01/05/2024 09:00	14.42	0.53	362303.2	24.59	0.1	0	41.5
01/05/2024 10:00	14.46	0.54	359885.8	24.12	0.1	0	44.4
01/05/2024 11:00	14.34	0.68	406136	30.79	0.2	0	39
01/05/2024 12:00	14.1	0.68	419649.7	34.18	0.3	0	31.7
01/05/2024 13:00	14.09	0.72	419037	34.14	0.3	0	31.5
01/05/2024 14:00	14.1	0.75	418396	34.08	0.3	0	31.5
01/05/2024 15:00	14.1	0.72	418870.1	34.14	0.3	0	31.5
01/05/2024 16:00	14.09	0.63	419244.9	34.16	0.3	0	31.7
01/05/2024 17:00	14.09	0.6	420788.8	34.39	0.3	0	31.7
01/05/2024 18:00	14.09	0.59	420220.2	34.32	0.3	0	31.3
01/05/2024 19:00	14.06	0.56	420660.1	34.43	0.2	0	30.7
01/05/2024 20:00	14.03	0.59	420148.7	34.42	0.2	0	30.5
01/05/2024 21:00	14.03	0.61	419260.9	34.37	0.2	0	30.4
01/05/2024 22:00	14.03	0.61	419028.9	34.36	0.2	0	30.2
01/05/2024 23:00	14.03	0.61	419126.3	34.37	0.2	0	30.4
01/05/2024 24:00	14.03	0.63	419724.9	34.4	0.2	0	30.4
Minimum	14.03	0.53	359885.8	24.12	0.1	0	30.2
MinDate	05/01/2024 20:00:00	05/01/2024 9:00:00	05/01/2024 10:00:00	05/01/2024 10:00:00	05/01/2024 9:00:00	05/01/2024 1:00:00	05/01/2024 22:00:00
Maximum	14.46	0.75	420788.8	34.43	0.4	0	44.4
MaxDate	05/01/2024 10:00:00	05/01/2024 14:00:00	05/01/2024 17:00:00	05/01/2024 19:00:00	05/01/2024 1:00:00	05/01/2024 1:00:00	05/01/2024 10:00:00
Avg	14.14	0.64	405824.6	32.08	0.3	0	33.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	18963	3.2	0.1	0	3.6
Site ABPR52 Daily: 01/05/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
01/05/2024 01:00	14.46	0.45	393604.9	30.72	0	0	30.9
01/05/2024 02:00	14.4	0.48	405372.3	32.58	0	0	29.7
01/05/2024 03:00	14.4	0.52	403989.7	32.47	0	0	29.7
01/05/2024 04:00	14.43	0.55	399792.7	31.75	0	0	30.4
01/05/2024 05:00	14.45	0.6	395642.7	31.05	0	0	30.5
01/05/2024 06:00	14.45	0.6	394726.8	30.87	0	0	30.3
01/05/2024 07:00	14.51	0.62	384491.4	29.16	0	0	28.5
01/05/2024 08:00	14.63	0.63	370103.1	26.63	0	0	27.6
01/05/2024 09:00	14.77	0.58	359443.9	24.65	0	0	34.9
01/05/2024 10:00	14.86	0.56	357395.7	24.17	0	0	37.7
01/05/2024 11:00	14.78	0.58	406006.6	30.82	0	0	35.6
01/05/2024 12:00	14.63	0.66	422076.4	34.21	0	0	31.7
01/05/2024 13:00	14.6	0.73	421349.8	34.23	0	0	31.7
01/05/2024 14:00	14.59	0.75	420723.3	34.15	0	0	31.5
01/05/2024 15:00	14.58	0.66	422035.1	34.21	0	0	31.7
01/05/2024 16:00	14.55	0.56	422050.8	34.23	0	0	31.9
01/05/2024 17:00	14.54	0.44	423605.3	34.46	0	0	31.8
01/05/2024 18:00	14.48	0.48	422033.6	34.39	0	0	31.1
01/05/2024 19:00	14.41	0.48	421056.7	34.51	0	0	29.8
01/05/2024 20:00	14.35	0.52	419669.3	34.47	0	0	28.9
01/05/2024 21:00	14.34	0.56	418999	34.45	0	0	28.5
01/05/2024 22:00	14.34	0.61	418880.1	34.43	0	0	28.1
01/05/2024 23:00	14.34	0.63	419319.5	34.44	0	0	28.2
01/05/2024 24:00	14.35	0.55	419221.6	34.48	0	0	28.2
Minimum	14.34	0.44	357395.7	24.17	0	0	27.6
MinDate	05/01/2024 21:00:00	05/01/2024 17:00:00	05/01/2024 10:00:00	05/01/2024 10:00:00	05/01/2024 1:00:00	05/01/2024 1:00:00	05/01/2024 8:00:00
Maximum	14.86	0.75	423605.3	34.51	0	0	37.7
MaxDate	05/01/2024 10:00:00	05/01/2024 14:00:00	05/01/2024 17:00:00	05/01/2024 19:00:00	05/01/2024 1:00:00	05/01/2024 1:00:00	05/01/2024 10:00:00
Avg	14.51	0.58	405899.7	32.15	0	0	30.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	20434.4	3.2	0	0	2.5
Site ABPR51 Daily: 02/05/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
02/05/2024 01:00	Shutdown	0.56	Shutdown	3.35	Shutdown	Shutdown	Shutdown
02/05/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/05/2024 03:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
02/05/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/05/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/05/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/05/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/05/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
02/05/2024 09:00	Shutdown	0.35	Shutdown	3.95	Shutdown	Shutdown	Shutdown
02/05/2024 10:00	14.23	0.51	424662	33.41	0.5	0	31.5
02/05/2024 11:00	14.14	0.52	436144.2	35.89	0.3	0	29.4
02/05/2024 12:00	14.16	0.56	444270.2	36.77	0.3	0	29.2
02/05/2024 13:00	14.39	0.63	383813.4	27.15	0.2	0	41.8
02/05/2024 14:00	14.27	0.75	435893.4	34.93	0.3	0	33.8
02/05/2024 15:00	14.17	0.81	451533.3	37.6	0.4	0	30.2
02/05/2024 16:00	14.19	0.68	463491.5	38.78	0.3	0	29.7
02/05/2024 17:00	14.2	0.73	466717.5	39.13	0.3	0	29.8
02/05/2024 18:00	14.19	0.72	467260.1	39.25	0.3	0	29.8
02/05/2024 19:00	14.15	0.71	461897.8	38.82	0.3	0	29.4
02/05/2024 20:00	14.15	0.74	465595.5	39.29	0.2	0	29.2
02/05/2024 21:00	14.14	0.73	466469.3	39.38	0.2	0	29.1
02/05/2024 22:00	14.13	0.71	463678.6	39.17	0.2	0	29.2
02/05/2024 23:00	14.12	0.71	461611.6	39	0.3	0	29.4
02/05/2024 24:00	14.13	0.74	459702.4	38.76	0.3	0	29.7
Minimum	14.12	0.01	383813.4	0	0.2	0	29.1
MinDate	05/02/2024 23:00:00	05/02/2024 2:00:00	05/02/2024 13:00:00	05/02/2024 2:00:00	05/02/2024 13:00:00	05/02/2024 10:00:00	05/02/2024 21:00:00
Maximum	14.39	0.81	467260.1	39.38	0.5	0	41.8
MaxDate	05/02/2024 13:00:00	05/02/2024 15:00:00	05/02/2024 18:00:00	05/02/2024 21:00:00	05/02/2024 10:00:00	05/02/2024 10:00:00	05/02/2024 13:00:00
Avg	14.18	0.49	450182.7	24.55	0.3	0	30.7
Num	15	23	15	23	15	15	15



Data[%]	63	96	63	96	63	63	63
STD	0.1	0.3	22803.4	17.9	0.1	0	3.3
Site ABPR52 Daily: 02/05/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
02/05/2024 01:00	14.55	0.61	466222.2	38.26	0	0	31.4
02/05/2024 02:00	14.51	0.67	498914	42.87	0	0	28.8
02/05/2024 03:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
02/05/2024 04:00	14.52	0.53	498457.4	42.89	0	0	29
02/05/2024 05:00	14.52	0.49	498412.1	42.93	0	0	29
02/05/2024 06:00	14.53	0.52	497682	42.87	0	0	28.9
02/05/2024 07:00	14.52	0.54	497269.1	42.83	0	0	28.6
02/05/2024 08:00	14.55	0.57	498774.9	42.82	0	0	28.9
02/05/2024 09:00	14.61	0.6	476926.4	39.88	0	0	30.1
02/05/2024 10:00	14.59	0.67	417548.3	33.44	0	0	30
02/05/2024 11:00	14.57	0.73	436714.7	35.98	0	0	29.3
02/05/2024 12:00	14.59	0.71	445243.2	36.84	0	0	29.3
02/05/2024 13:00	14.8	0.71	382148.7	27.26	0	0	37.6
02/05/2024 14:00	14.69	0.58	436799.3	34.84	0	0	32
02/05/2024 15:00	14.63	0.5	455986.6	37.7	0	0	30.1
02/05/2024 16:00	14.61	0.51	467235.2	38.89	0	0	29.6
02/05/2024 17:00	14.59	0.52	470882	39.23	0	0	29.6
02/05/2024 18:00	14.56	0.54	470577.7	39.33	0	0	29.3
02/05/2024 19:00	14.48	0.53	463515.1	38.9	0	0	28.1
02/05/2024 20:00	14.45	0.65	467262.5	39.39	0	0	27.6
02/05/2024 21:00	14.44	0.6	467127.5	39.47	0	0	27.3
02/05/2024 22:00	14.44	0.59	465367.5	39.25	0	0	27.3
02/05/2024 23:00	14.44	0.59	463060.9	39.07	0	0	27.4
02/05/2024 24:00	14.45	0.51	461129.9	38.84	0	0	27.6
Minimum	14.44	0.49	382148.7	27.26	0	0	27.3
MinDate	05/02/2024 21:00:00	05/02/2024 5:00:00	05/02/2024 13:00:00	05/02/2024 13:00:00	05/02/2024 1:00:00	05/02/2024 1:00:00	05/02/2024 21:00:00
Maximum	14.8	0.73	498914	42.93	0	0	37.6
MaxDate	05/02/2024 13:00:00	05/02/2024 11:00:00	05/02/2024 2:00:00	05/02/2024 5:00:00	05/02/2024 1:00:00	05/02/2024 1:00:00	05/02/2024 13:00:00
Avg	14.55	0.59	465359	38.86	0	0	29.4
Num	23	23	23	23	23	23	23
Data[%]	96	96	96	96	96	96	96
STD	0.1	0.1	28652.2	3.6	0	0	2.2
Site ABPR51 Daily: 03/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
03/05/2024 01:00	14.26	0.73	465501.8	38.5	0.2	0	33.9
03/05/2024 02:00	14.22	0.76	498678.1	43.02	0.4	0	30.3
03/05/2024 03:00	14.22	0.82	498379.5	43	0.3	0	30.5
03/05/2024 04:00	14.22	0.82	498127.7	43	0.3	0	30.5
03/05/2024 05:00	14.22	0.84	497840.6	43	0.3	0	30.7
03/05/2024 06:00	14.22	0.82	499026.6	43.11	0.3	0	30.7
03/05/2024 07:00	14.22	0.81	498288	43.03	0.3	0	30.4
03/05/2024 08:00	14.22	0.67	499093.6	43.08	0.4	0	30.3
03/05/2024 09:00	14.21	0.71	487650.1	41.53	0.3	0	30.6
03/05/2024 10:00	14.22	0.65	448897.3	37.03	0.3	0	32.2
03/05/2024 11:00	14.2	0.72	460948.1	38.68	0.3	0	30.4
03/05/2024 12:00	14.2	0.72	457735.8	38.33	0.3	0	30.6
03/05/2024 13:00	14.36	0.73	387969.2	28.37	0.2	0	39.5
03/05/2024 14:00	14.28	0.77	443965.2	35.83	0.2	0	33.6
03/05/2024 15:00	14.2	0.88	466013	39.11	0.3	0	29.6
03/05/2024 16:00	14.19	0.8	464475.5	38.9	0.3	0	29.7
03/05/2024 17:00	14.19	0.76	462717.4	38.72	0.3	0	30
03/05/2024 18:00	14.19	0.71	469470.8	39.52	0.3	0	29.8
03/05/2024 19:00	14.16	0.71	469656.6	39.6	0.3	0	29.5
03/05/2024 20:00	14.16	0.72	465779.2	39.35	0.2	0	29.6
03/05/2024 21:00	14.15	0.72	467947.6	39.6	0.2	0	29.5
03/05/2024 22:00	14.14	0.73	467276.4	39.48	0.2	0	29.4
03/05/2024 23:00	14.14	0.72	468386.1	39.66	0.2	0	29.5
03/05/2024 24:00	14.14	0.78	468355.8	39.63	0.3	0	29.5
Minimum	14.14	0.65	387969.2	28.37	0.2	0	29.4
MinDate	05/03/2024 22:00:00	05/03/2024 10:00:00	05/03/2024 13:00:00	05/03/2024 13:00:00	05/03/2024 1:00:00	05/03/2024 1:00:00	05/03/2024 22:00:00
Maximum	14.36	0.88	499093.6	43.11	0.4	0	39.5
MaxDate	05/03/2024 13:00:00	05/03/2024 15:00:00	05/03/2024 8:00:00	05/03/2024 6:00:00	05/03/2024 2:00:00	05/03/2024 1:00:00	05/03/2024 13:00:00
Avg	14.21	0.75	471340.8	39.71	0.3	0	30.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	24840.1	3.2	0.1	0	2.2
Site ABPR52 Daily: 03/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
03/05/2024 01:00	Shutdown	0.61	Shutdown	3.75	Shutdown	Shutdown	Shutdown
03/05/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
03/05/2024 03:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
03/05/2024 04:00	Shutdown	4.19	Shutdown	0	Shutdown	Shutdown	Shutdown
03/05/2024 05:00	Shutdown	9.92	Shutdown	0	Shutdown	Shutdown	Shutdown
03/05/2024 06:00	Shutdown	5.32	Shutdown	0	Shutdown	Shutdown	Shutdown
03/05/2024 07:00	Shutdown	0.75	Shutdown	0	Shutdown	Shutdown	Shutdown
03/05/2024 08:00	Shutdown	1.11	Shutdown	0	Shutdown	Shutdown	Shutdown
03/05/2024 09:00	Shutdown	1.29	Shutdown	2.19	Shutdown	Shutdown	Shutdown
03/05/2024 10:00	14.7	0.75	460095.7	37.12	0	0	30.8
03/05/2024 11:00	14.75	0.74	468775.3	38.78	0	0	30.5
03/05/2024 12:00	14.77	0.61	465139.4	38.43	0	0	30.9
03/05/2024 13:00	14.89	0.68	389760.8	28.42	0	0	34.4
03/05/2024 14:00	14.75	0.68	448489.5	35.96	0	0	32.6
03/05/2024 15:00	14.66	0.7	472049.3	39.18	0	0	30.1
03/05/2024 16:00	14.65	0.72	469414.9	38.96	0	0	30.3
03/05/2024 17:00	14.63	0.53	466915.6	38.77	0	0	30.2
03/05/2024 18:00	14.57	0.5	473100.5	39.59	0	0	29.7
03/05/2024 19:00	14.5	0.42	472248.7	39.71	0	0	28.8
03/05/2024 20:00	14.47	0.44	468492.4	39.44	0	0	28.2
03/05/2024 21:00	14.44	0.56	469658.3	39.67	0	0	27.8
03/05/2024 22:00	14.43	0.56	468269.7	39.58	0	0	27.6
03/05/2024 23:00	14.44	0.54	469780.2	39.74	0	0	27.6
03/05/2024 24:00	14.44	0.66	469727.2	39.7	0	0	27.5
Minimum	14.43	0	389760.8	0	0	0	27.5
MinDate	05/03/2024 22:00:00	05/03/2024 2:00:00	05/03/2024 13:00:00	05/03/2024 2:00:00	05/03/2024 10:00:00	05/03/2024 10:00:00	
Maximum	14.89	9.92	473100.5	39.74	0	0	34.4
MaxDate	05/03/2024 13:00:00	05/03/2024 5:00:00	05/03/2024 18:00:00	05/03/2024 23:00:00	05/03/2024 10:00:00	05/03/2024 10:00:00	05/03/2024 13:00:00
Avg	14.61	1.35	462127.8	24.12	0	0	29.8



Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	2.2	20924.3	18.7	0	0	2
Site ABPR51 Daily: 04/05/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
04/05/2024 01:00	14.26	0.77	463650.9	38.34	0.4	0	33.9
04/05/2024 02:00	14.22	0.73	498370.2	43.02	0.4	0	30.4
04/05/2024 03:00	14.22	0.75	498090.7	43.03	0.4	0	30.5
04/05/2024 04:00	14.22	0.7	498178.7	43.03	0.3	0	30.4
04/05/2024 05:00	14.22	0.75	498191.4	43.07	0.3	0	30.4
04/05/2024 06:00	14.22	0.86	497877.1	43.03	0.4	0	30.3
04/05/2024 07:00	14.22	0.9	496689.7	42.98	0.4	0	30.3
04/05/2024 08:00	14.22	0.68	498448.4	43.07	0.4	0	30
04/05/2024 09:00	14.2	0.58	487191.7	41.58	0.3	0	30
04/05/2024 10:00	14.2	0.68	447492.9	36.78	0.2	0	31.1
04/05/2024 11:00	14.21	0.84	474425.1	40.06	0.3	0	29.6
04/05/2024 12:00	14.18	0.69	467360.4	39.33	0.2	0	29.4
04/05/2024 13:00	14.4	0.57	381952.8	26.98	0.1	0	42.4
04/05/2024 14:00	14.24	0.61	438914.7	34.46	0.2	0	33.9
04/05/2024 15:00	14.19	0.78	467414.3	39.23	0.3	0	29.1
04/05/2024 16:00	14.15	0.58	454227.1	37.97	0.3	0	29.4
04/05/2024 17:00	14.16	0.65	458387.3	38.34	0.3	0	29.8
04/05/2024 18:00	14.17	0.65	462290.3	38.81	0.3	0	30.1
04/05/2024 19:00	14.14	0.63	453842.6	38.09	0.2	0	30
04/05/2024 20:00	14.1	0.66	451081.1	37.86	0.2	0	30
04/05/2024 21:00	14.11	0.66	454635.1	38.29	0.2	0	29.7
04/05/2024 22:00	14.11	0.69	457270.8	38.53	0.2	0	29.7
04/05/2024 23:00	14.1	0.7	453427.4	38.13	0.2	0	29.6
04/05/2024 24:00	14.12	0.69	459437.5	38.74	0.2	0	29.4
Minimum	14.1	0.57	381952.8	26.98	0.1	0	29.1
MinDate	05/04/2024 20:00:00	05/04/2024 13:00:00	05/04/2024 13:00:00	05/04/2024 13:00:00	05/04/2024 13:00:00	05/04/2024 1:00:00	05/04/2024 15:00:00
Maximum	14.4	0.9	498448.4	43.07	0.4	0	42.4
MaxDate	05/04/2024 13:00:00	05/04/2024 7:00:00	05/04/2024 8:00:00	05/04/2024 5:00:00	05/04/2024 1:00:00	05/04/2024 1:00:00	05/04/2024 13:00:00
Avg	14.19	0.7	467452	39.28	0.3	0	30.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	26999.9	3.6	0.1	0	2.7
Site ABPR52 Daily: 04/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
04/05/2024 01:00	Shutdown	0.74	Shutdown	3.95	Shutdown	Shutdown	Shutdown
04/05/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
04/05/2024 03:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
04/05/2024 04:00	Shutdown	1.25	Shutdown	0	Shutdown	Shutdown	Shutdown
04/05/2024 05:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
04/05/2024 06:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
04/05/2024 07:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
04/05/2024 08:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
04/05/2024 09:00	Shutdown	0.6	Shutdown	1.8	Shutdown	Shutdown	Shutdown
04/05/2024 10:00	14.61	0.54	436619.3	34.69	0.1	0	30.9
04/05/2024 11:00	14.55	0.61	435751.8	35.76	0	0	29.6
04/05/2024 12:00	14.55	0.69	447422.2	36.96	0	0	29.4
04/05/2024 13:00	14.79	0.82	379247.4	26.75	0	0	38.8
04/05/2024 14:00	14.63	0.68	449750	35.48	0	0	32.6
04/05/2024 15:00	14.57	0.64	446402.6	36.73	0	0	29.4
04/05/2024 16:00	14.54	0.42	439007.1	36.13	0	0	28.8
04/05/2024 17:00	14.56	0.45	459716.9	38.15	0	0	28.8
04/05/2024 18:00	14.52	0.44	452769.8	37.59	0	0	29.1
04/05/2024 19:00	14.47	0.43	456589.7	38.29	0	0	28
04/05/2024 20:00	14.42	0.54	452439	37.96	0	0	27.6
04/05/2024 21:00	14.42	0.55	456369.5	38.37	0	0	27.1
04/05/2024 22:00	14.43	0.59	458868.6	38.62	0	0	27.1
04/05/2024 23:00	14.42	0.61	454442.7	38.2	0	0	27.1
04/05/2024 24:00	14.44	0.6	461253.5	38.83	0	0	26.7
Minimum	14.42	0.01	379247.4	0	0	0	26.7
MinDate	05/04/2024 20:00:00	05/04/2024 2:00:00	05/04/2024 13:00:00	05/04/2024 2:00:00	05/04/2024 11:00:00	05/04/2024 10:00:00	
Maximum	14.79	1.25	461253.5	38.83	0.1	0	38.8
MaxDate	05/04/2024 13:00:00	05/04/2024 4:00:00			05/04/2024 10:00:00	05/04/2024 10:00:00	05/04/2024 13:00:00
Avg	14.53	0.49	445776.6	23.09	0	0	29.4
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	20139.4	17.9	0	0	3
Site ABPR51 Daily: 05/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
05/05/2024 01:00	Shutdown	0.52	Shutdown	4.03	Shutdown	Shutdown	Shutdown
05/05/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 05:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 06:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 11:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 12:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 13:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 15:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/05/2024 18:00	Shutdown	0.31	Shutdown	0.71	Shutdown	Shutdown	Shutdown
05/05/2024 19:00	14.16	0.79	414297.7	27.1	1.2	0	34.3
05/05/2024 20:00	14.1	0.67	437115.2	36.14	0.3	0	29.5
05/05/2024 21:00	14.09	0.65	435261.2	36.06	0.2	0	29.2
05/05/2024 22:00	14.09	0.81	438505.9	36.43	0.2	0	29.2
05/05/2024 23:00	14.19	1.05	438645.2	35.67	0.3	0	32.4
05/05/2024 24:00	14.22	0.67	498335.9	42.91	0.3	0	29.7
Minimum	14.09	0.01	414297.7	0	0.2	0	29.2
MinDate	05/05/2024 21:00:00	05/05/2024 2:00:00	05/05/2024 19:00:00	05/05/2024 2:00:00	05/05/2024 21:00:00	05/05/2024 19:00:00	05/05/2024 21:00:00
Maximum	14.22	1.05	498335.9	42.91	1.2	0	34.3
MaxDate		05/05/2024 23:00:00			05/05/2024 19:00:00	05/05/2024 19:00:00	05/05/2024 19:00:00



Avg	14.14	0.24	443693.5	9.13	0.4	0	30.7
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0.1	0.3	28343.6	15.9	0.4	0	2.1

Site ABPR52 Daily: 05/05/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
05/05/2024 01:00	14.54	0.61	467479.5	38.51	0	0	30.2
05/05/2024 02:00	14.52	0.63	498668.8	42.92	0	0	28
05/05/2024 03:00	14.52	0.62	498821.9	42.92	0	0	28.1
05/05/2024 04:00	14.53	0.57	498332.6	42.91	0	0	28
05/05/2024 05:00	14.53	0.53	498324.3	42.9	0	0	27.9
05/05/2024 06:00	14.53	0.43	498908.8	42.99	0	0	27.9
05/05/2024 07:00	14.53	0.5	497351.2	42.86	0	0	27.6
05/05/2024 08:00	14.54	0.53	497994.6	42.84	0	0	27.6
05/05/2024 09:00	14.6	0.68	499838.4	42.83	0	0	28.2
05/05/2024 10:00	14.67	0.74	501758.9	42.79	0	0	29.2
05/05/2024 11:00	14.77	0.83	503628.3	42.73	0	0	30.3
05/05/2024 12:00	14.83	0.74	504667.1	42.7	0	0	30.6
05/05/2024 13:00	14.74	0.63	502951.9	42.75	0	0	30.1
05/05/2024 14:00	14.6	0.46	498747.6	42.76	0	0	30.8
05/05/2024 15:00	14.67	0.73	502800.4	42.67	0	0	31
05/05/2024 16:00	14.65	0.69	502006.9	42.75	0	0	30.9
05/05/2024 17:00	14.63	0.66	503261.8	42.8	0	0	30
05/05/2024 18:00	14.57	0.54	496501.7	42.28	0	0	28.9
05/05/2024 19:00	14.5	0.55	419684.1	33.62	0	0	28.5
05/05/2024 20:00	14.4	0.55	435537	36.22	0	0	27.4
05/05/2024 21:00	14.37	0.44	434200.8	36.14	0	0	26.9
05/05/2024 22:00	14.38	0.45	437807.2	36.51	0	0	26.7
05/05/2024 23:00	<Samp	0.73	<Samp	21.49	<Samp	<Samp	<Samp
05/05/2024 24:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.37	0.05	419684.1	0	0	0	26.7
MinDate	05/05/2024 21:00:00		05/05/2024 19:00:00		05/05/2024 1:00:00	05/05/2024 1:00:00	05/05/2024 22:00:00
Maximum	14.83	0.83	504667.1	42.99	0	0	31
MaxDate	05/05/2024 12:00:00	05/05/2024 11:00:00	05/05/2024 12:00:00	05/05/2024 6:00:00	05/05/2024 1:00:00	05/05/2024 1:00:00	05/05/2024 15:00:00
Avg	14.57	0.58	486330.6	38.75	0	0	28.9
Num	22	24	22	24	22	22	22
Data[%]	92	100	92	100	92	92	92
STD	0.1	0.2	27476.5	9.6	0	0	1.4

Site ABPR51 Daily: 06/05/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
06/05/2024 01:00	14.22	0.69	498424.3	43.03	0.3	0	30
06/05/2024 02:00	14.22	0.73	498379.3	43.02	0.3	0	30.2
06/05/2024 03:00	14.22	0.73	498412	43.05	0.3	0	30.2
06/05/2024 04:00	14.22	0.76	498375.5	43.04	0.3	0	30.3
06/05/2024 05:00	14.22	0.79	498168.2	43.05	0.4	0	30.2
06/05/2024 06:00	14.22	0.8	499201.7	43.13	0.3	0	30.4
06/05/2024 07:00	14.22	1.04	497674.7	43.02	0.4	0	30.1
06/05/2024 08:00	14.22	0.9	497953.9	42.97	0.5	0	30.1
06/05/2024 09:00	14.21	0.67	487225.8	41.59	0.4	0	30.4
06/05/2024 10:00	14.17	0.61	422562.8	34.21	0.3	0	31.2
06/05/2024 11:00	14.13	0.67	438390.9	36.41	0.4	0	30.3
06/05/2024 12:00	14.16	0.72	443010	36.85	0.4	0	30.4
06/05/2024 13:00	14.41	0.68	377524.4	26.8	0.3	0	44.5
06/05/2024 14:00	14.26	0.53	426489.2	34.17	0.3	0	35.2
06/05/2024 15:00	14.14	0.65	447978.6	37.58	0.4	0	31.2
06/05/2024 16:00	14.16	0.92	448248.8	37.45	0.5	0	31.1
06/05/2024 17:00	14.16	1.2	450587	37.66	0.4	0	30.2
06/05/2024 18:00	14.15	0.9	449384.9	37.63	0.3	0	30.5
06/05/2024 19:00	14.13	0.75	447941.7	37.51	0.3	0	30.3
06/05/2024 20:00	14.11	0.85	448215.3	37.55	0.3	0	29.9
06/05/2024 21:00	14.1	0.81	445754.2	37.34	0.4	0	30
06/05/2024 22:00	14.1	0.82	443600.4	37.07	0.4	0	30.1
06/05/2024 23:00	14.1	0.75	446227.4	37.44	0.3	0	29.9
06/05/2024 24:00	14.1	0.7	446674.5	37.44	0.3	0	29.9
Minimum	14.1	0.53	377524.4	26.8	0.3	0	29.9
MinDate	05/06/2024 21:00:00	05/06/2024 14:00:00	05/06/2024 13:00:00	05/06/2024 13:00:00	05/06/2024 1:00:00	05/06/2024 1:00:00	05/06/2024 20:00:00
Maximum	14.41	1.2	499201.7	43.13	0.5	0	44.5
MaxDate	05/06/2024 13:00:00	05/06/2024 17:00:00	05/06/2024 6:00:00	05/06/2024 6:00:00	05/06/2024 8:00:00	05/06/2024 1:00:00	05/06/2024 13:00:00
Avg	14.18	0.78	460683.5	38.71	0.4	0	31.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	32419.1	4	0.1	0	3

Site ABPR52 Daily: 06/05/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
06/05/2024 01:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 02:00	Shutdown	1.06	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 03:00	Shutdown	5.53	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 04:00	Shutdown	7.78	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 05:00	Shutdown	8.02	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 06:00	Shutdown	3.04	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 07:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 08:00	Shutdown	0.45	Shutdown	0	Shutdown	Shutdown	Shutdown
06/05/2024 09:00	Shutdown	0.87	Shutdown	2.07	Shutdown	Shutdown	Shutdown
06/05/2024 10:00	14.63	0.67	430820	34.17	0	0	29.8
06/05/2024 11:00	14.63	0.67	443819.9	36.51	0	0	28.9
06/05/2024 12:00	14.65	0.56	447865.8	36.93	0	0	29.2
06/05/2024 13:00	14.85	0.61	377877	26.86	0	0	39.5
06/05/2024 14:00	14.73	0.41	429233.1	34.26	0	0	31.7
06/05/2024 15:00	14.56	0.4	451489.6	37.68	0	0	29
06/05/2024 16:00	14.63	0.81	451984.5	37.56	0	0	29.6
06/05/2024 17:00	14.56	0.7	452938.5	37.75	0	0	28.5
06/05/2024 18:00	14.52	0.56	452462.7	37.71	0	0	28.6
06/05/2024 19:00	14.47	0.38	450480.1	37.57	0	0	28.5
06/05/2024 20:00	14.43	0.41	450261.5	37.63	0	0	27.7
06/05/2024 21:00	14.41	0.46	447550.9	37.44	0	0	27.5
06/05/2024 22:00	14.41	0.53	444866.5	37.16	0	0	27.6
06/05/2024 23:00	14.41	0.51	448145.8	37.54	0	0	27.3
06/05/2024 24:00	14.41	0.48	448120.5	37.52	0	0	27.1
Minimum	14.41	0	377877	0	0	0	27.1
MinDate	05/06/2024 21:00:00	05/06/2024 1:00:00	05/06/2024 13:00:00	05/06/2024 1:00:00	05/06/2024 10:00:00	05/06/2024 10:00:00	
Maximum	14.85	8.02	452938.5	37.75	0	0	39.5



MaxDate	05/06/2024 13:00:00	05/06/2024 5:00:00	05/06/2024 17:00:00	05/06/2024 17:00:00	05/06/2024 10:00:00	05/06/2024 10:00:00	05/06/2024 13:00:00
Avg	14.55	1.46	441861.1	22.77	0	0	29.4
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	2.3	19105.5	18	0	0	3
Site ABPR52 Daily: 07/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
07/05/2024 01:00	Shutdown	0.62	Shutdown	3.24	Shutdown	Shutdown	Shutdown
07/05/2024 02:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
07/05/2024 03:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
07/05/2024 04:00	Shutdown	1.4	Shutdown	0	Shutdown	Shutdown	Shutdown
07/05/2024 05:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
07/05/2024 06:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
07/05/2024 07:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
07/05/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
07/05/2024 09:00	Shutdown	0.49	Shutdown	2.18	Shutdown	Shutdown	Shutdown
07/05/2024 10:00	14.44	0.43	435697	35.1	0	0	31.5
07/05/2024 11:00	14.39	0.32	444226	37.25	0	0	30.1
07/05/2024 12:00	14.34	0.58	442351.5	37.34	0	0	30.3
07/05/2024 13:00	14.6	0.43	376326.4	27.25	0	0	45.5
07/05/2024 14:00	14.46	0.14	431776.4	35.16	0	0	33.8
07/05/2024 15:00	14.39	0.37	460004.1	39.04	0	0	29.5
07/05/2024 16:00	14.45	0.28	469405.9	39.94	0	0	29.1
07/05/2024 17:00	14.46	0.41	457873.4	38.77	0	0	29.2
07/05/2024 18:00	14.46	0.44	453526.2	38.34	0	0	29
07/05/2024 19:00	14.46	0.38	455588.1	38.6	0	0	28.7
07/05/2024 20:00	14.46	0.35	454351.1	38.44	0	0	28.7
07/05/2024 21:00	14.45	0.39	460563.3	39.09	0	0	28.5
07/05/2024 22:00	14.44	0.25	463850.9	39.5	0	0	28.7
07/05/2024 23:00	14.44	0.38	470593.1	40.19	0	0	28.7
07/05/2024 24:00	14.44	0.38	472257.1	40.33	0	0	28.5
Minimum	14.34	0.02	376326.4	0	0	0	28.5
MinDate	05/07/2024 12:00:00	05/07/2024 8:00:00	05/07/2024 13:00:00	05/07/2024 2:00:00	05/07/2024 10:00:00	05/07/2024 10:00:00	05/07/2024 21:00:00
Maximum	14.6	1.4	472257.1	40.33	0	0	45.5
MaxDate	05/07/2024 13:00:00	05/07/2024 4:00:00			05/07/2024 10:00:00	05/07/2024 10:00:00	05/07/2024 13:00:00
Avg	14.45	0.35	449892.7	23.74	0	0	30.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	23725.2	18.5	0	0	4.3
Site ABPR51 Daily: 07/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
07/05/2024 01:00	14.25	0.71	471564.6	39.07	0.2	0	33
07/05/2024 02:00	14.22	0.77	497973.8	42.96	0.3	0	30
07/05/2024 03:00	14.22	0.76	497964.1	42.99	0.3	0	30.2
07/05/2024 04:00	14.22	0.81	497840.5	43	0.3	0	30
07/05/2024 05:00	14.22	0.89	498505.3	43.12	0.3	0	30.2
07/05/2024 06:00	14.22	1.04	497206.5	42.99	0.4	0	30.2
07/05/2024 07:00	14.22	1.12	497298.1	43.02	0.4	0	30.2
07/05/2024 08:00	14.22	0.76	497086.9	43	0.4	0	31.1
07/05/2024 09:00	14.2	0.6	483020	41.49	0.2	0	32.7
07/05/2024 10:00	14.19	0.96	428633.5	35.03	0.3	0	34.5
07/05/2024 11:00	14.1	0.56	441349.8	37.18	0.2	0	32.8
07/05/2024 12:00	14.11	0.78	439798.6	37.27	0.2	0	33.8
07/05/2024 13:00	14.39	1.1	377804.1	27.22	0.1	0	50.2
07/05/2024 14:00	14.25	0.49	430613.2	35.08	0.2	0	38
07/05/2024 15:00	14.15	0.62	456772.6	38.96	0.4	0	33.3
07/05/2024 16:00	14.16	0.82	466297.4	39.84	0.7	0	32.6
07/05/2024 17:00	14.15	1.32	455332.8	38.67	0.5	0	32.7
07/05/2024 18:00	14.14	1.18	451192.9	38.24	0.5	0	32.5
07/05/2024 19:00	14.14	1.04	454490.3	38.53	0.5	0	32.3
07/05/2024 20:00	14.14	1.03	452048.8	38.37	0.6	0	32.4
07/05/2024 21:00	14.15	1.05	458153	39.01	0.7	0	32.1
07/05/2024 22:00	14.16	0.84	462470.8	39.42	0.5	0	32.2
07/05/2024 23:00	14.18	1.12	469390.7	40.13	0.6	0	32.3
07/05/2024 24:00	14.18	1.32	470519	40.24	0.7	0	32.2
Minimum	14.1	0.49	377804.1	27.22	0.1	0	30
MinDate	05/07/2024 11:00:00	05/07/2024 14:00:00	05/07/2024 13:00:00	05/07/2024 13:00:00	05/07/2024 13:00:00	05/07/2024 1:00:00	05/07/2024 2:00:00
Maximum	14.39	1.32	498505.3	43.12	0.7	0	50.2
MaxDate	05/07/2024 13:00:00	05/07/2024 17:00:00	05/07/2024 5:00:00	05/07/2024 5:00:00	05/07/2024 16:00:00	05/07/2024 1:00:00	05/07/2024 13:00:00
Avg	14.19	0.9	464722	39.37	0.4	0	33
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	29405	3.6	0.2	0	4.1
Site ABPR51 Daily: 08/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
08/05/2024 01:00	14.25	0.94	462986.9	38.82	0.6	0	36.1
08/05/2024 02:00	14.22	1.01	491698	42.89	0.5	0	32.6
08/05/2024 03:00	14.22	1	492042.5	42.91	0.6	0	33.1
08/05/2024 04:00	14.22	1.09	492018.5	42.91	0.6	0	33.1
08/05/2024 05:00	14.22	0.99	491838.4	42.92	0.6	0	33.2
08/05/2024 06:00	14.22	0.93	492815.5	43.02	0.5	0	33
08/05/2024 07:00	14.22	0.9	492125.3	42.93	0.5	0	32.9
08/05/2024 08:00	14.22	0.8	491980.4	42.93	0.5	0	32.9
08/05/2024 09:00	14.25	0.86	485622.8	42.01	0.4	0	33.4
08/05/2024 10:00	14.24	0.88	442753.1	36.84	0.4	0	33.3
08/05/2024 11:00	14.21	1.09	445307	37.45	0.4	0	32.5
08/05/2024 12:00	14.22	1.19	452372	38.08	0.4	0	32
08/05/2024 13:00	14.42	0.98	381804.6	27.62	0.3	0	45.4
08/05/2024 14:00	14.3	0.75	441104.9	35.83	0.3	0	35.5
08/05/2024 15:00	14.22	0.79	458756.9	38.77	0.5	0	31
08/05/2024 16:00	14.22	0.76	462989.1	39.12	0.5	0	30.9
08/05/2024 17:00	14.22	0.9	466688.5	39.5	0.4	0	31
08/05/2024 18:00	14.21	0.96	463361.5	39.23	0.4	0	31.5
08/05/2024 19:00	14.2	0.99	470286.5	39.99	0.3	0	31.1
08/05/2024 20:00	14.19	1.02	470921	40.09	0.3	0	31
08/05/2024 21:00	14.18	1.03	471574	40.16	0.4	0	30.9
08/05/2024 22:00	14.22	1.06	485098.4	41.57	0.3	0	31
08/05/2024 23:00	14.2	1.06	483063.2	41.4	0.4	0	31.2
08/05/2024 24:00	14.2	1.02	482551	41.36	0.4	0	31
Minimum	14.18	0.75	381804.6	27.62	0.3	0	30.9
MinDate	05/08/2024 21:00:00	05/08/2024 14:00:00	05/08/2024 13:00:00	05/08/2024 13:00:00	05/08/2024 13:00:00	05/08/2024 1:00:00	05/08/2024 16:00:00



Maximum	14.42	1.19	492815.5	43.02	0.6	0	45.4
MaxDate	05/08/2024 13:00:00	05/08/2024 12:00:00	05/08/2024 6:00:00	05/08/2024 6:00:00	05/08/2024 1:00:00	05/08/2024 1:00:00	05/08/2024 13:00:00
Avg	14.23	0.96	469656.6	39.93	0.4	0	32.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	25340.7	3.4	0.1	0	3

Site ABPR52 Daily: 08/05/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
08/05/2024 01:00	Shutdown	0.66	Shutdown	3.96	Shutdown	Shutdown	Shutdown
08/05/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
08/05/2024 03:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
08/05/2024 04:00	Shutdown	1.44	Shutdown	0	Shutdown	Shutdown	Shutdown
08/05/2024 05:00	Shutdown	4.62	Shutdown	0	Shutdown	Shutdown	Shutdown
08/05/2024 06:00	Shutdown	1.56	Shutdown	0	Shutdown	Shutdown	Shutdown
08/05/2024 07:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
08/05/2024 08:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
08/05/2024 09:00	Shutdown	0.81	Shutdown	1.41	Shutdown	Shutdown	Shutdown
08/05/2024 10:00	14.7	0.78	454964.2	36.6	0.2	0	33.2
08/05/2024 11:00	14.75	0.86	452563	37.54	0	0	31.4
08/05/2024 12:00	14.79	0.8	459528	38.16	0	0	31.2
08/05/2024 13:00	14.96	0.71	384682.4	27.81	0	0	39.3
08/05/2024 14:00	14.85	0.43	447874.8	35.88	0	0	32.9
08/05/2024 15:00	14.75	0.49	466682	38.86	0	0	29.7
08/05/2024 16:00	14.75	0.65	470244.3	39.2	0	0	29.8
08/05/2024 17:00	14.69	0.52	472653.4	39.6	0	0	29.7
08/05/2024 18:00	14.62	0.47	469109.6	39.33	0	0	30.1
08/05/2024 19:00	14.6	0.58	475779.1	40.07	0	0	29.6
08/05/2024 20:00	14.55	0.59	475383.3	40.18	0	0	29.1
08/05/2024 21:00	14.5	0.71	476137.7	40.27	0	0	28.7
08/05/2024 22:00	14.48	0.65	488975.4	41.67	0	0	29
08/05/2024 23:00	14.47	0.69	486642.6	41.49	0	0	28.8
08/05/2024 24:00	14.46	0.67	486887.2	41.45	0	0	28.6
Minimum	14.46	0	384682.4	0	0	0	28.6
MinDate		05/08/2024 2:00:00	05/08/2024 13:00:00	05/08/2024 2:00:00	05/08/2024 11:00:00	05/08/2024 10:00:00	
Maximum	14.96	4.62	488975.4	41.67	0.2	0	39.3
MaxDate	05/08/2024 13:00:00	05/08/2024 5:00:00	05/08/2024 22:00:00	05/08/2024 22:00:00	05/08/2024 10:00:00	05/08/2024 10:00:00	05/08/2024 13:00:00
Avg	14.66	0.79	464540.5	24.31	0	0	30.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.2	0.9	25357.9	19	0.1	0	2.8

Site ABPR51 Daily: 09/05/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
09/05/2024 01:00	14.27	1.04	461045.1	38.23	0.4	0	35.8
09/05/2024 02:00	14.22	0.88	494126.4	42.93	0.5	0	31.5
09/05/2024 03:00	14.22	0.93	494039.8	42.95	0.4	0	31.7
09/05/2024 04:00	14.22	0.85	494342.5	42.94	0.4	0	31.6
09/05/2024 05:00	14.22	0.88	494419.1	42.98	0.4	0	31.6
09/05/2024 06:00	14.22	0.97	495568.7	43.09	0.5	0	31.3
09/05/2024 07:00	14.22	0.93	494807.3	43.02	0.6	0	31.3
09/05/2024 08:00	14.22	0.88	494536.3	42.98	0.9	0	31.3
09/05/2024 09:00	14.21	1.01	488073.5	42.07	0.7	0	31.4
09/05/2024 10:00	14.2	0.82	458508.4	38.44	0.4	0	30.8
09/05/2024 11:00	14.17	0.86	463479.3	39.29	0.4	0	30.5
09/05/2024 12:00	14.2	0.84	467752.4	39.67	0.3	0	30.5
09/05/2024 13:00	14.35	0.81	388932.8	28.74	0.2	0	39.6
09/05/2024 14:00	14.26	0.73	441660.7	36.03	0.3	0	33.5
09/05/2024 15:00	14.18	0.88	457434.5	38.56	0.4	0	30.8
09/05/2024 16:00	14.21	0.93	468591.7	39.63	0.4	0	30.4
09/05/2024 17:00	Shutdown	1.49	Shutdown	11.21	Shutdown	Shutdown	Shutdown
09/05/2024 18:00	Shutdown	1.77	Shutdown	9.07	Shutdown	Shutdown	Shutdown
09/05/2024 19:00	14.14	1.32	462875.2	36.36	0.6	0	33.7
09/05/2024 20:00	14.17	1.2	476038.9	40.79	0.5	0	31.4
09/05/2024 21:00	14.17	1.09	472463.8	40.4	0.3	0	31.8
09/05/2024 22:00	14.2	1.11	483630	41.57	0.4	0	31.4
09/05/2024 23:00	14.21	0.98	486303.9	41.89	0.4	0	31.7
09/05/2024 24:00	14.22	1.08	489032.5	42.1	0.6	0	32.4
Minimum	14.14	0.73	388932.8	9.07	0.2	0	30.4
MinDate	05/09/2024 19:00:00	05/09/2024 14:00:00	05/09/2024 13:00:00	05/09/2024 18:00:00	05/09/2024 13:00:00	05/09/2024 1:00:00	05/09/2024 16:00:00
Maximum	14.35	1.77	495568.7	43.09	0.9	0	39.6
MaxDate	05/09/2024 13:00:00	05/09/2024 18:00:00	05/09/2024 6:00:00	05/09/2024 6:00:00	05/09/2024 8:00:00	05/09/2024 1:00:00	05/09/2024 13:00:00
Avg	14.21	1.01	473984.6	37.71	0.5	0	32.1
Num	22	24	22	24	22	22	22
Data[%]	92	100	92	100	92	92	92
STD	0	0.2	24784.9	9.1	0.2	0	2.1

Site ABPR52 Daily: 09/05/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
09/05/2024 01:00	Shutdown	0.83	Shutdown	4.09	Shutdown	Shutdown	Shutdown
09/05/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/05/2024 03:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
09/05/2024 04:00	Shutdown	0.81	Shutdown	0	Shutdown	Shutdown	Shutdown
09/05/2024 05:00	Shutdown	3.12	Shutdown	0	Shutdown	Shutdown	Shutdown
09/05/2024 06:00	Shutdown	2.19	Shutdown	0	Shutdown	Shutdown	Shutdown
09/05/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
09/05/2024 08:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
09/05/2024 09:00	Shutdown	0.83	Shutdown	1.38	Shutdown	Shutdown	Shutdown
09/05/2024 10:00	14.6	0.77	471535	38.24	0.2	0	30.2
09/05/2024 11:00	14.56	0.7	470800.1	39.38	0	0	28.5
09/05/2024 12:00	14.59	0.59	474165.4	39.76	0	0	28.7
09/05/2024 13:00	14.67	0.61	389858.3	28.82	0	0	33.9
09/05/2024 14:00	14.65	0.54	446335.9	36.1	0	0	30.4
09/05/2024 15:00	14.6	0.53	462415.2	38.64	0	0	29.2
09/05/2024 16:00	14.63	0.56	473364.4	39.72	0	0	29.1
09/05/2024 17:00	Shutdown	2.25	Shutdown	12.05	Shutdown	Shutdown	Shutdown
09/05/2024 18:00	Shutdown	1.75	Shutdown	11.08	Shutdown	Shutdown	Shutdown
09/05/2024 19:00	14.4	0.58	457579.3	36.68	0	0	31.4
09/05/2024 20:00	14.4	0.34	478417.7	40.86	0	0	28.8
09/05/2024 21:00	14.4	0.4	474285	40.5	0	0	29.1
09/05/2024 22:00	14.41	0.55	485174.6	41.65	0	0	28.9
09/05/2024 23:00	14.44	0.46	488652.2	41.99	0	0	29.1
09/05/2024 24:00	14.47	0.55	491502.3	42.2	0	0	29.6
Minimum	14.4	0.01	389858.3	0	0	0	28.5



MinDate	05/09/2024 19:00:00	05/09/2024 2:00:00	05/09/2024 13:00:00	05/09/2024 2:00:00	05/09/2024 11:00:00	05/09/2024 10:00:00	05/09/2024 11:00:00
Maximum	14.67	3.12	491502.3	42.2	0.2	0	33.9
MaxDate	05/09/2024 13:00:00	05/09/2024 5:00:00			05/09/2024 10:00:00	05/09/2024 10:00:00	05/09/2024 13:00:00
Avg	14.52	0.79	466468.1	22.21	0	0	29.8
Num	13	24	13	24	13	13	13
Data[%]	54	100	54	100	54	54	54
STD	0.1	0.8	26130.5	18.9	0.1	0	1.5
Site ABPR51 Daily: 10/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
10/05/2024 01:00	14.3	1.09	447441	36.53	0.5	0	40.1
10/05/2024 02:00	14.22	1.23	492276.2	42.87	0.7	0	32.7
10/05/2024 03:00	14.22	1.26	492213.5	42.88	0.8	0	32.5
10/05/2024 04:00	14.22	0.99	492304.1	42.89	0.7	0	32.2
10/05/2024 05:00	14.22	1.07	492198	42.9	0.6	0	32.2
10/05/2024 06:00	14.22	1.06	493350.4	43.01	0.5	0	32.4
10/05/2024 07:00	14.22	0.81	492148.9	42.91	0.6	0	32.7
10/05/2024 08:00	14.24	0.85	493362.5	42.96	0.6	0	32.4
10/05/2024 09:00	14.26	1.07	482531.7	41.57	0.6	0	31.9
10/05/2024 10:00	14.23	0.81	459533.4	38.58	0.4	0	31.8
10/05/2024 11:00	14.18	0.85	460244.6	38.97	0.3	0	31.4
10/05/2024 12:00	14.21	1.05	464850.8	39.28	0.3	0	31.1
10/05/2024 13:00	14.36	0.76	387908.4	28.5	0.2	0	40.3
10/05/2024 14:00	14.28	0.79	442384.5	36.06	0.2	0	33.9
10/05/2024 15:00	14.2	0.87	461264.7	38.9	0.3	0	31.2
10/05/2024 16:00	14.22	0.8	463476.6	39.13	0.3	0	31.8
10/05/2024 17:00	14.22	0.83	464479.7	39.25	0.3	0	32.1
10/05/2024 18:00	14.19	0.89	463141.7	39.25	0.2	0	31.4
10/05/2024 19:00	14.18	1.01	470196.4	39.96	0.3	0	31.2
10/05/2024 20:00	14.21	1.05	484178.4	41.39	0.3	0	31.2
10/05/2024 21:00	14.17	1.05	474282	40.45	0.3	0	30.7
10/05/2024 22:00	14.2	1.05	489443.7	42.01	0.3	0	30.9
10/05/2024 23:00	14.2	1.06	487637.9	41.88	0.2	0	31.2
10/05/2024 24:00	14.21	1.02	490051	42.08	0.3	0	31.1
Minimum	14.17	0.76	387908.4	28.5	0.2	0	30.7
MinDate	05/10/2024 21:00:00	05/10/2024 13:00:00	05/10/2024 13:00:00	05/10/2024 13:00:00	05/10/2024 13:00:00	05/10/2024 1:00:00	05/10/2024 21:00:00
Maximum	14.36	1.26	493362.5	43.01	0.8	0	40.3
MaxDate	05/10/2024 13:00:00	05/10/2024 3:00:00	05/10/2024 8:00:00	05/10/2024 6:00:00	05/10/2024 3:00:00	05/10/2024 1:00:00	05/10/2024 13:00:00
Avg	14.22	0.97	472537.5	40.18	0.4	0	32.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	24059.3	3.2	0.2	0	2.5
Site ABPR52 Daily: 10/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
10/05/2024 01:00	Shutdown	0.68	Shutdown	4.85	Shutdown	Shutdown	Shutdown
10/05/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
10/05/2024 03:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
10/05/2024 04:00	Shutdown	0.29	Shutdown	0	Shutdown	Shutdown	Shutdown
10/05/2024 05:00	Shutdown	1.87	Shutdown	0	Shutdown	Shutdown	Shutdown
10/05/2024 06:00	Shutdown	1.34	Shutdown	0	Shutdown	Shutdown	Shutdown
10/05/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
10/05/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
10/05/2024 09:00	Shutdown	1.09	Shutdown	2.06	Shutdown	Shutdown	Shutdown
10/05/2024 10:00	14.68	0.55	472775.9	38.45	0.2	0	31.7
10/05/2024 11:00	14.61	0.55	467952.6	39.05	0	0	29.6
10/05/2024 12:00	14.62	0.64	471430.6	39.36	0	0	29.6
10/05/2024 13:00	14.72	0.62	389096	28.58	0	0	34.4
10/05/2024 14:00	14.62	0.6	447401.3	36.14	0	0	30.7
10/05/2024 15:00	14.53	0.67	467204.8	39	0	0	29.5
10/05/2024 16:00	14.54	0.69	469474.1	39.22	0	0	30.3
10/05/2024 17:00	14.54	0.64	469927.8	39.34	0	0	30.5
10/05/2024 18:00	14.49	0.53	468046.2	39.33	0	0	29.3
10/05/2024 19:00	14.47	0.57	474306.8	40.06	0	0	29
10/05/2024 20:00	14.48	0.51	488250	41.52	0	0	29.2
10/05/2024 21:00	14.45	0.42	476791.3	40.52	0	0	27.9
10/05/2024 22:00	14.46	0.55	491771.9	42.09	0	0	28.3
10/05/2024 23:00	14.49	0.54	490526.4	41.97	0	0	28.8
10/05/2024 24:00	14.5	0.6	493295.7	42.18	0	0	28.7
Minimum	14.45	0	389096	0	0	0	27.9
MinDate	05/10/2024 21:00:00	05/10/2024 2:00:00	05/10/2024 13:00:00	05/10/2024 2:00:00	05/10/2024 11:00:00	05/10/2024 10:00:00	05/10/2024 21:00:00
Maximum	14.72	1.87	493295.7	42.18	0.2	0	34.4
MaxDate	05/10/2024 13:00:00	05/10/2024 5:00:00			05/10/2024 10:00:00	05/10/2024 10:00:00	05/10/2024 13:00:00
Avg	14.55	0.58	469216.8	24.74	0	0	29.8
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	25225.9	19.2	0.1	0	1.6
Site ABPR51 Daily: 11/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
11/05/2024 01:00	14.26	0.94	462574	38.59	0.2	0	35.2
11/05/2024 02:00	14.22	0.85	493281.7	42.93	0.3	0	31.8
11/05/2024 03:00	14.22	1.05	493183.4	42.94	0.4	0	32.1
11/05/2024 04:00	14.22	1.31	492545.7	42.91	0.3	0	32.1
11/05/2024 05:00	14.22	0.99	492838.1	42.93	0.4	0	32.1
11/05/2024 06:00	14.22	0.87	493664.4	43.01	0.4	0	32
11/05/2024 07:00	14.22	1.11	493514	42.92	0.4	0	31.4
11/05/2024 08:00	14.22	1.05	494284.3	43	0.5	0	31.4
11/05/2024 09:00	14.21	0.99	488489	42.25	0.5	0	31.4
11/05/2024 10:00	14.2	0.88	458698.7	38.49	0.3	0	31.1
11/05/2024 11:00	14.2	1.04	474661.2	40.38	0.4	0	30.5
11/05/2024 12:00	14.2	0.94	474624.1	40.35	0.3	0	30.3
11/05/2024 13:00	14.31	0.77	398857.5	30.2	0.1	0	35.9
11/05/2024 14:00	14.25	0.85	453530.8	37.7	0.3	0	34.5
11/05/2024 15:00	14.2	0.9	478653.1	41.03	0.4	0	32.1
11/05/2024 16:00	14.19	0.91	474383.5	40.51	0.4	0	31.4
11/05/2024 17:00	14.21	1.03	478268.7	40.77	0.4	0	31.3
11/05/2024 18:00	14.22	1.05	480662.8	41.08	0.4	0	31.5
11/05/2024 19:00	14.21	1.12	481314.4	41.2	0.4	0	31.7
11/05/2024 20:00	14.21	0.85	481389.7	41.25	0.4	0	31.6
11/05/2024 21:00	14.2	0.99	481616	41.28	0.5	0	31.7
11/05/2024 22:00	14.21	1.21	487502.2	41.85	0.5	0	31.3
11/05/2024 23:00	14.21	1.1	486184.8	41.76	0.6	0	31.2
11/05/2024 24:00	14.2	1.02	485007.2	41.65	0.6	0	31.1



Minimum	14.19	0.77	398857.5	30.2	0.1	0	30.3
MinDate	05/11/2024 16:00:00	05/11/2024 13:00:00	05/11/2024 13:00:00	05/11/2024 13:00:00	05/11/2024 13:00:00	05/11/2024 1:00:00	05/11/2024 12:00:00
Maximum	14.31	1.31	494284.3	43.01	0.6	0	35.9
MaxDate	05/11/2024 13:00:00	05/11/2024 4:00:00	05/11/2024 8:00:00	05/11/2024 6:00:00	05/11/2024 23:00:00	05/11/2024 1:00:00	05/11/2024 13:00:00
Avg	14.22	0.99	478322	40.87	0.4	0	31.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	20337.2	2.7	0.1	0	1.4
Site ABPR52 Daily: 11/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
11/05/2024 01:00	Shutdown	0.77	Shutdown	4.22	Shutdown	Shutdown	Shutdown
11/05/2024 02:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
11/05/2024 03:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
11/05/2024 04:00	Shutdown	0.76	Shutdown	0	Shutdown	Shutdown	Shutdown
11/05/2024 05:00	Shutdown	2.23	Shutdown	0	Shutdown	Shutdown	Shutdown
11/05/2024 06:00	Shutdown	1.43	Shutdown	0	Shutdown	Shutdown	Shutdown
11/05/2024 07:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
11/05/2024 08:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
11/05/2024 09:00	Shutdown	0.7	Shutdown	1.25	Shutdown	Shutdown	Shutdown
11/05/2024 10:00	14.52	0.59	471778.1	38.4	0.2	0	30.3
11/05/2024 11:00	14.56	0.57	481182.9	40.49	0	0	28.6
11/05/2024 12:00	14.59	0.44	481268.6	40.45	0	0	28.8
11/05/2024 13:00	14.68	0.31	400390.6	30.29	0	0	30.5
11/05/2024 14:00	14.47	0.2	453665.6	37.61	0	0	29.7
11/05/2024 15:00	14.46	0.49	481857.7	41.12	0	0	28.5
11/05/2024 16:00	14.55	0.59	478030.1	40.6	0	0	28.6
11/05/2024 17:00	14.6	0.7	482309.9	40.86	0	0	29.2
11/05/2024 18:00	14.53	0.6	484791.2	41.18	0	0	29.2
11/05/2024 19:00	14.51	0.76	484916.8	41.28	0	0	29.2
11/05/2024 20:00	14.52	0.44	484734.8	41.32	0	0	29
11/05/2024 21:00	14.51	0.68	485169.8	41.39	0	0	29.1
11/05/2024 22:00	14.48	0.66	490299.9	41.95	0	0	28.7
11/05/2024 23:00	14.47	0.52	489195.8	41.84	0	0	28.5
11/05/2024 24:00	14.47	0.49	487921.4	41.73	0	0	28.2
Minimum	14.46	0.02	400390.6	0	0	0	28.2
MinDate	05/11/2024 15:00:00	05/11/2024 2:00:00	05/11/2024 13:00:00	05/11/2024 2:00:00	05/11/2024 11:00:00	05/11/2024 10:00:00	
Maximum	14.68	2.23	490299.9	41.95	0.2	0	30.5
MaxDate	05/11/2024 13:00:00	05/11/2024 5:00:00	05/11/2024 22:00:00	05/11/2024 22:00:00	05/11/2024 10:00:00	05/11/2024 10:00:00	05/11/2024 13:00:00
Avg	14.53	0.6	475834.3	25.25	0	0	29.1
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.5	22682.4	19.7	0.1	0	0.7
Site ABPR51 Daily: 12/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
12/05/2024 01:00	14.23	1.02	470613.8	38.39	0.6	0	34.4
12/05/2024 02:00	14.22	0.86	493250.2	42.9	0.7	0	31.7
12/05/2024 03:00	14.22	0.93	493230.7	42.91	0.6	0	31.9
12/05/2024 04:00	14.22	0.99	493218.1	42.92	0.6	0	31.4
12/05/2024 05:00	14.22	0.93	492639.5	42.92	0.7	0	31.3
12/05/2024 06:00	14.22	1.08	493712.4	43	0.7	0	31.2
12/05/2024 07:00	14.22	0.82	493452.3	42.92	0.7	0	31.3
12/05/2024 08:00	14.22	0.79	493305.3	42.9	0.6	0	30.9
12/05/2024 09:00	14.26	0.63	493365.9	42.87	0.5	0	31.4
12/05/2024 10:00	14.3	0.67	495441.7	42.93	0.5	0	31
12/05/2024 11:00	14.31	0.81	496416.1	42.97	0.4	0	30.9
12/05/2024 12:00	14.28	0.94	497034.6	42.94	0.4	0	31.1
12/05/2024 13:00	14.28	0.77	497159.8	42.97	0.5	0	30.8
12/05/2024 14:00	14.25	0.63	496139.7	42.96	0.3	0	30.6
12/05/2024 15:00	14.22	0.77	494625.7	42.9	0.4	0	30.6
12/05/2024 16:00	14.24	0.77	496569.6	42.95	0.6	0	30.5
12/05/2024 17:00	14.26	0.73	497017.6	42.95	0.5	0	30.6
12/05/2024 18:00	14.24	0.75	492596.4	42.53	0.4	0	30.8
12/05/2024 19:00	14.2	0.78	432300.1	35.2	0.4	0	34.7
12/05/2024 20:00	14.16	0.9	462340.4	39.2	0.4	0	30.4
12/05/2024 21:00	14.15	0.91	460032.9	39.04	0.4	0	30.1
12/05/2024 22:00	14.15	0.9	464320.4	39.46	0.4	0	29.8
12/05/2024 23:00	<Samp	0.96	<Samp	23.33	<Samp	<Samp	<Samp
12/05/2024 24:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.15	0.07	432300.1	0	0.3	0	29.8
MinDate	05/12/2024 21:00:00		05/12/2024 19:00:00		05/12/2024 14:00:00	05/12/2024 1:00:00	05/12/2024 22:00:00
Maximum	14.31	1.08	497159.8	43	0.7	0	34.7
MaxDate	05/12/2024 11:00:00	05/12/2024 6:00:00	05/12/2024 13:00:00	05/12/2024 6:00:00	05/12/2024 2:00:00	05/12/2024 1:00:00	05/12/2024 19:00:00
Avg	14.23	0.81	486308.3	39.34	0.5	0	31.2
Num	22	24	22	24	22	22	22
Data[%]	92	100	92	100	92	92	92
STD	0	0.2	17106.4	9.4	0.1	0	1.2
Site ABPR52 Daily: 12/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
12/05/2024 01:00	Shutdown	0.72	Shutdown	4.32	Shutdown	Shutdown	Shutdown
12/05/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 03:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 04:00	Shutdown	0.4	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 05:00	Shutdown	1.65	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 06:00	Shutdown	1.89	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 07:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 08:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 09:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 10:00	Shutdown	0.25	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 11:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 12:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 13:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 14:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 15:00	Shutdown	0.28	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 16:00	Shutdown	0.61	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 17:00	Shutdown	0.51	Shutdown	0	Shutdown	Shutdown	Shutdown
12/05/2024 18:00	Shutdown	0.88	Shutdown	0.71	Shutdown	Shutdown	Shutdown
12/05/2024 19:00	14.56	0.82	443982.6	29.62	0.3	0	35.3
12/05/2024 20:00	14.5	0.54	469400.3	39.27	0	0	28.6
12/05/2024 21:00	14.44	0.5	464907.3	39.12	0	0	28
12/05/2024 22:00	14.41	0.51	468609.7	39.56	0	0	27.5
12/05/2024 23:00	14.5	0.62	451034.9	37.08	0	0	30.5



12/05/2024 24:00	14.47	0.7	496536.3	42.8	0	0	28.5
Minimum	14.41	0	443982.6	0	0	0	27.5
MinDate	05/12/2024 22:00:00	05/12/2024 2:00:00	05/12/2024 19:00:00	05/12/2024 2:00:00	05/12/2024 20:00:00	05/12/2024 19:00:00	05/12/2024 22:00:00
Maximum	14.56	1.89	496536.3	42.8	0.3	0	35.3
MaxDate	05/12/2024 19:00:00	05/12/2024 6:00:00			05/12/2024 19:00:00	05/12/2024 19:00:00	05/12/2024 19:00:00
Avg	14.48	0.5	465745.2	9.69	0.1	0	29.7
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0.1	0.5	18222.1	16.8	0.1	0	2.9

Site ABPR51 Daily: 13/05/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
13/05/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 04:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 05:00	Shutdown	0.58	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 06:00	Shutdown	0.44	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 07:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
13/05/2024 09:00	Shutdown	0.74	Shutdown	1.73	Shutdown	Shutdown	Shutdown
13/05/2024 10:00	14.22	1.04	451275.9	36.65	1.1	0	33.6
13/05/2024 11:00	14.21	0.99	467863.1	39.52	0.5	0	30.5
13/05/2024 12:00	14.21	1.01	464451.5	39.2	0.4	0	30.9
13/05/2024 13:00	14.4	0.91	386047.2	28.05	0.3	0	42.8
13/05/2024 14:00	14.28	0.84	442325.7	35.59	0.3	0	36.1
13/05/2024 15:00	14.21	0.95	464801.6	39.31	0.3	0	30.9
13/05/2024 16:00	14.18	0.96	468400.1	39.74	0.3	0	30.3
13/05/2024 17:00	14.16	0.65	468888.3	39.96	0.4	0	30.5
13/05/2024 18:00	14.15	0.82	465163.6	39.59	0.4	0	31.1
13/05/2024 19:00	14.18	1.08	470044.7	40.1	0.4	0	31.4
13/05/2024 20:00	14.2	1.27	474710.8	40.58	0.4	0	31.4
13/05/2024 21:00	14.22	0.95	483700.8	41.51	0.5	0	31.2
13/05/2024 22:00	14.22	1.09	489258.5	42.04	0.5	0	31.3
13/05/2024 23:00	14.21	0.63	484154.7	41.58	0.3	0	31.1
13/05/2024 24:00	14.22	0.74	486781.9	41.85	0.3	0	31.4
Minimum	14.15	0.01	386047.2	0	0.3	0	30.3
MinDate	05/13/2024 18:00:00	05/13/2024 1:00:00	05/13/2024 13:00:00	05/13/2024 1:00:00	05/13/2024 13:00:00	05/13/2024 10:00:00	05/13/2024 16:00:00
Maximum	14.4	1.27	489258.5	42.04	1.1	0	42.8
MaxDate	05/13/2024 13:00:00	05/13/2024 20:00:00	05/13/2024 22:00:00	05/13/2024 22:00:00	05/13/2024 10:00:00	05/13/2024 10:00:00	05/13/2024 13:00:00
Avg	14.22	0.66	464524.6	24.46	0.4	0	32.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	25166.8	19.4	0.2	0	3.3

Site ABPR52 Daily: 13/05/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
13/05/2024 01:00	14.46	0.7	496063	42.87	0	0	28.2
13/05/2024 02:00	14.46	0.69	495715.3	42.88	0	0	28.1
13/05/2024 03:00	14.47	0.7	496101	42.86	0	0	28.3
13/05/2024 04:00	14.44	0.45	494528.3	42.9	0	0	29
13/05/2024 05:00	14.38	0.6	492752.3	42.87	0	0	29.2
13/05/2024 06:00	14.38	0.87	493475	42.97	0	0	29.2
13/05/2024 07:00	14.38	0.91	492279.3	42.83	0	0	29
13/05/2024 08:00	14.4	0.78	492069.2	42.81	0	0	28.9
13/05/2024 09:00	14.42	0.68	480520.2	41.4	0	0	29.3
13/05/2024 10:00	14.5	0.56	453405.8	37.68	0	0	30.2
13/05/2024 11:00	14.46	0.56	460941.7	38.89	0	0	29.3
13/05/2024 12:00	14.52	0.68	459681.2	38.64	0	0	30.2
13/05/2024 13:00	14.76	0.82	383923.6	27.96	0	0	37.4
13/05/2024 14:00	14.65	0.67	458563.8	37.19	0	0	34.8
13/05/2024 15:00	14.53	0.73	491232	41.55	0	0	30.6
13/05/2024 16:00	14.47	0.61	500408.3	42.77	0	0	30.4
13/05/2024 17:00	14.4	0.32	497418.5	42.84	0	0	29.2
13/05/2024 18:00	14.37	0.43	487268.6	41.86	0	0	28.6
13/05/2024 19:00	14.4	0.39	480317.6	41.14	0	0	28.8
13/05/2024 20:00	14.4	0.5	475514.1	40.65	0	0	28.7
13/05/2024 21:00	14.42	0.43	485858.6	41.61	0	0	28.7
13/05/2024 22:00	14.45	0.51	491535.8	42.14	0	0	29.1
13/05/2024 23:00	14.41	0.13	485250.2	41.66	0	0	28.5
13/05/2024 24:00	14.41	0.23	488378.8	41.95	0	0	28.9
Minimum	14.37	0.13	383923.6	27.96	0	0	28.1
MinDate	05/13/2024 18:00:00	05/13/2024 23:00:00	05/13/2024 13:00:00	05/13/2024 13:00:00	05/13/2024 1:00:00	05/13/2024 1:00:00	05/13/2024 2:00:00
Maximum	14.76	0.91	500408.3	42.97	0	0	37.4
MaxDate	05/13/2024 13:00:00	05/13/2024 7:00:00	05/13/2024 16:00:00	05/13/2024 6:00:00	05/13/2024 1:00:00	05/13/2024 1:00:00	05/13/2024 13:00:00
Avg	14.46	0.58	480550.1	40.96	0	0	29.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	24641.6	3.3	0	0	2.1

Site ABPR51 Daily: 14/05/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
14/05/2024 01:00	14.25	0.89	463731.1	38.91	0.3	0	35.2
14/05/2024 02:00	14.22	1.04	493011.7	42.9	0.4	0	31.7
14/05/2024 03:00	14.22	0.89	493008.8	42.92	0.4	0	31.9
14/05/2024 04:00	14.22	1.09	493014.3	42.92	0.5	0	31.4
14/05/2024 05:00	14.22	0.9	492920.9	42.97	0.3	0	31.8
14/05/2024 06:00	14.22	0.88	493569.7	43.06	0.3	0	32
14/05/2024 07:00	14.22	0.86	492888	42.96	0.4	0	31.9
14/05/2024 08:00	14.22	0.96	493552.8	43	0.6	0	31.5
14/05/2024 09:00	14.23	0.97	480280.1	41.17	0.5	0	31.7
14/05/2024 10:00	14.25	0.82	452665.3	37.53	0.4	0	31.4
14/05/2024 11:00	14.21	1.06	463191.9	39.13	0.4	0	30.6
14/05/2024 12:00	14.22	0.99	462838.2	39.05	0.3	0	30.6
14/05/2024 13:00	14.37	0.87	389664.3	28.73	0.2	0	40
14/05/2024 14:00	14.27	0.67	441909.5	36	0.3	0	32.6
14/05/2024 15:00	14.2	0.77	463852	39.12	0.4	0	29.7
14/05/2024 16:00	14.18	0.67	461097	38.86	0.4	0	29.7
14/05/2024 17:00	14.2	0.67	466026.2	39.38	0.4	0	29.5
14/05/2024 18:00	14.2	0.69	466514.1	39.42	0.4	0	29.8
14/05/2024 19:00	14.21	0.81	470581.3	39.87	0.4	0	29.8
14/05/2024 20:00	14.2	0.9	474959.5	40.35	0.4	0	29.9
14/05/2024 21:00	14.22	0.94	489579	41.88	0.4	0	30.2
14/05/2024 22:00	14.22	0.98	497467.9	42.64	0.5	0	30.2



14/05/2024 23:00	14.22	0.92	497262.2	42.67	0.5	0	30.6
14/05/2024 24:00	14.22	0.95	497189.4	42.66	0.5	0	31
Minimum	14.18	0.67	389664.3	28.73	0.2	0	29.5
MinDate	05/14/2024 16:00:00	05/14/2024 14:00:00	05/14/2024 13:00:00	05/14/2024 13:00:00	05/14/2024 13:00:00	05/14/2024 1:00:00	05/14/2024 17:00:00
Maximum	14.37	1.09	497467.9	43.06	0.6	0	40
MaxDate	05/14/2024 13:00:00	05/14/2024 4:00:00	05/14/2024 22:00:00	05/14/2024 6:00:00	05/14/2024 8:00:00	05/14/2024 1:00:00	05/14/2024 13:00:00
Avg	14.23	0.88	474615.6	40.34	0.4	0	31.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	24507.1	3.2	0.1	0	2.2
Site ABPR52 Daily: 14/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
14/05/2024 01:00	Shutdown	0.54	Shutdown	4.22	Shutdown	Shutdown	Shutdown
14/05/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/05/2024 03:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
14/05/2024 04:00	Shutdown	1.25	Shutdown	0	Shutdown	Shutdown	Shutdown
14/05/2024 05:00	Shutdown	2.86	Shutdown	0	Shutdown	Shutdown	Shutdown
14/05/2024 06:00	Shutdown	1.24	Shutdown	0	Shutdown	Shutdown	Shutdown
14/05/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/05/2024 08:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/05/2024 09:00	Shutdown	0.58	Shutdown	2.47	Shutdown	Shutdown	Shutdown
14/05/2024 10:00	14.62	0.6	463628.4	37.56	0	0	30
14/05/2024 11:00	14.66	0.69	470434.4	39.23	0	0	29.4
14/05/2024 12:00	14.69	0.7	469354.8	39.15	0	0	29.8
14/05/2024 13:00	14.8	0.68	391236.8	28.78	0	0	35
14/05/2024 14:00	14.7	0.42	445459.6	36.02	0	0	30.2
14/05/2024 15:00	14.65	0.42	469926.7	39.21	0	0	28.7
14/05/2024 16:00	14.63	0.29	466475.1	38.94	0	0	28.7
14/05/2024 17:00	14.6	0.37	471651.8	39.48	0	0	28.4
14/05/2024 18:00	14.59	0.52	471688.2	39.51	0	0	28.5
14/05/2024 19:00	14.59	0.61	478815.2	40.23	0	0	28.8
14/05/2024 20:00	14.56	0.6	495510.9	42.09	0	0	30.3
14/05/2024 21:00	14.55	0.62	495545.6	42.12	0	0	29.7
14/05/2024 22:00	14.52	0.6	503275	42.94	0	0	29.4
14/05/2024 23:00	14.52	0.52	502449.5	42.97	0	0	29.3
14/05/2024 24:00	14.52	0.52	501725.1	42.9	0	0	29.3
Minimum	14.52	0	391236.8	0	0	0	28.4
MinDate	05/14/2024 22:00:00	05/14/2024 2:00:00	05/14/2024 13:00:00	05/14/2024 2:00:00	05/14/2024 10:00:00	05/14/2024 10:00:00	05/14/2024 17:00:00
Maximum	14.8	2.86	503275	42.97	0	0	35
MaxDate	05/14/2024 13:00:00	05/14/2024 5:00:00	05/14/2024 22:00:00	05/14/2024 23:00:00	05/14/2024 10:00:00	05/14/2024 10:00:00	05/14/2024 13:00:00
Avg	14.61	0.61	473145.1	24.91	0	0	29.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.6	28365.2	19.3	0	0	1.6
Site ABPR51 Daily: 15/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
15/05/2024 01:00	14.28	0.9	452619.3	37.09	0.5	0	36.2
15/05/2024 02:00	14.22	0.81	494775.5	42.87	0.5	0	30.7
15/05/2024 03:00	14.22	0.8	494893.6	42.9	0.4	0	30.5
15/05/2024 04:00	14.22	0.84	494735.7	42.92	0.4	0	30.6
15/05/2024 05:00	14.22	0.79	494707.5	42.93	0.4	0	30.7
15/05/2024 06:00	14.22	0.85	495541.8	43.01	0.5	0	30.6
15/05/2024 07:00	14.22	0.89	494559.7	42.92	0.6	0	30.6
15/05/2024 08:00	14.22	0.64	495388.7	42.95	0.5	0	30.7
15/05/2024 09:00	14.22	0.54	483334.7	41.48	0.4	0	30.8
15/05/2024 10:00	14.24	0.55	456012.5	38.02	0.5	0	30.6
15/05/2024 11:00	14.25	0.78	470574.7	39.86	0.5	0	29.5
15/05/2024 12:00	14.22	0.67	469076.9	39.75	0.4	0	29.8
15/05/2024 13:00	14.36	0.39	394179.3	29.36	0.3	0	39.2
15/05/2024 14:00	14.26	0.66	445874.6	36.64	0.3	0	33.4
15/05/2024 15:00	14.21	0.8	469887.8	39.82	0.5	0	30.4
15/05/2024 16:00	14.22	0.83	471133.2	39.84	0.5	0	30.3
15/05/2024 17:00	14.2	1	463977.6	39.17	0.4	0	30.2
15/05/2024 18:00	14.16	1.27	460047.8	38.9	0.4	0	30.7
15/05/2024 19:00	14.16	1.08	462153.4	39.22	0.4	0	30.6
15/05/2024 20:00	14.18	1.04	470157.7	40.08	0.4	0	30.3
15/05/2024 21:00	14.22	0.85	491330.1	42.18	0.4	0	30
15/05/2024 22:00	14.21	1.29	494746	42.49	0.5	0	29.9
15/05/2024 23:00	14.21	1.37	491604.8	42.28	0.5	0	30.1
15/05/2024 24:00	14.21	1	495501.9	42.6	0.5	0	30.3
Minimum	14.16	0.39	394179.3	29.36	0.3	0	29.5
MinDate	05/15/2024 18:00:00	05/15/2024 13:00:00	05/15/2024 13:00:00	05/15/2024 13:00:00	05/15/2024 13:00:00	05/15/2024 1:00:00	05/15/2024 11:00:00
Maximum	14.36	1.37	495541.8	43.01	0.6	0	39.2
MaxDate	05/15/2024 13:00:00	05/15/2024 23:00:00	05/15/2024 6:00:00	05/15/2024 6:00:00	05/15/2024 7:00:00	05/15/2024 1:00:00	05/15/2024 13:00:00
Avg	14.22	0.86	475284	40.39	0.4	0	31.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.2	23843.9	3.1	0.1	0	2.2
Site ABPR52 Daily: 15/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
15/05/2024 01:00	Shutdown	0.75	Shutdown	4.7	Shutdown	Shutdown	Shutdown
15/05/2024 02:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
15/05/2024 03:00	Shutdown	0.17	Shutdown	0	Shutdown	Shutdown	Shutdown
15/05/2024 04:00	Shutdown	1.13	Shutdown	0	Shutdown	Shutdown	Shutdown
15/05/2024 05:00	Shutdown	2.79	Shutdown	0	Shutdown	Shutdown	Shutdown
15/05/2024 06:00	Shutdown	1.5	Shutdown	0	Shutdown	Shutdown	Shutdown
15/05/2024 07:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
15/05/2024 08:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
15/05/2024 09:00	Shutdown	0.57	Shutdown	1.68	Shutdown	Shutdown	Shutdown
15/05/2024 10:00	14.71	0.6	467587.5	37.96	0.1	0	30.4
15/05/2024 11:00	14.78	0.85	479092.6	39.95	0	0	28.6
15/05/2024 12:00	14.72	0.58	476204.9	39.84	0	0	28.6
15/05/2024 13:00	14.75	0.32	395308.9	29.45	0	0	34
15/05/2024 14:00	14.59	0.5	450982.1	36.77	0	0	30.4
15/05/2024 15:00	14.55	0.58	475484	39.92	0	0	28.8
15/05/2024 16:00	14.62	0.74	477280.6	39.94	0	0	29.5
15/05/2024 17:00	14.57	0.58	468894.4	39.28	0	0	29.2
15/05/2024 18:00	14.42	0.4	463301.4	39.01	0	0	28.7
15/05/2024 19:00	14.39	0.51	465847.6	39.32	0	0	28.2
15/05/2024 20:00	14.39	0.57	474948.2	40.27	0	0	28
15/05/2024 21:00	14.4	0.57	497317.3	42.5	0	0	28.3



15/05/2024 22:00	14.4	0.6	499661.4	42.77	0	0	28.3
15/05/2024 23:00	14.41	0.52	495990.4	42.46	0	0	28.2
15/05/2024 24:00	14.42	0.57	502882.6	43.12	0	0	28.7
Minimum	14.39	0.03	395308.9	0	0	0	28
MinDate	05/15/2024 19:00:00	05/15/2024 7:00:00	05/15/2024 13:00:00	05/15/2024 2:00:00	05/15/2024 11:00:00	05/15/2024 10:00:00	05/15/2024 20:00:00
Maximum	14.78	2.79	502882.6	43.12	0.1	0	34
MaxDate	05/15/2024 11:00:00	05/15/2024 5:00:00			05/15/2024 10:00:00	05/15/2024 10:00:00	05/15/2024 13:00:00
Avg	14.54	0.65	472718.9	24.96	0	0	29.2
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.6	26063.1	19.4	0	0	1.5
Site ABPR51 Daily: 16/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
16/05/2024 01:00	14.25	0.82	457520.4	38.07	0.4	0	33.7
16/05/2024 02:00	14.22	0.85	493371.6	42.87	0.5	0	30.6
16/05/2024 03:00	14.22	0.72	493893.1	42.9	0.4	0	30.4
16/05/2024 04:00	14.22	0.92	493945.1	42.9	0.4	0	30.4
16/05/2024 05:00	14.22	1.07	493985.7	42.91	0.5	0	30.2
16/05/2024 06:00	14.22	0.87	494956.6	42.99	0.5	0	30.3
16/05/2024 07:00	14.22	0.85	493927.8	42.91	0.6	0	30.3
16/05/2024 08:00	14.22	0.9	494776.1	42.93	0.6	0	30.1
16/05/2024 09:00	14.21	1.01	489067.6	42.1	0.6	0	30
16/05/2024 10:00	14.19	1.03	457005.1	38.15	0.4	0	29.4
16/05/2024 11:00	14.16	0.9	465466.1	39.48	0.3	0	29.7
16/05/2024 12:00	14.16	0.83	464535.4	39.47	0.4	0	30.7
16/05/2024 13:00	14.34	0.71	390855.7	28.99	0.3	0	38.9
16/05/2024 14:00	14.24	0.75	445745.6	36.66	0.3	0	32.7
16/05/2024 15:00	14.16	0.89	470423.4	40.06	0.3	0	30.8
16/05/2024 16:00	14.16	1.22	467693.2	39.76	0.4	0	30.5
16/05/2024 17:00	14.16	1.01	466765.5	39.69	0.6	0	30.2
16/05/2024 18:00	14.15	0.91	462701.1	39.23	0.6	0	29.9
16/05/2024 19:00	14.15	1	463527	39.31	0.5	0	30.2
16/05/2024 20:00	14.18	1	478452.3	40.82	0.5	0	29.8
16/05/2024 21:00	14.18	1.16	478752	40.87	0.5	0	29.7
16/05/2024 22:00	14.2	1.41	484586.2	41.51	0.5	0	29.7
16/05/2024 23:00	14.21	1.29	487306.3	41.77	0.5	0	29.8
16/05/2024 24:00	14.19	0.94	483713.8	41.41	0.6	0	29.8
Minimum	14.15	0.71	390855.7	28.99	0.3	0	29.4
MinDate	05/16/2024 18:00:00	05/16/2024 13:00:00	05/16/2024 13:00:00	05/16/2024 13:00:00	05/16/2024 11:00:00	05/16/2024 1:00:00	05/16/2024 10:00:00
Maximum	14.34	1.41	494956.6	42.99	0.6	0	38.9
MaxDate	05/16/2024 13:00:00	05/16/2024 22:00:00	05/16/2024 6:00:00	05/16/2024 6:00:00	05/16/2024 7:00:00	05/16/2024 1:00:00	05/16/2024 13:00:00
Avg	14.2	0.96	473873.8	40.32	0.5	0	30.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.2	23093.3	3	0.1	0	2
Site ABPR52 Daily: 16/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
16/05/2024 01:00	Shutdown	0.69	Shutdown	4.18	Shutdown	Shutdown	Shutdown
16/05/2024 02:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
16/05/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
16/05/2024 04:00	Shutdown	0.96	Shutdown	0	Shutdown	Shutdown	Shutdown
16/05/2024 05:00	Shutdown	2.18	Shutdown	0	Shutdown	Shutdown	Shutdown
16/05/2024 06:00	Shutdown	1.59	Shutdown	0	Shutdown	Shutdown	Shutdown
16/05/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
16/05/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
16/05/2024 09:00	Shutdown	0.64	Shutdown	1.39	Shutdown	Shutdown	Shutdown
16/05/2024 10:00	14.49	0.49	468124.6	37.98	0.2	0	28.6
16/05/2024 11:00	14.45	0.36	470740.9	39.57	0	0	27.4
16/05/2024 12:00	14.43	0.4	468285.9	39.58	0	0	28.1
16/05/2024 13:00	14.59	0.55	390579.7	29.11	0	0	33.6
16/05/2024 14:00	14.51	0.54	448165.6	36.72	0	0	29.1
16/05/2024 15:00	14.36	0.58	472497	40.15	0	0	27.9
16/05/2024 16:00	14.36	0.55	469441.7	39.86	0	0	27.6
16/05/2024 17:00	14.39	0.66	469718.8	39.77	0	0	27.4
16/05/2024 18:00	14.38	0.62	465180.3	39.32	0	0	27.2
16/05/2024 19:00	14.39	0.68	465604.6	39.4	0	0	27.5
16/05/2024 20:00	14.38	0.56	480841	40.93	0	0	27.3
16/05/2024 21:00	14.39	0.58	480481	40.96	0	0	27.2
16/05/2024 22:00	14.4	0.37	486618	41.61	0	0	27.1
16/05/2024 23:00	14.4	0.4	489039.4	41.87	0	0	27.1
16/05/2024 24:00	14.38	0.35	485871.4	41.52	0	0	26.9
Minimum	14.36	0	390579.7	0	0	0	26.9
MinDate	05/16/2024 15:00:00	05/16/2024 7:00:00	05/16/2024 13:00:00	05/16/2024 2:00:00	05/16/2024 11:00:00	05/16/2024 10:00:00	
Maximum	14.59	2.18	489039.4	41.87	0.2	0	33.6
MaxDate	05/16/2024 13:00:00	05/16/2024 5:00:00	05/16/2024 23:00:00	05/16/2024 23:00:00	05/16/2024 10:00:00	05/16/2024 10:00:00	05/16/2024 13:00:00
Avg	14.42	0.58	467412.7	24.75	0	0	28
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.5	23690.7	19.3	0.1	0	1.7
Site ABPR51 Daily: 17/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
17/05/2024 01:00	14.26	0.81	463407.7	38.63	0.5	0	33
17/05/2024 02:00	14.22	0.7	493363.1	42.88	0.3	0	30.9
17/05/2024 03:00	14.22	0.88	493093.4	42.91	0.3	0	31.3
17/05/2024 04:00	14.22	0.94	493183.6	42.91	0.3	0	31.2
17/05/2024 05:00	14.22	1.16	493269.2	42.88	0.5	0	30.9
17/05/2024 06:00	14.22	1.04	493869.9	42.99	0.4	0	31
17/05/2024 07:00	14.22	1.23	492980	42.89	0.4	0	31
17/05/2024 08:00	14.22	1.19	493201.3	42.91	0.5	0	30.8
17/05/2024 09:00	14.21	1.05	486408.8	42.04	0.4	0	31
17/05/2024 10:00	14.2	0.85	452592.8	37.9	0.3	0	30.8
17/05/2024 11:00	14.17	0.98	465245.2	39.51	0.4	0	29.9
17/05/2024 12:00	14.16	0.88	458415.6	38.67	0.5	0	29.7
17/05/2024 13:00	14.36	0.81	387560.5	28.37	0.3	0	38.4
17/05/2024 14:00	14.25	0.61	442722.6	36.14	0.2	0	32.1
17/05/2024 15:00	14.16	1.12	462750.8	39.4	0.1	0	30.9
17/05/2024 16:00	14.15	1.23	462490.3	39.31	0.3	0	30.4
17/05/2024 17:00	14.15	1.02	465251.1	39.47	0.4	0	29.5
17/05/2024 18:00	14.15	0.95	463320.3	39.26	0.4	0	29.1
17/05/2024 19:00	14.16	0.96	466029.4	39.5	0.4	0	29.2
17/05/2024 20:00	14.16	1.01	468989.6	39.88	0.3	0	29.3



17/05/2024 21:00	14.16	1.01	472318.7	40.15	0.4	0	29.2
17/05/2024 22:00	14.17	0.99	480892	41.11	0.5	0	29.2
17/05/2024 23:00	14.19	1.05	484225.8	41.48	0.3	0	29.5
17/05/2024 24:00	14.19	0.96	482493.9	41.27	0.4	0	29.4
Minimum	14.15	0.61	387560.5	28.37	0.1	0	29.1
MinDate	05/17/2024 16:00:00	05/17/2024 14:00:00	05/17/2024 13:00:00	05/17/2024 13:00:00	05/17/2024 15:00:00	05/17/2024 1:00:00	05/17/2024 18:00:00
Maximum	14.36	1.23	493869.9	42.99	0.5	0	38.4
MaxDate	05/17/2024 13:00:00	05/17/2024 7:00:00	05/17/2024 6:00:00	05/17/2024 6:00:00	05/17/2024 1:00:00	05/17/2024 1:00:00	05/17/2024 13:00:00
Avg	14.2	0.98	471586.5	40.1	0.4	0	30.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.2	23518.4	3.2	0.1	0	1.9
Site ABPR52 Daily: 17/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
17/05/2024 01:00	Shutdown	0.57	Shutdown	3.62	Shutdown	Shutdown	Shutdown
17/05/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
17/05/2024 03:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
17/05/2024 04:00	Shutdown	0.9	Shutdown	0	Shutdown	Shutdown	Shutdown
17/05/2024 05:00	Shutdown	2.22	Shutdown	0	Shutdown	Shutdown	Shutdown
17/05/2024 06:00	Shutdown	1.46	Shutdown	0	Shutdown	Shutdown	Shutdown
17/05/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
17/05/2024 08:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
17/05/2024 09:00	Shutdown	0.74	Shutdown	1.37	Shutdown	Shutdown	Shutdown
17/05/2024 10:00	14.48	0.69	463717.5	37.71	0.2	0	30.1
17/05/2024 11:00	14.52	0.83	472176.2	39.59	0	0	28
17/05/2024 12:00	14.54	0.81	463454.8	38.76	0	0	27.9
17/05/2024 13:00	14.72	0.77	388612.7	28.46	0	0	33.2
17/05/2024 14:00	14.6	0.19	446047.5	36.19	0	0	28.9
17/05/2024 15:00	14.37	0.2	465040.5	39.49	0	0	27.8
17/05/2024 16:00	14.36	0.79	465629.4	39.38	0	0	27.4
17/05/2024 17:00	14.41	0.8	468033.5	39.57	0	0	26.9
17/05/2024 18:00	14.45	0.76	466301.1	39.37	0	0	26.7
17/05/2024 19:00	14.46	0.72	468451.4	39.6	0	0	26.7
17/05/2024 20:00	14.42	0.7	471930	39.97	0	0	26.9
17/05/2024 21:00	14.41	0.71	474205.9	40.25	0	0	26.9
17/05/2024 22:00	14.41	0.59	483827.1	41.22	0	0	26.8
17/05/2024 23:00	14.41	0.51	487235.8	41.57	0	0	27.1
17/05/2024 24:00	14.41	0.37	485590.3	41.35	0	0	26.9
Minimum	14.36	0	388612.7	0	0	0	26.7
MinDate	05/17/2024 16:00:00	05/17/2024 2:00:00	05/17/2024 13:00:00	05/17/2024 2:00:00	05/17/2024 11:00:00	05/17/2024 10:00:00	05/17/2024 18:00:00
Maximum	14.72	2.22	487235.8	41.57	0.2	0	33.2
MaxDate	05/17/2024 13:00:00	05/17/2024 5:00:00	05/17/2024 23:00:00	05/17/2024 23:00:00	05/17/2024 10:00:00	05/17/2024 10:00:00	05/17/2024 13:00:00
Avg	14.46	0.65	464683.6	24.48	0	0	27.9
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.5	23416.8	19.1	0.1	0	1.8
Site ABPR51 Daily: 18/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW MG/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
18/05/2024 01:00	14.09	1.03	408420.9	32.92	0.4	0	32.3
18/05/2024 02:00	14.07	1.25	425519.7	35.19	0.4	0	30.2
18/05/2024 03:00	14.07	1.34	426706.8	35.35	0.4	0	30.3
18/05/2024 04:00	14.07	1.26	420923	34.63	0.5	0	30.8
18/05/2024 05:00	14.05	1.21	414649.7	33.92	0.4	0	31.1
18/05/2024 06:00	14.05	1.07	412985.6	33.78	0.5	0	31.6
18/05/2024 07:00	14.06	0.87	409413.5	33.19	0.5	0	32.2
18/05/2024 08:00	14.09	0.92	406443	32.69	0.6	0	32.3
18/05/2024 09:00	14.11	0.79	403262.9	32.14	0.5	0	32.5
18/05/2024 10:00	14.23	0.83	441914.3	36.15	0.3	0	30.9
18/05/2024 11:00	14.15	1.04	460589.4	38.96	0.2	0	29.7
18/05/2024 12:00	14.16	1.03	467202.3	39.57	0.2	0	29.3
18/05/2024 13:00	14.34	0.91	391071.9	28.8	0.1	0	35.7
18/05/2024 14:00	14.25	0.93	439130	35.41	0.2	0	34.9
18/05/2024 15:00	14.18	0.98	471082.2	39.91	0.3	0	29.1
18/05/2024 16:00	14.17	0.89	465687.5	39.43	0.4	0	29.5
18/05/2024 17:00	14.17	0.97	468782.2	39.69	0.4	0	29.4
18/05/2024 18:00	14.17	1.01	472884.8	40.1	0.3	0	28.8
18/05/2024 19:00	14.19	1.03	473800.8	40.19	0.3	0	29.3
18/05/2024 20:00	14.18	0.91	471315.8	40.02	0.3	0	29.6
18/05/2024 21:00	14.19	0.86	480224.5	40.88	0.3	0	29.2
18/05/2024 22:00	14.17	0.93	473781.3	40.24	0.3	0	29.3
18/05/2024 23:00	14.18	1.03	479613.9	40.82	0.3	0	29.1
18/05/2024 24:00	14.18	0.96	479385	40.79	0.3	0	29.3
Minimum	14.05	0.79	391071.9	28.8	0.1	0	28.8
MinDate	05/18/2024 5:00:00	05/18/2024 9:00:00	05/18/2024 13:00:00	05/18/2024 13:00:00	05/18/2024 13:00:00	05/18/2024 1:00:00	05/18/2024 18:00:00
Maximum	14.34	1.34	480224.5	40.88	0.6	0	35.7
MaxDate	05/18/2024 13:00:00	05/18/2024 3:00:00	05/18/2024 21:00:00	05/18/2024 21:00:00	05/18/2024 8:00:00	05/18/2024 1:00:00	05/18/2024 13:00:00
Avg	14.15	1	444366.3	36.87	0.4	0	30.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30341.4	3.6	0.1	0	1.9
Site ABPR52 Daily: 18/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
18/05/2024 01:00	14.33	0.39	408491.4	32.98	0	0	28.5
18/05/2024 02:00	14.3	0.33	425718.7	35.27	0	0	27.4
18/05/2024 03:00	14.31	0.3	427101	35.43	0	0	27.5
18/05/2024 04:00	14.31	0.28	421142.1	34.71	0	0	27.7
18/05/2024 05:00	14.32	0.36	414518.2	33.99	0	0	27.5
18/05/2024 06:00	14.34	0.49	413855.3	33.85	0	0	28
18/05/2024 07:00	14.35	0.51	409708.7	33.25	0	0	28
18/05/2024 08:00	14.42	0.7	407070.7	32.78	0	0	28.2
18/05/2024 09:00	14.53	0.74	404697.3	32.22	0	0	28.2
18/05/2024 10:00	14.62	0.65	453293.4	37.18	0	0	28.6
18/05/2024 11:00	14.43	0.58	463798.3	39.1	0	0	27
18/05/2024 12:00	14.45	0.52	469741	39.67	0	0	27
18/05/2024 13:00	14.56	0.49	390292.6	29	0	0	30.2
18/05/2024 14:00	14.5	0.54	452581.5	36.76	0	0	31.4
18/05/2024 15:00	14.46	0.48	474008	40.09	0	0	26.6
18/05/2024 16:00	14.48	0.59	467672.3	39.5	0	0	27.1
18/05/2024 17:00	14.49	0.74	470442.8	39.78	0	0	26.9
18/05/2024 18:00	14.47	0.77	476212.6	40.32	0	0	26.6
18/05/2024 19:00	14.46	0.71	476358	40.33	0	0	27.1



18/05/2024 20:00	14.42	0.62	473779.6	40.11	0	0	27.4
18/05/2024 21:00	14.42	0.46	482502	40.98	0	0	27.1
18/05/2024 22:00	14.39	0.43	474834.2	40.33	0	0	26.7
18/05/2024 23:00	14.4	0.39	480798.7	40.92	0	0	26.6
18/05/2024 24:00	14.41	0.35	480645.5	40.89	0	0	26.5
Minimum	14.3	0.28	390292.6	29	0	0	26.5
MinDate	05/18/2024 2:00:00	05/18/2024 4:00:00	05/18/2024 13:00:00	05/18/2024 13:00:00	05/18/2024 1:00:00	05/18/2024 1:00:00	
Maximum	14.62	0.77	482502	40.98	0	0	31.4
MaxDate	05/18/2024 10:00:00	05/18/2024 18:00:00	05/18/2024 21:00:00	05/18/2024 21:00:00	05/18/2024 1:00:00	05/18/2024 1:00:00	05/18/2024 14:00:00
Avg	14.42	0.52	446636	37.06	0	0	27.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	31248.7	3.5	0	0	1.2
Site ABPR51 Daily: 19/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
19/05/2024 01:00	14.11	0.81	407001	32.55	0.3	0	32.3
19/05/2024 02:00	14.04	0.9	412959.4	33.69	0.3	0	31.2
19/05/2024 03:00	14.08	0.92	406655.1	32.76	0.3	0	32.2
19/05/2024 04:00	14.08	0.91	406128.2	32.62	0.3	0	32.5
19/05/2024 05:00	14.12	0.88	399591.8	31.58	0.3	0	33.6
19/05/2024 06:00	14.11	0.89	402271	32.08	0.4	0	33.9
19/05/2024 07:00	14.13	0.88	397989	31.33	0.4	0	33.7
19/05/2024 08:00	14.19	0.7	389817	29.95	0.4	0	34.1
19/05/2024 09:00	14.2	0.72	388565.3	29.63	0.3	0	31.7
19/05/2024 10:00	14.15	0.88	397644.7	31.16	0.2	0	33
19/05/2024 11:00	14.16	0.95	396123.3	31.04	0.1	0	33.9
19/05/2024 12:00	14.17	0.93	392280.3	30.26	0.3	0	32
19/05/2024 13:00	14.22	0.95	385302.3	29	0.2	0	30.8
19/05/2024 14:00	14.15	0.82	395299	30.89	0.2	0	32
19/05/2024 15:00	14.16	0.93	391443.8	30.27	0.2	0	31.7
19/05/2024 16:00	14.19	1.02	387838	29.55	0.3	0	30.8
19/05/2024 17:00	14.2	0.77	386467.3	29.33	0.2	0	30.9
19/05/2024 18:00	14.17	0.74	390550.3	30	0.2	0	31.7
19/05/2024 19:00	14.21	0.81	412522.7	32.54	0.2	0	34.9
19/05/2024 20:00	14.11	0.98	448707.9	37.66	0.2	0	29.3
19/05/2024 21:00	14.1	1.04	445073	37.32	0.2	0	29.5
19/05/2024 22:00	14.09	0.98	444510.6	37.22	0.3	0	29.5
19/05/2024 23:00	14.19	0.94	411603.9	32.39	0.2	0	32.1
19/05/2024 24:00	14.23	0.84	383035.6	28.58	0.2	0	30.7
Minimum	14.04	0.7	383035.6	28.58	0.1	0	29.3
MinDate	05/19/2024 2:00:00	05/19/2024 8:00:00			05/19/2024 11:00:00	05/19/2024 1:00:00	05/19/2024 20:00:00
Maximum	14.23	1.04	448707.9	37.66	0.4	0	34.9
MaxDate		05/19/2024 21:00:00	05/19/2024 20:00:00	05/19/2024 20:00:00	05/19/2024 6:00:00	05/19/2024 1:00:00	05/19/2024 19:00:00
Avg	14.15	0.88	403307.6	31.81	0.3	0	32
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	18713.7	2.5	0.1	0	1.5
Site ABPR52 Daily: 19/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
19/05/2024 01:00	14.35	0.36	406754.3	32.6	0	0	28.3
19/05/2024 02:00	14.3	0.47	413029.1	33.77	0	0	27.6
19/05/2024 03:00	14.34	0.4	407261.3	32.84	0	0	28.1
19/05/2024 04:00	14.34	0.51	405974.6	32.69	0	0	28.4
19/05/2024 05:00	14.37	0.6	399584.3	31.65	0	0	29.5
19/05/2024 06:00	14.37	0.65	402853.4	32.15	0	0	29.6
19/05/2024 07:00	14.4	0.69	398081.4	31.4	0	0	29.4
19/05/2024 08:00	14.48	0.64	390299	30.02	0	0	30.1
19/05/2024 09:00	14.51	0.62	388543.1	29.69	0	0	28
19/05/2024 10:00	14.47	0.59	398105.3	31.23	0	0	30.2
19/05/2024 11:00	14.43	0.45	396780	31.11	0	0	30.8
19/05/2024 12:00	14.43	0.64	391988.6	30.34	0	0	28.8
19/05/2024 13:00	14.52	0.5	384558.5	29.07	0	0	27.4
19/05/2024 14:00	14.43	0.34	395537.7	30.96	0	0	29.1
19/05/2024 15:00	14.41	0.38	390517.9	30.33	0	0	28.1
19/05/2024 16:00	14.47	0.62	387194.3	29.61	0	0	27.4
19/05/2024 17:00	14.52	0.39	386665.3	29.4	0	0	28
19/05/2024 18:00	14.48	0.53	391430.4	30.06	0	0	29.1
19/05/2024 19:00	14.5	0.59	416321.8	32.89	0	0	31.8
19/05/2024 20:00	14.39	0.51	450702.6	37.73	0	0	27
19/05/2024 21:00	14.36	0.61	446411.3	37.41	0	0	27.1
19/05/2024 22:00	14.37	0.58	445339.9	37.29	0	0	27
19/05/2024 23:00	14.45	0.47	411052.4	32.48	0	0	28.5
19/05/2024 24:00	14.5	0.38	381817.3	28.64	0	0	26.4
Minimum	14.3	0.34	381817.3	28.64	0	0	26.4
MinDate	05/19/2024 2:00:00	05/19/2024 14:00:00			05/19/2024 1:00:00	05/19/2024 1:00:00	
Maximum	14.52	0.69	450702.6	37.73	0	0	31.8
MaxDate	05/19/2024 13:00:00	05/19/2024 7:00:00	05/19/2024 20:00:00	05/19/2024 20:00:00	05/19/2024 1:00:00	05/19/2024 1:00:00	05/19/2024 19:00:00
Avg	14.42	0.52	403616.8	31.89	0	0	28.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	19301.3	2.5	0	0	1.3
Site ABPR51 Daily: 20/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
20/05/2024 01:00	14.29	0.61	378429.9	27.82	0.1	0	32.6
20/05/2024 02:00	14.25	0.84	382747.9	28.6	0.2	0	32.5
20/05/2024 03:00	14.25	1.04	383028.1	28.73	0.3	0	32.6
20/05/2024 04:00	14.25	0.96	381840.7	28.51	0.3	0	32.4
20/05/2024 05:00	14.28	0.88	378210.6	27.73	0.3	0	31.7
20/05/2024 06:00	14.26	1.06	382263.7	28.6	0.4	0	32.1
20/05/2024 07:00	14.22	0.94	385147.7	29.06	0.4	0	32.4
20/05/2024 08:00	14.22	0.77	385661.9	29.16	0.5	0	32.2
20/05/2024 09:00	14.17	0.66	395156.7	30.8	0.5	0	32.9
20/05/2024 10:00	14.24	0.77	429770.1	34.65	0.3	0	32.9
20/05/2024 11:00	14.16	0.87	449002.3	37.6	0.3	0	29.5
20/05/2024 12:00	14.16	0.9	455306.5	38.2	0.2	0	29.1
20/05/2024 13:00	14.36	1.06	385236.8	27.95	0	0	38.8
20/05/2024 14:00	14.23	0.89	435438.3	35.08	0.1	0	35.7
20/05/2024 15:00	14.15	1.26	454524.3	38.44	0.3	0	31
20/05/2024 16:00	14.14	1.29	451227.6	37.99	0.5	0	30.3
20/05/2024 17:00	14.15	1.38	454340.1	38.27	0.5	0	30.7
20/05/2024 18:00	14.15	1.31	455747.8	38.41	0.4	0	29.1



20/05/2024 19:00	14.15	0.93	457811	38.65	0.3	0	29.1
20/05/2024 20:00	14.12	0.93	452248.3	38.04	0.5	0	29.3
20/05/2024 21:00	14.12	1.02	452438.8	38.07	0.5	0	29.2
20/05/2024 22:00	14.15	1.06	457733.3	38.61	0.4	0	29.1
20/05/2024 23:00	14.15	1.2	459293.6	38.74	0.5	0	29
20/05/2024 24:00	14.15	1.21	460572.6	38.91	0.5	0	29
Minimum	14.12	0.61	378210.6	27.73	0	0	29
MinDate	05/20/2024 20:00:00	05/20/2024 1:00:00	05/20/2024 5:00:00	05/20/2024 5:00:00	05/20/2024 13:00:00	05/20/2024 1:00:00	05/20/2024 23:00:00
Maximum	14.36	1.38	460572.6	38.91	0.5	0	38.8
MaxDate	05/20/2024 13:00:00	05/20/2024 17:00:00			05/20/2024 8:00:00	05/20/2024 1:00:00	05/20/2024 13:00:00
Avg	14.2	0.99	423465.8	34.03	0.3	0	31.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	35028.7	4.7	0.1	0	2.4
Site ABPR52 Daily: 20/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
20/05/2024 01:00	14.56	0.17	376392.5	27.89	0	0	27.2
20/05/2024 02:00	14.52	0.42	381577.4	28.67	0	0	27.8
20/05/2024 03:00	14.52	0.56	381740.4	28.79	0	0	27.8
20/05/2024 04:00	14.5	0.5	380125.5	28.58	0	0	27.4
20/05/2024 05:00	14.53	0.59	376306.3	27.81	0	0	26.3
20/05/2024 06:00	14.5	0.68	381057.5	28.69	0	0	27.2
20/05/2024 07:00	14.48	0.64	384086.6	29.14	0	0	27.6
20/05/2024 08:00	14.51	0.65	385177.9	29.22	0	0	27.8
20/05/2024 09:00	14.58	0.68	396140.3	30.89	0	0	29.4
20/05/2024 10:00	14.66	0.65	435924.5	35.11	0	0	29.7
20/05/2024 11:00	14.58	0.68	452746.1	37.71	0	0	27.6
20/05/2024 12:00	14.58	0.53	459119.4	38.35	0	0	27.4
20/05/2024 13:00	14.58	0.66	385257.5	28.25	0	0	33.2
20/05/2024 14:00	14.42	0.61	440157.7	35.54	0	0	32.5
20/05/2024 15:00	14.34	0.68	457058.1	38.62	0	0	27.6
20/05/2024 16:00	14.38	0.68	452571	38.08	0	0	27.3
20/05/2024 17:00	14.4	0.63	455690.4	38.35	0	0	27.9
20/05/2024 18:00	14.4	0.57	457818.8	38.56	0	0	26.3
20/05/2024 19:00	14.39	0.43	459081.6	38.72	0	0	26.2
20/05/2024 20:00	14.36	0.52	453217.8	38.15	0	0	26.3
20/05/2024 21:00	14.35	0.55	452981.6	38.14	0	0	26.3
20/05/2024 22:00	14.38	0.54	458499.1	38.7	0	0	26.2
20/05/2024 23:00	14.4	0.57	460093.9	38.83	0	0	26.2
20/05/2024 24:00	14.41	0.42	461664.8	39	0	0	25.9
Minimum	14.34	0.17	376306.3	27.81	0	0	25.9
MinDate	05/20/2024 15:00:00	05/20/2024 1:00:00	05/20/2024 5:00:00	05/20/2024 5:00:00	05/20/2024 1:00:00	05/20/2024 1:00:00	
Maximum	14.66	0.68	461664.8	39	0	0	33.2
MaxDate	05/20/2024 10:00:00	05/20/2024 6:00:00			05/20/2024 1:00:00	05/20/2024 1:00:00	05/20/2024 13:00:00
Avg	14.47	0.57	424353.6	34.16	0	0	27.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	36490.5	4.7	0	0	1.9
Site ABPR51 Daily: 21/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
21/05/2024 01:00	14.15	1.01	395693.2	30.81	0.5	0	32.7
21/05/2024 02:00	14.07	0.85	406799.8	32.84	0.5	0	31.5
21/05/2024 03:00	14.08	0.95	406779.8	32.8	0.4	0	31.9
21/05/2024 04:00	14.11	0.94	401139.6	31.88	0.3	0	33.4
21/05/2024 05:00	14.16	0.98	393244.8	30.64	0.4	0	33.2
21/05/2024 06:00	14.16	1.15	394348.6	30.71	0.3	0	33.3
21/05/2024 07:00	14.16	0.78	393051.4	30.65	0.3	0	33.7
21/05/2024 08:00	14.18	1.2	392020.3	30.41	0.3	0	33.4
21/05/2024 09:00	14.17	1.15	393630.7	30.68	0.3	0	33.5
21/05/2024 10:00	14.2	1.13	430856.5	35.13	0.4	0	32.8
21/05/2024 11:00	14.14	1.33	449576.5	37.84	0.4	0	29.7
21/05/2024 12:00	14.14	1	451628.4	38.04	0.4	0	29.6
21/05/2024 13:00	14.39	0.93	380411.5	27	0.1	0	42.1
21/05/2024 14:00	14.19	0.95	434130.3	34.31	0.3	0	34.8
21/05/2024 15:00	14.15	0.94	450300.7	37.92	0.3	0	30.4
21/05/2024 16:00	14.15	1.1	453700.5	38.26	0.3	0	29.9
21/05/2024 17:00	14.15	1.01	454674.8	38.47	0.3	0	30.7
21/05/2024 18:00	14.15	0.84	453655	38.37	0.1	0	30.8
21/05/2024 19:00	14.15	0.95	453502.5	38.41	0.3	0	31.1
21/05/2024 20:00	14.14	1.12	451178.7	38.14	0.3	0	31.1
21/05/2024 21:00	14.13	1.06	445208.1	37.49	0.4	0	31.2
21/05/2024 22:00	14.15	1.15	452642.8	38.23	0.3	0	30.8
21/05/2024 23:00	14.14	1.25	448030.5	37.81	0.2	0	31
21/05/2024 24:00	14.13	1.33	444880.9	37.46	0.2	0	31.2
Minimum	14.07	0.78	380411.5	27	0.1	0	29.6
MinDate	05/21/2024 2:00:00	05/21/2024 7:00:00	05/21/2024 13:00:00	05/21/2024 13:00:00	05/21/2024 13:00:00	05/21/2024 1:00:00	05/21/2024 12:00:00
Maximum	14.39	1.33	454674.8	38.47	0.5	0	42.1
MaxDate	05/21/2024 13:00:00	05/21/2024 11:00:00	05/21/2024 17:00:00	05/21/2024 17:00:00	05/21/2024 1:00:00	05/21/2024 1:00:00	05/21/2024 13:00:00
Avg	14.16	1.05	426295.3	34.76	0.3	0	32.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	27402.5	3.7	0.1	0	2.5
Site ABPR52 Daily: 21/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
21/05/2024 01:00	14.42	0.41	395232.3	30.89	0	0	28.6
21/05/2024 02:00	14.32	0.43	407070.5	32.91	0	0	27.2
21/05/2024 03:00	14.32	0.46	406695.8	32.87	0	0	27.5
21/05/2024 04:00	14.35	0.45	400784.4	31.95	0	0	28.8
21/05/2024 05:00	14.4	0.57	393022.4	30.71	0	0	28.6
21/05/2024 06:00	14.4	0.46	392928.2	30.8	0	0	28.9
21/05/2024 07:00	14.4	0.48	392870.1	30.73	0	0	29
21/05/2024 08:00	14.42	0.57	391140.5	30.48	0	0	29.1
21/05/2024 09:00	14.42	0.5	392810.7	30.74	0	0	29.3
21/05/2024 10:00	14.49	0.68	434138.5	35.43	0	0	29.7
21/05/2024 11:00	14.44	0.58	451743.9	37.96	0	0	27
21/05/2024 12:00	14.42	0.5	453350	38.13	0	0	26.8
21/05/2024 13:00	14.6	0.42	377126.8	26.95	0	0	37.1
21/05/2024 14:00	14.44	0.62	430827.9	34.29	0	0	32.9
21/05/2024 15:00	14.43	0.49	454107.8	38.08	0	0	27.7
21/05/2024 16:00	14.43	0.25	456249.1	38.4	0	0	27.5
21/05/2024 17:00	14.38	0.1	456184.5	38.57	0	0	27.7



21/05/2024 18:00	14.35	0.52	455176.3	38.46	0	0	27.3
21/05/2024 19:00	14.37	0.47	455884.8	38.52	0	0	27.6
21/05/2024 20:00	14.37	0.51	453102.3	38.22	0	0	27.7
21/05/2024 21:00	14.36	0.4	446490.6	37.58	0	0	28
21/05/2024 22:00	14.38	0.43	453351.6	38.32	0	0	27.6
21/05/2024 23:00	14.37	0.74	448628.5	37.89	0	0	27.7
21/05/2024 24:00	14.34	1.06	445820.8	37.55	0	0	27.9
Minimum	14.32	0.1	377126.8	26.95	0	0	26.8
MinDate	05/21/2024 2:00:00	05/21/2024 17:00:00	05/21/2024 13:00:00	05/21/2024 13:00:00	05/21/2024 1:00:00	05/21/2024 1:00:00	05/21/2024 12:00:00
Maximum	14.6	1.06	456249.1	38.57	0	0	37.1
MaxDate	05/21/2024 13:00:00		05/21/2024 16:00:00	05/21/2024 17:00:00	05/21/2024 1:00:00	05/21/2024 1:00:00	05/21/2024 13:00:00
Avg	14.4	0.5	426864.1	34.85	0	0	28.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	28702.5	3.7	0	0	2.2

Site ABPR51 Daily: 22/05/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
22/05/2024 01:00	14.23	1.09	384896.2	29.11	0.2	0	35.5
22/05/2024 02:00	14.16	1.26	393351.3	30.73	0.2	0	34.1
22/05/2024 03:00	14.16	1.08	393627.4	30.73	0.3	0	33.8
22/05/2024 04:00	14.16	0.71	393384.1	30.66	0.3	0	33.9
22/05/2024 05:00	14.21	0.78	386543.2	29.57	0.3	0	33
22/05/2024 06:00	14.19	0.71	389322.1	30.07	0.2	0	33.6
22/05/2024 07:00	14.17	1.03	392459.1	30.5	0.4	0	33.8
22/05/2024 08:00	14.17	0.93	391996.9	30.46	0.5	0	33.3
22/05/2024 09:00	14.19	0.54	390838.2	30.23	0.5	0	32.7
22/05/2024 10:00	14.21	1.15	430151.5	34.98	0.3	0	32.8
22/05/2024 11:00	14.14	1.17	446436.6	37.5	0.3	0	30.3
22/05/2024 12:00	14.13	0.95	446528	37.53	0.3	0	30.1
22/05/2024 13:00	14.39	0.78	379828.5	27.15	0.2	0	43.3
22/05/2024 14:00	14.26	0.86	427096.8	34.29	0.2	0	34.6
22/05/2024 15:00	14.14	0.97	447839.3	37.65	0.2	0	29.9
22/05/2024 16:00	14.15	0.95	451128.4	37.96	0.2	0	29.8
22/05/2024 17:00	14.16	0.97	456800.8	38.51	0.2	0	29.8
22/05/2024 18:00	14.16	0.92	457359.8	38.57	0.2	0	30.1
22/05/2024 19:00	14.16	0.85	454835.1	38.3	0.1	0	30.5
22/05/2024 20:00	14.15	1.03	454249.6	38.32	0.2	0	30.4
22/05/2024 21:00	14.15	0.93	453956.6	38.31	0.2	0	30.4
22/05/2024 22:00	14.15	0.96	454558.7	38.39	0.3	0	30.5
22/05/2024 23:00	14.14	1.03	452362.3	38.19	0.4	0	30.3
22/05/2024 24:00	14.15	1.24	452070.2	38.15	0.3	0	30.1
Minimum	14.13	0.54	379828.5	27.15	0.1	0	29.8
MinDate	05/22/2024 12:00:00	05/22/2024 9:00:00	05/22/2024 13:00:00	05/22/2024 13:00:00	05/22/2024 19:00:00	05/22/2024 1:00:00	05/22/2024 16:00:00
Maximum	14.39	1.26	457359.8	38.57	0.5	0	43.3
MaxDate	05/22/2024 13:00:00	05/22/2024 2:00:00	05/22/2024 18:00:00	05/22/2024 18:00:00	05/22/2024 8:00:00	05/22/2024 1:00:00	05/22/2024 13:00:00
Avg	14.18	0.95	424234.2	34.41	0.3	0	32.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	30817	4.1	0.1	0	3

Site ABPR52 Daily: 22/05/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
22/05/2024 01:00	14.45	0.86	383346.1	29.13	0	0	30.7
22/05/2024 02:00	14.38	0.65	393243.6	30.81	0	0	29.4
22/05/2024 03:00	14.37	0.55	392493.9	30.8	0	0	29.3
22/05/2024 04:00	14.39	0.44	392235	30.74	0	0	29
22/05/2024 05:00	14.43	0.49	385182.2	29.63	0	0	27.8
22/05/2024 06:00	14.42	0.38	388290.1	30.14	0	0	28.5
22/05/2024 07:00	14.41	0.41	391147.3	30.58	0	0	28.9
22/05/2024 08:00	14.42	0.55	391496.1	30.54	0	0	28.6
22/05/2024 09:00	14.47	0.61	390252.4	30.3	0	0	28.2
22/05/2024 10:00	14.54	0.68	430540.9	34.95	0	0	29.1
22/05/2024 11:00	14.47	0.66	448470.7	37.58	0	0	27.4
22/05/2024 12:00	14.43	0.53	448461.9	37.61	0	0	27.3
22/05/2024 13:00	14.63	0.48	379309.7	27.23	0	0	37.9
22/05/2024 14:00	14.54	0.46	428392.3	34.34	0	0	30.8
22/05/2024 15:00	14.43	0.44	450508.1	37.75	0	0	27.3
22/05/2024 16:00	14.46	0.45	454361.5	38.01	0	0	27.5
22/05/2024 17:00	14.47	0.47	460132.7	38.58	0	0	27.5
22/05/2024 18:00	14.46	0.38	460725.8	38.66	0	0	27.5
22/05/2024 19:00	14.42	0.39	457331.5	38.44	0	0	27.7
22/05/2024 20:00	14.41	0.51	456198.2	38.47	0	0	27.4
22/05/2024 21:00	14.4	0.44	456292.5	38.49	0	0	27.3
22/05/2024 22:00	14.4	0.51	456730.7	38.51	0	0	27.3
22/05/2024 23:00	14.4	0.58	454512.1	38.31	0	0	27.2
22/05/2024 24:00	14.4	0.61	453177.8	38.16	0	0	27
Minimum	14.37	0.38	379309.7	27.23	0	0	27
MinDate	05/22/2024 3:00:00	05/22/2024 6:00:00	05/22/2024 13:00:00	05/22/2024 13:00:00	05/22/2024 1:00:00	05/22/2024 1:00:00	
Maximum	14.63	0.86	460725.8	38.66	0	0	37.9
MaxDate	05/22/2024 13:00:00	05/22/2024 1:00:00	05/22/2024 18:00:00	05/22/2024 18:00:00	05/22/2024 1:00:00	05/22/2024 1:00:00	05/22/2024 13:00:00
Avg	14.44	0.52	425118	34.49	0	0	28.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	32441.9	4.1	0	0	2.3

Site ABPR51 Daily: 23/05/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
23/05/2024 01:00	14.19	1.13	390968.8	30.16	0.3	0	34.3
23/05/2024 02:00	14.15	0.82	399468.6	31.56	0.2	0	33.6
23/05/2024 03:00	14.15	1	396172.5	31.32	0.1	0	35.1
23/05/2024 04:00	14.16	1.07	392707.8	30.66	0.1	0	34.6
23/05/2024 05:00	14.19	1.23	390360.3	30.1	0.1	0	33.8
23/05/2024 06:00	14.17	0.7	391632.7	30.37	0.1	0	34.1
23/05/2024 07:00	14.18	1.08	392689.8	30.53	0.1	0	34.6
23/05/2024 08:00	14.17	1.07	393137.7	30.6	0.2	0	34.4
23/05/2024 09:00	14.17	0.94	393793.6	30.74	0.2	0	34.1
23/05/2024 10:00	14.21	1.15	433005.5	35.34	0.2	0	32.9
23/05/2024 11:00	14.14	1.21	449276.6	37.78	0.2	0	30
23/05/2024 12:00	14.15	1.27	457669.7	38.57	0.2	0	29.6
23/05/2024 13:00	14.37	0.95	385191.7	28.04	0.1	0	39.5
23/05/2024 14:00	14.24	0.91	440525.5	35.96	0	0	32.4
23/05/2024 15:00	14.17	1.12	469864	39.94	0.1	0	29.9
23/05/2024 16:00	14.15	0.96	454777.9	38.38	0.2	0	30



23/05/2024 17:00	14.17	1.18	463358.6	39.25	0.2	0	29.5
23/05/2024 18:00	14.17	1.17	468011.5	39.67	0.1	0	29.3
23/05/2024 19:00	14.17	1.18	470814.9	39.95	0.2	0	29.3
23/05/2024 20:00	14.19	1.31	472440.3	40.15	0.2	0	29.6
23/05/2024 21:00	14.16	1.05	464662.7	39.39	0.2	0	30
23/05/2024 22:00	14.21	1.14	476323.1	40.65	0.2	0	30.3
23/05/2024 23:00	14.2	1.05	478396.8	40.81	0.2	0	30
23/05/2024 24:00	14.18	0.85	467513.2	39.71	0.1	0	30.4
Minimum	14.14	0.7	385191.7	28.04	0	0	29.3
MinDate	05/23/2024 11:00:00	05/23/2024 6:00:00	05/23/2024 13:00:00	05/23/2024 13:00:00	05/23/2024 14:00:00	05/23/2024 1:00:00	05/23/2024 18:00:00
Maximum	14.37	1.31	478396.8	40.81	0.3	0	39.5
MaxDate	05/23/2024 13:00:00	05/23/2024 20:00:00	05/23/2024 23:00:00	05/23/2024 23:00:00	05/23/2024 1:00:00	05/23/2024 1:00:00	05/23/2024 13:00:00
Avg	14.18	1.06	433031.8	35.4	0.2	0	32.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	36394.4	4.5	0.1	0	2.7
Site ABPR52 Daily: 23/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
23/05/2024 01:00	14.45	0.6	390255.3	30.23	0	0	29.9
23/05/2024 02:00	14.41	0.41	398759.6	31.64	0	0	29.5
23/05/2024 03:00	14.41	0.47	395851	31.39	0	0	30.6
23/05/2024 04:00	14.41	0.61	392015.4	30.74	0	0	29.8
23/05/2024 05:00	14.38	0.7	388321.2	30.17	0	0	28.9
23/05/2024 06:00	14.36	0.51	390559.7	30.45	0	0	29.1
23/05/2024 07:00	14.36	0.82	391141.3	30.62	0	0	29.5
23/05/2024 08:00	14.36	0.41	391858.2	30.68	0	0	29.4
23/05/2024 09:00	14.4	0.4	392776.8	30.82	0	0	29.3
23/05/2024 10:00	14.46	0.45	433264.1	35.41	0	0	29
23/05/2024 11:00	14.45	0.42	450839.8	37.86	0	0	27
23/05/2024 12:00	14.47	0.43	459882.5	38.67	0	0	27
23/05/2024 13:00	14.64	0.39	383597.8	28.13	0	0	34.1
23/05/2024 14:00	14.49	0.31	441934.9	36.06	0	0	28
23/05/2024 15:00	14.41	0.57	471895.7	40.03	0	0	26.7
23/05/2024 16:00	14.4	0.46	456774.6	38.46	0	0	26.9
23/05/2024 17:00	14.45	0.39	466227.5	39.34	0	0	26.6
23/05/2024 18:00	14.42	0.33	469734.3	39.75	0	0	26.4
23/05/2024 19:00	14.41	0.36	472452.6	40.07	0	0	26.3
23/05/2024 20:00	14.41	0.27	474339.8	40.26	0	0	26.5
23/05/2024 21:00	14.39	0.27	467062.8	39.61	0	0	26.8
23/05/2024 22:00	14.41	0.23	480115.5	40.98	0	0	27
23/05/2024 23:00	14.4	0.25	482212.5	41.17	0	0	27
23/05/2024 24:00	14.39	0.26	470014.7	39.9	0	0	27
Minimum	14.36	0.23	383597.8	28.13	0	0	26.3
MinDate	05/23/2024 6:00:00	05/23/2024 22:00:00	05/23/2024 13:00:00	05/23/2024 13:00:00	05/23/2024 1:00:00	05/23/2024 1:00:00	05/23/2024 19:00:00
Maximum	14.64	0.82	482212.5	41.17	0	0	34.1
MaxDate	05/23/2024 13:00:00	05/23/2024 7:00:00	05/23/2024 23:00:00	05/23/2024 23:00:00	05/23/2024 1:00:00	05/23/2024 1:00:00	05/23/2024 13:00:00
Avg	14.42	0.43	433828.6	35.52	0	0	28.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	38126.6	4.6	0	0	1.9
Site ABPR51 Daily: 24/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
24/05/2024 01:00	14.12	0.93	404720.5	32.43	0.1	0	34.3
24/05/2024 02:00	14.08	0.73	413334.8	33.81	0.1	0	32.4
24/05/2024 03:00	14.08	0.62	415385.3	34.07	0.1	0	32.3
24/05/2024 04:00	14.09	0.84	410906.8	33.57	0.2	0	33.5
24/05/2024 05:00	14.09	1.05	410305.6	33.43	0.2	0	33.6
24/05/2024 06:00	14.08	1.17	410036.8	33.42	0.3	0	33.6
24/05/2024 07:00	14.09	1.08	409265.7	33.39	0	0	34.6
24/05/2024 08:00	14.09	1.35	412054.6	33.78	0.1	0	34
24/05/2024 09:00	14.09	1.08	412670.9	33.72	0.2	0	33.6
24/05/2024 10:00	14.23	1.02	450820.2	37.39	0.2	0	32.2
24/05/2024 11:00	14.2	1.2	472139.3	40.15	0.2	0	30.7
24/05/2024 12:00	14.2	1.15	469064.2	39.83	0.2	0	30.2
24/05/2024 13:00	14.37	1.03	391726.7	28.93	0.2	0	38.9
24/05/2024 14:00	14.31	1.25	442225.6	36.03	0.3	0	32.4
24/05/2024 15:00	14.26	1.23	473235.1	40.04	0.2	0	29.8
24/05/2024 16:00	14.22	1.17	470660.6	39.82	0.1	0	29.8
24/05/2024 17:00	14.22	1.21	481340.1	40.91	0.1	0	29.2
24/05/2024 18:00	14.21	1.23	476428.1	40.5	0.1	0	29.7
24/05/2024 19:00	14.21	1.16	479184.6	40.85	0.1	0	29.8
24/05/2024 20:00	14.2	1.12	475935.2	40.48	0.2	0	29.9
24/05/2024 21:00	14.2	1.13	474371.9	40.32	0.3	0	30.1
24/05/2024 22:00	14.19	1.17	472431.9	40.15	0.3	0	30.2
24/05/2024 23:00	14.2	1.19	476054.3	40.52	0.3	0	30
24/05/2024 24:00	14.2	1.4	478436.8	40.76	0.3	0	29.8
Minimum	14.08	0.62	391726.7	28.93	0	0	29.2
MinDate	05/24/2024 2:00:00	05/24/2024 3:00:00	05/24/2024 13:00:00	05/24/2024 13:00:00	05/24/2024 7:00:00	05/24/2024 1:00:00	05/24/2024 17:00:00
Maximum	14.37	1.4	481340.1	40.91	0.3	0	38.9
MaxDate	05/24/2024 13:00:00	05/24/2024 17:00:00	05/24/2024 17:00:00	05/24/2024 17:00:00	05/24/2024 6:00:00	05/24/2024 1:00:00	05/24/2024 13:00:00
Avg	14.18	1.1	445114	37.01	0.2	0	31.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	32491.5	3.7	0.1	0	2.3
Site ABPR52 Daily: 24/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
24/05/2024 01:00	14.34	0.3	405616.8	32.71	0	0	29.7
24/05/2024 02:00	14.3	0.3	413435.8	33.87	0	0	28.3
24/05/2024 03:00	14.31	0.3	415473.2	34.16	0	0	28.2
24/05/2024 04:00	14.32	0.32	411264.3	33.65	0	0	29
24/05/2024 05:00	14.33	0.43	410310.8	33.51	0	0	29.2
24/05/2024 06:00	14.33	0.47	410254.2	33.5	0	0	29.2
24/05/2024 07:00	14.32	0.54	409330.2	33.45	0	0	30
24/05/2024 08:00	14.29	1.43	412690.7	33.86	0	0	29.2
24/05/2024 09:00	14.3	0.85	413184.9	33.8	0	0	29.4
24/05/2024 10:00	14.45	0.55	452387.6	37.47	0	0	28.1
24/05/2024 11:00	14.46	0.6	474403.8	40.24	0	0	27.5
24/05/2024 12:00	14.46	0.68	472049.3	39.92	0	0	27.2
24/05/2024 13:00	14.69	0.76	390797.7	28.92	0	0	34.1
24/05/2024 14:00	14.68	0.72	446260.8	36.18	0	0	28.8
24/05/2024 15:00	14.66	0.56	478771.8	40.16	0	0	28.3



24/05/2024 16:00	14.6	0.67	474953.5	39.91	0	0	28
24/05/2024 17:00	14.54	0.46	484680.1	41	0	0	27.4
24/05/2024 18:00	14.48	0.47	478993.4	40.6	0	0	27.3
24/05/2024 19:00	14.45	0.5	481973	40.94	0	0	27.3
24/05/2024 20:00	14.43	0.41	478439.3	40.56	0	0	27.1
24/05/2024 21:00	14.43	0.42	476369.3	40.43	0	0	27.3
24/05/2024 22:00	14.44	0.46	474988.4	40.25	0	0	27.3
24/05/2024 23:00	14.45	0.46	478335.4	40.61	0	0	27.2
24/05/2024 24:00	14.44	0.45	480394.1	40.88	0	0	26.9
Minimum	14.29	0.3	390797.7	28.92	0	0	26.9
MinDate	05/24/2024 8:00:00	05/24/2024 1:00:00	05/24/2024 13:00:00	05/24/2024 13:00:00	05/24/2024 1:00:00	05/24/2024 1:00:00	
Maximum	14.69	1.43	484680.1	41	0	0	34.1
MaxDate	05/24/2024 13:00:00	05/24/2024 8:00:00	05/24/2024 17:00:00	05/24/2024 17:00:00	05/24/2024 1:00:00	05/24/2024 1:00:00	05/24/2024 13:00:00
Avg	14.44	0.55	446889.9	37.11	0	0	28.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	33816.4	3.7	0	0	1.5
Site ABPR51 Daily: 25/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
25/05/2024 01:00	14.11	1.07	409111.3	33	0.2	0	32.8
25/05/2024 02:00	14.09	1.12	425782.7	35.27	0.3	0	30.8
25/05/2024 03:00	14.08	1.02	423624.6	35.02	0.3	0	30.9
25/05/2024 04:00	14.08	1.14	418813.4	34.49	0.4	0	31
25/05/2024 05:00	14.07	1.49	411219.3	33.52	0.3	0	32.1
25/05/2024 06:00	14.08	1.19	409848.2	33.3	0.3	0	32.2
25/05/2024 07:00	14.07	0.96	410673.2	33.41	0.3	0	32
25/05/2024 08:00	14.09	1.1	406544.4	32.8	0.2	0	33
25/05/2024 09:00	14.13	0.94	403311.8	32.21	0.2	0	32.7
25/05/2024 10:00	14.21	0.8	440463.7	36.17	0.1	0	30.4
25/05/2024 11:00	14.18	1.04	463778.6	39.15	0.2	0	29
25/05/2024 12:00	14.19	1.04	466602.8	39.4	0.1	0	28.8
25/05/2024 13:00	14.35	0.89	391564.9	28.98	0.1	0	35.8
25/05/2024 14:00	14.21	0.9	430203.7	35.23	0	0	32.8
25/05/2024 15:00	14.15	1.17	452707	38.32	0.2	0	30.8
25/05/2024 16:00	14.17	1.26	463830.5	39.33	0.3	0	30.1
25/05/2024 17:00	14.18	1.37	467961.9	39.62	0.4	0	29.1
25/05/2024 18:00	14.19	1.12	469534.4	39.84	0.2	0	28.9
25/05/2024 19:00	14.2	1.16	472477.4	40.22	0.1	0	29.9
25/05/2024 20:00	14.17	1.23	467216.2	39.66	0.1	0	29.9
25/05/2024 21:00	14.19	1.14	473147.6	40.25	0.2	0	29.6
25/05/2024 22:00	14.19	1.2	467997.2	39.81	0.1	0	30.7
25/05/2024 23:00	14.18	1.28	467907.2	39.8	0.1	0	30.6
25/05/2024 24:00	14.18	1.38	466435.4	39.67	0.1	0	30.6
Minimum	14.07	0.8	391564.9	28.98	0	0	28.8
MinDate	05/25/2024 5:00:00	05/25/2024 10:00:00	05/25/2024 13:00:00	05/25/2024 13:00:00	05/25/2024 14:00:00	05/25/2024 1:00:00	05/25/2024 12:00:00
Maximum	14.35	1.49	473147.6	40.25	0.4	0	35.8
MaxDate	05/25/2024 13:00:00	05/25/2024 5:00:00	05/25/2024 21:00:00	05/25/2024 21:00:00	05/25/2024 4:00:00	05/25/2024 1:00:00	05/25/2024 13:00:00
Avg	14.16	1.13	440864.9	36.6	0.2	0	31
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	28108.9	3.3	0.1	0	1.7
Site ABPR52 Daily: 25/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
25/05/2024 01:00	14.37	0.4	409647.4	33.08	0	0	28.7
25/05/2024 02:00	14.34	0.62	426139.5	35.35	0	0	27.6
25/05/2024 03:00	14.35	0.58	423537.1	35.11	0	0	27.6
25/05/2024 04:00	14.34	0.68	419112.5	34.56	0	0	27.5
25/05/2024 05:00	14.33	0.52	410874.5	33.59	0	0	27.8
25/05/2024 06:00	14.32	0.42	409143.4	33.38	0	0	28
25/05/2024 07:00	14.3	0.52	410846.5	33.49	0	0	27.8
25/05/2024 08:00	14.36	0.67	406842.3	32.87	0	0	28.6
25/05/2024 09:00	14.46	0.66	403799	32.28	0	0	28.9
25/05/2024 10:00	14.51	0.58	442582.6	36.24	0	0	27.1
25/05/2024 11:00	14.47	0.59	466805.3	39.23	0	0	26.6
25/05/2024 12:00	14.51	0.46	469797.5	39.49	0	0	26.7
25/05/2024 13:00	14.65	0.48	391773.9	29.09	0	0	29.6
25/05/2024 14:00	14.45	0.53	431301.7	35.29	0	0	28.4
25/05/2024 15:00	14.4	0.59	454051.1	38.41	0	0	27.3
25/05/2024 16:00	14.42	0.54	464256.3	39.42	0	0	26.4
25/05/2024 17:00	14.44	0.82	468214.6	39.71	0	0	25.7
25/05/2024 18:00	14.45	0.49	470534.9	39.94	0	0	25.5
25/05/2024 19:00	14.44	0.46	473288	40.32	0	0	26.3
25/05/2024 20:00	14.43	0.66	469057.2	39.76	0	0	26.7
25/05/2024 21:00	14.42	0.58	474582.6	40.33	0	0	26.4
25/05/2024 22:00	14.42	0.48	470449.2	39.9	0	0	27.5
25/05/2024 23:00	14.4	0.7	469777.8	39.9	0	0	27.2
25/05/2024 24:00	14.39	0.55	468360.1	39.77	0	0	27.2
Minimum	14.3	0.4	391773.9	29.09	0	0	25.5
MinDate	05/25/2024 7:00:00	05/25/2024 1:00:00	05/25/2024 13:00:00	05/25/2024 13:00:00	05/25/2024 1:00:00	05/25/2024 1:00:00	05/25/2024 18:00:00
Maximum	14.65	0.82	474582.6	40.33	0	0	29.6
MaxDate	05/25/2024 13:00:00	05/25/2024 17:00:00	05/25/2024 21:00:00	05/25/2024 21:00:00	05/25/2024 1:00:00	05/25/2024 1:00:00	05/25/2024 13:00:00
Avg	14.42	0.57	441865.6	36.69	0	0	27.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	28811.8	3.3	0	0	1
Site ABPR51 Daily: 26/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
26/05/2024 01:00	Shutdown	0.93	Shutdown	3.83	Shutdown	Shutdown	Shutdown
26/05/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 04:00	Shutdown	0.27	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 05:00	Shutdown	0.7	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 09:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 10:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
26/05/2024 11:00	Shutdown	1.66	Shutdown	5.72	Shutdown	Shutdown	Shutdown
26/05/2024 12:00	14.44	0.89	441730.1	34.75	0.3	0	37.3
26/05/2024 13:00	14.43	1.02	507729.4	42.96	0.2	0	34
26/05/2024 14:00	14.41	1.1	506058.7	42.94	0.2	0	33.9







27/05/2024 14:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
27/05/2024 15:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
27/05/2024 16:00	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp
27/05/2024 17:00	14.53	0.73	440891.6	36.38	0	0	29.4
27/05/2024 18:00	14.54	0.69	440726.6	36.38	0	0	29.4
27/05/2024 19:00	14.48	0.34	440287.2	36.58	0	0	28.1
27/05/2024 20:00	14.41	0.45	439071.4	36.5	0	0	27.7
27/05/2024 21:00	14.39	0.56	435079.6	36.15	0	0	27.6
27/05/2024 22:00	14.39	0.54	436191.7	36.31	0	0	27.5
27/05/2024 23:00	14.38	0.58	437476.7	36.48	0	0	27.2
27/05/2024 24:00	14.38	0.59	436922	36.4	0	0	27.1
Minimum	14.38	0	430102.2	0	0	0	27.1
MinDate	05/27/2024 23:00:00	05/27/2024 7:00:00	05/27/2024 10:00:00	05/27/2024 6:00:00	05/27/2024 10:00:00	05/27/2024 10:00:00	
Maximum	14.58	2.67	440891.6	36.58	0	0	30.4
MaxDate	05/27/2024 11:00:00	05/27/2024 6:00:00	05/27/2024 17:00:00	05/27/2024 19:00:00	05/27/2024 10:00:00	05/27/2024 10:00:00	05/27/2024 10:00:00
Avg	14.46	0.71	437229.5	30.11	0	0	28.3
Num	10	12	10	12	10	10	10
Data[%]	42	50	42	50	42	42	42
STD	0.1	0.6	3294.5	14.1	0	0	1.1
Site ABPR51 Daily: 28/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
28/05/2024 01:00	14.2	0.92	391483.9	30.21	0.2	0	33.9
28/05/2024 02:00	14.09	0.93	405897.6	32.78	0.3	0	32.6
28/05/2024 03:00	14.09	0.92	406801.3	32.89	0.2	0	32.3
28/05/2024 04:00	14.13	0.9	399642.8	31.72	0.3	0	32.9
28/05/2024 05:00	14.16	0.89	393855.4	30.85	0.3	0	33
28/05/2024 06:00	14.16	0.9	396303.4	31.24	0.3	0	33.3
28/05/2024 07:00	14.15	0.87	396759.8	31.32	0.3	0	33.6
28/05/2024 08:00	14.16	0.71	397171.6	31.35	0.3	0	33.1
28/05/2024 09:00	14.17	0.65	396731.9	31.29	0.2	0	33.2
28/05/2024 10:00	14.28	0.69	423959.5	34.18	0.3	0	33.4
28/05/2024 11:00	14.22	0.66	438701.7	36.64	0.3	0	30.5
28/05/2024 12:00	14.22	0.82	440002	36.74	0.3	0	30.1
28/05/2024 13:00	14.45	0.69	375606	26.69	0.2	0	43.9
28/05/2024 14:00	14.3	0.75	466645.8	38.91	0.4	0	42.9
28/05/2024 15:00	14.19	0.99	514810.5	45.25	0.5	0	43.5
28/05/2024 16:00	14.27	0.93	458922	38.13	0.4	0	40.3
28/05/2024 17:00	14.36	0.78	389122.1	29.39	0.3	0	36.3
28/05/2024 18:00	14.32	0.83	404783.2	31.57	0.3	0	35.5
28/05/2024 19:00	14.27	0.89	460644.8	38.54	0.3	0	31.2
28/05/2024 20:00	14.23	0.99	463571.1	39.06	0.3	0	30.9
28/05/2024 21:00	14.21	0.97	460254.2	38.77	0.3	0	30.8
28/05/2024 22:00	14.21	0.97	460958	38.88	0.3	0	30.5
28/05/2024 23:00	14.21	0.98	465297.6	39.33	0.3	0	30.3
28/05/2024 24:00	14.21	1.01	464730.6	39.28	0.2	0	30.1
Minimum	14.09	0.65	375606	26.69	0.2	0	30.1
MinDate	05/28/2024 2:00:00	05/28/2024 9:00:00	05/28/2024 13:00:00	05/28/2024 13:00:00	05/28/2024 1:00:00	05/28/2024 1:00:00	05/28/2024 12:00:00
Maximum	14.45	1.01	514810.5	45.25	0.5	0	43.9
MaxDate	05/28/2024 13:00:00		05/28/2024 15:00:00	05/28/2024 15:00:00	05/28/2024 15:00:00	05/28/2024 1:00:00	05/28/2024 13:00:00
Avg	14.22	0.86	428027.4	34.79	0.3	0	34.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	36358.2	4.5	0.1	0	4.3
Site ABPR52 Daily: 28/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
28/05/2024 01:00	14.45	0.61	391063.2	30.29	0	0	29.6
28/05/2024 02:00	14.34	0.66	406164.6	32.86	0	0	28.3
28/05/2024 03:00	14.34	0.52	406934.6	32.97	0	0	28.1
28/05/2024 04:00	14.37	0.42	399228.1	31.8	0	0	28.5
28/05/2024 05:00	14.43	0.42	394283.2	30.92	0	0	28.2
28/05/2024 06:00	14.4	0.38	396530.9	31.32	0	0	28.7
28/05/2024 07:00	14.4	0.44	397194.9	31.39	0	0	28.8
28/05/2024 08:00	14.42	0.56	397413.6	31.43	0	0	28.5
28/05/2024 09:00	14.52	0.57	397560.1	31.36	0	0	28.5
28/05/2024 10:00	14.64	0.63	424078.2	34.26	0	0	29
28/05/2024 11:00	14.6	0.52	439529.8	36.73	0	0	26.8
28/05/2024 12:00	14.59	0.63	440331.4	36.84	0	0	26.6
28/05/2024 13:00	14.78	0.6	373793.7	26.8	0	0	38.7
28/05/2024 14:00	14.64	0.44	392729.2	30.2	0	0	31.3
28/05/2024 15:00	14.55	0.67	391954.1	30.45	0	0	27.9
28/05/2024 16:00	14.47	0.75	451090.1	37.62	0	0	31.8
28/05/2024 17:00	14.44	0.81	519668	45.81	0	0	40.1
28/05/2024 18:00	14.48	0.77	507312.6	44.37	0	0	38.2
28/05/2024 19:00	14.53	0.37	460665.5	38.63	0	0	27.2
28/05/2024 20:00	14.44	0.32	464517.1	39.1	0	0	26.8
28/05/2024 21:00	14.41	0.52	461262.6	38.85	0	0	26.6
28/05/2024 22:00	14.4	0.59	462728	38.96	0	0	26.4
28/05/2024 23:00	14.41	0.62	466569.3	39.47	0	0	26.3
28/05/2024 24:00	14.42	0.61	465931	39.35	0	0	26.1
Minimum	14.34	0.32	373793.7	26.8	0	0	26.1
MinDate	05/28/2024 2:00:00	05/28/2024 20:00:00	05/28/2024 13:00:00	05/28/2024 13:00:00	05/28/2024 1:00:00	05/28/2024 1:00:00	
Maximum	14.78	0.81	519668	45.81	0	0	40.1
MaxDate	05/28/2024 13:00:00	05/28/2024 17:00:00	05/28/2024 17:00:00	05/28/2024 17:00:00	05/28/2024 1:00:00	05/28/2024 1:00:00	05/28/2024 17:00:00
Avg	14.48	0.56	429522.3	35.07	0	0	29.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	39914.6	4.8	0	0	4
Site ABPR51 Daily: 29/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
29/05/2024 01:00	14.14	0.92	412039.5	33.3	0.2	0	32.3
29/05/2024 02:00	14.12	0.93	428445.7	35.44	0.3	0	30.8
29/05/2024 03:00	14.15	0.92	429182.4	35.52	0.3	0	31.2
29/05/2024 04:00	14.15	0.89	415103.3	33.82	0.4	0	32.5
29/05/2024 05:00	14.16	0.9	408392.8	32.95	0.3	0	33.5
29/05/2024 06:00	14.15	0.91	411203.8	33.39	0.4	0	33.2
29/05/2024 07:00	14.17	0.88	404999.8	32.49	0.4	0	33.9
29/05/2024 08:00	14.16	0.81	405471.6	32.53	0.4	0	33.5
29/05/2024 09:00	14.21	0.62	406232	32.45	0.3	0	34.3
29/05/2024 10:00	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp
29/05/2024 11:00	14.26	0.78	435392	35.96	0.4	0	32.9
29/05/2024 12:00	14.16	0.84	433017.6	35.98	0.3	0	31







30/05/2024 12:00	14.54	0.53	453847	38.26	0	0	26.4
30/05/2024 13:00	14.69	0.79	381452.1	27.92	0	0	35.3
30/05/2024 14:00	14.58	0.63	434180.3	35.08	0	0	30.1
30/05/2024 15:00	14.47	0.66	456498.8	38.41	0	0	26.1
30/05/2024 16:00	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp
30/05/2024 17:00	14.47	0.61	457534.6	38.55	0	0	25.3
30/05/2024 18:00	14.43	0.4	458731.3	38.68	0	0	25.7
30/05/2024 19:00	14.38	0.33	462119.3	39.04	0	0	25.3
30/05/2024 20:00	14.37	0.31	460067.1	38.91	0	0	25.4
30/05/2024 21:00	14.39	0.37	463566.3	39.19	0	0	25.8
30/05/2024 22:00	14.39	0.4	461367	39	0	0	25.6
30/05/2024 23:00	14.4	0.48	457487.3	38.61	0	0	25.4
30/05/2024 24:00	14.42	0.6	460902.7	38.95	0	0	25.5
Minimum	14.37	0.31	381452.1	27.92	0	0	25.3
MinDate	05/30/2024 20:00:00	05/30/2024 20:00:00	05/30/2024 13:00:00	05/30/2024 13:00:00	05/30/2024 12:00:00	05/30/2024 12:00:00	05/30/2024 17:00:00
Maximum	14.69	0.79	463566.3	39.19	0	0	35.3
MaxDate	05/30/2024 13:00:00	05/30/2024 13:00:00	05/30/2024 21:00:00	05/30/2024 21:00:00	05/30/2024 12:00:00	05/30/2024 12:00:00	05/30/2024 13:00:00
Avg	14.46	0.51	450646.1	37.55	0	0	26.8
Num	12	12	12	12	12	12	12
Data[%]	50	50	50	50	50	50	50
STD	0.1	0.2	23102.5	3.2	0	0	3
Site ABPR51 Daily: 31/05/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
31/05/2024 01:00	14.14	0.76	404585.5	32.41	0.4	0	33
31/05/2024 02:00	14.09	0.8	413583.1	33.84	0.4	0	31.2
31/05/2024 03:00	14.09	0.69	413877.6	33.88	0.4	0	31.1
31/05/2024 04:00	14.09	0.8	413823.4	33.84	0.5	0	31
31/05/2024 05:00	14.12	0.96	402135.5	32.09	0.5	0	33.2
31/05/2024 06:00	14.1	0.83	407362.8	33.11	0.5	0	32
31/05/2024 07:00	14.1	0.9	406948.3	32.91	0.4	0	32.4
31/05/2024 08:00	14.11	0.84	406574.4	32.86	0.4	0	32.5
31/05/2024 09:00	14.1	0.78	408936.5	33.29	0.3	0	32.2
31/05/2024 10:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
31/05/2024 11:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
31/05/2024 12:00	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp
31/05/2024 13:00	14.43	0.87	377621.4	26.95	0.2	0	42.5
31/05/2024 14:00	14.29	0.99	431994.3	34.85	0.3	0	33.6
31/05/2024 15:00	14.2	0.91	454444.8	38.24	0.4	0	29.5
31/05/2024 16:00	14.21	0.9	455982.2	38.36	0.4	0	29.5
31/05/2024 17:00	14.2	0.96	457226.2	38.54	0.3	0	29.5
31/05/2024 18:00	14.16	1.01	454028.3	38.3	0.3	0	29.5
31/05/2024 19:00	14.17	1	454282.3	38.37	0.3	0	29.5
31/05/2024 20:00	14.16	1.21	455185.1	38.53	0.2	0	29.8
31/05/2024 21:00	14.15	0.93	454710.8	38.43	0.3	0	29.3
31/05/2024 22:00	14.16	0.85	456061.3	38.64	0.4	0	29.4
31/05/2024 23:00	14.17	0.92	456012.6	38.58	0.3	0	29.7
31/05/2024 24:00	14.16	1.04	451523.6	38.06	0.4	0	29.8
Minimum	14.09	0.69	377621.4	26.95	0.2	0	29.3
MinDate	05/31/2024 2:00:00	05/31/2024 3:00:00	05/31/2024 13:00:00	05/31/2024 13:00:00	05/31/2024 13:00:00	05/31/2024 1:00:00	05/31/2024 21:00:00
Maximum	14.43	1.21	457226.2	38.64	0.5	0	42.5
MaxDate	05/31/2024 13:00:00	05/31/2024 20:00:00	05/31/2024 17:00:00	05/31/2024 22:00:00	05/31/2024 4:00:00	05/31/2024 1:00:00	05/31/2024 13:00:00
Avg	14.16	0.9	430328.6	35.43	0.4	0	31.4
Num	21	21	21	21	21	21	21
Data[%]	88	88	88	88	88	88	88
STD	0.1	0.1	25728.4	3.3	0.1	0	2.9
Site ABPR52 Daily: 31/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
31/05/2024 01:00	14.39	0.53	404675.9	32.5	0	0	28.5
31/05/2024 02:00	14.34	0.56	413670.1	33.9	0	0	26.8
31/05/2024 03:00	14.34	0.5	414217.3	33.95	0	0	26.6
31/05/2024 04:00	14.32	0.49	413824.9	33.91	0	0	26.5
31/05/2024 05:00	14.32	0.51	401255.8	32.17	0	0	28.3
31/05/2024 06:00	14.3	0.46	407908.9	33.19	0	0	27.2
31/05/2024 07:00	14.31	0.52	407210.7	32.99	0	0	27.7
31/05/2024 08:00	14.33	0.47	406334.8	32.93	0	0	27.7
31/05/2024 09:00	14.34	0.4	409581.5	33.37	0	0	27.5
31/05/2024 10:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
31/05/2024 11:00	NoData	NoData	NoData	NoData	NoData	NoData	NoData
31/05/2024 12:00	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp	<Samp
31/05/2024 13:00	14.7	0.83	374780.3	26.98	0	0	37.2
31/05/2024 14:00	14.56	0.71	431236	34.89	0	0	28.9
31/05/2024 15:00	14.48	0.61	455247.4	38.33	0	0	25.6
31/05/2024 16:00	14.48	0.59	456312.5	38.46	0	0	25.6
31/05/2024 17:00	14.43	0.38	457841.3	38.62	0	0	25.4
31/05/2024 18:00	14.37	0.28	455498.5	38.39	0	0	25.5
31/05/2024 19:00	14.37	0.31	456196	38.57	0	0	25.4
31/05/2024 20:00	14.36	1.03	457209	38.71	0	0	25.7
31/05/2024 21:00	14.38	0.79	457742.2	38.76	0	0	25.4
31/05/2024 22:00	14.4	0.59	459234.6	38.85	0	0	25.4
31/05/2024 23:00	14.41	0.63	457997.9	38.8	0	0	25.7
31/05/2024 24:00	14.38	0.8	451782.5	38.13	0	0	25.7
Minimum	14.3	0.28	374780.3	26.98	0	0	25.4
MinDate	05/31/2024 6:00:00	05/31/2024 18:00:00	05/31/2024 13:00:00	05/31/2024 13:00:00	05/31/2024 1:00:00	05/31/2024 1:00:00	05/31/2024 17:00:00
Maximum	14.7	1.03	459234.6	38.85	0	0	37.2
MaxDate	05/31/2024 13:00:00	05/31/2024 20:00:00	05/31/2024 22:00:00	05/31/2024 22:00:00	05/31/2024 1:00:00	05/31/2024 1:00:00	05/31/2024 13:00:00
Avg	14.4	0.57	430940.8	35.54	0	0	27.1
Num	21	21	21	21	21	21	21
Data[%]	88	88	88	88	88	88	88
STD	0.1	0.2	26763.7	3.3	0	0	2.6



Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8
Site ABPR51 Daily: 01/06/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
01/06/2024 01:00	14.14	1.18	403071.3	32.07	0.3	0	32.9
01/06/2024 02:00	14.09	0.6	414066.7	33.9	0.3	0	31.2
01/06/2024 03:00	14.09	0.76	421668.6	34.83	0.3	0	30.8
01/06/2024 04:00	14.1	0.89	415709.1	34.08	0.4	0	31.6
01/06/2024 05:00	14.1	0.84	407140.9	32.96	0.4	0	33
01/06/2024 06:00	14.11	0.67	406841.6	32.97	0.3	0	32.8
01/06/2024 07:00	14.12	0.88	403829.4	32.48	0.4	0	32.9
01/06/2024 08:00	14.19	0.73	392471.8	30.46	0.4	0	32.5
01/06/2024 09:00	14.31	0.84	388537.6	29.25	0.2	0	36.2
01/06/2024 10:00	14.1	1.02	419604.4	34.61	0.3	0	30.9
01/06/2024 11:00	14.11	0.97	423062.8	34.98	0.3	0	30.8
01/06/2024 12:00	14.13	1.01	425640.3	35.18	0.3	0	30.9
01/06/2024 13:00	14.63	1	346157.1	21.42	0.1	0	58.3
01/06/2024 14:00	14.16	1.01	425614.3	35.16	0.3	0	31.9
01/06/2024 15:00	14.13	1.02	421945.4	34.84	0.3	0	31.1
01/06/2024 16:00	14.15	1.01	428446.2	35.57	0.3	0	30.9
01/06/2024 17:00	14.15	1.01	429408.9	35.72	0.3	0	30.8
01/06/2024 18:00	14.13	1.02	426807.8	35.37	0.3	0	31.1
01/06/2024 19:00	14.13	1.01	427096.9	35.42	0.3	0	31.1
01/06/2024 20:00	14.12	0.94	428550.2	35.6	0.3	0	31
01/06/2024 21:00	14.11	0.96	427902.2	35.55	0.3	0	31
01/06/2024 22:00	14.1	0.99	426672.7	35.42	0.3	0	30.9
01/06/2024 23:00	14.09	1.03	425210.5	35.27	0.3	0	30.9
01/06/2024 24:00	14.17	1.01	409760.8	32.72	0.3	0	33.8
Minimum	14.09	0.6	346157.1	21.42	0.1	0	30.8
MinDate	06/01/2024 2:00:00	06/01/2024 2:00:00	06/01/2024 13:00:00	06/01/2024 13:00:00	06/01/2024 13:00:00	06/01/2024 1:00:00	06/01/2024 3:00:00
Maximum	14.63	1.18	429408.9	35.72	0.4	0	58.3
MaxDate	06/01/2024 13:00:00	06/01/2024 1:00:00	06/01/2024 17:00:00	06/01/2024 17:00:00	06/01/2024 4:00:00	06/01/2024 1:00:00	06/01/2024 13:00:00
Avg	14.15	0.93	414384.1	33.58	0.3	0	32.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	18685.7	3.1	0.1	0	5.6
Site ABPR52 Daily: 01/06/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
01/06/2024 01:00	14.33	0.63	402183.2	32.17	0	0	28
01/06/2024 02:00	14.28	0.89	413583.7	33.97	0	0	26.6
01/06/2024 03:00	14.28	1.7	421527	34.92	0	0	26.3
01/06/2024 04:00	14.3	1.4	415570	34.15	0	0	26.9
01/06/2024 05:00	14.32	0.93	407080	33.04	0	0	28
01/06/2024 06:00	14.33	0.96	406425.2	33.05	0	0	27.7
01/06/2024 07:00	14.34	0.78	403845.9	32.55	0	0	28
01/06/2024 08:00	14.41	0.51	391310.6	30.53	0	0	26.9
01/06/2024 09:00	14.52	0.53	386592.7	29.32	0	0	30.6
01/06/2024 10:00	14.35	0.57	419308.9	34.7	0	0	26.3
01/06/2024 11:00	14.37	0.54	422583	35.05	0	0	26.4
01/06/2024 12:00	14.37	0.45	424829.4	35.23	0	0	26.6
01/06/2024 13:00	14.83	0.66	341636.4	21.47	0	0	54.5
01/06/2024 14:00	14.4	0.45	425163.2	35.22	0	0	27.7
01/06/2024 15:00	14.36	0.53	421375.2	34.92	0	0	26.8
01/06/2024 16:00	14.36	0.58	428234.4	35.64	0	0	26.7
01/06/2024 17:00	14.35	0.61	429421.1	35.8	0	0	26.6
01/06/2024 18:00	14.34	0.62	426099.9	35.44	0	0	26.6
01/06/2024 19:00	14.34	0.56	426434.1	35.5	0	0	26.8
01/06/2024 20:00	14.33	0.6	427882.7	35.67	0	0	26.9
01/06/2024 21:00	14.33	0.57	427010.3	35.62	0	0	26.8
01/06/2024 22:00	14.33	0.55	426241.7	35.5	0	0	26.7
01/06/2024 23:00	14.34	0.47	424429.7	35.35	0	0	26.6
01/06/2024 24:00	14.39	0.54	408076.4	32.8	0	0	29.1
Minimum	14.28	0.45	341636.4	21.47	0	0	26.3
MinDate	06/01/2024 2:00:00	06/01/2024 12:00:00	06/01/2024 13:00:00	06/01/2024 13:00:00	06/01/2024 1:00:00	06/01/2024 1:00:00	06/01/2024 3:00:00
Maximum	14.83	1.7	429421.1	35.8	0	0	54.5
MaxDate	06/01/2024 13:00:00	06/01/2024 3:00:00	06/01/2024 17:00:00	06/01/2024 17:00:00	06/01/2024 1:00:00	06/01/2024 1:00:00	06/01/2024 13:00:00
Avg	14.37	0.69	413618.5	33.65	0	0	28.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.3	19451.6	3.1	0	0	5.7
Site ABPR51 Daily: 02/06/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
02/06/2024 01:00	14.25	0.92	386520.8	29.5	0.2	0	32.4
02/06/2024 02:00	14.19	0.96	393403.6	30.67	0.3	0	33.3
02/06/2024 03:00	14.2	0.97	391913.5	30.48	0.3	0	33.6
02/06/2024 04:00	14.25	0.94	385773.3	29.26	0.3	0	33
02/06/2024 05:00	14.28	0.94	381540.1	28.58	0.3	0	32.7
02/06/2024 06:00	14.27	0.95	383877.6	29.06	0.3	0	33.4
02/06/2024 07:00	14.27	0.85	384019.6	28.95	0.4	0	33
02/06/2024 08:00	14.31	0.66	379702.2	28.18	0.2	0	32.2
02/06/2024 09:00	14.32	0.68	380179.6	28.25	0.2	0	33.9
02/06/2024 10:00	14.28	0.8	384522.9	29.07	0.2	0	33.1
02/06/2024 11:00	14.31	0.78	381143.2	28.5	0.2	0	33.1
02/06/2024 12:00	14.32	0.77	381225.3	28.46	0.3	0	33.4
02/06/2024 13:00	14.36	0.84	375916.9	27.45	0.2	0	33.6
02/06/2024 14:00	14.29	0.97	382939.3	28.87	0.3	0	33.9
02/06/2024 15:00	14.28	0.88	384570.7	29.16	0.3	0	35.9
02/06/2024 16:00	14.31	0.82	381202.8	28.53	0.3	0	33.7
02/06/2024 17:00	14.31	0.82	380120.5	28.38	0.3	0	33.4
02/06/2024 18:00	14.28	0.85	382940.5	28.81	0.3	0	33.3
02/06/2024 19:00	14.28	1.01	472876.4	39.63	0.3	0	31.8
02/06/2024 20:00	14.28	1.09	497964.8	42.78	0.4	0	30.8
02/06/2024 21:00	14.26	1.06	486080.4	41.65	0.4	0	30.6
02/06/2024 22:00	14.28	1.11	490970.3	42.19	0.3	0	31.1
02/06/2024 23:00	14.29	1.07	434536.6	34.95	0.2	0	33.2
02/06/2024 24:00	14.33	0.93	378083.3	27.87	0.2	0	32.8
Minimum	14.19	0.66	375916.9	27.45	0.2	0	30.6
MinDate	06/02/2024 2:00:00	06/02/2024 8:00:00	06/02/2024 13:00:00	06/02/2024 13:00:00	06/02/2024 1:00:00	06/02/2024 1:00:00	06/02/2024 21:00:00
Maximum	14.36	1.11	497964.8	42.78	0.4	0	35.9
MaxDate	06/02/2024 13:00:00	06/02/2024 22:00:00	06/02/2024 20:00:00	06/02/2024 20:00:00	06/02/2024 7:00:00	06/02/2024 1:00:00	06/02/2024 15:00:00
Avg	14.28	0.9	402584.4	31.22	0.3	0	33
Num	24	24	24	24	24	24	24



Data[%]	100	100	100	100	100	100	100
STD	0	0.1	40300.9	5	0.1	0	1.1
Site ABPR52 Daily: 02/06/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
02/06/2024 01:00	14.45	0.46	385924.4	29.58	0	0	26.6
02/06/2024 02:00	14.41	0.48	392473.6	30.75	0	0	27.9
02/06/2024 03:00	14.42	0.58	390940.2	30.55	0	0	27.8
02/06/2024 04:00	14.47	0.55	384493.4	29.33	0	0	26.8
02/06/2024 05:00	14.51	0.62	380120.3	28.65	0	0	26.3
02/06/2024 06:00	14.48	0.69	382754.1	29.13	0	0	27.1
02/06/2024 07:00	14.49	0.71	382252.6	29.02	0	0	26.7
02/06/2024 08:00	14.58	0.62	378300.2	28.25	0	0	25.7
02/06/2024 09:00	14.57	0.61	379029.3	28.32	0	0	27.6
02/06/2024 10:00	14.54	0.6	383564.2	29.15	0	0	27
02/06/2024 11:00	14.61	0.48	380195.1	28.57	0	0	26.8
02/06/2024 12:00	14.64	0.5	379986.7	28.52	0	0	27
02/06/2024 13:00	14.66	0.6	374549.8	27.52	0	0	26.7
02/06/2024 14:00	14.57	0.64	381926.3	28.94	0	0	27.6
02/06/2024 15:00	14.53	0.65	383274.9	29.23	0	0	29.8
02/06/2024 16:00	14.57	0.69	380186.4	28.6	0	0	27.5
02/06/2024 17:00	14.56	0.6	378959.3	28.45	0	0	27.4
02/06/2024 18:00	14.53	0.62	382060.4	28.88	0	0	27.4
02/06/2024 19:00	14.52	0.51	472279.1	39.64	0	0	27.2
02/06/2024 20:00	14.48	0.55	498098.8	42.86	0	0	26.9
02/06/2024 21:00	14.48	0.43	487220.5	41.75	0	0	26.4
02/06/2024 22:00	14.47	0.33	491491.8	42.29	0	0	26.9
02/06/2024 23:00	14.46	0.38	435076.1	35.2	0	0	27.8
02/06/2024 24:00	14.49	0.39	376345.8	27.95	0	0	26.4
Minimum	14.41	0.33	374549.8	27.52	0	0	25.7
MinDate	06/02/2024 2:00:00	06/02/2024 22:00:00	06/02/2024 13:00:00	06/02/2024 13:00:00	06/02/2024 1:00:00	06/02/2024 1:00:00	06/02/2024 8:00:00
Maximum	14.66	0.71	498098.8	42.86	0	0	29.8
MaxDate	06/02/2024 13:00:00	06/02/2024 7:00:00	06/02/2024 20:00:00	06/02/2024 20:00:00	06/02/2024 1:00:00	06/02/2024 1:00:00	06/02/2024 15:00:00
Avg	14.52	0.55	401729.3	31.3	0	0	27.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	40920.3	5	0	0	0.8
Site ABPR51 Daily: 03/06/2024 Type: AVG							
Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
03/06/2024 01:00	14.34	0.91	376473.7	27.5	0.2	0	33.3
03/06/2024 02:00	14.31	0.92	379444.4	28.08	0.2	0	32.4
03/06/2024 03:00	14.29	0.92	381217.8	28.42	0.2	0	32.5
03/06/2024 04:00	14.32	0.92	378193.2	27.9	0.3	0	32.7
03/06/2024 05:00	14.39	0.9	371996.2	26.62	0.2	0	37.6
03/06/2024 06:00	14.34	0.89	376583	27.7	0.3	0	33.1
03/06/2024 07:00	14.34	0.89	376390.1	27.48	0.3	0	33.4
03/06/2024 08:00	14.37	0.87	372853.8	26.83	0.3	0	36
03/06/2024 09:00	14.38	0.81	373413.8	26.91	0.3	0	36.6
03/06/2024 10:00	14.33	0.72	378876	28.04	0.3	0	32.6
03/06/2024 11:00	14.33	0.76	379870.7	28.13	0.3	0	32.4
03/06/2024 12:00	14.36	0.75	376358.4	27.44	0.3	0	33.6
03/06/2024 13:00	14.39	0.76	372881.1	26.82	0.2	0	35.6
03/06/2024 14:00	14.34	0.86	377823.9	27.81	0.3	0	32.5
03/06/2024 15:00	14.31	0.67	380786.5	28.41	0.3	0	32.9
03/06/2024 16:00	14.31	0.73	379626	28.2	0.4	0	32.5
03/06/2024 17:00	14.33	0.66	377915	27.83	0.4	0	32.6
03/06/2024 18:00	14.3	0.65	379874.1	28.28	0.4	0	32.6
03/06/2024 19:00	14.3	0.92	469048.3	39.13	0.3	0	31
03/06/2024 20:00	14.28	1.06	496650.1	42.6	0.3	0	30.4
03/06/2024 21:00	14.23	1.04	484484.3	41.44	0.4	0	29.4
03/06/2024 22:00	14.25	1.07	491030.3	42.12	0.3	0	29.9
03/06/2024 23:00	14.27	0.99	436502.1	35.27	0.3	0	31.7
03/06/2024 24:00	14.29	0.85	380322.5	28.26	0.2	0	31.4
Minimum	14.23	0.65	371996.2	26.62	0.2	0	29.4
MinDate	06/03/2024 21:00:00	06/03/2024 18:00:00	06/03/2024 5:00:00	06/03/2024 5:00:00	06/03/2024 1:00:00	06/03/2024 1:00:00	06/03/2024 21:00:00
Maximum	14.39	1.07	496650.1	42.6	0.4	0	37.6
MaxDate	06/03/2024 5:00:00	06/03/2024 22:00:00	06/03/2024 20:00:00	06/03/2024 20:00:00	06/03/2024 16:00:00	06/03/2024 1:00:00	06/03/2024 5:00:00
Avg	14.32	0.86	397859	30.3	0.3	0	32.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	42012	5.3	0.1	0	2
Site ABPR52 Daily: 03/06/2024 Type: AVG							
Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
03/06/2024 01:00	14.51	0.45	373711.5	27.57	0	0	26.6
03/06/2024 02:00	14.49	0.52	377166.8	28.16	0	0	26
03/06/2024 03:00	14.48	0.54	379165.1	28.49	0	0	26.3
03/06/2024 04:00	14.5	0.62	376634.6	27.97	0	0	26.1
03/06/2024 05:00	14.56	0.63	369226	26.69	0	0	30.1
03/06/2024 06:00	14.52	0.62	375338.8	27.77	0	0	26.4
03/06/2024 07:00	14.52	0.58	373653	27.55	0	0	26.5
03/06/2024 08:00	14.55	0.64	370334.4	26.89	0	0	28.6
03/06/2024 09:00	14.59	0.59	370925.2	26.97	0	0	29.2
03/06/2024 10:00	14.61	0.49	377608.3	28.12	0	0	26.1
03/06/2024 11:00	14.65	0.5	378147.6	28.2	0	0	26
03/06/2024 12:00	14.66	0.55	374569.8	27.5	0	0	26.8
03/06/2024 13:00	14.67	0.69	371078.4	26.87	0	0	28.5
03/06/2024 14:00	14.63	0.77	376540.1	27.89	0	0	26.2
03/06/2024 15:00	14.62	0.63	380115	28.47	0	0	26.9
03/06/2024 16:00	14.59	0.65	378483.3	28.28	0	0	26.5
03/06/2024 17:00	14.61	0.54	376568.6	27.9	0	0	26.2
03/06/2024 18:00	14.58	0.4	378996.2	28.35	0	0	26.5
03/06/2024 19:00	14.54	0.49	468968.9	39.21	0	0	26.4
03/06/2024 20:00	14.48	0.47	496769.7	42.7	0	0	26.6
03/06/2024 21:00	14.41	0.5	484960.5	41.53	0	0	25.5
03/06/2024 22:00	14.41	0.57	491903.3	42.23	0	0	25.8
03/06/2024 23:00	14.44	0.6	436347.5	35.38	0	0	26.9
03/06/2024 24:00	14.47	0.58	378532.4	28.33	0	0	25.5
Minimum	14.41	0.4	369226	26.69	0	0	25.5
MinDate	06/03/2024 21:00:00	06/03/2024 18:00:00	06/03/2024 5:00:00	06/03/2024 5:00:00	06/03/2024 1:00:00	06/03/2024 1:00:00	06/03/2024 21:00:00
Maximum	14.67	0.77	496769.7	42.7	0	0	30.1
MaxDate	06/03/2024 13:00:00	06/03/2024 14:00:00	06/03/2024 20:00:00	06/03/2024 20:00:00	06/03/2024 1:00:00	06/03/2024 1:00:00	06/03/2024 5:00:00
Avg	14.55	0.57	396489.3	30.38	0	0	26.8



Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	42885.3	5.3	0	0	1.2
Site ABPR51 Daily: 04/06/2024 Type: AVG							
Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
04/06/2024 01:00	14.33	0.82	375800.6	27.4	0.3	0	32.7
04/06/2024 02:00	14.28	0.84	381803	28.57	0.3	0	31.8
04/06/2024 03:00	14.28	0.84	381963.5	28.64	0.3	0	31.7
04/06/2024 04:00	14.3	0.79	378828.6	28	0.3	0	31.4
04/06/2024 05:00	14.35	0.81	373680.9	27.05	0.2	0	33
04/06/2024 06:00	14.29	0.79	380330	28.29	0.3	0	31.4
04/06/2024 07:00	14.28	0.81	381814.7	28.52	0.3	0	31.5
04/06/2024 08:00	14.28	0.8	380671.4	28.3	0.4	0	31.2
04/06/2024 09:00	14.27	0.84	395821	29.12	0.3	0	33.9
04/06/2024 10:00	14.11	0.76	419952.4	34.63	0.4	0	30.4
04/06/2024 11:00	14.12	0.75	419206.5	34.54	0.4	0	30.5
04/06/2024 12:00	14.15	0.73	420325.8	34.57	0.4	0	30.5
04/06/2024 13:00	14.61	0.77	349806.6	21.99	0.2	0	56.1
04/06/2024 14:00	14.21	0.9	436878.3	36.24	0.4	0	30.5
04/06/2024 15:00	14.21	0.79	445327.4	37.18	0.5	0	29.8
04/06/2024 16:00	14.22	0.62	447021.9	37.36	0.5	0	30
04/06/2024 17:00	14.2	0.74	446839.5	37.38	0.5	0	30
04/06/2024 18:00	14.2	0.64	445493.2	37.36	0.4	0	30
04/06/2024 19:00	14.21	0.69	452225	38.09	0.4	0	29.9
04/06/2024 20:00	14.19	0.88	456882.4	38.54	0.4	0	29.5
04/06/2024 21:00	14.18	0.93	458961.3	38.86	0.4	0	29.2
04/06/2024 22:00	14.18	0.96	462332.4	39.18	0.4	0	29.3
04/06/2024 23:00	14.19	0.98	466043.2	39.56	0.3	0	29
04/06/2024 24:00	14.24	0.95	437183.6	35.55	0.3	0	32.9
Minimum	14.11	0.62	349806.6	21.99	0.2	0	29
MinDate	06/04/2024 10:00:00	06/04/2024 16:00:00	06/04/2024 13:00:00	06/04/2024 13:00:00	06/04/2024 5:00:00	06/04/2024 1:00:00	06/04/2024 23:00:00
Maximum	14.61	0.98	466043.2	39.56	0.5	0	56.1
MaxDate	06/04/2024 13:00:00	06/04/2024 23:00:00	06/04/2024 23:00:00	06/04/2024 23:00:00	06/04/2024 15:00:00	06/04/2024 1:00:00	06/04/2024 13:00:00
Avg	14.25	0.81	416466.4	33.12	0.4	0	31.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	35899.5	5.1	0.1	0	5.3
Site ABPR52 Daily: 04/06/2024 Type: AVG							

Date & Time	52HRSG_O2	52HRSG_DUST	52HRSG_FLOW	GT_LOAD	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
04/06/2024 01:00	14.51	0.58	373212.9	27.46	0	0	26.2
04/06/2024 02:00	14.47	0.58	380172.9	28.64	0	0	25.8
04/06/2024 03:00	14.47	0.57	380417	28.7	0	0	25.8
04/06/2024 04:00	14.5	0.61	377224.6	28.06	0	0	25.2
04/06/2024 05:00	14.53	0.49	371444.2	27.11	0	0	26.1
04/06/2024 06:00	14.48	0.45	378588.1	28.37	0	0	25.3
04/06/2024 07:00	14.47	0.39	380289.8	28.59	0	0	25.4
04/06/2024 08:00	14.49	0.44	378832.7	28.38	0	0	25.2
04/06/2024 09:00	14.47	0.5	394592.7	29.14	0	0	29
04/06/2024 10:00	14.37	0.54	419673	34.69	0	0	25.9
04/06/2024 11:00	14.44	0.61	419009.3	34.62	0	0	26.2
04/06/2024 12:00	14.49	0.7	419935.4	34.62	0	0	26.4
04/06/2024 13:00	14.93	1.01	342586.6	21.4	0	0	55.9
04/06/2024 14:00	14.53	0.83	435969.3	36.18	0	0	26.6
04/06/2024 15:00	14.52	0.53	445063.3	37.26	0	0	25.9
04/06/2024 16:00	14.52	0.28	447153.6	37.45	0	0	25.9
04/06/2024 17:00	14.48	0.44	446804	37.45	0	0	25.9
04/06/2024 18:00	14.48	0.47	446096.3	37.45	0	0	25.8
04/06/2024 19:00	14.48	0.53	453027.3	38.17	0	0	25.5
04/06/2024 20:00	14.45	0.53	457010.1	38.63	0	0	25.2
04/06/2024 21:00	14.39	0.5	459848.5	38.95	0	0	25
04/06/2024 22:00	14.38	0.56	462874.3	39.27	0	0	25
04/06/2024 23:00	14.39	0.48	467421.5	39.65	0	0	24.7
04/06/2024 24:00	14.37	0.68	455534.3	33.31	0	0	24.9
Minimum	14.37	0.28	342586.6	21.4	0	0	24.7
MinDate	06/04/2024 10:00:00	06/04/2024 16:00:00	06/04/2024 13:00:00	06/04/2024 13:00:00	06/04/2024 1:00:00	06/04/2024 1:00:00	06/04/2024 23:00:00
Maximum	14.93	1.01	467421.5	39.65	0	0	55.9
MaxDate	06/04/2024 13:00:00	06/04/2024 13:00:00	06/04/2024 23:00:00	06/04/2024 23:00:00	06/04/2024 1:00:00	06/04/2024 1:00:00	06/04/2024 13:00:00
Avg	14.48	0.55	416365.9	33.06	0	0	27
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	38025.6	5.2	0	0	6.2
Site ABPR51 Daily: 05/06/2024 Type: AVG							

Date & Time	51HRSG_O2	51HRSG_DUST	51HRSG_FLOW	GT_LOAD	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
	%VOL	MG/M3	M3/HR	MW			
05/06/2024 01:00	14.26	0.94	493528.8	42.43	0.3	0	30
05/06/2024 02:00	14.26	0.89	496014.6	42.9	0.3	0	29.7
05/06/2024 03:00	14.28	0.86	495240.6	42.93	0.4	0	30.5
05/06/2024 04:00	14.28	0.88	494806.3	42.9	0.4	0	30.6
05/06/2024 05:00	14.27	0.87	495138.3	42.93	0.4	0	30.5
05/06/2024 06:00	14.28	0.88	495889.6	43.02	0.4	0	30.4
05/06/2024 07:00	14.28	1.18	495408.2	42.93	0.5	0	30.4
05/06/2024 08:00	14.28	1.26	495521.5	42.99	0.6	0	30.7
05/06/2024 09:00	14.27	1.02	425314.9	34.2	0.5	0	34.8
05/06/2024 10:00	14.1	0.74	410460.2	33.54	0.5	0	31
05/06/2024 11:00	14.1	0.65	411183.4	33.54	0.5	0	31.1
05/06/2024 12:00	14.15	0.64	414162.3	33.69	0.5	0	31
05/06/2024 13:00	14.64	0.76	349129	22.06	0.1	0	56.9
05/06/2024 14:00	14.12	0.79	413297.8	33.85	0.4	0	31.9
05/06/2024 15:00	14.1	0.84	414579.6	34.08	0.4	0	31.1
05/06/2024 16:00	14.1	0.85	415483.4	34.16	0.4	0	30.6
05/06/2024 17:00	14.1	0.88	415855.4	34.21	0.4	0	30.6
05/06/2024 18:00	14.09	0.88	415777.1	34.14	0.4	0	30.5
05/06/2024 19:00	14.1	0.88	416191	34.19	0.4	0	30.5
05/06/2024 20:00	14.1	0.87	413922.3	34.04	0.4	0	30.6
05/06/2024 21:00	14.1	0.88	410740.4	33.66	0.5	0	30.9
05/06/2024 22:00	14.09	0.86	409646.9	33.41	0.4	0	31.3
05/06/2024 23:00	14.09	0.85	409820.3	33.43	0.4	0	31.3
05/06/2024 24:00	14.18	0.86	401486.1	31.96	0.4	0	34.7
Minimum	14.09	0.64	349129	22.06	0.1	0	29.7
MinDate	06/05/2024 18:00:00	06/05/2024 12:00:00	06/05/2024 13:00:00	06/05/2024 13:00:00	06/05/2024 13:00:00	06/05/2024 1:00:00	06/05/2024 2:00:00
Maximum	14.64	1.26	496014.6	43.02	0.6	0	56.9
MaxDate	06/05/2024 13:00:00	06/05/2024 8:00:00	06/05/2024 2:00:00	06/05/2024 6:00:00	06/05/2024 8:00:00	06/05/2024 1:00:00	06/05/2024 13:00:00



Avg	14.19	0.88	437858.2	36.3	0.4	0	32.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	43568.2	5.3	0.1	0	5.4

Site ABPR52 Daily: 05/06/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
05/06/2024 01:00	Shutdown	0.33	Shutdown	0.15	Shutdown	Shutdown	Shutdown
05/06/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
05/06/2024 03:00	Shutdown	0.74	Shutdown	0	Shutdown	Shutdown	Shutdown
05/06/2024 04:00	Shutdown	7.2	Shutdown	0	Shutdown	Shutdown	Shutdown
05/06/2024 05:00	Shutdown	9.94	Shutdown	0	Shutdown	Shutdown	Shutdown
05/06/2024 06:00	Shutdown	4.86	Shutdown	0	Shutdown	Shutdown	Shutdown
05/06/2024 07:00	Shutdown	0.93	Shutdown	0	Shutdown	Shutdown	Shutdown
05/06/2024 08:00	Shutdown	0.97	Shutdown	0	Shutdown	Shutdown	Shutdown
05/06/2024 09:00	<Samp	1.25	<Samp	16.98	<Samp	<Samp	<Samp
05/06/2024 10:00	14.41	0.66	414108.2	33.61	0	0	26.9
05/06/2024 11:00	14.5	0.56	414032.2	33.61	0	0	27.5
05/06/2024 12:00	14.61	0.58	417761.7	33.77	0	0	28
05/06/2024 13:00	14.97	0.7	347238	22.02	0	0	50.9
05/06/2024 14:00	14.45	0.44	415749.8	33.98	0	0	28.4
05/06/2024 15:00	14.4	0.4	416733.8	34.19	0	0	27.9
05/06/2024 16:00	14.37	0.39	417098.8	34.22	0	0	27.4
05/06/2024 17:00	14.35	0.34	418001.6	34.32	0	0	27.3
05/06/2024 18:00	14.34	0.47	417062.9	34.23	0	0	27.1
05/06/2024 19:00	14.34	0.54	417302.1	34.27	0	0	27
05/06/2024 20:00	14.34	0.54	415239.2	34.1	0	0	26.8
05/06/2024 21:00	14.33	0.59	412371.3	33.74	0	0	26.6
05/06/2024 22:00	14.34	0.58	410348	33.47	0	0	26.4
05/06/2024 23:00	14.34	0.57	410447.8	33.5	0	0	26.5
05/06/2024 24:00	14.35	0.83	409197.7	28.23	0	0	26.4
Minimum	14.33	0.01	347238	0	0	0	26.4
MinDate	06/05/2024 21:00:00	06/05/2024 2:00:00	06/05/2024 13:00:00	06/05/2024 2:00:00	06/05/2024 10:00:00	06/05/2024 10:00:00	06/05/2024 22:00:00
Maximum	14.97	9.94	418001.6	34.32	0	0	50.9
MaxDate	06/05/2024 13:00:00	06/05/2024 5:00:00	06/05/2024 17:00:00	06/05/2024 17:00:00	06/05/2024 10:00:00	06/05/2024 10:00:00	06/05/2024 13:00:00
Avg	14.43	1.43	410179.5	21.18	0	0	28.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.2	2.4	17651.6	15.8	0	0	6.2

Site ABPR51 Daily: 06/06/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
06/06/2024 01:00	14.28	0.9	495569.4	42.88	0.4	0	30.1
06/06/2024 02:00	14.28	0.85	494556.1	42.93	0.4	0	30.6
06/06/2024 03:00	14.28	0.88	494112.8	42.94	0.4	0	30.9
06/06/2024 04:00	14.28	0.9	493771.8	42.92	0.4	0	31.1
06/06/2024 05:00	14.28	0.9	494173.9	42.94	0.4	0	31.2
06/06/2024 06:00	14.28	0.92	494760.3	43.04	0.4	0	31.4
06/06/2024 07:00	14.28	0.9	493323.8	42.93	0.4	0	31.3
06/06/2024 08:00	14.28	0.76	494783.7	42.95	0.5	0	30.9
06/06/2024 09:00	14.28	0.67	422803	33.97	0.4	0	35.7
06/06/2024 10:00	14.1	0.66	411122.8	33.72	0.4	0	32.2
06/06/2024 11:00	14.14	0.73	414524.4	34.03	0.4	0	31.6
06/06/2024 12:00	14.16	0.76	417781.1	34.11	0.4	0	31.2
06/06/2024 13:00	14.61	0.73	351490.6	22.3	0.2	0	53.6
06/06/2024 14:00	14.17	0.83	421250.6	34.64	0.5	0	30.7
06/06/2024 15:00	14.15	0.8	417533.4	34.2	0.5	0	31
06/06/2024 16:00	14.15	0.79	419347.4	34.41	0.4	0	30.5
06/06/2024 17:00	14.11	0.85	412744.5	33.7	0.3	0	31.3
06/06/2024 18:00	14.1	0.86	410379.3	33.43	0.4	0	31.5
06/06/2024 19:00	14.1	0.82	410889.3	33.53	0.4	0	31.6
06/06/2024 20:00	14.1	0.87	409900	33.41	0.4	0	32.5
06/06/2024 21:00	14.1	0.86	409920.2	33.47	0.4	0	32
06/06/2024 22:00	14.09	0.9	409640.2	33.4	0.3	0	32.2
06/06/2024 23:00	14.1	0.88	409603.4	33.45	0.3	0	32.9
06/06/2024 24:00	14.18	0.87	400737.3	31.76	0.4	0	36.6
Minimum	14.09	0.66	351490.6	22.3	0.2	0	30.1
MinDate	06/06/2024 22:00:00	06/06/2024 10:00:00	06/06/2024 13:00:00	06/06/2024 13:00:00	06/06/2024 13:00:00	06/06/2024 1:00:00	06/06/2024 1:00:00
Maximum	14.61	0.92	495569.4	43.04	0.5	0	53.6
MaxDate	06/06/2024 13:00:00	06/06/2024 6:00:00	06/06/2024 1:00:00	06/06/2024 6:00:00	06/06/2024 8:00:00	06/06/2024 1:00:00	06/06/2024 13:00:00
Avg	14.2	0.83	437696.6	36.29	0.4	0	32.7
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	43031.8	5.3	0.1	0	4.7

Site ABPR52 Daily: 06/06/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
06/06/2024 01:00	Shutdown	0.24	Shutdown	0.01	Shutdown	Shutdown	Shutdown
06/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
06/06/2024 03:00	Shutdown	0.2	Shutdown	0	Shutdown	Shutdown	Shutdown
06/06/2024 04:00	Shutdown	2.35	Shutdown	0	Shutdown	Shutdown	Shutdown
06/06/2024 05:00	Shutdown	5.15	Shutdown	0	Shutdown	Shutdown	Shutdown
06/06/2024 06:00	Shutdown	0.38	Shutdown	0	Shutdown	Shutdown	Shutdown
06/06/2024 07:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
06/06/2024 08:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
06/06/2024 09:00	Shutdown	1.29	Shutdown	16.67	Shutdown	Shutdown	Shutdown
06/06/2024 10:00	14.45	0.67	417048.8	33.81	0	0	28.4
06/06/2024 11:00	14.55	0.72	418738.7	34.12	0	0	29.3
06/06/2024 12:00	14.53	0.72	419940.3	34.02	0	0	28.9
06/06/2024 13:00	14.92	0.81	351258.8	22.41	0	0	47.9
06/06/2024 14:00	14.53	0.66	425902	34.92	0	0	28.6
06/06/2024 15:00	14.48	0.56	420195.6	34.31	0	0	29.1
06/06/2024 16:00	14.45	0.42	420355.3	34.48	0	0	28.5
06/06/2024 17:00	14.4	0.45	413278.2	33.61	0	0	28
06/06/2024 18:00	14.36	0.55	411757.6	33.5	0	0	27.7
06/06/2024 19:00	14.34	0.57	411789.2	33.6	0	0	27.6
06/06/2024 20:00	14.35	0.54	410656.3	33.48	0	0	27.8
06/06/2024 21:00	14.35	0.48	410365.8	33.52	0	0	27.3
06/06/2024 22:00	14.34	0.46	410240.2	33.46	0	0	27.2
06/06/2024 23:00	14.34	0.45	410137.9	33.51	0	0	27.6
06/06/2024 24:00	14.35	0.71	407363.2	27.72	0	0	28.3
Minimum	14.34	0	351258.8	0	0	0	27.2
MinDate	06/06/2024 19:00:00	06/06/2024 2:00:00	06/06/2024 13:00:00	06/06/2024 2:00:00	06/06/2024 10:00:00	06/06/2024 10:00:00	06/06/2024 22:00:00
Maximum	14.92	5.15	425902	34.92	0	0	47.9



MaxDate	06/06/2024 13:00:00	06/06/2024 5:00:00	06/06/2024 14:00:00	06/06/2024 14:00:00	06/06/2024 10:00:00	06/06/2024 10:00:00	06/06/2024 13:00:00
Avg	14.45	0.78	410601.8	21.13	0	0	29.5
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.2	1	17235.4	15.8	0	0	5.1
Site ABPR51 Daily: 07/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
07/06/2024 01:00	14.28	0.94	495032.3	42.87	0.4	0	30.8
07/06/2024 02:00	14.28	0.93	493614.7	42.92	0.4	0	31.1
07/06/2024 03:00	14.28	0.89	494044.8	42.94	0.4	0	31
07/06/2024 04:00	14.28	0.9	493712.3	42.94	0.4	0	31
07/06/2024 05:00	14.28	0.92	493981.8	42.96	0.5	0	31.2
07/06/2024 06:00	14.28	0.92	494538	43.04	0.4	0	31.3
07/06/2024 07:00	14.28	0.94	493594.5	42.96	0.4	0	31.3
07/06/2024 08:00	14.28	0.87	494413.9	43	0.5	0	31.2
07/06/2024 09:00	14.32	0.83	426330.3	34.15	0.3	0	36.9
07/06/2024 10:00	14.13	0.76	407575.3	33.13	0.4	0	33.5
07/06/2024 11:00	14.13	0.73	409164	33.29	0.4	0	33
07/06/2024 12:00	14.15	0.72	408512.9	33.15	0.4	0	32.8
07/06/2024 13:00	14.6	0.73	352697.3	22.48	0.2	0	53.2
07/06/2024 14:00	14.15	0.8	410853.1	33.47	0.5	0	33.7
07/06/2024 15:00	14.14	0.84	410354.5	33.42	0.4	0	32.6
07/06/2024 16:00	14.14	0.8	411550.6	33.58	0.4	0	32.4
07/06/2024 17:00	14.13	0.82	411109.4	33.55	0.4	0	32
07/06/2024 18:00	14.13	0.84	411349.1	33.52	0.5	0	32.3
07/06/2024 19:00	14.12	0.81	413050	33.76	0.4	0	31.7
07/06/2024 20:00	14.1	0.86	413303.8	33.87	0.4	0	31.6
07/06/2024 21:00	14.1	0.89	411938.3	33.75	0.4	0	31.9
07/06/2024 22:00	14.09	0.85	411421.2	33.7	0.4	0	31.8
07/06/2024 23:00	14.1	0.87	413773.8	33.99	0.4	0	31.6
07/06/2024 24:00	14.11	1	412333	28.38	0.4	0	31.3
Minimum	14.09	0.72	352697.3	22.48	0.2	0	30.8
MinDate	06/07/2024 22:00:00	06/07/2024 12:00:00	06/07/2024 13:00:00	06/07/2024 13:00:00	06/07/2024 13:00:00	06/07/2024 1:00:00	06/07/2024 1:00:00
Maximum	14.6	1	495032.3	43.04	0.5	0	53.2
MaxDate	06/07/2024 13:00:00		06/07/2024 1:00:00	06/07/2024 6:00:00	06/07/2024 5:00:00	06/07/2024 1:00:00	06/07/2024 13:00:00
Avg	14.2	0.85	437010.4	36.03	0.4	0	33
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	43091.6	5.6	0.1	0	4.5
Site ABPR52 Daily: 07/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
07/06/2024 01:00	Shutdown	0.22	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 03:00	Shutdown	0.1	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 04:00	Shutdown	1.38	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 05:00	Shutdown	3.59	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 06:00	Shutdown	1.64	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 08:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
07/06/2024 09:00	<Samp	0.84	<Samp	16.37	<Samp	<Samp	<Samp
07/06/2024 10:00	14.41	0.6	411437.9	33.22	0	0	28.6
07/06/2024 11:00	14.44	0.68	410094.2	33.36	0	0	28.6
07/06/2024 12:00	14.49	0.69	409612.4	33.24	0	0	28.4
07/06/2024 13:00	14.87	0.81	350321.9	22.54	0	0	47.6
07/06/2024 14:00	14.45	0.66	410971	33.5	0	0	29.3
07/06/2024 15:00	14.4	0.51	410727.9	33.47	0	0	28.1
07/06/2024 16:00	14.35	0.4	411795.3	33.67	0	0	27.9
07/06/2024 17:00	14.37	0.49	411378.1	33.62	0	0	27.5
07/06/2024 18:00	14.36	0.52	411064.6	33.6	0	0	27.6
07/06/2024 19:00	14.34	0.52	413140.7	33.84	0	0	27.2
07/06/2024 20:00	14.33	0.48	413174.8	33.94	0	0	27.1
07/06/2024 21:00	14.29	0.61	412267.4	33.83	0	0	27.1
07/06/2024 22:00	14.29	0.64	411795.7	33.77	0	0	27.2
07/06/2024 23:00	14.31	0.58	414825.3	34.14	0	0	26.8
07/06/2024 24:00	14.37	0.52	404380.8	32.41	0	0	29.7
Minimum	14.29	0	350321.9	0	0	0	26.8
MinDate	06/07/2024 21:00:00	06/07/2024 2:00:00	06/07/2024 13:00:00	06/07/2024 1:00:00	06/07/2024 10:00:00	06/07/2024 10:00:00	06/07/2024 23:00:00
Maximum	14.87	3.59	414825.3	34.14	0	0	47.6
MaxDate	06/07/2024 13:00:00	06/07/2024 5:00:00	06/07/2024 23:00:00	06/07/2024 23:00:00	06/07/2024 10:00:00	06/07/2024 10:00:00	06/07/2024 13:00:00
Avg	14.4	0.69	407132.5	21.19	0	0	29.2
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.7	15882.1	15.8	0	0	5.1
Site ABPR51 Daily: 08/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
08/06/2024 01:00	Shutdown	0.29	Shutdown	0.07	Shutdown	Shutdown	Shutdown
08/06/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/06/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/06/2024 04:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
08/06/2024 05:00	Shutdown	1.14	Shutdown	0	Shutdown	Shutdown	Shutdown
08/06/2024 06:00	Shutdown	0.49	Shutdown	0	Shutdown	Shutdown	Shutdown
08/06/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/06/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
08/06/2024 09:00	Shutdown	0.74	Shutdown	14.08	Shutdown	Shutdown	Shutdown
08/06/2024 10:00	14.17	0.78	425455.6	34.78	0.4	0	30.2
08/06/2024 11:00	14.16	0.75	422112.2	34.65	0.4	0	30.4
08/06/2024 12:00	14.16	0.74	422308.5	34.59	0.5	0	30.2
08/06/2024 13:00	14.52	0.76	359672.8	24.24	0.2	0	46.5
08/06/2024 14:00	14.17	0.8	426559.4	35.19	0.4	0	31.1
08/06/2024 15:00	14.16	0.82	427287.9	35.28	0.4	0	30.8
08/06/2024 16:00	14.16	0.82	424328.8	34.93	0.5	0	31
08/06/2024 17:00	14.16	0.76	422261.6	34.67	0.6	0	31
08/06/2024 18:00	14.16	0.81	427060.2	35.18	0.5	0	30.9
08/06/2024 19:00	14.16	0.83	422716.6	34.81	0.4	0	31
08/06/2024 20:00	14.14	0.88	423772.7	34.93	0.4	0	30.5
08/06/2024 21:00	14.11	0.89	422390.4	34.87	0.4	0	30.4
08/06/2024 22:00	14.13	0.87	423569.8	35.01	0.4	0	30.6
08/06/2024 23:00	14.16	0.85	425599.7	35.23	0.4	0	31.1
08/06/2024 24:00	14.22	0.84	414922.5	33.39	0.5	0	34
Minimum	14.11	0.01	359672.8	0	0.2	0	30.2
MinDate	06/08/2024 21:00:00	06/08/2024 2:00:00	06/08/2024 13:00:00	06/08/2024 2:00:00	06/08/2024 13:00:00	06/08/2024 10:00:00	06/08/2024 10:00:00



Maximum	14.52	1.14	427287.9	35.28	0.6	0	46.5
MaxDate	06/08/2024 13:00:00	06/08/2024 5:00:00	06/08/2024 15:00:00	06/08/2024 15:00:00	06/08/2024 17:00:00	06/08/2024 10:00:00	06/08/2024 13:00:00
Avg	14.18	0.63	419334.6	21.91	0.4	0	32
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	16775.3	16.5	0.1	0	4.1

Site ABPR52 Daily: 08/06/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
08/06/2024 01:00	14.44	0.52	494345.4	42.72	0	0	25.9
08/06/2024 02:00	14.43	0.48	493437.8	42.82	0	0	26.4
08/06/2024 03:00	14.43	0.35	492984.8	42.81	0	0	26.4
08/06/2024 04:00	14.43	0.47	492455.5	42.82	0	0	26.4
08/06/2024 05:00	14.43	0.45	492553.8	42.8	0	0	26.4
08/06/2024 06:00	14.44	0.43	493251.8	42.89	0	0	26.6
08/06/2024 07:00	14.43	0.38	492146.3	42.74	0	0	26.4
08/06/2024 08:00	14.46	0.51	493086.4	42.76	0	0	26.1
08/06/2024 09:00	14.5	0.52	470874.5	40.06	0	0	26.5
08/06/2024 10:00	14.41	0.55	420575.5	34.83	0	0	27
08/06/2024 11:00	14.41	0.63	420118.6	34.71	0	0	26.8
08/06/2024 12:00	14.45	0.64	420218.4	34.67	0	0	26.8
08/06/2024 13:00	14.75	0.79	355181.4	24.21	0	0	40.8
08/06/2024 14:00	14.41	0.57	424843.9	35.25	0	0	27.3
08/06/2024 15:00	14.39	0.45	425717.6	35.36	0	0	27
08/06/2024 16:00	14.38	0.47	422850.6	34.99	0	0	27
08/06/2024 17:00	14.41	0.48	420967.1	34.74	0	0	26.9
08/06/2024 18:00	14.4	0.44	425013.2	35.26	0	0	27
08/06/2024 19:00	14.36	0.41	421780.3	34.96	0	0	27
08/06/2024 20:00	14.3	0.46	422662.4	35.03	0	0	26.5
08/06/2024 21:00	14.29	0.54	421629.2	34.95	0	0	26.4
08/06/2024 22:00	14.31	0.58	423626.3	35.14	0	0	26.5
08/06/2024 23:00	14.35	0.52	424721.2	35.31	0	0	27
08/06/2024 24:00	14.36	0.81	421980.7	29.37	0	0	27.3
Minimum	14.29	0.35	355181.4	24.21	0	0	25.9
MinDate	06/08/2024 21:00:00	06/08/2024 3:00:00	06/08/2024 13:00:00	06/08/2024 13:00:00	06/08/2024 1:00:00	06/08/2024 1:00:00	06/08/2024 1:00:00
Maximum	14.75	0.81	494345.4	42.89	0	0	40.8
MaxDate	06/08/2024 13:00:00		06/08/2024 1:00:00	06/08/2024 6:00:00	06/08/2024 1:00:00	06/08/2024 1:00:00	06/08/2024 13:00:00
Avg	14.42	0.52	445292.5	37.13	0	0	27.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	38591.6	4.9	0	0	2.9

Site ABPR51 Daily: 09/06/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
09/06/2024 01:00	14.29	0.88	495534.4	42.78	0.5	0	30.7
09/06/2024 02:00	14.28	0.86	494631.2	42.89	0.5	0	31.4
09/06/2024 03:00	14.28	0.86	494587.3	42.88	0.5	0	31.4
09/06/2024 04:00	14.28	0.86	494525.7	42.88	0.4	0	31.5
09/06/2024 05:00	14.28	0.87	494634.1	42.9	0.4	0	31.2
09/06/2024 06:00	14.28	0.84	495381.6	42.98	0.5	0	31.1
09/06/2024 07:00	14.28	0.81	493696.9	42.91	0.4	0	31.3
09/06/2024 08:00	14.28	1.03	493119.3	42.98	0.4	0	31.5
09/06/2024 09:00	14.28	0.97	493344.2	42.97	0.4	0	31.9
09/06/2024 10:00	14.28	0.79	494495.1	42.97	0.5	0	31.5
09/06/2024 11:00	14.29	0.69	495731	42.98	0.4	0	31
09/06/2024 12:00	14.31	0.76	496893.1	43	0.4	0	30.7
09/06/2024 13:00	14.34	0.78	497984.4	43.06	0.5	0	30.8
09/06/2024 14:00	14.34	0.82	498699.5	43.1	0.4	0	30.9
09/06/2024 15:00	14.32	0.85	498828.3	43.09	0.4	0	30.8
09/06/2024 16:00	14.33	0.82	498609.4	43.07	0.4	0	30.7
09/06/2024 17:00	14.33	0.84	498807.3	43.08	0.4	0	30.7
09/06/2024 18:00	14.3	0.89	489580.9	42.13	0.3	0	30.8
09/06/2024 19:00	14.21	0.92	429616.1	35.27	0.3	0	31.2
09/06/2024 20:00	14.16	0.97	443091	37.25	0.4	0	30.2
09/06/2024 21:00	14.15	0.97	439691	36.85	0.3	0	30.6
09/06/2024 22:00	14.15	0.95	434302	36.27	0.3	0	31.1
09/06/2024 23:00	14.24	0.95	437315.2	35.91	0.3	0	33.7
09/06/2024 24:00	14.28	0.95	494445.1	42.87	0.3	0	30.6
Minimum	14.15	0.69	429616.1	35.27	0.3	0	30.2
MinDate	06/09/2024 21:00:00	06/09/2024 11:00:00	06/09/2024 19:00:00	06/09/2024 19:00:00	06/09/2024 18:00:00	06/09/2024 1:00:00	06/09/2024 20:00:00
Maximum	14.34	1.03	498828.3	43.1	0.5	0	33.7
MaxDate	06/09/2024 13:00:00	06/09/2024 8:00:00	06/09/2024 15:00:00	06/09/2024 14:00:00	06/09/2024 1:00:00	06/09/2024 1:00:00	06/09/2024 23:00:00
Avg	14.27	0.87	483231	41.54	0.4	0	31.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	24516	2.8	0.1	0	0.7

Site ABPR52 Daily: 09/06/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
09/06/2024 01:00	Shutdown	0.28	Shutdown	0.02	Shutdown	Shutdown	Shutdown
09/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 03:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 04:00	Shutdown	2.18	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 05:00	Shutdown	3.76	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 06:00	Shutdown	2.47	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 07:00	Shutdown	0.11	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 08:00	Shutdown	0.59	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 09:00	Shutdown	0.44	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 10:00	Shutdown	0.21	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 11:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 12:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 13:00	Shutdown	0.16	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 14:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 15:00	Shutdown	0.41	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 16:00	Shutdown	0.59	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 17:00	Shutdown	0.7	Shutdown	0	Shutdown	Shutdown	Shutdown
09/06/2024 18:00	Shutdown	0.87	Shutdown	1.46	Shutdown	Shutdown	Shutdown
09/06/2024 19:00	14.44	0.35	439175.9	35.26	0.2	0	29.7
09/06/2024 20:00	14.41	0.39	447464.3	37.35	0	0	27.8
09/06/2024 21:00	14.39	0.32	442434.1	36.95	0	0	27.9
09/06/2024 22:00	14.38	0.35	435991.8	36.33	0	0	28.2
09/06/2024 23:00	<Samp	0.72	<Samp	21.31	<Samp	<Samp	<Samp
09/06/2024 24:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.38	0	435991.8	0	0	0	27.8



MinDate	06/09/2024 22:00:00	06/09/2024 2:00:00	06/09/2024 22:00:00	06/09/2024 2:00:00	06/09/2024 20:00:00	06/09/2024 19:00:00	06/09/2024 20:00:00
Maximum	14.44	3.76	447464.3	37.35	0.2	0	29.7
MaxDate	06/09/2024 19:00:00	06/09/2024 5:00:00	06/09/2024 20:00:00	06/09/2024 20:00:00	06/09/2024 19:00:00	06/09/2024 19:00:00	06/09/2024 19:00:00
Avg	14.41	0.65	441266.6	7.03	0.1	0	28.4
Num	4	24	4	24	4	4	4
Data[%]	17	100	17	100	17	17	17
STD	0	0.9	4894.4	14.1	0.1	0	0.9
Site ABPR51 Daily: 10/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
10/06/2024 01:00	14.28	0.91	494872.2	42.94	0.3	0	31
10/06/2024 02:00	14.28	0.93	494385.7	42.94	0.3	0	31
10/06/2024 03:00	14.28	0.94	494247.8	42.95	0.3	0	31.1
10/06/2024 04:00	14.28	0.93	494585.5	42.94	0.3	0	31.1
10/06/2024 05:00	14.28	0.94	494867.1	42.95	0.3	0	31
10/06/2024 06:00	14.28	0.87	495526.2	43.07	0.4	0	31.1
10/06/2024 07:00	14.28	0.94	495099.3	43	0.3	0	31.2
10/06/2024 08:00	14.28	0.95	495467.8	43.08	0.3	0	31.3
10/06/2024 09:00	14.27	0.89	444102.1	36.67	0.3	0	32.4
10/06/2024 10:00	14.16	0.86	432213.1	36.1	0.3	0	31.3
10/06/2024 11:00	14.16	0.9	432826.8	36.1	0.3	0	31.4
10/06/2024 12:00	14.16	0.91	435205.3	36.38	0.3	0	31.5
10/06/2024 13:00	14.48	0.81	365263.5	24.97	0.2	0	45.2
10/06/2024 14:00	14.24	0.94	464438.5	39.38	0.3	0	30.6
10/06/2024 15:00	14.22	0.96	458296	38.8	0.3	0	30.8
10/06/2024 16:00	14.26	0.99	471180.1	39.95	0.3	0	30.2
10/06/2024 17:00	14.26	1	475064.3	40.38	0.3	0	30
10/06/2024 18:00	14.24	0.97	469387.8	39.87	0.3	0	30.1
10/06/2024 19:00	14.23	1.04	469413.3	39.9	0.3	0	30.1
10/06/2024 20:00	14.25	1.01	478982.8	40.87	0.3	0	30
10/06/2024 21:00	14.25	1.02	477454.5	40.73	0.4	0	30
10/06/2024 22:00	14.25	1.03	480533.1	41.11	0.4	0	30
10/06/2024 23:00	14.24	1.03	481071.2	41.16	0.3	0	30
10/06/2024 24:00	14.31	1.02	450908	37.02	0.3	0	35
Minimum	14.16	0.81	365263.5	24.97	0.2	0	30
MinDate	06/10/2024 10:00:00	06/10/2024 13:00:00	06/10/2024 13:00:00	06/10/2024 13:00:00	06/10/2024 13:00:00	06/10/2024 1:00:00	06/10/2024 17:00:00
Maximum	14.48	1.04	495526.2	43.08	0.4	0	45.2
MaxDate	06/10/2024 13:00:00	06/10/2024 19:00:00	06/10/2024 6:00:00	06/10/2024 8:00:00	06/10/2024 6:00:00	06/10/2024 1:00:00	06/10/2024 13:00:00
Avg	14.26	0.95	468558	39.72	0.3	0	31.6
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30571	4	0	0	3.1
Site ABPR52 Daily: 10/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
10/06/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 02:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 03:00	Shutdown	0.43	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 04:00	Shutdown	1.62	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 05:00	Shutdown	3.55	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 06:00	Shutdown	2.08	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 08:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
10/06/2024 09:00	Shutdown	0.9	Shutdown	17.17	Shutdown	Shutdown	Shutdown
10/06/2024 10:00	14.45	0.57	437856.9	36.18	0	0	28.1
10/06/2024 11:00	14.4	0.54	434064.9	36.21	0	0	27.9
10/06/2024 12:00	14.4	0.46	436071.3	36.46	0	0	27.9
10/06/2024 13:00	14.67	0.54	361102	25.07	0	0	40.1
10/06/2024 14:00	14.45	0.28	465867.5	39.44	0	0	27
10/06/2024 15:00	14.42	0.35	459063.2	38.9	0	0	27.1
10/06/2024 16:00	14.45	0.37	471391.2	40.02	0	0	26.8
10/06/2024 17:00	14.44	0.44	475539.1	40.47	0	0	26.4
10/06/2024 18:00	14.42	0.4	469660.1	39.96	0	0	26.4
10/06/2024 19:00	14.41	0.5	470019.3	40	0	0	26.4
10/06/2024 20:00	14.43	0.61	479974.7	41	0	0	26.3
10/06/2024 21:00	14.42	0.69	478620.2	40.83	0	0	26.2
10/06/2024 22:00	14.43	0.67	481910.1	41.26	0	0	26.1
10/06/2024 23:00	14.43	0.66	482167.9	41.28	0	0	26.2
10/06/2024 24:00	14.43	0.71	469639.4	35.14	0	0	26.7
Minimum	14.4	0.01	361102	0	0	0	26.1
MinDate	06/10/2024 11:00:00	06/10/2024 1:00:00	06/10/2024 13:00:00	06/10/2024 1:00:00	06/10/2024 10:00:00	06/10/2024 10:00:00	06/10/2024 22:00:00
Maximum	14.67	3.55	482167.9	41.28	0	0	40.1
MaxDate	06/10/2024 13:00:00	06/10/2024 5:00:00	06/10/2024 23:00:00	06/10/2024 23:00:00	06/10/2024 10:00:00	06/10/2024 10:00:00	06/10/2024 13:00:00
Avg	14.44	0.69	458196.5	24.56	0	0	27.7
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.8	31484.6	18.5	0	0	3.5
Site ABPR51 Daily: 11/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
11/06/2024 01:00	14.28	0.98	491476.3	42.49	0.3	0	31.1
11/06/2024 02:00	14.28	0.96	494234	42.93	0.3	0	31.6
11/06/2024 03:00	14.28	0.93	494299.3	42.92	0.3	0	31.4
11/06/2024 04:00	14.28	0.93	494321.7	42.93	0.3	0	31.5
11/06/2024 05:00	14.28	0.92	493660.3	42.92	0.3	0	31.2
11/06/2024 06:00	14.28	0.93	494252.7	43.01	0.3	0	31
11/06/2024 07:00	14.28	0.91	493457.6	42.92	0.3	0	31.1
11/06/2024 08:00	14.28	0.74	495192.3	43.06	0.4	0	30.8
11/06/2024 09:00	14.28	0.93	454678.2	37.83	0.2	0	33.2
11/06/2024 10:00	14.24	0.98	470560.3	40.1	0.3	0	30.4
11/06/2024 11:00	14.21	0.87	453396.5	38.29	0.3	0	30.7
11/06/2024 12:00	14.22	0.88	452264.8	38.14	0.3	0	30.6
11/06/2024 13:00	14.5	0.74	360836.1	24.3	0.1	0	46.9
11/06/2024 14:00	14.23	0.9	456200.3	38.54	0.3	0	30.6
11/06/2024 15:00	14.22	0.92	456062.3	38.51	0.3	0	30.5
11/06/2024 16:00	14.22	0.94	456539.7	38.55	0.3	0	30.6
11/06/2024 17:00	14.22	0.95	457777.1	38.68	0.2	0	30.6
11/06/2024 18:00	14.2	0.97	455767.6	38.59	0.2	0	30.3
11/06/2024 19:00	14.21	1	461863.9	39.29	0.3	0	30.9
11/06/2024 20:00	14.24	1.05	478157.7	40.96	0.3	0	30.8
11/06/2024 21:00	14.23	1.11	474660.4	40.66	0.2	0	30.5
11/06/2024 22:00	14.25	1.1	482382.9	41.42	0.2	0	30.4
11/06/2024 23:00	14.26	1.09	483015.6	41.51	0.2	0	30.9
11/06/2024 24:00	14.32	1.03	455580.5	37.63	0.3	0	35.5



Minimum	14.2	0.74	360836.1	24.3	0.1	0	30.3
MinDate	06/11/2024 18:00:00	06/11/2024 8:00:00	06/11/2024 13:00:00	06/11/2024 13:00:00	06/11/2024 13:00:00	06/11/2024 1:00:00	06/11/2024 18:00:00
Maximum	14.5	1.11	495192.3	43.06	0.4	0	46.9
MaxDate	06/11/2024 13:00:00	06/11/2024 21:00:00	06/11/2024 8:00:00	06/11/2024 8:00:00	06/11/2024 8:00:00	06/11/2024 1:00:00	06/11/2024 13:00:00
Avg	14.26	0.95	469193.3	39.84	0.3	0	31.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	28660.5	3.9	0.1	0	3.4
Site ABPR52 Daily: 11/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
11/06/2024 01:00	Shutdown	0.33	Shutdown	0.15	Shutdown	Shutdown	Shutdown
11/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/06/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/06/2024 04:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
11/06/2024 05:00	Shutdown	1.09	Shutdown	0	Shutdown	Shutdown	Shutdown
11/06/2024 06:00	Shutdown	0.8	Shutdown	0	Shutdown	Shutdown	Shutdown
11/06/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
11/06/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
11/06/2024 09:00	<Samp	0.76	<Samp	20.7	<Samp	<Samp	<Samp
11/06/2024 10:00	14.53	0.52	479133.3	40.21	0	0	27.4
11/06/2024 11:00	14.5	0.71	456397.9	38.29	0	0	28.1
11/06/2024 12:00	14.46	0.66	453736.4	38.22	0	0	27.2
11/06/2024 13:00	14.7	0.72	358203.1	24.32	0	0	40.8
11/06/2024 14:00	14.45	0.64	456801	38.59	0	0	26.9
11/06/2024 15:00	14.45	0.53	456789.1	38.59	0	0	26.8
11/06/2024 16:00	14.44	0.4	456965.3	38.63	0	0	26.9
11/06/2024 17:00	14.42	0.29	458226.5	38.77	0	0	26.8
11/06/2024 18:00	14.4	0.37	456738.7	38.67	0	0	26.3
11/06/2024 19:00	14.4	0.47	462799.4	39.36	0	0	26.9
11/06/2024 20:00	14.42	0.43	479401.2	41.07	0	0	26.9
11/06/2024 21:00	14.41	0.56	476286.1	40.76	0	0	26.6
11/06/2024 22:00	14.43	0.62	483967.9	41.5	0	0	26.5
11/06/2024 23:00	14.44	0.61	484875.2	41.6	0	0	26.9
11/06/2024 24:00	14.44	0.87	476910	35.35	0	0	27.1
Minimum	14.4	0	358203.1	0	0	0	26.3
MinDate	06/11/2024 18:00:00	06/11/2024 2:00:00	06/11/2024 13:00:00	06/11/2024 2:00:00	06/11/2024 10:00:00	06/11/2024 10:00:00	06/11/2024 18:00:00
Maximum	14.7	1.09	484875.2	41.6	0	0	40.8
MaxDate	06/11/2024 13:00:00	06/11/2024 5:00:00	06/11/2024 23:00:00	06/11/2024 23:00:00	06/11/2024 10:00:00	06/11/2024 10:00:00	06/11/2024 13:00:00
Avg	14.46	0.48	459815.4	24.78	0	0	27.9
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	30417.6	18.5	0	0	3.6
Site ABPR51 Daily: 12/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
12/06/2024 01:00	14.29	0.96	493323.7	42.77	0.3	0	31.6
12/06/2024 02:00	14.28	0.91	493135.6	42.92	0.3	0	31.4
12/06/2024 03:00	14.28	0.95	493232.4	42.94	0.3	0	31.3
12/06/2024 04:00	14.28	0.9	492977.6	42.95	0.3	0	31.2
12/06/2024 05:00	14.28	0.94	493236.6	42.95	0.3	0	31.1
12/06/2024 06:00	14.28	0.9	493618.3	42.98	0.4	0	30.9
12/06/2024 07:00	14.28	0.92	493938.1	42.96	0.2	0	31.1
12/06/2024 08:00	14.28	0.9	493970.6	42.97	0.2	0	31
12/06/2024 09:00	14.26	0.79	455770.1	38.18	0.2	0	32.4
12/06/2024 10:00	14.21	0.82	450837.3	38.14	0.3	0	30.7
12/06/2024 11:00	14.2	0.75	442902.3	37.21	0.3	0	30.8
12/06/2024 12:00	14.22	0.77	443657	37.2	0.3	0	30.6
12/06/2024 13:00	14.55	0.72	356402.9	23.53	0.1	0	49.4
12/06/2024 14:00	14.23	0.87	448932.3	37.75	0.3	0	30.3
12/06/2024 15:00	14.22	0.85	448887.6	37.67	0.4	0	30.1
12/06/2024 16:00	14.22	0.87	450801.8	37.92	0.3	0	29.9
12/06/2024 17:00	14.22	0.87	453632.4	38.2	0.3	0	29.9
12/06/2024 18:00	14.22	0.9	456657	38.53	0.3	0	30.1
12/06/2024 19:00	14.23	0.92	468579.2	39.8	0.2	0	29.5
12/06/2024 20:00	14.25	0.99	480505	41.07	0.2	0	29.5
12/06/2024 21:00	14.23	0.99	477246.7	40.75	0.3	0	29.4
12/06/2024 22:00	14.24	1.02	483923.6	41.47	0.2	0	29.5
12/06/2024 23:00	14.23	1.02	480328.7	41.17	0.2	0	29.6
12/06/2024 24:00	14.28	1	449911.6	37.03	0.2	0	34.2
Minimum	14.2	0.72	356402.9	23.53	0.1	0	29.4
MinDate	06/12/2024 11:00:00	06/12/2024 13:00:00	06/12/2024 13:00:00	06/12/2024 13:00:00	06/12/2024 13:00:00	06/12/2024 1:00:00	06/12/2024 21:00:00
Maximum	14.55	1.02	493970.6	42.98	0.4	0	49.4
MaxDate	06/12/2024 13:00:00	06/12/2024 22:00:00	06/12/2024 8:00:00	06/12/2024 6:00:00	06/12/2024 6:00:00	06/12/2024 1:00:00	06/12/2024 13:00:00
Avg	14.26	0.9	466517.1	39.54	0.3	0	31.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30627.2	4.1	0.1	0	4
Site ABPR52 Daily: 12/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
12/06/2024 01:00	Shutdown	0.42	Shutdown	0.14	Shutdown	Shutdown	Shutdown
12/06/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
12/06/2024 03:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
12/06/2024 04:00	Shutdown	0.45	Shutdown	0	Shutdown	Shutdown	Shutdown
12/06/2024 05:00	Shutdown	1.43	Shutdown	0	Shutdown	Shutdown	Shutdown
12/06/2024 06:00	Shutdown	2.26	Shutdown	0	Shutdown	Shutdown	Shutdown
12/06/2024 07:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
12/06/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
12/06/2024 09:00	Shutdown	0.79	Shutdown	19.09	Shutdown	Shutdown	Shutdown
12/06/2024 10:00	14.52	0.5	459035.9	38.19	0	0	27.3
12/06/2024 11:00	14.55	0.47	447825.5	37.3	0	0	27.6
12/06/2024 12:00	14.56	0.57	443630.4	37.28	0	0	27.5
12/06/2024 13:00	14.86	0.76	353800.9	23.56	0	0	44.3
12/06/2024 14:00	14.55	0.73	449377.2	37.83	0	0	27.1
12/06/2024 15:00	14.53	0.7	449120.7	37.77	0	0	26.9
12/06/2024 16:00	14.49	0.72	450857.4	38	0	0	26.7
12/06/2024 17:00	14.48	0.61	453965.2	38.28	0	0	26.7
12/06/2024 18:00	14.47	0.49	457091.6	38.61	0	0	26.8
12/06/2024 19:00	14.45	0.37	468798.4	39.89	0	0	26.2
12/06/2024 20:00	14.44	0.42	480718	41.16	0	0	26.2
12/06/2024 21:00	14.42	0.43	477994.9	40.86	0	0	26
12/06/2024 22:00	14.42	0.47	484743	41.55	0	0	26
12/06/2024 23:00	14.4	0.53	481685.5	41.25	0	0	26.1



12/06/2024 24:00	14.4	0.78	469813.2	34.75	0	0	26.2
Minimum	14.4	0.01	353800.9	0	0	0	26
MinDate	06/12/2024 23:00:00	06/12/2024 2:00:00	06/12/2024 13:00:00	06/12/2024 2:00:00	06/12/2024 10:00:00	06/12/2024 10:00:00	06/12/2024 21:00:00
Maximum	14.86	2.26	484743	41.55	0	0	44.3
MaxDate	06/12/2024 13:00:00	06/12/2024 6:00:00	06/12/2024 22:00:00	06/12/2024 22:00:00	06/12/2024 10:00:00	06/12/2024 10:00:00	06/12/2024 13:00:00
Avg	14.5	0.58	455230.5	24.4	0	0	27.8
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.5	31308.7	18.3	0	0	4.6
Site ABPR51 Daily: 13/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
13/06/2024 01:00	14.28	0.89	494045.3	42.79	0.3	0	30.1
13/06/2024 02:00	14.28	0.87	495222.5	42.96	0.4	0	30.4
13/06/2024 03:00	14.28	0.87	494624.2	42.97	0.3	0	30.5
13/06/2024 04:00	14.28	0.89	494308.5	42.99	0.3	0	30.6
13/06/2024 05:00	14.28	0.88	494462.4	42.99	0.3	0	30.6
13/06/2024 06:00	14.28	0.91	494333.2	43.04	0.3	0	30.6
13/06/2024 07:00	14.28	0.81	494763.8	43.01	0.3	0	30.7
13/06/2024 08:00	14.28	0.63	494981.1	43.03	0.4	0	30.3
13/06/2024 09:00	14.28	0.6	454696.7	37.98	0.3	0	32
13/06/2024 10:00	14.27	0.69	469352	39.89	0.3	0	29.7
13/06/2024 11:00	14.24	0.73	452973.9	38.16	0.3	0	30.3
13/06/2024 12:00	14.24	0.74	450258.5	37.76	0.3	0	30.4
13/06/2024 13:00	14.55	0.71	358254.3	23.61	0.2	0	49.4
13/06/2024 14:00	14.24	0.84	452757.6	38.09	0.4	0	30.1
13/06/2024 15:00	14.25	0.73	454809.5	38.27	0.4	0	30.4
13/06/2024 16:00	14.26	0.68	458486.8	38.63	0.4	0	30.3
13/06/2024 17:00	14.26	0.69	462682.9	39.04	0.4	0	30.1
13/06/2024 18:00	14.26	0.7	462587.1	39.02	0.5	0	29.9
13/06/2024 19:00	14.26	0.84	463501.2	39.15	0.4	0	29.8
13/06/2024 20:00	14.26	0.9	473221.3	40.22	0.4	0	29.8
13/06/2024 21:00	14.24	0.92	472786.8	40.25	0.3	0	29.4
13/06/2024 22:00	14.22	0.96	470435.6	40.01	0.3	0	29.1
13/06/2024 23:00	14.22	0.97	477635.3	40.77	0.3	0	28.9
13/06/2024 24:00	14.25	0.91	440463.4	36.18	0.3	0	32.3
Minimum	14.22	0.6	358254.3	23.61	0.2	0	28.9
MinDate	06/13/2024 22:00:00	06/13/2024 9:00:00	06/13/2024 13:00:00	06/13/2024 13:00:00	06/13/2024 13:00:00	06/13/2024 1:00:00	06/13/2024 23:00:00
Maximum	14.55	0.97	495222.5	43.04	0.5	0	49.4
MaxDate	06/13/2024 13:00:00	06/13/2024 23:00:00	06/13/2024 2:00:00	06/13/2024 6:00:00	06/13/2024 18:00:00	06/13/2024 1:00:00	06/13/2024 13:00:00
Avg	14.27	0.81	467985.2	39.62	0.3	0	31.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	29417.8	4	0.1	0	4
Site ABPR52 Daily: 13/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
13/06/2024 01:00	Shutdown	0.36	Shutdown	0.14	Shutdown	Shutdown	Shutdown
13/06/2024 02:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
13/06/2024 03:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
13/06/2024 04:00	Shutdown	0.75	Shutdown	0	Shutdown	Shutdown	Shutdown
13/06/2024 05:00	Shutdown	1.9	Shutdown	0	Shutdown	Shutdown	Shutdown
13/06/2024 06:00	Shutdown	2.56	Shutdown	0	Shutdown	Shutdown	Shutdown
13/06/2024 07:00	Shutdown	0.15	Shutdown	0	Shutdown	Shutdown	Shutdown
13/06/2024 08:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
13/06/2024 09:00	Shutdown	0.9	Shutdown	18.52	Shutdown	Shutdown	Shutdown
13/06/2024 10:00	14.71	0.51	480690.6	40.02	0	0	27.3
13/06/2024 11:00	14.68	0.52	460405.8	38.32	0	0	28.5
13/06/2024 12:00	14.7	0.58	458192.9	37.99	0	0	28.6
13/06/2024 13:00	14.95	0.86	358314.9	23.62	0	0	42.4
13/06/2024 14:00	14.65	0.64	460244.4	38.17	0	0	28.4
13/06/2024 15:00	14.64	0.57	463062.2	38.38	0	0	28.7
13/06/2024 16:00	14.64	0.53	466083.3	38.72	0	0	28.6
13/06/2024 17:00	14.64	0.5	469959.5	39.1	0	0	28.4
13/06/2024 18:00	14.63	0.43	469694.2	39.16	0	0	28.1
13/06/2024 19:00	14.58	0.6	468717.8	39.22	0	0	28
13/06/2024 20:00	14.55	0.55	477909.1	40.31	0	0	27.9
13/06/2024 21:00	14.46	0.41	476065.9	40.34	0	0	26.8
13/06/2024 22:00	14.42	0.56	472981.6	40.08	0	0	26
13/06/2024 23:00	14.43	0.58	480705.3	40.86	0	0	25.8
13/06/2024 24:00	14.4	0.88	456780.6	33.39	0	0	25.8
Minimum	14.4	0.08	358314.9	0	0	0	25.8
MinDate		06/13/2024 2:00:00	06/13/2024 13:00:00	06/13/2024 2:00:00	06/13/2024 10:00:00	06/13/2024 10:00:00	06/13/2024 23:00:00
Maximum	14.95	2.56	480705.3	40.86	0	0	42.4
MaxDate	06/13/2024 13:00:00	06/13/2024 6:00:00	06/13/2024 23:00:00	06/13/2024 23:00:00	06/13/2024 10:00:00	06/13/2024 10:00:00	06/13/2024 13:00:00
Avg	14.61	0.66	461320.5	24.43	0	0	28.6
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.5	29577.1	18.4	0	0	4
Site ABPR51 Daily: 14/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
14/06/2024 01:00	14.28	0.88	496444.5	42.86	0.3	0	29.3
14/06/2024 02:00	14.28	0.85	496946	43.03	0.3	0	29.6
14/06/2024 03:00	14.28	0.79	496821.8	43.05	0.4	0	29.8
14/06/2024 04:00	14.28	0.78	496550.2	43.04	0.4	0	29.8
14/06/2024 05:00	14.28	0.78	496374.9	43.04	0.4	0	29.8
14/06/2024 06:00	14.28	0.79	496959.3	43.14	0.4	0	30.4
14/06/2024 07:00	14.28	0.7	495527.5	43.02	0.4	0	30.2
14/06/2024 08:00	14.29	0.55	496846.4	43.07	0.4	0	29.9
14/06/2024 09:00	14.28	0.54	452547.3	37.58	0.4	0	31.8
14/06/2024 10:00	14.28	0.71	483768.6	41.33	0.4	0	29.1
14/06/2024 11:00	14.28	0.75	480861.5	40.95	0.4	0	29.1
14/06/2024 12:00	14.28	0.77	483556	41.06	0.4	0	29.4
14/06/2024 13:00	14.45	0.68	368281.3	25.92	0.3	0	41.6
14/06/2024 14:00	14.29	0.91	483248	41.11	0.5	0	29.2
14/06/2024 15:00	14.29	0.92	483073.3	41.01	0.5	0	29.6
14/06/2024 16:00	14.29	0.79	480916	40.84	0.5	0	29.5
14/06/2024 17:00	14.29	0.77	484196.5	41.19	0.5	0	29.6
14/06/2024 18:00	14.28	0.74	482070.3	41	0.5	0	29.3
14/06/2024 19:00	14.29	0.84	488656.7	41.71	0.4	0	29.7
14/06/2024 20:00	14.28	0.93	491790.8	42.08	0.4	0	29.6
14/06/2024 21:00	14.28	0.92	492806.3	42.2	0.4	0	29.4
14/06/2024 22:00	14.26	0.94	489502.7	41.94	0.4	0	29.2



14/06/2024 23:00	14.27	0.96	496442.3	42.64	0.3	0	29.4
14/06/2024 24:00	14.27	0.94	460132.9	38.26	0.4	0	32
Minimum	14.26	0.54	368281.3	25.92	0.3	0	29.1
MinDate	06/14/2024 22:00:00	06/14/2024 9:00:00	06/14/2024 13:00:00	06/14/2024 13:00:00	06/14/2024 1:00:00	06/14/2024 1:00:00	06/14/2024 10:00:00
Maximum	14.45	0.96	496959.3	43.14	0.5	0	41.6
MaxDate	06/14/2024 13:00:00	06/14/2024 23:00:00	06/14/2024 6:00:00	06/14/2024 6:00:00	06/14/2024 14:00:00	06/14/2024 1:00:00	06/14/2024 13:00:00
Avg	14.29	0.8	482263.4	41.04	0.4	0	30.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	26792.1	3.5	0.1	0	2.5
Site ABPR52 Daily: 14/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
14/06/2024 01:00	Shutdown	0.47	Shutdown	0.22	Shutdown	Shutdown	Shutdown
14/06/2024 02:00	Shutdown	0.07	Shutdown	0	Shutdown	Shutdown	Shutdown
14/06/2024 03:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
14/06/2024 04:00	Shutdown	0.45	Shutdown	0	Shutdown	Shutdown	Shutdown
14/06/2024 05:00	Shutdown	1.3	Shutdown	0	Shutdown	Shutdown	Shutdown
14/06/2024 06:00	Shutdown	0.76	Shutdown	0	Shutdown	Shutdown	Shutdown
14/06/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
14/06/2024 08:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
14/06/2024 09:00	Shutdown	1.07	Shutdown	18.68	Shutdown	Shutdown	Shutdown
14/06/2024 10:00	14.68	0.63	495725.1	41.44	0	0	27.2
14/06/2024 11:00	14.69	0.66	489637.5	41.1	0	0	28
14/06/2024 12:00	14.7	0.68	491402.1	41.15	0	0	28.6
14/06/2024 13:00	14.83	0.8	368526.1	26.01	0	0	34.5
14/06/2024 14:00	14.68	0.65	493971.5	41.31	0	0	29
14/06/2024 15:00	14.67	0.59	491871.4	41.12	0	0	29.5
14/06/2024 16:00	14.68	0.56	491112.9	40.95	0	0	29.5
14/06/2024 17:00	14.71	0.59	494489	41.31	0	0	29.8
14/06/2024 18:00	14.66	0.56	490453.3	41.15	0	0	28.9
14/06/2024 19:00	14.64	0.58	496031.2	41.85	0	0	29.2
14/06/2024 20:00	14.54	0.51	496815	42.15	0	0	28.1
14/06/2024 21:00	14.47	0.69	496202.3	42.31	0	0	27.3
14/06/2024 22:00	14.46	0.6	492750.7	42.04	0	0	26.6
14/06/2024 23:00	14.45	0.56	499749.1	42.75	0	0	26.6
14/06/2024 24:00	14.43	0.75	478896.2	35.66	0	0	26.1
Minimum	14.43	0	368526.1	0	0	0	26.1
MinDate		06/14/2024 7:00:00	06/14/2024 13:00:00	06/14/2024 2:00:00	06/14/2024 10:00:00	06/14/2024 10:00:00	
Maximum	14.83	1.3	499749.1	42.75	0	0	34.5
MaxDate	06/14/2024 13:00:00	06/14/2024 5:00:00	06/14/2024 23:00:00	06/14/2024 23:00:00	06/14/2024 10:00:00	06/14/2024 10:00:00	06/14/2024 13:00:00
Avg	14.62	0.57	484508.9	25.88	0	0	28.6
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	32432.8	19.5	0	0	2
Site ABPR51 Daily: 15/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
15/06/2024 01:00	14.28	0.82	496472.6	42.87	0.5	0	29.2
15/06/2024 02:00	14.28	0.78	496729.8	43.06	0.5	0	29.7
15/06/2024 03:00	14.28	0.74	496017	43.06	0.5	0	30.2
15/06/2024 04:00	14.28	0.74	496179.5	43.05	0.5	0	30.4
15/06/2024 05:00	14.28	0.7	495829.4	43.08	0.5	0	30.6
15/06/2024 06:00	14.28	0.76	496601.3	43.16	0.5	0	30.5
15/06/2024 07:00	14.28	0.7	495938.5	43.07	0.5	0	30.4
15/06/2024 08:00	14.28	0.53	496291.3	43.08	0.5	0	30.3
15/06/2024 09:00	14.28	0.42	459131.3	38.54	0.5	0	30.9
15/06/2024 10:00	14.28	0.41	467538.2	39.68	0.5	0	29.8
15/06/2024 11:00	14.28	0.48	464550.3	39.25	0.5	0	29.8
15/06/2024 12:00	14.29	0.6	469210.9	39.72	0.5	0	29.4
15/06/2024 13:00	14.46	0.44	365079.5	25.43	0.4	0	41.8
15/06/2024 14:00	14.29	0.72	469976.3	39.76	0.5	0	29.7
15/06/2024 15:00	14.26	0.64	462479.4	39	0.6	0	29.5
15/06/2024 16:00	14.28	0.62	465908.2	39.37	0.6	0	29.9
15/06/2024 17:00	14.28	0.62	468403.7	39.54	0.6	0	29.7
15/06/2024 18:00	14.28	0.62	468612.1	39.61	0.6	0	29.5
15/06/2024 19:00	14.27	0.67	467119.2	39.48	0.6	0	29.7
15/06/2024 20:00	14.25	0.77	464555.6	39.27	0.6	0	29.5
15/06/2024 21:00	14.24	0.82	467353.8	39.71	0.5	0	29.4
15/06/2024 22:00	14.23	0.89	470868.8	40.06	0.4	0	29.3
15/06/2024 23:00	14.22	0.88	469607.6	39.93	0.4	0	29
15/06/2024 24:00	14.21	0.94	457970.3	33.36	0.5	0	29.2
Minimum	14.21	0.41	365079.5	25.43	0.4	0	29
MinDate		06/15/2024 10:00:00	06/15/2024 13:00:00	06/15/2024 13:00:00	06/15/2024 13:00:00	06/15/2024 1:00:00	06/15/2024 23:00:00
Maximum	14.46	0.94	496729.8	43.16	0.6	0	41.8
MaxDate	06/15/2024 13:00:00		06/15/2024 2:00:00	06/15/2024 6:00:00	06/15/2024 15:00:00	06/15/2024 1:00:00	06/15/2024 13:00:00
Avg	14.28	0.68	472017.7	39.84	0.5	0	30.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	27065.8	3.8	0.1	0	2.5
Site ABPR52 Daily: 15/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
15/06/2024 01:00	Shutdown	0.33	Shutdown	0.15	Shutdown	Shutdown	Shutdown
15/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/06/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
15/06/2024 04:00	Shutdown	0.19	Shutdown	0	Shutdown	Shutdown	Shutdown
15/06/2024 05:00	Shutdown	0.93	Shutdown	0	Shutdown	Shutdown	Shutdown
15/06/2024 06:00	Shutdown	0.84	Shutdown	0	Shutdown	Shutdown	Shutdown
15/06/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
15/06/2024 08:00	Shutdown	0.13	Shutdown	0	Shutdown	Shutdown	Shutdown
15/06/2024 09:00	Shutdown	0.91	Shutdown	18.26	Shutdown	Shutdown	Shutdown
15/06/2024 10:00	14.75	0.56	478991.7	39.77	0	0	26.9
15/06/2024 11:00	14.72	0.55	469892	39.33	0	0	27.2
15/06/2024 12:00	14.64	0.58	469498	39.65	0	0	25.9
15/06/2024 13:00	14.78	0.48	363035.5	25.43	0	0	34.9
15/06/2024 14:00	14.55	0.5	471702.4	39.82	0	0	25.9
15/06/2024 15:00	14.5	0.47	464291.7	39.08	0	0	25.7
15/06/2024 16:00	14.49	0.56	467373.1	39.45	0	0	26
15/06/2024 17:00	14.51	0.63	469060.2	39.63	0	0	26
15/06/2024 18:00	14.5	0.58	469933.2	39.72	0	0	25.8
15/06/2024 19:00	14.48	0.62	468851.5	39.65	0	0	25.9
15/06/2024 20:00	14.49	0.49	467758.9	39.39	0	0	26.5
15/06/2024 21:00	14.45	0.35	470962.1	39.78	0	0	26.7



15/06/2024 22:00	14.42	0.37	473993.5	40.17	0	0	26.2
15/06/2024 23:00	14.4	0.53	472712	40.05	0	0	25.9
15/06/2024 24:00	14.44	0.68	448148	36.31	0	0	28.5
Minimum	14.4	0	363035.5	0	0	0	25.7
MinDate	06/15/2024 23:00:00	06/15/2024 2:00:00	06/15/2024 13:00:00	06/15/2024 2:00:00	06/15/2024 10:00:00	06/15/2024 10:00:00	06/15/2024 15:00:00
Maximum	14.78	0.93	478991.7	40.17	0	0	34.9
MaxDate	06/15/2024 13:00:00	06/15/2024 5:00:00	06/15/2024 10:00:00	06/15/2024 22:00:00	06/15/2024 10:00:00	06/15/2024 10:00:00	06/15/2024 13:00:00
Avg	14.54	0.47	461746.9	24.82	0	0	26.9
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.3	28096.7	18.6	0	0	2.3
Site ABPR51 Daily: 16/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
16/06/2024 01:00	Shutdown	0.3	Shutdown	0.3	Shutdown	Shutdown	Shutdown
16/06/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 03:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 04:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 05:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 06:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 09:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 10:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 11:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 12:00	Shutdown	0.14	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 13:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 15:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 16:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 17:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
16/06/2024 18:00	Shutdown	0.74	Shutdown	2.64	Shutdown	Shutdown	Shutdown
16/06/2024 19:00	14.3	0.72	429885.4	34.45	1.2	0	33.1
16/06/2024 20:00	14.28	0.72	446641.2	37.07	0.7	0	31.5
16/06/2024 21:00	14.28	0.68	446268.7	37.14	0.6	0	31.7
16/06/2024 22:00	14.26	0.74	447123.1	37.31	0.7	0	31.3
16/06/2024 23:00	14.3	0.69	438754.9	35.72	0.6	0	33.9
16/06/2024 24:00	14.35	0.74	499127.3	42.8	0.6	0	31.5
Minimum	14.26	0.01	429885.4	0	0.6	0	31.3
MinDate	06/16/2024 22:00:00	06/16/2024 2:00:00	06/16/2024 19:00:00	06/16/2024 2:00:00	06/16/2024 21:00:00	06/16/2024 19:00:00	06/16/2024 22:00:00
Maximum	14.35	0.74	499127.3	42.8	1.2	0	33.9
MaxDate		06/16/2024 18:00:00			06/16/2024 19:00:00	06/16/2024 19:00:00	06/16/2024 23:00:00
Avg	14.3	0.24	451300.1	9.48	0.7	0	32.2
Num	6	24	6	24	6	6	6
Data[%]	25	100	25	100	25	25	25
STD	0	0.3	24363.6	16.5	0.2	0	1.1
Site ABPR52 Daily: 16/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
16/06/2024 01:00	14.45	0.66	494131.7	42.34	0	0	26.3
16/06/2024 02:00	14.46	0.75	497032.3	42.93	0	0	26.3
16/06/2024 03:00	14.47	0.74	496327.1	42.86	0	0	26.1
16/06/2024 04:00	14.48	0.55	496074.5	42.83	0	0	26.6
16/06/2024 05:00	14.49	0.43	497101.2	42.85	0	0	27.1
16/06/2024 06:00	14.49	0.33	496809.3	42.82	0	0	27
16/06/2024 07:00	14.52	0.3	496674.6	42.77	0	0	27.3
16/06/2024 08:00	14.58	0.38	497797.6	42.74	0	0	27.9
16/06/2024 09:00	14.66	0.38	498414	42.7	0	0	28
16/06/2024 10:00	14.71	0.41	499145.5	42.69	0	0	28.2
16/06/2024 11:00	14.77	0.6	500605.7	42.65	0	0	29
16/06/2024 12:00	14.74	0.75	501093.4	42.65	0	0	28.8
16/06/2024 13:00	14.7	0.72	503076.2	42.76	0	0	29.3
16/06/2024 14:00	14.71	0.66	504663.4	42.65	0	0	30
16/06/2024 15:00	14.68	0.28	504023.5	42.71	0	0	30
16/06/2024 16:00	14.65	0.35	503902.2	42.75	0	0	29.5
16/06/2024 17:00	14.58	0.47	500573.5	42.76	0	0	29.3
16/06/2024 18:00	14.52	0.61	483686.9	40.92	0	0	29.6
16/06/2024 19:00	14.41	0.58	425270.8	34.51	0	0	27.3
16/06/2024 20:00	14.36	0.67	444635.8	37.15	0	0	27.2
16/06/2024 21:00	14.37	0.58	445414.5	37.23	0	0	27.3
16/06/2024 22:00	14.36	0.64	446742.4	37.39	0	0	26.8
16/06/2024 23:00	<Samp	0.96	<Samp	21.71	<Samp	<Samp	<Samp
16/06/2024 24:00	Shutdown	0.12	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	14.36	0.12	425270.8	0	0	0	26.1
MinDate	06/16/2024 20:00:00		06/16/2024 19:00:00		06/16/2024 1:00:00	06/16/2024 1:00:00	06/16/2024 3:00:00
Maximum	14.77	0.96	504663.4	42.93	0	0	30
MaxDate	06/16/2024 11:00:00	06/16/2024 23:00:00	06/16/2024 14:00:00	06/16/2024 2:00:00	06/16/2024 1:00:00	06/16/2024 1:00:00	06/16/2024 14:00:00
Avg	14.55	0.54	487872.5	38.97	0	0	28
Num	22	24	22	24	22	22	22
Data[%]	92	100	92	100	92	92	92
STD	0.1	0.2	23573.9	9.5	0	0	1.3
Site ABPR51 Daily: 17/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
17/06/2024 01:00	14.34	0.73	498577.3	42.9	0.6	0	31.7
17/06/2024 02:00	14.34	0.78	498094.9	42.91	0.6	0	32.3
17/06/2024 03:00	14.32	0.83	497010.9	42.9	0.6	0	31.6
17/06/2024 04:00	14.3	1.01	496496.4	42.91	0.7	0	31.4
17/06/2024 05:00	14.3	0.93	496088	42.93	0.7	0	31.4
17/06/2024 06:00	14.32	0.55	495632.3	43.07	0.5	0	32.5
17/06/2024 07:00	14.29	0.67	494369.4	43	0.6	0	32.2
17/06/2024 08:00	14.3	0.9	494903.4	43	0.7	0	32.2
17/06/2024 09:00	14.29	1.01	449555.7	37.41	0.7	0	32.7
17/06/2024 10:00	14.23	1.26	454101.2	38.34	0.8	0	31.6
17/06/2024 11:00	14.25	1.29	452405.3	37.98	0.8	0	31.6
17/06/2024 12:00	14.28	1.05	457868.7	38.44	0.8	0	31.7
17/06/2024 13:00	14.56	0.59	359446.7	24.13	0.5	0	45.2
17/06/2024 14:00	14.28	0.82	456723.4	38.28	0.7	0	31.5
17/06/2024 15:00	14.27	0.92	460174.7	38.63	0.7	0	30.9
17/06/2024 16:00	14.29	0.93	460715.9	38.6	0.7	0	31.3
17/06/2024 17:00	14.31	0.93	461775	38.65	0.7	0	31.7
17/06/2024 18:00	14.3	0.95	460596.1	38.57	0.7	0	31.5
17/06/2024 19:00	14.28	0.95	459522.3	38.59	0.6	0	31.3
17/06/2024 20:00	14.25	0.89	458162.8	38.51	0.7	0	31



17/06/2024 21:00	14.24	0.87	459363.1	38.72	0.7	0	30.7
17/06/2024 22:00	14.23	0.91	460178.6	38.85	0.7	0	30.5
17/06/2024 23:00	14.22	0.84	455876.8	38.38	0.6	0	30.4
17/06/2024 24:00	14.25	0.97	441468.8	36.3	0.7	0	31.9
Minimum	14.22	0.55	359446.7	24.13	0.5	0	30.4
MinDate	06/17/2024 23:00:00	06/17/2024 6:00:00	06/17/2024 13:00:00	06/17/2024 13:00:00	06/17/2024 6:00:00	06/17/2024 1:00:00	06/17/2024 23:00:00
Maximum	14.56	1.29	498577.3	43.07	0.8	0	45.2
MaxDate	06/17/2024 13:00:00	06/17/2024 11:00:00	06/17/2024 1:00:00	06/17/2024 6:00:00	06/17/2024 10:00:00	06/17/2024 1:00:00	06/17/2024 13:00:00
Avg	14.29	0.9	465796.2	39.25	0.7	0	32.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	29855.8	3.9	0.1	0	2.8
Site ABPR52 Daily: 17/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
17/06/2024 01:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 02:00	Shutdown	0.43	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 03:00	Shutdown	2.43	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 04:00	Shutdown	3.58	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 05:00	Shutdown	3.74	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 06:00	Shutdown	1.49	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 07:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 08:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
17/06/2024 09:00	Shutdown	0.86	Shutdown	18.1	Shutdown	Shutdown	Shutdown
17/06/2024 10:00	14.44	0.5	459947.8	38.44	0	0	26.3
17/06/2024 11:00	14.45	0.52	454312.4	38.06	0	0	26.9
17/06/2024 12:00	14.47	0.4	459899	38.52	0	0	26.7
17/06/2024 13:00	14.68	0.26	357016.9	24.2	0	0	37.8
17/06/2024 14:00	14.43	0.45	458225.8	38.36	0	0	26.7
17/06/2024 15:00	14.44	0.52	461030.2	38.7	0	0	26.3
17/06/2024 16:00	14.45	0.6	461378.6	38.68	0	0	26.6
17/06/2024 17:00	14.46	0.66	461992.8	38.75	0	0	26.9
17/06/2024 18:00	14.45	0.61	460762.5	38.65	0	0	26.7
17/06/2024 19:00	14.42	0.55	460418.8	38.7	0	0	26.6
17/06/2024 20:00	14.4	0.58	459015	38.62	0	0	26.2
17/06/2024 21:00	14.4	0.5	460665.8	38.82	0	0	26
17/06/2024 22:00	14.39	0.47	460871.5	38.92	0	0	25.7
17/06/2024 23:00	14.39	0.44	456723.1	38.47	0	0	25.6
17/06/2024 24:00	14.42	0.5	441957.4	36.43	0	0	26.9
Minimum	14.39	0.03	357016.9	0	0	0	25.6
MinDate	06/17/2024 22:00:00	06/17/2024 1:00:00	06/17/2024 13:00:00	06/17/2024 1:00:00	06/17/2024 10:00:00	06/17/2024 10:00:00	06/17/2024 23:00:00
Maximum	14.68	3.74	461992.8	38.92	0	0	37.8
MaxDate	06/17/2024 13:00:00	06/17/2024 5:00:00	06/17/2024 17:00:00	06/17/2024 22:00:00	06/17/2024 10:00:00	06/17/2024 10:00:00	06/17/2024 13:00:00
Avg	14.45	0.84	451614.5	24.18	0	0	27.2
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	1	26635.3	18.1	0	0	3
Site ABPR51 Daily: 18/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW MG/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
18/06/2024 01:00	14.16	0.76	405661.9	32.54	0.6	0	32.8
18/06/2024 02:00	14.14	0.78	411878.1	33.53	0.7	0	31.4
18/06/2024 03:00	14.15	0.77	411949.9	33.44	0.8	0	31.8
18/06/2024 04:00	14.16	0.77	408428.2	32.97	0.7	0	32.6
18/06/2024 05:00	14.2	0.66	403096.3	32.13	0.7	0	34.5
18/06/2024 06:00	14.21	0.78	404780.9	32.44	0.8	0	34.7
18/06/2024 07:00	14.22	0.78	400553.3	31.82	0.7	0	35.6
18/06/2024 08:00	14.22	0.85	400913	31.77	0.8	0	35.3
18/06/2024 09:00	14.31	0.65	405346.3	31.63	0.7	0	35.6
18/06/2024 10:00	14.29	0.75	452481.1	37.78	0.7	0	32.1
18/06/2024 11:00	14.31	0.79	454658.5	37.85	0.7	0	32.4
18/06/2024 12:00	14.32	0.85	456869.5	38.05	0.7	0	32.3
18/06/2024 13:00	14.64	0.75	355980	23.36	0.5	0	49.8
18/06/2024 14:00	14.32	0.94	455194.1	37.86	0.7	0	32.3
18/06/2024 15:00	14.37	0.93	461900	38.33	0.8	0	32.9
18/06/2024 16:00	14.41	0.9	470371.5	39.04	0.8	0	33
18/06/2024 17:00	14.42	0.87	473951.8	39.37	0.8	0	33.2
18/06/2024 18:00	14.4	0.84	468017	38.8	0.8	0	32.8
18/06/2024 19:00	14.29	0.67	460150.8	38.49	0.6	0	31
18/06/2024 20:00	14.27	0.81	461964.6	38.85	0.6	0	30.8
18/06/2024 21:00	14.28	0.88	465687.2	39.23	0.7	0	30.8
18/06/2024 22:00	14.29	0.9	474660.8	40.13	0.7	0	30.6
18/06/2024 23:00	14.28	0.86	472762.7	40.02	0.8	0	30.5
18/06/2024 24:00	14.31	0.87	450091.5	36.91	0.7	0	32.9
Minimum	14.14	0.65	355980	23.36	0.5	0	30.5
MinDate	06/18/2024 2:00:00	06/18/2024 9:00:00	06/18/2024 13:00:00	06/18/2024 13:00:00	06/18/2024 13:00:00	06/18/2024 1:00:00	06/18/2024 23:00:00
Maximum	14.64	0.94	474660.8	40.13	0.8	0	49.8
MaxDate	06/18/2024 13:00:00	06/18/2024 14:00:00	06/18/2024 22:00:00	06/18/2024 22:00:00	06/18/2024 3:00:00	06/18/2024 1:00:00	06/18/2024 13:00:00
Avg	14.29	0.81	436972.9	35.68	0.7	0	33.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	33381.9	4.1	0.1	0	3.8
Site ABPR52 Daily: 18/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
18/06/2024 01:00	14.35	0.41	405300.5	32.62	0	0	27.5
18/06/2024 02:00	14.31	0.46	411894.1	33.62	0	0	26.1
18/06/2024 03:00	14.34	0.5	411736	33.53	0	0	26.4
18/06/2024 04:00	14.35	0.59	408460.9	33.04	0	0	27
18/06/2024 05:00	14.4	0.46	402874.9	32.19	0	0	28.7
18/06/2024 06:00	14.39	0.58	404961.2	32.52	0	0	29
18/06/2024 07:00	14.4	0.59	400213.6	31.89	0	0	29.9
18/06/2024 08:00	14.41	0.75	400795.5	31.85	0	0	29.4
18/06/2024 09:00	14.51	0.66	404720.1	31.71	0	0	29.3
18/06/2024 10:00	14.53	0.59	452986.3	37.89	0	0	26.9
18/06/2024 11:00	14.55	0.59	454071.7	37.94	0	0	27.2
18/06/2024 12:00	14.54	0.46	456486.3	38.15	0	0	27.1
18/06/2024 13:00	14.77	0.62	352843.5	23.43	0	0	41.9
18/06/2024 14:00	14.48	0.68	454575.2	37.93	0	0	27.2
18/06/2024 15:00	14.51	0.79	460443.2	38.42	0	0	27.4
18/06/2024 16:00	14.56	0.9	468697.6	39.14	0	0	27.4
18/06/2024 17:00	14.6	0.83	471825.7	39.46	0	0	27.6
18/06/2024 18:00	14.58	0.71	466070.6	38.88	0	0	27.3
18/06/2024 19:00	14.44	0.3	459730.1	38.57	0	0	26



18/06/2024 20:00	14.39	0.34	461967.1	38.96	0	0	25.9
18/06/2024 21:00	14.4	0.5	466103.4	39.35	0	0	26
18/06/2024 22:00	14.41	0.46	474489.8	40.22	0	0	25.8
18/06/2024 23:00	14.41	0.44	472729.5	40.08	0	0	25.8
18/06/2024 24:00	14.41	0.77	466539.3	33.88	0	0	25.8
Minimum	14.31	0.3	352843.5	23.43	0	0	25.8
MinDate	06/18/2024 2:00:00	06/18/2024 19:00:00	06/18/2024 13:00:00	06/18/2024 13:00:00	06/18/2024 1:00:00	06/18/2024 1:00:00	06/18/2024 22:00:00
Maximum	14.77	0.9	474489.8	40.22	0	0	41.9
MaxDate	06/18/2024 13:00:00	06/18/2024 16:00:00	06/18/2024 22:00:00	06/18/2024 22:00:00	06/18/2024 1:00:00	06/18/2024 1:00:00	06/18/2024 13:00:00
Avg	14.46	0.58	437104.8	35.64	0	0	27.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.2	33916.2	4.1	0	0	3.2
Site ABPR51 Daily: 19/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
19/06/2024 01:00	14.32	0.88	493851.3	42.24	0.6	0	31.4
19/06/2024 02:00	14.33	0.82	496777.2	42.82	0.7	0	31.3
19/06/2024 03:00	14.33	0.81	497219.5	42.84	0.7	0	31.7
19/06/2024 04:00	14.34	0.8	497592.5	42.83	0.7	0	32.2
19/06/2024 05:00	14.34	0.84	497060	42.85	0.7	0	32.4
19/06/2024 06:00	14.34	0.83	497286.9	42.93	0.7	0	32.4
19/06/2024 07:00	14.34	0.79	497351	42.85	0.8	0	32.8
19/06/2024 08:00	14.35	0.63	498756.2	42.85	0.8	0	32.8
19/06/2024 09:00	14.38	0.6	449899.3	36.79	0.7	0	35.4
19/06/2024 10:00	14.37	0.65	470669.5	39.42	0.8	0	32.3
19/06/2024 11:00	14.38	0.56	459948.3	38.25	0.8	0	33
19/06/2024 12:00	14.37	0.65	453744.7	37.59	0.8	0	32.8
19/06/2024 13:00	14.54	0.65	358478.1	23.76	0.5	0	47.7
19/06/2024 14:00	14.24	0.89	452540.1	37.95	0.7	0	30
19/06/2024 15:00	14.24	0.8	454892.9	38.17	0.7	0	29.5
19/06/2024 16:00	14.22	0.79	451939.7	37.93	0.6	0	30
19/06/2024 17:00	14.22	0.86	449453.3	37.72	0.6	0	30.3
19/06/2024 18:00	14.22	0.86	448196	37.56	0.7	0	30.3
19/06/2024 19:00	14.22	0.78	452613.8	38.07	0.6	0	29.6
19/06/2024 20:00	14.23	0.8	467328.8	39.59	0.6	0	29.4
19/06/2024 21:00	14.22	0.85	466732.5	39.58	0.6	0	29.2
19/06/2024 22:00	14.24	0.82	477162.1	40.59	0.6	0	28.9
19/06/2024 23:00	14.26	0.9	481344.4	41.04	0.6	0	28.9
19/06/2024 24:00	14.27	0.97	468595.9	36.97	0.6	0	30.2
Minimum	14.22	0.56	358478.1	23.76	0.5	0	28.9
MinDate	06/19/2024 16:00:00	06/19/2024 11:00:00	06/19/2024 13:00:00	06/19/2024 13:00:00	06/19/2024 13:00:00	06/19/2024 1:00:00	06/19/2024 22:00:00
Maximum	14.54	0.97	498756.2	42.93	0.8	0	47.7
MaxDate	06/19/2024 13:00:00	06/19/2024 8:00:00	06/19/2024 6:00:00	06/19/2024 7:00:00	06/19/2024 7:00:00	06/19/2024 1:00:00	06/19/2024 13:00:00
Avg	14.3	0.78	468309.8	39.3	0.7	0	31.9
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30386.8	4	0.1	0	3.8
Site ABPR52 Daily: 19/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
19/06/2024 01:00	Shutdown	0.48	Shutdown	0.38	Shutdown	Shutdown	Shutdown
19/06/2024 02:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
19/06/2024 03:00	Shutdown	0.18	Shutdown	0	Shutdown	Shutdown	Shutdown
19/06/2024 04:00	Shutdown	1.7	Shutdown	0	Shutdown	Shutdown	Shutdown
19/06/2024 05:00	Shutdown	3.38	Shutdown	0	Shutdown	Shutdown	Shutdown
19/06/2024 06:00	Shutdown	1.97	Shutdown	0	Shutdown	Shutdown	Shutdown
19/06/2024 07:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
19/06/2024 08:00	Shutdown	0.06	Shutdown	0	Shutdown	Shutdown	Shutdown
19/06/2024 09:00	<Samp	0.79	<Samp	20.03	<Samp	<Samp	<Samp
19/06/2024 10:00	14.67	0.47	475730	39.6	0	0	26.8
19/06/2024 11:00	14.7	0.38	461126.1	38.34	0	0	27.9
19/06/2024 12:00	14.68	0.58	454084.1	37.67	0	0	27.8
19/06/2024 13:00	14.87	0.71	357697	23.71	0	0	40.3
19/06/2024 14:00	14.57	0.73	458101.3	38.04	0	0	27.6
19/06/2024 15:00	14.51	0.58	457654.1	38.25	0	0	26.4
19/06/2024 16:00	14.41	0.48	452004.1	38.02	0	0	25.7
19/06/2024 17:00	14.38	0.53	449045.2	37.81	0	0	25.9
19/06/2024 18:00	14.37	0.58	447556.6	37.66	0	0	25.9
19/06/2024 19:00	14.34	0.28	452686	38.15	0	0	25.1
19/06/2024 20:00	14.36	0.35	468149.1	39.69	0	0	24.9
19/06/2024 21:00	14.35	0.48	467226.1	39.66	0	0	24.7
19/06/2024 22:00	14.38	0.52	478157.9	40.7	0	0	24.4
19/06/2024 23:00	14.4	0.5	482515.8	41.14	0	0	24.4
19/06/2024 24:00	14.4	0.73	474340.1	35.51	0	0	24.9
Minimum	14.34	0.04	357697	0	0	0	24.4
MinDate	06/19/2024 19:00:00	06/19/2024 7:00:00	06/19/2024 13:00:00	06/19/2024 2:00:00	06/19/2024 10:00:00	06/19/2024 10:00:00	06/19/2024 22:00:00
Maximum	14.87	3.38	482515.8	41.14	0	0	40.3
MaxDate	06/19/2024 13:00:00	06/19/2024 5:00:00	06/19/2024 23:00:00	06/19/2024 23:00:00	06/19/2024 10:00:00	06/19/2024 10:00:00	06/19/2024 13:00:00
Avg	14.49	0.69	455738.2	24.35	0	0	26.8
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.2	0.7	29325.4	18.2	0	0	3.9
Site ABPR51 Daily: 20/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
20/06/2024 01:00	14.31	0.84	488281.2	41.82	0.7	0	32.6
20/06/2024 02:00	14.28	0.78	495813.1	42.9	0.7	0	30.4
20/06/2024 03:00	14.28	0.72	495264.4	42.91	0.7	0	30.5
20/06/2024 04:00	14.28	0.78	494727.2	42.9	0.7	0	30.7
20/06/2024 05:00	14.28	0.81	494594.7	42.92	0.6	0	30.7
20/06/2024 06:00	14.28	0.79	495209	42.98	0.7	0	30.7
20/06/2024 07:00	14.28	0.67	494156.4	42.88	0.7	0	30.8
20/06/2024 08:00	14.29	0.47	494478.1	42.86	0.7	0	30.5
20/06/2024 09:00	14.3	0.45	454806.6	37.93	0.7	0	32.6
20/06/2024 10:00	14.28	0.53	469891.1	39.85	0.7	0	29.6
20/06/2024 11:00	14.24	0.54	452856	38.07	0.6	0	30
20/06/2024 12:00	14.23	0.57	449645.9	37.71	0.7	0	30.2
20/06/2024 13:00	14.55	0.68	357387.9	23.67	0.5	0	49
20/06/2024 14:00	14.25	0.83	452778.1	37.94	0.7	0	30.1
20/06/2024 15:00	14.26	0.78	455016.8	38.1	0.7	0	30.2
20/06/2024 16:00	14.25	0.59	455073.8	38.12	0.7	0	29.8
20/06/2024 17:00	14.25	0.66	455530.2	38.23	0.8	0	29.7
20/06/2024 18:00	14.24	0.65	454692.8	38.15	0.7	0	29.7



20/06/2024 19:00	14.25	0.79	458927.3	38.61	0.6	0	29.7
20/06/2024 20:00	14.24	0.89	464482.8	39.29	0.5	0	29.7
20/06/2024 21:00	14.24	0.9	468235.6	39.72	0.6	0	29.3
20/06/2024 22:00	14.26	0.93	481878	41.18	0.6	0	28.9
20/06/2024 23:00	14.25	0.9	484707.9	41.39	0.7	0	28.8
20/06/2024 24:00	14.32	0.73	456609.8	37.69	0.7	0	33.4
Minimum	14.23	0.45	357387.9	23.67	0.5	0	28.8
MinDate	06/20/2024 12:00:00	06/20/2024 9:00:00	06/20/2024 13:00:00	06/20/2024 13:00:00	06/20/2024 13:00:00	06/20/2024 1:00:00	06/20/2024 23:00:00
Maximum	14.55	0.93	495813.1	42.98	0.8	0	49
MaxDate	06/20/2024 13:00:00	06/20/2024 22:00:00	06/20/2024 2:00:00	06/20/2024 6:00:00	06/20/2024 17:00:00	06/20/2024 1:00:00	06/20/2024 13:00:00
Avg	14.28	0.72	467710.2	39.49	0.7	0	31.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	29524.2	4	0.1	0	4
Site ABPR52 Daily: 20/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
20/06/2024 01:00	Shutdown	0.52	Shutdown	0.46	Shutdown	Shutdown	Shutdown
20/06/2024 02:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
20/06/2024 03:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
20/06/2024 04:00	Shutdown	0.56	Shutdown	0	Shutdown	Shutdown	Shutdown
20/06/2024 05:00	Shutdown	1.97	Shutdown	0	Shutdown	Shutdown	Shutdown
20/06/2024 06:00	Shutdown	0.8	Shutdown	0	Shutdown	Shutdown	Shutdown
20/06/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
20/06/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
20/06/2024 09:00	<Samp	0.75	<Samp	19.54	<Samp	<Samp	<Samp
20/06/2024 10:00	14.6	0.36	475519.1	39.96	0	0	24.9
20/06/2024 11:00	14.56	0.4	454215.1	38.16	0	0	26
20/06/2024 12:00	14.53	0.54	449942.1	37.79	0	0	26.1
20/06/2024 13:00	14.8	0.92	353707.8	23.72	0	0	43.2
20/06/2024 14:00	14.48	0.76	452906.1	38.04	0	0	26
20/06/2024 15:00	14.45	0.61	454423.1	38.17	0	0	25.9
20/06/2024 16:00	14.46	0.36	454795.8	38.21	0	0	25.5
20/06/2024 17:00	14.45	0.43	455529.1	38.33	0	0	25.4
20/06/2024 18:00	14.45	0.4	454590.8	38.22	0	0	25.4
20/06/2024 19:00	14.43	0.36	458274.2	38.69	0	0	25.4
20/06/2024 20:00	14.37	0.34	465387.5	39.39	0	0	25.2
20/06/2024 21:00	14.35	0.49	469247.7	39.82	0	0	24.8
20/06/2024 22:00	14.37	0.63	483919.5	41.27	0	0	24.5
20/06/2024 23:00	14.39	0.73	485421.2	41.49	0	0	24.5
20/06/2024 24:00	14.41	0.65	477855.1	35.17	0	0	25
Minimum	14.35	0	353707.8	0	0	0	24.5
MinDate	06/20/2024 21:00:00	06/20/2024 7:00:00	06/20/2024 13:00:00	06/20/2024 2:00:00	06/20/2024 10:00:00	06/20/2024 10:00:00	06/20/2024 22:00:00
Maximum	14.8	1.97	485421.2	41.49	0	0	43.2
MaxDate	06/20/2024 13:00:00	06/20/2024 5:00:00	06/20/2024 23:00:00	06/20/2024 23:00:00	06/20/2024 10:00:00	06/20/2024 10:00:00	06/20/2024 13:00:00
Avg	14.47	0.53	456382.2	24.43	0	0	26.5
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	30811	18.3	0	0	4.6
Site ABPR51 Daily: 21/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
21/06/2024 01:00	14.3	0.65	496004.6	42.87	0.7	0	30.5
21/06/2024 02:00	14.29	0.68	495704.3	43.01	0.7	0	30.7
21/06/2024 03:00	14.28	0.7	495305.5	43.01	0.7	0	30.6
21/06/2024 04:00	14.28	0.74	495473.2	43.01	0.7	0	30.4
21/06/2024 05:00	14.28	0.68	495723	43.01	0.7	0	30.5
21/06/2024 06:00	14.28	0.65	495541.9	43.06	0.7	0	30.7
21/06/2024 07:00	14.28	0.69	494592.2	42.99	0.7	0	30.8
21/06/2024 08:00	14.29	0.7	495169.5	43	0.7	0	30.5
21/06/2024 09:00	14.29	0.49	450413.4	37.41	0.7	0	32.5
21/06/2024 10:00	14.28	0.59	478870.6	40.84	0.7	0	29.4
21/06/2024 11:00	14.28	0.68	477329.5	40.63	0.7	0	29.3
21/06/2024 12:00	14.28	0.69	475743.2	40.3	0.7	0	29.4
21/06/2024 13:00	14.47	0.54	365971.1	25.66	0.6	0	42
21/06/2024 14:00	14.29	0.6	476521.2	40.44	0.7	0	29.4
21/06/2024 15:00	14.28	0.67	477335.4	40.57	0.8	0	29.5
21/06/2024 16:00	14.28	0.7	478469.6	40.7	0.7	0	29.6
21/06/2024 17:00	14.28	0.87	478525.7	40.74	0.6	0	29.5
21/06/2024 18:00	14.27	0.91	476537.1	40.59	0.6	0	29.2
21/06/2024 19:00	14.26	0.91	478402.5	40.81	0.6	0	28.9
21/06/2024 20:00	14.26	0.92	479479.4	40.91	0.6	0	28.9
21/06/2024 21:00	14.24	0.87	474924.3	40.45	0.7	0	28.6
21/06/2024 22:00	14.24	0.9	476334.7	40.52	0.6	0	28.5
21/06/2024 23:00	14.26	0.85	479286.8	40.87	0.6	0	28.9
21/06/2024 24:00	14.32	0.85	454684	37.52	0.6	0	33.6
Minimum	14.24	0.49	365971.1	25.66	0.6	0	28.5
MinDate	06/21/2024 21:00:00	06/21/2024 9:00:00	06/21/2024 13:00:00	06/21/2024 13:00:00	06/21/2024 13:00:00	06/21/2024 1:00:00	06/21/2024 22:00:00
Maximum	14.47	0.92	496004.6	43.06	0.8	0	42
MaxDate	06/21/2024 13:00:00	06/21/2024 20:00:00	06/21/2024 1:00:00	06/21/2024 6:00:00	06/21/2024 15:00:00	06/21/2024 1:00:00	06/21/2024 13:00:00
Avg	14.29	0.73	476764.2	40.54	0.7	0	30.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	26606.3	3.5	0.1	0	2.7
Site ABPR52 Daily: 21/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
21/06/2024 01:00	Shutdown	0.31	Shutdown	0.13	Shutdown	Shutdown	Shutdown
21/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
21/06/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
21/06/2024 04:00	Shutdown	0.43	Shutdown	0	Shutdown	Shutdown	Shutdown
21/06/2024 05:00	Shutdown	1.42	Shutdown	0	Shutdown	Shutdown	Shutdown
21/06/2024 06:00	Shutdown	1.81	Shutdown	0	Shutdown	Shutdown	Shutdown
21/06/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
21/06/2024 08:00	Shutdown	0.05	Shutdown	0	Shutdown	Shutdown	Shutdown
21/06/2024 09:00	Shutdown	0.98	Shutdown	19.18	Shutdown	Shutdown	Shutdown
21/06/2024 10:00	14.66	0.58	491645.3	41.1	0	0	27.1
21/06/2024 11:00	14.66	0.66	486404.1	40.8	0	0	27.5
21/06/2024 12:00	14.66	0.78	482777.8	40.35	0	0	27.7
21/06/2024 13:00	14.79	0.74	366554.5	25.77	0	0	33.5
21/06/2024 14:00	14.67	0.48	485308.2	40.49	0	0	27.9
21/06/2024 15:00	14.65	0.43	486234.3	40.69	0	0	28.4
21/06/2024 16:00	14.6	0.34	486487	40.83	0	0	28
21/06/2024 17:00	14.5	0.31	482971.3	40.83	0	0	27.4



21/06/2024 18:00	14.44	0.33	480922.5	40.71	0	0	26.2
21/06/2024 19:00	14.42	0.44	482450.8	40.95	0	0	25.9
21/06/2024 20:00	14.42	0.53	483227.8	41	0	0	25.7
21/06/2024 21:00	14.42	0.62	478188.7	40.53	0	0	25.4
21/06/2024 22:00	14.41	0.66	477984.6	40.62	0	0	24.9
21/06/2024 23:00	14.4	0.51	480326.9	40.97	0	0	24.6
21/06/2024 24:00	14.4	0.74	473793.8	35.42	0	0	25.2
Minimum	14.4	0	366554.5	0	0	0	24.6
MinDate	06/21/2024 23:00:00	06/21/2024 2:00:00	06/21/2024 13:00:00	06/21/2024 2:00:00	06/21/2024 10:00:00	06/21/2024 10:00:00	06/21/2024 23:00:00
Maximum	14.79	1.81	491645.3	41.1	0	0	33.5
MaxDate	06/21/2024 13:00:00	06/21/2024 6:00:00	06/21/2024 10:00:00	06/21/2024 10:00:00	06/21/2024 10:00:00	06/21/2024 10:00:00	06/21/2024 13:00:00
Avg	14.54	0.55	475018.5	25.43	0	0	27
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	30311.5	19.1	0	0	2.2

Site ABPR51 Daily: 22/06/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
22/06/2024 01:00	14.28	0.78	494603.5	42.73	0.7	0	30.6
22/06/2024 02:00	14.28	0.78	495839.2	43	0.6	0	30.5
22/06/2024 03:00	14.28	0.79	495154.8	43.04	0.6	0	30.6
22/06/2024 04:00	14.28	0.81	495109.3	43.05	0.6	0	30.7
22/06/2024 05:00	14.28	0.82	494933.1	43.01	0.6	0	30.7
22/06/2024 06:00	14.28	0.83	495532.6	43.09	0.6	0	30.8
22/06/2024 07:00	14.28	0.78	495046.1	43.06	0.7	0	30.8
22/06/2024 08:00	14.28	0.78	495364.1	43.08	0.7	0	30.6
22/06/2024 09:00	14.31	0.71	422025.3	33.7	0.6	0	36.1
22/06/2024 10:00	14.22	0.65	393208.6	30.87	0.7	0	33.8
22/06/2024 11:00	14.22	0.68	393645	30.84	0.7	0	34
22/06/2024 12:00	14.2	0.64	394474.5	30.74	0.7	0	33.7
22/06/2024 13:00	14.67	0.64	345723.5	21.6	0.4	0	57.7
22/06/2024 14:00	14.23	0.67	393732.2	30.91	0.7	0	34.8
22/06/2024 15:00	14.22	0.67	393831.1	30.85	0.7	0	34.2
22/06/2024 16:00	14.22	0.67	393654.6	30.85	0.7	0	33.9
22/06/2024 17:00	14.22	0.67	394017.7	30.89	0.6	0	33.7
22/06/2024 18:00	14.22	0.67	393844.8	30.89	0.6	0	33.5
22/06/2024 19:00	14.23	0.76	410895.5	32.82	0.6	0	35.3
22/06/2024 20:00	14.26	0.96	476488	40.52	0.5	0	29.3
22/06/2024 21:00	14.27	0.91	472874.5	40.25	0.5	0	29.4
22/06/2024 22:00	14.28	0.89	474799.4	40.46	0.5	0	29.5
22/06/2024 23:00	14.27	0.88	468625.2	39.85	0.6	0	29.9
22/06/2024 24:00	14.29	0.85	447019.4	36.34	0.5	0	33.6
Minimum	14.2	0.64	345723.5	21.6	0.4	0	29.3
MinDate	06/22/2024 12:00:00	06/22/2024 12:00:00	06/22/2024 13:00:00	06/22/2024 13:00:00	06/22/2024 13:00:00	06/22/2024 1:00:00	06/22/2024 20:00:00
Maximum	14.67	0.96	495839.2	43.09	0.7	0	57.7
MaxDate	06/22/2024 13:00:00	06/22/2024 20:00:00	06/22/2024 2:00:00	06/22/2024 6:00:00	06/22/2024 1:00:00	06/22/2024 1:00:00	06/22/2024 13:00:00
Avg	14.27	0.76	442935	36.52	0.6	0	33.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	49254.5	6.2	0.1	0	5.6

Site ABPR52 Daily: 22/06/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
22/06/2024 01:00	Shutdown	0.41	Shutdown	0.3	Shutdown	Shutdown	Shutdown
22/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
22/06/2024 03:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
22/06/2024 04:00	Shutdown	0.37	Shutdown	0	Shutdown	Shutdown	Shutdown
22/06/2024 05:00	Shutdown	1.32	Shutdown	0	Shutdown	Shutdown	Shutdown
22/06/2024 06:00	Shutdown	1.51	Shutdown	0	Shutdown	Shutdown	Shutdown
22/06/2024 07:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
22/06/2024 08:00	Shutdown	0.08	Shutdown	0	Shutdown	Shutdown	Shutdown
22/06/2024 09:00	Shutdown	0.9	Shutdown	15.38	Shutdown	Shutdown	Shutdown
22/06/2024 10:00	14.44	0.46	397076	30.99	0	0	29.4
22/06/2024 11:00	14.46	0.6	395801	30.92	0	0	29.9
22/06/2024 12:00	14.47	0.66	397123	30.81	0	0	29.8
22/06/2024 13:00	14.91	0.83	341240.4	21.19	0	0	54.5
22/06/2024 14:00	14.45	0.68	395330.4	31.07	0	0	29.8
22/06/2024 15:00	14.47	0.65	395619.3	30.92	0	0	30.1
22/06/2024 16:00	14.48	0.51	395636.3	30.93	0	0	30.1
22/06/2024 17:00	14.43	0.41	395810.7	30.96	0	0	29.6
22/06/2024 18:00	14.41	0.38	395347.8	30.97	0	0	29.2
22/06/2024 19:00	14.41	0.33	409943.3	32.71	0	0	29.3
22/06/2024 20:00	14.45	0.26	478976.2	40.49	0	0	26.7
22/06/2024 21:00	14.46	0.32	476586.3	40.36	0	0	26.5
22/06/2024 22:00	14.47	0.41	478425.3	40.55	0	0	26.5
22/06/2024 23:00	14.46	0.47	472788.3	39.96	0	0	26.8
22/06/2024 24:00	14.44	0.71	462482.5	34.15	0	0	26.5
Minimum	14.41	0	341240.4	0	0	0	26.5
MinDate	06/22/2024 18:00:00	06/22/2024 2:00:00	06/22/2024 13:00:00	06/22/2024 2:00:00	06/22/2024 10:00:00	06/22/2024 10:00:00	06/22/2024 21:00:00
Maximum	14.91	1.51	478976.2	40.55	0	0	54.5
MaxDate	06/22/2024 13:00:00	06/22/2024 6:00:00	06/22/2024 20:00:00	06/22/2024 22:00:00	06/22/2024 10:00:00	06/22/2024 10:00:00	06/22/2024 13:00:00
Avg	14.48	0.51	419212.5	21.36	0	0	30.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	42765.1	16.3	0	0	6.9

Site ABPR51 Daily: 23/05/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
23/05/2024 01:00	14.19	1.13	390968.8	30.16	0.3	0	34.3
23/05/2024 02:00	14.15	0.82	399468.6	31.56	0.2	0	33.6
23/05/2024 03:00	14.15	1	396172.5	31.32	0.1	0	35.1
23/05/2024 04:00	14.16	1.07	392707.8	30.66	0.1	0	34.6
23/05/2024 05:00	14.19	1.23	390360.3	30.1	0.1	0	33.8
23/05/2024 06:00	14.17	0.7	391632.7	30.37	0.1	0	34.1
23/05/2024 07:00	14.18	1.08	392689.8	30.53	0.1	0	34.6
23/05/2024 08:00	14.17	1.07	393137.7	30.6	0.2	0	34.4
23/05/2024 09:00	14.17	0.94	393793.6	30.74	0.2	0	34.1
23/05/2024 10:00	14.21	1.15	433005.5	35.34	0.2	0	32.9
23/05/2024 11:00	14.14	1.21	449276.6	37.78	0.2	0	30
23/05/2024 12:00	14.15	1.27	457669.7	38.57	0.2	0	29.6
23/05/2024 13:00	14.37	0.95	385191.7	28.04	0.1	0	39.5
23/05/2024 14:00	14.24	0.91	440525.5	35.96	0	0	32.4
23/05/2024 15:00	14.17	1.12	469864	39.94	0.1	0	29.9
23/05/2024 16:00	14.15	0.96	454777.9	38.38	0.2	0	30



23/05/2024 17:00	14.17	1.18	463358.6	39.25	0.2	0	29.5
23/05/2024 18:00	14.17	1.17	468011.5	39.67	0.1	0	29.3
23/05/2024 19:00	14.17	1.18	470814.9	39.95	0.2	0	29.3
23/05/2024 20:00	14.19	1.31	472440.3	40.15	0.2	0	29.6
23/05/2024 21:00	14.16	1.05	464662.7	39.39	0.2	0	30
23/05/2024 22:00	14.21	1.14	476323.1	40.65	0.2	0	30.3
23/05/2024 23:00	14.2	1.05	478396.8	40.81	0.2	0	30
23/05/2024 24:00	14.18	0.85	467513.2	39.71	0.1	0	30.4
Minimum	14.14	0.7	385191.7	28.04	0	0	29.3
MinDate	05/23/2024 11:00:00	05/23/2024 6:00:00	05/23/2024 13:00:00	05/23/2024 13:00:00	05/23/2024 14:00:00	05/23/2024 1:00:00	05/23/2024 18:00:00
Maximum	14.37	1.31	478396.8	40.81	0.3	0	39.5
MaxDate	05/23/2024 13:00:00	05/23/2024 20:00:00	05/23/2024 23:00:00	05/23/2024 23:00:00	05/23/2024 1:00:00	05/23/2024 1:00:00	05/23/2024 13:00:00
Avg	14.18	1.06	433031.8	35.4	0.2	0	32.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0	0.1	36394.4	4.5	0.1	0	2.7
Site ABPR52 Daily: 23/05/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
23/05/2024 01:00	14.45	0.6	390255.3	30.23	0	0	29.9
23/05/2024 02:00	14.41	0.41	398759.6	31.64	0	0	29.5
23/05/2024 03:00	14.41	0.47	395851	31.39	0	0	30.6
23/05/2024 04:00	14.41	0.61	392015.4	30.74	0	0	29.8
23/05/2024 05:00	14.38	0.7	388321.2	30.17	0	0	28.9
23/05/2024 06:00	14.36	0.51	390559.7	30.45	0	0	29.1
23/05/2024 07:00	14.36	0.82	391141.3	30.62	0	0	29.5
23/05/2024 08:00	14.36	0.41	391858.2	30.68	0	0	29.4
23/05/2024 09:00	14.4	0.4	392776.8	30.82	0	0	29.3
23/05/2024 10:00	14.46	0.45	433264.1	35.41	0	0	29
23/05/2024 11:00	14.45	0.42	450839.8	37.86	0	0	27
23/05/2024 12:00	14.47	0.43	459882.5	38.67	0	0	27
23/05/2024 13:00	14.64	0.39	383597.8	28.13	0	0	34.1
23/05/2024 14:00	14.49	0.31	441934.9	36.06	0	0	28
23/05/2024 15:00	14.41	0.57	471895.7	40.03	0	0	26.7
23/05/2024 16:00	14.4	0.46	456774.6	38.46	0	0	26.9
23/05/2024 17:00	14.45	0.39	466227.5	39.34	0	0	26.6
23/05/2024 18:00	14.42	0.33	469734.3	39.75	0	0	26.4
23/05/2024 19:00	14.41	0.36	472452.6	40.07	0	0	26.3
23/05/2024 20:00	14.41	0.27	474339.8	40.26	0	0	26.5
23/05/2024 21:00	14.39	0.27	467062.8	39.61	0	0	26.8
23/05/2024 22:00	14.41	0.23	480115.5	40.98	0	0	27
23/05/2024 23:00	14.4	0.25	482212.5	41.17	0	0	27
23/05/2024 24:00	14.39	0.26	470014.7	39.9	0	0	27
Minimum	14.36	0.23	383597.8	28.13	0	0	26.3
MinDate	05/23/2024 6:00:00	05/23/2024 22:00:00	05/23/2024 13:00:00	05/23/2024 13:00:00	05/23/2024 1:00:00	05/23/2024 1:00:00	05/23/2024 19:00:00
Maximum	14.64	0.82	482212.5	41.17	0	0	34.1
MaxDate	05/23/2024 13:00:00	05/23/2024 7:00:00	05/23/2024 23:00:00	05/23/2024 23:00:00	05/23/2024 1:00:00	05/23/2024 1:00:00	05/23/2024 13:00:00
Avg	14.42	0.43	433828.6	35.52	0	0	28.3
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	38126.6	4.6	0	0	1.9
Site ABPR51 Daily: 24/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
24/06/2024 01:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 02:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 03:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 04:00	Shutdown	1.03	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 05:00	Shutdown	1.5	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 06:00	Shutdown	1.09	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 08:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
24/06/2024 09:00	<Samp	0.83	<Samp	18.88	<Samp	<Samp	<Samp
24/06/2024 10:00	14.26	0.79	453970.4	37.95	0.5	0	29.4
24/06/2024 11:00	14.24	0.75	450348.6	37.71	0.6	0	29.9
24/06/2024 12:00	14.24	0.73	447734.5	37.44	0.6	0	29.9
24/06/2024 13:00	14.57	0.68	356681.7	23.75	0.4	0	48.9
24/06/2024 14:00	14.22	0.92	517035.5	45.63	0.7	0	41.4
24/06/2024 15:00	14.22	0.98	520123.2	45.98	0.7	0	44.4
24/06/2024 16:00	14.33	0.82	431677.3	34.77	0.6	0	38.5
24/06/2024 17:00	14.35	0.75	389455.4	29.69	0.5	0	35.9
24/06/2024 18:00	14.33	0.83	419710.8	33.54	0.5	0	33.8
24/06/2024 19:00	14.3	0.93	465645.3	39.16	0.5	0	31.6
24/06/2024 20:00	14.32	0.92	467862.3	39.48	0.5	0	31.9
24/06/2024 21:00	14.34	0.95	470317.9	39.69	0.5	0	31.9
24/06/2024 22:00	14.34	0.95	472370.7	39.86	0.5	0	32.4
24/06/2024 23:00	14.34	0.93	465539	39.21	0.5	0	32.7
24/06/2024 24:00	14.37	0.91	447716.6	36.19	0.5	0	36
Minimum	14.22	0.01	356681.7	0	0.4	0	29.4
MinDate	06/24/2024 14:00:00	06/24/2024 1:00:00	06/24/2024 13:00:00	06/24/2024 1:00:00	06/24/2024 13:00:00	06/24/2024 10:00:00	06/24/2024 10:00:00
Maximum	14.57	1.5	520123.2	45.98	0.7	0	48.9
MaxDate	06/24/2024 13:00:00	06/24/2024 5:00:00	06/24/2024 15:00:00	06/24/2024 15:00:00	06/24/2024 14:00:00	06/24/2024 10:00:00	06/24/2024 13:00:00
Avg	14.32	0.73	451746	24.12	0.5	0	35.2
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	42035.1	18.3	0.1	0	5.8
Site ABPR52 Daily: 24/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
24/06/2024 01:00	14.49	0.47	496203.9	42.84	0	0	28.1
24/06/2024 02:00	14.49	0.44	495626.4	42.83	0	0	28.1
24/06/2024 03:00	14.47	0.41	495285.3	42.83	0	0	28
24/06/2024 04:00	14.45	0.37	495011.7	42.84	0	0	27.5
24/06/2024 05:00	14.45	0.33	494506.2	42.82	0	0	27.2
24/06/2024 06:00	14.46	0.32	495578.8	42.92	0	0	27.3
24/06/2024 07:00	14.46	0.42	493978.5	42.79	0	0	27.1
24/06/2024 08:00	14.46	0.5	494772.3	42.8	0	0	26.8
24/06/2024 09:00	14.5	0.57	436467.5	35.56	0	0	27.6
24/06/2024 10:00	14.46	0.57	453241.2	38.05	0	0	26.8
24/06/2024 11:00	14.5	0.61	451737	37.81	0	0	27.2
24/06/2024 12:00	14.54	0.59	449970.3	37.53	0	0	27.5
24/06/2024 13:00	14.84	0.76	354013.2	23.76	0	0	41.5
24/06/2024 14:00	14.57	0.52	390849.4	29.92	0	0	28.9
24/06/2024 15:00	14.54	0.43	384934	29.1	0	0	29



24/06/2024 16:00	14.43	0.37	475081.7	40.37	0	0	34.1
24/06/2024 17:00	14.33	0.39	526630.7	46.98	0	0	38.9
24/06/2024 18:00	14.37	0.27	500690	43.76	0	0	33.9
24/06/2024 19:00	14.43	0.35	464679.3	39.25	0	0	26.5
24/06/2024 20:00	14.44	0.39	467741.4	39.56	0	0	26.7
24/06/2024 21:00	14.46	0.41	469880.4	39.77	0	0	26.7
24/06/2024 22:00	14.47	0.44	472404.4	39.99	0	0	27.1
24/06/2024 23:00	14.47	0.49	465906.8	39.32	0	0	27.3
24/06/2024 24:00	14.45	0.74	461103.9	33.24	0	0	27.2
Minimum	14.33	0.27	354013.2	23.76	0	0	26.5
MinDate	06/24/2024 17:00:00	06/24/2024 18:00:00	06/24/2024 13:00:00	06/24/2024 13:00:00	06/24/2024 1:00:00	06/24/2024 1:00:00	06/24/2024 19:00:00
Maximum	14.84	0.76	526630.7	46.98	0	0	41.5
MaxDate	06/24/2024 13:00:00	06/24/2024 13:00:00	06/24/2024 17:00:00	06/24/2024 17:00:00	06/24/2024 1:00:00	06/24/2024 1:00:00	06/24/2024 13:00:00
Avg	14.48	0.47	466095.5	39.03	0	0	29
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	40695.5	5.4	0	0	4
Site ABPR51 Daily: 25/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
25/06/2024 01:00	14.4	0.92	499081.8	42.85	0.5	0	33.1
25/06/2024 02:00	14.39	0.91	497937.8	42.9	0.5	0	33.5
25/06/2024 03:00	14.35	0.91	496824.1	42.89	0.5	0	33.2
25/06/2024 04:00	14.34	0.93	496830.8	42.9	0.5	0	33
25/06/2024 05:00	14.34	0.9	496855.3	42.91	0.5	0	32.9
25/06/2024 06:00	14.35	0.87	497518.7	43.02	0.5	0	33
25/06/2024 07:00	14.35	0.86	496894.9	42.94	0.6	0	32.6
25/06/2024 08:00	14.35	0.8	497729.7	42.97	0.5	0	32.5
25/06/2024 09:00	14.34	0.81	454421.2	37.69	0.5	0	33
25/06/2024 10:00	14.3	0.84	462866.5	38.93	0.5	0	31.5
25/06/2024 11:00	14.33	0.85	461975.4	38.71	0.5	0	31.7
25/06/2024 12:00	14.35	0.86	460617.3	38.4	0.5	0	32.2
25/06/2024 13:00	14.57	0.73	362648.3	24.62	0.3	0	44.6
25/06/2024 14:00	14.29	0.85	466495.2	39.36	0.5	0	30
25/06/2024 15:00	14.28	0.88	472576.1	40.03	0.5	0	29.9
25/06/2024 16:00	14.29	0.92	482811.8	41.18	0.5	0	29.8
25/06/2024 17:00	14.28	1.03	486721.5	41.64	0.4	0	30
25/06/2024 18:00	14.27	1.16	481295.7	41.11	0.5	0	29.5
25/06/2024 19:00	14.26	1.19	476848.7	40.65	0.4	0	29.5
25/06/2024 20:00	14.25	1.21	476309.1	40.58	0.4	0	29.4
25/06/2024 21:00	14.28	1.01	482801.2	41.27	0.4	0	29.6
25/06/2024 22:00	14.28	1.08	486703.9	41.77	0.4	0	30.1
25/06/2024 23:00	14.29	1.1	485471.2	41.61	0.4	0	30.7
25/06/2024 24:00	14.3	1.03	470225.7	39.69	0.5	0	32
Minimum	14.25	0.73	362648.3	24.62	0.3	0	29.4
MinDate	06/25/2024 20:00:00	06/25/2024 13:00:00	06/25/2024 13:00:00	06/25/2024 13:00:00	06/25/2024 13:00:00	06/25/2024 1:00:00	06/25/2024 20:00:00
Maximum	14.57	1.21	499081.8	43.02	0.6	0	44.6
MaxDate	06/25/2024 13:00:00	06/25/2024 20:00:00	06/25/2024 1:00:00	06/25/2024 6:00:00	06/25/2024 7:00:00	06/25/2024 1:00:00	06/25/2024 13:00:00
Avg	14.33	0.94	477102.6	40.44	0.5	0	32
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	28094.9	3.8	0.1	0	3.1
Site ABPR52 Daily: 25/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
25/06/2024 01:00	Shutdown	0.31	Shutdown	0.08	Shutdown	Shutdown	Shutdown
25/06/2024 02:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
25/06/2024 03:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
25/06/2024 04:00	Shutdown	0.59	Shutdown	0	Shutdown	Shutdown	Shutdown
25/06/2024 05:00	Shutdown	1.56	Shutdown	0	Shutdown	Shutdown	Shutdown
25/06/2024 06:00	Shutdown	0.5	Shutdown	0	Shutdown	Shutdown	Shutdown
25/06/2024 07:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
25/06/2024 08:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
25/06/2024 09:00	Shutdown	0.89	Shutdown	18.47	Shutdown	Shutdown	Shutdown
25/06/2024 10:00	14.52	0.4	467619.1	39.01	0	0	25.8
25/06/2024 11:00	14.52	0.43	463346.3	38.76	0	0	26.5
25/06/2024 12:00	14.54	0.44	461042.9	38.51	0	0	26.8
25/06/2024 13:00	14.72	0.56	359403.6	24.69	0	0	36.5
25/06/2024 14:00	14.46	0.57	466492.4	39.43	0	0	25.5
25/06/2024 15:00	14.46	0.53	471867.3	40.12	0	0	25.5
25/06/2024 16:00	14.46	0.51	483059.1	41.28	0	0	25.4
25/06/2024 17:00	14.42	0.34	487557.5	41.73	0	0	25.4
25/06/2024 18:00	14.38	0.76	482008.2	41.2	0	0	24.7
25/06/2024 19:00	14.39	0.89	476923.4	40.72	0	0	24.9
25/06/2024 20:00	14.4	0.9	476433.8	40.69	0	0	24.8
25/06/2024 21:00	14.42	0.86	482778.8	41.37	0	0	24.9
25/06/2024 22:00	14.43	0.83	487032.8	41.88	0	0	25.5
25/06/2024 23:00	14.41	0.68	485375.4	41.72	0	0	25.7
25/06/2024 24:00	14.41	0.59	469124.6	39.79	0	0	26.5
Minimum	14.38	0	359403.6	0	0	0	24.7
MinDate	06/25/2024 18:00:00	06/25/2024 2:00:00	06/25/2024 13:00:00	06/25/2024 2:00:00	06/25/2024 10:00:00	06/25/2024 10:00:00	06/25/2024 18:00:00
Maximum	14.72	1.56	487557.5	41.88	0	0	36.5
MaxDate	06/25/2024 13:00:00	06/25/2024 5:00:00	06/25/2024 17:00:00	06/25/2024 22:00:00	06/25/2024 10:00:00	06/25/2024 10:00:00	06/25/2024 13:00:00
Avg	14.46	0.55	468004.4	25.39	0	0	26.3
Num	15	24	15	24	15	15	15
Data[%]	63	100	63	100	63	63	63
STD	0.1	0.4	31305.8	19.1	0	0	2.9
Site ABPR51 Daily: 26/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
26/06/2024 01:00	14.19	0.91	433815	36.22	0.5	0	31.9
26/06/2024 02:00	14.22	0.92	445224.8	37.43	0.6	0	31.3
26/06/2024 03:00	14.21	0.88	444438.4	37.35	0.7	0	31.4
26/06/2024 04:00	14.18	0.98	432435.1	35.98	0.5	0	31.5
26/06/2024 05:00	14.16	1	429717.6	35.7	0.5	0	31.2
26/06/2024 06:00	14.16	0.94	429090.6	35.57	0.5	0	31.1
26/06/2024 07:00	14.16	0.87	425372.4	35.17	0.6	0	31.3
26/06/2024 08:00	14.16	0.81	419371.5	34.51	0.6	0	31.8
26/06/2024 09:00	14.26	0.89	432687.7	35.44	0.5	0	31.6
26/06/2024 10:00	14.33	0.99	484419.6	41.06	0.5	0	31
26/06/2024 11:00	14.34	0.94	470887	39.64	0.5	0	31.6
26/06/2024 12:00	14.34	0.92	464985.9	38.97	0.5	0	32
26/06/2024 13:00	14.58	0.79	365041.9	25.04	0.3	0	44.5
26/06/2024 14:00	14.41	0.92	476844.7	40.03	0.5	0	32.3



26/06/2024 15:00	14.37	0.94	475019.6	39.87	0.5	0	31.8
26/06/2024 16:00	14.36	0.92	472072.4	39.61	0.6	0	31.8
26/06/2024 17:00	14.4	0.96	484888.5	40.82	0.5	0	32.5
26/06/2024 18:00	14.4	0.97	483157.8	40.66	0.6	0	32.7
26/06/2024 19:00	14.37	0.98	485852.8	41.05	0.5	0	32.1
26/06/2024 20:00	14.35	1	488221.7	41.4	0.5	0	31.8
26/06/2024 21:00	14.34	0.96	486866.4	41.38	0.5	0	31.4
26/06/2024 22:00	14.33	0.96	485660.3	41.35	0.5	0	31
26/06/2024 23:00	14.33	0.9	492702.2	42.07	0.4	0	30.8
26/06/2024 24:00	14.28	0.87	466592.5	39.21	0.5	0	30.3
Minimum	14.16	0.79	365041.9	25.04	0.3	0	30.3
MinDate	06/26/2024 5:00:00	06/26/2024 13:00:00	06/26/2024 13:00:00	06/26/2024 13:00:00	06/26/2024 13:00:00	06/26/2024 1:00:00	
Maximum	14.58	1	492702.2	42.07	0.7	0	44.5
MaxDate	06/26/2024 13:00:00	06/26/2024 5:00:00	06/26/2024 23:00:00	06/26/2024 23:00:00	06/26/2024 3:00:00	06/26/2024 1:00:00	06/26/2024 13:00:00
Avg	14.3	0.93	457306.9	38.15	0.5	0	32.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	31433.7	3.7	0.1	0	2.7

Site ABPR52 Daily: 26/06/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
26/06/2024 01:00	14.31	0.5	432801.7	36.31	0	0	26.5
26/06/2024 02:00	14.33	0.51	444420.6	37.52	0	0	26
26/06/2024 03:00	14.33	0.44	444025	37.43	0	0	26.1
26/06/2024 04:00	14.3	0.6	430998.8	36.06	0	0	26.2
26/06/2024 05:00	14.3	0.79	428208.2	35.78	0	0	26.1
26/06/2024 06:00	14.29	0.77	427066.3	35.64	0	0	26
26/06/2024 07:00	14.3	0.64	423827.8	35.25	0	0	26.1
26/06/2024 08:00	14.29	0.63	418225.5	34.58	0	0	26
26/06/2024 09:00	14.38	0.65	430865.4	35.52	0	0	25.6
26/06/2024 10:00	14.44	0.61	482082.6	41.21	0	0	24.9
26/06/2024 11:00	14.44	0.61	467171.1	39.72	0	0	25.2
26/06/2024 12:00	14.45	0.56	460900.6	39.05	0	0	25.5
26/06/2024 13:00	14.68	0.57	359342.7	25	0	0	37.5
26/06/2024 14:00	14.48	0.41	471134.8	40.09	0	0	25.5
26/06/2024 15:00	14.45	0.38	469337.6	39.96	0	0	25.3
26/06/2024 16:00	14.46	0.42	466962.8	39.7	0	0	25.4
26/06/2024 17:00	14.48	0.53	479206.6	40.92	0	0	25.6
26/06/2024 18:00	14.48	0.58	477250.5	40.75	0	0	25.6
26/06/2024 19:00	14.46	0.58	481254.4	41.15	0	0	25.4
26/06/2024 20:00	14.42	0.62	484268.1	41.48	0	0	25.3
26/06/2024 21:00	14.4	0.7	484215.4	41.48	0	0	24.9
26/06/2024 22:00	14.39	0.65	483671.5	41.42	0	0	24.8
26/06/2024 23:00	14.4	0.61	490881.6	42.16	0	0	25
26/06/2024 24:00	14.38	0.65	465031	39.29	0	0	24.7
Minimum	14.29	0.38	359342.7	25	0	0	24.7
MinDate	06/26/2024 6:00:00	06/26/2024 15:00:00	06/26/2024 13:00:00	06/26/2024 13:00:00	06/26/2024 1:00:00	06/26/2024 1:00:00	
Maximum	14.68	0.79	490881.6	42.16	0	0	37.5
MaxDate	06/26/2024 13:00:00	06/26/2024 5:00:00	06/26/2024 23:00:00	06/26/2024 23:00:00	06/26/2024 1:00:00	06/26/2024 1:00:00	06/26/2024 13:00:00
Avg	14.4	0.58	454298	38.23	0	0	26.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	30969.7	3.7	0	0	2.5

Site ABPR51 Daily: 27/06/2024 Type: AVG

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
27/06/2024 01:00	14.17	0.77	430369.5	35.74	0.5	0	30.7
27/06/2024 02:00	14.18	0.8	435171.3	36.27	0.5	0	30.4
27/06/2024 03:00	14.17	0.84	435153.8	36.26	0.5	0	30.4
27/06/2024 04:00	14.18	0.86	435160.8	36.24	0.6	0	30.5
27/06/2024 05:00	14.16	0.85	424474.8	35.07	0.6	0	30.7
27/06/2024 06:00	14.15	1.07	427647.3	35.44	0.6	0	30.4
27/06/2024 07:00	14.16	0.8	423408.3	35.05	0.5	0	31.6
27/06/2024 08:00	14.16	0.89	418236	34.47	0.6	0	31.9
27/06/2024 09:00	14.26	0.78	422545.8	34.07	0.6	0	32.9
27/06/2024 10:00	11.41	0.81	478084.7	40.54	7.3	1.1	16.9
27/06/2024 11:00	11.83	0.86	474494.5	40.01	30.2	15.5	49.7
27/06/2024 12:00	14.21	0.9	481807.5	40.52	0	0	31.5
27/06/2024 13:00	14.33	0.65	371397.3	26.24	0	0	36.6
27/06/2024 14:00	14.2	0.91	485665.4	40.95	0	0	30.9
27/06/2024 15:00	14.21	0.88	488461.4	41.18	0	0	31.4
27/06/2024 16:00	14.22	0.89	489682.6	41.4	0	0	31.8
27/06/2024 17:00	14.23	0.99	491276.9	41.36	0	0	32.3
27/06/2024 18:00	14.21	0.84	490306.3	41.36	0	0	31.2
27/06/2024 19:00	14.16	0.86	484258.7	40.98	0	0	30.7
27/06/2024 20:00	14.12	0.97	479223.2	40.63	0	0	30.3
27/06/2024 21:00	14.14	0.91	482191.2	41.06	0	0	30.3
27/06/2024 22:00	14.15	0.96	490223.2	41.77	0	0	31
27/06/2024 23:00	14.15	0.96	490221.8	41.82	0	0	30.7
27/06/2024 24:00	14.15	0.94	473544.3	39.73	0	0	31.8
Minimum	11.41	0.65	371397.3	26.24	0	0	16.9
MinDate	06/27/2024 10:00:00	06/27/2024 13:00:00	06/27/2024 13:00:00	06/27/2024 13:00:00	06/27/2024 12:00:00	06/27/2024 1:00:00	06/27/2024 10:00:00
Maximum	14.33	1.07	491276.9	41.82	30.2	15.5	49.7
MaxDate	06/27/2024 13:00:00	06/27/2024 6:00:00	06/27/2024 17:00:00	06/27/2024 23:00:00	06/27/2024 11:00:00	06/27/2024 11:00:00	06/27/2024 11:00:00
Avg	13.97	0.87	458458.6	38.26	1.8	0.7	31.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.7	0.1	33646.2	3.8	6.2	3.2	5

Site ABPR52 Daily: 27/06/2024 Type: AVG

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
27/06/2024 01:00	14.29	0.67	429067	35.81	0	0	25.3
27/06/2024 02:00	14.31	0.72	433672	36.35	0	0	25.1
27/06/2024 03:00	14.31	0.63	434081.2	36.36	0	0	25.1
27/06/2024 04:00	14.31	0.59	433799.7	36.33	0	0	25.2
27/06/2024 05:00	14.3	0.53	423389.6	35.15	0	0	25.2
27/06/2024 06:00	14.3	0.48	426208.5	35.51	0	0	25.2
27/06/2024 07:00	14.29	0.27	422968.3	35.14	0	0	26
27/06/2024 08:00	14.29	0.58	417588.2	34.54	0	0	26.2
27/06/2024 09:00	14.39	0.57	420390.1	34.12	0	0	27.1
27/06/2024 10:00	14.45	0.58	476242.4	40.62	0	0	24
27/06/2024 11:00	10.14	0.55	470819.1	40.09	1.9	0	17.2
27/06/2024 12:00	11.78	0.53	476866.1	40.62	32.1	15.4	48.8
27/06/2024 13:00	14.84	0.63	367368.9	26.32	0	0	34.9



27/06/2024 14:00	14.7	0.67	480991.4	41	0	0	28.6
27/06/2024 15:00	14.71	0.6	483407.2	41.27	0	0	28.6
27/06/2024 16:00	14.7	0.59	485265.5	41.5	0	0	29.1
27/06/2024 17:00	14.71	0.81	485189.1	41.46	0	0	29
27/06/2024 18:00	14.71	0.54	485461.5	41.45	0	0	28.5
27/06/2024 19:00	14.67	0.4	481053.9	41.07	0	0	28.5
27/06/2024 20:00	14.66	0.39	476921	40.72	0	0	28.6
27/06/2024 21:00	14.67	0.44	480253.1	41.14	0	0	28.7
27/06/2024 22:00	14.68	0.5	488810.4	41.95	0	0	29
27/06/2024 23:00	14.68	0.48	488752.9	41.92	0	0	29
27/06/2024 24:00	14.69	0.45	470761.7	39.76	0	0	30.2
Minimum	10.14	0.27	367368.9	26.32	0	0	17.2
MinDate	06/27/2024 11:00:00	06/27/2024 7:00:00	06/27/2024 13:00:00	06/27/2024 13:00:00	06/27/2024 1:00:00	06/27/2024 1:00:00	06/27/2024 11:00:00
Maximum	14.84	0.81	488810.4	41.95	32.1	15.4	48.8
MaxDate	06/27/2024 13:00:00	06/27/2024 17:00:00	06/27/2024 22:00:00	06/27/2024 22:00:00	06/27/2024 12:00:00	06/27/2024 12:00:00	06/27/2024 12:00:00
Avg	14.23	0.55	455805.3	38.34	1.4	0.6	28
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	1.1	0.1	32886.9	3.8	6.5	3.1	5.4
Site ABPR51 Daily: 28/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
28/06/2024 01:00	14.02	0.88	431621.6	35.84	0	0	31.1
28/06/2024 02:00	14.03	0.84	441399.5	36.9	0	0	30.7
28/06/2024 03:00	14.03	0.92	440006.7	36.76	0	0	30.8
28/06/2024 04:00	14.03	0.9	432603.8	35.95	0	0	31.3
28/06/2024 05:00	13.99	0.9	419815.2	34.52	0	0	31.4
28/06/2024 06:00	14	0.94	423552.2	34.96	0	0	31
28/06/2024 07:00	14	0.89	426221.2	35.25	0	0	30.9
28/06/2024 08:00	14	0.74	423657.5	34.95	0	0	30.8
28/06/2024 09:00	14.08	0.72	424618.7	34.42	0	0	31.7
28/06/2024 10:00	14.2	0.74	476706	40.1	0	0	30.7
28/06/2024 11:00	14.23	0.76	474223	39.64	0	0	31.5
28/06/2024 12:00	14.24	0.88	477919.2	39.86	0	0	31.7
28/06/2024 13:00	14.32	0.67	369890.2	26.06	0	0	36.8
28/06/2024 14:00	14.1	1.06	472795.9	40.19	0	0	29.4
28/06/2024 15:00	14.11	0.95	468791	39.62	0	0	29.6
28/06/2024 16:00	14.15	0.98	474544.4	39.95	0	0	30.3
28/06/2024 17:00	14.2	0.97	481396.8	40.49	0	0	31.2
28/06/2024 18:00	14.19	0.98	478242.6	40.26	0	0	32.1
28/06/2024 19:00	14.15	0.99	469765.6	39.58	0	0	31
28/06/2024 20:00	14.11	0.94	465155	39.26	0	0	30.3
28/06/2024 21:00	14.09	0.91	461249.8	38.91	0	0	30.2
28/06/2024 22:00	14.09	0.95	461390.3	38.95	0	0	30.2
28/06/2024 23:00	14.09	0.96	462741.1	39.08	0	0	30.1
28/06/2024 24:00	14.09	0.9	443443.5	36.68	0	0	31.3
Minimum	13.99	0.67	369890.2	26.06	0	0	29.4
MinDate	06/28/2024 5:00:00	06/28/2024 13:00:00	06/28/2024 13:00:00	06/28/2024 13:00:00	06/28/2024 1:00:00	06/28/2024 1:00:00	06/28/2024 14:00:00
Maximum	14.32	1.06	481396.8	40.49	0	0	36.8
MaxDate	06/28/2024 13:00:00	06/28/2024 14:00:00	06/28/2024 17:00:00	06/28/2024 17:00:00	06/28/2024 1:00:00	06/28/2024 1:00:00	06/28/2024 13:00:00
Avg	14.11	0.89	450072.9	37.42	0	0	31.1
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	27319.7	3.2	0	0	1.4
Site ABPR52 Daily: 28/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW M3/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
28/06/2024 01:00	14.59	0.51	430511	35.92	0	0	29.5
28/06/2024 02:00	14.6	0.52	440272.7	37	0	0	29.1
28/06/2024 03:00	14.6	0.59	438620.8	36.84	0	0	29.3
28/06/2024 04:00	14.59	0.64	431479.8	36.03	0	0	29.7
28/06/2024 05:00	14.58	0.63	418258.1	34.59	0	0	29.8
28/06/2024 06:00	14.59	0.67	422290.3	35.03	0	0	29.6
28/06/2024 07:00	14.59	0.7	425047.8	35.32	0	0	29.5
28/06/2024 08:00	14.6	0.73	422110.9	35.03	0	0	29.3
28/06/2024 09:00	14.69	0.69	422223.9	34.44	0	0	29.5
28/06/2024 10:00	14.81	0.68	472779.8	40.2	0	0	28.5
28/06/2024 11:00	14.83	0.59	467964.5	39.73	0	0	28.9
28/06/2024 12:00	14.8	0.63	470862.7	39.95	0	0	28.6
28/06/2024 13:00	14.86	0.4	365573.5	26.19	0	0	34.6
28/06/2024 14:00	14.66	0.57	470925.1	40.24	0	0	28.3
28/06/2024 15:00	14.67	0.73	466782.6	39.7	0	0	28.1
28/06/2024 16:00	14.7	0.68	470468.1	40.04	0	0	28.2
28/06/2024 17:00	14.71	0.68	475766.4	40.57	0	0	28.6
28/06/2024 18:00	14.67	0.55	473451.3	40.35	0	0	29.7
28/06/2024 19:00	14.65	0.46	466433.1	39.66	0	0	28.8
28/06/2024 20:00	14.63	0.49	463089.4	39.33	0	0	28.6
28/06/2024 21:00	14.63	0.46	459704.8	39.01	0	0	28.5
28/06/2024 22:00	14.63	0.47	459992.6	39.05	0	0	28.6
28/06/2024 23:00	14.63	0.45	461049.3	39.16	0	0	28.6
28/06/2024 24:00	14.65	0.44	441483.4	36.74	0	0	29.8
Minimum	14.58	0.4	365573.5	26.19	0	0	28.1
MinDate	06/28/2024 5:00:00	06/28/2024 13:00:00	06/28/2024 13:00:00	06/28/2024 13:00:00	06/28/2024 1:00:00	06/28/2024 1:00:00	06/28/2024 15:00:00
Maximum	14.86	0.73	475766.4	40.57	0	0	34.6
MaxDate	06/28/2024 13:00:00	06/28/2024 8:00:00	06/28/2024 17:00:00	06/28/2024 17:00:00	06/28/2024 1:00:00	06/28/2024 1:00:00	06/28/2024 13:00:00
Avg	14.67	0.58	447380.9	37.51	0	0	29.2
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	26635.2	3.2	0	0	1.3
Site ABPR51 Daily: 29/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
29/06/2024 01:00	14	0.85	408449.7	32.99	0	0	32
29/06/2024 02:00	13.98	0.82	410621.2	33.36	0	0	31.3
29/06/2024 03:00	13.98	0.78	409391.8	33.16	0	0	31.4
29/06/2024 04:00	13.99	0.85	408871.8	33.01	0	0	31.6
29/06/2024 05:00	14.05	0.95	399064.3	31.47	0	0	33.3
29/06/2024 06:00	14.01	1.13	405105.2	32.56	0	0	32.5
29/06/2024 07:00	14.05	0.9	398605.1	31.41	0	0	32.8
29/06/2024 08:00	14.07	1.03	398118.7	31.33	0	0	33
29/06/2024 09:00	14.15	0.67	402994.7	31.35	0	0	34.6
29/06/2024 10:00	14.05	1.07	439570.3	36.84	0	0	32.3
29/06/2024 11:00	14.05	1.38	445411	37.49	0	0	32
29/06/2024 12:00	14.06	1.18	452116.5	38.08	0	0	31.5



29/06/2024 13:00	14.41	1.02	357343	23.84	0	0	51.5
29/06/2024 14:00	14.04	0.91	443216.4	37.15	0	0	31
29/06/2024 15:00	14.05	0.93	438586.6	36.52	0	0	31.2
29/06/2024 16:00	14.03	0.95	430500.3	35.6	0	0	31.4
29/06/2024 17:00	14.03	0.94	427197.4	35.26	0	0	31.5
29/06/2024 18:00	14.03	0.83	426003.8	35.14	0	0	31.9
29/06/2024 19:00	14.03	0.83	425900.4	35.18	0	0	31.6
29/06/2024 20:00	14.03	0.86	425264.7	35.19	0	0	31.4
29/06/2024 21:00	14.02	0.89	424806.3	35.21	0	0	31.4
29/06/2024 22:00	14.02	0.89	426238.2	35.34	0	0	31.1
29/06/2024 23:00	14.01	0.93	427687.1	35.46	0	0	30.8
29/06/2024 24:00	14.09	0.9	415645.2	33.52	0	0	34
Minimum	13.98	0.67	357343	23.84	0	0	30.8
MinDate	06/29/2024 2:00:00	06/29/2024 9:00:00	06/29/2024 13:00:00	06/29/2024 13:00:00	06/29/2024 1:00:00	06/29/2024 1:00:00	06/29/2024 23:00:00
Maximum	14.41	1.38	452116.5	38.08	0	0	51.5
MaxDate	06/29/2024 13:00:00	06/29/2024 11:00:00	06/29/2024 12:00:00	06/29/2024 12:00:00	06/29/2024 1:00:00	06/29/2024 1:00:00	06/29/2024 13:00:00
Avg	14.05	0.94	418612.9	34.02	0	0	32.8
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	20396.4	3	0	0	4.1
Site ABPR52 Daily: 29/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
29/06/2024 01:00	14.57	0.43	407133.7	33.1	0	0	30.6
29/06/2024 02:00	14.56	0.41	409192	33.44	0	0	29.8
29/06/2024 03:00	14.56	0.48	408122	33.25	0	0	30.1
29/06/2024 04:00	14.58	0.58	407391.1	33.09	0	0	30.1
29/06/2024 05:00	14.63	0.53	397691.5	31.55	0	0	31.2
29/06/2024 06:00	14.59	0.6	403869.2	32.64	0	0	31
29/06/2024 07:00	14.63	0.52	397154.3	31.48	0	0	30.7
29/06/2024 08:00	14.64	0.65	396606.8	31.4	0	0	31
29/06/2024 09:00	14.71	0.37	401876.1	31.5	0	0	32
29/06/2024 10:00	14.61	0.6	438609.9	36.91	0	0	30.8
29/06/2024 11:00	14.6	1.6	444488.2	37.56	0	0	30.8
29/06/2024 12:00	14.62	1.26	450399.7	38.06	0	0	30.5
29/06/2024 13:00	14.93	1.09	353405.6	23.97	0	0	50.4
29/06/2024 14:00	14.65	0.76	443461.9	37.26	0	0	29.9
29/06/2024 15:00	14.66	0.51	437632.9	36.59	0	0	30.1
29/06/2024 16:00	14.64	0.55	428783	35.65	0	0	30.5
29/06/2024 17:00	14.63	0.49	425958.8	35.34	0	0	30.6
29/06/2024 18:00	14.64	0.38	425042.1	35.22	0	0	30.9
29/06/2024 19:00	14.61	0.39	425267.6	35.3	0	0	30.7
29/06/2024 20:00	14.59	0.42	424438.3	35.28	0	0	30.6
29/06/2024 21:00	14.59	0.46	424321.5	35.28	0	0	30.4
29/06/2024 22:00	14.59	0.54	425097	35.43	0	0	30.2
29/06/2024 23:00	14.59	0.66	425327.2	35.54	0	0	30.1
29/06/2024 24:00	14.6	0.9	423671.5	29.7	0	0	30.1
Minimum	14.56	0.37	353405.6	23.97	0	0	29.8
MinDate	06/29/2024 2:00:00	06/29/2024 9:00:00	06/29/2024 13:00:00	06/29/2024 13:00:00	06/29/2024 1:00:00	06/29/2024 1:00:00	06/29/2024 2:00:00
Maximum	14.93	1.6	450399.7	38.06	0	0	50.4
MaxDate	06/29/2024 13:00:00	06/29/2024 11:00:00	06/29/2024 12:00:00	06/29/2024 12:00:00	06/29/2024 1:00:00	06/29/2024 1:00:00	06/29/2024 13:00:00
Avg	14.63	0.63	417705.9	33.94	0	0	31.4
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.3	20903.8	3.1	0	0	4.1
Site ABPR51 Daily: 30/06/2024 Type: AVG							

Date & Time	51HRSG_O2 %VOL	51HRSG_DUST MG/M3	51HRSG_FLOW M3/HR	GT_LOAD MW	51HRSG_CO@7%O2	51HRSG_SO2@7%O2	51HRSG_NOx@7%O2
30/06/2024 01:00	14.16	0.99	496784.7	42.8	0	0	30.3
30/06/2024 02:00	14.16	1.11	497697.6	43.08	0	0	30.6
30/06/2024 03:00	14.16	1.02	497804.1	43.08	0	0	30.5
30/06/2024 04:00	14.16	1.07	497498.5	43.09	0	0	30.5
30/06/2024 05:00	14.15	0.99	497987.4	43.15	0	0	30.8
30/06/2024 06:00	14.16	1.06	497609.6	43.12	0	0	31.3
30/06/2024 07:00	14.16	1.23	496171	43.16	0	0	32
30/06/2024 08:00	14.16	1.17	496561.8	43.17	0	0	31.8
30/06/2024 09:00	14.16	1.28	493919.8	42.87	0	0	31.3
30/06/2024 10:00	14.15	1.03	494242.1	42.81	0	0	30.7
30/06/2024 11:00	14.16	1.02	497244.8	42.87	0	0	31.1
30/06/2024 12:00	14.22	0.84	498695.5	42.8	0	0	32.3
30/06/2024 13:00	14.23	0.91	499428.8	42.74	0	0	32.5
30/06/2024 14:00	14.2	0.84	496944.9	42.83	0	0	32.6
30/06/2024 15:00	14.19	1.04	495545.8	42.93	0	0	33
30/06/2024 16:00	14.2	1.11	496282.3	42.76	0	0	32.5
30/06/2024 17:00	14.22	0.87	499714.6	42.88	0	0	32.7
30/06/2024 18:00	14.22	0.95	498235.9	42.83	0	0	33.1
30/06/2024 19:00	14.04	1.03	520431.8	46.81	0	0	39.1
30/06/2024 20:00	13.96	1.05	529469.9	48.32	0	0	41.6
30/06/2024 21:00	13.97	1.28	531621.3	48.68	0	0	42.4
30/06/2024 22:00	13.96	1.41	532156.8	48.74	0	0	42.4
30/06/2024 23:00	14.05	1.17	511965.2	45.68	0	0	37
30/06/2024 24:00	14.15	1	492034.8	42.83	0	0	31.1
Minimum	13.96	0.84	492034.8	42.74	0	0	30.3
MinDate	06/30/2024 20:00:00	06/30/2024 12:00:00	06/30/2024 13:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00
Maximum	14.23	1.41	532156.8	48.74	0	0	42.4
MaxDate	06/30/2024 13:00:00	06/30/2024 22:00:00	06/30/2024 22:00:00	06/30/2024 22:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00	06/30/2024 21:00:00
Avg	14.14	1.06	502752.1	43.92	0	0	33.5
Num	24	24	24	24	24	24	24
Data[%]	100	100	100	100	100	100	100
STD	0.1	0.1	12394.3	2	0	0	3.9
Site ABPR52 Daily: 30/06/2024 Type: AVG							

Date & Time	52HRSG_O2 %VOL	52HRSG_DUST MG/M3	52HRSG_FLOW MG/HR	GT_LOAD MW	52HRSG_CO@7%O2	52HRSG_SO2@7%O2	52HRSG_NOx@7%O2
30/06/2024 01:00	Shutdown	0.51	Shutdown	0.02	Shutdown	Shutdown	Shutdown
30/06/2024 02:00	Shutdown	0.47	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 03:00	Shutdown	0.54	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 04:00	Shutdown	0.61	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 05:00	Shutdown	0.5	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 06:00	Shutdown	0.42	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 07:00	Shutdown	0.72	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 08:00	Shutdown	0.48	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 09:00	Shutdown	0.48	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 10:00	Shutdown	0.09	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 11:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown



30/06/2024 12:00	Shutdown	0	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 13:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 14:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 15:00	Shutdown	0.04	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 16:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 17:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 18:00	Shutdown	0.03	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 19:00	Shutdown	0.01	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 20:00	Shutdown	0.02	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 21:00	Shutdown	0.64	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 22:00	Shutdown	1.4	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 23:00	Shutdown	0.46	Shutdown	0	Shutdown	Shutdown	Shutdown
30/06/2024 24:00	Shutdown	0.3	Shutdown	0	Shutdown	Shutdown	Shutdown
Minimum	---	0	---	0	---	---	---
MinDate	06/30/2024 1:00:00	06/30/2024 12:00:00	06/30/2024 1:00:00	06/30/2024 2:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00
Maximum	---	1.4	---	0.02	---	---	---
MaxDate	06/30/2024 1:00:00	06/30/2024 22:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00	06/30/2024 1:00:00
Avg	---	0.33	---	0	---	---	---
Num	0	24	0	24	0	0	0
Data[%]	---	100	---	100	---	---	---
STD	---	0.3	---	0	---	---	---