

ภาคผนวกที่ 7

Checklist อุปกรณ์ดับเพลิง
ประจำเดือนมกราคม-มิถุนายน 2567

Check List emergency light

[illegible]

(1) = Fire Exit

(2) = Emergency Light

Responsible by Date 5/1/24

Supervisor by [Signature] Date 1/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Building B	/	/	/	/	/	5/1/24					
221 Fire Exit	/	/	/	/	/			/			
225 Emergency	/	/	/	/	/		16/7/24	/			
233 Emergency	/	/	/	/	/			/			
224 Fire Exit	/	/	/	/	/			/			

Note: Mark [✓] Normal

(1) = Fire Exit

Mark (X) Abnormal

(2) = Emergency Light

Responsible by 16/7/24 Date..... 5/1/24

Supervisor by 16/7/24 Date..... 7/1/24

Check List emergency light

[illegible]

(1) = Fire Exit

(2) = Emergency Light

Responsible by 6w123 Date 5/2/24

Supervisor by [Signature] Date 12/02

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Building D											
421 Fire Exit	/	/	/	/	/	4/1/24		/			
426 Emergency Fire Exit	/	/	/	/	/			/			
436 Emergency	/	/	/	/	/			/			
429 Fire Exit	/	/	/	/	/			/			
								/			

Note: Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by win 245 Date 4/1/24

Supervisor by Boon Date 1/2/24

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

[illegible]

Note:Mark [✓] Normal

(1) = Fire Exit

Mark (X) Abnormal

(2) = Emergency Light

Responsible by win 2ub Date 4/1/24

Supervisor by [Signature] Date 2/2/02

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by banjars Date 4/1/24

Supervisor by *[Signature]* Date 1/2/17

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

[illegible]

Note:Mark [✓] Normal

(1) = Fire Exit

Mark (X) Abnormal

(2) = Emergency Light

Responsible by birajana Date. 4/1/24

Supervisor by [Signature] Date 11/2/17

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 241 (Fire Exit)	✓	✓	✓	✓	✓	6/1/24		✓			
Room 241 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 246 (Fire Exit)	✓		✓	✓	✓			✓			
Room 246 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 252 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 252 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 263 (Fire Exit)	✓	✓	✓	✓	✓		6/1/24	✓			
Room 263 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 269 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 269 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 274 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 274 (Emergency)	✓	✓	✓	✓	✓			✓			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by 6/1/24 Date 6/1/24

Supervisor by 6/1/24 Date 1/2/24

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 341 (Fire Exit)	✓	✓	✓	✓	✓	6/1/24		✓			
Room 341 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 346 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 346 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 355 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 355 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 360 (Fire Exit)	✓	✓	✓	✓	✓		windus	✓			
Room 360 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 371 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 371 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 377 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 377 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 382 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 382 (Emergency)	✓	✓	✓	✓	✓			✓			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by windus Date 6/1/24

Supervisor by Bob Date 1/2/24

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Jan-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 441 (Fire Exit)	/	/	/	/	/	6/1/24		/			
Room 441 (Emergency)	/	/	/	/	/			/			
Room 446 (Fire Exit)	/	/	/	/	/			/			
Room 446 (Emergency)	/	/	/	/	/			/			
Room 456 (Fire Exit)	/	/	/	/	/			/			
Room 456 (Emergency)	/	/	/	/	/			/			
Room 462 (Fire Exit)	/	/	/	/	/			/			
Room 462 (Emergency)	/	/	/	/	/		6/1/24	/			
Room 473 (Fire Exit)	/	/	/	/	/			/			
Room 473 (Emergency)	/	/	/	/	/			/			
Room 479 (Fire Exit)	/	/	/	/	/			/			
Room 479 (Emergency)	/	/	/	/	/			/			
Room 484 (Fire Exit)	/	/	/	/	/			/			
Room 484 (Emergency)	/	/	/	/	/			/			

Note: Mark [/] Normal

Mark (X) Abnormal

Responsible by 6/1/24

Supervisor by 1/2/24

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building A

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building A													
Side Steps													
Corridor Room 121	Chemical Powder-ABC	√	√	√	√	√	√	√	24/01/24	Santichai			
Corridor Room 131	Chemical Powder-ABC	√	√	√	√	√	√	√	24/01/24	Santichai			
Central Staircase													
Corridor Room 122	Chemical Powder-ABC	√	√	√	√	√	√	√	24/01/24	Santichai			
Side Steps													
Corridor Room 124	NON-CFC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	24/01/24	Santichai			Dismantled
Corridor Room 137	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	24/01/24	Santichai			Dismantled
Facade of Building													
Corridor Room A21	NON-CFC	√	√	√	√	√	√	√	24/01/24	Santichai			
Behind the Building													
Corridor MDB Room	Chemical Powder-ABC	√	√	√	√	√	√	√	24/01/24	Santichai			

Remark;

[√] Normal

[X] Abnormal

Loss Prevention Check

People & Culture Manager

01 N.W. 2567

6/1/24

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building B

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building B													
Side Steps													
Corridor Room 221	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 231	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Central Staircase													
Corridor Room 222 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 233 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 224	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/1-4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
01/02/24

People & Culture Manager

[Signature]

01 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building C

Monthly..01/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building C													
Side Steps													
Corridor Room 321	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 331 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Central Staircase													
Corridor Room 322 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 334 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 324	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/5-8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


01/02/24

People & Culture Manager

 01 P.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building D

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building D													
Side Steps													
Corridor Room 421	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	24/01/24	Santichai			Dismantled
Corridor Room 431	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	24/01/24	Santichai			Dismantled
Central Staircase													
Corridor Room 422	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 434	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 424	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 437	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/12	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/9-12 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
21/02/24

People & Culture Manager

[Signature] 01 P.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building E

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building E													
Side Steps													
Corridor Room 521	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	24/01/24	Santichai			Dismantled
Corridor Room 531	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	24/01/24	Santichai			Dismantled
Central Staircase													
Corridor Room 522	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 534	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 524	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 537	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/16	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/13-16 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

People & Culture Manager

01 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building F

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building F													
Side Steps													
Corridor Room 621	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 631	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Central Staircase													
Corridor Room 623	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 633	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 624	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 637	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/17-20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

People & Culture Manager

01 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building G													
Side Steps													
Corridor Room 721	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 731	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Central Staircase													
Corridor Room 722	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 733	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 724	Chemical Powder-ABC	X	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			Pressure down
Corridor Room 737	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/24	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/21-24 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
01/02/24

People & Culture Manager

[Signature]

01 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building H													
Side Steps													
Corridor Room 925	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 933	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 924	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 927	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/26	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/25-26 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


01/02/24

People & Culture Manager



01 P.W. 2557

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..01/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building I													
Side Steps													
Corridor Room 923	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 935	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Side Steps													
Corridor Room 936	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 949	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Facade of Building													
Corridor Office 20/27	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Behind the Building													
Corridor Office 20/26-27 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


01/02/24

People & Culture Manager



01 N.W. 2557

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing Floor 1, Restaurant, Lobby

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 1													
Loading x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Accounting Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Female Locker	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Canteen Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Main Kitchen x4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Electrical Control Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Captain Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Lift Main Kitchen x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Bai-Ruer Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Boat Point Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Loss Prevention Office	NON-CFC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Generator Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

People & Culture Manager

01 N.W. 2567

NH BOAT LAGOON PHUKET RESORT Check List Fire Extinguisher Hotel Wing FLOOR 2,3

Monthly..01/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 2													
Corridor Room 242	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 250	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 256	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 264	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 272	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
FLOOR 3													
Corridor Room 342	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 348	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 352	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
CorridorRoom 358	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 364	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 372	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 380	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


01/02/24

People & Culture Manager



01 P.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 4/White House Meeting Room

Monthly..01/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 4													
Corridor Room 442	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 448	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 454	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 460	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 466	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 474	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
Corridor Room 482	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
White House Meeting Room01	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
White House Meeting Room02	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
White House Meeting Room03	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
White House Meeting Room04	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
White House Meeting Room05	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			
White House Meeting Room KC x3	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	24/01/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


01/02/24

People & Culture Manager

 01 P.W. 2567

ทำความสะอาดห้องควบคุมไฟฟ้าย่อย 1 SDB



1/2/67

ทำความสะอาดห้องควบคุมไฟฟ้า 2 MDB



เสร็จ
1/2/57

ทำความสะอาดห้องควบคุมไฟฟ้า 3 MDB



11/2/67

TEST RUN RECORD FOR EMERGENCY GENERATOR

DATE 17/1/67 ENGINEER ยุทธนา โควิท
GENERATOR 1000 kVA LOCATION 323m

สภาพเครื่องก่อน TEST RUN

- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
- ☒ สภาพสายพาน (Machine Bell)
- ☒ ระดับน้ำในหม้อน้ำ (Boiler)
- ☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN

☐ ON LOAD ☒ OFF LOAD

TIME START TIME STOP

รายการตรวจเช็ค		บันทึก
Oil (L.)		
Voltage (V)	L1	
Voltage (V)	L2	
Voltage (V)	L3	
Coolant Temp (°C)		
Oil Pressure (bar)		
Speed (RPM)		
Frequency (Hz)		
Battery (V)		
Run Time (h)		

REMARK

ทำงานตามปกติและเรียบร้อย

ยุทธนา
11/2/67

Generator 2



Check List emergency light

[illegible]

(1) = Fire Exit

(2) = Emergency Light

Responsible by Eng. A. A. A. Date 27/2/17

Supervisor by محمد علي Date 29/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 241 (Fire Exit)	/	/	/	/	/	27/02/67		/			
Room 241 (Emergency)	/	/	/	/	/	27/2/67		/			
Room 246 (Fire Exit)	/	/	/	/	/	28/2/67		/			
Room 246 (Emergency)	/	/	/	/	/	28/2/67		/			
Room 252 (Fire Exit)	/	/	/	/	/	27/2/67		/			
Room 252 (Emergency)	/	/	/	/	/	27/2/67		/			
Room 263 (Fire Exit)	/	/	/	/	/	27/2/67		/			
Room 263 (Emergency)	/	/	/	/	/	27/2/67		/			
Room 269 (Fire Exit)	/	/	/	/	/	27/2/67		/			
Room 269 (Emergency)	/	/	/	/	/	27/2/67		/			
Room 274 (Fire Exit)	/	/	/	/	/	27/2/67		/			
Room 274 (Emergency)	/	/	/	/	/	27/2/67		/			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by Date 27/2/67

Supervisor by Date 29/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 341 (Fire Exit)	✓	✓	✓	✓	✓	28/2/67	[Signature]	✓			
Room 341 (Emergency)	✓	✓	✓	✓	✓	28/2/67		✓			
Room 346 (Fire Exit)	✓	✓	✓	✓	✓	28/2/67		✓			
Room 346 (Emergency)	✓	✓	✓	✓	✓	28/2/67		✓			
Room 355 (Fire Exit)	✓	✓	✓	✓	✓	28/2/67		✓			
Room 355 (Emergency)	✓	✓	✓	✓	✓	28/2/67		✓			
Room 360 (Fire Exit)	✓	✓	✓	✓	✓	27/2/67		✓			
Room 360 (Emergency)	✓	✓	✓	✓	✓	27/2/67		✓			
Room 371 (Fire Exit)	✓	✓	✓	✓	✓	27/2/67		✓			
Room 371 (Emergency)	✓	✓	✓	✓	✓	27/2/67		✓			
Room 377 (Fire Exit)	✓	✓	✓	✓	✓	27/2/67		✓			
Room 377 (Emergency)	✓	✓	✓	✓	✓	27/2/67		✓			
Room 382 (Fire Exit)	✓	✓	✓	✓	✓	27/2/67		✓			
Room 382 (Emergency)	✓	✓	✓	✓	✓	27/2/67		✓			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by [Signature] Date 27/2/67

Supervisor by [Signature] Date 27/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 441 (Fire Exit)	/	/	/	/	/	28/2/67	[Signature]	/			
Room 441 (Emergency)	/	/	/	/	/	28/2/67		/			
Room 446 (Fire Exit)	/	/	/	/	/	28/2/67		/			
Room 446 (Emergency)	/	/	/	/	/	28/2/67		/			
Room 456 (Fire Exit)	/	/	/	/	/	28/2/67		/			
Room 456 (Emergency)	/	/	/	/	/	28/2/67		/			
Room 462 (Fire Exit)	/	/	/	/	/	28/2/67		/			
Room 462 (Emergency)	/	/	/	/	/	28/2/67		/			
Room 473 (Fire Exit)	/	/	/	/	/	28/2/67		/			
Room 473 (Emergency)	/	/	/	/	/	28/2/67		/			
Room 479 (Fire Exit)	/	/	/	/	/	28/2/67		/			
Room 479 (Emergency)	/	/	/	/	/	28/2/67		/			
Room 484 (Fire Exit)	/	/	/	/	/	28/2/67		/			
Room 484 (Emergency)	/	/	/	/	/	28/2/67		/			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by [Signature] Date 27/2/67

Supervisor by [Signature] Date 27/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

[illegible]

Note:Mark [✓] Normal

(1) = Fire Exit

Mark (X) Abnormal

(2) = Emergency Light

Responsible by Date.....

Supervisor by John W. [Signature] Date 2/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by 2456 Date 27/2/17

Supervisor by W. S. B. Date 27/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by gintan Date 27/2/67

Supervisor by W. J. 2.65 Date 27/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by gnm Date 27/12/16

Supervisor by Wing Date 22/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by E. P. M. A. Date 27/2/67

Supervisor by [Signature] Date 27/2/67

Check List emergency light

[illegible]

(2) = Emergency Light

Responsible by E. H. 2021 Date 27/12/167

Supervisor by [Signature] Date 27/2/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Feb-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by grom Date 27/2/67

Supervisor by Janis Date 27/2/67

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building A

Monthly..02/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building A													
Side Steps													
Corridor Room 121	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 131	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Central Staircase													
Corridor Room 122	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Side Steps													
Corridor Room 124	NON-CFC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	27/02/24	Santichai			Dismantled
Corridor Room 137	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	27/02/24	Santichai			Dismantled
Facade of Building													
Corridor Room A21	NON-CFC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Behind the Building													
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


28/02/2024

People & Culture Manager



29 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building B

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building B													
Side Steps													
Corridor Room 221	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 231	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Central Staircase													
Corridor Room 222 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 233 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Side Steps													
Corridor Room 224	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Facade of Building													
Corridor Office 20/4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Behind the Building													
Corridor Office 20/1-4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


28/02/2024

People & Culture Manager



29 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building C

Monthly..02/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building C													
Side Steps													
Corridor Room 321	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 331 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Central Staircase													
Corridor Room 322 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 334 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Side Steps													
Corridor Room 324	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Facade of Building													
Corridor Office 20/8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Behind the Building													
Corridor Office 20/5-8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


28/02-2024

People & Culture Manager


29 Feb. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building D

Monthly..02/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building D													
Side Steps													
Corridor Room 421	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	27/02/24	Santichai			Dismantled
Corridor Room 431	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	27/02/24	Santichai			Dismantled
Central Staircase													
Corridor Room 422	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 434	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Side Steps													
Corridor Room 424	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 437	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Facade of Building													
Corridor Office 20/12	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Behind the Building													
Corridor Office 20/9-12 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			

Remark;

[☒] Normal

[☐] Abnormal

Loss Prevention Check


28/02/2024

People & Culture Manager



29 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building E

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building E													
Side Steps													
Corridor Room 521	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	27/02/24	Santichai			Dismantled
Corridor Room 531	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	27/02/24	Santichai			Dismantled
Central Staircase													
Corridor Room 522	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 534	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Side Steps													
Corridor Room 524	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 537	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Facade of Building													
Corridor Office 20/16	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Behind the Building													
Corridor Office 20/13-16 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

People & Culture Manager

29 Feb. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building F

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building F													
Side Steps													
Corridor Room 621	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 631	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Central Staircase													
Corridor Room 623	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 633	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Side Steps													
Corridor Room 624	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 637	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Facade of Building													
Corridor Office 20/20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Behind the Building													
Corridor Office 20/17-20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	v	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

25/02/2024

People & Culture Manager

29 P.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building G													
Side Steps													
Corridor Room 721	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 731	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Central Staircase													
Corridor Room 722	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Corridor Room 733	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Side Steps													
Corridor Room 724	Chemical Powder-ABC	X	✓	✓	✓	✓	✓	✓	27/02/24	Santichai	27/02/24		Pressure down
Corridor Room 737	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Facade of Building													
Corridor Office 20/24	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			
Behind the Building													
Corridor Office 20/21-24 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	27/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

People & Culture Manager

29 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building H													
Side Steps													
Corridor Room 925	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Corridor Room 933	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Side Steps													
Corridor Room 924	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Corridor Room 927	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Facade of Building													
Corridor Office 20/26	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Behind the Building													
Corridor Office 20/25-26 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

28/02/2024

People & Culture Manager

29 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building I													
Side Steps													
Corridor Room 923	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Corridor Room 935	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Side Steps													
Corridor Room 936	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Corridor Room 949	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Facade of Building													
Corridor Office 20/27	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
Behind the Building													
Corridor Office 20/26-27 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			

Remark:

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
28/02/2024

People & Culture Manager

[Signature]

29 A.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing Floor 1, Restaurant, Lobby

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 1													
Loading x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Accounting Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Female Locker	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Canteen Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Main Kitchen x4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Electrical Control Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Captain Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Lift Main Kitchen x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Bai-Ruer Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Boat Point Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Loss Prevention Office	NON-CFC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Generator Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Gas Store	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
26/02/24

People & Culture Manager

[Signature]

29 P.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 2,3

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 2													
Corridor Room 242	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 250	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 256	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 264	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 272	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
FLOOR 3													
Corridor Room 342	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 348	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 352	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 358	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 364	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 372	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 380	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


26/02/2024

People & Culture Manager


29 N.W. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 4/White House Meeting Room

Monthly..02/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 4													
Corridor Room 442	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 448	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 454	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 460	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 466	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 474	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
Corridor Room 482	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	26/02/24	Santichai			
White House Meeting Room01	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
White House Meeting Room02	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
White House Meeting Room03	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
White House Meeting Room04	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
White House Meeting Room05	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			
White House Meeting Room KC x3	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/02/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
28/02/2024

People & Culture Manager

[Signature]

29 N.W. 2567

TEST RUN RECORD FOR EMERGENCY GENERATOR

GATE 15/02/2567 ENGINEER เสงี่ยม ใจดี
 GENERATOR 1000 KVA LOCATION อ.หาดใหญ่

สภาพเครื่องก่อน TEST RUN

- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
- ☒ สภาพสายพาน (Machine Belt)
- ☒ ระดับน้ำในหม้อน้ำ (Boiler)
- ☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN

☐ ON LOAD ☐ OFF LOAD

TIME START TIME STOP

รายการตรวจเช็ค		บันทึก
Oil (L.)		1800 L
Voltage (V)	L1	0
Voltage (V)	L2	0
Voltage (V)	L3	0
Coolant Temp (°C)		0
Oil Pressure (bar)		0
Speed (RPM)		0
Frequency (Hz)		0
Battery (V)		27.4
Run Time (h)		201h25m

REMARK

..... ตรวจเช็ค น้ำมัน 1800 ลิตร + ทำความสะอาด

..... 53079

.....

.....

.....

.....

.....

.....


.....

.....





งานทำความสะอาดห้องควบคุมไฟฟ้าย่อย 1 SDB

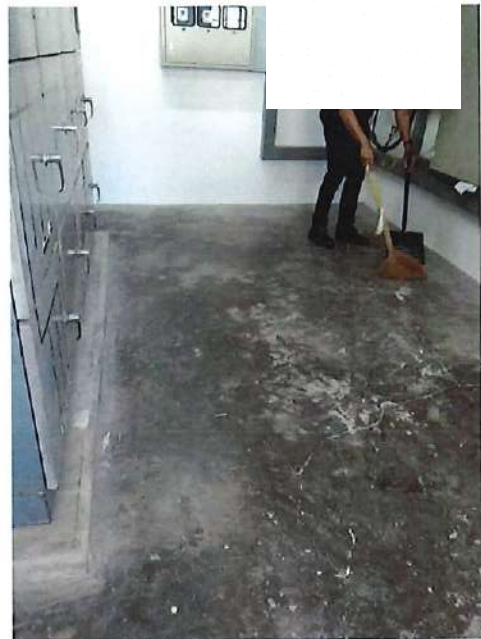

งานทำความสะอาดห้องควบคุมไฟฟ้า 2 MDB



งานทำความสะอาดห้องควบคุมไฟฟ้า 3 MDB



งานทำความสะอาดห้องควบคุมไฟฟ้า 1 MDB



Check List emergency light

[illegible]

(2) = Emergency Light

Supervisor by Wanda Tate Date 8/9/67

Check List emergency light

[illegible]

(1) = Fire Exit

(2) = Emergency Light

Responsible by WNS Date 23/3/17

Supervisor by benzoni jay Date 29/3/67

Check List emergency light

[illegible]

(2) = Emergency Light

Supervisor by బొమ్మిడి నవీన్ Date 29/9/27

Check List emergency light

[illegible]

(1) = Fire Exit

(2) = Emergency Light

Responsible by Yusuf Date 23/3/27

Supervisor by Bairam Singh Date 28/9/27

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Mar-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible byDate.....

Supervisor by benjamin f. faye Date 29/3/27

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Mar-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by 21/10/17 Date 23/3/17

Supervisor by Date 22/3/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Mar-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by unna Date 23/8/67

Supervisor by சென்னை கல்வி Date 23/3/67

Mar-24

Supervisor by சென்ட்ரல் டிபுட்டி Date 23/3/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Mar-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 241 (Fire Exit)	/	/	/	/	/			/			
Room 241 (Emergency)	/	/	/	/	/			/			
Room 246 (Fire Exit)	/	/	/	/	/			/			
Room 246 (Emergency)	/	/	/	/	/			/			
Room 252 (Fire Exit)	/	/	/	/	/			/			
Room 252 (Emergency)	/	/	/	/	/			/			
Room 263 (Fire Exit)	/	/	/	/	/	23/3/67	สมชาย	/			
Room 263 (Emergency)	/	/	/	/	/			/			
Room 269 (Fire Exit)	/	/	/	/	/			/			
Room 269 (Emergency)	/	/	/	/	/			/			
Room 274 (Fire Exit)	/	/	/	/	/			/			
Room 274 (Emergency)	/	/	/	/	/			/			
Room 247 (Fire Exit)	/	/	/	/	/			/			
Room 247 (Fire Emergency)	/	/	/	/	/			/			

Note: Mark [/] Normal

Mark (X) Abnormal

Responsible by Date 23/3/67

Supervisor by Date 23/3/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Mar-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 341 (Fire Exit)	/	/	/	/	/	23/3/67	gndon	/			
Room 341 (Emergency)	/	/	/	/	/			/			
Room 346 (Fire Exit)	/	/	/	/	/			/			
Room 346 (Emergency)	/	/	/	/	/			/			
Room 355 (Fire Exit)	/	/	/	/	/			/			
Room 355 (Emergency)	/	/	/	/	/			/			
Room 360 (Fire Exit)	/	/	/	/	/			/			
Room 360 (Emergency)	/	/	/	/	/			/			
Room 371 (Fire Exit)	/	/	/	/	/			/			
Room 371 (Emergency)	/	/	/	/	/			/			
Room 377 (Fire Exit)	/	/	/	/	/			/			
Room 377 (Emergency)	/	/	/	/	/			/			
Room 382 (Fire Exit)	/	/	/	/	/			/			
Room 382 (Emergency)	/	/	/	/	/			/			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by gndon Date 23/3/67

Supervisor by gndon Date 23/3/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Mar-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 441 (Fire Exit)	/	/	/	/	/	23/3/17	สมชาย	/			
Room 441 (Emergency)	/	/	/	/	/			/			
Room 446 (Fire Exit)	/	/	/	/	/			/			
Room 446 (Emergency)	/	/	/	/	/			/			
Room 456 (Fire Exit)	/	/	/	/	/			/			
Room 456 (Emergency)	/	/	/	/	/			/			
Room 462 (Fire Exit)	/	/	/	/	/			/			
Room 462 (Emergency)	/	/	/	/	/			/			
Room 473 (Fire Exit)	/	/	/	/	/			/			
Room 473 (Emergency)	/	/	/	/	/			/			
Room 479 (Fire Exit)	/	/	/	/	/			/			
Room 479 (Emergency)	/	/	/	/	/			/			
Room 484 (Fire Exit)	/	/	/	/	/			/			
Room 484 (Emergency)	/	/	/	/	/			/			

Note: Mark [/] Normal

Mark (X) Abnormal

Responsible byสมชาย.....Date 23/3/17

Supervisor byสมชาย ใจดี.....Date 23/3/17

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building A

Monthly..03/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building A													
Side Steps													
Corridor Room 121	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 131	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Central Staircase													
Corridor Room 122	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 124	NON-CFC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	28/03/24	Santichai			Dismantled
Corridor Room 137	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	28/03/24	Santichai			Dismantled
Facade of Building													
Corridor Room A21	NON-CFC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[V] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
30/3/24

People & Culture Manager

[Signature]

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building B

Monthly..03/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building B													
Side Steps													
Corridor Room 221	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 231	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Central Staircase													
Corridor Room 222 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 233 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 224	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/1-4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]

People & Culture Manager

[Signature]

- 1 (U.U. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building C

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building C													
Side Steps													
Corridor Room 321	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 331 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Central Staircase													
Corridor Room 322 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 334 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 324	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/5-8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

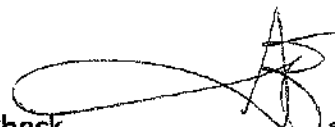
30/3/24

People & Culture Manager


- 1 W.U. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building D

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building D													
Side Steps													
Corridor Room 421	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	28/03/24	Santichai			Dismantled
Corridor Room 431	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	28/03/24	Santichai			Dismantled
Central Staircase													
Corridor Room 422	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 434	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 424	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 437	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/12	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/9-12 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

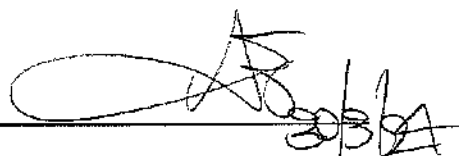

People & Culture Manager



NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building E

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building E													
Side Steps													
Corridor Room 521	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	28/03/24	Santichai			Dismantled
Corridor Room 531	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	28/03/24	Santichai			Dismantled
Central Staircase													
Corridor Room 522	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 534	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 524	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 537	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/16	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/13-16 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[**✓**] Normal

[**X**] Abnormal

Loss Prevention Check

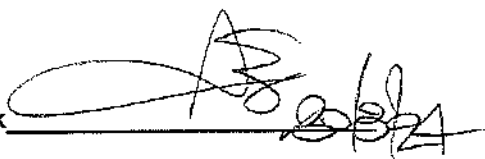

People & Culture Manager



- 1 B.B. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building F

Monthly..03/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building F													
Side Steps													
Corridor Room 621	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 631	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Central Staircase													
Corridor Room 623	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 633	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 624	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 637	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/17-20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

People & Culture Manager

- 1 W.U. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building G													
Side Steps													
Corridor Room 721	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 731	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Central Staircase													
Corridor Room 722	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 733	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 724	Chemical Powder-ABC	X	✓	✓	✓	✓	✓	✓	28/03/24	Santichai	27/02/24		Pressure down
Corridor Room 737	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/24	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/21-24 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


28/03/24

People & Culture Manager



- 1 W.O. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building H													
Side Steps													
Corridor Room 925	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 933	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 924	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 927	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/26	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/25-26 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


20/3/24

People & Culture Manager



- 1 M.O. 2567

NH BOAT LAGOON PHUKET RESORT **Check List Fire Extinguisher Building G**

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building I													
Side Steps													
Corridor Room 923	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 935	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Side Steps													
Corridor Room 936	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Corridor Room 949	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Facade of Building													
Corridor Office 20/27	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
Behind the Building													
Corridor Office 20/26-27 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			

Remark;


[✓] Normal

[X] Abnormal

Loss Prevention Check

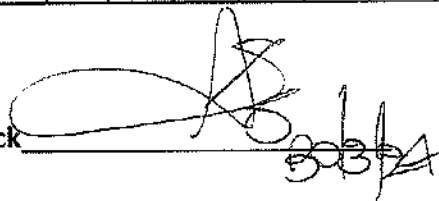

People & Culture Manager



- 1 W.O. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing Floor 1, Restaurant, Lobby

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 1													
Loading x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Accounting Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Female Locker	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Canteen Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			Fire Blanket x1
Main Kitchen x2	Chemical -ABCDK	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			Fire Blanket x2
Electrical Control Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Captain Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Lift Main Kitchen x2	Chemical Powder-AK	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Bai-Ruer Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Boat Point Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Loss Prevention Office	NON-CFC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Generator Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Gas Store	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

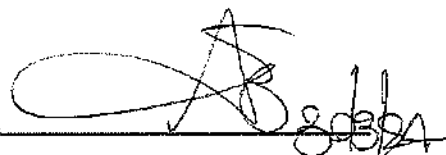

People & Culture Manager



NH BOAT LAGOON PHUKET RESORT
Check List Fire Extinguisher Hotel Wing FLOOR 2,3

Monthly..03/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 2													
Corridor Room 242	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 250	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 256	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 264	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 272	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
FLOOR 3													
Corridor Room 342	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 348	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 352	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 358	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 364	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 372	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 380	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			

Remark;


[✓] Normal

[X] Abnormal

Loss Prevention Check

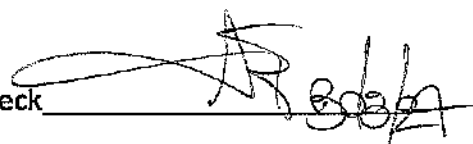

People & Culture Manager



NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 4/White House Meeting Room

Monthly..03/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 4													
Corridor Room 442	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 448	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 454	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 460	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 466	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 474	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
Corridor Room 482	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/03/24	Santichai			
White House Meeting Room01	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
White House Meeting Room02	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
White House Meeting Room03	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
White House Meeting Room04	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
White House Meeting Room05	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			
White House Meeting Room KC x3	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/03/24	Santichai			Fire Blanket x2

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
28/3/24

People & Culture Manager

[Signature]

TEST RUN RECORD FOR EMERGENCY GENERATOR

DATE 24/3/67 ENGINEER สมชาย
 GENERATOR 500 KVA LOCATION ลานกิจกรรม

สภาพเครื่องก่อน TEST RUN

- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
- ☒ สภาพสายพาน (Machine Belt)
- ☒ ระดับน้ำในหม้อน้ำ (Boiler)
- ☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN

☐ ON LOAD ☒ OFF LOAD

TIME START 14.00 TIME STOP 15.00

รายการตรวจเช็ค		บันทึก
Oil (L.)		400 L
Voltage (V)	L1	230
Voltage (V)	L2	-
Voltage (V)	L3	229
Coolant Temp (°C)		70
Oil Pressure (bar)		3.58
Speed (RPM)		-
Frequency (Hz)		-
Battery (V)		27.1
Run Time (h)		547 h

REMARK

หม้อน้ำ 100 ลิตร ใช้ 5 ลิตร ใช้ 0.5 ลิตร



TEST RUN RECORD FOR EMERGENCY GENERATOR

DATE 25/3/69 ENGINEER W. S. S.
GENERATOR 1000 KVA LOCATION 3.503m

สภาพเครื่องก่อน TEST RUN

- | | |
|---|------------------------------------|
| ✓ | ระดับน้ำมันเครื่อง (Motor Oil) |
| ✓ | สภาพสายพาน (Machine Bell) |
| ✓ | ระดับน้ำในหม้อน้ำ (Boiler) |
| ✓ | ระดับน้ำกลั่นในแบตเตอรี่ (Battery) |





TEST RUN

☐ ON LOAD ☒ OFF LOAD

TIME START 16.10 TIME STOP 15.26

รายการตรวจเช็ค		บันทึก
Oil (L.)		18.00
Voltage (V)	L1	234
Voltage (V)	L2	234
Voltage (V)	L3	234
Coolant Temp (°C)		63
Oil Pressure (bar)		5.17
Speed (RPM)		1509
Frequency (Hz)		50.2
Battery (V)		27.4
Run Time (h)		2021.40m

REMARK

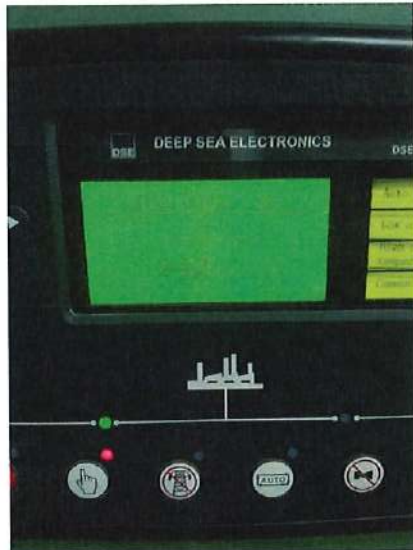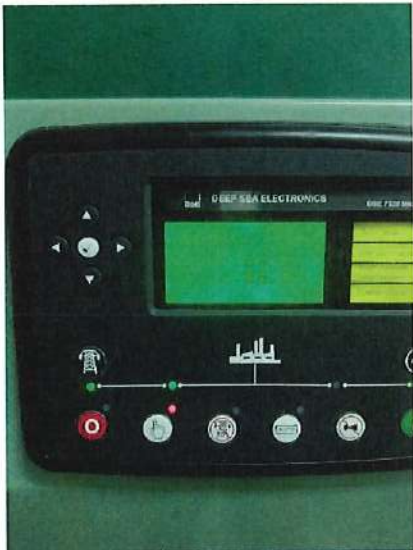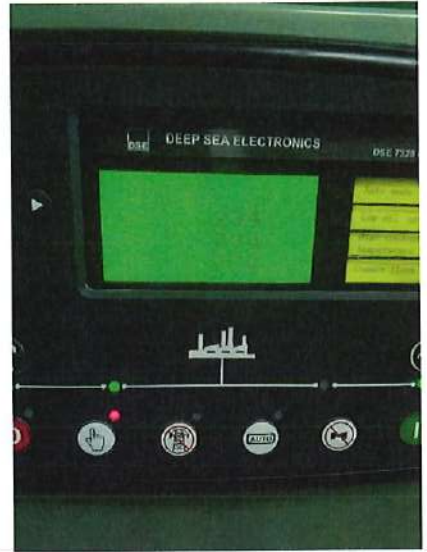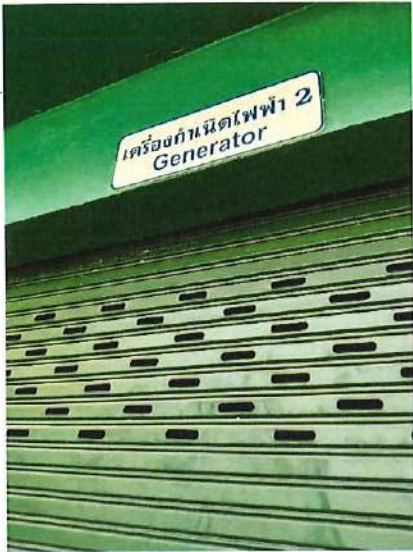

TEST RUN RECORD FOR EMERGENCY GENERATOR

DATE 25/3/67 ENGINEER W. J. J. J.
GENERATOR 400 KVA LOCATION Rm Hotel

สภาพเครื่องก่อน TEST RUN

- | | |
|-------------------------------------|------------------------------------|
| ☒ | ระดับน้ำมันเครื่อง (Motor Oil) |
| ☒ | สภาพสายพาน (Machine Belt) |
| ☒ | ระดับน้ำในหม้อน้ำ (Boiler) |
| ☒ | ระดับน้ำกลั่นในแบตเตอรี่ (Battery) |

TEST RUN

☐ ON LOAD ☒ OFF LOAD

TIME START 15.20 TIME STOP 16.00

รายการตรวจเช็ค		บันทึก
Oil (L.)		10.5
Voltage (V)	L1	230
Voltage (V)	L2	230
Voltage (V)	L3	230
Coolant Temp (°C)		60
Oil Pressure (bar)		4
Speed (RPM)		1502
Frequency (Hz)		52
Battery (V)		28
Run Time (h)		1078.7h

REMARK



NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building A

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building A													
Side Steps													
Corridor Room 121	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 131	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Central Staircase													
Corridor Room 122	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Side Steps													
Corridor Room 124	NON-CFC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/04/24	Santichai			Dismantled
Corridor Room 137	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/04/24	Santichai			Dismantled
Facade of Building													
Corridor Room A21	NON-CFC	√	√	√	√	√	√	√	30/04/24	Santichai			
Behind the Building													
Corridor MDB Room	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			

Remark;

[√] Normal

[X] Abnormal

Loss Prevention Check


80/04/24

People & Culture Manager



02 W.A. 2024

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building B

Monthly..04/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building B													
Side Steps													
Corridor Room 221	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 231	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Central Staircase													
Corridor Room 222 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 233 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Side Steps													
Corridor Room 224	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/1-4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


30/04/24

People & Culture Manager

 02 MAR 2024

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building C

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building C													
Side Steps													
Corridor Room 321	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 331 x2	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Central Staircase													
Corridor Room 322 x2	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 334 x2	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Side Steps													
Corridor Room 324	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/8	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/5-8	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			

Remark;

[**√**] Normal

[**X**] Abnormal

Loss Prevention Check

[Signature]
30/04/24

People & Culture Manager

[Signature]

02 M.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building D

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building D													
Side Steps													
Corridor Room 421	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/04/24	Santichai			Dismantled
Corridor Room 431	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/04/24	Santichai			Dismantled
Central Staircase													
Corridor Room 422	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 434	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Side Steps													
Corridor Room 424	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 437	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/12	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/9-12 x2	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			

Remark;

[☒] Normal

[☐] Abnormal

Loss Prevention Check


30/04/24

People & Culture Manager



02 W.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building E

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building E													
Side Steps													
Corridor Room 521	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/04/24	Santichai			Dismantled
Corridor Room 531	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/04/24	Santichai			Dismantled
Central Staircase													
Corridor Room 522	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 534	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Side Steps													
Corridor Room 524	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 537	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/16	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/13-16 x2	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			

Remark;

[☒] Normal

[☐] Abnormal

Loss Prevention Check


30/04/24

People & Culture Manager

 02 W.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building F

Monthly..04/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building F													
Side Steps													
Corridor Room 621	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 631	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Central Staircase													
Corridor Room 623	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 633	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Side Steps													
Corridor Room 624	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 637	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/17-20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


30/04/24

People & Culture Manager

 02 W.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..04/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building G													
Side Steps													
Corridor Room 721	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 731	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Central Staircase													
Corridor Room 722	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Corridor Room 733	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Side Steps													
Corridor Room 724	Chemical Powder-ABC	X	√	√	√	√	√	√	30/04/24	Santichai	27/02/24		Pressure down
Corridor Room 737	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/24	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/21-24 x2	Chemical Powder-ABC	√	√	√	√	√	√	√	30/04/24	Santichai			

Remark;

[√] Normal

[X] Abnormal

Loss Prevention Check


30/04/24

People & Culture Manager

 02 M.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building H													
Side Steps													
Corridor Room 925	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 933	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Side Steps													
Corridor Room 924	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 927	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/26	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/25-26 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
30/04/24

People & Culture Manager

[Signature] 02 M.A. 2567

NH BOAT LAGOON PHUKET RESORT
Check List Fire Extinguisher Building G

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building I													
Side Steps													
Corridor Room 923	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 935	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Side Steps													
Corridor Room 936	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Corridor Room 949	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Facade of Building													
Corridor Office 20/27	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			
Behind the Building													
Corridor Office 20/26-27 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/04/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


30/04/24

People & Culture Manager


D2 W.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing Floor 1, Restaurant, Lobby

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 1													
Loading x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Accounting Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Female Locker	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Canteen Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			Fire Blanket x1
Main Kitchen x2	Chemical -ABCDK	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			Fire Blanket x2
Electrical Control Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Captain Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Lift Main Kitchen x2	Chemical Powder-AK	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Bai-Ruer Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Boat Point Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Loss & Prevention Office	NON-CFC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Generator Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Gas Store	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


29/04/24

People & Culture Manager

 02 W.A. 2567

NH BOAT LAGOON PHUKET RESORT
Check List Fire Extinguisher Hotel Wing FLOOR 2,3

Monthly..04/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 2													
Corridor Room 242	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 250	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 256	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 264	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 272	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
FLOOR 3													
Corridor Room 342	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 348	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 352	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
CorridorRoom 358	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 364	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 372	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 380	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check


30/04/24

People & Culture Manager

 02 W.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 4/White House Meeting Room

Monthly..04/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 4													
Corridor Room 442	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 448	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 454	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 460	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 466	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 474	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
Corridor Room 482	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
White House Meeting Room01	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
White House Meeting Room02	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
White House Meeting Room03	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
White House Meeting Room04	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
White House Meeting Room05	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			
White House Meeting Room KC x3	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	25/04/24	Santichai			Fire Blanket x2

Remark;

[✓] Normal

[X] Abnormal

Loss Prevention Check

[Signature]
30/04/24

People & Culture Manager

[Signature]

02 W.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by

Supervisor by _____

Date

.Date

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by [Signature] Date 25/4/67

Supervisor by Lin Wang Date 2/5/67

Apr-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by Qamar ul Huda Date 25/4/67

Supervisor by Leinhardt T. N. K. e Date 2/5/67

Check List emergency light

[illegible]

(2) = Emergency Light

Supervisor by సీనియర్ ఇంజనీర్ Date 2/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by Adnan Sidiq Date 27/4/67

Supervisor by பெரியசாமி சகலா Date 15/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by

Supervisor by _____

Responsible by Syner Sakt Date 27/4/67

Supervisor by revised 3/15/67 Date 2/15/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

[illegible]

Note:Mark [✓] Normal

(1) = Fire Exit

Mark (X) Abnormal

(2) = Emergency Light

Responsible by Samer Samir Date 27/4/67

Supervisor by Wingard Satish Date 2/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by APB Date 26/3/07

Supervisor by leindan [signature] Date 2/3/07

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 241 (Fire Exit)	✓	✓	✓	✓	✓	25/01/67	มณฑล	✓			
Room 241 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 246 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 246 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 252 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 252 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 263 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 263 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 269 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 269 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 274 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 274 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 247 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 247 (Emergency)	✓	✓	✓	✓	✓			✓			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by มณฑล Date 25/01/67

Supervisor by วิศวกร Date 2/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 341 (Fire Exit)	✓	✓	✓	✓	✓	15/01/67	Dharmak	✓			
Room 341 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 346 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 346 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 355 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 355 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 360 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 360 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 371 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 371 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 377 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 377 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 382 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 382 (Emergency)	✓	✓	✓	✓	✓			✓			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by Dharmak Date 15/01/67

Supervisor by Kongsak Date 2/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

Apr-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 441 (Fire Exit)	✓	✓	✓	✓	✓	25/01/67	Dhansin	✓			
Room 441 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 446 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 446 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 456 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 456 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 462 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 462 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 473 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 473 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 479 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 479 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 484 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 484 (Emergency)	✓	✓	✓	✓	✓			✓			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by Dhansin Date 25/01/67

Supervisor by Saisak Sae Date 2/5/67

TEST RUN RECORD FOR EMERGENCY GENERATOR

GATE 20/4/62 ENGINEER นาย
 GENERATOR 800 KVA LOCATION ข. 195

สภาพเครื่องก่อน TEST RUN


- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
☒ สภาพสายพาน (Machine Belt)
☒ ระดับน้ำในหม้อน้ำ (Boiler)
☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN

☐ ON LOAD ☒ OFF LOAD

TIME START 13:30 TIME STOP 14:30

รายการตรวจเช็ค		บันทึก	REMARK
Oil (L.)		10.5	
Voltage (V)	L1	233	
Voltage (V)	L2	233	
Voltage (V)	L3	232	
Coolant Temp (°C)		60	
Oil Pressure (bar)		4	
Speed (RPM)		1500	
Frequency (Hz)		50	
Battery (V)		28	
Run Time (h)		107.5h	

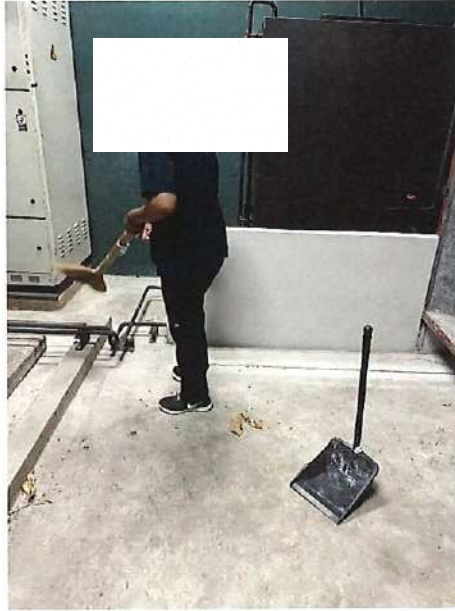

TEST RUN RECORD FOR EMERGENCY GENERATOR

GATE 261A/67 ENGINEER mark
 GENERATOR 1000 KVA LOCATION 3,50m5

สภาพเครื่องก่อน TEST RUN

- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
- ☒ สภาพสายพาน (Machine Bell)
- ☒ ระดับน้ำในหม้อน้ำ (Boiler)
- ☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN

☐ ON LOAD ☒ OFF LOAD

TIME START 16.19 TIME STOP 17.28

รายการตรวจเช็ค		บันทึก
Oil (L.)		1800
Voltage (V)	L1	236
Voltage (V)	L2	236
Voltage (V)	L3	236
Coolant Temp (°C)		63
Oil Pressure (bar)		0.14
Speed (RPM)		1509
Frequency (Hz)		50.2
Battery (V)		27.4
Run Time (h)		20440

REMARK

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....



TEST RUN RECORD FOR EMERGENCY GENERATOR

GATE 266/167 ENGINEER กฤษ
 GENERATOR 500 kVA LOCATION ต.น.ก. ๑๕๕

สภาพเครื่องก่อน TEST RUN

- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
- ☒ สภาพสายพาน (Machine Belt)
- ☒ ระดับน้ำในหม้อน้ำ (Boiler)
- ☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN


☐ ON LOAD ☒ OFF LOAD

TIME START 14:20 TIME STOP 15:25

รายการตรวจเช็ค		บันทึก
Oil (L.)		400 L
Voltage (V)	L1	290
Voltage (V)	L2	-
Voltage (V)	L3	292
Coolant Temp (°C)		70
Oil Pressure (bar)		4.56
Speed (RPM)		-
Frequency (Hz)		-
Battery (V)		27.0
Run Time (h)		๑ ชม

REMARK

ไม่พบปัญหา

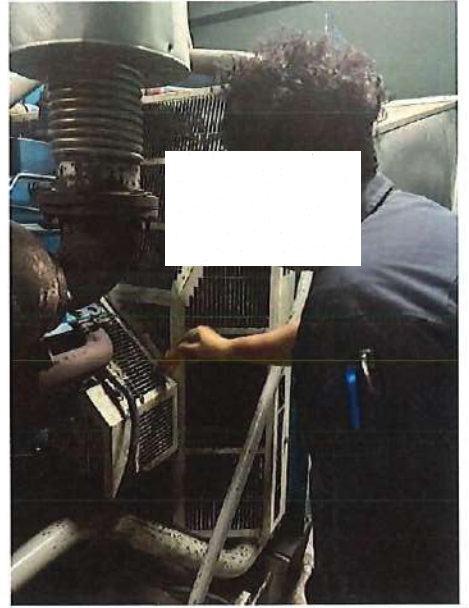

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by

Supervisor by _____

..Date.....

.Date.....

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

(1) = Fire Exit

Mark (X) Abnormal

(2) = Emergency Light

Responsible by

Supervisor by _____

...Date... 30/5/67

..Date..... 31/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by

Supervisor by _____

Date.....

Date 31/5

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by গণনা সিস্টেম Date ২০/১/১৭

Supervisor by 10/5/67 Date 92/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by สมชาย ใจดี Date 30/5/67

Supervisor by 12/20/05 Date 3/15/07

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by gimben gnt Date 30/6/67

Supervisor by Leni Wank Date 31/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by

Supervisor by _____

Responsible by gama 70/12 Date 29/4/17

Supervisor by Date 9/15/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

(1) = Fire Exit

Mark (X) Abnormal

(2) = Emergency Light

Responsible by Eymen İmre Date 30/5/67

Supervisor by Date 9/7/16

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 241 (Fire Exit)	/	/	/	/	/			/			
Room 241 (Emergency)	/	/	/	/	/			/			
Room 246 (Fire Exit)	/	/	/	/	/			/			
Room 246 (Emergency)	/	/	/	/	/			/			
Room 252 (Fire Exit)	/	/	/	/	/			/			
Room 252 (Emergency)	/	/	/	/	/	30/5/67	gndor	/			
Room 263 (Fire Exit)	/	/	/	/	/			/			
Room 263 (Emergency)	/	/	/	/	/			/			
Room 269 (Fire Exit)	/	/	/	/	/			/			
Room 269 (Emergency)	/	/	/	/	/			/			
Room 274 (Fire Exit)	/	/	/	/	/			/			
Room 274 (Emergency)	/	/	/	/	/			/			
Room 247 (Fire Exit)	/	/	/	/	/			/			
Room 247 (Emergency)	/	/	/	/	/			/			

Note:Mark [✓] Normal

Mark (X) Abnormal

Responsible bygndor 30/5/67

Supervisor bywirod 31/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 341 (Fire Exit)	/	/	/	/	/	30/5/67	gmon	/			
Room 341 (Emergency)	/	/	/	/	/			/			
Room 346 (Fire Exit)	/	/	/	/	/			/			
Room 346 (Emergency)	/	/	/	/	/			/			
Room 355 (Fire Exit)	/	/	/	/	/			/			
Room 355 (Emergency)	/	/	/	/	/			/			
Room 360 (Fire Exit)	/	/	/	/	/			/			
Room 360 (Emergency)	/	/	/	/	/			/			
Room 371 (Fire Exit)	/	/	/	/	/			/			
Room 371 (Emergency)	/	/	/	/	/			/			
Room 377 (Fire Exit)	/	/	/	/	/			/			
Room 377 (Emergency)	/	/	/	/	/			/			
Room 382 (Fire Exit)	✓	✓	✓	✓	✓			/			
Room 382 (Emergency)	✓	✓	✓	✓	✓			/			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by gmon 555 Date 30/5/67
 Supervisor by Leinab Date 31/5/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 441 (Fire Exit)	✓	✓	✓	✓	✓	30/5/67	สมชาย	✓			
Room 441 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 446 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 446 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 456 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 456 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 462 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 462 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 473 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 473 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 479 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 479 (Emergency)	✓	✓	✓	✓	✓			✓			
Room 484 (Fire Exit)	✓	✓	✓	✓	✓			✓			
Room 484 (Emergency)	✓	✓	✓	✓	✓			✓			

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by

สมชาย 30/5/67

Supervisor by

31/5/67

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building A

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building A													
Side Steps													
Corridor Room 121	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 131	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Central Staircase													
Corridor Room 122	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 124	NON-CFC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/05/24	Santichai			Dismantled
Corridor Room 137	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/05/24	Santichai			Dismantled
Facade of Building													
Corridor Room A21	NON-CFC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

AS
30/05/24

People & Culture Manager

hon

05 มิ.ย. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building B

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building B													
Side Steps													
Corridor Room 221	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 231	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Central Staircase													
Corridor Room 222 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 233 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 224	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/1-4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

[Signature]
20/05/24

People & Culture Manager

[Signature]

05.05.2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building C

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building C													
Side Steps													
Corridor Room 321	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 331 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Central Staircase													
Corridor Room 322 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 334 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 324	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/5-8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

[Signature]
00/05/24

People & Culture Manager

[Signature]

05 0.0. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building D

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building D													
Side Steps													
Corridor Room 421	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/05/24	Santichai			Dismantled
Corridor Room 431	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/05/24	Santichai			Dismantled
Central Staircase													
Corridor Room 422	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 434	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 424	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 437	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/12	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/9-12 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[**✓**] Normal

[**X**] Abnormal

Loss & Prevention Check

[Signature]
30/5/24

People & Culture Manager

[Signature]

05 08 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building E

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building E													
Side Steps													
Corridor Room 521	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/05/24	Santichai			Dismantled
Corridor Room 531	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/05/24	Santichai			Dismantled
Central Staircase													
Corridor Room 522	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 534	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 524	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 537	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/16	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/13-16 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

AS
00/05/24

People & Culture Manager

1000
05.08.2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building F

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building F													
Side Steps													
Corridor Room 621	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 631	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Central Staircase													
Corridor Room 623	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 633	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 624	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 637	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/17-20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;


[✓] Normal

[X] Abnormal

Loss & Prevention Check


0015/24

People & Culture Manager



05 มิ.ย. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building G													
Side Steps													
Corridor Room 721	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 731	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Central Staircase													
Corridor Room 722	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 733	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 724	Chemical Powder-ABC	X	✓	✓	✓	✓	✓	✓	30/05/24	Santichai	27/02/24		Pressure down
Corridor Room 737	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/24	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/21-24 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

[Signature]
30/3/24

People & Culture Manager

[Signature]

05 ส.อ. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..05/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building H													
Side Steps													
Corridor Room 925	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 933	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 924	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 927	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/26	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/25-26 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check


30/5/24

People & Culture Manager



05.08.2024

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building I													
Side Steps													
Corridor Room 923	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 935	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Side Steps													
Corridor Room 936	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Corridor Room 949	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Facade of Building													
Corridor Office 20/27	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			
Behind the Building													
Corridor Office 20/26-27 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

AS
30/5/24

People & Culture Manager

Pro

05 ส.ค. 2567

NH BOAT LAGOON PHUKET RESORT
Check List Fire Extinguisher Hotel Wing Floor 1, Restaurant, Lobby

Monthly..05/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 1													
Loading x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Accounting Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Female Locker	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Canteen Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			Fire Blanket x1
Main Kitchen x2	Chemical -ABCDK	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			Fire Blanket x2
Electrical Control Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Captain Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Lift Main Kitchen x2	Chemical Powder-AK	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Bai-Ruer Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Boat Point Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Loss & Prevention Office	NON-CFC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Generator Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Gas Store	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check


30/5/24

People & Culture Manager



05 มิ.ย. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 2,3

Monthly..05/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 2													
Corridor Room 242	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 250	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 256	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 264	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 272	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Front Office	Chemical Powder-ABC	X	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			Pressure down
FLOOR 3													
Corridor Room 342	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 348	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 352	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 358	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 364	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 372	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 380	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

[Signature]
30/5/24

People & Culture Manager

[Signature]

05 0.0. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 4/White House Meeting Room

Monthly..05/2024


Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 4													
Corridor Room 442	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 448	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 454	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 460	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 466	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 474	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
Corridor Room 482	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
White House Meeting Room01	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
White House Meeting Room02	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
White House Meeting Room03	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
White House Meeting Room04	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
White House Meeting Room05	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			
White House Meeting Room KC x3	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	29/05/24	Santichai			Fire Blanket x2

Remark;


[**V**] Normal

[**X**] Abnormal

Loss & Prevention Check


20/5/24

People & Culture Manager



05 ส.อ. 2567

TEST RUN RECORD FOR EMERGENCY GENERATOR

DATE 25/5/67 ENGINEER เอนจิเนียร์
GENERATOR 800 KVA LOCATION R 135 ไชยเคี

สภาพเครื่องก่อน TEST RUN

- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
- ☒ สภาพสายพาน (Machine Belt)
- ☒ ระดับน้ำในหม้อน้ำ (Boiler)
- ☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN

☒ ON LOAD ☐ OFF LOAD

TIME START 13.30 TIME STOP 14.30

รายการตรวจเช็ค		บันทึก
Oil (L.)		<u>1050</u>
Voltage (V)	L1	<u>400</u>
Voltage (V)	L2	<u>400</u>
Voltage (V)	L3	<u>400</u>
Coolant Temp (°C)		<u>85</u>
Oil Pressure (bar)		<u>4</u>
Speed (RPM)		<u>1500</u>
Frequency (Hz)		<u>52</u>
Battery (V)		<u>28</u>
Run Time (h)		<u>1090.1</u>

REMARK

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

TEST RUN RECORD FOR EMERGENCY GENERATOR

DATE 29/5/67 ENGINEER ใน กิ่ง
GENERATOR 500KVA LOCATION หมู่ที่ ๑๓๕๘๘

สภาพเครื่องก่อน TEST RUN

- | | |
|-------------------------------------|------------------------------------|
| ☒ | ระดับน้ำมันเครื่อง (Motor Oil) |
| ☒ | สภาพสายพาน (Machine Belt) |
| ☒ | ระดับน้ำในหม้อน้ำ (Boiler) |
| ☒ | ระดับน้ำกลั่นในแบตเตอรี่ (Battery) |

TEST RUN

☒ ON LOAD ☐ OFF LOAD

TIME START 18.46 TIME STOP 14.25

รายการตรวจเช็ค		บันทึก
Oil (L.)		25%
Voltage (V)	L1	397
Voltage (V)	L2	-
Voltage (V)	L3	404
Coolant Temp (°C)		70.
Oil Pressure (bar)		3.23
Speed (RPM)		-
Frequency (Hz)		-
Battery (V)		27.2
Run Time (h)		-

REMARK

အသံစုံ ချစ်မြတ်နိုးပါမိလေ

ព្រះបាទសម្តេចនរោត្តម

10/10/2002

 $251 \rightarrow 727$

TEST RUN RECORD FOR EMERGENCY GENERATOR

DATE 22/5/67 ENGINEER ชตธนา
 GENERATOR 1000 KVA LOCATION 3508th

สภาพเครื่องก่อน TEST RUN

- ☒ ระดับน้ำมันเครื่อง (Motor Oil)
- ☒ สภาพสายพาน (Machine Belt)
- ☒ ระดับน้ำในหม้อน้ำ (Boiler)
- ☒ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN



☐ ON LOAD ☐ OFF LOAD


TIME START TIME STOP





รายการตรวจเช็ค		บันทึก
Oil (L.)		17.20 L
Voltage (V)	L1	-
Voltage (V)	L2	-
Voltage (V)	L3	-
Coolant Temp (°C)		-
Oil Pressure (bar)		-
Speed (RPM)		-
Frequency (Hz)		-
Battery (V)		-
Run Time (h)		-

REMARK

ทำงานปกติ และ ใช้น้ำกลั่น

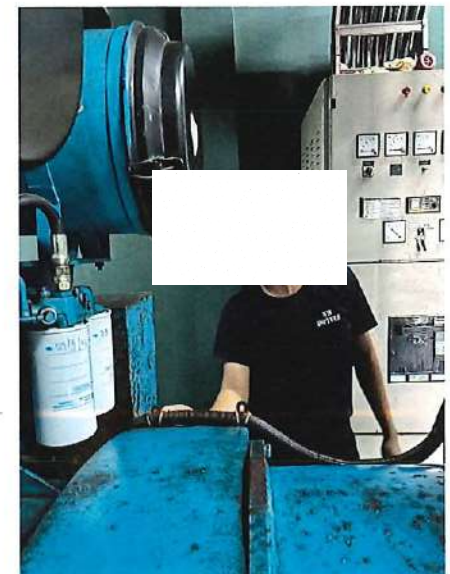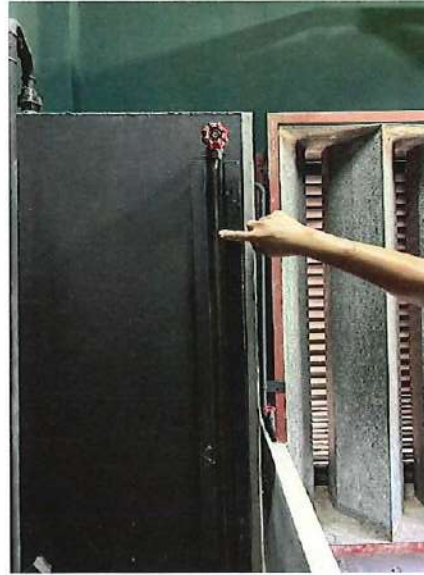

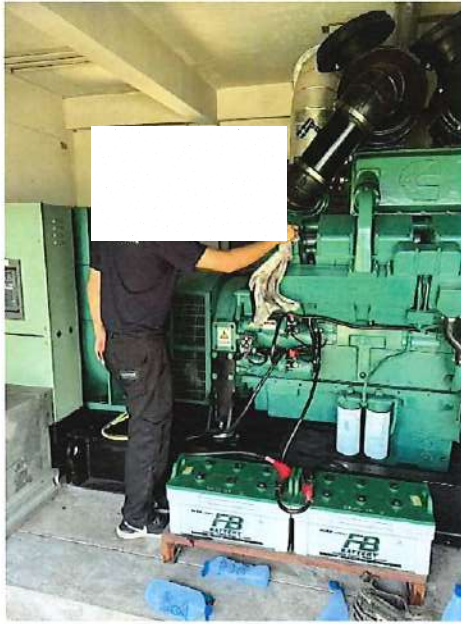

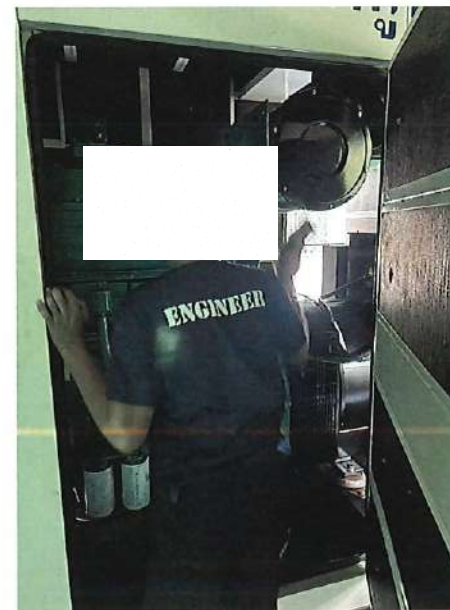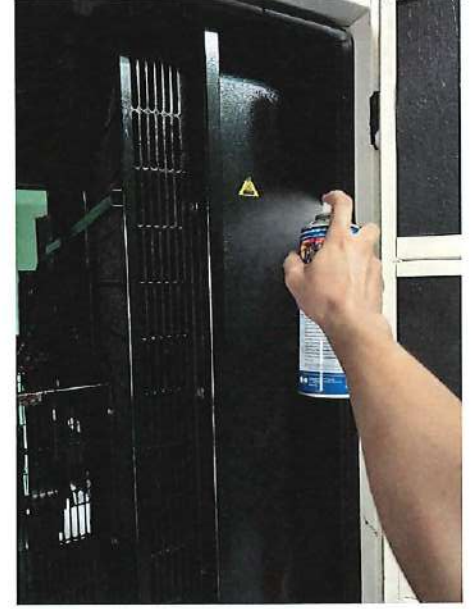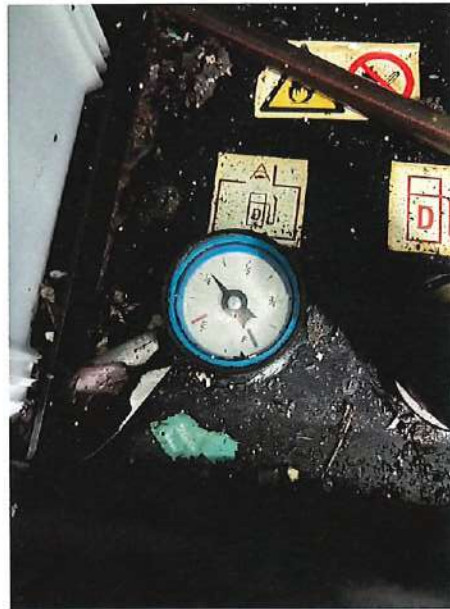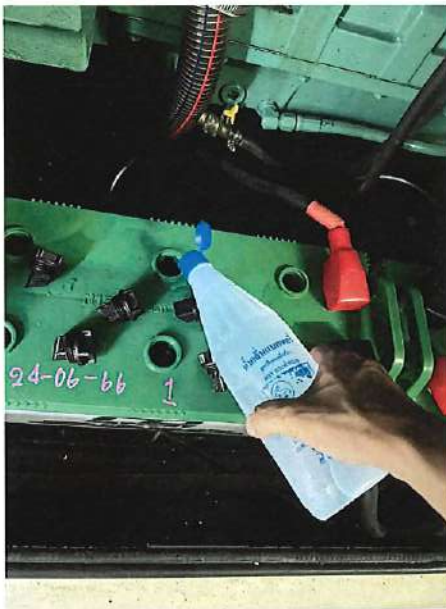



Global Marine Tech Co.,Ltd.

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel : 66(0)76 373 024

Fax : 66(0)76 373 025

Tax ID : 0835555000220

Email: info@gmthkt.com

DELIVERY ORDER / ใบส่งของ

Customer : Khun Suriyan

Company : Phuket Boat Lagoon.

Address : 22/1 Moo 2, Thepkasatri Rd., T.Kohkaew, A.Muang, Phuket 83110

Tel. : 076-239888

Fax : 076-239255

Subject : [Spare part] Service Preventive Maintenance Generator Cummins KTA19-G4 SN:41196000/500 KVA.

Quotation No. : GMT2403-036 PU

PO No. : HBLP24004330

Delivery Date : 28-05-2024

Mobile :

We thank you for your inquiry and we are pleased to provide quotation as per the following details :

Item	Part No.	Description	Qty
1		Fuel Filter.	2 EA
2		Coolant Filter.	1 EA
3		Lube Filter No.1.	2 EA
4		Lube Filter No.2.	1 EA
5		Air Filter.	1 EA
6		Engine Oil 15W-40.	52 Liter
7		Coolant.	1 Lot

Please send email to info@gmthkt.com for queries with this account.

REMITTANCE ADVICE

Delivery By



Receive By

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand
Tel: +66 076 373 024 Fax: +66 076 373 025 Email: Sales1@gmthkt.com http: www.gmthkt.com



Global Marine Tech Co.,Ltd.

58/115 Phoemsin Thani Village Moo 6 T.Ratsada, A.Muangphuket, Phuket 83000 THAILAND

Tel: 66(0)76-373 024

Fax: 66(0)76-373 025

Tax ID : 0835555000220

Email: info@gmthkt.com

1/1

Preventive Maintenance Work Order

Customer : Khun Suriyan

Work Order No. : WO2405-034 PU

Company : Phuket Boat Lagoon.

Quotation No. : GMT2403-036 PU

Address : 22/1 Moo 2, Thepkasattri Road, Kaokaew,Muang Phuket 83110

PO No. : HBLP240004330

Tel. : 076 239 888


Fax :

Date of Service : 28-05-2024

Mobile : 082-2797177

E-mail :

Item	QTY	Description
		<u>Service Preventive Maintenance Cummins KTA19-G4/500 KVA.</u> - Check engine control. - Check external cooling pipes. - Check engine and external engine exhaust system. - Check external leak. - Check coolant pump, Battery condition, And charger systems. - Check clean up air filter. - Inspection vibration damper, Belt condition. - Check engine lube oil, Fuel filter, Coolant filter. - Check fuel system. - Check exhaust line. - Check the electric system. - Check engine following periodical maintenance table. - Test run engine. - Check function of generator. - Provide Report.


Customer Name




Service Engineer
(Global Marine Tech Co.,Ltd.)

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel: +66 076 373 024 Fax: +66 076 373 025 Email: Sales1@gmthkt.com http: www.gmthkt.com



Global Marine Tech Co.,Ltd.

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel : 66(0)76 373 024

Fax : 66(0)76 373 025

Tax ID : 0835555000220

Email: info@gmthkt.com

DELIVERY ORDER / ใบส่งของ

Customer : Khun Suriyan

Quotation No. : GMT2403-035 PU

Company : Phuket Boat Lagoon.

PO No. : HBLP24004240

Address : 22/1 Moo 2, Thepkasattri Rd., T.Kohkaew, A.Muang, Phuket 83110

Delivery Date : 28-05-2024

Tel. : 076-239888

Fax : 076-239255

Mobile :

Subject : [Spare part] Service Preventive Maintenance Generator Cummins KTA38-G2A SN:41246531/1000 KVA.

We thank you for your inquiry and we are pleased to provide quotation as per the following details :

Item	Part No.	Description	Qty
1		Fuel Filter.	2 EA
2		Coolant Filter.	4 EA
3		Oil Filter No. 1	4 EA
4		Oil Filter No. 2	2 EA
5		Air Filter.	2 EA
6		Engine Oil.	126 Liter
7		Coolant.	1 Lot

Please send email to info@gmthkt.com for queries with this account.

REMITTANCE ADVICE

Delivery By





Receive By



Global Marine Tech Co., Ltd.

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel: +66 076 373 024 Fax: +66 076 373 025 Email: Sales1@gmthkt.com http: www.gmthkt.com



Global Marine Tech Co.,Ltd.

58/115 Phoemsin Thani Village Moo 6 T.Ratsada, A.Muangphuket, Phuket 83000 THAILAND

Tel: 66(0)76-373 024

Fax: 66(0)76-373 025

Tax ID : 0835555000220

Email: info@gmthkt.com

1/1

Preventive Maintenance Work Order

Customer : Khun Suriyan

Work Order No. : WO2405-035 PU

Company : Phuket Boat Lagoon.

Quotation No. : GMT2405-035 PU

Address : 22/1 Moo 2, Thepkasattri Road, Kaokaew,Muang Phuket 83110

PO No. : HBLP24004240

Tel. : 076 239 888


Fax :

Date of Service : 26-05-2023

Mobile : 082-2797177

E-mail :

Item	QTY	Description
		<u>Service Preventive Maintenance Cummins KTA38-G2A/1000 KVA.</u> - Check engine control. - Check external cooling pipes. - Check engine and external engine exhaust system. - Check external leak. - Check coolant pump, Battery condition, And charger systems. - Check clean up air filter. - Inspection vibration damper, Belt condition. - Check engine lube oil, Fuel filter, Coolant filter. - Check fuel system. - Check exhaust line. - Check the electric system. - Check engine following periodical maintenance table. - Test run engine. - Check function of generator. - Provide Report.


Customer Name




Service Engineer
(Global Marine Tech Co.,Ltd.)



Global Marine Tech Co.,Ltd.

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel : 66(0)76 373 024

Fax : 66(0)76 373 025

Tax ID : 0835555000220

Email: info@gmthkt.com

DELIVERY ORDER / ใบส่งของ

Customer : Khun Suriyan

Company : Phuket Boat Lagoon.

Address : 22/1 Moo 2, Thepkasattri Rd., T.Kohkaew, A.Muang, Phuket 83110

Tel. : 076-239888

Fax : 076-239255

Subject : [Spare part] Service Preventive Maintenance Generator Perkins 3012-TAG2

Quotation No. : GMT2403-034 PU

PO No. : HBLP24004210

Delivery Date : 28-05-2024

Mobile :

We thank you for your inquiry and we are pleased to provide quotation as per the following details :

Item	Part No.	Description	Qty
1		Fuel Filter.	2 EA
2		Lube Filter.	3 EA
3		Air Filter.	2 EA
4		Engine Oil 15W-40.	78 Liter
5		Coolant.	1 Lot

Please send email to info@gmthkt.com for queries with this account.

REMITTANCE ADVICE

Delivery By



Receive By

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel: +66 076 373 024 Fax: +66 076 373 025 Email: Sales1@gmthkt.com http: www.gmthkt.com



Global Marine Tech Co.,Ltd.

58/115 Phoemsin Thani Village Moo 6 T.Ratsada, A.Muangphuket, Phuket 83000 THAILAND

Tel: 66(0)76-373 024

Fax: 66(0)76-373 025

Tax ID : 0835555000220

Email: info@gmthkt.com

1/1

Preventive Maintenance Work Order

Customer : Khun Suriyan
Company : Phuket Boat Lagoon.
Address : 22/1 Moo 2, Thepkasattri Road, Kaokaew,Muang Phuket 83110
Tel. : 076 239 888 Fax :
Mobile : 082-2797177

Work Order No. : WO2405-033 PU
Quotation No. : GMT2403-034 PU
PO No. : HBLP24004240
Date of Service : 28-05-2024
E-mail :

Item	QTY	Description
		Service Preventive Maintenance Generator Perkins 3012-TAG2 - Check engine control. - Check external cooling pipes. - Check engine and external engine exhaust system. - Check external leak. - Check coolant pump, Battery condition, And charger systems. - Check clean up air filter. - Inspection vibration damper, Belt condition. - Check engine lube oil, Fuel filter, Coolant filter. - Check fuel system. - Check exhaust line. - Check the electric system. - Check engine following periodical maintenance table. - Test run engine. - Check function of generator. - Check list Report.

Customer Name



Service Engineer
(Global Marine Tech Co.,Ltd.)

Global Marine Tech Co., Ltd.

58/115 Moo 6 Phoemsin thani village T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel: +66 076 373 024 Fax: +66 076 373 025 Email: Sales1@gmthkt.com http: www.gmthkt.com

**Global Marine**58/115 Phoemsin Thani Village, Moo 6 T.
Tel. 076 373 024 Fax. 076**SERVICE AND INSP**

Customer: Phuket Boat Lagoon

Customer Address: 12/1 Mos 2, Thepkasitvi Rd, Thonkhaeng A. Muang Phuket 83110

Generator model: 01300906

S/N 0139173/01

DATE: 28-05-24

Alternator model: STAMFORD

S/N 0139173/01

Engine Hour: 1080 h

Engine model: SD12-TAG2A

S/N 50612029-01213

Controller Model:

Item	Description	Check	Clean		
1	ระบบหล่อเย็น (Cooling System)				
1.1	ตรวจสอบระดับน้ำในหม้อน้ำ (Top up). ตรวจสอบสภาพหม้อน้ำ	/	/		
1.2	ตรวจสอบความตึงของ Belt Tension. Thermostat Housing	/	/		
1.3	ตรวจสอบการทำงานของปั๊มน้ำหล่อเย็น. ระบายน้ำ Radiator. Water pump	/	/		
1.4	ตรวจสอบคุณภาพน้ำมันหล่อเย็น (Coolant Filter)	/	/		
2	ระบบหล่อลื่น (Lubrication System)				
2.1	ตรวจสอบระดับน้ำมันหล่อลื่น Dipstick (H ☒ / M ☐ / L ☐)	/	/		
2.2	ตรวจสอบสภาพของ Oil Filter และการทำงานของปั๊มน้ำมันหล่อลื่น	/	/		
2.3	ตรวจสอบสภาพของสายลม. ถังน้ำมันเชื้อเพลิง. ท่อลม Breather pipe. Oil Sampling Point. Filter Cap.	/	/		
2.4	ตรวจสอบความชื้นในน้ำ (Grease for Cooling pump)	/	/		
2.5	ตรวจสอบความตึงของสายลมและสายพาน (Belt Tension / Grease)	/	/		
2.6	ตรวจสอบการหล่อลื่น (Grease for Alternator)	/	/		
3	ระบบน้ำมันเชื้อเพลิง (Fuel System)				
3.1	ตรวจสอบระดับน้ำมันเชื้อเพลิงในถัง (F ☐ / M ☒ / E ☐) 1150 PPS	/	/		
3.2	ตรวจสอบสภาพของ Primary Fuel Filter และการทำงานของปั๊มน้ำมันเชื้อเพลิง	/	/		
3.3	ตรวจสอบสภาพของ Secondary Fuel Filter และการทำงานของปั๊มน้ำมันเชื้อเพลิง	/	/		
3.4	ตรวจสอบสภาพของ Fuel Injection Pump. Relief Valve. Fuel Lift Pump	/	/		
3.5	ตรวจสอบสภาพของ Governor. Throttle Lever. Governor Weights	/	/		
4	ระบบอากาศ (Air System & Exhaust System)				
4.1	ตรวจสอบสภาพของ Air Filter Component	/	/		
4.2	ตรวจสอบสภาพของ Turbocharger. Inter manifold. Exhaust Manifold	/	/		
5	ระบบไฟฟ้า (Electric System)				
5.1	ตรวจสอบสภาพของสายไฟและจุดต่อสายไฟตามจุดต่างๆ	/	/		
5.2	DC : ตรวจสอบสภาพของแบตเตอรี่, ขั้วแบตเตอรี่ สายไฟ และ สาย Ground	/	/		
5.3	DC : ตรวจสอบระดับน้ำกรดในแบตเตอรี่ ระบบ (Top up) (F ☐ / M ☒ / E ☐)	/	/		
5.4	AC : ตรวจสอบสภาพและการทำงานของ Circuit Breaker	/	/		
5.5	ตรวจสอบการทำงานของ Battery Charger	/	/		
6	Control Panel Functional Operation				
6.1	ทดสอบหลอดไฟ LED และสัญญาณเตือน (Lamp Test / Reset)	/	/		
6.2	ทดสอบความดันน้ำมันเครื่อง (PSI) (2 - 5 BAR)	/	/		
6.3	ทดสอบอุณหภูมิหม้อน้ำ (°C) (°F)	/	/		
6.4	ทดสอบความเร็วรอบ (rpm) (ความถี่ Hz)	/	/		
6.5	ทดสอบ Battery Charging (DC) (Volt) (Amp)	/	/		
6.6	การทำงานของสัญญาณเตือนการระบุน้ำมันเครื่อง (Alarm Status)	/	/		
6.7	การทำงานของ Emergency Push button switch	/	/		
6.8	การทำงานของ AC Volt & Amp Selector	/	/		
6.9	การทำงานของ Start Manual Run Auto และ Stop	/	/		
7	ระบบกันเสียง (Soundproof System)				
7.1	ระบบกันเสียง	/	/		
7.2	หม้อน้ำ (Sound attenuated Enclosure)	/	/		
8	การทดสอบเครื่องกำเนิดไฟฟ้า	ค่าแรงดันไฟฟ้า (Volt)			
	ค่าแรงดันไฟฟ้าที่ทำการวัด	L1-N	L2-N	L3-N	L1-L2
8.1	สภาวะไม่โหลด (No Load)	230	230	230	400
8.2	สภาวะมีโหลด (Load)				

tsada, A.Muangphuket, Phuket 83000 Thailand
3 025 E-mail : info@gmthkt.com

CONCLUSION REPORT

Customer Phone : 091 2312054


Project :

☐ Pre-Delivery

Commissioning

S/N : ☒ Preventive maintenance / 810 KVA

[illegible]

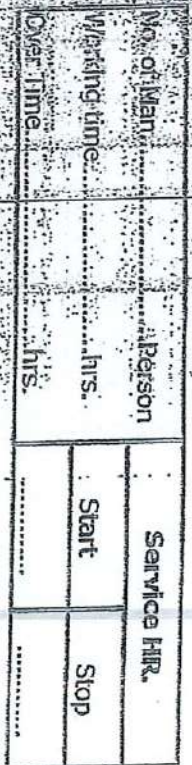


Global Marine
Service & Inspection
Inc. Co., Ltd.
Wilmington, Delaware

[illegible]

ค่าของน้ำหนักสินค้าแต่ละชิ้น

1.100 - 1.200 =	ค่า
1.200 - 1.250 =	๑๓๕
1.250 - 1.300 =	๕



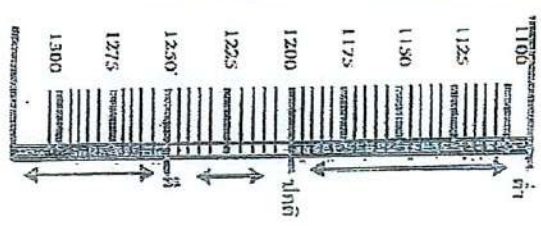

Perkins 800kva 28-05-2024



**Global Marine**58/115 Phoemsin Thani Village, Moo 6
Tel. 076 373 024 Fax. 076**SERVICE AND INSPECTION**

Customer : Phuket Boat Lagoon

Customer Address : 22/1 Moo 2 Thepkasitthi Rd, T.kohkarn A. Muay Phuket 83110

Generator model : TCI600T

S/N TCI060T000000

DATE : 22-11-22

Alternator model :

S/N 2171031701

Engine Hour : 203 h

Engine model : KTA38-G2A

S/N M244431

Controller Model :

Item	Description	Check	Clean		
1	ระบบหล่อเย็น (Cooling System)				
1.1	ตรวจสอบระดับน้ำในหม้อน้ำ (Top up) ตรวจสอบสภาพของฝาหม้อน้ำ	/			
1.2	ตรวจสอบความตึง Belt Tension, Thermostat Housing	/			
1.3	ตรวจสอบสภาพของท่อรั่วซึมของหม้อน้ำ, วาล์ว, หม้อน้ำ Radiator, Water pump	/			
1.4	ตรวจสอบสภาพของน้ำหล่อเย็น (Coolant Filter)	/			
2	ระบบหล่อลื่น (Lubrication System)				
2.1	ตรวจสอบระดับน้ำมันหล่อลื่น Dipstick (H ☐ / M ☐ / L ☐)	/			
2.2	ตรวจสอบสภาพของ Oil Filter และการรั่วซึมของน้ำมันหล่อลื่นตามจุดต่าง	/			
2.3	ตรวจสอบสภาพของท่อลมหายใจ, ถังน้ำมันเชื้อเพลิง, ท่อลมหายใจ Breather pipe, Oil Sampling Point, Filter Cap	/			
2.4	ตรวจสอบการฉาบมัน (Grease for Cooling pump)	/			
2.5	ตรวจสอบการตึงของสายพานพาน้ำมัน (Belt Tension / Grease)	/			
2.6	ตรวจสอบการฉาบมัน (Grease for Alternator)	/			
3	ระบบน้ำมันเชื้อเพลิง (Fuel System)				
3.1	ตรวจสอบระดับน้ำมันเชื้อเพลิงในถัง (F ☐ / M ☐ / E ☐)	/			
3.2	ตรวจสอบสภาพของ Primary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	/			
3.3	ตรวจสอบสภาพของ Secondary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	/			
3.4	ตรวจสอบสภาพของ Fuel Injection Pump, Relief Valve, Fuel Lift Pump	/			
3.5	ตรวจสอบสภาพของ Governor, Throttle Lever, Governor Weights	/			
4	ระบบอากาศ (Air System & Exhaust System)				
4.1	ตรวจสอบสภาพของ Air Filter Component	/			
4.2	ตรวจสอบสภาพของ Turbocharger, Inter manifold, Exhaust Manifold	/			
5	ระบบไฟฟ้า (Electric System)				
5.1	ตรวจสอบสภาพของสายไฟและจุดต่อสายไฟตามจุดต่าง	/			
5.2	DC : ตรวจสอบสภาพของแบตเตอรี่, ขั้วแบตเตอรี่ สายไฟ และ สาย Ground	/			
5.3	DC : ตรวจสอบระดับน้ำกรดในแบตเตอรี่ ระดับ (Top up) (F ☐ / M ☐ / E ☐)	/			
5.4	AC : ตรวจสอบสภาพและการทำงานของ Circuit Breaker	/			
5.5	ตรวจสอบการชาร์จแบตเตอรี่ Battery Charger	/			
6	Control Panel Functional Operation				
6.1	ทดสอบหลอดไฟ LED บนแผงควบคุม (Lamp Test / Reset)	/			
6.2	ตรวจสอบความดันน้ำมันเชื้อเพลิง (PSI) (Bar)	/			
6.3	ตรวจสอบอุณหภูมิของน้ำหล่อเย็น (°C) (°F)	/			
6.4	ตรวจสอบความเร็วรอบ (rpm) (ความถี่ Hz)	/			
6.5	ตรวจสอบ Battery Charging (DC) (Volt) (กระแส Amp)	/			
6.6	การทำงานของสัญญาณเตือนและระบบป้องกันส่วนต่างๆ (Alarm Status)	/			
6.7	การทำงานของปุ่ม Emergency Push button switch	/			
6.8	การทำงานของสวิตช์ AC Volt & Amp Selector	/			
6.9	การทำงานของสวิตช์ Start/Run/Manual Run/Stop	/			
7	ระบบกันเสียง (Soundproof System)				
7.1	ระดับความดัง				
7.2	ผนังห้อง (Sound attenuated Enclosure)				
8	การทดสอบเครื่องกำเนิดไฟฟ้า	ค่าแรงดันไฟฟ้า (Volt)			
	ค่าแรงดันไฟฟ้าที่การวัด	L1-N	L2-N	L3-N	L1-L2
8.1	สถานะไม่มีโหลด (No Load)	234	234	234	400
8.2	สถานะมีโหลด (Load)				

Remark :

usada, A.Muangphuket, Phuket 83000 Thailand
3 025 E-mail : info@gmthkt.com

CTION REPORT

Project :

Quotation NO: GHT 2403-035 PA

☐ Pre-Delivery

☐ Commissioning

S/N : ☐ Preventive maintenance / 940 KVA

[illegible]



Global Marine Tech Co., Ltd.
Service & Inspection Acknowledgment Form

No. of Man	Person	Service HR.	
		Start	Stop
Working time	hrs.		
Over time	hrs.		

ตารางการตรวจเช็คแบตเตอรี่ประจำเดือน

แบตเตอรี่แต่ละเครื่อง	กำลังไฟ	+	+	+	+	+	สถานะ	หมายเหตุ
แบตเตอรี่ NO. 1	13.6 V	12.86	13.06	12.86	12.26	12.26	27.00	
แบตเตอรี่ NO. 2	13.6 V	12.86	12.86	12.86	12.26	12.26	27.00	
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								
แบตเตอรี่ NO.								

ค่าของน้ำหนักแบตเตอรี่


1100 - 1200 = 300
1200 - 1250 = 100
1250 - 1300 = 50




ผู้ตรวจเช็ค

13.6 V 27.00

แบตเตอรี่ 94-b-6
ขนาดแบตเตอรี่ 300 Ah
จำนวน 2100

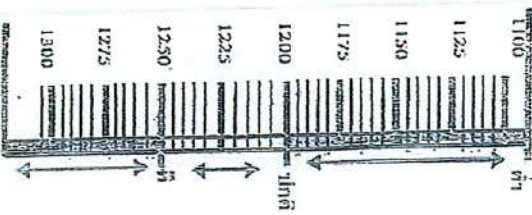

Cummins 1000kva 28-05-2024

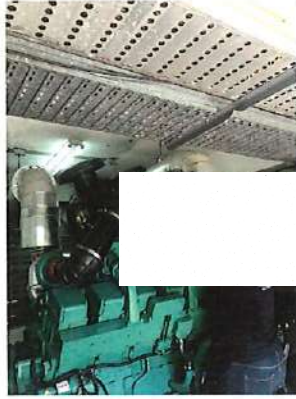

**Global Marine**58/115 Phoemsin Thani Village, Moo 6
Tel. 076 373 024 Fax. 07**SERVICE AND INSPECTION**

Customer : Phuket Boat Lagoon
 Customer Address : 22/1 Moo 2, Thepkasornwong Rd. T. Kohkaww, A. Muang Phuket 83000
 Generator model : 425-5005 S/N 4250051001231 DATE : 28-05-24
 Alternator model : STAMFORD S/N X13KA64650 Engine Hour : 5856 Hrs
 Engine model : KTA19-64 S/N 411A6000 Controller Model : D20050X

Item	Description	Check	Clean
1	ระบบหล่อเย็น (Cooling System)		
1.1	ตรวจสอบระดับน้ำหล่อเย็น (Top up) ตรวจสอบสายพานพาน้ำ	/	
1.2	ตรวจสอบความตึงเครียด Belt Tension, Thermostat housing	/	
1.3	ตรวจสอบสภาพของถังน้ำหล่อเย็น, พัดลม, ปั๊ม Radiator, Water pump	/	
1.4	ตรวจสอบการกรองน้ำหล่อเย็น (Coolant Filter)	/	
2	ระบบหล่อลื่น (Lubrication System)		
2.1	ตรวจสอบระดับน้ำมันหล่อลื่น Dipstick (H / M / L)	/	
2.2	ตรวจสอบการกรอง Oil Filter และหาว่ามีน้ำมันหล่อลื่นในถังหรือไม่	/	
2.3	ตรวจสอบสายพานพาน้ำมัน, สายน้ำหล่อเย็น, ท่อลมหายใจ Breather pipe, Oil Sampling Point, Filter Cap	/	
2.4	ตรวจสอบจารบีปั๊ม (Grease for Cooling pump)	/	
2.5	ตรวจสอบความตึงเครียดสายพานพาน้ำมัน (Belt Tension / Grease)	/	
2.6	ตรวจสอบจารบีมอเตอร์ (Grease for Alternator)	/	
3	ระบบน้ำมันเชื้อเพลิง (Fuel System)		
3.1	ตรวจสอบระดับน้ำมันเชื้อเพลิงในถัง (F / M / E)	/	
3.2	ตรวจสอบการกรอง Primary Fuel Filter และหาว่ามีน้ำมันเชื้อเพลิงในถังหรือไม่	/	
3.3	ตรวจสอบการกรอง Secondary Fuel Filter และหาว่ามีน้ำมันเชื้อเพลิงในถังหรือไม่	/	
3.4	ตรวจสอบการกรอง Fuel Injection Pump, Relief Valve, Fuel Lift Pump	/	
3.5	ตรวจสอบการกรอง Governor, Throttle Lever, Governor Weights	/	
4	ระบบอากาศ (Air System & Exhaust System)		
4.1	ตรวจสอบการกรอง Air Filter Component	/	
4.2	ตรวจสอบการกรอง Turbocharger, Inter manifold, Exhaust Manifold	/	
5	ระบบไฟฟ้า (Electric System)		
5.1	ตรวจสอบการกรองสายไฟและจุดต่อสายไฟตามจุดต่างๆ	/	
5.2	DC : ตรวจสอบการกรองสายไฟ, สายไฟ และ สาย Ground	/	
5.3	DC : ตรวจสอบการกรองสายไฟในแบตเตอรี่ (Top up) (F / M / E)	/	
5.4	AC : ตรวจสอบการกรองสายไฟในตู้ Circuit Breaker	/	
5.5	ตรวจสอบการกรองสายไฟของ Battery Charger	/	
6	Control Panel Functional Operation		
6.1	ทดสอบหลอดไฟ LED และสัญญาณเตือน (Lamp Test / Reset)	/	
6.2	ทดสอบระดับน้ำเชื้อเพลิง (PSI) (4.5 BAR)	/	
6.3	ทดสอบอุณหภูมิเครื่องยนต์ (°C) (60 °C) (°F)	/	
6.4	ทดสอบความเร็วรอบเครื่องยนต์ (rpm) (การหมุน 520 Hz)	/	
6.5	ทดสอบ Battery Charging (DC) (V) (12.0 Amp)	/	
6.6	การแจ้งเตือนระดับน้ำเชื้อเพลิง/การเตือนภัยในตู้ควบคุม (Alarm Status)	/	
6.7	การแจ้งเตือนฉุกเฉิน Emergency Push button switch	/	
6.8	การเลือกแรงดันไฟฟ้า AC Volt & Amp Selector	/	
6.9	การเลือกโหมดการทำงาน Start Man / Manual Run และ Auto และ Stop	/	
7	ระบบกันเสียง (Soundproof System)		
7.1	ระดับความดัง		
7.2	ตู้กันเสียง (Sound attenuated Enclosure)		

การทดสอบเครื่องกำเนิดไฟฟ้า		ค่าแรงดันไฟฟ้า(Volt)			
ค่าแรงดันไฟฟ้าที่การวัด		L1-N	L2-N	L3-N	L1-L2
8.1	สถานะไม่โหลด (No Load)	230	230	230	400
8.2	สถานะโหลด (Load)				

Remark : * * * * *

atsada, A.Muangphuket, Phuket 83000 Thailand
73 025 E-mail : info@gmthkt.com

CTION REPORT

Project :

☐ Pre-Delivery☐ Commissioning

S/N : 7390 ☒ Preventive maintenance / 300 KVA

[illegible]



Global Marine Tech Co., Ltd.
Service & Inspection Acknowledgment Form

No. of Man	Person	Service HR.	
Working time	hrs.	Start	Stop
Over time	hrs.		


ตารางการตรวจเช็คแบตเตอรี่ประจำเดือน

แบตเตอรี่แต่ละเครื่อง	กำลังไฟ	ค่า 1	ค่า 2	ค่า 3	ค่า 4	ค่า 5	ค่า 6	สถานะ	หมายเหตุ
แบตเตอรี่ NO. 1	13.3	19.50	19.50	19.50	19.50	19.50	19.50		
แบตเตอรี่ NO. 2	13.3	19.50	19.50	19.50	19.50	19.50	19.50		
แบตเตอรี่ NO. 3									
แบตเตอรี่ NO. 4									
แบตเตอรี่ NO. 5									
แบตเตอรี่ NO. 6									
แบตเตอรี่ NO. 7									
แบตเตอรี่ NO. 8									
แบตเตอรี่ NO. 9									
แบตเตอรี่ NO. 10									
แบตเตอรี่ NO. 11									
แบตเตอรี่ NO. 12									
แบตเตอรี่ NO. 13									
แบตเตอรี่ NO. 14									
แบตเตอรี่ NO. 15									

ค่าของน้ำหนักแบตเตอรี่
1100 - 1200 = ต่ำ
1200 - 1250 = ปกติ
1250 - 1300 = ดี



ผู้ตรวจเช็ค

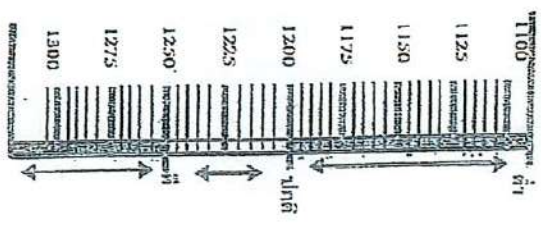

Cummins 500 kva 28-05-2024





Global Marine Tech Co.,Ltd.

58/115 Phoemsin Thani Village, Moo 6 T.Ratsada, A.Muangphuket, Phuket 83000 Thailand
Tel. 076 373 024 Fax. 076 373 025 E-mail : info@gmthkt.com

2091

SERVICE AND INSPECTION REPORT

Customer : <u>Phuket Boat Lagoon</u>		Customer Phone : <u>076-879888</u>	
Customer Address : <u>22/1 Moo 2, Thepkasattvi Rd, T. Kohkaw, A. Muang Phuket 83110</u>		Project : <u>Quotation No: GMT2403-036 PU</u>	
Generator model : <u>ACS 500 S</u>	S/N <u>ACS500S10012301</u>	DATE : <u>24-05-24</u>	☐ Pre-Delivery
Alternator model : <u>STAMFORD</u>	S/N <u>X13K464650</u>	Engine Hour : <u>588 h 51 n</u>	☐ Commissioning
Engine model : <u>KTA19-64</u>	S/N <u>41196000</u>	Controller Model : <u>Deep Sea</u> S/N : <u>7320</u>	☒ Preventive maintenance / <u>500</u> KVA

m	Description	Check	Clean	Defect		Replace	Remark				
				Adjust	Repair						
ระบบหล่อเย็น (Cooling System)											
	ตรวจเช็คระดับน้ำในหม้อน้ำ (Top up). ตรวจเช็คสภาพของฝาหม้อน้ำ	/				/					
	ตรวจเช็คสภาพของ Belt Tension, Thermostat Housing	/									
	ตรวจเช็คสภาพของการรั่วซึมของหม้อน้ำ, ท่อยาง, ปั๊มน้ำ Radiator, Water pump	/									
	ตรวจเช็คสภาพกรองน้ำหล่อเย็น (Coolant Filter)	/									
ระบบหล่อลื่น (Lubrication System)											
	ตรวจเช็คระดับน้ำมันหล่อลื่นจาก Dipstick (H ☒ / M : ☐ / L : ☐)	/				/					
	ตรวจเช็คสภาพของ Oil Filter และการรั่วซึมของน้ำมันหล่อลื่นตามจุดต่างๆ	/									
	ตรวจเช็คสภาพของท่อระบายลม, อ่างน้ำมันเครื่อง, กรองต่างๆ Breather pipe, Oil Sampling Point, Filter Cap.	/									
	ตรวจเช็คจาระบีปั๊มน้ำ (Grease for Cooling pump)	/									
	ตรวจเช็คจาระบีชุดลูกกรอกดันสายพานพัดลม (Belt Tension / Grease)	/									
	ตรวจเช็คจาระบีไดนาโม (Grease for Alternator)	/									
ระบบน้ำมันเชื้อเพลิง (Fuel System)											
	ตรวจเช็คระดับน้ำมันเชื้อเพลิงในถัง (F : ☐ / M : ☒ / E : ☐)	/				/	ขนาดถังน้ำมัน <u> </u> ลิตร				
	ตรวจเช็คสภาพของ Primary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	/				/					
	ตรวจเช็คสภาพของ Secondary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	/									
	ตรวจเช็คสภาพของ Fuel Injection Pump, Relief Valve, Fuel Lift Pump	/									
	ตรวจเช็คสภาพของ Governor, Throttle Lever, Governor Weights	/									
ระบบอากาศ (Air System & Exhaust System)											
	ตรวจเช็คสภาพของ Air Filter Component	/				/					
	ตรวจเช็คสภาพของ Turbocharger, Inter manifold, Exhaust Manifold	/									
ระบบไฟฟ้า (Electric System)											
	ตรวจสอบสภาพของสายไฟและจุดต่อสายไฟตามจุดต่างๆ	/									
	DC : ตรวจเช็คสภาพของแบตเตอรี่, ขั้วแบตเตอรี่ สายไฟ และ สาย Ground	/									
	DC : ตรวจเช็คระดับน้ำกรดในแบตเตอรี่ ระดับ (Top up) (F : ☐ / M : ☒ / E : ☐)	/					(อายุแบตเตอรี่ <u>24-06-66</u>)				
	AC : ตรวจเช็คสภาพและการทำงานของ Circuit Breaker	/									
	ตรวจเช็คการทำงานของ Battery Charger	/									
Control Panel Functional Operation											
	ทดสอบหลอดไฟ LED แสดงสัญญาณเตือน (Lamp Test / Reset)	/									
	เกจวัดความดันน้ำมันเครื่อง (.....PSI.) (<u>4.34</u> BAR)	/									
	เกจวัดอุณหภูมิหม้อน้ำหล่อเย็น (<u>60</u> °C) (.....°F)	/									
	เกจวัดความเร็วรอบ (<u>1500</u> rpm.) (ค่าความถี่ <u>50.0</u> Hz.)	/									
	เกจวัด Battery Charging (DC <u>27.4</u> Volt.) (กระแส <u>12.0</u> Amp.)	/									
	การทำงานของสัญญาณเตือนสภาวะบกพร่องในส่วนต่างๆ (Alarm Status)	/									
	การทำงานของปุ่ม Emergency Push button switch	/									
	การทำงานของสวิตช์ AC Volt & Amp Selector	/									
	การทำงานของสวิตช์ Start แบบ Manual Run แบบ Auto และ Stop	/									
ระบบเก็บเสียง (Soundproof System)											
	ระดับความดัง										
	ผนังของ (Sound attenuated Enclosure)										
การทดสอบเครื่องกำเนิดไฟฟ้า											
ตำแหน่งที่ทำการวัด		ค่าแรงดันไฟฟ้า(Volt)					ค่าแรงดันไฟฟ้า(Amp)				
		L1-N	L2-N	L3-N	L1-L2	L2-L3	L3-L1	L1	L2	L3	
3.1	สภาวะไม่มีโหลด (No Load)	230	230	230	400	400	400				* ยืนยันโอเคก่อนใช้งาน
3.2	สภาวะมีโหลด (Load)										

Remark : * หน้าจอของเครื่องแสดงผลภาพ ผิดค่า / ไม่ชัด	* ตรวจสอบกับช่างไฟฟ้า / ช่างเครื่อง	* ตรวจสอบกับช่างไฟฟ้า / ช่างเครื่อง	* ตรวจสอบกับช่างไฟฟ้า / ช่างเครื่อง
} รายการแก้ไข : 1) เปลี่ยนชุดตัวจ่ายไฟฟ้า 1 ชุด 2) เปลี่ยนชุดตัวจ่ายไฟฟ้า 1 ชุด			
(Customer)		(Service Engineer)	
Date (24-05-24)			



Global Marine Tech Co.,Ltd.

58/115 Phoemsin Thani Vilage, Moo 6 T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel. 076 373 024 Fax. 076 373 025 E-mail : info@gmthkt.com

2090

SERVICE AND INSPECTION REPORT

Customer : <u>Phuket Boat Lagoon</u>						Customer Phone : <u>076-239888</u>			
Customer Address : <u>22/1 Moo 2, Thepkasatri Rd, T.kohkaew A. Muang Phuket 83110</u>						Project : <u>Avotation NO: GMT 2403-035 PU</u>			
Generator model : <u>TC1000T</u>		S/N <u>TC1000T1010010</u>		DATE : <u>28-5-24</u>		☐ Pre-Delivery			
Alternator model :		S/N <u>x174031701</u>		Engine Hour : <u>203 h 22m</u>		☐ Commissioning			
Engine model : <u>KTA 38 - G2A</u>		S/N <u>41246631</u>		Controller Model :		S/N :		☐ Preventive maintenance / <u>940</u> KVA	

Item	Description	Check	Clean	Defect		Replace	Remark			
				Adjust	Repair					
1	ระบบหล่อเย็น (Cooling System)									
1.1	ตรวจเช็คระดับน้ำในหม้อน้ำ (Top up). ตรวจเช็คสภาพของฝาหม้อน้ำ	✓								
1.2	ตรวจเช็คสภาพของ Belt Tension, Thermostat Housing	✓								
1.3	ตรวจเช็คสภาพของการรั่วซึมของหม้อน้ำ, ท่อยาง, ปั๊มน้ำ Radiator, Water pump	✓								
1.4	ตรวจเช็คสภาพกรองน้ำยาหล่อเย็น (Coolant Filter)					✓				
2	ระบบหล่อลื่น (Lubrication System)									
2.1	ตรวจเช็คระดับน้ำมันหล่อลื่นจาก Dipstick (H : ☒ / M : ☐ / L : ☐)					✓				
2.2	ตรวจเช็คสภาพของ Oil Filter และการรั่วซึมของน้ำมันหล่อลื่นตามจุดต่างๆ	✓								
2.3	ตรวจเช็คสภาพของท่อระบายลม, อ่างน้ำมันเครื่อง, กรองต่างๆ Breather pipe, Oil Sampling Point, Filter Cap.	✓								
2.4	ตรวจเช็คจาระบีปั๊มน้ำ (Grease for Cooling pump)	✓								
2.5	ตรวจเช็คจาระบีชุดลูกกรอกดันสายพานพัดลม (Belt Tension / Grease)	✓								
2.6	ตรวจเช็คจาระบีไดนาโม (Grease for Alternator)	✓								
3	ระบบน้ำมันเชื้อเพลิง (Fuel System)									
3.1	ตรวจเช็คระดับน้ำมันเชื้อเพลิงในถัง (F : ☐ / M : ☒ / E : ☐)	✓					ขนาดถังน้ำมัน _____ ลิตร			
3.2	ตรวจเช็คสภาพของ Primary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	✓								
3.3	ตรวจเช็คสภาพของ Secondary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	✓								
3.4	ตรวจเช็คสภาพของ Fuel Injection Pump, Relief Valve, Fuel Lift Pump	✓								
3.5	ตรวจเช็คสภาพของ Governor, Throttle Lever, Governor Weights	✓								
4	ระบบอากาศ (Air System & Exhaust System)									
4.1	ตรวจเช็คสภาพของ Air Filter Component	✓								
4.2	ตรวจเช็คสภาพของ Turbocharger, Inter manifold, Exhaust Manifold	✓								
5	ระบบไฟฟ้า (Electric System)									
5.1	ตรวจสอบสภาพของสายไฟและจุดต่อสายไฟตามจุดต่างๆ	✓								
5.2	DC : ตรวจเช็คสภาพของแบตเตอรี่, ขั้วแบตเตอรี่ สายไฟ และ สาย Ground	✓								
5.3	DC : ตรวจเช็คระดับน้ำกรดในแบตเตอรี่ ระดับ (Top up) (F : ☒ / M : ☐ / E : ☐)	✓								
5.4	AC : ตรวจเช็คสภาพและการทำงานของ Circuit Breaker	✓					(อายุแบตเตอรี่ <u>2A-b-66</u>)			
5.5	ตรวจเช็คการทำงานของ Battery Charger	✓								
6	Control Panel Functional Operation									
6.1	ทดสอบหลอดไฟ LED แสดงสัญญาณเตือน (Lamp Test / Reset)	✓								
6.2	เกจวัดความดันน้ำมันเครื่อง (.....PSI.) (<u>91</u> <u>6.34</u> BAR.)	✓								
6.3	เกจวัดอุณหภูมิหม้อน้ำหล่อเย็น (.....°C) (<u>80</u> <u>68</u> °F)	✓								
6.4	เกจวัดความเร็วรอบ (<u>1009</u> rpm.) (ค่าความถี่ <u>50.4</u> Hz.)	✓								
6.5	เกจวัด Battery Charging (DC <u>27.4</u> Volt.) (กระแส <u>2.88</u> Amp.)	✓								
6.6	การทำงานของสัญญาณเตือนสถานะบกพร่องในส่วนต่างๆ (Alarm Status)	✓								
6.7	การทำงานของปุ่ม Emergency Push button switch	✓								
6.8	การทำงานของสวิตช์ AC Volt & Amp Selector	✓								
6.9	การทำงานของสวิตช์ Start แบบ Manual Run แบบ Auto และ Stop	✓								
7	ระบบเก็บเสียง (Soundproof System)									
7.1	ระดับความดัง									
7.2	ผนังของ (Sound attenuated Enclosure)									
8	การทดสอบเครื่องกำเนิดไฟฟ้า	ค่าแรงดันไฟฟ้า(Volt)				ค่าแรงดันไฟฟ้า(Amp)				
	ตำแหน่งที่ทำการวัด	L1-N	L2-N	L3-N	L1-L2	L2-L3	L3-L1	L1	L2	L3
8.1	สถานะไม่มีโหลด (No Load)	<u>232</u>	<u>234</u>	<u>234</u>	<u>406</u>	<u>406</u>	<u>406</u>			
8.2	สถานะมีโหลด (Load)									

Remark:



Global Marine Tech Co.,Ltd.

58/115 Phoemsin Thani Vilage, Moo 6 T.Ratsada, A.Muangphuket, Phuket 83000 Thailand

Tel. 076 373 024 Fax. 076 373 025 E-mail : info@gmthkt.com

2092

SERVICE AND INSPECTION REPORT

Customer : Phuket Boat Lagoon Customer Phone : 076-239888

Customer Address : 22/1 Moo 2, Thepkasatti Rd, Thonburi A. Muay Phuket 83116 Project : Quotation NO: GMT

Generator model : 01300906 S/N 0139174/01 DATE : 28-05-24 ☐ Pre-Delivery

Alternator model : STAMFORD S/N 0139174/01 Engine Hour : 1080 h ☐ Commissioning

Engine model : 3012-TAG2A S/N 56C120284U12B3 Controller Model : S/N : ☒ Preventive maintenance / 810 KVA

em	Description	Check	Clean	Defect		Replace	Remark
				Adjust	Repair		
1	ระบบหล่อเย็น (Cooling System)						
1.1	ตรวจเช็คระดับน้ำในหม้อน้ำ (Top up). ตรวจเช็คสภาพของฝาหม้อน้ำ	/				/	
1.2	ตรวจเช็คสภาพของ Belt Tension, Thermostat Housing	/					
1.3	ตรวจเช็คสภาพของการรั่วซึมของหม้อน้ำ, ท่อยาง, ปั๊มน้ำ Radiator, Water pump	/					
1.4	ตรวจเช็คสภาพกรองน้ำยาหล่อเย็น (Coolant Filter)	/					
2	ระบบหล่อลื่น (Lubrication System)						
2.1	ตรวจเช็คระดับน้ำมันหล่อลื่นจาก Dipstick (H: ☒ / M: ☐ / L: ☐)	/				/	
2.2	ตรวจเช็คสภาพของ Oil Filter และการรั่วซึมของน้ำมันหล่อลื่นตามจุดต่างๆ	/				/	
2.3	ตรวจเช็คสภาพของท่อระบายลม, อ่างน้ำมันเครื่อง, กรองต่างๆ Breather pipe, Oil Sampling Point, Filter Cap.	/					
2.4	ตรวจเช็คจาระบีปั๊มน้ำ (Grease for Cooling pump)						
2.5	ตรวจเช็คจาระบีชุดลูกกรอกคันสายพานพัดลม (Belt Tension / Grease)						
2.6	ตรวจเช็คจาระบีไดนาโม (Grease for Alternator)						
3	ระบบน้ำมันเชื้อเพลิง (Fuel System)						
3.1	ตรวจเช็คระดับน้ำมันเชื้อเพลิงในถัง (F: ☐ / M: ☒ / E: ☐) <u>สี 1150 รกrs</u>	/					ขนาดถังน้ำมัน <u>1300</u> ลิตร
3.2	ตรวจเช็คสภาพของ Primary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	/				/	
3.3	ตรวจเช็คสภาพของ Secondary Fuel Filter และการรั่วซึมของน้ำมันเชื้อเพลิง	/				/	
3.4	ตรวจเช็คสภาพของ Fuel Injection Pump, Relief Valve, Fuel Lift Pump	/					
3.5	ตรวจเช็คสภาพของ Govenor, Throttle Lever, Govenor Weights	/					
4	ระบบอากาศ (Air System & Exhaust System)						
4.1	ตรวจเช็คสภาพของ Air Filter Component	/				/	
4.2	ตรวจเช็คสภาพของ Turbocharger, Inter manifold, Exhaust Manifold	/					
5	ระบบไฟฟ้า (Electric System)						
5.1	ตรวจสอบสภาพของสายไฟและจุดต่อสายไฟตามจุดต่างๆ	/					
5.2	DC : ตรวจเช็คสภาพของแบตเตอรี่, ขั้วแบตเตอรี่ สายไฟ และ สาย Ground	/					
5.3	DC : ตรวจเช็คระดับน้ำกรดในแบตเตอรี่ ระดับ (Top up) (F: ☐ / M: ☒ / E: ☐)	/					
5.4	AC : ตรวจเช็คสภาพและการทำงานของ Circuit Breaker	/					(อายุแบตเตอรี่ <u>24-06-23</u>)
5.5	ตรวจเช็คการทำงานของ Battery Charger	/					
6	Control Panel Functional Operation						
6.1	ทดสอบหลอดไฟ LED แสดงสัญญาณเตือน (Lamp Test / Reset)	/					
6.2	เกจวัดความดันน้ำมันเครื่อง (.....PSI.) (<u>4.3</u> BAR.)	/					
6.3	เกจวัดอุณหภูมิน้ำหล่อเย็น (<u>60</u> °C) (.....°F)	/					
6.4	เกจวัดความเร็วรอบ (<u>1512</u> rpm.) (ค่าความถี่ <u>50.9</u> Hz.)	/					
6.5	เกจวัด Battery Charging (DC <u>26.3</u> Volt.) (กระแส <u>2.13</u> Amp.)	/					
6.6	การทำงานของสัญญาณเตือนสภาวะบกพร่องในส่วนต่างๆ (Alarm Status)	/					
6.7	การทำงานของปุ่ม Emergency Push button switch	/					
6.8	การทำงานของสวิตช์ AC Volt & Amp Selector	/					
6.9	การทำงานของสวิตช์ Start แบบ Manual Run แบบ Auto และ Stop	/					
7	ระบบเก็บเสียง (Soundproof System)						
7.1	ระดับความดัง						
7.2	ผนังของ (Sound attenuated Enclosure)						

Remark.....

Name: (Customer) Date: 28/5/24 (Service Engineer)

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by gnta Date 27/6/67

Supervisor by Wainwright Date 27/6/67

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by 4/10/67 Date 27/6/67

Supervisor by Leinard Date 27/1/67

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by gymn Date 27/6/67

Supervisor by Carson Date 27/6/67

May-24

[illegible]

Supervisor by 10/10/67 Date 27/6/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by Date 27/6/67

Supervisor by W. J. S. Date 27/6/67

Check List emergency light

[illegible]

(1) = Fire Exit

(2) = Emergency Light

Supervisor by Leirwaik Date 27/6/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

[illegible]

Note:Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible by upm Date. 27/6/67

Supervisor by Winters Date 27/6/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Bai rure 1 (Fire Exit)	✓	✓	✓	✓	✓	27/6/67	synon	✓		✓	
Bai rure 1 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Bai rure 2 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Bai rure 2 (Emergency)	✓	✓	✓	✓	✓			✓		✓	

Note: Mark [✓] Normal

Mark (X) Abnormal

(1) = Fire Exit

(2) = Emergency Light

Responsible bysynon.....Date 27/6/67

Supervisor bysynon.....Date 27/6/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 241 (Fire Exit)	✓	✓	✓	✓	✓	27/6/67	gnor	✓		✓	
Room 241 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 246 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 246 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 252 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 252 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 263 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 263 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 269 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 269 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 274 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 274 (Emergency)	✓	✓	✓	✓	✓			✓		✓	

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by gnor Date 27/6/67

Supervisor by gnor Date 27/6/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 341 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 341 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 346 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 346 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 355 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 355 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 360 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 360 (Emergency)	✓	✓	✓	✓	✓	27/6/67	gman	✓		✓	
Room 371 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 371 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 377 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 377 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 382 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 382 (Emergency)	✓	✓	✓	✓	✓			✓		✓	

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible by gman Date 27/6/67

Supervisor by leis Bais Date 27/6/67

NH BOAT LAGOON PHUKET RESORT

Check List emergency light

May-24

installation point	Power	Light	Battery	Switch	Cleanliness	Date	Inspector	Normal	Abnormal	Done	Note
Room 441 (Fire Exit)	✓	✓	✓	✓	✓	27/6/67	gnoan	✓		✓	
Room 441 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 446 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 446 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 456 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 456 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 462 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 462 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 473 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 473 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 479 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 479 (Emergency)	✓	✓	✓	✓	✓			✓		✓	
Room 484 (Fire Exit)	✓	✓	✓	✓	✓			✓		✓	
Room 484 (Emergency)	✓	✓	✓	✓	✓			✓		✓	

Note: Mark [✓] Normal

Mark (X) Abnormal

Responsible bygnoan.....Date 27/6/67

Supervisor bywin 325.....Date 27/6/67

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building A

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building A													
Side Steps													
Corridor Room 121	Chemical Powder-ABC	√	√	√	√	√	√	√	30/06/24	Santichai			
Corridor Room 131	Chemical Powder-ABC	√	√	√	√	√	√	√	30/06/24	Santichai			
Central Staircase													
Corridor Room 122	Chemical Powder-ABC	√	√	√	√	√	√	√	30/06/24	Santichai			
Side Steps													
Corridor Room 124	NON-CFC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/06/24	Santichai			Dismantled
Corridor Room 137	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/06/24	Santichai			Dismantled
Facade of Building													
Corridor Room A21	NON-CFC	√	√	√	√	√	√	√	30/06/24	Santichai			
Behind the Building													
Corridor MDB Room	Chemical Powder-ABC	√	√	√	√	√	√	√	30/06/24	Santichai			

Remark;

[√] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 N.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building B

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building B													
Side Steps													
Corridor Room 221	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 231	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Central Staircase													
Corridor Room 222 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 233 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Side Steps													
Corridor Room 224	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Facade of Building													
Corridor Office 20/4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Behind the Building													
Corridor Office 20/1-4	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 A.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building C

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building C													
Side Steps													
Corridor Room 321	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 331 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Central Staircase													
Corridor Room 322 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 334 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Side Steps													
Corridor Room 324	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 237	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Facade of Building													
Corridor Office 20/8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Behind the Building													
Corridor Office 20/5-8	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02.09.2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building D

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building D													
Side Steps													
Corridor Room 421	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/06/24	Santichai			Dismantled
Corridor Room 431	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/06/24	Santichai			Dismantled
Central Staircase													
Corridor Room 422	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 434	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Side Steps													
Corridor Room 424	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 437	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Facade of Building													
Corridor Office 20/12	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Behind the Building													
Corridor Office 20/9-12 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02.06.2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building E

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building E													
Side Steps													
Corridor Room 521	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/06/24	Santichai			Dismantled
Corridor Room 531	Chemical Powder-ABC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	30/06/24	Santichai			Dismantled
Central Staircase													
Corridor Room 522	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 534	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Side Steps													
Corridor Room 524	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Corridor Room 537	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Facade of Building													
Corridor Office 20/16	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating
Behind the Building													
Corridor Office 20/13-16 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			Renovating

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 N.A. 2557

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building F

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building F													
Side Steps													
Corridor Room 621	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Corridor Room 631	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Central Staircase													
Corridor Room 623	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Corridor Room 633	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Side Steps													
Corridor Room 624	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Corridor Room 637	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Facade of Building													
Corridor Office 20/20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Behind the Building													
Corridor Office 20/17-20	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 A.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building G													
Side Steps													
Corridor Room 721	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Corridor Room 731	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Central Staircase													
Corridor Room 722	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Corridor Room 733	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Side Steps													
Corridor Room 724	Chemical Powder-ABC	X	✓	✓	✓	✓	✓	✓	30/06/24	Santichai	27/02/24		Pressure down
Corridor Room 737	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Facade of Building													
Corridor Office 20/24	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			
Behind the Building													
Corridor Office 20/21-24 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	30/06/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 N.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building H													
Side Steps													
Corridor Room 925	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Corridor Room 933	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Side Steps													
Corridor Room 924	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Corridor Room 927	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Facade of Building													
Corridor Office 20/26	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Behind the Building													
Corridor Office 20/25-26 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 A.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Building G

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
Building I													
Side Steps													
Corridor Room 923	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Corridor Room 935	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Side Steps													
Corridor Room 936	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Corridor Room 949	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Facade of Building													
Corridor Office 20/27	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			
Behind the Building													
Corridor Office 20/26-27 x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	1/6/2024	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 N.A. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing Floor 1, Restaurant, Lobby

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 1													
Loading x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor MDB Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Accounting Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Female Locker	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Canteen Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			Fire Blanket x1
Main Kitchen x2	Chemical -ABCDK	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			Fire Blanket x2
Electrical Control Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	X	28/06/24	Santichai			
Captain Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
F&B office x1/Pool barx1	Chemical Powder-AK	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			Fire Blanket x1
Bal-Ruer Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Boat Point Room	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Loss & Prevention Office	NON-CFC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Generator Room x2	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Gas Store	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

Handwritten signature
28/6/24

People & Culture Manager

Handwritten signature

02 JUN 2024

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 2,3

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 2													
Corridor Room 242	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 250	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 256	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 264	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 272	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Front Office	Chemical Powder-ABC	X	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			Pressure down
FLOOR 3													
Corridor Room 342	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 348	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 352	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 358	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 364	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 372	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 380	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

15 30/6/24

People & Culture Manager



02 H.M. 2567

NH BOAT LAGOON PHUKET RESORT

Check List Fire Extinguisher Hotel Wing FLOOR 4/White House Meeting Room

Monthly..06/2024

Installation Point	Chemical Type	Pressure Level	Safety Latch	Fire Hose	Obstruction	Install no more than 1.4 m.	Point Display Sign	Cleanliness	Checked Date	Inspector	Work Order No.	PR No.	Remark
FLOOR 4													
Corridor Room 442	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 448	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 454	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 460	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 466	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 474	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
Corridor Room 482	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
White House Meeting Room01	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
White House Meeting Room02	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
White House Meeting Room03	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
White House Meeting Room04	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
White House Meeting Room05	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			
White House Meeting Room KC x3	Chemical Powder-ABC	✓	✓	✓	✓	✓	✓	✓	28/06/24	Santichai			Fire Blanket x2

Remark;

[✓] Normal

[X] Abnormal

Loss & Prevention Check

People & Culture Manager

02 N.A. 2557

TEST RUN RECORD FOR EMERGENCY GENERATOR

GATE 7/7/67 ENGINEER ไม้จันทน์
 GENERATOR 1000 KVA LOCATION 350m

สภาพเครื่องก่อน TEST RUN

- ☐ ระดับน้ำมันเครื่อง (Motor Oil)
☐ สภาพสายพาน (Machine Belt)
☐ ระดับน้ำในหม้อน้ำ (Boiler)
☐ ระดับน้ำกลั่นในแบตเตอรี่ (Battery)

TEST RUN

☒ ON LOAD ☐ OFF LOAD

TIME START 13.20 TIME STOP 14.00

รายการตรวจเช็ค		บันทึก
Oil (L.)		1400L
Voltage (V)	L1	233
Voltage (V)	L2	234
Voltage (V)	L3	233
Coolant Temp (°C)		71
Oil Pressure (bar)		4.52
Speed (RPM)		1509
Frequency (Hz)		50.4
Battery (V)		27.4
Run Time (h)		209h 3m

REMARK

.....

