

ภาคผนวกที่ 18

BEFORE ฟील พหล 34




Phyll Phahol 34

Thermoscan Report (Before)

PROJECT : Phyll Phahol 34-(31-Jan-2024)

Phyll Phahol 34

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : TR
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

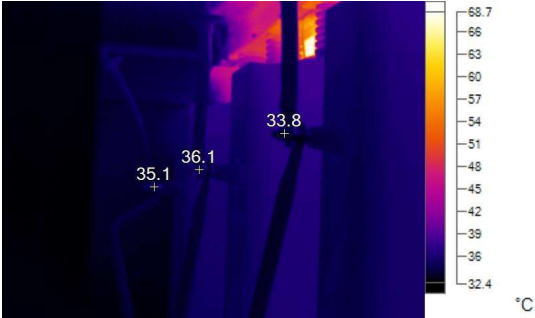

IR000438.IS2
1/31/2024 10:22:05 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	35.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:22:05 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	35.1°C	0.95	20.0°C
P1	36.1°C	0.95	20.0°C
P2	33.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : TR
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000439.IS2
1/31/2024 10:22:15 AM

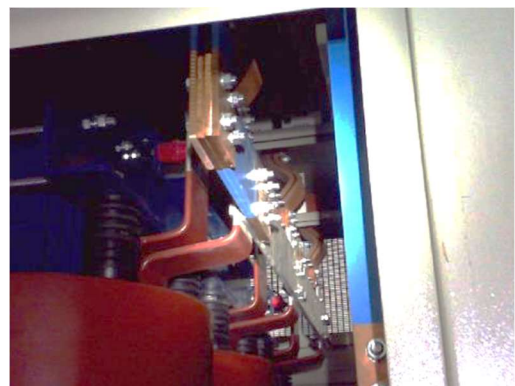

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	38.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:22:15 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	45.9°C	0.95	20.0°C
P1	38.2°C	0.95	20.0°C
P2	46.3°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ติด A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : MAIN CB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

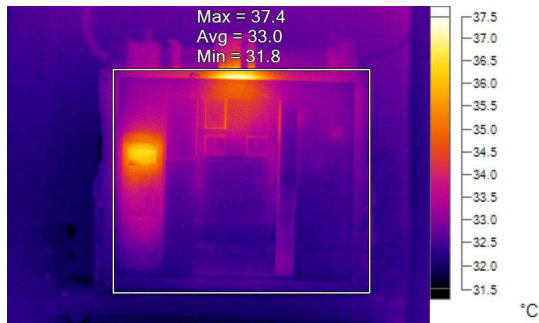

IR000440.IS2
1/31/2024 10:24:44 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.7°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:24:44 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	33.0°C	31.8°C	37.4°C	0.95	20.0°C	0.78

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : MAIN CB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000441.IS2
1/31/2024 10:25:07 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:25:07 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	32.5°C	P3	32.3°C	0.2°C
P1	32.5°C	P4	32.2°C	0.3°C
P2	32.5°C	P5	32.1°C	0.4°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : MAIN BREALER BRANCH
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

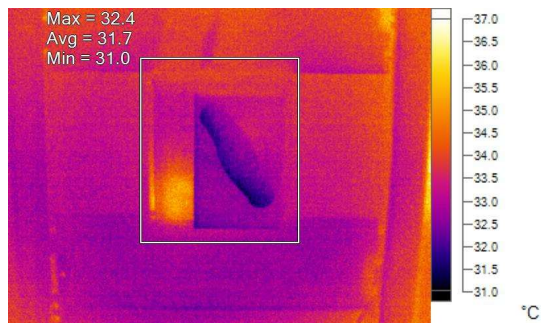

IR000442.IS2
1/31/2024 10:25:26 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.7°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:25:26 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	31.7°C	31.0°C	32.4°C	0.95	20.0°C	0.20

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : DBB,DBE,EVA,SPARE
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

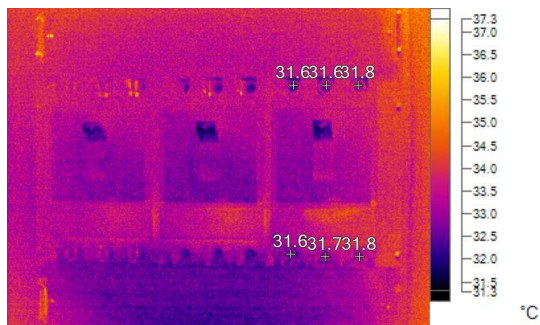

IR000443.IS2

1/31/2024 10:25:40 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:25:40 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	31.6°C	P3	31.6°C	0°C
P1	31.6°C	P4	31.7°C	0.1°C
P2	31.8°C	P5	31.8°C	0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : BUSDUCT 600A
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000444.IS2
1/31/2024 10:25:54 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:25:54 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.2°C	0.95	20.0°C
P1	32.3°C	0.95	20.0°C
P2	31.7°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : LCA,LCB,LCC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000445.IS2
1/31/2024 10:26:04 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:26:04 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	31.5°C	P3	31.6°C	0.1°C
P1	31.5°C	P4	31.7°C	0.2°C
P2	31.5°C	P5	31.6°C	0.1°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : CAPBANK
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000446.IS2
1/31/2024 10:26:11 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:26:11 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.3°C	0.95	20.0°C
P1	31.3°C	0.95	20.0°C
P2	31.3°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ดัก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EMDB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

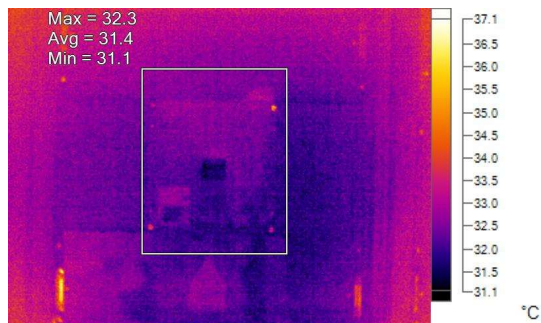

IR000447.IS2
1/31/2024 10:26:44 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:26:44 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	31.4°C	31.1°C	32.3°C	0.95	20.0°C	0.10

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EMDB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000448.IS2
1/31/2024 10:26:51 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:26:51 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.7°C	0.95	20.0°C
P1	31.6°C	0.95	20.0°C
P2	31.3°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : CAP
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000449.IS2
1/31/2024 10:27:10 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:27:10 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	31.5°C	31.2°C	32.3°C	0.95	20.0°C	0.17
A1	31.4°C	31.1°C	32.5°C	0.95	20.0°C	0.17
A2	31.4°C	30.9°C	32.2°C	0.95	20.0°C	0.17
A3	31.4°C	31.0°C	32.2°C	0.95	20.0°C	0.16

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ติด A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : CAP
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

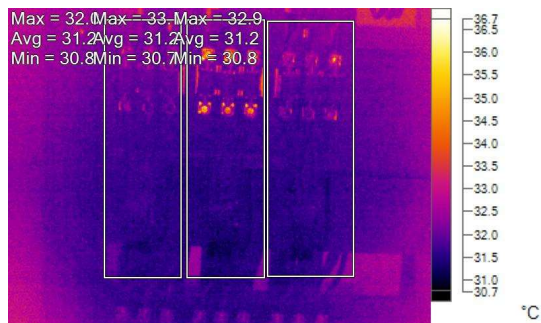

IR000450.IS2

1/31/2024 10:27:21 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:27:21 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	31.2°C	30.8°C	32.0°C	0.95	20.0°C	0.13
A1	31.2°C	30.7°C	33.1°C	0.95	20.0°C	0.23
A2	31.2°C	30.8°C	32.9°C	0.95	20.0°C	0.14

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ติด A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : CAP
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000451.IS2
 1/31/2024 10:27:30 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:27:30 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	31.1°C	30.8°C	31.7°C	0.95	20.0°C	0.11
A1	31.1°C	30.7°C	32.3°C	0.95	20.0°C	0.14
A2	31.1°C	30.7°C	32.2°C	0.95	20.0°C	0.13

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : ATS
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000452.IS2
1/31/2024 10:27:50 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:27:50 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	32.1°C	P3	31.1°C	1°C
P1	32.0°C	P4	31.3°C	0.7°C
P2	32.7°C	P5	31.5°C	1.2°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EDBB,EDBC,EDBD,EDBE
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000453.IS2

1/31/2024 10:28:20 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:28:20 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	31.3°C	30.9°C	31.6°C	0.95	20.0°C	0.10

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : ELCA,LIFT 12A,SPARE,SPARE
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000454.IS2
1/31/2024 10:28:26 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.1°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:28:26 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.3°C	0.95	20.0°C
P1	31.2°C	0.95	20.0°C
P2	31.2°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000455.IS2
1/31/2024 10:35:03 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:35:03 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.7°C	0.95	20.0°C
P1	32.7°C	0.95	20.0°C
P2	32.8°C	0.95	20.0°C
P3	32.7°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000456.IS2
1/31/2024 10:35:11 AM

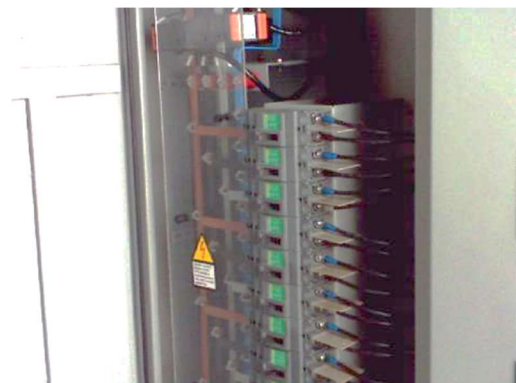

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:35:11 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.6°C	0.95	20.0°C
P1	32.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000457.IS2
1/31/2024 10:35:18 AM

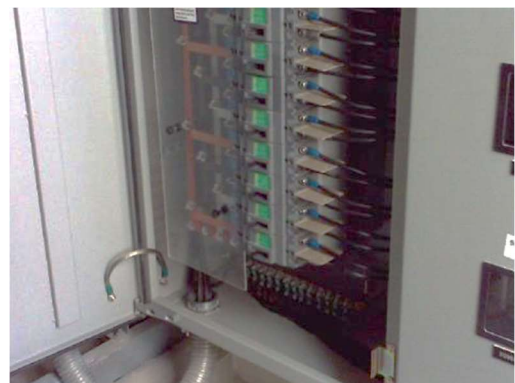

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:35:18 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.4°C	0.95	20.0°C
P1	32.3°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000458.IS2
1/31/2024 10:37:56 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:37:56 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.6°C	0.95	20.0°C
P1	31.7°C	0.95	20.0°C
P2	31.5°C	0.95	20.0°C
P3	31.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000459.IS2
1/31/2024 10:38:03 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:38:03 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.6°C	0.95	20.0°C
P1	31.7°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000460.IS2
1/31/2024 10:38:18 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:38:18 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.4°C	0.95	20.0°C
P1	31.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000461.IS2
1/31/2024 10:39:38 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:39:38 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.5°C	0.95	20.0°C
P1	31.5°C	0.95	20.0°C
P2	31.5°C	0.95	20.0°C
P3	31.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000462.IS2
1/31/2024 10:39:43 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.1°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:39:43 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.3°C	0.95	20.0°C
P1	31.3°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000463.IS2
1/31/2024 10:39:52 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:39:52 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.8°C	0.95	20.0°C
P1	30.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000464.IS2
1/31/2024 10:41:17 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:41:17 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.1°C	0.95	20.0°C
P1	31.2°C	0.95	20.0°C
P2	31.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000465.IS2
1/31/2024 10:41:25 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	30.7°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:41:25 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.1°C	0.95	20.0°C
P1	30.9°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000466.IS2
1/31/2024 10:41:33 AM

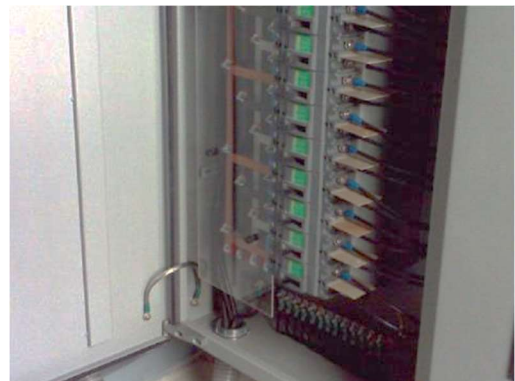

Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	30.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:41:33 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.8°C	0.95	20.0°C
P1	30.6°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000467.IS2
1/31/2024 10:43:06 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:43:06 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.3°C	0.95	20.0°C
P1	31.2°C	0.95	20.0°C
P2	31.3°C	0.95	20.0°C
P3	31.3°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000468.IS2
1/31/2024 10:43:11 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:43:11 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.9°C	0.95	20.0°C
P1	31.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000469.IS2
1/31/2024 10:43:22 AM

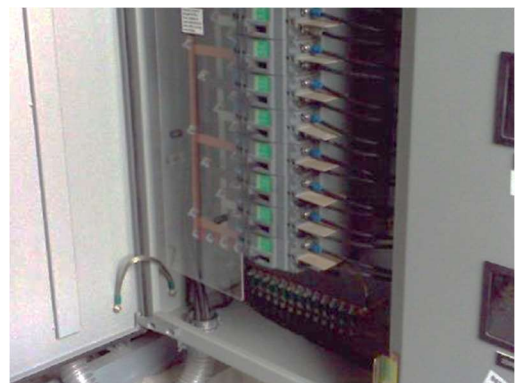

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:43:22 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.7°C	0.95	20.0°C
P1	31.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000470.IS2
1/31/2024 10:44:57 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:44:57 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.4°C	0.95	20.0°C
P1	30.6°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000471.IS2
1/31/2024 10:45:03 AM

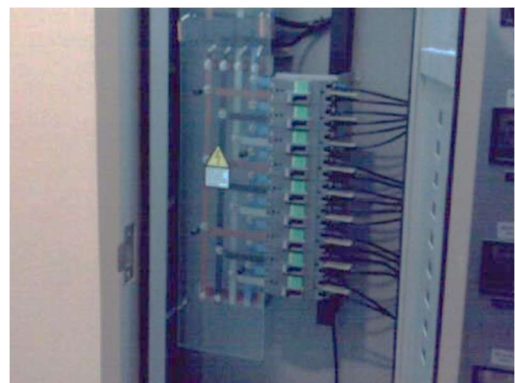

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:45:03 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.7°C	0.95	20.0°C
P1	30.7°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

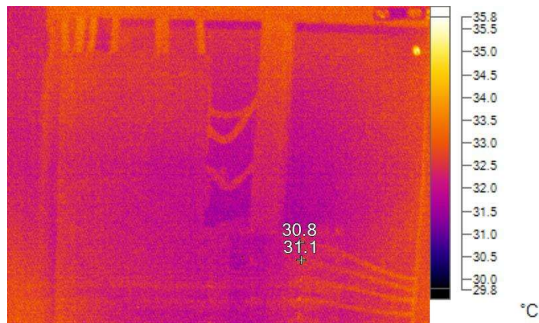

IR000472.IS2
1/31/2024 10:46:32 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:46:32 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.8°C	0.95	20.0°C
P1	31.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก A
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBA
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000473.IS2
1/31/2024 10:46:37 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:46:37 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.9°C	0.95	20.0°C
P1	30.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : ชั้น1 MDB MAIN
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

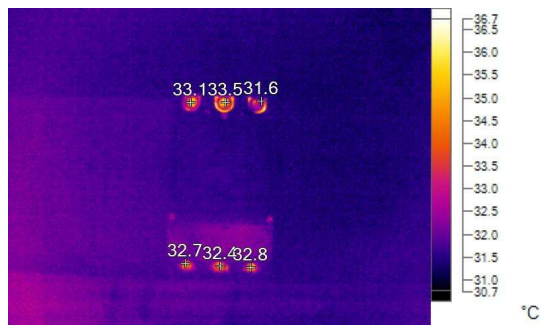

IR000474.IS2
1/31/2024 10:49:33 AM

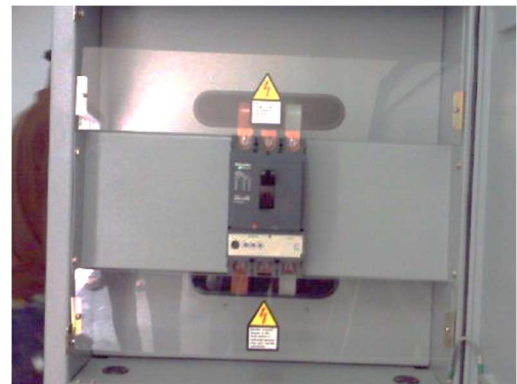

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:49:33 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	33.1°C	P3	32.7°C	0.4°C
P1	33.5°C	P4	32.4°C	1.1°C
P2	31.6°C	P5	32.8°C	1.2°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EDBB MAIN
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

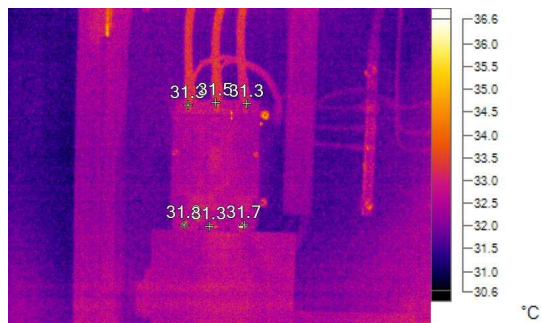

IR000475.IS2
1/31/2024 10:49:51 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:49:51 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	31.3°C	P3	31.8°C	0.5°C
P1	31.5°C	P4	31.3°C	0.2°C
P2	31.3°C	P5	31.7°C	0.4°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : LIFT,ELCB,น้ำพุ
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000476.IS2
1/31/2024 10:49:57 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:49:57 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.3°C	0.95	20.0°C
P1	32.4°C	0.95	20.0°C
P2	32.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000477.IS2
1/31/2024 10:52:11 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:52:11 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.9°C	0.95	20.0°C
P1	32.7°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000478.IS2
1/31/2024 10:52:17 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:52:17 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.9°C	0.95	20.0°C
P1	32.9°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000479.IS2
1/31/2024 10:53:26 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:53:26 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.9°C	0.95	20.0°C
P1	32.0°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000480.IS2
1/31/2024 10:53:33 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:53:33 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.8°C	0.95	20.0°C
P1	31.7°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

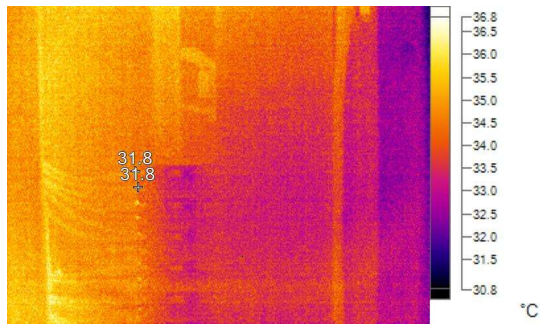

IR000481.IS2
1/31/2024 10:54:37 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:54:37 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.8°C	0.95	20.0°C
P1	31.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000482.IS2
1/31/2024 10:54:44 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:54:44 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.0°C	0.95	20.0°C
P1	31.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000483.IS2
1/31/2024 10:55:38 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:55:38 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.7°C	0.95	20.0°C
P1	32.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000484.IS2
1/31/2024 10:55:46 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:55:46 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.9°C	0.95	20.0°C
P1	31.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000485.IS2
1/31/2024 10:57:36 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:57:36 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.8°C	0.95	20.0°C
P1	31.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000486.IS2
1/31/2024 10:57:41 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:57:41 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.7°C	0.95	20.0°C
P1	31.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ดัก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000487.IS2
1/31/2024 10:58:46 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:58:46 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.7°C	0.95	20.0°C
P1	31.8°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000488.IS2
1/31/2024 10:58:51 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 10:58:51 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.6°C	0.95	20.0°C
P1	31.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000489.IS2
1/31/2024 11:00:06 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:00:06 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.7°C	0.95	20.0°C
P1	32.0°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก B
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000490.IS2
1/31/2024 11:00:13 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:00:13 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.8°C	0.95	20.0°C
P1	31.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : MAIN MDB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

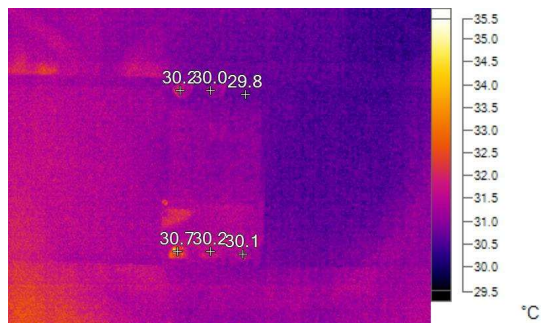

IR000491.IS2
1/31/2024 11:02:13 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:02:13 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	30.2°C	P3	30.7°C	0.5°C
P1	30.0°C	P4	30.2°C	0.2°C
P2	29.8°C	P5	30.1°C	0.3°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : MDBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000492.IS2
1/31/2024 11:02:21 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:02:21 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.2°C	0.95	20.0°C
P1	30.2°C	0.95	20.0°C
P2	30.3°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : MDBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000493.IS2
1/31/2024 11:02:28 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	30.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:02:28 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	30.7°C	0.95	20.0°C
P1	30.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000494.IS2
1/31/2024 11:04:09 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	34.1°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:04:09 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	34.2°C	0.95	20.0°C
P1	34.0°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

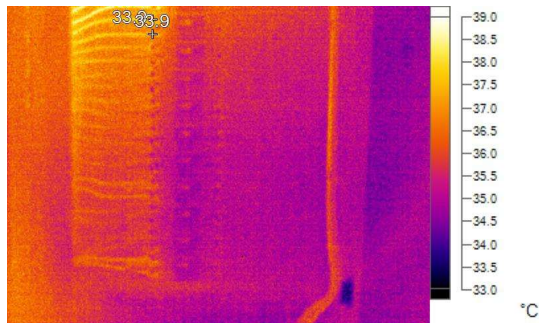

IR000495.IS2
1/31/2024 11:04:15 AM

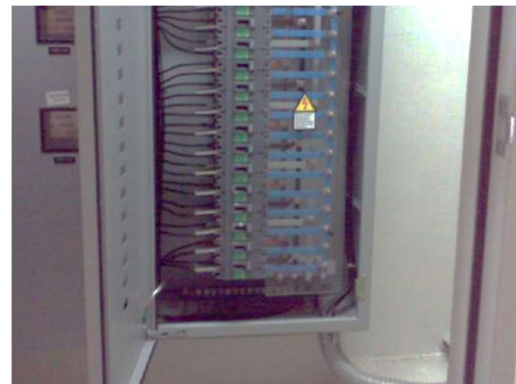

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	33.7°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:04:15 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	33.9°C	0.95	20.0°C
P1	33.9°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000496.IS2
1/31/2024 11:05:11 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	33.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:05:11 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	33.5°C	0.95	20.0°C
P1	33.4°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000497.IS2
1/31/2024 11:05:18 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:05:18 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	33.2°C	0.95	20.0°C
P1	33.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000498.IS2
1/31/2024 11:06:15 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	33.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:06:15 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	33.2°C	0.95	20.0°C
P1	33.2°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

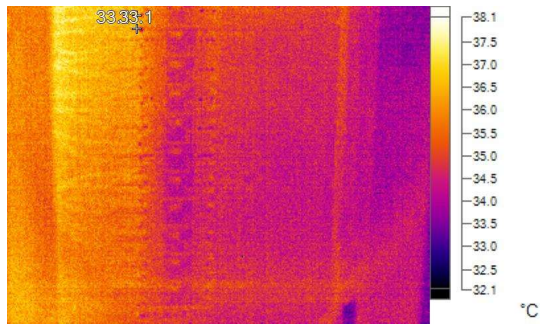

IR000499.IS2
1/31/2024 11:06:21 AM

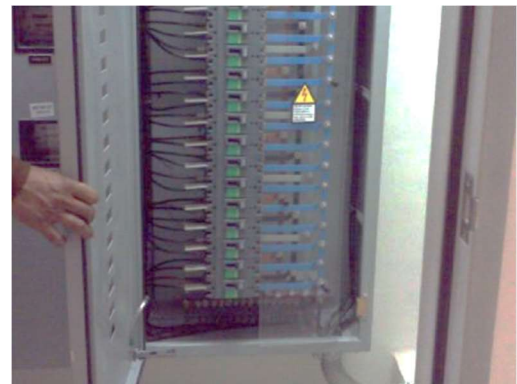

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:06:21 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	33.1°C	0.95	20.0°C
P1	33.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000500.IS2
1/31/2024 11:07:16 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:07:16 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.7°C	0.95	20.0°C
P1	32.7°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000501.IS2
1/31/2024 11:07:23 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:07:23 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.4°C	0.95	20.0°C
P1	32.4°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000502.IS2
1/31/2024 11:08:18 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:08:18 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.9°C	0.95	20.0°C
P1	32.9°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000503.IS2
1/31/2024 11:08:24 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:08:24 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.6°C	0.95	20.0°C
P1	32.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000504.IS2
1/31/2024 11:09:33 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.1°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:09:33 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.2°C	0.95	20.0°C
P1	32.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000505.IS2
1/31/2024 11:09:40 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:09:40 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.0°C	0.95	20.0°C
P1	32.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000506.IS2
1/31/2024 11:10:52 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:10:52 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.5°C	0.95	20.0°C
P1	32.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก C
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBC
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000507.IS2
1/31/2024 11:10:59 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:10:59 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	32.0°C	31.5°C	32.7°C	0.95	20.0°C	0.19

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : MAIN MDB
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

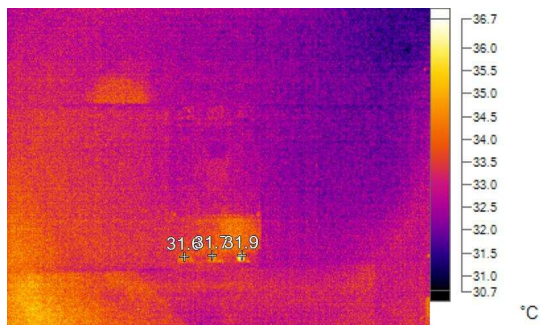

IR000508.IS2
1/31/2024 11:13:08 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:13:08 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.6°C	0.95	20.0°C
P1	31.7°C	0.95	20.0°C
P2	31.9°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EDBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000509.IS2
1/31/2024 11:13:24 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.1°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:13:24 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.3°C	0.95	20.0°C
P1	31.2°C	0.95	20.0°C
P2	31.2°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EDBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000510.IS2
1/31/2024 11:13:33 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.1°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:13:33 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.5°C	0.95	20.0°C
P1	31.6°C	0.95	20.0°C
P2	31.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000511.IS2
1/31/2024 11:15:16 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	33.5°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:15:16 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	33.8°C	0.95	20.0°C
P1	33.7°C	0.95	20.0°C
P2	33.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 8DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000512.IS2
1/31/2024 11:15:23 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	33.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:15:23 AM

Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	33.0°C	32.1°C	33.5°C	0.95	20.0°C	0.17

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000513.IS2
1/31/2024 11:16:43 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:16:43 AM


Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.4°C	0.95	20.0°C
P1	32.1°C	0.95	20.0°C
P2	32.2°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 7DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000514.IS2
1/31/2024 11:16:49 AM

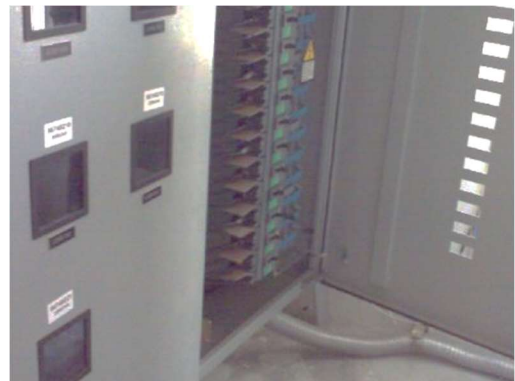

Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	32.0°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:16:49 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.3°C	0.95	20.0°C
P1	32.1°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000515.IS2
1/31/2024 11:18:10 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	32.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:18:10 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.4°C	0.95	20.0°C
P1	32.2°C	0.95	20.0°C
P2	32.5°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 6DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000516.IS2
1/31/2024 11:18:16 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	32.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:18:16 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.3°C	0.95	20.0°C
P1	32.4°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000517.IS2
1/31/2024 11:19:42 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.4°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:19:42 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.5°C	0.95	20.0°C
P1	32.5°C	0.95	20.0°C
P2	32.4°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 5DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000518.IS2
1/31/2024 11:19:48 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	32.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:19:48 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	32.7°C	0.95	20.0°C
P1	32.6°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000519.IS2
1/31/2024 11:21:16 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:21:16 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.9°C	0.95	20.0°C
P1	31.8°C	0.95	20.0°C
P2	32.0°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 4DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

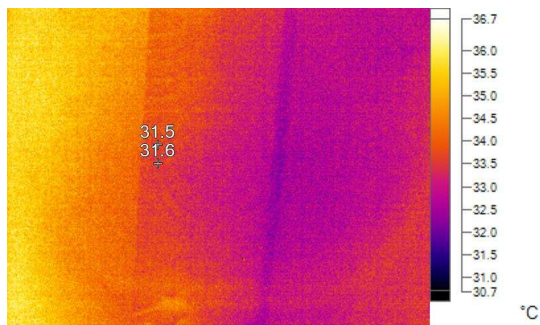

IR000520.IS2
1/31/2024 11:21:23 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:21:23 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.5°C	0.95	20.0°C
P1	31.6°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000521.IS2
1/31/2024 11:23:08 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:23:08 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.8°C	0.95	20.0°C
P1	31.9°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 3DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000522.IS2
1/31/2024 11:23:15 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.3°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:23:15 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.5°C	0.95	20.0°C
P1	31.6°C	0.95	20.0°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000523.IS2
1/31/2024 11:24:59 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	31.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:24:59 AM

Main Image Markers

Name	Temperature	Emissivity	Background
P0	31.9°C	0.95	20.0°C
P1	31.7°C	0.95	20.0°C
P2	31.9°C	0.95	20.0°C

PROJECT : ฟील พพล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : 2DBD
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M

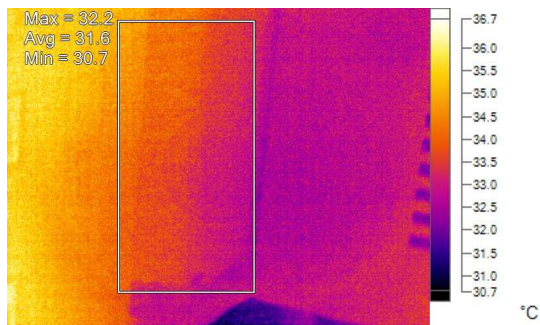

IR000524.IS2
1/31/2024 11:25:05 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	31.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:25:05 AM


Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	31.6°C	30.7°C	32.2°C	0.95	20.0°C	0.18

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : DBE
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000525.IS2
1/31/2024 11:27:44 AM

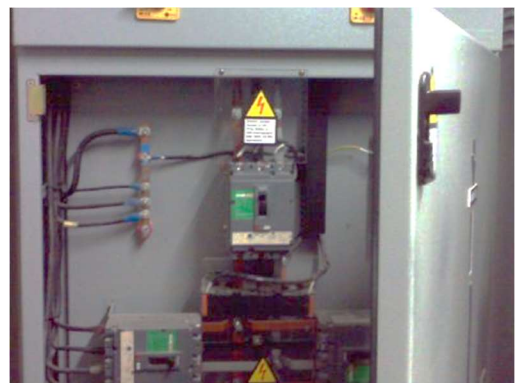

Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	27.9°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:27:44 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	29.3°C	P3	29.5°C	0.2°C
P1	29.2°C	P4	28.4°C	0.8°C
P2	28.6°C	P5	28.0°C	0.6°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : DBE
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000526.IS2
1/31/2024 11:27:54 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	27.2°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:27:54 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	31.2°C	P3	29.2°C	2°C
P1	32.7°C	P4	28.9°C	3.8°C
P2	29.9°C	P5	28.1°C	1.8°C

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ติด D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EDBE
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000527.IS2
1/31/2024 11:28:04 AM



Visible Light Image


Image Info

Background temperature	20.0°C
Average Temperature	27.6°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:28:04 AM


Main Image Markers

Name	Avg	Min	Max	Emissivity	Background	St. Dev.
A0	27.5°C	27.0°C	28.4°C	0.95	20.0°C	0.17

PROJECT : ฟील พหล 34 (Phyll Phahol 34)	LOCATION : ตึก D
INSTRUMENT : FLUKE Ti 32	EQUIPMENT ID : EDBE
SERAIL NO : Ti32-11070104	DISTANCE COMPONENT : 2M



IR000528.IS2
1/31/2024 11:28:11 AM



Visible Light Image

Image Info

Background temperature	20.0°C
Average Temperature	26.8°C
Camera Model	Fluke Ti32
IR Sensor Size	320 x 240
Camera serial number	Ti32-11070104 (60Hz)
Image Time	1/31/2024 11:28:11 AM

Main Image Markers

Name	Temperature	Name	Temperature	Delta T
P0	26.8°C	P3	26.9°C	0.1°C
P1	26.6°C	P4	26.9°C	0.3°C
P2	26.7°C	P5	26.9°C	0.2°C