

ภาคผนวกที่ 19

AFTER ปีล พหล 34



Phyll Phahol 34

Thermoscan Report (After)


PROJECT : Phyll Phahol 34-(14-Feb-2024)

Phyll Phahol 34

| | |
|--|-------------------------|
| PROJECT : ฟील พทล 34 (Phyll Phahol 34) | LOCATION : ดัก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : TR |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000579.IS2
2/14/2024 9:12:17 AM

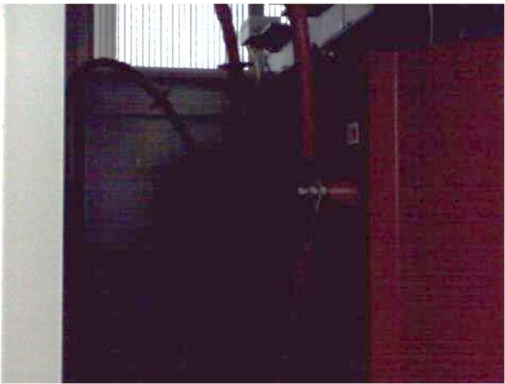

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 36.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:12:17 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 37.4°C | 0.95 | 20.0°C |
| P1 | 36.0°C | 0.95 | 20.0°C |
| P2 | 34.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : TR |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000580.IS2
2/14/2024 9:13:01 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 39.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:13:01 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 34.9°C | 0.95 | 20.0°C |
| P1 | 34.5°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : MAIN CB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000581.IS2
2/14/2024 9:13:27 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 33.9°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:13:27 AM |


Main Image Markers

| Name | Avg | Min | Max | Emissivity | Background | St. Dev. |
|------|--------|--------|--------|------------|------------|----------|
| A0 | 34.2°C | 32.9°C | 39.3°C | 0.95 | 20.0°C | 0.86 |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : MAIN CB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000582.IS2
2/14/2024 9:13:51 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 33.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:13:51 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 33.6°C | P3 | 33.3°C | 0.3°C |
| P1 | 33.6°C | P4 | 33.2°C | 0.4°C |
| P2 | 33.7°C | P5 | 33.1°C | 0.6°C |

| | |
|--|------------------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : MAIN BREALER BRANCH |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000583.IS2

2/14/2024 9:14:26 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:14:26 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.9°C | P3 | 32.8°C | 0.1°C |
| P1 | 33.0°C | P4 | 32.9°C | 0.1°C |
| P2 | 32.9°C | P5 | 32.8°C | 0.1°C |

| | |
|--|----------------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : DBB,DBE,EVA,SPARE |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000584.IS2
2/14/2024 9:14:40 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.9°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:14:40 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 33.6°C | P3 | 33.1°C | 0.5°C |
| P1 | 33.3°C | P4 | 32.7°C | 0.6°C |
| P2 | 32.9°C | P5 | 33.0°C | 0.1°C |

| | |
|--|-----------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : BUSDUCT 600A |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000585.IS2
2/14/2024 9:15:11 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:15:11 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 33.9°C | P3 | 35.1°C | 1.2°C |
| P1 | 34.3°C | P4 | 34.9°C | 0.6°C |
| P2 | 33.0°C | P5 | 33.3°C | 0.3°C |

| | |
|--|----------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : LCA,LCB,LCC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000586.IS2
2/14/2024 9:15:21 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:15:21 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.5°C | P3 | 32.0°C | 0.5°C |
| P1 | 32.4°C | P4 | 32.2°C | 0.2°C |
| P2 | 32.4°C | P5 | 32.2°C | 0.2°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : CAPBANK |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000587.IS2
2/14/2024 9:15:32 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:15:32 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.2°C | P3 | 32.0°C | 0.2°C |
| P1 | 32.2°C | P4 | 31.9°C | 0.3°C |
| P2 | 32.2°C | P5 | 31.9°C | 0.3°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EMDB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000588.IS2

2/14/2024 9:15:48 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:15:48 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.8°C | 0.95 | 20.0°C |
| P1 | 32.5°C | 0.95 | 20.0°C |
| P2 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EMDB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000589.IS2
2/14/2024 9:15:54 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:15:54 AM |


Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.5°C | P3 | 31.9°C | 0.6°C |
| P1 | 32.6°C | P4 | 32.0°C | 0.6°C |
| P2 | 32.2°C | P5 | 32.0°C | 0.2°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : CAP |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000590.IS2
2/14/2024 9:16:13 AM

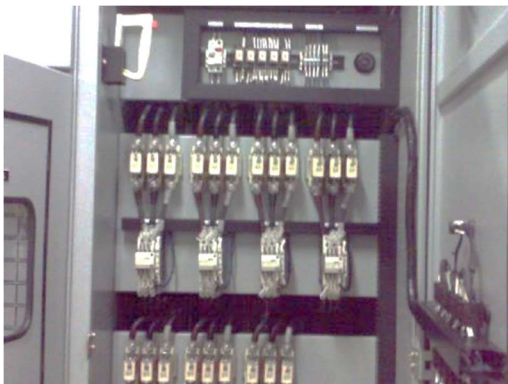

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:16:13 AM |

Main Image Markers

| Name | Avg | Min | Max | Emissivity | Background | St. Dev. |
|------|--------|--------|--------|------------|------------|----------|
| A0 | 32.5°C | 32.1°C | 32.9°C | 0.95 | 20.0°C | 0.13 |
| A1 | 32.4°C | 31.8°C | 33.2°C | 0.95 | 20.0°C | 0.14 |
| A2 | 32.3°C | 31.8°C | 33.6°C | 0.95 | 20.0°C | 0.15 |
| A3 | 32.3°C | 31.9°C | 32.9°C | 0.95 | 20.0°C | 0.12 |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : CAP |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |

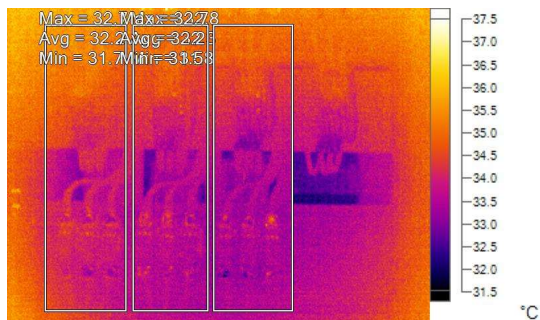

IR000591.IS2
2/14/2024 9:16:22 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:16:22 AM |

Main Image Markers

| Name | Avg | Min | Max | Emissivity | Background | St. Dev. |
|------|--------|--------|--------|------------|------------|----------|
| A0 | 32.3°C | 31.8°C | 32.8°C | 0.95 | 20.0°C | 0.18 |
| A1 | 32.2°C | 31.7°C | 32.7°C | 0.95 | 20.0°C | 0.18 |
| A2 | 32.2°C | 31.5°C | 32.7°C | 0.95 | 20.0°C | 0.17 |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : CAP |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000592.IS2
2/14/2024 9:16:32 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:16:32 AM |


Main Image Markers

| Name | Avg | Min | Max | Emissivity | Background | St. Dev. |
|------|--------|--------|--------|------------|------------|----------|
| A0 | 32.0°C | 31.6°C | 32.4°C | 0.95 | 20.0°C | 0.12 |
| A1 | 31.9°C | 31.5°C | 32.7°C | 0.95 | 20.0°C | 0.15 |
| A2 | 31.9°C | 31.5°C | 33.2°C | 0.95 | 20.0°C | 0.16 |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : ATS |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000593.IS2
2/14/2024 9:16:51 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:16:51 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.2°C | P3 | 32.1°C | 0.1°C |
| P1 | 32.4°C | P4 | 32.1°C | 0.3°C |
| P2 | 33.1°C | P5 | 32.5°C | 0.6°C |

| | |
|--|------------------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EDBB,EDBC,EDBD,EDBE |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000594.IS2
2/14/2024 9:17:20 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.1°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:17:20 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.2°C | P3 | 32.1°C | 0.1°C |
| P1 | 32.3°C | P4 | 32.1°C | 0.2°C |
| P2 | 32.2°C | P5 | 32.0°C | 0.2°C |

| | |
|--|--|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : ELCA,LIFT 12A,SPARE,SPARE |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000595.IS2
2/14/2024 9:17:55 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.9°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:17:55 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.2°C | 0.95 | 20.0°C |
| P1 | 32.2°C | 0.95 | 20.0°C |
| P2 | 32.2°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000596.IS2
2/14/2024 9:20:21 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:20:21 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.6°C | 0.95 | 20.0°C |
| P1 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000597.IS2
2/14/2024 9:20:35 AM

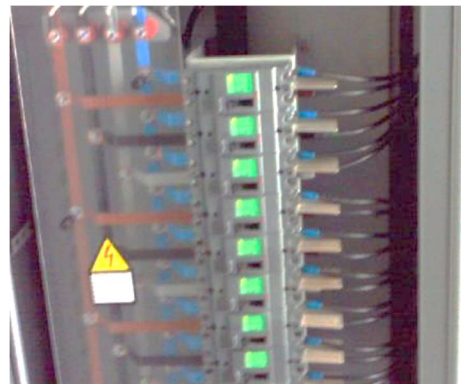

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.4°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:20:35 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.6°C | 0.95 | 20.0°C |
| P1 | 32.5°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000598.IS2
2/14/2024 9:20:42 AM

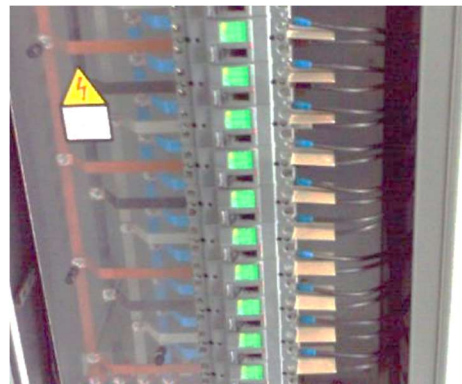

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:20:42 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 32.5°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:22:09 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.3°C | 0.95 | 20.0°C |
| P1 | 31.3°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000600.IS2
2/14/2024 9:22:16 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:22:16 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.8°C | 0.95 | 20.0°C |
| P1 | 31.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |

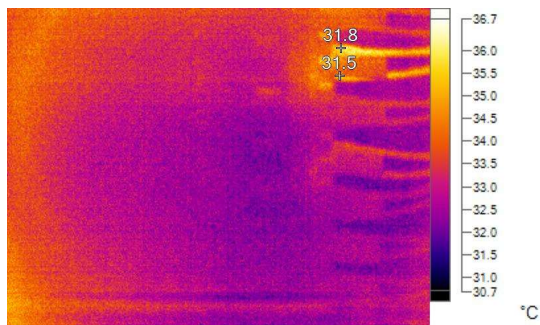

IR000601.IS2
2/14/2024 9:22:25 AM

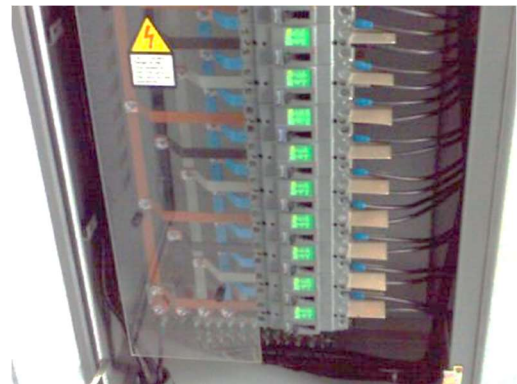

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:22:25 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.8°C | 0.95 | 20.0°C |
| P1 | 31.5°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000602.IS2
2/14/2024 9:24:20 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:24:20 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.4°C | 0.95 | 20.0°C |
| P1 | 31.5°C | 0.95 | 20.0°C |

| | |
|---|-------------------------|
| PROJECT : ฟील พหอล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000603.IS2
2/14/2024 9:24:30 AM

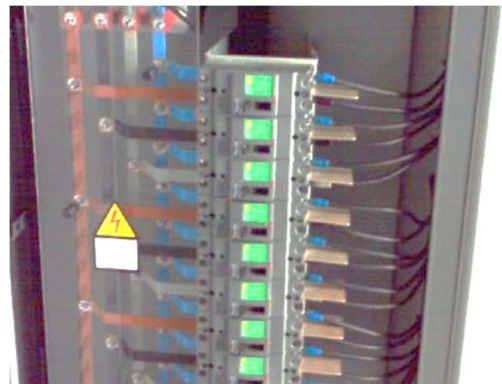

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.1°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:24:30 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.2°C | 0.95 | 20.0°C |
| P1 | 31.3°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000604.IS2
2/14/2024 9:24:38 AM

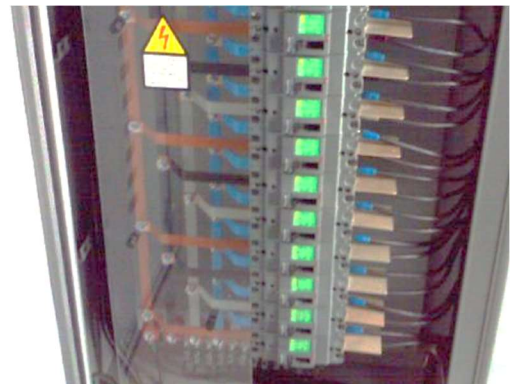

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.1°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:24:38 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.5°C | 0.95 | 20.0°C |
| P1 | 31.4°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |

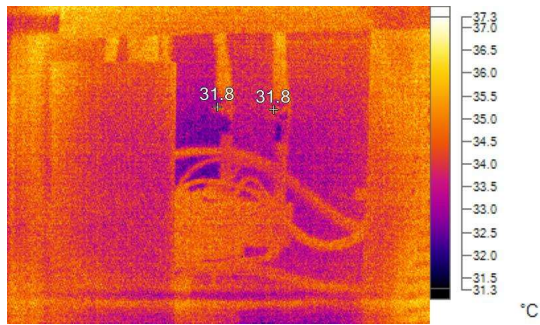

IR000605.IS2
2/14/2024 9:26:52 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:26:52 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.8°C | 0.95 | 20.0°C |
| P1 | 31.8°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000606.IS2
2/14/2024 9:26:58 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:26:58 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.7°C | 0.95 | 20.0°C |
| P1 | 31.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000607.IS2
2/14/2024 9:27:04 AM

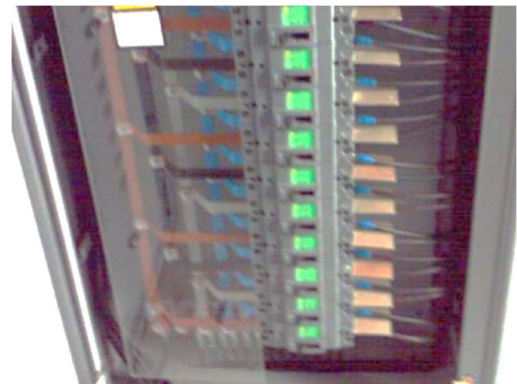

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:27:04 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.4°C | 0.95 | 20.0°C |
| P1 | 31.5°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000608.IS2
2/14/2024 9:27:53 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:27:53 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.4°C | 0.95 | 20.0°C |
| P1 | 31.4°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000609.IS2
2/14/2024 9:28:00 AM

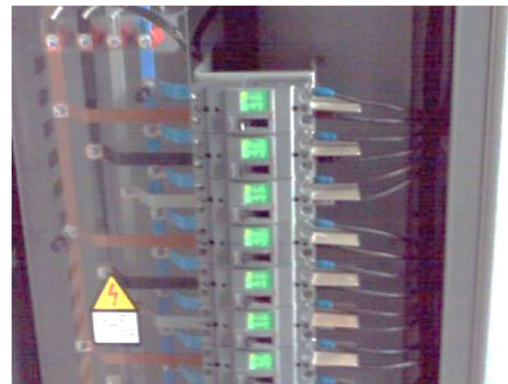

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.4°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:28:00 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.7°C | 0.95 | 20.0°C |
| P1 | 31.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000610.IS2
2/14/2024 9:28:05 AM

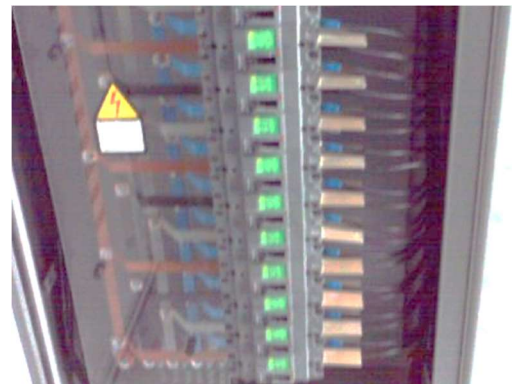

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:28:05 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.4°C | 0.95 | 20.0°C |
| P1 | 31.3°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000611.IS2
2/14/2024 9:28:55 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.1°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:28:55 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.3°C | 0.95 | 20.0°C |
| P1 | 31.3°C | 0.95 | 20.0°C |
| P2 | 31.2°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000612.IS2
2/14/2024 9:29:03 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:29:03 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.7°C | 0.95 | 20.0°C |
| P1 | 31.4°C | 0.95 | 20.0°C |

| | |
|---|-------------------------|
| PROJECT : ฟील พหอล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000613.IS2
2/14/2024 9:29:51 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:29:51 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.8°C | 0.95 | 20.0°C |
| P1 | 31.8°C | 0.95 | 20.0°C |
| P2 | 31.9°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก A |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBA |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000614.IS2
2/14/2024 9:29:57 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.6°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:29:57 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.9°C | 0.95 | 20.0°C |
| P1 | 31.8°C | 0.95 | 20.0°C |

| | |
|--|-------------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : ชั้น1 MDB MAIN |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000615.IS2
2/14/2024 9:38:55 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:38:55 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.2°C | P3 | 32.2°C | 0°C |
| P1 | 32.2°C | P4 | 32.4°C | 0.2°C |
| P2 | 33.1°C | P5 | 31.9°C | 1.2°C |

| | |
|--|--------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EDBB MAIN |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000616.IS2
2/14/2024 9:39:16 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:39:16 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 33.0°C | 0.95 | 20.0°C |
| P2 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|--------------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : LIFT,ELCB,น้ำพุ |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000617.IS2
2/14/2024 9:39:23 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:39:23 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 33.1°C | 0.95 | 20.0°C |
| P1 | 32.8°C | 0.95 | 20.0°C |
| P2 | 32.8°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000618.IS2
2/14/2024 9:40:59 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 34.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:40:59 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 34.2°C | 0.95 | 20.0°C |
| P1 | 34.3°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000619.IS2
2/14/2024 9:41:05 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 33.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:41:05 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 34.0°C | 0.95 | 20.0°C |
| P1 | 34.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000620.IS2
2/14/2024 9:41:56 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:41:56 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 33.0°C | 0.95 | 20.0°C |
| P1 | 33.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |

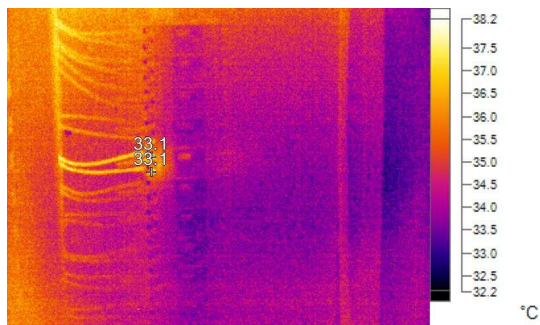

IR000621.IS2
2/14/2024 9:42:02 AM

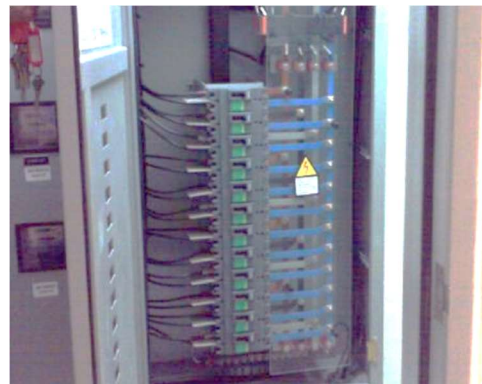

Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:42:02 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 33.1°C | 0.95 | 20.0°C |
| P1 | 33.1°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000622.IS2
2/14/2024 9:42:55 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:42:55 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.5°C | 0.95 | 20.0°C |
| P1 | 32.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000623.IS2
2/14/2024 9:43:01 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:43:01 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 32.8°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000624.IS2
2/14/2024 9:43:46 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:43:46 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.2°C | 0.95 | 20.0°C |
| P1 | 32.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000625.IS2
2/14/2024 9:43:52 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:43:52 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.1°C | 0.95 | 20.0°C |
| P1 | 32.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000626.IS2
2/14/2024 9:44:31 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:44:31 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.1°C | 0.95 | 20.0°C |
| P1 | 32.1°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000627.IS2
2/14/2024 9:44:37 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:44:37 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.9°C | 0.95 | 20.0°C |
| P1 | 31.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000628.IS2
2/14/2024 9:45:26 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:45:26 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.3°C | 0.95 | 20.0°C |
| P1 | 31.9°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000629.IS2
2/14/2024 9:45:32 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.6°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:45:32 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.2°C | 0.95 | 20.0°C |
| P1 | 32.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000630.IS2
2/14/2024 9:46:10 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.6°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:46:10 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.7°C | 0.95 | 20.0°C |
| P1 | 31.8°C | 0.95 | 20.0°C |
| P2 | 31.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก B |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000631.IS2
2/14/2024 9:46:16 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:46:16 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.8°C | 0.95 | 20.0°C |
| P1 | 31.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : MAIN MDB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000632.IS2
2/14/2024 9:48:05 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 30.6°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:48:05 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 30.8°C | P3 | 31.1°C | 0.3°C |
| P1 | 30.6°C | P4 | 30.7°C | 0.1°C |
| P2 | 30.7°C | P5 | 30.9°C | 0.2°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : MDBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000633.IS2
2/14/2024 9:48:32 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 30.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:48:32 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 30.9°C | 0.95 | 20.0°C |
| P1 | 31.0°C | 0.95 | 20.0°C |
| P2 | 31.2°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : MDBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |

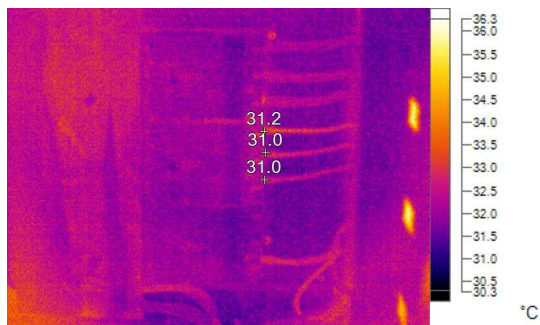

IR000634.IS2
2/14/2024 9:48:37 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 30.9°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:48:37 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.2°C | 0.95 | 20.0°C |
| P1 | 31.0°C | 0.95 | 20.0°C |
| P2 | 31.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000635.IS2
2/14/2024 9:49:59 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 34.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:49:59 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 34.4°C | 0.95 | 20.0°C |
| P1 | 34.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000636.IS2
2/14/2024 9:50:04 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 33.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:50:04 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 33.8°C | 0.95 | 20.0°C |
| P1 | 34.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000637.IS2
2/14/2024 9:50:34 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 33.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:50:34 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000638.IS2
2/14/2024 9:50:39 AM

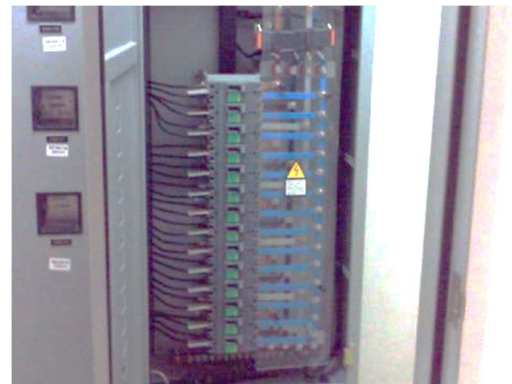

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:50:39 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 32.8°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.9°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:51:21 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.9°C | 0.95 | 20.0°C |
| P1 | 32.9°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000640.IS2
2/14/2024 9:51:33 AM

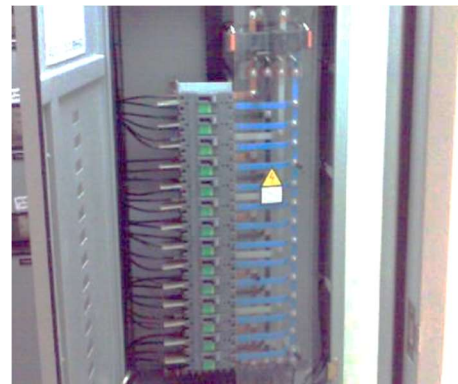

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.6°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:51:33 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.8°C | 0.95 | 20.0°C |
| P1 | 32.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000641.IS2
2/14/2024 9:52:10 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.6°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:52:10 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.9°C | 0.95 | 20.0°C |
| P1 | 33.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000642.IS2
2/14/2024 9:52:15 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.4°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:52:15 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.5°C | 0.95 | 20.0°C |
| P1 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000643.IS2
2/14/2024 9:52:49 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.4°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:52:49 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.6°C | 0.95 | 20.0°C |
| P1 | 32.8°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000644.IS2
2/14/2024 9:52:56 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:52:56 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.5°C | 0.95 | 20.0°C |
| P1 | 32.3°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000645.IS2
2/14/2024 9:53:29 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.1°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:53:29 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.1°C | 0.95 | 20.0°C |
| P1 | 32.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000646.IS2
2/14/2024 9:53:35 AM

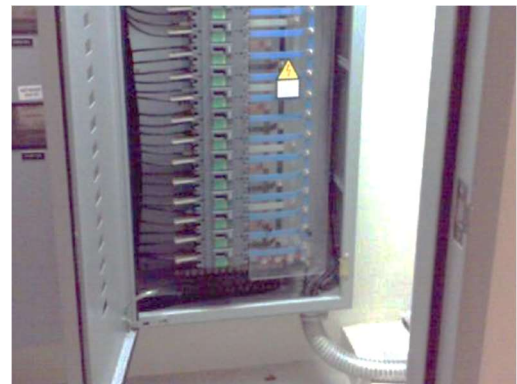

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:53:35 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.1°C | 0.95 | 20.0°C |
| P1 | 32.1°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000647.IS2
2/14/2024 9:54:36 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:54:36 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.2°C | 0.95 | 20.0°C |
| P1 | 32.2°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก C |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBC |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000648.IS2
2/14/2024 9:54:42 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.1°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:54:42 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.2°C | 0.95 | 20.0°C |
| P1 | 32.2°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : MAIN MDB |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000649.IS2
2/14/2024 9:56:47 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:56:47 AM |


Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 32.9°C | P3 | 32.4°C | 0.5°C |
| P1 | 32.5°C | P4 | 32.1°C | 0.4°C |
| P2 | 31.6°C | P5 | 32.2°C | 0.6°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EDBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000650.IS2
2/14/2024 9:56:59 AM

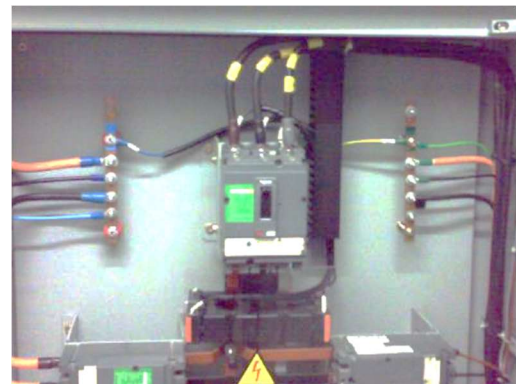

Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:56:59 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 31.8°C | 0.95 | 20.0°C |
| P1 | 31.7°C | 0.95 | 20.0°C |
| P2 | 31.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EDBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000651.IS2
2/14/2024 9:57:11 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:57:11 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.0°C | 0.95 | 20.0°C |
| P1 | 32.1°C | 0.95 | 20.0°C |
| P2 | 32.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000652.IS2
2/14/2024 9:59:01 AM



Visible Light Image


Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 34.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:59:01 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 34.4°C | 0.95 | 20.0°C |
| P1 | 34.4°C | 0.95 | 20.0°C |
| P2 | 34.5°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 8DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000653.IS2
2/14/2024 9:59:19 AM



Visible Light Image

Image Info

| | |
|------------------------|----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 33.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 9:59:19 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 34.0°C | 0.95 | 20.0°C |
| P1 | 34.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000654.IS2
2/14/2024 10:00:09 AM



Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.4°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:00:09 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.6°C | 0.95 | 20.0°C |
| P1 | 32.5°C | 0.95 | 20.0°C |
| P2 | 32.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 7DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000655.IS2
2/14/2024 10:00:17 AM



Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:00:17 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.5°C | 0.95 | 20.0°C |
| P1 | 32.3°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000656.IS2
2/14/2024 10:00:56 AM

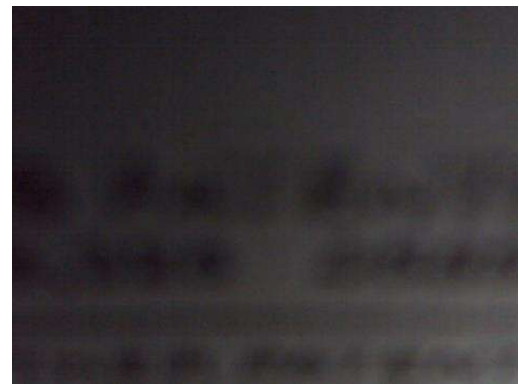

Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:00:56 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 6DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000657.IS2
2/14/2024 10:01:02 AM

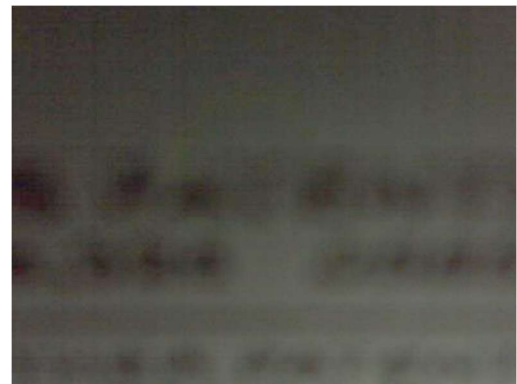

Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:01:02 AM |

Main Image Markers

| Name | Avg | Min | Max | Emissivity | Background | St. Dev. |
|------|--------|--------|--------|------------|------------|----------|
| A0 | 32.6°C | 31.6°C | 33.1°C | 0.95 | 20.0°C | 0.17 |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000658.IS2
2/14/2024 10:01:46 AM



Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:01:46 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 32.7°C | 0.95 | 20.0°C |
| P2 | 32.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ติด D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 5DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000659.IS2
2/14/2024 10:01:52 AM



Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:01:52 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.6°C | 0.95 | 20.0°C |
| P1 | 32.6°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:03:18 AM |


Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.6°C | 0.95 | 20.0°C |
| P1 | 32.7°C | 0.95 | 20.0°C |
| P2 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 4DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000661.IS2
2/14/2024 10:03:30 AM

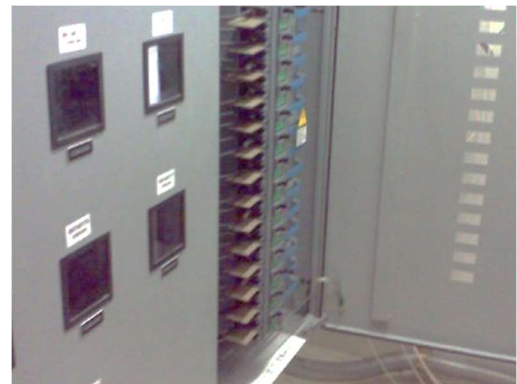

Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.3°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:03:30 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.4°C | 0.95 | 20.0°C |
| P1 | 32.5°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000662.IS2
2/14/2024 10:05:02 AM



Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.8°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:05:02 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.0°C | 0.95 | 20.0°C |
| P1 | 31.9°C | 0.95 | 20.0°C |
| P2 | 31.9°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ติด D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 3DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000663.IS2
2/14/2024 10:05:10 AM



Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 31.7°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:05:10 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.0°C | 0.95 | 20.0°C |
| P1 | 32.0°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000664.IS2
2/14/2024 10:06:33 AM



Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.5°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:06:33 AM |

Main Image Markers

| Name | Temperature | Emissivity | Background |
|------|-------------|------------|------------|
| P0 | 32.7°C | 0.95 | 20.0°C |
| P1 | 32.6°C | 0.95 | 20.0°C |
| P2 | 32.7°C | 0.95 | 20.0°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : 2DBD |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000665.IS2
2/14/2024 10:06:40 AM



Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 32.4°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:06:40 AM |


Main Image Markers

| Name | Avg | Min | Max | Emissivity | Background | St. Dev. |
|------|--------|--------|--------|------------|------------|----------|
| A0 | 32.3°C | 31.6°C | 32.9°C | 0.95 | 20.0°C | 0.18 |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : DBE |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000666.IS2
2/14/2024 10:08:55 AM



Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 27.4°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:08:55 AM |


Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 28.8°C | P3 | 28.3°C | 0.5°C |
| P1 | 28.3°C | P4 | 28.0°C | 0.3°C |
| P2 | 28.0°C | P5 | 27.5°C | 0.5°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : DBE |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000667.IS2
2/14/2024 10:09:02 AM

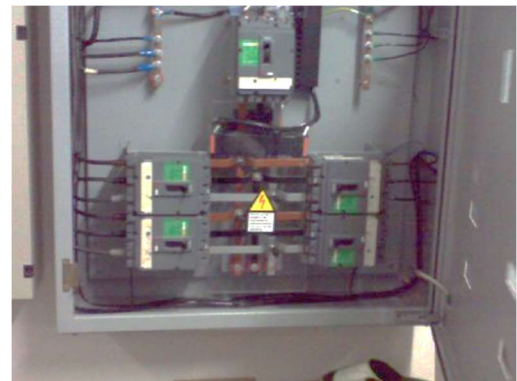

Visible Light Image


Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 27.0°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:09:02 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 29.3°C | P3 | 28.0°C | 1.3°C |
| P1 | 30.6°C | P4 | 28.2°C | 2.4°C |
| P2 | 27.9°C | P5 | 27.6°C | 0.3°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EDBE |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000668.IS2
2/14/2024 10:09:44 AM



Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 26.2°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:09:44 AM |


Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 25.9°C | P3 | 25.5°C | 0.4°C |
| P1 | 25.6°C | P4 | 25.0°C | 0.6°C |
| P2 | 25.6°C | P5 | 25.1°C | 0.5°C |

| | |
|--|-------------------------|
| PROJECT : ฟील พหล 34 (Phyll Phahol 34) | LOCATION : ตึก D |
| INSTRUMENT : FLUKE Ti 32 | EQUIPMENT ID : EDBE |
| SERAIL NO : Ti32-11070104 | DISTANCE COMPONENT : 2M |



IR000669.IS2
2/14/2024 10:09:51 AM

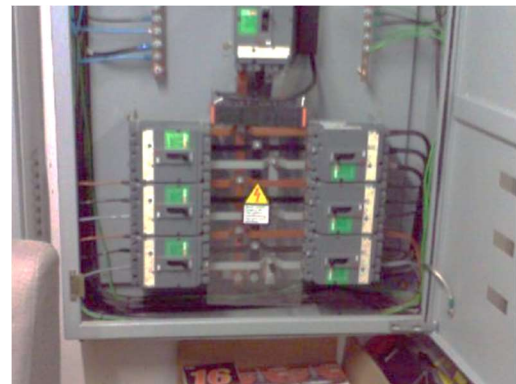

Visible Light Image

Image Info

| | |
|------------------------|-----------------------|
| Background temperature | 20.0°C |
| Average Temperature | 25.6°C |
| Camera Model | Fluke Ti32 |
| IR Sensor Size | 320 x 240 |
| Camera serial number | Ti32-11070104 (60Hz) |
| Image Time | 2/14/2024 10:09:51 AM |

Main Image Markers

| Name | Temperature | Name | Temperature | Delta T |
|------|-------------|------|-------------|---------|
| P0 | 26.7°C | P3 | 25.2°C | 1.5°C |
| P1 | 25.9°C | P4 | 24.9°C | 1°C |
| P2 | 25.9°C | P5 | 25.3°C | 0.6°C |