

**7.12 เอกสารการตรวจสอบประสิทธิภาพของอุปกรณ์ป้องกันอัคคีภัย
บันไดหนีไฟ ป้ายเครื่องหมายแสดงทางหนีไฟ และแผนผังเส้นทางหนีไฟ**

Summary Fire Equipment Report

Month: 02 January 2024

Extinguisher Tank	Location				Total
	B.O.H.	F.H.C.	Fire Cart	Spare Tank	
1. CO2	26	6	1	0	33
2. Halotron	8	0	0	1	9
3. Dry Chemical	0	38	3	7	48
4. Wet Chemical	3	0	0	0	3
5. Form	3	0	0	0	3
Total	40	44	4	8	96

Remark: Spare tank have kept in store inside Security Store room and fire cart has set nearby Store Keeper.

Back of the House (B.O.H)			
Type of tank	Quantity	Status	
		Yes	No
1. CO2	26	26	0
2. Halotron	8	8	0
3. Wet Chemical	3	4	0
4. Form	3	3	0
Total	40	41	0

Fire Hose Cabinet (F.H.C.)			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	38	38	0
2 CO2	6	6	0
Total	44	44	0

Fire Cart			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	3	3	0
2 CO2	1	1	0
Total	4	4	0

Spare Store			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	13	13	0
2. Halotron	4	4	0
Total	17	17	0

Other Equipment			
	Quantity	Status	
		Yes	No
1. Fire Blanket	5	5	0
2. Clothing Protect Heat	3	3	0
Total	8	8	0

Remark: The Clothing Protect Heat are kept in Hanger Cabinet nearby Fire Cart.

Other Emergency light / Signage	Status	Location										Total
		A	B	C-D	E	HR	BOH	UTOPIA	MK	LOBBY	ENG	
1. Emergency light	ALL	15	21	20	12	5	27	10	18	2	5	135
	YES	15	19	14	6	2	11	3	6	2	0	78
	NO	1	2	6	6	1	13	1	9	0	5	44
	Remove	0	0	0	0	1	3	6	3	0	1	14
2. Exit signage	ALL	2	1	2	0	0	7	15	6	3	0	36
	YES	2	1	2	0	0	7	15	6	3	0	36
	NO	0	0	0	0	0	1	0	0	0	0	1
3. Arrow point signage	ALL	15	22	32	4	1	2	4	4	3	0	87
	YES	14	22	30	4	1	2	3	3	3	0	82
	NO	1	0	2	0	0	2	1	1	0	0	7

Fire Hose Cabinet Checklist

Checked on Date: 02 January 2024

No.	Floor	Register No.	Location	Inside Fire Host Cabinet					Model	
				Hose Rack 30 M. 1.5 Inc	Nozzle	Hydrant Valve 2.5	Extinguisher			
							Tag	Yes		No
1st Floor										
1	1	FHC 01-01	Corridor A in front of room 1102						6.8 KGS.(ST-15 lbs.)	
2	1	FHC 01-02	Corridor A beside guest elevator						6.8 KGS.(ST-15 lbs.)	
3	1	FHC 01-03	Back of Cham Cha room(CO2)						10 C	
4	1	FHC 01-04	Inside Latest Recipe (CO2)						10 lbs.	
5	1	FHC 01-05	Near Main Kitchen door						10V (VIP-10lbs.)	
6	1	FHC 01-06	Beside Chief Steward Office						6.8 KGS.(ST-15 lbs.)	
7	1	FHC 01-07	In front of staff canteen						6.8 KGS.(15lbs.)	
8	1	FHC 01-08	Corridor B beside guest elevator (Latest Recipe)						6.8 KGS.(ST-15 lbs.)	
9	1	FHC 01-09	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	
10	1	FHC 01-10	Building C in front of pantry room						CN-15	
11	1	FHC 01-11	Building D near guest room 4101						FM-15 lbs. 6.8 KGS.	
12	1	FHC 01-12	Building E near guest room 5103						10 lbs.(5 KGS.) 4A:2B	
13	1	FHC 01-13	Building E near guest room 5107						10 lbs.(5 KGS.) 4A:2B	
14	1	FHC 01-14	Favola						6.8 KGS.(ST-15 lbs.)	
15	1	FHC 01-15	Spa						6.8 KGS.(ST-15 lbs.)	
2nd Floor										
16	2	FHC 02-01	Corridor A in front of guest room 1202						6.8 KGS.(ST-15 lbs.)	
17	2	FHC 02-02	Corridor A in front of Executive office						6.8 KGS.(ST-15 lbs.)	
18	2	FHC 02-03	Corridor B beside guest elevator (near fitness)						6.8 KGS.(ST-15 lbs.)	
19	2	FHC 02-04	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	
20	2	FHC 02-05	Building C corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	
21	2	FHC 02-06	Building D near guest room 4201						CN-15	
22	2	FHC 02-07	Building E near guest room 5203						10 lbs.(5 KGS.) 4A:2B	
23	2	FHC 02-08	Building E near guest room 5207						10 lbs.(5 KGS.) 4A:2B	
24	2	FHC 02-09	Toilet Utopia Fl.2(CO2)						10 lbs.	
3rd Floor										
25	3	FHC 03-01	Corridor in front of guest room 1302						6.8 KGS.(ST-15 lbs.)	
26	3	FHC 03-02	Corridor A near Kiosk shop						6.8 KGS.(ST-15 lbs.)	
27	3	FHC 03-03	In front of Business Center						6.8 KGS.(ST-15 lbs.)	
28	3	FHC 03-04	In front of Lobby Latitude 19 (Dry Chemical)						6.8 KGS.(ST-15 lbs.)	
			In front of Lobby Latitude 19 (CO2)						10 lbs.	
29.1	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	
29.2	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	
29.3	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	
30.1	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	
30.2	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	
30.3	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	
31	3	FHC 03-07	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	
32	3	FHC 03-08	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	
33	3	FHC 03-09	Corridor Building C front of pantry room						6.8 KGS.(ST-15 lbs.)	
34	3	FHC 03-10	Building D near guest room 4301						6.8 KGS.(ST-15 lbs.)	
35	3	FHC 03-11	Building E near guest room 5303						10 lbs.(5 KGS.) 4A:2B	
36	3	FHC 03-12	Building E near guest room 5307						10 lbs.(5 KGS.) 4A:2B	
4th Floor										
37	4	FHC 04-01	Corridor A in front of guest room 1402						6.8 KGS.(ST-15 lbs.)	
38	4	FHC 04-02	Corridor A near guest elevator						6.8 KGS.(ST-15 lbs.)	
39	4	FHC 04-03	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	
40	4	FHC 04-04	Building B near stair guest						6.8 KGS.(ST-15 lbs.)	
41	4	FHC 04-05	Building C Corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	
42	4	FHC 04-06	Building D near guest room 4401						6.8 KGS.(ST-15 lbs.)	
43	4	FHC 04-07	Building E near guest room 5403						10 lbs.(5 KGS.) 4A:2B	
44	4	FHC 04-08	Building E near guest room 5407						10C (CO2 10 lbs.)	

Summary : The total of 44 fire host cabinets.

Parameter	Total (Location)	Status		Remark
		Normal	Abnormal	
Hose Rack 30 m. 1.5 inc.	44	44	0	
Nozzle	44	44	0	
Hydrant Valve 2.5	44	44	0	
Dry Chemical Extinguisher	38	38	0	
CO ₂ Extinguisher	6	6	0	
The Fire hose cabinet door closer	44	44	0	

Fire Extinguisher (Hanged Alone) Checklist

Checked on Date : 02 January 2024

No.	Floor	Locations	TAG	CO2 10lb		Halotron 10 lb		Dry chemical 10 lb		WetChemical 10lb		Model	Manufacturer	Fire Blanket	Remark
				Yes	No	Yes	No	Yes	No	Yes	No				
1	G	Receiving Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
2	G	in front of Canteen room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
3	G	Accounting Office 1				✓						NON-CFC (10N)	V.I.P Fire		
4	G	Accounting Office 2				✓						NON-CFC (10N)	V.I.P Fire		
5	G	Laundry Room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
6	G	Laundry Room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
7	G	Laundry Room 3 (Store Laundry)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
8	G	Generator room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
9	G	MDR Room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
10	G	Plant room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
11	G	Plant room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
12	G	Plant room 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
13	G	Plant room 4		✓								10C (CO2 10 lbs.)	V.I.P Fire		
14	G	F&B in Pantry room behind Latest Recipe		✓								10C (CO2 10 lbs.)	V.I.P Fire		
15	G	F&B in front of butcher room								✓		Pro Plus 100K 2005	Kidde		
16	G	F&B in front of Fruit room								✓		Pro Plus 100K 2005	Kidde		
17	G	F&B in front of Bakery room								✓		Pro Plus 100K 2005	Kidde		
18	G	F&B inside Bakery room								✓		Pro Plus 100K 2005	Kidde		
19	G	Engineering Office 1				✓						NON-CFC (10N)	V.I.P Fire		
20	G	Engineering Office 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
21	G	Maintenance work shop 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
22	G	Maintenance work shop 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
23	G	Maintenance work shop 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
24	G	FAVOLA Steward Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
25	G	FAVOLA Kitchen								✓		K01-3	K-Guard		
26	G	SPA Manager room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
27	G	Treatment room 1 (Parvati)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
28	G	Treatment room 2 (Leelawadee)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
29	G	Treatment room 3 (Ratree)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
30	G	Treatment room 4 (Chuanom)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
31	G	Associate & Store room of SPA		✓								10C (CO2 10 lbs.)	V.I.P Fire		
32	G	EV Charger		✓								10C (CO2 10 lbs.)	V.I.P Fire		
33	2	HR Office				✓						NON-CFC (10N)	V.I.P Fire		
34	2	Executive Office 1				✓						NON-CFC (10N)	V.I.P Fire		
35	2	Executive Office 2				✓						NON-CFC (10N)	V.I.P Fire		
36	3	Front Office Department 1				✓						NON-CFC (10N)	V.I.P Fire		
37	3	Front Office Department 2				✓						NON-CFC (10N)	V.I.P Fire		
38	3	Lift service room Angsana		✓								10C (CO2 10 lbs.)	V.I.P Fire		
39	4	Elevator A						✓				10 C	Best		
40	4	Elevator B						✓				10 C	Best		
41	4	Elevator CDE						✓				10 C	Best		
42	G	India Kitchen								✓		Pro Plus 100K 2005	Kidde		
43	G	Gas Station 1						✓				15 lbs (6.9 KG.)	Imperial		
44	G	Gas Station 2						✓				15 lbs (6.9 KG.)	Imperial		
45	G	Gas Station Favola						✓				15 lbs (6.9 KG.)	Imperial		
Total (Tanks)				0	25	0	8	0	6	0	5	0			1

Fire Cart Check List

No.	Description	TAG	Result		Remark	Model	Manufacturer
			Normal	Disable			
1	Extinguisher Dry Chemical (10 Lbs.) No.1	✓	✓			CN-15	C-NON Fire
2	Extinguisher Dry Chemical (10 Lbs.) No.2	✓	✓			CN-15	C-NON Fire
3	Extinguisher Dry Chemical (10 Lbs.) No.3	✓	✓			TF-15	Top Fire
4	Extinguisher CO2 No.4	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
5	Extinguisher CO2 No.5	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
6	Rope	✓			1 rope		
7	Hydrant 2.5 " set	✓			1 set		
8	Axe	✓			1		
9	Fire fighting Suite	✓			3 set		


Spare Tanks (Store in LP Store Room)

NO.	Location	Fire Extinguisher Spare (Tank)										Model	Manufacturer	Remark
		TAG	CO2 10lb		Halotron 10lb		Dry Chemical 10lb		Wet Chemical 10lb					
			Yes	No	Yes	No	Yes	No	Yes	No				
1	Store in Plant room NO. 1	✓			✓							Non CFC (10N)	V.I.P Fire	
2	Store in Plant room NO. 2	✓			✓							10 lbs.	Number 1 Fire	
3	Store in Plant room NO. 3	✓			✓							10 lbs.	Number 1 Fire	
4	Store in Plant room NO. 4	✓										9.0 litres	V.I.P Fire	Foam
5	Store in Plant room NO. 5	✓										FA-10 lbs	Fire Ade	Foam
6	Store in Plant room NO. 6	✓										FA-10 lbs	Fire Ade	Foam
7	Store in Plant room NO. 7	✓	✓									10C (CO2 10 lbs.)	V.I.P Fire	
8	Store in Plant room NO. 8	✓					✓					6.8 KGS.(ST-15 lbs.)	SATURN	
9	Store in Plant room NO. 9	✓					✓					6.8 KGS.(ST-15 lbs.)	SATURN	

10	Store in Plant room NO. 11	✓					✓				15 v.(VIP-15 lb)	V.I.P Fire	15 lb.
11	Store in Plant room NO. 12	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
12	Store in Plant room NO. 13	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
13	Store in Plant room NO. 14	✓					✓				NF-15 D	NOFIRE	
14	Store in Plant room NO. 15	✓					✓				15 AG	Angel	
15	Store in Plant room NO. 16	✓					✓				CN-15	C-NON Fire	
		15	1	0	3	0	8	0	0	0			

Emergency Light and Exit Signage Checklist (Angsana)

Checked on Date: 02 January 2024

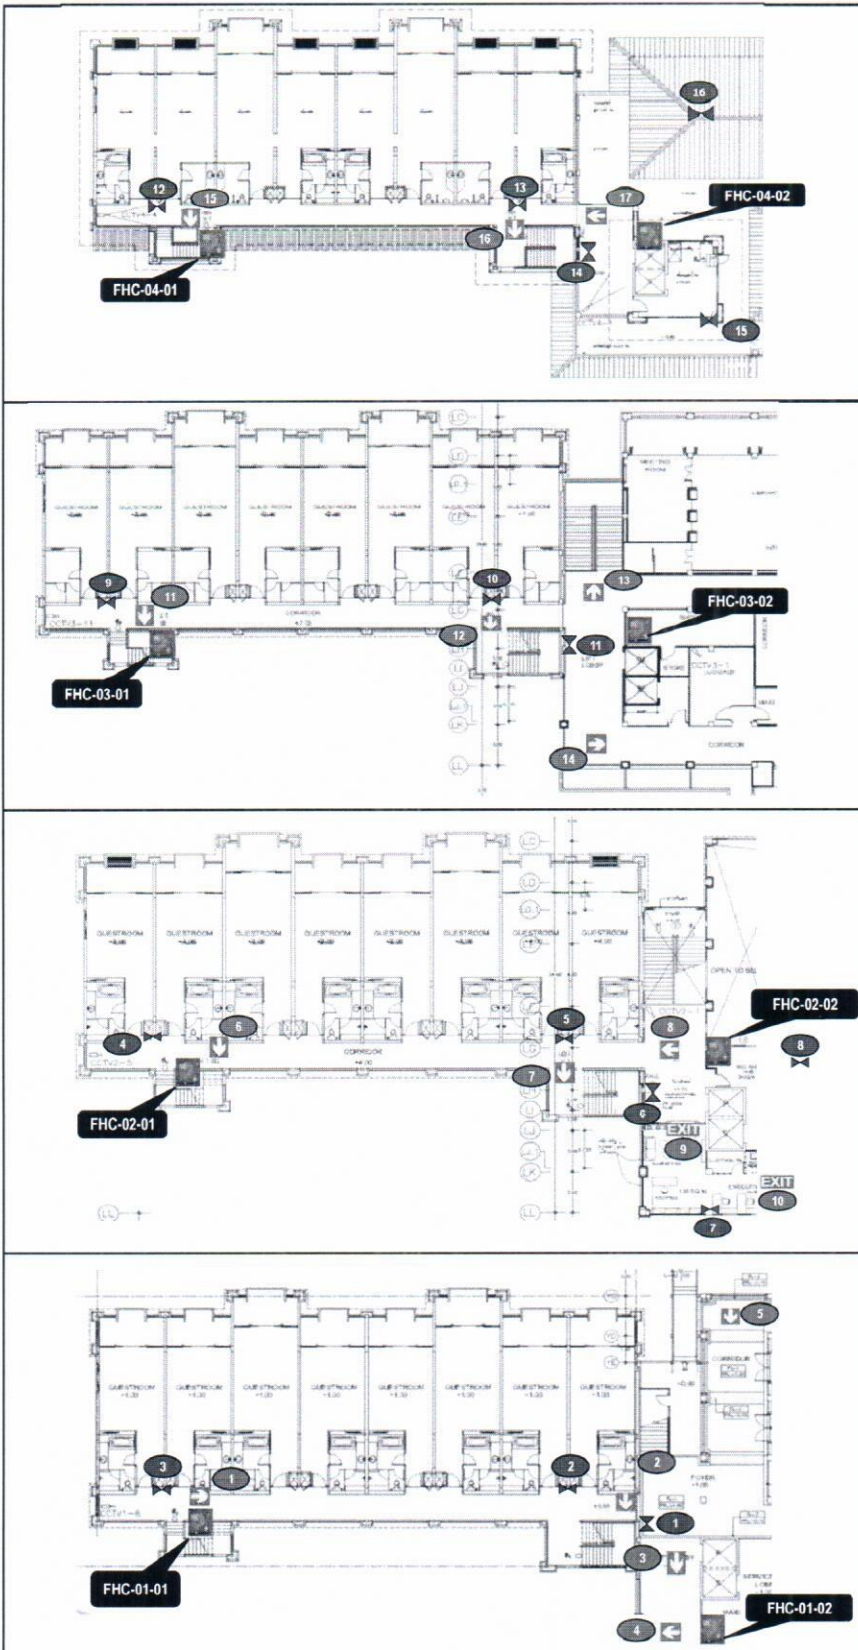

Angsana 4th floor				
No.	Exit Signage	Yes	No	Remark
15		✓		
16		✓		
17		✓		
No.	Emergency Light	Yes	No	Remark
12		✓		
13		✓		
14		✓		
15		✓		
16			✓	


Angsana 3rd floor				
No.	Exit Signage	Yes	No	Remark
11		✓		
12		✓		
13		✓		
14		✓		
No.	Emergency Light	Yes	No	Remark
9		✓		
10		✓		
11			X	Out of order

Angsana 2nd floor				
No.	Exit Signage	Yes	No	Remark
6		✓		
7		✓		
8		✓		
9		✓		
10		✓		
No.	Emergency Light	Yes	No	Remark
4		✓		
5		✓		
6		✓		
7		✓		
8		✓		


Angsana 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
No.	Emergency Light	Yes	No	Remark
1			X	Out of order
2		✓		
3		✓		

Emergency Light and Exit Signage Checklist (Bamboo)


Checked on Date: 02 January 2024

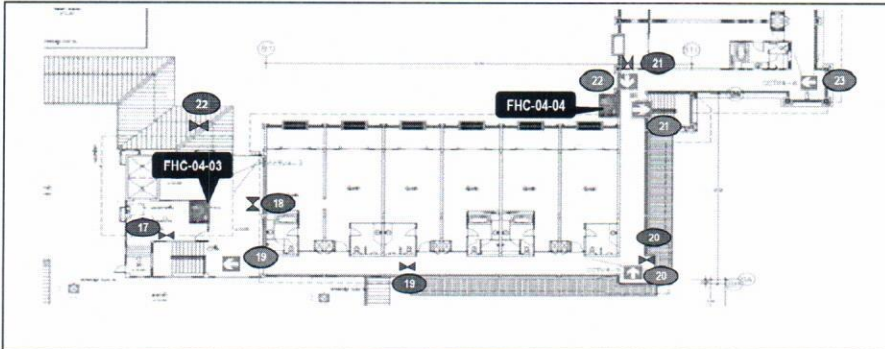


Bamboo 4th floor				
No.	Exit Signage	Yes	No	Remark
19		✓		
20			X	out of order
21		✓		
22		✓		
23		✓		
No.	Emergency Light	Yes	No	Remark
17		✓		
18		✓		
19		✓		
20		✓		
21		✓		
22			✓	

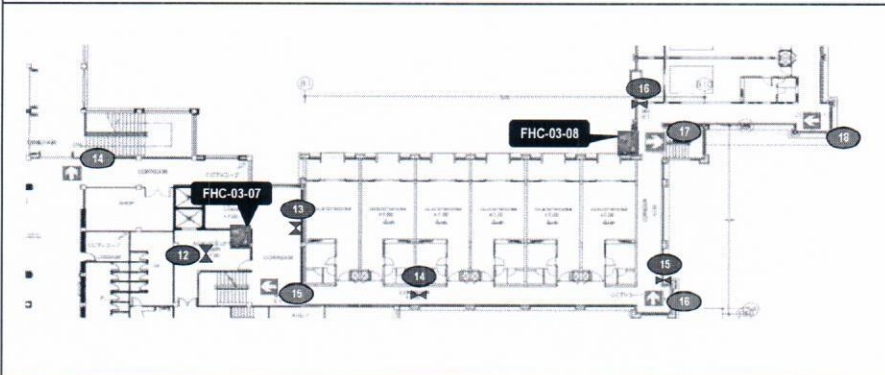

Bamboo 3rd floor				
No.	Exit Signage	Yes	No	Remark
14		✓		
15		✓		
16		✓		
17		✓		
18		✓		
No.	Emergency Light	Yes	No	Remark
12		✓		
13		✓		
14		✓		
15		✓		
16		✓		

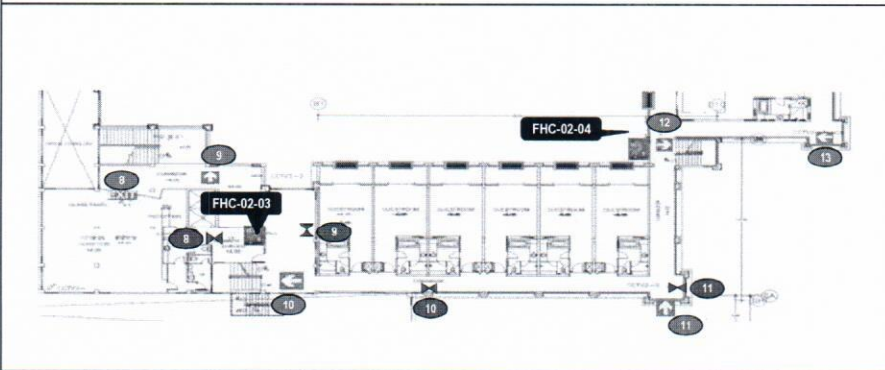


Bamboo 2nd floor				
No.	Exit Signage	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11		✓		
12		✓		
13		✓		
No.	Emergency Light	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11		✓		

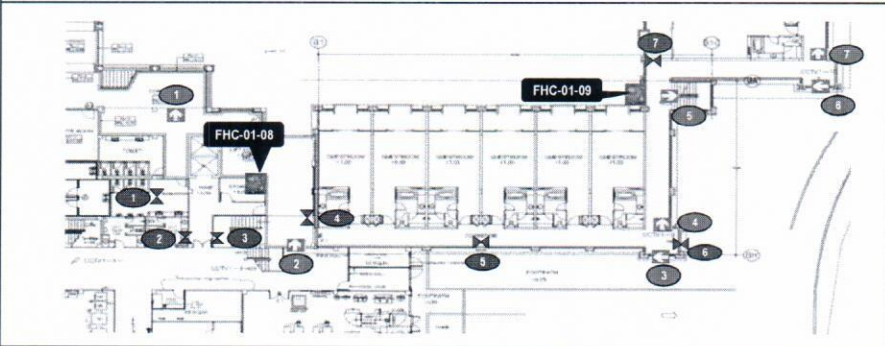


Bamboo 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
6		✓		
7		✓		
No.	Emergency Light	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4			X	out of order
5		✓		
6		✓		
7			X	out of order

Emergency Light and Exit Signage Checklist (Champa and Dalar)


Checked on Date: 02 January 2024

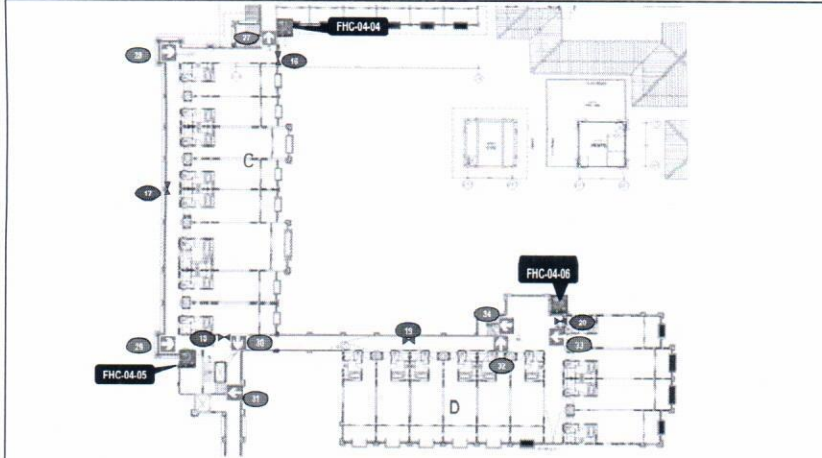


Champa and Dalar 4th floor				
No.	Exit Signage	Yes	No	Remark
27	EXIT	✓		
28	EXIT	✓		
29	EXIT	✓		
30	EXIT	✓		
31	EXIT	✓		
32	EXIT	✓		
33	EXIT	✓		
34	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
16	EXIT	✓		
17	EXIT	✓		
18	EXIT		X	out of order
19	EXIT	✓		
20	EXIT	✓		

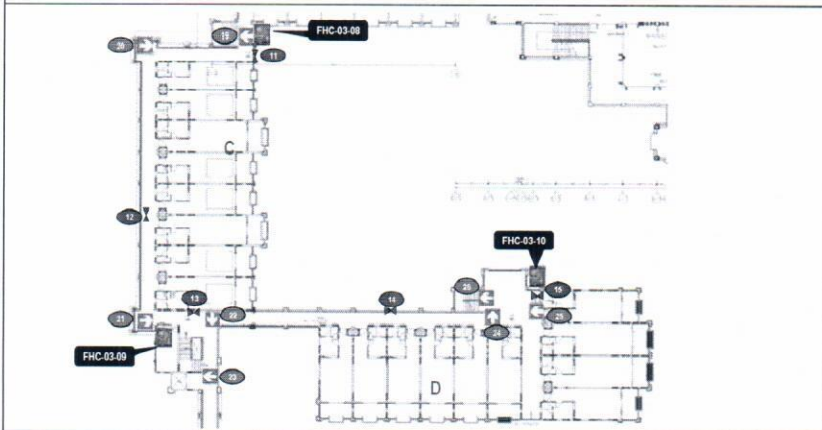

Champa and Dalar 3rd floor				
No.	Exit Signage	Yes	No	Remark
19	EXIT	✓		
20	EXIT	✓		
21	EXIT	✓		
22	EXIT	✓		
23	EXIT	✓		
24	EXIT	✓		
25	EXIT	✓		
26	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
11	EXIT	✓		
12	EXIT	✓		
13	EXIT	✓		
14	EXIT	✓		
15	EXIT		X	out of order

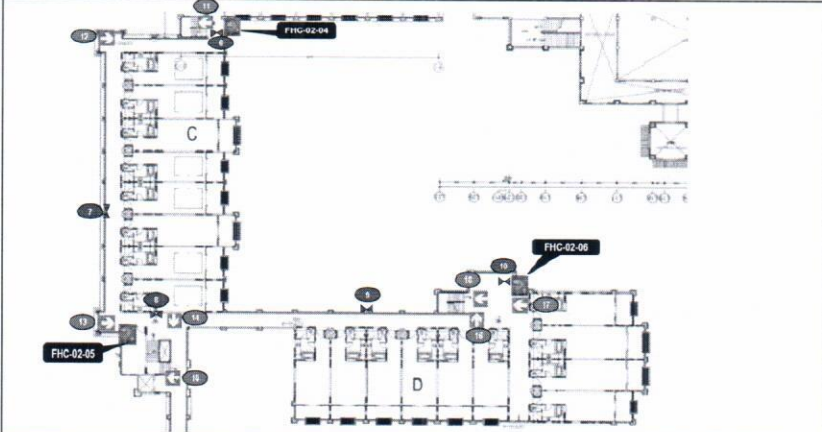


Champa and Dalar 2nd floor				
No.	Exit Signage	Yes	No	Remark
11	EXIT	✓		
12	EXIT	✓		
13	EXIT	✓		
14	EXIT	✓		
15	EXIT	✓		
16	EXIT	✓		
17	EXIT	✓		
18	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
6	EXIT	✓		
7	EXIT	✓		
8	EXIT	✓		
9	EXIT		X	out of order
10	EXIT		X	out of order

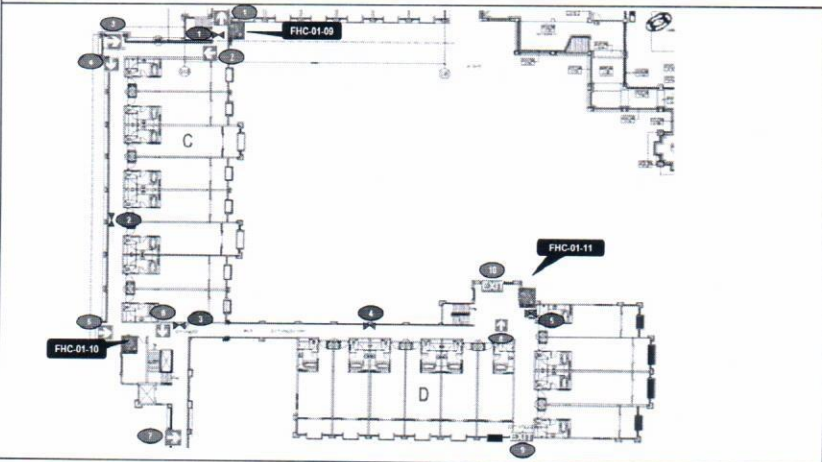

Champa and Dalar 1st floor				
No.	Exit Signage	Yes	No	Remark
1	EXIT	✓		
2	EXIT	✓		
3	EXIT	✓		
4	EXIT	✓		
5	EXIT	✓		
6	EXIT	✓		
7	EXIT	✓		
8	EXIT	✓		
9	EXIT	✓		
10	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
1	EXIT	✓		
2	EXIT		X	out of order
3	EXIT	✓		
4	EXIT	✓		
5	EXIT	✓		

Emergency Light and Exit Signage Checklist Utopia Room & Toilet Utopia FL.2

Checked On Date: 02 January 2024

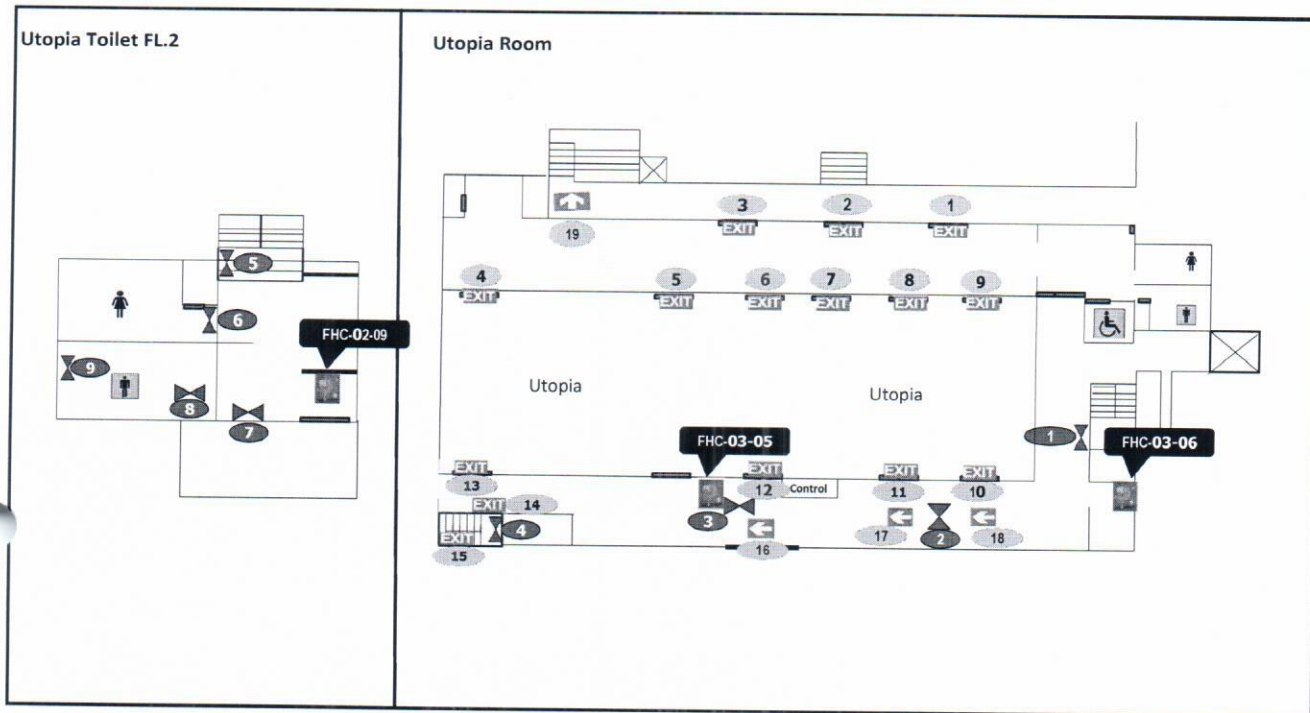


ป้ายหนีไฟ	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1 EXIT	Glass Door Utopia Rm. Point 1		x	REMOVED
2 EXIT	Glass Door Utopia Rm. Point 2	✓		
3 EXIT	Glass Door Utopia Rm. Point 3	✓		
4 EXIT	In Utopia Rm.	✓		
5 EXIT	In Utopia Rm.	✓		
6 EXIT	In Utopia Rm.	✓		
7 EXIT	In Utopia Rm.	✓		
8 EXIT	In Utopia Rm.	✓		
9 EXIT	In Utopia Rm.	✓		
10 EXIT	In Utopia Rm.	✓		
11 EXIT	In Utopia Rm.	✓		
12 EXIT	In Utopia Rm.	✓		
13 EXIT	In Utopia Rm.	✓		
14 EXIT	Stair down fire exit		x	out of order
15 EXIT	Stair up fire exit		x	out of order
16 ←	Building of Utopia		x	REMOVED
17 ←	Building of Utopia		x	REMOVED
18 ←	Building of Utopia		x	REMOVED
19 ←	Front of Utopia		x	REMOVED

ไฟฉุกเฉิน	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	Building of Utopia		x	REMOVED
2	Back of Utopia Rm.		x	REMOVED
3	Back of Utopia Rm.		x	REMOVED
4	Stair exit building Utopia Rm.		x	REMOVED
5	Stair JAMJUREE FL.2	✓		
6	Female toilet of Utopia FL.2	✓		
7	Male toilet of Utopia FL.2	✓		
8	In female toilet of Utopia FL.2		x	REMOVED
8	In male toilet of Utopia FL.2		x	REMOVED
9	Utopia Fire Escape		x	out of order

Emergency Light and Exit Signage Checklist (Lobby)

Checked on Date: 02 January 2024

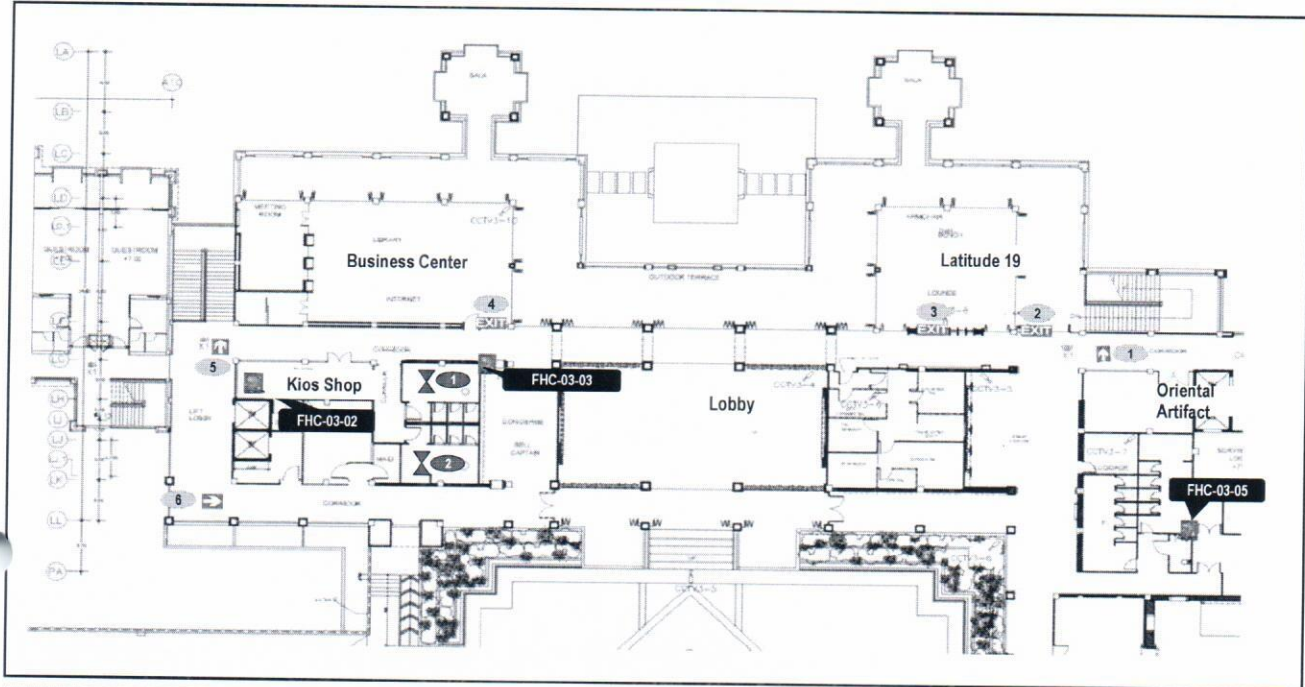


Exit Signage	Location	Status		Remark
		Yes	No	
1	Latitude 19 Stair	✓		
2	Latitude 19 Exit 1	✓		
3	Latitude 19 Exit 2	✓		
4	Library Exit	✓		
5	Kios Stair	✓		
6	Conner Corridor Concierge	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Guest Toilet (Female)	✓		
2	Guest toilet (Male)	✓		



Emergency Light and Exit Signage Checklist (Carpark and Engineer Office)

Checked on Date: 02 January 2024

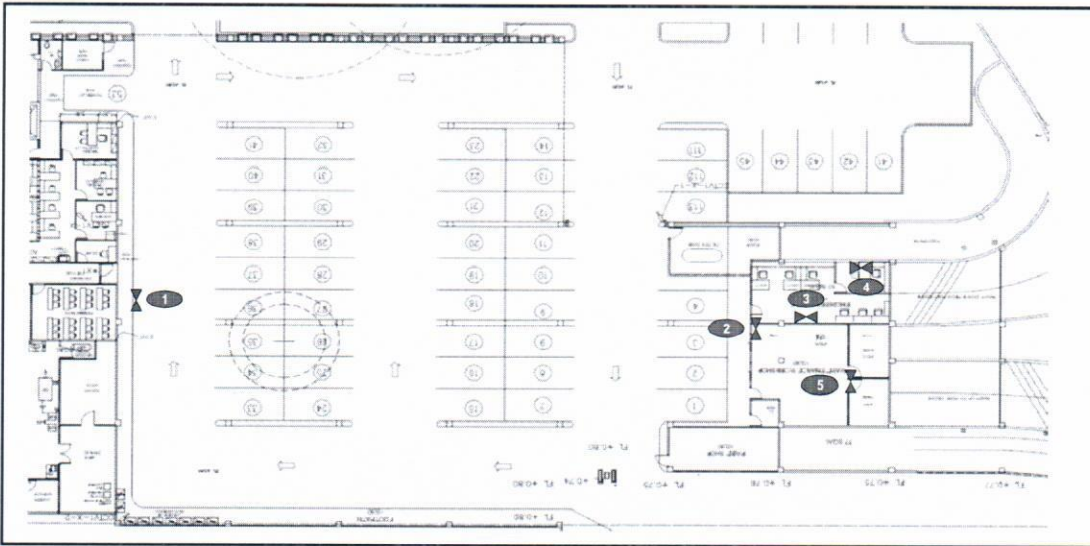


Exit Signage	Location	Status		Remark
		Yes	No	
1	Emergency Exit door		X	out of order
2	In front of Eng Office		X	out of order
3	Engineering Office		X	out of order
4	Chief Engineering office		X	out of order
5	Maintenance Shop		X	out of order



Emergency Light and Exit Signage Checklist (Favola Restaurant)

Checked on Date: 02 January 2024

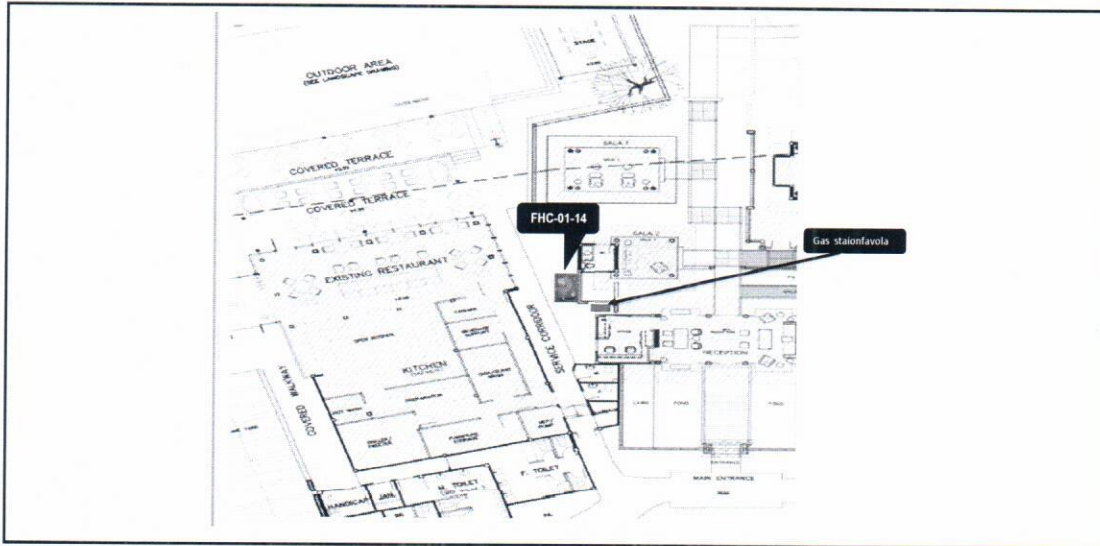

Inside Fire Host Cabinet				
Hose Rack 30	Nozzle	Hydrant Valve 2.5	Extinguisher	Axe





Summary Fire Equipment Report

Month: 05 February 2024

Extinguisher Tank	Location				Total
	B.O.H.	F.H.C.	Fire Cart	Spare Tank	
1. CO2	26	6	1	0	33
2. Halotron	8	0	0	1	9
3. Dry Chemical	0	38	3	7	48
4. Wet Chemical	3	0	0	0	3
5. Form	3	0	0	0	3
Total	40	44	4	8	96

Remark: Spare tank have kept in store inside Security Store room and fire cart has set nearby Store Keeper.

Back of the House (B.O.H)			
Type of tank	Quantity	Status	
		Yes	No
1. CO2	26	26	0
2. Halotron	8	8	0
3. Wet Chemical	3	4	0
4. Form	3	3	0
Total	40	41	0

Fire Hose Cabinet (F.H.C.)			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	38	38	0
2 CO2	6	6	0
Total	44	44	0

Fire Cart			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	3	3	0
2 CO2	1	1	0
Total	4	4	0

Spare Store			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	13	13	0
2. Halotron	4	4	0
Total	17	17	0

Other Equipment	Quantity	Status	
		Yes	No
1. Fire Blanket	5	5	0
2. Clothing Protect Heat	3	3	0
Total	8	8	0

Remark: The Clothing Protect Heat are kept in Hanger Cabinet nearby Fire Cart.

Other Emergency light / Signage	Status	Location										Total
		A	B	C-D	E	HR	BOH	UTOPIA	MK	LOBBY	ENG	
1. Emergency light	ALL	15	21	20	12	5	27	10	18	2	5	135
	YES	15	19	14	6	2	11	3	6	2	0	78
	NO	1	2	6	6	1	13	1	9	0	5	44
	Remove	0	0	0	0	1	3	6	3	0	1	14
2. Exit signage	ALL	2	1	2	0	0	7	15	6	3	0	36
	YES	2	1	2	0	0	7	15	6	3	0	36
	NO	0	0	0	0	0	1	0	0	0	0	1
3. Arrow point signage	ALL	15	22	32	4	1	2	4	4	3	0	87
	YES	14	22	30	4	1	2	3	3	3	0	82
	NO	1	0	2	0	0	2	1	1	0	0	7

Fire Hose Cabinet Checklist

Checked on Date: 5 February 2024

No.	Floor	Register No.	Location	Hose Rack 30 M. 1.5 Inc	Inside Fire Host Cabinet				Model	Manufacture	Remark
					Nozzle	Hydrant Valve 2.5	Extinguisher				
							Tag	Yes	No		
1st Floor											
1	1	FHC 01-01	Corridor A in front of room 1102						6.8 KGS.(ST-15 lbs.)	SATURN	
2	1	FHC 01-02	Corridor A beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
3	1	FHC 01-03	Back of Cham Cha room(CO2)						10 C	V.I.P Fire	
4	1	FHC 01-04	Inside Latest Recipe (CO2)						10 lbs.	Best	
5	1	FHC 01-05	Near Main Kitchen door						10V (VIP-10lbs.)	V.I.P Fire	
6	1	FHC 01-06	Beside Chief Steward Office						6.8 KGS.(ST-15 lbs.)	SATURN	
7	1	FHC 01-07	In front of staff canteen						6.8 KGS.(15lbs.)	Brake Fire	
8	1	FHC 01-08	Corridor B beside guest elevator (Latest Recipe)						6.8 KGS.(ST-15 lbs.)	SATURN	
9	1	FHC 01-09	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
10	1	FHC 01-10	Building C in front of pantry room						CN-15	C-NON Fire	
11	1	FHC 01-11	Building D near guest room 4101						FM-15 lbs. 6.8 KGS.	Fire Man Rescue	
12	1	FHC 01-12	Building E near guest room 5103						10 lbs.(5 KGS.) 4A:2B	WILL	
13	1	FHC 01-13	Building E near guest room 5107						10 lbs.(5 KGS.) 4A:2B	WILL	
14	1	FHC 01-14	Favola						6.8 KGS.(ST-15 lbs.)	SATURN	☑Axe
15	1	FHC 01-15	Spa						6.8 KGS.(ST-15 lbs.)	SATURN	☑Axe
2nd Floor											
16	2	FHC 02-01	Corridor A in front of guest room 1202						6.8 KGS.(ST-15 lbs.)	SATURN	
17	2	FHC 02-02	Corridor A in front of Executive office						6.8 KGS.(ST-15 lbs.)	SATURN	
18	2	FHC 02-03	Corridor B beside guest elevator (near fitness)						6.8 KGS.(ST-15 lbs.)	SATURN	
19	2	FHC 02-04	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
20	2	FHC 02-05	Building C corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN	
21	2	FHC 02-06	Building D near guest room 4201						CN-15	C-NON Fire	
22	2	FHC 02-07	Building E near guest room 5203						10 lbs.(5 KGS.) 4A:2B	WILL	
23	2	FHC 02-08	Building E near guest room 5207						10 lbs.(5 KGS.) 4A:2B	WILL	
24	2	FHC 02-09	Toilet Utopia Fl.2(CO2)						10 lbs.	Best	
3rd Floor											
25	3	FHC 03-01	Corridor in front of guest room 1302						6.8 KGS.(ST-15 lbs.)	SATURN	
26	3	FHC 03-02	Corridor A near Kiosk shop						6.8 KGS.(ST-15 lbs.)	SATURN	
27	3	FHC 03-03	In front of Business Center						6.8 KGS.(ST-15 lbs.)	SATURN	
28	3	FHC 03-04	In front of Lobby Latitude 19 (Dry Chemical)						6.8 KGS.(ST-15 lbs.)	SATURN	
			In front of Lobby Latitude 19 (CO ₂)						10 lbs.	EXTRA	
29.1	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	BEST	
29.2	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	EXTRA	
29.3	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	EXTRA	
30.1	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	BEST	
30.2	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	EXTRA	
30.3	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	EXTRA	
31	3	FHC 03-07	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
32	3	FHC 03-08	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
33	3	FHC 03-09	Corridor Building C front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN	
34	3	FHC 03-10	Building D near guest room 4301						6.8 KGS.(ST-15 lbs.)	SATURN	
35	3	FHC 03-11	Building E near guest room 5303						10 lbs.(5 KGS.) 4A:2B	WILL	
36	3	FHC 03-12	Building E near guest room 5307						10 lbs.(5 KGS.) 4A:2B	WILL	
4th Floor											
37	4	FHC 04-01	Corridor A in front of guest room 1402						6.8 KGS.(ST-15 lbs.)	SATURN	
38	4	FHC 04-02	Corridor A near guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
39	4	FHC 04-03	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
40	4	FHC 04-04	Building B near stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
41	4	FHC 04-05	Building C Corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN	
42	4	FHC 04-06	Building D near guest room 4401						6.8 KGS.(ST-15 lbs.)	SATURN	
43	4	FHC 04-07	Building E near guest room 5403						10 lbs.(5 KGS.) 4A:2B	WILL	
44	4	FHC 04-08	Building E near guest room 5407						10C (CO2 10 lbs.)	V.I.P Fire	

Summary : The total of 44 fire host cabinets.

Parameter	Total (Location)	Status		Remark
		Normal	Abnormal	
Hose Rack 30 m. 1.5 inc.	44	44	0	
Nozzle	44	44	0	
Hydrant Valve 2.5	44	44	0	
Dry Chemical Extinguisher	38	38	0	
CO2 Extinguisher	6	6	0	
The Fire hose cabinet door closer	44	44	0	

Fire Extinguisher (Hanged Alone) Checklist

Checked on Date : 05 February 2024

No.	Floor	Locations	TAG	CO2 10lb		Halotron 10 lb		Dry chemical 10 lb		WetChemical 10lb		Model	Manufacturer	Fire Blanket	Remark
				Yes	No	Yes	No	Yes	No	Yes	No				
1	G	Receiving Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
2	G	in front of Canteen room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
3	G	Accounting Office 1				✓						NON-CFC (10N)	V.I.P Fire		
4	G	Accounting Office 2				✓						NON-CFC (10N)	V.I.P Fire		
5	G	Laundry Room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
6	G	Laundry Room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
7	G	Laundry Room 3 (Store Laundry)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
8	G	Generator room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
9	G	MDB Room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
10	G	Plant room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
11	G	Plant room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
12	G	Plant room 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
13	G	Plant room 4		✓								10C (CO2 10 lbs.)	V.I.P Fire		
14	G	F&B in Pantry room behind Latest Recipe		✓								10C (CO2 10 lbs.)	V.I.P Fire		
15	G	F&B in front of butcher room								✓		Pro Plus 100K 2005	Kidde		
16	G	F&B in front of Fruit room								✓		Pro Plus 100K 2005	Kidde		
17	G	F&B in front of Bakery room								✓		Pro Plus 100K 2005	Kidde		
18	G	F&B inside Bakery room								✓		Pro Plus 100K 2005	Kidde		
19	G	Engineering Office 1				✓						NON-CFC (10N)	V.I.P Fire		
20	G	Engineering Office 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
21	G	Maintenance work shop 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
22	G	Maintenance work shop 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
23	G	Maintenance work shop 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
24	G	FAVOLA Steward Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
25	G	FAVOLA Kitchen								✓		K01-3	K-Guard		
26	G	SPA Manager room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
27	G	Treatment room 1 (Parvati)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
28	G	Treatment room 2 (Leelawadee)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
29	G	Treatment room 3 (Ratree)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
30	G	Treatment room 4 (Chuanchom)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
31	G	Associate & Store room of SPA		✓								10C (CO2 10 lbs.)	V.I.P Fire		
32	G	EV Charger		✓								10C (CO2 10 lbs.)	V.I.P Fire		
33	2	HR Office				✓						NON-CFC (10N)	V.I.P Fire		
34	2	Executive Office 1				✓						NON-CFC (10N)	V.I.P Fire		
35	2	Executive Office 2				✓						NON-CFC (10N)	V.I.P Fire		
36	3	Front Office Department 1				✓						NON-CFC (10N)	V.I.P Fire		
37	3	Front Office Department 2				✓						NON-CFC (10N)	V.I.P Fire		
38	3	Lift service room Angsana		✓								10C (CO2 10 lbs.)	V.I.P Fire		
39	4	Elevator A						✓				10 C	Best		
40	4	Elevator B						✓				10 C	Best		
41	4	Elevator CDE						✓				10 C	Best		
42	G	India Kitchen								✓		Pro Plus 100K 2005	Kidde		
43	G	Gas Station 1						✓				15 lbs (6.9 KG.)	Imperial		
44	G	Gas Station 2						✓				15 lbs (6.9 KG.)	Imperial		
45	G	Gas Station Favola						✓				15 lbs (6.9 KG.)	Imperial		
Total (Tanks)				0	25	0	8	0	6	0	5	0			1

Fire Cart Check List

No.	Description	TAG	Result		Remark	Model	Manufacturer
			Normal	Disable			
1	Extinguisher Dry Chemical (10 Lbs.) No.1	✓	✓			CN-15	C-NON Fire
2	Extinguisher Dry Chemical (10 Lbs.) No.2	✓	✓			CN-15	C-NON Fire
3	Extinguisher Dry Chemical (10 Lbs.) No.3	✓	✓			TF-15	Top Fire
4	Extinguisher CO2 No.4	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
5	Extinguisher CO2 No.5	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
6	Rope		✓		1 rope		
7	Hydrant 2.5 " set		✓		1 set		
8	Axe		✓		1		
9	Fire fighting Suite		✓		3 set		

Spare Tanks (Store in LP Store Room)


NO.	Location	Fire Extinguisher Spare (Tank)								Model	Manufacturer	Remark	
		TAG	CO2 10lb		Halotron 10lb		Dry Chemical 10lb		Wet Chemical 10lb				
			Yes	No	Yes	No	Yes	No	Yes				No
1	Store in Plant room NO. 1	✓			✓						Non CFC (10N)	V.I.P Fire	
2	Store in Plant room NO. 2	✓			✓						10 lbs.	Number 1 Fire	
3	Store in Plant room NO. 3	✓			✓						10 lbs.	Number 1 Fire	
4	Store in Plant room NO. 4	✓									9.0 litres	V.I.P Fire	Foam
5	Store in Plant room NO. 5	✓									FA-10 lbs	Fire Ade	Foam
6	Store in Plant room NO. 6	✓									FA-10 lbs	Fire Ade	Foam
7	Store in Plant room NO. 7	✓	✓								10C (CO2 10 lbs.)	V.I.P Fire	
8	Store in Plant room NO. 8	✓					✓				6.8 KGS.(ST-15 lbs.)	SATURN	
9	Store in Plant room NO. 9	✓					✓				6.8 KGS.(ST-15 lbs.)	SATURN	

10	Store in Plant room NO. 11	✓					✓				15 v.(VIP-15 lb)	V.I.P Fire	15 lb.
11	Store in Plant room NO. 12	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
12	Store in Plant room NO. 13	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
13	Store in Plant room NO. 14	✓					✓				NF-15 D	NOFIRE	
14	Store in Plant room NO. 15	✓					✓				15 AG	Angel	
15	Store in Plant room NO. 16	✓					✓				CN-15	C-NON Fire	
		13	1	0	3	0	8	0	0	0			



Emergency Light and Exit Signage Checklist (Angsana)

Checked on Date: 05 February 2024

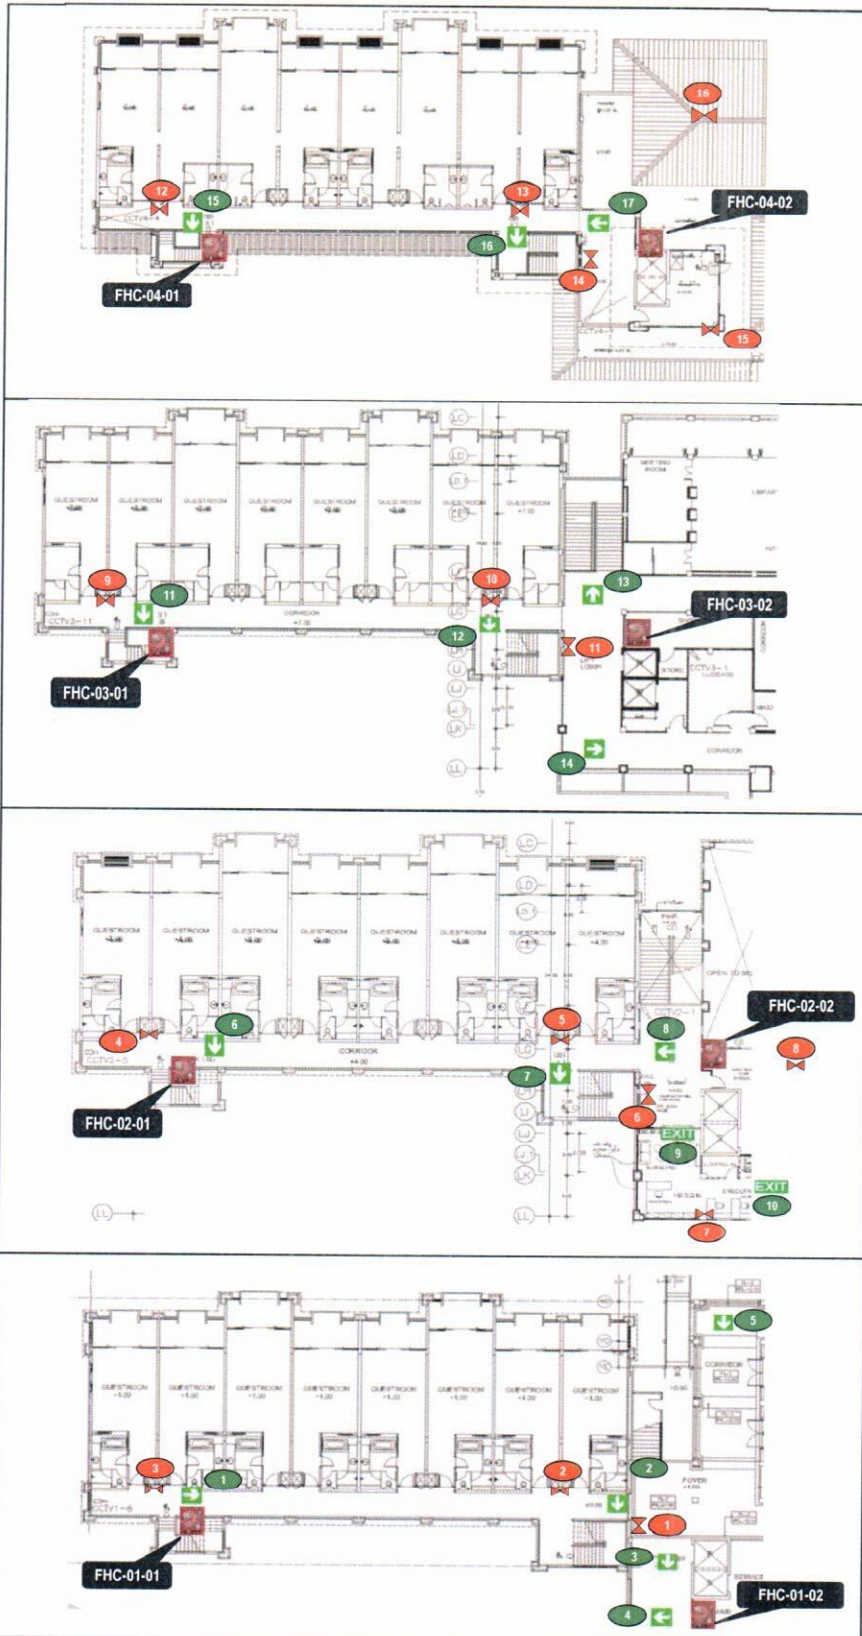

Angsana 4th floor				
No.	Exit Signage	Yes	No	Remark
15		✓		
16		✓		
17		✓		
No.	Emergency Light	Yes	No	Remark
12		✓		
13		✓		
14		✓		
15		✓		
16		✓		


Angsana 3rd floor				
No.	Exit Signage	Yes	No	Remark
11		✓		
12		✓		
13		✓		
14		✓		
No.	Emergency Light	Yes	No	Remark
9		✓		
10		✓		
11			X	Out of order

Angsana 2nd floor				
No.	Exit Signage	Yes	No	Remark
6		✓		
7		✓		
8		✓		
9		✓		
10		✓		
No.	Emergency Light	Yes	No	Remark
4		✓		
5		✓		
6		✓		
7		✓		
8		✓		


Angsana 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
No.	Emergency Light	Yes	No	Remark
1			X	Out of order
2		✓		
3		✓		

Emergency Light and Exit Signage Checklist (Bamboo)


Checked on Date: 05 February 2024

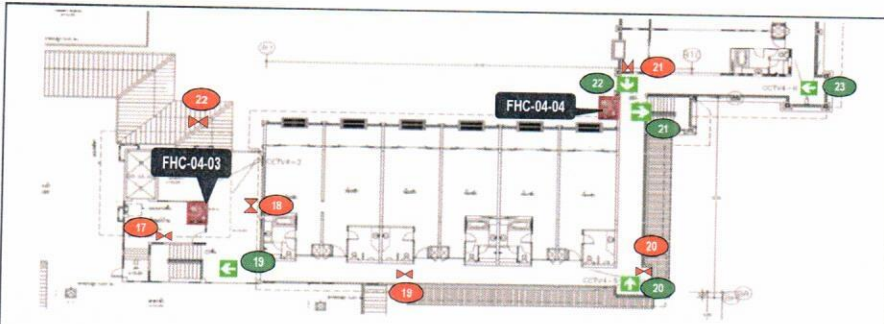


Bamboo 4th floor				
No.	Exit Signage	Yes	No	Remark
19		✓		
20			X	out of order
21		✓		
22		✓		
23		✓		
No.	Emergency Light	Yes	No	Remark
17		✓		
18		✓		
19		✓		
20		✓		
21		✓		
22			✓	

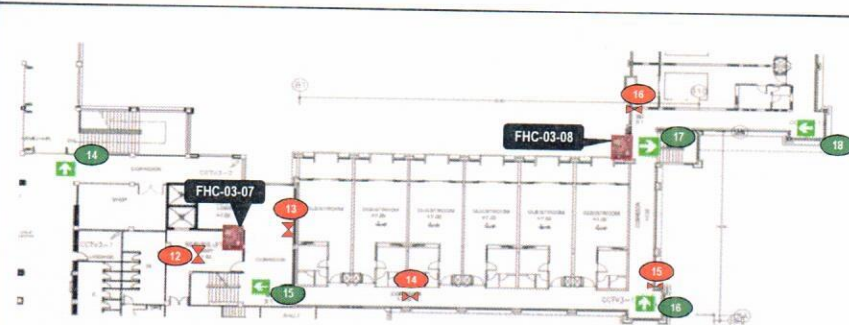


Bamboo 3rd floor				
No.	Exit Signage	Yes	No	Remark
14		✓		
15		✓		
16		✓		
17		✓		
18		✓		
No.	Emergency Light	Yes	No	Remark
12		✓		
13		✓		
14		✓		
15		✓		
16		✓		

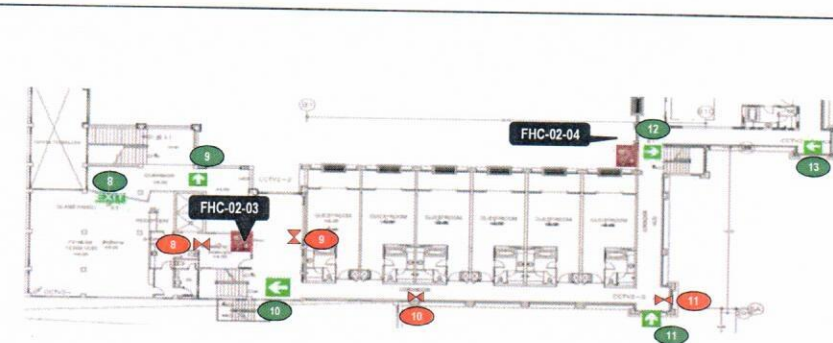

Bamboo 2nd floor				
No.	Exit Signage	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11		✓		
12		✓		
13		✓		
No.	Emergency Light	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11		✓		

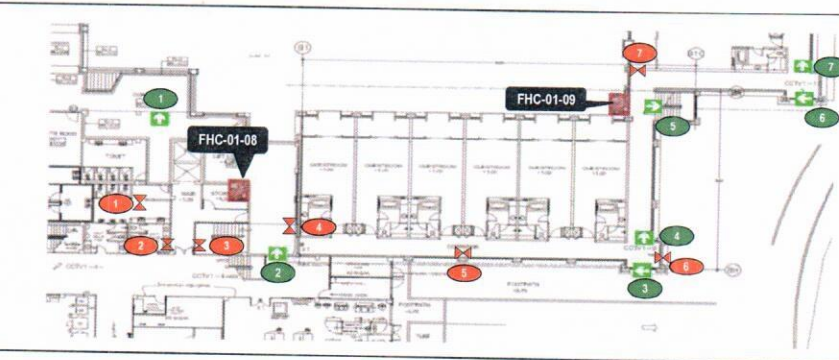

Bamboo 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
6		✓		
7		✓		
No.	Emergency Light	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4			X	out of order
5		✓		
6		✓		
7			X	out of order

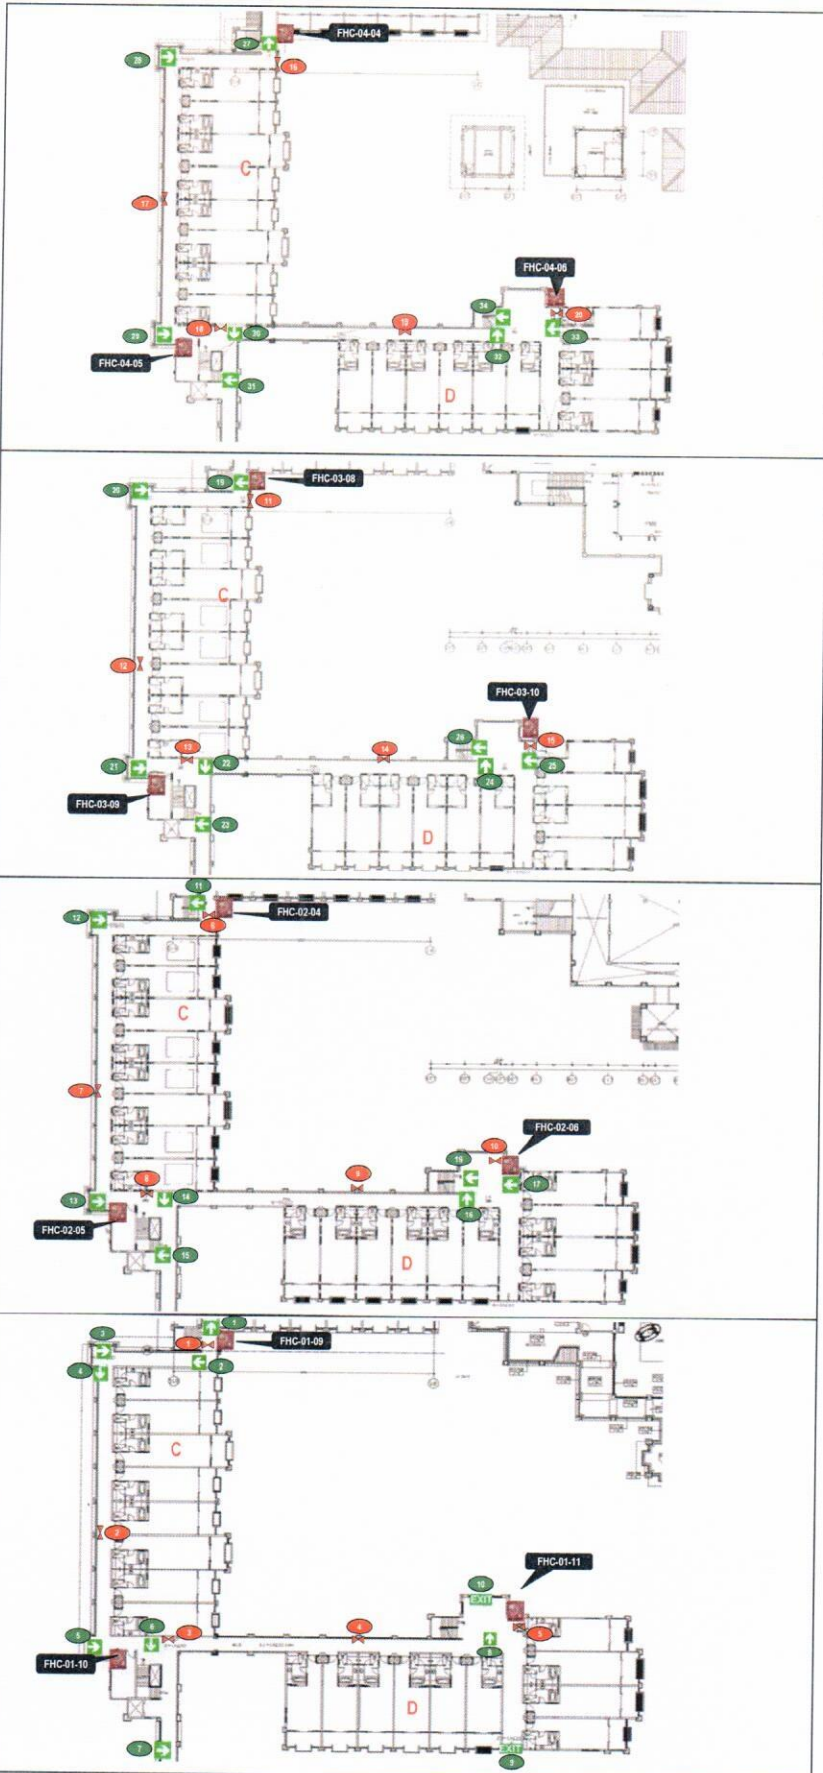


Champa and Dalar 4th floor				
No.	Exit Signage	Yes	No	Remark
27	✓	✓		
28	✓	✓		
29	✓	✓		
30	✓	✓		
31	✓	✓		
32	✓	✓		
33	✓	✓		
34	✓	✓		
No.	Emergency Light	Yes	No	Remark
16	✗	✓		
17	✗	✓		
18	✗	✗	✗	out of order
19	✗	✓		
20	✗	✓		

Champa and Dalar 3rd floor				
No.	Exit Signage	Yes	No	Remark
19	✓	✓		
20	✓	✓		
21	✓	✓		
22	✓	✓		
23	✓	✓		
24	✓	✓		
25	✓	✓		
26	✓	✓		
No.	Emergency Light	Yes	No	Remark
11	✗	✓		
12	✗	✓		
13	✗	✓		
14	✗	✓		
15	✗	✗	✗	out of order

Champa and Dalar 2nd floor				
No.	Exit Signage	Yes	No	Remark
11	✓	✓		
12	✓	✓		
13	✓	✓		
14	✓	✓		
15	✓	✓		
16	✓	✓		
17	✓	✓		
18	✓	✓		
No.	Emergency Light	Yes	No	Remark
6	✗	✓		
7	✗	✓		
8	✗	✓		
9	✗	✗	✗	out of order
10	✗	✗	✗	out of order

Champa and Dalar 1st floor				
No.	Exit Signage	Yes	No	Remark
1	✓	✓		
2	✓	✓		
3	✓	✓		
4	✓	✓		
5	✓	✓		
6	✓	✓		
7	✓	✓		
8	✓	✓		
9	EXIT	✓		
10	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
1	✗	✓		
2	✗	✗	✗	out of order
3	✗	✓		
4	✗	✓		
5	✗	✓		

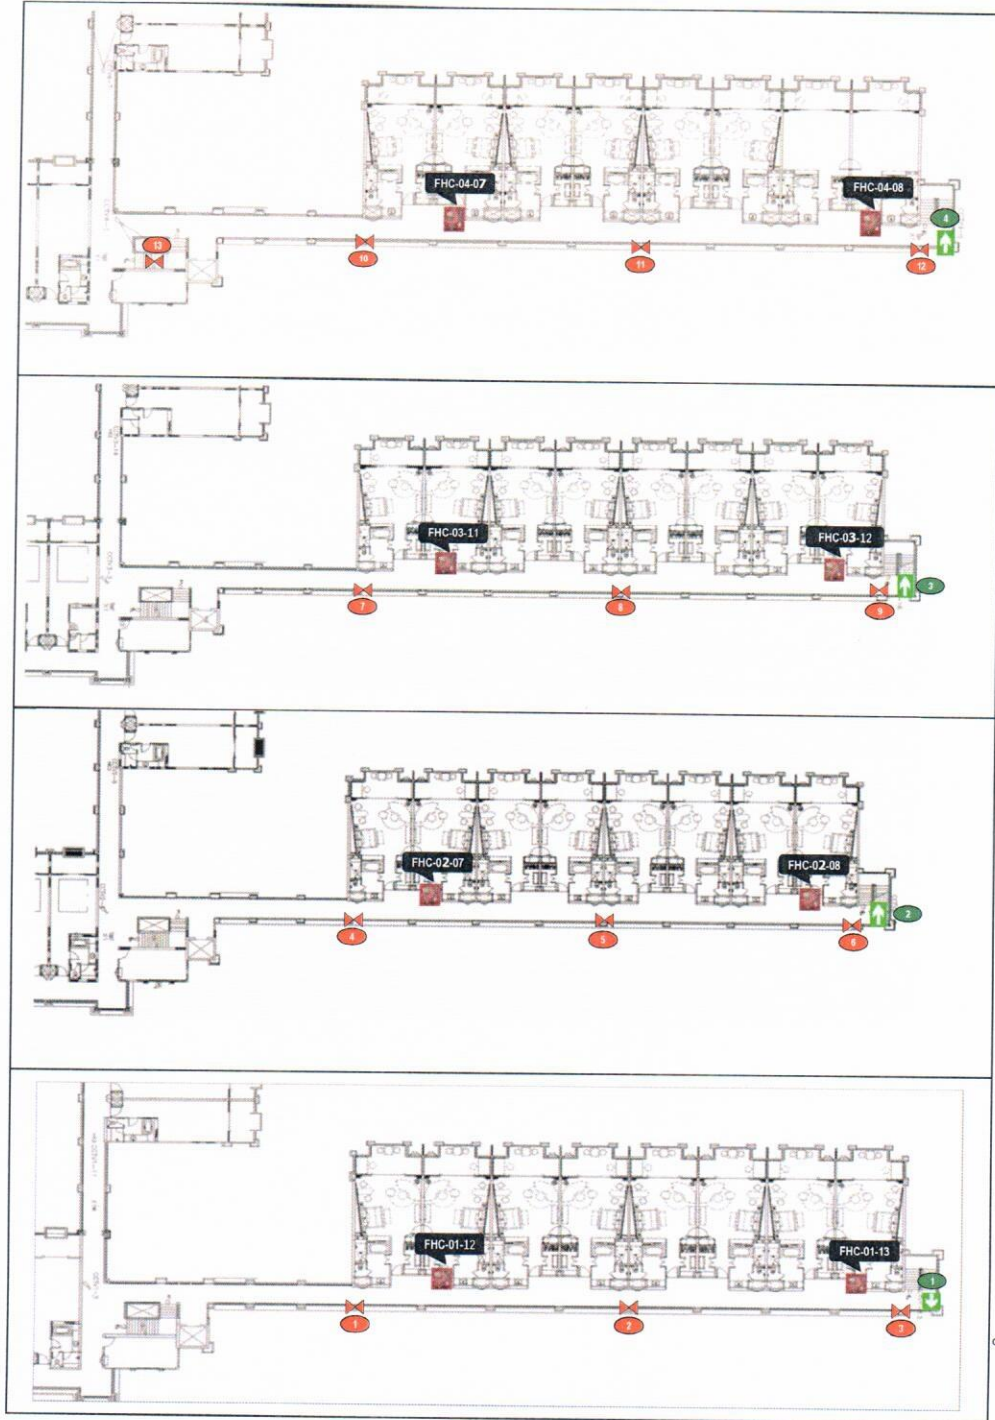

Eucalyptus 4th floor				
No.	Exit Signage	Yes	No	Remark
4		✓		
No.	Emergency Light	Yes	No	Remark
10			X	out of order
11		✓		
12				
13			X	out of order


Eucalyptus 3rd floor				
No.	Exit Signage	Yes	No	Remark
3		✓		
No.	Emergency Light	Yes	No	Remark
7		✓		
8		✓		
9			X	out of order







Eucalyptus 2nd floor				
No.	Exit Signage	Yes	No	Remark
2		✓		
No.	Emergency Light	Yes	No	Remark
4		✓		
5		✓		
6		✓		

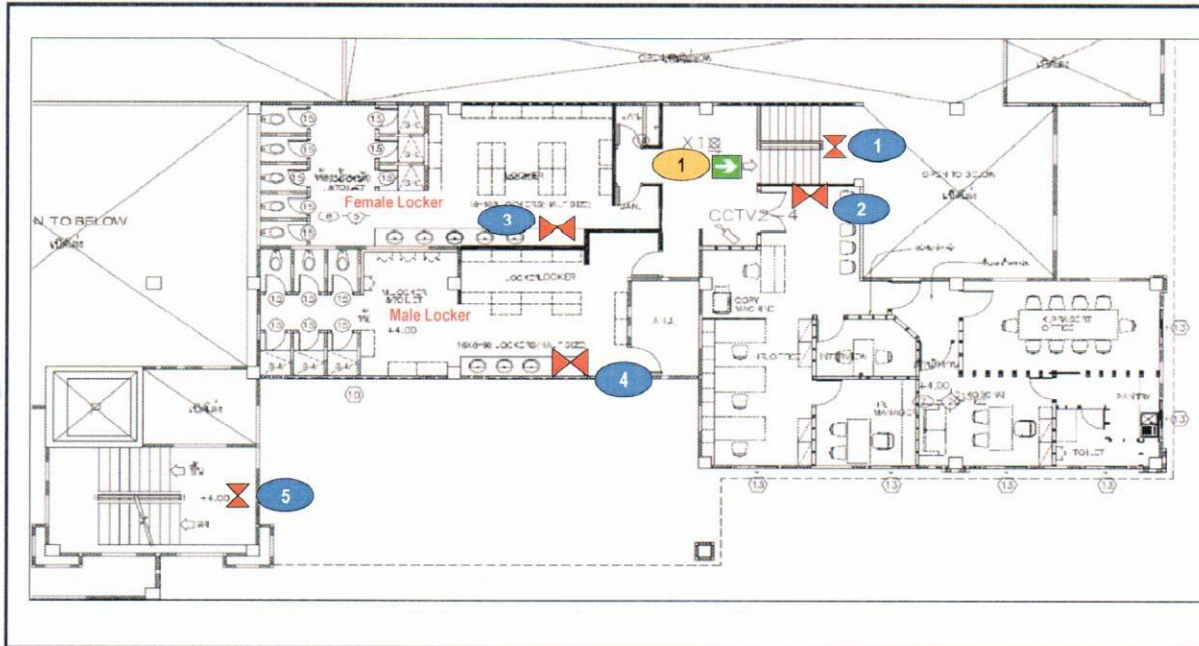Eucalyptus 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3		✓		

Emergency Light and Exit Signage Checklist (HR Office)


Checked on Date: 05 February 2024



Exit Signage	Location	Status		Remark
		YES	No	
1		Front of HR Office	✓	
Emergency Light	Location	Status		Remark
		YES	No	
1		Stair to HR Office	X	out of order
2		Inside HR Office	X	out of order
3		Female Locker Room	✓	
4		Male Locker Room	✓	
5		Stair to Ball Room	X	Remove

Emergency Light and Exit Signage Checklist (Back of the House)

Checked on Date: 05 February 2024

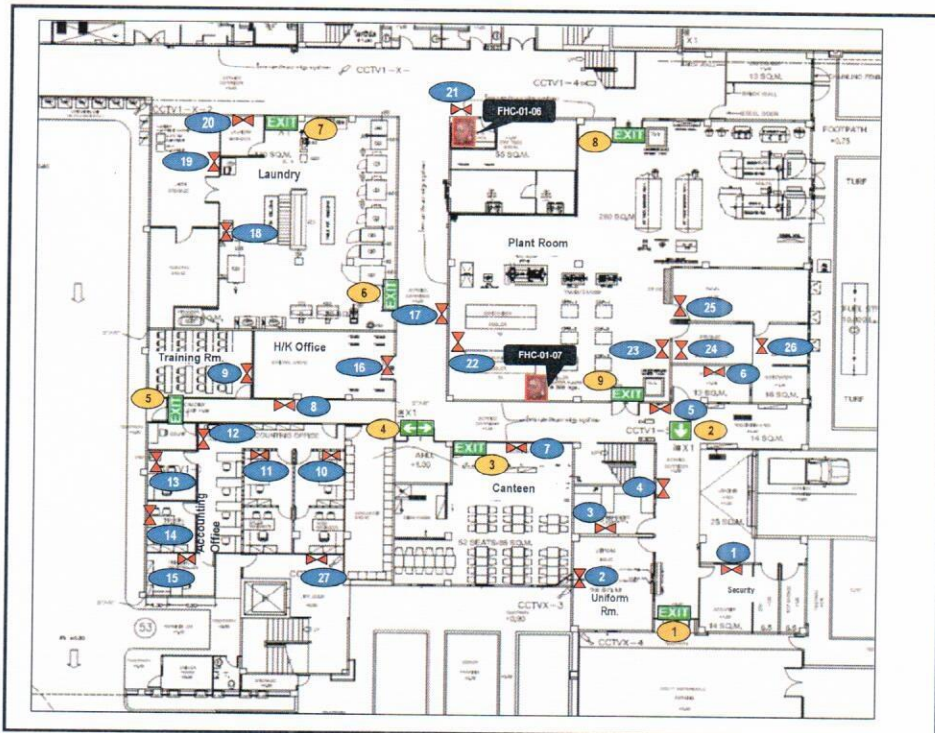


Exit Signage	Location	Status		Remark
		Yes	No	
1	EXIT Entrance Time Keeper	✓		
2	Front of First Aid room	✓		
3	EXIT Associate Canteen	✓		
4	EXIT Canteen Store	✓		
5	EXIT Fire Exit door 1	✓		
6	EXIT Laundry room 1	✓		
7	EXIT Laundry room 2	✓		
8	EXIT Plant room 1	✓		
9	EXIT Plant room 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Security Office		X	out of order
2	Uniform room	✓		
3	Receiving & Purchasing rm.		X	out of order
4	Front of Purchasing room	✓		
5	Front of Plant room	✓		
6	First Aid room		X	out of order
7	canteen		X	out of order
8	Front of Accounting Office	✓		
9	Training room (FB Office)		X	out of order
10	Reservation room		X	out of order
11	Inside Accounting Office1	✓		
12	Inside Accounting Office2	✓		
13	Cashier room		X	out of order
14	Asst. FC room	✓		
15	FC room	✓		
16	HK Office	✓		
17	Front of Laundry	✓		
18	Front of Laundry Store		X	out of order
19	Inside Laundry Store		X	out of order
20	Landry Office		X	Remove
21	Front of Steward Office	✓		
22	Plant Room		X	out of order
23	Front of Plant Room Storage		X	Remove
24	Inside Plant Room Storage		X	Remove
25	MDB Room	✓		
26	Generator Room		X	out of order
27	Building of JAMJUREE stair		X	out of order

Emergency Light and Exit Signage Checklist (Main Kitchen and Cham Cha)

Checked on Date: 05 February 2024

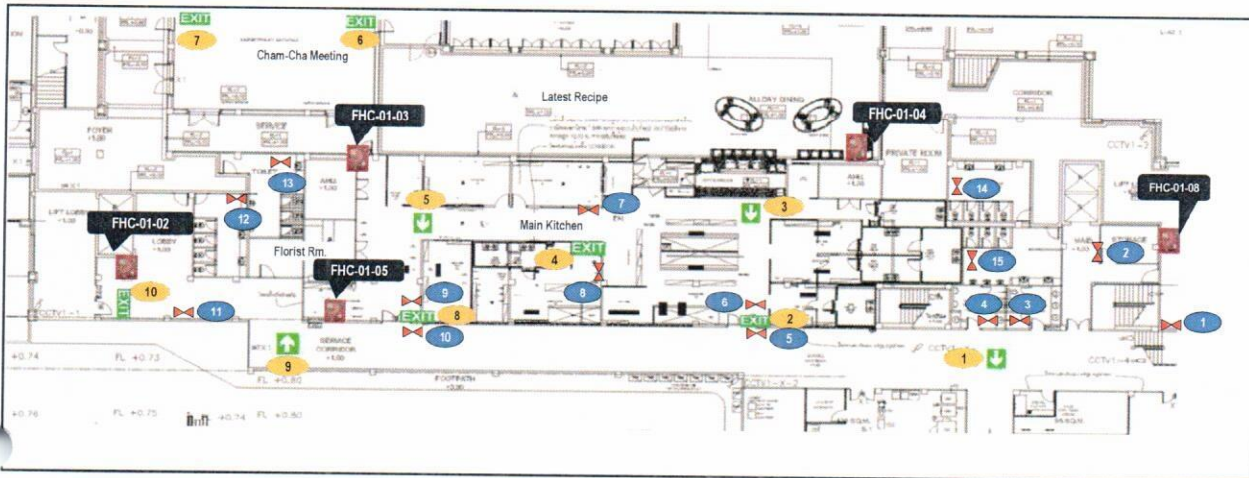


Exit Signage	Location	Status		Remark
		Yes	No	
1	Front of Associate Toilet	✓		
2	Main Kitchen Exit 1	✓		
3	Near Meat Preparation	✓		
4	Bakery room	✓		
5	Near Office Chef	✓		
6	Cham Cha 1	✓		
7	Cham Cha 2	✓		
8	Main Kitchen Exit 2	✓		
9	Opposite Florist room	✓		
10	Fire Exit Door 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Stair to behind Ball Room		X	Remove
2	Front of lift service B	✓		
3	Associate Female Toilet		X	out of order
4	Associate Male Toilet		X	out of order
5	Front of Main Kitchen 1	✓		
6	Behind Main Kitchen 1		X	out of order
7	Front of Bakery Room		X	out of order
8	Inside Bakery Room		X	out of order
9	Behind Main Kitchen 2		X	out of order
10	Front of Main Kitchen 2	✓		
11	Near Florist Room	✓		
12	Cham Cha Guest Female Toilet	✓		
13	Cham Cha Guest male Toilet	✓		
14	Near Florist Room	✓		
15	Front of lift service B 3rd floor	✓		
16	Front of lift service B 4nd floor		X	out of order
17	Cham cha Guest male Toilet	✓		
18	Latest Recipe Guest male Toilet		X	Remove
19	Latest Recipe Guest Female Toilet		X	out of order

Emergency Light and Exit Signage Checklist Utopia Room & Toilet Utopia FL.2

Checked On Date: 05 February 2024

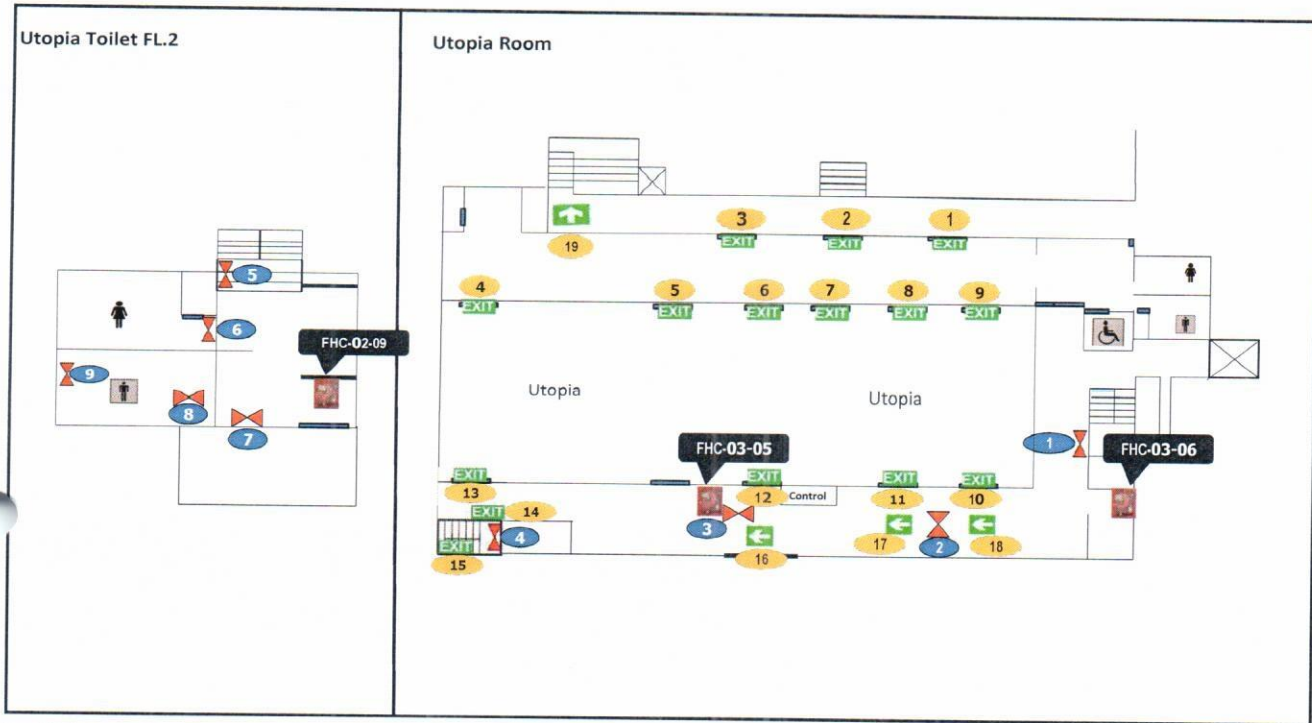


ป้ายหนีไฟ	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	EXIT		X	REMOVE
2	EXIT			
3	EXIT			
4	EXIT			
5	EXIT			
6	EXIT			
7	EXIT			
8	EXIT			
9	EXIT			
10	EXIT			
11	EXIT			
12	EXIT			
13	EXIT			
14	EXIT		x	out of order
15	EXIT		x	out of order
16	←		X	REMOVE
17	←		X	REMOVE
18	←		X	REMOVE
19	←		X	REMOVE

ไฟฉุกเฉิน	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	Building of Utopia		X	REMOVE
2	Back of Utopia Rm.		X	REMOVE
3	Back of Utopia Rm.		X	REMOVE
4	Stair exit building Utopia Rm.		X	REMOVE
5	Stair JAMJUREE FL.2	✓		
6	Female toilet of Utopia FL.2	✓		
7	Male toilet of Utopia FL.2	✓		
8	In female toilet of Utopia FL.2		X	REMOVE
8	In male toilet of Utopia FL.2		X	REMOVE
9	Utopia Fire Escape		X	out of order

Emergency Light and Exit Signage Checklist (Lobby)

Checked on Date: 05 February 2024

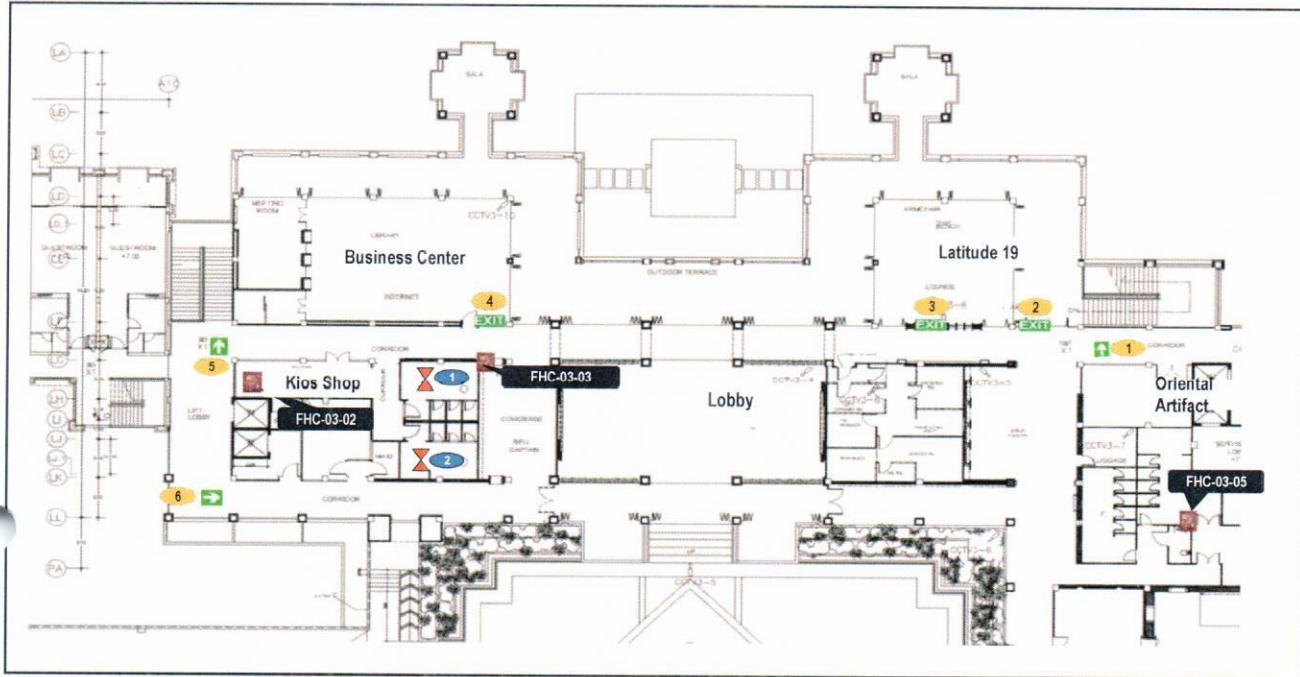


Exit Signage	Location	Status		Remark
		Yes	No	
1	Latitude 19 Stair	✓		
2	Latitude 19 Exit 1	✓		
3	Latitude 19 Exit 2	✓		
4	Library Exit	✓		
5	Kios Stair	✓		
6	Conner Corridor Concierge	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Guest Toilet (Female)	✓		
2	Guest toilet (Male)	✓		



Emergency Light and Exit Signage Checklist (Carpark and Engineer Office)

Checked on Date: 05 February 2024

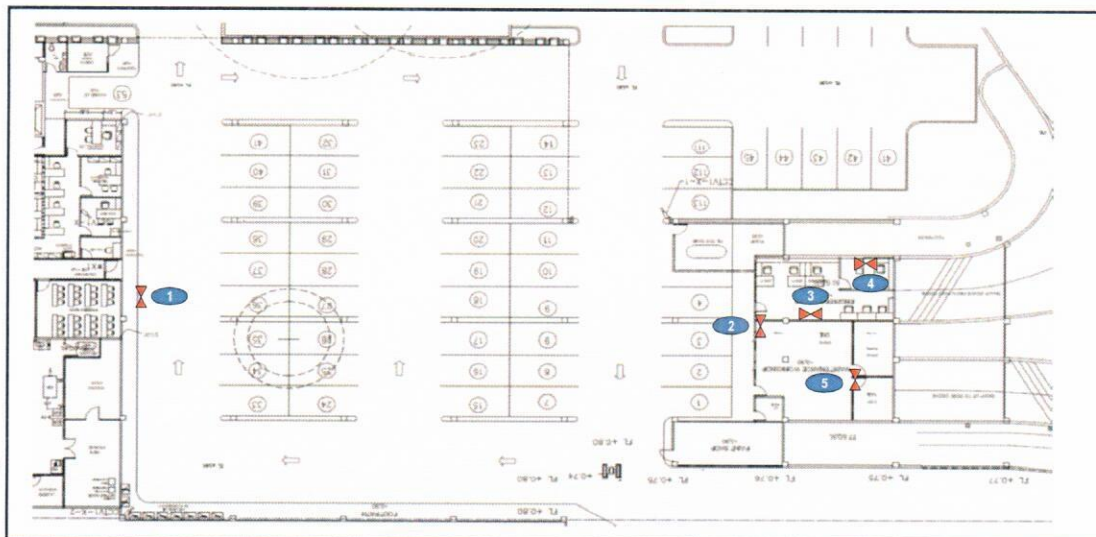


Exit Signage	Location	Status		Remark
		Yes	No	
1	Emergency Exit door		X	out of order
2	In front of Eng Office		X	out of order
3	Engineering Office		X	out of order
4	Chief Engineering office		X	REMOVE
5	Maintenance Shop		X	out of order



Emergency Light and Exit Signage Checklist (Favola Restaurant)

Checked on Date: 05 February 2024

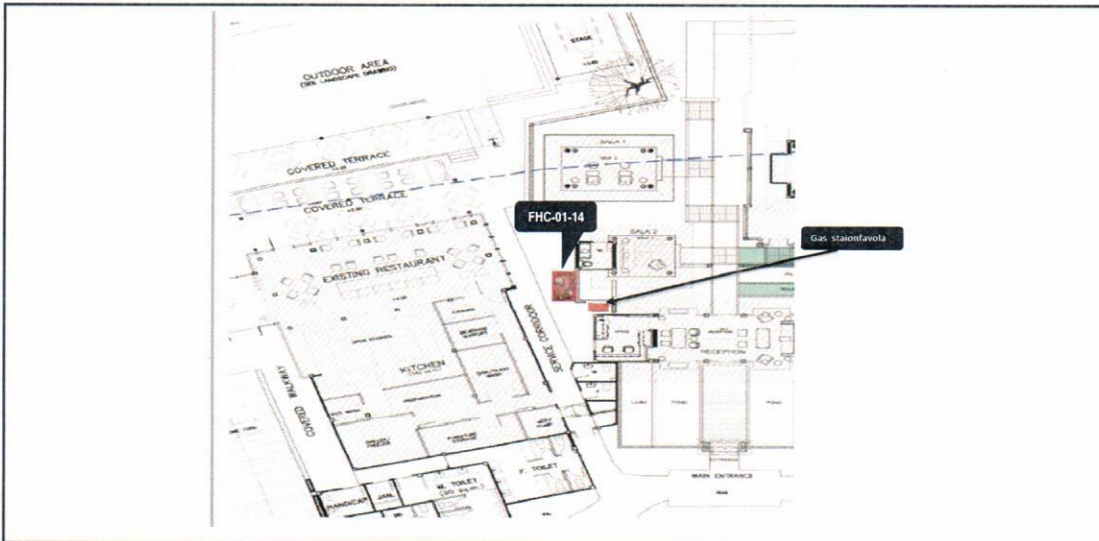


Inside Fire Host Cabinet				
Hose Rack 30	Nozzle	Hydrant Valve 2.5	Extinguisher	Axe



Emergency Light and Exit Signage Checklist (Spa)

Checked on Date: 05 February 2024

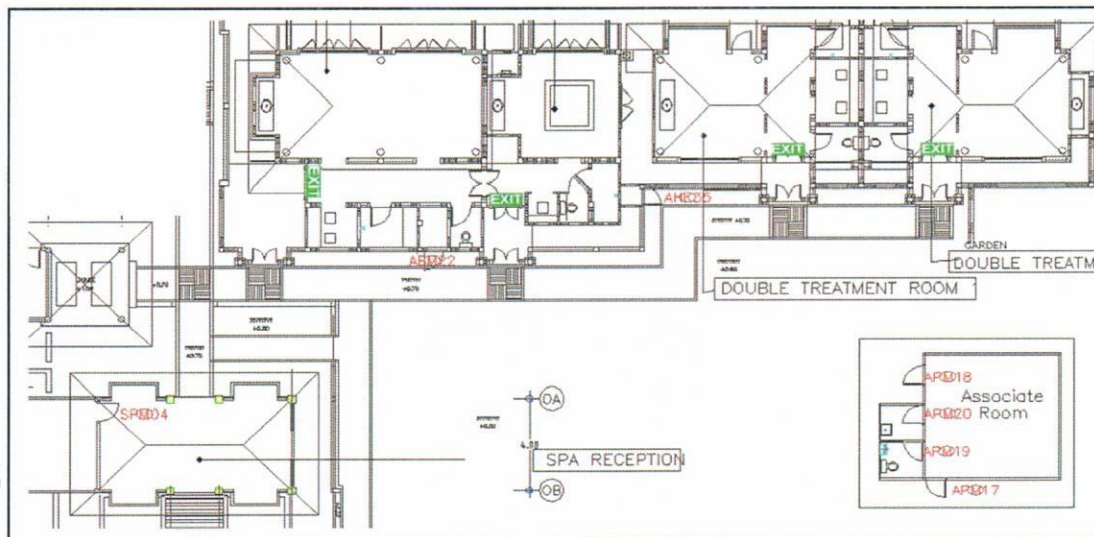

Exit Signage	Location	Status		Remark
		Yes	No	
1	Pavati Spa entrance	✓		
2	Leelawadee Spa entrance	✓		
3	Ratree Spa entrance		X	out of order
4	Chuanchom Spa entrance		X	out of order
5	Spa entrance		X	out of order

Emergency light	Location	Status		Remark
		Yes	No	
1	Generator room	✓		



Summary Fire Equipment Report

Month: 05 March 2024

Extinguisher Tank	Location				Total
	B.O.H.	F.H.C.	Fire Cart	Spare Tank	
1. CO2	26	6	1	0	33
2. Halotron	8	0	0	1	9
3. Dry Chemical	0	38	3	7	48
4. Wet Chemical	3	0	0	0	3
5. Form	3	0	0	0	3
Total	40	44	4	8	96

Remark: Spare tank have kept in store inside Security Store room and fire cart has set nearby Store Keeper.

Back of the House (B.O.H)			
Type of tank	Quantity	Status	
		Yes	No
1. CO2	26	26	0
2. Halotron	8	8	0
3. Wet Chemical	3	4	0
4. Form	3	3	0
Total	40	41	0

Fire Hose Cabinet (F.H.C.)			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	38	38	0
2 CO2	6	6	0
Total	44	44	0

Fire Cart			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	3	3	0
2 CO2	1	1	0
Total	4	4	0

Spare Store			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	13	13	0
2. Halotron	4	4	0
Total	17	17	0

Other Equipment			
	Quantity	Status	
		Yes	No
1. Fire Blanket	5	5	0
2. Clothing Protect Heat	3	3	0
Total	8	8	0

Remark: The Clothing Protect Heat are kept in Hanger Cabinet nearby Fire Cart.

Other Emergency light / Signage	Status	Location										Total
		A	B	C-D	E	HR	BOH	UTOPIA	MK	LOBBY	ENG	
1. Emergency light	ALL	15	21	20	12	5	27	10	18	2	5	135
	YES	15	19	14	6	2	11	3	6	2	0	78
	NO	1	2	6	6	1	13	1	9	0	5	44
	Remove	0	0	0	0	1	3	6	3	0	1	14
2. Exit signage	ALL	2	1	2	0	0	7	15	6	3	0	36
	YES	2	1	2	0	0	7	15	6	3	0	36
	NO	0	0	0	0	0	1	0	0	0	0	1
3. Arrow point signage	ALL	13	22	32	4	1	2	4	4	3	0	87
	YES	14	22	30	4	1	2	3	3	3	0	82
	NO	1	0	2	0	0	2	1	1	0	0	7

Fire Hose Cabinet Checklist

Checked on Date: 5 March 2024

No.	Floor	Register No.	Location	Inside Fire Host Cabinet					Model	Manufacture	Remark
				Hose Rack 30 M. 1.5 Inc	Nozzle	Hydrant Valve 2.5	Extinguisher				
1st Floor											
1	1	FHC 01-01	Corridor A in front of room 1102						6.8 KGS.(ST-15 lbs.)	SATURN	
2	1	FHC 01-02	Corridor A beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
3	1	FHC 01-03	Back of Cham Cha room(CO2)						10 C	V.I.P Fire	
4	1	FHC 01-04	Inside Latest Recipe (CO2)						10 lbs.	Best	
5	1	FHC 01-05	Near Main Kitchen door						10V (VIP-10lbs.)	V.I.P Fire	
6	1	FHC 01-06	Beside Chief Steward Office						6.8 KGS.(ST-15 lbs.)	SATURN	
7	1	FHC 01-07	In front of staff canteen						6.8 KGS.(15lbs.)	Brake Fire	
8	1	FHC 01-08	Corridor B beside guest elevator (Latest Recipe)						6.8 KGS.(ST-15 lbs.)	SATURN	
9	1	FHC 01-09	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
10	1	FHC 01-10	Building C in front of pantry room						CN-15	C-NON Fire	
11	1	FHC 01-11	Building D near guest room 4101						FM-15 lbs. 6.8 KGS.	Fire Man Rescue	
12	1	FHC 01-12	Building E near guest room 5103						10 lbs.(5 KGS.) 4A:2B	WILL	
13	1	FHC 01-13	Building E near guest room 5107						10 lbs.(5 KGS.) 4A:2B	WILL	
14	1	FHC 01-14	Favola						6.8 KGS.(ST-15 lbs.)	SATURN	☑Axe
15	1	FHC 01-15	Spa						6.8 KGS.(ST-15 lbs.)	SATURN	☑Axe
2nd Floor											
16	2	FHC 02-01	Corridor A in front of guest room 1202						6.8 KGS.(ST-15 lbs.)	SATURN	
17	2	FHC 02-02	Corridor A in front of Executive office						6.8 KGS.(ST-15 lbs.)	SATURN	
18	2	FHC 02-03	Corridor B beside guest elevator (near fitness)						6.8 KGS.(ST-15 lbs.)	SATURN	
19	2	FHC 02-04	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
20	2	FHC 02-05	Building C corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN	
21	2	FHC 02-06	Building D near guest room 4201						CN-15	C-NON Fire	
22	2	FHC 02-07	Building E near guest room 5203						10 lbs.(5 KGS.) 4A:2B	WILL	
23	2	FHC 02-08	Building E near guest room 5207						10 lbs.(5 KGS.) 4A:2B	WILL	
24	2	FHC 02-09	Toilet Utopia Fl.2(CO2)						10 lbs.	Best	
3rd Floor											
25	3	FHC 03-01	Corridor in front of guest room 1302						6.8 KGS.(ST-15 lbs.)	SATURN	
26	3	FHC 03-02	Corridor A near Kiosk shop						6.8 KGS.(ST-15 lbs.)	SATURN	
27	3	FHC 03-03	In front of Business Center						6.8 KGS.(ST-15 lbs.)	SATURN	
28	3	FHC 03-04	In front of Lobby Latitude 19 (Dry Chemical)						6.8 KGS.(ST-15 lbs.)	SATURN	
			In front of Lobby Latitude 19 (CO ₂)						10 lbs.	EXTRA	
29.1	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	BEST	
29.2	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	EXTRA	
29.3	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	EXTRA	
30.1	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	BEST	
30.2	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	EXTRA	
30.3	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	EXTRA	
31	3	FHC 03-07	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
32	3	FHC 03-08	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
33	3	FHC 03-09	Corridor Building C front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN	
34	3	FHC 03-10	Building D near guest room 4301						6.8 KGS.(ST-15 lbs.)	SATURN	
35	3	FHC 03-11	Building E near guest room 5303						10 lbs.(5 KGS.) 4A:2B	WILL	
36	3	FHC 03-12	Building E near guest room 5307						10 lbs.(5 KGS.) 4A:2B	WILL	
4th Floor											
37	4	FHC 04-01	Corridor A in front of guest room 1402						6.8 KGS.(ST-15 lbs.)	SATURN	
38	4	FHC 04-02	Corridor A near guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
39	4	FHC 04-03	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN	
40	4	FHC 04-04	Building B near stair guest						6.8 KGS.(ST-15 lbs.)	SATURN	
41	4	FHC 04-05	Building C Corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN	
42	4	FHC 04-06	Building D near guest room 4401						6.8 KGS.(ST-15 lbs.)	SATURN	
43	4	FHC 04-07	Building E near guest room 5403						10 lbs.(5 KGS.) 4A:2B	WILL	
44	4	FHC 04-08	Building E near guest room 5407						10C (CO2 10 lbs.)	V.I.P Fire	

Summary : The total of 44 fire host cabinets.

Parameter	Total (Location)	Status		Remark
		Normal	Abnormal	
Hose Rack 30 m. 1.5 inc.	44	44	0	
Nozzle	44	44	0	
Hydrant Valve 2.5	44	44	0	
Dry Chemical Extinguisher	38	38	0	
CO ₂ Extinguisher	6	6	0	
The Fire hose cabinet door closer	44	44	0	

Fire Extinguisher (Hanged Alone) Checklist

Checked on Date : 05 March 2024

No.	Floor	Locations	TAG	CO2 10lb		Halotron 10 lb		Dry chemical 10 lb		WetChemical 10lb		Model	Manufacturer	Fire Blanket	Remark	
				Yes	No	Yes	No	Yes	No	Yes	No					
1	G	Receiving Area		✓								10C (CO2 10 lbs.)	V.I.P Fire			
2	G	in front of Canteen room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
3	G	Accounting Office 1				✓						NON-CFC (10N)	V.I.P Fire			
4	G	Accounting Office 2				✓						NON-CFC (10N)	V.I.P Fire			
5	G	Laundry Room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire			
6	G	Laundry Room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
7	G	Laundry Room 3 (Store Laundry)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
8	G	Generator room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
9	G	MDB Room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
10	G	Plant room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire			
11	G	Plant room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
12	G	Plant room 3		✓								10C (CO2 10 lbs.)	V.I.P Fire			
13	G	Plant room 4		✓								10C (CO2 10 lbs.)	V.I.P Fire			
14	G	F&B in Pantry room behind Latest Recipe		✓								10C (CO2 10 lbs.)	V.I.P Fire			
15	G	F&B in front of butcher room								✓		Pro Plus 100K 2005	Kidde			
16	G	F&B in front of Fruit room								✓		Pro Plus 100K 2005	Kidde			
17	G	F&B in front of Bakery room								✓		Pro Plus 100K 2005	Kidde			
18	G	F&B inside Bakery room								✓		Pro Plus 100K 2005	Kidde			
19	G	Engineering Office 1				✓						NON-CFC (10N)	V.I.P Fire			
20	G	Engineering Office 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
21	G	Maintenance work shop 1		✓								10C (CO2 10 lbs.)	V.I.P Fire			
22	G	Maintenance work shop 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
23	G	Maintenance work shop 3		✓								10C (CO2 10 lbs.)	V.I.P Fire			
24	G	FAVOLA Steward Area		✓								10C (CO2 10 lbs.)	V.I.P Fire			
25	G	FAVOLA Kitchen								✓		K01-3	K-Guard			
26	G	SPA Manager room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
27	G	Treatment room 1 (Parvati)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
28	G	Treatment room 2 (Leelawadee)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
29	G	Treatment room 3 (Ratree)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
30	G	Treatment room 4 (Chuanchom)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
31	G	Associate & Store room of SPA		✓								10C (CO2 10 lbs.)	V.I.P Fire			
32	G	EV Charger		✓								10C (CO2 10 lbs.)	V.I.P Fire			
33	2	HR Office				✓						NON-CFC (10N)	V.I.P Fire			
34	2	Executive Office 1				✓						NON-CFC (10N)	V.I.P Fire			
35	2	Executive Office 2				✓						NON-CFC (10N)	V.I.P Fire			
36	3	Front Office Department 1				✓						NON-CFC (10N)	V.I.P Fire			
37	3	Front Office Department 2				✓						NON-CFC (10N)	V.I.P Fire			
38	3	Lift service room Angsana		✓								10C (CO2 10 lbs.)	V.I.P Fire			
39	4	Elevator A						✓				10 C	Best			
40	4	Elevator B						✓				10 C	Best			
41	4	Elevator CDE						✓				10 C	Best			
42	G	India Kitchen								✓		Pro Plus 100K 2005	Kidde			
43	G	Gas Station 1						✓				15 lbs (6.9 KG.)	Imperial			
44	G	Gas Station 2						✓				15 lbs (6.9 KG.)	Imperial			
45	G	Gas Station Favola						✓				15 lbs (6.9 KG.)	Imperial			
Total (Tanks)				0	25	0	8	0	6	0	5	0			1	


Fire Cart Check List

No.	Description	TAG	Result		Remark	Model	Manufacturer
			Normal	Disable			
1	Extinguisher Dry Chemical (10 Lbs.) No.1	✓	✓			CN-15	C-NON Fire
2	Extinguisher Dry Chemical (10 Lbs.) No.2	✓	✓			CN-15	C-NON Fire
3	Extinguisher Dry Chemical (10 Lbs.) No.3	✓	✓			TF-15	Top Fire
4	Extinguisher CO2 No.4	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
5	Extinguisher CO2 No.5	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
6	Rope		✓		1 rope		
7	Hydrant 2.5" set		✓		1 set		
8	Axe		✓		1		
9	Fire fighting Suite		✓		3 set		

Spare Tanks (Store in LP Store Room)


NO.	Location	TAG	Fire Extinguisher Spare (Tank)								Model	Manufacturer	Remark
			CO2 10lb		Halotron 10lb		Dry Chemical 10lb		Wet Chemical 10lb				
			Yes	No	Yes	No	Yes	No	Yes	No			
1	Store in Plant room NO. 1	✓			✓						Non CFC (10N)	V.I.P Fire	
2	Store in Plant room NO. 2	✓			✓						10 lbs.	Number 1 Fire	
3	Store in Plant room NO. 3	✓			✓						10 lbs.	Number 1 Fire	
4	Store in Plant room NO. 4	✓									9.0 litres	V.I.P Fire	Foam
5	Store in Plant room NO. 5	✓									FA-10 lbs	Fire Ade	Foam

10	Store in Plant room NO. 11	✓					✓				15 v.(VIP-15 lb)	V.I.P Fire	15 lb.
11	Store in Plant room NO. 12	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
12	Store in Plant room NO. 13	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
13	Store in Plant room NO. 14	✓					✓				NF-15 D	NOFIRE	
14	Store in Plant room NO. 15	✓					✓				15 AG	Angel	
15	Store in Plant room NO. 16	✓					✓				CN-15	C-NON Fire	
			15	1	0	3	0	8	0	0	0		



Emergency Light and Exit Signage Checklist (Angsana)

Checked on Date: 05 March 2024

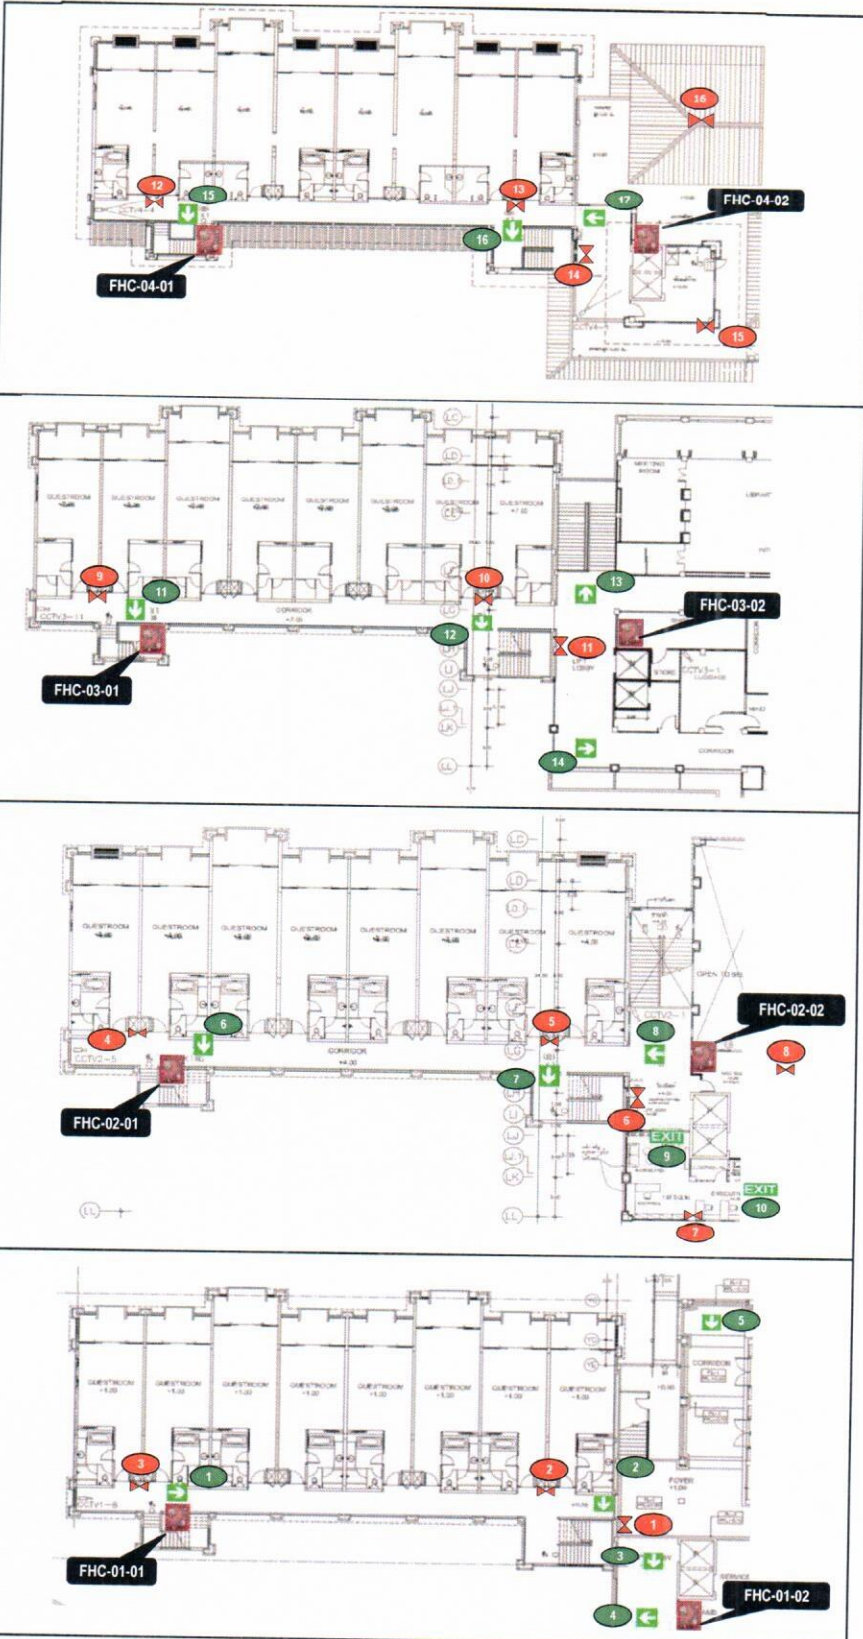

Angsana 4th floor				
No.	Exit Signage	Yes	No	Remark
15		✓		
16		✓		
17		✓		
No.	Emergency Light	Yes	No	Remark
12		✓		
13		✓		
14		✓		
15		✓		
16		✓		


Angsana 3rd floor				
No.	Exit Signage	Yes	No	Remark
11		✓		
12		✓		
13		✓		
14		✓		
No.	Emergency Light	Yes	No	Remark
9		✓		
10		✓		
11			X	Out of order

Angsana 2nd floor				
No.	Exit Signage	Yes	No	Remark
6		✓		
7		✓		
8		✓		
9		✓		
10		✓		
No.	Emergency Light	Yes	No	Remark
4		✓		
5		✓		
6		✓		
7		✓		
8		✓		


Angsana 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
No.	Emergency Light	Yes	No	Remark
1			X	Out of order
2		✓		
3		✓		

Emergency Light and Exit Signage Checklist (Bamboo)


Checked on Date: 05 March 2024

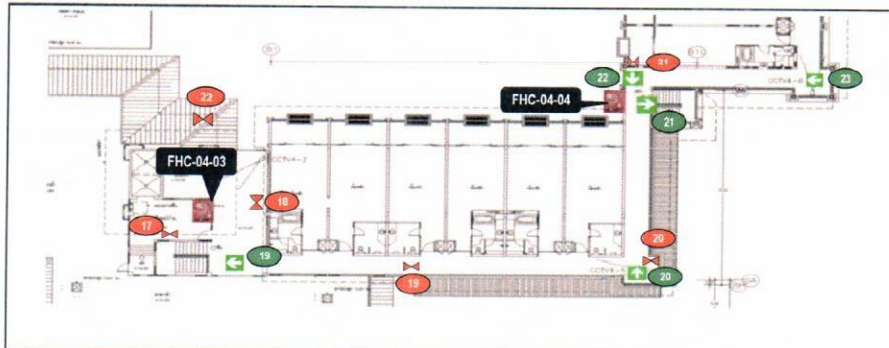


Bamboo 4th floor				
No.	Exit Signage	Yes	No	Remark
19		✓		
20			X	out of order
21		✓		
22		✓		
23		✓		
No.	Emergency Light	Yes	No	Remark
17		✓		
18		✓		
19		✓		
20		✓		
21		✓		
22		✓		

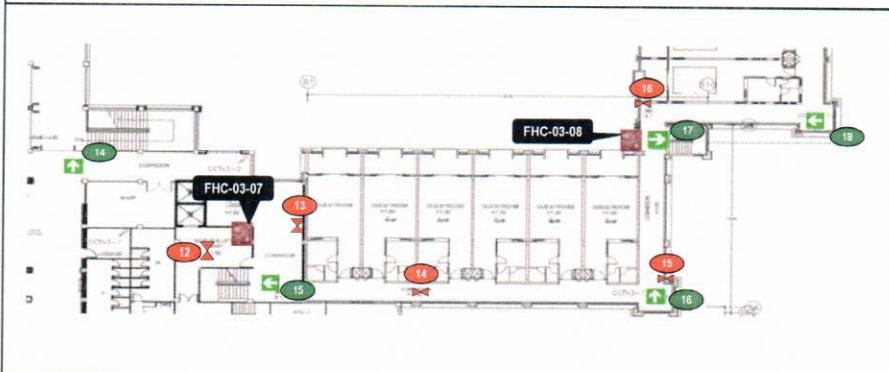

Bamboo 3rd floor				
No.	Exit Signage	Yes	No	Remark
14		✓		
15		✓		
16		✓		
17		✓		
18		✓		
No.	Emergency Light	Yes	No	Remark
12		✓		
13		✓		
14		✓		
15		✓		
16		✓		

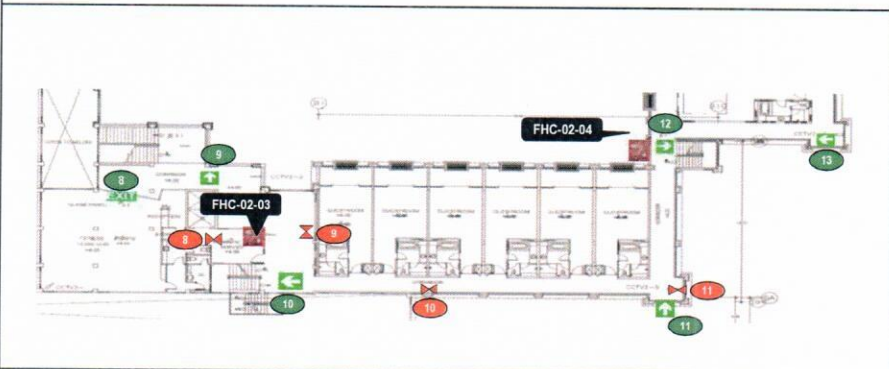


Bamboo 2nd floor				
No.	Exit Signage	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11		✓		
12		✓		
13		✓		
No.	Emergency Light	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11		✓		

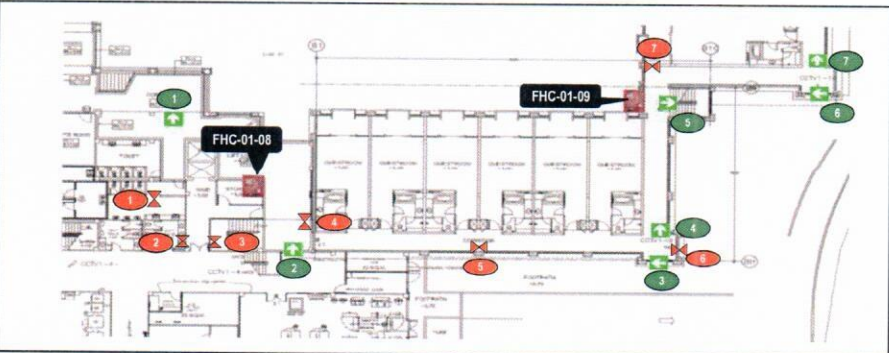


Bamboo 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
6		✓		
7		✓		
No.	Emergency Light	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4			X	out of order
5		✓		
6		✓		
7			X	out of order


Checked on Date: 05 March 2024

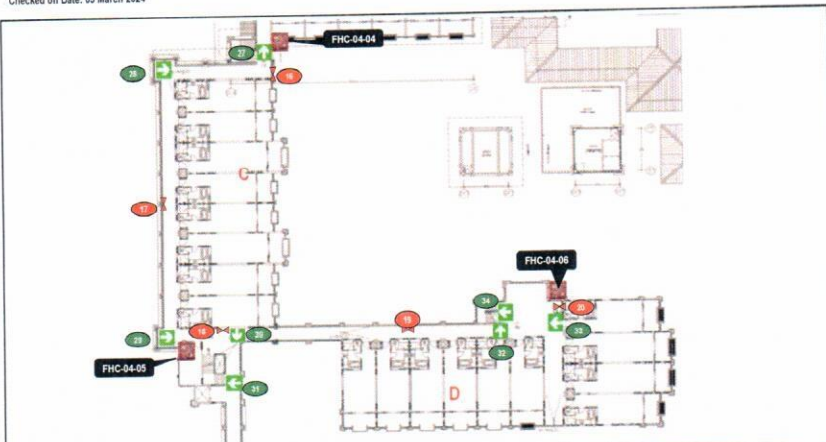


Champa and Dalar 4th floor				
No.	Exit Signage	Yes	No	Remark
27	✓	✓		
28	✓	✓		
29	✓	✓		
30	✓	✓		
31	✓	✓		
32	✓	✓		
33	✓	✓		
34	✓	✓		
No.	Emergency Light	Yes	No	Remark
16	✗	✓		
17	✗	✓		
18	✗	✗		out of order
19	✗	✓		
20	✗	✓		

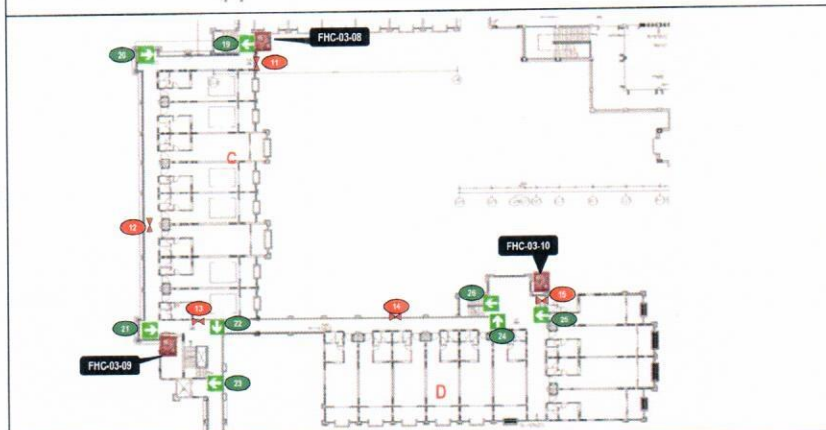

Champa and Dalar 3rd floor				
No.	Exit Signage	Yes	No	Remark
19	✓	✓		
20	✓	✓		
21	✓	✓		
22	✓	✓		
23	✓	✓		
24	✓	✓		
25	✓	✓		
26	✓	✓		
No.	Emergency Light	Yes	No	Remark
11	✗	✓		
12	✗	✓		
13	✗	✓		
14	✗	✓		
15	✗	✗		out of order

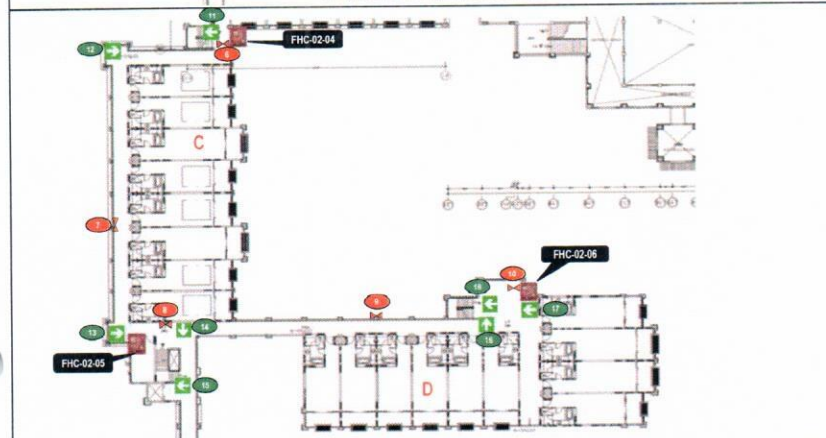


Champa and Dalar 2nd floor				
No.	Exit Signage	Yes	No	Remark
11	✓	✓		
12	✓	✓		
13	✓	✓		
14	✓	✓		
15	✓	✓		
16	✓	✓		
17	✓	✓		
18	✓	✓		
No.	Emergency Light	Yes	No	Remark
6	✗	✓		
7	✗	✓		
8	✗	✓		
9	✗	✗		out of order
10	✗	✗		out of order

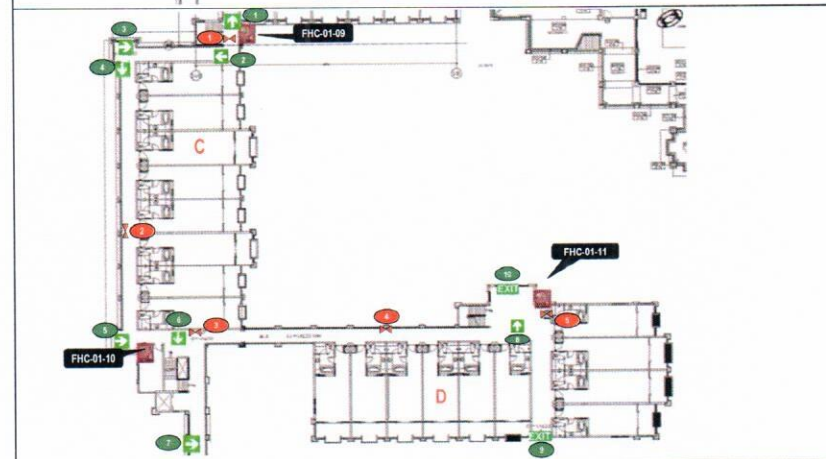

Champa and Dalar 1st floor				
No.	Exit Signage	Yes	No	Remark
1	✓	✓		
2	✓	✓		
3	✓	✓		
4	✓	✓		
5	✓	✓		
6	✓	✓		
7	✓	✓		
8	✓	✓		
9	EXIT	✓		
10	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
1	✗	✓		
2	✗	✗		out of order
3	✗	✓		
4	✗	✓		
5	✗	✓		

Emergency Light and Exit Signage Checklist (Eucalyptus)

Checked on Date: 05 March 2024

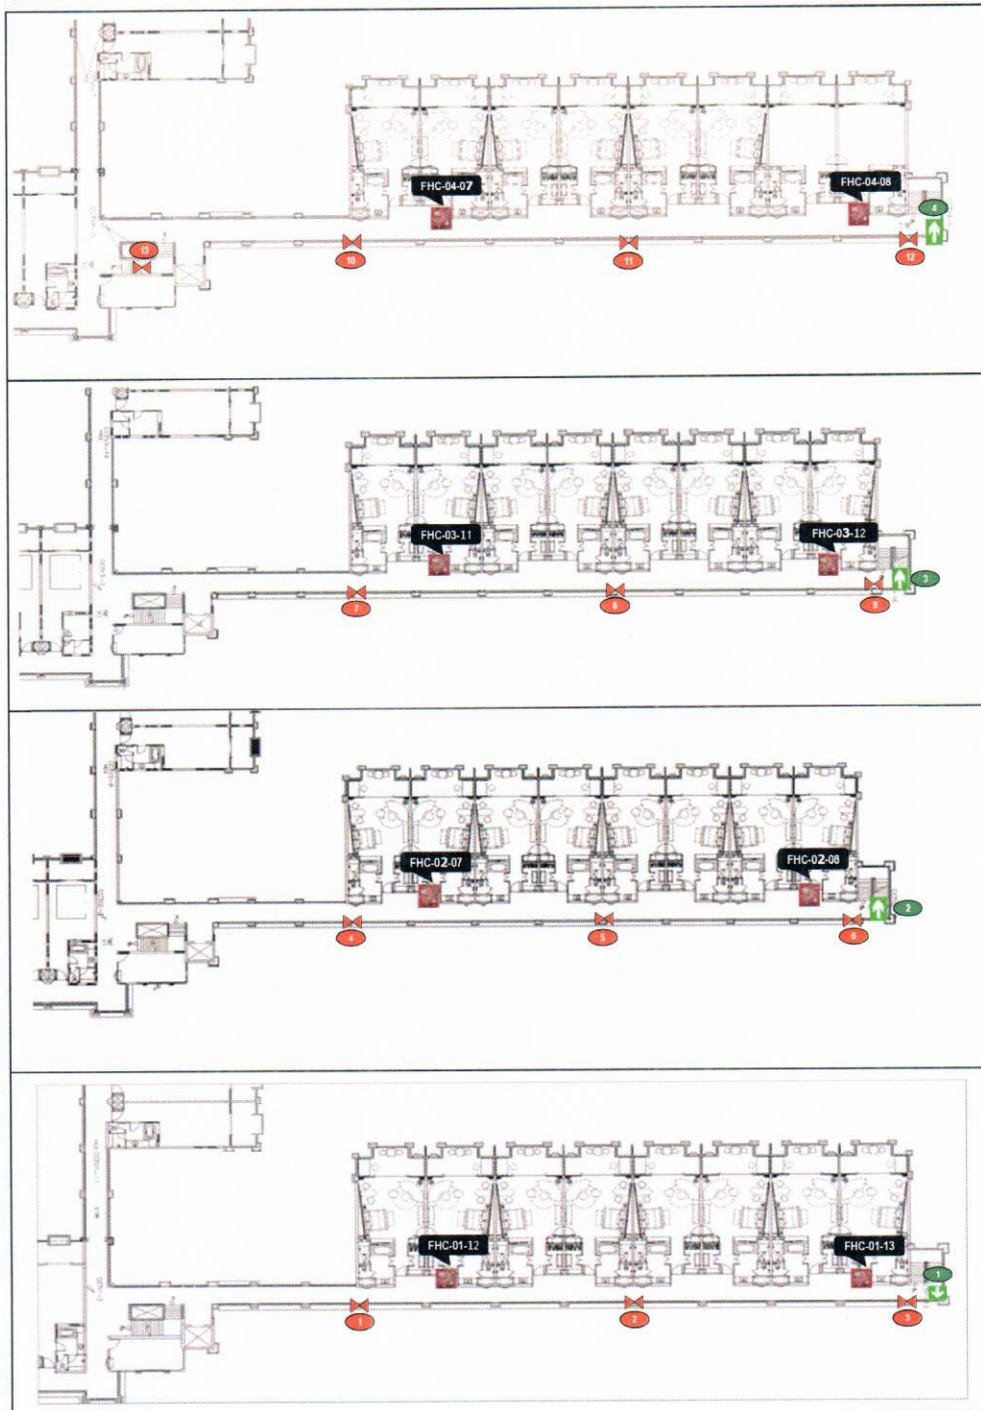

Eucalyptus 4th floor				
No.	Exit Signage	Yes	No	Remark
4		✓		
No.	Emergency Light	Yes	No	Remark
10			X	out of order
11		✓		
12		✓		
13			X	out of order

Eucalyptus 3rd floor				
No.	Exit Signage	Yes	No	Remark
3		✓		
No.	Emergency Light	Yes	No	Remark
7		✓		
8		✓		
9			X	out of order


Eucalyptus 2nd floor				
No.	Exit Signage	Yes	No	Remark
2		✓		
No.	Emergency Light	Yes	No	Remark
4		✓		
5		✓		
6		✓		

Eucalyptus 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3		✓		

Public Area

Emergency Light and Exit Signage Checklist (HR Office)


Checked on Date: 05 March 2024

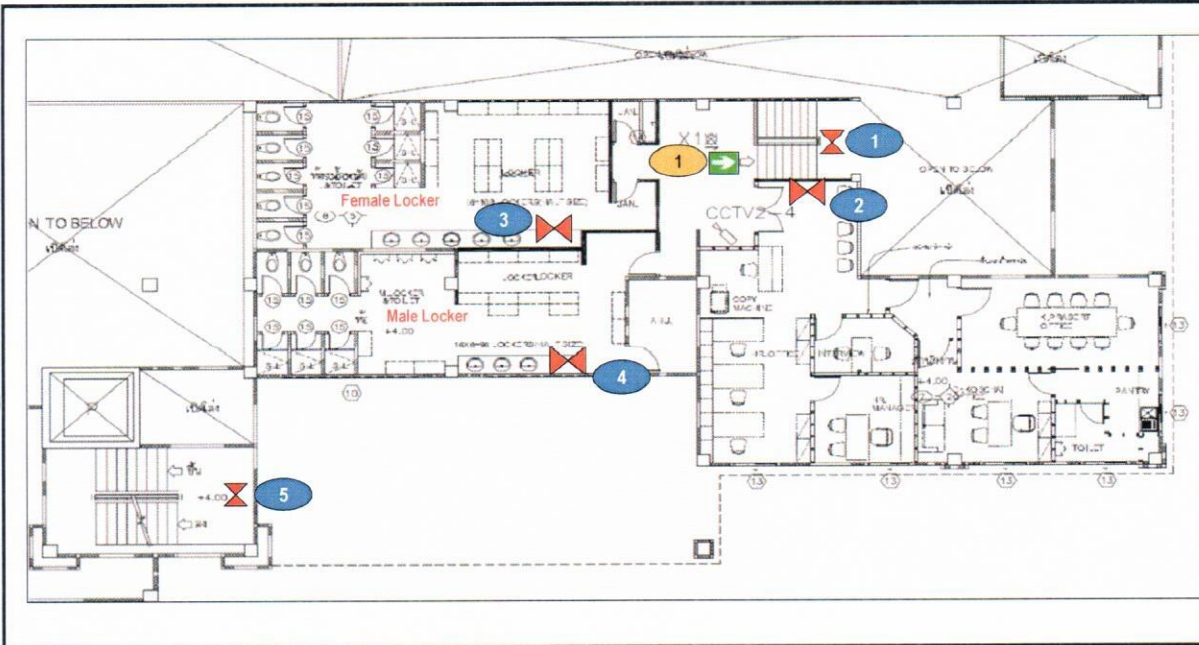

Exit Signage	Location	Status		Remark
		YES	No	
1		✓		
Emergency Light	Location	Status		Remark
		YES	No	
1			X	out of order
2			X	out of order
3		✓		
4		✓		
5			X	Remove

Emergency Light and Exit Signage Checklist (Back of the House)

Checked on Date: 05 March 2024

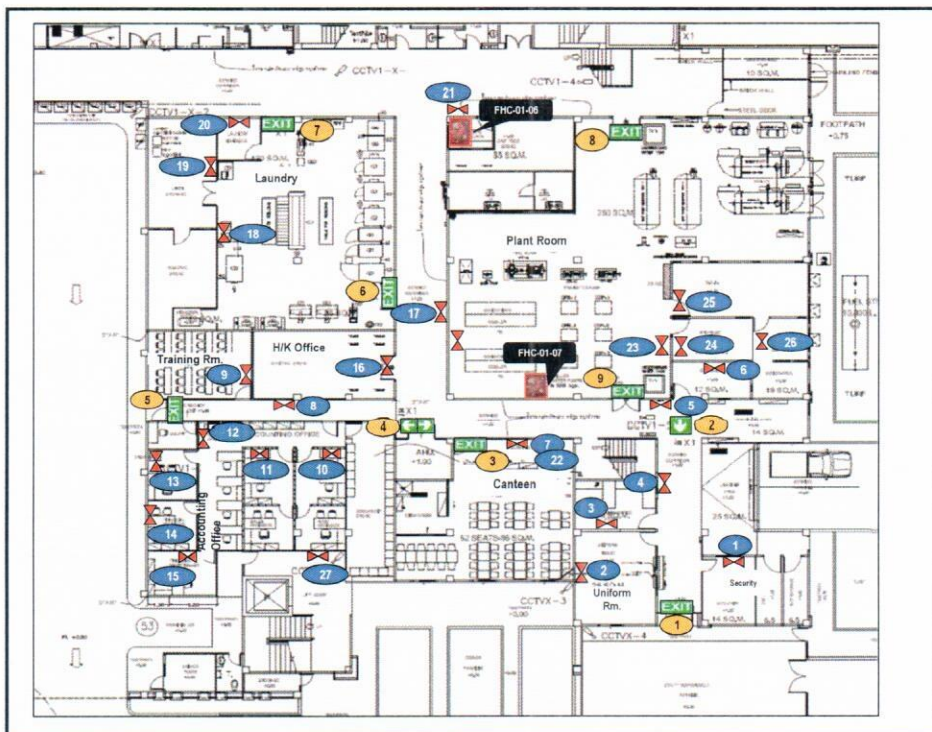


EXIT

Exit Signage	Location	Status		Remark
		Yes	No	
1	Entrance Time Keeper	✓		
2	Front of First Aid room			
3	Associate Canteen		X	out of order
4	Canteen Store	✓		
5	Fire Exit door 1	✓		
6	Laundry room 1	✓		
7	Laundry room 2	✓		
8	Plant room 1	✓		
9	Plant room 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Security Office		X	out of order
2	Uniform room	✓		
3	Receiving & Purchasing rm.		X	out of order
4	Front of Purchasing room	✓		
5	Front of Plant room	✓		
6	First Aid room		X	out of order
7	canteen		X	out of order
8	Front of Accounting Office	✓		
9	Training room (FB Office)		X	out of order
10	Reservation room		X	out of order
11	Inside Accounting Office1	✓		
12	Inside Accounting Office2	✓		
13	Cashier room		X	out of order
14	Asst. FC room	✓		
15	FC room	✓		
16	HK Office	✓		
17	Front of Laundry	✓		
18	Front of Laundry Store		X	out of order
19	Inside Laundry Store		X	out of order
20	Landry Office			Remove
21	Front of Steward Office	✓		
22	Plant Room		X	out of order
23	Front of Plant Room Storage		X	Remove
24	Inside Plant Room Storage		X	Remove
25	MDB Room	✓		
26	Generator Room		X	out of order
27	Building of JAMJUREE stair		X	out of order

Emergency Light and Exit Signage Checklist (Main Kitchen and Cham Cha)

Checked on Date: 05 March 2024

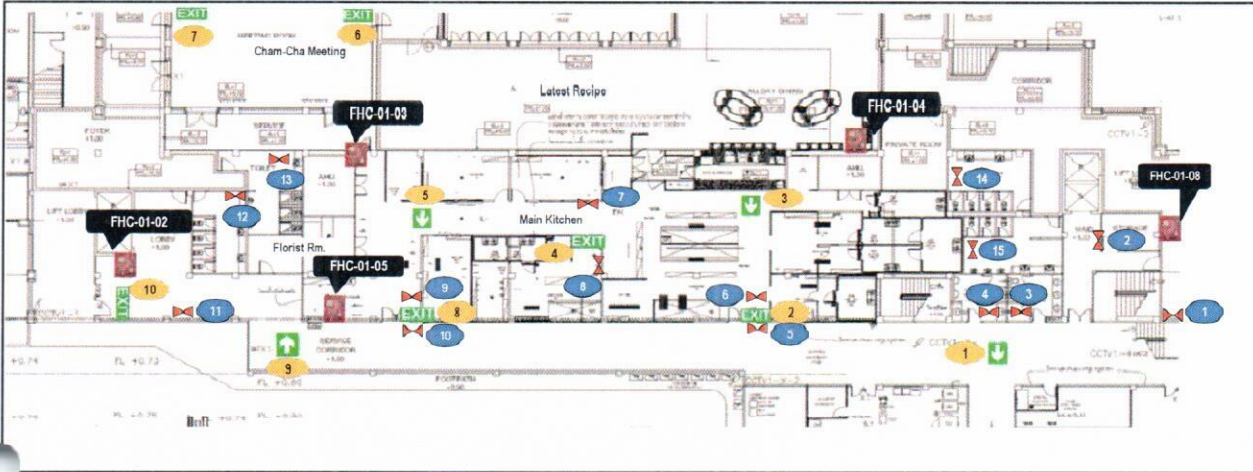


Exit Signage	Location	Status		Remark
		Yes	No	
1	Front of Associate Toilet	✓		
2	Main Kitchen Exit 1	✓		
3	Near Meat Preparation	✓		
4	Bakery room	✓		
5	Near Office Chef	✓		
6	Cham Cha 1	✓		
7	Cham Cha 2	✓		
8	Main Kitchen Exit 2	✓		
9	Opposite Florist room	✓		
10	Fire Exit Door 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Stair to behind Ball Room		X	Remove
2	Front of lift service B	✓		
3	Associate Female Toilet		X	out of order
4	Associate Male Toilet		X	out of order
5	Front of Main Kitchen 1	✓		
6	Behind Main Kitchen 1	✓		
7	Front of Bakery Room	✓		
8	Inside Bakery Room	✓		
9	Behind Main Kitchen 2	✓		
10	Front of Main Kitchen 2	✓		
11	Near Florist Room	✓		
12	Cham Cha Guest Female Toilet	✓		
11	Cham Cha Guest male Toilet	✓		
14	Near Florist Room	✓		
15	Front of lift service B 3rd floor	✓		
16	Front of lift service B 4nd floor		X	out of order
17	Cham cha Guest male Toilet	✓		
18	Latest Recipe Guest male Toilet		X	Remove
19	Latest Recipe Guest Female Toile		X	out of order

Emergency Light and Exit Signage Checklist Utopia Room & Toilet Utopia FL.2

Checked On Date: 05 March 2024

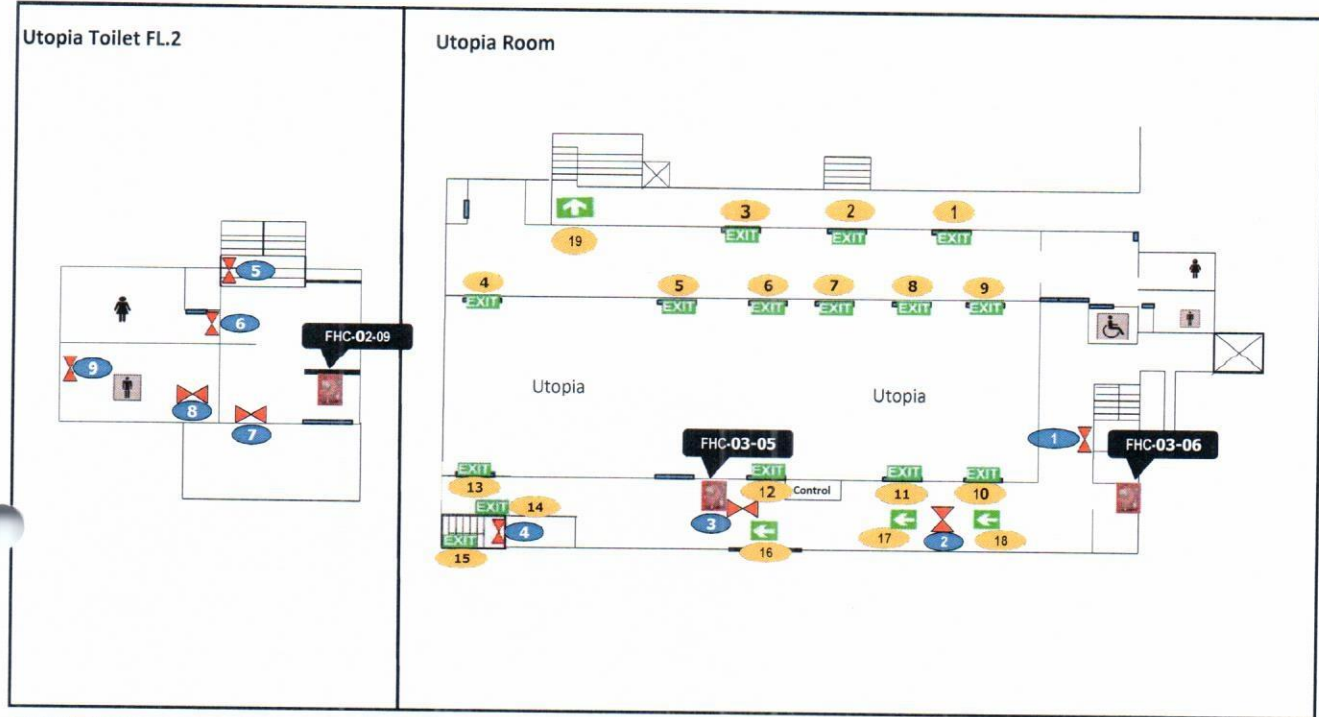


ป้ายหนีไฟ	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	EXIT Glass Door Utopia Rm. Point 1		X	REMOVE
2	EXIT Glass Door Utopia Rm. Point 2	✓		
3	EXIT Glass Door Utopia Rm. Point 3	✓		
4	EXIT In Utopia Rm.	✓		
5	EXIT In Utopia Rm.	✓		
6	EXIT In Utopia Rm.	✓		
7	EXIT In Utopia Rm.	✓		
8	EXIT In Utopia Rm.	✓		
9	EXIT In Utopia Rm.	✓		
10	EXIT In Utopia Rm.	✓		
11	EXIT In Utopia Rm.	✓		
12	EXIT In Utopia Rm.	✓		
13	EXIT In Utopia Rm.	✓		
14	EXIT Stair down fire exit		X	out of order
15	EXIT Stair up fire exit		X	out of order
16	← Building of Utopia		X	REMOVE
17	← Building of Utopia		X	REMOVE
18	← Building of Utopia		X	REMOVE
19	← Front of Utopia		X	REMOVE

ไฟฉุกเฉิน	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	Building of Utopia		X	REMOVE
2	Back of Utopia Rm.		X	REMOVE
3	Back of Utopia Rm.		X	REMOVE
4	Stair exit building Utopia Rm.		X	REMOVE
5	Stair JAMJUREE FL.2	✓		
6	Female toilet of Utopia FL.2	✓		
7	Male toilet of Utopia FL.2	✓		
8	In female toilet of Utopia FL.2		X	REMOVE
8	In male toilet of Utopia FL.2		X	REMOVE
9	Utopia Fire Escape		X	out of order

Emergency Light and Exit Signage Checklist (Lobby)

Checked on Date: 05 March 2024

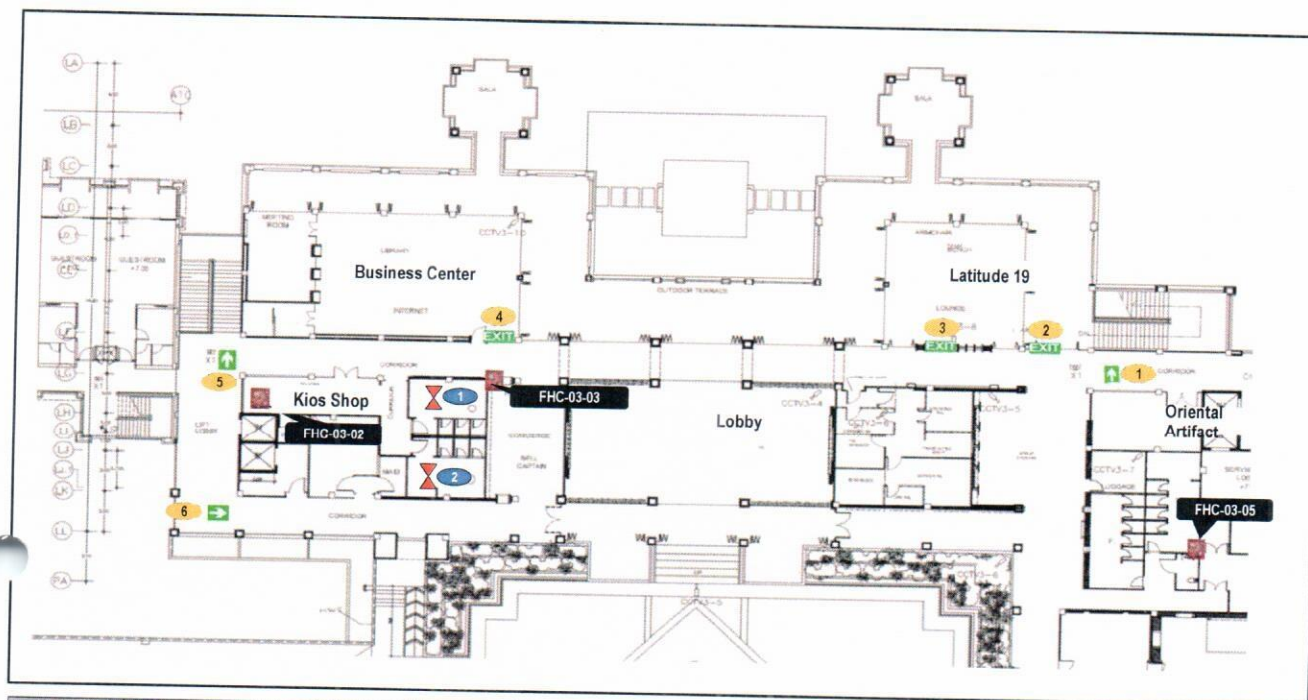


Exit Signage	Location	Status		Remark
		Yes	No	
1	Latitude 19 Stair	✓		
2	Latitude 19 Exit 1	✓		
3	Latitude 19 Exit 2	✓		
4	Library Exit	✓		
5	Kios Stair	✓		
6	Conner Corridor Concierge	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Guest Toilet (Female)	✓		
2	Guest toilet (Male)	✓		



Emergency Light and Exit Signage Checklist (Carpark and Engineer Office)

Checked on Date: 05 March 2024

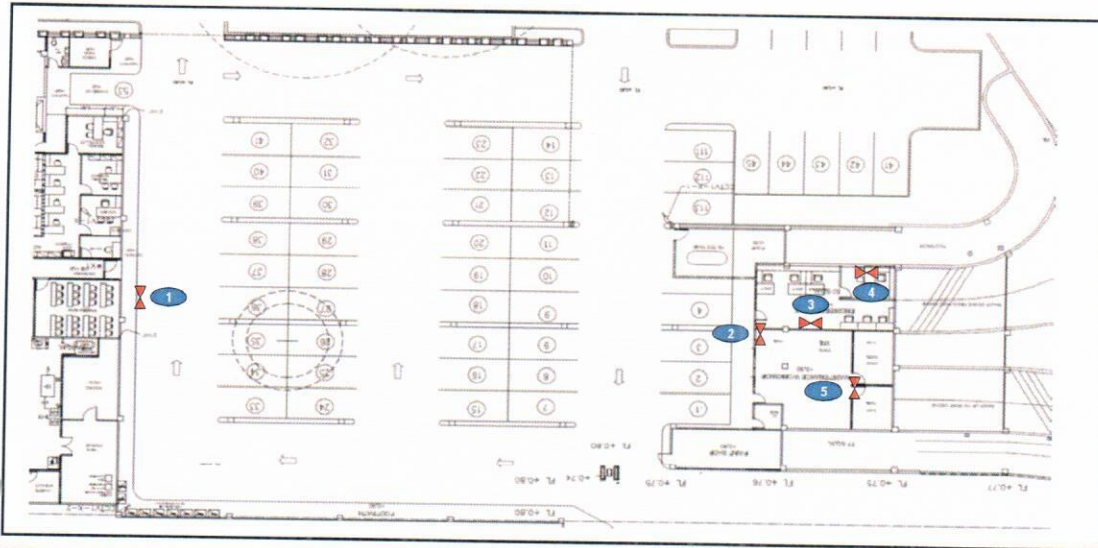


Exit Signage	Location	Status		Remark
		Yes	No	
1	Emergency Exit door		X	out of order
2	In front of Eng Office		X	out of order
3	Engineering Office		X	out of order
4	Chief Engineering office		X	REMOVE
5	Maintenance Shop		X	out of order



Emergency Light and Exit Signage Checklist (Favola Restaurant)

Checked on Date: 05 March 2024

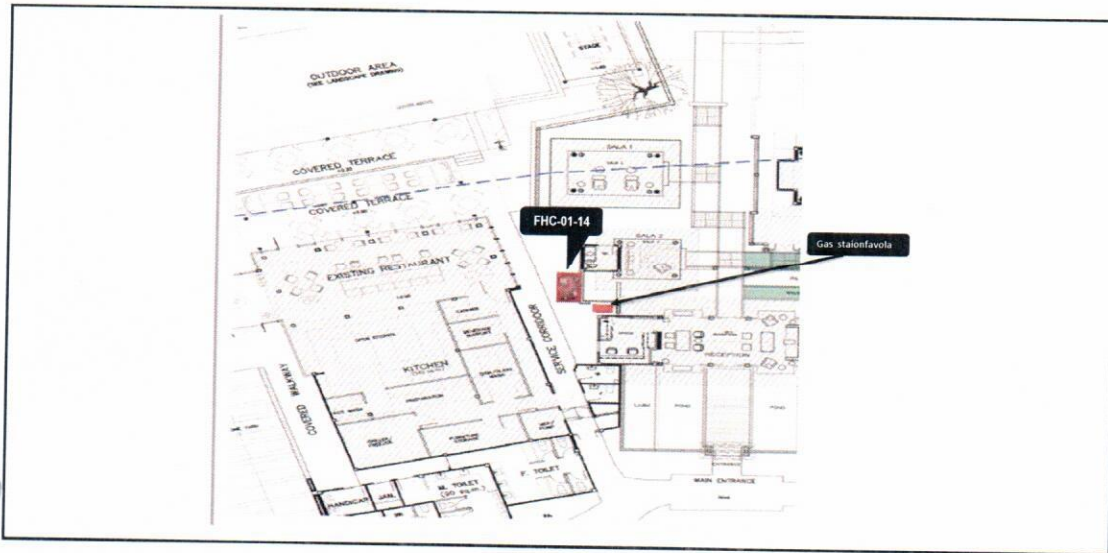


Inside Fire Host Cabinet				
Hose Rack 30	Nozzle	Hydrant Valve 2.5	Extinguisher	Axe



Emergency Light and Exit Signage Checklist (Spa)

Checked on Date: 05 March 2024

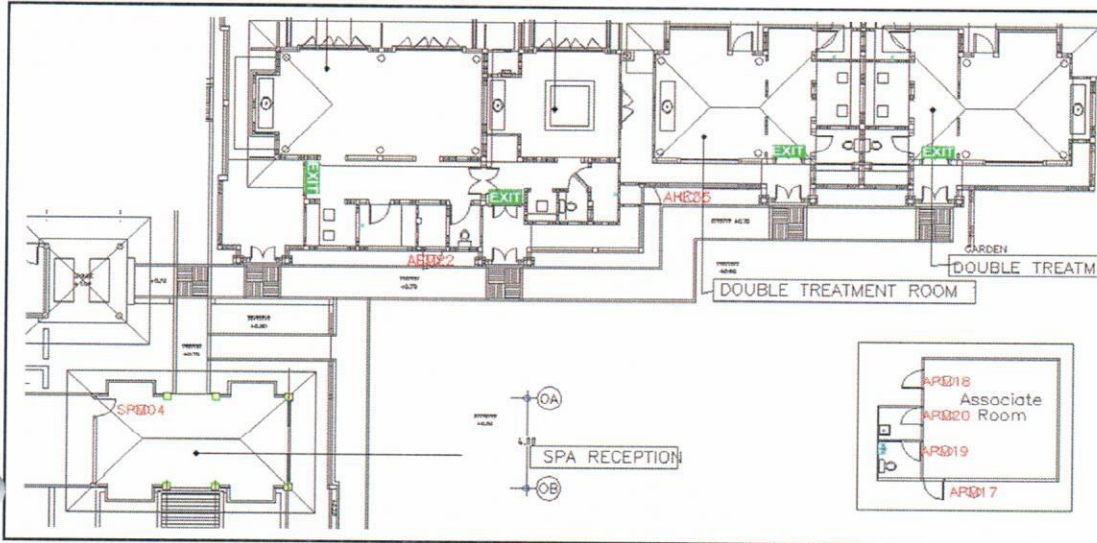

Exit Signage	Location	Status		Remark
		Yes	No	
1	Pavati Spa entrance	✓		
2	Leelawadee Spa entrance	✓		
3	Ratree Spa entrance		X	out of order
4	Chuanom Spa entrance		X	out of order
5	Spa entrance		X	out of order

Emergency light	Location	Status		Remark
		Yes	No	
1	Generator room	✓		



Summary Fire Equipment Report

Month: 06 April 2024

Extinguisher Tank	Location				Total
	B.O.H.	F.H.C.	Fire Cart	Spare Tank	
1. CO2	26	6	1	0	33
2. Halotron	8	0	0	1	9
3. Dry Chemical	0	38	3	7	48
4. Wet Chemical	3	0	0	0	3
5. Form	3	0	0	0	3
Total	40	44	4	8	96

Remark: Spare tank have kept in store inside Security Store room and fire cart has set nearby Store Keeper.

Back of the House (B.O.H)			
Type of tank	Quantity	Status	
		Yes	No
1. CO2	26	26	0
2. Halotron	8	8	0
3. Wet Chemical	3	4	0
4. Form	3	3	0
Total	40	41	0

Fire Hose Cabinet (F.H.C.)			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	38	38	0
2 CO2	6	6	0
Total	44	44	0

Fire Cart			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	3	3	0
2 CO2	1	1	0
Total	4	4	0

Spare Store			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	13	13	0
2 Halotron	4	4	0
Total	17	17	0

Other Equipment	Quantity	Status	
		Yes	No
1. Fire Blanket	5	5	0
2. Clothing Protect Heat	3	3	0
Total	8	8	0

Remark: The Clothing Protect Heat are kept in Hanger Cabinet nearby Fire Cart.

Other Emergency light / Signage	Status	Location										Total
		A	B	C-D	E	HR	BOH	UTOPIA	MK	LOBBY	ENG	
1. Emergency light	ALL	15	21	20	12	5	27	10	18	2	5	135
	YES	15	19	14	6	2	11	3	6	2	0	78
	NO	1	2	6	6	1	13	1	9	0	5	44
	Remove	0	0	0	0	1	3	6	3	0	1	14
2. Exit signage	ALL	2	1	2	0	0	7	15	6	3	0	36
	YES	2	1	2	0	0	7	15	6	3	0	36
	NO	0	0	0	0	0	1	0	0	0	0	1
3. Arrow point signage	ALL	15	22	32	4	1	2	4	4	3	0	87
	YES	14	22	30	4	1	2	3	3	3	0	82
	NO	1	0	2	0	0	2	1	1	0	0	7

Fire Hose Cabinet Checklist

Checked on Date: 5 : 06 April 2024

No.	Floor	Register No.	Location	Inside Fire Host Cabinet					Model	Manufacture	Remark	
				Hose Rack 30 M. 1.5 Inc	Nozzle	Hydrant Valve 2.5	Extinguisher					
							Tag	Yes				No
1st Floor												
1	1	FHC 01-01	Corridor A in front of room 1102						6.8 KGS.(ST-15 lbs.)	SATURN		
2	1	FHC 01-02	Corridor A beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN		
3	1	FHC 01-03	Back of Cham Cha room(CO2)						10 C	V.I.P Fire		
4	1	FHC 01-04	Inside Latest Recipe (CO2)						10 lbs.	Best		
5	1	FHC 01-05	Near Main Kitchen door						10V (VIP-10lbs.)	V.I.P Fire		
6	1	FHC 01-06	Beside Chief Steward Office						6.8 KGS.(ST-15 lbs.)	SATURN		
7	1	FHC 01-07	In front of staff canteen						6.8 KGS.(15lbs.)	Brake Fire		
8	1	FHC 01-08	Corridor B beside guest elevator (Latest Recipe)						6.8 KGS.(ST-15 lbs.)	SATURN		
9	1	FHC 01-09	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN		
10	1	FHC 01-10	Building C in front of pantry room						CN-15	C-NON Fire		
11	1	FHC 01-11	Building D near guest room 4101						FM-15 lbs. 6.8 KGS.	Fire Man Rescue		
12	1	FHC 01-12	Building E near guest room 5103						10 lbs.(5 KGS.) 4A:2B	WILL		
13	1	FHC 01-13	Building E near guest room 5107						10 lbs.(5 KGS.) 4A:2B	WILL		
14	1	FHC 01-14	Favola						6.8 KGS.(ST-15 lbs.)	SATURN	☒Axe	
15	1	FHC 01-15	Spa						6.8 KGS.(ST-15 lbs.)	SATURN	☒Axe	
2nd Floor												
16	2	FHC 02-01	Corridor A in front of guest room 1202						6.8 KGS.(ST-15 lbs.)	SATURN		
17	2	FHC 02-02	Corridor A in front of Executive office						6.8 KGS.(ST-15 lbs.)	SATURN		
18	2	FHC 02-03	Corridor B beside guest elevator (near fitness)						6.8 KGS.(ST-15 lbs.)	SATURN		
19	2	FHC 02-04	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN		
20	2	FHC 02-05	Building C corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN		
21	2	FHC 02-06	Building D near guest room 4201						CN-15	C-NON Fire		
22	2	FHC 02-07	Building E near guest room 5203						10 lbs.(5 KGS.) 4A:2B	WILL		
23	2	FHC 02-08	Building E near guest room 5207						10 lbs.(5 KGS.) 4A:2B	WILL		
24	2	FHC 02-09	Toilet Utopia Fl.2(CO2)						10 lbs.	Best		
3rd Floor												
25	3	FHC 03-01	Corridor in front of guest room 1302						6.8 KGS.(ST-15 lbs.)	SATURN		
26	3	FHC 03-02	Corridor A near Kiosk shop						6.8 KGS.(ST-15 lbs.)	SATURN		
27	3	FHC 03-03	In front of Business Center						6.8 KGS.(ST-15 lbs.)	SATURN		
28	3	FHC 03-04	In front of Lobby Latitude 19 (Dry Chemical)						6.8 KGS.(ST-15 lbs.)	SATURN		
			In front of Lobby Latitude 19 (CO ₂)						10 lbs.	EXTRA		
29.1	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	BEST		
29.2	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	EXTRA		
29.3	3	FHC 03-05	Back of Utopia room(CO2)						10 lbs.	EXTRA		
30.1	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	BEST		
30.2	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	EXTRA		
30.3	3	FHC 03-06	Building of Utopia room (CO2)						10 lbs.	EXTRA		
31	3	FHC 03-07	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN		
32	3	FHC 03-08	Building B in front of stair guest						6.8 KGS.(ST-15 lbs.)	SATURN		
33	3	FHC 03-09	Corridor Building C front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN		
34	3	FHC 03-10	Building D near guest room 4301						6.8 KGS.(ST-15 lbs.)	SATURN		
35	3	FHC 03-11	Building E near guest room 5303						10 lbs.(5 KGS.) 4A:2B	WILL		
36	3	FHC 03-12	Building E near guest room 5307						10 lbs.(5 KGS.) 4A:2B	WILL		
4th Floor												
37	4	FHC 04-01	Corridor A in front of guest room 1402						6.8 KGS.(ST-15 lbs.)	SATURN		
38	4	FHC 04-02	Corridor A near guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN		
39	4	FHC 04-03	Corridor B beside guest elevator						6.8 KGS.(ST-15 lbs.)	SATURN		
40	4	FHC 04-04	Building B near stair guest						6.8 KGS.(ST-15 lbs.)	SATURN		
41	4	FHC 04-05	Building C Corridor in front of pantry room						6.8 KGS.(ST-15 lbs.)	SATURN		
42	4	FHC 04-06	Building D near guest room 4401						6.8 KGS.(ST-15 lbs.)	SATURN		
43	4	FHC 04-07	Building E near guest room 5403						10 lbs.(5 KGS.) 4A:2B	WILL		
44	4	FHC 04-08	Building E near guest room 5407						10C (CO2 10 lbs.)	V.I.P Fire		

Summary : The total of 44 fire host cabinets.

Parameter	Total (Location)	Status		Remark
		Normal	Abnormal	
Hose Rack 30 m. 1.5 inc.	44	44	0	
Nozzle	44	44	0	
Hydrant Valve 2.5	44	44	0	
Dry Chemical Extinguisher	38	38	0	
CO ₂ Extinguisher	6	6	0	
The Fire hose cabinet door closer	44	44	0	

Fire Extinguisher (Hanged Alone) Checklist

Checked on Date : 06 April 2024

No.	Floor	Locations	TAG	CO2 10lb		Halotron 10 lb		Dry chemical 10 lb		WetChemical 10lb		Model	Manufacturer	Fire Blanket	Remark
				Yes	No	Yes	No	Yes	No	Yes	No				
1	G	Receiving Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
2	G	in front of Canteen room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
3	G	Accounting Office 1				✓						NON-CFC (10N)	V.I.P Fire		
4	G	Accounting Office 2				✓						NON-CFC (10N)	V.I.P Fire		
5	G	Laundry Room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
6	G	Laundry Room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
7	G	Laundry Room 3 (Store Laundry)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
8	G	Generator room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
9	G	MDB Room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
10	G	Plant room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
11	G	Plant room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
12	G	Plant room 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
13	G	Plant room 4		✓								10C (CO2 10 lbs.)	V.I.P Fire		
14	G	F&B in Pantry room behind Latest Recipe		✓								10C (CO2 10 lbs.)	V.I.P Fire		
15	G	F&B in front of butcher room								✓		Pro Plus 100K 2005	Kidde		
16	G	F&B in front of Fruit room								✓		Pro Plus 100K 2005	Kidde		
17	G	F&B in front of Bakery room								✓		Pro Plus 100K 2005	Kidde		
18	G	F&B inside Bakery room								✓		Pro Plus 100K 2005	Kidde		
19	G	Engineering Office 1				✓						NON-CFC (10N)	V.I.P Fire		
20	G	Engineering Office 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
21	G	Maintenance work shop 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
22	G	Maintenance work shop 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
23	G	Maintenance work shop 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
24	G	FAVOLA Steward Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
25	G	FAVOLA Kitchen								✓		K01-3	K-Guard		
26	G	SPA Manager room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
27	G	Treatment room 1 (Parvati)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
28	G	Treatment room 2 (Leelawadee)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
29	G	Treatment room 3 (Ratree)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
30	G	Treatment room 4 (Chuanom)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
31	G	Associate & Store room of SPA		✓								10C (CO2 10 lbs.)	V.I.P Fire		
32	G	EV Charger		✓								10C (CO2 10 lbs.)	V.I.P Fire		
33	2	HR Office				✓						NON-CFC (10N)	V.I.P Fire		
34	2	Executive Office 1				✓						NON-CFC (10N)	V.I.P Fire		
35	2	Executive Office 2				✓						NON-CFC (10N)	V.I.P Fire		
36	3	Front Office Department 1				✓						NON-CFC (10N)	V.I.P Fire		
37	3	Front Office Department 2				✓						NON-CFC (10N)	V.I.P Fire		
38	3	Lift service room Angsana		✓								10C (CO2 10 lbs.)	V.I.P Fire		
39	4	Elevator A						✓				10 C	Best		
40	4	Elevator B						✓				10 C	Best		
41	4	Elevator CDE						✓				10 C	Best		
42	G	India Kitchen								✓		Pro Plus 100K 2005	Kidde		
43	G	Gas Station 1						✓				15 lbs (6.9 KG.)	Imperial		
44	G	Gas Station 2						✓				15 lbs (6.9 KG.)	Imperial		
45	G	Gas Station Favola						✓				15 lbs (6.9 KG.)	Imperial		
Total (Tanks)				0	25	0	8	0	6	0	5	0		1	

Fire Cart Check List

No.	Description	TAG	Result		Remark	Model	Manufacturer
			Normal	Disable			
1	Extinguisher Dry Chemical (10 Lbs.) No.1	✓	✓			CN-15	C-NON Fire
2	Extinguisher Dry Chemical (10 Lbs.) No.2	✓	✓			CN-15	C-NON Fire
3	Extinguisher Dry Chemical (10 Lbs.) No.3	✓	✓			TF-15	Top Fire
4	Extinguisher CO2 No.4	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
5	Extinguisher CO2 No.5	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
6	Rope		✓		1 rope		
7	Hydrant 2.5" set		✓		1 set		
8	Axe		✓		1		
9	Fire fighting Suite		✓		3 set		

Spare Tanks (Store in LP Store Room)


NO.	Location	TAG	Fire Extinguisher Spare (Tank)								Model	Manufacturer	Remark
			CO2 10lb		Halotron 10lb		Dry Chemical 10lb		Wet Chemical 10lb				
			Yes	No	Yes	No	Yes	No	Yes	No			
1	Store in Plant room NO. 1	✓			✓						Non CFC (10N)	V.I.P Fire	
2	Store in Plant room NO. 2	✓			✓						10 lbs.	Number 1 Fire	
3	Store in Plant room NO. 3	✓			✓						10 lbs.	Number 1 Fire	
4	Store in Plant room NO. 4	✓									9.0 litres	V.I.P Fire	Foam
5	Store in Plant room NO. 5	✓									FA-10 lbs	Fire Ade	Foam

10	Store in Plant room NO. 11	✓					✓				15 v.(VIP-15 lb)	V.I.P Fire	15 lb.
11	Store in Plant room NO. 12	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
12	Store in Plant room NO. 13	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
13	Store in Plant room NO. 14	✓					✓				NF-15 D	NOFIRE	
14	Store in Plant room NO. 15	✓					✓				15 AG	Angel	
15	Store in Plant room NO. 16	✓					✓				CN-15	C-NON Fire	
		15	1	0	3	0	8	0	0	0			




Emergency Light and Exit Signage Checklist (Angsana)


Checked on Date : 06 April 2024

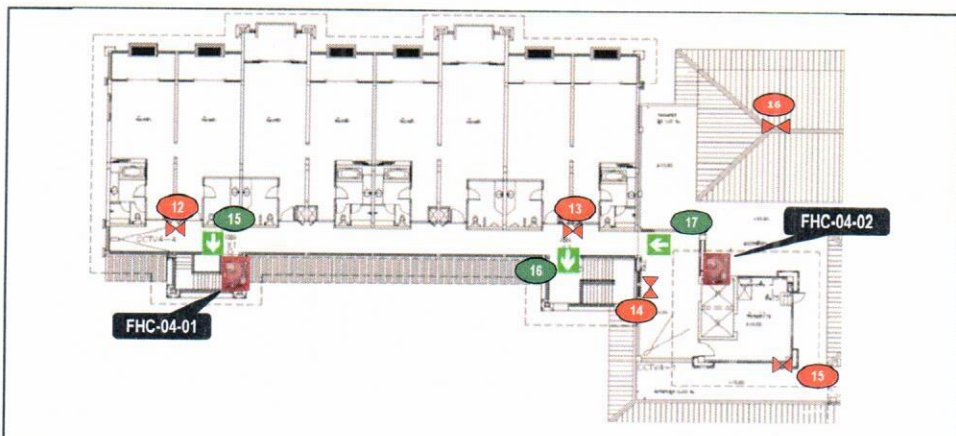


Angsana 4th floor				
No.	Exit Signage	Yes	No	Remark
16		✓		
17		✓		
No.	Emergency Light	Yes	No	Remark
12			X	Out of order
13			X	Out of order
14			X	Out of order
15			X	Out of order
16			X	Out of order

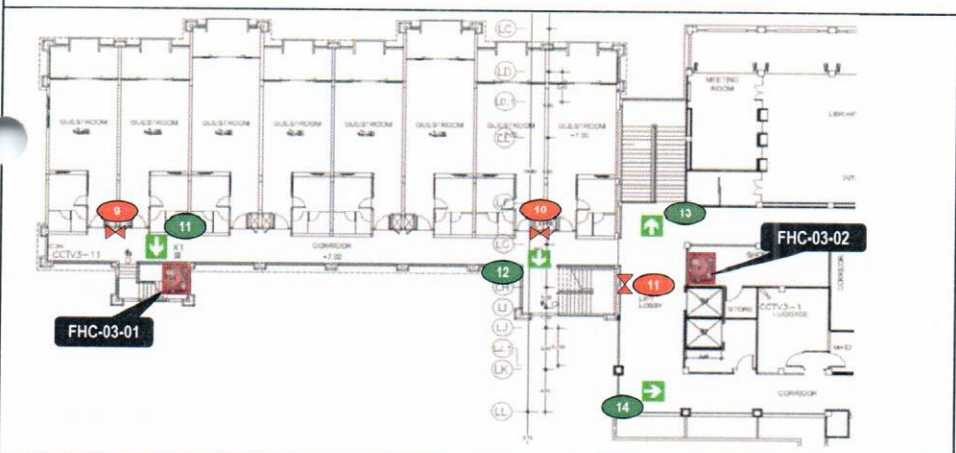


Angsana 3rd floor				
No.	Exit Signage	Yes	No	Remark
11		✓		
12		✓		
13		✓		
14		✓		
No.	Emergency Light	Yes	No	Remark
9			X	Out of order
10			X	Out of order
11		✓		

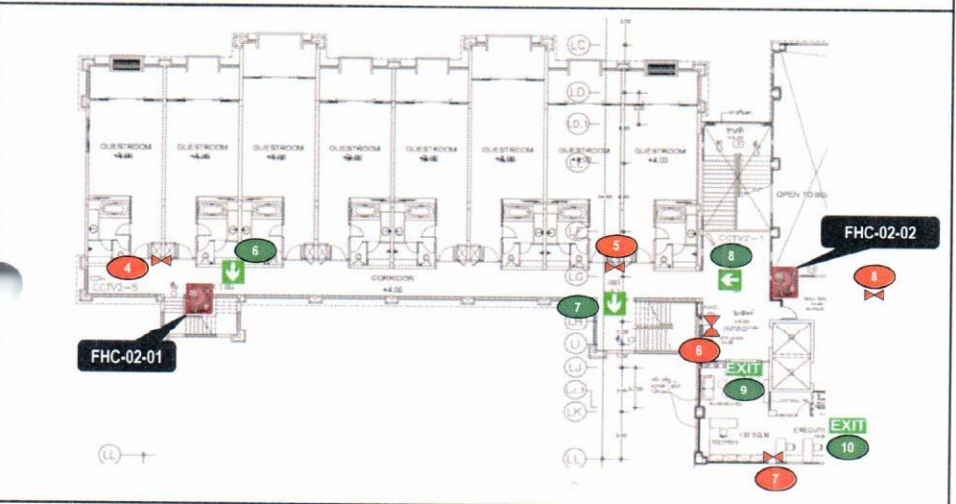


Angsana 2nd floor				
No.	Exit Signage	Yes	No	Remark
6		✓		
7		✓		
8		✓		
9		✓		
10		✓		
No.	Emergency Light	Yes	No	Remark
4			X	Out of order
5			X	Out of order
6			X	Out of order
7			X	Out of order
8			X	Out of order

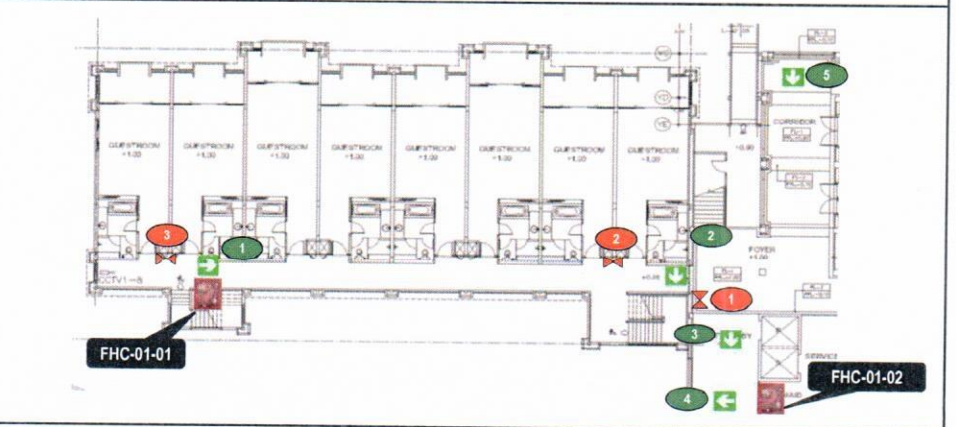


Angsana 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
No.	Emergency Light	Yes	No	Remark
1			X	Out of order
2			X	Out of order
3			X	Out of order

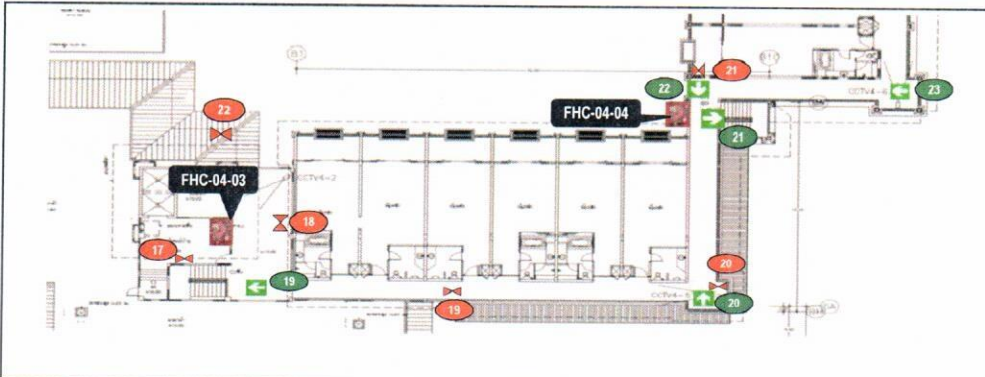


Bamboo 4th floor				
No.	Exit Signage	Yes	No	Remark
19		✓		
20			X	out of order
21		✓		
22		✓		
23		✓		
No.	Emergency Light	Yes	No	Remark
17			X	out of order
18			X	out of order
19			X	out of order
20			X	out of order
21			X	out of order
22			X	out of order

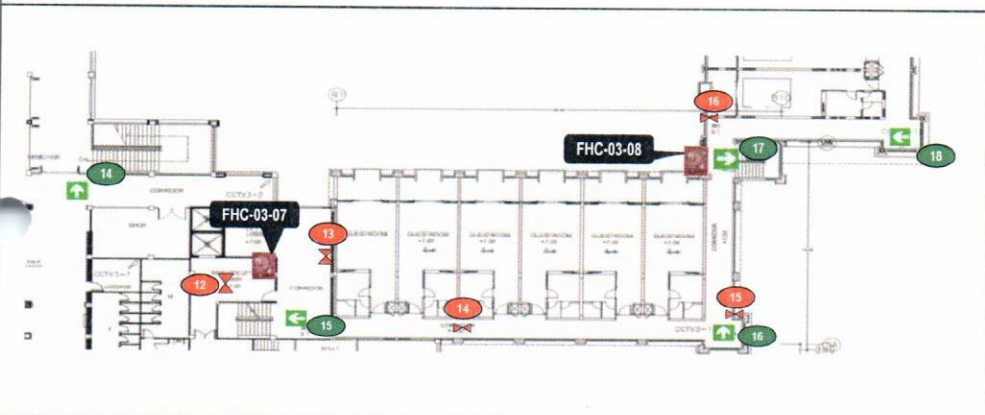


Bamboo 3rd floor				
No.	Exit Signage	Yes	No	Remark
14		✓		
15		✓		
16		✓		
17		✓		
18		✓		
No.	Emergency Light	Yes	No	Remark
12			X	out of order
13			X	out of order
14			X	out of order
15			X	out of order
16			X	out of order

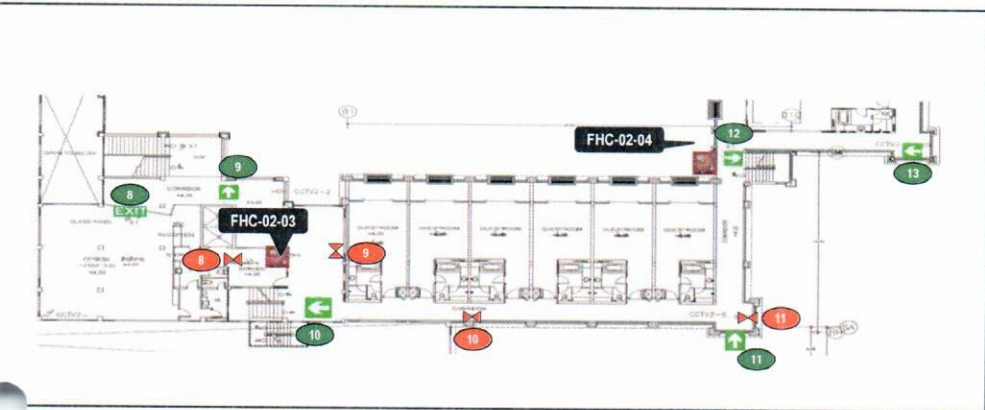


Bamboo 2nd floor				
No.	Exit Signage	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11			X	out of order
12		✓		
13		✓		
No.	Emergency Light	Yes	No	Remark
8			X	out of order
9			X	out of order
10			X	out of order
11			X	out of order

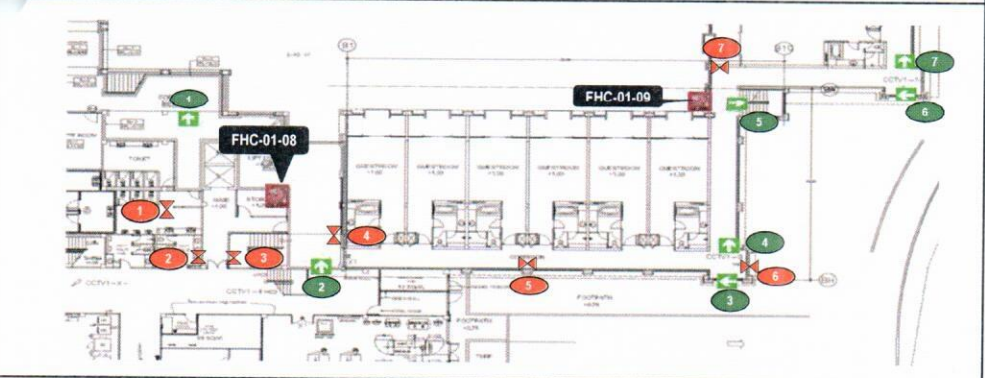


Bamboo 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
6		✓		
7		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3			X	out of order
4		✓		
5			X	out of order
6			X	out of order
7		✓		

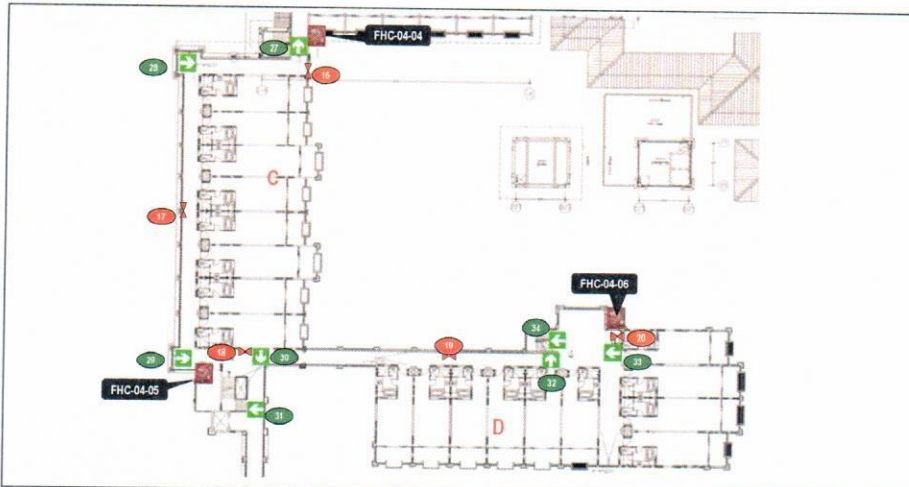


Champa and Dalar 4th floor				
No.	Exit Signage	Yes	No	Remark
27		✓		
28		✓		
29		✓		
30		✓		
31		✓		
32		✓		
33		✓		
34		✓		
No.	Emergency Light	Yes	No	Remark
16			X	out of order
17			X	out of order
18			X	out of order
19			X	out of order
20			X	out of order

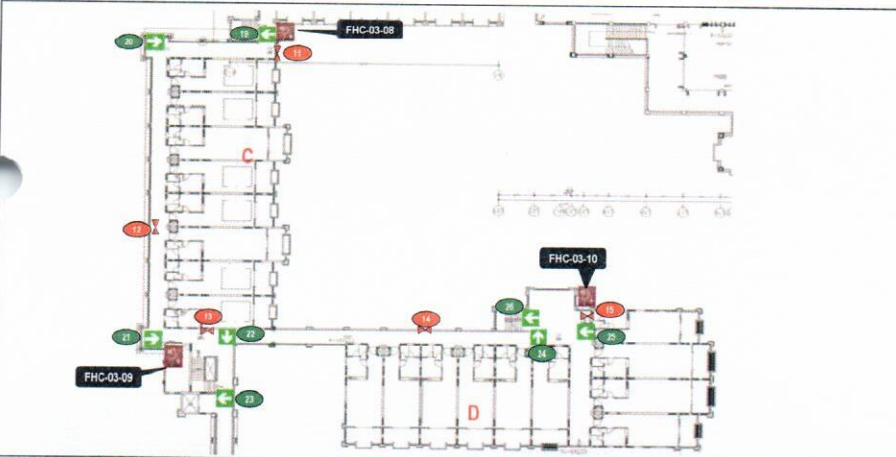

Champa and Dalar 3rd floor				
No.	Exit Signage	Yes	No	Remark
19		✓		
20		✓		
21		✓		
22		✓		
23		✓		
24		✓		
25		✓		
26		✓		
No.	Emergency Light	Yes	No	Remark
11			X	out of order
12			X	out of order
13			X	out of order
14			X	out of order
15			X	out of order

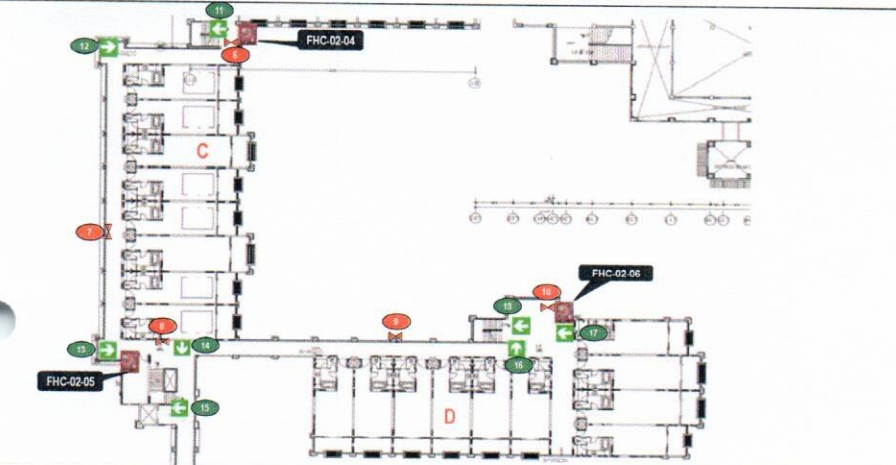


Champa and Dalar 2nd floor				
No.	Exit Signage	Yes	No	Remark
11		✓		
12		✓		
13		✓		
14		✓		
15		✓		
16		✓		
17		✓		
18		✓		
No.	Emergency Light	Yes	No	Remark
6			X	out of order
7			X	out of order
8			X	out of order
9			X	out of order
10			X	out of order

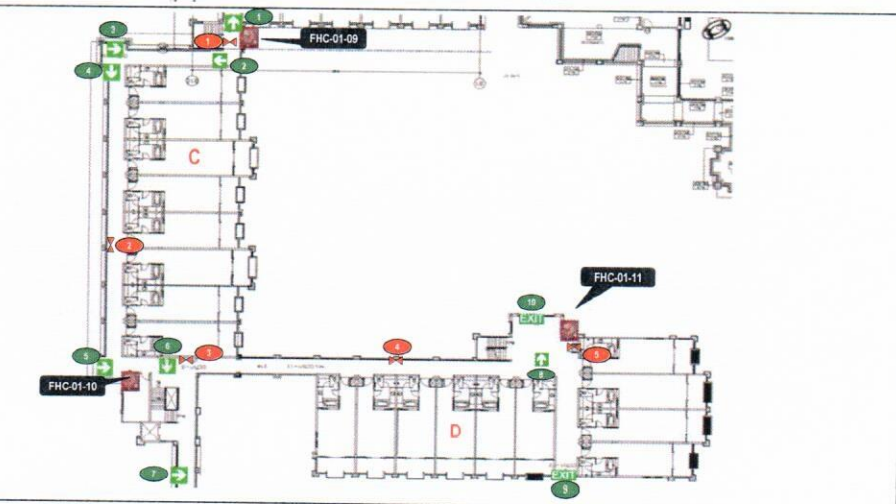

Champa and Dalar 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
6		✓		
7		✓		
8		✓		
9		✓		
10		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3			X	out of order
4			X	out of order
5			X	out of order

Emergency Light and Exit Signage Checklist (Eucalyptus)

Checked on Date: 00 April 2024

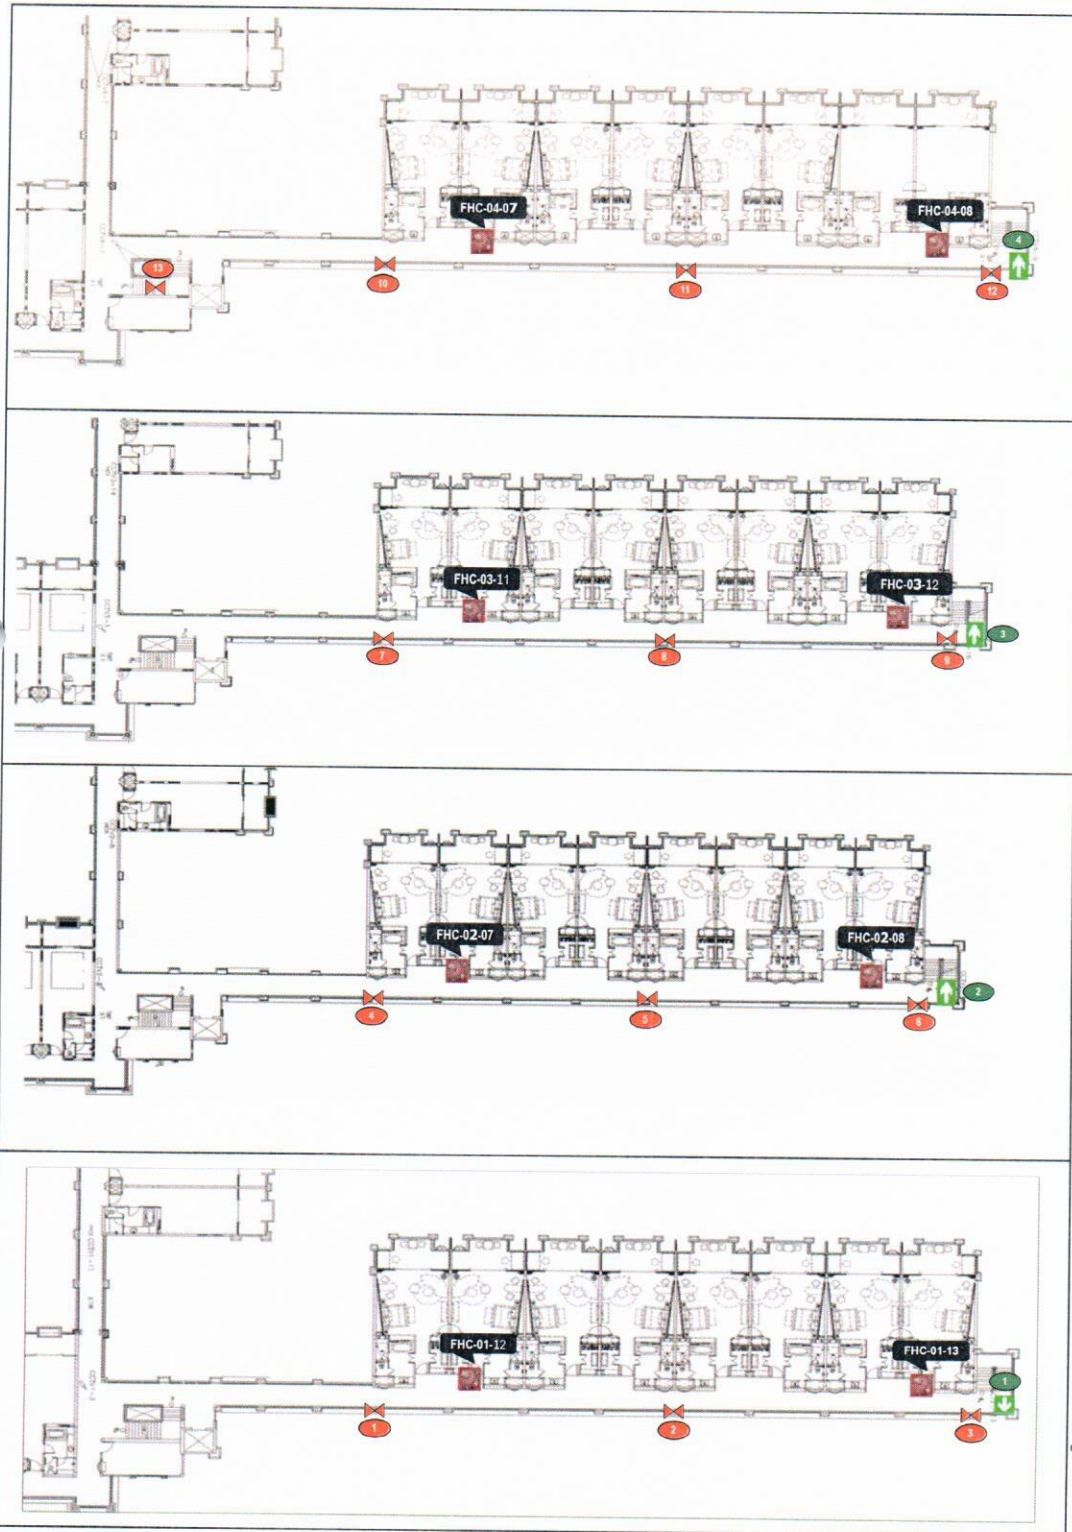

Eucalyptus 4th floor				
No.	Exit Signage	Yes	No	Remark
4		✓		
No.	Emergency Light	Yes	No	Remark
10			X	out of order
11			X	out of order
12			X	out of order
13			X	out of order


Eucalyptus 3rd floor				
No.	Exit Signage	Yes	No	Remark
3		✓		
No.	Emergency Light	Yes	No	Remark
7			X	out of order
8			X	out of order
9			X	out of order

Eucalyptus 2nd floor				
No.	Exit Signage	Yes	No	Remark
2		✓		
No.	Emergency Light	Yes	No	Remark
4			X	out of order
5			X	out of order
6			X	out of order

Eucalyptus 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3			X	out of order

Emergency Light and Exit Signage Checklist (HR Office)

Checked on Date: : 06 April 2024

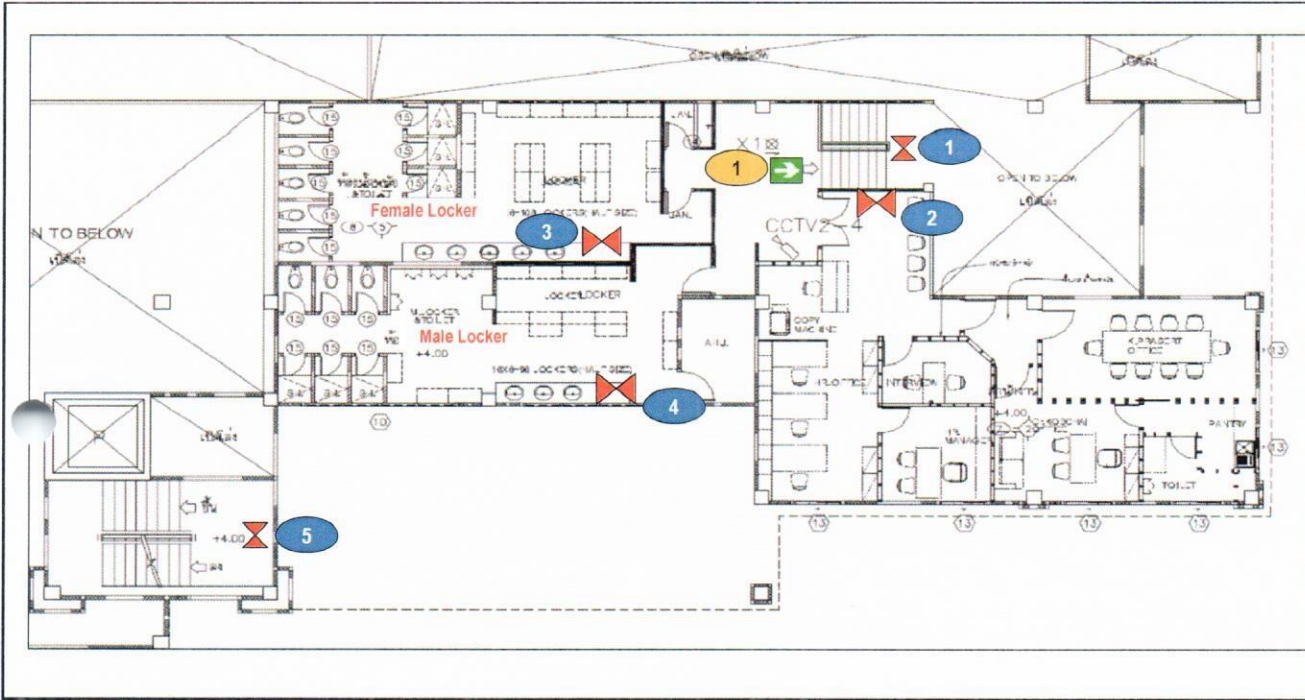


Exit Signage		Location	Status		Remark
			YES	No	
1		Front of HR Office	✓		
Emergency Light		Location	Status		Remark
			YES	No	
1		Stair to HR Office		X	out of order
2		Inside HR Office		X	out of order
		Female Locker Room	✓		
4		Male Locker Room	✓		
5		Stair to Ball Room		X	Remove



Emergency Light and Exit Signage Checklist (Back of the House)

Checked on Date: : 06 April 2024

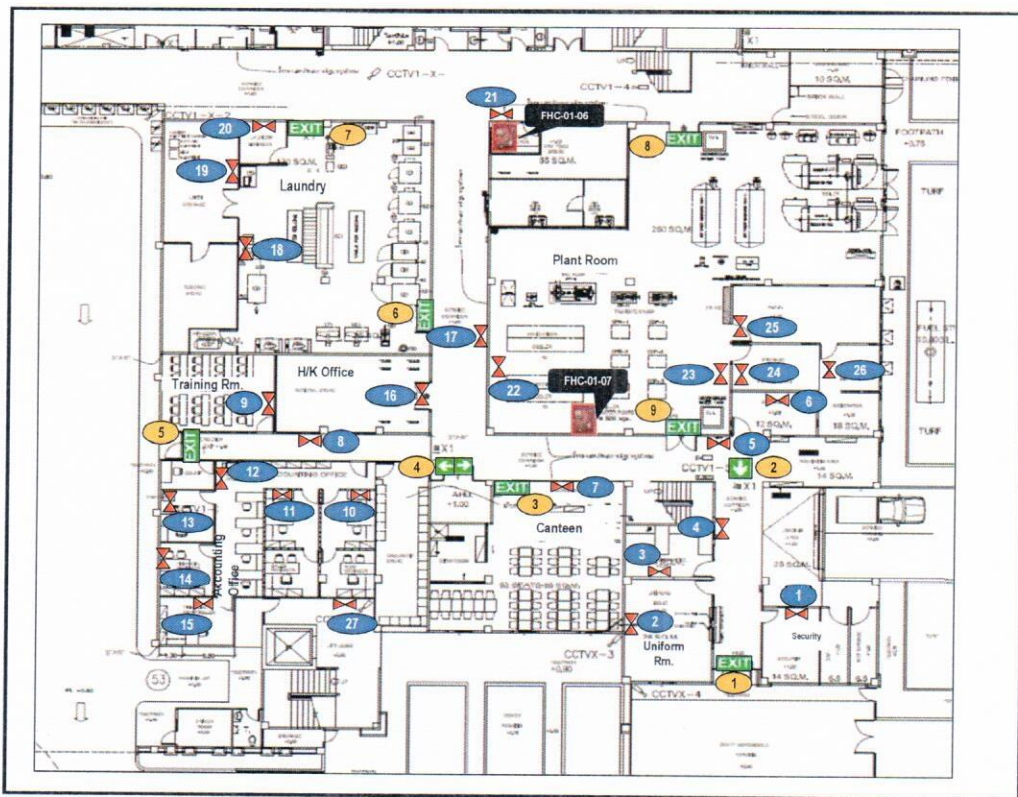


Exit Signage	Location	Status		Remark
		Yes	No	
1	Entrance Time Keeper	✓		
2	Front of First Aid room	✓		
3	Associate Canteen	✓		
4	Canteen Store	✓		
5	Fire Exit door 1	✓		
6	Laundry room 1	✓		
7	Laundry room 2	✓		
8	Plant room 1	✓		
9	Plant room 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Security Office		X	out of order
2	Uniform room		X	out of order
3	Receiving & Purchasing rm.	✓		
4	Front of Purchasing room	✓		
5	Front of Plant room	✓		
6	First Aid room		X	out of order
7	canteen		X	out of order
8	Front of Accounting Office	✓		
9	Training room (FB Office)		X	out of order
10	Reservation room		X	out of order
11	Inside Accounting Office1	✓		
12	Inside Accounting Office2	✓		
13	Cashier room		X	out of order
14	Asst. FC room	✓		
15	FC room	✓		
16	HK Office	✓		
17	Front of Laundry	✓		
18	Front of Laundry Store		X	out of order
19	Inside Laundry Store		X	out of order
20	Landry Office			Remove
21	Front of Steward Office	✓		
22	Plant Room	✓		
23	Front of Plant Room Storage	✓		
24	Inside Plant Room Storage	✓		
25	MDB Room	✓		
26	Generator Room	✓		
27	Building of JAMURCE store		X	out of order

Emergency Light and Exit Signage Checklist (Main Kitchen and Cham Cha)

Checked on Date: : 06 April 2024

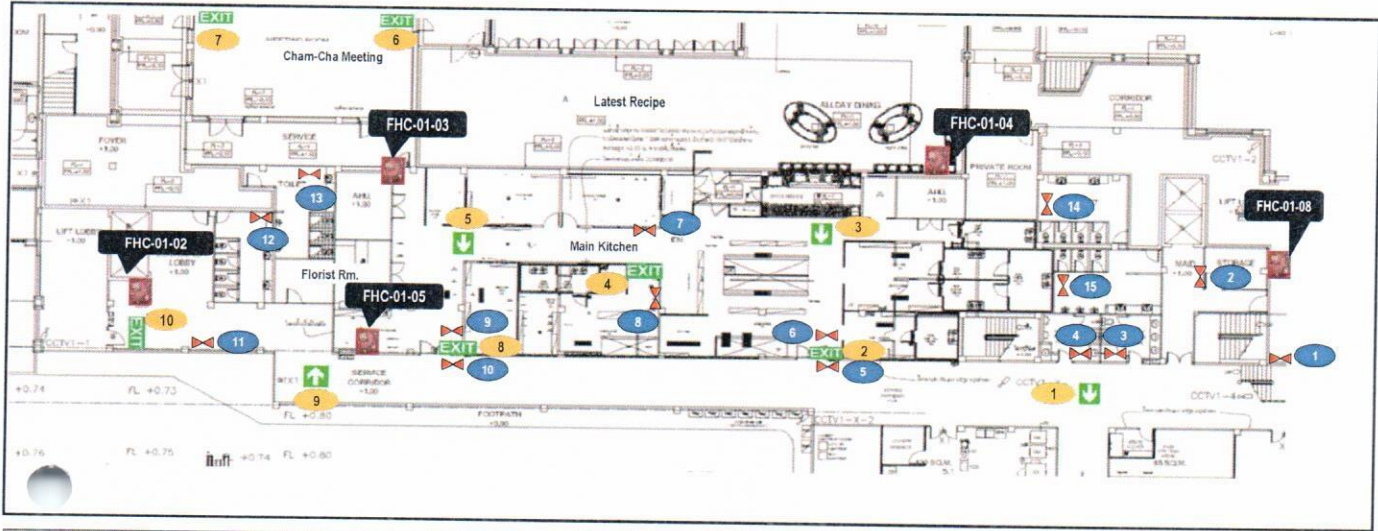


Exit Signage	Location	Status		Remark
		Yes	No	
1	Front of Associate Toilet	✓		
2	Main Kitchen Exit 1	✓		
3	Near Meat Preparation	✓		
4	Bakery room	✓		
5	Near Office Chief	✓		
6	Cham Cha 1	✓		
7	Cham Cha 2	✓		
8	Main Kitchen Exit 2	✓		
9	Opposite Florist room	✓		
10	Fire Exit Door 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Stair to behind Ball Room		X	Remove
2	Front of lift service B		X	out of order
3	Associate Female Toilet		X	out of order
4	Associate Male Toilet		X	out of order
5	Front of Main Kitchen 1	✓		
6	Behind Main Kitchen 1	✓		
7	Front of Bakery Room	✓		
8	Inside Bakery Room	✓		
9	Behind Main Kitchen 2	✓		
10	Front of Main Kitchen 2	✓		
11	Near Florist Room	✓		
12	Cham Cha Guest Female Toilet	✓		
13	Cham Cha Guest male Toilet		X	out of order
14	Near Florist Room	✓		
15	Front of lift service B 3rd floor	✓		
16	Front of lift service B 4nd floor		X	out of order
17	Cham cha Guest male Toilet	✓		
18	Latest Recipe Guest male Toilet		X	Remove
19	Latest Recipe Guest Female Toile		X	out of order

Emergency Light and Exit Signage Checklist Utopia Room & Toilet Utopia FL.2

Checked On Date: : 06 April 2024

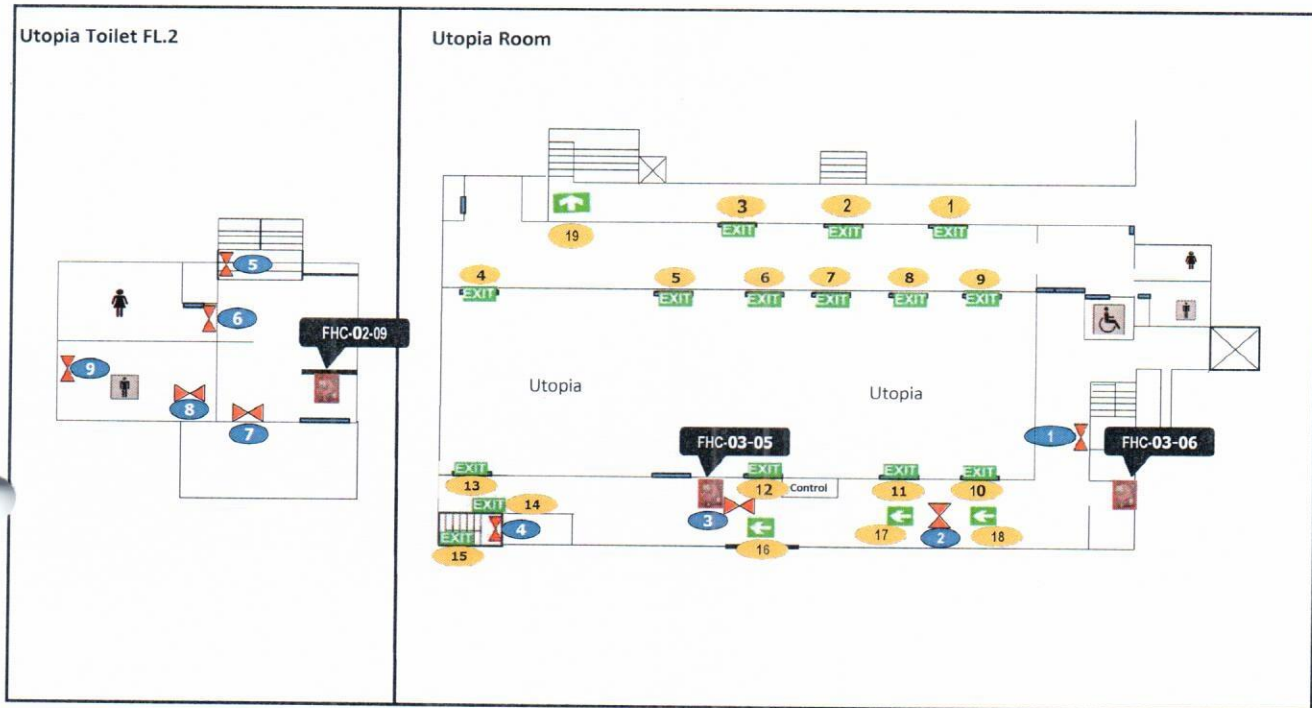


ป้ายหนีไฟ	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	EXIT		X	REMOVE
2	EXIT	✓		
3	EXIT	✓		
4	EXIT	✓		
5	EXIT	✓		
6	EXIT	✓		
7	EXIT	✓		
8	EXIT	✓		
9	EXIT	✓		
10	EXIT	✓		
11	EXIT	✓		
12	EXIT	✓		
13	EXIT	✓		
14	EXIT		X	out of order
15	EXIT		X	out of order
16	←		X	REMOVE
17	←		X	REMOVE
18	←		X	REMOVE
19	←	✓		

ไฟฉุกเฉิน	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	Building of Utopia		X	REMOVE
2	Back of Utopia Rm.		X	REMOVE
3	Back of Utopia Rm.		X	REMOVE
4	Stair exit building Utopia Rm.		X	REMOVE
5	Stair JAMJUREE FL.2	✓		
6	Female toilet of Utopia FL.2	✓		
7	Male toilet of Utopia FL.2	✓		
8	In female toilet of Utopia FL.2		X	REMOVE
8	In male toilet of Utopia FL.2		X	REMOVE
9	Utopia Fire Escape		X	out of order

Emergency Light and Exit Signage Checklist (Lobby)

Checked on Date : 06 April 2024

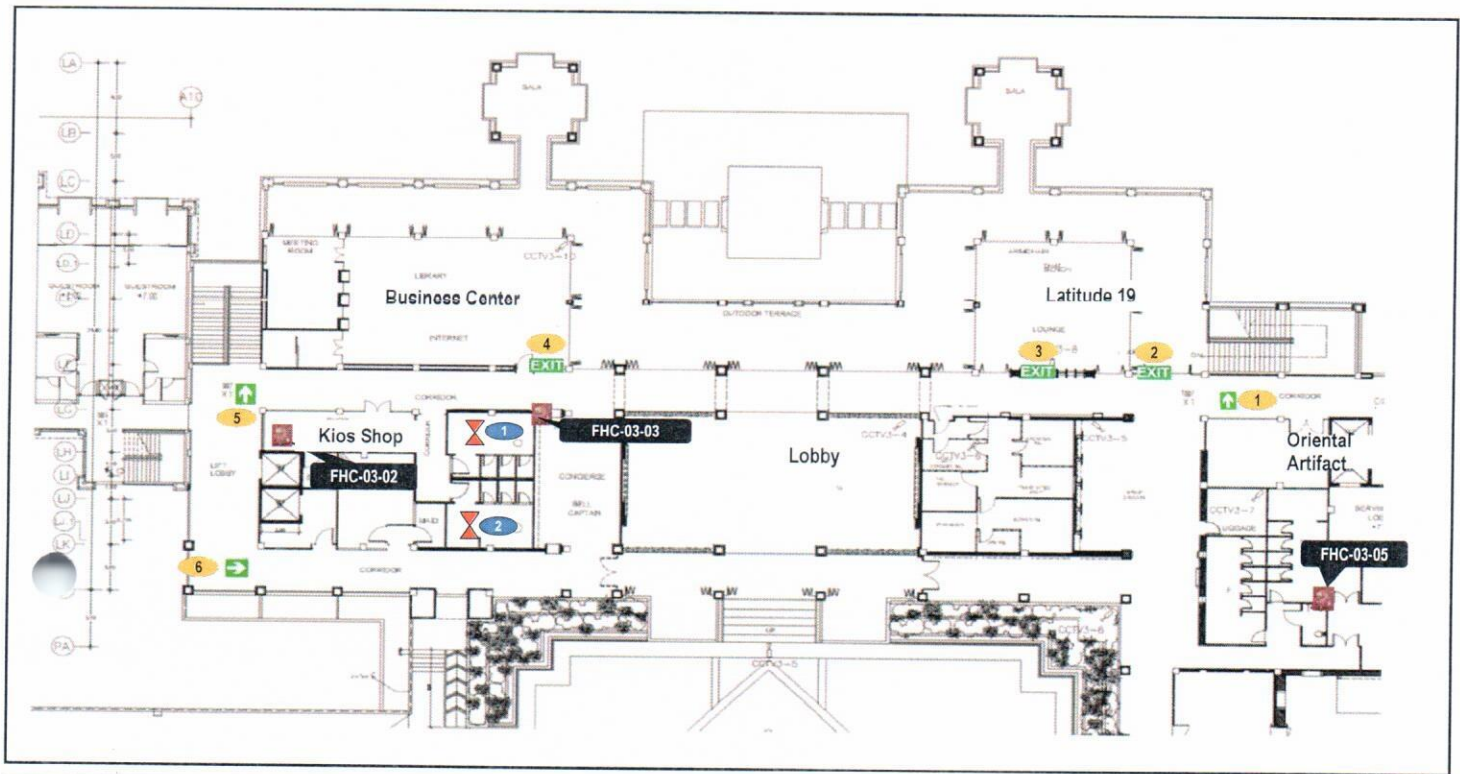


Exit Signage	Location	Status		Remark
		Yes	No	
1	Latitude 19 Stair	✓		
2	Latitude 19 Exit 1	✓		
3	Latitude 19 Exit 2	✓		
4	Library Exit	✓		
5	Kios Stair	✓		
6	Conner Corridor Concierge	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Guest Toilet (Female)	✓		
2	Guest toilet (Male)	✓		



Emergency Light and Exit Signage Checklist (Carpark and Engineer Office)

Checked on Date: : 06 April 2024

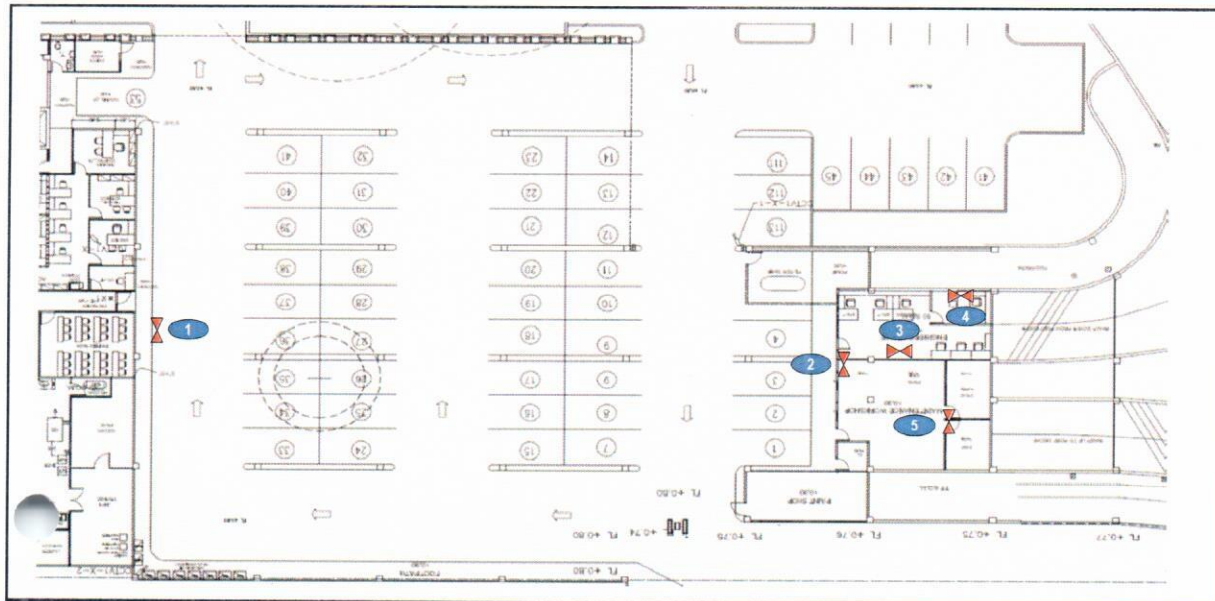


Exit Signage	Location	Status		Remark
		Yes	No	
1	Emergency Exit door		X	out of order
2	In front of Eng Office		X	out of order
3	Engineering Office		X	out of order
4	Chief Engineering office		X	REMOVE
5	Maintenance Shop		X	out of order



Emergency Light and Exit Signage Checklist (Favola Restaurant)

Checked on Date: : 06 April 2024

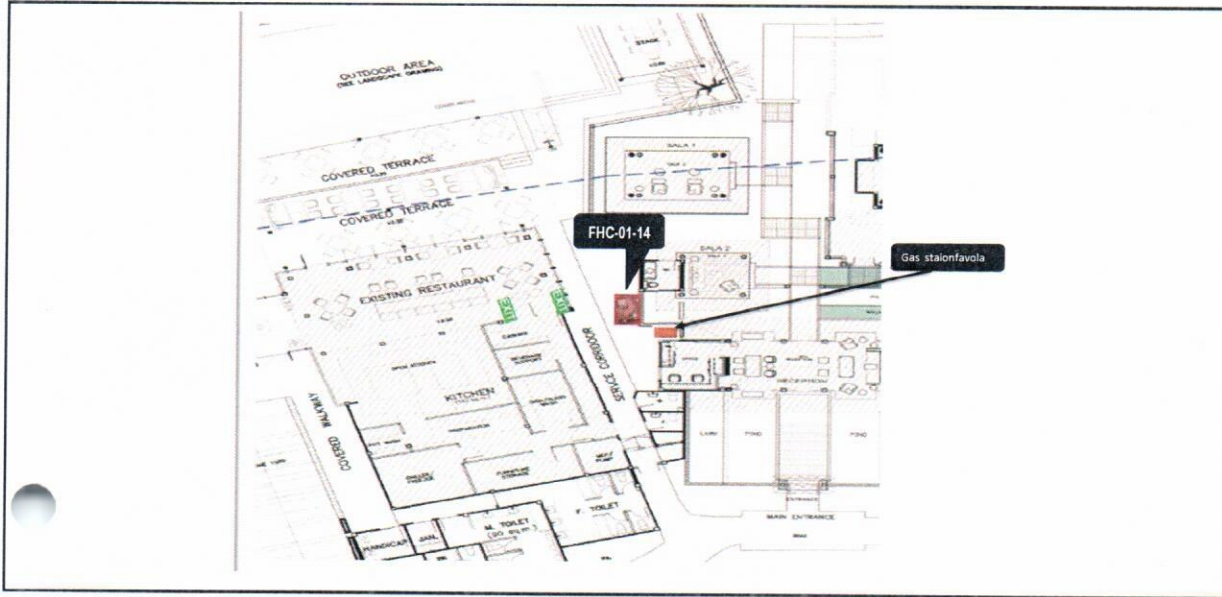


Inside Fire Host Cabinet				
Hose Rack 30	Nozzle	Hydrant Valve 2.5	Extinguisher	Axe

Exit	Signage	Location	Status		Remark
			Yes	No	
1	EXIT	Favola Exit 1	✓		
2	EXIT	Favola Exit 2	✓		
3	EXIT	TBA			



Emergency Light and Exit Signage Checklist (Spa)

Checked on Date : 06 April 2024

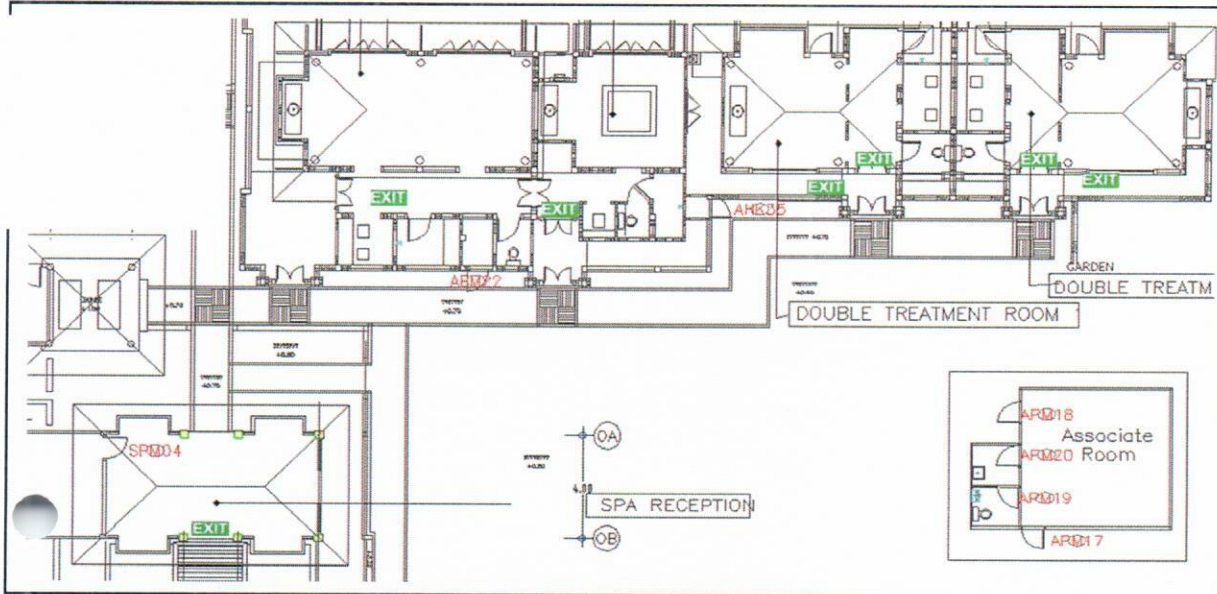

Exit Signage	Location	Status		Remark
		Yes	No	
1	EXIT Pavati Spa entrance	✓		
2	EXIT Leelawadee Spa entrance	✓		
3	EXIT Ratree Spa entrance	✓		
4	EXIT Ratree Spa	✓		
5	EXIT Chuanchom Spa entrance	✓		
6	EXIT Chuanchom Spa		x	out of order
7	EXIT Spa entrance		x	out of order

Emergency light	Location	Status		Remark
		Yes	No	
1	Generator room	✓		



Summary Fire Equipment Report

Month: 05 May 2024

Extinguisher Tank	Location				Total
	B.O.H.	F.H.C.	Fire Cart	Spare Tank	
1. CO2	26	6	1	0	33
2. Halotron	8	0	0	1	9
3. Dry Chemical	0	38	3	7	48
4. Wet Chemical	3	0	0	0	3
5. Form	3	0	0	0	3
Total	40	44	4	8	96

Remark: Spare tank have kept in store inside Security Store room and fire cart has set nearby Store Keeper.

Back of the House (B.O.H)			
Type of tank	Quantity	Status	
		Yes	No
1. CO2	26	26	0
2. Halotron	8	8	0
3. Wet Chemical	3	4	0
4. Form	3	3	0
Total	40	41	0

Fire Hose Cabinet (F.H.C.)			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	38	38	0
2 CO2	6	6	0
Total	44	44	0

Fire Cart			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	3	3	0
2 CO2	1	1	0
Total	4	4	0

Spare Store			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	13	13	0
2. Halotron	4	4	0
Total	17	17	0

Other Equipment			
	Quantity	Status	
		Yes	No
1. Fire Blanket	5	5	0
2. Clothing Protect Heat	3	3	0
Total	8	8	0

Remark: The Clothing Protect Heat are kept in Hanger Cabinet nearby Fire Cart.

Other Emergency light / Signage	Status	Location										Total
		A	B	C-D	E	HR	BOH	UTOPIA	MK	LOBBY	ENG	
1. Emergency light	ALL	15	21	20	12	5	27	10	18	2	5	135
	YES	15	19	14	6	2	11	3	6	2	0	78
	NO	1	2	6	6	1	13	1	9	0	5	44
	Remove	0	0	0	0	1	3	6	3	0	1	14
2. Exit signage	ALL	2	1	2	0	0	7	15	6	3	0	36
	YES	2	1	2	0	0	7	15	6	3	0	36
	NO	0	0	0	0	0	1	0	0	0	0	1
3. Arrow point signage	ALL	15	22	32	4	1	2	4	4	3	0	87
	YES	14	22	30	4	1	2	3	3	3	0	82
	NO	1	0	2	0	0	2	1	1	0	0	7

Fire Hose Cabinet Checklist

Checked on Date: 05 May 2024

No.	Floor	Register No.	Location	Inside Fire Host Cabinet						Model	Manufacture	Remark
				Hose Rack 30 M. 1.5 Inc	Nozzle	Hydrant Valve 2.5	Extinguisher					
							Tag	Yes	No			
1st Floor												
1	1	FHC 01-01	Corridor A in front of room 1102							6.8 KGS.(ST-15 lbs.)	SATURN	
2	1	FHC 01-02	Corridor A beside guest elevator							6.8 KGS.(ST-15 lbs.)	SATURN	
3	1	FHC 01-03	Back of Cham Cha room(CO2)							10 C	V.I.P Fire	
4	1	FHC 01-04	Inside Latest Recipe (CO2)							10 lbs.	Best	
5	1	FHC 01-05	Near Main Kitchen door							10V (VIP-10lbs.)	V.I.P Fire	
6	1	FHC 01-06	Beside Chief Steward Office							6.8 KGS.(ST-15 lbs.)	SATURN	
7	1	FHC 01-07	In front of staff canteen							6.8 KGS.(15lbs.)	Brake Fire	
8	1	FHC 01-08	Corridor B beside guest elevator (Latest Recipe)							6.8 KGS.(ST-15 lbs.)	SATURN	
9	1	FHC 01-09	Building B in front of stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
10	1	FHC 01-10	Building C in front of pantry room							CN-15	C-NON Fire	
11	1	FHC 01-11	Building D near guest room 4101							FM-15 lbs. 6.8 KGS.	Fire Man Rescue	
12	1	FHC 01-12	Building E near guest room 5103							10 lbs.(5 KGS.) 4A:2B	WILL	
13	1	FHC 01-13	Building E near guest room 5107							10 lbs.(5 KGS.) 4A:2B	WILL	
14	1	FHC 01-14	Favola							6.8 KGS.(ST-15 lbs.)	SATURN	☒Axe
15	1	FHC 01-15	Spa							6.8 KGS.(ST-15 lbs.)	SATURN	☒Axe
2nd Floor												
16	2	FHC 02-01	Corridor A in front of guest room 1202							6.8 KGS.(ST-15 lbs.)	SATURN	
17	2	FHC 02-02	Corridor A in front of Executive office							6.8 KGS.(ST-15 lbs.)	SATURN	
18	2	FHC 02-03	Corridor B beside guest elevator (near fitness)							6.8 KGS.(ST-15 lbs.)	SATURN	
19	2	FHC 02-04	Building B in front of stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
20	2	FHC 02-05	Building C corridor in front of pantry room							6.8 KGS.(ST-15 lbs.)	SATURN	
21	2	FHC 02-06	Building D near guest room 4201							6.8 KGS.(ST-15 lbs.)	SATURN	
22	2	FHC 02-07	Building E near guest room 5203							CN-15	C-NON Fire	
23	2	FHC 02-08	Building E near guest room 5207							10 lbs.(5 KGS.) 4A:2B	WILL	
24	2	FHC 02-09	Toilet Utopia Fl.2(CO2)							10 lbs.(5 KGS.) 4A:2B	WILL	
3rd Floor												
25	3	FHC 03-01	Corridor in front of guest room 1302							10 lbs.	Best	
26	3	FHC 03-02	Corridor A near Kiosk shop							6.8 KGS.(ST-15 lbs.)	SATURN	
27	3	FHC 03-03	In front of Business Center							6.8 KGS.(ST-15 lbs.)	SATURN	
28	3	FHC 03-04	In front of Lobby Latitude 19 (Dry Chemical)							6.8 KGS.(ST-15 lbs.)	SATURN	
			In front of Lobby Latitude 19 (CO ₂)							6.8 KGS.(ST-15 lbs.)	SATURN	
29.1	3	FHC 03-05	Back of Utopia room(CO2)							10 lbs.	EXTRA	
29.2	3	FHC 03-05	Back of Utopia room(CO2)							10 lbs.	BEST	
29.3	3	FHC 03-05	Back of Utopia room(CO2)							10 lbs.	EXTRA	
30.1	3	FHC 03-06	Building of Utopia room (CO2)							10 lbs.	EXTRA	
30.2	3	FHC 03-06	Building of Utopia room (CO2)							10 lbs.	EXTRA	
30.3	3	FHC 03-06	Building of Utopia room (CO2)							10 lbs.	EXTRA	
31	3	FHC 03-07	Corridor B beside guest elevator							6.8 KGS.(ST-15 lbs.)	SATURN	
32	3	FHC 03-08	Building B in front of stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
33	3	FHC 03-09	Corridor Building C front of pantry room							6.8 KGS.(ST-15 lbs.)	SATURN	
34	3	FHC 03-10	Building D near guest room 4301							6.8 KGS.(ST-15 lbs.)	SATURN	
35	3	FHC 03-11	Building E near guest room 5303							10 lbs.(5 KGS.) 4A:2B	WILL	
36	3	FHC 03-12	Building E near guest room 5307							10 lbs.(5 KGS.) 4A:2B	WILL	
4th Floor												
37	4	FHC 04-01	Corridor A in front of guest room 1402							6.8 KGS.(ST-15 lbs.)	SATURN	
38	4	FHC 04-02	Corridor A near guest elevator							6.8 KGS.(ST-15 lbs.)	SATURN	
39	4	FHC 04-03	Corridor B beside guest elevator							6.8 KGS.(ST-15 lbs.)	SATURN	
40	4	FHC 04-04	Building B near stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
41	4	FHC 04-05	Building C Corridor in front of pantry room							6.8 KGS.(ST-15 lbs.)	SATURN	
42	4	FHC 04-06	Building D near guest room 4401							6.8 KGS.(ST-15 lbs.)	SATURN	
43	4	FHC 04-07	Building E near guest room 5403							10 lbs.(5 KGS.) 4A:2B	WILL	
44	4	FHC 04-08	Building E near guest room 5407							10C (CO2 10 lbs.)	V.I.P Fire	

Summary : The total of 44 fire host cabinets.

Parameter	Total (Location)	Status		Remark
		Normal	Abnormal	
Hose Rack 30 m. 1.5 inc.	44	44	0	
Nozzle	44	44	0	
Hydrant Valve 2.5	44	44	0	
Dry Chemical Extinguisher	38	38	0	
CO2 Extinguisher	6	6	0	
The Fire hose cabinet door closer	44	44	0	

Fire Extinguisher (Hanged Alone) Checklist

Checked on Date : 05 May 2024

No.	Floor	Locations	TAG	CO2 10lb		Halotron 10 lb		Dry chemical 10 lb		WetChemical 10lb		Model	Manufacturer	Fire Blanket	Remark	
				Yes	No	Yes	No	Yes	No	Yes	No					
1	G	Receiving Area		✓								10C (CO2 10 lbs.)	V.I.P Fire			
2	G	in front of Canteen room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
3	G	Accounting Office 1				✓						NON-CFC (10N)	V.I.P Fire			
4	G	Accounting Office 2				✓						NON-CFC (10N)	V.I.P Fire			
5	G	Laundry Room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire			
6	G	Laundry Room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
7	G	Laundry Room 3 (Store Laundry)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
8	G	Generator room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
9	G	MDB Room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
10	G	Plant room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire			
11	G	Plant room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
12	G	Plant room 3		✓								10C (CO2 10 lbs.)	V.I.P Fire			
13	G	Plant room 4		✓								10C (CO2 10 lbs.)	V.I.P Fire			
14	G	F&B in Pantry room behind Latest Recipe		✓								10C (CO2 10 lbs.)	V.I.P Fire			
15	G	F&B in front of butcher room								✓		Pro Plus 100K 2005	Kidde			
16	G	F&B in front of Fruit room								✓		Pro Plus 100K 2005	Kidde			
17	G	F&B in front of Bakery room								✓		Pro Plus 100K 2005	Kidde			
18	G	F&B inside Bakery room								✓		Pro Plus 100K 2005	Kidde			
19	G	Engineering Office 1				✓						NON-CFC (10N)	V.I.P Fire			
20	G	Engineering Office 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
21	G	Maintenance work shop 1		✓								10C (CO2 10 lbs.)	V.I.P Fire			
22	G	Maintenance work shop 2		✓								10C (CO2 10 lbs.)	V.I.P Fire			
23	G	Maintenance work shop 3		✓								10C (CO2 10 lbs.)	V.I.P Fire			
24	G	FAVOLA Steward Area		✓								10C (CO2 10 lbs.)	V.I.P Fire			
25	G	FAVOLA Kitchen								✓		K01-3	K-Guard			
26	G	SPA Manager room		✓								10C (CO2 10 lbs.)	V.I.P Fire			
27	G	Treatment room 1 (Parvati)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
28	G	Treatment room 2 (Leelawadee)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
29	G	Treatment room 3 (Ratree)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
30	G	Treatment room 4 (Chuanchom)		✓								10C (CO2 10 lbs.)	V.I.P Fire			
31	G	Associate & Store room of SPA		✓								10C (CO2 10 lbs.)	V.I.P Fire			
32	G	EV Charger		✓								10C (CO2 10 lbs.)	V.I.P Fire			
33	2	HR Office				✓						NON-CFC (10N)	V.I.P Fire			
34	2	Executive Office 1				✓						NON-CFC (10N)	V.I.P Fire			
35	2	Executive Office 2				✓						NON-CFC (10N)	V.I.P Fire			
36	3	Front Office Department 1				✓						NON-CFC (10N)	V.I.P Fire			
37	3	Front Office Department 2				✓						NON-CFC (10N)	V.I.P Fire			
38	3	Lift service room Angsana		✓								NON-CFC (10N)	V.I.P Fire			
39	4	Elevator A						✓				10 C	Best			
40	4	Elevator B						✓				10 C	Best			
41	4	Elevator CDE						✓				10 C	Best			
42	G	India Kitchen								✓		Pro Plus 100K 2005	Kidde			
43	G	Gas Station 1						✓				15 lbs (6.9 KG.)	Imperial			
44	G	Gas Station 2						✓				15 lbs (6.9 KG.)	Imperial			
45	G	Gas Station Favola						✓				15 lbs (6.9 KG.)	Imperial			
Total (Tanks)				0	25	0	8	0	6	0	5	0			1	

Fire Cart Check List

No.	Description	TAG	Result		Remark	Model	Manufacturer
			Normal	Disable			
1	Extinguisher Dry Chemical (10 Lbs.) No.1	✓	✓			CN-15	C-NON Fire
2	Extinguisher Dry Chemical (10 Lbs.) No.2	✓	✓			CN-15	C-NON Fire
3	Extinguisher Dry Chemical (10 Lbs.) No.3	✓	✓			TF-15	Top Fire
4	Extinguisher CO2 No.4	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
5	Extinguisher CO2 No.5	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
6	Rope		✓		1 rope		
7	Hydrant 2.5" set		✓		1 set		
8	Axe		✓		1		
9	Fire fighting Suite		✓		3 set		

Spare Tanks (Store in LP Store Room)


[illegible]

10	Store in Plant room NO. 11	✓					✓				15 v.(VIP-15 lb)	V.I.P Fire	15 lb.
11	Store in Plant room NO. 12	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
12	Store in Plant room NO. 13	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
13	Store in Plant room NO. 14	✓					✓				NF-15 D	NOFIRE	
14	Store in Plant room NO. 15	✓					✓				15 AG	Angel	
15	Store in Plant room NO. 16	✓					✓				CN-15	C-NON Fire	
		15	1	0	3	0	8	0	0	0			




Emergency Light and Exit Signage Checklist (Angsana)


Checked on Date: 05 May 2024

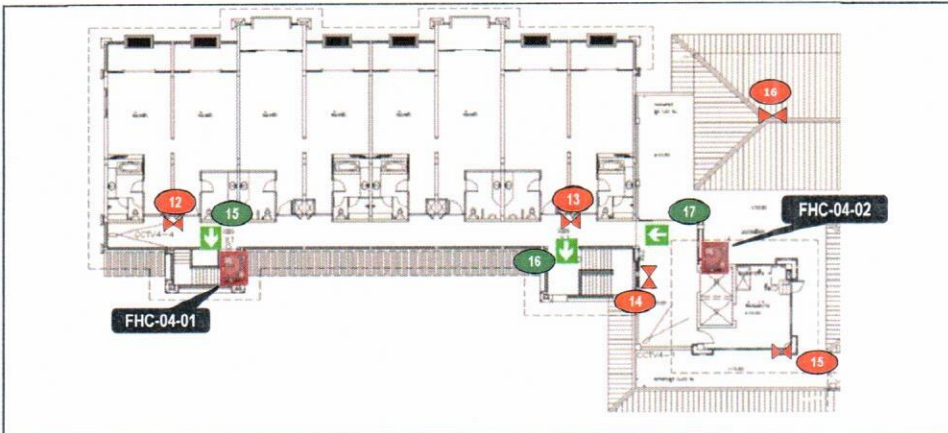


Angsana 4th floor				
No.	Exit Signage	Yes	No	Remark
15		✓		
16		✓		
17		✓		
No.	Emergency Light	Yes	No	Remark
12			X	out of order
13			X	out of order
14			X	out of order
15			X	out of order
16			X	out of order

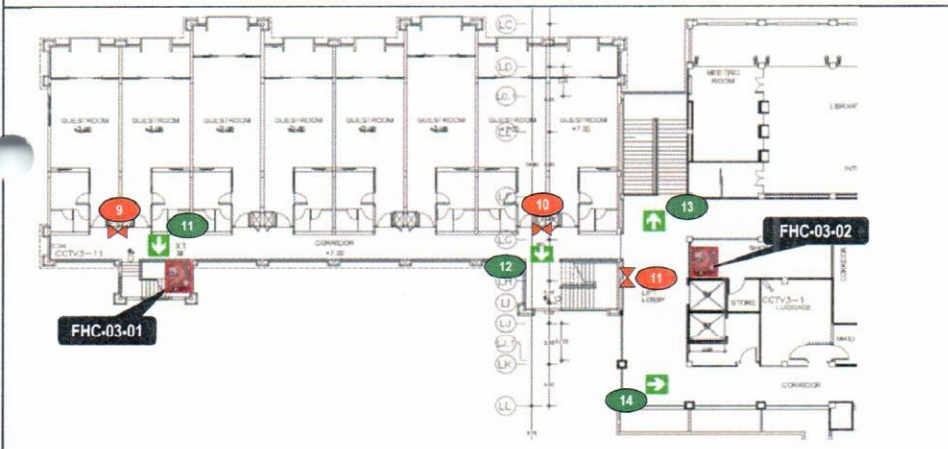

Angsana 3rd floor				
No.	Exit Signage	Yes	No	Remark
11		✓		
12		✓		
13		✓		
14		✓		
No.	Emergency Light	Yes	No	Remark
9			X	out of order
10			X	out of order
11		✓		

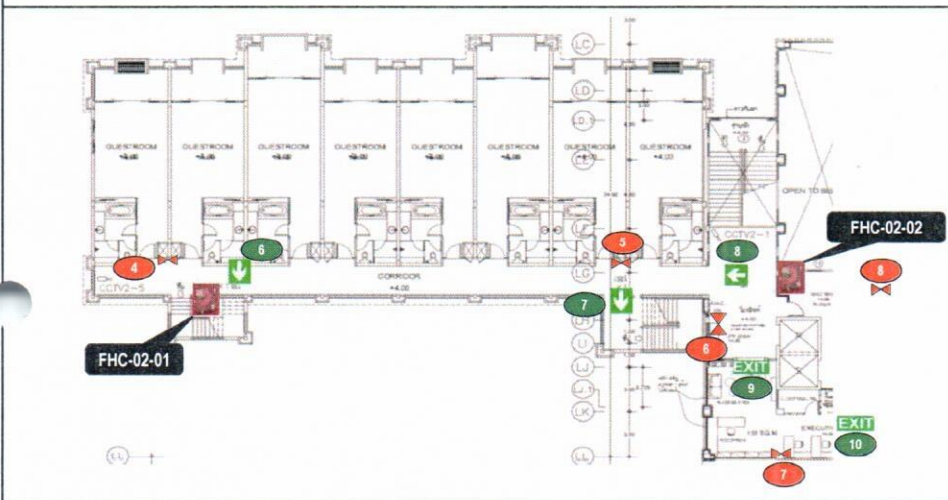


Angsana 2nd floor				
No.	Exit Signage	Yes	No	Remark
6		✓		
7		✓		
8		✓		
9		✓		
10		✓		
No.	Emergency Light	Yes	No	Remark
4			X	Out of order
5			X	Out of order
6			X	Out of order
7			X	Out of order
8			X	Out of order
9			X	Out of order
10			X	Out of order

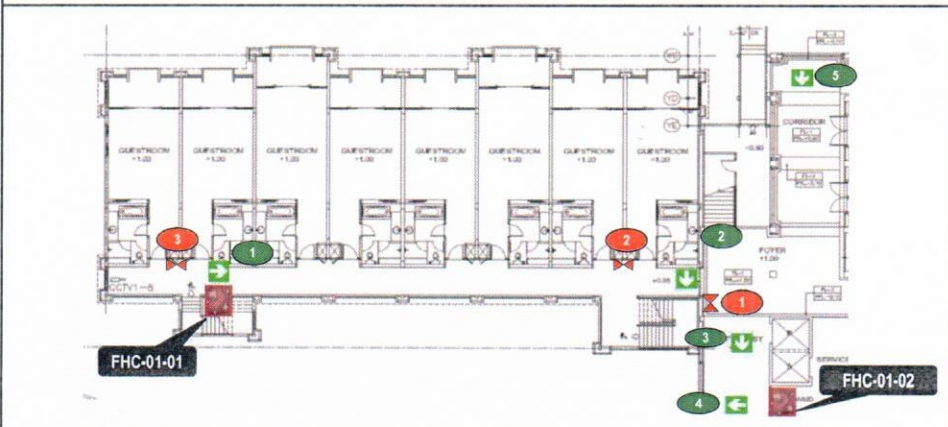


Angsana 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
No.	Emergency Light	Yes	No	Remark
1			X	Out of order
2			X	Out of order
3			X	Out of order

Emergency Light and Exit Signage Checklist (Bamboo)


Checked on Date: 05 May 2024

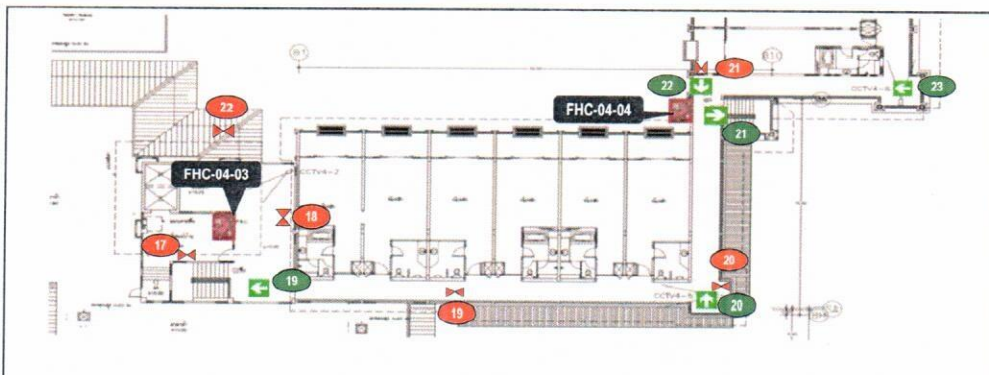


Bamboo 4th floor				
No.	Exit Signage	Yes	No	Remark
19		✓		
20			X	out of order
21		✓		
22		✓		
23		✓		
No.	Emergency Light	Yes	No	Remark
17			X	out of order
18			X	out of order
19			X	out of order
20			X	out of order
21			X	out of order
22			X	out of order

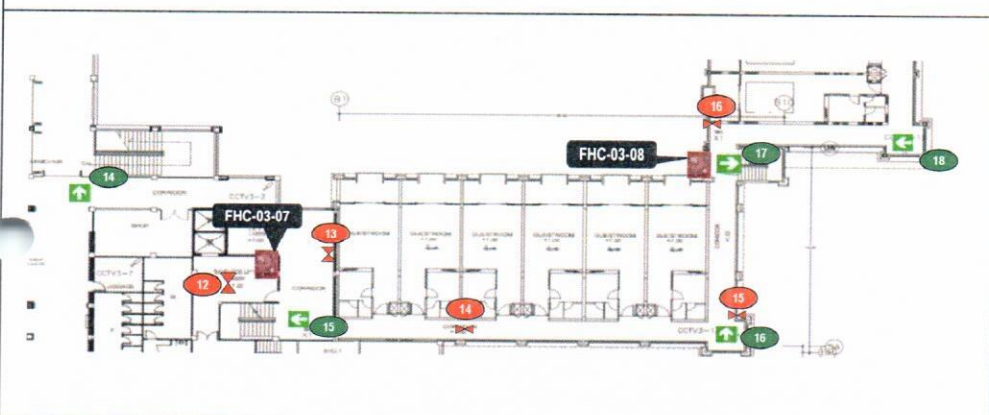

Bamboo 3rd floor				
No.	Exit Signage	Yes	No	Remark
14		✓		
15		✓		
16		✓		
17		✓		
18		✓		
No.	Emergency Light	Yes	No	Remark
12			X	out of order
13			X	out of order
14			X	out of order
15			X	out of order
16			X	out of order

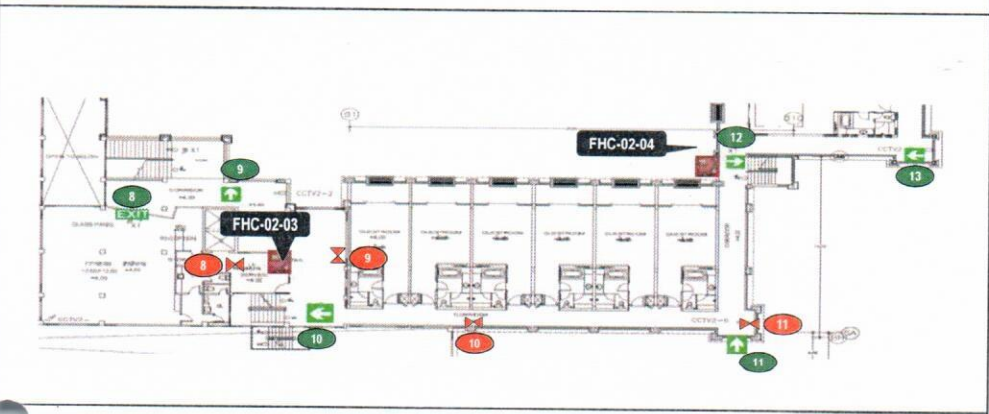

Bamboo 2nd floor				
No.	Exit Signage	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11			X	out of order
12		✓		
13		✓		
No.	Emergency Light	Yes	No	Remark
8			X	out of order
9			X	out of order
10			X	out of order
11			X	out of order

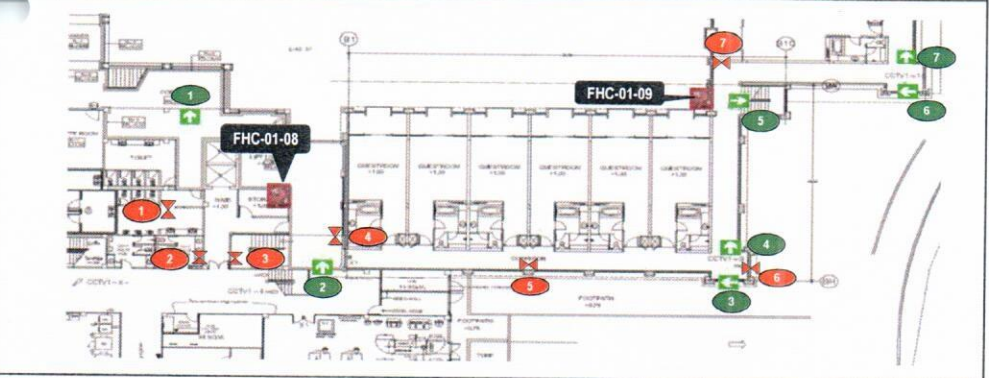


Bamboo 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
6		✓		
7		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3			X	out of order
4		✓		
5			X	out of order
6			X	out of order
7		✓		

Champa and Dalar 4th floor				
No.	Exit Signage	Yes	No	Remark
27	✓	✓		
28	✓	✓		
29	✓	✓		
30	✓	✓		
31	✓	✓		
32	✓	✓		
33	✓	✓		
34	✓	✓		
No.	Emergency Light	Yes	No	Remark
	✗		X	out of order
	✗		X	out of order
	✗		X	out of order
	✗		X	out of order
	✗		X	out of order

Champa and Dalar 3rd floor				
No.	Exit Signage	Yes	No	Remark
19	✓	✓		
20	✓	✓		
21	✓	✓		
22	✓	✓		
23	✓	✓		
24	✓	✓		
25	✓	✓		
26	✓	✓		
No.	Emergency Light	Yes	No	Remark
11	✗		X	out of order
12	✗		X	out of order
13	✗		X	out of order
14	✗		X	out of order
15	✗		X	out of order


Champa and Dalar 2nd floor				
No.	Exit Signage	Yes	No	Remark
11	✓	✓		
12	✓	✓		
13	✓	✓		
14	✓	✓		
15	✓	✓		
16	✓	✓		
17	✓	✓		
18	✓	✓		
No.	Emergency Light	Yes	No	Remark
6	✗		X	out of order
7	✗		X	out of order
8	✗		X	out of order
9	✗		X	out of order
10	✗		X	out of order

Champa and Dalar 1st floor				
No.	Exit Signage	Yes	No	Remark
1	✓	✓		
2	✓	✓		
3	✓	✓		
4	✓	✓		
5	✓	✓		
6	✓	✓		
7	✓	✓		
8	✓	✓		
9	EXIT	✓		
10	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
1	✗		X	out of order
2	✗		X	out of order
3	✗		X	out of order
4	✗		X	out of order
5	✗		X	out of order

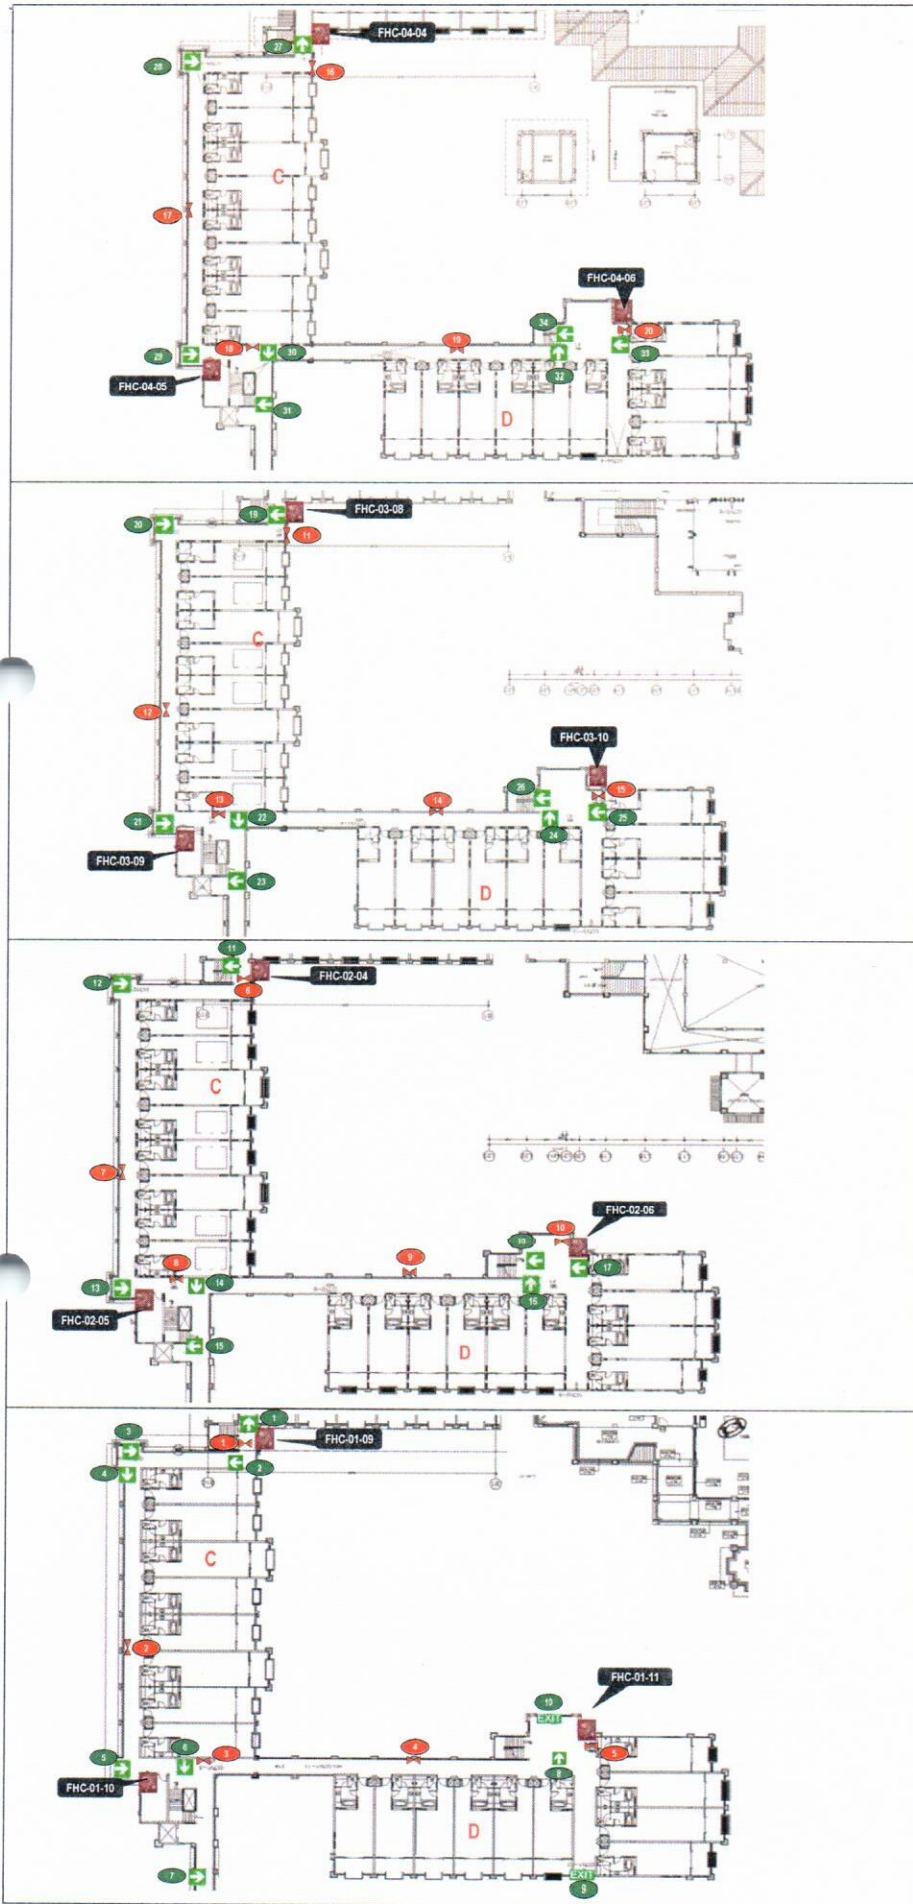

Emergency Light and Exit Signage Checklist (Eucalyptus)

Checked on Date: 05 May 2024

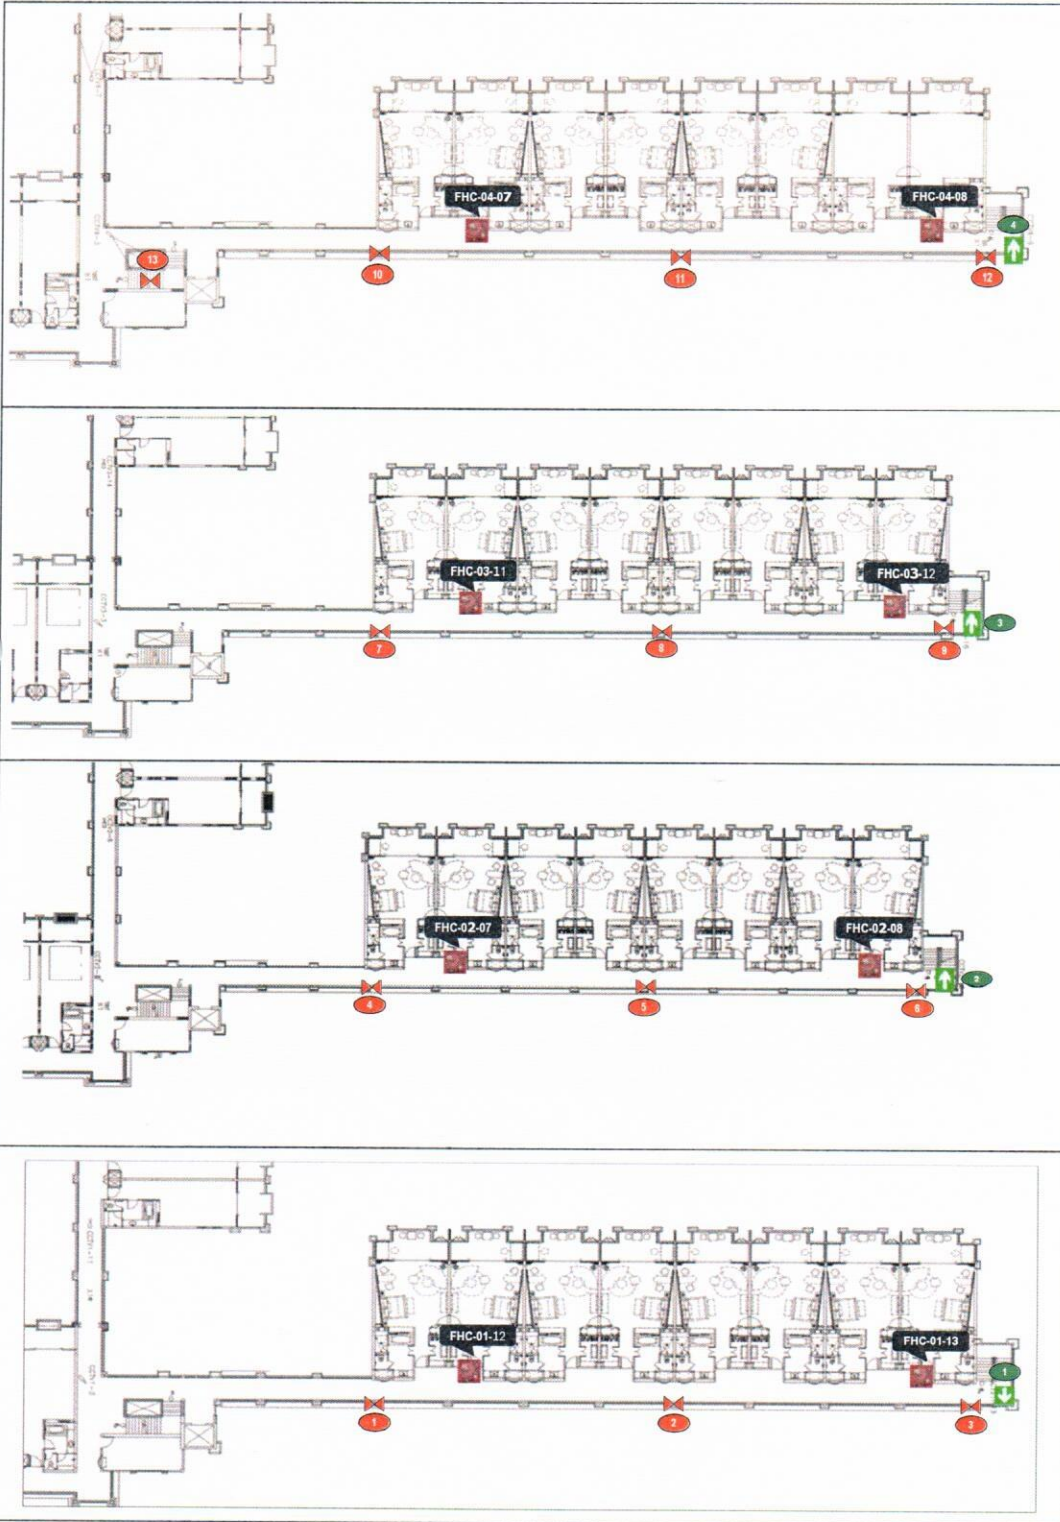

Eucalyptus 4th floor				
No.	Exit Signage	Yes	No	Remark
4		✓		
No.	Emergency Light	Yes	No	Remark
10			X	out of order
11			X	out of order
12			X	out of order
13			X	out of order


Eucalyptus 3rd floor				
No.	Exit Signage	Yes	No	Remark
3		✓		
No.	Emergency Light	Yes	No	Remark
7			X	out of order
8			X	out of order
9			X	out of order

Eucalyptus 2nd floor				
No.	Exit Signage	Yes	No	Remark
2		✓		
No.	Emergency Light	Yes	No	Remark
4			X	out of order
5			X	out of order
6			X	out of order

Eucalyptus 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3			X	out of order

Emergency Light and Exit Signage Checklist (HR Office)


Checked on Date: 05 May 2024

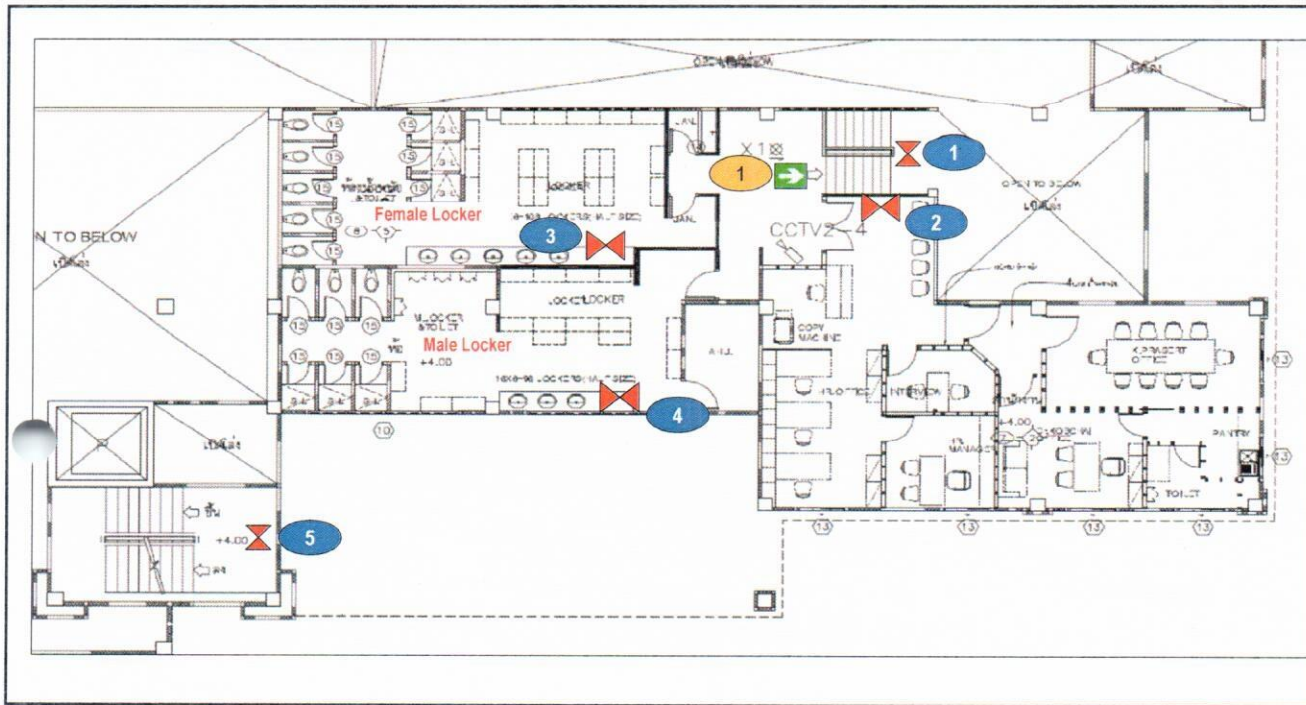

Exit Signage		Location	Status		Remark
			YES	No	
1		Front of HR Office	✓		
Emergency Light		Location	Status		Remark
			YES	No	
1		Stair to HR Office		X	out of order
2		Inside HR Office		X	out of order
3		Female Locker Room	✓		
4		Male Locker Room		X	out of order
5		Stair to Ball Room		X	Remove

Emergency Light and Exit Signage Checklist (Back of the House)

Checked on Date: 05 May 2024

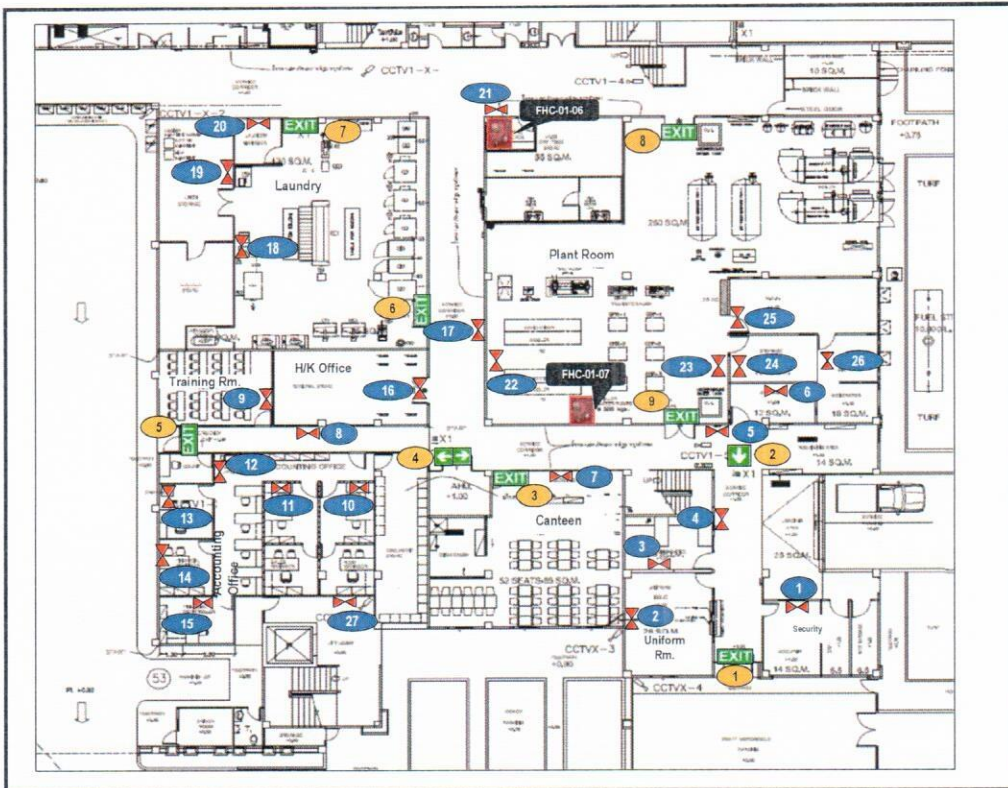


Exit Signage	Location	Status		Remark
		Yes	No	
1	EXIT Entrance Time Keeper	✓		
2	EXIT Front of First Aid room	✓		
3	EXIT Associate Canteen	✓		
4	EXIT Canteen Store	✓		
5	EXIT Fire Exit door 1	✓		
6	EXIT Laundry room 1	✓		
7	EXIT Laundry room 2	✓		
8	EXIT Plant room 1	✓		
9	EXIT Plant room 2		X	out of order

Emergency Light	Location	Status		Remark
		Yes	No	
1	Security Office		X	out of order
2	Uniform room		X	out of order
3	Receiving & Purchasing rm.	✓		
4	Front of Purchasing room	✓		
5	Front of Plant room	✓		
6	First Aid room	✓		
7	canteen		X	out of order
8	Front of Accounting Office	✓		
9	Training room (FB Office)		X	out of order
10	Reservation room		X	out of order
11	Inside Accounting Office1	✓		
12	Inside Accounting Office2	✓		
13	Cashier room		X	out of order
14	Asst. FC room	✓		
15	FC room	✓		
16	HK Office	✓		
17	Front of Laundry	✓		
18	Front of Laundry Store		X	out of order
19	Inside Laundry Store		X	out of order
20	Laundry Office			Remove
21	Front of Steward Office	✓		
22	Plant Room	✓		
23	Front of Plant Room Storage	✓		
24	Inside Plant Room Storage	✓		
25	MDB Room	✓		
26	Generator Room	✓		
27	Building of JAMJUREE stair		X	out of order

Emergency Light and Exit Signage Checklist (Main Kitchen and Cham Cha)

Checked on Date: 05 May 2024

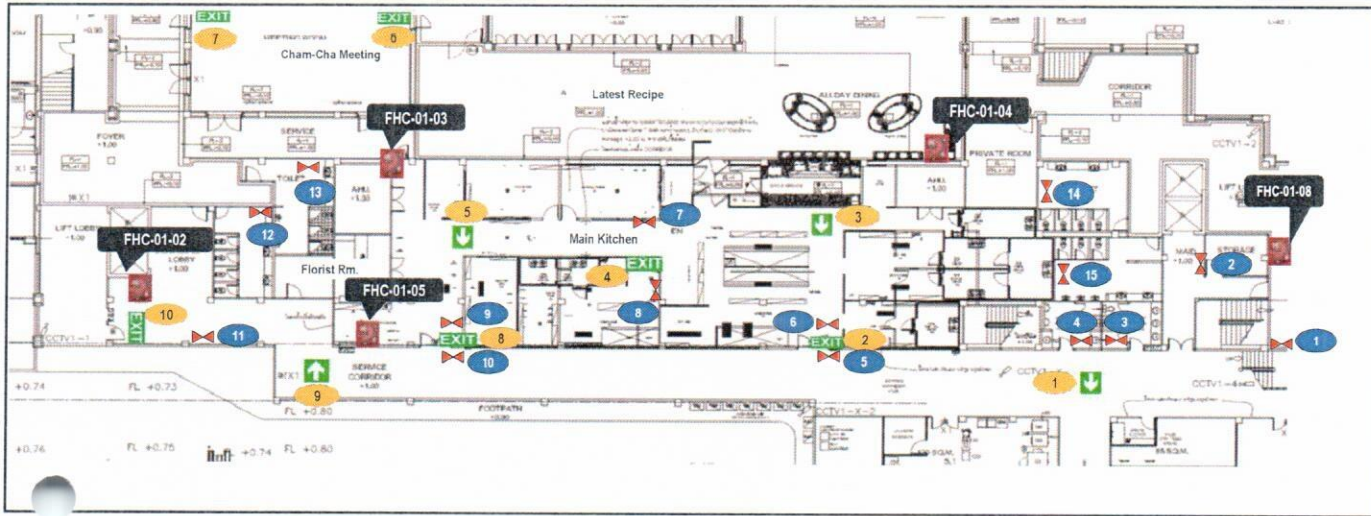


Exit Signage	Location	Status		Remark
		Yes	No	
1	Front of Associate Toilet	✓		
2	Main Kitchen Exit 1	✓		
3	Near Meat Preparation	✓		
4	Bakery room	✓		
5	Near Office Chef	✓		
6	Cham Cha 1	✓		
7	Cham Cha 2	✓		
8	Main Kitchen Exit 2	✓		
9	Opposite Florist room	✓		
10	Fire Exit Door 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Stair to behind Ball Room		X	Remove
2	Front of lift service B	✓		
3	Associate Female Toilet		X	out of order
4	Associate Male Toilet		X	out of order
5	Front of Main Kitchen 1	✓		
6	Behind Main Kitchen 1	✓		
7	Front of Bakery Room	✓		
8	Inside Bakery Room	✓		
9	Behind Main Kitchen 2	✓		
10	Front of Main Kitchen 2	✓		
11	Near Florist Room	✓		
12	Cham Cha Guest Female Toilet	✓		
11	Cham Cha Guest male Toilet	✓		
14	Near Florist Room	✓		
15	Front of lift service B 3rd floor	✓		
16	Front of lift service B 4nd floor		X	out of order
17	Cham cha Guest male Toilet	✓		
18	Latest Recipe Guest male Toilet		X	Remove
19	Latest Recipe Guest Female Toilet		X	out of order

Emergency Light and Exit Signage Checklist Utopia Room & Toilet Utopia FL.2

Checked On Date: 05 May 2024

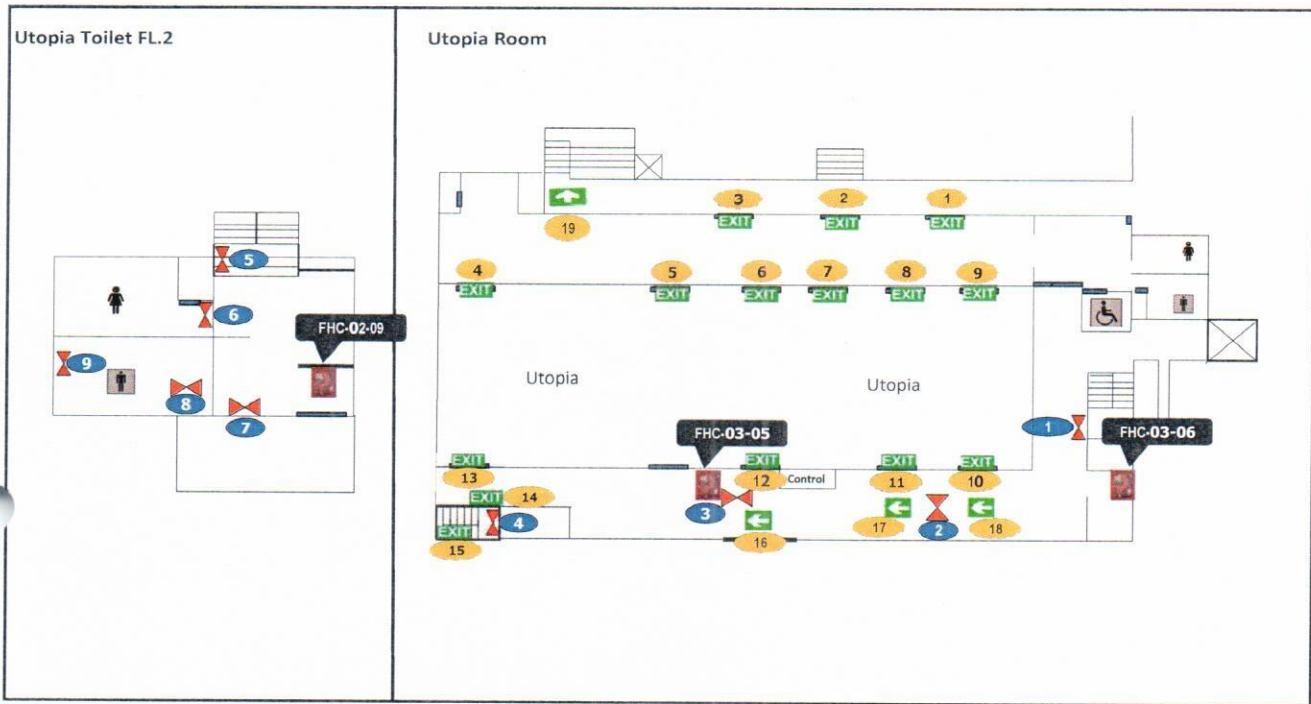


ป้ายหนีไฟ	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	EXIT	Glass Door Utopia Rm. Point 1		REMOVE
2	EXIT	Glass Door Utopia Rm. Point 2	✓	
3	EXIT	Glass Door Utopia Rm. Point 3	✓	
4	EXIT	In Utopia Rm.	✓	
5	EXIT	In Utopia Rm.	✓	
6	EXIT	In Utopia Rm.	✓	
7	EXIT	In Utopia Rm.	✓	
8	EXIT	In Utopia Rm.	✓	
9	EXIT	In Utopia Rm.	✓	
10	EXIT	In Utopia Rm.	✓	
11	EXIT	In Utopia Rm.	✓	
12	EXIT	In Utopia Rm.	✓	
13	EXIT	In Utopia Rm.	✓	
14	EXIT	Stair down fire exit	x	out of order
15	EXIT	Stair up fire exit	x	out of order
16	←	Building of Utopia	x	REMOVE
17	←	Building of Utopia	x	REMOVE
18	←	Building of Utopia	x	REMOVE
19	←	Front of Utopia	x	REMOVE

ไฟฉุกเฉิน	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	Building of Utopia		x	REMOVE
2	Back of Utopia Rm.		x	REMOVE
3	Back of Utopia Rm.		x	REMOVE
4	Stair exit building Utopia Rm.		x	REMOVE
5	Stair JAMJUREE FL.2	✓		
6	Female toilet of Utopia FL.2	✓		
7	Male toilet of Utopia FL.2	✓		
8	In female toilet of Utopia FL.2		x	REMOVE
8	In male toilet of Utopia FL.2		x	REMOVE
9	Utopia Fire Escape		x	out of order

Emergency Light and Exit Signage Checklist (Lobby)

Checked on Date: 05 May 2024

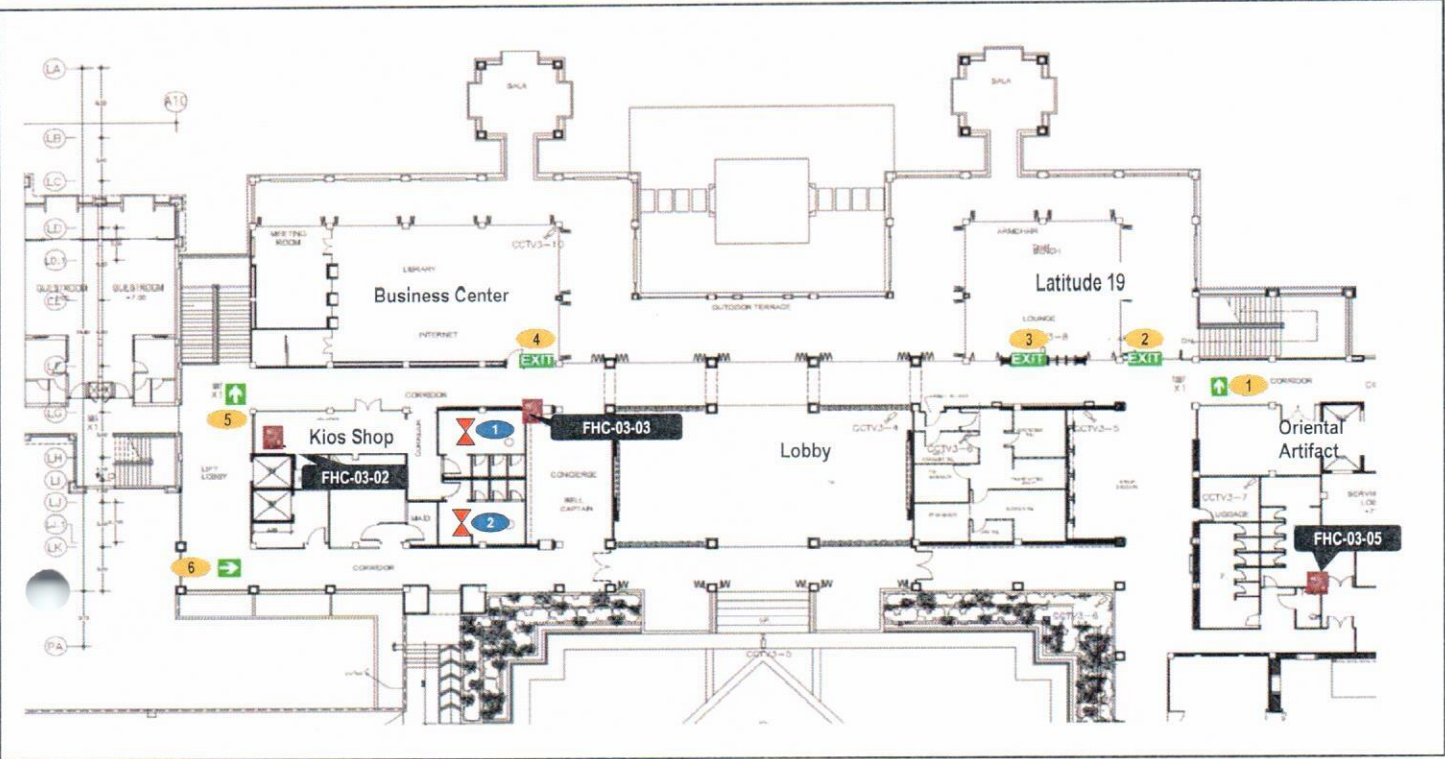


Exit Signage		Location	Status		Remark
			Yes	No	
1		Latitude 19 Stair	✓		
2		Latitude 19 Exit 1	✓		
3		Latitude 19 Exit 2	✓		
4		Library Exit	✓		
5		Kios Stair	✓		
6		Conner Corridor Concierge	✓		

Emergency Light		Location	Status		Remark
			Yes	No	
1		Guest Toilet (Female)	✓		
2		Guest toilet (Male)	✓		



Emergency Light and Exit Signage Checklist (Carpark and Engineer Office)

Checked on Date: 05 May 2024

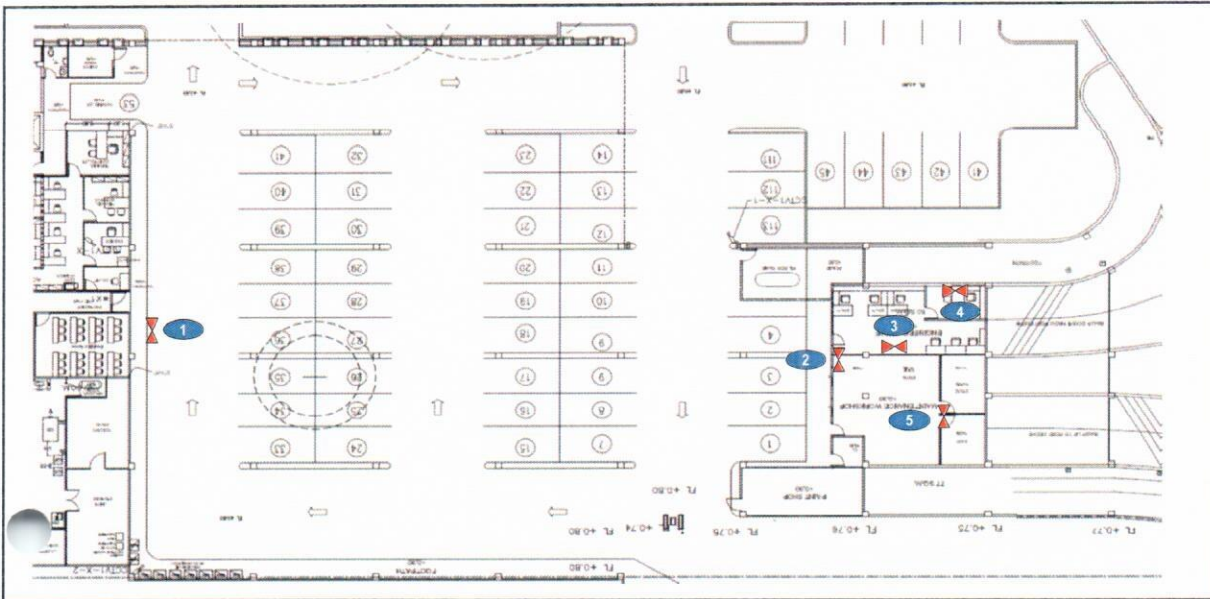


Exit Signage	Location	Status		Remark
		Yes	No	
1	Emergency Exit door		X	out of order
2	In front of Eng Office		X	out of order
3	Engineering Office		X	out of order
4	Chief Engineering office		X	REMOVE
5	Maintenance Shop		X	out of order



Emergency Light and Exit Signage Checklist (Favola Restaurant)

Checked on Date: 05 May 2024

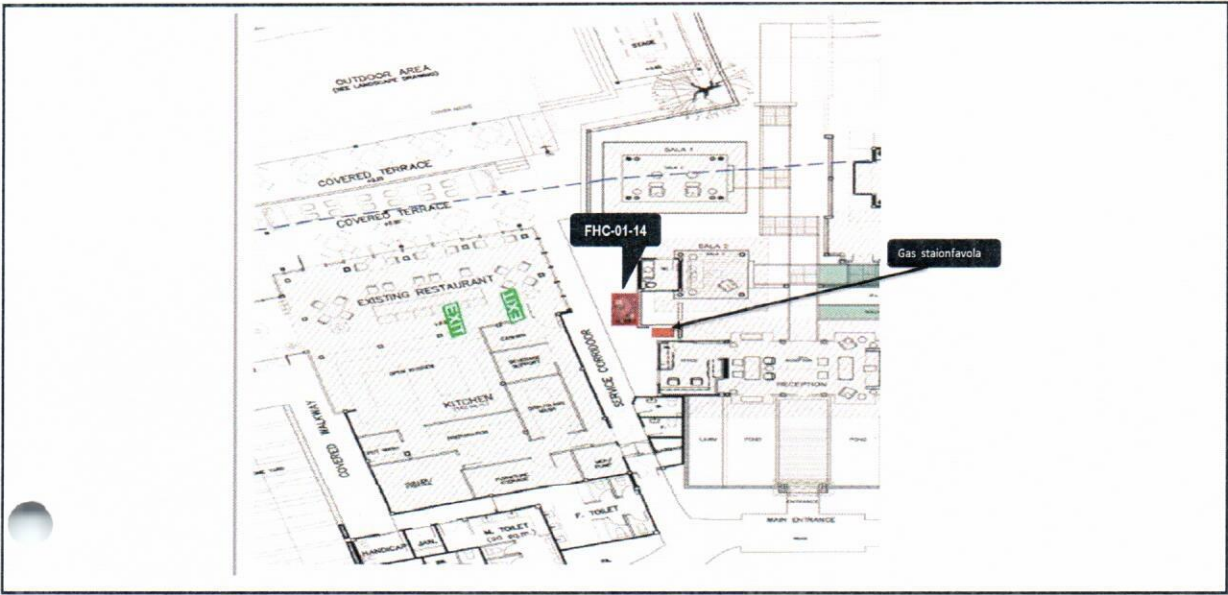


Inside Fire Host Cabinet				
Hose Rack 30	Nozzle	Hydrant Valve 2.5	Extinguisher	Axe

Exit Signage	Location	Status		Remark
		Yes	No	
1 EXIT	Favola Exit 1	✓		
2 EXIT	Favola Exit 2	✓		
3 EXIT	TBA			



Emergency Light and Exit Signage Checklist (Spa)

Checked on Date: 05 May 2024

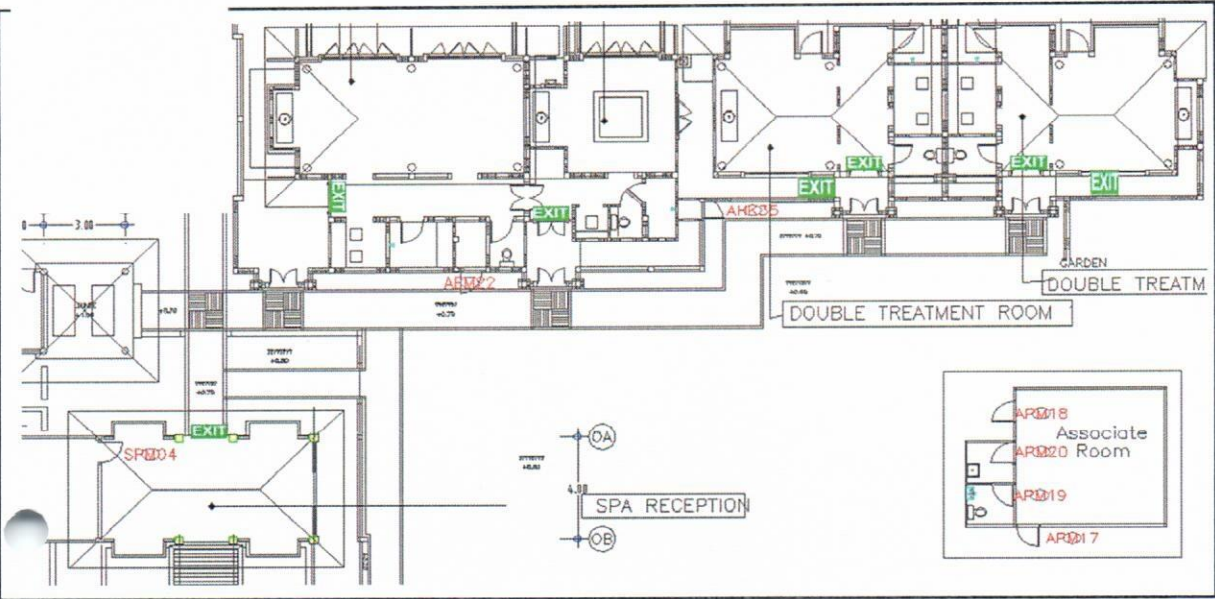

Exit Signage	Location	Status		Remark
		Yes	No	
1	Pavati Spa entrance	✓		
2	Leelawadee Spa entrance	✓		
3	Ratree Spa entrance	✓		
4	Chuanchom Spa entrance		x	out of order
5	Spa entrance		x	out of order

Emergency light	Location	Status		Remark
		Yes	No	
1	Generator room	✓		



Summary Fire Equipment Report

Month: 05 May 2024

Extinguisher Tank	Location				Total
	B.O.H.	F.H.C.	Fire Cart	Spare Tank	
1. CO2	26	6	1	0	33
2. Halotron	8	0	0	1	9
3. Dry Chemical	0	38	3	7	48
4. Wet Chemical	3	0	0	0	3
5. Form	3	0	0	0	3
Total	40	44	4	8	96

Remark: Spare tank have kept in store inside Security Store room and fire cart has set nearby Store Keeper.

Back of the House (B.O.H)			
Type of tank	Quantity	Status	
		Yes	No
1. CO2	26	26	0
2. Halotron	8	8	0
3. Wet Chemical	3	4	0
4. Form	3	3	0
Total	40	41	0

Fire Hose Cabinet (F.H.C.)			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	38	38	0
2 CO2	6	6	0
Total	44	44	0

Fire Cart			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	3	3	0
2 CO2	1	1	0
Total	4	4	0

Spare Store			
Type of tank	Quantity	Status	
		Yes	No
1 Dry Chemical	13	13	0
2. Halotron	4	4	0
Total	17	17	0

Other Equipment			
	Quantity	Status	
		Yes	No
1. Fire Blanket	5	5	0
2. Clothing Protect Heat	3	3	0
Total	8	8	0

Remark: The Clothing Protect Heat are kept in Hanger Cabinet nearby Fire Cart.

Other Emergency light / Signage	Status	Location										Total
		A	B	C-D	E	HR	BOH	UTOPIA	MK	LOBBY	ENG	
1. Emergency light	ALL	15	21	20	12	5	27	10	18	2	5	135
	YES	15	19	14	6	2	11	3	6	2	0	78
	NO	1	2	6	6	1	13	1	9	0	5	44
	Remove	0	0	0	0	1	3	6	3	0	1	14
2. Exit signage	ALL	2	1	2	0	0	7	15	6	3	0	36
	YES	2	1	2	0	0	7	15	6	3	0	36
	NO	0	0	0	0	0	1	0	0	0	0	1
3. Arrow point signage	ALL	15	22	32	4	1	2	4	4	3	0	87
	YES	14	22	30	4	1	2	3	3	3	0	82
	NO	1	0	2	0	0	2	1	1	0	0	7

Fire Hose Cabinet Checklist

Checked on Date: 05 May 2024

No.	Floor	Register No.	Location	Inside Fire Host Cabinet						Model	Manufacture	Remark
				Hose Rack 30 M. 1.5 Inc	Nozzle	Hydrant Valve 2.5	Extinguisher					
							Tag	Yes	No			
1st Floor												
1	1	FHC 01-01	Corridor A in front of room 1102							6.8 KGS.(ST-15 lbs.)	SATURN	
2	1	FHC 01-02	Corridor A beside guest elevator							6.8 KGS.(ST-15 lbs.)	SATURN	
3	1	FHC 01-03	Back of Cham Cha room(CO2)							10 C	V.I.P Fire	
4	1	FHC 01-04	Inside Latest Recipe (CO2)							10 lbs.	Best	
5	1	FHC 01-05	Near Main Kitchen door							10V (VIP-10lbs.)	V.I.P Fire	
6	1	FHC 01-06	Beside Chief Steward Office							6.8 KGS.(ST-15 lbs.)	SATURN	
7	1	FHC 01-07	In front of staff canteen							6.8 KGS.(15lbs.)	Brake Fire	
8	1	FHC 01-08	Corridor B beside guest elevator (Latest Recipe)							6.8 KGS.(ST-15 lbs.)	SATURN	
9	1	FHC 01-09	Building B in front of stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
10	1	FHC 01-10	Building C in front of pantry room							CN-15	C-NON Fire	
11	1	FHC 01-11	Building D near guest room 4101							FM-15 lbs. 6.8 KGS.	Fire Man Rescue	
12	1	FHC 01-12	Building E near guest room 5103							10 lbs.(5 KGS.) 4A:2B	WILL	
13	1	FHC 01-13	Building E near guest room 5107							10 lbs.(5 KGS.) 4A:2B	WILL	
14	1	FHC 01-14	Favola							6.8 KGS.(ST-15 lbs.)	SATURN	ⓂAxe
15	1	FHC 01-15	Spa							6.8 KGS.(ST-15 lbs.)	SATURN	ⓂAxe
2nd Floor												
16	2	FHC 02-01	Corridor A in front of guest room 1202							6.8 KGS.(ST-15 lbs.)	SATURN	
17	2	FHC 02-02	Corridor A in front of Executive office							6.8 KGS.(ST-15 lbs.)	SATURN	
18	2	FHC 02-03	Corridor B beside guest elevator (near fitness)							6.8 KGS.(ST-15 lbs.)	SATURN	
19	2	FHC 02-04	Building B in front of stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
20	2	FHC 02-05	Building C corridor in front of pantry room							6.8 KGS.(ST-15 lbs.)	SATURN	
21	2	FHC 02-06	Building D near guest room 4201							6.8 KGS.(ST-15 lbs.)	SATURN	
22	2	FHC 02-07	Building E near guest room 5203							CN-15	C-NON Fire	
23	2	FHC 02-08	Building E near guest room 5207							10 lbs.(5 KGS.) 4A:2B	WILL	
24	2	FHC 02-09	Toilet Utopia Fl.2(CO2)							10 lbs.(5 KGS.) 4A:2B	WILL	
3rd Floor												
25	3	FHC 03-01	Corridor in front of guest room 1302							10 lbs.	Best	
26	3	FHC 03-02	Corridor A near Kiosk shop							6.8 KGS.(ST-15 lbs.)	SATURN	
27	3	FHC 03-03	In front of Business Center							6.8 KGS.(ST-15 lbs.)	SATURN	
28	3	FHC 03-04	In front of Lobby Latitude 19 (Dry Chemical)							6.8 KGS.(ST-15 lbs.)	SATURN	
			In front of Lobby Latitude 19 (CO ₂)							6.8 KGS.(ST-15 lbs.)	SATURN	
29.1	3	FHC 03-05	Back of Utopia room(CO2)							10 lbs.	EXTRA	
29.2	3	FHC 03-05	Back of Utopia room(CO2)							10 lbs.	BEST	
29.3	3	FHC 03-05	Back of Utopia room(CO2)							10 lbs.	EXTRA	
30.1	3	FHC 03-06	Building of Utopia room (CO2)							10 lbs.	EXTRA	
30.2	3	FHC 03-06	Building of Utopia room (CO2)							10 lbs.	BEST	
30.3	3	FHC 03-06	Building of Utopia room (CO2)							10 lbs.	EXTRA	
31	3	FHC 03-07	Corridor B beside guest elevator							10 lbs.	EXTRA	
32	3	FHC 03-08	Building B in front of stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
33	3	FHC 03-09	Corridor Building C front of pantry room							6.8 KGS.(ST-15 lbs.)	SATURN	
34	3	FHC 03-10	Building D near guest room 4301							6.8 KGS.(ST-15 lbs.)	SATURN	
35	3	FHC 03-11	Building E near guest room 5303							6.8 KGS.(ST-15 lbs.)	SATURN	
36	3	FHC 03-12	Building E near guest room 5307							10 lbs.(5 KGS.) 4A:2B	WILL	
4th Floor												
37	4	FHC 04-01	Corridor A in front of guest room 1402							10 lbs.(5 KGS.) 4A:2B	WILL	
38	4	FHC 04-02	Corridor A near guest elevator							6.8 KGS.(ST-15 lbs.)	SATURN	
39	4	FHC 04-03	Corridor B beside guest elevator							6.8 KGS.(ST-15 lbs.)	SATURN	
40	4	FHC 04-04	Building B near stair guest							6.8 KGS.(ST-15 lbs.)	SATURN	
41	4	FHC 04-05	Building C Corridor in front of pantry room							6.8 KGS.(ST-15 lbs.)	SATURN	
42	4	FHC 04-06	Building D near guest room 4401							6.8 KGS.(ST-15 lbs.)	SATURN	
43	4	FHC 04-07	Building E near guest room 5403							6.8 KGS.(ST-15 lbs.)	SATURN	
44	4	FHC 04-08	Building E near guest room 5407							10 lbs.(5 KGS.) 4A:2B	WILL	
										10C (CO2 10 lbs.)	V.I.P Fire	

Summary : The total of 44 fire host cabinets.

Parameter	Total (Location)	Status		Remark
		Normal	Abnormal	
Hose Rack 30 m. 1.5 inc.	44	44	0	
Nozzle	44	44	0	
Hydrant Valve 2.5	44	44	0	
Dry Chemical Extinguisher	38	38	0	
CO ₂ Extinguisher	6	6	0	
The Fire hose cabinet door closer	44	44	0	

Fire Extinguisher (Hanged Alone) Checklist

Checked on Date : 05 May 2024

No.	Floor	Locations	TAG	CO2 10lb		Halotron 10 lb		Dry chemical 10 lb		WetChemical 10lb		Model	Manufacturer	Fire Blanket	Remark
				Yes	No	Yes	No	Yes	No	Yes	No				
1	G	Receiving Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
2	G	in front of Canteen room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
3	G	Accounting Office 1				✓						NON-CFC (10N)	V.I.P Fire		
4	G	Accounting Office 2				✓						NON-CFC (10N)	V.I.P Fire		
5	G	Laundry Room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
6	G	Laundry Room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
7	G	Laundry Room 3 (Store Laundry)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
8	G	Generator room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
9	G	MDB Room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
10	G	Plant room 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
11	G	Plant room 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
12	G	Plant room 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
13	G	Plant room 4		✓								10C (CO2 10 lbs.)	V.I.P Fire		
14	G	F&B in Pantry room behind Latest Recipe		✓								10C (CO2 10 lbs.)	V.I.P Fire		
15	G	F&B in front of butcher room								✓		Pro Plus 100K 2005	Kidde		
16	G	F&B in front of Fruit room								✓		Pro Plus 100K 2005	Kidde		
17	G	F&B in front of Bakery room								✓		Pro Plus 100K 2005	Kidde		
18	G	F&B inside Bakery room								✓		Pro Plus 100K 2005	Kidde		
19	G	Engineering Office 1				✓						NON-CFC (10N)	V.I.P Fire		
20	G	Engineering Office 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
21	G	Maintenance work shop 1		✓								10C (CO2 10 lbs.)	V.I.P Fire		
22	G	Maintenance work shop 2		✓								10C (CO2 10 lbs.)	V.I.P Fire		
23	G	Maintenance work shop 3		✓								10C (CO2 10 lbs.)	V.I.P Fire		
24	G	FAVOLA Steward Area		✓								10C (CO2 10 lbs.)	V.I.P Fire		
25	G	FAVOLA Kitchen								✓		K01-3	K-Guard		
26	G	SPA Manager room		✓								10C (CO2 10 lbs.)	V.I.P Fire		
27	G	Treatment room 1 (Parvati)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
28	G	Treatment room 2 (Leelawadee)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
29	G	Treatment room 3 (Ratree)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
30	G	Treatment room 4 (Chuanom)		✓								10C (CO2 10 lbs.)	V.I.P Fire		
31	G	Associate & Store room of SPA		✓								10C (CO2 10 lbs.)	V.I.P Fire		
32	G	EV Charger		✓								10C (CO2 10 lbs.)	V.I.P Fire		
33	2	HR Office				✓						NON-CFC (10N)	V.I.P Fire		
34	2	Executive Office 1				✓						NON-CFC (10N)	V.I.P Fire		
35	2	Executive Office 2				✓						NON-CFC (10N)	V.I.P Fire		
36	3	Front Office Department 1				✓						NON-CFC (10N)	V.I.P Fire		
37	3	Front Office Department 2				✓						NON-CFC (10N)	V.I.P Fire		
38	3	Lift service room Angsana		✓								10C (CO2 10 lbs.)	V.I.P Fire		
39	4	Elevator A						✓				10 C	Best		
40	4	Elevator B						✓				10 C	Best		
41	4	Elevator CDE						✓				10 C	Best		
42	G	India Kitchen								✓		Pro Plus 100K 2005	Kidde		
43	G	Gas Station 1						✓				15 lbs (6.9 KG.)	Imperial		
44	G	Gas Station 2						✓				15 lbs (6.9 KG.)	Imperial		
45	G	Gas Station Favola						✓				15 lbs (6.9 KG.)	Imperial		
46	2							✓				15 lbs (6.9 KG.)	Imperial		
Total (Tanks)				0	25	0	8	0	6	0	5	0		1	

Fire Cart Check List


No.	Description	TAG	Result		Remark	Model	Manufacturer
			Normal	Disable			
1	Extinguisher Dry Chemical (10 Lbs.) No.1	✓	✓			CN-15	C-NON Fire
2	Extinguisher Dry Chemical (10 Lbs.) No.2	✓	✓			CN-15	C-NON Fire
3	Extinguisher Dry Chemical (10 Lbs.) No.3	✓	✓			TF-15	Top Fire
4	Extinguisher CO2 No.4	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
5	Extinguisher CO2 No.5	✓	✓			10C (CO2 10 lbs.)	V.I.P Fire
6	Rope		✓		1 rope		
7	Hydrant 2.5" set		✓		1 set		
8	Axe		✓		1		
9	Fire fighting Suite		✓		3 set		

Spare Tanks (Store in LP Store Room)

NO.	Location	Fire Extinguisher Spare (Tank)								Model	Manufacturer	Remark	
		TAG	CO2 10lb		Halotron 10lb		Dry Chemical 10lb		Wet Chemical 10lb				
			Yes	No	Yes	No	Yes	No	Yes				No
1	Store in Plant room NO. 1	✓			✓						Non CFC (10N)	V.I.P Fire	
2	Store in Plant room NO. 2	✓			✓						10 lbs.	Number 1 Fire	
3	Store in Plant room NO. 3	✓			✓						10 lbs.	Number 1 Fire	
4	Store in Plant room NO. 4	✓									9.0 litres	V.I.P Fire	Foam

9	Store in Plant room NO. 9	✓					✓				6.8 KGS.(ST-15 lbs.)	SATURN	
10	Store in Plant room NO. 11	✓					✓				15 v.(VIP-15 lb)	V.I.P Fire	15 lb.
11	Store in Plant room NO. 12	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
12	Store in Plant room NO. 13	✓					✓				10 v.(VIP-10 lb)	V.I.P Fire	
13	Store in Plant room NO. 14	✓					✓				NF-15 D	NOFIRE	
14	Store in Plant room NO. 15	✓					✓				15 AG	Angel	
15	Store in Plant room NO. 16	✓					✓				CN-15	C-NON Fire	
		15	1	0	3	0	8	0	0	0			



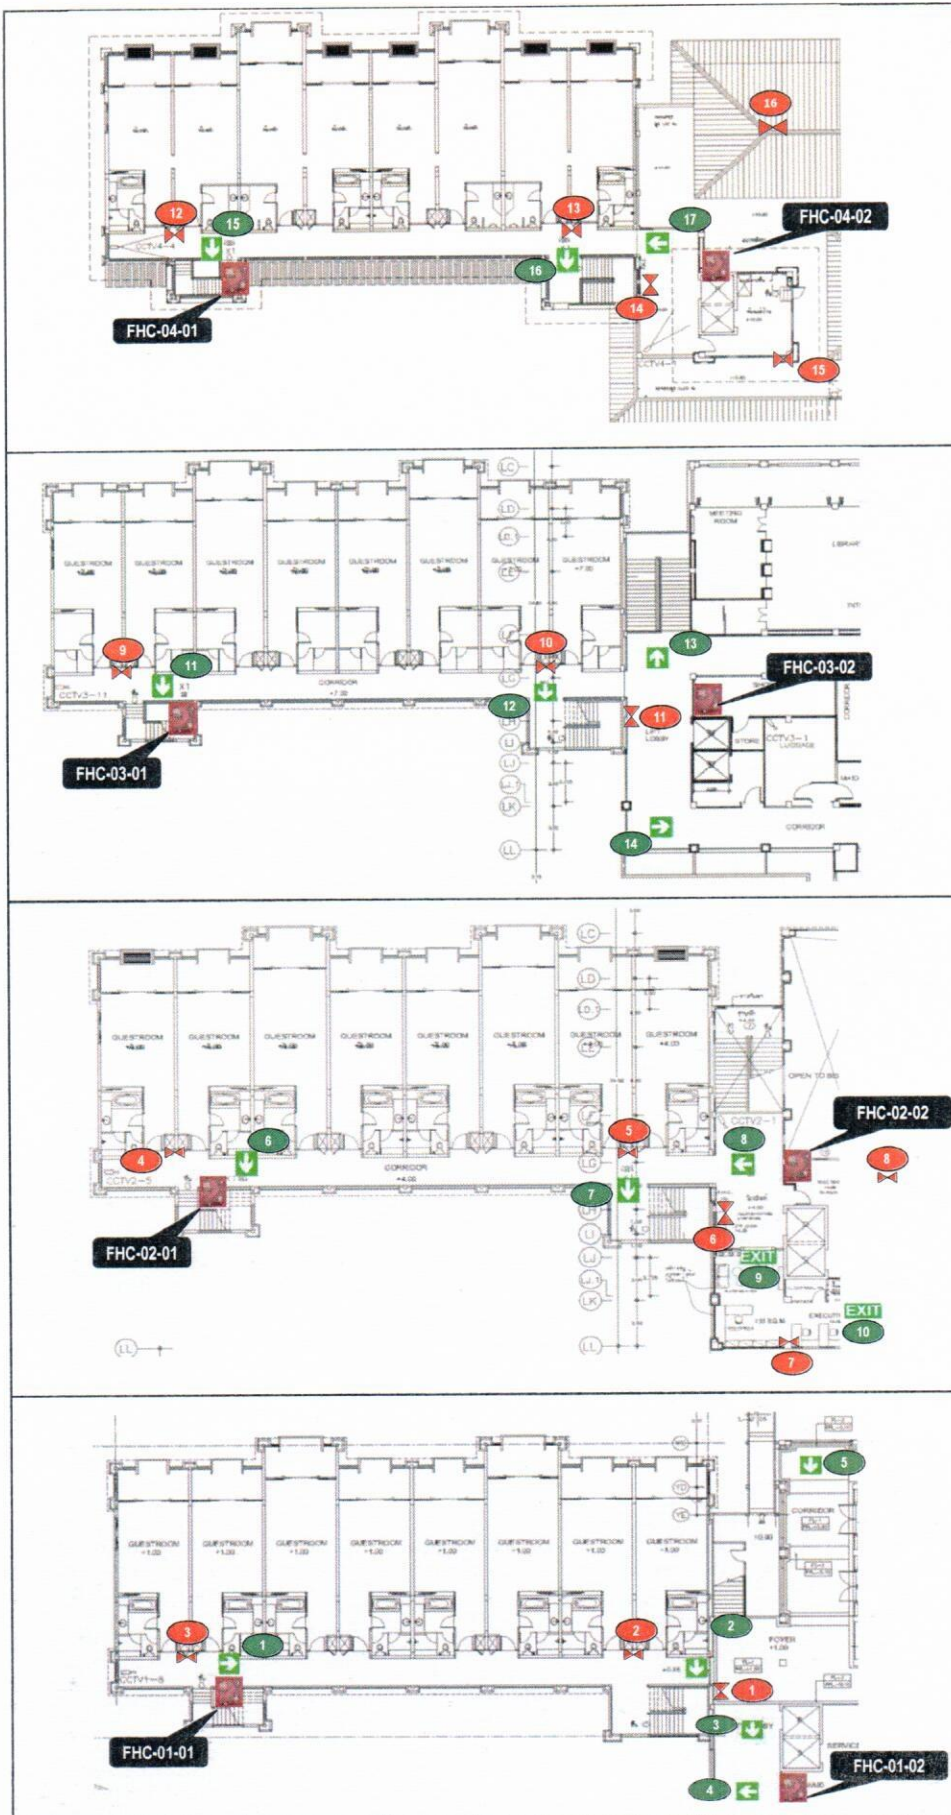

Angsana 4th floor				
No.	Exit Signage	Yes	No	Remark
15		✓		
16		✓		
17		✓		
No.	Emergency Light	Yes	No	Remark
12			X	out of order
13			X	out of order
14			X	out of order
15			X	out of order
16			X	out of order


Angsana 3rd floor				
No.	Exit Signage	Yes	No	Remark
11		✓		
12		✓		
13		✓		
14		✓		
No.	Emergency Light	Yes	No	Remark
9			X	out of order
10			X	out of order
11		✓		

Angsana 2nd floor				
No.	Exit Signage	Yes	No	Remark
6		✓		
7		✓		
8		✓		
9		✓		
10		✓		
No.	Emergency Light	Yes	No	Remark
4			X	Out of order
5			X	Out of order
6			X	Out of order
7			X	Out of order
8			X	Out of order


Angsana 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
No.	Emergency Light	Yes	No	Remark
1			X	Out of order
2			X	Out of order
3			X	Out of order

Emergency Light and Exit Signage Checklist (Bamboo)


Checked on Date: 05 May 2024

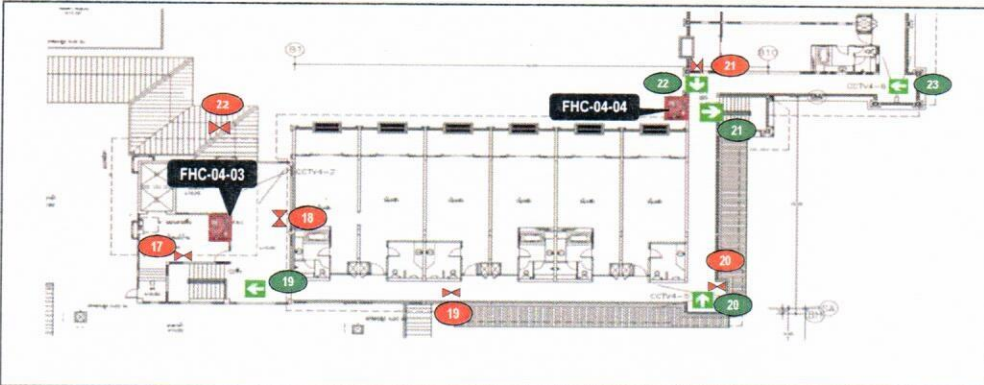


Bamboo 4th floor				
No.	Exit Signage	Yes	No	Remark
19		✓		
20			X	out of order
21		✓		
22		✓		
23		✓		
No.	Emergency Light	Yes	No	Remark
17			X	out of order
18			X	out of order
19			X	out of order
20			X	out of order
21			X	out of order
22			X	out of order

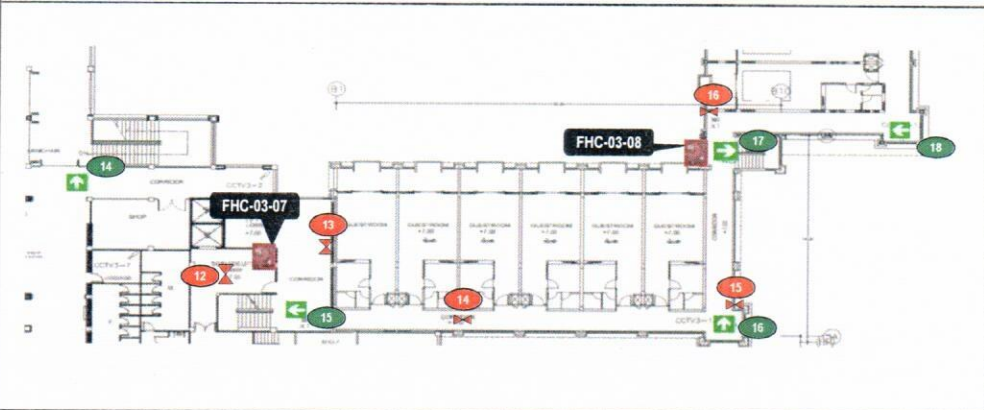


Bamboo 3rd floor				
No.	Exit Signage	Yes	No	Remark
14		✓		
15		✓		
16		✓		
17		✓		
18		✓		
No.	Emergency Light	Yes	No	Remark
12			X	out of order
13			X	out of order
14			X	out of order
15			X	out of order
16			X	out of order

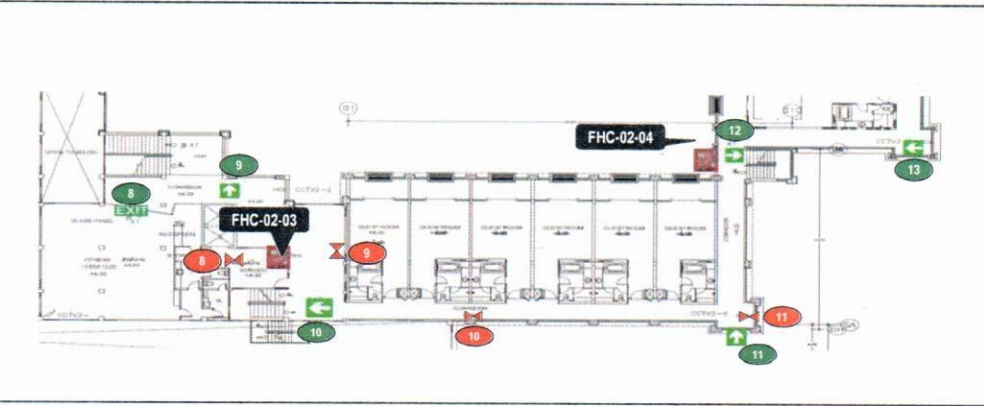


Bamboo 2nd floor				
No.	Exit Signage	Yes	No	Remark
8		✓		
9		✓		
10		✓		
11			X	out of order
12		✓		
13		✓		
No.	Emergency Light	Yes	No	Remark
8			X	out of order
9			X	out of order
10			X	out of order
11			X	out of order

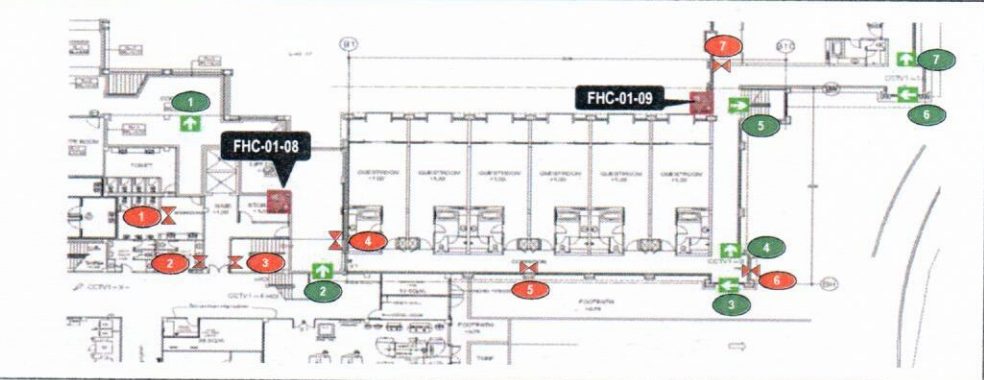


Bamboo 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
2		✓		
3		✓		
4		✓		
5		✓		
6		✓		
7		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3			X	out of order
4		✓		
5			X	out of order
6			X	out of order
7		✓		

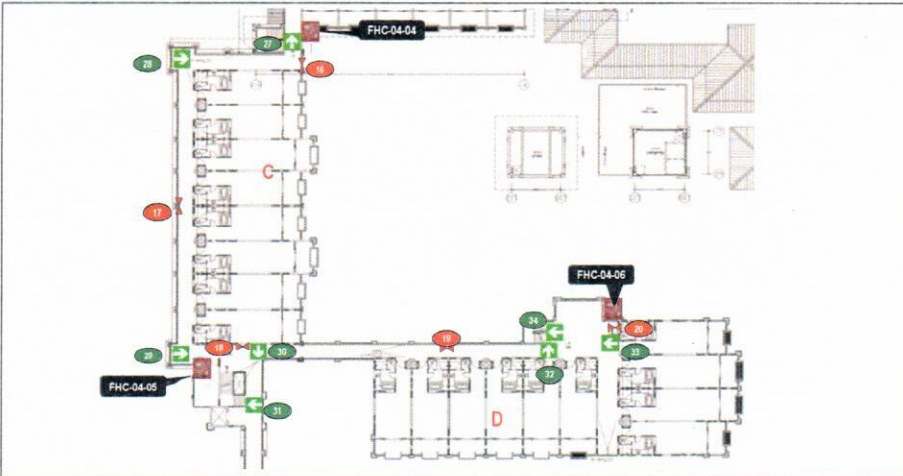


Champa and Dalar 4th floor				
No.	Exit Signage	Yes	No	Remark
27	✓	✓		
28	✓	✓		
29	✓	✓		
30	✓	✓		
31	✓	✓		
32	✓	✓		
33	✓	✓		
34	✓	✓		
No.	Emergency Light	Yes	No	Remark
	✗		X	out of order
	✗		X	out of order
	✗		X	out of order
	✗		X	out of order
	✗		X	out of order

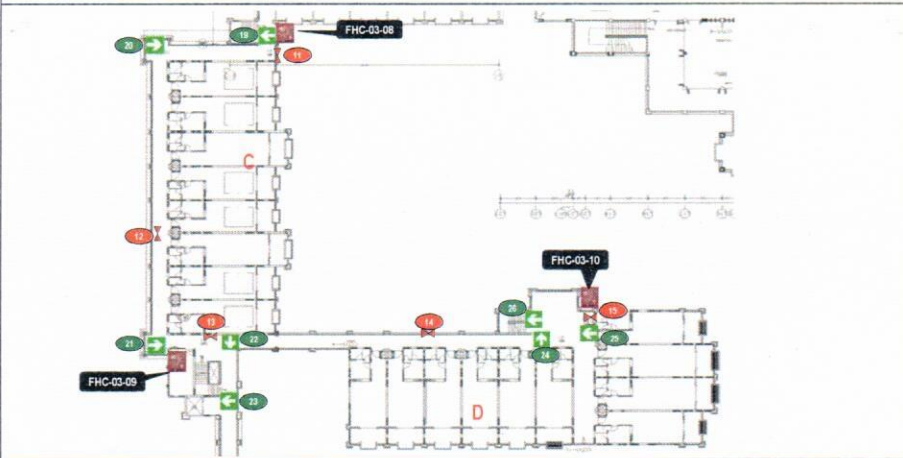


Champa and Dalar 3rd floor				
No.	Exit Signage	Yes	No	Remark
19	✓	✓		
20	✓	✓		
21	✓	✓		
22	✓	✓		
23	✓	✓		
24	✓	✓		
25	✓	✓		
26	✓	✓		
No.	Emergency Light	Yes	No	Remark
11	✗		X	out of order
12	✗		X	out of order
13	✗		X	out of order
14	✗		X	out of order
15	✗		X	out of order

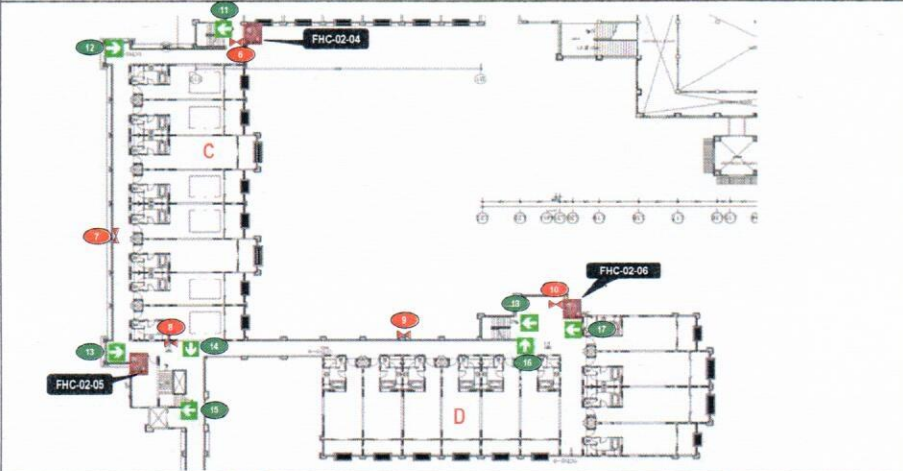

Champa and Dalar 2nd floor				
No.	Exit Signage	Yes	No	Remark
11	✓	✓		
12	✓	✓		
13	✓	✓		
14	✓	✓		
15	✓	✓		
16	✓	✓		
17	✓	✓		
18	✓	✓		
No.	Emergency Light	Yes	No	Remark
6	✗		X	out of order
7	✗		X	out of order
8	✗		X	out of order
9	✗		X	out of order
10	✗		X	out of order

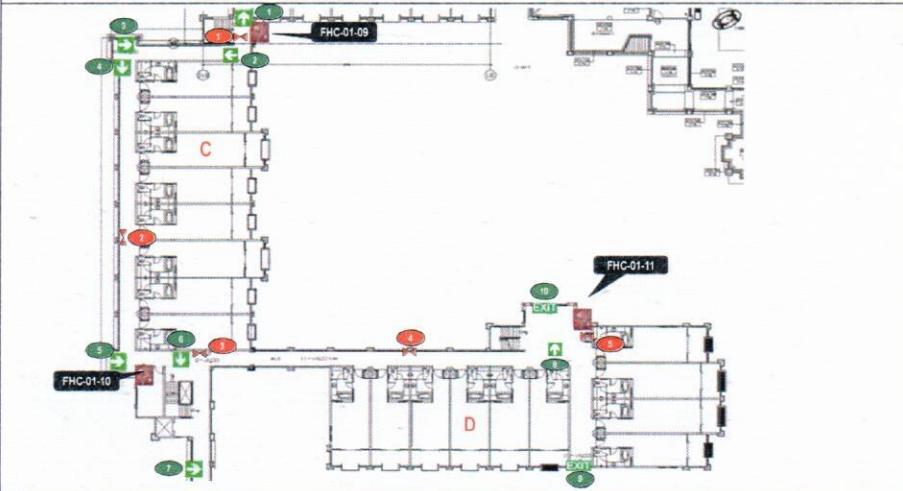

Champa and Dalar 1st floor				
No.	Exit Signage	Yes	No	Remark
1	✓	✓		
2	✓	✓		
3	✓	✓		
4	✓	✓		
5	✓	✓		
6	✓	✓		
7	✓	✓		
8	✓	✓		
9	EXIT	✓		
10	EXIT	✓		
No.	Emergency Light	Yes	No	Remark
1	✗		X	out of order
2	✗		X	out of order
3	✗		X	out of order
4	✗		X	out of order
5	✗		X	out of order

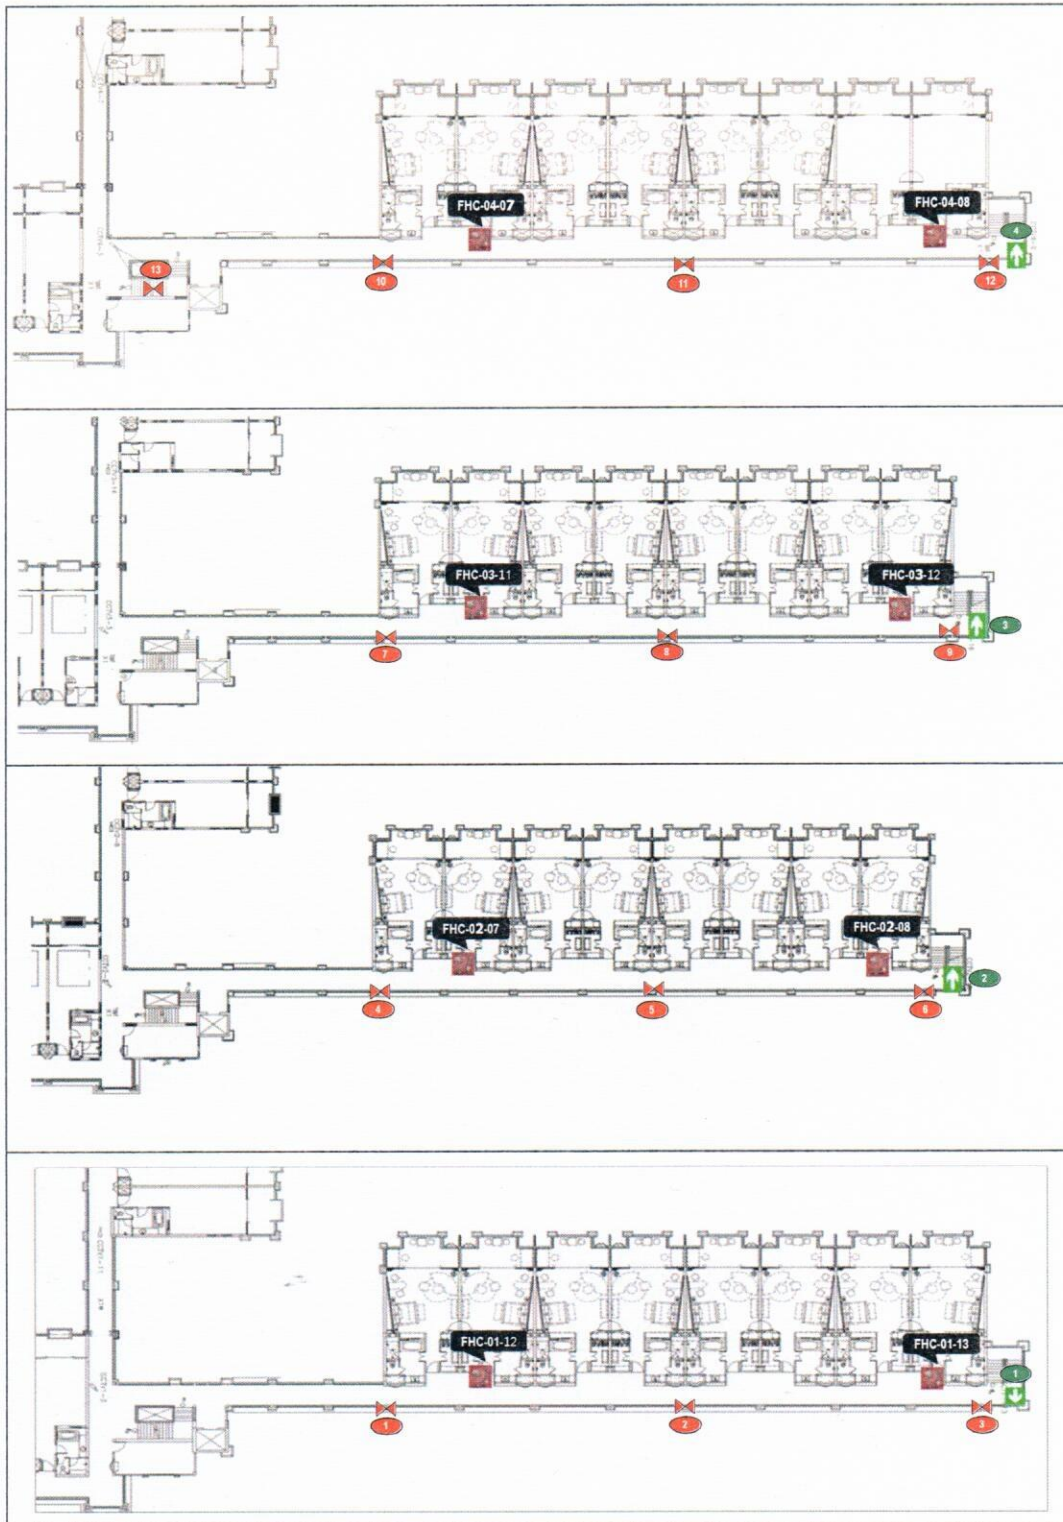

Eucalyptus 4th floor				
No.	Exit Signage	Yes	No	Remark
4		✓		
No.	Emergency Light	Yes	No	Remark
10			X	out of order
11			X	out of order
12			X	out of order
13			X	out of order


Eucalyptus 3rd floor				
No.	Exit Signage	Yes	No	Remark
3		✓		
No.	Emergency Light	Yes	No	Remark
7			X	out of order
8			X	out of order
9			X	out of order

Eucalyptus 2nd floor				
No.	Exit Signage	Yes	No	Remark
2		✓		
No.	Emergency Light	Yes	No	Remark
4			X	out of order
5			X	out of order
6			X	out of order

Eucalyptus 1st floor				
No.	Exit Signage	Yes	No	Remark
1		✓		
No.	Emergency Light	Yes	No	Remark
1			X	out of order
2			X	out of order
3			X	out of order

Emergency Light and Exit Signage Checklist (HR Office)

Checked on Date: 05 May 2024

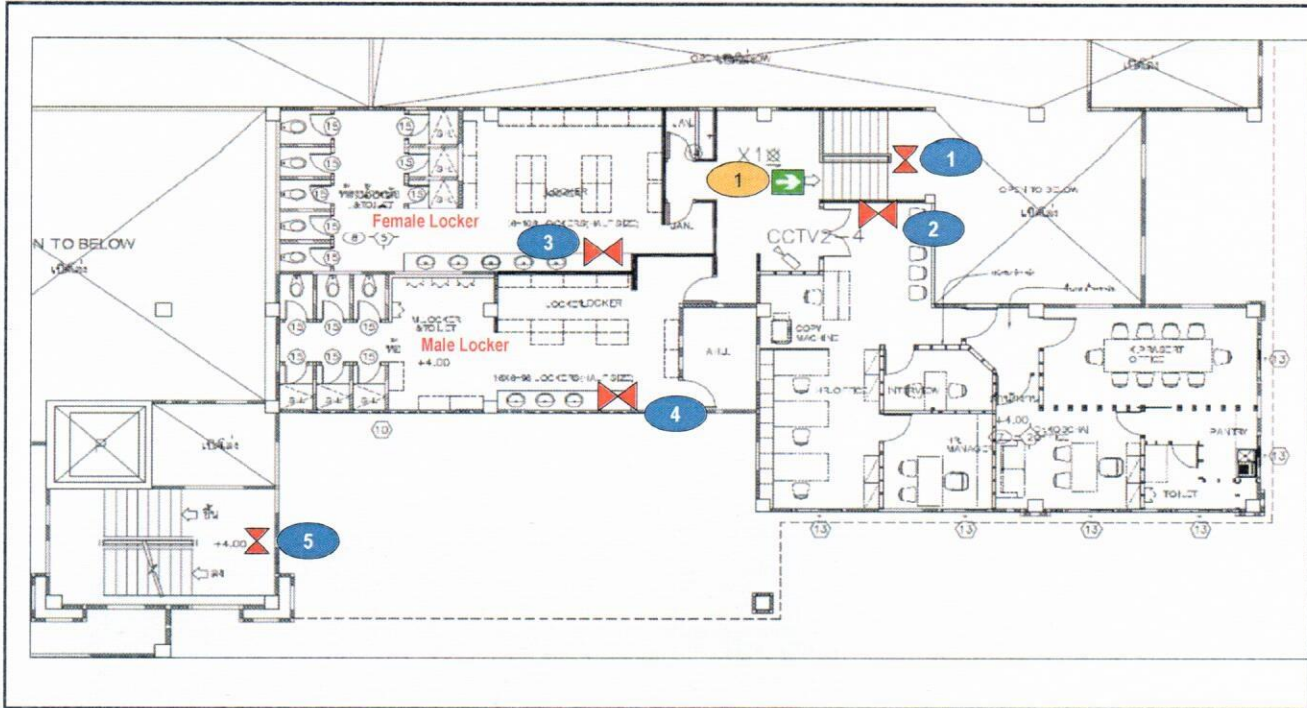


Exit Signage		Location	Status		Remark
			YES	No	
1		Front of HR Office	✓		
Emergency Light		Location	Status		Remark
			YES	No	
1		Stair to HR Office		X	out of order
2		Inside HR Office		X	out of order
3		Female Locker Room	✓		
4		Male Locker Room		X	out of order
5		Stair to Ball Room		X	Remove



Emergency Light and Exit Signage Checklist (Back of the House)

Checked on Date: 05 May 2024

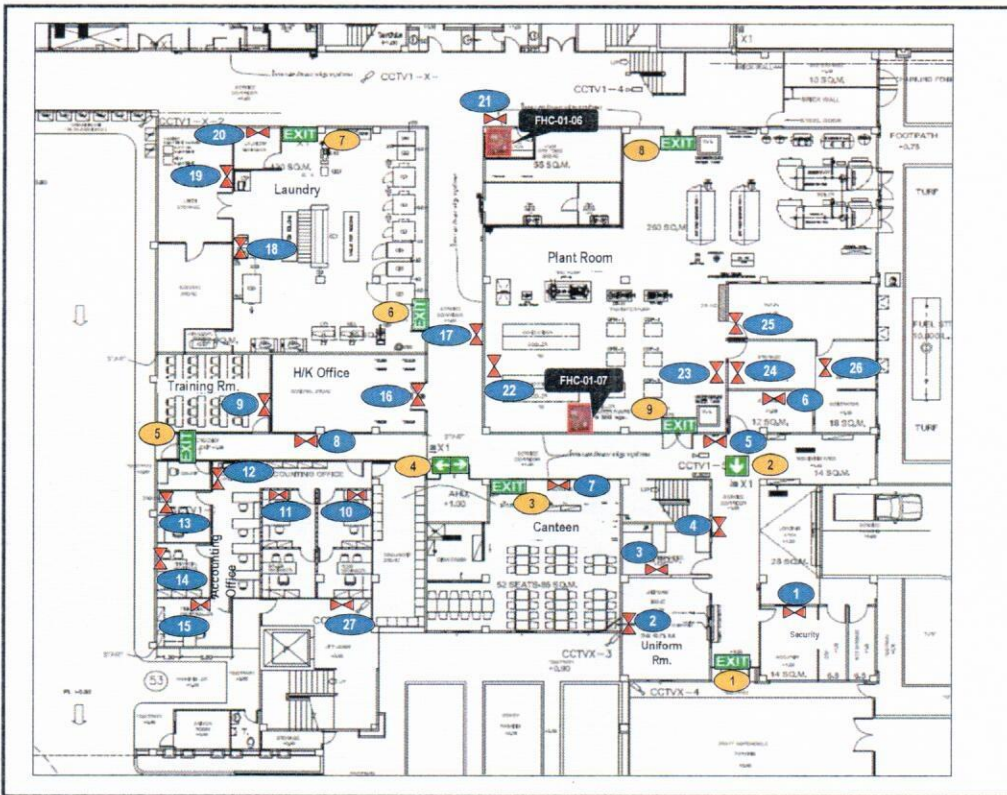


Exit Signage	Location	Status		Remark
		Yes	No	
1 EXIT	Entrance Time Keeper	✓		
2	Front of First Aid room	✓		
33 3 EXIT	Associate Canteen	✓		
4	Canteen Store	✓		
5 EXIT	Fire Exit door 1	✓		
6 EXIT	Laundry room 1	✓		
7 EXIT	Laundry room 2	✓		
8 EXIT	Plant room 1	✓		
9 EXIT	Plant room 2		X	out of order

Emergency Light	Location	Status		Remark
		Yes	No	
1	Security Office		X	out of order
2	Uniform room		X	out of order
3	Recieving & Purchasing rm.	✓		
4	Front of Purchasing room	✓		
5	Front of Plant room	✓		
6	First Aid room	✓		
7	canteen		X	out of order
8	Front of Accounting Office	✓		
9	Training room (FB Office)		X	out of order
10	Reservation room		X	out of order
11	Inside Accounting Office1	✓		
12	Inside Accounting Office2	✓		
13	Cashier room		X	out of order
14	Asst. FC room	✓		
15	FC room	✓		
16	HK Office	✓		
17	Front of Laundry	✓		
18	Front of Lanudry Store		X	out of order
19	Inside Lanudry Store		X	out of order
20	Landry Office			Remove
21	Front of Steward Office	✓		
22	Plant Room	✓		
23	Front of Plant Room Storage	✓		
24	Inside Plant Room Storage	✓		
25	MDB Room	✓		
26	Generator Room	✓		
27	Building of JAMJUREE stair		X	out of order

Emergency Light and Exit Signage Checklist (Main Kitchen and Cham Cha)

Checked on Date: 05 May 2024

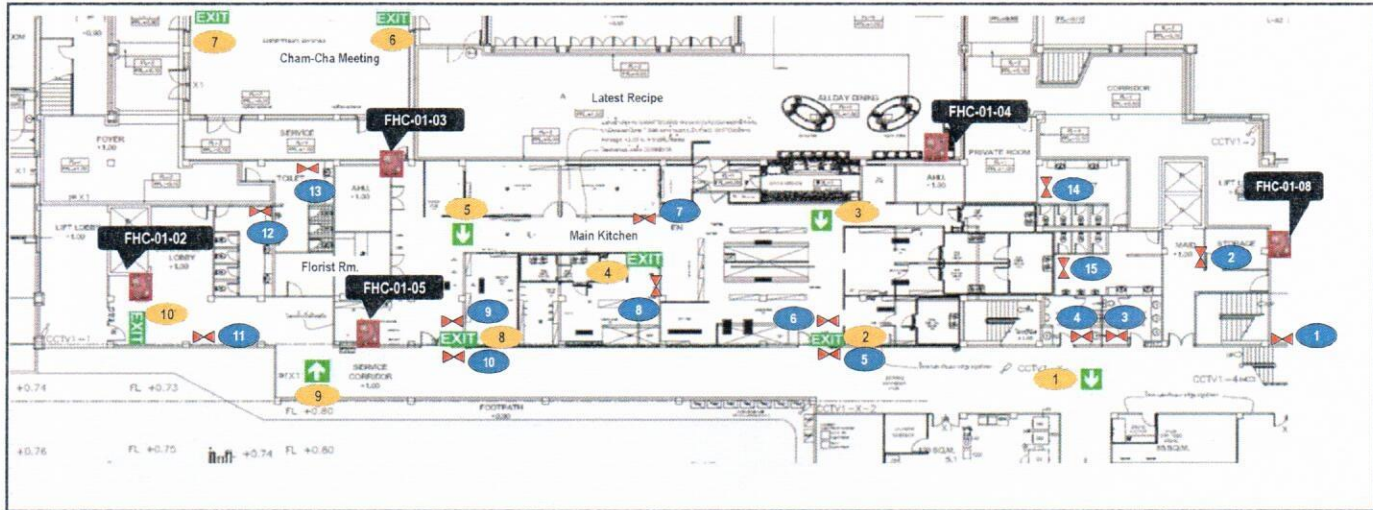


Exit Signage	Location	Status		Remark
		Yes	No	
1	Front of Associate Toilet	✓		
2	Main Kitchen Exit 1	✓		
3	Near Meat Preparation	✓		
4	Bakery room	✓		
5	Near Office Chef	✓		
6	Cham Cha 1	✓		
7	Cham Cha 2	✓		
8	Main Kitchen Exit 2	✓		
9	Opposite Florist room	✓		
10	Fire Exit Door 2	✓		

Emergency Light	Location	Status		Remark
		Yes	No	
1	Stair to behind Ball Room		X	Remove
2	Front of lift service B	✓		
3	Associate Female Toilet		X	out of order
4	Associate Male Toilet		X	out of order
5	Front of Main Kitchen 1	✓		
6	Behind Main Kitchen 1	✓		
7	Front of Bakery Room	✓		
8	Inside Bakery Room	✓		
9	Behind Main Kitchen 2	✓		
10	Front of Main Kitchen 2	✓		
11	Near Florist Room	✓		
12	Cham Cha Guest Female Toilet	✓		
11	Cham Cha Guest male Toilet	✓		
14	Near Florist Room	✓		
15	Front of lift service B 3rd floor	✓		
16	Front of lift service B 4nd floor		X	out of order
17	Cham cha Guest male Toilet	✓		
18	Latest Recipe Guest male Toilet		X	Remove
19	Latest Recipe Guest Female Toile		X	out of order

Emergency Light and Exit Signage Checklist Utopia Room & Toilet Utopia FL.2

Checked On Date: 05 May 2024

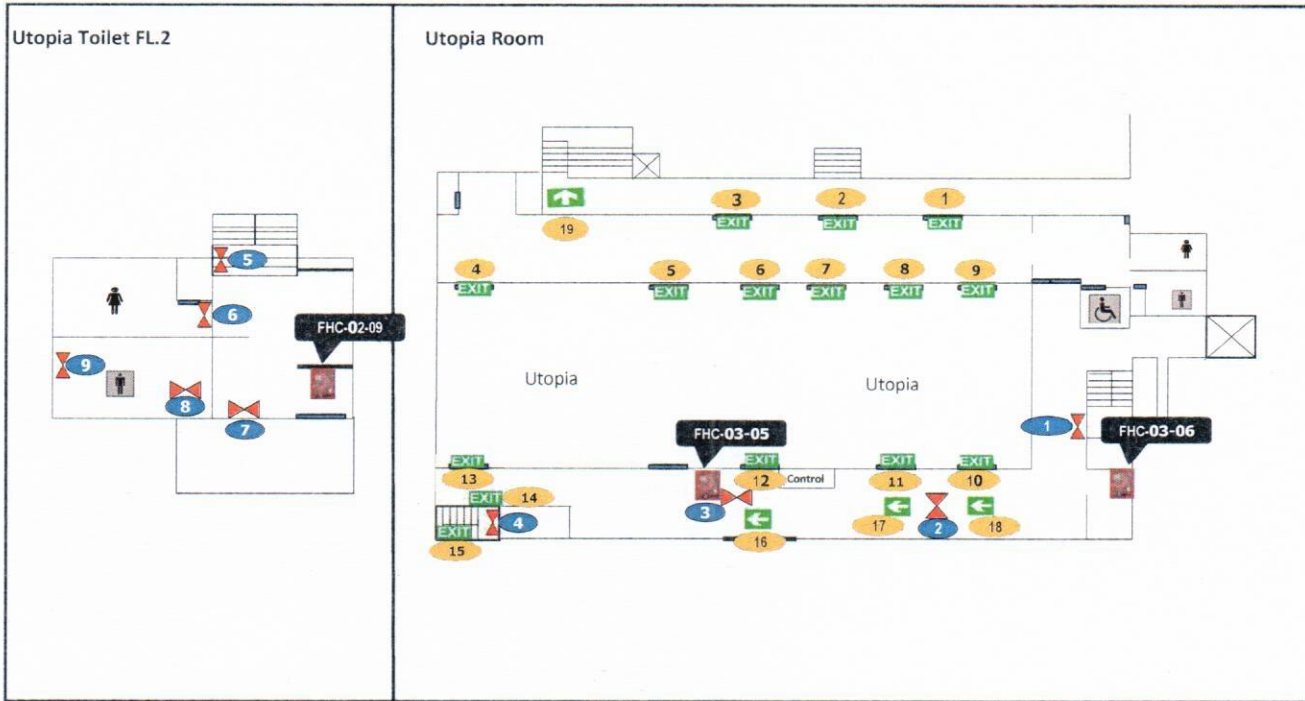


ป้ายหนีไฟ	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	EXIT	Glass Door Utopia Rm. Point 1		X REMOVE
2	EXIT	Glass Door Utopia Rm. Point 2	✓	
3	EXIT	Glass Door Utopia Rm. Point 3	✓	
4	EXIT	In Utopia Rm.	✓	
5	EXIT	In Utopia Rm.	✓	
6	EXIT	In Utopia Rm.	✓	
7	EXIT	In Utopia Rm.	✓	
8	EXIT	In Utopia Rm.	✓	
9	EXIT	In Utopia Rm.	✓	
10	EXIT	In Utopia Rm.	✓	
11	EXIT	In Utopia Rm.	✓	
12	EXIT	In Utopia Rm.	✓	
13	EXIT	In Utopia Rm.	✓	
14	EXIT	Stair down fire exit		x out of order
15	EXIT	Stair up fire exit		x out of order
16	←	Building of Utopia		X REMOVE
17	←	Building of Utopia		X REMOVE
18	←	Building of Utopia		X REMOVE
19	←	Front of Utopia		X REMOVE

ไฟฉุกเฉิน	สถานที่	สถานะ		หมายเหตุ
		✓	x	
1	↔	Building of Utopia		X REMOVE
2	↔	Back of Utopia Rm.		X REMOVE
3	↔	Back of Utopia Rm.		X REMOVE
4	↔	Stair exit building Utopia Rm.		X REMOVE
5	↔	Stair JAMJUREE FL.2	✓	
6	↔	Female toilet of Utopia FL.2	✓	
7	↔	Male toilet of Utopia FL.2	✓	
8	↔	In female toilet of Utopia FL.2		X REMOVE
8	↔	In male toilet of Utopia FL.2		X REMOVE
9	↔	Utopia Fire Escape		X out of order

Emergency Light and Exit Signage Checklist (Lobby)

Checked on Date: 05 May 2024

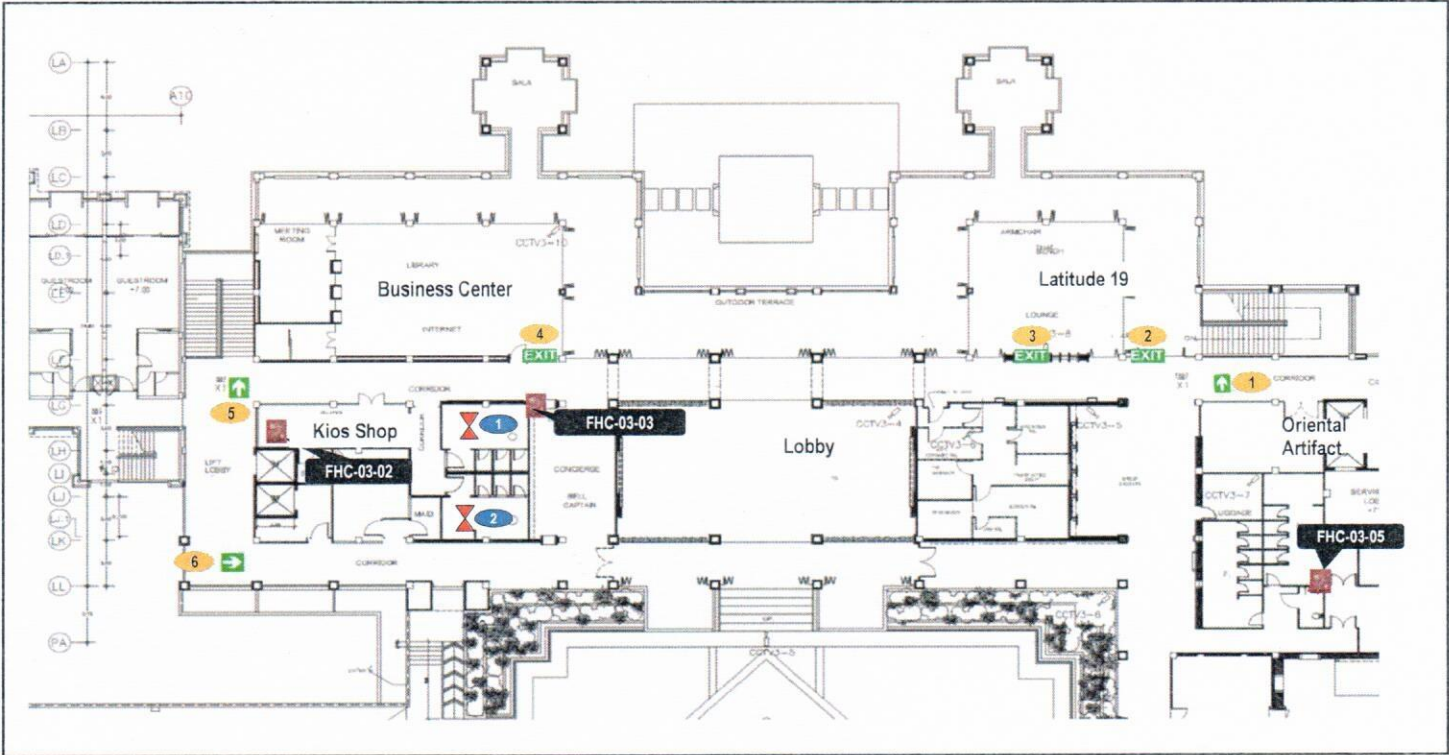


Exit Signage		Location	Status		Remark
			Yes	No	
1		Latitude 19 Stair	✓		
2		Latitude 19 Exit 1	✓		
3		Latitude 19 Exit 2	✓		
4		Library Exit	✓		
5		Kios Stair	✓		
6		Conner Corridor Concierge	✓		

Emergency Light		Location	Status		Remark
			Yes	No	
1		Guest Toilet (Female)	✓		
2		Guest toilet (Male)	✓		



Emergency Light and Exit Signage Checklist (Carpark and Engineer Office)

Checked on Date: 05 May 2024

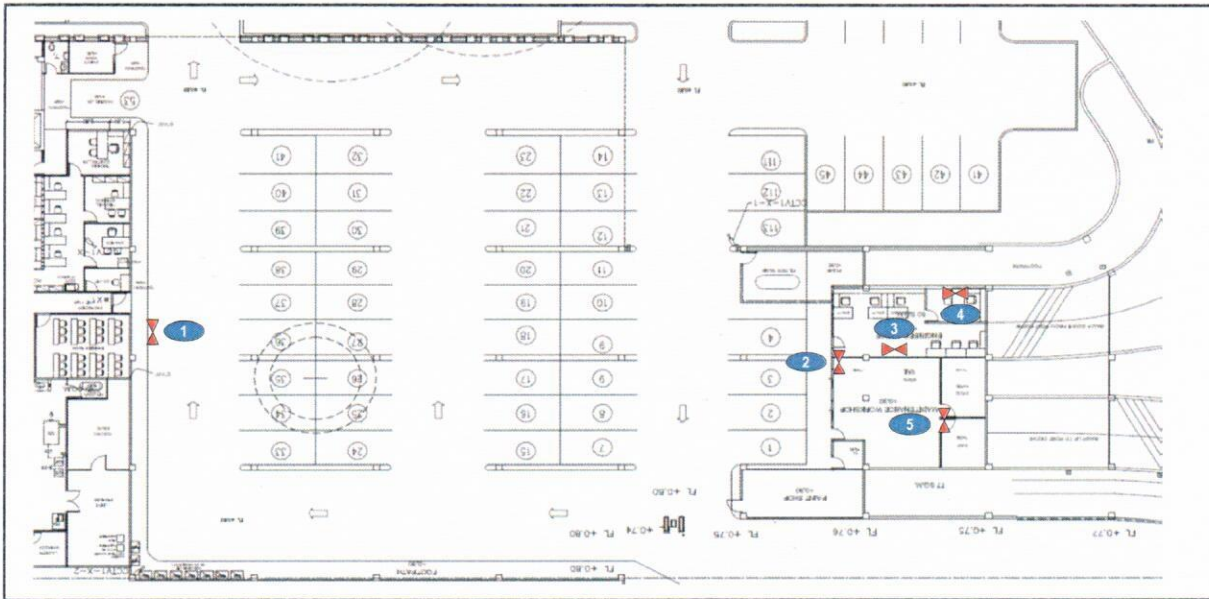


Exit Signage	Location	Status		Remark
		Yes	No	
1	Emergency Exit door		X	out of order
2	In front of Eng Office		X	out of order
3	Engineering Office		X	out of order
4	Chief Engineering office		X	REMOVE
5	Maintenance Shop		X	out of order



Emergency Light and Exit Signage Checklist (Favola Restaurant)

Checked on Date: 05 May 2024

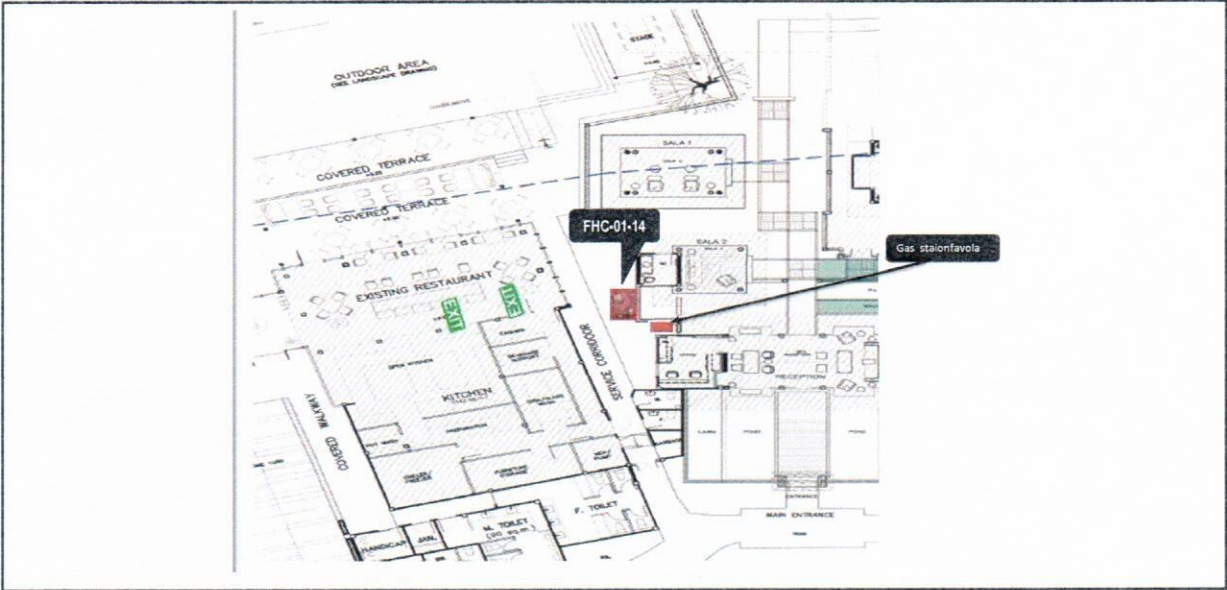


Inside Fire Host Cabinet				
Hose Rack 30	Nozzle	Hydrant Valve 2.5	Extinguisher	Axe

Exit	Signage	Location	Status		Remark
			Yes	No	
1	EXIT	Favola Exit 1	✓		
2	EXIT	Favola Exit 2	✓		
3	EXIT	TBA			



Emergency Light and Exit Signage Checklist (Spa)

Checked on Date: 05 May 2024

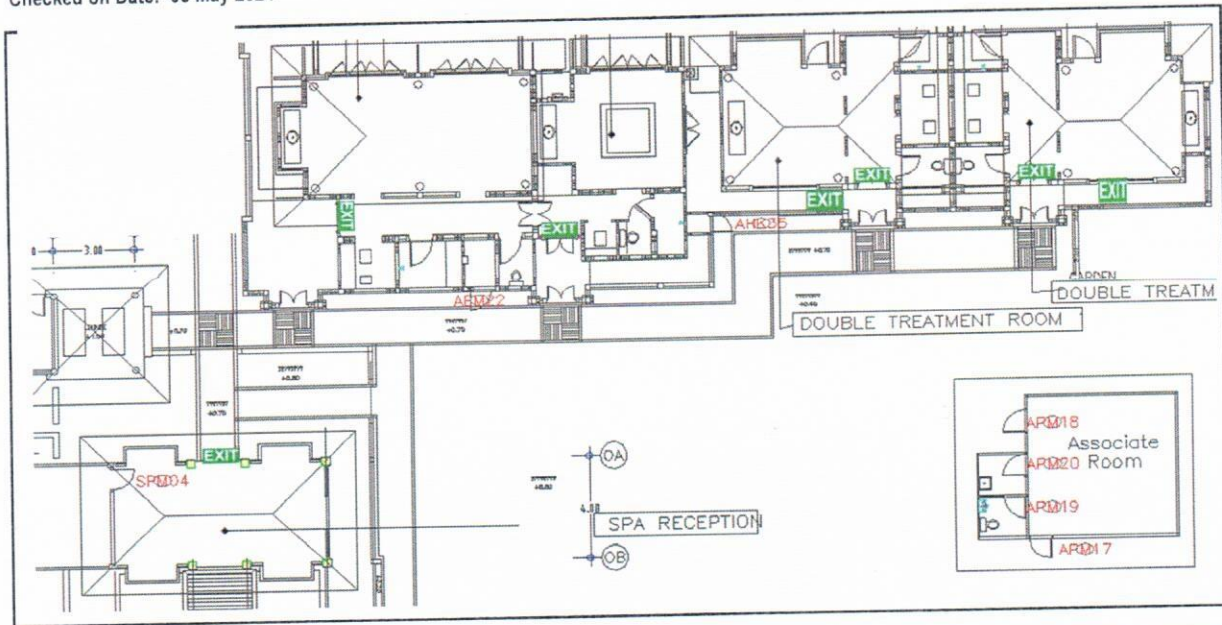

Exit Signage	Location	Status		Remark
		Yes	No	
1	Pavati Spa entrance	✓		
2	Leelawadee Spa entrance	✓		
3	Ratree Spa entrance	✓		
4	Chuanom Spa entrance		x	out of order
5	Chuanom Spa entrance		x	out of order
6	Spa entrance		x	out of order
7	Spa entrance		x	out of order

Emergency light	Location	Status		Remark
		Yes	No	
1	Generator room	✓		



7.13 ตัวอย่างบัตรจดนามผู้เข้าพักโรงแรม

บัตรลงทะเบียนผู้พัก / GUEST REGISTRATION FORM

ชื่อผู้เข้าพัก / Guest Name:	เลขที่การจอง / Confirmation No.:
วันที่เข้าพัก - เวลา / Arrival Date-Time:	ประเภทห้องพัก / Room Type:
วันที่ออกไป - เวลา / Departure Date-Time:	ห้องพักเลขที่ / Room No.:
จำนวนผู้ใหญ่/เด็ก / No. of Adults / Children:	อัตราค่าห้องพัก / Room Rate:
	การชำระเงิน / Mode of Payment:

บริษัท / Company:	ตำแหน่ง / Designation:
ที่อยู่ / Address:	เมือง / City:
*หมายเลขโทรศัพท์ / Phone:	ประเทศ/ภูมิภาค / Country /Region:
*อีเมล / E-mail:	*โทรศัพท์มือถือ / Mobile:

หนังสือเดินทางเลขที่ / Passport no:	สัญชาติ / Nationality / Citizenship:
วันหมดอายุ / Date of Expiry :	วัน เดือน ปี เกิด / Date of Birth:
หมายเลขสมาชิก / Loyalty Number:	ระดับสมาชิก / Loyalty Level:

หมายเหตุ / Remarks:	
---------------------	--

กองตรวจคนเข้าเมือง / Immigration no:	เลขประจำตัวประชาชน / ID Card no:
ออกให้โดย / Issue By:	วันออกบัตร / Issue Date:
วันหมดอายุ / Expiry Date:	มาจาก / Coming From:
อาชีพ / Occupation:	จะไปที่ / Going To:
ใบสำคัญประจำตัวคนต่างด้าวเลขที่ / ID Card For Foreign National No:	

[การใช้บริการ - บริการเพิ่มเติมหรือบริการเช็คเอาท์ด่วน ฯลฯ /OPTIONAL-[PROPERTY USE-EXPRESS CHECK-OUT, UPSELL, FEES, ETC.]

โรงแรมเลอ เมอริเดียน เชียงราย ("โรงแรม") ไม่รับผิดชอบต่อการชำระเงินของห้องพักของท่าน ทางโรงแรมจะไม่รับผิดชอบใด ๆ ในกรณีที่เกิดข้อพิพาทหรือข้อพิพาทอื่น ๆ ของแขกผู้เข้าพักระหว่างการเข้าพักที่โรงแรม เนื่องจากมีบริการ กองบริการที่จัดไว้ให้ในห้องพักและที่แผนกต้อนรับ จะมีการเช็คเอาท์โดยอัตโนมัติโดยไม่ต้องแจ้งให้ทราบล่วงหน้าหลังจากพ้นกำหนดเวลาเช็คอินที่แจ้งไว้ หากท่านต้องการพักต่อและ/หรือเลื่อน วันที่เดินทางกลับ กรุณาติดต่อแผนกต้อนรับส่วนหน้าเพื่อสอบถามห้องพักที่สามารถจัดให้ได้และอัตราค่าห้องพัก อัตราค่าห้องพักแบบครึ่งวันจะพิจารณาจากวันที่เดินทางกลับและห้องพักที่สามารถจัดหาให้ได้

ในกรณีนี้ จะมีค่าบริการเพิ่ม 10% ภาษีมูลค่าเพิ่ม 7% ในรายการใช้จ่ายของท่าน

หลังจากเช็คอินแล้ว ข้าพเจ้าในฐานะผู้เข้าพักที่ลงทะเบียนกับทางโรงแรมขอรับรองว่าจะชำระค่าใช้จ่ายและค่าธรรมเนียมทั้งหมดที่เกิดขึ้นจากข้าพเจ้าและผู้เข้าพักอื่น ๆ ของข้าพเจ้าระหว่างการเข้าพักที่โรงแรม รวมถึงค่าใช้จ่ายต่าง ๆ ไม่จำกัดเฉพาะค่าห้องพัก อาหารและเครื่องดื่ม ภาษีและค่าบริการทั้งหมดของข้าพเจ้า และจะชำระค่าใช้จ่ายทั้งหมดเต็มจำนวนเป็นเงินสดหรือผ่านบัตรเครดิตเมื่อเดินทางกลับ หรือเมื่อใดก็ตามที่ได้รับแจ้งจากทางโรงแรม หากข้าพเจ้าทำให้เกิดความเสียหายต่อทางโรงแรมระหว่างการเข้าพัก ข้าพเจ้าจะรับผิดชอบต่อการสูญเสียหรือความเสียหายทั้งหมดที่เกิดขึ้น รวมถึงค่าใช้จ่ายต่อ ๆ ไปนี้ใช้เพื่อยืนยันความยินยอมโดยไม่มีการเพิกถอนภายหลังของข้าพเจ้า ในการให้สิทธิแก่ทางโรงแรมในการหักค่าใช้จ่าย ค่าธรรมเนียม ค่าเสียหาย หรือค่าสินไหมทดแทนใดๆ ทั้งหมดที่กล่าวไปข้างต้นจากเงินมัดจำและ/หรือบัตรเครดิตของข้าพเจ้า หลังจากลงชื่อด้านล่างนี้ ข้าพเจ้ายังให้ความยินยอมในการจัดเก็บ ใช้งาน เผยแพร่ และถ่ายโอนข้อมูลส่วนตัวของข้าพเจ้าตามที่ระบุด้านล่างแบบฟอร์มนี้ ภายใต้คำแถลงนโยบายความเป็นส่วนตัวของ Marriott Group

The Le Méridien Chiang Rai ("Hotel") does not accept personal cheques for the settlement of your account. The Hotel is not responsible for the loss of money, jewellery and other valuables on property. Free safe deposit boxes are available in the guest room or at the Reception Desk. Rooms will be checked out automatically without prior notice after the noted check out time. Should you wish to extend your stay and/or postpone your departure date, please contact the Front Desk for room availability and the applicable room rate. Half day room rate charges are based on the day of departure and room availability.

A 10% Service Charge, 7% Government Tax will be added to your bill.

By signing this card, I, being the registered guest of the Hotel agree and undertake to pay all charges and expenses incurred by me and my other guests during my stay at the Hotel, including without limitation, all room rates, food and beverage charges, taxes and service charges, and to fully settle my account by cash or credit card upon departure, or at any time as requested by the Hotel. If I cause any damage to the Hotel during my stay, I will be liable for all loss or damage. My signature below signifies my irrevocable consent authorizing the Hotel to deduct all aforesaid charges, expenses, damages or losses from my deposit and/or credit card. By signing below, I also consent to my Personal Data being collected, used, shared and transferred as detailed on the back of this form and in the Marriott Group Global Privacy Statement.

วันที่ / Date : _____ลายมือชื่อผู้เข้าพัก / Guest Signature: _____
เช็คอินโดย / Checked-in by: _____ยืนยันโดย / Confirmed by: _____

กลุ่มบริษัทแม่อรөө* จะเก็บและใช้ข้อมูลส่วนบุคคลที่ท่านมอบให้ตามที่เราเปิดเผยในประกาศเรื่องความเป็นส่วนตัวที่ใช้ทั่วโลกของเรา (ดูได้ที่แผนกต้อนรับและทางออนไลน์) เพื่อการจัดหาสินค้าและบริการให้ท่าน เพื่อปฏิบัติตามข้อกำหนดทางกฎหมายและตามสัญญา และเพื่อยืนยันหรือปกป้องสิทธิหรือสิทธิเรียกร้องตามกฎหมายหากจำเป็น ท่านต้องมอบข้อมูลส่วนบุคคลนี้ให้แก่เรา เพื่อให้เราสามารถจัดหาสินค้าและบริการให้ท่านได้ตามคำร้องขอ นอกจากนี้ กลุ่มบริษัทแม่อรөөจะเก็บและใช้ข้อมูลส่วนบุคคลของท่าน (ซึ่งเป็นส่วนหนึ่งของข้อมูลส่วนบุคคล) เพื่อปรับปรุงการเข้าพักในปัจจุบันและในอนาคตของท่านให้ดียิ่งขึ้น “ข้อมูลส่วนบุคคล” จะรวมถึงความสนใจ กิจกรรม อาหารและเครื่องดื่มที่เลือก และการขอรับบริการและสิ่งอำนวยความสะดวกต่าง ๆ โดยท่านอาจเป็นผู้ให้ข้อมูลความชอบส่วนตัวนี้เองหรือเราอาจเก็บข้อมูลจากการสังเกตการณ์ ท่านปฏิเสธความยินยอมที่จะให้เรเก็บและใช้ข้อมูลความชอบส่วนตัวได้ แต่หากไม่มีข้อมูลดังกล่าว เราอาจไม่สามารถมอบประสบการณ์การเข้าพักที่เป็นไปตามความชอบส่วนตัวของท่านได้ เราจะเป็นข้อมูลส่วนบุคคลของท่านกับบรรดาเจ้าของโรงแรมและผู้รับสิทธิแฟรนไชส์ โดยบุคคลเหล่านั้นต้องใช้ข้อมูลส่วนบุคคลให้เป็นไปตามสัญญาที่มีอยู่กับเรา กลุ่มบริษัทแม่อรөө เจ้าของโรงแรม และผู้รับสิทธิแฟรนไชส์ต่างต้องรับผิดชอบข้อมูลส่วนบุคคลอย่างมีประสิทธิภาพ

ทั้งนี้ เพื่อให้ได้รับอนุญาตตามกฎหมายที่มีผลบังคับ กลุ่มบริษัทแม่อรөөในฐานะบริษัทที่มีการประกอบกิจการทั่วโลก อาจส่งข้อมูลส่วนบุคคลของท่านไปยังประเทศสหรัฐอเมริกาและประเทศอื่น ๆ ซึ่งอาจมีกฎหมายคุ้มครองข้อมูลที่แตกต่างไปจากประเทศของท่าน ท่านสามารถขอเข้าดู ข้อสำเนา หรือขอแก้ไขหรือลบข้อมูลส่วนบุคคลของท่าน คัดค้านการประมวลผลข้อมูลส่วนบุคคลของท่าน เปลี่ยนแปลงข้อมูลของท่านหากการติดต่อต้องการ ร้องเรียนหรือสอบถามเกี่ยวกับข้อมูลส่วนบุคคลของท่านได้ โดยติดต่อ ผู้อำนวยการ - ทรัพยากรข้อมูล (Director of Global Compliance, Privacy, Marriott International, Inc) ของกลุ่มบริษัทแม่อรөөทางอีเมลที่ MarriottDPO@marriott.com ทางโทรศัพท์ที่ +1-240-632-3247 หรือทางไปรษณีย์ผ่านการใช้การปฏิบัติตามข้อกำหนดทั่วโลก แผนกความเป็นส่วนตัว 10400 ถนนแฟร์นวูดเบเธสดา แมริแลนด์ 20817 สหรัฐอเมริกา (Director of Global Compliance, Privacy, Marriott International, Inc, 10400 Fernwood Road, Bethesda, MD, 20817, USA) ท่านอาจร้องเรียนต่อหน่วยงานผู้มีอำนาจด้านการคุ้มครองข้อมูลภายในประเทศของท่านได้ทุกเวลาเช่นกัน

☐ ข้าพเจ้าตกลงให้มีการเก็บ ใช้ และส่งข้อมูลความชอบส่วนตัวของข้าพเจ้าไว้ เพื่อให้การเข้าพักที่โรงแรมของข้าพเจ้าได้รับการจัดการให้เป็นไปตามความชอบส่วนตัว ตามรายละเอียดที่ระบุข้างต้นและในประกาศเรื่องความเป็นส่วนตัวที่ใช้ทั่วโลกของกลุ่มบริษัทแม่อรөө

*คำที่ใช้ต้นด้วยอักษรตัวใหญ่ซึ่งใช้ในบัตรลงทะเบียนนี้ มีคำอธิบายอยู่ในประกาศเรื่องความเป็นส่วนตัวที่ใช้ทั่วโลก

โปรแกรมLOYALTY MARRIOTT BONVOY™: สมาชิกภาพและสิทธิประโยชน์ของ โปรแกรมLOYALTY Marriott Bonvoy จะมอบให้ตามดุลยพินิจของบริษัท แม่อรөө อินเตอร์เนชั่นแนล, อินค. และบริษัทในเครือ (“แม่อรөө”) ความหมายของคำจำกัดความตัวหนาที่ใช้ในเอกสารฉบับนี้ ได้ถูกกำหนดไว้ภายใต้หัวข้อ ข้อกำหนดและเงื่อนไข ของสมาชิก **โปรแกรมLOYALTY Marriott Bonvoy ศึกษารายละเอียดทั้งหมดได้ที่ www.marriott.com/loyalty/terms/default.mi** ทั้งนี้ เพื่อให้กฎหมายอนุญาต แม่อรөөและโปรแกรมพันธมิตรมีสิทธิเปลี่ยนแปลง จำกัด ปรับปรุง หรือยกเลิกกฎเกณฑ์ของโปรแกรม ข้อบังคับ ของรางวัล และระดับของรางวัลได้ทุกเวลา ไม่ว่าจะมีการแจ้งให้ทราบหรือไม่ แม้ว่าการเปลี่ยนแปลงดังกล่าวอาจมีผลกระทบต่อมูลค่าของคะแนนหรือไมล์ที่ได้สะสมไว้ ความสามารถในการใช้คะแนนหรือไมล์ที่ได้สะสมไว้ หรือความสามารถในการได้รับของรางวัลบางอย่าง แม่อรөөและโปรแกรมพันธมิตรอาจดำเนินการดังต่อไปนี้และดำเนินการอื่น ๆ : ก) เพิ่มหรือลดจำนวนคะแนนหรือไมล์ที่ได้รับจากการเข้าพัก หรือที่ต้องใช้สำหรับแลกของรางวัล ข) เพิกถอน จำกัด ปรับปรุง หรือยกเลิกของรางวัลหรือหมดอายุใด ๆ ค) เพิ่มกำหนดวันที่ห้ามใช้ของรางวัล จำกัดหรือที่ใช้จ่ายของรางวัลได้ในที่พักที่เข้าร่วมรายการ หรือจำกัดการใช้ของรางวัลต่อไปโดยประการอื่น ง) เปลี่ยนแปลงสิทธิประโยชน์ของโปรแกรม บริษัทพันธมิตรเกี่ยวกับการเดินทาง สถานที่ซึ่งให้บริการโดยแม่อรөөหรือโปรแกรมพันธมิตรเงื่อนไขการเข้าร่วมรายการ กฎเกณฑ์ในการได้รับ แลก เก็บสะสม หรือถูกระงับคะแนนหรือไมล์ หรือกฎเกณฑ์ที่ใช้บังคับสำหรับการใช้ของรางวัล จ) เปลี่ยนแปลงหรือยกเลิกของรางวัลของ โปรแกรมพันธมิตร อนึ่ง การสะสมคะแนนหรือไมล์ไม่ได้ทำให้สมาชิกได้รับสิทธิใด ๆ เกี่ยวกับคะแนน ไมล์ของรางวัล หรือสิทธิประโยชน์ของโปรแกรม ในการสะสมคะแนนหรือไมล์ สมาชิกอาจยื่นข้อกล่าวหาของรางวัลหรือระดับของรางวัลและหมดอายุใด ๆ ใดๆจะมีอยู่ต่อไป ข้อกำหนดและเงื่อนไขทั้งหมดของ โปรแกรมLOYALTY Marriott Bonvoy จะมีผลบังคับ โปรดดูรายละเอียดทั้งหมดที่ www.marriott.com/loyalty/terms/default.mi

การใช้ข้อมูลส่วนบุคคล : ในการลงทะเบียนเข้าเป็นสมาชิกโปรแกรมLOYALTY Marriott Bonvoy จะมีการจัดเก็บข้อมูลชื่อ หมายเลขโทรศัพท์มือถือ และที่อยู่ของสมาชิก ข้อมูลเกี่ยวกับการใช้และการเปิดเผยข้อมูลส่วนบุคคลของท่านเมื่อมีอายุอย่างต่ำ และในคำแถลงเรื่องความเป็นส่วนตัวที่ใช้ทั่วโลกของกลุ่มบริษัทแม่อรөө (Marriott Group Global Privacy Statement) (ดูได้ที่แผนกต้อนรับของโรงแรมและทางออนไลน์)

☐ ตกลง โปรดลงทะเบียนข้าพเจ้าเข้าเป็นสมาชิกโปรแกรมLOYALTY Marriott Bonvoy ข้าพเจ้าตกลงตามข้อกำหนดและเงื่อนไขของ โปรแกรมLOYALTY Marriott Bonvoy และข้อกำหนดของคำแถลงเรื่องความเป็นส่วนตัวที่ใช้ทั่วโลกของกลุ่มบริษัทแม่อรөө

PRIVACY INFORMATION

The Marriott Group* will collect and use Personal Data provided by you as described in our Global Privacy Statement (available at the front desk and online) to provide you goods and services, to comply with legal and contractual requirements and, if necessary, to assert or defend a legal right or claim. It is mandatory that you provide us with this Personal Data so we can provide you with the goods and services requested by you.

The Marriott Group will also collect and use Personal Preferences (a subset of Personal Data) to enhance your current and future stays. “Personal Preferences” include your interests, activities, food and beverage choices, and service and amenity requests. Personal Preferences may be provided by you or collected by observation. You may withhold consent to our collection and use of your Personal Preferences, but without it, we may not be able to provide personalized experiences.

We will share your Personal Data with Owners and Franchisees, and they are required to use Personal Data according to their contract with us. Marriott Group, Owners and Franchisees are each independently responsible for Personal Data.

To the extent permitted by applicable law, the Marriott Group, as a company with global operations, may transfer your Personal Data to the United States and other countries where data protection laws may differ from those of your home country.

You may request access to, a copy of, or request the correction or deletion of your Personal Data, object to the processing of your Personal Data, make a change to your communication preferences, make a complaint or ask a question relating to your Personal Data, by emailing MarriottDPO@marriott.com, writing to: Director of Global Compliance, Privacy, Marriott International, Inc., 10400 Fernwood Road, Bethesda, MD, 20817, U.S.A., or calling +1-240-632-3247. You may also make a complaint with a data protection authority at any time.

☐ I agree that my Personal Preferences may be collected, used and transferred to personalize my hotel stays, as detailed above and in the Marriott Group Global Privacy Statement.

*Capitalized terms used in this Registration Card are described in the Global Privacy Statement.

MARRIOTT BONVOY™ LOYALTY PROGRAM: Marriott Bonvoy Loyalty Program Membership and its benefits are offered at the discretion of Marriott International, Inc. and its affiliates (“Marriott”). Capitalized words used in this document are defined in the Marriott Bonvoy Loyalty Program Terms and Conditions at www.marriott.com/loyalty/terms/default.mi. To the extent permitted by law, Marriott and its Partner Programs have the right to change, limit, modify or cancel Program Rules, regulations, Awards and Award levels at any time, with or without notice, even though such changes may affect the value of Points or Miles already accumulated, the ability to use accumulated Points or Miles, or the ability to obtain certain Awards. Marriott and its Partner Programs may, among other things: a) increase or decrease the number of Points or Miles received for a stay or required for an Award; b) withdraw, limit, modify or cancel any Award or category; c) add blackout dates, limit rooms available for any Award at any Participating Property or otherwise restrict the continued availability of Awards; d) change program benefits; travel partners; locations served by Marriott or its Partner Programs; conditions of participation; rules for earning, redeeming, retaining or forfeiting Points or Miles; or rules governing the use of Awards; e) change or cancel its Partner Program awards. The accumulation of Points or Miles does not entitle Members to any vested rights with respect to Points, Miles, Awards or program benefits. In accumulating Points or Miles, Members may not rely upon the continued availability of any Award or Award level and category. All the Marriott Bonvoy Loyalty Program Terms and Conditions apply. Please visit www.marriott.com/loyalty/terms/default.mi for full details.

USE OF PERSONAL DATA: Your name, cell phone number and email address will be collected to enroll you in the Marriott Bonvoy Loyalty Program. Information relating to the use and disclosure of your Personal Data is described below and in the Marriott Group Global Privacy Statement (available at the Hotel front desk and online).

☐ Yes, please enroll me in the Marriott Bonvoy Loyalty Program. I agree to the Marriott Bonvoy Loyalty Program Terms and Conditions and the terms of the Marriott Group Global Privacy Statement.

7.14 ใบอนุญาตจัดตั้งสถานที่จำหน่ายอาหาร หรือสถานที่สะสมอาหาร



ในอัญญาต
การประกอบกิจการสหกรณ์ช่วยเหลืออาหาร หรือ สหกรณ์สะสมอาหาร

สำนักงานเทศบาลนครฉะเชิงเทรา

อัญญาตให้	บริษัท เชนทรี โฮเทล จำกัด	สัญญา	-
อยู่บ้านเลขที่ 221/2 หมู่ 20 ต.รอก/ช้อย -	ถนน แดงทอง		
ตำบล/แขวง รอบเวียง อำเภอ/เขต เมือง จังหวัด ฉะเชิงเทรา	โทรศัพท์ 053-503333		

ข้อ 1) ประกอบกิจการประเภท (สหกรณ์ช่วยเหลืออาหาร/สะสมอาหาร) ช่วยเหลืออาหาร

โดยให้ชื่อสหกรณ์ประกอบ การ โรงแรมเดอะเมอริเดียน ฉะเชิงเทราวิสาหกิจ

ตั้งอยู่บ้านเลขที่ 221/2 หมู่ที่ 20 ต.รอก/ช้อย -	ถนน แดงทอง
--	------------

ตำบล/แขวง รอบเวียง อำเภอ เมืองฉะเชิงเทรา จังหวัด ฉะเชิงเทรา	โทรศัพท์ -
---	------------

มีพื้นที่ประกอบกิจการ เกิน 500 ไร่ไม่เกิน - ตารางเมตร

ทั้งนี้ ได้เสียค่าธรรมเนียมในอัญญาตจำนวน

ตามใบเสร็จรับเงินเลขที่ 87 เลขที่ 02 ลงวันที่ 7 เดือน กันยายน พ.ศ. 2566

ข้อ 3) ผู้ได้รับในอัญญาตต้องปฏิบัติตามข้อกำหนดด้านสุขลักษณะตามที่กำหนดไว้ในข้อกำหนดของเทศบาลนครฉะเชิงเทรา

ข้อ 4) ผู้ได้รับในอัญญาตต้องปฏิบัติตามเงื่อนไขเฉพาะดังต่อไปนี้

- ปฏิบัติตามเทศบัญญัติเทศบาลนครฉะเชิงเทรา ข้อ 2545 และปฏิบัติตามเงื่อนไขโดยยึดด้วยสุขลักษณะตามคำแนะนำของสำนักงานสาธารณสุขอำเภอ คำสั่งของสำนักงานท้องถิ่น คำแนะนำของหน่วยงานส่วนที่ 10000 ประเด็น ข้อบังคับ และประกาศของเทศบาลนครฉะเชิงเทรา

ในอัญญาตฉบับนี้ขึ้นอายุวันที่	10	เดือน	กันยายน	พ.ศ.	2567
ออกให้ ณ วันที่	7	เดือน	กันยายน	พ.ศ.	2566

- คำเตือน 1. ต้องแสดงในอัญญาตนี้ไว้ในที่เปิดเผย ณ สหกรณ์ที่ได้รับอัญญาตให้ประกอบกิจการ
2. ผู้ใดดำเนินการประกอบกิจการตามที่กำหนด ให้เป็นกิจการที่ต้องมีการควบคุมตามเทศบัญญัติเทศบาลนครฉะเชิงเทรา โดยไม่ได้รับอัญญาตจากสำนักงานท้องถิ่น มีโทษจำคุกไม่เกินหกเดือน หรือปรับไม่เกิน 50,000 บาท
3. หากประสงค์จะประกอบกิจการในข้อ 1 ไม่ต้องยื่นคำขอต่อในอัญญาตก่อนในอัญญาตขึ้นอายุ
4. หากเกิดกรณีการร้องเรียนหรือความผิดปกติของกระบวนการในอัญญาตทันที
5. หากมีกฎหมายหรือข้อบังคับ สหกรณ์ใดต่อได้ที่ งานสุภาพวิภา ภาของสาธารณสุขและสิ่งแวดล้อมสำนักงานเทศบาลนครฉะเชิงเทรา โทร. 0-5371-1333 ต่อ 404

7.15 ใบอนุญาตประกอบกิจการที่เป็นอันตรายต่อสุขภาพ

ใบอนุญาตประกอบกิจการที่เป็นอันตรายต่อสุขภาพ

สำนักงานเทศบาลนครฉะเชิงเทรา

อนุญาตให้ บริษัท เชนารี โฮเทล จำกัด สัญชาติ - สัญชาติ -
บ้านเลขที่ 221/2 หมู่ 20 ตระกุ่ม/บ่อขย - ถนน แดงทราย

ตำบล/แขวง รอบเวียง อำเภอ/เขต เมืองเวียงจันทน์ จังหวัด เวียงจันทน์ โทรศัพท์ 053-503333

ข้อ 1) ประกอบกิจการที่เป็นอันตรายต่อสุขภาพประเภท โรงแรม, ภัตตาคาร, สระว่ายน้ำ, ทำเบเกอรี่
โดยให้เจ้าพนักงานประกอบกิจการว่า โรงแรมเฉลิมเอวโรดิยน ดิยงราชวิศวรรักษ์

ตั้งอยู่บ้านเลขที่ 221/2 หมู่ 20 ต.กรง/บ่อ - ถนน แควทอง

ตำบล/แขวง รอนเวียง อำเภอ/เขต เมืองเวียงจันทน์ จังหวัด เวียงจันทน์ โทรศัพท์ 053-603333

มีพื้นที่ประกอบการ ตารางเมตร ใต้เครื่องจักรที่มีกำลังขนาด ไม่นเกิน - แรงม้า

จำนวนตามลักษณะกิจการ 159 ต่๑/เครือ๑/หมู่๑/หลัง/ติดร จำนวนคนงาน - คน

ทั้งนี้ ได้เสียค่าธรรมเนียมใบอนุญาตจำนวน

ตามใบเสร็จรับเงินฉบับที่ 70 เลขที่ 72 ลงวันที่ 7 เดือน กันยายน พ.ศ. 2566

ข้อ 2) ผู้ได้รับใบอนุญาต ต้องปฏิบัติตามข้อกำหนดด้านสุขลักษณะตามที่กำหนดไว้ในข้อกำหนดของเทศบาลเมือง เทศบาลนครเชียงราย

ข้อ 3) ผู้ได้รับใบอนุญาตต้องปฏิบัติตามเงื่อนไขเฉพาะ ดังต่อไปนี้

- ปฏิบัติตามเทศบัญญัติเทศบาลนครเชียงใหม่ ว่าด้วยการควบคุมกิจการที่เป็นอันตรายต่อสุขภาพ พ.ศ. 2549

และปฏิบัติการอื่นใดเกี่ยวข้องด้วยสุจริตและตามคำแนะนำของเจ้าพนักงานสาธารณสุข คำสั่งของเจ้าพนักงานท้องถิ่นคำแนะนำของพนักงาน
เจ้าหน้าที่ ตลอดจนระเบียบ ข้อบังคับ และประกาศของประเทศมาจนครบดียังราย

ในอุทฺตมคณปิณฑิตายุสฺสํ 10 เดือน กันยายน พ.ศ. 2567

๑๐๑ ให้ ณ วันที่ 7 เดือน กันยายน พ.ศ. 2566

- คำเตือน 1. ต้องแสดง ใบอนุญาตนี้ไว้ในที่เปิดเผย ณ สถานที่ที่ได้รับอนุญาตให้ประกอบกิจการ
2. ผู้ใดฝ่าฝืนกิจการตามประเภทที่กำหนด ให้เป็นกิจการที่ต้องมีการควบคุมตามเทศบัญญัติเทศบาลนคร
เชียงใหม่ โดยไม่ได้รับอนุญาตจากเจ้าพนักงานท้องถิ่น มีโทษจำคุก ไม่เกินหกเดือน หรือปรับไม่เกิน
50,000 บาท
3. หากประสงค์จะประกอบกิจการในบิต่อไปต้องยื่นคำขอต่อยุในอนุญาตก่อนในอนุญาตสิ้นอายุ
4. หากเกิดกรณีการร้องเรียนเหตุว่าคาถาหมอลำเป็นจริง จะถูกระงับในอนุญาตทันที
5. หากมีบัญชาหรือข้อสงสัย สามารถติดต่อได้ที่ งานสุภาพบุรุษ กองสาธารณสุขและสิ่งแวดล้อมสำนักงาน
เทศบาลนครเชียงใหม่ โทร. 0-5 371-1333 ต่อ 404