

ภาคผนวก 2.4
บันทึกการตรวจสอบประสิทธิภาพ
ระบบป้องกันอัคคีภัย

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector	✓		
3.	Smoke Detector		✓	
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / Remark				
401 = 5024 - 38				
406 = 5024 - 68				
413 = 5024 - 68				
402 = 5024 - 36				
409 = 5024 - 63				
410 = 5024 - 65				
<div> <div>Elkachi</div> <div>Operation By</div> </div> <div> <div>Elkachi</div> <div>Redcheck By</div> </div> <div> <div>OK</div> <div>Chief Engineer</div> </div>				

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector	✓		
3.	Smoke Detector		✓	
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / Remark				
411 = 5024 - 64				
410 = 5024 - 62				
416 = 5024 - 60				
419 = 5024 - 57				
915 = 5029 - 42				
<div> <div>Elkachi</div> <div>Operation By</div> </div> <div> <div>Elkachi</div> <div>Redcheck By</div> </div> <div> <div>OK</div> <div>Chief Engineer</div> </div>				

DATE: 20-May-24
LOCATION: 409

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		/	
2.	Heat Detector	/		
3.	Smoke Detector		/	
4.	Pull Manual Call Point		/	
5.	Strobe Light		/	
6.	Horn and Strobe Speaker		/	
7.	Alarm buzzer		/	
8.	Zone Indicator panel	/		
9.	Graphic Zone Display Panel	/		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		/	
11.	Fire Ventilation System Automatic Close		/	
12.	Gas Protection Valve Automatic Close		/	
13.	Pressurize Fan System Automatic Open		/	
14.	Smoke Fan System Automatic Open		/	
15.	Air condition : AHU and OAU System Automatic Close		/	
16.	Telephone jack		/	
17.	Sounder base	/		
18.	Fire work control program	/		
Common / ทั่วไป				

Signature: [Signature] Chief Engineer

Signature: [Signature] Redcheck By

Operation By

[illegible]

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE: 05-July-24
LOCATION: 403

LOCATION403.....

[illegible]

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE: 04-JUNE-20
LOCATION: A23

LOCATION 423

[illegible]

DATE : 03- July-20
 LOCATION : 404

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector	✓		
3.	Smoke Detector		✓	
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / Remark 404 = 502A-7A				
		Operation By <i>Elkadey</i>		Chief Engineer <i>OK</i>
		Recheck By <i>Elkadey</i>		

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 7,15,16-May-24
LOCATION 311,316,320,323
324,915 (Bed Room),915 (Living Room)

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack	✓		
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / หมายเหตุ 311 = 5023-22				
316 = 5023-18				
320 = 5023-14				
323 = 5023-11				
324 = 5023-10				
915 (Living Room) = 5024-9				
915 (Bed Room) = 5029-8				
Operation By Ekkachai				
Check By Ekkachai				
Chief Engineer				

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 02,03-May-24
LOCATION 404,318,309
325,328

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / หมายเหตุ 319 = 5023-16				
325 = 5023-9				
328 = 5023-5				
309 = 5023-14				
404 = 5024-67				
Operation By Ekkachai				
Check By Ekkachai				
Chief Engineer				

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 3-8-May-24
LOCATION 909, 1009, 1012, 1014, 1025 (Living Room)

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Mammal Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		

Comment / Remark
990 = 9029-14
1009 = 90210-67
1012 = 90210-63
1014 = 90210-62
1025 (Living Room) = 90210-51

.....
Elkachi
Operation By

.....
Elkachi
Recheck By

.....
As
Chief Engineer

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 07-May-24
LOCATION 213, 216, 219, 210, 909, 904, 902

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Mammal Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		

Comment / Remark
211 = 9027-64
216 = 9027-60
217 = 9027-39
220 = 9027-56
902 = 9028-18
904 = 9028-116
907 = 9028-111

.....
Elkachi
Operation By



.....
Elkachi
Recheck By

.....
As
Chief Engineer

RM
20/May/2018

DATE: 20/May/24

LOCATION 927, 408, 1107

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector		✓	
4.	Pull Manual Call Point	✓		
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
<p>Comment / หมายเหตุ</p> <p>408 = 5027-66</p> <p>927 = 5024-6</p> <p>1107 = 50211-119</p>				
<p>Operation By  Chief Engineer </p>				

PREVENTIVE MAINTENANCE : FIRE ALARM

PREVENTIVE MAINTENANCE : FIRE ALARM

BANGKOK FUTURE PARK RANGSIT

BANGKOK FUTURE PARK MARKET

DATE: 28-May-24




LOCATION	502,509,513,518
----------	-----------------

LOCATION 502, 509, 513, 516

LOCATION *****5245725



[illegible][illegible]

DATE: 21 MAY - 24
LOCATION: 810, 905, 907, 909
010, 924

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel			
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / หมายเหตุ		910 = 5029-109		
		905 = 5029-30		
		903 = 5029-23		
		909 = 5029-25		
		910 = 5029-23		
		914 = 5029-10		
		 Ekkachai		
		 Ekkachai		
Operation By		 Chief Engineer		

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE: 30-MAY-24
LOCATION 321, 528, 1105
1127

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
<p>Comment / # of item 321 = 3D23-13</p> <p>528 = 3D25-69</p> <p>1105 = 3D21-116</p> <p>1124 = 3D21-89</p>				
<p>Operation By  Recheck By </p> <p>Chief Engineer</p>				

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE: 24-MAY-74

LOCATION 705, 721, 727

801, 819, 820, 822

[illegible]

DATE : 04-June-24
LOCATION : 808

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		

Comment / หมายเหตุ

Eldachan

Operation By

Eldachan

Recheck By

Ors

Chief Engineer

DATE : 31-May-24
LOCATION : 1008, 1010, 1011
1010

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		

Comment / หมายเหตุ

1008 = 5DZ10-68
1010 = 5DZ10-65
1011 = 5DZ10-64
1010 = 5DZ10-56

borin

Operation By

borin

Recheck By

Ors

Chief Engineer

DATE: 05-June-24
LOCATION: 715, 725, 1001
1002.

DATE: 01-June-24
LOCATION: 309,314
609,616

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base		✓	
18.	Fire work control program	✓		
Comment / 備註				
				Chief Engineer
				Recheck By
				Operation By

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer	✓		
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel		✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / หมายเหตุ 308 = 5023-26 314 = 5023-20 609 = 5026-25 616 = 5026-19				

Reluctant

Operation By

Reluctant

Recheck By

Chief Engineer

PREVENTIVE MAINTENANCE : FIRE ALARM

NOVOTEL
DANGKOK FUTURE PARK RANGSIT

06-2017-90

DATE: 08-JUNE-74
LOCATION 821, 423

LOCATION	
821, 423	

[illegible][illegible]

DATE: 10-July-24

LOCATION: 603, 621, 323

DATE: 01-July-24
LOCATION 303, 615, 605
903, 812, 1112

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition - AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
<p>Comment / หมายเหตุ</p> <p>103 = 5026-33</p> <p>601 = 5026-13</p> <p>883 = 5028-05</p>				

๕๒๕๓๓๓๓๓

Operation By

๕๒๕๓๓๓๓๓

Check By

๕๒๕๓๓๓๓๓

Chief Engineer

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓		
2.	Heat Detector	✓		
3.	Smoke Detector	✓		
4.	Pull Manual Call Point			
5.	Stroke Light	✓		
6.	Horn and Stroke Speaker	✓		
7.	Alarm buzzer	✓		
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓		
11.	Fire Ventilation System Automatic Close	✓		
12.	Gas Protection Valve Automatic Close	✓		
13.	Pressurize Fan System Automatic Open	✓		
14.	Smoke Fan System Automatic Open	✓		
15.	Air condition : AHU and OAU System Automatic Close	✓		
16.	Telephone jack	✓		
17.	Sounder base	✓		
18.	Fire work control program	✓		
<p>Comment / Signature</p> <p>307 = 5023-174</p> <p>603 = 5026-30</p> <p>615 = 5026-14</p> <p>919 = 5028-105</p> <p>903 = 5029-33</p> <p>1117 = 50211-108</p>				

Operation By

Eklachin

Recheck By

Eklachin

Chief Engineer

[Signature]

PREVENTIVE MAINTENANCE : FIRE ALARM

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE: 11-july-24

DATE: 11-july-24

LOCATION 908,623,611
1114,327

LOCATION 1013, 1019

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack	✓		
17.	Sounder base	✓		
18.	Fire work control program	✓		
<p>Common / ทั่วทั้งระบบ</p> <p>908 = 5129-26</p> <p>623 = 5126-11</p> <p>611 = 5126-92</p> <p>322 = 5123-6</p> <p>1114 = 51211-106</p>				
<p>Phachai.....</p> <p>Operation By</p>				
<p>Phachai.....</p> <p>Checked By</p>				
<p>Chief Engineer</p>				

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 16-July-24
LOCATION : 714

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / หมายเหตุ				
714 = 5027 - 62				
		Operation By		
		Ekkachai		
		Redeek By		
		Ekkachai		
		Chief Engineer		
		OB		

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 15-July-24
LOCATION : 724, 806, 813

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector		✓	
2.	Heat Detector		✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point		✓	
5.	Strobe Light		✓	
6.	Horn and Strobe Speaker		✓	
7.	Alarm buzzer		✓	
8.	Zone Indicator panel	✓		
9.	Graphic Zone Display Panel	✓		
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)		✓	
11.	Fire Ventilation System Automatic Close		✓	
12.	Gas Protection Valve Automatic Close		✓	
13.	Pressurize Fan System Automatic Open		✓	
14.	Smoke Fan System Automatic Open		✓	
15.	Air condition : AHU and OAU System Automatic Close		✓	
16.	Telephone jack		✓	
17.	Sounder base	✓		
18.	Fire work control program	✓		
Comment / หมายเหตุ				
724 = 5027 - 52				
806 = 5028 - 113				
813 = 5028 - 101				
		Operation By		
		Ekkachai		
		Redeek By		
		Ekkachai		
		Chief Engineer		
		OB		

ภาคผนวก 2.5

เอกสารประชาสัมพันธ์ให้ความรู้การคัดแยกมูลฝอย

วิธีการ 3 ใช้ (3R) เพื่อจัดการขยะ

Recycle : R ที่สาม

แปรรูปใช้ใหม่

เป็นการนำวัสดุที่สามารถนำกลับมาใช้ใหม่ได้ เช่น แก้ว อะลูมิเนียม เหล็ก พลาสติก นำมาแปรรูปและผลิตภัณฑ์ต่างๆ

ตัวอย่าง RECQLE เช่น

1. การนำกล่องเครื่องดื่ม ยูเอชทีมาใช้ทำลังคา



2. นำกระดาษใช้แล้วแปรรูปเป็นเยื่อกระดาษเพื่อทำเป็นส่วนผสมในการผลิตเป็นกระดาษใหม่

3. นำเศษแก้วเก่ามาหลอมเพื่อขึ้นรูปเป็นแก้วใบใหม่



4. การหลอมขวด PET เป็นเม็ดพลาสติกที่เป็นเส้นใยนำมาผลิตเป็นพรม เสื้อ



NOVOTEL

BANGKOK FUTURE PARK RANGSIT

ขยะมูลฝอยและการจัดการ



ความหมายของ "ขยะ"

1. ขยะย่อยสลาย หรือ มูลฝอยย่อยสลาย

คือขยะที่เน่าเสียและย่อยสลายได้เร็ว นำมาหมักทำปุ๋ยได้ เช่น เศษผัก เปลือกผลไม้ เศษอาหาร ใบไม้ เศษเนื้อสัตว์ เป็นต้น

2. ขยะรีไซเคิล หรือ มูลฝอยที่ใช้ได้

คือ ของเสียบรรจุภัณฑ์ หรือวัสดุเหลือใช้ ซึ่งนำกลับมาใช้ประโยชน์ได้ เช่น กระดาษแก้ว

3. ขยะทั่วไป หรือ มูลฝอยทั่วไป

คือ ขยะประเภทอื่นนอกเหนือจากขยะย่อยสลาย ขยะรีไซเคิลและขยะอันตราย มีลักษณะที่ย่อยสลายยากและไม่คุ้มค่า



วิธีการ 3 ใช้ (3R) เพื่อจัดการขยะ

Recycle : R แรก

ใช้น้อย

สามารถทำได้ง่ายๆ โดยใช้ทรัพยากรที่มีอยู่อย่างพอเพียงใช้เท่าที่จำเป็นใช้ผลิตภัณฑ์ให้เหมาะสมกับงานและเป็นมิตรต่อสิ่งแวดล้อมช่วยต่อการกำจัดไม่ใช้อย่างฟุ่มเฟือย

ตัวอย่าง RECQLE เช่น

1. ใช้กระดาษหรือถุงผ้าแทนการใช้ถุงพลาสติกซึ่งใช้เวลา 450 ปีในการย่อยสลาย

2. ใช้แก้ว ส่วนตัวแทนการใช้แก้วพลาสติกหรือแก้วที่ใช้ครั้งเดียวทิ้ง

3. ใช้กล่องใส่อาหารแทนการใช้กล่องโฟมย่อยสลายยาก



วิธีการ 3 ใช้ (3R) เพื่อจัดการขยะ

Recycle : R ที่สอง

ใช้ซ้ำ

เป็นการนำสิ่งต่างๆ ที่ใช้งานไปแล้วนำกลับมาใช้อีก ลดการใช้ทรัพยากรรวมทั้งลดปริมาณขยะมูลฝอยอีกด้วย

ตัวอย่าง RECQLE เช่น

1. ทำสิ่งประดิษฐ์จากวัสดุเหลือใช้



2. ใช้กระดาษสองหน้าช่วยชีวิตต้นไม้

3. ใช้ถ่านไฟฉายแบบชาร์จใหม่ได้ (RECHARGEABLE BATTERY)

4. บริจาคสิ่งของ เสื้อผ้า ให้กับผู้ที่มีความจำเป็น

5. ขายสินค้ามือสอง เช่น หนังสือ เสื้อผ้า รองเท้า เป็นการเพิ่มรายได้แล้วยังลดปริมาณขยะ

ภาคผนวก 2.6

บันทึกการตรวจสอบระบบระบายน้ำประจำวัน

[illegible][illegible]

NOVOTEL
HOTELS & RESORTS

SWIMMING POOL LOG SHEET : DAILY

Date 24/12/24

Description		Mentoring	Address	Night
Pump Operating	Na-1	-		(
	Na-2	-		(
	Na-3	ON		(
Sand Filter System Pressure	Na-1	0	Pressure Gauge Old [PN]	(
	Na-2	0		(
	Na-3	-		(
Backwash Chaining	Na-1	-	Pump	(
	Na-2	-		(
	Na-3	-	Filter	(
Back Wash (11 min)	Na-1	-		(
	Na-2	-		(
	Na-3	-		(
Chlorine & PH Test Results (Test 1st manual)	Cl	9.0		4.5
	PH	7.6		7.5
		-		(
Chlorine	Chlorine	-		(
	Endo A/B	-		(
	Endo B	-		(
Chlorine Added (1%)	Endo B	-		(
	Endo	-		(
	Aluminate Disposal	-		(
Salt Chlorinator	Na-1	ON	off	(
	Na-2	-		(
	Na-3	-		(
Water System Control (Display & 10)	Na-1	4.5		(
	Na-2	-		(
	Na-3	-		(
Borg Tank	Water Level (High, Medium, Low)	LOW	LOW	4.1
	Operation By	OSMA	OSMA	4.1

Name: _____

Checked By: _____

NOV 2014

Swimming Pool Log Sheet

Date: 4/1/14

Swimming Pool Log Sheet : DAILY

Location: _____

Manager: DAVID

Attendant: JILL

Hour: 9:00

Description		Status (Y/N/G)	
Pump Operating	Na1	-	-
	Na2	-	-
	Na3	ON	-
Said Filter System Pressure	Pressure Gauge Out (PSI)	16	-
	Na1	10	-
	Na2	10	-
	Na3	10	-
Strainer Cleaning	Prep	-	-
	Na1	-	-
	Na2	-	-
Back Wash (if req.)	Filter	-	-
	Na1	-	-
	Na2	-	-
	Na3	-	-
Chlorine & Test Results (Test kit manual)	CL	1.0	2.5
	FE	7.5	4.8
	Na1	-	-
	Na2	-	-
Chlorine	Na3	-	-
	Na4	-	-
	Na5	-	-
	Na6	-	-
Chemical Addition (12)	Na7	-	-
	Na8	-	-
	Na9	-	-
	Na10	-	-
Said Chlorinator	Na11	ON	-
	Na12	-	-
	Na13	-	-
	Na14	-	-
Water Level (High, Medium, Low)	Na15	9.5	-
	Na16	LOW	-
	Na17	9.5	-
	Na18	9.5	-
Bump Tank	Na19	9.5	-
	Na20	9.5	-
	Na21	9.5	-
	Na22	9.5	-

Blank: _____

Backlog By: _____

Chief Engineer: _____

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Signature
	N-1	N-2	N-3	N-1	N-2	N-3	
Pump Operating	-	-	-	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [Psi]			Pressure Gauge Out [Psi]			
	N-1	N-2	N-3	N-1	N-2	N-3	
	10	10	10	10	10	10	
	10	10	10	10	10	10	
Strainer Cleaning	Pump			Pump			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Back Wash (15 min)	Filter			Filter			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	Chlorine			Chlorine			
	N-1	N-2	N-3	N-1	N-2	N-3	
	9.0	9.0	9.0	9.0	9.0	9.0	
	7.5	7.5	7.5	7.5	7.5	7.5	
Chemical Addition (kg)	Soda Ash			Soda Ash			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Salt Chlorinator	Salt			Salt			
	N-1	N-2	N-3	N-1	N-2	N-3	
	ON	ON	ON	ON	ON	ON	
	-	-	-	-	-	-	
Sump Tank	Water Level (High, Medium, Low)			Water Level (High, Medium, Low)			
	N-1	N-2	N-3	N-1	N-2	N-3	
	LOW	LOW	LOW	LOW	LOW	LOW	
	ON	ON	ON	ON	ON	ON	

Old Engineer

Signature

Signature

W.2.6-2

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Signature
	N-1	N-2	N-3	N-1	N-2	N-3	
Pump Operating	-	-	-	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [Psi]			Pressure Gauge Out [Psi]			
	N-1	N-2	N-3	N-1	N-2	N-3	
	10	10	10	10	10	10	
	10	10	10	10	10	10	
Strainer Cleaning	Pump			Pump			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Back Wash (15 min)	Filter			Filter			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	Chlorine			Chlorine			
	N-1	N-2	N-3	N-1	N-2	N-3	
	9.0	9.0	9.0	9.0	9.0	9.0	
	7.5	7.5	7.5	7.5	7.5	7.5	
Chemical Addition (kg)	Soda Ash			Soda Ash			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Salt Chlorinator	Salt			Salt			
	N-1	N-2	N-3	N-1	N-2	N-3	
	ON	ON	ON	ON	ON	ON	
	-	-	-	-	-	-	
Sump Tank	Water Level (High, Medium, Low)			Water Level (High, Medium, Low)			
	N-1	N-2	N-3	N-1	N-2	N-3	
	LOW	LOW	LOW	LOW	LOW	LOW	
	ON	ON	ON	ON	ON	ON	

Old Engineer

Signature

Signature

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Signature
	N-1	N-2	N-3	N-1	N-2	N-3	
Pump Operating	-	-	-	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [Psi]			Pressure Gauge Out [Psi]			
	N-1	N-2	N-3	N-1	N-2	N-3	
	10	10	10	10	10	10	
	10	10	10	10	10	10	
Strainer Cleaning	Pump			Pump			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Back Wash (15 min)	Filter			Filter			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	Chlorine			Chlorine			
	N-1	N-2	N-3	N-1	N-2	N-3	
	9.5	9.5	9.5	9.5	9.5	9.5	
	7.5	7.5	7.5	7.5	7.5	7.5	
Chemical Addition (kg)	Soda Ash			Soda Ash			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Salt Chlorinator	Salt			Salt			
	N-1	N-2	N-3	N-1	N-2	N-3	
	ON	ON	ON	ON	ON	ON	
	-	-	-	-	-	-	
Sump Tank	Water Level (High, Medium, Low)			Water Level (High, Medium, Low)			
	N-1	N-2	N-3	N-1	N-2	N-3	
	LOW	LOW	LOW	LOW	LOW	LOW	
	ON	ON	ON	ON	ON	ON	

Old Engineer

Signature

Signature

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Signature
	N-1	N-2	N-3	N-1	N-2	N-3	
Pump Operating	-	-	-	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [Psi]			Pressure Gauge Out [Psi]			
	N-1	N-2	N-3	N-1	N-2	N-3	
	10	10	10	10	10	10	
	10	10	10	10	10	10	
Strainer Cleaning	Pump			Pump			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Back Wash (15 min)	Filter			Filter			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	Chlorine			Chlorine			
	N-1	N-2	N-3	N-1	N-2	N-3	
	9.5	9.5	9.5	9.5	9.5	9.5	
	7.5	7.5	7.5	7.5	7.5	7.5	
Chemical Addition (kg)	Soda Ash			Soda Ash			
	N-1	N-2	N-3	N-1	N-2	N-3	
	-	-	-	-	-	-	
	-	-	-	-	-	-	
Salt Chlorinator	Salt			Salt			
	N-1	N-2	N-3	N-1	N-2	N-3	
	ON	ON	ON	ON	ON	ON	
	-	-	-	-	-	-	
Sump Tank	Water Level (High, Medium, Low)			Water Level (High, Medium, Low)			
	N-1	N-2	N-3	N-1	N-2	N-3	
	LOW	LOW	LOW	LOW	LOW	LOW	
	ON	ON	ON	ON	ON	ON	

Old Engineer

Signature

Signature

NOVOTEL
SUNSHINE COAST RESORT & SPA

SWIMMING POOL LOG SHEET : DAILY

Date: 9/1/24 Night: 01:00

Description	Morning		Afternoon	
	Na1	Na2	Na1	Na2
Pump Operating	ON	ON	ON	ON
Pool Filter System Pressure	10	10	10	10
Strainers Cleaning	10	10	10	10
Back Wash (10 min)	10	10	10	10
Chlorine & pH Test Results (Test 10 min)	10	10	10	10
Chlorine	10	10	10	10
Soda Ash	10	10	10	10
Sulfonic Bisphosphate Acid	10	10	10	10
Aluminate Sulphate	10	10	10	10
Stains (NaOCl)	10	10	10	10
Volume System Control (Biphasic 5-10)	10	10	10	10
Water Level (Biphasic 5-10 min, Low)	10	10	10	10
Operator By	10	10	10	10
Supp Tank	10	10	10	10

Remarks: 01:00

Chief Engineer

NOVOTEL
SUNSHINE COAST RESORT & SPA

SWIMMING POOL LOG SHEET : DAILY

Date: 10/1/24 Night: 01:00

Description	Morning		Afternoon	
	Na1	Na2	Na1	Na2
Pump Operating	ON	ON	ON	ON
Pool Filter System Pressure	10	10	10	10
Strainers Cleaning	10	10	10	10
Back Wash (10 min)	10	10	10	10
Chlorine & pH Test Results (Test 10 min)	10	10	10	10
Chlorine	10	10	10	10
Soda Ash	10	10	10	10
Sulfonic Bisphosphate Acid	10	10	10	10
Aluminate Sulphate	10	10	10	10
Stains (NaOCl)	10	10	10	10
Volume System Control (Biphasic 5-10)	10	10	10	10
Water Level (Biphasic 5-10 min, Low)	10	10	10	10
Operator By	10	10	10	10
Supp Tank	10	10	10	10

Remarks: 01:00

Chief Engineer

NOVOTEL
SUNSHINE COAST RESORT & SPA

SWIMMING POOL LOG SHEET : DAILY

Date: 11/1/24 Night: 01:00

Description	Morning		Afternoon	
	Na1	Na2	Na1	Na2
Pump Operating	ON	ON	ON	ON
Pool Filter System Pressure	10	10	10	10
Strainers Cleaning	10	10	10	10
Back Wash (10 min)	10	10	10	10
Chlorine & pH Test Results (Test 10 min)	10	10	10	10
Chlorine	10	10	10	10
Soda Ash	10	10	10	10
Sulfonic Bisphosphate Acid	10	10	10	10
Aluminate Sulphate	10	10	10	10
Stains (NaOCl)	10	10	10	10
Volume System Control (Biphasic 5-10)	10	10	10	10
Water Level (Biphasic 5-10 min, Low)	10	10	10	10
Operator By	10	10	10	10
Supp Tank	10	10	10	10

Remarks: 01:00

Chief Engineer

NOVOTEL
SUNSHINE COAST RESORT & SPA

SWIMMING POOL LOG SHEET : DAILY

Date: 12/1/24 Night: 01:00

Description	Morning		Afternoon	
	Na1	Na2	Na1	Na2
Pump Operating	ON	ON	ON	ON
Pool Filter System Pressure	10	10	10	10
Strainers Cleaning	10	10	10	10
Back Wash (10 min)	10	10	10	10
Chlorine & pH Test Results (Test 10 min)	10	10	10	10
Chlorine	10	10	10	10
Soda Ash	10	10	10	10
Sulfonic Bisphosphate Acid	10	10	10	10
Aluminate Sulphate	10	10	10	10
Stains (NaOCl)	10	10	10	10
Volume System Control (Biphasic 5-10)	10	10	10	10
Water Level (Biphasic 5-10 min, Low)	10	10	10	10
Operator By	10	10	10	10
Supp Tank	10	10	10	10

Remarks: 01:00

Chief Engineer

NOVOTEL
Swimming Pool Log Sheet - Daily

Date: 13/1/24 Night: 13/1/24

Description	Monitoring		Status (Bar, Off)	Pressure Gauge Out (Pa)
	Na.1	Na.2		
Pump Operating	ON	ON	-	0.0
Pool Filter System Pressure	-	-	-	-
Brickwork Chasing	-	-	-	-
Brick Work (10 min)	-	-	-	-
Chlorine & pH Test Results (Test kit manual)	7.0	7.2	0.8	7.2
Chemical Addition (kg)	-	-	-	-
Salt Chlorinator	-	-	-	-
Water Level (High, Medium, Low)	8.5	9.0	9.0	9.0
Operator By	SHE			5/10

Remark: _____

Refined By: _____

Chief Engineer: _____

NOVOTEL
Swimming Pool Log Sheet - Daily

Date: 14/1/24 Night: 14/1/24

Description	Monitoring		Status (Bar, Off)	Pressure Gauge Out (Pa)
	Na.1	Na.2		
Pump Operating	-	-	-	0.0
Pool Filter System Pressure	-	-	-	-
Brickwork Chasing	-	-	-	-
Brick Work (10 min)	-	-	-	-
Chlorine & pH Test Results (Test kit manual)	7.0	7.0	0.8	7.0
Chemical Addition (kg)	-	-	-	-
Salt Chlorinator	-	-	-	-
Water Level (High, Medium, Low)	8.5	9.0	9.0	9.0
Operator By	SHE			5/10

Remark: _____

Refined By: _____

Chief Engineer: _____

NOVOTEL
Swimming Pool Log Sheet - Daily

Date: 15/1/24 Night: 15/1/24

Description	Monitoring		Status (Bar, Off)	Pressure Gauge Out (Pa)
	Na.1	Na.2		
Pump Operating	ON	ON	-	0.0
Pool Filter System Pressure	-	-	-	-
Brickwork Chasing	-	-	-	-
Brick Work (10 min)	-	-	-	-
Chlorine & pH Test Results (Test kit manual)	7.0	7.0	0.8	7.0
Chemical Addition (kg)	-	-	-	-
Salt Chlorinator	-	-	-	-
Water Level (High, Medium, Low)	8.5	9.0	9.0	9.0
Operator By	SHE			5/10

Remark: _____

Refined By: _____

Chief Engineer: _____

NOVOTEL
Swimming Pool Log Sheet - Daily

Date: 16/1/24 Night: 16/1/24

Description	Monitoring		Status (Bar, Off)	Pressure Gauge Out (Pa)
	Na.1	Na.2		
Pump Operating	ON	ON	-	0.0
Pool Filter System Pressure	-	-	-	-
Brickwork Chasing	-	-	-	-
Brick Work (10 min)	-	-	-	-
Chlorine & pH Test Results (Test kit manual)	7.0	7.0	0.8	7.0
Chemical Addition (kg)	-	-	-	-
Salt Chlorinator	-	-	-	-
Water Level (High, Medium, Low)	8.5	9.0	9.0	9.0
Operator By	SHE			5/10

Remark: _____

Refined By: _____

Chief Engineer: _____

18/1/24

NOVOTEL

SWIMMING POOL LOG SHEET: DAILY

Date: 18/1/24 Night: 01:00

Description	Monitoring			Status (Elev. Off)
	Na1	Na2	Na3	
Pump Operating	ON	ON	ON	Pressure Gauge Out [Pa]
Stand Filter System Pressure	10	10	10	Pump
Brackets Chasing	10	10	10	Filter
Back Wash (10 min)	10	10	10	Filter
Chlorine & pH Test Results (Test kit manual)	1.5	7.6	1.5	Chlorine
Chlorine Additional (1%)	ON	ON	ON	Soda Ash
Salt Chlorinator	ON	ON	ON	Automatic Backwash
Water Level (Elev. 100mm, Low 1)	4.5	4.5	4.5	Water Level
Sign Task	4.5	4.5	4.5	Operate By

Remarks: _____

Checked By: _____

Chief Engineer: _____

17/1/24

NOVOTEL

SWIMMING POOL LOG SHEET: DAILY

Date: 17/1/24 Night: 01:00

Description	Monitoring			Status (Elev. Off)
	Na1	Na2	Na3	
Pump Operating	ON	ON	ON	Pressure Gauge Out [Pa]
Stand Filter System Pressure	10	10	10	Pump
Brackets Chasing	10	10	10	Filter
Back Wash (10 min)	10	10	10	Filter
Chlorine & pH Test Results (Test kit manual)	1.5	7.6	1.5	Chlorine
Chlorine Additional (1%)	ON	ON	ON	Soda Ash
Salt Chlorinator	ON	ON	ON	Automatic Backwash
Water Level (Elev. 100mm, Low 1)	4.5	4.5	4.5	Water Level
Sign Task	4.5	4.5	4.5	Operate By

Remarks: _____

Checked By: _____

Chief Engineer: _____

19/1/24

NOVOTEL

SWIMMING POOL LOG SHEET: DAILY

Date: 19/1/24 Night: 01:00

Description	Monitoring			Status (Elev. Off)
	Na1	Na2	Na3	
Pump Operating	ON	ON	ON	Pressure Gauge Out [Pa]
Stand Filter System Pressure	10	10	10	Pump
Brackets Chasing	10	10	10	Filter
Back Wash (10 min)	10	10	10	Filter
Chlorine & pH Test Results (Test kit manual)	1.5	7.6	1.5	Chlorine
Chlorine Additional (1%)	ON	ON	ON	Soda Ash
Salt Chlorinator	ON	ON	ON	Automatic Backwash
Water Level (Elev. 100mm, Low 1)	4.5	4.5	4.5	Water Level
Sign Task	4.5	4.5	4.5	Operate By

Remarks: _____

Checked By: _____

Chief Engineer: _____

18/1/24

NOVOTEL

SWIMMING POOL LOG SHEET: DAILY

Date: 18/1/24 Night: 01:00

Description	Monitoring			Status (Elev. Off)
	Na1	Na2	Na3	
Pump Operating	ON	ON	ON	Pressure Gauge Out [Pa]
Stand Filter System Pressure	10	10	10	Pump
Brackets Chasing	10	10	10	Filter
Back Wash (10 min)	10	10	10	Filter
Chlorine & pH Test Results (Test kit manual)	1.5	7.6	1.5	Chlorine
Chlorine Additional (1%)	ON	ON	ON	Soda Ash
Salt Chlorinator	ON	ON	ON	Automatic Backwash
Water Level (Elev. 100mm, Low 1)	4.5	4.5	4.5	Water Level
Sign Task	4.5	4.5	4.5	Operate By

Remarks: _____

Checked By: _____

Chief Engineer: _____

NOVOTEL

Date 25/7/24

21.00	Afternoon	21.00
-------	-----------	-------

NOVOTEL

NOVOTEL
HOTEL & RESORTS

SWIMMING POOL LOG SHEET : DAILY

NO. _____

Address _____

Date _____

Time _____

State / Dist. / City _____

Pump Operating

No.1

No.2

No.3

No.4

No.5

No.6

No.7

No.8

No.9

No.10

No.11

No.12

No.13

No.14

No.15

No.16

No.17

No.18

No.19

No.20

No.21

No.22

No.23

No.24

No.25

No.26

No.27

No.28

No.29

No.30

No.31

No.32

No.33

No.34

No.35

No.36

No.37

No.38

No.39

No.40

No.41

No.42

No.43

No.44

No.45

No.46

No.47

No.48

No.49

No.50

No.51

No.52

No.53

No.54

No.55

No.56

No.57

No.58

No.59

No.60

No.61

No.62

Band Filter System Pressure

No.1

No.2

No.3

No.4

No.5

No.6

No.7

No.8

No.9

No.10

No.11

No.12

No.13

No.14

No.15

No.16

No.17

No.18

No.19

No.20

No.21

No.22

No.23

No.24

No.25

No.26

No.27

No.28

No.29

No.30

No.31

Chief Engineer

Recheck By

Chief Engineer

Feedback By

NOVOTEL

Date 26/1/67

2000

NOVOTEL

NOVOTEL
NORWICH HOTEL LIMITED

SWIMMING POOL LOG SHEET : DAILY

Ngbr.....

Address.....

Meeting.....

Description

Status (Run Off)

Pump Operating

No.1

No.2

No.3

Pressure Gauge Out (PSI)

Good Filter System Pressure

No.1

No.2

No.3

Brineless Chilling

No.1

No.2

No.3

Back Wash (11mks)

No.1

No.2

No.3

Chlorine & PH Test Results (Test kit result)

PH

Chlorine

Free AOB

Swimming Pool Water Add

SW

Ammonium Nitrate

No.1

No.2

No.3

No.4

No.5

Ball Chlorinator

Status (On/Off)

Volume System Control (Display 0-100)

Steps Tank

Water Level (100% - Medium Low)

Operation By

Signature

Date

Time

Page

Remark

Feedback By

NOVOTEL

Date 2/1/11

Afternoon

NOVOTEL

[illegible]

Our Budget

Rebeck By

Chief Engineer

Rebeck By

NOVOTEL

Date 28/1/21

4.00

NOVOTEL

NOVOTEL

SANTOPIERRE HOTEL

SWIMMING POOL LOG SHEET : DAILY

High - 20.2

Description		Measuring		Adjustment		Status (Run, Off)		High		
Pump Operating		Nd1	-	-	-	-	-	-	-	
		Nd2	-	-	-	-	-	-	-	
		Nd3	ON	-	-	-	-	-	-	
		Nd4	-	-	-	-	-	-	-	
Pool Filter System Pressure		Nd1	10	0	-	-	-	-	-	
		Nd2	10	0	-	-	-	-	-	
		Nd3	-	-	-	-	-	-	-	
		Nd4	-	-	-	-	-	-	-	
Stratifier Chasing		Nd1	-	-	-	-	-	-	-	
		Nd2	-	-	-	-	-	-	-	
		Nd3	-	-	-	-	-	-	-	
		Nd4	-	-	-	-	-	-	-	
Back Wash (1 time)		Nd1	-	-	-	-	-	-	-	
		Nd2	-	-	-	-	-	-	-	
		Nd3	1.5	15	-	-	-	-	-	
		Nd4	7.6	76	-	-	-	-	-	
Chlorine & pH Test Results (Test kit results)		pH	-	-	-	-	-	-	-	
Chemical Addition (kg)		Chlorine	-	-	-	-	-	-	-	
		Soda Ash	-	-	-	-	-	-	-	
		Sodium Bisphosphate Acid	-	-	-	-	-	-	-	
		Salt	-	-	-	-	-	-	-	
Alumination in kg/litre		Nd1	-	-	-	-	-	-	-	
		Nd2	-	-	-	-	-	-	-	
		Nd3	20	200	-	-	-	-	-	
		Nd4	-	-	-	-	-	-	-	
Salt Chlorinator		Nd1	-	-	-	-	-	-	-	
		Nd2	-	-	-	-	-	-	-	
		Nd3	-	-	-	-	-	-	-	
		Nd4	-	-	-	-	-	-	-	
Bump Tank		Nd1	-	-	-	-	-	-	-	
		Nd2	-	-	-	-	-	-	-	
		Nd3	45	450	-	-	-	-	-	
		Nd4	-	-	-	-	-	-	-	
Water Level (High, Medium, Low)		Water Level		High, Medium, Low		Water Level		High, Medium, Low		
Operation By		Operation By		Operation By		Operation By		Operation By		

Remarks:

Rebeck By

NOVOTEL

Date 4/2/24

SWIMMING POOL LOG SHEET: DAILY

Date 3/20/24Night 00-00 enter time and date requested

Equipment		Serial Number	Manufacturer	Model	Year	Location	Notes
Pump Operating	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	ON	-	-	-	-	ON
End Filter System Pressure	No.1	10	-	-	-	-	10
	No.2	10	-	-	-	-	10
	No.3	-	-	-	-	-	-
Pump	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Strainers Cleaning	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Back Wash (14 mls)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	1.5	-	-	-	-	1.5
Character of PM Test Results (Per 10 months)	CL	1.6	-	-	-	-	1.6
	PI	1.6	-	-	-	-	1.6
	No.1	-	-	-	-	-	-
Characteristics	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
Characteristics Additional (14)	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
Characteristics Additional (14)	PI	-	-	-	-	-	-
	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
Characteristics Additional (14)	No.3	-	-	-	-	-	-
	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	-
Characteristics Additional (14)	No.1	-	-	-	-	-	-
	No.2	-	-	-	-	-	-
	No.3	-	-	-	-	-	-
Characteristics Additional (14)	CL	-	-	-	-	-	-
	PI	-	-	-	-	-	

Chief Engineer

Feedback By

Technical By

Remarks:

NOVOTEL

Date 4/2/67

----- FANCY FOOT LOG SHEET: DAILY

5/2/27

DATE _____

[illegible]

Civil Engineer

technology by

1

Remarks:

NOVOTEL
Swimming Pool Log Sheet

SWIMMING POOL LOG SHEET : DAILY

Date: 6/2/24 Night: 08:00

Description	Meters		Status (Run, Off)
	Na.1	Na.2	
Pump Operating	ON	ON	ON
Pool Filter System Pressure	10	10	10
Brickwork Chasing	10	10	10
Back Wash (10 min)	10	10	10
Chlorine & PH Test Results (Test kit manual)	1.5	7.6	1.5
Chemical Added (kg)	1.5	7.6	1.5
Ball Chlorinator	ON	ON	ON
Volume System Control (Display 4-10)	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON
Surge Tank	ON	ON	ON

Remarks: _____

Refined By: _____

Chief Engineer: _____

NOVOTEL
Swimming Pool Log Sheet

SWIMMING POOL LOG SHEET : DAILY

Date: 7/2/24 Night: 08:00

Description	Meters		Status (Run, Off)
	Na.1	Na.2	
Pump Operating	ON	ON	ON
Pool Filter System Pressure	10	10	10
Brickwork Chasing	10	10	10
Back Wash (10 min)	10	10	10
Chlorine & PH Test Results (Test kit manual)	1.5	7.6	1.5
Chemical Added (kg)	1.5	7.6	1.5
Ball Chlorinator	ON	ON	ON
Volume System Control (Display 4-10)	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON
Surge Tank	ON	ON	ON

Remarks: _____

Refined By: _____

Chief Engineer: _____

W.2.6-10

NOVOTEL
Swimming Pool Log Sheet

SWIMMING POOL LOG SHEET : DAILY

Date: 08/02/24 Night: 08:00

Description	Meters		Status (Run, Off)
	Na.1	Na.2	
Pump Operating	ON	ON	ON
Pool Filter System Pressure	10	10	10
Brickwork Chasing	10	10	10
Back Wash (10 min)	10	10	10
Chlorine & PH Test Results (Test kit manual)	1.5	7.6	1.5
Chemical Added (kg)	1.5	7.6	1.5
Ball Chlorinator	ON	ON	ON
Volume System Control (Display 4-10)	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON
Surge Tank	ON	ON	ON

Remarks: _____

Refined By: _____

Chief Engineer: _____

NOVOTEL
Swimming Pool Log Sheet

SWIMMING POOL LOG SHEET : DAILY

Date: 09/02/24 Night: 08:00

Description	Meters		Status (Run, Off)
	Na.1	Na.2	
Pump Operating	ON	ON	ON
Pool Filter System Pressure	10	10	10
Brickwork Chasing	10	10	10
Back Wash (10 min)	10	10	10
Chlorine & PH Test Results (Test kit manual)	1.5	7.6	1.5
Chemical Added (kg)	1.5	7.6	1.5
Ball Chlorinator	ON	ON	ON
Volume System Control (Display 4-10)	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON
Surge Tank	ON	ON	ON

Remarks: _____

Refined By: _____

Chief Engineer: _____

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 10/9/24 Night: 0.00

Description	Menting	Alarm	Status (Alarm Off)	Pressure Gauge Out [Psi]	
				Na1	Na2
Pump Operating	Na1 -	Na2 -	ON	0.55	0
Stand Filter System Pressure	Na1 10	Na2 10	Pump		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Chlorine & pH Test Results (Test kit manual)	Na1 1.7	Na2 7.6			
Chlorine	Na1 -	Na2 -			
Soda Ash	Na1 -	Na2 -			
Sodium Dichloro Sulfate Add	Na1 -	Na2 -			
Aluminate Sulfate	Na1 -	Na2 -			
Stain (10000)	Na1 -	Na2 -			
Volume System Control (Display 0-10)	Na1 -	Na2 -			
Water Level (High, Medium, Low)	Na1 4.5	Na2 4.5			
Surge Tank	Na1 -	Na2 -			

Remark: _____

Chief Engineer: _____

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 11/2/24 Night: 0.00

Description	Menting	Alarm	Status (Alarm Off)	Pressure Gauge Out [Psi]	
				Na1	Na2
Pump Operating	Na1 -	Na2 -	ON	0.55	0
Stand Filter System Pressure	Na1 10	Na2 10	Pump		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Chlorine & pH Test Results (Test kit manual)	Na1 1.9	Na2 7.6			
Chlorine	Na1 -	Na2 -			
Soda Ash	Na1 -	Na2 -			
Sodium Dichloro Sulfate Add	Na1 -	Na2 -			
Aluminate Sulfate	Na1 -	Na2 -			
Stain (10000)	Na1 -	Na2 -			
Volume System Control (Display 0-10)	Na1 -	Na2 -			
Water Level (High, Medium, Low)	Na1 4.5	Na2 4.5			
Surge Tank	Na1 -	Na2 -			

Remark: _____

Chief Engineer: _____

W.2.6-11

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 10/10/24 Night: 0.00

Description	Menting	Alarm	Status (Alarm Off)	Pressure Gauge Out [Psi]	
				Na1	Na2
Pump Operating	Na1 -	Na2 -	ON	0.55	0
Stand Filter System Pressure	Na1 10	Na2 10	Pump		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Chlorine & pH Test Results (Test kit manual)	Na1 1.5	Na2 7.6			
Chlorine	Na1 -	Na2 -			
Soda Ash	Na1 -	Na2 -			
Sodium Dichloro Sulfate Add	Na1 -	Na2 -			
Aluminate Sulfate	Na1 -	Na2 -			
Stain (10000)	Na1 -	Na2 -			
Volume System Control (Display 0-10)	Na1 -	Na2 -			
Water Level (High, Medium, Low)	Na1 4.5	Na2 4.5			
Surge Tank	Na1 -	Na2 -			

Remark: _____

Chief Engineer: _____

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 10/11/24 Night: 0.00

Description	Menting	Alarm	Status (Alarm Off)	Pressure Gauge Out [Psi]	
				Na1	Na2
Pump Operating	Na1 -	Na2 -	ON	0.55	0
Stand Filter System Pressure	Na1 10	Na2 10	Pump		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Backwash (10 min)	Na1 -	Na2 -	Filter		
Chlorine & pH Test Results (Test kit manual)	Na1 1.5	Na2 7.6			
Chlorine	Na1 -	Na2 -			
Soda Ash	Na1 -	Na2 -			
Sodium Dichloro Sulfate Add	Na1 -	Na2 -			
Aluminate Sulfate	Na1 -	Na2 -			
Stain (10000)	Na1 -	Na2 -			
Volume System Control (Display 0-10)	Na1 -	Na2 -			
Water Level (High, Medium, Low)	Na1 4.5	Na2 4.5			
Surge Tank	Na1 -	Na2 -			

Remark: _____

Chief Engineer: _____

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 18/6/14 Night: 03:00

Description	Monitoring	Alarm	State (On/Off)
Pump Operating	N4.1 - N4.2 - N4.3 ON	OFF	Pressure Gauge On [PN]
Stand Filter System Pressure	N4.1 10 N4.2 - N4.3 10	ON	Pump
Stand Filter System Pressure	N4.1 - N4.2 - N4.3 -	OFF	Filter
Back Wash (10 min)	N4.1 - N4.2 - N4.3 -	ON	Back Wash (10 min)
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.5	ON	Chlorine & PH Test Results (Test kit manual)
Chlorine Added (kg)	N4.1 - N4.2 - N4.3 -	ON	Chlorine Added (kg)
Salinity System Control (Display 0-100)	N4.1 - N4.2 - N4.3 -	ON	Salinity System Control (Display 0-100)
Water Level (High, Medium, Low)	N4.1 - N4.2 - N4.3 -	ON	Water Level (High, Medium, Low)

Remarks: _____

Refused By: _____

Chief Engineer: _____

W.2.6-13

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 18/6/14 Night: 03:00

Description	Monitoring	Alarm	State (On/Off)
Pump Operating	N4.1 - N4.2 - N4.3 ON	OFF	Pressure Gauge On [PN]
Stand Filter System Pressure	N4.1 10 N4.2 - N4.3 10	ON	Pump
Stand Filter System Pressure	N4.1 - N4.2 - N4.3 -	OFF	Filter
Back Wash (10 min)	N4.1 - N4.2 - N4.3 -	ON	Back Wash (10 min)
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.5	ON	Chlorine & PH Test Results (Test kit manual)
Chlorine Added (kg)	N4.1 - N4.2 - N4.3 -	ON	Chlorine Added (kg)
Salinity System Control (Display 0-100)	N4.1 - N4.2 - N4.3 -	ON	Salinity System Control (Display 0-100)
Water Level (High, Medium, Low)	N4.1 - N4.2 - N4.3 -	ON	Water Level (High, Medium, Low)

Remarks: _____

Refused By: _____

Chief Engineer: _____

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 19/6/14 Night: 03:00

Description	Monitoring	Alarm	State (On/Off)
Pump Operating	N4.1 - N4.2 - N4.3 ON	OFF	Pressure Gauge On [PN]
Stand Filter System Pressure	N4.1 10 N4.2 - N4.3 10	ON	Pump
Stand Filter System Pressure	N4.1 - N4.2 - N4.3 -	OFF	Filter
Back Wash (10 min)	N4.1 - N4.2 - N4.3 -	ON	Back Wash (10 min)
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.5	ON	Chlorine & PH Test Results (Test kit manual)
Chlorine Added (kg)	N4.1 - N4.2 - N4.3 -	ON	Chlorine Added (kg)
Salinity System Control (Display 0-100)	N4.1 - N4.2 - N4.3 -	ON	Salinity System Control (Display 0-100)
Water Level (High, Medium, Low)	N4.1 - N4.2 - N4.3 -	ON	Water Level (High, Medium, Low)

Remarks: _____

Refused By: _____

Chief Engineer: _____

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 19/6/14 Night: 03:00

Description	Monitoring	Alarm	State (On/Off)
Pump Operating	N4.1 - N4.2 - N4.3 ON	OFF	Pressure Gauge On [PN]
Stand Filter System Pressure	N4.1 10 N4.2 - N4.3 10	ON	Pump
Stand Filter System Pressure	N4.1 - N4.2 - N4.3 -	OFF	Filter
Back Wash (10 min)	N4.1 - N4.2 - N4.3 -	ON	Back Wash (10 min)
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.5	ON	Chlorine & PH Test Results (Test kit manual)
Chlorine Added (kg)	N4.1 - N4.2 - N4.3 -	ON	Chlorine Added (kg)
Salinity System Control (Display 0-100)	N4.1 - N4.2 - N4.3 -	ON	Salinity System Control (Display 0-100)
Water Level (High, Medium, Low)	N4.1 - N4.2 - N4.3 -	ON	Water Level (High, Medium, Low)

Remarks: _____

Refused By: _____

Chief Engineer: _____

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 22/01/13 High: 01.00

Description	Monitoring		Alarm	Status
	Na1	Na2		
Pump Operating	ON	ON	ON	ON
Stand Filter System Pressure	10	10	ON	ON
Brine/Chlorine	ON	ON	ON	ON
Back Wash (10 min)	ON	ON	ON	ON
Chlorine & pH Test Results (Test kit manual)	1.5	7.5	ON	ON
Chlorine	1.5	7.5	ON	ON
Salt Add	ON	ON	ON	ON
Sodium Bisphosphate Add	ON	ON	ON	ON
Aluminate Sulphate	ON	ON	ON	ON
Brine (ON/OFF)	ON	ON	ON	ON
Volume System Control (Display & 100)	ON	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON	ON
Operate By	ON	ON	ON	ON
Signs	ON	ON	ON	ON

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 22/01/13 High: 01.00

Description	Monitoring		Alarm	Status
	Na1	Na2		
Pump Operating	ON	ON	ON	ON
Stand Filter System Pressure	10	10	ON	ON
Brine/Chlorine	ON	ON	ON	ON
Back Wash (10 min)	ON	ON	ON	ON
Chlorine & pH Test Results (Test kit manual)	1.5	7.5	ON	ON
Chlorine	1.5	7.5	ON	ON
Salt Add	ON	ON	ON	ON
Sodium Bisphosphate Add	ON	ON	ON	ON
Aluminate Sulphate	ON	ON	ON	ON
Brine (ON/OFF)	ON	ON	ON	ON
Volume System Control (Display & 100)	ON	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON	ON
Operate By	ON	ON	ON	ON
Signs	ON	ON	ON	ON

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 24/01/13 High: 01.00

Description	Monitoring		Alarm	Status
	Na1	Na2		
Pump Operating	ON	ON	ON	ON
Stand Filter System Pressure	10	10	ON	ON
Brine/Chlorine	ON	ON	ON	ON
Back Wash (10 min)	ON	ON	ON	ON
Chlorine & pH Test Results (Test kit manual)	1.5	7.5	ON	ON
Chlorine	1.5	7.5	ON	ON
Salt Add	ON	ON	ON	ON
Sodium Bisphosphate Add	ON	ON	ON	ON
Aluminate Sulphate	ON	ON	ON	ON
Brine (ON/OFF)	ON	ON	ON	ON
Volume System Control (Display & 100)	ON	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON	ON
Operate By	ON	ON	ON	ON
Signs	ON	ON	ON	ON

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 24/01/13 High: 01.00

Description	Monitoring		Alarm	Status
	Na1	Na2		
Pump Operating	ON	ON	ON	ON
Stand Filter System Pressure	10	10	ON	ON
Brine/Chlorine	ON	ON	ON	ON
Back Wash (10 min)	ON	ON	ON	ON
Chlorine & pH Test Results (Test kit manual)	1.5	7.5	ON	ON
Chlorine	1.5	7.5	ON	ON
Salt Add	ON	ON	ON	ON
Sodium Bisphosphate Add	ON	ON	ON	ON
Aluminate Sulphate	ON	ON	ON	ON
Brine (ON/OFF)	ON	ON	ON	ON
Volume System Control (Display & 100)	ON	ON	ON	ON
Water Level (High, Medium, Low)	ON	ON	ON	ON
Operate By	ON	ON	ON	ON
Signs	ON	ON	ON	ON

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 28/10/24 High: 0.9m

Description	Monitoring	Alarm	Notes
Pump Operating	NAL - NAL - NAL -	ON	0.9m
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	0	10
Brine/Chlorine	NAL - NAL - NAL -	0	0
Back Wash (10 min)	NAL - NAL - NAL -	0	0
Chlorine & pH Test Results (Test kit manual)	CL 1.9 PH 7.6	0	0
Chemical Addition (kg)	NAL - NAL - NAL -	0	0
Brine (0.001)	NAL - NAL - NAL -	0	0
Water System Control (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Water Level (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Stop Tank	NAL - NAL - NAL -	0	0

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 29/10/24 High: 0.9m

Description	Monitoring	Alarm	Notes
Pump Operating	NAL - NAL - NAL -	ON	0.9m
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	0	10
Brine/Chlorine	NAL - NAL - NAL -	0	0
Back Wash (10 min)	NAL - NAL - NAL -	0	0
Chlorine & pH Test Results (Test kit manual)	CL 1.9 PH 7.6	0	0
Chemical Addition (kg)	NAL - NAL - NAL -	0	0
Brine (0.001)	NAL - NAL - NAL -	0	0
Water System Control (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Water Level (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Stop Tank	NAL - NAL - NAL -	0	0

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 28/10/24 High: 0.9m

Description	Monitoring	Alarm	Notes
Pump Operating	NAL - NAL - NAL -	ON	0.9m
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	0	10
Brine/Chlorine	NAL - NAL - NAL -	0	0
Back Wash (10 min)	NAL - NAL - NAL -	0	0
Chlorine & pH Test Results (Test kit manual)	CL 1.9 PH 7.6	0	0
Chemical Addition (kg)	NAL - NAL - NAL -	0	0
Brine (0.001)	NAL - NAL - NAL -	0	0
Water System Control (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Water Level (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Stop Tank	NAL - NAL - NAL -	0	0

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET: DAILY

Date: 29/10/24 High: 0.9m

Description	Monitoring	Alarm	Notes
Pump Operating	NAL - NAL - NAL -	ON	0.9m
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	0	10
Brine/Chlorine	NAL - NAL - NAL -	0	0
Back Wash (10 min)	NAL - NAL - NAL -	0	0
Chlorine & pH Test Results (Test kit manual)	CL 1.9 PH 7.6	0	0
Chemical Addition (kg)	NAL - NAL - NAL -	0	0
Brine (0.001)	NAL - NAL - NAL -	0	0
Water System Control (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Water Level (Bipolar 0-10V)	NAL - NAL - NAL -	0	0
Stop Tank	NAL - NAL - NAL -	0	0

Chief Engineer

NOVOTEL
Swimming Pool Log Sheet

Date: 9/18/24 High: 84.0

SWIMMING POOL LOG SHEET : DAILY

Alarm: [Blank] Status: [Blank]

Description	Monitoring	Alarm	Status	Off
Pump Operating	NAL - NAL - NAL -	ON	ON	ON
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	ON	ON	ON
Brackish Chilling	NAL - NAL - NAL -	ON	ON	ON
Back Wash (10 min)	NAL - NAL - NAL -	ON	ON	ON
Chlorine & pH Test Results (Test 40 min)	CL 1.5 PH 7.6	ON	ON	ON
Chlorine	NAL - NAL - NAL -	ON	ON	ON
Chemical Addition (10)	NAL - NAL - NAL -	ON	ON	ON
Sal Disinfectant	NAL - NAL - NAL -	ON	ON	ON
Stop Tank	NAL - NAL - NAL -	ON	ON	ON

Signature: [Blank] Chief Engineer

NOVOTEL
Swimming Pool Log Sheet

Date: 9/18/24 High: 84.0

SWIMMING POOL LOG SHEET : DAILY

Alarm: [Blank] Status: [Blank]

Description	Monitoring	Alarm	Status	Off
Pump Operating	NAL - NAL - NAL -	ON	ON	ON
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	ON	ON	ON
Brackish Chilling	NAL - NAL - NAL -	ON	ON	ON
Back Wash (10 min)	NAL - NAL - NAL -	ON	ON	ON
Chlorine & pH Test Results (Test 40 min)	CL 1.5 PH 7.6	ON	ON	ON
Chlorine	NAL - NAL - NAL -	ON	ON	ON
Chemical Addition (10)	NAL - NAL - NAL -	ON	ON	ON
Sal Disinfectant	NAL - NAL - NAL -	ON	ON	ON
Stop Tank	NAL - NAL - NAL -	ON	ON	ON

Signature: [Blank] Chief Engineer

W.2.6-17

NOVOTEL
Swimming Pool Log Sheet

Date: 7/12/24 High: 84.0

SWIMMING POOL LOG SHEET : DAILY

Alarm: [Blank] Status: [Blank]

Description	Monitoring	Alarm	Status	Off
Pump Operating	NAL - NAL - NAL -	ON	ON	ON
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	ON	ON	ON
Brackish Chilling	NAL - NAL - NAL -	ON	ON	ON
Back Wash (10 min)	NAL - NAL - NAL -	ON	ON	ON
Chlorine & pH Test Results (Test 40 min)	CL 1.5 PH 7.6	ON	ON	ON
Chlorine	NAL - NAL - NAL -	ON	ON	ON
Chemical Addition (10)	NAL - NAL - NAL -	ON	ON	ON
Sal Disinfectant	NAL - NAL - NAL -	ON	ON	ON
Stop Tank	NAL - NAL - NAL -	ON	ON	ON

Signature: [Blank] Chief Engineer

NOVOTEL
Swimming Pool Log Sheet

Date: 9/13/24 High: 84.0

SWIMMING POOL LOG SHEET : DAILY

Alarm: [Blank] Status: [Blank]

Description	Monitoring	Alarm	Status	Off
Pump Operating	NAL - NAL - NAL -	ON	ON	ON
Pool Filter System Pressure	NAL 10 NAL 10 NAL -	ON	ON	ON
Brackish Chilling	NAL - NAL - NAL -	ON	ON	ON
Back Wash (10 min)	NAL - NAL - NAL -	ON	ON	ON
Chlorine & pH Test Results (Test 40 min)	CL 1.5 PH 7.6	ON	ON	ON
Chlorine	NAL - NAL - NAL -	ON	ON	ON
Chemical Addition (10)	NAL - NAL - NAL -	ON	ON	ON
Sal Disinfectant	NAL - NAL - NAL -	ON	ON	ON
Stop Tank	NAL - NAL - NAL -	ON	ON	ON

Signature: [Blank] Chief Engineer

SWIMMING POOL LOG SHEET: DAILY

Date 9/10/10

NOVOTEL

NOVOTEL

SWIMMING POOL LOG SHEET: DAILY

Date: 11/10/2019 Page: 1

Description	Starting Concentration	Saline (Lbs. OZ)	Alkaline (Lbs. OZ)	PH
Pump Operating	No.1	-	-	-
	No.2	-	0.4	0.0
	No.3	0.2	-	1.0
Back Filter System Pressure	No.1	1.0	0.8	1.0
	No.2	1.0	-	-
	No.3	-	Pump	-
Engineers Chilling	No.1	-	-	-
	No.2	-	0.4	-
	No.3	-	-	-
Back Wash (10 min)	No.1	-	-	1.5
	No.2	-	1.8	2.3
	No.3	1.5	2.6	-
Chlorine & PH Test Results (Test All assets)	CL	1.5	-	-
	PH	-	-	-
	PH	-	-	-
Chlorine	Chlorine	-	-	-
	Free A/C	-	-	-
	Total A/C	-	-	-
Chemical Addition (1 qt)	Sodium Bicarbonate Add	-	-	-
	Salt	-	-	-
	Ammonium Sulfate	-	-	-
Salt Chlorinator	No.1	0.2	0.4	0.0
	No.2	-	-	0.5
	No.3	-	-	0.5
Water System Control (Display 5-10)	No.1	-	-	0.0
	No.2	-	-	0.5
	No.3	-	-	0.5
Bsp. Tank	No.1	1.0	1.0	1.0
	No.2	1.0	1.0	1.0
	No.3	1.0	1.0	1.0
Water Level (High, Medium, Low)		High	Medium	Low
Operator By		Operator	By	

Chief Engineer

checked by

พ.2.6-18

CHRYSLER CREDIT CORPORATION

Date 11/15 _____

NOVOTEL

[illegible]

Old English

checked By

SWIMMING POOL LOG SHEET: DAILY

Date 10/10/12

NOVOTEL

NOVOTEL
NOVOTEL HOTEL & RESORTS

SWIMMING POOL LOG SHEET: DAILY

Date	Time	Activity	Meeting	Status		Time		Notes	Signature	
				Start	End	Start	End			
		Pump Operating		Nd1						
				Nd2						
				Nd3						
		Blow Filter System Pressure		Nd1						
				Nd2						
				Nd3						
		Backwash Chasing		Nd1						
				Nd2						
				Nd3						
		Back Wash (1 tank)		Nd1						
				Nd2						
				Nd3						
		Cl.		Nd1						
				Nd2						
				Nd3						
		Filter		Nd1						
				Nd2						
				Nd3						
		Pump		Nd1						
				Nd2						
				Nd3						
		Chlorine & pH Test Results (Test at least once)		Nd1						
				Nd2						
				Nd3						
		Chlorine		Nd1						
				Nd2						
				Nd3						
		Chemical Addition (1 qt)		Nd1						
				Nd2						
				Nd3						
		Ammonia Injection		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						
				Nd2						
				Nd3						
		Water Level (High, Medium, Low)		Nd1						

Chief Engineer

Endock By

POOL LOG SHEET: DAILY

Date 12/8/24NOVOTEL
International Payment Agents Secretary[illegible]

Center Director

Feedback By

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

10/03/19

Description	Morning			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	ON	-	-	ON	-
Sand Filter System Pressure	Nc.1	-	-	Nc.1	-	-
	Nc.2	10	10	Nc.2	10	10
	Nc.3	10	10	Nc.3	10	10
Strainers Cleaning	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Back Wash (10 min)	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	CL	1.5	1.5
	PH	7.6	7.6	PH	7.6	7.6
Chemical Additional (kg)	Soda Ash	-	-	Soda Ash	-	-
	Sodium Bisphosphate Acid	-	-	Sodium Bisphosphate Acid	-	-
	Salt	-	-	Salt	-	-
Salt Chlorinator	States (On/Off)	ON	ON	States (On/Off)	ON	ON
	Volume System Control (Display 0-100)	95	95	Volume System Control (Display 0-100)	95	95
	Nc.1	95	95	Nc.2	95	95
Surge Tank	Water Level (High, Medium, Low)	High	High	Water Level (High, Medium, Low)	High	High
	Operation By	10/03/19	10/03/19	Operation By	10/03/19	10/03/19

Remark

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

10/03/19

Description	Morning			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	ON	-	-	ON	-
Sand Filter System Pressure	Nc.1	-	-	Nc.1	-	-
	Nc.2	10	10	Nc.2	10	10
	Nc.3	10	10	Nc.3	10	10
Strainers Cleaning	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Back Wash (10 min)	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	CL	1.5	1.5
	PH	7.6	7.6	PH	7.6	7.6
Chemical Additional (kg)	Soda Ash	-	-	Soda Ash	-	-
	Sodium Bisphosphate Acid	-	-	Sodium Bisphosphate Acid	-	-
	Salt	-	-	Salt	-	-
Salt Chlorinator	States (On/Off)	ON	ON	States (On/Off)	ON	ON
	Volume System Control (Display 0-100)	95	95	Volume System Control (Display 0-100)	95	95
	Nc.1	95	95	Nc.2	95	95
Surge Tank	Water Level (High, Medium, Low)	High	High	Water Level (High, Medium, Low)	High	High
	Operation By	10/03/19	10/03/19	Operation By	10/03/19	10/03/19

Remark

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

10/03/19

Description	Morning			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	ON	-	-	ON	-
Sand Filter System Pressure	Nc.1	-	-	Nc.1	-	-
	Nc.2	10	10	Nc.2	10	10
	Nc.3	10	10	Nc.3	10	10
Strainers Cleaning	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Back Wash (10 min)	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	CL	1.5	1.5
	PH	7.6	7.6	PH	7.6	7.6
Chemical Additional (kg)	Soda Ash	-	-	Soda Ash	-	-
	Sodium Bisphosphate Acid	-	-	Sodium Bisphosphate Acid	-	-
	Salt	-	-	Salt	-	-
Salt Chlorinator	States (On/Off)	ON	ON	States (On/Off)	ON	ON
	Volume System Control (Display 0-100)	95	95	Volume System Control (Display 0-100)	95	95
	Nc.1	95	95	Nc.2	95	95
Surge Tank	Water Level (High, Medium, Low)	High	High	Water Level (High, Medium, Low)	High	High
	Operation By	10/03/19	10/03/19	Operation By	10/03/19	10/03/19

Remark

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

10/03/19

Description	Morning			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	ON	-	-	ON	-
Sand Filter System Pressure	Nc.1	-	-	Nc.1	-	-
	Nc.2	10	10	Nc.2	10	10
	Nc.3	10	10	Nc.3	10	10
Strainers Cleaning	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Back Wash (10 min)	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	CL	1.5	1.5
	PH	7.6	7.6	PH	7.6	7.6
Chemical Additional (kg)	Soda Ash	-	-	Soda Ash	-	-
	Sodium Bisphosphate Acid	-	-	Sodium Bisphosphate Acid	-	-
	Salt	-	-	Salt	-	-
Salt Chlorinator	States (On/Off)	ON	ON	States (On/Off)	ON	ON
	Volume System Control (Display 0-100)	95	95	Volume System Control (Display 0-100)	95	95
	Nc.1	95	95	Nc.2	95	95
Surge Tank	Water Level (High, Medium, Low)	High	High	Water Level (High, Medium, Low)	High	High
	Operation By	10/03/19	10/03/19	Operation By	10/03/19	10/03/19

Remark

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Nc1	Nc2	Nc1	Nc2	
Pump Operating	-	-	-	-	-
Stand Filter System Pressure	Pressure Gauge Out [PSI]		Pressure Gauge Out [PSI]		
	Nc1	Nc2	Nc1	Nc2	
	10	10	10	10	
Strainers Cleaning	Pump		Pump		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Back Wash (10 min)	Filter		Filter		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL		CL		
	Nc1	Nc2	Nc1	Nc2	
	1.5	1.5	1.5	1.5	
Chemical Addition (kg)	PH		PH		
	Nc1	Nc2	Nc1	Nc2	
	7.6	7.6	7.6	7.6	
Surge Tank	Water Level [High, Medium, Low]		Water Level [High, Medium, Low]		
	Nc1	Nc2	Nc1	Nc2	
	LOW	LOW	LOW	LOW	

Remark: Chief Engineer

Backcheck By

W.2.6-21

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Nc1	Nc2	Nc1	Nc2	
Pump Operating	-	-	-	-	-
Stand Filter System Pressure	Pressure Gauge Out [PSI]		Pressure Gauge Out [PSI]		
	Nc1	Nc2	Nc1	Nc2	
	10	10	10	10	
Strainers Cleaning	Pump		Pump		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Back Wash (10 min)	Filter		Filter		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL		CL		
	Nc1	Nc2	Nc1	Nc2	
	1.5	1.5	1.5	1.5	
Chemical Addition (kg)	PH		PH		
	Nc1	Nc2	Nc1	Nc2	
	7.6	7.6	7.6	7.6	
Surge Tank	Water Level [High, Medium, Low]		Water Level [High, Medium, Low]		
	Nc1	Nc2	Nc1	Nc2	
	LOW	LOW	LOW	LOW	

Remark: Chief Engineer

Backcheck By

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Nc1	Nc2	Nc1	Nc2	
Pump Operating	-	-	-	-	-
Stand Filter System Pressure	Pressure Gauge Out [PSI]		Pressure Gauge Out [PSI]		
	Nc1	Nc2	Nc1	Nc2	
	10	10	10	10	
Strainers Cleaning	Pump		Pump		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Back Wash (10 min)	Filter		Filter		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL		CL		
	Nc1	Nc2	Nc1	Nc2	
	1.5	1.5	1.5	1.5	
Chemical Addition (kg)	PH		PH		
	Nc1	Nc2	Nc1	Nc2	
	7.6	7.6	7.6	7.6	
Surge Tank	Water Level [High, Medium, Low]		Water Level [High, Medium, Low]		
	Nc1	Nc2	Nc1	Nc2	
	LOW	LOW	LOW	LOW	

Remark: Chief Engineer

Backcheck By

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Nc1	Nc2	Nc1	Nc2	
Pump Operating	-	-	-	-	-
Stand Filter System Pressure	Pressure Gauge Out [PSI]		Pressure Gauge Out [PSI]		
	Nc1	Nc2	Nc1	Nc2	
	10	10	10	10	
Strainers Cleaning	Pump		Pump		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Back Wash (10 min)	Filter		Filter		
	Nc1	Nc2	Nc1	Nc2	
	-	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL		CL		
	Nc1	Nc2	Nc1	Nc2	
	1.5	1.5	1.5	1.5	
Chemical Addition (kg)	PH		PH		
	Nc1	Nc2	Nc1	Nc2	
	7.6	7.6	7.6	7.6	
Surge Tank	Water Level [High, Medium, Low]		Water Level [High, Medium, Low]		
	Nc1	Nc2	Nc1	Nc2	
	LOW	LOW	LOW	LOW	

Remark: Chief Engineer

Backcheck By

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 20/03/24

Description	Morning		Afternoon		Night	
	State	Time	State	Time	State	Time
Pump Operating	Ns1	-	Ns1	-	Ns1	-
	Ns2	-	Ns2	ON	Ns2	-
	Ns3	ON	Ns3	-	Ns3	-
Sand Filter System Pressure	Ns4	-	Ns4	-	Ns4	-
	Ns5	10	Ns5	10	Ns5	-
	Ns6	10	Ns6	10	Ns6	-
Strainers Cleaning	Ns7	-	Ns7	-	Ns7	-
	Ns8	-	Ns8	-	Ns8	-
	Ns9	-	Ns9	-	Ns9	-
Back Wash (10 min.)	Ns10	-	Ns10	-	Ns10	-
	Ns11	-	Ns11	-	Ns11	-
	Ns12	-	Ns12	-	Ns12	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	CL	1.5	CL	1.5
	PH	7.6	PH	7.6	PH	7.6
Chemical Addition (kg)	Ns13	-	Ns13	-	Ns13	-
	Ns14	-	Ns14	-	Ns14	-
	Ns15	-	Ns15	-	Ns15	-
Salt Chlorinator	Ns16	-	Ns16	-	Ns16	-
	Ns17	-	Ns17	-	Ns17	-
	Ns18	-	Ns18	-	Ns18	-
Surge Tank	Ns19	-	Ns19	-	Ns19	-
	Ns20	-	Ns20	-	Ns20	-
	Ns21	-	Ns21	-	Ns21	-

Remark:

Chief Engineer

Relieved By

W.2.6-22

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 27/3/24

Description	Morning		Afternoon		Night	
	State	Time	State	Time	State	Time
Pump Operating	Ns1	-	Ns1	-	Ns1	-
	Ns2	-	Ns2	ON	Ns2	-
	Ns3	ON	Ns3	-	Ns3	-
Sand Filter System Pressure	Ns4	-	Ns4	-	Ns4	-
	Ns5	10	Ns5	10	Ns5	-
	Ns6	10	Ns6	10	Ns6	-
Strainers Cleaning	Ns7	-	Ns7	-	Ns7	-
	Ns8	-	Ns8	-	Ns8	-
	Ns9	-	Ns9	-	Ns9	-
Back Wash (10 min.)	Ns10	-	Ns10	-	Ns10	-
	Ns11	-	Ns11	-	Ns11	-
	Ns12	-	Ns12	-	Ns12	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	CL	1.5	CL	1.5
	PH	7.6	PH	7.6	PH	7.6
Chemical Addition (kg)	Ns13	-	Ns13	-	Ns13	-
	Ns14	-	Ns14	-	Ns14	-
	Ns15	-	Ns15	-	Ns15	-
Salt Chlorinator	Ns16	-	Ns16	-	Ns16	-
	Ns17	-	Ns17	-	Ns17	-
	Ns18	-	Ns18	-	Ns18	-
Surge Tank	Ns19	-	Ns19	-	Ns19	-
	Ns20	-	Ns20	-	Ns20	-
	Ns21	-	Ns21	-	Ns21	-

Remark:

Chief Engineer

Relieved By

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 28/3/24

Description	Morning		Afternoon		Night	
	State	Time	State	Time	State	Time
Pump Operating	Ns1	-	Ns1	-	Ns1	-
	Ns2	-	Ns2	ON	Ns2	-
	Ns3	ON	Ns3	-	Ns3	-
Sand Filter System Pressure	Ns4	-	Ns4	-	Ns4	-
	Ns5	10	Ns5	10	Ns5	-
	Ns6	10	Ns6	10	Ns6	-
Strainers Cleaning	Ns7	-	Ns7	-	Ns7	-
	Ns8	-	Ns8	-	Ns8	-
	Ns9	-	Ns9	-	Ns9	-
Back Wash (10 min.)	Ns10	-	Ns10	-	Ns10	-
	Ns11	-	Ns11	-	Ns11	-
	Ns12	-	Ns12	-	Ns12	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	CL	1.5	CL	1.5
	PH	7.6	PH	7.6	PH	7.6
Chemical Addition (kg)	Ns13	-	Ns13	-	Ns13	-
	Ns14	-	Ns14	-	Ns14	-
	Ns15	-	Ns15	-	Ns15	-
Salt Chlorinator	Ns16	-	Ns16	-	Ns16	-
	Ns17	-	Ns17	-	Ns17	-
	Ns18	-	Ns18	-	Ns18	-
Surge Tank	Ns19	-	Ns19	-	Ns19	-
	Ns20	-	Ns20	-	Ns20	-
	Ns21	-	Ns21	-	Ns21	-

Remark:

Chief Engineer

Relieved By

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 28/3/24

Description	Morning		Afternoon		Night	
	State	Time	State	Time	State	Time
Pump Operating	Ns1	-	Ns1	-	Ns1	-
	Ns2	-	Ns2	ON	Ns2	-
	Ns3	ON	Ns3	-	Ns3	-
Sand Filter System Pressure	Ns4	-	Ns4	-	Ns4	-
	Ns5	10	Ns5	10	Ns5	-
	Ns6	10	Ns6	10	Ns6	-
Strainers Cleaning	Ns7	-	Ns7	-	Ns7	-
	Ns8	-	Ns8	-	Ns8	-
	Ns9	-	Ns9	-	Ns9	-
Back Wash (10 min.)	Ns10	-	Ns10	-	Ns10	-
	Ns11	-	Ns11	-	Ns11	-
	Ns12	-	Ns12	-	Ns12	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	CL	1.5	CL	1.5
	PH	7.6	PH	7.6	PH	7.6
Chemical Addition (kg)	Ns13	-	Ns13	-	Ns13	-
	Ns14	-	Ns14	-	Ns14	-
	Ns15	-	Ns15	-	Ns15	-
Salt Chlorinator	Ns16	-	Ns16	-	Ns16	-
	Ns17	-	Ns17	-	Ns17	-
	Ns18	-	Ns18	-	Ns18	-
Surge Tank	Ns19	-	Ns19	-	Ns19	-
	Ns20	-	Ns20	-	Ns20	-
	Ns21	-	Ns21	-	Ns21	-

Remark:

Chief Engineer

Relieved By

NOVOTEL
HOTEL & RESORTS

SWIMMING POOL LOG SHEET : DAILY

Date: 20/11/24

Description	Morning			Afternoon			Night		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating									
Sand Filter System Pressure	Ns1	10		Ns1	10		Ns1	10	
	Ns2	10		Ns2	10		Ns2	10	
	Ns3			Ns3			Ns3		
Strainers Cleaning	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Back Wash (10 min.)	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Chlorine & PH Test Results (Test kit manual)	CL	1.5		CL	1.5		CL	1.5	
	PH	7.4		PH	7.4		PH	7.4	
Chemical Addition (kg)	Chlorine			Chlorine			Chlorine		
	Soda Ash			Soda Ash			Soda Ash		
	Sodium Bicarbonate			Sodium Bicarbonate			Sodium Bicarbonate		
	Acid			Acid			Acid		
Salt Chlorinator	State (On/Off)	ON		State (On/Off)	ON		State (On/Off)	ON	
	Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95	
Surge Tank	Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High	

Remark: Chief Engineer

NOVOTEL
HOTEL & RESORTS

SWIMMING POOL LOG SHEET : DAILY

Date: 20/11/24

Description	Morning			Afternoon			Night		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating									
Sand Filter System Pressure	Ns1	10		Ns1	10		Ns1	10	
	Ns2	10		Ns2	10		Ns2	10	
	Ns3			Ns3			Ns3		
Strainers Cleaning	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Back Wash (10 min.)	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Chlorine & PH Test Results (Test kit manual)	CL	1.5		CL	1.5		CL	1.5	
	PH	7.4		PH	7.4		PH	7.4	
Chemical Addition (kg)	Chlorine			Chlorine			Chlorine		
	Soda Ash			Soda Ash			Soda Ash		
	Sodium Bicarbonate			Sodium Bicarbonate			Sodium Bicarbonate		
	Acid			Acid			Acid		
Salt Chlorinator	State (On/Off)	ON		State (On/Off)	ON		State (On/Off)	ON	
	Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95	
Surge Tank	Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High	

Remark: Chief Engineer

NOVOTEL
HOTEL & RESORTS

SWIMMING POOL LOG SHEET : DAILY

Date: 20/11/24

Description	Morning			Afternoon			Night		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating									
Sand Filter System Pressure	Ns1	10		Ns1	10		Ns1	10	
	Ns2	10		Ns2	10		Ns2	10	
	Ns3			Ns3			Ns3		
Strainers Cleaning	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Back Wash (10 min.)	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Chlorine & PH Test Results (Test kit manual)	CL	1.5		CL	1.5		CL	1.5	
	PH	7.4		PH	7.4		PH	7.4	
Chemical Addition (kg)	Chlorine			Chlorine			Chlorine		
	Soda Ash			Soda Ash			Soda Ash		
	Sodium Bicarbonate			Sodium Bicarbonate			Sodium Bicarbonate		
	Acid			Acid			Acid		
Salt Chlorinator	State (On/Off)	ON		State (On/Off)	ON		State (On/Off)	ON	
	Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95	
Surge Tank	Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High	

Remark: Chief Engineer

NOVOTEL
HOTEL & RESORTS

SWIMMING POOL LOG SHEET : DAILY

Date: 20/11/24

Description	Morning			Afternoon			Night		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating									
Sand Filter System Pressure	Ns1	10		Ns1	10		Ns1	10	
	Ns2	10		Ns2	10		Ns2	10	
	Ns3			Ns3			Ns3		
Strainers Cleaning	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Back Wash (10 min.)	Ns1			Ns1			Ns1		
	Ns2			Ns2			Ns2		
	Ns3			Ns3			Ns3		
Chlorine & PH Test Results (Test kit manual)	CL	1.5		CL	1.5		CL	1.5	
	PH	7.4		PH	7.4		PH	7.4	
Chemical Addition (kg)	Chlorine			Chlorine			Chlorine		
	Soda Ash			Soda Ash			Soda Ash		
	Sodium Bicarbonate			Sodium Bicarbonate			Sodium Bicarbonate		
	Acid			Acid			Acid		
Salt Chlorinator	State (On/Off)	ON		State (On/Off)	ON		State (On/Off)	ON	
	Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95		Volume System Control (Display 0-100)	95	
Surge Tank	Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High		Water Level (High, Medium, Low)	High	

Remark: Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date: 8/4/24

Description	Morning			Afternoon			Night
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
Pump Operating	-	-	-	-	-	-	-
Sand Filter System Pressure	Pressure Gauge Out (PSI)			Pressure Gauge Out (PSI)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	10	10	-	0	0	-	4.9
	-	-	-	-	-	-	4.9
Strainers Cleaning	Pump			Pump			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Back Wash (10 min)	Filter			Filter			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL			CL			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	1.5	1.5	-	1.5	1.5	-	7.0
	PH	PH	PH	PH	PH	PH	7.1
Chemical Addition (kg)	Chlorine			Chlorine			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Salt Chlorinator	Status (On/Off)			Status (On/Off)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	OFF	OFF	OFF	OFF	OFF	OFF	ON
	-	-	-	-	-	-	ON
Surge Tank	Volume System Control (Display 0-100)			Volume System Control (Display 0-100)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	0	0	0	0	0	0	0
	-	-	-	-	-	-	0
Water Level (High, Medium, Low)	Operation By			Operation By			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-

Remark: Chief Engineer

Remark: By

W.2.6-25

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date: 8/4/24

Description	Morning			Afternoon			Night
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
Pump Operating	-	-	-	-	-	-	-
Sand Filter System Pressure	Pressure Gauge Out (PSI)			Pressure Gauge Out (PSI)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	10	10	-	0	0	-	-
	-	-	-	-	-	-	-
Strainers Cleaning	Pump			Pump			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Back Wash (10 min)	Filter			Filter			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL			CL			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	1.5	1.5	-	1.5	1.5	-	7.0
	PH	PH	PH	PH	PH	PH	7.1
Chemical Addition (kg)	Chlorine			Chlorine			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Salt Chlorinator	Status (On/Off)			Status (On/Off)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	OFF	OFF	OFF	OFF	OFF	OFF	ON
	-	-	-	-	-	-	ON
Surge Tank	Volume System Control (Display 0-100)			Volume System Control (Display 0-100)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	0	0	0	0	0	0	0
	-	-	-	-	-	-	0
Water Level (High, Medium, Low)	Operation By			Operation By			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-

Remark: Chief Engineer

Remark: By

W.2.6-25

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date: 7/14/24

Description	Morning			Afternoon			Night
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
Pump Operating	-	-	-	-	-	-	-
Sand Filter System Pressure	Pressure Gauge Out (PSI)			Pressure Gauge Out (PSI)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	10	10	-	0	0	-	4.9
	-	-	-	-	-	-	4.9
Strainers Cleaning	Pump			Pump			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Back Wash (10 min)	Filter			Filter			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL			CL			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	1.5	1.5	-	1.5	1.5	-	7.0
	PH	PH	PH	PH	PH	PH	7.1
Chemical Addition (kg)	Chlorine			Chlorine			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Salt Chlorinator	Status (On/Off)			Status (On/Off)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	OFF	OFF	OFF	OFF	OFF	OFF	ON
	-	-	-	-	-	-	ON
Surge Tank	Volume System Control (Display 0-100)			Volume System Control (Display 0-100)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	0	0	0	0	0	0	0
	-	-	-	-	-	-	0
Water Level (High, Medium, Low)	Operation By			Operation By			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-

Remark: Chief Engineer

Remark: By

W.2.6-25

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date: 7/14/24

Description	Morning			Afternoon			Night
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
Pump Operating	-	-	-	-	-	-	-
Sand Filter System Pressure	Pressure Gauge Out (PSI)			Pressure Gauge Out (PSI)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	10	10	-	0	0	-	-
	-	-	-	-	-	-	-
Strainers Cleaning	Pump			Pump			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Back Wash (10 min)	Filter			Filter			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL			CL			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	1.5	1.5	-	1.5	1.5	-	7.0
	PH	PH	PH	PH	PH	PH	7.1
Chemical Addition (kg)	Chlorine			Chlorine			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-
Salt Chlorinator	Status (On/Off)			Status (On/Off)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	OFF	OFF	OFF	OFF	OFF	OFF	ON
	-	-	-	-	-	-	ON
Surge Tank	Volume System Control (Display 0-100)			Volume System Control (Display 0-100)			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	0	0	0	0	0	0	0
	-	-	-	-	-	-	0
Water Level (High, Medium, Low)	Operation By			Operation By			
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	
	-	-	-	-	-	-	-
	-	-	-	-	-	-	-

Remark: Chief Engineer

Remark: By

W.2.6-25

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (On/Off)	Date	Time
Pump Operating	Ns1	-	-	-	-	-
	Ns2	-	-	-	-	-
	Ns3	-	-	-	-	-
Sand Filter System Pressure	Ns4	10	-	-	-	-
	Ns5	10	-	-	-	-
	Ns6	-	-	-	-	-
Strainers Cleaning	Ns7	-	-	-	-	-
	Ns8	-	-	-	-	-
	Ns9	-	-	-	-	-
Back Wash (10 min)	Ns10	-	-	-	-	-
	Ns11	-	-	-	-	-
	Ns12	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns13	1.5	-	-	-	-
	Ns14	7.5	-	-	-	-
	Ns15	-	-	-	-	-
Chemical Addition (kg)	Ns16	-	-	-	-	-
	Ns17	-	-	-	-	-
	Ns18	-	-	-	-	-
Salt Chlorinator	Ns19	-	-	-	-	-
	Ns20	-	-	-	-	-
	Ns21	-	-	-	-	-
Surge Tank	Ns22	-	-	-	-	-
	Ns23	-	-	-	-	-
	Ns24	-	-	-	-	-

Remark: _____

Retest By: _____

Chief Engineer: _____

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (On/Off)	Date	Time
Pump Operating	Ns1	-	-	-	-	-
	Ns2	-	-	-	-	-
	Ns3	-	-	-	-	-
Sand Filter System Pressure	Ns4	10	-	-	-	-
	Ns5	10	-	-	-	-
	Ns6	-	-	-	-	-
Strainers Cleaning	Ns7	-	-	-	-	-
	Ns8	-	-	-	-	-
	Ns9	-	-	-	-	-
Back Wash (10 min)	Ns10	-	-	-	-	-
	Ns11	-	-	-	-	-
	Ns12	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns13	1.5	-	-	-	-
	Ns14	7.5	-	-	-	-
	Ns15	-	-	-	-	-
Chemical Addition (kg)	Ns16	-	-	-	-	-
	Ns17	-	-	-	-	-
	Ns18	-	-	-	-	-
Salt Chlorinator	Ns19	-	-	-	-	-
	Ns20	-	-	-	-	-
	Ns21	-	-	-	-	-
Surge Tank	Ns22	-	-	-	-	-
	Ns23	-	-	-	-	-
	Ns24	-	-	-	-	-

Remark: _____

Retest By: _____

Chief Engineer: _____

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (On/Off)	Date	Time
Pump Operating	Ns1	ON	-	-	-	-
	Ns2	-	-	-	-	-
	Ns3	-	-	-	-	-
Sand Filter System Pressure	Ns4	10	-	-	-	-
	Ns5	10	-	-	-	-
	Ns6	-	-	-	-	-
Strainers Cleaning	Ns7	-	-	-	-	-
	Ns8	-	-	-	-	-
	Ns9	-	-	-	-	-
Back Wash (10 min)	Ns10	-	-	-	-	-
	Ns11	-	-	-	-	-
	Ns12	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns13	1.5	-	-	-	-
	Ns14	7.5	-	-	-	-
	Ns15	-	-	-	-	-
Chemical Addition (kg)	Ns16	-	-	-	-	-
	Ns17	-	-	-	-	-
	Ns18	-	-	-	-	-
Salt Chlorinator	Ns19	-	-	-	-	-
	Ns20	-	-	-	-	-
	Ns21	-	-	-	-	-
Surge Tank	Ns22	-	-	-	-	-
	Ns23	-	-	-	-	-
	Ns24	-	-	-	-	-

Remark: _____

Retest By: _____

Chief Engineer: _____

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (On/Off)	Date	Time
Pump Operating	Ns1	-	-	-	-	-
	Ns2	-	-	-	-	-
	Ns3	-	-	-	-	-
Sand Filter System Pressure	Ns4	10	-	-	-	-
	Ns5	10	-	-	-	-
	Ns6	-	-	-	-	-
Strainers Cleaning	Ns7	-	-	-	-	-
	Ns8	-	-	-	-	-
	Ns9	-	-	-	-	-
Back Wash (10 min)	Ns10	-	-	-	-	-
	Ns11	-	-	-	-	-
	Ns12	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns13	1.5	-	-	-	-
	Ns14	7.5	-	-	-	-
	Ns15	-	-	-	-	-
Chemical Addition (kg)	Ns16	-	-	-	-	-
	Ns17	-	-	-	-	-
	Ns18	-	-	-	-	-
Salt Chlorinator	Ns19	-	-	-	-	-
	Ns20	-	-	-	-	-
	Ns21	-	-	-	-	-
Surge Tank	Ns22	-	-	-	-	-
	Ns23	-	-	-	-	-
	Ns24	-	-	-	-	-

Remark: _____

Retest By: _____

Chief Engineer: _____

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date 24/4/24

Description	Morning 06:00			Afternoon 12:00			Night 01:00		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating	-	-	-	-	-	-	-	-	-
Sand Filter System Pressure	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10
Strainers Cleaning	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
Chemical Additional (kg)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Salt Chlorinator	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Surge Tank	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10

Remark:

Chief Engineer

Checked By

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date 24/4/24

Description	Morning 06:00			Afternoon 12:00			Night 01:00		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating	-	-	-	-	-	-	-	-	-
Sand Filter System Pressure	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10
Strainers Cleaning	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
Chemical Additional (kg)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Salt Chlorinator	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Surge Tank	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10

Remark:

Chief Engineer

Checked By

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date 23/4/24

Description	Morning 06:00			Afternoon 12:00			Night 01:00		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating	-	-	-	-	-	-	-	-	-
Sand Filter System Pressure	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10
Strainers Cleaning	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
Chemical Additional (kg)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Salt Chlorinator	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Surge Tank	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10

Remark:

Checked By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date 23/4/24

Description	Morning 06:00			Afternoon 12:00			Night 01:00		
	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
Pump Operating	-	-	-	-	-	-	-	-	-
Sand Filter System Pressure	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10
Strainers Cleaning	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
	1.5	7.6	1.5	1.5	7.6	1.5	1.5	7.6	1.5
Chemical Additional (kg)	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Salt Chlorinator	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	-	-	-	-	-	-	-	-	-
	-	-	-	-	-	-	-	-	-
Surge Tank	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3	Ns1	Ns2	Ns3
	10	10	10	10	10	10	10	10	10
	10	10	10	10	10	10	10	10	10

Remark:

Checked By

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

26/4/24

Date: 26/4/24

Description	Morning		Afternoon		State (On, Off)	Night
	1	2	1	2		
Pump Operating	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	ON	Ns3	ON	-	ON
Sand Filter System Pressure	Ns4	-	Ns4	-	-	-
	Ns2	10	Ns2	10	-	10
	Ns3	-	Ns3	10	-	10
Strainers Cleaning	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Back Wash (10 min.)	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Chlorine & PH Test Results (Test 1st manual)	CL	1.8	CL	1.8	-	1.5
	PH	7.6	PH	7.6	-	7.6
Chemical Addition (kg)	Chlorine	-	Chlorine	-	-	-
	Soda Ash	-	Soda Ash	-	-	-
	Sodium Bisphosphate Acid Salt	-	Sodium Bisphosphate Acid Salt	-	-	-
Salt Chlorinator	State (On/Off)	ON	State (On/Off)	ON	-	ON
	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
Surge Tank	Volume System Control (Display 0-100)	45	Volume System Control (Display 0-100)	45	-	45
	Ns1	10	Ns1	10	-	10
	Ns2	10	Ns2	10	-	10
Water Level (High, Medium, Low)	Water Level	High	Water Level	High	-	High
	Operation By	5/11/24	Operation By	5/11/24	-	5/11/24
	Remark	5/11/24	Remark	5/11/24	-	5/11/24

Remark: 5/11/24

Retest By: 5/11/24

Chief Engineer: 5/11/24

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

27/04/24

Date: 27/04/24

Description	Morning		Afternoon		State (On, Off)	Night
	1	2	1	2		
Pump Operating	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	ON	Ns3	ON	-	ON
Sand Filter System Pressure	Ns4	-	Ns4	-	-	-
	Ns2	10	Ns2	10	-	10
	Ns3	10	Ns3	10	-	10
Strainers Cleaning	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Back Wash (10 min.)	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Chlorine & PH Test Results (Test 1st manual)	CL	1.5	CL	1.5	-	1.5
	PH	7.6	PH	7.6	-	7.6
Chemical Addition (kg)	Chlorine	-	Chlorine	-	-	-
	Soda Ash	-	Soda Ash	-	-	-
	Sodium Bisphosphate Acid Salt	-	Sodium Bisphosphate Acid Salt	-	-	-
Salt Chlorinator	State (On/Off)	ON	State (On/Off)	ON	-	ON
	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
Surge Tank	Volume System Control (Display 0-100)	45	Volume System Control (Display 0-100)	45	-	45
	Ns1	10	Ns1	10	-	10
	Ns2	10	Ns2	10	-	10
Water Level (High, Medium, Low)	Water Level	High	Water Level	High	-	High
	Operation By	5/11/24	Operation By	5/11/24	-	5/11/24
	Remark	5/11/24	Remark	5/11/24	-	5/11/24

Remark: 5/11/24

Retest By: 5/11/24

Chief Engineer: 5/11/24

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

28/4/24

Date: 28/4/24

Description	Morning		Afternoon		State (On, Off)	Night
	1	2	1	2		
Pump Operating	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	ON	Ns3	ON	-	ON
Sand Filter System Pressure	Ns4	-	Ns4	-	-	-
	Ns2	10	Ns2	10	-	10
	Ns3	10	Ns3	10	-	10
Strainers Cleaning	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Back Wash (10 min.)	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Chlorine & PH Test Results (Test 1st manual)	CL	1.5	CL	1.5	-	1.5
	PH	7.6	PH	7.6	-	7.6
Chemical Addition (kg)	Chlorine	-	Chlorine	-	-	-
	Soda Ash	-	Soda Ash	-	-	-
	Sodium Bisphosphate Acid Salt	-	Sodium Bisphosphate Acid Salt	-	-	-
Salt Chlorinator	State (On/Off)	ON	State (On/Off)	ON	-	ON
	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
Surge Tank	Volume System Control (Display 0-100)	45	Volume System Control (Display 0-100)	45	-	45
	Ns1	10	Ns1	10	-	10
	Ns2	10	Ns2	10	-	10
Water Level (High, Medium, Low)	Water Level	High	Water Level	High	-	High
	Operation By	5/11/24	Operation By	5/11/24	-	5/11/24
	Remark	5/11/24	Remark	5/11/24	-	5/11/24

Remark: 5/11/24

Retest By: 5/11/24

Chief Engineer: 5/11/24

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

28/4/24

Date: 28/4/24

Description	Morning		Afternoon		State (On, Off)	Night
	1	2	1	2		
Pump Operating	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	ON	Ns3	ON	-	ON
Sand Filter System Pressure	Ns4	-	Ns4	-	-	-
	Ns2	10	Ns2	10	-	10
	Ns3	10	Ns3	10	-	10
Strainers Cleaning	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Back Wash (10 min.)	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
	Ns3	-	Ns3	-	-	-
Chlorine & PH Test Results (Test 1st manual)	CL	1.5	CL	1.5	-	1.5
	PH	7.6	PH	7.6	-	7.6
Chemical Addition (kg)	Chlorine	-	Chlorine	-	-	-
	Soda Ash	-	Soda Ash	-	-	-
	Sodium Bisphosphate Acid Salt	-	Sodium Bisphosphate Acid Salt	-	-	-
Salt Chlorinator	State (On/Off)	ON	State (On/Off)	ON	-	ON
	Ns1	-	Ns1	-	-	-
	Ns2	-	Ns2	-	-	-
Surge Tank	Volume System Control (Display 0-100)	45	Volume System Control (Display 0-100)	45	-	45
	Ns1	10	Ns1	10	-	10
	Ns2	10	Ns2	10	-	10
Water Level (High, Medium, Low)	Water Level	High	Water Level	High	-	High
	Operation By	5/11/24	Operation By	5/11/24	-	5/11/24
	Remark	5/11/24	Remark	5/11/24	-	5/11/24

Remark: 5/11/24

Retest By: 5/11/24

Chief Engineer: 5/11/24

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Night
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	
Pump Operating	ON	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Strainers Cleaning	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Back Wash (10 min)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chlorine & PH Test Results (Test kit manual)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chemical Addition (kg)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Salt Chlorinator	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Surge Tank	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10

Chief Engineer

Backfill By

W.2.6-31

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Night
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	
Pump Operating	ON	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Strainers Cleaning	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Back Wash (10 min)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chlorine & PH Test Results (Test kit manual)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chemical Addition (kg)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Salt Chlorinator	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Surge Tank	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10

Chief Engineer

Backfill By

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Night
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	
Pump Operating	ON	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Strainers Cleaning	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Back Wash (10 min)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chlorine & PH Test Results (Test kit manual)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chemical Addition (kg)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Salt Chlorinator	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Surge Tank	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10

Chief Engineer

Backfill By

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning			Afternoon			Night
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	
Pump Operating	ON	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Strainers Cleaning	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Back Wash (10 min)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chlorine & PH Test Results (Test kit manual)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Chemical Addition (kg)	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Salt Chlorinator	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10
Surge Tank	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1
	10	10	10	10	10	10	10
	10	10	10	10	10	10	10

Chief Engineer

Backfill By

SWIMMING POOL LOG SHEET - DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (Ems Off)	Notes
Pump Operating	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sand Filter System Pressure	Pool 1	10	10	10	
	Pool 2	10	10	10	
	Pool 3	10	10	10	
Suction Chilling	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Back Wash (10 min)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Chlorine & PH Test Results (Test for 10 min)	Pool 1	1.5	7.0	7.0	
	Pool 2	1.5	7.0	7.0	
	Pool 3	1.5	7.0	7.0	
Chemical Addition (1%)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sodium Bisulfate Acid	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sulf Chlorinator	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Single Tank	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	

Chief Engineer

Backfill By

NOVOTEL

W.2.6-32

SWIMMING POOL LOG SHEET - DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (Ems Off)	Notes
Pump Operating	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sand Filter System Pressure	Pool 1	10	10	10	
	Pool 2	10	10	10	
	Pool 3	10	10	10	
Suction Chilling	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Back Wash (10 min)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Chlorine & PH Test Results (Test for 10 min)	Pool 1	1.5	7.0	7.0	
	Pool 2	1.5	7.0	7.0	
	Pool 3	1.5	7.0	7.0	
Chemical Addition (1%)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sodium Bisulfate Acid	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sulf Chlorinator	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Single Tank	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	

Chief Engineer

Backfill By

NOVOTEL

SWIMMING POOL LOG SHEET - DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (Ems Off)	Notes
Pump Operating	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sand Filter System Pressure	Pool 1	10	10	10	
	Pool 2	10	10	10	
	Pool 3	10	10	10	
Suction Chilling	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Back Wash (10 min)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Chlorine & PH Test Results (Test for 10 min)	Pool 1	1.5	7.0	7.0	
	Pool 2	1.5	7.0	7.0	
	Pool 3	1.5	7.0	7.0	
Chemical Addition (1%)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sodium Bisulfate Acid	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sulf Chlorinator	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Single Tank	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	

Chief Engineer

Backfill By

NOVOTEL

SWIMMING POOL LOG SHEET - DAILY

NOVOTEL

Description		Monitoring	Alarm	Status (Ems Off)	Notes
Pump Operating	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sand Filter System Pressure	Pool 1	10	10	10	
	Pool 2	10	10	10	
	Pool 3	10	10	10	
Suction Chilling	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Back Wash (10 min)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Chlorine & PH Test Results (Test for 10 min)	Pool 1	1.5	7.0	7.0	
	Pool 2	1.5	7.0	7.0	
	Pool 3	1.5	7.0	7.0	
Chemical Addition (1%)	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sodium Bisulfate Acid	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Sulf Chlorinator	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	
Single Tank	Pool 1	ON	ON	ON	
	Pool 2	ON	ON	ON	
	Pool 3	ON	ON	ON	

Chief Engineer

Backfill By

NOVOTEL

NOVOTEL
S.W.I.M.M.I.N.G. P.O.O.L. L.O.G. S.H.E.E.T. : D.A.I.L.Y.

Date: 10/05/24 Night: 10/05/24

Description	Morning			Afternoon			Evening		
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3
Pump Operating	-	-	-	ON	ON	ON	-	-	-
Pressure Gauge Out [Pa]	-	-	-	10	10	10	-	-	-
Sand Filter System Pressure	-	-	-	10	10	10	-	-	-
Strainers Cleaning	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	-	-	-	1.0	7.8	7.8	-	-	-
Chlorine	-	-	-	1.0	7.8	7.8	-	-	-
Soda Ash	-	-	-	-	-	-	-	-	-
Sodium Bisulphate Acid	-	-	-	-	-	-	-	-	-
Salt	-	-	-	-	-	-	-	-	-
Aluminium Sulphate	-	-	-	-	-	-	-	-	-
Status (On/Off)	-	-	-	ON	ON	ON	-	-	-
Volume System Control (Display 4-10)	-	-	-	1.0	1.0	1.0	-	-	-
Water Level (High, Medium, Low)	-	-	-	1.0	1.0	1.0	-	-	-
Surge Tank	-	-	-	1.0	1.0	1.0	-	-	-

Remark: 10/05/24

Chief Engineer: 10/05/24

W.2.6-33

NOVOTEL
S.W.I.M.M.I.N.G. P.O.O.L. L.O.G. S.H.E.E.T. : D.A.I.L.Y.

Date: 10/05/24 Night: 10/05/24

Description	Morning			Afternoon			Evening		
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3
Pump Operating	-	-	-	ON	ON	ON	-	-	-
Pressure Gauge Out [Pa]	-	-	-	10	10	10	-	-	-
Sand Filter System Pressure	-	-	-	10	10	10	-	-	-
Strainers Cleaning	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	-	-	-	1.5	7.5	7.5	-	-	-
Chlorine	-	-	-	1.5	7.5	7.5	-	-	-
Soda Ash	-	-	-	-	-	-	-	-	-
Sodium Bisulphate Acid	-	-	-	-	-	-	-	-	-
Salt	-	-	-	-	-	-	-	-	-
Aluminium Sulphate	-	-	-	-	-	-	-	-	-
Status (On/Off)	-	-	-	ON	ON	ON	-	-	-
Volume System Control (Display 4-10)	-	-	-	1.0	1.0	1.0	-	-	-
Water Level (High, Medium, Low)	-	-	-	1.0	1.0	1.0	-	-	-
Surge Tank	-	-	-	1.0	1.0	1.0	-	-	-

Remark: 10/05/24

Chief Engineer: 10/05/24

NOVOTEL
S.W.I.M.M.I.N.G. P.O.O.L. L.O.G. S.H.E.E.T. : D.A.I.L.Y.

Date: 10/05/24 Night: 10/05/24

Description	Morning			Afternoon			Evening		
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3
Pump Operating	-	-	-	ON	ON	ON	-	-	-
Pressure Gauge Out [Pa]	-	-	-	10	10	10	-	-	-
Sand Filter System Pressure	-	-	-	10	10	10	-	-	-
Strainers Cleaning	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	-	-	-	1.5	7.5	7.5	-	-	-
Chlorine	-	-	-	1.5	7.5	7.5	-	-	-
Soda Ash	-	-	-	-	-	-	-	-	-
Sodium Bisulphate Acid	-	-	-	-	-	-	-	-	-
Salt	-	-	-	-	-	-	-	-	-
Aluminium Sulphate	-	-	-	-	-	-	-	-	-
Status (On/Off)	-	-	-	ON	ON	ON	-	-	-
Volume System Control (Display 4-10)	-	-	-	1.0	1.0	1.0	-	-	-
Water Level (High, Medium, Low)	-	-	-	1.0	1.0	1.0	-	-	-
Surge Tank	-	-	-	1.0	1.0	1.0	-	-	-

Remark: 10/05/24

Chief Engineer: 10/05/24

NOVOTEL
S.W.I.M.M.I.N.G. P.O.O.L. L.O.G. S.H.E.E.T. : D.A.I.L.Y.

Date: 10/05/24 Night: 10/05/24

Description	Morning			Afternoon			Evening		
	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3	Nc1	Nc2	Nc3
Pump Operating	-	-	-	ON	ON	ON	-	-	-
Pressure Gauge Out [Pa]	-	-	-	10	10	10	-	-	-
Sand Filter System Pressure	-	-	-	10	10	10	-	-	-
Strainers Cleaning	-	-	-	-	-	-	-	-	-
Back Wash (10 min)	-	-	-	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	-	-	-	1.5	7.5	7.5	-	-	-
Chlorine	-	-	-	1.5	7.5	7.5	-	-	-
Soda Ash	-	-	-	-	-	-	-	-	-
Sodium Bisulphate Acid	-	-	-	-	-	-	-	-	-
Salt	-	-	-	-	-	-	-	-	-
Aluminium Sulphate	-	-	-	-	-	-	-	-	-
Status (On/Off)	-	-	-	ON	ON	ON	-	-	-
Volume System Control (Display 4-10)	-	-	-	1.0	1.0	1.0	-	-	-
Water Level (High, Medium, Low)	-	-	-	1.0	1.0	1.0	-	-	-
Surge Tank	-	-	-	1.0	1.0	1.0	-	-	-

Remark: 10/05/24

Chief Engineer: 10/05/24

NOVOTEL		SWIMMING POOL LOG SHEET : DAILY			Date
Description	Meters	Altitude	Night	Date	
Pump Operating	Nc-1	-	-	12/05/67	
	Nc-2	ON (MAN)	-		
	Nc-3	-	-		
Stand Filter System Pressure	Nc-1	-	-	1000	
	Nc-2	10	-		
	Nc-3	10	-		
Strainers Cleaning	Nc-1	-	-	Pump	
	Nc-2	-	-		
	Nc-3	-	-		
Back Wash (10 min)	Nc-1	-	-	Filter	
	Nc-2	-	-		
	Nc-3	-	-		
Chlorine & PH Test Results (Test for standard)	CL	1.0	-	1.0	
	CL	9.5	-		
	PH	-	-		
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-		
	Sulfuric Acid	-	-		
Salt	Salt	-	-	-	
	Aluminium Sulphate	-	-		
	Silica	-	-		
Salt Chlorinator	Nc-1	ON	-	-	
	Nc-2	ON	-		
	Nc-3	ON	-		
Serge Tank	Volume System Control (Display 0100)	85	-	85	
	Water Level (High, Medium, Low)	85	-		
	Water Level (High, Medium, Low)	85	-		

Remark
 Pump - 03 08:20/09 11:15/03 20/00
 1

Chief Engineer

NOVOTEL

Date: 13/5/27

SWIMMING POOL LOG SHEET : DAILY

Client: Novotel

Pool Name: Novotel

Description	Reading		Alerts		Night
	10:00	18:00	10:00	18:00	
Pool Operating	Nc-1	-	-	-	-
	Nc-2	-	-	-	-
	Nc-3	ON	OFF	-	-
Stand Filter System Pressure	Nc-1	-	0	0	-
	Nc-2	10	0	0	-
	Nc-3	10	0	0	-
Strainers Cleaning	Nc-1	-	-	-	-
	Nc-2	-	-	-	-
	Nc-3	-	-	-	-
Back Wash (10 min)	Nc-1	-	-	-	-
	Nc-2	-	-	-	-
	Nc-3	-	-	-	-
Chlorine & PH Test Results (Test for manual)	CL	7.5	10	1.3	-
	PH	7.5	8.0	7.6	-
					-
Chemical Additives (kg)	Chlorine	-	-	-	-
	Soda Ash	-	-	-	-
	Sodium Bicarbonate Acid	-	-	-	-
	Salt	-	-	-	-
	Aluminium Sulfate	-	-	-	-
Salt Chlorinator	Saline (NaCl)	ON	-	-	-
	Nc-1	-	-	-	-
	Nc-2	-	-	-	-
	Nc-3	-	-	-	-
	Volume System Control (Display 4-10)	100	85	85	-
Surge Tank	Nc-1	100	100	100	-
	Nc-2	100	100	100	-
	Nc-3	100	100	100	-
Water Level (High, Medium, Low)	High		Medium		-
	Medium		Low		-
Operation By	baf				

Remark: baf

Chief Engineer

[illegible]

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date: 15/5/23

Page: 05/07

Description		Morning <u>07:00</u>	Afternoon <u>13:00</u>	Evening <u>18:00</u>	Night <u>23:00</u>
Pump Operating	Na1	-	-	-	-
	Na2	-	-	-	-
	Na3	<u>ON</u>	<u>OFF</u>	<u>ON</u>	<u>ON</u>
Sand Filter System Pressure	Pressure Gauge Out (Pa)				
	Na1	-	-	-	-
	Na2	<u>10</u>	<u>0</u>	<u>10</u>	<u>10</u>
	Na3	<u>10</u>	<u>0</u>	<u>10</u>	<u>10</u>
Strainer Cleaning	Pump				
	Na1	-	-	-	-
	Na2	-	-	-	-
	Na3	-	-	-	-
Back Wash (1 min)	Filter				
	Na1	-	-	-	-
	Na2	-	-	-	-
	Na3	-	-	-	-
Chlorine & PH Test Results (Test 1st main)	Cl	<u>1.5</u>	<u>1.5</u>	<u>1.5</u>	<u>1.5</u>
	PH	<u>7.5</u>	<u>7.6</u>	<u>7.6</u>	<u>7.6</u>
		-	-	-	-
		-	-	-	-
Chemical Additional (Kg)	Chlorine	-	-	-	-
	Soda Ash	-	-	-	-
	Sodium Bisphosphate Acid	-	-	-	-
	Salt	-	-	-	-
	Aluminium Sulfate	-	-	-	-
	Stain (On/Off)	<u>ON</u>	<u>OFF</u>	-	-
	Na1	-	-	-	-
	Na2	-	-	-	-
	Na3	-	-	-	-
	Na4	-	-	-	-
Salt Chlorinator	Volume System Control (Delay 240)				
	Na1	<u>9.5</u>	<u>9.5</u>	<u>9.5</u>	<u>9.5</u>
	Na2	<u>9.5</u>	<u>9.5</u>	<u>9.5</u>	<u>9.5</u>
	Na3	<u>9.5</u>	<u>9.5</u>	<u>9.5</u>	<u>9.5</u>
Spare Tank	Water Level (High, Medium, Low)				
	Operation By <u>Mil'lym</u>				
<div style="display: flex; justify-content: space-between;"> Remark: <u>108</u> Chief Engineer <u>2023-3</u> </div>					

Date 15/05/2020

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Start	End	Start	End	
Pump Operating	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Sand Filter System Pressure	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Strainers Cleaning	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Back Wash (10 min.)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chlorine & PH Test Results (Test kit manual)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chemical Additives (kg)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Salt Chlorinator	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Surge Tank	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-

Remark:

Retest By:

Chief Engineer

Date 15/05/2020

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Start	End	Start	End	
Pump Operating	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Sand Filter System Pressure	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Strainers Cleaning	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Back Wash (10 min.)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chlorine & PH Test Results (Test kit manual)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chemical Additives (kg)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Salt Chlorinator	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Surge Tank	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-

Remark:

Retest By:

Chief Engineer

Date 15/05/2020

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Start	End	Start	End	
Pump Operating	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Sand Filter System Pressure	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Strainers Cleaning	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Back Wash (10 min.)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chlorine & PH Test Results (Test kit manual)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chemical Additives (kg)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Salt Chlorinator	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Surge Tank	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-

Remark:

Retest By:

Chief Engineer

Date 15/05/2020

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning		Afternoon		Night
	Start	End	Start	End	
Pump Operating	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Sand Filter System Pressure	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Strainers Cleaning	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Back Wash (10 min.)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chlorine & PH Test Results (Test kit manual)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Chemical Additives (kg)	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Salt Chlorinator	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-
Surge Tank	Nc1	-	Nc1	-	-
	Nc2	-	Nc2	-	-
	Nc3	-	Nc3	-	-

Remark:

Retest By:

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

01/5/17

Description	Morning			Afternoon		
	Ns.1	Ns.2	Ns.3	Ns.1	Ns.2	Ns.3
Pump Operating	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Strainers Cleaning	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Back Wash (10 min)	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Chlorine & PH Test Results (Test kit manual)	CL	7.3	7.3	CL	7.3	7.3
	PH	7.3	7.3	PH	7.3	7.3
Chemical Additional (kg)	Chlorine	10	10	Chlorine	10	10
	Soda Ash	10	10	Soda Ash	10	10
	Sodium Bisulphate Acid	10	10	Sodium Bisulphate Acid	10	10
Salt Chlorinator	Ns.1	ON	ON	Ns.1	ON	ON
	Ns.2	ON	ON	Ns.2	ON	ON
	Ns.3	ON	ON	Ns.3	ON	ON
Sump Tank	Water Level (High, Medium, Low)	10	10	Water Level (High, Medium, Low)	10	10
	Operation By	10	10	Operation By	10	10

Remark

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

01/5/17

Description	Morning			Afternoon		
	Ns.1	Ns.2	Ns.3	Ns.1	Ns.2	Ns.3
Pump Operating	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Strainers Cleaning	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Back Wash (10 min)	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Chlorine & PH Test Results (Test kit manual)	CL	7.3	7.3	CL	7.3	7.3
	PH	7.3	7.3	PH	7.3	7.3
Chemical Additional (kg)	Chlorine	10	10	Chlorine	10	10
	Soda Ash	10	10	Soda Ash	10	10
	Sodium Bisulphate Acid	10	10	Sodium Bisulphate Acid	10	10
Salt Chlorinator	Ns.1	ON	ON	Ns.1	ON	ON
	Ns.2	ON	ON	Ns.2	ON	ON
	Ns.3	ON	ON	Ns.3	ON	ON
Sump Tank	Water Level (High, Medium, Low)	10	10	Water Level (High, Medium, Low)	10	10
	Operation By	10	10	Operation By	10	10

Remark

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

01/5/17

Description	Morning			Afternoon		
	Ns.1	Ns.2	Ns.3	Ns.1	Ns.2	Ns.3
Pump Operating	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Strainers Cleaning	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Back Wash (10 min)	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Chlorine & PH Test Results (Test kit manual)	CL	7.3	7.3	CL	7.3	7.3
	PH	7.3	7.3	PH	7.3	7.3
Chemical Additional (kg)	Chlorine	10	10	Chlorine	10	10
	Soda Ash	10	10	Soda Ash	10	10
	Sodium Bisulphate Acid	10	10	Sodium Bisulphate Acid	10	10
Salt Chlorinator	Ns.1	ON	ON	Ns.1	ON	ON
	Ns.2	ON	ON	Ns.2	ON	ON
	Ns.3	ON	ON	Ns.3	ON	ON
Sump Tank	Water Level (High, Medium, Low)	10	10	Water Level (High, Medium, Low)	10	10
	Operation By	10	10	Operation By	10	10

Remark

Chief Engineer

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date

01/5/17

Description	Morning			Afternoon		
	Ns.1	Ns.2	Ns.3	Ns.1	Ns.2	Ns.3
Pump Operating	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Strainers Cleaning	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Back Wash (10 min)	Ns.1	10	10	Ns.1	10	10
	Ns.2	10	10	Ns.2	10	10
	Ns.3	10	10	Ns.3	10	10
Chlorine & PH Test Results (Test kit manual)	CL	7.3	7.3	CL	7.3	7.3
	PH	7.3	7.3	PH	7.3	7.3
Chemical Additional (kg)	Chlorine	10	10	Chlorine	10	10
	Soda Ash	10	10	Soda Ash	10	10
	Sodium Bisulphate Acid	10	10	Sodium Bisulphate Acid	10	10
Salt Chlorinator	Ns.1	ON	ON	Ns.1	ON	ON
	Ns.2	ON	ON	Ns.2	ON	ON
	Ns.3	ON	ON	Ns.3	ON	ON
Sump Tank	Water Level (High, Medium, Low)	10	10	Water Level (High, Medium, Low)	10	10
	Operation By	10	10	Operation By	10	10

Remark

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL
NOMINATED CHIEF ENGINEER

Date: 16/04/2020

Shift: 08:00

Description	Monitoring	Alarm	Status	Remarks
Pump Operating	Nc1 - Nc2 - Nc3 -	ON	ON	
Stand Filter System Pressure	Nc1 1.0 Nc2 1.0 Nc3 -	ON	ON	
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	ON	ON	
Back Wash (10 min)	Nc1 - Nc2 - Nc3 -	ON	ON	
Chlorine & PH Test Results (Test kit manual)	Nc1 1.5 Nc2 7.5 Nc3 -	ON	ON	
Chemical Additional (kg)	Nc1 - Nc2 - Nc3 -	ON	ON	
Salt Chlorinator	Nc1 - Nc2 - Nc3 -	ON	ON	
Water Level (High, Medium, Low)	Nc1 - Nc2 - Nc3 -	ON	ON	
Operation By	H1			

Remark: 16/04/2020

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL
NOMINATED CHIEF ENGINEER

Date: 02-06/2020

Shift: 08:33

Description	Monitoring	Alarm	Status	Remarks
Pump Operating	Nc1 - Nc2 - Nc3 -	ON	ON	
Stand Filter System Pressure	Nc1 - Nc2 - Nc3 -	ON	ON	
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	ON	ON	
Back Wash (10 min)	Nc1 - Nc2 - Nc3 -	ON	ON	
Chlorine & PH Test Results (Test kit manual)	Nc1 1.5 Nc2 7.5 Nc3 -	ON	ON	
Chemical Additional (kg)	Nc1 - Nc2 - Nc3 -	ON	ON	
Salt Chlorinator	Nc1 - Nc2 - Nc3 -	ON	ON	
Water Level (High, Medium, Low)	Nc1 - Nc2 - Nc3 -	ON	ON	
Operation By	H1			

Remark: 02-06/2020

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL
NOMINATED CHIEF ENGINEER

Date: 07/06/2020

Shift: 08:00

Description	Monitoring	Alarm	Status	Remarks
Pump Operating	Nc1 - Nc2 - Nc3 -	ON	ON	
Stand Filter System Pressure	Nc1 1.0 Nc2 1.0 Nc3 -	ON	ON	
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	ON	ON	
Back Wash (10 min)	Nc1 - Nc2 - Nc3 -	ON	ON	
Chlorine & PH Test Results (Test kit manual)	Nc1 1.5 Nc2 7.5 Nc3 -	ON	ON	
Chemical Additional (kg)	Nc1 - Nc2 - Nc3 -	ON	ON	
Salt Chlorinator	Nc1 - Nc2 - Nc3 -	ON	ON	
Water Level (High, Medium, Low)	Nc1 - Nc2 - Nc3 -	ON	ON	
Operation By	H1			

Remark: 07/06/2020

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL
NOMINATED CHIEF ENGINEER

Date: 04/06/2020

Shift: 08:30

Description	Monitoring	Alarm	Status	Remarks
Pump Operating	Nc1 - Nc2 - Nc3 -	ON	ON	
Stand Filter System Pressure	Nc1 - Nc2 - Nc3 -	ON	ON	
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	ON	ON	
Back Wash (10 min)	Nc1 - Nc2 - Nc3 -	ON	ON	
Chlorine & PH Test Results (Test kit manual)	Nc1 1.5 Nc2 7.5 Nc3 -	ON	ON	
Chemical Additional (kg)	Nc1 - Nc2 - Nc3 -	ON	ON	
Salt Chlorinator	Nc1 - Nc2 - Nc3 -	ON	ON	
Water Level (High, Medium, Low)	Nc1 - Nc2 - Nc3 -	ON	ON	
Operation By	H1			

Remark: 04/06/2020

Chief Engineer

Date 05/04/24

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date 05/04/24

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning 08:30			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	-	-	-	-	-
Stand Filter System Pressure	-	-	-	-	-	-
Strainers Cleaning	-	-	-	-	-	-
Back Wash (10 min.)	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	-	-	-	-	-	-
Chemical Additional (kg)	-	-	-	-	-	-
Salt Chlorinator	-	-	-	-	-	-
Stop Task	-	-	-	-	-	-

Remarks

Chief Engineer

Backwash By

Date 08/04/24

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Date 08/04/24

SWIMMING POOL LOG SHEET : DAILY

NOVOTEL

Description	Morning 08:30			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	-	-	-	-	-
Stand Filter System Pressure	-	-	-	-	-	-
Strainers Cleaning	-	-	-	-	-	-
Back Wash (10 min.)	-	-	-	-	-	-
Chlorine & PH Test Results (Test kit manual)	-	-	-	-	-	-
Chemical Additional (kg)	-	-	-	-	-	-
Salt Chlorinator	-	-	-	-	-	-
Stop Task	-	-	-	-	-	-

Remarks

Chief Engineer

Backwash By

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 09-06-17
Night

Description	Morning			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	-	ON	-	-	ON
Sand Filter System Pressure	Nc.1	10	-	Nc.1	10	-
	Nc.2	-	-	Nc.2	10	10
	Nc.3	10	-	Nc.3	-	-
Strainers Cleaning	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Back Wash (10 min.)	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	9.5	CL	1.5	9.5
	PH	-	-	PH	-	-
	Operation By	M.A				
Chemical Additional (kg)	Sodium Bisulphate Acid	-	-	Sodium Bisulphate Acid	-	-
	Salt	-	-	Salt	-	-
	Aluminium sulphate	-	-	Aluminium sulphate	-	-
Salt Chlorinator	Status (On/Off)	-	ON	Status (On/Off)	-	ON
	Volume System Control (Display 0-100)	-	-	Volume System Control (Display 0-100)	-	-
	Nc.2	-	-	Nc.2	-	-
Sump Tank	Water Level (High, Medium, Low)	High	High	Water Level (High, Medium, Low)	High	High
	Operation By	M.A				

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 09-06-17
Night

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 09-06-17
Night

W.2.6-41

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 10/06/17
Night

Description	Morning			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	-	ON	-	-	ON
Sand Filter System Pressure	Nc.1	10	-	Nc.1	10	-
	Nc.2	-	-	Nc.2	10	10
	Nc.3	10	-	Nc.3	-	-
Strainers Cleaning	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Back Wash (10 min.)	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	9.5	CL	1.5	9.5
	PH	-	-	PH	-	-
	Operation By	M.A				
Chemical Additional (kg)	Sodium Bisulphate Acid	-	-	Sodium Bisulphate Acid	-	-
	Salt	-	-	Salt	-	-
	Aluminium sulphate	-	-	Aluminium sulphate	-	-
Salt Chlorinator	Status (On/Off)	-	ON	Status (On/Off)	-	ON
	Volume System Control (Display 0-100)	-	-	Volume System Control (Display 0-100)	-	-
	Nc.2	-	-	Nc.2	-	-
Sump Tank	Water Level (High, Medium, Low)	High	High	Water Level (High, Medium, Low)	High	High
	Operation By	M.A				

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 10/06/17
Night

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 10/06/17
Night

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 10/06/17
Night

Description	Morning			Afternoon		
	Nc.1	Nc.2	Nc.3	Nc.1	Nc.2	Nc.3
Pump Operating	-	-	ON	-	-	ON
Sand Filter System Pressure	Nc.1	10	-	Nc.1	10	-
	Nc.2	-	-	Nc.2	10	10
	Nc.3	10	-	Nc.3	-	-
Strainers Cleaning	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Back Wash (10 min.)	Nc.1	-	-	Nc.1	-	-
	Nc.2	-	-	Nc.2	-	-
	Nc.3	-	-	Nc.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	9.5	CL	1.5	9.5
	PH	-	-	PH	-	-
	Operation By	M.A				
Chemical Additional (kg)	Sodium Bisulphate Acid	-	-	Sodium Bisulphate Acid	-	-
	Salt	-	-	Salt	-	-
	Aluminium sulphate	-	-	Aluminium sulphate	-	-
Salt Chlorinator	Status (On/Off)	-	ON	Status (On/Off)	-	ON
	Volume System Control (Display 0-100)	-	-	Volume System Control (Display 0-100)	-	-
	Nc.2	-	-	Nc.2	-	-
Sump Tank	Water Level (High, Medium, Low)	High	High	Water Level (High, Medium, Low)	High	High
	Operation By	M.A				

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 10/06/17
Night

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date 10/06/17
Night

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 13/6/17 Night: 08:00

Morning: 08:00 Afternoon: 11:00

Description	State (Run, Off)	Pressure Gauge Out (PSI)	Water Level (High, Medium, Low)	Operation By
Pump Operating	Nc1 - Nc2 - Nc3 ON	-	-	-
Stand Filter System Pressure	Nc1 - Nc2 10 Nc3 10	-	-	-
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	-	-	-
Back Wash (10 min.)	Nc1 - Nc2 - Nc3 -	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.6	-	-	-
Chemical Additional (kg)	Soda Ash - Sodium Bisphosphate Acid Salt - Aluminium Sulphate -	-	-	-
Salt Chlorinator	State (On, Off) - Volume System Control (Display 0-100) 45	-	-	-
Surge Tank	Water Level (High, Medium, Low) H1	-	-	-

Remark: 08:00

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 14/6/17 Night: 08:00

Morning: 08:00 Afternoon: 11:00

Description	State (Run, Off)	Pressure Gauge Out (PSI)	Water Level (High, Medium, Low)	Operation By
Pump Operating	Nc1 - Nc2 - Nc3 ON	-	-	-
Stand Filter System Pressure	Nc1 - Nc2 10 Nc3 10	-	-	-
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	-	-	-
Back Wash (10 min.)	Nc1 - Nc2 - Nc3 -	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.6	-	-	-
Chemical Additional (kg)	Soda Ash - Sodium Bisphosphate Acid Salt - Aluminium Sulphate -	-	-	-
Salt Chlorinator	State (On, Off) - Volume System Control (Display 0-100) 45	-	-	-
Surge Tank	Water Level (High, Medium, Low) H1	-	-	-

Remark: 08:00

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 15/6/17 Night: 08:00

Morning: 08:00 Afternoon: 11:00

Description	State (Run, Off)	Pressure Gauge Out (PSI)	Water Level (High, Medium, Low)	Operation By
Pump Operating	Nc1 - Nc2 - Nc3 ON	-	-	-
Stand Filter System Pressure	Nc1 10 Nc2 10 Nc3 10	-	-	-
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	-	-	-
Back Wash (10 min.)	Nc1 - Nc2 - Nc3 -	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.6	-	-	-
Chemical Additional (kg)	Soda Ash - Sodium Bisphosphate Acid Salt - Aluminium Sulphate -	-	-	-
Salt Chlorinator	State (On, Off) - Volume System Control (Display 0-100) 45	-	-	-
Surge Tank	Water Level (High, Medium, Low) H1	-	-	-

Remark: 08:00

Chief Engineer

NOVOTEL
SWIMMING POOL LOG SHEET : DAILY

Date: 16/6/17 Night: 08:00

Morning: 08:00 Afternoon: 11:00

Description	State (Run, Off)	Pressure Gauge Out (PSI)	Water Level (High, Medium, Low)	Operation By
Pump Operating	Nc1 - Nc2 - Nc3 ON	-	-	-
Stand Filter System Pressure	Nc1 10 Nc2 10 Nc3 10	-	-	-
Strainers Cleaning	Nc1 - Nc2 - Nc3 -	-	-	-
Back Wash (10 min.)	Nc1 - Nc2 - Nc3 -	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL 1.5 PH 7.6	-	-	-
Chemical Additional (kg)	Soda Ash - Sodium Bisphosphate Acid Salt - Aluminium Sulphate -	-	-	-
Salt Chlorinator	State (On, Off) - Volume System Control (Display 0-100) 45	-	-	-
Surge Tank	Water Level (High, Medium, Low) H1	-	-	-

Remark: 08:00

Chief Engineer

NOVOTEL
NOVOTEL CHATEAU D'ARCADE

SWIMMING POOL LOG SHEET : DAILY

Date 30/6/67

Description	Morning <u>08:30</u>			Afternoon <u>14:30</u>			Evening <u>19:00</u>		
	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3	Nx1	Nx2	Nx3
Pump Operating	ON	ON	ON	ON	ON	ON	ON	ON	ON
Sand Filter System Pressure	10	10	10	10	10	10	10	10	10
Brine System Cleaning	ON	ON	ON	ON	ON	ON	ON	ON	ON
Back Wash (10 min)	ON	ON	ON	ON	ON	ON	ON	ON	ON
Chlorine & PH Test Results (Test kit manual)	CL	PH	PH	CL	PH	PH	CL	PH	PH
Chemical Addition (kg)	Chlorine	Soda Ash	Sodium Bisulphate	Chlorine	Soda Ash	Sodium Bisulphate	Chlorine	Soda Ash	Sodium Bisulphate
Salt Chlorinator	ON	ON	ON	ON	ON	ON	ON	ON	ON
Water Level [High, Medium, Low]	High	High	High	High	High	High	High	High	High
Operation By	R. DUBOIS								

Remark:

Checked By:

Chief Engineer:

ภาคผนวก 2.7
หลักฐานการจัดให้มีอุปกรณ์ไฟฟ้า
แบบประหยัดพลังงาน

QUOTATION

Date : 10 April 2023
Ref : 0233051237P - G
To : บริษัท ฟิวเจอร์ ฟาเคดไลท์ติ้ง จำกัด
Attn : คุณจก / แผนกช่าง
Email : HB346-le2@accor.com
Project : Novotel Bangkok Futurepark Rangsit - Guestroom

(Spare Part 10% = Tender + Additional)

Type	Description	Qty	Unit Price	Total Price
		Ter.	Barit	Barit
DL100 (all)	Bled DL601A Recessed adjustable downlight matt white color IP20 c/w Philip Master MR16 12V 7.5W 10Deg 2700K led & Remote Vossloh non dim 12V transformer	716	605.00	43,560.00
DL101 (all)	Bled DL601A Recessed adjustable downlight matt white color IP20 c/w Philip MR16 12V 7.5W 36Deg 2700K led & Remote Vossloh non dim 12V transformer	845	605.00	51,425.00
DL102 (all)	Bled DL808 Recessed fixeddownlight matt white color IP20 c/w 6W 36Deg 2700K CR190 & Remote non dim driver	233	625.00	14,375.00
DL103 (all)	Bled DL601A Recessed fixed downlight matt white color IP44 with glass diffuser c/w MR16 7.5W 36Deg 2700K CR190 lamp & Remote Vossloh 12V transformer	226	745.00	17,135.00
LE100 (all)	Bled 2835-180-14-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 14W/m 180leds 2700K CR880 24VDC led	586.5	270.00	15,930.00
LE101 (all)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 24W/m 120leds 2700K CR880 24VDC led	1867	280.00	52,360.00
LE102 (all)	Bled 2835-120-9-6-27-24-9-20 Recessed shelf light IP20 L 900mm with LS809 profile with frosted diffuser c/w 9 6W/m 120leds 2700K CR887 24VDC led	342.5	240.00	8,160.00
W100 (all)	Bled WA35125F Recessed wall light matt white color IP20 c/w 3W 2700K CR180 300mA led & Remote 300mA driver	153	980.00	14,700.00
รวม Power Supply ที่ใช้กับ Strip Light Type LE1xx				
	Remote 24VDC 15W power supply		325.00	
	Remote 24VDC 25W power supply		425.00	
	Remote 24VDC 35W power supply		455.00	
	Remote 24VDC 75W power supply		620.00	
	Remote 24VDC 100W power supply		676.00	
	Remote 24VDC 150W power supply		780.00	
	Remote 24VDC 200W power supply		1,040.00	
Total:				217,645.00
7% VAT:				15,235.15
Grand Total:				232,880.15

Remark : Type LE100, LE101, LE102 รับประกัน Power Supply ให้ลูกค้า
หากว่า วัสดุ อุปกรณ์ไม่พอ ช่างจะเพิ่ม Led Strip ที่ใช้ไม่พอจะ
และ ราคาค่าการเปลี่ยนหลอดจะคิด

QUOTATION

Date : 10 April 2023
Ref : 0233051237P - F
To : บริษัท ฟิวเจอร์ ฟาเคดไลท์ติ้ง จำกัด
Attn : คุณจก / แผนกช่าง
Email : HB346-le2@accor.com
Project : Novotel Future Rangsit - Façade

(Spare Part 10% = Tender + Additional)

Type	Description	Qty	Unit Price	Total Price
		Ter.	Barit	Barit
LE500 (all)	Facade Lime DM1001-AS Surface Linear wall washer LED L1000mm with aluminium extrusion housing IP66 finish in dark grey c/w Lamp 20W 15° x 45° 3000K CR8-80 & Remote 24VDC power supply (Modify bracket center fitting L 200mm)	14	3,780.00	3,780.00
UP500 (all)	Shylon SL2128CC-12 recessed inground uplighter with stainless steel, tempered safety glass protection IP67 + Installation sleeve c/w Lamp LED 32W 3000K 80deg and Integral driver 220V	3	6,485.00	6,485.00
UP502 (all)	Shylon SL1140UF13 Surface Adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 30W 3000K 30Deg. CR8-80 and Integral driver 220V On/Off	14	4,220.00	8,440.00
UP503 (all)	Shylon SL1145FE-1 Surface Adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 10W 3000K 20Deg. CR8-80 and Integral driver 220V On/Off	12	2,915.00	2,915.00
UP504 (all)	Bled SL1145FE-1 Surface adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 10W 3000K 80deg. CR1>80 and Integral driver 220V On/Off	8	2,915.00	2,915.00
UP505 (all)	Shylon SL3220A-3 Surface LED window reveal luminaire with aluminium body glass protection IP67 finish in dark grey c/w Lamp 3W 3000K 2Deg x120Deg CR8-80 and Integral driver 220V On/Off	20	2,270.00	4,540.00
W500 (all)	Lipman LI-30022-T3-W30 Surface Wall mounted LED Asymmetric with aluminium body + glass protection IP65 Finish in Dark Grey color c/w Lamp LED 24-Led37W 3000K CR80-1268mm-4636mm beam angle 135x67Deg and Integral driver 220V on-off	8	11,645.00	11,645.00
W501 (all)	Shylon SL1140UFE-3 Surface Adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 15W 3000K 12Deg. CR8-80 and Integral driver 220V On/Off	2	4,880.00	4,880.00
Sub-Total:				45,600.00
7% VAT:				3,192.00
Total:				48,792.00

Remark : ราคาค่าเปลี่ยนหลอดจะคิดเพิ่มจากค่าวัสดุ
ไม่คิดค่าแรง

Delivery : 6-8 Week from receipt of order confirmation; & or approval of sample(s) / drawing(s) & for confirmation of date of delivery, colour, dimensions, mounting. This excludes 2-4 weeks of summer holiday in Aug/Sept and 1 month year end holiday in December. This advice on delivery is only valid as at the date of this quotation, and is subject to our confirmation at the time of our receipt of your order confirmation.

1) It is valid only as at the date of this quotation. It is subject to our confirmation with the manufacturer upon receipt of official Purchase Order.

QUOTATION

Date : 10 April 2023

Ref : 0233051/23/Ip - C&P












To : บริษัท ฟิวเจอร์ ฟาอุร์ปาร์ก จำกัด

Attn : คุณกร / คุณณัชชา

Email : H3346-1e2@accor.com

Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300

(Spare Part 10% = Tender + Additional)














Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add				
	Corridor #200						
DL200 (all)	Bled DL110.WH Recessed fixed downlight IP20 with honeycomb finish in matt black color c/w 6W 36deg 2700K CRI>90 575lm 220VDC led & Remote non-dim driver	181	63		24	895.00	21,480.00
DL201 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white color c/w Philip MR16 12V 7.5W 240deg 2700K led & Remote non-dim driver	131	14		15	605.00	9,075.00
DL202 (all)	Bled DL110.WH Recessed fixed downlight IP20 with honeycomb finish in matt black color c/w 6W 36deg 3000K CRI>90 575lm 220VDC led & Remote non-dim driver	21	6		3	895.00	2,685.00
LE200(all)	Bled 3528-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 14W/m 980lm 2700K CRI>80 24VDC led	361	242		60	280.00	16,800.00
LE201(all)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 24W/m 1800lm 2700K CRI>80 24VDC led	199			20	280.00	5,600.00
LE202(all)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 24W/m 1800lm 2700K CRI>80 24VDC led	77			8	280.00	2,240.00
	Total : Corridor # 200						57,880.00
	Public Area #300						
DL300 (all)	Bled DL110.WH Recessed fixed downlight IP20 with honeycomb finish in matt white color c/w 6W 36deg 2700K CRI>90 575lm 220VDC led & Remote dali dimming driver	17	3		2	1,275.00	2,550.00
DL301 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Philip MR16 12V 7.5W 100deg 2700K CRP95 485lm led & Remote dali dimming driver	60			6	920.00	5,520.00
DL301SP (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Sorra MR16 CC 7.5W 100deg 2700K CRP95 485lm 12V led & Remote dali dimming driver	13			1	3,075.00	3,075.00
DL302 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim with Spread lens c/w Philip MR16 12V 7.5W 100deg 2700K CRP95 485lm led & Remote dali dimming driver	8			1	920.00	920.00
DL302SP (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim with Snap System 100deg-36deg c/w Sorra MR16 CC 7.5W 100deg 2700K CRP95 485lm 12V led & Remote dali dimming driver	4			1	3,715.00	3,715.00

Date : 10 April 2023













Ref : 0233051/23/Ip - C&P

To : บริษัท ฟิวเจอร์ ฟาอุร์ปาร์ก จำกัด









Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add				
DL303 (all)	Bled DL110.BK Recessed fixed downlight IP20 with honeycomb finish in matt black color c/w 6W 100deg 2700K CRI>90 575lm 220VDC led & Remote dali dimming driver	8			1	1,275.00	1,275.00
DL304 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Philip MR16 12V 7.5W 36Deg 2700K CRP95 515lm led & Remote dali dimming driver (175 - 175ps Exclusive Lounge finish in matt black trim)	156			16	920.00	14,720.00
DL304 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt black trim c/w Philip MR16 12V 7.5W 36Deg 2700K CRP95 515lm led & Remote dali dimming driver (Exclusive Lounge)	19			2	920.00	1,840.00
DL304S (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Philip MR16 12V 7.5W 36Deg 2700K CRP95 515lm led & Remote 12VAC non-dim transformer	131	1		13	650.00	8,450.00
DL305 (all)	Bled DL401 Recessed adjustable downlight IP44 with glass diffuser finish in matt white color c/w Philip MR16 12V 7.5W 36Deg 2700K CRP95 515lm led & Remote dali dimming driver	56	2		6	1,060.00	6,360.00
DL306 (all)	Bled Value 125 206x41 Recessed fixed downlight IP44 with glass diffuser finish in matt white color c/w 25W 1760lm 360deg CRP90 2700K led & Remote dali dimming driver	169	33		20	1,730.00	34,600.00
DL304B (all)	Bled Value 125 206x41 Recessed fixed downlight IP44 with glass diffuser finish in matt black color c/w 25W 1760lm 360deg CRP90 2700K led & Remote dali dimming driver	13			1	1,730.00	1,730.00
DL307 (all)	Kozumi DD091-2820MM9027 Recessed downlight finish in matt white color c/w 28W 1836lm 20Deg 2700K CRP90 led & Remote dali dimming driver	25	4		3	3,380.00	10,140.00
DL307B (all)	Kozumi DD091-2820MM9027 Recessed downlight finish in matt black color c/w 28W 1836lm 20Deg 2700K CRP90 led & Remote dali dimming driver	7			1	3,380.00	3,380.00
DL308 (all)	Tenda CLECI2R-B2715 Surface mounted spotlight with snoot aluminium body IP20 finish in matt black color c/w 12W 15x40deg 1080lm 2700K CRI>90 led & Remote 48VDC 100W driver & Dali dimming driver	12			1	1,480.00	1,480.00
DL309 (all)	Bled AM- mini-D1 Recessed adjustable downlight c/w 2W 30Deg 2700K CRP90 led & Remote 500mA non-dim driver	23			2	700.00	1,400.00
DL310 (all)	Bled KS3124 Surface Spotlight LED bled mount adjustable with aluminium body finish in matt white color c/w lamp LED COB 12W 2700K 700lm 15Deg & Remote non-dim driver	11			1	1,035.00	1,035.00
DL311 (all)	Bled WCG6 122W Recessed adjustable downlight IP44 with glass diffuser finish in matt white color c/w 10W 24Deg 2700K CRI>90 led & Remote dali dimming driver	5			1	1,385.00	1,385.00

Date : 10 April 2023
Ref : Q233051231P - C&P
To : บริษัท ฟิวเจอร์ ปาร์ค จำกัด
Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add				
DL312 (all)	Acme Focus-B Recess adjustable downlight IP20 aluminium body finish in matt black color with honey comb c/w 12W 700lm 16Deg 2700K CRI80 led & Remote dali dimming driver	14			1	2,700.00	2,700.00
DL313 (all)	Acme Focus-B Recess adjustable downlight IP20 aluminium body finish in matt black color with honey comb c/w 12W 670lm 25Deg 2700K CRI80 led & Remote dali dimming driver	14			1	2,700.00	2,700.00
DL314 (all)	Acme Focus-B Recess adjustable downlight IP20 aluminium body finish in matt black color with honey comb & frosted sticker c/w 12W 640lm 36Deg 2700K CRI80 led & Remote dali dimming driver	3			1	2,950.00	2,950.00
DL315 (all)	Aris CAC2M Surface mounted spotlight downlight aluminium body IP20 finish in Black color c/w Lamp Philips Master MR16 7W 10Deg 3000K CRI>90 12V	7			1	4,515.00	4,515.00
DL316 (all)	Bled W68-005 Surface mounted spotlight downlight aluminium body IP20 with clear glass finish in Black color c/w Lamp Philips Master MR16 7W 10Deg 3000K CRI90 12V	1			1	2,500.00	2,500.00
LE300 (all)	Bled 2835-120-9-6-27-24-9-20 Recessed shell light IP20 1900mm with LS809 profile c/w 9.6W/m 120leds 2700K CRI87 24VDC led	94.8	1.5		10	240.00	2,400.00
LE301 (all)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 profile with frosted diffuser c/w 24W/m 120leds 2700K CRI80 24VDC led	923			92	280.00	25,760.00
LE303 (all)	Bled 2216-120-9-6-27-24-20-9 Flexible led strip IP20 with LS049 aluminium profile with frosted diffuser c/w 9.6W/m 650lm 24VDC 2700K (Reception กระจกห้อง 5cm & Area ลิ้นชัก กระจก LS049)	139	2.5		14	240.00	3,360.00
LE303A (all)	Bled 2216-120-14-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 14.4W/m 980lm 2700K CRI>80 24VDC led	216			22	270.00	5,940.00
LE303B (all)	Bled 2216-60-4-8-27-24-20 Flexible led strip IP20 mounted on L048 aluminium profile with frosted diffuser c/w 4.8W/m 360lm 24VDC 2700K	16.4			2	215.00	430.00
LE304 (all)	Line Decomint DM-1000AC Surface mounted linear uplighter IP20 finish in matt TBA color c/w 30W 2700K 15x35deg 24VDC led	6			1	3,780.00	3,780.00
	Remote 24VDC 150W power supply	2			1	780.00	780.00
	Remote SR-2302B Dali Interface dim	2			1	1,000.00	1,000.00
S300 (all)	Bled KT-3321 Track mounted spotlight IP20 finish in matt white color c/w 25W 24Deg 2200m 2700K led & Remote dali dimming driver	120			12	2,215.00	26,580.00











Date : 10 April 2023
Ref : Q233051231P - C&P
To : บริษัท ฟิวเจอร์ ปาร์ค จำกัด
Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add				
S302 (all)	Tenda MP-S108-WG30 Track spotlight finish in matt black color c/w 8W 38Deg 48VDC 640lm 2700K CRI>90 led & Remote dali dimming driver	4			1	2,310.00	2,310.00
S303 (all)	Tenda MP-S108-WG30 Track spotlight finish in matt black color c/w 8W 15Deg 48VDC 640lm 2700K CRI>90 led & Remote dali dimming driver	30			3	2,310.00	6,930.00
T300 (all)	Tenda Mpower MP-SUR-TRI08 Rod surface mounted track IP20 with suspension MP-KIT-SUS01 finish in matt black color หมายเหตุ Tender 4M (ใช้จริง=12M, สั่งเพิ่ม 30.2-20M, ลด=12M)	12			1	3,970.00	3,970.00
T301 (all)	Powergear Recessed track 3-Circuit finish white with L7000mm (Ballroom ใหญ่ 3 ห้อง = 12Set)	12			1	4,765.00	4,765.00
	Powergear Rod surface mounted track 3-Circuit finish white with L7000mm (Ballroom เล็ก 2 ห้อง = 8Set)	8			1	4,765.00	4,765.00
	Remark 1 Set = Track 3 Circuit 2Mx3 + 1Mx3 + Live-end 1 + Joint 3 + End cap 1 1 Room = 4Set ; (Total 5 Room = 20 Set)						
T302	Tenda SU-MT100 Rod surface mounted magnetic track with SUS-MTCON suspended kit with PCB-CON50 PCB connector and SU-MTAC end cap finish in matt black color หมายเหตุ Tender 12M (ใช้จริง=32M, โยชน์มาจาก T300=20M)	12	20		3	5,150.00	15,450.00
UP300 (all)	Bled CO29-01A Recessed inground uplight with Stainless Steel body and tempered glass protection IP67 finish in Stainless Steel color c/w 2.6W CRI90 2700K 150deg 24VDC led	17			2	1,190.00	2,380.00
W300 (all)	Bled Karen PX-1900-CRI Surface wall light IP44 aluminium body finish in Gold color c/w Philip Master GU10 5W 395lm 36Deg 3000K CRI>90 220V led	7			1	1,190.00	1,190.00
Total : Public Area #300							230,730.00
รายการ Power Supply ที่ใช้กับ Spotlight Type LE2xx-LE3xx							
	Remote 24VDC 15W power supply					325.00	
	Remote 24VDC 25W power supply					425.00	
	Remote 24VDC 35W power supply					455.00	
	Remote 24VDC 75W power supply					620.00	
	Remote 24VDC 100W power supply					676.00	
	Remote 24VDC 150W power supply					780.00	
	Remote 24VDC 200W power supply					1,040.00	
Remark : Type UP300 ใช้ร่วมกับ Power Supply, เนื่องจากขนาด Wall ของหลอดไฟ ที่ใช้กับระบบ Led Strip ที่ใช้บนแต่ละจุด และ รางติดตั้งหลอดไฟบนแต่ละจุด							Total : 288,610.00 7% VAT : 20,202.70
Grand Total :							308,812.70











QUOTATION

Date : 10 April 2023
Ref : Q23305123Tp - L&S
To : บริษัท ฟิวเจอร์ แลนด์สเคป จำกัด
Attn : คุณเอก / คุณนันทนา
Email : Hb346-1e2@aor.com
Project : Novotel Future Rangsit Landscape - Landscape & Swimming Pool




(Spare Part 10% = Tender + Additional)

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add Total				
B400 (alt)	Landscape & Swimming Pool Ligman AB-10001-W30-ND-01 Surface bollard Asymmetric 26x75x320cm with aluminum housing glass diffuser protection IP65 finish in TBA color c/w Led 11W 3000K 10270deg 765lm CRI80 (Ground Floor & Spirit House)	12	12		1	13,670.00	13,670.00
DL400	Neko SSR5-9303513F-B-54 Recessed trimless fixed downlight LED with aluminum body cover diffuser IP54 finish in matt black color c/w Lamp LED COB 13W 3000K 900lm 350deg 350mA and Remote Driver Nondim (Swimming Pool)	10	10		1	1,740.00	1,740.00
DL401 (alt)	Bled BernerS 30225-1SD Spotlight LED COB with aluminum body and glass protection IP65 with honeycomb + tree strap finish in matt black color c/w Lamp LED Cree COB 10W 631lm 3000K 150deg. Intergal Driver input 220V (Ground Floor)	11	11		1	2,275.00	2,275.00
DL402 (alt)	Bled LEGO-OUT-3 (6-Head) Recessed mini Linear LED with aluminum body cover glass protection IP65 finish in matt black color c/w Lamp 10W 36Deg. 2700K and Remote Driver 500mA Non-dim (Ground Floor)	29	29		3	3,780.00	11,340.00
DL402A (alt)	Bled LM-L291-27-100-N Recessed mini Linear LED L 291mm IP65 aluminum body and cover glassfinish in matt black color c/w Lamp 20W 1600lm 100deg 2700K led and Remote Driver Non-dim (Ground Floor)	30	30		3	5,250.00	15,750.00
DL403 (alt)	Bled LM-L291-27-36D-N Recessed mini Linear LED L 291mm IP65 aluminum body and cover glassfinish in matt black color c/w Lamp 20W 1700lm 36Deg 2700K led and Remote Driver Non-dim (Ground Floor)	3	3		1	5,250.00	5,250.00
LE-400 (alt)	KPG C4TL0657 Recessed Linear Underwater LED L 250mm. with stainless steel 316 body & protection glass IP68 + Mounting Sleeve ABS 039# c/w Lamp 6x2W 3000K 45°735° CRI>85 12Vdc (Ground Floor)	3	3		1	8,125.00	8,125.00
LE-401 (alt)	Remote power supply LPV60-12Vdc IP67 Bled LY-NS-T1212-W27 Flexible neon light IP67 with aluminium profile c/w 10Wlm 484lm 2700K CRI>80 24VDC led (Ground Floor - Pizza Kitchen and Terrace & Swimming Pool)	1	1		1	600.00	600.00
LE-402 (alt)	Lime DM1001-AS Surface Linear wall washer LED L1000mm. with aluminium extrusion housing IP66 finish in dark grey color c/w Lamp 20W 15° x 45° 3000K CRI>80 (Modify bracket center fitting L100mm) (Ground Floor) Remote power supply LRS200-24Vdc	38	78.2		8	806.00	6,448.00
LE-403 (alt)	SP Conour Cont V LM10 Flexible vertical bending IP67 with CONT V LM10 SS PROFILE 1M c/w 12W 2700K 900lm 24VDC led (Ground Floor)	5	4		1	1,040.00	1,040.00
						3,240.00	3,240.00

Date : 10 April 2023
Ref : Q23305123Tp - L&S
To : บริษัท ฟิวเจอร์ แลนด์สเคป จำกัด
Project : Novotel Future Rangsit Landscape - Landscape & Swimming Pool

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add Total				
P400 (alt)	Stylon SL1137LFE-6 Pole Top Luminaire Adjustable Surface mounted led spotlight IP67 aluminium body with pole custom L 4000 finish in dark grey color c/w lamp 30w 10 x 70deg 3000K & intergal driver input 220V (Ground Floor)	30	30		3	17,685.00	53,855.00
UP400 (alt)	Bled SL1240S-1 Surface spotlight IP66 aluminium housing with protection tempered glass cover finish in matt black color c/w LED 1x10W Cree 3000K 300deg (Ground Floor & Swimming Pool) Remote Power Supply LPV20-24Vdc IP67	100	100		10	1,750.00	17,500.00
UP402 (alt)	Bled RB-IO23 Recessed inground uplighter with Honeycomb louver + housing box IP67 c/w 9W 150deg 3000K 24Vdc led (Ground Floor - Pizza Kitchen and Terrace & Swimming Pool) Remote power supply LPV35-24Vdc IP67	9	9		1	1,945.00	1,945.00
UP403 (alt)	UL-25-W-COB-2500-EH Recessed inground uplight with stainless steel and protection glass protection IP67 with box housing c/w Cree COB 25W 2700K 110deg input 220V (Ground Floor)	2	2		1	535.00	535.00
UP404 (alt)	Bled-LOE051/H5 Recessed inground uplight LED with aluminium housing and stainless steel trim cover clear glass protection IP67 c/w Lamp LED Cree 1x3W 2700K 150deg 700mA and remote driver 700mA Nordinm (Spirit House)	1	1		1	1,875.00	1,875.00
UP405 (alt)	Bled 30257 mini Spotlight LED with aluminium housing and cover glass protection finish in matt white c/w Lamp Cree 3W 3000K 100deg 19lm and Remote driver (Spirit House)	10	10		1	2,250.00	2,250.00
W400 (alt)	Bled EL4024 Surface wall mounted with aluminium body IP65 finish in white color c/w Lamp Led 6W 3000K 120Deg led & intergal driver Input 220V (Ground Floor)	2	2		1	2,160.00	2,160.00
W400 (alt)	Bled EL4024 Surface wall mounted with aluminium body IP65 finish in dark grey color c/w Lamp Led 6W 3000K 120Deg led & intergal driver Input 220V (Swimming Pool) F4301000 Box for installation	8	8		1	2,160.00	2,160.00
Accessories		8	8		1	520.00	520.00
W401	Bled LY-NS-T1212-W27 flexible neon light IP67 with aluminium profile c/w 10Wlm 484lm 2700K CRI>80 24VDC led (Swimming Pool)	28	28		3	696.00	2,888.00
W402 (alt)	Bled EL4008 Surface wall mounted down LED with aluminium body and glass protection IP65 finish in matt white color c/w lamp 9W Wide Flood 3000K and intergal driver 220V (Ground Floor)	8	8		1	1,945.00	1,945.00

Date : 10 April 2023
Def : Q23305123Tp- L&S
To : บริษัท ฟิวเจอร์ ดีเวลลอปเม้นท์ จำกัด
Project : Novotel Future Rangsit Landscape - Landscape & Swimming Pool

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add				
DL600 (alt)	Neko Takeo TT-13405008F-WW Recessed downlight Fixed with aluminum body and white reflector finish in matt white color c/w Lamp LED 9W 3000K 50Deg and Remote driver non dim (Guard House)	10	10		1	970.00	970.00
DL600S (alt)	Bled Bic 3022 YXX-630CX-012-036 Surface Fixed downlight LED with aluminum body cover glass protection IP32 finish in white color c/w Lamp COB 12W 3000K 36Deg 880lm CRI80 & Integral Driver Input 220V (Guard House)	4	4		1	3,375.00	3,375.00
W600 (alt)	Bled EL400S Surface wall mounted down LED with aluminum body and glass protection IP65 finish in matt white color c/w lamp 9W Wide Flood 3000K and Integral driver 220V (Guard House)	4	4		1	1,945.00	1,945.00
รวม Power Supply สำหรับ Striplight Type LE4xx, W4xx							
	Remote 24VDC 15W power supply					325.00	
	Remote 24VDC 25W power supply					425.00	
	Remote 24VDC 35W power supply					455.00	
	Remote 24VDC 75W power supply					620.00	
	Remote 24VDC 100W power supply					676.00	
	Remote 24VDC 150W power supply					780.00	
	Remote 24VDC 200W power supply					1,040.00	
						Total :	189,311.00
Remark :						7% VAT:	13,251.77
: Type LE401 , LE403 , W401 ระบุรุ่น Power Supply ให้ตรงกับ Watt ของหลอดไฟ และระบุ Led Strip ที่ใช้บนแต่ละจุด และ ระบุการติดตั้งบนหลอดไฟ						Total:	202,562.77

- **6-8 Week** from receipt of order confirmation; & or approval of sample(s) / drawing(s); & or confirmation of date of delivery, colour, dimensions, mounting. This excludes 2-4 weeks of summer holiday in Aug/Sept and 1 month year end holiday in December. This advice on delivery is only valid as at the date of this quotation, and is subject to our confirmation at the time of your receipt of your order confirmation.

- 1) It is valid only as at the date of this quotation. It is subject to our confirmation with the manufacturer upon receipt of official Purchase Order.
 - 2) It is valid only from the date we receive all your approval(s) on design & drawing(s), confirmation of colour of fitting(s)/lamp(s), date(s) of delivery, and other information necessary to process your order.
- Delivery within Bangkok, ground floor only.

- 50% Deposit to be paid upon your order confirmation, via Telegraphic Transfer (T/T) to our Bangkok Bank Public Company LTD bank account. (as shown below) Balance 50% upon complete delivery, via T/T to our Bangkok Bank Public Company LTD LTD bank account. All bank charges outside our Bangkok bank to be borne by you, the applicant.

Bank Name : BANGKOK BANK PUBLIC COMPANY LIMITED
Bank Address : 333 SILOM ROAD, BANGRAK BANGKOK 10500

Bank Tel. : +66 22314333

Account Name: BEST ARCHITECTURAL LIGHTING CO., LTD

Account No. : 175-3-07081-0 (THB - A/C)

Swift Code : BKK BTHBK

***Please take note that "ALL BANK CHARGES OUTSIDE BANGKOK BANK PUBLIC COMPANY LIMITED, TO BE BORNE BY APPLICANT".**



Teera-Mongkol Industry Public Co., Ltd
66/67-69 Moo.3 Lieb Khlong Si Wa Pha Sawat Road,
Khok Krabue, Muang Samut Sakhon
TH - 74000 Samut Sakhon

Invoice address
Pipat Development Co.,Ltd. (Branch 00001)
Novotel Bangkok Future Park Rangsit
VAT registration number: 0105562188928
14 Pathayothin Road, Prachathipat, Thanyaburi
Th - 12130 Pathumthani

Purchase Order	
Order Number	32572172391401RGEQFE #020516
Order date	05.07.2023 10:10:00
Date of delivery	06.07.2023
Currency	Thai baht
Confirmed	-
Delivery address Novole Bangkok Future Park Rangsit Call 02-5202525 EXT 1708-1709 114 Phachayohin Road, Phachathipai, Thanyaburi TH - 12130 - Pathumthani Property Operation & Maintenance	

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (packaging units)	Total
1	Light bulb, LED, dimmable, vintage, G45, 4W, E27, 2700K (21 - Property Operation & Maintenance) For Pedro project. APR32572319279823_3	TEERAQ41	1 piece/unit / piece/unit	75.00 7%	35,000	2'625.00 2'808.75
2	Light bulb, LED, dimmable, vintage, S164, 4W, E27, 2700K (21 - Property Operation & Maintenance) For Pedro project. APR32572319279823_3	TEERAQ43	1 piece/unit / piece/unit	110.00 7%	12,000	1'320.00 1'412.40
3	Light bulb, LED, vintage, G95, 6W, E27, 2700K (21 - Property Operation & Maintenance) For Pedro project. APR32572319279823_3	TEERAQ42	1 piece/unit / piece/unit	180.00 7%	3,000	540.00 577.80

Total value of order	Net amount	4'485.00
	Tax	313.95
	THB	
	Gross Amount	4'798.95

Delivery information	-
Terms of delivery	-
Terms of payment	-
Digitally authorized by	GM - Piara Yues VIOU FC - Kemate Chirapook Purchasing Assistant Mgr - Hanuehai Inramana Chief Engineer - Wattana Juphan
Contact Buyer	Purchasing Assistant Mgr - Hanuehai Inramana 025202525 HB346-PU2@accor.com HB346-CL@accor.com Client number: 325721 Tax registration number: 010562188928
Contact Supplier	K. Kung +66 2 877 9510 12 adminb2c@thaiballast.com; nongdayada@gmail.com
Terms and conditions	Tax registration number: 0107552000189

HomePro (Future Park Rungsi) Branch 000133 126 phahonyothin road, prachathipat, thanyaburi TH - 12130 PATHUM THANI
--

Purchase Order
Order Number 32572198551934RFWEWE #020081
Order date 23.06.2023 09:04:00
Date of delivery 24.06.2023
Currency Thai baht

Invoice address Pipat Development Co.,Ltd. (Branch 00001) Novotel Bangkok Future Park Rangsit VAT registration number: 0105562188928 114 Pahonyothin Road, Prachathipat, Thanyaburi TH - 12130 Pathumthani
--

Delivery address Novotel Bangkok Future Park Rangsit Call 02-5202525 EXT 1708-1709 114 Pahonyothin Road, Prachathipat, Thanyaburi TH - 12130 - Pathumthani Property Operation & Maintenance

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (packaging units)	Total
1	LED Light bulb, PHILIPS, cool daylight, 12W, E27 (21 - Property Operation & Maintenance) For public area APP325272318384533_3	99-452144	1 piece/unit / piece/unit	154.21 7%	3,000	462.62 495.00

Total value of order	THB	Net amount 462.62	Tax 32.38	Gross Amount 495.00
-----------------------------	------------	-----------------------------	---------------------	-------------------------------

Delivery information	-
Terms of delivery	
Terms of payment	
Digitally authorized by	GM - Pierre-Yves VIOU FC - Konate Charoensook Purchasing Assistant Mgr. - Haruethai Intrama Chief Engineer - Wattana Juphan
Contact Buyer	Purchasing Assistant Mgr. - Haruethai Intrama 025202525 HB346-PU2@accor.com HB346-GL@accor.com Client number: Tax registration number: 0105562188928
Contact Supplier	
Terms and conditions	Tax registration number: 0107544000043

Kranes Co., Ltd (Head Office)
324/9,11 Bangna Residence Tower, 1st Floor,
Sanphawut Road, Bangna Nua, Bangna
TH - 10260 Bangkok

Purchase Order	
Order Number	32572119347301REZMRW #018934
Order date	26.05.2023 14:44:00
Date of delivery	31.05.2023
Currency	Thai baht
Confirmed	-

Invoice address
Pipat Development Co.,Ltd. (Branch 00001)
Novotel Bangkok Future Park Rangsit
VAT registration number: 010556218928
T14 Panyothin Road, Prachathipat, Thanyaburi
TH - 12130 Pathumthani
Property Operation & Maintenance

Delivery address
Novotel Bangkok Future Park Rangsit
Call 02-5202525 EXT 1708-1709
T14 Panyothin Road, Prachathipat, Thanyaburi
TH - 12130 - Pathumthani
Property Operation & Maintenance

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (packaging units)	Total
1	Light, panel, LED, Panel48, 48W, 6500K, 60x60cm (21 - Property Operation & Maintenance) Lighting for back office. APP32572315901863_3	Kranes1369	1 piece/unit / piece/unit	1020.00 7%	4.000	4'080.00 4'365.60

Total value of order		THB	Net amount	Tax	Gross Amount
			4'080.00	285.60	4'365.60

Delivery information	-
Terms of delivery	2 days after receive PO
Terms of payment	Credit 30 days/ For new customer and upcountry by cash only
Digitally authorized by	GM - Pierre-Yves VIOU FC - Konate Charoensook Purchasing Assistant Mgr. - Haruethai Intrama Chief Engineer - Wattana Juiphan
Contact Buyer	Purchasing Assistant Mgr. - Haruethai Intrama 025202525 HB346-PU2@accor.com HB346-GL@accor.com Client number: 325721 Tax registration number: 010556218928
Contact Supplier	Khun Sudarat Payngam +66 2 744 8457 sales@kranes-tools.com Tax registration number: 0105547161097
Terms and conditions	-

Lighting & Equipment PL Co., Ltd.
TH - 10400 Bangkok

Purchase Order	
Order Number	3257219959491REZDPE #018908
Order date	26.05.2023 08:12:00
Date of delivery	27.05.2023
Currency	Thai baht

Invoice address
Pipat Development Co.,Ltd. (Branch 00001)
Novotel Bangkok Future Park Rangsit
VAT registration number: 010556218928
T14 Panyothin Road, Prachathipat, Thanyaburi
TH - 12130 Pathumthani
Property Operation & Maintenance

Delivery address
Novotel Bangkok Future Park Rangsit
Call 02-5202525 EXT 1708-1709
T14 Panyothin Road, Prachathipat, Thanyaburi
TH - 12130 - Pathumthani
Property Operation & Maintenance

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (packaging units)	Total
1	Light Bulb, LED ST64 FIM 5W WW E27 DIM L&E (21 - Property Operation & Maintenance) For spare parts of lights in front of Meeting room and Public area. APP32572316087079_3	99-669616	1 piece/unit / piece/unit	112.15 7%	10.000	1'121.50 1'200.01

Total value of order		THB	Net amount	Tax	Gross Amount
			1'121.50	78.51	1'200.01

Delivery information	-
Terms of delivery	
Terms of payment	
Digitally authorized by	GM - Pierre-Yves VIOU FC - Konate Charoensook Purchasing Assistant Mgr. - Haruethai Intrama Chief Engineer - Wattana Juiphan
Contact Buyer	Purchasing Assistant Mgr. - Haruethai Intrama 025202525 HB346-PU2@accor.com HB346-GL@accor.com Client number: Tax registration number: 010556218928
Contact Supplier	02-2488133 Tax registration number:
Terms and conditions	-

ภาคผนวก 2.8
หลักฐานการจัดให้มีการดูแลระบบปรับอากาศ
ภายในโครงการ

Cleaning Filter In Guest Room Q2

Floor 3			Floor 4			Floor 5			Floor 6			Floor 7			Floor 8			Floor 9			Floor 10			Floor 11		
307	KGB		401	KGB	9-Apr-24	501	KGB		601	KGB		701	KGB		801	KGB	9-Apr-24	901	KGB		1001	KGB	21-May-24	1101	KGB	24-Apr-24
	KGB																									
308	TWB		402	TWB	4-May-24	502	TWB	15-May-24	602	TWB	10-Apr-24	702	TWB		802	TWB	9-Apr-24	902	TWB		1002	TWB	15-May-24	1102	TWB	24-Apr-24
309	KGE		403	KGB		503	KGB	20-Apr-24	603	KGB		703	KGB		803	KGB	1-May-24	903	KGB		1003	KGB		1103	KGB	
310	KGE		404	TWB		504	TWB	20-Apr-24	604	TWB	20-Apr-24	704	TWB	9-Apr-24	804	TWB		904	TWB		1004	TWB	9-Apr-24	1104	TWB	13-May-24
311	TWB	14-May-24	405	KGB	22-Apr-24	505	KGB		605	KGB		705	KGB		805	KGB		905	KGB	21-May-24	1005	KGB		1105	KGB	
312	KGB		406	TWB	20-May-24	506	TWB	15-May-24	606	TWB	14-May-24	706	TWB		806	TWB		906	TWB	13-May-24	1006	TWB	9-Apr-24	1106	TWB	15-May-24
314	TWB		407	KGB	22-Apr-24	507	KGB	9-Apr-24	607	KGB		707	KGB		807	KGB	9-Apr-24	907	KGB		1007	KGB		1107	KGB	20-May-24
315	KGB	22-Apr-24	408	TWB	4-May-24	508	TWB	10-Apr-24	608	TWB	23-May-24	708	TWB	20-May-24	808	TWB	9-Apr-24	908	TWB	13-May-24	1008	TWB	15-May-24	1108	TWB	23-May-24
316	TWB	15-May-24	409	KGE	2-May-24	509	KGE	9-Apr-24	609	KGE		709	KGE		809	KGE		909	KGE	13-May-24	1009	KGE		1109	KGE	
317	KGB	19-Apr-24	410	KGE	2-May-24	510	KGE	21-May-24	610	KGE	8-May-24	710	KGE		810	KGE		910	KGE	13-May-24	1010	KGE	8-May-24	1110	KGE	
318	TWB	2-May-24	411	TWB	13-May-24	511	TWB	15-May-24	611	TWB		711	TWB		811	TWB		911	TWB	13-May-24	1011	TWB	15-May-24	1111	TWB	
319	TWB		412	TWB	13-May-24	512	TWB	9-Apr-24	612	TWB		712	TWB		812	TWB		912	TWB		1012	TWB		1112	TWB	
320	TWB	9-Apr-24	414	TWB	13-May-24	514	TWB		614	TWB	10-Apr-24	714	TWB		814	TWB		914	TWB		1014	TWB		1114	TWB	23-May-24
321	STDO		415	TWB	13-May-24	515	TWB		615	TWB		715	TWB		815	TWB	21-May-24	915	TWB	18-Apr-24	1015	TWB		1115	TWB	
322	TWB	22-Apr-24	416	TWB	13-May-24	516	TWB		616	TWB		716	TWB	1-May-24	816	TWB		916	TWB		1016	TWB		1116	TWB	8-May-24
323**	STDO	9-Apr-24	417	TWB	18-May-24	517	TWB	15-May-24	617	TWB		717	TWB		817	TWB	16-May-24	917	TWB	18-Apr-24	1017	TWB		1117	TWB	
324	TWB	15-May-24	418	TWB	5-May-24	518	TWB		618	TWB	23-May-24	718	TWB		818	TWB		918	TWB	18-Apr-24	1018	TWB	15-May-24	1118	TWB	
325	STDO	3-May-24	419	TWB	13-May-24	519	TWB	14-May-24	619	TWB		719	TWB		819	TWB	24-May-24	919	TWB		1019	TWB	15-May-24	1119	TWB	23-May-24
326	KGB		420	TWB		520	TWB	15-May-24	620	TWB		720	TWB	8-May-24	820	TWB	14-May-24	920	TWB	7-May-24	1020	TWB	21-May-24	1120	TWB	
327	TWA	9-Apr-24	421	KGB		521	KGB	9-Apr-24	621	KGB		721	KGB	23-May-24	821	KGB		921	KGB		1021	KGB	19-Apr-24	1121	KGB	
328	KGA	3-May-24	422	TWB		522	TWB	2-May-24	622	TWB		722	TWB	10-Apr-24	822	TWB		922	TWB	24-Apr-24	1022	TWB	19-Apr-24	1122	TWB	
Total		12	423	KGB	13-May-24	523	KGB	9-Apr-24	623	KGB	23-May-24	723	KGB		823	KGB		923	KGB	18-Apr-24	1023	KGB	21-May-24	1127	KGB	
			424	TWB	10-Apr-24	524	TWB		624	TWB		724	TWB	14-Apr-24	824	TWB		924	TWB	21-May-24	1024	TWB	8-May-24	1128	TWB	
Update on 24/05/2024			425	SKA	18-May-24	525	SKA		625	SKA		725	SKA		825	SKA		925	SKA	16-May-24	1025	SKA	8-May-24	Total		9
			427**	TWA	23-Apr-24	527	TWA		627	TWA	8-May-24	727	TWA	23-May-24	827	TWA		927	TWA	20-May-24	1027	TWA	1-May-24			
			428**	KGA	23-Apr-24	528	KGA		628	KGA		728	KGA		828	KGA		928	KGA	24-Apr-24	1028	KGA		DONE		116
			Total		21	Total		16	Total		9	Total		8	Total		9	Total		16	Total		16	Room Remain		110

ภาคผนวก 2.9
ข้อกำหนดและข้อปฏิบัติของผู้พักอาศัย
ภายในโครงการ

NOVOTEL



précautions
COVID—19

Welcome

Your health and safety is our priority. We've established **very strict cleaning protocol** across our hotels and particular care is taken when **cleaning and disinfecting guest rooms**.

If for any reason you feel unwell during your stay, please remain in your room and contact reception.

Our breakfast hours and food and drinks menus are available in your room.

Before you leave, please help us maintain sanitary measures by:


- putting all of your waste in the bin,
- putting your used towels in either the sink, the shower cubicle or bathtub,
- leaving the window open.

Please remember to maintain social distancing while you're in the hotel for the sake of your health and the safety of our staff and guests.


Thank you. We hope you enjoy your stay with us.



Avoid touching surfaces
as much as possible.



To contain the virus, please
keep at least 1.5 meters
from other people.



Only one person per lift
at a time, please.



Please drop your room
key-card in the box
by reception when
you check out.



Please pay by credit card.


Thank you.





NOVOTEL BANGKOK FUTURE PARK RANGSIT
HOTEL INFORMATION

Please note that TV screen damages
are chargeable up to THB 20,000

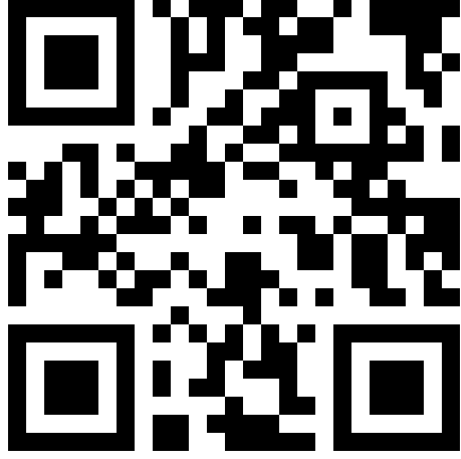

NOVOTEL BANGKOK FUTURE PARK RANGSIT
HOTEL INFORMATION

Please note that TV screen damages
are chargeable up to THB 20,000



Safety Box instruction

Locking the safety box

- Close the safety box's door.
- Key in personal 4-6 digit numbers, eg. 123456.
- Press the "LOCK" button.
- Safety box display will show "LOCK" once it is locked successfully.

Opening the safety box

- Key in the same personal digits numbers, eg. 123456.
- Safety box will open accordingly.

Safety Box instruction

Locking the safety box

- Close the safety box's door.
- Key in personal 4-6 digit numbers, eg. 123456.
- Press the "LOCK" button.
- Safety box display will show "LOCK" once it is locked successfully.

Opening the safety box

- Key in the same personal digits numbers, eg. 123456.
- Safety box will open accordingly.

NOVOTEL

WELCOME TO NOVOTEL BANGKOK FUTURE PARK RANGSIT

1) THE HOTEL WILL BE HELD RESPONSIBLE FOR A LOSS OR DAMAGE OF GUEST'S PROPERTY AS FOLLOWING;

1.1 The loss or damage occurs in the hotel.

1.2 *Should the lost or damaged property following article 1.1 is cash, gold, bill of exchange, jewelry or other valuable items, the hotel shall be responsible for the maximum amount of 5,000.00 Thai Baht unless the guest does declare the value of item and deposit his/her property to the hotel.*

2) THE HOTEL SHALL NOT BE LIABLE FOR ANY LOSS OR DAMAGE RESULTING FROM;

2.1 A force majeure event.

2.2 An existing condition of the article.

2.3 A loss or damage caused from guest or his/her visitor.

1.โรงแรมจะรับผิดชอบต่อทรัพย์สินของผู้เข้าพักกรณีเกิดการสูญหายหรือเสียหายดังนี้:

1.1 การสูญหายหรือเสียหายที่เกิดขึ้นในโรงแรม

1.2 หากทรัพย์สินที่สูญหายตามข้อ 1.1 เป็นประเภทเงิน ทอง ธนบัตร ตัวเงิน ัญมณี หรือของมีค่าอื่นๆ

โรงแรมจะรับผิดชอบไม่เกินวงเงิน 5,000.00 บาท เว้นแต่ผู้เข้าพักจะได้ฝากและแจ้งราคาแห่งทรัพย์สินนั้นไว้กับโรงแรม

2.โรงแรมขอสงวนสิทธิ์ในความรับผิดชอบ หากความสูญหายหรือเสียหายดังกล่าวเกิดขึ้นเพราะเหตุดังต่อไปนี้

2.1 เหตุสุดวิสัย

2.2 เหตุแห่งสภาพของทรัพย์สินนั้นๆ

2.3 เป็นความรับผิดชอบของผู้เข้าพัก บริวาร หรือบุคคลที่ผู้เข้าพักให้การต้อนรับ





NOVOTEL BANGKOK FUTURE PARK RANGSIT
HOTEL INFORMATION



NOVOTEL BANGKOK FUTURE PARK RANGSIT
HOTEL INFORMATION



ภาคผนวก 2.10
หลักฐานการบำรุงรักษาไฟฟ้าภายในโครงการประจำปี

TO : ผู้จัดการฝ่ายอาคาร และผู้เกี่ยวข้อง โรงแรมโนโวเทล รังสิต
 From : นายเรืองเดช เดชขำ
 Subject : PM ระบบไฟฟ้า Transformer, MDB1, MDB2, ATS2-EMDB-LB, CAP-1, CAP-2
 Time estimate : 4 ชั่วโมง ในวันศุกร์ที่ 7 เมษายน 256 เวลา 14.00-17.00 น.



ลำดับ	รายการดำเนินงาน	ระยะเวลาทำงาน (นาที)	เวลาดำเนินการ							
			12.00 น.	13.00 น.	14.00 น.	15.00 น.	16.00 น.	17.00 น.	18.00 น.	
	ขั้นตอนดำเนินการ วันศุกร์ที่ 7 เมษายน 2566									
1	แลกเปลี่ยนอุปกรณ์เตรียมความพร้อมในส่วนช่าง บ.เทิร์น	90 นาที								
2	ปิดไฟฟ้า TR 1 , MDB 1 , MDB 2, Cap Bank 1 , Cap Bank 2 (ทำ PM)	60 นาที								
3	ปิด GENERATOR , ATS 1+ EMDB-LB, ATS 2+EMDB-LS (ทำ PM)	30 นาที								
4	เปิดไฟฟ้าคืนระบบ TR 1 , MDB 1 , MDB 2, Cap Bank 1 , Cap Bank 2	30 นาที								
5	เปิดระบบคืน GENERATOR , ATS 1+ EMDB-LB, ATS 2+EMDB-LS									
7	ทำความสะอาดพื้นที่ และเดินตรวจสอบความเรียบร้อยภายในอาคาร	30 นาที								

Note :
 -ระยะเวลาอาจเปลี่ยนแปลงตามความเหมาะสม
 -ช่างเข้าดำเนินการจาก บริษัท Charoen chai , บริษัท ESI , บริษัท Socomec และ บริษัท เทิสท์ ำ
 -การไฟฟ้า จะตัดไฟฟ้าที่ฟิวส์เสาไฟฟ้าต้นทางก่อนหม้อแปลงของโรงแรม
 GENERATOR เป็นของทางโรงแรมจัดจ้างเองทางบริษัทเทิสท์จึงขอให้นักเดินเข้ามาเพื่อสแกนภายในวันดังกล่าว

จัดทำโดย
 นายเรืองเดช เดชขำ (099-4539971)