

เอกสารแนบที่ 5

รายงานการตรวจสอบอุปกรณ์ป้องกันและแจ้งเตือนอัคคีภัย

---



## รายงานการตรวจสอบระบบป้องกันอัคคีภัย

# The Village Resort and Spa

[illegible]

ข้อควรระวัง TVDS

ใบตรวจสอบสภาพถังดับเพลิง					
วัน/เดือน/ปี	สภาพการตรวจสอบ				ผู้ตรวจ
	สลัก ยางรัด	ตัวถัง ข้อต่อ	สภาพ ถัง	เกจวัด	
10/07/67	✓	✓	✓	✓	
09/03/67	✓	✓	✓	✓	
14/4/67	✓	✓	✓	✓	
17/7/67	✓	✓	✓	✓	

หมายเหตุ 
ปกติ 
ผิดปกติ





เอกสารแนบที่ 6

บันทึกการตรวจสอบการทำงานของระบบต่างๆ ภายในโครงการ

---







## Maintenance Generator

**แบบฟอร์มการบำรุงรักษาเครื่องกำเนิดไฟฟ้า**

## TECHNICAL DATA

Description	Manufacturer	Model	Capacity	Serial No.
Electric generator		C250D5		
Controller	Power Command 1301	PC L2	N/A	A16H004999
Engine	Cummins	6CTA8.360		78592363
Generator	Stamford	UCD127A114	200 kW (250 kVA)	X15403448

Item	Description	Task	WEEK
สํานวน	รายการ	รายการ	
Engine Section / ชิ้นส่วนเครื่องยนต์	Air Cooled System ระบบระบายความร้อนด้วยอากาศ	Check	✓
	Cool Water Level ระดับน้ำในระบบระบายความร้อน	Check	72.0
	Water Temperature อุณหภูมิในระบบระบายความร้อน(F)	Record	161.8
	Oil Temperature อุณหภูมิในน้ำมันเครื่อง(F)	Record	46.1
	Oil Pressure แรงดันน้ำมันเครื่อง(PSI)	Record	67
	Oil Level Record ระดับน้ำมันเครื่อง	Record	44.1
	Belt Tension ความตึงสายพาน	Check	✓
	Shock Condition สภาพเพลาทำป็น	Check	✓
	Shock Level Record ระดับน้ำมันเครื่อง	Record	1/2
	Vibration & Noise การสั่นสะเทือนและเสียง	Check	✓
Alternator / กระจุกไฟฟ้า	Grease Bearing การหล่อจารบีในกระจุกไฟฟ้า	Check	✓
	Speed Record ความเร็วรอบ (RPM)	Record	1500
	Voltage Record บันทึกแรงดันไฟฟ้า	Record	50.8
	Frequency Record บันทึกความถี่ไฟฟ้า(Hz)	Record	50.0
	Frequency Stability สถานภาพความถี่ไฟฟ้า	Record	A✓
	Battery Condition สภาพแบตเตอรี่	Check	✓
Control Section / ชิ้นส่วนการควบคุม	Distilled Water of Battery น้ำกลั่นแบตเตอรี่	Check	✓
	Battery Charger ภาชนะชาร์จแบตเตอรี่	Check	✓
	Battery Voltage Record บันทึกแรงดันไฟฟ้าแรงดัน(DC Volts)	Record	128.2
	Battery Amperes Record กระแสไฟฟ้าแรงดัน(DC Amp.)	Record	23.6
	Testing Period(วินาที) ระยะเวลาการทดสอบ(วินาที)	Record	15.4
	Enging Operating Hour ชั่วโมงการทำงานของเครื่องยนต์	Record	94.4

2008 年 12 月

Remarks:



0805/9  
07/05/2005

**THE VILLAGAE RESORT & SPA**

## Maintenance Generator

แบบฟอร์มการบำรุงรักษาเครื่องกำเนิดไฟฟ้า

## TECHNICAL DATA

Description	Manufacturer	Model	Capacity	Serial No.
Electric generator		C250D5		
Controller	Power Commander 1301	PC 1.2	N/A	A16H004899
Engine	Cummins	6CTA8.339		78592363
Generator	Stamford	UCD327414	200 KW (250 KVA)	X13495446

Item	Description	Task	WEEK
4.4	รวม	รวม	
Engine Section / ส่วนเครื่องยนต์	Air Cooled System ตรวจระบบการระบายอากาศ	✓	
	Cool Water Level ระดับน้ำในระบบระบาย	Check	
	Water Temperature อุณหภูมิระบบระบายน้ำ(F)	Check	
	Oil Temperature อุณหภูมิ น้ำมันเครื่อง(F)	Record	
	Oil Pressure แรงดันน้ำมันเครื่อง(PSI)	Record	
	Oil Level Record ระดับน้ำมันเครื่อง	Record	
	Belt Tension ความตึงสายพาน	Check	
	Smoke Condition สภาพควันดำ	Check	
	Diesel Level Record ระดับน้ำดีเซล	Record	
	Vibration & Noise การสั่นสะเทือนและเสียง	Check	
Alternator / ส่วนเครื่องกำเนิดไฟฟ้า	Grease Bearing ตรวจสอบจารบี	✓	
	Speed Record ความเร็วรอบ (RPM)	Check	
	Voltage Record บันทึกแรงดันไฟฟ้า	Record	
	Frequency Record บันทึกความถี่(Hz)	Record	
	Frequency Stability ความคงที่ความถี่	Record	
	Battery Condition สภาพแบตเตอรี่	Check	
Control Section / ส่วนควบคุม	Distilled Water of Battery น้ำกรดแบตเตอรี่	✓	
	Battery Charger อุปกรณ์ชาร์จ	Check	
	Battery Voltage Record บันทึกแรงดันไฟฟ้า(DC Voltage)	Record	
	Battery Amperes Record บันทึกกระแสไฟฟ้า(DC Amp.)	Record	
	Testing Period(Min) ระยะเวลาการทดสอบ(นาที)	Record	
	Ending Operating Hour ชั่วโมงการทำงานเสร็จ	Record	

Check by:

**Remark:**



Date	Dec
Technician	12/10/17
CE	







Description	Manufacturer	Model	Capacity	Serial No.
Electric generator		C250D5	N/A	A16H004809
Engine Controller	Power Command 1301	PC 1.2		78592353
Engine	Cummins	GCTAA0.358	310HP @ 1,500rpm	X15,403448
Generator	Stamford	UCD1274.14	200 KW, 250 KVA	

Engine Section / ส่วนเครื่องยนต์	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Air Cooled System	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Coolant Water Level	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Water Temperature	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Oil Temperature	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Oil Pressure	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Oil Level Record	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Back Tension	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Smoke Condition	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Digital Level Record	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Window & Sides	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Grease & Bearing	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Speed Record	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Voltage Record	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Frequency Record	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Frequency Stability	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Battery Condition	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Distilled Water of Battery	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Battery Chages	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Check
Battery Voltage Record	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Battery Answer Record	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record
Testing Kernal ( Mile. )	32 ชั่วโมงก่อนบิน / 32 hours before flight	32 ชั่วโมงหลังบิน / 32 hours after flight	Record

1. The first part of the document is a list of names and addresses, which appears to be a directory or a list of contacts. The names are listed in a column, and the addresses are listed in a column next to them. The names are: J. A. Smith, J. B. Jones, J. C. Brown, J. D. White, J. E. Black, J. F. Green, J. G. Gray, J. H. White, J. I. Black, J. J. Green, J. K. Gray, J. L. White, J. M. Black, J. N. Green, J. O. Gray, J. P. White, J. Q. Black, J. R. Green, J. S. Gray, J. T. White, J. U. Black, J. V. Green, J. W. Gray, J. X. White, J. Y. Black, J. Z. Green, J. A. Smith, J. B. Jones, J. C. Brown, J. D. White, J. E. Black, J. F. Green, J. G. Gray, J. H. White, J. I. Black, J. J. Green, J. K. Gray, J. L. White, J. M. Black, J. N. Green, J. O. Gray, J. P. White, J. Q. Black, J. R. Green, J. S. Gray, J. T. White, J. U. Black, J. V. Green, J. W. Gray, J. X. White, J. Y. Black, J. Z. Green.

**Remark:**


RECEIVED

Description	Manufacturer	Model	Capacity	Serial No.
Electric generator		C250D5		
Controller	Power Command 1301	PCI-2	N/A	A161004899
Engine	Cummins	6CTAA8.3GB	3100hp @1500rpm	785923353
Generator	Stamford	UCD127414	200 KW, (250 KVA)	X15J403448

[illegible]

PPS NO 5474  
199140192

**Remark:**



THE FRONT VILLAGE

Check list

Daily check list


02/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Railer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำมัน	น้ำมันดีเซล	พลาสม่า
8:00	A			27.6	13.05	/	/	5/8/205 L	/
14:00	A			27.6	13.05	✓	✓	5/8/205 L	✓
0:00	A			27.6 V	13.05	✓	✓	5/8/205 L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1	Overload	
8:00	/		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
15:00	A			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	น้ำเค็ม%	น้ำจืด%
8:00	100%	100%
14:00	95%	100%
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list


07/01/17

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	หม้อน้ำ	ขั้วแบตเตอรี่
8:00	P		27.6	13.05	✓	✓	✓	5/8/205L ✓
14:00	A		27.6	13.06	✓	✓	✓	5/8/205L ✓
0:00	A		27.6V	13.05V	✓	✓	✓	5/8/205L ✓


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	0		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (ครัว)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		Overload
14:00	✓		
0:00	✓		

PUEP (ถังน้ำ/TANK)														
BOOSTER PUEP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2										
8:00	0		✓	✓										
15:00	A		+	✓										
0:00	A		✓	X										




WATER TANK		
Time	น้ำดื่ม%	น้ำเค็ม%
8:00	95%	95%
14:00	95%	100%
0:00	90%	95%





## THE FRONT VILLAGE

## Check list



Daily check list


03-01-17

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8:00	P			27.6	13.05	✓	✓	5/8 905L
14:00	A			27.6	13.05	✓	✓	5/8 205L
0:00	A			27.6.v	13.05.v	✓	✓	5/8 205L


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	P		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUEP (ถังน้ำขึ้นTANK)														
BOOSTER PUEP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2										
8:00	P		✓	✓										
15:00	A		✓	✓										
0:00	A		✓	✓										



WATER TANK		
Time	น้ำดิบ%	น้ำค้%
8:00	95%	90%
14:00	95%	100%
0:00	90%	95%



## THE FRONT VILLAGE

## Check list

Daily check list


04/1/68

GENERATOR								
	MODE			V	V	Distilled water	Railor	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยอน้ำ	น้ำมันดีเซล
8:00	A			27.6	19.05	/	/	5/8/205L
14:00	A			27.6	19.05	/	/	5/8/205L
0:00	A			27.6.V	13.05.V	✓	✓	5/8/205L


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
Time	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00	✓		

PUEP (ถังน้ำTANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			/	/								
0:00	A			✓	✓								



WATER TANK		
Time	น้ำดิบ%	น้ำเสี%
8:00	90%	85%
14:00		
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list


05/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.04	✓	✓	5/8/205L	✓
14:00	B			27.6	13.04	✓	✓	5/8/205L	✓
0:00	A			27.6.V	13.05.V	✓	✓	5/8/205.L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	49	2	3					
15:00	B			✓	✓	✓	49	2	3					
0:00	A			✓	✓	✓	49	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUEP (ถังน้ำTANK)													
ROOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00													
15:00													
0:00													



WATER TANK		
Time	น้ำเต็ม%	น้ำต่ำ%
8:00		
14:00		
0:00		



## THE FRONT VILLAGE

## Check list

Daily check list

6/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	/	/	5 1/2 / 20%v	/
14:00	A			27.6	13.05	/	/	5 1/2 / 20%v	/
0:00	A			27.6	13.05	/	/	5 1/2 / 20%v	/

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	4	2	3					
15:00	A			/	/	/	42	2	3					
0:00	D			/	/	/	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8:00	/	
14:00	/	
0:00	/	


PUEP (ถังน้ำ/TANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	D			✓	✓								
0:00	A			✓	✓								

WATER TANK		
Time	น้ำดื่ม%	น้ำคั้น%
8:00	100%	100%
14:00	95%	100%
0:00	95%	95%



## THE FRONT VILLAGE

## Check list












Daily check list


2/10/12

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำดับไฟ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	☑			92.6	13.05	/	/	6/8 200L	/
14:00	☑			92.6	13.05	/	/	6/8 200L	/
0:00	☑			92.6	13.05	/	/	6/8 200L	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	☑			/	/	/								
15:00	☑			/	/	/								
0:00	☑			/	/	/								

Kitchen (น้ำ)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	/		
14:00	/		
0:00		☑	

PUMP (น้ำหมักTANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00														
15:00														
0:00														



WATER TANK		
Time	น้ำดิบ%	น้ำเค็ม%
8:00	90%	95%
14:00	100%	100%
0:00	100%	100%



## THE FRONT VILLAGE

## Check list

Daily check list


8/10/10

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	R			27.6	13.05	✓	✓	5/10 200L	✓
14:00	R			27.6	13.05	✓	✓	5/10 200L	✓
0:00	R			27.6	13.05	✓	✓	5/10 200L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	R			✓	✓	✓	42	2	3					
15:00	R			✓	✓	✓	42	2	3					
0:00	R			✓	✓	✓	42	2	3					

Kitchen (ก.ย.)			
Time	Exhaust NO.1	Overload	
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2									
8:00	R			✓	✓									
15:00	R			✓	✓									
0:00	R			✓	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00		
14:00	100%	100%
0:00	95%	100%



## THE FRONT VILLAGE

## Check list

Daily check list

7/01/69

GENERATOR								
Time	MODE			V	V	Distilled water	Railor	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำเชื้อ	น้ำมันดีเซล
8:00	<input checked="" type="checkbox"/>			20.6	13.05	✓	✓	6/6 000
14:00	<input checked="" type="checkbox"/>			22.6	13.06	✓	✓	5/6 202
0:00	<input checked="" type="checkbox"/>			27.6	13.03	✓	✓	5/4 12064

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	<input checked="" type="checkbox"/>			✓	✓	✓	42	2	3					
15:00	<input checked="" type="checkbox"/>			✓	✓	✓	42	2	3					
0:00	<input checked="" type="checkbox"/>			✓	✓	✓	42	2	3					


Kitchen (H.T.)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	<input checked="" type="checkbox"/>		
14:00	<input checked="" type="checkbox"/>		
0:00	<input checked="" type="checkbox"/>		

PUMP (ปั๊ม) (TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00														
15:00	D			✓	✓									
0:00	D			✗	✓									

WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00		
14:00	95%	95%
0:00	95%	100%

## THE FRONT VILLAGE

## Check list



Daily check list


16/6/62

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8:00	0			20.6	13.00	✓	✓	55 / 205L
14:00	0			20.6	13.00	✓	✓	55 / 205L
0:00	A			27.6	13.05	✓	✓	55 / 205L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
Time	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	0			✓	✓	✓	48	2	3					
15:00	0			✓	✓	✓	48	2	3					
0:00	A			✓	✓	✓	48	2	3					

Kitchen (กitchen)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ) TANK													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00													
15:00	A			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00		
14:00	95%	100%
0:00	95%	95%





## THE FRONT VILLAGE

## Check list

Daily check list

17/01/02

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			22.6	13.05	✓	✓	5/8 / 203L	✓
14:00	A			22.6	13.05	✓	✓	5/8 / 203L	✓
0:00	A			27.6	13.05	✓	✓	5/8 / 203L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	D			✓	✓	✓	42	2	3					
15:00	D			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (K73)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (K33) WATERTANK														
BOOSTER PUMP D			ON/OFF											
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00														
15:00														
0:00														

WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00		
14:00	100%	95%
0:00	25%	95%

THE FRONT VILLAGE

Check list



Daily check list


12/07/12

GENERATOR								
Time	MODE			V	V	Distilled water	Balier	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยา	น้ำมันดีเซล
8:00	P			22.6	13.05	✓	✓	5/8 205L
14:00	P			22.6	13.05	✓	✓	5/8 205L
0:00	A			27.5	13.05	✓	✓	5/8 205L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	P			✓	✓	✓	48	2	5					
15:00	P			✓	✓	✓	49	2	5					
0:00	P			✓	✓	✓	48	2	5					

Kitchen (ครัว)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	1													
15:00	P			✓	✓									
0:00	P			✓	✓									




WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00		
14:00	90%	100%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list


13-01-67

GENERATOR								
Time	MODE			V	V	Distilled water	Balker	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อหุง	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	5/8/2021
14:00	A			27.6	13.05	✓	✓	5/8/2021
0:00	A			27.6	13.05	✓	✓	5/8/2021


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (ห้อง)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2										
8:00														
15:00	A		✓	✓										
0:00	A		X	✓										




WATER TANK		
Time	น้ำดื่ม%	น้ำเสียน%
8:00		
14:00	95%	45%
0:00	90%	60%



THE FRONT VILLAGE

Check list



Daily check list


14/01/66

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	5/8/205L
14:00	A			27.6	13.05	✓	✓	5/8/205L
0:00	A			27.6	13.05	✓	✓	5/8/205L


BOOSTER PUMP													
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF							
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (RT)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D				ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			+	✓								



WATER TANK		
Time	น้ำดิบ%	น้ำคั้น%
8:00	90%	98%
14:00	100%	100%
0:00	95%	95%



THE FRONT VILLAGE

Check list

Daily check list


12/01/12

GENERATOR									
Time	MODE			V	V	Distilled water	Water	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำยา	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	P			25.6	13.05	✓	✓	5/5 205L	✓
14:00	P			25.1	13.05	✓	✓	5/5 205L	✓
0:00	A			27.5	13.05	✓	✓	5/5 205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	P			✓	✓	✓	42	2	3					
15:00	P			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (K12)			
Time	Exhaust NO.1	Overload	
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (WATER TANK)													
BOOSTER PUMP D				ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2									
8:00	P		✓	✓									
15:00	P		✓	✓									
0:00	A		✓	✓									




WATER-TANK		
Time	น้ำดื่ม%	น้ำยา%
8:00	100%	100%
14:00	100%	100%
0:00	95%	100%





THE FRONT VILLAGE

Check list



Daily check list


16/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อต้มน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/2/205L	✓
14:00	P			25.6	13.05	✓	✓	3/2/205L	✓
0:00	A			27.5	13.05	✓	✓	5/2/205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	P			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังเก็บน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	P			✓	✗									
0:00	A			✗	✓									



WATER TANK		
Time	น้ำดิบ%	น้ำคั้น%
8:00	100%	90%
14:00	100%	95%
0:00	100%	95%



THE FRONT VILLAGE

Check list

Daily check list


17/01/67.

GENERATOR									
Time	MODE			V		Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	130.6	✓	✓	5/8/205L	✓
14:00	A			27.6	130.6	✓	✓	5/8/205L	✓
0:00	A			27.6	130.6	✓	✓	5/8/205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำTANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	D			✗	✓								



WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00	98%	98%
14:00	98%	95%
0:00	98%	95%



THE FRONT VILLAGE

Check list

Daily check list


18/01/24

GENERATOR									
Time	MODE			V		Distilled water	Water	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			22.06	13.05	✓	✓	5/8 205L	✓
14:00	B			22.06	13.05	✓	✓	5/8 205L	✓
0:00	A			27.6V	13.05V	✓	✓	5/8 205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	42	3					
15:00	A			✓	✓	✓	42	42	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8:00	✓	
14:00	✓	
0:00	✗	

PUMP (ถังน้ำTANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓								
15:00	B			✓	✓								
0:00	A			✗	✓								



WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	100%	95%
14:00	90%	90%
0:00	95%	95%



THE FRONT VILLAGE

Check list

Daily check list


19/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8/205	✓
14:00	A			27.6	13.06	✓	✓	5/8/205	✓
0:00	B			27.6	13.08	✓	✓	5/8/205	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓	✓	42	2	3					
15:00	✓			✓	✓	✓	42	2	3					
0:00	✓			✓	✓	✓	42	2	3					

Kitchen (K12)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ/TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			/	/								
0:00	B			✓	✗								



WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00	90%	95%
14:00	95%	96%
0:00	98%	96%



## THE FRONT VILLAGE

## Check list

Daily check list


20/6/12

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			2.76	12.06	/	/	3/8/2012	/
14:00	A			29.6	12.06	/	/	3/8/2012	/
0:00	A			29.6	13.06	/	/	5/8/2012	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	P			/	/	/	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00	X		

PUMP (ถังน้ำ/TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			/	X								
0:00	P			X	X								



WATER TANK		
Time	น้ำดิบ%	น้ำดื่ม%
8:00	90%	95%
14:00	70%	90%
0:00	100%	100%





## THE FRONT VILLAGE

## Check list

Daily check list


21-01-87

GENERATOR									
Time	MODE			V	V	Distilled water	Water	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำดื่ม	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8/205L	✓
14:00	A			27.6	13.05	✓	✓	5/8/205L	✓
0:00	A			27.6	13.05	✓	✓	5/8/205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
Time	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	47	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (P32)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		✓	

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	A			X	✓								
0:00	A			X	X								



WATER TANK		
Time	น้ำดื่ม%	น้ำกลั่น%
8:00	90%	95%
14:00	90%	95%
0:00	100%	100%



## THE FRONT VILLAGE

## Check list

Daily check list


22/01/2024

GENERATOR									
Time	MODE			V		Distilled water	Bailer	Direct fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันเชื้อเพลิง	ขั้วแบตเตอรี่
8:00	A			27.6.v	1305.v	✓	✓	5/8/205.1	✓
14:00	P			22.0C	1305	✓	✓	5/8/205.1	✓
0:00	P			22.06	1305	✓	✓	5/8/205.1	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	A2	9	3					
15:00	P			✓	✓	✓	A2	2	3					
0:00	P			✓	✓	✓	A2	2	3					

Kitchen (ห้อง)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		X	

PUMP (ถังน้ำ/TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	P			X	✓								
0:00	P			✓	✓								



WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00	95%	100%
14:00	90%	95%
0:00	100%	100%



## THE FRONT VILLAGE

## Check list

Daily check list

23-01-68

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำดี	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8/205L	✓
14:00	A			27.6	13.95	/	/	5/8/205L	/
0:00	A			27.6	13.05	✓	✓	5/8/205L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (P12)		
Time	Exhaust NO.1	Overload
	ON	OFF
8:00	✓	
14:00	/	
0:00		✓

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			+	✓									
15:00	A			✗	/									
0:00	P			✗	✗									

WATER TANK		
Time	น้ำเค็ม%	น้ำจืด%
8:00	95%	100%
14:00	90%	95%
0:00	100%	95%

THE FRONT VILLAGE

Check list

Daily check list


24/01/67.

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยอน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8 203L	✓
14:00	A			27.6	13.05	✓	✓	5/8 203L	✓
0:00	A			27.6	13.05	✓	✓	5/8 203L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (น้ำ)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		X	

PUMP (น้ำในถัง TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	A			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	น้ำดิบ%	น้ำดื่ม%
8:00	90%	100%
14:00	95%	100%
0:00	95%	90%



THE FRONT VILLAGE

Check list

Daily check list

25/01/67.

GENERATOR									
Time	MODE			V	V	Distilled water	Water	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยา	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.06	✓	✓	5/8 205L	✓
14:00	A			27.6	13.06	✓	✓	5/8 205L	✓
0:00	A			27.6	13.06	✓	✓	5/8 205L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (ห้อง)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D			ON/OFF											
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			X	/									
0:00	A			X	✓									

WATER TANK		
Time	น้ำดื่ม%	น้ำยา%
8:00	90%	95%
14:00	95%	100%
0:00	95%	100%



THE FRONT VILLAGE

Check list

Daily check list


26/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Railor	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำเกลือ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A		27.6	13.06		/	/	/	5/8 / 2052
14:00	A		27.6	13.06		/	/	/	5/8 / 2052
0:00	D		27.6	13.05		/	/	5/8 / 2052	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	D			/	/	/	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00		X	X

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
15:00	A			/	/									
0:00	D			/	/									




WATER TANK		
Time	น้ำดื่ม%	น้ำเกลือ%
8:00	93%	100%
15:00	95%	100%
0:00	90%	96%



## THE FRONT VILLAGE

## Check list



Daily check list


27/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.0	13.05	/	/	/	5/8/205L
14:00	A			27.0	13.0	/	/	/	5/8/205L
0:00	A			27.0	13.05	/	/	5/8/205L	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (ห้อง)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	/		
14:00	/		
0:00		X	

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			/	/								
0:00	A			/	/								




WATER TANK		
Time	น้ำดื่ม %	น้ำจืด %
8:00	90%	100%
14:00	90%	95%
0:00	95%	90%



## THE FRONT VILLAGE

## Check list



Daily


28/01/67

GENERATOR									
Time	MODE			V		Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำสะอาด	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	58/205L	✓
14:00	A			27.6	12.95	✓	✓	58/205L	✓
0:00	B			27.6	12.00	✓	✓	58/205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	L/W	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	B			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		✓	

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D		ON/OFF		ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			x	✓									
15:00	A			X	/									
0:00	B			X	/									



WATER TANK		
Time	น้ำดื่ม%	น้ำสะอาด%
8:00	95%	100%
14:00	90%	95%
0:00	90%	95%



## THE FRONT VILLAGE

## Check list

Daily check list


29-01-67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำทิ้ง	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8/205L	✓
14:00	1			17.6	13.05	✓	✓	5/8/205L	✓
0:00	B			22.6	13.05	✓	✓	5/8/205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	B			✓	✓	✓	42	2	3					

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		X	

PUMP (ถังน้ำ/TANK)													
BOOSTER PUMP D			DN/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			+	✓								
15:00	A			/	/								
0:00	A			X	X								



WATER TANK		
Time	น้ำดื่ม%	น้ำทิ้ง%
8:00	90%	95%
14:00	90%	95%
0:00	100%	95%



THE FRONT VILLAGE

Check list

Daily check list


30/01/67

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยา	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	58/203L
14:00	A			27.6	13.05	✓	✓	58/203L
0:00	P			27.6	13.05	✓	✓	58/203L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	P			✓	✓	✓	42	2	3					

Kitchen (R73)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		✗	

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✗	✓								
0:00	P			✓	✓								



WATER TANK		
Time	น้ำดิบ %	น้ำดื่ม %
8:00	95%	100%
14:00	90%	100%
0:00	75%	90%





## THE FRONT VILLAGE

## Check list

Daily check list

31/01/24

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6V	13.05V	✓	✓	5/8/205L	✓
14:00	B			27.6	13.05V	✓	✓	5/8/205L	✓
0:00	A			27.6	13.05	✓	✓	5/8/205L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	✓	42	2	3					
15:00	B		✓	✓	✓	✓	42	2	3					
0:00	A		✓	✓	✓	✓	42	2	3					

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2										
8:00	A		✓	✓	✓									
15:00	B		✓	✓	✓									
0:00	B		✓	✓	✓									

WATER TANK		
Time	น้ำดื่ม%	น้ำคั้น%
8:00	90%	95%
14:00	95%	90%
0:00	95%	100%



THE FRONT VILLAGE

Check list

Daily check list


01/02/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยอน	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	D			20.06	13.05	✓	✓	5/8 20L	✓
14:00	A								
0:00	A					/	/	5/8 20L	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	D			/	/	/	42	2	3					
15:00														
0:00	A			/	/	/	42	2	3					

Kitchen (033)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00			
0:00	X	X	

PUMP (WATER TANK)													
BOOSTER PUMP D				ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	D			X	✓								
15:00													
0:00	A			X	/								



WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	95%	100%
14:00	90%	95%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list


28/07/12

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			22.96	13.05	✓	✓	5/8 205L	✓
14:00	P			22.06	13.05	✓	✓	5/8 205L	✓
0:00	P			22.06	13.05	✓	✓	5/8 205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			✓	✓	✓	42	2	3					
15:00	P			✓	✓	✓	42	2	3					
0:00	P			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		X	

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2									
8:00	A			✓	✓									
15:00	P			✓	✓									
0:00	P			✓	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำค%
8:00	75%	70%
14:00	70%	100%
0:00	75%	70%



THE FRONT VILLAGE

Check list

Daily check list


03-02-67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	48/205L	✓
14:00									
0:00	A			27.6	13.05	✓	✓	56/205L	✓


ROOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00														
0:00	A			✓	✓	✓	49	2	3					

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			X	✓									
15:00														
0:00	A			X	✓									



WATER TANK		
Time	น้ำเค็ม%	น้ำจืด%
8:00	95%	95%
14:00		
0:00	95%	95%



## THE FRONT VILLAGE

## Check list

Daily check list


4/22/12

GENERATOR									
Time	MODE			V		Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	P			12.06	13.05	✓	✓	5/8 205L	✓
14:00	P			12.06	13.05	✓	✓	5/8 205L	✓
0:00	A			12.06	13.05	✓	✓	5/8 205L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	P			✓	✓	✓	42	2	3					
15:00	P			✓	✓	✓	42	2	3					
0:00	P			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	P			✓	✓								
15:00	P			✓	✓								
0:00	P			✓	✓								



WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00	95%	90%
14:00	100%	100%
0:00	95%	100%







## Check list

Daily check list  
5/02/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อต้มน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8/205L	✓
14:00	A			27.6	13.05	✓	✓	5/8/205L	✓
0:00	A			27.6	13.05	✓	✓	5/8/205L	✓


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓	✓	

THE FRONT VILLAGE

## Check list

Daily check list  
06/02/67


GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อต้มน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8/205L	✓
14:00	A			27.6	13.05	✓	✓	5/8/205L	✓
0:00	A			27.06	13.05	✓	✓	5/8/205L	✓

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


  

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		✓	

PUEP (ปั๊มสูบน้ำTANK)													
ROOSTER PUEP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	D			X	X								
0:00	D			✓	X								




WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	90%	100%
14:00	90%	95%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list

07/02/24


GENERATOR								
Time	MODE			V	V	Distilled water	Baile	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยาล้าง	น้ำมันดีเซล
8:00	A			27.6.V	13.05.V	✓	✓	5/8/205.L
14:00	A			27.6	13.02	✓	✓	5/8/205.L
0:00	D			28.06V	13.05V	✓	✓	5/8/205.L

ROOSTER PUEP													
ROOSTER PUEP D			ON/OFF										
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	13				
15:00	A			✓	✓	✓	42	2	3				
0:00	D			✓	✓	✓	42	2	3				


  

Kitchen (872)		
Time	Exhaust NO.1	Overload
8:00	ON	OFF
14:00	✓	
0:00		X

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D	
8:00	A			X	✓									
15:00	A			✓	✓									
0:00	<del>A</del>			X	✓									




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	90%	95%
14:00	100%	100%
0:00	95%	90%



THE FRONT VILLAGE

Check list



Daily check list


8/02/67

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	5/8/205L ✓
14:00	A			27.6	13.05	✓	✓	5/8/205L ✓
0:00	A			27.6	13.05	✓	✓	5/8/205L ✓


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF			psi	LOW	HI	Storage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2								
8:00	A			✓	✓	42	2	3					
15:00	A			✓	✓	42	2	3					
0:00	A			✓	✓	42	2	3					

Kitchen (R12)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		X	


PUEP (USHUNTANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✗								
15:00	A			✓	✓								
0:00	A			✓	✗								




WATER TANK		
Time	High %	Low %
8:00	100%	85%
15:00	100%	90%
0:00	95%	90%



PUEP (USHUNTANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	D			✗	✓								
15:00	A			✓	✓								
0:00	D			✓	✓								



WATER TANK		
Time	High %	Low %
8:00	95%	100%
15:00	95%	100%
0:00	90%	95%



## THE FRONT VILLAGE

## Check list

Daily check list

11/02/12

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำยอน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	✓			27.6	13.05	✓	✓	1/2 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			28.0	13.05	✓	✓	1/2 300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (HFO)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00		✓	
14:00	✓		
0:00	✓		

PUMP (น้ำดื่ม/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
15:00	A			✓	✓									
0:00	A			/	✓									

WATER TANK		
Time	น้ำดื่ม%	น้ำยอน้ำ%
8:00	90%	90%
14:00	95%	100%
0:00	100%	100%

## THE FRONT VILLAGE

## Check list

Daily check list


5/12/12

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6.V	13.05.V	✓	✓	1/2 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			27.6	13.05	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (กitchen)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00		X	
14:00	✓		
0:00	X		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF									
AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D		
8:00	A		✓	✓										
15:00	A		X	✓										
0:00	A		✓	✓										



WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	90%	90%
14:00	90%	95%
0:00	95%	100%





## THE FRONT VILLAGE

## Check list

Daily check list

16/07/12

GENERATOR									
Time	MODE			V		Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			25.06	13.05	✓	✓	<del>1/2</del> 300L	✓
14:00	A			27.06V	13.05	✓	✓	<del>1/2</del> 300L	✓
0:00	A			27.06	13.05	✓	✓	<del>1/2</del> 300L	✓

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (P55)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	X		

PUEP (WATER TANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	X									
15:00	A			X	✓									
0:00	A			✓	✓									

WATER TANK		
Time	น้ำเค็ม%	น้ำจืด%
8:00	90%	95%
14:00	90%	95%
0:00	95%	100%

## THE FRONT VILLAGE

## Check list

Daily check list


17-02-67

GENERATOR									
Time	MODE			V		Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			28.6	13.05	✓	✓	1/2 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			27.6	13.05	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (น้ำ)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00		✓	
14:00		✓	
0:00	2		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			X	✓									
15:00	A			X	✓									
0:00	A			✓	✓									



WATER TANK		
Time	น้ำดิบ %	น้ำดี %
8:00	90%	90%
14:00	90%	100%
0:00	100%	98%



## THE FRONT VILLAGE

## Check list

Daily check list

180269

GENERATOR								
Time	MODE			V		Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	ขั้วแบตเตอรี่
8:00	A			27.6	13.06	✓	✓	1/2 300L ✓
14:00	A			27.6	13.06	✓	✓	1/2 300L ✓
0:00	A			27.6	13.06	✓	✓	1/2 300L ✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (K73)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00		X	
14:00	✓		
0:00	✓		

PUEP (ถังน้ำ/TANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								

WATER TANK		
Time	น้ำดื่ม%	น้ำเค็ม%
8:00	90%	90%
14:00	90%	915%
0:00	100%	100%

## THE FRONT VILLAGE

## Check list

Daily check list

19/02/24

GENERATOR									
Time	MODE *			V		Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	P			27.05	13.06	✓	✓	1/300L	✓
14:00	A			27.06V	13.05V	✓	✓	1/300L	✓
0:00	A			27.06	13.05	✓	✓	1/300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	40	2	3					

Kitchen (กitchen)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		✗	

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2									
8:00	P			✓	✓									
15:00	A			✗	✓									
0:00	A			✗	✓									

WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	100%	95%
14:00	60%	65%
0:00		

THE FRONT VILLAGE

Check list

Daily check list

20/2/67

GENERATOR									
Time	MODE			V	V	Distilled water	Dalier	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยาล้าง	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.0	13.6	✓	✓	1/2 300L	✓
14:00	A			27.06V	13.05V	✓	✓	1/2 300L	✓
0:00	A			27.06	13.05X	✓	✓	1/2 300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (น้ำ)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (น้ำหมักTANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			/	/									
0:00	A			/	/									

WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8:00	100%	100%
14:00	90%	95%
0:00	100%	100%

## THE FRONT VILLAGE

## Check list

Daily check list

21/02/68

GENERATOR									
Time	MODE			V		Distilled water	Water	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	1/2 300L	✓
14:00	A			27.6V	13.05V	✓	✓	1/2 300L	✓
0:00	A			27.6V	13.05V	✓	✓	1/2 300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (กitchen)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00		X	
14:00	✓		
0:00	X		

PUMP (ถังน้ำ/TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								

WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	95%	95%
14:00	90%	95%
0:00	95%	90%



## THE FRONT VILLAGE

## Check list

Daily check list

22/2/67

GENERATOR									
Time	MODE			V	V	Distilled water	Baller	Diesel fuel	Datery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.0V	✓	✓	1/2 300L	✓
14:00	A			27.6V	13.05V	✓	✓	1/2 300V	✓
0:00	A			27.6V	13.05V	✓	✓	1/2 300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (A75)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (WATER TANK)														
ROOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			✓	✓									
0:00	A			/	/									

WATER TANK		
Time	น้ำเต็ม%	น้ำวัด%
8:00	90%	95%
14:00	90%	95%
0:00	95%	100%

THE FRONT VILLAGE

Check list



Daily check list


23/02/82

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	ถังเก็บ	หม้อน้ำ	ถังเก็บเชื้อเพลิง	ขั้วแบตเตอรี่
8:00	B			22.06	13.05	✓	✓	1/2 800L	✓
14:00	A			27.06	13.05	✓	✓	1/2 800L	✓
0:00	A			27.6	13.05	✓		1/2 800L	✓


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (n3)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUEP (ถังเก็บน้ำ/TANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			✓	✓									
15:00	A			✓	✗									
0:00	A			✓	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8:00	85%	90%
14:00	90%	95%
0:00	100%	95%






THE FRONT  
Check list

Daily check list  
24/02/16


GENERATOR									
	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	P			27.98	13.05	✓	✓	1/2 300L	✓
14:00	A			27.06V	13.05V	✓	✓	1/2 300L	✓
0:00	A			27.6V	13.05V	✓	✓	1/2 300L	✓

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8:00	✓	
14:00	✓	
0:00	✓	



PUEP ( ถังน้ำTANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	P			✓	✓									
15:00	A			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	น้ำดิบ%	น้ำดี%
8:00	95%	90%
14:00	90%	90%
0:00	95%	100%

THE FRONT VILLAGE

Check list

Daily check list

25/02/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำส้ม	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	1/2 300 L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300 L	✓
0:00	A			27.6	13.05	✓	✓	1/2 300 L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (น้ำ)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	X		
14:00		X	
0:00	X		

PUMP (น้ำในถัง)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			X	✓									
15:00	A			/	X									
0:00	A			/	/									

WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	70%	75%
14:00	25%	100%
0:00	100%	100%

THE FRONT VILLAGE

Check list

Daily check list


26/02/22

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	พอยท์	น้ำมันเครื่อง	ขั้วแบตเตอรี่
8:00	A			27.06	13.05	✓	✓	1/2 300L	✓
14:00	A			27.06	13.05	✓	✓	1/2 300L	✓
0:00	A			27.06	13.05	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	B		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (K73)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓	✓	

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2										
8:00														
15:00	A			✗	✓									
0:00	A			✗	✗									



WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00		
14:00	90%	95%
0:00	90%	95%



## THE FRONT VILLAGE

## Check list

Daily check list

28/02/67.

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.5	✓	✓	1/2 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			27.6	13.05	✓	✓	1/2 300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (KIT)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำTANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✗	✓								
15:00	A			✗	✓								
0:00	A			✓	✓								

WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	95%	95%
14:00	90%	100%
0:00	100%	95%



THE FRONT VILLAGE

Check list

Daily check list


28-02-47

GENERATOR									
Time	MODE			V		Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.5	✓	✓	1/2 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			27.05	13.05	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (P79)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		
14:00	✓		
0:00	✗		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			X	X									
15:00	A			X	✓									
0:00	A			✓	X									



WATER TANK		
Time	น้ำดื่ม%	น้ำเสีย%
8:00	95%	95%
14:00	90%	100%
0:00	90%	95%



## THE FRONT VILLAGE

## Check list



Daily check list


29/02/67

GENERATOR									
Time	MODE			V		Distilled water	Baller	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	เบ๊ลล์	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	1/2 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			27.06V	13.05V	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	B			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (กitchen)			
Time	Exhaust NO.1		
	ON	OFF	Overhaul
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			✓	✓									
15:00	B			✗	✓									
0:00	A			✓	✗									



WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8:00	95%	100%
14:00	90%	100%
0:00	90%	95%



## THE FRONT VILLAGE

## Check list

Daily check list

01/03/68

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันเชื้อเพลิง
8:00	A			27.06	13.05	✓	✓	1/2 000L
14:00	A			27.0	13.05	✓	✓	1/2 000L
0:00	A			27.06	13.05	✓	✓	1/2 000L

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	0.					
15:00	D			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (012)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	P			✓	✓									
15:00	A			✓	✓									
0:00	A			✓	✗									

WATER TANK		
Time	น้ำดื่ม%	น้ำดิบ%
8:00	70%	90%
14:00	95%	100%
0:00	90%	95%

THE FRONT VILLAGE

Check list

Daily check list


02-03-67

GENERATOR									
Time	MODE			V		Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.05	13.05	✓	✓	1/2 300L	✓
14:00	A			27.5	13.05	✓	✓	1/2 300L	✓
0:00	A			27.5	13.06	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (น้ำ)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00														
15:00	A			+	✓									
0:00	A			✓	✓									




WATER TANK		
Time	น้ำดิบ%	น้ำดื่ม%
8:00		
14:00	90%	95%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list


03-03-67

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00									
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			27.66V	13.05V	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00														
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (P12)		
Time	Exhaust NO.1	
	ON	OFF
8:00		
14:00	✓	
0:00	✗	

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00														
15:00	A			✓	✓									
0:00	A			✓	✗									



WATER TANK		
Time	น้ำเต็ม%	น้ำล้น%
8:00		
14:00	90%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


4-3-67

GENERATOR									
Time	MODE			V		Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.5	13.05	/	/	12 300L	/
14:00	A			27.5	13.05	/	/	12 300L	/
0:00	A			27.05	13.05	/	/	12 300L	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (AT)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	/		
14:00	/		
0:00	X		

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			X	/								
0:00	A			/	X								



WATER TANK		
Time	น้ำดื่ม %	น้ำจืด %
8:00	90%	95%
14:00	100%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list


9/5/12

GENERATOR									
Time	MODE			V		Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.5	19.5	✓	✓	1/2 / 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓
0:00	A			27.06	13.05	✓	✓	1/2 / 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF										
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUEP (ถังน้ำTANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	FWR	CPU	COM	Water D
8:00	A			/	X								
15:00	A			+	✓								
0:00	A			✓	X								



WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	95%	95%
14:00	90%	45%
0:00	90%	95%





THE FRONT VILLAGE

Check list

Daily check list


06/03/67

GENERATOR									
Time	MODE			V		Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓
0:00	A			27.06	13.05	✓	✓	1/2 / 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	A			✗	✓									
0:00	A			✓	✗									



WATER TANK		
Time	น้ำดิบ %	น้ำดี %
8:00	95%	95%
14:00	90%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list


07-05-67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.5	✓	✓	1/2 / 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓
0:00	A			27.6.4	13.05	✓	✓	1/2 / 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (กitchen)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✗	✓								
0:00	A			✓	✗								



WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	95%	95%
14:00	10%	95%
0:00	90%	95%



## Check list

Daily check list

09/03/67

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยาล้าง	น้ำมันดีเซล
8:00	A			29.6	19.05	/	/	1/2 500L
14:00	A			27.6	13.05	/	/	1/2 800L
0:00	A			27.06V	13.05V	✓	✓	1/2 500L

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
Time	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00	X		




THE FRONT VILLAGE

ข้อมูลทั่วไป								Remark
SPEC	Description	Repeat Temperature		Time				
No.		SPEC	°C	8:00	14:00	0:00		
COOKING AREA								
10	4-DOOR UPRIGHT CHILLER	(-18)-(-22)	9.0	/	10			
1	UNDERCOUNTER REFRIGERATOR ( ตู้เย็นขนาดเล็ก )	(-18)-(-22)	/	/	/			
2	4-DOOR UPRIGHT CHILLER	2°C-5°C	8	/	9			
6	4-DOOR UPRIGHT CHILLER	3°C-5°C	6.4	/	9.1			
4	UNDERCOUNTER REFRIGERATOR ( ตู้เย็นขนาดเล็ก )	(-22)	/	/	/			
3	3-DOOR UNDERCOUNTER REFRIGERATOR	2°C-5°C	8.3	/	-10			
7	1-DOOR UPRIGHT CHILLER	(-18)-(-22)	8.2	/	8			
	Ice machine	2°C-5°C	/	/	/			
ตู้แช่แข็ง ห้องครัว								
9	4-DOOR UPRIGHT CHILLER	2°C-5°C	7	/	7			
8	3-DOOR UNDERCOUNTER REFRIGERATOR	2°C-5°C	7.8	/	8.4			
DINING ROOM								
	2-DOOR UNDERCOUNTER REFRIGERATOR	0°C-8°C	9.0	/	10			
	2-DOOR UNDERCOUNTER REFRIGERATOR ( ตู้เย็นขนาดเล็ก )	2°C-5°C	4.1	/	4.3			
POOL BAR								
	2-DOOR UNDERCOUNTER REFRIGERATOR	2°C-5°C	6.8	/	8.0			
Refrigerator ห้องนอน								
	4-DOOR UNDERCOUNTER REFRIGERATOR	2°C-8°C	4.9	/	4.2			

PUMP (ปั๊ม) TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
	AUTO	MAN	OFF	P1	P2									
8:00	A			X	/									
15:00	A			/	/									
0:00	A			✓	✗									




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	2.5	100
14:00	95%	95%
0:00	90%	95%



# THE FRONT VILLAGE

## Check list



Daily check list

01/06/17

GENERATOR								
Time	MODE			V		Distilled water	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8:00	A			27.06	13.05	✓	✓	10 300L
14:00	A			27.06	13.05	✓	✓	12 300L
0:00	A			27.06	13.05	✓	✓	12 300L

BOOSTER PUMP

BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	48	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


Kitchen (ครัว)

Time	Exhaust NO.1		Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUEP (น้ำดื่ม) TANK													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✗								
15:00	A			✓	✓								
0:00	B			✗	✓								




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	95%	90%
14:00	95%	95%
0:00	90%	95%



# THE FRONT VILLAGE

## Check list




Daily check list  
10/03/67

GENERATOR								
	MODE			V	V	Distilled water	Batter	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำดื่ม
8:00	A			27.6	13.85	✓		1/2 300L
14:00	B			29.06	13.05	✓	✓	1/2 300L
0:00	A			27.6	13.05	✓	✓	1/2 300L


BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	Water D
8:00	P			✓	✓	✓	42	2	3				
15:00	B			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (น้ำ)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✗		

PUEP (ถังน้ำTANK)													
BOOSTER PUEP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	X								
15:00	A			X	X								
0:00	A			/	✓								




WATER TANK		
Time	น้ำดื่ม%	น้ำจืด%
8:00	0.0%	0.5%
14:00	95%	100%
0:00	90%	95%



# THE FRONT VILLAGE

## Check list



Daily check list


11/09/67

GENERATOR								
Time	MODE			V		Distilled water	Dalier	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำย้อม	น้ำมันดีเซล
8:00	A			27.6	13.05	/	/	1/2 / 300
14:00	A			27.6	13.05	/	/	1/2 / 300
0:00	A			27.6	13.05	/	/	1/2 / 300


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	/		
	/		
14:00			
0:00	X		

PUEP (น้ำดื่ม) TANK													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	X								
15:00	A			/	/								
0:00	A			/	/								




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	40%	45%
14:00	95%	100%
0:00	90%	90%



THE FRONT VILLAGE

Check list



Daily check list

12/03/67


GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำดื่ม
8:00	A			27.6	18.05	/	/	15/300
14:00	A			22.06	18.05	✓	✓	15/300
0:00	A			27.6	18.05	✓	✓	15/300

BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			/	/	/	42	2	3				
15:00	A			/	/	/	42	2	3				
0:00	A			/	/	/	42	2	3				


Kirchen (น้ำดื่ม)		
Time	Exhaust NO.1	Overload
8:00	/	
14:00	✓	
0:00	X	



PUMP (ปั๊มน้ำ) TANK														
BOOSTER PUMP D			ON/OFF											
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			✓	✓									
15:00	D			✓	✗									
0:00	A			✓	✓									




WATER TANK		
Time	น้ำเค็ม%	น้ำจืด%
8:00	90%	85%
14:00	90%	95%
0:00	90%	90%



THE FRONT VILLAGE

Check list



Daily check list

13/03/67


GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	300L	✓
14:00	A			27.06	13.05	✓	✓	300L	✓
0:00	A			27.6	13.05	✓	✓	300L	✓

BOOSTER PUMP														
BOOSTER PUMP D			ON/OFF											
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


  

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✗		

PUEP (ถังเก็บน้ำTANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								




WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	95%	100%
14:00	90%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


14/05/67

GENERATOR								
	MODE			V	V	Distilled water	Bailer	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	1/2 300L
14:00	A			27.06	13.05	✓	✓	1/2 300L
0:00	A			27.6	13.05	✓	✓	1/2 300L


BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (น้ำ)		
Time	Exhaust NO.1	Overload
8:00	✓	
14:00	✓	
0:00	X	

PUEP (ถังน้ำ TANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	90%	95%
14:00	90%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list

15/03/67

GENERATOR								
	MODE			V	V	Distilled water	Bailer	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	ถังเก็บน้ำ	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	300L
14:00	A			27.05	13.05	✓	✓	300L
0:00	A			27.06.V	13.05.V	✓	✓	300L


BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8:00	✓	
14:00	✓	
0:00	✓	

PUEP (น้ำดื่ม) TANK														
BOOSTER PUEP D			ON/OFF											
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
15:00	A			X	X									
0:00	A			/	X									




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	90%	95%
14:00	95%	100%
0:00	90%	95%



THE FRONT VILLAGE

Check list



16/03/67


Daily check list

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	/	/	18 500Z	/
14:00	A			28.06	13.05	/	/	18 500Z	/
0:00	A			27.6.4	13.5.4	/	/	18 500Z	/


BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF											
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8:00	/	
14:00	X	
0:00	X	

PUMP (ถังน้ำ/TANK)													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	X								
15:00	P			X	X								
0:00	A			/	X								




WATER TANK		
Time	น้ำดื่ม%	น้ำเสียน%
8:00	90%	64%
14:00	90%	95%
0:00	90%	95%



# THE FRONT VILLAGE

## Check list



Daily check list

17/03/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	/	/	3002	/
14:00	A			22.06	13.05	/	/	3006	/
0:00	A			27.6	13.05	/	/	3006	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF										
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00	X		

PUEP (ถังน้ำ/TANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			X	X								
0:00	A			X	✓								




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	95%	95%
14:00	95%	90%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


18/03/67

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล
8:00	A			27.6	13.05	/	/	1/2 300L
14:00	P			27.96	13.05	✓	✓	1/2 300L
0:00	A			27.6	13.05	✓	✓	1/2 300L


BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	Water D
8:00	A			/	/	/	42	2	3				
15:00	P			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ปั๊ม) TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D	
8:00	A			/	X									
15:00	B			/	/									
0:00	A			X	✓									




WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	0.0%	0.0%
14:00	90%	90%
0:00	95%	100%



# THE FRONT VILLAGE

## Check list



Daily check list

11/03/67

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	3002
14:00	A			27.6	13.05	✓	✓	3006
0:00	A			27.6	13.05	✓	✓	3006


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	B			/	/	/	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
8:00	✓	
14:00	✓	
0:00	X	


11/03/67



PUMP (PUMPTANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	P			✓	✗									
0:00	A			✗	✓									




WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	95%	95%
14:00	95%	90%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


20/02/57

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	300L ✓
14:00	P			27.06	13.05	✓	✓	300L ✓
0:00	A			27.6	13.05	✓	✓	300L ✓


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF			psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2								
8:00	A			✓	✓	42	2	3					
15:00	P			✓	✓	42	2	3					
0:00	A			✓	✓	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
8:00	✓	
14:00	✓	
0:00	X	

PUEP (ถังน้ำ/TANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			✓	✓									
15:00	B			✓	✗									
0:00	A			✓	✓									




WATER TANK		
Time	น้ำดื่ม%	น้ำเสียน%
8:00	95%	100%
14:00	90%	95%
0:00	90%	90%



THE FRONT VILLAGE

Check list



46

Daily check list


21/03/67

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำขุ่น	น้ำมันดีเซล ขั้วแบตเตอรี่
8:00	A			27.6	13.03	✓	✓	1/2 300.2 ✓
14:00	A			27.6.2	13.05.2	✓	✓	1/2 300.4 ✓
0:00	A			27.6	13.05	✓	✓	1/2 300.4 ✓


BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	D			✓	✓	✓	42	2	3					

Kitchen (น้ำ)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✗		

PUMP ( ปั๊ม ) TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
15:00	A			/	X									
0:00	A			X	✓									




WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	95%	90%
15:00	90%	95%
0:00	95%	95%



THE FRONT VILLAGE

Check list



22/03/67


Daily check list

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	พริกน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	18.0	/	/	18/300L	/
14:00	A			27.6	18.0	/	/	18/300L	/
0:00	A			27.6	18.0	/	/	18/300L	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF			psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	49	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	/		
14:00	/		
0:00	X		

PUMP (ถังน้ำ TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			/	X								
15:00	B			/	/								
0:00	A			X	/								




WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	90%	95%
15:00	100%	98%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list

23.03.67

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	1/2 / 300L
14:00	B			27.1	13.00	✓	✓	1/2 (300L)
0:00	A			27.06V	13.05V	✓	✓	1/2 / 300L


BOOSTER PUMP													
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF							
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	B			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	/		
0:00	X		

PUEP (ปั๊มน้ำ TANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	B			X	X								
0:00	A			X	X								




WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00	95%	100%
15:00	100%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


24-03-67

GENERATOR								
MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8:00	A			22.6	13.09	✓	✓	1/300L
14:00	A			27.6	13.05	✓	✓	1/300L
0:00	B			22.01	13.05	✓	✓	1/300L


BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	B			✓	✓	✓	42	2	3				

Kirchen (ครัว)		
Time	Exhaust NO.1	Overload
	ON	OFF
8:00	X	X
14:00	X	
0:00		X

PUMP (ปั๊ม) (TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			X	✓									
15:00	A			X	✓									
0:00	D			✓	✓									




WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	95%	100%
14:00	95%	95%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list


25/3/67

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำขัง	ขั้วแบตเตอรี่
8:00	A			27.6	15.6	✓	✓	1/2 500L
14:00	A			27.6	13.6	✓	✓	1/2 500L
0:00	D			27.6	13.6	✓	✓	1/2 500L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF			psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	D			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	D			✓	✓	✓	42	2	3					

Kitchen (ห้อง)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		
14:00	✓		
0:00	✓		

PUEP (ถังน้ำ TANK)														
BOOSTER PUEP D		ON/OFF		ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			X	/									
15:00	A			X	/									
0:00	D			X	/									




WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8:00	95%	100%
14:00	95%	95%
0:00	90%	100%



THE FRONT VILLAGE

Check list



Daily check list

26/03/67


GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำแบตเตอรี่
8:00	A			27.6	13.05	/	/	300L
14:00	A			27.6	13.05	/	/	300L
0:00								

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF			psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00														


Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	/		
14:00	/		
0:00			



PUEP (ปั๊มน้ำTANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
15:00	A			X	/									
0:00														




WATER TANK		
Time	น้ำเต็ม%	น้ำเหลือ%
8:00	95%	100%
14:00	90%	95%
0:00		



THE FRONT VILLAGE

Check list



Daily check list


27/03/24

GENERATOR									
	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.06	13.05	/	/	25 / 300L	/
14:00	A			27.6	13.05	/	/	13 / 300L	/
0:00	A			27.6	13.05	/	/	12 / 300L	/


BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	12	2	3					
15:00	A			/	/	/	12	2	3					
0:00	A			/	/	/	12	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00		X	

PUMP (ปั๊ม) (TANK)													
BOOSTER PUMP D			ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	A			✓	✓								
0:00	A			X	X								




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	90%	95%
14:00	95%	100%
0:00	95%	90%



THE FRONT VILLAGE

Check list



Daily check list


28/03/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	1/2 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 300L	✓
0:00	A			27.6	13.05	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	X		

PUEP (บ้าน ) WATER TANK													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			/	/								
0:00	A			/	/								




WATER TANK		
Time	น้ำเต็ม %	น้ำเต็ม %
8:00	90%	90%
14:00	0.5%	0.5%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


29/03/67.

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	ขั้วแบตเตอรี่
8:00	A			27.06	13.05	/	/	360L
14:00	A			27.06	13.05	/	/	360L
0:00	P			27.06	13.05	/	/	360L


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	B			/	/	/	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00		/	

PUMP (ปั๊ม) TANK													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/								
15:00	A			/	/								
0:00	A			/	/								




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	95%	100%
14:00	90%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


30/03/67

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	1/2 / 300L
14:00	A			27.6	13.05	✓	✓	1/2 / 300L
0:00	A			27.6	13.05	✓	✓	1/2 / 300L


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (กitchen)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		

PUEP (ปั๊ม) (TANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	A			✓	X								
0:00	A			✓	X								




WATER TANK		
Time	น้ำดื่ม%	น้ำร้อน%
8:00	90%	95%
14:00	90%	59%
0:00	93%	100%



# THE FRONT VILLAGE

## Check list




Daily check list  
31/05/12

GENERATOR									
Time	MODE			V	V	Distilled water	Butler	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	ถังน้ำดื่ม	ถังน้ำดื่ม	ถังน้ำมัน	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	1/2 200h	✓
14:00	A			27.6	13.05	✓	✓	1/2 200h	✓
0:00	A			27.6	13.05	✓	✓	1/2 200h	✓


BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kirichen (n7)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		X	

PUMP (WATER TANK)													
BOOSTER PUMP D		ON/OFF		ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	✓			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	Water %	Water %
8:00	95%	10%
15:00	90%	25%
0:00		



THE FRONT VILLAGE

Check list

Daily check list


01/04/67

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	แบตเตอรี่
8:00	A			27.6	13.5	✓	✓	1/2 300L. ✓
14:00	A			27.6	13.5	✓	✓	1/2 300L. ✓
0:00	B			27.6	13.5	✓	✓	1/2 300L. ✓


BOOSTER PUMP															
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/	/	42	2	3						
15:00	A			/	/	/	42	2	3						
0:00	B			/	/	/	42	2	3						

Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
8:00	ON	OFF
14:00	✓	
0:00	✓	

PUEP (ถังน้ำ/TANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
15:00	A			/	X									
0:00	A			/	/									




WATER TANK		
Time	น้ำดิบ%	น้ำดี%
8:00	95%	100%
14:00	90%	95%
0:00		





THE FRONT VILLAGE

Check list



Daily check list


02/04/67.

GENERATOR									
Time	MODE			V		Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.06	13.05	✓	✓	1/2 660L	✓
14:00	A			27.06	11.05	✓	✓	1/2 660L	✓
0:00	B			27.06	13.05	✓	✓	1/2 660L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	B			✓	✓	✓	42	2	3					

Kitchen (ห้อง)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		✓	

PUMP (WITH TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			/	/									
0:00	A			/	/									



WATER TANK		
Time	น้ำดื่ม	น้ำประปา
8:00	98%	95%
14:00	90%	85%
0:00	95%	92%



THE FRONT VILLAGE

Check list:

Daily check list


03/04/62

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อไอน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.00	✓	✓	1/2 / 000	✓
14:00	A			27.6	13.05	✓	✓	1/2 / 000	✓
0:00									


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00														

Kitchen (P17)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00			

BOOSTER PUMP (WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			✓	✓									
15:00	A			✓	✓									
0:00														



WATER TANK		
Time	MAN	PSI
8:00	95%	100.2
15:00	95%	91.5
0:00		



THE FRONT VILLAGE

Check list

Daily check list

04/04/61

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	✓			27.6	19.06	✓	✓	18/300L	✓
14:00	A			27.6	19.06	✓	✓	19/300L	✓
0:00	A			27.6	13.03	✓	✓	1/3/300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	47	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (ห้อง)			
Time	Exhaust NO.1	Overload	
8:00	ON		
14:00	ON		
0:00	X		

PUMP (PUMP/TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	X								
15:00	A			/	X								
0:00	A			+	✓								

WATER TANK		
Time	น้ำดื่ม%	น้ำร้อน%
8:00	95%	100%
14:00	90%	95%
0:00	90%	95%

THE FRONT VILLAGE

Check list

Daily check list


05/04/68.

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	/	/	300L
14:00	A			27.6	13.05	/	/	300L
0:00	A			27.6	13.05	/	/	300L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		/	/	/	42	2	3						
15:00	A		/	/	/	42	2	3						
0:00	A		/	/	/	42	2	3						

Kitchen (K12)			
Time	Exhaust NO.1	ON	OFF
8:00	/		
14:00	/		
0:00	X		

PUMP (3000 L/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			/	/									
0:00	A			/	/									



WATER TANK		
Time	น้ำดื่ม	น้ำร้อน
8:00	95%	90%
14:00	95%	90%
0:00	95%	90%



THE FRONT VILLAGE

Check list

Daily check list


6/6/07

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	ถังน้ำดื่ม	หม้อน้ำ	ถังน้ำมัน	ขั้วแบตเตอรี่
8:00	A			27.6	13.0	/	/	1/2 / 200	/
14:00	A			27.5	13.6	/	/	1/2 / 300	/
0:00	A			27.6	13.6	/	/	1/2 / 300	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	CUT OFF	CN/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00	X		

TILE PUMP TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	PI	Shorage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			/	/									
0:00	A			/	/									



WATER TANK		
Time	Level	Temp
8:00	95%	100%
15:00	95%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list


02/02/02

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Exhaust fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	แบตเตอรี่	น้ำมันเชื้อเพลิง	ขั้วแบตเตอรี่
8:00	A			28.6	13.06	/	/	1/2 300L	/
14:00	A			27.6	13.06	/	/	1/2 300L	/
0:00	A			27.6	13.06	/	/	1/2 300L	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
14:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (K13)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	/		
14:00	/		
0:00	X		

BOOSTER PUMP D														
	AUTO	MAN	ONOFF OFF	ONOFF PI										
						psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	B			✓	✓									
15:00	A			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	Inlet	Outlet
8:00	100%	100%
14:00	100%	100%
0:00	90%	95%



## THE FRONT VILLAGE

## Check list

Daily check list

02/06/22

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	ถังเก็บน้ำ	ถังน้ำ	ถังน้ำมัน	ขั้วแบตเตอรี่
8:00	A			22.06	13.06	✓	✓	1/2 300L	✓
14:00	A			27.06	13.06	✓	✓	1/2 300L	✓
0:00	A			27.06	13.06	✓	✓	1/2 300L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
Time	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (P2)			
Time	Exhaust NO.1		Overload
8:00	✓		
14:00	✓		
0:00	✗	✗	

PUMP (WATER TANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Storage	PWR	CPU	COM	Water D
Time	AUTO	MAN	OFF	P1	P2									
8:00	A			✓	✗									
15:00	A			✓	✓									
0:00	A			✓	✗									

WATER TANK		
Time	IN	OUT
8:00	10%	15%
14:00	15%	15%
0:00	0.5%	0.5%



THE FRONT VILLAGE

Check list

Daily check list


09/09/67

GENERATOR									
Time	MODE			V	V	Distilled water	Water	Diesel fuel	Parity Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	ดีเซล	พาริตี้
8:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓
14:00									
0:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				CNOFF	ON/OFF	ON/OFF								
Time	AUTO	MAN	OFF	P1	P2	P3	psi	LOV	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00														
0:00	A			✓	✓	✓	42	2	3					

Kitchen (NY)			
Time	Exhaust NO.1		Overload
8:00	✓		
14:00			
0:00	X	X	

BOOSTER PUMP														
BOOSTER PUMP D				CNOFF	ON/OFF	ON/OFF								
Time	AUTO	MAN	OFF	P1	P2	P3	psi	LOV	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00														
0:00	A			✓	X									



WATER TANK		
Time	Water Level	Water Level
8:00	10%	10%
14:00		
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list


10/09/67.

GENERATOR									
Time	MODE			V	V	Distilled water	Exhaust	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	Water	Oil	Exhaust	Terminals
8:00	A			27.6	13.05	✓	✓	1/2 / 500L	✓
14:00	A			27.6	13.05	✓	✓	1/2 / 500L	✓
0:00	A			27.6	13.05	✓	✓	1/2 / 500L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (R72)			
Time	Exhaust NO.1	Overload	
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		✓	

PUMP (G31) (WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			/	/									
0:00	B			/	/									



WATER TANK		
Time	Water Level	Water Level
8:00	95%	90%
14:00	100%	100%
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list

11/04/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.6	/	/	1/2 300L	/
14:00	A			27.6	13.6	/	/	1/2 300L	/
0:00	A			27.6	13.6	/	/	1/2 300L	/

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					


Kitchen (N33)			
Time	Exhaust NQ.1		Overhaul
	ON	OFF	
8:00	/		
14:00	/		
0:00	X	X	

TUBE (TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			/	/									
0:00	A			/	X									

WATER TANK		
Time	Water %	Water %
8:00	100%	100%
14:00	100%	100%
0:00	95%	100%

THE FRONT VILLAGE

Check list



Daily check list


12/01/13

GENERATOR									
Time	MODE			V		Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยาล้าง	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	B			22.6	13.06	✓	✓	1/2 360L	✓
14:00	A			27.6	13.6	✓	✓	1/2 500L	✓
0:00	A			27.6	19.6	✓	✓	1/2 400L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓	✓	42	7	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (R70)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✗	✗	

PUMP (WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	B			✓	✓									
15:00	A			✓	✓									
0:00	A			✓	✗									



WATER TANK		
Time	น้ำดื่ม%	น้ำยาล้าง%
8:00	70%	75%
14:00	100%	100%
0:00	65%	65%



THE FRONT VILLAGE

Check list

Daily check list


13/04/67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			97.6	13.05	✓	✓	1/2/3001	✓
14:00	A			97.6	13.0	✓	✓	/	✓
0:00	A			97.6	13.5	✓	✓	1/9/3001	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
	✗	✗	

PUMP (ถังน้ำ)														
BOOSTER PUMP B			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	B			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	น้ำดื่ม	น้ำใช้
8:00	100%	100%
14:00	100%	100%
0:00	2.5/	2.5/



## THE FRONT VILLAGE

## Check list

Daily check list


14/04/67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.09	✓	✓	1/2/300L	✓
14:00	A			27.6	13.6	✓	✓	1/2/300L	✓
0:00	A			27.6	13.09	✓	✓	1/2/300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	FWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ก13)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		X	

PUMP ( 034 TANK )														
BOOSTER PUMP D		ON/OFF		ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	FWR	CPU	COM	Water D	
8:00	A			X	✓									
15:00	A			X	X									
0:00	A			X	X									



WATER TANK		
Time	น้ำดื่ม	น้ำใช้
8:00	90%	100%
14:00	80%	45%
0:00	85%	85%



THE FRONT VILLAGE

Check list

Daily check list

15/04/67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	ดีเซล	ขั้วแบตเตอรี่
8:00									
14:00	A			27.6	13.5	—	—	1/2/3 OK	—
0:00	A			27.6	13.05	—	—	1/2/3 OK	—

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00														
15:00	A		—	—	—	42	2	3						
0:00	A		—	—	—	42	2	3						

Kitchen (K73)			
Time	Exhaust NO.1	ON	OFF
8:00			
14:00	—		
0:00		X	

PUMP (HYD TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00														
15:00	A			/	/									
0:00	A			/	/									

WATER TANK		
Time	Water	Temp
8:00	90%	95%
14:00	90%	95%
0:00	95%	95%



THE FRONT VILLAGE

Check list

Daily check list


16/11/21

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล
8:00	A			17.6V	13.5V	✓	✓	1/2 / 500L
14:00	A			22.6V	13.5V	✓	✓	2 / 990L
0:00	A			27.6V	13.5V	✓	✓	1/2 / 800


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	B			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	7					

Kitchen (ห้อง)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00		X	
0:00		X	

PUMP (ถังน้ำTANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LCW	LC	Storage	PWR	CPU	COM	Water D	
8:00	A			X	✓									
15:00	B			X	X									
0:00	A			/	X									



WATER TANK		
Time	High %	Low %
8:00	90%	95%
14:00	95%	95%
0:00	95%	95%



THE FRONT VILLAGE

Check list

Daily check list

17-00-67

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำเค็ม	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	1/2 / 300L
14:00	A			27.6	13.05	✓	✓	1/2 / 300L
0:00	A			22.6	13.05	✓	✓	1/2 / 300L

BOOSTER PUMP													
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Storage	PWR	CPU	COM
Time	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI				Water D
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (น้ำ)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		
14:00	✓		
0:00		✗	

PUMP (TANK)													
BOOSTER PUMP D				ON/OFF	ON/OFF	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
Time	AUTO	MAN	OFF	P1	P2	psi	LOW	HI					
8:00	A			✗	✓								
15:00	A			✓	✓								
0:00	A			✗	✗								

WATER TANK		
Time	น้ำดื่ม	น้ำเค็ม
8:00	79%	100%
14:00	100%	100%
0:00	95%	90%

## THE FRONT VILLAGE

## Check list

Daily check list


18-04-67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓
14:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓
0:00	A			27.6	13.05	✓	✓	1/2 / 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (A73)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		X	

PUMP (WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	+									
15:00	A			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	Water Level	Water Level
8:00	95%	95%
14:00	95%	95%
0:00	95%	95%



## THE FRONT VILLAGE

## Check list

Daily check list

19/04/68.

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Used fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	MINUS	PLUS	MINUS	PLUS
8:00	A			27.6	19.5	/	/	20.500L	/
14:00	A			27.6	19.5	/	/	1/2 300L	/
0:00	A			27.6	19.5	/	/	1/2 300L	/

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	H1	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (H2)		
Time	Exhaust NO.1	
	ON	OFF
8:00	/	
14:00	/	
0:00		X

PUMP (TANK)													
BOOSTER PUMP B			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	H1	Shortage	PWR	CPU	COM	Water D
8:00	A			/	X								
15:00	A			/	/								
0:00	A			/	X								

WATER TANK		
Time	100%	100%
8:00	100%	100%
14:00	100%	100%
0:00	100%	100%

THE FRONT VILLAGE

Check list

Daily check list


20/01/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำเชื้อเพลิง	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	/	/	1/2 500L	/
14:00	A			27.6	13.05	/	/	1/2 300L	/
0:00	A			27.6	13.05	/	/	1/2 500L	/


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	LT	Shortage	PWR	CPU	COM	Water D
8:00	A			/	/	/	42	2	3					
15:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kirchen (n72)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	/		
14:00	/		
0:00		X	

TOWER (WITH WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW		Shortage		PWR	CPU	COM	Water D
8:00														
15:00	A			/	/									
0:00	A			/	/									



WATER TANK		
Time	น้ำกลั่น	น้ำเชื้อเพลิง
15:00		
14:00		
13:00	95%	100%
12:00	100%	90%



THE FRONT VILLAGE

Check list

Daily check list


21/04/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			20.6	13.05	✓	✓	1/2 Good	✓
14:00	A			27.6	13.05	✓	✓	2 300L	✓
0:00	A			27.6	13.06	✓	✓	1/2 300L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	P			✓	✓	✓	42	0	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (n13)			
Time	Exhaust NO.1		Overload
8:00	✓		
14:00	✓		
0:00	✓	✗	

PUMP (WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	P			✓	✓									
15:00	A			✓	✓									
	A			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	Water %	Water %
8:00	100%	100%
14:00	100%	100%
0:00	100%	100%



THE FRONT VILLAGE

Check list

Daily check list


77-00-67

GENERATOR								
Time	MODE			V	V	Discharged	Battery	Steady Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	Volts	Volts	Volts
8:00	A			27.6	13.05	✓	✓	1/290L
14:00	A			27.6	13.05	✓	✓	1/290L
0:00	A			27.6	13.05	✓	✓	1/290L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	PI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (NTA)		
Time	Exhaust NO.1	Overload
8:00	ON	OFF
14:00	ON	OFF
0:00	ON	OFF

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	PI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						



WATER TANK		
Time	High	Low
8:00	90%	90%
14:00	90%	90%
0:00	90%	90%





## THE FRONT VILLAGE

## Check list

Daily check list

23/10/68

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F / 290L	✓
14:00	A			27.6	13.05	—	—	1 / 290L	—
0:00	A			27.6	13.05	—	—	1 / 290L	—

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LC	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			—	—	—	42	2	3					
0:00	A			—	—	—	42	2	3					

Kitchen (P13)		
Time	Exhaust NO.1	
	ON	OFF
8:00		X
14:00	—	
0:00		X

PUMP (BATH TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			X	✓									
15:00														
	A			X	✓									
0:00	A			X	✓									

WATER-TANK		
Time	Water Level	Water Level
8:00	90%	95%
14:00	100%	100%
0:00	25%	25%

THE FRONT VILLAGE

Check list

Daily check list


24/04/67

GENERATOR									
Time	MODE			V	V	Distilled water	Battery	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A								
14:00	A			27.6	13.05	✓	✓	1/2 / 480	✓
0:00	A			27.6	13.05	✓	✓	F / 480L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00														
15:00	A			✓	✓	✓	42	2	3	✓				
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ห้อง)			
Time	Exhaust NO.1	Overload	
	ON	OFF	
8:00			
14:00	✓		
0:00		✓	

PUMP (น้ำดื่ม) TANK														
BOOSTER PUMP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D	
8:00														
15:00	A			✓	✓									
0:00	A			✓	✓									



WATER TANK		
Time	Water %	Water %
8:00		
15:00	100%	100%
0:00	100%	100%



## THE FRONT VILLAGE

## Check list

Daily check list

25-04-67

GENERATOR									
Time	MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F / 480L	✓
14:00	A			27.6	13.05	✓	✓	F / 480	✓
0:00	A			27.6	13.05	✓	✓	F / 480L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (กitchen)		
Time	Exhaust NO.1	Overload
8:00	ON	OFF
14:00	✓	
0:00	✓	

PUMP (33111) TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage		FWR	CPC	COM	Water D
8:00	A			X	✓									
15:00	A			/	/									
0:00	A			/	/									

WATER TANK		
Time	MAN %	MAN %
8:00	45%	90%
14:00	45%	90%
0:00	100%	100%

THE FRONT VILLAGE

Check list

Daily check list


26/04/02

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยาล้าง	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	P			27.6	13.05	✓	✓	F / 420L	✓
14:00	A			27.6	13.02	✓	✓	F / 420L	✓
0:00	A			27.6	13.05	✓	✓	F / 420L	✓


BOOSTER PUMP													
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF							
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	P			✓	✓	✓	42	2	3				Water D
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (P1)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		✓	

BOOSTER PUMP D													
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	P			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	Water Level	Water Level
8:00	100%	100%
14:00	100%	100%
0:00	100%	100%



THE FRONT VILLAGE

Check list

Daily check list

27-01-67

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	พื้ล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F/410L ✓
14:00	A			27.6	13.05	✓	✓	F/410L ✓
0:00	A			27.6	13.05	✓	✓	F/410L ✓

BOOSTER PUMP														
BOOSTER PUMP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
13:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (กitchen)			
Time	Exhaust NO.1	ON	OFF
8:00	✓		
14:00	✓		
0:00		✗	

PUMP CONTROLLER														
BOOSTER PUMP D			DI/OFF	DN/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			X	✓									
15:00	A			✓	✓									
0:00	A			✓	X									

WATER TANK		
Time	High	Low
8:00	95%	100%
14:00	95%	100%
0:00	95%	100%

THE FRONT VILLAGE

Check list

Daily check list


28/01/67.

GENERATOR									
Time	MODE			V	V	Distilled water	Dalier	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยาล้าง	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F / 410L	✓
14:00	A			27.6	13.05	✓	✓	F / 410L	✓
0:00	A			27.6	13.05	✓	✓	F / 410L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P3								
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		✗	

TUEP (THERMOTANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF		psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2									
8:00	A			✗	✓									
15:00	A			✗	✓									
0:00	A			✗	✗									



WATER TANK		
Time	High %	Low %
8:00	75%	97.5%
14:00	40%	90.5%
0:00	100%	100%



## THE FRONT VILLAGE

## Check list

Daily check list

27/02/67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			22.6	13.05	✓	✓	F/410L	✓
14:00	A			22.6	13.05	✓	✓	F/410L	✓
0:00	A			22.6	13.05	✓	✓	F/410L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						

Kitchen (K73)		
Time	Exhaust NO.1	Overload
8:00	ON	
14:00	ON	
0:00	ON	

## THE FRONT VILLAGE

## Check list

Daily check list

30/04/67


GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F/410L	✓
14:00	A			27.6	13.05	✓	✓	F/410L	✓
0:00	A			27.6	13.05	✓	✓	F/410L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
AUTO	MAN	OFF	P1	P2	P3									
8:00	A		✓	✓	✓	42	2	3						
15:00	A		✓	✓	✓	42	2	3						
0:00	A		✓	✓	✓	42	2	3						


Kitchen (K73)		
Time	Exhaust NO.1	Overload
8:00	ON	
14:00	ON	
0:00	ON	



BOOSTER PUMP D													
	AUTO	MAN	ON/OFF	ON/OFF									
Time			OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	100%	100%
8:00	90%	95%
15:00	95%	100%
0:00	95%	95%



THE FRONT VILLAGE

Check list



Daily check list


01/05/12  
01/05/12

GENERATOR									
Time	MODE	V	V	Distilled water	B. filter	Discol. fuel	Battery terminals		
	AUTO	MAN	OFF	BATT.1	BATT.2				
8:00	B			27.6V	13.05	✓	✓	F 410L	✓
14:00	A			27.6V	13.5V	✓	✓	F 410L	✓
0:00	P			27.6V	13.5V	✓	✓	F 410L	✓


BOOSTER PUMP													
	AUTO	MAN	ON/OFF	ON/OFF	ON/OFF								
Time			OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM
8:00	P			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	P			✓	✓	✓	42	2	3				

Kitchen (N73)		
Time	Exhaust NO.1	Overload
	ON	OFF
8:00	✓	
14:00	✓	
0:00		✓

PUMP (BOOSTER PUMP)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	PI	12	1st	2nd	3rd	Storage	PWR	CPU	COM	Water D
8:00	P			X	X								
15:00	A			X	X								
0:00	P			X	X								




WATER TANK		
1st	2nd	
75%	75%	
85%	85%	
95%	95%	



# THE FRONT VILLAGE

## Check list



Daily check list


02/05/67

GENERATOR								
	MODE			V	V	Distilled water	Bailer	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	ถังเก็บน้ำ	ถังเก็บน้ำ	ถังเก็บน้ำ
8:00	A			27.6	13.05	✓	✓	F 410L
14:00	A			27.6	13.5	✓	✓	F 410L
0:00	A			27.6	13.05	✓	✓	F 410L


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	F1	F2	F3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (K12)		
Time	Exhaust NO.1	Overload
	ON	OFF
8:00		X
14:00	✓	X
0:00	X	

PUMP (ISHIMTANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	A			✓	✗									
0:00	A			✓	✓									



WATER TANK		
Time	IN %	OUT %
8:00	95%	95%
14:00	95%	95%
0:00	100%	95%



THE FRONT VILLAGE

Check list

Daily check list


03/05/12

GENERATOR								
Time	MODE			V		Distilled water	Water	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำมันดีเซล
8:00	P			27.6	13.05	✓	✓	F. 410L
14:00	A			27.6-V	13.0-V	✓	✓	F. 410L
0:00	A			27.6	13.05	✓	✓	F. 410L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	P			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (NTS)		
Time	Exhaust NO.1	Overload
	ON	OFF
8:00	✓	
14:00	✓	
0:00	✓	

PUMP (GSH) TANK													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✗								
12:00	A			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	High %	Low %
8:00	90%	95%
12:00	90%	90%
0:00	95%	100%



THE FRONT VILLAGE

Check list:

Daily check list


24/05/17

GENERATOR								
Time	MODE			V	V	Battery Voltage	Battery	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	VOLTS	AMPS	TEMPERATURE
8:00	✗			22.6	13.05	✓	✓	40°C
14:00	A			27.6V	13.5V	✓	✓	40°C
0:00	A			27.6	13.05	✓	✓	40°C


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (A1)		
Time	Exhaust NO.1	Overhaul
	ON	OFF
8:00	✓	
14:00	✓	
0:00	✗	

FUEL (GSH) TANK													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								




WATER TANK		
Time	100%	100%
8:00	10%	0%
14:00	90%	90%
0:00	15%	100%



THE FRONT VILLAGE

Check list



Daily check list

05-05-67.

GENERATOR									
Time	MODE			V		Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F/410L	✓
14:00	B			27.6	13.05	✓	✓	F/410L	✓
0:00	A			27.6	13.05	✓	✓	F/410L	✓


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (822)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00		X	
14:00	✓		
0:00	X		

PUEP (ปั๊มสูบน้ำ)													
BOOSTER PUEP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	11:00%	11:00%
8:00	90%	90%
14:00	100%	100%
0:00	95%	100%



THE FRONT VLY 107  
Check list




Daily check list  
06/05/24

GENERATOR									
Time	MODE			V	V	Distilled water	BzLr	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	Water	Water	Water	Water
8:00	A			27.6	13.05	✓	✓	F 410L	✓
14:00	A			27.6	13.05	✓	✓	F 410L	✓
0:00	A			27.6	13.05	✓	✓	F 410L	✓


PUEP (ปั๊มสูบน้ำ)														
BOOSTER PUEP D			ON/OFF		ON/OFF		ON/OFF							
	AUTO	MAN	OFF	P1	P2	P3	P4	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	B			✓	✓	✓	49	2	3					
15:00	A			✓	✓	✓	49	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (073)		
Time	Exhaust NO.1	Overload
8:00	✓	
14:00	✓	
0:00		X

PUMP (SHIMTANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	1st	LOW	2nd	Storage	PWR	CPU	COM	Water D
8:00	P			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								




WATER TANK		
Time	1st	2nd
8:00		
15:00		
0:00	90%	90%
	95%	95%



# THE FRONT VILLAGE

## Check list



Daily check list

07/05/67

GENERATOR									
	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำดับไฟ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.05	13.05	✓	✓	F 410L	✓
14:00	A			27.6V	13.5V	✓	✓	F 410L	✓
0:00	A			27.6	13.05	✓	✓	F 410L	✓


BOOSTER PUMP													
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF							
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				


Kitchen (น้ำ)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		



BOOSTER PUMP D													
	AUTO	MAN	ON/OFF	ON/OFF									
			OFF	PI	P2	psi	LOW	III	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	A			✓	X								
0:00	A			✓	X								



WATER TANK		
Time	110%	110%
8:00	95%	95%
15:00	95%	95%
0:00	95%	100%



# THE FRONT VILLAGE

Check list

Daily check list


08/05/67

GENERATOR									
	MODE			V	V	Disinfect water	Batter	Disinfect fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำมัน	น้ำมัน	น้ำมัน	น้ำมัน
8:00	A			27.6	13.05	✓	✓	F 410L	✓
14:00	A			27.6	13.5	✓	✓	F 410L	✓
0:00	A			27.6	13.05	✓	✓	F 410L	✓


BOOSTER PUMP													
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF							
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	III	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (n73)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

BOOSTER PUMP D													
	AUTO	MAN	ON/OFF	ON/OFF									
			OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00													
0:00	A			X	✓								




WATER TANK		
Time	Water	Water
8:00	90%	75%
15:00	90%	95%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list

10/05/02  
9/05/02


GENERATOR								
Time	MODE	V	V	Distilled water	Boiler	Diesel fuel	Battery Terminals	
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อต้มน้ำ	น้ำมันเชื้อเพลิง
8:00	✓			27.6	13.5	✓		น้ำกลั่น 410L
14:00	A			27.6	13.5	✓	✓	F 410L
0:00	A			27.6	13.05	✓	✓	F 410L

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	✓			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


  

Kitchen (ห้องครัว)		
Time	Exhaust NO.1	Overload
	ON	OFF
8:00	✓	
14:00	✓	
0:00	✓	

PUMP (ปั๊ม) TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	✓			✓	✓									
15:00	A			✗	✓									
0:00	A			✓	✓									




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	100%	100%
14:00	90%	95%
0:00	100%	100%



THE FRONT VILLAGE

Check list



Daily check list

10/05/12

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			28.6	13.05	✓	✓	F 410L	✓
14:00	A			27.6V	13.5V	✓	✓	F 410L	✓
0:00	A			27.6V	13.5V	✓	✓	F 40L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (กitchen)		
Time	Exhaust NO.1	Overload
8:00	ON	OFF
14:00	✓	
0:00	x	

PUMP (ปั๊ม) TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	0			✓	✗									
15:00	A			✓	✓									
0:00	A			✓	✓									




WATER TANK		
Time	น้ำดื่ม%	น้ำกลั่น%
8:00	95%	90%
14:00	90%	90%
0:00	95%	95%



# THE FRONT VILLAGE

## Check list



Daily check list:


11/05/67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F / 410L	✓
14:00	A			27.6	13.5	✓	✓	F / 410L	✓
0:00	A			27.6	13.5	✓	✓	F / 410L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
8:00	✓	
14:00	✓	
0:00	✓	

PUMP (ปั๊ม) (TANK)													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			X	✓								
15:00	A			✓	✓								
0:00	A			✓	✓								




WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8:00	90%	90%
15:00	90%	95%
0:00	95%	95%



THE FRONT VILLAGE

Check list



Daily check list


12/15/17

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำดื่ม
8:00	A			27.06	13.05	✓	✓	✓
14:00	A			27.06	13.05	✓	✓	✓
0:00	A			27.6	13.05	✓	✓	✓


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF										
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ครัว)		
Time	Exhausts NO.1	Overload
8:00	X	
14:00	✓	
0:00	X	

PUMP (ปั๊ม) WATER TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	D			✓	✓									
15:00	A			✓	✓									
0:00	A			✓	✓									




WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	90%	95%
14:00	95%	95%
0:00	100%	100%



THE FRONT VILLAGE

Check list



Daily check list


13/5/67

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล
8:00								
14:00	A			27.6	13.05	✓	✓	F 410L
0:00	A			27.6	13.05	✓	✓	F 410L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR.	CPU	COM	Water D
8:00	M			✓	✓	✓	42	2	3					
15:00														
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8:00		
14:00	✓	
0:00		✓

PUMP (ปั๊ม) (TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00													
15:00	A			X	✓								
0:00	A			✓	X								




WATER TANK		
Time	น้ำดื่ม%	น้ำประปา%
8:00		
15:00	90%	95%
0:00	95%	95%



# THE FRONT VILLAGE

## Check list



Daily check list


10/05/67

GENERATOR								
MODE			V	V	Distilled water	Boiler	Diesel fuel	Battery Terminal
Time	AUTO	MAN	OFF	BATT.1	BATT.2	ถังเก็บ	หม้อน้ำ	ถังน้ำมัน
8:00								
14:00	A			27.6	13.05	✓	✓	F/410L ✓
0:00	A			27.6v	13.5v	✓	✓	F/410L ✓


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00													
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
8:00		
14:00	✓	
0:00	X	

PUMP (ปั๊ม) WATER TANK													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00													
15:00	A			X	✓								
0:00	A			✓	X								




WATER TANK		
Time	น้ำเต็ม %	น้ำเหลือ %
8:00		
14:00	90%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list

15/05/67


GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	TFU น้ำดีเซล	TVRS น้ำแบตเตอรี่
8:00	A			12.6	13.05	✓	✓	F 410L	✓
14:00	A			12.6	13.05	✓	✓	F 410L	✓
0:00	A			12.6	13.5	✓	✓	F 410L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	D			42	2	3								
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
8:00	✓	
14:00	✓	
0:00	X	



PUMP (ปั๊ม) WATER TANK													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shorage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✗	✓								
0:00	A			✓	✗								




WATER TANK		
Time	น้ำดื่ม %	น้ำดิบ %
8:00	90%	75%
14:00	90%	100%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list

16/05/67.

GENERATOR								
Time	MODE			V		Distilled water	Boiler	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	หม้อน้ำ	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F 4102 ✓
14:00	A			27.6	13.05	✓	✓	F 4102 ✓
0:00	A			27.6.v	13.5.v	✓	✓	F 4102 ✓


BOOSTER PUMP

BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shotage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


Kitchen (ห้องครัว)

Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✗		

PUEP (ถังน้ำ TANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			/	/									
13:00	B			x	/									
0:00	A			/	x									




WATER TANK		
Time	น้ำดื่ม%	น้ำดี%
8:00	95%	100%
14:00	90%	100%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


17/08/67.

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00									
14:00	A			27.6	13.05	/	/	F 4102	/
0:00	A			27.6.V	13.5.V	/	/	F 410.1	/


BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00														
13:00	A			/	/	/	42	2	3					
0:00	A			/	/	/	42	2	3					

Kitchen (ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8:00		
14:00	/	
0:00	x	

PUMP (ปั๊ม) TANK													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00													
15:00	A			✓	✓								
0:00	A			✓	✓								




WATER TANK		
Time	น้ำดื่ม	น้ำประปา
8:00		
15:00	100%	100%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


13/05/67

GENERATOR								
	MODE			V	V	Distilled water	Bailer	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	เบสิล	น้ำมันดีเซล
8:00	A			22.6	13.05	✓	✓	F 410L
14:00	A			22.6	13.05	✓	✓	F 410L
0:00	A			22.6	13.05	✓	✓	F 410L


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ห้อง)		
Time	Exhaust NO.1	
	ON	OFF
8:00	✓	
14:00	✓	
0:00	✓	

FUEL (น้ำมันTANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓								
15:00	B			✓	✓								
0:00	A			✓	✓								




WATER TANK		
Time	น้ำดื่ม%	น้ำจืด%
8:00	90%	95%
14:00	95%	100%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list


19/65/17

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำจืด	น้ำดื่ม
8:00	A			27.6	15.05	✓	✓	✓
14:00	A			27.6	13.05	✓	✓	✓
0:00	A			27.6	13.5	✓	✓	✓


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✗		

PUEP (43H) (W/TANK)													
BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	x								

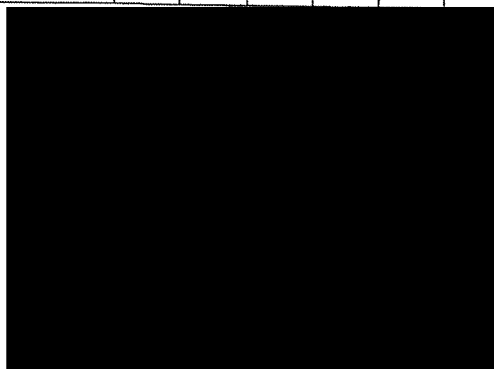


WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8:00	95%	90%
15:00	90%	100%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


9265/158

GENERATOR								
	MODE			V	V	Distilled water	Boiler	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำดื่ม	น้ำดื่ม
8:00	B			22.6	13.05	✓	✓	F / 410.1
14:00	A			24.6	13.05	✓	✓	F / 410.1
0:00	A			27.6.v	13.5.v	✓	✓	F / 410.1


BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM
8:00	B			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ก74)		
Time	Exhaust NO.1	
	ON	OFF
8:00	✓	
14:00	✓	
0:00	x	

PUMP (ปั๊ม) TANK														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	B			✓	✓									
15:00	A			✗	✓									
0:00	A			✓	✗									



WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	90%	95%
15:00	90%	90%
0:00	90%	90%



THE FRONT VILLAGE

Check list



Daily check list

21/05/15

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำประปา	น้ำประปา
8:00	B			27.6	13.05	✓	✓	✓
14:00	A			27.6	13.05	✓	✓	✓
0:00	A			27.6V	13.5V	✓	✓	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (กitchen)		
Time	Exhaust NO.1	Overload
8:00	ON	OFF
14:00	✓	
0:00	✗	

PUMP (ปั๊ม) TANK													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	FWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	A			✓	✓								
0:00	A			✓	✗								




WATER TANK		
Time	น้ำดื่ม %	น้ำใช้ %
8:00	100%	100%
14:00	95%	90%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list


12/05/12

GENERATOR									
MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals	
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำใช้	น้ำดื่ม	น้ำใช้
8:00	A			27.6	13.05	✓	✓	F. 410L	✓
14:00	A			27.6	13.05	✓	✓	F. 410L	✓
0:00	A			27.6V	13.5V	✓	✓	F. 410L	✓


BOOSTER PUMP													
BOOSTER PUMP D			ON/OFF		ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	FWR	CPU	COM
8:00	A			✓	✓	✓	42	2	3				
15:00	A			✓	✓	✓	42	2	3				
0:00	A			✓	✓	✓	42	2	3				

Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
8:00	✓	
14:00	✓	
0:00	✗	

PUMP (ปั๊ม) (TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	P			✓	✓									
15:00	A			✗	✓									
0:00	A			✓	✗									




WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	90%	95%
14:00	90%	95%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list

23/05/67.

GENERATOR									
Time	MODE			V		Distilled water	Boiler	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F 410L	✓
14:00	A			27.6	13.05	✓	✓	F 410L	✓
0:00	A			27.6	13.5	✓	✓	F 410L	✓

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓								
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					


Kitchen (ครัว)			
Time	Exhaust NO.1	Overhaul	
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✓		



PUEP (3311) TANK														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	—									
15:00	A			✓	✓									
0:00	A			✓	✗									




WATER TANK		
Time	น้ำเต็ม%	น้ำใช้%
8:00	100%	95%
15:00	95%	90%
0:00	90%	95%



THE FRONT VILLAGE

Check list



Daily check list

24/05/17

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำยอน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			22.6	13.05	✓	✓	F 410L	✓
14:00	P			22.6	13.05	✓	✓	F 410L	✓
0:00	P			22.6	13.05	✓	✓	F 410L	✓

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	P			✓	✓	✓	42	2	13					
15:00	P			✓	✓	✓	42	2	13					
0:00	P			✓	✓	✓	42	2	13					

Kitchen (K12)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		✗	

## THE FRONT VILLAGE

## Check list

Daily check list

25/05/24

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.I	BATT.II	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A		22.6	13.05	✓	✓		F 40L	✓
14:00	A		27.6	13.05	✓	✓		F 410L	✓
0:00	A		27.6.v	13.5.v	✓	✓		F 410.L	✓

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (R72)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	✗		

PUEP (R72) TANK														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	A			✓	✓									
0:00	A			✓	✗									

WATER TANK		
Time	น้ำดื่ม	น้ำร้อน
8:00	90%	90%
14:00	95%	100%
0:00	90%	95%

## THE FRONT VILLAGE

## Check list

Daily check list

26/05/13

GENERATOR								
	MODE			V	V	Distilled water	Bailer	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	น้ำเสีย	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	F 40L
14:00	A			27.6	13.05	✓	✓	F 40L
0:00	A			27.6	13.05	✓	✓	F 40L

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
14:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ห้องครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	A			✓	✓									
	A			✓	✓									
0:00	A			✓	✓									

WATER TANK		
Time	น้ำดื่ม%	น้ำเสีย%
8:00	90%	90%
14:00	95%	100%
0:00	100%	100%


22/05/62

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			22.6	13.05	✓	✓	F 410L	✓
14:00	A			22.6	13.05	✓	✓	F 410L	✓
0:00	A			22.6	13.05	✓	✓	F 410L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shorage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	49	2	13					
15:00	A			✓	✓	✓	49	2	13					
0:00	A			✓	✓	✓	49	2	13					

Kitchen (ครัว)		
Time	Exhaust NO.1	Overload
	ON	OFF
8:00	✓	
	✓	
14:00	✓	
0:00		X

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shorage		PWR	CPU	COM	Water D
8:00	D			✓	✓									
15:00	D			✓	✓									
0:00	A			X	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำเสียน%
8:00	90%	90%
14:00	90%	95%
0:00	95%	100%



## THE FRONT VILLAGE

## Check list

Daily check list


28/05/67.

GENERATOR									
Time	MODE			V	V	Distilled water	Dialer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	ถังเก็บ	ถังเก็บ	ถังเก็บ	ถังเก็บ
8:00	A			27.6	13.05	✓	✓	F 4102	✓
14:00	0			27.6	13.05	✓	✓	FL 4106	✓
0:00	A			27.6	13.05	✓	✓	FL 4106	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Storage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	0			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (ถังเก็บน้ำ)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Storage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	B			✓	✓									
0:00	B			✓	✓									



WATER TANK		
Time	ถังเก็บ%	ถังเก็บ%
8:00	95%	100%
14:00	90%	95%
0:00	75%	100%



## THE FRONT VILLAGE

Check list

Daily check list


29/05/67

GENERATOR									
Time	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F 410L	✓
14:00	A			27.6	13.05	✓	✓	F 410L	✓
0:00	A			27.6	13.05	✓	✓	F 410L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	D			✓	✓									
15:00	D			✓	✓									
0:00	D			X	✓									




WATER TANK		
Time	น้ำดิบ%	น้ำกลั่น%
8:00	95%	95%
14:00	90%	95%
0:00	95%	100%



THE FRONT VILLAGE

Check list



Daily check list


30/05/67

GENERATOR								
	MODE			V	V	Distilled water	Batter	Diesel fuel
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล
8:00	A			27.6	13.05	✓	✓	F 490L
14:00	A			27.6V	13.5V	✓	✓	F 410.1
0:00	A			27.6	13.05	✓	✓	F 410L


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
14:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	X									
15:00	A			X	✓									
0:00	A			X	✓									



WATER TANK		
Time	น้ำดื่ม %	น้ำเสียน้ำ %
8:00	25%	10%
14:00	90%	95%
0:00	95%	200%



## THE FRONT VILLAGE

## Check list

Daily check list

31/05/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	ถังน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.06	✓	✓	F 410L	✓
14:00	P			27.6	13.06	✓	✓	F 410L	✓
0:00	P			27.6	13.06	✓	✓	F 410L	✓

BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	B			✓	✓	✓	42	2	3					
0:00	P			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00		✗	

PUMP (ถังน้ำ/TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	P			✓	✓									
15:00	P			✓	✓									
0:00	A			✓	✗									

WATER TANK		
Time	น้ำดื่ม%	น้ำเสิร์ฟ%
8:00	90%	90%
15:00	95%	90%
0:00	90%	95%



THE FRONT VILLAGE

Check list

Daily check list


01/06/62

GENERATOR									
	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A		27.6	15.06		✓	✓	F 410L	✓
14:00	B		22.6	13.06		✓	✓	F 400L	✓
0:00	A		27.6	13.06		✓	✓	F 410L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	B			✓	✓	✓	42	2	3					
15:00	B			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (ถังน้ำ TANK)														
BOOSTER PUMP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	B			✓	✓									
15:00	B			✓	✓									
0:00	A			X	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8:00		
14:00	90%	95%
0:00	95%	100%



## THE FRONT VILLAGE

## Check list

Daily check list


02-06-67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อต้มน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.5	130.5	/	/	PL 410L	/
14:00	A			27.5	130.5	/	/	PL 410L	/
0:00	A			27.5	130.5	/	/	PL 410L	/


BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	02	2	3					
15:00	A			✓	✓	✓	02	2	3					
0:00	A			✓	✓	✓	02	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00		X	
14:00	✓		
0:00		X	

PUEP (ถังน้ำ 4TANK)														
BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			✓	✓									
15:00	A			X	✓									
0:00	A			✓	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำทิ้ง%
8:00	90%	95%
14:00	100%	100%
0:00	95%	90%



THE FRONT VILLAGE

Check list

Daily check list


3/6/67

GENERATOR									
	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.5	✓	✓	F. 100L.	✓
14:00	A			27.6	13.5	✓	✓	F. 400L.	✓
0:00	A			27.6	13.05	✓	✓	F. 400L.	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	12	2	3					
15:00	A			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ห้อง)		
Time	Exhaust NO.1	
	ON	OFF
8:00	✓	
14:00	✓	
0:00	X	

PUMP (ถังน้ำ/TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	PI	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	D		X	X	/								
15:00													
	A		X	X	/								
0:00													
	A			/	/								



WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8:00	100%	90%
14:00	100%	100%
0:00	90%	90%



THE FRONT VILLAGE

Check list

Daily check list


04/06/67.

GENERATOR									
	MODE			V	V	Distilled water	Batter	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	แบตเตอรี่	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F / 410L	✓
14:00	Ø			22.6	13.05	✓	✓	F / 410L	✓
0:00	A			27.6	13.05	✓	✓	F / 410L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	Ø			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (น้ำ)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	X		

PUMP (WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	A			X	✓									
0:00	A			X	✓									




WATER TANK		
Time	น้ำดื่ม	น้ำจืด
8:00	90%	95%
14:00	90%	95%
0:00	90%	100%



## THE FRONT VILLAGE

## Check list



Daily check list


05/06/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หมักน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F 410L	✓
14:00	A			28.6	13.05	✓	✓	F 410L	✓
0:00	A			27.5	13.05	✓	✓	F 410L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	B			✓	✓	✓	49	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ห้อง)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00	✓		

PUMP (WATER TANK)														
BOOSTER PUMP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8:00	A			/	/									
15:00	B			✓	✓									
0:00	A			✓	✓									




WATER TANK		
Time	น้ำเต็ม %	น้ำเต็ม %
8:00	100%	100%
14:00	90%	90%
0:00	90%	100%



## THE FRONT VILLAGE

## Check list



Daily check list


6/6/67

GENERATOR									
	MODE			V	V	Distilled water	Dailer	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำดื่ม	พริกดน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F 400L	✓
14:00	B			28.6	13.05	✓	✓	F 400L	✓
0:00	A			27.6	13.06	✓	✓	F 410L	✓


BOOSTER PUMP															
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8:00	A			✓	✓	✓	42	2	3						
15:00	B			✓	✓	✓	42	2	3						
0:00	A			✓	✓	✓	42	2	3						

Kitchen (ครัว)			
Time	Exhauster NO.1		Overload
	ON	OFF	
8:00	✓		
14:00	✓		
0:00	X		

PUMP (RESERVOIR TANK)															
BOOSTER PUMP D				ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D		
8:00	B			✓	✓										
15:00	B			✓	✓										
0:00	A			X	✓										



WATER TANK		
Time	น้ำดื่ม %	น้ำดื่ม %
8:00	95%	95%
14:00	90%	95%
0:00	95%	100%



## THE FRONT VILLAGE

## Check list

Daily check list


07/06/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminal
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	น้ำขัง	น้ำมันดีเซล	ขั้วแบตเตอรี่
8:00	A			27.6	13.05	✓	✓	F 40L	✓
14:00	D			22.6	13.05	✓	✓	F 40L	✓
0:00	A			27.6	13.5	✓	✓	F 40L	✓


BOOSTER PUMP														
BOOSTER PUMP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓	✓	42	2	3					
15:00	D			✓	✓	✓	42	2	3					
0:00	A			✓	✓	✓	42	2	3					

Kitchen (ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8:00	✓		
14:00	✓		
0:00		✓	

PUMP (น้ำใน TANK)													
BOOSTER PUMP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8:00	A			✓	✓								
15:00	D			✓	✓								
0:00	A			✓	✓								



WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8:00	95%	95%
15:00	90%	90%
0:00	90%	95%



THE FRONT VILLAGE

Check list


Daily check list  
02/06/67.

GENERATOR								
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	✓	✓	F. 100
14.00								
0.00	A			27.6.v	13.5.v	✓	✓	F. 100

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	42	2	3					
15.00														
0.00	A			✓	✓	✓	42	2	3					

Kitchen(ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8.00	✓	
14.00		
0.00		X

BOOSTER PUEP D														
	AUTO	MAN	ON/OFF	ON/OFF										
			OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A			✓	✓									
15.00														
0.00	A			X	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำเส%
8.00	98%	100%
14.00		
0.00	90%	95%





THE FRONT VILLAGE  
Check list


Daily check list  
๑๑.๐๖/๖๗

GENERATOR									
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.06	✓	✓	F 400L	✓
14.00	A			27.6	13.06	✓	✓	F 400L	✓
0.00	A			27.6	13.06	✓	✓	F 400L	✓

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	42	2	3					
15.00	A			✓	✓	✓	42	2	3					
0.00	A			✓	✓	✓	42	2	3					

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	✓		
14.00	✓		
0.00		7	

BOOSTER PUEP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI		Shortage	PWR	CPU	COM	Water D
8.00	A			/	/									
15.00	A			/	/									
0.00	P			✓	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำเส%
8.00	95%	100%
14.00	90%	85%
0.00	90%	90%



THE FRONT VILLAGE

Check list

Daily check list


10/06/67

GENERATOR									
Time	MODE			V		Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.5	13.06	✓	✓	FL 110L	✓
14.00	A			27.6	13.05	✓	✓	FL 110L	✓
0.00									

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	12	2	3					
15.00	A			✓	✓	✓	42	2	3					
0.00														

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	✓		
14.00	✓		
0.00			

BOOSTER PUEP														
	BOOSTER PUEP D			ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A			+	✓									
15.00	A			X	✓									
0.00														



WATER TANK		
Time	น้ำดื่ม%	น้ำเส%
8.00	90%	95%
14.00	95%	95%
0.00		



THE FRONT VILLAGE

Check list

Daily check list


11/06/67

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	✓	✓	5.5 L 3.55 L	✓
14.00	A			27.6	13.05	✓	✓	3.8 3.50 L	✓
0.00	D			27.6	13.05	✓	✓	5.5 L 3.50 L	✓

BOOSTER PUEP															
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A			✓	✓	✓	4.2	2	3						
15.00	A			✓	✓	✓	4.2	2	3						
0.00	D			✓	✓	✓	4.2	2	3						

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	✓		
14.00	✓		
0.00	✓	✗	

BOOSTER PUEP D			ON/OFF	ON/OFF										
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI		Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓									
15.00														
0.00	A			✓	✓									



WATER TANK		
Time	น้ำกลั่น%	น้ำส้ม%
8.00	95%	100%
14.00		
0.00	90%	95%

THE FRONT VILLAGE  
Check list


Daily check list  
12/06/62

GENERATOR								
Time	MODE			V	V	Distilled water	Batter	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	แบตเตอรี่	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	✓	✓	✓
14.00	A			27.6	13.05	✓	✓	✓
0.00	A			27.6	13.05	✓	✓	✓

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	42	2	3					
15.00	A			✓	✓	✓	42	2	3					
0.00	A			✓	✓	✓	42	2	3					

Kitchen(ครัว)		
Time	Exhaust NO.1	
	ON	OFF
8.00	✓	
14.00	✓	
0.00		✗

BOOSTER PUEP D														
	AUTO	MAN	ON/OFF	ON/OFF										
			OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A			✓	✓									
	A			✗	✓									
15.00														
	A			✓	✓									
0.00														



WATER TANK		
Time	น้ำสูง%	น้ำต่ำ%
8.00	95%	90%
14.00	95%	100%
0.00	90%	90%

THE FRONT VILLAGE

Check list


Daily check list  
13/01/67

GENERATOR									
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	/	/	F 410-	/
14.00	A			27.6	13.05	/	/	F 419	/
0.00	A			27.6	13.05	/	/	58 350L	/

BOOSTER PUEP															
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A			/	/	/	42	2	3.						
15.00	A			/	/	/	42	2	3						
0.00	A			/	/	/	42	2	3						

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	/		
14.00	/		
0.00	/		

BOOSTER PUEP D															
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D		
8.00	A			/	/										
15.00	A			/	/										
0.00	A			/	/										



WATER TANK		
Time	น้ำเต็ม%	น้ำต่ำ%
8.00	95%	90%
14.00	95%	95%
0.00	90%	95%

THE FRONT VILLAGE  
Check list

Daily check list  
14/10/62

GENERATOR									
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
5.00	A			27.6	12.07	/	/	F 400	/
14.00	A			27.6	12.07	/	/	F 400	/
0.00	A			28.6	13.05	/	/	F 400	/

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			/	/	/	42	2	3					
15.00	A			/	/	/	42	2	3					
0.00	A			/	/	/	42	2	3					

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	/		
14.00	/		
0.00		X	

BOOSTER PUEP D														
	AUTO	MAN	ON/OFF	ON/OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A		/	/	/	/	/	/	/					
15.00	A		/	/	/	/	/	/	/					
0.00	A		/	/	/	/	/	/	/					

WATER TANK		
Time	น้ำดื่ม%	น้ำเสีย%
8.00	100%	95%
14.00	90%	85%
0.00	90%	90%

THE FRONT VILLAGE

Check list


Daily check list  
15/6/67

GENERATOR									
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	✓	✓	5/8 350L	✓
14.00	A			27.6	13.05	✓	✓	5/8 350L	✓
0.00	A			27.6	13.05	✓	✓	5/8 350L	✓

BOOSTER PUEP D															
Time	MODE			ON/OFF	ON/OFF	ON/OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU
	AUTO	MAN	OFF	OFF	ON	ON	OFF	ON	ON	OFF	ON	ON	ON	ON	ON
8.00	A			✓	✓	✓	✓	✓	✓	42	2	3			
15.00	A			✓	✓	✓	✓	✓	✓	42	2	3			
0.00	A			✓	✓	✓	✓	✓	✓	42	2	3			

Kitchen(ครัว)			
Time	Exhaust NO.1	ON	OFF
8.00			✓
14.00	✓		
0.00		✓	

BOOSTER PUEP D															
Time	MODE			ON/OFF	ON/OFF	ON/OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU
	AUTO	MAN	OFF	OFF	ON	ON	OFF	ON	ON	OFF	ON	ON	ON	ON	ON
8.00	A			✓	✓	✓	✓	✓	✓	42	2	3			
15.00	A			✓	✓	✓	✓	✓	✓	42	2	3			
0.00	A			✓	✓	✓	✓	✓	✓	42	2	3			



WATER TANK		
Time	น้ำเต็ม%	น้ำผิ%
8.00	95%	95%
14.00	95%	95%
0.00	95%	90%

THE FRONT VILLAGE  
Check list


Daily check list  
1406/67

GENERATOR								
Time	MODE			V	V	Distilled wter	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	พื้มน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	/	/	5/8 350L
14.00	A			27.6	13.05	/	/	5/8 350L
0.00	B			27.6	13.05	/	/	5/8 350L

BOOSTER PUEP														
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF								
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			/	/	/	42	2	3					
15.00	A			/	/	/	42	2	3					
0.00	B			/	/	/	42	2	3					

Kitchen(น้ำ)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	/		
14.00	/		
0.00		X	

	BOOSTER PUEP D																			
	AUTO	MAN	ON/OFF OFF	ON/OFF P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D							
8.00	A			/	/															
15.00	A			/	/															
0.00	B			/	/															



WATER TANK		
Time	น้ำดื่ม%	น้ำดื่ม%
8.00	100%	95%
14.00	100%	100%
0.00	90%	90%



THE FRONT VILLAGE  
Check list

Daily check list  
17/06/67

GENERATOR								
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	✓	✓	5/8 350L
14.00	A			27.6	13.05	✓	✓	5/8 350L
0.00	A			27.6	13.05	✓	✓	5/8 350L

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	42	2	3					
14.00	A			✓	✓	✓	42	2	3					
0.00	A			✓	✓	✓	42	2	3					

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00		X	
14.00	✓		
0.00		X	

THE FRONT VILLAGE  
Check list

Daily check list  
18/06/67

GENERATOR								
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	✓	✓	5/8 350L
14.00	A			27.6	13.05	✓	✓	5/8 350L
0.00								

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	42	2	3					
14.00	A			✓	✓	✓	42	2	3					
0.00														

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	✓		
14.00	✓		
0.00			

BOOSTER PUEP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI		Shortage	PWR	CPU	COM	Water D
8.00	A			+	✓									
15.00	A			<del>  </del>	<del>  </del>									
0.00														

WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8.00	90%	95%
14.00	95%	95%
0.00		

THE FRONT VILLAGE  
Check list


Daily check list  
19/06/67

GENERATOR								
Time	AUTO	MAN	OFF	V	V	Distilled water	Batter	Battery Terminals
8.00	A			27.6	13.06	✓	✓	350L
14.00	A			27.6	13.05	✓	✓	350L
0.00	A			27.6	13.05	✓	✓	350L

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI		Shortage	PWR	CPU	Water D
8.00	A			✓	✓	✓	42	2	3					
15.00	A			✓	✓	✓	42	2	3					
0.00	A			✓	✓	✓	42	2	3					

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	✓		
14.00	✓		
0.00		✓	

BOOSTER PUEP D			ON/OFF	ON/OFF											
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI		Shortage	PWR	CPU	COM	Water D	
8.00	A			/	/										
15.00	A			/	/										
0.00	A			/	/										



WATER TANK		
Time	น้ำเต็ม%	น้ำเต็ม%
8.00	95%	100%
14.00	90%	95%
0.00	90%	90%

**THE FRONT VILLAGE**  
Check list

Daily check list  
20/06/67

GENERATOR								
Time	MODE	V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals	
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	/	/	58 350L
14.00	A			27.6	13.05	/	/	58 350L
0.00	A			27.6	13.05	/	/	58 350L

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI		Shortage	PWR	CPU	Water D
8.00	A			/	/	/	42	2	3					
15.00	A			/	/	/	42	2	3					
0.00	A			/	/	/	42	2	3					

Kitchen(น้ำ)		
Time	Exhaust NO.1	
	ON	Overload
8.00	/	
14.00	/	
0.00	/	

THE FRONT VILLAGE

Check list

Daily check list

21/06/67

GENERATOR									
Time	MODE			V		Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	/	/	5/8 350L	/
14.00	A			27.6	13.05	/	/	5/8 350L	/
0.00				27.6	13.05	/	/	5/8 350L	/

BOOSTER PUEP															
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A		/	/	/	/	42	2	3						
15.00	A		/	/	/	/	42	2	3						
0.00	A		/	/	/	/	42	2	3						

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	/		
14.00	/		
0.00		X	

THE FRONT VILLAGE

Check list

Daily check list

27/06/67

GENERATOR									
Time	MODE			V		Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.06	/	/	5/8 350L	/
14.00	A			27.6	13.06	/	/	5/8 350L	/
0.00	A			27.6	13.06	/	/	5/8 350L	/

BOOSTER PUEP															
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A		/	/	/	/	42	2	3						
15.00	A		/	/	/	/	42	2	3						
0.00	A		/	/	/	/	42	2	3						

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	/		
14.00	/		
0.00		X	

BOOSTER PUEP D														
	AUTO	MAN	ON/OFF	ON/OFF										
			OFF	P1	P2	psi	LOW	HI		Shortage	PWR	CPU	COM	Water D
8.00	A			/	/									
15.00	A			/	/									
0.00	A			/	/									

WATER TANK	
น้ำเต็ม%	น้ำใช้%
100%	90%
100%	100%
100%	100%

**THE FRONT VILLAGE**  
Check list

Daily check list  
23-6-64

GENERATOR								
Time	MODE	V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals	
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	/	/	350L
14.00	A			27.6	13.05	/	/	350L
0.00	A			27.6	13.05	/	/	350L

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			/	/	/	42	2	3					
15.00	A			/	/	/	42	2	3					
0.00	A			/	/	/	42	2	3					

Kitchen(ครัว)		
Time	Exhaust NO.1	Overload
	ON	OFF
8.00	/	
14.00	/	
0.00	/	

BOOSTER PUEP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI		Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓									
15.00	A			✓	✓									
0.00	A			✓	✓									



WATER TANK		
Time	น้ำเต็ม%	น้ำตื้น%
8.00	90%	95%
14.00	100%	100%
0.00	95%	100%

**THE FRONT VILLAGE**  
Check list

Daily check list  
24/06/20

GENERATOR									
	MODE			V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals
Time	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	พร่องน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			22.6	13.05	✓	✓	5/8 350L	✓
14.00	A			27.6	13.05	✓	✓	5/8 350L	✓
0.00	A			27.6	13.05	✓	✓	5/8 350L	✓

BOOSTER PUEP															
BOOSTER PUEP D			'ON/OFF	'ON/OFF	'ON/OFF										
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8.00	<input checked="" type="checkbox"/>			<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	49	2	3						
15.00	<input checked="" type="checkbox"/>			<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	42	2	3						
0.00	<input checked="" type="checkbox"/>			<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	42	2	4						

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	<input checked="" type="checkbox"/>		
14.00	<input checked="" type="checkbox"/>		
0.00	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	

THE FRONT VILLAGE  
Check list


Daily check list  
25-6-67

GENERATOR								
Time	MODE			V	V	Distilled wter	Bailer	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	✓	✓	5/8 350L
14.00	A			22.6	13.05	✓	✓	5/8 350L
0.00	X			27.6	13.05	✓	✓	5/8 350L

BOOSTER PUEP															
BOOSTER PUEP D			'ON/OFF	'ON/OFF	'ON/OFF										
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage		PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	42	2	3						
15.00	B			✓	✓	✓	42	2	3						
0.00	A			✓	✓	✓	42	2	3						

Kitchen(ครัว)		
Time	Exhaust NO.1	Overload
8.00	✓	
14.00	✓	
0.00		X

BOOSTER PUEP D				ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI		Shortage	PWR	CPU	COM	Water D
8.00	A			X	✓									
15.00	B			X	✓									
0.00	A			X	✓									



WATER TANK		
Time	น้ำดื่ม%	น้ำใช้%
8.00	95%	100%
14.00	95%	90%
0.00	95%	90%

THE FRONT VILLAGE  
Check list


Daily check list  
26-06-67

GENERATOR								
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	พละน้ำ	น้ำมันดีเซล
8.00	A			27.6	13.05	✓	✓	5/8 350L
14.00	A			27.6	13.05	✓	✓	5/8 350L
0.00								

BOOSTER PUEP													
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF								
AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A		✓	✓	✓	42	2	3					
15.00	A		✓	✓	✓	42	2	3					
0.00													

Kitchen(ครัว)			
Time	Exhaust NO.1		Overload
	ON	OFF	
8.00	✓		
14.00	✓		
0.00			

BOOSTER PUEP D													
	AUTO	MAN	OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			+	✓								
15.00	A			✓	✓								
0.00													



WATER TANK		
Time	น้ำเต็ม%	น้ำต่ำ%
8.00	70%	95%
14.00	100%	100%
0.00		



THE FRONT VILLAGE  
Check list


Daily check list  
27/06/67

GENERATOR									
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	✓	✓	3/5 35L	✓
14.00	A			27.6	13.05	✓	✓	3/5 35L	✓
0.00	A			27.6	13.05	✓	✓	3/5 35L	✓

BOOSTER PUEP D															
Time	MODE			ON/OFF	ON/OFF	ON/OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU
	AUTO	MAN	OFF	P1	P2	P3	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU
8.00	A			✓	✓	✓	42	2	3						
15.00	A			✓	✓	✓	42	2	3						
0.00	A			✓	✓	✓	42	2	3						

Kitchen(ครัว)			
Time	Exhaustn NO.1	Overload	
	ON	OFF	
8.00	✓		
14.00		✗	
0.00	-	✗	

BOOSTER PUEP D															
Time	MODE			ON/OFF	ON/OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
	AUTO	MAN	OFF	P1	P2	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓										
15.00	A			✓	✓										
0.00	A			✗	✓										



WATER TANK		
Time	น้ำเต็ม%	น้ำ少%
8.00	100%	90%
14.00	100%	100%
0.00	95%	100%

THE FRONT VILLAGE  
Check list

Daily check list  
28/06/67

GENERATOR									
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	/	/	5/8 350L	/
14.00	A			27.6	13.05	/	/	5/8 350L	/
0.00	A			27.6	13.05	/	/	5/8 350L	/

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			/	/	/	42	2	3					
15.00	A			/	/	/	42	2	3					
0.00	A			/	/	/	42	2	3					

Kitchen(ครัว)			
Time	Exhaust NO.1		
	ON	OFF	Overload
8.00	/		
14.00	/		
0.00		X	

BOOSTER PUEP D														
	AUTO	MAN	ON/OFF	ON/OFF										
			OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	A			/	/									
15.00	A			/	/									
0.00	A			/	/									

WATER TANK		
Time	น้ำเต็ม%	น้ำลด%
8.00	95%	95%
14.00	95%	95%
0.00	95%	95%

THE FRONT VILLAGE  
Check list

Daily check list  
29/06/18

GENERATOR								
Time	MODE			V	V	Distilled wter	Bailer	Diesel fuel
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	พริ้วน้ำ	น้ำมันดีเซล
8.00	P			22.6	13.05	✓	✓	5/8 350L
14.00	A			27.6	13.05	✓	✓	5/8 350L
0.00	A			22.6	13.05	✓	✓	5/8 350L

BOOSTER PUEP															
BOOSTER PUEP D				ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	P			✓	✓	✓	42	2	3						
15.00	P			✓	✓	✓	42	2	3						
0.00	A			✓	✓	✓	42	2	3						

Kitchen(ครัว)			
Time	Exhaustn NO.1		
	ON	OFF	Overload
8.00	✓		
14.00	✓		
0.00		X	

BOOSTER PUEP D															
	AUTO	MAN	ON/OFF	ON/OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D	
8.00	B			✓	X										
15.00	P			✓	✓										
0.00	A			✓	X										

WATER TANK		
	น้ำเต็ม%	น้ำเต็ม%
8.00	100%	95%
15.00	95%	95%
0.00	95%	100%

THE FRONT VILLAGE  
Check list

Daily check list  
30/06/62

GENERATOR									
Time	MODE			V	V	Distilled water	Bailer	Diesel fuel	Battery Terminals
	AUTO	MAN	OFF	BATT.1	BATT.2	น้ำกลั่น	หม้อน้ำ	น้ำมันดีเซล	ขั้วแบตเตอรี่
8.00	A			27.6	13.05	✓	✓	5/8 350L	✓
14.00	A			27.6	13.05	✓	✓	5/8 350L	✓
0.00	A			27.6	13.05	✓	✓	5/8 350L	✓

BOOSTER PUEP														
BOOSTER PUEP D			ON/OFF	ON/OFF	ON/OFF									
	AUTO	MAN	OFF	P1	P2	P3	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			✓	✓	✓	4.2	2	3					
15.00	A			✓	✓	✓	4.2	2	3					
0.00	A			✓	✓	✓	4.2	2	3					

Kitchen(ครัว)		
Time	Exhaust NO.1	Overload
8.00	✓	
14.00	✓	
0.00	X	

BOOSTER PUEP D														
	AUTO	MAN	ON/OFF	ON/OFF	P1	P2	psi	LOW	HI	Shortage	PWR	CPU	COM	Water D
8.00	A			X	✓									
15.00	A			X	X									
0.00	A			✓	X									

WATER TANK	
น้ำดื่ม%	น้ำยว%
100%	95%
5%	95%
0%	0.5%