

ภาคผนวก ข-21

---

ข้อมูลปริมาณการสูบน้ำทะเล


Indicator	Unit	Jul	Aug	Sep	Oct	Nov
Sewer	m3	45,877,073	68,333,616	60,659,710	65,196,983	58,326,763
CFR3 Sewer Once Through Coding Water	m3	8,757,387				
PH3 Sewer Once Through Coding Water	m3	12,592,045	37,101,131	35,692,373	37,666,466	38,437,761
GSP3 Sewer Once Through Coding Water	m3	24,527,641	31,232,485	24,967,337	27,530,517	19,889,002
Sewer Grand Totals	m3	0	0	0	0	0

Dec
63,286,511
36,347,536
28,938,975
0

ภาคผนวก ข-22

---

ผังการผลิตน้ำใส และน้ำปราศจากแร่ธาตุ

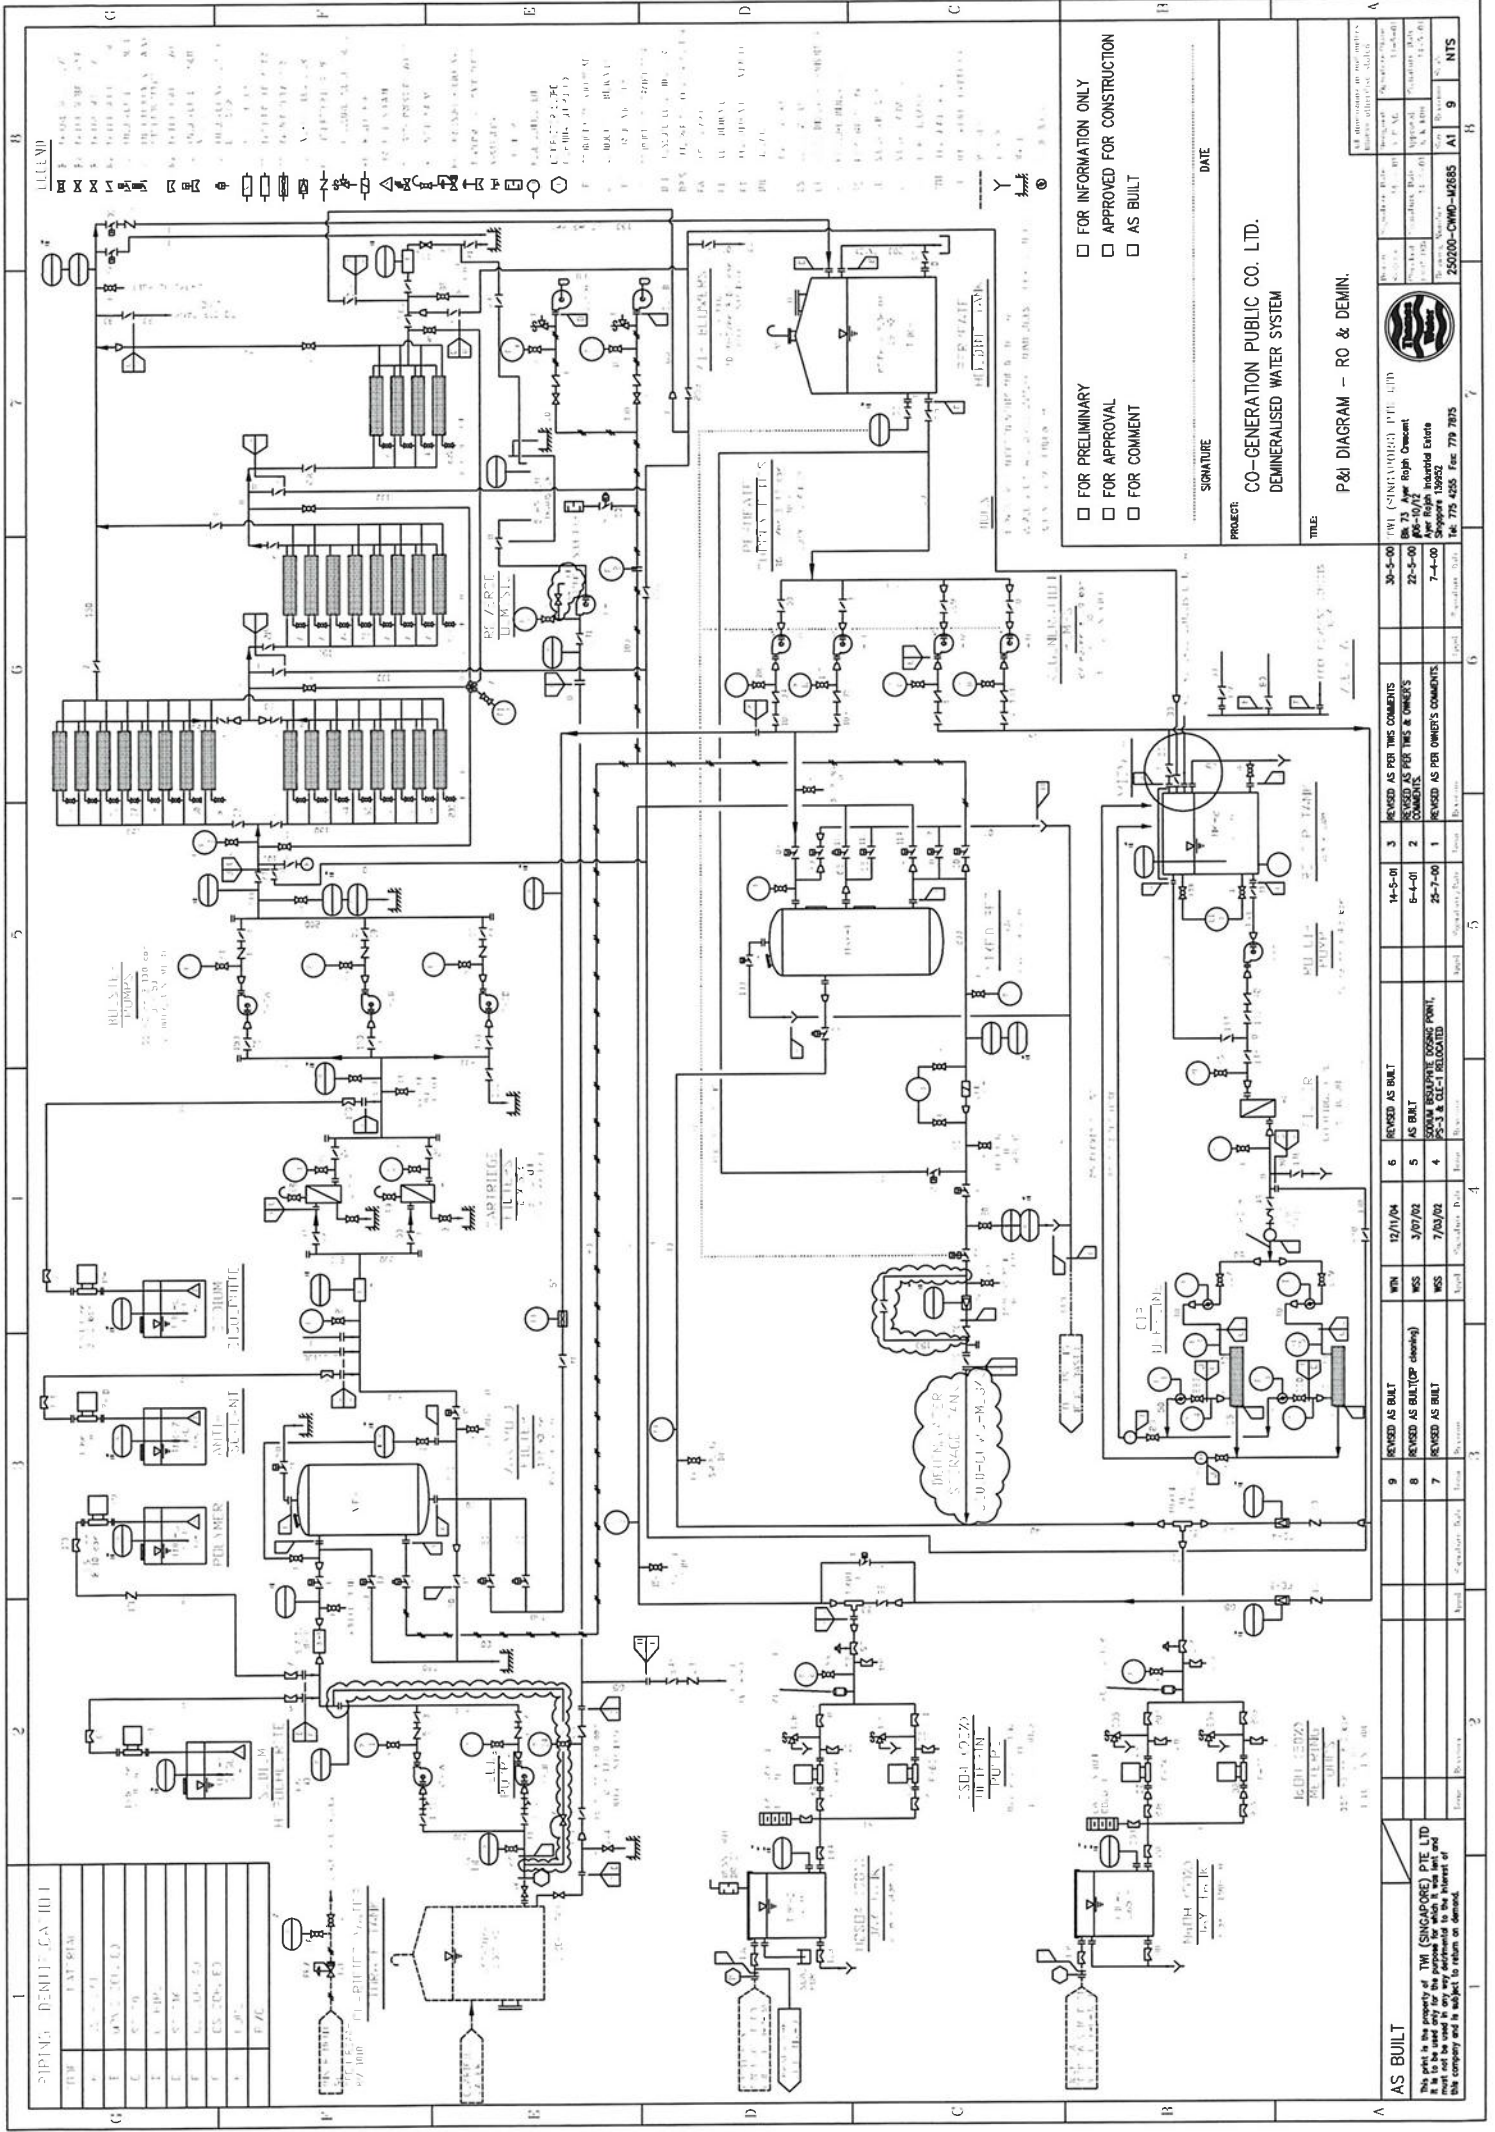

- ☐ FOR PRELIMINARY
- ☐ FOR APPROVAL
- ☐ FOR COMMENT
- ☐ FOR INFORMATION ONLY
- ☐ APPROVED FOR CONSTRUCTION
- ☐ AS BUILT

SIGNATURE \_\_\_\_\_ DATE \_\_\_\_\_

PROJECT: CO-GENERATION PUBLIC CO. LTD.  
DEMINERALISED WATER SYSTEM


TITLE: P&ID DIAGRAM - RO & DEMIN.

AS BUILT																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																									
----------	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--







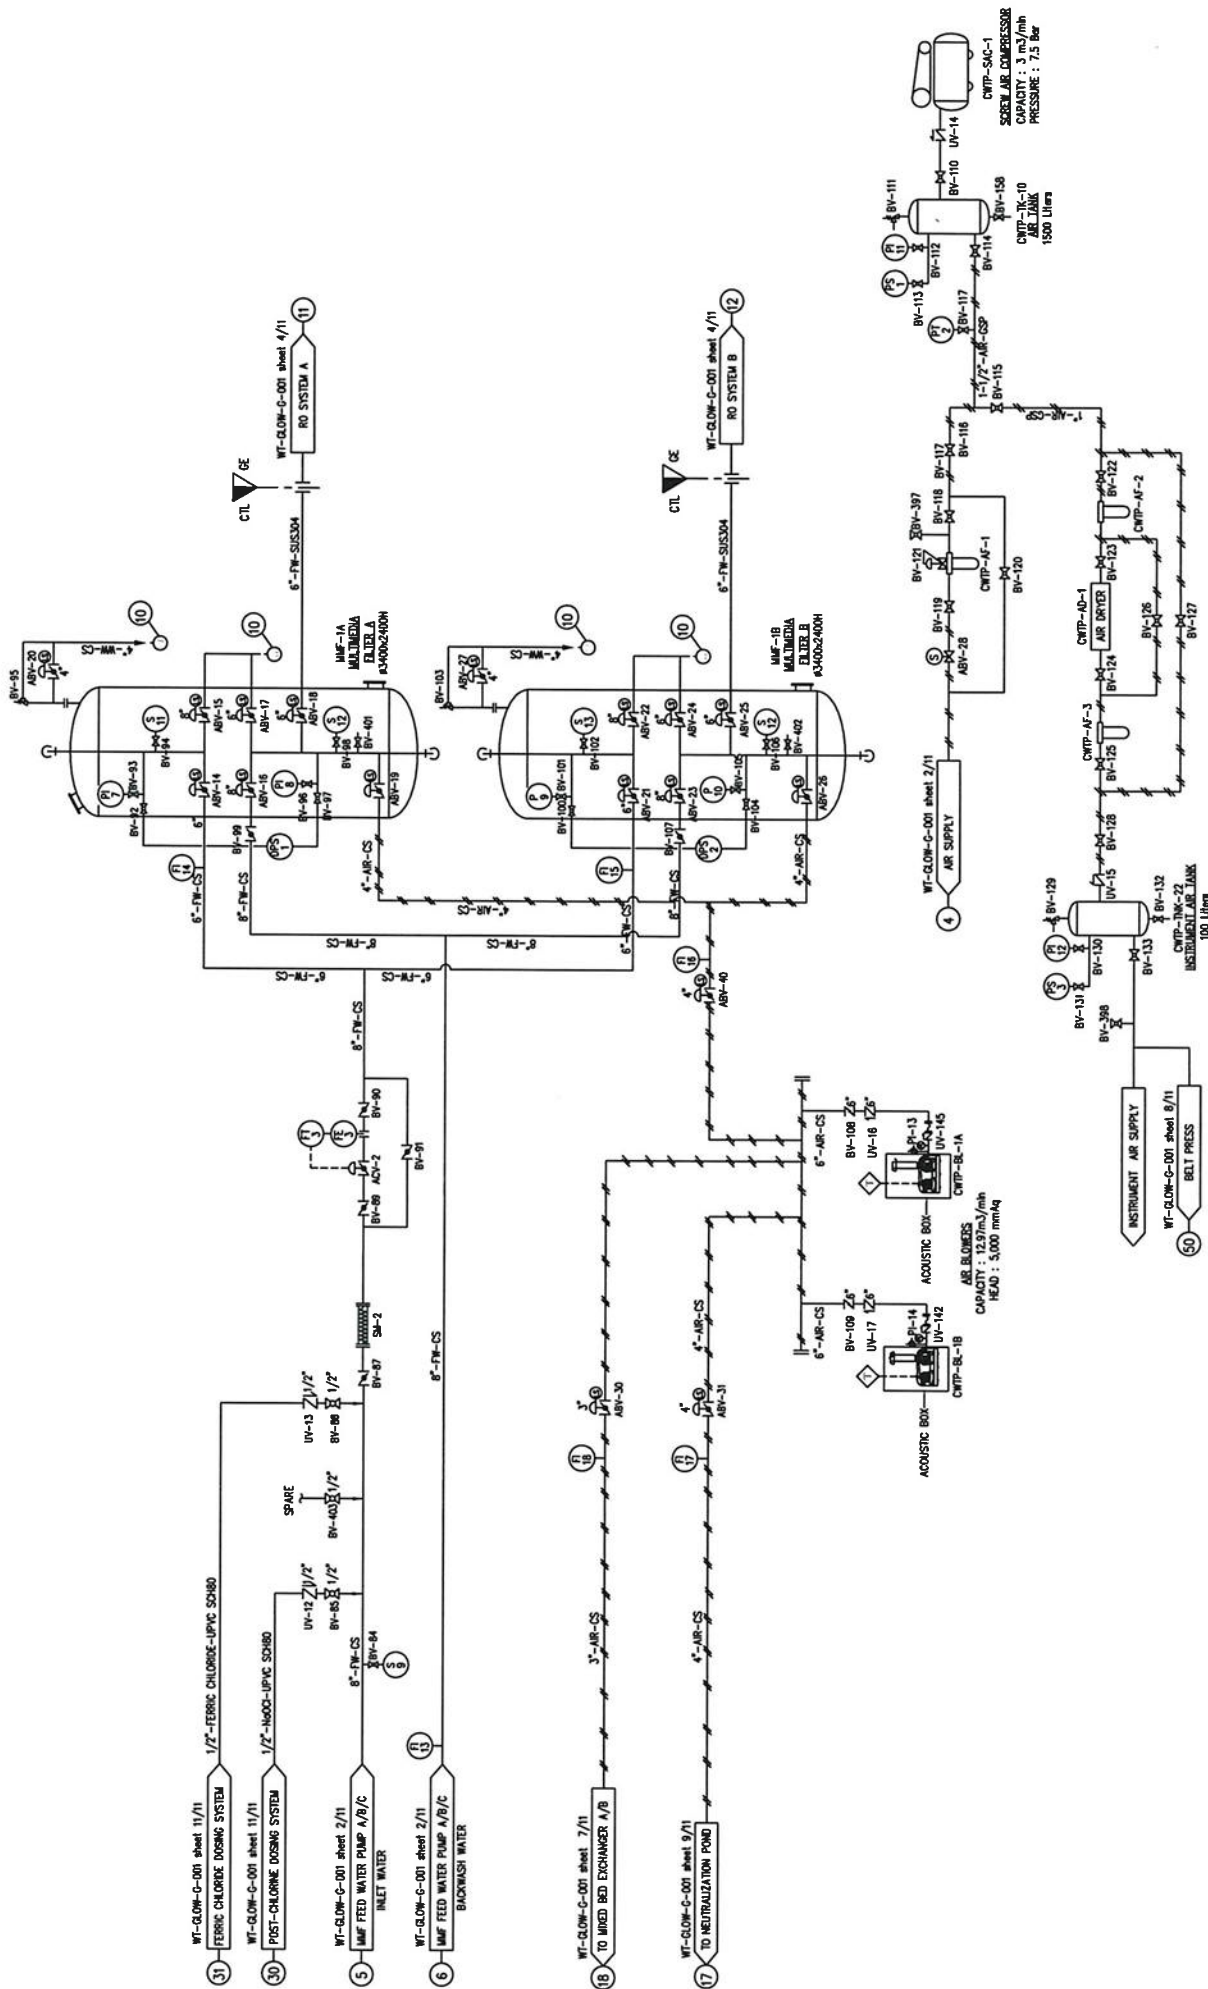

Item Ref	Quantity	Title/Name, designation, material, dimension etc	Article No./Reference
5	As-Built Drawing	Drawn By: Rattana K. K.	Approved by/date: Dr. Sammal G. 08/03/04
4	For Construction	Checked by: Premuk P.	Scale: 1/100
3	Revised as Comments	Client: GLOW SPP PCL	
2	Revised as Comments	Project Title: Water Treatment Plant	
1	Revised as Comments	Drawing Title: P&ID	
0	For Approval	Drawing No. WT-GLOW-G-001	Edition 5
Rev/No	Revision note	Date	Sheet 3/11

REMARK :

① : TO WASTEWATER POND




GE Infrastructure  
Water & process Technologies  
Chemitreat (Thailand)







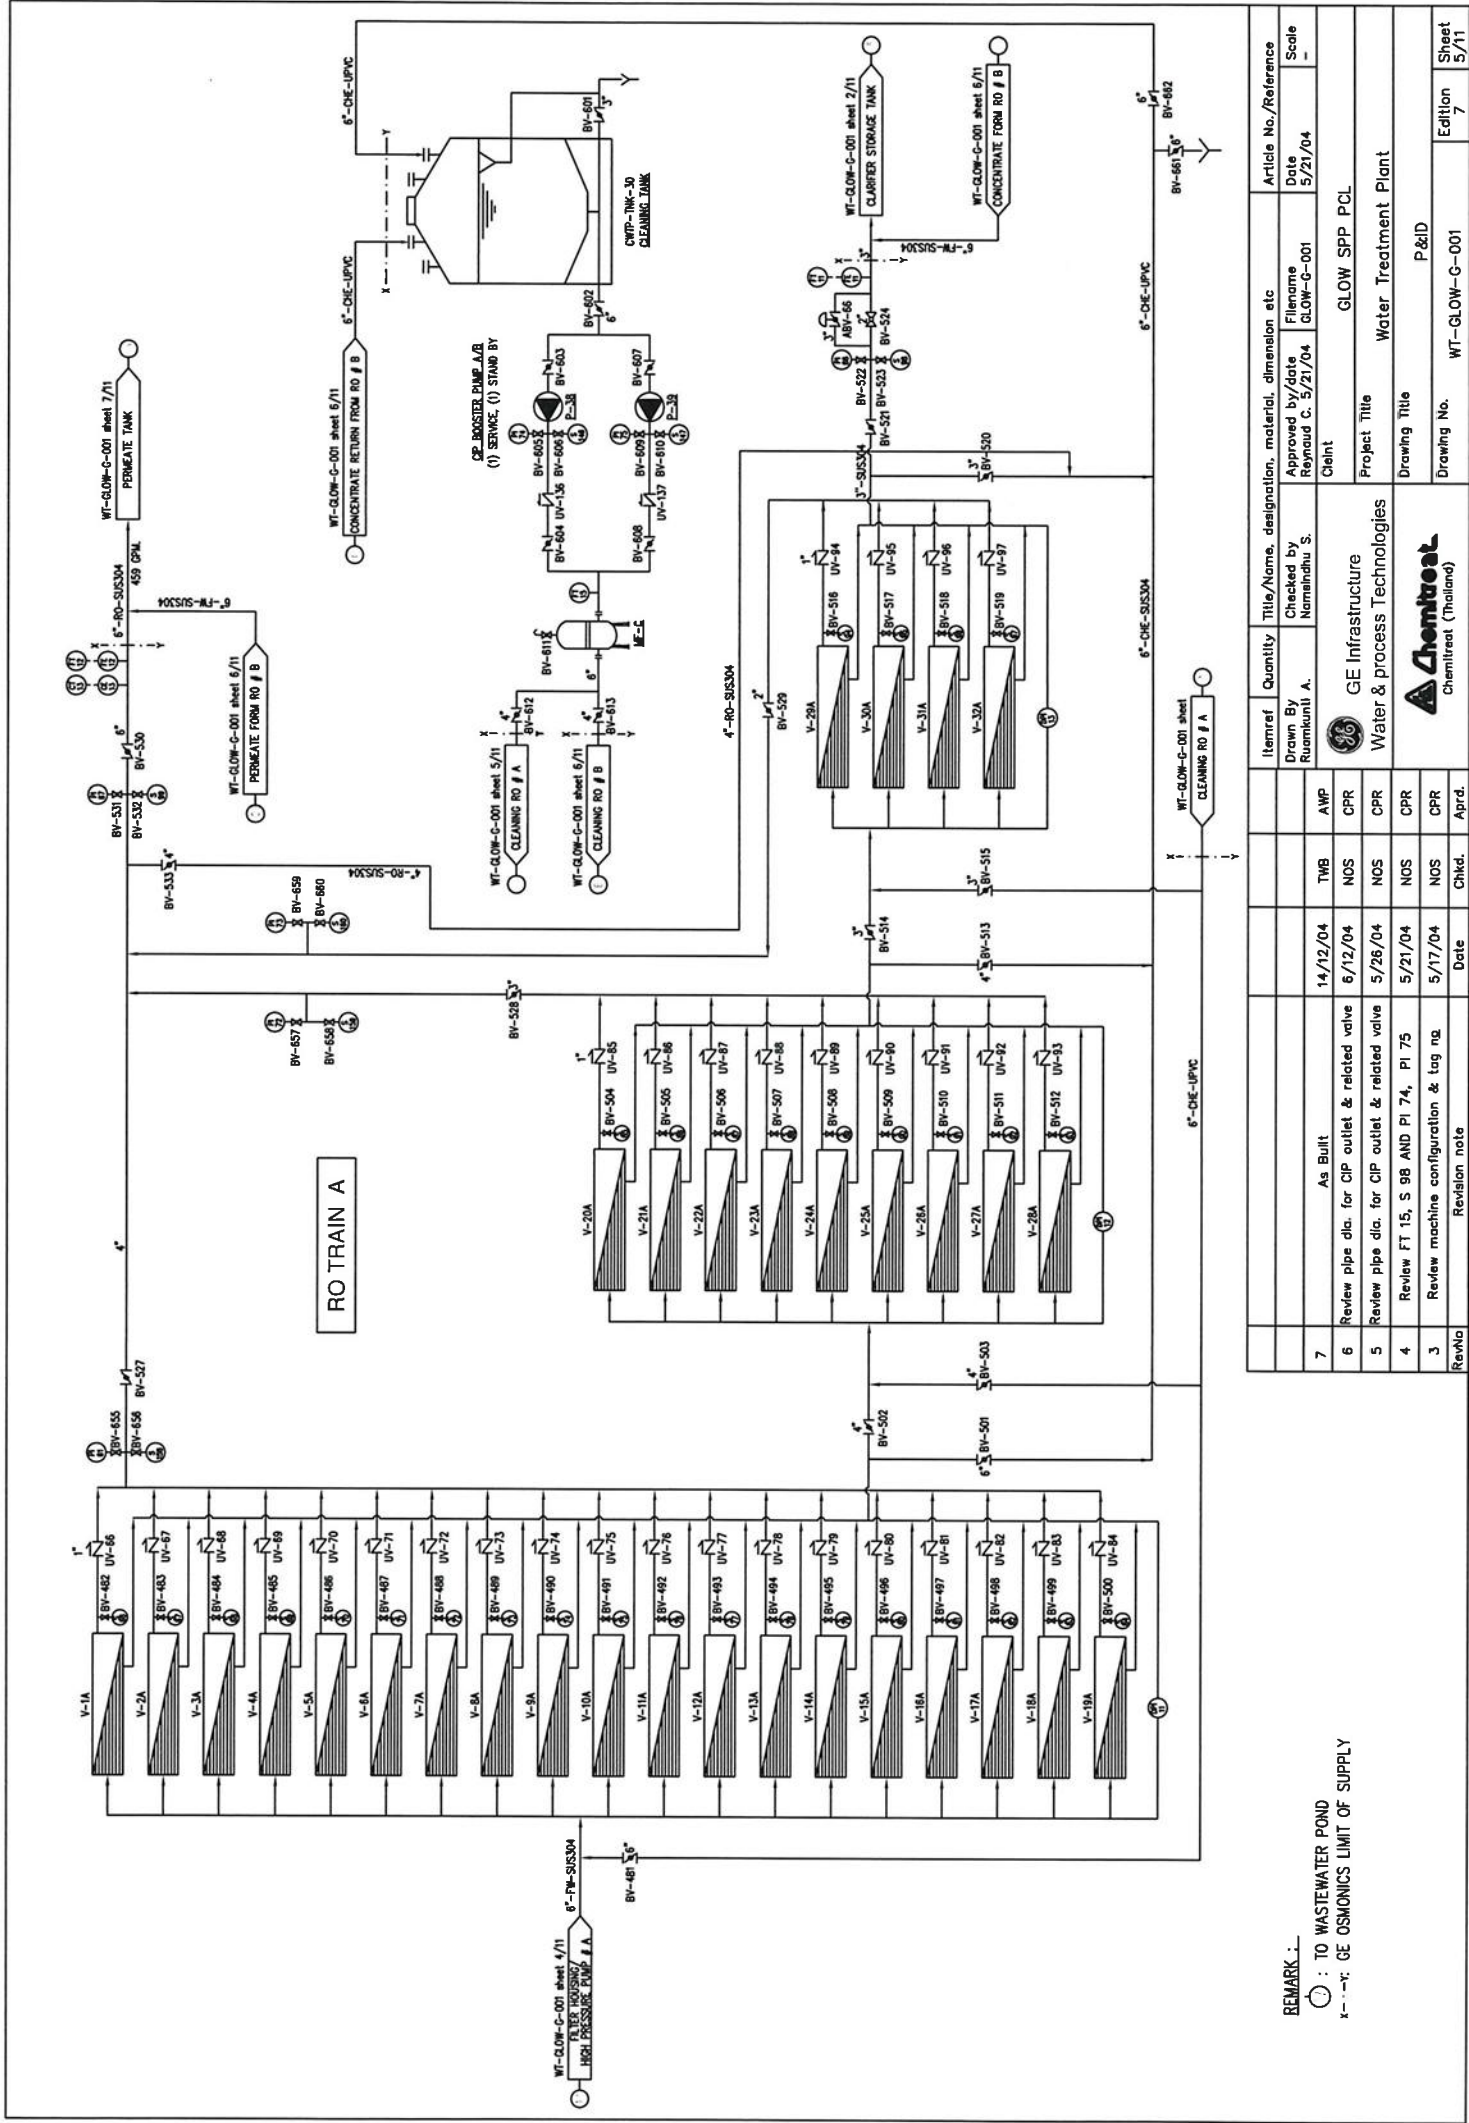

REMARK :


○ : TO WASTEWATER POND  
 x---x: GE OSMONICS LIMIT OF SUPPLY

Itemref	Quantity	Title/Name, designation, material, dimension etc	Article No./Reference
Drawn By	Checked by	Approved by/date	Filename
Ruamkunli A.	Namaindu S.	Reynaud C. 5/21/04	GLOW-G-001
		Date	Scale
		5/21/04	-
Client			
GLOW SPP PCL			
Project Title			
Water Treatment Plant			
Drawing Title			
P&ID			
Drawing No.			
WT-GLOW-G-001			
Edition			
7			
Sheet			
5/11			








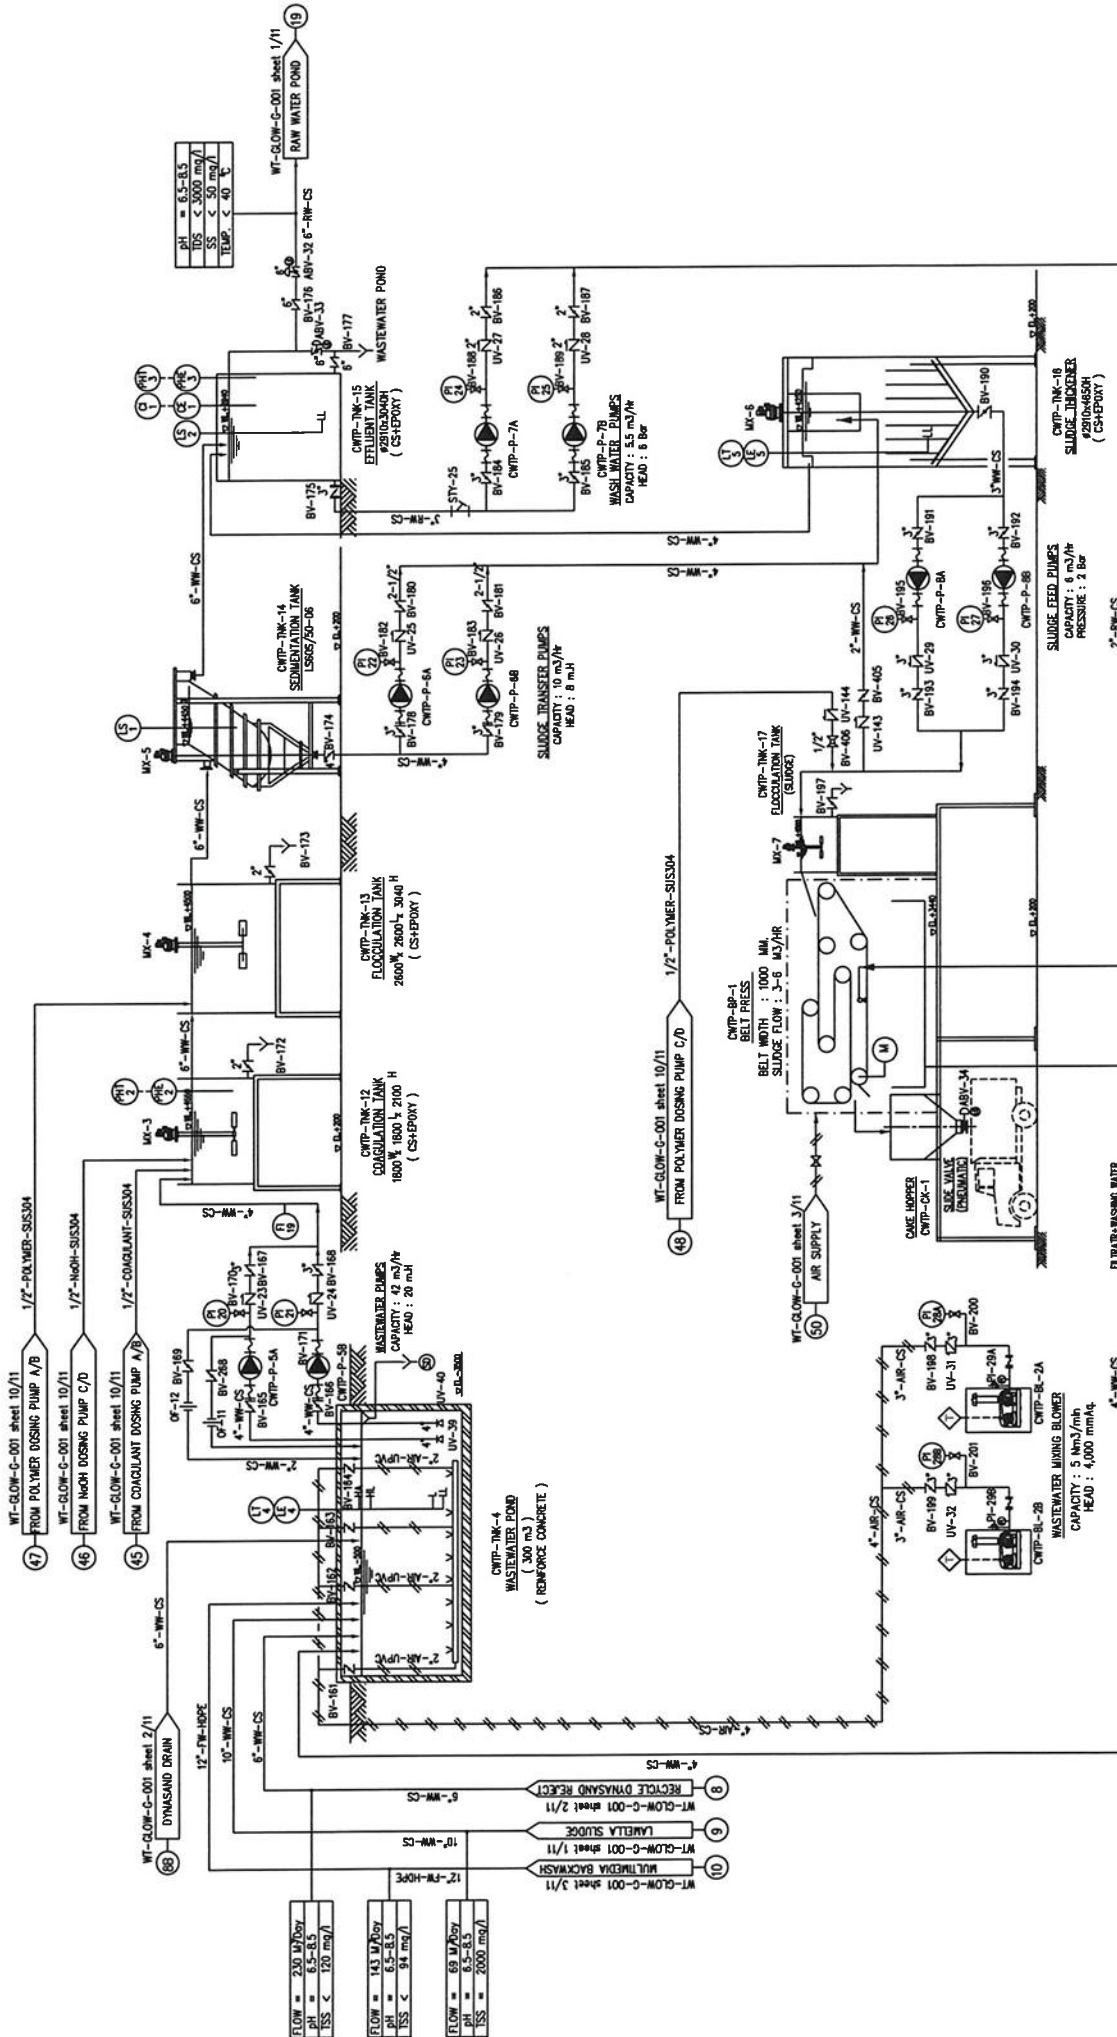

Itemref	Quantity	Title/Name, designation, material, dimension etc	Article No./Reference
5	As-Built Drawing	17/12/04	17/12/04
4	For Construction	4/06/04	4/06/04
3	Revised as Comments	27/04/04	27/04/04
2	Revised as Comments	21/04/04	21/04/04
1	Revised as Comments	07/04/04	07/04/04
0	For Approval	18/03/04	18/03/04
RevNo	Revision note	Date	Aprd.
Drawn By	Rattanaul K.	Checked by	Pramuk P.
Approved by/date	Dr.Sommal C.	File name	WT-GLOW-G-001
Scale		Date	08/03/04
Client	GE Infrastructure	Project Title	Water Treatment Plant
Drawing No.	WT-GLOW-G-001	Drawing Title	P&ID
Sheet	5	Sheet	8/11



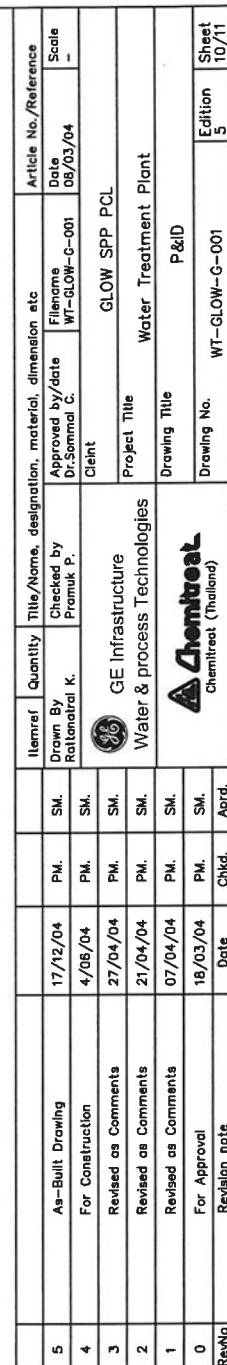

[illegible]



ภาคผนวก ข-23

---

แผนการซ่อมบำรุงระบบบำบัดน้ำเสีย ประจำปี 2567



Maintenance Plan	Maintenance Item	Maintenance Item Description	Equipment	Group	Group Counter	Maint. Planner Group	Main Work Center	Order Type	Max/Active Qty	Functional Location	MEO Index	Maintenance Plan	Location	Description of Functional location	Maintenance Strategy	Cycle Description
P064031PA-08	228	PM Condensate pump 1A, 1B and 1C	1000071288	4251PA-3	1	P06	MECH06-2	PA001	PTB	4251-46-QWSP-P-1B	8	4251	QHD	Pump, Service Water Pump 1B	MONTH	every 3 months
P064031PA-09	371	PM for WTP: Rotating Pump of Water export	1000011875	4251PA-3	5	P06	MECH06-2	PA001	PTB	4301-90-QWWD-P-3	8	4301	QGF	Pump, WTP1 Clean in Place (CIP) Pump	MONTH	every 3 months
P064031PA-09	416	PM for RO-1: Rotating Pump - Quarterly	2000002843	4251PA-3	1	P06	MECH06-1	PA001	PTB	4251-46-QWSP-P-1B	8	4251	QGF	Pump, WTP1 Clean in Place (CIP) Pump	MONTH	every 3 months
P064031PA-09	417	PM for WTP: Agitator - Quarterly	2000002843	4251PA-3	1	P06	MECH06-1	PA001	PTB	4251-46-QWSP-P-1B	8	4251	QGF	Pump, WTP1 Clean in Place (CIP) Pump	MONTH	every 3 months
P064031PA-09	418	PM for WTP: Agitator - Quarterly	2000002843	4251PA-3	1	P06	MECH06-1	PA001	PTB	4251-46-QWSP-P-1B	8	4251	QGF	Pump, WTP1 Clean in Place (CIP) Pump	MONTH	every 3 months
P064031PA-09	419	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	420	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	421	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	422	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	423	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	424	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	425	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	426	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	427	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	428	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	429	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	430	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	431	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	432	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	433	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	434	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	435	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	436	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	437	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	438	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	439	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	440	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	441	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	442	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	443	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	444	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	445	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	446	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	447	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	448	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	449	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	450	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	451	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	452	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	453	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	454	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	455	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	456	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	457	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	458	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	459	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	460	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	461	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	462	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	463	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	464	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	465	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	466	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	467	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	468	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	469	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	470	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	471	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	472	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	473	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	474	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	475	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	476	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06	MECH06-1	PA001	PTB	4257-90-3CWTP-P-301	8	4257	GEA	Pump, Desalg. WTP3, Chlorine Pump 1	MONTH	every 3 months
P064031PA-09	477	PM for CFF Plant 300m3/hr: Rotating Pump - Quarterly	1000016521	4257PA-3	1	P06										



1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	-----



[illegible]











[illegible]



[illegible]











[illegible]



[illegible]



[illegible]

Project	Phase	Start Date	End Date	Duration	Frequency	Unit	Location	Notes
Project A	Phase 1	2023-01-01	2023-03-31	3 Months	Weekly	10000	Site A	Initial site assessment and planning.
	Phase 2	2023-04-01	2023-06-30	3 Months	Weekly	20000	Site A	Foundation work and structural steel erection.
	Phase 3	2023-07-01	2023-09-30	3 Months	Weekly	30000	Site A	Roofing and interior wall construction.
	Phase 4	2023-10-01	2023-12-31	3 Months	Weekly	40000	Site A	Final finishing, painting, and landscaping.
	Phase 5	2024-01-01	2024-03-31	3 Months	Weekly	50000	Site A	Commissioning and handover.
	Phase 6	2024-04-01	2024-06-30	3 Months	Weekly	60000	Site A	Post-project evaluation and documentation.
	Phase 7	2024-07-01	2024-09-30	3 Months	Weekly	70000	Site A	Final inspection and sign-off.
	Phase 8	2024-10-01	2024-12-31	3 Months	Weekly	80000	Site A	Archival and project closure.
	Phase 9	2025-01-01	2025-03-31	3 Months	Weekly	90000	Site A	Final report and lessons learned.
	Phase 10	2025-04-01	2025-06-30	3 Months	Weekly	100000	Site A	Project completion and final review.
Project B	Phase 1	2023-01-01	2023-03-31	3 Months	Weekly	10000	Site B	Initial site assessment and planning.
	Phase 2	2023-04-01	2023-06-30	3 Months	Weekly	20000	Site B	Foundation work and structural steel erection.
	Phase 3	2023-07-01	2023-09-30	3 Months	Weekly	30000	Site B	Roofing and interior wall construction.
	Phase 4	2023-10-01	2023-12-31	3 Months	Weekly	40000	Site B	Final finishing, painting, and landscaping.
	Phase 5	2024-01-01	2024-03-31	3 Months	Weekly	50000	Site B	Commissioning and handover.
	Phase 6	2024-04-01	2024-06-30	3 Months	Weekly	60000	Site B	Post-project evaluation and documentation.
	Phase 7	2024-07-01	2024-09-30	3 Months	Weekly	70000	Site B	Final inspection and sign-off.
	Phase 8	2024-10-01	2024-12-31	3 Months	Weekly	80000	Site B	Archival and project closure.
	Phase 9	2025-01-01	2025-03-31	3 Months	Weekly	90000	Site B	Final report and lessons learned.
	Phase 10	2025-04-01	2025-06-30	3 Months	Weekly	100000	Site B	Project completion and final review.
Project C	Phase 1	2023-01-01	2023-03-31	3 Months	Weekly	10000	Site C	Initial site assessment and planning.
	Phase 2	2023-04-01	2023-06-30	3 Months	Weekly	20000	Site C	Foundation work and structural steel erection.
	Phase 3	2023-07-01	2023-09-30	3 Months	Weekly	30000	Site C	Roofing and interior wall construction.
	Phase 4	2023-10-01	2023-12-31	3 Months	Weekly	40000	Site C	Final finishing, painting, and landscaping.
	Phase 5	2024-01-01	2024-03-31	3 Months	Weekly	50000	Site C	Commissioning and handover.
	Phase 6	2024-04-01	2024-06-30	3 Months	Weekly	60000	Site C	Post-project evaluation and documentation.
	Phase 7	2024-07-01	2024-09-30	3 Months	Weekly	70000	Site C	Final inspection and sign-off.
	Phase 8	2024-10-01	2024-12-31	3 Months	Weekly	80000	Site C	Archival and project closure.
	Phase 9	2025-01-01	2025-03-31	3 Months	Weekly	90000	Site C	Final report and lessons learned.
	Phase 10	2025-04-01	2025-06-30	3 Months	Weekly	100000	Site C	Project completion and final review.



## ภาคผนวก ข-24

---

ผลการตรวจวัดอุณหภูมิ และคลอรีนจากเครื่อง  
ตรวจวัดแบบอัตโนมัติของโรงไฟฟ้า  
ระหว่างเดือนกรกฎาคม ถึงธันวาคม พ.ศ. 2567

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB CHRC-TT-2001A1			3HYB CHRC-AT-1A1	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)		
01-Jul-24 01:00:00	38.86180934	0.053908692		
01-Jul-24 02:00:00	38.12383646	0.050998824		
01-Jul-24 03:00:00	37.28078257	0.033617149		
01-Jul-24 04:00:00	37.42266574	0.027756992		
01-Jul-24 05:00:00	36.89199142	0.025410957		
01-Jul-24 06:00:00	36.48519417	0.025569356		
01-Jul-24 07:00:00	36.4164725	0.040076224		
01-Jul-24 08:00:00	38.78593101	0.034401053		
01-Jul-24 09:00:00	39.94566232	0.029465706		
01-Jul-24 10:00:00	39.34207475	0.022543779		
01-Jul-24 11:00:00	39.30966458	0.014815591		
01-Jul-24 12:00:00	39.94897675	0.033646052		
01-Jul-24 13:00:00	38.71234683	0.036638073		
01-Jul-24 14:00:00	37.91225364	0.028377899		
01-Jul-24 15:00:00	37.09703184	0.021141393		
01-Jul-24 16:00:00	37.07374871	0.022538507		
01-Jul-24 17:00:00	36.74190152	0.038558725		
01-Jul-24 18:00:00	36.34318484	0.028065614		
01-Jul-24 19:00:00	34.77369894	0.026649391		
01-Jul-24 20:00:00	34.87556776	0.022758426		
01-Jul-24 21:00:00	35.46857237	0.023409623		
01-Jul-24 22:00:00	35.89356614	0.022610812		
01-Jul-24 23:00:00	35.65360883	0.02155739		
02-Jul-24 00:00:00	35.43071655	0.021589958		
02-Jul-24 01:00:00	35.61655984	0.021622765		
02-Jul-24 02:00:00	35.90774219	0.020350647		
02-Jul-24 03:00:00	34.91170567	0.020986937		
02-Jul-24 04:00:00	35.0775473	0.014262426		
02-Jul-24 05:00:00	34.43699869	0.007785964		
02-Jul-24 06:00:00	34.95245371	0.010967442		
02-Jul-24 07:00:00	35.29765595	0.021708277		
02-Jul-24 08:00:00	35.85686886	0.031973768		
02-Jul-24 09:00:00	37.54276256	0.04174932		
02-Jul-24 10:00:00	35.0365944	0.027867548		
02-Jul-24 11:00:00	39.47806414	0.030337697		
02-Jul-24 12:00:00	38.95143027	0.028118346		
02-Jul-24 13:00:00	39.47315479	0.039617802		
02-Jul-24 14:00:00	38.70872893	0.032899785		
02-Jul-24 15:00:00	38.57100781	0.026582435		
02-Jul-24 16:00:00	37.4863473	0.043574772		
02-Jul-24 17:00:00	34.37257097	0.02745103		
02-Jul-24 18:00:00	34.86145291	0.027315353		
02-Jul-24 19:00:00	34.91771456	0.025900548		
02-Jul-24 20:00:00	35.53476459	0.024834616		
02-Jul-24 21:00:00	36.4755893	0.025974697		
02-Jul-24 22:00:00	37.08703519	0.025212882		
02-Jul-24 23:00:00	36.95530053	0.031467075		
03-Jul-24 00:00:00	36.49744389	0.027620141		
03-Jul-24 01:00:00	35.64340245	0.035658231		
03-Jul-24 02:00:00	35.75449144	0.030294291		
03-Jul-24 03:00:00	35.90833332	0.026539967		

3HYB CHRC-TT-2001A1			3HYB CHRC-AT-1A1	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)		
03-Jul-24 04:00:00	35.72113872	0.023310477		
03-Jul-24 05:00:00	35.69283408	0.024693979		
03-Jul-24 06:00:00	35.71159669	0.023667275		
03-Jul-24 07:00:00	36.26413795	0.021522337		
03-Jul-24 08:00:00	36.6510175	0.023260637		
03-Jul-24 09:00:00	37.43134359	0.03230197		
03-Jul-24 10:00:00	37.92495751	0.034439933		
03-Jul-24 11:00:00	37.92943921	0.035571587		
03-Jul-24 12:00:00	37.44566365	0.02851754		
03-Jul-24 13:00:00	37.73921688	0.028656538		
03-Jul-24 14:00:00	38.03302774	0.028802038		
03-Jul-24 15:00:00	36.91919785	0.042066017		
03-Jul-24 16:00:00	36.1971906	0.024899927		
03-Jul-24 17:00:00	35.57546815	0.035182546		
03-Jul-24 18:00:00	36.11048796	0.026456386		
03-Jul-24 19:00:00	36.12321528	0.03360638		
03-Jul-24 20:00:00	36.33698428	0.026382554		
03-Jul-24 21:00:00	37.04893636	0.022626355		
03-Jul-24 22:00:00	37.5720896	0.02280248		
03-Jul-24 23:00:00	37.26527057	0.028658442		
04-Jul-24 00:00:00	36.94727523	0.024687403		
04-Jul-24 01:00:00	36.45314594	0.022752466		
04-Jul-24 02:00:00	35.8792204	0.024726825		
04-Jul-24 03:00:00	35.61993011	0.036538317		
04-Jul-24 04:00:00	35.36070504	0.023333982		
04-Jul-24 05:00:00	35.08643666	0.019932952		
04-Jul-24 06:00:00	35.12382197	0.018832426		
04-Jul-24 07:00:00	35.44438642	0.023493626		
04-Jul-24 08:00:00	35.40680083	0.023036658		
04-Jul-24 09:00:00	36.96075184	0.020653281		
04-Jul-24 10:00:00	37.7406316	0.02564777		
04-Jul-24 11:00:00	35.66896403	0.019676209		
04-Jul-24 12:00:00	35.38097563	0.020639505		
04-Jul-24 13:00:00	34.38964552	0.027454442		
04-Jul-24 14:00:00	34.51235109	0.024997459		
04-Jul-24 15:00:00	35.30788956	0.02837008		
04-Jul-24 16:00:00	34.97035228	0.032633204		
04-Jul-24 17:00:00	34.68461874	0.024307614		
04-Jul-24 18:00:00	34.68854086	0.024668628		
04-Jul-24 19:00:00	34.85508067	0.022333883		
04-Jul-24 20:00:00	34.84114888	0.022511714		
04-Jul-24 21:00:00	34.80840893	0.02358859		
04-Jul-24 22:00:00	36.35214732	0.02177141		
04-Jul-24 23:00:00	36.56230473	0.0323335056		
05-Jul-24 00:00:00	36.10094733	0.025913889		
05-Jul-24 01:00:00	35.31666579	0.026394683		
05-Jul-24 02:00:00	32.34039011	0.022032422		
05-Jul-24 03:00:00	30.4942215	0.02352388		
05-Jul-24 04:00:00	30.58051295	0.024374094		
05-Jul-24 05:00:00	33.06986679	0.022755219		
05-Jul-24 06:00:00	35.49226651	0.022737759		

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
05-Jul-24 07:00:00	33.74984084	0.02563946	
05-Jul-24 08:00:00	34.58006487	0.028540607	
05-Jul-24 09:00:00	36.21315319	0.032077724	
05-Jul-24 10:00:00	36.94116914	0.022227117	
05-Jul-24 11:00:00	37.48445874	0.025823207	
05-Jul-24 12:00:00	38.65483189	0.031726415	
05-Jul-24 13:00:00	38.86557039	0.027589088	
05-Jul-24 14:00:00	37.78897328	0.029200307	
05-Jul-24 15:00:00	36.3182418	0.028163061	
05-Jul-24 16:00:00	36.2039203	0.02781706	
05-Jul-24 17:00:00	35.95659766	0.026812626	
05-Jul-24 18:00:00	36.0504448	0.024777224	
05-Jul-24 19:00:00	35.53644431	0.029179216	
05-Jul-24 20:00:00	35.42189595	0.027548488	
05-Jul-24 21:00:00	35.50989547	0.028547068	
05-Jul-24 22:00:00	36.26880185	0.025809586	
05-Jul-24 23:00:00	33.95880991	0.021924804	
06-Jul-24 00:00:00	34.81367535	0.035298578	
06-Jul-24 01:00:00	35.8287402	0.03159281	
06-Jul-24 02:00:00	36.52884038	0.030006112	
06-Jul-24 03:00:00	33.73524425	0.028397963	
06-Jul-24 04:00:00	33.85307032	0.029233974	
06-Jul-24 05:00:00	33.79958892	0.029866094	
06-Jul-24 06:00:00	33.89234865	0.0297326	
06-Jul-24 07:00:00	34.17147784	0.036419331	
06-Jul-24 08:00:00	34.70570376	0.034065376	
06-Jul-24 09:00:00	36.05438861	0.030473221	
06-Jul-24 10:00:00	37.04269785	0.023155749	
06-Jul-24 11:00:00	37.61119477	0.023236423	
06-Jul-24 12:00:00	36.14544813	0.02359599	
06-Jul-24 13:00:00	37.34834709	0.023763784	
06-Jul-24 14:00:00	37.9622261	0.024174533	
06-Jul-24 15:00:00	37.7212508	0.02455229	
06-Jul-24 16:00:00	36.78491845	0.02455775	
06-Jul-24 17:00:00	35.97249907	0.02444718	
06-Jul-24 18:00:00	35.38845685	0.024328393	
06-Jul-24 19:00:00	35.10641932	0.023999956	
06-Jul-24 20:00:00	35.08778367	0.024568013	
06-Jul-24 21:00:00	35.15413827	0.024603639	
06-Jul-24 22:00:00	35.17294296	0.02386565	
06-Jul-24 23:00:00	35.41406711	0.023653808	
07-Jul-24 00:00:00	36.00366863	0.023457195	
07-Jul-24 01:00:00	35.95161895	0.023712752	
07-Jul-24 02:00:00	35.57791743	0.02370306	
07-Jul-24 03:00:00	35.37241166	0.023842112	
07-Jul-24 04:00:00	35.18801922	0.023999422	
07-Jul-24 05:00:00	34.87234736	0.02403378	
07-Jul-24 06:00:00	34.78935788	0.023786839	
07-Jul-24 07:00:00	34.87696258	0.023720918	
07-Jul-24 08:00:00	35.234400785	0.023686411	
07-Jul-24 09:00:00	35.87798001	0.023715125	

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
07-Jul-24 10:00:00	36.74592249	0.023895716	
07-Jul-24 11:00:00	37.37268144	-	
07-Jul-24 12:00:00	37.83818839	0.023942189	
07-Jul-24 13:00:00	38.49754908	0.0240432	
07-Jul-24 14:00:00	37.97760975	0.023846934	
07-Jul-24 15:00:00	37.39144513	0.024419488	
07-Jul-24 16:00:00	36.57820662	0.024680583	
07-Jul-24 17:00:00	36.00105516	0.024832482	
07-Jul-24 18:00:00	35.61596872	0.025087781	
07-Jul-24 19:00:00	35.27205853	0.024784262	
07-Jul-24 20:00:00	35.20632842	0.024563683	
07-Jul-24 21:00:00	35.60287413	0.024513838	
07-Jul-24 22:00:00	35.93503859	0.02425571	
07-Jul-24 23:00:00	35.63903987	0.02357449	
08-Jul-24 00:00:00	35.2901046	0.023385641	
08-Jul-24 01:00:00	35.0533221	0.023754734	
08-Jul-24 02:00:00	34.89862723	0.023974058	
08-Jul-24 03:00:00	34.81205478	0.023843977	
08-Jul-24 04:00:00	34.87930857	0.023815409	
08-Jul-24 05:00:00	35.04482762	0.023824904	
08-Jul-24 06:00:00	34.75067761	0.023598017	
08-Jul-24 07:00:00	34.39957786	0.023431284	
08-Jul-24 08:00:00	34.7004205	0.023394926	
08-Jul-24 09:00:00	35.62946538	0.023215859	
08-Jul-24 10:00:00	36.58069527	0.023155453	
08-Jul-24 11:00:00	36.81889487	0.023057839	
08-Jul-24 12:00:00	37.76536318	0.023444041	
08-Jul-24 13:00:00	36.91556003	0.024002626	
08-Jul-24 14:00:00	36.3470984	0.023934682	
08-Jul-24 15:00:00	36.31245665	0.024368753	
08-Jul-24 16:00:00	37.01620509	0.023843286	
08-Jul-24 17:00:00	36.48215551	0.023941803	
08-Jul-24 18:00:00	35.9418374	0.023889321	
08-Jul-24 19:00:00	35.68844743	0.023550161	
08-Jul-24 20:00:00	35.40035355	0.023351881	
08-Jul-24 21:00:00	35.62826637	0.024288238	
08-Jul-24 22:00:00	35.98044109	0.024004703	
08-Jul-24 23:00:00	35.82207464	0.024221886	
09-Jul-24 00:00:00	36.1376637	0.024265402	
09-Jul-24 01:00:00	36.28671741	0.024087779	
09-Jul-24 02:00:00	35.92732543	0.024197359	
09-Jul-24 03:00:00	35.6684755	0.023831431	
09-Jul-24 04:00:00	36.94433298	0.023239517	
09-Jul-24 05:00:00	36.86552319	0.023132112	
09-Jul-24 06:00:00	36.2035622	0.023195754	
09-Jul-24 07:00:00	35.00355575	0.023099921	
09-Jul-24 08:00:00	35.17024954	0.022753228	
09-Jul-24 09:00:00	35.83978079	0.023026784	
09-Jul-24 10:00:00	36.13200171	0.023214128	
09-Jul-24 11:00:00	35.38258011	0.023571089	
09-Jul-24 12:00:00	36.63732108	0.023529382	



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name #1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name #1	
Time Interval	1h

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
09-Jul-24 13:00:00	37.67076641	0.024271435	
09-Jul-24 14:00:00	36.42392311	0.024489605	
09-Jul-24 15:00:00	36.17878092	0.024492476	
09-Jul-24 16:00:00	36.15307226	0.01633938	
09-Jul-24 17:00:00	35.5504374	0.00807295	
09-Jul-24 18:00:00	35.54620841	0.006279901	
09-Jul-24 19:00:00	35.16609566	0.006152884	
09-Jul-24 20:00:00	35.29429055	0.00721396	
09-Jul-24 21:00:00	35.70513792	0.006398877	
09-Jul-24 22:00:00	35.8627114	0.006161793	
09-Jul-24 23:00:00	36.28239554	0.006123077	
10-Jul-24 00:00:00	36.45100633	0.007038445	
10-Jul-24 01:00:00	36.38912153	0.005998929	
10-Jul-24 02:00:00	36.01684129	0.004631397	
10-Jul-24 03:00:00	35.77981625	0.005194918	
10-Jul-24 04:00:00	35.71963472	0.005164219	
10-Jul-24 05:00:00	35.48028174	0.005122665	
10-Jul-24 06:00:00	34.73762801	0.005329168	
10-Jul-24 07:00:00	34.98870339	0.005136026	
10-Jul-24 08:00:00	35.29122887	0.004993665	
10-Jul-24 09:00:00	35.82062212	0.004145101	
10-Jul-24 10:00:00	35.66690855	0.002892004	
10-Jul-24 11:00:00	37.62056694	0.002934176	
10-Jul-24 12:00:00	37.27044571	0.002717243	
10-Jul-24 13:00:00	37.59195814	0.0068513483	
10-Jul-24 14:00:00	38.42937268	0.078542106	
10-Jul-24 15:00:00	37.69841793	0.086954146	
10-Jul-24 16:00:00	37.03485774	0.085994466	
10-Jul-24 17:00:00	36.73873697	0.001894991	
10-Jul-24 18:00:00	37.00980171	0.003052992	
10-Jul-24 19:00:00	37.1463503	0.002712956	
10-Jul-24 20:00:00	36.52847538	0.004471238	
10-Jul-24 21:00:00	37.38545028	0.00371778	
10-Jul-24 22:00:00	36.33982462	0.071277227	
10-Jul-24 23:00:00	35.32180906	0.07867053	
11-Jul-24 00:00:00	35.41691879	0.075905595	
11-Jul-24 01:00:00	35.08989295	0.001093761	
11-Jul-24 02:00:00	35.46117989	0.001108902	
11-Jul-24 03:00:00	34.73602007	0.002099162	
11-Jul-24 04:00:00	35.3575085	0.002962689	
11-Jul-24 05:00:00	35.58504599	0.071111654	
11-Jul-24 06:00:00	35.35010033	0.070599145	
11-Jul-24 07:00:00	35.27007132	0.001237937	
11-Jul-24 08:00:00	35.49047713	0.002803757	
11-Jul-24 09:00:00	35.1705381	0.002292121	
11-Jul-24 10:00:00	35.46159044	0.002163519	
11-Jul-24 11:00:00	36.16167348	0.002346253	
11-Jul-24 12:00:00	36.70991699	0.001114801	
11-Jul-24 13:00:00	0.001531095	0.001531095	
11-Jul-24 14:00:00	38.41846212	0.003537896	
11-Jul-24 15:00:00	39.80308606	0.003837655	

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
11-Jul-24 16:00:00	36.23943874	0.002603859	
11-Jul-24 17:00:00	35.65569843	0.003918034	
11-Jul-24 18:00:00	34.93378053	0.004115286	
11-Jul-24 19:00:00	34.68914089	0.002700673	
11-Jul-24 20:00:00	35.00347301	0.002585765	
11-Jul-24 21:00:00	35.23736697	0.002598519	
11-Jul-24 22:00:00	34.88948616	0.002913255	
11-Jul-24 23:00:00	34.87341662	0.002925442	
12-Jul-24 00:00:00	34.98409822	0.003009946	
12-Jul-24 01:00:00	34.94649116	0.00314458	
12-Jul-24 02:00:00	34.71802989	0.01339282	
12-Jul-24 03:00:00	34.81886544	0.022359933	
12-Jul-24 04:00:00	34.80346413	0.022824072	
12-Jul-24 05:00:00	34.64105349	0.022846508	
12-Jul-24 06:00:00	34.35037163	0.015975106	
12-Jul-24 07:00:00	34.54288655	0.004069145	
12-Jul-24 08:00:00	34.85094242	0.0035737	
12-Jul-24 09:00:00	35.12870075	0.003781741	
12-Jul-24 10:00:00	35.6759397	0.003094198	
12-Jul-24 11:00:00	36.88427233	0.002197772	
12-Jul-24 12:00:00	37.92109524	0.001552585	
12-Jul-24 13:00:00	37.20094733	0.001070711	
12-Jul-24 14:00:00	36.74422818	0.094087155	
12-Jul-24 15:00:00	36.43337034	0.002286709	
12-Jul-24 16:00:00	36.46481497	0.002056214	
12-Jul-24 17:00:00	35.77566823	0.010316501	
12-Jul-24 18:00:00	35.14212442	0.005034464	
12-Jul-24 19:00:00	34.5777414	0.00156703	
12-Jul-24 20:00:00	34.57149534	0.001527796	
12-Jul-24 21:00:00	34.51345663	0.080624225	
12-Jul-24 22:00:00	35.00994484	0.068835504	
12-Jul-24 23:00:00	35.19957539	0.092524069	
13-Jul-24 00:00:00	35.2282814	0.080244263	
13-Jul-24 01:00:00	35.35216457	0.07838886	
13-Jul-24 02:00:00	35.19719684	0.009193744	
13-Jul-24 03:00:00	35.1116107	0.01224493	
13-Jul-24 04:00:00	35.22212223	0.022171703	
13-Jul-24 05:00:00	34.86916492	0.023626676	
13-Jul-24 06:00:00	34.67834804	0.016291321	
13-Jul-24 07:00:00	35.15496559	0.002784691	
13-Jul-24 08:00:00	35.35038129	0.002764707	
13-Jul-24 09:00:00	36.33427126	0.002156273	
13-Jul-24 10:00:00	37.19193312	0.001014356	
13-Jul-24 11:00:00	37.19876236	0.068563135	
13-Jul-24 12:00:00	38.69337455	0.001548819	
13-Jul-24 13:00:00	38.81221963	0.001559016	
13-Jul-24 14:00:00	39.07010638	0.001673916	
13-Jul-24 15:00:00	37.11900544	0.08349835	
13-Jul-24 16:00:00	36.86406856	0.068395967	
13-Jul-24 17:00:00	35.98421417	0.003508704	
13-Jul-24 18:00:00	35.14497221	0.001863073	

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name Pl	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name Pl	
Time Interval	1h

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
13-Jul-24 19:00:00	34.32468395	0.070220922	
13-Jul-24 20:00:00	33.09776307	0.08724173	
13-Jul-24 21:00:00	32.82456005	0.062974796	
13-Jul-24 22:00:00	32.92940501	0.06744212	
13-Jul-24 23:00:00	33.18371557	0.070276116	
14-Jul-24 00:00:00	33.10494572	0.062386478	
14-Jul-24 01:00:00	33.66064428	0.076350644	
14-Jul-24 02:00:00	34.31924025	0.016647157	
14-Jul-24 03:00:00	33.98005852	0.022830963	
14-Jul-24 04:00:00	35.69875333	0.023213704	
14-Jul-24 05:00:00	34.43842309	0.02326689	
14-Jul-24 06:00:00	34.05000454	0.013510498	
14-Jul-24 07:00:00	34.04590025	0.001461048	
14-Jul-24 08:00:00	34.40806595	0.001654887	
14-Jul-24 09:00:00	34.54639356	0.001234611	
14-Jul-24 10:00:00	35.28301478	0.075792142	
14-Jul-24 11:00:00	36.05363423	0.069224735	
14-Jul-24 12:00:00	36.56932259	0.077333558	
14-Jul-24 13:00:00	36.74412447	0.078518657	
14-Jul-24 14:00:00	36.56911304	0.092737223	
14-Jul-24 15:00:00	36.04759076	0.073656203	
14-Jul-24 16:00:00	35.57004381	0.076959929	
14-Jul-24 17:00:00	34.56213484	0.073320752	
14-Jul-24 18:00:00	34.0408879	0.093683713	
14-Jul-24 19:00:00	33.59486812	0.089077759	
14-Jul-24 20:00:00	34.48951274	0.090327055	
14-Jul-24 21:00:00	33.4865604	0.092137205	
14-Jul-24 22:00:00	33.75100019	0.097409126	
14-Jul-24 23:00:00	34.31369586	0.090235051	
15-Jul-24 00:00:00	34.73627863	0.08617005	
15-Jul-24 01:00:00	35.09695957	0.028324645	
15-Jul-24 02:00:00	35.27861993	0.051194809	
15-Jul-24 03:00:00	35.2381575	0.042428267	
15-Jul-24 04:00:00	35.29086171	0.040727134	
15-Jul-24 05:00:00	35.312121777	0.035107021	
15-Jul-24 06:00:00	35.3198455	0.04268927	
15-Jul-24 07:00:00	35.47564776	0.040414809	
15-Jul-24 08:00:00	35.73822091	0.030811913	
15-Jul-24 09:00:00	36.2593227	0.039991515	
15-Jul-24 10:00:00	37.57214726	0.022206156	
15-Jul-24 11:00:00	37.20936028	0.020223365	
15-Jul-24 12:00:00	36.53387174	0.02474262	
15-Jul-24 13:00:00	35.41280986	0.021143131	
15-Jul-24 14:00:00	35.78950422	0.037861462	
15-Jul-24 15:00:00	35.34956989	0.036952452	
15-Jul-24 16:00:00	35.37814072	0.033422851	
15-Jul-24 17:00:00	35.18641452	0.037273994	
15-Jul-24 18:00:00	35.18023049	0.033394848	
15-Jul-24 19:00:00	35.09176874	0.024005032	
15-Jul-24 20:00:00	35.08545413	0.025664399	
15-Jul-24 21:00:00	35.01069544	0.017901731	

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
15-Jul-24 22:00:00	34.61730416	0.017540081	
15-Jul-24 23:00:00	34.74778836	0.018646205	
16-Jul-24 00:00:00	35.4513662	0.019930403	
16-Jul-24 01:00:00	35.26797784	0.016876569	
16-Jul-24 02:00:00	34.33455433	0.016786267	
16-Jul-24 03:00:00	33.76293601	0.018043316	
16-Jul-24 04:00:00	35.04239272	0.020358479	
16-Jul-24 05:00:00	34.44082669	0.018813839	
16-Jul-24 06:00:00	34.93195117	0.019070073	
16-Jul-24 07:00:00	34.86713641	0.019411584	
16-Jul-24 08:00:00	35.49125714	0.023997573	
16-Jul-24 09:00:00	35.80602611	0.018649561	
16-Jul-24 10:00:00	36.30851501	0.022514352	
16-Jul-24 11:00:00	36.14528951	0.018720656	
16-Jul-24 12:00:00	35.90923331	0.020455506	
16-Jul-24 13:00:00	35.7429401	0.024697793	
16-Jul-24 14:00:00	37.09737645	0.014859251	
16-Jul-24 15:00:00	36.33994209	0.021373568	
16-Jul-24 16:00:00	35.41896614	0.015252492	
16-Jul-24 17:00:00	34.63148078	0.015595631	
16-Jul-24 18:00:00	37.21592639	0.017802236	
16-Jul-24 19:00:00	34.32821548	0.027887194	
16-Jul-24 20:00:00	34.25051549	0.023103863	
16-Jul-24 21:00:00	34.54107417	0.018071777	
16-Jul-24 22:00:00	34.58994689	0.009751271	
16-Jul-24 23:00:00	34.51186221	0.039058945	
17-Jul-24 00:00:00	34.46723826	0.031388511	
17-Jul-24 01:00:00	34.46053696	0.019399943	
17-Jul-24 02:00:00	34.44116116	0.015536753	
17-Jul-24 03:00:00	34.56210971	0.014286338	
17-Jul-24 04:00:00	35.03032255	0.014425065	
17-Jul-24 05:00:00	35.48557784	0.013545969	
17-Jul-24 06:00:00	35.33504715	0.013335779	
17-Jul-24 07:00:00	34.38810468	0.01297566	
17-Jul-24 08:00:00	35.21518826	0.013276566	
17-Jul-24 09:00:00	35.75030963	0.013408375	
17-Jul-24 10:00:00	36.11924779	0.08747287	
17-Jul-24 11:00:00	37.16382619	0.026384435	
17-Jul-24 12:00:00	36.5497027	0.023341586	
17-Jul-24 13:00:00	36.45822654	0.01204789	
17-Jul-24 14:00:00	36.06643013	0.01444276	
17-Jul-24 15:00:00	35.78682179	0.025855255	
17-Jul-24 16:00:00	35.35737538	0.07202548	
17-Jul-24 17:00:00	35.14096509	0.088114217	
17-Jul-24 18:00:00	36.2835728	0.064667257	
17-Jul-24 19:00:00	34.67706034	0.063102553	
17-Jul-24 20:00:00	34.57030495	0.062647415	
17-Jul-24 21:00:00	34.48100825	0.0623768	
17-Jul-24 22:00:00	34.38900127	0.0631125	
17-Jul-24 23:00:00	34.54980439	0.062444993	
18-Jul-24 00:00:00	34.8798325	0.055046494	



Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2001A1	3HYB-CHRC-AT-1A1
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
18-Jul-24 01:00:00	34.9884716	0.069261404
18-Jul-24 02:00:00	35.013566	0.011661208
18-Jul-24 03:00:00	35.03553596	0.011929585
18-Jul-24 04:00:00	34.964475	0.008124842
18-Jul-24 05:00:00	35.11497913	0.007693334
18-Jul-24 06:00:00	37.71866141	0.007849966
18-Jul-24 07:00:00	35.6973696	0.004613259
18-Jul-24 08:00:00	34.51864033	0.003466027
18-Jul-24 09:00:00	35.12137625	0.006124623
18-Jul-24 10:00:00	36.36243756	0.006073709
18-Jul-24 11:00:00	36.8470259	0.006963839
18-Jul-24 12:00:00	36.04914101	0.011421771
18-Jul-24 13:00:00	36.59416942	0.00890515
18-Jul-24 14:00:00	36.35092219	0.008823269
18-Jul-24 15:00:00	35.31462504	0.005267721
18-Jul-24 16:00:00	35.31738195	0.003324564
18-Jul-24 17:00:00	34.75557068	0.004280235
18-Jul-24 18:00:00	34.68411694	0.003512454
18-Jul-24 19:00:00	34.39538161	0.004810265
18-Jul-24 20:00:00	34.48653908	0.004180242
18-Jul-24 21:00:00	34.43338799	0.006189247
18-Jul-24 22:00:00	34.69687924	0.005972276
18-Jul-24 23:00:00	34.60789397	0.004324813
19-Jul-24 00:00:00	34.42863592	0.004621228
19-Jul-24 01:00:00	34.38316212	0.004258262
19-Jul-24 02:00:00	34.35286938	0.003959763
19-Jul-24 03:00:00	34.12582538	0.003964379
19-Jul-24 04:00:00	33.76641343	0.002787506
19-Jul-24 05:00:00	33.99321408	0.00424682
19-Jul-24 06:00:00	33.99238101	0.004844839
19-Jul-24 07:00:00	33.9937828	0.006210634
19-Jul-24 08:00:00	34.2619798	0.004240894
19-Jul-24 09:00:00	34.57069731	0.00562361
19-Jul-24 10:00:00	35.55981598	0.002337149
19-Jul-24 11:00:00	36.00079265	0.003492218
19-Jul-24 12:00:00	36.75467639	0.019658511
19-Jul-24 13:00:00	36.81869253	0.002423024
19-Jul-24 14:00:00	35.39147156	0.003332399
19-Jul-24 15:00:00	35.48659848	0.073346906
19-Jul-24 16:00:00	34.81940744	0.001627798
19-Jul-24 17:00:00	34.80905882	0.002066159
19-Jul-24 18:00:00	34.65576381	0.001360723
19-Jul-24 19:00:00	34.35384335	0.067567442
19-Jul-24 20:00:00	34.41306569	0.068672503
19-Jul-24 21:00:00	34.36413469	0.07924346
19-Jul-24 22:00:00	34.8598877	0.065942065
19-Jul-24 23:00:00	34.99566661	0.069642910
20-Jul-24 00:00:00	34.91803571	0.078502368
20-Jul-24 01:00:00	35.0221712	0.06965292
20-Jul-24 02:00:00	35.09384777	0.07047754
20-Jul-24 03:00:00	34.94665459	0.077699517

3HYB-CHRC-TT-2001A1	3HYB-CHRC-AT-1A1
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
20-Jul-24 04:00:00	34.40586736	0.077694682
20-Jul-24 05:00:00	34.87865838	0.070574898
20-Jul-24 06:00:00	35.45979563	0.069599741
20-Jul-24 07:00:00	35.17421168	0.074746892
20-Jul-24 08:00:00	35.44595239	0.071072881
20-Jul-24 09:00:00	35.493865438	0.072176723
20-Jul-24 10:00:00	35.96789602	0.065916444
20-Jul-24 11:00:00	36.87317458	0.073656666
20-Jul-24 12:00:00	36.69652809	0.070051892
20-Jul-24 13:00:00	36.41491006	0.07564276
20-Jul-24 14:00:00	36.50359076	0.071916859
20-Jul-24 15:00:00	38.14942169	0.069659303
20-Jul-24 16:00:00	35.62454273	0.073614072
20-Jul-24 17:00:00	35.10804478	0.074487338
20-Jul-24 18:00:00	34.944099	0.082897166
20-Jul-24 19:00:00	34.84124237	0.078755348
20-Jul-24 20:00:00	34.98438284	0.08050429
20-Jul-24 21:00:00	34.88927806	0.081964789
20-Jul-24 22:00:00	34.91437557	0.079766298
20-Jul-24 23:00:00	34.69127091	0.081637159
21-Jul-24 00:00:00	34.39514286	0.085938609
21-Jul-24 01:00:00	34.21692114	0.07346608
21-Jul-24 02:00:00	33.94209383	0.089167935
21-Jul-24 03:00:00	33.86077827	0.086477665
21-Jul-24 04:00:00	34.6841569	0.069861875
21-Jul-24 05:00:00	34.62715435	0.083359366
21-Jul-24 06:00:00	34.858652584	0.076174045
21-Jul-24 07:00:00	34.81580946	0.083282537
21-Jul-24 08:00:00	34.92208154	0.071702075
21-Jul-24 09:00:00	35.35846419	0.079564473
21-Jul-24 10:00:00	36.62432679	0.074786423
21-Jul-24 11:00:00	37.62385511	0.080665786
21-Jul-24 12:00:00	37.11421232	0.078717325
21-Jul-24 13:00:00	37.17423646	0.087042701
21-Jul-24 14:00:00	37.77458846	0.086389776
21-Jul-24 15:00:00	37.12175743	0.073920086
21-Jul-24 16:00:00	36.11799632	0.086399516
21-Jul-24 17:00:00	35.87299478	0.085848425
21-Jul-24 18:00:00	35.61819379	0.005664165
21-Jul-24 19:00:00	35.6808457	0.022912852
21-Jul-24 20:00:00	36.3270754	0.022635142
21-Jul-24 21:00:00	36.61280835	0.022763019
21-Jul-24 22:00:00	36.65010779	0.023330505
21-Jul-24 23:00:00	36.52711381	0.023339307
22-Jul-24 00:00:00	36.20267386	0.023172404
22-Jul-24 01:00:00	35.89564178	0.023335707
22-Jul-24 02:00:00	35.12362171	0.022105832
22-Jul-24 03:00:00	35.10287422	0.010015889
22-Jul-24 04:00:00	35.15078208	0.004104442
22-Jul-24 05:00:00	35.14490702	0.003312622
22-Jul-24 06:00:00	35.16769609	0.003868763

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB CHRC-TT-2001AI		3HYB CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
22-Jul-24 07:00:00	35.35945969	0.003501222
22-Jul-24 08:00:00	35.70595116	0.002577888
22-Jul-24 09:00:00	37.38793542	0.002912718
22-Jul-24 10:00:00	38.993803	0.003142163
22-Jul-24 11:00:00	38.1475516	0.003455133
22-Jul-24 12:00:00	38.41131625	0.002836289
22-Jul-24 13:00:00	38.71782412	0.002575192
22-Jul-24 14:00:00	37.91803281	0.002466407
22-Jul-24 15:00:00	36.64433508	0.00171413
22-Jul-24 16:00:00	36.05433346	0.002374705
22-Jul-24 17:00:00	36.48251467	0.005484892
22-Jul-24 18:00:00	36.15288206	0.004607843
22-Jul-24 19:00:00	35.96874565	0.004715066
22-Jul-24 20:00:00	35.78878419	0.004794574
22-Jul-24 21:00:00	35.4553996	0.004350405
22-Jul-24 22:00:00	35.44600476	0.002860073
22-Jul-24 23:00:00	35.08157429	0.001111432
23-Jul-24 00:00:00	35.0945999	0.082078377
23-Jul-24 01:00:00	34.95303829	0.073143698
23-Jul-24 02:00:00	34.71467264	0.08714558
23-Jul-24 03:00:00	34.80468558	0.089176444
23-Jul-24 04:00:00	34.44025702	0.079049112
23-Jul-24 05:00:00	34.88974206	0.069557143
23-Jul-24 06:00:00	35.00092512	0.082327412
23-Jul-24 07:00:00	34.68453734	0.084066897
23-Jul-24 08:00:00	35.29533658	0.081537111
23-Jul-24 09:00:00	35.94918187	0.078568993
23-Jul-24 10:00:00	36.41248501	0.072152468
23-Jul-24 11:00:00	36.58921428	0.070132779
23-Jul-24 12:00:00	37.65023061	0.083153101
23-Jul-24 13:00:00	37.4318876	0.080679453
23-Jul-24 14:00:00	37.07993094	0.068267241
23-Jul-24 15:00:00	36.71399402	0.001143323
23-Jul-24 16:00:00	34.84143394	0.00127608
23-Jul-24 17:00:00	33.38185905	0.001215776
23-Jul-24 18:00:00	34.09871979	0.001401482
23-Jul-24 19:00:00	33.79979305	0.002681679
23-Jul-24 20:00:00	33.39933212	0.002364516
23-Jul-24 21:00:00	33.88945584	0.002083648
23-Jul-24 22:00:00	34.05662558	0.001933679
23-Jul-24 23:00:00	34.29895184	0.001804773
24-Jul-24 00:00:00	34.3760661	0.002452611
24-Jul-24 01:00:00	34.65303932	0.002539997
24-Jul-24 02:00:00	34.78980713	0.00223434
24-Jul-24 03:00:00	34.79236477	0.003061345
24-Jul-24 04:00:00	34.67189155	0.003151484
24-Jul-24 05:00:00	34.38673524	0.003626704
24-Jul-24 06:00:00	34.4721119	0.003196021
24-Jul-24 07:00:00	34.66568237	0.006799258
24-Jul-24 08:00:00	34.75560039	0.004337778
24-Jul-24 09:00:00	35.05209912	0.003481174

3HYB CHRC-TT-2001AI		3HYB CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
24-Jul-24 10:00:00	35.33534326	0.003265776
24-Jul-24 11:00:00	37.10588844	0.002867165
24-Jul-24 12:00:00	37.01416032	0.002676143
24-Jul-24 13:00:00	38.72859541	0.002664989
24-Jul-24 14:00:00	36.7747593	0.003334545
24-Jul-24 15:00:00	36.26668248	0.003248539
24-Jul-24 16:00:00	37.28052747	0.002784788
24-Jul-24 17:00:00	37.85692674	0.002335251
24-Jul-24 18:00:00	34.72946735	0.00108545
24-Jul-24 19:00:00	34.28894886	0.001795758
24-Jul-24 20:00:00	33.81881417	0.001679884
24-Jul-24 21:00:00	33.46486626	0.001668648
24-Jul-24 22:00:00	33.55286342	0.002394329
24-Jul-24 23:00:00	34.01445534	0.002433498
25-Jul-24 00:00:00	33.99661179	0.005780784
25-Jul-24 01:00:00	33.91675655	0.00245952
25-Jul-24 02:00:00	33.83446875	0.001148963
25-Jul-24 03:00:00	33.85535871	0.068319225
25-Jul-24 04:00:00	33.62992264	0.07840506
25-Jul-24 05:00:00	33.43734206	0.069402729
25-Jul-24 06:00:00	33.51204373	0.075285931
25-Jul-24 07:00:00	33.83901132	0.003822306
25-Jul-24 08:00:00	34.4765371	0.004965052
25-Jul-24 09:00:00	35.67789001	0.077459803
25-Jul-24 10:00:00	36.48593547	0.085047467
25-Jul-24 11:00:00	36.57072682	0.084740746
25-Jul-24 12:00:00	36.84716662	0.072048623
25-Jul-24 13:00:00	36.08527108	0.072285246
25-Jul-24 14:00:00	34.28291227	0.06163701
25-Jul-24 15:00:00	34.7793184	0.004511413
25-Jul-24 16:00:00	36.44455505	0.007259707
25-Jul-24 17:00:00	36.60282318	0.006437126
25-Jul-24 18:00:00	36.56093331	0.010678951
25-Jul-24 19:00:00	36.58805629	0.022074322
25-Jul-24 20:00:00	36.61750451	0.02233666
25-Jul-24 21:00:00	36.8179801	0.022480265
25-Jul-24 22:00:00	37.15900819	0.022105832
25-Jul-24 23:00:00	37.48754542	0.021918933
26-Jul-24 00:00:00	37.20633105	0.022005152
26-Jul-24 01:00:00	36.6292002	0.021478611
26-Jul-24 02:00:00	36.88097965	0.019730622
26-Jul-24 03:00:00	37.15197101	0.010302285
26-Jul-24 04:00:00	37.06297333	0.010408658
26-Jul-24 05:00:00	36.56319875	0.009214161
26-Jul-24 06:00:00	34.8286352	0.012830827
26-Jul-24 07:00:00	34.87630633	0.021860758
26-Jul-24 08:00:00	35.26313289	0.021675403
26-Jul-24 09:00:00	35.79220635	0.02189209
26-Jul-24 10:00:00	36.44638912	0.02184355
26-Jul-24 11:00:00	36.4980985	0.021857791
26-Jul-24 12:00:00	36.65783739	0.021892209



Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2007AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
26-Jul-24 13:00:00	36.122545	0.021926539
26-Jul-24 14:00:00	36.4220152	0.014704639
26-Jul-24 15:00:00	36.3693526	0.00823765
26-Jul-24 16:00:00	35.6086177	0.00642301
26-Jul-24 17:00:00	36.5343349	0.007711299
26-Jul-24 18:00:00	36.54909811	0.007864277
26-Jul-24 19:00:00	36.41899634	0.007533804
26-Jul-24 20:00:00	36.37414491	0.00728802
26-Jul-24 21:00:00	36.05719256	0.006731723
26-Jul-24 22:00:00	35.64466425	0.007065011
26-Jul-24 23:00:00	35.82255776	0.006925085
27-Jul-24 00:00:00	35.93202828	0.007669762
27-Jul-24 01:00:00	34.6679317	0.006559853
27-Jul-24 02:00:00	34.41224647	0.006375856
27-Jul-24 03:00:00	34.50117563	0.007833009
27-Jul-24 04:00:00	34.46922954	0.007761317
27-Jul-24 05:00:00	34.3543725	0.007646232
27-Jul-24 06:00:00	34.24588577	0.008116711
27-Jul-24 07:00:00	34.3710572	0.008341456
27-Jul-24 08:00:00	34.54944255	0.007611908
27-Jul-24 09:00:00	34.50068775	0.007328051
27-Jul-24 10:00:00	35.20534493	0.006830568
27-Jul-24 11:00:00	35.13662155	0.006890744
27-Jul-24 12:00:00	35.27832257	0.006929577
27-Jul-24 13:00:00	35.48562127	0.007261668
27-Jul-24 14:00:00	36.70280534	0.00733157
27-Jul-24 15:00:00	35.47647992	0.008752309
27-Jul-24 16:00:00	36.09590092	0.019108286
27-Jul-24 17:00:00	36.32611298	0.010394418
27-Jul-24 18:00:00	34.82571149	0.00624439
27-Jul-24 19:00:00	34.44528029	0.004959034
27-Jul-24 20:00:00	32.47905524	0.004872177
27-Jul-24 21:00:00	37.55553003	0.004467037
27-Jul-24 22:00:00	37.62627148	0.003543373
27-Jul-24 23:00:00	34.31328592	0.003357698
28-Jul-24 00:00:00	35.44639105	0.003459812
28-Jul-24 01:00:00	35.36236173	0.003606096
28-Jul-24 02:00:00	35.49762015	0.003104328
28-Jul-24 03:00:00	36.36109887	0.003082308
28-Jul-24 04:00:00	35.63354378	0.003252403
28-Jul-24 05:00:00	35.83740438	0.003891786
28-Jul-24 06:00:00	36.12791657	0.00435146
28-Jul-24 07:00:00	36.33172592	0.00443245
28-Jul-24 08:00:00	36.47860477	0.004449622
28-Jul-24 09:00:00	36.90231378	0.011980394
28-Jul-24 10:00:00	37.46448936	0.021245753
28-Jul-24 11:00:00	38.5720632	0.021365346
28-Jul-24 12:00:00	39.82417679	0.021622213
28-Jul-24 13:00:00	39.60572686	0.021689267
28-Jul-24 14:00:00	39.94781026	0.021960449
28-Jul-24 15:00:00	39.62023616	0.021699923

3HYB-CHRC-TT-2007AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
28-Jul-24 16:00:00	39.19124354	0.021911395
28-Jul-24 17:00:00	38.44386252	0.021771551
28-Jul-24 18:00:00	38.11819338	0.021761068
28-Jul-24 19:00:00	36.99516244	0.021750387
28-Jul-24 20:00:00	33.79799913	0.02175009
28-Jul-24 21:00:00	33.80777443	0.021457545
28-Jul-24 22:00:00	33.69031817	0.02103215
28-Jul-24 23:00:00	37.10112881	0.020887796
29-Jul-24 00:00:00	37.89862691	0.020676592
29-Jul-24 01:00:00	34.61451379	0.020739099
29-Jul-24 02:00:00	36.4626206	0.020688142
29-Jul-24 03:00:00	37.99251736	0.020272369
29-Jul-24 04:00:00	34.67877223	0.02120497
29-Jul-24 05:00:00	34.76830862	0.021666421
29-Jul-24 06:00:00	33.93408503	0.021663903
29-Jul-24 07:00:00	33.17963963	0.021775665
29-Jul-24 08:00:00	32.56770628	0.021528012
29-Jul-24 09:00:00	32.29510001	0.021392469
29-Jul-24 10:00:00	32.76254775	0.021335441
29-Jul-24 11:00:00	32.65857507	0.02086106
29-Jul-24 12:00:00	34.33134089	0.020675363
29-Jul-24 13:00:00	29.71454902	0.020396397
29-Jul-24 14:00:00	31.70879587	0.020665405
29-Jul-24 15:00:00	32.96361031	0.020554719
29-Jul-24 16:00:00	34.21222813	0.020598871
29-Jul-24 17:00:00	33.67969424	0.020425118
29-Jul-24 18:00:00	30.74317064	0.02121115
29-Jul-24 19:00:00	28.14231267	0.020982785
29-Jul-24 20:00:00	29.08063415	0.020651389
29-Jul-24 21:00:00	30.91912251	0.020800599
29-Jul-24 22:00:00	32.5327475	0.020485786
29-Jul-24 23:00:00	33.57650949	0.020471163
30-Jul-24 00:00:00	33.86793853	0.020465903
30-Jul-24 01:00:00	33.162732	0.011850799
30-Jul-24 02:00:00	33.20479051	0.00869933
30-Jul-24 03:00:00	34.94430756	0.00859361
30-Jul-24 04:00:00	35.57841632	0.005228024
30-Jul-24 05:00:00	36.47623653	0.005551197
30-Jul-24 06:00:00	38.45562219	0.005810576
30-Jul-24 07:00:00	36.827179	0.006276675
30-Jul-24 08:00:00	37.49120049	0.006477342
30-Jul-24 09:00:00	37.86659513	0.006003089
30-Jul-24 10:00:00	38.53723535	0.005872321
30-Jul-24 11:00:00	39.55602952	0.005762781
30-Jul-24 12:00:00	39.15684925	0.005103167
30-Jul-24 13:00:00	37.85746001	0.005456524
30-Jul-24 14:00:00	38.84097959	0.005575294
30-Jul-24 15:00:00	39.5647081	0.005875423
30-Jul-24 16:00:00	38.25922626	0.006693673
30-Jul-24 17:00:00	38.4265086	0.007366466
30-Jul-24 18:00:00	39.95165221	0.008273398

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2001A		3HYB-CHRC-AT-1A	
Date/Time	Temperature at 500 meters canal (°C)	Chlorine online at 500 m. canal (mg/l)	
30-Jul-24 19:00:00	39.21620888	0.005312745	
30-Jul-24 20:00:00	39.57520947	0.005354993	
30-Jul-24 21:00:00	39.97362292	0.00587594	
30-Jul-24 22:00:00	39.56611725	0.005543763	
30-Jul-24 23:00:00	39.20454469	0.005974862	
31-Jul-24 00:00:00	39.1863973	0.004971205	
31-Jul-24 01:00:00	37.88425701	0.003644781	
31-Jul-24 02:00:00	37.6866502	0.002319295	
31-Jul-24 03:00:00	37.42781186	0.00142409	
31-Jul-24 04:00:00	37.97960765	0.001340308	
31-Jul-24 05:00:00	39.46022068	0.00187448	
31-Jul-24 06:00:00	39.50697451	0.001568511	
31-Jul-24 07:00:00	39.55029604	0.002753753	
31-Jul-24 08:00:00	39.30491536	0.0025770096	
31-Jul-24 09:00:00	39.41736575	0.002803551	
31-Jul-24 10:00:00	39.77377298	0.002820022	
31-Jul-24 11:00:00	39.65993632	0.003939415	
31-Jul-24 12:00:00	39.82383124	0.003975833	
31-Jul-24 13:00:00	39.84303515	0.004294495	
31-Jul-24 14:00:00	39.10014265	0.00383846	
31-Jul-24 15:00:00	39.95254603	0.003462151	
31-Jul-24 16:00:00	39.96457742	0.002745698	
31-Jul-24 17:00:00	39.76930506	0.002440712	
31-Jul-24 18:00:00	39.81702234	0.002071937	
31-Jul-24 19:00:00	39.51423803	0.002099927	
31-Jul-24 20:00:00	39.64607582	0.00231092	
31-Jul-24 21:00:00	39.34302055	0.002183085	
31-Jul-24 22:00:00	39.69503799	0.002047202	
31-Jul-24 23:00:00	39.52585262	0.002045946	
01-Aug-24 00:00:00	39.75950404	0.002408778	
01-Aug-24 01:00:00	39.49538301	0.002197276	
01-Aug-24 02:00:00	39.83574434	0.001067003	
01-Aug-24 03:00:00	39.5564922	0.00285365	
01-Aug-24 04:00:00	39.81733163	0.074884764	
01-Aug-24 05:00:00	39.91583432	0.001284247	
01-Aug-24 06:00:00	39.86669274	0.078553382	
01-Aug-24 07:00:00	39.91072342	0.075364253	
01-Aug-24 08:00:00	39.08843498	0.001871722	
01-Aug-24 09:00:00	39.55484827	0.003951438	
01-Aug-24 10:00:00	34.13280055	0.0037595706	
01-Aug-24 11:00:00	36.88910389	0.003637417	
01-Aug-24 12:00:00	39.8584659	0.003597306	
01-Aug-24 13:00:00	39.6410465	0.003846637	
01-Aug-24 14:00:00	36.75675609	0.004184187	
01-Aug-24 15:00:00	35.81815689	0.004657797	
01-Aug-24 16:00:00	39.65768893	0.004662849	
01-Aug-24 17:00:00	39.79602532	0.005224559	
01-Aug-24 18:00:00	38.88564958	0.005114892	
01-Aug-24 19:00:00	39.68771045	0.004918691	
01-Aug-24 20:00:00	39.82029984	0.004649602	
01-Aug-24 21:00:00	39.84928107	0.004335086	

3HYB-CHRC-TT-2001A		3HYB-CHRC-AT-1A	
Date/Time	Temperature at 500 meters canal (°C)	Chlorine online at 500 m. canal (mg/l)	
01-Aug-24 22:00:00	39.87760778	0.004715163	
01-Aug-24 23:00:00	38.99095163	0.004525994	
02-Aug-24 00:00:00	38.90746678	0.003818695	
02-Aug-24 01:00:00	39.986527	0.003874588	
02-Aug-24 02:00:00	39.19895485	0.002776432	
02-Aug-24 03:00:00	39.67825318	0.002276405	
02-Aug-24 04:00:00	39.30505541	0.00158503	
02-Aug-24 05:00:00	39.91909434	0.002592143	
02-Aug-24 06:00:00	39.68753741	0.002319902	
02-Aug-24 07:00:00	39.78777907	0.001645413	
02-Aug-24 08:00:00	39.6213226	0.00118664	
02-Aug-24 09:00:00	39.62020555	0.001781877	
02-Aug-24 10:00:00	36.56212474	0.001844432	
02-Aug-24 11:00:00	34.53424542	0.004008277	
02-Aug-24 12:00:00	34.7164399	0.00382022	
02-Aug-24 13:00:00	34.89623288	0.004027174	
02-Aug-24 14:00:00	34.52079915	0.003428661	
02-Aug-24 15:00:00	37.17244655	0.003267624	
02-Aug-24 16:00:00	39.78788484	0.003756427	
02-Aug-24 17:00:00	39.46779851	0.003798509	
02-Aug-24 18:00:00	36.6111031	0.003609791	
02-Aug-24 19:00:00	39.13214361	0.004272002	
02-Aug-24 20:00:00	39.76524052	0.003851773	
02-Aug-24 21:00:00	39.23103869	0.003291943	
02-Aug-24 22:00:00	39.85180443	0.003460285	
02-Aug-24 23:00:00	39.81632562	0.003414432	
03-Aug-24 00:00:00	39.27374828	0.00300222	
03-Aug-24 01:00:00	39.91144407	0.001560224	
03-Aug-24 02:00:00	39.19803205	0.001316214	
03-Aug-24 03:00:00	39.04510881	0.00112566	
03-Aug-24 04:00:00	39.04278874	0.00112566	
03-Aug-24 05:00:00	37.20056017	0.070520887	
03-Aug-24 06:00:00	39.15088789	0.084125173	
03-Aug-24 07:00:00	39.76075086	0.08405471	
03-Aug-24 08:00:00	39.15251749	0.084685185	
03-Aug-24 09:00:00	38.23428678	0.07635915	
03-Aug-24 10:00:00	39.41832344	0.083410032	
03-Aug-24 11:00:00	39.67022878	0.081704308	
03-Aug-24 12:00:00	39.08539958	0.071796036	
03-Aug-24 13:00:00	39.18723649	0.072169642	
03-Aug-24 14:00:00	39.38477213	0.084482562	
03-Aug-24 15:00:00	39.18747516	0.076761326	
03-Aug-24 16:00:00	39.46150361	0.001423061	
03-Aug-24 17:00:00	39.5749062	0.001746376	
03-Aug-24 18:00:00	38.87916097	0.001560072	
03-Aug-24 19:00:00	39.05576341	0.001016633	
03-Aug-24 20:00:00	39.02714001	0.069377532	
03-Aug-24 21:00:00	39.64704227	0.075859307	
03-Aug-24 22:00:00	39.5687032	0.001056616	
03-Aug-24 23:00:00	36.96483089	0.076600473	
04-Aug-24 00:00:00	37.71571987	0.001424771	



Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB.CHRC-TT-2001AI			3HYB.CHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)		
04-Aug-24 01:00:00	35.2731419	0.001465166		
04-Aug-24 02:00:00	37.81870568	0.074058602		
04-Aug-24 03:00:00	37.02067597	0.086605687		
04-Aug-24 04:00:00	36.92861151	0.090741739		
04-Aug-24 05:00:00	36.70275549	0.072263092		
04-Aug-24 06:00:00	37.21600284	0.07139701		
04-Aug-24 07:00:00	38.10545031	0.001133369		
04-Aug-24 08:00:00	39.49130971	0.001442878		
04-Aug-24 09:00:00	39.44642965	0.001081218		
04-Aug-24 10:00:00	39.11952861	0.085110662		
04-Aug-24 11:00:00	39.98145501	0.001358202		
04-Aug-24 12:00:00	39.50901699	0.001099373		
04-Aug-24 13:00:00	39.17400841	0.001199387		
04-Aug-24 14:00:00	39.35143094	0.00134567		
04-Aug-24 15:00:00	39.2175833	0.002183326		
04-Aug-24 16:00:00	39.69796459	0.005831676		
04-Aug-24 17:00:00	38.10371061	0.005071206		
04-Aug-24 18:00:00	37.50701076	0.01192846		
04-Aug-24 19:00:00	39.85032986	0.023412483		
04-Aug-24 20:00:00	38.94221763	0.023225573		
04-Aug-24 21:00:00	39.72323184	0.023008983		
04-Aug-24 22:00:00	39.81736703	0.02269149		
04-Aug-24 23:00:00	39.62110759	0.022575209		
05-Aug-24 00:00:00	39.59668936	0.022655811		
05-Aug-24 01:00:00	39.89198812	0.022395261		
05-Aug-24 02:00:00	39.32715047	0.023027229		
05-Aug-24 03:00:00	39.45550553	0.022806782		
05-Aug-24 04:00:00	39.35924933	0.022443611		
05-Aug-24 05:00:00	38.60339706	0.013393239		
05-Aug-24 06:00:00	33.54293201	0.010612514		
05-Aug-24 07:00:00	33.80915397	0.009844891		
05-Aug-24 08:00:00	34.17260962	0.009175608		
05-Aug-24 09:00:00	34.32089241	0.009367776		
05-Aug-24 10:00:00	36.42501709	0.009609175		
05-Aug-24 11:00:00	39.01368944	0.009478275		
05-Aug-24 12:00:00	39.00182129	0.009158387		
05-Aug-24 13:00:00	39.62468095	0.006051123		
05-Aug-24 14:00:00	39.85027433	0.008268131		
05-Aug-24 15:00:00	39.51314606	0.017867625		
05-Aug-24 16:00:00	39.47928075	0.023311615		
05-Aug-24 17:00:00	39.57242957	0.016303595		
05-Aug-24 18:00:00	38.92480449	0.008140016		
05-Aug-24 19:00:00	39.6235119	0.007771934		
05-Aug-24 20:00:00	38.5721776	0.008095003		
05-Aug-24 21:00:00	39.3983805	0.007930164		
05-Aug-24 22:00:00	39.62900098	0.007621108		
05-Aug-24 23:00:00	38.87438761	0.00775982		
06-Aug-24 00:00:00	38.89895377	0.008198932		
06-Aug-24 01:00:00	34.19355521	0.007859964		
06-Aug-24 02:00:00	34.69109338	0.007192283		
06-Aug-24 03:00:00	39.09254458	0.005956994		

3HYB.CHRC-TT-2001AI			3HYB.CHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)		
06-Aug-24 04:00:00	39.538529	0.005995742		
06-Aug-24 05:00:00	39.04507519	0.006713927		
06-Aug-24 06:00:00	34.07066914	0.005638289		
06-Aug-24 07:00:00	34.3516349	0.005747976		
06-Aug-24 08:00:00	39.25308441	0.005846141		
06-Aug-24 09:00:00	38.23094476	0.007346043		
06-Aug-24 10:00:00	39.09677301	0.007617763		
06-Aug-24 11:00:00	39.37693748	0.006261266		
06-Aug-24 12:00:00	39.76196745	0.006221353		
06-Aug-24 13:00:00	39.81959777	0.005743371		
06-Aug-24 14:00:00	38.82265781	0.007090045		
06-Aug-24 15:00:00	38.88704854	0.020770337		
06-Aug-24 16:00:00	39.27786907	0.086706117		
06-Aug-24 17:00:00	38.96667675	0.074739809		
06-Aug-24 18:00:00	37.5720653	0.074132735		
06-Aug-24 19:00:00	38.36185267	0.074085829		
06-Aug-24 20:00:00	39.27412735	0.071985873		
06-Aug-24 21:00:00	39.55659163	0.069532055		
06-Aug-24 22:00:00	39.5909013	0.070885255		
06-Aug-24 23:00:00	39.19087453	0.071682213		
07-Aug-24 00:00:00	39.05908512	0.07423034		
07-Aug-24 01:00:00	38.29687163	0.074708049		
07-Aug-24 02:00:00	38.26431355	0.072641629		
07-Aug-24 03:00:00	38.7429907	0.085865611		
07-Aug-24 04:00:00	36.69567104	0.082711127		
07-Aug-24 05:00:00	39.11689117	0.01791306		
07-Aug-24 06:00:00	39.77249898	0.017160765		
07-Aug-24 07:00:00	39.45339556	0.022472765		
07-Aug-24 08:00:00	39.94513241	0.022682959		
07-Aug-24 09:00:00	39.82381206	0.018659909		
07-Aug-24 10:00:00	39.9744577	0.01891608		
07-Aug-24 11:00:00	39.06155036	0.011026233		
07-Aug-24 12:00:00	39.43560078	0.012713609		
07-Aug-24 13:00:00	39.54526244	0.019882295		
07-Aug-24 14:00:00	39.21729781	0.013062608		
07-Aug-24 15:00:00	39.61753814	0.015506754		
07-Aug-24 16:00:00	39.06164044	0.014396002		
07-Aug-24 17:00:00	39.68908118	0.01485332		
07-Aug-24 18:00:00	39.2944775	0.020333981		
07-Aug-24 19:00:00	39.68276278	0.013990021		
07-Aug-24 20:00:00	38.18021278	0.012239371		
07-Aug-24 21:00:00	39.74224433	0.017444255		
07-Aug-24 22:00:00	39.87802311	0.014055118		
07-Aug-24 23:00:00	39.44988712	0.016449979		
08-Aug-24 00:00:00	39.36413842	0.01640287		
08-Aug-24 01:00:00	39.42120619	0.006536229		
08-Aug-24 02:00:00	39.04646982	0.005883363		
08-Aug-24 03:00:00	36.79826608	0.005624033		
08-Aug-24 04:00:00	36.30000703	0.005715222		
08-Aug-24 05:00:00	37.60586105	0.004147735		
08-Aug-24 06:00:00	37.64953369	0.005403782		

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB-CHRC-TT-2001A		3HYB-CHRC-AT-1A	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
08-Aug-24 07:00:00	39.04822452	0.006885924	
08-Aug-24 08:00:00	39.09873209	0.006452187	
08-Aug-24 09:00:00	39.01188385	0.005616695	
08-Aug-24 10:00:00	39.61986037	0.005976686	
08-Aug-24 11:00:00	39.92842479	0.006872794	
08-Aug-24 12:00:00	39.52480256	0.008903178	
08-Aug-24 13:00:00	39.08250792	0.006108666	
08-Aug-24 14:00:00	39.58578328	0.005495445	
08-Aug-24 15:00:00	39.62964211	0.005268314	
08-Aug-24 16:00:00	39.89757282	0.005585565	
08-Aug-24 17:00:00	39.69673655	0.005270058	
08-Aug-24 18:00:00	39.64184238	0.004273908	
08-Aug-24 19:00:00	39.86538876	0.003784524	
08-Aug-24 20:00:00	39.5215071	0.003378569	
08-Aug-24 21:00:00	39.35876737	0.003528601	
08-Aug-24 22:00:00	39.19798165	0.003039386	
08-Aug-24 23:00:00	39.35176167	0.003164764	
08-Aug-24 00:00:00	39.0779936	0.002593613	
09-Aug-24 01:00:00	39.17500398	0.002525841	
09-Aug-24 02:00:00	39.93964851	0.002798115	
09-Aug-24 03:00:00	39.7575601	0.002529343	
09-Aug-24 04:00:00	39.42864305	0.002115395	
09-Aug-24 05:00:00	39.32403351	0.002367877	
09-Aug-24 06:00:00	39.23873642	0.002053136	
09-Aug-24 07:00:00	39.14620593	0.0093503	
09-Aug-24 08:00:00	39.28281393	0.003296668	
09-Aug-24 09:00:00	39.92626296	0.003173118	
09-Aug-24 10:00:00	39.3280496	0.003577702	
09-Aug-24 11:00:00	39.26458481	0.002845787	
09-Aug-24 12:00:00	39.23147881	0.00289687	
09-Aug-24 13:00:00	39.39156976	0.002661165	
09-Aug-24 14:00:00	39.27810212	0.003645036	
09-Aug-24 15:00:00	39.28246771	0.003641367	
09-Aug-24 16:00:00	39.45980059	0.0031624	
09-Aug-24 17:00:00	39.05061103	0.00369126	
09-Aug-24 18:00:00	39.04580224	0.003080898	
09-Aug-24 19:00:00	39.19712098	0.003152932	
09-Aug-24 20:00:00	39.00665514	0.003433305	
09-Aug-24 21:00:00	39.96220711	0.003228733	
09-Aug-24 22:00:00	38.99578825	0.002563874	
09-Aug-24 23:00:00	38.74477804	0.003125746	
10-Aug-24 00:00:00	39.94364664	0.004190133	
10-Aug-24 01:00:00	39.00424149	0.002763891	
10-Aug-24 02:00:00	39.88128906	0.003268875	
10-Aug-24 03:00:00	39.55153273	0.003314398	
10-Aug-24 04:00:00	39.35536781	0.002965661	
10-Aug-24 05:00:00	39.57393005	0.00306504	
10-Aug-24 06:00:00	39.50904328	0.003948719	
10-Aug-24 07:00:00	38.32351362	0.002918063	
10-Aug-24 08:00:00	39.61938727	0.003471134	
10-Aug-24 09:00:00	39.9136787	0.003418475	

3HYB-CHRC-TT-2001A		3HYB-CHRC-AT-1A	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
10-Aug-24 10:00:00	38.92637446	0.003431508	
10-Aug-24 11:00:00	39.00737606	0.002856124	
10-Aug-24 12:00:00	39.63202428	0.003321966	
10-Aug-24 13:00:00	39.03423981	0.004487546	
10-Aug-24 14:00:00	39.09724688	0.005689123	
10-Aug-24 15:00:00	39.26572539	0.006675744	
10-Aug-24 16:00:00	39.48314862	0.0108705	
10-Aug-24 17:00:00	39.03533818	0.013725609	
10-Aug-24 18:00:00	39.5297235	0.003515028	
10-Aug-24 19:00:00	38.68881166	0.004038108	
10-Aug-24 20:00:00	39.27737653	0.002941142	
10-Aug-24 21:00:00	39.43612717	0.003020289	
10-Aug-24 22:00:00	39.64081139	0.003534942	
10-Aug-24 23:00:00	39.43267107	0.003624622	
11-Aug-24 00:00:00	39.94395584	0.003634893	
11-Aug-24 01:00:00	39.21279499	0.002157631	
11-Aug-24 02:00:00	39.26439014	0.001306313	
11-Aug-24 03:00:00	39.63560754	0.001868704	
11-Aug-24 04:00:00	39.13255454	0.002061962	
11-Aug-24 05:00:00	39.63083508	0.001773022	
11-Aug-24 06:00:00	39.0901889	0.001467296	
11-Aug-24 07:00:00	39.69632755	0.00151364	
11-Aug-24 08:00:00	39.66535528	0.001834878	
11-Aug-24 09:00:00	39.23426883	0.001880201	
11-Aug-24 10:00:00	39.637257513	0.002031769	
11-Aug-24 11:00:00	39.99292802	0.002320671	
11-Aug-24 12:00:00	38.18952674	0.002308679	
11-Aug-24 13:00:00	38.87381812	0.001690062	
11-Aug-24 14:00:00	39.45990218	0.021615733	
11-Aug-24 15:00:00	38.8719864	0.027021747	
11-Aug-24 16:00:00	39.14937312	0.025183107	
11-Aug-24 17:00:00	39.09642233	0.020037544	
11-Aug-24 18:00:00	39.05864519	0.028816893	
11-Aug-24 19:00:00	38.99129237	0.026250639	
11-Aug-24 20:00:00	38.07682761	0.025991981	
11-Aug-24 21:00:00	39.82229888	0.025777011	
11-Aug-24 22:00:00	38.98346772	0.025663691	
11-Aug-24 23:00:00	39.12337103	0.025447951	
12-Aug-24 00:00:00	39.18223422	0.02698314	
12-Aug-24 01:00:00	39.13700864	0.025925553	
12-Aug-24 02:00:00	39.45856914	0.028015048	
12-Aug-24 03:00:00	38.82179401	0.028445036	
12-Aug-24 04:00:00	37.72678804	0.026257381	
12-Aug-24 05:00:00	36.35382105	0.028327515	
12-Aug-24 06:00:00	36.53542149	0.026097474	
12-Aug-24 07:00:00	36.71618413	0.026084109	
12-Aug-24 08:00:00	36.62871812	0.028052433	
12-Aug-24 09:00:00	37.74668304	0.026302083	
12-Aug-24 10:00:00	38.82489253	0.028531177	
12-Aug-24 11:00:00	38.81302152	0.026742723	
12-Aug-24 12:00:00	38.6588647	0.026782259	



Start Time	1/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
12-Aug-24 13:00:00	39.48162414	0.026985847
12-Aug-24 14:00:00	39.38328911	0.027105374
12-Aug-24 15:00:00	39.42818904	0.026906162
12-Aug-24 16:00:00	37.86078114	0.027059767
12-Aug-24 17:00:00	37.1881957	0.026563602
12-Aug-24 18:00:00	36.34310112	0.026448415
12-Aug-24 19:00:00	36.46672149	0.026244235
12-Aug-24 20:00:00	36.61257069	0.025915578
12-Aug-24 21:00:00	36.58273187	0.015530995
12-Aug-24 22:00:00	36.2315944	0.011690066
12-Aug-24 23:00:00	36.18320712	0.010679637
13-Aug-24 00:00:00	36.67518016	0.010532629
13-Aug-24 01:00:00	36.93650113	0.010226667
13-Aug-24 02:00:00	36.65659227	0.008322642
13-Aug-24 03:00:00	36.63356865	0.007800163
13-Aug-24 04:00:00	36.39656486	0.007464954
13-Aug-24 05:00:00	36.13845482	0.008544227
13-Aug-24 06:00:00	36.13941465	0.008833069
13-Aug-24 07:00:00	35.67793742	0.009454184
13-Aug-24 08:00:00	35.91172152	0.00733404
13-Aug-24 09:00:00	36.68191885	0.009814178
13-Aug-24 10:00:00	36.16328019	0.006537324
13-Aug-24 11:00:00	39.69663048	0.006163165
13-Aug-24 12:00:00	38.92297833	0.008492986
13-Aug-24 13:00:00	39.47359882	0.005303
13-Aug-24 14:00:00	39.41686857	0.005231514
13-Aug-24 15:00:00	38.68962427	0.005160305
13-Aug-24 16:00:00	38.51709356	0.005737274
13-Aug-24 17:00:00	36.25711249	0.005174622
13-Aug-24 18:00:00	36.6284026	0.004743426
13-Aug-24 19:00:00	36.70627832	0.00445773
13-Aug-24 20:00:00	37.41368966	0.00468617
13-Aug-24 21:00:00	37.64658439	0.004774244
13-Aug-24 22:00:00	37.65514666	0.005324926
13-Aug-24 23:00:00	38.53067196	0.005313717
14-Aug-24 00:00:00	39.11244286	0.005708408
14-Aug-24 01:00:00	37.09449527	0.005268521
14-Aug-24 02:00:00	36.59487366	0.005252912
14-Aug-24 03:00:00	36.23538124	0.005668549
14-Aug-24 04:00:00	36.36480303	0.005963541
14-Aug-24 05:00:00	36.61772969	0.005215189
14-Aug-24 06:00:00	35.77271408	0.005234429
14-Aug-24 07:00:00	36.05194275	0.008073149
14-Aug-24 08:00:00	36.5730223	0.007148693
14-Aug-24 09:00:00	38.07731129	0.007030486
14-Aug-24 10:00:00	39.16313687	0.007469026
14-Aug-24 11:00:00	39.64143565	0.007715191
14-Aug-24 12:00:00	38.9053426	0.008437313
14-Aug-24 13:00:00	39.13756795	0.009653661
14-Aug-24 14:00:00	39.34607187	0.007781461
14-Aug-24 15:00:00	39.86116586	0.011276255

Start Time	1/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
14-Aug-24 16:00:00	38.42959115	0.008091336
14-Aug-24 17:00:00	36.84050148	0.007337667
14-Aug-24 18:00:00	36.70987097	0.00729352
14-Aug-24 19:00:00	36.40568723	0.00802951
14-Aug-24 20:00:00	36.03227342	0.007053423
14-Aug-24 21:00:00	36.07578513	0.006340143
14-Aug-24 22:00:00	36.15467784	0.006392959
14-Aug-24 23:00:00	36.11278577	0.006176713
15-Aug-24 00:00:00	36.47465556	0.003775969
15-Aug-24 01:00:00	36.3002063	0.003894472
15-Aug-24 02:00:00	36.07507686	0.003945652
15-Aug-24 03:00:00	35.99992885	0.003789704
15-Aug-24 04:00:00	36.08600206	0.00377867
15-Aug-24 05:00:00	35.948066	0.00410813
15-Aug-24 06:00:00	35.93475906	0.004011233
15-Aug-24 07:00:00	35.94331422	0.00416176
15-Aug-24 08:00:00	36.50269555	0.004280485
15-Aug-24 09:00:00	38.02996384	0.004323144
15-Aug-24 10:00:00	38.8759662	0.004169679
15-Aug-24 11:00:00	38.45821892	0.004340094
15-Aug-24 12:00:00	39.57174344	0.004771041
15-Aug-24 13:00:00	39.59571333	0.014299603
15-Aug-24 14:00:00	39.13142262	0.008355402
15-Aug-24 15:00:00	39.10283322	0.008162763
15-Aug-24 16:00:00	38.36349797	0.007863027
15-Aug-24 17:00:00	37.60115129	0.008104873
15-Aug-24 18:00:00	37.11328096	0.007314583
15-Aug-24 19:00:00	36.91128843	0.008675403
15-Aug-24 20:00:00	36.92460488	0.008802699
15-Aug-24 21:00:00	36.92379242	0.005963055
15-Aug-24 22:00:00	37.05915621	0.00566828
15-Aug-24 23:00:00	36.75912842	0.005159796
16-Aug-24 00:00:00	37.1124552	0.00516012
16-Aug-24 01:00:00	37.27831469	0.004495293
16-Aug-24 02:00:00	37.27678116	0.003774533
16-Aug-24 03:00:00	37.41102861	0.003944336
16-Aug-24 04:00:00	37.19754449	0.003143227
16-Aug-24 05:00:00	36.74401096	0.00376881
16-Aug-24 06:00:00	36.46165348	0.003894094
16-Aug-24 07:00:00	36.31036894	0.003685116
16-Aug-24 08:00:00	36.38069578	0.004276677
16-Aug-24 09:00:00	37.9197183	0.00480841
16-Aug-24 10:00:00	39.34316729	0.004944024
16-Aug-24 11:00:00	39.08988923	0.004838453
16-Aug-24 12:00:00	39.75313124	0.005171237
16-Aug-24 13:00:00	39.23659733	0.004799906
16-Aug-24 14:00:00	39.3750899	0.004996993
16-Aug-24 15:00:00	38.04253584	0.005019243
16-Aug-24 16:00:00	37.96659517	0.004820742
16-Aug-24 17:00:00	37.19944436	0.004710894
16-Aug-24 18:00:00	37.34602029	0.004830538

Start Time	1/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name PI	
Time Interval	1h

Start Time	1/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name PI	
Time Interval	1h

3HYB CHRC-TT-2001AI		3HYB CHRC-AT-1AI	
Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)	
16-Aug-24 19:00:00	37.09478786	0.00516372	
16-Aug-24 20:00:00	36.77531723	0.005255286	
16-Aug-24 21:00:00	36.71010141	0.005057197	
16-Aug-24 22:00:00	36.7553787	0.005230223	
16-Aug-24 23:00:00	37.34331495	0.005529073	
17-Aug-24 00:00:00	37.14892891	0.005292066	
17-Aug-24 01:00:00	37.69097947	0.005438488	
17-Aug-24 02:00:00	37.97903367	0.004316353	
17-Aug-24 03:00:00	37.96455957	0.00288424	
17-Aug-24 04:00:00	37.66111893	0.001724613	
17-Aug-24 05:00:00	36.69830015	0.001551871	
17-Aug-24 06:00:00	36.34507802	0.001823165	
17-Aug-24 07:00:00	36.78168833	0.002077119	
17-Aug-24 08:00:00	37.29389765	0.003178151	
17-Aug-24 09:00:00	36.93847862	0.002971199	
17-Aug-24 10:00:00	37.8587177	0.00253822	
17-Aug-24 11:00:00	38.36739782	0.002833226	
17-Aug-24 12:00:00	38.44429024	0.002921208	
17-Aug-24 13:00:00	38.37293195	0.003049062	
17-Aug-24 14:00:00	38.51255662	0.003147568	
17-Aug-24 15:00:00	38.10542249	0.003301101	
17-Aug-24 16:00:00	37.69578653	0.002920303	
17-Aug-24 17:00:00	37.38660432	0.002894451	
17-Aug-24 18:00:00	36.55701199	0.00278973	
17-Aug-24 19:00:00	36.92528489	0.0029965343	
17-Aug-24 20:00:00	37.22123319	0.003264245	
17-Aug-24 21:00:00	37.21045452	0.00308129	
17-Aug-24 22:00:00	37.18858199	0.003578629	
17-Aug-24 23:00:00	37.53364551	0.003446076	
18-Aug-24 00:00:00	38.12256457	0.003356694	
18-Aug-24 01:00:00	38.08962002	0.003921203	
18-Aug-24 02:00:00	37.85429754	0.003286724	
18-Aug-24 03:00:00	37.71959309	0.0029986716	
18-Aug-24 04:00:00	37.44025281	0.003344117	
18-Aug-24 05:00:00	37.27698277	0.003531281	
18-Aug-24 06:00:00	37.12267783	0.003961981	
18-Aug-24 07:00:00	37.231731	0.003917879	
18-Aug-24 08:00:00	37.55478728	0.003947306	
18-Aug-24 09:00:00	38.35347196	0.00407222	
18-Aug-24 10:00:00	39.14408395	0.004013869	
18-Aug-24 11:00:00	39.87505913	0.00412142	
18-Aug-24 12:00:00	39.23157756	0.004247726	
18-Aug-24 13:00:00	39.63019184	0.004474676	
18-Aug-24 14:00:00	38.94438278	0.004413129	
18-Aug-24 15:00:00	38.59195212	0.00452786	
18-Aug-24 16:00:00	38.45986063	0.005431255	
18-Aug-24 17:00:00	39.03293889	0.006129122	
18-Aug-24 18:00:00	38.35395252	0.005682005	
18-Aug-24 19:00:00	38.57482841	0.023206451	
18-Aug-24 20:00:00	38.77189369	0.025588283	
18-Aug-24 21:00:00	38.64041421	0.025615607	

3HYB CHRC-TT-2001AI		3HYB CHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)	
18-Aug-24 22:00:00	38.39843511	0.025487131	
18-Aug-24 23:00:00	38.40273617	0.025392193	
19-Aug-24 00:00:00	38.52777412	0.023188968	
19-Aug-24 01:00:00	39.65606349	0.009154706	
19-Aug-24 02:00:00	39.70414235	0.005026851	
19-Aug-24 03:00:00	38.18539026	0.004262877	
19-Aug-24 04:00:00	38.72151067	0.003298618	
19-Aug-24 05:00:00	38.39915358	0.003047282	
19-Aug-24 06:00:00	38.28739257	0.002597139	
19-Aug-24 07:00:00	38.14887092	0.001966611	
19-Aug-24 08:00:00	38.57273578	0.002413713	
19-Aug-24 09:00:00	39.96285664	0.003662757	
19-Aug-24 10:00:00	39.65392389	0.004116746	
19-Aug-24 11:00:00	38.81220449	0.003755756	
19-Aug-24 12:00:00	39.91724313	0.004730109	
19-Aug-24 13:00:00	39.29005666	0.005314576	
19-Aug-24 14:00:00	38.83391321	0.005230186	
19-Aug-24 15:00:00	38.47772741	0.004991746	
19-Aug-24 16:00:00	39.1626055	0.005024502	
19-Aug-24 17:00:00	39.92210949	0.005153976	
19-Aug-24 18:00:00	38.0394331	0.00516028	
19-Aug-24 19:00:00	39.19796621	0.0050505846	
19-Aug-24 20:00:00	39.96342722	0.005239951	
19-Aug-24 21:00:00	38.0507502	0.005319308	
19-Aug-24 22:00:00	38.68615408	0.004989765	
20-Aug-24 00:00:00	39.6430401	0.004760914	
20-Aug-24 01:00:00	38.06644134	0.003633744	
20-Aug-24 02:00:00	39.62075997	0.002095935	
20-Aug-24 03:00:00	37.72949469	0.001986486	
20-Aug-24 04:00:00	37.86094437	0.001298969	
20-Aug-24 05:00:00	38.25380786	0.001847839	
20-Aug-24 06:00:00	37.94804857	0.002517568	
20-Aug-24 07:00:00	38.45217489	0.00156778	
20-Aug-24 08:00:00	39.08722847	0.00182234	
20-Aug-24 09:00:00	39.51795286	0.008652566	
20-Aug-24 10:00:00	39.83430612	0.076046165	
20-Aug-24 11:00:00	38.95098675	0.075295063	
20-Aug-24 12:00:00	38.8552723	0.07549782	
20-Aug-24 13:00:00	38.87025507	0.001531842	
20-Aug-24 14:00:00	38.70470212	0.001929858	
20-Aug-24 15:00:00	39.5674148	0.001891375	
20-Aug-24 16:00:00	38.95961311	0.001289346	
20-Aug-24 17:00:00	39.04531604	0.001162054	
20-Aug-24 18:00:00	38.80519995	0.071749609	
20-Aug-24 19:00:00	38.73865374	0.072042116	
20-Aug-24 20:00:00	38.64563001	0.077644184	
20-Aug-24 21:00:00	39.59410255	0.08511799	
20-Aug-24 22:00:00	38.85790826	0.082656057	
20-Aug-24 23:00:00	39.36387288	0.087305163	
21-Aug-24 00:00:00	39.90841609	0.086840995	



Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
21-Aug-24 01:00:00	38.1521498	0.06541357	
21-Aug-24 02:00:00	38.70623407	0.060751511	
21-Aug-24 03:00:00	38.09548599	0.067230701	
21-Aug-24 04:00:00	38.78604221	0.06773747	
21-Aug-24 05:00:00	38.67484339	0.073426861	
21-Aug-24 06:00:00	38.55752857	0.08111435	
21-Aug-24 07:00:00	39.15768374	0.073039136	
21-Aug-24 08:00:00	39.30226276	0.063652189	
21-Aug-24 09:00:00	39.38633676	0.085140227	
21-Aug-24 10:00:00	38.73362767	0.072303916	
21-Aug-24 11:00:00	38.76083157	0.079848223	
21-Aug-24 12:00:00	39.52553188	0.077611625	
21-Aug-24 13:00:00	39.4116096	0.001258674	
21-Aug-24 14:00:00	39.35280275	0.001599502	
21-Aug-24 15:00:00	38.85983931	0.001589174	
21-Aug-24 16:00:00	37.21735018	0.001680978	
21-Aug-24 17:00:00	36.92673005	0.001678983	
21-Aug-24 18:00:00	36.09081416	0.001235652	
21-Aug-24 19:00:00	36.26713612	0.0011778	
21-Aug-24 20:00:00	36.44445073	0.00125717	
21-Aug-24 21:00:00	36.60080356	0.001456088	
21-Aug-24 22:00:00	36.90312048	0.001410097	
21-Aug-24 23:00:00	36.82780884	0.001186134	
22-Aug-24 00:00:00	37.07802837	0.001166644	
22-Aug-24 01:00:00	36.8666176	0.001159568	
22-Aug-24 02:00:00	36.71639455	0.001150611	
22-Aug-24 03:00:00	36.45142545	0.001146872	
22-Aug-24 04:00:00	36.364827	0.083701927	
22-Aug-24 05:00:00	36.01202769	0.001069659	
22-Aug-24 06:00:00	36.437277	0.001208642	
22-Aug-24 07:00:00	36.64498347	0.001218197	
22-Aug-24 08:00:00	36.43609808	0.001285422	
22-Aug-24 09:00:00	37.51647305	0.001323287	
22-Aug-24 10:00:00	38.88113813	0.001150322	
22-Aug-24 11:00:00	39.82723422	0.001483258	
22-Aug-24 12:00:00	39.42671644	0.001740217	
22-Aug-24 13:00:00	39.00593074	0.002215179	
22-Aug-24 14:00:00	39.75674365	0.002247288	
22-Aug-24 15:00:00	39.41708473	0.001367901	
22-Aug-24 16:00:00	37.78245966	0.001390425	
22-Aug-24 17:00:00	37.47164239	0.001837717	
22-Aug-24 18:00:00	36.70576344	0.00145861	
22-Aug-24 19:00:00	36.57915763	0.001342816	
22-Aug-24 20:00:00	36.56471325	0.001230826	
22-Aug-24 21:00:00	36.66317506	0.001257665	
22-Aug-24 22:00:00	37.11357284	0.001006444	
22-Aug-24 23:00:00	39.17842377	0.087321207	
23-Aug-24 00:00:00	38.79972201	0.079631926	
23-Aug-24 01:00:00	38.69429844	0.001007708	
23-Aug-24 02:00:00	38.57872316	0.067471015	
23-Aug-24 03:00:00	38.193659	0.082223203	

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
23-Aug-24 04:00:00	37.7700135	0.075276619	
23-Aug-24 05:00:00	37.59753327	0.068209048	
23-Aug-24 06:00:00	37.49186445	0.075640596	
23-Aug-24 07:00:00	37.66520237	0.087122006	
23-Aug-24 08:00:00	38.70628072	0.072660934	
23-Aug-24 09:00:00	39.40135711	0.080224991	
23-Aug-24 10:00:00	39.86965125	0.069675746	
23-Aug-24 11:00:00	39.80748484	0.069788769	
23-Aug-24 12:00:00	38.71896935	0.086885114	
23-Aug-24 13:00:00	38.15637298	0.075572602	
23-Aug-24 14:00:00	38.47748075	0.075529267	
23-Aug-24 15:00:00	38.13870344	0.072202577	
23-Aug-24 16:00:00	37.8204758	0.070610611	
23-Aug-24 17:00:00	37.43694136	0.071096524	
23-Aug-24 18:00:00	36.3998765	0.081665918	
23-Aug-24 19:00:00	35.94746593	0.082334122	
23-Aug-24 20:00:00	35.9492758	0.080851502	
23-Aug-24 21:00:00	35.8120472	0.077997396	
23-Aug-24 22:00:00	36.17814407	0.086520923	
23-Aug-24 23:00:00	37.80734204	0.083055799	
24-Aug-24 00:00:00	39.36877726	0.071257437	
24-Aug-24 01:00:00	38.79063208	0.087226228	
24-Aug-24 02:00:00	38.4339165	0.06656791	
24-Aug-24 03:00:00	37.98492282	0.082917795	
24-Aug-24 04:00:00	37.20258996	0.08110832	
24-Aug-24 05:00:00	36.79698865	0.069516001	
24-Aug-24 06:00:00	36.59835547	0.0849126	
24-Aug-24 07:00:00	36.25437949	0.072181524	
24-Aug-24 08:00:00	36.2270869	0.004965405	
24-Aug-24 09:00:00	38.77055208	0.003715706	
24-Aug-24 10:00:00	39.84648855	0.006139561	
24-Aug-24 11:00:00	38.94761278	0.005021049	
24-Aug-24 12:00:00	39.01430198	0.00402684	
24-Aug-24 13:00:00	39.00687609	0.04827382	
24-Aug-24 14:00:00	38.94992588	0.003915494	
24-Aug-24 15:00:00	39.26306354	0.005961071	
24-Aug-24 16:00:00	38.3559243	0.007267984	
24-Aug-24 17:00:00	37.88413124	0.007987867	
24-Aug-24 18:00:00	37.09086513	0.003548559	
24-Aug-24 19:00:00	37.83351945	0.001583552	
24-Aug-24 20:00:00	37.59486347	0.001043685	
24-Aug-24 21:00:00	37.42469541	0.080178958	
24-Aug-24 22:00:00	37.94873793	0.07320566	
24-Aug-24 23:00:00	39.89901431	0.087087189	
25-Aug-24 00:00:00	38.92029458	0.071048646	
25-Aug-24 01:00:00	38.33235426	0.082812959	
25-Aug-24 02:00:00	38.178692	0.072431088	
25-Aug-24 03:00:00	37.66812723	0.086192297	
25-Aug-24 04:00:00	37.36387238	0.073002597	
25-Aug-24 05:00:00	37.21615509	0.084359581	
25-Aug-24 06:00:00	37.15723837	0.079474619	

Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
25-Aug-24 07:00:00	37.45784256	0.076443155	
25-Aug-24 08:00:00	37.64742286	0.077797766	
25-Aug-24 09:00:00	39.46603189	0.076329888	
25-Aug-24 10:00:00	39.32865056	0.069723666	
25-Aug-24 11:00:00	39.72665403	0.092615057	
25-Aug-24 12:00:00	39.49357083	0.066226023	
25-Aug-24 13:00:00	39.1035228	0.074703086	
25-Aug-24 14:00:00	38.08911578	0.077841263	
25-Aug-24 15:00:00	37.54849243	0.067779077	
25-Aug-24 16:00:00	36.61671601	0.074595269	
25-Aug-24 17:00:00	36.19229659	0.094678499	
25-Aug-24 18:00:00	36.26648908	0.082714315	
25-Aug-24 19:00:00	36.29742048	0.027853221	
25-Aug-24 20:00:00	36.23831354	0.029873403	
25-Aug-24 21:00:00	36.45305861	0.029599016	
25-Aug-24 22:00:00	36.70009989	0.029462133	
25-Aug-24 23:00:00	38.41386506	0.029366874	
25-Aug-24 00:00:00	39.19172579	0.026941417	
26-Aug-24 01:00:00	38.85942607	0.042263893	
26-Aug-24 02:00:00	36.64837396	0.020273925	
26-Aug-24 03:00:00	37.75820702	0.001107208	
26-Aug-24 04:00:00	36.48238927	0.001061066	
26-Aug-24 05:00:00	33.28514336	0.069807334	
26-Aug-24 06:00:00	34.50050316	0.068269441	
26-Aug-24 07:00:00	36.96566039	0.084874381	
26-Aug-24 08:00:00	36.96566039	0.083486644	
26-Aug-24 09:00:00	37.50174679	0.082945227	
26-Aug-24 10:00:00	39.60617978	0.077223882	
26-Aug-24 11:00:00	39.24749596	0.078645828	
26-Aug-24 12:00:00	39.33469175	0.074271708	
26-Aug-24 13:00:00	39.73005758	0.069896257	
26-Aug-24 14:00:00	39.64238628	0.076694914	
26-Aug-24 15:00:00	39.64933713	0.06986326	
26-Aug-24 16:00:00	39.20844872	0.068452271	
26-Aug-24 17:00:00	38.84642257	0.078460922	
26-Aug-24 18:00:00	38.63828694	0.071030988	
26-Aug-24 19:00:00	38.64592168	0.077143677	
26-Aug-24 20:00:00	38.82347739	0.075490076	
26-Aug-24 21:00:00	39.21041916	0.082104244	
26-Aug-24 22:00:00	39.42266597	0.082705741	
26-Aug-24 23:00:00	39.77547832	0.072636954	
27-Aug-24 00:00:00	39.8917972	0.072135361	
27-Aug-24 01:00:00	39.40825119	0.081099124	
27-Aug-24 02:00:00	39.68958247	0.081467338	
27-Aug-24 03:00:00	39.22612271	0.075371707	
27-Aug-24 04:00:00	39.11667937	0.083919407	
27-Aug-24 05:00:00	39.74929428	0.07624955	
27-Aug-24 06:00:00	38.6268022	0.072723681	
27-Aug-24 07:00:00	39.50972599	0.076585391	
27-Aug-24 08:00:00	39.84997956	0.077797031	
27-Aug-24 09:00:00	39.79536659	0.086580267	

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
27-Aug-24 10:00:00	39.99131933	0.0759598	
27-Aug-24 11:00:00	39.19441462	0.071866985	
27-Aug-24 12:00:00	38.92808114	0.074246974	
27-Aug-24 13:00:00	39.84593899	0.083257038	
27-Aug-24 14:00:00	39.94643927	0.080053061	
27-Aug-24 15:00:00	39.85386936	0.072363655	
27-Aug-24 16:00:00	39.59832582	0.068661819	
27-Aug-24 17:00:00	39.0806672	0.07903532	
27-Aug-24 18:00:00	38.89655687	0.089008234	
27-Aug-24 19:00:00	39.09519098	0.074330335	
27-Aug-24 20:00:00	39.25588966	0.066743189	
27-Aug-24 21:00:00	39.88511292	0.087242714	
27-Aug-24 22:00:00	39.06396629	0.079420177	
27-Aug-24 23:00:00	39.10270941	0.08105561	
28-Aug-24 00:00:00	39.36229851	0.073570244	
28-Aug-24 01:00:00	39.9715502	0.070257829	
28-Aug-24 02:00:00	39.69107508	0.072351916	
28-Aug-24 03:00:00	39.85763227	0.076070038	
28-Aug-24 04:00:00	39.72893039	0.076247566	
28-Aug-24 05:00:00	39.89723033	0.072065089	
28-Aug-24 06:00:00	39.46069096	0.087311108	
28-Aug-24 07:00:00	39.42654897	0.068892618	
28-Aug-24 08:00:00	39.44868619	0.065783673	
28-Aug-24 09:00:00	39.23567395	0.077189463	
28-Aug-24 10:00:00	39.4660766	0.07368372	
28-Aug-24 11:00:00	39.80611447	0.092843871	
28-Aug-24 12:00:00	39.78685403	0.080942748	
28-Aug-24 13:00:00	38.86115376	0.072108504	
28-Aug-24 14:00:00	39.31449672	0.085139814	
28-Aug-24 15:00:00	39.4253376	0.078878202	
28-Aug-24 16:00:00	39.82008254	0.060360013	
28-Aug-24 17:00:00	37.6901257	0.074876743	
28-Aug-24 18:00:00	36.42652146	0.073337388	
28-Aug-24 19:00:00	36.05034982	0.072548015	
28-Aug-24 20:00:00	36.98920968	0.072952949	
28-Aug-24 21:00:00	36.0232738	0.072999403	
28-Aug-24 22:00:00	35.8328026	0.07287598	
28-Aug-24 23:00:00	37.40975823	0.069648574	
29-Aug-24 00:00:00	38.2397788	0.074594621	
29-Aug-24 01:00:00	37.62295677	0.011166091	
29-Aug-24 02:00:00	36.80318124	0.02104218	
29-Aug-24 03:00:00	37.3017381	0.025068905	
29-Aug-24 04:00:00	37.15944283	0.018470663	
29-Aug-24 05:00:00	36.52539862	0.00290454	
29-Aug-24 06:00:00	36.12464633	0.006115566	
29-Aug-24 07:00:00	36.18727164	0.006783801	
29-Aug-24 08:00:00	36.60669503	0.006214746	
29-Aug-24 09:00:00	36.53308223	0.010479915	
29-Aug-24 10:00:00	35.3200611	0.006756675	
29-Aug-24 11:00:00	34.30650905	0.006476452	
29-Aug-24 12:00:00	36.22898169	0.00439978	



Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-200(A)	3HYB-CHRC-AT-1(A)
---------------------	-------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
29-Aug-24 13:00:00	36.41501184	0.00556484
29-Aug-24 14:00:00	36.61156323	0.006228069
29-Aug-24 15:00:00	33.66101844	0.006125114
29-Aug-24 16:00:00	34.24381351	0.007264833
29-Aug-24 17:00:00	35.01663874	0.007799131
29-Aug-24 18:00:00	35.05288333	0.00646363
29-Aug-24 19:00:00	35.50262347	0.005095326
29-Aug-24 20:00:00	35.78944	0.00680472
29-Aug-24 21:00:00	36.67485393	0.006118321
29-Aug-24 22:00:00	37.0961158	0.010406185
29-Aug-24 23:00:00	36.87503158	0.00360584
30-Aug-24 00:00:00	36.10870227	0.003551874
30-Aug-24 01:00:00	36.52792152	0.00436384
30-Aug-24 02:00:00	37.9856785	0.003274417
30-Aug-24 03:00:00	37.79661781	0.005728426
30-Aug-24 04:00:00	37.61016509	0.004681771
30-Aug-24 05:00:00	37.33076737	0.003102572
30-Aug-24 06:00:00	37.09797959	0.004039427
30-Aug-24 07:00:00	37.05234286	0.007105249
30-Aug-24 08:00:00	36.07755532	0.007251005
30-Aug-24 09:00:00	39.42128466	0.012721587
30-Aug-24 10:00:00	39.65042589	0.009596517
30-Aug-24 11:00:00	39.43010061	0.019254467
30-Aug-24 12:00:00	39.07688945	0.019054615
30-Aug-24 13:00:00	39.47081536	0.00650513
30-Aug-24 14:00:00	39.85745153	0.014776963
30-Aug-24 15:00:00	37.95443996	0.012869136
30-Aug-24 16:00:00	36.53790798	0.00786551
30-Aug-24 17:00:00	37.08822365	0.01212529
30-Aug-24 18:00:00	37.17071383	0.00561186
30-Aug-24 19:00:00	37.24740911	0.00591186
30-Aug-24 20:00:00	36.97283555	0.009438931
30-Aug-24 21:00:00	37.07736996	0.006544263
30-Aug-24 22:00:00	36.60852242	0.009769015
30-Aug-24 23:00:00	37.44068444	0.005552043
31-Aug-24 00:00:00	38.6366286	0.010474763
31-Aug-24 01:00:00	38.10165592	0.009877142
31-Aug-24 02:00:00	37.5852146	0.00870638
31-Aug-24 03:00:00	37.74233492	0.007163642
31-Aug-24 04:00:00	37.12593374	0.005802119
31-Aug-24 05:00:00	36.65154646	0.003201032
31-Aug-24 06:00:00	36.38755867	0.007658411
31-Aug-24 07:00:00	36.61557586	0.007510074
31-Aug-24 08:00:00	37.59246953	0.008652488
31-Aug-24 09:00:00	39.82255446	0.011129461
31-Aug-24 10:00:00	39.71760652	0.006539186
31-Aug-24 11:00:00	39.09706182	0.015146557
31-Aug-24 12:00:00	39.65363034	0.020963473
31-Aug-24 13:00:00	39.50257646	0.019664623
31-Aug-24 14:00:00	39.72921099	0.018379106
31-Aug-24 15:00:00	39.11549376	0.02502186

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-200(A)	3HYB-CHRC-AT-1(A)
---------------------	-------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
31-Aug-24 16:00:00	36.48032953	0.023669751
31-Aug-24 17:00:00	37.05165291	0.025029203
31-Aug-24 18:00:00	36.72036899	0.020084102
31-Aug-24 19:00:00	36.52843154	0.028235095
31-Aug-24 20:00:00	36.60325667	0.013435799
31-Aug-24 21:00:00	36.59065526	0.006308466
31-Aug-24 22:00:00	36.61384551	0.017561377
31-Aug-24 23:00:00	37.97147595	0.010494861
01-Sep-24 00:00:00	39.48182727	0.013492334
01-Sep-24 01:00:00	38.97658493	0.009277346
01-Sep-24 02:00:00	37.28655929	0.00767825
01-Sep-24 03:00:00	36.69844524	0.06521577
01-Sep-24 04:00:00	36.39112154	0.011217605
01-Sep-24 05:00:00	36.43101841	0.007309944
01-Sep-24 06:00:00	36.12814547	0.005354097
01-Sep-24 07:00:00	36.53775944	0.074420433
01-Sep-24 08:00:00	37.56032336	0.002352227
01-Sep-24 09:00:00	39.54155767	0.00557934
01-Sep-24 10:00:00	39.31944815	0.018889899
01-Sep-24 11:00:00	39.69955305	0.011880291
01-Sep-24 12:00:00	38.32497167	0.012374482
01-Sep-24 13:00:00	39.37618444	0.0066439
01-Sep-24 14:00:00	39.89377353	0.011201963
01-Sep-24 15:00:00	39.40339447	0.014666129
01-Sep-24 16:00:00	38.57110774	0.021139377
01-Sep-24 17:00:00	37.43764577	0.014155395
01-Sep-24 18:00:00	36.87016066	0.069780106
01-Sep-24 19:00:00	36.77676132	0.088775395
01-Sep-24 20:00:00	36.90137019	0.094794184
01-Sep-24 21:00:00	36.93076236	0.075857726
01-Sep-24 22:00:00	37.1822581	0.079131176
01-Sep-24 23:00:00	38.68475314	0.090806661
02-Sep-24 00:00:00	29.46904185	0.051470512
02-Sep-24 01:00:00	29.17917896	0.035514496
02-Sep-24 02:00:00	30.42142785	0.020129277
02-Sep-24 03:00:00	31.20255364	0.019843442
02-Sep-24 04:00:00	31.51284022	0.019030566
02-Sep-24 05:00:00	32.28563917	0.011294952
02-Sep-24 06:00:00	33.17527429	0.013368639
02-Sep-24 07:00:00	34.71757831	0.01076916
02-Sep-24 08:00:00	37.86392437	0.015446294
02-Sep-24 09:00:00	39.17636756	0.01862002
02-Sep-24 10:00:00	39.0461803	0.020625735
02-Sep-24 11:00:00	37.6574082	0.020486559
02-Sep-24 12:00:00	37.03268606	0.018845552
02-Sep-24 13:00:00	37.80174227	0.013320071
02-Sep-24 14:00:00	33.08881393	0.012671723
02-Sep-24 15:00:00	32.61257943	0.012486971
02-Sep-24 16:00:00	32.9445396	0.01051943
02-Sep-24 17:00:00	34.542131	0.010301942
02-Sep-24 18:00:00	34.86977729	0.011401187

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)	
02-Sep-24 19:00:00	35.20963172	0.009203006	
02-Sep-24 20:00:00	35.42206613	0.009216948	
02-Sep-24 21:00:00	35.76113266	0.009023201	
02-Sep-24 22:00:00	35.97146232	0.006595137	
02-Sep-24 23:00:00	37.50037852	0.006785047	
03-Sep-24 00:00:00	38.47959515	0.004469352	
03-Sep-24 01:00:00	37.61286123	0.005904171	
03-Sep-24 02:00:00	29.25662327	0.007769964	
03-Sep-24 03:00:00	30.3984967	0.002724454	
03-Sep-24 04:00:00	30.34310056	0.005884323	
03-Sep-24 05:00:00	30.19559369	0.002799265	
03-Sep-24 06:00:00	30.65910187	0.00372921	
03-Sep-24 07:00:00	29.98205246	0.017699641	
03-Sep-24 08:00:00	30.68915131	0.015309596	
03-Sep-24 09:00:00	30.13299326	0.012446593	
03-Sep-24 10:00:00	30.93077013	0.01761075	
03-Sep-24 11:00:00	32.59823307	0.010956707	
03-Sep-24 12:00:00	34.42513821	0.011526017	
03-Sep-24 13:00:00	35.35477529	0.013100592	
03-Sep-24 14:00:00	35.55185403	0.009638769	
03-Sep-24 15:00:00	35.17915127	0.010409867	
03-Sep-24 16:00:00	34.89687638	0.013268598	
03-Sep-24 17:00:00	33.68278568	0.014233901	
03-Sep-24 18:00:00	34.70946519	0.024148233	
03-Sep-24 19:00:00	34.90540516	0.022176171	
03-Sep-24 20:00:00	34.58013492	0.013450453	
03-Sep-24 21:00:00	34.55194061	0.015948127	
03-Sep-24 22:00:00	33.93156586	0.013691046	
03-Sep-24 23:00:00	34.56142706	0.028544322	
04-Sep-24 00:00:00	36.16794227	0.020139053	
04-Sep-24 01:00:00	35.27589056	0.017180955	
04-Sep-24 02:00:00	35.20411988	0.012836425	
04-Sep-24 03:00:00	35.20680457	0.013936961	
04-Sep-24 04:00:00	35.7207598	0.016248236	
04-Sep-24 05:00:00	35.50561369	0.010938193	
04-Sep-24 06:00:00	35.60329126	0.00757844	
04-Sep-24 07:00:00	36.11942923	0.009761486	
04-Sep-24 08:00:00	38.29611153	0.010569754	
04-Sep-24 09:00:00	39.97957605	0.012559583	
04-Sep-24 10:00:00	38.28749223	0.009118831	
04-Sep-24 11:00:00	38.13102235	0.014331947	
04-Sep-24 12:00:00	38.90178349	0.01681423	
04-Sep-24 13:00:00	38.67286263	0.025759654	
04-Sep-24 14:00:00	39.13877119	0.054425582	
04-Sep-24 15:00:00	38.79829286	0.086209279	
04-Sep-24 16:00:00	37.91777675	0.083970053	
04-Sep-24 17:00:00	36.66924558	0.090623373	
04-Sep-24 18:00:00	36.93996061	0.078218701	
04-Sep-24 19:00:00	37.14953016	0.077221906	
04-Sep-24 20:00:00	37.15014891	0.076612119	
04-Sep-24 21:00:00	36.51293095	0.081172235	

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)	
04-Sep-24 22:00:00	36.56189495	0.082133992	
04-Sep-24 23:00:00	39.50044536	0.07963598	
05-Sep-24 00:00:00	38.54763168	0.080602688	
05-Sep-24 01:00:00	37.51024014	0.08123891	
05-Sep-24 02:00:00	36.62262195	0.083761851	
05-Sep-24 03:00:00	35.86591634	0.083091991	
05-Sep-24 04:00:00	35.9257147	0.085985448	
05-Sep-24 05:00:00	35.66260309	0.080703736	
05-Sep-24 06:00:00	35.72477047	0.08064567	
05-Sep-24 07:00:00	36.02560789	0.086256156	
05-Sep-24 08:00:00	38.32409813	0.070478697	
05-Sep-24 09:00:00	39.86823538	0.095048873	
05-Sep-24 10:00:00	39.27595356	0.080453962	
05-Sep-24 11:00:00	39.05913664	0.086653623	
05-Sep-24 12:00:00	38.36747271	0.086620249	
05-Sep-24 13:00:00	38.4094656	0.08626816	
05-Sep-24 14:00:00	39.50738352	0.087331	
05-Sep-24 15:00:00	39.12571021	0.086282143	
05-Sep-24 16:00:00	38.11413258	0.046132486	
05-Sep-24 17:00:00	37.4861317	0.040165624	
05-Sep-24 18:00:00	36.94081921	0.035731651	
05-Sep-24 19:00:00	36.32502826	0.027847026	
05-Sep-24 20:00:00	36.67480052	0.021472783	
05-Sep-24 21:00:00	36.67821266	0.028604189	
05-Sep-24 22:00:00	39.84447184	0.015244081	
05-Sep-24 23:00:00	38.96418044	0.008974929	
06-Sep-24 00:00:00	38.31077543	0.011092102	
06-Sep-24 01:00:00	37.55227489	0.010892773	
06-Sep-24 03:00:00	37.08482933	0.007718209	
06-Sep-24 04:00:00	36.86020683	0.008356832	
06-Sep-24 05:00:00	36.17983398	0.010664007	
06-Sep-24 06:00:00	36.37484466	0.00600116	
06-Sep-24 07:00:00	36.50575226	0.008629327	
06-Sep-24 08:00:00	38.79064116	0.01253986	
06-Sep-24 09:00:00	39.82178712	0.008122466	
06-Sep-24 10:00:00	39.94564343	0.006084379	
06-Sep-24 11:00:00	39.03489556	0.004850292	
06-Sep-24 12:00:00	39.15966537	0.004679431	
06-Sep-24 13:00:00	39.41162232	0.007536844	
06-Sep-24 14:00:00	37.86960617	0.008975228	
06-Sep-24 15:00:00	37.2398966	0.001475172	
06-Sep-24 16:00:00	36.95524305	0.006605422	
06-Sep-24 17:00:00	36.51659953	0.003026135	
06-Sep-24 18:00:00	37.04513741	0.00407465	
06-Sep-24 19:00:00	38.88313644	0.003110069	
06-Sep-24 20:00:00	38.8856039	0.001170932	
06-Sep-24 21:00:00	39.46111299	0.070510195	
06-Sep-24 22:00:00	39.85010701	0.005614904	
06-Sep-24 23:00:00	39.02197218	0.007857155	
07-Sep-24 00:00:00	38.992687	0.005644141	



Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name P1	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2001A1		3HYB-CHRC-AT-1A1	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
07-Sep-24 01:00:00	39.046017	0.003491417	
07-Sep-24 02:00:00	39.46735485	0.019050595	
07-Sep-24 03:00:00	39.36899319	0.024035557	
07-Sep-24 04:00:00	39.94699005	0.022503766	
07-Sep-24 05:00:00	39.91987284	0.023973816	
07-Sep-24 06:00:00	39.6960453	0.020965099	
07-Sep-24 07:00:00	39.62618329	0.011506097	
07-Sep-24 08:00:00	39.94439457	0.031440469	
07-Sep-24 09:00:00	39.40644811	0.021905051	
07-Sep-24 10:00:00	39.07981295	0.028278546	
07-Sep-24 11:00:00	39.50437658	0.027892292	
07-Sep-24 12:00:00	39.0079879	0.018017674	
07-Sep-24 13:00:00	39.92209426	0.029252073	
07-Sep-24 14:00:00	39.41711331	0.026621676	
07-Sep-24 15:00:00	38.87023533	0.023850172	
07-Sep-24 16:00:00	39.69650326	0.016679598	
07-Sep-24 17:00:00	39.52026943	0.016000716	
07-Sep-24 18:00:00	39.33322747	0.039648893	
07-Sep-24 19:00:00	39.14381162	0.024861692	
07-Sep-24 20:00:00	39.37650306	0.026097926	
07-Sep-24 21:00:00	39.20169846	0.025661032	
07-Sep-24 22:00:00	39.70540244	0.028736441	
07-Sep-24 23:00:00	39.34610074	0.037839379	
08-Sep-24 00:00:00	39.70820204	0.04289246	
08-Sep-24 01:00:00	39.59677541	0.079709284	
08-Sep-24 02:00:00	38.91645166	0.080079804	
08-Sep-24 03:00:00	39.69887442	0.061342862	
08-Sep-24 04:00:00	39.14763371	0.067737658	
08-Sep-24 05:00:00	39.04940386	0.067850696	
08-Sep-24 06:00:00	39.69719526	0.071739142	
08-Sep-24 07:00:00	39.37612057	0.070195924	
08-Sep-24 08:00:00	39.86943654	0.077182518	
08-Sep-24 09:00:00	39.72777826	0.086099118	
08-Sep-24 10:00:00	39.71375004	0.070919457	
08-Sep-24 11:00:00	39.21908663	0.064140238	
08-Sep-24 12:00:00	39.38666835	0.07998166	
08-Sep-24 13:00:00	38.90371042	0.069437822	
08-Sep-24 14:00:00	39.22120537	0.079690742	
08-Sep-24 15:00:00	39.98665613	0.067768506	
08-Sep-24 16:00:00	39.32104462	0.075930787	
08-Sep-24 17:00:00	37.69005347	0.068651617	
08-Sep-24 18:00:00	38.82690668	0.068615807	
08-Sep-24 19:00:00	38.98106254	0.074551185	
08-Sep-24 20:00:00	39.67481325	0.072276304	
08-Sep-24 21:00:00	39.9373196	0.081871726	
08-Sep-24 22:00:00	39.18019485	0.086597299	
08-Sep-24 23:00:00	38.89852208	0.083296215	
09-Sep-24 00:00:00	38.84455303	0.084776302	
09-Sep-24 01:00:00	38.87266044	0.068256705	
09-Sep-24 02:00:00	38.53655653	0.084167118	
09-Sep-24 03:00:00	39.41288448	0.074815255	

3HYB-CHRC-TT-2001A1		3HYB-CHRC-AT-1A1	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
09-Sep-24 04:00:00	39.5492312	0.069117645	
09-Sep-24 05:00:00	39.91341915	0.082763978	
09-Sep-24 06:00:00	39.43782686	0.069648755	
09-Sep-24 07:00:00	39.39587463	0.074813332	
09-Sep-24 08:00:00	39.82046516	0.076207769	
09-Sep-24 09:00:00	39.73084999	0.081492472	
09-Sep-24 10:00:00	39.19657421	0.086217086	
09-Sep-24 11:00:00	39.61642203	0.084679032	
09-Sep-24 12:00:00	38.94410229	0.079993446	
09-Sep-24 13:00:00	39.13131464	0.071745348	
09-Sep-24 14:00:00	39.72424207	0.08426035	
09-Sep-24 15:00:00	38.91177278	0.08029728	
09-Sep-24 16:00:00	39.86550545	0.081378368	
09-Sep-24 17:00:00	39.69165486	0.082875943	
09-Sep-24 18:00:00	39.72498649	0.08428911	
09-Sep-24 19:00:00	39.81699572	0.080781311	
09-Sep-24 20:00:00	39.86335646	0.069489348	
09-Sep-24 21:00:00	39.34617535	0.070926679	
09-Sep-24 22:00:00	39.74833208	0.07517652	
09-Sep-24 23:00:00	39.57596309	0.085794085	
10-Sep-24 00:00:00	39.49760365	0.074089784	
10-Sep-24 01:00:00	39.78181862	0.07393153	
10-Sep-24 02:00:00	39.93900357	0.077343101	
10-Sep-24 03:00:00	39.40277589	0.071900391	
10-Sep-24 04:00:00	39.3567039	0.084574483	
10-Sep-24 05:00:00	38.73958623	0.085799557	
10-Sep-24 06:00:00	38.51136673	0.086731049	
10-Sep-24 07:00:00	38.45031153	0.076459968	
10-Sep-24 08:00:00	38.93214112	0.086645399	
10-Sep-24 09:00:00	39.05224906	0.082449386	
10-Sep-24 10:00:00	39.16628993	0.079750992	
10-Sep-24 11:00:00	39.62897488	0.085119559	
10-Sep-24 12:00:00	39.26062016	0.083639164	
10-Sep-24 13:00:00	39.51442794	0.076933253	
10-Sep-24 14:00:00	39.66232982	0.080226894	
10-Sep-24 15:00:00	39.46140438	0.072978597	
10-Sep-24 16:00:00	39.71046035	0.07202775	
10-Sep-24 17:00:00	34.10151406	0.087370798	
10-Sep-24 18:00:00	34.59184091	0.08124784	
10-Sep-24 19:00:00	36.77271824	0.074786611	
10-Sep-24 20:00:00	35.96900666	0.083897146	
10-Sep-24 21:00:00	36.38868667	0.077650989	
10-Sep-24 22:00:00	36.69860358	0.086311309	
10-Sep-24 23:00:00	36.53624762	0.088410074	
11-Sep-24 00:00:00	36.35696374	0.0709565349	
11-Sep-24 01:00:00	36.78072336	0.083227651	
11-Sep-24 02:00:00	36.77959669	0.076950927	
11-Sep-24 03:00:00	36.73883184	0.088638419	
11-Sep-24 04:00:00	36.67337808	0.08175378	
11-Sep-24 05:00:00	36.2932957	0.087258542	
11-Sep-24 06:00:00	35.88340592	0.086171604	

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB.CHRC-TT-2001AI	3HYB.CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
11-Sep-24 07:00:00	35.92502301	0.087164954
11-Sep-24 08:00:00	37.17810444	0.067569993
11-Sep-24 09:00:00	39.05774327	0.077687138
11-Sep-24 10:00:00	39.67287716	0.080935742
11-Sep-24 11:00:00	39.56931045	0.067542778
11-Sep-24 12:00:00	39.59405926	0.074162221
11-Sep-24 13:00:00	39.63918672	0.078815213
11-Sep-24 14:00:00	38.55068954	0.081636904
11-Sep-24 15:00:00	37.99530933	0.072527175
11-Sep-24 16:00:00	38.30034419	0.086542425
11-Sep-24 17:00:00	38.62747475	0.072265379
11-Sep-24 18:00:00	38.40767497	0.072460397
11-Sep-24 19:00:00	38.17698321	0.069818613
11-Sep-24 20:00:00	36.10152374	0.0729652195
11-Sep-24 21:00:00	38.28344303	0.080062718
11-Sep-24 22:00:00	38.43921985	0.078846323
11-Sep-24 23:00:00	39.76404508	0.076754028
12-Sep-24 00:00:00	39.63148658	0.081162355
12-Sep-24 01:00:00	39.30869523	0.086274118
12-Sep-24 02:00:00	39.52785592	0.081073645
12-Sep-24 03:00:00	38.89650595	0.078002655
12-Sep-24 04:00:00	38.5407279	0.076304017
12-Sep-24 05:00:00	36.21122227	0.070578308
12-Sep-24 06:00:00	38.3550613	0.086215083
12-Sep-24 07:00:00	39.43840169	0.076877875
12-Sep-24 08:00:00	39.95300698	0.076333788
12-Sep-24 09:00:00	39.42204809	0.077904492
12-Sep-24 10:00:00	39.64034609	0.07710841
12-Sep-24 11:00:00	39.84343419	0.070035063
12-Sep-24 12:00:00	39.26176821	0.076282157
12-Sep-24 13:00:00	37.82038325	0.077571209
12-Sep-24 14:00:00	38.77699714	0.088715324
12-Sep-24 15:00:00	38.5892382	0.070315621
12-Sep-24 16:00:00	38.41957093	0.083972337
12-Sep-24 17:00:00	38.46458016	0.076240751
12-Sep-24 18:00:00	38.74398575	0.08080077
12-Sep-24 19:00:00	38.71097718	0.072046345
12-Sep-24 20:00:00	38.71830024	0.073058929
12-Sep-24 21:00:00	38.76579184	0.074832111
12-Sep-24 22:00:00	39.14204116	0.069378112
12-Sep-24 23:00:00	39.21865621	0.081690401
13-Sep-24 00:00:00	39.09450996	0.086402802
13-Sep-24 01:00:00	39.66561162	0.084523326
13-Sep-24 02:00:00	38.65769387	0.083975812
13-Sep-24 03:00:00	39.99203168	0.084722599
13-Sep-24 04:00:00	39.80935009	0.085466847
13-Sep-24 05:00:00	39.39871156	0.085557157
13-Sep-24 06:00:00	39.22217738	0.079669791
13-Sep-24 07:00:00	39.73248154	0.078608751
13-Sep-24 08:00:00	39.25050771	0.081632951
13-Sep-24 09:00:00	39.72465786	0.089315266

3HYB.CHRC-TT-2001AI	3HYB.CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
13-Sep-24 10:00:00	38.99860104	0.079460369
13-Sep-24 11:00:00	38.67109747	0.084361863
13-Sep-24 12:00:00	39.96305293	0.076736304
13-Sep-24 13:00:00	39.55248787	0.080478253
13-Sep-24 14:00:00	39.32629638	0.078174972
13-Sep-24 15:00:00	39.50032779	0.080826125
13-Sep-24 16:00:00	39.18942901	0.082901928
13-Sep-24 17:00:00	39.57634761	0.079665543
13-Sep-24 18:00:00	39.05503398	0.083112442
13-Sep-24 19:00:00	38.61362884	0.071152772
13-Sep-24 20:00:00	38.1183135	0.083619966
13-Sep-24 21:00:00	37.78313984	0.077684333
13-Sep-24 22:00:00	38.25193552	0.08246764
13-Sep-24 23:00:00	38.93782827	0.082029896
14-Sep-24 00:00:00	39.67824901	0.070056837
14-Sep-24 01:00:00	32.84868607	0.073959861
14-Sep-24 02:00:00	33.25222962	0.07966524
14-Sep-24 03:00:00	35.36113931	0.078913242
14-Sep-24 04:00:00	36.12426622	0.082366402
14-Sep-24 05:00:00	36.69919784	0.085334888
14-Sep-24 06:00:00	36.68440526	0.085357711
14-Sep-24 07:00:00	38.87403411	0.0837823
14-Sep-24 08:00:00	38.54568075	0.075489326
14-Sep-24 09:00:00	39.31470998	0.073004734
14-Sep-24 10:00:00	39.83432668	0.075337679
14-Sep-24 11:00:00	39.64523086	0.085436119
14-Sep-24 12:00:00	38.93940964	0.089269321
14-Sep-24 13:00:00	38.48273965	0.086043953
14-Sep-24 14:00:00	38.75904285	0.086738559
14-Sep-24 15:00:00	38.43840819	0.086940612
14-Sep-24 16:00:00	38.07052622	0.08643718
14-Sep-24 17:00:00	37.72323404	0.07768291
14-Sep-24 18:00:00	36.8544557	0.075055026
14-Sep-24 19:00:00	36.54834943	0.073000343
14-Sep-24 20:00:00	36.18822979	0.08062807
14-Sep-24 21:00:00	36.186584	0.077300996
14-Sep-24 22:00:00	36.46517786	0.087163534
14-Sep-24 23:00:00	38.40440484	0.086060419
15-Sep-24 00:00:00	39.56051918	0.086223097
15-Sep-24 01:00:00	39.06934387	0.070533364
15-Sep-24 02:00:00	38.25201912	0.081193296
15-Sep-24 03:00:00	37.67507949	0.084963701
15-Sep-24 04:00:00	37.68355128	0.072243732
15-Sep-24 05:00:00	37.52180314	0.076287503
15-Sep-24 06:00:00	37.34545773	0.076173893
15-Sep-24 07:00:00	38.07162293	0.087514394
15-Sep-24 08:00:00	39.32800757	0.085242577
15-Sep-24 09:00:00	39.98555563	0.092475388
15-Sep-24 10:00:00	38.12542815	0.084671293
15-Sep-24 11:00:00	38.55223012	0.074602664
15-Sep-24 12:00:00	36.71575757	0.078533709



Start Time	7/1/24 1:00 AM
End Time	11/1/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	11/1/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB CHRC-TT-2001AI			3HYB CHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)		
15-Sep-24 13:00:00	36.78627044	0.079974052		
15-Sep-24 14:00:00	38.22315297	0.07678574		
15-Sep-24 15:00:00	37.9780552	0.062330474		
15-Sep-24 16:00:00	37.8634813	0.070933466		
15-Sep-24 17:00:00	37.49245547	0.064578006		
15-Sep-24 18:00:00	37.05417883	0.076951795		
15-Sep-24 19:00:00	36.05931493	0.066754083		
15-Sep-24 20:00:00	33.59105521	0.061175129		
15-Sep-24 21:00:00	31.79603922	0.073094006		
15-Sep-24 22:00:00	34.04018793	0.072150976		
15-Sep-24 23:00:00	37.60691399	0.079512276		
16-Sep-24 00:00:00	38.46753665	0.073247963		
16-Sep-24 01:00:00	37.46330094	0.072709743		
16-Sep-24 02:00:00	37.31263448	0.081291577		
16-Sep-24 03:00:00	37.34576679	0.084147702		
16-Sep-24 04:00:00	37.37677305	0.077658561		
16-Sep-24 05:00:00	37.11904412	0.078066026		
16-Sep-24 06:00:00	36.94456938	0.082476142		
16-Sep-24 07:00:00	37.14725984	0.067970855		
16-Sep-24 08:00:00	38.29633188	0.077311803		
16-Sep-24 09:00:00	39.4924753	0.082711859		
16-Sep-24 10:00:00	39.64655936	0.07052263		
16-Sep-24 11:00:00	39.71999544	0.078179501		
16-Sep-24 12:00:00	39.63959985	0.085463555		
16-Sep-24 13:00:00	38.71555452	0.075316804		
16-Sep-24 14:00:00	38.95159829	0.08411471		
16-Sep-24 15:00:00	37.31926551	0.086437244		
16-Sep-24 16:00:00	37.20881312	0.070574386		
16-Sep-24 17:00:00	36.66339968	0.077468173		
16-Sep-24 18:00:00	36.69124561	0.077210756		
16-Sep-24 19:00:00	36.67108114	0.080129246		
16-Sep-24 20:00:00	36.77926192	0.069025094		
16-Sep-24 21:00:00	36.15713984	0.077916354		
16-Sep-24 22:00:00	36.33386144	0.086784861		
16-Sep-24 23:00:00	36.77850319	0.084733007		
17-Sep-24 00:00:00	38.34822814	0.069036224		
17-Sep-24 01:00:00	37.70236645	0.070790958		
17-Sep-24 02:00:00	37.43100171	0.073113362		
17-Sep-24 03:00:00	38.95785001	0.077554244		
17-Sep-24 04:00:00	39.09970331	0.081377952		
17-Sep-24 05:00:00	39.87521363	0.079602349		
17-Sep-24 06:00:00	38.8969917	0.086204181		
17-Sep-24 07:00:00	39.97375949	0.080343006		
17-Sep-24 08:00:00	39.19739154	0.078463771		
17-Sep-24 09:00:00	39.47032436	0.077032684		
17-Sep-24 10:00:00	39.44441576	0.071431208		
17-Sep-24 11:00:00	39.09464048	0.070766171		
17-Sep-24 12:00:00	38.85714522	0.073934577		
17-Sep-24 13:00:00	39.5413807	0.082309533		
17-Sep-24 14:00:00	38.9949781	0.069901556		
17-Sep-24 15:00:00	39.01816734	0.086065335		

3HYB CHRC-TT-2001AI			3HYB CHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)		
17-Sep-24 16:00:00	36.95892132	0.081091326		
17-Sep-24 17:00:00	33.40017858	0.078324052		
17-Sep-24 18:00:00	34.01582903	0.082318505		
17-Sep-24 19:00:00	34.97796641	0.077251625		
17-Sep-24 20:00:00	39.83669232	0.080960127		
17-Sep-24 21:00:00	36.69812539	0.071986775		
17-Sep-24 22:00:00	36.71737235	0.086394025		
17-Sep-24 23:00:00	36.81326221	0.075317199		
18-Sep-24 00:00:00	39.2150851	0.071554244		
18-Sep-24 01:00:00	39.51488939	0.074044234		
18-Sep-24 02:00:00	39.24048947	0.079628559		
18-Sep-24 03:00:00	38.88437324	0.08680109		
18-Sep-24 04:00:00	39.85223615	0.077595035		
18-Sep-24 05:00:00	39.42030984	0.073133837		
18-Sep-24 06:00:00	38.900642	0.068288499		
18-Sep-24 07:00:00	39.71758447	0.075210903		
18-Sep-24 08:00:00	39.02236649	0.081437121		
18-Sep-24 09:00:00	38.87436796	0.089420745		
18-Sep-24 10:00:00	39.82562972	0.082331742		
18-Sep-24 11:00:00	38.94861054	0.079601564		
18-Sep-24 12:00:00	39.67242799	0.074492795		
18-Sep-24 13:00:00	38.92235808	0.071848621		
18-Sep-24 14:00:00	39.25212454	0.069777926		
18-Sep-24 15:00:00	38.8660698	0.071503746		
18-Sep-24 16:00:00	39.53426021	0.069564663		
18-Sep-24 17:00:00	39.96779273	0.087297593		
18-Sep-24 18:00:00	38.1243311	0.086196605		
18-Sep-24 19:00:00	39.7676154	0.068677531		
18-Sep-24 20:00:00	39.28495495	0.085714312		
18-Sep-24 21:00:00	38.19426512	0.071657494		
18-Sep-24 22:00:00	29.97018608	0.085777021		
18-Sep-24 23:00:00	34.27655557	0.074587349		
19-Sep-24 00:00:00	36.95999924	0.074654093		
19-Sep-24 01:00:00	39.47433416	0.074211034		
19-Sep-24 02:00:00	39.83101232	0.075026311		
19-Sep-24 03:00:00	36.98829557	0.080375721		
19-Sep-24 04:00:00	39.7165568	0.080917285		
19-Sep-24 05:00:00	38.86740194	0.076142482		
19-Sep-24 06:00:00	39.94743652	0.075686738		
19-Sep-24 07:00:00	39.08429752	0.079595437		
19-Sep-24 08:00:00	39.14511872	0.07000445		
19-Sep-24 09:00:00	39.23188353	0.087345367		
19-Sep-24 10:00:00	39.15840522	0.073962398		
19-Sep-24 11:00:00	36.62018553	0.073841116		
19-Sep-24 12:00:00	39.14193191	0.078426948		
19-Sep-24 13:00:00	38.86105189	0.068072777		
19-Sep-24 14:00:00	37.99275404	0.082606589		
19-Sep-24 15:00:00	37.59012684	0.070260953		
19-Sep-24 16:00:00	36.74920193	0.079328643		
19-Sep-24 17:00:00	37.11914077	0.07407405		
19-Sep-24 18:00:00	38.47182467	0.078937552		

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2001A1	3HYB-CHRC-AT-1A1
---------------------	------------------

Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)
19-Sep-24 19:00:00	37.9385556	0.078328216
19-Sep-24 20:00:00	36.19550599	0.073881025
19-Sep-24 21:00:00	37.93416783	0.080111283
19-Sep-24 22:00:00	38.45211901	0.08173481
19-Sep-24 23:00:00	38.87436786	0.08351112
20-Sep-24 00:00:00	39.13440524	0.086423623
20-Sep-24 01:00:00	37.4860079	0.0728817
20-Sep-24 02:00:00	36.1232534	0.0833282
20-Sep-24 03:00:00	36.79517212	0.072042347
20-Sep-24 04:00:00	35.69528396	0.067844027
20-Sep-24 05:00:00	35.28847622	0.057828547
20-Sep-24 06:00:00	35.04174111	0.083067676
20-Sep-24 07:00:00	35.40014867	0.074945385
20-Sep-24 08:00:00	37.008823	0.068701482
20-Sep-24 09:00:00	37.32115683	0.074086607
20-Sep-24 10:00:00	36.80946759	0.070891989
20-Sep-24 11:00:00	37.51655016	0.081441981
20-Sep-24 12:00:00	37.95515027	0.087048903
20-Sep-24 13:00:00	37.8941661	0.073987131
20-Sep-24 14:00:00	37.40634115	0.079968657
20-Sep-24 15:00:00	36.60280772	0.075853343
20-Sep-24 16:00:00	35.87786387	0.079041936
20-Sep-24 17:00:00	35.63098262	0.07890454
20-Sep-24 18:00:00	35.68754813	0.066790536
20-Sep-24 19:00:00	35.3777753	0.062983154
20-Sep-24 20:00:00	35.31296393	0.083372955
20-Sep-24 21:00:00	35.23513602	0.08495316
20-Sep-24 22:00:00	35.33815412	0.081164425
20-Sep-24 23:00:00	37.22362212	0.069135932
21-Sep-24 00:00:00	36.87752891	0.059428734
21-Sep-24 01:00:00	35.57068703	0.073855987
21-Sep-24 02:00:00	34.30568442	0.067997272
21-Sep-24 03:00:00	34.35698956	0.068219048
21-Sep-24 04:00:00	34.32830746	0.069789506
21-Sep-24 05:00:00	34.34683617	0.068995647
21-Sep-24 06:00:00	34.11416635	0.080311
21-Sep-24 07:00:00	34.48079109	0.082895746
21-Sep-24 08:00:00	35.88441086	0.077037714
21-Sep-24 09:00:00	37.41406392	0.06021551
21-Sep-24 10:00:00	36.59224098	0.067657891
21-Sep-24 11:00:00	38.04423798	0.076412288
21-Sep-24 12:00:00	38.4717213	0.080165309
21-Sep-24 13:00:00	37.72124191	0.08337784
21-Sep-24 14:00:00	36.7392555	0.068077112
21-Sep-24 15:00:00	36.35402114	0.074470068
21-Sep-24 16:00:00	35.76111845	0.070592227
21-Sep-24 17:00:00	35.82967886	0.067168692
21-Sep-24 18:00:00	36.32018795	0.074980878
21-Sep-24 19:00:00	36.17043799	0.079577325
21-Sep-24 20:00:00	35.84820797	0.082944891
21-Sep-24 21:00:00	35.58903886	0.077854294

3HYB-CHRC-TT-2001A1	3HYB-CHRC-AT-1A1
---------------------	------------------

Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)
21-Sep-24 22:00:00	35.67403991	0.081925577
21-Sep-24 23:00:00	36.98902046	0.072832525
22-Sep-24 00:00:00	38.65784939	0.072530157
22-Sep-24 01:00:00	37.39440666	0.07524539
22-Sep-24 02:00:00	36.61080957	0.081278259
22-Sep-24 03:00:00	36.05282928	0.07389617
22-Sep-24 04:00:00	35.78476291	0.082983651
22-Sep-24 05:00:00	34.70564845	0.080916591
22-Sep-24 06:00:00	34.88664748	0.081738516
22-Sep-24 07:00:00	35.18263389	0.069501798
22-Sep-24 08:00:00	36.66184807	0.064989702
22-Sep-24 09:00:00	37.80131521	0.071451999
22-Sep-24 10:00:00	37.19347501	0.084138072
22-Sep-24 11:00:00	36.66499099	0.081076884
22-Sep-24 12:00:00	36.60588472	0.074801434
22-Sep-24 13:00:00	36.70058434	0.07127399
22-Sep-24 14:00:00	35.62984847	0.074880539
22-Sep-24 15:00:00	34.48265065	0.083973924
22-Sep-24 16:00:00	35.83084414	0.069998
22-Sep-24 17:00:00	34.40218547	0.07682598
22-Sep-24 18:00:00	34.45590888	0.069873885
22-Sep-24 19:00:00	34.03012978	0.08324758
22-Sep-24 20:00:00	33.89698372	0.067866294
22-Sep-24 21:00:00	34.10326487	0.068512524
22-Sep-24 22:00:00	34.87086378	0.073352157
22-Sep-24 23:00:00	37.74200001	0.082747531
23-Sep-24 00:00:00	38.54078834	0.06827889
23-Sep-24 01:00:00	38.04497634	0.07291633
23-Sep-24 02:00:00	37.50883759	0.074344867
23-Sep-24 03:00:00	36.35292259	0.085602005
23-Sep-24 04:00:00	35.54186631	0.082486585
23-Sep-24 05:00:00	35.07942735	0.081992358
23-Sep-24 06:00:00	34.82189527	0.079433104
23-Sep-24 07:00:00	35.25063913	0.078002407
23-Sep-24 08:00:00	37.1778347	0.070810418
23-Sep-24 09:00:00	39.15390612	0.067886949
23-Sep-24 10:00:00	38.63572486	0.078575024
23-Sep-24 11:00:00	37.93486824	0.068246776
23-Sep-24 12:00:00	38.55215267	0.081424792
23-Sep-24 13:00:00	38.11266355	0.071320745
23-Sep-24 14:00:00	37.61143478	0.079518603
23-Sep-24 15:00:00	37.10264305	0.069250086
23-Sep-24 16:00:00	37.24308402	0.076308911
23-Sep-24 17:00:00	36.47233833	0.087376177
23-Sep-24 18:00:00	36.31722098	0.070560292
23-Sep-24 19:00:00	36.07645538	0.074323165
23-Sep-24 20:00:00	35.21717301	0.080686779
23-Sep-24 21:00:00	35.73403944	0.081514438
23-Sep-24 22:00:00	35.68204993	0.073300563
23-Sep-24 23:00:00	38.0591238	0.070389755
24-Sep-24 00:00:00	38.0693315	0.08735645



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
24-Sep-24 01:00:00	36.75854578	0.079724267	
24-Sep-24 02:00:00	36.35406637	0.068166609	
24-Sep-24 03:00:00	36.24207387	0.097384135	
24-Sep-24 04:00:00	36.14866225	0.097339037	
24-Sep-24 05:00:00	35.85945104	0.071572028	
24-Sep-24 06:00:00	35.87946581	0.097148042	
24-Sep-24 07:00:00	35.85093798	0.07237813	
24-Sep-24 08:00:00	36.33860814	0.062505249	
24-Sep-24 09:00:00	38.15103827	0.079293219	
24-Sep-24 10:00:00	38.54198467	0.062915421	
24-Sep-24 11:00:00	36.58464196	0.066639626	
24-Sep-24 12:00:00	35.9947991	0.097351752	
24-Sep-24 13:00:00	35.29990778	0.071635103	
24-Sep-24 14:00:00	35.63591211	0.097286987	
24-Sep-24 15:00:00	35.00775574	0.097406005	
24-Sep-24 16:00:00	34.66304034	0.097257826	
24-Sep-24 17:00:00	32.36756773	0.087061495	
24-Sep-24 18:00:00	31.90787208	0.084839869	
24-Sep-24 19:00:00	31.76424307	0.097403051	
24-Sep-24 20:00:00	31.48178485	0.081490385	
24-Sep-24 21:00:00	31.36386184	0.080444828	
24-Sep-24 22:00:00	31.55847515	0.097110494	
24-Sep-24 23:00:00	30.93397463	0.084900174	
25-Sep-24 00:00:00	34.69469813	0.095549133	
25-Sep-24 01:00:00	38.29825183	0.073112484	
25-Sep-24 02:00:00	39.69847626	0.070100793	
25-Sep-24 03:00:00	39.16157222	0.097022841	
25-Sep-24 04:00:00	39.93768981	0.097077433	
25-Sep-24 05:00:00	39.11843481	0.096726368	
25-Sep-24 06:00:00	39.61257034	0.096665223	
25-Sep-24 07:00:00	39.09519747	0.096211509	
25-Sep-24 08:00:00	37.77131806	0.096309699	
25-Sep-24 09:00:00	37.12520935	0.096609497	
25-Sep-24 10:00:00	35.55364929	0.097023246	
25-Sep-24 11:00:00	35.05396226	0.096663683	
25-Sep-24 12:00:00	34.99524066	0.096727159	
25-Sep-24 13:00:00	36.22312288	0.096901449	
25-Sep-24 14:00:00	35.00010884	0.079892071	
25-Sep-24 15:00:00	35.08471885	0.097863685	
25-Sep-24 16:00:00	34.66018146	0.095860636	
25-Sep-24 17:00:00	33.10081899	0.09005695	
25-Sep-24 18:00:00	32.59253242	0.089772288	
25-Sep-24 19:00:00	32.58733669	0.0928911	
25-Sep-24 20:00:00	32.75833143	0.093434086	
25-Sep-24 21:00:00	32.76988674	0.093525526	
25-Sep-24 22:00:00	32.42220553	0.09420828	
25-Sep-24 23:00:00	32.59842426	0.095118592	
26-Sep-24 00:00:00	35.42520269	0.095415808	
26-Sep-24 01:00:00	38.4179588	0.096189937	
26-Sep-24 02:00:00	39.10076876	0.096144161	
26-Sep-24 03:00:00	39.54551526	0.095611708	

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
26-Sep-24 04:00:00	39.42816148	0.095978326	
26-Sep-24 05:00:00	39.54927437	0.095968649	
26-Sep-24 06:00:00	39.4915109	0.095778141	
26-Sep-24 07:00:00	39.48216819	0.09625911	
26-Sep-24 08:00:00	39.10536111	0.096357077	
26-Sep-24 09:00:00	39.37270692	0.096496667	
26-Sep-24 10:00:00	39.63831563	0.096088833	
26-Sep-24 11:00:00	39.26939698	0.096887895	
26-Sep-24 12:00:00	38.87861822	0.097272146	
26-Sep-24 13:00:00	39.32210283	0.073504522	
26-Sep-24 14:00:00	39.8813475	0.060577386	
26-Sep-24 15:00:00	39.22912671	0.075627129	
26-Sep-24 16:00:00	39.38059943	0.077940459	
26-Sep-24 17:00:00	39.2383343	0.090284571	
26-Sep-24 18:00:00	39.2519653	0.096670871	
26-Sep-24 19:00:00	39.39733251	0.096868653	
26-Sep-24 20:00:00	39.55566735	0.097200125	
26-Sep-24 21:00:00	39.57087578	0.097420473	
26-Sep-24 22:00:00	39.04968914	0.068673401	
26-Sep-24 23:00:00	38.96539737	0.097092522	
27-Sep-24 00:00:00	39.56896088	0.09710439	
27-Sep-24 01:00:00	39.53986109	0.096932984	
27-Sep-24 02:00:00	39.07599891	0.088558295	
27-Sep-24 03:00:00	38.92687301	0.096617748	
27-Sep-24 04:00:00	38.98706582	0.096823685	
27-Sep-24 05:00:00	39.03220025	0.097427558	
27-Sep-24 06:00:00	38.57864428	0.097396172	
27-Sep-24 07:00:00	39.1151117	0.081709179	
27-Sep-24 08:00:00	39.16927338	0.081757415	
27-Sep-24 09:00:00	38.88751859	0.078976984	
27-Sep-24 10:00:00	39.74001085	0.07895926	
27-Sep-24 11:00:00	39.60221115	0.078107428	
27-Sep-24 12:00:00	39.06846513	0.071726156	
27-Sep-24 13:00:00	39.42462302	0.084418826	
27-Sep-24 14:00:00	39.54204251	0.07537579	
27-Sep-24 15:00:00	39.40322146	0.077093076	
27-Sep-24 16:00:00	38.99572313	0.070585742	
27-Sep-24 17:00:00	39.5593816	0.08374787	
27-Sep-24 18:00:00	39.87209173	0.08684185	
27-Sep-24 19:00:00	38.74845105	0.0756201	
27-Sep-24 20:00:00	38.95693474	0.07257318	
27-Sep-24 21:00:00	38.54226862	0.069256716	
27-Sep-24 22:00:00	39.25944422	0.097123097	
27-Sep-24 23:00:00	38.98656362	0.096867088	
28-Sep-24 00:00:00	39.03746874	0.09653795	
28-Sep-24 01:00:00	39.0508189	0.096353233	
28-Sep-24 02:00:00	38.94530475	0.095960377	
28-Sep-24 03:00:00	38.95893934	0.095866276	
28-Sep-24 04:00:00	39.16693537	0.095970323	
28-Sep-24 05:00:00	38.39138956	0.096483019	
28-Sep-24 06:00:00	38.71864475	0.096302626	

Start Time	7/1/24 1:00 AM
End Time	3/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	3/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
28-Sep-24 07:00:00	39.01070662	0.097014363
28-Sep-24 08:00:00	39.14758082	0.09731498
28-Sep-24 09:00:00	38.90481386	0.067997473
28-Sep-24 10:00:00	39.0534991	0.072211072
28-Sep-24 11:00:00	39.35153627	0.080447766
28-Sep-24 12:00:00	39.09963082	0.084086268
28-Sep-24 13:00:00	39.28829699	0.078133956
28-Sep-24 14:00:00	39.75862105	0.071276511
28-Sep-24 15:00:00	38.89710459	0.087138209
28-Sep-24 16:00:00	39.16425583	0.084994103
28-Sep-24 17:00:00	39.4871037	0.080501609
28-Sep-24 18:00:00	38.92422213	0.097071237
28-Sep-24 19:00:00	38.62747707	0.096715271
28-Sep-24 20:00:00	38.38951448	0.096852055
28-Sep-24 21:00:00	38.4034175	0.096570276
28-Sep-24 22:00:00	38.97482607	0.096386318
28-Sep-24 23:00:00	39.52607609	0.096106635
28-Sep-24 00:00:00	39.18839783	0.095850627
29-Sep-24 01:00:00	39.85532727	0.095723131
29-Sep-24 02:00:00	39.05809018	0.095709228
29-Sep-24 03:00:00	39.50466765	0.095746867
29-Sep-24 04:00:00	38.33186035	0.095868222
29-Sep-24 05:00:00	38.24839842	0.09580146
29-Sep-24 06:00:00	38.26842973	0.085757463
29-Sep-24 07:00:00	38.45860147	0.0959031
29-Sep-24 08:00:00	39.70552591	0.095945457
29-Sep-24 09:00:00	39.3817701	0.09604673
29-Sep-24 10:00:00	38.95251588	0.096295505
29-Sep-24 11:00:00	39.46992608	0.097292299
29-Sep-24 12:00:00	38.96681839	0.073237672
29-Sep-24 13:00:00	39.833647	0.078136104
29-Sep-24 14:00:00	39.14531153	0.07877968
29-Sep-24 15:00:00	38.20155873	0.08209594
29-Sep-24 16:00:00	39.15131778	0.08302594
29-Sep-24 17:00:00	38.83152368	0.086532027
29-Sep-24 18:00:00	39.10365529	0.086756224
29-Sep-24 19:00:00	38.86254654	0.07412434
29-Sep-24 20:00:00	39.01880569	0.078863935
29-Sep-24 21:00:00	39.1153689	0.079418626
29-Sep-24 22:00:00	39.02650896	0.082982767
29-Sep-24 23:00:00	39.89099015	0.085921094
30-Sep-24 00:00:00	39.12422707	0.073821198
30-Sep-24 01:00:00	39.32345705	0.085651096
30-Sep-24 02:00:00	38.99528471	0.087112313
30-Sep-24 03:00:00	38.89573842	0.072115641
30-Sep-24 04:00:00	38.26242482	0.077753247
30-Sep-24 05:00:00	38.48568449	0.083271067
30-Sep-24 06:00:00	38.69527346	0.084619931
30-Sep-24 07:00:00	38.79204796	0.081507425
30-Sep-24 08:00:00	39.70457883	0.081926961
30-Sep-24 09:00:00	39.13120922	0.072778271

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
30-Sep-24 10:00:00	39.60350291	0.073049599
30-Sep-24 11:00:00	39.95093196	0.070642218
30-Sep-24 12:00:00	38.8638126	0.072879805
30-Sep-24 13:00:00	39.21162374	0.083981535
30-Sep-24 14:00:00	39.10351847	0.071784449
30-Sep-24 15:00:00	38.85574374	0.072236544
30-Sep-24 16:00:00	38.64106899	0.083265767
30-Sep-24 17:00:00	38.66010677	0.078368896
30-Sep-24 18:00:00	38.9391891	0.084125378
30-Sep-24 19:00:00	38.94761217	0.077389512
30-Sep-24 20:00:00	38.9592167	0.079918036
30-Sep-24 21:00:00	38.98208597	0.082052931
30-Sep-24 22:00:00	39.05789162	0.073835693
30-Sep-24 23:00:00	39.66954342	0.076108608
01-Oct-24 00:00:00	37.07452859	0.07181143
01-Oct-24 01:00:00	34.95654724	0.067922545
01-Oct-24 02:00:00	33.81834943	0.087000528
01-Oct-24 03:00:00	35.6496795	0.080758667
01-Oct-24 04:00:00	37.5306406	0.084154167
01-Oct-24 05:00:00	37.94342629	0.08415518
01-Oct-24 06:00:00	37.49431846	0.07568046
01-Oct-24 07:00:00	37.74488403	0.087068749
01-Oct-24 08:00:00	39.5989129	0.068888191
01-Oct-24 09:00:00	39.18747345	0.079149345
01-Oct-24 10:00:00	38.13371327	0.08323196
01-Oct-24 11:00:00	39.67057445	0.068899542
01-Oct-24 12:00:00	39.42771657	0.083433463
01-Oct-24 13:00:00	39.08039787	0.080644265
01-Oct-24 14:00:00	39.34756486	0.070724428
01-Oct-24 15:00:00	36.75331912	0.070717872
01-Oct-24 16:00:00	38.94170701	0.071277918
01-Oct-24 17:00:00	37.02583044	0.07027653
01-Oct-24 18:00:00	37.73418988	0.081354169
01-Oct-24 19:00:00	38.16693827	0.079505674
01-Oct-24 20:00:00	38.16666944	0.071446741
01-Oct-24 21:00:00	37.86739553	0.077117095
01-Oct-24 22:00:00	39.01433135	0.072289346
01-Oct-24 23:00:00	39.28877695	0.078985165
02-Oct-24 00:00:00	38.91704872	0.07480352
02-Oct-24 01:00:00	39.8120261	0.073903714
02-Oct-24 02:00:00	38.48738148	0.079795693
02-Oct-24 03:00:00	38.28681958	0.068888017
02-Oct-24 04:00:00	38.29194712	0.083208062
02-Oct-24 05:00:00	38.27869972	0.079881711
02-Oct-24 06:00:00	37.86202462	0.071474822
02-Oct-24 07:00:00	38.53328234	0.082707934
02-Oct-24 08:00:00	39.8227353	0.082273209
02-Oct-24 09:00:00	39.63380769	0.071076438
02-Oct-24 10:00:00	39.51344323	0.084805513
02-Oct-24 11:00:00	39.00501067	0.067846005
02-Oct-24 12:00:00	39.04798167	0.078616242



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2001A1		3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
02-Oct-24 13:00:00	39.56395146	0.08363097
02-Oct-24 14:00:00	39.97766244	0.08327256
02-Oct-24 15:00:00	39.23765729	0.07556953
02-Oct-24 16:00:00	39.81268086	0.077533214
02-Oct-24 17:00:00	39.85717897	0.074700322
02-Oct-24 18:00:00	39.85936912	0.07444646
02-Oct-24 19:00:00	39.57031131	0.07303597
02-Oct-24 20:00:00	38.833495	0.069116107
02-Oct-24 21:00:00	38.49887712	0.06771752
02-Oct-24 22:00:00	38.8093767	0.077249199
02-Oct-24 23:00:00	39.62515387	0.08309826
03-Oct-24 00:00:00	38.90707588	0.079486215
03-Oct-24 01:00:00	39.93040747	0.085425181
03-Oct-24 02:00:00	38.97916173	0.082275653
03-Oct-24 03:00:00	38.74269427	0.083612483
03-Oct-24 04:00:00	38.70954692	0.083190677
03-Oct-24 05:00:00	38.54595631	0.086178994
03-Oct-24 06:00:00	38.19065122	0.07795709
03-Oct-24 07:00:00	38.75985787	0.069503765
03-Oct-24 08:00:00	39.98499575	0.088765634
03-Oct-24 09:00:00	39.49201246	0.0770435985
03-Oct-24 10:00:00	39.27941191	0.081978658
03-Oct-24 11:00:00	39.20811806	0.069082187
03-Oct-24 12:00:00	39.2122556	0.067974354
03-Oct-24 13:00:00	39.32817174	0.076744485
03-Oct-24 14:00:00	38.69605834	0.082069111
03-Oct-24 15:00:00	38.5110931	0.076212657
03-Oct-24 16:00:00	39.52019994	0.097853745
03-Oct-24 17:00:00	38.09977036	0.080145468
03-Oct-24 18:00:00	37.74641853	0.084507554
03-Oct-24 19:00:00	37.7942422	0.079715272
03-Oct-24 20:00:00	37.95158877	0.073687832
03-Oct-24 21:00:00	37.74892556	0.067859887
03-Oct-24 22:00:00	37.85230693	0.067630869
03-Oct-24 23:00:00	39.5004118	0.074012067
04-Oct-24 00:00:00	39.44185456	0.078185519
04-Oct-24 01:00:00	39.85201578	0.07734577
04-Oct-24 02:00:00	37.9982428	0.075338526
04-Oct-24 03:00:00	38.31827427	0.067870203
04-Oct-24 04:00:00	38.34407954	0.08695185
04-Oct-24 05:00:00	38.21514782	0.07497647
04-Oct-24 06:00:00	37.91831445	0.077560324
04-Oct-24 07:00:00	38.21752405	0.06753505
04-Oct-24 08:00:00	39.05704419	0.072714299
04-Oct-24 09:00:00	39.05237642	0.085234681
04-Oct-24 10:00:00	38.92741576	0.067474408
04-Oct-24 11:00:00	37.09603123	0.072169336
04-Oct-24 12:00:00	38.62445805	0.066880882
04-Oct-24 13:00:00	38.60524776	0.073479167
04-Oct-24 14:00:00	38.21355861	0.083513117
04-Oct-24 15:00:00	37.74304871	0.082146131

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time interval	1h

3HYB-CHRC-TT-2001A1		3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
04-Oct-24 16:00:00	36.26332269	0.079651894
04-Oct-24 17:00:00	36.65397101	0.087213759
04-Oct-24 18:00:00	36.93544953	0.073177117
04-Oct-24 19:00:00	37.43864958	0.077903116
04-Oct-24 20:00:00	37.36504529	0.087657289
04-Oct-24 21:00:00	37.49282553	0.075472346
04-Oct-24 22:00:00	38.29525607	0.071831434
04-Oct-24 23:00:00	39.58451336	0.070133739
05-Oct-24 00:00:00	39.07801856	0.081888219
05-Oct-24 01:00:00	39.41400871	0.07094647
05-Oct-24 02:00:00	38.37604918	0.082018016
05-Oct-24 03:00:00	38.12250657	0.087133252
05-Oct-24 04:00:00	37.90282165	0.074868976
05-Oct-24 05:00:00	37.74562911	0.086254641
05-Oct-24 06:00:00	37.08890642	0.070199005
05-Oct-24 07:00:00	36.99544454	0.0716214
05-Oct-24 08:00:00	38.95223636	0.086203138
05-Oct-24 09:00:00	39.08211857	0.086538738
05-Oct-24 10:00:00	39.03626961	0.087189752
05-Oct-24 11:00:00	39.96496766	0.0792625341
05-Oct-24 12:00:00	38.85303328	0.082984574
05-Oct-24 13:00:00	38.74309791	0.082813631
05-Oct-24 14:00:00	36.95335178	0.076281235
05-Oct-24 15:00:00	39.15755464	0.079446883
05-Oct-24 16:00:00	37.6553785	0.085552737
05-Oct-24 17:00:00	36.75295333	0.086016001
05-Oct-24 18:00:00	35.97312677	0.081000531
05-Oct-24 19:00:00	35.97071571	0.073215845
05-Oct-24 20:00:00	36.72104832	0.078077647
05-Oct-24 21:00:00	37.05295282	0.087652319
05-Oct-24 22:00:00	37.81424793	0.069650971
05-Oct-24 23:00:00	39.1129101	0.075660143
06-Oct-24 00:00:00	39.83378742	0.07871743
06-Oct-24 01:00:00	39.63270076	0.077373557
06-Oct-24 02:00:00	38.89106485	0.08048355
06-Oct-24 03:00:00	38.98395774	0.077606932
06-Oct-24 04:00:00	38.23699964	0.087106511
06-Oct-24 05:00:00	38.02450572	0.079844824
06-Oct-24 06:00:00	38.3189268	0.07067439
06-Oct-24 07:00:00	38.64955987	0.085220883
06-Oct-24 08:00:00	38.95600151	0.072190689
06-Oct-24 09:00:00	39.73250785	0.076982631
06-Oct-24 10:00:00	39.27890076	0.085516739
06-Oct-24 11:00:00	39.04847275	0.068391308
06-Oct-24 12:00:00	39.71051965	0.080055592
06-Oct-24 13:00:00	39.81438792	0.07474287
06-Oct-24 14:00:00	39.54182753	0.077796897
06-Oct-24 15:00:00	39.81236781	0.072715986
06-Oct-24 16:00:00	39.00573861	0.078081368
06-Oct-24 17:00:00	39.45342446	0.07318127
06-Oct-24 18:00:00	39.40870961	0.07312045

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 600 molers canal (C°)	Chlorine online at 500 m. canal (mg/l)	
06-Oct-24 19:00:00	39.46495084	0.074131991	
06-Oct-24 20:00:00	39.25637304	0.07576681	
06-Oct-24 21:00:00	39.52839849	0.072939882	
06-Oct-24 22:00:00	39.01082174	0.079380213	
06-Oct-24 23:00:00	39.2907623	0.080199124	
07-Oct-24 00:00:00	39.65335732	0.086710364	
07-Oct-24 01:00:00	39.271811549	0.067871682	
07-Oct-24 02:00:00	39.89244432	0.077286933	
07-Oct-24 03:00:00	39.59547153	0.075604681	
07-Oct-24 04:00:00	39.22573466	0.071373136	
07-Oct-24 05:00:00	38.91709147	0.06981353	
07-Oct-24 06:00:00	39.24739186	0.082856124	
07-Oct-24 07:00:00	39.52425787	0.08477128	
07-Oct-24 08:00:00	38.90569663	0.076547181	
07-Oct-24 09:00:00	39.31357987	0.073941851	
07-Oct-24 10:00:00	39.46004855	0.070130787	
07-Oct-24 11:00:00	39.293360316	0.067840074	
07-Oct-24 12:00:00	39.34085849	0.071018766	
07-Oct-24 13:00:00	39.43638334	0.074138744	
07-Oct-24 14:00:00	39.24842409	0.081128974	
07-Oct-24 15:00:00	39.11824037	0.0838506	
07-Oct-24 16:00:00	37.0941828	0.068519549	
07-Oct-24 17:00:00	37.97959757	0.082510604	
07-Oct-24 18:00:00	38.91782397	0.076182955	
07-Oct-24 19:00:00	35.90027448	0.080959697	
07-Oct-24 20:00:00	37.97959757	0.07512176	
07-Oct-24 21:00:00	39.22939496	0.083202049	
07-Oct-24 22:00:00	39.97080884	0.068142382	
07-Oct-24 23:00:00	39.83062843	0.07512176	
08-Oct-24 00:00:00	39.78110012	0.080720101	
08-Oct-24 01:00:00	39.54240738	0.07981424	
08-Oct-24 02:00:00	39.51596877	0.085822433	
08-Oct-24 03:00:00	38.88328684	0.078344767	
08-Oct-24 04:00:00	38.2278074	0.074629108	
08-Oct-24 05:00:00	38.15726568	0.078789989	
08-Oct-24 06:00:00	37.45700811	0.080122031	
08-Oct-24 07:00:00	37.17278766	0.079340971	
08-Oct-24 08:00:00	37.84351944	0.084645752	
08-Oct-24 09:00:00	39.42978924	0.08019435	
08-Oct-24 10:00:00	39.96461111	0.082776873	
08-Oct-24 11:00:00	39.62842816	0.082641855	
08-Oct-24 12:00:00	39.52289165	0.088045689	
08-Oct-24 13:00:00	38.93216467	0.069407067	
08-Oct-24 14:00:00	39.52084053	0.076091017	
08-Oct-24 15:00:00	39.98705332	0.084956952	
08-Oct-24 16:00:00	39.22859471	0.074650139	
08-Oct-24 17:00:00	38.16824693	0.074436684	
08-Oct-24 18:00:00	37.39987783	0.076207556	
08-Oct-24 19:00:00	38.90733438	0.077017486	
08-Oct-24 20:00:00	39.02944598	0.07615948	
08-Oct-24 21:00:00	39.13608037	0.083069154	
		0.075291408	

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 600 molers canal (C°)	Chlorine online at 500 m. canal (mg/l)	
08-Oct-24 22:00:00	39.83355287	0.07498546	
08-Oct-24 23:00:00	39.48566512	0.081382914	
09-Oct-24 00:00:00	39.08072014	0.07866007	
09-Oct-24 01:00:00	39.34628738	0.082585737	
09-Oct-24 02:00:00	38.86266916	0.089875138	
09-Oct-24 03:00:00	38.21054287	0.088813825	
09-Oct-24 04:00:00	37.77594765	0.079036837	
09-Oct-24 05:00:00	37.01916084	0.0768817	
09-Oct-24 06:00:00	36.51107886	0.085306067	
09-Oct-24 07:00:00	37.21246857	0.086625729	
09-Oct-24 08:00:00	38.86388405	0.08261698	
09-Oct-24 09:00:00	39.10820359	0.079308428	
09-Oct-24 10:00:00	39.76837897	0.084689753	
09-Oct-24 11:00:00	39.38342278	0.072249797	
09-Oct-24 12:00:00	39.0776418	0.088275028	
09-Oct-24 13:00:00	38.13238479	0.085471892	
09-Oct-24 14:00:00	38.5570582	0.072168645	
09-Oct-24 15:00:00	38.32576667	0.07073715	
09-Oct-24 16:00:00	38.06559197	0.078731295	
09-Oct-24 17:00:00	37.22151148	0.073583289	
09-Oct-24 18:00:00	36.91588285	0.084740785	
09-Oct-24 19:00:00	37.27633341	0.078874222	
09-Oct-24 20:00:00	37.24493212	0.073289555	
09-Oct-24 21:00:00	37.47382662	0.08189108	
09-Oct-24 22:00:00	37.86686262	0.085658014	
09-Oct-24 23:00:00	39.64497235	0.088779091	
10-Oct-24 00:00:00	39.68612324	0.077833773	
10-Oct-24 01:00:00	39.3712068	0.0786655	
10-Oct-24 02:00:00	38.79582016	0.078880054	
10-Oct-24 03:00:00	37.483277	0.087711784	
10-Oct-24 04:00:00	37.81798865	0.08460868	
10-Oct-24 05:00:00	38.25019849	0.089044793	
10-Oct-24 06:00:00	37.87257138	0.083664132	
10-Oct-24 07:00:00	37.94118228	0.084567369	
10-Oct-24 08:00:00	39.07849275	0.084749054	
10-Oct-24 09:00:00	39.17590996	0.073761813	
10-Oct-24 10:00:00	35.17154419	0.077209912	
10-Oct-24 11:00:00	38.92821468	0.082180386	
10-Oct-24 12:00:00	39.30789059	0.085875043	
10-Oct-24 13:00:00	39.80311578	0.073363814	
10-Oct-24 14:00:00	39.61526222	0.083058857	
10-Oct-24 15:00:00	39.88580001	0.077590304	
10-Oct-24 16:00:00	39.75178944	0.082486755	
10-Oct-24 17:00:00	39.8506589	0.075279518	
10-Oct-24 18:00:00	39.81321719	0.073223713	
10-Oct-24 19:00:00	39.24240886	0.072053849	
10-Oct-24 20:00:00	39.36100065	0.088516884	
10-Oct-24 21:00:00	39.895898113	0.082528748	
10-Oct-24 22:00:00	38.86316971	0.077928316	
10-Oct-24 23:00:00	39.15288203	0.086587987	
11-Oct-24 00:00:00	38.87351873	0.075055375	



Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI	
Date/Time	Temperature at 500 meters cunad (C°)	Chlorine online at 500 m. cunad (mg/l)	
11-Oct-24 01:00:00	39.42290271	0.073226041	
11-Oct-24 02:00:00	39.69497363	0.077949822	
11-Oct-24 03:00:00	39.67945734	0.078895903	
11-Oct-24 04:00:00	39.88175165	0.085631985	
11-Oct-24 05:00:00	39.31003507	0.086222056	
11-Oct-24 06:00:00	38.96588897	0.083540903	
11-Oct-24 07:00:00	39.887196	0.074544671	
11-Oct-24 08:00:00	39.04135685	0.077121605	
11-Oct-24 09:00:00	39.4464453	0.082097246	
11-Oct-24 10:00:00	39.88550633	0.077100794	
11-Oct-24 11:00:00	39.26853551	0.07342751	
11-Oct-24 12:00:00	39.31043138	0.088016498	
11-Oct-24 13:00:00	39.81345377	0.079046034	
11-Oct-24 14:00:00	39.26153555	0.077538862	
11-Oct-24 15:00:00	39.4544665	0.07652496	
11-Oct-24 16:00:00	39.52810506	0.075682743	
11-Oct-24 17:00:00	39.36141119	0.073141424	
11-Oct-24 18:00:00	39.24144326	0.069062644	
11-Oct-24 19:00:00	39.09512569	0.071235157	
11-Oct-24 20:00:00	39.94509735	0.079488017	
11-Oct-24 21:00:00	39.80745351	0.089211727	
11-Oct-24 22:00:00	39.57802355	0.074848625	
11-Oct-24 23:00:00	38.4587743	0.073970001	
12-Oct-24 00:00:00	39.55129489	0.088055773	
12-Oct-24 01:00:00	39.62444584	0.081782915	
12-Oct-24 02:00:00	38.85921383	0.075045468	
12-Oct-24 03:00:00	39.76074926	0.089262939	
12-Oct-24 04:00:00	38.98297916	0.085596436	
12-Oct-24 05:00:00	39.56645072	0.079634673	
12-Oct-24 06:00:00	38.97093052	0.081052636	
12-Oct-24 07:00:00	39.87695365	0.086203662	
12-Oct-24 08:00:00	39.15324227	0.085555073	
12-Oct-24 09:00:00	39.20542883	0.072571372	
12-Oct-24 10:00:00	38.0365395	0.087001792	
12-Oct-24 11:00:00	38.93837319	0.088024675	
12-Oct-24 12:00:00	38.94632399	0.070054792	
12-Oct-24 13:00:00	38.93737241	0.086186366	
12-Oct-24 14:00:00	39.39735176	0.085574718	
12-Oct-24 15:00:00	39.5235325	0.075637555	
12-Oct-24 16:00:00	39.69747553	0.06781421	
12-Oct-24 17:00:00	38.95315846	0.08738059	
12-Oct-24 18:00:00	39.80743801	0.082657042	
12-Oct-24 19:00:00	39.64032013	0.077922328	
12-Oct-24 20:00:00	39.80314552	0.078381889	
12-Oct-24 21:00:00	39.17717333	0.075526151	
12-Oct-24 22:00:00	39.83135445	0.079520371	
12-Oct-24 23:00:00	39.88548651	0.086359845	
13-Oct-24 00:00:00	39.94941135	0.071125251	
13-Oct-24 01:00:00	39.22881909	0.085558759	
13-Oct-24 02:00:00	39.69702843	0.075842266	
13-Oct-24 03:00:00	39.52544741	0.074507033	

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI	
Date/Time	Temperature at 500 meters cunad (C°)	Chlorine online at 500 m. cunad (mg/l)	
13-Oct-24 04:00:00	39.08180284	0.071389184	
13-Oct-24 05:00:00	38.87448746	0.069696955	
13-Oct-24 06:00:00	39.0466302	0.073052595	
13-Oct-24 07:00:00	39.31411803	0.070667221	
13-Oct-24 08:00:00	39.05460539	0.071032851	
13-Oct-24 09:00:00	39.35618716	0.088207245	
13-Oct-24 10:00:00	38.93366451	0.073444546	
13-Oct-24 11:00:00	39.31503248	0.078859605	
13-Oct-24 12:00:00	39.4080793	0.068056002	
13-Oct-24 13:00:00	38.77866128	0.07402536	
13-Oct-24 14:00:00	39.52849772	0.070571598	
13-Oct-24 15:00:00	39.73016204	0.072682186	
13-Oct-24 16:00:00	39.91622154	0.082601286	
13-Oct-24 17:00:00	39.58407648	0.069092908	
13-Oct-24 18:00:00	39.16831902	0.087338004	
13-Oct-24 19:00:00	39.48775452	0.0870094	
13-Oct-24 20:00:00	39.353577	0.074013872	
13-Oct-24 21:00:00	39.22050588	0.086631314	
13-Oct-24 22:00:00	39.92283305	0.075523317	
13-Oct-24 23:00:00	39.0887401	0.084509558	
14-Oct-24 00:00:00	39.05760839	0.079076017	
14-Oct-24 01:00:00	39.94904568	0.072393001	
14-Oct-24 02:00:00	39.23552286	0.085561457	
14-Oct-24 03:00:00	38.71622332	0.069167836	
14-Oct-24 04:00:00	39.38466762	0.078548244	
14-Oct-24 05:00:00	39.38724683	0.06894441	
14-Oct-24 06:00:00	39.06945398	0.078145781	
14-Oct-24 07:00:00	39.21728461	0.075171973	
14-Oct-24 08:00:00	39.4360008	0.074612756	
14-Oct-24 09:00:00	39.38000871	0.0826343	
14-Oct-24 10:00:00	39.59931808	0.085928286	
14-Oct-24 11:00:00	39.70404967	0.075626919	
14-Oct-24 12:00:00	39.73035221	0.082397006	
14-Oct-24 13:00:00	39.55908614	0.086508653	
14-Oct-24 14:00:00	39.66327049	0.085402258	
14-Oct-24 15:00:00	39.07681294	0.071099322	
14-Oct-24 16:00:00	39.92086931	0.071745812	
14-Oct-24 17:00:00	39.75254679	0.070514592	
14-Oct-24 18:00:00	39.92485926	0.074766619	
14-Oct-24 19:00:00	39.7074545	0.083995539	
14-Oct-24 20:00:00	39.42403853	0.081875371	
14-Oct-24 21:00:00	39.57968679	0.071447207	
14-Oct-24 22:00:00	39.88082913	0.076396909	
14-Oct-24 23:00:00	38.91376873	0.06817823	
15-Oct-24 00:00:00	38.63798195	0.078125393	
15-Oct-24 01:00:00	39.7890088	0.077890001	
15-Oct-24 02:00:00	38.95215644	0.084220735	
15-Oct-24 03:00:00	39.36296733	0.069973341	
15-Oct-24 04:00:00	38.25809455	0.069189339	
15-Oct-24 05:00:00	39.58468415	0.067495745	
15-Oct-24 06:00:00	39.36533365	0.085711584	

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name PI	
Time Interval	1h

3HYB CHRC-TT-2001AI		3HYB CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
15-Oct-24 07:00:00	39.32297037	0.073175894
15-Oct-24 08:00:00	39.92686742	0.075384294
15-Oct-24 09:00:00	39.44146997	0.072319808
15-Oct-24 10:00:00	39.87887594	0.083397029
15-Oct-24 11:00:00	39.10448216	0.086190248
15-Oct-24 12:00:00	39.7007501	0.074268205
15-Oct-24 13:00:00	36.87941437	0.071636747
15-Oct-24 14:00:00	39.64158158	0.068325478
15-Oct-24 15:00:00	39.62027438	0.081325061
15-Oct-24 16:00:00	39.39403107	0.076632094
15-Oct-24 17:00:00	39.04704151	0.086755597
15-Oct-24 18:00:00	38.49168316	0.086203561
15-Oct-24 19:00:00	39.63543911	0.073003736
15-Oct-24 20:00:00	38.98401009	0.074493465
15-Oct-24 21:00:00	39.53460076	0.078775895
15-Oct-24 22:00:00	38.9443329	0.087761084
15-Oct-24 23:00:00	39.73978545	0.071276274
16-Oct-24 00:00:00	39.04329504	0.085428115
16-Oct-24 01:00:00	39.98867616	0.081213892
16-Oct-24 02:00:00	39.82732533	0.08651257
16-Oct-24 03:00:00	39.18177562	0.073987062
16-Oct-24 04:00:00	39.49587801	0.084158
16-Oct-24 05:00:00	39.03844672	0.079612247
16-Oct-24 06:00:00	38.99540251	0.085638399
16-Oct-24 07:00:00	38.91974135	0.08675125
16-Oct-24 08:00:00	39.70269736	0.070843011
16-Oct-24 09:00:00	39.35160242	0.084657645
16-Oct-24 10:00:00	39.23874463	0.07910485
16-Oct-24 11:00:00	39.62149459	0.06873252
16-Oct-24 12:00:00	39.78953962	0.084420411
16-Oct-24 13:00:00	38.73337694	0.079138732
16-Oct-24 14:00:00	38.86766704	0.070209829
16-Oct-24 15:00:00	39.17017857	0.070142897
16-Oct-24 16:00:00	38.88714289	0.075478497
16-Oct-24 17:00:00	38.89496284	0.076228482
16-Oct-24 18:00:00	39.82291632	0.083116028
16-Oct-24 19:00:00	39.99657849	0.07817453
16-Oct-24 20:00:00	39.80313499	0.072389151
16-Oct-24 21:00:00	38.91425056	0.070121737
16-Oct-24 22:00:00	39.97863955	0.081198962
16-Oct-24 23:00:00	39.92886325	0.078342455
17-Oct-24 00:00:00	39.94463319	0.072853259
17-Oct-24 01:00:00	39.5793752	0.079682695
17-Oct-24 02:00:00	39.88223568	0.075287267
17-Oct-24 03:00:00	39.16385988	0.085711128
17-Oct-24 04:00:00	39.57259806	0.079501328
17-Oct-24 05:00:00	39.05119543	0.067643454
17-Oct-24 06:00:00	39.40601288	0.079023636
17-Oct-24 07:00:00	39.48010383	0.070674305
17-Oct-24 08:00:00	39.2233311	0.074735312
17-Oct-24 09:00:00	39.14972317	0.086597184

3HYB CHRC-TT-2001AI		3HYB CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
17-Oct-24 10:00:00	38.88143546	0.072114367
17-Oct-24 11:00:00	39.22288733	0.073361998
17-Oct-24 12:00:00	39.9738596	0.072774833
17-Oct-24 13:00:00	39.4489943	0.068247562
17-Oct-24 14:00:00	39.66173517	0.082314652
17-Oct-24 15:00:00	38.99390995	0.082742511
17-Oct-24 16:00:00	39.65819584	0.079810064
17-Oct-24 17:00:00	39.42421851	0.073714687
17-Oct-24 18:00:00	39.26528185	0.07000522
17-Oct-24 19:00:00	39.37646976	0.086549817
17-Oct-24 20:00:00	39.20835534	0.075334057
17-Oct-24 21:00:00	38.08439453	0.081453812
17-Oct-24 22:00:00	39.81684113	0.085163073
17-Oct-24 23:00:00	38.43767532	0.086001647
18-Oct-24 00:00:00	39.46105552	0.074923764
18-Oct-24 01:00:00	39.23026664	0.082826229
18-Oct-24 02:00:00	39.03632518	0.083633447
18-Oct-24 03:00:00	39.58676393	0.085563099
18-Oct-24 04:00:00	39.87420017	0.077796661
18-Oct-24 05:00:00	39.08804606	0.085905059
18-Oct-24 06:00:00	39.68070941	0.078250963
18-Oct-24 07:00:00	39.08571241	0.082543384
18-Oct-24 08:00:00	38.88714366	0.083194055
18-Oct-24 09:00:00	39.32526782	0.086307283
18-Oct-24 10:00:00	38.95704066	0.081465289
18-Oct-24 11:00:00	39.1064574	0.075360068
18-Oct-24 12:00:00	39.44415857	0.076392736
18-Oct-24 13:00:00	37.64770855	0.072225782
18-Oct-24 14:00:00	30.34918585	0.075815286
18-Oct-24 15:00:00	33.55990369	0.087081125
18-Oct-24 16:00:00	38.27899327	0.070154321
18-Oct-24 17:00:00	37.08004522	0.071425145
18-Oct-24 18:00:00	37.56293696	0.068483657
18-Oct-24 19:00:00	37.86119472	0.0850378
18-Oct-24 20:00:00	38.17677007	0.073845614
18-Oct-24 21:00:00	39.11638505	0.071508286
18-Oct-24 22:00:00	39.08718273	0.078327419
18-Oct-24 23:00:00	39.12327879	0.068886737
19-Oct-24 00:00:00	39.81226696	0.078557562
19-Oct-24 01:00:00	39.49867028	0.071566618
19-Oct-24 02:00:00	39.41867156	0.07265264
19-Oct-24 03:00:00	39.43983221	0.079432645
19-Oct-24 04:00:00	39.26706223	0.074379646
19-Oct-24 05:00:00	38.52008148	0.08639461
19-Oct-24 06:00:00	39.02175521	0.071122613
19-Oct-24 07:00:00	39.10334088	0.079464
19-Oct-24 08:00:00	39.82057607	0.083288758
19-Oct-24 09:00:00	39.14334875	0.079457263
19-Oct-24 10:00:00	39.98467019	0.077473741
19-Oct-24 11:00:00	38.94468452	0.086142004
19-Oct-24 12:00:00	39.25047836	0.06778977



Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB CHRC-TT-2001A			3HYB CHRC-AI-1A
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
19-Oct-24 13:00:00	39.86569562	0.074851398	
19-Oct-24 14:00:00	39.97979508	0.074457836	
19-Oct-24 15:00:00	38.98475781	0.087142765	
19-Oct-24 16:00:00	39.69277848	0.071868261	
19-Oct-24 17:00:00	39.32564224	0.069774818	
19-Oct-24 18:00:00	39.08640633	0.086352443	
19-Oct-24 19:00:00	39.25644275	0.083081044	
19-Oct-24 20:00:00	39.77082519	0.072935523	
19-Oct-24 21:00:00	39.09481959	0.083223897	
19-Oct-24 22:00:00	39.32432492	0.069484011	
19-Oct-24 23:00:00	39.74302453	0.085250563	
20-Oct-24 00:00:00	38.6180582	0.087119353	
20-Oct-24 01:00:00	38.14796669	0.078434252	
20-Oct-24 02:00:00	38.35819432	0.074412049	
20-Oct-24 03:00:00	37.12186316	0.085702811	
20-Oct-24 04:00:00	38.40875426	0.077591203	
20-Oct-24 05:00:00	38.43736921	0.073538318	
20-Oct-24 06:00:00	35.17021402	0.0780264	
20-Oct-24 07:00:00	31.48532242	0.083754332	
20-Oct-24 08:00:00	31.81894389	0.081156099	
20-Oct-24 09:00:00	34.86282697	0.086582669	
20-Oct-24 10:00:00	36.25505529	0.085241905	
20-Oct-24 11:00:00	37.47313673	0.072509887	
20-Oct-24 12:00:00	39.84202033	0.081777481	
20-Oct-24 13:00:00	39.27629272	0.086303189	
20-Oct-24 14:00:00	39.75415865	0.078885479	
20-Oct-24 15:00:00	39.24579333	0.088132519	
20-Oct-24 16:00:00	39.36418605	0.071536388	
20-Oct-24 17:00:00	38.72074619	0.080306972	
20-Oct-24 18:00:00	39.28438535	0.08784155	
20-Oct-24 19:00:00	39.06818047	0.086010985	
20-Oct-24 20:00:00	39.65980071	0.087714935	
20-Oct-24 21:00:00	38.9107241	0.072524773	
20-Oct-24 22:00:00	39.26116095	0.078244874	
20-Oct-24 23:00:00	39.77120749	0.072683315	
21-Oct-24 00:00:00	39.76262638	0.071803709	
21-Oct-24 01:00:00	39.87757036	0.073645049	
21-Oct-24 02:00:00	39.21490756	0.071798366	
21-Oct-24 03:00:00	38.91954339	0.067808983	
21-Oct-24 04:00:00	38.99508682	0.084282519	
21-Oct-24 05:00:00	38.92361907	0.077017558	
21-Oct-24 06:00:00	38.12208183	0.086241886	
21-Oct-24 07:00:00	39.37025594	0.080631931	
21-Oct-24 08:00:00	39.43971907	0.080028494	
21-Oct-24 09:00:00	38.4819566	0.072984647	
21-Oct-24 10:00:00	39.20800328	0.084414613	
21-Oct-24 11:00:00	39.78557967	0.087775452	
21-Oct-24 12:00:00	39.83429193	0.071661479	
21-Oct-24 13:00:00	39.56510013	0.082017149	
21-Oct-24 14:00:00	39.64281081	0.069188314	
21-Oct-24 15:00:00	39.40599423	0.08577875	

3HYB CHRC-TT-2001A			3HYB CHRC-AI-1A
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
21-Oct-24 16:00:00	38.50619036	0.083291655	
21-Oct-24 17:00:00	37.59541301	0.08008741	
21-Oct-24 18:00:00	37.30734359	0.087159566	
21-Oct-24 19:00:00	37.43419534	0.086563174	
21-Oct-24 20:00:00	37.45279604	0.07312647	
21-Oct-24 21:00:00	37.51028693	0.087071068	
21-Oct-24 22:00:00	37.4950057	0.07809176	
21-Oct-24 23:00:00	39.30598677	0.067689193	
22-Oct-24 00:00:00	39.4584566	0.071509743	
22-Oct-24 01:00:00	38.6481848	0.070239888	
22-Oct-24 02:00:00	38.0324693	0.084446516	
22-Oct-24 03:00:00	37.66894715	0.084554253	
22-Oct-24 04:00:00	37.37493492	0.077263468	
22-Oct-24 05:00:00	37.59372681	0.067483422	
22-Oct-24 06:00:00	37.68007347	0.078297311	
22-Oct-24 07:00:00	38.35812912	0.075866989	
22-Oct-24 08:00:00	38.82682294	0.073982789	
22-Oct-24 09:00:00	38.93124977	0.072308536	
22-Oct-24 10:00:00	38.95154659	0.071715084	
22-Oct-24 11:00:00	39.00778962	0.071174126	
22-Oct-24 12:00:00	39.87272293	0.076416158	
22-Oct-24 13:00:00	27.60413488	0.076731831	
22-Oct-24 14:00:00	25.72321701	0.087286846	
22-Oct-24 15:00:00	27.17987427	0.070808434	
22-Oct-24 16:00:00	31.34356739	0.069505064	
22-Oct-24 17:00:00	33.73858361	0.087551972	
22-Oct-24 18:00:00	31.99624137	0.076538194	
22-Oct-24 19:00:00	28.69472007	0.078233261	
22-Oct-24 20:00:00	36.32119203	0.077914166	
22-Oct-24 21:00:00	31.0767629	0.06966933	
22-Oct-24 22:00:00	30.3429405	0.072259405	
22-Oct-24 23:00:00	30.91646305	0.074262062	
23-Oct-24 00:00:00	30.97610218	0.078830637	
23-Oct-24 01:00:00	32.28768529	0.073272787	
23-Oct-24 02:00:00	32.92855923	0.0867895	
23-Oct-24 03:00:00	31.61509493	0.085440408	
23-Oct-24 04:00:00	29.99355546	0.08682556	
23-Oct-24 05:00:00	29.2248284	0.080871012	
23-Oct-24 06:00:00	29.53735598	0.082450659	
23-Oct-24 07:00:00	29.81024662	0.082505447	
23-Oct-24 08:00:00	35.43918756	0.079234724	
23-Oct-24 09:00:00	30.60306871	0.08241234	
23-Oct-24 10:00:00	38.39031481	0.075056844	
23-Oct-24 11:00:00	35.62842987	0.067592877	
23-Oct-24 12:00:00	36.07399474	0.083000906	
23-Oct-24 13:00:00	34.73903443	0.071208364	
23-Oct-24 14:00:00	37.35453861	0.082574042	
23-Oct-24 15:00:00	34.67795721	0.076866698	
23-Oct-24 16:00:00	33.44867932	0.072181125	
23-Oct-24 17:00:00	33.15690957	0.070032489	
23-Oct-24 18:00:00	33.16779812	0.08097188	

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
23-Oct-24 19:00:00	32.97811507	0.067811963
23-Oct-24 20:00:00	32.96706733	0.086545052
23-Oct-24 21:00:00	33.25719632	0.070854288
23-Oct-24 22:00:00	33.95101981	0.077459186
23-Oct-24 23:00:00	33.67193787	0.077691036
24-Oct-24 00:00:00	33.79188725	0.080252298
24-Oct-24 01:00:00	33.40633919	0.089851513
24-Oct-24 02:00:00	32.59862076	0.083341416
24-Oct-24 03:00:00	32.6228172	0.082843677
24-Oct-24 04:00:00	33.23198792	0.087472056
24-Oct-24 05:00:00	32.66362169	0.088197233
24-Oct-24 06:00:00	32.40720554	0.088703256
24-Oct-24 07:00:00	31.78135716	0.075200823
24-Oct-24 08:00:00	31.65889334	0.067666121
24-Oct-24 09:00:00	33.63052083	0.085715261
24-Oct-24 10:00:00	35.82540053	0.080851071
24-Oct-24 11:00:00	38.37750922	0.07248313
24-Oct-24 12:00:00	38.55960674	0.069131298
24-Oct-24 13:00:00	38.42072433	0.078550125
24-Oct-24 14:00:00	38.05840505	0.078779916
24-Oct-24 15:00:00	37.77559893	0.076138072
24-Oct-24 16:00:00	37.38133736	0.076975707
24-Oct-24 17:00:00	37.34075947	0.080611692
24-Oct-24 18:00:00	37.5123657	0.086514323
24-Oct-24 19:00:00	37.95308408	0.074026204
24-Oct-24 20:00:00	37.81600993	0.077802835
24-Oct-24 21:00:00	38.56717264	0.087785026
24-Oct-24 22:00:00	39.64216255	0.084969005
24-Oct-24 23:00:00	39.42694005	0.06916516
25-Oct-24 00:00:00	39.81161683	0.0877366
25-Oct-24 01:00:00	39.48284806	0.07359784
25-Oct-24 02:00:00	39.73016424	0.073100593
25-Oct-24 03:00:00	39.42462196	0.084989309
25-Oct-24 04:00:00	39.78187241	0.087149627
25-Oct-24 05:00:00	39.88010951	0.081001682
25-Oct-24 06:00:00	39.04324712	0.073152727
25-Oct-24 07:00:00	39.57872192	0.081001682
25-Oct-24 08:00:00	39.77117729	0.081985466
25-Oct-24 09:00:00	39.25728204	0.06898986
25-Oct-24 10:00:00	39.80040854	0.08703813
25-Oct-24 11:00:00	39.47653968	0.076342111
25-Oct-24 12:00:00	38.96565561	0.070083614
25-Oct-24 13:00:00	39.2433508	0.08685542
25-Oct-24 14:00:00	39.31381212	0.087397578
25-Oct-24 15:00:00	39.88460163	0.07827175
25-Oct-24 16:00:00	39.11131499	0.075748054
25-Oct-24 17:00:00	39.50900913	0.076089392
25-Oct-24 18:00:00	39.27641008	0.085817099
25-Oct-24 19:00:00	39.25913355	0.073796988
25-Oct-24 20:00:00	39.82407122	0.089519834
25-Oct-24 21:00:00	39.26592154	0.068165831

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
25-Oct-24 22:00:00	38.88081785	0.080551628
25-Oct-24 23:00:00	39.15181981	0.075378178
26-Oct-24 00:00:00	39.42515527	0.07554133
26-Oct-24 01:00:00	38.65181543	0.072192887
26-Oct-24 02:00:00	39.36002141	0.069851486
26-Oct-24 03:00:00	39.30515145	0.078245279
26-Oct-24 04:00:00	38.59668513	0.086454182
26-Oct-24 05:00:00	38.71046161	0.080185046
26-Oct-24 06:00:00	38.99503115	0.079647451
26-Oct-24 07:00:00	39.27514308	0.084862395
26-Oct-24 08:00:00	39.7748041	0.069387345
26-Oct-24 09:00:00	39.4515069	0.085140586
26-Oct-24 10:00:00	39.14088734	0.078990631
26-Oct-24 11:00:00	39.05510528	0.083401645
26-Oct-24 12:00:00	39.1351314	0.084126085
26-Oct-24 13:00:00	39.21287308	0.078181527
26-Oct-24 14:00:00	39.28458229	0.081292199
26-Oct-24 15:00:00	39.11555826	0.0857288
26-Oct-24 16:00:00	39.03131514	0.0822174
26-Oct-24 17:00:00	39.11466036	0.075627037
26-Oct-24 18:00:00	39.68889917	0.08017707
26-Oct-24 19:00:00	39.52216935	0.073139686
26-Oct-24 20:00:00	38.87383304	0.070620045
26-Oct-24 21:00:00	38.58574227	0.073309022
26-Oct-24 22:00:00	39.05089428	0.080218375
26-Oct-24 23:00:00	39.68848984	0.07047836
27-Oct-24 00:00:00	39.29637162	0.070358189
27-Oct-24 01:00:00	39.494483	0.077511981
27-Oct-24 02:00:00	39.28476317	0.081853212
27-Oct-24 03:00:00	39.7084942	0.071695575
27-Oct-24 04:00:00	39.19128317	0.070879104
27-Oct-24 05:00:00	39.97872326	0.07728346
27-Oct-24 06:00:00	38.92164448	0.080339425
27-Oct-24 07:00:00	39.56369252	0.074871173
27-Oct-24 08:00:00	39.72648364	0.075907502
27-Oct-24 09:00:00	39.39974758	0.082569995
27-Oct-24 10:00:00	39.75927156	0.08306997
27-Oct-24 11:00:00	38.09245538	0.072536669
27-Oct-24 12:00:00	38.06552048	0.076881198
27-Oct-24 13:00:00	37.42959031	0.076590642
27-Oct-24 14:00:00	36.64509562	0.079698115
27-Oct-24 15:00:00	35.95766312	0.087233131
27-Oct-24 16:00:00	34.44228385	0.072871161
27-Oct-24 17:00:00	38.89233173	0.073821278
27-Oct-24 18:00:00	33.5813145	0.075973451
27-Oct-24 19:00:00	33.16496116	0.079203869
27-Oct-24 20:00:00	32.65370811	0.071014187
27-Oct-24 21:00:00	32.09972359	0.084485365
27-Oct-24 22:00:00	32.16060533	0.080732824
27-Oct-24 23:00:00	33.94060537	0.089789181
28-Oct-24 00:00:00	32.70312917	0.073483791



Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	11/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB-CHRC-TT-2001A		3HYB-CHRC-AT-1A	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
28-Oct-24 01:00:00	31.87623174	0.074352464	
28-Oct-24 02:00:00	31.40026921	0.07496518	
28-Oct-24 03:00:00	32.17145031	0.073659617	
28-Oct-24 04:00:00	32.59762669	0.066046268	
28-Oct-24 05:00:00	30.93509389	0.06573871	
28-Oct-24 06:00:00	31.50485073	0.072766033	
28-Oct-24 07:00:00	32.23366181	0.06997888	
28-Oct-24 08:00:00	33.00439435	0.075212652	
28-Oct-24 09:00:00	31.56552333	0.073582065	
28-Oct-24 10:00:00	31.76793797	0.073430694	
28-Oct-24 11:00:00	32.6765546	0.062621881	
28-Oct-24 12:00:00	32.80320201	0.060358467	
28-Oct-24 13:00:00	32.31694542	0.065196539	
28-Oct-24 14:00:00	32.84008332	0.078905501	
28-Oct-24 15:00:00	32.25231287	0.075286066	
28-Oct-24 16:00:00	32.13435619	0.061108453	
28-Oct-24 17:00:00	30.74895138	0.063162898	
28-Oct-24 18:00:00	31.84844403	0.069386156	
28-Oct-24 19:00:00	31.66940808	0.072699096	
28-Oct-24 20:00:00	31.58223114	0.070103281	
28-Oct-24 21:00:00	31.52566249	0.075499136	
28-Oct-24 22:00:00	31.38243994	0.068833804	
28-Oct-24 23:00:00	31.6283815	0.061645974	
29-Oct-24 00:00:00	31.46842804	0.060959955	
29-Oct-24 01:00:00	31.29578278	0.061891451	
29-Oct-24 02:00:00	31.17090327	0.071004516	
29-Oct-24 03:00:00	31.49873769	0.077538596	
29-Oct-24 04:00:00	31.54488156	0.079048592	
29-Oct-24 05:00:00	31.84821244	0.082572839	
29-Oct-24 06:00:00	31.59746374	0.061403418	
29-Oct-24 07:00:00	32.2883721	0.080620264	
29-Oct-24 08:00:00	32.82041062	0.079351062	
29-Oct-24 09:00:00	33.90854263	0.063391713	
29-Oct-24 10:00:00	34.95265102	0.073528844	
29-Oct-24 11:00:00	35.69363802	0.073409733	
29-Oct-24 12:00:00	36.21907646	0.079651036	
29-Oct-24 13:00:00	34.6853974	0.085956821	
29-Oct-24 14:00:00	34.21854415	0.08090294	
29-Oct-24 15:00:00	33.90677215	0.074798755	
29-Oct-24 16:00:00	33.34145562	0.075466686	
29-Oct-24 17:00:00	32.50364312	0.077343606	
29-Oct-24 18:00:00	32.55932959	0.081340737	
29-Oct-24 19:00:00	32.28807734	0.082668197	
29-Oct-24 20:00:00	32.16350736	0.079249636	
29-Oct-24 21:00:00	32.14053312	0.083450454	
29-Oct-24 22:00:00	32.2742593	0.083079831	
29-Oct-24 23:00:00	32.2870899	0.077595469	
30-Oct-24 00:00:00	32.41840182	0.076269576	
30-Oct-24 01:00:00	32.47904718	0.082268146	
30-Oct-24 02:00:00	32.0895024	0.067545404	
30-Oct-24 03:00:00	32.5362409	0.085586786	

3HYB-CHRC-TT-2001A		3HYB-CHRC-AT-1A	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
30-Oct-24 04:00:00	28.80054614	0.07620823	
30-Oct-24 05:00:00	28.36366352	0.068082454	
30-Oct-24 06:00:00	29.55645147	0.085166598	
30-Oct-24 07:00:00	35.66263974	0.079182455	
30-Oct-24 08:00:00	32.62413666	0.073034839	
30-Oct-24 09:00:00	33.22635864	0.086532864	
30-Oct-24 10:00:00	33.80713362	0.081109273	
30-Oct-24 11:00:00	35.11056176	0.074751085	
30-Oct-24 12:00:00	35.09071616	0.079393003	
30-Oct-24 13:00:00	35.08687517	0.068238482	
30-Oct-24 14:00:00	35.36431785	0.079593728	
30-Oct-24 15:00:00	34.66534654	0.079452273	
30-Oct-24 16:00:00	33.81311372	0.080070405	
30-Oct-24 17:00:00	33.28157076	0.070637817	
30-Oct-24 18:00:00	32.12801228	0.082340245	
30-Oct-24 19:00:00	32.50917711	0.085219975	
30-Oct-24 20:00:00	32.43463672	0.073918059	
30-Oct-24 21:00:00	32.19535301	0.072646834	
30-Oct-24 22:00:00	32.44044513	0.077160272	
30-Oct-24 23:00:00	32.20919915	0.079445712	
31-Oct-24 00:00:00	32.08966649	0.081076395	
31-Oct-24 01:00:00	32.29862677	0.083005877	
31-Oct-24 02:00:00	32.38771971	0.074965924	
31-Oct-24 03:00:00	32.03226346	0.08717039	
31-Oct-24 04:00:00	31.82963873	0.085092759	
31-Oct-24 05:00:00	32.18998666	0.077539893	
31-Oct-24 06:00:00	32.41441809	0.079787327	
31-Oct-24 07:00:00	32.16693541	0.084245405	
31-Oct-24 08:00:00	33.26478924	0.071963912	
31-Oct-24 09:00:00	35.32548617	0.085207783	
31-Oct-24 10:00:00	35.84851646	0.081915362	
31-Oct-24 11:00:00	35.62990062	0.087169752	
31-Oct-24 12:00:00	36.2759709	0.074424757	
31-Oct-24 13:00:00	35.07065362	0.073689547	
31-Oct-24 14:00:00	33.16548323	0.073876893	
31-Oct-24 15:00:00	33.8584715	0.070133096	
31-Oct-24 16:00:00	24.80387158	0.079601196	
31-Oct-24 17:00:00	33.5266541	0.079576684	
31-Oct-24 18:00:00	32.40297071	0.067565113	
31-Oct-24 19:00:00	32.09552329	0.084243188	
31-Oct-24 20:00:00	31.61502419	0.082484696	
31-Oct-24 21:00:00	31.82257953	0.077158156	
31-Oct-24 22:00:00	31.88592963	0.0748161	
31-Oct-24 23:00:00	31.70796352	0.080808909	
01-Nov-24 00:00:00	31.5577514	0.086216002	
01-Nov-24 01:00:00	31.17984459	0.072835762	
01-Nov-24 02:00:00	30.99672126	0.05931128	
01-Nov-24 03:00:00	31.07314786	0.077599172	
01-Nov-24 04:00:00	31.19011651	0.08470176	
01-Nov-24 05:00:00	31.18700447	0.072979353	
01-Nov-24 06:00:00	31.20715371	0.08430617	

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2007AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
01-Nov-24 07:00:00	31.81115628	0.067821793
01-Nov-24 08:00:00	33.22701548	0.082250013
01-Nov-24 09:00:00	33.60249449	0.071839789
01-Nov-24 10:00:00	31.74782704	0.085206274
01-Nov-24 11:00:00	33.21432834	0.084126536
01-Nov-24 12:00:00	31.9865396	0.08953766
01-Nov-24 13:00:00	32.14693768	0.081866532
01-Nov-24 14:00:00	32.50665378	0.080466286
01-Nov-24 15:00:00	32.74594921	0.073897111
01-Nov-24 16:00:00	32.46897546	0.084959271
01-Nov-24 17:00:00	32.17260048	0.079365739
01-Nov-24 18:00:00	32.00288651	0.076742371
01-Nov-24 19:00:00	31.67566031	0.073431907
01-Nov-24 20:00:00	33.05273904	0.078216837
01-Nov-24 21:00:00	31.48957621	0.077526316
01-Nov-24 22:00:00	31.45289724	0.078758953
01-Nov-24 23:00:00	31.88613452	0.087263844
02-Nov-24 00:00:00	32.08284998	0.072225315
02-Nov-24 01:00:00	31.47494044	0.069959314
02-Nov-24 02:00:00	31.60876391	0.089743859
02-Nov-24 03:00:00	31.52696146	0.079720734
02-Nov-24 04:00:00	31.53787163	0.084868629
02-Nov-24 05:00:00	31.39877207	0.065225069
02-Nov-24 06:00:00	31.30601503	0.084699217
02-Nov-24 07:00:00	31.42012664	0.070442589
02-Nov-24 08:00:00	31.66391407	0.083740822
02-Nov-24 09:00:00	32.01720823	0.078990445
02-Nov-24 10:00:00	32.45592892	0.06844098
02-Nov-24 11:00:00	33.2786854	0.086174525
02-Nov-24 12:00:00	34.15950279	0.072065004
02-Nov-24 13:00:00	33.69708513	0.081816649
02-Nov-24 14:00:00	33.76861497	0.082671605
02-Nov-24 15:00:00	33.08940782	0.070505283
02-Nov-24 16:00:00	32.13523529	0.076931345
02-Nov-24 17:00:00	31.73669242	0.086506982
02-Nov-24 18:00:00	31.17666467	0.072729189
02-Nov-24 19:00:00	30.33087638	0.077046032
02-Nov-24 20:00:00	30.23814879	0.083385223
02-Nov-24 21:00:00	30.40232026	0.073239571
02-Nov-24 22:00:00	30.44731625	0.080641066
02-Nov-24 23:00:00	30.93432412	0.088424864
03-Nov-24 00:00:00	30.81356829	0.073025275
03-Nov-24 01:00:00	30.3873974	0.078612518
03-Nov-24 02:00:00	30.35073575	0.084854481
03-Nov-24 03:00:00	29.92434354	0.084666481
03-Nov-24 04:00:00	29.64995765	0.084082932
03-Nov-24 05:00:00	28.88762323	0.071857512
03-Nov-24 06:00:00	28.84564547	0.072515659
03-Nov-24 07:00:00	28.95820531	0.083675239
03-Nov-24 08:00:00	30.50943266	0.083715452
03-Nov-24 09:00:00	30.88217999	0.084723952

3HYB-CHRC-TT-2007AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
03-Nov-24 10:00:00	31.68603795	0.08405317
03-Nov-24 11:00:00	32.40263817	0.075428673
03-Nov-24 12:00:00	33.83251299	0.078772018
03-Nov-24 13:00:00	33.14585083	0.075339533
03-Nov-24 14:00:00	32.37088322	0.068268522
03-Nov-24 15:00:00	32.59550941	0.064874645
03-Nov-24 16:00:00	32.11210341	0.072500734
03-Nov-24 17:00:00	33.63878528	0.08545763
03-Nov-24 18:00:00	32.91148216	0.071059234
03-Nov-24 19:00:00	31.87754159	0.076091006
03-Nov-24 20:00:00	30.51518137	0.084960547
03-Nov-24 21:00:00	30.13578197	0.078771115
03-Nov-24 22:00:00	28.71536558	0.079542292
03-Nov-24 23:00:00	30.07361683	0.073278024
04-Nov-24 00:00:00	29.79465726	0.085018092
04-Nov-24 01:00:00	30.07043911	0.074418161
04-Nov-24 02:00:00	30.27388293	0.078434876
04-Nov-24 03:00:00	30.46587517	0.08671744
04-Nov-24 04:00:00	30.17377025	0.080741126
04-Nov-24 05:00:00	30.24022502	0.079461596
04-Nov-24 06:00:00	30.40450815	0.076589789
04-Nov-24 07:00:00	30.37761899	0.078810039
04-Nov-24 08:00:00	30.91892417	0.085418297
04-Nov-24 09:00:00	31.98450965	0.074369353
04-Nov-24 10:00:00	32.79189584	0.075338981
04-Nov-24 11:00:00	34.23761319	0.080865341
04-Nov-24 12:00:00	34.18842258	0.074531655
04-Nov-24 13:00:00	34.54834038	0.080466695
04-Nov-24 14:00:00	34.30388771	0.088248443
04-Nov-24 15:00:00	34.02652549	0.069454956
04-Nov-24 16:00:00	33.19112335	0.078146383
04-Nov-24 17:00:00	32.89205903	0.089921208
04-Nov-24 18:00:00	32.3735375	0.083415245
04-Nov-24 19:00:00	32.10514941	0.080224945
04-Nov-24 20:00:00	32.24793734	0.075808184
04-Nov-24 21:00:00	32.44738897	0.072720545
04-Nov-24 22:00:00	32.08468897	0.075442203
04-Nov-24 23:00:00	32.24023551	0.079114813
05-Nov-24 00:00:00	32.10213186	0.080953442
05-Nov-24 01:00:00	31.89421907	0.068315967
05-Nov-24 02:00:00	32.10260967	0.075434387
05-Nov-24 03:00:00	31.3059778	0.081831038
05-Nov-24 04:00:00	31.05045766	0.074306641
05-Nov-24 05:00:00	31.3626298	0.085141312
05-Nov-24 06:00:00	30.84455727	0.078638658
05-Nov-24 07:00:00	30.94122229	0.069516178
05-Nov-24 08:00:00	30.9593861	0.087555444
05-Nov-24 09:00:00	33.37543921	0.08182681
05-Nov-24 10:00:00	38.53851671	0.0703353
05-Nov-24 11:00:00	38.86597641	0.075093972
05-Nov-24 12:00:00	38.27558353	0.071408916



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name Pl	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name Pl	
Time Interval	1h

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
05-Nov-24 13:00:00	39.41145384	0.075323749
05-Nov-24 14:00:00	39.9680221	0.091814488
05-Nov-24 15:00:00	39.12375205	0.077634222
05-Nov-24 16:00:00	37.02788506	0.068278161
05-Nov-24 17:00:00	39.87463144	0.07189777
05-Nov-24 18:00:00	39.98326066	0.084429853
05-Nov-24 19:00:00	39.03820152	0.072561876
05-Nov-24 20:00:00	39.92221147	0.076963168
05-Nov-24 21:00:00	39.35845461	0.068844612
05-Nov-24 22:00:00	39.53903344	0.071034621
05-Nov-24 23:00:00	39.56032764	0.072224078
06-Nov-24 00:00:00	39.11877395	0.079270189
06-Nov-24 01:00:00	39.03502996	0.069882024
06-Nov-24 02:00:00	39.52407857	0.068830086
06-Nov-24 03:00:00	39.83926478	0.080357161
06-Nov-24 04:00:00	39.3519357	0.074975221
06-Nov-24 05:00:00	39.53651005	0.069534166
06-Nov-24 06:00:00	38.8129631	0.069036423
06-Nov-24 07:00:00	39.65830462	0.070286008
06-Nov-24 08:00:00	39.46749149	0.080424327
06-Nov-24 09:00:00	39.01653128	0.067464011
06-Nov-24 10:00:00	39.42721373	0.067979201
06-Nov-24 11:00:00	39.14846456	0.081195942
06-Nov-24 12:00:00	39.86620279	0.084814733
06-Nov-24 13:00:00	39.54484927	0.084267526
06-Nov-24 14:00:00	39.18220534	0.07278695
06-Nov-24 15:00:00	39.91289514	0.082046392
06-Nov-24 16:00:00	39.08123413	0.070589275
06-Nov-24 17:00:00	39.81926773	0.074936178
06-Nov-24 18:00:00	39.6176395	0.086467335
06-Nov-24 19:00:00	39.66852861	0.068108103
06-Nov-24 20:00:00	39.80875427	0.07885396
06-Nov-24 21:00:00	39.44934149	0.068464083
06-Nov-24 22:00:00	39.53354356	0.08678095
06-Nov-24 23:00:00	39.71282158	0.07496987
07-Nov-24 00:00:00	39.97565558	0.07346855
07-Nov-24 01:00:00	39.93852458	0.07194832
07-Nov-24 02:00:00	39.50535954	0.073758105
07-Nov-24 03:00:00	39.52069055	0.07566919
07-Nov-24 04:00:00	39.59847705	0.082734908
07-Nov-24 05:00:00	39.50796186	0.074424129
07-Nov-24 06:00:00	39.09367746	0.089866015
07-Nov-24 07:00:00	39.19430954	0.069507766
07-Nov-24 08:00:00	39.51649381	0.079530116
07-Nov-24 09:00:00	39.7447228	0.074260306
07-Nov-24 10:00:00	39.29867465	0.068460348
07-Nov-24 11:00:00	39.02876403	0.071500183
07-Nov-24 12:00:00	39.19132988	0.074783847
07-Nov-24 13:00:00	38.99365832	0.086469326
07-Nov-24 14:00:00	39.52158158	0.0758344
07-Nov-24 15:00:00	39.67072679	0.071178008

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
07-Nov-24 16:00:00	39.26786631	0.076918524
07-Nov-24 17:00:00	39.3578943	0.06784636
07-Nov-24 18:00:00	39.02453592	0.068099173
07-Nov-24 19:00:00	39.50877584	0.07219309
07-Nov-24 20:00:00	39.32821079	0.07886577
07-Nov-24 21:00:00	38.88710397	0.080415571
07-Nov-24 22:00:00	39.20107743	0.07743788
07-Nov-24 23:00:00	39.26620936	0.07072381
08-Nov-24 00:00:00	39.53096995	0.074786536
08-Nov-24 01:00:00	39.15761353	0.075959384
08-Nov-24 02:00:00	39.21857515	0.084675359
08-Nov-24 03:00:00	39.48088666	0.079782408
08-Nov-24 04:00:00	39.64735259	0.08537601
08-Nov-24 05:00:00	39.13003768	0.074108327
08-Nov-24 06:00:00	39.85128528	0.086059169
08-Nov-24 07:00:00	39.15160404	0.075406055
08-Nov-24 08:00:00	38.94941853	0.084484912
08-Nov-24 09:00:00	38.95283454	0.07502347
08-Nov-24 10:00:00	39.05164105	0.085321975
08-Nov-24 11:00:00	39.0544986	0.078655906
08-Nov-24 12:00:00	39.28760149	0.075061658
08-Nov-24 13:00:00	39.12317034	0.075203831
08-Nov-24 14:00:00	39.32260995	0.080334294
08-Nov-24 15:00:00	39.59103074	0.04321239
08-Nov-24 16:00:00	39.94898341	0.08243298
08-Nov-24 17:00:00	39.55654394	0.075505574
08-Nov-24 18:00:00	39.36655849	0.080392965
08-Nov-24 19:00:00	39.94247483	0.080389228
08-Nov-24 20:00:00	39.15702481	0.080315314
08-Nov-24 21:00:00	39.42087895	0.080128818
08-Nov-24 22:00:00	39.73226502	0.080153828
08-Nov-24 23:00:00	39.21750293	0.080144021
09-Nov-24 00:00:00	39.91793198	0.080122884
09-Nov-24 01:00:00	39.94637343	0.08021715
09-Nov-24 02:00:00	38.9089983	0.079974196
09-Nov-24 03:00:00	39.54325016	0.08008467
09-Nov-24 04:00:00	38.81559052	0.080100504
09-Nov-24 05:00:00	39.51948436	0.080151367
09-Nov-24 06:00:00	39.87273079	0.079814913
09-Nov-24 07:00:00	39.95802317	0.080151819
09-Nov-24 08:00:00	39.27007274	0.080336933
09-Nov-24 09:00:00	39.68140633	0.080415001
09-Nov-24 10:00:00	39.83354596	0.080621338
09-Nov-24 11:00:00	39.98273399	0.080630578
09-Nov-24 12:00:00	39.34811086	0.080843014
09-Nov-24 13:00:00	38.97915674	0.08020041
09-Nov-24 14:00:00	39.05761442	0.080690995
09-Nov-24 15:00:00	39.73952849	0.080816763
09-Nov-24 16:00:00	39.9541157	0.080552873
09-Nov-24 17:00:00	39.84643354	0.080714925
09-Nov-24 18:00:00	39.81068927	0.08044671

Start Time	7/1/24 1:00 AM
End Time	3/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	3/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2001A			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
09-Nov-24 19:00:00	39.4226592	0.08051317	
09-Nov-24 20:00:00	39.12544645	0.080472668	
09-Nov-24 21:00:00	39.63832338	0.080538074	
09-Nov-24 22:00:00	39.12594484	0.080407658	
09-Nov-24 23:00:00	39.37203335	0.080309098	
10-Nov-24 00:00:00	39.92264083	0.08034668	
10-Nov-24 01:00:00	39.2790525	0.080135939	
10-Nov-24 02:00:00	39.91023549	0.080184428	
10-Nov-24 03:00:00	39.39427695	0.080279541	
10-Nov-24 04:00:00	39.90641795	0.080142687	
10-Nov-24 05:00:00	39.18463792	0.080088495	
10-Nov-24 06:00:00	39.28491672	0.080152497	
10-Nov-24 07:00:00	39.96546633	0.079948821	
10-Nov-24 08:00:00	39.95516258	0.080271064	
10-Nov-24 09:00:00	39.62845101	0.08048723	
10-Nov-24 10:00:00	39.02731675	0.080703805	
10-Nov-24 11:00:00	39.4633323	0.080650754	
10-Nov-24 12:00:00	39.41068595	0.080598026	
10-Nov-24 13:00:00	39.14293708	0.080670759	
10-Nov-24 14:00:00	39.98266865	0.080656687	
10-Nov-24 15:00:00	39.84331388	0.080698636	
10-Nov-24 16:00:00	35.3349256	0.080692882	
10-Nov-24 17:00:00	34.13437048	0.080716621	
10-Nov-24 18:00:00	33.42340671	0.080684068	
10-Nov-24 19:00:00	33.78689845	0.080470785	
10-Nov-24 20:00:00	34.33964726	0.080549452	
10-Nov-24 21:00:00	35.02880653	0.080533854	
10-Nov-24 22:00:00	34.59650651	0.080532634	
10-Nov-24 23:00:00	34.20864348	0.080426116	
11-Nov-24 00:00:00	34.03846266	0.080426138	
11-Nov-24 01:00:00	32.70760814	0.080451909	
11-Nov-24 02:00:00	33.11873248	0.080552391	
11-Nov-24 03:00:00	32.76125337	0.080531142	
11-Nov-24 04:00:00	31.54081375	0.080527553	
11-Nov-24 05:00:00	30.99823097	0.08019477	
11-Nov-24 06:00:00	30.47608752	0.080191379	
11-Nov-24 07:00:00	29.98308594	0.080267673	
11-Nov-24 08:00:00	30.74193856	0.080333455	
11-Nov-24 09:00:00	31.42166521	0.080211197	
11-Nov-24 10:00:00	33.4340972	0.080477642	
11-Nov-24 11:00:00	36.39348793	0.080641796	
11-Nov-24 12:00:00	37.4634477	0.080829536	
11-Nov-24 13:00:00	39.19232015	0.080756972	
11-Nov-24 14:00:00	37.38516308	0.080670279	
11-Nov-24 15:00:00	35.46670416	0.08076737	
11-Nov-24 16:00:00	35.26554888	0.08079639	
11-Nov-24 17:00:00	33.97456566	0.080652449	
11-Nov-24 18:00:00	33.42850446	0.080573188	
11-Nov-24 19:00:00	33.90755438	0.080451626	
11-Nov-24 20:00:00	34.21157083	0.080409919	
11-Nov-24 21:00:00	34.12492285	0.080438571	

3HYB-CHRC-TT-2001A1			3HYB-CHRC-AT-1A1
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
11-Nov-24 22:00:00	34.89539245	0.080399238	
11-Nov-24 23:00:00	34.36037339	0.080484433	
12-Nov-24 00:00:00	34.77053648	0.080328284	
12-Nov-24 01:00:00	35.01123907	0.080309098	
12-Nov-24 02:00:00	34.51452086	0.080377197	
12-Nov-24 03:00:00	34.2846825	0.080225287	
12-Nov-24 04:00:00	33.13719023	0.080231052	
12-Nov-24 05:00:00	33.7264017	0.080271403	
12-Nov-24 06:00:00	33.17641168	0.080142551	
12-Nov-24 07:00:00	32.78110849	0.080404324	
12-Nov-24 08:00:00	33.38806644	0.080822016	
12-Nov-24 09:00:00	34.49358323	0.080737305	
12-Nov-24 10:00:00	35.30256603	0.080836487	
12-Nov-24 11:00:00	36.37285095	0.080959913	
12-Nov-24 12:00:00	36.43699307	0.080946859	
12-Nov-24 13:00:00	36.68779688	0.080837674	
12-Nov-24 14:00:00	36.51201624	0.08066135	
12-Nov-24 15:00:00	36.45365675	0.080503676	
12-Nov-24 16:00:00	31.79957002	0.080655585	
12-Nov-24 17:00:00	33.57372626	0.080630493	
12-Nov-24 18:00:00	34.5476021	0.080551148	
12-Nov-24 19:00:00	35.52572294	0.080576147	
12-Nov-24 20:00:00	36.23391428	0.080542331	
12-Nov-24 21:00:00	36.30287355	0.080432977	
12-Nov-24 22:00:00	36.810191	0.080459764	
12-Nov-24 23:00:00	36.1427958	0.080361589	
13-Nov-24 00:00:00	36.21225188	0.08029107	
13-Nov-24 01:00:00	35.68660638	0.080320062	
13-Nov-24 02:00:00	35.39511232	0.080134244	
13-Nov-24 03:00:00	34.27797584	0.080229686	
13-Nov-24 04:00:00	35.45632158	0.080258874	
13-Nov-24 05:00:00	35.02079257	0.080283949	
13-Nov-24 06:00:00	34.8826238	0.080340915	
13-Nov-24 07:00:00	34.94324653	0.080319553	
13-Nov-24 08:00:00	34.94486662	0.080483331	
13-Nov-24 09:00:00	35.90507469	0.080662706	
13-Nov-24 10:00:00	36.08032208	0.080690172	
13-Nov-24 11:00:00	36.90034003	0.080680089	
13-Nov-24 12:00:00	37.44081866	0.0807095	
13-Nov-24 13:00:00	37.57233962	0.080728149	
13-Nov-24 14:00:00	37.36461948	0.080543349	
13-Nov-24 15:00:00	36.15881633	0.080510231	
13-Nov-24 16:00:00	35.66721037	0.080556799	
13-Nov-24 17:00:00	35.24574368	0.080518256	
13-Nov-24 18:00:00	34.04838662	0.080318875	
13-Nov-24 19:00:00	34.76112238	0.080258179	
13-Nov-24 20:00:00	34.70718545	0.080242242	
13-Nov-24 21:00:00	33.70566008	0.08041314	
13-Nov-24 22:00:00	34.61252647	0.08038626	
13-Nov-24 23:00:00	34.9374196	0.080403739	
14-Nov-24 00:00:00	34.77679202	0.0803243	



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2001AJ	3HYB-CHRC-AT-1AJ
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
14-Nov-24 01:00:00	33.88312573	0.0801395
14-Nov-24 02:00:00	34.72277326	0.075907566
14-Nov-24 03:00:00	34.5096316	0.080392027
14-Nov-24 04:00:00	34.7441575	0.080194431
14-Nov-24 05:00:00	33.86400586	0.08013398
14-Nov-24 06:00:00	33.94326376	0.080223447
14-Nov-24 07:00:00	34.20208186	0.080286607
14-Nov-24 08:00:00	33.86397447	0.080252855
14-Nov-24 09:00:00	34.00470534	0.080294461
14-Nov-24 10:00:00	34.33417877	0.080302595
14-Nov-24 11:00:00	34.59771024	0.080445692
14-Nov-24 12:00:00	35.94682437	0.080783759
14-Nov-24 13:00:00	37.37657297	0.080651855
14-Nov-24 14:00:00	36.95595904	0.080665792
14-Nov-24 15:00:00	36.18135682	0.080525513
14-Nov-24 16:00:00	36.26612158	0.080531248
14-Nov-24 17:00:00	35.51057764	0.080381533
14-Nov-24 18:00:00	34.96437161	0.080378078
14-Nov-24 19:00:00	36.05376607	0.080320841
14-Nov-24 20:00:00	36.9989043	0.080302037
14-Nov-24 21:00:00	34.98856622	0.080217634
14-Nov-24 22:00:00	35.0335955	0.080114504
14-Nov-24 23:00:00	34.7951193	0.080168723
15-Nov-24 00:00:00	34.19983295	0.080131022
15-Nov-24 01:00:00	33.39904942	0.080067956
15-Nov-24 02:00:00	33.08137133	0.080207855
15-Nov-24 03:00:00	33.21159303	0.080190382
15-Nov-24 04:00:00	32.17826860	0.080070436
15-Nov-24 05:00:00	32.3048066	0.08011565
15-Nov-24 06:00:00	31.75418492	0.080051507
15-Nov-24 07:00:00	32.33085705	0.080054559
15-Nov-24 08:00:00	33.26064596	0.080254449
15-Nov-24 09:00:00	34.545643	0.080552996
15-Nov-24 10:00:00	35.53790312	0.080586636
15-Nov-24 11:00:00	35.96124955	0.080736513
15-Nov-24 12:00:00	37.16147312	0.080799301
15-Nov-24 13:00:00	36.32684069	0.080827671
15-Nov-24 14:00:00	35.90565217	0.080806476
15-Nov-24 15:00:00	34.71582944	0.080703386
15-Nov-24 16:00:00	35.27405924	0.080839303
15-Nov-24 17:00:00	34.72190148	0.080653589
15-Nov-24 18:00:00	33.87740068	0.080553295
15-Nov-24 19:00:00	34.65703411	0.0803859
15-Nov-24 20:00:00	35.04576265	0.0803984318
15-Nov-24 21:00:00	34.32242205	0.080347171
15-Nov-24 22:00:00	34.98329073	0.080295704
15-Nov-24 23:00:00	35.20849115	0.080189345
16-Nov-24 00:00:00	36.05791098	0.080323622
16-Nov-24 01:00:00	35.20659272	0.08034666
16-Nov-24 02:00:00	36.17257519	0.080293326
16-Nov-24 03:00:00	35.5511865	0.080259739

3HYB-CHRC-TT-2001AJ	3HYB-CHRC-AT-1AJ
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
16-Nov-24 04:00:00	35.36811514	0.080162363
16-Nov-24 05:00:00	34.84485972	0.080000865
16-Nov-24 06:00:00	34.54518214	0.080505659
16-Nov-24 07:00:00	34.80955622	0.080108304
16-Nov-24 08:00:00	35.35355518	0.08034729
16-Nov-24 09:00:00	36.52690033	0.080569845
16-Nov-24 10:00:00	36.981778361	0.080563988
16-Nov-24 11:00:00	38.45239166	0.080754579
16-Nov-24 12:00:00	37.66510566	0.08033815
16-Nov-24 13:00:00	37.62266739	0.08087228
16-Nov-24 14:00:00	36.23930649	0.080793254
16-Nov-24 15:00:00	35.58984617	0.080796034
16-Nov-24 16:00:00	34.97582425	0.080687052
16-Nov-24 17:00:00	34.69921618	0.08075392
16-Nov-24 18:00:00	34.31796557	0.080565673
16-Nov-24 19:00:00	34.2655443	0.080448236
16-Nov-24 20:00:00	34.12870082	0.080351112
16-Nov-24 21:00:00	34.5023439	0.080381379
16-Nov-24 22:00:00	35.44764891	0.080372676
16-Nov-24 23:00:00	34.59638566	0.080254788
17-Nov-24 00:00:00	35.46342162	0.080335151
17-Nov-24 01:00:00	35.00346431	0.080248006
17-Nov-24 02:00:00	36.52118936	0.080227152
17-Nov-24 03:00:00	36.20587392	0.080275981
17-Nov-24 04:00:00	37.05819965	0.080305118
17-Nov-24 05:00:00	36.6317442	0.080284573
17-Nov-24 06:00:00	37.17153632	0.080381395
17-Nov-24 07:00:00	36.75987997	0.080300264
17-Nov-24 08:00:00	39.47493939	0.080562422
17-Nov-24 09:00:00	39.36460129	0.080777895
17-Nov-24 10:00:00	39.66227059	0.080841404
17-Nov-24 11:00:00	39.0341489	0.081051297
17-Nov-24 12:00:00	39.56914007	0.080698221
17-Nov-24 13:00:00	39.7875355	0.080856019
17-Nov-24 14:00:00	39.35192401	0.080740865
17-Nov-24 15:00:00	39.18195839	0.080892775
17-Nov-24 16:00:00	37.51891566	0.080808173
17-Nov-24 17:00:00	35.74141627	0.080589634
17-Nov-24 18:00:00	34.26499863	0.080205112
17-Nov-24 19:00:00	35.22879901	0.080019192
17-Nov-24 20:00:00	34.90175669	0.080090663
17-Nov-24 21:00:00	35.44377877	0.080117459
17-Nov-24 22:00:00	36.0583014	0.080059079
17-Nov-24 23:00:00	35.89780252	0.080131361
18-Nov-24 00:00:00	35.43674968	0.080160322
18-Nov-24 01:00:00	33.962806	0.080064222
18-Nov-24 02:00:00	34.2899684	0.080144472
18-Nov-24 03:00:00	33.84430568	0.080285644
18-Nov-24 04:00:00	35.7373127	0.080280197
18-Nov-24 05:00:00	33.67041788	0.080061646
18-Nov-24 06:00:00	33.5431011	0.079939213

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYBCHRC-TT-2001AI		3HYBCHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
18-Nov-24 07:00:00	33.33227857	0.079572218	
18-Nov-24 08:00:00	33.08632923	0.079784476	
18-Nov-24 09:00:00	33.67704271	0.080084062	
18-Nov-24 10:00:00	37.22955508	0.080260891	
18-Nov-24 11:00:00	39.612137	0.080564033	
18-Nov-24 12:00:00	36.31351967	0.080571266	
18-Nov-24 13:00:00	36.45765372	0.080605457	
18-Nov-24 14:00:00	36.42299843	0.080508253	
18-Nov-24 15:00:00	35.81457422	0.080446709	
18-Nov-24 16:00:00	34.91705984	0.080461966	
18-Nov-24 17:00:00	34.86508774	0.080265074	
18-Nov-24 18:00:00	35.10205355	0.080294212	
18-Nov-24 19:00:00	33.95174266	0.080136414	
18-Nov-24 20:00:00	33.07975743	0.080020905	
18-Nov-24 21:00:00	33.28965991	0.080034129	
18-Nov-24 22:00:00	33.4966076	0.080048557	
18-Nov-24 23:00:00	33.04060647	0.079988335	
19-Nov-24 00:00:00	33.30456739	0.079963988	
19-Nov-24 01:00:00	33.3317935	0.079903263	
19-Nov-24 02:00:00	33.28091013	0.079960297	
19-Nov-24 03:00:00	32.71690788	0.079905727	
19-Nov-24 04:00:00	32.33202794	0.079684561	
19-Nov-24 05:00:00	32.17312271	0.079628564	
19-Nov-24 06:00:00	31.91665821	0.079572947	
19-Nov-24 07:00:00	31.7795192	0.07974571	
19-Nov-24 08:00:00	31.7651134	0.079847987	
19-Nov-24 09:00:00	32.51713968	0.07999013	
19-Nov-24 10:00:00	33.77988109	0.080310669	
19-Nov-24 11:00:00	34.24043868	0.08043457	
19-Nov-24 12:00:00	34.56482774	0.080556856	
19-Nov-24 13:00:00	34.54245643	0.080582739	
19-Nov-24 14:00:00	33.56537636	0.08059845	
19-Nov-24 15:00:00	33.76761786	0.08060218	
19-Nov-24 16:00:00	33.75817352	0.080528565	
19-Nov-24 17:00:00	33.54772269	0.080240071	
19-Nov-24 18:00:00	32.8054629	0.080273505	
19-Nov-24 19:00:00	32.79406437	0.080116713	
19-Nov-24 20:00:00	32.60395418	0.079999118	
19-Nov-24 21:00:00	32.38731602	0.080046829	
19-Nov-24 22:00:00	31.9556743	0.079970974	
19-Nov-24 23:00:00	33.49215827	0.079908244	
20-Nov-24 00:00:00	39.70454535	0.079950799	
20-Nov-24 01:00:00	39.72818255	0.079907536	
20-Nov-24 02:00:00	39.16652628	0.079877216	
20-Nov-24 03:00:00	39.46478536	0.079786513	
20-Nov-24 04:00:00	39.26541193	0.079690891	
20-Nov-24 05:00:00	39.50025554	0.079693349	
20-Nov-24 06:00:00	38.88783926	0.079510752	
20-Nov-24 07:00:00	39.43763822	0.079542711	
20-Nov-24 08:00:00	37.33639463	0.079842461	
20-Nov-24 09:00:00	39.24657091	0.079931302	

3HYBCHRC-TT-2001AI		3HYBCHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
20-Nov-24 10:00:00	39.35990393	0.08012424	
20-Nov-24 11:00:00	39.92807308	0.080241394	
20-Nov-24 12:00:00	39.86633249	0.080256697	
20-Nov-24 13:00:00	39.80652756	0.080358887	
20-Nov-24 14:00:00	39.01419332	0.080511407	
20-Nov-24 15:00:00	39.8020548	0.080450847	
20-Nov-24 16:00:00	39.33542546	0.080422285	
20-Nov-24 17:00:00	35.79918333	0.080348714	
20-Nov-24 18:00:00	34.56188814	0.08009847	
20-Nov-24 19:00:00	32.84298792	0.080217404	
20-Nov-24 20:00:00	32.56662866	0.080065579	
20-Nov-24 21:00:00	33.08846365	0.079887984	
20-Nov-24 22:00:00	32.57971916	0.079866537	
20-Nov-24 23:00:00	32.65188408	0.079791599	
21-Nov-24 00:00:00	32.1941225	0.079791599	
21-Nov-24 01:00:00	32.02885291	0.07962076	
21-Nov-24 02:00:00	31.27652679	0.07966148	
21-Nov-24 03:00:00	30.75360211	0.079761971	
21-Nov-24 04:00:00	30.28061808	0.079725605	
21-Nov-24 05:00:00	30.50755867	0.07972819	
21-Nov-24 06:00:00	29.88358951	0.079641385	
21-Nov-24 07:00:00	30.08069352	0.079739549	
21-Nov-24 08:00:00	30.42847892	0.0797978734	
21-Nov-24 09:00:00	31.66468248	0.080070665	
21-Nov-24 10:00:00	32.38771795	0.080127002	
21-Nov-24 11:00:00	33.06240587	0.080311536	
21-Nov-24 12:00:00	33.52757398	0.080435011	
21-Nov-24 13:00:00	33.14155198	0.080386675	
21-Nov-24 14:00:00	33.10998788	0.080443319	
21-Nov-24 15:00:00	32.63708302	0.080578613	
21-Nov-24 16:00:00	31.94254359	0.08038477	
21-Nov-24 17:00:00	31.93630234	0.08036498	
21-Nov-24 18:00:00	31.4953078	0.080306555	
21-Nov-24 19:00:00	38.8829314	0.080278524	
21-Nov-24 20:00:00	39.95159241	0.080191379	
21-Nov-24 21:00:00	39.5771962	0.080083211	
21-Nov-24 22:00:00	33.16499956	0.07998725	
21-Nov-24 23:00:00	31.8348993	0.079973009	
22-Nov-24 00:00:00	31.46372468	0.079786338	
22-Nov-24 01:00:00	31.71043424	0.07982336	
22-Nov-24 02:00:00	31.34310753	0.079735311	
22-Nov-24 03:00:00	31.19174438	0.079625109	
22-Nov-24 04:00:00	31.10013733	0.079734633	
22-Nov-24 05:00:00	30.83449738	0.079724799	
22-Nov-24 06:00:00	30.31465957	0.079505059	
22-Nov-24 07:00:00	29.75611966	0.079684087	
22-Nov-24 08:00:00	29.9769972	0.079908718	
22-Nov-24 09:00:00	30.12671278	0.080048964	
22-Nov-24 10:00:00	31.74274336	0.080115085	
22-Nov-24 11:00:00	34.95650917	0.080395169	
22-Nov-24 12:00:00	34.49658994	0.08058743	



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name PI	
Time Interval	1h

3HYB-CHRC-TT-2001AJ	3HYB-CHRC-AT-1AJ
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
22-Nov-24 13:00:00	34.3500701	0.08049486
22-Nov-24 14:00:00	32.9115405	0.080535657
22-Nov-24 15:00:00	33.34517038	0.080468496
22-Nov-24 16:00:00	32.18914742	0.080357332
22-Nov-24 17:00:00	31.58976086	0.080247586
22-Nov-24 18:00:00	31.15232551	0.080278718
22-Nov-24 19:00:00	33.19444018	0.080014038
22-Nov-24 20:00:00	36.25685898	0.079955888
22-Nov-24 21:00:00	33.68976373	0.079842801
22-Nov-24 22:00:00	32.30522547	0.079801941
22-Nov-24 23:00:00	31.1223875	0.079719544
23-Nov-24 00:00:00	30.89564811	0.079813046
23-Nov-24 01:00:00	30.43089884	0.079739702
23-Nov-24 02:00:00	31.152322	0.079648184
23-Nov-24 03:00:00	31.20726555	0.079813215
23-Nov-24 04:00:00	30.689083	0.079708184
23-Nov-24 05:00:00	29.98272436	0.079681057
23-Nov-24 06:00:00	29.50542786	0.07956526
23-Nov-24 07:00:00	29.04388806	0.079572817
23-Nov-24 08:00:00	29.31574858	0.079732953
23-Nov-24 09:00:00	31.61971219	0.07985772
23-Nov-24 10:00:00	38.59274593	0.080135091
23-Nov-24 11:00:00	39.2516421	0.080323848
23-Nov-24 12:00:00	39.59462041	0.080496668
23-Nov-24 13:00:00	38.944539	0.080437215
23-Nov-24 14:00:00	39.19569887	0.080411106
23-Nov-24 15:00:00	39.83035702	0.080246024
23-Nov-24 16:00:00	39.75170343	0.080207486
23-Nov-24 17:00:00	39.36509141	0.08010674
23-Nov-24 18:00:00	39.15119634	0.080132209
23-Nov-24 19:00:00	39.08452614	0.08006281
23-Nov-24 20:00:00	39.02151528	0.079976965
23-Nov-24 21:00:00	39.40180721	0.079884395
23-Nov-24 22:00:00	39.32466167	0.07989355
23-Nov-24 23:00:00	39.54827261	0.07975656
24-Nov-24 00:00:00	39.21507526	0.07973452
24-Nov-24 01:00:00	39.45226882	0.079828672
24-Nov-24 02:00:00	39.43752372	0.079765505
24-Nov-24 03:00:00	39.83779367	0.079860942
24-Nov-24 04:00:00	39.97117211	0.079822455
24-Nov-24 05:00:00	39.04922138	0.079737176
24-Nov-24 06:00:00	39.32814251	0.079579871
24-Nov-24 07:00:00	39.57518713	0.079553901
24-Nov-24 08:00:00	39.31413105	0.079741753
24-Nov-24 09:00:00	39.62867861	0.079877769
24-Nov-24 10:00:00	39.80441585	0.080211878
24-Nov-24 11:00:00	39.49469886	0.080244954
24-Nov-24 12:00:00	39.17089741	0.080418227
24-Nov-24 13:00:00	39.6375298	0.080463246
24-Nov-24 14:00:00	39.71180904	0.080497657
24-Nov-24 15:00:00	39.71722844	0.080315586

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name PI	
Time Interval	1h

3HYB-CHRC-TT-2001AJ	3HYB-CHRC-AT-1AJ
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
24-Nov-24 16:00:00	39.21273643	0.080121076
24-Nov-24 17:00:00	39.321155027	0.080232059
24-Nov-24 18:00:00	39.35000106	0.079850463
24-Nov-24 19:00:00	39.85467816	0.08063205
24-Nov-24 20:00:00	39.42821827	0.080007014
24-Nov-24 21:00:00	39.53150347	0.079926034
24-Nov-24 22:00:00	39.82954411	0.079809348
24-Nov-24 23:00:00	39.55562575	0.079890272
25-Nov-24 00:00:00	39.51735581	0.079958089
25-Nov-24 01:00:00	39.25508925	0.079970409
25-Nov-24 02:00:00	39.77664319	0.080023419
25-Nov-24 03:00:00	39.10481885	0.080005222
25-Nov-24 04:00:00	39.13591228	0.080012795
25-Nov-24 05:00:00	37.73048133	0.079870153
25-Nov-24 06:00:00	37.1803561	0.079740397
25-Nov-24 07:00:00	36.60601985	0.079805332
25-Nov-24 08:00:00	37.0543745	0.080458747
25-Nov-24 09:00:00	38.53356571	0.080643265
25-Nov-24 10:00:00	39.39089239	0.080605891
25-Nov-24 11:00:00	38.86141003	0.080854658
25-Nov-24 12:00:00	39.71709319	0.081105228
25-Nov-24 13:00:00	38.86379888	0.081038006
25-Nov-24 14:00:00	39.38119837	0.08094636
25-Nov-24 15:00:00	39.46239718	0.080955336
25-Nov-24 16:00:00	39.13887416	0.081025856
25-Nov-24 17:00:00	39.07092841	0.080959405
25-Nov-24 18:00:00	39.48815558	0.08075765
25-Nov-24 19:00:00	39.11337172	0.08075002
25-Nov-24 20:00:00	39.23898536	0.080718146
25-Nov-24 21:00:00	39.18075466	0.080566915
25-Nov-24 22:00:00	39.2672091	0.080636088
25-Nov-24 23:00:00	39.27588682	0.080561659
26-Nov-24 00:00:00	39.35879563	0.080528893
26-Nov-24 01:00:00	39.42758326	0.080624701
26-Nov-24 02:00:00	38.2460995	0.080434276
26-Nov-24 03:00:00	37.30788325	0.080621338
26-Nov-24 04:00:00	37.22564989	0.080593024
26-Nov-24 05:00:00	37.25481663	0.080274421
26-Nov-24 06:00:00	36.57872881	0.079864966
26-Nov-24 07:00:00	36.90858531	0.079802704
26-Nov-24 08:00:00	36.88328716	0.08000055
26-Nov-24 09:00:00	37.2433055	0.080288357
26-Nov-24 10:00:00	37.48673224	0.080473556
26-Nov-24 11:00:00	37.96345192	0.080580887
26-Nov-24 12:00:00	38.82904435	0.080599411
26-Nov-24 13:00:00	38.89378168	0.080777882
26-Nov-24 14:00:00	38.51424548	0.080684071
26-Nov-24 15:00:00	37.70543025	0.080534702
26-Nov-24 16:00:00	36.65712764	0.080683384
26-Nov-24 17:00:00	35.38156513	0.080480787
26-Nov-24 18:00:00	36.61848093	0.080228865

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYBCHRC-TT-2001AI		3HYBCHRC-AT-1AI
Date/Time	Temperature et 600 mètres canal (C°)	Chlorine online et 500 m. canal (mg/l)
26-Nov-24 19:00:00	35.9575498	0.079884199
26-Nov-24 20:00:00	36.44768974	0.079897423
26-Nov-24 21:00:00	36.09439207	0.079929267
26-Nov-24 22:00:00	35.37548167	0.0799589785
26-Nov-24 23:00:00	35.23891414	0.079902479
27-Nov-24 00:00:00	35.30453488	0.079990641
27-Nov-24 01:00:00	34.93167287	0.079916721
27-Nov-24 02:00:00	34.60114215	0.079892985
27-Nov-24 03:00:00	34.9789973	0.079723104
27-Nov-24 04:00:00	34.10378159	0.079759047
27-Nov-24 05:00:00	34.10071091	0.079757182
27-Nov-24 06:00:00	33.97911408	0.079582892
27-Nov-24 07:00:00	33.55127684	0.079610867
27-Nov-24 08:00:00	33.50283118	0.079921977
27-Nov-24 09:00:00	33.94911101	0.080088978
27-Nov-24 10:00:00	35.19983426	0.080236071
27-Nov-24 11:00:00	36.44148934	0.080475786
27-Nov-24 12:00:00	36.47967372	0.080360472
27-Nov-24 13:00:00	36.3182288	0.080681356
27-Nov-24 14:00:00	36.41128501	0.080560991
27-Nov-24 15:00:00	36.32140786	0.080632189
27-Nov-24 16:00:00	35.68603436	0.080277111
27-Nov-24 17:00:00	35.37514053	0.080107795
27-Nov-24 18:00:00	33.42865419	0.08039734
27-Nov-24 19:00:00	32.54537773	0.08012198
27-Nov-24 20:00:00	31.64394302	0.079666114
27-Nov-24 21:00:00	31.28828326	0.079902819
27-Nov-24 22:00:00	31.02327579	0.079885186
27-Nov-24 23:00:00	30.91957907	0.079801771
28-Nov-24 00:00:00	30.76527475	0.079938988
28-Nov-24 01:00:00	31.07528808	0.079801771
28-Nov-24 02:00:00	30.70758479	0.079727343
28-Nov-24 03:00:00	29.91773734	0.079681566
28-Nov-24 04:00:00	29.52997077	0.079518975
28-Nov-24 05:00:00	29.30576378	0.079528809
28-Nov-24 06:00:00	28.80337843	0.079433639
28-Nov-24 07:00:00	28.73499243	0.079535816
28-Nov-24 08:00:00	29.24255284	0.079722087
28-Nov-24 09:00:00	30.00307006	0.079886542
28-Nov-24 10:00:00	32.48736085	0.08011339
28-Nov-24 11:00:00	34.29284954	0.080298197
28-Nov-24 12:00:00	34.50592079	0.08049113
28-Nov-24 13:00:00	34.58153231	0.080476889
28-Nov-24 14:00:00	34.82846024	0.080523117
28-Nov-24 15:00:00	34.40140863	0.080525377
28-Nov-24 16:00:00	33.35508233	0.080451467
28-Nov-24 17:00:00	33.02372845	0.080327013
28-Nov-24 18:00:00	32.5719939	0.080127031
28-Nov-24 19:00:00	31.7862334	0.080027262
28-Nov-24 20:00:00	31.51053938	0.080010987
28-Nov-24 21:00:00	31.38211343	0.079944526

3HYBCHRC-TT-2001AI		3HYBCHRC-AT-1AI
Date/Time	Temperature et 600 mètres canal (C°)	Chlorine online et 500 m. canal (mg/l)
28-Nov-24 22:00:00	31.10520062	0.079946754
28-Nov-24 23:00:00	30.77342603	0.079754106
29-Nov-24 00:00:00	30.1240339	0.079572211
29-Nov-24 01:00:00	29.91460223	0.079781426
29-Nov-24 02:00:00	29.66375131	0.079466417
29-Nov-24 03:00:00	29.88560229	0.079456329
29-Nov-24 04:00:00	29.92211145	0.079298712
29-Nov-24 05:00:00	29.91885615	0.079188189
29-Nov-24 06:00:00	29.83717636	0.07911343
29-Nov-24 07:00:00	29.28967848	0.079112413
29-Nov-24 08:00:00	29.18823295	0.079388767
29-Nov-24 09:00:00	30.08211013	0.079687161
29-Nov-24 10:00:00	31.52640228	0.079796516
29-Nov-24 11:00:00	32.83143477	0.079569902
29-Nov-24 12:00:00	34.24682128	0.080130344
29-Nov-24 13:00:00	35.33871103	0.080233428
29-Nov-24 14:00:00	35.48086539	0.080216438
29-Nov-24 15:00:00	35.3112762	0.080297207
29-Nov-24 16:00:00	35.48972111	0.080274879
29-Nov-24 17:00:00	35.88014434	0.08022249
29-Nov-24 18:00:00	35.98476565	0.07960802
29-Nov-24 19:00:00	35.61038128	0.079768626
29-Nov-24 20:00:00	36.13009916	0.079549747
29-Nov-24 21:00:00	35.96058782	0.079617649
29-Nov-24 22:00:00	35.98731837	0.079482015
30-Nov-24 00:00:00	35.0231745	0.079217303
30-Nov-24 01:00:00	35.11923425	0.079236744
30-Nov-24 02:00:00	34.68283981	0.079171753
30-Nov-24 03:00:00	34.34831189	0.079190403
30-Nov-24 04:00:00	34.64152351	0.078953044
30-Nov-24 05:00:00	35.61890497	0.078938972
30-Nov-24 06:00:00	35.6436154	0.078643669
30-Nov-24 07:00:00	35.24545501	0.078607915
30-Nov-24 08:00:00	34.87834421	0.07898051
30-Nov-24 09:00:00	34.97148202	0.079280203
30-Nov-24 10:00:00	35.59004665	0.079488175
30-Nov-24 11:00:00	37.02704845	0.079904853
30-Nov-24 12:00:00	37.85089266	0.08008952
30-Nov-24 13:00:00	37.86740551	0.080227074
30-Nov-24 14:00:00	36.14324912	0.080138009
30-Nov-24 15:00:00	38.1191941	0.08008728
30-Nov-24 16:00:00	37.00403542	0.080334925
30-Nov-24 17:00:00	36.42807302	0.0802011
30-Nov-24 18:00:00	36.8420967	0.079941135
30-Nov-24 19:00:00	36.93945482	0.07986399
30-Nov-24 20:00:00	37.42991849	0.079957524
30-Nov-24 21:00:00	38.11066003	0.079784365
30-Nov-24 22:00:00	37.97905228	0.07957289
30-Nov-24 23:00:00	38.59358682	0.079406738
01-Dec-24 00:00:00	39.50502141	0.079400635



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2001(A)	3HYB-CHRC-AT-1(A)
----------------------	-------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
01-Dec-24 01:00:00	39.48264615	0.079289475
01-Dec-24 02:00:00	39.86154719	0.079298005
01-Dec-24 03:00:00	39.78945004	0.079242621
01-Dec-24 04:00:00	38.99185139	0.079207781
01-Dec-24 05:00:00	39.86732006	0.079079776
01-Dec-24 06:00:00	38.98458176	0.079097663
01-Dec-24 07:00:00	39.60910024	0.079118955
01-Dec-24 08:00:00	39.16052577	0.079465061
01-Dec-24 09:00:00	39.54316707	0.079678694
01-Dec-24 10:00:00	39.12620315	0.080007935
01-Dec-24 11:00:00	39.77230761	0.08015035
01-Dec-24 12:00:00	39.87366868	0.080212854
01-Dec-24 13:00:00	39.980989139	0.080344871
01-Dec-24 14:00:00	38.91091207	0.080461896
01-Dec-24 15:00:00	39.77778956	0.080109959
01-Dec-24 16:00:00	39.88662331	0.080266995
01-Dec-24 17:00:00	39.17419566	0.080117976
01-Dec-24 18:00:00	39.84769834	0.080052524
01-Dec-24 19:00:00	39.95407757	0.07987747
01-Dec-24 20:00:00	39.40857143	0.079657381
01-Dec-24 21:00:00	39.56629889	0.07968732
01-Dec-24 22:00:00	39.18512246	0.079730903
01-Dec-24 23:00:00	38.92299258	0.080189345
02-Dec-24 00:00:00	39.17404132	0.080218845
02-Dec-24 01:00:00	39.23499145	0.080234782
02-Dec-24 02:00:00	39.07893557	0.079632184
02-Dec-24 03:00:00	39.60809445	0.079323239
02-Dec-24 04:00:00	39.43846646	0.079245504
02-Dec-24 05:00:00	38.797114069	0.079167894
02-Dec-24 06:00:00	35.596617	0.079292467
02-Dec-24 07:00:00	38.28789952	0.079407755
02-Dec-24 08:00:00	39.68242937	0.079651557
02-Dec-24 09:00:00	39.59527201	0.080001831
02-Dec-24 10:00:00	39.49467108	0.080298256
02-Dec-24 11:00:00	39.5205328	0.08027823
02-Dec-24 12:00:00	39.1633881	0.08015278
02-Dec-24 13:00:00	39.54036739	0.080154928
02-Dec-24 14:00:00	39.86426215	0.080174594
02-Dec-24 15:00:00	38.95305368	0.080250549
02-Dec-24 16:00:00	39.15523557	0.080084566
02-Dec-24 17:00:00	39.29769974	0.080183962
02-Dec-24 18:00:00	39.15182594	0.080178919
02-Dec-24 19:00:00	39.65621808	0.079591321
02-Dec-24 20:00:00	39.2698609	0.079474046
02-Dec-24 21:00:00	38.88526088	0.079547119
02-Dec-24 22:00:00	39.13956801	0.079479592
02-Dec-24 23:00:00	39.41869232	0.079629452
03-Dec-24 00:00:00	39.00261693	0.079384472
03-Dec-24 01:00:00	39.8396403	0.07928894
03-Dec-24 02:00:00	38.94125468	0.079422641
03-Dec-24 03:00:00	39.73510293	0.079475742

3HYB-CHRC-TT-2001(A)	3HYB-CHRC-AT-1(A)
----------------------	-------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
03-Dec-24 04:00:00	39.90326891	0.079449602
03-Dec-24 05:00:00	39.43276094	0.07922338
03-Dec-24 06:00:00	39.14286538	0.079325227
03-Dec-24 07:00:00	39.91655974	0.079229601
03-Dec-24 08:00:00	39.81402344	0.079495748
03-Dec-24 09:00:00	39.50882469	0.0796207
03-Dec-24 10:00:00	39.14827224	0.079945882
03-Dec-24 11:00:00	39.45076011	0.080256822
03-Dec-24 12:00:00	39.45760802	0.080337525
03-Dec-24 13:00:00	39.20966604	0.080252414
03-Dec-24 14:00:00	39.53435812	0.080191718
03-Dec-24 15:00:00	39.82120034	0.080238851
03-Dec-24 16:00:00	34.26775655	0.080232408
03-Dec-24 17:00:00	29.01326122	0.080265978
03-Dec-24 18:00:00	29.60214541	0.080498318
03-Dec-24 19:00:00	30.04744788	0.080440538
03-Dec-24 20:00:00	29.76482066	0.080345323
03-Dec-24 21:00:00	29.44940887	0.080302925
03-Dec-24 22:00:00	29.16579186	0.080336507
03-Dec-24 23:00:00	29.21681847	0.080255596
04-Dec-24 00:00:00	28.91834767	0.080343989
04-Dec-24 01:00:00	28.78320578	0.080386851
04-Dec-24 02:00:00	28.60064372	0.080517409
04-Dec-24 03:00:00	28.04722102	0.080469606
04-Dec-24 04:00:00	27.7689924	0.080387034
04-Dec-24 05:00:00	27.84080576	0.080325826
04-Dec-24 06:00:00	27.364955393	0.080621507
04-Dec-24 07:00:00	26.45898117	0.080387709
04-Dec-24 08:00:00	28.19281908	0.080407206
04-Dec-24 09:00:00	30.15291355	0.080019802
04-Dec-24 10:00:00	31.24952222	0.080000814
04-Dec-24 11:00:00	32.4396741	0.080768636
04-Dec-24 12:00:00	34.06513971	0.080645252
04-Dec-24 13:00:00	34.82767166	0.080756578
04-Dec-24 14:00:00	34.39655364	0.080955223
04-Dec-24 15:00:00	36.37097872	0.080798453
04-Dec-24 16:00:00	33.88318852	0.080771044
04-Dec-24 17:00:00	31.94904682	0.080756124
04-Dec-24 18:00:00	31.64503696	0.080725522
04-Dec-24 19:00:00	31.52986118	0.080571973
04-Dec-24 20:00:00	31.18960004	0.080448669
04-Dec-24 21:00:00	31.56196064	0.080347207
04-Dec-24 22:00:00	31.94310622	0.08042433
04-Dec-24 23:00:00	31.59297607	0.080508592
05-Dec-24 00:00:00	31.1209594	0.080500115
05-Dec-24 01:00:00	30.55827397	0.080525038
05-Dec-24 02:00:00	29.24233597	0.08095759
05-Dec-24 03:00:00	29.81708663	0.08040568
05-Dec-24 04:00:00	29.57464914	0.08036396
05-Dec-24 05:00:00	29.18437875	0.080537019
05-Dec-24 06:00:00	29.17871973	0.080849143

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name P1	
Time Interval	1h

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
05-Dec-24 07:00:00	29.02352337	0.080345279
05-Dec-24 08:00:00	29.767051665	0.080646543
05-Dec-24 09:00:00	31.10167115	0.080267334
05-Dec-24 10:00:00	34.16013524	0.080347697
05-Dec-24 11:00:00	36.65668457	0.080419413
05-Dec-24 12:00:00	36.3989981	0.080535041
05-Dec-24 13:00:00	34.58143026	0.080386918
05-Dec-24 14:00:00	34.20910043	0.08085942
05-Dec-24 15:00:00	36.18485862	0.080625136
05-Dec-24 16:00:00	33.56412013	0.080742617
05-Dec-24 17:00:00	32.30370919	0.080666549
05-Dec-24 18:00:00	31.7356336	0.080360136
05-Dec-24 19:00:00	31.4561384	0.080402369
05-Dec-24 20:00:00	31.36080585	0.08042928
05-Dec-24 21:00:00	31.19527756	0.080471003
05-Dec-24 22:00:00	31.20560301	0.080399529
05-Dec-24 23:00:00	30.89764108	0.08050571
05-Dec-24 00:00:00	30.33480765	0.080517724
05-Dec-24 01:00:00	29.90502944	0.080479525
05-Dec-24 02:00:00	29.41051652	0.080508796
05-Dec-24 03:00:00	29.42471149	0.08044515
05-Dec-24 04:00:00	29.1235236	0.08021308
05-Dec-24 05:00:00	28.6519139	0.080267673
05-Dec-24 06:00:00	28.38015848	0.080276826
05-Dec-24 07:00:00	28.65034345	0.080157725
05-Dec-24 08:00:00	29.87591289	0.080348799
05-Dec-24 09:00:00	31.24435635	0.08072408
05-Dec-24 10:00:00	32.62356075	0.08075332
05-Dec-24 11:00:00	36.61339245	0.080817498
05-Dec-24 12:00:00	36.85891218	0.080795457
05-Dec-24 13:00:00	34.75024024	0.080580997
05-Dec-24 14:00:00	34.01842395	0.08060201
05-Dec-24 15:00:00	35.92805312	0.08044671
05-Dec-24 16:00:00	33.99654025	0.080327804
05-Dec-24 17:00:00	32.74893092	0.080345211
05-Dec-24 18:00:00	31.65922685	0.080377875
05-Dec-24 19:00:00	31.73428779	0.08055822
05-Dec-24 20:00:00	31.70881434	0.080369379
05-Dec-24 21:00:00	31.2501443	0.080376587
05-Dec-24 22:00:00	31.18587047	0.080201213
05-Dec-24 23:00:00	31.65451762	0.07975803
07-Dec-24 00:00:00	31.67211665	0.079807565
07-Dec-24 01:00:00	31.02810136	0.079845852
07-Dec-24 02:00:00	30.59404719	0.079773866
07-Dec-24 03:00:00	30.69307056	0.079762438
07-Dec-24 04:00:00	30.46659765	0.079653253
07-Dec-24 05:00:00	30.38695077	0.079725703
07-Dec-24 06:00:00	30.71771472	0.079694115
07-Dec-24 07:00:00	30.59464138	0.080346341
07-Dec-24 08:00:00	30.95103138	0.080327804
07-Dec-24 09:00:00	32.93808491	0.079698511

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)
07-Dec-24 10:00:00	34.84134793	0.080377536
07-Dec-24 11:00:00	37.5672653	0.080796983
07-Dec-24 12:00:00	37.27283494	0.08097975
07-Dec-24 13:00:00	35.46385625	0.080800743
07-Dec-24 14:00:00	34.68299807	0.080560303
07-Dec-24 15:00:00	34.72115557	0.080363125
07-Dec-24 16:00:00	33.7653338	0.08034651
07-Dec-24 17:00:00	32.87132345	0.080188696
07-Dec-24 18:00:00	31.92850574	0.080175103
07-Dec-24 19:00:00	31.65188721	0.0806427
07-Dec-24 20:00:00	31.64638779	0.080871522
07-Dec-24 21:00:00	31.75292879	0.080692886
07-Dec-24 22:00:00	31.70635174	0.080703057
07-Dec-24 23:00:00	31.84385793	0.08067107
08-Dec-24 00:00:00	32.25153598	0.080413592
08-Dec-24 01:00:00	32.20054601	0.08027988
08-Dec-24 02:00:00	31.69076696	0.080226169
08-Dec-24 03:00:00	31.53089448	0.080209147
08-Dec-24 04:00:00	31.53461916	0.080298647
08-Dec-24 05:00:00	31.27009547	0.080437724
08-Dec-24 06:00:00	31.00868684	0.080472921
08-Dec-24 07:00:00	31.65641754	0.080457628
08-Dec-24 08:00:00	32.08472305	0.080217149
08-Dec-24 09:00:00	31.93734444	0.080274807
08-Dec-24 10:00:00	32.37339769	0.08027502
08-Dec-24 11:00:00	31.37241304	0.080291409
08-Dec-24 12:00:00	30.44874087	0.080500963
08-Dec-24 13:00:00	30.98520855	0.080682373
08-Dec-24 14:00:00	32.02839555	0.080633922
08-Dec-24 15:00:00	33.18645574	0.080546332
08-Dec-24 16:00:00	33.03987147	0.08065211
08-Dec-24 17:00:00	32.64436392	0.080504778
08-Dec-24 18:00:00	32.46138955	0.08034668
08-Dec-24 19:00:00	32.28925895	0.080360592
08-Dec-24 20:00:00	32.10571907	0.08036338
08-Dec-24 21:00:00	31.91780652	0.080420612
08-Dec-24 22:00:00	31.65810587	0.080390325
08-Dec-24 23:00:00	30.88836081	0.080408833
09-Dec-24 00:00:00	30.36878288	0.080238173
09-Dec-24 01:00:00	29.94970918	0.080257958
09-Dec-24 02:00:00	29.49139052	0.080135515
09-Dec-24 03:00:00	28.57278511	0.07991706
09-Dec-24 04:00:00	27.91628475	0.079785156
09-Dec-24 05:00:00	27.48255389	0.079766846
09-Dec-24 06:00:00	27.44571163	0.079627482
09-Dec-24 07:00:00	27.46143316	0.079644436
09-Dec-24 08:00:00	28.0894782	0.079790808
09-Dec-24 09:00:00	28.96397807	0.079792955
09-Dec-24 10:00:00	31.11212271	0.080088411
09-Dec-24 11:00:00	35.52332548	0.080228
09-Dec-24 12:00:00	35.48842277	0.080317111



Start Time	7/1/24 1:00 AM
End Time	3/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	3/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
09-Dec-24 13:00:00	34.64941266	0.060541043	
09-Dec-24 14:00:00	33.79199295	0.06049452	
09-Dec-24 15:00:00	36.19429169	0.060523235	
09-Dec-24 16:00:00	33.8825483	0.060450779	
09-Dec-24 17:00:00	32.53417692	0.060386632	
09-Dec-24 18:00:00	31.35293644	0.060542351	
09-Dec-24 19:00:00	31.32954416	0.060673121	
09-Dec-24 20:00:00	30.15909837	0.060621066	
09-Dec-24 21:00:00	29.8746530	0.060549791	
09-Dec-24 22:00:00	29.71164186	0.060450436	
09-Dec-24 23:00:00	29.669103	0.060419593	
10-Dec-24 00:00:00	29.83705964	0.060459238	
10-Dec-24 01:00:00	29.63008012	0.060425912	
10-Dec-24 02:00:00	29.14145137	0.060192846	
10-Dec-24 03:00:00	29.15595128	0.060454416	
10-Dec-24 04:00:00	28.76693008	0.060230127	
10-Dec-24 05:00:00	28.44851566	0.060175103	
10-Dec-24 06:00:00	28.16138565	0.060094907	
10-Dec-24 07:00:00	27.81351443	0.060135091	
10-Dec-24 08:00:00	28.89204847	0.060256144	
10-Dec-24 09:00:00	30.32466646	0.060218506	
10-Dec-24 10:00:00	32.22236206	0.060417379	
10-Dec-24 11:00:00	35.53144597	0.060399348	
10-Dec-24 12:00:00	35.5569639	0.060450381	
10-Dec-24 13:00:00	28.51521186	0.060694831	
10-Dec-24 14:00:00	27.60060204	0.060914532	
10-Dec-24 15:00:00	28.47612524	0.060961563	
10-Dec-24 16:00:00	27.93908655	0.060721707	
10-Dec-24 17:00:00	27.78369494	0.060960422	
10-Dec-24 18:00:00	30.29672956	0.060632867	
10-Dec-24 19:00:00	31.07951832	0.060456566	
10-Dec-24 20:00:00	32.50003194	0.060476775	
10-Dec-24 21:00:00	30.18606014	0.060237834	
10-Dec-24 22:00:00	31.21280852	0.060328536	
10-Dec-24 23:00:00	30.44851769	0.060421109	
11-Dec-24 00:00:00	28.97113339	0.060225287	
11-Dec-24 01:00:00	29.16621956	0.060155097	
11-Dec-24 02:00:00	29.27598155	0.06020223	
11-Dec-24 03:00:00	29.52025488	0.060237195	
11-Dec-24 04:00:00	29.50128679	0.060141746	
11-Dec-24 05:00:00	28.93426364	0.060283059	
11-Dec-24 06:00:00	28.6450174	0.060394491	
11-Dec-24 07:00:00	29.18494513	0.060244615	
11-Dec-24 08:00:00	30.28203736	0.060370922	
11-Dec-24 09:00:00	30.69428046	0.060615506	
11-Dec-24 10:00:00	32.5946725	0.060683224	
11-Dec-24 11:00:00	35.25797384	0.06090549	
11-Dec-24 12:00:00	35.30340839	0.061320394	
11-Dec-24 13:00:00	34.08451003	0.060940484	
11-Dec-24 14:00:00	34.42463424	0.061043904	
11-Dec-24 15:00:00	36.83813	0.061160482	

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
11-Dec-24 16:00:00	34.35443019	0.061164042	
11-Dec-24 17:00:00	32.95670713	0.06117981	
11-Dec-24 18:00:00	32.19634211	0.061079707	
11-Dec-24 19:00:00	32.3278782	0.060969448	
11-Dec-24 20:00:00	32.18697305	0.060773756	
11-Dec-24 21:00:00	31.85374463	0.060940925	
11-Dec-24 22:00:00	32.57298906	0.060632526	
11-Dec-24 23:00:00	32.16067021	0.060636597	
12-Dec-24 00:00:00	31.4738365	0.060776977	
12-Dec-24 01:00:00	30.5122854	0.060662028	
12-Dec-24 02:00:00	30.54305566	0.060529609	
12-Dec-24 03:00:00	30.15756124	0.060575147	
12-Dec-24 04:00:00	29.97816353	0.060332438	
12-Dec-24 05:00:00	29.52841022	0.060601332	
12-Dec-24 06:00:00	29.31990228	0.06059082	
12-Dec-24 07:00:00	29.19948308	0.06053894	
12-Dec-24 08:00:00	29.39806046	0.060262587	
12-Dec-24 09:00:00	29.84454684	0.06043925	
12-Dec-24 10:00:00	30.78546254	0.06060947	
12-Dec-24 11:00:00	31.09205205	0.06020969	
12-Dec-24 12:00:00	30.9855351	0.060230713	
12-Dec-24 13:00:00	31.68512421	0.060212233	
12-Dec-24 14:00:00	31.84276772	0.06021386	
12-Dec-24 15:00:00	32.39305105	0.06036499	
12-Dec-24 16:00:00	37.13937308	0.060367567	
12-Dec-24 17:00:00	39.5676798	0.06050407	
12-Dec-24 18:00:00	39.42076641	0.079972549	
12-Dec-24 19:00:00	39.84030294	0.060032349	
12-Dec-24 20:00:00	39.55995285	0.079859524	
12-Dec-24 21:00:00	39.80816437	0.079869589	
12-Dec-24 22:00:00	39.68623188	0.079842461	
12-Dec-24 23:00:00	39.15616314	0.079671502	
13-Dec-24 00:00:00	38.97074313	0.079863824	
13-Dec-24 01:00:00	39.05037677	0.079736667	
13-Dec-24 02:00:00	39.82745774	0.079572211	
13-Dec-24 03:00:00	39.39459	0.079627652	
13-Dec-24 04:00:00	39.6487844	0.079571703	
13-Dec-24 05:00:00	39.76980054	0.079540846	
13-Dec-24 06:00:00	39.12211617	0.079491566	
13-Dec-24 07:00:00	39.22805321	0.079453994	
13-Dec-24 08:00:00	39.38824026	0.079397922	
13-Dec-24 09:00:00	39.25307034	0.079586614	
13-Dec-24 10:00:00	39.61905749	0.079507875	
13-Dec-24 11:00:00	38.87099264	0.079781596	
13-Dec-24 12:00:00	39.84114839	0.079811069	
13-Dec-24 13:00:00	39.56625287	0.060154475	
13-Dec-24 14:00:00	38.9006524	0.060132921	
13-Dec-24 15:00:00	39.11567159	0.060112621	
13-Dec-24 16:00:00	39.94280424	0.079981147	
13-Dec-24 17:00:00	39.65701664	0.060157019	
13-Dec-24 18:00:00	39.81172737	0.060137126	

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name Pl	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag Name Pl	
Time Interval	1h

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
13-Dec-24 19:00:00	39.75297412	0.080325996	
13-Dec-24 20:00:00	39.59248467	0.08037618	
13-Dec-24 21:00:00	39.86942288	0.080165439	
13-Dec-24 22:00:00	39.86029934	0.079686996	
13-Dec-24 23:00:00	39.75171566	0.079745257	
14-Dec-24 00:00:00	39.94970026	0.080103038	
14-Dec-24 01:00:00	39.76748055	0.080157301	
14-Dec-24 02:00:00	39.82614122	0.080221219	
14-Dec-24 03:00:00	39.99759647	0.080267221	
14-Dec-24 04:00:00	39.27036752	0.080277872	
14-Dec-24 05:00:00	39.93280722	0.080333116	
14-Dec-24 06:00:00	38.41051577	0.079692993	
14-Dec-24 07:00:00	38.87297118	0.07975265	
14-Dec-24 08:00:00	39.65970621	0.080197031	
14-Dec-24 09:00:00	39.41352927	0.080211249	
14-Dec-24 10:00:00	35.99515078	0.07998329	
14-Dec-24 11:00:00	35.72189751	0.079656973	
14-Dec-24 12:00:00	36.0046266	0.080250493	
14-Dec-24 13:00:00	36.31304803	0.08030202	
14-Dec-24 14:00:00	36.03483263	0.080652706	
14-Dec-24 15:00:00	34.23999121	0.080506727	
14-Dec-24 16:00:00	33.56427465	0.080573666	
14-Dec-24 17:00:00	34.72821676	0.080434593	
14-Dec-24 18:00:00	35.7392453	0.080549791	
14-Dec-24 19:00:00	36.34256954	0.080307346	
14-Dec-24 20:00:00	36.30360161	0.0803939473	
14-Dec-24 21:00:00	36.50779385	0.079914686	
14-Dec-24 22:00:00	36.78663187	0.080068631	
14-Dec-24 23:00:00	37.81832874	0.079715814	
15-Dec-24 00:00:00	36.79625555	0.079449632	
15-Dec-24 01:00:00	34.88564609	0.079526126	
15-Dec-24 02:00:00	34.49212833	0.079522283	
15-Dec-24 03:00:00	33.87293126	0.079659196	
15-Dec-24 04:00:00	33.57047739	0.079665731	
15-Dec-24 05:00:00	33.25245376	0.079506768	
15-Dec-24 06:00:00	33.55304838	0.079620531	
15-Dec-24 07:00:00	33.99670475	0.079487101	
15-Dec-24 08:00:00	35.34418999	0.079596872	
15-Dec-24 09:00:00	35.74321197	0.079550917	
15-Dec-24 10:00:00	35.52180633	0.079646476	
15-Dec-24 11:00:00	35.61245775	0.080120595	
15-Dec-24 12:00:00	36.24673528	0.080390083	
15-Dec-24 13:00:00	36.63514755	0.080469767	
15-Dec-24 14:00:00	37.10445563	0.080499171	
15-Dec-24 15:00:00	36.5811505	0.080495126	
15-Dec-24 16:00:00	36.19756691	0.080606589	
15-Dec-24 17:00:00	36.27156742	0.080726793	
15-Dec-24 18:00:00	35.27017057	0.080541992	
15-Dec-24 19:00:00	34.9813816	0.080484857	
15-Dec-24 20:00:00	35.19256673	0.080515487	
15-Dec-24 21:00:00	34.99285144	0.080518143	

3HYB-CHRC-TT-2001AI		3HYB-CHRC-AT-1AI	
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
15-Dec-24 22:00:00	35.11026512	0.080673898	
15-Dec-24 23:00:00	36.36926191	0.080143279	
16-Dec-24 00:00:00	36.76008429	0.079721341	
16-Dec-24 01:00:00	35.14666906	0.079502098	
16-Dec-24 02:00:00	35.2188765	0.079733276	
16-Dec-24 03:00:00	35.10913155	0.079665132	
16-Dec-24 04:00:00	35.06080108	0.080343507	
16-Dec-24 05:00:00	35.2610947	0.080467802	
16-Dec-24 06:00:00	35.69986611	0.080331421	
16-Dec-24 07:00:00	36.26077205	0.080402555	
16-Dec-24 08:00:00	37.15741764	0.080703736	
16-Dec-24 09:00:00	37.43952047	0.080570814	
16-Dec-24 10:00:00	36.618691941	0.080704899	
16-Dec-24 11:00:00	36.88963185	0.080490994	
16-Dec-24 12:00:00	37.97675473	0.08056878	
16-Dec-24 13:00:00	38.48414511	0.080680062	
16-Dec-24 14:00:00	36.84574577	0.081068759	
16-Dec-24 15:00:00	38.7660702	0.081062147	
16-Dec-24 16:00:00	39.5227791	0.081175401	
16-Dec-24 17:00:00	39.20404644	0.08106859	
16-Dec-24 18:00:00	39.32361056	0.080936121	
16-Dec-24 19:00:00	37.53995583	0.080751433	
16-Dec-24 20:00:00	36.69061319	0.080955493	
16-Dec-24 21:00:00	36.00791347	0.080595965	
16-Dec-24 22:00:00	36.24739449	0.080535465	
16-Dec-24 23:00:00	36.66103259	0.080421533	
17-Dec-24 00:00:00	36.27973453	0.080325998	
17-Dec-24 01:00:00	37.12687498	0.080306041	
17-Dec-24 02:00:00	35.63077805	0.080409749	
17-Dec-24 03:00:00	34.81560785	0.080271064	
17-Dec-24 04:00:00	34.67190162	0.080371433	
17-Dec-24 05:00:00	34.87538256	0.080512492	
17-Dec-24 06:00:00	34.08084105	0.080589973	
17-Dec-24 07:00:00	34.42916314	0.080595096	
17-Dec-24 08:00:00	36.69836438	0.080506754	
17-Dec-24 09:00:00	37.74977396	0.080560077	
17-Dec-24 10:00:00	36.78404134	0.080728376	
17-Dec-24 11:00:00	38.38004194	0.080888604	
17-Dec-24 12:00:00	39.15337351	0.080654726	
17-Dec-24 13:00:00	39.44638021	0.081068793	
17-Dec-24 14:00:00	39.03920731	0.081147258	
17-Dec-24 15:00:00	38.58818906	0.081175673	
17-Dec-24 16:00:00	37.75672116	0.080949536	
17-Dec-24 17:00:00	31.48552939	0.08089937	
17-Dec-24 18:00:00	31.51640923	0.080871921	
17-Dec-24 19:00:00	33.6264944	0.080666835	
17-Dec-24 20:00:00	34.09992089	0.080747477	
17-Dec-24 21:00:00	32.91044839	0.080790202	
17-Dec-24 22:00:00	32.7303395	0.080719333	
17-Dec-24 23:00:00	32.77042022	0.080527102	
18-Dec-24 00:00:00	34.19018367	0.080597263	



Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

Start Time	7/1/24 1:00 AM
End Time	7/1/25 1:00 AM
Tag name PI	
Time interval	1h

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)	
18-Dec-24 01:00:00	33.82904371	0.080544874	
18-Dec-24 02:00:00	32.53540242	0.080509949	
18-Dec-24 03:00:00	30.81515378	0.080479804	
18-Dec-24 04:00:00	29.0215813	0.080447523	
18-Dec-24 05:00:00	29.4870874	0.080298078	
18-Dec-24 06:00:00	29.5048738	0.080369511	
18-Dec-24 07:00:00	32.49920421	0.080113186	
18-Dec-24 08:00:00	34.98158857	0.080195891	
18-Dec-24 09:00:00	36.98518416	0.080443206	
18-Dec-24 10:00:00	37.53436835	0.080538789	
18-Dec-24 11:00:00	37.87907896	0.08077966	
18-Dec-24 12:00:00	38.71988269	0.081024255	
18-Dec-24 13:00:00	38.94148083	0.081015806	
18-Dec-24 14:00:00	38.98765026	0.081130529	
18-Dec-24 15:00:00	38.989673	0.081043498	
18-Dec-24 16:00:00	38.86884251	0.081004503	
18-Dec-24 17:00:00	38.2731846	0.081032866	
18-Dec-24 18:00:00	37.77425156	0.080989922	
18-Dec-24 19:00:00	38.54100816	0.081014472	
18-Dec-24 20:00:00	38.07424465	0.080906485	
18-Dec-24 21:00:00	37.66640262	0.080778673	
18-Dec-24 22:00:00	37.68597035	0.08073098	
18-Dec-24 23:00:00	39.51602859	0.080652534	
19-Dec-24 00:00:00	39.53850205	0.080752903	
19-Dec-24 01:00:00	38.72173651	0.080677596	
19-Dec-24 02:00:00	37.18734083	0.080544874	
19-Dec-24 03:00:00	36.15479818	0.080468693	
19-Dec-24 04:00:00	35.53891951	0.080383866	
19-Dec-24 05:00:00	34.54619304	0.080368381	
19-Dec-24 06:00:00	34.2939886	0.080335647	
19-Dec-24 07:00:00	34.508878	0.080651011	
19-Dec-24 08:00:00	35.87128883	0.080616794	
19-Dec-24 09:00:00	37.33475857	0.080851712	
19-Dec-24 10:00:00	36.40050922	0.080855306	
19-Dec-24 11:00:00	35.77868337	0.080789184	
19-Dec-24 12:00:00	36.57327803	0.081080797	
19-Dec-24 13:00:00	37.27212828	0.081102498	
19-Dec-24 14:00:00	36.52070405	0.081189959	
19-Dec-24 15:00:00	37.58786005	0.080821737	
19-Dec-24 16:00:00	37.79838259	0.080878412	
19-Dec-24 17:00:00	36.53445434	0.081018357	
19-Dec-24 18:00:00	36.41535917	0.080922445	
19-Dec-24 19:00:00	36.46252037	0.080849881	
19-Dec-24 20:00:00	36.21610192	0.08077696	
19-Dec-24 21:00:00	35.78159893	0.080637478	
19-Dec-24 22:00:00	35.94604211	0.080558607	
19-Dec-24 23:00:00	37.42639301	0.080588301	
20-Dec-24 00:00:00	38.52787489	0.080495005	
20-Dec-24 01:00:00	36.59013524	0.080386353	
20-Dec-24 02:00:00	35.70463887	0.080432892	
20-Dec-24 03:00:00	35.60183522	0.080339813	

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 600 meters canal (C°)	Chlorine online at 600 m. canal (mg/l)	
20-Dec-24 04:00:00	34.12143291	0.080388952	
20-Dec-24 05:00:00	34.09566256	0.080371885	
20-Dec-24 06:00:00	34.61151244	0.080412801	
20-Dec-24 07:00:00	34.28774324	0.080397203	
20-Dec-24 08:00:00	34.26548326	0.080382283	
20-Dec-24 09:00:00	35.90758153	0.080579631	
20-Dec-24 10:00:00	36.36923131	0.080583021	
20-Dec-24 11:00:00	36.67320351	0.080711618	
20-Dec-24 12:00:00	36.78747293	0.081014028	
20-Dec-24 13:00:00	36.78861924	0.081139345	
20-Dec-24 14:00:00	36.78138508	0.081130981	
20-Dec-24 15:00:00	36.78119535	0.081126065	
20-Dec-24 16:00:00	36.75934474	0.081040785	
20-Dec-24 17:00:00	36.80423185	0.081135898	
20-Dec-24 18:00:00	36.61681255	0.08091815	
20-Dec-24 19:00:00	36.82133177	0.080769928	
20-Dec-24 20:00:00	36.8217357	0.080705092	
20-Dec-24 21:00:00	36.82238254	0.080741374	
20-Dec-24 22:00:00	36.82525433	0.080678321	
20-Dec-24 23:00:00	36.82437355	0.080479252	
21-Dec-24 00:00:00	36.8244517	0.080597941	
21-Dec-24 01:00:00	36.82697365	0.080552673	
21-Dec-24 02:00:00	36.82405901	0.080522563	
21-Dec-24 03:00:00	36.82282523	0.080532789	
21-Dec-24 04:00:00	36.8222527	0.080484348	
21-Dec-24 05:00:00	36.82229784	0.080537245	
21-Dec-24 06:00:00	36.82180445	0.080446371	
21-Dec-24 07:00:00	36.81413506	0.080454169	
21-Dec-24 08:00:00	36.79867851	0.08014778	
21-Dec-24 09:00:00	36.78540092	0.078874222	
21-Dec-24 10:00:00	36.78752895	0.080242242	
21-Dec-24 11:00:00	36.78505661	0.080985169	
21-Dec-24 12:00:00	36.78669588	0.08057975	
21-Dec-24 13:00:00	36.79933467	0.081020101	
21-Dec-24 14:00:00	36.79458012	0.081007385	
21-Dec-24 15:00:00	36.80118015	0.080758158	
21-Dec-24 16:00:00	36.8081387	0.080810547	
21-Dec-24 17:00:00	36.81144848	0.080862901	
21-Dec-24 18:00:00	36.82467235	0.080851441	
21-Dec-24 19:00:00	36.81878047	0.080791897	
21-Dec-24 20:00:00	36.80979534	0.080873277	
21-Dec-24 21:00:00	36.81576615	0.080802409	
21-Dec-24 22:00:00	36.80773314	0.080810547	
21-Dec-24 23:00:00	36.81621758	0.080057102	
22-Dec-24 00:00:00	36.8212858	0.079940796	
22-Dec-24 01:00:00	36.78688228	0.079676423	
22-Dec-24 02:00:00	36.82519186	0.079634829	
22-Dec-24 03:00:00	36.82548242	0.079750909	
22-Dec-24 04:00:00	36.82097615	0.079912313	
22-Dec-24 05:00:00	36.8187705	0.079810757	
22-Dec-24 06:00:00	36.81803096	0.079812792	

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name P1	
Time Interval	1h

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
22-Dec-24 07:00:00	36.82204673	0.079825338	
22-Dec-24 08:00:00	36.81506864	0.079855855	
22-Dec-24 09:00:00	36.79599216	0.079979661	
22-Dec-24 10:00:00	35.79019525	0.080046049	
22-Dec-24 11:00:00	36.7867366	0.080254652	
22-Dec-24 12:00:00	36.78990041	0.080562337	
22-Dec-24 13:00:00	36.76261287	0.080518934	
22-Dec-24 14:00:00	36.7866993	0.080663933	
22-Dec-24 15:00:00	36.78987032	0.080609436	
22-Dec-24 16:00:00	36.80279405	0.080532377	
22-Dec-24 17:00:00	36.80379896	0.080480569	
22-Dec-24 18:00:00	36.81909084	0.080295834	
22-Dec-24 19:00:00	36.82343726	0.080176459	
22-Dec-24 20:00:00	36.81279573	0.080052015	
22-Dec-24 21:00:00	36.82742376	0.079939944	
22-Dec-24 22:00:00	36.82236024	0.079858736	
22-Dec-24 23:00:00	36.82643325	0.079822795	
23-Dec-24 00:00:00	36.83006033	0.079805162	
23-Dec-24 01:00:00	36.82679072	0.079803467	
23-Dec-24 02:00:00	36.81882214	0.079819928	
23-Dec-24 03:00:00	36.82406549	0.079720985	
23-Dec-24 04:00:00	36.82010196	0.079528469	
23-Dec-24 05:00:00	36.82700875	0.079442681	
23-Dec-24 06:00:00	36.80694017	0.079547119	
23-Dec-24 07:00:00	36.82435789	0.079395921	
23-Dec-24 08:00:00	36.79740312	0.079428779	
23-Dec-24 09:00:00	36.78380363	0.079600684	
23-Dec-24 10:00:00	36.78644629	0.079850281	
23-Dec-24 11:00:00	36.77512048	0.080341593	
23-Dec-24 12:00:00	36.85194672	0.080470785	
23-Dec-24 13:00:00	36.89640652	0.080519273	
23-Dec-24 14:00:00	36.79935204	0.080482992	
23-Dec-24 15:00:00	36.80408067	0.080466037	
23-Dec-24 16:00:00	36.78911485	0.080440267	
23-Dec-24 17:00:00	36.81400439	0.080455695	
23-Dec-24 18:00:00	36.82484702	0.080318366	
23-Dec-24 19:00:00	36.82918365	0.080238512	
23-Dec-24 20:00:00	36.82339235	0.080092231	
23-Dec-24 21:00:00	36.82947333	0.07995592	
23-Dec-24 22:00:00	36.82436605	0.079984765	
23-Dec-24 23:00:00	36.82190619	0.079772864	
24-Dec-24 00:00:00	36.81995901	0.079682538	
24-Dec-24 01:00:00	36.82447595	0.079656051	
24-Dec-24 02:00:00	36.81637205	0.079671122	
24-Dec-24 03:00:00	36.81211114	0.079778883	
24-Dec-24 04:00:00	36.82211528	0.079784817	
24-Dec-24 05:00:00	36.81831457	0.079939101	
24-Dec-24 06:00:00	36.81331305	0.079900445	
24-Dec-24 07:00:00	36.81692308	0.079820082	
24-Dec-24 08:00:00	36.82143374	0.079762436	
24-Dec-24 09:00:00	36.81033275	0.079706828	

3HYB-CHRC-TT-2001AI			3HYB-CHRC-AT-1AI
Date/Time	Temperature at 500 meters canal (C°)	Chlorine online at 500 m. canal (mg/l)	
24-Dec-24 10:00:00	36.79793905	0.079870608	
24-Dec-24 11:00:00	36.78933652	0.08017086	
24-Dec-24 12:00:00	36.79451608	0.080471124	
24-Dec-24 13:00:00	36.7878757	0.080481127	
24-Dec-24 14:00:00	36.80120528	0.080320401	
24-Dec-24 15:00:00	36.80551108	0.080201552	
24-Dec-24 16:00:00	36.80534441	0.080140516	
24-Dec-24 17:00:00	36.80778982	0.080172305	
24-Dec-24 18:00:00	36.82117826	0.079954444	
24-Dec-24 19:00:00	36.82004728	0.079953342	
24-Dec-24 20:00:00	36.81609946	0.08014289	
24-Dec-24 21:00:00	36.81973427	0.08012085	
24-Dec-24 22:00:00	36.81436575	0.080015733	
24-Dec-24 23:00:00	36.81526053	0.079975835	
25-Dec-24 00:00:00	36.8144055	0.079868636	
25-Dec-24 01:00:00	36.81798352	0.079890272	
25-Dec-24 02:00:00	36.81894294	0.080093384	
25-Dec-24 03:00:00	36.82166532	0.079695368	
25-Dec-24 04:00:00	36.82081255	0.079602592	
25-Dec-24 05:00:00	36.82336719	0.080009856	
25-Dec-24 06:00:00	36.82363238	0.079801093	
25-Dec-24 07:00:00	36.82247169	0.079781426	
25-Dec-24 08:00:00	36.80743059	0.079857212	
25-Dec-24 09:00:00	36.7972837	0.079741923	
25-Dec-24 10:00:00	36.7877202	0.080065918	
25-Dec-24 11:00:00	36.78543282	0.080271403	
25-Dec-24 12:00:00	36.79282195	0.080334925	
25-Dec-24 13:00:00	36.78551665	0.080025284	
25-Dec-24 14:00:00	36.7867483	0.080028459	
25-Dec-24 15:00:00	36.78985203	0.080673216	
25-Dec-24 16:00:00	36.79431773	0.080589464	
25-Dec-24 17:00:00	36.79895628	0.080403307	
25-Dec-24 18:00:00	36.8197006	0.080374485	
25-Dec-24 19:00:00	36.81670396	0.080296495	
25-Dec-24 20:00:00	37.04445582	0.080371094	
25-Dec-24 21:00:00	36.54062658	0.08023919	
25-Dec-24 22:00:00	37.23789196	0.08013449	
25-Dec-24 23:00:00	38.33121091	0.080185615	
26-Dec-24 00:00:00	37.06243178	0.080121952	
26-Dec-24 01:00:00	35.98940008	0.080109575	
26-Dec-24 02:00:00	35.30021304	0.080114068	
26-Dec-24 03:00:00	35.38425559	0.080055571	
26-Dec-24 04:00:00	34.5819487	0.080095089	
26-Dec-24 05:00:00	34.52547742	0.079797703	
26-Dec-24 06:00:00	34.9563873	0.079803806	
26-Dec-24 07:00:00	37.34984977	0.079806006	
26-Dec-24 08:00:00	38.72150883	0.079988397	
26-Dec-24 09:00:00	37.18331538	0.080074802	
26-Dec-24 10:00:00	37.46611364	0.080174086	
26-Dec-24 11:00:00	38.85941653	0.080090332	
26-Dec-24 12:00:00	38.50688008	0.080098979	



Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

Start Time	7/1/24 1:00 AM
End Time	1/1/25 1:00 AM
Tag name PI	
Time Interval	1h

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature el 500 meters canal (C°)	Chlorine online el 500 m. canal (mg/l)
26-Dec-24 13:00:00	38.85634312	0.080243428
26-Dec-24 14:00:00	39.03895776	0.080412492
26-Dec-24 15:00:00	38.87701182	0.080455639
26-Dec-24 16:00:00	39.01346053	0.08050458
26-Dec-24 17:00:00	38.97251777	0.080355486
26-Dec-24 18:00:00	37.76310395	0.080404211
26-Dec-24 19:00:00	37.50031052	0.08036646
26-Dec-24 20:00:00	38.26732995	0.080327861
26-Dec-24 21:00:00	38.50676236	0.08072727
26-Dec-24 22:00:00	38.9235054	0.080008104
26-Dec-24 23:00:00	39.10753536	0.079887165
27-Dec-24 00:00:00	39.20127041	0.0794940407
27-Dec-24 01:00:00	39.46026565	0.079963359
27-Dec-24 02:00:00	38.98882923	0.079842597
27-Dec-24 03:00:00	38.86271516	0.079891832
27-Dec-24 04:00:00	38.23820336	0.079867215
27-Dec-24 05:00:00	37.85502052	0.079871284
27-Dec-24 06:00:00	37.06914083	0.079945747
27-Dec-24 07:00:00	38.31525583	0.079809231
27-Dec-24 08:00:00	39.2375856	0.079931921
27-Dec-24 09:00:00	39.62293859	0.080091543
27-Dec-24 10:00:00	39.29467597	0.080038904
27-Dec-24 11:00:00	39.70083121	0.080444223
27-Dec-24 12:00:00	39.30370446	0.080529514
27-Dec-24 13:00:00	39.37100832	0.080584988
27-Dec-24 14:00:00	39.16623301	0.080467733
27-Dec-24 15:00:00	39.81906546	0.080493348
27-Dec-24 16:00:00	39.42045151	0.080402686
27-Dec-24 17:00:00	39.94241711	0.080304972
27-Dec-24 18:00:00	39.42284845	0.080221219
27-Dec-24 19:00:00	39.83595006	0.080217871
27-Dec-24 20:00:00	39.3527512	0.08016744
27-Dec-24 21:00:00	38.34937848	0.080174764
27-Dec-24 22:00:00	39.10088961	0.080173407
27-Dec-24 23:00:00	39.24572374	0.080169978
28-Dec-24 00:00:00	39.39837282	0.080192312
28-Dec-24 01:00:00	38.67039169	0.08010398
28-Dec-24 02:00:00	37.86676184	0.080106008
28-Dec-24 03:00:00	37.26312195	0.080114068
28-Dec-24 04:00:00	37.56819156	0.080076972
28-Dec-24 05:00:00	37.74081606	0.0800786
28-Dec-24 06:00:00	37.29508831	0.08000359
28-Dec-24 07:00:00	37.67148846	0.07999759
28-Dec-24 08:00:00	39.75289286	0.080160794
28-Dec-24 09:00:00	39.56739467	0.080353529
28-Dec-24 10:00:00	39.37483314	0.080361599
28-Dec-24 11:00:00	39.08865744	0.080393866
28-Dec-24 12:00:00	39.66310024	0.080657507
28-Dec-24 13:00:00	39.62454679	0.080612183
28-Dec-24 14:00:00	39.76238372	0.080627781
28-Dec-24 15:00:00	38.52043285	0.080614895

3HYB-CHRC-TT-2001AI	3HYB-CHRC-AT-1AI
---------------------	------------------

Date/Time	Temperature el 500 meters canal (C°)	Chlorine online el 500 m. canal (mg/l)
28-Dec-24 16:00:00	38.81464542	0.080463664
28-Dec-24 17:00:00	38.81224462	0.080366381
28-Dec-24 18:00:00	38.67132307	0.080345226
28-Dec-24 19:00:00	38.84995364	0.080344742
28-Dec-24 20:00:00	38.52153173	0.080248684
28-Dec-24 21:00:00	38.103384	0.080153741
28-Dec-24 22:00:00	39.5613376	0.080191718
28-Dec-24 23:00:00	39.98029607	0.080054728
29-Dec-24 00:00:00	38.34717576	0.080084229
29-Dec-24 01:00:00	37.0359744	0.080002848
29-Dec-24 02:00:00	36.63348081	0.080123562
29-Dec-24 03:00:00	35.64058656	0.08003564
29-Dec-24 04:00:00	35.55635584	0.079993002
29-Dec-24 05:00:00	35.68900469	0.079878404
29-Dec-24 06:00:00	35.50314673	0.079812351
29-Dec-24 07:00:00	35.4853124	0.079798813
29-Dec-24 08:00:00	38.77841189	0.08008875
29-Dec-24 09:00:00	39.47919657	0.080145093
29-Dec-24 10:00:00	39.10242158	0.080126862
29-Dec-24 11:00:00	39.76690459	0.080529688
29-Dec-24 12:00:00	38.96419008	0.080444064
29-Dec-24 13:00:00	39.1529347	0.08064551
29-Dec-24 14:00:00	39.70174128	0.08051567
29-Dec-24 15:00:00	39.9815881	0.080498735
29-Dec-24 16:00:00	39.66371197	0.080315146
29-Dec-24 17:00:00	39.16985066	0.080459842
29-Dec-24 18:00:00	38.71679467	0.080176233
29-Dec-24 19:00:00	38.66130109	0.079906503
29-Dec-24 20:00:00	38.33787911	0.079651412
29-Dec-24 21:00:00	38.99872108	0.079938761
29-Dec-24 22:00:00	39.37640363	0.079755995
29-Dec-24 23:00:00	39.18876793	0.079760403
30-Dec-24 00:00:00	38.98019335	0.079687613
30-Dec-24 01:00:00	38.92869108	0.079812
30-Dec-24 02:00:00	38.24017645	0.079653512
30-Dec-24 03:00:00	38.04237972	0.079822456
30-Dec-24 04:00:00	38.0508685	0.079852682
30-Dec-24 05:00:00	37.84072538	0.079651402
30-Dec-24 06:00:00	37.51084184	0.079825168
30-Dec-24 07:00:00	38.03911964	0.079924181
30-Dec-24 08:00:00	39.48601147	0.08018586
30-Dec-24 09:00:00	39.00084404	0.080329251
30-Dec-24 10:00:00	39.85247978	0.080375966
30-Dec-24 11:00:00	39.95326694	0.080583699
30-Dec-24 12:00:00	39.17375471	0.08075765
30-Dec-24 13:00:00	39.28952953	0.080768161
30-Dec-24 14:00:00	39.42556348	0.0807213
30-Dec-24 15:00:00	39.23431661	0.080619032
30-Dec-24 16:00:00	38.79019854	0.080486314
30-Dec-24 17:00:00	38.78825522	0.08053282
30-Dec-24 18:00:00	39.11397	0.080321107





## ภาคผนวก ข-25

---

ผลการตรวจวัดอุณหภูมิน้ำหล่อเย็นก่อนและหลังผ่าน  
คอนเดนเซอร์ของโครงการ  
ระหว่างเดือนกรกฎาคม ถึงธันวาคม พ.ศ. 2567

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
01-Jul-24 01:00:00	4.24	4.96	4.51
01-Jul-24 02:00:00	4.22	4.96	4.53
01-Jul-24 03:00:00	4.18	4.96	4.58
01-Jul-24 04:00:00	3.82	4.97	4.78
01-Jul-24 05:00:00	4.24	4.93	4.84
01-Jul-24 06:00:00	4.31	4.88	4.82
01-Jul-24 07:00:00	4.31	4.96	4.78
01-Jul-24 08:00:00	4.24	4.94	4.80
01-Jul-24 09:00:00	4.28	4.96	4.91
01-Jul-24 10:00:00	4.27	4.91	4.90
01-Jul-24 11:00:00	4.24	4.96	4.97
01-Jul-24 12:00:00	4.26	4.91	4.81
01-Jul-24 13:00:00	4.24	4.88	4.74
01-Jul-24 14:00:00	4.23	4.98	4.84
01-Jul-24 15:00:00	4.24	4.97	4.89
01-Jul-24 16:00:00	4.24	4.93	4.80
01-Jul-24 17:00:00	4.29	4.88	4.78
01-Jul-24 18:00:00	4.32	4.92	4.77
01-Jul-24 19:00:00	4.30	4.93	4.75
01-Jul-24 20:00:00	4.24	4.97	4.82
01-Jul-24 21:00:00	4.30	4.92	4.68
01-Jul-24 22:00:00	4.19	4.92	4.17
01-Jul-24 23:00:00	4.22	4.92	4.17
02-Jul-24 00:00:00	4.20	4.91	4.19
02-Jul-24 01:00:00	4.20	4.94	4.38
02-Jul-24 02:00:00	4.23	4.94	4.57
02-Jul-24 03:00:00	4.26	4.95	4.53
02-Jul-24 04:00:00	4.26	4.89	4.76
02-Jul-24 05:00:00	4.27	4.91	4.82
02-Jul-24 06:00:00	4.26	4.97	4.79
02-Jul-24 07:00:00	4.19	4.95	4.79
02-Jul-24 08:00:00	4.24	4.97	4.89
02-Jul-24 09:00:00	4.27	4.94	4.96

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
02-Jul-24 10:00:00	4.26	4.94	4.90
02-Jul-24 11:00:00	4.19	4.93	4.94
02-Jul-24 12:00:00	4.17	4.94	4.67
02-Jul-24 13:00:00	4.15	4.92	4.67
02-Jul-24 14:00:00	4.20	4.91	4.75
02-Jul-24 15:00:00	4.21	4.97	4.73
02-Jul-24 16:00:00	4.22	4.90	4.78
02-Jul-24 17:00:00	4.23	4.91	4.74
02-Jul-24 18:00:00	3.95	4.98	4.77
02-Jul-24 19:00:00	3.70	4.97	4.81
02-Jul-24 20:00:00	3.72	4.94	4.73
02-Jul-24 21:00:00	3.74	4.96	4.51
02-Jul-24 22:00:00	3.90	4.89	4.16
02-Jul-24 23:00:00	4.02	4.98	4.16
03-Jul-24 00:00:00	4.06	4.92	4.27
03-Jul-24 01:00:00	4.09	4.88	4.45
03-Jul-24 02:00:00	4.10	4.98	4.40
03-Jul-24 03:00:00	4.12	4.88	4.44
03-Jul-24 04:00:00	4.14	4.95	4.62
03-Jul-24 05:00:00	4.16	4.98	4.75
03-Jul-24 06:00:00	4.30	4.94	4.84
03-Jul-24 07:00:00	4.17	4.96	4.86
03-Jul-24 08:00:00	4.28	4.96	4.97
03-Jul-24 09:00:00	4.40	4.89	4.98
03-Jul-24 10:00:00	4.35	4.93	4.98
03-Jul-24 11:00:00	4.36	4.90	4.92
03-Jul-24 12:00:00	4.33	4.89	4.74
03-Jul-24 13:00:00	4.30	4.96	4.74
03-Jul-24 14:00:00	4.28	4.92	4.86
03-Jul-24 15:00:00	4.29	4.97	4.85
03-Jul-24 16:00:00	4.29	4.95	4.86
03-Jul-24 17:00:00	4.29	4.92	4.89
03-Jul-24 18:00:00	4.30	4.98	4.81



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
03-Jul-24 19:00:00	4.32	4.89	4.83
03-Jul-24 20:00:00	4.32	4.98	4.83
03-Jul-24 21:00:00	4.23	4.96	4.58
03-Jul-24 22:00:00	4.14	4.92	4.32
03-Jul-24 23:00:00	4.18	4.97	4.31
04-Jul-24 00:00:00	4.18	4.90	4.35
04-Jul-24 01:00:00	4.19	4.88	4.53
04-Jul-24 02:00:00	4.14	4.89	4.56
04-Jul-24 03:00:00	4.16	4.88	4.59
04-Jul-24 04:00:00	4.25	4.98	4.81
04-Jul-24 05:00:00	4.29	4.98	4.90
04-Jul-24 06:00:00	4.32	4.94	4.91
04-Jul-24 07:00:00	4.30	4.96	4.96
04-Jul-24 08:00:00	4.34	4.89	4.94
04-Jul-24 09:00:00	4.46	4.94	5.00
04-Jul-24 10:00:00	4.42	4.93	4.91
04-Jul-24 11:00:00	4.39	4.98	4.96
04-Jul-24 12:00:00	4.36	4.95	4.93
04-Jul-24 13:00:00	4.32	4.91	4.87
04-Jul-24 14:00:00	4.30	4.87	4.97
04-Jul-24 15:00:00	4.26	4.98	4.91
04-Jul-24 16:00:00	4.23	4.93	4.88
04-Jul-24 17:00:00	4.24	4.95	4.85
04-Jul-24 18:00:00	4.24	4.97	4.86
04-Jul-24 19:00:00	4.23	4.91	4.84
04-Jul-24 20:00:00	4.23	4.97	4.84
04-Jul-24 21:00:00	4.18	4.87	4.64
04-Jul-24 22:00:00	4.14	4.95	4.34
04-Jul-24 23:00:00	4.18	4.96	4.36
05-Jul-24 00:00:00	4.16	4.98	4.32
05-Jul-24 01:00:00	4.18	4.97	4.50
05-Jul-24 02:00:00	4.17	4.90	4.46
05-Jul-24 03:00:00	4.15	4.92	4.31

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
05-Jul-24 04:00:00	4.17	4.92	4.54
05-Jul-24 05:00:00	4.20	4.89	4.63
05-Jul-24 06:00:00	4.24	4.97	4.69
05-Jul-24 07:00:00	4.20	4.95	4.76
05-Jul-24 08:00:00	4.40	4.91	4.93
05-Jul-24 09:00:00	4.44	4.88	4.89
05-Jul-24 10:00:00	4.40	4.89	4.98
05-Jul-24 11:00:00	4.36	4.97	4.89
05-Jul-24 12:00:00	4.34	4.88	4.96
05-Jul-24 13:00:00	4.29	4.98	4.80
05-Jul-24 14:00:00	4.28	4.91	4.99
05-Jul-24 15:00:00	4.26	4.99	4.92
05-Jul-24 16:00:00	4.25	4.88	4.94
05-Jul-24 17:00:00	4.22	4.88	4.92
05-Jul-24 18:00:00	4.22	4.97	4.83
05-Jul-24 19:00:00	4.23	4.89	4.85
05-Jul-24 20:00:00	4.22	4.94	4.91
05-Jul-24 21:00:00	4.10	4.98	4.61
05-Jul-24 22:00:00	4.06	4.94	4.25
05-Jul-24 23:00:00	4.06	4.89	4.16
06-Jul-24 00:00:00	4.02	4.88	4.05
06-Jul-24 01:00:00	4.03	4.91	4.27
06-Jul-24 02:00:00	4.06	4.93	4.26
06-Jul-24 03:00:00	4.08	4.91	4.30
06-Jul-24 04:00:00	4.11	4.93	4.55
06-Jul-24 05:00:00	4.16	4.97	4.59
06-Jul-24 06:00:00	4.24	4.91	4.76
06-Jul-24 07:00:00	4.23	4.94	4.88
06-Jul-24 08:00:00	4.20	4.91	4.98
06-Jul-24 09:00:00	4.29	4.90	4.99
06-Jul-24 10:00:00	4.49	4.89	4.97
06-Jul-24 11:00:00	4.47	4.88	4.95
06-Jul-24 12:00:00	4.44	4.98	4.82

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
06-Jul-24 13:00:00	4.41	4.91	4.70
06-Jul-24 14:00:00	4.35	4.89	4.59
06-Jul-24 15:00:00	4.31	4.92	4.51
06-Jul-24 16:00:00	4.28	4.91	4.50
06-Jul-24 17:00:00	4.25	4.91	4.51
06-Jul-24 18:00:00	4.23	4.94	4.44
06-Jul-24 19:00:00	4.23	4.92	4.46
06-Jul-24 20:00:00	4.20	4.94	4.39
06-Jul-24 21:00:00	4.18	4.95	4.39
06-Jul-24 22:00:00	4.18	4.96	4.21
06-Jul-24 23:00:00	4.11	4.98	4.17
07-Jul-24 00:00:00	3.98	4.92	4.15
07-Jul-24 01:00:00	4.00	4.98	4.39
07-Jul-24 02:00:00	4.05	4.91	4.47
07-Jul-24 03:00:00	4.07	4.94	4.51
07-Jul-24 04:00:00	4.06	4.92	4.68
07-Jul-24 05:00:00	4.07	4.98	4.71
07-Jul-24 06:00:00	4.10	4.95	4.78
07-Jul-24 07:00:00	3.89	4.98	4.88
07-Jul-24 08:00:00	3.82	4.89	4.86
07-Jul-24 09:00:00	3.98	4.88	4.91
07-Jul-24 10:00:00	4.15	4.87	4.97
07-Jul-24 11:00:00	4.14	4.94	4.95
07-Jul-24 12:00:00	4.07	4.91	4.71
07-Jul-24 13:00:00	4.05	4.91	4.60
07-Jul-24 14:00:00	4.02	4.90	4.59
07-Jul-24 15:00:00	3.99	4.92	4.54
07-Jul-24 16:00:00	3.94	4.91	4.53
07-Jul-24 17:00:00	3.92	4.89	4.42
07-Jul-24 18:00:00	3.99	4.90	4.52
07-Jul-24 19:00:00	4.12	4.98	4.64
07-Jul-24 20:00:00	4.09	4.89	4.54
07-Jul-24 21:00:00	4.01	4.88	4.47

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
07-Jul-24 22:00:00	3.95	4.88	4.43
07-Jul-24 23:00:00	3.95	4.90	4.47
08-Jul-24 00:00:00	3.94	4.93	4.54
08-Jul-24 01:00:00	3.94	4.98	4.51
08-Jul-24 02:00:00	3.94	4.98	4.52
08-Jul-24 03:00:00	3.95	4.99	4.48
08-Jul-24 04:00:00	3.98	4.95	4.74
08-Jul-24 05:00:00	4.01	4.89	4.79
08-Jul-24 06:00:00	4.04	4.88	4.84
08-Jul-24 07:00:00	4.01	4.93	4.90
08-Jul-24 08:00:00	4.20	4.91	4.97
08-Jul-24 09:00:00	4.27	4.93	4.91
08-Jul-24 10:00:00	4.29	4.90	4.89
08-Jul-24 11:00:00	4.29	4.95	4.98
08-Jul-24 12:00:00	4.28	4.89	4.89
08-Jul-24 13:00:00	4.23	4.99	4.87
08-Jul-24 14:00:00	4.21	4.87	4.98
08-Jul-24 15:00:00	4.18	4.98	4.98
08-Jul-24 16:00:00	4.11	4.97	4.90
08-Jul-24 17:00:00	4.09	4.98	4.89
08-Jul-24 18:00:00	4.07	4.88	4.83
08-Jul-24 19:00:00	4.05	4.98	4.70
08-Jul-24 20:00:00	4.17	4.97	4.58
08-Jul-24 21:00:00	4.28	4.87	4.56
08-Jul-24 22:00:00	4.27	4.88	4.56
08-Jul-24 23:00:00	4.23	4.89	4.75
09-Jul-24 00:00:00	4.22	4.94	4.81
09-Jul-24 01:00:00	4.25	4.97	4.85
09-Jul-24 02:00:00	4.24	4.97	4.78
09-Jul-24 03:00:00	4.26	4.88	4.80
09-Jul-24 04:00:00	4.27	4.92	4.98
09-Jul-24 05:00:00	4.26	4.93	4.93
09-Jul-24 06:00:00	4.29	4.98	4.95



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
09-Jul-24 07:00:00	4.29	4.88	4.88
09-Jul-24 08:00:00	4.40	4.97	4.97
09-Jul-24 09:00:00	4.44	4.93	4.89
09-Jul-24 10:00:00	4.45	4.95	4.98
09-Jul-24 11:00:00	4.45	4.89	4.96
09-Jul-24 12:00:00	4.44	4.97	4.87
09-Jul-24 13:00:00	4.40	4.91	4.89
09-Jul-24 14:00:00	4.40	4.89	4.93
09-Jul-24 15:00:00	4.36	4.92	4.91
09-Jul-24 16:00:00	4.35	4.87	4.87
09-Jul-24 17:00:00	4.28	4.92	4.78
09-Jul-24 18:00:00	4.26	4.89	4.75
09-Jul-24 19:00:00	4.22	4.96	4.66
09-Jul-24 20:00:00	4.25	4.89	4.53
09-Jul-24 21:00:00	4.28	4.95	4.49
09-Jul-24 22:00:00	4.27	4.91	4.40
09-Jul-24 23:00:00	4.23	4.96	4.64
10-Jul-24 00:00:00	4.22	4.96	4.73
10-Jul-24 01:00:00	4.26	4.89	4.73
10-Jul-24 02:00:00	4.26	4.87	4.77
10-Jul-24 03:00:00	4.28	4.89	4.79
10-Jul-24 04:00:00	4.30	4.89	4.91
10-Jul-24 05:00:00	4.32	4.88	4.89
10-Jul-24 06:00:00	4.29	4.87	4.98
10-Jul-24 07:00:00	4.24	4.89	4.97
10-Jul-24 08:00:00	4.35	4.94	4.91
10-Jul-24 09:00:00	4.39	4.93	4.92
10-Jul-24 10:00:00	4.41	4.90	4.98
10-Jul-24 11:00:00	4.40	4.88	4.96
10-Jul-24 12:00:00	4.42	4.90	4.93
10-Jul-24 13:00:00	4.39	4.92	4.92
10-Jul-24 14:00:00	4.36	4.92	4.97
10-Jul-24 15:00:00	4.38	4.91	4.90

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
10-Jul-24 16:00:00	4.35	4.96	4.83
10-Jul-24 17:00:00	4.34	4.88	4.88
10-Jul-24 18:00:00	4.31	4.99	4.67
10-Jul-24 19:00:00	4.28	4.93	4.54
10-Jul-24 20:00:00	4.29	4.98	4.58
10-Jul-24 21:00:00	4.25	4.95	4.66
10-Jul-24 22:00:00	4.25	4.91	4.78
10-Jul-24 23:00:00	4.29	4.94	4.75
11-Jul-24 00:00:00	4.29	4.90	4.69
11-Jul-24 01:00:00	4.28	4.88	4.68
11-Jul-24 02:00:00	4.29	4.95	4.72
11-Jul-24 03:00:00	4.29	4.97	4.70
11-Jul-24 04:00:00	4.29	4.94	4.90
11-Jul-24 05:00:00	4.28	4.96	4.94
11-Jul-24 06:00:00	4.32	4.89	4.97
11-Jul-24 07:00:00	4.26	4.88	4.98
11-Jul-24 08:00:00	4.40	4.89	4.97
11-Jul-24 09:00:00	4.44	4.97	4.88
11-Jul-24 10:00:00	4.47	4.94	4.94
11-Jul-24 11:00:00	4.47	4.98	4.90
11-Jul-24 12:00:00	4.44	4.98	4.98
11-Jul-24 13:00:00	4.43	4.91	4.94
11-Jul-24 14:00:00	4.42	4.88	4.94
11-Jul-24 15:00:00	4.38	4.98	4.92
11-Jul-24 16:00:00	4.34	4.92	4.86
11-Jul-24 17:00:00	4.34	4.88	4.89
11-Jul-24 18:00:00	4.33	4.96	4.80
11-Jul-24 19:00:00	4.33	4.95	4.68
11-Jul-24 20:00:00	4.33	4.89	4.99
11-Jul-24 21:00:00	4.30	4.97	4.56
11-Jul-24 22:00:00	4.26	4.95	4.61
11-Jul-24 23:00:00	4.33	4.88	4.73
12-Jul-24 00:00:00	4.32	4.87	4.76

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
12-Jul-24 01:00:00	4.33	4.94	4.70
12-Jul-24 02:00:00	4.34	4.99	4.69
12-Jul-24 03:00:00	4.34	4.89	4.75
12-Jul-24 04:00:00	4.34	4.92	4.93
12-Jul-24 05:00:00	4.35	4.90	4.99
12-Jul-24 06:00:00	4.37	4.95	4.91
12-Jul-24 07:00:00	4.33	4.89	4.97
12-Jul-24 08:00:00	4.34	4.94	4.87
12-Jul-24 09:00:00	4.35	4.96	4.90
12-Jul-24 10:00:00	4.49	4.93	2.58
12-Jul-24 11:00:00	4.49	4.88	2.06
12-Jul-24 12:00:00	4.42	4.94	1.78
12-Jul-24 13:00:00	4.43	4.89	1.74
12-Jul-24 14:00:00	4.40	4.95	1.78
12-Jul-24 15:00:00	3.39	4.90	1.75
12-Jul-24 16:00:00	Unit Shut down	4.97	1.59
12-Jul-24 17:00:00	4.58	4.97	1.65
12-Jul-24 18:00:00	4.15	4.95	1.67
12-Jul-24 19:00:00	4.16	4.90	1.62
12-Jul-24 20:00:00	4.12	4.88	1.57
12-Jul-24 21:00:00	4.30	4.89	1.52
12-Jul-24 22:00:00	4.34	4.92	1.34
12-Jul-24 23:00:00	4.34	4.91	1.18
13-Jul-24 00:00:00	4.31	4.92	1.14
13-Jul-24 01:00:00	4.32	4.99	1.30
13-Jul-24 02:00:00	4.31	4.90	1.32
13-Jul-24 03:00:00	4.28	4.88	1.37
13-Jul-24 04:00:00	4.29	4.98	1.53
13-Jul-24 05:00:00	4.29	4.99	1.52
13-Jul-24 06:00:00	4.33	4.93	1.55
13-Jul-24 07:00:00	4.28	4.96	1.49
13-Jul-24 08:00:00	4.35	4.88	1.49
13-Jul-24 09:00:00	4.39	4.96	1.65

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
13-Jul-24 10:00:00	4.40	4.96	1.79
13-Jul-24 11:00:00	4.38	4.90	1.73
13-Jul-24 12:00:00	4.30	4.91	1.41
13-Jul-24 13:00:00	4.34	4.89	1.46
13-Jul-24 14:00:00	4.36	4.97	1.57
13-Jul-24 15:00:00	4.37	4.87	1.51
13-Jul-24 16:00:00	4.32	4.99	1.53
13-Jul-24 17:00:00	4.29	4.93	1.56
13-Jul-24 18:00:00	4.31	4.97	1.51
13-Jul-24 19:00:00	4.31	4.93	1.49
13-Jul-24 20:00:00	4.31	4.99	1.42
13-Jul-24 21:00:00	4.24	4.96	1.35
13-Jul-24 22:00:00	4.31	4.97	1.26
13-Jul-24 23:00:00	4.25	4.89	1.07
14-Jul-24 00:00:00	4.23	4.98	0.98
14-Jul-24 01:00:00	4.25	4.95	1.18
14-Jul-24 02:00:00	4.26	4.89	1.17
14-Jul-24 03:00:00	4.24	4.95	1.12
14-Jul-24 04:00:00	4.25	4.98	1.39
14-Jul-24 05:00:00	4.26	4.94	1.39
14-Jul-24 06:00:00	4.25	4.97	1.40
14-Jul-24 07:00:00	4.26	4.96	1.32
14-Jul-24 08:00:00	4.20	4.90	1.30
14-Jul-24 09:00:00	3.90	4.91	1.36
14-Jul-24 10:00:00	3.83	4.97	1.41
14-Jul-24 11:00:00	3.90	4.89	1.38
14-Jul-24 12:00:00	3.94	4.96	1.24
14-Jul-24 13:00:00	3.94	4.98	1.18
14-Jul-24 14:00:00	3.88	4.91	1.15
14-Jul-24 15:00:00	4.17	4.97	1.16
14-Jul-24 16:00:00	4.22	4.97	1.15
14-Jul-24 17:00:00	4.23	4.91	1.26
14-Jul-24 18:00:00	4.29	4.87	4.97



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
14-Jul-24 19:00:00	4.35	4.94	4.89
14-Jul-24 20:00:00	4.34	4.97	4.79
14-Jul-24 21:00:00	4.28	4.92	1.18
14-Jul-24 22:00:00	4.29	4.88	1.00
14-Jul-24 23:00:00	4.29	4.92	1.07
15-Jul-24 00:00:00	4.27	4.89	1.08
15-Jul-24 01:00:00	4.30	4.90	1.16
15-Jul-24 02:00:00	4.32	4.97	1.15
15-Jul-24 03:00:00	4.33	4.89	1.27
15-Jul-24 04:00:00	4.34	4.90	1.39
15-Jul-24 05:00:00	4.35	4.93	1.41
15-Jul-24 06:00:00	4.35	4.98	1.38
15-Jul-24 07:00:00	4.35	4.92	1.39
15-Jul-24 08:00:00	4.43	4.94	1.46
15-Jul-24 09:00:00	4.41	4.88	1.63
15-Jul-24 10:00:00	4.37	4.90	1.63
15-Jul-24 11:00:00	4.40	4.90	1.66
15-Jul-24 12:00:00	4.43	4.91	1.40
15-Jul-24 13:00:00	4.44	4.94	1.34
15-Jul-24 14:00:00	4.47	4.91	1.38
15-Jul-24 15:00:00	4.45	4.94	1.40
15-Jul-24 16:00:00	4.45	4.97	1.36
15-Jul-24 17:00:00	4.42	4.97	1.35
15-Jul-24 18:00:00	4.37	4.91	1.33
15-Jul-24 19:00:00	4.34	4.87	1.33
15-Jul-24 20:00:00	4.33	4.88	1.30
15-Jul-24 21:00:00	4.31	4.89	1.34
15-Jul-24 22:00:00	4.34	4.87	1.33
15-Jul-24 23:00:00	4.24	4.94	1.13
16-Jul-24 00:00:00	4.24	4.92	0.93
16-Jul-24 01:00:00	4.26	4.91	0.92
16-Jul-24 02:00:00	4.28	4.94	1.03
16-Jul-24 03:00:00	4.29	4.88	1.20

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
16-Jul-24 04:00:00	4.30	4.93	1.31
16-Jul-24 05:00:00	4.31	4.95	1.38
16-Jul-24 06:00:00	4.29	4.88	1.37
16-Jul-24 07:00:00	4.27	4.97	1.41
16-Jul-24 08:00:00	4.25	4.93	1.33
16-Jul-24 09:00:00	4.29	4.91	1.50
16-Jul-24 10:00:00	4.35	4.93	1.53
16-Jul-24 11:00:00	4.30	4.93	1.55
16-Jul-24 12:00:00	4.34	4.89	1.44
16-Jul-24 13:00:00	4.33	4.91	1.34
16-Jul-24 14:00:00	4.32	4.88	1.32
16-Jul-24 15:00:00	4.31	4.90	1.27
16-Jul-24 16:00:00	4.33	4.90	1.31
16-Jul-24 17:00:00	4.32	4.97	1.31
16-Jul-24 18:00:00	4.30	4.96	1.24
16-Jul-24 19:00:00	4.27	4.98	1.24
16-Jul-24 20:00:00	4.29	4.98	1.28
16-Jul-24 21:00:00	4.31	4.90	1.17
16-Jul-24 22:00:00	4.22	4.88	0.79
16-Jul-24 23:00:00	4.24	4.97	0.80
17-Jul-24 00:00:00	4.25	4.89	0.78
17-Jul-24 01:00:00	4.27	4.96	0.90
17-Jul-24 02:00:00	4.28	4.92	1.08
17-Jul-24 03:00:00	4.31	4.92	1.06
17-Jul-24 04:00:00	4.32	4.90	1.28
17-Jul-24 05:00:00	4.31	4.95	1.32
17-Jul-24 06:00:00	4.31	4.97	1.27
17-Jul-24 07:00:00	4.24	4.90	1.31
17-Jul-24 08:00:00	4.24	4.97	1.50
17-Jul-24 09:00:00	4.35	4.95	1.59
17-Jul-24 10:00:00	4.36	4.96	1.57
17-Jul-24 11:00:00	4.34	4.90	1.53
17-Jul-24 12:00:00	4.30	4.90	1.42

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
17-Jul-24 13:00:00	4.28	4.98	1.29
17-Jul-24 14:00:00	4.29	4.93	1.27
17-Jul-24 15:00:00	4.29	4.93	1.17
17-Jul-24 16:00:00	4.27	4.95	1.15
17-Jul-24 17:00:00	4.26	4.96	1.20
17-Jul-24 18:00:00	4.26	4.96	1.23
17-Jul-24 19:00:00	4.22	4.93	1.18
17-Jul-24 20:00:00	4.30	4.97	1.20
17-Jul-24 21:00:00	4.31	4.95	1.05
17-Jul-24 22:00:00	4.25	4.96	0.86
17-Jul-24 23:00:00	4.26	4.94	0.72
18-Jul-24 00:00:00	4.26	4.98	0.74
18-Jul-24 01:00:00	4.37	4.91	0.97
18-Jul-24 02:00:00	4.38	4.90	1.00
18-Jul-24 03:00:00	4.37	4.93	1.06
18-Jul-24 04:00:00	4.37	4.88	1.29
18-Jul-24 05:00:00	4.40	4.93	1.29
18-Jul-24 06:00:00	4.43	4.99	1.32
18-Jul-24 07:00:00	4.36	4.88	1.31
18-Jul-24 08:00:00	4.38	4.88	1.44
18-Jul-24 09:00:00	4.41	4.92	1.55
18-Jul-24 10:00:00	4.39	4.89	1.56
18-Jul-24 11:00:00	4.39	4.96	1.49
18-Jul-24 12:00:00	4.36	4.87	1.27
18-Jul-24 13:00:00	4.32	4.93	1.24
18-Jul-24 14:00:00	4.32	4.91	1.17
18-Jul-24 15:00:00	4.32	4.99	1.12
18-Jul-24 16:00:00	4.31	4.94	1.12
18-Jul-24 17:00:00	4.32	4.96	1.12
18-Jul-24 18:00:00	4.30	4.94	1.17
18-Jul-24 19:00:00	4.27	4.96	1.09
18-Jul-24 20:00:00	4.31	4.93	1.11
18-Jul-24 21:00:00	4.36	4.93	1.01

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
18-Jul-24 22:00:00	4.37	4.88	0.92
18-Jul-24 23:00:00	4.34	4.95	4.89
19-Jul-24 00:00:00	4.30	4.90	4.90
19-Jul-24 01:00:00	4.30	4.92	4.98
19-Jul-24 02:00:00	4.32	4.88	4.99
19-Jul-24 03:00:00	4.32	4.99	4.99
19-Jul-24 04:00:00	4.33	4.88	1.35
19-Jul-24 05:00:00	4.37	4.89	4.89
19-Jul-24 06:00:00	4.40	4.93	1.45
19-Jul-24 07:00:00	4.36	4.97	1.46
19-Jul-24 08:00:00	4.45	4.98	1.50
19-Jul-24 09:00:00	4.52	4.98	1.57
19-Jul-24 10:00:00	4.49	4.87	1.47
19-Jul-24 11:00:00	4.43	4.93	1.41
19-Jul-24 12:00:00	4.37	4.95	1.27
19-Jul-24 13:00:00	4.38	4.92	1.14
19-Jul-24 14:00:00	4.37	4.93	1.05
19-Jul-24 15:00:00	4.37	4.96	1.03
19-Jul-24 16:00:00	4.35	4.95	1.03
19-Jul-24 17:00:00	4.34	4.89	1.02
19-Jul-24 18:00:00	4.34	4.93	1.04
19-Jul-24 19:00:00	4.32	4.91	0.91
19-Jul-24 20:00:00	4.36	4.93	0.74
19-Jul-24 21:00:00	4.34	4.90	0.75
19-Jul-24 22:00:00	4.33	4.88	0.77
19-Jul-24 23:00:00	4.35	4.95	0.84
20-Jul-24 00:00:00	4.29	4.92	0.81
20-Jul-24 01:00:00	4.31	4.94	0.74
20-Jul-24 02:00:00	4.32	4.92	0.73
20-Jul-24 03:00:00	4.34	4.97	0.81
20-Jul-24 04:00:00	4.37	4.98	1.05
20-Jul-24 05:00:00	4.40	4.88	1.10
20-Jul-24 06:00:00	4.41	4.96	1.11



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
20-Jul-24 07:00:00	4.41	4.89	1.21
20-Jul-24 08:00:00	4.43	4.95	1.19
20-Jul-24 09:00:00	4.44	4.92	1.16
20-Jul-24 10:00:00	4.41	4.96	1.19
20-Jul-24 11:00:00	4.38	4.88	1.11
20-Jul-24 12:00:00	4.35	4.94	0.90
20-Jul-24 13:00:00	4.32	4.94	0.77
20-Jul-24 14:00:00	4.29	4.96	0.60
20-Jul-24 15:00:00	4.12	4.98	0.54
20-Jul-24 16:00:00	4.10	4.98	0.50
20-Jul-24 17:00:00	4.08	4.94	0.55
20-Jul-24 18:00:00	4.09	4.98	0.51
20-Jul-24 19:00:00	4.07	4.97	0.43
20-Jul-24 20:00:00	4.06	4.95	5.00
20-Jul-24 21:00:00	4.02	4.95	0.32
20-Jul-24 22:00:00	4.07	4.93	0.35
20-Jul-24 23:00:00	4.06	4.92	0.56
21-Jul-24 00:00:00	4.05	4.99	0.54
21-Jul-24 01:00:00	4.07	4.99	4.99
21-Jul-24 02:00:00	4.08	4.99	0.69
21-Jul-24 03:00:00	4.09	4.90	0.65
21-Jul-24 04:00:00	4.11	4.94	0.90
21-Jul-24 05:00:00	4.12	4.97	0.93
21-Jul-24 06:00:00	4.15	4.97	1.03
21-Jul-24 07:00:00	4.17	4.97	1.04
21-Jul-24 08:00:00	4.22	4.95	1.09
21-Jul-24 09:00:00	4.25	4.93	1.12
21-Jul-24 10:00:00	4.22	4.92	1.13
21-Jul-24 11:00:00	4.18	4.93	1.02
21-Jul-24 12:00:00	4.16	4.88	0.87
21-Jul-24 13:00:00	4.13	4.88	0.75
21-Jul-24 14:00:00	4.08	4.95	0.63
21-Jul-24 15:00:00	4.07	4.97	0.61

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
21-Jul-24 16:00:00	4.03	4.92	0.59
21-Jul-24 17:00:00	4.02	4.91	0.42
21-Jul-24 18:00:00	4.03	4.87	4.99
21-Jul-24 19:00:00	4.05	4.88	0.36
21-Jul-24 20:00:00	4.04	4.97	0.47
21-Jul-24 21:00:00	3.98	4.94	0.54
21-Jul-24 22:00:00	4.00	4.96	4.99
21-Jul-24 23:00:00	4.09	4.97	4.99
22-Jul-24 00:00:00	4.15	4.93	4.99
22-Jul-24 01:00:00	4.14	4.87	4.88
22-Jul-24 02:00:00	4.13	4.96	5.00
22-Jul-24 03:00:00	4.15	4.94	5.00
22-Jul-24 04:00:00	4.14	4.96	5.00
22-Jul-24 05:00:00	4.15	4.99	Unit Shut down
22-Jul-24 06:00:00	4.18	4.87	5.00
22-Jul-24 07:00:00	4.16	4.92	Unit Shut down
22-Jul-24 08:00:00	4.22	4.88	Unit Shut down
22-Jul-24 09:00:00	4.26	4.99	Unit Shut down
22-Jul-24 10:00:00	4.27	4.95	Unit Shut down
22-Jul-24 11:00:00	4.25	4.92	Unit Shut down
22-Jul-24 12:00:00	4.23	4.93	Unit Shut down
22-Jul-24 13:00:00	4.19	4.94	Unit Shut down
22-Jul-24 14:00:00	4.15	4.91	Unit Shut down
22-Jul-24 15:00:00	4.12	4.93	Unit Shut down
22-Jul-24 16:00:00	4.11	4.90	Unit Shut down
22-Jul-24 17:00:00	4.08	4.98	Unit Shut down
22-Jul-24 18:00:00	4.07	4.96	Unit Shut down
22-Jul-24 19:00:00	4.06	4.88	Unit Shut down
22-Jul-24 20:00:00	4.05	4.97	Unit Shut down
22-Jul-24 21:00:00	4.02	4.95	Unit Shut down
22-Jul-24 22:00:00	4.02	4.94	Unit Shut down
22-Jul-24 23:00:00	4.09	4.88	Unit Shut down
23-Jul-24 00:00:00	4.13	4.91	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
23-Jul-24 01:00:00	4.13	4.98	Unit Shut down
23-Jul-24 02:00:00	4.11	4.92	Unit Shut down
23-Jul-24 03:00:00	4.15	4.98	Unit Shut down
23-Jul-24 04:00:00	4.19	4.91	Unit Shut down
23-Jul-24 05:00:00	4.16	4.94	Unit Shut down
23-Jul-24 06:00:00	4.15	4.88	4.99
23-Jul-24 07:00:00	4.10	4.92	Unit Shut down
23-Jul-24 08:00:00	4.17	4.99	Unit Shut down
23-Jul-24 09:00:00	4.26	4.96	Unit Shut down
23-Jul-24 10:00:00	4.25	4.96	Unit Shut down
23-Jul-24 11:00:00	4.20	4.89	Unit Shut down
23-Jul-24 12:00:00	4.26	4.91	Unit Shut down
23-Jul-24 13:00:00	4.30	4.97	Unit Shut down
23-Jul-24 14:00:00	4.27	4.96	5.00
23-Jul-24 15:00:00	4.26	4.92	5.00
23-Jul-24 16:00:00	4.25	4.99	5.00
23-Jul-24 17:00:00	4.23	4.92	5.00
23-Jul-24 18:00:00	4.20	4.98	5.00
23-Jul-24 19:00:00	4.21	4.93	Unit Shut down
23-Jul-24 20:00:00	4.20	4.97	Unit Shut down
23-Jul-24 21:00:00	4.18	4.90	Unit Shut down
23-Jul-24 22:00:00	4.21	4.99	Unit Shut down
23-Jul-24 23:00:00	4.23	4.91	Unit Shut down
24-Jul-24 00:00:00	4.10	4.95	Unit Shut down
24-Jul-24 01:00:00	3.84	4.99	Unit Shut down
24-Jul-24 02:00:00	3.86	4.99	Unit Shut down
24-Jul-24 03:00:00	3.90	4.97	Unit Shut down
24-Jul-24 04:00:00	3.90	4.92	Unit Shut down
24-Jul-24 05:00:00	3.93	4.96	Unit Shut down
24-Jul-24 06:00:00	3.98	4.90	Unit Shut down
24-Jul-24 07:00:00	3.91	4.91	Unit Shut down
24-Jul-24 08:00:00	3.89	4.90	Unit Shut down
24-Jul-24 09:00:00	3.95	4.90	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
24-Jul-24 10:00:00	3.97	4.88	Unit Shut down
24-Jul-24 11:00:00	3.96	4.87	Unit Shut down
24-Jul-24 12:00:00	3.97	4.94	Unit Shut down
24-Jul-24 13:00:00	3.96	4.97	Unit Shut down
24-Jul-24 14:00:00	3.95	4.90	Unit Shut down
24-Jul-24 15:00:00	3.96	4.95	Unit Shut down
24-Jul-24 16:00:00	4.21	4.99	Unit Shut down
24-Jul-24 17:00:00	4.30	4.93	Unit Shut down
24-Jul-24 18:00:00	4.33	4.90	Unit Shut down
24-Jul-24 19:00:00	4.27	4.90	Unit Shut down
24-Jul-24 20:00:00	4.24	4.94	Unit Shut down
24-Jul-24 21:00:00	4.15	4.96	Unit Shut down
24-Jul-24 22:00:00	4.06	4.97	Unit Shut down
24-Jul-24 23:00:00	4.05	4.92	Unit Shut down
25-Jul-24 00:00:00	4.04	4.93	Unit Shut down
25-Jul-24 01:00:00	4.04	4.88	Unit Shut down
25-Jul-24 02:00:00	4.04	4.93	Unit Shut down
25-Jul-24 03:00:00	4.02	4.97	Unit Shut down
25-Jul-24 04:00:00	4.03	4.90	Unit Shut down
25-Jul-24 05:00:00	4.02	4.93	Unit Shut down
25-Jul-24 06:00:00	4.04	4.97	Unit Shut down
25-Jul-24 07:00:00	4.03	4.97	Unit Shut down
25-Jul-24 08:00:00	4.04	4.95	Unit Shut down
25-Jul-24 09:00:00	4.13	4.92	Unit Shut down
25-Jul-24 10:00:00	4.19	4.90	Unit Shut down
25-Jul-24 11:00:00	4.19	4.96	Unit Shut down
25-Jul-24 12:00:00	4.12	4.90	Unit Shut down
25-Jul-24 13:00:00	4.19	4.97	Unit Shut down
25-Jul-24 14:00:00	4.23	4.89	Unit Shut down
25-Jul-24 15:00:00	4.19	4.91	Unit Shut down
25-Jul-24 16:00:00	4.05	4.90	Unit Shut down
25-Jul-24 17:00:00	4.01	4.90	Unit Shut down
25-Jul-24 18:00:00	4.01	4.92	Unit Shut down



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
25-Jul-24 19:00:00	3.91	4.92	Unit Shut down
25-Jul-24 20:00:00	3.95	4.97	Unit Shut down
25-Jul-24 21:00:00	3.99	4.92	Unit Shut down
25-Jul-24 22:00:00	3.99	4.90	Unit Shut down
25-Jul-24 23:00:00	3.99	4.90	Unit Shut down
26-Jul-24 00:00:00	3.97	4.98	Unit Shut down
26-Jul-24 01:00:00	3.97	4.98	Unit Shut down
26-Jul-24 02:00:00	3.96	4.92	Unit Shut down
26-Jul-24 03:00:00	3.98	4.92	Unit Shut down
26-Jul-24 04:00:00	3.96	4.90	Unit Shut down
26-Jul-24 05:00:00	3.97	4.96	Unit Shut down
26-Jul-24 06:00:00	3.99	4.98	Unit Shut down
26-Jul-24 07:00:00	3.99	4.88	Unit Shut down
26-Jul-24 08:00:00	3.99	4.94	Unit Shut down
26-Jul-24 09:00:00	4.06	4.91	Unit Shut down
26-Jul-24 10:00:00	4.09	4.89	Unit Shut down
26-Jul-24 11:00:00	4.11	4.90	Unit Shut down
26-Jul-24 12:00:00	4.12	4.98	Unit Shut down
26-Jul-24 13:00:00	4.11	4.96	4.98
26-Jul-24 14:00:00	4.13	4.98	4.99
26-Jul-24 15:00:00	4.09	4.93	4.97
26-Jul-24 16:00:00	4.09	4.91	4.99
26-Jul-24 17:00:00	4.05	4.95	4.98
26-Jul-24 18:00:00	4.00	4.96	4.99
26-Jul-24 19:00:00	3.84	4.91	4.99
26-Jul-24 20:00:00	3.51	4.99	Unit Shut down
26-Jul-24 21:00:00	3.56	4.89	Unit Shut down
26-Jul-24 22:00:00	3.58	4.98	Unit Shut down
26-Jul-24 23:00:00	3.60	4.88	Unit Shut down
27-Jul-24 00:00:00	3.61	4.89	Unit Shut down
27-Jul-24 01:00:00	3.60	4.97	Unit Shut down
27-Jul-24 02:00:00	3.68	4.98	Unit Shut down
27-Jul-24 03:00:00	3.68	4.89	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
27-Jul-24 04:00:00	3.70	4.94	Unit Shut down
27-Jul-24 05:00:00	3.72	4.95	Unit Shut down
27-Jul-24 06:00:00	3.71	4.92	Unit Shut down
27-Jul-24 07:00:00	3.69	4.89	Unit Shut down
27-Jul-24 08:00:00	3.66	4.97	Unit Shut down
27-Jul-24 09:00:00	3.71	4.97	Unit Shut down
27-Jul-24 10:00:00	3.72	4.90	Unit Shut down
27-Jul-24 11:00:00	3.72	4.98	Unit Shut down
27-Jul-24 12:00:00	3.64	4.92	Unit Shut down
27-Jul-24 13:00:00	3.70	4.93	Unit Shut down
27-Jul-24 14:00:00	3.72	4.99	Unit Shut down
27-Jul-24 15:00:00	3.67	4.95	Unit Shut down
27-Jul-24 16:00:00	3.63	4.99	Unit Shut down
27-Jul-24 17:00:00	3.62	4.95	Unit Shut down
27-Jul-24 18:00:00	3.61	4.94	Unit Shut down
27-Jul-24 19:00:00	3.55	4.89	Unit Shut down
27-Jul-24 20:00:00	3.51	4.97	Unit Shut down
27-Jul-24 21:00:00	3.49	4.97	Unit Shut down
27-Jul-24 22:00:00	3.50	4.88	4.99
27-Jul-24 23:00:00	3.60	4.91	Unit Shut down
28-Jul-24 00:00:00	3.69	4.90	Unit Shut down
28-Jul-24 01:00:00	3.70	4.88	Unit Shut down
28-Jul-24 02:00:00	3.61	4.95	Unit Shut down
28-Jul-24 03:00:00	3.62	4.92	Unit Shut down
28-Jul-24 04:00:00	3.62	4.89	Unit Shut down
28-Jul-24 05:00:00	3.61	4.96	Unit Shut down
28-Jul-24 06:00:00	3.63	4.96	Unit Shut down
28-Jul-24 07:00:00	3.59	4.96	Unit Shut down
28-Jul-24 08:00:00	3.61	4.96	Unit Shut down
28-Jul-24 09:00:00	3.61	4.97	Unit Shut down
28-Jul-24 10:00:00	3.59	4.91	Unit Shut down
28-Jul-24 11:00:00	3.60	4.88	Unit Shut down
28-Jul-24 12:00:00	3.59	4.91	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
28-Jul-24 13:00:00	3.57	4.91	Unit Shut down
28-Jul-24 14:00:00	3.55	4.88	Unit Shut down
28-Jul-24 15:00:00	3.55	4.97	Unit Shut down
28-Jul-24 16:00:00	3.55	4.89	Unit Shut down
28-Jul-24 17:00:00	3.54	4.98	4.99
28-Jul-24 18:00:00	3.53	4.94	4.99
28-Jul-24 19:00:00	3.55	4.89	Unit Shut down
28-Jul-24 20:00:00	3.54	4.97	Unit Shut down
28-Jul-24 21:00:00	3.48	4.98	Unit Shut down
28-Jul-24 22:00:00	3.54	4.88	Unit Shut down
28-Jul-24 23:00:00	3.57	4.89	Unit Shut down
29-Jul-24 00:00:00	3.58	4.94	Unit Shut down
29-Jul-24 01:00:00	3.61	4.96	Unit Shut down
29-Jul-24 02:00:00	3.62	4.89	Unit Shut down
29-Jul-24 03:00:00	3.63	4.87	Unit Shut down
29-Jul-24 04:00:00	3.64	4.97	Unit Shut down
29-Jul-24 05:00:00	3.69	4.97	Unit Shut down
29-Jul-24 06:00:00	3.67	4.95	Unit Shut down
29-Jul-24 07:00:00	3.57	4.93	Unit Shut down
29-Jul-24 08:00:00	3.65	4.88	Unit Shut down
29-Jul-24 09:00:00	3.66	4.93	Unit Shut down
29-Jul-24 10:00:00	3.68	4.96	Unit Shut down
29-Jul-24 11:00:00	3.65	4.95	Unit Shut down
29-Jul-24 12:00:00	3.69	4.97	Unit Shut down
29-Jul-24 13:00:00	4.27	4.91	Unit Shut down
29-Jul-24 14:00:00	4.98	4.91	Unit Shut down
29-Jul-24 15:00:00	4.98	4.88	Unit Shut down
29-Jul-24 16:00:00	4.93	4.90	Unit Shut down
29-Jul-24 17:00:00	4.63	4.97	Unit Shut down
29-Jul-24 18:00:00	3.96	4.89	Unit Shut down
29-Jul-24 19:00:00	4.93	4.98	Unit Shut down
29-Jul-24 20:00:00	4.91	4.90	Unit Shut down
29-Jul-24 21:00:00	4.97	4.99	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
29-Jul-24 22:00:00	3.59	4.96	Unit Shut down
29-Jul-24 23:00:00	3.70	4.89	Unit Shut down
30-Jul-24 00:00:00	3.69	4.93	Unit Shut down
30-Jul-24 01:00:00	3.77	4.99	Unit Shut down
30-Jul-24 02:00:00	3.78	4.95	Unit Shut down
30-Jul-24 03:00:00	3.76	4.91	Unit Shut down
30-Jul-24 04:00:00	4.01	4.93	Unit Shut down
30-Jul-24 05:00:00	3.74	4.99	Unit Shut down
30-Jul-24 06:00:00	3.74	4.96	Unit Shut down
30-Jul-24 07:00:00	3.71	4.93	Unit Shut down
30-Jul-24 08:00:00	3.71	4.88	Unit Shut down
30-Jul-24 09:00:00	3.72	4.92	Unit Shut down
30-Jul-24 10:00:00	3.69	4.96	Unit Shut down
30-Jul-24 11:00:00	3.65	4.97	Unit Shut down
30-Jul-24 12:00:00	3.55	4.96	Unit Shut down
30-Jul-24 13:00:00	3.52	4.87	Unit Shut down
30-Jul-24 14:00:00	3.51	4.90	Unit Shut down
30-Jul-24 15:00:00	3.50	4.98	Unit Shut down
30-Jul-24 16:00:00	3.48	4.92	Unit Shut down
30-Jul-24 17:00:00	3.47	4.90	Unit Shut down
30-Jul-24 18:00:00	3.49	4.88	Unit Shut down
30-Jul-24 19:00:00	3.49	4.91	Unit Shut down
30-Jul-24 20:00:00	3.50	4.90	Unit Shut down
30-Jul-24 21:00:00	3.57	4.99	Unit Shut down
30-Jul-24 22:00:00	3.53	4.94	Unit Shut down
30-Jul-24 23:00:00	3.58	4.87	Unit Shut down
31-Jul-24 00:00:00	3.64	4.94	Unit Shut down
31-Jul-24 01:00:00	3.68	4.96	Unit Shut down
31-Jul-24 02:00:00	3.73	4.96	Unit Shut down
31-Jul-24 03:00:00	3.74	4.95	Unit Shut down
31-Jul-24 04:00:00	3.68	4.97	Unit Shut down
31-Jul-24 05:00:00	3.69	4.88	Unit Shut down
31-Jul-24 06:00:00	3.69	4.94	Unit Shut down



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
31-Jul-24 07:00:00	3.62	4.91	Unit Shut down
31-Jul-24 08:00:00	3.62	4.96	Unit Shut down
31-Jul-24 09:00:00	3.62	4.87	Unit Shut down
31-Jul-24 10:00:00	3.60	4.93	Unit Shut down
31-Jul-24 11:00:00	3.59	4.87	Unit Shut down
31-Jul-24 12:00:00	3.57	4.92	Unit Shut down
31-Jul-24 13:00:00	3.52	4.88	Unit Shut down
31-Jul-24 14:00:00	3.48	4.97	Unit Shut down
31-Jul-24 15:00:00	3.46	4.88	Unit Shut down
31-Jul-24 16:00:00	3.49	4.95	Unit Shut down
31-Jul-24 17:00:00	3.52	4.96	Unit Shut down
31-Jul-24 18:00:00	3.54	4.93	Unit Shut down
31-Jul-24 19:00:00	3.54	4.88	Unit Shut down
31-Jul-24 20:00:00	3.52	4.87	Unit Shut down
31-Jul-24 21:00:00	3.49	4.90	Unit Shut down
31-Jul-24 22:00:00	3.54	4.88	Unit Shut down
31-Jul-24 23:00:00	3.53	4.90	Unit Shut down
01-Aug-24 00:00:00	3.54	4.90	Unit Shut down
01-Aug-24 01:00:00	3.54	4.90	Unit Shut down
01-Aug-24 02:00:00	3.48	4.94	Unit Shut down
01-Aug-24 03:00:00	3.52	4.98	Unit Shut down
01-Aug-24 04:00:00	3.67	4.87	Unit Shut down
01-Aug-24 05:00:00	3.68	4.91	Unit Shut down
01-Aug-24 06:00:00	3.63	4.97	Unit Shut down
01-Aug-24 07:00:00	3.62	4.98	Unit Shut down
01-Aug-24 08:00:00	3.63	4.96	Unit Shut down
01-Aug-24 09:00:00	3.66	4.97	Unit Shut down
01-Aug-24 10:00:00	3.68	4.96	Unit Shut down
01-Aug-24 11:00:00	3.67	4.96	Unit Shut down
01-Aug-24 12:00:00	3.50	4.98	Unit Shut down
01-Aug-24 13:00:00	3.56	4.98	Unit Shut down
01-Aug-24 14:00:00	3.58	4.99	Unit Shut down
01-Aug-24 15:00:00	3.60	4.91	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
01-Aug-24 16:00:00	3.59	4.91	Unit Shut down
01-Aug-24 17:00:00	3.60	4.90	Unit Shut down
01-Aug-24 18:00:00	3.60	4.89	Unit Shut down
01-Aug-24 19:00:00	3.54	4.92	Unit Shut down
01-Aug-24 20:00:00	3.48	4.87	Unit Shut down
01-Aug-24 21:00:00	3.47	4.87	Unit Shut down
01-Aug-24 22:00:00	3.50	4.90	Unit Shut down
01-Aug-24 23:00:00	3.51	4.96	Unit Shut down
02-Aug-24 00:00:00	3.52	4.91	Unit Shut down
02-Aug-24 01:00:00	3.50	4.89	Unit Shut down
02-Aug-24 02:00:00	3.51	4.94	Unit Shut down
02-Aug-24 03:00:00	3.53	4.87	Unit Shut down
02-Aug-24 04:00:00	3.54	4.89	Unit Shut down
02-Aug-24 05:00:00	3.55	4.94	Unit Shut down
02-Aug-24 06:00:00	3.56	4.88	Unit Shut down
02-Aug-24 07:00:00	3.55	4.99	Unit Shut down
02-Aug-24 08:00:00	3.58	4.91	Unit Shut down
02-Aug-24 09:00:00	3.69	4.94	Unit Shut down
02-Aug-24 10:00:00	3.72	4.94	4.91
02-Aug-24 11:00:00	3.66	4.92	Unit Shut down
02-Aug-24 12:00:00	3.50	4.94	Unit Shut down
02-Aug-24 13:00:00	3.59	4.98	Unit Shut down
02-Aug-24 14:00:00	3.62	4.98	Unit Shut down
02-Aug-24 15:00:00	3.60	4.95	Unit Shut down
02-Aug-24 16:00:00	3.59	4.89	Unit Shut down
02-Aug-24 17:00:00	3.57	4.95	Unit Shut down
02-Aug-24 18:00:00	3.61	4.98	Unit Shut down
02-Aug-24 19:00:00	3.54	4.93	Unit Shut down
02-Aug-24 20:00:00	3.53	4.94	Unit Shut down
02-Aug-24 21:00:00	3.55	4.90	Unit Shut down
02-Aug-24 22:00:00	3.57	4.94	Unit Shut down
02-Aug-24 23:00:00	3.64	4.96	Unit Shut down
03-Aug-24 00:00:00	3.64	4.91	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
03-Aug-24 01:00:00	3.65	4.98	Unit Shut down
03-Aug-24 02:00:00	3.67	4.98	Unit Shut down
03-Aug-24 03:00:00	3.71	4.92	Unit Shut down
03-Aug-24 04:00:00	3.75	4.90	Unit Shut down
03-Aug-24 05:00:00	3.76	4.88	Unit Shut down
03-Aug-24 06:00:00	3.73	4.98	Unit Shut down
03-Aug-24 07:00:00	3.65	4.93	Unit Shut down
03-Aug-24 08:00:00	3.66	4.91	Unit Shut down
03-Aug-24 09:00:00	3.69	4.87	Unit Shut down
03-Aug-24 10:00:00	3.68	4.93	Unit Shut down
03-Aug-24 11:00:00	3.63	Unit Shut down	Unit Shut down
03-Aug-24 12:00:00	3.67	Unit Shut down	Unit Shut down
03-Aug-24 13:00:00	3.71	Unit Shut down	Unit Shut down
03-Aug-24 14:00:00	3.65	Unit Shut down	Unit Shut down
03-Aug-24 15:00:00	3.61	Unit Shut down	Unit Shut down
03-Aug-24 16:00:00	3.60	Unit Shut down	Unit Shut down
03-Aug-24 17:00:00	3.61	4.91	Unit Shut down
03-Aug-24 18:00:00	3.59	4.87	Unit Shut down
03-Aug-24 19:00:00	3.54	4.98	Unit Shut down
03-Aug-24 20:00:00	3.57	4.87	Unit Shut down
03-Aug-24 21:00:00	3.59	4.97	Unit Shut down
03-Aug-24 22:00:00	3.58	4.93	Unit Shut down
03-Aug-24 23:00:00	3.77	4.90	Unit Shut down
04-Aug-24 00:00:00	3.47	4.98	Unit Shut down
04-Aug-24 01:00:00	3.32	4.91	Unit Shut down
04-Aug-24 02:00:00	3.35	4.89	Unit Shut down
04-Aug-24 03:00:00	3.40	4.98	Unit Shut down
04-Aug-24 04:00:00	3.43	4.98	Unit Shut down
04-Aug-24 05:00:00	3.42	4.97	Unit Shut down
04-Aug-24 06:00:00	3.43	4.95	Unit Shut down
04-Aug-24 07:00:00	3.42	4.95	Unit Shut down
04-Aug-24 08:00:00	3.43	4.96	Unit Shut down
04-Aug-24 09:00:00	3.49	4.95	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
04-Aug-24 10:00:00	3.76	4.97	Unit Shut down
04-Aug-24 11:00:00	3.81	4.87	Unit Shut down
04-Aug-24 12:00:00	3.74	4.92	Unit Shut down
04-Aug-24 13:00:00	3.68	4.99	Unit Shut down
04-Aug-24 14:00:00	3.65	4.89	Unit Shut down
04-Aug-24 15:00:00	3.62	4.95	Unit Shut down
04-Aug-24 16:00:00	3.61	4.89	Unit Shut down
04-Aug-24 17:00:00	3.65	4.87	Unit Shut down
04-Aug-24 18:00:00	3.72	4.92	Unit Shut down
04-Aug-24 19:00:00	3.73	4.94	Unit Shut down
04-Aug-24 20:00:00	3.71	4.95	Unit Shut down
04-Aug-24 21:00:00	3.72	4.90	Unit Shut down
04-Aug-24 22:00:00	3.73	4.89	Unit Shut down
04-Aug-24 23:00:00	3.80	4.96	Unit Shut down
05-Aug-24 00:00:00	3.80	4.93	Unit Shut down
05-Aug-24 01:00:00	3.83	4.88	Unit Shut down
05-Aug-24 02:00:00	3.81	4.98	Unit Shut down
05-Aug-24 03:00:00	3.77	4.96	Unit Shut down
05-Aug-24 04:00:00	3.80	4.92	Unit Shut down
05-Aug-24 05:00:00	3.83	4.95	Unit Shut down
05-Aug-24 06:00:00	3.86	4.89	Unit Shut down
05-Aug-24 07:00:00	3.85	4.90	Unit Shut down
05-Aug-24 08:00:00	3.95	4.92	Unit Shut down
05-Aug-24 09:00:00	3.95	4.90	Unit Shut down
05-Aug-24 10:00:00	3.94	4.98	Unit Shut down
05-Aug-24 11:00:00	3.93	4.92	Unit Shut down
05-Aug-24 12:00:00	3.88	4.93	Unit Shut down
05-Aug-24 13:00:00	3.82	4.88	Unit Shut down
05-Aug-24 14:00:00	3.79	4.95	Unit Shut down
05-Aug-24 15:00:00	3.79	4.97	Unit Shut down
05-Aug-24 16:00:00	3.77	4.90	Unit Shut down
05-Aug-24 17:00:00	3.77	4.90	Unit Shut down
05-Aug-24 18:00:00	3.70	4.96	Unit Shut down



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
05-Aug-24 19:00:00	3.73	4.91	Unit Shut down
05-Aug-24 20:00:00	3.77	4.98	Unit Shut down
05-Aug-24 21:00:00	3.83	4.92	Unit Shut down
05-Aug-24 22:00:00	3.83	4.92	Unit Shut down
05-Aug-24 23:00:00	3.80	4.96	Unit Shut down
06-Aug-24 00:00:00	3.75	4.88	Unit Shut down
06-Aug-24 01:00:00	3.74	4.90	Unit Shut down
06-Aug-24 02:00:00	3.75	4.93	Unit Shut down
06-Aug-24 03:00:00	3.77	4.96	Unit Shut down
06-Aug-24 04:00:00	3.79	4.99	Unit Shut down
06-Aug-24 05:00:00	3.83	4.91	Unit Shut down
06-Aug-24 06:00:00	3.89	4.94	Unit Shut down
06-Aug-24 07:00:00	3.89	4.89	Unit Shut down
06-Aug-24 08:00:00	3.96	4.94	Unit Shut down
06-Aug-24 09:00:00	3.97	4.88	Unit Shut down
06-Aug-24 10:00:00	3.94	4.96	Unit Shut down
06-Aug-24 11:00:00	3.86	4.94	Unit Shut down
06-Aug-24 12:00:00	3.78	4.98	Unit Shut down
06-Aug-24 13:00:00	3.83	4.94	Unit Shut down
06-Aug-24 14:00:00	3.83	4.95	4.99
06-Aug-24 15:00:00	3.80	4.94	4.99
06-Aug-24 16:00:00	3.70	4.90	4.99
06-Aug-24 17:00:00	3.70	4.94	Unit Shut down
06-Aug-24 18:00:00	3.68	4.94	Unit Shut down
06-Aug-24 19:00:00	3.65	4.94	4.99
06-Aug-24 20:00:00	3.68	4.94	Unit Shut down
06-Aug-24 21:00:00	3.63	4.96	Unit Shut down
06-Aug-24 22:00:00	3.67	4.89	Unit Shut down
06-Aug-24 23:00:00	3.71	4.98	Unit Shut down
07-Aug-24 00:00:00	3.71	4.91	Unit Shut down
07-Aug-24 01:00:00	3.71	4.91	Unit Shut down
07-Aug-24 02:00:00	3.70	4.90	Unit Shut down
07-Aug-24 03:00:00	3.69	4.97	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
07-Aug-24 04:00:00	3.68	4.94	Unit Shut down
07-Aug-24 05:00:00	3.71	4.92	Unit Shut down
07-Aug-24 06:00:00	3.71	4.96	Unit Shut down
07-Aug-24 07:00:00	3.69	4.90	Unit Shut down
07-Aug-24 08:00:00	3.70	4.96	Unit Shut down
07-Aug-24 09:00:00	3.77	4.89	Unit Shut down
07-Aug-24 10:00:00	3.79	4.87	Unit Shut down
07-Aug-24 11:00:00	3.74	4.96	Unit Shut down
07-Aug-24 12:00:00	3.72	4.92	Unit Shut down
07-Aug-24 13:00:00	3.72	4.89	Unit Shut down
07-Aug-24 14:00:00	3.72	4.97	Unit Shut down
07-Aug-24 15:00:00	3.67	4.93	Unit Shut down
07-Aug-24 16:00:00	3.63	4.97	Unit Shut down
07-Aug-24 17:00:00	3.63	4.99	Unit Shut down
07-Aug-24 18:00:00	3.64	4.94	Unit Shut down
07-Aug-24 19:00:00	3.64	4.99	4.99
07-Aug-24 20:00:00	3.65	4.95	Unit Shut down
07-Aug-24 21:00:00	3.61	4.90	Unit Shut down
07-Aug-24 22:00:00	3.67	4.96	Unit Shut down
07-Aug-24 23:00:00	3.71	4.97	Unit Shut down
08-Aug-24 00:00:00	3.71	4.89	Unit Shut down
08-Aug-24 01:00:00	3.73	4.93	Unit Shut down
08-Aug-24 02:00:00	3.72	4.91	Unit Shut down
08-Aug-24 03:00:00	3.73	4.99	Unit Shut down
08-Aug-24 04:00:00	3.73	4.97	Unit Shut down
08-Aug-24 05:00:00	3.73	4.94	Unit Shut down
08-Aug-24 06:00:00	3.76	4.89	Unit Shut down
08-Aug-24 07:00:00	3.73	4.91	Unit Shut down
08-Aug-24 08:00:00	3.79	4.96	Unit Shut down
08-Aug-24 09:00:00	3.83	4.91	Unit Shut down
08-Aug-24 10:00:00	3.79	4.88	Unit Shut down
08-Aug-24 11:00:00	3.77	4.91	Unit Shut down
08-Aug-24 12:00:00	3.70	4.91	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
08-Aug-24 13:00:00	3.76	4.94	Unit Shut down
08-Aug-24 14:00:00	3.71	4.97	4.99
08-Aug-24 15:00:00	3.72	4.97	4.99
08-Aug-24 16:00:00	3.72	4.96	4.99
08-Aug-24 17:00:00	3.74	4.89	4.99
08-Aug-24 18:00:00	3.73	4.91	4.99
08-Aug-24 19:00:00	3.71	4.94	4.99
08-Aug-24 20:00:00	3.66	4.97	4.99
08-Aug-24 21:00:00	3.63	4.93	Unit Shut down
08-Aug-24 22:00:00	3.66	4.96	Unit Shut down
08-Aug-24 23:00:00	3.71	4.88	Unit Shut down
09-Aug-24 00:00:00	3.70	4.95	Unit Shut down
09-Aug-24 01:00:00	3.69	4.88	Unit Shut down
09-Aug-24 02:00:00	3.69	4.97	Unit Shut down
09-Aug-24 03:00:00	3.68	4.89	Unit Shut down
09-Aug-24 04:00:00	3.67	4.95	Unit Shut down
09-Aug-24 05:00:00	3.66	4.99	Unit Shut down
09-Aug-24 06:00:00	3.70	4.96	Unit Shut down
09-Aug-24 07:00:00	3.64	4.99	Unit Shut down
09-Aug-24 08:00:00	3.64	4.94	Unit Shut down
09-Aug-24 09:00:00	3.68	4.98	Unit Shut down
09-Aug-24 10:00:00	3.67	4.95	Unit Shut down
09-Aug-24 11:00:00	3.64	4.90	Unit Shut down
09-Aug-24 12:00:00	3.59	4.97	Unit Shut down
09-Aug-24 13:00:00	3.69	4.97	Unit Shut down
09-Aug-24 14:00:00	3.71	4.98	4.99
09-Aug-24 15:00:00	3.69	4.87	4.99
09-Aug-24 16:00:00	3.67	4.93	4.99
09-Aug-24 17:00:00	3.65	4.91	4.99
09-Aug-24 18:00:00	3.65	4.98	4.99
09-Aug-24 19:00:00	3.62	4.91	4.99
09-Aug-24 20:00:00	3.66	4.93	4.99
09-Aug-24 21:00:00	3.69	4.88	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
09-Aug-24 22:00:00	3.67	4.88	Unit Shut down
09-Aug-24 23:00:00	3.64	4.98	Unit Shut down
10-Aug-24 00:00:00	3.61	4.91	Unit Shut down
10-Aug-24 01:00:00	3.66	4.98	Unit Shut down
10-Aug-24 02:00:00	3.69	4.96	Unit Shut down
10-Aug-24 03:00:00	3.68	4.91	Unit Shut down
10-Aug-24 04:00:00	3.69	4.87	Unit Shut down
10-Aug-24 05:00:00	3.71	4.96	Unit Shut down
10-Aug-24 06:00:00	3.71	4.94	Unit Shut down
10-Aug-24 07:00:00	3.72	4.93	Unit Shut down
10-Aug-24 08:00:00	3.76	4.98	Unit Shut down
10-Aug-24 09:00:00	3.83	4.94	Unit Shut down
10-Aug-24 10:00:00	3.83	4.97	Unit Shut down
10-Aug-24 11:00:00	3.80	4.96	4.99
10-Aug-24 12:00:00	3.73	4.91	Unit Shut down
10-Aug-24 13:00:00	3.73	4.96	Unit Shut down
10-Aug-24 14:00:00	3.77	4.92	4.99
10-Aug-24 15:00:00	3.75	4.98	4.99
10-Aug-24 16:00:00	3.73	4.98	4.99
10-Aug-24 17:00:00	3.73	4.91	4.99
10-Aug-24 18:00:00	3.74	4.90	4.99
10-Aug-24 19:00:00	3.72	4.90	Unit Shut down
10-Aug-24 20:00:00	3.75	4.94	Unit Shut down
10-Aug-24 21:00:00	3.80	4.89	Unit Shut down
10-Aug-24 22:00:00	3.79	4.91	Unit Shut down
10-Aug-24 23:00:00	3.74	4.98	Unit Shut down
11-Aug-24 00:00:00	3.72	4.90	Unit Shut down
11-Aug-24 01:00:00	3.73	4.89	Unit Shut down
11-Aug-24 02:00:00	3.73	4.94	Unit Shut down
11-Aug-24 03:00:00	3.74	4.90	Unit Shut down
11-Aug-24 04:00:00	3.73	4.91	Unit Shut down
11-Aug-24 05:00:00	3.74	4.97	Unit Shut down
11-Aug-24 06:00:00	3.76	4.99	Unit Shut down



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
11-Aug-24 07:00:00	3.70	4.88	Unit Shut down
11-Aug-24 08:00:00	3.75	4.99	Unit Shut down
11-Aug-24 09:00:00	3.76	4.92	Unit Shut down
11-Aug-24 10:00:00	3.76	4.92	Unit Shut down
11-Aug-24 11:00:00	3.75	4.96	Unit Shut down
11-Aug-24 12:00:00	3.74	4.89	Unit Shut down
11-Aug-24 13:00:00	3.72	4.94	Unit Shut down
11-Aug-24 14:00:00	3.70	4.96	Unit Shut down
11-Aug-24 15:00:00	3.66	4.98	Unit Shut down
11-Aug-24 16:00:00	3.63	4.90	Unit Shut down
11-Aug-24 17:00:00	3.62	4.92	Unit Shut down
11-Aug-24 18:00:00	3.62	4.91	Unit Shut down
11-Aug-24 19:00:00	3.66	4.91	Unit Shut down
11-Aug-24 20:00:00	3.61	4.98	Unit Shut down
11-Aug-24 21:00:00	3.58	4.94	Unit Shut down
11-Aug-24 22:00:00	3.61	4.95	Unit Shut down
11-Aug-24 23:00:00	3.68	4.97	Unit Shut down
12-Aug-24 00:00:00	3.72	4.96	Unit Shut down
12-Aug-24 01:00:00	3.70	4.89	Unit Shut down
12-Aug-24 02:00:00	3.71	4.99	Unit Shut down
12-Aug-24 03:00:00	3.77	4.96	Unit Shut down
12-Aug-24 04:00:00	3.76	4.94	Unit Shut down
12-Aug-24 05:00:00	3.78	4.93	Unit Shut down
12-Aug-24 06:00:00	3.78	4.98	Unit Shut down
12-Aug-24 07:00:00	3.81	4.90	Unit Shut down
12-Aug-24 08:00:00	3.72	4.88	Unit Shut down
12-Aug-24 09:00:00	3.70	4.88	Unit Shut down
12-Aug-24 10:00:00	3.71	4.95	Unit Shut down
12-Aug-24 11:00:00	3.69	4.87	Unit Shut down
12-Aug-24 12:00:00	3.68	4.96	Unit Shut down
12-Aug-24 13:00:00	3.66	4.87	Unit Shut down
12-Aug-24 14:00:00	3.64	4.97	Unit Shut down
12-Aug-24 15:00:00	3.63	4.88	Unit Shut down

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
12-Aug-24 16:00:00	3.63	4.89	Unit Shut down
12-Aug-24 17:00:00	3.68	4.90	Unit Shut down
12-Aug-24 18:00:00	3.69	4.88	Unit Shut down
12-Aug-24 19:00:00	3.68	4.89	Unit Shut down
12-Aug-24 20:00:00	3.68	4.93	Unit Shut down
12-Aug-24 21:00:00	3.73	4.94	4.89
12-Aug-24 22:00:00	3.74	4.90	3.71
12-Aug-24 23:00:00	3.74	4.88	3.62
13-Aug-24 00:00:00	3.74	4.93	4.54
13-Aug-24 01:00:00	3.76	4.90	4.88
13-Aug-24 02:00:00	3.70	4.92	4.97
13-Aug-24 03:00:00	3.66	4.90	4.91
13-Aug-24 04:00:00	3.68	4.96	4.93
13-Aug-24 05:00:00	3.66	4.91	4.91
13-Aug-24 06:00:00	3.70	4.95	4.94
13-Aug-24 07:00:00	3.64	4.97	4.95
13-Aug-24 08:00:00	3.66	4.91	4.87
13-Aug-24 09:00:00	3.70	4.93	4.88
13-Aug-24 10:00:00	3.79	4.88	4.97
13-Aug-24 11:00:00	3.75	4.88	4.98
13-Aug-24 12:00:00	3.61	4.96	4.95
13-Aug-24 13:00:00	3.62	4.92	4.91
13-Aug-24 14:00:00	3.58	4.98	4.91
13-Aug-24 15:00:00	3.65	4.90	4.96
13-Aug-24 16:00:00	3.61	4.91	4.88
13-Aug-24 17:00:00	3.63	4.88	4.98
13-Aug-24 18:00:00	3.69	4.95	4.89
13-Aug-24 19:00:00	3.71	4.91	4.99
13-Aug-24 20:00:00	3.73	4.94	4.89
13-Aug-24 21:00:00	3.74	4.91	4.93
13-Aug-24 22:00:00	3.74	4.88	4.91
13-Aug-24 23:00:00	3.79	4.92	4.94
14-Aug-24 00:00:00	3.79	4.96	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
14-Aug-24 01:00:00	3.81	4.90	4.95
14-Aug-24 02:00:00	3.82	4.95	4.94
14-Aug-24 03:00:00	3.84	4.97	4.90
14-Aug-24 04:00:00	3.77	4.91	4.93
14-Aug-24 05:00:00	3.73	4.91	4.87
14-Aug-24 06:00:00	3.72	4.92	4.91
14-Aug-24 07:00:00	3.69	4.93	4.90
14-Aug-24 08:00:00	3.72	4.95	4.94
14-Aug-24 09:00:00	3.90	4.96	4.95
14-Aug-24 10:00:00	3.89	4.97	4.89
14-Aug-24 11:00:00	3.83	4.88	4.97
14-Aug-24 12:00:00	3.64	4.88	4.90
14-Aug-24 13:00:00	3.68	4.88	4.93
14-Aug-24 14:00:00	3.75	4.88	4.93
14-Aug-24 15:00:00	3.66	4.99	4.93
14-Aug-24 16:00:00	3.74	4.96	4.91
14-Aug-24 17:00:00	3.61	4.89	4.94
14-Aug-24 18:00:00	3.61	4.98	4.87
14-Aug-24 19:00:00	3.63	4.99	4.98
14-Aug-24 20:00:00	3.66	4.94	4.94
14-Aug-24 21:00:00	3.65	4.89	4.87
14-Aug-24 22:00:00	3.66	4.93	4.92
14-Aug-24 23:00:00	3.75	4.91	4.96
15-Aug-24 00:00:00	3.77	4.97	4.91
15-Aug-24 01:00:00	3.77	4.94	4.88
15-Aug-24 02:00:00	3.79	4.97	4.90
15-Aug-24 03:00:00	3.82	4.91	4.91
15-Aug-24 04:00:00	3.84	4.96	4.92
15-Aug-24 05:00:00	3.85	4.90	4.92
15-Aug-24 06:00:00	3.84	4.88	4.98
15-Aug-24 07:00:00	3.80	4.90	4.96
15-Aug-24 08:00:00	3.84	4.95	4.91
15-Aug-24 09:00:00	3.87	4.98	4.92

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
15-Aug-24 10:00:00	3.85	4.91	4.98
15-Aug-24 11:00:00	3.81	4.89	4.88
15-Aug-24 12:00:00	3.77	4.94	4.98
15-Aug-24 13:00:00	3.74	4.97	4.98
15-Aug-24 14:00:00	3.70	4.96	4.91
15-Aug-24 15:00:00	3.69	4.88	4.94
15-Aug-24 16:00:00	3.68	4.98	4.90
15-Aug-24 17:00:00	3.70	4.95	4.97
15-Aug-24 18:00:00	3.71	4.90	4.95
15-Aug-24 19:00:00	3.72	4.92	4.89
15-Aug-24 20:00:00	3.72	4.90	4.99
15-Aug-24 21:00:00	3.71	4.98	4.92
15-Aug-24 22:00:00	3.74	4.92	4.90
15-Aug-24 23:00:00	3.79	4.97	4.99
16-Aug-24 00:00:00	3.83	4.90	4.96
16-Aug-24 01:00:00	3.87	4.87	4.98
16-Aug-24 02:00:00	3.87	4.88	4.93
16-Aug-24 03:00:00	3.88	4.94	4.88
16-Aug-24 04:00:00	3.91	4.90	4.93
16-Aug-24 05:00:00	3.92	4.88	4.90
16-Aug-24 06:00:00	3.92	4.93	4.91
16-Aug-24 07:00:00	3.87	4.93	4.90
16-Aug-24 08:00:00	3.87	4.91	4.92
16-Aug-24 09:00:00	3.86	4.92	4.91
16-Aug-24 10:00:00	3.84	4.97	4.98
16-Aug-24 11:00:00	3.79	4.90	4.90
16-Aug-24 12:00:00	3.73	4.98	4.94
16-Aug-24 13:00:00	3.75	4.98	4.88
16-Aug-24 14:00:00	3.84	4.93	4.92
16-Aug-24 15:00:00	3.86	4.87	4.97
16-Aug-24 16:00:00	3.82	4.97	4.94
16-Aug-24 17:00:00	3.73	4.95	4.95
16-Aug-24 18:00:00	3.64	4.95	4.92



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
16-Aug-24 19:00:00	3.64	4.96	4.89
16-Aug-24 20:00:00	3.63	4.94	4.88
16-Aug-24 21:00:00	3.61	4.87	4.89
16-Aug-24 22:00:00	3.64	4.96	4.92
16-Aug-24 23:00:00	3.70	4.98	4.98
17-Aug-24 00:00:00	3.71	4.97	4.99
17-Aug-24 01:00:00	3.72	4.95	4.88
17-Aug-24 02:00:00	3.73	4.93	4.97
17-Aug-24 03:00:00	3.75	4.88	4.99
17-Aug-24 04:00:00	3.78	4.97	4.89
17-Aug-24 05:00:00	3.79	4.96	4.91
17-Aug-24 06:00:00	3.80	4.93	4.90
17-Aug-24 07:00:00	3.77	4.96	4.90
17-Aug-24 08:00:00	3.81	4.97	4.99
17-Aug-24 09:00:00	3.81	4.88	4.94
17-Aug-24 10:00:00	3.79	4.88	4.89
17-Aug-24 11:00:00	3.73	4.99	4.89
17-Aug-24 12:00:00	3.63	4.99	4.93
17-Aug-24 13:00:00	3.66	4.99	4.98
17-Aug-24 14:00:00	3.70	4.99	4.94
17-Aug-24 15:00:00	3.65	4.87	4.98
17-Aug-24 16:00:00	3.65	4.97	4.90
17-Aug-24 17:00:00	3.63	4.99	4.92
17-Aug-24 18:00:00	3.61	4.99	4.87
17-Aug-24 19:00:00	3.62	4.99	4.95
17-Aug-24 20:00:00	3.64	4.95	4.97
17-Aug-24 21:00:00	3.61	4.87	4.88
17-Aug-24 22:00:00	3.67	4.90	4.92
17-Aug-24 23:00:00	3.71	4.92	4.97
18-Aug-24 00:00:00	3.70	4.94	4.98
18-Aug-24 01:00:00	3.72	4.95	4.88
18-Aug-24 02:00:00	3.73	4.88	4.88
18-Aug-24 03:00:00	3.76	4.91	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
18-Aug-24 04:00:00	3.79	4.94	4.90
18-Aug-24 05:00:00	3.81	4.99	4.88
18-Aug-24 06:00:00	3.83	4.90	4.94
18-Aug-24 07:00:00	3.79	4.97	4.92
18-Aug-24 08:00:00	3.74	4.89	4.98
18-Aug-24 09:00:00	3.80	4.97	4.93
18-Aug-24 10:00:00	3.78	4.94	4.88
18-Aug-24 11:00:00	3.73	4.90	4.93
18-Aug-24 12:00:00	3.70	4.97	4.99
18-Aug-24 13:00:00	3.68	4.92	4.97
18-Aug-24 14:00:00	3.66	4.98	4.99
18-Aug-24 15:00:00	3.65	4.99	4.99
18-Aug-24 16:00:00	3.63	4.97	4.99
18-Aug-24 17:00:00	3.60	4.90	4.99
18-Aug-24 18:00:00	3.62	4.88	4.95
18-Aug-24 19:00:00	3.64	4.87	4.96
18-Aug-24 20:00:00	3.66	4.93	4.92
18-Aug-24 21:00:00	3.61	4.87	4.96
18-Aug-24 22:00:00	3.63	4.92	4.96
18-Aug-24 23:00:00	3.62	4.87	4.91
19-Aug-24 00:00:00	3.61	4.94	4.89
19-Aug-24 01:00:00	3.58	4.88	4.88
19-Aug-24 02:00:00	3.59	4.96	4.89
19-Aug-24 03:00:00	3.60	4.89	4.93
19-Aug-24 04:00:00	3.62	4.94	4.89
19-Aug-24 05:00:00	3.63	4.94	4.95
19-Aug-24 06:00:00	3.67	4.92	4.98
19-Aug-24 07:00:00	3.76	4.93	4.89
19-Aug-24 08:00:00	3.98	4.99	4.88
19-Aug-24 09:00:00	3.99	4.96	4.92
19-Aug-24 10:00:00	3.95	4.92	4.90
19-Aug-24 11:00:00	3.90	4.94	4.88
19-Aug-24 12:00:00	3.76	4.95	4.95

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
19-Aug-24 13:00:00	3.78	4.94	4.96
19-Aug-24 14:00:00	3.79	4.94	4.89
19-Aug-24 15:00:00	3.74	4.92	4.92
19-Aug-24 16:00:00	3.72	4.98	4.91
19-Aug-24 17:00:00	3.71	4.89	4.89
19-Aug-24 18:00:00	3.39	4.94	4.94
19-Aug-24 19:00:00	2.76	4.99	4.88
19-Aug-24 20:00:00	2.74	4.91	4.88
19-Aug-24 21:00:00	2.95	4.98	4.94
19-Aug-24 22:00:00	3.01	4.98	4.93
19-Aug-24 23:00:00	2.96	4.89	4.97
20-Aug-24 00:00:00	2.85	4.90	4.91
20-Aug-24 01:00:00	2.82	4.90	4.93
20-Aug-24 02:00:00	2.68	4.96	4.90
20-Aug-24 03:00:00	2.64	4.92	4.88
20-Aug-24 04:00:00	2.60	4.99	4.96
20-Aug-24 05:00:00	2.44	4.96	4.88
20-Aug-24 06:00:00	2.37	4.91	4.93
20-Aug-24 07:00:00	1.88	4.90	4.97
20-Aug-24 08:00:00	Unit Shut down	4.95	4.90
20-Aug-24 09:00:00	Unit Shut down	4.98	4.94
20-Aug-24 10:00:00	Unit Shut down	4.94	4.98
20-Aug-24 11:00:00	Unit Shut down	4.94	4.93
20-Aug-24 12:00:00	Unit Shut down	4.97	4.94
20-Aug-24 13:00:00	Unit Shut down	4.89	4.90
20-Aug-24 14:00:00	Unit Shut down	4.92	4.89
20-Aug-24 15:00:00	Unit Shut down	4.94	4.97
20-Aug-24 16:00:00	Unit Shut down	4.95	4.97
20-Aug-24 17:00:00	Unit Shut down	4.95	4.98
20-Aug-24 18:00:00	Unit Shut down	4.93	4.88
20-Aug-24 19:00:00	Unit Shut down	4.89	4.93
20-Aug-24 20:00:00	Unit Shut down	4.95	4.94
20-Aug-24 21:00:00	Unit Shut down	4.91	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
20-Aug-24 22:00:00	Unit Shut down	4.96	4.98
20-Aug-24 23:00:00	Unit Shut down	4.88	4.90
21-Aug-24 00:00:00	Unit Shut down	4.89	4.99
21-Aug-24 01:00:00	Unit Shut down	4.95	4.98
21-Aug-24 02:00:00	Unit Shut down	4.90	4.89
21-Aug-24 03:00:00	Unit Shut down	4.93	4.88
21-Aug-24 04:00:00	Unit Shut down	4.98	4.90
21-Aug-24 05:00:00	Unit Shut down	4.97	4.94
21-Aug-24 06:00:00	Unit Shut down	4.87	4.96
21-Aug-24 07:00:00	Unit Shut down	4.93	4.98
21-Aug-24 08:00:00	Unit Shut down	4.91	4.91
21-Aug-24 09:00:00	Unit Shut down	4.88	4.97
21-Aug-24 10:00:00	Unit Shut down	4.96	4.89
21-Aug-24 11:00:00	Unit Shut down	4.97	4.97
21-Aug-24 12:00:00	Unit Shut down	4.94	4.99
21-Aug-24 13:00:00	Unit Shut down	4.95	4.99
21-Aug-24 14:00:00	Unit Shut down	4.91	4.99
21-Aug-24 15:00:00	Unit Shut down	4.87	4.99
21-Aug-24 16:00:00	Unit Shut down	4.95	4.99
21-Aug-24 17:00:00	Unit Shut down	4.97	4.99
21-Aug-24 18:00:00	Unit Shut down	4.97	4.99
21-Aug-24 19:00:00	Unit Shut down	4.93	4.99
21-Aug-24 20:00:00	Unit Shut down	4.98	4.94
21-Aug-24 21:00:00	Unit Shut down	4.94	4.92
21-Aug-24 22:00:00	Unit Shut down	4.92	4.91
21-Aug-24 23:00:00	Unit Shut down	4.91	4.99
22-Aug-24 00:00:00	Unit Shut down	4.89	4.92
22-Aug-24 01:00:00	Unit Shut down	4.92	4.95
22-Aug-24 02:00:00	Unit Shut down	4.99	4.94
22-Aug-24 03:00:00	Unit Shut down	4.91	4.93
22-Aug-24 04:00:00	Unit Shut down	4.94	4.95
22-Aug-24 05:00:00	Unit Shut down	4.90	4.93
22-Aug-24 06:00:00	Unit Shut down	4.99	4.88



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
22-Aug-24 07:00:00	Unit Shut down	4.88	4.99
22-Aug-24 08:00:00	Unit Shut down	4.95	4.96
22-Aug-24 09:00:00	Unit Shut down	4.94	4.95
22-Aug-24 10:00:00	Unit Shut down	4.89	4.98
22-Aug-24 11:00:00	Unit Shut down	4.89	4.98
22-Aug-24 12:00:00	Unit Shut down	4.90	4.99
22-Aug-24 13:00:00	Unit Shut down	4.92	4.98
22-Aug-24 14:00:00	Unit Shut down	4.95	4.90
22-Aug-24 15:00:00	Unit Shut down	4.96	4.90
22-Aug-24 16:00:00	Unit Shut down	4.95	4.99
22-Aug-24 17:00:00	Unit Shut down	4.88	4.97
22-Aug-24 18:00:00	Unit Shut down	4.91	4.98
22-Aug-24 19:00:00	Unit Shut down	4.95	4.96
22-Aug-24 20:00:00	Unit Shut down	4.90	4.89
22-Aug-24 21:00:00	Unit Shut down	4.92	4.97
22-Aug-24 22:00:00	Unit Shut down	4.90	4.94
22-Aug-24 23:00:00	Unit Shut down	4.98	4.91
23-Aug-24 00:00:00	Unit Shut down	4.96	4.89
23-Aug-24 01:00:00	Unit Shut down	4.91	4.93
23-Aug-24 02:00:00	Unit Shut down	4.90	4.96
23-Aug-24 03:00:00	Unit Shut down	4.90	4.96
23-Aug-24 04:00:00	Unit Shut down	4.96	4.98
23-Aug-24 05:00:00	Unit Shut down	4.97	4.92
23-Aug-24 06:00:00	Unit Shut down	4.96	4.96
23-Aug-24 07:00:00	Unit Shut down	4.87	4.88
23-Aug-24 08:00:00	Unit Shut down	4.99	4.98
23-Aug-24 09:00:00	Unit Shut down	4.91	4.97
23-Aug-24 10:00:00	Unit Shut down	4.94	4.97
23-Aug-24 11:00:00	Unit Shut down	4.95	4.97
23-Aug-24 12:00:00	Unit Shut down	4.94	4.96
23-Aug-24 13:00:00	Unit Shut down	4.96	4.98
23-Aug-24 14:00:00	Unit Shut down	4.88	4.94
23-Aug-24 15:00:00	Unit Shut down	4.88	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
23-Aug-24 16:00:00	Unit Shut down	4.95	4.99
23-Aug-24 17:00:00	Unit Shut down	4.90	4.94
23-Aug-24 18:00:00	Unit Shut down	4.93	4.88
23-Aug-24 19:00:00	Unit Shut down	4.92	4.98
23-Aug-24 20:00:00	Unit Shut down	4.91	4.98
23-Aug-24 21:00:00	Unit Shut down	4.89	4.97
23-Aug-24 22:00:00	Unit Shut down	4.90	4.97
23-Aug-24 23:00:00	Unit Shut down	4.97	4.96
24-Aug-24 00:00:00	Unit Shut down	4.91	4.95
24-Aug-24 01:00:00	Unit Shut down	4.98	4.92
24-Aug-24 02:00:00	Unit Shut down	4.97	4.93
24-Aug-24 03:00:00	Unit Shut down	4.96	4.97
24-Aug-24 04:00:00	Unit Shut down	4.97	4.93
24-Aug-24 05:00:00	Unit Shut down	4.91	4.91
24-Aug-24 06:00:00	Unit Shut down	4.89	4.88
24-Aug-24 07:00:00	Unit Shut down	4.96	4.94
24-Aug-24 08:00:00	Unit Shut down	4.90	4.98
24-Aug-24 09:00:00	Unit Shut down	4.93	4.93
24-Aug-24 10:00:00	Unit Shut down	4.88	4.88
24-Aug-24 11:00:00	Unit Shut down	4.99	4.92
24-Aug-24 12:00:00	Unit Shut down	4.88	4.90
24-Aug-24 13:00:00	Unit Shut down	4.97	4.96
24-Aug-24 14:00:00	Unit Shut down	4.93	4.93
24-Aug-24 15:00:00	Unit Shut down	4.89	4.89
24-Aug-24 16:00:00	Unit Shut down	4.89	4.93
24-Aug-24 17:00:00	Unit Shut down	4.98	4.94
24-Aug-24 18:00:00	Unit Shut down	4.98	4.97
24-Aug-24 19:00:00	Unit Shut down	4.93	4.96
24-Aug-24 20:00:00	Unit Shut down	4.93	4.87
24-Aug-24 21:00:00	Unit Shut down	4.91	4.94
24-Aug-24 22:00:00	Unit Shut down	4.99	4.88
24-Aug-24 23:00:00	Unit Shut down	4.91	4.90
25-Aug-24 00:00:00	Unit Shut down	4.95	4.99

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
25-Aug-24 01:00:00	Unit Shut down	4.91	4.96
25-Aug-24 02:00:00	Unit Shut down	4.93	4.88
25-Aug-24 03:00:00	Unit Shut down	4.96	4.92
25-Aug-24 04:00:00	Unit Shut down	4.94	4.99
25-Aug-24 05:00:00	Unit Shut down	4.91	4.91
25-Aug-24 06:00:00	Unit Shut down	4.96	4.98
25-Aug-24 07:00:00	Unit Shut down	4.92	4.88
25-Aug-24 08:00:00	Unit Shut down	4.90	4.93
25-Aug-24 09:00:00	Unit Shut down	4.98	4.90
25-Aug-24 10:00:00	Unit Shut down	4.94	4.94
25-Aug-24 11:00:00	Unit Shut down	4.98	4.90
25-Aug-24 12:00:00	Unit Shut down	4.89	4.99
25-Aug-24 13:00:00	Unit Shut down	4.93	4.89
25-Aug-24 14:00:00	Unit Shut down	4.87	4.97
25-Aug-24 15:00:00	Unit Shut down	4.90	4.90
25-Aug-24 16:00:00	Unit Shut down	4.95	4.94
25-Aug-24 17:00:00	Unit Shut down	4.98	4.93
25-Aug-24 18:00:00	Unit Shut down	4.96	4.91
25-Aug-24 19:00:00	Unit Shut down	4.89	4.96
25-Aug-24 20:00:00	Unit Shut down	4.94	4.98
25-Aug-24 21:00:00	Unit Shut down	4.88	4.88
25-Aug-24 22:00:00	Unit Shut down	4.90	4.88
25-Aug-24 23:00:00	Unit Shut down	4.98	4.97
26-Aug-24 00:00:00	Unit Shut down	4.92	4.94
26-Aug-24 01:00:00	Unit Shut down	4.98	4.91
26-Aug-24 02:00:00	Unit Shut down	4.97	4.92
26-Aug-24 03:00:00	Unit Shut down	4.88	4.98
26-Aug-24 04:00:00	Unit Shut down	4.99	4.92
26-Aug-24 05:00:00	Unit Shut down	4.96	4.89
26-Aug-24 06:00:00	Unit Shut down	4.93	4.96
26-Aug-24 07:00:00	Unit Shut down	4.92	4.90
26-Aug-24 08:00:00	Unit Shut down	4.90	4.87
26-Aug-24 09:00:00	Unit Shut down	4.87	4.89

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
26-Aug-24 10:00:00	Unit Shut down	4.87	4.90
26-Aug-24 11:00:00	Unit Shut down	4.93	4.98
26-Aug-24 12:00:00	Unit Shut down	4.92	4.91
26-Aug-24 13:00:00	Unit Shut down	4.94	4.99
26-Aug-24 14:00:00	Unit Shut down	4.95	4.89
26-Aug-24 15:00:00	Unit Shut down	4.91	4.98
26-Aug-24 16:00:00	Unit Shut down	4.88	4.98
26-Aug-24 17:00:00	Unit Shut down	4.98	4.92
26-Aug-24 18:00:00	Unit Shut down	4.96	4.96
26-Aug-24 19:00:00	Unit Shut down	4.90	4.96
26-Aug-24 20:00:00	Unit Shut down	4.92	4.91
26-Aug-24 21:00:00	Unit Shut down	4.92	4.93
26-Aug-24 22:00:00	Unit Shut down	4.93	4.93
26-Aug-24 23:00:00	Unit Shut down	4.98	4.91
27-Aug-24 00:00:00	Unit Shut down	4.89	4.89
27-Aug-24 01:00:00	Unit Shut down	4.89	4.91
27-Aug-24 02:00:00	Unit Shut down	4.89	4.90
27-Aug-24 03:00:00	Unit Shut down	4.91	4.93
27-Aug-24 04:00:00	Unit Shut down	4.97	4.87
27-Aug-24 05:00:00	Unit Shut down	4.97	4.98
27-Aug-24 06:00:00	Unit Shut down	4.90	4.89
27-Aug-24 07:00:00	Unit Shut down	4.92	4.88
27-Aug-24 08:00:00	Unit Shut down	4.91	4.88
27-Aug-24 09:00:00	Unit Shut down	4.94	4.98
27-Aug-24 10:00:00	Unit Shut down	4.88	4.96
27-Aug-24 11:00:00	Unit Shut down	4.98	4.90
27-Aug-24 12:00:00	Unit Shut down	4.92	4.96
27-Aug-24 13:00:00	Unit Shut down	4.91	4.87
27-Aug-24 14:00:00	Unit Shut down	4.92	4.95
27-Aug-24 15:00:00	Unit Shut down	4.93	4.88
27-Aug-24 16:00:00	Unit Shut down	4.90	4.90
27-Aug-24 17:00:00	Unit Shut down	4.91	4.93
27-Aug-24 18:00:00	Unit Shut down	4.89	4.88



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
27-Aug-24 19:00:00	Unit Shut down	4.90	4.99
27-Aug-24 20:00:00	Unit Shut down	4.90	4.99
27-Aug-24 21:00:00	Unit Shut down	4.96	4.99
27-Aug-24 22:00:00	Unit Shut down	4.98	4.90
27-Aug-24 23:00:00	Unit Shut down	4.93	4.97
28-Aug-24 00:00:00	Unit Shut down	4.94	4.93
28-Aug-24 01:00:00	Unit Shut down	4.96	4.88
28-Aug-24 02:00:00	Unit Shut down	4.87	4.92
28-Aug-24 03:00:00	Unit Shut down	4.88	4.87
28-Aug-24 04:00:00	Unit Shut down	4.95	4.89
28-Aug-24 05:00:00	Unit Shut down	4.90	4.99
28-Aug-24 06:00:00	Unit Shut down	4.89	4.91
28-Aug-24 07:00:00	Unit Shut down	4.96	4.99
28-Aug-24 08:00:00	Unit Shut down	4.94	4.99
28-Aug-24 09:00:00	Unit Shut down	4.98	4.99
28-Aug-24 10:00:00	Unit Shut down	4.92	4.99
28-Aug-24 11:00:00	Unit Shut down	4.96	4.99
28-Aug-24 12:00:00	Unit Shut down	4.91	4.99
28-Aug-24 13:00:00	Unit Shut down	4.98	4.93
28-Aug-24 14:00:00	Unit Shut down	4.93	4.94
28-Aug-24 15:00:00	Unit Shut down	4.96	4.94
28-Aug-24 16:00:00	Unit Shut down	4.88	4.94
28-Aug-24 17:00:00	Unit Shut down	4.99	4.88
28-Aug-24 18:00:00	Unit Shut down	4.94	4.96
28-Aug-24 19:00:00	Unit Shut down	4.88	4.99
28-Aug-24 20:00:00	Unit Shut down	4.95	4.99
28-Aug-24 21:00:00	Unit Shut down	4.92	4.87
28-Aug-24 22:00:00	Unit Shut down	4.88	4.90
28-Aug-24 23:00:00	Unit Shut down	4.93	4.88
29-Aug-24 00:00:00	Unit Shut down	4.88	4.92
29-Aug-24 01:00:00	Unit Shut down	4.94	4.93
29-Aug-24 02:00:00	Unit Shut down	4.93	4.87
29-Aug-24 03:00:00	Unit Shut down	4.97	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
29-Aug-24 04:00:00	Unit Shut down	4.98	4.91
29-Aug-24 05:00:00	Unit Shut down	4.92	4.96
29-Aug-24 06:00:00	Unit Shut down	4.92	4.96
29-Aug-24 07:00:00	Unit Shut down	4.89	4.89
29-Aug-24 08:00:00	Unit Shut down	4.90	4.91
29-Aug-24 09:00:00	Unit Shut down	4.92	4.99
29-Aug-24 10:00:00	Unit Shut down	4.94	4.93
29-Aug-24 11:00:00	Unit Shut down	4.90	4.97
29-Aug-24 12:00:00	Unit Shut down	4.88	4.97
29-Aug-24 13:00:00	Unit Shut down	4.93	4.99
29-Aug-24 14:00:00	Unit Shut down	4.97	4.99
29-Aug-24 15:00:00	Unit Shut down	4.88	4.89
29-Aug-24 16:00:00	Unit Shut down	4.96	4.98
29-Aug-24 17:00:00	Unit Shut down	4.97	4.99
29-Aug-24 18:00:00	Unit Shut down	4.95	4.94
29-Aug-24 19:00:00	Unit Shut down	4.91	4.97
29-Aug-24 20:00:00	Unit Shut down	4.91	4.91
29-Aug-24 21:00:00	Unit Shut down	4.96	4.95
29-Aug-24 22:00:00	Unit Shut down	4.98	4.99
29-Aug-24 23:00:00	Unit Shut down	4.93	4.99
30-Aug-24 00:00:00	Unit Shut down	4.96	4.99
30-Aug-24 01:00:00	Unit Shut down	4.93	4.99
30-Aug-24 02:00:00	Unit Shut down	4.98	4.99
30-Aug-24 03:00:00	Unit Shut down	4.98	4.99
30-Aug-24 04:00:00	Unit Shut down	4.87	4.99
30-Aug-24 05:00:00	Unit Shut down	4.92	4.99
30-Aug-24 06:00:00	Unit Shut down	4.89	4.99
30-Aug-24 07:00:00	Unit Shut down	4.87	4.99
30-Aug-24 08:00:00	Unit Shut down	4.87	4.99
30-Aug-24 09:00:00	Unit Shut down	4.88	4.99
30-Aug-24 10:00:00	Unit Shut down	4.97	4.94
30-Aug-24 11:00:00	Unit Shut down	4.95	4.93
30-Aug-24 12:00:00	Unit Shut down	4.87	4.87

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
30-Aug-24 13:00:00	Unit Shut down	4.95	4.92
30-Aug-24 14:00:00	Unit Shut down	4.88	4.92
30-Aug-24 15:00:00	Unit Shut down	4.97	4.91
30-Aug-24 16:00:00	Unit Shut down	4.90	4.88
30-Aug-24 17:00:00	Unit Shut down	4.97	4.89
30-Aug-24 18:00:00	Unit Shut down	4.88	4.94
30-Aug-24 19:00:00	Unit Shut down	4.92	4.89
30-Aug-24 20:00:00	Unit Shut down	4.92	4.94
30-Aug-24 21:00:00	Unit Shut down	4.99	4.96
30-Aug-24 22:00:00	Unit Shut down	4.92	4.92
30-Aug-24 23:00:00	Unit Shut down	4.89	4.97
31-Aug-24 00:00:00	Unit Shut down	4.96	4.92
31-Aug-24 01:00:00	Unit Shut down	4.88	4.87
31-Aug-24 02:00:00	Unit Shut down	4.97	4.93
31-Aug-24 03:00:00	Unit Shut down	4.96	4.90
31-Aug-24 04:00:00	Unit Shut down	4.88	4.99
31-Aug-24 05:00:00	Unit Shut down	4.88	4.96
31-Aug-24 06:00:00	Unit Shut down	4.91	4.93
31-Aug-24 07:00:00	Unit Shut down	4.96	4.95
31-Aug-24 08:00:00	Unit Shut down	4.89	4.95
31-Aug-24 09:00:00	Unit Shut down	4.89	4.91
31-Aug-24 10:00:00	Unit Shut down	4.94	4.95
31-Aug-24 11:00:00	Unit Shut down	4.89	4.91
31-Aug-24 12:00:00	Unit Shut down	4.91	4.91
31-Aug-24 13:00:00	Unit Shut down	4.93	4.92
31-Aug-24 14:00:00	Unit Shut down	4.89	4.90
31-Aug-24 15:00:00	Unit Shut down	4.89	4.89
31-Aug-24 16:00:00	Unit Shut down	4.99	4.90
31-Aug-24 17:00:00	Unit Shut down	4.93	4.92
31-Aug-24 18:00:00	Unit Shut down	4.98	4.88
31-Aug-24 19:00:00	Unit Shut down	4.92	4.92
31-Aug-24 20:00:00	Unit Shut down	4.94	4.88
31-Aug-24 21:00:00	Unit Shut down	4.93	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
31-Aug-24 22:00:00	Unit Shut down	4.94	4.91
31-Aug-24 23:00:00	Unit Shut down	4.88	4.87
01-Sep-24 00:00:00	Unit Shut down	4.94	4.98
01-Sep-24 01:00:00	Unit Shut down	4.96	4.92
01-Sep-24 02:00:00	Unit Shut down	4.94	4.90
01-Sep-24 03:00:00	Unit Shut down	4.99	4.96
01-Sep-24 04:00:00	Unit Shut down	4.97	4.94
01-Sep-24 05:00:00	Unit Shut down	4.89	4.90
01-Sep-24 06:00:00	Unit Shut down	4.95	4.94
01-Sep-24 07:00:00	Unit Shut down	4.90	4.96
01-Sep-24 08:00:00	Unit Shut down	4.98	4.93
01-Sep-24 09:00:00	Unit Shut down	4.87	4.89
01-Sep-24 10:00:00	Unit Shut down	4.90	4.94
01-Sep-24 11:00:00	Unit Shut down	4.91	4.90
01-Sep-24 12:00:00	Unit Shut down	4.97	4.99
01-Sep-24 13:00:00	Unit Shut down	4.94	4.88
01-Sep-24 14:00:00	Unit Shut down	4.94	4.94
01-Sep-24 15:00:00	Unit Shut down	4.99	4.90
01-Sep-24 16:00:00	Unit Shut down	4.98	4.94
01-Sep-24 17:00:00	Unit Shut down	4.93	4.99
01-Sep-24 18:00:00	Unit Shut down	4.91	4.99
01-Sep-24 19:00:00	Unit Shut down	4.98	4.95
01-Sep-24 20:00:00	Unit Shut down	4.95	4.99
01-Sep-24 21:00:00	Unit Shut down	4.91	4.87
01-Sep-24 22:00:00	Unit Shut down	4.88	4.96
01-Sep-24 23:00:00	Unit Shut down	4.90	4.99
02-Sep-24 00:00:00	Unit Shut down	4.90	4.99
02-Sep-24 01:00:00	Unit Shut down	4.95	4.99
02-Sep-24 02:00:00	Unit Shut down	4.92	4.92
02-Sep-24 03:00:00	Unit Shut down	4.91	4.91
02-Sep-24 04:00:00	Unit Shut down	4.99	4.98
02-Sep-24 05:00:00	Unit Shut down	4.93	4.99
02-Sep-24 06:00:00	Unit Shut down	4.92	4.99



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
02-Sep-24 07:00:00	Unit Shut down	4.96	4.99
02-Sep-24 08:00:00	Unit Shut down	4.96	4.99
02-Sep-24 09:00:00	Unit Shut down	4.93	4.99
02-Sep-24 10:00:00	Unit Shut down	4.97	4.99
02-Sep-24 11:00:00	Unit Shut down	4.96	4.99
02-Sep-24 12:00:00	Unit Shut down	4.90	4.99
02-Sep-24 13:00:00	Unit Shut down	4.98	4.99
02-Sep-24 14:00:00	Unit Shut down	4.99	4.99
02-Sep-24 15:00:00	Unit Shut down	4.92	4.99
02-Sep-24 16:00:00	Unit Shut down	4.98	4.99
02-Sep-24 17:00:00	Unit Shut down	4.95	4.99
02-Sep-24 18:00:00	Unit Shut down	4.87	4.99
02-Sep-24 19:00:00	Unit Shut down	4.93	4.99
02-Sep-24 20:00:00	Unit Shut down	4.95	4.99
02-Sep-24 21:00:00	Unit Shut down	4.91	4.96
02-Sep-24 22:00:00	Unit Shut down	4.91	4.99
02-Sep-24 23:00:00	Unit Shut down	4.99	4.99
03-Sep-24 00:00:00	Unit Shut down	4.96	4.99
03-Sep-24 01:00:00	Unit Shut down	4.92	4.89
03-Sep-24 02:00:00	Unit Shut down	4.93	5.00
03-Sep-24 03:00:00	Unit Shut down	4.94	4.99
03-Sep-24 04:00:00	Unit Shut down	4.94	4.99
03-Sep-24 05:00:00	Unit Shut down	4.87	4.99
03-Sep-24 06:00:00	Unit Shut down	4.96	4.99
03-Sep-24 07:00:00	Unit Shut down	4.90	4.99
03-Sep-24 08:00:00	Unit Shut down	4.97	4.99
03-Sep-24 09:00:00	Unit Shut down	4.92	4.99
03-Sep-24 10:00:00	Unit Shut down	4.99	4.99
03-Sep-24 11:00:00	Unit Shut down	4.95	4.99
03-Sep-24 12:00:00	Unit Shut down	4.92	4.99
03-Sep-24 13:00:00	Unit Shut down	4.88	4.99
03-Sep-24 14:00:00	Unit Shut down	4.99	4.99
03-Sep-24 15:00:00	Unit Shut down	4.92	4.99

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
03-Sep-24 16:00:00	Unit Shut down	4.99	4.99
03-Sep-24 17:00:00	Unit Shut down	4.94	4.99
03-Sep-24 18:00:00	Unit Shut down	4.95	4.99
03-Sep-24 19:00:00	Unit Shut down	4.92	4.99
03-Sep-24 20:00:00	Unit Shut down	4.93	4.97
03-Sep-24 21:00:00	Unit Shut down	4.98	4.99
03-Sep-24 22:00:00	Unit Shut down	4.98	4.92
03-Sep-24 23:00:00	Unit Shut down	4.87	4.88
04-Sep-24 00:00:00	Unit Shut down	4.94	4.89
04-Sep-24 01:00:00	Unit Shut down	4.91	4.90
04-Sep-24 02:00:00	Unit Shut down	4.91	4.98
04-Sep-24 03:00:00	Unit Shut down	4.93	4.88
04-Sep-24 04:00:00	Unit Shut down	4.90	4.95
04-Sep-24 05:00:00	Unit Shut down	4.90	4.89
04-Sep-24 06:00:00	Unit Shut down	4.98	4.90
04-Sep-24 07:00:00	Unit Shut down	4.95	4.96
04-Sep-24 08:00:00	Unit Shut down	4.93	4.89
04-Sep-24 09:00:00	Unit Shut down	4.93	4.98
04-Sep-24 10:00:00	Unit Shut down	4.95	4.96
04-Sep-24 11:00:00	Unit Shut down	4.91	4.93
04-Sep-24 12:00:00	Unit Shut down	4.92	4.99
04-Sep-24 13:00:00	Unit Shut down	4.89	4.94
04-Sep-24 14:00:00	Unit Shut down	4.90	4.92
04-Sep-24 15:00:00	Unit Shut down	4.96	4.96
04-Sep-24 16:00:00	Unit Shut down	4.97	4.94
04-Sep-24 17:00:00	Unit Shut down	4.90	4.97
04-Sep-24 18:00:00	Unit Shut down	4.96	4.90
04-Sep-24 19:00:00	Unit Shut down	4.96	4.91
04-Sep-24 20:00:00	Unit Shut down	4.88	4.98
04-Sep-24 21:00:00	Unit Shut down	4.91	4.97
04-Sep-24 22:00:00	Unit Shut down	4.95	4.93
04-Sep-24 23:00:00	Unit Shut down	4.90	4.89
05-Sep-24 00:00:00	Unit Shut down	4.94	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
05-Sep-24 01:00:00	Unit Shut down	4.91	4.88
05-Sep-24 02:00:00	Unit Shut down	4.94	4.91
05-Sep-24 03:00:00	Unit Shut down	4.95	4.90
05-Sep-24 04:00:00	Unit Shut down	4.89	4.89
05-Sep-24 05:00:00	Unit Shut down	4.89	4.95
05-Sep-24 06:00:00	Unit Shut down	4.90	4.91
05-Sep-24 07:00:00	Unit Shut down	4.96	4.96
05-Sep-24 08:00:00	Unit Shut down	4.88	4.93
05-Sep-24 09:00:00	Unit Shut down	4.90	4.99
05-Sep-24 10:00:00	Unit Shut down	4.98	4.99
05-Sep-24 11:00:00	Unit Shut down	4.90	4.99
05-Sep-24 12:00:00	Unit Shut down	4.92	4.99
05-Sep-24 13:00:00	Unit Shut down	4.95	4.99
05-Sep-24 14:00:00	Unit Shut down	4.95	4.99
05-Sep-24 15:00:00	Unit Shut down	4.95	4.99
05-Sep-24 16:00:00	Unit Shut down	4.92	4.90
05-Sep-24 17:00:00	Unit Shut down	4.94	4.99
05-Sep-24 18:00:00	Unit Shut down	4.93	4.99
05-Sep-24 19:00:00	Unit Shut down	4.90	4.99
05-Sep-24 20:00:00	Unit Shut down	4.90	4.99
05-Sep-24 21:00:00	Unit Shut down	4.95	4.99
05-Sep-24 22:00:00	Unit Shut down	4.91	4.99
05-Sep-24 23:00:00	Unit Shut down	4.89	4.99
06-Sep-24 00:00:00	Unit Shut down	4.94	4.99
06-Sep-24 01:00:00	Unit Shut down	4.88	4.99
06-Sep-24 02:00:00	Unit Shut down	4.90	4.99
06-Sep-24 03:00:00	Unit Shut down	4.88	4.99
06-Sep-24 04:00:00	Unit Shut down	4.97	4.99
06-Sep-24 05:00:00	Unit Shut down	4.94	4.99
06-Sep-24 06:00:00	Unit Shut down	4.95	4.99
06-Sep-24 07:00:00	Unit Shut down	4.91	4.99
06-Sep-24 08:00:00	Unit Shut down	4.95	4.99
06-Sep-24 09:00:00	Unit Shut down	4.91	4.99

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
06-Sep-24 10:00:00	Unit Shut down	4.98	4.99
06-Sep-24 11:00:00	Unit Shut down	4.98	4.99
06-Sep-24 12:00:00	Unit Shut down	4.90	4.99
06-Sep-24 13:00:00	Unit Shut down	4.97	4.99
06-Sep-24 14:00:00	Unit Shut down	4.94	4.99
06-Sep-24 15:00:00	Unit Shut down	4.97	4.99
06-Sep-24 16:00:00	Unit Shut down	4.89	4.99
06-Sep-24 17:00:00	Unit Shut down	4.33	4.99
06-Sep-24 18:00:00	Unit Shut down	Unit Shut down	4.99
06-Sep-24 19:00:00	Unit Shut down	Unit Shut down	4.99
06-Sep-24 20:00:00	Unit Shut down	Unit Shut down	4.99
06-Sep-24 21:00:00	Unit Shut down	Unit Shut down	4.89
06-Sep-24 22:00:00	Unit Shut down	Unit Shut down	4.83
06-Sep-24 23:00:00	Unit Shut down	Unit Shut down	4.85
07-Sep-24 00:00:00	Unit Shut down	Unit Shut down	4.81
07-Sep-24 01:00:00	Unit Shut down	Unit Shut down	4.97
07-Sep-24 02:00:00	Unit Shut down	3.06	4.97
07-Sep-24 03:00:00	Unit Shut down	4.59	4.95
07-Sep-24 04:00:00	Unit Shut down	4.97	4.92
07-Sep-24 05:00:00	Unit Shut down	4.94	4.93
07-Sep-24 06:00:00	Unit Shut down	4.99	4.96
07-Sep-24 07:00:00	Unit Shut down	4.88	4.92
07-Sep-24 08:00:00	Unit Shut down	4.56	4.89
07-Sep-24 09:00:00	Unit Shut down	4.25	4.91
07-Sep-24 10:00:00	Unit Shut down	3.66	4.98
07-Sep-24 11:00:00	Unit Shut down	3.58	4.96
07-Sep-24 12:00:00	Unit Shut down	3.33	4.93
07-Sep-24 13:00:00	Unit Shut down	3.16	4.92
07-Sep-24 14:00:00	Unit Shut down	3.30	4.99
07-Sep-24 15:00:00	Unit Shut down	3.39	4.99
07-Sep-24 16:00:00	Unit Shut down	3.37	4.99
07-Sep-24 17:00:00	Unit Shut down	3.53	4.99
07-Sep-24 18:00:00	Unit Shut down	3.64	4.93



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
07-Sep-24 19:00:00	Unit Shut down	3.73	4.94
07-Sep-24 20:00:00	Unit Shut down	3.92	4.96
07-Sep-24 21:00:00	Unit Shut down	4.00	4.88
07-Sep-24 22:00:00	Unit Shut down	3.92	4.95
07-Sep-24 23:00:00	Unit Shut down	4.04	4.91
08-Sep-24 00:00:00	Unit Shut down	4.03	4.93
08-Sep-24 01:00:00	Unit Shut down	4.04	4.92
08-Sep-24 02:00:00	Unit Shut down	4.04	4.90
08-Sep-24 03:00:00	Unit Shut down	4.04	4.87
08-Sep-24 04:00:00	Unit Shut down	4.02	4.92
08-Sep-24 05:00:00	Unit Shut down	4.06	4.98
08-Sep-24 06:00:00	Unit Shut down	4.04	4.94
08-Sep-24 07:00:00	Unit Shut down	3.99	4.98
08-Sep-24 08:00:00	Unit Shut down	4.01	4.90
08-Sep-24 09:00:00	Unit Shut down	4.04	4.90
08-Sep-24 10:00:00	Unit Shut down	4.04	4.92
08-Sep-24 11:00:00	Unit Shut down	3.78	4.91
08-Sep-24 12:00:00	Unit Shut down	3.96	4.88
08-Sep-24 13:00:00	Unit Shut down	4.07	4.98
08-Sep-24 14:00:00	Unit Shut down	4.05	4.89
08-Sep-24 15:00:00	Unit Shut down	4.03	4.91
08-Sep-24 16:00:00	Unit Shut down	4.03	4.89
08-Sep-24 17:00:00	Unit Shut down	3.84	4.89
08-Sep-24 18:00:00	Unit Shut down	2.60	4.97
08-Sep-24 19:00:00	Unit Shut down	3.57	4.90
08-Sep-24 20:00:00	Unit Shut down	2.48	4.95
08-Sep-24 21:00:00	Unit Shut down	2.54	4.99
08-Sep-24 22:00:00	Unit Shut down	2.55	4.85
08-Sep-24 23:00:00	Unit Shut down	2.56	4.89
09-Sep-24 00:00:00	Unit Shut down	3.02	4.94
09-Sep-24 01:00:00	Unit Shut down	3.51	4.98
09-Sep-24 02:00:00	Unit Shut down	3.76	4.88
09-Sep-24 03:00:00	Unit Shut down	3.86	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
09-Sep-24 04:00:00	Unit Shut down	3.89	4.98
09-Sep-24 05:00:00	Unit Shut down	3.92	4.89
09-Sep-24 06:00:00	Unit Shut down	3.96	4.98
09-Sep-24 07:00:00	Unit Shut down	3.96	4.94
09-Sep-24 08:00:00	Unit Shut down	4.04	4.90
09-Sep-24 09:00:00	Unit Shut down	3.86	4.98
09-Sep-24 10:00:00	Unit Shut down	3.85	4.94
09-Sep-24 11:00:00	Unit Shut down	4.05	4.88
09-Sep-24 12:00:00	Unit Shut down	4.03	4.98
09-Sep-24 13:00:00	Unit Shut down	4.02	4.94
09-Sep-24 14:00:00	Unit Shut down	4.03	4.89
09-Sep-24 15:00:00	Unit Shut down	4.02	4.96
09-Sep-24 16:00:00	Unit Shut down	3.97	4.94
09-Sep-24 17:00:00	Unit Shut down	4.00	4.99
09-Sep-24 18:00:00	Unit Shut down	3.99	4.94
09-Sep-24 19:00:00	Unit Shut down	4.02	4.95
09-Sep-24 20:00:00	Unit Shut down	4.00	4.98
09-Sep-24 21:00:00	Unit Shut down	4.01	4.96
09-Sep-24 22:00:00	Unit Shut down	3.97	4.99
09-Sep-24 23:00:00	Unit Shut down	4.03	4.92
10-Sep-24 00:00:00	Unit Shut down	4.06	4.89
10-Sep-24 01:00:00	Unit Shut down	4.06	4.95
10-Sep-24 02:00:00	Unit Shut down	4.05	4.97
10-Sep-24 03:00:00	Unit Shut down	4.06	4.90
10-Sep-24 04:00:00	Unit Shut down	4.03	4.89
10-Sep-24 05:00:00	Unit Shut down	4.02	4.94
10-Sep-24 06:00:00	Unit Shut down	4.02	4.95
10-Sep-24 07:00:00	Unit Shut down	3.96	4.89
10-Sep-24 08:00:00	Unit Shut down	3.96	4.97
10-Sep-24 09:00:00	Unit Shut down	3.99	4.99
10-Sep-24 10:00:00	Unit Shut down	3.98	4.96
10-Sep-24 11:00:00	Unit Shut down	3.97	4.89
10-Sep-24 12:00:00	Unit Shut down	3.96	4.94

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
10-Sep-24 13:00:00	Unit Shut down	3.96	4.94
10-Sep-24 14:00:00	Unit Shut down	3.92	4.96
10-Sep-24 15:00:00	Unit Shut down	3.98	4.94
10-Sep-24 16:00:00	Unit Shut down	3.89	4.90
10-Sep-24 17:00:00	Unit Shut down	3.80	4.88
10-Sep-24 18:00:00	Unit Shut down	3.96	4.95
10-Sep-24 19:00:00	Unit Shut down	4.04	4.91
10-Sep-24 20:00:00	Unit Shut down	4.06	4.87
10-Sep-24 21:00:00	Unit Shut down	4.07	4.99
10-Sep-24 22:00:00	Unit Shut down	4.09	4.99
10-Sep-24 23:00:00	Unit Shut down	4.09	4.99
11-Sep-24 00:00:00	Unit Shut down	4.08	4.94
11-Sep-24 01:00:00	Unit Shut down	4.08	4.94
11-Sep-24 02:00:00	Unit Shut down	4.06	4.97
11-Sep-24 03:00:00	Unit Shut down	4.06	4.91
11-Sep-24 04:00:00	Unit Shut down	4.05	4.88
11-Sep-24 05:00:00	Unit Shut down	4.05	4.91
11-Sep-24 06:00:00	Unit Shut down	4.04	4.95
11-Sep-24 07:00:00	Unit Shut down	3.96	4.89
11-Sep-24 08:00:00	Unit Shut down	4.02	4.87
11-Sep-24 09:00:00	Unit Shut down	4.00	4.91
11-Sep-24 10:00:00	Unit Shut down	3.99	4.93
11-Sep-24 11:00:00	Unit Shut down	3.97	4.96
11-Sep-24 12:00:00	Unit Shut down	3.96	4.89
11-Sep-24 13:00:00	Unit Shut down	3.96	4.88
11-Sep-24 14:00:00	Unit Shut down	3.97	4.92
11-Sep-24 15:00:00	Unit Shut down	3.99	4.97
11-Sep-24 16:00:00	Unit Shut down	3.99	4.96
11-Sep-24 17:00:00	Unit Shut down	3.95	4.96
11-Sep-24 18:00:00	Unit Shut down	3.95	4.89
11-Sep-24 19:00:00	Unit Shut down	3.99	4.95
11-Sep-24 20:00:00	Unit Shut down	4.01	4.95
11-Sep-24 21:00:00	Unit Shut down	4.02	4.90

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
11-Sep-24 22:00:00	Unit Shut down	3.97	4.96
11-Sep-24 23:00:00	Unit Shut down	4.03	4.98
12-Sep-24 00:00:00	Unit Shut down	4.05	4.94
12-Sep-24 01:00:00	Unit Shut down	4.09	4.96
12-Sep-24 02:00:00	Unit Shut down	4.08	4.89
12-Sep-24 03:00:00	Unit Shut down	4.09	4.93
12-Sep-24 04:00:00	Unit Shut down	4.03	4.90
12-Sep-24 05:00:00	Unit Shut down	3.69	4.98
12-Sep-24 06:00:00	Unit Shut down	4.06	4.90
12-Sep-24 07:00:00	Unit Shut down	3.94	4.91
12-Sep-24 08:00:00	Unit Shut down	4.38	4.95
12-Sep-24 09:00:00	Unit Shut down	4.42	4.88
12-Sep-24 10:00:00	Unit Shut down	4.39	4.87
12-Sep-24 11:00:00	Unit Shut down	4.39	4.99
12-Sep-24 12:00:00	Unit Shut down	4.39	4.83
12-Sep-24 13:00:00	Unit Shut down	4.39	4.96
12-Sep-24 14:00:00	Unit Shut down	4.36	4.96
12-Sep-24 15:00:00	Unit Shut down	4.38	4.93
12-Sep-24 16:00:00	Unit Shut down	4.38	4.94
12-Sep-24 17:00:00	Unit Shut down	4.38	4.88
12-Sep-24 18:00:00	Unit Shut down	4.39	4.94
12-Sep-24 19:00:00	Unit Shut down	4.41	4.87
12-Sep-24 20:00:00	Unit Shut down	4.44	4.90
12-Sep-24 21:00:00	Unit Shut down	4.43	4.89
12-Sep-24 22:00:00	Unit Shut down	4.38	4.98
12-Sep-24 23:00:00	Unit Shut down	4.49	4.98
13-Sep-24 00:00:00	Unit Shut down	4.51	4.98
13-Sep-24 01:00:00	Unit Shut down	4.52	4.96
13-Sep-24 02:00:00	Unit Shut down	4.52	4.96
13-Sep-24 03:00:00	Unit Shut down	4.51	4.97
13-Sep-24 04:00:00	Unit Shut down	4.48	4.95
13-Sep-24 05:00:00	Unit Shut down	4.46	4.92
13-Sep-24 06:00:00	Unit Shut down	4.49	4.89



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
13-Sep-24 07:00:00	Unit Shut down	4.42	4.97
13-Sep-24 08:00:00	Unit Shut down	4.46	4.90
13-Sep-24 09:00:00	Unit Shut down	4.46	4.89
13-Sep-24 10:00:00	Unit Shut down	4.45	4.91
13-Sep-24 11:00:00	Unit Shut down	4.25	4.90
13-Sep-24 12:00:00	Unit Shut down	4.12	4.96
13-Sep-24 13:00:00	Unit Shut down	4.11	4.99
13-Sep-24 14:00:00	Unit Shut down	4.09	4.93
13-Sep-24 15:00:00	Unit Shut down	4.11	4.87
13-Sep-24 16:00:00	Unit Shut down	4.37	4.89
13-Sep-24 17:00:00	Unit Shut down	4.40	4.97
13-Sep-24 18:00:00	Unit Shut down	4.37	4.92
13-Sep-24 19:00:00	Unit Shut down	4.42	4.92
13-Sep-24 20:00:00	Unit Shut down	4.41	4.90
13-Sep-24 21:00:00	Unit Shut down	4.38	4.96
13-Sep-24 22:00:00	Unit Shut down	4.36	4.98
13-Sep-24 23:00:00	Unit Shut down	4.46	4.99
14-Sep-24 00:00:00	Unit Shut down	4.47	4.96
14-Sep-24 01:00:00	Unit Shut down	4.49	4.95
14-Sep-24 02:00:00	Unit Shut down	4.44	4.89
14-Sep-24 03:00:00	Unit Shut down	4.51	4.96
14-Sep-24 04:00:00	Unit Shut down	4.54	4.97
14-Sep-24 05:00:00	Unit Shut down	4.54	4.97
14-Sep-24 06:00:00	Unit Shut down	4.49	4.90
14-Sep-24 07:00:00	Unit Shut down	4.33	4.94
14-Sep-24 08:00:00	Unit Shut down	4.39	4.98
14-Sep-24 09:00:00	Unit Shut down	4.45	4.94
14-Sep-24 10:00:00	Unit Shut down	4.43	4.96
14-Sep-24 11:00:00	Unit Shut down	4.39	4.94
14-Sep-24 12:00:00	Unit Shut down	4.37	4.93
14-Sep-24 13:00:00	Unit Shut down	4.38	4.89
14-Sep-24 14:00:00	Unit Shut down	4.36	4.88
14-Sep-24 15:00:00	Unit Shut down	4.37	4.90

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
14-Sep-24 16:00:00	Unit Shut down	4.30	4.90
14-Sep-24 17:00:00	Unit Shut down	3.91	4.97
14-Sep-24 18:00:00	Unit Shut down	4.28	4.88
14-Sep-24 19:00:00	Unit Shut down	4.37	4.87
14-Sep-24 20:00:00	Unit Shut down	4.38	4.90
14-Sep-24 21:00:00	Unit Shut down	4.37	4.87
14-Sep-24 22:00:00	Unit Shut down	4.32	4.93
14-Sep-24 23:00:00	Unit Shut down	4.46	4.96
15-Sep-24 00:00:00	Unit Shut down	4.48	4.94
15-Sep-24 01:00:00	Unit Shut down	4.50	4.89
15-Sep-24 02:00:00	Unit Shut down	4.51	4.90
15-Sep-24 03:00:00	Unit Shut down	4.52	4.98
15-Sep-24 04:00:00	Unit Shut down	4.52	4.94
15-Sep-24 05:00:00	Unit Shut down	4.40	4.91
15-Sep-24 06:00:00	Unit Shut down	4.52	4.93
15-Sep-24 07:00:00	Unit Shut down	4.34	4.92
15-Sep-24 08:00:00	Unit Shut down	4.45	4.88
15-Sep-24 09:00:00	Unit Shut down	4.50	4.97
15-Sep-24 10:00:00	Unit Shut down	4.46	4.92
15-Sep-24 11:00:00	Unit Shut down	4.00	4.91
15-Sep-24 12:00:00	Unit Shut down	3.94	4.89
15-Sep-24 13:00:00	Unit Shut down	4.32	4.97
15-Sep-24 14:00:00	Unit Shut down	4.40	4.95
15-Sep-24 15:00:00	Unit Shut down	4.39	4.95
15-Sep-24 16:00:00	Unit Shut down	4.37	4.92
15-Sep-24 17:00:00	Unit Shut down	4.37	4.89
15-Sep-24 18:00:00	Unit Shut down	4.40	4.99
15-Sep-24 19:00:00	Unit Shut down	4.40	4.91
15-Sep-24 20:00:00	Unit Shut down	4.41	4.94
15-Sep-24 21:00:00	Unit Shut down	4.40	4.91
15-Sep-24 22:00:00	Unit Shut down	4.30	4.98
15-Sep-24 23:00:00	Unit Shut down	4.45	4.99
16-Sep-24 00:00:00	Unit Shut down	4.49	4.94

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
16-Sep-24 01:00:00	Unit Shut down	4.40	4.89
16-Sep-24 02:00:00	Unit Shut down	4.48	4.90
16-Sep-24 03:00:00	Unit Shut down	4.53	4.97
16-Sep-24 04:00:00	Unit Shut down	4.55	4.89
16-Sep-24 05:00:00	Unit Shut down	4.54	4.92
16-Sep-24 06:00:00	Unit Shut down	4.57	4.91
16-Sep-24 07:00:00	Unit Shut down	4.44	4.98
16-Sep-24 08:00:00	Unit Shut down	4.50	4.90
16-Sep-24 09:00:00	Unit Shut down	4.55	4.90
16-Sep-24 10:00:00	Unit Shut down	4.52	4.96
16-Sep-24 11:00:00	Unit Shut down	4.48	4.91
16-Sep-24 12:00:00	Unit Shut down	4.45	4.95
16-Sep-24 13:00:00	Unit Shut down	4.43	4.91
16-Sep-24 14:00:00	Unit Shut down	4.43	4.90
16-Sep-24 15:00:00	Unit Shut down	4.42	4.88
16-Sep-24 16:00:00	Unit Shut down	4.42	4.98
16-Sep-24 17:00:00	Unit Shut down	4.41	4.90
16-Sep-24 18:00:00	Unit Shut down	4.37	4.97
16-Sep-24 19:00:00	Unit Shut down	4.40	4.96
16-Sep-24 20:00:00	Unit Shut down	4.41	4.93
16-Sep-24 21:00:00	Unit Shut down	4.37	4.91
16-Sep-24 22:00:00	Unit Shut down	4.42	4.92
16-Sep-24 23:00:00	Unit Shut down	4.43	4.95
17-Sep-24 00:00:00	Unit Shut down	4.26	4.92
17-Sep-24 01:00:00	Unit Shut down	Unit Shut down	4.99
17-Sep-24 02:00:00	Unit Shut down	Unit Shut down	4.89
17-Sep-24 03:00:00	Unit Shut down	Unit Shut down	4.95
17-Sep-24 04:00:00	Unit Shut down	Unit Shut down	4.97
17-Sep-24 05:00:00	Unit Shut down	Unit Shut down	4.90
17-Sep-24 06:00:00	Unit Shut down	Unit Shut down	4.93
17-Sep-24 07:00:00	Unit Shut down	Unit Shut down	4.92
17-Sep-24 08:00:00	Unit Shut down	Unit Shut down	4.88
17-Sep-24 09:00:00	Unit Shut down	Unit Shut down	4.94

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
17-Sep-24 10:00:00	Unit Shut down	Unit Shut down	4.93
17-Sep-24 11:00:00	Unit Shut down	Unit Shut down	4.89
17-Sep-24 12:00:00	Unit Shut down	Unit Shut down	4.98
17-Sep-24 13:00:00	Unit Shut down	Unit Shut down	4.89
17-Sep-24 14:00:00	Unit Shut down	Unit Shut down	4.98
17-Sep-24 15:00:00	Unit Shut down	Unit Shut down	4.97
17-Sep-24 16:00:00	Unit Shut down	Unit Shut down	4.98
17-Sep-24 17:00:00	Unit Shut down	Unit Shut down	4.89
17-Sep-24 18:00:00	Unit Shut down	Unit Shut down	4.98
17-Sep-24 19:00:00	Unit Shut down	Unit Shut down	4.95
17-Sep-24 20:00:00	Unit Shut down	Unit Shut down	4.88
17-Sep-24 21:00:00	Unit Shut down	Unit Shut down	4.96
17-Sep-24 22:00:00	Unit Shut down	Unit Shut down	4.98
17-Sep-24 23:00:00	Unit Shut down	Unit Shut down	4.96
18-Sep-24 00:00:00	Unit Shut down	Unit Shut down	4.96
18-Sep-24 01:00:00	Unit Shut down	Unit Shut down	4.90
18-Sep-24 02:00:00	Unit Shut down	Unit Shut down	4.87
18-Sep-24 03:00:00	Unit Shut down	Unit Shut down	4.88
18-Sep-24 04:00:00	Unit Shut down	Unit Shut down	4.88
18-Sep-24 05:00:00	Unit Shut down	Unit Shut down	4.89
18-Sep-24 06:00:00	Unit Shut down	Unit Shut down	4.96
18-Sep-24 07:00:00	Unit Shut down	Unit Shut down	4.92
18-Sep-24 08:00:00	Unit Shut down	Unit Shut down	4.95
18-Sep-24 09:00:00	Unit Shut down	Unit Shut down	4.99
18-Sep-24 10:00:00	Unit Shut down	Unit Shut down	4.94
18-Sep-24 11:00:00	Unit Shut down	Unit Shut down	4.96
18-Sep-24 12:00:00	Unit Shut down	4.97	4.91
18-Sep-24 13:00:00	Unit Shut down	4.91	4.92
18-Sep-24 14:00:00	Unit Shut down	4.96	4.98
18-Sep-24 15:00:00	Unit Shut down	4.55	4.97
18-Sep-24 16:00:00	Unit Shut down	4.50	4.94
18-Sep-24 17:00:00	Unit Shut down	4.42	4.98
18-Sep-24 18:00:00	Unit Shut down	4.45	4.87



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
18-Sep-24 19:00:00	Unit Shut down	4.47	4.96
18-Sep-24 20:00:00	Unit Shut down	4.47	4.99
18-Sep-24 21:00:00	Unit Shut down	4.50	4.90
18-Sep-24 22:00:00	Unit Shut down	4.45	4.85
18-Sep-24 23:00:00	Unit Shut down	4.39	4.80
19-Sep-24 00:00:00	Unit Shut down	4.38	4.77
19-Sep-24 01:00:00	Unit Shut down	4.59	4.99
19-Sep-24 02:00:00	Unit Shut down	4.61	4.97
19-Sep-24 03:00:00	Unit Shut down	4.57	4.90
19-Sep-24 04:00:00	Unit Shut down	4.57	4.95
19-Sep-24 05:00:00	Unit Shut down	4.61	4.94
19-Sep-24 06:00:00	Unit Shut down	4.57	4.92
19-Sep-24 07:00:00	Unit Shut down	4.51	4.88
19-Sep-24 08:00:00	Unit Shut down	4.60	4.97
19-Sep-24 09:00:00	Unit Shut down	4.61	4.87
19-Sep-24 10:00:00	Unit Shut down	4.61	4.88
19-Sep-24 11:00:00	Unit Shut down	4.35	4.89
19-Sep-24 12:00:00	Unit Shut down	4.35	4.89
19-Sep-24 13:00:00	Unit Shut down	4.44	4.88
19-Sep-24 14:00:00	Unit Shut down	4.50	4.92
19-Sep-24 15:00:00	Unit Shut down	4.56	4.97
19-Sep-24 16:00:00	Unit Shut down	4.58	4.87
19-Sep-24 17:00:00	Unit Shut down	4.61	4.90
19-Sep-24 18:00:00	Unit Shut down	4.60	4.99
19-Sep-24 19:00:00	Unit Shut down	4.63	4.91
19-Sep-24 20:00:00	Unit Shut down	4.65	4.88
19-Sep-24 21:00:00	Unit Shut down	4.66	4.95
19-Sep-24 22:00:00	Unit Shut down	4.61	4.90
19-Sep-24 23:00:00	Unit Shut down	4.68	4.92
20-Sep-24 00:00:00	Unit Shut down	4.69	5.00
20-Sep-24 01:00:00	Unit Shut down	4.69	4.97
20-Sep-24 02:00:00	Unit Shut down	4.67	4.96
20-Sep-24 03:00:00	Unit Shut down	4.69	4.96

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
20-Sep-24 04:00:00	Unit Shut down	4.65	4.96
20-Sep-24 05:00:00	Unit Shut down	4.64	4.97
20-Sep-24 06:00:00	Unit Shut down	4.62	4.94
20-Sep-24 07:00:00	Unit Shut down	4.59	4.88
20-Sep-24 08:00:00	Unit Shut down	4.59	4.99
20-Sep-24 09:00:00	Unit Shut down	4.55	4.88
20-Sep-24 10:00:00	Unit Shut down	4.67	4.94
20-Sep-24 11:00:00	Unit Shut down	4.66	4.87
20-Sep-24 12:00:00	Unit Shut down	4.99	4.99
20-Sep-24 13:00:00	Unit Shut down	4.99	4.91
20-Sep-24 14:00:00	Unit Shut down	4.99	4.88
20-Sep-24 15:00:00	Unit Shut down	4.99	4.97
20-Sep-24 16:00:00	Unit Shut down	4.99	4.97
20-Sep-24 17:00:00	Unit Shut down	4.99	4.92
20-Sep-24 18:00:00	Unit Shut down	4.99	4.88
20-Sep-24 19:00:00	Unit Shut down	4.99	4.98
20-Sep-24 20:00:00	Unit Shut down	4.99	4.92
20-Sep-24 21:00:00	Unit Shut down	4.99	4.97
20-Sep-24 22:00:00	Unit Shut down	4.99	4.90
20-Sep-24 23:00:00	Unit Shut down	4.99	4.97
21-Sep-24 00:00:00	Unit Shut down	4.99	4.93
21-Sep-24 01:00:00	Unit Shut down	4.68	4.93
21-Sep-24 02:00:00	Unit Shut down	4.66	4.88
21-Sep-24 03:00:00	Unit Shut down	4.64	4.92
21-Sep-24 04:00:00	Unit Shut down	4.64	4.93
21-Sep-24 05:00:00	Unit Shut down	4.59	4.96
21-Sep-24 06:00:00	Unit Shut down	4.60	4.93
21-Sep-24 07:00:00	Unit Shut down	4.55	4.90
21-Sep-24 08:00:00	Unit Shut down	4.61	4.99
21-Sep-24 09:00:00	Unit Shut down	4.60	4.90
21-Sep-24 10:00:00	Unit Shut down	4.60	4.90
21-Sep-24 11:00:00	Unit Shut down	4.99	4.99
21-Sep-24 12:00:00	Unit Shut down	4.99	4.90

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
21-Sep-24 13:00:00	Unit Shut down	4.99	4.88
21-Sep-24 14:00:00	Unit Shut down	4.99	4.92
21-Sep-24 15:00:00	Unit Shut down	4.99	4.91
21-Sep-24 16:00:00	Unit Shut down	4.99	4.92
21-Sep-24 17:00:00	Unit Shut down	4.99	4.97
21-Sep-24 18:00:00	Unit Shut down	4.99	4.91
21-Sep-24 19:00:00	Unit Shut down	4.99	4.87
21-Sep-24 20:00:00	Unit Shut down	4.99	4.88
21-Sep-24 21:00:00	Unit Shut down	4.99	4.91
21-Sep-24 22:00:00	Unit Shut down	4.99	4.93
21-Sep-24 23:00:00	Unit Shut down	4.69	4.96
22-Sep-24 00:00:00	Unit Shut down	4.70	4.87
22-Sep-24 01:00:00	Unit Shut down	4.72	4.97
22-Sep-24 02:00:00	Unit Shut down	4.70	4.91
22-Sep-24 03:00:00	Unit Shut down	4.70	4.92
22-Sep-24 04:00:00	Unit Shut down	4.69	4.91
22-Sep-24 05:00:00	Unit Shut down	4.65	4.89
22-Sep-24 06:00:00	Unit Shut down	4.65	4.96
22-Sep-24 07:00:00	Unit Shut down	4.62	4.98
22-Sep-24 08:00:00	Unit Shut down	4.65	4.98
22-Sep-24 09:00:00	Unit Shut down	4.64	4.87
22-Sep-24 10:00:00	Unit Shut down	4.63	4.91
22-Sep-24 11:00:00	Unit Shut down	4.62	4.88
22-Sep-24 12:00:00	Unit Shut down	4.63	4.91
22-Sep-24 13:00:00	Unit Shut down	4.99	4.99
22-Sep-24 14:00:00	Unit Shut down	4.99	4.90
22-Sep-24 15:00:00	Unit Shut down	4.99	4.88
22-Sep-24 16:00:00	Unit Shut down	4.99	4.93
22-Sep-24 17:00:00	Unit Shut down	4.99	4.95
22-Sep-24 18:00:00	Unit Shut down	4.62	4.99
22-Sep-24 19:00:00	Unit Shut down	4.99	4.98
22-Sep-24 20:00:00	Unit Shut down	4.99	4.95
22-Sep-24 21:00:00	Unit Shut down	4.99	4.95

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
22-Sep-24 22:00:00	Unit Shut down	4.99	4.83
22-Sep-24 23:00:00	Unit Shut down	4.99	4.78
23-Sep-24 00:00:00	Unit Shut down	4.67	4.87
23-Sep-24 01:00:00	Unit Shut down	4.60	4.92
23-Sep-24 02:00:00	Unit Shut down	4.99	4.89
23-Sep-24 03:00:00	Unit Shut down	4.71	4.88
23-Sep-24 04:00:00	Unit Shut down	4.69	4.88
23-Sep-24 05:00:00	Unit Shut down	4.69	4.84
23-Sep-24 06:00:00	Unit Shut down	4.65	4.78
23-Sep-24 07:00:00	Unit Shut down	4.59	4.78
23-Sep-24 08:00:00	Unit Shut down	4.63	4.80
23-Sep-24 09:00:00	Unit Shut down	4.63	4.78
23-Sep-24 10:00:00	Unit Shut down	4.63	4.80
23-Sep-24 11:00:00	Unit Shut down	4.99	4.82
23-Sep-24 12:00:00	Unit Shut down	4.99	4.81
23-Sep-24 13:00:00	Unit Shut down	4.99	4.75
23-Sep-24 14:00:00	Unit Shut down	4.99	4.81
23-Sep-24 15:00:00	Unit Shut down	4.99	4.80
23-Sep-24 16:00:00	Unit Shut down	4.99	4.79
23-Sep-24 17:00:00	Unit Shut down	4.99	4.82
23-Sep-24 18:00:00	Unit Shut down	4.99	4.86
23-Sep-24 19:00:00	Unit Shut down	4.99	4.85
23-Sep-24 20:00:00	Unit Shut down	4.99	4.86
23-Sep-24 21:00:00	Unit Shut down	4.99	4.86
23-Sep-24 22:00:00	Unit Shut down	4.60	4.77
23-Sep-24 23:00:00	Unit Shut down	4.71	4.79
24-Sep-24 00:00:00	Unit Shut down	4.71	4.86
24-Sep-24 01:00:00	Unit Shut down	4.72	4.99
24-Sep-24 02:00:00	Unit Shut down	4.73	5.00
24-Sep-24 03:00:00	Unit Shut down	4.73	4.95
24-Sep-24 04:00:00	Unit Shut down	4.70	4.91
24-Sep-24 05:00:00	Unit Shut down	4.68	4.90
24-Sep-24 06:00:00	Unit Shut down	4.99	4.85



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
24-Sep-24 07:00:00	Unit Shut down	4.99	4.95
24-Sep-24 08:00:00	Unit Shut down	4.99	4.92
24-Sep-24 09:00:00	Unit Shut down	4.99	4.88
24-Sep-24 10:00:00	Unit Shut down	4.99	4.97
24-Sep-24 11:00:00	Unit Shut down	4.99	4.94
24-Sep-24 12:00:00	Unit Shut down	4.99	4.91
24-Sep-24 13:00:00	Unit Shut down	4.99	4.98
24-Sep-24 14:00:00	Unit Shut down	4.99	4.97
24-Sep-24 15:00:00	Unit Shut down	4.99	4.91
24-Sep-24 16:00:00	Unit Shut down	4.99	4.96
24-Sep-24 17:00:00	Unit Shut down	4.99	4.93
24-Sep-24 18:00:00	Unit Shut down	4.99	4.89
24-Sep-24 19:00:00	Unit Shut down	4.99	4.93
24-Sep-24 20:00:00	Unit Shut down	4.99	4.97
24-Sep-24 21:00:00	Unit Shut down	4.99	4.97
24-Sep-24 22:00:00	Unit Shut down	4.99	4.94
24-Sep-24 23:00:00	Unit Shut down	4.99	4.75
25-Sep-24 00:00:00	Unit Shut down	4.99	4.87
25-Sep-24 01:00:00	Unit Shut down	4.99	4.85
25-Sep-24 02:00:00	Unit Shut down	4.99	4.86
25-Sep-24 03:00:00	Unit Shut down	4.99	4.82
25-Sep-24 04:00:00	Unit Shut down	4.99	4.81
25-Sep-24 05:00:00	Unit Shut down	4.99	4.75
25-Sep-24 06:00:00	Unit Shut down	4.99	4.78
25-Sep-24 07:00:00	Unit Shut down	4.99	4.76
25-Sep-24 08:00:00	Unit Shut down	4.99	4.71
25-Sep-24 09:00:00	Unit Shut down	4.99	4.69
25-Sep-24 10:00:00	Unit Shut down	4.99	4.75
25-Sep-24 11:00:00	Unit Shut down	4.99	4.73
25-Sep-24 12:00:00	Unit Shut down	4.99	4.97
25-Sep-24 13:00:00	Unit Shut down	4.99	4.95
25-Sep-24 14:00:00	Unit Shut down	4.99	4.95
25-Sep-24 15:00:00	Unit Shut down	4.99	4.90

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
25-Sep-24 16:00:00	Unit Shut down	4.99	4.99
25-Sep-24 17:00:00	Unit Shut down	4.99	4.90
25-Sep-24 18:00:00	Unit Shut down	4.99	4.90
25-Sep-24 19:00:00	Unit Shut down	4.99	4.96
25-Sep-24 20:00:00	Unit Shut down	4.99	4.93
25-Sep-24 21:00:00	Unit Shut down	4.99	4.96
25-Sep-24 22:00:00	Unit Shut down	4.99	4.99
25-Sep-24 23:00:00	Unit Shut down	4.99	4.91
26-Sep-24 00:00:00	Unit Shut down	4.99	4.96
26-Sep-24 01:00:00	Unit Shut down	4.41	4.94
26-Sep-24 02:00:00	Unit Shut down	4.41	4.94
26-Sep-24 03:00:00	Unit Shut down	4.41	4.95
26-Sep-24 04:00:00	Unit Shut down	4.41	4.98
26-Sep-24 05:00:00	Unit Shut down	4.42	4.87
26-Sep-24 06:00:00	Unit Shut down	4.40	4.96
26-Sep-24 07:00:00	Unit Shut down	4.39	4.99
26-Sep-24 08:00:00	Unit Shut down	4.52	4.89
26-Sep-24 09:00:00	Unit Shut down	4.49	4.91
26-Sep-24 10:00:00	Unit Shut down	4.45	5.00
26-Sep-24 11:00:00	Unit Shut down	4.41	4.94
26-Sep-24 12:00:00	Unit Shut down	4.39	4.97
26-Sep-24 13:00:00	Unit Shut down	4.39	4.88
26-Sep-24 14:00:00	Unit Shut down	4.40	4.90
26-Sep-24 15:00:00	Unit Shut down	4.42	4.98
26-Sep-24 16:00:00	Unit Shut down	4.43	4.98
26-Sep-24 17:00:00	Unit Shut down	4.39	4.95
26-Sep-24 18:00:00	Unit Shut down	4.40	4.93
26-Sep-24 19:00:00	Unit Shut down	4.42	4.97
26-Sep-24 20:00:00	Unit Shut down	4.43	4.98
26-Sep-24 21:00:00	Unit Shut down	4.43	4.93
26-Sep-24 22:00:00	Unit Shut down	4.99	4.95
26-Sep-24 23:00:00	Unit Shut down	4.99	4.91
27-Sep-24 00:00:00	Unit Shut down	4.99	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
27-Sep-24 01:00:00	Unit Shut down	4.99	4.91
27-Sep-24 02:00:00	Unit Shut down	4.99	4.96
27-Sep-24 03:00:00	Unit Shut down	4.99	4.97
27-Sep-24 04:00:00	Unit Shut down	4.99	4.88
27-Sep-24 05:00:00	Unit Shut down	4.99	4.89
27-Sep-24 06:00:00	Unit Shut down	4.99	4.94
27-Sep-24 07:00:00	Unit Shut down	4.99	4.99
27-Sep-24 08:00:00	Unit Shut down	4.99	4.93
27-Sep-24 09:00:00	Unit Shut down	4.99	4.90
27-Sep-24 10:00:00	Unit Shut down	4.99	4.95
27-Sep-24 11:00:00	Unit Shut down	4.99	4.88
27-Sep-24 12:00:00	Unit Shut down	4.99	4.93
27-Sep-24 13:00:00	Unit Shut down	4.99	4.92
27-Sep-24 14:00:00	Unit Shut down	4.99	4.91
27-Sep-24 15:00:00	Unit Shut down	4.99	4.94
27-Sep-24 16:00:00	Unit Shut down	4.99	4.90
27-Sep-24 17:00:00	Unit Shut down	4.99	4.94
27-Sep-24 18:00:00	Unit Shut down	4.99	4.89
27-Sep-24 19:00:00	Unit Shut down	4.99	4.88
27-Sep-24 20:00:00	Unit Shut down	4.99	4.95
27-Sep-24 21:00:00	Unit Shut down	4.99	4.99
27-Sep-24 22:00:00	Unit Shut down	4.99	4.89
27-Sep-24 23:00:00	Unit Shut down	4.99	4.87
28-Sep-24 00:00:00	Unit Shut down	4.99	4.96
28-Sep-24 01:00:00	Unit Shut down	4.99	4.98
28-Sep-24 02:00:00	Unit Shut down	4.99	4.91
28-Sep-24 03:00:00	Unit Shut down	4.99	4.90
28-Sep-24 04:00:00	Unit Shut down	4.99	4.97
28-Sep-24 05:00:00	Unit Shut down	4.99	4.98
28-Sep-24 06:00:00	Unit Shut down	4.99	4.92
28-Sep-24 07:00:00	Unit Shut down	4.99	4.87
28-Sep-24 08:00:00	Unit Shut down	4.99	4.89
28-Sep-24 09:00:00	Unit Shut down	4.99	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
28-Sep-24 10:00:00	Unit Shut down	4.99	4.95
28-Sep-24 11:00:00	Unit Shut down	4.99	4.99
28-Sep-24 12:00:00	Unit Shut down	4.99	4.90
28-Sep-24 13:00:00	Unit Shut down	4.99	4.89
28-Sep-24 14:00:00	Unit Shut down	4.99	4.95
28-Sep-24 15:00:00	Unit Shut down	4.99	4.99
28-Sep-24 16:00:00	Unit Shut down	4.99	4.88
28-Sep-24 17:00:00	Unit Shut down	4.99	4.89
28-Sep-24 18:00:00	Unit Shut down	4.99	4.99
28-Sep-24 19:00:00	Unit Shut down	4.99	4.96
28-Sep-24 20:00:00	Unit Shut down	4.99	4.97
28-Sep-24 21:00:00	Unit Shut down	4.99	4.96
28-Sep-24 22:00:00	Unit Shut down	4.99	4.87
28-Sep-24 23:00:00	Unit Shut down	4.99	4.89
29-Sep-24 00:00:00	Unit Shut down	4.99	4.98
29-Sep-24 01:00:00	Unit Shut down	4.99	4.94
29-Sep-24 02:00:00	Unit Shut down	4.99	4.92
29-Sep-24 03:00:00	Unit Shut down	4.99	4.87
29-Sep-24 04:00:00	Unit Shut down	4.99	4.95
29-Sep-24 05:00:00	Unit Shut down	4.99	4.93
29-Sep-24 06:00:00	Unit Shut down	4.99	4.95
29-Sep-24 07:00:00	Unit Shut down	4.99	4.99
29-Sep-24 08:00:00	Unit Shut down	4.99	4.91
29-Sep-24 09:00:00	Unit Shut down	4.99	4.99
29-Sep-24 10:00:00	Unit Shut down	4.99	4.97
29-Sep-24 11:00:00	Unit Shut down	4.99	4.92
29-Sep-24 12:00:00	Unit Shut down	4.99	4.99
29-Sep-24 13:00:00	Unit Shut down	4.99	4.99
29-Sep-24 14:00:00	Unit Shut down	4.99	4.99
29-Sep-24 15:00:00	Unit Shut down	4.99	4.99
29-Sep-24 16:00:00	Unit Shut down	4.44	4.99
29-Sep-24 17:00:00	Unit Shut down	4.45	4.99
29-Sep-24 18:00:00	Unit Shut down	4.47	4.94



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
29-Sep-24 19:00:00	Unit Shut down	4.46	4.92
29-Sep-24 20:00:00	Unit Shut down	4.47	4.95
29-Sep-24 21:00:00	Unit Shut down	4.46	4.90
29-Sep-24 22:00:00	Unit Shut down	4.44	4.93
29-Sep-24 23:00:00	Unit Shut down	4.49	4.91
30-Sep-24 00:00:00	Unit Shut down	4.48	4.93
30-Sep-24 01:00:00	Unit Shut down	4.49	4.95
30-Sep-24 02:00:00	Unit Shut down	4.99	4.96
30-Sep-24 03:00:00	Unit Shut down	4.99	4.93
30-Sep-24 04:00:00	Unit Shut down	4.99	4.91
30-Sep-24 05:00:00	Unit Shut down	4.99	4.88
30-Sep-24 06:00:00	Unit Shut down	4.99	4.90
30-Sep-24 07:00:00	Unit Shut down	4.99	4.96
30-Sep-24 08:00:00	Unit Shut down	4.99	4.92
30-Sep-24 09:00:00	Unit Shut down	4.99	4.91
30-Sep-24 10:00:00	Unit Shut down	4.99	4.91
30-Sep-24 11:00:00	Unit Shut down	4.99	4.91
30-Sep-24 12:00:00	Unit Shut down	4.99	4.89
30-Sep-24 13:00:00	Unit Shut down	4.99	4.95
30-Sep-24 14:00:00	Unit Shut down	4.99	4.94
30-Sep-24 15:00:00	Unit Shut down	4.99	4.87
30-Sep-24 16:00:00	Unit Shut down	4.99	4.99
30-Sep-24 17:00:00	Unit Shut down	4.99	4.88
30-Sep-24 18:00:00	Unit Shut down	4.99	4.95
30-Sep-24 19:00:00	Unit Shut down	4.99	4.96
30-Sep-24 20:00:00	Unit Shut down	4.99	4.93
30-Sep-24 21:00:00	Unit Shut down	4.99	4.95
30-Sep-24 22:00:00	Unit Shut down	4.99	4.93
30-Sep-24 23:00:00	Unit Shut down	4.99	4.93
01-Oct-24 00:00:00	Unit Shut down	4.99	4.99
01-Oct-24 01:00:00	Unit Shut down	4.99	4.91
01-Oct-24 02:00:00	Unit Shut down	4.99	4.89
01-Oct-24 03:00:00	Unit Shut down	4.99	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
01-Oct-24 04:00:00	Unit Shut down	4.99	4.89
01-Oct-24 05:00:00	Unit Shut down	4.99	4.98
01-Oct-24 06:00:00	Unit Shut down	4.99	4.98
01-Oct-24 07:00:00	Unit Shut down	4.99	4.96
01-Oct-24 08:00:00	Unit Shut down	4.99	4.99
01-Oct-24 09:00:00	Unit Shut down	4.99	4.98
01-Oct-24 10:00:00	Unit Shut down	4.99	4.95
01-Oct-24 11:00:00	Unit Shut down	4.99	4.90
01-Oct-24 12:00:00	Unit Shut down	4.99	4.99
01-Oct-24 13:00:00	Unit Shut down	4.99	4.94
01-Oct-24 14:00:00	Unit Shut down	4.99	4.95
01-Oct-24 15:00:00	Unit Shut down	4.99	4.92
01-Oct-24 16:00:00	Unit Shut down	4.99	4.87
01-Oct-24 17:00:00	Unit Shut down	4.99	4.92
01-Oct-24 18:00:00	Unit Shut down	4.99	4.91
01-Oct-24 19:00:00	Unit Shut down	4.99	4.96
01-Oct-24 20:00:00	Unit Shut down	4.99	4.97
01-Oct-24 21:00:00	Unit Shut down	4.99	4.88
01-Oct-24 22:00:00	Unit Shut down	4.99	4.97
01-Oct-24 23:00:00	Unit Shut down	4.45	4.94
02-Oct-24 00:00:00	Unit Shut down	4.47	4.98
02-Oct-24 01:00:00	Unit Shut down	4.44	4.88
02-Oct-24 02:00:00	Unit Shut down	4.45	4.90
02-Oct-24 03:00:00	Unit Shut down	4.47	4.92
02-Oct-24 04:00:00	Unit Shut down	4.45	4.88
02-Oct-24 05:00:00	Unit Shut down	4.45	4.89
02-Oct-24 06:00:00	Unit Shut down	4.50	4.94
02-Oct-24 07:00:00	Unit Shut down	4.45	4.91
02-Oct-24 08:00:00	Unit Shut down	4.52	4.90
02-Oct-24 09:00:00	Unit Shut down	4.52	4.96
02-Oct-24 10:00:00	Unit Shut down	4.50	4.90
02-Oct-24 11:00:00	Unit Shut down	4.48	4.87
02-Oct-24 12:00:00	Unit Shut down	4.47	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
02-Oct-24 13:00:00	Unit Shut down	4.45	4.90
02-Oct-24 14:00:00	Unit Shut down	4.44	4.92
02-Oct-24 15:00:00	Unit Shut down	4.42	4.95
02-Oct-24 16:00:00	Unit Shut down	4.41	4.96
02-Oct-24 17:00:00	Unit Shut down	4.45	4.90
02-Oct-24 18:00:00	Unit Shut down	4.43	4.88
02-Oct-24 19:00:00	Unit Shut down	4.46	4.92
02-Oct-24 20:00:00	Unit Shut down	4.44	4.90
02-Oct-24 21:00:00	Unit Shut down	4.45	4.94
02-Oct-24 22:00:00	Unit Shut down	4.40	4.89
02-Oct-24 23:00:00	Unit Shut down	4.46	4.88
03-Oct-24 00:00:00	Unit Shut down	4.46	4.93
03-Oct-24 01:00:00	Unit Shut down	4.45	4.87
03-Oct-24 02:00:00	Unit Shut down	4.44	4.95
03-Oct-24 03:00:00	Unit Shut down	4.45	4.90
03-Oct-24 04:00:00	Unit Shut down	4.44	4.96
03-Oct-24 05:00:00	Unit Shut down	4.45	4.89
03-Oct-24 06:00:00	Unit Shut down	4.44	4.95
03-Oct-24 07:00:00	Unit Shut down	4.40	4.89
03-Oct-24 08:00:00	Unit Shut down	4.46	4.98
03-Oct-24 09:00:00	Unit Shut down	4.48	4.90
03-Oct-24 10:00:00	Unit Shut down	4.48	4.96
03-Oct-24 11:00:00	Unit Shut down	4.46	4.96
03-Oct-24 12:00:00	Unit Shut down	4.44	4.98
03-Oct-24 13:00:00	Unit Shut down	4.44	4.98
03-Oct-24 14:00:00	Unit Shut down	4.99	4.95
03-Oct-24 15:00:00	Unit Shut down	4.99	4.92
03-Oct-24 16:00:00	Unit Shut down	4.99	4.95
03-Oct-24 17:00:00	Unit Shut down	4.99	4.99
03-Oct-24 18:00:00	Unit Shut down	4.99	4.92
03-Oct-24 19:00:00	Unit Shut down	4.49	4.96
03-Oct-24 20:00:00	Unit Shut down	4.47	4.93
03-Oct-24 21:00:00	Unit Shut down	4.47	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
03-Oct-24 22:00:00	Unit Shut down	4.44	4.92
03-Oct-24 23:00:00	Unit Shut down	4.50	4.94
04-Oct-24 00:00:00	Unit Shut down	4.51	4.89
04-Oct-24 01:00:00	Unit Shut down	4.48	4.97
04-Oct-24 02:00:00	Unit Shut down	4.46	4.94
04-Oct-24 03:00:00	Unit Shut down	4.45	4.90
04-Oct-24 04:00:00	Unit Shut down	4.46	4.96
04-Oct-24 05:00:00	Unit Shut down	4.46	4.95
04-Oct-24 06:00:00	Unit Shut down	4.45	4.93
04-Oct-24 07:00:00	Unit Shut down	4.39	4.94
04-Oct-24 08:00:00	Unit Shut down	4.43	4.92
04-Oct-24 09:00:00	Unit Shut down	4.45	4.98
04-Oct-24 10:00:00	Unit Shut down	4.99	4.91
04-Oct-24 11:00:00	Unit Shut down	4.99	4.89
04-Oct-24 12:00:00	Unit Shut down	4.99	4.93
04-Oct-24 13:00:00	Unit Shut down	4.99	4.98
04-Oct-24 14:00:00	Unit Shut down	4.99	4.99
04-Oct-24 15:00:00	Unit Shut down	4.99	4.97
04-Oct-24 16:00:00	Unit Shut down	4.99	4.87
04-Oct-24 17:00:00	Unit Shut down	4.99	4.92
04-Oct-24 18:00:00	Unit Shut down	4.99	4.98
04-Oct-24 19:00:00	Unit Shut down	4.99	4.95
04-Oct-24 20:00:00	Unit Shut down	4.48	4.95
04-Oct-24 21:00:00	Unit Shut down	4.46	4.95
04-Oct-24 22:00:00	Unit Shut down	4.47	4.93
04-Oct-24 23:00:00	Unit Shut down	4.54	4.96
05-Oct-24 00:00:00	Unit Shut down	4.54	4.91
05-Oct-24 01:00:00	Unit Shut down	4.53	4.99
05-Oct-24 02:00:00	Unit Shut down	4.51	4.99
05-Oct-24 03:00:00	Unit Shut down	4.51	4.97
05-Oct-24 04:00:00	Unit Shut down	4.48	4.98
05-Oct-24 05:00:00	Unit Shut down	4.47	4.93
05-Oct-24 06:00:00	Unit Shut down	4.46	4.94



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
05-Oct-24 07:00:00	Unit Shut down	4.43	4.90
05-Oct-24 08:00:00	Unit Shut down	4.48	4.91
05-Oct-24 09:00:00	Unit Shut down	4.48	4.88
05-Oct-24 10:00:00	Unit Shut down	4.48	4.91
05-Oct-24 11:00:00	Unit Shut down	4.46	4.91
05-Oct-24 12:00:00	Unit Shut down	4.45	4.92
05-Oct-24 13:00:00	Unit Shut down	4.45	4.96
05-Oct-24 14:00:00	Unit Shut down	4.99	4.92
05-Oct-24 15:00:00	Unit Shut down	4.45	4.95
05-Oct-24 16:00:00	Unit Shut down	4.43	4.88
05-Oct-24 17:00:00	Unit Shut down	4.44	4.94
05-Oct-24 18:00:00	Unit Shut down	4.45	4.96
05-Oct-24 19:00:00	Unit Shut down	4.46	4.96
05-Oct-24 20:00:00	Unit Shut down	4.45	4.98
05-Oct-24 21:00:00	Unit Shut down	4.41	4.98
05-Oct-24 22:00:00	Unit Shut down	4.38	4.98
05-Oct-24 23:00:00	Unit Shut down	4.45	4.96
06-Oct-24 00:00:00	Unit Shut down	4.44	4.94
06-Oct-24 01:00:00	Unit Shut down	4.43	4.94
06-Oct-24 02:00:00	Unit Shut down	4.42	4.94
06-Oct-24 03:00:00	Unit Shut down	4.39	4.93
06-Oct-24 04:00:00	Unit Shut down	4.39	4.90
06-Oct-24 05:00:00	Unit Shut down	4.41	4.96
06-Oct-24 06:00:00	Unit Shut down	4.41	4.96
06-Oct-24 07:00:00	Unit Shut down	4.10	4.92
06-Oct-24 08:00:00	Unit Shut down	Unit Shut down	4.92
06-Oct-24 09:00:00	Unit Shut down	Unit Shut down	4.93
06-Oct-24 10:00:00	Unit Shut down	Unit Shut down	4.95
06-Oct-24 11:00:00	Unit Shut down	Unit Shut down	5.00
06-Oct-24 12:00:00	Unit Shut down	4.99	4.98
06-Oct-24 13:00:00	Unit Shut down	4.99	4.89
06-Oct-24 14:00:00	Unit Shut down	4.99	4.93
06-Oct-24 15:00:00	Unit Shut down	4.99	4.96

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
06-Oct-24 16:00:00	Unit Shut down	4.99	4.91
06-Oct-24 17:00:00	Unit Shut down	4.99	4.98
06-Oct-24 18:00:00	Unit Shut down	4.99	4.91
06-Oct-24 19:00:00	Unit Shut down	4.99	4.91
06-Oct-24 20:00:00	Unit Shut down	4.99	4.97
06-Oct-24 21:00:00	Unit Shut down	4.99	4.94
06-Oct-24 22:00:00	Unit Shut down	4.99	4.89
06-Oct-24 23:00:00	Unit Shut down	4.99	4.92
07-Oct-24 00:00:00	Unit Shut down	4.99	4.96
07-Oct-24 01:00:00	Unit Shut down	4.99	4.95
07-Oct-24 02:00:00	Unit Shut down	4.99	4.94
07-Oct-24 03:00:00	Unit Shut down	4.38	4.90
07-Oct-24 04:00:00	Unit Shut down	4.38	4.98
07-Oct-24 05:00:00	Unit Shut down	4.34	4.95
07-Oct-24 06:00:00	Unit Shut down	4.32	4.88
07-Oct-24 07:00:00	Unit Shut down	4.99	4.91
07-Oct-24 08:00:00	Unit Shut down	4.35	4.97
07-Oct-24 09:00:00	Unit Shut down	4.99	4.92
07-Oct-24 10:00:00	Unit Shut down	4.99	4.92
07-Oct-24 11:00:00	Unit Shut down	4.99	4.95
07-Oct-24 12:00:00	Unit Shut down	4.99	4.92
07-Oct-24 13:00:00	Unit Shut down	4.99	4.91
07-Oct-24 14:00:00	Unit Shut down	4.99	4.98
07-Oct-24 15:00:00	Unit Shut down	4.99	4.87
07-Oct-24 16:00:00	Unit Shut down	4.99	4.93
07-Oct-24 17:00:00	Unit Shut down	4.99	4.96
07-Oct-24 18:00:00	Unit Shut down	4.99	4.97
07-Oct-24 19:00:00	Unit Shut down	4.99	4.92
07-Oct-24 20:00:00	Unit Shut down	4.99	4.95
07-Oct-24 21:00:00	Unit Shut down	4.99	4.89
07-Oct-24 22:00:00	Unit Shut down	4.99	4.90
07-Oct-24 23:00:00	Unit Shut down	4.99	4.89
08-Oct-24 00:00:00	Unit Shut down	4.99	4.88

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
08-Oct-24 01:00:00	Unit Shut down	4.99	4.97
08-Oct-24 02:00:00	Unit Shut down	4.99	4.97
08-Oct-24 03:00:00	Unit Shut down	4.99	4.96
08-Oct-24 04:00:00	Unit Shut down	4.99	4.89
08-Oct-24 05:00:00	Unit Shut down	4.99	4.93
08-Oct-24 06:00:00	Unit Shut down	4.99	4.95
08-Oct-24 07:00:00	Unit Shut down	4.99	4.94
08-Oct-24 08:00:00	Unit Shut down	4.99	4.95
08-Oct-24 09:00:00	Unit Shut down	4.99	4.91
08-Oct-24 10:00:00	Unit Shut down	4.99	4.93
08-Oct-24 11:00:00	Unit Shut down	4.99	4.87
08-Oct-24 12:00:00	Unit Shut down	4.99	4.97
08-Oct-24 13:00:00	Unit Shut down	4.99	4.88
08-Oct-24 14:00:00	Unit Shut down	4.99	4.90
08-Oct-24 15:00:00	Unit Shut down	4.99	4.95
08-Oct-24 16:00:00	Unit Shut down	4.99	4.95
08-Oct-24 17:00:00	Unit Shut down	4.99	4.94
08-Oct-24 18:00:00	Unit Shut down	4.99	4.98
08-Oct-24 19:00:00	Unit Shut down	4.99	4.88
08-Oct-24 20:00:00	Unit Shut down	4.99	4.95
08-Oct-24 21:00:00	Unit Shut down	4.99	4.89
08-Oct-24 22:00:00	Unit Shut down	4.99	4.95
08-Oct-24 23:00:00	Unit Shut down	4.99	4.90
09-Oct-24 00:00:00	Unit Shut down	4.99	4.88
09-Oct-24 01:00:00	Unit Shut down	4.99	4.92
09-Oct-24 02:00:00	Unit Shut down	4.99	4.98
09-Oct-24 03:00:00	Unit Shut down	4.99	4.92
09-Oct-24 04:00:00	Unit Shut down	4.99	4.91
09-Oct-24 05:00:00	Unit Shut down	4.99	4.98
09-Oct-24 06:00:00	Unit Shut down	4.99	4.93
09-Oct-24 07:00:00	Unit Shut down	4.99	4.91
09-Oct-24 08:00:00	Unit Shut down	4.99	4.87
09-Oct-24 09:00:00	Unit Shut down	4.99	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
09-Oct-24 10:00:00	Unit Shut down	4.99	4.92
09-Oct-24 11:00:00	Unit Shut down	4.33	4.92
09-Oct-24 12:00:00	Unit Shut down	4.32	4.94
09-Oct-24 13:00:00	Unit Shut down	4.11	4.90
09-Oct-24 14:00:00	Unit Shut down	3.89	4.90
09-Oct-24 15:00:00	Unit Shut down	3.91	4.87
09-Oct-24 16:00:00	Unit Shut down	3.91	4.93
09-Oct-24 17:00:00	Unit Shut down	3.90	4.88
09-Oct-24 18:00:00	Unit Shut down	3.93	4.95
09-Oct-24 19:00:00	Unit Shut down	3.95	4.92
09-Oct-24 20:00:00	Unit Shut down	4.35	4.92
09-Oct-24 21:00:00	Unit Shut down	4.39	4.94
09-Oct-24 22:00:00	Unit Shut down	4.30	4.98
09-Oct-24 23:00:00	Unit Shut down	4.46	4.98
10-Oct-24 00:00:00	Unit Shut down	4.49	4.97
10-Oct-24 01:00:00	Unit Shut down	4.49	4.88
10-Oct-24 02:00:00	Unit Shut down	4.47	4.93
10-Oct-24 03:00:00	Unit Shut down	4.47	4.88
10-Oct-24 04:00:00	Unit Shut down	4.46	4.94
10-Oct-24 05:00:00	Unit Shut down	4.43	4.94
10-Oct-24 06:00:00	Unit Shut down	4.41	4.87
10-Oct-24 07:00:00	Unit Shut down	4.36	4.88
10-Oct-24 08:00:00	Unit Shut down	4.40	4.94
10-Oct-24 09:00:00	Unit Shut down	4.38	4.89
10-Oct-24 10:00:00	Unit Shut down	4.41	4.91
10-Oct-24 11:00:00	Unit Shut down	4.41	4.96
10-Oct-24 12:00:00	Unit Shut down	4.41	4.93
10-Oct-24 13:00:00	Unit Shut down	4.41	4.97
10-Oct-24 14:00:00	Unit Shut down	4.41	4.92
10-Oct-24 15:00:00	Unit Shut down	4.41	4.90
10-Oct-24 16:00:00	Unit Shut down	4.40	4.88
10-Oct-24 17:00:00	Unit Shut down	4.40	4.96
10-Oct-24 18:00:00	Unit Shut down	4.40	4.92



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
10-Oct-24 19:00:00	Unit Shut down	4.40	4.92
10-Oct-24 20:00:00	Unit Shut down	4.40	4.87
10-Oct-24 21:00:00	Unit Shut down	4.40	4.90
10-Oct-24 22:00:00	Unit Shut down	4.40	4.90
10-Oct-24 23:00:00	Unit Shut down	4.40	4.90
11-Oct-24 00:00:00	Unit Shut down	4.40	4.97
11-Oct-24 01:00:00	Unit Shut down	4.39	4.96
11-Oct-24 02:00:00	Unit Shut down	4.39	4.92
11-Oct-24 03:00:00	Unit Shut down	4.39	4.95
11-Oct-24 04:00:00	Unit Shut down	4.39	4.88
11-Oct-24 05:00:00	Unit Shut down	4.39	4.88
11-Oct-24 06:00:00	Unit Shut down	4.39	4.96
11-Oct-24 07:00:00	Unit Shut down	4.39	4.90
11-Oct-24 08:00:00	Unit Shut down	4.39	4.92
11-Oct-24 09:00:00	Unit Shut down	4.39	4.95
11-Oct-24 10:00:00	Unit Shut down	4.38	4.92
11-Oct-24 11:00:00	Unit Shut down	4.38	4.89
11-Oct-24 12:00:00	Unit Shut down	4.38	4.95
11-Oct-24 13:00:00	Unit Shut down	4.38	4.92
11-Oct-24 14:00:00	Unit Shut down	4.38	4.95
11-Oct-24 15:00:00	Unit Shut down	4.38	4.93
11-Oct-24 16:00:00	Unit Shut down	4.38	4.87
11-Oct-24 17:00:00	Unit Shut down	4.38	4.90
11-Oct-24 18:00:00	Unit Shut down	4.38	4.92
11-Oct-24 19:00:00	Unit Shut down	4.37	4.88
11-Oct-24 20:00:00	Unit Shut down	4.37	4.89
11-Oct-24 21:00:00	Unit Shut down	4.37	4.96
11-Oct-24 22:00:00	Unit Shut down	4.37	4.93
11-Oct-24 23:00:00	Unit Shut down	4.37	4.97
12-Oct-24 00:00:00	Unit Shut down	4.37	4.95
12-Oct-24 01:00:00	Unit Shut down	4.37	4.97
12-Oct-24 02:00:00	Unit Shut down	4.37	4.90
12-Oct-24 03:00:00	Unit Shut down	4.37	4.89

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
12-Oct-24 04:00:00	Unit Shut down	4.36	4.91
12-Oct-24 05:00:00	Unit Shut down	4.36	4.91
12-Oct-24 06:00:00	Unit Shut down	4.36	4.91
12-Oct-24 07:00:00	Unit Shut down	4.36	4.94
12-Oct-24 08:00:00	Unit Shut down	4.36	4.94
12-Oct-24 09:00:00	Unit Shut down	4.36	4.96
12-Oct-24 10:00:00	Unit Shut down	4.36	4.96
12-Oct-24 11:00:00	Unit Shut down	4.36	4.91
12-Oct-24 12:00:00	Unit Shut down	4.36	4.97
12-Oct-24 13:00:00	Unit Shut down	4.36	4.88
12-Oct-24 14:00:00	Unit Shut down	4.35	4.97
12-Oct-24 15:00:00	Unit Shut down	4.35	4.91
12-Oct-24 16:00:00	Unit Shut down	4.35	4.93
12-Oct-24 17:00:00	Unit Shut down	4.35	4.90
12-Oct-24 18:00:00	Unit Shut down	4.35	4.98
12-Oct-24 19:00:00	Unit Shut down	4.35	4.89
12-Oct-24 20:00:00	Unit Shut down	4.35	4.95
12-Oct-24 21:00:00	Unit Shut down	4.35	4.93
12-Oct-24 22:00:00	Unit Shut down	4.35	4.99
12-Oct-24 23:00:00	Unit Shut down	4.34	4.97
13-Oct-24 00:00:00	Unit Shut down	4.34	4.93
13-Oct-24 01:00:00	Unit Shut down	4.34	4.91
13-Oct-24 02:00:00	Unit Shut down	4.34	4.95
13-Oct-24 03:00:00	Unit Shut down	4.34	4.94
13-Oct-24 04:00:00	Unit Shut down	4.34	4.96
13-Oct-24 05:00:00	Unit Shut down	4.34	4.92
13-Oct-24 06:00:00	Unit Shut down	4.34	4.90
13-Oct-24 07:00:00	Unit Shut down	4.34	4.92
13-Oct-24 08:00:00	Unit Shut down	4.33	4.90
13-Oct-24 09:00:00	Unit Shut down	4.33	4.94
13-Oct-24 10:00:00	Unit Shut down	4.33	4.89
13-Oct-24 11:00:00	Unit Shut down	4.33	4.92
13-Oct-24 12:00:00	Unit Shut down	4.33	4.92

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
13-Oct-24 13:00:00	Unit Shut down	4.33	4.93
13-Oct-24 14:00:00	Unit Shut down	4.33	4.88
13-Oct-24 15:00:00	Unit Shut down	4.33	4.90
13-Oct-24 16:00:00	Unit Shut down	4.33	4.96
13-Oct-24 17:00:00	Unit Shut down	4.32	4.95
13-Oct-24 18:00:00	Unit Shut down	4.32	4.95
13-Oct-24 19:00:00	Unit Shut down	4.32	4.88
13-Oct-24 20:00:00	Unit Shut down	4.32	4.91
13-Oct-24 21:00:00	Unit Shut down	4.32	4.89
13-Oct-24 22:00:00	Unit Shut down	4.32	4.96
13-Oct-24 23:00:00	Unit Shut down	4.32	4.94
14-Oct-24 00:00:00	Unit Shut down	4.32	4.93
14-Oct-24 01:00:00	Unit Shut down	4.32	4.89
14-Oct-24 02:00:00	Unit Shut down	4.31	4.91
14-Oct-24 03:00:00	Unit Shut down	4.31	4.88
14-Oct-24 04:00:00	Unit Shut down	4.31	4.98
14-Oct-24 05:00:00	Unit Shut down	4.31	4.88
14-Oct-24 06:00:00	Unit Shut down	4.31	4.89
14-Oct-24 07:00:00	Unit Shut down	4.31	4.89
14-Oct-24 08:00:00	Unit Shut down	4.31	4.92
14-Oct-24 09:00:00	Unit Shut down	4.31	4.92
14-Oct-24 10:00:00	Unit Shut down	4.99	4.93
14-Oct-24 11:00:00	Unit Shut down	4.99	4.93
14-Oct-24 12:00:00	Unit Shut down	4.99	4.91
14-Oct-24 13:00:00	Unit Shut down	4.99	4.98
14-Oct-24 14:00:00	Unit Shut down	4.99	4.87
14-Oct-24 15:00:00	Unit Shut down	4.99	4.89
14-Oct-24 16:00:00	Unit Shut down	4.99	4.95
14-Oct-24 17:00:00	Unit Shut down	4.99	4.92
14-Oct-24 18:00:00	Unit Shut down	4.99	4.90
14-Oct-24 19:00:00	Unit Shut down	4.30	4.94
14-Oct-24 20:00:00	Unit Shut down	4.30	4.97
14-Oct-24 21:00:00	Unit Shut down	4.29	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
14-Oct-24 22:00:00	Unit Shut down	4.29	4.98
14-Oct-24 23:00:00	Unit Shut down	4.29	4.91
15-Oct-24 00:00:00	Unit Shut down	4.29	4.98
15-Oct-24 01:00:00	Unit Shut down	4.29	4.98
15-Oct-24 02:00:00	Unit Shut down	4.29	4.97
15-Oct-24 03:00:00	Unit Shut down	4.29	4.89
15-Oct-24 04:00:00	Unit Shut down	4.29	4.89
15-Oct-24 05:00:00	Unit Shut down	4.29	4.90
15-Oct-24 06:00:00	Unit Shut down	4.28	4.98
15-Oct-24 07:00:00	Unit Shut down	4.28	4.88
15-Oct-24 08:00:00	Unit Shut down	4.28	4.90
15-Oct-24 09:00:00	Unit Shut down	4.99	4.94
15-Oct-24 10:00:00	Unit Shut down	4.99	4.95
15-Oct-24 11:00:00	Unit Shut down	4.99	4.93
15-Oct-24 12:00:00	Unit Shut down	4.99	4.93
15-Oct-24 13:00:00	Unit Shut down	4.99	4.99
15-Oct-24 14:00:00	Unit Shut down	4.99	4.98
15-Oct-24 15:00:00	Unit Shut down	4.99	4.94
15-Oct-24 16:00:00	Unit Shut down	4.99	4.90
15-Oct-24 17:00:00	Unit Shut down	4.99	4.89
15-Oct-24 18:00:00	Unit Shut down	4.99	4.95
15-Oct-24 19:00:00	Unit Shut down	4.27	4.88
15-Oct-24 20:00:00	Unit Shut down	4.27	4.94
15-Oct-24 21:00:00	Unit Shut down	4.27	4.88
15-Oct-24 22:00:00	Unit Shut down	4.27	4.91
15-Oct-24 23:00:00	Unit Shut down	4.27	4.92
16-Oct-24 00:00:00	Unit Shut down	4.26	4.99
16-Oct-24 01:00:00	Unit Shut down	4.26	4.95
16-Oct-24 02:00:00	Unit Shut down	4.26	4.95
16-Oct-24 03:00:00	Unit Shut down	4.26	4.89
16-Oct-24 04:00:00	Unit Shut down	4.26	4.94
16-Oct-24 05:00:00	Unit Shut down	4.26	4.99
16-Oct-24 06:00:00	Unit Shut down	4.26	4.90



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
16-Oct-24 07:00:00	Unit Shut down	4.26	4.99
16-Oct-24 08:00:00	Unit Shut down	4.26	4.88
16-Oct-24 09:00:00	Unit Shut down	4.25	4.96
16-Oct-24 10:00:00	Unit Shut down	4.25	4.93
16-Oct-24 11:00:00	Unit Shut down	4.25	4.95
16-Oct-24 12:00:00	Unit Shut down	4.25	4.95
16-Oct-24 13:00:00	Unit Shut down	4.25	4.89
16-Oct-24 14:00:00	Unit Shut down	4.25	4.88
16-Oct-24 15:00:00	Unit Shut down	4.25	4.91
16-Oct-24 16:00:00	Unit Shut down	4.25	4.95
16-Oct-24 17:00:00	Unit Shut down	4.25	4.98
16-Oct-24 18:00:00	Unit Shut down	4.24	4.97
16-Oct-24 19:00:00	Unit Shut down	4.24	4.92
16-Oct-24 20:00:00	Unit Shut down	4.24	4.93
16-Oct-24 21:00:00	Unit Shut down	4.24	4.92
16-Oct-24 22:00:00	Unit Shut down	4.24	4.94
16-Oct-24 23:00:00	Unit Shut down	4.24	4.94
17-Oct-24 00:00:00	Unit Shut down	4.24	4.92
17-Oct-24 01:00:00	Unit Shut down	4.24	4.88
17-Oct-24 02:00:00	Unit Shut down	4.24	4.97
17-Oct-24 03:00:00	Unit Shut down	4.23	4.93
17-Oct-24 04:00:00	Unit Shut down	4.23	4.97
17-Oct-24 05:00:00	Unit Shut down	4.23	4.88
17-Oct-24 06:00:00	Unit Shut down	4.23	4.94
17-Oct-24 07:00:00	Unit Shut down	4.23	4.97
17-Oct-24 08:00:00	Unit Shut down	4.23	4.91
17-Oct-24 09:00:00	Unit Shut down	4.23	4.89
17-Oct-24 10:00:00	Unit Shut down	4.23	4.93
17-Oct-24 11:00:00	Unit Shut down	4.23	4.97
17-Oct-24 12:00:00	Unit Shut down	4.22	4.95
17-Oct-24 13:00:00	Unit Shut down	4.22	4.88
17-Oct-24 14:00:00	Unit Shut down	4.22	4.88
17-Oct-24 15:00:00	Unit Shut down	4.22	4.88

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
17-Oct-24 16:00:00	Unit Shut down	4.22	4.88
17-Oct-24 17:00:00	Unit Shut down	4.25	4.92
17-Oct-24 18:00:00	Unit Shut down	4.26	4.88
17-Oct-24 19:00:00	Unit Shut down	4.99	4.92
17-Oct-24 20:00:00	Unit Shut down	4.99	4.92
17-Oct-24 21:00:00	Unit Shut down	4.99	4.90
17-Oct-24 22:00:00	Unit Shut down	4.99	4.98
17-Oct-24 23:00:00	Unit Shut down	4.33	4.88
18-Oct-24 00:00:00	Unit Shut down	4.50	4.87
18-Oct-24 01:00:00	Unit Shut down	4.49	4.88
18-Oct-24 02:00:00	Unit Shut down	4.49	4.89
18-Oct-24 03:00:00	Unit Shut down	4.47	4.89
18-Oct-24 04:00:00	Unit Shut down	4.46	4.99
18-Oct-24 05:00:00	Unit Shut down	4.45	4.92
18-Oct-24 06:00:00	Unit Shut down	4.46	4.90
18-Oct-24 07:00:00	Unit Shut down	4.44	4.96
18-Oct-24 08:00:00	Unit Shut down	4.99	4.96
18-Oct-24 09:00:00	Unit Shut down	4.99	4.88
18-Oct-24 10:00:00	Unit Shut down	4.99	4.91
18-Oct-24 11:00:00	Unit Shut down	4.99	4.87
18-Oct-24 12:00:00	Unit Shut down	4.99	4.93
18-Oct-24 13:00:00	Unit Shut down	4.99	4.91
18-Oct-24 14:00:00	Unit Shut down	4.99	4.89
18-Oct-24 15:00:00	Unit Shut down	4.99	4.94
18-Oct-24 16:00:00	Unit Shut down	4.99	4.91
18-Oct-24 17:00:00	Unit Shut down	4.99	4.98
18-Oct-24 18:00:00	Unit Shut down	4.99	4.92
18-Oct-24 19:00:00	Unit Shut down	4.99	4.98
18-Oct-24 20:00:00	Unit Shut down	4.99	4.90
18-Oct-24 21:00:00	Unit Shut down	4.52	4.91
18-Oct-24 22:00:00	Unit Shut down	4.59	4.89
18-Oct-24 23:00:00	Unit Shut down	4.58	4.87
19-Oct-24 00:00:00	Unit Shut down	4.45	4.89

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
19-Oct-24 01:00:00	Unit Shut down	4.39	4.99
19-Oct-24 02:00:00	Unit Shut down	4.36	4.94
19-Oct-24 03:00:00	Unit Shut down	4.34	4.93
19-Oct-24 04:00:00	Unit Shut down	4.34	4.95
19-Oct-24 05:00:00	Unit Shut down	4.34	4.91
19-Oct-24 06:00:00	Unit Shut down	4.32	4.96
19-Oct-24 07:00:00	Unit Shut down	4.29	4.96
19-Oct-24 08:00:00	Unit Shut down	4.37	4.98
19-Oct-24 09:00:00	Unit Shut down	4.48	4.92
19-Oct-24 10:00:00	Unit Shut down	4.99	4.92
19-Oct-24 11:00:00	Unit Shut down	4.99	4.96
19-Oct-24 12:00:00	Unit Shut down	4.99	4.90
19-Oct-24 13:00:00	Unit Shut down	4.99	4.89
19-Oct-24 14:00:00	Unit Shut down	4.99	4.99
19-Oct-24 15:00:00	Unit Shut down	4.99	4.96
19-Oct-24 16:00:00	Unit Shut down	4.99	4.98
19-Oct-24 17:00:00	Unit Shut down	4.99	4.91
19-Oct-24 18:00:00	Unit Shut down	4.99	4.93
19-Oct-24 19:00:00	Unit Shut down	4.99	4.98
19-Oct-24 20:00:00	Unit Shut down	4.99	4.96
19-Oct-24 21:00:00	Unit Shut down	4.99	4.88
19-Oct-24 22:00:00	Unit Shut down	4.99	4.97
19-Oct-24 23:00:00	Unit Shut down	4.48	4.97
20-Oct-24 00:00:00	Unit Shut down	4.35	4.87
20-Oct-24 01:00:00	Unit Shut down	4.31	4.95
20-Oct-24 02:00:00	Unit Shut down	4.29	4.96
20-Oct-24 03:00:00	Unit Shut down	4.32	5.00
20-Oct-24 04:00:00	Unit Shut down	4.32	4.99
20-Oct-24 05:00:00	Unit Shut down	4.99	4.96
20-Oct-24 06:00:00	Unit Shut down	4.99	4.96
20-Oct-24 07:00:00	Unit Shut down	4.99	4.92
20-Oct-24 08:00:00	Unit Shut down	4.20	4.89
20-Oct-24 09:00:00	Unit Shut down	4.24	4.98

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
20-Oct-24 10:00:00	Unit Shut down	4.25	5.00
20-Oct-24 11:00:00	Unit Shut down	4.26	4.89
20-Oct-24 12:00:00	Unit Shut down	4.99	4.93
20-Oct-24 13:00:00	Unit Shut down	4.99	4.88
20-Oct-24 14:00:00	Unit Shut down	4.99	4.89
20-Oct-24 15:00:00	Unit Shut down	4.99	4.92
20-Oct-24 16:00:00	Unit Shut down	4.99	4.94
20-Oct-24 17:00:00	Unit Shut down	4.99	4.87
20-Oct-24 18:00:00	Unit Shut down	4.99	4.98
20-Oct-24 19:00:00	Unit Shut down	4.99	4.93
20-Oct-24 20:00:00	Unit Shut down	4.99	4.89
20-Oct-24 21:00:00	Unit Shut down	4.99	4.99
20-Oct-24 22:00:00	Unit Shut down	4.99	4.94
20-Oct-24 23:00:00	Unit Shut down	4.56	4.92
21-Oct-24 00:00:00	Unit Shut down	4.55	4.91
21-Oct-24 01:00:00	Unit Shut down	4.57	4.92
21-Oct-24 02:00:00	Unit Shut down	4.55	4.90
21-Oct-24 03:00:00	Unit Shut down	4.53	4.91
21-Oct-24 04:00:00	Unit Shut down	4.52	4.91
21-Oct-24 05:00:00	Unit Shut down	4.50	4.90
21-Oct-24 06:00:00	Unit Shut down	4.47	4.93
21-Oct-24 07:00:00	Unit Shut down	4.41	4.97
21-Oct-24 08:00:00	Unit Shut down	4.99	4.90
21-Oct-24 09:00:00	Unit Shut down	4.99	4.89
21-Oct-24 10:00:00	Unit Shut down	4.99	4.96
21-Oct-24 11:00:00	Unit Shut down	4.99	4.88
21-Oct-24 12:00:00	Unit Shut down	4.99	4.98
21-Oct-24 13:00:00	Unit Shut down	4.99	4.96
21-Oct-24 14:00:00	Unit Shut down	4.99	4.88
21-Oct-24 15:00:00	Unit Shut down	4.99	4.92
21-Oct-24 16:00:00	Unit Shut down	4.99	4.92
21-Oct-24 17:00:00	Unit Shut down	4.99	4.98
21-Oct-24 18:00:00	Unit Shut down	4.99	4.91



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
21-Oct-24 19:00:00	Unit Shut down	4.52	4.92
21-Oct-24 20:00:00	Unit Shut down	4.50	4.95
21-Oct-24 21:00:00	Unit Shut down	4.51	4.95
21-Oct-24 22:00:00	Unit Shut down	4.48	4.94
21-Oct-24 23:00:00	Unit Shut down	4.60	4.93
22-Oct-24 00:00:00	Unit Shut down	4.61	4.90
22-Oct-24 01:00:00	Unit Shut down	4.59	4.92
22-Oct-24 02:00:00	Unit Shut down	4.53	4.92
22-Oct-24 03:00:00	Unit Shut down	4.50	4.89
22-Oct-24 04:00:00	Unit Shut down	4.50	4.96
22-Oct-24 05:00:00	Unit Shut down	4.47	4.96
22-Oct-24 06:00:00	Unit Shut down	4.45	4.94
22-Oct-24 07:00:00	Unit Shut down	4.38	4.96
22-Oct-24 08:00:00	Unit Shut down	4.39	4.92
22-Oct-24 09:00:00	Unit Shut down	4.39	4.89
22-Oct-24 10:00:00	Unit Shut down	4.39	4.88
22-Oct-24 11:00:00	Unit Shut down	4.40	4.99
22-Oct-24 12:00:00	Unit Shut down	4.39	4.97
22-Oct-24 13:00:00	Unit Shut down	4.99	4.96
22-Oct-24 14:00:00	Unit Shut down	4.99	4.89
22-Oct-24 15:00:00	Unit Shut down	4.99	4.96
22-Oct-24 16:00:00	Unit Shut down	4.99	4.92
22-Oct-24 17:00:00	Unit Shut down	4.99	4.88
22-Oct-24 18:00:00	Unit Shut down	4.99	4.93
22-Oct-24 19:00:00	Unit Shut down	4.46	4.88
22-Oct-24 20:00:00	Unit Shut down	4.38	4.91
22-Oct-24 21:00:00	Unit Shut down	4.52	4.92
22-Oct-24 22:00:00	Unit Shut down	4.56	4.98
22-Oct-24 23:00:00	Unit Shut down	4.48	4.93
23-Oct-24 00:00:00	Unit Shut down	4.57	4.94
23-Oct-24 01:00:00	Unit Shut down	4.80	4.94
23-Oct-24 02:00:00	Unit Shut down	4.77	4.94
23-Oct-24 03:00:00	Unit Shut down	4.75	4.98

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
23-Oct-24 04:00:00	Unit Shut down	4.69	4.92
23-Oct-24 05:00:00	Unit Shut down	4.68	4.88
23-Oct-24 06:00:00	Unit Shut down	4.72	4.87
23-Oct-24 07:00:00	Unit Shut down	4.79	4.97
23-Oct-24 08:00:00	Unit Shut down	4.98	4.96
23-Oct-24 09:00:00	Unit Shut down	4.80	4.97
23-Oct-24 10:00:00	Unit Shut down	4.57	4.95
23-Oct-24 11:00:00	Unit Shut down	4.70	4.94
23-Oct-24 12:00:00	Unit Shut down	4.92	4.94
23-Oct-24 13:00:00	Unit Shut down	4.87	4.92
23-Oct-24 14:00:00	Unit Shut down	4.95	4.94
23-Oct-24 15:00:00	Unit Shut down	4.83	4.97
23-Oct-24 16:00:00	Unit Shut down	4.39	4.98
23-Oct-24 17:00:00	Unit Shut down	4.40	4.93
23-Oct-24 18:00:00	Unit Shut down	4.38	4.97
23-Oct-24 19:00:00	Unit Shut down	4.44	4.90
23-Oct-24 20:00:00	Unit Shut down	4.40	4.95
23-Oct-24 21:00:00	Unit Shut down	4.37	4.94
23-Oct-24 22:00:00	Unit Shut down	4.36	4.97
23-Oct-24 23:00:00	Unit Shut down	4.36	4.98
24-Oct-24 00:00:00	Unit Shut down	4.16	4.89
24-Oct-24 01:00:00	Unit Shut down	4.13	4.91
24-Oct-24 02:00:00	Unit Shut down	4.11	4.96
24-Oct-24 03:00:00	Unit Shut down	4.10	4.97
24-Oct-24 04:00:00	Unit Shut down	4.07	4.94
24-Oct-24 05:00:00	Unit Shut down	4.07	4.92
24-Oct-24 06:00:00	Unit Shut down	4.03	4.97
24-Oct-24 07:00:00	Unit Shut down	4.02	4.88
24-Oct-24 08:00:00	Unit Shut down	4.09	4.97
24-Oct-24 09:00:00	Unit Shut down	4.33	4.97
24-Oct-24 10:00:00	Unit Shut down	4.30	4.95
24-Oct-24 11:00:00	Unit Shut down	4.31	4.99
24-Oct-24 12:00:00	Unit Shut down	4.27	4.95

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
24-Oct-24 13:00:00	Unit Shut down	4.30	4.89
24-Oct-24 14:00:00	Unit Shut down	4.27	4.91
24-Oct-24 15:00:00	Unit Shut down	4.28	4.88
24-Oct-24 16:00:00	Unit Shut down	4.27	4.98
24-Oct-24 17:00:00	Unit Shut down	4.27	4.90
24-Oct-24 18:00:00	Unit Shut down	4.03	4.97
24-Oct-24 19:00:00	Unit Shut down	4.20	4.96
24-Oct-24 20:00:00	Unit Shut down	4.33	4.92
24-Oct-24 21:00:00	Unit Shut down	4.35	4.97
24-Oct-24 22:00:00	Unit Shut down	4.38	4.93
24-Oct-24 23:00:00	Unit Shut down	4.42	4.96
25-Oct-24 00:00:00	Unit Shut down	4.42	4.94
25-Oct-24 01:00:00	Unit Shut down	4.44	4.99
25-Oct-24 02:00:00	Unit Shut down	4.44	4.89
25-Oct-24 03:00:00	Unit Shut down	4.43	4.89
25-Oct-24 04:00:00	Unit Shut down	4.43	4.95
25-Oct-24 05:00:00	Unit Shut down	4.43	4.92
25-Oct-24 06:00:00	Unit Shut down	4.37	4.98
25-Oct-24 07:00:00	Unit Shut down	4.32	4.97
25-Oct-24 08:00:00	Unit Shut down	4.37	4.92
25-Oct-24 09:00:00	Unit Shut down	4.37	4.99
25-Oct-24 10:00:00	Unit Shut down	4.33	4.97
25-Oct-24 11:00:00	Unit Shut down	4.29	4.97
25-Oct-24 12:00:00	Unit Shut down	4.99	4.95
25-Oct-24 13:00:00	Unit Shut down	4.99	4.98
25-Oct-24 14:00:00	Unit Shut down	4.99	4.98
25-Oct-24 15:00:00	Unit Shut down	4.99	4.91
25-Oct-24 16:00:00	Unit Shut down	4.99	4.95
25-Oct-24 17:00:00	Unit Shut down	4.32	4.92
25-Oct-24 18:00:00	Unit Shut down	4.32	4.99
25-Oct-24 19:00:00	Unit Shut down	4.35	4.87
25-Oct-24 20:00:00	Unit Shut down	4.41	4.91
25-Oct-24 21:00:00	Unit Shut down	4.42	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
25-Oct-24 22:00:00	Unit Shut down	4.46	4.93
25-Oct-24 23:00:00	Unit Shut down	4.52	4.97
26-Oct-24 00:00:00	Unit Shut down	4.51	4.92
26-Oct-24 01:00:00	Unit Shut down	4.54	4.89
26-Oct-24 02:00:00	Unit Shut down	4.54	4.92
26-Oct-24 03:00:00	Unit Shut down	4.53	4.91
26-Oct-24 04:00:00	Unit Shut down	4.51	4.92
26-Oct-24 05:00:00	Unit Shut down	4.52	4.91
26-Oct-24 06:00:00	Unit Shut down	4.56	4.96
26-Oct-24 07:00:00	Unit Shut down	4.49	4.98
26-Oct-24 08:00:00	Unit Shut down	4.51	4.90
26-Oct-24 09:00:00	Unit Shut down	4.48	4.98
26-Oct-24 10:00:00	Unit Shut down	4.48	4.91
26-Oct-24 11:00:00	Unit Shut down	4.47	4.94
26-Oct-24 12:00:00	Unit Shut down	4.99	4.96
26-Oct-24 13:00:00	Unit Shut down	4.99	4.93
26-Oct-24 14:00:00	Unit Shut down	4.99	4.96
26-Oct-24 15:00:00	Unit Shut down	4.99	4.99
26-Oct-24 16:00:00	Unit Shut down	4.99	4.88
26-Oct-24 17:00:00	Unit Shut down	4.47	4.97
26-Oct-24 18:00:00	Unit Shut down	4.51	4.94
26-Oct-24 19:00:00	Unit Shut down	4.51	4.97
26-Oct-24 20:00:00	Unit Shut down	4.51	4.96
26-Oct-24 21:00:00	Unit Shut down	4.47	4.95
26-Oct-24 22:00:00	Unit Shut down	4.48	4.95
26-Oct-24 23:00:00	Unit Shut down	4.49	4.99
27-Oct-24 00:00:00	Unit Shut down	4.47	4.98
27-Oct-24 01:00:00	Unit Shut down	4.49	4.93
27-Oct-24 02:00:00	Unit Shut down	4.49	4.93
27-Oct-24 03:00:00	Unit Shut down	4.49	4.91
27-Oct-24 04:00:00	Unit Shut down	4.50	4.91
27-Oct-24 05:00:00	Unit Shut down	4.49	4.91
27-Oct-24 06:00:00	Unit Shut down	4.50	4.92



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
27-Oct-24 07:00:00	Unit Shut down	4.44	4.93
27-Oct-24 08:00:00	Unit Shut down	4.48	4.98
27-Oct-24 09:00:00	Unit Shut down	4.47	4.91
27-Oct-24 10:00:00	Unit Shut down	4.45	4.98
27-Oct-24 11:00:00	Unit Shut down	4.43	4.93
27-Oct-24 12:00:00	Unit Shut down	4.43	4.94
27-Oct-24 13:00:00	Unit Shut down	4.41	4.92
27-Oct-24 14:00:00	Unit Shut down	4.99	4.89
27-Oct-24 15:00:00	Unit Shut down	4.99	4.93
27-Oct-24 16:00:00	Unit Shut down	4.42	4.99
27-Oct-24 17:00:00	Unit Shut down	4.46	4.98
27-Oct-24 18:00:00	Unit Shut down	4.42	4.89
27-Oct-24 19:00:00	Unit Shut down	4.43	4.92
27-Oct-24 20:00:00	Unit Shut down	4.39	4.94
27-Oct-24 21:00:00	Unit Shut down	4.47	4.94
27-Oct-24 22:00:00	Unit Shut down	4.45	4.92
27-Oct-24 23:00:00	Unit Shut down	4.43	4.98
28-Oct-24 00:00:00	Unit Shut down	4.47	4.95
28-Oct-24 01:00:00	Unit Shut down	4.47	4.98
28-Oct-24 02:00:00	Unit Shut down	4.46	4.97
28-Oct-24 03:00:00	Unit Shut down	4.50	4.88
28-Oct-24 04:00:00	Unit Shut down	4.51	4.98
28-Oct-24 05:00:00	Unit Shut down	4.48	4.91
28-Oct-24 06:00:00	Unit Shut down	4.46	4.98
28-Oct-24 07:00:00	Unit Shut down	4.42	4.97
28-Oct-24 08:00:00	Unit Shut down	4.46	4.96
28-Oct-24 09:00:00	Unit Shut down	4.45	4.94
28-Oct-24 10:00:00	Unit Shut down	4.42	4.91
28-Oct-24 11:00:00	Unit Shut down	4.41	4.90
28-Oct-24 12:00:00	Unit Shut down	4.99	4.95
28-Oct-24 13:00:00	Unit Shut down	4.99	4.90
28-Oct-24 14:00:00	Unit Shut down	4.99	4.97
28-Oct-24 15:00:00	Unit Shut down	4.99	4.89

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
28-Oct-24 16:00:00	Unit Shut down	4.44	4.92
28-Oct-24 17:00:00	Unit Shut down	4.44	4.98
28-Oct-24 18:00:00	Unit Shut down	4.44	4.91
28-Oct-24 19:00:00	Unit Shut down	4.50	4.96
28-Oct-24 20:00:00	Unit Shut down	4.48	4.91
28-Oct-24 21:00:00	Unit Shut down	4.48	4.95
28-Oct-24 22:00:00	Unit Shut down	4.45	4.98
28-Oct-24 23:00:00	Unit Shut down	4.46	4.97
29-Oct-24 00:00:00	Unit Shut down	4.48	4.96
29-Oct-24 01:00:00	Unit Shut down	4.52	4.89
29-Oct-24 02:00:00	Unit Shut down	4.53	4.90
29-Oct-24 03:00:00	Unit Shut down	4.47	4.94
29-Oct-24 04:00:00	Unit Shut down	4.47	4.95
29-Oct-24 05:00:00	Unit Shut down	4.48	4.92
29-Oct-24 06:00:00	Unit Shut down	4.51	4.98
29-Oct-24 07:00:00	Unit Shut down	4.43	4.91
29-Oct-24 08:00:00	Unit Shut down	4.50	4.93
29-Oct-24 09:00:00	Unit Shut down	4.45	4.92
29-Oct-24 10:00:00	Unit Shut down	4.39	4.91
29-Oct-24 11:00:00	Unit Shut down	4.50	4.91
29-Oct-24 12:00:00	Unit Shut down	4.48	4.89
29-Oct-24 13:00:00	Unit Shut down	4.51	4.97
29-Oct-24 14:00:00	Unit Shut down	4.49	4.90
29-Oct-24 15:00:00	Unit Shut down	4.50	4.88
29-Oct-24 16:00:00	Unit Shut down	4.51	4.98
29-Oct-24 17:00:00	Unit Shut down	4.99	4.92
29-Oct-24 18:00:00	Unit Shut down	4.99	4.91
29-Oct-24 19:00:00	Unit Shut down	4.99	4.91
29-Oct-24 20:00:00	Unit Shut down	4.99	4.99
29-Oct-24 21:00:00	Unit Shut down	4.99	4.99
29-Oct-24 22:00:00	Unit Shut down	4.99	4.94
29-Oct-24 23:00:00	Unit Shut down	4.99	4.92
30-Oct-24 00:00:00	Unit Shut down	4.99	4.95

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
30-Oct-24 01:00:00	Unit Shut down	4.99	4.97
30-Oct-24 02:00:00	Unit Shut down	4.99	4.97
30-Oct-24 03:00:00	Unit Shut down	4.99	4.96
30-Oct-24 04:00:00	Unit Shut down	4.99	4.83
30-Oct-24 05:00:00	Unit Shut down	4.99	4.88
30-Oct-24 06:00:00	Unit Shut down	4.99	4.95
30-Oct-24 07:00:00	Unit Shut down	4.99	4.83
30-Oct-24 08:00:00	Unit Shut down	4.99	4.96
30-Oct-24 09:00:00	Unit Shut down	4.99	4.96
30-Oct-24 10:00:00	Unit Shut down	4.99	4.99
30-Oct-24 11:00:00	Unit Shut down	4.99	4.95
30-Oct-24 12:00:00	Unit Shut down	4.99	4.97
30-Oct-24 13:00:00	Unit Shut down	4.99	4.97
30-Oct-24 14:00:00	Unit Shut down	4.99	4.92
30-Oct-24 15:00:00	Unit Shut down	4.99	4.87
30-Oct-24 16:00:00	Unit Shut down	4.99	4.87
30-Oct-24 17:00:00	Unit Shut down	4.99	4.98
30-Oct-24 18:00:00	Unit Shut down	4.99	4.88
30-Oct-24 19:00:00	Unit Shut down	4.99	4.97
30-Oct-24 20:00:00	Unit Shut down	4.99	4.97
30-Oct-24 21:00:00	Unit Shut down	4.99	4.99
30-Oct-24 22:00:00	Unit Shut down	4.37	4.95
30-Oct-24 23:00:00	Unit Shut down	4.41	4.99
31-Oct-24 00:00:00	Unit Shut down	4.39	4.88
31-Oct-24 01:00:00	Unit Shut down	4.38	4.97
31-Oct-24 02:00:00	Unit Shut down	4.44	4.99
31-Oct-24 03:00:00	Unit Shut down	4.44	4.98
31-Oct-24 04:00:00	Unit Shut down	4.45	4.93
31-Oct-24 05:00:00	Unit Shut down	4.45	4.92
31-Oct-24 06:00:00	Unit Shut down	4.47	4.90
31-Oct-24 07:00:00	Unit Shut down	4.42	4.89
31-Oct-24 08:00:00	Unit Shut down	4.50	4.90
31-Oct-24 09:00:00	Unit Shut down	4.49	4.88

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
31-Oct-24 10:00:00	Unit Shut down	4.35	4.91
31-Oct-24 11:00:00	Unit Shut down	4.31	4.92
31-Oct-24 12:00:00	Unit Shut down	4.30	4.92
31-Oct-24 13:00:00	Unit Shut down	4.34	4.87
31-Oct-24 14:00:00	Unit Shut down	4.32	4.96
31-Oct-24 15:00:00	Unit Shut down	4.31	4.96
31-Oct-24 16:00:00	Unit Shut down	4.33	4.96
31-Oct-24 17:00:00	Unit Shut down	4.40	4.94
31-Oct-24 18:00:00	Unit Shut down	4.41	4.90
31-Oct-24 19:00:00	Unit Shut down	4.44	4.96
31-Oct-24 20:00:00	Unit Shut down	4.44	4.97
31-Oct-24 21:00:00	Unit Shut down	4.41	4.91
31-Oct-24 22:00:00	Unit Shut down	4.39	4.98
31-Oct-24 23:00:00	Unit Shut down	4.42	4.92
01-Nov-24 00:00:00	Unit Shut down	4.35	4.97
01-Nov-24 01:00:00	Unit Shut down	4.26	4.88
01-Nov-24 02:00:00	Unit Shut down	4.22	4.93
01-Nov-24 03:00:00	Unit Shut down	4.24	4.88
01-Nov-24 04:00:00	Unit Shut down	4.23	4.93
01-Nov-24 05:00:00	Unit Shut down	4.23	4.88
01-Nov-24 06:00:00	Unit Shut down	4.25	4.89
01-Nov-24 07:00:00	Unit Shut down	4.21	4.91
01-Nov-24 08:00:00	Unit Shut down	4.25	4.90
01-Nov-24 09:00:00	Unit Shut down	4.24	4.92
01-Nov-24 10:00:00	Unit Shut down	4.99	4.89
01-Nov-24 11:00:00	Unit Shut down	4.99	4.99
01-Nov-24 12:00:00	Unit Shut down	4.99	4.92
01-Nov-24 13:00:00	Unit Shut down	4.99	4.88
01-Nov-24 14:00:00	Unit Shut down	4.99	4.92
01-Nov-24 15:00:00	Unit Shut down	4.99	4.94
01-Nov-24 16:00:00	Unit Shut down	4.99	4.93
01-Nov-24 17:00:00	Unit Shut down	4.99	4.88
01-Nov-24 18:00:00	Unit Shut down	4.99	4.92



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
01-Nov-24 19:00:00	Unit Shut down	4.99	4.96
01-Nov-24 20:00:00	Unit Shut down	4.31	4.99
01-Nov-24 21:00:00	Unit Shut down	4.28	4.88
01-Nov-24 22:00:00	Unit Shut down	4.05	4.96
01-Nov-24 23:00:00	Unit Shut down	4.09	4.96
02-Nov-24 00:00:00	Unit Shut down	4.09	4.92
02-Nov-24 01:00:00	Unit Shut down	4.08	4.90
02-Nov-24 02:00:00	Unit Shut down	4.06	4.97
02-Nov-24 03:00:00	Unit Shut down	4.03	4.98
02-Nov-24 04:00:00	Unit Shut down	4.02	4.97
02-Nov-24 05:00:00	Unit Shut down	4.00	4.94
02-Nov-24 06:00:00	Unit Shut down	4.01	4.95
02-Nov-24 07:00:00	Unit Shut down	3.95	4.90
02-Nov-24 08:00:00	Unit Shut down	3.97	4.87
02-Nov-24 09:00:00	Unit Shut down	4.99	4.94
02-Nov-24 10:00:00	Unit Shut down	4.99	4.94
02-Nov-24 11:00:00	Unit Shut down	4.99	4.93
02-Nov-24 12:00:00	Unit Shut down	4.99	4.86
02-Nov-24 13:00:00	Unit Shut down	4.99	4.97
02-Nov-24 14:00:00	Unit Shut down	4.99	4.96
02-Nov-24 15:00:00	Unit Shut down	4.99	4.90
02-Nov-24 16:00:00	Unit Shut down	4.99	4.99
02-Nov-24 17:00:00	Unit Shut down	4.99	4.90
02-Nov-24 18:00:00	Unit Shut down	4.99	4.98
02-Nov-24 19:00:00	Unit Shut down	4.99	4.88
02-Nov-24 20:00:00	Unit Shut down	4.99	4.94
02-Nov-24 21:00:00	Unit Shut down	4.99	4.96
02-Nov-24 22:00:00	Unit Shut down	4.99	4.99
02-Nov-24 23:00:00	Unit Shut down	4.99	4.94
03-Nov-24 00:00:00	Unit Shut down	4.99	4.95
03-Nov-24 01:00:00	Unit Shut down	4.99	4.91
03-Nov-24 02:00:00	Unit Shut down	4.99	4.97
03-Nov-24 03:00:00	Unit Shut down	4.99	4.98

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
03-Nov-24 04:00:00	Unit Shut down	4.99	4.96
03-Nov-24 05:00:00	Unit Shut down	4.99	4.98
03-Nov-24 06:00:00	Unit Shut down	4.99	4.95
03-Nov-24 07:00:00	Unit Shut down	4.99	4.92
03-Nov-24 08:00:00	Unit Shut down	4.99	4.86
03-Nov-24 09:00:00	Unit Shut down	4.99	4.91
03-Nov-24 10:00:00	Unit Shut down	4.99	4.93
03-Nov-24 11:00:00	Unit Shut down	4.99	4.93
03-Nov-24 12:00:00	Unit Shut down	4.99	4.92
03-Nov-24 13:00:00	Unit Shut down	4.99	4.94
03-Nov-24 14:00:00	Unit Shut down	4.99	4.97
03-Nov-24 15:00:00	Unit Shut down	4.99	4.88
03-Nov-24 16:00:00	Unit Shut down	4.99	4.98
03-Nov-24 17:00:00	Unit Shut down	4.99	4.95
03-Nov-24 18:00:00	Unit Shut down	4.99	4.93
03-Nov-24 19:00:00	Unit Shut down	4.99	4.95
03-Nov-24 20:00:00	Unit Shut down	4.23	4.93
03-Nov-24 21:00:00	Unit Shut down	4.18	4.93
03-Nov-24 22:00:00	Unit Shut down	4.15	4.95
03-Nov-24 23:00:00	Unit Shut down	4.15	4.93
04-Nov-24 00:00:00	Unit Shut down	4.09	4.84
04-Nov-24 01:00:00	Unit Shut down	4.07	4.96
04-Nov-24 02:00:00	Unit Shut down	4.05	4.93
04-Nov-24 03:00:00	Unit Shut down	4.02	4.85
04-Nov-24 04:00:00	Unit Shut down	4.02	4.85
04-Nov-24 05:00:00	Unit Shut down	4.01	4.90
04-Nov-24 06:00:00	Unit Shut down	4.99	4.92
04-Nov-24 07:00:00	Unit Shut down	4.99	4.86
04-Nov-24 08:00:00	Unit Shut down	4.99	4.79
04-Nov-24 09:00:00	Unit Shut down	4.99	4.55
04-Nov-24 10:00:00	Unit Shut down	4.99	4.44
04-Nov-24 11:00:00	Unit Shut down	4.99	4.49
04-Nov-24 12:00:00	Unit Shut down	4.99	4.43

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
04-Nov-24 13:00:00	Unit Shut down	4.99	4.41
04-Nov-24 14:00:00	Unit Shut down	4.99	4.47
04-Nov-24 15:00:00	Unit Shut down	4.99	4.71
04-Nov-24 16:00:00	Unit Shut down	4.99	4.50
04-Nov-24 17:00:00	Unit Shut down	4.99	4.44
04-Nov-24 18:00:00	Unit Shut down	4.99	4.44
04-Nov-24 19:00:00	Unit Shut down	4.99	4.52
04-Nov-24 20:00:00	Unit Shut down	4.33	4.88
04-Nov-24 21:00:00	Unit Shut down	4.31	4.90
04-Nov-24 22:00:00	Unit Shut down	4.14	4.88
04-Nov-24 23:00:00	Unit Shut down	4.13	4.85
05-Nov-24 00:00:00	Unit Shut down	3.97	4.85
05-Nov-24 01:00:00	Unit Shut down	4.10	4.92
05-Nov-24 02:00:00	Unit Shut down	4.08	4.84
05-Nov-24 03:00:00	Unit Shut down	4.08	4.77
05-Nov-24 04:00:00	Unit Shut down	4.06	4.78
05-Nov-24 05:00:00	Unit Shut down	4.06	4.77
05-Nov-24 06:00:00	Unit Shut down	4.01	4.73
05-Nov-24 07:00:00	Unit Shut down	4.99	4.70
05-Nov-24 08:00:00	Unit Shut down	4.99	4.72
05-Nov-24 09:00:00	Unit Shut down	4.99	4.75
05-Nov-24 10:00:00	Unit Shut down	4.99	4.76
05-Nov-24 11:00:00	Unit Shut down	4.99	4.73
05-Nov-24 12:00:00	Unit Shut down	4.99	4.75
05-Nov-24 13:00:00	Unit Shut down	4.99	4.76
05-Nov-24 14:00:00	Unit Shut down	4.99	4.70
05-Nov-24 15:00:00	Unit Shut down	4.99	4.76
05-Nov-24 16:00:00	Unit Shut down	4.99	4.71
05-Nov-24 17:00:00	Unit Shut down	4.99	4.78
05-Nov-24 18:00:00	Unit Shut down	4.99	4.83
05-Nov-24 19:00:00	Unit Shut down	4.99	4.84
05-Nov-24 20:00:00	Unit Shut down	4.99	4.84
05-Nov-24 21:00:00	Unit Shut down	4.99	4.88

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
05-Nov-24 22:00:00	Unit Shut down	4.99	4.87
05-Nov-24 23:00:00	Unit Shut down	4.99	4.92
06-Nov-24 00:00:00	Unit Shut down	4.99	4.80
06-Nov-24 01:00:00	Unit Shut down	4.22	4.89
06-Nov-24 02:00:00	Unit Shut down	4.18	4.97
06-Nov-24 03:00:00	Unit Shut down	4.17	4.98
06-Nov-24 04:00:00	Unit Shut down	4.15	4.99
06-Nov-24 05:00:00	Unit Shut down	4.15	4.97
06-Nov-24 06:00:00	Unit Shut down	4.99	4.95
06-Nov-24 07:00:00	Unit Shut down	4.99	4.86
06-Nov-24 08:00:00	Unit Shut down	4.99	4.99
06-Nov-24 09:00:00	Unit Shut down	4.99	4.96
06-Nov-24 10:00:00	Unit Shut down	4.99	4.95
06-Nov-24 11:00:00	Unit Shut down	4.99	4.92
06-Nov-24 12:00:00	Unit Shut down	4.99	4.91
06-Nov-24 13:00:00	Unit Shut down	4.99	4.93
06-Nov-24 14:00:00	Unit Shut down	4.99	4.94
06-Nov-24 15:00:00	Unit Shut down	4.99	4.95
06-Nov-24 16:00:00	Unit Shut down	4.99	4.90
06-Nov-24 17:00:00	Unit Shut down	4.99	4.88
06-Nov-24 18:00:00	Unit Shut down	4.99	4.96
06-Nov-24 19:00:00	Unit Shut down	4.99	4.90
06-Nov-24 20:00:00	Unit Shut down	4.99	4.95
06-Nov-24 21:00:00	Unit Shut down	4.99	4.98
06-Nov-24 22:00:00	Unit Shut down	4.17	4.92
06-Nov-24 23:00:00	Unit Shut down	4.14	4.98
07-Nov-24 00:00:00	Unit Shut down	4.14	4.89
07-Nov-24 01:00:00	Unit Shut down	4.15	4.97
07-Nov-24 02:00:00	Unit Shut down	4.12	4.93
07-Nov-24 03:00:00	Unit Shut down	4.11	4.91
07-Nov-24 04:00:00	Unit Shut down	4.99	4.82
07-Nov-24 05:00:00	Unit Shut down	4.99	4.89
07-Nov-24 06:00:00	Unit Shut down	4.99	4.79



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
07-Nov-24 07:00:00	Unit Shut down	4.99	4.68
07-Nov-24 08:00:00	Unit Shut down	4.99	4.66
07-Nov-24 09:00:00	Unit Shut down	4.99	4.68
07-Nov-24 10:00:00	Unit Shut down	4.99	4.65
07-Nov-24 11:00:00	Unit Shut down	4.99	4.67
07-Nov-24 12:00:00	Unit Shut down	4.99	4.64
07-Nov-24 13:00:00	Unit Shut down	4.99	4.71
07-Nov-24 14:00:00	Unit Shut down	4.99	4.85
07-Nov-24 15:00:00	Unit Shut down	4.99	4.98
07-Nov-24 16:00:00	Unit Shut down	4.99	4.94
07-Nov-24 17:00:00	Unit Shut down	4.99	4.94
07-Nov-24 18:00:00	Unit Shut down	4.99	4.97
07-Nov-24 19:00:00	Unit Shut down	4.99	4.90
07-Nov-24 20:00:00	Unit Shut down	4.99	4.96
07-Nov-24 21:00:00	Unit Shut down	4.99	4.92
07-Nov-24 22:00:00	Unit Shut down	4.99	4.99
07-Nov-24 23:00:00	Unit Shut down	4.99	4.89
08-Nov-24 00:00:00	Unit Shut down	4.99	4.98
08-Nov-24 01:00:00	Unit Shut down	4.99	4.93
08-Nov-24 02:00:00	Unit Shut down	4.99	4.96
08-Nov-24 03:00:00	Unit Shut down	4.99	4.95
08-Nov-24 04:00:00	Unit Shut down	4.99	4.92
08-Nov-24 05:00:00	Unit Shut down	4.99	4.90
08-Nov-24 06:00:00	Unit Shut down	4.99	4.90
08-Nov-24 07:00:00	Unit Shut down	4.99	4.99
08-Nov-24 08:00:00	Unit Shut down	4.99	4.97
08-Nov-24 09:00:00	Unit Shut down	4.99	4.99
08-Nov-24 10:00:00	Unit Shut down	4.99	4.98
08-Nov-24 11:00:00	Unit Shut down	4.99	4.95
08-Nov-24 12:00:00	Unit Shut down	4.99	4.90
08-Nov-24 13:00:00	Unit Shut down	4.99	4.89
08-Nov-24 14:00:00	Unit Shut down	4.99	4.97

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
08-Nov-24 16:00:00	Unit Shut down	4.99	4.91
08-Nov-24 17:00:00	Unit Shut down	4.99	4.93
08-Nov-24 18:00:00	Unit Shut down	4.99	4.90
08-Nov-24 19:00:00	Unit Shut down	4.99	4.91
08-Nov-24 20:00:00	Unit Shut down	4.99	4.95
08-Nov-24 21:00:00	Unit Shut down	4.99	4.89
08-Nov-24 22:00:00	Unit Shut down	4.99	4.94
08-Nov-24 23:00:00	Unit Shut down	4.99	4.94
09-Nov-24 00:00:00	Unit Shut down	4.99	4.89
09-Nov-24 01:00:00	Unit Shut down	4.99	4.91
09-Nov-24 02:00:00	Unit Shut down	4.99	4.91
09-Nov-24 03:00:00	Unit Shut down	4.99	4.87
09-Nov-24 04:00:00	Unit Shut down	4.99	4.93
09-Nov-24 05:00:00	Unit Shut down	4.99	4.98
09-Nov-24 06:00:00	Unit Shut down	4.99	4.96
09-Nov-24 07:00:00	Unit Shut down	4.99	4.89
09-Nov-24 08:00:00	Unit Shut down	4.99	4.93
09-Nov-24 09:00:00	Unit Shut down	4.99	4.93
09-Nov-24 10:00:00	Unit Shut down	4.99	4.88
09-Nov-24 11:00:00	Unit Shut down	4.99	4.98
09-Nov-24 12:00:00	Unit Shut down	4.99	4.91
09-Nov-24 13:00:00	Unit Shut down	4.99	4.98
09-Nov-24 14:00:00	Unit Shut down	4.99	4.92
09-Nov-24 15:00:00	Unit Shut down	4.99	4.87
09-Nov-24 16:00:00	Unit Shut down	4.99	4.96
09-Nov-24 17:00:00	Unit Shut down	4.99	4.88
09-Nov-24 18:00:00	Unit Shut down	4.99	4.94
09-Nov-24 19:00:00	Unit Shut down	4.99	4.91
09-Nov-24 20:00:00	Unit Shut down	4.99	4.98
09-Nov-24 21:00:00	Unit Shut down	4.99	4.94
09-Nov-24 22:00:00	Unit Shut down	4.99	4.95
09-Nov-24 23:00:00	Unit Shut down	4.99	4.98
10-Nov-24 00:00:00	Unit Shut down	4.99	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
10-Nov-24 01:00:00	Unit Shut down	4.99	4.93
10-Nov-24 02:00:00	Unit Shut down	4.99	4.87
10-Nov-24 03:00:00	Unit Shut down	4.99	4.94
10-Nov-24 04:00:00	Unit Shut down	4.99	4.99
10-Nov-24 05:00:00	Unit Shut down	4.99	4.91
10-Nov-24 06:00:00	Unit Shut down	4.99	4.97
10-Nov-24 07:00:00	Unit Shut down	4.99	4.88
10-Nov-24 08:00:00	Unit Shut down	4.99	4.89
10-Nov-24 09:00:00	Unit Shut down	4.99	4.94
10-Nov-24 10:00:00	Unit Shut down	4.99	4.93
10-Nov-24 11:00:00	Unit Shut down	4.99	4.97
10-Nov-24 12:00:00	Unit Shut down	4.99	4.92
10-Nov-24 13:00:00	Unit Shut down	4.99	4.96
10-Nov-24 14:00:00	Unit Shut down	4.99	4.91
10-Nov-24 15:00:00	Unit Shut down	4.99	4.97
10-Nov-24 16:00:00	Unit Shut down	4.99	4.90
10-Nov-24 17:00:00	Unit Shut down	4.99	4.93
10-Nov-24 18:00:00	Unit Shut down	4.99	4.99
10-Nov-24 19:00:00	Unit Shut down	4.99	4.98
10-Nov-24 20:00:00	Unit Shut down	4.99	4.97
10-Nov-24 21:00:00	Unit Shut down	4.99	4.98
10-Nov-24 22:00:00	Unit Shut down	4.99	4.91
10-Nov-24 23:00:00	Unit Shut down	4.22	5.00
11-Nov-24 00:00:00	Unit Shut down	4.21	4.93
11-Nov-24 01:00:00	Unit Shut down	4.20	4.88
11-Nov-24 02:00:00	Unit Shut down	4.19	4.98
11-Nov-24 03:00:00	Unit Shut down	4.20	4.96
11-Nov-24 04:00:00	Unit Shut down	4.99	4.91
11-Nov-24 05:00:00	Unit Shut down	4.99	4.89
11-Nov-24 06:00:00	Unit Shut down	4.18	4.91
11-Nov-24 07:00:00	Unit Shut down	4.99	4.95
11-Nov-24 08:00:00	Unit Shut down	4.99	4.95
11-Nov-24 09:00:00	Unit Shut down	4.99	4.88

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
11-Nov-24 10:00:00	Unit Shut down	4.99	4.94
11-Nov-24 11:00:00	Unit Shut down	4.99	4.87
11-Nov-24 12:00:00	Unit Shut down	4.99	4.94
11-Nov-24 13:00:00	Unit Shut down	4.99	4.84
11-Nov-24 14:00:00	Unit Shut down	4.99	4.96
11-Nov-24 15:00:00	Unit Shut down	4.99	4.94
11-Nov-24 16:00:00	Unit Shut down	4.99	4.91
11-Nov-24 17:00:00	Unit Shut down	4.99	4.94
11-Nov-24 18:00:00	Unit Shut down	4.99	4.95
11-Nov-24 19:00:00	Unit Shut down	4.99	4.98
11-Nov-24 20:00:00	Unit Shut down	4.99	4.98
11-Nov-24 21:00:00	Unit Shut down	4.99	4.98
11-Nov-24 22:00:00	Unit Shut down	4.99	4.78
11-Nov-24 23:00:00	Unit Shut down	4.99	4.69
12-Nov-24 00:00:00	Unit Shut down	4.99	4.77
12-Nov-24 01:00:00	Unit Shut down	4.99	4.96
12-Nov-24 02:00:00	Unit Shut down	4.99	4.97
12-Nov-24 03:00:00	Unit Shut down	4.99	4.99
12-Nov-24 04:00:00	Unit Shut down	4.99	4.95
12-Nov-24 05:00:00	Unit Shut down	4.99	4.88
12-Nov-24 06:00:00	Unit Shut down	4.99	4.94
12-Nov-24 07:00:00	Unit Shut down	4.99	4.98
12-Nov-24 08:00:00	Unit Shut down	4.99	4.97
12-Nov-24 09:00:00	Unit Shut down	4.99	4.89
12-Nov-24 10:00:00	Unit Shut down	4.99	4.99
12-Nov-24 11:00:00	Unit Shut down	4.99	4.94
12-Nov-24 12:00:00	Unit Shut down	4.99	4.93
12-Nov-24 13:00:00	Unit Shut down	4.99	4.84
12-Nov-24 14:00:00	Unit Shut down	4.99	4.92
12-Nov-24 15:00:00	Unit Shut down	4.99	4.92
12-Nov-24 16:00:00	Unit Shut down	4.99	4.95
12-Nov-24 17:00:00	Unit Shut down	4.99	4.96
12-Nov-24 18:00:00	Unit Shut down	4.99	4.89



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
12-Nov-24 19:00:00	Unit Shut down	4.99	4.92
12-Nov-24 20:00:00	Unit Shut down	4.99	4.96
12-Nov-24 21:00:00	Unit Shut down	4.99	4.91
12-Nov-24 22:00:00	Unit Shut down	4.99	4.93
12-Nov-24 23:00:00	Unit Shut down	4.99	4.95
13-Nov-24 00:00:00	Unit Shut down	4.99	4.91
13-Nov-24 01:00:00	Unit Shut down	4.99	4.97
13-Nov-24 02:00:00	Unit Shut down	4.99	4.89
13-Nov-24 03:00:00	Unit Shut down	4.99	4.89
13-Nov-24 04:00:00	Unit Shut down	4.99	4.93
13-Nov-24 05:00:00	Unit Shut down	4.99	4.98
13-Nov-24 06:00:00	Unit Shut down	4.99	4.92
13-Nov-24 07:00:00	Unit Shut down	4.99	4.95
13-Nov-24 08:00:00	Unit Shut down	4.99	4.93
13-Nov-24 09:00:00	Unit Shut down	4.99	4.95
13-Nov-24 10:00:00	Unit Shut down	4.99	5.00
13-Nov-24 11:00:00	Unit Shut down	4.99	4.89
13-Nov-24 12:00:00	Unit Shut down	4.99	4.93
13-Nov-24 13:00:00	Unit Shut down	4.99	4.92
13-Nov-24 14:00:00	Unit Shut down	4.99	4.90
13-Nov-24 15:00:00	Unit Shut down	4.99	4.98
13-Nov-24 16:00:00	Unit Shut down	4.99	4.93
13-Nov-24 17:00:00	Unit Shut down	4.99	4.93
13-Nov-24 18:00:00	Unit Shut down	4.99	4.93
13-Nov-24 19:00:00	Unit Shut down	4.99	4.91
13-Nov-24 20:00:00	Unit Shut down	4.99	4.94
13-Nov-24 21:00:00	Unit Shut down	4.99	4.90
13-Nov-24 22:00:00	Unit Shut down	4.99	4.92
13-Nov-24 23:00:00	Unit Shut down	4.99	4.97
14-Nov-24 00:00:00	Unit Shut down	4.99	4.98
14-Nov-24 01:00:00	Unit Shut down	4.99	4.98
14-Nov-24 02:00:00	Unit Shut down	4.99	4.96
14-Nov-24 03:00:00	Unit Shut down	4.99	4.94

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
14-Nov-24 04:00:00	Unit Shut down	4.99	4.96
14-Nov-24 05:00:00	Unit Shut down	4.99	4.94
14-Nov-24 06:00:00	Unit Shut down	4.99	4.89
14-Nov-24 07:00:00	Unit Shut down	4.99	4.96
14-Nov-24 08:00:00	Unit Shut down	4.99	4.94
14-Nov-24 09:00:00	Unit Shut down	4.99	4.96
14-Nov-24 10:00:00	Unit Shut down	4.99	4.90
14-Nov-24 11:00:00	Unit Shut down	4.99	4.91
14-Nov-24 12:00:00	Unit Shut down	4.99	4.91
14-Nov-24 13:00:00	Unit Shut down	4.99	4.92
14-Nov-24 14:00:00	Unit Shut down	4.99	4.90
14-Nov-24 15:00:00	Unit Shut down	4.99	4.91
14-Nov-24 16:00:00	Unit Shut down	4.99	4.95
14-Nov-24 17:00:00	Unit Shut down	4.99	4.95
14-Nov-24 18:00:00	Unit Shut down	4.99	4.91
14-Nov-24 19:00:00	Unit Shut down	4.99	4.94
14-Nov-24 20:00:00	Unit Shut down	4.99	4.92
14-Nov-24 21:00:00	Unit Shut down	4.99	4.90
14-Nov-24 22:00:00	Unit Shut down	4.99	4.99
14-Nov-24 23:00:00	Unit Shut down	4.99	4.93
15-Nov-24 00:00:00	Unit Shut down	4.99	4.91
15-Nov-24 01:00:00	Unit Shut down	4.99	4.97
15-Nov-24 02:00:00	Unit Shut down	4.99	4.90
15-Nov-24 03:00:00	Unit Shut down	4.99	4.90
15-Nov-24 04:00:00	Unit Shut down	4.99	4.98
15-Nov-24 05:00:00	Unit Shut down	4.99	4.87
15-Nov-24 06:00:00	Unit Shut down	4.99	4.89
15-Nov-24 07:00:00	Unit Shut down	4.99	4.91
15-Nov-24 08:00:00	Unit Shut down	4.99	4.95
15-Nov-24 09:00:00	Unit Shut down	4.99	4.94
15-Nov-24 10:00:00	Unit Shut down	4.99	4.97
15-Nov-24 11:00:00	Unit Shut down	4.99	4.87
15-Nov-24 12:00:00	Unit Shut down	4.99	4.99

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
15-Nov-24 13:00:00	Unit Shut down	4.99	4.92
15-Nov-24 14:00:00	Unit Shut down	4.99	4.95
15-Nov-24 15:00:00	Unit Shut down	4.99	4.97
15-Nov-24 16:00:00	Unit Shut down	4.99	4.99
15-Nov-24 17:00:00	Unit Shut down	4.99	4.96
15-Nov-24 18:00:00	Unit Shut down	4.99	4.91
15-Nov-24 19:00:00	Unit Shut down	4.99	4.98
15-Nov-24 20:00:00	Unit Shut down	4.99	4.87
15-Nov-24 21:00:00	Unit Shut down	4.99	4.88
15-Nov-24 22:00:00	Unit Shut down	4.99	4.96
15-Nov-24 23:00:00	Unit Shut down	4.99	4.97
16-Nov-24 00:00:00	Unit Shut down	4.99	4.89
16-Nov-24 01:00:00	Unit Shut down	4.99	4.91
16-Nov-24 02:00:00	Unit Shut down	4.99	4.92
16-Nov-24 03:00:00	Unit Shut down	4.99	4.99
16-Nov-24 04:00:00	Unit Shut down	4.99	4.94
16-Nov-24 05:00:00	Unit Shut down	4.99	4.93
16-Nov-24 06:00:00	Unit Shut down	4.13	4.92
16-Nov-24 07:00:00	Unit Shut down	4.99	4.92
16-Nov-24 08:00:00	Unit Shut down	4.99	4.88
16-Nov-24 09:00:00	Unit Shut down	4.99	4.92
16-Nov-24 10:00:00	Unit Shut down	4.99	4.92
16-Nov-24 11:00:00	Unit Shut down	4.99	4.88
16-Nov-24 12:00:00	Unit Shut down	4.99	4.94
16-Nov-24 13:00:00	Unit Shut down	4.99	4.91
16-Nov-24 14:00:00	Unit Shut down	4.99	4.96
16-Nov-24 15:00:00	Unit Shut down	4.99	4.96
16-Nov-24 16:00:00	Unit Shut down	4.99	4.90
16-Nov-24 17:00:00	Unit Shut down	4.99	4.98
16-Nov-24 18:00:00	Unit Shut down	4.99	4.89
16-Nov-24 19:00:00	Unit Shut down	4.99	4.97
16-Nov-24 20:00:00	Unit Shut down	4.99	4.97
16-Nov-24 21:00:00	Unit Shut down	4.99	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
16-Nov-24 22:00:00	Unit Shut down	4.99	4.93
16-Nov-24 23:00:00	Unit Shut down	4.99	4.92
17-Nov-24 00:00:00	Unit Shut down	4.99	4.92
17-Nov-24 01:00:00	Unit Shut down	4.99	4.88
17-Nov-24 02:00:00	Unit Shut down	4.99	4.99
17-Nov-24 03:00:00	Unit Shut down	4.99	4.95
17-Nov-24 04:00:00	Unit Shut down	4.99	4.92
17-Nov-24 05:00:00	Unit Shut down	4.99	4.92
17-Nov-24 06:00:00	Unit Shut down	4.99	4.87
17-Nov-24 07:00:00	Unit Shut down	4.99	3.04
17-Nov-24 08:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 09:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 10:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 11:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 12:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 13:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 14:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 15:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 16:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 17:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 18:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 19:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 20:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 21:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 22:00:00	Unit Shut down	4.99	Unit Shut down
17-Nov-24 23:00:00	Unit Shut down	4.99	Unit Shut down
18-Nov-24 00:00:00	Unit Shut down	4.99	Unit Shut down
18-Nov-24 01:00:00	Unit Shut down	4.99	Unit Shut down
18-Nov-24 02:00:00	Unit Shut down	4.99	Unit Shut down
18-Nov-24 03:00:00	Unit Shut down	4.99	Unit Shut down
18-Nov-24 04:00:00	Unit Shut down	4.99	Unit Shut down
18-Nov-24 05:00:00	Unit Shut down	4.99	Unit Shut down
18-Nov-24 06:00:00	Unit Shut down	4.99	Unit Shut down





Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
21-Nov-24 01:00:00	Unit Shut down	Unit Shut down	4.93
21-Nov-24 02:00:00	Unit Shut down	Unit Shut down	4.98
21-Nov-24 03:00:00	Unit Shut down	Unit Shut down	4.98
21-Nov-24 04:00:00	Unit Shut down	Unit Shut down	4.92
21-Nov-24 05:00:00	Unit Shut down	Unit Shut down	4.95
21-Nov-24 06:00:00	Unit Shut down	Unit Shut down	4.93
21-Nov-24 07:00:00	Unit Shut down	4.99	4.88
21-Nov-24 08:00:00	Unit Shut down	4.99	4.98
21-Nov-24 09:00:00	Unit Shut down	4.99	4.99
21-Nov-24 10:00:00	Unit Shut down	4.99	4.91
21-Nov-24 11:00:00	Unit Shut down	4.99	4.95
21-Nov-24 12:00:00	Unit Shut down	4.99	4.93
21-Nov-24 13:00:00	Unit Shut down	4.99	4.93
21-Nov-24 14:00:00	Unit Shut down	4.99	4.98
21-Nov-24 15:00:00	Unit Shut down	4.99	4.98
21-Nov-24 16:00:00	Unit Shut down	4.99	4.87
21-Nov-24 17:00:00	Unit Shut down	4.99	4.91
21-Nov-24 18:00:00	Unit Shut down	4.99	4.99
21-Nov-24 19:00:00	Unit Shut down	4.99	4.97
21-Nov-24 20:00:00	Unit Shut down	4.99	4.98
21-Nov-24 21:00:00	Unit Shut down	4.99	4.95
21-Nov-24 22:00:00	Unit Shut down	Unit Shut down	5.00
21-Nov-24 23:00:00	Unit Shut down	Unit Shut down	4.89
22-Nov-24 00:00:00	Unit Shut down	Unit Shut down	4.96
22-Nov-24 01:00:00	Unit Shut down	Unit Shut down	4.97
22-Nov-24 02:00:00	Unit Shut down	Unit Shut down	4.97
22-Nov-24 03:00:00	Unit Shut down	Unit Shut down	4.92
22-Nov-24 04:00:00	Unit Shut down	Unit Shut down	4.92
22-Nov-24 05:00:00	Unit Shut down	Unit Shut down	4.94
22-Nov-24 06:00:00	Unit Shut down	Unit Shut down	4.92
22-Nov-24 07:00:00	Unit Shut down	Unit Shut down	4.95
22-Nov-24 08:00:00	Unit Shut down	4.99	4.95
22-Nov-24 09:00:00	Unit Shut down	4.99	4.95

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
22-Nov-24 10:00:00	Unit Shut down	4.99	4.94
22-Nov-24 11:00:00	Unit Shut down	4.99	4.94
22-Nov-24 12:00:00	Unit Shut down	4.99	4.88
22-Nov-24 13:00:00	Unit Shut down	4.99	4.98
22-Nov-24 14:00:00	Unit Shut down	4.99	4.88
22-Nov-24 15:00:00	Unit Shut down	4.99	4.89
22-Nov-24 16:00:00	Unit Shut down	4.99	4.93
22-Nov-24 17:00:00	Unit Shut down	4.99	4.94
22-Nov-24 18:00:00	Unit Shut down	4.99	4.94
22-Nov-24 19:00:00	Unit Shut down	4.99	4.89
22-Nov-24 20:00:00	Unit Shut down	4.99	4.92
22-Nov-24 21:00:00	Unit Shut down	4.99	4.92
22-Nov-24 22:00:00	Unit Shut down	Unit Shut down	4.80
22-Nov-24 23:00:00	Unit Shut down	Unit Shut down	4.76
23-Nov-24 00:00:00	Unit Shut down	Unit Shut down	4.74
23-Nov-24 01:00:00	Unit Shut down	Unit Shut down	4.84
23-Nov-24 02:00:00	Unit Shut down	Unit Shut down	4.98
23-Nov-24 03:00:00	Unit Shut down	Unit Shut down	4.97
23-Nov-24 04:00:00	Unit Shut down	Unit Shut down	4.97
23-Nov-24 05:00:00	Unit Shut down	Unit Shut down	4.89
23-Nov-24 06:00:00	Unit Shut down	Unit Shut down	4.79
23-Nov-24 07:00:00	Unit Shut down	Unit Shut down	4.61
23-Nov-24 08:00:00	Unit Shut down	Unit Shut down	4.99
23-Nov-24 09:00:00	Unit Shut down	Unit Shut down	4.96
23-Nov-24 10:00:00	Unit Shut down	Unit Shut down	4.93
23-Nov-24 11:00:00	Unit Shut down	Unit Shut down	4.98
23-Nov-24 12:00:00	Unit Shut down	Unit Shut down	4.91
23-Nov-24 13:00:00	Unit Shut down	Unit Shut down	4.98
23-Nov-24 14:00:00	Unit Shut down	Unit Shut down	4.92
23-Nov-24 15:00:00	Unit Shut down	Unit Shut down	4.98
23-Nov-24 16:00:00	Unit Shut down	Unit Shut down	4.97
23-Nov-24 17:00:00	Unit Shut down	Unit Shut down	4.89
23-Nov-24 18:00:00	Unit Shut down	Unit Shut down	4.95



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
23-Nov-24 19:00:00	Unit Shut down	Unit Shut down	4.93
23-Nov-24 20:00:00	Unit Shut down	Unit Shut down	4.95
23-Nov-24 21:00:00	Unit Shut down	Unit Shut down	4.95
23-Nov-24 22:00:00	Unit Shut down	Unit Shut down	4.77
23-Nov-24 23:00:00	Unit Shut down	Unit Shut down	4.79
24-Nov-24 00:00:00	Unit Shut down	Unit Shut down	4.83
24-Nov-24 01:00:00	Unit Shut down	Unit Shut down	4.97
24-Nov-24 02:00:00	Unit Shut down	Unit Shut down	4.90
24-Nov-24 03:00:00	Unit Shut down	Unit Shut down	4.94
24-Nov-24 04:00:00	Unit Shut down	Unit Shut down	4.91
24-Nov-24 05:00:00	Unit Shut down	Unit Shut down	4.90
24-Nov-24 06:00:00	Unit Shut down	Unit Shut down	4.92
24-Nov-24 07:00:00	Unit Shut down	4.99	4.93
24-Nov-24 08:00:00	Unit Shut down	4.99	4.97
24-Nov-24 09:00:00	Unit Shut down	4.99	4.97
24-Nov-24 10:00:00	Unit Shut down	4.99	4.94
24-Nov-24 11:00:00	Unit Shut down	4.99	4.90
24-Nov-24 12:00:00	Unit Shut down	4.99	4.99
24-Nov-24 13:00:00	Unit Shut down	4.99	4.94
24-Nov-24 14:00:00	Unit Shut down	4.99	4.94
24-Nov-24 15:00:00	Unit Shut down	4.99	4.95
24-Nov-24 16:00:00	Unit Shut down	4.99	4.95
24-Nov-24 17:00:00	Unit Shut down	4.99	4.98
24-Nov-24 18:00:00	Unit Shut down	4.99	4.97
24-Nov-24 19:00:00	Unit Shut down	4.99	4.94
24-Nov-24 20:00:00	Unit Shut down	4.99	4.99
24-Nov-24 21:00:00	Unit Shut down	Unit Shut down	4.89
24-Nov-24 22:00:00	Unit Shut down	Unit Shut down	4.81
24-Nov-24 23:00:00	Unit Shut down	Unit Shut down	4.79
25-Nov-24 00:00:00	Unit Shut down	Unit Shut down	4.89
25-Nov-24 01:00:00	Unit Shut down	2.85	4.93
25-Nov-24 02:00:00	Unit Shut down	4.30	4.91
25-Nov-24 03:00:00	Unit Shut down	4.13	4.99

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
25-Nov-24 04:00:00	Unit Shut down	3.64	4.89
25-Nov-24 05:00:00	Unit Shut down	3.47	4.90
25-Nov-24 06:00:00	Unit Shut down	3.41	4.94
25-Nov-24 07:00:00	Unit Shut down	2.90	4.96
25-Nov-24 08:00:00	Unit Shut down	Unit Shut down	4.98
25-Nov-24 09:00:00	Unit Shut down	4.99	4.92
25-Nov-24 10:00:00	Unit Shut down	4.99	4.90
25-Nov-24 11:00:00	Unit Shut down	4.99	4.90
25-Nov-24 12:00:00	Unit Shut down	4.99	4.94
25-Nov-24 13:00:00	Unit Shut down	4.99	4.92
25-Nov-24 14:00:00	Unit Shut down	4.99	4.94
25-Nov-24 15:00:00	Unit Shut down	4.99	4.92
25-Nov-24 16:00:00	Unit Shut down	4.99	4.99
25-Nov-24 17:00:00	Unit Shut down	4.99	5.00
25-Nov-24 18:00:00	Unit Shut down	4.99	4.98
25-Nov-24 19:00:00	Unit Shut down	4.99	4.95
25-Nov-24 20:00:00	Unit Shut down	4.99	4.89
25-Nov-24 21:00:00	Unit Shut down	4.99	4.83
25-Nov-24 22:00:00	Unit Shut down	4.99	4.84
25-Nov-24 23:00:00	Unit Shut down	4.99	4.97
26-Nov-24 00:00:00	Unit Shut down	4.99	4.99
26-Nov-24 01:00:00	Unit Shut down	Unit Shut down	4.88
26-Nov-24 02:00:00	Unit Shut down	Unit Shut down	4.91
26-Nov-24 03:00:00	Unit Shut down	Unit Shut down	4.85
26-Nov-24 04:00:00	Unit Shut down	Unit Shut down	4.98
26-Nov-24 05:00:00	Unit Shut down	Unit Shut down	4.98
26-Nov-24 06:00:00	Unit Shut down	Unit Shut down	4.97
26-Nov-24 07:00:00	Unit Shut down	Unit Shut down	4.95
26-Nov-24 08:00:00	Unit Shut down	Unit Shut down	4.89
26-Nov-24 09:00:00	Unit Shut down	4.99	4.89
26-Nov-24 10:00:00	Unit Shut down	4.99	4.95
26-Nov-24 11:00:00	Unit Shut down	4.99	4.95
26-Nov-24 12:00:00	Unit Shut down	4.99	4.81

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
26-Nov-24 13:00:00	Unit Shut down	4.99	4.82
26-Nov-24 14:00:00	Unit Shut down	4.99	4.97
26-Nov-24 15:00:00	Unit Shut down	4.99	4.96
26-Nov-24 16:00:00	Unit Shut down	4.99	4.97
26-Nov-24 17:00:00	Unit Shut down	4.99	4.97
26-Nov-24 18:00:00	Unit Shut down	4.99	4.96
26-Nov-24 19:00:00	Unit Shut down	4.99	4.93
26-Nov-24 20:00:00	Unit Shut down	4.99	4.89
26-Nov-24 21:00:00	Unit Shut down	4.99	4.91
26-Nov-24 22:00:00	Unit Shut down	4.99	4.94
26-Nov-24 23:00:00	Unit Shut down	4.99	4.90
27-Nov-24 00:00:00	Unit Shut down	4.99	4.96
27-Nov-24 01:00:00	Unit Shut down	Unit Shut down	4.93
27-Nov-24 02:00:00	Unit Shut down	Unit Shut down	4.89
27-Nov-24 03:00:00	Unit Shut down	4.99	4.96
27-Nov-24 04:00:00	Unit Shut down	4.99	4.69
27-Nov-24 05:00:00	Unit Shut down	4.99	4.90
27-Nov-24 06:00:00	Unit Shut down	4.99	4.97
27-Nov-24 07:00:00	Unit Shut down	Unit Shut down	4.98
27-Nov-24 08:00:00	Unit Shut down	Unit Shut down	4.95
27-Nov-24 09:00:00	Unit Shut down	Unit Shut down	4.91
27-Nov-24 10:00:00	Unit Shut down	Unit Shut down	4.95
27-Nov-24 11:00:00	Unit Shut down	Unit Shut down	4.97
27-Nov-24 12:00:00	Unit Shut down	Unit Shut down	4.97
27-Nov-24 13:00:00	Unit Shut down	Unit Shut down	4.90
27-Nov-24 14:00:00	Unit Shut down	Unit Shut down	4.96
27-Nov-24 15:00:00	Unit Shut down	Unit Shut down	4.90
27-Nov-24 16:00:00	Unit Shut down	Unit Shut down	4.87
27-Nov-24 17:00:00	Unit Shut down	Unit Shut down	4.95
27-Nov-24 18:00:00	Unit Shut down	Unit Shut down	4.99
27-Nov-24 19:00:00	Unit Shut down	Unit Shut down	4.90
27-Nov-24 20:00:00	Unit Shut down	Unit Shut down	4.95
27-Nov-24 21:00:00	Unit Shut down	Unit Shut down	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
27-Nov-24 22:00:00	Unit Shut down	Unit Shut down	4.97
27-Nov-24 23:00:00	Unit Shut down	Unit Shut down	4.98
28-Nov-24 00:00:00	Unit Shut down	Unit Shut down	4.98
28-Nov-24 01:00:00	Unit Shut down	Unit Shut down	4.92
28-Nov-24 02:00:00	Unit Shut down	4.99	4.90
28-Nov-24 03:00:00	Unit Shut down	4.99	4.93
28-Nov-24 04:00:00	Unit Shut down	4.99	4.91
28-Nov-24 05:00:00	Unit Shut down	4.99	4.98
28-Nov-24 06:00:00	Unit Shut down	4.99	4.90
28-Nov-24 07:00:00	Unit Shut down	4.99	4.90
28-Nov-24 08:00:00	Unit Shut down	4.99	4.95
28-Nov-24 09:00:00	Unit Shut down	4.99	4.95
28-Nov-24 10:00:00	Unit Shut down	4.99	4.90
28-Nov-24 11:00:00	Unit Shut down	4.99	4.88
28-Nov-24 12:00:00	Unit Shut down	4.99	4.95
28-Nov-24 13:00:00	Unit Shut down	4.99	4.94
28-Nov-24 14:00:00	Unit Shut down	4.99	4.93
28-Nov-24 15:00:00	Unit Shut down	4.99	4.93
28-Nov-24 16:00:00	Unit Shut down	4.99	4.97
28-Nov-24 17:00:00	Unit Shut down	4.99	4.98
28-Nov-24 18:00:00	Unit Shut down	4.99	4.96
28-Nov-24 19:00:00	Unit Shut down	4.99	4.92
28-Nov-24 20:00:00	Unit Shut down	4.99	4.92
28-Nov-24 21:00:00	Unit Shut down	4.99	4.94
28-Nov-24 22:00:00	Unit Shut down	4.99	4.93
28-Nov-24 23:00:00	Unit Shut down	4.99	4.89
29-Nov-24 00:00:00	Unit Shut down	4.99	4.94
29-Nov-24 01:00:00	Unit Shut down	4.99	4.99
29-Nov-24 02:00:00	Unit Shut down	4.99	4.93
29-Nov-24 03:00:00	Unit Shut down	Unit Shut down	4.92
29-Nov-24 04:00:00	Unit Shut down	Unit Shut down	4.88
29-Nov-24 05:00:00	Unit Shut down	4.99	4.99
29-Nov-24 06:00:00	Unit Shut down	4.99	4.88



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
29-Nov-24 07:00:00	Unit Shut down	4.99	4.97
29-Nov-24 08:00:00	Unit Shut down	4.99	4.88
29-Nov-24 09:00:00	Unit Shut down	4.99	4.91
29-Nov-24 10:00:00	Unit Shut down	4.99	4.91
29-Nov-24 11:00:00	Unit Shut down	4.99	4.94
29-Nov-24 12:00:00	Unit Shut down	4.99	4.89
29-Nov-24 13:00:00	Unit Shut down	4.99	4.88
29-Nov-24 14:00:00	Unit Shut down	4.99	4.95
29-Nov-24 15:00:00	Unit Shut down	4.99	4.97
29-Nov-24 16:00:00	Unit Shut down	4.99	4.92
29-Nov-24 17:00:00	Unit Shut down	4.99	4.96
29-Nov-24 18:00:00	Unit Shut down	4.99	4.90
29-Nov-24 19:00:00	Unit Shut down	4.99	4.98
29-Nov-24 20:00:00	Unit Shut down	4.99	4.99
29-Nov-24 21:00:00	Unit Shut down	4.99	4.96
29-Nov-24 22:00:00	Unit Shut down	4.99	4.90
29-Nov-24 23:00:00	Unit Shut down	4.99	4.91
30-Nov-24 00:00:00	Unit Shut down	4.99	4.98
30-Nov-24 01:00:00	Unit Shut down	4.99	4.95
30-Nov-24 02:00:00	Unit Shut down	4.99	4.95
30-Nov-24 03:00:00	Unit Shut down	4.99	4.89
30-Nov-24 04:00:00	Unit Shut down	4.99	4.94
30-Nov-24 05:00:00	Unit Shut down	4.99	4.88
30-Nov-24 06:00:00	Unit Shut down	4.99	4.98
30-Nov-24 07:00:00	Unit Shut down	4.99	4.97
30-Nov-24 08:00:00	Unit Shut down	4.99	4.93
30-Nov-24 09:00:00	Unit Shut down	4.99	4.93
30-Nov-24 10:00:00	Unit Shut down	4.99	4.90
30-Nov-24 11:00:00	Unit Shut down	4.99	4.90
30-Nov-24 12:00:00	Unit Shut down	4.99	4.89
30-Nov-24 13:00:00	Unit Shut down	4.99	4.96
30-Nov-24 14:00:00	Unit Shut down	4.99	4.91
30-Nov-24 15:00:00	Unit Shut down	4.99	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
30-Nov-24 16:00:00	Unit Shut down	4.99	4.94
30-Nov-24 17:00:00	Unit Shut down	4.99	4.95
30-Nov-24 18:00:00	Unit Shut down	4.99	4.96
30-Nov-24 19:00:00	Unit Shut down	4.99	4.87
30-Nov-24 20:00:00	Unit Shut down	4.99	4.98
30-Nov-24 21:00:00	Unit Shut down	4.99	4.98
30-Nov-24 22:00:00	Unit Shut down	4.99	4.96
30-Nov-24 23:00:00	Unit Shut down	4.99	4.96
01-Dec-24 00:00:00	Unit Shut down	4.99	4.90
01-Dec-24 01:00:00	Unit Shut down	4.99	4.75
01-Dec-24 02:00:00	Unit Shut down	4.99	4.89
01-Dec-24 03:00:00	Unit Shut down	4.99	4.92
01-Dec-24 04:00:00	Unit Shut down	4.99	4.99
01-Dec-24 05:00:00	Unit Shut down	4.99	4.97
01-Dec-24 06:00:00	Unit Shut down	4.99	4.94
01-Dec-24 07:00:00	Unit Shut down	4.99	4.97
01-Dec-24 08:00:00	Unit Shut down	4.99	4.94
01-Dec-24 09:00:00	Unit Shut down	4.99	4.99
01-Dec-24 10:00:00	Unit Shut down	4.99	4.97
01-Dec-24 11:00:00	Unit Shut down	4.99	4.99
01-Dec-24 12:00:00	Unit Shut down	4.99	4.92
01-Dec-24 13:00:00	Unit Shut down	4.99	4.94
01-Dec-24 14:00:00	Unit Shut down	4.99	4.96
01-Dec-24 15:00:00	Unit Shut down	4.99	4.97
01-Dec-24 16:00:00	Unit Shut down	4.99	4.98
01-Dec-24 17:00:00	Unit Shut down	4.99	4.99
01-Dec-24 18:00:00	Unit Shut down	4.99	4.92
01-Dec-24 19:00:00	Unit Shut down	4.99	4.98
01-Dec-24 20:00:00	Unit Shut down	4.99	4.89
01-Dec-24 21:00:00	Unit Shut down	4.99	4.87
01-Dec-24 22:00:00	Unit Shut down	4.99	4.95
01-Dec-24 23:00:00	Unit Shut down	4.99	4.99
02-Dec-24 00:00:00	Unit Shut down	4.99	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
02-Dec-24 01:00:00	Unit Shut down	4.99	4.91
02-Dec-24 02:00:00	Unit Shut down	4.99	4.91
02-Dec-24 03:00:00	Unit Shut down	4.99	4.99
02-Dec-24 04:00:00	Unit Shut down	4.99	4.77
02-Dec-24 05:00:00	Unit Shut down	4.99	4.71
02-Dec-24 06:00:00	Unit Shut down	4.99	4.71
02-Dec-24 07:00:00	Unit Shut down	4.99	4.69
02-Dec-24 08:00:00	Unit Shut down	4.99	4.50
02-Dec-24 09:00:00	Unit Shut down	4.99	4.52
02-Dec-24 10:00:00	Unit Shut down	4.99	4.69
02-Dec-24 11:00:00	Unit Shut down	4.99	4.81
02-Dec-24 12:00:00	Unit Shut down	4.99	4.90
02-Dec-24 13:00:00	Unit Shut down	4.99	4.76
02-Dec-24 14:00:00	Unit Shut down	4.99	4.72
02-Dec-24 15:00:00	Unit Shut down	4.99	4.77
02-Dec-24 16:00:00	Unit Shut down	4.99	4.85
02-Dec-24 17:00:00	Unit Shut down	4.99	4.93
02-Dec-24 18:00:00	Unit Shut down	4.99	4.94
02-Dec-24 19:00:00	Unit Shut down	4.99	4.95
02-Dec-24 20:00:00	Unit Shut down	4.99	4.97
02-Dec-24 21:00:00	Unit Shut down	4.99	4.94
02-Dec-24 22:00:00	Unit Shut down	4.99	4.97
02-Dec-24 23:00:00	Unit Shut down	4.99	4.93
03-Dec-24 00:00:00	Unit Shut down	4.99	4.89
03-Dec-24 01:00:00	Unit Shut down	4.99	4.87
03-Dec-24 02:00:00	Unit Shut down	4.99	4.92
03-Dec-24 03:00:00	Unit Shut down	4.99	4.94
03-Dec-24 04:00:00	Unit Shut down	4.99	4.97
03-Dec-24 05:00:00	Unit Shut down	4.99	4.98
03-Dec-24 06:00:00	Unit Shut down	4.99	4.92
03-Dec-24 07:00:00	Unit Shut down	4.99	4.94
03-Dec-24 08:00:00	Unit Shut down	4.99	4.94
03-Dec-24 09:00:00	Unit Shut down	4.99	4.93

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
03-Dec-24 10:00:00	Unit Shut down	4.99	4.92
03-Dec-24 11:00:00	Unit Shut down	4.99	4.92
03-Dec-24 12:00:00	Unit Shut down	4.99	4.98
03-Dec-24 13:00:00	Unit Shut down	4.99	4.91
03-Dec-24 14:00:00	Unit Shut down	4.99	4.94
03-Dec-24 15:00:00	Unit Shut down	4.99	4.97
03-Dec-24 16:00:00	Unit Shut down	4.99	4.98
03-Dec-24 17:00:00	Unit Shut down	4.99	4.94
03-Dec-24 18:00:00	Unit Shut down	4.99	4.98
03-Dec-24 19:00:00	Unit Shut down	4.99	4.91
03-Dec-24 20:00:00	Unit Shut down	4.99	4.98
03-Dec-24 21:00:00	Unit Shut down	4.99	4.97
03-Dec-24 22:00:00	Unit Shut down	4.99	4.96
03-Dec-24 23:00:00	Unit Shut down	4.99	4.96
04-Dec-24 00:00:00	Unit Shut down	4.99	4.89
04-Dec-24 01:00:00	Unit Shut down	4.99	4.99
04-Dec-24 02:00:00	Unit Shut down	4.99	4.89
04-Dec-24 03:00:00	Unit Shut down	4.99	4.87
04-Dec-24 04:00:00	Unit Shut down	4.99	4.96
04-Dec-24 05:00:00	Unit Shut down	4.99	4.91
04-Dec-24 06:00:00	Unit Shut down	4.99	4.93
04-Dec-24 07:00:00	Unit Shut down	4.99	4.91
04-Dec-24 08:00:00	Unit Shut down	4.99	4.96
04-Dec-24 09:00:00	Unit Shut down	4.99	4.89
04-Dec-24 10:00:00	Unit Shut down	4.99	4.94
04-Dec-24 11:00:00	Unit Shut down	4.99	4.97
04-Dec-24 12:00:00	Unit Shut down	4.99	4.92
04-Dec-24 13:00:00	Unit Shut down	4.99	4.94
04-Dec-24 14:00:00	Unit Shut down	4.99	4.95
04-Dec-24 15:00:00	Unit Shut down	4.99	4.95
04-Dec-24 16:00:00	Unit Shut down	4.99	4.89
04-Dec-24 17:00:00	Unit Shut down	4.99	4.98
04-Dec-24 18:00:00	Unit Shut down	4.99	4.96



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
04-Dec-24 19:00:00	Unit Shut down	4.99	4.92
04-Dec-24 20:00:00	Unit Shut down	4.99	4.92
04-Dec-24 21:00:00	Unit Shut down	4.99	4.88
04-Dec-24 22:00:00	Unit Shut down	4.99	4.92
04-Dec-24 23:00:00	Unit Shut down	4.99	4.93
05-Dec-24 00:00:00	Unit Shut down	4.99	4.92
05-Dec-24 01:00:00	Unit Shut down	4.99	4.99
05-Dec-24 02:00:00	Unit Shut down	4.99	4.88
05-Dec-24 03:00:00	Unit Shut down	4.99	4.90
05-Dec-24 04:00:00	Unit Shut down	4.99	4.94
05-Dec-24 05:00:00	Unit Shut down	4.99	4.99
05-Dec-24 06:00:00	Unit Shut down	4.99	4.87
05-Dec-24 07:00:00	Unit Shut down	4.99	4.99
05-Dec-24 08:00:00	Unit Shut down	4.99	4.88
05-Dec-24 09:00:00	Unit Shut down	4.99	4.87
05-Dec-24 10:00:00	Unit Shut down	4.99	4.90
05-Dec-24 11:00:00	Unit Shut down	4.99	4.97
05-Dec-24 12:00:00	Unit Shut down	4.99	4.92
05-Dec-24 13:00:00	Unit Shut down	4.99	4.92
05-Dec-24 14:00:00	Unit Shut down	4.99	4.94
05-Dec-24 15:00:00	Unit Shut down	4.99	4.98
05-Dec-24 16:00:00	Unit Shut down	4.99	4.89
05-Dec-24 17:00:00	Unit Shut down	4.99	4.89
05-Dec-24 18:00:00	Unit Shut down	4.99	4.96
05-Dec-24 19:00:00	Unit Shut down	4.99	4.94
05-Dec-24 20:00:00	Unit Shut down	4.99	4.89
05-Dec-24 21:00:00	Unit Shut down	4.99	4.96
05-Dec-24 22:00:00	Unit Shut down	4.99	4.92
05-Dec-24 23:00:00	Unit Shut down	4.99	4.92
06-Dec-24 00:00:00	Unit Shut down	4.99	4.91
06-Dec-24 01:00:00	Unit Shut down	4.99	4.96
06-Dec-24 02:00:00	Unit Shut down	4.99	4.99
06-Dec-24 03:00:00	Unit Shut down	4.99	4.88

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
06-Dec-24 04:00:00	Unit Shut down	4.99	4.99
06-Dec-24 05:00:00	Unit Shut down	4.99	4.94
06-Dec-24 06:00:00	Unit Shut down	4.99	4.93
06-Dec-24 07:00:00	Unit Shut down	4.99	4.89
06-Dec-24 08:00:00	Unit Shut down	4.99	4.97
06-Dec-24 09:00:00	Unit Shut down	4.99	4.90
06-Dec-24 10:00:00	Unit Shut down	4.99	4.96
06-Dec-24 11:00:00	Unit Shut down	4.99	4.92
06-Dec-24 12:00:00	Unit Shut down	4.99	4.87
06-Dec-24 13:00:00	Unit Shut down	4.99	4.93
06-Dec-24 14:00:00	Unit Shut down	4.99	4.87
06-Dec-24 15:00:00	Unit Shut down	4.99	4.93
06-Dec-24 16:00:00	Unit Shut down	4.99	4.92
06-Dec-24 17:00:00	Unit Shut down	4.99	4.94
06-Dec-24 18:00:00	Unit Shut down	4.99	4.91
06-Dec-24 19:00:00	Unit Shut down	4.99	4.93
06-Dec-24 20:00:00	Unit Shut down	4.99	4.93
06-Dec-24 21:00:00	Unit Shut down	4.99	4.95
06-Dec-24 22:00:00	Unit Shut down	4.99	4.92
06-Dec-24 23:00:00	Unit Shut down	4.99	4.89
07-Dec-24 00:00:00	Unit Shut down	4.99	4.90
07-Dec-24 01:00:00	Unit Shut down	4.99	4.89
07-Dec-24 02:00:00	Unit Shut down	4.99	4.91
07-Dec-24 03:00:00	Unit Shut down	4.99	4.98
07-Dec-24 04:00:00	Unit Shut down	4.99	4.96
07-Dec-24 05:00:00	Unit Shut down	4.99	4.97
07-Dec-24 06:00:00	Unit Shut down	4.99	4.97
07-Dec-24 07:00:00	Unit Shut down	4.99	4.98
07-Dec-24 08:00:00	Unit Shut down	4.99	4.97
07-Dec-24 09:00:00	Unit Shut down	4.99	4.97
07-Dec-24 10:00:00	Unit Shut down	4.99	4.99
07-Dec-24 11:00:00	Unit Shut down	4.99	4.91
07-Dec-24 12:00:00	Unit Shut down	4.99	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
07-Dec-24 13:00:00	Unit Shut down	4.99	4.93
07-Dec-24 14:00:00	Unit Shut down	4.99	4.97
07-Dec-24 15:00:00	Unit Shut down	4.99	4.97
07-Dec-24 16:00:00	Unit Shut down	4.99	4.90
07-Dec-24 17:00:00	Unit Shut down	4.99	4.95
07-Dec-24 18:00:00	Unit Shut down	4.99	4.97
07-Dec-24 19:00:00	Unit Shut down	4.99	4.89
07-Dec-24 20:00:00	Unit Shut down	4.99	4.95
07-Dec-24 21:00:00	Unit Shut down	4.99	4.91
07-Dec-24 22:00:00	Unit Shut down	4.99	4.78
07-Dec-24 23:00:00	Unit Shut down	4.99	4.73
08-Dec-24 00:00:00	Unit Shut down	4.99	4.77
08-Dec-24 01:00:00	Unit Shut down	4.99	4.78
08-Dec-24 02:00:00	Unit Shut down	4.99	4.83
08-Dec-24 03:00:00	Unit Shut down	4.99	4.94
08-Dec-24 04:00:00	Unit Shut down	4.99	4.95
08-Dec-24 05:00:00	Unit Shut down	4.99	4.98
08-Dec-24 06:00:00	Unit Shut down	4.99	4.96
08-Dec-24 07:00:00	Unit Shut down	4.99	4.99
08-Dec-24 08:00:00	Unit Shut down	4.99	5.00
08-Dec-24 09:00:00	Unit Shut down	4.99	4.99
08-Dec-24 10:00:00	Unit Shut down	4.99	4.99
08-Dec-24 11:00:00	Unit Shut down	4.99	4.93
08-Dec-24 12:00:00	Unit Shut down	4.99	4.87
08-Dec-24 13:00:00	Unit Shut down	4.99	4.83
08-Dec-24 14:00:00	Unit Shut down	4.99	4.82
08-Dec-24 15:00:00	Unit Shut down	4.99	4.19
08-Dec-24 16:00:00	Unit Shut down	4.99	4.19
08-Dec-24 17:00:00	Unit Shut down	4.99	4.21
08-Dec-24 18:00:00	Unit Shut down	4.99	4.27
08-Dec-24 19:00:00	Unit Shut down	4.99	4.27
08-Dec-24 20:00:00	Unit Shut down	4.99	4.97
08-Dec-24 21:00:00	Unit Shut down	4.99	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
08-Dec-24 22:00:00	Unit Shut down	4.99	4.96
08-Dec-24 23:00:00	Unit Shut down	4.99	4.92
09-Dec-24 00:00:00	Unit Shut down	4.99	5.00
09-Dec-24 01:00:00	Unit Shut down	4.99	4.99
09-Dec-24 02:00:00	Unit Shut down	4.99	4.87
09-Dec-24 03:00:00	Unit Shut down	4.99	4.92
09-Dec-24 04:00:00	Unit Shut down	4.99	4.88
09-Dec-24 05:00:00	Unit Shut down	4.99	4.97
09-Dec-24 06:00:00	Unit Shut down	4.99	4.94
09-Dec-24 07:00:00	Unit Shut down	4.99	4.97
09-Dec-24 08:00:00	Unit Shut down	4.99	4.90
09-Dec-24 09:00:00	Unit Shut down	4.99	4.99
09-Dec-24 10:00:00	Unit Shut down	4.99	4.98
09-Dec-24 11:00:00	Unit Shut down	4.99	4.97
09-Dec-24 12:00:00	Unit Shut down	4.99	4.91
09-Dec-24 13:00:00	Unit Shut down	4.99	4.90
09-Dec-24 14:00:00	Unit Shut down	4.99	4.95
09-Dec-24 15:00:00	Unit Shut down	4.99	4.95
09-Dec-24 16:00:00	Unit Shut down	4.99	4.89
09-Dec-24 17:00:00	Unit Shut down	4.99	4.91
09-Dec-24 18:00:00	Unit Shut down	4.99	4.96
09-Dec-24 19:00:00	Unit Shut down	4.99	4.93
09-Dec-24 20:00:00	Unit Shut down	4.99	4.97
09-Dec-24 21:00:00	Unit Shut down	4.99	4.87
09-Dec-24 22:00:00	Unit Shut down	4.99	4.98
09-Dec-24 23:00:00	Unit Shut down	4.99	4.98
10-Dec-24 00:00:00	Unit Shut down	4.10	4.91
10-Dec-24 01:00:00	Unit Shut down	4.10	4.93
10-Dec-24 02:00:00	Unit Shut down	4.11	4.94
10-Dec-24 03:00:00	Unit Shut down	4.13	4.98
10-Dec-24 04:00:00	Unit Shut down	4.09	4.96
10-Dec-24 05:00:00	Unit Shut down	4.09	4.96
10-Dec-24 06:00:00	Unit Shut down	4.09	4.99



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
10-Dec-24 07:00:00	Unit Shut down	4.99	4.96
10-Dec-24 08:00:00	Unit Shut down	4.99	4.89
10-Dec-24 09:00:00	Unit Shut down	4.99	4.91
10-Dec-24 10:00:00	Unit Shut down	4.99	4.92
10-Dec-24 11:00:00	Unit Shut down	4.99	4.93
10-Dec-24 12:00:00	Unit Shut down	4.99	4.94
10-Dec-24 13:00:00	Unit Shut down	4.99	4.96
10-Dec-24 14:00:00	Unit Shut down	4.99	4.92
10-Dec-24 15:00:00	Unit Shut down	4.99	4.99
10-Dec-24 16:00:00	Unit Shut down	4.99	4.88
10-Dec-24 17:00:00	Unit Shut down	4.99	4.98
10-Dec-24 18:00:00	Unit Shut down	4.99	4.87
10-Dec-24 19:00:00	Unit Shut down	4.99	4.92
10-Dec-24 20:00:00	Unit Shut down	4.99	4.95
10-Dec-24 21:00:00	Unit Shut down	4.99	4.91
10-Dec-24 22:00:00	Unit Shut down	4.99	4.91
10-Dec-24 23:00:00	Unit Shut down	4.99	4.98
11-Dec-24 00:00:00	Unit Shut down	4.99	4.89
11-Dec-24 01:00:00	Unit Shut down	4.99	4.95
11-Dec-24 02:00:00	Unit Shut down	4.99	4.92
11-Dec-24 03:00:00	Unit Shut down	4.99	4.92
11-Dec-24 04:00:00	Unit Shut down	4.99	4.97
11-Dec-24 05:00:00	Unit Shut down	4.99	4.88
11-Dec-24 06:00:00	Unit Shut down	4.99	4.93
11-Dec-24 07:00:00	Unit Shut down	4.99	4.97
11-Dec-24 08:00:00	Unit Shut down	4.99	4.88
11-Dec-24 09:00:00	Unit Shut down	4.99	4.97
11-Dec-24 10:00:00	Unit Shut down	4.99	4.91
11-Dec-24 11:00:00	Unit Shut down	4.99	4.91
11-Dec-24 12:00:00	Unit Shut down	4.99	4.91
11-Dec-24 13:00:00	Unit Shut down	4.99	4.97
11-Dec-24 14:00:00	Unit Shut down	4.99	4.90
11-Dec-24 15:00:00	Unit Shut down	4.99	4.95

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
11-Dec-24 16:00:00	Unit Shut down	4.99	4.97
11-Dec-24 17:00:00	Unit Shut down	4.99	4.97
11-Dec-24 18:00:00	Unit Shut down	4.99	4.98
11-Dec-24 19:00:00	Unit Shut down	4.99	4.87
11-Dec-24 20:00:00	Unit Shut down	4.99	4.87
11-Dec-24 21:00:00	Unit Shut down	4.99	4.91
11-Dec-24 22:00:00	Unit Shut down	4.99	4.89
11-Dec-24 23:00:00	Unit Shut down	4.99	4.75
12-Dec-24 00:00:00	Unit Shut down	4.99	4.80
12-Dec-24 01:00:00	Unit Shut down	4.99	4.97
12-Dec-24 02:00:00	Unit Shut down	4.99	5.00
12-Dec-24 03:00:00	Unit Shut down	4.99	4.99
12-Dec-24 04:00:00	Unit Shut down	4.99	4.99
12-Dec-24 05:00:00	Unit Shut down	4.99	4.95
12-Dec-24 06:00:00	Unit Shut down	4.99	4.88
12-Dec-24 07:00:00	Unit Shut down	4.99	4.87
12-Dec-24 08:00:00	Unit Shut down	4.99	4.98
12-Dec-24 09:00:00	Unit Shut down	4.99	4.97
12-Dec-24 10:00:00	Unit Shut down	4.04	4.88
12-Dec-24 11:00:00	Unit Shut down	4.04	4.93
12-Dec-24 12:00:00	Unit Shut down	4.04	4.94
12-Dec-24 13:00:00	Unit Shut down	1.83	4.92
12-Dec-24 14:00:00	Unit Shut down	Unit Shut down	4.95
12-Dec-24 15:00:00	Unit Shut down	4.99	4.92
12-Dec-24 16:00:00	Unit Shut down	4.99	4.91
12-Dec-24 17:00:00	Unit Shut down	4.99	4.98
12-Dec-24 18:00:00	Unit Shut down	4.99	4.99
12-Dec-24 19:00:00	Unit Shut down	4.99	4.96
12-Dec-24 20:00:00	Unit Shut down	4.99	4.88
12-Dec-24 21:00:00	Unit Shut down	4.99	4.88
12-Dec-24 22:00:00	Unit Shut down	4.99	4.98
12-Dec-24 23:00:00	Unit Shut down	4.99	4.94
13-Dec-24 00:00:00	Unit Shut down	4.99	4.87

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
13-Dec-24 01:00:00	Unit Shut down	4.99	4.94
13-Dec-24 02:00:00	Unit Shut down	4.24	4.97
13-Dec-24 03:00:00	Unit Shut down	4.23	4.78
13-Dec-24 04:00:00	Unit Shut down	4.32	4.90
13-Dec-24 05:00:00	Unit Shut down	4.99	4.99
13-Dec-24 06:00:00	Unit Shut down	4.99	4.91
13-Dec-24 07:00:00	Unit Shut down	4.13	4.89
13-Dec-24 08:00:00	Unit Shut down	4.26	4.95
13-Dec-24 09:00:00	Unit Shut down	4.23	4.93
13-Dec-24 10:00:00	Unit Shut down	4.24	4.94
13-Dec-24 11:00:00	Unit Shut down	4.24	4.96
13-Dec-24 12:00:00	Unit Shut down	4.24	4.98
13-Dec-24 13:00:00	Unit Shut down	4.24	4.88
13-Dec-24 14:00:00	Unit Shut down	4.36	4.91
13-Dec-24 15:00:00	Unit Shut down	4.49	4.98
13-Dec-24 16:00:00	Unit Shut down	4.54	4.94
13-Dec-24 17:00:00	Unit Shut down	4.48	4.91
13-Dec-24 18:00:00	Unit Shut down	4.60	4.95
13-Dec-24 19:00:00	Unit Shut down	4.65	4.87
13-Dec-24 20:00:00	Unit Shut down	4.62	4.95
13-Dec-24 21:00:00	Unit Shut down	4.69	4.90
13-Dec-24 22:00:00	Unit Shut down	4.62	4.73
13-Dec-24 23:00:00	Unit Shut down	4.59	4.71
14-Dec-24 00:00:00	Unit Shut down	4.50	4.68
14-Dec-24 01:00:00	Unit Shut down	4.48	4.79
14-Dec-24 02:00:00	Unit Shut down	4.10	4.77
14-Dec-24 03:00:00	Unit Shut down	4.99	4.78
14-Dec-24 04:00:00	Unit Shut down	4.99	4.91
14-Dec-24 05:00:00	Unit Shut down	4.99	4.92
14-Dec-24 06:00:00	Unit Shut down	4.99	4.95
14-Dec-24 07:00:00	Unit Shut down	4.99	4.95
14-Dec-24 08:00:00	Unit Shut down	4.99	4.89
14-Dec-24 09:00:00	Unit Shut down	4.99	4.92

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
14-Dec-24 10:00:00	Unit Shut down	4.99	4.90
14-Dec-24 11:00:00	Unit Shut down	4.99	4.84
14-Dec-24 12:00:00	Unit Shut down	4.99	4.53
14-Dec-24 13:00:00	Unit Shut down	4.99	4.49
14-Dec-24 14:00:00	Unit Shut down	4.99	4.50
14-Dec-24 15:00:00	Unit Shut down	4.99	4.99
14-Dec-24 16:00:00	Unit Shut down	4.99	4.45
14-Dec-24 17:00:00	Unit Shut down	4.99	4.59
14-Dec-24 18:00:00	Unit Shut down	4.99	4.88
14-Dec-24 19:00:00	Unit Shut down	4.99	4.96
14-Dec-24 20:00:00	Unit Shut down	4.99	4.99
14-Dec-24 21:00:00	Unit Shut down	4.99	4.96
14-Dec-24 22:00:00	Unit Shut down	4.99	4.99
14-Dec-24 23:00:00	Unit Shut down	4.99	4.99
15-Dec-24 00:00:00	Unit Shut down	4.99	4.99
15-Dec-24 01:00:00	Unit Shut down	4.99	4.99
15-Dec-24 02:00:00	Unit Shut down	4.99	4.99
15-Dec-24 03:00:00	Unit Shut down	4.99	4.99
15-Dec-24 04:00:00	Unit Shut down	4.99	4.99
15-Dec-24 05:00:00	Unit Shut down	4.99	4.99
15-Dec-24 06:00:00	Unit Shut down	4.99	4.99
15-Dec-24 07:00:00	Unit Shut down	4.99	4.99
15-Dec-24 08:00:00	Unit Shut down	4.99	4.99
15-Dec-24 09:00:00	Unit Shut down	4.99	4.99
15-Dec-24 10:00:00	Unit Shut down	4.99	4.99
15-Dec-24 11:00:00	Unit Shut down	4.99	4.99
15-Dec-24 12:00:00	Unit Shut down	4.99	4.99
15-Dec-24 13:00:00	Unit Shut down	4.99	4.99
15-Dec-24 14:00:00	Unit Shut down	4.99	4.99
15-Dec-24 15:00:00	Unit Shut down	4.99	4.99
15-Dec-24 16:00:00	Unit Shut down	4.99	4.99
15-Dec-24 17:00:00	Unit Shut down	4.99	4.99
15-Dec-24 18:00:00	Unit Shut down	4.99	4.99



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
15-Dec-24 19:00:00	Unit Shut down	4.99	4.99
15-Dec-24 20:00:00	Unit Shut down	4.99	4.99
15-Dec-24 21:00:00	Unit Shut down	4.99	4.99
15-Dec-24 22:00:00	Unit Shut down	4.99	4.66
15-Dec-24 23:00:00	Unit Shut down	4.99	4.59
16-Dec-24 00:00:00	Unit Shut down	4.99	4.63
16-Dec-24 01:00:00	Unit Shut down	4.99	4.77
16-Dec-24 02:00:00	Unit Shut down	4.99	4.72
16-Dec-24 03:00:00	Unit Shut down	4.99	4.74
16-Dec-24 04:00:00	Unit Shut down	4.99	4.89
16-Dec-24 05:00:00	Unit Shut down	4.99	4.86
16-Dec-24 06:00:00	Unit Shut down	4.99	4.83
16-Dec-24 07:00:00	Unit Shut down	4.99	4.86
16-Dec-24 08:00:00	Unit Shut down	4.99	4.99
16-Dec-24 09:00:00	Unit Shut down	4.99	4.99
16-Dec-24 10:00:00	Unit Shut down	4.99	4.99
16-Dec-24 11:00:00	Unit Shut down	4.99	4.99
16-Dec-24 12:00:00	Unit Shut down	4.99	4.99
16-Dec-24 13:00:00	Unit Shut down	4.99	4.99
16-Dec-24 14:00:00	Unit Shut down	4.99	4.99
16-Dec-24 15:00:00	Unit Shut down	4.99	4.99
16-Dec-24 16:00:00	Unit Shut down	4.99	4.99
16-Dec-24 17:00:00	Unit Shut down	4.99	4.99
16-Dec-24 18:00:00	Unit Shut down	4.99	4.99
16-Dec-24 19:00:00	Unit Shut down	4.99	4.99
16-Dec-24 20:00:00	Unit Shut down	4.99	4.99
16-Dec-24 21:00:00	Unit Shut down	4.99	4.99
16-Dec-24 22:00:00	Unit Shut down	4.99	4.99
16-Dec-24 23:00:00	Unit Shut down	4.99	4.99
17-Dec-24 00:00:00	Unit Shut down	4.99	4.60
17-Dec-24 01:00:00	Unit Shut down	4.99	4.56
17-Dec-24 02:00:00	Unit Shut down	4.99	4.40
17-Dec-24 03:00:00	Unit Shut down	4.99	4.42

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
17-Dec-24 04:00:00	Unit Shut down	4.99	4.67
17-Dec-24 05:00:00	Unit Shut down	4.99	4.77
17-Dec-24 06:00:00	Unit Shut down	4.99	4.76
17-Dec-24 07:00:00	Unit Shut down	4.99	4.81
17-Dec-24 08:00:00	Unit Shut down	4.99	4.85
17-Dec-24 09:00:00	Unit Shut down	4.99	4.92
17-Dec-24 10:00:00	Unit Shut down	4.99	4.88
17-Dec-24 11:00:00	Unit Shut down	4.99	4.94
17-Dec-24 12:00:00	Unit Shut down	4.99	4.97
17-Dec-24 13:00:00	Unit Shut down	4.99	4.98
17-Dec-24 14:00:00	Unit Shut down	4.99	4.99
17-Dec-24 15:00:00	Unit Shut down	4.99	4.99
17-Dec-24 16:00:00	Unit Shut down	4.99	4.99
17-Dec-24 17:00:00	Unit Shut down	4.99	4.99
17-Dec-24 18:00:00	Unit Shut down	4.99	4.99
17-Dec-24 19:00:00	Unit Shut down	4.99	4.99
17-Dec-24 20:00:00	Unit Shut down	4.99	4.99
17-Dec-24 21:00:00	Unit Shut down	4.99	4.99
17-Dec-24 22:00:00	Unit Shut down	4.99	4.94
17-Dec-24 23:00:00	Unit Shut down	4.99	4.99
18-Dec-24 00:00:00	Unit Shut down	4.99	4.99
18-Dec-24 01:00:00	Unit Shut down	4.99	4.89
18-Dec-24 02:00:00	Unit Shut down	4.99	4.91
18-Dec-24 03:00:00	Unit Shut down	4.99	4.93
18-Dec-24 04:00:00	Unit Shut down	4.99	4.98
18-Dec-24 05:00:00	Unit Shut down	4.99	4.89
18-Dec-24 06:00:00	Unit Shut down	4.99	4.97
18-Dec-24 07:00:00	Unit Shut down	4.99	4.96
18-Dec-24 08:00:00	Unit Shut down	4.99	4.95
18-Dec-24 09:00:00	Unit Shut down	4.99	4.87
18-Dec-24 10:00:00	Unit Shut down	4.99	4.89
18-Dec-24 11:00:00	Unit Shut down	4.99	4.87
18-Dec-24 12:00:00	Unit Shut down	4.99	4.94

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
18-Dec-24 13:00:00	Unit Shut down	4.99	4.87
18-Dec-24 14:00:00	Unit Shut down	4.99	4.86
18-Dec-24 15:00:00	Unit Shut down	4.99	4.92
18-Dec-24 16:00:00	Unit Shut down	4.99	4.96
18-Dec-24 17:00:00	Unit Shut down	4.99	4.95
18-Dec-24 18:00:00	Unit Shut down	4.99	4.93
18-Dec-24 19:00:00	Unit Shut down	4.99	4.90
18-Dec-24 20:00:00	Unit Shut down	4.99	4.92
18-Dec-24 21:00:00	Unit Shut down	4.99	4.88
18-Dec-24 22:00:00	Unit Shut down	4.99	4.88
18-Dec-24 23:00:00	Unit Shut down	4.99	4.92
19-Dec-24 00:00:00	Unit Shut down	4.99	4.90
19-Dec-24 01:00:00	Unit Shut down	4.99	4.89
19-Dec-24 02:00:00	Unit Shut down	4.99	4.90
19-Dec-24 03:00:00	Unit Shut down	4.99	4.94
19-Dec-24 04:00:00	Unit Shut down	4.99	4.87
19-Dec-24 05:00:00	Unit Shut down	4.99	4.94
19-Dec-24 06:00:00	Unit Shut down	4.99	4.95
19-Dec-24 07:00:00	Unit Shut down	4.99	4.97
19-Dec-24 08:00:00	Unit Shut down	4.99	4.98
19-Dec-24 09:00:00	Unit Shut down	4.99	4.87
19-Dec-24 10:00:00	Unit Shut down	4.99	4.96
19-Dec-24 11:00:00	Unit Shut down	4.99	4.87
19-Dec-24 12:00:00	Unit Shut down	4.99	4.87
19-Dec-24 13:00:00	Unit Shut down	4.99	4.96
19-Dec-24 14:00:00	Unit Shut down	4.99	4.96
19-Dec-24 15:00:00	Unit Shut down	4.99	4.94
19-Dec-24 16:00:00	Unit Shut down	4.99	Unit Shut down
19-Dec-24 17:00:00	Unit Shut down	4.99	4.96
19-Dec-24 18:00:00	Unit Shut down	4.99	4.99
19-Dec-24 19:00:00	Unit Shut down	4.99	4.89
19-Dec-24 20:00:00	Unit Shut down	4.99	4.98
19-Dec-24 21:00:00	Unit Shut down	4.99	4.91

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
19-Dec-24 22:00:00	Unit Shut down	4.99	4.97
19-Dec-24 23:00:00	Unit Shut down	4.99	4.96
20-Dec-24 00:00:00	Unit Shut down	4.99	4.99
20-Dec-24 01:00:00	Unit Shut down	4.99	4.95
20-Dec-24 02:00:00	Unit Shut down	4.99	4.88
20-Dec-24 03:00:00	Unit Shut down	4.99	4.89
20-Dec-24 04:00:00	Unit Shut down	4.99	4.91
20-Dec-24 05:00:00	Unit Shut down	4.99	4.95
20-Dec-24 06:00:00	Unit Shut down	4.99	4.90
20-Dec-24 07:00:00	Unit Shut down	4.99	4.94
20-Dec-24 08:00:00	Unit Shut down	4.99	4.90
20-Dec-24 09:00:00	Unit Shut down	4.99	4.95
20-Dec-24 10:00:00	Unit Shut down	4.99	4.90
20-Dec-24 11:00:00	Unit Shut down	4.99	4.90
20-Dec-24 12:00:00	Unit Shut down	4.99	4.92
20-Dec-24 13:00:00	Unit Shut down	4.99	4.91
20-Dec-24 14:00:00	Unit Shut down	4.99	4.96
20-Dec-24 15:00:00	Unit Shut down	4.99	4.91
20-Dec-24 16:00:00	Unit Shut down	4.99	4.99
20-Dec-24 17:00:00	Unit Shut down	4.99	4.99
20-Dec-24 18:00:00	Unit Shut down	4.99	4.99
20-Dec-24 19:00:00	Unit Shut down	4.99	4.99
20-Dec-24 20:00:00	Unit Shut down	4.99	4.99
20-Dec-24 21:00:00	Unit Shut down	4.99	4.97
20-Dec-24 22:00:00	Unit Shut down	4.99	4.93
20-Dec-24 23:00:00	Unit Shut down	4.99	4.99
21-Dec-24 00:00:00	Unit Shut down	4.99	4.94
21-Dec-24 01:00:00	Unit Shut down	4.99	4.89
21-Dec-24 02:00:00	Unit Shut down	4.99	4.94
21-Dec-24 03:00:00	Unit Shut down	4.99	4.92
21-Dec-24 04:00:00	Unit Shut down	4.99	4.88
21-Dec-24 05:00:00	Unit Shut down	4.99	4.87
21-Dec-24 06:00:00	Unit Shut down	4.99	4.90



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
21-Dec-24 07:00:00	Unit Shut down	4.99	4.99
21-Dec-24 08:00:00	Unit Shut down	4.99	4.95
21-Dec-24 09:00:00	Unit Shut down	4.99	4.92
21-Dec-24 10:00:00	Unit Shut down	4.99	4.96
21-Dec-24 11:00:00	Unit Shut down	4.99	4.92
21-Dec-24 12:00:00	Unit Shut down	4.99	4.95
21-Dec-24 13:00:00	Unit Shut down	4.99	4.97
21-Dec-24 14:00:00	Unit Shut down	4.99	4.92
21-Dec-24 15:00:00	Unit Shut down	4.99	4.92
21-Dec-24 16:00:00	Unit Shut down	4.99	4.89
21-Dec-24 17:00:00	Unit Shut down	4.99	4.89
21-Dec-24 18:00:00	Unit Shut down	4.99	4.99
21-Dec-24 19:00:00	Unit Shut down	4.99	4.97
21-Dec-24 20:00:00	Unit Shut down	4.99	4.99
21-Dec-24 21:00:00	Unit Shut down	4.99	4.97
21-Dec-24 22:00:00	Unit Shut down	4.99	4.89
21-Dec-24 23:00:00	Unit Shut down	4.99	4.90
22-Dec-24 00:00:00	Unit Shut down	4.99	4.86
22-Dec-24 01:00:00	Unit Shut down	4.99	4.98
22-Dec-24 02:00:00	Unit Shut down	4.99	4.93
22-Dec-24 03:00:00	Unit Shut down	4.99	4.88
22-Dec-24 04:00:00	Unit Shut down	4.99	4.95
22-Dec-24 05:00:00	Unit Shut down	4.99	4.94
22-Dec-24 06:00:00	Unit Shut down	4.99	4.89
22-Dec-24 07:00:00	Unit Shut down	4.99	4.91
22-Dec-24 08:00:00	Unit Shut down	4.99	4.93
22-Dec-24 09:00:00	Unit Shut down	4.99	4.89
22-Dec-24 10:00:00	Unit Shut down	4.99	4.91
22-Dec-24 11:00:00	Unit Shut down	4.99	4.88
22-Dec-24 12:00:00	Unit Shut down	4.99	4.99
22-Dec-24 13:00:00	Unit Shut down	4.99	4.92
22-Dec-24 14:00:00	Unit Shut down	4.99	4.93
22-Dec-24 15:00:00	Unit Shut down	4.99	4.98

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
22-Dec-24 16:00:00	Unit Shut down	4.99	4.97
22-Dec-24 17:00:00	Unit Shut down	4.99	4.93
22-Dec-24 18:00:00	Unit Shut down	4.99	4.99
22-Dec-24 19:00:00	Unit Shut down	4.99	4.99
22-Dec-24 20:00:00	Unit Shut down	4.99	4.99
22-Dec-24 21:00:00	Unit Shut down	4.99	4.99
22-Dec-24 22:00:00	Unit Shut down	4.99	4.83
22-Dec-24 23:00:00	Unit Shut down	4.99	4.89
23-Dec-24 00:00:00	Unit Shut down	4.99	4.87
23-Dec-24 01:00:00	Unit Shut down	4.99	4.99
23-Dec-24 02:00:00	Unit Shut down	4.20	4.93
23-Dec-24 03:00:00	Unit Shut down	4.23	5.00
23-Dec-24 04:00:00	Unit Shut down	4.99	4.89
23-Dec-24 05:00:00	Unit Shut down	4.99	4.87
23-Dec-24 06:00:00	Unit Shut down	4.99	4.99
23-Dec-24 07:00:00	Unit Shut down	4.99	4.99
23-Dec-24 08:00:00	Unit Shut down	4.99	4.99
23-Dec-24 09:00:00	Unit Shut down	4.99	4.99
23-Dec-24 10:00:00	Unit Shut down	4.99	4.99
23-Dec-24 11:00:00	Unit Shut down	4.99	4.99
23-Dec-24 12:00:00	Unit Shut down	4.99	4.99
23-Dec-24 13:00:00	Unit Shut down	4.99	5.00
23-Dec-24 14:00:00	Unit Shut down	4.99	4.96
23-Dec-24 15:00:00	Unit Shut down	4.99	4.95
23-Dec-24 16:00:00	Unit Shut down	4.99	4.95
23-Dec-24 17:00:00	Unit Shut down	4.99	4.96
23-Dec-24 18:00:00	Unit Shut down	4.99	4.92
23-Dec-24 19:00:00	Unit Shut down	4.99	5.00
23-Dec-24 20:00:00	Unit Shut down	4.99	4.98
23-Dec-24 21:00:00	Unit Shut down	4.99	4.95
23-Dec-24 22:00:00	Unit Shut down	4.99	4.96
23-Dec-24 23:00:00	Unit Shut down	4.99	4.92
24-Dec-24 00:00:00	Unit Shut down	4.99	4.89

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
24-Dec-24 01:00:00	Unit Shut down	4.99	4.91
24-Dec-24 02:00:00	Unit Shut down	4.99	4.95
24-Dec-24 03:00:00	Unit Shut down	4.99	4.95
24-Dec-24 04:00:00	Unit Shut down	4.99	4.97
24-Dec-24 05:00:00	Unit Shut down	4.99	4.99
24-Dec-24 06:00:00	Unit Shut down	4.99	4.98
24-Dec-24 07:00:00	Unit Shut down	4.99	4.99
24-Dec-24 08:00:00	Unit Shut down	4.99	4.95
24-Dec-24 09:00:00	Unit Shut down	4.99	4.89
24-Dec-24 10:00:00	Unit Shut down	4.99	4.99
24-Dec-24 11:00:00	Unit Shut down	4.99	4.99
24-Dec-24 12:00:00	Unit Shut down	4.99	4.99
24-Dec-24 13:00:00	Unit Shut down	4.99	4.95
24-Dec-24 14:00:00	Unit Shut down	4.99	4.88
24-Dec-24 15:00:00	Unit Shut down	4.99	4.98
24-Dec-24 16:00:00	Unit Shut down	4.99	4.95
24-Dec-24 17:00:00	Unit Shut down	4.99	4.98
24-Dec-24 18:00:00	Unit Shut down	4.99	4.94
24-Dec-24 19:00:00	Unit Shut down	4.99	4.95
24-Dec-24 20:00:00	Unit Shut down	4.09	4.93
24-Dec-24 21:00:00	Unit Shut down	4.10	4.95
24-Dec-24 22:00:00	Unit Shut down	4.05	4.91
24-Dec-24 23:00:00	Unit Shut down	4.05	4.94
25-Dec-24 00:00:00	Unit Shut down	4.03	4.89
25-Dec-24 01:00:00	Unit Shut down	4.00	4.91
25-Dec-24 02:00:00	Unit Shut down	3.99	4.91
25-Dec-24 03:00:00	Unit Shut down	3.98	4.88
25-Dec-24 04:00:00	Unit Shut down	3.97	4.96
25-Dec-24 05:00:00	Unit Shut down	3.94	4.95
25-Dec-24 06:00:00	Unit Shut down	3.94	4.92
25-Dec-24 07:00:00	Unit Shut down	3.91	4.96
25-Dec-24 08:00:00	Unit Shut down	4.13	4.94
25-Dec-24 09:00:00	Unit Shut down	4.14	4.95

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
25-Dec-24 10:00:00	Unit Shut down	4.15	4.89
25-Dec-24 11:00:00	Unit Shut down	4.13	4.92
25-Dec-24 12:00:00	Unit Shut down	4.07	4.92
25-Dec-24 13:00:00	Unit Shut down	4.08	4.90
25-Dec-24 14:00:00	Unit Shut down	4.10	4.91
25-Dec-24 15:00:00	Unit Shut down	4.11	4.92
25-Dec-24 16:00:00	Unit Shut down	4.09	4.98
25-Dec-24 17:00:00	Unit Shut down	4.10	4.99
25-Dec-24 18:00:00	Unit Shut down	4.12	4.89
25-Dec-24 19:00:00	Unit Shut down	4.13	4.99
25-Dec-24 20:00:00	Unit Shut down	4.14	4.94
25-Dec-24 21:00:00	Unit Shut down	4.13	4.88
25-Dec-24 22:00:00	Unit Shut down	4.12	4.89
25-Dec-24 23:00:00	Unit Shut down	4.14	4.91
26-Dec-24 00:00:00	Unit Shut down	4.11	4.88
26-Dec-24 01:00:00	Unit Shut down	4.11	4.87
26-Dec-24 02:00:00	Unit Shut down	4.08	4.97
26-Dec-24 03:00:00	Unit Shut down	4.08	4.95
26-Dec-24 04:00:00	Unit Shut down	4.07	4.97
26-Dec-24 05:00:00	Unit Shut down	4.01	4.90
26-Dec-24 06:00:00	Unit Shut down	3.99	4.92
26-Dec-24 07:00:00	Unit Shut down	3.96	4.97
26-Dec-24 08:00:00	Unit Shut down	4.99	4.93
26-Dec-24 09:00:00	Unit Shut down	4.99	4.91
26-Dec-24 10:00:00	Unit Shut down	4.99	4.89
26-Dec-24 11:00:00	Unit Shut down	4.99	4.89
26-Dec-24 12:00:00	Unit Shut down	4.99	4.98
26-Dec-24 13:00:00	Unit Shut down	4.99	4.97
26-Dec-24 14:00:00	Unit Shut down	4.99	4.89
26-Dec-24 15:00:00	Unit Shut down	4.99	4.97
26-Dec-24 16:00:00	Unit Shut down	4.99	4.90
26-Dec-24 17:00:00	Unit Shut down	4.99	4.87
26-Dec-24 18:00:00	Unit Shut down	4.27	4.97



Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
26-Dec-24 19:00:00	Unit Shut down	4.28	4.94
26-Dec-24 20:00:00	Unit Shut down	4.27	4.91
26-Dec-24 21:00:00	Unit Shut down	4.28	4.90
26-Dec-24 22:00:00	Unit Shut down	4.15	4.92
26-Dec-24 23:00:00	Unit Shut down	4.20	4.99
27-Dec-24 00:00:00	Unit Shut down	4.19	4.99
27-Dec-24 01:00:00	Unit Shut down	4.14	4.92
27-Dec-24 02:00:00	Unit Shut down	4.06	4.96
27-Dec-24 03:00:00	Unit Shut down	3.68	4.97
27-Dec-24 04:00:00	Unit Shut down	4.02	4.96
27-Dec-24 05:00:00	Unit Shut down	4.04	4.88
27-Dec-24 06:00:00	Unit Shut down	4.01	4.87
27-Dec-24 07:00:00	Unit Shut down	3.94	4.95
27-Dec-24 08:00:00	Unit Shut down	4.99	4.87
27-Dec-24 09:00:00	Unit Shut down	4.99	4.91
27-Dec-24 10:00:00	Unit Shut down	4.99	4.99
27-Dec-24 11:00:00	Unit Shut down	4.99	4.89
27-Dec-24 12:00:00	Unit Shut down	4.99	4.91
27-Dec-24 13:00:00	Unit Shut down	4.99	4.92
27-Dec-24 14:00:00	Unit Shut down	4.99	4.60
27-Dec-24 15:00:00	Unit Shut down	4.99	4.94
27-Dec-24 16:00:00	Unit Shut down	4.99	4.97
27-Dec-24 17:00:00	Unit Shut down	4.99	4.96
27-Dec-24 18:00:00	Unit Shut down	4.99	4.99
27-Dec-24 19:00:00	Unit Shut down	4.99	4.99
27-Dec-24 20:00:00	Unit Shut down	4.99	4.99
27-Dec-24 21:00:00	Unit Shut down	4.15	4.99
27-Dec-24 22:00:00	Unit Shut down	4.11	4.93
27-Dec-24 23:00:00	Unit Shut down	4.14	4.90
28-Dec-24 00:00:00	Unit Shut down	4.09	4.88
28-Dec-24 01:00:00	Unit Shut down	4.04	4.99
28-Dec-24 02:00:00	Unit Shut down	4.05	4.97
28-Dec-24 03:00:00	Unit Shut down	4.04	4.90

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
28-Dec-24 04:00:00	Unit Shut down	4.02	4.92
28-Dec-24 05:00:00	Unit Shut down	4.02	4.87
28-Dec-24 06:00:00	Unit Shut down	4.01	4.88
28-Dec-24 07:00:00	Unit Shut down	3.95	4.87
28-Dec-24 08:00:00	Unit Shut down	4.00	4.95
28-Dec-24 09:00:00	Unit Shut down	4.01	4.88
28-Dec-24 10:00:00	Unit Shut down	4.01	4.91
28-Dec-24 11:00:00	Unit Shut down	4.01	4.91
28-Dec-24 12:00:00	Unit Shut down	4.02	4.96
28-Dec-24 13:00:00	Unit Shut down	4.05	4.96
28-Dec-24 14:00:00	Unit Shut down	4.04	4.98
28-Dec-24 15:00:00	Unit Shut down	4.06	4.95
28-Dec-24 16:00:00	Unit Shut down	4.07	4.88
28-Dec-24 17:00:00	Unit Shut down	4.09	4.88
28-Dec-24 18:00:00	Unit Shut down	4.11	4.91
28-Dec-24 19:00:00	Unit Shut down	4.12	4.92
28-Dec-24 20:00:00	Unit Shut down	4.14	4.91
28-Dec-24 21:00:00	Unit Shut down	4.13	4.89
28-Dec-24 22:00:00	Unit Shut down	4.06	4.92
28-Dec-24 23:00:00	Unit Shut down	4.09	4.87
29-Dec-24 00:00:00	Unit Shut down	4.08	4.88
29-Dec-24 01:00:00	Unit Shut down	4.06	4.97
29-Dec-24 02:00:00	Unit Shut down	4.04	4.95
29-Dec-24 03:00:00	Unit Shut down	4.00	4.95
29-Dec-24 04:00:00	Unit Shut down	4.00	4.90
29-Dec-24 05:00:00	Unit Shut down	4.00	4.88
29-Dec-24 06:00:00	Unit Shut down	3.99	4.92
29-Dec-24 07:00:00	Unit Shut down	3.91	4.87
29-Dec-24 08:00:00	Unit Shut down	3.93	4.87
29-Dec-24 09:00:00	Unit Shut down	3.88	4.99
29-Dec-24 10:00:00	Unit Shut down	3.87	4.96
29-Dec-24 11:00:00	Unit Shut down	3.89	4.99
29-Dec-24 12:00:00	Unit Shut down	3.90	4.89

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
29-Dec-24 13:00:00	Unit Shut down	3.92	4.84
29-Dec-24 14:00:00	Unit Shut down	3.92	4.87
29-Dec-24 15:00:00	Unit Shut down	3.93	4.87
29-Dec-24 16:00:00	Unit Shut down	3.96	4.89
29-Dec-24 17:00:00	Unit Shut down	3.98	4.97
29-Dec-24 18:00:00	Unit Shut down	3.98	4.98
29-Dec-24 19:00:00	Unit Shut down	4.02	4.90
29-Dec-24 20:00:00	Unit Shut down	4.03	4.98
29-Dec-24 21:00:00	Unit Shut down	3.99	4.93
29-Dec-24 22:00:00	Unit Shut down	3.93	4.95
29-Dec-24 23:00:00	Unit Shut down	3.98	4.89
30-Dec-24 00:00:00	Unit Shut down	Unit Shut down	Unit Shut down
30-Dec-23 01:00:00	Unit Shut down	4.19	4.75
30-Dec-23 02:00:00	Unit Shut down	4.17	4.73
30-Dec-23 03:00:00	Unit Shut down	4.14	4.70
30-Dec-23 04:00:00	Unit Shut down	4.11	4.48
30-Dec-23 05:00:00	Unit Shut down	4.09	4.47
30-Dec-23 06:00:00	Unit Shut down	4.08	4.46
30-Dec-23 07:00:00	Unit Shut down	4.12	4.47
30-Dec-23 08:00:00	Unit Shut down	4.31	4.29
30-Dec-23 09:00:00	Unit Shut down	4.34	4.33
30-Dec-23 10:00:00	Unit Shut down	4.34	4.28
30-Dec-23 11:00:00	Unit Shut down	4.34	4.30
30-Dec-23 12:00:00	Unit Shut down	4.33	4.23
30-Dec-23 13:00:00	Unit Shut down	4.33	4.29
30-Dec-23 14:00:00	Unit Shut down	4.33	4.32
30-Dec-23 15:00:00	Unit Shut down	4.34	4.38
30-Dec-23 16:00:00	Unit Shut down	4.35	4.41
30-Dec-23 17:00:00	Unit Shut down	4.37	3.89
30-Dec-23 18:00:00	Unit Shut down	4.37	3.77
30-Dec-23 19:00:00	Unit Shut down	4.40	3.89
30-Dec-23 20:00:00	Unit Shut down	4.44	3.89
30-Dec-23 21:00:00	Unit Shut down	4.17	3.80

Summary daily average cooling difference temperature

Date	CFB1 (C°)	CFB2 (C°)	CFB3 (C°)
30-Dec-23 22:00:00	Unit Shut down	4.06	3.70
30-Dec-23 23:00:00	Unit Shut down	4.13	3.78
31-Dec-23 00:00:00	Unit Shut down	3.98	3.77
31-Dec-23 01:00:00	Unit Shut down	3.92	3.76
31-Dec-23 02:00:00	Unit Shut down	3.84	3.67
31-Dec-23 03:00:00	Unit Shut down	3.79	3.65
31-Dec-23 04:00:00	Unit Shut down	3.76	3.70
31-Dec-23 05:00:00	Unit Shut down	3.74	3.68
31-Dec-23 06:00:00	Unit Shut down	3.71	3.61
31-Dec-23 07:00:00	Unit Shut down	3.68	3.61
31-Dec-23 08:00:00	Unit Shut down	3.72	3.61
31-Dec-23 09:00:00	Unit Shut down	3.70	3.65
31-Dec-23 10:00:00	Unit Shut down	3.73	3.68
31-Dec-23 11:00:00	Unit Shut down	3.76	3.62
31-Dec-23 12:00:00	Unit Shut down	3.65	3.60
31-Dec-23 13:00:00	Unit Shut down	3.62	3.56
31-Dec-23 14:00:00	Unit Shut down	3.62	3.56
31-Dec-23 15:00:00	Unit Shut down	3.62	3.54
31-Dec-23 16:00:00	Unit Shut down	3.58	3.61
31-Dec-23 17:00:00	Unit Shut down	3.58	3.71
31-Dec-23 18:00:00	Unit Shut down	3.59	3.60
31-Dec-23 19:00:00	Unit Shut down	3.60	3.65
31-Dec-23 20:00:00	Unit Shut down	3.63	3.77
31-Dec-23 21:00:00	Unit Shut down	3.63	3.71
31-Dec-23 22:00:00	Unit Shut down	3.64	3.74
31-Dec-23 23:00:00	Unit Shut down	3.70	3.83
01-Jan-24 00:00:00	Unit Shut down	3.70	3.90