

ภาคผนวก ข

เอกสารประกอบการปฏิบัติตาม
มาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม

ภาคผนวก ข.1

จดหมายนำส่งรายงานการปฏิบัติตามมาตรการฯ
ให้กับหน่วยงานของรัฐซึ่งมีอำนาจอนุญาตตามกฎหมาย



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

สำนักงานใหญ่ : เลขที่ 555/1 ศูนย์อำนวยการอุตสาหกรรมปิโตรเคมีฯ อาคาร 18 ถนนวิภาวดีรังสิต แขวงจตุจักร
เขตจตุจักร กรุงเทพฯ 10900 โทรศัพท์ +66(0)2265-8400 โทรสาร +66(0)2265-8500

สำนักงานระยอง : เลขที่ 59 ถนนราษฎร์นิยม ตำบลเนินพระ อำเภอเมืองระยอง จังหวัดระยอง 21150
โทรศัพท์ +66(0)3899-4000 โทรสาร +66(0)3899-4111

บมจ. เลขที่ 0107554000267

ที่ 04 - 33 / 2567

25 กรกฎาคม 2567

เรื่อง รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตาม
ตรวจสอบคุณภาพสิ่งแวดล้อม โครงการโรงผลิตสารโอเลฟินส์ ของบริษัท พีทีที โกลบอล เคมิคอล
จำกัด (มหาชน) สาขา 3 โรงโอเลฟินส์ 2

เรียน ผู้อำนวยการสำนักงานนิคมอุตสาหกรรมมาบตาพุด

- สิ่งที่ส่งมาด้วย 1. รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และ
มาตรการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม โครงการโรงผลิตสารโอเลฟินส์
จำนวน 3 เล่ม
2. CD รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และ
มาตรการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม โครงการโรงผลิตสารโอเลฟินส์
จำนวน 4 แผ่น

ตามที่สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม กำหนดให้โรงงานเสนอ
รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบ
คุณภาพสิ่งแวดล้อม โดยสรุปให้หน่วยงานที่เกี่ยวข้องทุก 6 เดือน

บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 3 โรงโอเลฟินส์ 2 ใคร่ขอส่งรายงานผลการ
ปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบคุณภาพ
สิ่งแวดล้อม ของโครงการโรงผลิตสารโอเลฟินส์ ครั้งที่ 1/2567 ระหว่างเดือนมกราคม ถึง มิถุนายน พ.ศ. 2567
รายละเอียดดังสิ่งที่ส่งมาด้วย

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ



รองกรรมการผู้จัดการใหญ่ สายงานโอเลฟินส์

หน่วยงาน SHE-Olefins II

โทร. 0-3897-5000 ต่อ 5734

ได้รับเอกสารแล้ว เมื่อวันที่ ๒1 กค ๖๗
ลงชื่อ..... ผู้รับเอกสาร

ยืนยันการรับข้อมูลเข้าสู่ระบบอิเล็กทรอนิกส์

เลขที่ Monitor : 256707-869

ชื่อโครงการ : โครงการโรงผลิตสารโอเลฟินส์ (ส่วนขยาย ครั้งที่ 3) บริษัท
พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

รอบรายงาน : ม.ค 67 - มิ.ย. 67


วันที่ยื่นรายงาน : 31/07/2567

เลขที่ IEE/EIA/EHIA : 15167

ผู้ยื่นรายงาน :

อีเมล :

โทรศัพท์ :

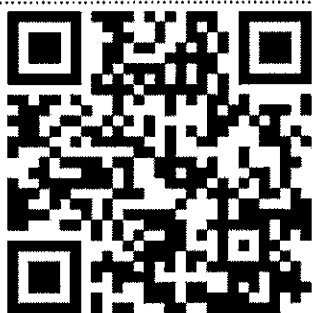

QR Code สำหรับเรียกดูข้อมูลรายงานรายงาน Monitor นี้
โดยท่านสามารถเรียกดูข้อมูลรายงานต่างๆ
ที่เกี่ยวข้องกับโครงการได้ผ่านโมบายแอปพลิเคชัน Smart EIA
อีกหนึ่งช่องทาง

สำนักงานนโยบายและแผนทรัพยากรธรรมชาติและสิ่งแวดล้อม



กองพัฒนาระบบการประเมินผลกระทบสิ่งแวดล้อม
Division of Environmental Impact Assessment Development

ภาคผนวก ข.2

สรุปผลการศึกษา HAZOP ที่เพิ่มมาแต่ละปี

កង្វះ

Summary

វិទ្យាសាស្ត្រ
ប្រែប្រួល

ความเข้มข้น = 29.9 mg SO₂/g
อัตราการไหล = 1.5 ลิตรต่อนาที
อัตราการไหลของแก๊สออกซิเจน
-ไฮโดรเจน (H₂) 27 mol-%
-คาร์บอนมอนอกไซด์ (CO) 0.08 mol-%
-ก๊าซเฉื่อย (C₂H₆) 72 mol-%

5270

19-A [-49-04-01] Tail gas expander/compressor

14000000

| เลขประจำตัวประชาชน | ชื่อ-นามสกุล | ตำแหน่ง | หน่วยงาน | ข้อมูลการปฏิบัติงาน | ข้อมูลการประเมินผล | | | |
|--------------------|--------------|---------|----------|---------------------|--------------------|-------|-----------|-----|
| | | | | | ความรู้ | ทักษะ | คุณลักษณะ | รวม |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |

บริษัท นวัตกรรม เทคโนโลยี และ การบริการ จำกัด (มหาชน)

[illegible][illegible]


กรมส่งเสริมการค้าระหว่างประเทศ
บริษัท สยาม โอเรียนทอล จำกัด (มหาชน)

[illegible]

[illegible][illegible]

ภาคผนวก ข.3

หนังสือแจ้งการติดตั้งและเชื่อมโยงข้อมูล Online Monitoring
ไปยังสำนักงานนิคมอุตสาหกรรมมาบตาพุด



หลังจากรื้อถอนแล้วจะนำปูนซีเมนต์ไปใช้ทำอะไรบ้าง
ผู้เขียนพบว่ามีงานที่นิยมใช้ปูนซีเมนต์ในกรณีการนำปูนซีเมนต์ไปใช้ทำอะไรบ้าง
1) การนำปูนซีเมนต์ไปใช้ทำอะไรบ้าง
2) การนำปูนซีเมนต์ไปใช้ทำอะไรบ้าง

เนื่องจาก มหานครนิวยอร์กและอหะซัยจะขยับตัวล่วงหน้าก่อนในปริมาณ 15-4. การเปลี่ยนแปลง
รายละเอียด โครงการในทางงบประมาณวิศวกรรมที่เกี่ยวข้อง โครงการ 15-4 จะเกิดขึ้น โดยพื้นฐานแล้ว ทั้งที่ 5
ของงบปีแรก มีสิทธิ์ ไม่แน่นอน แต่ยังคง จำกัด (เฉพาะ 15-4) 3 ครั้งโดยสิ้นเชิง 15-4 จะกำหนดให้ต้องเขียน 10-
ข้อมูลผลการตรวจวัดค่าทางเคมีสำหรับ 15-4 ปีแรกให้เสร็จ จากคณะกรรมการวิจัยมหาวิทยาลัยเมือง (Online
Gas Detector หรือ Gas Chromatograph) ในบริเวณมหาวิทยาลัย 1,3 ปีแรกให้เสร็จ ไม่ใช่อุปกรณ์ที่จะใช้และ
อาจจะเพิ่มอุปกรณ์ที่จะใช้เพื่อเพิ่มจำนวนของสำนักงานปฏิบัติการแบบภาคนี้รวมทั้งเพิ่มเครื่องมือที่จำเป็นด้วย และ
บริษัท 4 ของกลุ่มจะดำเนินการในการเพิ่มข้อมูลชุดข้อมูล 18 แห่ง ซึ่งปริมาณรายละเอียดที่ใส่ได้เท่ากับตัว 2 เพื่อ
คำนวณการเพิ่มข้อมูลชุดข้อมูลเหล่านี้ตามเพิ่มขึ้นของสาร 1,3 ปีแรกให้เสร็จ ในเวลาที่จะวางพิมพ์ที่ 14-19
ตุลาคม 2553

ทั้งนี้ ถ้าหากการประมาณการซึ่งมีข้อมูลระหว่างบริษัทฯ ไปยังศูนย์ผู้ให้บริการระหว่างประเทศและกลุ่มลูกค้าต่าง ๆ มีความผิดพลาดสูงเกินกว่า ๑๐% บริษัทฯ จะพิจารณาปรับลดหรือเพิ่มรายได้จากการดำเนินงานในส่วนที่เกี่ยวข้องกับธุรกิจดังกล่าว

1. คุณบรรณวิทย์นันท์ อัครพัฒนวิเศษ โทร. ๐๘๕-๗๗๖-๑๖๖๖
2. คุณวิภาดา อัครพัฒนวิเศษ โทร. ๐๘๕-๗๗๖-๑๖๖๖

๙๖๕: กรมการช่างและศิลปศึกษา

ਅਮਰਿਕਾ ਵਿਚ ਵਸਦੇ ਹਿੰਦੂ

ของกรมการแพทย์ใหญ่ กลุ่มแพทย์อาสาสมัคร

หมายเลขงาน SHE-Olefin 1
โทร. 0-3587-5761

***** (SECRET) *****

[illegible]

Internet IP Address: CENX.PTTCGROUP.COM:2100
Einfach

Modern warfare
Envisage Ultimate

Line Internet Back up
Logger ID no: 5 S&A hp, 5

4.1 ชื่อผู้จัดการโรงงาน นายพรหม ปิ่นนาค
โทรศัพท์ 038-98-4000

การพิมพ์
ฉบับนี้

รวมบทความในชุด

E-mail: scott.finn@usda.gov

4.2 โครงการพัฒนาระบบ CEMs ภายใต้ 5 มาตรการ
สำคัญ 028-27-5740

អារម្ភ
Mobile

089 870 8234

E-mail: callison.j@policejournal.com

แบบฟอร์มสำหรับกรอกข้อมูลการตรวจวัดค่ามลพิษทางอากาศ (CEQA: Criteria)

1. ข้อมูลทั่วไป

ชื่อโครงการ: ...
 ที่อยู่: ...
 ประเภทโครงการ: ...
 ผู้ดำเนินการ: ...
 วันที่: ...

2. ข้อมูลของโครงการ (CEQA)

2.1. ลักษณะของโครงการ: ...

2.2. ลักษณะของพื้นที่: ...

หมายเหตุ:

1. ข้อมูลของโครงการ: ...

2. ข้อมูลของพื้นที่: ...

3. ข้อมูลของโครงการ: ...

4. ข้อมูลของพื้นที่: ...

5. ข้อมูลของโครงการ: ...

6. ข้อมูลของพื้นที่: ...


| ลำดับ | ชื่อโครงการ | วันที่ | พื้นที่ | ข้อมูลการตรวจวัด | | | ผลการตรวจวัด | |
|-------|-------------|--------|---------|------------------|-----------|-----------|--------------|-----------|
| | | | | ค่าเฉลี่ย | ค่าสูงสุด | ค่าต่ำสุด | ค่าเฉลี่ย | ค่าสูงสุด |
| 1 | ... | ... | ... | ... | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... | ... | ... | ... | ... |
| 21 | ... | ... | ... | ... | ... | ... | ... | ... |
| 22 | ... | ... | ... | ... | ... | ... | ... | ... |
| 23 | ... | ... | ... | ... | ... | ... | ... | ... |
| 24 | ... | ... | ... | ... | ... | ... | ... | ... |
| 25 | ... | ... | ... | ... | ... | ... | ... | ... |
| 26 | ... | ... | ... | ... | ... | ... | ... | ... |
| 27 | ... | ... | ... | ... | ... | ... | ... | ... |
| 28 | ... | ... | ... | ... | ... | ... | ... | ... |
| 29 | ... | ... | ... | ... | ... | ... | ... | ... |
| 30 | ... | ... | ... | ... | ... | ... | ... | ... |
| 31 | ... | ... | ... | ... | ... | ... | ... | ... |
| 32 | ... | ... | ... | ... | ... | ... | ... | ... |
| 33 | ... | ... | ... | ... | ... | ... | ... | ... |
| 34 | ... | ... | ... | ... | ... | ... | ... | ... |
| 35 | ... | ... | ... | ... | ... | ... | ... | ... |
| 36 | ... | ... | ... | ... | ... | ... | ... | ... |
| 37 | ... | ... | ... | ... | ... | ... | ... | ... |
| 38 | ... | ... | ... | ... | ... | ... | ... | ... |
| 39 | ... | ... | ... | ... | ... | ... | ... | ... |
| 40 | ... | ... | ... | ... | ... | ... | ... | ... |
| 41 | ... | ... | ... | ... | ... | ... | ... | ... |
| 42 | ... | ... | ... | ... | ... | ... | ... | ... |
| 43 | ... | ... | ... | ... | ... | ... | ... | ... |
| 44 | ... | ... | ... | ... | ... | ... | ... | ... |
| 45 | ... | ... | ... | ... | ... | ... | ... | ... |
| 46 | ... | ... | ... | ... | ... | ... | ... | ... |
| 47 | ... | ... | ... | ... | ... | ... | ... | ... |
| 48 | ... | ... | ... | ... | ... | ... | ... | ... |
| 49 | ... | ... | ... | ... | ... | ... | ... | ... |
| 50 | ... | ... | ... | ... | ... | ... | ... | ... |

3. ข้อมูลของพื้นที่ (CEQA: Criteria)

3.1. ข้อมูลของพื้นที่

| ลำดับ | ชื่อพื้นที่ | วันที่ | พื้นที่ | ค่าเฉลี่ย | ค่าสูงสุด | ค่าต่ำสุด | ค่าเฉลี่ย | ค่าสูงสุด |
|-------|-------------|--------|---------|-----------|-----------|-----------|-----------|-----------|
| 1 | ... | ... | ... | ... | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... | ... | ... | ... | ... |
| 21 | ... | ... | ... | ... | ... | ... | ... | ... |
| 22 | ... | ... | ... | ... | ... | ... | ... | ... |
| 23 | ... | ... | ... | ... | ... | ... | ... | ... |
| 24 | ... | ... | ... | ... | ... | ... | ... | ... |
| 25 | ... | ... | ... | ... | ... | ... | ... | ... |
| 26 | ... | ... | ... | ... | ... | ... | ... | ... |
| 27 | ... | ... | ... | ... | ... | ... | ... | ... |
| 28 | ... | ... | ... | ... | ... | ... | ... | ... |
| 29 | ... | ... | ... | ... | ... | ... | ... | ... |
| 30 | ... | ... | ... | ... | ... | ... | ... | ... |
| 31 | ... | ... | ... | ... | ... | ... | ... | ... |
| 32 | ... | ... | ... | ... | ... | ... | ... | ... |
| 33 | ... | ... | ... | ... | ... | ... | ... | ... |
| 34 | ... | ... | ... | ... | ... | ... | ... | ... |
| 35 | ... | ... | ... | ... | ... | ... | ... | ... |
| 36 | ... | ... | ... | ... | ... | ... | ... | ... |
| 37 | ... | ... | ... | ... | ... | ... | ... | ... |
| 38 | ... | ... | ... | ... | ... | ... | ... | ... |
| 39 | ... | ... | ... | ... | ... | ... | ... | ... |
| 40 | ... | ... | ... | ... | ... | ... | ... | ... |
| 41 | ... | ... | ... | ... | ... | ... | ... | ... |
| 42 | ... | ... | ... | ... | ... | ... | ... | ... |
| 43 | ... | ... | ... | ... | ... | ... | ... | ... |
| 44 | ... | ... | ... | ... | ... | ... | ... | ... |
| 45 | ... | ... | ... | ... | ... | ... | ... | ... |
| 46 | ... | ... | ... | ... | ... | ... | ... | ... |
| 47 | ... | ... | ... | ... | ... | ... | ... | ... |
| 48 | ... | ... | ... | ... | ... | ... | ... | ... |
| 49 | ... | ... | ... | ... | ... | ... | ... | ... |
| 50 | ... | ... | ... | ... | ... | ... | ... | ... |

หมายเหตุ: ...



8557 NUB

१४३३

ผู้ดำเนินการจัดทำงานนี้คือมูลนิธิสงเคราะห์เด็กไทย

๕.๓ การเปลี่ยนแปลงของระบบเศรษฐกิจไทย

โรงเรียนราชประชานุเคราะห์ ๕ จังหวัดบุรีรัมย์ วันที่ ๒๐ พฤษภาคม ๒๕๖๓ (นายทศพร)

આચાર્યશ્રીના આશ્રિત સ્વર્ણકાળે

RECEIVED
JAN 10 1967

1. The first part of the document is a list of names and titles, including "The Hon. Mr. Justice" and "The Hon. Mr. Justice".

17

[illegible]

90701 2558

ทั้งนี้ ถ้าหากมีการประชุมแบบการถ่ายสัญญาณระหว่างบริษัทฯ ไปยังศูนย์ที่กระทรวงเกษตรและสหกรณ์
 ตามการเชิญจากสภามหาวิทยาลัยเกษตรศาสตร์ว่าถึงงานบัณฑิตศึกษามหาวิทยาลัยเกษตรศาสตร์ตามงานดำเนินการ
 ดังกล่าว ได้ที่

1. คุณธนัชพร : นักข่าวพิเศษ
โทรศัพท์มือถือ 085-178-183
2. คุณธีรพัฒน์ : ตำรวจ
โทรศัพท์มือถือ 091-970-6344

31/01/1996 10:00:00 AM

นางอภัย หิมาวัตร

การขาดความรู้ใหม่ ขาดประสบการณ์

Тел. 0-3597-5761

1. **ชื่อโครงการ/ชื่อเรื่อง** : โครงการพัฒนาระบบงานเอกสาร
 2. **ชื่อผู้จัดทำ/ชื่อหน่วยงาน** : นางสาวสมใจ ใจดี / หน่วยงานราชการ
 3. **ชื่ออาจารย์ที่ปรึกษา** : อาจารย์สมชาย ใจดี
 4. **ชื่อผู้ช่วย** : นางสาวสมใจ ใจดี

[illegible]

| | | | |
|----------------------------|---|-------------------|-----------------------------|
| 3. ชื่อคอมพิวเตอร์/เครื่อง | Internet IP Address: CEN-PTTG-CGROUP.COM/2108 | Model/Host/Ver. | Line/Internet/Back up |
| คอมพิวเตอร์/เครื่อง | Emulation | Emulator/Ultimaty | Logger ID no: 5, File No. 5 |

A. ข้อมูลส่วนบุคคลที่ปรากฏในบัญชีรายชื่อ

| ร.ร. | ชื่อ | นามสกุล | ตำแหน่ง | เบอร์โทรศัพท์ | อีเมล |
|------|------|---------|---------|---------------|------------------------|
| 1 | นาย | สมชาย | สมใจ | 08-123-4567 | smchai.smjai@group.com |

4.2.2 Personal Contact Details

| | | | |
|-----------------|---------------------------|----------------|---|
| <u>Name:</u> | <u>Mrs Tina A. Hwang.</u> | <u>Work:</u> | <u>78967</u> |
| <u>Contact:</u> | <u>035-97-5740</u> | <u>Mobile:</u> | <u>096-576-8234</u> |
| | | | <u>E-mail address: Tina.Hwang@nrc.ca</u> |



คำขวัญ: ใจอาสา ใจดีใจเก่ง (CEN)

Cheng Chen, Jinyan Li, and Huihui Wang

แบบฟอร์มข้อมูลระบบตรวจสอบมลพิษแบบต่อเนื่อง (CEMs)

1. 背景

[illegible]

2. ตรวจจับวัตถุ (Sensor)

| เครื่องวัด (Sensor) | | | | หน่วย | | ช่วงการตรวจวัด | หน่วย | ค่าอ้างอิง/ปกติ | หมายเหตุ |
|-------------------------|--------------|-------------|-------------------------|------------|--------|-------------------------|-------|-----------------|----------|
| Parameter | Tag Name | Plant | Description | | | | | | |
| NOx @ 7% O ₂ | AI2412X.PV | Plant 3-4 | Boiler | ABB/URAR14 | 0-400 | ppm @ 7% O ₂ | 19 | | |
| SOx @ 7% O ₂ | AI2414X.PV | Plant 3-4 | Boiler | ABB/URAR14 | 0-1600 | ppm @ 7% O ₂ | 20 | | |
| SOx @ 7% O ₂ | AI10103X.PV | Plant 1-4/1 | Cracking Furnace F-1010 | ABB/URAR14 | 0-200 | ppm @ 7% O ₂ | 21 | | |
| NOx @ 7% O ₂ | AI10103X.PV | Plant 1-4/1 | Cracking Furnace F-1010 | ABB/URAR14 | 0-200 | ppm @ 7% O ₂ | 22 | | |
| SOx @ 7% O ₂ | AI10203X.PV | Plant 1-4/1 | Cracking Furnace F-1020 | ABB/URAR14 | 0-200 | ppm @ 7% O ₂ | 23 | | |
| NOx @ 7% O ₂ | AI10203X.PV | Plant 1-4/1 | Cracking Furnace F-1020 | ABB/URAR14 | 0-200 | ppm @ 7% O ₂ | 24 | | |
| SOx @ 7% O ₂ | AI310101X.PV | Plant 1-4/2 | Cracking Furnace F-3101 | ABB/URAR14 | 0-60 | ppm @ 7% O ₂ | 25 | | |
| SOx @ 7% O ₂ | AI310201X.PV | Plant 1-4/2 | Cracking Furnace F-3102 | ABB/URAR14 | 0-60 | ppm @ 7% O ₂ | 26 | | |
| SOx @ 7% O ₂ | AI310401X.PV | Plant 1-4/2 | Cracking Furnace F-3103 | ABB/URAR14 | 0-60 | ppm @ 7% O ₂ | 27 | | |
| NOx @ 7% O ₂ | AI310101X.PV | Plant 1-4/2 | Cracking Furnace F-3101 | ABB/URAR14 | 0-160 | ppm @ 7% O ₂ | 28 | | |
| NOx @ 7% O ₂ | AI310201X.PV | Plant 1-4/2 | Cracking Furnace F-3102 | ABB/URAR14 | 0-160 | ppm @ 7% O ₂ | 29 | | |
| NOx @ 7% O ₂ | AI310301X.PV | Plant 1-4/2 | Cracking Furnace F-3103 | ABB/URAR14 | 0-160 | ppm @ 7% O ₂ | 30 | | |
| SOx @ 7% O ₂ | AI310401X.PV | Plant 1-4/2 | Cracking Furnace F-3104 | ABB/URAR14 | 0-60 | ppm @ 7% O ₂ | 31 | | |
| SOx @ 7% O ₂ | AI310601X.PV | Plant 1-4/2 | Cracking Furnace F-3105 | ABB/URAR14 | 0-60 | ppm @ 7% O ₂ | 32 | | |
| NOx @ 7% O ₂ | AI310401X.PV | Plant 1-4/2 | Cracking Furnace F-3104 | ABB/URAR14 | 0-160 | ppm @ 7% O ₂ | 33 | | |
| NOx @ 7% O ₂ | AI310601X.PV | Plant 1-4/2 | Cracking Furnace F-3105 | ABB/URAR14 | 0-160 | ppm @ 7% O ₂ | 34 | | |
| SOx @ 7% O ₂ | AI310606X.PV | Plant 1-4/2 | Cracking Furnace F-3106 | ABB/URAR14 | 0-160 | ppm @ 7% O ₂ | 35 | | |
| NOx @ 7% O ₂ | AI310606X.PV | Plant 1-4/2 | Cracking Furnace F-3106 | ABB/URAR14 | 0-50 | ppm @ 7% O ₂ | 36 | | |

แบบฟอร์มข้อมูลระบบตรวจสอบมลพิษแบบต่อเนื่อง (CEMs)

1. ગ્રંથપ્રકરણ

[illegible]

2. เซลล์แม่ข่าย (Sensor)

| Parameter | | Tag Name | Plant | Description | Unit | Range | Unit | Unit | Unit |
|-------------------------|---------------|-----------|-----------------------|-----------------------|-------|-------------------------|------|------|------|
| COD Plant I-4 | COD Plant I-4 | Plant I-4 | Waste Water Treatment | Brant+Dugbebe/Berikan | 0-120 | ppm | 27 | | |
| | | | | | | | 28 | | |
| | | | | | | | 29 | | |
| NOX @ 7% O ₂ | | TOCGC | Waste Heat Boiler | | 0-200 | ppm @ 7% O ₂ | 30 | | |
| | | | | | | | 31 | | |
| | | | | | | | 32 | | |
| | | | | | | | 33 | | |
| | | | | | | | 34 | | |
| | | | | | | | 35 | | |
| | | | | | | | 36 | | |
| | | | | | | | 37 | | |
| | | | | | | | 38 | | |
| | | | | | | | 39 | | |
| | | | | | | | 40 | | |
| | | | | | | | 41 | | |
| | | | | | | | 42 | | |
| | | | | | | | 43 | | |
| | | | | | | | 44 | | |
| | | | | | | | 45 | | |
| | | | | | | | 46 | | |
| | | | | | | | 47 | | |
| | | | | | | | 48 | | |
| | | | | | | | 49 | | |
| | | | | | | | 50 | | |
| | | | | | | | 51 | | |
| | | | | | | | 52 | | |
| | | | | | | | 53 | | |
| COD Plant I-1 | COD Plant I-1 | Plant I-1 | Waste Water Treatment | UVAC with SC100 | 0-120 | ppm | 54 | | |

แบบฟอร์มข้อมูลระบบตรวจวัดมลพิษแบบต่อเนื่อง (CEMs)

1. ข้อมูลทั่วไป
 ชื่อโรงงาน/บริษัท: บริษัท อีอีซี จำกัด (มหาชน)
 ที่อยู่: เลขที่ 42(1) 27/2535 ถนน
 อำเภอ: เมือง จังหวัด: นนทบุรี
 โทรศัพท์: 038-99-4000 โทรสาร: 038-99-4001
 อีเมล: eece@eece.com
 2. ข้อมูลเครื่องวัด (Sensor)
 เลขที่เครื่องวัด: 42(1) 27/2535
 วันที่ติดตั้ง: 14 กุมภาพันธ์ 2558
 ผู้ติดตั้ง: บริษัท อีอีซี จำกัด (มหาชน)
 เลขที่ใบอนุญาต: 14 กุมภาพันธ์ 2558

| Parameter | Tag Name | Plant | Description | ยี่ห้อ/รุ่น | ช่วงการตรวจวัด | หน่วย | เลขช่องสัญญาณ | หมายเหตุ |
|-------------------------|-----------------|-----------|------------------------|---------------------------------|----------------|-------------------------|---------------|----------|
| NOx @ 7% O ₂ | H-3710-NOx @ 7% | Plant I-1 | HRSG #3 (H-3710) | Environment S.A. / MIR-9000 CLD | 0-200 ppm | ppm @ 7% O ₂ | 65 | |
| NOx @ 7% O ₂ | H-3709-NOx @ 7% | Plant I-1 | HRSG #2 (H-3709) | Environment S.A. / MIR-9000 CLD | 0-200 ppm | ppm @ 7% O ₂ | 66 | |
| NOx @ 7% O ₂ | H-3708-NOx @ 7% | Plant I-1 | HRSG #1 (H-3708) | Environment S.A. / MIR-9000 CLD | 0-200 ppm | ppm @ 7% O ₂ | 67 | |
| NOx @ 7% O ₂ | H-3707 | Plant I-1 | Aux boiler #2 (H-3707) | Environment S.A. / MIR-9000 CLD | 0-100 ppm | ppm @ 7% O ₂ | 68 | |
| NOx @ 7% O ₂ | H-3706 | Plant I-1 | Aux boiler #1 (H-3706) | Environment S.A. / MIR-9000 CLD | 0-100 ppm | ppm @ 7% O ₂ | 69 | |
| NOx @ 7% O ₂ | H-3705 | Plant I-1 | HRSG II (H-3705) | SIEMENS/Ultimate23 | 0-200 | ppm @ 7% O ₂ | 60 | |
| NOx @ 7% O ₂ | H-3704 | Plant I-1 | HRSG I (H-3704) | SIEMENS/Ultimate23 | 0-200 | ppm @ 7% O ₂ | 61 | |
| NOx @ 7% O ₂ | H-3703 | Plant I-1 | WHSS II (H-3703) | SIEMENS/Ultimate23 | 0-200 | ppm @ 7% O ₂ | 62 | |
| NOx @ 7% O ₂ | H-3702 | Plant I-1 | FSB (H-3702) | SIEMENS/Ultimate23 | 0-200 | ppm @ 7% O ₂ | 63 | ดัดแปลง |
| NOx @ 7% O ₂ | H-3701 | Plant I-1 | WHSS I (H-3701) | SIEMENS/Ultimate23 | 0-200 | ppm @ 7% O ₂ | 64 | |

3. ข้อมูลระบบรับส่งข้อมูล
 ระบบส่งข้อมูลเป็นแบบ Real-time IP Address: 19.88.235.216 Modem เบอร์โทร: Line Internet Back up
 Logger: Enviroch รุ่น: EnvirochFW Logger ID No. 18

4. ข้อมูลเพื่อการติดต่อประสานงานกรณีฉุกเฉิน

แบบฟอร์มข้อมูลระบบตรวจวัดมลพิษแบบต่อเนื่อง (CEMs)

1. ข้อมูลทั่วไป
 ชื่อโรงงาน/บริษัท: บริษัท อีอีซี จำกัด (มหาชน)
 ที่อยู่: เลขที่ 42(1) 27/2535 ถนน
 อำเภอ: เมือง จังหวัด: นนทบุรี
 โทรศัพท์: 038-99-4000 โทรสาร: 038-99-4001
 อีเมล: eece@eece.com
 2. ข้อมูลเครื่องวัด (Sensor)
 เลขที่เครื่องวัด: 42(1) 27/2535
 วันที่ติดตั้ง: 14 กุมภาพันธ์ 2558
 ผู้ติดตั้ง: บริษัท อีอีซี จำกัด (มหาชน)
 เลขที่ใบอนุญาต: 14 กุมภาพันธ์ 2558

| Parameter | Tag Name | Plant | Description | ยี่ห้อ/รุ่น | ช่วงการตรวจวัด | หน่วย | เลขช่องสัญญาณ | หมายเหตุ |
|-----------|----------|-------|-------------|-------------|----------------|-------|---------------|----------|
|-----------|----------|-------|-------------|-------------|----------------|-------|---------------|----------|

4.1 ข้อมูลการโทรแจ้งระบบตรวจวัดมลพิษ
 โทรศัพท์: 038-99-4000 Mobile: 038-99-4001 Email: eece@eece.com
 ชื่อผู้ควบคุมระบบ CEMs: นางสาว อีอีซี ตำแหน่ง: หัวหน้างาน เบอร์โทร: 038-99-4000
 โทรศัพท์: 038-99-4000 Mobile: 038-99-4001 Email: eece@eece.com

ภาคผนวก ข.4

การทบทวนเหตุการณ์อุบัติภัย/อุบัติเหตุ
ที่เกิดขึ้นจากการประกอบกิจการ
อุตสาหกรรมที่มีการผลิตลักษณะเดียวกัน



การประชุมคณะกรรมการความปลอดภัย อาชีวอนามัยและสิ่งแวดล้อม (คปอ.) ครั้งที่ 2/2567 กลุ่มผลิตภัณฑ์โอเลฟินส์



Safety Moment



Incident Summary

BUALET5 6-Camera 6 02-Jun-2011 6:18:46 PM SST



เช้าวันที่ 2 มิถุนายน 2011 ผู้รับเหมาได้ขออนุญาต Work permit ในระบบ e-Work Permit และทาง Lead Operator ได้เข้ามาตรวจสอบและอนุมัติ Work permit ช่วงเวลา 15.37 น.

เวลา 17.47 น. หลังได้รับการอนุมัติ Work Permit ทางผู้รับเหมาได้เริ่มดำเนินการถอดน็อตยึดหน้าแปลนของฝา Manhole ด้านบนหัวถังออก แล้วหย่อนสาย Hose PVC ขนาด 2 นิ้ว ลงไป โดยที่ปลาย Hose อีกด้านต่อเข้ากับรถ Vacuum Truck และเริ่มทำการสูบล้างที่คิดว่าเป็น Diethanolamine ออกจากถังมาใส่รถ Vacuum Truck

เวลา 18.19 น. ได้เกิดการระเบิดขึ้นภายในถัง T302 และเกิดไฟลุกไหม้ที่ตัวถังและรถ Vacuum Truck ตามมา ส่งผลให้ผู้รับเหมาที่ทำงานบนหัวถังและด้านล่างบริเวณรถ Vacuum Truck เสียชีวิตรวม 4 คน และอีก 1 คนบาดเจ็บสาหัสจากการถูกไฟคลอก

Incident Cause

1. Operator ที่มา Drain สาร Hydrocarbon ใช้การอ่านค่าจาก LT301 เพียงอย่างเดียว โดยไม่ได้ Cross Check กับ Float and Tape Level gauge (**LT301 วัดระดับได้ไม่เที่ยงกันทั้ง ในขณะ Float and Tape Level gauge วัดระดับได้เที่ยงกันทั้ง**) ทำให้เข้าใจผิดคิดว่าในถังไม่มี Hydrocarbon เหลืออยู่แล้ว
2. ขาดกระบวนการในตรวจสอบเพื่อยืนยันชนิดของสารที่อยู่ถังให้แน่ชัด ก่อนที่จะเริ่มปฏิบัติงาน ทำให้นำมาซึ่งความผิดพลาดในการเลือกวิธีปฏิบัติงาน อุปกรณ์ที่ใช้ปฏิบัติงาน และมาตรการความปลอดภัยที่ใช้
3. เกิดไฟฟ้าสถิตจากการใช้สาย Hose PVC ซึ่งเป็น None-Conductive Material สูบล้างสาร Hydrocarbon ไวไฟ รวมถึงไม่ได้ทำ Bonding & Grounding สาย Hose ในขณะปฏิบัติงานด้วย
4. Hose และอุปกรณ์ของผู้รับเหมาที่นำมาใช้ ไม่ได้ผ่านการตรวจสอบจากโรงกลั่นก่อน แม้จะมีการกำหนดไว้ในสัญญาจ้างงานระหว่างโรงกลั่นกับบริษัทผู้รับเหมาก็ตาม
5. Operator ยังไม่ได้ทำการตรวจวัดแก๊สก่อนเริ่มงาน แต่ Lead Operator ได้กดรับรองในระบบ e-Work Permit ว่า Operator ออกไป On site check และตรวจวัดแก๊สให้แล้ว เพื่อให้ระบบ Issue เอกสาร Work permit ออกมาได้
6. Work permit ได้ถูกอนุมัติ ก่อนที่เอกสาร Risk Assessment ของงานดังกล่าว จะไม่ได้รับการตรวจสอบและอนุมัติจากผู้อำนวยการของบริษัท นอกจากนี้พนักงาน Operator ใช้เวลาเพียง 1 นาที เท่านั้น ในการ review เอกสาร Work permit ก่อนกดอนุมัติ



Safety Moment : Inadequate Isolation during Reactor Cleaning



Process Accident - Inadequate Isolation during Reactor Cleaning



Incident : ผู้รับเหมาทำงานซ่อมบำรุง Reactor A ทำการตัดแยกท่อเข้า Reactor ด้วย automatic On-Off valve ไม่ได้ใส่ slip plate เพราะพิจารณาว่าไม่มีงาน entry ไม่มีงาน welding ต่อมาผู้รับเหมาถูกสั่งให้ใช้ grinder ตัดท่อ drain line เพื่อติดตั้งอุปกรณ์ตรวจวิเคราะห์ใหม่ พบว่ามี Hydrocarbon vapor ประมาณ 7 kg รั่วผ่าน isolation valve จนเกิดไฟไหม้และระเบิดที่ Reactor A มีผู้เสียชีวิต 2 ราย

สาเหตุ : 1. มีการใช้ single valve Isolation กับ hydrocarbon แทนที่จะใช้ slip plate/ blind
2. ไม่มีกระบวนการทดสอบว่า isolation valve ปิดกันได้มีประสิทธิภาพ วาล์วอยู่ที่สูง
3. ประกายไฟจากการใช้ grinder

สิ่งที่ได้เรียนรู้

1. อย่าเชื่อมั่นว่าวาล์วทุกตัวจะปิดได้สนิท ตลอดเวลา
2. พิจารณาเลือกตัดแยกระบบ ด้วย Positive Isolation หรือ Physical disconnect
3. การ Isolate/ drain/ purge ต้องให้มั่นใจว่าไม่ลารหรือความดันหลงเหลือในระบบ ก่อนอนุมัติ permit to work

ภาคผนวก ข.5

ตัวอย่างฐานข้อมูลสุขภาพของพนักงาน (E-health Book)

Digital Healthcare System (DHCS)

Protect your health and get convenience for your health facilities.



HRA

Health Risk Assessment (HRA)



Health Book

Electronic Health Records (EHR)



Chatbot

Chat Health Tracking Guide (CHT)



Tele-doctor

Tele-Consult Doctor (TCD)



Analytic

Medical Analysis (MA)



SDS

Safety Data Sheet (SDS)



Analytics

Health Book

Electronic Health Records (EHR)



PTT Global Chemical Public Company Limited



Date 01.08.2023

ภาคผนวก ข.6

หลักเกณฑ์การพิจารณาห้องปฏิบัติการตรวจวัดคุณภาพสิ่งแวดล้อม

เอกสารแนบท้ายสัญญาหมายเลข 1



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

ข้อกำหนด

การติดตามตรวจสอบผลกระทบสิ่งแวดล้อม และจัดทำรายงานผลการปฏิบัติตาม
มาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบ
ผลกระทบสิ่งแวดล้อม ที่ระบุไว้ในรายงานการประเมินผลกระทบสิ่งแวดล้อม
(EIA Monitoring Report)
ประจำปี 2566 – 2568

สารบัญ

| | หน้า |
|---|------|
| 1. วัตถุประสงค์ | 3 |
| 2. ข้อกำหนดทั่วไปสำหรับการเสนอบริการ | 4 |
| 3. การจัดเตรียมข้อเสนอบริการ | 6 |
| 4. เงื่อนไขการพิจารณาจ้าง | 6 |
| 5. ระยะเวลาการดำเนินงาน | 7 |
| 6. หน้าที่ความรับผิดชอบในการดำเนินการของผู้เสนอบริการ | 7 |
| 7. ขอบเขตของงาน | 10 |
| 8. ข้อเสนอด้านราคา | 13 |

ข้อกำหนด

การติดตามตรวจสอบผลกระทบสิ่งแวดล้อม และจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกัน และแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม ที่ระบุไว้ในรายงานการประเมินผลกระทบสิ่งแวดล้อม (EIA Monitoring Report)

1. วัตถุประสงค์:

1.1 เพื่อตรวจสอบ ควบคุมคุณภาพและรวบรวมข้อมูลผลการดำเนินการตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมที่ระบุไว้ในรายงานการประเมินผลกระทบสิ่งแวดล้อม (EIA) ของแต่ละโครงการ และการปฏิบัติตามประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม เรื่อง หลักเกณฑ์ และวิธีการจัดทำรายงานผลการปฏิบัติตามมาตรการที่กำหนดไว้ในรายงานการประเมินผลกระทบสิ่งแวดล้อม ซึ่งผู้ดำเนินการหรือขออนุญาตจะต้องจัดทำเมื่อได้รับอนุญาตให้ดำเนินโครงการหรือกิจการ แล้ว พ.ศ. 2561 และ/หรือกฎหมาย แนวทาง ข้อกำหนดต่างๆ ที่เกี่ยวข้อง

1.2 เพื่อดำเนินการตรวจสอบ ตามมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมที่ระบุไว้ในรายงานการประเมินผลกระทบสิ่งแวดล้อม (EIA) ของแต่ละโครงการ

1.3 เพื่อจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมของแต่ละโครงการ ตามมาตรการที่ระบุไว้ในรายงานการประเมินผลกระทบสิ่งแวดล้อม (EIA) เสนอต่อหน่วยงานของรัฐซึ่งมีอำนาจอนุญาตตามกฎหมาย รวมถึงหน่วยงานราชการอื่น ภายในเวลาที่กำหนด

1.4 เพื่อจัดทำรายงานสรุปผลการตรวจวัดสุختาสตรอุตสาหกรรมของแต่ละโครงการ เสนอต่อหน่วยงานที่เกี่ยวข้อง

1.5 เพื่อดำเนินการตรวจวัดคุณภาพสิ่งแวดล้อม ตามรายการนอกเหนือจากที่ระบุไว้ในมาตรการฯ ซึ่งแต่ละโครงการได้ระบุไว้ พร้อมจัดทำรายงานสรุปผลการตรวจวัด

2. ข้อกำหนดทั่วไปสำหรับการเสนอบริการ:

2.1 ผู้เสนอบริการต้องศึกษาข้อกำหนดทั่วไป เงื่อนไข และขอบเขตงาน รวมทั้งกระบวนการควบคุมคุณภาพงานและความปลอดภัย ให้เข้าใจอย่างถี่ถ้วนก่อนยื่นข้อเสนอขอรับบริการ หากมีข้อสงสัยประการใด ให้ซักถามเพิ่มเติมได้ในช่วงเวลาหลังจากผู้เสนอบริการรับเอกสารข้อกำหนดจนถึงก่อนวันยื่นข้อเสนอให้บริการ เพื่อผู้เสนอบริการจะได้เข้าใจในเนื้อหาของงานและทราบขอบเขตงานก่อนยื่นข้อเสนอขอรับบริการ และเพื่อหลีกเลี่ยงความผิดพลาดของการยื่นข้อเสนอขอรับบริการ ความผิดพลาดในการวางแผนการปฏิบัติงาน และความล่าช้าในการให้บริการ และผู้เสนอบริการจะยกข้อเรียกร้อง หรือข้ออ้างนั้น โดยอาศัยเหตุผลที่มีได้ตรวจสอบเอกสารไม่ได้

2.2 ข้อกำหนด หรือเอกสารอื่นใดที่ได้ทำขึ้นเพื่อวัตถุประสงค์ในการเชิญชวนเสนอการนี้ ผู้เสนอบริการจะต้องไม่เปิดเผยข้อมูลใดๆ ที่อยู่ในเอกสารดังกล่าว หรือข้อมูลที่ให้แก่ผู้เสนอบริการโดยวิธีการอื่นใดที่เกี่ยวข้องกับการเชิญชวนเสนอการนี้ให้แก่บุคคลที่สาม เว้นแต่เพื่อเป็นการจัดเตรียมเอกสารข้อเสนอให้บริการของตนเท่านั้น ผู้เสนอบริการจะต้องเก็บรักษาข้อมูลเกี่ยวกับการเชิญชวนเสนอการและเอกสารเสนอให้บริการของตนไว้เป็นความลับตลอดระยะเวลาการพิจารณา ในกรณีที่มีการฝ่าฝืนข้อห้ามเกี่ยวกับการรักษาความลับดังกล่าว บริษัทฯ อาจปฏิเสธไม่รับข้อเสนอให้บริการนั้น บริษัทฯ สงวนสิทธิ์แต่ผู้เดียวในบรรดาข้อมูล แบบแปลนและในเอกสารอื่นๆ ทั้งหมดที่ส่งให้แก่ผู้เสนอบริการ

2.3 ข้อกำหนดฉบับนี้ มีจุดมุ่งหมายเพื่อใช้เป็นแนวทางในการดำเนินการเท่านั้น บริษัทฯ หรือตัวแทนของบริษัทฯ ไม่จำเป็นต้องรับผิดชอบต่อข้อร้องใดๆ หรือข้อมูลใดๆ ในเอกสารดังกล่าวเหล่านี้

2.4 ผู้เสนอบริการจำเป็นต้องเสนอค่าบริการ ค่าเก็บตัวอย่าง ค่าการตรวจวัดและการวิเคราะห์ผล โดยรวมเป็นค่าใช้จ่ายสำหรับแต่ละรายการตรวจวัด เป็นราคาต่อหน่วยตัวอย่าง และราคาต่อพารามิเตอร์ ตามที่บริษัทฯ ได้กำหนดไว้ รวมถึงระบุวิธีการตรวจวัดและวิเคราะห์ผล ที่ผู้เสนอบริการได้รับอนุญาตหรือขึ้นทะเบียนห้องปฏิบัติการต่อหน่วยงานราชการ ทั้งนี้งานบริการติดตามตรวจสอบคุณภาพสิ่งแวดล้อมจะคิดค่าใช้จ่ายที่เกิดขึ้นจริง รวมถึงค่าใช้จ่ายสำหรับการจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมของแต่ละโครงการ

2.5 ในกรณีที่ทางบริษัทฯ ได้แจ้งขอให้การตรวจวัดคุณภาพสิ่งแวดล้อมเพิ่มเติมจากที่ระบุไว้ในเอกสารแนบที่ 1 ทางผู้เสนอบริการจะต้องคิดค่าใช้จ่ายตามที่ได้อนุญาตไว้เป็นราคาต่อหน่วยตัวอย่าง และราคาต่อพารามิเตอร์ ตามหัวข้อ 2.4 เท่านั้น

2.6 การติดต่อ การรับรอง หรือการให้คำชี้แจงใดๆ ของพนักงานบริษัทฯ หรือตัวแทนของบริษัทฯ ไม่ว่าเป็นลายลักษณ์อักษรหรือด้วยวาจา ไม่ถือว่าผูกพันบริษัทฯ หรือตัวแทนของบริษัทฯ เว้นแต่จะได้มีคำชี้แจงเป็นลายลักษณ์อักษรจากบริษัทฯ ซึ่งได้ระบุเป็นการชัดแจ้ง

2.7 ผู้เสนอบริการพึงรับทราบว่าบริษัทฯ อาจจะทำคำแนะนำสำหรับผู้เสนอบริการ หรือภาคผนวกของข้อกำหนดเพิ่มเติมได้ในระหว่างระยะเวลาการยื่นข้อเสนอบริการได้และโดยที่ไม่เป็นการกระทบถึงลำดับแห่งเอกสารทั่วไป ให้บทบัญญัติในเอกสารที่ออกเพิ่มเติมอยู่ในลำดับที่เหนือกว่าข้อกำหนดที่ได้ออกไปก่อนหน้านี้

2.8 ผู้เสนอบริการพึงรับทราบว่า ผู้เสนอบริการอาจมีความจำเป็นที่จะต้องมาทำการปรึกษาหารือ หรือชี้แจงในบางประการเกี่ยวกับเอกสารข้อเสนอบริการ ทั้งนี้ เนื้อความในเอกสารข้อเสนอบริการใดๆ หรือข้อแก้ไข หรือข้อชี้แจงใดๆ ให้ผู้เสนอบริการยื่นเอกสารเป็นลายลักษณ์อักษร โดยระบุเป็นการชัดแจ้งว่าให้ถือเป็นส่วนหนึ่งของเอกสารข้อเสนอบริการ ทั้งนี้ไม่ว่าจะมีการร้องขอก่อนหรือหลังการยื่นเอกสารเพิ่มเติม จะถือเป็นส่วนหนึ่งของเอกสารข้อเสนอบริการ และไม่ว่าเอกสารที่เพิ่มเติมนั้นจะเป็นเอกสารเพิ่มเติมหรือเป็นฉบับแก้ไขใหม่ก็ตาม

2.9 ผู้เสนอบริการพึงรับทราบถึงนโยบายบริษัทฯ เกี่ยวกับการประเมินเอกสารข้อเสนอบริการทั้งด้านเทคนิคและราคา เพื่อพิจารณาตรวจสอบความถูกต้อง และความเป็นไปตามข้อกำหนดของบริษัทฯ และเป็นไปตามรายละเอียดคุณลักษณะเฉพาะ (Specification) หรือไม่ โดยผู้เสนอบริการที่เสนอเอกสารข้อเสนอที่ถูกต้องและเป็นไปตามข้อกำหนด จึงจะมีสิทธิที่เข้าร่วมเสนอราคา

2.10 ผู้เสนอบริการจะต้องตรวจสอบและรับผิดชอบในความถูกต้องของข้อมูล โดยรวมถึงความถูกต้องด้านงานพิมพ์ รูปภาพและสัญลักษณ์ต่างๆ ให้ถูกต้องชัดเจน

2.11 ผู้เสนอบริการพึงรับทราบว่าการทำงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม ของแต่ละโครงการอาจจะเริ่มดำเนินการในระยะเวลาที่แตกต่างกันออกไป โดยจะต้องเสนอรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมให้แก่ หน่วยงานของรัฐซึ่งมีอำนาจอนุญาตตามกฎหมาย รวมถึงหน่วยงานราชการอื่น ภายในวันที่ 31 กรกฎาคม และ 31 มกราคม ในปีถัดไป ดังนั้นผู้เสนอบริการจะต้องประสานงานกับบริษัทฯ อย่างใกล้ชิดและต่อเนื่อง เพื่อติดตามผลการดำเนินงานและรายงานผลให้บริษัทฯ ทราบอย่างต่อเนื่อง

3. การจัดเตรียมข้อเสนอบริการ:

ผู้เสนอบริการพึงรับทราบว่าการจัดเตรียมข้อเสนอบริการการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม และจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม โดยขอบเขตงานในครั้งนี้จะต้องพิจารณาให้ครอบคลุมมาตรการต่างๆ ในความรับผิดชอบของแต่ละโครงการ โดยมีเนื้อหาสาระถูกต้อง ครบถ้วนและสมบูรณ์

ทั้งนี้การจัดทำข้อเสนอบริการให้จัดทำข้อเสนอด้านเทคนิคและด้านราคา พร้อมเสนอรายละเอียดของการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมในลักษณะของราคาต่อหน่วย และราคาต่อพารามิเตอร์ เพื่อประกอบการพิจารณาในรายละเอียด

ในกรณีที่ไม่ได้มีการเดินเครื่องหรือไม่มีความพร้อมในการตรวจวัดคุณภาพสิ่งแวดล้อม บริษัทฯ สงวนสิทธิ์ในการไม่ดำเนินการตรวจวัดตามรายการหรือแผนงานที่ได้รับไว้ ทั้งนี้จะได้มีการแจ้งให้ทราบล่วงหน้าในแต่ละกรณี

4. เงื่อนไขการพิจารณาจ้าง:

4.1 บริษัทฯ ขอสงวนสิทธิ์ในการพิจารณาจ้างงาน เฉพาะส่วนใดส่วนหนึ่งเพียงบางส่วน หรือทั้งหมดของขอบเขตงานได้

4.2 การดำเนินการตรวจวัดคุณภาพสิ่งแวดล้อมและการจัดทำรายงานฯ ต้องดำเนินการโดยบุคลากรที่มีคุณสมบัติตามที่กำหนด มีความสามารถและประสบการณ์เหมาะสมกับลักษณะงานที่ปฏิบัติ และใช้วัสดุอุปกรณ์อย่างดี ที่ผ่านการสอบเทียบให้ผลถูกต้องและเชื่อถือได้ มีคุณสมบัติหรือวิธีการตรวจวัดตามรายละเอียดและเงื่อนไขของบริษัทฯ

4.3 บริษัทฯ สงวนไว้ซึ่งสิทธิ์ที่จะทำการต่อรองราคากับผู้เสนอบริการ เพื่อให้มีการลดราคาลงตามที่เห็นว่าจำเป็นในอันที่จะให้ราคาอยู่ในวงเงินที่เหมาะสม

5. ระยะเวลาการดำเนินงาน:

การดำเนินการตรวจสอบคุณภาพสิ่งแวดล้อม และจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อมตามที่ระบุในข้อกำหนดฉบับนี้ มีระยะเวลาการว่าจ้างรวม 3 ปี โดยเริ่มนับตั้งแต่วันที่ 1 มกราคม พ.ศ. 2566 ถึง 28 กุมภาพันธ์ 2569 ซึ่งรวมระยะเวลาในการจัดทำรายงานผลการปฏิบัติตามมาตรการฯ ระหว่างเดือนกรกฎาคม ถึง เดือนธันวาคม ของปี 2568

6. หน้าที่ความรับผิดชอบในการดำเนินการของผู้เสนอบริการ

6.1 ผู้เสนอบริการจะต้องจัดส่งแผนการปฏิบัติงานในภาพรวมและระยะเวลาดำเนินการของแต่ละโครงการ ตั้งแต่เริ่มต้นการจัดเตรียมแผนงาน จนกระทั่งได้เสนอรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม ให้หน่วยงานของรัฐซึ่งมีอำนาจอนุญาตตามกฎหมาย รวมถึงหน่วยงานราชการอื่น โดยจัดส่งให้บริษัทฯ ในวันประชุมเริ่มงาน (Kick-off meeting) ทั้งนี้ให้เสนอแผนงานเบื้องต้นให้บริษัทฯ พิจารณาพร้อมกับข้อเสนอทางเทคนิค

6.2 ผู้เสนอบริการจะต้องดำเนินการตรวจสอบและส่งผลการตรวจสอบผลกระทบสิ่งแวดล้อม รวมถึงเข้าทวนสอบ (Audit) ผลการปฏิบัติตามมาตรการฯ ของแต่ละโครงการที่รับผิดชอบ ตามขอบเขตงานที่กำหนดในไว้ทุกรายการ ให้แล้วเสร็จภายในเดือนมิถุนายน และ เดือนธันวาคมของปีที่ทำเนิการ (ยกเว้นกรณีที่โรงงานไม่สามารถให้เข้าดำเนินการตรวจวัดได้ ซึ่งจะต้องมีการปรับเปลี่ยนช่วงเวลาดำเนินการ)

6.3 ผู้เสนอบริการจะต้องมีการบันทึกและรายงานลักษณะของกิจกรรมต่างๆ ที่เกิดขึ้นบริเวณโดยรอบจุดเก็บตัวอย่างน้ำ จุดตรวจวัดคุณภาพอากาศ และระดับเสียง ขณะทำการเก็บตัวอย่างหรือตรวจวัด รวมถึงลักษณะของตัวอย่างน้ำที่เก็บ

6.4 ผู้เสนอบริการจะต้องจัดทำรายงานผลการปฏิบัติตามมาตรการฯ ตามแนวทางการเสนอรายงานฯ ที่ สม. กำหนด โดยมีขอบเขตงานที่กำหนดในไว้ข้อ 7. จัดส่งให้บริษัทฯ โดยปฏิบัติตามตารางเวลาการจัดทำรายงาน ดังตารางที่ 1 หรือตามที่ได้ตกลงร่วมกับโครงการ

6.5 ผู้เสนอบริการมีหน้าที่จัดทำรายงานผลการปฏิบัติตามมาตรการฯ เพื่อให้บริษัทฯ นำเสนอรายงานต่อหน่วยงานของรัฐซึ่งมีอำนาจอนุญาตตามกฎหมาย รวมถึงหน่วยงานราชการอื่น ทั้งนี้ต้องรายงานความก้าวหน้าของการดำเนินการ ให้บริษัทฯ ทราบอย่างน้อยทุกๆ 3 เดือน หรือตามที่บริษัทฯ มีการร้องขอ

6.6 ผู้เสนอบริการจะต้องเข้าติดตามทวนสอบ (Audit) มาตรการฯ ปีละ 2 ครั้ง ภายในช่วงเดือนเมษายน – พฤษภาคม และเดือนตุลาคม – พฤศจิกายน หรือตามที่ตกลงร่วมกับโครงการ ตามรอบการจัดทำรายงานผลการปฏิบัติตามมาตรการฯ

6.7 ถือเป็นความรับผิดชอบของผู้เสนอบริการ ร่วมกับบริษัทฯ ในการจัดทำรายงานผลการปฏิบัติตามมาตรการฯ และนำเสนอรายงานต่อหน่วยงานของรัฐตามที่กฎหมายกำหนด ให้ได้ภายในวันที่ 31 กรกฎาคม และ 31 มกราคม ของปีถัดไป พร้อมเก็บสำเนาหลักฐานการส่งรายงาน และนำเสนอให้บริษัทฯ พร้อมเล่มรายงานตามที่ระบุ รวมถึงการนำรายงานฯ เข้าสู่ระบบ SMART EIA ของ สม.

6.8 การให้คำปรึกษา ให้คำแนะนำ ตลอดจนเสนอแนะแนวทางการปฏิบัติตามมาตรการด้านสิ่งแวดล้อมและให้เป็นไปตามกฎหมายและข้อกำหนดต่างๆ ที่เกี่ยวข้องให้ครบถ้วน

6.9 นำส่งผลการตรวจวัดคุณภาพสิ่งแวดล้อมตามรายการที่กำหนด ภายใน 14 วันนับจากวันที่ทำการเก็บตัวอย่างแล้วเสร็จ หรือตามระยะเวลาที่ตกลงร่วมกัน พร้อมแนบภาพถ่ายประกอบการเก็บตัวอย่าง ข้อมูลเบื้องต้นและใบรับรองผลการสอบเทียบของอุปกรณ์การตรวจวัดผ่านทางสื่ออิเล็กทรอนิกส์ (E-mail)

6.10 อื่นๆ ตามที่ได้มีการตกลงร่วมกันระหว่างบริษัทฯ และผู้เสนอบริการ

ตารางที่ 1 กำหนดระยะเวลาการจัดส่งรายงาน

| ลำดับ | รายงานผลการปฏิบัติตามมาตรการตามรายงาน EIA | จำนวนรายงาน * | ส่งรายงาน * |
|-------|--|------------------------------------|---|
| 1 | ร่างรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขของแต่ ละโครงการ นำเสนอ GC และบริษัทในกลุ่ม ตรวจสอบรายงาน | E-file / hard copy (ตามที่ตกลง) | ภายในวันที่ 15 พฤษภาคม และ 15 พฤศจิกายน |
| 2 | GC และบริษัทในกลุ่มแจ้งผลการตรวจสอบร่างรายงานผลการ ปฏิบัติตามมาตรการฯ (Draft Report) เพื่อปรับปรุงแก้ไข | - | ภายในวันที่ 1 มิถุนายน และ 1 ธันวาคม |
| 3 | ร่างรายงานผลการปฏิบัติตามมาตรการฯ ฉบับสมบูรณ์ (Draft Final Report) ของแต่ละโครงการ นำเสนอ GC และบริษัทในกลุ่ม ตรวจสอบรายงาน | E-file / hard copy (ตามที่ตกลง) | ภายในวันที่ 20 มิถุนายน และ 20 ธันวาคม |
| 4 | GC และบริษัทในกลุ่ม แจ้งผลการตรวจสอบร่างรายงานผลการ ปฏิบัติตามมาตรการฯ ฉบับสมบูรณ์ (Draft Final Report) เพื่อ ปรับปรุงแก้ไขและจัดทำรายงานผลการปฏิบัติตามมาตรการฯ ฉบับ สมบูรณ์ (Final Report) | - | ภายในวันที่ 1 กรกฎาคม และ 3 มกราคม |
| 5 | จัดทำรายงานฯ ฉบับสมบูรณ์ สำหรับเสนอให้ผู้ที่เกี่ยวข้องลงนาม | 1 ชุด | ภายในวันที่ 15 กรกฎาคม และ 15 มกราคม |
| 6 | จัดทำรายงานฯ ฉบับสมบูรณ์ (Final Report) พร้อมซีดีรอม และ นำส่งรายงานราชการที่เกี่ยวข้อง ** (ซีดีรอมบันทึกรายงานในรูปแบบ pdf file จำนวน 9 แผ่น และ pdf file + soft file (ทั้ง word file และ Excel file) จำนวน 2 แผ่น) | 5 ชุด (ขึ้นกับแต่ละโครงการ) | ภายในวันที่ 31 กรกฎาคม และ 31 มกราคม |
| 7 | รายงานผลการตรวจวัดคุณภาพสิ่งแวดล้อม (ฉบับรวมผลการ ตรวจวัดทุกรายงาน) พร้อมซีดีรอม นำส่งให้ GC และบริษัทในกลุ่ม (ซีดีรอมบันทึกรายงาน pdf file + doc file จำนวน 2 ชุด) | 2 ชุด | ภายในวันที่ 30 สิงหาคม และ 28 กุมภาพันธ์ |
| 8 | รายงานผลการตรวจวัดสุขศาสตร์อุตสาหกรรม (Industrial Hygiene) พร้อมซีดีรอม นำส่งให้ GC และบริษัทในกลุ่ม (ซีดีรอม บันทึกรายงาน pdf file + doc file จำนวน 2 ชุด) | 2 ชุด (ต่อครั้งการตรวจวัด) | ภายใน 30 วัน นับจากวันที่ ตรวจวัดเสร็จสิ้น |

หมายเหตุ:

- * ระยะเวลาและจำนวนเล่มรายงานอาจมีการปรับเปลี่ยนตามความเหมาะสมและขึ้นกับการตกลง
ร่วมกันของแต่ละโครงการ
- ** เก็บสำเนาหลักฐานการส่งรายงาน และนำส่งให้บริษัทฯ พร้อมเล่มรายงานตามที่ระบุ
- กรณีที่รายงานฉบับสมบูรณ์ไม่สามารถนำส่งได้ตามกำหนดอันเนื่องมาจากทางโครงการนั้น การ
จัดทำรายงานฯ ฉบับรวม ผลการตรวจวัดทุกรายการ จะนำส่งภายใน 10 วัน นับจากวันที่จัดส่ง
รายงานฉบับสมบูรณ์

7. ขอบเขตของงาน:

รายละเอียดสำหรับผู้เสนอรับจ้าง เพื่อประกอบการจัดทำข้อเสนอรับจ้างบริการตามมาตรการ
ป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม พร้อมจัดทำ
รายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตาม
ตรวจสอบผลกระทบสิ่งแวดล้อม โดยมีขอบเขตดังนี้

7.1 โครงการที่ต้องดำเนินการ

โครงการที่ต้องดำเนินการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม มีจำนวน 22 โครงการ แบ่งเป็น 2
กลุ่มคือ กลุ่มที่ 1 เป็นโครงการที่ต้องดำเนินการตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
และมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม พร้อมจัดทำรายงานผลการปฏิบัติตามมาตรการฯ
จำนวน 21 โครงการ ประกอบด้วย โครงการของบริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) จำนวน
16 โครงการ (อ้างถึงตารางที่ 2 ลำดับที่ 1-16) และโครงการของบริษัทในกลุ่มของบริษัท พีทีที โกล
บอล เคมิคอล จำกัด จำนวน 5 โครงการ (อ้างถึงตารางที่ 2 ลำดับที่ 17-21) และกลุ่มที่ 2 เป็น
โครงการที่ไม่เข้าข่ายต้องจัดทำรายงานการประเมินผลกระทบสิ่งแวดล้อม จำนวน 1 โครงการ (อ้างถึง
ตารางที่ 2 ลำดับที่ 22)

ทั้งนี้ รายการตรวจวัดต่างๆ ของแต่ละโครงการสามารถสรุปได้ดังเอกสารแนบที่ 1 โดยอาจมีการ
เปลี่ยนแปลงได้ขึ้นอยู่กับความเหมาะสมของสภาวะการดำเนินโครงการ ณ ขณะนั้น รวมถึงในกรณีที่มีการ
เห็นชอบในรายงานการประเมินผลกระทบสิ่งแวดล้อม (EIA) ฉบับใหม่ และผู้เสนอรับจ้างจะต้องสามารถ
ดำเนินการตรวจวัดคุณภาพสิ่งแวดล้อมได้ทุกพารามิเตอร์

ตารางที่ 2 โครงการที่ต้องดำเนินการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม

| กลุ่มที่ 1 : โครงการที่ต้องดำเนินการตามมาตรการในรายงานการประเมินผลกระทบสิ่งแวดล้อม (EIA Report) | |
|---|--|
| 1. โครงการโรงงานผลิตสารโพลีเอทิลีน | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 2 |
| 2. โครงการโรงไฟฟ้า (Power Plant) | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 2 |
| 3. โครงการผลิตโพลีเอทิลีน (HDPE) | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 2 |
| 4. โครงการโรงงานผลิตสารโพลีเอทิลีน | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 3 |
| 5. โครงการโรงงานอะโรเมติกส์ หน่วยที่ 1 | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 4 |
| 6. โครงการโรงงานอะโรเมติกส์ หน่วยที่ 2 | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 5 |
| 7. โครงการโรงกลั่นน้ำมัน | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 6 |
| 8. โครงการทำแท็บเล็ต | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 6 |
| 9. โครงการทำแท็บเล็ตและคลังผลิตภัณฑ์ | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 7 |
| 10. โครงการโรงงานอินทเนครเกอร์ | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 11 |
| 11. โครงการโรงงานแอลดีพี | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 11 |
| 12. โครงการโรงงานแอลแอลดีพี | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 11 |
| 13. โครงการผลิตเม็ดพลาสติกชนิดความหนาแน่นสูง | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 12 |
| 14. โครงการโรงงานผลิตเอทิลีนออกไซด์และเอทิลีนไกลคอล | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 16 (บริษัท จีซี โกลบอล จำกัด (เดิม)) |
| 15. โครงการโรงงานผลิตสารเอทานอลเอมีน | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 16 (บริษัท จีซี โกลบอล จำกัด (เดิม)) |
| 16. โครงการผลิตเม็ดพลาสติกชนิดโพลีคาร์บอเนต | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 17 (บริษัท จีซี สโตร์นิคส์ จำกัด (เดิม)) |
| 17. โครงการโรงงานผลิตสารฟีนอล | บริษัท พีทีที ฟีนอล จำกัด * |
| 18. โครงการโรงงานผลิตสารบิสฟีนอล เอ | บริษัท พีทีที ฟีนอล จำกัด * |
| 19. โครงการโรงงานผลิตโพรพิลีนออกไซด์ | บริษัท จีซี ออกซิเจน จำกัด * |
| 20. โครงการโรงงานผลิตโพลีเอทิลีน | บริษัท จีซี โพลีเอทิลีน จำกัด |
| 21. โครงการโรงงานผลิตเม็ดพลาสติกเทอร์และพลาสติค | บริษัท โกลบอลกรีนเคมิคอล จำกัด (มหาชน) สาขา 1 |
| กลุ่มที่ 2 : โครงการที่ไม่เข้าข่ายต้องจัดทำรายงานการประเมินผลกระทบสิ่งแวดล้อม (EIA Report) | |
| 22. โครงการโรงงานผลิตเมทิลเอสเทอร์ หน่วยที่ 2 | บริษัท โกลบอลกรีนเคมิคอล จำกัด (มหาชน) สาขา 3 |

หมายเหตุ : * จะมีการโอนสิทธิและหน้าที่ เมื่อเปลี่ยนชื่อบริษัทเป็นบริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

7.2 การดำเนินงานตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม

7.2.1 การดำเนินงานทวนสอบ (Audit) การปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมการดำเนินงานตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม

จัดทำแผนและเข้าดำเนินการตรวจสอบการปฏิบัติตามมาตรการฯ (Audit) ของแต่ละโครงการ ตามรายละเอียดที่กำหนด ทั้งในทางติดตามเอกสาร การสอบถามหน่วยงานที่เกี่ยวข้อง หรือหลักฐานประกอบอื่น เช่น รูปถ่าย เป็นต้น และจัดทำสรุปผลการปฏิบัติตามมาตรการฯ โดยให้ดำเนินการให้แล้วเสร็จภายในเดือนพฤษภาคม และ เดือนพฤศจิกายนของปีที่ผ่านมา (ยกเว้นกรณีที่ไม่สามารถให้เข้าดำเนินการได้ ซึ่งจะต้องมีการปรับเปลี่ยนช่วงเวลาดำเนินการ)

7.2.2 การดำเนินงานตามมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม

จัดทำแผนและเข้าดำเนินการตรวจติดตามตรวจสอบคุณภาพสิ่งแวดล้อมของโครงการ ตามที่มาตรการฯ กำหนด รวมถึงดำเนินการตรวจวัดพารามิเตอร์อื่น ที่นอกเหนือจากมาตรการฯ

1) วิธีการตรวจติดตามตรวจสอบคุณภาพสิ่งแวดล้อมจะดำเนินการให้เป็นไปตามที่รายงานการประเมินผลกระทบสิ่งแวดล้อมกำหนด หรือเป็นวิธีที่เป็นที่ยอมรับระดับสากล (เช่น U.S. EPA เป็นต้น) หรือตามที่กฎหมายได้ระบุไว้

2) ดำเนินการบันทึกพิกัดของจุดเก็บตัวอย่าง/จุดตรวจวัดต่างๆ รายงานลักษณะของกิจกรรมต่างๆ ที่เกิดขึ้นและสภาพโดยรอบบริเวณจุดตรวจวัดคุณภาพอากาศ และระดับความดังเสียง ขณะทำการตรวจวัด รวมถึงลักษณะของตัวอย่างคุณภาพน้ำที่เก็บมาวิเคราะห์

7.2.3 การจัดทำรายงาน

1) การจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม (ตามมาตรการฯ ในรายงาน EIA) : เพื่อนำเสนอต่อหน่วยงานของรัฐซึ่งมีอำนาจอนุญาตตามกฎหมาย รวมถึงหน่วยงานราชการอื่น โดยจะครอบคลุมถึงการดำเนินงานทั้งระยะก่อสร้าง (ถ้ามี) และระยะดำเนินการของโครงการ ซึ่งไม่รวมถึงรายการตรวจวัดที่นอกเหนือจากมาตรการฯ กำหนด ทั้งนี้อาจมีการเปลี่ยนแปลงได้ขึ้นอยู่กับสถานะของโครงการขณะนั้น และรูปแบบการจัดทำรายงานจะต้องเป็นไปตามแนวทางที่ สม. กำหนด

2) การจัดทำรายงานผลการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม : เพื่อนำเสนอต่อโครงการ โดยเป็นรายการตรวจติดตาม ทั้งที่กำหนดในมาตรการฯ และไม่ได้กำหนดในมาตรการฯ ทุกรายการ พร้อมแสดงกราฟย้อนหลัง 3 ปี

3) การจัดทำรายงานผลการตรวจวัดสุขศาสตร์อุตสาหกรรม : เพื่อนำเสนอต่อโครงการ โดยเป็นรายการตรวจติดตามตรวจสอบคุณภาพสิ่งแวดล้อม ด้านสุขศาสตร์อุตสาหกรรม (Industrial Hygiene) ที่ทำการตรวจวัดทุกๆ ไตรมาส โดยนำเสนอรายงานฉบับสมบูรณ์ให้แก่โครงการภายใน 30 วัน นับจากวันที่ตรวจวัดแล้วเสร็จ ในเดือนมีนาคม เดือนมิถุนายน เดือนกันยายน และเดือนธันวาคม หรือที่โครงการระบุความถี่ได้ ทั้งนี้จะแสดงผลการตรวจวัดและกราฟย้อนหลัง 3 ปี ทุกรายการ ยกเว้นผลการตรวจวัดแสงสว่างในสถานที่ทำงาน จะรายงานผลเป็นครั้งๆ ในรอบการตรวจวัดนั้นๆ และจัดทำเป็นแผนผังแสดงจุดตรวจวัดประกอบรายงานผลการตรวจวัดแสงสว่าง ทั้งนี้ให้เป็นไปตามที่ตกลงร่วมกันสำหรับแต่ละโครงการ

4) การจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อมและมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม สำหรับโครงการที่ตั้งอยู่ในนิคมอุตสาหกรรมดับบลิวเอชเอตะวันออก (มาบตาพุด) : โดยนำเสนอต่อสำนักงานนิคมฯ สำหรับโครงการที่ตั้งอยู่ในพื้นที่ตามที่มีการกำหนดมา ได้แก่ โครงการลำดับที่ 14, 15, 17, 18, 19, 20 และ 21 โดยรูปแบบการจัดทำรายงานให้เป็นไปตามที่สำนักงานนิคมฯ กำหนด

5) การจัดทำรายงานตรวจสอบการปฏิบัติตามมาตรการด้านสิ่งแวดล้อม (Environmental Compliance Audit Report) : ดำเนินการ ปีละ 1 ครั้ง สำหรับโครงการที่จะต้องดำเนินการตามที่กำหนดในมาตรการฯ ของโครงการลำดับที่ 14 หรือโครงการอื่นๆ ที่อาจถูกกำหนดในมาตรการฯ ในอนาคต หรือตามที่โครงการร้องขอออกเนื่องจากข้างต้น ซึ่งจะคิดค่าใช้จ่ายเพิ่มเติมนอกเหนือจากข้อเสนองานครั้งนี้

รายละเอียดรายงานแต่ละประเภทที่ต้องจัดทำของแต่ละโครงการแสดงดังตารางที่ 3

8. ข้อเสนอด้านราคา

ให้ผู้เสนอบริการเสนอค่าใช้จ่ายที่เกิดขึ้นโดยให้เสนอค่าบริการ ค่าเก็บตัวอย่าง ค่าการตรวจวัด และการวิเคราะห์ตัวอย่าง รวมเป็นค่าใช้จ่ายสำหรับแต่ละรายการตรวจวัด เป็นราคาต่อหน่วยตัวอย่าง และราคาต่อพารามิเตอร์ ซึ่งการตรวจวัดพารามิเตอร์เดียวกันด้วยวิธีเดียวกันจะต้องมีราคาต่อหน่วยที่เท่ากันในทุกๆ โครงการ

ตารางที่ 3 สรุปรายงานที่ต้องจัดทำแต่ละโครงการ จำนวน 22 โครงการ

| No. | Project | EIA MTR | EIA MTR (WHA) | ENV Audit | ENV | IH |
|-----|------------------------|---------|---------------|-----------|-----|----|
| 1 | GC2 – Olefins 1 | ✓ | | | ✓ | ✓ |
| 2 | GC2 – Power Plant | ✓ | | | ✓ | ✓ |
| 3 | GC2 – HDPE 2 | ✓ | | | ✓ | ✓ |
| 4 | GC3 – Olefins 2 | ✓ | | | ✓ | ✓ |
| 5 | GC4 – Aromatics I | ✓ | | | ✓ | ✓ |
| 6 | GC5 – Aromatics II | ✓ | | | ✓ | ✓ |
| 7 | GC6 – Refinery | ✓ | | | ✓ | ✓ |
| 8 | GC6 – Jetty | ✓ | | | ✓ | ✓ |
| 9 | GC7 – BTF & Jetty | ✓ | | | ✓ | ✓ |
| 10 | GC11 – Olefins 3 | ✓ | | | ✓ | ✓ |
| | GC11 – WH | | | | | ✓ |
| 11 | GC11 – LPDE | ✓ | | | ✓ | ✓ |
| 12 | GC11 – LLDPE | ✓ | | | ✓ | ✓ |
| 13 | GC12 – HDPE 1 | ✓ | | | ✓ | ✓ |
| 14 | GC16 – EOG (GC Glycol) | ✓ | ✓ | ✓ | ✓ | ✓ |
| 15 | GC16 – EA (GC Glycol) | ✓ | ✓ | | ✓ | ✓ |
| 16 | GC17 – PS | ✓ | | | ✓ | ✓ |
| 17 | PPCL – Phenol | ✓ | ✓ | | ✓ | ✓ |
| 18 | PPCL – BPA | ✓ | ✓ | | ✓ | ✓ |
| 19 | GCO – PO | ✓ | ✓ | | ✓ | ✓ |
| 20 | GCP – Polyols | ✓ | ✓ | | ✓ | ✓ |
| 21 | GGC1 | ✓ | ✓ | | ✓ | ✓ |
| 22 | GGC2 | ✓ | | | | ✓ |

หมายเหตุ 1. รายงาน EIA Monitoring ในแต่ละรอบการตรวจวัดจะเป็นการรายงานผลกระทบก่อสร้างและ/หรือระยะดำเนินการในรายงานฉบับเดียวกัน ขึ้นกับรายงานการประเมินผลกระทบสิ่งแวดล้อมของโครงการฉบับปัจจุบันที่โครงการยึดถือและสถานะของโครงการขณะนั้น

ภาคผนวก ข.7

แผนการเดินทางเครื่องและซ่อมบำรุงเตาของโรงที่ 2/2

แผนงานเดินเครื่องเตาเผาแตกโมเลกุลของหน่วยผลิต I-4/2

เดือนกรกฎาคม 2567

| | Jul-24 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|----------------|--------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-----|------|------|------|------|------|------|------|------|------|
| As of 18Jul24 | 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
| F-3101 | C29 | C30 | C31 | C32 | D/C | D/C | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | C1 | C2 | C3 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 |
| F-3102 | C31 | D/C | D/C | C/M | C1 | C2 | C3 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 | C12 | C13 | C14 | C15 | C16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 |
| F-3103 | C10 | C11 | C12 | C13 | C14 | C15 | C16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 | C28 | C29 | D/C | D/C | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | C/D |
| F-3104 | D/C | C1 | C2 | C3 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 | C12 | C13 | C14 | C15 | C16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 | C28 | C29 | C30 |
| F-3105 | HSSB | HSSB | HSSB | HSSB | HSSB | HSSB | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | S/D | P/M | P/M | P/M | P/M | P/M | P/M | P/M | P/M | P/M | P/M |
| F-3106 | C70 | C71 | C72 | C73 | C74 | C75 | C76 | C77 | C78 | C79 | C80 | C81 | C82 | C83 | C84 | C85 | C86 | C87 | C88 | C89 | C90 | C91 | C92 | C93 | C94 | C95 | C96 | C97 | C98 | C99 | C100 |
| Feedstock plan | 2+60 | | | | | | | | | | 3+58 | | | | | | | | | | 3+57 | | | | | | | | | | |
| Ethane mode | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Co-crack mode | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 3 |
| MHO to Q-1515 | 108 | | | 108 | | | | | | | | | | | | | | | | | 108 | | | | | | | | | | |

•F-3105 มี Plan เข้า P/M วันที่ 23 Jul 2024 เป็นต้นไป (Radiant Coil Replacement, Cross-over Line Replacement, Clean Convection Coil)

แผนงานเดินเครื่องเตาเผาแตกโมเลกุลของหน่วยผลิต I-4/2 (ต่อ)

| As of 9Sep24 | Sep-24 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|----------------|-----------|-----|-----|-----|-----|-----|----------|------|----------|-----|----------|-----|-----|-----|-----|-----|---------|-----|-----|-----|-----|-----|------|-----|-----|-----|-----|-----|-----|-----|-----|
| | 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | |
| | F-3101 | C2 | C3 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 | C12 | C13 | C14 | C15 | C16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 | C28 | C29 | D/C | D/C |
| | F-3102 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | E9 | E10 | E11 | E12 | E13 | E14 | E15 | E16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 | D/C | D/C | C1 | C2 |
| | F-3103 | E1 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | E9 | HSSB | D/C | D/C | P/L | P/L | P/L | P/L | P/L | P/L | P/L | P/L | P/L | HSSB | C1 | C2 | C3 | C4 | C5 | C6 | C7 | C8 |
| | F-3104 | E1 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | E9 | E10 | E11 | E12 | E13 | E14 | E15 | E16 | E17 | E18 | E19 | E20 | E21 | E22 | E23 | E24 | E25 | E26 | E27 | E28 | E29 | E30 |
| | F-3105 | P/L | P/L | P/L | P/L | E1 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | E9 | E10 | E11 | C12 | C13 | C14 | C15 | C16 | C17 | C18 | D/C | D/C | C1 | C2 | C3 | C4 | C5 | C6 |
| F-3106 | P/M | P/M | P/M | P/M | P/M | P/M | P/M | HSSB | HSSB | E1 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | E9 | E10 | E11 | E12 | E13 | E14 | E15 | D/C | D/C | E1 | E2 | E3 | E4 | |
| Feedstock plan | E40+LPG15 | | | | | | E55+LPG5 | | E60+LPG3 | | E62+LPG3 | | | | | | E25+P45 | | | | | | | | | | | | | | |
| Ethane mode | 3 | 3 | 3 | 3 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 1 | 1 | 2 | 2 | 2 | 2 | |
| Co-crack mode | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 4 | 4 | 3 | 3 | 3 | 3 | |
| MHO to O-1515 | | | | | | | | | | | 108 | | | | | | | | | | | | | 108 | | 108 | | 108 | | 108 | |

| As of 28Oct24 | Oct-24 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|----------------|---------|-----|-----|-----|-----|-----|-----|-----|-----|------|-----|-----|-----|-----|------|---------|-----|-----|-----|-----|-----|-----|------|-----|-----|-----|------|-----|-----|-----|-----|--|--|
| F-3101 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | E9 | E10 | E11 | E12 | E13 | E14 | E15 | E16 | E17 | E18 | E19 | E20 | E21 | E22 | E23 | E24 | D/C | D/C | P/L | HSSB | E1 | E2 | E3 | E4 | | |
| F-3102 | E9 | E10 | E11 | E12 | E13 | E14 | E15 | E16 | E17 | E18 | D/C | D/C | P/L | P/L | HSSB | C1 | C2 | C3 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 | C12 | C13 | C14 | C15 | C16 | | |
| F-3103 | C14 | C15 | C16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 | C28 | D/C | D/C | P/L | P/L | P/L | P/L | P/L | HSSB | E1 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | | |
| F-3104 | C32 | D/C | D/C | P/L | P/L | P/L | P/L | P/L | P/L | HSSB | E1 | E2 | E3 | E4 | E5 | E6 | E7 | E8 | E9 | E10 | E11 | E12 | E13 | E14 | E15 | E16 | E17 | D/C | D/C | P/L | P/L | | |
| F-3105 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 | C12 | C13 | C14 | C15 | C16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 | C28 | C29 | C30 | C31 | C32 | C33 | C34 | | |
| F-3106 | D/C | C1 | C2 | C3 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 | C12 | C13 | C14 | C15 | C16 | C17 | C18 | C19 | C20 | C21 | C22 | C23 | C24 | C25 | C26 | C27 | C28 | C29 | C30 | | |
| Feedstock plan | E25+P45 | | | | | | | | | | | | | | | 30E+P45 | | | | | | | | | | | | | | | | | |
| Ethane mode | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | | |
| Co-crack mode | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | |
| MHO to O-1515 | 108 | | | | | | | | | | | 108 | | | | 108 | | | | | | | | 108 | | | | 108 | | | | | |

ภาคผนวก ข.8

WI การใช้เตาถ้ำรอง (F-3106)



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

Plant Operation II

W-(O-P2-OP2)-742

วิธีปฏิบัติงานการ FEED IN, FEED OFF F-3106






บริษัท พีทีที โกลบอล เคมิคอล
จำกัด (มหาชน)

W-(O-P2-OP2)-742: วิธีปฏิบัติงานการ FEED IN
, FEED OFF F-3106

Internal Use Only

Internal Use Only





Internal Use Only

ภาคผนวก ข.9

ข้อมูลการทำ Load Test ของเตาสํารอง (F-3106)

โปรดพิจารณาผลการทำ Load Test ของ F-3106 ที่ส่งจัดส่งให้แก่องค์ฯ. ตามมาตรฐานที่กำหนดไว้ใน EIA (รายละเอียดเพิ่มเติมดังเอกสารแนบที่ 1 และ 2) ซึ่งได้ดำเนินการตรวจวัดโดยทาง SECOT ในวันที่ 20 และ 22 ต.ค. 53 โดยค่าความเข้มข้นของมลพิษที่ระบุไว้ตามข้อกำหนด EIA จะประกอบด้วย:

- ค่าเฉลี่ยของไนโตรเจนไดออกไซด์ : ค่าอัตราการระบาย NOx จะต้องไม่เกิน 1.25 g/s และความเข้มข้นของ NOx จะต้องไม่เกิน 35 ppm ที่ 7%O₂
- ค่าเฉลี่ยของซัลเฟอร์ไดออกไซด์ : ค่าอัตราการระบาย SOx จะต้องไม่เกิน 0.1 g/s และความเข้มข้นของ SOx จะต้องไม่เกิน 1.5 ppm ที่ 7%O₂

ผลการตรวจวัดค่าความเข้มข้นการระบายมลพิษ เทียบกับการคาดการณ์และขีดจำกัดการปล่อยของค่า

| วันที่ตรวจวัด | อัตราการระบาย (kg/hr) | ค่าเฉลี่ยของมลพิษ (g/s) | | ค่าเฉลี่ยของมลพิษ (ppm) | |
|---------------|-----------------------|-------------------------|------|-------------------------|-----|
| | | NOx | SOx | NOx | SOx |
| 18 | 1,150 | 1.02 | 0.01 | 21.8 | - |
| 20 | 1,213 | 1.09 | 0.01 | 21.5 | - |
| 22 | 1,194 | 1.10 | 0.01 | 22.4 | - |
| 24 | 1,378 | 1.16 | 0.01 | 21.2 | - |
| 26 | 1,345 | 1.18 | 0.01 | 21.5 | - |
| 28 | 1,366 | 1.24 | 0.01 | 21.9 | - |

จากตารางข้างต้น จะเห็นว่า

- F-3106 สามารถเดินเครื่องจักรผลิตได้มากกว่า 28 T/H เพื่อไม่ให้เกินอัตราการระบาย NOx ไม่เกิน 1.25 g/s โดยปัจจุบัน เครื่อง F-3106 ปล่อยค่าเฉลี่ยมลพิษไว้ที่ 28 T/H เป็นค่ากำลังการผลิตสูงสุด (100% capacity)
- ส่วนอัตราการระบาย SOx นั้นไม่เปลี่ยนแปลงไม่ว่ากำลังการผลิต โดยค่าที่วัดได้ยังคงมีค่าต่ำกว่าค่าความเข้มข้น EIA ที่กำหนดไว้
- ความเข้มข้นของ NOx และ SOx ที่วัดได้จากการผลิตต่างๆ นั้น พบว่า ยังคงอยู่ต่ำกว่าค่าความเข้มข้น EIA เช่นกัน

สำหรับ Emission Report การตรวจวัดอย่างเป็นทางการ ผนวกกับใบและการจัดส่งกลับจากทาง SECOT อีกครั้ง เพื่อจัดทำเป็นเอกสารแนบข้อมูลอ้างอิงต่อไปครับ

จึงเรียนมาเพื่อทราบและพิจารณาครับ



ขอขอบคุณมากครับ


Best Regards,



ภาคผนวก ข.10

เอกสารการติดตั้งระบบ High Integrity Trip

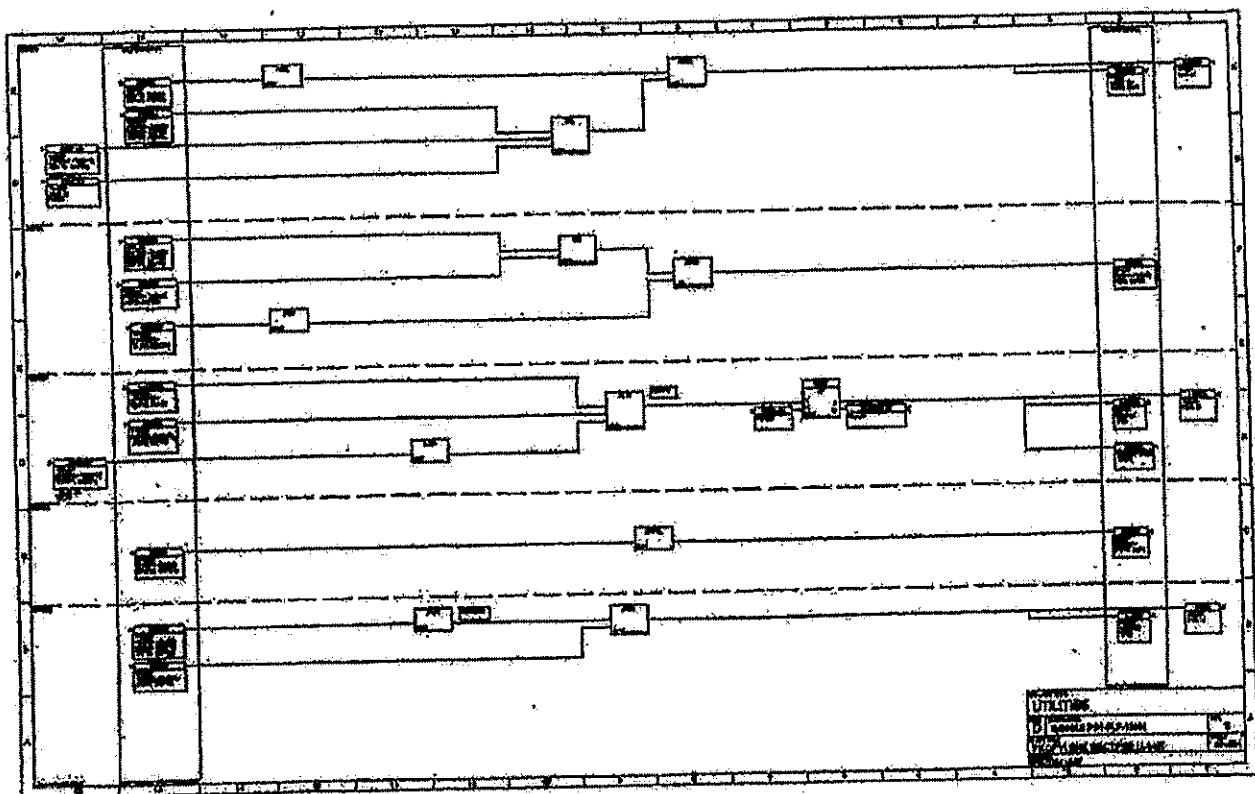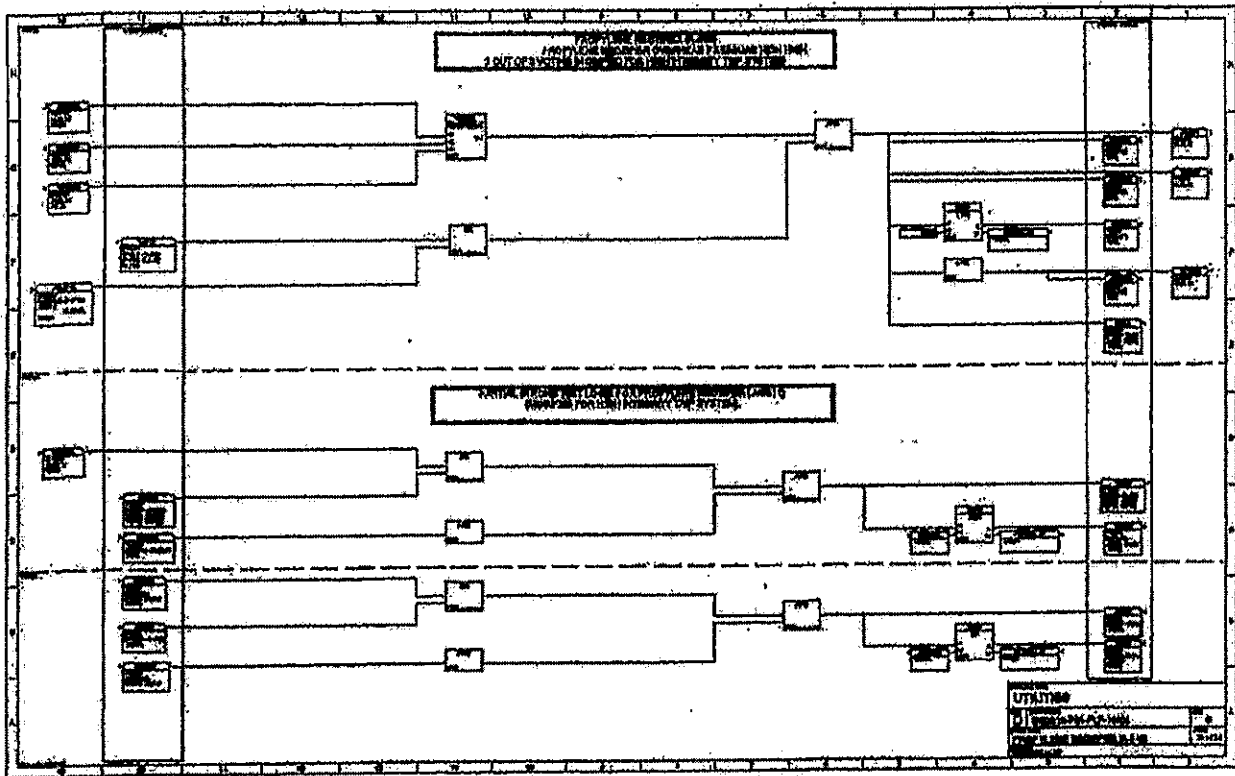

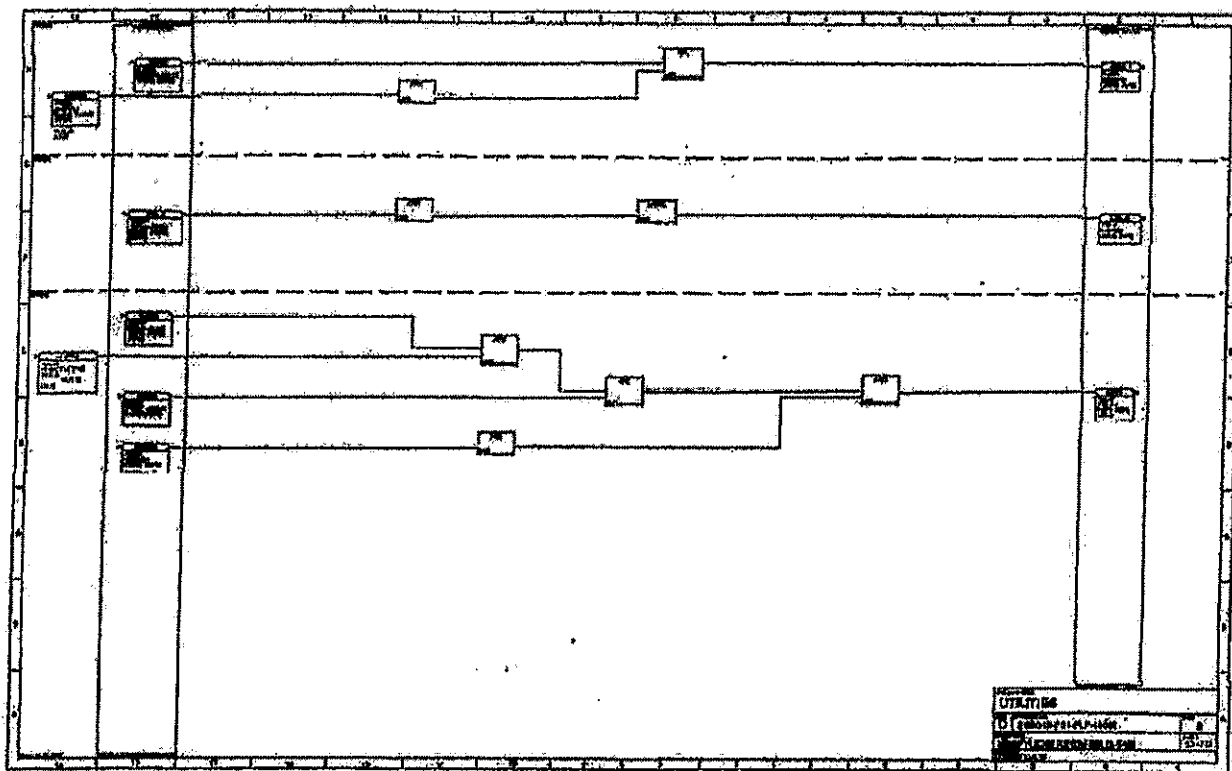

ภาคผนวก ข.11

หนังสือขึ้นทะเบียนผู้ควบคุมระบบบำบัดมลพิษ



วันที่ OLE 059 / 5 ส.ย. 2567

- ๒ -

ที่ อก ๐๓๓๗/ ๕๐ ๒๗

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๕๐๐

๒๗ พฤษภาคม ๒๕๖๗

เรื่อง หนังสือรับแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน

เรียน ผู้รับใบอนุญาตประกอบกิจการโรงงาน บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

อ้างถึง คำขอเลขที่ ๐๖๔๔ ลงรับวันที่ ๑๔ พฤษภาคม ๒๕๖๗

ตามคำขอที่อ้างถึง ท่านแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ของ บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) ทะเบียนผู้ประกอบการเลขที่ ๓๒๐๗๐๐๑๐๒๕๓๖๖ (น.๔๒(๑)-๑๐/๒๕๓๖-ก.น.พ.) ประกอบกิจการผลิตสารไอโซพรีน และผลิตภัณฑ์อิน/บิวทีน-๑ ตั้งอยู่ ณ เลขที่ ๔ ถนนโอ-๕ ตำบลมาตาตุด อำเภอเมืองระยอง จังหวัดระยอง โทรศัพท์ ๐ ๓๘๘๗ ๕๐๐๐ ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว รับแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน และให้ท่านยื่นคำขอแจ้งการมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงานครั้งต่อไป ภายในวันที่ ๒๘ พฤษภาคม ๒๕๖๗ โดยมีบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ดังนี้

| ผู้จัดการสิ่งแวดล้อม | | | นางศุภมิตรา วิหิตกนกธำรง | | |
|----------------------|-----------------------------|--------------|--------------------------|------------|--------------------|
| ลำดับ | ผู้ควบคุมระบบบำบัด | เลขทะเบียน | มลพิษน้ำ | มลพิษอากาศ | มลพิษกากอุตสาหกรรม |
| ๑ | | ๑๐๐-๕๘-๐๐๑๔๑ | ✓ | | |
| ๒ | | ๑๒๓-๕๐-๐๐๓๘๗ | ✓ | ✓ | ✓ |
| ๓ | | ๐๒๐-๖๐-๐๐๓๑๖ | | ✓ | |
| ๔ | | ๑๐๐-๖๑-๐๐๓๘๖ | ✓ | | |
| ลำดับ | ผู้ปฏิบัติงานประจำระบบบำบัด | | มลพิษน้ำ | มลพิษอากาศ | มลพิษกากอุตสาหกรรม |
| ๑ | | | | ✓ | |
| ๒ | | | | ✓ | |
| ๓ | | | ✓ | ✓ | ✓ |
| ๔ | | | | ✓ | |
| ๕ | | | ✓ | ✓ | ✓ |
| ๖ | | | ✓ | | ✓ |
| ๗ | | | ✓ | ✓ | ✓ |
| ๘ | | | ✓ | ✓ | |
| ๙ | | | ✓ | | |
| ๑๐ | | | ✓ | ✓ | |

| ลำดับ | ผู้ปฏิบัติงานประจำระบบบำบัด | มลพิษน้ำ | มลพิษอากาศ | มลพิษกากอุตสาหกรรม |
|-------|-----------------------------|----------|------------|--------------------|
| ๑๑ | | ✓ | ✓ | |
| ๑๒ | | | ✓ | |
| ๑๓ | | | ✓ | |
| ๑๔ | | | ✓ | |
| ๑๕ | | ✓ | ✓ | |
| ๑๖ | | | ✓ | ✓ |
| ๑๗ | | | ✓ | |
| ๑๘ | | ✓ | | ✓ |
| ๑๙ | | | ✓ | |
| ๒๐ | | | | ✓ |
| ๒๑ | | | ✓ | ✓ |
| ๒๒ | | | ✓ | ✓ |
| ๒๓ | | ✓ | ✓ | |
| ๒๔ | | ✓ | ✓ | ✓ |
| ๒๕ | | ✓ | | |
| ๒๖ | | ✓ | ✓ | |
| ๒๗ | | ✓ | ✓ | ✓ |
| ๒๘ | | | ✓ | |
| ๒๙ | | ✓ | | ✓ |
| ๓๐ | | | ✓ | |
| ๓๑ | | ✓ | ✓ | ✓ |
| ๓๒ | | ✓ | ✓ | ✓ |
| ๓๓ | | ✓ | ✓ | ✓ |
| ๓๔ | | ✓ | ✓ | |
| ๓๕ | | | ✓ | |
| ๓๖ | | | ✓ | |
| ๓๗ | | ✓ | ✓ | |
| ๓๘ | | | ✓ | ✓ |
| ๓๙ | | ✓ | ✓ | |
| ๔๐ | | | | ✓ |
| ๔๑ | | | | ✓ |
| ๔๒ | | | ✓ | |
| ๔๓ | | | ✓ | |
| ๔๔ | | | | ✓ |

② เสงี่ยม Q-H-02
CC: คุณ ทวีศักดิ์
เพื่อทราบและ
ดำเนินการต่อไป
วิภาดาคุณ
0-12

① ๐-๑๒ ๒๗
เพื่อไม่จนกว่า
นางสุมิตรา
5 มิ.ย. 67

ลำดับ ๑๑...

ลำดับ ๔๕...

OLE

| ลำดับ | ผู้ปฏิบัติงานประจำระบบบำบัด | มลพิษน้ำ | มลพิษอากาศ | มลพิษกากอุตสาหกรรม |
|-------|-----------------------------|----------|------------|--------------------|
| ๔๕ | | | | ✓ |
| ๔๖ | | | | ✓ |
| ๔๗ | | ✓ | ✓ | ✓ |
| ๔๘ | | | ✓ | |
| ๔๙ | | | ✓ | |
| ๕๐ | | | | ✓ |
| ๕๑ | | ✓ | ✓ | |
| ๕๒ | | | | ✓ |
| ๕๓ | | ✓ | ✓ | ✓ |
| ๕๔ | | | | ✓ |
| ๕๕ | | | | ✓ |

หมายเหตุ การแจ้งการมี/ยกเลิก/เพิ่มเติม/เปลี่ยนแปลง บุคลากรด้านสิ่งแวดล้อมประจำโรงงาน ต้องส่งหนังสือฉบับนี้ด้วย

จึงเรียนมาเพื่อโปรดทราบ

ขอแสดงความนับถือ



ผู้อำนวยการกองส่งเสริมเทคโนโลยีสิ่งแวดล้อมโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองส่งเสริมเทคโนโลยีสิ่งแวดล้อมโรงงาน

กลุ่มกำกับบุคลากรด้านสิ่งแวดล้อมประจำโรงงาน

โทร. ๐ ๒๔๓๐ ๖๓๑๕ ต่อ ๒๔๐๕

โทรสาร ๐ ๒๔๓๐ ๖๓๑๕ ต่อ ๒๔๙๙

ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th



ภาคผนวก ข.12

แผนการตรวจสอบและซ่อมบำรุงเครื่องจักร/อุปกรณ์

| Planned date | MaintenancePlan | Equipment | Description | MainItem text | Order Type | Sched.StartDate | Equipment Categories |
|--------------|-----------------|----------------|--|--|------------|-----------------|----------------------|
| 20241230 | B00-C-00127 | B-1034-HDT-001 | All Heat Detector for Fire Alarm System | (6M)Heat Detector Visual Inspection | IM | 30/12/2024 | |
| 20241230 | B00-C-00134 | B-1034-HDT-001 | All Heat Detector for Fire Alarm System | (1Y) Heat Detector Cleaning and Function | IM | 30/12/2024 | |
| 20241230 | B00-C-00135 | B-1034-SDT-001 | All Smoke Detector for Fire Alarm OLE2/1 | (1Y) Smoke Detector Cleaning and Function | IM | 30/12/2024 | |
| 20241230 | B00-C-00128 | B-1034-SDT-001 | All Smoke Detector for Fire Alarm OLE2/1 | (6M)FunctionTest Smock and Heat detector | IM | 30/12/2024 | |
| 20241230 | B11-C-00084 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (6M) Deluge Valve Spray Test | PM | 30/12/2024 | |
| 20241230 | B11-C-00082 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (3M) Deluge Valve Function Test | PM | 30/12/2024 | |
| 20241230 | B11-C-00085 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (6M) Deluge Valve Spray Test | PM | 30/12/2024 | |
| 20241230 | B11-C-00083 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (3M) Deluge Valve Function Test | PM | 30/12/2024 | |
| 20241230 | B11-C-00027 | B-1035-FHH-001 | Fire Hose House for OLE2/2 | (6M) Fire Hose Box Test | IM | 30/12/2024 | |
| 20241230 | B11-C-00028 | B-1035-FHH-001 | Fixed Monitor for OLE2/2 | (6M) Fixed Monitor Function Test | IM | 30/12/2024 | |
| 20241230 | B11-C-00029 | B-1035-FHV-001 | Post Indicator Valve for OLE2/2 | (6M) Post Indicator Valve Exercise | IM | 30/12/2024 | |
| 20241230 | B12-C-00782 | B-1036-CO2-001 | CO2 Portable for OLE2/3 | (1M)CO2 Portable Visual Inspection | IM | 30/12/2024 | |
| 20241230 | B12-C-00788 | B-1036-DC-001 | Dry Chemical for OLE2/3 | (1M)Dry Chemical Visual Inspection | IM | 30/12/2024 | |
| 20241230 | B12-C-00798 | B-1036-FA-001 | All Manual Fire Alarm for OLE2/3 | (1M)Manual Fire Visual Inspection/Test | IM | 30/12/2024 | |
| 20241230 | B12-C-00604 | B-1036-FHM-001 | FM200 for Rack Room (OLE2/3) | (1M)FM200 System Visual Inspection | IM | 30/12/2024 | Pump |
| 20241230 | B063-WK-0002 | B-F-1601A | FIRE MAIN PUMP | (1M)Weekly-Ph suction screen clearing | IM | 30/12/2024 | |
| 20241230 | B12-C-00721 | B-SECUR-TASK03 | WATER TANK TEST FIRE PUMP | (1M)WATER TANK TEST FIRE PUMP | IM | 30/12/2024 | |
| 20241230 | B12-C-00002 | B-W-3821-G2 | POLISHER BLOWER FILTER/SILENCER | (2)SILENCER INSPECTION | PM | 30/12/2024 | |
| 20241229 | B00-C-00130 | B-1034-CO2-001 | CO2 Portable for OLE2/1 | (1M) CO2 Portable Visual Inspection | IM | 29/12/2024 | |
| 20241229 | B00-C-00131 | B-1034-CO2-001 | Dry Chemical for OLE2/1 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/12/2024 | |
| 20241229 | B00-C-00129 | B-1034-DC-002 | Dry Chemical for Admin | (1M)INSPECTION | IM | 29/12/2024 | |
| 20241229 | B00-C-00001 | B-1034-DV-001 | Deluge Valve for OLE2/1/Group 1 (-DV | (3M) Deluge Valve Function Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00002 | B-1034-DV-002 | Deluge Valve for OLE2/1/Group 2 (-DV | (3M) Deluge Valve Function Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00003 | B-1034-DV-003 | Deluge Valve for OLE2/1/Group 3 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/12/2024 | |
| 20241229 | B00-C-00004 | B-1034-DV-004 | Deluge Valve for OLE2/1/Group 4 (-DV | (6M) Deluge Valve Spray Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00005 | B-1034-DV-005 | Deluge Valve for OLE2/1/Group 5 (-DV | (3M) Deluge Valve Function Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00006 | B-1034-DV-006 | Deluge Valve for OLE2/1/Group 6 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/12/2024 | |
| 20241229 | B00-C-00007 | B-1034-DV-007 | Deluge Valve for OLE2/1/Group 7 (-DV | (6M) Deluge Valve Spray Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00008 | B-1034-DV-008 | Deluge Valve for OLE2/1/Group 8 (-DV | (3M) Deluge Valve Function Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00009 | B-1034-DV-009 | Deluge Valve for OLE2/1/Group 9 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/12/2024 | |
| 20241229 | B00-C-00010 | B-1034-DV-010 | Deluge Valve for OLE2/1/Group 10 (-DV | (6M) Deluge Valve Spray Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00011 | B-1034-DV-011 | Deluge Valve for OLE2/1/Group 11 (-DV | (3M) Deluge Valve Function Test | PM | 29/12/2024 | |
| 20241229 | B00-C-00012 | B-1034-FHH-001 | Fire Hose Reel and Cabinet for Admin | (1M)Fire Hose Reel and Cabinet Reel Visual | IM | 29/12/2024 | |
| 20241229 | B00-C-00013 | B-1034-FHH-001 | Fixed Monitor for OLE2/1 | (1M)Fixed Monitor Visual Inspection | IM | 29/12/2024 | |
| 20241229 | B00-C-00014 | B-1034-FHV-001 | Post Indicator Valve for OLE2/1 | (1M)Post Indicator Valve Visual Insp | IM | 29/12/2024 | |
| 20241229 | B00-C-00015 | B-1034-WC-001 | Water Curtain for OLE2/1 | (1M)Water Curtain Inspection | IM | 29/12/2024 | |

| | | | | | | | |
|----------|-------------------|-------------------|--|--|----|------------|------------|
| 20241229 | B11-C-00086 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (6M) Deluge Valve Spray Test | PM | 30/12/2024 | |
| 20241229 | B11-C-00087 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (3M) Deluge Valve Function Test | PM | 30/12/2024 | |
| 20241229 | B11-C-00088 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (6M) Deluge Valve Spray Test | PM | 30/12/2024 | |
| 20241229 | B11-C-00089 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (3M) Deluge Valve Function Test | PM | 30/12/2024 | |
| 20241229 | B11-C-00090 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Insp | IM | 29/12/2024 | |
| 20241229 | B11-S-00025 | B-1035-WH-001 | Water Hydrant for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 29/12/2024 | |
| 20241229 | B11-S-00026 | B-1035-WH-001 | Water Hydrant for OLE2/2 | (1Y) Water Hydrant Function Test | IM | 29/12/2024 | |
| 20241229 | B11-S-00027 | B-1035-WH-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant Monitor Visual Insp | IM | 29/12/2024 | |
| 20241229 | B11-S-00028 | B-1035-WH-001 | Water Hydrant with Monitor for OLE2/2 | (1Y) Water Hydrant Monitor Function Tes | IM | 29/12/2024 | |
| 20241229 | B12-C-00771 | B-1036-FHV-001 | Post Indicator Valve for OLE2/3 | (1M) Post Indicator Valve Visual Insp | IM | 29/12/2024 | |
| 20241229 | B11-C-00142 | B-SCBA-001 | Self-contained breathing apparatus for | (1M)SCBA Visual Inspection | IM | 29/12/2024 | |
| 20241229 | B63-C-00056 | B-WM-1616 | WATER MONITOR AREA FIRE TRAINING | (6M)WM FIRE TRAINING LUBRICATION | PM | 29/12/2024 | |
| 20241228 | B12-C-00789 | B-1036-DV-001 | Deluge Valve for Grouping 1(OLE2/3)/Tag | (1M)Deluge Valve Visual Inspection | IM | 28/12/2024 | |
| 20241228 | B12-C-00793 | B-1036-DV-002 | Deluge Valve for Grouping 2(OLE2/3)/Tag | (1M)Deluge Valve Visual Inspection | IM | 28/12/2024 | |
| 20241228 | B12-C-00797 | B-1036-DV-003 | Deluge Valve for Grouping 3(OLE2/3)/Tag | (1M)Deluge Valve Visual Inspection | IM | 28/12/2024 | |
| 20241228 | B12-C-00799 | B-1036-FHH-001 | Fire Hose House for OLE2/3 | (1M)Fire Hose Box Visual Inspection | IM | 28/12/2024 | |
| 20241228 | B12-C-00798 | B-1036-FHM-001 | Fire Hose House for OLE2/3 | (1M)Fire Hydrant Visual Inspection | IM | 28/12/2024 | |
| 20241228 | B12-C-00797 | B-1036-WH-001 | Water Hydrant with Monitor for OLE2/3 | (1M)Water Hydrant Monitor Visual Insp | IM | 28/12/2024 | |
| 20241228 | B52A-C-00031 | B-AT-11441 | CW RETURN FR HEADER | (6M)SET&CALIBRATION | PM | 28/12/2024 | |
| 20241228 | B52A-C-00032 | B-AT-12044 | TOC Tx of CWS header | (6M)SET&CALIBRATION | PM | 28/12/2024 | |
| 20241228 | B3A-C-00005 | B-AT-2415 | GAS DENSITY ANALYZER HEADER | (6M)SET & CALIBRATE (W/O PT) B-2401 | PM | 28/12/2024 | |
| 20241228 | B63-C-00103 | B-DV-1623A | C/2/3 OFF SPEC TK Q-1537 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 28/12/2024 | |
| 20241228 | B63-C-00103 | B-DV-1623B | C/2/3 OFF SPEC TK Q-1537 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 28/12/2024 | |
| 20241228 | B63-C-00103 | B-DV-1624A | PROPYLENE PRODUCT TK Q-1535 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 28/12/2024 | |
| 20241228 | B63-C-00103 | B-DV-1624B | PROPYLENE PRODUCT TK Q-1535 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 28/12/2024 | |
| 20241228 | B-EL-008 | B-EL-008 | GROUPING FOR EXIT LIGHTING OLP | (3M)INSPECT WIRING/CHECK | PM | 28/12/2024 | |
| 20241228 | B-INTERCOM-GP2-P1 | B-INTERCOM-GP2-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 28/12/2024 | |
| 20241228 | B47C-C-00001 | B-LT-15341 | T-1534 | (1Y)SET & CALIBRATE (OUT-SOURCE) | PM | 28/12/2024 | |
| 20241228 | B54-C-00002 | B-LT-22143 | M-2214 | (1Y)SET & CALIBRATE (OUT-SOURCE) | PM | 28/12/2024 | |
| 20241228 | B90-C-00097 | B-MCC-EO-211 | Grouping Tag for MCC Sub#4 (MCC-211) | (3M) Inspect & Adjust | PM | 28/12/2024 | |
| 20241228 | B90-C-00098 | B-MCC-EO-211 | Grouping Tag for MCC Sub#4 (MCC-211) | (1Y) Inspect & Adjust | PM | 28/12/2024 | |
| 20241228 | B90-C-00135 | B-MCC-EO-6 | Grouping Tag for 6.6KV MCC Sub#5 | (1Y)INSPECT CONTROL WIRING/CONTACT RELAY | PM | 28/12/2024 | |
| 20241228 | B90-C-00134 | B-MCC-EO-8 | Grouping Tag for 6.6KV MCC Sub#5 | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 28/12/2024 | |
| 20241228 | BH11-C-00015 | B-P-3005A | CAUSTIC FEED PUMP | (1Y)LUBRICATION | PM | 28/12/2024 | Pump |
| 20241228 | B43A-C-00018 | B-PV-68005 | M-680 TO COLD FLAGE | (2M)SET & CALIBRATE(PSV 344) | PM | 28/12/2024 | PSV |
| 20241228 | BH3-C-00001 | B-R-3101 | ETHYLENE PURMACE TO FAN#1 | (2M) RE GREASE DAMPER BEARING | PM | 28/12/2024 | |
| 20241228 | BH27-C-00002 | B-V-3902-P1S | FILMING AMINE INJECTION PUMP FOR D.S. | (1Y)LUBRICATION | PM | 28/12/2024 | |
| 20241228 | BH27-C-00003 | B-V-3902-P2A | FILMING AMINE INJECTION PUMP FOR Q.W. | (1Y)LUBRICATION | PM | 28/12/2024 | |
| 20241228 | BH27-C-00004 | B-V-3902-P2S | FILMING AMINE INJECTION PUMP FOR Q.W. | (1Y)LUBRICATION | PM | 28/12/2024 | |
| 20241228 | B31-C-00043 | B-V-710-P-1S | CORRO. ANTIOXIDANT INHIBITOR | (1Y)CLEANING & LUBRICATE | PM | 28/12/2024 | |
| 20241228 | BWS-S-00007 | B-W502-02-01 | AIR COMPRESSOR SULLAIR | (1M)INSPECTION | PM | 28/12/2024 | Compressor |
| 20241228 | BWS-C-00001 | B-W503-06-01 | BALANCING MACHINE | (1M)INSPECTION | PM | 28/12/2024 | |
| 20241228 | BWS-S-00001 | B-W505-03-01 | UNIVERSAL MILLING MACHINE | (1M)INSPECT | PM | 28/12/2024 | |
| 20241228 | BWS-S-00018 | B-W505-03-01 | CENTER LATHE MACHINE ALUX | (1M)INSPECT | PM | 28/12/2024 | |
| 20241228 | BWS-S-00023 | B-W505-03-02 | CENTER LATHE MACHINE PINACHO | (1M)INSPECT | PM | 28/12/2024 | |

| | | | | | | | |
|----------|---------------|------------------|--|-------------------------------------|----|------------|---------|
| 20241228 | BWS-C-00001 | B-W505-06-01 | COLUMN TYPE DRILLING MACHINE | (1M)INSPECTION | PM | 28/12/2024 | |
| 20241228 | BWS-S-00025 | B-W505-07-01 | HYDRAULIC HACKSAW | (1M)INSPECT | PM | 28/12/2024 | |
| 20241228 | BWS-S-00026 | B-W505-21-01 | SHAPING MACHINE | (1M)INSPECT & LUBRICATE | PM | 28/12/2024 | |
| 20241228 | BWS-S-00005 | B-W508-03-01 | HIGH PRESSURE WATER JET MACHINE | (1M)INSPECT | PM | 28/12/2024 | |
| 20241228 | BWS-S-00003 | B-W514-01-01 | FORK LIFT | (1Y)LUBRICATE & INSPECTION | PM | 28/12/2024 | |
| 20241228 | BWS-C-00008 | B-W514-03-01 | TRUCK LOADER NIMO | (1M)INSPECTION | PM | 28/12/2024 | |
| 20241227 | B11-C-00091 | B-AT-300601 | ARSIN ANALYZER - FILTER LPG FEED ARSINE | (2M) SET & CALIBRATE | PM | 27/12/2024 | |
| 20241227 | B11-C-00092 | B-AT-300602 | MERCURY ANALYZER - FILTER LPG FEED ARSIN | (2M) SET & CALIBRATE | PM | 27/12/2024 | |
| 20241227 | B0P8-C-00027 | B-AT-382102 | SIQZ ANALYZER TRANSMITTER FOR V-3821 OUT | (1M)SET & CALIBRATE | PM | 27/12/2024 | |
| 20241227 | B10A-C-00041 | B-F-110 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-169) | PM | 27/12/2024 | Furnace |
| 20241227 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 27/12/2024 | WWT |
| 20241227 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 27/12/2024 | WWT |
| 20241227 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 27/12/2024 | WWT |
| 20241227 | B12-C-00656 | B-GS-2E-P1 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 27/12/2024 | |
| 20241227 | B90-C-00005 | B-GS-2E-P2 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 27/12/2024 | |
| 20241227 | B90-C-00075 | B-GS-34A | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 27/12/2024 | |
| 20241227 | B90-C-00056 | B-LP-3E1-1 | LP AT NEW CCB CONTROL ROOM | (4M)INSPECTION & CLEANING | PM | 27/12/2024 | |
| 20241227 | B90-C-00056 | B-LP-3E1-2 | LP AT NEW MAIN SUB | (4M)INSPECTION & CLEANING | PM | 27/12/2024 | |
| 20241227 | B90-C-00056 | B-LP-3E1-3 | LP AT NEW PROCESS SUB | (4M)INSPECTION & CLEANING | PM | 27/12/2024 | |
| 20241227 | B90-C-00056 | B-LP-4F1-1 | LP AT NEW CCB CONTROL ROOM | (4M)INSPECTION & CLEANING | PM | 27/12/2024 | |
| 20241227 | B90-C-00056 | B-LP-4F1-2 | LP AT NEW MAIN SUB | (4M)INSPECTION & CLEANING | PM | 27/12/2024 | |
| 20241227 | B90-C-00056 | B-LP-4F1-3 | LP AT NEW PROCESS SUB | (4M)INSPECTION & CLEANING | PM | 27/12/2024 | |
| 20241227 | B47A2-C-00002 | B-LT-15311 | M-1531 | (1Y)SET & CALIBRATE (OUT-SOURCE) | PM | 27/12/2024 | |
| 20241227 | B47A2-C-00003 | B-LT-15331 | T-1533 | (1Y)SET & CALIBRATE (OUT-SOURCE) | PM | 27/12/2024 | |
| 20241227 | B090-C-00029 | B-MCC-2E4-2-J | MCC FOR R-3600-G-7 | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B090-C-00029 | B-MCC-2E4-7-M | MCC FOR R-3600-P-15 | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B090-C-00028 | B-MCC-2E5-3-K | MCC FOR R-3650-G-5 | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B090-C-00029 | B-MCC-2E5-6-T | FEEDER FOR R-3600-G-6 | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B12-C-00757 | B-MCC-2EA-SR03A1 | MCC FOR R-4031-R-1A | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B12-C-00757 | B-MCC-2EA-SR06D1 | MCC FOR R-4031-P-1A | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B12-C-00757 | B-MCC-2EB-SAZ0D1 | MCC FOR R-4031-P-15 | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B12-C-00757 | B-MCC-2EB-SAZ3B1 | MCC FOR R-4031-R-15 | RCM (3M) MCC INSPECTION | PM | 27/12/2024 | |
| 20241227 | B061-C-00019 | B-P-1132A | CP FEED PUMP | (1M)CLEAN STRAINER FOR B-P-1132 | PM | 27/12/2024 | Pump |
| 20241227 | B061-C-00019 | B-P-1132S | CP FEED PUMP | (1M)CLEAN STRAINER FOR B-P-1132 | PM | 27/12/2024 | Pump |
| 20241227 | B061-C-00018 | B-P-1136A | DOG EFFLUENT TRANSFER PUMP | (1M)CLEAN STRAINER FOR B-P-1136 | PM | 27/12/2024 | Pump |
| 20241227 | B061-C-00018 | B-P-1136S | DOG EFFLUENT TRANSFER PUMP | (1M)CLEAN STRAINER FOR B-P-1136 | PM | 27/12/2024 | Pump |
| 20241227 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1M)TEST RUN | PM | 27/12/2024 | Pump |
| 20241227 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1M)TEST RUN | PM | 27/12/2024 | Pump |
| 20241227 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 27/12/2024 | Pump |
| 20241227 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 27/12/2024 | Pump |
| 20241227 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 27/12/2024 | Pump |
| 20241226 | B3A-C-00004 | B-AT-2410 | ISO14000,OPACITY ANALYZER FOR S-2401 | (3M)WINDOWN CHECK (B-2401) | PM | 26/12/2024 | |
| 20241226 | B7-C-00006 | B-AT-9440 | HC LP SUS COND. DISC. P-902A/S | (1M)SET & CALIBRATE | PM | 26/12/2024 | |
| 20241226 | B63-C-00008 | B-DV-NPA-01 | GROUPING TAP FOR DELUGE VALVE NPA | (1M)CHECK/VISUAL/HOT DETECTORS AND | PM | 26/12/2024 | |
| 20241226 | B60-C-00087 | B-G-1117-P-1A | HIGH PRESSURE PEG PUMPS | (1M)CLEAN STRAINER/INSPECTION | PM | 26/12/2024 | |
| 20241226 | B12-C-00756 | B-MCC-2EA-SR05D1 | MCC FOR R-4307S | RCM (3M) MCC INSPECTION | PM | 26/12/2024 | |
| 20241226 | B12-C-00756 | B-MCC-2EB-SA2A11 | MCC FOR R-4307A | RCM (3M) MCC INSPECTION | PM | 26/12/2024 | |
| 20241226 | B12-C-00756 | B-MCC-2EB-SA23B2 | MCC FOR R-4301-G-5 | RCM (3M) MCC INSPECTION | PM | 26/12/2024 | |
| 20241226 | B12-C-00756 | B-MCC-2EB-SR23D1 | MCC FOR R-4301-P-15 | RCM (3M) MCC INSPECTION | PM | 26/12/2024 | |
| 20241226 | B7D-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (NUNGATE) | (1D)INSPECTION | PM | 26/12/2024 | |

| | | | | | | | |
|----------|---------------|------------------|---------------------------------------|--|----|------------|---------|
| 20241224 | 863-C-00058 | B-WM-1602 | WATER MONITOR AREA UTILITY | (6M)WM UTILITY LUBRICATION | PM | 24/12/2024 | |
| 20241224 | 863-C-00058 | B-WM-1603 | WATER MONITOR AREA UTILITY | (6M)WM UTILITY LUBRICATION | PM | 24/12/2024 | |
| 20241224 | 863-C-00058 | B-WM-1604 | WATER MONITOR AREA UTILITY | (6M)WM UTILITY LUBRICATION | PM | 24/12/2024 | |
| 20241223 | 832-C-00112 | B-A-750 | GHU STRIPPER TOWER | (3M) CONDITION CHECK (OSL 2022-171) | IM | 23/12/2024 | |
| 20241223 | 861-C-00090 | B-AT-11391 | ISO14000, G-1127-R-1 TO Q-1139 | (2M)CSD ANALYZER INSPECT (OUT-SOURCE) | PM | 23/12/2024 | |
| 20241223 | 812-C-00031 | B-AT-47001 | LP CONDENSATE TCC | (1M)SET & CALIBRATE | PM | 23/12/2024 | |
| 20241223 | 812-C-00018 | B-AT-5010 | BSW FROM DEARATOR | (2M)CALIBRATION | PM | 23/12/2024 | |
| 20241223 | 812-C-00044 | B-F-150 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-144) | IM | 23/12/2024 | Furnace |
| 20241223 | 810C-C-00040 | B-F-170 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-140) | IM | 23/12/2024 | Furnace |
| 20241223 | 815C-C-00007 | B-F-3103 | ETHYLENE FURNACE # 3 | (2M)SET/CALIBRATE(GROUP 11-1)PSL, PSH, PSL | PM | 23/12/2024 | Furnace |
| 20241223 | 815C-C-00007 | B-F-3103 | ETHYLENE FURNACE # 3 | (2M)SET/CALIBRATE(GROUP 11-2)OUT-SOURCE | PM | 23/12/2024 | Furnace |
| 20241223 | 8060-C-00054 | B-G-1122-V-1 | VAPOR SCRUBBER | (3M) CONDITION CHECK (OSL 2022-170) | PM | 23/12/2024 | |
| 20241223 | 8003-C-00030 | B-HV-2200B | HP STM TO PT-220A TURB | (3M) CONDITION CHECK (OSL 2022-174) | IM | 23/12/2024 | |
| 20241223 | 8007-C-00022 | B-LV-950 | HP FLASH DRUM | (3M) CONDITION CHECK (OSL 2022-173) | IM | 23/12/2024 | |
| 20241223 | 809C-C-00014 | B-H-19818 | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2M)UPDATE N2, CO2, REL. DENSITY | PM | 23/12/2024 | |
| 20241223 | 8013-C-00001 | B-HOV-HV-310113 | MOV for B-HV-310113 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8013-C-00002 | B-HOV-HV-310114 | MOV for B-HV-310114 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8014C-C-00001 | B-HOV-HV-310213 | MOV for B-HV-310213 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8014C-C-00002 | B-HOV-HV-310214 | MOV for B-HV-310214 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8015C-C-00002 | B-HOV-HV-310313 | MOV for B-HV-310313 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8015C-C-00003 | B-HOV-HV-310314 | MOV for B-HV-310314 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8016C-C-00002 | B-HOV-HV-310413 | MOV for B-HV-310413 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8016C-C-00003 | B-HOV-HV-310414 | MOV for B-HV-310414 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8017C-C-00001 | B-HOV-HV-310513 | MOV for B-HV-310513 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8017C-C-00002 | B-HOV-HV-310514 | MOV for B-HV-310514 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00002 | B-HOV-HV-310640A | MOV for B-HV-310640A | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00001 | B-HOV-HV-310641 | MOV for B-HV-310641 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00006 | B-HOV-HV-320103 | MOV for B-HV-320103 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00006 | B-HOV-HV-320112 | MOV for B-HV-320112 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00007 | B-HOV-HV-330301 | MOV for B-HV-330301 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00008 | B-HOV-HV-330701 | MOV for B-HV-330701 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00006 | B-HOV-HV-330702 | MOV for B-HV-330702 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00007 | B-HOV-HV-330703 | MOV for B-HV-330703 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00008 | B-HOV-HV-330704 | MOV for B-HV-330704 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00008 | B-HOV-HV-331001 | MOV for B-HV-331001 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00010 | B-HOV-HV-331002 | MOV for B-HV-331002 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00008 | B-HOV-HV-340101 | MOV for B-HV-340101 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00011 | B-HOV-HV-341901 | MOV for B-HV-341901 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00012 | B-HOV-HV-341902 | MOV for B-HV-341902 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00017 | B-HOV-HV-350001 | MOV for B-HV-350001 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00018 | B-HOV-HV-350002 | MOV for B-HV-350002 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00019 | B-HOV-HV-350005 | MOV for B-HV-350005 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00020 | B-HOV-HV-350006 | MOV for B-HV-350006 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00021 | B-HOV-HV-350001 | MOV for B-HV-350001 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00022 | B-HOV-HV-350002 | MOV for B-HV-350002 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00023 | B-HOV-HV-350005 | MOV for B-HV-350005 | (1M)RCM-Inspection and Lubrication | PM | 23/12/2024 | |
| 20241223 | 8018C-C-00028 | B-P-12015 | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2022-172) | PM | 23/12/2024 | Pump |
| 20241223 | 852B-C-00099 | B-P-12025 | SIDESTREAM FILTER BACKWASH SUMP PUMP | (3M)REGREASE | PM | 23/12/2024 | Pump |
| 20241223 | 8063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pt suction screen cleaning | PM | 23/12/2024 | Pump |

| | | | | | | | |
|----------|---------------|-------------------|--|--|----|------------|------------|
| 20241223 | 811-C-00005 | B-P-4056 | SOLVENT SLOPS PUMP | (3M) REGREASE | PM | 23/12/2024 | Pump |
| 20241223 | 800C-C-00087 | B-PIPE1-5CL | LINE STEAM CONDENSATE - LP QLE 2-1 | (3M) CONDITION CHECK (OSL 2022-175) | IM | 23/12/2024 | |
| 20241223 | 847A1-C-00027 | B-PSH-15307A | PRESSURE SWITCH LP ETHYLEN TO ROC | (1V) SET & CALIBRATION | PM | 23/12/2024 | |
| 20241223 | 847A1-C-00027 | B-PSH-15307B | PRESSURE SWITCH LP ETHYLEN TO ROC | (1V) SET & CALIBRATION | PM | 23/12/2024 | |
| 20241223 | 847A1-C-00028 | B-PSH-15307C | PRESSURE SWITCH LP ETHYLEN TO ROC | (1V) SET & CALIBRATION | PM | 23/12/2024 | |
| 20241223 | 847A1-C-00028 | B-PSH-15308A | PRESSURE SW LP ETHYLEN TO TTT/PTCH I-1 | (1V) SET & CALIBRATION | PM | 23/12/2024 | |
| 20241223 | 847A1-C-00028 | B-PSH-15308B | PRESSURE SW LP ETHYLEN TO TTT/PTCH I-1 | (1V) SET & CALIBRATION | PM | 23/12/2024 | |
| 20241223 | 847A1-C-00028 | B-PSH-15308C | PRESSURE SW LP ETHYLEN TO TTT/PTCH I-1 | (1V) SET & CALIBRATION | PM | 23/12/2024 | |
| 20241223 | 847C-C-00054 | B-PSH-15314 | T-154 TO HOT B AREA | (3M) CONDITION CHECK (OSL 2023-143) | IM | 23/12/2024 | PSV |
| 20241223 | 8061-C-00020 | B-Q-1169 | WASTE WATER SUMP | (3M) CONDITION CHECK (OSL 2023-141) | IM | 23/12/2024 | |
| 20241223 | 8529-C-00010 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-167) | IM | 23/12/2024 | |
| 20241223 | 819A-WK-0001 | B-R-300-PT-15 | CG COND SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207A | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207B | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207C | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207D | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207E | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207F | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207G | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 818C-C-00024 | B-R-3207H | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/12/2024 | |
| 20241223 | 842B-WK-0001 | B-R-600-PT-15 | CJR SURFACE CONDENSER COND.TURBINE | (2W)REGREASE & INSPECTION | PM | 23/12/2024 | |
| 20241223 | 842B-WK-0001 | B-R-650-PT-15 | CJR CMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 23/12/2024 | |
| 20241223 | 848C-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 23/12/2024 | |
| 20241223 | 809C-C-00005 | B-T-050A | FRN FEED QW. HEATERS | (3M) CONDITION CHECK (OSL 2022-165) | IM | 23/12/2024 | |
| 20241223 | 8102C-C-00003 | B-V-3901-P2A | NEUTRALIZING AMINE INJECTION PUMP FOR Q. | (1V)INSPECTION | PM | 23/12/2024 | |
| 20241222 | 809P-C-00025 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET/CALIBRATE | PM | 23/12/2024 | |
| 20241222 | 809P-C-00026 | B-AT-33102 | MOISTURE ANALYZER TRANSMITTER FOR M-3301 | (1M)MOISTURE ANALYZER AMETEK | PM | 23/12/2024 | |
| 20241222 | 848C-C-00001 | B-CCTV-CP2-BV | CCTV Grouping Tag | (3M)FUNCTION TEST & EXERCISE | PM | 23/12/2024 | |
| 20241222 | 8050S-C-00001 | B-G-1350S-R-1 | ASSIST AIR BLOWER | RCM (1V)INSPECTION IMPELIER AND CASING S | PM | 23/12/2024 | |
| 20241222 | 859S-C-00009 | B-P-2217 | COOLING WATER MACK-UP PUMP | (1M)CLEANING & LUBRICATE | PM | 23/12/2024 | Pump |
| 20241222 | 890-C-00029 | B-PM-3801S | BPW PUMP MOTOR | (1M)CLEANING AND INSPECTION | PM | 23/12/2024 | Motor |
| 20241222 | 818A-C-00033 | B-R-300 | CRACKED CAS COMPRESSOR TURBINE DRIVER | (1M) INSPECT TURBINE EXPANSION JOINT | IM | 23/12/2024 | Compressor |
| 20241222 | 811-C-00004 | B-R-2M2 | DRY TYPE TRANSFORMER | (3M)CONDITION CHECK | PM | 23/12/2024 | |
| 20241222 | 86AS-S-00001 | B-W-260-1 | FILMING AMINE INJECTION PUMP | (1V)INSPECTION, CLEAN, LUBRICATE | PM | 23/12/2024 | |
| 20241221 | 809P-C-00004 | B-BLOCK-VALVE-NO2 | BY FV FOR PH SEC 12 FLUSHING OUT TO OPE | (6M)LUBRICATION | PM | 23/12/2024 | |
| 20241221 | 809P-C-00004 | B-CV-121A | GROUPING TAG FOR CONTROL VALVE | (6M)LUBRICATION (GREASE NO. G-23) | PM | 23/12/2024 | |
| 20241221 | 809P-C-00005 | B-CV-64 | GROUPING TAG FOR CONTROL VALVE GROUP 4-C | (6M)LUBRICATION (GREASE NO. G-23) | PM | 23/12/2024 | |
| 20241221 | 863-C-00106 | B-DV-1610 | PROPYLENE DEBIT PUMPS DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00106 | B-DV-1612 | C3 RECYCLE PUMPS DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00102 | B-DV-1621A | LPG STORAGE TK Q-1521 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00102 | B-DV-1621B | LPG STORAGE TK Q-1521 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00102 | B-DV-1622A | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00102 | B-DV-1622B | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00105 | B-DV-1627A | MIXED C4 TK Q-1540 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00105 | B-DV-1627B | MIXED C4 TK Q-1540 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00105 | B-DV-1627C | MIXED C4 TK Q-1540 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00106 | B-DV-1630 | C4 HYDROGEN EFFLUENT PUMP DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00106 | B-DV-1631 | C4 HYDROGEN PUMP DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 863-C-00106 | B-DV-1641 | RAW MIXED C4 PRODUCT PUMP DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 23/12/2024 | |
| 20241221 | 838-C-00095 | B-EQ011 | GROUPING FOR 380V SWGR 3 TAG | (6M)INSPECT CABLE/TIGHTNESS NUTS/SCREW | PM | 23/12/2024 | |

| | | | | | | | |
|----------|---------------|-------------------|--|---|----|------------|----------|
| 20241221 | 861-C-00106 | B-G-1144-G-3 | UREA DILUTION AGITATOR | (1V)LUBRICATION | PM | 21/12/2024 | |
| 20241221 | 812-C-T-4704 | B-LCP-T-4704 | LCR FOR TREATER REGENERATION HEATER | (1M)INSPECTION&RECORD | IM | 21/12/2024 | |
| 20241221 | 846A-C-00037 | B-L1-15201B | RTG of Tank Q-1520 | (6M)Verify Pin Radar Tank&Calibrate (Law) | PM | 21/12/2024 | |
| 20241221 | 846A-C-00038 | B-L1-15211A | RTG of Tank Q-1521 | (6M)Verify Pin Radar Tank&Calibrate (Law) | PM | 21/12/2024 | |
| 20241221 | 847B-C-00034 | B-L1-15351A | RTG of Tank Q-1535 | (6M)Verify Pin Radar Tank&Calibrate (Law) | PM | 21/12/2024 | |
| 20241221 | 847B-C-00035 | B-L1-15361A | RTG of Tank Q-1536 | (6M)Verify Pin Radar Tank&Calibrate (Law) | PM | 21/12/2024 | |
| 20241221 | 847C-C-00015 | B-L1-15371A | RTG of Tank Q-1537 | (6M)Verify Pin Radar Tank&Calibrate (Law) | PM | 21/12/2024 | |
| 20241221 | 847C-C-00060 | B-LT-49101 | Q-4910 radar tank gauge | (6M)Verify Pin Radar Tank&Calibrate (Law) | PM | 21/12/2024 | |
| 20241221 | 847C-C-00061 | B-LT-49102 | Q-4910 radar tank gauge | (6M)Verify Pin Radar Tank&Calibrate (Law) | PM | 21/12/2024 | |
| 20241221 | 809P-C-00016 | B-M-19016 | GROUPING TAG FOR FUEL GAS FROM PTT SKID | (1M)INSPECTION & ADJUST | PM | 21/12/2024 | |
| 20241221 | 8015S-C-00001 | B-M-19192 | GROUPING TAG FOR C234 TO SSCM BPE RMC | (4M)SET & CALIBRATE | PM | 21/12/2024 | |
| 20241221 | 890-C-00013 | B-MCC-EO-A | Grouping Tag for 6.6KV MCC Sub#5 | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 21/12/2024 | |
| 20241221 | 890-C-00013 | B-MCC-EO-A | Grouping Tag for 6.6KV MCC Sub#5 | (1M)INSPECT CONTACT WIRING/CONTACT RELAY | PM | 21/12/2024 | |
| 20241221 | 809P-C-00034 | B-MOTOR-EO-006 | GROUPING FOR MOTORS CONSOLE#5 | (6M)CLEANING & INSPECTION AND LUBE OIL | PM | 21/12/2024 | Motor |
| 20241221 | 861-S-00022 | B-P-1130A | CPI SLUDGE TRANSFER PUMP | (6M)CLEANING & LUBRICATE | PM | 21/12/2024 | Pump WWT |
| 20241221 | 800C-C-00089 | B-P-1175 | WASTE WATER RECYCLING PUMP | (1V)LUBRICATION | PM | 21/12/2024 | Pump WWT |
| 20241221 | 843A-C-00017 | B-PSV-69005 | M-690 TO COLD FLARE | (3V)SET & CALIBRATE(PSV 406) | PM | 21/12/2024 | PSV |
| 20241221 | 858-C-00005 | B-PV-19043 | N2 TO H2 CUSTODY (N.B/L) | (6M)LUBRICATE(GREASE G-33) (OILT-SOURCE) | PM | 21/12/2024 | |
| 20241221 | 845S-C-00033 | B-WSTOOLS-02 | T02 TOOLS ASSET CONTROL-1,4 | (6M)INSPECT TOOLS ASSET CONTROL | PM | 21/12/2024 | |
| 20241221 | 890-C-00028 | B-XFMR-2A1 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 21/12/2024 | |
| 20241221 | 890-C-00028 | B-XFMR-2A2 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 21/12/2024 | |
| 20241221 | 890-C-00028 | B-XFMR-2A3 | POWER TRANSFORMER FOR ADMIN BLDG | (3M)-RCM Visual Inspection | IM | 21/12/2024 | |
| 20241221 | 890-C-00028 | B-XFMR-2A4 | POWER TRANSFORMER FOR ADMIN BLDG | (3M)-RCM Visual Inspection | IM | 21/12/2024 | |
| 20241220 | B11-C-00013 | B-AT-30027B | HYDROLYSIS REACTOR 1-300" OUTLET | (2M) SET & CALIBRATE | PM | 20/12/2024 | |
| 20241220 | B11-C-00013 | B-AT-371001 | A-3701 GC SPLITTER TEMPERATURE | (2M) SET & CALIBRATE | PM | 20/12/2024 | |
| 20241220 | B11-C-00111 | B-AT-371002 | ANALYZER (GC) PROPANE RECYCLE FROM C3 SP | (2M) SET & CALIBRATE | PM | 20/12/2024 | |
| 20241220 | B03A-C-00029 | B-E-2401 | STEAM GENERATOR | (3M) CONDITION CHECK (OSL 2023-249) | IM | 20/12/2024 | |
| 20241220 | B09B-C-00001 | B-CAP-NMS | GROUPING TAG FOR NEW MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 20/12/2024 | |
| 20241220 | B10B-C-00054 | B-F-120 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-234) | IM | 20/12/2024 | Furnace |
| 20241220 | B10B-C-00056 | B-F-120 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-253) | IM | 20/12/2024 | Furnace |
| 20241220 | B10E-C-00051 | B-F-190 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-245) | IM | 20/12/2024 | Furnace |
| 20241220 | B10U-C-00052 | B-F-190 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-238) | IM | 20/12/2024 | Furnace |
| 20241220 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 20/12/2024 | Pump WWT |
| 20241220 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 20/12/2024 | Pump WWT |
| 20241220 | B061-C-00017 | B-G-1144-P-25 | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 20/12/2024 | Pump WWT |
| 20241220 | B11Z-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 20/12/2024 | |
| 20241220 | B90-C-00026 | B-GS-2E-F2 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 20/12/2024 | |
| 20241220 | B90-C-00045 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 20/12/2024 | |
| 20241220 | B10D-C-00075 | B-LG-1407 | FURNACE F-140 STEAM DR | (3M) CONDITION CHECK (OSL 2023-244) | IM | 20/12/2024 | |
| 20241220 | B0P5-S-00005 | B-MOTOR-EO-006 | GROUPING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | PM | 20/12/2024 | |
| 20241220 | B0P5-S-00016 | B-MOTOR-EO-DEM1N | GROUPING TAG FOR MOTOR DEMIN PLANT | (1M)CLEANING & INSPECTION. | PM | 20/12/2024 | Motor |
| 20241220 | B11-C-00044 | B-NONE-OLIFINS-P2 | Equipment Non Olefins Plant 1-4/2 | (3M) CONDITION CHECK (OSL 2023-233) | IM | 20/12/2024 | |
| 20241220 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 20/12/2024 | Pump |
| 20241220 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 20/12/2024 | Pump |
| 20241220 | B061-C-00019 | B-P-1136A | DCE EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 20/12/2024 | Pump |
| 20241220 | B061-C-00018 | B-P-1136S | DCE EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 20/12/2024 | Pump |
| 20241220 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 20/12/2024 | Pump |
| 20241220 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 20/12/2024 | Pump |
| 20241220 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 20/12/2024 | Pump |
| 20241220 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 20/12/2024 | Pump |

| | | | | | | | |
|----------|---------------|----------------|---|--|----|------------|--------------------|
| 20241218 | B10K-C-00018 | B-F-1010 | USC PYROLYSIS FURNACE | (6M)REGREASE DAMPER BEARING | PM | 18/12/2024 | Furnace |
| 20241218 | B10K-C-00021 | B-F-1020 | USC PYROLYSIS FURNACE | (6M)REGREASE DAMPER BEARING | PM | 18/12/2024 | Furnace |
| 20241218 | B10K-C-00012 | B-F-160 | USC FURNACES | (6M)REGREASE DAMPER BEARING | PM | 18/12/2024 | Furnace |
| 20241218 | B10K-C-00011 | B-F-190 | USC FURNACES | (6M)REGREASE DAMPER BEARING | PM | 18/12/2024 | Furnace |
| 20241218 | B-C10-C-00001 | B-G-3841 | COOLING TOWER SYSTEM | (2M)VISUAL INSPECTION | IM | 18/12/2024 | Fan Visual Inspect |
| 20241218 | B-C10-C-00001 | B-G-3841-RIA | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/12/2024 | Fan Visual Inspect |
| 20241218 | B-C10-C-00001 | B-G-3841-R1C | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/12/2024 | Fan Visual Inspect |
| 20241218 | B-C10-C-00001 | B-G-3841-R1C | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/12/2024 | Fan Visual Inspect |
| 20241218 | B-C10-C-00001 | B-G-3841-R1D | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/12/2024 | Fan Visual Inspect |
| 20241218 | B63-C-00053 | B-HV-1640 | HYDRANT AREA TRUCK LOADING | (6M)HY TRUCK LOAD LUBRICATION | PM | 18/12/2024 | Motor |
| 20241218 | B478-C-00011 | B-PP-15335 | LP PROPYLENE PRODUCT PUMP MOTOR | (2M)LUBRICATION | PM | 18/12/2024 | Motor |
| 20241218 | B478-C-00011 | B-PP-15335 | LP PROPYLENE PRODUCT PUMP (NO.1) | (2M)LUBRICATION | PM | 18/12/2024 | Motor |
| 20241218 | B30A-C-00003 | B-P-4036A | ACETYLENE WASHER BOTTOMS PUMP | (1M)CHECK & CLEAN MECHANICAL SEAL COOLE | PM | 18/12/2024 | Pump |
| 20241218 | B30A-C-00003 | B-P-573 | LIQUID PROPANE PUMP | (1M)CLEAN & INSPECTION | PM | 18/12/2024 | Pump |
| 20241218 | B00C-C-00044 | B-PIPE1-DR | LINE DRAIN OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-014) | IM | 18/12/2024 | |
| 20241218 | B00C-C-00043 | B-PIPE1-SCM | LINE STEAM CONDENSATE - MP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-003) | IM | 18/12/2024 | |
| 20241218 | B00C-C-00041 | B-PIPE1-5M | LINE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-004) | IM | 18/12/2024 | |
| 20241218 | B90-C-00014 | B-PM-3001A | LPG FEED PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 18/12/2024 | Motor |
| 20241218 | B90-C-00011 | B-PM-3901A | WASH OIL INJECTION PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 18/12/2024 | Motor |
| 20241218 | B478-C-00001 | B-PSV-15511 | ISO14000,PSY SAFETY VALVE OF Q-1551 | (1M)INSPECT & ADJUST | PM | 18/12/2024 | PSV |
| 20241218 | B478-C-00001 | B-PSV-15513 | WATERGEMMENT VENT Q-1551 | (1M)INSPECT & ADJUST FOR Q-1551 | PM | 18/12/2024 | PSV |
| 20241218 | B478-C-00001 | B-PSV-15513 | WATERGEMMENT VENT Q-1551 | (1M)INSPECT & ADJUST FOR Q-1551 | PM | 18/12/2024 | PSV |
| 20241218 | B33-C-00008 | B-STD-600A | GROUPING TAG FOR STANDARD GAS | (1M)CHECK STANDARD GAS STATUS | PM | 18/12/2024 | |
| 20241218 | B13-S-00017 | B-XFM-RHT-001 | POWER TRANSFORMER 6.6KV / 2072V | (3M)CONDITION CHECK | PM | 18/12/2024 | |
| 20241217 | B11-C-00094 | B-AT-340610 | ACETYLENE REACTOR EFFLUENT | (1M) SET & CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B11-C-00095 | B-AT-350220 | DEBUTANIZER REFLUX PUMPS P-3502A/5 DISCH | (2M) SET & CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00011 | B-AT-382105 | ISO14000,PH METER TX FOR V-3821-P-1 OUTL | (1M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00064 | B-AT-402101 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00065 | B-AT-402105 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00066 | B-AT-402201 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00068 | B-AT-420101A | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00069 | B-AT-420101B | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00029 | B-AT-430105 | Fuel Gas of F-4301 and F-4302 CEMs | (1M)SET & CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00071 | B-AT-430401 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00032 | B-AT-480104 | FE-4801-02 Downstream TOC | (1M)SET & CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B12-C-00033 | B-AT-485201 | Q-4852 TOC | (1M)SET & CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B90-C-00043 | B-BC-2EE-110-1 | BATTERY CHARGER 110VDC 6.36 KVA(OUTY) | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00044 | B-BC-2EE-110-2 | BATTERY CHARGER 110VDC 6.36 KVA(STAND BY) | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00045 | B-BC-2EE-24-1 | BAT TERT CHARGER 24VDC 2.5 KVA(OUTY) | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00046 | B-BC-2EE-24-2 | BATTERY CHARGER 24VDC 2.5 KVA(STAND BY) | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00048 | B-BC-2M1-1 | 110 VDC BATTERY CHARGER PANEL | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00049 | B-BC-2M1-2 | 110 VDC BATTERY CHARGER PANEL | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00050 | B-BC-34A-1 | BATTERY CHARGER NO. 1 | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00051 | B-BC-34A-2 | BATTERY CHARGER NO. 2 | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00007 | B-BC1-2E5 | BATTERY CHARGER AT NEW MAIN SUB.-1 | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00040 | B-BC1-2E5-2 | BATTERY CHARGER AT NEW MAIN SUB.-2 | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00041 | B-BC1-3A4 | BATTERY CHARGER PANEL NO.1 FOR SUB NO.5 | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00025 | B-BC2-2E5 | BATTERY CHARGER AT NEW PRO. SUB.-1 | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00042 | B-BC2-2E5-2 | BATTERY CHARGER AT NEW PRO. SUB.-2 | (3M)CONDITION CHECK | PM | 17/12/2024 | |
| 20241217 | B90-C-00047 | B-BC2-KW1A | BATTERY CHARGER PANEL NO.2 FOR SUB NO.5 | (3M)CONDITION CHECK | PM | 17/12/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|------------|------------|
| 20241217 | B90-C-00160 | B-CP-TR-PLANT1 | GROUP TAG FOR CP TRU PLANT1 | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 17/12/2024 | |
| 20241217 | B90-C-00162 | B-CP-TR-PLANT2 | GROUP TAG FOR CP TRU PLANT2 | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 17/12/2024 | |
| 20241217 | B12-C-00041 | B-CP-TRU-1 | CATHODIC PROTECTION INERTER NO.1 | (1M)VISUAL INSPECTION & RECORD | PM | 17/12/2024 | |
| 20241217 | B90-C-00159 | B-CP-TRU-PLANT1 | GROUP TAG FOR CP TRU PLANT1 | (2M)VISUAL INSPECTION | PM | 17/12/2024 | |
| 20241217 | B90-C-00158 | B-CP-TRU-PLANT2 | GROUP TAG FOR CP TRU PLANT2 | (2M)VISUAL INSPECTION | PM | 17/12/2024 | |
| 20241217 | B00C-C-00005 | B-DCS-P1 | DCS HONEYWELL TDC3000EXPERION | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-DCS-P1-BOILER | DCS EMERSON DELTA-V M CONTROLLER SOFTWA | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00005 | B-DCS-P1-ORP | DCS HONEYWELL C300 EXPORION RS1.1 | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00005 | B-DCS-P2 | DCS YOKOGAWA CP461-50/AV30D/REVISION RS | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00005 | B-DCS-P3 | DCS HONEYWELL C300 EXPORION | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00005 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P1-ORP | ESD/IMP101TMA & GOS2A 3.02EM12.10.0 | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P1-TANKFARM | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P2-COLD/UT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P2-FUR5/HOT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P2-FUR6 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B0A-C-00039 | B-LDCL-3M2 | GROUPING FOR PH LOCAL ANALYZER 3 M Ph/2 | (3M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B90-C-00015 | B-M-19057 | GROUPING TAG FOR TAIL GAS TO ROC. MSKID | (1M)UPDATE N2, CO2, REL. DENSITY | PM | 17/12/2024 | |
| 20241217 | B38-S-00005 | B-MOTOR-EP-NA001 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION | PM | 17/12/2024 | Motor |
| 20241217 | B428-B-00014 | B-MR-600-P-1A | CZR CONDENSER COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/12/2024 | |
| 20241217 | B428-B-00012 | B-MR-600-P-2A | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/12/2024 | |
| 20241217 | B428-B-00011 | B-MR-600-P-2S | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/12/2024 | |
| 20241217 | B059-C-00013 | B-P-1124 | CHEMICAL SEWER SUMP PUMP | (4M) Inspect and Calibrate | PM | 17/12/2024 | Pump |
| 20241217 | B12-C-00045 | B-PGC-BV-HOUSE1 | GROUPING TAG FOR PGC BV HOUSE 1 | (3M) CONDITION CHECK (OSL2018-0221-031) | PM | 17/12/2024 | |
| 20241217 | B12-C-00046 | B-PGC-BV-HOUSE2 | GROUPING TAG FOR PGC BV HOUSE 2 | (4M) Inspect and Calibrate | PM | 17/12/2024 | |
| 20241217 | B12-C-00047 | B-PGC-BV-HOUSE3 | GROUPING TAG FOR PGC BV HOUSE 3 | (4M) Inspect and Calibrate | PM | 17/12/2024 | |
| 20241217 | B12-C-00044 | B-PGC-BV-HOUSE3 | GROUPING TAG FOR PGC BV HOUSE 3 | (2M)SET&CALIBRATE | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P1-CCS-R575 | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P1-CCS-CGC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P1-CCS-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P1-CCS-PAC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P1-PSA1 | PRESSURE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P1-TMC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P2-TTCC-CGC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P2-TTCC-ERC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P2-TTCC-PRC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P2-PSA2 | PRESSURE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | |
| 20241217 | B00C-C-00006 | B-PLC-P3-TTCC | INTEGRATED TURBINE COMPRESSOR CONTROL | (1M)DAILY CHECK SYSTEM | PM | 17/12/2024 | Compressor |
| 20241217 | B19A-C-00018 | B-R-300 | CRACKED GAS COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/12/2024 | Compressor |
| 20241217 | B428-B-00018 | B-R-600-P-1A | CZR COMPRESSOR CONDENSATE PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/12/2024 | Compressor |
| 20241217 | B428-B-00012 | B-R-600-P-2A | CZR COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/12/2024 | Compressor |
| 20241217 | B428-B-00011 | B-R-600-P-2S | CZR COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/12/2024 | Compressor |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|------------|---------------|
| 20241217 | B19A-C-00058 | B-RX/RX-401A | TAIL GAS EXPANDER & COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/12/2024 | Compressor |
| 20241217 | B19A-C-00058 | B-RX/RX-401B | TAIL GAS RECOMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/12/2024 | Compressor |
| 20241217 | B19A-C-00058 | B-RX-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) N2 PRESSURE INSPECTION | IM | 17/12/2024 | Compressor |
| 20241217 | B19A-C-00058 | B-RX-600 | ETHYLENE REFRIGERANT COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | IM | 17/12/2024 | Compressor |
| 20241217 | B19A-C-00058 | B-RX-650 | PROPYLENE REFRIGERANT COMPRESSOR TURBIN | (1M) N2 PRESSURE INSPECTION | IM | 17/12/2024 | Compressor |
| 20241217 | B12-C-00021 | B-SCADA-BV | SCADA SYSTEM FOR BV | (1M)VISUAL INSPECT | PM | 17/12/2024 | |
| 20241216 | B11-C-00096 | B-AT-360030 | LP DEETHANIZER A-3600 OVID. TO C2 SPLIT | (2M) SET & CALIBRATE | PM | 16/12/2024 | |
| 20241216 | B11-C-00097 | B-AT-360031 | LP DEETHANIZER A-3600 BITMS. TO PUMP P-3 | (2M) SET & CALIBRATE | PM | 16/12/2024 | |
| 20241216 | B012-C-00011 | B-HV-2101B | HP STM TO PT-210A TURB | (3M) CONDITION CHECK (OSL 2021-069) | IM | 16/12/2024 | |
| 20241216 | B016-C-00022 | B-M-15057 | GROUPING TAG FOR TAIL GAS TO ROC. M.SKID | (4M)SET & CALIBRATE | PM | 16/12/2024 | |
| 20241216 | B008-C-00013 | B-M-942 | INTERMITTENT BLOWDOWN DRAIN | (3M) CONDITION CHECK (OSL 2022-209) | IM | 16/12/2024 | |
| 20241216 | B38-S-00003 | B-MOTOR-EO-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 16/12/2024 | Motor |
| 20241216 | B063-C-00014 | B-PM-1601A | MAIN FIREWATER PUMP MOTOR | RCM(3M)GREASING | PM | 16/12/2024 | Motor |
| 20241216 | B063-C-00015 | B-PM-1601B | MAIN FIREWATER PUMP MOTOR | RCM(3M)GREASING | PM | 16/12/2024 | Motor |
| 20241216 | B00C-C-00104 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-215) | IM | 16/12/2024 | |
| 20241216 | B00C-C-00103 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-214) | IM | 16/12/2024 | |
| 20241216 | B00C-C-00105 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-216) | IM | 16/12/2024 | |
| 20241216 | B12-C-00760 | B-NONE-OLEFINS-P3 | Equipment Non Olefins Plant 1-4/3 | (3M) CONDITION CHECK (OSL 2022-206) | IM | 16/12/2024 | |
| 20241216 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1M)Weekly-Pit suction screen cleaning | PM | 16/12/2024 | Pump |
| 20241216 | B00C-C-00102 | B-PIPE1-D5 | LINE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-207) | IM | 16/12/2024 | |
| 20241216 | B19A-C-00067 | B-R-300 | CRACKED GAS COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-217) | IM | 16/12/2024 | Compressor |
| 20241216 | B19A-C-00068 | B-SECUR-TASK05 | FOR PREST FIRE PUMP | (1M)INSPECTION | PM | 16/12/2024 | |
| 20241216 | B12-C-00763 | B-SST-479310 | SUPERHEATED UP STEAM HEADER | (3M) CONDITION CHECK (OSL 2022-213) | IM | 16/12/2024 | |
| 20241216 | B12-C-00761 | B-SST-479317 | HP STEAM XV-479304 | (3M) CONDITION CHECK (OSL 2022-211) | IM | 16/12/2024 | |
| 20241216 | B12-C-00762 | B-SST-479350 | HP STEAM HEADER | (3M) CONDITION CHECK (OSL 2022-212) | IM | 16/12/2024 | |
| 20241216 | B90-S-00001 | B-DPS1-225 | UPS AT NEW PROCESS SUBSTION | (1M)INSPECT & ADJUST | PM | 16/12/2024 | |
| 20241216 | B63-C-00050 | B-WM-1605 | WATER MONITOR AREA FURNACE | (6M)WM FURNACE LUBRICATION | PM | 16/12/2024 | |
| 20241216 | B63-C-00050 | B-WM-1606 | WATER MONITOR AREA FURNACE | (6M)WM FURNACE LUBRICATION | PM | 16/12/2024 | |
| 20241216 | B63-C-00050 | B-WM-1608 | WATER MONITOR AREA FURNACE | (6M)WM FURNACE LUBRICATION | PM | 16/12/2024 | |
| 20241215 | B00C-C-00209 | B-1034-FST-1605 | Foam Storage Tank for Truck Load | (3M)Function Test | PM | 15/12/2024 | |
| 20241215 | B00C-C-00208 | B-1034-FST-1606 | Foam Storage Tank for Truck Load | (1M)VISUAL INSPECTION | IM | 15/12/2024 | |
| 20241215 | B11-C-00138 | B-1035-FHH-001 | Pne House House for OLE2/2 | (1M)Pne House Box Visual Inspection | PM | 15/12/2024 | |
| 20241215 | B11-C-00139 | B-1035-FST-001 | Foam Storage Tank for Truck Load | (3M)Function Test | PM | 15/12/2024 | |
| 20241215 | B11-C-00157 | B-1035-FVW-001 | Post Indicator Valve for OLE2/2 | (1M)Post Indicator Valve Visual Insp | PM | 15/12/2024 | |
| 20241215 | B11-C-00148 | B-1035-FWC-001 | Water Curtain for OLE2/2 | (1M)Water Curtain Inspection | PM | 15/12/2024 | ตรวจพบรอยรั่ว |
| 20241215 | B00C-C-00217 | B-1036-FST-H4796 | Foam Storage Tank for H-4090,H-4091 BV | (1M)VISUAL INSPECTION | IM | 15/12/2024 | ตรวจพบรอยรั่ว |
| 20241215 | B029-S-00004 | B-A-530 | PROPYLENE STRIPPER | (3M) CONDITION CHECK (OSL 2020-001) | IM | 15/12/2024 | |
| 20241215 | B90-S-00019 | B-CAP-C5 | GROUPING TAG FOR CAP-C5 SUBSTATION#3 | (1M)VISUAL INSPECTION TEMP,NOISE, VIBRAT | PM | 15/12/2024 | |
| 20241215 | B48-C-00023 | B-CCTV-GPI-BV | CCTV Grouping Tag BV | (3M)FUNCTION TEST & EXERCISE | PM | 15/12/2024 | |
| 20241215 | B11-C-00154 | B-C02-PRO-SUB | CO2 System for New Process Sub | (1M)VISUAL INSPECTION | IM | 15/12/2024 | |
| 20241215 | B63-C-00063 | B-DV-1605 | PROPYLENE STRIP A-530 DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 15/12/2024 | |
| 20241215 | B63-C-00063 | B-DV-1605 | PROPYLENE STRIP A-530 DELUGE VALVE | (6M) Spray Test | PM | 15/12/2024 | |
| 20241215 | B63-C-00063 | B-DV-1606 | PROPYLENE RECT A-540 DELUGE VALVE | (6M) Spray Test | PM | 15/12/2024 | |
| 20241215 | B63-C-00063 | B-DV-1606 | PROPYLENE RECT A-540 DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 15/12/2024 | |
| 20241215 | B63-C-00063 | B-DV-1607 | GHU STRIPPER A-750 DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 15/12/2024 | |
| 20241215 | B63-C-00063 | B-DV-1607 | GHU STRIPPER A-750 DELUGE VALVE | (6M) Spray Test | PM | 15/12/2024 | |
| 20241215 | B63-C-00063 | B-DV-1608 | DEMETH PREFRAC A-01 DELUGE VALVE | (6M) Spray Test | PM | 15/12/2024 | |
| 20241215 | B12-C-00806 | B-DV-TRANS-SUB6 | Deluge Valve for Transformer sub 6 | (1M)Deluge Valve Visual Inspection | IM | 15/12/2024 | |
| 20241215 | B43-C-00004 | B-F-4301 | ISOMERIZATION FEED HEATER | (6M)FLAME SCANNER CLEAN & FUNCTION TEST | PM | 15/12/2024 | Furnace |
| 20241215 | B57B-C-00059 | B-G-1204A | Cooling Tower A | (2M)EXTERNAL INSPECTION | IM | 15/12/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|---|----|------------|------------|
| 20241214 | B30-C-00067 | B-PIPE1-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-126) | IM | 14/12/2024 | |
| 20241214 | B23B-C-00021 | B-PSV-93475 | PSV-93475 TO GRADE | (7)TEST & CALIBRATE(PSV 2X4) | PM | 14/12/2024 | PSV |
| 20241214 | B47D-C-00075 | B-PAV49102 | Q-4910 vent to flare control valve | (6M)LUBRICATION (GREASE 5-G-23) | PM | 14/12/2024 | |
| 20241214 | B3A-C-00012 | B-R-2401 | PD, PAN | (1M)CHECK LUBRICATING OIL | PM | 14/12/2024 | |
| 20241214 | BNA-C-00014 | B-SECUR-TASK22 | FOR PM: INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/12/2024 | |
| 20241214 | B90-C-00125 | B-SWGR-EO-FD | Groupping Tag for 6.6KV SWGR Sub#5 | (1Y) INSPECT & ADJUST | PM | 14/12/2024 | |
| 20241214 | B90-C-00119 | B-SWGR-EO-FD | Groupping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 14/12/2024 | |
| 20241213 | BH3-C-00016 | B-AT-310105 | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M)SET & CALIBRATION | PM | 13/12/2024 | |
| 20241213 | B90-C-00028 | B-AT-312001/1-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) ISO14001 SET/CALIBRATION | PM | 13/12/2024 | |
| 20241213 | B061-C-00044 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 13/12/2024 | |
| 20241213 | B061-C-00047 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 13/12/2024 | |
| 20241213 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 13/12/2024 | |
| 20241213 | B12-C-00058 | B-GS-26-F1 | DIESEL ENGINE GENERATOR SET | (18M)BATTERY REPLACEMENT | PM | 13/12/2024 | |
| 20241213 | B12-C-00056 | B-GS-26-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 13/12/2024 | |
| 20241213 | B90-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 13/12/2024 | |
| 20241213 | B90-C-00075 | B-GS-2A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 13/12/2024 | |
| 20241213 | B0PS-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 13/12/2024 | Motor |
| 20241213 | B38-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 13/12/2024 | Motor |
| 20241213 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 13/12/2024 | Pump |
| 20241213 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 13/12/2024 | Pump |
| 20241213 | B061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 13/12/2024 | Pump |
| 20241213 | B061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 13/12/2024 | Pump |
| 20241213 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 13/12/2024 | Pump |
| 20241213 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 13/12/2024 | Pump |
| 20241213 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 13/12/2024 | Pump |
| 20241213 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 13/12/2024 | Pump |
| 20241213 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 13/12/2024 | Pump |
| 20241213 | BPM-S-00006 | B-PM-3201S | QUENCH WATER PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 13/12/2024 | Motor |
| 20241213 | B19-C-00062 | B-4-S-0004P | CRACKED GAS COMPRESSOR HP CASING | (3M)WET WRAPPED DRAIN FLANGE | PM | 13/12/2024 | Compressor |
| 20241213 | BNA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/12/2024 | |
| 20241213 | B38-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/12/2024 | |
| 20241213 | B12-C-00036 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/12/2024 | |
| 20241213 | B12-C-00034 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/12/2024 | |
| 20241213 | B12-C-00037 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/12/2024 | |
| 20241212 | B0PS-S-00004 | B-CAP-M5 | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP, NOISE AND VIB | PM | 12/12/2024 | |
| 20241212 | B66-C-00088 | B-G-1132-P-1S | HIGH PRESSURE FEED PUMPS | (1M)CLEAN STRAINERS/INSPECTION | PM | 12/12/2024 | |
| 20241212 | B10P-C-00044 | B-HM-1407 | DEGORE EFFLUENT TO F-140 | (1.5)SKYCLEANING BOT/PLATE INS.(Group) | PM | 12/12/2024 | |
| 20241212 | B10-C-00043 | B-G-1176A | BIO-SLUDGE TRANSFER PUMP | (1Y)LUBRICATION | PM | 12/12/2024 | Pump WWT |
| 20241212 | B00-C-00092 | B-P-1176B | BIO-SLUDGE TRANSFER PUMP | (1Y)LUBRICATION | PM | 12/12/2024 | Pump WWT |
| 20241212 | B00-C-00055 | B-PIPE1-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-046) | IM | 12/12/2024 | |
| 20241212 | B30A-S-00002 | B-R-575A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (1M)INSPECTION & CLEAN | PM | 12/12/2024 | |
| 20241212 | B0-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (NUNGNATE) | (1D)INSPECTION | PM | 12/12/2024 | Inspection |
| 20241212 | B0-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYARIN) | (1D)INSPECTION | PM | 12/12/2024 | Inspection |
| 20241212 | B0-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (1D)INSPECTION | PM | 12/12/2024 | Inspection |
| 20241212 | B0-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 12/12/2024 | Inspection |
| 20241212 | BNA-C-00012 | B-SECUR-TASK20 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/12/2024 | |
| 20241212 | B063-WK-0002 | B-P-1601A | FOR PM: INSPECTION AND CHECK MOBILE GENE | (1M)INSPECTION | PM | 12/12/2024 | |
| 20241212 | B07-C-00008 | B-T-376B | HP DEPROPAIZER CONDENSER | (3M) CONDITION CHECK (OSL 2020-045) | IM | 12/12/2024 | |
| 20241211 | B07-C-00004 | B-AT-3600C | CG DEHYDRATORS BEDS | (1M)MOISTURE ANALYZER AMETEK | PM | 11/12/2024 | |
| 20241211 | B60-B-00002 | B-G-1122-R-1S | HIGH PRESSURE AIR COMPRESSOR | (8000 Hrs) PISTON &PISTON ROD INSPECTION | PM | 11/12/2024 | Compressor |

| | | | | | | | |
|----------|--------------|----------------|---|--|----|------------|------------|
| 20241211 | B63-C-00094 | B-HY-1634 | HYDRANT AREA COLD | (6M)HY TANK LUBRICATION | PM | 11/12/2024 | Inspection |
| 20241211 | B63-C-00094 | B-HY-1635 | HYDRANT AREA COLD | (6M)HY TANK LUBRICATION | PM | 11/12/2024 | Inspection |
| 20241211 | B63-C-00094 | B-HY-1636 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 11/12/2024 | Inspection |
| 20241211 | B63-C-00094 | B-HY-1637 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 11/12/2024 | Inspection |
| 20241211 | B3-C-00016 | B-H-19014 | GROUPING TAG FOR FR CLUC HP STM TO OLEFIN | (3M)SET & CALIBRATION. | PM | 11/12/2024 | |
| 20241211 | B38-C-00121 | B-MG-401-P-1A | EXPENDER OIL PUMP MOTOR | (3M)VISUAL INSPECTION AND RECORD | PM | 11/12/2024 | |
| 20241211 | B42B-C-00015 | B-MR-600-P-1A | CZR CONDENSER COND. PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/12/2024 | |
| 20241211 | B42B-C-00015 | B-MR-600-P-2A | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/12/2024 | |
| 20241211 | B42B-C-00015 | B-MR-600-P-2S | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/12/2024 | |
| 20241211 | B01B-C-00001 | B-PM-1570A | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/12/2024 | Motor |
| 20241211 | B01B-C-00001 | B-PM-1570B | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/12/2024 | Motor |
| 20241211 | B01B-C-00003 | B-PM-1570S | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/12/2024 | Motor |
| 20241211 | B01C-C-00002 | B-PT-19192 | PRESSURE TRANSMITTER FOR C2H4 METER SKID | (4M)SET & CALIBRATE | PM | 11/12/2024 | |
| 20241211 | B01C-C-00003 | B-PT-19192 | TEMP. TRANSMITTER FOR C2H4 METER SKID | (4M)SET & CALIBRATE | PM | 11/12/2024 | |
| 20241211 | B38-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/12/2024 | |
| 20241211 | B47D-C-00032 | B-V-1540-P-1A | MAIN OIL PUMP | (1Y)CLEANING | PM | 11/12/2024 | |
| 20241211 | B73-S-00006 | B-V-267-P-1S | POLYMERIZATION INHIBITOR INJECTION PUMP | (6M)CLEAN STRAINER | PM | 11/12/2024 | |
| 20241210 | B12-C-00070 | B-AT-430303 | BUTENE-1 GCG | (1M)SET/CALIBRATE | PM | 10/12/2024 | |
| 20241210 | B13-S-00013 | B-BU-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B13-S-00014 | B-BU-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B13-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B13-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00052 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00053 | B-BU-BC-110-1 | BATTERY UNIT FOR 110VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00056 | B-BU-BC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00054 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.2 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00055 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.PROCESS | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00057 | B-BU-CG | BATTERY UNIT FOR 110VDC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00058 | B-BU-UPS | BATTERY UNIT FOR 220VAC BANK-5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00062 | B-BU-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00060 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B90-S-00061 | B-BU-UPS-2 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/12/2024 | |
| 20241210 | B63-C-00104 | B-DV-1625A | UPG STORAGE TX Q-1520 DELUGE VALVE | (6M)OV TANK LUBRICATION & INSPECTION | IM | 10/12/2024 | |
| 20241210 | B63-C-00104 | B-DV-1625B | UPG STORAGE TX Q-1520 DELUGE VALVE | (6M)OV TANK LUBRICATION & INSPECTION | IM | 10/12/2024 | |
| 20241210 | B63-C-00104 | B-DV-1626A | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M)OV TANK LUBRICATION & INSPECTION | IM | 10/12/2024 | |
| 20241210 | B63-C-00104 | B-DV-1626B | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M)OV TANK LUBRICATION & INSPECTION | IM | 10/12/2024 | |
| 20241210 | B63-C-00104 | B-DV-1626C | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M)OV TANK LUBRICATION & INSPECTION | IM | 10/12/2024 | |
| 20241210 | B63-C-00104 | B-DV-1626D | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M)OV TANK LUBRICATION & INSPECTION | IM | 10/12/2024 | |
| 20241210 | B12-C-00372 | B-DV-48001 | OV For Transformer #1 | (6M)SPRAY TEST | PM | 10/12/2024 | |
| 20241210 | B12-C-00372 | B-DV-48002 | OV For Transformer #2 | (6M)SPRAY TEST | PM | 10/12/2024 | |
| 20241210 | B12-C-00372 | B-DV-48003 | OV For Transformer #3 | (6M)SPRAY TEST | PM | 10/12/2024 | |
| 20241210 | B0P-C-00003 | B-G-3100 | ELEVATOR | (1M)INSPECTION AND FUNCTION TEST | PM | 10/12/2024 | |
| 20241210 | B90-S-00027 | B-HYDRAULIC-01 | HYDRAULIC STATIC PRESS. 30 T | (1M)LUBRICATION & INSPECTION | PM | 10/12/2024 | |
| 20241210 | B0P-C-00002 | B-M-19028 | GROUPING TAG FOR PY GAS TO ASC/TTT | (4M)SET & CALIBRATE | PM | 10/12/2024 | |
| 20241210 | B0P-C-00003 | B-MOTOR-EO-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 10/12/2024 | Motor |
| 20241210 | BMR-1602A | B-MR-701A | RECYCLE H2 COMPRESSOR | RCM(3M) GREASE DESKCHECK OIL LEVEL MOTOR | PM | 10/12/2024 | Motor |
| 20241210 | BMR-1602S | B-MR-701A | RECYCLE H2 COMPRESSOR | RCM(3M) GREASE DESKCHECK OIL LEVEL MOTOR | PM | 10/12/2024 | Motor |
| 20241210 | B90-C-00168 | B-D0SG15 | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/12/2024 | |
| 20241210 | B63-S-00014 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | RCM(3M)REGREASE COUPLING | PM | 10/12/2024 | Pump |

| | | | | | | | |
|----------|---------------|------------------|--|--|----|------------|------------|
| 20241210 | B63-S-00015 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | RCM(3M)REGREASE COUPLING | PM | 10/12/2024 | Pump |
| 20241210 | B33-C-00033 | B-P-221S | DEMINERALIZED WATER MAKE-UP PUMP | (1Y)CLEANING | PM | 10/12/2024 | Pump |
| 20241210 | BNA-C-00010 | B-SECUR-TASK18 | INSPECTION FIRE ALARM STATION | (1M)INSPECTION | PM | 10/12/2024 | |
| 20241210 | B30-C-00002 | B-SECUR-TASK43 | INSPECTION MOBILE FOAM U | (1M)INSPECTION | PM | 10/12/2024 | |
| 20241210 | BH11S-C-00001 | B-XV-330101 | SH STM TO R3301-PT-A10 | RCA (1M) CLEANUP/INSPECTION | PM | 10/12/2024 | |
| 20241209 | B091-C-00001 | B-AT-1110/1900 | PGC EFFLUENT FROM F-110F/190 | (1M)SET & CALIBRATION | PM | 9/12/2024 | |
| 20241209 | B49F-C-00007 | B-AT-1900GA | ETHANE FEED | (2M)SET & CALIBRATION (OUT-SOURCE) | PM | 9/12/2024 | |
| 20241209 | B0P7-C-00086 | B-AT-310X01A/1-3 | GROUPING TAG CENS F-3101 to F-3103 | (1M)SET/CALIBRATION | PM | 9/12/2024 | |
| 20241209 | B0P7-C-00086 | B-AT-310X01B/4-6 | GROUPING TAG CENS F-3104 to F-3106 | (1M)SET/CALIBRATION | PM | 9/12/2024 | |
| 20241209 | B60-S-00001 | B-G-1122-P-1A | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/12/2024 | |
| 20241209 | B60-S-00002 | B-G-1122-P-1S | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/12/2024 | |
| 20241209 | B051-C-00021 | B-G-1132-V-1 | NEW AERATION TANK | (3M) CONDITION CHECK (OSL 2023-272) | IM | 9/12/2024 | |
| 20241209 | B12-S-00004 | B-G-4803-P-2A | SCALE DISPERSANT INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 9/12/2024 | |
| 20241209 | BH3-C-00027 | B-HV-310113 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | BH3-C-00026 | B-HV-310114 | MOTOR OPERATED DECKING VALVE OF F-3101 | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | BH4-C-00023 | B-HV-310213 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | BH4-C-00024 | B-HV-310214 | MOTOR OPERATED DECKING VALVE OF F-3102 | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | BH5-C-00023 | B-HV-310313 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | BH5-C-00022 | B-HV-310314 | MOTOR OPERATED DECKING VALVE OF F-3103 | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | BH5-C-00023 | B-HV-310413 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | BH5-C-00024 | B-HV-310414 | MOTOR OPERATED DECKING VALVE OF F-3104 | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | B-HV-310513 | B-HV-310513 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | B-HV-310514 | B-HV-310514 | MOTOR OPERATED DECKING VALVE OF F-3105 | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | B90-C-00014 | B-HV-310640A | ELECTRICPOWER (F-3106 CRACKED GAS MOVES) | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | B90-C-00015 | B-HV-310640B | ELECTRICPOWER (F-3106 CRACKED GAS MOVES) | (3M)Collect Torque Profile & Record | IM | 9/12/2024 | |
| 20241209 | B6P-C-00014 | B-H-19018 | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2M)UPDATE N2, CO2, REL DENSITY | PM | 9/12/2024 | |
| 20241209 | B060-C-00058 | B-P-1123A | SULFURIC ACID TRANSFER PUMP | (3M) CONDITION CHECK (OSL 2023-268) | IM | 9/12/2024 | Pump |
| 20241209 | B52A-C-00022 | B-P-1201A | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2020-078) | IM | 9/12/2024 | Pump |
| 20241209 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly Pit suction screen cleaning | PM | 9/12/2024 | Pump |
| 20241209 | B03-C-00010 | B-P-5668 | DEBUTANIZER REFLUX/PRODUCT PUMPS | (3M) CONDITION CHECK (OSL 2023-271) | IM | 9/12/2024 | Pump |
| 20241209 | B001-C-00033 | B-P-901C | SHIP BFW PUMPS | (3M) CONDITION CHECK (OSL 2020-029) | IM | 9/12/2024 | Pump |
| 20241209 | B001-C-00033 | B-P9E1-04S | LINE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-267) | IM | 9/12/2024 | |
| 20241209 | B00C-00001 | B-TRAP-050 | LINE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-027) | IM | 9/12/2024 | |
| 20241209 | B49C-C-00017 | B-Q-1515 | NG STORAGE TANK | (3M) CONDITION CHECK (OSL 2023-269) | IM | 9/12/2024 | Tank |
| 20241209 | B15A-WK-0001 | B-R-300-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 9/12/2024 | |
| 20241209 | B42B-WK-0001 | B-R-600-PT-15 | C2R SURFACE CONDENSER COND.TURBINE | (2W)REGREASE & INSPECTION | PM | 9/12/2024 | |
| 20241209 | B43B-WK-0001 | B-R-650-PT-15 | C3R COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 9/12/2024 | |
| 20241209 | B18A-C-00032 | B-RT-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (3M) CONDITION CHECK (OSL 2020-025) | IM | 9/12/2024 | Compressor |
| 20241209 | B06B-C-00004 | B-SOH-270 | DESUPERHEATER OF DILUTION STEAM TO PURVA | (3M) CONDITION CHECK (OSL 2020-026) | IM | 9/12/2024 | |
| 20241209 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 9/12/2024 | |
| 20241209 | BNA-C-00009 | B-SECUR-TASK17 | INSPECTION FOAM STORAGE TANK, FOA | (1W)INSPECTION | PM | 9/12/2024 | |
| 20241209 | B47B-C-00053 | B-T-1534 | PROPYLENE VAPORIZER | (3M) CONDITION CHECK (OSL 2020-024) | IM | 9/12/2024 | |
| 20241209 | B47A-C-00051 | B-T-3303B | DILUTION STEAM RECOLLER | (3M) CONDITION CHECK (OSL 2023-273) | IM | 9/12/2024 | |
| 20241209 | B00C-000123 | B-TRAP-050 | GROUPING STEAM TRAP AREA 050 | (3M) CONDITION CHECK (OSL 2023-270) | IM | 9/12/2024 | |
| 20241209 | B00C-000125 | B-TRAP-050 | GROUPING STEAM TRAP AREA 050 | (3M) CONDITION CHECK (OSL 2023-275) | IM | 9/12/2024 | |
| 20241209 | B00C-000124 | B-VALVEFL-5M | VALVE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-274) | IM | 9/12/2024 | |
| 20241208 | BNA-C-00075 | B-DV-1666 | DELUGE VALVE FOR SUB85/TRKT 1A | (6M) Spray Test | PM | 8/12/2024 | |
| 20241208 | BNA-C-00076 | B-DV-1667 | DELUGE VALVE FOR SUB85/TRKT 2A | (6M) Spray Test | PM | 8/12/2024 | |
| 20241208 | BNA-C-00077 | B-DV-1668 | DELUGE VALVE FOR Q-4910 | (6M) Spray Test | PM | 8/12/2024 | |
| 20241208 | BNA-C-00073 | B-DV-1669A | DELUGE VALVE FOR Q-4910 | (6M) Spray Test | PM | 8/12/2024 | |

| | | | | | | | |
|----------|---------------|---------------------|--|--|------------|-----------|------------|
| 20241207 | B52B-S-000027 | B-G-1200-P-1S | CW CORROSION INHIBITION PUMP | (V)VISUAL INSPECTION, CLEAN, LUBRICATE | PH | 7/12/2024 | |
| 20241207 | B43C-S-00001 | B-G-620-FT-1A | C2R/C3R LUBE OIL TURBINE | (M)LUBRICATE & INSPECTION | PH | 7/12/2024 | |
| 20241207 | B42B-C-00007 | B-MR-600-P-2A | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(V)INSPECTION | PH | 7/12/2024 | |
| 20241207 | B31-C-00039 | B-P-710A | GHU 1ST STAGE QUENCH PUMP | (V)LUBRICATION & CLEANING | Pump | 7/12/2024 | |
| 20241207 | B51B-C-00015 | B-PSV-9310S | LP STEAM TO G-931 | (V)SET & CALIBRATE (PSV 3/4X1) | PSV | 7/12/2024 | |
| 20241207 | B053-C-00005 | B-Q-2215 | DEMINEALIZED WATER STORAGE TANK | (3M) CONDITION CHECK (OSL 2021-088) | IM | 7/12/2024 | |
| 20241207 | B10K-S-00001 | B-R-1010 | FURNACE ID FANS | RCM-(6M)ID Fan Lubricate, Inspection | PH | 7/12/2024 | |
| 20241207 | B10L-S-00001 | B-R-1020 | FURNACE ID FANS | RCM-(6M)ID Fan Lubricate, Inspection | PH | 7/12/2024 | |
| 20241207 | B10S-S-00001 | B-R-170 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate, Inspection | PH | 7/12/2024 | |
| 20241207 | B10M-S-00001 | B-R-180 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate, Inspection | PH | 7/12/2024 | |
| 20241207 | B10J-S-00001 | B-R-190 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate, Inspection | PH | 7/12/2024 | |
| 20241207 | B47B-C-00007 | B-R-600-P-2A | C2R COMPRESSOR CONDENSATE VACUUM PUMP | (V)CLEANING | Compressor | 7/12/2024 | |
| 20241207 | B43B-C-00008 | B-R-605-P-2A | C3R COMPRESSOR CONDENSATE VACUUM PUMP | (V)CLEANING | Compressor | 7/12/2024 | |
| 20241207 | BNA-C-00007 | B-SECUR-TASK15 | FOR PM: INSPECTION HALON FIRE EXTINGUISHER | (1M)INSPECTION | PH | 7/12/2024 | |
| 20241207 | BNA-C-00007 | B-SECUR-TASK1529 | FOR PM:MANUAL STATION TEST (ADMIN AREA) | (1M)INSPECTION | PH | 7/12/2024 | |
| 20241207 | B90-C-00118 | B-SWGR-EO-ED | Grouping Tag for 6.6KV SWGR SUB#5 | (3M) INSPECT & ADJUST | PH | 7/12/2024 | |
| 20241207 | B02S-C-00013 | B-T-378A | C2 HYDROGENATION FEED HEATER | (3M) CONDITION CHECK (OSL 2021-082) | IM | 7/12/2024 | |
| 20241207 | B3A-C-00009 | B-TR-01 | DISTRIBUTION TRANSFORMER | (1M)CONDITION CHECK | PH | 7/12/2024 | |
| 20241207 | B03I-C-00026 | B-ANALYZER-O214/1 | GROUPING FOR OXYGEN ANALYZER PLANT#1/1 | (1M)SET & CALIBRATE | PH | 7/12/2024 | |
| 20241207 | B08I-C-00002 | B-AT-1200/1800 | PGC EFFLUENT FROM F-120/F-180 | (1M)SET & CALIBRATION | PH | 6/12/2024 | |
| 20241207 | B09I-C-00003 | B-AT-1300/1400/1150 | PGC EFFLUENT FROM F-130/F-140/F-150 | (1M)SET & CALIBRATION | PH | 6/12/2024 | |
| 20241207 | B08I-C-00004 | B-AT-1600/1700 | PGC EFFLUENT FROM F-160/F-1700 | (1M)SET & CALIBRATION | PH | 6/12/2024 | |
| 20241207 | B44F-C-00003 | B-AT-1905A | CO2 ANALYZER IN ETHANE FEED FROM PTT | (2M)CALIBRATE INFRAREDESENSOR/OUT-SOURCE | PH | 6/12/2024 | |
| 20241207 | B03S-C-00002 | B-AT-800 | BUTADIENE HYDRD. INLETS/OUTLET | (1M)SET&CALIBRATE | PH | 6/12/2024 | |
| 20241207 | B06I-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PH | 6/12/2024 | |
| 20241207 | B06I-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PH | 6/12/2024 | |
| 20241207 | B06I-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PH | 6/12/2024 | |
| 20241207 | B12-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PH | 6/12/2024 | |
| 20241207 | B13-S-00002 | B-GS-2E-F2 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PH | 6/12/2024 | |
| 20241207 | B05I-C-00018 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PH | 6/12/2024 | |
| 20241207 | B11-S-00012 | B-MCC-ORP | Grouping For MCC ORP | (3M)INSPECT&CONDITION CHECK | PH | 6/12/2024 | |
| 20241207 | B0PS-S-00002 | B-MOTOR-EO-007 | GROUPING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | Motor | 6/12/2024 | |
| 20241207 | B0PS-S-00005 | B-MOTOR-EO-012 | GROUPING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | Motor | 6/12/2024 | |
| 20241207 | B90-C-00170 | B-OSAVR | GROUPING FOR 115KV AVR | (1M)VISUAL INSPECT&RECORD DATA | PH | 6/12/2024 | |
| 20241207 | B90-C-00171 | B-OSGVS | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PH | 6/12/2024 | |
| 20241207 | B06I-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | Pump | 6/12/2024 | |
| 20241207 | B06I-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | Pump | 6/12/2024 | |
| 20241207 | B06I-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | Pump | 6/12/2024 | |
| 20241207 | B06I-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | Pump | 6/12/2024 | |
| 20241207 | B32A-C-00029 | B-P-1201A | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2022-182) | IM | 6/12/2024 | |
| 20241207 | B063-WX-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PH | 6/12/2024 | |
| 20241207 | B063-WX-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | Pump | 6/12/2024 | |
| 20241207 | B063-WX-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | Pump | 6/12/2024 | |
| 20241207 | B063-WX-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | Pump | 6/12/2024 | |
| 20241207 | B063-WX-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | Pump | 6/12/2024 | |
| 20241207 | B00A-C-00093 | B-PIPEL-SCIL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-183) | IM | 6/12/2024 | |
| 20241207 | B47B-C-00032 | B-R-600-P-1S | C2R COMPRESSOR CONDENSATE PUMP | (3M) CONDITION CHECK (OSL 2022-185) | IM | 6/12/2024 | Compressor |
| 20241207 | B12-C-00769 | B-VALVE-P3 | CRACKED GAS COMPRESSION TURBINE DRIVER | B-AT-300 | PH | 6/12/2024 | Compressor |
| 20241207 | B12-C-00769 | B-VALVE-P3 | VALVE PROCESS OLE 2-3 | (1M) CHECK VOCS | IM | 6/12/2024 | |
| 20241207 | BNA-C-00062 | B-CALT-EO-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2M)Visual & Condition Inspection | PH | 5/12/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|-----------|------------|
| 20241203 | B01E-C-00029 | B-M-310 | CG 1ST STAGE STATION DRUM | (3M) CONDITION CHECK (OSL 2022-190) | IM | 3/12/2024 | |
| 20241203 | B90-C-00177 | B-MOTOR-B1-1237BC | MOTOR GROUPING FOR B1-BC | (1M)CLEANING & INSPECTION | PH | 3/12/2024 | Motor |
| 20241203 | B90-C-00179 | B-MOTOR-B1-1237BC | MOTOR GROUPING FOR B1-BC | (6M)MOTOR WINDING INSULATION RESISTANCE | PH | 3/12/2024 | Motor |
| 20241203 | B90-C-00178 | B-MOTOR-B1-7A | MOTOR GROUPING FOR B1-A | (1M)CLEANING & INSPECTION | PH | 3/12/2024 | Motor |
| 20241203 | B90-C-00174 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BEU-A | (1M)CLEANING & INSPECTION | PH | 3/12/2024 | Motor |
| 20241203 | B90-C-00176 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BEU-A | (6M)MOTOR WINDING INSULATION RESISTANCE | PH | 3/12/2024 | Motor |
| 20241203 | B90-C-00175 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BEU-A | (3M)LUBRICATION | PH | 3/12/2024 | Motor |
| 20241203 | B90-C-00183 | B-MOTOR-BE-0BC | MOTOR GROUPING FOR BEU-BC | (1M)CLEANING AND INSPECTION | PH | 3/12/2024 | Motor |
| 20241203 | B90-C-00186 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-8BC | (1M)CLEANING AND INSPECTION | PH | 3/12/2024 | Motor |
| 20241203 | B00-C-00096 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-195) | IM | 3/12/2024 | |
| 20241203 | B00-C-00094 | B-PIPEL-8D | LINE BLOWDOWN HYDROCARBON & WATER OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-187) | IM | 3/12/2024 | |
| 20241203 | B47E-C-00001 | B-PSV-15501 | ISO14000SAFETY VALVE OF Q-1550 | (V)INSPECT & ADJUST | PH | 3/12/2024 | PSV |
| 20241203 | B05I-C-00001 | B-R-624 | COMPRESSOR | (6M)INSPECT | PH | 3/12/2024 | Compressor |
| 20241203 | B90-C-00250 | B-SD-BC-1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.1 | (2M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B90-C-00250 | B-SD-BC-2 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.2 | (2M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B90-C-00251 | B-SD-BC-2M1 | DISTRIBUTION PANEL OF BC 110VDC SUB.7 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B90-C-00250 | B-SD-BC-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B90-C-00250 | B-SD-BC-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B48-C-00015 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B00S-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.6 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B00S-C-00011 | B-SD-F2 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B05I-C-00011 | B-SD-F3 | DISTRIBUTION PANEL OF BC 24VDC SUB.6 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B90-C-00251 | B-SD-UPS-2M1 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B90-C-00251 | B-SD-UPS-2M2 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PH | 3/12/2024 | |
| 20241203 | B60-C-00040 | B-SPEAKER-ES-001 | GROUPING TAG FOR SPEAKER/HORN FOLLOW TA | (3M)INTERCOMME FUNCTION TEST | PH | 3/12/2024 | |
| 20241203 | B90-C-00123 | B-SWGR-EO-D0 | Grouping Tag for 6.6KV SWGR SUB#5 | (1Y) INSPECT & ADJUST | PH | 3/12/2024 | |
| 20241203 | B10C-C-00040 | B-T-131 | TLX QUENCH EXCHANGER | (3M) CONDITION CHECK (OSL 2022-191) | PH | 3/12/2024 | |
| 20241203 | B12-C-00059 | B-UPS-2EE-BV | GROUPING FOR UPS 220 KVA | (1M)INSPECT & ADJUST | PH | 3/12/2024 | |
| 20241203 | B00C-C-00095 | B-VALVE-P1 | VALVE PROCESS OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-194) | IM | 3/12/2024 | |
| 20241203 | B00C-C-00094 | B-VALVE-SCIL | VALVE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-192) | IM | 3/12/2024 | |
| 20241203 | B05I-C-00012 | B-G-1477A | INSTRUMENT AIR DRYER | (1Y)CHANGE PRE AND AFTE FILTER ELEMENT | PH | 2/12/2024 | |
| 20241203 | B05I-C-00012 | B-G-1477S | INSTRUMENT AIR DRYER | (1Y)CHANGE PRE AND AFTE FILTER ELEMENT | PH | 2/12/2024 | |
| 20241203 | B05I-C-00013 | B-G-1478A | INSTRUMENT AIR DRIERS | (1Y)CHANGE PRE AND AFTE FILTER ELEMENT | PH | 2/12/2024 | |
| 20241203 | B05I-C-00017 | B-G-1478A | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PH | 2/12/2024 | |
| 20241203 | B05I-C-00017 | B-G-1478S | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PH | 2/12/2024 | |
| 20241203 | B05I-C-00013 | B-G-1478S | INSTRUMENT AIR DRIERS | (1Y)CHANGE PRE AND AFTE FILTER ELEMENT | PH | 2/12/2024 | |
| 20241203 | B0PS-C-00023 | B-M-1900A | GROUPING TAG FOR HP PROPYLENE TO IRPC | (4M)SET & CALIBRATE | PH | 2/12/2024 | |
| 20241203 | B11-S-00010 | B-MOTOR-ORP | Grouping For Motor ORP | (1M)VISUAL INSPECT | PH | 2/12/2024 | Motor |
| 20241203 | B61-S-00001 | B-P-1137A | HERATION TANK FEED PUMP | (3M)CLEANING | PH | 2/12/2024 | Pump |
| 20241203 | B61-S-00001 | B-P-1137S | HERATION TANK FEED PUMP | (3M)CLEANING | PH | 2/12/2024 | Pump |
| 20241203 | B063-WX-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-PRE suction screen cleaning | PH | 2/12/2024 | Pump |
| 20241203 | B49-C-00001 | B-PDI-11098 | WWT OFF GAS TO FLARE | (1Y)CHECK & ADJUST (OUT-SOURCE) | PH | 2/12/2024 | |
| 20241203 | B49-C-00001 | B-PDI-13501 | DP ACROSS SFP-13501 | (1Y)CHECK & ADJUST (OUT-SOURCE) | PH | 2/12/2024 | |
| 20241203 | B47D-C-00002 | B-PDI-15408 | Q-1540 TO LP FLARE | (1Y)CHECK & ADJUST (OUT-SOURCE) | PH | 2/12/2024 | |
| 20241203 | B06A-C-00006 | B-PIPEL-OS | LINE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-049) | IM | 2/12/2024 | |
| 20241203 | B43-C-00030 | B-R-3101 | ETHYLENE FURNACE ID FAN#1 | (1M) Visual inspection | PH | 2/12/2024 | |
| 20241203 | B44-C-00027 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | (1M) Visual inspection | PH | 2/12/2024 | |
| 20241203 | B11S-C-00026 | B-R-3103 | ETHYLENE FURNACE ID FAN#3 | (1M) Visual inspection | PH | 2/12/2024 | |
| 20241203 | B06A-C-00003 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (1M) Visual inspection | PH | 2/12/2024 | |
| 20241203 | B17-C-00028 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (1M) Visual inspection | PH | 2/12/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|-------------------------------------|----|-----------|---------|
| 20241205 | B43C-C-00008 | B-MR-600-P-4A | C2R OIL PURIFIER PUMP MOTOR | RCM-(M)VISUAL CHECK | PM | 5/12/2024 | |
| 20241205 | B47C-C-00012 | B-PSV-15507 | W/EMERGENCY VENT Q-1550 | (V)PSV Function Test On-Site | PM | 5/12/2024 | PSV |
| 20241205 | B9C-S-00002 | B-PT-1501A | FRN FEED PUMP TURBINE | (6M)LUBRICATION | PM | 5/12/2024 | |
| 20241205 | B1-S-00011 | B-PT-901A | UP BOILER FEED WATER PUMP TURBINE | (6M)CHANGE LUBE OIL GOVERNOR | PM | 5/12/2024 | |
| 20241205 | B10A-S-00001 | B-R-110 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/12/2024 | |
| 20241205 | B10B-S-00001 | B-R-120 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/12/2024 | |
| 20241205 | B10C-S-00001 | B-R-130 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/12/2024 | |
| 20241205 | B10D-S-00001 | B-R-140 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/12/2024 | |
| 20241205 | B10E-S-00001 | B-R-150 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/12/2024 | |
| 20241205 | B10F-S-00001 | B-R-160 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/12/2024 | |
| 20241205 | B43C-C-00008 | B-R-600-P-4A | LUBE OIL PURIFIER | RCM-(M)VISUAL INSPECTION | PM | 5/12/2024 | |
| 20241205 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NOI (NUNGNATE) | (10)INSPECTION | PM | 5/12/2024 | |
| 20241205 | B20-C-00003 | B-SECUR-TASK03B | FOR PM: CHECK A WATER TRUCK(SATYVARIN) | (10)INSPECTION | PM | 5/12/2024 | |
| 20241205 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK AMBULANCE(DITRUKSA) | (10)INSPECTION | PM | 5/12/2024 | |
| 20241205 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (10)INSPECTION | PM | 5/12/2024 | |
| 20241205 | BNA-C-00024 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2M)INSPECTION | PM | 5/12/2024 | |
| 20241205 | B90-C-00094 | B-UPS1-A1 | UPS1 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/12/2024 | |
| 20241205 | B90-C-00095 | B-UPS1-A2 | UPS(BYPASS) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/12/2024 | |
| 20241205 | B90-C-00096 | B-UPS1-A3 | UPS2 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/12/2024 | |
| 20241204 | B13-C-00033 | B-CAP-1M1 | POWER CAPACITOR PANEL-1 | (1M)VISUAL INSPECTION | PM | 4/12/2024 | |
| 20241204 | B13-C-00034 | B-CAP-1M2 | POWER CAPACITOR PANEL-2 | (1M)VISUAL INSPECTION | PM | 4/12/2024 | |
| 20241204 | B13-C-00057 | B-EHT-001 | ELECTRICAL HEAT TRACING CONTROL PANEL | (1M)VISUAL INSPECTION | PM | 4/12/2024 | |
| 20241204 | B63-C-00093 | B-HY-1630 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 4/12/2024 | |
| 20241204 | B63-C-00093 | B-HY-1631 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 4/12/2024 | |
| 20241204 | B63-C-00093 | B-HY-1632 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 4/12/2024 | |
| 20241204 | B63-C-00093 | B-HY-1633 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 4/12/2024 | |
| 20241204 | B3S-C-00002 | B-MOTOR-EP-NPA-003 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING | PM | 4/12/2024 | Motor |
| 20241204 | B61-S-00019 | B-P-1149A | BIO-SLUDGE TRANSFER PUMP | (6M)CLEANING | PM | 4/12/2024 | Pump |
| 20241204 | B61-S-00041 | B-P-1149S | BIO-SLUDGE TRANSFER PUMP | (6M)CLEANING & LUBRICATE | PM | 4/12/2024 | Pump |
| 20241204 | B20-C-00001 | B-SECUR-TASK41 | VISUAL INSPECTION CO2 SYSTEM MA | (1M)INSPECTION | PM | 4/12/2024 | |
| 20241204 | B13-C-00058 | B-SUZ-FRMC3 | ELECTRICAL REMOTE MONITORING & CONTROL S | (1M)VISUAL INSPECTION | PM | 4/12/2024 | |
| 20241204 | B007-S-00001 | B-SWGR-SUB01 | Grouping for 6.6 KV SWGR/MCC SUB3 | (3M)INSPECT & CONDITION CHECK | PM | 4/12/2024 | |
| 20241204 | B007-S-00001 | B-SWGR-SUB01 | Grouping for 6.6 KV SWGR/MCC SUB 4 | (3M)INSPECT & CONDITION CHECK | PM | 4/12/2024 | |
| 20241203 | B53-C-00037 | B-AT-22177 | ISO14000 RPT DISCHARGE LINE G-2217-P-4A/B | (1M)SET&CALIBRATE | PM | 3/12/2024 | |
| 20241203 | B12-C-00663 | B-AT-400001 | 1, 3 Butadiene in Air GCG | (1M)SET&CALIBRATE | PM | 3/12/2024 | |
| 20241203 | B12-C-00667 | B-AT-404801 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 3/12/2024 | |
| 20241203 | B007-C-00003 | B-AT-9211 | ISO14000, SUMP Q-920 TO Q-1145 | (1M)SET&CALIBRATE | PM | 3/12/2024 | |
| 20241203 | B00C-C-00011 | B-DCS-P1 | DCS HONEYWELL TDC3000&EXPERION | (4M)SWITCH OVER SERVER | PM | 3/12/2024 | |
| 20241203 | B00C-C-00011 | B-DCS-P1-ORP | DCS HONEYWELL C300 EXPERION RS11.1 | (4M)SWITCH OVER SERVER | PM | 3/12/2024 | |
| 20241203 | B12-C-00673 | B-DCS-P3 | DCS HONEYWELL C300 EXPERION | (2M)REMOVE HISTORY FILE | PM | 3/12/2024 | |
| 20241203 | B96C-C-00002 | B-EF-11 | MASTER FIRE ALARM PANEL AT NEW CCB CONTR | (1M)CO2 SYSTEM CHECK | PM | 3/12/2024 | |
| 20241203 | B96C-C-00002 | B-EF-12 | LOCAL FIRE ALARM PANEL AT SUB.2 | (1M)CO2 SYSTEM CHECK | PM | 3/12/2024 | |
| 20241203 | B96C-C-00002 | B-EF-13 | LOCAL FIRE ALARM PANEL AT SUB. PROCESS | (1M)CO2 SYSTEM CHECK | PM | 3/12/2024 | |
| 20241203 | B10K-C-00051 | B-F-1010 | USC PYROLYSIS FURNACE | (3M) CONDITION CHECK (OSL 2022-193) | IN | 3/12/2024 | Furnace |
| 20241203 | B10K-C-00044 | B-F-1010 | USC PYROLYSIS FURNACE | (3M) CONDITION CHECK (OSL 2021-110) | IN | 3/12/2024 | Furnace |
| 20241203 | B10E-C-00043 | B-F-120 | USC FURNACES | (3M) CONDITION CHECK (OSL 2021-062) | IN | 3/12/2024 | Furnace |
| 20241203 | B10K-C-00045 | B-F-170 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-192) | IN | 3/12/2024 | Furnace |
| 20241203 | BNA-C-00051 | B-GC-1M | GROUPING FOR PM GC 1 Month | (1M)SET & CALIBRATION | PM | 3/12/2024 | |
| 20241203 | B4B-C-00020 | B-IRP-BV | IRP GROUPING FOR BV | (1M)INSPECTION | PM | 3/12/2024 | |
| 20241203 | B09C-C-00064 | B-HM-19020 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1M)UPDATE NZ, CO2, REL. DENSITY | PM | 3/12/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|---|----|------------|------------|
| 20241201 | B00-C-00100 | B-PIPEL-SL | LINE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-202) | IM | 1/12/2024 | |
| 20241201 | B08-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (SM) LUBRICATION | PM | 1/12/2024 | |
| 20241201 | B133-C-00013 | B-PV-384102A | HPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/12/2024 | |
| 20241201 | B52A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/12/2024 | |
| 20241201 | B298-C-00016 | B-R-575A | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/12/2024 | Compressor |
| 20241201 | B050-C-00007 | B-S-1301 | Demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/12/2024 | |
| 20241201 | BNA-C-00033 | B-SECUR-TASK48 | FOR PM : INSPECTION PM-200 SYSTEMS | (1M) Visual Inspection PM-200 system (RA) | PM | 1/12/2024 | |
| 20241201 | B00-C-00068 | B-SECUR-TASK51 | Smoke / Heat detector system : Control A | (1M) Visual Inspection | PM | 1/12/2024 | |
| 20241201 | B32A-C-00100 | B-SM-2322 | FLUXE 87 Industrial Fluorimeter | (1M) CALIBRATION STANDARD EQ (OUT-SOURCE) | PM | 1/12/2024 | |
| 20241201 | B32-C-00101 | B-SM-1002 | FLUXE 8725 Process Calibrator | (1M) CALIBRATION STANDARD EQ (OUT-SOURCE) | PM | 1/12/2024 | |
| 20241201 | B32-C-00104 | B-SM-1102 | FLUXE 789 Process Meter | (1M) CALIBRATION STANDARD EQ (OUT-SOURCE) | PM | 1/12/2024 | |
| 20241201 | B32-C-00106 | B-SM-1202 | FLUXE 52 Thermometer Calibrator | (1M) CALIBRATION STANDARD EQ (OUT-SOURCE) | PM | 1/12/2024 | |
| 20241201 | B12-C-00352 | B-SWGR-HV-BV | SWGR GROUPING FOR BV | (3M) INSPECT & CONDITION CHECK | PM | 1/12/2024 | |
| 20241201 | B12-C-00353 | B-SWGR-LV-BV | SWGR GROUPING FOR BV | (3M) INSPECT & CONDITION CHECK | PM | 1/12/2024 | |
| 20241201 | B00-C-00099 | B-RAPR-820 | GROUPING STEAM TRAP AREA 020 | (3M) CONDITION CHECK (OSL 2022-198) | IM | 1/12/2024 | |
| 20241201 | BNA-C-00046 | B-TX-ISBUP27A | GROUPING TAG FOR TX ISBUP27A | (T) CALIBRATION | PM | 1/12/2024 | |
| 20241201 | B12-C-00060 | B-USP-2EF-BV | GROUPING FOR UPS 220 KVA | (1M) CONDITION CHECK | PM | 1/12/2024 | |
| 20241201 | B47D-C-00031 | B-V-1540-P-15 | MAIN OIL PUMP | (1M) LUBRICATION | PM | 1/12/2024 | |
| 20241130 | B12-C-00782 | B-1035-CO2-001 | CO2 Portable for OLE2/3 | (1M) CO2 Portable Visual Inspection | PM | 29/11/2024 | |
| 20241130 | B12-C-00788 | B-1035-DC-001 | Dry Chemical for OLE2/3 | (1M) Dry Chemical Visual Inspection | PM | 29/11/2024 | |
| 20241130 | B12-C-00798 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/3 | (1M) Manual Fire Visual Inspection | PM | 29/11/2024 | |
| 20241130 | B12-C-00804 | B-1035-FM-001 | FM200 for Rack Room (OLE2/3) | (1M) FM200 System Visual Inspection | PM | 29/11/2024 | |
| 20241130 | B0P6-C-00043 | B-BLOCK-VALVE-N01 | BV FOR PM SEC 12 FLUSHING OUT TO OPE | (6M) LUBRICATION | PM | 29/11/2024 | |
| 20241130 | B12-C-00766 | B-M4P-4307A | SURFACE CONDENSER PUMP MOTOR | RCH (6M) INSPECTION AND TEST | PM | 29/11/2024 | Motor |
| 20241130 | B12-C-00767 | B-M4P-4307S | SURFACE CONDENSER PUMP MOTOR | RCH (6M) INSPECTION AND TEST | PM | 29/11/2024 | Motor |
| 20241130 | B41-C-00001 | B-M4P-478A | ETHYLENE PRODUCT PUMP MOTOR | (1M) LUBRICATION | PM | 29/11/2024 | Motor |
| 20241130 | B12-C-00001 | B-M4P-800A | C4 HIGH PRESSURE OIL MOTORS. | (1M) LUBRICATION | PM | 29/11/2024 | Motor |
| 20241130 | B208-S-00012 | B-P-3415 | GASOLINE INJECTION PUMP | (1M) OIL & LUBRICATE | PM | 29/11/2024 | Pump |
| 20241130 | B208-S-00012 | B-P-3415 | GASOLINE INJECTION PUMP | (3M) INSPECT & CLEAN, LUBRICATE | PM | 29/11/2024 | Pump |
| 20241130 | B16-C-00020 | B-PSV-2200F | A-220 TOP HOT FLARE | BOUYTIE-(4Y)-OVERHAUL & INSPECTION (8x10) | PM | 29/11/2024 | PSV |
| 20241130 | B35-C-00032 | B-PSV-8004S | L-800S TO HOT FLARE | (24M) SET & CALIBRATE (PSV 1 1/2x2) | PM | 29/11/2024 | PSV |
| 20241130 | B12-C-00785 | B-R-4301-MG-5 | OIL PURIFIER | RCH (6M) INSPECTION AND TEST | PM | 29/11/2024 | |
| 20241130 | B12-C-00764 | B-R-4301-MP-15 | STAND BY OIL PUMP MOTOR | RCH (6M) INSPECTION AND TEST | PM | 29/11/2024 | Motor |
| 20241130 | B11-C-00143 | B-SWGR-1E-1F-SUB2 | PM FOR GROUP SWITCHGEAR OMP2 | (1M) INSPECTION AND Individual Test | PM | 29/11/2024 | |
| 20241129 | B00-C-00130 | B-1034-CO2-001 | CO2 Portable for OLE JET/1 | (1M) CO2 Portable Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-C-00131 | B-1034-CC-001 | Dry Chemical for OLE2/1 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/11/2024 | |
| 20241129 | B00-C-00129 | B-1034-DC-002 | Dry Chemical for Admin | (1M) INSPECTION | IM | 29/11/2024 | |
| 20241129 | B00-S-00001 | B-1034-DV-001 | Deluge Valve for OLE2/1 Group 1 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-S-00002 | B-1034-DV-002 | Deluge Valve for OLE2/1 Group 2 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-S-00003 | B-1034-DV-003 | Deluge Valve for OLE2/1 Group 3 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-S-00004 | B-1034-DV-004 | Deluge Valve for OLE2/1 Group 4 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-S-00005 | B-1034-DV-005 | Deluge Valve for OLE2/1 Group 5 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-S-00006 | B-1034-DV-006 | Deluge Valve for OLE2/1 Group 6 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-C-00133 | B-1034-FM-001 | All Manual Fire Alarm for OLE2/1 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/11/2024 | |
| 20241129 | B00-C-00134 | B-1034-FM-001 | Fire Department Connection for Admin | (1M) Fire Department Connection Visual | IM | 29/11/2024 | |
| 20241129 | B00-C-00152 | B-1034-FHH-001 | Fire Hose Reel for OLE2/1 | (1M) Fire Hose Reel Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-C-00154 | B-1034-FHH-001 | Fire Hose Reel and Cabinet for Admin | (1M) Fire Hose and Cabinet Reel Visual | IM | 29/11/2024 | |
| 20241129 | B00-C-00156 | B-1034-FM-001 | Fixed Monitor for OLE2/1 | (1M) Fixed Monitor Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-C-00198 | B-1034-PHV-001 | Post Indicator Valve for OLE2/1 | (1M) Post Indicator Valve Visual Insp | IM | 29/11/2024 | |
| 20241129 | B00-C-00200 | B-1034-WC-001 | Water Curtain for OLE2/1 | (1M) Water Curtain Inspection | IM | 29/11/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|---|----|------------|-------|
| 20241129 | B11-C-00016 | B-1034-WDC-001 | Wheeled Fire Extinguishers for OLE2/1 | (1M) Dry Chemical Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-C-00203 | B-1034-WHM-001 | Water Hydrant for OLE2/1 | (1M) Water Hydrant Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B00-C-00205 | B-1034-WHM-001 | Water Hydrant with Monitor for OLE2/1 | (1M) Water Hydrant Monitor Visual Inspect | IM | 29/11/2024 | |
| 20241129 | B11-C-00086 | B-1035-CO2-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B11-C-00087 | B-1035-DC-001 | Dry Chemical for OLE2/2 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/11/2024 | |
| 20241129 | B11-C-00088 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B11-C-00089 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (1M) Deluge Valve Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B11-S-00025 | B-1035-FM-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/11/2024 | |
| 20241129 | B11-S-00026 | B-1035-WM-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B12-C-00076 | B-1036-PHV-001 | Post Indicator Valve for OLE2/3 | (1M) Post Indicator Valve Visual Insp | IM | 29/11/2024 | |
| 20241129 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M) CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/11/2024 | |
| 20241129 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M) CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/11/2024 | |
| 20241129 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M) CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/11/2024 | |
| 20241129 | B12-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1M) FUNCTION TEST & EXERCISE | PM | 29/11/2024 | |
| 20241129 | B90-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1M) FUNCTION TEST & EXERCISE | PM | 29/11/2024 | |
| 20241129 | B90-C-00075 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (1M) FUNCTION TEST & EXERCISE | PM | 29/11/2024 | |
| 20241129 | B11-C-00135 | B-MCC-1E1-1E2-SUB2 | PM FOR GROUP MCC OMP1 | (3M) INSPECTION | PM | 29/11/2024 | |
| 20241129 | B11-C-00137 | B-MOTOR-OMP-01 | PM FOR GROUP MOTOR OMP1 | (3M) RCM Motor Inspection | PM | 29/11/2024 | Motor |
| 20241129 | B11-C-00136 | B-MOTOR-OMP-01 | PM FOR GROUP MOTOR OMP1 | (3M) RCM Motor Lubrication | PM | 29/11/2024 | Motor |
| 20241129 | B11-C-00140 | B-MOTOR-OMP-02 | PM FOR GROUP MOTOR OMP2 | (3M) RCM Motor Lubrication | PM | 29/11/2024 | Motor |
| 20241129 | B11-C-00139 | B-MOTOR-OMP-02 | PM FOR GROUP MOTOR OMP2 | (3M) RCM Motor Lubrication | PM | 29/11/2024 | Motor |
| 20241129 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1M) CLEAN STRAINER FOR B-P-1132 | PM | 29/11/2024 | Pump |
| 20241129 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1M) CLEAN STRAINER FOR B-P-1132 | PM | 29/11/2024 | Pump |
| 20241129 | B061-C-00018 | B-P-1136A | DGP EFFLUENT TRANSFER PUMP | (1M) CLEAN STRAINER FOR B-P-1136 | PM | 29/11/2024 | Pump |
| 20241129 | B061-C-00018 | B-P-1136S | DGP EFFLUENT TRANSFER PUMP | (1M) CLEAN STRAINER FOR B-P-1136 | PM | 29/11/2024 | Pump |
| 20241129 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1M) TEST RUN | PM | 29/11/2024 | Pump |
| 20241129 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1M) TEST RUN | PM | 29/11/2024 | Pump |
| 20241129 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1M) TEST RUN | PM | 29/11/2024 | Pump |
| 20241129 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1M) TEST RUN | PM | 29/11/2024 | Pump |
| 20241129 | B063-WK-0002 | B-P-1601E | ENGINE DRIVEN FIRE PUMP | (1M) TEST RUN | PM | 29/11/2024 | Pump |
| 20241129 | B238-C-00013 | B-PSV-9347A | R-9347-3 TO GRADE | (3Y) SET & CALIBRATE (PSV 3x6) | PM | 29/11/2024 | PSV |
| 20241129 | B11-C-00142 | B-SCBA-001 | Self-contained breathing apparatus for | (1M) SCBA Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B11-C-00144 | B-TRA-ANH-11-004-1 | DRY TYPE TRANSFORMER FOR ANALYZER HOUSE | (3M) RCM Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B11-C-00145 | B-TRA-ANH-11-004-2 | DRY TYPE TRANSFORMER FOR ANALYZER HOUSE | (3M) RCM Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B11-C-00146 | B-TRA-ANH-11-005-1 | DRY TYPE TRANSFORMER FOR ANALYZER HOUSE | (3M) RCM Visual Inspection | IM | 29/11/2024 | |
| 20241129 | B11-C-00147 | B-TRA-ANH-11-005-2 | DRY TYPE TRANSFORMER FOR ANALYZER HOUSE | (3M) RCM Visual Inspection | IM | 29/11/2024 | |
| 20241128 | B12-C-00789 | B-1036-DV-001 | Deluge Valve for Grouping 1 (OLE2/3) 778g | (1M) Deluge Valve Visual Inspection | IM | 28/11/2024 | |
| 20241128 | B12-C-00793 | B-1036-DV-002 | Deluge Valve for Grouping 2 (OLE2/3) 778g | (1M) Deluge Valve Visual Inspection | IM | 28/11/2024 | |
| 20241128 | B12-C-00797 | B-1036-DV-003 | Deluge Valve for Grouping 3 (OLE2/3) 778g | (1M) Deluge Valve Visual Inspection | IM | 28/11/2024 | |
| 20241128 | B12-C-00778 | B-1036-FHH-001 | Fire Hose House for OLE2/3 | (1M) Fire Hose Box Visual Inspection | IM | 28/11/2024 | |
| 20241128 | B12-C-00776 | B-1036-WH-001 | Water Hydrant for OLE2/3 | (1M) Water Hydrant Visual Inspection | IM | 28/11/2024 | |
| 20241128 | B12-C-00779 | B-1036-WHM-001 | Water Hydrant with Monitor for OLE2/3 | (1M) Water Hydrant Monitor Visual Inspect | IM | 28/11/2024 | |
| 20241128 | B63-C-00046 | B-DV-15601 | FUEL GAS GUSTORY INLET | (2M) CALIBRATION | PM | 28/11/2024 | |
| 20241128 | B63-C-00046 | B-DV-1626A | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/11/2024 | |
| 20241128 | B63-C-00046 | B-DV-1626B | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/11/2024 | |
| 20241128 | B63-C-00046 | B-DV-1626C | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/11/2024 | |
| 20241128 | B63-C-00046 | B-DV-1626D | ETHYLENE PRODUCT TX Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/11/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|--------------------------------------|----|------------|------------|
| 20241128 | B60-C-00087 | B-G-1112-P-1A | HIGH PRESSURE FEED PUMPS | (1M) CLEAN STRAINER/INSPECTION | PM | 28/11/2024 | |
| 20241128 | B-PSV-9010C | B-PSV-9010C | SVAP STM LET DOWN STM | (2M) SET & CALIBRATE (PSV 4x6) | PM | 28/11/2024 | PSV |
| 20241128 | B0P6-C-00024 | B-P-3600-PM-15 | CO2 COMP LID PUMP MOTOR | RCH (3M) Motor Inspection | PM | 28/11/2024 | Motor |
| 20241128 | B20-C-00003 | B-SECUR-TASK30A | FOR PM: CHECK A FOAM TRUCK NOL (MUNGAETA) | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241128 | B20-C-00003 | B-SECUR-TASK30C | FOR PM: CHECK A WATER TRUCK (SAYVARIN) | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241128 | B20-C-00003 | B-SECUR-TASK30E | FOR PM: CHECK AMBULANCE (JITRUKISA) | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241128 | B20-C-00003 | B-SECUR-TASK30F | FOR PM: CHECK WATER CAR (NATVAYU) | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241128 | B90-C-00117 | B-SWGR-EQ-00 | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 28/11/2024 | |
| 20241128 | BWS-S-00007 | B-W502-02-01 | AIR COMPRESSOR SULLAIR | (1M) INSPECTION | PM | 28/11/2024 | Compressor |
| 20241128 | BWS-S-00001 | B-W503-04-01 | BALANCING MACHINE | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241128 | BWS-S-00002 | B-W505-01-01 | UNIVERSAL MILLING MACHINE | (1M) INSPECT | PM | 28/11/2024 | |
| 20241128 | BWS-S-00014 | B-W505-03-01 | CENTER LATHE MACHINE AXIAL | (1M) INSPECT | PM | 28/11/2024 | |
| 20241128 | BWS-S-00023 | B-W505-03-02 | CENTER LATHE MACHINE PINACHO | (1M) INSPECT | PM | 28/11/2024 | |
| 20241128 | BWS-C-00001 | B-W505-05-01 | COLUMN TYPE DRILLING MACHINE | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241128 | BWS-S-00025 | B-W505-07-01 | HYDRAULIC HACKSAW | (1M) INSPECT | PM | 28/11/2024 | |
| 20241128 | BWS-S-00026 | B-W505-21-01 | SHAPING MACHINE | (1M) INSPECT & LUBRICATE | PM | 28/11/2024 | |
| 20241128 | BWS-S-00005 | B-W508-03-01 | HIGH PRESSURE WATER JET MACHINE | (1M) INSPECT | PM | 28/11/2024 | |
| 20241128 | BWS-S-00003 | B-W514-01-01 | FORK LIFT | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241128 | BWS-S-00009 | B-W514-03-01 | TRUCK LOADER HINO | (1M) INSPECTION | PM | 28/11/2024 | |
| 20241127 | B91-C-1202 | B-AE-1202 | CG EFFLUENT FROM F-130 | (6M) CALIBRATION | PM | 27/11/2024 | |
| 20241127 | B91-C-1009 | B-AE-1400 | CG EFFLUENT FROM F-140 | (6M) CALIBRATION | PM | 27/11/2024 | |
| 20241127 | B0P1-C-00031 | B-ANALYZER-Q214/1 | GROUPING FOR OXYGEN ANALYZER PLANT/1/1 | (2M) SET & CALIBRATE | PM | 27/11/2024 | |
| 20241127 | B061-C-00139 | B-AT-1141A1 | (2M) COD Analyzer | (2M) Inspect & Cal | PM | 27/11/2024 | |
| 20241127 | B061-C-00027 | B-AT-382102 | SIO2 ANALYZER TRANSMITTER FOR V-3821 OUT | (1M) SET & CALIBRATE | PM | 27/11/2024 | |
| 20241127 | B12-C-00023 | B-AT-402103 | BUTADIENE IR | (2M) SET & CALIBRATE | PM | 27/11/2024 | |
| 20241127 | B90-C-00139 | B-INTERCOM-GP1-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M) INTERCOM FUNCTION TEST | PM | 27/11/2024 | |
| 20241127 | B35-C-00029 | B-PSV-8003S | L-800A TO HOT FLARE | (24M) SET & CALIBRATE (PSV 1 1/2x2) | PM | 27/11/2024 | |

| | | | | | | | |
|----------|---------------|--------------------|--|--|----|------------|------------|
| 20241120 | B12-C-00072 | B-BV-LOCAL-ANL2K | Grouping for Local Analyzer BV | (2)SET & CALIBRATE | PH | 20/11/2024 | |
| 20241120 | B09P-C-00001 | B-CAP-NMS | GROUPING TAG FOR NEW MAIN SUB | (1)VISUAL INSPECTION TEMP/NOISE AND VIB | PH | 20/11/2024 | |
| 20241120 | B63-C-00113 | B-DV-16801 | DELUGE VALVE FOR C3 PHU UNIT | (6H) SPRAY TEST | PH | 20/11/2024 | |
| 20241120 | B63-C-00113 | B-DV-16802 | DELUGE VALVE FOR C3 PHU UNIT | (6H) SPRAY TEST | PH | 20/11/2024 | |
| 20241120 | B63-C-00113 | B-DV-16803 | DELUGE VALVE FOR C3 PHU UNIT | (6H) SPRAY TEST | PH | 20/11/2024 | |
| 20241120 | B10L-C-00055 | B-F-1020 | USC PYROLYSIS FURNACE | (3)CYCLO & REFRACTORY INSPECTION GROUP C | PH | 20/11/2024 | Furnace |
| 20241120 | B19P-C-00024 | B-PT-3021 | ANTI-SURGE CG COMP 3RD STG DISCH | (6H)FLUSH/VENT IMPULSE LINE OF FLOW TX. | PH | 20/11/2024 | |
| 20241120 | B19P-C-00024 | B-PT-3022 | ANTI-SURGE CG COMP 2ND STG DISCH | (6H)FLUSH/VENT IMPULSE LINE OF FLOW TX. | PH | 20/11/2024 | |
| 20241120 | B60-C-00047 | B-G-1112-P-1A | HIGH PRESSURE FEED PUMPS | (1Y)Inspection&Lubrication | PH | 20/11/2024 | |
| 20241120 | B09P-S-00001 | B-M-19009 | GROUPING TAG FOR LPG. FROM PIT6C4 | (4H)SET & CALIBRATE | PH | 20/11/2024 | |
| 20241120 | B09PS-S-00005 | B-MOTDR-EQ-006 | GROUPING FOR MOTORS CONSOLE#5 | (1H)CLEANING & INSPECTION. | PH | 20/11/2024 | |
| 20241120 | B09P-C-00016 | B-MOTDR-EQ-DEMIN | GROUPING TAG FOR MOTOR DEMIN PLANT | (3)CLEANING AND INSPECTION ON OPERATION. | PH | 20/11/2024 | Motor |
| 20241120 | B9P-C-00003 | B-PP-3E1-1 | NEW MAIN SUBSTATION NORMAL-HVAC MOTOR | (1H)CLEANING AND INSPECTION | PH | 20/11/2024 | |
| 20241120 | B9P-C-00003 | B-PP-3E1-2 | NEW PROCESS SUBSTATION NORMAL-HVAC MOTOR | (1H)CLEANING AND INSPECTION | PH | 20/11/2024 | |
| 20241120 | B9P-C-00003 | B-PP-4FI-1 | CONTROL BUILDING EMERGENCY-HVAC MOTOR | (1H)CLEANING AND INSPECTION | PH | 20/11/2024 | |
| 20241120 | B9P-C-00003 | B-PP-4FI-2 | NEW MAIN SUBSTATION EMERGENCY-HVAC MOTOR | (1H)CLEANING AND INSPECTION | PH | 20/11/2024 | |
| 20241120 | B9P-C-00003 | B-PP-4FI-3 | NEW PROCESS SUBSTATION EMERGENCY-HVAC MO | (1H)CLEANING AND INSPECTION | PH | 20/11/2024 | |
| 20241120 | B47P-C-00009 | B-PT-15353 | PRESS. TX. COMPENSATE FOR LT-15353 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PH | 20/11/2024 | |
| 20241120 | B47P-C-00009 | B-PT-15358 | P-1535A/S DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PH | 20/11/2024 | |
| 20241120 | B47P-C-00009 | B-PT-15363 | PRESS. TX. COMPENSATE FOR LT-15361 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PH | 20/11/2024 | |
| 20241120 | B47C-C-00006 | B-PT-15373 | PRESS. TX. COMPENSATE FOR LT-15371 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PH | 20/11/2024 | |
| 20241120 | B47D-C-00019 | B-PT-15403 | C-1540 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PH | 20/11/2024 | |
| 20241120 | B12-C-00355 | B-VSD-G-4801-RM-1A | VSD Panel for G-4801-RM-1A | (1H)Inspection & Record | PH | 20/11/2024 | |
| 20241120 | B4-MR-1135A | B-VSD-MR-1135A | VSD Panel for R-1135A | (1H)Inspection & Record | PH | 20/11/2024 | |
| 20241120 | B9P-C-00195 | B-VSD-MR-1135B | VSD Panel for R-1135B | (1H)Inspection & Record | PH | 20/11/2024 | |
| 20241120 | B003-C-00019 | B-VSD-MR-1500A | VSD Panel for R-1500A | (1H)Inspection & Record | PH | 20/11/2024 | |
| 20241120 | B003-C-00020 | B-VSD-MR-1500S | VSD Panel for R-1500S | (1H)Inspection & Record | PH | 20/11/2024 | |
| 20241119 | B11-C-00104 | B-A-371204 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1H) SET & CALIBRATE | PH | 19/11/2024 | |
| 20241119 | B11-C-00110 | B-A-371214 | ANALYZER (GC) PROPYLENE PRODUCT FROM C3 | (1H) SET & CALIBRATE | PH | 19/11/2024 | |
| 20241119 | B52A-C-00020 | B-G-1204A | Cooling Tower A | (1Y)INSPECTION&CLEANING BAR SCREEN | PH | 19/11/2024 | |
| 20241119 | B52A-C-00020 | B-G-1204B | Cooling Tower B | (1Y)INSPECTION&CLEANING BAR SCREEN | PH | 19/11/2024 | |
| 20241119 | B52A-C-00020 | B-G-1204C | Cooling Tower C | (1Y)INSPECTION&CLEANING BAR SCREEN | PH | 19/11/2024 | |
| 20241119 | B52A-C-00020 | B-G-1204D | Cooling Tower D | (1Y)INSPECTION&CLEANING BAR SCREEN | PH | 19/11/2024 | |
| 20241119 | B52A-C-00020 | B-G-1204E | Cooling Tower E | (1Y)INSPECTION&CLEANING BAR SCREEN | PH | 19/11/2024 | |
| 20241119 | B10-S-300113A | B-G-300113A | COMPRESSOR MAIN OIL PUMP TURBINE | (1H)CHECK LUBRICATE OIL | PH | 19/11/2024 | |
| 20241119 | B04P-C-00038 | B-G-1901B | GROUPING TAG FOR FUEL GAS TO TIC/LOC | (4H)SET & CALIBRATE | PH | 19/11/2024 | Compressor |
| 20241119 | BNA-C-00017 | B-SECUR-TASK46 | FOR PH. INSPECTION AND CHECK MOBILE AIR | (1H)INSPECTION | PH | 19/11/2024 | |
| 20241118 | B11-C-00100 | B-A-370501 | C3 LIQUID FROM T-3005 FEED TO L-307S MAP | (1H) SET & CALIBRATE | PH | 18/11/2024 | |
| 20241118 | B11-C-00109 | B-A-370502 | ANALYZER (GC) MAPF REACTOR RECYCLE | (1H) SET & CALIBRATE | PH | 18/11/2024 | |
| 20241118 | B11-C-00101 | B-A-370503 | LP DEETHAN. BOTTOMS FROM P3604A/S PUMP | (1H) SET & CALIBRATE | PH | 18/11/2024 | |
| 20241118 | B11-C-00105 | B-A-371202 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1H) SET & CALIBRATE | PH | 18/11/2024 | |
| 20241118 | B12-C-00027 | B-A-430106A | F-4301 Oxyg. Ana. | (2H)SET & CALIBRATE | PH | 18/11/2024 | |
| 20241118 | B12-C-00028 | B-A-430203 | F-4302 Oxyg. Ana. | (2H)SET & CALIBRATE | PH | 18/11/2024 | |
| 20241118 | B009-C-00010 | B-E-C-01 | MASTER FIRE ALARM CONTROL PANEL AT CCB | (3H)VISUAL INSPECTION | IM | 18/11/2024 | |
| 20241118 | B009-C-00010 | B-E-C-02 | FIRE ALARM MONITORING AT FIRE STATION | (3H)VISUAL INSPECTION | IM | 18/11/2024 | |
| 20241118 | B009-C-00010 | B-E-C-03 | FIRE ALARM POWER PANEL TANK AREA | (3H)VISUAL INSPECTION | IM | 18/11/2024 | |
| 20241118 | B09P-C-00046 | B-MOTDR-EQ-011 | GROUPING FOR MOTORS CONSOLE#46 | (3Y)CLEANING & INSPECTION&LUBRICATION | PH | 18/11/2024 | Motor |
| 20241118 | B03A-C-0002 | B-MOV-HV-2401 | MOV for B-HV-2401 | (1Y)Inspection and Lubrication | PH | 18/11/2024 | |
| 20241118 | B03A-C-0002 | B-MOV-HV-2402 | MOV for B-HV-2402 | (1Y)Inspection and Lubrication | PH | 18/11/2024 | |
| 20241118 | B03A-C-0024 | B-MOV-HV-2403 | MOV for B-HV-2403 | (1Y)Inspection and Lubrication | PH | 18/11/2024 | |

| | | | | | | | |
|----------|--------------|----------------------|--|--|----|------------|-------|
| 20241117 | 063-C-00111 | 0-DV-1623A | C2/C3 OF SPEC TX Q-1537 DELUGE VALVE | (6H) Spray Test | PH | 17/11/2024 | |
| 20241117 | 063-C-00111 | 0-DV-1623B | C2/C3 OF SPEC TX Q-1537 DELUGE VALVE | (6H) Spray Test | PH | 17/11/2024 | |
| 20241117 | 063-C-00111 | 0-DV-1624A | PROPYLENE PRODUCT TK Q-1535 DELUGE VALVE | (6H) Spray Test | PH | 17/11/2024 | |
| 20241117 | 063-C-00111 | 0-DV-1624B | PROPYLENE PRODUCT TK Q-1535 DELUGE VALVE | (6H) Spray Test | PH | 17/11/2024 | |
| 20241117 | 063-C-00044 | 0-DV-1625A | LPG STORAGE TK Q-1520 DELUGE VALVE | (6H) Spray Test | PH | 17/11/2024 | |
| 20241117 | 063-C-00044 | 0-DV-1625B | LPG STORAGE TK Q-1520 DELUGE VALVE | (6H) Spray Test | PH | 17/11/2024 | |
| 20241117 | 000-C-00031 | 0-E-ESD-PI-3 | Group for ESD/PI-3 | (3H)INSPECT, VERIFY & CHECK | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-ROILER | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-C3 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-ORP | ESD/PI31011H,9.050E4,2.0EH2,10.0 | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-PI-TANKFARM | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-P2-COLDJLT | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-P2-FUR5/HOT | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-P2-FUR6 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-ESD-P2-FUR7 | EMERGENCY SHUTDOWN SYSTEM | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 010-C-00238 | 0-HV-10108 | F-1010 EFFLUENT TO A-210 | (3H)Collect Torque Profile & Record | IM | 17/11/2024 | |
| 20241117 | 010-C-00239 | 0-HV-10107 | CH3CLORINE EFFLUENT TO A-210 | (3H)Collect Torque Profile & Record | IM | 17/11/2024 | |
| 20241117 | 009P-C-00015 | 0-M-19075 | GROUPING TAG FOR TAIL GAS TO ROC, M.SKID | (1H)UPDATE N2, CO2, REL. DENSITY | PH | 17/11/2024 | |
| 20241117 | 009P-C-00070 | 0-M-19075 | GROUPING TAG FOR RPLG RROM PIT/PE | (6H)IMPROVE LUG TURBINE METER (OUT-SOURCE) | PH | 17/11/2024 | |
| 20241117 | 090-C-00128 | 0-MCC-EC-282 | Grouping Tag for MCC-282 | (3H)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PH | 17/11/2024 | |
| 20241117 | 038-S-00005 | 0-B-MOTOR-EP-NFA-001 | GROUPING TAG FOR MOTOR NFA AREA | (1H)CLEANING AND INSPECTION. | PH | 17/11/2024 | Motor |
| 20241117 | 029E-C-00013 | 0-MOV-HV-5705 | MOV for B-HV-5705 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 029E-C-00014 | 0-MOV-HV-5706 | MOV for B-HV-5706 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 029E-C-00015 | 0-MOV-HV-5717 | MOV for B-HV-5717 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 042A-C-00037 | 0-MOV-HV-6004 | MOV for B-HV-6004 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 042A-C-00038 | 0-MOV-HV-6005 | MOV for B-HV-6005 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 042A-C-00039 | 0-MOV-HV-6008 | MOV for B-HV-6008 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 042A-C-00040 | 0-MOV-HV-6009 | MOV for B-HV-6009 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 042A-C-00041 | 0-MOV-HV-6010 | MOV for B-HV-6010 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 028A-C-00028 | 0-MOV-KV-5554 | MOV for B-KV-5554 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 028A-C-00029 | 0-MOV-KV-5555 | MOV for B-KV-5555 | (1Y)Inspection and Lubrication | PH | 17/11/2024 | |
| 20241117 | 028E-C-00014 | 0-NR-600-P-1A | CCR CONDENSER COND. PUMP MOTOR | ROH-(1H)VISUAL CHECK | PH | 17/11/2024 | |
| 20241117 | 028E-C-00014 | 0-NR-600-P-2A | CCR CONDENSER COND. PUMP MOTOR | ROH-(1H)VISUAL CHECK | PH | 17/11/2024 | |
| 20241117 | 028E-C-00014 | 0-NR-600-P-2S | CCR SURFACE CONDENSER PUMP MOTOR | ROH-(1H)VISUAL CHECK | PH | 17/11/2024 | |
| 20241117 | 061-C-00123 | 0-B-1165A | SLUDGE STORAGE AREA SUMP PUMP | (3M)REGREASE | PH | 17/11/2024 | Pump |
| 20241117 | 061-C-00124 | 0-B-1165S | SLUDGE STORAGE AREA SUMP PUMP | (3M)REGREASE | PH | 17/11/2024 | Pump |
| 20241117 | 012-C-00042 | 0-PSCG-BV-HOUSE1 | GROUPING TAG FOR PGC BV HOUSE 1 | (2H)SET/CALIBRATE | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-PLC-PI-CCC-R575 | ANTI-SURGE AND PERFORMANCE CONTROL | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-PLC-PI-CCS-CGC | ANTI-SURGE AND PERFORMANCE CONTROL | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-PLC-PI-CCS-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-PLC-PI-CCS-PRC | ANTI-SURGE AND PERFORMANCE CONTROL | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-PLC-PI-ISA1 | PRESSURE SWING ADSORPTION | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-PLC-PI-TMC | TURBOMACHINERY CONTROL | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |
| 20241117 | 000-C-00065 | 0-PLC-P2-ITCC-CGC | TURBOMACHINERY CONTROL | (1H)DAILY CHECK SYSTEM | PH | 17/11/2024 | |

| | | | | | | | |
|----------|--------------|------------------|--|---|----|------------|------------|
| 20241116 | 8029-C-00011 | B-HOV-KV-5307 | MOV for B-KV-5307 | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 8029-C-00012 | B-HOV-KV-5308 | MOV for B-KV-5308 | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 8029-C-00013 | B-HOV-KV-5324 | MOV for B-KV-5324 | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 8029-C-00014 | B-HOV-KV-5331A | MOV for B-KV-5331A | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 828A-C-00024 | B-HOV-KV-5504 | MOV for B-KV-5504 | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 828A-C-00025 | B-HOV-KV-5505 | MOV for B-KV-5505 | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 828A-C-00026 | B-HOV-KV-5550 | MOV for B-KV-5550 | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 828A-C-00027 | B-HOV-KV-5551 | MOV for B-KV-5551 | (1Y)Inspection and Lubrication | PM | 16/11/2024 | |
| 20241116 | 829-C-00005 | B-MP-5415 | PROPYLENE PRODUCT PUMP MOTOR | (1Y)CHANGE LUBE OIL, MOTORS. | PM | 16/11/2024 | Motor Pump |
| 20241116 | 87-C-00035 | B-PF-920S | CONDENSE. POLIMERIS NEVTRALIZATION SUMP P. | (6M)REGREASE | PM | 16/11/2024 | |
| 20241116 | 890-C-00063 | B-PM-341 | LINC STEAM CONDENSATE - 1" PIPE 2-1 | (3M) CONDITION CHECK (OSL 2021-106) | IM | 16/11/2024 | |
| 20241116 | 890-C-00016 | B-PM-344 | COOL WATER TOWER MOTOR | (6M)CHANGE OIL Lubrication/Inspect | PM | 16/11/2024 | Motor |
| 20241117 | 836-C-00072 | B-PSV-1014 | M-410 TO COLE FLARE | (24M)SET & CALIBRATE (PSV 4/2) | PM | 16/11/2024 | PSV |
| 20241116 | 835-C-00068 | B-PSV-80036 | L-800A TO HOT FLARE | (24M)SET & CALIBRATE (PSV 1/1,2/2) | PM | 16/11/2024 | PSV |
| 20241116 | 890-C-00021 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (1Y)ID Fan Lubricate, Inspection(Group.M) | PM | 16/11/2024 | |
| 20241116 | 890-C-00061 | B-RM-3104 | ETHYLENE FURNACE ID FAN#4 MOTOR | (1Y)ID Fan Motor Inspection (Group.M) | PM | 16/11/2024 | |
| 20241116 | 890-C-00121 | B-SWGR-EO-80 | Grouping Tag for 6.6KV SWGR Sub#5 | (1Y) INSPECT & ADJUST | PM | 16/11/2024 | |
| 20241116 | 890-S-00001 | B-UPS1-2ES | UPS AT NEW PROCESS SUBSTION | (1M)INSPECT & ADJUST | PM | 16/11/2024 | |
| 20241116 | 863-C-00042 | B-WM-1517 | WATER MONITOR AREA HOT | (6M)WM HOT LUBRICATION | PM | 16/11/2024 | |
| 20241116 | 863-C-00042 | B-WM-1518 | WATER MONITOR AREA HOT | (6M)WM HOT LUBRICATION | PM | 16/11/2024 | |
| 20241116 | 863-C-00042 | B-WM-1619 | WATER MONITOR AREA HOT | (6M)WM HOT LUBRICATION | PM | 16/11/2024 | |
| 20241116 | 863-C-00042 | B-WM-1644 | WATER MONITOR AREA TANK | (6M)WM TANK LUBRICATION | PM | 16/11/2024 | |
| 20241116 | 863-C-00042 | B-WM-1645 | WATER MONITOR AREA TANK | (6M)WM TANK LUBRICATION | PM | 16/11/2024 | |
| 20241116 | 863-C-00095 | B-WM-1646 | WATER MONITOR AREA TANK | (6M)WM TANK LUBRICATION | PM | 16/11/2024 | |
| 20241115 | 800-C-00028 | B-103F-PST-1605 | Foam Storage Tank for Truck Load | (1M)VISUAL INSPECTION | IM | 15/11/2024 | |
| 20241115 | 811-C-00158 | B-103S-FIH-001 | Fire Hose House for OLE2/2 | (1M)Fire Hose Box Visual Inspection | IM | 15/11/2024 | |
| 20241115 | 811-C-00151 | B-103S-PST-001 | Foam Storage Tank for R-3801 | (3M)Function Test | PM | 15/11/2024 | |
| 20241115 | 811-C-00150 | B-103S-PST-001 | Foam Storage Tank for R-3801 | (1M)VISUAL INSPECTION | IM | 15/11/2024 | |
| 20241115 | 811-C-00152 | B-103S-PST-001 | Foam Storage Tank for R-3801 | (6M)Spray Test | PM | 15/11/2024 | |
| 20241115 | 811-C-00157 | B-103S-PV-001 | Post Indicator Valve for OLE2/2 | (1M)Post Indicator Valve Visual Insp | PM | 15/11/2024 | |
| 20241115 | 811-C-00148 | B-103S-WC-001 | Water Curtain for OLE2/2 | (1M)Water Curtain Inspection | PM | 15/11/2024 | |
| 20241115 | 811-C-00149 | B-103S-WC-001 | Water Curtain for OLE2/2 | (6M)Water Curtain Inspection and Function | PM | 15/11/2024 | |
| 20241115 | 800-C-00127 | B-103F-PST-M4798 | Foam Storage Tank for M-4090,M-4091 BV | (1M)VISUAL INSPECTION | IM | 15/11/2024 | |
| 20241115 | 800-C-00118 | B-103F-PST-M4798 | Foam Storage Tank for M-4090,M-4091 BV | (3M)Function Test | PM | 15/11/2024 | |
| 20241115 | 800-C-00219 | B-103F-PST-M4798 | Foam Storage Tank for M-4090,M-4091 BV | (6M)Spray Test | PM | 15/11/2024 | |
| 20241115 | 390-S-00015 | B-CAP-ES | GROUPING TAG FOR CAP-ES SUBSTATION#3 | (1M)VISUAL INSPECTION TEMP,NOISE, VIBRAT | PM | 15/11/2024 | |
| 20241115 | 811-C-00014 | B-CO2-PRO-SUB | CO2 System for New Process Sub | (1M)VISUAL INSPECTION | IM | 15/11/2024 | |
| 20241115 | 890-C-00196 | B-CP-IRPC | CATHODIC PROT. FOR 4 PIPELINE TO IRPC | (6M)CIPS TEST | PM | 15/11/2024 | |
| 20241115 | 812-C-00807 | B-DV-TRANS-SUB6 | Deluge Valve for Transformer sub 6 | (5M)Deluge Valve Function Test | PM | 15/11/2024 | |
| 20241115 | 812-C-00806 | B-DV-TRANS-SUB6 | Deluge Valve for Transformer sub 6 | (1M)Deluge Valve Visual Inspection | IM | 15/11/2024 | |
| 20241115 | 800-C-00010 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (3M)PAYMENT SERVICE AGREEMENT TRICOINEX | PM | 15/11/2024 | |
| 20241115 | 862-S-00008 | B-G-1142-V-1 | PUG MILL | (6M)LUBRICATION | PM | 15/11/2024 | WWT |
| 20241115 | 8061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/11/2024 | WWT |
| 20241115 | 8061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/11/2024 | WWT |
| 20241115 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/11/2024 | WWT |
| 20241115 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/11/2024 | WWT |
| 20241115 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/11/2024 | WWT |
| 20241115 | 890-C-00005 | B-GS-345 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 15/11/2024 | |
| 20241115 | 890-C-00075 | B-GS-249 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 15/11/2024 | |
| 20241115 | 890-C-00005 | B-GS-345 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 15/11/2024 | |
| 20241115 | 83-C-00015 | B-M-19026 | GROUPING TAG FOR PL. PROPYLENE TO HMC | (4M)CALIBRATION | PM | 15/11/2024 | |
| 20241115 | 80P5-S-00009 | B-MCC-EO-2E1 | GROUPING TAG FOR MCC | (1Y)INSPECT & ADJUST | PM | 15/11/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|-------------------------------------|----|------------|------------|
| 20241114 | 802S-C-0002 | B-MOV-HV-3818 | MOV for B-HV-3818 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00028 | B-MOV-HV-3819 | MOV for B-HV-3819 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00029 | B-MOV-HV-3820 | MOV for B-HV-3820 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00030 | B-MOV-HV-3821 | MOV for B-HV-3821 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00031 | B-MOV-HV-3822 | MOV for B-HV-3822 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00032 | B-MOV-HV-3823 | MOV for B-HV-3823 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00033 | B-MOV-HV-3824 | MOV for B-HV-3824 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00034 | B-MOV-HV-3825 | MOV for B-HV-3825 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 802S-C-00035 | B-MOV-HV-3826 | MOV for B-HV-3826 | (1Y)Inspection and Lubrication | PM | 14/11/2024 | |
| 20241114 | 82-C-00003 | B-PSV-9030A | SHIP-SP STM LETDOWN STN | (5M)SET & CALIBRATE(PSV 406) | PM | 14/11/2024 | PSV |
| 20241114 | 82-C-00006 | B-PSV-9030B | SHIP-SP STM LETDOWN STN | (5M)SET & CALIBRATE(PSV 406) | PM | 14/11/2024 | PSV |
| 20241114 | 82-C-00007 | B-PSV-9030C | SHIP-SP STM LETDOWN STN | (3M) COCKING CHECK(PSV 402-001) | PM | 14/11/2024 | |
| 20241114 | 83A-C-00012 | BA-2-201 | COCKING TOWER BASIN | CHCKED LUBRICATING OIL | PM | 14/11/2024 | |
| 20241114 | 820-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK MOT (MUNGATE) | (10)INSPECTION | PM | 14/11/2024 | |
| 20241114 | 820-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAVYARIN) | (10)INSPECTION | PM | 14/11/2024 | |
| 20241114 | 820-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (10)INSPECTION | PM | 14/11/2024 | |
| 20241114 | 820-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (MATVAYU) | (10)INSPECTION | PM | 14/11/2024 | |
| 20241114 | 8NA-C-00014 | B-SECUR-TASK02 | FOR PM: INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/11/2024 | |
| 20241113 | 8H3-C-00016 | B-AT-310105 | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M)SET & CALIBRATION | PM | 13/11/2024 | |
| 20241113 | 807F-C-00028 | B-AT-312001/1-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) ISO1-0001 SET&CALIBRATION | PM | 13/11/2024 | |
| 20241113 | 806I-S-00009 | B-G-1144-F4 | POLYELECTROLYTE FLEX PUMP | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 13/11/2024 | |
| 20241113 | 806F-S-00067 | B-A-19075 | GROUPING TAG FOR RFG FROM PT1PE | (4M)SET & CALIBRATE | PM | 13/11/2024 | |
| 20241113 | 809S-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE45 | (1M)CLEANING & INSPECTION. | PM | 13/11/2024 | Motor |
| 20241113 | 809S-C-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 13/11/2024 | Motor |
| 20241113 | 890-S-00005 | B-PM-32015 | CHILLER WATER PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 13/11/2024 | Motor |
| 20241113 | 890-C-00007 | B-PMB-222 | POWER PANEL FOR F/F STATION | (1Y)INSPECTION | PM | 13/11/2024 | |
| 20241113 | 819A-C-00062 | B-R-300PH | CRACKED GAS COMPRESSOR HP CASING | (1M)INSPECT WRAPPED DRAIN FLANGE | PM | 13/11/2024 | Compressor |
| 20241113 | 8H7-S-00001 | B-R-3105 | ETHYLENE FURNACE IDI FAN#5 | (2M) RE GREASE CAMPER BEARING | PM | 13/11/2024 | |
| 20241113 | 8NA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/11/2024 | |
| 20241113 | 838-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/11/2024 | |
| 20241113 | 812-C-00036 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/11/2024 | |
| 20241113 | 812-C-00034 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/11/2024 | |
| 20241113 | 812-C-00037 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/11/2024 | |
| 20241113 | 804-C-00004 | B-CAZ-HS | GROUPING TAG FOR CAPACITY MAIN SUB | (1Y)CONDITION CHECK | PM | 13/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16501 | DELUGE VALVE FOR M-577A, B-575A | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16502 | DELUGE VALVE FOR T-576A, T-515 | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16503 | DELUGE VALVE FOR M-576A | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16504 | DELUGE VALVE FOR M-570A, T-570A | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16505 | DELUGE VALVE FOR A-570 | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16506 | DELUGE VALVE FOR A-570 | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16507 | DELUGE VALVE FOR A-510 | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 863-C-00112 | B-DV-16508 | DELUGE VALVE FOR L-551A, L-551S | (6M) SPRAY TEST | PM | 12/11/2024 | |
| 20241112 | 810H-C-00042 | B-F-120 | USE RURNACES | (3M) CONDITION CHECK (OSL 2020-061) | IM | 12/11/2024 | Furnace |
| 20241112 | 810D-C-00035 | B-F-140 | USE RURNACES | (3M) CONDITION CHECK (OSL 2020-060) | IM | 12/11/2024 | Furnace |
| 20241112 | 8NA-C-00052 | B-GE-2N1 | GROUPING FOR PM GE 2 Month group1 | (2Y)SET&CALIBRATE | PM | 12/11/2024 | |
| 20241112 | 804-C-00057 | B-CAZ-HS | GROUPING TAG FOR CAPACITY MAIN SUB | (1Y)CONDITION CHECK (OSL 2020-067) | PM | 12/11/2024 | |
| 20241112 | 857A-C-00024 | B-A-1201C | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2020-069) | PM | 12/11/2024 | Pump |
| 20241112 | 800-C-00060 | B-PIPE1-SC1 | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-067) | PM | 12/11/2024 | |
| 20241112 | 830A-S-00012 | B-R-575A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (6M)INSPECTION & LUBRICATE | PM | 12/11/2024 | |
| 20241112 | 8NA-C-00002 | B-SECUR-TASK02 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/11/2024 | |

| | | | | | | | |
|----------|---------------|-------------------|--|---|----|------------|---------|
| 20241112 | BNA-C-00012 | B-SECUR-TASK#5 | FOR PM: INSPECTION AND CHECK MOBILE GENE | (M)INSPECTION | PM | 12/11/2024 | |
| 20241112 | B9A-C-00011 | B-T-4308 | URG VAPORIZERS | (M) CONDITION CHECK (OSL 2021-068) | IM | 12/11/2024 | |
| 20241112 | B09F-C-00003 | B-T-061 | 1/N/NG/JARU FEED QD. HEATER | (M) CONDITION CHECK (OSL 2020-059) | IM | 12/11/2024 | |
| 20241112 | B021-C-00004 | B-AT-3600C | CG DEHYDRATORS BEDS | (M)MOISTURE ANALYZER AMETEK | PM | 12/11/2024 | |
| 20241111 | B38-C-00009 | B-E0ISRD | GROUPING FOR MCC 32 TAG | (V)INSPECT CONTROL WIRING/CONTACT RELAY | PM | 11/11/2024 | |
| 20241111 | B10D-C-00037 | B-F-140 | USC FURNACES | (M) CONDITION CHECK (OSL 2022-133) | IM | 11/11/2024 | Furnace |
| 20241111 | B30-C-00033 | B-FIC-49101 | P-4910A/S minimum flow controller | (V)SET/ & CALIBRATE | PM | 11/11/2024 | |
| 20241111 | B47D-C-00066 | B-HT-49101 | P-4910A/S discharge pneumatic transmitt | (V)SET & CALIBRATE (OUT-SOURCE) | PM | 11/11/2024 | |
| 20241111 | B06C-C-00042 | B-G-1122-4-5 | WWT CHEMICAL SEWER SUMP PIT | (M) CONDITION CHECK (OSL 2020-044) | IM | 11/11/2024 | WWT |
| 20241111 | B06F-C-00014 | B-H-19018 | GROUPING TAG FOR FUEL GAS TO TCC/CCO | (W)PURDATE N2, CO2, REL. DENSITY | PM | 11/11/2024 | |
| 20241111 | B04-C-00013 | B-MOTOR-MCCSUB-CT | GROUPING TAG FOR MOTOR-MCC SUB CT | (M)MOTOR WINDING INSUL RESISTANCE TEST | PM | 11/11/2024 | Motor |
| 20241111 | B00-C-00054 | B-MOTOR-MCCSUB-TK | GROUPING TAG FOR MOTOR-MCC SUB TANK | (M)MOTOR WINDING INSUL RESISTANCE TEST | PM | 11/11/2024 | Motor |
| 20241111 | B00-C-00050 | B-MOTOR-MCCSUB1 | GROUPING TAG FOR MOTOR-MCC SUB 1 | (M)MOTOR WINDING INSUL RESISTANCE TEST | PM | 11/11/2024 | Motor |
| 20241111 | B00-C-00051 | B-MOTOR-MCCSUB3 | GROUPING TAG FOR MOTOR-MCC SUB 3 | (M)MOTOR WINDING INSUL RESISTANCE TEST | PM | 11/11/2024 | Motor |
| 20241111 | B00-C-00052 | B-MOTOR-MCCSUB4 | GROUPING TAG FOR MOTOR-MCC SUB 4 | (M)MOTOR WINDING INSUL RESISTANCE TEST | PM | 11/11/2024 | Motor |
| 20241111 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (W)Weekly-Pit suction screen cleaning | PM | 11/11/2024 | Pump |
| 20241111 | B016-C-00024 | B-P-220A | QUENCH WATER CIRCULATION PUMP | (M) CONDITION CHECK (OSL 2022-135) | PM | 11/11/2024 | Pump |
| 20241111 | B001-C-00034 | B-P-901C | SHF BPW PUMPS | (M) CONDITION CHECK (OSL 2020-042) | PM | 11/11/2024 | Pump |
| 20241111 | B55-C-00002 | B-PDI-19005 | CLARIFIED WATER (CUC) | (V)SET & CALIBRATE (OUT-SOURCE) | PM | 11/11/2024 | |
| 20241111 | B53-C-00001 | B-PDI-19006 | DESLI WATER (CUC) | (V)SET & CALIBRATE (OUT-SOURCE) | PM | 11/11/2024 | |
| 20241111 | B47D-C-00001 | B-PDI-19011 | FR LEAT TO RAW WATER | (V)SET & CALIBRATE (OUT-SOURCE) | PM | 11/11/2024 | |
| 20241111 | B54-C-00001 | B-PDI-19012 | FR LEAT TO POT. WATER | (V)SET & CALIBRATE (OUT-SOURCE) | PM | 11/11/2024 | |
| 20241111 | B47D-C-00064 | B-PSH-49103 | P-4910A seal pot pressure switch | (V)SET & CALIBRATE (OUT-SOURCE) | PM | 11/11/2024 | |
| 20241111 | B47D-C-00065 | B-PSH-49104 | P-4910S seal pot pressure switch | (V)SET & CALIBRATE (OUT-SOURCE) | PM | 11/11/2024 | WWT |
| 20241111 | B061-C-00014 | B-Q-1135 | EQUALIZATION TANK | (M) CONDITION CHECK (OSL 2020-039) | IM | 11/11/2024 | |
| 20241111 | B19A-C-00060 | B-R-300P-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (M) CONDITION CHECK (OSL 2021-066) | IM | 11/11/2024 | |
| 20241111 | B19A-WK-0001 | B-R-300P-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (W)REGREASE & INSPECTION | PM | 11/11/2024 | |
| 20241111 | B17A-S-00001 | B-R-3105 | ETHYLENE FURNACE ID FANS#5 | (M) RE GREASE DAMPER BEARING | PM | 11/11/2024 | |
| 20241111 | B142B-WK-0001 | B-R-603-PT-15 | C&R SURFACE CONDENSER COND TURBINE | (W)REGREASE & INSPECTION | PM | 11/11/2024 | |
| 20241111 | B148-WK-0001 | B-R-603-PT-15 | C&R SURFACE CONDENSER COND TURBINE | (W)REGREASE & INSPECTION | PM | 11/11/2024 | |
| 20241111 | BNA-C-00021 | B-SECUR-TASK#5 | FOR PM: TEST FIRE PUMP | (V)FUNCTION TEST Smoke detector | PM | 11/11/2024 | |
| 20241111 | BNA-C-00055 | B-SECUR-TASK#20 | FOR PM: INSPECTION HALON SYSTEMS | (V)FUNCTION TEST Smoke detector | PM | 11/11/2024 | |
| 20241111 | BNA-C-00096 | B-SECUR-TASK#21 | INSPECTION CO2 SYSTEMS | (V)FUNCTION TEST Smoke detector | PM | 11/11/2024 | |
| 20241111 | BNA-C-00097 | B-SECUR-TASK#8 | FOR PM: INSPECTION FM-200 SYSTEMS | (V)FUNCTION TEST Smoke detector | PM | 11/11/2024 | |
| 20241111 | B027-C-00008 | B-T-390A | LP DEPROPANIZER REBOILERS | (M) CONDITION CHECK (OSL 2020-043) | IM | 11/11/2024 | |
| 20241111 | B38-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (M)INSPECT & ADJUST | PM | 11/11/2024 | |
| 20241110 | B12-C-00041 | B-AE-4000-01X | GROUPING TAG FOR L3 BD IN AIR ELEMENT | (V) INSPECTION & CLEANING. | PM | 10/11/2024 | |
| 20241110 | B12-C-00026 | B-AT-40202 | BITUTADIENE IR | (M)SET & CALIBRATE | PM | 10/11/2024 | |
| 20241110 | B12-C-00023 | B-AT-40303 | BITUTADIENE IR | (M)SET & CALIBRATE | PM | 10/11/2024 | |
| 20241110 | B12-C-00030 | B-AT-43061 | BITUTADIENE IR | (M)SET & CALIBRATE | PM | 10/11/2024 | |
| 20241110 | B13-S-00013 | B-BU-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B13-S-00014 | B-BU-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B13-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B13-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00052 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00053 | B-BU-BC-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00056 | B-BU-BC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00057 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.2 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00055 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.3 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00057 | B-BU-DC | BATTERY UNIT FOR 110VDC SUB.5 | (M)INSPECTION AND RECORD | PM | 10/11/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---------------------------------------|---|----|-----------|---------|
| 20241108 | B10K-C-00024 | B-F-1010 | USC PYROLYSIS FURNACE | (L)SY/CLEANING & INSPECTION(GROUP.2) | PM | 8/11/2024 | Furnace |
| 20241108 | B10K-C-00041 | B-F-1010 | USC PYROLYSIS FURNACE | (V)INSPECTION FURNACE(GROUP.AB2) | IM | 8/11/2024 | Furnace |
| 20241108 | B10K-C-00041 | B-F-1010 | USC PYROLYSIS FURNACE | (V)INTERNAL CLEANING USX (GROUP.U1) | PM | 8/11/2024 | Furnace |
| 20241108 | B10K-C-00041 | B-F-1010 | USC PYROLYSIS FURNACE | (V)INTERNAL CLEANING USX (GROUP.U1) | PM | 8/11/2024 | Furnace |
| 20241108 | B10K-C-00041 | B-F-1010 | USC PYROLYSIS FURNACE | (V)INTERNAL CLEANING USX (GROUP.U1) | PM | 8/11/2024 | Furnace |
| 20241108 | B10K-C-00041 | B-F-1010 | USC PYROLYSIS FURNACE | (V)INTERNAL CLEANING USX (GROUP.U1) | PM | 8/11/2024 | Furnace |
| 20241108 | B10K-C-00024 | B-F-1010 | USC PYROLYSIS FURNACE | (L)SY/CONDITION CHECK (GROUP.V) | IM | 8/11/2024 | Furnace |
| 20241108 | B10K-C-00004 | B-F-1010 | USC PYROLYSIS FURNACE | (V)CONVECTION CLEAN (GROUP.B) | PM | 8/11/2024 | Furnace |
| 20241108 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 8/11/2024 | |
| 20241108 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 8/11/2024 | |
| 20241108 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 8/11/2024 | |
| 20241108 | B49-C-00021 | B-G-1350-P-1 | LP VDC VCLARE NO DRUM LIQUID PUMP | RCM-(M)Short Term preservation | PM | 8/11/2024 | |
| 20241108 | B90-C-00006 | B-G-1350-P-1 | LP VDC VCLARE NO DRUM LIQUID PUMP | (W)TEST RUN | PM | 8/11/2024 | |
| 20241108 | B90-C-00005 | B-G-1350-P-1 | DIESEL ENGINE GENERATOR SET MOTOR | (W)FUNCTION TEST & EXERCISE | PM | 8/11/2024 | |
| 20241108 | B90-C-00075 | B-G-1350-P-1 | DIESEL ENGINE GENERATOR SET | (W)FUNCTION TEST & EXERCISE | PM | 8/11/2024 | |
| 20241108 | B10K-C-00041 | B-HV-10107 | DECOKE EFFLUENT TO F-1010 | DRL(V)HY-10107 B/T PLATE INS (GROUP.G) | PM | 8/11/2024 | |
| 20241108 | B10K-C-00002 | B-M-1010 | CRACKING FURNACE STEAM DRUMS | (V)INSPECTION DRUM BY LAW(GROUP.H) | IM | 8/11/2024 | |
| 20241108 | B10K-C-00002 | B-M-1010 | CRACKING FURNACE STEAM DRUMS | (V)SET/CALIBRATE STM DRN. BY LAW "H" | PM | 8/11/2024 | |
| 20241108 | B10A-C-00042 | B-M-110 | STEAM DRUM | (V)EXTERNAL INSPECTION BY LAW | IM | 8/11/2024 | |
| 20241108 | B10B-C-00052 | B-M-120 | STEAM DRUM | (V)EXTERNAL INSPECTION BY LAW | IM | 8/11/2024 | |
| 20241108 | B10C-C-00038 | B-M-130 | STEAM DRUM | (V)EXTERNAL INSPECTION BY LAW | IM | 8/11/2024 | |
| 20241108 | B10D-C-00043 | B-M-140 | STEAM DRUM | (V)EXTERNAL INSPECTION BY LAW | IM | 8/11/2024 | |
| 20241108 | B10E-C-00049 | B-M-150 | STEAM DRUM | (V)EXTERNAL INSPECTION BY LAW | IM | 8/11/2024 | |
| 20241108 | B10F-C-00045 | B-M-160 | STEAM DRUM | (V)EXTERNAL INSPECTION BY LAW | IM | 8/11/2024 | |
| 20241108 | B90-S-00018 | B-MCC-EO-2H1 | GROUPING TAG FOR MCC SUBSTATION#3 | (M)INSPECT & ADJUST | PM | 8/11/2024 | |
| 20241108 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (W)CLEAN STRAINER FOR B-P-1132 | PM | 8/11/2024 | Pump |
| 20241108 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (W)CLEAN STRAINER FOR B-P-1132 | PM | 8/11/2024 | Pump |
| 20241108 | B061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (W)CLEAN STRAINER FOR B-P-1136 | PM | 8/11/2024 | Pump |
| 20241108 | B061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (W)CLEAN STRAINER FOR B-P-1136 | PM | 8/11/2024 | Pump |
| 20241108 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (W)TEST RUN | PM | 8/11/2024 | Pump |
| 20241108 | B063-WK-0002 | B-P-1601B | ENGINE DRIVEN FIRE PUMP | (W)TEST RUN | PM | 8/11/2024 | Pump |
| 20241108 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (W)TEST RUN | PM | 8/11/2024 | Pump |
| 20241108 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (W)TEST RUN | PM | 8/11/2024 | Pump |
| 20241108 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (W)TEST RUN | PM | 8/11/2024 | Pump |
| 20241108 | B10K-C-00002 | B-PSV-10112 | M-1010 STM DRUM FOR F-1010 | (V)INSPECTION PSV M-1010(GROUP.H) | PM | 8/11/2024 | PSV |
| 20241108 | B10K-C-00002 | B-PSV-10113 | M-1010 STM DRUM FOR F-1010 | (V)INSPECTION PSV M-1010(GROUP.H) | PM | 8/11/2024 | PSV |
| 20241108 | B10K-C-00002 | B-PSV-10114 | F-1010 SHP STEAM OUT | (V)INSPECTION PSV M-1010(GROUP.H) | PM | 8/11/2024 | PSV |
| 20241108 | B13-C-00044 | B-UPS-2M1-A1 | 220 VAC UPS1 PANEL | (M)INSPECT/CONDITION CHECK | PM | 8/11/2024 | |
| 20241108 | B13-C-00045 | B-UPS-2M1-A2 | 220 VAC UPS1 PANEL(BYPASS) | (M)INSPECT/CONDITION CHECK | PM | 8/11/2024 | |
| 20241108 | B13-C-00046 | B-UPS-2M1-A3 | 220 VAC UPS1 PANEL | (M)INSPECT/CONDITION CHECK | PM | 8/11/2024 | |
| 20241108 | B12-S-00040 | B-V-4799 | OIL MIST SYSTEM | (M) MONTHLY & INSPECTION | PM | 8/11/2024 | |
| 20241107 | B41-C-00003 | B-AT-4700 | ETHYLENE TOWER | (M)SET & CALIBRATE | PM | 7/11/2024 | |
| 20241107 | BNA-C-00061 | B-CRUT-EQ-COLD-P1 | Critical Equipments Cold Area Plant 1 | (M)Visual & Condition Inspection | PM | 7/11/2024 | |
| 20241107 | BNA-C-00062 | B-CRUT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (M)Visual & Condition Inspection | PM | 7/11/2024 | |
| 20241107 | B38-C-00113 | B-CRITICAL-EQ-HOT | GROUPING TAG FOR PH. SEC. PLANT#1 | (M)Visual & Condition Inspection | PM | 7/11/2024 | |
| 20241107 | B12-S-00028 | B-G-4801-R-1A | COOLING WATER FANS | (M)COOLING GEARBOX & FAN VISUAL INSPECT | PM | 7/11/2024 | |
| 20241107 | B12-S-00029 | B-G-4801-R-1B | COOLING WATER FANS | (M)COOLING GEARBOX & FAN VISUAL INSPECT | PM | 7/11/2024 | |
| 20241107 | B12-S-00030 | B-G-4801-R-1C | COOLING WATER FANS | (M)COOLING GEARBOX & FAN VISUAL INSPECT | PM | 7/11/2024 | |
| 20241107 | B12-S-00032 | B-G-4801-R-1D | COOLING WATER FANS | (M)COOLING GEARBOX & FAN VISUAL INSPECT | PM | 7/11/2024 | |
| 20241107 | B10K-S-00001 | B-R-1010 | FURNACE ID FANS | RCM-(M)INSPECT & LUBRICATE | PM | 7/11/2024 | |

| | | | | | | | |
|----------|-----------------|------------------|--|-------------------------------------|----|------------|------------|
| 20241110 | B90-S-00058 | B-BU-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (3M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00062 | B-BU-UPS-2 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00060 | B-BU-UPS1-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B90-S-00061 | B-BU-UPS2-1 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/11/2024 | |
| 20241110 | B10B-C-00012 | B-F-120 | USC FURNACES | (6M)REGREASE DAMPER BEARING. | PM | 10/11/2024 | Furnace |
| 20241110 | B10C-C-00011 | B-F-130 | USC FURNACES | (6M)REGREASE DAMPER BEARING. | PM | 10/11/2024 | Furnace |
| 20241110 | B61-C-00010 | B-G-1144-P-S | UREA FEED PUMP | (1Y)LUBRICATION | PM | 10/11/2024 | |
| 20241110 | B0P-C-00002 | B-G-1167 | DMF | (3M)LUBRICATION & CHANGE LUBE OIL | PM | 10/11/2024 | |
| 20241110 | B0P-C-00001 | B-G-3100 | ELEVATOR | (1M)INSPECTION AND FUNCTION TEST | PM | 10/11/2024 | |
| 20241110 | BWS-S-00002 | B-HYDRAULIC-01 | HYDRAULIC STATIC PRESS. 30 T | (3M)INSPECTION & INSPECTION | PM | 10/11/2024 | |
| 20241110 | B0P-C-00002 | B-MOTOR-EO-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 10/11/2024 | Motor |
| 20241110 | B90-C-00188 | B-O9G15 | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/11/2024 | |
| 20241110 | B61-C-00122 | B-P-11575 | FINAL FILTER BACKWASH SUMP PUMP | (3M)REGREASE | PM | 10/11/2024 | Pump |
| 20241110 | B63-S-00013 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | RCM(3M)REGREASE COUPLING | PM | 10/11/2024 | Pump |
| 20241110 | B001-S-00002 | B-PSV-9001 | OUTLET V-900-P-1S | (3Y)INSPECTION & OVERHAUL PSV | PM | 10/11/2024 | PSV |
| 20241110 | B31-C-00037 | B-R-701S | GHF RECYCLE H2 COMPRESSOR | (6M)INSPECT & ADJUST | PM | 10/11/2024 | Compressor |
| 20241110 | BNA-C-00010 | B-SECUR-TASK18 | INSPECTION FIRE ALARM STATION | (1M)INSPECTION | PM | 10/11/2024 | |
| 20241110 | B20-C-00002 | B-SECUR-TASK43 | VISUAL INSPECTION MOBILE FOAM U | (1M)INSPECTION | PM | 10/11/2024 | |
| 20241110 | B60-C-00038 | B-SPEAKER-ES-003 | GROUPING TAG FOR SPEAKER/HORN FOLLOW TA | (3M)FUNCTION TEST & EXERCISE | PM | 10/11/2024 | |
| 20241110 | B90-C-00114 | B-SWGR-EO-40 | Grouping Tag for 6.8KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 10/11/2024 | |
| 20241110 | B20-C-00071 | B-UPS-004 | GROUPING FOR UPS 125 KVA | (3M)SPECIFIC GRAVITY TEST | PM | 10/11/2024 | |
| 20241110 | B001-S-00002 | B-V-900-P-1S | HYDRAZINE INJECTION PUMP | (V)INSPECTION, CLEAN, LUBRICATE | PM | 10/11/2024 | |
| 20241110 | B15-C-00001 | B-XV-330101 | SH STM TO R3301-PT-01A | RCM (1Y) CLEAN&INSPECTION | IM | 10/11/2024 | |
| 20241110 | B081-C-00001 | B-AT-1100/1900 | PGC EFFLUENT FROM F-110/F-190 | (1M)SET & CALIBRATION | PM | 9/11/2024 | |
| 20241110 | B09P-C-00006 | B-AT-310001A/L-3 | GROUPING TAG CEMS F-3104 TO F-3103 | (1M)SET&CALIBRATION | PM | 9/11/2024 | |
| 20241110 | B07-C-00006 | B-AT-310001B/4-6 | GROUPING TAG CEMS F-3104 TO F-3106 | (1M)SET&CALIBRATION | PM | 9/11/2024 | |
| 20241110 | B1T-C-00021 | B-FW-19-04-03 | MOBILE NITROGEN HEATER | (1Y)INSPECTION | PM | 9/11/2024 | |
| 20241110 | B47D-C-00018 | B-FT-19010 | FLOW TX FOR FMT-19011 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 9/11/2024 | |
| 20241110 | B58-C-00002 | B-FT-19017A | N2 OLEFIN PLANT | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 9/11/2024 | |
| 20241110 | B68-C-00002 | B-FT-19017B | N2 OLEFIN PLANT | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 9/11/2024 | |
| 20241110 | B60-C-00054 | B-G-1112-P-3A | Oxidized spent CAUSTIC TRANSFER PUMPS | (1Y)LUBRICATE | PM | 9/11/2024 | |
| 20241110 | B61-C-1122-P-1A | B-G-1122-P-1A | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/11/2024 | |
| 20241110 | B66-S-00002 | B-C-1122-P-1S | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/11/2024 | |
| 20241110 | B62-C-00018 | B-G-1141-P-1A | FILTER PRESS FEED PUMP | (1Y)LUBRICATION | PM | 9/11/2024 | |
| 20241110 | B0P-C-00040 | B-H-19007 | GROUPING TAG FOR ETHYLENE TO FROM-1-1 | (4M)SET & CALIBRATE | PM | 9/11/2024 | |
| 20241110 | B0P-C-00053 | B-H-19008 | GROUPING TAG FOR ETHYLENE TO VNT | (4M)SET & CALIBRATE | PM | 9/11/2024 | |
| 20241110 | B29-C-00004 | B-MP-541A | PROPYLENE PRODUCT PUMP MOTOR | (1Y)CHANGE LUBE.OIL. MOTORS. | PM | 9/11/2024 | |
| 20241110 | B61-C-00128 | B-P-1167S | FIRE FIGHTING TRAINING AREA SUMP PUMP | (6M)REGREASE | PM | 9/11/2024 | Motor |
| 20241110 | B2B-S-00015 | B-PSV-2631 | OUTLET V-263-P-1S | (3Y)INSPECTION & OVERHAUL PSV | PM | 9/11/2024 | PSV |
| 20241110 | BNA-C-00009 | B-SECUR-TASK17 | INSPECTION FOAM STORAGE TANK,FOA | (1M)INSPECTION | PM | 9/11/2024 | |
| 20241110 | B90-C-00120 | B-SWGR-EO-40 | Grouping Tag for 6.8KV SWGR Sub#5 | (1Y) INSPECT & ADJUST | PM | 9/11/2024 | |
| 20241110 | B081-S-00002 | B-V-263-P-1S | CAUSTIC INJECTION PUMP | (V)INSPECTION, CLEAN, LUBRICATE | PM | 9/11/2024 | |
| 20241110 | B63-C-00041 | B-WM-1640 | WATER MONITOR AREA TANK | (6M)WM TANK LUBRICATION | PM | 9/11/2024 | |
| 20241110 | B63-C-00041 | B-WM-1641 | WATER MONITOR AREA TANK | (6M)WM TANK LUBRICATION | PM | 9/11/2024 | |
| 20241110 | B63-C-00041 | B-WM-1642 | WATER MONITOR AREA TANK | (6M)WM TANK LUBRICATION | PM | 9/11/2024 | |
| 20241110 | B63-C-00041 | B-WM-1643 | WATER MONITOR AREA TANK | (6M)WM TANK LUBRICATION | PM | 9/11/2024 | |
| 20241110 | B01B-C-00019 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2021-078) | IM | 8/11/2024 | |
| 20241110 | BH3C-C-00001 | B-AT-342001 | MOISTURE ANALYZER TRANSMITTER FOR M-3420 | (2M)SET & CALIBRATE | PM | 8/11/2024 | |
| 20241110 | B46A-C-00021 | B-DV-1562 | DELUGEVALVE FOR Q-1522 | (6M) Spray Test | PM | 8/11/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|-----------|--------------|
| 20241106 | B0P5-C-00015 | B-MOTOR-EG-012 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/11/2024 | Motor |
| 20241106 | B103-C-00003 | B-MR-190 | FURNACE ID FAN MOTOR | (1Y)INSPECTION (GROUP M) | PM | 6/11/2024 | |
| 20241106 | B90-C-00170 | B-OSAVR | GROUPING FOR 115KV AVR | (1M)VISUAL INSPECT/RECORD DATA | PM | 6/11/2024 | |
| 20241106 | B90-C-00171 | B-OSGVS | GROUPING FOR 115KV GIS | (1M)ISRF/VISUAL INSPECT/RECORD DATA | PM | 6/11/2024 | |
| 20241106 | B112-C-00107 | B-P-4851A | OWS SUMP PUMPS | (3M) REGREASE | PM | 6/11/2024 | Pump |
| 20241106 | B112-C-00108 | B-P-4851B | OWS SUMP PUMPS | (3M) REGREASE | PM | 6/11/2024 | Pump |
| 20241106 | B30-C-00015 | B-PSV-5600A | T-567 TO HOT FLARE | (GY)SET & CALIBRATE (PSV 1 1/202) | PM | 6/11/2024 | PSV |
| 20241106 | B90-C-00022 | B-RM-3103 | ETHYLENE FURNACE ID FAN#3 | (1Y)ID Fan Lubricate,Inspection (Group M) | PM | 6/11/2024 | |
| 20241106 | B90-C-00023 | B-RM-3103 | ETHYLENE FURNACE ID FAN#3 MOTOR | (1Y)ID Fan Motor Inspection (Group M) | PM | 6/11/2024 | |
| 20241106 | B103-C-00017 | B-34-3231-Q1 | CONDENSATE STRAINER TANK | (3M) CONDITION CHECK (OSL 2021-102) | PM | 6/11/2024 | |
| 20241106 | B13-C-00003 | B-V-740-P-3 | SODIUM SULFIDE PUMP | (1Y)CHECK & LUBRICATE | PM | 6/11/2024 | |
| 20241106 | B112-C-00709 | B-VALVE-P-3 | VALVE PROCESS OLE 2-3 | (1M) CHECK VOCS | PM | 6/11/2024 | |
| 20241106 | B0V5-C-00031 | B-CRANE-PITGCS | GROUPING TAG FOR CRANE PITGCS | (6M) PT CRANE 19 UNITS (OUT-SOURCE) | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-C02 | FIRE ALARM CONTROL PANEL FOR CO2 | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-C02-1 | CO2 SYSTEM CONTROL PANEL (GIS) | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-C02-2 | CO2 SYSTEM CONTROL PANEL (SWGR) | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-FM200 | FIRE ALARM CONTROL PANEL FOR FM-200 | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-MFA-01 | FIRE ALARM CONTROL PANEL FOR MASTER | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-MFA-01 | FIRE ALARM CONTROL PANEL FOR MASTER | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-SUB3 | FIRE ALARM CONTROL PANEL | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-SUB4 | FIRE ALARM CONTROL PANEL | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-TR-1 | FIXED WATER SPRAY CONTROL PANEL (DV-1666) | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B009-C-00007 | B-FACP-TR-2 | FIXED WATER SPRAY CONTROL PANEL (DV-1667) | (3M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B52A-C-00019 | B-G-1201 | COOLING TOWER | (6M)INSPECTION/CLEANING BAR SCREEN | PM | 5/11/2024 | |
| 20241106 | B43C-C-00008 | B-MR-600-P-4A | CZR OIL PURIFIER PUMP MOTOR | (1M)VISUAL CHECK | PM | 5/11/2024 | |
| 20241106 | B35-C-00021 | B-PSV-8009A | K-8005 TO HOT FLARE | (2M)SET & CALIBRATE (PSV 1 1/202) | PM | 5/11/2024 | PSV |
| 20241106 | B04-C-00001 | B-R-110 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate,Inspection | PM | 5/11/2024 | |
| 20241106 | B10B-S-00001 | B-R-120 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate,Inspection | PM | 5/11/2024 | |
| 20241106 | B10B-S-00001 | B-R-130 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate,Inspection | PM | 5/11/2024 | |
| 20241106 | B10D-S-00001 | B-R-140 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate,Inspection | PM | 5/11/2024 | |
| 20241106 | B10E-S-00001 | B-R-150 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate,Inspection | PM | 5/11/2024 | |
| 20241106 | B10F-S-00001 | B-R-160 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate,Inspection | PM | 5/11/2024 | |
| 20241106 | B43C-C-00008 | B-R-600-P-4A | LUBE OIL PURIFIER | RCM-(1M)VISUAL INSPECTION | PM | 5/11/2024 | |
| 20241106 | B0P5-C-00011 | B-SVIDRG | GROUPING FOR BLOCK VALVE | (1Y)INSPECTION / LUBRICATION | PM | 5/11/2024 | |
| 20241106 | B90-C-00094 | B-UPSI-A1 | UPSI FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/11/2024 | |
| 20241106 | B90-C-00095 | B-UPSI-A2 | UPSI (BYPASS) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/11/2024 | |
| 20241106 | B90-C-00096 | B-UPSI-A3 | UPSI FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/11/2024 | |
| 20241106 | B1-C-00018 | B-AT-9010 | BRW FROM DEAERATOR | (2M)CALIBRATION | PM | 4/11/2024 | |
| 20241106 | B13-C-00053 | B-CAP-1M1 | POWER CAPACITOR PANEL-1 | (1M)VISUAL INSPECTION | PM | 4/11/2024 | |
| 20241106 | B13-C-00054 | B-CAP-1M1 | POWER CAPACITOR PANEL-2 | (1M)VISUAL INSPECTION | PM | 4/11/2024 | |
| 20241106 | B13-C-00057 | B-EHT-001 | ELECTRICAL HEAT TRACING CONTROL PANEL | (1M)VISUAL INSPECTION | PM | 4/11/2024 | |
| 20241106 | B10H-C-00010 | B-F-180 | USC FURNACES | (6M)REGREASE DAMPER BEARING. | PM | 4/11/2024 | Furnace |
| 20241106 | B061-S-00011 | B-G-1144-A-2B | FINAL CLARIFIER AGITATOR | RCM-(1Y)INSPECTION & LUBRICATION | PM | 4/11/2024 | |
| 20241106 | B061-S-00010 | B-G-1144-A-2B | SLUDGE RETURN PUMP | (3M) CONDITION CHECK (OSL 2021-078) | PM | 4/11/2024 | |
| 20241106 | B13-C-00048 | B-GAS-DETECTOR-BV | Grouping for Gas Detector BV | (4M)CAL GAS DETECTOR PLANT/BV(OUT-SOURCE) | PM | 4/11/2024 | Gas Detector |
| 20241106 | B13-C-00049 | B-GAS-DETECTOR-BV | Gas detector Ratintrate metering skid | (4M)CAL GAS DETECTOR PLANT/BV(OUT-SOURCE) | PM | 4/11/2024 | Gas Detector |
| 20241106 | B13-C-00048 | B-GAS-DETECTOR-BV | Gas detector Ratintrate metering skid | (4M)CAL GAS DETECTOR PLANT/BV(OUT-SOURCE) | PM | 4/11/2024 | Gas Detector |
| 20241106 | B090-S-00001 | B-MCC-68KV-SUB1 | Grouping For 6.6 KV MCC SUB 1 | (6M)INSPECTION INFRARED | PM | 4/11/2024 | |
| 20241106 | B30-C-00023 | B-MDB-4A2-2 | MAIN DISTRIBUTION BOARD FOR NEW LAB BUILD | (6M)INSPECT CABLE/TIGHTNESS NUTS/SCREWS. | PM | 4/11/2024 | |
| 20241106 | B30-C-00023 | B-MDB-4B2-1 | MAIN DISTRIBUTION BOARD FOR NEW CCB BUILD | (6M)INSPECT CABLE/TIGHTNESS NUTS/SCREWS. | PM | 4/11/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|-----------|---------|
| 20241104 | B38-S-00002 | B-MOTOR-EP-NA-003 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING | PM | 4/11/2024 | Motor |
| 20241104 | B063-WX-0001 | B-P-1501A | FIRE MAIN PUMP | (1Y)Weekly Pit suction screen cleaning | PM | 4/11/2024 | Pump |
| 20241104 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM TEST FIRE PUMP | (1Y)INSPECTION | PM | 4/11/2024 | |
| 20241104 | B20-C-00001 | B-SECUR-TASK04 | VISUAL INSPECTION CO2 SYSTEM MA | (1M)INSPECTION | PM | 4/11/2024 | |
| 20241104 | B11-C-00058 | B-SUT-ERMCS | ELECTRICAL REMOTE MONITORING & CONTROL S | (1M)VISUAL INSPECTION | PM | 4/11/2024 | |
| 20241104 | B090-S-00002 | B-SWGR-SUB1 | Grouping For 6.6 KV SWGR SUB 1 | (6M)INSPECTION INFRARED | PM | 4/11/2024 | |
| 20241104 | B63-C-00096 | B-WM-1612 | WATER MONITOR AREA QUENCH | (6M)WM QUENCH LUBRICATION | PM | 4/11/2024 | |
| 20241104 | B63-C-00096 | B-WM-1613 | WATER MONITOR AREA QUENCH | (6M)WM QUENCH LUBRICATION | PM | 4/11/2024 | |
| 20241104 | B63-C-00096 | B-WM-1614 | WATER MONITOR AREA QUENCH | (6M)WM QUENCH LUBRICATION | PM | 4/11/2024 | |
| 20241104 | B63-C-00096 | B-WM-1615 | WATER MONITOR AREA QUENCH | (6M)WM QUENCH LUBRICATION | PM | 4/11/2024 | |
| 20241103 | B53-C-00037 | B-AT-22177 | ISO14000,PH DISCHARGE LINE G-2217-P-4A/B | (1M)SET&CALIBRATE | PM | 3/11/2024 | |
| 20241103 | B0P7-C-00032 | B-AT-320201 | 1-4 ANALYZER TRANSMITTER FOR V-302 OUT | (3M)SET & CALIBRATE | PM | 3/11/2024 | |
| 20241103 | BH11-C-00014 | B-AT-330104 | NACHI ANALYZER TRANSMITTER FOR A-3301 BTM | (3M)SET & CALIBRATE | PM | 3/11/2024 | |
| 20241103 | B112-C-00663 | B-AT-400001 | 1, 3 Butadiene In Air GCG | (1M)SET&CALIBRATE | PM | 3/11/2024 | |
| 20241103 | B12-C-00667 | B-AT-404801 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 3/11/2024 | |
| 20241103 | B007-C-00003 | B-AT-9211 | ISO14000, SUMP Q-920 TO Q-1145 | (1M)SET&CALIBRATE | PM | 3/11/2024 | |
| 20241103 | B90-C-00002 | B-E-F-11 | MASTER FIRE ALARM PANEL AT NEW CCB CONTR | (1M)CO2 SYSTEM CHECK | PM | 3/11/2024 | |
| 20241103 | B90-C-00002 | B-E-F-12 | LOCAL FIRE ALARM PANEL AT SUB.2 | (1M)CO2 SYSTEM CHECK | PM | 3/11/2024 | |
| 20241103 | B90-C-00002 | B-E-F-13 | LOCAL FIRE ALARM PANEL AT SUB PROCESS | (1M)CO2 SYSTEM CHECK | PM | 3/11/2024 | |
| 20241103 | B10A-C-00011 | B-F-110 | USC FURNACES | (6M)REGREASE DAMPER BEARING. | PM | 3/11/2024 | Furnace |
| 20241103 | B61-S-00120 | B-G-1168 | NEW SLUDGE DEWATERING UNIT (DECANTER) | (3M)LUBRICATION & CHANGE GREASE | PM | 3/11/2024 | |
| 20241103 | BNA-C-00051 | B-GC-1M | GROUPING FOR PM GC 1 Month | (1M)SET & CALIBRATION | PM | 3/11/2024 | |
| 20241103 | B46-C-00020 | B-IRP-BV | IRP GROUPING FOR BV | (1M)INSPECTION | PM | 3/11/2024 | |
| 20241103 | B0P-C-00064 | B-MCC-0E-003 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1M)UPDATE N2, CO2, REL DENSITY | PM | 3/11/2024 | |
| 20241103 | B90-C-00030 | B-MCC-0E-003 | GROUPING TAG FOR MCC SUBSTATION#3 | (3M)INSPECT & ADJUST | PM | 3/11/2024 | |
| 20241103 | B090-C-00009 | B-MCC-SUB1 | MCC FOR PLUG-IN MCCB | (2M)Thermocan & Inspection | PM | 3/11/2024 | |
| 20241103 | B003-C-00028 | B-MCC-TANK | MCC FOR PLUG-IN MCCB | (2M)Thermocan & Inspection | PM | 3/11/2024 | |
| 20241103 | B003-C-00028 | B-MCC-TANK | MCC FOR PLUG-IN MCCB | (2M)Thermocan & Inspection | PM | 3/11/2024 | |
| 20241103 | B90-C-00178 | B-MOTOR-BI-1237BC | MOTOR GROUPING FOR BI-BC | (3M)LUBRICATION | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00177 | B-MOTOR-BI-1237BC | MOTOR GROUPING FOR BI-BC | (1M)CLEANING & INSPECTION | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00180 | B-MOTOR-BI-7A | MOTOR GROUPING FOR BI-A | (1M)CLEANING AND INSPECTION. | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00181 | B-MOTOR-BI-7A | MOTOR GROUPING FOR BI-A | (3M)LUBRICATION | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00182 | B-MOTOR-BI-7A | MOTOR GROUPING FOR BI-A | (6M)MOTOR WINDING INSULATION RESISTANCE | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00184 | B-MOTOR-BE-08C | MOTOR GROUPING FOR BEU-8C | (1M)CLEANING & INSPECTION | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00185 | B-MOTOR-BE-08C | MOTOR GROUPING FOR BEU-8C | (6M)MOTOR WINDING INSULATION RESISTANCE | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00184 | B-MOTOR-BE-08C | MOTOR GROUPING FOR BEU-8C | (3M)LUBRICATION | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00183 | B-MOTOR-BE-08C | MOTOR GROUPING FOR BEU-8C | (1M)CLEANING AND INSPECTION. | PM | 3/11/2024 | Motor |
| 20241103 | B0P5-C-00045 | B-MOTOR-EG-010 | GROUPING FOR MOTORS CONSOLE#6 | (3M)CLEANING & INSPECTION/ LUBRICATION | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00187 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-8C | (3M)LUBRICATION | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00188 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-8C | (6M)MOTOR WINDING INSULATION RESISTANCE | PM | 3/11/2024 | Motor |
| 20241103 | B90-C-00186 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-8C | (1M)CLEANING AND INSPECTION. | PM | 3/11/2024 | Motor |
| 20241103 | B43C-C-00002 | B-MR-650-P-1A | CZR COND. CONDENSATE PUMP MOTOR | (1Y)LUBRICATION | PM | 3/11/2024 | |
| 20241103 | B61-C-00121 | B-P-1152A | FINAL FILTER BACKWASH SUMP PUMP | (3M)REGREASE | PM | 3/11/2024 | Pump |
| 20241103 | B90-C-00250 | B-SD-BC-1 | DISTRIBUTION PANEL OF BC BOARD SUB5 NO.1 | (1M)INSPECTION | PM | 3/11/2024 | |
| 20241103 | B90-C-00250 | B-SD-BC-2 | DISTRIBUTION PANEL OF BC BOARD SUB5 NO.2 | (1M)INSPECTION | PM | 3/11/2024 | |
| 20241103 | B90-C-00250 | B-SD-BC-3 | DISTRIBUTION PANEL OF BC 110VDC SUB.3 | (1M)INSPECTION | PM | 3/11/2024 | |
| 20241103 | B90-C-00250 | B-SD-BC-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PM | 3/11/2024 | |
| 20241103 | B90-C-00250 | B-SD-BC-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PM | 3/11/2024 | |
| 20241103 | B48-C-00015 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1M)INSPECTION | PM | 3/11/2024 | |
| 20241103 | B009-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.6 | (1M)INSPECTION | PM | 3/11/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|---------|------------|--|
| 20241101 | B12-C-00056 | B-GS-2F5 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 1/11/2024 | |
| 20241101 | B90-C-00005 | B-GS-2F5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 1/11/2024 | |
| 20241101 | B90-C-00075 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 1/11/2024 | |
| 20241101 | B0121MCM01 | B-INSP-CM-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/11/2024 | |
| 20241101 | B0121MCM01 | B-INSP-CM-OLE2-1-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/11/2024 | |
| 20241101 | B0121MCM01 | B-INSP-CM-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/11/2024 | |
| 20241101 | B0121MCM01 | B-INSP-CM-OLE2-2-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/11/2024 | |
| 20241101 | B0121MCM01 | B-INSP-CM-OLE2-3-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/11/2024 | |
| 20241101 | BNA-C-00037 | B-LOCAL-2M | GROUPING FOR PM LOCAL ANALYZER 2 Month | (2M)SET & CALIBRATE | PM | 1/11/2024 | |
| 20241101 | B005-C-00001 | B-MOTOR-EO-D08 | GROUPING TAG FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION | Motor | 1/11/2024 | |
| 20241101 | B35-S-00001 | B-MOTOR-EP-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING | Motor | 1/11/2024 | |
| 20241101 | B061-E-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | Pump | 1/11/2024 | |
| 20241101 | B061-E-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | Pump | 1/11/2024 | |
| 20241101 | B061-E-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | Pump | 1/11/2024 | |
| 20241101 | B061-E-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | Pump | 1/11/2024 | |
| 20241101 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | Pump | 1/11/2024 | |
| 20241101 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | Pump | 1/11/2024 | |
| 20241101 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | Pump | 1/11/2024 | |
| 20241101 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | Pump | 1/11/2024 | |
| 20241101 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | Pump | 1/11/2024 | |
| 20241101 | B11-C-00066 | B-P-3403A | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE to Bearing Mechanical Seal | Pump | 1/11/2024 | |
| 20241101 | B11-C-00067 | B-P-3403S | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE to Bearing Mechanical Seal | Pump | 1/11/2024 | |
| 20241101 | B41-C-00026 | B-P-478A | ETHYLENE PRODUCT PUMP | (3Y)CLEANING | Pump | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P1-CCS-CGC | ANTI-SURGE AND PERFORMANCE CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P1-CCS-FRC | ANTI-SURGE AND PERFORMANCE CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P1-CCS-PRC | ANTI-SURGE AND PERFORMANCE CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P1-PSA1 | PRESSURE SWING ADSORPTION | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00023 | B-PLC-P1-PRC | TURBOMACHINERY CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P2-TTCC-CGC | TURBOMACHINERY CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P2-TTCC-ERC | TURBOMACHINERY CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P2-TTCC-PRC | TURBOMACHINERY CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P2-PSA2 | PRESSURE SWING ADSORPTION | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B00-C-00022 | B-PLC-P2-TTCC | INTEGRATED TURBINE COMPRESSOR CONTROL | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/11/2024 | |
| 20241101 | B2-C-00007 | B-PSV-9030S | SHHP-STM LETDOWN STN | (5M)SET & CALIBRATE(PSV 406) | PSV | 1/11/2024 | |
| 20241101 | BNA-C-00068 | B-SECUR-TASK#8 | FOR PM : INSPECTION FM-200 SYSTEMS | (1M) Visual inspection FM-200 system (RA | PM | 1/11/2024 | |
| 20241101 | B00-C-00033 | B-SECUR-TASK#1 | Smoke / Heat detector system : Control a | (1M)Visual Inspection | PM | 1/11/2024 | |
| 20241101 | B10X-C-00053 | B-P-1010 | USC PYROLYSIS FURNACE | (3Y)COIL & REFRACTORY INSPECTION GROUP C | Furnace | 31/10/2024 | |
| 20241101 | B40-C-00087 | B-G-113-2-1A | HIGH PRESSURE FEED PUMPS | (1M)CLEAN STRAINER&INSPECTION | Pump | 31/10/2024 | |
| 20241101 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NOT (MUNINGATE) | (1D)INSPECTION | PM | 31/10/2024 | |
| 20241101 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYVARI) | (1D)INSPECTION | PM | 31/10/2024 | |
| 20241101 | B20-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBUJANCE(JITRIKUSA) | (1D)INSPECTION | PM | 31/10/2024 | |
| 20241101 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 31/10/2024 | |
| 20241101 | B32-C-00071 | B-SM-0302 | HAND HELD DI. MULTIMETER | (1Y)CALIBRATION HANDHELD DI. MULTIMETER | PM | 31/10/2024 | |
| 20241101 | B32-C-00026 | B-SM-0305S | HAND HELD DI. MULTIMETER | (1Y)CALIBRATION HANDHELD DI. MULTIMETER | PM | 31/10/2024 | |
| 20241101 | B32-C-00006 | B-SM-0306S | HAND HELD DI. MULTIMETER | (1Y)CALIBRATION HANDHELD DI. MULTIMETER | PM | 31/10/2024 | |
| 20241101 | B32-C-03034 | B-SM-0308 | RMS MULTIMETER | (1Y)CALIBRATION RMS MULTIMETER | PM | 31/10/2024 | |
| 20241101 | B32-C-03073 | B-SM-0309 | RMS MULTIMETER | (1Y)CALIBRATION RMS MULTIMETER | PM | 31/10/2024 | |
| 20241101 | B32-C-03036 | B-SM-0310 | RMS MULTIMETER | (1Y)CALIBRATION RMS MULTIMETER | PM | 31/10/2024 | |
| 20241101 | B32-C-00012 | B-SM-0702 | DIGITAL MULTIMETER | (1Y)CAL. DIGITAL MULTIMETER(OUT-SOURCE) | PM | 31/10/2024 | |

| | | | | | | | |
|----------|--------------|----------------|---|---|----|------------|--|
| 20241031 | B32-C-00056 | B-SM-0401 | DOCUMENTING PROCESS CALIBRATE | (1Y)CAL. DOCUMENTING PROCESS(OUT-SOURCE) | PM | 31/10/2024 | |
| 20241031 | B32-C-00053 | B-SP-1102 | PORTABLE PRESS. CALIBRATOR | (1Y)CAL. PORTABLE HAND PUMP(OUT-SOURCE) | PM | 31/10/2024 | |
| 20241031 | B32-C-00014 | B-ST-0402 | HANDHELD DI. THERMOMETER | (1Y)CAL. HANDHELD DI. THERMO(OUT-SOURCE) | PM | 31/10/2024 | |
| 20241031 | B32-C-00025 | B-ST-0501 | DI THERMOMETER FOR FIELD | (1Y)CAL. DILTHER. FOR FIELD(OUT-SOURCE) | PM | 31/10/2024 | |
| 20241030 | B12-C-00782 | B-1036-CO2-001 | CO2 Portable for OLE2/3 | (1M)CO2 Portable Visual Inspection | IM | 30/10/2024 | |
| 20241030 | B12-C-00783 | B-1036-CO2-001 | CO2 Portable for OLE2/3 | (6M)CO2 Portable weight Test | IM | 30/10/2024 | |
| 20241030 | B12-C-00788 | B-1036-DC-001 | Dry Chemical for OLE2/3 | (1M)Dry Chemical Visual Inspection | IM | 30/10/2024 | |
| 20241030 | B12-C-00791 | B-1036-DV-001 | Deluge Valve for Grouping 1(OLE2/3)/7tag | (6M)Deluge Valve Spray Test | PM | 30/10/2024 | |
| 20241030 | B12-C-00792 | B-1036-DV-002 | Deluge Valve for Grouping 2(OLE2/3)/7tag | (6M)Deluge Valve Spray Test | PM | 30/10/2024 | |
| 20241030 | B12-C-00795 | B-1036-FH-003 | Deluge Valve for Grouping 3(OLE2/3)/6tag | (6M)Deluge Valve Spray Test | PM | 30/10/2024 | |
| 20241030 | B12-C-00796 | B-1036-FA-001 | All Manual Fire Alarm for OLE2/3 | (1M)Manual Fire Alarm Visual Inspect&Test | IM | 30/10/2024 | |
| 20241030 | B12-C-00800 | B-1036-FH-001 | Fire Hose House for OLE2/3 | (6M)Fire Hose Box Test | IM | 30/10/2024 | |
| 20241030 | B12-C-00804 | B-1036-FH-001 | FM200 for Rack Room (OLE2/3) | (1M)FM200 System Visual Inspection | IM | 30/10/2024 | |
| 20241030 | B12-C-00803 | B-1036-FH-001 | FM200 for Rack Room (OLE2/3) | (6M)FM200 Cleaning and Function Test | IM | 30/10/2024 | |
| 20241030 | B12-C-00772 | B-1036-FV-001 | Post Indicator Valve for OLE2/3 | (6M)Post Indicator Valve Exercise | IM | 30/10/2024 | |
| 20241030 | B42B-C-00013 | B-R-600-PT-15 | C2R SURFACE CONDENSER COND.TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/10/2024 | |
| 20241030 | B43B-C-00038 | B-R-650-PT-15 | C3R COMP SURFACE CONDENSER COND.TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/10/2024 | |
| 20241029 | B00-C-00130 | B-1034-CO2-001 | CO2 Portable for OLE OLE2/1 | (1M) CO2 Portable Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00131 | B-1034-DC-001 | Dry Chemical for OLE2/1 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/10/2024 | |
| 20241029 | B00-C-00129 | B-1034-DC-002 | Dry Chemical for Admin | (1M)INSPECTION | IM | 29/10/2024 | |
| 20241029 | B00-C-00001 | B-1034-DV-001 | Deluge Valve for OLE OLE2/1/Group 1 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00002 | B-1034-DV-002 | Deluge Valve for OLE OLE2/1/Group 2 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00003 | B-1034-DV-003 | Deluge Valve for OLE OLE2/1/Group 3 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00004 | B-1034-DV-004 | Deluge Valve for OLE OLE2/1/Group 4 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00005 | B-1034-DV-005 | Deluge Valve for OLE OLE2/1/Group 5 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00006 | B-1034-DV-006 | Deluge Valve for OLE OLE2/1/Group 6 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00133 | B-1034-FA-001 | All Manual Fire Alarm for OLE2/1 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/10/2024 | |
| 20241029 | B00-C-00130 | B-1034-FDC-001 | Fire Department Connection for Admin | (1M)Fire Department Connection Visual | IM | 29/10/2024 | |
| 20241029 | B00-C-00122 | B-1034-FH-001 | Fire Hose House for OLE2/1 | (1M)Fire Hose Box Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00154 | B-1034-FH-001 | Fire Hose Riser and Cabinet for Admin | (1M)Fire Hose and Cabinet Riser Visual | IM | 29/10/2024 | |
| 20241029 | B00-C-00156 | B-1034-FH-001 | Fixed Monitor for OLE2/1 | (1M)Fixed Monitor Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00198 | B-1034-PV-001 | Post Indicator Valve for OLE2/1 | (1M)Post Indicator Valve Visual Insp | IM | 29/10/2024 | |
| 20241029 | B00-C-00200 | B-1034-WC-001 | Water Curtain for OLE2/1 | (1M)Water Curtain Inspection | IM | 29/10/2024 | |
| 20241029 | B11-C-00116 | B-1034-WDC-001 | Wheeled Fire Extinguishers for OLE2/1 | (1M)Dry Chemical Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00203 | B-1034-WH-001 | Water Hydrant for OLE2/1 | (1M)Water Hydrant Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B00-C-00205 | B-1034-WHM-001 | Water Hydrant with Monitor for OLE2/1 | (1M)Water Hydrant Monitor Visual Inspect | IM | 29/10/2024 | |
| 20241029 | B11-C-00088 | B-1035-CO2-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B11-C-00087 | B-1035-DC-001 | Dry Chemical for OLE2/2 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/10/2024 | |
| 20241029 | B11-C-00088 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5) | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B11-C-00089 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1) | (1M) Deluge Valve Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B11-C-00090 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/10/2024 | |
| 20241029 | B11-S-00025 | B-1035-WH-001 | Water Hydrant for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 29/10/2024 | |
| 20241029 | B11-S-00026 | B-1035-WHM-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant Monitor Visual Inspect | IM | 29/10/2024 | |
| 20241029 | B12-C-00071 | B-1036-PV-001 | Post Indicator Valve for OLE2/3 | (1M)Post Indicator Valve Visual Insp | IM | 29/10/2024 | |
| 20241029 | BNA-C-00078 | B-DV-1665 | DELUGE VALVE FOR Q-1523 | (6M) Spray Test | PM | 29/10/2024 | |
| 20241029 | B4YK-C-00018 | B-PT-1553A5 | CSW LOW P-1553A5 | (3M) CONDITION CHECK (OSL 2021-116) | PM | 29/10/2024 | |
| 20241029 | B46A-C-00052 | B-AT-15221 | Q-15221 | (6M)Nitrify Radior Task&Calorize (LWR) | PM | 29/10/2024 | |
| 20241029 | B608-C-00010 | B-N-942 | INTERMITTENT BLOWDOWN DRUM | (3M) CONDITION CHECK (OSL 2021-115) | IM | 29/10/2024 | |

| | | | | | | | |
|----------|---------------|-------------------------------------|---|--|----|------------|------------|
| 20241029 | B11-S-00025 | B-P-1570S | Light Naphtha Supply Pump | (6M)CHANGE LUBE OIL | PM | 29/10/2024 | Pump |
| 20241029 | B9A-C-00005 | B-PT-1502B | P-1502A/5 DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 29/10/2024 | |
| 20241029 | B6V3-C-00012 | B-PV-38M102A | HPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-113) | PM | 29/10/2024 | |
| 20241029 | B11-C-00012 | B-SCBA-001 | Self-contained breathing apparatus for | (1M)SCBA Visual Inspection | IM | 29/10/2024 | |
| 20241028 | B12-C-00789 | B-1036-DV-001 | Deluge Valve for Grouping 1(OLE2/3)/7tag. | (1M)Deluge Valve Visual Inspection | IM | 28/10/2024 | |
| 20241028 | B12-C-00793 | B-1036-DV-002 | Deluge Valve for Grouping 2(OLE2/3)/7tag. | (1M)Deluge Valve Visual Inspection | IM | 28/10/2024 | |
| 20241028 | B12-C-00797 | B-1036-DV-003 | Deluge Valve for Grouping 3(OLE2/3)/6tag. | (1M)Deluge Valve Visual Inspection | IM | 28/10/2024 | |
| 20241028 | B12-C-00799 | B-1036-FHH-001 | Fire Hose House for OLE2/3 | (1M)Fire Hose Box Visual Inspection | IM | 28/10/2024 | |
| 20241028 | B12-C-00778 | B-1036-WH-001 | Water Hydrant for OLE2/3 | (1M)Water Hydrant Visual Inspection | IM | 28/10/2024 | |
| 20241028 | B12-C-00779 | B-1036-WHM-001 | Water Hydrant with Monitor for OLE2/3 | (1M)Water Hydrant Monitor Visual Inspect | IM | 28/10/2024 | |
| 20241028 | B80-C-00011 | B-BENTLYNEVADA | VIBRATION MONITORING SYSTEM | (2M)INSPECT & ADJUST | PM | 28/10/2024 | |
| 20241028 | B6V-C-00085 | B-DV-1627A | MIXED CA TK Q-1540 DELUGE VALVE | (6M) Spray Test | PM | 28/10/2024 | |
| 20241028 | B6V-C-00085 | B-DV-1627B | MIXED CA TK Q-1540 DELUGE VALVE | (6M) Spray Test | PM | 28/10/2024 | |
| 20241028 | B6V-C-00085 | B-DV-1627C | MIXED CA TK Q-1540 DELUGE VALVE | (6M)INSPECTION | PM | 28/10/2024 | |
| 20241028 | B31-C-00060 | B-EE-ORP | Grouping For EMERGENCY EXIT ORP | (3M)INSPECT, VERIFY&CHECK | PM | 28/10/2024 | |
| 20241028 | B38-C-00011 | B-EONING | GROUPING FOR 380V SWGR 3 TAG | (6M)INSPECT CABLE/TIGHTNESS NUTS/SCREW | PM | 28/10/2024 | |
| 20241028 | B47A2-C-00015 | B-FT-19011A | FLOW ETHYLENE FROM PTT CHEM I-4 TO TCCG | (6M)SET & CALIBRATION | PM | 28/10/2024 | |
| 20241028 | B007-C-00020 | B-G-920A | CONDENSATE POLISHERS | (3M) CONDITION CHECK (OSL 2022-145) | IM | 28/10/2024 | |
| 20241028 | B096-C-00014 | B-M-1901B | GROUPING TAG FOR FUEL GAS TO TCCG/COO | (2W)UPDATE N2, CO2, REL DENSITY | PM | 28/10/2024 | |
| 20241028 | B007-C-00021 | B-M-944 | LP SUSPECT CONDENSATE DRUM | (3M) CONDITION CHECK (OSL 2022-147) | IM | 28/10/2024 | |
| 20241028 | B52B-C-00098 | B-P-1202A | SIDESTREAM FILTER BACKWASH SUMP PUMP | (3M)REGREASE | PM | 28/10/2024 | Pump |
| 20241028 | B061-E-00018 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly pit suction screen cleaning | PM | 28/10/2024 | Pump |
| 20241028 | B28B-C-00023 | B-P-517A | C3 HYDROGENATION FEED PUMP | (1Y)CLEANING & INSPECTION | PM | 28/10/2024 | Pump |
| 20241028 | B32-C-00020 | B-UG-0301 | STANDARD WEIGHT 5 KG. | (1Y)CAL STD.WEIGHT 5 KG.(OUT-SOURCE) | PM | 28/10/2024 | |
| 20241028 | B32-C-00021 | B-PM-01/01 | DIGITAL MULTIMETER | (1Y)CAL DIGITAL MULTIMETER(OUT-SOURCE) | PM | 28/10/2024 | Motor |
| 20241028 | B32-C-00027 | B-PP-01/01 | DIGITAL MANOMETER | (1Y)CAL DIGITAL MANOMETER(OUT-SOURCE) | PM | 28/10/2024 | |
| 20241028 | B32-C-00079 | B-PR-01/01 | DECADE RESISTANCE BOX | (1Y)CAL DECADE RESIST. BOX(OUT-SOURCE) | PM | 28/10/2024 | |
| 20241028 | B32-C-00008 | B-PT-01/01 | DIGITAL THERMOMETER | (1Y)CAL DIGITAL THERMOMETER(OUT-SOURCE) | PM | 28/10/2024 | |
| 20241028 | B47A2-C-00024 | B-PT-19011A | ETHYLENE FLOW TO TCCG | (6M)SET & CALIBRATION | PM | 28/10/2024 | |
| 20241028 | B23A-C-00019 | B-PT-19012 | FUEL GAS TO TCCG | (6M)SET & CALIBRATION | PM | 28/10/2024 | |
| 20241028 | B15A-C-00061 | B-R-300 | CRACKED GAS COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-148) | IM | 28/10/2024 | Compressor |
| 20241028 | B19A-W-00001 | B-A-300-PT-1S | CGR COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 28/10/2024 | |
| 20241028 | B6V3-S-00001 | B-A-3101 | ETHYLENE PURGE TO FAN#1 | (2W) RE GREASE DAMPER BEARING | PM | 28/10/2024 | |
| 20241028 | B6V4-W-00001 | B-A-400-PT-1S | CHARGE GAS COMP SURFACE COND TURBINE | (2W) REGREASE & INSPECTION | PM | 28/10/2024 | |
| 20241028 | B6V8-W-00001 | B-A-650-PT-1S | CHGR COMP SURFACE CONDENSER COND TURBINE | (2W) REGREASE & INSPECTION | PM | 28/10/2024 | |
| 20241028 | B33-C-00060 | B-SE-0201 | VOLTAGE/CURRENT STANDARD | (1Y)CALIBRATION VOLTAGE/CURRENT STANDARD | PM | 28/10/2024 | |
| 20241028 | B32-C-00011 | B-SE-0202 | VOLTAGE CURRENT STANDARD | (1Y)CALIBRATION VOLTAGE/CURRENT STANDARD | PM | 28/10/2024 | |
| 20241028 | B32-C-00066 | B-SE-0302 | INSTRUMENT CALIBRATION | (1Y)INSTRUMENT CALIBRATION(OUT-SOURCE) | PM | 28/10/2024 | |
| 20241028 | B32-C-00017 | B-SE-0401 | COMPACT CALIBRATOR CA 100 | (1Y)INST_CAL(COMPACT CA100)(OUT-SOURCE) | PM | 28/10/2024 | |
| 20241028 | BNA-C-00021 | B-SECUR-TASK0S | FOR PH; TEST FIRE PUMP | (1W)INSPECTION | PM | 28/10/2024 | |
| 20241028 | B32-C-00022 | B-SF-0203 | FREQUENCY CALIBRATION MODEL 942,ALTEK | (1Y)INST_CAL(FREQUENCY)(OUT-SOURCE) | PM | 28/10/2024 | |
| 20241028 | B32-C-00028 | B-SM-0301 | HAND HELD DI. MULTIMETER | (1Y)CALIBRATION HANDHELD DI. MULTIMETER | PM | 28/10/2024 | |
| 20241028 | B02S-C-00014 | B-T-374 | C2 HYDROGENATION SPARE INTERCOOLER | (3M) CONDITION CHECK (OSL 2022-149) | IM | 28/10/2024 | |
| 20241028 | B47A2-C-00012 | B-FT-19011A | TEMP TRANSMITTER FOR TE-19011A | (6M)SET & CALIBRATION | PM | 28/10/2024 | |
| 20241028 | B23A-C-00020 | B-FT-19012B | TEMP TRANSMITTER FOR TE-19012B | (6M)SET & CALIBRATION | PM | 28/10/2024 | |
| 20241028 | B6V-C-00085 | B-GROUPING TAG FOR FUEL GAS TO TCCG | GROUPING TAG FOR FUEL GAS TO TCCG | (1Y)INSPECTION | PM | 28/10/2024 | |
| 20241028 | BWS-S-00007 | B-WS02-02-01 | AIR COMPRESSOR SULLAIR | (1M)INSPECTION | PM | 28/10/2024 | Compressor |
| 20241028 | BWS-C-00001 | B-WS01-06-01 | BALANCING MACHINE | (1M)INSPECTION | PM | 28/10/2024 | |
| 20241028 | BWS-S-00001 | B-WS05-01-01 | UNIVERSAL MILLING MACHINE | (1M)INSPECT | PM | 28/10/2024 | |
| 20241028 | BWS-S-00014 | B-WS05-03-01 | CENTER LATHE MACHINE AJAX | (3M)INSPECT | PM | 28/10/2024 | |

| | | | | | | | |
|----------|---------------|--------------------|---|---------------------------------------|----|------------|---------|
| 20241025 | B0P2-S-00001 | B-EPCD1M | GROUPING FOR MOTORS CONSOLE#2 | (3M)LUBRICATION ON OPERATION. | PM | 25/10/2024 | |
| 20241025 | B0P3-C-00003 | B-EPCD1M | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/10/2024 | |
| 20241025 | B0P5-S-00001 | B-EPCD1M | GROUPING FOR MOTORS CONSOLE#3 | (3M)LUBRICATION ON OPERATION. | PM | 25/10/2024 | |
| 20241025 | B0M4-C-00002 | B-EPCD1MG | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/10/2024 | |
| 20241025 | B0M4-S-00001 | B-EPCD1MH | GROUPING FOR MOTORS CONSOLE#4,5,6 | (3M)LUBRICATION ON OPERATION. | PM | 25/10/2024 | |
| 20241025 | B100C-C-00039 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-178) | IM | 25/10/2024 | Furnace |
| 20241025 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 25/10/2024 | |
| 20241025 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 25/10/2024 | |
| 20241025 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 25/10/2024 | |
| 20241025 | B11-C-00006 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 25/10/2024 | |
| 20241025 | B09-C-00006 | B-GS-2E-F2 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 25/10/2024 | |
| 20241025 | B09-C-00075 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 25/10/2024 | |
| 20241025 | B0P5-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/10/2024 | Motor |
| 20241025 | B0P5-C-00004 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/10/2024 | Motor |
| 20241025 | B00-C-00008 | B-NONE-OLDFINS-P1 | Equipment Non Oldfins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-181) | IM | 25/10/2024 | |
| 20241025 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1M)CLEAN STRAINER FOR B-P-1132 | PM | 25/10/2024 | Pump |
| 20241025 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1M)CLEAN STRAINER FOR B-P-1132 | PM | 25/10/2024 | Pump |
| 20241025 | B061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1M)CLEAN STRAINER FOR B-P-1136 | PM | 25/10/2024 | Pump |
| 20241025 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1M)TEST RUN | PM | 25/10/2024 | Pump |
| 20241025 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1M)TEST RUN | PM | 25/10/2024 | Pump |
| 20241025 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 25/10/2024 | Pump |
| 20241025 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 25/10/2024 | Pump |
| 20241025 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 25/10/2024 | Pump |
| 20241025 | B52B-C-00141 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-176) | IM | 25/10/2024 | |
| 20241025 | B52B-C-00142 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-177) | IM | 25/10/2024 | |
| 20241025 | B11-C-00038 | B-SST-4800A | HP HEADER STEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-179) | IM | 25/10/2024 | |
| 20241025 | B11-C-00039 | B-SST-4800B | HP HEADER STEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-180) | IM | 25/10/2024 | |
| 20241025 | B9M-C-00239 | B-YFMR-261 | POWER TRANSFORMER 6.6/0.4 KV | (3M) RCM Visual Inspection | IM | 25/10/2024 | |
| 20241025 | B9M-C-00239 | B-YFMR-262 | POWER TRANSFORMER 6.6/0.4 KV | (3M) RCM Visual Inspection | IM | 25/10/2024 | |
| 20241025 | B11-C-00112 | B-AT-37101 | PROPYLENE PRODUCT TO PROPYLENE PRODUCT H | (2M) SET & CALIBRATE | PM | 24/10/2024 | |
| 20241024 | B11-C-00113 | B-AT-37101 | C3 GUARD ABSORBER-1-3710A | (2M) SET & CALIBRATE | PM | 24/10/2024 | |
| 20241024 | B11-C-00106 | B-AT-371203 | O2 ANALYZER - PROPYLENE PROD. FROM A-371 | (2M) SET & CALIBRATE | PM | 24/10/2024 | |
| 20241024 | B29-C-00008 | B-AT-5300 | PROPYLENE STRIPPER | (2M)SET & CALIBRATE | PM | 24/10/2024 | |
| 20241024 | B12-C-00403 | B-CPT-TV-BV | CPT TP GROUPING FOR BV | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 24/10/2024 | |
| 20241024 | BNA-C-00062 | B-CRIT-ECQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2M)Visual & Condition Inspection | PM | 24/10/2024 | |
| 20241024 | B29-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK HOI (MUNGUATE) | (1D)INSPECTION | PM | 24/10/2024 | |
| 20241024 | B29-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SANYUAN) | (1D)INSPECTION | PM | 24/10/2024 | |
| 20241024 | B29-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBUANCE(JITRUISA) | (1D)INSPECTION | PM | 24/10/2024 | |
| 20241024 | B29-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVUA) | (1D)INSPECTION | PM | 24/10/2024 | |
| 20241024 | BNA-C-00024 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2M)INSPECTION | PM | 24/10/2024 | |
| 20241024 | B016-C-00030 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2023-229) | IM | 23/10/2024 | |
| 20241023 | B61-C-00090 | B-AT-11391 | ISO14000, G-1127-R-1 TO Q-1139 | (2M)COD ANALYZER INSPECT.(OUT-SOURCE) | PM | 23/10/2024 | |
| 20241023 | B12-C-00031 | B-AT-470701 | LP CONDENSATE TOC | (1M)SET & CALIBRATE | PM | 23/10/2024 | |
| 20241023 | B10F-C-00047 | B-F-160 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-227) | IM | 23/10/2024 | Furnace |
| 20241023 | B0P5-C-00001 | B-F-1993 | FOR PM: TEST FIRE PUMP | (3M) CONDITION CHECK (OSL 2023-231) | IM | 23/10/2024 | |
| 20241023 | B73-C-00002 | B-M-1531 | METHANOL VAPORIZER DRUM | (3M) CONDITION CHECK (OSL 2023-230) | IM | 23/10/2024 | |
| 20241023 | B61-C-00125 | B-P-1142A | CONTAMINATED STORM WATER PUMP | (6M)REGREASE | PM | 23/10/2024 | Pump |
| 20241023 | B61-C-00127 | B-P-1167A | FIRE FIGHTING TRAINING A SUMP PUMP | (6M)REGREASE | PM | 23/10/2024 | Pump |
| 20241023 | B13-S-00024 | B-P-1508B | Light Naphtia Supply Pump | (6M)CHANGE LUBE OIL | PM | 23/10/2024 | Pump |

| | | | | | | | |
|----------|--------------|-------------------|--|---|----|------------|------------|
| 20241023 | B14-C-00013 | B-P-230A | FUEL OIL PRODUCT PUMP | (6M)CLEANING | PM | 23/10/2024 | Pump |
| 20241023 | B23A-C-00013 | B-PSV-19019A | SAFETY VALVE TO VENT | (1M)GROUP PSV Functiontest One-on(One-on-2) | IM | 23/10/2024 | PSV |
| 20241023 | B060-C-00057 | B-Q-1171 | SPENT CAUSTIC HOLDING TANK | (3M) CONDITION CHECK (OSL 2023-226) | IM | 23/10/2024 | |
| 20241023 | B57-C-00025 | B-R-1475A | INSTRUMENT AIR COMPRESSOR | (3M)Air intake filter inspection,Cleanin | PM | 23/10/2024 | |
| 20241023 | B57-C-00026 | B-R-1475S | INSTRUMENT AIR COMPRESSOR | (3M)Air intake filter inspection,Cleanin | PM | 23/10/2024 | |
| 20241023 | B57-C-00027 | B-R-1475Z | INSTRUMENT AIR COMPRESSOR | (3M)Air intake filter inspection,Cleanin | PM | 23/10/2024 | Compressor |
| 20241023 | B30A-C-00005 | B-R-575A | C3 SPLITTER HEAT PUMP COMPRESSOR | (6M)CHANGE BUFFER/ASPERATION GAS FILTER | PM | 23/10/2024 | Compressor |
| 20241023 | B00-C-00017 | B-VALVE1-05 | VALVE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-228) | IM | 23/10/2024 | |
| 20241022 | B81-S-00006 | B-AE-1100 | CG EFFLUENT FROM F-110 | (6M)CALIBRATION | PM | 22/10/2024 | |
| 20241022 | B81-S-00012 | B-AE-1200 | CG EFFLUENT FROM F-120 | (6M)CALIBRATION | PM | 22/10/2024 | |
| 20241022 | B009-C-00018 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (6M)CALIBRATE | PM | 22/10/2024 | |
| 20241022 | B413-C-00002 | B-AT-33100S | MOISTURE ANALYZER TRANSMITTER FOR M-3301 | (6M)MOISTURE ANALYZER AMETEX | PM | 22/10/2024 | |
| 20241022 | B63-C-00063 | B-DV-1621A | LP6 STORAGE TK Q-1521 DELUGE VALVE | (6M)Spray Test | PM | 22/10/2024 | |
| 20241022 | B63-C-00063 | B-DV-1621B | LP6 STORAGE TK Q-1521 DELUGE VALVE | (6M)Spray Test | PM | 22/10/2024 | |
| 20241022 | B63-C-00063 | B-DV-1622A | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (6M)Spray Test | PM | 22/10/2024 | |
| 20241022 | B63-C-00063 | B-DV-1622B | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (6M)Spray Test | PM | 22/10/2024 | |
| 20241022 | B050-S-00001 | B-G-1305S-R-1 | ASSIST AIR BLOWER | RCM-(1M) VISUAL INSPECTION | IM | 22/10/2024 | |
| 20241022 | B61-C-00118 | B-P-1142D | CONTAMINATED STORM WATER PUMP | (3M)REGREASE | PM | 22/10/2024 | Pump |
| 20241022 | B90-S-00009 | B-PM-3801S | BNW PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 22/10/2024 | Motor |
| 20241022 | B013-C-00018 | B-PSV-32010A | WATER QUENCH TOWER A-3201 ONHD VAPOR TO | BOATIE (UBH) OVERHAUL & INSPECTION(6X10) | PM | 22/10/2024 | PSV |
| 20241022 | B43A-C-00015 | B-PSV-6600S | M-660 TO COLD FLARE | (2M)SET & CALIBRATE(PSV 40S) | PM | 22/10/2024 | |
| 20241022 | B18A-C-00033 | B-RT-3002 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) INSPECT TURBINE EXPANSION JOINT | IM | 22/10/2024 | Compressor |
| 20241022 | BNA-C-00025 | B-SECUR-TASK32 | FLUSH AND VISUAL CHECK ROAM TANK | (3M)INSPECTION | PM | 22/10/2024 | |
| 20241022 | B39-C-00008 | B-V-400 | PRESSURE SWING ADSORPTION UNIT | (3M)INSPECTION | IM | 22/10/2024 | |
| 20241021 | B016-C-00023 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2021-098) | IM | 21/10/2024 | |
| 20241021 | B81-S-00005 | B-AE-1800 | CG EFFLUENT FROM F-180 | (6M)CALIBRATION | PM | 21/10/2024 | |
| 20241021 | B38-C-00014 | B-EONINH | GROUPING FOR 360V SWGR 4 TAG | (6M)INSPECT CABLE/TIGHTNESS NUTS/SCREW | PM | 21/10/2024 | |
| 20241021 | B10F-C-00037 | B-F-170 | USC FURNACES | (3M) CONDITION CHECK (OSL 2021-099) | IM | 21/10/2024 | Furnace |
| 20241021 | B38-C-00012 | B-PT-2003 | HTL STEAM LINE | (3M) CONDITION CHECK (OSL 2021-096) | IM | 21/10/2024 | |
| 20241021 | B52A-C-00026 | B-G-1201 | COOLING TOWER | (3M) CONDITION CHECK (OSL 2021-095) | IM | 21/10/2024 | |
| 20241021 | B12-C-00654 | B-LCP-T-4704 | LCP FOR TREATER REGENERATION HEATER | (1M)INSPECTION&RECORD | IM | 21/10/2024 | |
| 20241021 | B0P6-C-00001 | B-M-19016 | GROUPING TAG FOR FUEL GAS FROM PTT SKID | (1M)INSPECTION & ADJUST | PM | 21/10/2024 | |
| 20241021 | B026-C-00016 | B-MOV-HV-3807 | MOV FOR B-HV-3807 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00017 | B-MOV-HV-3808 | MOV FOR B-HV-3808 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00018 | B-MOV-HV-3809 | MOV FOR B-HV-3809 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00019 | B-MOV-HV-3810 | MOV FOR B-HV-3810 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00020 | B-MOV-HV-3811 | MOV FOR B-HV-3811 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00021 | B-MOV-HV-3812 | MOV FOR B-HV-3812 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00022 | B-MOV-HV-3813 | MOV FOR B-HV-3813 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00023 | B-MOV-HV-3814 | MOV FOR B-HV-3814 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00024 | B-MOV-HV-3815 | MOV FOR B-HV-3815 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B026-C-00025 | B-MOV-HV-3816 | MOV FOR B-HV-3816 | (1Y)Inspection and Lubrication | PM | 21/10/2024 | |
| 20241021 | B7A1-C-00016 | B-MR-1531 | ETHYLENE RECOVERY COMPRESSOR MOTOR | (3M) Lubrication | PM | 21/10/2024 | Compressor |
| 20241021 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-PH suction screen cleaning | PM | 21/10/2024 | Pump |
| 20241021 | B43B-C-00010 | B-PSV-6510S | SAFETY VALVE MP STEAM FROM RT-650 | (2Y)SET & CALIBRATE(PSV 6X10) | PM | 21/10/2024 | PSV |
| 20241021 | B51B-C-00013 | B-PSV-9300S | G-931 TO COLD FLARE | (2Y)SET & CALIBRATE (PSV 1X10) | PM | 21/10/2024 | PSV |
| 20241021 | B063-C-00018 | B-R-1475A | INSTRUMENT AIR COMPRESSOR | (3M)Air intake filter inspection,Cleanin | PM | 21/10/2024 | Compressor |
| 20241021 | B063-C-00011 | B-R-1470A | PLANT AIR COMPRESSOR | (3M)INSPECT | PM | 21/10/2024 | Compressor |
| 20241021 | B063-C-00012 | B-R-1470S | PLANT AIR COMPRESSOR | (3M)INSPECT | PM | 21/10/2024 | Compressor |
| 20241021 | B063-C-00013 | B-R-1470S | PLANT AIR COMPRESSOR | (3M)Air intake filter inspection,Cleanin | PM | 21/10/2024 | Compressor |

| | | | | | | | |
|----------|--------------|------------------|--|--|----|------------|------------|
| 20241021 | B12-S-00062 | B-R-4301-PT-1A | STEAM TURBINE FOR MAIN LUBE OIL PUMP | (1Y)OVERSPEED TRIP TEST | PM | 21/10/2024 | |
| 20241021 | B23B-C-00036 | B-R-434 | FUEL GAS COMPRESSOR | (3M) CONDITION CHECK (OSL 2021-000) | IM | 21/10/2024 | Compressor |
| 20241021 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 21/10/2024 | |
| 20241021 | B35-C-00079 | B-PSV-003 | GROUPING FOR UPS 150 KVA | (3M)SPECIFIC GRAVITY TEST | PM | 21/10/2024 | |
| 20241021 | B33-C-00018 | B-V-740-P-1A | SLUDGE PUMP | (1Y)CLEANING & LUBRICATE | PM | 21/10/2024 | |
| 20241021 | B33-C-00020 | B-V-740-P-1S | SLUDGE PUMP | (1Y)CLEANING | PM | 21/10/2024 | |
| 20241020 | B90-C-00172 | B-ACWL-P1 | ACWL GROUPING FOR P1 | (6M)CHECK & INSPECTION | PM | 20/10/2024 | |
| 20241020 | B11-C-00018 | B-ACWL-P2 | ACWL GROUPING FOR P2 | (6M)CHECK & INSPECTION | PM | 20/10/2024 | |
| 20241020 | B11-C-00093 | B-AT-300701 | HYDROLYSIS REACTOR L-3007 OUTLET | (2M) SET & CALIBRATE | PM | 20/10/2024 | |
| 20241020 | B11-C-00103 | B-AT-371001 | A-3701 C3 SPLITTER TEMPERATURE | (2M) SET & CALIBRATE | PM | 20/10/2024 | |
| 20241020 | B11-C-00111 | B-AT-371002 | ANALYZER (GC) PROPANE RECYCLE FROM C3 SP | (2M) SET & CALIBRATE | PM | 20/10/2024 | |
| 20241020 | B11-C-00142 | B-CAL-N0001 | GROUPING TAG FOR NEW MAIN SUB | (1M)VISUAL INSPECTION TEMP NOISE AND VIB | PM | 20/10/2024 | |
| 20241020 | B32-C-00060 | B-EDSRN | SERVO MOTOR FOR NEW MAIN SUB | (3M) CONDITION CHECK (OSL 2023-230) | IM | 20/10/2024 | |
| 20241020 | B10A-C-00046 | B-F-110 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-265) | IM | 20/10/2024 | Furnace |
| 20241020 | B10C-C-00042 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-259) | IM | 20/10/2024 | Furnace |
| 20241020 | B52B-C-00143 | B-G-1220-Q-3 | SULFURIC ACID TANK | (3M) CONDITION CHECK (OSL 2023-258) | PM | 20/10/2024 | |
| 20241020 | B0P6-C-00027 | B-H-1900S | GROUPING TAG FOR LPG FROM PTT | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | PM | 20/10/2024 | |
| 20241020 | B0P5-S-00005 | B-MOTOR-EO-006 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 20/10/2024 | Motor |
| 20241020 | B0P5-S-00016 | B-MOTOR-EO-DEMIN | GROUPING TAG FOR MOTOR DEMIN PLANT | (1M)CLEANING & INSPECTION. | PM | 20/10/2024 | Motor |
| 20241020 | B026-C-00015 | B-MOV-HV-3806 | MOV FOR B-HV-3806 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00742 | B-MOV-HV-430140 | MOV FOR B-HV-430140 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00743 | B-MOV-HV-430141 | MOV FOR B-HV-430141 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00737 | B-MOV-HV-43017A | MOV FOR B-HV-43017A | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00738 | B-MOV-HV-43017S | MOV FOR B-HV-43017S | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00734 | B-MOV-HV-430218A | MOV FOR B-HV-430218A | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00738 | B-MOV-HV-430218S | MOV FOR B-HV-430218S | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00735 | B-MOV-HV-430219A | MOV FOR B-HV-430219A | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00739 | B-MOV-HV-430219S | MOV FOR B-HV-430219S | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00736 | B-MOV-HV-430220A | MOV FOR B-HV-430220A | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00740 | B-MOV-HV-430220S | MOV FOR B-HV-430220S | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B12-C-00741 | B-MOV-HV-430227 | MOV FOR B-HV-430227 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00009 | B-MOV-KV-3602 | MOV FOR B-KV-3602 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00010 | B-MOV-KV-3603 | MOV FOR B-KV-3603 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00011 | B-MOV-KV-3608 | MOV FOR B-KV-3608 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00012 | B-MOV-KV-3607 | MOV FOR B-KV-3607 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00013 | B-MOV-KV-3608 | MOV FOR B-KV-3608 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00014 | B-MOV-KV-3609 | MOV FOR B-KV-3609 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00015 | B-MOV-KV-3622 | MOV FOR B-KV-3622 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00016 | B-MOV-KV-3628 | MOV FOR B-KV-3628 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B021-C-00017 | B-MOV-KV-3629 | MOV FOR B-KV-3629 | (1Y)Inspection and Lubrication | PM | 20/10/2024 | |
| 20241020 | B29-C-00006 | B-MP-546 | PROPYLENE TOWER REFLUX PUMP MOTOR | (6M)CHANGE LUBE OIL MOTORS. | PM | 20/10/2024 | Motor |
| 20241020 | B90-C-00173 | B-OSBL-LN-P1-1 | LIGHTNING GROUPING TAG FOR BUILDING | (6M)CHECK & INSPECTION | PM | 20/10/2024 | |
| 20241020 | B016-C-00018 | B-P-220S | QUENCH WATER CIRCULATION PUMP | (3M) CONDITION CHECK (OSL 2020-035) | IM | 20/10/2024 | Pump |
| 20241020 | B26S-S-00001 | B-P-52SA | C3 HYDROGENATION RECYCLE PUMP | (1Y)CIRCULATION | PM | 20/10/2024 | Pump |
| 20241020 | B00-C-00016 | B-P-901B | SEA WATER FLOED WATER PUMP | (3M) CONDITION CHECK (OSL 2021-073) | PM | 20/10/2024 | Pump |
| 20241020 | B00-C-00017 | B-PIPEL-P | LINE PROCESS C-11 | (3M) CONDITION CHECK (OSL 2023-236) | IM | 20/10/2024 | |
| 20241020 | B00-C-00021 | B-PIPEL-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-263) | IM | 20/10/2024 | |
| 20241020 | B00-C-00017 | B-PIPEL-SHH | LINE STEAM - SUPER HIGH PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-257) | IM | 20/10/2024 | |
| 20241020 | B90-C-00003 | B-PP-3E1-1 | NEW MAIN SUBSTATION NORMAL HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/10/2024 | |
| 20241020 | B90-C-00003 | B-PP-3E1-2 | NEW PROCESS SUBSTATION NORMAL HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/10/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|--|----|------------|------|
| 20241019 | B29-S-00002 | B-P-540S | COMMONSPARE OF P-540A & P-546 | (6M)LUBRICATION | PM | 19/10/2024 | Pump |
| 20241019 | B51A-C-00008 | B-P-930 | Hill Flare Drum Liquid Pump | (6M)LUBRICATION | PM | 19/10/2024 | Pump |
| 20241019 | B005-S-00001 | B-PSV-11441 | SAFETY VALVE DISCHARGE G-1144-P-3 | (3Y)INSPECTION & OVERHAUL PSV | PM | 19/10/2024 | PSV |
| 20241019 | B52B-S-00031 | B-PSV-12208 | SAFETY VALVE DISCHARGE G-1220-P-4S | (3Y)INSPECTION & OVERHAUL PSV | PM | 19/10/2024 | PSV |
| 20241019 | B16-S-00005 | B-P-TJ-220A | QUENCH WATER CIRCULATION PUMP TURBINE | (6M)CHANGE LUBE OIL GOVERNOR | PM | 19/10/2024 | PSV |
| 20241019 | B3A-C-00007 | B-R-2402 | FLUE GAS RECIRCULATION FAN | (6M)CHECK LUBRICATING OIL | PM | 19/10/2024 | Pump |
| 20241019 | B23B-C-00017 | B-R-934-P-1A | COOLING WATER PUMP FOR FUEL GAS COMPRES | (2Y)CHANGE LUBE OIL | PM | 19/10/2024 | Pump |
| 20241019 | B23B-C-00018 | B-R-934-P-1S | COOLING WATER PUMP FOR FUEL GAS COMPRES. | (2Y)CHANGE LUBE OIL | PM | 19/10/2024 | Pump |
| 20241019 | B0A-C-00017 | B-SECUR-TASK46 | FOR PM: INSPECTION AND CHECK MOBILE AIR | (1M)INSPECTION | PM | 19/10/2024 | Pump |
| 20241019 | B0A-C-00056 | B-TV-12268 | G-1122-1-1 | (3M) CONDITION CHECK (OSL 2022-219) | IM | 19/10/2024 | Pump |
| 20241019 | B3A-C-00007 | B-V-2403 | SOOT BLOWER FOR SUPERHEATER | (6M)CHECK LUBRICATING OIL | PM | 19/10/2024 | Pump |
| 20241019 | B3A-C-00007 | B-V-2402 | SOOT BLOWER FOR CONVECTION BANK | (6M)CHECK LUBRICATING OIL | PM | 19/10/2024 | Pump |
| 20241019 | B3A-C-00007 | B-V-2403 | SOOT BLOWER FOR CONVECTION BANK | (6M)CHECK LUBRICATING OIL | PM | 19/10/2024 | Pump |
| 20241019 | B3A-C-00007 | B-V-2404 | SOOT BLOWER FOR ECONOMIZER | (6M)CHECK LUBRICATING OIL | PM | 19/10/2024 | Pump |
| 20241019 | B3A-C-00007 | B-V-2405 | SOOT BLOWER FOR ECONOMIZER | (6M)CHECK LUBRICATING OIL | PM | 19/10/2024 | Pump |
| 20241019 | B32B-C-00001 | B-V-3901-P1A | NEUTRALIZING AMINE INJECTION PUMP FOR D. | (1Y)LUBRICATION | PM | 19/10/2024 | Pump |
| 20241019 | B31-C-00044 | B-V-3710-P-1A | CORRO. ANTIOXIDANT INHIBITOR | (1Y)CLEANING & LUBRICATE | PM | 19/10/2024 | Pump |
| 20241018 | B11-C-00100 | B-AT-370501 | C3 LIQUID FROM T-3705 FEED TO L-3705 MAP | (1M) SET & CALIBRATE | PM | 18/10/2024 | Pump |
| 20241018 | B11-C-00109 | B-AT-370502 | ANALYZER (GC) MAPD REACTOR RECYCLE | (1M) SET & CALIBRATE | PM | 18/10/2024 | Pump |
| 20241018 | B11-C-00101 | B-AT-370503 | LP DEETHAN. BOTTOMS FROM P3604/VS PUMP | (1M) SET & CALIBRATE | PM | 18/10/2024 | Pump |
| 20241018 | B11-C-00105 | B-AT-371202 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 18/10/2024 | Pump |
| 20241018 | B00C-C-00065 | B-DCS-P1 | DCS HONEYWELL TDC3000/PERION | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-DCS-P1-BOILER | DCS EMERSON DELTA-VI MD CONTROLLER SOFTWA | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-DCS-P1-ORP | DCS HONEYWELL C300 EXPIRATION RS11.1 | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-DCS-P2 | DCS YOKOGAWA CP461-50/AFV300/REVISION R5 | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-DCS-P3 | DCS HONEYWELL C300 EXPIRATION | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | IM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-ORP | ESD/PH3101TH 3.050CA 2.0EN2.10.0 | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P1-TANKFARM | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P2-COLD/UT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P2-FURS/HOT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P2-FUR6 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B14-C-00011 | B-RV-2300 | CO TO FUEL OIL STRIPPER A-230 | (6M)INSPECT & ADJUST | IM | 18/10/2024 | Pump |
| 20241018 | B051-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 18/10/2024 | Pump |
| 20241018 | B051-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 18/10/2024 | Pump |
| 20241018 | B051-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 18/10/2024 | Pump |
| 20241018 | B10-C-00001 | B-G-3841 | COOLING TOWER SYSTEM | (2M)VISUAL INSPECTION | IM | 18/10/2024 | Pump |
| 20241018 | B10-C-00021 | B-G-3841-R1A | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/10/2024 | Pump |
| 20241018 | B10-C-00021 | B-G-3841-R1B | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/10/2024 | Pump |
| 20241018 | B10-C-00021 | B-G-3841-R1C | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/10/2024 | Pump |
| 20241018 | B10-C-00021 | B-G-3841-R1D | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/10/2024 | Pump |
| 20241018 | B12-C-00056 | B-QS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 18/10/2024 | Pump |

| | | | | | | | |
|----------|--------------|-------------------|---|-------------------------------------|----|------------|------------|
| 20241018 | B90-C-00005 | B-GS-32S | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 18/10/2024 | Pump |
| 20241018 | B90-C-00075 | B-GS-34A | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 18/10/2024 | Pump |
| 20241018 | B00S-C-00015 | B-M-19057 | GROUPING TAG FOR TAIL GAS TO ROC. M.SKID | (1W)UPDATE NO. CO2, REL. DENSITY | PM | 18/10/2024 | Pump |
| 20241018 | B090-C-00032 | B-MCC-ZES-3-K | MCC FOR R-3650-G-5 | RCM (3M) INSPECTION | PM | 18/10/2024 | Pump |
| 20241018 | B90-C-00022 | B-MCC-ZEB-SA20D1 | MCC FOR R-4031-P-1S | RCM (3M)INSPECTION | IM | 18/10/2024 | Pump |
| 20241018 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 18/10/2024 | Pump |
| 20241018 | B061-C-00018 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 18/10/2024 | Pump |
| 20241018 | B061-C-00019 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 18/10/2024 | Pump |
| 20241018 | B061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 18/10/2024 | Pump |
| 20241018 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 18/10/2024 | Pump |
| 20241018 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 18/10/2024 | Pump |
| 20241018 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 18/10/2024 | Pump |
| 20241018 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 18/10/2024 | Pump |
| 20241018 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 18/10/2024 | Pump |
| 20241018 | B20A-C-00029 | B-P-343S | 15014000,COMMON SPARE FOR P-342 & P-343A | (6M) CHANGE LUBE OIL & INSPECT | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P1-CCC-R57S | AKTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P1-CCS-CGC | AKTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P1-CCS-ERC | AKTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P1-CCS-PRC | AKTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P1-PSA1 | PRESSURE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P1-TTC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P2-TTCC-CGC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P2-TTCC-ERC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P2-TTCC-PRC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P2-PSA2 | PRESSURE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Pump |
| 20241018 | B00-C-00065 | B-PLC-P3-TTCC | INTEGRATED TURBINE COMPRESSOR CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/10/2024 | Compressor |
| 20241018 | B5S-C-00009 | B-PSV-14701A | M-1470 | (3Y)SET & CALIBRATE(PSV 3x4) | PM | 18/10/2024 | PSV |
| 20241018 | B5S-C-00016 | B-PSV-14701S | M-1470 | (3Y)SET & CALIBRATE(PSV 3x4) | PM | 18/10/2024 | PSV |
| 20241018 | B47D-C-00117 | B-R-1500S | VOC TANK AREA BLOWER | RCM (6M) CHANGE LUBE OIL | PM | 18/10/2024 | Pump |
| 20241018 | B10A-C-00005 | B-P-302-P-6A | C3 INJECTION PUMP | (1W)FUNCTION TEST, CLEAN, LUBRICATE | PM | 18/10/2024 | Pump |
| 20241018 | B332-C-00001 | B-P-302-P-6S | GROUPING TAG FOR STANDARD GAS | (1W)CHECK STANDARD GAS STATUS | PM | 18/10/2024 | Pump |
| 20241017 | B11-C-00096 | B-AT-340610 | ACETYLENE REACTOR EFFLUENT | (1M) SET & CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B11-C-00095 | B-AT-350220 | DEBUTANIZER REFLUX PUMPS P-3502A/VS DISCH | (2M) SET & CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | BH20-C-00011 | B-AT-38210S | ISO14000,PH METER TX FOR V-3821-P-1 OUTF | (1M)SET&CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00064 | B-AT-402101 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00065 | B-AT-40210S | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00066 | B-AT-402201 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00068 | B-AT-42010A | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00069 | B-AT-42010B | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00029 | B-AT-43010S | Fuel Gas of B-4301 and F-4302 CEHs | (1M)SET & CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00074 | B-AT-430401 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00032 | B-AT-480104 | FE-4801-02 Downstream TOC | (1M)SET & CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00033 | B-AT-48201 | Q-4852 TOC | (1M)SET & CALIBRATE | PM | 17/10/2024 | Pump |
| 20241017 | B90S-00043 | B-BC-2EE-110-1 | BATTERY CHARGER 110VDC 6.36 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/10/2024 | Pump |
| 20241017 | B90S-00044 | B-BC-2EE-110-2 | BATTERY CHARGER 110VDC 6.36 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/10/2024 | Pump |
| 20241017 | B90S-00045 | B-BC-2EE-24-1 | BATTERY CHARGER 24VDC 2.5 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/10/2024 | Pump |
| 20241017 | B90S-00046 | B-BC-2EE-24-2 | BATTERY CHARGER 24VDC 2.5 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/10/2024 | Pump |
| 20241017 | B90S-00047 | B-BC-2EE-24-3 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/10/2024 | Pump |
| 20241017 | B90S-00048 | B-BC-2EE-24-4 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/10/2024 | Pump |
| 20241017 | B90S-00050 | B-BC-344-1 | BATTERY CHARGER NO. 1 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | Pump |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|------------|------------|
| 20241017 | B90-S-00051 | B-BC-344-2 | BATTERY CHARGER NO. 2 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | |
| 20241017 | B90-S-00007 | B-BC1-2E5 | BATTERY CHARGER AT NEW MAIN SUB-1 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | |
| 20241017 | B90-S-00040 | B-BC1-2E5-2 | BATTERY CHARGER AT NEW MAIN SUB-2 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | |
| 20241017 | B90-S-00044 | B-BC1-344 | BATTERY CHARGER PANEL NO.1 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | |
| 20241017 | B90-S-00042 | B-BC2-2E5 | BATTERY CHARGER AT NEW PRD. SUB-1 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | |
| 20241017 | B90-S-00043 | B-BC2-2E5-2 | BATTERY CHARGER AT NEW PRD. SUB-2 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | |
| 20241017 | B90-S-00047 | B-BC2-KW1A | BATTERY CHARGER PANEL NO.2 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/10/2024 | |
| 20241017 | B90-C-00160 | B-CP-TP-PLANT1 | GROUP TAG FOR CP TP PLANT1 | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 17/10/2024 | |
| 20241017 | B90-C-00162 | B-CP-TP-PLANT2 | GROUP TAG FOR CP TP PLANT2 | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 17/10/2024 | |
| 20241017 | B12-C-00401 | B-C-TRU-01 | CATHODIC PROTECTION RECTIFIER NO.1 | (1M)VISUAL INSPECTION & RECORD | PM | 17/10/2024 | |
| 20241017 | B90-C-00159 | B-CP-TRU-PLANT1 | GROUP TAG FOR CP TRU PLANT1 | (2M)VISUAL INSPECTION | PM | 17/10/2024 | |
| 20241017 | B90-C-00150 | B-CP-TRU-PLANT2 | GROUP TAG FOR CP TRU PLANT2 | (1M)VISUAL INSPECTION | PM | 17/10/2024 | |
| 20241017 | B65-C-00079 | B-0V-1617 | LUBE/SEAL OIL CONSOLE & DELUGE VALVE | (6M)SPRY TEST | PM | 17/10/2024 | |
| 20241017 | B65-C-00080 | B-G-1112-P-1S | HIGH PRESSURE FEED PUMPS | (1M)CLEAN STRAINER&INSPECTION | PM | 17/10/2024 | |
| 20241017 | B00S-C-00026 | B-M-1900S | GROUPING TAG FOR NGL FROM PTT | (4M)SET & CALIBRATE | PM | 17/10/2024 | |
| 20241017 | B00S-C-00049 | B-M-19006 | GROUPING TAG FOR LPG FROM PTT | (4M)SET & CALIBRATE | PM | 17/10/2024 | |
| 20241017 | B3S-S-00005 | B-MOTOR-EP-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 17/10/2024 | Motor |
| 20241017 | B29-S-00001 | B-MP-540A | PROPYLENE RECTIFIER BOTTOMS PUMP MOTOR | (6M)LUBRICATION | PM | 17/10/2024 | Motor |
| 20241017 | B42B-C-00014 | B-MR-600-P-1A | C2R CONDENSER COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/10/2024 | |
| 20241017 | B42B-C-00012 | B-MR-600-P-2A | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/10/2024 | |
| 20241017 | B42B-C-00031 | B-MR-600-P-2S | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/10/2024 | |
| 20241017 | B95C-00010 | B-PP-1501B | FRM FEED PUMP | (6M)CLEAN & LUBRICATE | PM | 17/10/2024 | Pump |
| 20241017 | B29-C-00010 | B-P-344S | FRM CIRCULATING CAUSTIC CIRCULATION PUMP | (6M) CHECK LUBE OIL & INSPECT | PM | 17/10/2024 | Pump |
| 20241017 | B29-S-00001 | B-MP-540A | PROPYLENE RECTIFIER BOTTOM'S PUMP | (6M)LUBRICATION | PM | 17/10/2024 | Pump |
| 20241017 | B12-C-00014 | B-PGC-BV-HOUSE3 | GROUPING TAG FOR RGC BV HOUSE 3 | (2M)SET&CALIBRATE | PM | 17/10/2024 | |
| 20241017 | B19A-C-00058 | B-R-300 | CRACKED GAS COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/10/2024 | Compressor |
| 20241017 | B42B-C-00014 | B-R-600-P-1A | C2R COMPRESSOR CONDENSATE PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/10/2024 | Compressor |
| 20241017 | B42B-C-00012 | B-R-600-P-2A | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/10/2024 | Compressor |
| 20241017 | B42B-C-00031 | B-R-600-P-2S | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/10/2024 | Compressor |
| 20241017 | B19A-C-00058 | B-R/RX-401A | TAIL GAS EXPANDER & COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/10/2024 | Compressor |
| 20241017 | B19A-C-00058 | B-R/RX-401B | TAIL GAS RECOMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/10/2024 | Compressor |
| 20241017 | B19A-C-00058 | B-RIT-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) N2 PRESSURE INSPECTION | IM | 17/10/2024 | Compressor |
| 20241017 | B19A-C-00058 | B-RIT-600 | ETHYLENE REFRIGERANT COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | IM | 17/10/2024 | Compressor |
| 20241017 | B19A-C-00058 | B-R/LINE-ABRIC-440 | RAIL LINE ABRIC 440 COMPRESSOR TURBIN | (1M) N2 PRESSURE INSPECTION | IM | 17/10/2024 | Compressor |
| 20241017 | B12-C-00021 | B-SCADA-BV | SCADA SYSTEM FOR BV | (1M)VISUAL INSPECT | PM | 17/10/2024 | |
| 20241017 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO.1 (NUNSGATE) | (1D)INSPECTION | PM | 17/10/2024 | |
| 20241017 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYARRIN) | (1D)INSPECTION | PM | 17/10/2024 | |
| 20241017 | B20-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBUANCE (JATIRUKSA) | (1D)INSPECTION | PM | 17/10/2024 | |
| 20241017 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR(NITRUKSA) | (1D)INSPECTION | PM | 17/10/2024 | |
| 20241016 | B11-C-00096 | B-AT-360030 | LP DEETHANIZER A-3600 OVHD. TO C2 SPLIT | (2M) SET & CALIBRATE | PM | 16/10/2024 | |
| 20241016 | B11-C-00097 | B-AT-360031 | LP DEETHANIZER A-3600 BTMS. TO PUMP P-3 | (2M) SET & CALIBRATE | PM | 16/10/2024 | |
| 20241016 | B23A-C-00018 | B-FT-19012A | FUEL GAS FROM PITCH TO TOGCC | (6M)SET & CALIBRATION | PM | 16/10/2024 | |
| 20241016 | B00S-C-00034 | B-M-19003 | GROUPING TAG FOR RHN PORT M.SKD | (4M)PROVE LIQ.TURBINE METER(OUT-SOURCE) | PM | 16/10/2024 | |
| 20241016 | B00S-C-00033 | B-M-19003 | GROUPING TAG FOR RHN PORT M.SKD | (4M)SET & CALIBRATE | PM | 16/10/2024 | |
| 20241016 | B00S-C-35009 | B-M-19007 | GROUPING TAG FOR ETHYLENE TO FROM I-1 | (1)IMPROVE GAS TURBINE METER(OUT-SOURCE) | PM | 16/10/2024 | |
| 20241016 | B00S-C-19008 | B-M-19008 | GROUPING TAG FOR LUBRICATION TO INT | (1)IMPROVE GAS TURBINE METER | PM | 16/10/2024 | |
| 20241016 | B00S-C-00037 | B-M-19013 | GROUPING TAG FOR N2 FROM TIG M.SKD | (4M)SET & CALIBRATE | PM | 16/10/2024 | |
| 20241016 | B00S-C-00004 | B-M-19013 | GROUPING TAG FOR N2 FROM TIG M.SKD | (1)IMPROVE GAS TURBINE METER(OUT-SOURCE) | PM | 16/10/2024 | |
| 20241016 | B00S-C-00006 | B-M-19018 | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (1)IMPROVE GAS TURBINE METER(OUT-SOURCE) | PM | 16/10/2024 | |
| 20241016 | B00S-C-00028 | B-M-19028 | GROUPING TAG FOR PY GAS TO ASC/TTT | (4M)PROVE LIQ.TURBINE METER(OUT-SOURCE) | PM | 16/10/2024 | |

| | | | | | | | |
|----------|---------------|------------------|--|--|----|------------|---------|
| 20241014 | B01-S-00004 | B-AE-1700 | CG EFFLUENT FROM F-170 | (6M)CALIBRATION | PM | 14/10/2024 | |
| 20241014 | B10K-C-00022 | B-AT-10013 | (ISO14000)CEMS SOX/NOXCO F-1010 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/10/2024 | |
| 20241014 | B10L-C-00024 | B-AT-10023 | (ISO14000)CEMS SOX/NOXCO F-1020 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/10/2024 | |
| 20241014 | B0P1-C-00028 | B-AT-1003/1-3 | GROUPING TAGS CEMS AT-1103/1203/1303 | (1M)SET & CALIBRATION | PM | 14/10/2024 | |
| 20241014 | B0P1-C-00028 | B-AT-1003/1-6 | GROUPING TAGS CEMS AT-1403/1503/1603 | (1M)SET & CALIBRATION | PM | 14/10/2024 | |
| 20241014 | B0P1-C-00028 | B-AT-1003/7-9 | GROUPING TAGS CEMS AT-1703/1803/1903 | (1M)SET & CALIBRATION | PM | 14/10/2024 | |
| 20241014 | B3A-C-00013 | B-AT-2411A | ISO14000)CEMS SOX/NOX/CO ANALYZER S-2401 | (1M)SET & CALIBRATE CEMS(B-2401) | PM | 14/10/2024 | |
| 20241014 | B3A-S-00013 | B-B-2401 | STEAM GENERATOR | (1M)CLEANING B-2401 | PM | 14/10/2024 | |
| 20241014 | B0C-C-00027 | B-CO2-SUB1-1 | CO2 FIRE SYSTEM CONTROL PANEL(SWGR) SUB1 | (1M)INSPECTION | PM | 14/10/2024 | |
| 20241014 | B0C-C-00027 | B-CO2-SUB1-2 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M)INSPECTION | PM | 14/10/2024 | |
| 20241014 | B10B-C-00011 | B-F-120 | (4)REPLACE NEW RADIANT COILS(GROUP*) | (3M) CONDITION CHECK (OSL 2021-072) | IM | 14/10/2024 | Furnace |
| 20241014 | B10B-C-00042 | B-F-190 | USE FURNACES | (2)SET/CALIBRATE(GROUP 1)-1/PSL, PSH, PSL | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00006 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)INSPECTION GROUP H | IM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00002 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)INSPECTION TLVSDV VALVE (GROUP.U) | IM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00002 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)FURNACE SHUTDOWN INSPECTION GROUP.C | IM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00008 | B-F-3102 | ETHYLENE FURNACE # 2 | (2)SET/CALIBRATE(GROUP 1)-1/OUT-SOURCE | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00001 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)SET & CALIBRATE (GROUP.Q) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00001 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)SET/CALIBRATE(GROUP.Q) (OUT-SOURCE) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00001 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)CHECK/INSPECT (GROUP.S) (OUT-SOURCE) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00001 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)INSPECT, PCV,CLEAN IMPLUSE(GROUP.P) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00001 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)AE-310206 PYGAS SAMPLING (GROUP.T) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00002 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)FUNCTION TEST (GROUP.F) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00021 | B-F-3102 | ETHYLENE FURNACE # 2 | (2)SIF PROOF TEST/INSPECTION(GROUP.SIF) | IM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00021 | B-F-3102 | ETHYLENE FURNACE # 2 | (2)SIF PROOF TEST/INSPECTION(GROUP.SIF) | IM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00022 | B-F-3102 | ETHYLENE FURNACE # 2 | (2)SET/CALIBRATE (GROUP.SCR) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00022 | B-F-3102 | ETHYLENE FURNACE # 2 | (2)SET/CALIBRATE (GROUP 12-1) (OUT-SOURCE) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00022 | B-F-3102 | ETHYLENE FURNACE # 2 | (2)SET/CALIBRATE(GROUP 12-2) (OUT-SOURCE) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00025 | B-F-3102 | ETHYLENE FURNACE # 2 | (2)CLEAN/INSPECT FLOW FLOW(GROUP.L) | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00020 | B-F-3102 | ETHYLENE FURNACE # 2 | (1V)Inspect Cock Valve 24 tags (GROUP.L) | IM | 14/10/2024 | Furnace |
| 20241014 | B61-C-00095 | B-G-1125-P-1A | DGR RECYCLE PUMP | (6M)PACKING INSPECTION | PM | 14/10/2024 | Pump |
| 20241014 | BH4-C-00028 | B-HV-3102/13 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (6M)LUBRICAT AND INSPECT ZJ VALVE GroupE | PM | 14/10/2024 | Furnace |
| 20241014 | BH4-C-00028 | B-HV-3102/14 | MOTOR OPERATED DECKING VALVE OF F-3102 | (6M)LUBRICAT AND INSPECT ZJ VALVE GroupE | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00070 | B-HY-1610 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00070 | B-HY-1611 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00070 | B-HY-1612 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00091 | B-HY-1613 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00091 | B-HY-1614 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00091 | B-HY-1615 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00092 | B-HY-1616 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00092 | B-HY-1617 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B63-C-00092 | B-HY-1618 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/10/2024 | Furnace |
| 20241014 | B0P5-C-00050 | B-IR-REFRA-00050 | GROUPING TAG FOR INFRARED SURVEY | (6M)INSPECTION INFRARED | IM | 14/10/2024 | Furnace |
| 20241014 | B13-C-00062 | B-INTERCOM-GRP | Grouping Tag Intercom GRP | (2M)INTERCOM FUNCTION TEST | PM | 14/10/2024 | Furnace |
| 20241014 | B0A-C-00018 | B-1A-11018 | GROUPING TAG FOR REL. GAS TO TCC/COOD | (2M)REL. GAS TO TCC/COOD | PM | 14/10/2024 | Furnace |
| 20241014 | B60-C-00012 | B-A-11235 | SULFURIC ACID TRANSFER PUMP | (1V) CHANGE LUBE OIL | PM | 14/10/2024 | Pump |
| 20241014 | B60-C-00062 | B-A-11315 | RECOVERED OIL TRANSFER PUMP | (3M)REGREASE | PM | 14/10/2024 | Pump |
| 20241014 | B063-WK-00001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pit suction screen cleaning | PM | 14/10/2024 | Pump |
| 20241014 | B29A-C-00002 | B-P-572A | C3 SPLITTER BOTTOMS PUMP | (1V)CLEANING & INSPECTION | PM | 14/10/2024 | Pump |
| 20241014 | B31-C-00041 | B-P-740A | SHU ZNO STAGE QUENCH PUMP | (1V)LUBRICATION & CLEANING | PM | 14/10/2024 | Pump |

| | | | | | | | |
|----------|---------------|----------------|--|-------------------------------------|----|------------|-------------|
| 20241012 | B63-C-00039 | B-HY-1620 | HYDRANT AREA QUENCH | (6M)HY QUENCH LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00039 | B-HY-1621 | HYDRANT AREA QUENCH | (6M)HY QUENCH LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00039 | B-HY-1622 | HYDRANT AREA QUENCH | (6M)HY QUENCH LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00039 | B-HY-1623 | HYDRANT AREA COLD | (6M)HY QUENCH LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00043 | B-HY-1624 | HYDRANT AREA HOT | (6M)HY HOT LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00043 | B-HY-1625 | HYDRANT AREA HOT | (6M)HY HOT LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00043 | B-HY-1626 | HYDRANT AREA HOT | (6M)HY HOT LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00048 | B-HY-1627 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00048 | B-HY-1628 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00048 | B-HY-1629 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B63-C-00043 | B-HY-1641 | HYDRANT AREA HOT | (6M)HY HOT LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B10H-C-00006 | B-10P-F-180 | TLVSDV switch Box of F-180 | (3M) CONDITION CHECK (OSL 2021-090) | IM | 12/10/2024 | Water/Flare |
| 20241012 | B10F-C-00039 | B-M-160 | STEAM DRUM | (1V)INSPECTION (GROUP.M) | PM | 12/10/2024 | |
| 20241012 | B10H-C-00002 | B-MK-180 | FURANDE ID FAN MOTOR | (3M)REGRASE | PM | 12/10/2024 | Pump |
| 20241012 | B61-C-00117 | B-A-1142B | CONTAMINATED STORM WATER PUMP | (3M) CLEAN SUCTION STRAINER | PM | 12/10/2024 | Pump |
| 20241012 | B55-S-00003 | B-P-2216 | SERVICE WATER PUMP | (1V) LUBRICATE & CLEANING | PM | 12/10/2024 | Pump |
| 20241012 | BNA-C-00057 | B-P-4910A | BUTENE-1 PRODUCT TRANSFER PUMP | (1M)INSPECTION & CLEAN | PM | 12/10/2024 | |
| 20241012 | B30A-S-00002 | B-R-575A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (1M)INSPECTION | PM | 12/10/2024 | |
| 20241012 | BNA-C-00012 | B-SECUR-TASK50 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/10/2024 | |
| 20241012 | BNA-C-00012 | B-SECUR-TASK45 | FOR PM: INSPECTION AND CHECK MOBILE GENE | (1M)INSPECTION | PM | 12/10/2024 | |
| 20241012 | B030-C-00006 | B-TE-13000 | FLARE VPRS TO ELEV FLARE | (3M) CONDITION CHECK (OSL 2021-091) | IM | 12/10/2024 | |
| 20241012 | B73-S-00005 | B-V-267-P-1A | POLYMERIZATION INHIBITION PUMP | (1V)CAPACITY SETTING | PM | 12/10/2024 | |
| 20241012 | B31-C-00045 | B-V-710-G-1 | GASO ANTIOXIDANT INHI STORAGE DRUM AGI | (3M)LUBRICATION | PM | 12/10/2024 | |
| 20241012 | B90-C-00046 | B-XFMR-11 | 2226.9KV POWER TRANSFORMER SUB.4 | (3M)RCM Visual Inspection | IM | 12/10/2024 | |
| 20241012 | B90-C-00046 | B-XFMR-12 | 2226.9KV POWER TRANSFORMER SUB.4 | (3M)RCM Visual Inspection | IM | 12/10/2024 | |
| 20241012 | B026-C-00013 | B-XFMR-2E1 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW MAI | (6M)-RCM Thermosan | IM | 12/10/2024 | |
| 20241012 | B026-C-00012 | B-XFMR-2E1 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW MAI | (3M)-RCM Visual Inspection | IM | 12/10/2024 | |
| 20241012 | B026-C-00012 | B-XFMR-2E2 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW MAI | (6M)-RCM Thermosan | IM | 12/10/2024 | |
| 20241012 | B026-C-00012 | B-XFMR-2E2 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW MAI | (3M)-RCM Visual Inspection | IM | 12/10/2024 | |
| 20241012 | B026-C-00012 | B-XFMR-2E3 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (6M)-RCM Thermosan | IM | 12/10/2024 | |
| 20241012 | B026-C-00012 | B-XFMR-2E3 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (3M)-RCM Visual Inspection | IM | 12/10/2024 | |
| 20241012 | B026-C-00012 | B-XFMR-2E4 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (6M)-RCM Thermosan | IM | 12/10/2024 | |
| 20241012 | B026-C-00013 | B-XFMR-2E4 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (3M)-RCM Visual Inspection | IM | 12/10/2024 | |
| 20241012 | B026-C-00012 | B-XFMR-2E5 | POWER TRANSFORMER 6.6/0.4 KV | (6M)-RCM Thermosan | IM | 12/10/2024 | |
| 20241012 | B026-C-00013 | B-XFMR-2E5 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 12/10/2024 | |
| 20241012 | B90-C-00046 | B-XFMR-4575 | AUTO TRANSFORMER FOR RM-575 | (3M)VISUAL CHECK | PM | 12/10/2024 | |
| 20241011 | B021-C-00024 | B-AT-3600C | CO DEHYDRATORS BEGS | (1M)MOISTURE ANALYZER AMETEX | PM | 11/10/2024 | |
| 20241011 | B061-C-00017 | B-G-1144-P-2A | WATER STRAINER FOR B-G-1144-P-2 | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 11/10/2024 | |
| 20241011 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 11/10/2024 | |
| 20241011 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 11/10/2024 | |
| 20241011 | B12-C-00056 | B-GS-2F-FL | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 11/10/2024 | |
| 20241011 | B90-C-00005 | B-GS-2S | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 11/10/2024 | |
| 20241011 | B90-C-00075 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 11/10/2024 | |
| 20241011 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 11/10/2024 | Pump |
| 20241011 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 11/10/2024 | Pump |
| 20241011 | B061-C-00019 | B-P-1136A | COG EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 11/10/2024 | Pump |
| 20241011 | B061-C-00017 | B-P-1136B | COG EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 11/10/2024 | Pump |
| 20241011 | B063-WK-00002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 11/10/2024 | Pump |
| 20241011 | B063-WK-00002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 11/10/2024 | Pump |
| 20241011 | B063-WK-00002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 11/10/2024 | Pump |

| | | | | | | | |
|----------|---------------|--------------------|---|---|----|------------|------------|
| 20241014 | B09C-C-00004 | B-PT-1501A | FRAN FEED PUMP TURBINE | (1V) OVER SPEED TRIP TEST | PM | 14/10/2024 | |
| 20241014 | B3A-C-00012 | B-R-2401 | FD. FAN | (1M)CHECK LUBRICATING OIL | PM | 14/10/2024 | |
| 20241014 | B13A-WK-00001 | B-R-300-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 14/10/2024 | |
| 20241014 | B89-C-00008 | B-R-3102 | ETHYLENE FURNACE 10 FAN#2 | (1V)FD Fan Lubricate,Inspection(Group.M) | PM | 14/10/2024 | |
| 20241014 | B42B-WK-00001 | B-R-600-PT-15 | C2R SURFACE CONDENSER COND.TURBINE | (2W)REGREASE & INSPECTION | PM | 14/10/2024 | |
| 20241014 | B43B-WK-00001 | B-R-650-PT-15 | C3R COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 14/10/2024 | |
| 20241014 | B90-C-00008 | B-RM-3102 | ETHYLENE FURNACE 10 FAN#2 MOTOR | (1V)FD Fan Motor Inspection (Group.M) | PM | 14/10/2024 | |
| 20241014 | BNA-C-00021 | B-SECUR-TASK50 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 14/10/2024 | |
| 20241014 | BNA-C-00014 | B-SECUR-TASK22 | FOR PM: INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/10/2024 | |
| 20241013 | BH3-C-00016 | B-AT-3101/05 | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M)SET & CALIBRATION | PM | 13/10/2024 | |
| 20241013 | B003-C-00028 | B-AT-3120/11-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) ISO14001 SET/CALIBRATION | PM | 13/10/2024 | |
| 20241013 | B003-C-00029 | B-AT-19014A | CRITICAL LOOP, CROSS CHECK METER HP STEA | (3M) CONDITION CHECK (OSL 2022-130) | IM | 13/10/2024 | |
| 20241013 | B033-C-00009 | B-FV-7059 | HP STEAM TO F-700 | (3M) CONDITION CHECK (OSL 2022-225) | IM | 13/10/2024 | |
| 20241013 | B007-C-00024 | B-G-910A | SUSPECT CONDENSATE FILTERS | (3M) CONDITION CHECK (OSL 2022-221) | IM | 13/10/2024 | |
| 20241013 | B007-C-00019 | B-G-910A | SUSPECT CONDENSATE FILTERS | (3M) CONDITION CHECK (OSL 2022-126) | IM | 13/10/2024 | |
| 20241013 | B008-C-00012 | B-M-942 | INTERMITTENT BLOWDOWN DRUM | (3M) CONDITION CHECK (OSL 2022-131) | IM | 13/10/2024 | |
| 20241013 | B0P5-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION | PM | 13/10/2024 | Motor |
| 20241013 | B38-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION | PM | 13/10/2024 | Motor |
| 20241013 | B013-C-00015 | B-P-221A | QUENCH OIL TOWER REFLUX PUMP | (3M) CONDITION CHECK (OSL 2022-224) | IM | 13/10/2024 | Pump |
| 20241013 | B28S-S-00002 | B-P-520S | C3 HYDROGENATION RECYCLE PUMP | (1V)LUBRICATION | PM | 13/10/2024 | Pump |
| 20241013 | B00-C-00051 | B-PIPEL-3C15 | LINE STEAM CONDENSATE - 1P DIE 2-1 | (3M) CONDITION CHECK (OSL 2021-093) | IM | 13/10/2024 | |
| 20241013 | B90-S-00005 | B-PM-3201S | QUENCH WATER PUMP MOTOR | (3M)LUBRICATION | PM | 13/10/2024 | Motor |
| 20241014 | B04A-C-00005 | B-GR-1470S | PLATE AIR COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-132) | IM | 13/10/2024 | Compressor |
| 20241013 | B13A-C-00062 | B-200HP | CRACKER GAS COMPRESSOR HP CASING | (1M)INSPECTION WRAPPED DRAIN FLANGE | PM | 13/10/2024 | Compressor |
| 20241012 | BNA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/10/2024 | |
| 20241013 | B45A-C-00059 | B-T-1520 | LPV VAPORIZER | (3M) CONDITION CHECK (OSL 2022-129) | IM | 13/10/2024 | |
| 20241013 | B38-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/10/2024 | |
| 20241013 | B00-C-00106 | B-VALVE1-SHH | VALVE STEAM - SUPER HIGH PRESSURE CLE 2-1 | (3M) CONDITION CHECK (OSL 2022-222) | IM | 13/10/2024 | |
| 20241013 | B12-C-00356 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/10/2024 | |
| 20241013 | B12-C-00354 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/10/2024 | |
| 20241013 | B12-C-00357 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/10/2024 | |
| 20241012 | B0P5-S-00004 | B-CAP-M5 | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 12/10/2024 | |
| 20241012 | B10H-C-00025 | B-F-180 | USC FURNACES | (1.5V)INSPECTION (GROUP.1) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00003 | B-F-180 | USC FURNACES | (1.5V)SET & CALIBRATE (GROUP.0) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00002 | B-F-180 | USC FURNACES | (1.5V)INSPECTION CONTROL VALVE(GROUP.2) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00047 | B-F-180 | USC FURNACES | (1.5V)CONDITION CHECK (GROUP.V) | IM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00047 | B-F-180 | USC FURNACES | (1V)INSPECTION FURNACE(GROUP.A&Z) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00047 | B-F-180 | USC FURNACES | (1V)UNPLUG COIL VENTURI(GROUP.A) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00002 | B-F-180 | USC FURNACES | (1.5V)SET/CALIBRATE(GROUP.O)(OUT-SOURCE) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00002 | B-F-180 | USC FURNACES | (1.5V)CHECK&INSPECT(GROUP.5)(OUT-SOURCE) | IM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00002 | B-F-180 | USC FURNACES | (1.5V)CHECK & INSPECT(GROUP.1) | IM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00039 | B-F-180 | USC FURNACES | (3M) CONDITION CHECK (OSL 2021-089) | IM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00037 | B-F-180 | USC FURNACES | (1V)INTERNAL CLEANING TLX(GROUP(T)) | IM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00037 | B-F-180 | USC FURNACES | (1V)INTERNAL CLEANING USG(GROUP.U1) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00013 | B-F-180 | USC FURNACES | (1.5V)INSPECTION (GROUP.3) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00026 | B-F-180 | USC FURNACES | (1.5V)CLEANING & INSPECTION(GROUP.2) | PM | 12/10/2024 | Furnace |
| 20241012 | B10H-C-00043 | B-F-180 | USC FURNACES | (1.5V)IMS Impulse LinePig VenturiGroup.PI | IM | 12/10/2024 | Furnace |
| 20241012 | B60-C-00055 | B-G-1112-P-35 | OXIDIZED SPENT CAUSTIC TRANSFER PUMPS | (1V)LUBRICATE | PM | 12/10/2024 | |
| 20241012 | B10H-C-00049 | B-HV-1807 | DECOKE EFFLUENT TO F-180 | (1.5V)CLEANING BOTTOM PLATE INS.(GroupG) | PM | 12/10/2024 | |
| 20241012 | B63-C-00039 | B-HY-1619 | HYDRANT AREA QUENCH | (6M)HY QUENCH LUBRICATION | PM | 12/10/2024 | |

| | | | | | | | |
|----------|---------------|-------------------|--|---|----|-----------|---------------|
| 20241009 | 061-C-001-30 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1Y) LUBRICATE & CLEANING | PM | 9/10/2024 | |
| 20241009 | 010K-C-00046 | B-HV-10106 | F-1010 EFFLUENT TO A-210 | (6M)LUBRICAT AND INSPECT ZV VALVE Group G | PM | 9/10/2024 | |
| 20241009 | 010K-C-00046 | B-HV-10106A | F-1010 DECKING VALVE | (6M)LUBRICAT AND INSPECT ZV VALVE Group G | PM | 9/10/2024 | |
| 20241009 | 009C-C-00048 | B-M-N-1100 | GROUPING TAG FOR MIXED C4 (EAST B/L) | (4M)CALIB.FOR M-19010 MIXED C4 TO BST. | PM | 9/10/2024 | |
| 20241009 | 0308-C-00122 | B-HIG-401-P-15 | EXPENDER OIL PUMP MOTOR | (3M)VISUAL INSPECTION AND RECORD | PM | 9/10/2024 | |
| 20241009 | 047A1-C-0020 | B-PT-15306 | Q-1530 | (2Y)SET & CALIBRATE (OUT-SOURCE) | PM | 9/10/2024 | |
| 20241009 | 047A2-C-0011 | B-PT-15310 | P-1530A/5 DISCH. | (2Y)SET & CALIBRATE (OUT-SOURCE) | PM | 9/10/2024 | |
| 20241009 | 047A2-C-0011 | B-PT-15325 | T-1530 TO HOT FLARE | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 9/10/2024 | |
| 20241009 | BNA-C-00029 | B-SECUR-TASK17 | INSPECTION ROOM STORAGE TANK/ROA | (1M)INSPECTION | PM | 9/10/2024 | |
| 20241008 | 049-C-00013 | B-G-1359-P-1 | LP VOC FLARE KO DRUM LIQUID PUMP | RCM-(1M)Short Term preservation | PM | 8/10/2024 | waitin(Flare) |
| 20241008 | 049-C-00013 | B-GND-BV | GROUND GROUPING FOR BV | (6M)CHECK&INSPECTION | PM | 8/10/2024 | |
| 20241008 | 049-C-00013 | B-IF-08 | INSPECTION FLANGE GROUPING FOR BV | (6M)CHECK&INSPECTION | PM | 8/10/2024 | |
| 20241008 | 041N-C-0014 | B-41N-BV | LIGHTING GROUPIN FOR BV | (6M)CHECK&INSPECTION | PM | 8/10/2024 | |
| 20241008 | 090-C-00156 | B-MCC-0E-KW1A | Grouping Tag, for MCC-KW1A | (3M)INSPECT & CONDITION CHECK | PM | 8/10/2024 | |
| 20241008 | 090-C-00156 | B-MCC-0E-KW2B | Grouping Tag, for MCC-KW2B | (3M)INSPECT & CONDITION CHECK | PM | 8/10/2024 | |
| 20241008 | 0113-S-00026 | B-P-1571A | Cracker Bottom Export Pump | (6M)CHANGE LUBE OIL | PM | 8/10/2024 | Pump |
| 20241008 | 0113-S-00027 | B-P-15715 | Cracker Bottom Export Pump | (6M)CHANGE LUBE OIL | PM | 8/10/2024 | Pump |
| 20241008 | 057-B-00002 | B-R-14755 | INSTRUMENT AIR COMPRESS | (4,000hrs)Inspection Visit Type A 4000H | PM | 8/10/2024 | |
| 20241008 | 0091-C-00006 | B-SVDRF | GROUPING FOR BLOCK VALVE | (1Y)INSPECTION / LUBRICATION | PM | 8/10/2024 | |
| 20241008 | 090-C-00156 | B-SWGR-0E-KW12A | Grouping Tag, for SWGR-KW1A,10 | (3M)INSPECT & CONDITION CHECK | PM | 8/10/2024 | |
| 20241008 | 013-C-00044 | B-UPS-2M1-A1 | 220 VAC UPS1 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/10/2024 | |
| 20241008 | 013-C-00046 | B-UPS-2M1-A2 | 220 VAC UPS PANEL(BYPASS) | (1M)INSPECT&CONDITION CHECK | PM | 8/10/2024 | |
| 20241008 | 013-C-00046 | B-UPS-2M1-A3 | 220 VAC UPS2 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/10/2024 | |
| 20241008 | 043-S-0002 | B-AJ-3802-PIA | HEAT EXCHANGER ANILINE INJECTION PUMP | (1M)QUALITY CHECK | PM | 8/10/2024 | |
| 20241008 | 012-S-00040 | B-AJ-4799 | OIL WST SYSTEM | (1M) MONTHLY & INSPECTION | PM | 8/10/2024 | |
| 20241007 | 003C-C-00080 | B-ANALYZER-Q2H42 | GROUPING FOR OXYGEN ANALYZER PLANT#1/2 | (2M)SET & CALIBRATE | PM | 7/10/2024 | |
| 20241007 | BNA-C-00051 | B-CRIT-EG-CO2D-P1 | Critical Equipment Cold Area Plant 1 | (1M)Visual & Condition Inspection | PM | 7/10/2024 | |
| 20241007 | 038-C-00113 | B-CRITICAL-EG-HGT | GROUPING TAG FOR NH SEC PLANT#1 | (1M)Visual & Condition Inspection | PM | 7/10/2024 | |
| 20241007 | 090-C-00067 | B-GS-252 | DIESEL ENGINE GENERATOR SET MOTOR | (3M)INSPECT ENGINE WEEKLY EXERCISE | PM | 7/10/2024 | |
| 20241007 | 090-C-00067 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (3M)INSPECT ENGINE WEEKLY EXERCISE | PM | 7/10/2024 | |
| 20241007 | 063-C-00082 | B-HY-1501 | HYDRANT AREA TEMP FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/10/2024 | |
| 20241007 | 063-C-00082 | B-HY-1502 | HYDRANT AREA TEMP FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/10/2024 | |
| 20241007 | 063-C-00082 | B-HY-1503 | HYDRANT AREA TEMP FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/10/2024 | |
| 20241007 | 063-C-00082 | B-HY-1504 | HYDRANT AREA FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/10/2024 | |
| 20241007 | 055-C-00083 | B-CM-12015 | CANAL WY WATER CIRCULATING MOTOR | (1Y)CLEANING & LUBRICATE | PM | 7/10/2024 | Motor |
| 20241007 | 055B-C-00057 | B-P-12015 | COOLING WATER PUMP | (1Y)CLEANING | PM | 7/10/2024 | Pump |
| 20241007 | 0026C-WX-0001 | B-P-1501A | FIRE MAIN PUMP | (1Y)Weekly-Pt sation screen cleaning | PM | 7/10/2024 | Pump |
| 20241007 | 0208-C-00016 | B-P-335A | STRONG CAUSTIC SUPPLY PUMP | (1Y)CLEANING & LUBRICATE | PM | 7/10/2024 | Pump |
| 20241007 | 0208-C-00017 | B-P-335S | STRONG CAUSTIC SUPPLY PUMP | (1Y)CLEANING & LUBRICATE | PM | 7/10/2024 | Pump |
| 20241007 | 010K-S-00001 | B-R-1010 | FURNACE ID FANS | RCM-(1M)INSPECT & LUBRICATE | PM | 7/10/2024 | |
| 20241007 | 010L-S-00001 | B-R-1020 | FURNACE ID FANS | RCM-(1M)INSPECT & LUBRICATE | PM | 7/10/2024 | |
| 20241007 | 010G-S-00001 | B-R-120 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/10/2024 | |
| 20241007 | 010H-S-00001 | B-R-180 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/10/2024 | |
| 20241007 | 010S-S-00001 | B-R-190 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/10/2024 | |
| 20241007 | BNA-C-00021 | B-SECUR-TASK08 | FOR PM:TEST FIRE PUMP | (1M)INSPECTION | PM | 7/10/2024 | |
| 20241007 | BNA-C-00021 | B-SECUR-TASK15 | FOR PM:INSPECTION HALON FIRE EXTINGUISH | (1M)INSPECTION | PM | 7/10/2024 | |
| 20241007 | BNA-C-00020 | B-SECUR-TASK29 | FOR PM:MANUAL STATION TEST (ADMIN AREA) | (1M)INSPECTION | PM | 7/10/2024 | |
| 20241007 | B3A-C-00009 | B-TR-01 | DISTRIBUTION TRANSFORMER | (1M)CONDITION CHECK | PM | 7/10/2024 | |
| 20241007 | 090-C-00240 | B-XFMR-4A2-1 | LIGHTING TRANSFORMER FOR LABORATORY 0.4/ | (3M)-RCM Visual Inspection | IM | 7/10/2024 | |
| 20241007 | 090-C-00241 | B-XFMR-4A2-1 | LIGHTING TRANSFORMER FOR LABORATORY 0.4/ | (6M)-RCM Thermosan | IM | 7/10/2024 | |

| | | | | | | | |
|----------|---------------|--------------------|---|---|----|-----------|------------|
| 20241005 | B10F-S-00001 | B-R-160 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PH | 5/10/2024 | |
| 20241005 | BH4-C-00016 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | RCM(3Y)Overhaul ID Fan Bearing Group ID" | PH | 5/10/2024 | |
| 20241005 | BH43C-C-00008 | B-R-600-P-4A | LUBE OIL PURIFIER | RCM-(1M)VISUAL INSPECTION | PH | 5/10/2024 | |
| 20241005 | BH4-C-00016 | B-RM-3102 | ETHYLENE FURNACE ID FAN#2 MOTOR | (3Y) ID Fan Motor Overhaul (Group ID") | PH | 5/10/2024 | |
| 20241005 | B06A-C-00004 | B-T-269 | DILUTION STEAM GENERATOR FEED EATER | (3M) CONDITION CHECK (OSI: 2021-111) | IM | 5/10/2024 | |
| 20241005 | B90-C-00017 | B-UP51-A1 | UPS1 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PH | 5/10/2024 | |
| 20241005 | B90-C-00055 | B-UP51-A2 | UPS2(BYPASS) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PH | 5/10/2024 | |
| 20241005 | B90-C-00096 | B-UP51-A3 | UPS2 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PH | 5/10/2024 | |
| 20241025 | BH23-C-00002 | B-V-3801-P1A | D2 SCAVENGER INJECTION PUMP | (1Y)LUBRICATION | PH | 5/10/2024 | |
| 20241025 | BH23-C-00006 | B-V-3803-P1E | PHOSPHASE PUMP | (1Y)LUBRICATION | PH | 5/10/2024 | |
| 20241025 | BH23-C-00007 | B-V-3803-P1S | PHOSPHASE PUMP | (1Y)LUBRICATION | PH | 5/10/2024 | |
| 20241025 | B12-C-00010 | B-XFMR-2E1 | POWER TRANSFORMER 6.6/0.4 kV FOR SUB NO.6 | (6M)-RCM Thermoscan | IM | 5/10/2024 | |
| 20241025 | B12-C-00017 | B-XFMR-2EAB | POWER TRANSFORMER 6.6/0.4 kV FOR SUB NO.6 | (6M)-RCM Thermoscan | IM | 5/10/2024 | |
| 20241025 | B12-C-00010 | B-XFMR-2EB | POWER TRANSFORMER 6.6/0.4 kV FOR SUB NO.6 | (6M)-RCM Thermoscan | IM | 5/10/2024 | |
| 20241024 | B13-C-00053 | B-CAP-1M1 | POWER CAPACITOR PANEL-1 | (1M)VISUAL INSPECTION | PH | 4/10/2024 | |
| 20241024 | B13-C-00054 | B-CAP-1M1 | POWER CAPACITOR PANEL-2 | (1M)VISUAL INSPECTION | PH | 4/10/2024 | |
| 20241024 | B13-C-00057 | B-EHT-001 | ELECTRICAL HEAT TRACING CONTROL PANEL | (1M)VISUAL INSPECTION | PH | 4/10/2024 | |
| 20241024 | BH3-C-00006 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)SET/CALIBRATE(GROUP(11-2))(OUT-SOURCE) | PH | 4/10/2024 | Furnace |
| 20241024 | BH3-C-00006 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)SET/CALIBRATE(GROUP(11-1))PSL, PSH, PSL | PH | 4/10/2024 | Furnace |
| 20241024 | B053-C-00004 | B-FT-22201 | P-2213 DISCH. | (3M) CONDITION CHECK (OSI: 2021-071) | IM | 4/10/2024 | |
| 20241024 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PH | 4/10/2024 | |
| 20241024 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PH | 4/10/2024 | |
| 20241024 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PH | 4/10/2024 | |
| 20241024 | B12-C-00056 | B-G-25-F-1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PH | 4/10/2024 | |
| 20241024 | B90-C-00005 | B-G-25-2S | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PH | 4/10/2024 | |
| 20241024 | B90-C-00075 | B-G-34-4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PH | 4/10/2024 | |
| 20241024 | B338-S-00002 | B-MOTOR-EP-NPA-003 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION | PH | 4/10/2024 | Motor |
| 20241024 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PH | 4/10/2024 | Pump |
| 20241024 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PH | 4/10/2024 | Pump |
| 20241024 | B061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PH | 4/10/2024 | Pump |
| 20241024 | B061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PH | 4/10/2024 | Pump |
| 20241024 | B063-WK-C002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PH | 4/10/2024 | Pump |
| 20241024 | B063-WK-C002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PH | 4/10/2024 | Pump |
| 20241024 | B063-WK-C002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PH | 4/10/2024 | Pump |
| 20241024 | B063-WK-C002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PH | 4/10/2024 | Pump |
| 20241024 | B063-WK-C002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PH | 4/10/2024 | Pump |
| 20241024 | B518-B-00009 | B-PSV-9300A | 93J1 TO COLD FLARE | (3Y)SET & CALIBRATE (PSV 1X2) | PH | 4/10/2024 | PSV |
| 20241024 | B47A1-S-00005 | B-R-1530S | ETHYLENE STORAGE BOIL-OFF COMPRESSOR | (5Y)OVERHAUL | PH | 4/10/2024 | Compressor |
| 20241024 | B20-C-00001 | B-SECUR-TASK44 | VISUAL INSPECTION CO2 SYSTEM MA | (1M)INSPECTION | PH | 4/10/2024 | |
| 20241024 | B13-C-00058 | B-SU7-ERMC5 | ELECTRICAL REMOTE MONITORING & CONTROLS | (1M)VISUAL INSPECTION | PH | 4/10/2024 | |
| 20241024 | B13-S-00011 | B-SWGR-ORP | Grouping For SWGR ORP | (6M)INSPECTION INFRARED | PH | 4/10/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|------------|
| 20240928 | 8112-C-00799 | B-1036-FHH-001 | Fire Hose House for OLE2/3 | (1M)Fire Hose Box Visual Inspection | IM | 28/9/2024 | |
| 20240928 | 8112-C-00778 | B-1036-FHH-001 | Water Hydrant for OLE2/3 | (1M)Water Hydrant Visual Inspection | IM | 28/9/2024 | |
| 20240928 | 8112-C-00779 | B-1036-FHH-001 | Water Hydrant with Monitor for OLE2/3 | (1M)Water Hydrant Monitor Visual Inspect | IM | 28/9/2024 | |
| 20240928 | 8112-C-00059 | B-EL-ORP | Grouping For EXIT LIGHTING ORP | (3M)INSPECT, VERIFY&CHECK | PM | 28/9/2024 | |
| 20240928 | 87-C-00078 | B-G-920-P-1A | SULFURIC ACID FEED PUMP | (1Y)LUBRICATION | PM | 28/9/2024 | |
| 20240928 | 890-C-00140 | B-INTERCOM-6P2-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 28/9/2024 | |
| 20240928 | 890-C-00097 | B-MCC-ED-211 | Grouping Tag for MCC Sub#4 (MCC-211) | (3M) Inspect & Adjust | PM | 28/9/2024 | |
| 20240928 | 890-C-00134 | B-MCC-EO-B | Grouping Tag for 6.6KV MCC Sub#5 | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 28/9/2024 | |
| 20240928 | 853-C-00032 | B-P-2213S | DEFINERIALIZED WATER MAKE-UP PUMP | (1Y)CLEANING | PM | 28/9/2024 | Pump |
| 20240928 | 87-C-00017 | B-P-3402 | OP-SPEC C2 PUMP | (8M) CHECK & INSPECT | PM | 28/9/2024 | Pump |
| 20240928 | 87-C-3502A | B-P-3502A | DEBILITANTER REFLUX PUMP | (6M)CHECK & INSPECT | PM | 28/9/2024 | Pump |
| 20240928 | 861-C-00018 | B-P-3502S | DEBILITANTER REFLUX PUMP | (6M)CHECK & INSPECT | PM | 28/9/2024 | Pump |
| 20240928 | 861-C-00034 | B-P-3501S | ETHANE RECYLE PUMP | (6M)CHECK & INSPECT | PM | 28/9/2024 | Pump |
| 20240928 | 86A-C-00058 | B-P-4910S | BUTENE-1 PRODUCT TRANSFER PUMP | (1Y) Lubricate & Cleaning | PM | 28/9/2024 | Pump |
| 20240928 | 87-S-00008 | B-P-902A | LP SUSPECT CONDENSATE RUMP | (2Y)CLEANING & LUBRICATE | PM | 28/9/2024 | Pump |
| 20240928 | 841-C-00045 | B-PSV-6501S | T-64MC TO COLD FLARE | (3Y)SET & CALIBRATE(PSV EX3) | PM | 28/9/2024 | PSV |
| 20240928 | 834-C-00001 | B-PT | STANDARD TOOL & HOOK | (1Y)INSPECTION | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00007 | B-W502-02-01 | AIR COMPRESSOR SULLIAR | (1Y)CLEANING | PM | 28/9/2024 | Compressor |
| 20240928 | 8W5-C-00001 | B-W503-06-01 | BALANCING MACHINE | (1M)INSPECTION | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00001 | B-W505-01-01 | UNIVERSAL MILLING MACHINE | (1M)INSPECT | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00014 | B-W505-03-01 | CENTER LATHE MACHINE AJAX | (1M)INSPECT | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00023 | B-W505-03-02 | CENTER LATHE MACHINE PINACHO | (1M)INSPECT | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00001 | B-W505-05-01 | COLUMN TYPE DRILLING MACHINE | (1M)INSPECTION | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00025 | B-W505-07-01 | HYDRAULIC HACKSAW | (1M)INSPECT | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00026 | B-W505-21-01 | SHAPING MACHINE | (1M)INSPECT & LUBRICATE | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00005 | B-W508-03-01 | HIGH PRESSURE WATER JET MACHINE | (1M)INSPECT | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00003 | B-W514-01-01 | FORK LIFT | (1M)INSPECTION | PM | 28/9/2024 | |
| 20240928 | 8W5-S-00009 | B-W514-03-01 | PUMP LOADER HINO | (1M)INSPECTION | PM | 28/9/2024 | |
| 20240927 | 80P1-C-00031 | B-ANALYZER-O2I4/1 | GROUPING FOR OXYGEN ANALYZER PLANT#1 | (2M)SET & CALIBRATE | PM | 27/9/2024 | |
| 20240927 | 801-C-00019 | B-AT-1141A | PHOTO ANALYZER | (2M) Inspect & Cal | PM | 27/9/2024 | |
| 20240927 | 80P6-C-00027 | B-AT-383102 | SIO2 ANALYZER TRANSMITTER FOR V-3821 OUT | (1M)SET & CALIBRATE | PM | 27/9/2024 | |
| 20240927 | 812-C-00023 | B-AT-402103 | BUTADIENE IR | (2M)SET & CALIBRATE | PM | 27/9/2024 | |
| 20240927 | 810A-C-00041 | B-F-110 | USE FURNACES | (3M) CONDITION CHECK (OSL 2022-165) | IM | 27/9/2024 | Furnace |
| 20240927 | 8061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 27/9/2024 | |
| 20240927 | 8061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 27/9/2024 | |
| 20240927 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 27/9/2024 | |
| 20240927 | 812-C-00036 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 27/9/2024 | |
| 20240927 | 890-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 27/9/2024 | |
| 20240927 | 890-C-00075 | B-GS-3M | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 27/9/2024 | |
| 20240927 | 890-C-00028 | B-MCC-1E4-P-3 | MCC FOR R-3600-G-7 | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 890-C-00028 | B-MCC-2E4-P-3 | MCC FOR R-3600-P-15 | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 890-C-00028 | B-MCC-2E5-P-3 | MCC FOR R-3650-G-5 | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 890-C-00029 | B-MCC-2E5-G-6 | FEEDER FOR R-3600-G-6 | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 812-C-00057 | B-MCC-2EA-SR03A1 | MCC for R-4031-R-1A | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 812-C-00057 | B-MCC-2EA-SR06D1 | MCC for R-4031-P-1A | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 812-C-00057 | B-MCC-2EB-SAZ001 | MCC for R-4031-P-1S | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 812-C-00057 | B-MCC-2EB-SAZ3B1 | MCC for R-4031-R-1S | RCM (3M) MCC INSPECTION | IM | 27/9/2024 | Furnace |
| 20240927 | 80P1-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 27/9/2024 | Pump |
| 20240927 | 8061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 27/9/2024 | Pump |
| 20240927 | 8061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 27/9/2024 | Pump |

| | | | | | | | |
|----------|--------------|------------------|---|--|----|-----------|---------|
| 20240927 | 8061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 27/9/2024 | Pump |
| 20240927 | 8063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 27/9/2024 | Pump |
| 20240927 | 8063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 27/9/2024 | Pump |
| 20240927 | 8063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 27/9/2024 | Pump |
| 20240927 | 8063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 27/9/2024 | Pump |
| 20240927 | 8063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 27/9/2024 | Pump |
| 20240926 | 83A-C-00004 | B-AT-2410 | ISO14000-OPACITY ANALYZER FOR S-2401 | (3M)WINDOW CHECK (B-2401) | PM | 26/9/2024 | |
| 20240926 | 812-C-00024 | B-AT-402104 | BUTADIENE Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/9/2024 | |
| 20240926 | 812-C-00025 | B-AT-404501 | BEU Column Accuam. (N-4045) Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/9/2024 | |
| 20240926 | 87-C-00006 | B-AT-4040 | HIC LP SLS COND. DISC. P-902A/5 | (1M)SET & CALIBRATE | PM | 26/9/2024 | |
| 20240926 | 87-C-00006 | B-AT-4040 | CRIT SO. CO.2 P-2 | (1M)SET & CALIBRATE | PM | 26/9/2024 | |
| 20240926 | 863-C-00088 | B-DV-NPA-001 | GROUPING TAG FOR DELUGE VALVE NPA | (1W)CHECK/VISUAL HEAT DETECTORS AND | PM | 26/9/2024 | |
| 20240926 | 812-C-00756 | B-MCC-2EA-SR05D1 | MCC for P-3407S | RCM (3M) MCC INSPECTION | IM | 26/9/2024 | |
| 20240926 | 812-C-00756 | B-MCC-2EB-SAZ0E1 | MCC for P-3407A | RCM (3M) MCC INSPECTION | IM | 26/9/2024 | |
| 20240926 | 812-C-00756 | B-MCC-2EB-SAZ3B3 | MCC for R-4301-G-5 | RCM (3M) MCC INSPECTION | IM | 26/9/2024 | |
| 20240926 | 812-C-00756 | B-MCC-2EB-SR23D1 | MCC for R-4301-P-15 | RCM (3M) MCC INSPECTION | IM | 26/9/2024 | |
| 20240926 | 820-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (NUNGHATE) | (1D)INSPECTION | PM | 26/9/2024 | |
| 20240926 | 820-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAVYARIN) | (1D)INSPECTION | PM | 26/9/2024 | |
| 20240926 | 820-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (1D)INSPECTION | PM | 26/9/2024 | |
| 20240926 | 820-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 26/9/2024 | |
| 20240926 | 804-C-00014 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2M)INSPECTION | PM | 26/9/2024 | |
| 20240925 | 80P1-C-00002 | B-EPXD1M4 | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P1-S-00002 | B-EPXD1M8 | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P2-C-00001 | B-EPXD1M6 | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P2-S-00001 | B-EPXD1M6 | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P3-C-00003 | B-EPXD1M6 | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P3-S-00003 | B-EPXD1M6 | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P4-C-00002 | B-EPXD1M6 | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P4-S-00002 | B-EPXD1M6 | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/9/2024 | |
| 20240925 | 80P5-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/9/2024 | Motor |
| 20240925 | 80P5-S-00004 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/9/2024 | Motor |
| 20240925 | 890-S-00015 | B-PM-3001S | URG FEED PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 25/9/2024 | Motor |
| 20240925 | 846A-C-00011 | B-PT-15203 | PRESS.TX. COMPENSATE FOR LT-15201 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 25/9/2024 | |
| 20240925 | 81A-C-00030 | B-SECUR-TASK03C | FOR PH:FLUSH LINE HEADER FIRE WATER | (4M)INSPECTION | PM | 25/9/2024 | |
| 20240925 | 8H22-C-00005 | B-V-3100-P-3 | DNDS INJECTION PUMP TO FURNACE F-3103 | (1Y)LUBRICATION | PM | 25/9/2024 | |
| 20240924 | 8016-C-00027 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2022-152) | IM | 24/9/2024 | |
| 20240924 | 8016-C-00028 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2022-157) | IM | 24/9/2024 | |
| 20240924 | 8016-C-00036 | B-D-5-C-51 | 115V DC FOR 6.6 KV MCC | (3M) CONDITION CHECK (OSL 2022-151) | IM | 24/9/2024 | |
| 20240924 | 8106-C-00048 | B-F-150 | USE FURNACES | (3M) CONDITION CHECK (OSL 2022-153) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00016 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Condition Valve Calibration(Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00016 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Inspection Furnace (Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00016 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)DV Bottom Plate Inspect(Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00019 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Selenoid Valves (Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00019 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Check Valve for Line (DNDS(Group.2)) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00019 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Effluent Analyzer and Pygas(Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00026 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)SPH Steam Valve (Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00006 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Inspect and Clean (Group.4) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00006 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Inspect and Clean (Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00006 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Clean Fuel Gas Strainer (Group.2) | IM | 24/9/2024 | Furnace |
| 20240924 | 8H7A-C-00006 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Inspect and Clean (Group.2) | IM | 24/9/2024 | Furnace |

| | | | | | | | |
|----------|---------------|-------------------|--|--|----|-----------|---------|
| 20240924 | BH7A-C-00008 | B-F-3106 | ETHYLENE FURNACE # 6 | (1Y)Inspect and Clean (Group.W) | PM | 24/9/2024 | Furnace |
| 20240924 | B10B-C-00051 | B-M-120 | STEAM DRUM | (3M) CONDITION CHECK (OSL 2022-155) | IM | 24/9/2024 | |
| 20240924 | BH7A-C-00020 | B-M-3106 | 6 FURNACE SHP STEAM | (1Y)SG Steam Drum Overhaul(Group.1) | PM | 24/9/2024 | |
| 20240924 | B51A-C-00006 | B-M-932 | HOT FLARE KNOCKOUT DRUM | (3M) CONDITION CHECK (OSL 2020-011) | IM | 24/9/2024 | Flare |
| 20240924 | B00C-C-00070 | B-P-1201A | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2022-150) | IM | 24/9/2024 | Pump |
| 20240924 | B00C-C-00074 | B-PIPE1-5CH | LINE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-158) | IM | 24/9/2024 | |
| 20240924 | B00C-C-00073 | B-PIPE1-5L | LINE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-156) | IM | 24/9/2024 | |
| 20240924 | B16-C-00017 | B-PSV-2200C | A-220 TOP HOT FLARE | BOWTIE-(4Y)-OVERHAUL & INSPECTION (8X10) | PM | 24/9/2024 | PSV |
| 20240924 | B90C-C-00077 | B-R-3106 | ETHYLENE FURNACE ID FAN#6 | (1Y)ID Fan Lubricate,Inspection(Group.M) | PM | 24/9/2024 | |
| 20240924 | B90C-C-00077 | B-RM-3106 | ETHYLENE FURNACE ID FAN#5 MOTOR | (1Y)ID Fan Motor Inspection (Group.M) | PM | 24/9/2024 | |
| 20240924 | B06A-C-00008 | B-T-2708 | DILUTION STEAM GENERATOR RECOILERS | (3M) CONDITION CHECK (OSL 2022-154) | IM | 24/9/2024 | |
| 20240924 | BH22-C-00009 | B-V-3100-P6S | DNDS INJECTION PUMP (COMMON SPARE) | (1Y)LUBRICATION | PM | 24/9/2024 | |
| 20240923 | B32-C-00112 | B-A-750 | GHR TRIPPER TOWER | (3M) CONDITION CHECK (OSL 2022-171) | PM | 23/9/2024 | |
| 20240923 | B11-C-00031 | B-AT-407021 | LP CONDENSATE TOC | (1M)SET & CALIBRATE | PM | 23/9/2024 | |
| 20240923 | B11-C-00031 | B-CV-BV-A1 | Grouping Globe Control Valve ClassA | (1Y)VISUAL INSPECTION | IM | 23/9/2024 | |
| 20240923 | B11-C-00032 | B-CV-BV-A2 | Grouping Butterfly Control Valve ClassA | (1Y)VISUAL INSPECTION | IM | 23/9/2024 | |
| 20240923 | B10E-C-00044 | B-F-150 | USE FURNACES | (3M) CONDITION CHECK (OSL 2022-144) | IM | 23/9/2024 | Furnace |
| 20240923 | B10G-C-00040 | B-F-170 | USE FURNACES | (3M) CONDITION CHECK (OSL 2022-140) | IM | 23/9/2024 | Furnace |
| 20240923 | B060-C-00054 | B-G-1122-V-1 | VAPOR SCRUBBER | (3M) CONDITION CHECK (OSL 2022-170) | IM | 23/9/2024 | |
| 20240923 | B003-C-00030 | B-HV-2200B | HP STM TO PT-220A TURB | (3M) CONDITION CHECK (OSL 2022-174) | IM | 23/9/2024 | |
| 20240923 | B007-C-00022 | B-LV-9490 | HP FLASH DRUM | (3M) CONDITION CHECK (OSL 2022-173) | IM | 23/9/2024 | |
| 20240923 | B52A-C-00008 | B-P-1201A | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2022-172) | IM | 23/9/2024 | Pump |
| 20240923 | B06A-C-00008 | B-T-2708 | DILOUTION STEAM GENERATOR RECOILERS | (3M) CONDITION CHECK (OSL 2022-154) | IM | 23/9/2024 | Pump |
| 20240923 | B063-WX-00021 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pr sudion sren cleaning | PM | 23/9/2024 | Pump |
| 20240923 | B11-C-00045 | B-P-0056 | SOLVENT SLOPS PUMP | (3M) REGREASE | PM | 23/9/2024 | Pump |
| 20240923 | B11-C-00043 | B-PGC-BV-HOUSE2 | GROUPING TAG FOR PGC BV HOUSE 2 | (2M)SET&CALIBRATE | PM | 23/9/2024 | |
| 20240923 | B00C-C-00067 | B-PIPE1-5CL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-175) | IM | 23/9/2024 | |
| 20240923 | B47B-C-00054 | B-T-1534 | T-1534 TO HOT FLARE | (3M) CONDITION CHECK (OSL 2022-143) | IM | 23/9/2024 | PSV |
| 20240923 | B16-C-00021 | B-PSV-2200S | A-220 TOP HOT FLARE | BOWTIE-(4Y)-OVERHAUL & INSPECTION (8X10) | PM | 23/9/2024 | PSV |
| 20240923 | B061-C-00020 | B-Q-1169 | WASTE WATER SUMP | (3M) CONDITION CHECK (OSL 2022-141) | IM | 23/9/2024 | |
| 20240923 | B52B-C-00140 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-167) | IM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207A | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207B | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207C | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207D | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207E | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207F | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207G | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BH8-C-00024 | B-R-3207H | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/9/2024 | |
| 20240923 | BNA-C-00005 | B-SECUR-TASK05 | FOR PH: TEST FIRE PUMP | (1W)INSPECTION | PM | 23/9/2024 | |
| 20240923 | B09C-C-00001 | B-T-050A | FRN: FEED QW. HEATERS | (3M) CONDITION CHECK (OSL 2022-165) | IM | 23/9/2024 | |
| 20240922 | B01I-C-00025 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET&CALIBRATE | PM | 22/9/2024 | |
| 20240922 | BH13-C-00062 | B-AT-311003 | MOISTURE ANALYZER TRANSMITTER FOR M-3301 | (1M)MOISTURE ANALYZER AMETEX | PM | 22/9/2024 | |
| 20240922 | B48-C-00024 | B-CCTV-GP2-BV | CCTV Grouping TAG BV | (3M)FUNCTION TEST & EXERCISE | PM | 22/9/2024 | |
| 20240922 | B03A-C-00001 | B-P-1350S-R-1 | ASSISTED BY BOWTIE | (3M)FUNCTION TEST & EXERCISE | PM | 22/9/2024 | |
| 20240922 | B09C-C-00005 | B-M-10073 | GROUPINGTAG FOR QUENCH BOTTOM FROM PITTE | (4M)SET & CALIBRATE | PM | 22/9/2024 | |
| 20240922 | B09C-C-00006 | B-M-13074 | GROUPING TAG FOR C3/C4 FROM PITTE | (4M)SET & CALIBRATE | PM | 22/9/2024 | |
| 20240922 | B09C-C-00009 | B-FM-3801S | BFM PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 22/9/2024 | Motor |
| 20240922 | B43A-C-00005 | B-PSV-5660A | H-660 TO COLD FLARE | (3Y)SET & CALIBRATE(PSV 4X6) | PM | 22/9/2024 | PSV |
| 20240922 | B52B-C-00051 | B-R-1201F | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 22/9/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|--|----|-----------|------------|
| 20240920 | 9063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 20/9/2024 | Pump |
| 20240920 | 9063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 20/9/2024 | Pump |
| 20240920 | 9063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 20/9/2024 | Pump |
| 20240920 | 9063-WK-0002 | B-P-1601E | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 20/9/2024 | Pump |
| 20240920 | 9016-C-00031 | B-P-220A | QUENCH WATER CIRCULATION PUMP | (3M) CONDITION CHECK (OSL 2023-252) | IM | 20/9/2024 | Pump |
| 20240920 | 9013-C-00016 | B-P-221A | QUENCH OIL TOWER REFLEX PUMP | (3M) CONDITION CHECK (OSL 2023-254) | IM | 20/9/2024 | Pump |
| 20240920 | 9208-C-00029 | B-P-342 | ISO14000, WEAK CAUSTIC CIRCULATION PUMP | (1Y) CLEANING & INSPECT | PM | 20/9/2024 | Pump |
| 20240920 | 855-C-00011 | B-PP1-1800S | CLARIFIED WATER (CLC) | (3M) CONDITION CHECK (OSL 2023-241) | IM | 20/9/2024 | |
| 20240920 | 890-C-00114 | B-PIPEL-SC1 | LINE STEAM CONDENSATE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-253) | IM | 20/9/2024 | |
| 20240920 | 800-C-00109 | B-PIPEL-SC1 | LINE STEAM CONDENSATE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-253) | IM | 20/9/2024 | |
| 20240920 | 800-C-00112 | B-PIPEL-SC1 | LINE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-243) | IM | 20/9/2024 | |
| 20240920 | 800-C-00115 | B-PIPEL-SC1 | LINE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-255) | IM | 20/9/2024 | |
| 20240920 | 800-C-00113 | B-PIPEL-SC1 | LINE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-248) | IM | 20/9/2024 | |
| 20240920 | 8090-C-00022 | B-PM-3804A | C3 COMP VACUUM COND MOTOR | RCM (3M) Motor Inspection | IM | 20/9/2024 | Motor |
| 20240920 | 8090-C-00023 | B-PM-3804B | C3 COMP VACUUM COND PUMP MOTOR | RCM (3M) Motor Inspection | IM | 20/9/2024 | Motor |
| 20240920 | 8090-C-00025 | B-PM-3805A | C2 COMP VACUUM COND PUMP MOTOR | RCM (3M) Motor Inspection | IM | 20/9/2024 | Motor |
| 20240920 | 8090-C-00027 | B-PM-3805B | C2 COMP VACUUM COND PUMP MOTOR | RCM (3M) Motor Inspection | IM | 20/9/2024 | Motor |
| 20240920 | 890-C-00003 | B-PP-3E1-1 | NEW MAIN SUBSTATION NORMAL HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/9/2024 | |
| 20240920 | 890-C-00003 | B-PP-3E1-2 | NEW PROCESS SUBSTATION NORMAL HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/9/2024 | |
| 20240920 | 890-C-00003 | B-PP-4F1-1 | CONTROL BUILDING EMERGENCY HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/9/2024 | |
| 20240920 | 890-C-00003 | B-PP-4F1-2 | NEW MAIN SUBSTATION EMERGENCY HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/9/2024 | |
| 20240920 | 890-C-00003 | B-PP-4F1-3 | NEW PROCESS SUBSTATION EMERGENCY HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/9/2024 | |
| 20240920 | 855-C-00030 | B-Q-120L | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2023-236) | IM | 20/9/2024 | |
| 20240920 | 855-C-00012 | B-Q-221B | CLARIFIED WATER STORAGE TANK | (3M) CONDITION CHECK (OSL 2023-246) | IM | 20/9/2024 | |
| 20240920 | 8090-C-00025 | B-R-3600-GM-7 | OIL PURIFIER MOTOR | RCM (3M) Motor Inspection | IM | 20/9/2024 | |
| 20240920 | 8090-C-00026 | B-S-1301 | Demulsifier Fire Stack | (3M) CONDITION CHECK (OSL 2023-250) | IM | 20/9/2024 | |
| 20240920 | 8090-C-00011 | B-S-1302 | Demulsifier Fire Stack | (3M) CONDITION CHECK (OSL 2023-252) | IM | 20/9/2024 | |
| 20240920 | 813-C-00049 | B-TR-2M1 | DRY TYPE TRANSFORMER | (3M) CONDITION CHECK (OSL 2023-232) | PM | 20/9/2024 | |
| 20240920 | 800-C-00110 | B-TRAP-010 | GROUING STEAM TRAP AREA 010 | (3M) CONDITION CHECK (OSL 2023-242) | IM | 20/9/2024 | |
| 20240920 | 800-C-00110 | B-VALVEU-1S | VALVE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-240) | IM | 20/9/2024 | |
| 20240920 | 812-C-00355 | B-VSD-G-4801-RM-1A | VSD Panel for G-4801- RM-1A | (1M)Inspection & Record | PM | 20/9/2024 | |
| 20240920 | 890-C-00194 | B-VSD-MR-1135A | VSD Panel for R-1135A | (1M)Inspection & Record | PM | 20/9/2024 | |
| 20240920 | 890-C-00195 | B-VSD-MR-1135S | VSD Panel for R-1135S | (1M)Inspection & Record | PM | 20/9/2024 | |
| 20240920 | 8003-C-00019 | B-VSD-MR-1500A | VSD Panel for R-1500A | (1M)Inspection & Record | PM | 20/9/2024 | |
| 20240920 | 8003-C-00020 | B-VSD-MR-1500S | VSD Panel for R-1500S | (1M)Inspection & Record | PM | 20/9/2024 | |
| 20240919 | 811-C-00104 | B-AT-3710A | PROPILENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 18/9/2024 | |
| 20240919 | 811-C-00110 | B-AT-3712A | ANALYZER (GC) PROPILENE PRODUCT FROM C3 | (1M) SET & CALIBRATE | PM | 18/9/2024 | |
| 20240919 | 860-C-00088 | B-G-1112-P-15 | HIGH PRESSURE FEED PUMPS | (1M)CLEAN STRAINER&INSPECTION | PM | 19/9/2024 | |
| 20240919 | 818B-S-00001 | B-G-300-PI-1A | CG COMPRESSOR MAIN OIL PUMP TURBINE | (1M)CHECK LUBRICATE OIL | PM | 19/9/2024 | Compressor |
| 20240919 | 810C-C-00041 | B-HV-137 | DECOKE EFFLUENT TO F-130 | (1M)CLEANING BOTTOM PLATE INS.(GROUP1) | PM | 19/9/2024 | |
| 20240919 | 820-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (MUNGATE) | (1D)INSPECTION | PM | 19/9/2024 | |
| 20240919 | 820-C-00003 | B-SECUR-TASK03B | FOR PM: CHECK A FOAM TRUCK(SAYVARI) | (1D)INSPECTION | PM | 19/9/2024 | |
| 20240919 | 820-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK AMBUKANCE(CITRUSKA) | (1D)INSPECTION | PM | 19/9/2024 | |
| 20240919 | 820-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER TAP (NATVATU) | (1D)INSPECTION | PM | 19/9/2024 | |
| 20240919 | 813-C-00017 | B-SECUR-TASK06 | FOR PM: INSPECTION AND CHECK MOBILE AIR | (1M)INSPECTION | PM | 19/9/2024 | |
| 20240918 | 811-C-00100 | B-AT-370501 | C3 LIQUID FROM T-3705 FEED TO T-3705 MAP | (1M) SET & CALIBRATE | PM | 18/9/2024 | |
| 20240918 | 811-C-00109 | B-AT-370502 | ANALYZER (GC) MAP RECYCLO | (1M) SET & CALIBRATE | PM | 18/9/2024 | |
| 20240918 | 811-C-00101 | B-AT-370503 | 1P DEETHAN. BOTTOMS FROM P3604A/S PUMP | (1M) SET & CALIBRATE | PM | 18/9/2024 | |
| 20240918 | 811-C-00105 | B-AT-371202 | PROPILENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 18/9/2024 | |
| 20240918 | 812-C-00027 | B-AT-430106A | F-4301 Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 18/9/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|---------|
| 20240918 | 812-C-00028 | B-AT-430203 | F-4302 Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-DOS-P1 | DCS HONEYWELL TDC3000&EXPERION | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-DOS-P1-BOILER | DCS EMERSON DELTA-V NO CONTROLLER SOFWA | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-DOS-P1-ORP | DCS HONEYWELL C300 EXPERION RS11.1 | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-DOS-P2 | DCS YOKOGAWA CP461-50/AV300/REVISION RS | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-DOS-P3 | DCS HONEYWELL C300 EXPERION | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | IM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-ORP | ESD/MP3101TH.9.05024.2.0ENH2.10.0 | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P1-TANFARM | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P2-COLDAT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P2-FURS/HOT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P2-FURS | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 810A-C-00025 | B-F-110 | USC URNANCES | (1.5Y)INSPECTION (GROUP R1) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00026 | B-F-110 | USC URNANCES | (1.5Y)CLEANING & INSPECTION(GROUP.2) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00049 | B-F-110 | USC URNANCES | (1.5Y)CHECK & INSPECT(GROUP.1) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00049 | B-F-110 | USC URNANCES | (1.5Y)CHECK&INSPECT(GROUP.1) (OUT-SOURCE) | IM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00049 | B-F-110 | USC URNANCES | (1.5Y)SET&CALIBRATE(GROUP.2) (OUT-SOURCE) | IM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00049 | B-F-110 | USC URNANCES | (1.5Y)INSPECT CONTROL VALVE(GROUP.3) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00049 | B-F-110 | USC URNANCES | (1.5Y)SET & CALIBRATE (GROUP.3) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00003 | B-F-110 | USC URNANCES | (1.5Y)CONCOND CHECK (GROUP V) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00003 | B-F-110 | USC URNANCES | (1.5Y)INTERNAL CLEANING TUX(GROUP**) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00003 | B-F-110 | USC URNANCES | (1.5Y)NIPUS LOG CO. VENTURI (GROUP**A) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00003 | B-F-110 | USC URNANCES | (1.5Y)INTERNAL CLEANING USX (GROUP**U1) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00003 | B-F-110 | USC URNANCES | (1.5Y)INSPECTION FURNANCE(GROUP**A&2) | IM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00007 | B-F-110 | USC URNANCES | (1.5Y)INSPECTION (GROUP R2) | PM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00037 | B-F-110 | USC URNANCES | (1.5Y)INS. Impulse LinePG Ventury Group.PI | IM | 18/9/2024 | Furnace |
| 20240918 | 810A-C-00049 | B-HV-1107 | DECOKE EFFLUENT TO F-110 | (1.5Y)CLEANING BOTTOM PLATE INS.(GROUP.2) | PM | 18/9/2024 | |
| 20240918 | 810A-C-00049 | B-LOC-F-110 | TI/DOV Switch Box of F-110 | (1.5Y)Inspect F-110 DI/TX LOC (GROUP**) | IM | 18/9/2024 | |
| 20240918 | 800P-C-00015 | B-M-1057 | GROUPING TAG FOR TAIL GAS TO ROC, M.SKID | (1M)INSPECTION | PM | 18/9/2024 | |
| 20240918 | 810A-C-00049 | B-MR-10 | FURNACE ID FAN MOTOR | (1Y)INSPECTION (GROUP M) | PM | 18/9/2024 | |
| 20240918 | 800-C-00049 | B-PIPEL-DR | LINE DRAIN OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-014) | IM | 18/9/2024 | |
| 20240918 | 800-C-00049 | B-PIPEL-SCH | LINE STEAM CONDENSATE - MP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-003) | IM | 18/9/2024 | |
| 20240918 | 800-C-00041 | B-PIPEL-SM | LINE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-004) | IM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P1-CCC-R57S | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P1-CCC-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P1-CCC-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P1-CCC-PRC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P1-PSA1 | PURGE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P1-TMC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P2-ITCC-ERC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P2-ITCC-ERC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P2-ITCC-PRC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|--|----|-----------|------------|
| 20240918 | 800-C-00065 | B-PLC-P2-PSA2 | PRESSURE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | |
| 20240918 | 800-C-00065 | B-PLC-P3-TTCC | INTEGRATED TURBINE COMPRESSOR CONTROL | (1M)DAILY CHECK SYSTEM | PM | 18/9/2024 | Compressor |
| 20240918 | 890-C-00014 | B-PM-3901A | LPG FEED PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 18/9/2024 | Motor |
| 20240918 | 890-C-00011 | B-PM-3901A | WASH OIL INJECTION PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 18/9/2024 | Motor |
| 20240918 | 890-C-00003 | B-PT-1501S | P-1501A/S DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 18/9/2024 | |
| 20240918 | 890-C-00005 | B-PT-1505A | P-1505A/S DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 18/9/2024 | |
| 20240918 | 890-C-00005 | B-PT-1510A | P-1510A/S DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 18/9/2024 | |
| 20240918 | 890-C-00005 | B-PT-1515B | P-1515A/S DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 18/9/2024 | |
| 20240918 | 832-C-00001 | B-STANDARD-GAS | GROUPING TAG FOR STANDARD GAS | (1M)CHECK STANDARD GAS STATUS | PM | 18/9/2024 | |
| 20240918 | 813-C-00008 | B-W-3100-PS5 | DMDS INJECTION PUMP TO FURNACE SPARE | (1Y)LUBRICATION | PM | 18/9/2024 | |
| 20240918 | 813-S-00017 | B-XFMR-EHT-001 | POWER TRANSFORMER 6.6KV / 2072V | (3M)CONDUCTION CHECK | PM | 18/9/2024 | |
| 20240917 | 811-C-00094 | B-AT-340610 | ACETYLENE REACTOR EFFLUENT | (1M) SET & CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 8102-C-00011 | B-AT-38210S | ISO14000,PH METER TX FOR V-3821-P-1 OUTL. | (1M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00664 | B-AT-402101 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00665 | B-AT-402105 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00666 | B-AT-402201 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00668 | B-AT-420101A | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00669 | B-AT-420101B | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00029 | B-AT-430105 | Prod Gas of F-4301 and F-4302 CEMs | (1M)SET & CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00671 | B-AT-430401 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00032 | B-AT-48010A | FE-4801-02 Downstream TOC | (1M)SET & CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 812-C-00033 | B-AT-485201 | Q-4852 TOC | (1M)SET & CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 890-S-00043 | B-BC-2EE-110-1 | BATTERY CHARGER 110VDC 6.36 KVA(DUTY) | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00043 | B-BC-2EE-110-2 | BATTERY CHARGER 110VDC 6.36 KVA(STAND BY) | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00045 | B-BC-2EE-24-1 | BATTERY CHARGER 24VDC 2.5 KVA(DUTY) | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00046 | B-BC-2EE-24-2 | BATTERY CHARGER 24VDC 2.5 KVA(STAND BY) | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00048 | B-BC-2M1-1 | 110 VDC BATTERY CHARGER PANEL | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00049 | B-BC-2M1-2 | 110 VDC BATTERY CHARGER PANEL | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00050 | B-BC-3A4-1 | BATTERY CHARGER NO. 1 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00051 | B-BC-3A4-2 | BATTERY CHARGER NO. 2 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00007 | B-BC1-2E5 | BATTERY CHARGER AT NEW MAIN SUB.-1 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00049 | B-BC1-2E5-2 | BATTERY CHARGER AT NEW MAIN SUB.-2 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00041 | B-BC1-3A4 | BATTERY CHARGER PANEL NO.1 FOR SUB NO.5 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00043 | B-BC2-2E5 | BATTERY CHARGER AT NEW PRG. SUB.-1 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00042 | B-BC2-2E5-2 | BATTERY CHARGER AT NEW PRG. SUB.-2 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 890-S-00047 | B-BC2-KW1A | BATTERY CHARGER PANEL NO.2 FOR SUB NO.5 | (1Y)CONDUCTION CHECK | PM | 17/9/2024 | |
| 20240917 | 812-C-00011 | B-CP-TRU-01 | CATHODIC PROTECTION RECTIFIER NO.1 | (1M)VISUAL INSPECTION & RECORD | PM | 17/9/2024 | |
| 20240917 | 890-C-00150 | B-CP-TRU-PLANT2 | GROUP FOR CP TRU PLANT2 | (1M)VISUAL INSPECTION | PM | 17/9/2024 | |
| 20240917 | 890-C-00039 | B-LOCAL-3M2 | GROUPING FOR PH LOCAL ANALYZER 3 M P1472 | (3M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 838-S-00005 | B-MOTOR-EP-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION | PM | 17/9/2024 | Motor |
| 20240917 | 842B-C-00014 | B-NR-600-P-1A | C2R CONDENSER COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/9/2024 | |
| 20240917 | 842B-C-00012 | B-NR-600-P-2A | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/9/2024 | |
| 20240917 | 842B-C-00031 | B-NR-600-P-2S | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/9/2024 | |
| 20240917 | 8059-C-00003 | B-1127A | CHEMICAL SEWER SUMP PUMP | (3M) CONDITION CHECK (OSL 18-0221-031) | PM | 17/9/2024 | Pump |
| 20240917 | 810-C-00042 | B-RGC-BW-HOUSE1 | GROUPING TAG FOR RGC BW HOUSE 1 | (2M)SET&CALIBRATE | PM | 17/9/2024 | |
| 20240917 | 819A-C-00058 | B-CRA-01A | CR-01 NO.2 PRESSURE INSPECTION | (1M) NO.2 PRESSURE INSPECTION | PM | 17/9/2024 | Compressor |
| 20240917 | 842B-C-00014 | B-R-600-P-1A | C2R COMPRESSOR CONDENSATE PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/9/2024 | Compressor |
| 20240917 | 842B-C-00012 | B-R-600-P-2A | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/9/2024 | Compressor |
| 20240917 | 842B-C-00031 | B-R-600-P-2S | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/9/2024 | Compressor |
| 20240917 | 819A-C-00058 | B-R/R-401A | TAIL GAS EXPANDER & COMPRESSOR | (1M) NO.2 PRESSURE INSPECTION | PM | 17/9/2024 | Compressor |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|---------|
| 20240915 | 048-C-00022 | B-INTERCOM-CP2-BV | INTERCOM Grouping Tag BV | (3M)INTERCOM FUNCTION TEST | PM | 15/9/2024 | |
| 20240915 | 048-C-00018 | B-MCC-2C2-1 | MCC FOR P-1602A | RCM(3M) Visual Inspection | PM | 15/9/2024 | |
| 20240915 | 048-C-00040 | B-MCC-344-1 | MCC FOR P-1602S | RCM(3M) Visual Inspection | PM | 15/9/2024 | |
| 20240915 | 0096-C-00021 | B-MCC-EO-002 | GROUPING TAG FOR MCC. | (3M)INSPECT CABLE/TIGHTNESS NUTS/SCREWS | PM | 15/9/2024 | |
| 20240915 | B1-C-00159 | B-MOVEC-01 | NOVEC CONTROL PANEL - NEW C8 | (1M) Novec1230 System Visual Inspection | PM | 15/9/2024 | |
| 20240915 | 007-C-00001 | B-OIL-MIST-PLANT2 | Grouping Tag for Oil Mist Systems PI-4/2 | (6M)INSPECTION & CALIBRATION | PM | 15/9/2024 | |
| 20240915 | 0063-C-00046 | B-P-1602A | FIRE WATER JOCKEY PUMP | (1M)Visual Inspect Conclusion | PM | 15/9/2024 | Pump |
| 20240915 | 0063-C-00047 | B-P-1602S | FIRE WATER JOCKEY PUMP | (1M)Visual Inspect Conclusion | PM | 15/9/2024 | Pump |
| 20240915 | 023A-C-00012 | B-PSV-19003A | FUEL GAS RP PTT TO G-1350 | (3)SET & CALIBRATE (PSV102) | PM | 15/9/2024 | PSV |
| 20240915 | 023A-C-00013 | B-PSV-19003B | FUEL GAS RP PTT TO G-1350 | (3)SET & CALIBRATE (PSV102) | PM | 15/9/2024 | PSV |
| 20240915 | 0413-C-00001 | B-PSV-390011 | FUEL GAS HEADER | (3)SET & CALIBRATE(PSV 060) | PM | 15/9/2024 | PSV |
| 20240915 | 0413-C-00010 | B-PSV-390012 | FUEL GAS HEADER | (3)SET & CALIBRATE(PSV 060) | PM | 15/9/2024 | PSV |
| 20240915 | 023B-C-00014 | B-PSV-9350A | M-935 TO HOT FLARE | (3)SET & CALIBRATE(PSV 405) | PM | 15/9/2024 | PSV |
| 20240915 | 023B-C-00022 | B-PSV-9350S | SAFETY VALVE OF M-937 | (3)SET & CALIBRATE(PSV 405) | PM | 15/9/2024 | PSV |
| 20240915 | 023B-C-00033 | B-PSV-9370A | M-937 OUTLET TO HOT FLARE | (3)INSPECTION & OVERHAUL | PM | 15/9/2024 | PSV |
| 20240915 | 023B-C-00034 | B-PSV-9370S | M-937 OUTLET TO HOT FLARE | (3)INSPECTION & OVERHAUL | PM | 15/9/2024 | PSV |
| 20240915 | 019A-C-00068 | B-R-300-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 15/9/2024 | |
| 20240915 | 0122-C-00007 | B-V-3100-PSA | DMDS INJECTION PUMP TO FURNACE F-3105 | (1Y)LUBRICATION | PM | 15/9/2024 | |
| 20240915 | 012-C-00716 | B-VALVE-CNR | VALVE COOLING WATER RETURN OLE 2-3 | (1M)INSPECT GEAR OF BTF VALVE CWR T-404S | IM | 15/9/2024 | |
| 20240914 | 0035-C-00006 | B-AE-22301 | DEMI WATER TO PROCESS | (3M) CONDITION CHECK (OSL 2021-125) | IM | 14/9/2024 | |
| 20240914 | 010K-C-00024 | B-AT-10103 | ISO14000 CEMS SOX/NOX/CO F-1010 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/9/2024 | |
| 20240914 | 010L-C-00072 | B-AT-10203 | ISO14000 CEMS SOX/NOX/CO F-1020 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/9/2024 | |
| 20240914 | 00P1-C-00028 | B-AT-10303/1-3 | GROUPING TAGS CEMS AT-1103/1203/1303 | (1M)SET & CALIBRATION | PM | 14/9/2024 | |
| 20240914 | 00P1-C-00028 | B-AT-10303/4-6 | GROUPING TAGS CEMS AT-1403/1503/1603 | (1M)SET & CALIBRATION | PM | 14/9/2024 | |
| 20240914 | 00P1-C-00028 | B-AT-10303/7-9 | GROUPING TAGS CEMS AT-1703/1803/1903 | (1M)SET&CALIBRATION | PM | 14/9/2024 | |
| 20240914 | 03A-C-00013 | B-AT-2411A | ISO14000 CEMS SOX,NOX,CO ANALYZER S-2401 | (1M)SET & CALIBRATE CEMS(8-2401) | PM | 14/9/2024 | |
| 20240914 | 03A-C-00001 | B-AT-4000 | PSA UNIT INLET | (2M)SET & CALIBRATE | PM | 14/9/2024 | |
| 20240914 | 03A-S-00013 | B-P-2401 | STEAM GENERATOR | (1M)CLEANING B-2401 | PM | 14/9/2024 | |
| 20240914 | 090-C-00137 | B-CO2-SUB1-2 | CO2 FIRE SYSTEM CONTROL PANEL(SWGR) SUB1 | (1M)INSPECTION | PM | 14/9/2024 | |
| 20240914 | 090-C-00137 | B-CO2-SUB1-2 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M)INSPECTION | PM | 14/9/2024 | |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)INSPECT, RCV,CLEAN IMPLUSE(GROUP P) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)CHECK&INSPECT(GROUP,S)(OUT-SOURCE) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)SET&CALIBRATE(GROUP,Q)(OUT-SOURCE) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)INSPECTION GROUP H | IM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)INSPECTION TLV&DV VALVE (GROUP,U) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)FURNACE SHUTDOWN INSPECTION GROUP,C | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00023 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)Inspect Cook Valve 24 bags (GROUP,L) | IM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)AE-310106 PRESS SAMPLING (GROUP,T) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00001 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)SET & CALIBRATE (GROUP,Q) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00028 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)CLEAN&INSPECTION FEED FLOW(GROUP,J) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00008 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)SET&CALIBRATE(GROUP,12)(OUT-SOURCE) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00008 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)SET&CALIBRATE(GROUP,12)(OUT-SOURCE) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00024 | B-F-3101 | ETHYLENE FURNACE # 1 | (1Y)FUNCTION TEST(GROUP,F) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00024 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)SIF PROOF TEST&INSPECTION(GROUP,SIF) | IM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00024 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)SIF PROOF TEST&INSPECTION(GROUP,SIF) | IM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00025 | B-F-3101 | ETHYLENE FURNACE # 1 | (2Y)SET&CALIBRATE (GROUP,SCR) | PM | 14/9/2024 | Furnace |
| 20240914 | 090-C-00016 | B-G-2401-P-1A | AMMONIA INJECTION PUMP | (1Y)CLEAN & FLUSHING | PM | 14/9/2024 | |
| 20240914 | 090-C-00017 | B-G-2401-P-2A | AMMONIA INJECTION PUMP | (1Y)CLEAN & FLUSHING | PM | 14/9/2024 | |
| 20240914 | 090-C-00031 | B-HV-31011 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (6M)LUBRICAT AND INSPECT 23 VALVE GroupE | PM | 14/9/2024 | |
| 20240914 | 090-C-00031 | B-HV-31011 | MOTOR OPERATED DECKING VALVE OF F-3101 | (6M)LUBRICAT AND INSPECT 23 VALVE GroupE | PM | 14/9/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|-----------|------------|
| 20240914 | 0096-C-00030 | B-M-19004 | GROUPING TAG FOR NP PROPYLE LENE TO IRPC | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | PM | 14/9/2024 | |
| 20240914 | 061-C-00080 | B-P-1137S | CI FEED PUMP | (1Y) CHANGE LUBE OIL | PM | 14/9/2024 | Pump |
| 20240914 | 047D-C-00033 | B-P-141E1 | RAW MIXED C4 PRODUCT PUMP | (3Y) CLEAN MEAL SEAL COOLER | PM | 14/9/2024 | Pump |
| 20240914 | 000-C-00067 | B-PIPE1-SC1 | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-126) | IM | 14/9/2024 | |
| 20240914 | 029-C-00050 | B-PSV-5301S | M-5305 TO COLD FLARE | (3Y)SET & CALIBRATE (PSV 1X2) | PM | 14/9/2024 | PSV |
| 20240914 | 03A-C-00012 | B-R-2401 | FD. FAN | (1M)CHECK LUBRICATING OIL | PM | 14/9/2024 | |
| 20240914 | 090-C-00062 | B-R-3101 | ETHYLENE FURNACE ID FAN#1 | (1Y)FD Fan Lubricate,Inspector(Group,M) | PM | 14/9/2024 | |
| 20240914 | 090-C-00062 | B-RM-3101 | ETHYLENE FURNACE ID FAN#1 MOTOR | (1Y)FD Fan Motor Inspection (Group,M) | PM | 14/9/2024 | |
| 20240914 | 09A-C-00018 | B-SECUR-TASK22 | FOR PM : INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/9/2024 | |
| 20240914 | 09A-C-00018 | B-SECUR-TASK34 | FOR PM : INSPECTION CHEMICAL PROTECTIVE | (1M)INSPECTION | PM | 14/9/2024 | |
| 20240914 | 090-C-00019 | B-SHGL-650-RD | Grouping Tag for 650 SHGL SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 14/9/2024 | |
| 20240914 | 0122-C-00004 | B-V-3100-P2 | CHMS INJECTION PUMP TO FURNACE F-3102 | (1Y)LUBRICATION | PM | 14/9/2024 | |
| 20240914 | 0122-C-00006 | B-V-3100-P4 | CHMS INJECTION PUMP TO FURNACE F-3102 | (1Y)LUBRICATION | PM | 14/9/2024 | |
| 20240913 | 0413-C-00016 | B-AT-310105 | CO2 ANALYZER TRANSMITTER FOR F-3103/1302 | (1M)SET & CALIBRATION | PM | 13/9/2024 | |
| 20240913 | 00P2-C-00028 | B-AT-312001/1-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) ISO4001 SET&CALIBRATION | PM | 13/9/2024 | |
| 20240913 | 0061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 13/9/2024 | |
| 20240913 | 0061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 13/9/2024 | |
| 20240913 | 0061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 13/9/2024 | |
| 20240913 | 050-S-00001 | B-G-1350S | COMBUSTOR STACK | (5M)INSPECTION & CLEANING | PM | 13/9/2024 | |
| 20240913 | 012-C-00058 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 13/9/2024 | |
| 20240913 | 050-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 13/9/2024 | |
| 20240913 | 050-C-00005 | B-GS-34A | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 13/9/2024 | |
| 20240913 | 020Y-C-00002 | B-M-19190 | Grouping Tag for Raff from GC3 to KAC | (4M)SET & CALIBRATE | PM | 13/9/2024 | |
| 20240913 | 020Y-C-00002 | B-M-19190 | Grouping Tag for Raff from GC3 to KAC | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | PM | 13/9/2024 | |
| 20240913 | 00P5-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLES#5 | (1M)CLEANING & INSPECTION. | PM | 13/9/2024 | Motor |
| 20240913 | 03B-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 13/9/2024 | Motor |
| 20240913 | 016-S-00004 | B-MP-220C | QUENCH WATER CIRCULATION PUMP MOTOR | (1Y)CHANGE LUBE OIL MOTOR | PM | 13/9/2024 | Motor |
| 20240913 | 016-S-00003 | B-MP-220S | QUENCH WATER CIRCULATION PUMP MOTOR | (1Y)LUBRICATION | PM | 13/9/2024 | Motor |
| 20240913 | 0061-C-00019 | B-P-1137S | CI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1137 | PM | 13/9/2024 | Pump |
| 20240913 | 0061-C-00019 | B-P-1137S | CI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1137 | PM | 13/9/2024 | Pump |
| 20240913 | 0061-C-00018 | B-P-1136A | DGP EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 13/9/2024 | Pump |
| 20240913 | 0061-C-00018 | B-P-1136S | DGP EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 13/9/2024 | Pump |
| 20240913 | 0063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (W)TEST RUN | PM | 13/9/2024 | Pump |
| 20240913 | 0063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (W)TEST RUN | PM | 13/9/2024 | Pump |
| 20240913 | 0063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (W)TEST RUN | PM | 13/9/2024 | Pump |
| 20240913 | 0063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (W)TEST RUN | PM | 13/9/2024 | Pump |
| 20240913 | 0063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (W)TEST RUN | PM | 13/9/2024 | Pump |
| 20240913 | 016-S-00002 | B-P-220S | QUENCH WATER CIRCULATION PUMP | (1Y)CLEAN & LUBRICATE | PM | 13/9/2024 | Pump |
| 20240913 | 016-S-00004 | B-P-220S | QUENCH WATER CIRCULATION PUMP | (1Y)CLEAN & LUBRICATE | PM | 13/9/2024 | Pump |
| 20240913 | 016-S-00003 | B-P-220S | QUENCH WATER CIRCULATION PUMP | (1Y)CLEAN & LUBRICATE | PM | 13/9/2024 | Pump |
| 20240913 | 016-S-00005 | B-P-3201S | QUENCH WATER PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 13/9/2024 | PSV |
| 20240913 | 04-C-00007 | B-PSV-9045A | MP-LP STM L&DOWN STM | (3Y)SET & CALIBRATE(PSV BX10) | PM | 13/9/2024 | PSV |
| 20240913 | 015A-C-00062 | B-R-300MP | CRACKED GAS COMPRESSOR HP CASING | (1M)INSPECT WRAPPED DRAIN FLANGE | PM | 13/9/2024 | Compressor |
| 20240913 | 017-S-00001 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (2M) RE GREASE DAMPER BEARING | PM | 13/9/2024 | |
| 20240913 | 09A-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/9/2024 | |
| 20240913 | 03B-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/9/2024 | |
| 20240913 | 012-C-00356 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/9/2024 | |
| 20240913 | 012-C-00357 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/9/2024 | |
| 20240913 | 012-C-00357 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/9/2024 | |
| 20240912 | 00P5-S-00004 | B-CAP-N5 | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 12/9/2024 | |

| | | | | | | | |
|----------|---------------|-------------------|--|---|----|-----------|-------|
| 20240912 | 09A-C-00052 | B-CRIT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2W)Visual & Condition Inspection | PM | 12/9/2024 | |
| 20240912 | 09A-C-00052 | B-GC-2M1 | GROUPING FOR PM GC 2 Month group | (2M)SET&CALIBRATE | PM | 12/9/2024 | |
| 20240912 | 0061-C-00028 | B-PIPE1-SC1 | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-046) | PM | 12/9/2024 | |
| 20240912 | 048-C-00018 | B-P-3301-PT-1A | CG-1350 FUEL TURBINE | (1Y)OVERSPEED TRIP TEST | PM | 12/9/2024 | |
| 20240912 | 030A-S-00002 | B-R-575A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (1M)INSPECTION & CLEAN | PM | 12/9/2024 | |
| 20240912 | 020-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NOI (NUNGATE) | (1D)INSPECTION | PM | 12/9/2024 | |
| 20240912 | 020-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYVARI) | (1D)INSPECTION | PM | 12/9/2024 | |
| 20240912 | 020-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (1D)INSPECTION | PM | 12/9/2024 | |
| 20240912 | 020-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 12/9/2024 | |
| 20240912 | 09A-C-00024 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2W)INSPECTION | PM | 12/9/2024 | |
| 20240912 | 09A-C-00012 | B-SECUR-TASK20 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/9/2024 | |
| 20240912 | 09A-C-00012 | B-SECUR-TASK45 | FOR PM: INSPECTION CHECK MOBILE GENE | (1M)INSPECTION | PM | 12/9/2024 | |
| 20240912 | 0075-C-00005 | B-T-376B | HP DEPRESSURIZER CONDENSER | (3M) CONDITION CHECK (OSL 2020-045) | PM | 12/9/2024 | |
| 20240911 | 0021-C-00004 | B-AT-3600C | CG DEHYDRATORS BEDS | (1M)MOISTURE ANALYZER AMETEX | PM | 11/9/2024 | |
| 20240911 | 047A2-C-00010 | B-FT-1902S | ETHYLENE (EAST BL) | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 11/9/2024 | |
| 20240911 | 047B-C-00008 | B-FT-1902S | LP PROPYLENE (EAST BL) | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 11/9/2024 | |
| 20240911 | 047B-C-00008 | B-FT-1902T | LP PROPYLENE (NORTH BL) | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 11/9/2024 | |
| 20240911 | 03-C-00015 | B-M-19014 | GROUPING TAG FOR RR CUC HP STM TO OLEFIN | (3M)SET & CALIBRATION. | PM | 11/9/2024 | |
| 20240911 | 03B-C-00121 | B-MH-041-P-1A | EXPENDER OIL PUMP MOTOR | (3M)VISUAL INSPECTION AND RECORD | PM | 11/9/2024 | |
| 20240911 | 042B-C-00015 | B-MR-600-P-1A | C2R CONDENSER COND. PUMP MOTOR | RCM-(3M)GREASE | PM | 11/9/2024 | |
| 20240911 | 042B-C-00015 | B-MR-600-P-2A | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(3M)GREASE | PM | 11/9/2024 | |
| 20240911 | 042B-C-00015 | B-MR-600-P-2S | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(3M)GREASE | PM | 11/9/2024 | |
| 20240911 | 016-C-00018 | B-AT-220A | QUENCH WATER CIRCULATION PUMP | (1Y)OVERSPEED TRIP TEST | PM | 12/9/2024 | Pump |
| 20240911 | 015-C-00001 | B-PT-220A | QUENCH WATER CIRCULATION PUMP TURBINE | (1Y)OVER SPEED TRIP TEST | PM | 12/9/2024 | |
| 20240911 | 047A-S-00005 | B-R-3105 | ETHYLENE PURNACE IO FAN#6 | (2M) RE GREASE DAMPER BEARING | PM | 11/9/2024 | |
| 20240911 | 032A-C-00081 | B-SE-0303 | INSTRUMENT CALIBRATION | (1Y)INSTRUMENT CALIBRATION(OUT-SOURCE) | PM | 11/9/2024 | |
| 20240911 | 034B-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/9/2024 | |
| 20240911 | 012-C-00026 | B-AT-002202 | BIUTADIENE IR | (2M)SET & CALIBRATE | PM | 10/9/2024 | |
| 20240911 | 012-C-00070 | B-AT-430303 | BIUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 10/9/2024 | |
| 20240911 | 012-C-00030 | B-AT-430601 | BIUTENE-1 IR | (2M)SET & CALIBRATE | PM | 10/9/2024 | |
| 20240911 | 013-S-00013 | B-BU-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240911 | 013-S-00014 | B-BU-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240911 | 013-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240911 | 013-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00052 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00053 | B-BU-BC-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00056 | B-BU-BC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00054 | B-BU-BC1-110 | BATTERY UNIT FOR 110VDC SUB.2 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00055 | B-BU-BC2-110 | BATTERY UNIT FOR 110VDC SUB.PROCESS | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00057 | B-BU-DC | BATTERY UNIT FOR 110VDC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00058 | B-BU-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00062 | B-BU-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00060 | B-BU-UPS-1-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0950-S-00061 | B-BU-UPS-2-1 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/9/2024 | |
| 20240910 | 0077-C-00001 | B-G-3100 | ELEVATOR | (1M)INSPECTION AND FUNCTION TEST | PM | 10/9/2024 | |
| 20240910 | 00WS-S-00002 | B-HYDRAULIC-01 | HYDRAULIC STATIC PRESS 30 T | (1M)LUBRICATION & INSPECTION | PM | 10/9/2024 | |
| 20240910 | 0005-C-00027 | B-MOTOR-EO-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 10/9/2024 | Motor |
| 20240910 | 0635-S-00019 | B-MP-1602A | FIREWATER JOCKEY PUMP MOTOR | RCM(3M) GREASE DEKCHECK OIL LEVEL MOTOR | PM | 10/9/2024 | Motor |
| 20240910 | 0635-S-00019 | B-MP-1602S | FIREWATER JOCKEY PUMP MOTOR | RCM(3M) GREASE DEKCHECK OIL LEVEL MOTOR | PM | 10/9/2024 | Motor |

| | | | | | | | |
|----------|--------------|-------------------|--|---------------------------------------|----|----------|---------|
| 20240903 | 890-C-00002 | B-EF-11 | MASTER FIRE ALARM PANEL AT NEW COB CONTR | (1)MCO2 SYSTEM CHECK | PM | 3/9/2024 | |
| 20240903 | 890-C-00002 | B-EF-12 | LOCAL FIRE ALARM PANEL AT NEW COB CONTR | (1)MCO2 SYSTEM CHECK | PM | 3/9/2024 | |
| 20240903 | 890-C-00002 | B-EF-13 | LOCAL FIRE ALARM PANEL AT SUBPROCESS | (1)MCO2 SYSTEM CHECK | PM | 3/9/2024 | |
| 20240903 | 810K-C-00051 | B-F-1010 | USC PYROLYSIS FURNACE | (3M) CONDITION CHECK (OSL 2022-193) | IM | 3/9/2024 | Furnace |
| 20240903 | 810K-C-00044 | B-F-1010 | USC PYROLYSIS FURNACE | (3M) CONDITION CHECK (OSL 2021-110) | IM | 3/9/2024 | Furnace |
| 20240903 | 810E-C-00043 | B-F-120 | USC FURNACES | (3M) CONDITION CHECK (OSL 2021-062) | IM | 3/9/2024 | Furnace |
| 20240903 | 810G-C-00045 | B-F-170 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-192) | IM | 3/9/2024 | Furnace |
| 20240903 | 8NA-C-00051 | B-GC-1M | GROUPING FOR PM GC 1 Month | (1)MSET & CALIBRATION | PM | 3/9/2024 | |
| 20240903 | 848-C-00020 | B-IRP-BV | IRP GROUPING FOR BV | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 80M-C-00064 | B-M-19020 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1)MXPDATE N2, CO2, REL DENSITY | PM | 3/9/2024 | |
| 20240903 | 8016-C-00003 | B-M-310 | GC 1ST STAGE SUCTION DRUM | (3M) CONDITION CHECK (OSL 2022-190) | IM | 3/9/2024 | |
| 20240903 | 800-C-00009 | B-MCC-SUB1 | MCC FOR PLUG-IN MCC-B | (2M)Thermoscan & Inspection | IM | 3/9/2024 | |
| 20240903 | 800-C-00028 | B-MCC-TANK | MCC FOR PLUG-IN MCC-B | (2M)Thermoscan & Inspection | IM | 3/9/2024 | |
| 20240903 | 8002-C-00002 | B-MCC-WASTE | MCC FOR PLUG-IN MCC-B | (2M)Thermoscan & Inspection | IM | 3/9/2024 | |
| 20240903 | 890-C-00177 | B-MOTOR-B1-1237BC | MOTOR GROUPING FOR B1-BC | (1)MCLEANING & INSPECTION | PM | 3/9/2024 | Motor |
| 20240903 | 890-C-00180 | B-MOTOR-B1-7A | MOTOR GROUPING FOR B1-BC | (1)MCLEANING AND INSPECTION | PM | 3/9/2024 | Motor |
| 20240903 | 890-C-00174 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BEU-A | (1)MCLEANING & INSPECTION | PM | 3/9/2024 | Motor |
| 20240903 | 890-C-00175 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BEU-A | (1)MCLEANING AND INSPECTION | PM | 3/9/2024 | Motor |
| 20240903 | 890-C-00183 | B-MOTOR-BE-0BC | MOTOR GROUPING FOR BEU-A | (1)MCLEANING AND INSPECTION | PM | 3/9/2024 | Motor |
| 20240903 | 890-C-00186 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-BC | (1)MCLEANING AND INSPECTION | PM | 3/9/2024 | Motor |
| 20240903 | 800-C-00096 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-195) | IM | 3/9/2024 | |
| 20240903 | 800-C-00094 | B-PIPE1-BD | LINE BLOWDOWN HYDROCARBON WATER OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-187) | IM | 3/9/2024 | |
| 20240903 | 890-C-00150 | B-SD-BC-1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.1 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 890-C-00150 | B-SD-BC-2 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.2 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 890-C-00151 | B-SD-BC-2M1 | DISTRIBUTION PANEL OF BC 110VDC SUB.7 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 890-C-00150 | B-SD-BC-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 890-C-00150 | B-SD-BC-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.5 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 848-C-00015 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 800-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.6 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 800-C-00011 | B-SD-F2 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 800-C-00011 | B-SD-F3 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 800-C-00011 | B-SD-UPS-2M1 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 890-C-00251 | B-SD-UPS-2M2 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1)MINSPECTION | PM | 3/9/2024 | |
| 20240903 | 860-C-00040 | B-SPEAKER-ES-001 | GROUPING TAG FOR SPEAKER/HORNS FOLLOW TA | (3M)INTERCOM FUNCTION TEST | PM | 3/9/2024 | |
| 20240903 | 810C-C-00040 | B-T-131 | TLX QUENCH EXCHANGER | (3M) CONDITION CHECK (OSL 2022-191) | IM | 3/9/2024 | |
| 20240903 | 812-C-00059 | B-UPS-2FE-BV | GROUPING FOR UPS 220 KVA | (1)MINSPECT & ADJUST | PM | 3/9/2024 | |
| 20240903 | 800-C-00095 | B-VALVE1-P | VALVE PROCESS OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-194) | IM | 3/9/2024 | |
| 20240903 | 800-C-00064 | B-VALVE1-SC1 | VALVE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-109) | IM | 3/9/2024 | |
| 20240903 | 800-C-00039 | B-ARC-3015 | ARC VALVE | (4M)ARC OVERHAUL | PM | 2/9/2024 | |
| 20240903 | 800-C-00035 | B-DV-15503 | DELUGE VALVE FOR M-576A | (6M)LUBRICATION & INSPECTION | PM | 2/9/2024 | |
| 20240903 | 800-C-00035 | B-DV-15504 | DELUGE VALVE FOR M-576A, 1-576A | (6M)LUBRICATION & INSPECTION | PM | 2/9/2024 | |
| 20240903 | 848A-C-00058 | B-DV-1570 | DELUGE VALVE FOR QUENCH/FURNACE | (6M)LUBRICATION & INSPECTION | PM | 2/9/2024 | |
| 20240902 | 8057-C-00017 | B-G-1478A | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/9/2024 | |
| 20240902 | 8057-C-00017 | B-G-1478B | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/9/2024 | |
| 20240902 | 8063-C-00043 | B-HY-1671 | HYDRANT NEW FIRE TRAINING AREA | (6M)LUBRICATION | PM | 2/9/2024 | |
| 20240902 | 8063-C-00043 | B-HY-1672 | HYDRANT NEW FIRE TRAINING AREA | (6M)LUBRICATION | PM | 2/9/2024 | |
| 20240902 | 8096-C-00014 | B-M-19018 | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2)UPDATE N2, CO2, REL DENSITY | PM | 2/9/2024 | |
| 20240902 | 812-C-00050 | B-MOTOR-GRP | GROUPING TAG FOR MOTOR GRP | (1)MINSPECTION | PM | 2/9/2024 | Motor |
| 20240902 | 8064-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-PI suction screen cleaning | PM | 2/9/2024 | Pump |
| 20240902 | 8064-C-00006 | B-PIPE1-DS | LINE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-049) | IM | 2/9/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|----------|---------|
| 20240902 | 811-S-00021 | B-PSV-1009 | DISCHARGE LINE OF V-100-P-1D | (3)INSPECTION & OVERHAUL PSV | PM | 2/9/2024 | PSV |
| 20240902 | 811-S-00015 | B-PSV-1014 | PUMP V-100-P-1X DISCH | (3)INSPECTION & OVERHAUL PSV | PM | 2/9/2024 | PSV |
| 20240902 | 811-S-00024 | B-PSV-1015 | PUMP V-100-P-1X DISCH | (3)INSPECTION & OVERHAUL PSV | PM | 2/9/2024 | PSV |
| 20240902 | 815A-WK-0001 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 2/9/2024 | |
| 20240902 | 8H4-C-00030 | B-R-3101 | ETHYLENE FURNACE ID FAN#1 | (1M) Visual Inspection | PM | 2/9/2024 | |
| 20240902 | 8H4-C-00027 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | (1M) Visual Inspection | PM | 2/9/2024 | |
| 20240902 | 8H5-C-00026 | B-R-3103 | ETHYLENE FURNACE ID FAN#3 | (1M) Visual Inspection | PM | 2/9/2024 | |
| 20240902 | 8H6-C-00028 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (1M) Visual Inspection | PM | 2/9/2024 | |
| 20240902 | 8H7-C-00028 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (1M) Visual Inspection | PM | 2/9/2024 | |
| 20240902 | 8H8-C-00056 | B-R-3106 | ETHYLENE FURNACE ID FAN#6 | (1M) Visual Inspection | PM | 2/9/2024 | |
| 20240902 | 802B-C-00001 | B-R-650-PT-1S | CG SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 2/9/2024 | |
| 20240902 | 8438-WK-0001 | B-R-650-PT-1S | CGR COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 2/9/2024 | |
| 20240902 | 8NA-C-00021 | B-SECUR-TASK03 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 2/9/2024 | |
| 20240902 | 813-C-00042 | B-SU7-FA-FAC-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/9/2024 | |
| 20240902 | 813-C-00043 | B-SU7-FA-FAC-001 | Firefighting Control Panel at CO2 cylind | (1M)VISUAL INSPECTION | PM | 2/9/2024 | |
| 20240902 | 811-S-00021 | B-V-100-P-1D | DMDS INJECTION PUMP TO F-140 | (1Y)INSPECT LUBRICATE & SET | PM | 2/9/2024 | |
| 20240902 | 811-S-00015 | B-V-100-P-1X | DMDS INJECTION PUMPS | (1Y)INSPECT LUBRICATE & SET | PM | 2/9/2024 | |
| 20240902 | 811-S-00024 | B-V-100-P-1L | DMDS INJECTION PUMPS | (1Y)INSPECT LUBRICATE & SET | PM | 2/9/2024 | |
| 20240902 | 811-C-00013 | B-V-100-P-1X | COMMON SPARE FOR P-1A-13 | (1Y)INSPECT LUBRICATE & SET | PM | 2/9/2024 | |
| 20240901 | 8013-C-00013 | B-A-210 | QUENCH OIL TOWER | (3M) CONDITION CHECK (OSL 2022-201) | IM | 1/9/2024 | |
| 20240901 | 8H4S-C-00001 | B-AT-33100 | MOISTURE ANALYZER TRANSMITTER FOR M-3310 | (2M)SET & CALIBRATE | PM | 1/9/2024 | |
| 20240901 | 8H4S-C-00001 | B-AT-33100 | MOISTURE ANALYZER TRANSMITTER FOR M-3310 | (2M)SET & CALIBRATE | PM | 1/9/2024 | |
| 20240901 | 8077-C-00015 | B-AT-33100 | MOISTURE ANALYZER TRANSMITTER FOR M-3301 | (2M)SET & CALIBRATE | PM | 1/9/2024 | |
| 20240901 | 8H11-S-00003 | B-AUTCP4/2 | Grouping Tag for Caustic Pump 1-4/2 | (1M)CLEAN | PM | 1/9/2024 | |
| 20240901 | 800-C-00075 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1M) Function and Record test | PM | 1/9/2024 | |
| 20240901 | 800-C-00075 | B-CCTV-F5 | GROUPING TAG FOR FIRE STATION | (1M) Function and Record test | PM | 1/9/2024 | |
| 20240901 | 800-C-00077 | B-CCTV-GATE | GROUPING TAG FOR GATE | (1M) Function and Record test | PM | 1/9/2024 | |
| 20240901 | 800-C-00078 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/9/2024 | |
| 20240901 | 800-C-00079 | B-CCTV-WH | GROUPING TAG FOR WARE HOUSE | (1M) Function and Record test | PM | 1/9/2024 | |
| 20240901 | 800-C-00080 | B-CCTV-WKS | GROUPING TAG FOR WORK SHOP | (1M) Function and Record test | PM | 1/9/2024 | |
| 20240901 | 800-C-00089 | B-DOS-P1 | DCS HONEYWELL TDC3000EXPERION | (2M)REMOVE HISTORY FILE | PM | 1/9/2024 | |
| 20240901 | 800-C-00089 | B-DOS-P1-ORP | DCS HONEYWELL C300 EXPERION RS11.1 | (2M)REMOVE HISTORY FILE | PM | 1/9/2024 | |
| 20240901 | 812-C-00674 | B-DOS-P3 | DCS HONEYWELL C300 EXPERION | (4M)SWITCH OVER SERVER | PM | 1/9/2024 | |
| 20240901 | 848-C-00018 | B-DV-BV | DELUGE VALVE GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/9/2024 | |
| 20240901 | 848-C-00016 | B-EF-BV | EMERGENCY EXIT GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/9/2024 | |
| 20240901 | 848-C-00017 | B-EL-BV | EMERGENCY LIGHT GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/9/2024 | |
| 20240901 | 838-C-00051 | B-EPSRD | GROUPING FOR MCC, 6 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT RELAY | PM | 1/9/2024 | |
| 20240901 | 8007-C-00003 | B-F-3105 | ETHYLENE FURNACE 5 | (3M) CONDITION CHECK (OSL 2022-205) | IM | 1/9/2024 | Furnace |
| 20240901 | 812-C-00046 | B-FEED-ABE | FEEDER GROUPING FOR BV | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 8063-C-00030 | B-FT-16001 | DISCHARGE MIN-FLOW OF FIRE WATER PUMPS | RCM-(1Y)CALIBRATION | PM | 1/9/2024 | |
| 20240901 | 848-C-00019 | B-FMC-BV | FIRE ALARM GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/9/2024 | |
| 20240901 | 8033-C-00008 | B-FT-7059 | MP STEAM TO F-700 | (3M) CONDITION CHECK (OSL 2022-203) | IM | 1/9/2024 | |
| 20240901 | 850-C-00016 | B-G-1350S-P-1 | K.O. DRUM PUMP | RCM-(1M)SHORT TERM PRESERVATION | PM | 1/9/2024 | |
| 20240901 | 8057-C-00016 | B-G-1477A | INSTRUMENT AIR DRYER | (3M)Cleaning Auto Drain of Air Dryer | PM | 1/9/2024 | |
| 20240901 | 8057-C-00016 | B-G-1477S | INSTRUMENT AIR DRYER | (3M)Cleaning Auto Drain of Air Dryer | PM | 1/9/2024 | |
| 20240901 | 8012IMC01 | B-INSF-CM-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/9/2024 | |
| 20240901 | 8012IMC01 | B-INSF-CM-OLE2-1-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/9/2024 | |
| 20240901 | 8012IMC01 | B-INSF-CM-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/9/2024 | |
| 20240901 | 8012IMC01 | B-INSF-CM-OLE2-2-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/9/2024 | |
| 20240901 | 8012IMC01 | B-INSF-CM-OLE2-3-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/9/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|-----------|-----------------------------|
| 20240901 | 8012IMC01 | B-INSF-CM-OLE2-3-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/9/2024 | |
| 20240901 | 8NA-C-00037 | B-LCCAL-2M | GROUPING FOR PM LOCAL ANALYZER 2 Month | (2M)SET&CALIBRATE | PM | 1/9/2024 | |
| 20240901 | 812-C-00197 | B-MCC-B1-1ABE | MCC GROUPING FOR B1-A | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 812-C-00198 | B-MCC-B1-2ABE | MCC GROUPING FOR B1-BC | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 812-C-00199 | B-MCC-BE-1AB | MCC GROUPING FOR BEU-A | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 812-C-00199 | B-MCC-BE-2AB | MCC GROUPING FOR BEU-BC | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 812-C-00151 | B-MCC-OSBL-2AB | MCC GROUPING FOR B1-BC | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 80PS-S-00001 | B-MOTOR-EO-008 | GROUPING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | PM | 1/9/2024 | Motor |
| 20240901 | 838-S-00001 | B-MOTOR-EP-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING | PM | 1/9/2024 | Motor |
| 20240901 | 800-C-00097 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-195) | IM | 1/9/2024 | |
| 20240901 | 811-C-00066 | B-P-3403A | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE TO Bearing Mechanical Seal | PM | 1/9/2024 | Pump |
| 20240901 | 811-C-00067 | B-P-3403S | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE TO Bearing Mechanical Seal | PM | 1/9/2024 | Pump |
| 20240901 | 8027-C-00009 | B-PSU-0 | LP DEPROP. CONDENSATE PUMP | (3M) CONDITION CHECK (OSL 2022-195) | IM | 1/9/2024 | Pump |
| 20240901 | 800-C-00101 | B-PIPE1-SCM | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-204) | IM | 1/9/2024 | |
| 20240901 | 800-C-00066 | B-PIPE1-SCM | LINE STEAM CONDENSATE - MP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-121) | IM | 1/9/2024 | |
| 20240901 | 800-C-00098 | B-PIPE1-LSL | LINE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-197) | IM | 1/9/2024 | |
| 20240901 | 800-C-00100 | B-PIPE1-LSL | LINE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-202) | IM | 1/9/2024 | |
| 20240901 | 8518-C-00006 | B-PSV-9301A | G-930-T931 TO M-930 | (7Y)SET & CALIBRATE (PSV 1/2X23) | PM | 1/9/2024 | PSV |
| 20240901 | 8133-C-00013 | B-PV-384102A | HPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/9/2024 | |
| 20240901 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/9/2024 | |
| 20240901 | 8145-C-00002 | B-Q-3101 | AG. AMMONIA STORAGE TANK | (4M)SET&CALIBRATE | PM | 1/9/2024 | |
| 20240901 | 8036-S-00001 | B-R-3600-PT-1A | C2 CORRA LD PUMP TURBINE | (1Y)OVERSEERED TRIP TEST | PM | 1/9/2024 | |
| 20240901 | 8054-C-00016 | B-S-575A | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/9/2024 | Compressor |
| 20240901 | 8054-C-00007 | B-S-575B | Demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/9/2024 | Compressor Flare (Flare) |
| 20240901 | 8NA-C-00013 | B-SECUR-TASK48 | FOR PM : INSPECTION FM-20 SYSTEMS | (1M) Visual inspection FM-20 system (RA | PM | 1/9/2024 | |
| 20240901 | 800-C-00068 | B-SECUR-TASK51 | Smoke / Heat detector system : Control a | (1M)Visual Inspection | PM | 1/9/2024 | |
| 20240901 | 8112-C-00352 | B-SWGR-HV-BV | SWGR GROUPING FOR BV | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 8112-C-00353 | B-SWGR-LV-BV | SWGR GROUPING FOR BV | (3M)INSPECT & CONDITION CHECK | PM | 1/9/2024 | |
| 20240901 | 800-C-00099 | B-TRAP-020 | GROUPING STEAM TRAP AREA 020 | (3M) CONDITION CHECK (OSL 2022-198) | IM | 1/9/2024 | |
| 20240831 | 8H24-C-00003 | B-V-3002-P15 | NEUTRALIZING AMINE INJECTION PUMP | (1Y)LUBRICATION | PM | 31/8/2024 | |
| 20240831 | 8112-C-00782 | B-1036-C02-001 | CO2 Portable for OLE2/3 | (1M)CO2 Portable Visual Inspection | IM | 30/8/2024 | |
| 20240831 | 8112-C-00788 | B-1036-DC-001 | Dry Chemical for OLE2/3 | (1M)Dry Chemical Visual Inspection | IM | 30/8/2024 | |
| 20240831 | 8112-C-00798 | B-1036-FA-001 | All Manual Fire Alarm for OLE2/3 | (1M)Manual Fire Visual Inspection | IM | 30/8/2024 | |
| 20240831 | 8112-C-00801 | B-1036-PA-001 | PA for Back Room (OLE2/3) | (1M)H2000 System Visual Inspection | IM | 30/8/2024 | |
| 20240831 | 8061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 30/8/2024 | |
| 20240831 | 8061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 30/8/2024 | |
| 20240831 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 30/8/2024 | |
| 20240831 | 8112-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 30/8/2024 | |
| 20240831 | 8112-C-00055 | B-GS-2E-F2 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 30/8/2024 | |
| 20240831 | 8112-C-00055 | B-GS-2E-F3 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 30/8/2024 | |
| 20240831 | 8112-C-00075 | B-GS-3A-34 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 30/8/2024 | |
| 20240831 | 8061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 30/8/2024 | Pump |
| 20240831 | 8061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 30/8/2024 | Pump |
| 20240831 | 8061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 30/8/2024 | Pump |
| 20240831 | 8061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 30/8/2024 | Pump |
| 20240831 | 8063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 30/8/2024 | Pump |
| 20240831 | 8063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 30/8/2024 | Pump |
| 20240831 | 8063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 30/8/2024 | Pump |
| 20240831 | 8063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 30/8/2024 | Pump |
| 20240831 | 8063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 30/8/2024 | Pump |
| 20240829 | 800-C-00130 | B-1034-CO2-001 | CO2 Portable for OLE OLE2/1 | (1M) CO2 Portable Visual Inspection | IM | 29/8/2024 | |

| | | | | | | | |
|----------|---------------|----------------------|--|--|----|-----------|------------|
| 20240828 | B5-C-00004 | B-AT-15202 | LP STEAM TO T-1520 | (2)(Y)CHECK & ADJUST (OUT-SOURCE) | PM | 28/8/2024 | |
| 20240828 | B47C-C-00005 | B-AT-15303 | OP SPEC TO T-1530 | (2)(Y)CHECK & ADJUST (OUT-SOURCE) | PM | 28/8/2024 | |
| 20240828 | B47AL-C-00019 | B-AT-15304 | T-1531 OUTLET | (2)(Y)CHECK & ADJUST (OUT-SOURCE) | PM | 28/8/2024 | |
| 20240828 | B47AL-C-00019 | B-AT-15305 | CRITICAL LOOP, R-1530A/5 TO T-310 | (2)(Y)CHECK & ADJUST (OUT-SOURCE) | PM | 28/8/2024 | |
| 20240828 | B5-C-00004 | B-AT-15306 | LP STEAM TO T-1533 | (2)(Y)CHECK & ADJUST (OUT-SOURCE) | PM | 28/8/2024 | |
| 20240828 | B52B-C-00046 | B-MR-1201F | COOLING TOWER FAN MOTOR | (1)(Y)CLEANING CONTACT | PM | 28/8/2024 | |
| 20240828 | B90-C-00017 | B-PM-3841B | COOLING TOWER PUMP MOTOR | (6M)Change Oil Lubrication&Inspection | PM | 28/8/2024 | |
| 20240828 | B95A-C-00004 | B-PSV-15212 | R-1520A/5 TO T-1530 | (2)(Y)INSPECTION & OVERHAUL | PM | 28/8/2024 | PSV |
| 20240828 | B52B-C-00046 | B-R-1201F | COOLING TOWER FAN | (1)(Y)REPLACE LUBE OIL | PM | 28/8/2024 | |
| 20240828 | B13-C-00001 | B-R-310 | ETHYLENE FURNACE TO FAN#1 | (2M) RE GREASE DAMPER BEARING | PM | 28/8/2024 | |
| 20240828 | B090-C-00024 | B-R-3600-PM-15 | C2 COMP LRD PUMP MOTOR | RCM (3M) Motor Inspection | IM | 28/8/2024 | Motor |
| 20240828 | B90-C-00117 | B-SWGR-EQ-D0 | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 28/8/2024 | |
| 20240828 | B097-C-00066 | B-V-3895 | PRESSURE PROPORTIONING TANK | (6M)TEST FOAM SYSTEM | PM | 28/8/2024 | |
| 20240828 | B097-C-00066 | B-V-3895 | FORM TANK FOR FURNACE AREA | (6M)TEST FOAM SYSTEM | PM | 28/8/2024 | |
| 20240828 | B098-C-00035 | B-V-3897 | FORM TANK FOR TANK AREA | (6M)TEST FOAM SYSTEM | PM | 28/8/2024 | |
| 20240828 | BW5-S-00007 | B-W502-02-01 | AIR COMPRESSOR SULLIAR | (11M)INSPECTION | PM | 28/8/2024 | Compressor |
| 20240828 | BW5-C-00001 | B-W503-06-01 | LAMINATING MACHINE | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-C-00001 | B-W505-01-01 | UNIVERSAL MILLING MACHINE | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-S-00014 | B-W505-03-01 | CENTER LATHE MACHINE AXAX | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-S-00023 | B-W505-03-02 | CENTER LATHE MACHINE PINACHO | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-C-00001 | B-W505-05-01 | COLUMN TYPE DRILLING MACHINE | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-S-00025 | B-W505-07-01 | HYDRAULIC HACKSAW | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-S-00026 | B-W505-21-01 | SHAPING MACHINE | (11M)INSPECTION & LUBRICATE | PM | 28/8/2024 | |
| 20240828 | BW5-S-00005 | B-W508-03-01 | HIGH PRESSURE WATER JET MACHINE | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-S-00003 | B-W514-401-01 | FORK LIFT | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240828 | BW5-S-00009 | B-W514-401-01 | TRUCK (LOADER/HIMO) | (11M)INSPECTION | PM | 28/8/2024 | |
| 20240827 | B-AE-13200 | B-AE-13200 | CG EFFLUENT FROM R-1320 | (3M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240827 | B81-S-00009 | B-AE-1400 | CG EFFLUENT FROM F-140 | (3M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240827 | B11-C-00091 | B-AT-300601 | ARGON ANALYZER - FILTER LPG FEED ARGON | (2M) SET & CALIBRATE | PM | 27/8/2024 | |
| 20240827 | B11-C-00092 | B-AT-300602 | MERCURY ANALYZER - FILTER LPG FEED ARGON | (2M) SET & CALIBRATE | PM | 27/8/2024 | |
| 20240827 | B098-C-00027 | B-AT-382102 | SI02 ANALYZER TRANSMITTER FOR V-3821 OUT | (1M)SET & CALIBRATE | PM | 27/8/2024 | |
| 20240827 | B63-C-00108 | B-DV-1528 | VALVE FAIL TO OPEN DELUGE VALVEN | (6M) Spray Test | PM | 27/8/2024 | |
| 20240827 | B63-C-00108 | B-DV-1529 | LABORATORY BLDG SPRINKLER PANEL DELUGE V | (6M) Spray Test | PM | 27/8/2024 | |
| 20240827 | B63-C-00108 | B-DV-1530 | C4 HYDROGEN EFFLUENT PUMP DELUGE VALVE | (6M) Spray Test | PM | 27/8/2024 | |
| 20240827 | B63-C-00108 | B-DV-1531 | C4 HYDROGEN PUMP DELUGE VALVE | (6M) Spray Test | PM | 27/8/2024 | |
| 20240827 | B90-C-00019 | B-INTERCOM-PM-GPI-PI | GROUPING TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 27/8/2024 | |
| 20240827 | B90-C-00056 | B-LP-3E1-1 | LP AT NEW CCB CONTROL ROOM | (4M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240827 | B90-C-00056 | B-LP-3E1-2 | LP AT NEW MAIN SUB | (4M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240827 | B90-C-00056 | B-LP-3E1-3 | LP AT NEW PROCESS SUB | (4M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240827 | B90-C-00056 | B-LP-4FI-1 | LP AT NEW CCB CONTROL ROOM | (4M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240827 | B90-C-00056 | B-LP-4FI-2 | LP AT NEW MAIN SUB | (4M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240827 | B90-C-00056 | B-LP-4FI-3 | LP AT NEW PROCESS SUB | (4M)INSPECTION & CLEANING | PM | 27/8/2024 | |
| 20240826 | B74-C-00006 | B-AT-9400 | HC LP SUS COND. DISC. P-902A/5 | (1M)SET & CALIBRATE | PM | 26/8/2024 | |
| 20240826 | B63-C-00088 | B-DV-NPA-01 | GROUPING TAG FOR DELUGE VALVE NPA | (1M)CHECKVISUAL HEAT DETECTORS AND | PM | 26/8/2024 | |
| 20240826 | B52B-C-00046 | B-MR-1201F | COOLING TOWER FAN MOTOR | (1M)INSPECTION | PM | 26/8/2024 | |
| 20240826 | B52B-C-00046 | B-P-1205F | Sludge stream backwash sump pump S | (1M)INSPECTION | PM | 26/8/2024 | Pump |
| 20240826 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pit suction screen cleaning | PM | 26/8/2024 | Pump |
| 20240826 | B52A-C-00033 | B-R-1201B | COOLING TOWER FAN | (3M) CONDITION CHECK (OIL 232-256) | IM | 26/8/2024 | |
| 20240826 | B52B-C-00046 | B-R-1201G | COOLING TOWER FAN | (1Y)REPLACE LUBE OIL | PM | 26/8/2024 | |
| 20240826 | B57-B-00003 | B-R-1475Z | INSTRUMENT AIR COMPRESSOR | (2000Hrs)Inspection&Cleaning Air Inlet | PM | 26/8/2024 | Compressor |

| | | | | | | | |
|----------|--------------|--------------------|--|---|----|-----------|------------|
| 20240826 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | | | | |
| 20240825 | B-AT-371012 | B-AT-371012 | U-37105 CG ARGON ABSORBER | (1W)INSPECTION | PM | 26/8/2024 | |
| 20240825 | B63-C-00067 | B-DV-1615 | CRACKED GAS COMPRESSOR DELUGE VALVE | (6M) Spray Test | PM | 26/8/2024 | Compressor |
| 20240825 | B63-C-00067 | B-DV-1616 | CRACKED GAS COMPRESSOR DELUGE VALVE | (6M) Spray Test | PM | 26/8/2024 | Compressor |
| 20240825 | B46A-C-00013 | B-DV-1662 | DELUGEVALVE FOR Q-1522 | (3M)FUNCTION TEST | PM | 26/8/2024 | |
| 20240825 | B39C-C-00049 | B-EOLSRG | GROUPING FOR 6.6 KV SWGR 11 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 26/8/2024 | |
| 20240825 | B091-C-00002 | B-EPCD1MA | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B091-C-00001 | B-EPCD1MB | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B092-C-00002 | B-EPCD1MC | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B093-C-00001 | B-EPCD1MD | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B093-C-00003 | B-EPCD1ME | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B093-C-00002 | B-EPCD1MF | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B094-C-00001 | B-EPCD1MG | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B094-S-00001 | B-EPCD1MH | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 26/8/2024 | |
| 20240825 | B34C-C-00004 | B-GAS-DETECTOR-NPA | GROUPING TAG FOR GAS-DETECTOR-NPA | (4M)GAS DETECTOR PLANT2 (OUT-SOURCE) | PM | 26/8/2024 | |
| 20240825 | B12-C-00747 | B-M-486002 | Grouping Tag for Raff from GC3 to KAC | (4M)PROVE LQI TURBINE METER(OUT-SOURCE) | PM | 26/8/2024 | |
| 20240825 | B12-C-00746 | B-M-486002 | Grouping Tag for Raff from GC3 to KAC | (4M)SET & CALIBRATE | PM | 26/8/2024 | |
| 20240825 | B09S-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 26/8/2024 | Motor |
| 20240825 | B09S-C-00004 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 26/8/2024 | Motor |
| 20240825 | B52B-C-00046 | B-MR-1201A | COOLING TOWER FAN MOTOR | (1Y)CLEANING CONTACT | PM | 26/8/2024 | |
| 20240825 | B52B-C-00049 | B-MR-1201C | COOLING TOWER FAN MOTOR | (1Y)CLEANING CONTACT | PM | 26/8/2024 | |
| 20240825 | B019-C-00023 | B-P-3806A | LP BFW Pumps | (1Y) CLEANING & LUBRICATE | PM | 26/8/2024 | Pump |
| 20240825 | B52B-C-00025 | B-P-3906S | LP BFW Pumps | (1Y) CLEANING & LUBRICATE | PM | 26/8/2024 | Pump |
| 20240825 | B52B-C-00038 | B-R-1201A | COOLING TOWER FAN | (1Y)REPLACE LUBE OIL | PM | 26/8/2024 | |
| 20240825 | B52B-C-00039 | B-R-1201C | COOLING TOWER FAN | (1Y)REPLACE LUBE OIL | PM | 26/8/2024 | |
| 20240825 | B093-C-00006 | B-SVDRRE | GROUPING FOR BLOCK VALVE | (1Y)INSPECTION / LUBRICATION | PM | 26/8/2024 | |
| 20240824 | B11-C-00112 | B-AT-371003 | PROPYLENE PRODUCT TO PROPYLENE PRODUCT H | (2M) SET & CALIBRATE | PM | 24/8/2024 | |
| 20240824 | B11-C-00111 | B-AT-371011 | C3 GUARD ABSORBER L-3710A | (2M) SET & CALIBRATE | PM | 24/8/2024 | |
| 20240824 | B11-C-00106 | B-AT-371038 | C3 ANALYZER - PROPYLENE PROD. FROM A-371 | (2M) SET & CALIBRATE | PM | 24/8/2024 | |
| 20240824 | B19A-C-00008 | B-AT-5320 | PROPYLENE STRIPPER | (2M)SET & CALIBRATE | PM | 24/8/2024 | |
| 20240824 | B12-C-00403 | B-CP-TP-BV | CP TP GROUPING FOR BV | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 24/8/2024 | |
| 20240824 | B63-C-00109 | B-DV-1613 | PROPYLENE RECT EX DELUGE VALVE | (6M) Spray Test | PM | 24/8/2024 | |
| 20240824 | B63-C-00109 | B-DV-1614 | ETHYLENE DEPROPANIZER PUMPS DELUGE VALVE | (6M) Spray Test | PM | 24/8/2024 | |
| 20240824 | B90-C-00055 | B-ELP-1 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/8/2024 | |
| 20240824 | B90-C-00055 | B-ELP-2 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/8/2024 | |
| 20240824 | B90-C-00055 | B-ELP-3 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/8/2024 | |
| 20240824 | B90-C-00055 | B-ELP-4 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/8/2024 | |
| 20240824 | B32-C-00001 | B-P-700 | REGENERATION HEATER | (1Y)INSPECTION FURNACE | PM | 24/8/2024 | Furnace |
| 20240824 | B62-C-00020 | B-G-1141-P-2 | CLOTH WASH WATER PUMP | (1Y)LUBRICATION | PM | 24/8/2024 | |
| 20240824 | B52B-S-00028 | B-G-1220-P-2A | CW ANTISCALANT/DISPENSER PUMP | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 24/8/2024 | |
| 20240824 | B90-C-00059 | B-MCC-EO-211 | Grouping Tag for MCC Sub#4 (MCC-211) | (3M) Inspect & Adjust | PM | 24/8/2024 | |
| 20240824 | B52B-C-00036 | B-MR-1201B | COOLING TOWER FAN MOTOR | (1Y)CLEANING CONTACT | PM | 24/8/2024 | |
| 20240824 | B52B-C-00037 | B-MR-1201D | COOLING TOWER FAN MOTOR | (1Y)CLEANING CONTACT | PM | 24/8/2024 | |
| 20240824 | B18-C-00016 | B-PSV-2200B | A-120 TOP HOT FLARE | (4Y)OVERHAUL & INSPECTION (8X10) | PM | 24/8/2024 | PSV |
| 20240824 | B52B-C-00036 | B-R-1201B | COOLING TOWER FAN | (1Y)REPLACE LUBE OIL | PM | 24/8/2024 | |
| 20240824 | B52B-C-00037 | B-R-1201D | COOLING TOWER FAN | (1Y)REPLACE LUBE OIL | PM | 24/8/2024 | |
| 20240824 | B52B-C-00116 | B-R-1201F | COOLING TOWER FAN | (3M) INSPECT & ADJUST | PM | 24/8/2024 | |
| 20240824 | B12-C-00044 | B-V-4805-15 | INSTRUMENT AIR DRYERS | (1Y)INSPECTION EXHAUST MUFFLER | PM | 24/8/2024 | |
| 20240823 | B61-C-00090 | B-AT-11391 | IS01-K000, G-1127-R-1 TO Q-1139 | (2M)OCD ANALYZER INSPECT (OUT-SOURCE) | PM | 23/8/2024 | |
| 20240823 | B12-C-00031 | B-AT-470701 | LP CONDENSATE TOC | (2M)SET & CALIBRATE | PM | 23/8/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|------------|
| 20240823 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 23/8/2024 | |
| 20240823 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 23/8/2024 | |
| 20240823 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 23/8/2024 | |
| 20240823 | B12-S-00058 | B-G-4803-P-5A | H2SO4 INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 23/8/2024 | |
| 20240823 | B12-C-00056 | B-GS-2F-21 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 23/8/2024 | |
| 20240823 | B90-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 23/8/2024 | |
| 20240823 | B90-C-00005 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 23/8/2024 | |
| 20240823 | B52B-C-00040 | B-MR-1201E | COOLING TOWER FAN MOTOR | (1Y)CLEANING CONTACT | PM | 23/8/2024 | |
| 20240823 | B52B-C-00042 | B-MR-1201H | COOLING TOWER FAN MOTOR | (1Y)CLEANING CONTACT | PM | 23/8/2024 | |
| 20240823 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 23/8/2024 | Pump |
| 20240823 | B061-C-00019 | B-P-1132B | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 23/8/2024 | Pump |
| 20240823 | B061-C-00018 | B-P-1136A | DGP EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 23/8/2024 | Pump |
| 20240823 | B061-C-00018 | B-P-1136B | DGP EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 23/8/2024 | Pump |
| 20240823 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 23/8/2024 | Pump |
| 20240823 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 23/8/2024 | Pump |
| 20240823 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 23/8/2024 | Pump |
| 20240823 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 23/8/2024 | Pump |
| 20240823 | B063-WK-0002 | B-P-1601E | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 23/8/2024 | Pump |
| 20240823 | B090-C-00036 | B-PM-3805S | C2 COMP VACUUM COND PUMP MOTOR | RCM (6M) INSPECTION AND TEST | PM | 23/8/2024 | Motor |
| 20240823 | B52B-C-00040 | B-R-1201E | COOLING TOWER FAN | (1Y)REPLACE LUBE OIL | PM | 23/8/2024 | |
| 20240823 | B52B-C-00042 | B-R-1201H | COOLING TOWER FAN | (1Y)REPLACE LUBE OIL | PM | 23/8/2024 | |
| 20240823 | B090-C-00034 | B-R-3600-GM-7 | OIL PURIFIER MOTOR | RCM (6M) INSPECTION AND TEST | PM | 23/8/2024 | |
| 20240822 | B091-C-00025 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET&CALIBRATE | PM | 22/8/2024 | |
| 20240822 | B23A-C-00014 | B-AT-19001 | FUEL GAS CUSTODY INLET | (7M)CALIBRATION | PM | 22/8/2024 | |
| 20240822 | B013-C-00062 | B-AT-311003 | MOISTURE ANALYZER TRANSMITTER FOR H-3301 | (1M)MOISTURE ANALYZER AMETEX | PM | 22/8/2024 | |
| 20240822 | B60-C-00068 | B-G-112-P-1S | HIGH PRESSURE FEED PUMPS | (1M)CLEAN STRAINER&INSPECTION | PM | 22/8/2024 | |
| 20240822 | B050-S-00001 | B-G-1305S-R-1 | ASSIST AIR BLOWER | RCM (1M) VISUAL INSPECTION | IM | 22/8/2024 | |
| 20240822 | B12-C-00754 | B-MP-4307A | SURFACE CONDENSER PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/8/2024 | Motor |
| 20240822 | B12-C-00755 | B-MP-4307S | SURFACE CONDENSER PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/8/2024 | Motor |
| 20240822 | B61-S-00024 | B-P-1130S | CPI SLUDGE TRANSFER PUMP | (1Y)CLEAN & LUBRICATION | PM | 22/8/2024 | Pump |
| 20240822 | B47-S-00004 | B-A-1506A | TRANSFER P-Q-1551 TO Q-1501 PUMP | (1Y) LUBRICATION | PM | 22/8/2024 | Pump |
| 20240822 | B090-C-00036 | B-PM-3805S | BPM PUMP MOTOR | (3M) Disconnection & Check Lube Oil | PM | 22/8/2024 | Motor |
| 20240822 | B12-C-00749 | B-R-4031-MP-1A | OIL PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/8/2024 | Motor |
| 20240822 | B12-C-00749 | B-R-4031-MP-1S | OIL PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/8/2024 | Motor |
| 20240822 | B12-C-00750 | B-R-4031-MP-1A | VENTILATION FAN MOTOR | RCM (3M) Motor Inspection | IM | 22/8/2024 | |
| 20240822 | B12-C-00751 | B-R-4031-MR-1S | VENTILATION FAN MOTOR | RCM (3M) Motor Inspection | IM | 22/8/2024 | |
| 20240822 | B12-C-00753 | B-R-4301-MG-5 | OIL PURIFIER | RCM (3M) Motor Inspection | IM | 22/8/2024 | |
| 20240822 | B12-C-00752 | B-R-4301-MP-1S | STAND BY OIL PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/8/2024 | Motor |
| 20240822 | B18A-C-00033 | B-RT-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) INSPECT TURBINE EXPANSION JOINT | PM | 22/8/2024 | Compressor |
| 20240822 | B20-C-00003 | B-SECUR-TASK030A | FOR PM: CHECK A FOAM TRUCK NO.1 (MUNGNATE) | (1D)INSPECTION | PM | 22/8/2024 | |
| 20240822 | B20-C-00003 | B-SECUR-TASK030C | FOR PM: CHECK A WATER TRUCK(SAYVARDI) | (1D)INSPECTION | PM | 22/8/2024 | |
| 20240822 | B20-C-00003 | B-SECUR-TASK030E | FOR PM: CHECK AMBLANCE(JITRUSGA) | (1D)INSPECTION | PM | 22/8/2024 | |
| 20240822 | B20-C-00003 | B-SECUR-TASK030F | FOR PM: CHECK WATER CAR (NATVAY) | (1D)INSPECTION | PM | 22/8/2024 | |
| 20240821 | B108-C-00026 | B-F-120 | USC RURNANCES | (L1)SYNOPSIS (GROUP.R1) | PM | 21/8/2024 | Furnace |
| 20240821 | B108-C-00007 | B-F-120 | USC RURNANCES | (L1)SYNOPSIS (GROUP.R2) | PM | 21/8/2024 | Furnace |
| 20240821 | B108-C-00048 | B-F-120 | USC RURNANCES | (L1)SYNLS Impulse Lineup VerifyGroup.P1 | IM | 21/8/2024 | Furnace |
| 20240821 | B108-C-00003 | B-F-120 | USC RURNANCES | (L1)SYSET & CALIBRATE (GROUP.Q) | PM | 21/8/2024 | Furnace |
| 20240821 | B108-C-00003 | B-F-120 | USC RURNANCES | (L1)SYNINSPECT CONTROL VALVE(GROUP.Q) | PM | 21/8/2024 | Furnace |
| 20240821 | B108-C-00003 | B-F-120 | USC RURNANCES | (L1)SYSET&CALIBRATE(GROUP.Q)(OUT-SOURCE) | PM | 21/8/2024 | Furnace |
| 20240821 | B108-C-00003 | B-F-120 | USC RURNANCES | (L1)SYCHECK&INSPECT(GROUP.Q)(OUT-SOURCE) | IM | 21/8/2024 | Furnace |

| | | | | | | | |
|----------|--------------|-------------------|--|---|----|-----------|--------------|
| 20240819 | 800-C-00065 | B-DOS-P1-ORP | DOS HONEYWELL C300 EXPIRIION R511.1 | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-DOS-P2 | DOS YOKOGAWA CP451-S0/AP30D/REVISION RS | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-DOS-P3 | DOS HONEYWELL C300 EXPIRIION | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-CR3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | IM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-ORP | ESD/MP310TH4.9.OSOE4.2.GENH2.10.0 | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P1-TANKARM | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P2-COLDJUT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P2-RUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P2-RUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P2-RURS/HOT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P2-RURS | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 850-C-00002 | B-FT-13002A | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00009 | B-FT-13001B | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00005 | B-FT-13001A | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00004 | B-FV-13002A | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00007 | B-FV-13002B | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00006 | B-FV-13003A | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00009 | B-FV-13003B | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00003 | B-FV-13004A | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 850-C-00007 | B-FV-16005A | ISO14000,MP STEAM TO FLARE | (2Y) Inspection & Calibration | PM | 19/8/2024 | Water(Flare) |
| 20240819 | 860-C-00058 | B-G-112Z-P-3A | OXIDIZED SPENT CAUSTIC TRANSFER PUMP | (1Y)LUBRICATE | PM | 19/8/2024 | |
| 20240819 | 860-C-00072 | B-G-114I-V-2 | HYDROLIC PUMP | (1Y)INSPECTION | PM | 19/8/2024 | |
| 20240819 | 860-C-00001 | B-H-300-PT-1A | CG COMPRESSOR MAIN OIL PUMP TURBINE | (1M)CHECK LUBRICATE OIL | PM | 19/8/2024 | Compressor |
| 20240819 | 809P-C-00014 | B-M-1901A | GROUPING TAG FOR FUEL GAS TO TCC/COCD | (1M)UPDATE N2, CO2, REL. DENSITY | PM | 19/8/2024 | |
| 20240819 | 809P-C-00015 | B-M-19057 | GROUPING TAG FOR TAIL GAS TO ROC. M.SKID | (1M)UPDATE N2, CO2, REL. DENSITY | PM | 19/8/2024 | |
| 20240819 | 812-C-00378 | B-M-4090-06 | GROUPING TAG FOR BUTADIENE METER | (4M)PROVE LIQ.TURBINE METER(OUT-SOURCE) | PM | 19/8/2024 | |
| 20240819 | 812-C-00040 | B-M-4090-06 | GROUPING TAG FOR BUTADIENE METER | (4M)SET & CALIBRATION | PM | 19/8/2024 | |
| 20240819 | 8063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pit suction screen cleaning | PM | 19/8/2024 | Pump |
| 20240819 | 847E-C-00009 | B-PCV-1550S | ISO14000,Q-1550 TO CARBON CANISTE | (2Y) Inspection & Calibration | PM | 19/8/2024 | |
| 20240819 | 847E-C-00008 | B-PCV-1551S | ISO14000,Q-1551 TO CARBON CANISTE | (2Y) Inspection & Calibration | PM | 19/8/2024 | |
| 20240819 | 867C-F-00003 | B-PCV-9606 | ISO14000,QUENCH H2O SUMP VENT | (2Y) Inspection & Calibration | PM | 19/8/2024 | |
| 20240819 | 867C-F-00002 | B-PCV-9704 | ISO14000,CAUSTIC SUMP VENT | (2Y) Inspection & Calibration | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P1-CCS-R57S | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P1-CCS-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P1-CCS-PRC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P1-PSA1 | PRESSURE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P1-TMC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P2-ITCC-CGC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P2-ITCC-ERC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P2-ITCC-PRC | TURBOMACHINERY CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P2-PSA2 | PRESSURE SWING ADSORPTION | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 800-C-00065 | B-PLC-P3-ITCC | INTEGRATED TURBINE COMPRESSOR CONTROL | (1M)DAILY CHECK SYSTEM | PM | 19/8/2024 | |
| 20240819 | 819A-WK-0001 | B-R-300-PT-15 | CG COMP SURFACE CONDENSER CONDO TURBINE | (2W)REGREASE & INSPECTION | PM | 19/8/2024 | Compressor |

| | | | | | | | |
|----------|--------------|----------------|---|--|----|-----------|-------|
| 20240819 | 843B-WK-0001 | B-R-600-PT-15 | C2R SURFACE CONDENSER COND.TURBINE | (2W)REGREASE & INSPECTION | PM | 19/8/2024 | |
| 20240819 | 843B-WK-0001 | B-R-650-PT-15 | C3R COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 19/8/2024 | |
| 20240819 | BNA-C-00021 | B-SECUR-TASK05 | FOR FMC TEST FIRE PUMP | (1W)INSPECTION | PM | 19/8/2024 | |
| 20240819 | BNA-C-00021 | B-SECUR-TASK46 | FOR FMC INSPECTION AND CHECK MOBILE AIR | (1W)INSPECTION | PM | 19/8/2024 | |
| 20240818 | B11-C-00100 | B-AT-370501 | C3 LIQUID FROM T-3705 FEED TO L-3705 MAP | (1M) SET & CALIBRATE | PM | 18/8/2024 | |
| 20240818 | B11-C-00109 | B-AT-370502 | ANALYZER (GC) MAPD REACTOR RECYCLE | (1M) SET & CALIBRATE | PM | 18/8/2024 | |
| 20240818 | B11-C-00101 | B-AT-370503 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 18/8/2024 | |
| 20240818 | B11-C-00105 | B-AT-371202 | MASTER FIRE ALARM CONTROL PANEL AT CCS | (3M)VISUAL INSPECTION | PM | 18/8/2024 | |
| 20240818 | B009-C-00010 | B-E-F-01 | FIRE ALARM MONITORING AT FIRE STATION | (3M)VISUAL INSPECTION | PM | 18/8/2024 | |
| 20240818 | B009-C-00010 | B-E-F-03 | FIRE ALARM POWER PANEL TANK AREA | (3M)VISUAL INSPECTION | PM | 18/8/2024 | |
| 20240818 | BC10-C-00001 | B-G-3841 | COOLING TOWER SYSTEM | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/8/2024 | |
| 20240818 | BC10-C-00001 | B-G-3841-R1A | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/8/2024 | |
| 20240818 | BC10-C-00001 | B-G-3841-R1B | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/8/2024 | |
| 20240818 | BC10-C-00001 | B-G-3841-R1C | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/8/2024 | |
| 20240818 | BC10-C-00001 | B-G-3841-R1D | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/8/2024 | |
| 20240818 | B7-C-00029 | B-G-920-P-15 | SULFURIC ACID FEED PUMP | (1Y)LUBRICATION | PM | 18/8/2024 | |
| 20240818 | B7-C-00031 | B-G-920-P-25 | CAUSTIC SOLUTION FEED PUMP | (1Y)LUBRICATION | PM | 18/8/2024 | |
| 20240818 | B7-C-00036 | B-G-920-R-1A | AIR BLOWER FOR CONO POLISHING SYSTEM | (1Y)LUBRICATION | PM | 18/8/2024 | |
| 20240818 | B07P-C-00002 | B-MOTOR-EO-011 | GROUPING FOR MOTORS CONSOLE#6 | (3M)CLEANING & INSPECTION/LUBRICATION | PM | 18/8/2024 | Motor |
| 20240818 | B07P-C-00002 | B-P-1551B | LYOLYSIS GASOLINE PRODUCT PUMP | (1Y)LUBRICATION & CLEANING | PM | 18/8/2024 | Pump |
| 20240818 | B00-C-00059 | B-PIPE1-SC | LINE STEAM CONDENSATE OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-065) | IN | 18/8/2024 | |
| 20240818 | B00-C-00058 | B-PIPE1-SL | LINE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-064) | IN | 18/8/2024 | |
| 20240818 | B11S-00018 | B-PSV-1004 | DISCHARGE LINE OF V-100-P-13 | (3Y)INSPECTION & OVERHAUL PSV | PM | 18/8/2024 | PSV |
| 20240818 | B11S-00020 | B-PSV-1005 | DISCHARGE LIVE OF V-100-P-1H | (3Y)INSPECTION & OVERHAUL PSV | PM | 18/8/2024 | PSV |
| 20240818 | B11S-00019 | B-PSV-1008 | DISCHARGE LINE OF V-100-P-1E | (3Y)INSPECTION & OVERHAUL PSV | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00093 | B-PSV-1542A | PSV FOR V-1540-M-1 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00094 | B-PSV-1542S | PSV FOR V-1540-M-1 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00095 | B-PSV-1542TA | PSV FOR V-1540-M-2 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00096 | B-PSV-1542S | PSV FOR V-1540-M-2 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00099 | B-PSV-1542BA | PSV FOR V-1540-M-1 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00100 | B-PSV-1542S | PSV FOR V-1540-M-1 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00101 | B-PSV-15430A | PSV FOR V-1540-T-2 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00102 | B-PSV-15430S | PSV FOR V-1540-T-2 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00103 | B-PSV-15431A | PSV FOR OUT LET V-1540-T-3 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00104 | B-PSV-15431S | PSV FOR OUT LET V-1540-T-3 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00105 | B-PSV-15433A | PSV FOR V-1540-M-3 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00106 | B-PSV-15433S | PSV FOR V-1540-M-3 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00089 | B-PSV-15435A | ISO14000 SAFETY VALVE OF V-1540-M-4 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00090 | B-PSV-15435S | ISO14000 SAFETY VALVE OF V-1540-M-4 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00091 | B-PSV-15437A | SAFETY VALVE FOR V-1540-M-5 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B47D-C-00092 | B-PSV-15437S | SAFETY VALVE FOR V-1540-M-5 | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B23A-C-00031 | B-PSV-9362 | CRANK CASE OIL DOWNSTREAM 1, PUMP (R-936) | (3Y)INSPECTION & OVERHAUL | PM | 18/8/2024 | PSV |
| 20240818 | B32-C-00001 | B-STANDARD-GAS | GROUPING TAG FOR STANDARD GAS | (1M)CHECK STANDARD GAS STATUS | PM | 18/8/2024 | |
| 20240818 | B09P-S-00008 | B-SWGR-EO-2E1 | GROUPING TAG FOR SWGR | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 18/8/2024 | |
| 20240818 | B11S-00019 | B-V-100-P-1E | DMDS INJECTION PUMP TO F-150 | (1Y)INSPECTION LUBRICATE & SET | PM | 18/8/2024 | |
| 20240818 | B11S-00018 | B-V-100-P-1H | DMDS INJECTION PUMP TO F-150 | (1Y)INSPECTION LUBRICATE & SET | PM | 18/8/2024 | |
| 20240818 | B11S-00019 | B-V-100-P-11 | DMDS INJECTION PUMP TO F-150 | (1Y)INSPECTION LUBRICATE & SET | PM | 18/8/2024 | |
| 20240817 | B11-C-00094 | B-AT-340610 | ACETYLENE REACTOR EFFLUENT | (1M) SET & CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B11-C-00095 | B-AT-350220 | DEBUTANIZER REFLUX PUMPS P-3502A/5 DISCH | (2M) SET & CALIBRATE | PM | 17/8/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|-----------|-------|
| 20240817 | BH20-C-00011 | B-AT-382105 | ISO14000,PH METER TX FOR V-3821-P-1 OUTL | (1M)SET&CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00564 | B-AT-420101 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00565 | B-AT-420105 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00566 | B-AT-420102 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00568 | B-AT-420101A | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00569 | B-AT-420101B | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00029 | B-AT-430105 | Fuel Gas of F-4301 and F-4302 CEMs | (1M)SET & CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00621 | B-AT-430401 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00032 | B-AT-480104 | FE-4801-02 Downstream TOC | (1M)SET & CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B12-C-00033 | B-AT-485201 | Q-4852 TOC | (1M)SET & CALIBRATE | PM | 17/8/2024 | |
| 20240817 | B90-S-00043 | B-BC-2E-110-1 | BATTERY CHARGER 110VDC 6.36 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00044 | B-BC-2E-110-2 | BATTERY CHARGER 110VDC 36 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00045 | B-BC-2E-24-1 | BATTERY CHARGER 24VDC 2.5 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00046 | B-BC-2E-24-2 | BATTERY CHARGER 24VDC 2.5 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00048 | B-BC-2M1-1 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00049 | B-BC-2M1-2 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00050 | B-BC-34V-1 | BATTERY CHARGER NO. 1 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00051 | B-BC-34V-2 | BATTERY CHARGER NO. 2 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00007 | B-BC1-2ES | BATTERY CHARGER AT NEW MAIN SUB.-1 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00040 | B-BC1-2ES-2 | BATTERY CHARGER AT NEW MAIN SUB.-2 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00041 | B-BC1-34A | BATTERY CHARGER PANEL NO.1 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00025 | B-BC2-2ES | BATTERY CHARGER AT NEW PRO. SUB.-1 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00042 | B-BC2-2ES-2 | BATTERY CHARGER AT NEW PRO. SUB.-2 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-S-00047 | B-BC2-34V-1 | BATTERY CHARGER PANEL NO.2 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/8/2024 | |
| 20240817 | B90-C-00160 | B-CP-TRU-PLANT1 | GROUP TAG FOR CP TRU PLANT1 | (2M)VISUAL INSPECTION | PM | 17/8/2024 | |
| 20240817 | B90-C-00152 | B-CP-TRU-PLANT2 | GROUP TAG FOR CP TRU PLANT2 | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 17/8/2024 | |
| 20240817 | B12-C-00402 | B-CP-TRU-01 | CATHODIC PROTECTION RECTIFIER NO.1 | (1Y)FUNCTION TEST & EXERCISE TEST | PM | 17/8/2024 | |
| 20240817 | B12-C-00401 | B-CP-TRU-01 | CATHODIC PROTECTION RECTIFIER NO.1 | (1VISUAL INSPECTION & RECORD | PM | 17/8/2024 | |
| 20240817 | B90-C-00159 | B-CP-TRU-PLANT1 | GROUP TAG FOR CP TRU PLANT1 | (2M)VISUAL INSPECTION | PM | 17/8/2024 | |
| 20240817 | B90-C-00150 | B-CP-TRU-PLANT2 | GROUP FOR CP TRU PLANT2 | (1M)VISUAL INSPECTION | PM | 17/8/2024 | |
| 20240817 | B90-C-00131 | B-EE-GROUP | Group for EMERGENCY Exit | (3M)INSPECT, VERIFY & CHECK | PM | 17/8/2024 | |
| 20240817 | B12-S-00052 | B-G-4803-P-1A | CORROSION INHIBITOR INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 17/8/2024 | |
| 20240817 | B10K-C-00038 | B-HV-10105 | F-1010 EFFLUENT TO A-210 | (3M)Collect Torque Profile & Record | IM | 17/8/2024 | |
| 20240817 | B10K-C-00039 | B-HV-10107 | GEORCK EFFLUENT TO F-1010 | (3M)Collect Torque Profile & Record | IM | 17/8/2024 | |
| 20240817 | B-HV-10104 | B-HV-10104 | GROUP TAG FOR INSPECTION OF HVRD | (2Y)Inspect, Hand sign & Restore pipe | PM | 17/8/2024 | |
| 20240817 | B90-C-00128 | B-NHC-40-2E2 | Grouping Tag for HVC-2E2 | (3M)INSPECT HARD COPY TIGHTNESS NUTS AND SCR | PM | 17/8/2024 | |
| 20240817 | B38-S-00005 | B-MOTOR-EP-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1Y)CLEANING AND INSPECTION. | PM | 17/8/2024 | Motor |
| 20240817 | B47A2-C-0004 | B-MR-1530S | ETHYLENE PRODUCT PUMP MOTOR | (1Y)LUBRICATION | PM | 17/8/2024 | Motor |
| 20240817 | B47B-C-00014 | B-MR-600-P-1A | CZR CONDENSER COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/8/2024 | |
| 20240817 | B47B-C-00012 | B-MR-600-P-2A | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/8/2024 | |
| 20240817 | B47B-C-00031 | B-MR-600-P-2S | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/8/2024 | |
| 20240817 | B61-C-00123 | B-P-1165A | SLUDGE STORAGE AREA SUMP PUMP | (3M)REGREASE | PM | 17/8/2024 | Pump |
| 20240817 | B61-C-00124 | B-P-1165S | SLUDGE STORAGE AREA SUMP PUMP | (3M)REGREASE | PM | 17/8/2024 | Pump |
| 20240817 | BH19-C-00012 | B-P-3801S-T-1 | BRW PUMP LO COOLER | (2Y) INSPECTION & CLEAN | PM | 17/8/2024 | Pump |
| 20240817 | B12-C-00045 | B-PGC-BV-HOUSE1 | GROUPING TAG FOR PGC BV HOUSE 1 | (4M) Inspect and Calibrate | PM | 17/8/2024 | |
| 20240817 | B12-C-00046 | B-PGC-BV-HOUSE2 | GROUPING TAG FOR PGC BV HOUSE 2 | (4M) Inspect and Calibrate | PM | 17/8/2024 | |
| 20240817 | B12-C-00047 | B-PGC-BV-HOUSE3 | GROUPING TAG FOR PGC BV HOUSE 3 | (4M) Inspect and Calibrate | PM | 17/8/2024 | |
| 20240817 | B12-C-00048 | B-PGC-BV-HOUSE3 | GROUPING TAG FOR PGC BV HOUSE 3 | (4M) Inspect and Calibrate | PM | 17/8/2024 | |
| 20240817 | B18A-C-00033 | B-PT-4801A | STEAM TURBINE FOR P-4801A | (1Y) OVER SPEED TRIP TEST | PM | 17/8/2024 | |
| 20240817 | B12-C-000323 | B-PT-4801A | STEAM TURBINE FOR P-4801A | (6M)CHANGE GOVERNOR OIL | PM | 17/8/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|---|----|-----------|------|
| 20240815 | B11-C-00158 | B-1035-FHH-001 | Fire Hose House for OLE2/2 | (1M) Fire Hose Box Visual Inspection | PM | 15/8/2024 | |
| 20240815 | B11-C-00151 | B-1035-FST-001 | Foam Storage Tank for R-3801 | (3M) Function Test | PM | 15/8/2024 | |
| 20240815 | B11-C-00157 | B-1035-FST-001 | Foam Storage Tank for R-3801 | (1M) Visual Inspection | PM | 15/8/2024 | |
| 20240815 | B11-C-00157 | B-1035-FV-001 | Post Indicator Valve for OLE2/2 | (1M) Post Indicator Valve Visual Insp | PM | 15/8/2024 | |
| 20240815 | B11-C-00148 | B-1035-WC-001 | Water Curtain for OLE2/2 | (1M) Water Curtain Inspection | PM | 15/8/2024 | |
| 20240815 | B00-C-00217 | B-1036-FST-M4798 | Foam Storage Tank for M-4090/M-4091 BV | (1M) VISUAL INSPECTION | IM | 15/8/2024 | |
| 20240815 | B00-C-00218 | B-1036-FST-M4798 | Foam Storage Tank for M-4090/M-4091 BV | (3M) Function Test | PM | 15/8/2024 | |
| 20240815 | B90-S-00019 | B-CAP-CS | GROUPING TAG FOR CAP-CS SUBSTATION#3 | (1Y) CONDITION CHECK | PM | 15/8/2024 | |
| 20240815 | B11-C-00154 | B-CO2-PRO-SUB | CO2 System for New Process Sub | (1M) VISUAL INSPECTION | IM | 15/8/2024 | |
| 20240815 | BNA-C-00066 | B-CRIE-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2M) Visual & Condition Inspection | PM | 15/8/2024 | |
| 20240815 | B11-C-00066 | B-TR-VALVE-SUB6 | Deluge Valve Transformer sub 6 | (1M) Deluge Valve Visual Inspection | PM | 15/8/2024 | |
| 20240815 | B20-C-00010 | B-ESP-PI-PL-1 | EMERGENCY SHUTDOWN SYSTEM | (3M) PAYMENT SERVICE AGREEMENT TRICONEK | PM | 15/8/2024 | |
| 20240815 | B529-C-00059 | B-G-120A4 | Cooling Tower A | (2M) EXTERNAL INSPECTION | IM | 15/8/2024 | |
| 20240815 | B529-C-00060 | B-G-120AB | Cooling Tower B | (2M) EXTERNAL INSPECTION | IM | 15/8/2024 | |
| 20240815 | B529-C-00061 | B-G-120AC | Cooling Tower C | (2M) EXTERNAL INSPECTION | IM | 15/8/2024 | |
| 20240815 | B529-C-00062 | B-G-120AD | Cooling Tower D | (2M) EXTERNAL INSPECTION | IM | 15/8/2024 | |
| 20240815 | B529-C-00063 | B-G-120AE | Cooling Tower E | (2M) EXTERNAL INSPECTION | IM | 15/8/2024 | |
| 20240815 | BNA-C-00053 | B-GC-2M2 | GROUPING FOR PM GC 2 Month group2 | (2M) SET&CALIBRATE | PM | 15/8/2024 | |
| 20240815 | B09-S-00009 | B-MCC-EO-2E1 | GROUPING TAG FOR MCC MCC | (3M) INSPECT & ADJUST | PM | 15/8/2024 | |
| 20240815 | B09-S-00039 | B-MCC-EO-2E2 | Grouping Tag for MCC-2E2 | (3M) INSPECT & ADJUST | PM | 15/8/2024 | |
| 20240815 | B09-S-00010 | B-MCC-EO-2E3 | GROUPING TAG FOR MCC | (3M) INSPECT & ADJUST | PM | 15/8/2024 | |
| 20240815 | B09-S-00011 | B-MCC-EO-2E4 | GROUPING TAG FOR MCC | (3M) INSPECT & ADJUST | PM | 15/8/2024 | |
| 20240815 | B09-S-00006 | B-MCC-EO-2E5 | GROUPING TAG FOR MCC | (3M) INSPECT & ADJUST | PM | 15/8/2024 | |
| 20240815 | B09-S-00002 | B-MCC-EO-2G1 | GROUPING TAG FOR MCC SUBSTATION#3 | (1Y) INSPECT & ADJUST | PM | 15/8/2024 | |
| 20240815 | B11-C-00159 | B-NOVEC-01 | NOVEC CONTROL PANEL - NEW CB | (1M) Novect1230 System Visual Inspection | PM | 15/8/2024 | |
| 20240815 | B17-S-00001 | B-DIL-HIST-PLANT2 | Grouping Tag for Oil Mist Systems PL-4/2 | (1M) Oil Mist Monthly PM | PM | 15/8/2024 | |
| 20240815 | B063-C-00046 | B-P-1602A | FIRE WATER JOCKEY PUMP | (1M) Visual Inspection Conclusion | PM | 15/8/2024 | Pump |
| 20240815 | B063-C-00047 | B-P-1602B | FIRE WATER JOCKEY PUMP | (1M) Visual Inspection Conclusion | PM | 15/8/2024 | Pump |
| 20240815 | B11-S-00017 | B-PSV-101I | DISCHARGE LINE OF V-100-P-1C | (3Y) INSPECTION & OVERHAUL PSV | PM | 15/8/2024 | PSV |
| 20240815 | B11-S-00017 | B-PSV-101I | DISCHARGE LINE OF V-100-P-1B | (3Y) INSPECTION & OVERHAUL PSV | PM | 15/8/2024 | PSV |
| 20240815 | B11-S-00022 | B-PSV-101I | DISCHARGE LINE OF V-100-P-1A | (3Y) INSPECTION & OVERHAUL PSV | PM | 15/8/2024 | PSV |
| 20240815 | B529-C-00059 | B-R-120AA | COOLING WATER FAN A | (2M) Cooling Gearbox & Fan Visual Insp | PM | 15/8/2024 | |
| 20240815 | B529-C-00060 | B-R-120AB | COOLING WATER FAN B | (2M) Cooling Gearbox & Fan Visual Insp | PM | 15/8/2024 | |
| 20240815 | B529-C-00061 | B-R-120AC | COOLING WATER FAN C | (2M) Cooling Gearbox & Fan Visual Insp | PM | 15/8/2024 | |
| 20240815 | B529-C-00062 | B-R-120AD | COOLING WATER FAN D | (2M) Cooling Gearbox & Fan Visual Insp | PM | 15/8/2024 | |
| 20240815 | B529-C-00063 | B-R-120AE | COOLING WATER FAN E | (2M) Cooling Gearbox & Fan Visual Insp | PM | 15/8/2024 | |
| 20240815 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (MUNGATE) | (1D) INSPECTION | PM | 15/8/2024 | |
| 20240815 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYVARIN) | (1D) INSPECTION | PM | 15/8/2024 | |
| 20240815 | B20-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (1D) INSPECTION | PM | 15/8/2024 | |
| 20240815 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D) INSPECTION | PM | 15/8/2024 | |
| 20240815 | BNA-C-00024 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2W) INSPECTION | PM | 15/8/2024 | |
| 20240815 | B11-S-00022 | B-V-100-P-1A | DMDS. INJECTION PUMP TO F-110 | (1Y) INSPECT LUBRICATE & SET | PM | 15/8/2024 | |
| 20240815 | B11-S-00014 | B-V-100-P-1B | DMDS. INJECTION PUMP TO F-120 | (1Y) INSPECT LUBRICATE & SET | PM | 15/8/2024 | |
| 20240815 | B11-S-00017 | B-V-100-P-1C | DMDS. INJECTION PUMP TO F-130 | (1Y) INSPECT LUBRICATE & SET | PM | 15/8/2024 | |
| 20240815 | B11-S-00013 | B-V-100-P-1F | DMDS. INJECTION PUMP TO F-160 | (1Y) INSPECT LUBRICATE & SET | PM | 15/8/2024 | |
| 20240815 | B11-S-00016 | B-V-100-P-1G | DMDS. INJECTION PUMP TO F-120 | (1Y) INSPECT LUBRICATE & SET | PM | 15/8/2024 | |
| 20240815 | B11-S-00016 | B-V-100-P-1H | DMDS. INJECTION PUMP TO F-151 | (1Y) INSPECT LUBRICATE & SET | PM | 15/8/2024 | |
| 20240815 | B11-S-00023 | B-V-100-P-1S2 | DMDS INJECTION PUMP | (1Y) INSPECT LUBRICATE & SET | PM | 15/8/2024 | |
| 20240815 | B12-C-00716 | B-VALVE-CWR | VALVE COOLING WATER RETURN OLE 2-3 | (1M) INSPECT GEAR OF RTF VALVE CWR T-4045 | IM | 15/8/2024 | |
| 20240814 | B10K-C-00022 | B-AT-10103 | ISO14000,CEMS SOX/NOX/CO F-1010 FUEL GAS | (1M) SET & CALIBRATION | PM | 14/8/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|--|----|-----------|------------|
| 20240814 | B10L-C-00024 | B-AT-10103 | ISO14000,CEMS SOX/NOX/CO F-1020 FUEL GAS | (1M) SET & CALIBRATION | PM | 14/8/2024 | |
| 20240814 | B09-C-00013 | B-AT-10011-3 | GROUPING TAGS CEMS AT-11001/1201/1303 | (1M) SET & CALIBRATION | PM | 14/8/2024 | |
| 20240814 | B09-C-00018 | B-AT-10011-4 | GROUPING TAGS CEMS AT-1403/1501/1603 | (1M) SET & CALIBRATION | PM | 14/8/2024 | |
| 20240814 | B09-C-00018 | B-AT-10011-5 | GROUPING TAGS CEMS AT-1703/1803/1903 | (1M) SET & CALIBRATION | PM | 14/8/2024 | |
| 20240814 | B3A-C-00013 | B-AT-2411A | ISO14000,CEMS SOX/NOX/CO ANALYZER S-2401 | (1M) SET & CALIBRATE CEMS(B-2401) | PM | 14/8/2024 | |
| 20240814 | B3A-S-00013 | B-B-2401 | STEAM GENERATOR | (3M) LUBRICATION B-2401 | PM | 14/8/2024 | |
| 20240814 | B90-C-00027 | B-CO2-SUBJ-1 | CO2 FIRE SYSTEM CONTROL PANEL(SWGR) SUB1 | (1M) INSPECTION | PM | 14/8/2024 | |
| 20240814 | B90-C-00227 | B-CO2-SUBJ-2 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M) INSPECTION | PM | 14/8/2024 | |
| 20240814 | B060-C-00051 | B-G-1112-P-1A | HIGH PRESSURE FEED PUMPS | (3M) CLEAN STRAINER FOR B-G-1112-P-1 | PM | 14/8/2024 | |
| 20240814 | B060-C-00051 | B-G-1112-P-1S | HIGH PRESSURE FEED PUMPS | (3M) CLEAN STRAINER FOR B-G-1112-P-1 | PM | 14/8/2024 | |
| 20240814 | B060-C-00018 | B-G-1114-P-1 | FLARE PUMPS | (3M) CLEAN STRAINER FOR B-G-1114-P-1 | PM | 14/8/2024 | |
| 20240814 | B45F-C-00011 | B-H-19076 | Flareless Grouping Tag for Causal from VNT to GC3 | (4M) SET & CALIBRATE | PM | 14/8/2024 | |
| 20240814 | B45F-C-00018 | B-P-1552 | CAUSTIC TRANSFER PUMP | (2Y) CLEAN & LUBRICATE | PM | 14/8/2024 | Pump |
| 20240814 | B73-S-00002 | B-P-396A | LP DEPROPANIZER REFLUX PUMP | (1Y) CHANGE LUBE OIL | PM | 14/8/2024 | Pump |
| 20240814 | B31-C-00040 | B-P-7105 | GHU 1ST STAGE QUENCH PUMP | (1Y) LUBRICATION & CLEANING | PM | 14/8/2024 | Pump |
| 20240814 | B52A-C-00025 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-081) | IM | 14/8/2024 | |
| 20240814 | B3A-C-00012 | B-R-2401 | PD. FAN | (1M) CHECK LUBRICATING OIL | PM | 14/8/2024 | |
| 20240814 | BNA-C-00014 | B-SECUR-TASK22 | FOR PM: INSPECTION FIRE PROTECTIVE CLOT | (1M) INSPECTION | PM | 14/8/2024 | |
| 20240813 | BH3-C-00016 | B-AF-310105 | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M) SET & CALIBRATION | PM | 13/8/2024 | |
| 20240813 | B09-C-00028 | B-AT-312001/1-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) ISO14001 SET&CALIBRATION | PM | 13/8/2024 | |
| 20240813 | B061-S-00007 | B-G-1125-P-4S | ALUM FEED PUMP | (1Y) INSPECTION, CLEAN, LUBRICATE | PM | 13/8/2024 | |
| 20240813 | B09-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE#5 | (1M) CLEANING & INSPECTION | PM | 13/8/2024 | Motor |
| 20240813 | B39-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M) CLEANING AND INSPECTION | PM | 13/8/2024 | Motor |
| 20240813 | B90-S-00005 | B-PM-32015 | QUENCH WATER PUMP MOTOR | (1M) CLEANING AND INSPECTION | PM | 13/8/2024 | Motor |
| 20240813 | B19A-C-00062 | B-R-3001P | CRACKED GAS COMPRESSOR HP CASING | (1M) INSPECT WRAPPED DRAIN FLANGE | PM | 13/8/2024 | Compressor |
| 20240813 | BNA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M) INSPECTION | PM | 13/8/2024 | |
| 20240813 | B39-C-00004 | B-UPS-001 | GROUPING FOR UPS ISOXICA | (1M) INSPECT & ADJUST | PM | 13/8/2024 | |
| 20240813 | BH3-C-00006 | B-V-3021-P2 | CAUSTIC DOSING PUMP FOR REGENERATION | (1Y) LUBRICATE | PM | 13/8/2024 | |
| 20240813 | B216-C-00006 | B-V-3041-P1S | HYPOCHLORITE INJECTION PUMP | (1Y) LUBRICATE | PM | 13/8/2024 | |
| 20240813 | B12-C-00354 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M) Inspection & Record | PM | 13/8/2024 | |
| 20240813 | B12-C-00354 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M) Inspection & Record | PM | 13/8/2024 | |
| 20240813 | B12-C-00357 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M) Inspection & Record | PM | 13/8/2024 | |
| 20240812 | B09-S-00004 | B-CAP-N5 | GROUPING TAG FOR CAPACITY MAIN SUB | (1M) VISUAL INSPECTION TEMP, NOISE AND VIB | PM | 12/8/2024 | |
| 20240812 | B10B-C-00042 | B-F-120 | USC FURNACES | (3M) CONDITION CHECK (OSL 2020-061) | IM | 12/8/2024 | Furnace |
| 20240812 | B10D-C-00035 | B-F-140 | USC FURNACES | (3M) CONDITION CHECK (OSL 2020-060) | IM | 12/8/2024 | Furnace |
| 20240812 | B00-C-00057 | B-MONE-OLEFINS-P1 | Equipment Non Olefine Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2020-057) | IM | 12/8/2024 | |
| 20240812 | B52A-C-00024 | B-P1-201C | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2020-059) | PM | 12/8/2024 | Pump |
| 20240812 | B52A-C-00024 | B-P1-201A | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2020-059) | PM | 12/8/2024 | Pump |
| 20240812 | B3A-C-00007 | B-PCV-11303 | NITROGEN TO Q-1130 | (2Y) INSPECTION & CALIBRATE | PM | 12/8/2024 | |
| 20240812 | B00-C-00060 | B-PIPE-SC1 | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-067) | IM | 12/8/2024 | |
| 20240812 | B30A-S-00002 | B-R-575A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (1M) INSPECTION & CLEAN | PM | 12/8/2024 | |
| 20240812 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1M) INSPECTION | PM | 12/8/2024 | |
| 20240812 | BNA-C-00012 | B-SECUR-TASK20 | FOR PM: INSPECTION HALON SYSTEMS | (1M) INSPECTION | PM | 12/8/2024 | |
| 20240812 | BNA-C-00012 | B-SECUR-TASK45 | FOR PM: INSPECTION AND CHECK MOBILE GENE | (1M) INSPECTION | PM | 12/8/2024 | |
| 20240812 | B09A-C-00011 | B-T-0308 | UPG VAPORIZERS | (3M) CONDITION CHECK (OSL 2021-068) | IM | 12/8/2024 | |
| 20240812 | B30B-C-00004 | B-T-061 | CO2 CONDENSATION FEED CO. HEATER | (1M) CONDITION CHECK (OSL 2020-056) | IM | 12/8/2024 | |
| 20240811 | B00-C-00024 | B-AT-3000C | CO2 DEPROPANIZER BEDS | (1M) MOISTURE ANALYZER AMETEX | PM | 11/8/2024 | |
| 20240811 | B38-C-00045 | B-EPRISR | GROUPING FOR MCC_43 TAG | (1Y) INSPECT CONTROL WIRING/CONTACT RELAY | PM | 11/8/2024 | |
| 20240811 | B10B-C-00037 | B-F-140 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-133) | IM | 11/8/2024 | Furnace |
| 20240811 | B060-C-00042 | B-G-1122-Q-5 | WWT CHEMICAL SEWER SUMP PIT | (3M) CONDITION CHECK (OSL 2020-044) | IM | 11/8/2024 | |

| | | | | | | | |
|----------|--------------|------------------|---|-------------------------------------|----|-----------|-------|
| 20240811 | B01S-C-00024 | B-P-220A | QUENCH WATER CIRCULATION PUMP | (3M) CONDITION CHECK (OSL 2022-135) | IM | 11/8/2024 | Pump |
| 20240811 | B001-C-00034 | B-P-201C | SHIP BFW PUMPS | (3M) CONDITION CHECK (OSL 2020-042) | IM | 11/8/2024 | Pump |
| 20240811 | B58-C-00009 | B-PCV-11433 | Q-1143 INLET LINE | (3Y) INSPECTION & CALIBRATE | PM | 11/8/2024 | |
| 20240811 | B01B-C-00001 | B-PM-1570A | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M) LUBRICATION | PM | 11/8/2024 | Motor |
| 20240811 | B01B-C-00002 | B-PM-1570B | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M) LUBRICATION | PM | 11/8/2024 | Motor |
| 20240811 | B01B-C-00003 | B-PM-1570S | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M) LUBRICATION | PM | 11/8/2024 | Motor |
| 20240811 | B61-C-00167 | B-PSV-11432 | Safety Valve of Q-1143 | (3Y) INSPECTION & CALIBRATE | PM | 11/8/2024 | PSV |
| 20240811 | B61-C-00168 | B-PSV-11433 | Safety Valve of Q-1143 | (3Y) INSPECTION & CALIBRATE | PM | 11/8/2024 | PSV |
| 20240811 | B01-C-00002 | B-PI-19192 | PRESSURE TRANSMITTER FOR CH4 METER SKID | (4M)SET & CALIBRATE | PM | 11/8/2024 | |
| 20240811 | B061-C-00014 | B-Q-1135 | EQUALIZATION TANK | (3M) CONDITION CHECK (OSL 2020-039) | IM | 11/8/2024 | |
| 20240811 | B57-C-00001 | B-R-1475A | INSTRUMENT AIR COMPRESSOR | (2Y)SET & CALIBRATE (OUT-SOURCE) | PM | 11/8/2024 | |
| 20240811 | B11A-C-00060 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (3M) CONDITION CHECK (OSL 2021-066) | IM | 11/8/2024 | |
| 20240811 | B027-C-00008 | B-T-390A | DEPROPANIZER REBOILERS | (3M) CONDITION CHECK (OSL 2020-043) | PM | 11/8/2024 | |
| 20240811 | B01-C-00003 | B-TT-19192 | TEMP. TRANSMITTER FOR CH4 METER SKID | (4M)SET & CALIBRATE | PM | 11/8/2024 | |
| 20240811 | B38-C-00007 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/8/2024 | |
| 20240810 | B12-C-00670 | B-AT-430303 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 10/8/2024 | |
| 20240810 | B13-S-00013 | B-BT-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B13-S-00014 | B-BL-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B13-S-00015 | B-BL-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B13-S-00016 | B-BL-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00052 | B-BL-BC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00053 | B-BL-BC-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00054 | B-BL-BC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00054 | B-BL-BC-110 | BATTERY UNIT FOR 110VDC SUB.2 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00055 | B-BL-BC-210 | BATTERY UNIT FOR 110VDC SUB.PROCESS | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00057 | B-BL-DC | BATTERY UNIT FOR 110VDC SUB.5 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00058 | B-BL-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00059 | B-BL-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00062 | B-BL-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00060 | B-BL-UPS1-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B90-S-00061 | B-BL-UPS2-1 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/8/2024 | |
| 20240810 | B00-C-00002 | B-G-1167 | DAF | (3M)LUBRICATION & CHANGE LUBE OIL | PM | 10/8/2024 | |
| 20240810 | B52B-S-00024 | B-G-1220-P-3A | SULFURIC ACID PUMP | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 10/8/2024 | |
| 20240810 | B3A-C-00019 | B-G-2401-P-3A | TRISODIUM PHOSPHATE INJECTION PUMP | (1Y)LUBRICATE & CLEAN & FLUSHING | PM | 10/8/2024 | |
| 20240810 | B097-C-00001 | B-G-310R | ELEVATOR | (4M)INSPECTION AND FUNCTION TEST | PM | 10/8/2024 | |
| 20240810 | B4S-C-00001 | B-HYDRAULIC-01 | B-HYDRAULIC STATIC PRESS. 30 T | (1M)LUBRICATION & INSPECTION | PM | 10/8/2024 | |
| 20240810 | B076-C-00035 | B-H-19078 | GROUPING TAG FOR PT GAS TO ASC/TTT | (4M)SET & CALIBRATE | PM | 10/8/2024 | |
| 20240810 | B075-C-00002 | B-MOTOR-EO-003 | GROUPING FOR MOTORS COMPLE545 | (1M)CLEANING | PM | 10/8/2024 | Motor |
| 20240810 | B27-C-00001 | B-MP-510S | C3 HYDROGENATION RECYCLE PUMP MOTOR | (1Y)CHANGE LUBE OIL MOTORS. | PM | 10/8/2024 | Motor |
| 20240810 | B31-C-00001 | B-MP-701S | 1ST STAGE FEED PUMP MOTOR | (1Y)LUBRICATION | PM | 10/8/2024 | Motor |
| 20240810 | B90-C-00168 | B-OSG1S | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/8/2024 | |
| 20240810 | B61-C-00122 | B-P-1152S | FINAL FILTER BACKWASH SUMP PUMP | (3M)REGREASE | PM | 10/8/2024 | Pump |
| 20240810 | B47D-C-00015 | B-P-1540A | MIXED CO PRODUCT PUMP | (2Y)CLEANING | PM | 10/8/2024 | Pump |
| 20240810 | B61-S-00013 | B-P-1610C | ENGINE DRIVEN FIRE PUMP | (RCM)3M/REGREASE COUPLING | PM | 10/8/2024 | Pump |
| 20240810 | B33-C-00001 | B-P-701S | GHS 1ST STAGE FEED PUMP | (1Y)CLEANING & INSPECTION | PM | 10/8/2024 | Pump |
| 20240810 | B31-C-00012 | B-P-740S | GHS 2ND STAGE QUENCH PUMP | (1Y) LUBRICATION & CLEANING | PM | 10/8/2024 | Pump |
| 20240810 | B31-C-00117 | B-PSV-1506S | PSV TAG TO COND F-14 | (3Y) CALIBRATE (PSV1X2) | PM | 10/8/2024 | PSV |
| 20240810 | B04A-C-00010 | B-SECUR-TASK8H | INSPECTION FIRE ALARM STATION | (1M)INSPECTION | PM | 10/8/2024 | |
| 20240810 | B7D-C-00002 | B-SECUR-TASK43 | VISUAL INSPECTION MOBILE FOAM II | (1M)INSPECTION | PM | 10/8/2024 | |
| 20240810 | B60-C-00038 | B-SPEAKER-ES-001 | GROUPING TAG FOR SPEAKER/HORN/S FOLLOW TA | (3M)FUNCTION TEST & EXERCISE | PM | 10/8/2024 | |

| | | | | | | | |
|----------|--------------|---------------|---------------------------------------|---|----|----------|---------|
| 20240802 | B100-C-00032 | B-F-140 | USC FURNACES | (1,5)SYIP SPOOF TEST&INSPECT (GROUP SIP) | IM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00036 | B-F-140 | USC FURNACES | (1,5)INSPECTION (GROUP P2) | IM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00037 | B-F-140 | USC FURNACES | (1,5)CLEANING & INSPECTION(GROUP 2) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00038 | B-F-140 | USC FURNACES | (1,5)YINS, Impulse UnepQ Ventury Group P1 | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00038 | B-F-140 | USC FURNACES | (2)YSET CALIBRATE(GROUP 11-2)(OUT-SOURCE) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00008 | B-F-140 | USC FURNACES | (2)YSET CALIBRATE(GROUP 11-1)PSL, PSH,PSL | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00014 | B-F-140 | USC FURNACES | (2)YSET CALIBRATE(GROUP 12-2)(OUT-SOURCE) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00026 | B-F-140 | USC FURNACES | (1,5)YINSPECTION (GROUP R1) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00014 | B-F-140 | USC FURNACES | (2)YSET CALIBRATE(GROUP 12-1)(OUT-SOURCE) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00031 | B-F-140 | USC FURNACES | (2)YCLEANING & INSPECTION (GROUP "USL") | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00003 | B-F-140 | USC FURNACES | (2)YSET & CALIBRATE (GROUP O) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00003 | B-F-140 | USC FURNACES | (1,5)YINSPECT CONTROL VALVE(GROUP O) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00003 | B-F-140 | USC FURNACES | (1,5)YSET CALIBRATE(GROUP Q)(OUT-SOURCE) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00003 | B-F-140 | USC FURNACES | (1,5)YCHECK&INSPECT(GROUP S)(OUT-SOURCE) | IM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00003 | B-F-140 | USC FURNACES | (1,5)YCHECK & INSPECT(GROUP L) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00033 | B-F-140 | USC FURNACES | (2)YCLEANING&INSPECT FLOW(GROUP J) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00042 | B-F-140 | USC FURNACES | (2)YCLEANING&INSPECT(GROUP P) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00042 | B-F-140 | USC FURNACES | (1)YUNPLUG COIL VENTURY (GROUP A) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00042 | B-F-140 | USC FURNACES | (1)YINSPECTION FURNACE(GROUP A&Z) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00042 | B-F-140 | USC FURNACES | (1)YINTERNAL CLEANING USX (GROUP U1) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00042 | B-F-140 | USC FURNACES | (1)YINTERNAL CLEANING TLX (GROUP U) | PM | 2/8/2024 | Furnace |
| 20240802 | B100-C-00042 | B-F-140 | USC FURNACES | (1,5)YCONDITION CHECK (GROUP V) | IM | 2/8/2024 | Furnace |
| 20240802 | B061-S-00006 | B-G-1125-P-4A | ALUM FEED PUMP | (1)YINSPECTION, CLEAN, LUBRICATE | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1)W/CLEAN STRAINER FOR B-G-1144-P-2S | PM | 2/8/2024 | Pump |
| 20240802 | B057-C-00014 | B-G-1475A | INSTRUMENT AIR DRIERS | (M)Cleaning Auto Drain of Air Dryer | PM | 2/8/2024 | Pump |
| 20240802 | B057-C-00014 | B-G-1475B | INSTRUMENT AIR DRIERS | (M)Cleaning Auto Drain of Air Dryer | PM | 2/8/2024 | Pump |
| 20240802 | B057-C-00015 | B-G-1475S | INSTRUMENT AIR DRIERS | (M)Cleaning Auto Drain of Air Dryer | PM | 2/8/2024 | Pump |
| 20240802 | B12-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1)YFUNCTION TEST & EXERCISE | PM | 2/8/2024 | Pump |
| 20240802 | B90-C-00005 | B-GS-2ES | DIESEL ENGINE GENERATOR SET MOTOR | (1)YFUNCTION TEST & EXERCISE | PM | 2/8/2024 | Pump |
| 20240802 | B90-C-00075 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1)YFUNCTION TEST & EXERCISE | PM | 2/8/2024 | Pump |
| 20240802 | B063-C-00042 | B-HY-164S | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/8/2024 | Pump |
| 20240802 | B063-C-00042 | B-HY-164T | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/8/2024 | Pump |
| 20240802 | B063-C-00042 | B-HY-164F | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/8/2024 | Pump |
| 20240802 | B063-C-00042 | B-HY-164S | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/8/2024 | Pump |
| 20240802 | B100-C-00003 | B-LCP-F-140 | TLVDY Switch Box of F-140 | (1,5)YInspect F-140 D/KTR LCP(GROUP U) | PM | 2/8/2024 | Pump |
| 20240802 | B428-C-00034 | B-LV-0005 | MP STM TO R-600-PT-1S | (3M) CONDITION CHECK (OSL 2023-284) | PM | 2/8/2024 | Pump |
| 20240802 | B069-C-00023 | B-M1-1904 | GROUPING TAG FOR HP PROPYLENE TO IRPC | (M)SET & CALIBRATE | PM | 2/8/2024 | Pump |
| 20240802 | B1-S-00010 | B-MOTOR-ORP | Grouping For Motor ORP | (3M)LUBRICATION | PM | 2/8/2024 | Motor |
| 20240802 | B1-S-00010 | B-MP-901C | SHF BOILER FEED WATER PUMP MOTOR | (2)Y MOTOR&SLEEVE BEARING INSPECT | IM | 2/8/2024 | Motor |
| 20240802 | B10L-C-00018 | B-MR-1020 | ETHYLENE FURNACE ID FAN#10 MOTOR | (1)YINSPECTION (GROUP M) | PM | 2/8/2024 | Pump |
| 20240802 | B100-C-00001 | B-MK-140 | FURNACE ID FAN MOTOR | (1)YINSPECTION (GROUP M) | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00018 | B-P-132A | CF FEED PUMP | (1)W/CLEAN STRAINER FOR B-P-132 | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00018 | B-P-132B | CF FEED PUMP | (1)W/CLEAN STRAINER FOR B-P-132 | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00018 | B-P-132S | CF FEED PUMP | (1)W/CLEAN STRAINER FOR B-P-132S | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00018 | B-P-132A | CF FEED PUMP | (1)W/CLEAN STRAINER FOR B-P-132A | PM | 2/8/2024 | Pump |
| 20240802 | B061-C-00018 | B-P-132S | CF FEED PUMP | (1)W/CLEAN STRAINER FOR B-P-132S | PM | 2/8/2024 | Pump |
| 20240802 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1)WTEST RUN | PM | 2/8/2024 | Pump |
| 20240802 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1)WTEST RUN | PM | 2/8/2024 | Pump |

| | | | | | | | |
|----------|---------------|--------------------|---|---|----|-----------|-------|
| 20240802 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1)WTEST RUN | PM | 2/8/2024 | Pump |
| 20240802 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1)WTEST RUN | PM | 2/8/2024 | Pump |
| 20240802 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1)WTEST RUN | PM | 2/8/2024 | Pump |
| 20240802 | B12-S-00031 | B-P-401A | SHU FEED PUMPS | (6M) CHANGE LUBE OIL AND FILTER | PM | 2/8/2024 | Pump |
| 20240802 | B001-C-00040 | B-P-901B | SHF BOILER FEED WATER PUMP | (3M) CONDITION CHECK (OSL 2023-286) | IM | 2/8/2024 | Pump |
| 20240802 | B1-S-00010 | B-P-901C | SHF BFW PUMPS | (2)YBEARING INSPECTION | PM | 2/8/2024 | Pump |
| 20240802 | B048-C-00005 | B-Q-155S | PYROLYSIS FUEL OIL STORAGE TANK | (3M) CONDITION CHECK (OSL 2023-285) | IM | 2/8/2024 | Pump |
| 20240802 | B43-C-00030 | B-R-3101 | ETHYLENE FURNACE ID FAN#1 | (1M) Visual inspection | PM | 2/8/2024 | Pump |
| 20240802 | B44-C-00027 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | (1M) Visual inspection | PM | 2/8/2024 | Pump |
| 20240802 | B45-C-00026 | B-R-3103 | ETHYLENE FURNACE ID FAN#3 | (1M) Visual inspection | PM | 2/8/2024 | Pump |
| 20240802 | B46-C-00024 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (1M) Visual inspection | PM | 2/8/2024 | Pump |
| 20240802 | B47-C-00026 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (1M) Visual inspection | PM | 2/8/2024 | Pump |
| 20240802 | B48-C-00056 | B-R-3106 | ETHYLENE FURNACE ID FAN#6 | (1M) Visual inspection | PM | 2/8/2024 | Pump |
| 20240802 | B13-C-00042 | B-SU7-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/8/2024 | Pump |
| 20240802 | B13-C-00043 | B-SU7-FA-FFCP-001 | Firefighting Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/8/2024 | Pump |
| 20240802 | BH36-C-00003 | B-T-3419 | DRYER REGENERATION HEATER | (3M) CONDITION CHECK (OSL 2023-283) | IM | 2/8/2024 | Pump |
| 20240802 | B00-C-00136 | B-VALVE1-SCH | VALVE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-282) | IM | 2/8/2024 | Pump |
| 20240801 | BH11-S-00003 | B-CAUTCHP/2 | Grouping Tag for Caustic Pump L-4/2 | (1M)CLEAN | PM | 1/8/2024 | Pump |
| 20240801 | B00-C-00075 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1M) Function and Record test | PM | 1/8/2024 | Pump |
| 20240801 | B00-C-00075 | B-CCTV-FS | GROUPING TAG FOR FIRE STATION | (1M) Function and Record test | PM | 1/8/2024 | Pump |
| 20240801 | B00-C-00077 | B-CCTV-GATE | GROUPING TAG FOR GATE | (1M) Function and Record test | PM | 1/8/2024 | Pump |
| 20240801 | B00-C-00078 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/8/2024 | Pump |
| 20240801 | B00-C-00079 | B-CCTV-WH | GROUPING TAG FOR WAREHOUSE | (1M) Function and Record test | PM | 1/8/2024 | Pump |
| 20240801 | B00-C-00080 | B-CCTV-WHS | GROUPING TAG FOR WORK SHOP | (1M) Function and Record test | PM | 1/8/2024 | Pump |
| 20240801 | BNA-C-00016 | B-CRIT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2W)Visual & Condition Inspection | PM | 1/8/2024 | Pump |
| 20240801 | B50-C-00062 | B-G-1300S-P-1 | I.C.O. DRUM PUMP | RCM(1M)SHORT TERM PRESERVATION | PM | 1/8/2024 | Pump |
| 20240801 | B108-C-00053 | B-HW-1207 | DECOKE EFFLUENT TO F-120 | (1,5)YCLEANING BOTTOM PLATE INS.(GROUP 1) | PM | 1/8/2024 | Pump |
| 20240801 | B45-C-00013 | B-HW-3113 | MOTOR OPERATED TRANSFER LINE VALVE OF F-120 | (6M)LUBRICAT AND INSPECT 2 VALVE Group | PM | 1/8/2024 | Pump |
| 20240801 | B45-C-00013 | B-HW-3103 | MOTOR OPERATED DECKING VALVE OF F-3103 | (6M)LUBRICAT AND INSPECT 2 VALVE Group | PM | 1/8/2024 | Pump |
| 20240801 | BOL2JMC01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/8/2024 | Pump |
| 20240801 | BOL2JMC01 | B-INSP-CH-OLE2-1-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/8/2024 | Pump |
| 20240801 | BOL2JMC01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/8/2024 | Pump |
| 20240801 | BOL2JMC01 | B-INSP-CH-OLE2-2-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/8/2024 | Pump |
| 20240801 | BOL2JMC01 | B-INSP-CH-OLE2-3-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/8/2024 | Pump |
| 20240801 | BOL2JMC01 | B-INSP-CH-OLE2-3-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/8/2024 | Pump |
| 20240801 | B09S-S-00001 | B-MOTOR-EO-008 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 1/8/2024 | Motor |
| 20240801 | B09S-S-00001 | B-MOTOR-EP-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING & INSPECTION | PM | 1/8/2024 | Motor |
| 20240801 | B47A2-C-00027 | B-P-1320S | ETHYLENE PRODUCT PUMP | (2)YCLEANING & INSPECTION | PM | 1/8/2024 | Pump |
| 20240801 | B11-C-00066 | B-P-3403A | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE to Bearing Mechanical Seal | PM | 1/8/2024 | Pump |
| 20240801 | B11-C-00066 | B-P-3403S | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE to Bearing Mechanical Seal | PM | 1/8/2024 | Pump |
| 20240801 | B04-C-00037 | B-P-3603A | ETHYLENE LP PRODUCT PUMP | (6M)CHECK & INSPECT | PM | 1/8/2024 | Pump |
| 20240801 | B46A-C-00033 | B-Q-1521 | LPG STORAGE TANK | (15)YINTERNAL INSPECTION (EXCISE/CLEAN) | IM | 1/8/2024 | Pump |
| 20240801 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A WATER TRUCK NO1 (NUNGUNATE) | (10)INSPECTION | PM | 1/8/2024 | Pump |
| 20240801 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYVARI) | (10)INSPECTION | PM | 1/8/2024 | Pump |
| 20240801 | B20-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBLANCE(JATRAYU) | (10)INSPECTION | PM | 1/8/2024 | Pump |
| 20240801 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATAYU) | (10)INSPECTION | PM | 1/8/2024 | Pump |
| 20240801 | BNA-C-00024 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (10)INSPECTION | PM | 1/8/2024 | Pump |
| 20240801 | BNA-C-00033 | B-SECUR-TASK48 | FOR PM: INSPECTION FM-200 SYSTEM | (1M) Visual inspection FM-200 system (RA) | PM | 1/8/2024 | Pump |
| 20240801 | B00-C-00068 | B-SECUR-TASK51 | Smoke / Heat detector system : Control a | (1M)Visual inspection | PM | 1/8/2024 | Pump |
| 20240731 | B00-C-00137 | B-1034-CO2-001 | CO2 Portable for OLE OLE2/1 | (6M)CO2 Portable weight Test | PM | 31/7/2024 | Pump |

| | | | | | | | |
|----------|--------------|----------------|---|--|----|-----------|------------|
| 20240731 | B00-C-00153 | B-1034-FHH-001 | Fire Hose House for OLE2/1 | (6M)Fire Hose and Nozzle Test | PM | 31/7/2024 | |
| 20240731 | B00-C-00155 | B-1034-FHR-001 | Fire Hose Reel and Cabinet for Admin | (6M)Fire Hose and Cabinet Test | PM | 31/7/2024 | |
| 20240731 | B00-C-00157 | B-1034-FM-001 | Fixed Monitor for OLE2/1 | (6M)Fixed Monitor Function Test | PM | 31/7/2024 | |
| 20240731 | B00-C-00199 | B-1034-FIV-001 | Post Indicator Valve for OLE2/1 | (6M)Post Indicator Valve Exercise | PM | 31/7/2024 | |
| 20240731 | B00-C-00201 | B-1034-WC-001 | Water Curtain for OLE2/1 | (6M)Water Curtain Inspect and Function | PM | 31/7/2024 | |
| 20240731 | B10C-C-00045 | B-F-130 | USC FURNACES | (3)YCOIL & REFRACTORY INSPECTION GROUP C | PM | 31/7/2024 | Furnace |
| 20240730 | B12-C-00782 | B-1036-CO2-001 | CO2 Portable for OLE2/3 | (1M)CO2 Portable Visual Inspection | IM | 30/7/2024 | |
| 20240730 | B12-C-00788 | B-1036-DC-001 | Dry Chemical for OLE2/3 | (1M)Dry Chemical Visual Inspection | IM | 30/7/2024 | |
| 20240730 | B12-C-00798 | B-1036-FA-001 | All Manual Fire Alarm for OLE2/3 | (1M)Manual Fire Visual InspectsTest | IM | 30/7/2024 | |
| 20240730 | B12-C-00804 | B-1036-FM-001 | FM200 for Rack Room (OLE2/3) | (1M)FM200 System Visual Inspection | IM | 30/7/2024 | |
| 20240730 | B031-S-00001 | B-MR-701A | RECYCLE H2 COMPRESSOR | (8,000H)OVERHAUL & INSPECTION MOTOR | PM | 30/7/2024 | Compressor |
| 20240730 | B031-S-00001 | B-PSV-702A | R-701A | (16,000H)OVERHAUL & INSPECT PSV | PM | 30/7/2024 | PSV |
| 20240730 | B031-S-00001 | B-PSV-702B | R-701A | (16,000H)OVERHAUL & INSPECT PSV | PM | 30/7/2024 | PSV |
| 20240730 | B42B-C-00033 | B-R-600-PT-1S | CR SURFACE CONDENSER COND.TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/7/2024 | |
| 20240730 | B438-C-00018 | B-R-600-PT-1S | CR COMP SURFACE CONDENSER COND.TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/7/2024 | |
| 20240730 | B031-S-00001 | B-R-701A | GRJ RECYCLE H2 COMPRESSOR | (8,000H)SET & CALIBRATION (OUT-SOURCE) | PM | 30/7/2024 | Compressor |
| 20240730 | B031-S-00001 | B-R-701A | GRJ RECYCLE H2 COMPRESSOR | (16,000H) OVERHAUL | PM | 30/7/2024 | Compressor |
| 20240730 | B032-S-00002 | B-V-730-P-1S | CORROSION INHIBITOR INJECT PUMP | (1)YINSPECTION, CLEAN, LUBRICATE | PM | 30/7/2024 | |
| 20240729 | B00-C-00130 | B-1034-CO2-001 | CO2 Portable for OLE OLE2/1 | (1M) CO2 Portable Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-C-00131 | B-1034-DC-001 | Dry Chemical for OLE2/1 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/7/2024 | |
| 20240729 | B00-C-00157 | B-1034-DC-002 | Dry Chemical for Admin | (1M)INSPECTION | IM | 29/7/2024 | |
| 20240729 | B00-S-00001 | B-1034-DV-001 | Deluge Valve for OLE OLE2/1Group 1 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-S-00002 | B-1034-DV-002 | Deluge Valve for OLE OLE2/1Group 2 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-S-00003 | B-1034-DV-003 | Deluge Valve for OLE OLE2/1Group 3 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-S-00004 | B-1034-DV-004 | Deluge Valve for OLE OLE2/1Group 4 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-S-00005 | B-1034-DV-005 | Deluge Valve for OLE OLE2/1Group 5 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-S-00006 | B-1034-DV-006 | Deluge Valve for OLE OLE2/1Group 6 (DV | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-C-00133 | B-1034-FA-001 | All Manual Fire Alarm for OLE2/1 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/7/2024 | |
| 20240729 | B00-C-00150 | B-1034-FDC-001 | Fire Department Connection for Admin | (1M)Fire Department Connection Visual | IM | 29/7/2024 | |
| 20240729 | B00-C-00152 | B-1034-FHH-001 | Fire Hose House for OLE2/1 | (1M)Fire Hose Box Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-C-00154 | B-1034-FHR-001 | Fire Hose Reel and Cabinet for Admin | (1M)Fire Hose and Cabinet Reel Visual | IM | 29/7/2024 | |
| 20240729 | B00-C-00156 | B-1034-FM-001 | Fixed Monitor for OLE2/1 | (1M)Fixed Monitor Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-C-00199 | B-1034-FIV-001 | Post Indicator Valve for OLE2/1 | (1M)Post Indicator Valve Visual Insp | IM | 29/7/2024 | |
| 20240729 | B00-C-00201 | B-1034-WC-001 | Water Curtain for OLE2/1 | (1M)Water Curtain Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B11-C-00016 | B-1034-WDC-001 | Whisked Fire Extinguishers for OLE2/1 | (1M)Dry Chemical Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-C-00203 | B-1034-WH-001 | Water Hydrant for OLE2/1 | (1M)Water Hydrant Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B00-C-00205 | B-1034-WHM-001 | Water Hydrant with Monitor for OLE2/1 | (1M)Water Hydrant Monitor Visual Inspect | IM | 29/7/2024 | |
| 20240729 | B11-C-00066 | B-1035-CO2-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B11-C-00067 | B-1035-DC-001 | Dry Chemical for OLE2/2 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/7/2024 | |
| 20240729 | B11-C-00068 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B11-C-00069 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (1M) Deluge Valve Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B11-C-00090 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/7/2024 | |
| 20240729 | B11-S-00090 | B-1035-WH-001 | Water Hydrant for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 29/7/2024 | |
| 20240729 | B11-S-00091 | B-1035-WHM-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant with Monitor Visual Inspect | IM | 29/7/2024 | |
| 20240729 | B12-C-00771 | B-1036-FIV-001 | Post Indicator Valve for OLE2/3 | (1M)Post Indicator Valve Visual Insp | IM | 29/7/2024 | |
| 20240729 | B1-C-00018 | B-AT-9010 | BFW FROM DEAERATOR | (V)W/CALIBRATION | PM | 29/7/2024 | |
| 20240729 | B10C-C-00016 | B-F-130 | USC FURNACES | (3)YCONVECTION CLEAN (GROUP "B") | PM | 29/7/2024 | Furnace |
| 20240729 | B10C-C-00026 | B-F-130 | USC FURNACES | (1,5)LYCLEANING & INSPECTION(GROUP Z) | PM | 29/7/2024 | Furnace |

| | | | | | | | |
|----------|--------------|----------------|---|--|----|-----------|--------------|
| 20240727 | B90-C-00018 | B-PM-38415 | COOLING TOWER PUMP MOTOR | (6M)CHANGE OIL Lubrication&Inspection | PM | 21/7/2024 | Motor |
| 20240727 | B13A-C-00019 | B-R-300-P-25 | CG COMPRESSOR CONDENSATE VACUUM PUMP | (1Y)CLEANING | PM | 21/7/2024 | Compressor |
| 20240727 | B13C-C-00003 | B-V-300-P15 | Q2 SCAVENGER INJECTION PUMP | (1Y)LUBRICATION | PM | 21/7/2024 | |
| 20240727 | B001-S-00001 | B-V-300-P-1A | HYDRAZINE INJECTION PUMP | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 21/7/2024 | |
| 20240726 | B12-C-00024 | B-AT-402104 | BUTADIENE Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/7/2024 | |
| 20240726 | B12-C-00025 | B-AT-404501 | BEI Column Accurum. (M-1045) Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/7/2024 | |
| 20240726 | B7-C-00006 | B-AT-9440 | HC LP SUS COND. DISC. P-902A/5 | (1M)SET & CALIBRATE | PM | 26/7/2024 | |
| 20240726 | B63-C-00088 | B-DV-NPA-001 | GROUPING TAG FOR DELUGE VALVE NPA | (1M)CHECK/VISUAL HEAT DETECTORS AND | PM | 26/7/2024 | |
| 20240726 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/7/2024 | |
| 20240726 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/7/2024 | |
| 20240726 | B061-C-00017 | B-G-1144-P-25 | SLUDGE RETURN PUMP | (1M)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/7/2024 | |
| 20240726 | B32-C-00010 | B-G1-300 | GAS DETECTOR (VOM) BETWEEN COCO&TPC | (6M)RECALIBRATE GAS DETECTOR(OUT-SOURCE) | PM | 26/7/2024 | Gas Detector |
| 20240726 | B32-C-00018 | B-G1-301 | GAS DETECTOR (VOM) BETWEEN COCO&TPC | (6M)RECALIBRATE GAS DETECTOR(OUT-SOURCE) | PM | 26/7/2024 | Gas Detector |
| 20240726 | B12-C-00056 | B-GS-2F-1 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 26/7/2024 | |
| 20240726 | B90-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 26/7/2024 | |
| 20240726 | B90-C-00075 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 26/7/2024 | |
| 20240726 | B016-C-00005 | B-M-3104 | 4 FURNACE SHP STEAM | (1Y) EXTERNAL INSPECTION BY LAW | IM | 26/7/2024 | |
| 20240726 | B0P5-C-00023 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (3M)CLEANING & INSPECTION. | PM | 26/7/2024 | |
| 20240726 | B0P5-C-00023 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (3M)CLEANING & INSPECTION. | PM | 26/7/2024 | |
| 20240726 | B0P5-C-00041 | B-MOTOR-EO-009 | GROUPING FOR MOTORS CONSOLE#9 | (3M)CLEANING & INSPECTION/LUBRICATION | PM | 26/7/2024 | |
| 20240726 | B5-C-00008 | B-P-1124A | CHEMICAL SEWER SUMP PUMP | (2M)REGREASE | PM | 26/7/2024 | |
| 20240726 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1M)W/CLEAN STRAINER FOR B-P-1132 | PM | 26/7/2024 | |
| 20240726 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1M)W/CLEAN STRAINER FOR B-P-1132 | PM | 26/7/2024 | |
| 20240726 | B061-C-00018 | B-P-1136A | CG EFFLUENT TRANSFER PUMP | (1M)W/CLEAN STRAINER FOR B-P-1136 | PM | 26/7/2024 | |
| 20240726 | B061-C-00018 | B-P-1136S | CG EFFLUENT TRANSFER PUMP | (1M)W/CLEAN STRAINER FOR B-P-1136 | PM | 26/7/2024 | |
| 20240726 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1M)TEST RUN | PM | 26/7/2024 | |
| 20240726 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1M)TEST RUN | PM | 26/7/2024 | |
| 20240726 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 26/7/2024 | |
| 20240726 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 26/7/2024 | |
| 20240726 | B063-WK-0002 | B-P-1601E | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 26/7/2024 | |
| 20240726 | BNA-C-00088 | B-PM-4510A | BUTENE-1 PRODUCT TRANSFER PUMP MOTOR | (3M)INSPECTION | PM | 26/7/2024 | |
| 20240726 | B057-C-00005 | B-PSV-14002 | SAFETY VALVE CV. RETURN LINE R-1475S | (3Y)INSPECTION & OVERHAUL | PM | 26/7/2024 | |
| 20240726 | B79-C-00049 | B-PSV-5300S | M-530A TO COLD FLARE | (3Y)SET & CALIBRATE (PSV 1X2) | PM | 26/7/2024 | |
| 20240726 | B090-C-00033 | B-R-3600-PM-1S | C2 COMP. LO PUMP MOTOR | RCM (6M) INSPECTION AND TEST | PM | 26/7/2024 | |
| 20240726 | BNA-C-00049 | B-VI-COMP | GROUPING TAG FOR VIBRATION MAJOR COMP | (3M)VIBRATION CHECK. | IM | 26/7/2024 | |
| 20240725 | B0P1-C-00002 | B-EPCD1MA | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/7/2024 | |
| 20240725 | B0P1-C-00001 | B-EPCD1MB | GROUPING FOR MOTORS CONSOLE#1 | (3M)LUBRICATION ON OPERATION. | PM | 25/7/2024 | |
| 20240725 | B0P2-C-00002 | B-EPCD1MC | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/7/2024 | |
| 20240725 | B0P2-C-00001 | B-EPCD1MD | GROUPING FOR MOTORS CONSOLE#2 | (3M)LUBRICATION ON OPERATION. | PM | 25/7/2024 | |
| 20240725 | B0P3-C-00003 | B-EPCD1ME | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/7/2024 | |
| 20240725 | B0P3-C-00002 | B-EPCD1MF | GROUPING FOR MOTORS CONSOLE#3 | (3M)LUBRICATION ON OPERATION. | PM | 25/7/2024 | |
| 20240725 | B0P4-C-00002 | B-EPCD1MG | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/7/2024 | |
| 20240725 | B0P4-C-00001 | B-EPCD1MH | GROUPING FOR MOTORS CONSOLE#4,5,6 | (3M)LUBRICATION ON OPERATION. | PM | 25/7/2024 | |
| 20240725 | B10C-C-00039 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-178) | IM | 25/7/2024 | Furnace |
| 20240725 | B10F-C-00041 | B-F-160 | USC FURNACES | (1.5Y)INS. Impulse LinePVC VenturyGroup | IM | 25/7/2024 | Furnace |
| 20240725 | B60-C-00088 | B-G-1112-P-1S | HIGH PRESSURE FEED PUMPS | (1M)CLEAN STRAINER&INSPECTION | PM | 25/7/2024 | |
| 20240725 | B0P5-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/7/2024 | |
| 20240725 | B0P5-C-00004 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/7/2024 | |
| 20240725 | B00-C-00088 | B-MOTOR-EO-003 | Equipment Non Offline Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-181) | IM | 25/7/2024 | |
| 20240725 | B528-C-00141 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-176) | IM | 25/7/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|------------|
| 20240725 | B528-C-00142 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-177) | IM | 25/7/2024 | |
| 20240725 | B49-C-00014 | B-R-1109S | ISOL 4000 WASTE WATER VAPOR COLLEC BLOWER | (6M)LUBRICATION | PM | 25/7/2024 | |
| 20240725 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO. (JUNIKANTE) | (1D)INSPECTION | PM | 25/7/2024 | |
| 20240725 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAVARIN) | (1D)INSPECTION | PM | 25/7/2024 | |
| 20240725 | B20-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(ETRUKSA) | (1D)INSPECTION | PM | 25/7/2024 | |
| 20240725 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 25/7/2024 | |
| 20240725 | B12-C-00758 | B-SST-48004 | HP HEADER STEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-179) | IM | 25/7/2024 | |
| 20240725 | B12-C-00759 | B-SST-48005 | HP HEADER STEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-180) | IM | 25/7/2024 | |
| 20240725 | B90-C-00239 | B-XFMR-281 | POWER TRANSFORMER 5.6/0.4 KV | (3M)RCM Visual Inspection | IM | 25/7/2024 | |
| 20240725 | B90-C-00239 | B-XFMR-282 | POWER TRANSFORMER 5.6/0.4 KV | (3M)RCM Visual Inspection | IM | 25/7/2024 | |
| 20240725 | B016-C-00030 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2023-229) | IM | 23/7/2024 | |
| 20240725 | B12-C-00012 | B-F-160 | USC FURNACES | (1M) SET & CALIBRATE | IM | 23/7/2024 | |
| 20240725 | B10F-C-00004 | B-F-160 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-222) | IM | 23/7/2024 | Furnace |
| 20240725 | B003-C-00031 | B-FI-1995 | HPS from Plant 1-1 | (3M) CONDITION CHECK (OSL 2023-231) | IM | 23/7/2024 | |
| 20240725 | B7A2-C-00004 | B-M-1531 | METHANOL VAPORIZER DRUM | (3M) CONDITION CHECK (OSL 2023-230) | IM | 23/7/2024 | |
| 20240725 | B23A-B-00002 | B-MR-939 | FUEL GAS COMPRESSOR MOTOR | (12,000HRS)MOTOR INSPECTION (OVERHAUL) | PM | 23/7/2024 | Compressor |
| 20240725 | B47F-S-00001 | B-P-1551A | PYROLYSIS GASOLINE PRODUCT PUMP | (2Y)CLEANING & LUBRICATE | PM | 23/7/2024 | Pump |
| 20240725 | B12-C-00043 | B-PGC-BV-HOUSE2 | GROUPING TAG FOR PGC BV HOUSE 2 | (2M)SET&CALIBRATE | PM | 23/7/2024 | |
| 20240725 | B060-C-00057 | B-Q-1121 | SPENT CAUSTIC HOLDING TANK | (3M) CONDITION CHECK (OSL 2023-226) | IM | 23/7/2024 | |
| 20240725 | B57-C-00025 | B-R-1475A | INSTRUMENT AIR COMPRESS | (3M)Air Intake Filter Inspection,Cleanin | PM | 23/7/2024 | |
| 20240725 | B57-C-00025 | B-R-1475B | INSTRUMENT AIR COMPRESS | (3M)Air Intake Filter Inspection,Cleanin | PM | 23/7/2024 | |
| 20240725 | B57-C-00027 | B-R-1475Z | INSTRUMENT AIR COMPRESS | (3M)Air Intake Filter Inspection,Cleanin | PM | 23/7/2024 | Compressor |
| 20240725 | B23A-B-00002 | B-R-939 | FUEL GAS COMPRESSOR | (12,000HRS)INSPECTION | PM | 23/7/2024 | Compressor |
| 20240725 | B23A-B-00002 | B-R-939 | FUEL GAS COMPRESSOR | (12,000HRS)SET & CALIBRATION(OUT-SOURCE) | PM | 23/7/2024 | Compressor |
| 20240725 | B00-C-00107 | B-VALVEI-DS | VALVE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-228) | IM | 23/7/2024 | |
| 20240725 | B81-S-00006 | B-AE-1100 | CG EFFLUENT FROM F-110 | (3M)INSPECTION & CLEANING | PM | 23/7/2024 | |
| 20240725 | B81-S-00002 | B-AE-1200 | CG EFFLUENT FROM F-120 | (3M)INSPECTION & CLEANING | PM | 23/7/2024 | |
| 20240725 | B001-C-00025 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET&CALIBRATE | PM | 23/7/2024 | |
| 20240725 | BH13-C-00062 | B-AT-331003 | MOISTURE ANALYZER TRANSMITTER FOR M-3301 | (1M)MOISTURE ANALYZER AMETEX | PM | 23/7/2024 | |
| 20240725 | B00-C-00012 | B-P-130109 | SUCK ONE AIR TO ETHYLENE FURNACE F-3101 | (3M)UPGRADE 2 LUBRICATE CONTROL VALVE CV-1 | PM | 23/7/2024 | |
| 20240725 | B050-S-00001 | B-G-1300S-R-1 | ASSIST. AIR BLOWER | RCM (1M) VISUAL INSPECTION | PM | 23/7/2024 | |
| 20240725 | B0P5-C-00014 | B-M-1901B | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2Y)UPGRADE N2, CO2, REL DENSITY | PM | 23/7/2024 | |
| 20240725 | B12-C-00732 | B-MOV-HV-430602 | MOV for B-HV-430602 | (1Y) Plan for Motor Operated Valve | PM | 23/7/2024 | |
| 20240725 | B61-C-00118 | B-P-11420 | CONTAMINATED STORM WATER PUMP | (3M)REGREASE | PM | 23/7/2024 | Pump |
| 20240725 | B63-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1M)Weekly Pit sution screen cleaning | PM | 23/7/2024 | |
| 20240725 | B3A-C-00023 | B-P-2402S | DEMINT FEED WATER PUMPS | (1Y)CLEAN & LUBRICATE | PM | 23/7/2024 | Pump |
| 20240725 | B90-S-00009 | B-PM-3801S | BFW PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 23/7/2024 | Motor |
| 20240725 | B528-C-00051 | B-R-1201F | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 23/7/2024 | |
| 20240725 | B528-C-00052 | B-R-1201G | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 23/7/2024 | |
| 20240725 | B528-C-00053 | B-R-1201H | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 23/7/2024 | |
| 20240725 | B19A-WK-0001 | B-R-300-PT-1S | CS COMP SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 23/7/2024 | |
| 20240725 | B19A-S-00001 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | (2M) RE GREASE DAMPER BEARING | PM | 23/7/2024 | |
| 20240725 | B19S-S-00001 | B-R-3103 | ETHYLENE FURNACE ID FAN#3 | (2M) RE GREASE DAMPER BEARING | PM | 23/7/2024 | |
| 20240725 | B428-WK-0001 | B-R-600-PT-1S | CJR SURFACE CONDENSER COND.TURBINE | (2M)REGREASE & INSPECTION | PM | 23/7/2024 | |
| 20240725 | B438-WK-0001 | B-R-650-PT-1S | CJR COMP SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 23/7/2024 | |
| 20240725 | B18A-C-00033 | B-RT-300 | CRACKED CAS COMPRESSOR TURBINE DRIVER | (1M) INSPECT TURBINE EXPANSION JOINT | IM | 23/7/2024 | Compressor |
| 20240725 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1M)INSPECTION | PM | 23/7/2024 | |
| 20240725 | B528-C-00025 | B-SECUR-TASK37 | FLUSH AND VISUAL CHECK FOAM TANK | (3M)INSPECTION | PM | 23/7/2024 | |
| 20240725 | B39-C-00008 | B-A-402 | PRESSURE SWING ADSORPTION UNIT | (1M)INSPECTION | IM | 23/7/2024 | |
| 20240725 | B016-C-00023 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2021-098) | IM | 21/7/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|------------|
| 20240721 | B61-S-00005 | B-AE-1800 | CG EFFLUENT FROM F-180 | (3M)INSPECTION & CLEANING | PM | 21/7/2024 | |
| 20240721 | B38-C-00041 | B-E018A | GROUPING FOR MCC 9 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT RELAY | PM | 21/7/2024 | |
| 20240721 | B10G-C-00037 | B-F-170 | USC FURNACES | (3M) CONDITION CHECK (OSL 2021-099) | IM | 21/7/2024 | Furnace |
| 20240721 | B01A-C-00021 | B-FI-2403 | SH STEAM LINE | (3M) CONDITION CHECK (OSL 2021-096) | IM | 21/7/2024 | |
| 20240721 | B52A-C-00016 | B-G-1201 | COOLING TOWER | (3M) CONDITION CHECK (OSL 2021-095) | IM | 21/7/2024 | |
| 20240721 | B12-C-00654 | B-CP-7-4704 | LCP FOR TREATER REGENERATION HEATER | (1M)INSPECTION&RECORD | IM | 21/7/2024 | |
| 20240721 | B0P6-C-00001 | B-M-19016 | GROUPING TAG FOR FUEL GAS FROM PTT SKID | (1M)INSPECTION & ADJUST | PM | 21/7/2024 | |
| 20240721 | B27-C-00002 | B-MP-510A | CG HYDROGENATION RECYCLE PUMP MOTOR | (1Y)LUBRICATION | PM | 21/7/2024 | Motor |
| 20240721 | B7A1-C-00016 | B-MR-1531 | ETHYLENE RECOVERY COMPRESSOR MOTOR | (3M) Lubrication | PM | 21/7/2024 | Compressor |
| 20240721 | B27-C-00025 | B-P-510A | C3 HYDROGENATION FEED PUMP | (2Y)CLEANING | PM | 21/7/2024 | Pump |
| 20240721 | B528-C-00015 | B-R-1201A | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 21/7/2024 | |
| 20240721 | B528-C-00017 | B-R-1201B | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 21/7/2024 | |
| 20240721 | B528-C-00018 | B-R-1201C | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 21/7/2024 | |
| 20240721 | B528-C-00019 | B-R-1201D | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 21/7/2024 | |
| 20240721 | B528-C-00020 | B-R-1201E | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 21/7/2024 | |
| 20240721 | B056-C-00011 | B-R-1470A | PLANT AIR COMPRESSOR | (3M)Air Intake Filter Inspection,Cleanin | PM | 21/7/2024 | Compressor |
| 20240721 | B056-C-00011 | B-R-1470A | PLANT AIR COMPRESSOR | (3M)INSPECT | PM | 21/7/2024 | Compressor |
| 20240721 | B056-C-00012 | B-R-1470S | PLANT AIR COMPRESSOR | (3M)Air Intake Filter Inspection,Cleanin | PM | 21/7/2024 | Compressor |
| 20240721 | B056-C-00012 | B-R-1470S | PLANT AIR COMPRESSOR | (3M)INSPECT | PM | 21/7/2024 | Compressor |
| 20240721 | B238-C-00036 | B-R-934 | FUEL GAS COMPRESSOR | (3M) CONDITION CHECK (OSL 2021-100) | IM | 21/7/2024 | Compressor |
| 20240721 | B38-C-00019 | B-UPS-003 | GROUPING FOR UPS 150 KVA | (3M)SPECIFIC GRAVITY TEST | PM | 21/7/2024 | |
| 20240721 | B006-C-00061 | B-CAR-NMS | GROUPING TAG FOR NEW MAIN SUB | (1Y)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 20/7/2024 | |
| 20240720 | B00-C-00065 | B-DCS-P1 | DCS HONEYWELL TCC3000&EXPERION | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B004-C-00065 | B-DCS-P1-BOILER | DCS EMERSON DELTA-V MP CONTROLLER SOFTWARE | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-DCS-P1-ORP | DCS HONEYWELL C300 EXPERION RS11.1 | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-DCS-P2 | DCS YOKOGAWA CP461-50/AF300/REVISION RS | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-DCS-P3 | DCS HONEYWELL C300 EXPERION | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | IM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-ORP | ESD/MP3101/Tr4.9.0505&2.0ENH2.10.0 | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P1-TANKFARM | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P2-COLDJUT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P2-FUR5/ROT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P2-FUR6 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B000-C-00065 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/7/2024 | |
| 20240720 | B10A-C-00046 | B-F-110 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-265) | IM | 20/7/2024 | Furnace |
| 20240720 | B10C-C-00042 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-259) | IM | 20/7/2024 | Furnace |
| 20240720 | B006-C-00034 | B-CAR-NMS-001 | GROUPING TAG FOR FIXED WATER PUMP MOTOR IN | (6M)VISUAL & VISUAL | PM | 20/7/2024 | |
| 20240720 | B660-C-00052 | B-G-1112-P-2A | SPENT CALUSTIC NEUTRALIZATION PUMPS | (1Y)LUBRICATE | PM | 20/7/2024 | |
| 20240720 | B660-C-00052 | B-G-1112-P-2A | SPENT CALUSTIC NEUTRALIZATION, PUMP | (1Y)LUBRICATE | PM | 20/7/2024 | |
| 20240720 | B62-S-00006 | B-G-1142-G-2 | SLUDGE SCREW FEEDER | (1Y)INSPECTION & LUBRICATION | PM | 20/7/2024 | |
| 20240720 | B528-S-00025 | B-G-1220-P-3S | SULFURIC ACID PUMP | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 20/7/2024 | |
| 20240720 | B528-C-00143 | B-G-1220-Q-3 | SULFURIC ACID TANK | (3M) CONDITION CHECK (OSL 2023-258) | PM | 20/7/2024 | |
| 20240720 | B13A-C-00018 | B-GA-2401-P-2S | AMMONIA INJECTION PUMP | (1Y)LUBRICATE & CLEAN & FLUSHING | PM | 20/7/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|----------------------------------|----|-----------|------------|
| 20240718 | 020-C-00003 | B-SECUR-TASK3C | FOR PH: CHECK A WATER TRUCK(SAVARIN) | (10)INSPECTION | PM | 18/7/2024 | |
| 20240718 | 020-C-00003 | B-SECUR-TASK3D | FOR PH: CHECK AMBUKASULTURSA | (10)INSPECTION | PM | 18/7/2024 | |
| 20240718 | 020-C-00003 | B-SECUR-TASK3UP | FOR PH: CHECK WATER CAR (NATAYU) | (10)INSPECTION | PM | 18/7/2024 | |
| 20240718 | 0NA-C-00074 | B-SECUR-TASK06 | FOR PH: TEST A FIRE TRUCK | (20)INSPECTION | PM | 18/7/2024 | |
| 20240718 | B12-C-00001 | B-STANDARD-GAS | GROUPING TAG FOR STANDARD GAS | (1M)CHECK STANDARD GAS STATUS | PM | 18/7/2024 | |
| 20240718 | B068-S-00001 | B-V-266-P-1A | EMULSION BREAKER INJECTION PUMP | (1M)INSPECTION, CLEAN, LUBRICATE | PM | 18/7/2024 | |
| 20240717 | B11-C-00094 | B-AT-340610 | ACETYLENE REACTOR EFFLUENT | (1M) SET & CALIBRATE | PM | 17/7/2024 | |
| 20240717 | BHDZ-C-00011 | B-AT-382105 | ISO14000,PH METER TX FOR V-3821-P-1 OUTL | (1M)TEST & CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00654 | B-AT-402101 | BUTADIENE GCG | (1M)SET& CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00665 | B-AT-402105 | BUTADIENE GCG | (1M)SET& CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00666 | B-AT-402201 | BUTADIENE GCG | (1M)SET& CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00668 | B-AT-420101 | BUTENE-1 GCG | (1M)SET & CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00669 | B-AT-420101B | BUTENE-1 GCG | (1M)SET& CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00629 | B-AT-430105 | Fuel Gas of F-4301 and F-4302 CEMs | (1M)SET & CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00671 | B-AT-430401 | BUTENE-1 GCG | (1M)SET& CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00032 | B-AT-480104 | FE-4801-02 Downstream TOC | (1M)SET & CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B12-C-00033 | B-AT-485201 | Q-4852 TOC | (1M)SET & CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B90-S-00043 | B-BC-2EE-110-1 | BATTERY CHARGER 110VDC 6.36 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00044 | B-BC-2EE-110-2 | BATTERY CHARGER 110VDC 6.36 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00045 | B-BC-2EE-24-1 | BATTERY CHARGER 24VDC 2.5 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00046 | B-BC-2EE-24-2 | BATTERY CHARGER 24VDC 2.5 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00048 | B-BC-2M1-1 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00049 | B-BC-2M1-2 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00050 | B-BC-3A4-1 | BATTERY CHARGER NO.1 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00051 | B-BC-3A4-2 | BATTERY CHARGER NO. 2 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00007 | B-BC1-2E5 | BATTERY CHARGER AT NEW MAIN SUB-1 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00040 | B-BC1-2E5-2 | BATTERY CHARGER AT NEW MAIN SUB-2 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00041 | B-BC1-3A4 | BATTERY CHARGER PANEL NO.1 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00025 | B-BC2-2E5 | BATTERY CHARGER AT NEW PRO. SUB-1 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00042 | B-BC2-2E5-2 | BATTERY CHARGER AT NEW PRO. SUB-2 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B90-S-00047 | B-BC2-KW1A | BATTERY CHARGER PANEL NO.2 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/7/2024 | |
| 20240717 | B12-C-00401 | B-CP-TRU-01 | CATHODIC PROTECTION RECTIFIER NO.1 | (1M)VISUAL INSPECTION & RECORD | PM | 17/7/2024 | |
| 20240717 | B90-C-00150 | B-CP-TRU-PLANT2 | GROUP FOR CP TRU PLANT2 | (1M)VISUAL INSPECTION | PM | 17/7/2024 | |
| 20240717 | B38-S-00005 | B-MOTOR-EP-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 17/7/2024 | Motor |
| 20240717 | B4R-600-P-1A | B-MR-600-P-1A | C2A SURFACE COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/7/2024 | |
| 20240717 | B42B-C-00012 | B-MR-600-P-2A | C2A SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/7/2024 | |
| 20240717 | B42B-C-00011 | B-MR-600-P-2S | C2A SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/7/2024 | |
| 20240717 | B12-C-00042 | B-PGC-BV-HOUSE1 | GROUPING TAG FOR PGC BV HOUSE1 | (2M)SET&CALIBRATE | PM | 17/7/2024 | |
| 20240717 | B060-C-00012 | B-PSV-11235 | SAFETY VALVE OFPG-1122-R-1A CASING STAGE1 | (3M)INSPECTION & OVERHAUL | PM | 17/7/2024 | PSV |
| 20240717 | B060-C-00013 | B-PSV-11237 | SAFETY VALVE OFPG-1122-R-1A CASING STAGE2 | (3M)INSPECTION & OVERHAUL | PM | 17/7/2024 | PSV |
| 20240717 | B060-C-00014 | B-PSV-11239 | SAFETY VALVE OFPG-1122-R-1A CASING STAGE3 | (3M)INSPECTION & OVERHAUL | PM | 17/7/2024 | PSV |
| 20240717 | B19A-C-00058 | B-R-300 | CRACKED GAS COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/7/2024 | Compressor |
| 20240717 | B42B-C-00014 | B-R-600-P-1A | C2R COMPRESSOR CONDENSATE PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/7/2024 | Compressor |
| 20240717 | B42B-C-00012 | B-R-600-P-2A | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/7/2024 | Compressor |
| 20240717 | B42B-C-00013 | B-R-600-P-2S | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/7/2024 | Compressor |
| 20240717 | B19A-C-00058 | B-RX-401A | TAIL GAS EXPANDER & COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/7/2024 | Compressor |
| 20240717 | B19A-C-00058 | B-RX-401B | TAIL GAS RECOMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/7/2024 | Compressor |
| 20240717 | B19A-C-00058 | B-R-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) N2 PRESSURE INSPECTION | IM | 17/7/2024 | Compressor |
| 20240717 | B19A-C-00058 | B-RT-600 | ETHYLENE REFRIGERANT COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | IM | 17/7/2024 | Compressor |
| 20240717 | B19A-C-00058 | B-RT-650 | PROPYLENE REFRICERANT COMPRESSOR TURBIN | (1M) N2 PRESSURE INSPECTION | IM | 17/7/2024 | Compressor |

| | | | | | | | |
|----------|----------------|--------------------|--|---|----|-----------|------------|
| 20240714 | 890-C-00022 | B-CO2-SUB1-2 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M)INSPECTION | PM | 14/7/2024 | |
| 20240714 | 9101-C-00047 | B-F-190 | USE RUMANCES | (3M) CONDITION CHECK (OSL 2021-072) | IM | 14/7/2024 | Furnace |
| 20240714 | 913-C-00062 | B-INTERCOM-ORP | Grouping For Intercom ORP | (3M)INTERCOM FUNCTION TEST | PM | 14/7/2024 | |
| 20240714 | 950-C-00062 | B-P-11315 | RECOVERED OIL TRANSFER PUMP | (3M)REGREASE | PM | 14/7/2024 | Pump |
| 20240714 | 93A-C-00012 | B-R-2401 | FD. FAN | (1M)CHECK LUBRICATING OIL | PM | 14/7/2024 | |
| 20240714 | 9NA-C-00014 | B-SECUR-TASK22 | FOR PH: INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/7/2024 | |
| 20240713 | 9H3-C-00016 | B-AT-310105 | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M)SET & CALIBRATION | PM | 13/7/2024 | |
| 20240713 | 90P2-C-00028 | B-AT-312011/1-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) ISO4001 SET/CALIBRATION | PM | 13/7/2024 | |
| 20240713 | 9003-C-00029 | B-FT-19014A | CRITICAL LOOP, CROSS CHECK METER HP STEA | (3M) CONDITION CHECK (OSL 2022-130) | IM | 13/7/2024 | |
| 20240713 | 9033-C-00009 | B-FV-7059 | MP STEAM TO F-700 | (3M) CONDITION CHECK (OSL 2022-225) | IM | 13/7/2024 | |
| 20240713 | 961-C-00131 | B-G-1144P-25 | SLUDGE RETURN PUMP | (1Y) LUBRICATE & CLEANING | PM | 13/7/2024 | |
| 20240713 | 916-C-02174/AS | B-G-2217/4/AS | SCALE DISPERSANT INJECTION PUMPS | (1Y)SET & CALIBRATION | PM | 13/7/2024 | |
| 20240713 | 912-S-00035 | B-G-4803-P-25 | SCALE DISPERSANT INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 13/7/2024 | |
| 20240713 | 9007-C-00024 | B-G-9101A | SUSPECT CONDENSATE FILTERS | (3M) CONDITION CHECK (OSL 2022-221) | IM | 13/7/2024 | |
| 20240713 | 9007-C-00019 | B-G-9104A | SUSPECT CONDENSATE FILTERS | (3M) CONDITION CHECK (OSL 2022-128) | IM | 13/7/2024 | |
| 20240713 | 9006-C-00067 | B-M-19075 | GROUPING TAG FOR RFG FROM PITPE | (4M)SET & CALIBRATE | PM | 13/7/2024 | |
| 20240713 | 9008-C-00012 | B-M-942 | INTERMITTENT BLOWDOWN DRUM | (3M) CONDITION CHECK (OSL 2022-131) | IM | 13/7/2024 | |
| 20240713 | 9005-P-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE5 | (1M)CLEANING & INSPECTION. | PM | 13/7/2024 | Motor |
| 20240713 | 938-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION | PM | 13/7/2024 | Motor |
| 20240713 | 9013-C-00015 | B-P-221A | QUENCH OIL TOWER REFUX PUMP | (3M) CONDITION CHECK (OSL 2022-224) | IM | 13/7/2024 | Pump |
| 20240713 | 922A-C-00020 | B-P-340A | FRESH CAUSTIC MAKE-UP PUMP | (1Y)CLEAN & LUBRICATE | PM | 13/7/2024 | Pump |
| 20240713 | 920B-C-00019 | B-P-585 | SPENT CAUSTIC STRAPPER BOTTOMS PUMP | (1Y)CLEANING & LUBRICATE | PM | 13/7/2024 | Pump |
| 20240713 | 9007-P-00001 | B-P-585 | LINE SWRM CONDENSATE - LP OLE 2-1 | (3M) CONDENSATE PUMP (OSL 2021-093) | PM | 13/7/2024 | |
| 20240713 | 990-S-00005 | B-PK-32015 | QUENCH WATER PUMP MOTOR | (1Y)CHANGE LUBE. OIL MOTORS | PM | 13/7/2024 | Motor |
| 20240713 | 9211-C-00016 | B-PSW-3335 | PL-3555 TO COLD FLARE | (3Y)SET & CALIBRATE (PSY 102) | PM | 13/7/2024 | PSV |
| 20240713 | 9058-C-00014 | B-R-14705 | PLANT AIR COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-132) | IM | 13/7/2024 | Compressor |
| 20240713 | 919A-C-00062 | B-R-300HP | CRACKED GAS COMPRESSOR HP CASING | (1M)INSPECT W/RAPPER DRAIN FLANGE | PM | 13/7/2024 | Compressor |
| 20240713 | 9H7S-00001 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (2M) RE GREASE DAMPER BEARRING | PM | 13/7/2024 | |
| 20240713 | 9NA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/7/2024 | |
| 20240713 | 946A-C-00059 | B-T-1520 | LP VAPORIZER | (3M) CONDITION CHECK (OSL 2022-123) | IM | 13/7/2024 | |
| 20240713 | 938-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/7/2024 | |
| 20240713 | 900-C-00106 | B-VALVE-SH1H | VALVE STEAM- SUPER HIGH PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-222) | IM | 13/7/2024 | |
| 20240713 | 912-S-00356 | B-V50-G-3841-RM-18 | VSD Panel for G-3841-RM-18 | (1M)Inspection & Record | PM | 13/7/2024 | |
| 20240713 | 9007-C-00071 | B-V50-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/7/2024 | |
| 20240713 | 912-S-00357 | B-V50-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/7/2024 | |
| 20240712 | 9005-S-00004 | B-CAP-MS | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 12/7/2024 | |
| 20240712 | 899-C-00164 | B-CP-TP-PLANT1 | GROUP TAG FOR CP TP PLANT1 | (1Y)INSTANCE OFF POTENTIAL PIPE TO SOIL | PM | 12/7/2024 | |
| 20240712 | 899-C-00166 | B-CP-TP-PLANT2 | GROUP TAG FOR CP TP PLANT2 | (1Y)INSTANCE OFF POTENTIAL PIPE TO SOIL | PM | 12/7/2024 | |
| 20240712 | 899-C-00163 | B-CP-TRU-PLANT1 | GROUP TAG FOR CP TRU PLANT1 | (1Y)FUNCTION TEST & EXERCISE TEST | PM | 12/7/2024 | |
| 20240712 | 899-C-00165 | B-CP-TRU-PLANT2 | GROUP FOR CP TRU PLANT2 | (1Y)FUNCTION TEST & EXERCISE TEST | PM | 12/7/2024 | |
| 20240712 | 900-C-00026 | B-DCS-PL | DCS HONEYWELL TDC3000&EXPERION | (6M)PAYMENT SERVICE AGREEMENT HONEYWELL | PM | 12/7/2024 | |
| 20240712 | 910H-C-00039 | B-F-180 | USE RUMANCES | (3M) CONDITION CHECK (OSL 2021-098) | IM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00010 | B-F-3105 | ETHYLENE FURNACE # 5 | (2Y)SET/CALIBRATE(GROUP 12-1)(OUT-SOURCE) | PM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00021 | B-F-3105 | ETHYLENE FURNACE # 5 | (2Y)SP PROOF TEST&INSPECTION(GROUP SIP) | IM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00021 | B-F-3105 | ETHYLENE FURNACE # 5 | (2Y)SP PROOF TEST&INSPECTION(GROUP SIP) | IM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00023 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)FORCE SHUTDOWN&INSPECTION GROUP C | PM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00003 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)INSPECTION TURBID VALVE (GROUP U) | PM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00003 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)INSPECTION GROUP H | IM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00002 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)FUNCTION TEST (GROUP F) | PM | 12/7/2024 | Furnace |
| 20240712 | 9H7-C-00022 | B-F-3105 | ETHYLENE FURNACE # 5 | (2Y)SET/CALIBRATE (GROUP SCR) | PM | 12/7/2024 | Furnace |

| | | | | | | | | | |
|----------|--------------|----------------|--|--|----|-----------|---------|--|--|
| 20240712 | BHF-C-00020 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)INSPECT COCK VALVE 24 legs (GROUP L) | IM | 11/7/2024 | Furnace | | |
| 20240712 | BHF-C-00001 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)AE-310506 PYGAS SAMPLING (GROUP T) | PM | 11/7/2024 | Furnace | | |
| 20240712 | BHF-C-00001 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)INSPECT PCV CLEAN (IMPULSE GROUP P) | PM | 11/7/2024 | Furnace | | |
| 20240712 | BHF-C-00001 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)CHECK/INSPECT (GROUP S) (OUT-SOURCE) | PM | 11/7/2024 | Furnace | | |
| 20240712 | BHF-C-00001 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)SET&CALIBRATE (GROUP Q) (OUT-SOURCE) | PM | 11/7/2024 | Furnace | | |
| 20240712 | BHF-C-00001 | B-F-3105 | ETHYLENE FURNACE # 5 | (1Y)SET & CALIBRATE (GROUP Q) (OUT-SOURCE) | PM | 11/7/2024 | Furnace | | |
| 20240712 | BHF-C-00010 | B-F-3105 | ETHYLENE FURNACE # 5 | (2Y)SET CALIBRATE (GROUP L2) (OUT-SOURCE) | PM | 11/7/2024 | Furnace | | |
| 20240712 | 0061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 11/7/2024 | Pump | | |
| 20240712 | 0061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 11/7/2024 | Pump | | |
| 20240712 | 0061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 11/7/2024 | Pump | | |
| 20240712 | 0519-C-00109 | B-G-1220-Q-3 | SULFURIC ACID TANK | (1Y) CHANGE SILICA GEL | PM | 11/7/2024 | Pump | | |
| 20240712 | 0519-C-00109 | B-G-1221-Q-5 | Sulfuric Acid Storage Tank | (1Y) CHANGE SILICA GEL | PM | 11/7/2024 | Pump | | |
| 20240712 | BNA-C-00052 | B-GC-2M | GROUPING FOR PM GC 2 Month group1 | (3M)SET&CALIBRATE | PM | 11/7/2024 | Pump | | |
| 20240712 | B12-C-00058 | B-GS-2F-1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00075 | B-GS-34A | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 11/7/2024 | Pump | | |
| 20240712 | BHF-C-00029 | B-HV-10513 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (6M)LUBRICAT AND INSPECT ZJ VALVE Group6 | PM | 11/7/2024 | Pump | | |
| 20240712 | BHF-C-00029 | B-HV-310514 | MOTOR OPERATED DECKING VALVE OF F-3105 | (6M)LUBRICAT AND INSPECT ZJ VALVE Group6 | PM | 11/7/2024 | Pump | | |
| 20240712 | B10F-C-00039 | B-M-160 | STEAM DRUM | (3M) CONDITION CHECK (OSL 2021-090) | IM | 11/7/2024 | Pump | | |
| 20240712 | 0061-C-00019 | B-P-1132A | CPJ FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 11/7/2024 | Pump | | |
| 20240712 | 0061-C-00019 | B-P-1132S | CPJ FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 11/7/2024 | Pump | | |
| 20240712 | 0061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 11/7/2024 | Pump | | |
| 20240712 | 0061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 11/7/2024 | Pump | | |
| 20240712 | B61-C-00117 | B-P-1142B | CONTAMINATED STORM WATER PUMP | (3M)REGREASE | PM | 11/7/2024 | Pump | | |
| 20240712 | 0063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 11/7/2024 | Pump | | |
| 20240712 | 0063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 11/7/2024 | Pump | | |
| 20240712 | 0063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 11/7/2024 | Pump | | |
| 20240712 | 0063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 11/7/2024 | Pump | | |
| 20240712 | 0063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 11/7/2024 | Pump | | |
| 20240712 | B64-C-00010 | B-P-2145 | POTABLE WATER PUMP | (1W)CLEAN STRAINER FOR B-P-2145 | PM | 11/7/2024 | Pump | | |
| 20240712 | 055-S-00003 | B-P-2216 | SERVICE WATER PUMP | (3M) CLEAN SUCTION STRAINER | PM | 11/7/2024 | Pump | | |
| 20240712 | B20A-C-00021 | B-P-3405 | FRESH CAUSTIC MAKE-UP PUMP | (1W)CLEAN & LUBRICATE | PM | 11/7/2024 | Pump | | |
| 20240712 | B21-C-00012 | B-PSV-3550A | M-355A TO COLD FLARE | (3Y)SET & CALIBRATE (PSV1X2) | PM | 11/7/2024 | PSV | | |
| 20240712 | B19A-C-00002 | B-R-300-P-S | WASH OIL TRANSFER PUMP | (1Y)CLEANING & LUBRICATE | PM | 11/7/2024 | Pump | | |
| 20240712 | B30A-S-00002 | B-R-575A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (1M)INSPECTION & CLEAN | PM | 11/7/2024 | Pump | | |
| 20240712 | BNA-C-00012 | B-SECUR-TASK20 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 11/7/2024 | Pump | | |
| 20240712 | BNA-C-00012 | B-SECUR-TASK45 | FOR PM: INSPECTION AND CHECK MOBILE GENE | (1M)INSPECTION | PM | 11/7/2024 | Pump | | |
| 20240712 | 0350-C-00006 | B-TE-1300B | FLARE VPS5 TO ELEV FLARE | (3M) CONDITION CHECK (OSL 2021-091) | PM | 11/7/2024 | Pump | | |
| 20240712 | B31-C-00045 | B-V-110-G-1 | GASO ANTIOXIDANT INH STORAGE DRUM AGI | (3M) LUBRICATION | PM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00046 | B-XFMR-1J | 2275.5KV POWER TRANSFORMER SUB.4 | (3M)RCM Visual Inspection | IM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00046 | B-XFMR-1K | 2275.5KV POWER TRANSFORMER SUB.4 | (3M)RCM Visual Inspection | IM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00046 | B-XFMR-2E1 | POWER TRANSFORMER 5.6/0.4 KV FOR NEW HAI | (3M)RCM Visual Inspection | IM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00046 | B-XFMR-2E2 | POWER TRANSFORMER 5.6/0.4 KV FOR NEW HAI | (3M)RCM Visual Inspection | IM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00046 | B-XFMR-2E3 | POWER TRANSFORMER 5.6/0.4 KV FOR NEW PRO | (3M)RCM Visual Inspection | IM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00046 | B-XFMR-2E4 | POWER TRANSFORMER 5.6/0.4 KV FOR NEW PRO | (3M)RCM Visual Inspection | IM | 11/7/2024 | Pump | | |
| 20240712 | B90-C-00046 | B-XFMR-R575 | AUTO TRANSFORMER FOR RM-575 | (1M)VISUAL CHECK | IM | 11/7/2024 | Pump | | |
| 20240712 | B63-C-00080 | B-DV-1628 | VALVE FAIL TO OPEN DELUGE VALVENEL | (6M)DY CCB LUBRICATION & INSPECTION | IM | 11/7/2024 | Pump | | |
| 20240712 | B63-C-00080 | B-DV-1629 | LABORATORY BLDG SPRINKER PANEL DELUGE V | (6M)DY LAB LUBRICATION & INSPECTION | IM | 11/7/2024 | Pump | | |

| | | | | | | | | | |
|----------|--------------|-----------------|--|---------------------------------------|----|-----------|------------|--|--|
| 20240710 | 0060-C-00048 | B-P-1123A | SULFURIC ACID TRANSFER PUMP | (3M) CONDITION CHECK (OSL 2020-054) | IM | 10/7/2024 | Pump | | |
| 20240710 | B61-S-00117 | B-P-1161A | FIREFIGHTING TRAINING WASTEWATER PUMP | (1Y)CLEAN STRAINER | PM | 10/7/2024 | Pump | | |
| 20240710 | B61-S-00005 | B-P-1161S | FIREFIGHTING TRAINING WASTEWATER PUMP | (1Y)CLEAN STRAINER | PM | 10/7/2024 | Pump | | |
| 20240710 | B61-S-00005 | B-P-1289 | HP CONDORP. CONDENSATE PUMP | (3M) CONDITION CHECK (OSL 2020-052) | IM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-P-3001S | BFW PUMP | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-P-901A | SHF BOILER FEED WATER PUMP | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-P-901B | SHF BOILER FEED WATER PUMP | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-P-901C | SHF BFW PUMPS | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-P-901S | SHF BOILER FEED WATER PUMP | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B7-S-00020 | B-P-902B | LP SUSPECT CONDENSATE PUMP | (2Y)CLEAN & INSPECTION | PM | 10/7/2024 | Pump | | |
| 20240710 | B00-C-00036 | B-PIPEI-K | LINE CAUSTIC OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-053) | IM | 10/7/2024 | Pump | | |
| 20240710 | B00-C-00048 | B-PIPEI-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-031) | IM | 10/7/2024 | Pump | | |
| 20240710 | B00-C-00048 | B-PIPEI-SLM | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-033) | IM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-PT-201A | COOLING WATER PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-PT-210A | QUENCH OIL CIRCULATION PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-PT-220A | QUENCH WATER CIRCULATION PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-PT-3801A | BFW PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-PT-4801A | STEAM TURBINE FOR P-4801A | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B007-C-00025 | B-Q-920 | CONDENSATE POLISHER NEUTRALIZATION SUMP | (3M) CONDITION CHECK (OSL 2023-275) | IM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-R-1470A | PLANT AIR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-1470S | PLANT AIR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-1531 | ETHYLENE RECOVERY COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-300 | CRACKED GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-330L | ETHYLENE REFRIGERANT COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-3600 | TAIL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-400C-R | RECYCLE GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-4301 | BUTENE-1 FRACTIONATOR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-575A | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-600 | ETHYLENE REFRIGERANT HEAT PUMP/COMPRESS. | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-701A | GHU RECYCLE H2 COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-701S | GHU RECYCLE H2 COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-936 | FUEL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-R-939 | FUEL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Compressor | | |
| 20240710 | B19A-C-00057 | B-RX-401A | TAIL GAS EXPANDER | (3M) CONDITION CHECK (OSL 2023-275) | IM | 10/7/2024 | Pump | | |
| 20240710 | B050-C-00009 | B-S-1301 | Demountable Flare Stack | (3M) CONDITION CHECK (OSL 2023-275) | IM | 10/7/2024 | Pump | | |
| 20240710 | BNA-C-00010 | B-SECUR-TASK18 | INSPECTION FIRE ALARM STATION | (1M)INSPECTION | PM | 10/7/2024 | Pump | | |
| 20240710 | B20-C-00002 | B-SECUR-TASK43 | VISUAL INSPECTION MOBILE FOAM U | (1M)INSPECTION | PM | 10/7/2024 | Pump | | |
| 20240710 | B19B-C-00060 | B-T-330A | CG 3RD STAGE AFTERCOOLERS | (3M) CONDITION CHECK (OSL 2023-281) | IM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-V-1540 | H2O-CO2 STORAGE REFRIGERATION UNIT | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-V-4090 | CHILLER PACKAGE-BUTADIENE BUFFER DRUM | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-V-4700A | CHILLED WATER PACKAGE | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B19A-C-00057 | B-V-4700B | CHILLED WATER PACKAGE | (3M)LUBE OIL SAMPLING | PM | 10/7/2024 | Pump | | |
| 20240710 | B11-C-00030 | B-VALVE2-SH | VALVE STEAM - HIGH PRESSURE OLE 2-2 | (3M) CONDITION CHECK (OSL 2020-020) | IM | 10/7/2024 | Pump | | |
| 20240710 | BH15-C-00001 | B-XV-330101 | SH STM TO R3301-PT-01A | RCA (1M) CLEAN/INSPECTION | IM | 10/7/2024 | Pump | | |
| 20240709 | 0081-C-00001 | B-AT-1100/1900 | PGC EFFLUENT FROM F-110/F-190 | (1M)SET & CALIBRATION | PM | 9/7/2024 | Pump | | |
| 20240709 | 0097-C-00086 | B-AT-310X01A1-3 | GROUPING TAG CEMS F-3101 to F-3103 | (1M)SET&CALIBRATION | PM | 9/7/2024 | Pump | | |
| 20240709 | 0097-C-00086 | B-AT-310X01B4-6 | GROUPING TAG CEMS F-3104 to F-3106 | (1M)SET&CALIBRATION | PM | 9/7/2024 | Pump | | |
| 20240709 | B67-C-00037 | B-EFT-021 | GROUPING FOR FOAM SYSTEM F/E | (3M)CHECK/VISUAL LEAK DETECTORS/LOCAL | PM | 9/7/2024 | Pump | | |
| 20240709 | B60-S-00001 | B-G-1122-P-1A | HIGH PRESSURE FEED PUMP | (1M)INSPECT, & LUBRICATE | PM | 9/7/2024 | Pump | | |

| | | | | | | | |
|----------|---------------|--------------------|--|--|----|----------|------------|
| 20240709 | 960-S-00002 | B-G-1122-P-1S | HIGH PRESSURE FEED PUMP | (1M)INSPECT, & LUBRICATE | PM | 9/7/2024 | |
| 20240709 | 909S-C-00040 | B-M-19007 | GROUPING TAG FOR ETHYLENE TO FROM I-1 | (4M)SET & CALIBRATE | PM | 9/7/2024 | |
| 20240709 | 909S-C-00053 | B-M-19008 | GROUPING TAG FOR ETHYLENE TO VMT | (4M)SET & CALIBRATE | PM | 9/7/2024 | |
| 20240709 | 938-C-00122 | B-HG-401-P-1S | EXPENDER OIL PUMP MOTOR | (3M)VISUAL INSPECTION AND RECORD | PM | 9/7/2024 | |
| 20240709 | 942A-C-00017 | B-PSV-6300S | M-430 TO COLD FLARE | (3Y)SET & CALIBRATE(PSV 1 /2/3) | PM | 9/7/2024 | PSV |
| 20240709 | 938-B-0001 | B-R-3801 | EXPORT FUEL GAS COMPRESSOR | (6.000hrs) INSPECTION | PM | 9/7/2024 | Compressor |
| 20240709 | 909S-C-00040 | B-SECUR-TASK17 | INSPECTION FOAM STORAGE TANK/FOA | (1M)INSPECTION | PM | 9/7/2024 | |
| 20240709 | 9H36-C-00001 | B-AT-342001 | MOISTURE ANALYZER TRANSMITTER FOR M-3420 | (2M)SET & CALIBRATE | PM | 8/7/2024 | |
| 20240709 | 938-C-00103 | B-CV-65 | GROUPING TAG FOR CONTROL VALVE GROUP-SB | (1M)LUBRICATION | PM | 8/7/2024 | |
| 20240709 | 949-C-00021 | B-G-1350-P-1 | LP VOC FLARE KO DRUM LIQUID PUMP | RCM (1M)Short Term preservation | PM | 8/7/2024 | main(Hare) |
| 20240709 | 909S-C-00014 | B-M-19018 | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2W)UPDATE N2, CO2, RED DENSITY | PM | 8/7/2024 | |
| 20240709 | 990-C-00156 | B-MCC-EO-KW1A | Grouping Tag, for MCC-KW1A | (3M)INSPECT&CONDITION CHECK | PM | 8/7/2024 | |
| 20240709 | 990-C-00156 | B-MCC-EO-KW2B | Grouping Tag, for MCC-KW2B | (3M)INSPECT&CONDITION CHECK | PM | 8/7/2024 | |
| 20240709 | 0063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)WASH-PT surface screen cleaning | PM | 8/7/2024 | Pump |
| 20240709 | 919A-WK-0001 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 8/7/2024 | |
| 20240709 | 943B-WK-0001 | B-R-600-PT-1S | C3A SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 8/7/2024 | |
| 20240709 | 943B-WK-0001 | B-R-650-PT-1S | C3B COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 8/7/2024 | |
| 20240709 | 9NA-C-00021 | B-SECUR-TASK05 | FOR PH: TEST FIRE PUMP | (1W)INSPECTION | PM | 8/7/2024 | |
| 20240709 | 909P1-C-00005 | B-SVDRIC | GROUPING FOR BLOC VALVE | (1Y)INSPECTION / LUBRICATION | PM | 8/7/2024 | |
| 20240709 | 990-C-00156 | B-SWGR-EO-KW1A | Grouping Tag, for SWGR-KW1A,1B | (3M)INSPECT&CONDITION CHECK | PM | 8/7/2024 | |
| 20240709 | 913-C-00044 | B-UPS-2M1-A1 | 220 VAC UPS1 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/7/2024 | |
| 20240709 | 913-C-00045 | B-UPS-2M1-A2 | 220 VAC UPS1 PANEL(BYPASS) | (1M)INSPECT&CONDITION CHECK | PM | 8/7/2024 | |
| 20240709 | 913-C-00046 | B-UPS-2M1-A3 | 220 VAC UPS1 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/7/2024 | |
| 20240709 | 914-C-00045 | B-A-4792 | OIL MLY SYSTEM | (6M)MAGNELY INSPECTION & CALIBRATION | PM | 8/7/2024 | |
| 20240709 | 941-C-00003 | B-AT-4700 | ETHYLENE TOWER | (2M)SET & CALIBRATE | PM | 7/7/2024 | |
| 20240709 | 9NA-C-00051 | B-CRIT-EO-COOLD-P1 | Critical Equipments Cold Area Plant 1 | (1M)Visual & Condition Inspection | PM | 7/7/2024 | |
| 20240709 | 938-C-00113 | B-CRIT-EO-HQ | GROUPING TAG FOR MH1 SEC PLANT#1 | (1M)Visual & Condition Inspection | PM | 7/7/2024 | |
| 20240709 | 938-C-00037 | B-E0ISR12 | GROUPING FOR MCC 10 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 7/7/2024 | |
| 20240709 | 938-C-00037 | B-EFISRA | GROUPING FOR MCC 7 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT RELAY | PM | 7/7/2024 | |
| 20240709 | 912-S-00028 | B-G-4801-MR-1A | COOLING WATER FAN MOTOR | (1Y)INSPECT MCC | PM | 7/7/2024 | |
| 20240709 | 912-S-00028 | B-G-4801-MR-1B | COOLING WATER FAN MOTOR | (1Y)INSPECT MCC | PM | 7/7/2024 | |
| 20240709 | 912-S-00030 | B-G-4801-MR-1C | COOLING WATER FAN MOTOR | (1Y)INSPECT MCC | PM | 7/7/2024 | |
| 20240709 | 912-S-00028 | B-G-4801-R-1A | COOLING WATER FANS | RCM(1Y)GEARBOX REPLACE LUBE OIL | PM | 7/7/2024 | |
| 20240709 | 912-S-00029 | B-G-4801-R-1B | COOLING WATER FANS | RCM(1Y)GEARBOX REPLACE LUBE OIL | PM | 7/7/2024 | |
| 20240709 | 912-S-00030 | B-G-4801-R-1C | COOLING WATER FANS | RCM(1Y)GEARBOX REPLACE LUBE OIL | PM | 7/7/2024 | |
| 20240709 | 990-C-00067 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (3M)INSPECT ENGINE WEEKLY EXERCISE | PM | 7/7/2024 | |
| 20240709 | 990-C-00067 | B-GS-34A | DIESEL ENGINE GENERATOR SET | (3M)INSPECT ENGINE WEEKLY EXERCISE | PM | 7/7/2024 | |
| 20240709 | 9001-S-00003 | B-MCC-3B1-M-Q4 | MCC FOR P-S665 | (6M)Visual Inspection | PM | 7/7/2024 | |
| 20240709 | 912-S-00028 | B-GS-5665 | CONDENSER REFLUX/PRODUCT PUMP | (1W)Visual Inspection | PM | 7/7/2024 | Pump |
| 20240709 | 910K-S-00001 | B-R-1010 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/7/2024 | |
| 20240709 | 910L-S-00001 | B-R-1020 | FURNACE ID FANS | RCM-(1M)INSPECT & LUBRICATE | PM | 7/7/2024 | |
| 20240709 | 910G-S-00001 | B-R-170 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/7/2024 | |
| 20240709 | 910H-S-00001 | B-R-180 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/7/2024 | |
| 20240709 | 910I-S-00001 | B-R-190 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/7/2024 | |
| 20240709 | 9NA-C-00007 | B-SECUR-TASK15 | FOR PH: INSPECTION HALON FIRE EXTINGUISH | (1M)INSPECTION | PM | 7/7/2024 | |
| 20240709 | 9NA-C-00007 | B-SECUR-TASK09 | FOR PH:MANUAL STATION TEST (ADMIN AREA) | (1M)INSPECTION | PM | 7/7/2024 | |
| 20240709 | 910K-S-00001 | B-XFPR-442-1 | TRANSFORMER AT NEW LAB BUILDING | (1M)CONDITION CHECK | PM | 7/7/2024 | |
| 20240709 | 990-C-00240 | B-XFPR-442-3 | LIGHTING TRANSFORMER FOR LABORATORY 0.4/ | (3M)-RCM Visual Inspection | PM | 7/7/2024 | |
| 20240709 | 990-C-00240 | B-XFPR-442-2 | TRANSFORMER AT NEW LAB BUILDING | (3M)-RCM Visual Inspection | PM | 7/7/2024 | |
| 20240709 | 990-C-00240 | B-XFPR-482-1 | TRANSFORMER AT NEW CCB BUILDING | (3M)-RCM Visual Inspection | PM | 7/7/2024 | |

| | | | | | | | | |
|----------|---------------|--------------------|---------------------------------------|--|----|----------|--|---------|
| 20240706 | B0P1-C-00026 | B-ANALYZER-G214/F1 | GROUPING FOR OXYGEN ANALYZER PLANT#1 | (1)MSET & CALIBRATE | PM | 6/7/2024 | | |
| 20240706 | B0P1-C-00001 | B-AT-1200/180 | PGC EFFLUENT FROM F-120P-180 | (1)MSET & CALIBRATION | PM | 6/7/2024 | | |
| 20240706 | B0P1-C-00003 | B-AT-1200/140/150 | PGC EFFLUENT FROM F-120P-140/F-150 | (1)MSET & CALIBRATION | PM | 6/7/2024 | | |
| 20240706 | B0P1-C-00004 | B-AT-1600/1700 | PGC EFFLUENT FROM F-160P-170 | (1)MSET & CALIBRATION | PM | 6/7/2024 | | |
| 20240706 | B035-C-00002 | B-AT-9000 | BUTADIENE HYDRO. INLET&OUTLET | (1)MSET&CALIBRATE | PM | 6/7/2024 | | |
| 20240706 | B008-C-00001 | B-BLOG-SUB4 | Substation No.4 Building | (1)VISUAL INSPECTION BUILDING UP ROOF FOR BLDG | IM | 6/7/2024 | | |
| 20240706 | B003-C-00018 | B-BLOG-TANK | Tank Substation Building | (1)VISUAL INSPECTION BUILDING UP ROOF FOR BLDG | IM | 6/7/2024 | | |
| 20240706 | B90-C-00193 | B-BLOG-TRUCK | Truck Load Building | (1)VISUAL INSPECTION BUILDING UP ROOF FOR BLDG | IM | 6/7/2024 | | |
| 20240706 | B0P5-C-00002 | B-MOTOR-EO-007 | GROUPING FOR MOTORS CONSOLE#5 | (1)CLEANING & INSPECTION. | PM | 6/7/2024 | | |
| 20240706 | B0P5-C-00015 | B-MOTOR-EO-D12 | GROUPING FOR MOTORS CONSOLE#5 | (1)CLEANING & INSPECTION | PM | 6/7/2024 | | |
| 20240706 | B024V-C-00001 | B-COSMVR | GROUPING FOR 115KV AVE | (1)VISUAL INSPECT&RECORD DATA | PM | 6/7/2024 | | |
| 20240706 | B90-C-00171 | B-COSG5 | GROUPING FOR 115KV G5S | (1)VISUAL INSPECT&RECORD DATA | PM | 6/7/2024 | | |
| 20240706 | B1-S-00007 | B-P-903A | LP SUSPECT CONDENSATE PUMP | (2)CLEANING | PM | 6/7/2024 | | Pump |
| 20240706 | B57-C-00016 | B-PSV-14782 | SAFETY VALVE OF G-1477S | (3)VISUAL INSPECT& REPAIR ON CONDITION | PM | 6/7/2024 | | PSV |
| 20240706 | B57-C-00016 | B-PSV-14891 | SAFETY VALVE OF G-1477A | (3)VISUAL INSPECT& REPAIR ON CONDITION | PM | 6/7/2024 | | PSV |
| 20240706 | B12-C-00769 | B-VALVE3-P | VALVE PROCESS OLE 2-3 | (1)M CHECK VOCS | IM | 6/7/2024 | | |
| 20240706 | B18A-C-00020 | B-ARC-3802S | ARC VALVE | (4) ARC OVERHAUL | PM | 5/7/2024 | | |
| 20240705 | B90-C-00142 | B-CAMERA-CCTV-P1 | GROUP TAG FOR CAMERA CCTV SYSTEM | (3)FUNCTION TEST & EXERCISE | PM | 5/7/2024 | | |
| 20240705 | B90-C-00144 | B-CC-CCTV-P1 | GROUP FOR CENTRAL CONTROL CCTV SYSTEM | (3)FUNCTION TEST & EXERCISE | PM | 5/7/2024 | | |
| 20240705 | B30-C-00036 | B-E01S07 | GROUPING FOR MCC 1S TAG | (1)VISUAL INSPECT CONTROL WIRING/CONTACT | PM | 5/7/2024 | | |
| 20240705 | B30-C-00036 | B-E01S08 | GROUPING FOR MCC 10 TAG | (1)VISUAL INSPECT CONTROL WIRING/CONTACT | PM | 5/7/2024 | | |
| 20240705 | B30-C-00036 | B-E01S11 | GROUPING FOR MCC 7 TAG | (1)VISUAL INSPECT CONTROL WIRING/CONTACT | PM | 5/7/2024 | | |
| 20240705 | B10C-C-00043 | B-F-130 | USC FURNACES | (1)FUNCTION CHECK (GROUP V) | IM | 5/7/2024 | | Furnace |
| 20240705 | B10C-C-00043 | B-F-130 | USC FURNACES | (1)INTERNAL CLEANING TLX (GROUP"U") | PM | 5/7/2024 | | Furnace |
| 20240705 | B10C-C-00043 | B-F-130 | USC FURNACES | (1)INTERNAL CLEANING USX (GROUP"U1") | PM | 5/7/2024 | | Furnace |
| 20240705 | B10C-C-00043 | B-F-130 | USC FURNACES | (1)INSPECTION FURNACE (GROUP"AAZ") | IM | 5/7/2024 | | Furnace |
| 20240705 | B10C-C-00043 | B-F-130 | USC FURNACES | (1)JUNPLUS COIL VENTURE (GROUP"AA") | PM | 5/7/2024 | | Furnace |
| 20240705 | B13-C-00001 | B-F1-11213 | N2 PURGE TO G-1121 | (1)CHECK & ADJUST (OUT-SOURCE) | PM | 5/7/2024 | | |
| 20240705 | B65-C-00024 | B-F-11214 | SERVICE WIRE TO SCOURBER | (1)SET & CALIBRATE (OUT-SOURCE) | PM | 5/7/2024 | | |
| 20240705 | B198-C-00012 | B-F1T-3001 | AN-SUR. CG COMP 1ST STG DSKH | (3)M FLUSH/VENT IMPULSE LINE OF FLOW TX. | PM | 5/7/2024 | | |
| 20240705 | B198-C-00012 | B-F1T-3002 | AN-SUR. CG COMP 5TH STG DSKH | (3)M FLUSH/VENT IMPULSE LINE OF FLOW TX. | PM | 5/7/2024 | | |
| 20240705 | B198-C-00012 | B-F1T-3004 | AN-SUR. CG COMP 4TH STG DSKH | (3)M FLUSH/VENT IMPULSE LINE OF FLOW TX. | PM | 5/7/2024 | | |
| 20240705 | B60-C-00060 | B-G-1122-P-6 | DRAIN PUMP | (3)M LUBRICATE | PM | 5/7/2024 | | |
| 20240705 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 5/7/2024 | | |
| 20240705 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 5/7/2024 | | |
| 20240705 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1)W/CLEAN STRAINER FOR B-G-1144-P-2 | PM | 5/7/2024 | | |
| 20240705 | B61-C-00116 | B-G-1144-R-3S | DIGESTER BLOWER | (1)LUBRICATION | PM | 5/7/2024 | | |
| 20240705 | B05-C-00074 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1)FUNCTION TEST & EXERCISE | PM | 5/7/2024 | | |
| 20240705 | B90-C-00005 | B-GS-2E-S | DIESEL ENGINE GENERATOR SET MOTOR | (1)FUNCTION TEST & EXERCISE | PM | 5/7/2024 | | |
| 20240705 | B90-C-00075 | B-GS-3A-4 | DIESEL ENGINE GENERATOR SET | (1)FUNCTION TEST & EXERCISE | PM | 5/7/2024 | | |
| 20240705 | B031-C-00021 | B-H-1700A | GRU 2ND STAGE HYDROGENATION REACTOR | (3)M CONDITION CHECK (OSL 2021-112) | IM | 5/7/2024 | | |
| 20240705 | B43C-C-00001 | B-HG-600-P-1S | LUBE OIL PUMP MOTOR | RCM (3)M REGREASE | PM | 5/7/2024 | | |
| 20240705 | B90-C-00143 | B-MONITOR-CCTV-P1 | GROUP TAG FOR MONITOR CCTV SYSTEM | (3)FUNCTION TEST & EXERCISE | PM | 5/7/2024 | | |
| 20240705 | B43C-C-00008 | B-MR-600-P-4A | C&R OIL PURIFIER PUMP MOTOR | RCM (1)VISUAL CHECK | PM | 5/7/2024 | | |
| 20240705 | B43C-C-00008 | B-MR-600-P-4A | C&R OIL PURIFIER PUMP MOTOR | RCM (3)M REGREASE | PM | 5/7/2024 | | |
| 20240705 | B061-C-00019 | B-P-1132A | CR1 FEED PUMP | (1)W/CLEAN STRAINER FOR B-P-1132 | PM | 5/7/2024 | | Pump |
| 20240705 | B061-C-00018 | B-P-1132B | CR1 FEED PUMP | (1)W/CLEAN STRAINER FOR B-P-1132 | PM | 5/7/2024 | | Pump |
| 20240705 | B061-C-00018 | B-P-1132A | DGP EFFLUENT TRANSFER PUMP | (1)W/CLEAN STRAINER FOR B-P-1136 | PM | 5/7/2024 | | Pump |
| 20240705 | B061-C-00018 | B-P-1136S | DGP EFFLUENT TRANSFER PUMP | (1)W/CLEAN STRAINER FOR B-P-1136 | PM | 5/7/2024 | | Pump |
| 20240705 | B063-WK-00002 | B-P-1601A | FIRE MAIN PUMP | (1)WTEST RUN | PM | 5/7/2024 | | Pump |

| | | | | | | | | |
|----------|--------------|--------------------|---------------------------------------|---|----|----------|--|--------------|
| 20240705 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1)WTEST RUN | PM | 5/7/2024 | | Pump |
| 20240705 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1)WTEST RUN | PM | 5/7/2024 | | Pump |
| 20240705 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1)WTEST RUN | PM | 5/7/2024 | | Pump |
| 20240705 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1)WTEST RUN | PM | 5/7/2024 | | Pump |
| 20240705 | B18-C-00014 | B-P-3203A | SLUDGE TRANSFER PUMP | (1)CLEANING | PM | 5/7/2024 | | Pump |
| 20240705 | B49-C-00005 | B-P-3205A | STRIPPED CONDENSATE PUMP | (1)CLEANING | PM | 5/7/2024 | | Pump |
| 20240705 | B18A-C-00011 | B-P-3205S | LP CONDENSATE PUMP | (4)CLEANING & INSPECTION | PM | 5/7/2024 | | Pump |
| 20240705 | B49-C-00002 | B-PD-11260 | G-1122-V-1 | (1)CHECK & ADJUST (OUT-SOURCE) | PM | 5/7/2024 | | |
| 20240705 | B208-S-00014 | B-PSV-2630 | OUTLET V-263-P-1A | (2)INSPECTION & OVERHAUL PSV | PM | 5/7/2024 | | PSV |
| 20240705 | B42A-C-00010 | B-PSV-5400A | M-540 TO COOLD FLARE | (1)SET & CALIBRATE (PSV 2X) | PM | 5/7/2024 | | PSV |
| 20240705 | B063-C-00001 | B-P-1501B | FURNACE ID FAN#1 | RCM (1)M INSPECT & LUBRICATE | PM | 5/7/2024 | | |
| 20240705 | B106-S-00001 | B-P-1420 | FURNACE ID FAN | RCM (1)M INSPECT & LUBRICATE | PM | 5/7/2024 | | |
| 20240705 | B10C-S-00001 | B-P-1430 | FURNACE ID FAN | RCM (1)M INSPECT & LUBRICATE | PM | 5/7/2024 | | |
| 20240705 | B10D-S-00001 | B-P-1440 | FURNACE ID FAN | RCM (1)M INSPECT & LUBRICATE | PM | 5/7/2024 | | |
| 20240705 | B10E-S-00001 | B-P-1450 | FURNACE ID FAN | RCM (1)M INSPECT & LUBRICATE | PM | 5/7/2024 | | |
| 20240705 | B10F-S-00001 | B-P-1460 | FURNACE ID FAN | RCM (1)M INSPECT & LUBRICATE | PM | 5/7/2024 | | |
| 20240705 | B90-C-00063 | B-P-310S | ETHYLENE FURNACE ID FAN#5 | (1)JD Fan Lubricate, Inspection (Group.M) | PM | 5/7/2024 | | |
| 20240705 | B43C-C-00008 | B-R-600-P-4A | LUBE OIL PURIFIER | RCM (1)VISUAL INSPECTION | PM | 5/7/2024 | | |
| 20240705 | B90-C-00063 | B-RM-310S | ETHYLENE FURNACE ID FAN#5 MOTOR | (1)JD Fan Motor Inspection (Group.M) | PM | 5/7/2024 | | |
| 20240705 | B90-C-00063 | B-T-269 | DILUTION STEAM GENERATOR FEED EATER | (3)M CONDITION CHECK (OSL 2021-111) | IM | 5/7/2024 | | |
| 20240705 | B90-C-00094 | B-UPS1-A1 | UPS1 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/7/2024 | | |
| 20240705 | B90-C-00095 | B-UPS1-A2 | UPS1 (BYPASS) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/7/2024 | | |
| 20240705 | B90-C-00096 | B-UPS1-A3 | UPS2 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/7/2024 | | |
| 20240705 | B23A-C-00014 | B-AT-19001 | FUEL GAS CUSTODY INLET | (1)W/CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B13-C-00053 | B-CAP-1M1 | POWER CAPACITOR PANEL-1 | (1M)VISUAL INSPECTION | PM | 4/7/2024 | | |
| 20240704 | B13-C-00054 | B-CAP-1M2 | POWER CAPACITOR PANEL-2 | (1M)VISUAL INSPECTION | PM | 4/7/2024 | | |
| 20240704 | B1A-C-00062 | B-CRIT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2W)Visual & Condition Inspection | PM | 4/7/2024 | | |
| 20240704 | B13-C-00057 | B-EHT-001 | ELECTRICAL HEAT TRACING CONTROL PANEL | (1M)VISUAL INSPECTION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-F-11214 | P-2311 DISCHARGE | (3)M CONDITION CHECK (OSL 2021-591) | IM | 4/7/2024 | | |
| 20240704 | B12-C-00048 | B-GAS-DETECTOR-BV | Grouping for Gas Detector BV | (4)MVISUAL GAS DETECTOR PLANT#B(OUT-SOURCE) | PM | 4/7/2024 | | Gas Detector |
| 20240704 | B12-C-00048 | B-GD-486001 | Gas detector Raffinate metering skid | (4)MVISUAL GAS DETECTOR PLANT#B(OUT-SOURCE) | PM | 4/7/2024 | | Gas Detector |
| 20240704 | B12-C-00048 | B-GD-486002 | Gas detector Raffinate metering skid | (4)MVISUAL GAS DETECTOR PLANT#B(OUT-SOURCE) | PM | 4/7/2024 | | Gas Detector |
| 20240704 | B38-S-00002 | B-MOTOR-EP-NPA-003 | GROUPING TAG FOR MOTOR NPA AREA | (3)M LUBRICATION | PM | 4/7/2024 | | Motor |
| 20240704 | B61-C-00126 | B-P-1142C | CONTAMINATED STORM WATER PUMP | (6M)REGREASE | PM | 4/7/2024 | | Pump |
| 20240704 | B063-C-00024 | B-P-1601A | FIRE MAIN PUMP | RCM (1)PERFORMANCE TEST | PM | 4/7/2024 | | Pump |
| 20240704 | B063-C-00024 | B-P-1601B | FIRE MAIN PUMP | RCM (1)PERFORMANCE TEST | PM | 4/7/2024 | | Pump |
| 20240704 | B063-C-00024 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | RCM (1)PERFORMANCE TEST | PM | 4/7/2024 | | Pump |
| 20240704 | B063-C-00024 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | RCM (1)PERFORMANCE TEST | PM | 4/7/2024 | | Pump |
| 20240704 | B063-C-00024 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | RCM (1)PERFORMANCE TEST | PM | 4/7/2024 | | Pump |
| 20240704 | B063-C-00024 | B-P-16003 | DISCHARGE PRESSURE CW FROM P-1601C | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16003 | DISCHARGE PRESSURE CW FROM P-1601D | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16004 | DISCHARGE PRESSURE CW FROM P-1601S | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16011 | DISCHARGE PRESSURE OF P-1601A | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16012 | DISCHARGE PRESSURE OF P-1601B | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16013 | DISCHARGE PRESSURE OF P-1601C | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16041 | DISCHARGE PRESSURE OF P-1601D | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16021 | DISCHARGE PRESSURE FW FROM P-1601A | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16061 | DISCHARGE PRESSURE FW FROM P-1602A | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-P-16071 | DISCHARGE PRESSURE FW FROM P-1602S | RCM (1)CALIBRATION | PM | 4/7/2024 | | |
| 20240704 | B063-C-00024 | B-PSV-15011 | DISCHARGE LINE P-1601A | RCM (1)INSPECTION & OVERHAUL | PM | 4/7/2024 | | PSV |

| | | | | | | | |
|----------|--------------|-------------------|---|----------------------------------|----|----------|-------|
| 20240704 | B063-C-00034 | B-PSV-16021 | DISCHARGE LINE OF P-1601B | RCM (1)INSPECTION & OVERHAUL | PM | 4/7/2024 | PSV |
| 20240704 | B063-C-00024 | B-PSV-16021 | DISCHARGE LINE P-1601C | RCM (1)INSPECTION & OVERHAUL | PM | 4/7/2024 | PSV |
| 20240704 | B063-C-00024 | B-PSV-16041 | DISCHARGE LINE P-1601D | RCM (1)INSPECTION & OVERHAUL | PM | 4/7/2024 | PSV |
| 20240704 | B063-C-00024 | B-PSV-16051 | DISCHARGE LINE P-1601S | RCM (1)INSPECTION & OVERHAUL | PM | 4/7/2024 | PSV |
| 20240704 | B050-C-00003 | B-R-1135A | AIR-STREAM BLOWERS | (6M)LUBRICATION | PM | 4/7/2024 | |
| 20240704 | B050-C-00004 | B-R-1135S | AIR-STREAM BLOWERS | (6M)LUBRICATION | PM | 4/7/2024 | |
| 20240704 | B050-C-00002 | B-R-1155 | Q-1155 Blower | (6M)LUBRICATION | PM | 4/7/2024 | |
| 20240704 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (MUNGNATE) | (1)DINSPECTION | PM | 4/7/2024 | |
| 20240704 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYRAWIN) | (1)DINSPECTION | PM | 4/7/2024 | |
| 20240704 | B20-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (1)DINSPECTION | PM | 4/7/2024 | |
| 20240704 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1)DINSPECTION | PM | 4/7/2024 | |
| 20240704 | B4A-C-00029 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2)WINSPECTION | PM | 4/7/2024 | |
| 20240704 | B063-C-00024 | B-SECUR-TASK04 | FOR PM: CHECK A CO2 SYSTEM MA | (1)VISUAL INSPECTION | PM | 4/7/2024 | |
| 20240704 | B13-C-00058 | B-SU7-ERMKS | ELECTRICAL REMOTE MONITORING & CONTROL S | (1)VISUAL INSPECTION | PM | 4/7/2024 | |
| 20240704 | B13-S-00011 | B-SWGR-08P | Grouping for SWGR 08P | (3)MINSPECT&CONDITION CHECK | PM | 4/7/2024 | |
| 20240704 | B11-C-00078 | B-V-3846-P-3A | BICODICE INJECTION PUMPS | (6M) CLEANING | PM | 4/7/2024 | |
| 20240704 | B11-C-00079 | B-V-3846-P-3S | BICODICE INJECTION PUMPS | (6M) CLEANING | PM | 4/7/2024 | |
| 20240703 | B53-C-00037 | B-AT-22177 | ISO14000 PH DISCHARGE LINE G-2217-P-4A/B | (1)MSET&CALIBRATE | PM | 3/7/2024 | |
| 20240703 | B12-C-00663 | B-AT-400001 | 1, 3 Butadiene in Air GCG | (1)MSET&CALIBRATE | PM | 3/7/2024 | |
| 20240703 | B12-C-00667 | B-AT-404801 | BUTADIENE GCG | (1)MSET&CALIBRATE | PM | 3/7/2024 | |
| 20240703 | B007-C-00003 | B-AT-9211 | ISO14000, SUMP Q-920 TO Q-1145 | (1)MSET&CALIBRATE | PM | 3/7/2024 | |
| 20240703 | B90C-00002 | B-E-F-11 | MASTER FIRE ALARM PANEL AT NEW CCB CONTR | (1)MCO2 SYSTEM CHECK | PM | 3/7/2024 | |
| 20240703 | B90C-00002 | B-E-F-12 | LOCAL FIRE ALARM PANEL AT SUB.2 | (1)MCO2 SYSTEM CHECK | PM | 3/7/2024 | |
| 20240703 | B90C-00002 | B-E-F-13 | LOCAL FIRE ALARM PANEL AT SUB. PROCESS | (1)MCO2 SYSTEM CHECK | PM | 3/7/2024 | |
| 20240703 | B061-S-00010 | B-G-1144-A-2A | FINAL CLARIFIER AGITATOR | RCM- (2M)INSPECTION | IM | 3/7/2024 | |
| 20240703 | BNA-C-00001 | B-GE-1M | GROUPING FOR PM GC 1 Month | (1)MSET & CALIBRATION | PM | 3/7/2024 | |
| 20240703 | B4B-C-00020 | B-IRP-BV | IRP GROUPING FOR BV | (1)MINSPECTION | PM | 3/7/2024 | |
| 20240703 | B06F-C-00064 | B-M-19020 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1)MUPDATE N2, CO2, REL. DENSITY | PM | 3/7/2024 | |
| 20240703 | B090-C-00009 | B-MCC-SUB1 | MCC FOR PLUG-IN MCCB | (2M)Thermocan & Inspection | IM | 3/7/2024 | |
| 20240703 | B003-C-00028 | B-MCC-TANK | MCC FOR PLUG-IN MCCB | (2M)Thermocan & Inspection | IM | 3/7/2024 | |
| 20240703 | B002-C-00002 | B-MCC-WASTE | MCC FOR PLUG-IN MCCB | (2M)Thermocan & Inspection | IM | 3/7/2024 | |
| 20240703 | B90-C-00177 | B-MOTOR-B1-1237BC | MOTOR GROUPING FOR B1-BC | (1)MCLEANING & INSPECTION | PM | 3/7/2024 | Motor |
| 20240703 | B90-C-00180 | B-MOTOR-B1-7A | MOTOR GROUPING FOR B1-A | (1)MCLEANING AND INSPECTION. | PM | 3/7/2024 | Motor |
| 20240703 | B90-C-00174 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BE-A | (1)MCLEANING & INSPECTION | PM | 3/7/2024 | Motor |
| 20240703 | B90-C-00186 | B-MOTOR-BE-0B | MOTOR GROUPING FOR BE-B | (1)MCLEANING AND INSPECTION. | PM | 3/7/2024 | Motor |
| 20240703 | B90-C-00186 | B-MOTOR-C5B1-6BC | MOTOR GROUPING FOR C5B1-BC | (1)MCLEANING AND INSPECTION. | PM | 3/7/2024 | Motor |
| 20240703 | B4B-C-00020 | B-P-1206A | STRIPPED CONDENSATE PUMP | (1)VCLEANING | PM | 3/7/2024 | Pump |
| 20240703 | B4B-C-00020 | B-P-1206A | LIGHT OIL RECOVERY PUMP | (1)MINSPECTION&LUBRICATION | PM | 3/7/2024 | Pump |
| 20240703 | B90-C-00020 | B-SD-BC-1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.1 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B90-C-00020 | B-SD-BC-2 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.2 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B90-C-00021 | B-SD-BC-2M1 | DISTRIBUTION PANEL OF BC 110VDC SUB.7 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B90-C-00020 | B-SD-BC-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B90-C-00020 | B-SD-BC-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.1 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B4B-C-00020 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B005-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.6 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B005-C-00011 | B-SD-F4 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B005-C-00011 | B-SD-F5 | DISTRIBUTION PANEL OF BC 24VDC SUB.6 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B90-C-00021 | B-SD-UPS-2M1 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B90-C-00021 | B-SD-UPS-2M2 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/7/2024 | |
| 20240703 | B12-C-00059 | B-UPS-ZEE-BV | GROUPING FOR UPS 220 KVA | (1M)INSPECT & ADJUST | PM | 3/7/2024 | |

| | | | | | | | |
|----------|--------------------|--------------------|--|--|----|----------|------------|
| 20240701 | BH11-S-00003 | B-CALC/PM2 | Grouping Tag for Causal Pump 1-4/2 | (1)M/CLEAN | PM | 1/7/2024 | |
| 20240701 | B00-C-00075 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1M) Function and Record test | PM | 1/7/2024 | |
| 20240701 | B00-C-00206 | B-CCTV-F5 | GROUPING TAG FOR FIRE STATION | (1M) Function and Record test | PM | 1/7/2024 | |
| 20240701 | B00-C-00077 | B-CCTV-GATE | GROUPING TAG FOR GATE | (1M) Function and Record test | PM | 1/7/2024 | |
| 20240701 | B00-C-00078 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/7/2024 | |
| 20240701 | B00-C-00079 | B-CCTV-WH | GROUPING TAG FOR WARE HOUSE | (1M) Function and Record test | PM | 1/7/2024 | |
| 20240701 | B00-C-00080 | B-CCTV-W5 | GROUPING TAG FOR WORK SHOP | (1M) Function and Record test | PM | 1/7/2024 | |
| 20240701 | B00-C-00009 | B-DCS-P1 | DCS HONEYWELL TDC3000/EXPERION | (2M)REMOVE HISTORY FILE | PM | 1/7/2024 | |
| 20240701 | B00-C-00009 | B-DCS-P1-ORP | DCS HONEYWELL TDC3000/EXPERION RS11.1 | (2M)REMOVE HISTORY FILE | PM | 1/7/2024 | |
| 20240701 | B50-C-00016 | B-G-1305-P-1 | K.O. DRUM PUMP | ROH/INSPECTOR TERM PRESERVATION | PM | 1/7/2024 | |
| 20240701 | B-INSF-CM-OLE2-1-A | | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/7/2024 | |
| 20240701 | B-INSF-CM-OLE2-1-N | | Condition monitor for inspect General | Vibration and Condition check | IM | 1/7/2024 | |
| 20240701 | B-INSF-CM-OLE2-2-A | | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/7/2024 | |
| 20240701 | B-INSF-CM-OLE2-2-N | | Condition monitor for inspect General | Vibration and Condition check | IM | 1/7/2024 | |
| 20240701 | B-INSF-CM-OLE2-3-A | | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/7/2024 | |
| 20240701 | B-INSF-CM-OLE2-3-N | | Condition monitor for inspect General | Vibration and Condition check | IM | 1/7/2024 | |
| 20240701 | BNA-C-00037 | B-LOCAL-2H | GROUPING FOR PM LOCAL ANALYZER 2 Month | (2M)SET/CALIBRATE | PM | 1/7/2024 | |
| 20240701 | BNA-C-00038 | B-LOCAL-3H | GROUPING FOR PM LOCAL ANALYZER 3 Month | (3M)SET/CALIBRATE | PM | 1/7/2024 | |
| 20240701 | B20C-C-00008 | B-LT-3108 | FRESH CAUSTIC MIX TANK | (1Y)SET/CALIBRATION(OUT-SOURCE) | PM | 1/7/2024 | |
| 20240701 | B02S-S-00001 | B-MOTOR-EO-008 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION | PM | 1/7/2024 | Motor |
| 20240701 | B30S-S-00001 | B-MOTOR-EP-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION | PM | 1/7/2024 | Motor |
| 20240701 | B52B-S-00114 | B-MR-WINCH-01 | WINCH PLANT 1-4 | (3M)CLEANING & INSPECTION | PM | 1/7/2024 | |
| 20240701 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Rit sudion screen cleaning | PM | 1/7/2024 | Pump |
| 20240701 | B11-C-00066 | B-P-3403A | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE to Bearing Mechanical Seal | PM | 1/7/2024 | Pump |
| 20240701 | B11-C-00067 | B-P-3403S | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE to Bearing Mechanical Seal | PM | 1/7/2024 | Pump |
| 20240701 | BNA-C-00090 | B-PH-4910S | BUTENE-1 PRODUCT TRANSFER PUMP MOTOR | (3M)INSPECTION | PM | 1/7/2024 | Motor |
| 20240701 | B19A-C-00021 | B-R-300-P-35 | WASH OIL INJECTION PUMP | (1Y)CLEAN & LUBRICATE | PM | 1/7/2024 | |
| 20240701 | B60A-C-00001 | B-R-3001 | EXPORT FUEL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 1/7/2024 | Compressor |
| 20240701 | B60B-C-00002 | B-R-3002 | EXPORT FUEL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 1/7/2024 | Compressor |
| 20240701 | B12-C-00001 | B-R-4031 | RECYCLE GAS COMPRESSOR | (1Y)VIBRATION CHECK | PM | 1/7/2024 | Compressor |
| 20240701 | B12-C-00006 | B-R-4301 | BUTENE-1 FRACTIONATOR COMPRESSOR | (3M)VIBRATION CHECK | PM | 1/7/2024 | Compressor |
| 20240701 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 1/7/2024 | |
| 20240701 | BNA-C-00033 | B-SECUR-TASK08 | FOR PM : INSPECTION FM-200 SYSTEMS | (1M) Visual Inspection FM-200 system (RA | PM | 1/7/2024 | |
| 20240701 | B00-C-00068 | B-SECUR-TASK51 | Smoke / Heat detector system : Control a | (1M)Visual Inspection | PM | 1/7/2024 | |
| 20240701 | B06A-C-00005 | B-T-269 | DILUTION STEAM GENERATOR FEED EATER | (3M) CONDITION CHECK (OSL 2020-030) | IM | 1/7/2024 | |
| 20240701 | B0P3-C-00015 | B-TX-ISLBP1H4 | GROUPING TAG FOR TX ISLBP1H4 | (4Y) SET/CALIBRATION(OUT-SOURCE)-Hot | PM | 1/7/2024 | |
| 20240701 | B3-C-00003 | B-V-4008 | PRESSURE SWING ADSORPTION UNIT NO. 2 | (3M)INSPECTION | IM | 1/7/2024 | |
| 20240701 | B3-C-00004 | B-V-4008 | PRESSURE SWING ADSORPTION UNIT NO. 3 | (3M)INSPECTION | IM | 1/7/2024 | |
| 20240701 | B-WINCH-01 | | WINCH PLANT 1-4 | (1Y)INSPECTION & TEST | IM | 1/7/2024 | |
| 20240701 | B3-C-00001 | B-WV-4613 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00001 | B-WV-4613 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00002 | B-WV-4615 | PSA 2 SEQ.; E1/R1 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00002 | B-WV-4615 | PSA 2 SEQ.; E1/R1 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00003 | B-WV-4623 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00003 | B-WV-4623 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00003 | B-WV-4623 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00004 | B-WV-4625 | PSA 2 SEQ.; E1/R1 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00004 | B-WV-4625 | PSA 2 SEQ.; E1/R1 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00005 | B-WV-4631 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00005 | B-WV-4631 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00005 | B-WV-4633 | PSA 2 SEQ.; E1/R1 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00006 | B-WV-4635 | PSA 2 SEQ.; E1/R1 | (6M) Basic Maintenance | PM | 1/7/2024 | |

| | | | | | | | |
|----------|--------------|----------------|---|---|----|-----------|------------|
| 20240701 | B3-C-00006 | B-WV-4635 | PSA 2 SEQ.; E1/R1 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00007 | B-WV-4643 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00007 | B-WV-4643 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00008 | B-WV-4645 | PSA 2 SEQ.; E1/R1 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00008 | B-WV-4645 | PSA 2 SEQ.; E1/R1 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00009 | B-WV-4653 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00009 | B-WV-4653 | PSA 2 SEQ.; PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B3-C-00010 | B-WV-4655 | PSA 2 SEQ.; E1/R1 | (6M) Basic Maintenance | PM | 1/7/2024 | |
| 20240701 | B3-C-00010 | B-WV-4655 | PSA 2 SEQ.; E1/R1 | (3M) Basic Inspection | PM | 1/7/2024 | |
| 20240701 | B00-C-00127 | B-1034-HDT-001 | All Heat Detector for Fire Alarm System | (6M)Heat Detector Visual Inspection | IM | 30/5/2024 | |
| 20240701 | B00-C-00128 | B-1034-SDT-001 | All Smoke Detector for Fire Alarm OLE2/1 | (6M)Function Test Smoke and Heat detector | IM | 30/5/2024 | |
| 20240630 | B11-C-00084 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5) | (6M) Deluge Valve Spray Test | PM | 30/5/2024 | |
| 20240630 | B11-C-00082 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5) | (3M) Deluge Valve Function Test | PM | 30/5/2024 | |
| 20240630 | B11-C-00085 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1) | (6M) Deluge Valve Spray Test | PM | 30/5/2024 | |
| 20240630 | B11-C-00083 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1) | (3M) Deluge Valve Function Test | PM | 30/5/2024 | |
| 20240630 | B11-S-00027 | B-1035-FHH-001 | Fire Hose House for OLE2/2 | (6M) Fire Hose Box Test | IM | 30/5/2024 | |
| 20240630 | B11-S-00028 | B-1035-FHH-001 | Fire Hose House for OLE2/2 | (6M) Fire Hose Box Visual Inspection | IM | 30/5/2024 | |
| 20240630 | B11-S-00029 | B-1035-FHH-001 | Post Indicator Valve for OLE2/2 | (6M) Post Indicator Valve Exercise | IM | 30/5/2024 | |
| 20240630 | B12-C-00782 | B-1036-CD-001 | CO2 Portable for OLE2/3 | (1M)CO2 Portable Visual Inspection | IM | 30/5/2024 | |
| 20240630 | B12-C-00788 | B-1036-DC-001 | Dry Chemical for OLE2/3 | (1M)Dry Chemical Visual Inspection | IM | 30/5/2024 | |
| 20240630 | B12-C-00798 | B-1036-FA-001 | All Manual Fire Alarm for OLE2/3 | (1M)Manual Fire Alarm Visual Test | IM | 30/5/2024 | |
| 20240630 | B12-C-00804 | B-1036-FH-001 | FM200 for Rack Room (OLE2/3) | (1M)FM200 System Visual Inspection | IM | 30/5/2024 | |
| 20240630 | B19A-C-00039 | B-R-300 | CRACKED GAS COMPRESSOR | (1Y)SPECIAL TOOL INSPECTION MAJOR R/R/T | PM | 30/5/2024 | Compressor |
| 20240630 | B19A-C-00039 | B-R-300 | CRACKED GAS COMPRESSOR | (1Y)SPECIAL TOOL INSPECTION MAJOR R/R/T | PM | 30/5/2024 | Compressor |
| 20240630 | B19A-C-00039 | B-R-300 | CRACKED GAS COMPRESSOR | (1Y)SPECIAL TOOL INSPECTION MAJOR R/R/T | PM | 30/5/2024 | Compressor |
| 20240630 | B19A-C-00039 | B-R-300 | CRACKED GAS COMPRESSOR | (1Y)SPECIAL TOOL INSPECTION MAJOR R/R/T | PM | 30/5/2024 | Compressor |
| 20240630 | B19A-C-00039 | B-R-300 | CRACKED GAS COMPRESSOR | (1Y)SPECIAL TOOL INSPECTION MAJOR R/R/T | PM | 30/5/2024 | Compressor |
| 20240629 | B00-C-00130 | B-1034-CD-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B00-C-00131 | B-1034-DC-001 | Dry Chemical for OLE2/1 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/5/2024 | |
| 20240629 | B00-C-00129 | B-1034-DC-002 | Dry Chemical for Admin | (1M)INSPECTION | IM | 29/5/2024 | |
| 20240629 | B00-S-00001 | B-1034-DV-001 | Deluge Valve for OLE OLE2/1Group 1 (-DV | (6M) Deluge Valve Spray Test | PM | 29/5/2024 | |
| 20240629 | B00-S-00001 | B-1034-DV-001 | Deluge Valve for OLE OLE2/1Group 1 (-DV | (1M) Deluge Valve Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B00-S-00001 | B-1034-DV-001 | Deluge Valve for OLE OLE2/1Group 1 (-DV | (3M) Deluge Valve Function Test | PM | 29/5/2024 | |
| 20240629 | B00-S-00002 | B-1034-DV-002 | Deluge Valve for OLE OLE2/1Group 2 (-DV | (3M) Deluge Valve Function Test | PM | 29/5/2024 | |
| 20240629 | B00-S-00003 | B-1034-DV-003 | Deluge Valve for OLE OLE2/1Group 3 (-DV | (3M) Deluge Valve Function Test | PM | 29/5/2024 | |
| 20240629 | B00-S-00004 | B-1034-DV-004 | Deluge Valve for OLE OLE2/1Group 4 (-DV | (3M) Deluge Valve Function Test | PM | 29/5/2024 | |
| 20240629 | B00-S-00005 | B-1034-DV-005 | Deluge Valve for OLE OLE2/1Group 5 (-DV | (3M) Deluge Valve Function Test | PM | 29/5/2024 | |
| 20240629 | B00-S-00006 | B-1034-DV-006 | Deluge Valve for OLE OLE2/1Group 6 (-DV | (3M) Deluge Valve Function Test | PM | 29/5/2024 | |
| 20240629 | B00-C-00133 | B-1034-FA-001 | All Manual Fire Alarm Visual Inspect | (1M) Manual Fire Alarm Visual Inspect | IM | 29/5/2024 | |
| 20240629 | B00-C-00150 | B-1034-FDC-001 | Fire Department Connection for Admin | (1M)Fire Department Connection Visual | IM | 29/5/2024 | |
| 20240629 | B00-C-00152 | B-1034-FHH-001 | Fire Hose House for OLE2/1 | (1M)Fire Hose Box Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B00-C-00154 | B-1034-FHH-001 | Fire Hose Reel and Cabinet for Admin | (1M)Fire Hose and Cabinet Reel Visual | IM | 29/5/2024 | |
| 20240629 | B00-C-00156 | B-1034-FHH-001 | Fixed Monitor Valve for OLE2/1 | (1M)Fixed Monitor Valve Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B00-C-00158 | B-1034-FHH-001 | Fixed Monitor Valve for OLE2/1 | (1M)Fixed Monitor Valve Visual Insp | IM | 29/5/2024 | |
| 20240629 | B00-C-00159 | B-1034-FHH-001 | Fixed Monitor Valve for OLE2/1 | (1M)Fixed Monitor Valve Visual Insp | IM | 29/5/2024 | |
| 20240629 | B11-C-00116 | B-1034-WDC-001 | Wheeled Fire Extinguishers for OLE2/1 | (1M)Dry Chemical Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B00-C-00203 | B-1034-WH-001 | Water Hydrant for OLE2/1 | (1M)Water Hydrant Visual Inspection | IM | 29/5/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|-----------|--------------|
| 20240629 | B00-C-00205 | B-1034-WHM-001 | Water Hydrant with Monitor for OLE2/1 | (1M)Water Hydrant Monitor Visual Inspect | IM | 29/5/2024 | |
| 20240629 | B11-C-00086 | B-1035-CD-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B11-C-00087 | B-1035-OC-001 | Dry Chemical for OLE2/2 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/5/2024 | |
| 20240629 | B11-C-00088 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (1M) Deluge Valve Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B11-C-00089 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (1M) Deluge Valve Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B11-C-00090 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/5/2024 | |
| 20240629 | B11-S-00025 | B-1035-WH-001 | Water Hydrant for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 29/5/2024 | |
| 20240629 | B11-S-00026 | B-1035-WHM-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant Monitor Visual Inspect | IM | 29/5/2024 | |
| 20240629 | B12-C-00721 | B-1036-PV-001 | Post Indicator Valve for OLE2/3 | (1M)Post Indicator Valve Visual Insp | IM | 29/5/2024 | |
| 20240629 | B007-C-00002 | B-BLDG-SUB3 | Substation No.3 Building | (1Y)INSPECTION BUILDING UP ROOF FOR BLDG | IM | 29/5/2024 | |
| 20240629 | B007-C-00005 | B-BLDG-SUB5 | Substation No.5 Building | (1Y)INSPECTION BUILDING UP ROOF FOR BLDG | IM | 29/5/2024 | |
| 20240629 | B002-C-00001 | B-BLDG-WW05 | C/T & WWT MCC Room Building | (1Y)INSPECTION BUILDING UP ROOF FOR BLDG | IM | 29/5/2024 | |
| 20240629 | BHS-C-00008 | B-M-3103 | 3 FURNACE SHIP STEAM | (3Y)STEAM DRUM INSPECTION BY LAW GROUP E | PM | 29/5/2024 | |
| 20240629 | BHS-C-00008 | B-M-3103 | 3 FURNACE SHP STEAM | (3Y)SET/CALIBRATE STM DRUM BY LAW #2 | PM | 29/5/2024 | |
| 20240629 | BHS-C-00008 | B-PSV-310301 | HIGH PRESSURE STEAM DRUM M-3103 TOP | (3Y)INSPECTION PSV M-3103(GROUP"E") | PM | 29/5/2024 | PSV |
| 20240629 | BHS-C-00008 | B-PSV-310302 | HIGH PRESSURE STEAM DRUM M-3103 TOP | (3Y)INSPECTION PSV M-3103(GROUP"E") | PM | 29/5/2024 | PSV |
| 20240629 | BHS-C-00008 | B-PSV-310303 | SUPER HP STEAM FROM F-3103 FURNACE OUTLE | (3Y)INSPECTION PSV M-3103(GROUP"E") | PM | 29/5/2024 | PSV |
| 20240629 | B11-C-00142 | B-SCBA-001 | Self-contained breathing apparatus for | (1M)SCBA Visual Inspection | IM | 29/5/2024 | |
| 20240629 | BHS-C-00056 | B-WM-1516 | WATER MONITOR AREA FIRE TRAINING | (6M)WM FIRE TRAINING LUBRICATION | PM | 29/5/2024 | |
| 20240628 | B12-C-00789 | B-1036-DV-001 | Deluge Valve for Grouping 2(OLE2/2)7Tas | (1M)Deluge Valve Visual Inspection | IM | 29/5/2024 | |
| 20240628 | B12-C-00793 | B-1036-DV-002 | Deluge Valve for Grouping 2(OLE2/2)7Tas | (1M)Deluge Valve Visual Inspection | IM | 29/5/2024 | |
| 20240628 | B12-C-00797 | B-1036-DV-003 | Deluge Valve for Grouping 3(OLE2/3)6Tas | (1M)Deluge Valve Visual Inspection | IM | 29/5/2024 | |
| 20240628 | B12-C-00799 | B-1036-FHH-001 | Fire Hose House for OLE2/3 | (1M)Fire Hose Box Visual Inspection | IM | 29/5/2024 | |
| 20240628 | B12-C-00778 | B-1036-WHM-001 | Water Hydrant for OLE2/3 | (1M)Water Hydrant Visual Inspection | IM | 29/5/2024 | |
| 20240628 | B12-C-00779 | B-1036-WHM-001 | Water Hydrant with Monitor for OLE2/3 | (1M)Water Hydrant Monitor Visual Inspect | IM | 29/5/2024 | |
| 20240628 | B52A-C-00031 | B-AT-11431 | CV RETURN FR HEADER | (6M)SET/CALIBRATION | PM | 29/5/2024 | |
| 20240628 | B52A-C-00032 | B-AT-12044 | TOX TC of CWS header | (6M)SET/CALIBRATION | PM | 29/5/2024 | |
| 20240628 | B3A-C-00005 | B-AT-2415 | GAS DENSITY ANALYZER HEADER | (6M)SET & CALIBRATE (W/O PT) B-2401 | PM | 29/5/2024 | Gas Detector |
| 20240628 | B63-C-00103 | B-DV-1623A | CX2/3 OFF SPEC TK Q-1537 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | PM | 29/5/2024 | |
| 20240628 | B63-C-00103 | B-DV-1623B | CX2/3 OFF SPEC TK Q-1537 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | PM | 29/5/2024 | |
| 20240628 | B63-C-00103 | B-DV-1624A | PROPELLENT PRODUCT TK Q-1535 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | PM | 29/5/2024 | |
| 20240628 | B63-C-00103 | B-DV-1624B | PROPELLENT PRODUCT TK Q-1535 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | PM | 29/5/2024 | |
| 20240628 | B63-C-00007 | B-DV-1627A | MIXED CI TK Q-1540 DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 29/5/2024 | |
| 20240628 | B63-C-00007 | B-DV-1627B | MIXED TK Q-1540 DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 29/5/2024 | |
| 20240628 | B63-C-00007 | B-DV-1627C | MIXED CI TK Q-1540 DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 29/5/2024 | |
| 20240628 | B13-C-00025 | B-EL-ORP | Grouping For EXT LIGHTING ORP | (3M)INSPECT, VERIFY%CHECK | PM | 29/5/2024 | |
| 20240628 | B38-C-00035 | B-EPISIRI0 | GROUPING FOR MCC. AS TAGS | (3M)INSPECT, CONTROL WIRING/CONTACT RELAY | PM | 29/5/2024 | |
| 20240628 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/5/2024 | |
| 20240628 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/5/2024 | |
| 20240628 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/5/2024 | |
| 20240628 | B12-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 29/5/2024 | |
| 20240628 | B90-C-00005 | B-GS-2E-S | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 29/5/2024 | |
| 20240628 | B90-C-00005 | B-GS-3M-F | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 29/5/2024 | |
| 20240628 | B90-C-00140 | B-INTERCOM-GP2-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 29/5/2024 | |
| 20240628 | B90-C-00097 | B-MCC-ED-21 | Grouping Tag for MCC Sub#4 (MCC-21) | (3M) Inspect & Adjust | PM | 29/5/2024 | |
| 20240628 | B90-C-00134 | B-MCC-ED-8 | Grouping Tag for 6.6KV MCC Sub#5 | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 29/5/2024 | |
| 20240628 | B13-C-00002 | B-MW-2108 | QUENCH OIL CIRCULATION PUMP MOTOR | (1Y)LUBRICATION | PM | 29/5/2024 | Motor |
| 20240628 | B051-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 29/5/2024 | Pump |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|------------|
| 20240624 | 963-C-00058 | B-WM-1607 | WATER MONITOR AREA UTILITY | (6W)WM UTILITY LUBRICATION | PM | 24/5/2024 | |
| 20240624 | 963-C-00058 | B-WM-1603 | WATER MONITOR AREA UTILITY | (6W)WM UTILITY LUBRICATION | PM | 24/5/2024 | |
| 20240624 | 963-C-00058 | B-WM-1604 | WATER MONITOR AREA UTILITY | (6W)WM UTILITY LUBRICATION | PM | 24/5/2024 | |
| 20240623 | 813Z-C-00112 | B-P-150 | GHU STRIPPER TOWER | (3M) CONDITION CHECK (OSL 2022-171) | IM | 23/5/2024 | |
| 20240623 | 961-C-00090 | B-AT-11391 | ISO14000, G-1127-R-1 TO Q-1139 | (2M)COD ANALYZER INSPECT.(OUT-SOURCE) | PM | 23/5/2024 | |
| 20240623 | 817Z-C-00031 | B-AT-4707U | LP CONDENSATE TOC | (1M)SET & CALIBRATE | PM | 23/5/2024 | |
| 20240623 | 810E-C-00044 | B-F-150 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-144) | IM | 23/5/2024 | Furnace |
| 20240623 | 810G-C-00040 | B-F-170 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-140) | IM | 23/5/2024 | Furnace |
| 20240623 | 9060-C-00054 | B-G-1122-V-1 | VAPOR SCRUBBER | (3M) CONDITION CHECK (OSL 2022-170) | IM | 23/5/2024 | |
| 20240623 | 9003-C-00030 | B-HV-22008 | HP STM TO PT-220A TURB | (3M) CONDITION CHECK (OSL 2022-174) | IM | 23/5/2024 | |
| 20240623 | 9007-C-00022 | B-LV-9450 | HP FLASH DRUM | (2M) CONDITION CHECK (OSL 2022-173) | IM | 23/5/2024 | |
| 20240623 | 802A-C-00018 | B-P-P-12810 | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2022-172) | IM | 23/5/2024 | Pump |
| 20240623 | 802A-C-00018 | B-P-12025 | SUBSTRATE FILTR. BACKWASH SUMP PUMP | (3M)REGREASE | PM | 23/5/2024 | Pump |
| 20240623 | 811Z-C-00089 | B-P-4056 | SOLVENT SLOPS PUMP | (3M) REGREASE | PM | 23/5/2024 | Pump |
| 20240623 | 9003-C-00087 | B-PIPE1-SCL | LINE STEAM CONDENSATE - LP DLE 2-1 | (3M) CONDITION CHECK (OSL 2022-175) | IM | 23/5/2024 | |
| 20240623 | 8478-C-00054 | B-PSV-15341A | T-1534 TO HOT FLARE | (3M) CONDITION CHECK (OSL 2022-143) | IM | 23/5/2024 | PSV |
| 20240623 | 9061-C-00020 | B-Q-1169 | OILY WASTE WATER SUMP | (3M) CONDITION CHECK (OSL 2022-141) | IM | 23/5/2024 | |
| 20240623 | 8578-C-00140 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-167) | IM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207A | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207B | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207C | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207D | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207E | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207F | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207G | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 8H8-C-00024 | B-R-3207H | Quench Water Air Cooler Fan | (3M)REGREASE | PM | 23/5/2024 | |
| 20240623 | 809C-C-00005 | B-T-050A | FRN. FEED QW. HEATERS | (3M) CONDITION CHECK (OSL 2022-165) | IM | 23/5/2024 | |
| 20240622 | 9091-C-00025 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET&CALIBRATE | PM | 22/5/2024 | |
| 20240622 | BH13-C-00062 | BAT-3311003 | MOISTURE ANALYZER TRANSMITTER FOR M-3301 | (1M)MOISTURE ANALYZER AMETEX | PM | 22/5/2024 | |
| 20240622 | B46-C-00024 | B-CCTV-GP2-BV | CCTV Grouping Tag BV | (3M)FUNCTION TEST & EXERCISE | PM | 22/5/2024 | |
| 20240622 | 8090-S-00001 | B-G-1350S-R-1 | ASSIST AIR BLOWER | RCM-(1M) VISUAL INSPECTION | IM | 22/5/2024 | |
| 20240622 | 890-S-00009 | B-PM-3801S | BFW PUMP MOTOR | (1M)CLEANING AND INSPECTION, | PM | 22/5/2024 | Motor |
| 20240622 | 903Z-C-00001 | B-PW-4116 | PSA BY PASS | (1Y)VISUAL INSPECTION BEFORE REPAIRING | PM | 22/5/2024 | |
| 20240622 | 818A-C-00033 | B-RV-3300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) INSPECT TURBINE EXPANSION JOINT | PM | 22/5/2024 | Compressor |
| 20240622 | 818Z-C-00033 | B-RV-3300 | CRACK TYPE TRANSFER | (3M)CONDITION CHECK | PM | 22/5/2024 | |
| 20240621 | 8076-C-00044 | B-BLOCK-VALVE-402 | BV FOR FM SC, SEC 12 FLUSHING OUT TO OPE | (5M)LUBRICATION | PM | 21/5/2024 | |
| 20240621 | 9001-C-00014 | B-CV-63 | GROUPING TAG FOR CONTROL VALVE | (6M)LUBRICATION (GREASE NO. G-23) | PM | 21/5/2024 | |
| 20240621 | 8025-C-00035 | B-CV-64 | GROUPING TAG FOR CONTROL VALVE GROUP-4 | (6M)LUBRICATION (GREASE NO. G-23) | PM | 21/5/2024 | |
| 20240621 | 863-C-00106 | B-DV-1610 | PROPYLENE DEBIT PUMPS DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 21/5/2024 | |
| 20240621 | 863-C-00106 | B-DV-1612 | C3 RECYCLE PUMPS DELUGE VALVE | (6M)DV HOT LUBRICATION & INSPECTION | IM | 21/5/2024 | |
| 20240621 | 863-C-00005 | B-DV-1618 | C2/C3 REFRIGERATION DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 21/5/2024 | |
| 20240621 | 863-C-00005 | B-DV-1619 | C2/C3 REFRIGERATION COMP DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 21/5/2024 | |
| 20240621 | 863-C-00005 | B-DV-1620 | LUBE/SGAL OIL CONSOLE DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 21/5/2024 | |
| 20240621 | 863-C-00006 | B-DV-1621A | UGC STORAGE TK Q-1521 DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 21/5/2024 | |
| 20240621 | 863-C-00006 | B-DV-1621A | UGC STORAGE TK Q-1521 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 21/5/2024 | |
| 20240621 | 863-C-00006 | B-DV-1621B | UGC STORAGE TK Q-1521 DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 21/5/2024 | |
| 20240621 | 863-C-00012 | B-DV-1621B | UGC STORAGE TK Q-1521 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 21/5/2024 | |
| 20240621 | 863-C-00012 | B-DV-1622A | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 21/5/2024 | |
| 20240621 | 863-C-00006 | B-DV-1622A | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 21/5/2024 | |
| 20240621 | 863-C-00006 | B-DV-1622B | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 21/5/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|-----------|---------|
| 20240621 | B026-C-00011 | B-PSV-3795A | OUTLET T-379 TO HOT FLARE | (3Y)INSPECTION & OVERHAUL | PM | 21/6/2024 | PSV |
| 20240621 | B026-C-00012 | B-PSV-3795B | OUTLET T-379 TO HOT FLARE | (3Y)INSPECTION & OVERHAUL | PM | 21/6/2024 | PSV |
| 20240621 | B58-B-00005 | P-VP-19041 | M2 TO ND CUSTODY (M/LR) | (6M)LUBRICANT(GREASE G-32) (OUT-SOURCE) | PM | 21/6/2024 | |
| 20240621 | B121-C-00029 | B-SP-0507 | PORTABLE OIL PRESS CAL (HL) | (1Y)TYPICAL PORT. DISPRESS (HYDUT-SOURCE) | PM | 21/6/2024 | |
| 20240621 | BWS-C-00033 | B-WSTOOLS-02 | TOOLS ASSET CONTROL L-4 | (6M)INSPECT TOOLS ASSET CONTROL | PM | 21/6/2024 | |
| 20240621 | B90-C-00228 | B-XFMR-2A1 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 21/6/2024 | |
| 20240621 | B90-C-00228 | B-XFMR-2A2 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 21/6/2024 | |
| 20240621 | B90-C-00228 | B-XFMR-2A3 | POWER TRANSFORMER FOR ADMIN BLDG | (3M)-RCM Visual Inspection | IM | 21/6/2024 | |
| 20240621 | B90-C-00228 | B-XFMR-2A4 | POWER TRANSFORMER FOR ADMIN BLDG | (3M)-RCM Visual Inspection | IM | 21/6/2024 | |
| 20240620 | B11-C-00093 | B-AT-300701 | HYDROLYSIS REACTOR L-3007 OUTLET | (2M) SET & CALIBRATE | PM | 20/6/2024 | |
| 20240620 | B11-C-00103 | B-AT-371001 | A-3701 C3 SPLITTER TEMPERATURE | (2M) SET & CALIBRATE | PM | 20/6/2024 | |
| 20240620 | B11-C-00111 | B-AT-371002 | ANALYZER (GC) PROPANE RECYCLE FROM C3 SP | (2M) SET & CALIBRATE | PM | 20/6/2024 | |
| 20240620 | B-P-240629 | B-P-240629 | STEAM GENERATOR | (3M) CONDITION CHECK (OSL 2023-249) | IM | 20/6/2024 | |
| 20240620 | BPC-B-00001 | C-PAP-NHS | GROUPOING TAG FOR MAIN MAIN SL | (2Y)VISUAL INSPECTION TEMP,MOISE AND VIB | PM | 20/6/2024 | |
| 20240620 | BNA-C-00062 | B-CRIT-QC-COLD-P2 | CRIOI EQUIPMENTS Cold Area Plant 2 | (2Y)Visual & Condition Inspection | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-DCS-P1 | DCS HONEYWELL TDC300&EXP&PERION | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-DCS-P1-BOILER | DCS EMERSON DELTA-V M0 CONTROLLER SOFTWA | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-DCS-P1-ORP | DCS HONEYWELL C300 EXP&PERION RS11.1 | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-DCS-P2 | DCS YOKOGAWA CP461-S0/APV300/REVISION R5 | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-DCS-P3 | DCS HONEYWELL C300 EXP&PERION | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | IM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-ORP | ESD/MP3101TH4-9.05064.2.0ENH2.10.0 | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P1-TANKFARM | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P2-COLD/UT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P2-FUR5/HOT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P2-FUR6 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B00-C-00065 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 20/6/2024 | |
| 20240620 | B106-C-00054 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-236) | IM | 20/6/2024 | Furnace |
| 20240620 | B106-C-00054 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-233) | IM | 20/6/2024 | Furnace |
| 20240620 | B106-C-00054 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-252) | IM | 20/6/2024 | Furnace |
| 20240620 | B106-C-00017 | B-F-170 | USC FURNACES | (3Y)CONVECTION CLEAN (GROUP "B") | PM | 20/6/2024 | Furnace |
| 20240620 | B103-C-00052 | B-F-190 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-238) | IM | 20/6/2024 | Furnace |
| 20240620 | B106-C-00045 | B-LG-1407 | FURNACE F-140 STEAM DR | (3M) CONDITION CHECK (OSL 2023-244) | IM | 20/6/2024 | |
| 20240620 | B0M-C-00027 | B-M-19006 | GROUPOING TAG FOR LPG FROM PTT | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | IM | 20/6/2024 | |
| 20240620 | B0M-C-00015 | B-M-19057 | GROUPOING TAG FOR TAIL GAS TO ROC. M.SKID | (1)UPDATE N2, CO2, REL. DENSITY | PM | 20/6/2024 | |
| 20240620 | BH7A-C-00023 | B-M-3106 | 6 FURNACE SHP STEAM | (1Y) EXTERNAL INSPECTION BY LAW | IM | 20/6/2024 | |
| 20240620 | B5M-S-00005 | B-MOTOR-EO-006 | GROUPOING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | PM | 20/6/2024 | Motor |
| 20240620 | B5M-S-00015 | B-MOTOR-EO-DEM1N | GROUPOING TAG FOR MOTOR DEMIN PLANT | (1M)CLEANING & INSPECTION. | PM | 20/6/2024 | Motor |
| 20240620 | B5M-S-00016 | B5M-S-OLEFINS-P2 | B5M-S-OLEFINS-P2 | (3M) CONDITION CHECK (OSL 2023-233) | IM | 20/6/2024 | |
| 20240620 | B5M-S-00031 | B-P-221A | QUENCH WATER CIRCULATION PUMP | (3M) CONDITION CHECK (OSL 2023-252) | IM | 20/6/2024 | Pump |
| 20240620 | B013-C-00016 | B-P-221A | QUENCH OIL TOWER REFUX PUMP | (3M) CONDITION CHECK (OSL 2023-254) | IM | 20/6/2024 | Pump |
| 20240620 | B55-C-00010 | B-P01-19005 | CLARIFIED WATER (CLC) | (3M) CONDITION CHECK (OSL 2023-241) | IM | 20/6/2024 | |
| 20240620 | B00-C-00109 | B-PIPEL-SC | LINE STEAM CONDENSATE QLE 2-1 | (3M) CONDITION CHECK (OSL 2023-239) | IM | 20/6/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|--|----|-----------|-------------|
| 20240620 | 800-C-00114 | B-PIPE1-SC | LINE STEAM CONDENSATE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-251) | IM | 20/5/2024 | |
| 20240620 | 800-C-00112 | B-PIPE1-SC | LINE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-243) | IM | 20/5/2024 | |
| 20240620 | 800-C-00115 | B-PIPE1-SC | LINE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-255) | IM | 20/5/2024 | |
| 20240620 | 800-C-00113 | B-PIPE1-SC | LINE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-248) | IM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P1-CCS-R575 | ANTI-SURGE AND PERFORMANCE CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P1-CCS-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P1-CCS-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P1-CCS-PRC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P1-PSA1 | PRESSURE SWING ADSORPTION | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P1-TTC | TURBOMACHINERY CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P2-TTC-CG2 | TURBOMACHINERY CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P2-TTC-ERC | TURBOMACHINERY CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P2-TTC-PRC | TURBOMACHINERY CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P2-PSA2 | PRESSURE SWING ADSORPTION | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | |
| 20240620 | 800-C-00065 | B-PLC-P3-TTC | INTEGRATED TURBINE COMPRESSOR CONTROL | (1M) DAILY CHECK SYSTEM | PM | 20/5/2024 | Compressor |
| 20240620 | 8090-C-00022 | B-PM-3804A | C3 COMP VACUUM COND PUMP MOTOR | RCM (3M) Motor Inspection | IM | 20/5/2024 | Motor |
| 20240620 | 8090-C-00023 | B-PM-3804S | C3 COMP VACUUM COND PUMP MOTOR | RCM (3M) Motor Inspection | IM | 20/5/2024 | Motor |
| 20240620 | 8090-C-00025 | B-PM-3805A | C2 COMP VACUUM COND PUMP MOTOR | RCM (3M) Motor Inspection | IM | 20/5/2024 | Motor |
| 20240620 | 8090-C-00027 | B-PM-3805S | C2 COMP VACUUM COND PUMP MOTOR | RCM (3M) Motor Inspection | IM | 20/5/2024 | Motor |
| 20240620 | 890-C-00003 | B-PP-3E1-1 | NEW MAIN SUBSTATION NORMAL-HVAC MOTOR | (1M) CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240620 | 890-C-00003 | B-PP-3E1-2 | NEW PROCESS SUBSTATION NORMAL-HVAC MOTOR | (1M) CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240620 | 890-C-00003 | B-PP-4F1-1 | CONTROL BUILDING EMERGENCY-HVAC MOTOR | (1M) CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240620 | 890-C-00003 | B-PP-4F1-2 | NEW MAIN SUBSTATION EMERGENCY-HVAC MOTOR | (1M) CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240620 | 890-C-00003 | B-PP-4F1-3 | NEW PROCESS SUBSTATION EMERGENCY-HVAC MO | (1M) CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240620 | 852A-C-00010 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2023-236) | IM | 20/5/2024 | |
| 20240620 | 855-C-00012 | B-Q-2216 | CLARIFIED WATER STORAGE TANK | (3M) CONDITION CHECK (OSL 2023-246) | IM | 20/5/2024 | |
| 20240620 | 846-S-00001 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (2M) RE GREASE DAMPER BEARING | PM | 20/5/2024 | |
| 20240620 | 8090-C-00025 | B-R-3600-GM-7 | OL PURIFIER MOTOR | RCM (3M) Motor Inspection | IM | 20/5/2024 | |
| 20240620 | 8090-C-00028 | B-S-1301 | Demulsifier Fire Stack | (3M) CONDITION CHECK (OSL 2023-250) | IM | 20/5/2024 | Water(Fire) |
| 20240620 | 8090-C-00011 | B-S-1302 | Demulsifier Fire Stack | (3M) CONDITION CHECK (OSL 2023-232) | IM | 20/5/2024 | Water(Fire) |
| 20240620 | 820-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO.1 (MUNGATE) | (1D) INSPECTION | PM | 20/5/2024 | |
| 20240620 | 820-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYARIN) | (1D) INSPECTION | PM | 20/5/2024 | |
| 20240620 | 820-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (1D) INSPECTION | PM | 20/5/2024 | |
| 20240620 | 820-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CR (NATYAYU) | (1D) INSPECTION | PM | 20/5/2024 | |
| 20240620 | 820-C-00003 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2W) INSPECTION | PM | 20/5/2024 | |
| 20240620 | 813-C-00049 | B-TR-2M1 | DRY TYPE TRANSFORMER | (3M) CONDITION CHECK | IM | 20/5/2024 | |
| 20240620 | 800-C-00111 | B-TRAP-010 | GROUPING STEAM TRAP AREA 010 | (3M) CONDITION CHECK (OSL 2023-242) | IM | 20/5/2024 | |
| 20240620 | 820-C-00110 | B-VALVE-151 | VALVE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-240) | IM | 20/5/2024 | |
| 20240620 | 812-C-00335 | B-VSD-G-801-RM-1A | VSD Panel for G-801-RM-1A | (1M) Inspection & Record | PM | 20/5/2024 | |
| 20240620 | 890-C-00119 | B-VSD-MR-1135A | VSD Panel for R-1135A | (1M) Inspection & Record | PM | 20/5/2024 | |
| 20240620 | 890-C-00195 | B-VSD-MR-1135S | VSD Panel for R-1135S | (1M) Inspection & Record | PM | 20/5/2024 | |
| 20240620 | 8003-C-00019 | B-VSD-MR-1500A | VSD Panel for R-1500A | (1M) Inspection & Record | PM | 20/5/2024 | |
| 20240620 | 8003-C-00020 | B-VSD-MR-1500S | VSD Panel for R-1500S | (1M) Inspection & Record | PM | 20/5/2024 | |
| 20240619 | 811-C-00098 | B-AT-370001 | DEPHOANIZER A-3700 BTMS. TO DEBUTANIZE | (2M) SET & CALIBRATE | PM | 19/5/2024 | |
| 20240619 | 811-C-00099 | B-AT-370002 | REFLUX TO A-3700 DEPHOANIZER | (2M) SET & CALIBRATE | PM | 19/5/2024 | |
| 20240619 | 811-C-00104 | B-AT-371204 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 19/5/2024 | |
| 20240619 | 811-C-00110 | B-AT-371214 | USC PYROLYSIS FURNACE | (1M) SET & CALIBRATE | PM | 19/5/2024 | |
| 20240619 | 8050-C-00005 | B-G-13505-2-P | CO. D RUM PUMP | RCM (LY) CHANGE HYDRAULIC OIL AND GEAR OIL | PM | 19/5/2024 | |
| 20240619 | 818S-C-00001 | B-G-300-PT-1A | CG COMPRESSOR MAIN OIL PUMP TURBINE | RCM (CHECK LUBRICATE OIL) | PM | 19/5/2024 | Compressor |
| 20240619 | 809S-C-00029 | B-M-1900T | GROUPING TAG FOR NGL FROM PTT | (4M) PROVE LIQ TURBINE METER (OUT-SOURCE) | IM | 19/5/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|--|----|-----------|------------|
| 20240619 | 8031-B-00002 | B-MR-7015 | RECYCLE H2 COMPRESSOR | (8,000hrs)LUBRICATE & INSPECTION MOTOR | PM | 19/5/2024 | Compressor |
| 20240619 | 8031-B-00002 | B-PSV-7024 | R-7015 | (15,000hrs)OVERHAUL & INSPECT PSV | PM | 19/5/2024 | PSV |
| 20240619 | 8031-B-00002 | B-PSV-7025 | R-7015 | (16,000hrs)OVERHAUL & INSPECT PSV | PM | 19/5/2024 | PSV |
| 20240619 | 8031-B-00002 | B-R-7015 | GRU RECYCLE H2 COMPRESSOR | (16,000HR) OVERHAUL | PM | 19/5/2024 | Compressor |
| 20240619 | 8031-B-00002 | B-R-7015 | GRU RECYCLE H2 COMPRESSOR | (8,000hrs)SET & CALIBRATION (OUT-SOURCE) | PM | 19/5/2024 | Compressor |
| 20240619 | BNA-C-00017 | B-SECUR-TASK#6 | FOR PM: INSPECTION AND CHECK MOBILE AIR | (1M) INSPECTION | PM | 19/5/2024 | |
| 20240618 | B11-C-00100 | B-AT-370501 | C3 LIQUID FROM T-3705 FEED TO L-3705 MAP | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240618 | B11-C-00109 | B-AT-370502 | ANALYZER (GC) MAP REACTOR RECYCLE | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240618 | B11-C-00110 | B-AT-370503 | LP DEETHAN. BOTTOMS FROM P3604A/S PUMP | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240618 | B11-C-00105 | B-AT-371202 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240618 | B10M-C-00018 | B-F-1010 | USC PYROLYSIS FURNACE | (6M)REGREASE DAMPER BEARING. | PM | 18/5/2024 | Furnace |
| 20240618 | B10L-C-00021 | B-F-1010 | USC PYROLYSIS FURNACE | (6M)REGREASE DAMPER BEARING. | PM | 18/5/2024 | Furnace |
| 20240618 | B10P-C-00012 | B-F-160 | USC FURNACES | (6M)REGREASE DAMPER BEARING. | PM | 18/5/2024 | Furnace |
| 20240618 | B103-C-00011 | B-F-190 | USC FURNACES | (6M)REGREASE DAMPER BEARING. | PM | 18/5/2024 | Furnace |
| 20240618 | B10-C-00001 | B-G-3841 | COOLING TOWER SYSTEM | (2M)VISUAL INSPECTION | IM | 18/5/2024 | |
| 20240618 | B10-C-00001 | B-G-3841-R1A | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/5/2024 | |
| 20240618 | B10-C-00001 | B-G-3841-R1B | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/5/2024 | |
| 20240618 | B10-C-00001 | B-G-3841-R1C | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/5/2024 | |
| 20240618 | B10-C-00001 | B-G-3841-R1D | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 18/5/2024 | |
| 20240618 | B63-C-00053 | B-HY-1640 | HYDRANT AREA TRUCK LOADING | (6M)HY TRUCK LOAD LUBRICATION | PM | 18/5/2024 | |
| 20240618 | B63-C-00054 | B-PIPE1-DR | LINE DRAIN OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-014) | IM | 18/5/2024 | |
| 20240618 | B63-C-00054 | B-PIPE1-SCM | LINE STEAM CONDENSATE - MP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-003) | IM | 18/5/2024 | |
| 20240618 | B00-C-00043 | B-PIPE1-SCM | LINE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-004) | IM | 18/5/2024 | |
| 20240618 | B90-C-00014 | B-PM-3001A | LPG FEED PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 18/5/2024 | Motor |
| 20240618 | B90-C-00011 | B-PM-3901A | WASH OIL INJECTION PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 18/5/2024 | Motor |
| 20240618 | B31-C-00026 | B-PSV-7011A | T-702 TO HOT FLARE | (24M)SET & CALIBRATE (PSV 1 / 1702) | PM | 18/5/2024 | PSV |
| 20240618 | B57-B-00002 | B-R-1475S | INSTRUMENT AIR COMPRESS | (2,000hrs)Inspection&Cleaning Air Inlet | PM | 18/5/2024 | |
| 20240618 | B32-C-00001 | B-STANDARD-GAS | GROUPING TAG FOR STANDARD GAS | (1M)CHECK STANDARD GAS STATUS | PM | 18/5/2024 | |
| 20240618 | B13-C-00017 | B-X0001-1-4F1-001 | POWER TRANSFORMER 6.6KV / 2072V | (3M)CONDITION CHECK | PM | 18/5/2024 | |
| 20240617 | B11-C-00010 | B-AT-390610 | ACETYLENE REACTOR EFFLUENT | (1M) SET & CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B11-C-00095 | B-AT-39020 | DEBUTANIZER REFLUX PUMPS P-3502A/S DISCH | (2M) SET & CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B102-C-00011 | B-AT-382105 | ISO14000 PH METER TX FOR V-3821-P-1 OUTL | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00664 | B-AT-402101 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00665 | B-AT-402105 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00666 | B-AT-402201 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00668 | B-AT-420101A | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00669 | B-AT-420101B | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00671 | B-AT-430105 | Fuel Gas of F-4301 and F-4302 CEMs | (1M)SET & CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00672 | B-AT-430401 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00032 | B-AT-480104 | FE-4801-02 Downstream TOC | (1M)SET & CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B12-C-00033 | B-AT-485201 | Q-4852 TOC | (1M)SET & CALIBRATE | PM | 17/5/2024 | |
| 20240617 | B90-S-00043 | B-BC-2EE-110-1 | BATTERY CHARGER 110VDC 6.36 KVA(DUTY) | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00044 | B-BC-2EE-110-2 | BATTERY CHARGER 110VDC 6.36 KVA(STAND BY) | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00045 | B-BC-2EE-24-1 | BATTERY CHARGER 24VDC 2.5 KVA(DUTY) | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00046 | B-BC-2EE-24-2 | BATTERY CHARGER 24VDC 2.5 KVA(STAND BY) | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00048 | B-BC-2M1-1 | 110 VDC BATTERY CHARGER PANEL | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00049 | B-BC-2M1-2 | 110 VDC BATTERY CHARGER PANEL | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00050 | B-BC-3M1-1 | BATTERY CHARGER NO. 1 | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00051 | B-BC-3M1-2 | BATTERY CHARGER NO. 2 | (3M)CONDITION CHECK | PM | 17/5/2024 | |
| 20240617 | B90-S-00052 | B-BC1-2ES | BATTERY CHARGER AT NEW MAIN SUB.-1 | (3M)CONDITION CHECK | PM | 17/5/2024 | |

| | | | | | | | |
|----------|----------------|-------------------|--|--|----|-----------|------|
| 20240615 | B-10-C-00006 | B-G-3841-RM-18 | COOLING TOWER FAN MOTOR | (1Y)CLEANING | PM | 15/6/2024 | |
| 20240615 | B-G-3841-RM-1C | B-G-3841-RM-1C | COOLING TOWER FAN MOTOR | (1Y)CLEANING | PM | 15/6/2024 | |
| 20240615 | B-10-C-00006 | B-G-3841-RM-1D | COOLING TOWER FAN MOTOR | (1Y)CLEANING | PM | 15/6/2024 | |
| 20240615 | BNA-C-00053 | B-GC-2M2 | GROUPING FOR PM GC 2 Month group2 | (2M)SET/CALIBRATE | PM | 15/6/2024 | |
| 20240615 | B10L-C-00045 | B-HV-10205 | F-1020 EFFLUENT TO A-210 | (3M)Collect Torque Profile & Record | IM | 15/6/2024 | |
| 20240615 | B10L-C-00044 | B-HV-10207 | DECOKE EFFLUENT TO F-1020 | (3M)Collect Torque Profile & Record | IM | 15/6/2024 | |
| 20240615 | B48-C-00022 | B-INTERCOM-6P2-BV | INTERCOM Grouping Tag BV | (3M)INTERCOM FUNCTION TEST | PM | 15/6/2024 | |
| 20240615 | B063-C-00018 | B-MCC-2C-1 | MCC FOR P-1602A | RCM(3M) Visual Inspection | PM | 15/6/2024 | |
| 20240615 | B060-C-00040 | B-MCC-3A-1 | MCC FOR P-1602S | RCM(3M) Visual Inspection | PM | 15/6/2024 | |
| 20240615 | B095-C-00021 | B-MCC-00402 | GROUPING TAG FOR MCC | (3M)INSPECT CABLE/TIGHTNESS NUTS/SCREWS | PM | 15/6/2024 | |
| 20240615 | B1-NV65-01 | B-NV65-01 | NEW CEM NEW CEM | (1M) New/130 System Visual Inspection | PM | 15/6/2024 | |
| 20240615 | B075-C-00001 | B-OIL-MIST-PLANT2 | Grouping Tag for Oil Mist Systems P1-4/2 | (1M) Oil Mist Healthy PM | PM | 15/6/2024 | |
| 20240615 | B063-C-00046 | B-A-1602A | FIRE WATER JOCKEY PUMP | (1M)Visual inspect Conclusion | PM | 15/6/2024 | Pump |
| 20240615 | B063-C-00047 | B-A-1602S | FIRE WATER JOCKEY PUMP | (1M)Visual inspect Conclusion | PM | 15/6/2024 | Pump |
| 20240615 | B039-C-00001 | B-PSV-4000 | R-400A TO HOT FLARE | (3Y)INSPECTION & OVERHAUL | PM | 15/6/2024 | PSV |
| 20240615 | B039-C-00002 | B-PSV-4001 | R-400S TO HOT FLARE | (3Y)INSPECTION & OVERHAUL | PM | 15/6/2024 | PSV |
| 20240615 | B41-C-00004 | B-PSV-4750S | T-475 TO COLD FLARE | (3Y)SET/CALIBRATE (PSV1 1/2Q2 1/2) | PM | 15/6/2024 | PSV |
| 20240615 | B42A-C-00015 | B-HSV-6100S | M-610 TO COLD FLARE | (3Y)SET/CALIBRATE (PSV1 1/2Q2 1/2) | PM | 15/6/2024 | PSV |
| 20240615 | B42A-C-00035 | B-Q-1522 | LPG BULLET TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | IM | 15/6/2024 | |
| 20240615 | B52B-C-00059 | B-R-1204A | COOLING WATER FAN A | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/6/2024 | |
| 20240615 | B52B-C-00060 | B-R-1204B | COOLING WATER FAN B | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/6/2024 | |
| 20240615 | B52B-C-00061 | B-R-1204C | COOLING WATER FAN C | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/6/2024 | |
| 20240615 | B52B-C-00062 | B-R-1204D | COOLING WATER FAN D | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/6/2024 | |
| 20240615 | B52B-C-00063 | B-R-1204E | COOLING WATER FAN E | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/6/2024 | |
| 20240615 | B19A-C-00068 | B-R-300-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 15/6/2024 | |
| 20240615 | B00-C-00072 | B-TT-11099 | TEMPERATURE IN RACK ROOM PLANT1 | (1Y)SET/CALIBRATION (OUT-SOURCE) | PM | 15/6/2024 | |
| 20240615 | B11-C-00042 | B-TT-350099 | TEMPERATURE IN RACK ROOM PLANT2 | (1Y)SET/CALIBRATION (OUT-SOURCE) | PM | 15/6/2024 | |
| 20240615 | B12-C-00075 | B-AV4V35-CWR | VALVE COOLING WATER RETURN OLE 2-3 | (1M)INSPECT GEAR OF BTF VALVE CWR T-4045 | IM | 15/6/2024 | |
| 20240615 | B063-C-00056 | B-AF-23001 | DEBIT WATER TO PROCESS | (3M) CONDITION CHECK (OSL 2021-125) | IM | 14/6/2024 | |
| 20240615 | B10K-C-00072 | B-AF-1010 | ISO1400 CEMS SOX/MOX/CO F-1010 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/6/2024 | |
| 20240615 | B10L-C-00024 | B-AF-10203 | ISO1400 CEMS SOX/MOX/CO F-1020 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/6/2024 | |
| 20240615 | B091-C-00028 | B-AF-10301/1-3 | GROUPING TAGS CEMS AT-1103/1/203/1303 | (1M)SET & CALIBRATION | PM | 14/6/2024 | |
| 20240615 | B091-C-00028 | B-AF-10304/4-6 | GROUPING TAGS CEMS AT-1403/1/503/1603 | (1M)SET & CALIBRATION | PM | 14/6/2024 | |
| 20240615 | B091-C-00028 | B-AF-10307/7-9 | GROUPING TAGS CEMS AT-1703/1/803/1903 | (1M)SET/CALIBRATION | PM | 14/6/2024 | |
| 20240615 | B3A-C-00013 | B-AF-2411A | ISO1400 CEMS SOX/MOX/CO ANALYZER S-2401 | (1M)SET & CALIBRATE CEMS(B-2401) | PM | 14/6/2024 | |
| 20240615 | B3A-S-00013 | B-B-2401 | STEAM GENERATOR | (1M)CLEANING B-2401 | PM | 14/6/2024 | |
| 20240615 | B90-C-00027 | B-C02-SUB1-1 | CO2 FIRE SYSTEM CONTROL PANEL(SWGA) SUB1 | (1M)INSPECTION | PM | 14/6/2024 | |
| 20240615 | B90-C-00027 | B-C02-SUB2-1 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M)INSPECTION | PM | 14/6/2024 | |
| 20240615 | B091-C-00013 | B-CV-01 | GROUPING TAG FOR CONTROL VALVE | (6M)LUBRICATION (GREASE NO. G-23) | PM | 14/6/2024 | |
| 20240615 | B091-C-00013 | B-CV-02 | GROUPING TAG FOR CONTROL VALVE | (6M)LUBRICATION (GREASE NO. G-23) | PM | 14/6/2024 | |
| 20240615 | B63-C-00057 | B-DV-1601 | ETHYLENE PRODUCT PUMPS DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 14/6/2024 | |
| 20240615 | B63-C-00057 | B-DV-1602 | ETHYLENE BUIL-OFF COMP DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 14/6/2024 | |
| 20240615 | B63-C-00057 | B-DV-1603 | MIXED C4 HTR PUMPS DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 14/6/2024 | |
| 20240615 | B63-C-00057 | B-DV-1604 | PROPYLENE PUMPS DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 14/6/2024 | |
| 20240615 | B47D-C-00024 | B-FV-49101 | P-4910AS minimum flow control valve | (6M)LUBRICATION (GREASE NO. G-23) | PM | 14/6/2024 | |
| 20240615 | B061-C-00017 | B-G-1144A-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144A-2 | PM | 14/6/2024 | |
| 20240615 | B061-C-00017 | B-G-1144A-2B | SLUDGE RETURN PUMP | (1W)CHECK AND ABRADE (FRICTION) | PM | 14/6/2024 | |
| 20240615 | B061-C-00017 | B-G-1144A-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144A-2 | PM | 14/6/2024 | |
| 20240615 | B12-C-00056 | B-GS-2F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 14/6/2024 | |
| 20240615 | B90-C-00005 | B-GS-2F5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 14/6/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|---|----|-----------|------------|
| 20240614 | B90-C-00075 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 14/6/2024 | |
| 20240614 | B13-S-00009 | B-MP-2105 | QUENCH OIL CIRCULATION PUMP MOTOR | (1Y)LUBRICATION | PM | 14/6/2024 | Motor |
| 20240614 | B52B-C-00059 | B-MR-1204A | COOLING TOWER FAN MOTOR A | (1Y)INSPECTION MCC | PM | 14/6/2024 | |
| 20240614 | B52B-C-00059 | B-MR-1204B | COOLING TOWER FAN MOTOR B | (1Y)INSPECTION MCC | PM | 14/6/2024 | |
| 20240614 | B52B-C-00056 | B-MR-1204C | COOLING TOWER FAN MOTOR C | (1Y)INSPECTION MCC | PM | 14/6/2024 | |
| 20240614 | B52B-C-00057 | B-MR-1204D | COOLING TOWER FAN MOTOR D | (1Y)INSPECTION MCC | PM | 14/6/2024 | |
| 20240614 | B52B-C-00058 | B-MR-1204E | COOLING TOWER FAN MOTOR E | (1Y)INSPECTION MCC | PM | 14/6/2024 | |
| 20240614 | B061-C-00018 | B-P-1132A | CFI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 14/6/2024 | Pump |
| 20240614 | B061-C-00018 | B-P-1132S | CFI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 14/6/2024 | Pump |
| 20240614 | B061-C-00018 | B-P-1133A | CO2 EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1133 | PM | 14/6/2024 | Pump |
| 20240614 | B061-C-00018 | B-P-1133S | CO2 EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1133 | PM | 14/6/2024 | Pump |
| 20240614 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 14/6/2024 | Pump |
| 20240614 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 14/6/2024 | Pump |
| 20240614 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 14/6/2024 | Pump |
| 20240614 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 14/6/2024 | Pump |
| 20240614 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 14/6/2024 | Pump |
| 20240614 | B13-S-00009 | B-P-2105 | QUENCH OIL CIRCULATION PUMP | (1Y)CLEAN,LUBRICATE,INSPECTION | PM | 14/6/2024 | Pump |
| 20240614 | B20A-C-00038 | B-P-343A | ISO14000 MEDIUM CAUSTIC CIRCULATION PUMP | (1Y) CLEANING & INSPECT | PM | 14/6/2024 | Pump |
| 20240614 | B20A-C-00035 | B-P-344A | STRONG CAUSTIC CIRCULATION PUMP | (1Y) CLEANING & INSPECT | PM | 14/6/2024 | Pump |
| 20240614 | B20A-C-00037 | B-P-345A | WASH WATER CIRCULATION PUMP | (1Y) CLEANING & INSPECT | PM | 14/6/2024 | Pump |
| 20240614 | B20A-C-00035 | B-P-3602A | ETHYLENE PRODUCT PUMP | (6M)CHECK & INSPECT | PM | 14/6/2024 | Pump |
| 20240614 | B32-C-00094 | B-P-756S | GRU STRIPPER REFLUX PUMP | (1Y)LUBRICATION & CLEANING | PM | 14/6/2024 | Pump |
| 20240614 | B00-C-00067 | B-PIPE1-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-126) | IM | 14/6/2024 | |
| 20240614 | B21-C-00011 | B-PSV-3531A | M-355S TO COLD FLARE | (3Y)SET & CALIBRATE (PSV 1X2) | PM | 14/6/2024 | PSV |
| 20240614 | B47D-C-00075 | B-PV-49102 | Q-4910 vent to flare control valve | (6M)LUBRICATION (GREASE NO. G-23) | PM | 14/6/2024 | |
| 20240614 | B52B-C-00054 | B-R-1204A | COOLING WATER FAN A | (1Y)LUBE OIL REPLACEMENT IN GEARBOX | PM | 14/6/2024 | |
| 20240614 | B52B-C-00055 | B-R-1204B | COOLING WATER FAN B | (1Y)LUBE OIL REPLACEMENT IN GEARBOX | PM | 14/6/2024 | |
| 20240614 | B52B-C-00056 | B-R-1204C | COOLING WATER FAN C | (1Y)LUBE OIL REPLACEMENT IN GEARBOX | PM | 14/6/2024 | |
| 20240614 | B52B-C-00057 | B-R-1204D | COOLING WATER FAN D | (1Y)LUBE OIL REPLACEMENT IN GEARBOX | PM | 14/6/2024 | |
| 20240614 | B52B-C-00058 | B-R-1204E | COOLING WATER FAN E | (1Y)LUBE OIL REPLACEMENT IN GEARBOX | PM | 14/6/2024 | |
| 20240614 | B3A-C-00012 | B-R-2401 | FD FAN | (1M)CHECK LUBRICATING OIL | PM | 14/6/2024 | |
| 20240614 | BNA-C-00014 | B-SECUR-TASK22 | FOR PM: INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/6/2024 | |
| 20240615 | B90-C-00019 | B-SWGR-EO-F0 | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 14/6/2024 | |
| 20240613 | BH3-C-00008 | B-AT-310105 | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M)SET & CALIBRATION | PM | 13/6/2024 | |
| 20240613 | B092-C-00028 | B-AT-312001/J-1 | GROUPING TAG OF NOX ANALYZER (SCR) L-4-2 | (1M) ISO14001 SET/CALIBRATION | PM | 13/6/2024 | Furnace |
| 20240613 | BH2A-C-00018 | B-F-3106 | ETHYLENE FURNACE # 6 | (2Y)Pressure Gauge Calibration(Group R) | PM | 13/6/2024 | Furnace |
| 20240613 | BH2A-C-00022 | B-F-3106 | ETHYLENE FURNACE # 6 | (2Y)SIF PROOF TESTING/INSPECTION(GROUP SIF) | IM | 13/6/2024 | Furnace |
| 20240613 | BH2A-C-00018 | B-F-3106 | ETHYLENE FURNACE # 6 | (2Y)Transmitter Calibration (Group IT-1) | PM | 13/6/2024 | Furnace |
| 20240613 | BH2A-C-00022 | B-F-3106 | ETHYLENE FURNACE # 6 | (2Y)SIF PROOF TESTING/INSPECTION(GROUP SIF) | PM | 13/6/2024 | Furnace |
| 20240613 | B60-C-00087 | B-G-1112-P-1A | HIGH PRESSURE FEED PUMP | (1M)CLEAN STRAINER/INSPECTION | PM | 13/6/2024 | |
| 20240613 | B09S-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION | PM | 13/6/2024 | Motor |
| 20240613 | B38-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION | PM | 13/6/2024 | Motor |
| 20240613 | B90S-00005 | B-PM-3201S | QUENCH WATER PUMP MOTOR | (1M)CLEANING AND INSPECTION | PM | 13/6/2024 | Motor |
| 20240613 | B19A-C-00062 | B-R-300HP | CRACKED GAS COMPRESSOR HP CASING | (1M)INSPECT WRAPPED DRAIN FLANGE | PM | 13/6/2024 | Compressor |
| 20240613 | B20-C-00003 | B-SECUR-TASK030A | FOR PM: CHECK A FOAM TRUCK NO1 (NUNGUNATE) | (1D)INSPECTION | PM | 13/6/2024 | |
| 20240613 | B20-C-00003 | B-SECUR-TASK030C | FOR PM: CHECK A WATER TRUCK(SAYAKUN) | (1D)INSPECTION | PM | 13/6/2024 | |
| 20240613 | B20-C-00003 | B-SECUR-TASK030B | FOR PM: CHECK A FOAM TRUCK NO1 (NUNGUNATE) | (1D)INSPECTION | PM | 13/6/2024 | |
| 20240613 | B20-C-00003 | B-SECUR-TASK030F | FOR PM: CHECK WATER CAR (WATYATU) | (1D)INSPECTION | PM | 13/6/2024 | |
| 20240613 | BNA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/6/2024 | |
| 20240613 | B38-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/6/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|--|----|-----------|-------|
| 20240613 | B12-C-00156 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/6/2024 | |
| 20240613 | B12-C-00154 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/6/2024 | |
| 20240613 | B12-C-00157 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/6/2024 | |
| 20240612 | B04B-C-00004 | B-CAP-0405 | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 12/6/2024 | |
| 20240612 | B00-C-00055 | B-PIPE1-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-046) | IM | 12/6/2024 | |
| 20240612 | B30A-S-00002 | B-R-657A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (1M)INSPECTION & CLEAN | PM | 12/6/2024 | |
| 20240612 | B43B-S-00003 | B-R-650-PT-15 | C3R COMP SURFACE CONDENSER COND TURBINE | (1Y)FLUSHING BEARING | PM | 12/6/2024 | |
| 20240612 | B43B-S-00003 | B-R-650-PT-15 | C3R COMP SURFACE CONDENSER COND TURBINE | (1Y)LUBRICATION | PM | 12/6/2024 | |
| 20240612 | BNA-C-00012 | B-SECUR-TASK20 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/6/2024 | |
| 20240612 | BNA-C-00012 | B-SECUR-TASK45 | FOR PM: INSPECTION AND CHECK MOBILE GENE | (1M)INSPECTION | PM | 12/6/2024 | |
| 20240612 | B025-C-00005 | B-T-3768 | HP DEPROPANIZER CONDENSER | (3M) CONDITION CHECK (OSL 2020-045) | IM | 12/6/2024 | |
| 20240612 | B021-C-00004 | B-AF-3800C | CG DEHYDRATORS BEDS | (1M)MOISTURE ANALYZER AMETEK | PM | 11/6/2024 | |
| 20240611 | B63-C-00094 | B-HY-1634 | HYDRANT AREA COLD | (6M)HY TANK LUBRICATION | PM | 11/6/2024 | |
| 20240611 | B63-C-00094 | B-HY-1635 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 11/6/2024 | |
| 20240611 | B63-C-00094 | B-HY-1636 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 11/6/2024 | |
| 20240611 | B63-C-00094 | B-HY-1637 | HYDRANT AREA TANK | (6M)HY TANK LUBRICATION | PM | 11/6/2024 | |
| 20240611 | B3-C-00016 | B-M-1901A | GROUPING TAG FOR FR CLIC HP STM TO OLEFIN | (3M)SET & CALIBRATION | PM | 11/6/2024 | |
| 20240611 | B38-C-00121 | B-MG-401-P-1A | EXPENDER OIL PUMP MOTOR | (3M)VISUAL INSPECTION AND RECORD | PM | 11/6/2024 | |
| 20240611 | B42B-C-00015 | B-MR-600-P-1A | C2R CONDENSER COND. PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/6/2024 | |
| 20240611 | B42B-C-00015 | B-MR-600-P-2A | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/6/2024 | |
| 20240611 | B42B-C-00015 | B-MR-600-P-2S | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/6/2024 | |
| 20240611 | B01B-C-00061 | B-PM-1570A | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/6/2024 | Motor |
| 20240611 | B01B-C-00061 | B-PM-1570B | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/6/2024 | Motor |
| 20240611 | B01B-C-00063 | B-PM-1570S | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/6/2024 | Motor |
| 20240611 | BNA-C-00022 | B-SECUR-TASK41 | FOR PM : FIRE PUMP PERFORMANCE TEST | (1Y)INSPECTION | PM | 11/6/2024 | |
| 20240611 | B38-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/6/2024 | |
| 20240611 | B73-S-00006 | B-V-267-P-1S | POLYMERIZATION INHIBITOR INJECTION PUMP | (6M)CLEAN CALIBRATE | PM | 11/6/2024 | |
| 20240610 | B12-C-00670 | B-AT-430303 | BATTERY-1 GCG | (1M)SET/CLIBRATOR | PM | 10/6/2024 | |
| 20240610 | B1-C-00018 | B-AT-9010 | BFW FROM DEAERATOR | (M)CALIBRATION | PM | 10/6/2024 | |
| 20240610 | B13-S-00013 | B-BU-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B13-S-00014 | B-BU-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B13-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B13-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00052 | B-BU-HC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00053 | B-BU-HC-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00056 | B-BU-BC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00059 | B-BU-BC1-110 | BATTERY UNIT FOR 110VDC SUB.2 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00055 | B-BU-BC2-110 | BATTERY UNIT FOR 110VDC SUB.PROCESS | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00057 | B-BU-DC | BATTERY UNIT FOR 120VDC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00058 | B-BU-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00062 | B-BU-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00060 | B-BU-UPS1-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B90-S-00061 | B-BU-UPS2-1 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/6/2024 | |
| 20240610 | B63-C-00104 | B-DV-1525A | UPS STORAGE TX-Q-1520 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 10/6/2024 | |
| 20240610 | B63-C-00104 | B-DV-1525B | UPS STORAGE TX-Q-1520 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 10/6/2024 | |
| 20240610 | B63-C-00104 | B-DV-1526A | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 10/6/2024 | |
| 20240610 | B63-C-00104 | B-DV-1526B | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 10/6/2024 | |
| 20240610 | B63-C-00104 | B-DV-1526C | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 10/6/2024 | |
| 20240610 | B63-C-00104 | B-DV-1526D | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M)DV TANK LUBRICATION & INSPECTION | IM | 10/6/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|----------|------------|
| 20240609 | B001-C-00033 | B-P-901C | SNP PUMP | (3M) CONDITION CHECK (OSL 2020-029) | IM | 9/6/2024 | Pump |
| 20240609 | B001-C-00122 | B-PIPE1-US | LIVE DILUTION STEAM OLE 2-1 | (2M) CONDITION CHECK (OSL 2023-267) | IM | 9/6/2024 | |
| 20240609 | B001-C-00047 | B-PIPE1-SCH | LIVE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-027) | IM | 9/6/2024 | |
| 20240609 | B42A-C-00009 | B-PSV-6300A | M-630 TO COLD FLARE | (3)SET & CALIBRATE/PSV 1 1/2/3/3 | PM | 9/6/2024 | PSV |
| 20240609 | B46C-C-00017 | B-Q-1515 | NGA STORAGE TANK | (3M) CONDITION CHECK (OSL 2023-269) | IM | 9/6/2024 | |
| 20240609 | B18A-C-00032 | B-RT-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (3M) CONDITION CHECK (OSL 2020-025) | IM | 9/6/2024 | Compressor |
| 20240609 | B06B-C-00004 | B-SDH-270 | DESUPERHEATER OF DILUTION STEAM TO FURNACE | (3M) CONDITION CHECK (OSL 2020-026) | IM | 9/6/2024 | |
| 20240609 | BNA-C-00009 | B-SECUR-TASK17 | INSPECTION FOAM STORAGE TANK/FOA | (1M)INSPECTION | PM | 9/6/2024 | |
| 20240609 | B47B-C-00053 | B-T-1534 | PROPYLENE VAPORIZER | (3M) CONDITION CHECK (OSL 2020-024) | IM | 9/6/2024 | |
| 20240609 | B110-C-00021 | B-Q-1203B | DILUTION STEAM REBOILER | (3M) CONDITION CHECK (OSL 2023-273) | IM | 9/6/2024 | |
| 20240609 | B04A-C-00010 | B-TRAP-450 | COLD DRAINING STEAM TRAP AREA 050 | (3M) CONDITION CHECK (OSL 2023-270) | IM | 9/6/2024 | |
| 20240609 | B00-C-00125 | B-TRAP-050 | GROUPING STEAM TRAP AREA 050 | (3M) CONDITION CHECK (OSL 2023-275) | IM | 9/6/2024 | |
| 20240609 | B00-C-00124 | B-VALVE1-5M | VALVE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-274) | IM | 9/6/2024 | |
| 20240609 | BNA-C-00075 | B-DV-1566 | DELUGE VALVE FOR SUBS/TKT 1A | (6M) Spray Test | PM | 8/6/2024 | |
| 20240609 | BNA-C-00076 | B-DV-1567 | DELUGE VALVE FOR SUBS/TKT 2A | (6M) Spray Test | PM | 8/6/2024 | |
| 20240609 | BNA-C-00077 | B-DV-1568 | DELUGE VALVE FOR Q-4910 | (6M) Spray Test | PM | 8/6/2024 | |
| 20240609 | BNA-C-00073 | B-DV-1569A | DELUGE VALVE FOR Q-4910 | (6M) Spray Test | PM | 8/6/2024 | |
| 20240609 | BNA-C-00074 | B-DV-1569B | DELUGE VALVE FOR Q-4910 | (6M) Spray Test | PM | 8/6/2024 | |
| 20240609 | B90-C-00199 | B-ECE-3P | EMERGENCY EXIT GROUPING FOR P2 | (3M)INSPECT, VERIFY/RY CHECK | PM | 8/6/2024 | |
| 20240609 | B-EPIR-00021 | B-EPIR-00021 | GROUPING FOR MCC, 108 TAG | (1V)INSPECT WIRING/ CONTACT RELAYS | PM | 8/6/2024 | |
| 20240609 | B10G-C-00011 | B-F-170 | USC FURNACES | (6M)GREASE DAMPER BEARINGS | PM | 8/6/2024 | Furnace |
| 20240609 | B49-B-00021 | B-G-1350-P-1 | LP VOC FLARE NO DRUM LIQUID PUMP | (1M)Short Term preservation | PM | 8/6/2024 | |
| 20240609 | B12-S-00023 | B-G-480-P-15 | CORROSION INHIBITOR INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 8/6/2024 | |
| 20240609 | B18-C-00035 | B-GND-LN-P2 | GROUND&LN GROUPING FOR P2 | (6M)CHECK & INSPECTION | PM | 8/6/2024 | |
| 20240609 | B48-C-00021 | B-INTERCOM-GP-1V | INTERCOM Grouping tag BV | (3M)INTERCOM FUNCTION TEST | PM | 8/6/2024 | |
| 20240609 | B01S-C-00026 | B-H-120 | WATER STRIPPER FEED COALESCE | (3M) CONDITION CHECK (OSL 2022-139) | IM | 8/6/2024 | |
| 20240609 | B90-C-00210 | B-MCC-3A2-BF02-1 | MCC FOR R-600-P-1A | RCM-(1V)Inspect cable/Tightness Nuts/Scr | PM | 8/6/2024 | |
| 20240609 | B90-C-00210 | B-MCC-3A2-BF10-1 | MCC FOR R-600-P-2A | RCM-(1V)Inspect cable/Tightness Nuts/Scr | PM | 8/6/2024 | |
| 20240609 | B90-C-00210 | B-MCC-3A2-BF11-3 | MCC FOR R-600-P-4A | RCM-(1V)Inspect cable/Tightness Nuts/Scr | PM | 8/6/2024 | |
| 20240609 | B90-C-00210 | B-MCC-3B1-BF11-1 | MCC FOR R-600-P-15 | RCM-(1V)Inspect cable/Tightness Nuts/Scr | PM | 8/6/2024 | |
| 20240609 | B90-C-00210 | B-MCC-3B2-BF01-2 | MCC FOR R-600-P-25 | RCM-(1V)Inspect cable/Tightness Nuts/Scr | PM | 8/6/2024 | |
| 20240609 | B90-C-00157 | B-MCC-0E-KW1A | Grouping Tag, for MCC-KW1A | (1V)INSPECT & ADJUST | PM | 8/6/2024 | |
| 20240609 | B90-C-00157 | B-MCC-0E-KW2B | Grouping Tag, for MCC-KW2B | (1V)INSPECT & ADJUST | PM | 8/6/2024 | |
| 20240609 | B09S-C-00033 | B-MOTOR-EO-007 | GROUPING FOR MOTORS CONSOLE#5 | (6M)LUBE OIL INSPECTION | PM | 8/6/2024 | Motor |
| 20240609 | B90-C-00009 | B-P-1501A | FRN FEED PUMP | (6M)CLEAN & LUBRICATE | PM | 8/6/2024 | Pump |
| 20240609 | B42A-C-00014 | B-R-600 | ETHYLENE REFRIGERANT HEAT PUMP/COMPRESS. | (6M)CHANGE BUFFERSEPARATION GAS FILTER | PM | 8/6/2024 | Compressor |
| 20240609 | B43A-C-00014 | B-R-650 | PROPYLENE REFRIGERANT COMPRESSOR | (6M)CHANGE BUFFERSEPARATION GAS FILTER | PM | 8/6/2024 | |
| 20240609 | B90-C-00157 | B-SWGR-EO-KW1A,1B | Grouping Tag, for SWGR-KW1A,1B | (1V)INSPECT & ADJUST | PM | 8/6/2024 | |
| 20240609 | B10B-C-00059 | B-T-330A | CG 3RD STAGE AFTER COOLERS | (3M) CONDITION CHECK (OSL 2022-138) | IM | 8/6/2024 | |
| 20240609 | B13-C-00044 | B-UPS-2M1-A1 | 220 VAC UPS1 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/6/2024 | |
| 20240609 | B13-C-00045 | B-UPS-2M1-A2 | 220 VAC UPS PANEL (BYPASS) | (1M)INSPECT&CONDITION CHECK | PM | 8/6/2024 | |
| 20240609 | B13-C-00046 | B-UPS-2M1-A3 | 220 VAC UPS2 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/6/2024 | |
| 20240609 | B12-S-00040 | B-V-4799 | OIL MIST SYSTEM | (1M) MONTHLY & INSPECTION | PM | 8/6/2024 | |
| 20240609 | B90-C-00246 | B-XFMR-2B1 | POWER TRANSFORMER 6.6/0.4 KV | (6M)-RCM Thermoscan | IM | 8/6/2024 | |
| 20240609 | B90-C-00246 | B-XFMR-2B2 | POWER TRANSFORMER 6.6/0.4 KV | (6M)-RCM Thermoscan | IM | 8/6/2024 | |
| 20240609 | B90-C-00246 | B-XFMR-2B3 | POWER TRANSFORMER 6.6/0.4 KV | (6M)-RCM Thermoscan | IM | 8/6/2024 | |
| 20240609 | B90-C-00246 | B-XFMR-2G1 | 6.6/0.4 KV TRANSFORMER SUBSTATION#3 | (3M)-RCM Visual Inspection | IM | 8/6/2024 | |
| 20240609 | B90-C-00247 | B-XFMR-2G2 | 6.6/0.4 KV TRANSFORMER SUBSTATION#3 | (3M)-RCM Visual Inspection | IM | 8/6/2024 | |
| 20240609 | B90-C-00246 | B-XFMR-2H1 | 6.6/0.4 KV TRANSFORMER SUBSTATION#3 | (6M)-RCM Thermoscan | IM | 8/6/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--------------------------------------|----|----------|---------|
| 20240608 | B90-C-00047 | B-XFMR-2H1 | 6.6/0.4 KV TRANSFORMER SUBSTATION#3 | (3M)-RCM Visual Inspection | IM | 8/6/2024 | |
| 20240608 | B01S-C-00025 | B-X-33011 | A-301 BOTTOMS OUTLET TO P-3301A/5 | (3M) CONDITION CHECK (OSL 2022-137) | IM | 8/6/2024 | |
| 20240607 | B01S-C-00032 | B-A-230 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2021-068) | IM | 7/6/2024 | |
| 20240607 | B029-C-00007 | B-A-540 | PROPYLENE RECTIFIER | (2M)SET & CALIBRATE | PM | 7/6/2024 | |
| 20240607 | B007-C-00080 | B-ANALYZER-Q214/2 | GROUPING FOR OXYGEN ANALYZER PLANT#1/2 | (1M)Visual & Condition Inspection | PM | 7/6/2024 | |
| 20240607 | BNA-C-00061 | B-CURT-EQ-COLD-P1 | Critical Equipments Cold Area Plank 1 | (1M)Visual & Condition Inspection | PM | 7/6/2024 | |
| 20240607 | B38-C-00113 | B-CRITICAL-EQ-HOT | GROUPING TAG FOR MH SEC PLANT #1 | (1M)Visual & Condition Inspection | PM | 7/6/2024 | |
| 20240607 | B10K-C-00043 | B-F-1010 | USC PYROLYSIS FURNACE | (3M) CONDITION CHECK (OSL 2021-087) | IM | 7/6/2024 | Furnace |
| 20240607 | B9A-C-00001 | B-FT-0300 | CRITICAL LOOP, LPG FEED TO M-630 | (1Y)CONDITION CHECK (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B9C-C-00001 | B-FT-0500 | CRITICAL LOOP, NAPHTHA FEED TO T-050A/B | (1Y)CONDITION CHECK (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B9B-C-00001 | B-FT-0600A | CRITICAL LOOP, MIXED FEEDS TO T-060A/B | (1Y)CONDITION CHECK (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B9B-C-00001 | B-FT-0600B | CRITICAL LOOP, LN FEED TO T-060A/B | (1Y)CONDITION CHECK (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B9B-C-00001 | B-FT-0600C | CRITICAL LOOP, ARU FEED TO T-060A/B | (1Y)CONDITION CHECK (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B9B-C-00001 | B-FT-0600D | CRITICAL LOOP, MGL FEED TO T-060A/B | (1Y)CONDITION CHECK (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B061-C-00017 | B-G-1144-P-2A | SUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 7/6/2024 | |
| 20240607 | B061-C-00017 | B-G-1144-P-2B | SUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 7/6/2024 | |
| 20240607 | B061-C-00017 | B-G-1144-P-2S | SUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 7/6/2024 | |
| 20240607 | B43C-S-00001 | B-G-600-PT-1A | C2R/C3R LUBE OIL TURBINE | (6M)LUBRICATE & INSPECTION | PM | 7/6/2024 | |
| 20240607 | B12-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 7/6/2024 | |
| 20240607 | B90-C-00005 | B-GS-2E-25 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 7/6/2024 | |
| 20240607 | B90-C-00075 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 7/6/2024 | |
| 20240607 | B061-C-00019 | B-P-1132A | WQ/EAN STRAINER FOR B-P-1132 | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 7/6/2024 | Pump |
| 20240607 | B061-C-00019 | B-P-1132S | CP1 FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132S | PM | 7/6/2024 | Pump |
| 20240607 | B061-C-00018 | B-P-1136A | DOF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 7/6/2024 | Pump |
| 20240607 | B061-C-00018 | B-P-1136S | DOF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136S | PM | 7/6/2024 | Pump |
| 20240607 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 7/6/2024 | Pump |
| 20240607 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 7/6/2024 | Pump |
| 20240607 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 7/6/2024 | Pump |
| 20240607 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 7/6/2024 | Pump |
| 20240607 | B063-WK-0002 | B-P-1601E | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 7/6/2024 | Pump |
| 20240607 | B30-S-00005 | B-P-5668 | DEB/TANIZER REFUX/PRODUCT PUMPS | (1Y)LUBRICATION | PM | 7/6/2024 | Pump |
| 20240607 | B1-C-00013 | B-PSLL-9037 | LP BPW PIP DCSH | (2V)INSPECTION & TEST (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B1-C-00012 | B-PSLL-9043 | Q-1502 LEVEL SWITCH | (2V)INSPECTION & TEST (OUT-SOURCE) | PM | 7/6/2024 | |
| 20240607 | B43C-S-00008 | B-PSV-6200A | M-620 TO COLD FLARE | (3)SET & CALIBRATE/PSV 1 1/2/3/3 | PM | 7/6/2024 | PSV |
| 20240607 | B053-C-00005 | B-P-221A | DEMINERALIZED WATER STORAGE TANK | (3M) CONDITION CHECK (OSL 2021-088) | IM | 7/6/2024 | |
| 20240607 | B10K-S-00001 | B-R-1010 | FURNACE ID FANS | RCM-(6M)ID Fan Lubricate, Inspection | PM | 7/6/2024 | |
| 20240607 | B10L-S-00001 | B-R-1020 | FURNACE ID FANS | RCM-(6M)ID Fan Lubricate, Inspection | PM | 7/6/2024 | |
| 20240607 | B10G-S-00001 | B-R-170 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate, Inspection | PM | 7/6/2024 | |
| 20240607 | B10H-S-00001 | B-R-180 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate, Inspection | PM | 7/6/2024 | |
| 20240607 | B10J-S-00001 | B-R-190 | FURNACE ID FAN | RCM-(6M)ID Fan Lubricate, Inspection | PM | 7/6/2024 | |
| 20240607 | BNA-C-00007 | B-SECUR-TASK15 | FOR PM: INSPECTION HALON FIRE EXTINGUISH | (1M)INSPECTION | PM | 7/6/2024 | |
| 20240607 | BNA-C-00007 | B-SECUR-TASK29 | FOR PM:MANUAL STATION TEST (ADMIN AREA) | (1M)INSPECTION | PM | 7/6/2024 | |
| 20240607 | B90-C-00118 | B-SWGR-EO-E0 | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 7/6/2024 | |
| 20240607 | B026-C-00013 | B-T-378A | CG HYDROGENATION FEED HEATER | (3M) CONDITION CHECK (OSL 2021-082) | IM | 7/6/2024 | |
| 20240607 | B3A-C-00002 | B-TR-01 | DISTRIBUTION TRANSFORMER | (1M)CONDITION CHECK | PM | 7/6/2024 | |
| 20240607 | B42S-C-00003 | B-V-3803-P1B | PHOSPHASE PUMP | (1Y)LUBRICATION | PM | 7/6/2024 | |
| 20240607 | B42S-C-00004 | B-V-3803-P1C | PHOSPHASE PUMP | (1Y)LUBRICATION | PM | 7/6/2024 | |
| 20240607 | B42S-C-00005 | B-V-3803-P1D | PHOSPHASE PUMP | (1Y)LUBRICATION | PM | 7/6/2024 | |
| 20240607 | B42S-C-00006 | B-V-3803-P1E | PHOSPHASE PUMP | (1Y)LUBRICATION | PM | 7/6/2024 | |
| 20240607 | B021-C-00004 | B-ANALYZER-Q214/1 | GROUPING FOR OXYGEN ANALYZER PLANT#1 | (1M)SET & CALIBRATION | PM | 6/6/2024 | |
| 20240606 | B081-C-00002 | B-AT-1200/1800 | PCC EFFLUENT FROM F-120/F-180 | (1M)SET & CALIBRATION | PM | 6/6/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|---|----|----------|------------|
| 20240606 | B081-C-00003 | B-AT-1300/1400/150 | PCC EFFLUENT FROM F-130/F-140/F-150 | (1M)SET & CALIBRATION | PM | 6/6/2024 | |
| 20240606 | B081-C-00004 | B-AT-1600/1700 | PCC EFFLUENT FROM F-160/F-170 | (1M)SET & CALIBRATION | PM | 6/6/2024 | |
| 20240606 | B046-C-00003 | B-AT-19058A | CO2 ANALYZER IN ETHANE FEED FROM PTT | (2M)CALIBRATE INFRAREDESENSOR(OUT-SOURCE) | PM | 6/6/2024 | |
| 20240606 | B035-C-00002 | B-AT-8000 | BUTADIENE HYDRO. INLETO/OUTLET | (1M)SET&CALIBRATE | PM | 6/6/2024 | |
| 20240606 | BNA-C-00062 | B-CRIT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2W)Visual & Condition Inspection | PM | 6/6/2024 | |
| 20240606 | B09P-C-00051 | B-M-1901S | GROUPING TAG FOR H2 TO TIG METE RING | (4M)SET & CALIBRATE | PM | 6/6/2024 | |
| 20240606 | B13-S-00012 | B-MCC-ORP | Grouping For MCC ORP | (3M)INSPECT&CONDITION CHECK | PM | 6/6/2024 | |
| 20240606 | B09P-S-00002 | B-MOTOR-EO-007 | GROUPING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | PM | 6/6/2024 | Motor |
| 20240606 | B09P-S-00015 | B-MOTOR-EO-012 | GROUPING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | PM | 6/6/2024 | Motor |
| 20240606 | B90-C-00170 | B-OSAVR | GROUPING FOR 115KV AVR | (1M)VISUAL INSPECT&RECORD DATA | PM | 6/6/2024 | |
| 20240606 | B90-C-00171 | B-OSGIS | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 6/6/2024 | |
| 20240606 | B52A-C-00029 | B-P-1201A | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2022-182) | PM | 6/6/2024 | Pump |
| 20240606 | B17-S-00002 | B-P-260A | LULIUM STEAM GENERATION FEED PUMP | (2Y)CLEAN & LUBRICATE | PM | 6/6/2024 | Pump |
| 20240606 | B00-C-00093 | B-PIPE1-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-183) | PM | 6/6/2024 | |
| 20240606 | B45A-C-00039 | B-PSV-15201A | Q-1520 TO HOT FLARE | (5Y)PSV Test and Overhaul (EXCISE)Q-1520 | PM | 6/6/2024 | PSV |
| 20240606 | B45A-C-00039 | B-PSV-15201S | Q-1520 TO HOT FLARE | (5Y)PSV Test and Overhaul (EXCISE)Q-1520 | PM | 6/6/2024 | PSV |
| 20240606 | B46A-C-00039 | B-Q-1520 | LPG STORAGE TANK | (5Y)SET & CALIBRATE | PM | 6/6/2024 | |
| 20240606 | B46A-C-00039 | B-Q-1520 | LPG STORAGE TANK | (5Y)INSPECTION BY LAW (EXCISE) | PM | 6/6/2024 | |
| 20240606 | B46A-C-00039 | B-Q-1520 | LPG STORAGE TANK | (5Y)SPF PROOF TEST & INSPECTION | PM | 6/6/2024 | |
| 20240606 | B46A-C-00039 | B-Q-1520 | LPG STORAGE TANK | (5Y)SPF PROOF TEST & INSPECTION | PM | 6/6/2024 | |
| 20240606 | B48B-C-00032 | B-R-600-P-1S | CRK COMPRESSOR CONDENSATE PUMP | (3M) CONDITION CHECK (OSL 2022-186) | PM | 6/6/2024 | Compressor |
| 20240606 | B11A-C-00034 | B-M-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (3M) CONDITION CHECK (OSL 2022-184) | PM | 6/6/2024 | Compressor |
| 20240606 | B20-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK HOT (NUNGUATE | (10D)INSPECTION | PM | 6/6/2024 | |
| 20240606 | B20-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAVARIN) | (10D)INSPECTION | PM | 6/6/2024 | |
| 20240606 | B20-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE(JITRUKSA) | (10D)INSPECTION | PM | 6/6/2024 | |
| 20240606 | B20-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (10D)INSPECTION | PM | 6/6/2024 | |
| 20240606 | BNA-C-00024 | B-SECUR-TASK06 | FOR PM: TEST A FIRE TRUCK | (2W)INSPECTION | PM | 6/6/2024 | |
| 20240606 | B12-C-00769 | B-VALVE3-P | VALVE PROCESS OLE 2-3 | (1M) CHECK VOCs | PM | 6/6/2024 | |
| 20240606 | B61-C-00026 | B-FT-11211 | FROM P-1132A/YS TO G-1121 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 5/6/2024 | |
| 20240606 | B61-C-00026 | B-FT-11221B | G-1122-1/2/YS DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 5/6/2024 | |
| 20240606 | B61-C-00026 | B-FT-11222 | AIR TO G-1122-1-1 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 5/6/2024 | |
| 20240606 | B61-C-00026 | B-FT-11223 | FROM G-1122-1 TO G-1123-1 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 5/6/2024 | |
| 20240606 | B61-C-00026 | B-FT-11231 | FROM P-1136 TO Q-1135 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 5/6/2024 | |
| 20240606 | B61-C-00026 | B-FT-11362 | G-1125P/IAS TO G-1125M1 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 5/6/2024 | |
| 20240606 | B09P-C-00063 | B-H-1902A | GROUPING TAG FOR LN FROM ATC M.SKID | (4M)PROVE LIQ TURBINE METER(OUT-SOURCE) | PM | 5/6/2024 | |
| 20240606 | B009-C-00008 | B-MFAMP-01 | MAIN FIRE ALARM MONITORING PANEL AT CCB | (1Y)BACKUP DATA | PM | 5/6/2024 | Motor |
| 20240606 | B43C-C-00008 | B-MR-600-P-4A | C2R OIL PURIFIER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 5/6/2024 | |
| 20240606 | B1-S-00005 | B-P-901A | SHP BOILER FEED WATER PUMP | (2Y)BEARING INSPECTION | PM | 5/6/2024 | Pump |
| 20240606 | B9C-S-00002 | B-PT-1501A | FRN FEED PUMP TURBINE | (6M)LUBRICATION | PM | 5/6/2024 | |
| 20240606 | B1-S-00011 | B-PT-901A | LP BOILER FEED WATER PUMP TURBINE | (6M)CHANGE LUBE OIL GOVERNOR | PM | 5/6/2024 | |
| 20240606 | B10A-S-00001 | B-R-110 | RURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/6/2024 | |
| 20240606 | B10B-S-00001 | B-R-120 | RURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/6/2024 | |
| 20240606 | B10C-S-00001 | B-R-130 | RURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/6/2024 | |
| 20240606 | B10D-S-00001 | B-R-140 | RURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/6/2024 | |
| 20240606 | B10E-S-00001 | B-R-150 | RURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/6/2024 | |
| 20240606 | B10F-S-00001 | B-R-160 | RURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/6/2024 | |
| 20240606 | B43C-C-00008 | B-R-600-P-4A | LUBE OIL PURIFIER | RCM-(1M)VISUAL INSPECTION | PM | 5/6/2024 | |
| 20240606 | B009-C-00009 | B-SCADA-P1 | SCADA SYSTEM FOR P1 | (1Y)INSPECTION AND BACKUP DATA | PM | 5/6/2024 | |
| 20240606 | B90-C-00094 | B-UPS1-A1 | UPS1 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/6/2024 | |
| 20240606 | B90-C-00095 | B-UPS1-A2 | UPS(BYPASS) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/6/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|--|----|----------|------------|
| 20240603 | 890-C-00183 | B-MOTOR-BF-08C | MOTOR GROUPING FOR BEU-BC | (1M)CLEANING AND INSPECTION | PM | 3/6/2024 | Motor |
| 20240603 | 890-C-00186 | B-MOTOR-OSBL-88C | MOTOR GROUPING FOR OSBL-BC | (1M)CLEANING AND INSPECTION | PM | 3/6/2024 | Motor |
| 20240603 | 800-C-00096 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-195) | IM | 3/6/2024 | Motor |
| 20240603 | 8063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pit sudsion screen cleaning | PM | 3/6/2024 | Pump |
| 20240603 | 858-C-00020 | B-PCV-15552 | N2 TO Q-1555 | (3Y) INSPECTION & CALIBRATE | PM | 3/6/2024 | |
| 20240603 | 858-C-00022 | B-PCV-19025 | N2 TO H-1902 | (3Y) INSPECTION & CALIBRATE | PM | 3/6/2024 | |
| 20240603 | 858-C-00023 | B-PCV-19114 | N2 TO H-1901 | (3Y) INSPECTION & CALIBRATE | PM | 3/6/2024 | |
| 20240603 | 890-C-00094 | B-PIPEL-BD | LINE BULKHEAD HYDROCARBON & WATER OLE 2-1 | (1M)FUNCTION TEST & EXERCISE | PM | 3/6/2024 | Compressor |
| 20240603 | 8235-S-00001 | B-B-834 | FLUE GAS COMPRESSOR | (1Y)PM CHECK & INSPECTION SHEET | PM | 3/6/2024 | |
| 20240603 | 890-C-00230 | B-SD-BC-1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.1 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 890-C-00230 | B-SD-BC-2 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.2 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 890-C-00231 | B-SD-BC-2M1 | DISTRIBUTION PANEL OF BC 110VDC SUB.7 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 890-C-00230 | B-SD-BC-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 890-C-00250 | B-SD-BC-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.5 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 848-C-00015 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 8009-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.6 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 8009-C-00011 | B-SD-F2 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 8009-C-00011 | B-SD-F9 | DISTRIBUTION PANEL OF BC 240VDC SUB.6 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 890-C-00251 | B-SD-UPS-2M1 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 890-C-00251 | B-SD-UPS-2M2 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 86A-C-00021 | B-SECUR-TASK005 | FOR PM: TEST FIRE PUMP | (1M)INSPECTION | PM | 3/6/2024 | |
| 20240603 | 890-C-00040 | B-SECUR-ES-001 | GROUPING TAG FOR SPEAKER/HORN/S FOLLOW TA | (3M)INTERCOM FUNCTION TEST | PM | 3/6/2024 | |
| 20240603 | 810C-C-00040 | B-T-131 | TLX QUENCH EXCHANGER | (3M) CONDITION CHECK (OSL 2022-191) | IM | 3/6/2024 | |
| 20240603 | 812-C-00040 | B-UPS-2EE-BV | GROUPING FOR UPS 220V XVA | (1M)INSPECT & ADJUST | PM | 3/6/2024 | |
| 20240603 | 800-C-00095 | B-VALVEI-P | VALVE PROCESS OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-194) | IM | 3/6/2024 | |
| 20240603 | 800-C-00094 | B-VALVEI-SCL | VALVE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-109) | IM | 3/6/2024 | |
| 20240603 | 880-C-00183 | B-LOG-RACK | Central Control Building | (1Y)INSPECTION BUILDING UP ROOF FOR BLDG | IM | 2/6/2024 | |
| 20240603 | 812-C-00358 | B-LOG-RACK | Rack Room Building | (1Y)INSPECTION BUILDING UP ROOF FOR BLDG | IM | 2/6/2024 | |
| 20240603 | 812-C-00359 | B-LOG-SUB86 | Substation No.6 Building | (1Y)INSPECTION BUILDING UP ROOF FOR BLDG | IM | 2/6/2024 | |
| 20240603 | 8057-C-00017 | B-G-1478A | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/6/2024 | |
| 20240603 | 8057-C-00017 | B-G-1478B | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/6/2024 | |
| 20240603 | 810L-C-00052 | B-HV-10207 | DECOKE EFFLUENT TO F-1020 | (1.5Y)CLEANING BOTTOM PLATE INS.(Group6) | PM | 2/6/2024 | |
| 20240603 | 813-S-00010 | B-MOTOR-ORP | Grouping For Motor ORP | (1Y)VISUAL INSPECT | PM | 2/6/2024 | Motor |
| 20240603 | 841-C-00002 | B-MP-4785 | ETHYLENE PRODUCT PUMP MOTOR | (1Y)LUBRICATION | PM | 2/6/2024 | Pump |
| 20240603 | 841-C-00023 | B-MP-4785 | ETHYLENE PRODUCT PUMP | (3Y)CLEANING | PM | 2/6/2024 | |
| 20240603 | 841-C-00026 | B-PIPEL-005 | ETHYLENE STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-549) | PM | 2/6/2024 | |
| 20240603 | 841-C-00030 | B-R-3101 | ETHYLENE FURNACE TO FAN#1 | (1M) Visual inspection | PM | 2/6/2024 | |
| 20240603 | 841-C-00027 | B-R-3102 | ETHYLENE FURNACE TO FAN#2 | (1M) Visual inspection | PM | 2/6/2024 | |
| 20240603 | 841-C-00026 | B-R-3103 | ETHYLENE FURNACE TO FAN#3 | (1M) Visual inspection | PM | 2/6/2024 | |
| 20240603 | 841-C-00028 | B-R-3104 | ETHYLENE FURNACE TO FAN#4 | (1M) Visual inspection | PM | 2/6/2024 | |
| 20240603 | 841-C-00028 | B-R-3105 | ETHYLENE FURNACE TO FAN#5 | (1M) Visual inspection | PM | 2/6/2024 | |
| 20240603 | 841-C-00056 | B-R-3106 | ETHYLENE FURNACE TO FAN#6 | (1M) Visual inspection | PM | 2/6/2024 | |
| 20240603 | 813-C-00042 | B-SUZ-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/6/2024 | |
| 20240603 | 813-C-00042 | B-SUZ-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/6/2024 | |
| 20240603 | 813-C-00003 | B-V-3840-PIA | NON OXIDISING INJECTION PUMP | (1Y)VISUAL INSPECTION | PM | 2/6/2024 | |
| 20240603 | 813-C-00004 | B-V-3840-PIA | NON OXIDISING INJECTION PUMP | (1Y)VISUAL INSPECTION | PM | 2/6/2024 | |
| 20240603 | 8013-C-00013 | B-A-210 | QUENCH OIL TOWER | (3M) CONDITION CHECK (OSL 2022-201) | IM | 1/6/2024 | |
| 20240603 | 8H11-S-00003 | B-CAUTICM/2 | Grouping Tag for Cautic Pump 1-4/2 | (1M)CLEAN | PM | 1/6/2024 | |
| 20240603 | 800-C-00075 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1M) Function and Record test | PM | 1/6/2024 | |
| 20240603 | 800-C-00075 | B-CCTV-FS2 | GROUPING TAG FOR FIRE STATION | (1M) Function and Record test | PM | 1/6/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|----------|---------|
| 20240601 | 800-C-00077 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/6/2024 | |
| 20240601 | 800-C-00078 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/6/2024 | |
| 20240601 | 800-C-00079 | B-CCTV-WH | GROUPING TAG FOR WARE HOUSE | (1M) Function and Record test | PM | 1/6/2024 | |
| 20240601 | 800-C-00080 | B-CCTV-WH | GROUPING TAG FOR WARE HOUSE | (1M) Function and Record test | PM | 1/6/2024 | |
| 20240601 | 848-C-00018 | B-DV-BV | DELUGE VALVE GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/6/2024 | |
| 20240601 | 848-C-00016 | B-EE-BV | EMERGENCY EXT GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/6/2024 | |
| 20240601 | 848-C-00017 | B-EL-BV | EMERGENCY LIGHT GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/6/2024 | |
| 20240601 | 87-C-00008 | B-DM-19-05-01 | DIGITAL CLAMP-ON METER | (1Y)CALIBRATION | PM | 1/6/2024 | |
| 20240601 | 87-C-00008 | B-DM-19-05-02 | DIGITAL CLAMP-ON METER | (1Y)CALIBRATION | PM | 1/6/2024 | |
| 20240601 | 810E-C-00006 | B-F-150 | USC FURNACES | (2Y)SETCALIBRATE(GROUP.11)-(PSL, PSL | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00008 | B-F-150 | USC FURNACES | (1.5Y)INSPECTION(GROUP.R2) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00005 | B-F-150 | USC FURNACES | (2Y)CLEAN&INSPECT(GROUP.P1) (OUT-SOURCE) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00026 | B-F-150 | USC FURNACES | (1.5Y)INSPECTION(GROUP.R1) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00027 | B-F-150 | USC FURNACES | (1.5Y)CLEANING & INSPECTION(GROUP.2) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00006 | B-F-150 | USC FURNACES | (2Y)SETCALIBRATE(GROUP.11)-(OUT-SOURCE) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00034 | B-F-150 | USC FURNACES | (2Y)CLEAN & INSPECTION (GROUP "LSL") | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00002 | B-F-150 | USC FURNACES | (1.5Y)SET & CALIBRATE (GROUP.Q) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00002 | B-F-150 | USC FURNACES | (1.5Y)INSPECT CONTROL VALVE(GROUP.Q) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00002 | B-F-150 | USC FURNACES | (1.5Y)SET&CALIBRATE(GROUP.Q)(OUT-SOURCE) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00037 | B-F-150 | USC FURNACES | (2Y)CLEAN&INSPECTION FEED FLOW(GROUP.I) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00002 | B-F-150 | USC FURNACES | (1.5Y)CHECK&INSPECT(GROUP.L) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00002 | B-F-150 | USC FURNACES | (1.5Y)CHECK&INSPECT(GROUP.L) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00036 | B-F-150 | USC FURNACES | (1.5Y)SIF PROOF TEST&INSPECT (GROUP.SIF) | IM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00036 | B-F-150 | USC FURNACES | (1.5Y)SIF PROOF TEST&INSPECT (GROUP.SIF) | IM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00014 | B-F-150 | USC FURNACES | (2Y)SETCALIBRATE(GROUP.12)-(OUT-SOURCE) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00014 | B-F-150 | USC FURNACES | (2Y)SETCALIBRATE(GROUP.12)-(OUT-SOURCE) | PM | 1/6/2024 | Furnace |
| 20240601 | 810E-C-00002 | B-F-150 | USC FURNACES | (1.5Y)INSPECTION LINE&PIE Venture Group.1) | IM | 1/6/2024 | Furnace |
| 20240601 | 8097-C-00003 | B-F-3105 | ETHYLENE FURNACE # 5 | (3M) CONDITION CHECK (OSL 2022-205) | IM | 1/6/2024 | Furnace |
| 20240601 | 812-C-00346 | B-FEEDER-ABE | FEEDER GROUPING FOR BV | (3M)INSPECT & CONDITION CHECK | PM | 1/6/2024 | |
| 20240601 | 848-C-00019 | B-FMC-BV | FIRE ALARM GROUPING FOR BV | (3M)INSPECT, VERIFY & CHECK | PM | 1/6/2024 | |
| 20240601 | 8033-C-00008 | B-FI-7059 | MP STEAM TO F-700 | (3M) CONDITION CHECK (OSL 2022-203) | IM | 1/6/2024 | |
| 20240601 | 850-C-00016 | B-G-13505-P-1 | K.O. DRUM PUMP | RCM-(1M)SHORT TERM PRESERVATION | PM | 1/6/2024 | |
| 20240601 | 8057-C-00015 | B-G-1477A | INSTRUMENT AIR DRYER | (3M)Cleaning Auto Drain of Air Dryer | PM | 1/6/2024 | |
| 20240601 | 8057-C-00016 | B-G-1477B | INSTRUMENT AIR DRYER | (3M)Cleaning Auto Drain of Air Dryer | PM | 1/6/2024 | |
| 20240601 | 80212CM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/6/2024 | |
| 20240601 | 80212CM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/6/2024 | |
| 20240601 | 80212CM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/6/2024 | |
| 20240601 | 80212CM01 | B-INSP-CH-OLE2-2-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/6/2024 | |
| 20240601 | 80212CM01 | B-INSP-CH-OLE2-3-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/6/2024 | |
| 20240601 | 80212CM01 | B-INSP-CH-OLE2-3-N | Condition monitor for inspect General | Vibration and Condition check | IM | 1/6/2024 | |
| 20240601 | 810E-C-00002 | B-LCP-F-150 | TLV/DV Switch Box of F-150 | (1.5Y)Inspect F-150 D/KTR LCP (GROUP**) | IM | 1/6/2024 | |
| 20240601 | 812-C-00342 | B-MCC-B1-1ABE | MCC GROUPING FOR B1-ABE | (3M)INSPECT & CONDITION CHECK | PM | 1/6/2024 | |
| 20240601 | 812-C-00348 | B-MCC-B1-2ABE | MCC GROUPING FOR B1-ABE | (3M)INSPECT & CONDITION CHECK | PM | 1/6/2024 | |
| 20240601 | 812-C-00349 | B-MCC-B1-3ABE | MCC GROUPING FOR B1-ABE | (3M)INSPECT & CONDITION CHECK | PM | 1/6/2024 | |
| 20240601 | 812-C-00350 | B-MCC-B1-4ABE | MCC GROUPING FOR B1-ABE | (3M)INSPECT & CONDITION CHECK | PM | 1/6/2024 | |
| 20240601 | 812-C-00351 | B-MCC-B1-5ABE | MCC GROUPING FOR B1-ABE | (3M)INSPECT & CONDITION CHECK | PM | 1/6/2024 | |
| 20240601 | 80P5-S-00001 | B-MOTOR-EP-008 | GROUPING FOR MOTORS CONSOLE#5 | (3M)LUBRICATION | PM | 1/6/2024 | Motor |
| 20240601 | 838S-S-00001 | B-MOTOR-EP-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING | PM | 1/6/2024 | Motor |
| 20240601 | 810E-C-00002 | B-MR-150 | FURNACE ID FAN MOTOR | (1Y)INSPECTION (GROUP.M) | PM | 1/6/2024 | |
| 20240601 | 800-C-00097 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-195) | IM | 1/6/2024 | |

| | | | | | | | |
|----------|---------------|---------------|---------------------------------------|---|----|----------|--------------|
| 20240601 | 813-C-00021 | B-P-221A | QUENCH OIL TOWER REFUX PUMP | (1Y)CLEANING & LUBRICATE | PM | 1/6/2024 | Pump |
| 20240601 | 813-C-00022 | B-P-221B | QUENCH OIL TOWER REFUX PUMP | (1Y)CLEANING & LUBRICATE | PM | 1/6/2024 | Pump |
| 20240601 | 848-S-00005 | B-P-3201A | QUENCH WATER PUMP | (6M)CLEANING | PM | 1/6/2024 | Pump |
| 20240601 | 848-S-00007 | B-P-3201B | QUENCH WATER PUMP | (6M)CLEANING | PM | 1/6/2024 | Pump |
| 20240601 | 848-S-00016 | B-P-3204A | PROCESS CONDENSATE PUMP | (1Y)CLEANING | PM | 1/6/2024 | Pump |
| 20240601 | 848-S-00019 | B-P-3204B | PROCESS CONDENSATE PUMP | (1Y)CLEANING | PM | 1/6/2024 | Pump |
| 20240601 | 811-C-00066 | B-P-3403A | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGRESS to Bearing Mechanical Seal | PM | 1/6/2024 | Pump |
| 20240601 | 811-C-00067 | B-P-3403B | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGRESS to Bearing Mechanical Seal | PM | 1/6/2024 | Pump |
| 20240601 | 811-S-00005 | B-P-3303A | DEBUTANIZER REFUX PUMP | (1Y)LUBRICATION | PM | 1/6/2024 | Pump |
| 20240601 | 811-S-00006 | B-P-3303B | DEBUTANIZER REFUX PUMP | (1Y)LUBRICATION | PM | 1/6/2024 | Pump |
| 20240601 | 802Z-C-00039 | B-P-300A | LP DEPROP. CONDENSATE PUMP | (3M) CONDITION CHECK (OSL 2022-199) | IM | 1/6/2024 | Pump |
| 20240601 | 800-C-00066 | B-PIPEL-SCM | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-204) | IM | 1/6/2024 | |
| 20240601 | 800-C-00066 | B-PIPEL-SCM | LINE STEAM CONDENSATE - MP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-121) | IM | 1/6/2024 | |
| 20240601 | 800-C-00068 | B-PIPEL-SL | LINE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-197) | IM | 1/6/2024 | |
| 20240601 | 800-C-00100 | B-PIPEL-SL | LINE STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-202) | IM | 1/6/2024 | |
| 20240601 | 812-C-00261 | B-PSV-430205A | T-4302 TO T-4303 | (3Y) Inspection & Testing | PM | 1/6/2024 | PSV |
| 20240601 | 812-C-00275 | B-PSV-480114 | P-4801-P-1A | (4Y)INSPECTION & OVERHAUL PSV | PM | 1/6/2024 | PSV |
| 20240601 | 812-C-00275 | B-PSV-480115 | P-4801-P-1S | (4Y)INSPECTION & OVERHAUL PSV | PM | 1/6/2024 | PSV |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (6M)LUBRICATION | PM | 1/6/2024 | |
| 20240601 | 848-S-00002 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-3201A | QUENCH WATER PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 1/6/2024 | |
| 20240601 | 8413-C-00013 | B-PV-384102A | NPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-122) | IM | 1/6/2024 | |
| 20240601 | 852A-C-00027 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-119) | IM | 1/6/2024 | |
| 20240601 | 847D-C-00114 | B-Q-4910 | BUTENE-1 TANK | (15Y)INTERNAL INSPECTION (EXCISE-CLEAN) | PM | 1/6/2024 | |
| 20240601 | 856-S-00002 | B-R-1470A | PLANT AIR COMPRESSOR | (2Y)LUBRICATE | PM | 1/6/2024 | Compressor |
| 20240601 | 829B-C-00016 | B-R-5 | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-200) | IM | 1/6/2024 | Compressor |
| 20240601 | 8050D-C-00017 | B-S-1301 | demountable Flare Stack | (3M) CONDITION CHECK (OSL 2021-120) | IM | 1/6/2024 | waurn(Flare) |
| 20240601 | 848-S-00005 | B-PT-320 | | | | | |

| | | | | | | | |
|----------|---------------|-------------------|--|--|----|-----------|------------|
| 20240529 | B11-C-00145 | B-TR-ANH-11-004-2 | DRY TYPE TRANSFORMER FOR ANALYZER HOUSE | (3M) RCM Visual Inspection | PM | 28/5/2024 | |
| 20240529 | B11-C-00146 | B-TR-ANH-11-005-1 | DRY TYPE TRANSFORMER FOR ANALYZER HOUSE | (3M) RCM Visual Inspection | PM | 28/5/2024 | |
| 20240529 | B11-C-00147 | B-TR-ANH-11-005-2 | DRY TYPE TRANSFORMER FOR ANALYZER HOUSE | (3M) RCM Visual Inspection | PM | 28/5/2024 | |
| 20240528 | B12-C-00789 | B-1036-DV-001 | Deluge Valve for Grouping 1(OLE2/3/7)tag | (1M)Deluge Valve Visual Inspection | PM | 28/5/2024 | |
| 20240528 | B12-C-00793 | B-1036-DV-002 | Deluge Valve for Grouping 2(OLE2/3/7)tag | (1M)Deluge Valve Visual Inspection | PM | 28/5/2024 | |
| 20240528 | B12-C-00797 | B-1036-DV-003 | Deluge Valve for Grouping 3(OLE2/3/7)tag | (1M)Deluge Valve Visual Inspection | PM | 28/5/2024 | |
| 20240528 | B12-C-00799 | B-1036-FHH-001 | Fire Hose Holder for OLE2/3 | (1M)Fire Hose Box Visual Inspection | PM | 28/5/2024 | |
| 20240528 | B12-C-00778 | B-1036-WHH-001 | Water Hydrant for OLE2/3 | (1M)Water Hydrant Visual Inspection | PM | 28/5/2024 | |
| 20240528 | B12-C-00779 | B-1036-WHH-001 | Water Hydrant with Monitor for OLE2/3 | (1M)Water Hydrant Monitor Visual Inspect | PM | 28/5/2024 | |
| 20240528 | B63-C-00946 | B-DV-1626A | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/5/2024 | |
| 20240528 | B63-C-00946 | B-DV-1626B | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/5/2024 | |
| 20240528 | B63-C-00946 | B-DV-1626C | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/5/2024 | |
| 20240528 | B63-C-00946 | B-DV-1626D | ETHYLENE PRODUCT TX-Q-1530 DELUGE VALVE | (6M) Spray Test | PM | 28/5/2024 | |
| 20240528 | B38-C-00031 | B-E01SR09 | GROUPING FOR MCC 13 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 28/5/2024 | |
| 20240528 | B38-C-00031 | B-E01SR10 | GROUPING FOR MCC 25 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 28/5/2024 | |
| 20240528 | B52B-C-00039 | B-G-1224-P-4S | NaOCl Injection pump | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 28/5/2024 | |
| 20240528 | B5-C-00018 | B-PSV-15204S | LP STEAM TO T-1520 | (24M)SET & CALIBRATE (PSV1X2) | PM | 28/5/2024 | PSV |
| 20240528 | B29-C-00048 | B-PSV-5312S | T-531A/B TO HOT FLARE | (3Y)SET & CALIBRATE (PSV 1 1/2") | PM | 28/5/2024 | PSV |
| 20240528 | B09-C-00024 | B-R-3600-PM-1S | C2 COMP R LO PUMP MOTOR | RCM (3M) Motor Inspection | PM | 28/5/2024 | Motor |
| 20240528 | B90-C-00117 | B-SWGR-EO-00 | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 28/5/2024 | |
| 20240528 | BWS-C-00007 | B-AW502-02-01 | AIR COMPRESSOR SULLAIR | (1M)INSPECTION | PM | 28/5/2024 | Compressor |
| 20240528 | BWS-C-00001 | B-AW503-06-01 | BALANCING MACHINE | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240528 | BWS-C-00001 | B-AW505-01-01 | UNIVERSAL MILLING MACHINE | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240528 | BWS-C-00014 | B-AW505-03-01 | CENTER LATHE MACHINE AJAX | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240528 | BWS-C-00023 | B-AW505-03-02 | CENTER LATHE MACHINE PINACHO | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240528 | BWS-C-00021 | B-AW505-05-01 | COLUMN TYPE DRILLING MACHINE | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240528 | BWS-C-00025 | B-AW505-07-01 | HYDRAULIC HACKSAW | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240528 | BWS-C-00026 | B-AW505-72-01 | SHAPING MACHINE | (1M)INSPECTION & LUBRICATE | PM | 28/5/2024 | |
| 20240528 | BWS-C-00005 | B-AW508-03-01 | HIGH PRESSURE WATER JET MACHINE | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240528 | BWS-C-00030 | B-E01SR14-01 | GROUPING FOR MCC 30 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 28/5/2024 | |
| 20240528 | BWS-C-00005 | B-AW514-03-01 | TRUCK LOADER HINDO | (1M)INSPECTION | PM | 28/5/2024 | |
| 20240527 | B81-S-00003 | B-AE-1300 | CG EFFLUENT FROM F-130 | (6M)CALIBRATION | PM | 27/5/2024 | |
| 20240527 | B81-S-00009 | B-AE-1400 | CG EFFLUENT FROM F-140 | (6M)CALIBRATION | PM | 27/5/2024 | |
| 20240527 | B09P1-C-00031 | B-ANALYZER-O214/1 | GROUPING FOR OXYGEN ANALYZER PLANT#1 | (2M)SET & CALIBRATE | PM | 27/5/2024 | |
| 20240527 | B61-C-00139 | B-AT-1141.1A | ZHYCO Analyzer | (2M)Inspect & Cal | PM | 27/5/2024 | |
| 20240527 | B09P-C-00027 | B-AT-362102 | SIO2 ANALYZER TRANSMITTER FOR V-3621 OUT | (1M)SET & CALIBRATE | PM | 27/5/2024 | |
| 20240527 | B12-C-00023 | B-AT-402103 | BUTADIENE IR | (2M)SET & CALIBRATE | PM | 27/5/2024 | |
| 20240527 | B38-C-00030 | B-E01SR09 | GROUPING FOR MCC 4 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 27/5/2024 | |
| 20240527 | B38-C-00030 | B-E01SR10 | GROUPING FOR MCC 30 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 27/5/2024 | |
| 20240527 | B90-C-00029 | B-INTERCOM-GP1-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 27/5/2024 | |
| 20240527 | B90-C-00002 | B-LT-5420 | RECYCLE C3H8 VAPORIZER | (2Y)SET & CALIBRATION (OUT-SOURCE,P1-2) | PM | 27/5/2024 | |
| 20240527 | B09P-C-00014 | B-M-1901B | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2W)UPDATE N2, CO2, REL. DENSITY | PM | 27/5/2024 | |
| 20240527 | B90-C-00019 | B-MLP-3A1 | MAIN S/S MAIN LTGAUX POWER PANEL | (1Y)INSPECTION & VERIFY | PM | 27/5/2024 | |
| 20240527 | B90-C-00019 | B-MLP-3A2 | MAIN S/S MAIN LTGAUX POWER PANEL | (2Y)SET & CALIBRATE | PM | 27/5/2024 | |
| 20240527 | B063-WK-00001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pit suction screen cleaning | PM | 27/5/2024 | Pump |
| 20240527 | B46C-C-00001 | B-PCV-1515S | ISO14000.PCV CARBON CANISTER SPP-1515 | (1Y)SET & CALIBRATE (OUT-SOURCE) | PM | 27/5/2024 | |
| 20240527 | B46C-C-00001 | B-PCV-1516Z | ISO14000.PCV CARBON CANISTER SPP-1516 | (1Y)SET & CALIBRATE (OUT-SOURCE) | PM | 27/5/2024 | |
| 20240527 | B46C-C-00001 | B-PCV-1517 | ISO14000.PCV CARBON CANISTER SPP-1517 | (1Y)SET & CALIBRATE (OUT-SOURCE) | PM | 27/5/2024 | |
| 20240527 | B18A-WK-0001 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (2Y)REGREASE & INSPECTION | PM | 27/5/2024 | |
| 20240527 | B42B-WK-0001 | B-R-600-PT-1S | C2R SURFACE CONDENSER COND.TURBINE | (2Y)REGREASE & INSPECTION | PM | 27/5/2024 | |

| | | | | | | | |
|----------|---------------|-----------------|--|-------------------------------------|----|-----------|---------|
| 20240527 | B43B-WK-0001 | B-R-630-PT-1S | C3R COMP SURFACE CONDENSER COND TURBINE | (2Y)REGREASE & INSPECTION | PM | 27/5/2024 | |
| 20240527 | BNA-C-00021 | B-SECUR-TASK05 | FOR PH: TEST FIRE PUMP | (1W)INSPECTION | PM | 27/5/2024 | |
| 20240526 | B12-C-00024 | B-AT-402104 | BUTADIENE Oxyg. Ana. | (4M)SET & CALIBRATE | PM | 27/5/2024 | |
| 20240526 | B12-C-00025 | B-AT-404501 | BEU Gulum Accumu. (M-4045) Oxyg. Ana. | (4M)SET & CALIBRATE | PM | 27/5/2024 | |
| 20240526 | B67-C-00006 | B-AT-9440 | HC LP SUS COND. DISC. P-902A/5 | (1M)SET & CALIBRATE | PM | 26/5/2024 | |
| 20240526 | B63-C-00088 | B-DV-NPA-001 | GROUPING TAG FOR DELUGE VALVE NPA | (1M)CHECK/VISUAL HEAT DETECTORS AND | PM | 26/5/2024 | |
| 20240526 | B13-C-00052 | B-LK-ORP | Grouping For Lightning ORP | (6M)CHECK/INSPECTION | PM | 26/5/2024 | |
| 20240526 | B47-C-00012 | B-MP-1541S | RAW MIXED C4 TRANSFER PUMP MOTOR | (2Y)CHANGE LUBE.OIL MOTORS, | PM | 26/5/2024 | Motor |
| 20240526 | B61-C-00046 | B-PSV-11446 | SAFETY VALVE DISCHARGE G-1144-R-3S | (3Y)TEST & SET SAFETY VALVE | PM | 26/5/2024 | PSV |
| 20240526 | B52A-C-00033 | B-R-1201B | COOLING TOWER FAN | (3M) CONDITION CHECK (OSL 2323-266) | IN | 26/5/2024 | |
| 20240526 | B614-C-00004 | BV-3841-F1S | CORROSION INHIBITOR INJECTION PUMP | (1Y)LUBRICATE | PM | 26/5/2024 | |
| 20240526 | B46A-C-00013 | B-DV-1652 | DELUGE VALVE FOR Q-1522 | (6M)FUNCTION TEST | PM | 25/5/2024 | |
| 20240526 | B0P1-C-00002 | B-EPCD1M | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P1-S-00001 | B-EPCD1MB | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P2-C-00002 | B-EPCD1MC | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P2-S-00001 | B-EPCD1MD | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P3-C-00003 | B-EPCD1ME | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P3-S-00002 | B-EPCD1MF | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P4-C-00001 | B-EPCD1MG | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P4-S-00001 | B-EPCD1MH | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/5/2024 | |
| 20240526 | B0P5-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/5/2024 | Motor |
| 20240526 | B0P5-S-00003 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/5/2024 | Motor |
| 20240526 | BNA-C-00030 | B-SECUR-TASK30 | FOR PH:FLUSH LINE HEADER FIRE WATER | (4M)INSPECTION | PM | 25/5/2024 | |
| 20240524 | B100-C-00011 | B-F-140 | USC FURNACES | (6M)REGREASE DAMPER BEARING. | PM | 24/5/2024 | Furnace |
| 20240524 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 24/5/2024 | |
| 20240524 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 24/5/2024 | |
| 20240524 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 24/5/2024 | |
| 20240524 | B13-C-00011 | B-GROUNDING-ORP | Grouping For Grounding ORP | (6M)CHECK/INSPECTION | PM | 24/5/2024 | |
| 20240524 | B12-C-00056 | B-GS-26-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 24/5/2024 | |
| 20240524 | B02-C-00003 | B-GS-26S | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 24/5/2024 | |
| 20240524 | B04-C-00075 | B-GS-24A | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 24/5/2024 | |
| 20240524 | B90-C-00099 | B-MCC-EO-2J1 | Grouping Tag for MCC Sub#1 (MCC-2J1) | (3M) Inspect & Adjust | PM | 24/5/2024 | |
| 20240524 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 24/5/2024 | Pump |
| 20240524 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 24/5/2024 | Pump |
| 20240524 | B061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 24/5/2024 | Pump |
| 20240524 | B061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 24/5/2024 | Pump |
| 20240524 | B063-WK-00002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 24/5/2024 | Pump |
| 20240524 | B063-WK-00002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 24/5/2024 | Pump |
| 20240524 | B063-WK-00002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 24/5/2024 | Pump |
| 20240524 | B063-WK-00002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 24/5/2024 | Pump |
| 20240524 | B063-WK-00002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 24/5/2024 | Pump |
| 20240524 | B12-C-00023 | B-P-390S | LP DEPROP. CONDENSATE PUMP | (3Y)CLEANING & INSPECTION | PM | 24/5/2024 | Pump |
| 20240524 | B7-C-00034 | B-P-920A | CONDENS. POLISHER NEUTRALIZATION SUMP P. | (6M)REGREASE | PM | 24/5/2024 | Pump |
| 20240524 | B0H8-C-00010 | B-R-3207H | Quench Water Air Cooler Fan | RCM-(1Y) FIN FAN INSPECTION | PM | 24/5/2024 | |
| 20240524 | B90-C-00016 | B-SWGR-EO-C0 | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 24/5/2024 | |
| 20240524 | B34-C-00007 | B-V-700-P-1S | DMDS INJECTION PUMP TO J-1710 | (1Y)LUBRICATION & SETTING | PM | 24/5/2024 | |
| 20240524 | B63-C-00098 | B-WM-1629 | WATER MONITOR AREA HOT | (6M)WM HOT LUBRICATION | PM | 24/5/2024 | |
| 20240524 | B63-C-00098 | B-WM-1630 | WATER MONITOR AREA BHL | (6M)WM HOT LUBRICATION | PM | 24/5/2024 | |
| 20240524 | B63-C-00098 | B-WM-1648 | WATER MONITOR AREA BRU | (6M)WM HOT LUBRICATION | PM | 24/5/2024 | |
| 20240523 | B12-C-00031 | B-AT-470701 | LP CONDENSATE TOC | (1M)SET & CALIBRATE | PM | 23/5/2024 | |

| | | | | | | | |
|----------|---------------|-------------------|---|--|----|-----------|------------|
| 20240523 | BNA-C-00062 | B-CRIT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2W)Visual & Condition Inspection | PM | 23/5/2024 | |
| 20240523 | B63-C-00045 | B-DV-1614 | RAW MIXED C4 PRODUCT PUMP DELUGE VALVE | (6M) Spray Test | PM | 23/5/2024 | |
| 20240523 | B63-C-00045 | B-DV-1651 | WATER VALVE AREA NEW TRUCKLOADING | (6M) Spray Test | PM | 23/5/2024 | |
| 20240523 | B63-C-00045 | B-DV-1651 | WATER VALVE AREA NEW TRUCKLOADING | (6M)OV TRUCK LOAD LUBRICATE & CHECK | IM | 23/5/2024 | |
| 20240523 | B63-C-00045 | B-DV-1661 | DELUGE VALVE FOR R-1531 | (6M) Spray Test | PM | 23/5/2024 | |
| 20240523 | B12-S-00056 | B-G-4803-P-4A | NAOCL INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 23/5/2024 | |
| 20240523 | B46E-S-00002 | B-P-1503B | FRN FEED PUMP FROM Q-1503/H TO Q-1501/2 | (1Y)INSPECTION & LUBRICATE | PM | 23/5/2024 | Pump |
| 20240523 | B12-C-00043 | B-PGC-BV-HOUSE2 | GROUPING TAG FOR PGC BV HOUSE 2 | (2M)SET&CALIBRATE | PM | 23/5/2024 | |
| 20240523 | B0H8-C-00009 | B-R-3207G | Quench Water Air Cooler Fan | RCM-(1Y) FIN FAN INSPECTION | PM | 23/5/2024 | |
| 20240523 | B020-C-00003 | B-SECUR-TASK03A | FOR PH: CHECK A FOAM TRUCK MO1 (NUNGATE) | (1D)INSPECTION | PM | 23/5/2024 | |
| 20240523 | B020-C-00003 | B-SECUR-TASK03C | FOR PH: CHECK A WATER TRUCK(SAYVAM) | (1D)INSPECTION | PM | 23/5/2024 | |
| 20240523 | B020-C-00003 | B-SECUR-TASK03E | FOR PH: CHECK AMBUANCE(JITRUSKA) | (1D)INSPECTION | PM | 23/5/2024 | |
| 20240523 | B020-C-00003 | B-SECUR-TASK03F | FOR PH: CHECK WATER CAR (MATVAYU) | (1D)INSPECTION | PM | 23/5/2024 | |
| 20240523 | BNA-C-00024 | B-SECUR-TASK06 | FOR PH: TEST A FIRE TRUCK | (2W)INSPECTION | PM | 23/5/2024 | |
| 20240523 | B63-C-00097 | B-WM-1623 | WATER MONITOR AREA HOT | (6M)WM HOT LUBRICATION | PM | 23/5/2024 | |
| 20240523 | B63-C-00097 | B-WM-1625 | WATER MONITOR AREA HOT | (6M)WM HOT LUBRICATION | PM | 23/5/2024 | |
| 20240523 | B63-C-00097 | B-WM-1627 | WATER MONITOR AREA HOT | (6M)WM HOT LUBRICATION | PM | 23/5/2024 | |
| 20240522 | B09P1-C-00025 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET&CALIBRATE | PM | 22/5/2024 | |
| 20240522 | BH13-C-00062 | B-AT-311003 | MOISTURE ANALYZER TRANSMITTER FOR H-3301 | (1M)MOISTURE ANALYZER AMETEK | PM | 22/5/2024 | |
| 20240522 | B060-C-00051 | B-G-1112-P-1A | HIGH PRESSURE FEED PUMPS | (3M)CLEAN STRAINER FOR B-G-1112-P-1 | PM | 22/5/2024 | |
| 20240522 | B060-C-00051 | B-G-1112-P-1S | HIGH PRESSURE FEED PUMPS | (3M)CLEAN STRAINER FOR B-G-1112-P-1 | PM | 22/5/2024 | |
| 20240522 | B52B-C-00017 | B-G-1224-P-3S | Beckde Inhibitor Injection Pump | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 22/5/2024 | |
| 20240522 | B050-C-00001 | B-G-1259E-R-1 | ASSIST AIR BLOWER | RCM-(1M) VISUAL INSPECTION | PM | 22/5/2024 | |
| 20240522 | B050-C-00001 | B-H-10073 | Grouping tags for QUENCH BOTTOM FROM PIT/PE | (4M)SET & CALIBRATE | IM | 22/5/2024 | |
| 20240522 | B050-C-00001 | B-H-19074 | Grouping TAG for CH3CN from PIT/PE | (4M)SET & CALIBRATE | IM | 22/5/2024 | |
| 20240522 | B90-C-00026 | B-MLP-201 | CT&BWMT MCC ROOM MAIN LT&AUX POWER PANE | (1Y)INSECTION & VERIFY | PM | 22/5/2024 | |
| 20240522 | B90-C-00026 | B-MLP-201 | CT/WWMT MCC ROOM MAIN LT&AUX POWER PANE | (1Y)INSECTION & VERIFY | PM | 22/5/2024 | |
| 20240522 | B12-C-00074 | B-HP-4307A | SURFACE CONDENSER PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/5/2024 | Motor |
| 20240522 | B12-C-00075 | B-HP-4307S | SURFACE CONDENSER PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/5/2024 | Motor |
| 20240522 | B90-S-00009 | B-PM-3801S | BPW PUMP MOTOR | (3M)Inspection & Check Lubc Oil | PM | 22/5/2024 | Motor |
| 20240522 | B52B-C-00051 | B-R-1201F | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 22/5/2024 | |
| 20240522 | B52B-C-00052 | B-R-1201G | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 22/5/2024 | |
| 20240522 | B52B-C-00053 | B-R-1201H | COOLING TOWER FAN | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 22/5/2024 | |
| 20240522 | B52B-C-00054 | B-R-1401 | ETHYLENE PURGE AIR COMPRESSOR | (1Y)INSPECTION & LUBRICATE | PM | 22/5/2024 | Compressor |
| 20240522 | B45-C-00001 | B-R-3102 | ETHYLENE FURNACE IN FAN#2 | (2M) RE GREASE DAMPER BEARING | PM | 22/5/2024 | |
| 20240522 | BH5-S-00001 | B-R-3103 | ETHYLENE FURNACE IN FAN#3 | (2M) RE GREASE DAMPER BEARING | PM | 22/5/2024 | |
| 20240522 | B0H8-C-00008 | B-R-3207F | Quench Water Air Cooler Fan | RCM-(1Y) FIN FAN INSPECTION | PM | 22/5/2024 | |
| 20240522 | B12-C-00748 | B-R-4031-MP-1A | OIL PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/5/2024 | Motor |
| 20240522 | B12-C-00749 | B-R-4031-MP-1S | OIL PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/5/2024 | Motor |
| 20240522 | B12-C-00750 | B-R-4031-MR-1A | VENTILATION FAN MOTOR | RCM (3M) Motor Inspection | IM | 22/5/2024 | |
| 20240522 | B12-C-00751 | B-R-4031-MR-1S | VENTILATION FAN MOTOR | RCM (3M) Motor Inspection | IM | 22/5/2024 | |
| 20240522 | B12-C-00753 | B-R-4301-MIG-5 | OIL PURIFIER | RCM (3M) Motor Inspection | IM | 22/5/2024 | |
| 20240522 | B12-C-00752 | B-R-4301-MP-1S | STAND BY OIL PUMP MOTOR | RCM (3M) Motor Inspection | IM | 22/5/2024 | Motor |
| 20240522 | B18A-C-00003 | B-RT-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M)INSPECT TURBINE EXPANSION JOINT | IM | 22/5/2024 | Compressor |
| 20240521 | B00-C-00065 | B-DCS-P1 | DCS HONEYWELL TIC&MOD&EXPERION | (1M)DAILY CHECK SYSTEM | PM | 21/5/2024 | |
| 20240521 | B00-C-00065 | B-DCS-P1-B-BOILER | DCS HONEYWELL DELTA-P1 MO CONTROLLER SOFWA | (1M)DAILY CHECK SYSTEM | PM | 21/5/2024 | |
| 20240521 | B00-C-00065 | B-DCS-P1-ORP | DCS HONEYWELL C300 EXPERION R311-1 | (1M)DAILY CHECK SYSTEM | PM | 21/5/2024 | |
| 20240521 | B00-C-00065 | B-DCS-P2 | DCS YOKOGAWA CP461-S0/APV300/REVISION RS | (1M)DAILY CHECK SYSTEM | PM | 21/5/2024 | |
| 20240521 | B00-C-00065 | B-DCS-P3 | DCS HONEYWELL C300 EXPERION | (1M)DAILY CHECK SYSTEM | PM | 21/5/2024 | |
| 20240521 | B38-C-00099 | B-FOJNIE | GROUPING FOR 380V SWGR S TAG | (1M)INSPECT CABLE/TIGHTNESS NUTS/SCREW | PM | 21/5/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|------------|-----------|--|
| 20240520 | 963-C-00113 | B-DV-16802 | DELUGE VALVE FOR CS PHU UNIT | (6M) SPRAY TEST | PM | 20/5/2024 | |
| 20240520 | 963-C-00113 | B-DV-16803 | DELUGE VALVE FOR CS PHU UNIT | (6M) SPRAY TEST | PM | 20/5/2024 | |
| 20240520 | 838-C-00028 | B-EI0SR03 | GROUPING FOR MCC 11 TAG | (1Y)INSPECT CONTROL WIRING/CONTACT | PM | 20/5/2024 | |
| 20240520 | 819B-C-00024 | B-FT-3021 | ANTI-SURGE,CG COMP 3RD STG DSCH | (6M)FLUSH/VENT IMPULSE LINE OF FLOW TX | PM | 20/5/2024 | |
| 20240520 | 819B-C-00024 | B-FT-3022 | ANTI-SURGE,CG COMP 2ND STG DSCH | (6M)FLUSH/VENT IMPULSE LINE OF FLOW TX | PM | 20/5/2024 | |
| 20240520 | 806F-S-00001 | B-M-19009 | GROUPING TAG FOR LPG FROM PITTC4 | (6M)PROVE TURBINE METER & DENSITOMETER | PM | 20/5/2024 | |
| 20240520 | 890-C-00145 | B-M-P-GROUP-PLANT1 | GROUP TAG FOR MAIN LIGHTING PANEL | (1Y)INSPECTION & VERIFY | PM | 20/5/2024 | |
| 20240520 | 809F-S-00005 | B-MOTOR-EO-006 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION | Motor | 20/5/2024 | |
| 20240520 | 809F-S-00016 | B-MOTOR-EO-DEMIN | GROUPING TAG FOR MOTOR DEMIN PLANT | (3M)LUBRICATION ON OPERATION | Motor | 20/5/2024 | |
| 20240520 | 805F-S-00046 | B-OSIL-7021 | GROUPING TAG FOR OSIL PLANT 2 Group1 | (3M)CHECK & ADJUST (OUT-SOURCE) | PM | 20/5/2024 | |
| 20240520 | 805F-WX-0001 | B-P-1601A | FIRE MAIN PUMP | (1Y)Wetdry-PR suction screen cleaning | Pump | 20/5/2024 | |
| 20240520 | 890-C-00003 | B-PP-3E1-1 | NEW MAIN SUBSTATION NORMAL-HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240520 | 890-C-00003 | B-PP-3E1-2 | NEW PROCESS SUBSTATION NORMAL-HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240520 | 890-C-00003 | B-PP-4F1-1 | CONTROL BUILDING EMERGENCY-HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240520 | 890-C-00003 | B-PP-4F1-2 | NEW MAIN SUBSTATION EMERGENCY-HVAC MOTOR | (1M)CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240520 | 890-C-00003 | B-PP-4F1-3 | NEW PROCESS SUBSTATION EMERGENCY-HVAC MO | (1M)CLEANING AND INSPECTION | PM | 20/5/2024 | |
| 20240520 | 819B-C-00057 | B-PSV-3602A | INLET M-3602 TO HOT FLARE | (3Y)INSPECTION & OVERHAUL | PSV | 20/5/2024 | |
| 20240520 | 89A-C-00011 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 20/5/2024 | |
| 20240520 | 838-C-00038 | B-UPS-406 | GROUPING FOR UPS 125 KVA | (1W)CONDITION CHECK | PM | 20/5/2024 | |
| 20240520 | 912-C-00355 | B-VSD-G-4901-RM-1A | VSD Panel for G-4901-RM-1A | (1M)INSPECTION & Record | PM | 20/5/2024 | |
| 20240520 | 890-C-00194 | B-VSD-MR-1135A | VSD Panel for R-1135A | (1M)INSPECTION & Record | PM | 20/5/2024 | |
| 20240520 | 890-C-00195 | B-VSD-MR-1135S | VSD Panel for R-1135S | (1M)INSPECTION & Record | PM | 20/5/2024 | |
| 20240520 | 8003-C-00019 | B-VSD-MR-1500A | VSD Panel for R-1500A | (1M)INSPECTION & Record | PM | 20/5/2024 | |
| 20240520 | 8003-C-00020 | B-VSD-MR-1500S | VSD Panel for R-1500S | (1M)INSPECTION & Record | PM | 20/5/2024 | |
| 20240519 | 811-C-00104 | B-AT-371204 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 19/5/2024 | |
| 20240519 | 811-C-00110 | B-AT-371214 | ANALYZER (GC) PROPYLENE PRODUCT FROM C3 | (1M) SET & CALIBRATE | PM | 19/5/2024 | |
| 20240519 | 945-C-00002 | B-FT-11441 | METHANOL TO G-1144V-1 | (2Y)SET & CALIBRATE (OUT-SOURCE) | PM | 19/5/2024 | |
| 20240519 | 961-C-00035 | B-FT-11442 | G-1144-P-2A DISCH. | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 19/5/2024 | |
| 20240519 | 961-C-00035 | B-FT-11444 | G-1144-S TO G-1144V-1 | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 19/5/2024 | |
| 20240519 | 961-C-00035 | B-FT-11511 | P-1151 TO Q-1135 | (2Y)SET & CALIBRATE (OUT-SOURCE) | PM | 19/5/2024 | |
| 20240519 | 818B-S-00001 | B-G-300-PI-1A | CG COMPRESSOR MAIN OIL PUMP TURBINE | (1M)CHECK (LUBRICATE) OIL | Compressor | 19/5/2024 | |
| 20240519 | 87-S-00001 | B-G-920-R-15 | AIR BLOWER FOR COND. POLISHING SYSTEM | (1Y)LUBRICATION | PM | 19/5/2024 | |
| 20240519 | 847D-C-00011 | B-MP-1541A | RAW MIXED C4 TRANSFER PUMP MOTOR | (2Y)LUBRICATION | Motor | 19/5/2024 | |
| 20240519 | 89A-C-00017 | B-SECUR-TASK46 | FOR PM: INSPECTION AND CHECK MOBILE AIR | (1M)INSPECTION | PM | 19/5/2024 | |
| 20240518 | 811-C-00100 | B-AT-370501 | C3 LIQUID FROM T-3705 FEED TO L-3705 MAP | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240518 | 811-C-00109 | B-AT-370502 | ANALYZER (GC) MAPD REACTOR RECYCLE | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240518 | 811-C-00101 | B-AT-370503 | LP DETHAN. BOTTOMS FROM P404A'S PUMP | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240518 | 811-C-00105 | B-AT-371202 | PROPYLENE PROD. FROM A-3710 C3 SPLITTER | (1M) SET & CALIBRATE | PM | 18/5/2024 | |
| 20240518 | 8612-C-00027 | B-AT-430106A | F-4301 Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 18/5/2024 | |
| 20240518 | 8612-C-00028 | B-AT-430203 | F-4302 Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 18/5/2024 | |
| 20240518 | 8009-C-00010 | B-E-F-01 | MASTER FIRE ALARM CONTROL PANEL AT CCB | (3M)VISUAL INSPECTION | IM | 18/5/2024 | |
| 20240518 | 8009-C-00010 | B-E-F-02 | FIRE ALARM MONITORING AT FIRE STATION | (3M)VISUAL INSPECTION | IM | 18/5/2024 | |
| 20240518 | 8009-C-00010 | B-E-F-03 | FIRE ALARM POWER PANEL TANK AREA | (3M)VISUAL INSPECTION | IM | 18/5/2024 | |
| 20240518 | 809F-C-00046 | B-MOTOR-EO-011 | GROUPING FOR MOTORS CONSOLE#6 | (3M)CLEANING & INSPECTION/LUBRICATION | Motor | 18/5/2024 | |
| 20240518 | 805-C-00055 | B-PIPEF-SCL | LINE STEAM CONDENSATE OLE 2-1 | (3M) CONDITION CHECK (OSL 201-105) | PM | 18/5/2024 | |
| 20240518 | 805-C-00058 | B-PIPEF-SCL | LINE STEAM CONDENSATE OLE 2-1 | (3M) CONDITION CHECK (OSL 201-105) | PM | 18/5/2024 | |
| 20240518 | 812-C-00001 | B-STANDARD-GAS | GROUPING TAG FOR STANDARD GAS | (1M)CHECK STANDARD GAS STATUS | PM | 18/5/2024 | |
| 20240518 | 809F-S-00008 | B-SWGRG-EO-2E1 | GROUPING TAG FOR SWGR | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 18/5/2024 | |
| 20240518 | 8C14-C-00003 | B-VY-3841-PIA | CORROSION INHIBITOR INJECTION PUMP | (1Y)LUBRICATE | PM | 18/5/2024 | |
| 20240517 | 811-C-00094 | B-AT-340610 | ACETYLENE REACTOR EFFLUENT | (1M) SET & CALIBRATE | PM | 17/5/2024 | |

| | | | | | | | |
|----------|--------------|-----------------|--|--|------------|-----------|------------|
| 20240517 | 8061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 17/5/2024 | Pump |
| 20240517 | 961-C-00079 | B-P-1133S | SLCP OIL TRANSFER PUMP | (1Y) CHANGE LUBE OIL | PM | 17/5/2024 | Pump |
| 20240517 | 8061-C-00018 | B-P-1136S | SLCP TRANSFER PUMP | (1M) CLEAN STRAINER FOR B-P-1136 | PM | 17/5/2024 | Pump |
| 20240517 | 961-C-00018 | B-P-1136S | SLCP TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 17/5/2024 | Pump |
| 20240517 | 861-C-00123 | B-P-1165A | SLUDGE STORAGE AREA SLUMP PUMP | (3M)REGREASE | PM | 17/5/2024 | Pump |
| 20240517 | 861-C-00124 | B-P-1165S | SLUDGE STORAGE AREA SUMP PUMP | (3M)REGREASE | PM | 17/5/2024 | Pump |
| 20240517 | 8063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 17/5/2024 | Pump |
| 20240517 | 8063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 17/5/2024 | Pump |
| 20240517 | 8063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 17/5/2024 | Pump |
| 20240517 | 8063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 17/5/2024 | Pump |
| 20240517 | 8063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 17/5/2024 | Pump |
| 20240517 | 8063-WK-0002 | B-P-1601T | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 17/5/2024 | Pump |
| 20240517 | 812-C-00042 | B-PCZ-RV-HOUSE1 | GROUPING TAG FOR RCV RV HOUSE1 | (1Y)SET&CALIBRATE | PM | 17/5/2024 | Pump |
| 20240517 | 89A-C-00055 | B-PSH-PUMP#4/1 | Grouping Tag pump seal Plant-4/1 | (1Y)SET&CALIBRATE | Motor | 17/5/2024 | Motor |
| 20240517 | 89A-C-00056 | B-PSH-PUMP#4/2 | Grouping Tag pump seal Plant-4/2 | (1Y)SET&CALIBRATE | Motor | 17/5/2024 | Motor |
| 20240517 | 89A-C-00056 | B-PSH-PUMP#4/2 | Grouping Tag pump seal Plant-4/2 | (1Y)SET&CALIBRATE | Motor | 17/5/2024 | Motor |
| 20240517 | 809A-C-00001 | B-PSV-0301A | T-030A TO HOT FLARE | (3Y)INSPECTION & OVERHAUL | PSV | 17/5/2024 | PSV |
| 20240517 | 827-C-00035 | B-PSV-3940S | LP STEAM TO T-394/B | (3Y)SET & CALIBRATE (PSV 1X2) | PSV | 17/5/2024 | PSV |
| 20240517 | 841-C-00022 | B-PSV-4750A | T-475 TO COLD FLARE | (3Y)SET&CALIBRATE (PSV 1/2X2 1/2) | PM | 17/5/2024 | PSV |
| 20240517 | 842A-C-00007 | B-PSV-6100A | H-610 TO COLD FLARE | (3Y)SET&CALIBRATE (PSV 1/2X2 1/2) | PM | 17/5/2024 | PSV |
| 20240517 | 847A1-C-0032 | B-4-1531 | ETHYLENE RECOVERY COMPRESSOR | (1Y)INSPECTION | Compressor | 17/5/2024 | Compressor |
| 20240517 | 819A-C-00058 | B-R-400C-RM | CRACKED GAS COMPRESSOR | (1M) N2 PRESSURE INSPECTION | Compressor | 17/5/2024 | Compressor |
| 20240517 | 8216-C-00024 | B-R-400C-RM | TAIL GAS COMPRESSOR MOTOR | (3M)LUBRICATION & CHECK | PM | 17/5/2024 | Compressor |
| 20240517 | 8428-C-00014 | B-R-600-P-1A | C2R COMPRESSOR CONDENSATE PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/5/2024 | Compressor |
| 20240517 | 8428-C-00012 | B-R-600-P-2A | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/5/2024 | Compressor |
| 20240517 | 8428-C-00031 | B-R-600-P-2S | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/5/2024 | Compressor |
| 20240517 | 819A-C-00058 | B-R/RX-401A | TAIL GAS EXPANDER & COMPRESSOR | (1M) N2 PRESSURE INSPECTION | Compressor | 17/5/2024 | Compressor |
| 20240517 | 819A-C-00058 | B-R/RX-401B | TAIL GAS COMPRESSOR | (1M) N2 PRESSURE INSPECTION | Compressor | 17/5/2024 | Compressor |
| 20240517 | 819A-C-00058 | B-R/T-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) N2 PRESSURE INSPECTION | Compressor | 17/5/2024 | Compressor |
| 20240517 | 819A-C-00058 | B-R/T-690 | ETHYLENE RECOVERY COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | Compressor | 17/5/2024 | Compressor |
| 20240517 | 819A-C-00058 | B-R/T-690 | PROPYLENE REFRIGERANT COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | Compressor | 17/5/2024 | Compressor |
| 20240517 | 890-C-00001 | B-S-1301 | Demountable Rare Stack | (6M)Check & Record Pilot Temp Element | IM | 17/5/2024 | Warm(Rare) |
| 20240517 | 8C19-C-00006 | B-S-1302 | Demountable Rare Stack | (6M)Check & Record Pilot Temp Element | IM | 17/5/2024 | Warm(Rare) |
| 20240517 | 812-C-00021 | B-SCADA-BV | SCADA SYSTEM FOR BV | (1M)VISUAL INSPECT | PM | 17/5/2024 | |
| 20240517 | 89A-C-00029 | B-SECUR-TASK36 | INSPECTION EQUIPMENT INSIDE CON | (4M)INSPECTION | PM | 17/5/2024 | |
| 20240517 | 890-C-00115 | B-SWGR-EO-80 | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | 811-C-00020 | B-V-910-P-1A | MORPHOLINE INJECTION PUMP | (1Y)LUBRICATION & CLEANING | PM | 17/5/2024 | |
| 20240517 | 812-C-00019 | B-XPRR-ZEB-F1 | POWER TRANSFORMER #002/230V FOR BUS 2E3 | (3M)RCM Visual Inspection | PM | 17/5/2024 | |
| 20240517 | 812-C-00019 | B-XPRR-ZEB-F2 | POWER TRANSFORMER #002/230V FOR BUS 2E3 | (3M)RCM Visual Inspection | PM | 17/5/2024 | |
| 20240516 | 8013-C-00012 | B-A-210 | QUENCH OIL TOWER | (3M) CONDITION CHECK (OSL 201-105) | PM | 16/5/2024 | |
| 20240516 | 823A-C-00014 | B-AT-19001 | FUEL GAS CUSTODY INLET | (1W)CALIBRATION | PM | 16/5/2024 | |
| 20240516 | 846F-C-00010 | B-AT-486001 | DENSITOMETER OF METERING SKID CAR | (4M)PROVE DENSITOMETER OF METERING SKID | PM | 16/5/2024 | |
| 20240516 | 838-C-00093 | B-DV-NPA-001 | GROUPING TAG FOR DELUGE VALVE NPA | (6M)REGREASE & VISUAL | PM | 16/5/2024 | |
| 20240516 | 810E-C-00011 | B-F-150 | USC RURNACES | (6M)REGREASE DAMPER BEARING. | Furnace | 16/5/2024 | |
| 20240516 | 84-C-00003 | B-FT-9025A | NP STEAM | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 16/5/2024 | |
| 20240516 | 84-C-00003 | B-FT-9025B | NP STEAM | (2Y)CHECK & ADJUST (OUT-SOURCE) | PM | 16/5/2024 | |
| 20240516 | 866-C-00007 | B-G-1112-P-1A | HIGH PRESSURE FEED PUMPS | (1W)CLEAN STRAINER/INSPECTION | PM | 16/5/2024 | |
| 20240516 | 866-C-00007 | B-G-1112-P-1B | HIGH PRESSURE FEED PUMPS | (1W)CLEAN STRAINER/INSPECTION | PM | 16/5/2024 | |
| 20240516 | 866-C-00007 | B-HV-310413 | MOTOR OPERATED TRANSFER LINE VALVE OF F-3104 | (6M)LUBRICAT AND INSPECT 22 VALVE Group# | PM | 16/5/2024 | |
| 20240516 | 866-C-00029 | B-HV-310414 | MOTOR OPERATED DECOCKING VALVE OF F-3104 | (6M)LUBRICAT AND INSPECT 22 VALVE Group# | PM | 16/5/2024 | |

| | | | | | | | |
|----------|--------------|---------------------|---|---|----|-----------|-------|
| 20240517 | B2HD-C-00011 | B-AT-382105 | ISO 14000 PH METER TX FOR V-3821-P-1 OUTL | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00064 | B-AT-402101 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00065 | B-AT-402105 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00066 | B-AT-402201 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00068 | B-AT-420101A | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00069 | B-AT-420101B | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00029 | B-AT-430105 | Fuel Gas of F-4301 and F-4302 CEMs | (1M)SET & CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00071 | B-AT-430401 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00032 | B-AT-480104 | FE-4801-Q2 Downstream TCC | (1M)SET & CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B12-C-00033 | B-AT-480204 | FE-4802-Q2 Downstream TCC | (1M)SET & CALIBRATE | PM | 17/5/2024 | |
| 20240517 | B90-S-00043 | B-BC-2EE-110-1 | BATTERY CHARGER 110VDC 6.36 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00044 | B-BC-2EE-110-2 | BATTERY CHARGER 110VDC6.36 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00045 | B-BC-2EE-24-1 | BATTERY CHARGER 24VDC 2.5 KVA(DUTY) | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00046 | B-BC-2EE-24-2 | BATTERY CHARGER 24VDC 2.5 KVA(STAND BY) | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00048 | B-BC-2M1-1 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00049 | B-BC-2M1-2 | 110 VDC BATTERY CHARGER PANEL | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00050 | B-BC-3A4-1 | BATTERY CHARGER NO. 1 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00051 | B-BC-3A4-2 | BATTERY CHARGER NO. 2 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00007 | B-BC1-2E5 | BATTERY CHARGER AT NEW MAIN SUB.-1 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00040 | B-BC1-2E5-2 | BATTERY CHARGER AT NEW MAIN SUB.-2 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00041 | B-BC1-3A4 | BATTERY CHARGER PANEL NO.1 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00025 | B-BC2-2E5 | BATTERY CHARGER AT NEW PRO. SUB.-1 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00042 | B-BC2-2E5-2 | BATTERY CHARGER AT NEW PRO. SUB.-2 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B90-S-00047 | B-BC2-KW1A | BATTERY CHARGER PANEL NO.2 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/5/2024 | |
| 20240517 | B12-C-00401 | B-CP-TRU-01 | CATHODIC PROTECTION RECTIFIER NO.1 | (1M)VISUAL INSPECTION & RECORD | PM | 17/5/2024 | |
| 20240517 | B90-C-00150 | B-CP-TRU-PLANT2 | GROUP FOR CP TRU PLANT2 | (1M)VISUAL INSPECTION | PM | 17/5/2024 | |
| 20240517 | B63-C-00004 | B-DV-1617 | LUBE&SEAL OIL CONSOLE DELUGE VALVE | (1Y)CHECK CARD CONTROL | PM | 17/5/2024 | |
| 20240517 | B63-C-00111 | B-DV-1623A | C2/C3 OFF SPEC TK Q-1537 DELUGE VALVE | (6M) Spray Test | PM | 17/5/2024 | |
| 20240517 | B63-C-00111 | B-DV-1623B | C2/C3 OFF SPEC TK Q-1537 DELUGE VALVE | (6M) Spray Test | PM | 17/5/2024 | |
| 20240517 | B63-C-00111 | B-DV-1624A | PROPYLENE PRODUCT TK Q-1535 DELUGE VALVE | (6M) Spray Test | PM | 17/5/2024 | |
| 20240517 | B63-C-00111 | B-DV-1624B | PROPYLENE PRODUCT TK Q-1535 DELUGE VALVE | (6M) Spray Test | PM | 17/5/2024 | |
| 20240517 | B63-C-00044 | B-DV-1625A | LPG STORAGE TK Q-1520 DELUGE VALVE | (6M) Spray Test | PM | 17/5/2024 | |
| 20240517 | B63-C-00044 | B-DV-1625B | LPG STORAGE TK Q-1520 DELUGE VALVE | (6M) Spray Test | PM | 17/5/2024 | |
| 20240517 | B63-S-00031 | B-EE-5800JF | Group 1 EMERGENCY Exit | (3M)INSPECT, VERIFY & CHECK | PM | 17/5/2024 | |
| 20240517 | B06L-C-00017 | B-G-114A-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-114A-P-2 | PM | 17/5/2024 | Motor |
| 20240517 | B06L-C-00017 | B-G-114A-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-114A-P-2 | PM | 17/5/2024 | Motor |
| 20240517 | B06L-C-00017 | B-G-114A-P-2C | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-114A-P-2 | PM | 17/5/2024 | |
| 20240517 | B12-C-00006 | B-GS-2E-P1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 17/5/2024 | |
| 20240517 | B90-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 17/5/2024 | |
| 20240517 | B90-C-00075 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 17/5/2024 | |
| 20240517 | B10K-C-00038 | B-HV-10105 | F-1010 EFFLUENT TO A-210 | (3M)Collect Torque Profile & Record | IM | 17/5/2024 | |
| 20240517 | B10K-C-00039 | B-HV-10107 | DECOKE EFFLUENT TO F-1010 | (3M)Collect Torque Profile & Record | IM | 17/5/2024 | |
| 20240517 | B096-C-00070 | B-M-19075 | GROUPING TAG FOR RFG FROM PTTPE | (6M)MOVE LUB.TURBINE METER (OUT-SOURCE) | PM | 17/5/2024 | |
| 20240517 | B09C-00017 | B-MC-DE-2E2 | Grouping Tag for MCC-2E2 | (3M)CHECK BOLT/TIGHTNESS NUTS AND SCR | PM | 17/5/2024 | |
| 20240517 | B39-S-00065 | B-MOTORE-EP-NFA-001 | GROUPING TAG FOR MOTOR NFA AREA | (1W)CLEAN LUBE AND INSPECTION | PM | 17/5/2024 | Motor |
| 20240517 | B51B-C-00120 | B-MP-1204A | Cooling water Pump Motor | (1Y)CHANGE LUBE, OIL MOTOR | PM | 17/5/2024 | Motor |
| 20240517 | B47B-C-00014 | B-MR-600-P-1A | C2R CONDENSER COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/5/2024 | |
| 20240517 | B47B-C-00012 | B-MR-600-P-2A | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/5/2024 | |
| 20240517 | B47B-C-00031 | B-MR-600-P-2S | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/5/2024 | |
| 20240517 | B05L-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 17/5/2024 | Pump |

| | | | | | | | |
|----------|----------------|--------------------|--|---|----|-----------|------------|
| 20240515 | 0528-B-C-00122 | B-MP-1204C | Cooling water Pump Motor | (1)YOCCHANGE LUBE OIL MOTOR | PM | 13/5/2024 | Motor |
| 20240515 | 0528-B-C-00123 | B-MP-1204S | Cooling water Pump Motor | (1)YOCCHANGE LUBE OIL MOTOR | PM | 13/5/2024 | Motor |
| 20240515 | 0511-C-00159 | B-NOVEC-01 | NOVEC CONTROL PANEL - NEW CCB | (1M) Novect1230 System Visual Inspection | PM | 13/5/2024 | |
| 20240515 | 0511-C-00160 | B-NOVEC-01 | NOVEC CONTROL PANEL - NEW CCB | (6M)Novect1230 Cleaning and Function Test | PM | 15/5/2024 | |
| 20240515 | 0673-S-00001 | B-OIL-MIST-PLANT2 | Grouping Tag for Oil Mist Systems PI-4/2 | (1M) Oil Mist Monthly PM | PM | 15/5/2024 | |
| 20240515 | 0603-C-00046 | B-P-1602A | FIRE WATER JOCKEY PUMP | (1M)Visual Inspect Conclusion | PM | 15/5/2024 | Pump |
| 20240515 | 0603-C-00047 | B-P-1602S | FIRE WATER JOCKEY PUMP | (1M)Visual Inspect Conclusion | PM | 15/5/2024 | Pump |
| 20240515 | 019A-C-00023 | B-PCV-3116 | ISO14000,VALVE N2 BLANKET OVH R-300-Q-3 | (2V) CALIBRATION | PM | 15/5/2024 | |
| 20240515 | 019A-C-00023 | B-PCV-3118 | ISO14000,VALVE VENT OVH R-300-Q-3OCABON | (2V) CALIBRATION | PM | 15/5/2024 | |
| 20240515 | 0635-S-00018 | B-PE-1601S | FIRE MAIN PUMP ENGINE | (1M)VISUAL INSPECTION | PM | 15/5/2024 | |
| 20240515 | 0635-S-00018 | B-PE-1602A | VOC TANK AREA BLOWER | RCM-(1V) BECT INSPECTION | PM | 15/5/2024 | |
| 20240515 | 047D-C-00115 | B-R-1300A | VOC TANK AREA BLOWER | RCM-(4M) CHANGE LUBE OIL | PM | 15/5/2024 | |
| 20240515 | 088E-C-00002 | B-RT-1301 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (6M)REC PARTIAL STROKE TEST | PM | 15/5/2024 | Compressor |
| 20240515 | 088E-C-00002 | B-RT-3600 | ETHYLENE COMPRESSOR TURBINE DRIVER | (6M)REC PARTIAL STROKE TEST | PM | 15/5/2024 | Compressor |
| 20240515 | 088E-C-00002 | B-RT-3650 | PROPYLENE COMPRESSOR TURBINE DRIVER | (6M)REC PARTIAL STROKE TEST | PM | 15/5/2024 | Compressor |
| 20240515 | 012-C-00016 | B-WALVE3-CWR | VALVE COOLING WATER RETURN OLE 2-3 | (1M)INSPECT GEAR OF BTF VALVE CWR T-4045 | IM | 15/5/2024 | |
| 20240515 | 010K-C-00022 | B-AT-10103 | ISO14000,CEMS SOX/NOX/CO F-1010 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/5/2024 | |
| 20240515 | 010L-C-00024 | B-AT-10203 | ISO14000,CEMS SOX/NOX/CO F-1020 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/5/2024 | |
| 20240515 | 00P1-C-00028 | B-AT-1003/1-1-3 | GROUPING TAGS CEMS AT-1103/1/203/1303 | (1M)SET & CALIBRATION | PM | 14/5/2024 | |
| 20240515 | 00P1-C-00028 | B-AT-1003/4-6 | GROUPING TAGS CEMS AT-1403/1503/1603 | (1M)SET & CALIBRATION | PM | 14/5/2024 | |
| 20240515 | 00P1-C-00028 | B-AT-1003/2-3-9 | GROUPING TAGS CEMS AT-1703/1803/1903 | (1M)SET & CALIBRATION | PM | 14/5/2024 | |
| 20240515 | 03A-C-00013 | B-AT-2411A | ISO14000,CEMS SOX/NOX CO ANALYZER S-2401 | (1M)SET & CALIBRATE CEMS(B-2401) | PM | 14/5/2024 | |
| 20240515 | 039-C-00001 | B-AT-4000 | PSA UNIT INLET | (2M)SET & CALIBRATE | PM | 14/5/2024 | |
| 20240515 | 03A-S-00013 | B-B-2401 | STEAM GENERATOR | (3M)LUBRICATION B-2401 | PM | 14/5/2024 | |
| 20240515 | 090-C-00027 | B-CO2-SUB1-1 | CO2 FIRE SYSTEM CONTROL PANEL(SWGR) SUB1 | (1M)INSPECTION | PM | 14/5/2024 | |
| 20240515 | 090-C-00027 | B-CO2-SUB1-2 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M)INSPECTION | PM | 14/5/2024 | |
| 20240515 | 03-C-00003 | B-FI-9011 | HP STM TO PT-901A TURB | (2V)CHECK & ADJUST (OUT-SOURCE) | PM | 14/5/2024 | |
| 20240515 | 03-C-00003 | B-FI-9025A | HP STEAM | (2V)CHECK & ADJUST (OUT-SOURCE) | PM | 14/5/2024 | |
| 20240515 | 03-C-00003 | B-FI-9025B | HP STEAM | (2V)CHECK & ADJUST (OUT-SOURCE) | PM | 14/5/2024 | |
| 20240515 | 0635-S-00015 | B-G-1411A-1-1 | CO2 ANALYZER TRANSMITTER FOR B-1301/3102 | (1M)SET & CALIBRATION | PM | 13/5/2024 | |
| 20240515 | 00P5-C-00030 | B-M-1500A | GROUPING TAG FOR HP PROPYLENE TO JRPC | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | PM | 14/5/2024 | |
| 20240515 | 052A-C-00025 | B-Q-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-081) | IM | 14/5/2024 | |
| 20240515 | 03A-C-00012 | B-R-2401 | FD. FAN | (1M)CHECK LUBRICATING OIL | PM | 14/5/2024 | |
| 20240515 | 08A-C-00014 | B-SECUR-TASK22 | FOR PM: INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/5/2024 | |
| 20240515 | 08A-C-00028 | B-SECUR-TASK34 | FOR PM: INSPECTION CHEMICAL PROTECTIVE | (4M)INSPECTION | PM | 14/5/2024 | |
| 20240515 | 032-C-00102 | B-SH-10402 | FLUXE 725 Process Calibrator | (1V)CALIBRATION STANDARD EQ.(OUT-SOURCE) | PM | 14/5/2024 | |
| 20240515 | 032-C-00106 | B-SH-10111 | DRUCK 20 Bar Pressure Calibrator | (1V)CALIBRATION STANDARD EQ.(OUT-SOURCE) | PM | 14/5/2024 | |
| 20240515 | 032-C-00111 | B-ST-0603 | AMSTER JORNA 550 C Temp Calibrator | (1V)CALIBRATION STANDARD EQ.(OUT-SOURCE) | PM | 14/5/2024 | |
| 20240515 | 014-C-00016 | B-AT-310102 | CO2 ANALYZER TRANSMITTER FOR B-1301/3102 | (1M)SET & CALIBRATION | PM | 13/5/2024 | |
| 20240515 | 00T2-C-00028 | B-AT-31201/1-5 | GROUPING TAG FOR CO2 ANALYZER (SCSI 1-4-2) | (1M)ISO SET & CALIBRATION | PM | 13/5/2024 | |
| 20240515 | 000-C-00025 | B-DCS-PI-BOILER | DCS EMERSON DELTA-V MD CONTROLLER SOFTWARE | (1P)PAYMENT SERVICE AGREEMENT Delav | PM | 13/5/2024 | |
| 20240515 | 060B-C-00025 | B-DCS-P2 | DCS YOKOGAWA CPM461-S0/APA30D/REVISION RS | (1P)PAYMENT SERVICE AGREEMENT YOKOGAWA | PM | 13/5/2024 | |
| 20240515 | 00P6-C-00014 | B-M-15018 | GROUPING TAG FOR FUEL GAS TO TCC/CCCO | (2)UPDATE N2, CO2, REL. DENSITY | PM | 13/5/2024 | |
| 20240515 | 001Y-C-00001 | B-M-15190 | Grouping Tag for Ruff from GC3 to KAC | (4M)SET & CALIBRATE | PM | 13/5/2024 | |
| 20240515 | 001Y-C-00002 | B-M-15190 | Grouping Tag for Ruff from GC3 to KAC | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | PM | 13/5/2024 | |
| 20240515 | 001Y-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 13/5/2024 | Motor |
| 20240515 | 0338-S-00002 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 13/5/2024 | Motor |
| 20240515 | 0635-S-00014 | B-M-1601A | FIRE MAIN PUMP | (1M)CLEANING AND INSPECTION. | PM | 13/5/2024 | Pump |
| 20240515 | 033A-C-00012 | B-P-8525 | CS HYDROGENATION PRODUCT PUMPS | (1V)LUBRICATION & CLEANING | PM | 13/5/2024 | Pump |
| 20240515 | 090-S-00005 | B-PM-3201S | QUENCH WATER PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 13/5/2024 | Pump |

| | | | | | | | |
|----------|--------------|--------------------|--|---|----|-----------|------------|
| 20240515 | 047A1-C-0006 | B-PV-15303 | MIN FLOW CONTROL VALVE FOR R-1531 | (1V)STROKE CHECK/CALIBRATE (OUT-SOURCE) | PM | 13/5/2024 | |
| 20240515 | 057-B-0002 | B-R-1402 | INSTANTANEOUS AIR COMPRESSOR | (4)WINDING & INSPECTION | PM | 13/5/2024 | Compressor |
| 20240515 | 019A-WK-0001 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (1M)INSPECT WRAPPED DRAIN FLANGE | PM | 13/5/2024 | |
| 20240515 | 019A-WK-0002 | B-R-300-PT-1S | CRACKED GAS COMPRESSOR H/P CASING | (2M) RE GREASE DAMPER BEARING | PM | 13/5/2024 | |
| 20240515 | 047H-S-00001 | B-R-3105 | ETHYLENE FURNACE TO FAN#6 | (2W)REGREASE & INSPECTION | PM | 13/5/2024 | |
| 20240515 | BH7A-WK-0001 | B-R-600-PT-1S | CR SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 13/5/2024 | |
| 20240515 | 0436-WK-0001 | B-R-650-PT-1S | CR COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 13/5/2024 | |
| 20240515 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 13/5/2024 | |
| 20240515 | BNA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/5/2024 | |
| 20240515 | BNA-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/5/2024 | |
| 20240515 | B12-C-00356 | B-VSD-G-3841-RM-18 | VSD Panel for G-3841-RM-18 | (1M)Inspection & Record | PM | 13/5/2024 | |
| 20240515 | B12-C-00357 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/5/2024 | |
| 20240515 | B12-C-00357 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/5/2024 | |
| 20240515 | B0P5-S-00004 | B-CAP-N5 | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 13/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16501 | DELUGE VALVE FOR M-577A, R-575A | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16502 | DELUGE VALVE FOR T-576A, T-515 | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16503 | DELUGE VALVE FOR M-576A | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16504 | DELUGE VALVE FOR M-570A, T-570A | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16505 | DELUGE VALVE FOR A-570 | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16506 | DELUGE VALVE FOR A-570 | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16507 | DELUGE VALVE FOR A-510 | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B63-C-00112 | B-DV-16508 | DELUGE VALVE FOR L-551A, L-5515 | (6M) SPRAY TEST | PM | 12/5/2024 | |
| 20240515 | B10D-C-00042 | B-F-120 | USE FURNACES | (2M) CONDITION CHECK (OSL 2020-061) | IM | 12/5/2024 | Furnace |
| 20240515 | B10D-C-00035 | B-F-140 | USE FURNACES | (3M) CONDITION CHECK (OSL 2020-060) | IM | 12/5/2024 | Furnace |
| 20240515 | BNA-C-00052 | B-GC-2M1 | GROUPING FOR PM GC 2 Month group1 | (2M)SET/CALIBRATE | PM | 12/5/2024 | |
| 20240515 | B00-C-00057 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2020-057) | PM | 12/5/2024 | |
| 20240515 | B61-C-00078 | B-P-1132A | CPI FEED PUMP | (1V) CHANGE LUBE OIL | PM | 12/5/2024 | Pump |
| 20240515 | B52A-C-00024 | B-P-1201C | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2020-059) | IM | 12/5/2024 | Pump |
| 20240515 | B00-C-00060 | B-PIPEL-SC1 | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-067) | IM | 12/5/2024 | |
| 20240515 | B00A-S-00002 | B-A-53A-PT-11A | MAIN LUBE OIL PUMP TURBINE | (6M)INSPECTION & LUBRICATE | PM | 12/5/2024 | |
| 20240515 | BNA-C-00012 | B-SECUR-TASK06 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/5/2024 | |
| 20240515 | BNA-C-00012 | B-SECUR-TASK45 | FOR PM: INSPECTION AND CHECK MOBILE GENE | (1M)INSPECTION | PM | 12/5/2024 | |
| 20240515 | B09A-C-00011 | B-T-030B | UPS VAPORIZERS | (3M) CONDITION CHECK (OSL 2021-068) | IM | 12/5/2024 | |
| 20240515 | B09B-C-00003 | B-T-061 | LUNGA/ARU FEED QO HEATER | (3M) CONDITION CHECK (OSL 2020-056) | IM | 12/5/2024 | |
| 20240515 | B47D-C-00004 | B-V-1540 | MIXED C4 STORAGE REFRIGERATION UNIT | (1V)CHECK & INSPECTION. | IM | 12/5/2024 | |
| 20240515 | B021-C-00004 | B-AT-3600C | CG DEHYDRATORS BEDS | (1M)MOISTURE ANALYZER AMETEX | PM | 11/5/2024 | |
| 20240515 | BT-C-00002 | B-W-17-04-02 | DIGITAL MULTIMETER | (1V)SET & CALIBRATE | PM | 11/5/2024 | |
| 20240515 | BT-C-00002 | B-W-17-04-05 | DIGITAL MULTIMETER | (1V)SET & CALIBRATE | PM | 11/5/2024 | |
| 20240515 | BT-C-00002 | B-W-17-04-10 | DIGITAL MULTIMETER | (1V)SET & CALIBRATE | PM | 11/5/2024 | |
| 20240515 | BT-C-00002 | B-W-17-04-22 | DIGITAL MULTIMETER | (1V)SET & CALIBRATE | PM | 11/5/2024 | |
| 20240515 | B10D-C-00002 | B-F-140 | USE FURNACES | (3M) CONDITION CHECK (OSL 2022-133) | IM | 11/5/2024 | Furnace |
| 20240515 | B060-C-00042 | B-G-1122-C-5 | WWT CHEMICAL SEWER SUMP PIT | (3M) CONDITION CHECK (OSL 2020-044) | IM | 11/5/2024 | |
| 20240515 | B528-S-00026 | B-G-1220-P-1A | CW CORROSION INHIBITOR PUMP | (1V)INSPECTION, CLEAN, LUBRICATE | PM | 11/5/2024 | |
| 20240515 | B00-C-00053 | B-MOTOR-MCC-SUB CT | GROUPING TAG FOR MOTOR-MCC SUB CT | (6M)MOTOR WINDINGS (INSUL. RESISTANCE TEST) | PM | 11/5/2024 | Motor |
| 20240515 | B00-C-00054 | B-MOTOR-MCCSUB-TX | GROUPING TAG FOR MOTOR-MCC SUB TANK | (6M)MOTOR WINDINGS (INSUL. RESISTANCE TEST) | PM | 11/5/2024 | Motor |
| 20240515 | B00-C-00050 | B-MOTOR-MCCSUB1 | GROUPING TAG FOR MOTOR-MCC SUB 1 | (6M)MOTOR WINDINGS (INSUL. RESISTANCE TEST) | PM | 11/5/2024 | Motor |
| 20240515 | B00-C-00051 | B-MOTOR-MCCSUB3 | GROUPING TAG FOR MOTOR-MCC SUB 3 | (6M)MOTOR WINDINGS (INSUL. RESISTANCE TEST) | PM | 11/5/2024 | Motor |
| 20240515 | B00-C-00052 | B-MOTOR-MCCSUB4 | GROUPING TAG FOR MOTOR-MCC SUB 4 | (6M)MOTOR WINDINGS (INSUL. RESISTANCE TEST) | PM | 11/5/2024 | Motor |
| 20240515 | B016-C-00014 | B-Q-220A | QUENCH WATER CIRCULATION PUMP | (3M) CONDITION CHECK (OSL 2022-135) | IM | 11/5/2024 | Pump |
| 20240515 | B001-C-00034 | B-P-901C | SHIP BFW PUMPS | (3M) CONDITION CHECK (OSL 2020-042) | IM | 11/5/2024 | Pump |

| | | | | | | | |
|----------|---------------|-------------------|---|--|----|-----------|----------|
| 20240511 | 047B-C-00019 | B-PSV-153615 | Q-1536 TO HOT FLARE | (5V)PSV Test and Overhaul (EXCISE)Q-1535 | PM | 11/5/2024 | PSV |
| 20240511 | 0061-C-00014 | B-Q-1135 | EQUALIZATION TANK | (3M) CONDITION CHECK (OSL 2020-035) | IM | 11/5/2024 | |
| 20240511 | 047B-C-00019 | B-Q-1536 | PROPYLENE PRODUCT STORAGE TANK | (5V)SF PROOF TEST & INSPECTION | IM | 11/5/2024 | |
| 20240511 | 047B-C-00019 | B-Q-1536 | PROPYLENE PRODUCT STORAGE TANK | (5V)SF PROOF TEST & INSPECTION | IM | 11/5/2024 | |
| 20240511 | 047B-C-00019 | B-Q-1536 | PROPYLENE PRODUCT STORAGE TANK | (5V)SET & CALIBRATE | PM | 11/5/2024 | |
| 20240511 | 019A-C-00060 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (3M) CONDITION CHECK (OSL 2021-066) | IM | 11/5/2024 | |
| 20240511 | BH7A-S-00001 | B-R-3106 | ETHYLENE FURNACE ID FAN#6 | (2M) RE GREASE DAMPER BEARING | IM | 11/5/2024 | |
| 20240511 | 0027-C-00008 | B-T-390A | LP DEPROPANIZER REBOILERS | (3M) CONDITION CHECK (OSL 2020-043) | IM | 11/5/2024 | |
| 20240511 | 038-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/5/2024 | |
| 20240510 | 012-C-00026 | B-AT-40202 | BUTADIENE IR | (2M)SET & CALIBRATE | PM | 10/5/2024 | |
| 20240510 | 012-C-00070 | B-AT-40303 | BUTENE-1 GCG | (1M)SET & CALIBRATE | PM | 10/5/2024 | |
| 20240510 | 012-C-00030 | B-AT-430601 | BUTENE-1 IR | (2M)SET & CALIBRATE | PM | 10/5/2024 | |
| 20240510 | 013-S-00013 | B-BU-2M1 | BATTERY UNIT FOR 110VDC BANK-1 SUB.7 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 013-S-00014 | B-BU-2M2 | BATTERY UNIT FOR 110VDC BANK-2 SUB.7 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 013-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 013-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00052 | B-BU-B-CC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00053 | B-BU-B-CC-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00056 | B-BU-B-CC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00054 | B-BU-B-CC-110 | BATTERY UNIT FOR 110VDC SUB.2 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00055 | B-BU-B-CC-110 | BATTERY UNIT FOR 110VDC SUB-PROCESS | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00057 | B-BU-B-CC | BATTERY UNIT FOR 110VDC SUB.5 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00058 | B-BU-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00062 | B-BU-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00060 | B-BU-UPS-1-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 090-S-00061 | B-BU-UPS-2-1 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (1V)BATTERY DISCHARGE TEST | PM | 10/5/2024 | |
| 20240510 | 010B-C-00012 | B-F-110 | USC FURNACES | (6M)REGREASE DAMPER BEARING | PM | 10/5/2024 | Furnace |
| 20240510 | 010C-C-00011 | B-F-110 | USC FURNACES | (6M)REGREASE DAMPER BEARING | PM | 10/5/2024 | Furnaces |
| 20240510 | 0061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 10/5/2024 | |
| 20240510 | 0061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 10/5/2024 | |
| 20240510 | 0061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2S | PM | 10/5/2024 | |
| 20240510 | 0007-C-00001 | B-G-1167 | CHLORINATOR | (1M)OIL CLEANING & CHANGE LUBE OIL | PM | 10/5/2024 | |
| 20240510 | 0007-C-00001 | B-G-1160 | ELEVATOR | (1M)INSPECTION AND FUNCTION TEST | PM | 10/5/2024 | |
| 20240510 | 012-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 10/5/2024 | |
| 20240510 | 090-C-00010 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 10/5/2024 | |
| 20240510 | 090-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 10/5/2024 | |
| 20240510 | 090-C-00015 | B-GS-3A | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 10/5/2024 | |
| 20240510 | BWS-S-00027 | B-HYDRAULIC-C01 | HYDRAULIC STATIC PRESS 30 T | (1M)MULBICATION & INSPECTION | PM | 10/5/2024 | |
| 20240510 | S44-C-00009 | B-M-3102 | 2 FURNACE SHP STEAM DRUM | (3M)SET & CALIBRATE SPM DRUM, BY LAW "E" | PM | 10/5/2024 | |
| 20240510 | S44-C-00009 | B-M-3102 | 2 FURNACE SHP STEAM DRUM | (3M)STEAM DRUM INSPECTION BY LAW GROUP E | IM | 10/5/2024 | |
| 20240510 | 090-C-00009 | B-MJP-2E2 | NEW MAIN SUB. MAIN LTC & AUX POWER PANEL | (1M)INSPECTION & VERIFY | PM | 10/5/2024 | |
| 20240510 | 090-C-00009 | B-MJP-2E4 | NEW PROCESS SUB. MAIN LTC & AUX POWER PANEL | (1M)INSPECTION & VERIFY | PM | 10/5/2024 | |
| 20240510 | 090-C-00009 | B-MJP-2E5 | NEW PROCESS SUB. MAIN LTC & AUX POWER PA | (1M)INSPECTION & VERIFY | PM | 10/5/2024 | |
| 20240510 | 090-C-00002 | B-MOTOR-LEO-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 10/5/2024 | Motor |
| 20240510 | 001P5-C-00001 | B-NONE-OF-FLNS-P1 | Equipment Not On Motors Plant 1-4/1 | (1M)PARTIAL STROKE TEST FOR SHUTDOWN | PM | 10/5/2024 | |
| 20240510 | 090-C-00168 | B-OSGIS | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/5/2024 | |
| 20240510 | 0061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 10/5/2024 | Pump |
| 20240510 | 0061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 10/5/2024 | Pump |
| 20240510 | 0061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 10/5/2024 | Pump |

| | | | | | | | |
|----------|---------------|--------------------|--|--|----|----------|-------------|
| 20240509 | B63-C-00041 | B-WM-1542 | WATER MONITOR AREA TANK | (6)W/M TANK LUBRICATION | PM | 9/5/2024 | |
| 20240509 | B63-C-00041 | B-WM-1543 | WATER MONITOR AREA TANK | (6)W/M TANK LUBRICATION | PM | 9/5/2024 | |
| 20240508 | B015-C-00019 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2021-078) | IM | 8/5/2024 | |
| 20240508 | B136-C-00001 | B-AT-342001 | MOISTURE ANALYZER TRANSMITTER FOR M-3420 | (2M)SET & CALIBRATE | PM | 8/5/2024 | |
| 20240508 | B464-C-00021 | B-DV-1652 | DELUGE VALVE FOR D-1522 | (6M) Spray Test | PM | 8/5/2024 | |
| 20240508 | B90-C-00137 | B-DV-GROUP-PLANT1 | GROUP TAG FOR DELUGE VALVE | (1)YCHECK CARD CONTROL | PM | 8/5/2024 | |
| 20240508 | B10AM-C-0001 | B-FST-1610 | FOAM TANK | (1)YCHECK CARD CONTROL | PM | 8/5/2024 | |
| 20240508 | B09F-C-00012 | B-FTRC-22051 | GROUPING TAG FOR F-22051/FIC-22051 | (2)YSET & CALIBRATE (OUT-SOURCE) | PM | 8/5/2024 | |
| 20240508 | B49-C-00021 | B-G-1350-P-1 | LP VOC FLARE DRUM LIQUID PUMP | RCM-(1M)Spot Term evesation | PM | 8/5/2024 | Water(Rare) |
| 20240508 | B90-C-00018 | B-MCC-E0-2M1 | GROUPING TAG FOR MCC SUBSTATION#3 | (3M)INSPECT & ADJUST | PM | 8/5/2024 | |
| 20240508 | B13-C-00044 | B-UPS-2M1-A | 220 VAC UPS1 PANEL | (1M)INSPECT/CONDITION CHECK | PM | 8/5/2024 | |
| 20240508 | B13-C-00045 | B-UPS-2M1-A2 | 220 VAC UPS2 PANEL(BYPASS) | (1M)INSPECT/CONDITION CHECK | PM | 8/5/2024 | |
| 20240508 | B13-C-00046 | B-UPS-2M1-A3 | 220 VAC UPS2 PANEL | (1M)INSPECT/CONDITION CHECK | PM | 8/5/2024 | |
| 20240508 | B12-S-00040 | B-V-4799 | OIL MIST SYSTEM | (1M) MONTHLY & INSPECTION | PM | 8/5/2024 | |
| 20240507 | B41-C-00003 | B-AT-4700 | ETHYLENE TOWER | (2M)SET & CALIBRATE | PM | 7/5/2024 | |
| 20240507 | B3A-C-00061 | B-CUT-EQ-COLD-P1 | Critical Equipments Cold Area Plant #1 | (1M)Visual & Condition Inspection | PM | 7/5/2024 | |
| 20240507 | B3A-C-00113 | B-CRITICAL-EQ-HOT | GROUPING TAG FOR NH1_SEC PLANT#1 | (1M)Visual & Condition Inspection | PM | 7/5/2024 | |
| 20240507 | B526-S-00040 | B-G-1224-P-5A | Sulfuric Acid Injection Pump | (1M)INSPECTION, CLEAN, LUBRICATE | PM | 7/5/2024 | |
| 20240507 | B12-S-00028 | B-G-4801-R-1A | COOLING WATER FANS | (2M)COOLING GEARBOX & FAN VISUAL INSPECT | PM | 7/5/2024 | |
| 20240507 | B12-S-00029 | B-G-4801-R-1B | COOLING WATER FANS | (2M)COOLING GEARBOX & FAN VISUAL INSPECT | PM | 7/5/2024 | |
| 20240507 | B12-S-00030 | B-G-4801-R-1C | COOLING WATER FANS | (2M)COOLING GEARBOX & FAN VISUAL INSPECT | PM | 7/5/2024 | |
| 20240507 | B61-C-00077 | B-P-1135A | SLOP OIL TRANSFER PUMP | (1Y) CHANGE LUBE OIL | PM | 7/5/2024 | Pump |
| 20240507 | B46E-S-00001 | B-P-1503A | FRN FEED PUMP FOR Q-1503/4 TO Q-1501/2 | (1Y)INSPECTION & LUBRICATE | PM | 7/5/2024 | Pump |
| 20240507 | B13H4-C-00002 | B-P-3871A | PROCESS SEWER TRANSFER PUMP | (6M)REGREASE | PM | 7/5/2024 | Pump |
| 20240507 | B34-C-00011 | B-P-852A | CS HYDROGENATION PRODUCT PUMPS | (1Y)LUBRICATION & CLEANING | PM | 7/5/2024 | Pump |
| 20240507 | B7-S-00002 | B-P-50002 | LP SUSPENSION DORISSEDA PUMP | (1Y)CLEANING & LUBRICATE | PM | 7/5/2024 | Pump |
| 20240507 | B10-S-00001 | B-P-1010 | RUNNER MOTOR | RCM-(1M)INSPECT & LUBRICATE | PM | 7/5/2024 | Motor |
| 20240507 | B10-S-00001 | B-P-1020 | FURNACE ID FANS | RCM-(1M)INSPECT & LUBRICATE | PM | 7/5/2024 | Motor |
| 20240507 | B10-S-00001 | B-P-1030 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/5/2024 | Motor |
| 20240507 | B10-S-00001 | B-P-180 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/5/2024 | Motor |
| 20240507 | B10-S-00001 | B-P-190 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 7/5/2024 | Motor |
| 20240507 | BNA-C-00007 | B-SECUR-TASK15 | FOR PH: INSPECTION HALON FIRE EXTINGUISH | (1M)INSPECTION | PM | 7/5/2024 | |
| 20240507 | BNA-C-00007 | B-SECUR-TASK29 | FOR PH:MANUAL STATION TEST (ADMIN AREA) | (1M)INSPECTION | PM | 7/5/2024 | |
| 20240507 | B3A-C-00009 | B-TR-01 | DISTRIBUTION TRANSFORMER | (1M)CONDITION CHECK | PM | 7/5/2024 | |
| 20240506 | B029-C-00008 | B-A-540 | PROPYLENE RECTIFIER | (3M) CONDITION CHECK (OSL 2021-101) | IM | 6/5/2024 | |
| 20240506 | B1A-C-00006 | B-AE-1500 | CG EFFLUENT FLOW F-150 | (6M)CALIBRATION | PM | 6/5/2024 | |
| 20240506 | B01-S-00007 | B-AE-1600 | CG EFFLUENT FROM F-160 | (6M)CALIBRATION | PM | 6/5/2024 | |
| 20240506 | B0P1-C-00025 | B-ANALYZER-O2/4/1 | GROUPING FOR OXYGEN ANALYZER PLANT/4/1 | (1M)SET & CALIBRATE | PM | 6/5/2024 | |
| 20240506 | B081-C-00002 | B-AT-1200/1800 | PGC EFFLUENT FROM F-120/F-180 | (1M)SET & CALIBRATION | PM | 6/5/2024 | |
| 20240506 | B081-C-00003 | B-AT-1300/1400/150 | PGC EFFLUENT FROM F-130/F-140/F-150 | (1M)SET & CALIBRATION | PM | 6/5/2024 | |
| 20240506 | B081-C-00004 | B-AT-1500/1700 | PGC EFFLUENT FROM F-150/F-170 | (1M)SET & CALIBRATION | PM | 6/5/2024 | |
| 20240506 | B03-S-00002 | B-AT-8000 | BUTADIENE HYDRO. INLETS/OUTLET | (1M)SET&CALIBRATE | PM | 6/5/2024 | |
| 20240506 | B0P5-S-00002 | B-MOTOR-E0-007 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00015 | B-MOTOR-E0-012 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00016 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00017 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00018 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00019 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00020 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00021 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00022 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00023 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00024 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00025 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00026 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00027 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00028 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00029 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00030 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00031 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00032 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00033 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00034 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00035 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00036 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00037 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00038 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00039 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00040 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00041 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00042 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00043 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00044 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00045 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00046 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00047 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00048 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00049 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00050 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00051 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00052 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00053 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00054 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00055 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00056 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00057 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00058 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00059 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00060 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00061 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00062 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00063 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00064 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00065 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00066 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00067 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00068 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00069 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00070 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00071 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00072 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00073 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00074 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00075 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00076 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00077 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00078 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00079 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00080 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00081 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00082 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00083 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00084 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00085 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00086 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00087 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00088 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00089 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00090 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00091 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00092 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00093 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00094 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00095 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00096 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 6/5/2024 | Motor |
| 20240506 | B0P5-S-00097 | B-OSARV | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | | | |

| | | | | | | | |
|----------|--------------|--------------------|--|---|----|----------|-------|
| 20240502 | 8057-C-00014 | B-G-1478S | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/5/2024 | |
| 20240502 | 8057-C-00015 | B-G-1478A | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/5/2024 | |
| 20240502 | 8057-C-00015 | B-G-1478S | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/5/2024 | |
| 20240502 | 869-C-00002 | B-GROUNDING-ES-001 | GROUNDING TAGS FOR GROUNDING SYSTEM (IN P) | (6M)INSPECTION | PM | 2/5/2024 | |
| 20240502 | 810K-C-00052 | B-HV-1017 | DECOKE EFFLUENT TO F-1010 | (15)CLEANING BOTTOM PLATE INS.(GroupG) | PM | 2/5/2024 | |
| 20240502 | 8C32-C-00002 | B-HY-1105 | HYDRANT AREA NPA | (6M)LUBRICATION | PM | 2/5/2024 | |
| 20240502 | 8C32-C-00002 | B-HY-1106 | HYDRANT AREA NPA | (6M)LUBRICATION | PM | 2/5/2024 | |
| 20240502 | 8C32-C-00002 | B-HY-1107 | HYDRANT AREA NPA | (6M)LUBRICATION | PM | 2/5/2024 | |
| 20240502 | 942B-C-00034 | B-1V-6005 | MP STM TO R-600-PT-15 | (3M) CONDITION CHECK (OSL 2023-284) | IM | 2/5/2024 | |
| 20240502 | 813-S-00010 | B-MOTOR-ORP | Grouping For Motor DRP | (3M)LUBRICATION | PM | 2/5/2024 | Motor |
| 20240502 | 810K-C-00025 | B-MR-1010 | ETHYLENE FURNACE ID FAN#10 MOTOR | (3Y) 10 Fan Motor Overhaul (Group "10") | PM | 2/5/2024 | |
| 20240502 | 8001-C-00040 | B-P-3013 | SPR BOILER FEED WATER PUMP | (3M) CONDITION CHECK (OSL 2023-285) | PM | 2/5/2024 | Pump |
| 20240502 | 820-C-00005 | B-Q-1553 | PRODYSIS RUL OIL STORAGE TANK | (10)INSPECTION | PM | 2/5/2024 | |
| 20240502 | 810K-C-00025 | B-R-1010 | FURNACE ID FANS | RCM(3Y)Overhaul ID Fan Bearing Group ID | PM | 2/5/2024 | |
| 20240502 | 8HD-C-00003 | B-R-3101 | ETHYLENE FURNACE ID FAN#1 | (1M) Visual inspection | PM | 2/5/2024 | |
| 20240502 | 8H4-C-00027 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | (1M) Visual inspection | PM | 2/5/2024 | |
| 20240502 | 8H5-C-00025 | B-R-3103 | ETHYLENE FURNACE ID FAN#3 | (1M) Visual inspection | PM | 2/5/2024 | |
| 20240502 | 8H6-C-00028 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (1M) Visual inspection | PM | 2/5/2024 | |
| 20240502 | 8H7-C-00028 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (1M) Visual inspection | PM | 2/5/2024 | |
| 20240502 | 8H8-C-00006 | B-R-3106 | ETHYLENE FURNACE ID FAN#6 | (1M) Visual inspection | PM | 2/5/2024 | |
| 20240502 | 820-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (MUNGATE) | (10)INSPECTION | PM | 2/5/2024 | |
| 20240502 | 820-C-00003 | B-SECUR-TASK03B | FOR PM: CHECK A WATER TRUCKS (ANYARIN) | (10)INSPECTION | PM | 2/5/2024 | |
| 20240502 | 820-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBULANCE (UTRUSKA) | (10)INSPECTION | PM | 2/5/2024 | |
| 20240502 | 820-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (10)INSPECTION | PM | 2/5/2024 | |
| 20240502 | 813-C-00042 | B-SU7-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/5/2024 | |
| 20240502 | 813-C-00043 | B-SU7-FA-FACP-001 | Firefighting Control Panel at CO2 cylind | (1M)VISUAL INSPECTION | PM | 2/5/2024 | |
| 20240502 | 8H36-C-00003 | B-T-3419 | DRYER REGENERATION HEATER | (3M) CONDITION CHECK (OSL 2023-283) | PM | 2/5/2024 | |
| 20240502 | 800-C-00136 | B-VALVEI-SCB | VALVE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-282) | PM | 2/5/2024 | |
| 20240502 | 863-C-00101 | B-WM-1636 | WATER MONITOR AREA COLD | (6M)WM COLD LUBRICATION | PM | 2/5/2024 | |
| 20240502 | 863-C-00101 | B-WM-1637 | WATER MONITOR AREA COLD | (6M)WM COLD LUBRICATION | PM | 2/5/2024 | |
| 20240502 | 863-C-00101 | B-WM-1638 | WATER MONITOR AREA COLD | (6M)WM COLD LUBRICATION | PM | 2/5/2024 | |
| 20240502 | 863-C-00101 | B-WM-1639 | WATER MONITOR AREA COLD | (6M)WM COLD LUBRICATION | PM | 2/5/2024 | |
| 20240501 | 8H35-C-00001 | B-AT-331001 | MOISTURE ANALYZER TRANSMITTER FOR M-3310 | (2M)SET & CALIBRATE | PM | 1/5/2024 | |
| 20240501 | 8H35-C-00001 | B-AT-331002 | MOISTURE ANALYZER TRANSMITTER FOR M-3310 | (2M)SET & CALIBRATE | PM | 1/5/2024 | |
| 20240501 | 8H37-C-00015 | B-AT-331003 | MOISTURE ANALYZER TRANSMITTER FOR M-3310 | (2M)SET & CALIBRATE | PM | 1/5/2024 | |
| 20240501 | 8H11-S-00003 | B-CALCTM-P2 | Grouping Tag for Cautic Pump 1-4/2 | (1M)CLEAN | PM | 1/5/2024 | |
| 20240501 | 800-C-00075 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1M) Function and Record test | PM | 1/5/2024 | |
| 20240501 | 800-C-00076 | B-CCTV-FI | GROUPING TAG FOR FIRE STATION | (1M) Function and Record test | PM | 1/5/2024 | |
| 20240501 | 800-C-00077 | B-CCTV-GATE | GROUPING TAG FOR GATE | (1M) Function and Record test | PM | 1/5/2024 | |
| 20240501 | 800-C-00078 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/5/2024 | |
| 20240501 | 800-C-00079 | B-CCTV-WH | GROUPING TAG FOR WARE HOUSE | (1M) Function and Record test | PM | 1/5/2024 | |
| 20240501 | 800-C-00080 | B-CCTV-WVS | GROUPING TAG FOR WORK SHOP | (1M) Function and Record test | PM | 1/5/2024 | |
| 20240501 | 800-C-00009 | B-DOS-P1 | DCS HONEYWELL TDC3000/EXPERION | (2M)REMOVE HISTORY FILE | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-DOS-P1 | DCS HONEYWELL TDC3000/EXPERION | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-DOS-P1-ORP | DCS HONEYWELL C300 EXPERION RS11.1 | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00009 | B-DOS-P1-ORP | DCS HONEYWELL C300 EXPERION RS11.1 | (2M)REMOVE HISTORY FILE | PM | 1/5/2024 | |
| 20240501 | 80C3-C-00024 | B-DOS-P2 | DCS YOKOGAWA CP461-50/AFV300/REVISION RS | (6M)CHECK MARSHALLING CABINET | PM | 1/5/2024 | |
| 20240501 | 80C3-C-00022 | B-DOS-P2 | DCS YOKOGAWA CP461-50/AFV300/REVISION RS | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 80C3-C-00023 | B-DOS-P3 | DCS HONEYWELL C300 EXPERION | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 812-C-00676 | B-DOS-P3 | DCS HONEYWELL C300 EXPERION | (6M)CHECK MARSHALLING CABINET | PM | 1/5/2024 | |

| | | | | | | | |
|----------|--------------|----------------|--|--|----|-----------|--|
| 20240430 | 812-C-00782 | B-1036-CO2-001 | CO2 Portable for OLE2/3 | (1M)CO2 Portable Visual Inspection | IM | 30/4/2024 | |
| 20240430 | 812-C-00783 | B-1036-CO2-001 | CO2 Portable for OLE2/3 | (6M)CO2 Portable weight Test | IM | 30/4/2024 | |
| 20240430 | 812-C-00789 | B-1036-DC-001 | Dry Chemical for OLE2/3 | (1M)Dry Chemical Visual Inspection | IM | 30/4/2024 | |
| 20240430 | 812-C-00791 | B-1036-DV-001 | Deluge Valve for Grouping 1 (OLE2/3)/7tag | (6M)Deluge Valve Spray Test | PM | 30/4/2024 | |
| 20240430 | 812-C-00792 | B-1036-DV-002 | Deluge Valve for Grouping 2 (OLE2/3)/7tag | (6M)Deluge Valve Spray Test | PM | 30/4/2024 | |
| 20240430 | 812-C-00795 | B-1036-DV-003 | Deluge Valve for Grouping 3 (OLE2/3)/7tag | (6M)Deluge Valve Spray Test | PM | 30/4/2024 | |
| 20240430 | 812-C-00796 | B-1036-FA-001 | All Manual Fire Alarm for OLE2/3 | (1M)Manual Fire Visual Inspekrt&Test | IM | 30/4/2024 | |
| 20240430 | 812-C-00800 | B-1036-FHH-001 | Fire Hose House for OLE2/3 | (6M)Fire Hose Box Test | IM | 30/4/2024 | |
| 20240430 | 812-C-00804 | B-1036-FM-001 | FM200 for Rack Room 1 (OLE2/3) | (1M)FM200 System Visual Inspection | IM | 30/4/2024 | |
| 20240430 | 812-C-00803 | B-1036-FM-001 | FM200 for Rack Room 1 (OLE2/3) | (6M)FM200 Cleaning and Function Test | IM | 30/4/2024 | |
| 20240430 | 812-C-00772 | B-1036-FIV-001 | Post Indicator Valve for OLE2/3 | (6M)Post Indicator Valve Exercise | IM | 30/4/2024 | |
| 20240430 | 812-C-00773 | B-1036-WDC-001 | Wheeled Fire Extinguishers for OLE2/3 | (1Y)Dry Chemical Powder inspection | PM | 30/4/2024 | |
| 20240430 | 812-C-00777 | B-1036-WH-001 | Water Hydrant for OLE2/3 | (1Y)Water Hydrant Function Test | PM | 30/4/2024 | |
| 20240430 | 848-C-00002 | B-Q-1553 | PRODYSIS RUL OIL STORAGE TANK | (10)INSPECTION | PM | 30/4/2024 | |
| 20240430 | 848-C-00002 | B-Q-1553 | PRODYSIS RUL OIL STORAGE TANK | (10)EXTERNAL INSPECTION (VISUAL CHECK) | PM | 30/4/2024 | |
| 20240430 | 848-C-00033 | B-R-600-PT-15 | C2R SURFACE CONDENSER COND.TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/4/2024 | |
| 20240430 | 848-C-00018 | B-R-650-PT-15 | C3R COMP SURFACE CONDENSER COND TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/4/2024 | |
| 20240430 | 8030-S-00002 | B-V-500-P-15 | POLYMERIZATION INHIBITOR | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 30/4/2024 | |
| 20240429 | 800-C-00130 | B-1034-CO2-001 | CO2 Portable for OLE OLE2/1 | (1M) CO2 Portable Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-C-00131 | B-1034-DC-001 | Dry Chemical for OLE2/1 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/4/2024 | |
| 20240429 | 800-C-00129 | B-1034-DC-002 | Dry Chemical for Admin | (1M)INSPECTION | IM | 29/4/2024 | |
| 20240429 | 800-S-00001 | B-1034-DV-001 | Deluge Valve for OLE OLE2/1Group 1 (- DV) | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-S-00002 | B-1034-DV-002 | Deluge Valve for OLE OLE2/1Group 2 (- DV) | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-S-00003 | B-1034-DV-003 | Deluge Valve for OLE OLE2/1Group 3 (- DV) | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-S-00004 | B-1034-DV-004 | Deluge Valve for OLE OLE2/1Group 4 (- DV) | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-S-00005 | B-1034-DV-005 | Deluge Valve for OLE OLE2/1Group 5 (- DV) | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-S-00006 | B-1034-DV-006 | Deluge Valve for OLE OLE2/1Group 6 (- DV) | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-C-00133 | B-1034-FA-001 | All Manual Fire Alarm for OLE2/1 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/4/2024 | |
| 20240429 | 800-C-00150 | B-1034-FDC-001 | Fire Department Connection for Admin | (1M)Fire Department Connection Visual | IM | 29/4/2024 | |
| 20240429 | 800-C-00152 | B-1034-FHH-001 | Fire Hose House for OLE2/1 | (1M)Fire Hose Box Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-C-00154 | B-1034-FHH-001 | Fire Hose Reel and Cabinet Reel Visual | (1M)Fire Hose and Cabinet Reel Visual | IM | 29/4/2024 | |
| 20240429 | 800-C-00156 | B-1034-FIV-001 | Post Indicator Valve for OLE2/1 | (1M)Post Indicator Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-C-00158 | B-1034-FIV-001 | Post Indicator Valve for OLE2/1 | (1M)Post Indicator Valve Visual Insp | IM | 29/4/2024 | |
| 20240429 | 800-C-00200 | B-1034-WC-001 | Water Curtain for OLE2/1 | (1M)Water Curtain Inspection | IM | 29/4/2024 | |
| 20240429 | 811-C-00116 | B-1034-WDC-001 | Wheeled Fire Extinguishers for OLE2/1 | (1M)Dry Chemical Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-C-00203 | B-1034-WH-001 | Water Hydrant for OLE2/1 | (1M)Water Hydrant Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 800-C-00205 | B-1034-WH-001 | Water Hydrant with Monitor for OLE2/1 | (1M)Water Hydrant Monitor Visual Inspect | IM | 29/4/2024 | |
| 20240429 | 811-C-00086 | B-1035-CO2-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 811-C-00087 | B-1035-DC-001 | Dry Chemical for OLE2/2 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/4/2024 | |
| 20240429 | 811-C-00088 | B-1035-DV-001 | Deluge Valve for Group 1 | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 811-C-00089 | B-1035-DV-002 | Deluge Valve for Group 2 | (1M) Deluge Valve Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 811-C-00090 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/4/2024 | |
| 20240429 | 811-S-00025 | B-1035-WH-001 | Water Hydrant for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 29/4/2024 | |
| 20240429 | 811-S-00026 | B-1035-WH-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant Monitor Visual Inspect | IM | 29/4/2024 | |
| 20240429 | 812-C-00771 | B-1036-FIV-001 | Post Indicator Valve for OLE2/3 | (1M)Post Indicator Valve Visual Insp | IM | 29/4/2024 | |
| 20240429 | 8N4-C-00078 | B-DV-1665 | DELUGE VALVE FOR Q-1523 | (6M) Spray Test | PM | 29/4/2024 | |
| 20240429 | 847F-C-00017 | B-TF-15531 | Min flow P-1553A/S | (3M) CONDITION CHECK (OSL 2021-116) | PM | 29/4/2024 | |
| 20240429 | 852B-S-00038 | B-G-1224-P-4A | NaOCl Injection pump | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 29/4/2024 | |

| | | | | | | | |
|----------|-------------|--------------------|---|----------------------------------|----|----------|--|
| 20240501 | 812-C-00674 | B-DOS-P3 | DCS HONEYWELL C300 EXPERION | (6M)SWITCH OVER SERVER | PM | 1/5/2024 | |
| 20240501 | 863-C-00038 | B-DV-1609 | DEMOMER FUEL DELUGE VALVE | (6M) Spray Test | PM | 1/5/2024 | |
| 20240501 | 863-C-00038 | B-DV-1610 | DEMOMER DEBURT PUMPS DELUGE VALVE | (6M) Spray Test | PM | 1/5/2024 | |
| 20240501 | 863-C-00038 | B-DV-1611 | DEMOMERANIZER REFLEX PUMPS DELUGE VALVE | (6M) Spray Test | PM | 1/5/2024 | |
| 20240501 | 863-C-00038 | B-DV-1612 | C3 RECYCLE PUMPS DELUGE VALVE | (6M) Spray Test | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-ORP | ESMYP4931011TH4.9.050E4.2.0ENH2.10.0 | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P1-TANKARM | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P2-COLDJUT | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P2-FURS/MOT | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P2-FUR6 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 800-C-00022 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (6M)BACKUP PROJECT&CONFIGURATION | PM | 1/5/2024 | |
| 20240501 | 850-C-00016 | B-G-1390S-P-1 | K.O. DRUM PUMP | RCM-(1M)SHORT TERM PRESERVATION | PM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-1-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-A | Condition monitor for inspect Critical | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | B-INSP-CH-OLE2-2-H | Condition monitor for inspect General | Vibration and Condition check | IM | 1/5/2024 | |
| 20240501 | 802J2HCM01 | | | | | | |

| | | | | | | | |
|----------|---------------|-------------------|--|--|----|-----------|-------|
| 20240428 | BWS-5-00009 | B-W514-03-01 | TRUCK LOADER HIMO | (6M)CHANGE ENGINE LUBE OIL & INSPECTION | PM | 28/4/2024 | |
| 20240428 | B0509-S-00003 | B-XFMR-CCB-01 | 6.5/0.4KV DISTRIBUTION TRANSFORMER - NEW | (3M) RCM Visual Inspection | PM | 28/4/2024 | |
| 20240428 | B0509-S-00003 | B-XFMR-CCB-02 | 6.5/0.4KV DISTRIBUTION TRANSFORMER - NEW | (3M) RCM Visual Inspection | PM | 28/4/2024 | |
| 20240427 | B11-C-00091 | B-AT-300601 | ARSIN ANALYZER - FILTER LPG FEED ARSINE | (2M) SET & CALIBRATE | PM | 27/4/2024 | |
| 20240427 | B11-C-00092 | B-AT-300602 | MERCURY ANALYZER - FILTER LPG FEED ARSIN | (2M) SET & CALIBRATE | PM | 27/4/2024 | |
| 20240427 | B09P-C-00027 | B-AT-382102 | SI02 ANALYZER TRANSMITTER FOR V-3821 OUT | (1M)SET & CALIBRATE | PM | 27/4/2024 | |
| 20240427 | B3A-S-00014 | B-P-2401 | STEAM GENERATOR | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 27/4/2024 | |
| 20240427 | B0-C-00141 | B-INTBCKOM-GP3-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 27/4/2024 | |
| 20240427 | B0-C-00056 | B-LP-3E1-1 | LP AT NEW CCB CONTROL ROOM | (4M)INSPECTION & CLEANING | PM | 27/4/2024 | |
| 20240427 | B0-C-00056 | B-LP-3E1-2 | LP AT NEW MAIN SUB | (4M)INSPECTION & CLEANING | PM | 27/4/2024 | |
| 20240427 | B0-C-00056 | B-LP-3E1-3 | LP AT NEW PROCESS SUB | (4M)INSPECTION & CLEANING | PM | 27/4/2024 | |
| 20240427 | B0-C-00056 | B-LP-4F1-1 | LP AT NEW CCB CONTROL ROOM | (4M)INSPECTION & CLEANING | PM | 27/4/2024 | |
| 20240427 | B0-C-00056 | B-LP-4F1-2 | LP AT NEW MAIN SUB | (4M)INSPECTION & CLEANING | PM | 27/4/2024 | |
| 20240427 | B0-C-00056 | B-LP-4F1-3 | LP AT NEW PROCESS SUB | (4M)INSPECTION & CLEANING | PM | 27/4/2024 | |
| 20240427 | B34A-C-00006 | B-P-5805 | DEFENATNIZER BOTTOMS PUMPS | (1M)LUBRICATION & CLEANING | PM | 27/4/2024 | Pump |
| 20240427 | B30-C-00016 | B-PSV-56125 | BHD TO T-565 | (24M)SET & CALIBRATE (PSV 1 1/202) | PM | 27/4/2024 | PSV |
| 20240427 | B19A-C-00020 | B-R-300-P-3A | WASH OIL INJECTION PUMP | (1M)CLEAN & LUBRICATE | PM | 27/4/2024 | |
| 20240426 | B90-C-00058 | B-ASLP-01 | LP FOR ANALYZER HOUSE | (6M)Thermoscan & Inspection | PM | 26/4/2024 | |
| 20240426 | B7-C-00006 | B-AT-9940 | HC LP SUS COND. DISC. P-902A/S | (1M)SET & CALIBRATE | PM | 26/4/2024 | |
| 20240426 | B63-C-00088 | B-DV-NPA-001 | GROUPING TAG FOR DELUGE VALVE NPA | (1M)CHECK/VISUAL HEAT DETECTORS AND | PM | 26/4/2024 | |
| 20240426 | B62-C-00013 | B-G-1142 | SLUDGE STABILIZATION SYSTEM | (6M)INSPECTION & CLEANING & LUBRICANT | PM | 26/4/2024 | |
| 20240426 | B61-C-00104 | B-G-1144-G-1 | PHOSPHORIC ACID DIUTION AGITATOR | (1M)LUBRICATION | PM | 26/4/2024 | |
| 20240426 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/4/2024 | |
| 20240426 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/4/2024 | |
| 20240426 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2S | PM | 26/4/2024 | |
| 20240426 | B12-C-00056 | B-GS-2E-PI | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 26/4/2024 | |
| 20240426 | B05-C-00026 | B-GS-2E1 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 26/4/2024 | |
| 20240426 | B09-C-00075 | B-GS-244 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 26/4/2024 | |
| 20240426 | B09P-C-00023 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (3M)CLEANING & INSPECTION. | PM | 26/4/2024 | Motor |
| 20240426 | B09P-C-00023 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (3M)CLEANING & INSPECTION. | PM | 26/4/2024 | Motor |
| 20240426 | B09P-C-00023 | B-MOTOR-EO-009 | GROUPING FOR MOTORS CONSOLE#5 | (3M)CLEANING & INSPECTION/LUBRICATION | PM | 26/4/2024 | Motor |
| 20240426 | B59-C-00008 | B-P-1124A | CHEMICAL SEWER SUMP PUMP | (3M)REGREASE | PM | 26/4/2024 | Pump |
| 20240426 | B06-C-00019 | B-P-1132A | CPI FEED PUMP | (1M)CLEAN STRAINER FOR B-P-1132 | PM | 26/4/2024 | Pump |
| 20240426 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1M)CLEAN STRAINER FOR B-P-1132 | PM | 26/4/2024 | Pump |
| 20240426 | B061-C-00018 | B-P-1136A | CGF EFFLUENT TRANSFER PUMP | (1M)CLEAN STRAINER FOR B-P-1136 | PM | 26/4/2024 | Pump |
| 20240426 | B061-C-00018 | B-P-1136S | CGF EFFLUENT TRANSFER PUMP | (1M)CLEAN STRAINER FOR B-P-1136 | PM | 26/4/2024 | Pump |
| 20240426 | B13-S-00023 | B-P-1570A | Ughit Naphtha Supply Pump | (1M)CLEANING & INSPECTION | PM | 26/4/2024 | Pump |
| 20240426 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1M)TEST RUN | PM | 26/4/2024 | Pump |
| 20240426 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1M)TEST RUN | PM | 26/4/2024 | Pump |
| 20240426 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 26/4/2024 | Pump |
| 20240426 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 26/4/2024 | Pump |
| 20240426 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1M)TEST RUN | PM | 26/4/2024 | Pump |
| 20240426 | B0-C-00033 | B-P-3601A | ETHANE RECYCLE PUMP | (6M)CHECK & INSPECT | PM | 26/4/2024 | Pump |
| 20240426 | B28S-S-00009 | B-P-520B | CG HYDROGENATION RECYCLE PUMP | (1M)CLEAN & LUBRICATE | PM | 26/4/2024 | Pump |
| 20240426 | B0-C-00033 | B-P-4910A | ETHANE RECYCLE PUMP MOTOR | (6M)CHECK & INSPECT | PM | 26/4/2024 | Pump |
| 20240426 | B034-C-00001 | B-PSV-5801A | A-580 OVD TO HOT FLARE | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | B034-C-00001 | B-PSV-5802A | LP STM TO T-850 | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | B034-C-00001 | B-PSV-5851A | M-585 TO HOT FLARE | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | B34A-C-00019 | B-PSV-8501A | M-850 | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | B34A-C-00022 | B-PSV-8502S | T-850 TO L-850 | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |

| | | | | | | | |
|----------|--------------|---------------------|---------------------------------------|--|----|-----------|------------|
| 20240426 | B34A-C-00023 | B-PSV-8503A | L-850 OVD | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | B34A-C-00023 | B-PSV-8504A | LP STM TO T-850 | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | B34A-C-00023 | B-PSV-8510A | M-851 TO HOT FLARE | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | B34A-C-00028 | B-PSV-8530A | M-853 | (3M)INSPECTION & OVERHAUL | PM | 26/4/2024 | PSV |
| 20240426 | BNA-C-00049 | B-VI-COMP | GROUPING TAG FOR VIBRATION MAJOR COMP | (3M)VIBRATION CHECK. | PM | 26/4/2024 | Motor |
| 20240426 | B11-C-00102 | B-AT-370701 | REGEN EFFLUENT FROM L-3705A/S REACTOR | (6M) SET & CALIBRATE | PM | 25/4/2024 | |
| 20240426 | B11-C-00114 | B-AT-371012 | L-3710S CS GUARD ABSORBER | (2M) SET & CALIBRATE | PM | 25/4/2024 | |
| 20240426 | BNA-C-00062 | B-CRIT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2M)Visual & Condition Inspection | PM | 25/4/2024 | |
| 20240426 | B0-C-00002 | B-EPCD1M4 | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/4/2024 | |
| 20240426 | B09P-C-00001 | B-EPCD1M6 | GROUPING FOR MOTORS CONSOLE#1 | (3M)LUBRICATION ON OPERATION. | PM | 25/4/2024 | |
| 20240426 | B09P-C-00002 | B-EPCD1M6 | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/4/2024 | |
| 20240426 | B09P-C-00003 | B-EPCD1M6 | GROUPING FOR MOTORS CONSOLE#2 | (3M)LUBRICATION ON OPERATION. | PM | 25/4/2024 | |
| 20240426 | B09P-C-00001 | B-EPCD1M6 | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/4/2024 | |
| 20240426 | B09P-C-00001 | B-EPCD1M6 | GROUPING FOR MOTORS CONSOLE#3 | (3M)LUBRICATION ON OPERATION. | PM | 25/4/2024 | |
| 20240426 | B09P-C-00002 | B-EPCD1M6 | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/4/2024 | |
| 20240426 | B09P-C-00001 | B-EPCD1M6 | GROUPING FOR MOTORS CONSOLE#4,5,6 | (3M)LUBRICATION ON OPERATION. | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-ORP | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P1-TANFARM | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P2-COLD/AT | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P2-RURI-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P2-RURI-3 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P2-RURI-3/HOT | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P2-RURI-6 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B10C-C-00039 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-178) | IM | 25/4/2024 | Furnace |
| 20240426 | B3R-C-00048 | B-GAS-DETECTOR-NPA | GROUPING TAG FOR GAS-DETECTOR-NPA | (4M)GAS DETECTOR PLANT2 (OUT-SOURCE) | PM | 25/4/2024 | |
| 20240426 | B12-C-00748 | B-M-486002 | Grouping Tag for Ralf from GC3 to KAC | (4M)SET & CALIBRATE | PM | 25/4/2024 | |
| 20240426 | B12-C-00747 | B-M-486002 | Grouping Tag for Ralf from GC3 to KAC | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | PM | 25/4/2024 | |
| 20240426 | B09P-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/4/2024 | Motor |
| 20240426 | B09P-C-00004 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/4/2024 | Motor |
| 20240426 | B09P-C-00004 | B-MOTOR-EO-009 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CHANGE LUBE OIL MOTOR | PM | 25/4/2024 | Motor |
| 20240426 | B09P-C-00004 | B-MOTOR-EO-009 | GROUPING FOR MOTORS CONSOLE#5 | (3M) CONDITION CHECK (OSL 2022-181) | IM | 25/4/2024 | |
| 20240426 | B09P-C-00004 | B-MOTOR-EO-009 | GROUPING FOR MOTORS CONSOLE#5 | RCM-(1M)MECH SEAL COOLER CLEANING | PM | 25/4/2024 | Pump |
| 20240426 | B11-C-00033 | B-PLC-P1-CCS-CGC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-PLC-P1-CCS-ERC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-PLC-P1-CCS-PRC | ANTI-SURGE AND PERFORMANCE CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-PLC-P1-TTC | TURBOMACHINERY CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-PLC-P2-TTC-CGC | TURBOMACHINERY CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-PLC-P2-TTC-ERC | TURBOMACHINERY CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-PLC-P2-TTC-PRC | TURBOMACHINERY CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | |
| 20240426 | B11-C-00033 | B-PLC-P3-TTC | INTEGRATED TURBINE COMPRESSOR CONTROL | (1M)THERMOSCAN MEASURE TEMPERATURE | PM | 25/4/2024 | Compressor |
| 20240426 | B1-C-00011 | B-PSL1-9015 | SHIP BWI DISTRIB | (2M)INSPECTION & TEST (OUT-SOURCE) | PM | 25/4/2024 | |
| 20240426 | B1-C-00011 | B-PSL1-9015 | LUBE OIL HEADER FOR P-901B | (2M)INSPECTION & TEST (OUT-SOURCE) | PM | 25/4/2024 | |
| 20240426 | B001-C-00037 | B-PT-9013 | SHIP BWI DISTRIB | (2M)INSPECTION & TEST (OUT-SOURCE) | PM | 25/4/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|------------|
| 20240425 | B52B-C-00142 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-177) | IM | 25/4/2024 | |
| 20240425 | B52B-C-00141 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-176) | IM | 25/4/2024 | |
| 20240425 | B20-C-00003 | B-SECUR-TASK03A | FOR PH: CHECK A FOAM TRUCK NO1 (MUNGATE) | (1D)INSPECTION | PM | 25/4/2024 | |
| 20240425 | B20-C-00003 | B-SECUR-TASK03C | FOR PH: CHECK A WATER TRUCK(SAYVARIU) | (1D)INSPECTION | PM | 25/4/2024 | |
| 20240425 | B20-C-00003 | B-SECUR-TASK03E | FOR PH: CHECK AMBULANCE(JITRUSKA) | (1D)INSPECTION | PM | 25/4/2024 | |
| 20240425 | B20-C-00003 | B-SECUR-TASK03F | FOR PH: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 25/4/2024 | |
| 20240425 | BNA-C-00024 | B-SECUR-TASK06 | FOR PH: TEST A FIRE TRUCK | (2W)INSPECTION | PM | 25/4/2024 | |
| 20240425 | B12-C-00758 | B-SST-48004 | HP HEADER STEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-179) | IM | 25/4/2024 | |
| 20240425 | B12-C-00759 | B-SST-48005 | HP HEADER STEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-180) | IM | 25/4/2024 | |
| 20240425 | B90-C-00039 | B-XFMR-261 | POWER TRANSFORMER 6.5/0.4 KV | (3M)RCM Visual Inspection | PM | 25/4/2024 | |
| 20240425 | B90-C-00039 | B-XFMR-262 | POWER TRANSFORMER 6.5/0.4 KV | (3M)RCM Visual Inspection | PM | 25/4/2024 | |
| 20240424 | B11-C-00112 | B-AT-371003 | PROPYLENE PRODUCT TO PROPYLENE PRODUCT H | (2M) SET & CALIBRATE | PM | 24/4/2024 | |
| 20240424 | B11-C-00113 | B-AT-371011 | CS GUARD ABSORBER L-3710A | (2M) SET & CALIBRATE | PM | 24/4/2024 | |
| 20240424 | B11-C-00106 | B-AT-371203 | O2 ANALYZER - PROPYLENE PROD. FROM A-371 | (2M) SET & CALIBRATE | PM | 24/4/2024 | |
| 20240424 | B20-C-00008 | B-AT-5300 | PROPYLENE STRIPPER | (2M)SET & CALIBRATE | PM | 24/4/2024 | |
| 20240424 | B12-C-00043 | B-CP-TB-BV | CP TP GROUPING FOR BV | (2M)ON POTENTIAL PIPE TO SOIL TEST | PM | 24/4/2024 | |
| 20240424 | B90-C-00055 | B-ELP-1 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/4/2024 | |
| 20240424 | B90-C-00055 | B-ELP-2 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/4/2024 | |
| 20240424 | B90-C-00055 | B-ELP-3 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/4/2024 | |
| 20240424 | B90-C-00055 | B-ELP-4 | EMERGENCY LP AT NEW PROCESS AREA | (4M)INSPECTION & CLEANING | PM | 24/4/2024 | |
| 20240424 | B53-C-00020 | B-G-2217-P-1A | CLARIFIER WATER PUMP | (1M)CLEANING & LUBRICATE | PM | 24/4/2024 | |
| 20240424 | B53-C-00020 | B-G-2217-P-6B | ACID FEED PUMP | (1M)SETTING & CALIBRATION | PM | 24/4/2024 | |
| 20240423 | B01S-C-00030 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2022-229) | IM | 24/4/2024 | |
| 20240423 | B61-C-00090 | B-AT-11391 | ISO1000, G-1127-R-1 TO Q-1139 | (2M)COD ANALYZER INSPECT.(OUT-SOURCE) | PM | 23/4/2024 | |
| 20240423 | B12-C-00031 | B-AT-407001 | LP CONDENSATE TDC | (1M)SET & CALIBRATE | PM | 23/4/2024 | |
| 20240423 | B10F-C-00047 | B-F-160 | US FURNACES | (3M) CONDITION CHECK (OSL 2023-227) | IM | 23/4/2024 | Furnace |
| 20240423 | B003-C-00031 | B-F-1995 | HPS from Plant I-1 | (3M) CONDITION CHECK (OSL 2023-231) | IM | 23/4/2024 | |
| 20240423 | B7A2-C-00004 | B-M-1531 | METHANOL VAPORIZER DRUM | (3M) CONDITION CHECK (OSL 2023-230) | IM | 23/4/2024 | |
| 20240423 | B61-C-00125 | B-P-1142A | CONTAMINATED STORM WATER PUMP | (6M)REGREASE | PM | 23/4/2024 | Pump |
| 20240423 | B61-C-00127 | B-P-1167A | FIRE FIGHTING TRAINING A SUMP PUMP | (6M)REGREASE | PM | 23/4/2024 | Pump |
| 20240423 | B13-S-00024 | B-P-1570B | Light Naptha Supply Pump | (1M)COUPLING INSPECTION | PM | 23/4/2024 | Pump |
| 20240423 | B14-C-00013 | B-P-230A | FUEL OIL PRODUCT PUMP | (6M)CLEANING | PM | 23/4/2024 | Pump |
| 20240423 | B006-C-00057 | B-Q-1121 | SPENT CAUSTIC HOLDING TANK | (3M) CONDITION CHECK (OSL 2023-226) | IM | 23/4/2024 | |
| 20240423 | B05-C-00026 | B-R-1475A | INSTRUMENT AIR COMPRESS | (3M)Air intake filter inspection,Cleanin | PM | 23/4/2024 | |
| 20240423 | B57-C-00736 | B-R-1475B | INSTRUMENT AIR COMPRESS | (3M)Air intake filter inspection,Cleanin | PM | 23/4/2024 | |
| 20240423 | B57-C-00727 | B-R-1475Z | INSTRUMENT AIR COMPRESSOR | (3M)Air intake filter inspection,Cleanin | PM | 23/4/2024 | Compressor |
| 20240423 | B30A-C-00005 | B-R-575A | CS SPLITTER HEAT PUMP COMPRESSOR | (6M)CHANGE BUTTERSEPERATION GAS FILTER | PM | 23/4/2024 | Compressor |
| 20240423 | B00-C-00107 | B-VALVE-05 | VALVE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-228) | IM | 23/4/2024 | |
| 20240422 | 881-S-00006 | B-AE-1100 | CG EFFLUENT FROM F-110 | (6M)CALIBRATION | PM | 22/4/2024 | |
| 20240422 | 381-S-00012 | B-AE-1200 | CG EFFLUENT FROM F-120 | (6M)CALIBRATION | PM | 22/4/2024 | |
| 20240422 | B0P1-C-00025 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET&CALIBRATE | PM | 22/4/2024 | |
| 20240422 | BH13-C-00062 | B-AT-331003 | MOISTURE ANALYZER TRANSMITTER FOR H-3301 | (1M)MOISTURE ANALYZER AMETEC | PM | 22/4/2024 | |
| 20240422 | B1-C-00018 | B-AT-9010 | BWP FROM DEASERATOR | (7M)CALIBRATION | PM | 22/4/2024 | |
| 20240422 | B12-C-00040 | B-CP-TB-BV | CP TP GROUPING FOR BV | (1M)INSTANCE OFF POTENTIAL PIPE TO SOIL | PM | 22/4/2024 | |
| 20240422 | B63-C-00083 | B-DV-1621A | LP6 STORAGE TK Q-1521 DELUGE VALVE | (6M)Spray Test | PM | 22/4/2024 | |
| 20240422 | B20-16118 | B-DV-1621B | LP6 STORAGE TK Q-1521 DELUGE VALVE | (6M)Spray Test | PM | 22/4/2024 | |
| 20240422 | B63-C-00083 | B-DV-1622A | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (6M)Spray Test | PM | 22/4/2024 | |
| 20240422 | B63-C-00083 | B-DV-1622B | PROPYLENE PRODUCT TK Q-1536 DELUGE VALVE | (6M)Spray Test | PM | 22/4/2024 | |
| 20240422 | B090-S-00001 | B-G-3505-R-1 | ASSIST AIR BLOWER | RCM-(1M) VISUAL INSPECTION | IM | 22/4/2024 | |
| 20240422 | B61-C-00118 | B-P-1142D | CONTAMINATED STORM WATER PUMP | (3M)REGREASE | PM | 22/4/2024 | Pump |

| | | | | | | | |
|----------|--------------|--------------------|--|---|------------|-----------|------------|
| 20240417 | B90-C-00150 | B-CP-TRU-PLANT2 | GROUP FOR CP TRU PLANT2 | (1M)VISUAL INSPECTION | PM | 17/4/2024 | |
| 20240417 | B63-C-00029 | B-DV-1617 | LUBESAL OIL CONSOLE DELUGE VALVE | (5M)Spray Test | | 17/4/2024 | |
| 20240417 | B38-S-00005 | B-MOTOR-EP-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | Motor | 17/4/2024 | |
| 20240417 | B29-S-00001 | B-MP-540A | PROPYLENE RECTIFIER BOTTOMS PUMP MOTOR | (2M)MOTOR & SLEEVE BEARING INSPECTION | Motor | 17/4/2024 | |
| 20240417 | B42B-C-00014 | B-MR-600-P-1A | C2R CONDENSER COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/4/2024 | |
| 20240417 | B42B-C-00012 | B-MR-600-P-2A | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/4/2024 | |
| 20240417 | B42B-C-00031 | B-MR-600-P-2S | C2R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/4/2024 | |
| 20240417 | B95-C-00010 | B-P-1501B | RAIR FAN PUMP | (6M)CLEAN & LUBRICATE | Pump | 17/4/2024 | |
| 20240417 | B20A-C-00030 | B-P-344A | STRONG CAUSTIC CIRCULATION PUMP | (6M) CHANGE LUBE OIL & INSPECT | Pump | 17/4/2024 | |
| 20240417 | B29-S-00001 | B-P-540A | PROPYLENE RECTIFIER BOTTOMS PUMP | (2M)CLEANING & LUBRICATE | Pump | 17/4/2024 | |
| 20240417 | B12-C-00045 | B-PGC-BV-HOUSE1 | GROUPING TAG FOR PGC BV HOUSE 1 | (4M) Inspect and Calibrate | PM | 17/4/2024 | |
| 20240417 | B12-C-00046 | B-PGC-BV-HOUSE2 | GROUPING TAG FOR PGC BV HOUSE 2 | (4M) Inspect and Calibrate | PM | 17/4/2024 | |
| 20240417 | B12-C-00044 | B-PGC-BV-HOUSE3 | GROUPING TAG FOR PGC BV HOUSE 3 | (2M)SET&CALIBRATE | PM | 17/4/2024 | |
| 20240417 | B12-C-00047 | B-PGC-BV-HOUSE3 | GROUPING TAG FOR PGC BV HOUSE 3 | (4M) Inspect and Calibrate | PM | 17/4/2024 | |
| 20240417 | B19A-C-00058 | B-R-300 | CRACKED GAS COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/4/2024 | Compressor |
| 20240417 | B42B-C-00014 | B-R-600-P-1A | C2R COMPRESSOR CONDENSATE PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/4/2024 | Compressor |
| 20240417 | B42B-C-00012 | B-R-600-P-2A | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/4/2024 | Compressor |
| 20240417 | B42B-C-00031 | B-R-600-P-2S | C2R COMPRESSOR CONDENSATE VACUUM PUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/4/2024 | Compressor |
| 20240417 | B19A-C-00058 | B-R/RX-401A | TAIL GAS EXPANDER & COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/4/2024 | Compressor |
| 20240417 | B19A-C-00058 | B-R/RX-401B | TAIL GAS RECOMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/4/2024 | Compressor |
| 20240417 | B19A-C-00058 | B-R-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) N2 PRESSURE INSPECTION | IM | 17/4/2024 | Compressor |
| 20240417 | B19A-C-00058 | B-R-600 | ETHYLENE REFRIGERANT COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | IM | 17/4/2024 | Compressor |
| 20240417 | B19A-C-00058 | B-R-650 | PROPYLENE REFRIGERANT COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | IM | 17/4/2024 | Compressor |
| 20240417 | B12-C-00021 | B-SCADA-BV | SCADA SYSTEM FOR BV | (1M)VISUAL INSPECT | IM | 17/4/2024 | |
| 20240416 | B11-C-00096 | B-AT-360030 | LP DEETHANIZER A-3600 OVHD. TO C2 SPLIT | (2M) SET & CALIBRATE | PM | 16/4/2024 | |
| 20240416 | B11-C-00097 | B-AT-360031 | LP DEETHANIZER A-3600 BTMS. TO PUMP P-3 | (2M) SET & CALIBRATE | PM | 16/4/2024 | |
| 20240416 | B11-C-00098 | B-AT-360032 | LP DEETHANIZER A-3600 BTMS. TO TCCG | (2M) SET & CALIBRATE | PM | 16/4/2024 | |
| 20240416 | B09-C-00022 | B-M-19057 | GROUPING TAG FOR TAIL GAS TO ROC. M5KSD | (4M)SET & CALIBRATE | PM | 16/4/2024 | |
| 20240416 | B38-S-00003 | B-MOTOR-EO-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (6M)CLEANING AND INSPECTION. | Motor | 15/4/2024 | |
| 20240416 | B41-C-00047 | B-MP-478B | ETHYLENE PRODUCT PUMP MOTOR | (1M)CHANGE LUBE OIL MOTOR | PM | 16/4/2024 | Motor |
| 20240416 | B59-C-00009 | B-P-1124S | CHEMICAL SEWER SUMP PUMP | (3M)REGREASE | PM | 16/4/2024 | Pump |
| 20240416 | B61-C-00120 | B-P-1143S | CONTAMINATED WATER TRANSFER PUMP | (1M)LUBRICATION | PM | 16/4/2024 | Pump |
| 20240416 | B29A-C-00003 | B-P-527S | C3 SPLITTER BOTTOMS PUMP | (1M)CLEANING & INSPECTION | PM | 16/4/2024 | Pump |
| 20240416 | B34A-C-00008 | B-P-805S | CS HYDROGENATION FEED PUMPS | (1M)CLEAN & LUBRICATE | PM | 16/4/2024 | Pump |
| 20240416 | B13-S-00011 | B-R-4801B | AIR COMPRESSORS | (4000Hr)Inspection Visit Type A 4000Hr | Compressor | 16/4/2024 | Compressor |
| 20240416 | B59-S-00001 | B-AUSFI-2E5 | UPS AT NEW PROCESS SUBSTATION | (3M)CONDITION CHECK | IM | 16/4/2024 | |
| 20240415 | B00-C-00208 | B-1034-FST-1605 | Foam Storage Tank for Truck Load | (1M)VISUAL INSPECTION | IM | 15/4/2024 | |
| 20240415 | B20A-C-00040 | B-A-340 | CAUSTIC TOWER | (3M) CONDITION CHECK (OSL 2022-160) | IM | 15/4/2024 | |
| 20240415 | B90-S-00019 | B-CAP-CS | GROUPING TAG FOR CAP-CS SUBSTATION#3 | (1M)VISUAL INSPECTION TEMP, NOISE, VIBRAT | PM | 15/4/2024 | |
| 20240415 | B90-C-00130 | B-EL-GROUP | Group for EMERGENCY Light | (3M)INSPECT, VERIFY & CHECK | PM | 15/4/2024 | |
| 20240415 | B10D-C-00041 | B-F-140 | USE FURNACES | (3M) CONDITION CHECK (OSL 2022-162) | IM | 15/4/2024 | Furnace |
| 20240415 | B10F-C-00044 | B-F-160 | USE FURNACES | (3M) CONDITION CHECK (OSL 2022-161) | IM | 15/4/2024 | Furnace |
| 20240415 | B060-C-00053 | B-G-1122-L-1 | OXIDATION REACTOR | (3M) CONDITION CHECK (OSL 2022-164) | IM | 15/4/2024 | |
| 20240415 | B59-C-00009 | B-P-1124S | Cooling Tower A | (2M)EXTERNAL INSPECTION | IM | 15/4/2024 | |
| 20240415 | B59-C-00009 | B-P-1124S | Cooling Tower B | (2M)EXTERNAL INSPECTION | IM | 15/4/2024 | |
| 20240415 | B59-C-00009 | B-P-1124S | Cooling Tower C | (2M)EXTERNAL INSPECTION | IM | 15/4/2024 | |
| 20240415 | B59-C-00009 | B-P-1124S | Cooling Tower D | (2M)EXTERNAL INSPECTION | IM | 15/4/2024 | |
| 20240415 | B59-C-00009 | B-P-1124S | Cooling Tower E | (2M)EXTERNAL INSPECTION | IM | 15/4/2024 | |
| 20240415 | B59-C-00009 | B-P-1124S | Scale Inhibitor Injection Pump | (1M)INSPECTION, CLEAN, LUBRICATE | PM | 15/4/2024 | |
| 20240415 | BNA-C-00053 | B-GC-2M2 | GROUPING FOR PM GC 2 Month group2 | (2M)SET&CALIBRATE | PM | 15/4/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|---------|
| 20240415 | BNA-C-00040 | B-LOCAL-6M | GROUPING FOR PM LOCAL ANALYZER 6 Month | (6M)INSPECTION & VERIFY | PM | 15/4/2024 | |
| 20240415 | B46E-C-00044 | B-LT-15031 | LEVEL OF Q-1503 NEW FAN STORAGE TANK | (6M)Verify Radar Tank&Calibrat (Law) | PM | 15/4/2024 | |
| 20240415 | B46E-C-00045 | B-LT-15041 | LEVEL OF Q-1504 NEW FAN STORAGE TANK | (6M)Verify Radar Tank&Calibrat (Law) | PM | 15/4/2024 | |
| 20240415 | B06P-C-00014 | B-M-19018 | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2M)UPDATE N2, CO2, REL. DENSITY | PM | 15/4/2024 | |
| 20240415 | B52B-C-00108 | B-MP-1201B | COOLING WATER PUMP MOTOR | (1M)CHANGE LUBE OIL MOTOR | PM | 15/4/2024 | Motor |
| 20240415 | B001-C-00022 | B-MP-901C | SHIP BOILER FEED WATER PUMP MOTOR | (1M)CHANGE LUBE OIL MOTOR | PM | 15/4/2024 | Motor |
| 20240415 | B07-S-00001 | B-OIL-MIST-PLANT2 | Grouping tag for Oil Mist Systems PL-4/2 | (1M) Oil Mist Monthly PM | PM | 15/4/2024 | |
| 20240415 | B52B-C-00108 | B-P-1201B | COOLING WATER PUMP | (1M)CLEANING | PM | 15/4/2024 | Pump |
| 20240415 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1M)WATER P&ID suction screen dearing | PM | 15/4/2024 | Pump |
| 20240415 | B063-C-00046 | B-P-1602A | FIRE WATER JOCKEY PUMP | (1M)Visual inspect Conclusion | PM | 15/4/2024 | Pump |
| 20240415 | B063-C-00047 | B-P-1602S | FIRE WATER JOCKEY PUMP | (1M)Visual inspect Conclusion | PM | 15/4/2024 | Pump |
| 20240415 | BK4-C-00038 | B-P-3603S | ETHYLENE LP PRODUCT PUMP | (6M)CHECK & INSPECT | PM | 15/4/2024 | Pump |
| 20240415 | B001-C-00022 | B-P-901C | SHIP BW PUMPS | RCM-(1M)MECH SEAL COOLER CLEANING | PM | 15/4/2024 | Pump |
| 20240415 | B52B-C-00059 | B-R-1204A | COOLING WATER FAN A | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/4/2024 | |
| 20240415 | B52B-C-00060 | B-R-1204B | COOLING WATER FAN B | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/4/2024 | |
| 20240415 | B52B-C-00061 | B-R-1204C | COOLING WATER FAN C | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/4/2024 | |
| 20240415 | B52B-C-00062 | B-R-1204D | COOLING WATER FAN D | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/4/2024 | |
| 20240415 | B52B-C-00063 | B-R-1204E | COOLING WATER FAN E | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/4/2024 | |
| 20240415 | B19A-WK-0001 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 15/4/2024 | |
| 20240415 | B42B-WK-0001 | B-R-600-PT-1S | C2R SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 15/4/2024 | |
| 20240415 | B43B-WK-0001 | B-R-650-PT-1S | C3R COMP SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 15/4/2024 | |
| 20240415 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (3M)INSPECTION | PM | 15/4/2024 | |
| 20240415 | B06P-C-00002 | B-SWGR-EO-001 | GROUPING TAG FOR SWGR. | (3M)INSPECT CABLE/TIGHTNESS NUTS/SCREWS | PM | 15/4/2024 | |
| 20240415 | B38-C-00012 | B-TRAP-010 | GROUPING STEAM TRAP AREA 010 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B38-C-00017 | B-TRAP-020 | GROUPING STEAM TRAP AREA 020 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B38-C-00018 | B-TRAP-030 | GROUPING STEAM TRAP AREA 030 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B38-C-00019 | B-TRAP-040 | GROUPING STEAM TRAP AREA 040 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B38-C-00020 | B-TRAP-050 | GROUPING STEAM TRAP AREA 050 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B38-C-00021 | B-TRAP-060 | GROUPING STEAM TRAP AREA 060 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B07P-C-00012 | B-TRAP-070 | GROUPING STEAM TRAP AREA 7 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B07P-C-00012 | B-TRAP-080 | GROUPING STEAM TRAP AREA 8 | (6M)STEAM TRAP OPERATING CHECK | IM | 15/4/2024 | |
| 20240415 | B98-C-00002 | B-TT-0610 | CRITICAL LOOP, MIXED FEEDS TO F-140-180 | (2M)CHECK & ADJUST (OUT-SOURCE) | PM | 15/4/2024 | |
| 20240415 | B12-C-00016 | B-BTVE3-CWR | VALVE COOLING WATER RETURN OLE 2-3 | (1M)INSPECT GEAR OF BTF VALVE CVR T-4045 | IM | 15/4/2024 | |
| 20240414 | B81-S-00004 | B-AE-1700 | CG EFFLUENT FROM F-170 | (6M)CALIBRATION | PM | 14/4/2024 | |
| 20240414 | B10K-C-00032 | B-AT-10123 | IS014000 CEMS SOX/NOVOC F-1010 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/4/2024 | |
| 20240414 | B10K-C-00034 | B-AT-10203 | IS014000 CEMS SOX/NOVOC F-1030 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/4/2024 | |
| 20240414 | B09-C-00028 | B-AT-10031-3 | GROUPING TAGS CEMS AT-11031/1031/1303 | (1M)SET & CALIBRATION | PM | 14/4/2024 | |
| 20240414 | B09-C-00028 | B-AT-10034-6 | GROUPING TAGS CEMS AT-14031/1503/1903 | (1M)SET & CALIBRATION | PM | 14/4/2024 | |
| 20240414 | B09-C-00028 | B-AT-10037-9 | GROUPING TAGS CEMS AT-17031/1803/1903 | (1M)SET&CALIBRATION | PM | 14/4/2024 | |
| 20240414 | B3A-C-00013 | B-AT-2411A | IS014000 CEMS SOX,NOX,CO ANALYZER,S-2401 | (1M)SET & CALIBRATE CEMS(B-2401) | PM | 14/4/2024 | |
| 20240414 | B3A-S-00013 | B-B-2401 | STEAM GENERATOR | (1M)CLEANING B-2401 | PM | 14/4/2024 | |
| 20240414 | B99-C-00227 | B-CO2-SUB81-1 | CO2 FIRE SYSTEM CONTROL PANEL(SWGR) SUB1 | (1M)INSPECTION | PM | 14/4/2024 | |
| 20240414 | B99-C-00227 | B-CO2-SUB81-2 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M)INSPECTION | PM | 14/4/2024 | |
| 20240414 | B10D-C-00042 | B-P-190 | USE FURNACES | (3M) CONDITION CHECK (OSL 2021-072) | IM | 14/4/2024 | Furnace |
| 20240414 | B10K-C-00032 | B-AT-10203 | IS014000 CEMS SOX/NOVOC F-1030 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/4/2024 | |
| 20240414 | B061-S-00005 | B-G-1125-P-3B | IS014000 PH NEUTRALIZATION FEED PUMP | (1M)INSPECTION, CLEAN, LUBRICATE | PM | 14/4/2024 | |
| 20240414 | B44-C-00028 | B-HV-310213 | MOTOR OPERATED TRANSFER LINE VALVE OF F-3102 | (6M)LUBRICAT AND INSPECT 23 VALVE GroupE | PM | 14/4/2024 | |
| 20240414 | B44-C-00028 | B-HV-310214 | MOTOR OPERATED DECKING VALVE OF F-3102 | (6M)LUBRICAT AND INSPECT 23 VALVE GroupE | PM | 14/4/2024 | |
| 20240414 | B63-C-00070 | B-HY-1610 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B63-C-00070 | B-HY-1611 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|-----------|------------|
| 20240414 | B63-C-00070 | B-HY-1612 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B63-C-00070 | B-HY-1613 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B63-C-00091 | B-HY-1614 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B63-C-00091 | B-HY-1615 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B63-C-00092 | B-HY-1616 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B63-C-00092 | B-HY-1617 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B63-C-00092 | B-HY-1618 | HYDRANT AREA UTILITY | (6M)HY UTILITY LUBRICATION | PM | 14/4/2024 | |
| 20240414 | B06P-C-00090 | B-INFRARED-SURVEY | GROUPING TAG FOR INFRARED SURVEY | (6M)INSPECTION INFRARED | IM | 14/4/2024 | |
| 20240414 | B13-C-00062 | B-INTERCOM-ORP | Grouping For Intercom ORP | (3M)INTERCOM FUNCTION TEST | PM | 14/4/2024 | |
| 20240414 | B46F-C-00011 | B-R-19076 | Grouping Tag for Caloric from VMT to GC3 | (4M)SET & CALIBRATE | PM | 14/4/2024 | |
| 20240414 | B63-C-00062 | B-P-1131S | MIXED HEAVY OIL TRANSFER PUMP | (1M)CHECK LUBE OIL & CLEAN | PM | 14/4/2024 | Pump |
| 20240414 | B98-C-00019 | B-P-1156A | MIXED HEAVY OIL TRANSFER PUMP | (1M)CHECK LUBE OIL & CLEAN | PM | 14/4/2024 | Pump |
| 20240414 | B98-C-00019 | B-P-1156S | MIXED HEAVY OIL TRANSFER PUMP | (1M)CHECK LUBE OIL & CLEAN | PM | 14/4/2024 | Pump |
| 20240414 | B3A-C-00012 | B-R-2401 | FD. FAN | (1M)CHECK LUBRICATING OIL | PM | 14/4/2024 | |
| 20240414 | BNA-C-00014 | B-SECUR-TASK22 | FOR PM: INSPECTION FIRE PROTECTIVE CLOT | (1M)INSPECTION | PM | 14/4/2024 | |
| 20240413 | B43-C-00016 | B-AT-31010S | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M)SET & CALIBRATION | PM | 13/4/2024 | |
| 20240413 | B09P-C-00028 | B-AT-312X01/L-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) IS014001 SET&CALIBRATION | PM | 13/4/2024 | |
| 20240413 | B003-C-00029 | B-FT-19014A | CRITICAL LOOP, CROSS CHECK METER HP STEA | (3M) CONDITION CHECK (OSL 2022-130) | IM | 13/4/2024 | |
| 20240413 | B03A-C-00009 | B-PM-7009 | MP STEAM TO R-700 | (3M) CONDITION CHECK (OSL 2022-225) | IM | 13/4/2024 | |
| 20240413 | B06P-C-00019 | B-G-910A | SUSPECT CONDENSATE FILTERS | (3M) CONDITION CHECK (OSL 2022-128) | IM | 13/4/2024 | |
| 20240413 | B007-C-00024 | B-G-910A | SUSPECT CONDENSATE FILTERS | (3M) CONDITION CHECK (OSL 2022-121) | IM | 13/4/2024 | |
| 20240413 | B08P-C-00027 | B-M-842 | INTERMITTENT DRAIN DRAIN DRAIN | (3M) CONDITION CHECK (OSL 2022-131) | PM | 13/4/2024 | |
| 20240413 | B05-C-00023 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLES | (1M)CLEANING & INSPECTION | PM | 13/4/2024 | Motor |
| 20240413 | B38-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION | PM | 13/4/2024 | Motor |
| 20240413 | B013-C-00015 | B-P-221A | QUENCH OIL TOWER REFILL PUMP | (3M) CONDITION CHECK (OSL 2022-294) | IM | 13/4/2024 | Pump |
| 20240413 | B00-C-00061 | B-PIPEL-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-093) | IM | 13/4/2024 | |
| 20240413 | B90-S-00005 | B-PM-3201S | QUENCH WATER PUMP MOTOR | (3M)LUBRICATION | PM | 13/4/2024 | Motor |
| 20240413 | B056-C-00014 | B-R-1470S | PLANT AIR COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-132) | PM | 13/4/2024 | Compressor |
| 20240413 | B19A-C-00062 | B-R-300HP | CRACKED GAS COMPRESSOR HP CASING | (1M)INSPECT WRAPPED DRAIN FLANGE | PM | 13/4/2024 | Compressor |
| 20240413 | BNA-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/4/2024 | |
| 20240413 | B46A-C-00009 | B-T-1520 | LPG VAPORIZER | (3M) CONDITION CHECK (OSL 2022-125) | IM | 13/4/2024 | |
| 20240413 | B38-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/4/2024 | |
| 20240413 | B00-C-00016 | B-VALVE1-SHH | VALVE STEAM -SUPER HIGH PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-222) | IM | 13/4/2024 | |
| 20240413 | B12-C-00054 | B-MSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/4/2024 | |
| 20240413 | B12-C-00054 | B-MSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/4/2024 | |
| 20240413 | B12-C-00057 | B-MSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/4/2024 | |
| 20240412 | B06P-S-00004 | B-CAP-MS | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 12/4/2024 | |
| 20240412 | B10H-C-00039 | B-180 | USC FURNACES | (3M) CONDITION CHECK (OSL 2021-089) | IM | 12/4/2024 | Furnace |
| 20240412 | B061-C-00010 | B-FE-11391 | BOTREATMENT EFFLUENT | (1Y)VISUAL INSPECTION | PM | 12/4/2024 | |
| 20240412 | B061-C-00011 | B-FT-11391 | BOTREATMENT EFFLUENT | (1Y)VISUAL INSPECTION | PM | 12/4/2024 | |
| 20240412 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 12/4/2024 | |
| 20240412 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 12/4/2024 | |
| 20240412 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1M)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 12/4/2024 | |
| 20240412 | B12-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 12/4/2024 | |
| 20240412 | B90-C-00013 | B-GS-2E-F5 | DIESEL ENGINE GENERATOR SET MOTOR | (1M)FUNCTION TEST & EXERCISE | PM | 12/4/2024 | |
| 20240412 | B90-C-00013 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 12/4/2024 | |
| 20240412 | B90-C-00013 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 12/4/2024 | |
| 20240412 | B90-C-00013 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 12/4/2024 | |
| 20240412 | B90-C-00013 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1M)FUNCTION TEST & EXERCISE | PM | 12/4/2024 | |
| 20240412 | B63-C-00039 | B-HY-1619 | HYDRANT AREA QUENCH | (6M)HY QUENCH LUBRICATION | PM | 12/4/2024 | |
| 20240412 | B63-C-00039 | B-HY-1620 | HYDRANT AREA QUENCH | (6M)HY QUENCH LUBRICATION | PM | 12/4/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|-----------------------------------|----|-----------|-------|
| 20240412 | B90-C-0006 | B-XFMR-13 | 220V,9KV POWER TRANSFORMER SUB.4 | (3M)RCM Visual Inspection | IM | 12/4/2024 | |
| 20240412 | B2-C-0001 | B-XFMR-21 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW HAI | (3M) RCM Visual Inspection | IM | 12/4/2024 | |
| 20240412 | BC26-C-00012 | B-XFMR-2E1 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW HAI | (3M) RCM Visual Inspection | IM | 12/4/2024 | |
| 20240412 | BC26-C-00013 | B-XFMR-2E2 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW HAI | (6M) RCM Thermoscan | IM | 12/4/2024 | |
| 20240412 | BC26-C-00013 | B-XFMR-2E3 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (6M) RCM Thermoscan | IM | 12/4/2024 | |
| 20240412 | BC26-C-00013 | B-XFMR-2E4 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (3M) RCM Visual Inspection | IM | 12/4/2024 | |
| 20240412 | BC26-C-00012 | B-XFMR-2E5 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (3M) RCM Visual Inspection | IM | 12/4/2024 | |
| 20240412 | BC26-C-00013 | B-XFMR-2E6 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (6M) RCM Thermoscan | IM | 12/4/2024 | |
| 20240412 | B90-C-0006 | B-XFMR-2E7 | AUTO TRANSFORMER FOR RM-575 | (6M) RCM Thermoscan | IM | 12/4/2024 | |
| 20240411 | B01-C-0004 | B-AT-3600C | CG DEHYDRATORS BEDS | (1M)VISUAL & CONDITION INSPECTION | PM | 11/4/2024 | |
| 20240411 | BNA-C-0002 | B-CRIT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (5M) CHANGE LUBE OIL & INSPECT | PM | 11/4/2024 | Pump |
| 20240411 | B20B-C-00028 | B-P-342 | ISO14000 WEAR CAUSTIC CIRCULATION PUMP | (6M) CHANGE LUBE OIL & INSPECT | PM | 11/4/2024 | Pump |
| 20240411 | B20A-C-00028 | B-P-343A | ISO14000 MEDIUM CAUSTIC CIRCULATION PUMP | (1Y)LUBRICATE | PM | 11/4/2024 | Pump |
| 20240411 | B30A-S-00005 | B-P-571A | PROPYLENE PRODUCT PUMP | (2M)LUBRICATION | PM | 11/4/2024 | Motor |
| 20240411 | B01B-C-00001 | B-PM-1570A | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/4/2024 | Motor |
| 20240411 | B01B-C-00002 | B-PM-1570B | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/4/2024 | Motor |
| 20240411 | B01B-C-00003 | B-PM-1570S | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (2M)LUBRICATION | PM | 11/4/2024 | Motor |
| 20240411 | B00B-C-00002 | B-PSV-5470S | T-5420 to Hot Flare | (3Y)INSPECTION & OVERHAUL | PM | 11/4/2024 | PSV |
| 20240411 | B00B-C-00005 | B-PSV-5470A | Refinery Cold Area Feed to N-577A | (3Y)INSPECTION & OVERHAUL | PM | 11/4/2024 | PSV |
| 20240411 | B23B-C-00009 | B-PSV-570S | N-557A to Cold flare | (3Y)INSPECTION & OVERHAUL | PM | 11/4/2024 | PSV |
| 20240411 | B34A-C-00021 | B-PSV-6502A | T-850 TO L-850 | (3Y)INSPECTION & OVERHAUL | PM | 11/4/2024 | PSV |
| 20240411 | B01C-00002 | B-PT-19192 | PRESSURE TRANSMITTER FOR C2H4 METER SKID | (4M)SET & CALIBRATE | PM | 11/4/2024 | |
| 20240411 | B20-C-00003 | B-SECUR-TASK03A | FOR PH: CHECK A FOAM TRUCK NO1 (MUNTING) | (10)INSPECTION | PM | 11/4/2024 | |
| 20240411 | B20-C-00003 | B-SECUR-TASK03C | FOR PH: CHECK A WATER TRUCK(SAVAYAN) | (10)INSPECTION | PM | 11/4/2024 | |
| 20240411 | B20-C-00003 | B-SECUR-TASK03E | FOR PH: CHECK AMBULANCE(JITRUKSA) | (10)INSPECTION | PM | 11/4/2024 | |
| 20240411 | B20-C-00003 | B-SECUR-TASK03F | FOR PH: CHECK WATER CAR (NATVAYU) | (10)INSPECTION | PM | 11/4/2024 | |
| 20240411 | BNA-C-00024 | B-SECUR-TASK06 | FOR PH: TEST A FIRE TRUCK | (2W)INSPECTION | PM | 11/4/2024 | |
| 20240411 | B01C-00003 | B-TT-19192 | TEMP. TRANSMITTER FOR C2H4 METER SKID | (4M)SET & CALIBRATE | PM | 11/4/2024 | |
| 20240411 | B3B-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/4/2024 | |
| 20240411 | B90-C-00234 | B-XFMR-2C1 | POWER TRANSFORMER 6.6/0.4 KV | (3M) RCM Visual Inspection | IM | 11/4/2024 | |
| 20240411 | B90-C-00235 | B-XFMR-2C1 | POWER TRANSFORMER 6.6/0.4 KV | (6M) RCM Thermoscan | IM | 11/4/2024 | |
| 20240411 | B90-C-00235 | B-XFMR-2C2 | POWER TRANSFORMER 6.6/0.4 KV | (6M) RCM Thermoscan | IM | 11/4/2024 | |
| 20240411 | B90-C-00234 | B-XFMR-2C2 | POWER TRANSFORMER 6.6/0.4 KV | (3M) RCM Visual Inspection | IM | 11/4/2024 | |
| 20240411 | B90-C-00234 | B-XFMR-2C3 | POWER TRANSFORMER 6.6/3 KV | (3M) RCM Visual Inspection | IM | 11/4/2024 | |
| 20240411 | B90-C-00235 | B-XFMR-2C3 | POWER TRANSFORMER 6.6/3 KV | (6M) RCM Thermoscan | IM | 11/4/2024 | |
| 20240410 | B12-C-00070 | B-AT-430303 | BUTENE-1 GGS | (1M)SET&CALIBRATE | PM | 10/4/2024 | |
| 20240410 | B13-S-00013 | B-BU-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B13-S-00014 | B-BU-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B13-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B13-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00052 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00053 | B-BU-BC-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00056 | B-BU-BC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00054 | B-BU-BC1-110 | BATTERY UNIT FOR 110VDC SUB.2 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00055 | B-BU-BC2-110 | BATTERY UNIT FOR 110VDC SUB.PROCESS | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00057 | B-BU-DC | BATTERY UNIT FOR 110VDC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00058 | B-BU-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|-------------------------------------|----|-----------|--------------|
| 20240410 | B90-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00060 | B-BU-UPS-2 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00061 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B90-S-00061 | B-BU-UPS-2 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/4/2024 | |
| 20240410 | B13-C-00001 | B-CAM-ORP | Grouping For Camera ORP | (3M)FUNCTION TEST&EXERCISE | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-G-1122-R-1A | HIGH PRESSURE AIR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-G-1122-R-1S | HIGH PRESSURE AIR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B060-C-00049 | B-G-1122-V-1 | VAPOR SCRUBBER | (3M) CONDITION CHECK (OSL 2020-055) | IM | 10/4/2024 | |
| 20240410 | B097-C-00001 | B-G-3100 | ELEVATOR | (1M)INSPECTION AND FUNCTION TEST | PM | 10/4/2024 | |
| 20240410 | B90S-00027 | B-HYDRAULIC-01 | HYDRAULIC STATIC PRESS 30 T | (1M)LUBRICATION & INSPECTION | PM | 10/4/2024 | |
| 20240410 | B10E-C-00052 | B-M-150 | STEAM DRUM | (3M) CONDITION CHECK (OSL 2023-278) | IM | 10/4/2024 | |
| 20240410 | B095-C-00005 | B-M-18028 | GROUPING TAG FOR PY GAS TO ASC/TTT | (4M)SET & CALIBRATE | PM | 10/4/2024 | |
| 20240410 | B095-C-00002 | B-MOTOR-ED-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION | PM | 10/4/2024 | Motor |
| 20240410 | B12-C-00768 | B-NONE-OLEFINS-P3 | Equipment Non Olefins Plant 1-4/3 | (3M) CONDITION CHECK (OSL 2023-280) | IM | 10/4/2024 | |
| 20240410 | B90-C-00168 | B-OSGIS | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/4/2024 | |
| 20240410 | B060-C-00048 | B-P-1123A | SULFURIC ACID TRANSFER PUMP | (3M) CONDITION CHECK (OSL 2020-054) | IM | 10/4/2024 | Pump |
| 20240410 | B47F-S-00006 | B-P-1506S | TRANSFER Q-1551 TO Q-1501 PUMP | (1Y) LUBRICATION | PM | 10/4/2024 | Pump |
| 20240410 | B025-C-00006 | B-P-370A | HP DEPROP. CONDENSATE PUMP | (3M) CONDITION CHECK (OSL 2020-052) | IM | 10/4/2024 | Pump |
| 20240410 | B19A-C-00057 | B-P-3801S | BPW PUMP | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Pump |
| 20240410 | B434-C-00003 | B-P-3871S | PROCESS SEWER TRANSFER PUMP | (6M)REGREASE | PM | 10/4/2024 | Pump |
| 20240410 | B19A-C-00057 | B-P-301A | SHIP BOILER FEED WATER PUMP | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Pump |
| 20240410 | B19A-C-00057 | B-P-301B | SHIP BOILER FEED WATER PUMP | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Pump |
| 20240410 | B19A-C-00057 | B-P-301 | SHIP BFW PUMPS | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Pump |
| 20240410 | B19A-C-00057 | B-P-301S | SHIP BOILER FEED WATER PUMP | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Pump |
| 20240410 | B00-C-00056 | B-PIPEL-K | LINE CAUSTIC DLE 2-1 | (3M) CONDITION CHECK (OSL 2020-053) | IM | 10/4/2024 | |
| 20240410 | B00-C-00048 | B-PIPEL-SCL | LIME STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-031) | IM | 10/4/2024 | |
| 20240410 | B00-C-00049 | B-PIPEL-SL | LIME STEAM - LOW PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-033) | IM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-PT-1201A | COOLING WATER PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-PT-210A | QUENCH OIL CIRCULATION PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-PT-220A | QUENCH WATER CIRCULATION PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-PT-3801A | BPW PUMP TURBINE | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-PT-4801A | STEAM TURBINE FOR P-4801A | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B007-C-00025 | B-Q-920 | CONDENSATE POLISHER NUTRIALIZATION SUMP | (3M) CONDITION CHECK (OSL 2023-279) | IM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-1470A | PLANT AIR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-1470S | PLANT AIR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-1531 | ETHYLENE RECOVERY COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-300 | CRACKED GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-3301 | CRACKED GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-3600 | ETHYLENE REFRIGERANT COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-4002-A | TAIL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-4031 | RECYCLE GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-4301 | BUTENE-1 FRACTIONATOR COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-575A | C3 SPLITTER HEAT PUMP COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-600 | ETHYLENE REFRIGERANT HEAT PUMP/COMPRESS. | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-701A | GHU RECYCLE H2 COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-701S | GHU RECYCLE H2 COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-936 | FUEL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-R-939 | FUEL GAS COMPRESSOR | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B19A-C-00057 | B-RX-401A | TAIL GAS EXPANDER | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | Compressor |
| 20240410 | B050-C-00009 | B-S-1301 | Demountable Flare Stack | (3M) CONDITION CHECK (OSL 2023-275) | IM | 10/4/2024 | Valve(Flare) |

| | | | | | | | |
|----------|---------------|-------------------|--|---|----|-----------|--------------|
| 20240410 | BNA-C-00010 | B-SECUR-TASK18 | INSPECTION FIRE ALARM STATION | (1M)INSPECTION | PM | 10/4/2024 | |
| 20240410 | B20-C-00002 | B-SECUR-TASK43 | VISUAL INSPECTION MOBILE FOAM U | (1M)INSPECTION | PM | 10/4/2024 | |
| 20240410 | B19B-C-00060 | B-T-330A | CG 3RD STAGE AFTERCOOLERS | (3M) CONDITION CHECK (OSL 2023-281) | IM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-V-1540 | MIXED O4 STORAGE REFRIGERATION UNIT | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-V-1408 | CHILLER PACKAGE-BUTADIENE BUFFER DRUM | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-V-4700A | CHILLED WATER PACKAGE | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B19A-C-00057 | B-V-4700B | CHILLED WATER PACKAGE | (3M)LUBE OIL SAMPLING | PM | 10/4/2024 | |
| 20240410 | B11-C-00030 | B-VALVE2-SH | VALVE STEAM - HIGH PRESSURE DLE 2-2 | (3M) CONDITION CHECK (OSL 2020-020) | IM | 10/4/2024 | |
| 20240410 | B11E-S-00001 | B-W-330101 | SH STM TO R3301-PT-01A | RCA (1M) CLEAN&INSPECTION | IM | 10/4/2024 | |
| 20240409 | B081-C-00001 | B-AT-1100/1900 | PGC EFFLUENT FROM F-110/F-190 | (1M)SET & CALIBRATION | PM | 9/4/2024 | |
| 20240409 | B46F-C-00006 | B-AT-19060A | ETHANE FEED | (2M)SET & CALIBRATION (OUT-SOURCE) | PM | 9/4/2024 | |
| 20240409 | B097-C-00086 | B-AT-3100X1A/1-3 | GROUPING TAG CENS F-3101 to F-3103 | (1M)SET&CALIBRATION | PM | 9/4/2024 | |
| 20240409 | B097-C-00086 | B-AT-3100X1B/4-6 | GROUPING TAG CENS F-3104 to F-3106 | (1M)SET&CALIBRATION | PM | 9/4/2024 | |
| 20240409 | B097-C-00086 | B-AT-3100X1C/7-9 | GROUPING TAG CENS F-3107 to F-3109 | (1M)SET&CALIBRATION | PM | 9/4/2024 | |
| 20240409 | B095-C-00001 | B-F-EFT-001 | GROUPING FOR FOAM SYSTEM F/E | (3M)CHECK/VISUAL HEAT DETECTORS/LOCAL | PM | 9/4/2024 | |
| 20240409 | B60-S-00087 | B-G-1122-P-1A | HIGH PRESSURE FEED PUMP | (1Y) CLEAN & INSPECT, LUBRICATION | PM | 9/4/2024 | |
| 20240409 | B60-S-00002 | B-G-1122-P-1S | HIGH PRESSURE FEED PUMP | (1Y) CLEAN & INSPECT, LUBRICATION | PM | 9/4/2024 | |
| 20240409 | B53-C-00021 | B-G-2217-P-1S | CLARIFIER WATER PUMP | (1Y)CLEANING & LUBRICATE | PM | 9/4/2024 | |
| 20240409 | B10K-C-00046 | B-HV-10106 | F-1010 EFFLUENT TO A-210 | (6M)LUBRICAT AND INSPECT 21 VALVE GroupG | PM | 9/4/2024 | |
| 20240409 | B10K-C-00046 | B-HV-10106A | F-1010 DECKING VALVE | (6M)LUBRICAT AND INSPECT 21 VALVE GroupG | PM | 9/4/2024 | |
| 20240409 | B3B-C-00122 | B-MG-401-P-1S | EXPENDER OIL PUMP MOTOR | (3M)VISUAL INSPECTION AND RECORD | PM | 9/4/2024 | |
| 20240409 | B40E-C-00014 | B-PSV-15102 | RP PORT ARU TO Q-1510 | (3Y)INSPECTION & OVERHAUL | PM | 9/4/2024 | PSV |
| 20240409 | B059S-C-00001 | B-PSV-15103 | P-1510AS TO HOT B.D | (3Y)INSPECTION & OVERHAUL | PM | 9/4/2024 | PSV |
| 20240409 | B059S-C-00002 | B-SECUR-TASK17 | INSPECTION FOR C2H4 SYSTEM FJE | (1M)INSPECTION | PM | 9/4/2024 | |
| 20240408 | B52S-C-00032 | B-G-1224P-1A | Corrosion Inhibitor Injection Pump | (1Y)INSPECTION, CLEAN, LUBRICATE | PM | 8/4/2024 | |
| 20240408 | B49-C-00021 | B-G-1350-P-1 | LP VOC FLARE KO DRUM LIQUID PUMP | RCH-(1M)Short Term preservation | PM | 8/4/2024 | Water(Flare) |
| 20240408 | B48-C-00013 | B-GNO-BV | GROUND GROUPING FOR BV | (6M)CHECK&INSPECTION | PM | 8/4/2024 | |
| 20240408 | B48-C-00012 | B-HF-BV | INSULATION FLANGE GROUPING FOR BV | (6M)CHECK&INSPECTION | PM | 8/4/2024 | |
| 20240408 | B48-C-00014 | B-JN-BV | LIGHTNING GROUPING FOR BV | (6M)CHECK&INSPECTION | PM | 8/4/2024 | |
| 20240408 | B90-C-00156 | B-MCC-EQ-KW1A | Grouping Tag, for MCC-KW1A | (3M)INSPECT& CONDITION CHECK | PM | 8/4/2024 | |
| 20240408 | B90-C-00155 | B-MCC-EQ-KW2B | Grouping Tag, for MCC-KW2B | (3M)INSPECT& CONDITION CHECK | PM | 8/4/2024 | |
| 20240408 | B13-S-00026 | B-P-1571A | Cracker Bottom Export Pump | (1Y)COUPLING INSPECTION | PM | 8/4/2024 | Pump |
| 20240408 | B13-S-00027 | B-P-1571S | Cracker Bottom Export Pump | (1Y)COUPLING INSPECTION | PM | 8/4/2024 | Pump |
| 20240408 | B24M-C-00001 | B-P-1601 | CRACKER MAIN PUMP | (1Y)CRACKER MAIN PUMP condition screen cleaning | PM | 8/4/2024 | Pump |
| 20240408 | BNA-C-00021 | B-SECUR-TASK05 | FOR PH- TEST FIRE PUMP | (1W)INSPECTION | PM | 9/4/2024 | |
| 20240408 | B90-C-00156 | B-SWGR-EQ-KW12A | Grouping Tag, for SWGR-KW1A,1B | (3M)INSPECT& CONDITION CHECK | PM | 8/4/2024 | |
| 20240408 | B13-C-00034 | B-UPS-2M1-A1 | 220 VAC UPS1 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/4/2024 | |
| 20240408 | B13-C-00045 | B-UPS-2M1-A2 | 220 VAC UPS PANEL(BYPASS) | (1M)INSPECT&CONDITION CHECK | PM | 8/4/2024 | |
| 20240408 | B13-C-00046 | B-UPS-2M1-A3 | 220 VAC UPS2 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/4/2024 | |
| 20240408 | B12-S-00040 | B-V-4799 | OIL MIST SYSTEM | (1M) MONTHLY & INSPECTION | PM | 8/4/2024 | |
| 20240407 | B097-C-00080 | B-ANALYZER-OZ14/2 | GROUPING FOR OXYGEN ANALYZER PLANT14/2 | (2M)SET & CALIBRATE | PM | 7/4/2024 | |
| 20240407 | BNA-C-00061 | B-CRIT-EQ-COLD-P1 | Critical Equipments Cold Area Plant #1 | (1M)Visual & Condition Inspection | PM | 7/4/2024 | |
| 20240407 | B3B-C-00113 | B-CRITICAL-EQ-HOT | GROUPING TAG FOR MH SEC PLANT#1 | (1M)Visual & Condition Inspection | PM | 7/4/2024 | |
| 20240407 | B90-C-00067 | B-GS-72S | DIESEL ENGINE GENERATOR SET MOTOR | (3M)INSPECT ENGINE WEEKLY EXERCISE | PM | 7/4/2024 | |
| 20240407 | B034M-C-00001 | B-HY-1501 | DIESEL ENGINE GENERATOR SET | (3M)INSPECT ENGINE WEEKLY EXERCISE | PM | 7/4/2024 | |
| 20240407 | B63-C-00082 | B-HY-1501 | HYDRANT AREA TEMP FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/4/2024 | |
| 20240407 | B63-C-00082 | B-HY-1502 | HYDRANT AREA TEMP FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/4/2024 | |
| 20240407 | B63-C-00082 | B-HY-1503 | HYDRANT AREA TEMP FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/4/2024 | |
| 20240407 | B63-C-00082 | B-HY-1504 | HYDRANT AREA TEMP FACILITY | (6M)HY FACILITY LUBRICATION | PM | 7/4/2024 | |
| 20240407 | B3A-S-00003 | B-P-2402A | DEMIN FEED WATER PUMPS | (1Y)CLEAN & LUBRICATE | PM | 7/4/2024 | Pump |
| 20240407 | B34E-C-00007 | B-P-85GA | CS HYDROGENATION FEED PUMPS | (1Y)CLEAN & LUBRICATE | PM | 7/4/2024 | Pump |

| | | | | | | | |
|----------|--------------|----------------|--|--|----|-----------|------------|
| 20240401 | B32-C-00109 | B-SP-10/12 | AMETEX PUMP 300Bar Pressure Calibrator | (1Y)CALIBRATION STANDARD EQ.(OUT-SOURCE) | PM | 1/4/2024 | |
| 20240401 | B32-C-00110 | B-ST-05/02 | AMETEX XOFRA 120°C Temp Calibrator | (1Y)CALIBRATION STANDARD EQ.(OUT-SOURCE) | PM | 1/5/2024 | |
| 20240401 | B06A-C-00005 | B-T-269 | DILUTION STEAM GENERATOR FEED EATER | (3M) CONDITION CHECK (OSL 2020-830) | IM | 1/4/2024 | |
| 20240401 | BC35-C-00003 | B-V-4008 | PRESSURE SWING ADSORPTION UNIT NO. 2 | (3M)INSPECTION | IM | 1/4/2024 | |
| 20240401 | BC35-C-00004 | B-V-400C | PRESSURE SWING ADSORPTION UNIT NO. 3 | (3M)INSPECTION | IM | 1/4/2024 | |
| 20240401 | BC35-S-00001 | B-XV-4613 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00002 | B-XV-4615 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00003 | B-XV-4623 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00004 | B-XV-4625 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00005 | B-XV-4633 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00006 | B-XV-4635 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00007 | B-XV-4643 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00008 | B-XV-4645 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00009 | B-XV-4653 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240401 | BC35-S-00010 | B-XV-4655 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/4/2024 | |
| 20240331 | B10F-C-00049 | B-F-160 | USE RURNACES | (3Y)COIL & REFRACTORY INSPECTION GROUP C | PM | 31/3/2024 | Furnace |
| 20240331 | B12-S-00023 | B-R-4801S | AIR COMPRESSORS | (4000hrs)Inspection Visit Type A 4000Hr | PM | 31/3/2024 | Compressor |
| 20240331 | BWS-C-00018 | B-SF-02/04 | Frequency Calibrator | (1Y) for Frequency Calibrator SF-02/04 | PM | 31/3/2024 | |
| 20240330 | B11-C-00082 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (3M) Deluge Valve Function Test | PM | 30/3/2024 | |
| 20240330 | B11-C-00083 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (3M) Deluge Valve Function Test | PM | 30/3/2024 | |
| 20240330 | B11-C-00138 | B-MOTOR-CMP-01 | PM FOR GROUP MOTOR DMP1 | (6M)INSPECTION AND TEST | IM | 30/3/2024 | Motor |
| 20240330 | B11-C-00141 | B-MOTOR-CMP-02 | PM FOR GROUP MOTOR DMP2 | (6M)INSPECTION AND TEST | IM | 30/3/2024 | Motor |
| 20240329 | B00-C-00130 | B-1034-C02-001 | CO2 Portable for OLE OLE2/1 | (1M) CO2 Portable Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B00-C-00131 | B-1034-DC-001 | Dry Chemical for OLE2/1 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/3/2024 | |
| 20240329 | B00-C-00129 | B-1034-DC-002 | Dry Chemical for Admin | (1M)INSPECTION | IM | 29/3/2024 | |
| 20240329 | B00-S-00001 | B-1034-DV-001 | Deluge Valve for OLE OLE2/1Group 1 (- DV | (3M) Deluge Valve Function Test | PM | 29/3/2024 | |
| 20240329 | B00-S-00002 | B-1034-DV-002 | Deluge Valve for OLE OLE2/1Group 2 (- DV | (3M) Deluge Valve Function Test | PM | 29/3/2024 | |
| 20240329 | B00-S-00003 | B-1034-DV-003 | Deluge Valve for OLE OLE2/1Group 3 (- DV | (3M) Deluge Valve Function Test | PM | 29/3/2024 | |
| 20240329 | B00-S-00004 | B-1034-DV-004 | Deluge Valve for OLE OLE2/1Group 4 (- DV | (3M) Deluge Valve Function Test | PM | 29/3/2024 | |
| 20240329 | B00-S-00005 | B-1034-DV-005 | Deluge Valve for OLE OLE2/1Group 5 (- DV | (3M) Deluge Valve Function Test | PM | 29/3/2024 | |
| 20240329 | B00-S-00006 | B-1034-DV-006 | Deluge Valve for OLE OLE2/1Group 6 (- DV | (3M) Deluge Valve Function Test | PM | 29/3/2024 | |
| 20240329 | B00-C-00133 | B-1034-FA-001 | All Manual Fire Alarm for OLE2/1 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/3/2024 | |
| 20240329 | B00-C-00150 | B-1034-FDC-001 | Fire Department Connection for Admin | (1M)Fire Department Connection Visual | IM | 29/3/2024 | |
| 20240329 | B00-C-00152 | B-1034-FHH-001 | Fire Hose House for OLE2/1 | (1M)Fire Hose Box Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B00-C-00154 | B-1034-FHR-001 | Fire Hose Reel and Cabinet for Admin | (1M)Fire Hose and Cabinet Reel Visual | IM | 29/3/2024 | |
| 20240329 | B00-C-00155 | B-1034-FR-001 | Fixed Monitor for OLE2/1 | (1M)Fixed Monitor Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B00-C-00158 | B-1034-FRV-001 | Fixed Indicator Valve for OLE2/1 | (1M)Post Indicator Valve Visual Insp | IM | 29/3/2024 | |
| 20240329 | B00-C-00200 | B-1034-WMC-001 | Water Curtain for OLE2/1 | (1M)Water Curtain Inspection | IM | 29/3/2024 | |
| 20240329 | B11-C-00116 | B-1034-WDC-001 | Wheeled Fire Extinguishers for OLE2/1 | (1M)Dry Chemical Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B00-C-00203 | B-1034-WHM-001 | Water Hydrant for OLE2/1 | (1M)Water Hydrant Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B00-C-00205 | B-1034-WHM-001 | Water Hydrant with Monitor for OLE2/1 | (1M)Water Hydrant Monitor Visual Inspect | IM | 29/3/2024 | |
| 20240329 | B10-S-00006 | B-1035-C02-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B11-C-00087 | B-1035-DC-001 | Dry Chemical for OLE2/2 | (1M) Visual Inspection & Cartridge Weigh | IM | 29/3/2024 | |
| 20240329 | B11-C-00088 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (1M) Deluge Valve Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B11-C-00089 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (1M) Deluge Valve Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B11-C-00090 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Inspect | IM | 29/3/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|---|----|-----------|---------|
| 20240328 | BWS-S-00023 | B-W505-03-02 | CENTER LATEX MACHINE PINACHO | (1M)INSPECT | PM | 28/3/2024 | |
| 20240328 | BWS-C-00001 | B-W505-05-01 | COLUMIN TYPE DRILLING MACHINE | (1M)INSPECTION | PM | 28/3/2024 | |
| 20240328 | BWS-S-00028 | B-W505-07-01 | HYDRAULIC JACKSAW | (1M)INSPECT | PM | 28/3/2024 | |
| 20240328 | BWS-S-00028 | B-W505-21-01 | SHAW-WALKER MACHINE | (1M)INSPECTION & LUBRICATE | PM | 28/3/2024 | |
| 20240328 | BWS-S-00005 | B-W508-03-01 | HIGH PRESSURE WATER JET MACHINE | (1M)INSPECT | PM | 28/3/2024 | |
| 20240328 | BWS-S-00003 | B-W514-01-01 | FORK LIFT | (1M)INSPECTION | PM | 28/3/2024 | |
| 20240328 | BWS-S-00009 | B-W514-03-01 | TRUCK LOADER HINDO | (1M)INSPECTION | PM | 28/3/2024 | |
| 20240327 | B09P-C-00031 | B-ANALYZER-O2/4/1 | GROUPING FOR OXYGEN ANALYZER PLANT/4/1 | (2M)SET & CALIBRATE | PM | 27/3/2024 | |
| 20240327 | B61-C-00139 | B-AT-11411A | (2M)COO Analyzer | (2M)Inspect & Cal | PM | 27/3/2024 | |
| 20240327 | B09B-C-00027 | B-AT-382102 | SIQZ ANALYZER TRANSMITTER FOR V-3821 OUT | (1M)SET & CALIBRATE | PM | 27/3/2024 | |
| 20240327 | B12-C-00023 | B-AT-402103 | BUTADIENE IR | (2M)SET & CALIBRATE | PM | 27/3/2024 | |
| 20240327 | B10A-C-00041 | B-F-110 | USE RURNACES | (3M) CONDITION CHECK (OSL 2022-169) | IM | 27/3/2024 | Furnace |
| 20240327 | B09M-C-00006 | B-M-19006 | GROUPING TAG FOR LPG FROM PIT | (1Y)PROVE GAS TURBINE METER(OUT-SOURCE) | PM | 27/3/2024 | |
| 20240327 | B09K-C-00002 | B-M-19010 | GROUPING TAG FOR HXED 4 (EAST RD) | (1Y)AT-18011 CALIBRATION DENSIOMETER | PM | 27/3/2024 | |
| 20240327 | B09K-C-00012 | B-M-19015 | GROUPING TAG FOR HX TO TIC METER RING | (1Y)PROVE GAS TURBINE METER(OUT-SOURCE) | PM | 27/3/2024 | |
| 20240327 | B09K-C-00013 | B-M-19071 | GROUPING TAG FOR HX TO TIC METER RING | (1Y)PROVE GAS TURBINE METER(OUT-SOURCE) | PM | 27/3/2024 | |
| 20240327 | B09K-C-00029 | B-MCC-264-2-3 | MCC FOR R-3600-G-6 | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240327 | B09K-C-00029 | B-MCC-264-7-M | MCC FOR R-3600-P-15 | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240327 | B09K-C-00028 | B-MCC-265-3-K | MCC FOR R-3650-G-5 | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240327 | B09K-C-00029 | B-MCC-265-6-T | FEEDER FOR R-3600-G-6 | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240327 | B12-C-00037 | B-MCC-26A-SR03A1 | MCC for R-4031-R-1A | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240327 | B12-C-00037 | B-MCC-26A-SR06D1 | MCC for R-4031-P-1A | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240327 | B12-C-00037 | B-MCC-26B-SA20D1 | MCC for R-4031-P-1S | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240327 | B12-C-00037 | B-MCC-26B-SA23B1 | MCC for R-4031-R-1S | RCM (3M) MCC INSPECTION | IM | 27/3/2024 | |
| 20240326 | B3A-C-00004 | B-AT-2410 | ISO14000,OPACITY ANALYZER FOR S-2401 | (3M)WINDOW CHECK (B-2401) | PM | 26/3/2024 | |
| 20240326 | B12-C-00024 | B-AT-402104 | BUTADIENE Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/3/2024 | |
| 20240326 | B12-C-00025 | B-AT-404501 | BEU Column Accumu. (M-4045) Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/3/2024 | |
| 20240326 | B7-C-00006 | B-AT-9940 | HC LP SUS COND. DISC. P-902A/5 | (1M)SET & CALIBRATE | PM | 26/3/2024 | |
| 20240326 | B63-C-00008 | B-DV-NPA-001 | GROUPING TAG FOR DELUGE VALVE NPA | (1M)CHECK/VISUAL HEAT DETECTORS AND | PM | 26/3/2024 | |
| 20240326 | B12-C-00036 | B-MCC-26A-SR05D1 | MCC for R-4031S | RCM (3M) MCC INSPECTION | IM | 26/3/2024 | |
| 20240326 | B12-C-00036 | B-MCC-26B-SA20D1 | MCC for R-4031S | RCM (3M) MCC INSPECTION | IM | 26/3/2024 | |
| 20240326 | B12-C-00036 | B-MCC-26B-SA23B3 | MCC for R-4031-G-5 | RCM (3M) MCC INSPECTION | IM | 26/3/2024 | |
| 20240326 | B12-C-00036 | B-MCC-26B-SR23D1 | MCC for R-4031-P-1S | RCM (3M) MCC INSPECTION | IM | 26/3/2024 | |
| 20240325 | B09P-C-00002 | B-EPCD1MA | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-S-00001 | B-EPCD1MB | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-C-00002 | B-EPCD1MC | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-S-00001 | B-EPCD1MD | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-C-00003 | B-EPCD1ME | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-S-00001 | B-EPCD1MF | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-C-00002 | B-EPCD1MG | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-S-00001 | B-EPCD1MH | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/3/2024 | |
| 20240325 | B09P-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/3/2024 | Motor |
| 20240325 | B09P-C-00004 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/3/2024 | Motor |
| 20240325 | B61-S-00001 | B-P-1137A | HERATION TANK FEED PUMP | (1Y)LUBRICATION | PM | 25/3/2024 | Pump |
| 20240325 | B61-S-00030 | B-P-1137S | HERATION TANK FEED PUMP | (1Y)LUBRICATION | PM | 25/3/2024 | Pump |
| 20240325 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1Y)Weekly-Pit suction screen cleaning | PM | 25/3/2024 | Pump |
| 20240325 | B90-C-00015 | B-PM-3001S | UPS FEED PUMP MOTOR | (3M)LUBRICATION MOTORS | PM | 25/3/2024 | Motor |
| 20240325 | B09S-C-00001 | B-PSV-1470A | SAFETY VALVE CW. RETURN LINE 2ND STAGE | (3Y)INSPECTION & OVERHAUL | PM | 25/3/2024 | PSV |
| 20240325 | B09S-C-00002 | B-PSV-1470S | SAFETY VALVE CW. RETURN LINE 2ND STAGE | (3Y)INSPECTION & OVERHAUL | PM | 25/3/2024 | PSV |
| 20240325 | B09S-C-00003 | B-PSV-1470E | SAFETY VALVE CW. RETURN LINE 3RD STAGE R | (3Y)INSPECTION & OVERHAUL | PM | 25/3/2024 | PSV |

| | | | | | | | |
|----------|---------------|-------------------|---|---|----|-----------|------------|
| 20240329 | B11-S-00005 | B-1035-WH-001 | Water Hydrant for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B11-S-00006 | B-1035-WH-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant Monitor Visual Inspe | IM | 29/3/2024 | |
| 20240329 | B12-C-00071 | B-1036-PV-001 | Post Indicator Valve for OLE2/3 | (1M)Post Indicator Valve Visual Insp | IM | 29/3/2024 | |
| 20240329 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/3/2024 | Pump |
| 20240329 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/3/2024 | Pump |
| 20240329 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 29/3/2024 | Pump |
| 20240329 | B12-C-00055 | B-GS-26-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 29/3/2024 | |
| 20240329 | B90-C-00005 | B-GS-26-F2 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 29/3/2024 | |
| 20240329 | B90-C-00005 | B-GS-34-A | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 29/3/2024 | |
| 20240329 | B061-C-00019 | B-P-1132A | DCP FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 29/3/2024 | Pump |
| 20240329 | B061-C-00019 | B-P-1132S | DCP FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 29/3/2024 | Pump |
| 20240329 | B061-C-00018 | B-P-1136A | DCP EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 29/3/2024 | Pump |
| 20240329 | B061-C-00018 | B-P-1136S | DCP EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 29/3/2024 | Pump |
| 20240329 | B063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 29/3/2024 | Pump |
| 20240329 | B063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 29/3/2024 | Pump |
| 20240329 | B063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 29/3/2024 | Pump |
| 20240329 | B063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 29/3/2024 | Pump |
| 20240329 | B063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 29/3/2024 | Pump |
| 20240329 | B25-C-00015 | B-PSV-3700S | A-370A TO COLD FLARE | (3Y)SET & CALIBRATE(PSV 406) | PM | 29/3/2024 | PSV |
| 20240329 | B41-C-00021 | B-PSV-4802A | T-482A/B TO COLD FLARE | (3Y)SET & CALIBRATE(PSV 1 1/2X3) | PM | 29/3/2024 | PSV |
| 20240329 | B29-C-00034 | B-PSV-5312A | T-531A/B TO HOT FLARE | (3Y)SET & CALIBRATE(PSV 1 1/2X2) | PM | 29/3/2024 | PSV |
| 20240329 | B17-C-00016 | B-P-310S | ETHYLENE FURNACE ID FAN#5 | RCM (3Y)Overhaul ID Fan Bearing Group"ID" | PM | 29/3/2024 | |
| 20240329 | B17-C-00016 | B-RH-310S | ETHYLENE FURNACE ID FAN#5 MOTOR | (3Y) ID Fan Motor Overhaul (Group "ID") | IM | 29/3/2024 | |
| 20240329 | B11-C-00142 | B-SCBA-001 | Self-contained breather for | (1M)SCBA Visual Inspection | IM | 29/3/2024 | |
| 20240329 | B32-C-00086 | B-SP-06/04 | PORTABLE PNEUMATIC PRESSURE CALIBRATOR | (1Y)CAL PORT-PNEUMATIC PRESS(OUT-SOURCE) | PM | 29/3/2024 | |
| 20240328 | B12-C-00789 | B-1036-DV-001 | Deluge Valve for Grouping 1(OLE2/3)/71g | (1M)Deluge Valve Visual Inspection | IM | 28/3/2024 | |
| 20240328 | B12-C-00793 | B-1036-DV-002 | Deluge Valve for Grouping 2(OLE2/3)/71g | (1M)Deluge Valve Visual Inspection | IM | 28/3/2024 | |
| 20240328 | B12-C-00797 | B-1036-DV-003 | Deluge Valve for Grouping 3(OLE2/3)/61g | (1M)Deluge Valve Visual Inspection | IM | 28/3/2024 | |
| 20240328 | B12-C-00799 | B-1036-FHH-001 | Fire Hose House for OLE2/3 | (1M)Fire Hose Box Visual Inspection | IM | 28/3/2024 | |
| 20240328 | B12-C-00778 | B-1036-WH-001 | Water Hydrant for OLE2/3 | (1M)Water Hydrant Visual Inspection | IM | 28/3/2024 | |
| 20240328 | B12-C-00779 | B-1036-WH-001 | Water Hydrant with Monitor for OLE2/3 | (1M)Water Hydrant Monitor Visual Inspect | IM | 28/3/2024 | |
| 20240328 | B23A-C-19001A | B-AT-19001 | FUEL GAS CUSTODY INLET | (2W)CALIBRATION | PM | 28/3/2024 | |
| 20240328 | B18A-C-00062 | B-CRIT-CQ-ELD-P2 | Critical Equipment Cold Area Mark 2 | (2W)Visual & Condition Inspection | PM | 28/3/2024 | |
| 20240328 | B18-C-00062 | B-EL-GR0P | Grouping for EXIST LIGHTING GRP | (3M)INSPECT, VERIFY&CHECK | PM | 28/3/2024 | |
| 20240328 | B09-C-00140 | B-INTERCOM-GRP-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 28/3/2024 | |
| 20240328 | B90-C-00039 | B-MCC-EO-211 | Grouping Tag for MCC Sub#4 (MCC-211) | (3M) INSPECT & Adjust | PM | 28/3/2024 | |
| 20240328 | B90-C-00174 | B-MCC-EO-B | Grouping Tag for 6.6KV MCC Sub#5 | (3M)INSPECT CABLE/TIGHTNESS NUTS AND SCR | PM | 28/3/2024 | |
| 20240328 | B02-C-00013 | B-P-3402 | DR-SPON C2 PUMP | (6M) CHECK & INSPECT | PM | 28/3/2024 | Pump |
| 20240328 | B01-C-00017 | B-P-3502A | DEBUTANIZER REFLUX PUMP | (6M)CHECK & INSPECT | PM | 28/3/2024 | Pump |
| 20240328 | B01-C-00018 | B-P-3502S | DEBUTANIZER REFLUX PUMP | (6M)CHECK & INSPECT | PM | 28/3/2024 | Pump |
| 20240328 | B04-C-00034 | B-P-3601S | ETHANE RECYCLE PUMP | (6M)CHECK & INSPECT | PM | 28/3/2024 | Pump |
| 20240328 | B20-C-00003 | B-SECUR-TASK03A | FOR PH: CHECK A FORD TRUCK NO1 (MUNGARTE) | (1D)INSPECTION | PM | 28/3/2024 | |
| 20240328 | B20-C-00003 | B-SECUR-TASK03C | FOR PH: CHECK A WATER TRUCK(SAYVIRAT) | (1D)INSPECTION | PM | 28/3/2024 | |
| 20240328 | B20-C-00003 | B-SECUR-TASK03E | FOR PH: CHECK AMULIANK(EJITIKRUSA) | (1D)INSPECTION | PM | 28/3/2024 | |
| 20240328 | B20-C-00003 | B-SECUR-TASK03G | FOR PH: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 28/3/2024 | |
| 20240328 | BNA-C-00024 | B-SECUR-TASK06 | FOR PH: TEST A FIRE TRUCK | (2W)INSPECTION | PM | 28/3/2024 | |
| 20240328 | BWS-S-00007 | B-W502-02-01 | AIR COMPRESSOR SULLARK | (1M)INSPECTION | PM | 28/3/2024 | Compressor |
| 20240328 | BWS-S-00001 | B-W502-03-01 | BALANCING MACHINE | (1M)INSPECTION | PM | 28/3/2024 | |
| 20240328 | BWS-S-00001 | B-W505-01-01 | UNIVERSAL MILLING MACHINE | (1M)INSPECT | PM | 28/3/2024 | |
| 20240328 | BWS-S-00014 | B-W505-03-01 | CENTER LATHE MACHINE AJAX | (1M)INSPECT | PM | 28/3/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|--|---|----|-----------|---------|
| 20240315 | 800-C-00207 | B-1034-DC-001 | Dry Chemical for OLEF21 | (5Y)Dry Chemical Hydro Static Test | PM | 15/3/2024 | |
| 20240315 | 800-C-00208 | B-1034-FST-1605 | Foam Storage Tank for Truck Load | (1M)VISUAL INSPECTION | PM | 15/3/2024 | |
| 20240315 | 800-C-00209 | B-1034-FST-1605 | Foam Storage Tank for Truck Load | (3M)FUNCTION TEST | PM | 15/3/2024 | |
| 20240315 | 800-C-00221 | B-1034-FST-1605 | Foam Storage Tank for Truck Load | (1Y)Sampling Foam Concentrate | PM | 15/3/2024 | |
| 20240315 | 800-C-00210 | B-1034-FST-1605 | Foam Storage Tank for Truck Load | (6M)Spray Test | PM | 15/3/2024 | |
| 20240315 | 800-C-00215 | B-1034-HDT-SUB7 | All Heat Detector for sub7 | (6M)Heat Detector Visual Inspection | PM | 15/3/2024 | |
| 20240315 | 800-C-00216 | B-1034-HDT-SUB7 | All Heat Detector for sub7 | (1Y) Heat Detector Cleaning and Function | PM | 15/3/2024 | |
| 20240315 | 800-C-00212 | B-1034-SUB-SUBTANK | All Smoke Detector for Sub Tank | (1Y)Smoke Detector Cleaning and Function | PM | 15/3/2024 | |
| 20240315 | 800-C-00211 | B-1034-SUB-SUBTANK | All Smoke Detector for Sub Tank | (6M)Smoke Detector Visual Inspection | PM | 15/3/2024 | |
| 20240315 | 800-C-00213 | B-1034-SUB-ADMIN | All Smoke Detector for Admin Area | (6M)Smoke Detector Visual Inspection | PM | 15/3/2024 | |
| 20240315 | 800-C-00214 | B-1034-SUB-ADMIN | All Smoke Detector for Admin Area | (1Y) Smoke Detector Cleaning and Function | PM | 15/3/2024 | |
| 20240315 | 802-C-00004 | B-A-530 | PROPYLENE STRIPPER | (3M) CONDITION CHECK (OSL 2020-001) | IM | 15/3/2024 | |
| 20240315 | 890-S-00019 | B-CAP-CS | GROUPING TAG FOR CAP-CS SUBSTATION#3 | (1M)VISUAL INSPECTION TEMP,MOISE, VIBRAT | PM | 15/3/2024 | |
| 20240315 | 848-C-00023 | B-CCTV-GPI-BV | CCTV Grouping Tag BV | (3M)FUNCTION TEST & EXERCISE | PM | 15/3/2024 | |
| 20240315 | 810-C-00047 | B-F-120 | USE FURNACES | (1.5Y)INSPECT HC FEED LINE(GROUP#A) | IM | 15/3/2024 | Furnace |
| 20240315 | 8009-C-00005 | B-FACP-CO2-1 | CO2 SYSTEM CONTROL PANEL(GIS) | (18M)BATTERY REPLACEMENT | PM | 15/3/2024 | |
| 20240315 | 8009-C-00005 | B-FACP-CO2-2 | CO2 SYSTEM CONTROL PANEL(SWGR) | (18M)BATTERY REPLACEMENT | PM | 15/3/2024 | |
| 20240315 | 861-C-00083 | B-G-1125-P-1A | DGF RECYCLE PUMP | (1Y) CHANGE LUBE OIL | PM | 15/3/2024 | |
| 20240315 | 8061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/3/2024 | |
| 20240315 | 8061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/3/2024 | |
| 20240315 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 15/3/2024 | |
| 20240315 | 812-C-00051 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 15/3/2024 | |
| 20240315 | 890-C-00005 | B-GS-2E | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 15/3/2024 | |
| 20240315 | 890-C-00005 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 15/3/2024 | |
| 20240315 | 810L-C-00045 | B-HV-10206 | F-1020 EFFLUENT TO A-210 | (3M)Collect Torque Profile & Record | IM | 15/3/2024 | |
| 20240315 | 810L-C-00044 | B-HV-10207 | DECOKE EFFLUENT TO F-1020 | (3M)Collect Torque Profile & Record | IM | 15/3/2024 | |
| 20240315 | 848-C-00022 | B-INTERCOM-GP2-BV | INTERCOM Grouping Tag BV | (3M)INTERCOM FUNCTION TEST | PM | 15/3/2024 | |
| 20240315 | 81-C-00015 | B-M-19026 | GROUPING TAG FOR LP, PROPYLENE TO HMC | (4M)CALIBRATION | PM | 15/3/2024 | |
| 20240315 | 8063-C-00018 | B-MCC-2C2-1 | MCC FOR P-1602A | RCM(3M) Visual Inspection | PM | 15/3/2024 | |
| 20240315 | 8063-C-00018 | B-MCC-344-1 | MCC FOR P-1602B | RCM(3M) Visual Inspection | PM | 15/3/2024 | |
| 20240315 | 8025-C-00021 | B-MCC-CO-002 | GROUPING TAG FOR MCC | (1M)INSPECT CABLE/TIGHTNESS NUTS/SCREWS | PM | 15/3/2024 | |
| 20240315 | 807-S-00001 | B-OIL-MIST-PLANT2 | Grouping Tag for Oil Mist Systems PI-4/2 | (6M)INSPECTION & CALIBRATION | PM | 15/3/2024 | |
| 20240315 | 8061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 15/3/2024 | Pump |
| 20240315 | 8061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 15/3/2024 | Pump |
| 20240315 | 8061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 15/3/2024 | Pump |
| 20240315 | 8061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 15/3/2024 | Pump |
| 20240315 | 8063-WK-0002 | B-P-1601A | FIRE MAIN PUMP | (1W)TEST RUN | PM | 15/3/2024 | Pump |
| 20240315 | 8063-WK-0002 | B-P-1601B | FIRE MAIN PUMP | (1W)TEST RUN | PM | 15/3/2024 | Pump |
| 20240315 | 8063-WK-0002 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 15/3/2024 | Pump |
| 20240315 | 8063-WK-0002 | B-P-1601D | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 15/3/2024 | Pump |
| 20240315 | 8063-WK-0002 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | (1W)TEST RUN | PM | 15/3/2024 | Pump |
| 20240315 | 8063-C-00046 | B-P-1602A | FIRE WATER JOCKEY PUMP | (1M)Visual inspect Conduion | PM | 15/3/2024 | Pump |
| 20240315 | 8063-C-00047 | B-P-1602S | FIRE WATER JOCKEY PUMP | (1M)Visual inspect Conduion | PM | 15/3/2024 | Pump |
| 20240315 | 826-C-00020 | B-PSV-3730S | T-373 TO HOT FLARE | (3Y)SET & CALIBRATE (PSV 1X2) | PM | 15/3/2024 | PSV |
| 20240315 | 829-C-00047 | B-PSV-5320S | T-531 TO HOT FLARE | (3Y)SET & CALIBRATE (PSV 1X2) | PM | 15/3/2024 | PSV |
| 20240315 | 819A-C-00068 | B-R-300-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 15/3/2024 | |
| 20240315 | 8009-C-00005 | B-SUT-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (18M)BATTERY REPLACEMENT | PM | 15/3/2024 | |
| 20240315 | 812-C-00016 | B-SUT-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (6M)FA-FACP-001 | PM | 15/3/2024 | |
| 20240315 | 812-C-00016 | B-SUT-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)INSPECT GEAR OF BTF VALVE CWR T-404S | IM | 15/3/2024 | |
| 20240314 | 8053-C-00006 | B-AE-22201 | DEMI WATER TO PROCESS | (3M) CONDITION CHECK (OSL 2021-125) | IM | 14/3/2024 | |

| | | | | | | | |
|----------|--------------|-----------------|--|--|----|-----------|-------|
| 20240311 | 842B-C-00015 | B-MR-600-P-2A | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/3/2024 | |
| 20240311 | 842B-C-00015 | B-MR-600-P-2S | CZR SURFACE CONDENSER PUMP MOTOR | RCM-(3M)REGREASE | PM | 11/3/2024 | |
| 20240311 | 8063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1Y)Weekly PI suction screen cleaning | PM | 11/3/2024 | Pump |
| 20240311 | 842B-C-00001 | B-R-300 | ETHYLENE FLARE TO FAN#6 | (2M) RE GREASE DAMPER BEARING | PM | 11/3/2024 | |
| 20240311 | 842B-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1M)INSPECTION | PM | 11/3/2024 | |
| 20240311 | 838-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/3/2024 | |
| 20240311 | 8C15-C-00003 | B-V-3842-P1A | POLYELECTROLYTE SCALE INHIBITOR INJECTIO | (1Y)LUBRICATE | PM | 11/3/2024 | |
| 20240311 | 8C15-C-00004 | B-V-3842-P1S | POLYELECTROLYTE SCALE INHIBITOR INJECTIO | (1Y)LUBRICATE | PM | 11/3/2024 | |
| 20240310 | 812-C-00026 | B-AT-40202 | BUTADIENE IR | (2M)SET & CALIBRATE | PM | 10/3/2024 | |
| 20240310 | 812-C-00070 | B-AT-43003 | BUTENE-1 GCG | (1M)SET&CALIBRATE | PM | 10/3/2024 | |
| 20240310 | 812-C-00030 | B-AT-430601 | BUTENE-1 IR | (2M)SET & CALIBRATE | PM | 10/3/2024 | |
| 20240310 | 813-S-00013 | B-BU-2H1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 813-S-00014 | B-BU-2H2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 813-S-00015 | B-BU-2H3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 813-S-00016 | B-BU-2H4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00052 | B-BU-BC-110 | BATTERY UNIT FOR 110VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00053 | B-BU-BC-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00056 | B-BU-BC-24 | BATTERY UNIT FOR 24VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00054 | B-BU-BC1-110 | BATTERY UNIT FOR 110VDC SUB.2 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00055 | B-BU-BC2-110 | BATTERY UNIT FOR 110VDC SUB.PROCESS | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00058 | B-BU-DC | BATTERY UNIT FOR 110VDC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00059 | B-BU-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00062 | B-BU-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00060 | B-BU-UPS1-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 890-S-00061 | B-BU-UPS2-1 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/3/2024 | |
| 20240310 | 8077-C-00001 | B-G-3100 | ELEVATOR | (1M)INSPECTION AND FUNCTION TEST | PM | 10/3/2024 | |
| 20240310 | 8W5-S-00027 | B-HYDRAULIC-01 | HYDRAULIC STATIC PRESS 30 T | (1M)LUBRICATION & INSPECTION | PM | 10/3/2024 | |
| 20240310 | 809S-C-00002 | B-MOTOR-EO-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 10/3/2024 | Motor |
| 20240310 | 863-S-00019 | B-MHP-1602A | FIREWATER JOCKEY PUMP MOTOR | RCM(3M) GREASE DECKCHECK OIL LEVEL MOTOR | PM | 10/3/2024 | Motor |
| 20240310 | 863-S-00020 | B-MHP-1602S | FIREWATER JOCKEY PUMP MOTOR | RCM(3M) GREASE DECKCHECK OIL LEVEL MOTOR | PM | 10/3/2024 | Motor |
| 20240310 | 863-S-00018 | B-K05G5 | GROUPING FOR 113KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/3/2024 | |
| 20240310 | 863-S-00014 | B-P-1501D | ENGINE DRIVEN FIRE PUMP | RCM(3M)REGREASE COUPLING | PM | 10/3/2024 | Pump |
| 20240310 | 863-S-00015 | B-P-1601S | ENGINE DRIVEN FIRE PUMP | RCM(3M)REGREASE COUPLING | PM | 10/3/2024 | Pump |
| 20240310 | 8NA-C-00010 | B-SECUR-TASK18 | INSPECTION FIRE ALARM STATION | (1M)INSPECTION | PM | 10/3/2024 | |
| 20240310 | 820-C-00002 | B-SECUR-TASK43 | VISUAL INSPECTION MOBILE FOAM U | (1M)INSPECTION | PM | 10/3/2024 | |
| 20240310 | 811S-C-00001 | B-XV-330101 | SH STM TO R3301-PT-01A | RCA (1M) CLEAN&INSPECTION | PM | 10/3/2024 | |
| 20240309 | 8081-C-00001 | B-AT-1100/1900 | PGC EFFLUENT FROM F-3101/F-190 | (1M)SET & CALIBRATION | PM | 9/3/2024 | |
| 20240309 | 8077-C-00086 | B-AT-3100XIA1-3 | GROUPING TAG CEMS F-3101 to F-3103 | (1M)SET&CALIBRATION | PM | 9/3/2024 | |
| 20240309 | 8077-C-00086 | B-AT-3100XIB1-4 | GROUPING TAG CEMS F-3104 to F-3106 | (1M)SET&CALIBRATION | PM | 9/3/2024 | |
| 20240309 | 860S-00001 | B-G-1122-P-1A | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/3/2024 | |
| 20240309 | 860-S-00002 | B-G-1122-P-1S | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/3/2024 | |
| 20240309 | 8061-C-00021 | B-G-1134-V-1 | NEW AERATION TANK | (3M) CONDITION CHECK (OSL 2023-272) | IM | 9/3/2024 | |
| 20240309 | 8H3-C-00027 | B-HV-310113 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H3-C-00026 | B-HV-310114 | MOTOR OPERATED DECKING VALVE OF F-3101 | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H4-C-00023 | B-HV-310213 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H4-C-00024 | B-HV-310214 | MOTOR OPERATED DECKING VALVE OF F-3102 | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H5-C-00023 | B-HV-310313 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H5-C-00024 | B-HV-310314 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H6-C-00023 | B-HV-310413 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--------------------------------------|----|----------|------------|
| 20240309 | 8H6-C-00024 | B-HV-310414 | MOTOR OPERATED DECKING VALVE OF F-3104 | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H7-C-00023 | B-HV-310513 | MOTOR OPERATED TRANSFER LINE VALVE OF F- | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H7-C-00024 | B-HV-310514 | MOTOR OPERATED DECKING VALVE OF F-3105 | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 8H8-C-00023 | B-HV-310604 | ELECTRICPOWER (F-3106 CRACKED GAS MOVES) | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 809S-C-00015 | B-HV-310608 | ELECTRICPOWER (F-3106 CRACKED GAS MOVES) | (3M)Collect Torque Profile & Record | IM | 9/3/2024 | |
| 20240309 | 809S-C-00040 | B-M-19007 | GROUPING TAG FOR ETHYLENE TO FROM I-1 | (4M)SET & CALIBRATE | PM | 9/3/2024 | |
| 20240309 | 809S-C-00053 | B-M-19008 | GROUPING TAG FOR ETHYLENE TO VNT | (4M)SET & CALIBRATE | PM | 9/3/2024 | |
| 20240309 | 8060-C-00058 | B-P-1123A | SULFURIC ACID TRANSFER PUMP | (3M) CONDITION CHECK (OSL 2023-268) | IM | 9/3/2024 | Pump |
| 20240309 | 857A-C-00022 | B-P-1201A | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2020-028) | IM | 9/3/2024 | Pump |
| 20240309 | 8030-C-00010 | B-P-5668 | DEBURTANIZER REFLUX/PRODUCT PUMPS | (3M) CONDITION CHECK (OSL 2023-271) | IM | 9/3/2024 | Pump |
| 20240309 | 8001-C-00033 | B-P-9013 | SHIP BOW PUMPS | (3M) CONDITION CHECK (OSL 2020-029) | IM | 9/3/2024 | Pump |
| 20240309 | 800-C-00122 | B-PIPEL-05 | LINE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-267) | IM | 9/3/2024 | |
| 20240309 | 800-C-00017 | B-PIPEL-06 | LINE STEAM CONDENSATE - HP OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-027) | IM | 9/3/2024 | |
| 20240309 | 848S-C-00017 | B-Q-1515 | NGL STORAGE TANK | (3M) CONDITION CHECK (OSL 2023-269) | IM | 9/3/2024 | |
| 20240309 | 818A-C-00032 | B-RT-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (3M) CONDITION CHECK (OSL 2020-025) | IM | 9/3/2024 | Compressor |
| 20240309 | 8068-C-00004 | B-SOH-270 | DESUPERHEATER OF DILUTION STEAM TO PURNA | (3M) CONDITION CHECK (OSL 2020-026) | IM | 9/3/2024 | |
| 20240309 | 8NA-C-00009 | B-SECUR-TASK17 | INSPECTION FOAM STORAGE TANK,FOA | (1M)INSPECTION | PM | 9/3/2024 | |
| 20240309 | 8478-C-00053 | B-T-1534 | PROPYLENE VAPORIZER | (3M) CONDITION CHECK (OSL 2020-024) | IM | 9/3/2024 | |
| 20240309 | 8H10-C-00021 | B-T-32036 | DILUTION STEAM REBOILER | (3M) CONDITION CHECK (OSL 2023-273) | IM | 9/3/2024 | |
| 20240309 | 800-C-00125 | B-TRAP-050 | GROUPING STEAM TRAP AREA 050 | (3M) CONDITION CHECK (OSL 2023-275) | IM | 9/3/2024 | |
| 20240309 | 800-C-00123 | B-TRAP-050 | GROUPING STEAM TRAP AREA 050 | (3M) CONDITION CHECK (OSL 2023-274) | IM | 9/3/2024 | |
| 20240309 | 800-C-00124 | B-VALVE1-5H | VALVE STEAM - MEDIUM PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-274) | IM | 9/3/2024 | |
| 20240309 | 8061-C-00010 | B-WM-1102 | WATER MONITOR AREA NPA | (6M)WATER MONITOR AREA NPA | PM | 9/3/2024 | |
| 20240309 | 8063-C-00010 | B-WM-1102 | WATER MONITOR AREA NPA | (6M)WATER MONITOR AREA NPA | PM | 9/3/2024 | |
| 20240309 | 8063-C-00010 | B-WM-1649 | WATER MONITOR PROCESS AREA | (6M)WATER MONITOR PROCESS AREA | PM | 9/3/2024 | |
| 20240309 | 8063-C-00011 | B-WM-1650 | WATER MONITOR FIRE TRAINING AREA | (6M)WATER MONITOR FIRE TRAINING AREA | PM | 9/3/2024 | |
| 20240309 | 8063-C-00012 | B-WM-2101 | WATER MONITOR WWV & COOLING AREA | (6M)WATER MONITOR WWV & COOLING AREA | PM | 9/3/2024 | |
| 20240309 | 8063-C-00013 | B-WM-2102 | WATER MONITOR WWV & COOLING AREA | (6M)WATER MONITOR WWV & COOLING AREA | PM | 9/3/2024 | |
| 20240309 | 8H36-C-00001 | B-AT-342001 | MOISTURE ANALYZER TRANSMITTER FOR M-3420 | (2M)SET & CALIBRATE | PM | 8/3/2024 | |
| 20240309 | 800-C-00082 | B-CCTV-FS | GROUPING TAG FOR FIRE STATION | (LY) Inspection | PM | 8/3/2024 | |
| 20240309 | 800-C-00083 | B-CCTV-GATE | GROUPING TAG FOR GATE | (LY) Inspection | PM | 8/3/2024 | |
| 20240309 | 800-C-00084 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (LY) Inspection | PM | 8/3/2024 | |
| 20240309 | 809S-C-00199 | B-E-92 | EMERGENCY EXIT GROUPING FOR P2 | (3M)INSPECT, VERIFY& CHECK | PM | 8/3/2024 | |
| 20240309 | 8061-C-00017 | B-G-1144-P-2A | W/CLCLEAN STRAINER FOR B-G-1144-P-2 | (W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 8/3/2024 | |
| 20240309 | 8061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 8/3/2024 | |
| 20240309 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 8/3/2024 | |
| 20240309 | 849-C-00021 | B-G-1350-P-1 | LP VOC FLARE KO DRUM LIQUID PUMP | PCM-(1M)Short Term preservation | PM | 8/3/2024 | Flare |
| 20240309 | 812-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 8/3/2024 | |
| 20240309 | 890-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 8/3/2024 | |
| 20240309 | 890-C-00075 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 8/3/2024 | |
| 20240309 | 848-C-00021 | B-INTERCOM-GP1-BV | INTERCOM Grouping TAG BV | (3M)INTERCOM FUNCTION TEST | PM | 8/3/2024 | |
| 20240309 | 8016-C-00026 | B-M-20 | WATER STRIPPER FEED COALESCE | (3M) CONDITION CHECK (OSL 2022-139) | IM | 8/3/2024 | |
| 20240309 | 8081-C-00019 | B-P-1132A | CPI FEED PUMP | (W)CLEAN STRAINER FOR B-P-1132 | PM | 8/3/2024 | Pump |
| 20240309 | 8061-C-00019 | B-P-1132S | CPI FEED PUMP | (W)CLEAN STRAINER FOR B-P-1132 | PM | 8/3/2024 | Pump |
| 20240309 | 8061-C-00018 | B-P-1136A | OPF EFFLUENT TRANSFER PUMP | (W)CLEAN STRAINER FOR B-P-1136 | PM | 8/3/2024 | Pump |
| 20240309 | 8061-C-00018 | B-P-1136S | OPF EFFLUENT TRANSFER PUMP | (W)CLEAN STRAINER FOR B-P-1136 | PM | 8/3/2024 | Pump |
| 20240309 | 857-B-00002 | B-PSV-14757A | SAFETY VALVE DISCHARGE 1ST STAGE R-1475S | (16,000)H/INSPECTION & OVERHAUL | PM | 8/3/2024 | PSV |
| 20240309 | 857-B-00002 | B-PSV-14757B | SAFETY VALVE DISCHARGE 1ST STAGE R-1475S | (16,000)H/INSPECTION & OVERHAUL | PM | 8/3/2024 | PSV |
| 20240309 | 857-B-00002 | B-PSV-14757A | SAFETY VALVE DISCHARGE R-1475S LINE TO G | (16,000)H/INSPECTION & OVERHAUL | PM | 8/3/2024 | PSV |
| 20240309 | 825-C-00016 | B-PSV-3761A | M-376 TO COLD FLARE | (3)SET&CALIBRATE (PSV1 1/202 1/2) | PM | 8/3/2024 | PSV |

| | | | | | | | | | | | | | | | |
|----------|----------------|----------------------------------|---|--|----------|----------|--------------|-------------|--------------------|-----------------------------------|--|--------------------------------------|----------|----------|-------|
| 20240305 | B90-C-00094 | B-UPSI-A1 | UPSI FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/3/2024 | | 20240303 | B90-C-00186 | B-MOTOR-OSHL-BBC | MOTOR GROUPING FOR OSHL-BBC | (1M)CLEANING AND INSPECTION. | PM | 3/3/2024 | Motor |
| 20240305 | B-UPSI-A2 | UPSI(BYPASS) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/3/2024 | | 20240303 | B90-C-00203 | B-MOTOR-LEFFINS-P1 | Equipment from Olefins Plant 1-01 | (3M) CONDITION CHECK (OSL 2022-195) | IM | 3/3/2024 | | |
| 20240305 | B90-C-00096 | B-UPSI-A3 | UPSI FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/3/2024 | | 20240303 | B90-C-00209 | LINE BLOWDOWN HYDRANT-BD | LINE BLOWDOWN HYDRANT WATER OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-187) | IM | 3/3/2024 | |
| 20240304 | B1-C-00018 | B-AT-9010 | BFW FROM DEAERATOR | (7M)CALIBRATION | PM | 4/3/2024 | | 20240303 | B90-C-00210 | B-K-1470-P-2S | PLANT AIR AUXILIARY PUMP | HC-K (1Y) COUPLING INSPECTION | PM | 3/3/2024 | |
| 20240304 | B13-C-00053 | B-CAP-1M1 | POWER CAPACITOR PANEL-1 | (1M)VISUAL INSPECTION | PM | 4/3/2024 | | 20240303 | B90-C-00250 | B-SD-BK-1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.1 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B13-C-00054 | B-CAP-1M1 | POWER CAPACITOR PANEL-2 | (1M)VISUAL INSPECTION | PM | 4/3/2024 | | 20240303 | B90-C-00251 | B-SD-BK-2M1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.2 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B13-C-00057 | B-EHT-001 | ELECTRICAL HEAT TRACING CONTROL PANEL | (1M)VISUAL INSPECTION | PM | 4/3/2024 | | 20240303 | B90-C-00252 | B-SD-BK-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B10L-C-00006 | B-F-1020 | USC PYROLYSIS FURNACE | (3Y)CLEANING & INSPECTION(GROUP A) | PM | 4/3/2024 | Furnace | 20240303 | B90-C-00253 | B-SD-BK-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.1 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B10L-C-00026 | B-F-1020 | USC PYROLYSIS FURNACE | (1.5Y)CLEANING & INSPECTION(GROUP 2) | PM | 4/3/2024 | Furnace | 20240303 | B94-C-00015 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B10L-C-00004 | B-F-1020 | USC PYROLYSIS FURNACE | (3Y)CONVECTION CLEAN (GROUP "B") | PM | 4/3/2024 | Furnace | 20240303 | B009-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.1 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B12-C-00048 | B-GAS-DETECTOR-BV | Grouping for Gas Detector BV | (4M)CAL GAS DETECTOR PLANT(BV)(OUT-SOURCE) | PM | 4/3/2024 | Gas Detector | 20240303 | B009-C-00011 | B-SD-F2 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B-GO-486001 | B-GO-486001 | Gas detector Raffinate metering skid | (4M)CAL GAS DETECTOR PLANT(BV)(OUT-SOURCE) | PM | 4/3/2024 | Gas Detector | 20240303 | B90-C-00254 | B-SD-PF | DISTRIBUTION PANEL OF BC 24VDC SUB.6 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B12-C-00048 | B-GO-486002 | Gas detector Raffinate metering skid | (4M)CAL GAS DETECTOR PLANT(BV)(OUT-SOURCE) | PM | 4/3/2024 | Gas Detector | 20240303 | B90-C-00255 | B-SD-UPS-2M1 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B0FC-P-00014 | B-AH-13018 | GROUPING TAG FOR FUEL GAS TO TCC/COCO | (2M)WUPIDE N2, CO2, REL DENSITY | PM | 4/3/2024 | | 20240303 | B90-C-00251 | B-SD-UPS-2M2 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/3/2024 | |
| 20240304 | B38-S-00002 | B-MOTOR-EP-PA-003 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING | PM | 4/3/2024 | Motor | 20240303 | B650-C-00040 | B-SPEAKER-ES-001 | GROUPING TAG FOR SPEAKER(HORNS FOLLOW TA | (3M)INTERCOMPE FUNCTION TEST | PM | 3/3/2024 | |
| 20240304 | B10-C-00028 | B-MR-1020 | ETHYLENE FURNACE ID FAN#10 MOTOR | (3Y) ID Fan Motor Overhaul (Group "ID") | PM | 4/3/2024 | | 20240303 | B10C-C-00040 | B-T-131 | TLIX QUENCH EXCHANGER | (3M) CONDITION CHECK (OSL 2022-191) | IM | 3/3/2024 | |
| 20240304 | B063-WK-0001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pit suction screen cleaning | PM | 4/3/2024 | Pump | 20240303 | B112-C-00059 | B-UPS-ZEE-BV | GROUPING FOR UPS 220 KVA | (1M)INSPCT & ADJUST | PM | 3/3/2024 | |
| 20240304 | B58-C-00019 | B-PCV-15164 | N2 TO Q-1515 | (3Y) INSPECTION & CALIBRATE | PM | 4/3/2024 | | 20240303 | B00-C-00055 | B-VALVE-I | VALVE PROCESS OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-194) | IM | 3/3/2024 | |
| 20240304 | B10C-C-00028 | B-R-1020 | FURNACE ID FANS | RCM(3Y)Overhaul ID Fan Bearing Group "ID" | PM | 4/3/2024 | | 20240303 | B00-C-00064 | B-VALVE-I-SCL | VALVE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-109) | IM | 3/3/2024 | |
| 20240304 | B19A-WK-0001 | B-R-300-PT-1S | CG COMP SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 4/3/2024 | | 20240302 | B063-C-00035 | B-DV-16503 | DELUGE VALVE FOR M-576A | (6M)LUBRICATION & INSPECTION | PM | 2/3/2024 | |
| 20240304 | B42B-WK-0001 | B-R-600-PT-1S | CCR SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 4/3/2024 | | 20240302 | B063-C-00035 | B-DV-16504 | DELUGE VALVE FOR M-570A, T-570DA | (6M)LUBRICATION & INSPECTION | PM | 2/3/2024 | |
| 20240304 | B43B-WK-0001 | B-R-650-PT-1S | CCR COMP SURFACE CONDENSER COND TURBINE | (2M)REGREASE & INSPECTION | PM | 4/3/2024 | | 20240302 | B46A-C-00058 | B-DV-16504 | DELUGE VALVE FOR QUENCH/RURNACE | (6M)LUBRICATION & INSPECTION | PM | 2/3/2024 | |
| 20240304 | BNA-C-00021 | B-SECUR-TASKS05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 4/3/2024 | | 20240302 | B057-C-00017 | B-G-1478A | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/3/2024 | |
| 20240304 | B-SECUR-TASK04 | B-SECUR-TASK04 | WATER INSPECTION CO2 SYSTEM MA | (1W)INSPECTION | PM | 4/3/2024 | | 20240302 | B057-C-00017 | B-G-1478B | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/3/2024 | |
| 20240304 | B13-C-00053 | B-SUTP-ERMC5 | ELECTRICAL MOTOR MONITORING & CONTROL 5 | (1M)INSPECTION | PM | 4/3/2024 | | 20240302 | B057-C-00018 | B-AH-1671 | GENSLUB NEW FIRE TRAINING AREA | (6M)LUBRICATION & INSPECTION | PM | 2/3/2024 | |
| 20240304 | B007-S-00001 | B-SWGR-SUB4 | Grouping for 6.5 KV SWGR/MCC SUB3 | (3M)INSPECT & CONDITION CHECK | PM | 4/3/2024 | | 20240302 | B057-C-00018 | B-AH-1671 | GENSLUB NEW FIRE TRAINING AREA | (6M)LUBRICATION & INSPECTION | PM | 2/3/2024 | |
| 20240304 | B008-S-00001 | B-SWGR-SUB4 | Grouping for 6.5 KV SWGR/MCC SUB 4 | (3M)INSPECT & CONDITION CHECK | PM | 4/3/2024 | | 20240302 | B063-C-00043 | B-MY-1672 | HYDRANT NEW FIRE TRAINING AREA | (6M)LUBRICATION & INSPECTION | PM | 2/3/2024 | |
| 20240303 | B53-C-00037 | B-AT-22177 | ISO14000,PH DISCHARGE LINE G-22177-P-4A/B | (1M)SET&CALIBRATE | PM | 3/3/2024 | | 20240302 | B13-S-00010 | B-MOTOR-ORP | Grouping For Motor ORP | (1M)VISUAL INSPECT | PM | 2/3/2024 | Motor |
| 20240303 | B12-C-00563 | B-AT-400001 | Li, 3 Butadiene in Air GCG | (1M)SET&CALIBRATE | PM | 3/3/2024 | | 20240302 | B06A-C-00006 | B-PIPEL-05 | LINE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2020-049) | IM | 2/3/2024 | |
| 20240303 | B12-C-00567 | B-AT-404801 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 3/3/2024 | | 20240302 | B19B-C-00031 | B-PSV-34505 | M-345 TO HOT FLARE | (3Y)SET & CALIBRATE(PSV 203) | PM | 2/3/2024 | PSV |
| 20240303 | B007-C-00003 | B-AT-9211 | ISO14000, SUMP Q-920 TO Q-1145 | (1M)SET&CALIBRATE | PM | 3/3/2024 | | 20240302 | B1-C-00024 | B-PSV-9013 | P-901C BFW INLET | (3Y)SET & CALIBRATE | PM | 2/3/2024 | PSV |
| 20240303 | B90-C-00002 | B-E-F-11 | MASTER FIRE ALARM PANEL AT NEW CCR CONTR | (1M)CO2 SYSTEM CHECK | PM | 3/3/2024 | | 20240302 | BH3-C-00030 | B-R-3101 | ETHYLENE FURNACE ID FAN#1 | (1M) Visual Inspection | PM | 2/3/2024 | |
| 20240303 | B90-C-00002 | B-E-F-12 | LOCAL FIRE ALARM PANEL AT SUB.2 | (1M)CO2 SYSTEM CHECK | PM | 3/3/2024 | | 20240302 | BH4-C-00027 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | (1M) Visual Inspection | PM | 2/3/2024 | |
| 20240303 | B90-C-00002 | B-E-F-13 | LOCAL FIRE ALARM PANEL AT SUB.PROCESS | (1M)CO2 SYSTEM CHECK | PM | 3/3/2024 | | 20240302 | BH5-C-00026 | B-R-3103 | ETHYLENE FURNACE ID FAN#3 | (1M) Visual Inspection | PM | 2/3/2024 | |
| 20240303 | B10-C-00051 | B-F-1010 | USC PYROLYSIS FURNACE | (3M) CONDITION CHECK (OSL 2022-193) | IM | 3/3/2024 | Furnace | 20240302 | BH6-C-00028 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (1M) Visual Inspection | PM | 2/3/2024 | |
| 20240303 | B10-C-00052 | B-F-1010 | USC PYROLYSIS FURNACE | (3M) CONDITION CHECK (OSL 2021-115) | IM | 3/3/2024 | Furnace | 20240302 | BH7-C-00028 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (1M) Visual Inspection | PM | 2/3/2024 | |
| 20240303 | B10B-C-00043 | B-F-120 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-062) | IM | 3/3/2024 | Furnace | 20240302 | BH8-C-00029 | B-R-3106 | ETHYLENE FURNACE ID FAN#6 | (1M) Visual Inspection | PM | 2/3/2024 | |
| 20240303 | B10G-C-00045 | B-F-170 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-192) | IM | 3/3/2024 | Furnace | 20240302 | B13-C-00042 | B-SUTP-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/3/2024 | |
| 20240303 | BNA-C-00051 | B-GC-1M | GROUPING FOR PM GC 1 Month | (1M)SET & CALIBRATION | PM | 3/3/2024 | | 20240302 | B13-C-00043 | B-SUTP-FA-FACP-001 | Firefighting Control Panel at CO2 cylind | (1M)VISUAL INSPECTION | PM | 2/3/2024 | |
| 20240303 | B48-C-00020 | B-IRP-BV | IRP GROUPING FOR BV | (1M)INSPECTION | PM | 3/3/2024 | | 20240301 | B013-C-00013 | B-A-210 | QUENCH OIL TOWER | (3M) CONDITION CHECK (OSL 2022-201) | IM | 1/3/2024 | |
| 20240303 | B09P-C-00064 | B-M-19020 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1M)MUAPIDE N2, CO2, REL DENSITY | PM | 3/3/2024 | | 20240301 | BH35-C-00001 | B-AT-331001 | MOISTURE ANALYZER TRANSMITTER FOR M-3310 | (2M)SET & CALIBRATE | PM | 1/3/2024 | |
| 20240303 | B01S-C-00029 | B-M-310 | CG 1ST STAGE SUCTION DRUM | (3M) CONDITION CHECK (OSL 2022-190) | IM | 3/3/2024 | | 20240301 | BH35-C-00001 | B-AT-331002 | MOISTURE ANALYZER TRANSMITTER FOR M-3310 | (2M)SET & CALIBRATE | PM | 1/3/2024 | |
| 20240303 | B09O-C-00009 | B-MCC-SUB1 | MCC FOR PLUG- IN MCCB | (2M)Thermoscan & Inspection | IM | 3/3/2024 | | 20240301 | B097-C-00015 | B-AT-331003 | MOISTURE ANALYZER TRANSMITTER FOR M-3301 | (2M)SET & CALIBRATE | PM | 1/3/2024 | |
| 20240303 | B000-C-00028 | B-MCC-TANK | MCC FOR PLUG-IN MCCB | (2M)Thermoscan & Inspection | IM | 3/3/2024 | | 20240301 | BH11-S-00003 | B-CAUTICP4/2 | Grouping Tag for Cautic Pump 1-4/2 | (1M)CLEAN | PM | 1/3/2024 | |
| 20240303 | B000-C-00002 | B-MCC-WASTE | MCC FOR PLUG-IN MCCB | (2M)Thermoscan & Inspection | IM | 3/3/2024 | | 20240301 | B00-C-00075 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1M) Function and Record test | PM | 1/3/2024 | |
| 20240303 | B90-C-00177 | B-MOTOR-B1-1237BC | MOTOR GROUPING FOR B1-BC | (1M)CLEANING & INSPECTION | PM | 3/3/2024 | Motor | 20240301 | B00-C-00076 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1Y) Inspection | PM | 1/3/2024 | |
| 20240303 | B90-C-00180 | B-MOTOR-B1-7A | MOTOR GROUPING FOR B1-7A | (1M)CLEANING AND INSPECTION | PM | 3/3/2024 | Motor | 20240301 | B00-C-00078 | B-CCTV-PS | GROUPING TAG FOR FIRE STATION | (1M) Function and Record test | PM | 1/3/2024 | |
| 20240303 | B90-C-00174 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BE-0A | (1M)CLEANING AND INSPECTION | PM | 3/3/2024 | Motor | 20240301 | B00-C-00079 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/3/2024 | |
| 20240303 | B90-C-00175 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BE-0A | (1M)CLEANING AND INSPECTION | PM | 3/3/2024 | Motor | 20240301 | B00-C-00078 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/3/2024 | |
| 20240303 | B90-C-00193 | B-MOTOR-BE-0BC | MOTOR GROUPING FOR BE-0BC | (1M)CLEANING AND INSPECTION | PM | 3/3/2024 | Motor | 20240301 | B00-C-00079 | B-CCTV-PS | GROUPING TAG FOR WARE HOUSE | (1M) Function and Record test | PM | 1/3/2024 | |

| | | | | | | | |
|----------|---------------|--------------------|---|--|----|-----------|------------|
| 20240215 | 8528-C-00062 | B-R-12040 | COOLING WATER FAN D | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/2/2024 | |
| 20240215 | 8528-C-00061 | B-R-12040 | COOLING WATER FAN E | (2M)Cooling Gearbox & Fan Visual Inspect | PM | 15/2/2024 | |
| 20240215 | 8147-C-00002 | B-R-31215 | DILUTION AIR FAN | (1V) BTL INSPECTION & CLEAN AIR FILTER | PM | 15/2/2024 | |
| 20240215 | 8018-C-00004 | B-R-30278 | Quench Water Air Cooler Fan | RCM-(1V) FIN FAN INSPECTION | PM | 15/2/2024 | |
| 20240215 | 820-C-00003 | B-SECUR-TASK03A | FOR PH: CHECK A FOAM TRUCK NO1 (MUNGDATE) | (1D)INSPECTION | PM | 15/2/2024 | |
| 20240215 | 820-C-00003 | B-SECUR-TASK03C | FOR PH: CHECK A WATER TRUCK(SAYVARN) | (1D)INSPECTION | PM | 15/2/2024 | |
| 20240215 | 820-C-00003 | B-SECUR-TASK03E | FOR PH: CHECK AMBULANCE(JITIRUKSA) | (1D)INSPECTION | PM | 15/2/2024 | |
| 20240215 | 820-C-00003 | B-SECUR-TASK03F | FOR PH: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 15/2/2024 | |
| 20240215 | 820-C-00004 | B-SECUR-TASK06 | FOR PH: TEST FIRE TRUCK | (2M)INSPECTION | PM | 15/2/2024 | |
| 20240215 | 8262-C-00002 | B-V-3901-P15 | NEUTRALIZING AMINE INJECTION PUMP FOR D. | (1V)UBRICATION | PM | 15/2/2024 | |
| 20240215 | 812-C-00716 | B-WALVES-CWR | VALVE COOLING WATER RETURN OLE 2-3 | (1M)INSPECT GEAR OF BTF VALVE CWR T-4045 | PM | 15/2/2024 | |
| 20240214 | 812-C-00022 | B-AT-10103 | ISO14000,CEMS SOX/NOVCO F-1010 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/2/2024 | |
| 20240214 | 812-C-00024 | B-AT-10203 | ISO14000,CEMS SOX/NOVCO F-1020 FUEL GAS | (1M)SET & CALIBRATION | PM | 14/2/2024 | |
| 20240214 | 80FL-C-00028 | B-AT-10031-3 | GROUPING TAGS CEMS AT-1103/1203/1303 | (1M)SET & CALIBRATION | PM | 14/2/2024 | |
| 20240214 | 80FL-C-00028 | B-AT-10034-6 | GROUPING TAGS CEMS AT-1403/1503/1603 | (1M)SET & CALIBRATION | PM | 14/2/2024 | |
| 20240214 | 80FL-C-00028 | B-AT-10037-9 | GROUPING TAGS CEMS AT-1703/1803/1903 | (1M)SET&CALIBRATION | PM | 14/2/2024 | |
| 20240214 | 83A-C-00018 | B-AT-2411A | ISO14000,CEMS SOX,NOX,CO ANALYZER S-2401 | (1M)SET & CALIBRATE CEMS(B-2401) | PM | 14/2/2024 | |
| 20240214 | 83A-C-00013 | B-B-2401 | STEAM GENERATOR | (3M)UBRICATION B-2401 | PM | 14/2/2024 | |
| 20240214 | 890-C-00227 | B-CO2-SUB1-1 | CO2 FIRE SYSTEM CONTROL PANEL(SWGR) SUB1 | (1M)INSPECTION | PM | 14/2/2024 | |
| 20240214 | 890-C-00227 | B-CO2-SUB1-2 | CO2 FIRE SYSTEM CONTROL PANEL(BATT) SUB1 | (1M)INSPECTION | PM | 14/2/2024 | |
| 20240214 | 862-S-00015 | B-C-1141-V-1 | FILTER PRESS | (3M)UBRICATION CHAIN | PM | 14/2/2024 | |
| 20240214 | 862-S-00015 | B-C-1201 | COOLING TOWER BASIN | (3M) CONDITION CHECK (OSL 2021-061) | PM | 14/2/2024 | |
| 20240214 | 83A-C-00012 | B-R-2401 | FD FAN | (1M)CHECK LUBRICATING OIL | PM | 14/2/2024 | |
| 20240214 | 83A-C-00014 | B-SECUR-TASK22 | FOR PH: INSPECTION FIRE PROTECTIVE CLDT | (1M)INSPECTION | PM | 14/2/2024 | |
| 20240213 | 81H3-C-00016 | B-AT-310105 | CO2 ANALYZER TRANSMITTER FOR F-3101/3102 | (1M)SET & CALIBRATION | PM | 13/2/2024 | |
| 20240213 | 80P2-C-00028 | B-AT-312001/1-5 | GROUPING TAG OF NOX ANALYZER (SCR) 1-4-2 | (1M) ISO-9001 SET&CALIBRATION | PM | 13/2/2024 | |
| 20240213 | 80P5-C-00003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING & INSPECTION. | PM | 13/2/2024 | Motor |
| 20240213 | 838-S-00004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING AND INSPECTION. | PM | 13/2/2024 | Motor |
| 20240213 | 890-S-00005 | B-PH-32015 | QUENCH WATER PUMP MOTOR | (1M)CLEANING AND INSPECTION. | PM | 13/2/2024 | Motor |
| 20240213 | 812-C-00025 | B-R-4000 | RIPTURE DISC | (1M)INSPECTION RIBTURE DISC | PM | 13/2/2024 | |
| 20240213 | 819A-C-00062 | B-R-300HP | CRACKED GAS COMPRESSOR HP CASING | (1M)INSPECT WRAPPED DRAIN FLANGE | PM | 13/2/2024 | Compressor |
| 20240213 | 83A-C-00013 | B-SECUR-TASK21 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/2/2024 | |
| 20240213 | 838-C-00004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/2/2024 | |
| 20240213 | 812-C-00356 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/2/2024 | |
| 20240213 | 812-C-00354 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/2/2024 | |
| 20240213 | 812-C-00357 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/2/2024 | |
| 20240212 | 80P5-S-00004 | B-CAP-MS | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP,NOISE AND VIB | PM | 12/2/2024 | |
| 20240212 | 8108-C-00042 | B-T-120 | USC FURNACES | (3M) CONDITION CHECK (OSL 2020-061) | PM | 12/2/2024 | Furnace |
| 20240212 | 8108-C-00035 | B-T-140 | USC FURNACES | (3M) CONDITION CHECK (OSL 2020-060) | PM | 12/2/2024 | Furnace |
| 20240212 | 800-C-00057 | B-NONE-OLEFINS-P1 | Equipment Non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2020-057) | PM | 12/2/2024 | |
| 20240212 | 852A-C-00024 | B-P-1201C | COOLING WATER PUMP | (3M) CONDITION CHECK (OSL 2020-059) | PM | 12/2/2024 | Pump |
| 20240212 | 8028-WK-00001 | B-P-1601A | FIRE MAIN PUMP | (1W)Weekly-Pt suction screen cleaning | PM | 12/2/2024 | Pump |
| 20240212 | 800-C-00060 | B-PIPE1-SCL | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-067) | PM | 12/2/2024 | |
| 20240212 | 830A-S-00002 | B-R-575A-PT-1A | MAIN LUBE OIL PUMP TURBINE | (1M)INSPECTION & CLEAN | PM | 12/2/2024 | |
| 20240212 | 81A-C-00021 | B-SECUR-TASK05 | FOR PH: TEST FIRE PUMP | (1W)INSPECTION | PM | 12/2/2024 | |
| 20240212 | 81A-C-00012 | B-SECUR-TASK20 | FOR PH: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/2/2024 | |
| 20240212 | 81A-C-00012 | B-SECUR-TASK45 | FOR PH: INSPECTION AND CHECK MOBILE GENE | (1M)INSPECTION | PM | 12/2/2024 | |
| 20240212 | 809A-C-00001 | B-T-308 | OLEFINS PLANT | (3M) CONDITION CHECK (OSL 2021-068) | PM | 12/2/2024 | |
| 20240212 | 809-C-00001 | B-T-061 | UNGLUARU FEED QO, HEATER | (3M) CONDITION CHECK (OSL 2020-056) | PM | 12/2/2024 | |
| 20240212 | 8C26-C-00014 | B-XFMR-2E1 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW MAI | (4Y)RCM Transformer Oil Analysis | PM | 12/2/2024 | |

| | | | | | | | |
|----------|--------------|------------------|--|---|----|-----------|---------|
| 20240212 | 8C26-C-00014 | B-XFMR-2E2 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW MAI | (4Y)RCM Transformer Oil Analysis | PM | 12/2/2024 | |
| 20240212 | 8C26-C-00014 | B-XFMR-2E3 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (4Y)RCM Transformer Oil Analysis | PM | 12/2/2024 | |
| 20240212 | 8C26-C-00014 | B-XFMR-2E4 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (4Y)RCM Transformer Oil Analysis | PM | 12/2/2024 | |
| 20240212 | 8C26-C-00014 | B-XFMR-2E5 | POWER TRANSFORMER 6.6/0.4 KV | (4Y)RCM Transformer Oil Analysis | PM | 12/2/2024 | |
| 20240211 | 8021-C-00004 | B-AT-3600C | CG DEHYDRATORS BEDS | (1M)MOISTURE ANALYZER AMETEX | PM | 11/2/2024 | |
| 20240211 | 810D-C-00037 | B-F-1-40 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-133) | PM | 11/2/2024 | Furnace |
| 20240211 | 8060-C-00042 | B-G-1122-Q-5 | WWY CHEMICAL SEWER SUMP PIT | (3M) CONDITION CHECK (OSL 2022-044) | PM | 11/2/2024 | |
| 20240211 | 8016-C-00024 | B-P-220A | QUENCH WATER CIRCULATION PUMP | (3M) CONDITION CHECK (OSL 2022-135) | PM | 11/2/2024 | Pump |
| 20240211 | 8001-C-00034 | B-P-301C | SHF BPW PUMPS | (3M) CONDITION CHECK (OSL 2022-042) | PM | 11/2/2024 | Pump |
| 20240211 | 8018-C-00001 | B-PH-1570A | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (3M)UBRICATION | PM | 11/2/2024 | Motor |
| 20240211 | 8018-C-00001 | B-PH-1570B | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (3M)UBRICATION | PM | 11/2/2024 | Motor |
| 20240211 | 8018-C-00003 | B-PH-1570S | LIGHT NAPHTHA SUPPLY PUMP MOTOR | (3M)UBRICATION | PM | 11/2/2024 | Motor |
| 20240211 | 8061-C-00014 | B-Q-1135 | EQUALIZATION TANK | (3M) CONDITION CHECK (OSL 2020-039) | PM | 11/2/2024 | |
| 20240211 | 815A-C-00060 | B-R-300-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (3M) CONDITION CHECK (OSL 2022-066) | PM | 11/2/2024 | |
| 20240211 | 8027-C-00008 | B-T-390A | LP DEPROPANIZER REBOILERS | (3M) CONDITION CHECK (OSL 2022-043) | PM | 11/2/2024 | |
| 20240211 | 838-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/2/2024 | |
| 20240211 | 890-C-00236 | B-XFMR-2C1 | POWER TRANSFORMER 6.6/0.4 KV | (4Y)RCM Transformer Oil Analysis | PM | 11/2/2024 | |
| 20240211 | 890-C-00236 | B-XFMR-2C2 | POWER TRANSFORMER 6.6/0.4 KV | (4Y)RCM Transformer Oil Analysis | PM | 11/2/2024 | |
| 20240211 | 890-C-00236 | B-XFMR-2C3 | POWER TRANSFORMER 6.6/3 KV | (4Y)RCM Transformer Oil Analysis | PM | 11/2/2024 | |
| 20240210 | 812-C-00670 | B-AT-430303 | BUTENE-1 CGC | (1M)SET&CALIBRATE | PM | 10/2/2024 | |
| 20240210 | 813-S-00013 | B-BU-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 813-S-00014 | B-BU-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 813-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 813-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00052 | B-BU-9C-110 | BATTERY UNIT FOR 110VDC SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00053 | B-BU-9C-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00056 | B-BU-9C-214 | BATTERY UNIT FOR 24VDC SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00054 | B-BU-9C-110 | BATTERY UNIT FOR 110VDC SUB.2 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00055 | B-BU-9C-110 | BATTERY UNIT FOR 110VDC SUB.PROCESS | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-C-00031 | B-BU-19010 | GROUPING TAG FOR 110VDC SUB.5 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00058 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC SUB.5 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00062 | B-BU-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00060 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 890-S-00061 | B-BU-UPS-2 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (3M)INSPECTION AND RECORD | PM | 10/2/2024 | |
| 20240210 | 800-C-00002 | B-G-1167 | DAF | (3M)UBRICATION & CHANGE LUBE OIL | PM | 10/2/2024 | |
| 20240210 | 80P7-C-00001 | B-G-3100 | ELEVATOR | (1M)INSPECTION & FUNCTION TEST | PM | 10/2/2024 | |
| 20240210 | 890-S-00027 | B-HYDRAULIC-01 | HYDRAULIC STATIC PRESS 30 T | (1M)UBRICATION & INSPECTION | PM | 10/2/2024 | |
| 20240210 | 80P5-C-00002 | B-MOTOR-EO-003 | GROUPING TAG FOR MIXED C4 (EAST B/L) | (4M)PROVE LIQ TURBINE METER(OUT-SOURCE) | PM | 10/2/2024 | Motor |
| 20240210 | 80P5-C-00002 | B-MOTOR-EO-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 10/2/2024 | |
| 20240210 | 890-C-00168 | B-O5G15 | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/2/2024 | |
| 20240210 | 861-C-00122 | B-P-11525 | FINAL FILTER BACKWASH SUMP PUMP | (3M)REGREASE | PM | 10/2/2024 | Pump |
| 20240210 | 863-S-00013 | B-P-1601C | ENGINE DRIVEN FIRE PUMP | RCM(1Y)GEARBOX LUBRICATION | PM | 10/2/2024 | Pump |
| 20240210 | 829-C-00031 | B-P-541A | PROPYLENE PRODUCT PUMP | (3Y)CLEANING | PM | 10/2/2024 | Pump |
| 20240210 | 863-S-00016 | B-PE-1601C | FIRE MAIN PUMP ENGINE | RCM(12Y)OVERHAUL | PM | 10/2/2024 | |
| 20240210 | 819B-C-00019 | B-PSV-3002A | R-300 TO HOT FLARE | (3Y)SET & CALIBRATE (PSV 4x8) | PM | 10/2/2024 | PSV |
| 20240210 | 844-C-00021 | B-PSV-4742S | T-474 TO COLD FLARE | (3Y)SET & CALIBRATE (PSV 1 /2X2) | PM | 10/2/2024 | PSV |
| 20240210 | 805A-C-00010 | B-SECUR-TASK18 | FOR PH: INSPECTION FIRE ALARM STATION | (1M)INSPECTION | PM | 10/2/2024 | |
| 20240210 | 820-C-00002 | B-SECUR-TASK43 | VISUAL INSPECTION MOBILE FOAM U | (1M)INSPECTION | PM | 10/2/2024 | |
| 20240210 | 860-C-00038 | B-SPEAKER-ES-003 | GROUPING TAG FOR SPEAKER/HORNS FOLLOW TA | (3M)FUNCTION TEST & EXERCISE | PM | 10/2/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|--|----|-----------|---------|
| 20240210 | 890-C-00114 | B-SWGR-EO-AD | Grouping Tag for 6.6KV SWGR Sub#5 | (3M) INSPECT & ADJUST | PM | 10/2/2024 | |
| 20240210 | 838-C-00071 | B-UPS-004 | GROUPING FOR UPS 125 KVA | (3M)SPECIFIC GRAVITY TEST | PM | 10/2/2024 | |
| 20240210 | 811X-C-00001 | B-XV-330101 | SH STM TO R3301-PT-01A | RCA (1M) CLEAN&INSPECTION | PM | 10/2/2024 | |
| 20240209 | 8081-C-00001 | B-AT-1100/1900 | PGC EFFLUENT FROM F-110F-190 | (1M)SET & CALIBRATION | PM | 9/2/2024 | |
| 20240209 | 844F-C-00001 | B-AT-19060A | ETHANOL FEED | (2M)SET & CALIBRATION (OUT-SOURCE) | PM | 9/2/2024 | |
| 20240209 | 80P7-C-00086 | B-AT-3100D1A1-3 | GROUPING TAG CEMS F-3101 to F-3103 | (1M)SET&CALIBRATION | PM | 9/2/2024 | |
| 20240209 | 80P7-C-00086 | B-AT-3100D1B1-4-6 | GROUPING TAG CEMS F-3104 to F-3106 | (1M)SET&CALIBRATION | PM | 9/2/2024 | |
| 20240209 | 860-S-00001 | B-G-1122-P-1A | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/2/2024 | |
| 20240209 | 860-S-00002 | B-G-1122-P-15 | HIGH PRESSURE FEED PUMP | (1M)INSPECT & LUBRICATE | PM | 9/2/2024 | |
| 20240209 | 8061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 9/2/2024 | |
| 20240209 | 8061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 9/2/2024 | |
| 20240209 | 8061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 9/2/2024 | |
| 20240209 | 812-C-00056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 9/2/2024 | |
| 20240209 | 890-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 9/2/2024 | |
| 20240209 | 890-C-00075 | B-GS-344 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 9/2/2024 | |
| 20240209 | 80P6-C-00048 | B-M-19010 | GROUPING TAG FOR MIXED C4 (EAST B/L) | (4M)CALIB. FOR M-19010 MIXED C4 TO B5T. | PM | 9/2/2024 | |
| 20240209 | 8061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 9/2/2024 | Pump |
| 20240209 | 8061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 9/2/2024 | Pump |
| 20240209 | 8061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 9/2/2024 | Pump |
| 20240209 | 8061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 9/2/2024 | Pump |
| 20240209 | 8159-S-00018 | B-PSV-5702S | M-19010 TO HOT FARE | CVSET & CALIBRATE (PSV 405) | PM | 9/2/2024 | PSV |
| 20240209 | 840-C-00011 | B-PSV-4400S | A-440 TO COLD FLARE | CVSET & CALIBRATE (PSV 405) | PM | 9/2/2024 | PSV |
| 20240209 | 829A-C-00022 | B-PSV-5702A | A-570 to Hot flare | BOWTIE-(4Y)-OVERHAUL & INSPECTION | PM | 9/2/2024 | PSV |
| 20240209 | 829A-C-00023 | B-PSV-5702B | A-570 to Hot flare | BOWTIE-(4Y)-OVERHAUL & INSPECTION | PM | 9/2/2024 | PSV |
| 20240209 | 829A-C-00024 | B-PSV-5702C | A-570 to Hot flare | BOWTIE-(4Y)-OVERHAUL & INSPECTION | PM | 9/2/2024 | PSV |
| 20240209 | 89A-C-00009 | B-SECUR-TASK17 | INSPECTION FOAM STORAGE TANK, FOA | (1M)INSPECTION | PM | 9/2/2024 | |
| 20240208 | 8016-C-00019 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSI, 2021-078) | IM | 8/2/2024 | |
| 20240208 | 823A-C-00014 | B-AT-19001 | FUEL GAS CUSTODY INLET | (7W)CALIBRATION | PM | 8/2/2024 | |
| 20240208 | 860-C-00048 | B-G-1112-P-1S | HIGH PRESSURE FEED PUMPS | (1M)CLEAN STRAINER&INSPECTION | PM | 8/2/2024 | |
| 20240208 | 8060-C-00086 | B-G-1112-P-2S | SPENT CAUSTIC NEUTRALIZATION PUMPS | RCM-(1Y) COUPLING INSPECTION | IM | 8/2/2024 | |
| 20240208 | 8060-C-00096 | B-G-1112-P-2S | SPENT CAUSTIC NEUTRALIZATION PUMPS | (1Y)LUBRICATE | PM | 8/2/2024 | |
| 20240208 | 844F-C-00001 | B-AT-19060A | ETHANOL FEED | RCM-(1M) MONTHLY & INSPECTION | PM | 8/2/2024 | Flare |
| 20240208 | 8040-C-00011 | B-SWGR-EO-2H1 | GROUPING TAG FOR MCC SUBSTATION#3 | RCM-(1M) Term preservation | PM | 8/2/2024 | |
| 20240208 | 812-C-00082 | B-P-4033S | DEGASSER BOTTOMS PUMP | (3M)INSPECT & ADJUST | PM | 8/2/2024 | |
| 20240208 | 810-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (MUNGDATE) | (1Y) CHECK & CLEAN MECHANICAL SEAL COOLE | PM | 8/2/2024 | Pump |
| 20240208 | 820-C-00003 | B-SECUR-TASK03B | FOR PM: CHECK A WATER TRUCK(SAYVARN) | (1D)INSPECTION | PM | 8/2/2024 | |
| 20240208 | 820-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBLANCE(JITRUSKA) | (1D)INSPECTION | PM | 8/2/2024 | |
| 20240208 | 820-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 8/2/2024 | |
| 20240208 | 813-C-00044 | B-UPS-2N1-A1 | 220 VAC UPS1 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/2/2024 | |
| 20240208 | 813-C-00045 | B-UPS-2N1-A2 | 220 VAC UPS2 PANEL(BYPASS) | (1M)INSPECT&CONDITION CHECK | PM | 8/2/2024 | |
| 20240208 | 813-C-00046 | B-UPS-2N1-A3 | 220 VAC UPS2 PANEL | (1M)INSPECT&CONDITION CHECK | PM | 8/2/2024 | |
| 20240208 | 812S-00040 | B-V-4799 | OIL MIST SYSTEM | (1M) MONTHLY & INSPECTION | PM | 8/2/2024 | |
| 20240207 | 80P7-C-00080 | B-ANALYZER-02142 | ANALYZER GROUPING FOR OXYGEN ANALYZER PLANT#1/2 | CVSET & CALIBRATE | PM | 7/2/2024 | |
| 20240207 | 80A-C-00012 | B-CRIT-EO-COLD-P1 | Critical Equipment Cold Area Phase 1 | (1M)Visual & Condition Inspection | PM | 7/2/2024 | |
| 20240207 | 838-C-00113 | B-CRITICAL-EO-HOT | GROUPING TAG FOR RM, SECL PLANT#1 | (1M)Visual & Condition Inspection | PM | 7/2/2024 | |
| 20240207 | 80H3-C-00003 | B-F-3101 | ETHYLENE FURNACE # 1 | (6M)LUBRICATE ROLLER BEARING | PM | 7/2/2024 | Furnace |
| 20240207 | 80H4-C-00004 | B-F-3102 | ETHYLENE FURNACE # 2 | (6M)LUBRICATE ROLLER BEARING | PM | 7/2/2024 | Furnace |
| 20240207 | 80H5-C-00004 | B-F-3103 | ETHYLENE FURNACE # 3 | (6M)LUBRICATE ROLLER BEARING | PM | 7/2/2024 | Furnace |
| 20240207 | 80H6-C-00004 | B-F-3104 | ETHYLENE FURNACE # 4 | (6M)LUBRICATE ROLLER BEARING | PM | 7/2/2024 | Furnace |
| 20240207 | 80H7-C-00004 | B-F-3105 | ETHYLENE FURNACE # 5 | (6M)LUBRICATE ROLLER BEARING | PM | 7/2/2024 | Furnace |

| | | | | | | | |
|----------|--------------|--------------------|--|---|----|----------|--|
| 20240205 | 8100-S-00001 | B-R-140 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/2/2024 | |
| 20240205 | 8100-S-00001 | B-R-150 | FURNACE ID FAN | B-MOTOR-INSPECT & LUBRICATE | PM | 5/2/2024 | |
| 20240205 | 8100-S-00001 | B-R-160 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/2/2024 | |
| 20240205 | 819A-WX-0001 | B-R-600-PT-15 | CG COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 5/2/2024 | |
| 20240205 | 843C-C-00008 | B-R-600-PT-4A | LUBE OIL PURIFIER | RCM-(1M)VISUAL INSPECTION | PM | 5/2/2024 | |
| 20240205 | 8428-WX-0001 | B-R-600-PT-15 | CIR SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 5/2/2024 | |
| 20240205 | 8438-WX-0001 | B-R-600-PT-15 | CIR COMP SURFACE CONDENSER COND TURBINE | (2W)REGREASE & INSPECTION | PM | 5/2/2024 | |
| 20240205 | 8NA-C-00021 | B-SECUR-TASK05 | FOR PM: TEST FIRE PUMP | (1W)INSPECTION | PM | 5/2/2024 | |
| 20240205 | 890-C-00094 | B-UPSI-A1 | UPS1 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/2/2024 | |
| 20240205 | 890-C-00094 | B-UPSI-A2 | UPS2 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/2/2024 | |
| 20240205 | 890-C-00096 | B-UPSI-A3 | UPS3 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/2/2024 | |
| 20240204 | 810K-C-00025 | B-AT-10103 | ISO14000,CEMS SOX/NOX/CO F-1010 FUEL GAS | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 810K-C-00029 | B-AT-10203 | ISO14000,CEMS SOX/NOX/CO F-1020 FUEL GAS | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 810K-C-00029 | B-AT-10303/1-3 | GROUPING TAGS CEMS AT-1103/1203/1303 | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 810K-C-00029 | B-AT-10304/4-6 | GROUPING TAGS CEMS AT-1403/1503/1603 | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 80P1-C-00030 | B-AT-10307/7-9 | GROUPING TAGS CEMS AT-1703/1803/1903 | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 83A-C-00027 | B-AT-2411A | ISO14000,CEMS SOX/NOX/CO ANALYZER S-2401 | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 80P7-C-00113 | B-AT-310X01A/1-3 | GROUPING TAG CEMS F-3101 to F-3103 | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 80P7-C-00114 | B-AT-310X01B/4-6 | GROUPING TAG CEMS F-3104 to F-3106 | (1V) CD Test | PM | 4/2/2024 | |
| 20240204 | 813-C-00053 | B-CAP-1M1 | POWER CAPACITOR PANEL-1 | (1M)VISUAL INSPECTION | PM | 4/2/2024 | |
| 20240204 | 813-C-00054 | B-CAP-1M2 | POWER CAPACITOR PANEL-2 | (1M)VISUAL INSPECTION | PM | 4/2/2024 | |
| 20240204 | 813-C-00057 | B-EHT-001 | ELECTRICAL HEAT TRACING CONTROL PANEL | (1M)VISUAL INSPECTION | PM | 4/2/2024 | |
| 20240204 | 8061-S-00011 | B-G-1144-A-2B | FINAL CLARIFIER AGITATOR | RCM-(3M)INSPECTION | IM | 4/2/2024 | |
| 20240204 | 861-C-00190 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (3M) CONDITION CHECK (OSL 2021-075) | PM | 4/2/2024 | |
| 20240204 | 810L-C-00047 | B-HV-10206 | F-1020 EFFLUENT TO A-210 | (6M)LUBRICAT AND INSPECT Z3 VALVE Group | PM | 4/2/2024 | |
| 20240204 | 810L-C-00047 | B-HV-10206A | F-1020 DECORKING VALVE | (6M)LUBRICAT AND INSPECT Z3 VALVE Group | PM | 4/2/2024 | |
| 20240204 | 809S-S-00001 | B-MCC-6A6Y-SUB1 | Grouping For 6.6 kV MCC SUB 1 | (3M)INSPECT & CONDITION CHECK | PM | 4/2/2024 | |
| 20240204 | 838-S-00001 | B-MOTOR-EP-NPA-003 | GROUPING TAG FOR MOTOR NPA AREA | (1M)CLEANING | PM | 4/2/2024 | |
| 20240204 | 890-C-00096 | B-SECUR-TASK04 | VISION INSPECTION CO2 SYSTEM NA | (1M)INSPECTION | PM | 4/2/2024 | |
| 20240204 | 813-C-00054 | B-SWGR-SUB1 | ELECTRICAL REMOTE MONITORING & CONTROL S | (1M)VISUAL INSPECTION | PM | 4/2/2024 | |
| 20240204 | 809S-S-00002 | B-SWGR-SUB1 | Grouping For 6.6 kV SWGR SUB 1 | (3M)INSPECT & CONDITION CHECK | PM | 4/2/2024 | |
| 20240203 | 853-C-00037 | B-AT-22177 | ISO14000,PH DISCHARGE LINE G-22177-P-4A/IB | (1M)SET&CALIBRATE | PM | 3/2/2024 | |
| 20240203 | 80P7-C-00032 | B-AT-320201 | 1-4 ANALYZER TRANSMITTER FOR V-3202 OUTL | (3M)SET & CALIBRATE | PM | 3/2/2024 | |
| 20240203 | 8111-C-00014 | B-AT-330104 | NAOH ANALYZER TRANSMITTER FOR A-3301 BTM | (3M)SET & CALIBRATE | PM | 3/2/2024 | |
| 20240203 | 813-C-00063 | B-AT-400001 | 1, 3 Butadiene In Air GCG | (1M)SET&CALIBRATE | PM | 3/2/2024 | |
| 20240203 | 813-C-00067 | B-AT-404001 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 3/2/2024 | |
| 20240203 | 80P7-C-00033 | B-AT-5211 | ISO14000, SUPH Q-320 TO Q-1145 | (1M)SET&CALIBRATE | PM | 3/2/2024 | |
| 20240203 | 812-C-00073 | B-DX2-P2 | 80C HONEYWELL C300 EXPIRATION | (2M)REMOVE HISTORY FILE | PM | 3/2/2024 | |
| 20240203 | 890-C-00002 | B-E-F-11 | MASTER FIRE ALARM PANEL AT NEW CCB CONTR | (1M)CO2 SYSTEM CHECK | PM | 3/2/2024 | |
| 20240203 | 890-C-00002 | B-E-F-12 | LOCAL FIRE ALARM PANEL AT SUB.2 | (1M)CO2 SYSTEM CHECK | PM | 3/2/2024 | |
| 20240203 | 890-C-00002 | B-E-F-13 | LOCAL FIRE ALARM PANEL AT SUB.3 | (1M)CO2 SYSTEM CHECK | PM | 3/2/2024 | |
| 20240203 | 861-S-00120 | B-G-1168 | NEW SLUDGE DEWATERING UNIT (DECANTER) | (6M)REGREASS & CHANGE BELT | PM | 3/2/2024 | |
| 20240203 | 8NA-C-00051 | B-GC-1M | GROUPING FOR PM GC-1 Month | (1M)SET & CALIBRATION | PM | 3/2/2024 | |
| 20240203 | 848-C-00020 | B-IRP-BV | IRP GROUPING FOR BV | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 809K-C-00064 | B-H-19020 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1M)UPDATE N2, CO2, REL. DENSITY | PM | 3/2/2024 | |
| 20240203 | 890-C-00096 | B-MCC-6A6Y-SUB3 | GROUPING TAG FOR MCC SUBSTATION#3 | (3M)INSPECT & CONDITION CHECK | PM | 3/2/2024 | |
| 20240203 | 890-C-00178 | B-MOTOR-B1-12379C | MOTOR GROUPING FOR B1-BC | (1M)CLEANING & INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00177 | B-MOTOR-B1-12379C | MOTOR GROUPING FOR B1-BC | (1M)CLEANING & INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00180 | B-MOTOR-B1-7A | MOTOR GROUPING FOR B1-A | (1M)CLEANING AND INSPECTION. | PM | 3/2/2024 | |
| 20240203 | 890-C-00181 | B-MOTOR-B1-7A | MOTOR GROUPING FOR B1-A | (3M)LUBRICATION | PM | 3/2/2024 | |

| | | | | | | | |
|----------|--------------|------------------|--|--|----|----------|-------|
| 20240203 | 890-C-00174 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BEU-A | (1M)CLEANING & INSPECTION | PM | 3/2/2024 | Motor |
| 20240203 | 890-C-00184 | B-MOTOR-BE-0BC | MOTOR GROUPING FOR BEU-BC | (3M)LUBRICATION | PM | 3/2/2024 | Motor |
| 20240203 | 890-C-00183 | B-MOTOR-BE-0BC | MOTOR GROUPING FOR BEU-BC | (1M)CLEANING AND INSPECTION. | PM | 3/2/2024 | Motor |
| 20240203 | 809K-C-00045 | B-MOTOR-EO-010 | GROUPING FOR MOTORS CONSOLE#6 | (3M)CLEANING & INSPECTION/LUBRICATION | PM | 3/2/2024 | Motor |
| 20240203 | 890-C-00187 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-BC | (3M)LUBRICATION | PM | 3/2/2024 | Motor |
| 20240203 | 890-C-00186 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-BC | (1M)CLEANING AND INSPECTION. | PM | 3/2/2024 | Motor |
| 20240203 | 861-C-00121 | B-P-1152A | FINAL FILL BACKWASH SUMP PUMP | (3M)REGREASE | PM | 3/2/2024 | Pump |
| 20240203 | 812-C-00093 | B-P-4092A | CHILLED WATER PUMPS FOR BEU BUFFER DRUM | (6M) CHANGE LUBE OIL | PM | 3/2/2024 | Pump |
| 20240203 | 812-C-00094 | B-P-4092S | CHILLED WATER PUMPS FOR BEU BUFFER DRUM | (6M) CHANGE LUBE OIL | PM | 3/2/2024 | Pump |
| 20240203 | 812-S-00033 | B-P-1101S | SHU FEED PUMPS | (1V) CLEAN OIL COOLER, CHANGE OIL,FILTER | PM | 3/2/2024 | Pump |
| 20240203 | 812-S-00033 | B-P-4101S | SHU SET STAGE RECYCLE / PRODUCT PUMPS | (1V) CHECK & CLEAN MECHANICAL SEAL COOLE | PM | 3/2/2024 | Pump |
| 20240203 | 812-C-00097 | B-P-4103A | SHU 2ND STAGE RECYCLE / PRODUCT PUMPS | (1V) CHECK & CLEAN MECHANICAL SEAL COOLE | PM | 3/2/2024 | Pump |
| 20240203 | 820B-C-00025 | B-PSV-3431S | T-343 TO HOT FLARE | (3V)SET & CALIBRATE (PSV 1X2) | PM | 3/2/2024 | PSV |
| 20240203 | 819B-C-00030 | B-PSV-3500S | M-350 TO COLD FLARE | (3V)SET & CALIBRATE (PSV 1X2) | PM | 3/2/2024 | PSV |
| 20240203 | 847E-C-00008 | B-Q-1550 | RAW PYROLYSIS GASOLINE STORAGE TANK | (15V)INTERVAL INSPECTION | PM | 3/2/2024 | |
| 20240203 | 849-C-00013 | B-R-1109A | ISO14000,WASTE WATER VAPOR COLLEC BLOWER | (6M)LUBRICATION | PM | 3/2/2024 | |
| 20240203 | 890-C-00250 | B-SD-BC-1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.1 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00250 | B-SD-BC-2 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.2 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00251 | B-SD-BC-2M1 | DISTRIBUTION PANEL OF BC BOARD SUB.7 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00250 | B-SD-BC-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00250 | B-SD-BC-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.1 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 848-C-00015 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 8009-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.6 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 8009-C-00011 | B-SD-F2 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 8009-C-00011 | B-SD-F3 | DISTRIBUTION PANEL OF BC 24VDC SUB.6 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00251 | B-SD-UPS-2M1 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00251 | B-SD-UPS-2M2 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/2/2024 | |
| 20240203 | 890-C-00038 | B-SWGR-EO-002 | GROUPING TAG FOR SWGR SUBSTATION#3 | (3M)INSPECT & ADJUST | PM | 3/2/2024 | |
| 20240203 | 890-C-00038 | B-SWGR-EO-002 | GROUPING TAG FOR SWGR SUBSTATION#3 | (3M)INSPECT & ADJUST | PM | 3/2/2024 | |
| 20240202 | 8063-C-00044 | B-DV-1662 | DELUGE VALVE FOR T-575A, T-515 | (6M)LUBRICATION & INSPECTION | PM | 2/2/2024 | |
| 20240202 | 845A-C-00057 | B-DV-1662 | DELUGE VALVE FOR Q-1522 | (6M)LUBRICATION & INSPECTION | PM | 2/2/2024 | |
| 20240202 | 811-C-00038 | B-DV-1668 | DELUGE VALVE FOR Q-4910 | (6M)LUBRICATION & INSPECTION | PM | 2/2/2024 | |
| 20240202 | 811-C-00038 | B-DV-1668A | DELUGE VALVE FOR Q-4910 | (6M)LUBRICATION & INSPECTION | PM | 2/2/2024 | |
| 20240202 | 811-C-00038 | B-DV-1669B | DELUGE VALVE FOR Q-4910 | (6M)LUBRICATION & INSPECTION | PM | 2/2/2024 | |
| 20240202 | 863-C-00096 | B-EDV-001 | GROUPING FOR DELUGE VALVE FIRE FIGHTING | (3M)CHECK/VISUAL HEAT DETECTORS/LOCAL | PM | 2/2/2024 | |
| 20240202 | 8081-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 2/2/2024 | |
| 20240202 | 8081-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 2/2/2024 | |
| 20240202 | 8081-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 2/2/2024 | |
| 20240202 | 8057-C-00014 | B-G-1475A | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/2/2024 | |
| 20240202 | 8057-C-00014 | B-G-1475S | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/2/2024 | |
| 20240202 | 8057-C-00015 | B-G-1476A | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/2/2024 | |
| 20240202 | 8057-C-00015 | B-G-1476S | INSTRUMENT AIR DRIERS | (3M)Cleaning Auto Drain of Air Dryer | PM | 2/2/2024 | |
| 20240202 | 812-C-00056 | B-GS-2F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 2/2/2024 | |
| 20240202 | 890-C-00005 | B-GS-2E1 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 2/2/2024 | |
| 20240202 | 890-C-00075 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 2/2/2024 | |
| 20240202 | 8063-C-00042 | B-HY-1646 | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/2/2024 | |
| 20240202 | 8063-C-00042 | B-HY-1647 | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/2/2024 | |
| 20240202 | 8063-C-00042 | B-HY-1648 | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/2/2024 | |
| 20240202 | 8063-C-00042 | B-HY-1649 | HYDRANT NEW NAPHTHA TANK AREA | (6M)LUBRICATION | PM | 2/2/2024 | |
| 20240202 | 8428-C-00034 | B-LV-5005 | MP STM TO R-600-PT-15 | (3M) CONDITION CHECK (OSL 2023-284) | IM | 2/2/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|----------|---------|
| 20240202 | 811-S-00010 | B-MOTOR-ORP | Grouping For Motor ORP | (3M)LUBRICATION | PM | 2/2/2024 | Motor |
| 20240202 | 8061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 2/2/2024 | Pump |
| 20240202 | 8061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 2/2/2024 | Pump |
| 20240202 | 8061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 2/2/2024 | Pump |
| 20240202 | 8061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 2/2/2024 | Pump |
| 20240202 | 812-S-00031 | B-P-4101A | SHU FEED PUMPS | (1V) CLEAN OIL COOLER, CHANGE OIL, FILTER | PM | 2/2/2024 | Pump |
| 20240202 | 812-C-00096 | B-P-4102S | SHU 1ST STAGE RECYCLE / PRODUCT PUMPS | (1V) CHECK & CLEAN MECHANICAL SEAL COOLE | PM | 2/2/2024 | Pump |
| 20240202 | 812-C-00098 | B-P-4103S | SHU 2ND STAGE RECYCLE / PRODUCT PUMPS | (1V) CHECK & CLEAN MECHANICAL SEAL COOLE | PM | 2/2/2024 | Pump |
| 20240202 | 8001-C-00040 | B-P-901B | SHV BOILER FEED WATER PUMP | (3M) CONDITION CHECK (OSL 2023-286) | IM | 2/2/2024 | Pump |
| 20240202 | 810H-C-00040 | B-PSV-155023A | Evaporator V-1550-T-4 Safety Valve | (3V)INSPECTION & OVERHAUL, PSV | PM | 2/2/2024 | PSV |
| 20240202 | 819S-C-00017 | B-PSV-3450A | M-345 TO HOT FLARE | (3V)SET & CALIBRATE(PSV 2X3) | PM | 2/2/2024 | PSV |
| 20240202 | 819S-C-00017 | B-PSV-3451A | T-345 TO HOT FLARE | (3V)SET & CALIBRATE(PSV 2X3) | PM | 2/2/2024 | PSV |
| 20240202 | 844-C-00017 | B-PSV-4782A | T-478 TO COLD FLARE | (3V)SET & CALIBRATE (PSV 1 X 2) | PM | 2/2/2024 | PSV |
| 20240202 | 804B-C-00005 | B-Q-1555 | PYROLYSIS FUEL OIL STORAGE TANK | (3M) CONDITION CHECK (OSL 2023-385) | IM | 2/2/2024 | |
| 20240202 | 8H4-C-00020 | B-R-3101 | ETHYLENE FURNACE ID FAN#1 | (1M) Visual inspection | PM | 2/2/2024 | |
| 20240202 | 8H4-C-00027 | B-R-3102 | ETHYLENE FURNACE ID FAN#2 | (1M) Visual inspection | PM | 2/2/2024 | |
| 20240202 | 8H5-C-00025 | B-R-3103 | ETHYLENE FURNACE ID FAN#3 | (1M) Visual inspection | PM | 2/2/2024 | |
| 20240202 | 8H5-C-00028 | B-R-3104 | ETHYLENE FURNACE ID FAN#4 | (1M) Visual inspection | PM | 2/2/2024 | |
| 20240202 | 8H7-C-00028 | B-R-3105 | ETHYLENE FURNACE ID FAN#5 | (1M) Visual inspection | PM | 2/2/2024 | |
| 20240202 | 818-C-00036 | B-R-3106 | ETHYLENE FURNACE ID FAN#6 | (1M) Visual inspection | PM | 2/2/2024 | |
| 20240202 | 813-C-00042 | B-SUT-FA-FACP-001 | Fire Alarm Control Panel at CO2 cylinder | (1M)VISUAL INSPECTION | PM | 2/2/2024 | |
| 20240202 | 813-C-00043 | B-SUT-FA-FHCP-001 | Firefighting Control Panel at CO2 cylind | (1M)VISUAL INSPECTION | PM | 2/2/2024 | |
| 20240202 | 813B-C-00003 | B-T-3419 | DRYER REGENERATION HEATER | (3M) CONDITION CHECK (OSL 2023-283) | IM | 2/2/2024 | |
| 20240202 | 800-C-00040 | B-VALVE1-SCH | VALVE STEAM CONDENSATE - HP QLE 2-1 | (3M) CONDITION CHECK (OSL 2023-282) | IM | 2/2/2024 | |
| 20240202 | 8990-C-00249 | B-XFMR-2B1 | POWER TRANSFORMER 6.6/0.4 KV | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 8990-C-00249 | B-XFMR-2B2 | POWER TRANSFORMER 6.6/0.4 KV | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 8990-C-00249 | B-XFMR-2D1 | POWER TRANSFORMER 6.6/0.4 KV | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 812-C-00711 | B-XFMR-2EA | POWER TRANSFORMER 6.6/0.4 KV FOR SUB NO.5 | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 812-C-00711 | B-XFMR-2EAB | POWER TRANSFORMER 6.6/0.4 KV FOR SUB NO.5 | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 812-C-00711 | B-XFMR-2EB | POWER TRANSFORMER 6.6/0.4 KV FOR SUB NO.6 | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 812-C-00711 | B-XFMR-2EB-F1 | POWER TRANSFORMER 400/230V FOR BUS 2EB | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 812-C-00711 | B-XFMR-2EB-F2 | POWER TRANSFORMER 400/230V FOR BUS 2EB | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 8990-C-00249 | B-XFMR-2G1 | 6.6/0.4 KV, TRANSFORMER SUBSTATION# 3 | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 8990-C-00249 | B-XFMR-2H1 | 6.6/0.4 KV, TRANSFORMER SUBSTATION#3 | (4Y)-RCH Transformer Oil Analysis | IM | 2/2/2024 | |
| 20240202 | 81H1-S-00003 | B-CAU1PC1/2 | Grouping Tag for Cautic Pump 1-4/2 | (1M)CLEAN | PM | 1/2/2024 | |
| 20240201 | 800-C-00075 | B-CCTV-AD | GROUPING TAG FOR ADMIN | (1M) Function and Record test | PM | 1/2/2024 | |
| 20240201 | 800-C-00076 | B-CCTV-FS | GROUPING TAG FOR FIRE STATION | (1M) Function and Record test | PM | 1/2/2024 | |
| 20240201 | 800-C-00077 | B-CCTV-GATE | GROUPING TAG FOR GATE | (1M) Function and Record test | PM | 1/2/2024 | |
| 20240201 | 800-C-00078 | B-CCTV-PLANT | GROUPING TAG FOR PLANT | (1M) Function and Record test | PM | 1/2/2024 | |
| 20240201 | 800-C-00079 | B-CCTV-WH | GROUPING TAG FOR WARE HOUSE | (1M) Function and Record test | PM | 1/2/2024 | |
| 20240201 | 800-C-00080 | B-CCTV-WHS | GROUPING TAG FOR WORK SHOP | (1M) Function and Record test | PM | 1/2/2024 | |
| 20240201 | 80A-C-00082 | B-CUT-EQ-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2W)Visual & Condition Inspection | PM | 1/2/2024 | |
| 20240201 | 805-C-00019 | B-F-3103 | ETHYLENE FURNACE # 3 | FURNACE SULTATION INSPECTION GROUP.C | IM | 1/2/2024 | Furnace |
| 20240201 | 8H5-C-00016 | B-F-3103 | ETHYLENE FURNACE # 3 | (1Y)Inspect Cock Valve 24 tags (GROUP L) | IM | 1/2/2024 | Furnace |
| 20240201 | 8H5-C-00027 | B-F-3103 | ETHYLENE FURNACE # 2 | (1Y)INSPECTION TILKUD VALVE (GROUP U) | IM | 1/2/2024 | Furnace |
| 20240201 | 8H5-C-00029 | B-F-3103 | ETHYLENE FURNACE # 3 | (1Y)INSPECTION GROUP H | IM | 1/2/2024 | Furnace |
| 20240201 | 8007-00001 | B-FT-94010 | Flow transmitter | (3Y) Inspection & Calibration | PM | 1/2/2024 | |
| 20240201 | 8590-C-00016 | B-G-L305S-P-1 | K.O. DRUM PUMP | RCM-(1M)SHORT TERM PRESERVATION | PM | 1/2/2024 | |
| 20240201 | 8H5-C-00028 | B-HV-310313 | MOTOR OPERATED TRANSFER LINE VALVE OF F-3 | (6M)LUBRICAT AND INSPECT Z2 VALVE Group | PM | 1/2/2024 | |
| 20240201 | 8H5-C-00028 | B-HV-310314 | MOTOR OPERATED DECKING VALVE OF F-3103 | (6M)LUBRICAT AND INSPECT Z3 VALVE Group | PM | 1/2/2024 | |

| | | | | | | | |
|----------|---------------|-------------------|---|---|----|-----------|------------|
| 20240130 | 800-S-00003 | B-1034-0V-005 | Deluge Valve for OLE OLE2/1(Group 5 (DV- | (1M) Deluge Valve Visual Inspection | IM | 30/1/2024 | |
| 20240130 | 800-S-00006 | B-1034-0V-006 | Deluge Valve for OLE OLE2/1(Group 6 (DV- | (1M) Deluge Valve Visual Inspection | IM | 30/1/2024 | |
| 20240130 | 800-C-00133 | B-1034-FA-001 | All Manual Fire Alarm for OLE2/1 | (1M) Manual Fire Alarm Visual Inspect | IM | 30/1/2024 | |
| 20240130 | 800-C-00205 | B-1034-WHM-001 | Water Hydrant with Monitor for OLE2/1 | (1M) Water Hydrant Monitor Visual Inspect | IM | 30/1/2024 | |
| 20240130 | 811-C-00086 | B-1035-CO2-001 | CO2 Portable for OLE2/2 | (1M) CO2 Portable Visual Inspection | IM | 30/1/2024 | |
| 20240130 | 811-C-00087 | B-1035-OC-001 | Dry Chemical for OLE2/2 | (1M) Visual Inspection & Cartridge Weigh | IM | 30/1/2024 | |
| 20240130 | 811-C-00088 | B-1035-DV-001 | Deluge Valve for Group 1 (B-DV-1,2,3,4,5 | (1M) Deluge Valve Visual Inspection | IM | 30/1/2024 | |
| 20240130 | 811-C-00089 | B-1035-DV-002 | Deluge Valve for Group 2 (B-DV-6,7,8,9,1 | (1M) Deluge Valve Visual Inspection | IM | 30/1/2024 | |
| 20240130 | 81035-FA-001 | B-1035-FA-001 | All Manual Fire Alarm for OLE2/2 | (1M) Manual Fire Alarm Visual Inspect | IM | 30/1/2024 | |
| 20240130 | 811-S-00025 | B-1035-WHM-001 | Water Hydrant for OLE2/2 | (1M) Water Hydrant Visual Inspection | IM | 30/1/2024 | |
| 20240130 | 811-S-00026 | B-1035-WHM-001 | Water Hydrant with Monitor for OLE2/2 | (1M) Water Hydrant Monitor Visual Inspect | IM | 30/1/2024 | |
| 20240130 | 812-C-00771 | B-1036-PV-001 | Post Indicator Valve for OLE2/3 | (1M) Post Indicator Valve Visual Insp | IM | 30/1/2024 | |
| 20240130 | 812-C-00731 | B-PSE-480103 | LINE OFFSPEC T-4048 TO Q-1540 | (1Y)INSPECTION RUBTURE DISC | IM | 30/1/2024 | |
| 20240130 | 857-B-00003 | B-R-1475S | INSTRUMENT AIR COMPRESSOR | (2000Hrs)Inspection/Cleaning Air Inlet | IM | 30/1/2024 | Compressor |
| 20240130 | 942B-C-00033 | B-R-600-PT-15 | CJR SURFACE CONDENSER COND.TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/1/2024 | |
| 20240130 | 943B-C-00018 | B-R-650-PT-15 | CJR COMP SURFACE CONDENSER COND TURBINE | (3M) REPLACE SERVICE PACK (AUTO GREASE) | PM | 30/1/2024 | |
| 20240129 | 947T-C-00017 | B-PT-15531 | Min Flow P-1553A/S | (3M) CONDITION CHECK (OSL 2021-116) | IM | 29/1/2024 | |
| 20240129 | 950B-C-00018 | B-M-542 | INTERMITTENT BLOWDOWN DRUM | (3M) CONDITION CHECK (OSL 2021-115) | IM | 29/1/2024 | |
| 20240129 | 9063-WK-0001 | B-P-1501A | FIRE MAIN PUMP | (1U)Weekly-PH suction screen cleaning | PM | 29/1/2024 | Pump |
| 20240129 | 9H313-C-00012 | B-PV-384102A | HPS STEAM IMPORT | (3M) CONDITION CHECK (OSL 2021-113) | IM | 29/1/2024 | |
| 20240129 | 89A-C-00021 | B-SECUR-TASK05 | FOR PH: TEST FIRE PUMP | (1Y)INSPECTION | PM | 29/1/2024 | |
| 20240128 | 980-C-00011 | B-BENTLYNEVADA | VIBRATION MONITORING SYSTEM | (3M)INSPECT & ADJUST | PM | 28/1/2024 | |
| 20240128 | 813-C-00060 | B-FE-ORP | Grouping For Emergency EXIT ORP | (3M)INSPECT, VERIFY&CHECK | PM | 28/1/2024 | |
| 20240128 | 8007-C-00020 | B-G-920A | CONDENSATE POLISHERS | (3M) CONDITION CHECK (OSL 2022-145) | PM | 28/1/2024 | |
| 20240128 | 8007-C-00021 | B-M-944 | LP SUSPECT CONDENSATE DRUM | (3M) CONDITION CHECK (OSL 2022-147) | PM | 28/1/2024 | |
| 20240128 | 952B-C-00098 | B-P-1202A | SIDESTREAM FILTER BACKWASH SUMP PUMP | (3M)REGREASE | PM | 28/1/2024 | Pump |
| 20240128 | 919A-C-00061 | B-R-300 | CRACKED GAS COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-148) | PM | 28/1/2024 | Compressor |
| 20240128 | 902B-C-00014 | B-T-374 | C3 HYDROGENATION TANK SPARE INTERCOOLER | (3M) CONDITION CHECK (OSL 2022-149) | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00007 | B-W502-02-01 | AIR COMPRESSOR SULLJAR | (1Y)INSPECTION | PM | 28/1/2024 | Compressor |
| 20240128 | 9W5-C-00001 | B-W503-06-01 | BALANCING MACHINE | (1Y)INSPECTION | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00001 | B-W505-01-01 | UNIVERSAL MILLING MACHINE | (1Y)LUBRICATE & INSPECTION | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00014 | B-W505-03-01 | CENTER LATHE MACHINE AJAX | (1Y)LUBRICATE & INSPECT | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00023 | B-W505-03-02 | CENTER LATHE MACHINE PINACHO | (1Y)LUBRICATE & INSPECTION | PM | 28/1/2024 | |
| 20240128 | 9W5-C-00001 | B-W505-05-01 | COLUMN TYPE DRILLING MACHINE | (1M)INSPECTION | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00025 | B-W505-07-01 | HYDRAULIC HACKSAW | (1Y)LUBRICATE & INSPECTION | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00026 | B-W505-21-01 | SHAPING MACHINE | (3M)INSPECT | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00029 | B-W508-03-01 | HIGH PRESSURE WATER JET MACHINE | (1Y)INSPECT | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00033 | B-W514-01-01 | FORK LIFT | (1Y)INSPECTION | PM | 28/1/2024 | |
| 20240128 | 9W5-S-00039 | B-W514-03-01 | TRUCK LOADER HINO | (1M)INSPECTION | PM | 28/1/2024 | |
| 20240128 | 8090-S-00003 | B-WFMR-CCB-01 | 6.6/0.4KV DISTRIBUTION TRANSFORMER - NEW | (3M) RCM Visual Inspection | IM | 28/1/2024 | |
| 20240128 | 8090-S-00003 | B-WFMR-CCB-02 | 6.6/0.4KV DISTRIBUTION TRANSFORMER - NEW | (3M) RCM Visual Inspection | IM | 28/1/2024 | |
| 20240127 | 90P1-C-00031 | B-ANALYZER-O2/471 | GROUPING FOR OXYGEN ANALYZER PLANT/4/1 | (2M)SET & CALIBRATE | PM | 27/1/2024 | |
| 20240127 | 961-C-00139 | B-AT-1411A | ZNO/CO Analyzer | (2M)Inspect & Cal | PM | 27/1/2024 | |
| 20240127 | 908-C-00027 | B-AT-382102 | SI02 ANALYZER TRANSMITTER FOR V-3821 OUT | (1M)SET & CALIBRATE | PM | 27/1/2024 | |
| 20240127 | 912-C-00023 | B-AT-402103 | BIJUTADIENE IR | (2M)SET & CALIBRATE | PM | 27/1/2024 | |
| 20240127 | 924-C-00014 | B-AT-240124 | LOCKWASHER | (2M)INSPECT & TIGHTNESS NUTS AND SCR | PM | 27/1/2024 | |
| 20240127 | 890-C-00141 | B-INTERCOM-GR3-P1 | GROUP TAG FOR INTERCOM SYSTEM | (3M)INTERCOM FUNCTION TEST | PM | 27/1/2024 | |
| 20240127 | 927-C-00021 | B-P-5105 | C3 HYDROGENATION FEED PUMP | (3Y)CLEANING | PM | 27/1/2024 | Pump |

| | | | | | | | |
|----------|--------------|-------------------|---|---|----|-----------|--------------|
| 20240127 | 890-C-00018 | B-PM-3841S | COOLING TOWER PUMP MOTOR | (6M)Change Oil Lubrication&Inspection | PM | 27/1/2024 | Motor |
| 20240126 | 912-C-00214 | B-AT-402104 | BIJUTADIENE Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/1/2024 | |
| 20240126 | 912-C-00025 | B-AT-404501 | BEU Celum Accuma. (M-4045) Oxyg. Ana. | (2M)SET & CALIBRATE | PM | 26/1/2024 | |
| 20240126 | 917-C-00006 | B-AT-9440 | HC LP SUS COND. DISC. P-902A/S | (1M)SET & CALIBRATE | PM | 26/1/2024 | |
| 20240126 | 963-C-00088 | B-DV-NPA-001 | GROUPING TAG FOR DELUGE VALVE NFA | (1M)CHECK/VISUAL HEAT DETECTORS AND | PM | 26/1/2024 | |
| 20240126 | 9061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/1/2024 | |
| 20240126 | 9061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/1/2024 | |
| 20240126 | 9061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 26/1/2024 | |
| 20240126 | 961-C-00114 | B-G-1144-A-2S | AERATION TANK BLOWER | (1Y)LUBRICATION | PM | 26/1/2024 | |
| 20240126 | 932-C-00010 | B-G1-300 | GAS DETECTOR (VCH) BETWEEN C000&T0C | (6M)RECALIBRATE GAS DETECTOR(OUT-SOURCE) | PM | 26/1/2024 | Gas Detector |
| 20240126 | 932-C-00018 | B-G1-301 | GAS DETECTOR (VCH) BETWEEN C000&T0C | (6M)RECALIBRATE GAS DETECTOR(OUT-SOURCE) | PM | 26/1/2024 | Gas Detector |
| 20240126 | 912-C-00056 | B-GS-2C-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 26/1/2024 | |
| 20240126 | 890-C-00005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 26/1/2024 | |
| 20240126 | 890-C-00025 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 26/1/2024 | |
| 20240126 | 90P9-C-00073 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (3M)CLEANING & INSPECTION. | PM | 26/1/2024 | Motor |
| 20240126 | 90P9-C-00023 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (3M)CLEANING & INSPECTION. | PM | 26/1/2024 | Motor |
| 20240126 | 90P9-C-00041 | B-MOTOR-EO-003 | GROUPING FOR MOTORS CONSOLE#6 | (3M)CLEANING & INSPECTION/LUBRICATION | PM | 26/1/2024 | Motor |
| 20240126 | 859-C-00008 | B-P-1124A | CHEMICAL SEWER SUMP PUMP | (3M)REGREASE | PM | 26/1/2024 | Pump |
| 20240126 | 9061-C-00019 | B-P-1132A | CP1 FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 26/1/2024 | Pump |
| 20240126 | 9061-C-00019 | B-P-1132S | CP1 FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 26/1/2024 | Pump |
| 20240126 | 9061-C-00018 | B-P-1136A | CP2 EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 26/1/2024 | Pump |
| 20240126 | 9061-C-00018 | B-P-1136S | CP2 EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 26/1/2024 | Pump |
| 20240126 | 9NA-C-00048 | B-PM-4910A | BUTENE1 PRODUCT TRANSFER PUMP MOTOR | (3Y)INSPECTION | PM | 26/1/2024 | |
| 20240126 | 961-C-00094 | B-PSV-11449 | SAFETY VALVE DISCHARGE G-1144-R-2S | (3Y)TEST & SET SAFETY VALVE | PM | 26/1/2024 | PSV |
| 20240126 | 9090-C-00033 | B-R-3600-PM-1S | C2 COMPR LD PUMP MOTOR | RCM (6M) INSPECTION AND TEST | PM | 26/1/2024 | Motor |
| 20240126 | 9NA-C-00049 | B-VI-COMP | GROUPING TAG FOR VIBRATION MAJOR COMP | (3M)VIBRATION CHECK. | IM | 26/1/2024 | Motor |
| 20240125 | 90P1-C-00002 | B-EPCOLM1 | GROUPING FOR MOTORS CONSOLE#1 | (1M)CLEANING | PM | 25/1/2024 | |
| 20240125 | 90P1-S-00001 | B-EPCOLM1B | GROUPING FOR MOTORS CONSOLE#1 | (3M)LUBRICATION ON OPERATION. | PM | 25/1/2024 | |
| 20240125 | 90P2-C-00002 | B-EPCOLM1C | GROUPING FOR MOTORS CONSOLE#2 | (1M)CLEANING | PM | 25/1/2024 | |
| 20240125 | 90P2-C-00001 | B-EPCOLM1D | GROUPING FOR MOTORS CONSOLE#2 | (3M)LUBRICATION ON OPERATION. | PM | 25/1/2024 | |
| 20240125 | 90P3-C-00003 | B-EPCOLM1E | GROUPING FOR MOTORS CONSOLE#3 | (1M)CLEANING | PM | 25/1/2024 | |
| 20240125 | 90P3-S-00001 | B-EPCOLM1F | GROUPING FOR MOTORS CONSOLE#3 | (3M)LUBRICATION ON OPERATION. | PM | 25/1/2024 | |
| 20240125 | 90P4-C-00002 | B-EPCOLM1G | GROUPING FOR MOTORS CONSOLE#4,5,6 | (1M)CLEANING | PM | 25/1/2024 | |
| 20240125 | 90P4-S-00001 | B-EPCOLM1H | GROUPING FOR MOTORS CONSOLE#4,5,6 | (3M)LUBRICATION ON OPERATION. | PM | 25/1/2024 | |
| 20240125 | 910M-C-00039 | B-F-130 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-178) | IM | 25/1/2024 | Furnace |
| 20240125 | 960-C-00087 | B-G-1112-P-1A | HIGH PRESSURE FEED PUMPS | (1W)CLEAN STRAINER&INSPECTION | PM | 25/1/2024 | |
| 20240125 | 90P9-C-00069 | B-M-1907A | GROUPING TAG FOR C3/C4 FROM PITPE | (1Y)PROVE MASS FLOW METER (OUT-SOURCE) | PM | 25/1/2024 | |
| 20240125 | 9H6-C-00010 | B-M-3104 | 4 FURNACE SHIP STEAM | SYSTEM DRUM CRUSH INSPECTION BY LAW GROUP E | IM | 25/1/2024 | |
| 20240125 | 9H6-C-00010 | B-M-3104 | 4 FURNACE SHIP STEAM | (3Y)SE & CALIBRATE SIM DASH. BY LAW "E" | IM | 25/1/2024 | |
| 20240125 | 90P9-C-00004 | B-MOTOR-EO-001 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/1/2024 | Motor |
| 20240125 | 90P9-C-00004 | B-MOTOR-EO-002 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 25/1/2024 | Motor |
| 20240125 | 900-C-00088 | B-NONE-OLEFINS-P1 | Equipment non Olefins Plant 1-4/1 | (3M) CONDITION CHECK (OSL 2022-181) | IM | 25/1/2024 | |
| 20240125 | 9H6-C-00010 | B-PSV-310401 | HIGH PRESSURE STEAM DRUM M-3104 TOP | (3Y)INSPECTION PSV M-3104(GROUP#E) | PM | 25/1/2024 | PSV |
| 20240125 | 9H6-C-00010 | B-PSV-310402 | HIGH PRESSURE STEAM DRUM M-3104 TOP | (3Y)INSPECTION PSV M-3104(GROUP#E) | PM | 25/1/2024 | PSV |
| 20240125 | 9H6-C-00010 | B-PSV-310403 | SUPER HP STEAM FROM F-3104 FURNACE OUTLET | (3Y)INSPECTION PSV M-3104(GROUP#E) | PM | 25/1/2024 | PSV |
| 20240125 | 952B-C-00142 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-177) | IM | 25/1/2024 | |
| 20240125 | 952B-C-00141 | B-Q-1204 | Cooling Tower Basin | (3M) CONDITION CHECK (OSL 2022-176) | IM | 25/1/2024 | |
| 20240125 | 952B-C-00105 | B-Q-1205 | USE OF WASTEWATER VAPOR COLLECT BLOWER | (6M)INSPECTION OVERHAUL | PM | 25/1/2024 | |
| 20240125 | 910-C-00003 | B-SECUR-TASK03A | FOR PH: CHECK A FOAM TRUCK MCL (NUNIGATE) | (1D)INSPECTION | PM | 25/1/2024 | |
| 20240125 | 910-C-00003 | B-SECUR-TASK03C | FOR PH: CHECK A WATER TRUCK(SAVANNA) | (1D)INSPECTION | PM | 25/1/2024 | |

| | | | | | | | |
|----------|---------------|-------------------|--|--|----|-----------|------------|
| 20240125 | 820-C-00003 | B-SECUR-TASK03E | FOR PH: CHECK AMBULANCE(JITRUKSA) | (1D)INSPECTION | PM | 25/1/2024 | |
| 20240125 | 820-C-00003 | B-SECUR-TASK03F | FOR PH: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 25/1/2024 | |
| 20240125 | 9NA-C-00030 | B-SECUR-TASK03G | FOR PH:FLUSH LINE HEADER FIRE WATER | (4M)INSPECTION | PM | 25/1/2024 | |
| 20240125 | 912-C-00028 | B-PSST-48004 | HP HEADSTEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-179) | IM | 25/1/2024 | |
| 20240125 | 912-C-00739 | B-PSST-48005 | HP HEADSTEAM TIE-IN | (3M) CONDITION CHECK (OSL 2022-180) | IM | 25/1/2024 | |
| 20240125 | 890-C-00239 | B-WFMR-281 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 25/1/2024 | |
| 20240125 | 890-C-00239 | B-WFMR-282 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 25/1/2024 | |
| 20240124 | 906-C-00068 | B-M-15073 | GROUPINGTAG FOR QUENCH BOTTOM FROM FITPE | (1Y)PROVE MASS FLOW METER (OUT-SOURCE) | PM | 24/1/2024 | |
| 20240124 | 812-C-00728 | B-PSE-490002 | LINE TO BTP RUBTURE DISC | (1Y)INSPECTION RUBTURE DISC | IM | 24/1/2024 | |
| 20240123 | 8016-C-00030 | B-A-220 | QUENCH WATER TOWER | (3M) CONDITION CHECK (OSL 2022-229) | IM | 23/1/2024 | |
| 20240123 | 812-C-00031 | B-AT-472071 | LP CONDENSATE TCC | (1M)SET & CALIBRATE | PM | 23/1/2024 | |
| 20240123 | 810F-C-00047 | B-F-160 | USC FURNACES | (3M) CONDITION CHECK (OSL 2023-227) | IM | 23/1/2024 | Furnace |
| 20240123 | 90B3-C-00001 | B-FT-1595 | HPS from Plant 1-1 | (3M) CONDITION CHECK (OSL 2023-231) | IM | 23/1/2024 | |
| 20240123 | 812-C-00094 | B-M-1531 | METHANOL VAPORIZER DRUM | (3M) CONDITION CHECK (OSL 2023-231) | IM | 23/1/2024 | |
| 20240123 | 812-C-00043 | B-PSG-BV-HOUSE2 | GROUPING TAG FOR ROC BV HOUSE 2 | (2M)SET&CALIBRATE | PM | 23/1/2024 | |
| 20240123 | 9060-C-00057 | B-Q-1121 | SPENT CAUSTIC HOLDING TANK | (3M) CONDITION CHECK (OSL 2023-226) | IM | 23/1/2024 | |
| 20240123 | 857-C-00025 | B-R-1475A | INSTRUMENT AIR COMPRESS | (3M)Air intake filter inspection,Cleanin | PM | 23/1/2024 | |
| 20240123 | 857-C-00026 | B-R-1475S | INSTRUMENT AIR COMPRESS | (3M)Air intake filter inspection,Cleanin | PM | 23/1/2024 | |
| 20240123 | 857-C-00027 | B-R-1475S | INSTRUMENT AIR COMPRESSOR | (3M)Air intake filter inspection,Cleanin | PM | 23/1/2024 | Compressor |
| 20240123 | 800-C-00107 | B-VALVE1-DS | VALVE DILUTION STEAM OLE 2-1 | (3M) CONDITION CHECK (OSL 2023-228) | IM | 23/1/2024 | |
| 20240122 | 981-S-00006 | B-AE-1100 | CG EFFLUENT FROM F-110 | (3M)INSPECTION & CLEANING | PM | 22/1/2024 | |
| 20240122 | 981-S-00006 | B-AE-1200 | CG EFFLUENT FROM F-120 | (3M)INSPECTION & CLEANING | PM | 22/1/2024 | |
| 20240122 | 907F-C-00015 | B-ANALYZER-SILICA | GROUPING FOR SILICA ANALYZER | (1M)SET&CALIBRATE | PM | 22/1/2024 | |
| 20240122 | 8112P-C-00063 | B-AT-331003 | MOISTURE ANALYZER TRANSMITTER FOR H-3301 | (1M)MOISTURE ANALYZER AMETEX | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-DCS-P1 | DCS HONEYWELL TDC3000&PERION | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-DCS-P1-BOILER | DCS EMERSON DELTA-V MD CONTROLLER SOFTWARE | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-DCS-P1-ORP | DCS HONEYWELL C300 EXPIRION RS11.1 | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-DCS-P2 | DCS YOKOGAWA CP461-S0/APV30D/REVISION R5 | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-DCS-P3 | DCS HONEYWELL C300 EXPIRION | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-BOILER | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-C3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-ORP | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-PLC1 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-PLC2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-PLC3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-PLC4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P1-TANKFARM | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P2-COLDPUT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P2-FUR1-2 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P2-FUR3-4 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P2-FUR5-HOT | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P2-FUR6 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 800-C-00065 | B-ESD-P3 | EMERGENCY SHUTDOWN SYSTEM | (1M)DAILY CHECK SYSTEM | PM | 22/1/2024 | |
| 20240122 | 8143-C-00013 | B-FV-310109 | DECOKE AIR TO ETHYLENE FURNACE F-3101 | (6M)PLANT 2 LUBRICATE CONTROL VALVE CV-1 | PM | 22/1/2024 | |
| 20240122 | 9050-S-00001 | B-G-1350S-R-1 | ASSIST AIR BLOWER | (6M)(1M) VISUAL INSPECTION | IM | 22/1/2024 | |
| 20240122 | 909F-C-00014 | B-M-19018 | GROUPING TAG FOR FUEL GAS TO TCC/CDSCO | (2M)UPDATE N2, CO2, REL DENSITY | PM | 22/1/2024 | |
| 20240122 | 909F-C-00015 | B-M-19017 | GROUPING TAG FOR TAIL GAS TO TCC/CDSCO | (1M)UPDATE N2, CO2, REL DENSITY | PM | 22/1/2024 | |
| 20240122 | 909F-C-00016 | B-M-19073 | GROUPING TAG FOR QUENCH BOTTOM FROM FITPE | (4M)SET & CALIBRATE | PM | 22/1/2024 | |
| 20240122 | 909F-C-00066 | B-M-19074 | GROUPING TAG FOR C3/C4 FROM PITPE | (4M)SET & CALIBRATE | PM | 22/1/2024 | |
| 20240122 | 961-C-00118 | B-P-1142D | CONTAMINATED STORAGE WATER PUMP | (3M)REGREASE | PM | 22/1/2024 | Pump |

| | | | | | | | |
|----------|--------------|--------------------|--|--|----|-----------|------------|
| 20240117 | 890-S-00025 | B-BC2-2E5 | BATTERY CHARGER AT NEW PRO. SUB-1 | (1M)INSPECT & ADJUST | PM | 17/1/2024 | |
| 20240117 | 890-S-00042 | B-BC2-2E5-2 | BATTERY CHARGER AT NEW PRO. SUB-2 | (1M)INSPECT & ADJUST | PM | 17/1/2024 | |
| 20240117 | 890-S-00047 | B-BC2-KW1A | BATTERY CHARGER PANEL NO.7 FOR SUB NO.5 | (1M)INSPECT & ADJUST | PM | 17/1/2024 | |
| 20240117 | 8112-C-00401 | B-CP-TRU-01 | CATHODIC PROTECTION RECTIFIER NO.1 | (1M)VISUAL INSPECTION & RECORD | PM | 17/1/2024 | |
| 20240117 | 890-C-00018 | B-CP-TRU-PLANT2 | GROUPING TAG FOR CP TRU PLANT2 | (1M)VISUAL INSPECTION | PM | 17/1/2024 | |
| 20240117 | 809C-00009 | B-H-15020 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1M)PROVE GAS TURBINE METER,(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240117 | 812-C-00012 | B-MOTOR-EP-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (3M)VISUAL CHECK AND INSPECTION | PM | 17/1/2024 | Motor |
| 20240117 | 842B-C-00014 | B-MR-600-P-1A | C/R CONDENSER COND. PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/1/2024 | |
| 20240117 | 842B-C-00012 | B-MR-600-P-2A | C/R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/1/2024 | |
| 20240117 | 842B-C-00031 | B-MR-600-P-2S | C/R SURFACE CONDENSER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 17/1/2024 | |
| 20240117 | 8112-C-00042 | B-PGC-BV-HOUSE1 | GROUPING TAG FOR PGC BV HOUSE 1 | (2M)SET/RECALIBRATE | PM | 17/1/2024 | |
| 20240117 | 8112-C-00075 | B-PSE-404802 | INLET T-4048 RUPTURE DISC | (1Y)INSPECTION RUPTURE DISC | IM | 17/1/2024 | |
| 20240117 | 819A-C-00058 | B-R-300 | CRACKED GAS COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/1/2024 | Compressor |
| 20240117 | 819A-C-00058 | B-R-600-P-1A | C/R COMPRESSOR CONDENSATE RUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/1/2024 | Compressor |
| 20240117 | 842B-C-00012 | B-MR-600-P-2A | C/R COMPRESSOR CONDENSATE VACUUM RUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/1/2024 | Compressor |
| 20240117 | 842B-C-00031 | B-MR-600-P-2S | C/R COMPRESSOR CONDENSATE VACUUM RUMP | RCM-(1M)VISUAL INSPECTION | PM | 17/1/2024 | Compressor |
| 20240117 | 819A-C-00058 | B-R/RX-401A | TAIL GAS EXPANDER & COMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/1/2024 | Compressor |
| 20240117 | 819A-C-00058 | B-R/RX-401B | TAIL GAS RECOMPRESSOR | (1M) N2 PRESSURE INSPECTION | IM | 17/1/2024 | Compressor |
| 20240117 | 819A-C-00058 | B-RIT-300 | CRACKED GAS COMPRESSOR TURBINE DRIVER | (1M) N2 PRESSURE INSPECTION | IM | 17/1/2024 | Compressor |
| 20240117 | 819A-C-00058 | B-RIT-600 | ETHYLENE REFRIGERANT COMPRESSOR TURBINE | (1M) N2 PRESSURE INSPECTION | IM | 17/1/2024 | Compressor |
| 20240117 | 819A-C-00058 | B-RIT-600 | PROPYLENE REFRIGERANT COMPRESSOR TURBIN | (1M) N2 PRESSURE INSPECTION | IM | 17/1/2024 | Compressor |
| 20240117 | 812-C-00021 | B-SCADA-INV | SCADA SYSTEM FOR INV | (3M)VISUAL INSPECT | PM | 17/1/2024 | |
| 20240117 | 812-C-00012 | B-SECUR-TASK36 | SECURITION EQUIPMENT INSIDE CON | (3M)VISUAL INSPECTION | PM | 17/1/2024 | |
| 20240117 | 832-C-00030 | B-SM-08/02 | DOCUMENTING PROCESS CALIBRATE | (1Y)CAL. DOCUMENTING PROCESS(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240117 | 832-C-00013 | B-SO-01/01 | THERMO HYDROGRAPH RECORD | (1Y)CAL.THERMOHYDROGRAPH REQ(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240117 | 832-C-00031 | B-SP-03/01 | DIGITAL MANOMETER | (1Y)CAL. DIGITAL MANOMETER(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240117 | 832-C-00033 | B-SP-06/02 | D 2 KG/CM2 PORTABLE DIGITAL PRESS. CAL | (1Y)CAL. PORTABLE DI PRESS(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240117 | 832-C-00072 | B-SP-06/02 | O-2KG/CM2 PORTABLE DIGITAL PRESS. CAL | (1Y)CAL. PORTABLE DI PRESS(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240117 | 832-C-00002 | B-SK-02/01 | DECADE RESISTANCE BOX | (1Y)CAL. DECADE RESIST. BOX(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240117 | 832-C-00004 | B-SM-06/01 | THERMO HYDROGRAPH RECORDER | (1Y)CAL.TEMP.CALIBRATOR(OUT-SOURCE) | PM | 17/1/2024 | |
| 20240116 | 846F-C-00010 | B-H-486001-01 | GROUPING TAG FOR HYDROGEN SOD CAR | (4M)PROVE LIQUID METER OF METERING SKID | PM | 16/1/2024 | |
| 20240116 | 819A-C-00058 | B-LOCAL-2M2 | GROUPING TAG FOR PM LOCAL ANALYZER 2 Month | (2M)SET/RECALIBRATE | PM | 16/1/2024 | |
| 20240116 | 846F-C-00008 | B-H-486001 | Grouping Tag for CAR from GC3 to IST | (4M)SET & CALIBRATE | PM | 16/1/2024 | |
| 20240116 | 846F-C-00009 | B-H-486001 | Grouping Tag for CAR from GC3 to IST | (4M)PROVE LIQ. TURBINE METER(OUT-SOURCE) | PM | 16/1/2024 | |
| 20240116 | 843B-S-00003 | B-MOTOR-EO-NPA-002 | GROUPING TAG FOR MOTOR NPA AREA | (3M)LUBRICATION ON OPERATION. | PM | 16/1/2024 | Motor |
| 20240116 | 855-C-00009 | B-P-11245 | CHEMICAL SEWER SLUMP PUMP | (3M)REGREASE | PM | 16/1/2024 | Pump |
| 20240116 | 890-S-00011 | B-UPS1-2E5 | UPS AT NEW PROCESS SUBSTION | (3M)CONDITION CHECK | PM | 16/1/2024 | |
| 20240115 | 816C-00036 | B-A-220 | QUENCH WATER TOWER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 816C-00036 | B-A-220 | QUENCH WATER TOWER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 820A-C-00040 | B-A-340 | CAUSTIC TOWER | (3M) CONDITION CHECK (OSL 202-150) | IM | 15/1/2024 | |
| 20240115 | 825-C-00027 | B-A-370 | HP DEPROANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 825-C-00027 | B-A-370 | HP DEPROANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 827-C-00039 | B-A-390 | LP DEPROANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 827-C-00039 | B-A-390 | LP DEPROANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 836-C-00029 | B-A-410 | DEMETHANIZER PREFRACTONATOR | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 836-C-00029 | B-A-410 | DEMETHANIZER PREFRACTONATOR | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 836-C-00030 | B-A-420 | DEMETHANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 836-C-00030 | B-A-420 | DEMETHANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 840-C-00017 | B-A-440 | DEETHANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |
| 20240115 | 840-C-00017 | B-A-440 | DEETHANIZER | (4Y) SIF PROOF TEST & INSPECTION | PM | 15/1/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|--|----|-----------|------------|
| 20240115 | B36-C-00031 | B-A-450 | DEMETHANIZER RECTIFIER TOWER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B36-C-00031 | B-A-450 | DEMETHANIZER RECTIFIER TOWER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B30A-C-00011 | B-A-510 | LP DEPROPANIZER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B30A-C-00011 | B-A-510 | LP DEPROPANIZER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B29-C-00052 | B-A-540 | PROPYLENE RECTIFIER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B29-C-00052 | B-A-540 | PROPYLENE RECTIFIER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B30-C-00038 | B-A-560 | PROPYLENE DEANIZER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B30-C-00038 | B-A-560 | DEBUTANIZER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B30A-C-00012 | B-A-570 | C3 SPLITTER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B30A-C-00012 | B-A-570 | C3 SPLITTER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B34A-C-00017 | B-A-580 | DEBUTANIZER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B34A-C-00017 | B-A-580 | DEBUTANIZER | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B1-C-00018 | B-A7-5010 | BPM FROM DEARATOR | (7W) CALIBRATION | PM | 15/1/2024 | |
| 20240115 | B90-S-00019 | B-CAP-25 | GROUPING TAG FOR CAP-25 SUBSTATION #3 | (1W) VISUAL INSPECTION TEMP, NOISE, VIBRAT | PM | 15/1/2024 | |
| 20240115 | B90-EL-00130 | B-CAP-25 | Group Tag for EMERGENCY Light | (1W) VISUAL TEST, VERIFY & CALIBRATE | PM | 15/1/2024 | |
| 20240115 | B10D-C-00041 | B-F-140 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-162) | IM | 15/1/2024 | Furnace |
| 20240115 | B10F-C-00044 | B-F-150 | USC FURNACES | (3M) CONDITION CHECK (OSL 2022-161) | IM | 15/1/2024 | Furnace |
| 20240115 | B060-C-00053 | B-G-1112-L-1 | OXIDATION REACTOR | (3M) CONDITION CHECK (OSL 2022-164) | IM | 15/1/2024 | |
| 20240115 | B12-S-00057 | B-G-4803-P-45 | NAOCL INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 15/1/2024 | |
| 20240115 | B12-S-00059 | B-G-4803-P-55 | H2SO4 INJECTION PUMPS | (6M) CHANGE GEAR OIL | PM | 15/1/2024 | |
| 20240115 | B09F-C-00033 | B-HY-NPA-001 | GROUPING TAG FOR HYDRANT IN NPA | (6M) REGREASE & VISUAL | PM | 15/1/2024 | |
| 20240115 | B26-C-00026 | B-L-380A | C2 HYDROGENATION ADIABATIC REACTORS | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B26-C-00027 | B-L-380A | C2 HYDROGENATION ADIABATIC REACTORS | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B28B-C-00030 | B-L-531A | C3 HYDROGENATION REACTORS | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | |
| 20240115 | B0C3-C-00011 | B-OD-AHH-6-1 | OXYGEN LOW DETECTOR HOUSE 6 | (6M) SET & CALIBRATE | PM | 15/1/2024 | |
| 20240115 | B0C3-C-00012 | B-OD-AHH-7-1 | OXYGEN LOW DETECTOR HOUSE 7 | (6M) SET & CALIBRATE | PM | 15/1/2024 | |
| 20240115 | B0C3-C-00013 | B-OD-AHH-8-1 | OXYGEN LOW DETECTOR HOUSE 8 | (6M) SET & CALIBRATE | PM | 15/1/2024 | |
| 20240115 | B07-S-00001 | B-OLL-MIST-PLANT2 | Grouping Tag for Oil Mist Systems PL-4/2 | (1M) Oil Mist Monthly PM | PM | 15/1/2024 | |
| 20240115 | B063-WK-0001 | B-P-1501A | FIRE MAIN PUMP | (1W) Weekly Pit suction screen cleaning | PM | 15/1/2024 | Pump |
| 20240115 | B46B-C-00010 | B-Q-1505 | LIQUID NAPHTHA STORAGE TANK | (6M) Inspection by EIA | IM | 15/1/2024 | |
| 20240115 | B19A-C-00044 | B-R-390 | CRACKED GAS COMPRESSOR | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | Compressor |
| 20240115 | B19A-C-00044 | B-R-390 | CRACKED GAS COMPRESSOR | (4Y) SIF PROOF TEST & INSPECTION | IM | 15/1/2024 | Compressor |
| 20240115 | B147-C-00001 | B-R-3121A | DILUTION AIR FAN | (1Y) BELT INSPECTION & CLEAN AIR FILTER | PM | 15/1/2024 | |
| 20240115 | BNA-C-00021 | B-SECUA-TASK05 | FOR PM: TEST FIRE PUMP | (1W) INSPECTION | PM | 15/1/2024 | |
| 20240115 | B12-C-00492 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4306) | IM | 15/1/2024 | |
| 20240115 | B12-C-00505 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4329) | IM | 15/1/2024 | |
| 20240115 | B12-C-00492 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4308) | IM | 15/1/2024 | |
| 20240115 | B12-C-00503 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4327) | IM | 15/1/2024 | |
| 20240115 | B12-C-00496 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4301) | IM | 15/1/2024 | |
| 20240115 | B12-C-00498 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4321) | IM | 15/1/2024 | |
| 20240115 | B12-C-00506 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4330) | IM | 15/1/2024 | |
| 20240115 | B12-C-00496 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4103) | IM | 15/1/2024 | |
| 20240115 | B12-C-00496 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4103) | IM | 15/1/2024 | |
| 20240115 | B12-C-00498 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4321) | IM | 15/1/2024 | |
| 20240115 | B12-C-00503 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4327) | IM | 15/1/2024 | |
| 20240115 | B12-C-00496 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4108) | IM | 15/1/2024 | |
| 20240115 | B12-C-00496 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4108) | IM | 15/1/2024 | |
| 20240115 | B12-C-00471 | B-SIF-B1 | SIF Proof test Butene-1 Unit | (4Y) SIF PROOF TEST INSPECTION (I-4110) | IM | 15/1/2024 | |

| | | | | | | | |
|----------|-------------|--------------------|---|--|----|-----------|------------|
| 20240113 | 801Y-C-0002 | B-4-M-19190 | Grouping Tag for Ralf from GC3 to KAC | (4W)PROVE U/L TURBINE METRIC(OUT-SOURCE) | PM | 13/1/2024 | |
| 20240113 | 800R-C-0012 | B-M-942 | INTERMITTENT BLOWDOWN DRUM | (3M) CONDITION CHECK (OSL 2022-131) | IM | 13/1/2024 | |
| 20240113 | 800C-C-0003 | B-MOTOR-EO-004 | GROUPING FOR MOTORS CONSOLES | (1M)CLEANING & INSPECTION. | PM | 13/1/2024 | Motor |
| 20240113 | 838-S-0004 | B-MOTOR-EO-NPA-001 | GROUPING TAG FOR MOTOR NPA AREA | (3M) LUBRICATION | PM | 13/1/2024 | Pump |
| 20240113 | 811-C-0015 | B-P-221A | QUENCH OIL TOWER REFLEX PUMP | (3M) CONDITION CHECK (OSL 2022-224) | IM | 13/1/2024 | |
| 20240113 | 800-C-0061 | B-PIPE1-SC1 | LINE STEAM CONDENSATE - LP OLE 2-1 | (3M) CONDITION CHECK (OSL 2021-093) | IM | 13/1/2024 | |
| 20240113 | 890-S-0005 | B-PM-32015 | QUENCH WATER PUMP MOTOR | (3M)LUBRICATION | PM | 13/1/2024 | Motor |
| 20240113 | 805G-C-0014 | B-R-14705 | PLANT AIR COMPRESSOR | (3M) CONDITION CHECK (OSL 2022-132) | PM | 13/1/2024 | Compressor |
| 20240113 | 819A-C-0062 | B-R-330HP | CRACKED GAS COMPRESSOR HP CASINGS | (1M)INSPECT WRAPPED DRAIN FLANGE | PM | 13/1/2024 | |
| 20240113 | 819-S-0004 | B-R-14705 | ETHYLENE PURGE U/L FAN#5 | (2M) RE GREASE DAMPER BEARING | PM | 13/1/2024 | |
| 20240113 | 8NA-C-0013 | B-SECUR-TASK01 | INSPECTION CO2 SYSTEMS | (1M)INSPECTION | PM | 13/1/2024 | |
| 20240113 | 848A-C-0059 | B-T-1520 | LPG VAPORIZER | (3M) CONDITION CHECK (OSL 2022-129) | PM | 13/1/2024 | |
| 20240113 | 836-C-0004 | B-UPS-001 | GROUPING FOR UPS 150KVA | (1M)INSPECT & ADJUST | PM | 13/1/2024 | |
| 20240113 | 800-C-0016 | B-VALVE1-SHH | VALVE STEAM - SUPER HIGH PRESSURE OLE 2-1 | (3M) CONDITION CHECK (OSL 2022-222) | IM | 13/1/2024 | |
| 20240113 | 812-C-0036 | B-VSD-G-3841-RM-1B | VSD Panel for G-3841-RM-1B | (1M)Inspection & Record | PM | 13/1/2024 | |
| 20240113 | 812-C-0034 | B-VSD-G-3841-RM-1C | VSD Panel for G-3841-RM-1C | (1M)Inspection & Record | PM | 13/1/2024 | |
| 20240113 | 812-C-0037 | B-VSD-RM-3106 | VSD Panel for R-3106 | (1M)Inspection & Record | PM | 13/1/2024 | |
| 20240112 | 809S-S-0004 | B-CAP-MS | GROUPING TAG FOR CAPACITY MAIN SUB | (1M)VISUAL INSPECTION TEMP NOISE AND VIB | PM | 12/1/2024 | |
| 20240112 | 840-C-0026 | B-DOS-P1 | DCS HONEYWELL TDC3000BEXPERION | (6M)PAYMENT SITES AGREEMENT HONEYWELL | PM | 12/1/2024 | |
| 20240112 | 810H-C-0039 | B-T-180 | USC FURNACES | (3M) CONDITION CHECK (OSL 2021-069) | IM | 12/1/2024 | Furnace |
| 20240112 | 806L-C-0017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 12/1/2024 | |
| 20240112 | 806L-C-0017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 12/1/2024 | |
| 20240112 | 806L-C-0017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 12/1/2024 | |
| 20240112 | 8NA-C-0052 | B-GC-2M1 | GROUPING FOR PM GC 2 Month group1 | (2M)SET&CALIBRATE | PM | 12/1/2024 | |
| 20240112 | 812-C-0056 | B-GS-2E-F1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 12/1/2024 | |
| 20240112 | 890-C-0005 | B-GS-2E5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 12/1/2024 | |
| 20240112 | 806L-C-0017 | B-GS-3M1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 12/1/2024 | |
| 20240112 | 817-C-0029 | B-HW-310513 | MOTOR OPERATED DECKING VALVE OF F-3105 | (6M)UNLEAK AND INSPECT 31 VALVE Group | PM | 12/1/2024 | |
| 20240112 | 817-C-0029 | B-HW-310514 | MOTOR OPERATED DECKING VALVE OF F-3105 | (6M)UNLEAK AND INSPECT 31 VALVE Group | PM | 12/1/2024 | |
| 20240112 | 810F-C-0039 | B-M-160 | STEAM DRUM | (3M) CONDITION CHECK (OSL 2021-090) | IM | 12/1/2024 | |
| 20240112 | 806L-C-0019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 12/1/2024 | Pump |
| 20240112 | 806L-C-0019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 12/1/2024 | Pump |
| 20240112 | 806L-C-0018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 12/1/2024 | Pump |
| 20240112 | 806L-C-0018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 12/1/2024 | Pump |
| 20240112 | 861-C-0017 | B-P-1142B | CONTAMINATED STORM WATER PUMP | (3M)REGREASE | PM | 12/1/2024 | Pump |
| 20240112 | 861-C-0017 | B-P-216 | SERVICE WATER PUMP | (1M)CLEANING & LUBRICATE | PM | 12/1/2024 | Pump |
| 20240112 | 830A-C-0002 | B-P-752A-P1-1A | MAIN LUBE OIL PUMP TURBINE | (1M)INSPECTION & CLEAN | PM | 12/1/2024 | Pump |
| 20240112 | 8NA-C-0012 | B-SECUR-TASK02 | FOR PM: INSPECTION HALON SYSTEMS | (1M)INSPECTION | PM | 12/1/2024 | |
| 20240112 | 8NA-C-0012 | B-SECUR-TASK03 | FOR PM: INSPECTION AND CHECK MOBILE GENE | (1M)INSPECTION | PM | 12/1/2024 | |
| 20240112 | 8050-C-0006 | B-TE-13000 | FLARE VPRS TO ELEV FLARE | (3M) CONDITION CHECK (OSL 2021-091) | IM | 12/1/2024 | Flare |
| 20240112 | 831-C-0004S | B-V-710-G-1 | GASO ANTIOXIDANT INHI STORAGE DRUM AGI | (3M)LUBRICATION | PM | 12/1/2024 | |
| 20240112 | 890-C-0046 | B-XFMR-11 | 22/5.5KV POWER TRANSFORMER SUB.4 | (3M)RCM Visual Inspection | PM | 12/1/2024 | |
| 20240112 | 890-C-0046 | B-XFMR-12 | 22/5.5KV POWER TRANSFORMER SUB.4 | (3M)RCM Visual Inspection | PM | 12/1/2024 | |
| 20240112 | 8026-C-0012 | B-XFMR-2E1 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW HAI | (3M)RCM Visual Inspection | PM | 12/1/2024 | |
| 20240112 | 8026-C-0012 | B-XFMR-2E2 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW HAI | (3M)RCM Visual Inspection | PM | 12/1/2024 | |
| 20240112 | 8026-C-0012 | B-XFMR-2E3 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW FSD | (3M)RCM Visual Inspection | PM | 12/1/2024 | |
| 20240112 | 8026-C-0012 | B-XFMR-2E4 | POWER TRANSFORMER 6.6/0.4 KV FOR NEW PRO | (3M)RCM Visual Inspection | PM | 12/1/2024 | |
| 20240112 | 8026-C-0012 | B-XFMR-2E5 | POWER TRANSFORMER 6.6/0.4 KV | (3M)RCM Visual Inspection | PM | 12/1/2024 | |
| 20240112 | 890-C-0046 | B-XFMR-R575 | AUTO TRANSFORMER FOR RM-575 | (3M)VISUAL CHECK | PM | 12/1/2024 | |
| 20240111 | 8021-C-0004 | B-AT-3600C | CG DEHYDRATORS BEDS | (1M)MOISTURE ANALYZER AMETEX | PM | 11/1/2024 | |

| | | | | | | | |
|----------|--------------|-------------------|--|-------------------------------------|----|-----------|------------|
| 20240111 | 803-C-00080 | B-DV-1628 | VALVE FAIL TO OPEN DELUGE VALVEND | (6M)DV CCB LUBRICATION & INSPECTION | IM | 11/1/2024 | |
| 20240111 | 803-C-00080 | B-DV-1628 | LABORATORY BLOW SPRINKLER PANEL DELUGE V | (6M)DV CCB LUBRICATION & INSPECTION | IM | 11/1/2024 | |
| 20240111 | 800-C-00080 | B-G-1112-P-15 | HIGH PRESSURE FEED PUMPS | (1M)FAN STRAINER&INSPECTION | PM | 11/1/2024 | |
| 20240111 | 810H-C-00080 | B-HV-1807 | DECOKE EFFLUENT TO F-1802 | (3M)OVERHAUL HV-1807 (GROUP "F") | PM | 11/1/2024 | |
| 20240111 | 844-C-00016 | B-PSV-4742A | T-474 TO COLD FLARE | (3M)SET & CALIBRATE (PSV 1 / 2/22) | PM | 11/1/2024 | PSV |
| 20240111 | BHFA-S-00001 | B-R-3106 | ETHYLENE PURGE U/L FAN#6 | (2M) RE GREASE DAMPER BEARING | PM | 11/1/2024 | |
| 20240111 | 820-C-00003 | B-SECUR-TASK03A | FOR PM: CHECK A FOAM TRUCK NO1 (MUNGATE) | (1D)INSPECTION | PM | 11/1/2024 | |
| 20240111 | 820-C-00003 | B-SECUR-TASK03C | FOR PM: CHECK A WATER TRUCK(SAYVARI) | (1D)INSPECTION | PM | 11/1/2024 | |
| 20240111 | 820-C-00003 | B-SECUR-TASK03E | FOR PM: CHECK AMBUCLANE(JITRUKSA) | (1D)INSPECTION | PM | 11/1/2024 | |
| 20240111 | 820-C-00003 | B-SECUR-TASK03F | FOR PM: CHECK WATER CAR (NATVAYU) | (1D)INSPECTION | PM | 11/1/2024 | |
| 20240111 | 838-C-00003 | B-UPS-002 | GROUPING FOR UPS 125 KVA | (1M)INSPECT & ADJUST | PM | 11/1/2024 | |
| 20240111 | 8C1G-C-00003 | BV-3843-PIA | HYPOCHLORITE INJECTION PUMP | (1Y)LUBRICATE | PM | 11/1/2024 | |
| 20240111 | 890-C-00234 | B-XMR-R-2C1 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 11/1/2024 | |
| 20240111 | 890-C-00234 | B-XMR-R-2C2 | POWER TRANSFORMER 6.6/0.4 KV | (3M)-RCM Visual Inspection | IM | 11/1/2024 | |
| 20240111 | 890-C-00234 | B-XMR-R-2C3 | POWER TRANSFORMER 6.6/3 KV | (3M)-RCM Visual Inspection | IM | 11/1/2024 | |
| 20240110 | 812-C-00076 | B-AT-432020 | BUTADIENE IR | (2M)SET & CALIBRATE | PM | 10/1/2024 | |
| 20240110 | 812-C-00670 | B-AT-430303 | BUTENE-1 CGC | (1M)SET&CALIBRATE | PM | 10/1/2024 | |
| 20240110 | 812-C-00030 | B-AT-430601 | BUTENE-1 IR | (2M)SET & CALIBRATE | PM | 10/1/2024 | |
| 20240110 | 813-S-00013 | B-BU-2M1 | BATTERY UNIT FOR UPS BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 813-S-00014 | B-BU-2M2 | BATTERY UNIT FOR UPS BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 813-S-00015 | B-BU-2M3 | BATTERY UNIT FOR 110 VDC BANK-1 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 813-S-00016 | B-BU-2M4 | BATTERY UNIT FOR 110 VDC BANK-2 SUB.7 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00052 | B-BU-9C-110 | BATTERY UNIT FOR 110VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00053 | B-BU-9C-110-1 | BATTERY UNIT FOR 110VDC SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00056 | B-BU-9C-124 | BATTERY UNIT FOR 240VDC SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00054 | B-BU-9C-111 | BATTERY UNIT FOR 110VDC SUB.2 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00055 | B-BU-9C-110 | BATTERY UNIT FOR 110VDC SUB PROCESS | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00057 | B-BU-DC | BATTERY UNIT FOR 110VDC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00058 | B-BU-UPS | BATTERY UNIT FOR 220VAC SUB.5 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00059 | B-BU-UPS-1 | BATTERY UNIT FOR 220VAC BANK-1 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00062 | B-BU-UPS-3 | BATTERY UNIT FOR 220VAC BANK-2 SUB.6 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00060 | B-BU-UPS1-1 | BATTERY UNIT FOR 220VAC UPS1 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 890-S-00061 | B-BU-UPS2-1 | BATTERY UNIT FOR 220VAC UPS2 SUB.1 | (1M)VISUAL INSPECTION AND RECORD | PM | 10/1/2024 | |
| 20240110 | 813-C-00061 | B-CAN-GRP | Grouping for Camera GRP | (3M)FUNCTION TEST&EXERCISE | PM | 10/1/2024 | |
| 20240110 | 819-C-00057 | B-G-1122-P-A-1A | HIGH PRESSURE AIR COMPRESSOR | (30)LUBE OIL SAMPLING | PM | 10/1/2024 | Compressor |
| 20240110 | 819A-C-00057 | B-G-1122-R-15 | HIGH PRESSURE AIR COMPRESSOR | (30)LUBE OIL SAMPLING | PM | 10/1/2024 | Compressor |
| 20240110 | 8060-C-00049 | B-G-1122-V-1 | VAPOR SCRUBBER | (3M) CONDITION CHECK (OSL 2020-055) | IM | 10/1/2024 | |
| 20240110 | 8097-C-00001 | B-G-3100 | ELEVATOR | (1M)INSPECTION AND FUNCTION TEST | PM | 10/1/2024 | |
| 20240110 | 8W5-S-00027 | B-HYDRAULIC-V1 | HYDRAULIC STATIC PRESS. 30 T | (1M)LUBRICATION & INSPECTION | PM | 10/1/2024 | |
| 20240110 | 810E-C-00052 | B-M-150 | STEAM DRUM | (3M) CONDITION CHECK (OSL 2023-278) | IM | 10/1/2024 | |
| 20240110 | 8075-C-00002 | B-MOTOR-EO-003 | GROUPING FOR MOTORS CONSOLE#5 | (1M)CLEANING | PM | 10/1/2024 | Motor |
| 20240110 | 812-C-00768 | B-NONE-OLEFINS-P3 | Equipment Non Olefins Plant 1-4/3 | (3M) CONDITION CHECK (OSL 2023-280) | IM | 10/1/2024 | |
| 20240110 | 890-C-00168 | B-OSG15 | GROUPING FOR 115KV GIS | (1M)VISUAL INSPECT&RECORD DATA | PM | 10/1/2024 | |
| 20240110 | 8060-C-00049 | B-P-1123A | SULFURIC ACID TRANSFER PUMP | (3M) CONDITION CHECK (OSL 2020-054) | IM | 10/1/2024 | Pump |
| 20240110 | 800C-C-00090 | B-P-1173A | DECANTER FEED PUMP | (1Y)LUBRICATION | PM | 10/1/2024 | Pump |
| 20240110 | 800C-C-00091 | B-P-1173S | DECANTER FEED PUMP | (1Y)LUBRICATION | PM | 10/1/2024 | Pump |
| 20240110 | 8075-C-00068 | B-H-370A | H-8 PROSOR, CONDENSATE PUMP | (3M) CONDITION CHECK (OSL 2020-052) | IM | 10/1/2024 | Pump |
| 20240110 | 815A-C-00057 | B-P-3801S | BPM PUMP | (30)LUBE OIL SAMPLING | PM | 10/1/2024 | Pump |
| 20240110 | 815A-C-00057 | B-P-901A | SHF BOILER FEED WATER PUMP | (30)LUBE OIL SAMPLING | PM | 10/1/2024 | Pump |
| 20240110 | 815A-C-00057 | B-P-901B | SHF BOILER FEED WATER PUMP | (30)LUBE OIL SAMPLING | PM | 10/1/2024 | Pump |

| | | | | | | | |
|----------|---------------|--------------------|--|--|----|----------|--------------|
| 20240105 | B60-C-00060 | B-G-1122-P-6 | DRAIN PUMP | (3M)LUBRICATE | PM | 5/1/2024 | |
| 20240105 | B061-C-00017 | B-G-1144-P-2A | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 5/1/2024 | |
| 20240105 | B061-C-00017 | B-G-1144-P-2B | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 5/1/2024 | |
| 20240105 | B061-C-00017 | B-G-1144-P-2S | SLUDGE RETURN PUMP | (1W)CLEAN STRAINER FOR B-G-1144-P-2 | PM | 5/1/2024 | |
| 20240105 | B12-C-00056 | B-GS-2F-1 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 5/1/2024 | |
| 20240105 | B90-C-00005 | B-GS-2F5 | DIESEL ENGINE GENERATOR SET MOTOR | (1W)FUNCTION TEST & EXERCISE | PM | 5/1/2024 | |
| 20240105 | B90-C-00075 | B-GS-3A4 | DIESEL ENGINE GENERATOR SET | (1W)FUNCTION TEST & EXERCISE | PM | 5/1/2024 | |
| 20240105 | B031-C-00021 | B-L-740A | GH2 2ND STAGE HYDROGENATION REACTOR | (3M) CONDITION CHECK (OSL 2021-112) | IM | 5/1/2024 | |
| 20240105 | B43C-C-00010 | B-MC-600-A-1S | LUBE OIL PUMP MOTOR | RCM-(3M)REGREASE | PM | 5/1/2024 | |
| 20240105 | B90-C-00142 | B-MOTOR-GR-CCTV-P1 | GROUP TAG FOR MONITOR CCTV SYSTEM | (3M) FUNCTION TEST & EXERCISE | PM | 5/1/2024 | |
| 20240105 | B43C-C-00010 | B-MR-600-P-4A | C2R OIL PURIFIER PUMP MOTOR | RCM-(3M)REGREASE | PM | 5/1/2024 | |
| 20240105 | B43C-C-00008 | B-MR-600-P-4A | C2R OIL PURIFIER PUMP MOTOR | RCM-(1M)VISUAL CHECK | PM | 5/1/2024 | |
| 20240105 | B061-C-00019 | B-P-1132A | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 5/1/2024 | Pump |
| 20240105 | B061-C-00019 | B-P-1132S | CPI FEED PUMP | (1W)CLEAN STRAINER FOR B-P-1132 | PM | 5/1/2024 | Pump |
| 20240105 | B061-C-00018 | B-P-1136A | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 5/1/2024 | Pump |
| 20240105 | B061-C-00018 | B-P-1136S | DGF EFFLUENT TRANSFER PUMP | (1W)CLEAN STRAINER FOR B-P-1136 | PM | 5/1/2024 | Pump |
| 20240105 | B61-C-00119 | B-P-1143A | CONTAMINATED WATER TRANSFER PUMP | (1V)LUBRICATION | PM | 5/1/2024 | Pump |
| 20240105 | B12-C-00088 | B-P-4071S | SOLVENT INHIBITOR (NANO2) DOSING PUMP | (1V) CHANGE GEAR OIL AND HYDRAULIC OIL | PM | 5/1/2024 | Pump |
| 20240105 | B12-C-00090 | B-P-4072S | ANTIFOAM INHIBITOR DOSING PUMP | (1V) CHANGE GEAR OIL AND HYDRAULIC OIL | PM | 5/1/2024 | Pump |
| 20240105 | B12-C-00092 | B-P-4073S | ANTIFOAM AGENT DOSING PUMP | (1V) CHANGE GEAR OIL AND HYDRAULIC OIL | PM | 5/1/2024 | Pump |
| 20240105 | B10A-S-00001 | B-R-110 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/1/2024 | |
| 20240105 | B10B-S-00001 | B-R-120 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/1/2024 | |
| 20240105 | B10C-S-00001 | B-R-130 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/1/2024 | |
| 20240105 | B10D-S-00001 | B-R-140 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/1/2024 | |
| 20240105 | B10E-S-00001 | B-R-150 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/1/2024 | |
| 20240105 | B10F-S-00001 | B-R-160 | FURNACE ID FAN | RCM-(1M)INSPECT & LUBRICATE | PM | 5/1/2024 | |
| 20240105 | B43C-C-00008 | B-MR-600-P-4A | LUBE OIL PURIFIER | RCM-(1M)VISUAL INSPECTION | PM | 5/1/2024 | |
| 20240105 | B05A-C-00007 | B-T-269 | DILUTION STEAM GENERATOR FEED EATER | (3M) CONDITION CHECK (OSL 2021-111) | IM | 5/1/2024 | |
| 20240105 | B05B-C-00001 | B-UPSI-A1 | UPS(A) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/1/2024 | |
| 20240105 | B05C-C-00025 | B-UPSI-A2 | UPS(BYPASS) FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/1/2024 | |
| 20240105 | B05D-C-00096 | B-UPSI-A3 | UPS2 FOR SUBSTATION NO.5 | (1M) Inspect & Condition Check | PM | 5/1/2024 | |
| 20240104 | B13-C-00053 | B-CAP-1M1 | POWER CAPACITOR PANEL-1 | (1M)VISUAL INSPECTION | PM | 4/1/2024 | |
| 20240104 | B13-C-00054 | B-CAP-1N1 | POWER CAPACITOR PANEL-2 | (1M)VISUAL INSPECTION | PM | 4/1/2024 | |
| 20240104 | BNA-C-00062 | B-CRIT-EG-COLD-P2 | Critical Equipments Cold Area Plant 2 | (2W)Visual & Condition Inspection | PM | 4/1/2024 | |
| 20240104 | B-EHT-C-00057 | B-EHT-001 | ELECTRICAL HEAT TRACING CONTROL PANEL | (1M)VISUAL INSPECTION | PM | 4/1/2024 | |
| 20240104 | B053-C-00004 | B-TF-22201 | IP-2213 DISCH. | (3M) CONDITION CHECK (OSL 2021-071) | IM | 4/1/2024 | |
| 20240104 | B050-C-00036 | B-G-1122-T-1A | REF/EFFLUENT HEAT EXCHANGER | (1V)PM CLEANING | PM | 4/1/2024 | |
| 20240104 | B050-C-00036 | B-G-1122-T-1S | REF/EFFLUENT HEAT EXCHANGER | (1V)PM CLEANING | PM | 4/1/2024 | |
| 20240104 | B39-C-00115 | B-GAS-DETECTOR-G1 | GROUPING TAGS FOR GAS DETECTOR GROUP NO. | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | Gas Detector |
| 20240104 | B38-C-00115 | B-GE-13032 | HP Flare Drum Pump (P-1303 A/S) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | Flare |
| 20240104 | B38-C-00115 | B-GE-13033 | HP Flare Drum Pump (P-1303 A/S) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | Flare |
| 20240104 | B38-C-00115 | B-GE-13034 | HP Flare Drum (M-1303) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | Flare |
| 20240104 | B38-C-00115 | B-GE-13035 | HP Flare Drum Pump (P-1303 A/S) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | Flare |
| 20240104 | B38-C-00115 | B-GE-13041 | HP Flare Liquid Seal Drum (M-1304) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | Flare |
| 20240104 | B38-C-00115 | B-GE-13042 | HP Flare Liquid Seal Drum (M-1304) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | Flare |
| 20240104 | B38-C-00115 | B-GE-15501 | Mixed C4 Heater (T-1550) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | |
| 20240104 | B38-C-00115 | B-GE-15511 | Hydrocarbon Pump (P-1553B) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | |
| 20240104 | B38-C-00115 | B-GE-15701 | Uprtg Naptha Supply Pump (P-1570 A/B/S) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | |
| 20240104 | B38-C-00115 | B-GE-15711 | Cranker Bottom Export Pump (P-1571A/S) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | |
| 20240104 | B38-C-00115 | B-GE-15712 | Fresh Air Intake (Mounting type) | (4M)GAS DETECTOR PLANT1(OUT-SOURCE) | PM | 4/1/2024 | |

| | | | | | | | |
|----------|--------------|--------------------|---|-------------------------------------|----------|----------|---------|
| 20240104 | B11-C-00076 | B-V-3905-P-1A | ANTI FOULANT INJECTION PUMPS | (1V)LUBRICATION | PM | 4/1/2024 | |
| 20240104 | B11-C-00077 | B-V-3905-P-1S | ANTI FOULANT INJECTION PUMPS | (1V)LUBRICATION | PM | 4/1/2024 | |
| 20240103 | B53-C-00037 | B-AT-21177 | ISO14000 PH DISCHARGE LINE G-2217-P-4A/B | (1M)SET&CALIBRATE | PM | 3/1/2024 | |
| 20240103 | B12-C-00063 | B-AT-400001 | 1, 3, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100, 101, 102, 103, 104, 105, 106, 107, 108, 109, 110, 111, 112, 113, 114, 115, 116, 117, 118, 119, 120, 121, 122, 123, 124, 125, 126, 127, 128, 129, 130, 131, 132, 133, 134, 135, 136, 137, 138, 139, 140, 141, 142, 143, 144, 145, 146, 147, 148, 149, 150, 151, 152, 153, 154, 155, 156, 157, 158, 159, 160, 161, 162, 163, 164, 165, 166, 167, 168, 169, 170, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794, 795, 796, 797, 798, 799, 800, 801, 802, 803, 804, 805, 806, 807, 808, 809, 810, 811, 812, 813, 814, 815, 816, 817, 818, 819, 820, 821, 822, 823, 824, 825, 826, 827, 828, 829, 830, 831, 832, 833, 834, 835, 836, 837, 838, 839, 840, 841, 842, 843, 844, 845, 846, 847, 848, 849, 850, 851, 852, 853, 854, 855, 856, 857, 858, 859, 860, 861, 862, 863, 864, 865, 866, 867, 868, 869, 870, 871, 872, 873, 874, 875, 876, 877, 878, 879, 880, 881, 882, 883, 884, 885, 886, 887, 888, 889, 890, 891, 892, 893, 894, 895, 896, 897, 898, 899, 900, 901, 902, 903, 904, 905, 906, 907, 908, 909, 910, 911, 912, 913, 914, 915, 916, 917, 918, 919, 920, 921, 922, 923, 924, 925, 926, 927, 928, 929, 930, 931, 932, 933, 934, 935, 936, 937, 938, 939, 940, 941, 942, 943, 944, 945, 946, 947, 948, 949, 950, 951, 952, 953, 954, 955, 956, 957, 958, 959, 960, 961, 962, 963, 964, 965, 966, 967, 968, 969, 970, 971, 972, 973, 974, 975, 976, 977, 978, 979, 980, 981, 982, 983, 984, 985, 986, 987, 988, 989, 990, 991, 992, 993, 994, 995, 996, 997, 998, 999, 1000 | PM | 3/1/2024 | | |
| 20240103 | B12-C-00067 | B-AT-404801 | BUTADIENE GCG | (1M)SET&CALIBRATE | PM | 3/1/2024 | |
| 20240103 | B007-C-00003 | B-AT-9211 | ISO14000, SUMP Q-920 TO Q-1145 | (1M)SET&CALIBRATE | PM | 3/1/2024 | |
| 20240103 | B90-C-00002 | B-E-F-11 | MASTER FIRE ALARM PANEL AT NEW CCB CONTR | (1M)CO2 SYSTEM CHECK | PM | 3/1/2024 | |
| 20240103 | B90-C-00002 | B-E-F-12 | LOCAL FIRE ALARM PANEL AT SUB.2 | (1M)CO2 SYSTEM CHECK | PM | 3/1/2024 | |
| 20240103 | B90-C-00002 | B-E-F-13 | LOCAL FIRE ALARM PANEL AT SUB.PROCESS | (1M)CO2 SYSTEM CHECK | PM | 3/1/2024 | |
| 20240103 | B061-S-00010 | B-G-1144-A-2A | FINAL CLARIFIER AGITATOR | RCM-(3M)INSPECTION | IM | 3/1/2024 | |
| 20240103 | BNA-C-00051 | B-GC-1M | GROUPING FOR PM GC 1 Month | (1M)SET & CALIBRATION | PM | 3/1/2024 | |
| 20240103 | B43C-C-00021 | B-MOTOR-GR-CCTV-P1 | GROUP TAG FOR MONITOR CCTV SYSTEM | (3M) FUNCTION TEST & EXERCISE | PM | 3/1/2024 | |
| 20240103 | B006-C-00064 | B-M-19020 | GROUPING TAG FOR FUEL GAS CUSTODY TO TIG | (1M)UPDATE M2, CO2, REL. DENSITY | PM | 3/1/2024 | |
| 20240103 | B030-C-00009 | B-MCC-SUB1 | MCC FOR PLUG-IN MCCB | (2M)Thermoscan & Inspection | IM | 3/1/2024 | |
| 20240103 | B003-C-00028 | B-MCC-TANK | MCC FOR PLUG-IN MCCB | (2M)Thermoscan & Inspection | IM | 3/1/2024 | |
| 20240103 | B002-C-00002 | B-MCC-WASTE | MCC FOR PLUG-IN MCCB | (2M)Thermoscan & Inspection | IM | 3/1/2024 | |
| 20240103 | B90-C-00177 | B-MOTOR-B1-12378C | MOTOR GROUPING FOR B1-BC | (1M)CLEANING & INSPECTION | PM | 3/1/2024 | Motor |
| 20240103 | B90-C-00180 | B-MOTOR-B1-7A | MOTOR GROUPING FOR B1-A | (1M)CLEANING AND INSPECTION. | PM | 3/1/2024 | Motor |
| 20240103 | B90-C-00174 | B-MOTOR-BE-0A | MOTOR GROUPING FOR BEU-A | (1M)CLEANING & INSPECTION | PM | 3/1/2024 | Motor |
| 20240103 | B90-C-00183 | B-MOTOR-BE-0BC | MOTOR GROUPING FOR BEU-BC | (1M)CLEANING AND INSPECTION. | PM | 3/1/2024 | Motor |
| 20240103 | B90-C-00186 | B-MOTOR-OSBL-8BC | MOTOR GROUPING FOR OSBL-8C | (1M)CLEANING AND INSPECTION. | PM | 3/1/2024 | Motor |
| 20240103 | B90-C-00250 | B-SD-BC-1 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.1 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B90-C-00250 | B-SD-BC-2 | DISTRIBUTION PANEL OF BC BOARD SUBS NO.2 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B90-C-00251 | B-SD-BC-2M1 | DISTRIBUTION PANEL OF BC 110VDC SUB.7 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B90-C-00250 | B-SD-BC-4 | DISTRIBUTION PANEL OF BC BOARD SUB.4 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B90-C-00251 | B-SD-BC-5A2 | DISTRIBUTION PANEL OF BC BOARD SUB.1 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B48-C-00015 | B-SD-BV | SUBDISTRIBUTION GROUPING FOR BV | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B009-C-00011 | B-SD-F1 | DISTRIBUTION PANEL OF BC 110VDC SUB.6 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B009-C-00011 | B-SD-F2 | DISTRIBUTION PANEL OF BC 220VAC SUB.6 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B009-C-00011 | B-SD-F9 | DISTRIBUTION PANEL OF BC 24VDC SUB.6 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B90-C-00251 | B-SD-UPS-2M1 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B90-C-00251 | B-SD-UPS-2M2 | DISTRIBUTION PANEL OF UPS 220VAC SUB.7 | (1M)INSPECTION | PM | 3/1/2024 | |
| 20240103 | B11-C-00059 | B-UPS-2EF-BV | GROUPING FOR UPS 220 VAC | (3M)TEST & ADJUST | PM | 3/1/2024 | |
| 20240103 | B063-C-00044 | B-DV-1508 | DIETHYL PREFER A-110 DELUGE VALVE | (3M) CONDITION CHECK (OSL 2023-287) | IM | 2/1/2024 | |
| 20240102 | B024-C-00162 | B-CV-1612 | C-13 CYCLE PUMPS DELUGE VALVE | (3M) CONDITION CHECK (OSL 2023-294) | IM | 2/1/2024 | |
| 20240102 | B063-C-00032 | B-DV-1522 | ETHYLENE PRODUCT PUMPS DELUGE VALVE | (6M)LUBRICATION & INSPECTION | PM | 2/1/2024 | |
| 20240102 | B063-C-00033 | B-DV-16501 | DELUGE VALVE FOR M-572A, R-575A | (6M)LUBRICATION & INSPECTION | PM | 2/1/2024 | |
| 20240102 | B11-C-00037 | B-DV-1566 | DELUGE VALVE FOR SUB#5/TRKT 1A | (6M)LUBRICATION & INSPECTION | PM | 2/1/2024 | |
| 20240102 | B11-C-00037 | B-DV-1567 | DELUGE VALVE FOR SUB#5/TRKT 2A | (6M)LUBRICATION & INSPECTION | PM | 2/1/2024 | |
| 20240102 | B10C-C-00254 | B-F-150 | USE FURNACES | (3M) CONDITION CHECK (OSL 2023-289) | IM | 2/1/2024 | Furnace |
| 20240102 | B060-C-00060 | B-G-1112-L-1 | OXIDATION REACTOR | (3M) CONDITION CHECK (OSL 2023-290) | IM | 2/1/2024 | |
| 20240102 | B61-S-00056 | B-G-1164 | CPI SLUDGE MIXER | (6M)EXERCISE INSPECT | PM | 2/1/2024 | |
| 20240102 | B52B-C-00144 | B-G-1202A | COILING TOWER SIDE STREAM FILTER | (3M) CONDITION CHECK (OSL 2023-288) | IM | 2/1/2024 | |
| 20240102 | B007-C-00078 | B-G-920-Q-1 | SULFURIC ACID TANKS | (3M) CONDITION CHECK (OSL 2023-292) | IM | 2/1/2024 | |
| 20240102 | B007-C-00078 | B-G-920-Q-2 | COMPENSATE POLYISHERS | (3M) CONDITION CHECK (OSL 2023-295) | IM | 2/1/2024 | |
| 20240102 | B4HY-1505 | B-4HY-1505 | HYDRANT AREA TEMP FACILITY | (6M)LUBRICATION | PM | 2/1/2024 | |
| 20240102 | B063-C-00039 | B-4HY-1506 | HYDRANT AREA TEMP FACILITY | (6M)LUBRICATION | PM | 2/1/2024 | |
| 20240102 | B063-C-00039 | B-4HY-1507 | HYDRANT AREA TEMP FACILITY | (6M)LUBRICATION | PM | 2/1/2024 | |
| 20240102 | B063-C-00039 | B-4HY-1508 | HYDRANT AREA TEMP FACILITY | (6M)LUBRICATION | PM | 2/1/2024 | |
| 20240102 | B063-C-00039 | B-4HY-1509 | HYDRANT AREA TEMP FACILITY | (6M)LUBRICATION | PM | 2/1/2024 | |

| | | | | | | | |
|----------|---------------|----------------|--|--|----|-----------|------------|
| 20240101 | B11-C-00067 | B-P-3403S | ETHYLENE RECOVERY TOWER BOTTOMS PUMPS | (1M) REGREASE to Bearing Mechanical Seal | PM | 1/1/2024 | Pump |
| 20240101 | B58-C-00021 | B-PCV-1502S | N2 TO M-1502 | (3Y) INSPECTION & CALIBRATE | PM | 1/1/2024 | |
| 20240101 | BNA-C-00090 | B-PM-4910S | BUTENE-1 PRODUCT TRANSFER PUMP MOTOR | (3M) INSPECTION | PM | 1/1/2024 | Motor |
| 20240101 | B145-C-00002 | B-Q-3101 | AQ. AMMONIA STORAGE TANK | (4M) SET&CALIBRATE | PM | 1/1/2024 | |
| 20240101 | B60A-C-00001 | B-R-3801 | EXPORT FUEL GAS COMPRESSOR | (3M) LUBE OIL SAMPLING | PM | 1/1/2024 | Compressor |
| 20240101 | B60A-C-00002 | B-R-3802 | EXPORT FUEL GAS COMPRESSOR | (3M) LUBE OIL SAMPLING | PM | 1/1/2024 | Compressor |
| 20240101 | B12-C-00065 | B-R-4031 | RECYCLE GAS COMPRESSOR | (3M) VIBRATION CHECK | IM | 1/1/2024 | Compressor |
| 20240101 | B12-C-00066 | B-R-4301 | BUTENE-1 FRACTIONATOR COMPRESSOR | (3M) VIBRATION CHECK | IM | 1/1/2024 | Compressor |
| 20240101 | BNA-C-00021 | B-SECUR-TASK05 | FOR PM TEST FIRE PUMP | (1W) INSPECTION | PM | 1/1/2024 | |
| 20240101 | BNA-C-00033 | B-SECUR-TASK48 | FOR PM : INSPECTION FM-200 SYSTEMS | (1M) Visual Inspection FM-200 system (RA | PM | 1/1/2024 | |
| 20240101 | B00-C-00068 | B-SECUR-TASK31 | Smoke / Heat detector system : Control a | (1M) Visual Inspection | PM | 1/1/2024 | |
| 20240101 | B32-C-00069 | B-SM-0307 | HAND HELD DI MULTIMETER | (1Y) CALIBRATION HANDHELD DI MULTIMETER | PM | 1/1/2024 | |
| 20240101 | B32-C-00075 | B-SM-03/11 | RMS MULTIMETER | (1Y) CALIBRATION RMS MULTIMETER | PM | 1/1/2024 | |
| 20240101 | B32-C-00076 | B-SM-03/12 | TRUE RMS MULTIMETER | (1Y) CALIBRATION RMS MULTIMETER | PM | 1/1/2024 | |
| 20240101 | B32-C-00080 | B-SM-03/13 | RMS MULTIMETER | (1Y) CALIBRATION RMS MULTIMETER | PM | 1/1/2024 | |
| 20240101 | B32-C-00061 | B-SP-05/01 | PORTABLE DI PRESSCAL(H) | (1Y) CAL. PORT. DI.PRESS (H)(OUT-SOURCE) | PM | 1/1/2024 | |
| 20240101 | B32-C-00009 | B-SP-06/03 | PORTABLE PNEUMATIC PRESSURE CALIBRATOR | (1Y) CAL.PORT. PNEUMATIC PRESS(OUT-SOURCE) | PM | 1/1/2024 | |
| 20240101 | B32-C-00074 | B-SP-11/01 | PORTABLE HAND PUMP | (1Y) CAL. PORTABLE HAND PUMP(OUT-SOURCE) | PM | 1/1/2024 | |
| 20240101 | B06A-C-00005 | B-T-269 | DILUTION STEAM GENERATOR FEED EATER | (3M) CONDITION CHECK (OSL 2020-030) | IM | 1/1/2024 | |
| 20240101 | BC35-C-00003 | B-XV-4008 | PRESSURE SWING ADSORPTION UNIT NO. 2 | (3M) INSPECTION | IM | 1/1/2024 | |
| 20240101 | BC35-C-00004 | B-XV-400C | PRESSURE SWING ADSORPTION UNIT NO. 3 | (3M) INSPECTION | IM | 1/1/2024 | |
| 20240101 | BC35-S-00001 | B-XV-4613 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00001 | B-XV-4613 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00002 | B-XV-4615 | PSA 2 SEQ.: E1/R1 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00002 | B-XV-4615 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00003 | B-XV-4623 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00003 | B-XV-4623 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00004 | B-XV-4625 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00004 | B-XV-4625 | PSA 2 SEQ.: E1/R1 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00005 | B-XV-4633 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00005 | B-XV-4633 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00006 | B-XV-4635 | PSA 2 SEQ.: E1/R1 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00006 | B-XV-4635 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00007 | B-XV-4643 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00007 | B-XV-4643 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00008 | B-XV-4645 | PSA 2 SEQ.: E1/R1 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00008 | B-XV-4645 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00009 | B-XV-4653 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20240101 | BC35-S-00009 | B-XV-4653 | PSA 2 SEQ.: PP1/P1, PP2/P2 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00010 | B-XV-4655 | PSA 2 SEQ.: E1/R1 | (3M) Basic Inspection | PM | 1/1/2024 | |
| 20240101 | BC35-S-00010 | B-XV-4655 | PSA 2 SEQ.: E1/R1 | (6M) Basic Maintenance | PM | 1/1/2024 | |
| 20231121 | B17-S-00001 | B-PT-250S | DILUTION STEAM GENERATION PUMP TURBINE | (1Y) OVER SPEED TRIP TEST | PM | 25/1/2024 | |
| 20231120 | B17-S-00004 | B-PT-250S | DILUTION STEAM GENERATION PUMP TURBINE | (3Y) OVERHAUL TURBINE | PM | 22/1/2024 | |
| 20230904 | B16-S-00006 | B-PT-220A | QUENCH WATER CIRCULATION PUMP TURBINE | (4Y) OVERHAUL TURBINE | PM | 15/1/2024 | |
| 20211101 | B47A1-C-00039 | B-Q-1530 | ETHYLENE PRODUCT STORAGE TANK | (5Y) INSPECTION BY LAW (EXCISE) | IM | 3/6/2024 | |

ภาคผนวก ข.13

ระเบียบปฏิบัติงานเพื่อลดการระบายออกของสารไฮโดรคาร์บอน



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

Plant Operation I

P-(O-P2-OP1)-042


ขั้นตอนการดำเนินงานการควบคุมคุณภาพอากาศ (Air Emission)

Internal Use Only



| |
|------------|
| ชื่อเอกสาร |
| |

Internal Use Only

| | | |
|---|--|--|
|  | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | P-(O-P2-OP1)-042: ขั้นตอนการดำเนินงานการควบคุมคุณภาพอากาศ (Air Emission) |
|---|--|--|



Internal Use Only

Internal Use Only

Internal Use Only

Internal Use Only

Internal Use Only



ประกาศใช้ครั้งที่ 1 หน้า 5 จาก 7 วันที่มีผลบังคับใช้: 27/04/2021

เอกสารนี้เป็นความลับ และควรใช้เฉพาะภายในองค์กรเท่านั้น บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) และบริษัทในเครือฯ ห้ามเผยแพร่
ข้อมูลใดๆ ต่อผู้ภายนอก เว้นแต่โดยความลับที่ได้รับอนุญาตโดยไม่มีเงื่อนไข



ประกาศใช้ครั้งที่ 1 หน้า 7 จาก 7 วันที่มีผลบังคับใช้: 27/04/2021

เอกสารนี้เป็นความลับ และควรใช้เฉพาะภายในองค์กรเท่านั้น บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) และบริษัทในเครือฯ ห้ามเผยแพร่
ข้อมูลใดๆ ต่อผู้ภายนอก เว้นแต่โดยความลับที่ได้รับอนุญาตโดยไม่มีเงื่อนไข



Internal Use Only

ประกาศใช้ครั้งที่ 1 หน้า 6 จาก 7 วันที่มีผลบังคับใช้: 27/04/2021

เอกสารนี้เป็นความลับ และควรใช้เฉพาะภายในองค์กรเท่านั้น บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) และบริษัทในเครือฯ ห้ามเผยแพร่
ข้อมูลใดๆ ต่อผู้ภายนอก เว้นแต่โดยความลับที่ได้รับอนุญาตโดยไม่มีเงื่อนไข

ภาคผนวก ข.14

WI การควบคุมระบบ Blow Down และระบบ Flare




บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

Plant Operation I

W-(O-P2-OP1)-510

วิธีปฏิบัติงานการควบคุมระบบ Blow Down และระบบ Flare (S-1300)

| | | |
|---|---|--|
|  | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP1)-510: วิธีปฏิบัติงานการควบคุม ระบบ Blow Down และระบบ Flare (S-1300) |
|---|---|--|



Internal Use Only

3. หน้าที่และความรับผิดชอบ

Internal Use Only



Internal Use Only

4. WORKFLOW

Internal Use Only



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

W-(O-P2-OP1)-S10: วิธีปฏิบัติงานการควบคุมระบบ Blow Down และระบบ Flare (S-1300)



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

W-(O-P2-OP1)-S10: วิธีปฏิบัติงานการควบคุมระบบ Blow Down และระบบ Flare (S-1300)



Internal Use

ภาคผนวก ข.15

WI การ Monitor และ Record ระบบ Flare Loss




บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

Plant Operation I

W-(O-P2-OP1)-518

วิธีปฏิบัติงานการ Monitor และ Record ระบบ Flare Loss



| | | |
|---|--|--|
|  | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP1)-518: วิธีปฏิบัติงานการ Monitor และ Record ระบบ Flare Loss |
|---|--|--|





Internal Use Only

3. หน้าที่และความรับผิดชอบ

Internal Use Only

2. ขอบเขต

-

Internal Use Only

4. WORKFLOW

Internal Use Only



Internal Use Only

ภาคผนวก ข.16

แผนงานอาชีพอนามัยและสิ่งแวดล้อม ประจำปี พ.ศ.2567




แผนการจัดการด้านอาชีวอนามัย ความปลอดภัย สิ่งแวดล้อม และความต่อเนื่องทางธุรกิจ (SHEBMP) ประจำปี 2567
สายงาน _____ โอเลฟินส์ _____


วัตถุประสงค์ : ดูแลสุขภาพพนักงาน สร้างวัฒนธรรมความปลอดภัย ป้องกันการเกิดอุบัติเหตุ รวมถึงอุบัติเหตุในกระบวนการผลิต (Process Safety Event)
โดยเน้นการจัดการระบบความปลอดภัยแบบบูรณาการ (Safety Integration) ป้องกันผลกระทบต่อสิ่งแวดล้อม และรักษาความต่อเนื่องในการดำเนินธุรกิจของบริษัทฯ

เป้าหมาย :

- (1) Personal Safety Target: TRIR ไม่เกิน 0.09 ราย ต่อ 2 แสนชั่วโมงการทำงาน
- (2) Process Safety Target: Process Safety Event Tier 1 = 0 Case
- (3) Health Performance Index (HPI): GCMS Score \geq 3.3
- (4) Environmental Target: Community Complaint = 0 Case
- (5) Security Target: Significant Security Case = 0 Case










ภาคผนวก ข.17

แผนการจัดการและควบคุม VOCs


3) มีมาตรการ/การดำเนินการแก้ไขจุดรั่วซึมและการบำรุงรักษา และ มีการเฝ้าระวังการรั่วซึมของ VOCs

มาตรการลดและควบคุม VOCs จาก Fugitive Sources

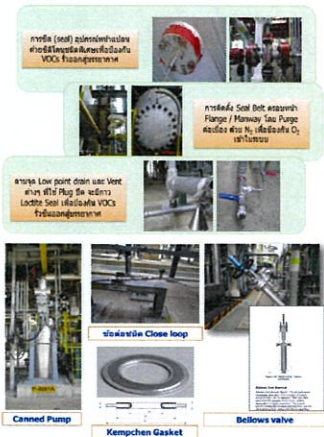

มาตรการลดและควบคุม VOCs จาก Wastewater

- Wastewater treatment is aeration system with pre-treatment unit

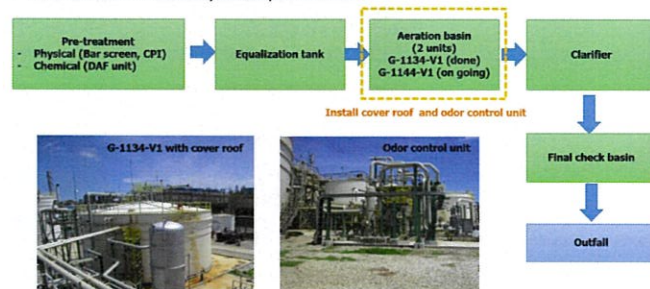

ภาคผนวก ข.18

รายงานปริมาณ VOCs จากการรั่วซึมของอุปกรณ์ในโรงงานแบบ รว.3/1



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

สำนักงานใหญ่ : เลขที่ 655/1 ถนนพหลโยธิน แขวงพหลโยธิน อ.บางเขน จ.นนทบุรี 11000 โทรศัพท์ +66(0)2265-8400 โทรสาร +66(0)2265-8500
สำนักงานระยอง : เลขที่ 59 ถนนพหลโยธิน ตำบลเนินพระ อำเภอเมืองระยอง จ.ระยอง 21150
โทรศัพท์ +66(0)3889-4000 โทรสาร +66(0)3889-4111
บมจ. เลขที่ 0107554000267



บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

สำนักงานใหญ่ : เลขที่ 655/1 ถนนพหลโยธิน แขวงพหลโยธิน อ.บางเขน จ.นนทบุรี 11000 โทรศัพท์ +66(0)2265-8400 โทรสาร +66(0)2265-8500
สำนักงานระยอง : เลขที่ 59 ถนนพหลโยธิน ตำบลเนินพระ อำเภอเมืองระยอง จ.ระยอง 21150
โทรศัพท์ +66(0)3889-4000 โทรสาร +66(0)3889-4111
บมจ. เลขที่ 0107554000267

ที่ 08-Q-SH - 004/2568

29 มกราคม 2568

เรื่อง การส่งแบบรายงานผลการตรวจวัดการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์และการซ่อมแซมอุปกรณ์
ในโรงงานอุตสาหกรรม(ร.ว.3/1)

เรียน ผู้อำนวยการนิคมอุตสาหกรรมมาบตาพุด

อ้างถึง ประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนด หลักเกณฑ์ และวิธีการปฏิบัติในการตรวจสอบและ
ควบคุมการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์ ในโรงงานอุตสาหกรรม พ.ศ. ๒๕๕๕

สิ่งที่ส่งมาด้วย แบบรายงานผลการตรวจวัดการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์และการซ่อมแซม
อุปกรณ์ในโรงงานอุตสาหกรรม(ร.ว.3/1) ครั้งที่ 2 ประจำปี 2567

ตามประกาศกระทรวงอุตสาหกรรมที่อ้างถึง กำหนดให้โรงงานอุตสาหกรรมต้องจัดทำบัญชีรายชื่อ
อุปกรณ์พร้อมผลการตรวจวัดและการซ่อมแซมให้เป็นปัจจุบัน โดยรวบรวมจัดทำสรุปตามแบบรายงานที่
กรมโรงงานอุตสาหกรรมกำหนด และจัดส่งให้กรมโรงงานอุตสาหกรรมหรือหน่วยงานที่กำกับดูแลทุก 6
เดือน นั้น

บัดนี้ บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 3 ได้ดำเนินการจัดทำรายงานผลการ
ตรวจวัดการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์ในโรงงานอุตสาหกรรม รอบที่ 2 ประจำปี พ.ศ. 2567
(ระหว่างเดือนกรกฎาคม – ธันวาคม 2567) แล้วเสร็จ โดยมีรายละเอียดดังเอกสารแนบ

จึงเรียนมาเพื่อโปรดพิจารณา

| | |
|------------------------|--------|
| ได้รับเอกสารแล้ว | |
| ลงชื่อ..... | ผู้รับ |
| วันที่รับ 29 / 01 / 68 | |

ขอแสดงความนับถือ



ผู้จัดการสิ่งแวดล้อม

ที่ 08-Q-SH - 004/2568

29 มกราคม 2568

เรื่อง การส่งแบบรายงานผลการตรวจวัดการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์และการซ่อมแซมอุปกรณ์
ในโรงงานอุตสาหกรรม(ร.ว.3/1)

เรียน ผู้อำนวยการนิคมอุตสาหกรรมมาบตาพุด

อ้างถึง ประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนด หลักเกณฑ์ และวิธีการปฏิบัติในการตรวจสอบและ
ควบคุมการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์ ในโรงงานอุตสาหกรรม พ.ศ. ๒๕๕๕

สิ่งที่ส่งมาด้วย แบบรายงานผลการตรวจวัดการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์และการซ่อมแซม
อุปกรณ์ในโรงงานอุตสาหกรรม(ร.ว.3/1) ครั้งที่ 2 ประจำปี 2567

ตามประกาศกระทรวงอุตสาหกรรมที่อ้างถึง กำหนดให้โรงงานอุตสาหกรรมต้องจัดทำบัญชีรายชื่อ
อุปกรณ์พร้อมผลการตรวจวัดและการซ่อมแซมให้เป็นปัจจุบัน โดยรวบรวมจัดทำสรุปตามแบบรายงานที่
กรมโรงงานอุตสาหกรรมกำหนด และจัดส่งให้กรมโรงงานอุตสาหกรรมหรือหน่วยงานที่กำกับดูแลทุก 6
เดือน นั้น

บัดนี้ บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) สาขา 3 ได้ดำเนินการจัดทำรายงานผลการ
ตรวจวัดการรั่วซึมของสารอินทรีย์ระเหยจากอุปกรณ์ในโรงงานอุตสาหกรรม รอบที่ 2 ประจำปี พ.ศ. 2567
(ระหว่างเดือนกรกฎาคม – ธันวาคม 2567) แล้วเสร็จ โดยมีรายละเอียดดังเอกสารแนบ

จึงเรียนมาเพื่อโปรดพิจารณา

ขอแสดงความนับถือ



ผู้จัดการสิ่งแวดล้อม

แบบรายงานผลการตรวจวัดการรั่วซึม ของสารอินทรีย์ระเหยจากอุปกรณ์ และการซ่อมแซมอุปกรณ์ในโรงงานอุตสาหกรรม (รว.3/1)
(1 แบบรายงานต่อ 1 โรงงาน)

ประจำปี พ.ศ. 2567 รอบที่ 2
ระหว่างเดือน กรกฎาคม ถึงเดือน ธันวาคม

| 1. รายละเอียดเกี่ยวกับโรงงาน | | | | | | | |
|--|-----------------------|--------------------------------------|--|--|--|--|---|
| ชื่อโรงงาน บริษัท ทีทีที โกลบอล เคมีคอล จำกัด (มหาชน) | | | | | | | |
| ทะเบียนโรงงานเลขที่ ข.42(1)-10/2536-กนท. | | | | | | | |
| สถานที่ตั้งโรงงาน เลขที่ 9 หมู่ที่ 1 - ซอย - ถนน 10-51 จังหวัด ระยอง เขต/อำเภอ เมืองระยอง แขวง/ตำบล รหัสไปรษณีย์ 21150 | | | | | | | |
| 2. ข้อมูลปริมาณสารอินทรีย์ระเหย | | | | | | | |
| ปริมาณสารอินทรีย์ระเหยรวมที่มีหรือใช้ในกระบวนการผลิต 592798.00 กิโลกรัม | | | | | | | |
| ประเภทอุปกรณ์ | สถานะสารอินทรีย์ระเหย | จำนวนอุปกรณ์ทั้งหมดของโรงงาน | | จำนวนอุปกรณ์ที่ต้องตรวจวัดการรั่วซึมในรอบการรายงานครั้งนี้ | | | ปริมาณสารอินทรีย์ระเหยรวมในรูปมีเทนที่รั่วซึมจากอุปกรณ์ที่ต้องตรวจวัดการรั่วซึมทั้งหมดในรอบการรายงานครั้งนี้ (กิโลกรัม) |
| | | จำนวนอุปกรณ์ที่ต้องตรวจวัดการรั่วซึม | จำนวนอุปกรณ์ที่ได้รับการยกเว้นไม่ต้องตรวจวัดการรั่วซึม | จำนวนอุปกรณ์ที่ต้องตรวจวัดการรั่วซึมทั้งหมด | จำนวนอุปกรณ์ที่มีผลการตรวจวัดเกินจากเกณฑ์การควบคุมการรั่วซึม | จำนวนอุปกรณ์ที่ได้รับการซ่อมแซมให้อยู่ในเกณฑ์การควบคุมการรั่วซึม | |
| | | (จุด) | (จุด) | (จุด) | (จุด) | (จุด) | |
| วาล์ว (Valves) | แก๊ส | 1062 | 93 | 969 | 0 | 0 | 7.64 |
| วาล์ว (Valves) | ของเหลว | 2374 | 111 | 2263 | 0 | 0 | 19.42 |
| ปั๊ม (Pumps) | ของเหลว | 32 | 0 | 32 | 0 | 0 | 2.10 |
| อุปกรณ์ลดความดัน (Pressure Relief Devices) | แก๊ส | 47 | 16 | 31 | 0 | 0 | 2.04 |
| อุปกรณ์ลดความดัน (Pressure Relief Devices) | ของเหลว | 21 | 2 | 19 | 0 | 0 | 1.25 |
| เครื่องอัดอากาศ (Compressors) | ทั้งหมด | 0 | 0 | 0 | 0 | 0 | 0.0 |
| ข้อต่อหรือหน้าแปลน (Connectors or Flanges) | ทั้งหมด | 7055 | 1244 | 5811 | 0 | 0 | 43.07 |
| ท่อส่งปลายเปิด (Open-Ended Lines) | ทั้งหมด | 591 | 7 | 584 | 0 | 0 | 5.19 |
| จุดเก็บตัวอย่างสารเคมี (Sampling Connections) | ทั้งหมด | 25 | 7 | 18 | 0 | 0 | 0.10 |

| | | | | | | | |
|--|---------|---|---|---|---|---|-----|
| อุปกรณ์ที่ใช้ควมหรือผสมของเหลว (Agitators or Mixers) | ทั้งหมด | 0 | 0 | 0 | 0 | 0 | 0.0 |
|--|---------|---|---|---|---|---|-----|

3. ปัญหา อุปกรณ์ และวิธีการแก้ไข

ขอรับรองว่าข้อมูลข้างต้นเป็นจริงทุกประการ

ผู้จัดการสิ่งแวดล้อมหรือผู้ได้รับอนุญาตประกอบกิจการโรงงาน

ภาคผนวก ข.19

WI การป้องกันการระบายสารจากการเก็บตัวอย่างผลิตภัณฑ์





บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)


Plant Operation III


W-(O-P2-OP3)-A985-001


วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B

| | | |
|---|---|--|
|  | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บ ตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|---|---|--|


| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|

| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|

| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|


| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|


4. WORKFLOW

| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|





ประกาศใช้ครั้งที่ 1 หน้า 9 จาก 12 วันที่มีผลบังคับใช้: 10/10/2021
เอกสารฉบับนี้เป็นความลับ และกรรมสิทธิ์ทางกฎหมายเพื่อให้ภายในกลุ่มบริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) และบริษัทในเครือเท่านั้น ห้ามเผยแพร่ ค่าเช่า
สัญญาเช่า ๙๙๙ บาท และค่าเช่าที่ดิน ๙๙๙ บาท

| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|





ประกาศใช้ครั้งที่ 1 หน้า 10 จาก 12 วันที่มีผลบังคับใช้: 10/10/2021
เอกสารฉบับนี้เป็นความลับ และกรรมสิทธิ์ทางกฎหมายเพื่อให้ภายในกลุ่มบริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) และบริษัทในเครือเท่านั้น ห้ามเผยแพร่ ค่าเช่า
สัญญาเช่า ๙๙๙ บาท และค่าเช่าที่ดิน ๙๙๙ บาท

| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|



ประกาศใช้ครั้งที่ 1 หน้า 11 จาก 12 วันที่มีผลบังคับใช้: 10/10/2021
เอกสารฉบับนี้เป็นความลับ และกรรมสิทธิ์ทางกฎหมายเพื่อให้ภายในกลุ่มบริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) และบริษัทในเครือเท่านั้น ห้ามเผยแพร่ ค่าเช่า
สัญญาเช่า ๙๙๙ บาท และค่าเช่าที่ดิน ๙๙๙ บาท

| | |
|--|---|
|  บริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | W-(O-P2-OP3)-A985-001: วิธีปฏิบัติงานการเก็บตัวอย่าง HIGH TEMPERATURE GAS/LIQUID TYPE SC-7B |
|--|---|



ประกาศใช้ครั้งที่ 1 หน้า 12 จาก 12 วันที่มีผลบังคับใช้: 10/10/2021
เอกสารฉบับนี้เป็นความลับ และกรรมสิทธิ์ทางกฎหมายเพื่อให้ภายในกลุ่มบริษัท ทีทีที โกลบอล เคมิคอล จำกัด (มหาชน) และบริษัทในเครือเท่านั้น ห้ามเผยแพร่ ค่าเช่า
สัญญาเช่า ๙๙๙ บาท และค่าเช่าที่ดิน ๙๙๙ บาท

ภาคผนวก ข.20

WI การป้องกันการระบายสารจากกิจกรรมการซ่อมแซมอุปกรณ์




บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน)

Plant Operation III


P-(O-P2-OP3)-002


ขั้นตอนการดำเนินงานการ SHUT DOWN BUTADIENE EXTRACTION UNIT



| | | |
|--|--|--|
| | บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | P-(O-P2-OP3)-002: ขั้นตอนการดำเนินงานการ SHUT DOWN BUTADIENE EXTRACTION UNIT |
|--|--|--|





| | |
|--|--|
|  บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | P-(O-P2-OP3)-002: ขั้นตอนการดำเนินการ SHUT DOWN BUTADIENE EXTRACTION UNIT |
|--|--|

| | |
|--|--|
|  บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | P-(O-P2-OP3)-002: ขั้นตอนการดำเนินการ SHUT DOWN BUTADIENE EXTRACTION UNIT |
|--|--|

ประกาศใช้ครั้งที่ 3 หน้า 1 จาก 10 วันที่มีผลบังคับใช้: 26/11/2023
เอกสารนี้เป็นความลับ และการนำข้อมูลภายนอกที่มีสิทธิ์ในทรัพย์สินทางปัญญาของ บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) ไปเผยแพร่โดยไม่ได้รับอนุญาตจะถือว่าผิดกฎหมาย
ข้อมูลนี้เป็นข้อมูลเบื้องต้นเท่านั้น และอาจมีการเปลี่ยนแปลงได้ตามความเหมาะสม

ประกาศใช้ครั้งที่ 3 หน้า 2 จาก 10 วันที่มีผลบังคับใช้: 26/11/2023
เอกสารนี้เป็นความลับ และการนำข้อมูลภายนอกที่มีสิทธิ์ในทรัพย์สินทางปัญญาของ บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) ไปเผยแพร่โดยไม่ได้รับอนุญาตจะถือว่าผิดกฎหมาย
ข้อมูลนี้เป็นข้อมูลเบื้องต้นเท่านั้น และอาจมีการเปลี่ยนแปลงได้ตามความเหมาะสม

| | |
|--|--|
|  บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | P-(O-P2-OP3)-002: ขั้นตอนการดำเนินการ SHUT DOWN BUTADIENE EXTRACTION UNIT |
|--|--|



| | |
|--|--|
|  บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) | P-(O-P2-OP3)-002: ขั้นตอนการดำเนินการ SHUT DOWN BUTADIENE EXTRACTION UNIT |
|--|--|

3. หัวข้อและความรับผิดชอบ

4. WORKFLOW

ประกาศใช้ครั้งที่ 3 หน้า 3 จาก 10 วันที่มีผลบังคับใช้: 26/11/2023
เอกสารนี้เป็นความลับ และการนำข้อมูลภายนอกที่มีสิทธิ์ในทรัพย์สินทางปัญญาของ บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) ไปเผยแพร่โดยไม่ได้รับอนุญาตจะถือว่าผิดกฎหมาย
ข้อมูลนี้เป็นข้อมูลเบื้องต้นเท่านั้น และอาจมีการเปลี่ยนแปลงได้ตามความเหมาะสม

ประกาศใช้ครั้งที่ 3 หน้า 4 จาก 10 วันที่มีผลบังคับใช้: 26/11/2023
เอกสารนี้เป็นความลับ และการนำข้อมูลภายนอกที่มีสิทธิ์ในทรัพย์สินทางปัญญาของ บริษัท พีทีที โกลบอล เคมิคอล จำกัด (มหาชน) ไปเผยแพร่โดยไม่ได้รับอนุญาตจะถือว่าผิดกฎหมาย
ข้อมูลนี้เป็นข้อมูลเบื้องต้นเท่านั้น และอาจมีการเปลี่ยนแปลงได้ตามความเหมาะสม






Internal Use Only

6. ภาคผนวก

Internal Use Only

ภาคผนวก ข.21


ผังระบบบำบัดน้ำเสียของโรงผลิตสารโอเลฟินส์ โรงที่ 2/1 และโรงที่ 2/2

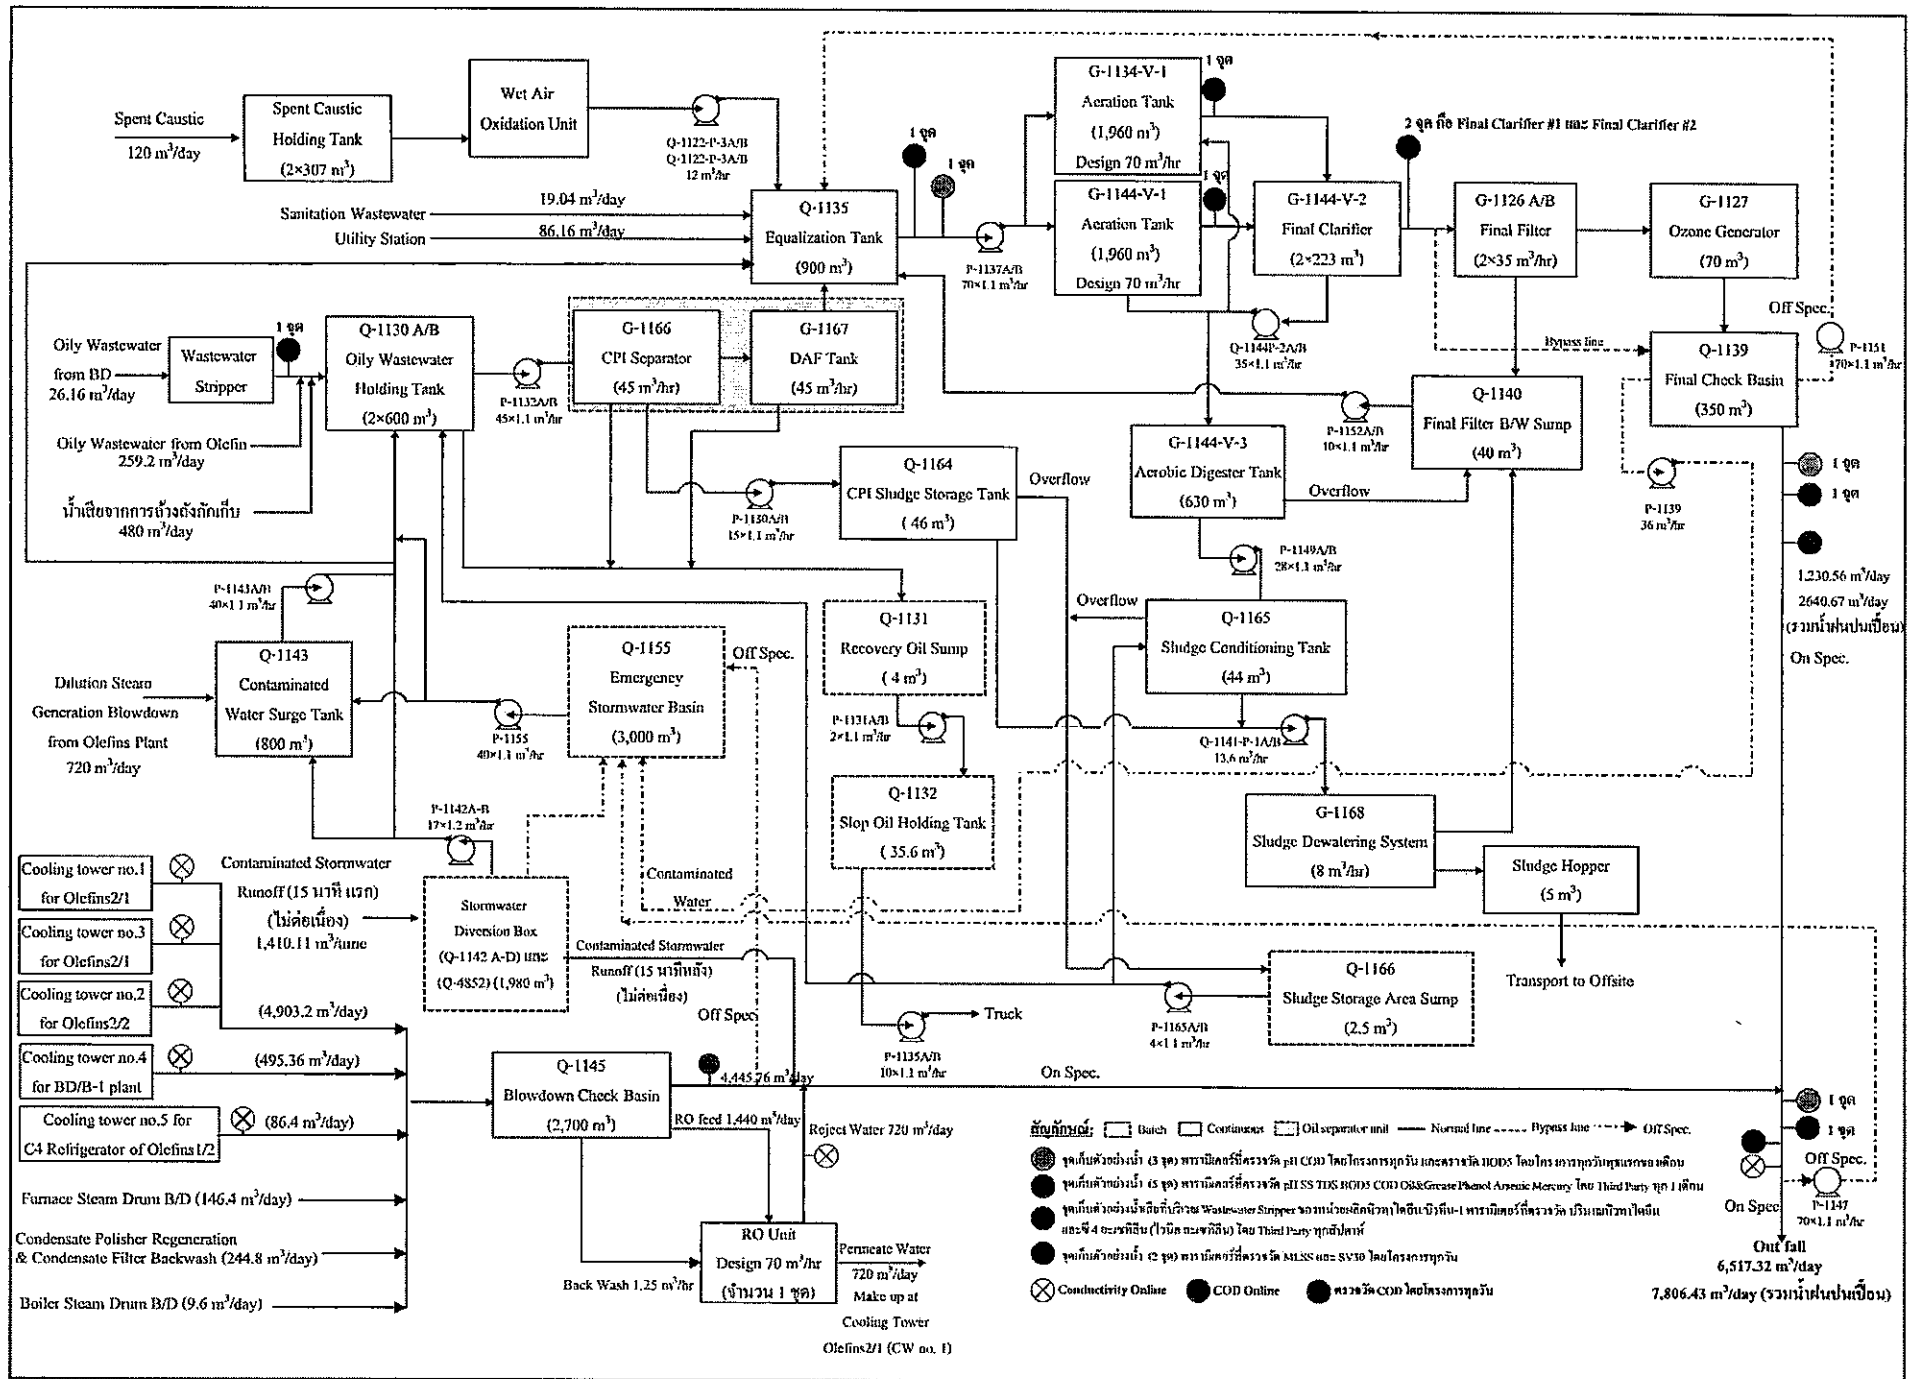

รูปที่ 2.8.2-2 ผังระบบบำบัดน้ำเสียของโรงผลิตสารโอเลฟินส์ โรงที่ 2/1 และ 2/2 ก่อนขยายกำลังการผลิต

ภาคผนวก ข.22


ผังการจัดการน้ำเสียของโครงการ

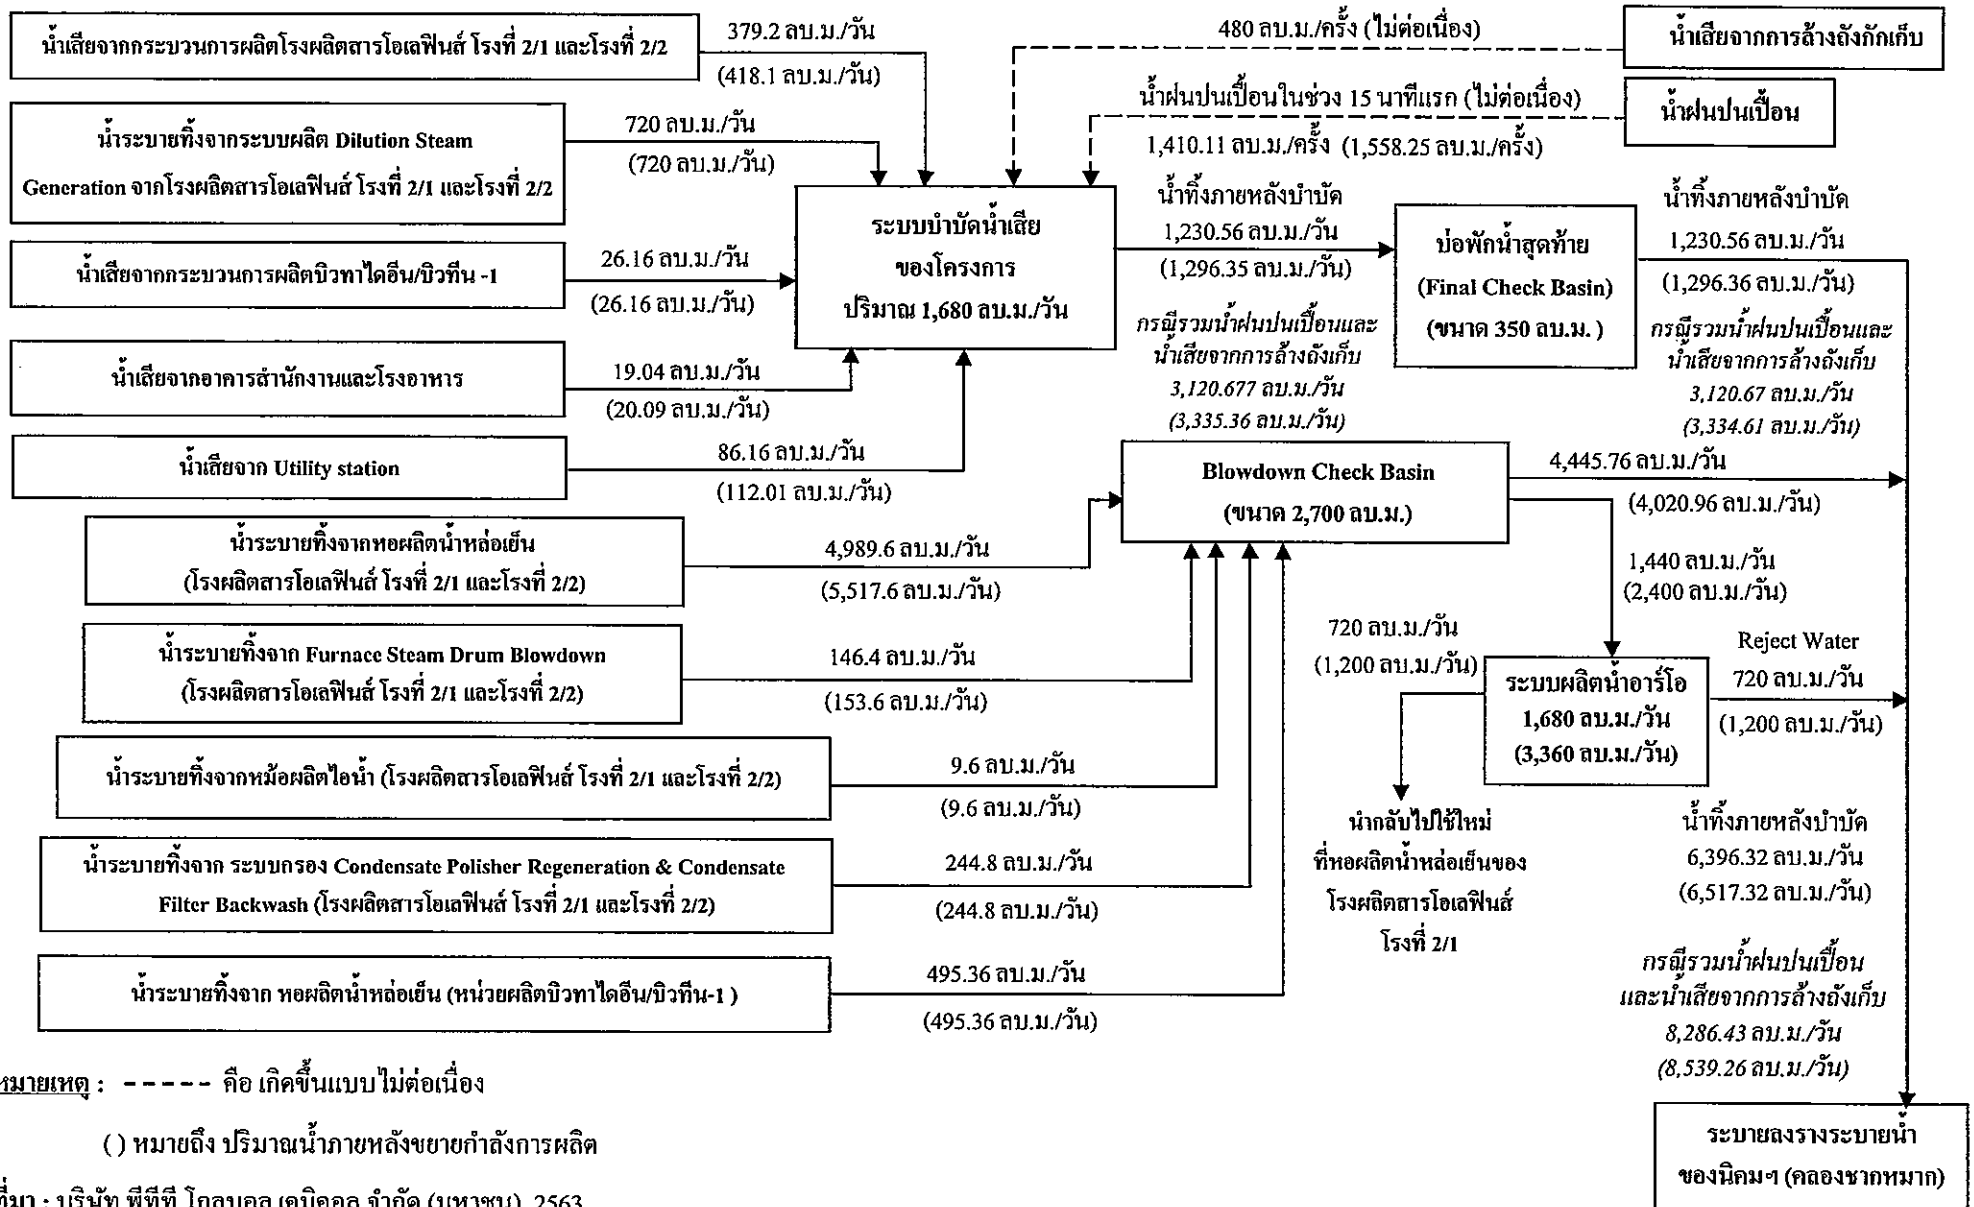

รูปที่ 2.8.2-1 ฟังการจัดการน้ำเสียของโครงการก่อนและภายหลังขยายกำลังการผลิต

ภาคผนวก ข.23

เอกสาร P&ID ของระบบ Wastewater Stripper





หน้าจอ DCS ระบบ Wastewater Stripper



ภาคผนวก ข.24


PID แสดง COD Online และ Conductivity Alarm

AT-11411A

COD ประตูล้างมืออัตโนมัติ



COD Online DCS AI-11411A

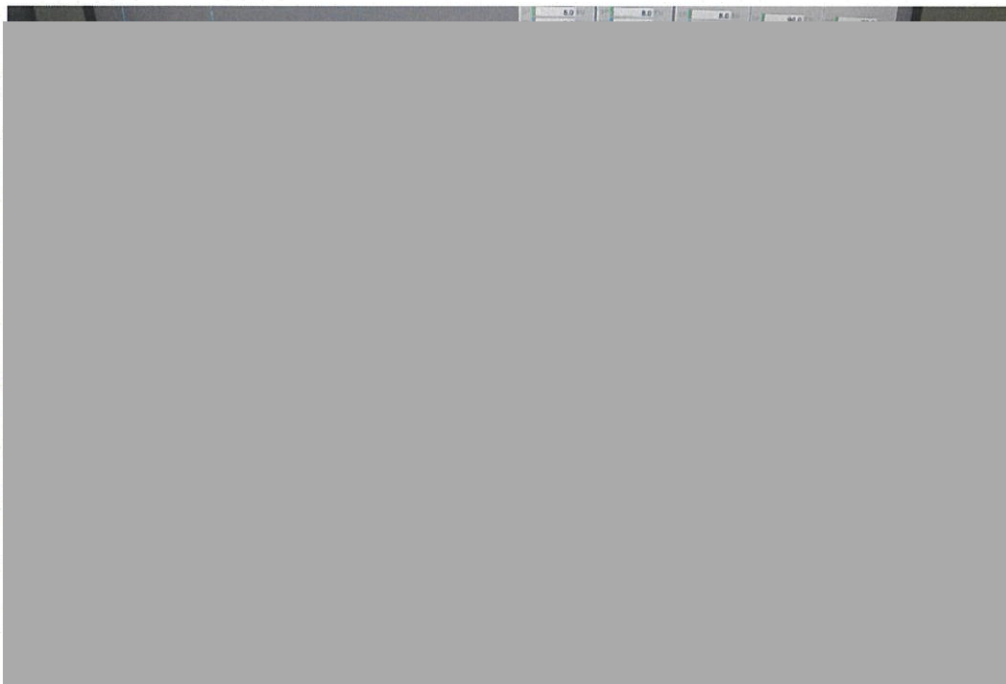


AI-11391A Q-1139 local



DCS AI-11391 A



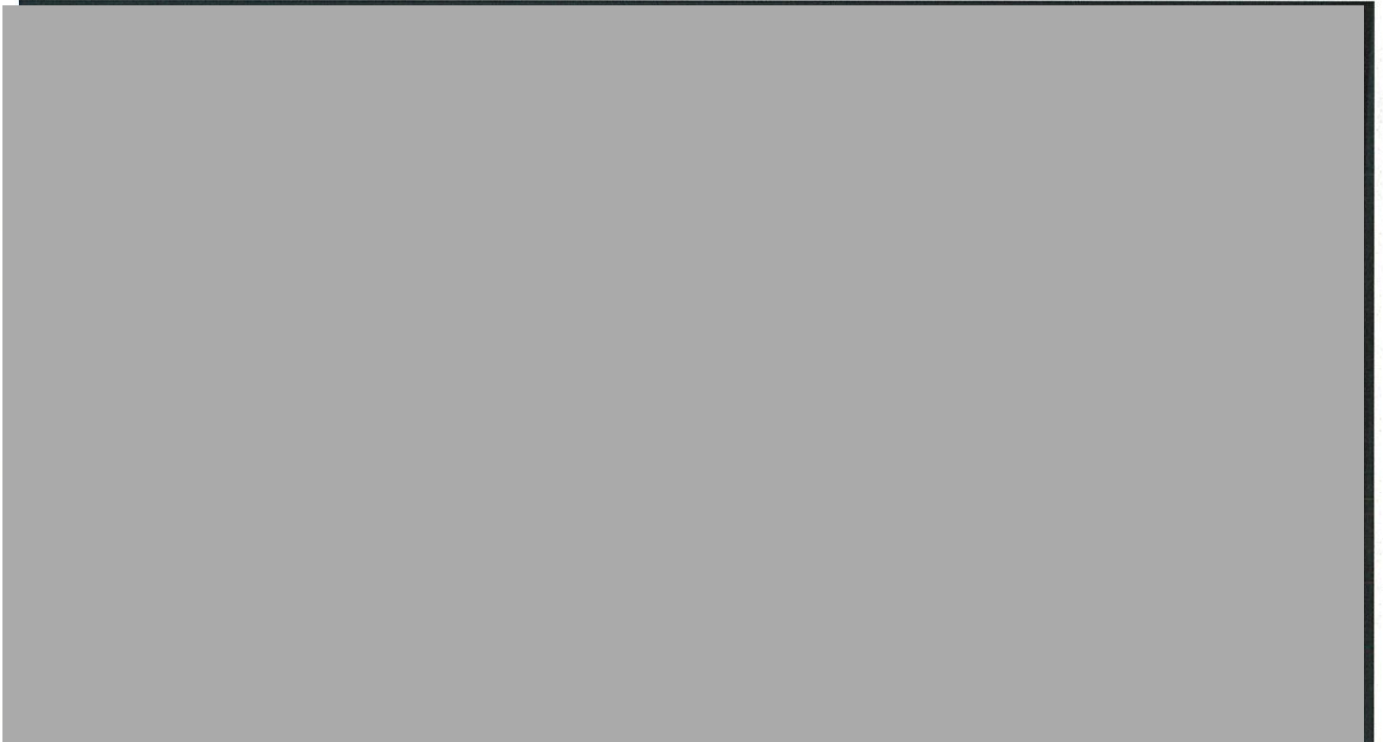



Conductivity at Q-1139 (SC-11390&outfloor(SC-11411)