

ภาคผนวกที่ 5

กระบวนการระงับเหตุฉุกเฉิน

Crisis Management Structure (โครงสร้างการจัดการภาวะวิกฤต)



The teams who response to emergency case, take action by investigating, firefighting & rescue and control evacuation, included 3 teams as below

ทีมที่ตอบสนองต่อกรณีฉุกเฉินจะดำเนินการโดยการตรวจสอบการดับเพลิงและกู้ภัยและการควบคุมการอพยพรวม 3 ทีมดังต่อไปนี้

Emergency Response Team (ERT) - The First team responses to go to the scene to investigate. Then report the situation to Operator.

ทีมรับมือกับเหตุฉุกเฉิน (ERT) - การตอบสนองทีมแรกที่จะไปยังที่เกิดเหตุเพื่อตรวจสอบ และรายงานสถานการณ์ให้ผู้ประกอบการ

Emergency Support Team (EST) - The second team responses to support, fight the fire and rescue the victim included disable guest after ERT confirmed the real fire.


ทีมสนับสนุนฉุกเฉิน (EST) – การตอบสนองทีมที่สองที่จะสนับสนุนการต่อสู้ไฟและช่วยเหลือผู้ได้รับบาดเจ็บหลังจากที่ได้รับการยืนยันว่าเป็นไฟจริง


Crisis Management Team (CMT) - The Third team response to control the emergency case and order to evacuation in case of the fire out of control.

ทีมบริหารภาวะวิกฤต (CMT) - การตอบสนองในการควบคุมกรณีฉุกเฉินและอพยพคนในกรณีของการเกิดไฟไหม้จริง

Fire Response Procedure and Code of Fire รหัสและกระบวนการรับเหตุไฟไหม้

Fire Response Procedure กระบวนการรับเหตุไฟไหม้	
Code1	<p>There has been an alarm or incident reported somewhere.</p> <ol style="list-style-type: none"> 1. ERT responses to go to the scene to investigate. 2. EST starts getting dress. 3. CMT Surveillance events. <p>มีการเตือนภัยหรือเหตุการณ์ที่เกิดขึ้นที่ใดที่หนึ่ง</p> <ol style="list-style-type: none"> 1. ทีมฉุกเฉิน(ERT)ไปยังที่เกิดเหตุเพื่อตรวจสอบ 2. ทีมสนับสนุน(EST)เตรียมใส่ชุดผจญเพลิง 3. ทีมผู้บริหาร(CMT)เฝ้าระวังเหตุการณ์
Code2	<p>There alarm has been confirmed. This is a real fire or emergency.</p> <ol style="list-style-type: none"> 1. EST responses to fight the fire and rescue the victim. 2. CMT There alarm has been confirmed. This is a real fire or emergency. Center 3. CMT prepare for evacuation. <p>เมื่อได้รับการยืนยันว่าไฟไหม้จริง</p> <ol style="list-style-type: none"> 1. ทีมสนับสนุน (EST) รีบไปที่เกิดเหตุเพื่อดับไฟและช่วยเหลือ 2. ทีมผู้บริหาร (CMT) เมื่อได้รับการยืนยันว่าเป็นไฟไหม้จริง CMT ประชุมกันที่ห้องบัญชาการ 3. ทีมผู้บริหาร (CMT) เตรียมความพร้อมสำหรับการอพยพ


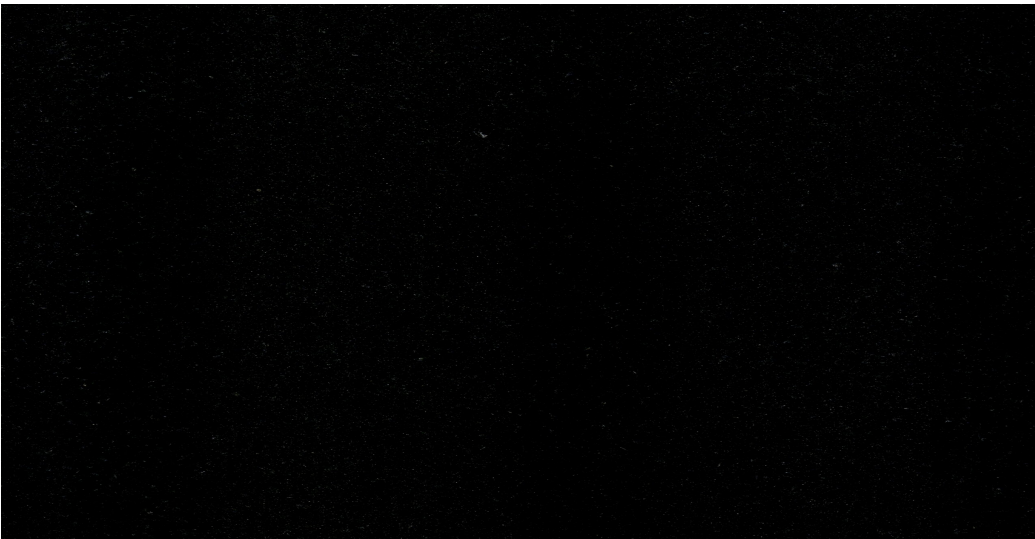
<p>Code3</p>	<p>The situation is out of control. The building should be evacuated. CMT order to evacuate. Fire brigade and Ambulance were notified.</p> <p>เมื่อไม่สามารถควบคุมสถานการณ์ได้ทีมผู้บริหารประกาศอพยพไปยังที่ปลอดภัยและเรียกรถดับเพลิงและรถพยาบาล</p> 
--------------	--






Fire Response Procedure for Guest and Team member

กระบวนการรับมือเหตุเพลิงไหม้สำหรับแขกและพนักงาน

When team members Amari Phuket find fire, the guests and staff at the scene first then fire you can stop safely if a fire is to notify the operator to show it. fight the fire and wait for the announcement of the management team.





เมื่อสมาชิกในทีมอมารีภูเก็ตพบเหตุไฟไหม้, ให้ช่วยเหลือแขกและพนักงานที่จุดเกิดเหตุก่อนหลังจากนั้นจึงดับไฟหากสามารถดับได้อย่างปลอดภัยถ้าไม่สามารถดับไฟได้ให้แจ้งไปยังโอเปอเรเตอร์เพื่อเข้าสู่กระบวนการดับเพลิงและรอการประกาศของทีมผู้บริหาร



Fire Response Procedure for Guest and Team Member

กระบวนการระงับเหตุเพลิงไหม้สำหรับแขกและพนักงาน



	<p>R</p>	<p><u>Remove</u> anyone from immediate danger. นำทุกคนออกจากพื้นที่อันตรายทันที</p>
	<p>A</p>	<p><u>Activate</u> the building fire alarm system. ทำสัญญาณเตือนเหตุเพลิงไหม้</p>
	<p>C</p>	<p><u>Confine</u> the fire by closing all windows and doors. จำกัดไฟโดยการปิดหน้าต่างและประตูทุกบาน</p>
	<p>E</p>	<p><u>Extinguish</u> the fire, if it can be done safely. <u>Evacuate</u>, leave the building. ดับไฟถ้าสามารถทำได้อย่างปลอดภัย อพยพออกจากอาคาร</p>

ภาคผนวกที่ 6

ใบเสร็จรับเงิน

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	21+8	29	1	29
2	น้ำมันเก่า				
3	อะลูมิเนียม	6	6	35	210
4	ขวดใส	11+5	16	6	96
5	พลาสติกดี	6+8+10+2+5+9	40	2	80
6	ขวดแก้ว	20+16+15+14+16+12+11+16+12+11+13+12+	168	0.25	42
7	กระดานยับ	5+8+6+2+5+13	44	1	44
8	กระดานตั้ง	4+14+13+11+10+5+13+13+11+16+13+15+10	948	1.5	222
9	เหล็ก	6	6	7	42
10	พลาสติกดำ	14	14	1	14
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกนำหน้า และ บิลรายการของเก่า	นำหน้า รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	7+8	15	1	15
2	น้ำมันเก่า				
3	อะลูมิเนียม	4	4	35	140
4	ขวดใส	5+2	7	6	42
5	พลาสติกสี	30+10+7+2+2+3	62	2	124
6	ขวดแก้ว	17+21+19+15+22+12+12+11+11+20+12+20+28+27 11+12+22+16+10+15+8+11+10+16+14+13+29+27+30+27+29+27+32+25+36+33+20+27+15	157	0.25	189.25
7	กระดานยับ	9+3+8+9+3+16+10+8+8+5+4	83	1	83
8	กระดานลึง	12+9+19+33+20+18+22+12+6	151	1.5	226.5
9					
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					19.75

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	$5+4+11+9+19$	48	1	48
2	น้ำมันเก่า				
3	อะลูมิเนียม	7	7	35	245
4	ขวดใส	$8+12+2+5+2+4$	33	6	198
5	พลาสติกสี	$8+4+7+11+6+3+13+14+28$	94	2	188
6	ขวดแก้ว	$25+25+18+18+17+17+16+18+13+18+15+45+37+35+42+40+46+49+52$	551	0.25	137.75
7	กระดามยับ	$7+8+10+9+2+9+10+13$	75	1	75
8	กระดามล้าง	$30+15+13+17+13+19+2+4+7+17+28+27+23+25+14$	254	1.5	381
9	เศษแก้ว	18	18	0.25	4.5
10	เหล็ก	11	11	6	66
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด</p>					3.25

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะลีสี่	4	4	1	4
2	น้ำมันเก่า				
3	อะลูมิเนียม				
4	ขวดใส				
5	พลาสติกดี	18	18	2	36
6	ขวดแก้ว	32+42+32+40+45+43	239	0.25	59.75
7	กระดามยับ	11+12+9+20	52	1	52
8	กระดามตั้ง	31+22+29+15+25+12+15+17+18+20+21	225	1.5	337.5
9					
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					25

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะลีส	$4+2+14$	25	1	25
2	น้ำมันเก่า				
3	อะลูมิเนียม	8.5	8.5	35	297.5
4	ขวดใส	$3+6+3+2+4$	18	6	108
5	พลาสติกดี	$2+6+8+6+4+2+9+1+1$	44	2	88
6	ขวดแก้ว	$32+39+36+36+32+20+16+32+24+20$	302	0.25	75.5
7	กระดามยับ	$11+20+12+9+10+5+3$	75	1	75
8	กระดามตั้ง	$12+9+12+11+25+21+34+24+10$	168	1.5	252
9	เตาอบ	$5+15$	20	6	120
10	พลาสติกกล่อง	$15+14+16+14+13+18$	90	2	180
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรือเดินสมุทร จำกัด					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการตั้งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะสี	8+18	26	1	26
2	น้ำมันเก่า				
3	อะลูมิเนียม	5	5	35	175
4	ขวดใส	7+3+4+2	16	6	96
5	พลาสติกสี	2+2+10+10+2+4	45	2	90
6	ขวดแก้ว	35+30+31+36+33+29+32+37+35+14	315	0.25	78.75
7	กระดามยับ	14+9+7+14+21+20+20+20	125	1	125
8	กระดามตั้ง	8+24+28+28+9+16+31+32+28+23+12	239	1.5	358.5
9	กระดามหัก	27	27	3	81
10	เหล็กทาว	9+9+10+8+16+12+13+16+4+15+10+10+10	142	6	852
พลาสติกกรอบ 5+11			16	1	16
เหล็กทาว 29+16					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการตั้งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ตั้งกะตี่	11+16+2	29	1.5	43.5
2	น้ำมันเก่า	10+8	18	12	916
3	อะลูมิเนียม	7	7	35	245
4	ขวดใส	9+4	13	6	78
5	พลาสติกดี	11+11+7+8+7+6+10+23	83	2	166
6	ขวดแก้ว	36+42+40+41+39+38+38+47+39+18+20	398	0.25	99.5
7	กระดาษยับ	6+6+7+20	39	1.5	58.5
8	กระดาษตั้ง	30+29+28+23+11	121	2	242
9	เหล็กยาว	16+12+8+10+3+23+27	99	5	495
10	เหล็กหนา	45+26	71	5.5	390.5
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะดี่	1 + 8 + 18	27	1.5	40.5
2	น้ำมันเก่า	14 + 22	36	12	432
3	อะลูมิเนียม	6	6	35	210
4	ขวดใส	6 + 5 + 3	14	6	84
5	พลาสติกดี	9 + 9 + 11 + 2	36	2	72
6	ขวดแก้ว	24 + 35 + 41 + 38 + 33 + 38 + 40 + 39 + 32 + 33 + 36 + 40 + 32 + 40 + 30 + 33 + 35 + 33 + 20 + 18 + 23 23 + 19 + 23 + 18 + 28 + 30	839	0.25	209.75
7	กระดวยับ	20 + 16 + 9 + 8 + 9	62	1.5	93
8	กระดวยถึง	18 + 10 + 7 + 24 + 20 + 20 + 15 + 38 + 25 + 15 + 20 + 20	232	2	464
9					
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					ยอดรวมทั้งหมด
					1605.95

ลา

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะตี่	20 + 23	43	1.5	64.5
2	น้ำมันเก่า				
3	อะลูมิเนียม	6	6	35	210
4	ขวดใส	4 + 9	13	6	78
5	พลาสติกสี	4 + 4 + 13 + 20 + 5	46	2	92
6	ขวดแก้ว	23 + 29 + 31 + 33 + 39 + 43 + 39 + 36 + 32 + 18	323	0.25	161.5
7	กระดาษยับ	10 + 18 + 10 + 15 + 8 + 8 + 7 + 7 + 6	89	1.5	133.5
8	กระดาษตั้ง	28 + 22 + 29 + 15 + 20 + 9 + 34 + 20 + 15 + 17 + 28	234	2	468
9					
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

ลาย

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะดี่	11+22	33	1	33
2	น้ำมันเก่า				
3	อะลูมิเนียม	7+4	11	35	385
4	ขวดใส	8+5+7	20	6	120
5	พลาสติกดี	10+10+8+5+8+3	44	2	88
6	ขวดแก้ว	19+19+21+21+20+20+20+20+16+29+20+18+20+19+22+19+18+20+11+12+14	398	0.25	99.5
7	กระดาษยับ	7+7+6+4+8+8+12+8	60	1	60
8	กระดาษตั้ง	13+21+23+33+29+16+16+15+10+14+6+18+14+16	244	1.5	366
9					
10					
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรือล เอ็มเทท จำกัด</p>					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	21+8	29	1.5	43.5
2	น้ำมันเก่า	11+15	26	12	312
3	อะลูมิเนียม	4	4	35	140
4	ขวดใส	2+3+4	9	6	54
5	พลาสติกดี	1+5+15+9+10+11+3+4	58	2	116
6	ขวดแก้ว	28+30+45+44+22+25+44+26	264	0.25	66
7	กระดามยับ	6+29+14+8+8+9+15+5	94	1.5	141
8	กระดามตั้ง	21+13+22+24+26+37+16+20+6+13+12	215	2	430
9	เหล็กขาง	8+15+10+7+2	42	5.5	231
10	เหล็กขนา	41	41	6	246
	ของหอ	11+36+40+32+20	139	13	1807

บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะดี่	$3 + 5 + 10$	18	1.5	27
2	น้ำมันเก่า	15	15	12	180
3	อะลูมิเนียม	5	5	35	175
4	ขวดใส	$3 + 9 -$	12	6	72
5	พลาสติกสี	$18 + 4 + 2 + 4$	28	2	56
6	ขวดแก้ว	$22 + 23 + 21 + 22 + 21 + 23 + 22 + 18 + 21 + 11 + 3$	213	0.25	53.25
7	กระดาษยับ	$20 + 5 + 17 + 16$	58	1.5	87
8	กระดาษล้าง	$12 + 7 + 13 + 8 + 11 + 16 + 14 + 17 + 14 + 5 + 11 + 7 + 11 + 6 + 7$	162	2	324
9	เหล็กบาง	6	6	5.5	33
10					
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด</p>					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะตี่	15+16	31	1.5	46.5
2	น้ำมันเก่า	10	10	12	120
3	อะลูมิเนียม	6.5	6.5	35	227.5
4	ขวดใส	3	3	6	18
5	พลาสติกสี	3+2+8+4+4+5+1	32	2	64
6	ขวดแก้ว	37+26+20+19+21+20+21+19+18+13+6	220	0.25	55
7	กระดามชัย	12+12+15	39	1.5	58.5
8	กระดามตั้ง	22+16+22+10+18+18+8+7+24+7+14+9	145	2	350
9	ภาชนะแก้วดำ	3	3	2.5	7.5
10	ขวด	2	2	10	20
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	9+18	27	1	27
2	น้ำมันเก่า	10	10	12	120
3	อะลูมิเนียม	2.8+3.8	6.6	35	231
4	ขวดใส	9+4	13	6	78
5	พลาสติกดี	4+14+5+9+14+16+24+16	102	2	204
6	ขวดแก้ว	22+16+21+16+12+20+20+20+15+12+15+16+18	228	0.25	57
7	กระดวยยับ	6+20	26	1	26
8	กระดวยตั้ง	18+18+20+19+18+25+32+19+10+12+11	207	1.5	310.5
9	กระดวย บิดๆ	4	4	2.5	6.5
10					
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด</p>					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะดี่	9+13	22	1	22
2	น้ำมันเก่า	3+6	9	12	108
3	อะลูมิเนียม	4.5	4.5	35	157.5
4	ขวดใส	6+3+4	13	6	78
5	พลาสติกสี	14+9+5+2	30	2	60
6	ขวดแก้ว	19+26+20+19+28+40+41+37+18	248	0.25	62
7	กระดามยับ	8+5+23	36	1	36
8	กระดามตั้ง	14+9+12+13+6+10+10+5+12+9+16+5+6+8+9+4+4+5+5	164	2	328
9					
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					5

ขวดแก้ว 19+23+21+20+21+23+19

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะลีส	11	11	1	11
2	น้ำมันเก่า				
3	อะลูมิเนียม				
4	ขวดใส	8+6+4+1	19	6	114
5	พลาสติกสี	7+8+11+4+4+2+ 5	41	2	82
6	ขวดแก้ว	13+14+19+20+22+19+18+23+15+20+20+19+29+20+29+18+18+15+20+17+18+22 16+16+16+19+13+26+24+16+15+17+16+17+13+27+20+19+22+25+24+13+19+20	987	0.25	246.75
7	กระดามยับ	16+12+31+6+8+8+8+12	101	1	101
8	กระดามตั้ง	29+26+24+5+12+13+9+25+29+29+16	216	1.5	324
9	ปั๊ว	15+1	16	1	16
10	คอยร้อน	39+13	52	75	3,900
11	เหล็กขาว	20+20+2+3+1+31+9+8	94	6	564
12	คอมเพลกเซอร์	30			390
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					1,148.75

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ตั้งกะล่				
2	น้ำมันเก่า				
3	อะลูมิเนียม	3+3+2	8	35	280
4	ขวดใส	4+3+4+3+5+6+4+1+4	34	6	204
5	พลาสติกสี	2+3+3+4+16+12	40	2	80
6	ขวดแก้ว	25+12+17+19+22+11+16+21+17+21+12+17+18+20+18+24+15+4+24+15+22+16+30+ 10+15+21+16+18+20+17+9	542	0.25	135.5
7	กระดามยับ	9+9+5+15+10+13	61	1	61
8	กระดามตั้ง	10+14+14+14+15+12+14+13+26+15+15+7+18+4+7+1+3+2+2+6+12+13+19+14+16+15+ 10+14+12+16+17+5+7+9+17+15+15+13+8	459	1.5	688.5
9	ถัง	9+25	34	1	34
10					

บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ตั้งกะตี่	๑	๑	1	๑
2	น้ำมันเก่า	11	11	12	132
3	อะลูมิเนียม	5	5	35	175
4	ขวดใส	5+10	15	6	90
5	พลาสติกสี	๑+5+๑+13	36	2	๗2
6	ขวดแก้ว	30+35+44+24+45+15+35+34+20+11+23	332	0.25	83
7	กระดามยับ	4+11	15	1	15
8	กระดามตั้ง	22+10+11+21+11+29+11+11+15+10+5+5+5+5+9	210	1.5	315
9	ถัง	31+9	40	1	40
10					

บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทค จำกัด

ถ่าย

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะสี	6+4	10	1	10
2	น้ำมันเก่า				
3	อะลูมิเนียม				
4	ขวดใส	6+1	7	6	42
5	พลาสติกสี	12+10+3+13+9	47	3	141
6	ขวดแก้ว	13+15+16+17+15+16+15+13+12+14+17+14+15+12+13+17+13+16+12+19+16+20+26+22+19+26+25+23+17+19+18+20+27+8+20+15+14+10+20+9+24+24+17+17+7+18+14+10+27+14+14	1,034	0.50	517
7	กระดวยยับ	8+8+7+13	36	1	36
8	กระดวยตั้ง	16+7+34+18+25+14+28+13+16+18+29+10+12+36+16+10+23	325	2	650
9	พลาสติกขาว	57	57	1	57
10	กระป๋องโค้ก	3	3	20	60

บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด

ขวดแก้ว 25+20+20+20+19+14+13+11+14+12+18+

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะสี				
2	น้ำมันเก่า	20	20	10	200
3	อะลูมิเนียม	3	3	20	60
4	ขวดใส				
5	พลาสติกสี	9+10+5	24	3	72
6	ขวดแก้ว	17+30+30+33+27+12	149	0.5	74.5
7	กระดวยยับ	10	10	1	10
8	กระดวยตั้ง	21+8+9+22	60	2	120
9	อื่น	5+9+3	17	1	17
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

โรงแรมอมารีภูเก็ต

14/1/24

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะดี่	6	6	1	6
2	น้ำมันเก่า	10	10	10	100
3	อะลูมิเนียม	1	1	25	25
4	ขวดใส				
5	พลาสติกสี	6+8	14	3	42
6	ขวดแก้ว				
7	กระดาดยับ	5+3+1+4+3+2+8	26	1	26
8	กระดาดตั้ง	6+18+10+8+3+5+3	53	2	106
9	เหล็กฆาง	21+10+8+12+22+18+13+14+8+	126	5	630
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเพท จำกัด					5

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ตั้งกะดี่	15+16	31	1	31
2	น้ำมันเก่า				
3	อะลูมิเนียม	5	5	25	125
4	ขวดใส	7	7	7	49
5	พลาสติกสี	8+15+7	30	3	90
6	ขวดแก้ว	28+16+31+25+18+19+26+16+18+19+10+19+16+19+7+19+18+18+19+19+14+19+13+18+ 20+17+	481	0.25	120.25
7	กระดาษยับ	12+7+9+16	44	1	44
8	กระดาษตั้ง	16+12+15+13+15+16+18+15+15+9+9+10+	163	2	326
9					
10					
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มแทท จำกัด</p>					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะตี่	$6+3+5$	14	1	14
2	น้ำมันเก่า	20	20	10	200
3	อะลูมิเนียม	$2+1$	3	25	75
4	ขวดใส	2	2	7	14
5	พลาสติกสี	$4+9+19+8+4+6+10$	60	3	180
6	ขวดแก้ว	$14+9+18+20+20+20+19+17+19+17+16+19+16+15+15+17$	271	0.25	67.75
7	กระดวยขยับ	$10+7+10+25$	52	1	52
8	กระดวยตั้ง	$6+5+10+7+5+5+9+13+9+10+10+18+10+25$	142	2	284
9					
10	66กิโล	$24+15+13+14+15+15+16+10+15+14+25$	176	0.25	44
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					75

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	4+5	9	1	9
2	น้ำมันเก่า				
3	อะลูมิเนียม				
4	ขวดใส				
5	พลาสติกสี	10+2+9+4+9	34	3	102
6	ขวดแก้ว	19+20+18+16+15+14+16+15+13+15+19+12+18	210	0.25	52.50
7	กระดามยับ	2+10+10+3+10	35	1	35
8	กระดามตั้ง	10+16+11+12+10+8+4+10	86	2	172
9					
10					
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเพท จำกัด</p>					0.50

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการตั้งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ตั้งกะดี่	$11+15+8+$	34	1	34
2	น้ำมันเก่า	$10+10$	20	10	200
3	อะลูมิเนียม	$2+1$	3	25	75
4	ขวดใส				
5	พลาสติกดี	$28+5+7+17+4+4+4+5+4$	78	3	234
6	ขวดแก้ว	$31+36+31+32+23+36+35+32+38+19+19+18+17+16+15+23+18+12+9+8+8+11$	494	0.25	123.5
7	กระดามชัย	$16+8+12+7+7+5+$	55	1	55
8	กระดามตั้ง	$17+24+36+7+8+10+6+7+$	115	2	230
9					
10					
					919.45
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะสี	5+10+6+9	30	1	30
2	น้ำมันเก่า				
3	อะลูมิเนียม	3+3	6	25	150
4	ขวดใส	2	2	7	14
5	พลาสติกสี	5+5+3+10+14+5+6+7+5+5	65	3	195
6	ขวดแก้ว	15+16+18+26+26+17+20+19+12+14+16+10+12+22+13+17+15+12+16	316	0.25	79
7	กระดามยับ	11+13+5	29	1	29
8	กระดามล้าง	8+12+9+15+20+15+5+5+10+13+7+15+19+22+20+8+15+12+25+20			
9	ว	+25	300	2	600
10	ขวดแก้ว	+13+18+12+16+20+17+19+17+18+19+20+20+22+24+17+17+13+13	345	0.25	86.25
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					25

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการถึงของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	7+11	18	1	18
2	น้ำมันเก่า				
3	อะลูมิเนียม				
4	ขวดใส				
5	พลาสติกดี	6+4+5+5+4+8	32	3	96
6	ขวดแก้ว	12+15+16+16+14+11+12+17+24+10+14+13+18+12+22+19+20+20+20	305	0.25	76.25
7	กระดามยับ	5+6+6+5	22	1	22
8	กระดามถึง	14+9+4+8+10+7+11+6+5+9+4+5+3+9+10+7+12+3	136	2	272
9	เหล็กหนา	37	37	6	222
10	เหล็กบาง	24+14+6+5+10+3	62	5	310
	ขวดแก้ว	+20+21+7	48	0.25	12
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด</p>			1,028.25	360.00	668.25

8.25

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะสี	5	5	1	5
2	น้ำมันเก่า	10	10	10	100
3	อะลูมิเนียม	3+	3	25	75
4	ขวดใส				
5	พลาสติกดี	4+9	13	3	39
6	ขวดแก้ว	20+20+20+20+20+19+14+14+13+14	174	0.25	43.6
7	กระดามยับ	8+10	18	1	18
8	กระดามตั้ง	8+17+14+12+10+15+18+19	113	2	226
9	ดินเผาเคลือบ (ผสม) $(4 \times 5 = 20) + (2.5 \times 4 = 10) + (3.5 \times 4 = 14)$		44	8	352
10					
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด</p>					

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ตั้งกะดี	$4+1+8+2+10+1+4$	30	1	30
2	น้ำมันเก่า				
3	อะลูมิเนียม	2.5	2.5	25	62.5
4	ขวดใส				
5	พลาสติกดี	$6+8+6+10+3+7+5+2$	47	3	141
6	ขวดแก้ว	$10+20+25+15+13+24+16+11+16+8+11+22+19+18+18+16+15+13$	290	0.5	145
7	กระดามยับ	$10+7$	17	1	17
8	กระดามดัง	$3+9+18+19+19+2+8+6+16+16+16+25+10+7+8+3$	185	2	370
9	ขวดแก้ว	$+11+18+7+8+14+22+22+33+7+19+8+5+8+13+13$	210	0.5	105
10	หลักนาง	1	5	5	5
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเพท จำกัด</p>					



โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะสี	7+3	10	1	10
2	น้ำมันเก่า				
3	อะลูมิเนียม				
4	ขวดใส				
5	พลาสติกดี	8+2	10	3	30
6	ขวดแก้ว	22+23+25+23+11+29+12	145	0.25	36.25
7	กระดวยยับ	11+7+6	24	1	24
8	กระดวยตั้ง	17+5+5+7+23+8	65	2	130
9	ไมโครเวฟ	12	12	300	3,600
10	เครื่องซักผ้า	3	3	1,000	3,000
<p>บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรือเดินสมุทร จำกัด</p>					

225

Microwave

Brand SIEMENS Electrolux GmbH HF24C561
Model P.R.C Typ AG9250L3 AC220-230V 50Hz
1450W 2450MHz 600W

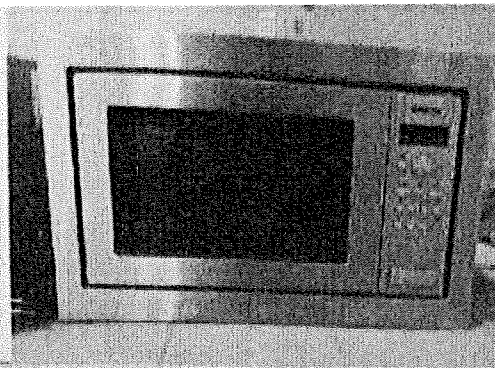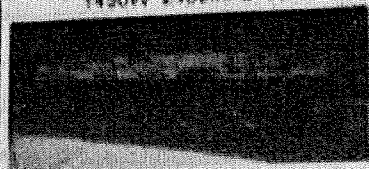

*ราคาซื้อ ไมโครเวฟ

จำนวน 12 เครื่อง คิดราคาเครื่องละ 300 บาท

total = 3,600 ✓



เครื่องซักผ้า จำนวน 3 เครื่อง

คิดราคาเครื่องละ 1,000 บาท

total = 3,000 บาท ✓

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	ถังกะสี	1+4	15	1	15
2	น้ำมันเก่า				
3	อะลูมิเนียม				
4	ขวดใส	3+	3	7	21
5	พลาสติกดี	4+4+7+1	16	3	48
6	ขวดแก้ว	24+23+21+26+31+20+20+26+17+13+23	244	0.25	61
7	กระดามยับ	5+6	11	1	11
8	กระดามตั้ง	5+5+7+9+8+8+9+14+1+6	72	2	144
9	ข้อไม้	3	3	25	75
10					
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทค จำกัด					75

โรงแรมอมารีภูเก็ต

ลำดับ ที่	รายการสิ่งของ	ใบจดบันทึกน้ำหนัก และ บิลรายการของเก่า	น้ำหนัก รวม	หน่วย ราคา	จำนวนเงิน
1	สังกะสี	8	8	1	8
2	น้ำมันเก่า				
3	อะลูมิเนียม	2 + 3	5	25	125
4	ขวดใส				
5	พลาสติกดี	9+9+7	25	3	75
6	ขวดแก้ว	24+23+25+12+25+29+28+21+29+23+23+14+20+21+20+20+25+25+20	422	0.5	211
7	กระดวยยับ	12+7+19+24+22+20+6+6+18+10+6	150	1	150
8	กระดวยตั้ง	23+12+17+10+4+55+12+15+9+17	174	2	348
9					
10	เศษแก้ว	90+16+26+22+22+9+12+74+27+13+13+15+14+7+24+11+28+26 +26+25+11+27+16+10	494	0.5	247
บัญชีธนาคาร SCB ไทยพาณิชย์ 6013034612 บริษัท อิตัลไทย เรียด เอ็มเทท จำกัด					

ภาคผนวกที่ 7

แบบบันทึกการตรวจสอบระบบป้องกันอัคคีภัย

Item no.	FLS CODE	Area		Fire Extinguisher								Checked by	Date	Remark		
				Type of Chemical		Physical		Gauge								
		Section		Location		Dry		Wet chemical		Normal	Abnormal				Status	Pressure
25	ACP-FLS10-PFE-025	Lagritta Bar	Enteance													
26	ACP-FLS10-PFE-026	Main Store	In Store													
27	ACP-FLS10-PFE-027	Building 1	In Garden Room			/								18/12		
28	ACP-FLS10-PFE-028	Building 1	In Florist Room			/								18		
29	ACP-FLS10-PFE-029	Garbage	The Room			/								18/12		
30	ACP-FLS10-PFE-030	Garbage	The Room			/								18/12		
31	ACP-FLS10-PFE-031	Staff Canteen	In The Kitchen			/								18/12		
32	ACP-FLS10-PFE-032	Staff Canteen	In The Kitchen			/								18/12		
33	ACP-FLS10-PFE-033	Staff Canteen	Station Gas			/								18/12		
34	ACP-FLS10-PFE-034	Staff Canteen	In The Kitchen													
35	ACP-FLS10-PFE-035	Male Locker	In Staff Toilets			/								18/12		
36	ACP-FLS10-PFE-036	Female Locker	In Staff Toilets											18/12		
37	ACP-FLS10-PFE-037	HR. Room	In HR. Room			/								18/12		
38	ACP-FLS10-PFE-038	MDB3	Out HR. Room			/								18/12		
39	ACP-FLS10-PFE-039	Lagritta Pool	Lagritta Pool			/								18/12		
40	ACP-FLS10-PFE-040	Lobby	Entrance (OPR)			/								18/12		
41	ACP-FLS10-PFE-041	Store bell	In The Room			/								18/12		
42	ACP-FLS10-PFE-042	Executive Offices	Door Offices											18/12		
43	ACP-FLS10-PFE-043	Lagritta Station Gas	Lobby	/		/								18/12		
44	ACP-FLS10-PFE-044	Lagritta Station Gas	Lobby	/		/								18/12		
45	ACP-FLS10-PFE-045	Secueity No.1	Enteance											18/12		
46	ACP-FLS10-PFE-046	Secueity No.2	Lobby											18/12		
47	ACP-FLS10-PFE-047	Secueity No.3	Time Kepper											18/12		
48	ACP-FLS10-PFE-048	Accounting	In The Room			/								18/12		
49	ACP-FLS10-PFE-049	Main Kitchen	Entrance			/								18/12		
50	ACP-FLS10-PFE-050	Main Kitchen	Entrance			/								18/12		
51	ACP-FLS10-PFE-051	Main Kitchen	Out The Room			/								18/12		
52	ACP-FLS10-PFE-052	Main Kitchen	In The Room			/								18/12		
53	ACP-FLS10-PFE-053	House Keeping	In The Room			/								18/12		
54	ACP-FLS10-PFE-054	Generator MDB 1	Entrance			/								18/12		
55	ACP-FLS10-PFE-055	Generator MDB 1	In The Room											18/12		


Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark	
		Section	Location	Type of Chemical			Physical		Gauge					
				Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure				
56	ACP-FLS10-PFE-056	GM House	Entrance		/		/		/	/	195		28/12	
57	ACP-FLS10-PFE-057	Laundry	Up The Stairs		/		/		/	/	195		28/12	
58	ACP-FLS10-PFE-058	Laundry	Station		/		/		/	/	195		28/12	
60	ACP-FLS10-PFE-060	Laundry	Station		/		/		/	/	195		28/12	
61	ACP-FLS10-PFE-061	Boiler room	In the room		/		/		/	/	195		28/12	
62	ACP-FLS10-PFE-062	Eng. Work Shop	Tools Room		/		/		/	/	195		28/12	
63	ACP-FLS10-PFE-063	Eng. Work Shop	MDR Room		/		/		/	/	195		28/12	
64	ACP-FLS10-PFE-064	Eng. Work Shop	Painter Room		/		/		/	/	195		28/12	
65	ACP-FLS10-PFE-065	Oil Station	Desel Tank		/		/		/	/	195		28/12	
66	ACP-FLS10-PFE-066	Walkway Rim talay			/		/		/	/	195		28/12	
67	ACP-FLS10-PFE-067	Voyagerlounge			/		/		/	/	195		28/12	
68	ACP-FLS10-PFE-068	Gas Station	Laundry		/		/		/	/	195		28/12	
69	ACP-FLS10-PFE-069	Mortorbike Garage1			/		/		/	1	195		28/12	
70	ACP-FLS10-PFE-070	Mortorbike Garage2			/		/		/	/	195		28/12	
71	ACP-FLS10-PFE-071	Rimtalay pump room			/		/		/	/	195		28/12	
72	ACP-FLS10-PFE-072	Kidclub			/		/		/	/	195		28/12	
73	ACP-FLS10-PFE-073	Fire Training			/		/		/	/	195		28/12	
74	ACP-FLS10-PFE-200	PABX room			/		/		/	/	195		28/12	
74	ACP-FLS10-PFE-200	PABX room			/		/		/	/	195		28/12	
75	ACP-FLS10-PFE-201	EE room B.2			/		/		/	/	195		28/12	
76	ACP-FLS10-PFE-202	Pantry smurt bar 1			/		/		/	/	195		28/12	
77	ACP-FLS10-PFE-203	Pantry smurt bar 2			/		/		/	/	195		28/12	
78	ACP-FLS10-PFE-204	Idea room Station Gas			/		/		/	/	195		28/12	
79	ACP-FLS10-PFE-205	Sport Center			/		/		/	/	195		28/12	
80	ACP-FLS10-PFE-206	Sport Center			/		/		/	/	195		28/12	

Acknowledge by:

Fire-Life Safety Teamleader

Approved by: ..

Heads of Department





10-02 Record of monthly inspection of all Portable Fire Extinguishers.


Month:..... Year:.....

[illegible]

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark
				Recharged	Normal	Over recharged	Pressure	Normal	Abnormal				
		Section	Location										
23	ACP-FLS10-PFE-096	Ocean Wing 10	6042		✓		195	✓				18-11-24	
24	ACP-FLS10-PFE-097		6044		✓		195	✓				18-11-24	
25	ACP-FLS10-PFE-098		6046		✓		195	✓				18-11-24	
26	ACP-FLS10-PFE-099	Ocean Wing 11	6048		✓		195	✓				18-11-24	
27	ACP-FLS10-PFE-100		6050		✓		195	✓				18-11-24	
28	ACP-FLS10-PFE-101		6052		✓		195	✓				18-11-24	
29	ACP-FLS10-PFE-102	Ocean Wing 12	6053		✓		195	✓				18-11-24	
30	ACP-FLS10-PFE-103		6055		✓		195	✓				18-11-24	
31	ACP-FLS10-PFE-104		6057		✓		195	✓				18-11-24	
32	ACP-FLS10-PFE-105	Ocean Wing 13	6058		✓		195	✓				18-11-24	
33	ACP-FLS10-PFE-106		6060		✓		195	✓				18-11-24	
34	ACP-FLS10-PFE-107		6062		✓		195	✓				18-11-24	
35	ACP-FLS10-PFE-108	Ocean Wing 14	6063		✓		195	✓				18-11-24	
36	ACP-FLS10-PFE-109		6066		✓		195	✓				18-11-24	
37	ACP-FLS10-PFE-110		6067		✓		195	✓				18-11-24	
38	ACP-FLS10-PFE-111	Ocean Wing 15	6069		✓		195	✓				18-11-24	
39	ACP-FLS10-PFE-112		6071		✓		195	✓				18-11-24	
40	ACP-FLS10-PFE-113		6073		✓		195	✓				18-11-24	
41	ACP-FLS10-PFE-114	Ocean Wing 16	6075		✓		195	✓				18-11-24	
42	ACP-FLS10-PFE-115		6077		✓		195	✓				18-11-24	
43	ACP-FLS10-PFE-116		6079		✓		195	✓				18-11-24	
44	ACP-FLS10-PFE-117	Ocean Wing 17	6081		✓		195	✓				18-11-24	
45	ACP-FLS10-PFE-118		6083		✓		195	✓				18-11-24	
46	ACP-FLS10-PFE-119		6086		✓		195	✓				18-11-24	
47	ACP-FLS10-PFE-120	Ocean Wing 18	6085		✓		195	✓				18-11-24	
48	ACP-FLS10-PFE-121		6090		✓		195	✓				18-11-24	
49	ACP-FLS10-PFE-122		6089		✓		195	✓				18-11-24	
50	ACP-FLS10-PFE-123	Ocean Wing 19	6087		✓		195	✓				18-11-24	
					✓		195	✓				18-11-24	
					✓		195	✓				18-11-24	
		Ocean Wing 20			✓		195	✓				18-11-24	
					✓		195	✓				18-11-24	
					✓		195	✓				18-11-24	

[illegible]

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)				Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal			
78	ACP-FLS10-PFE-151	Ocean Wing 33	6135		✓		195	✓		[Redacted]	17-7-24	
79	ACP-FLS10-PFE-152		6136		✓		195	✓			17-7-24	
80	ACP-FLS10-PFE-153	Ocean Wing 34	6137		✓		195	✓			17-7-24	
81	ACP-FLS10-PFE-154		6138		✓		195	✓			17-7-24	
82	ACP-FLS10-PFE-155	Ocean Wing 35	6139		✓		195	✓			17-7-24	
83	ACP-FLS10-PFE-156		6141		✓		195	✓			17-7-24	
84	ACP-FLS10-PFE-157	Ocean Wing 36	6142		✓		190	✓			17-7-24	
85	ACP-FLS10-PFE-158		6144		✓		195	✓			17-7-24	
86	ACP-FLS10-PFE-159	Ocean Wing 37	6145		✓		195	✓			17-7-24	
87	ACP-FLS10-PFE-160		6147	✓	✓		195	✓	✓		17-7-24	15th as indication
88	ACP-FLS10-PFE-161	Ocean Wing 38	6148		✓		195	✓			17-7-24	
89	ACP-FLS10-PFE-162		6149		✓		195	✓			17-7-24	
90	ACP-FLS10-PFE-163	Ocean Wing 39	6200		✓		195	✓			17-7-24	
91	ACP-FLS10-PFE-164		6200		✓		195	✓			17-7-24	
92	ACP-FLS10-PFE-165	Ocean Wing 40	6203		✓		195	✓			17-7-24	
93	ACP-FLS10-PFE-166		6205		✓		195	✓			17-7-24	
94	ACP-FLS10-PFE-167	Ocean Wing 41	6206		✓		195	✓			17-7-24	
95	ACP-FLS10-PFE-168		6208		✓		195	✓			17-7-24	
96	ACP-FLS10-PFE-169	Ocean Wing 42	6209		✓		195	✓			17-7-24	
97	ACP-FLS10-PFE-170		6211		✓		195	✓			17-7-24	
98	ACP-FLS10-PFE-171	Ocean Wing 43	6212		✓		195	✓			17-7-24	
99	ACP-FLS10-PFE-172		6215		✓		195	✓			17-7-24	
100	ACP-FLS10-PFE-173	Ocean Wing 44	6216		✓		195	✓			17-7-24	
101	ACP-FLS10-PFE-174		6218		✓		195	✓			17-7-24	
102	ACP-FLS10-PFE-175	Ocean Wing 45	6219		✓		195	✓			17-7-24	
103	ACP-FLS10-PFE-176		6221		✓		195	✓			17-7-24	
104	ACP-FLS10-PFE-177	Ocean Wing 46	6223		✓		195	✓			17-7-24	
105	ACP-FLS10-PFE-178		6224		✓		195	✓			17-7-24	

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)				Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal			
106	ACP-FLS10-PFE-179	Ocean Wing 47	6225		/		195	/			11-11-24	
107	ACP-FLS10-PFE-180		6227		/		195	/			11-11-24	
108	ACP-FLS10-PFE-181	Ocean Wing 48	6228		/		190	/			11-11-24	
109	ACP-FLS10-PFE-182		6230		/		195	/			11-11-24	
110	ACP-FLS10-PFE-183	Ocean Wing 49	6231		/		195	/			11-11-24	
111	ACP-FLS10-PFE-184		6233		/		195	/			11-11-24	
112	ACP-FLS10-PFE-185	Ocean Wing 50	6234		/		195	/			11-11-24	
113	ACP-FLS10-PFE-186		6236		/		195	/			11-11-24	
114	ACP-FLS10-PFE-187	ARP	H/K 1		/		195	/			11-11-24	
115	ACP-FLS10-PFE-188	ARP	MDB 4		/		195	/			11-11-24	
116	ACP-FLS10-PFE-189	ARP	Club House 1		/		195	/			11-11-24	
117	ACP-FLS10-PFE-190	ARP	Club House 2		/		195	/			11-11-24	
118	ACP-FLS10-PFE-191	ARP	Club House 3		/		195	/			11-11-24	
119	ACP-FLS10-PFE-192	ARP	Gas Club House		/		195	/			11-11-24	
120	ACP-FLS10-PFE-193	ARP	EE Club House		/		195	/			11-11-24	
121	ACP-FLS10-PFE-194	ARP	H/K 2		/		195	/			11-11-24	
122	ACP-FLS10-PFE-195	ARP	Fire pump1		/		195	/			18-11-24	
123	ACP-FLS10-PFE-196	ARP	Fire pump2		/		195	/			18-11-24	
124	ACP-FLS10-PFE-197	ARP	Generator 2		/		195	/			11-11-24	
125	ACP-FLS10-PFE-198	ARP	H/K 3		/		195	/			18-11-24	
126	ACP-FLS10-PFE-199	ARP	Staff toilet A7		/		195	/			11-11-24	
127	ACP-FLS10-PFE-207	ARP	Transformer 4		/		195	/			11-11-24	

Approve

Heads of

Acknowledge by:

Fire-Life Safety Teamleader

CHIEF ENGINEER

Engineering Department

FLS - 10 : Portable Fire Extinguishers

10-02 Record of monthly inspection of all Portable Fire Extinguishers.

Month: August Year: 2024

Ite m no.	FLS CODE	Area		Fire Extinguisher						
		Section	Location	Type of Chemical			Physical		Gauge	
				Dry	Halotron	Wet chemical	Normal	Abnormal		
1	ACP-FLS10-PFE-001	Floor 1/1	1101	/			/		/	195
2	ACP-FLS10-PFE-002	Floor 1/2	1206	/			/		/	195
3	ACP-FLS10-PFE-003	Floor 2/1	2101	/			/		/	195
4	ACP-FLS10-PFE-004	Floor 2/2	2204	/			/		/	195
5	ACP-FLS10-PFE-005	Floor 3/1	3101	/			/		/	195
6	ACP-FLS10-PFE-006	Floor 3/2	3201	/			/		/	195
7	ACP-FLS10-PFE-007	Floor 4/1	4101	/			/		/	195
8	ACP-FLS10-PFE-008	Floor 4/2	4205	/			/		/	195
9	ACP-FLS10-PFE-009	Floor 4/3	4305	/			/		/	195
10	ACP-FLS10-PFE-010	Building4	EE Room	/			/		/	195
11	ACP-FLS10-PFE-011	Building5	5105	/			/		/	195
12	ACP-FLS10-PFE-012	Building7	Coridor FL.1	/			/		/	195
13	ACP-FLS10-PFE-013		Store FL.2		/			/		195
14	ACP-FLS10-PFE-014		Store FL.3		/			/		195
15	ACP-FLS10-PFE-015	083 084 Spa 086	Front of spa reception	/			/		/	195
16	ACP-FLS10-PFE-016		Spa Reception		/			/		195
17	ACP-FLS10-PFE-017		Spa Sala 1		/			/		195
18	ACP-FLS10-PFE-018		Spa Sala 2		/			/		195
19	ACP-FLS10-PFE-019		Spa Sala 3		/			/		195
20	ACP-FLS10-PFE-020		Spa Sala 4		/			/		195
21	ACP-FLS10-PFE-021	Fitness	Fitness room	/			/		/	195
22	ACP-FLS10-PFE-022	Lift	Service Room	/			/		/	195
23	ACP-FLS10-PFE-023	Lagritta	In The Kitchen			/	/		/	195
24	ACP-FLS10-PFE-024	Lagritta	In The Kitchen	/			/		/	195

Ite m no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
				Section	Location	Type of Chemical			Physical				
		Dry	Halotron			Wet chemical	Normal	Abnormal	Status	Pressure			
25	ACP-FLS10-PFE-025	Lagritta Bar	Enteance	/			/			/	145	19-8-24	PS OK
26	ACP-FLS10-PFE-026	Main Store	In Store	/			/			/	145	19-8-24	PS OK
27	ACP-FLS10-PFE-027	Building 1	In Garden Room	/			/			/	145	19-8-24	
28	ACP-FLS10-PFE-028	Building 1	In Florist Room	/			/			/	145	19-8-24	
29	ACP-FLS10-PFE-029	Garbage	The Room	/			/			/	145	19-8-24	
30	ACP-FLS10-PFE-030	Garbage	The Room	/			/			/	145	19-8-24	PS OK
31	ACP-FLS10-PFE-031	Staff Canteen	In The Kitchen	/			/			/	145	19-8-24	
32	ACP-FLS10-PFE-032	Staff Canteen	In The Kitchen	/			/			/	145	19-8-24	
33	ACP-FLS10-PFE-033	Staff Canteen	Station Gas	/			/			/	145	19-8-24	PS OK
34	ACP-FLS10-PFE-034	Staff Canteen	In The Kitchen	/			/			/	145	19-8-24	
35	ACP-FLS10-PFE-035	Male Locker	In Staff Toilets	/			/			/	145	19-8-24	PS OK
36	ACP-FLS10-PFE-036	Female Locker	In Staff Toilets	/			/			/	145	19-8-24	
37	ACP-FLS10-PFE-037	HR. Room	In HR. Room	/			/			/	145	19-8-24	
38	ACP-FLS10-PFE-038	MDB3	Out HR. Room	/			/			/	145	19-8-24	
39	ACP-FLS10-PFE-039	Lagritta Pool	Lagritta Pool	/			/			/	145	19-8-24	
40	ACP-FLS10-PFE-040	Lobby	Entrance (OPR)	/			/			/	145	19-8-24	
41	ACP-FLS10-PFE-041	Store bell	In The Room	/			/			/	145	19-8-24	
42	ACP-FLS10-PFE-042	Executive Offices	Door Offices	/			/			/	145	19-8-24	
43	ACP-FLS10-PFE-043	Lagritta Station Gas	Lobby	/			/			/	145	19-8-24	
44	ACP-FLS10-PFE-044	Lagritta Station Gas	Lobby	/			/			/	145	19-8-24	
45	ACP-FLS10-PFE-045	Security No.1	Enteance	/			/			/	145	19-8-24	OF 2000
46	ACP-FLS10-PFE-046	Security No.2	Lobby	/			/			/	145	19-8-24	
47	ACP-FLS10-PFE-047	Security No.3	Time Kepper	/			/			/	145	19-8-24	
48	ACP-FLS10-PFE-048	Accounting	In The Room	/			/			/	145	19-8-24	
49	ACP-FLS10-PFE-049	Main Kitchen	Entrance	/			/			/	145	19-8-24	PS OK
50	ACP-FLS10-PFE-050	Main Kitchen	Entrance	/			/			/	145	19-8-24	PS OK
51	ACP-FLS10-PFE-051	Main Kitchen	Out The Room	/			/			/	145	19-8-24	PS OK
52	ACP-FLS10-PFE-052	Main Kitchen	In The Room	/			/			/	145	19-8-24	PS OK
53	ACP-FLS10-PFE-053	House Keeping	In The Room	/			/			/	145	19-8-24	
54	ACP-FLS10-PFE-054	Generator MDB 1	Entrance	/			/			/	145	19-8-24	
55	ACP-FLS10-PFE-055	Generator MDB 1	In The Room	/			/			/	145	19-8-24	

Ite m no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
		Section	Location	Type of Chemical			Physical		Gauge				
				Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure			
56	ACP-FLS10-PFE-056	GM House	Entrance										056* 058 WPS 059
57	ACP-FLS10-PFE-057	Laundry	Up The Stairs	/			/			/			058 WPS 059
58	ACP-FLS10-PFE-058	Laundry	Station	/			/			/			058 WPS 059
60	ACP-FLS10-PFE-059	Laundry	Station	/			/			/			058 WPS 059
61	ACP-FLS10-PFE-061	Boiler room	In the room	/			/			/			058 WPS 059
62	ACP-FLS10-PFE-062	Eng. Work Shop	Tools Room	/			/			/			058 WPS 059
63	ACP-FLS10-PFE-063	Eng. Work Shop	MDR Room	/			/			/			058 WPS 059
64	ACP-FLS10-PFE-064	Eng. Work Shop	Painter Room	/			/			/			058 WPS 059
65	ACP-FLS10-PFE-065	Oil Station	Desel Tank	/			/			/			058 WPS 059
66	ACP-FLS10-PFE-066	Walkway Rim talay		/			/			/			058 WPS 059
67	ACP-FLS10-PFE-067	Voyagerlounge		/			/			/			058 WPS 059
68	ACP-FLS10-PFE-068	Gas Station	Laundry	/			/			/			058 WPS 059
69	ACP-FLS10-PFE-069	Mortorbike Garage1		/			/			/			058 WPS 059
70	ACP-FLS10-PFE-070	Mortorbike Garage2		/			/			/			058 WPS 059
71	ACP-FLS10-PFE-071	Rimtalay pump room		/			/			/			058 WPS 059
72	ACP-FLS10-PFE-072	Kidclub		/			/			/			058 WPS 059
73	ACP-FLS10-PFE-073	Fire Training		/			/			/			058 WPS 059
74	ACP-FLS10-PFE-200	PABX room		/			/			/			058 WPS 059
74	ACP-FLS10-PFE-200	PABX room		/			/			/			058 WPS 059
75	ACP-FLS10-PFE-201	EE room B.2		/			/			/			058 WPS 059
76	ACP-FLS10-PFE-202	Pantry smurt bar 1		/			/			/			058 WPS 059
77	ACP-FLS10-PFE-203	Pantry smurt bar 2		/			/			/			058 WPS 059
78	ACP-FLS10-PFE-204	Idea room Station Gas		/			/			/			058 WPS 059
79	ACP-FLS10-PFE-205	Sport Center		/			/			/			058 WPS 059
80	ACP-FLS10-PFE-206	Sport Center		/			/			/			058 WPS 059

Approved by: [Signature]
 Heads of Dept: [Signature]
 Acknowledged: [Signature]
 Fire-Life Safety

Engineering Department

FLS - 10 : Portable Fire Extinguishers







10-02 Record of monthly inspection of all Portable Fire Extinguishers.


Month: Sep Year: 2024

Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark	
		Section	Location	Type of Chemical		Physical		Gauge						
				Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure				
1	ACP-PPE-001	Floor 1/1	1101		✓		✓			✓				
2	ACP-PPE-002	Floor 1/2	1206		✓		✓			✓				
3	ACP-PPE-003	Floor 2/1	2101		✓		✓			✓				
4	ACP-PPE-004	Floor 2/2	2204		✓		✓			✓				
5	ACP-PPE-005	Floor 3/1	3101		✓		✓			✓				
6	ACP-PPE-006	Floor 3/2	3201		✓		✓			✓				
7	ACP-PPE-007	Floor 4/1	4101		✓		✓			✓				
8	ACP-PPE-008	Floor 4/2	4205		✓		✓			✓				
9	ACP-PPE-009	Floor 4/3	4305		✓		✓			✓				
10	ACP-PPE-010	Building 4	EE Room		✓		✓			✓				
11	ACP-PPE-011	Building 5	5105		✓		✓			✓				
12	ACP-PPE-012	Building 5	5205		✓		✓			✓				
13	ACP-PPE-013	Building 5	5305		✓		✓			✓				
14	ACP-PPE-014	Building 7	Corridor FL.1		✓		✓			✓				
15	ACP-PPE-015	Building 7	Store FL.2		✓		✓			✓				
16	ACP-PPE-016	Building 7	Store FL.3		✓		✓			✓				
17	ACP-PPE-017	Building 7	7107		✓		✓			✓				
18	ACP-PPE-018	Building 7	7123		✓		✓			✓				
19	ACP-PPE-019	Building 7	7207		✓		✓			✓				
20	ACP-PPE-020	Building 7	7223		✓		✓			✓				
21	ACP-PPE-021	Building 7	7307		✓		✓			✓				
22	ACP-PPE-022	Building 7	7323		✓		✓			✓				
23	ACP-PPE-023	Lagritta	In The Kitchen			✓	✓			✓				

Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
				Type of Chemical			Physical		Gauge				
		Section	Location	Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure			
24	ACP-PPE-024	Lagritta	In The Kitchen			✓	✓		✓				
25	ACP-PPE-025	Lagritta Bar	Enteance				✓		✓				
26	ACP-PPE-026	Main Store	In Store				✓		✓				
27	ACP-PPE-027	Building 1	In Garden Room				✓		✓				
28	ACP-PPE-028	Building 1	In Florist Room				✓		✓				
29	ACP-PPE-029	Garbage	The Room				✓		✓				
30	ACP-PPE-030	Garbage	The Room				✓		✓				
31	ACP-PPE-031	Staff Canteen	In The Kitchen				✓		✓				
32	ACP-PPE-032	Staff Canteen	In The Kitchen				✓		✓				
33	ACP-PPE-033	Staff Canteen	Station Gas					✓	✓				
34	ACP-PPE-034	Staff Canteen	In The Kitchen					✓	✓				
35	ACP-PPE-035	Male Locker	In Staff Toilets				✓		✓				
36	ACP-PPE-036	Female Locker	In Staff Toilets				✓		✓				
37	ACP-PPE-037	HR. Room	In HR. Room				✓		✓				
38	ACP-PPE-038	MDB3	Out HR. Room				✓		✓				
39	ACP-PPE-039	Lagritta Pool	Lagritta Pool				✓		✓				
40	ACP-PPE-040	Lobby	Entrance (OPR)				✓		✓				
41	ACP-PPE-041	Store bell	In The Room				✓		✓				
42	ACP-PPE-042	Executive Offices	Door Offices				✓		✓				
43	ACP-PPE-043	Lagritta Station Gas	Lobby	✓			✓		✓				
44	ACP-PPE-044	Lagritta Station Gas	Lobby	✓			✓		✓				
45	ACP-PPE-045	Secueity No.1	Enteance				✓		✓				
46	ACP-PPE-046	Secueity No.2	Lobby				✓		✓				
47	ACP-PPE-047	Secueity No.3	Time Kepper				✓		✓				
48	ACP-PPE-048	Accounting	In The Room				✓		✓				
49	ACP-PPE-049	Main Kitchen	Entrance				✓		✓				
50	ACP-PPE-050	Main Kitchen	Entrance					✓	✓				
51	ACP-PPE-051	Main Kitchen	Out The Room					✓	✓				
52	ACP-PPE-052	Main Kitchen	In The Room					✓	✓				
53	ACP-PPE-053	House Keeping	In The Room				✓		✓				

[illegible]

Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark		
		Section	Location	Type of Chemical			Physical		Gauge	Status				Pressure	
				Dry	Halotron	Wet chemical	Normal	Abnormal							
82	ACP-PPE-082	Spa	Front of spa reception		✓				✓		✓				
83	ACP-PPE-083		Spa Reception		✓				✓		✓				
84	ACP-PPE-084		Spa Sala 1		✓				✓		✓				
85	ACP-PPE-085		Spa Sala 2		✓				✓		✓				
86	ACP-PPE-086		Spa Sala 3		✓				✓		✓				
87	ACP-PPE-087		Spa Sala 4		✓				✓		✓				
88	ACP-PPE-088	Fitness	Fitness room		✓				✓		✓				
89	ACP-PPE-089	Lift	Service Room		✓				✓		✓				
90	ACP-PPE-090	GM House	Entrance		✓				✓		✓				
91	ACP-PPE-091	Jetty 1			✓				✓		✓				
92	ACP-PPE-092	Jetty 2			✓				✓		✓				

Acknowledge by: 

Fire-Life Safety Te

Approved by:

Heads of Department



Engineering Department

FLS - 10 : Portable Fire Extinguishers

10-02 Record of monthly inspection of all Portable Fire Extinguishers.

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)				Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal			
1	ACP-FLS10-PFE-074	Ocean Wing 1	6000		✓		195	✓		[Redacted]	22-9-67	
2	ACP-FLS10-PFE-075		6002		✓		195	✓			22-9-67	
3	ACP-FLS10-PFE-076		6004		✓		195	✓			22-9-67	
4	ACP-FLS10-PFE-077	Ocean Wing 2	6006		✓		195	✓			22-9-67	
5	ACP-FLS10-PFE-078		6008		✓		195	✓			22-9-67	
6	ACP-FLS10-PFE-079		6010		✓		195	✓			22-9-67	
7	ACP-FLS10-PFE-080	Ocean Wing 3	6012		✓		195	✓			22-9-67	
8	ACP-FLS10-PFE-081		6015		✓		195	✓			22-9-67	
9	ACP-FLS10-PFE-082		6016		✓		195	✓			22-9-67	
10	ACP-FLS10-PFE-083	Ocean Wing 4	6017		✓		195	✓			22-9-67	
11	ACP-FLS10-PFE-084		6020		✓		195	✓			22-9-67	
12	ACP-FLS10-PFE-085	Ocean Wing 5	6021		✓		195	✓			22-9-67	
13	ACP-FLS10-PFE-086		6023		✓		195	✓			22-9-67	
14	ACP-FLS10-PFE-087	Ocean Wing 6	6024		✓		195	✓			22-9-67	
15	ACP-FLS10-PFE-088		6026		✓		195	✓			22-9-67	
16	ACP-FLS10-PFE-089	Ocean Wing 7	6028		✓		195	✓			22-9-67	
17	ACP-FLS10-PFE-090		6031		✓		195	✓			22-9-67	
18	ACP-FLS10-PFE-091	Ocean Wing 8	6032		✓		195	✓			22-9-67	
19	ACP-FLS10-PFE-092		6035		✓		195	✓			22-9-67	
20	ACP-FLS10-PFE-093	Ocean Wing 9	6036		✓		195	✓			22-9-67	
21	ACP-FLS10-PFE-094		6038		✓		195	✓			22-9-67	
22	ACP-FLS10-PFE-095		6040		✓		195	✓			22-9-67	

Month: Sep Year: 2022

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal				
23	ACP-FLS10-PFE-096	Ocean Wing 10	6042	✓	✓		195	✓		[REDACTED]	19-9-67		
24	ACP-FLS10-PFE-097		6044	✓	✓		195	✓			19-9-67		
25	ACP-FLS10-PFE-098		6046	✓	✓		195	✓			19-9-67		
26	ACP-FLS10-PFE-099		6048	✓	✓		195	✓			19-9-67		
27	ACP-FLS10-PFE-100	Ocean Wing 11	6050	✓	✓		195	✓			19-9-67		
28	ACP-FLS10-PFE-101		6052	✓	✓		195	✓			19-9-67		
29	ACP-FLS10-PFE-102		6053	✓	✓		195	✓			19-9-67		
30	ACP-FLS10-PFE-103		6055	✓	✓		195	✓			19-9-67		
31	ACP-FLS10-PFE-104	Ocean Wing 12	6057	✓	✓		195	✓			19-9-67		
32	ACP-FLS10-PFE-105		6058	✓	✓		195	✓			19-9-67		
33	ACP-FLS10-PFE-106		6060	✓	✓		195	✓			19-9-67		
34	ACP-FLS10-PFE-107		6062	✓	✓		195	✓			19-9-67		
35	ACP-FLS10-PFE-108	Ocean Wing 13	6063	✓	✓		195	✓			19-9-67		
36	ACP-FLS10-PFE-109		6066	✓	✓		195	✓			19-9-67		
37	ACP-FLS10-PFE-110		6067	✓	✓		195	✓			19-9-67		
38	ACP-FLS10-PFE-111		6069	✓	✓		195	✓			19-9-67		
39	ACP-FLS10-PFE-112	Ocean Wing 14	6071	✓	✓		195	✓			19-9-67		
40	ACP-FLS10-PFE-113		6073	✓	✓		195	✓			19-9-67		
41	ACP-FLS10-PFE-114		6075	✓	✓		195	✓			19-9-67		
42	ACP-FLS10-PFE-115		6077	✓	✓		195	✓			19-9-67		
43	ACP-FLS10-PFE-116	Ocean Wing 15	6079	✓	✓		195	✓			19-9-67		
44	ACP-FLS10-PFE-117		6081	✓	✓		195	✓			19-9-67		
45	ACP-FLS10-PFE-118		6083	✓	✓		195	✓			19-9-67		
46	ACP-FLS10-PFE-119		6086	✓	✓		195	✓			19-9-67		
47	ACP-FLS10-PFE-120	Ocean Wing 16	6085	✓	✓		195	✓			19-9-67		
48	ACP-FLS10-PFE-121		6090	✓	✓		195	✓			19-9-67		
49	ACP-FLS10-PFE-122		6089	✓	✓		195	✓			19-9-67		
50	ACP-FLS10-PFE-123		6087	✓	✓		195	✓			19-9-67		

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal				
51	ACP-FLS10-PFE-124	Ocean Wing 21	6091		✓		195	✓		[REDACTED]	18-9-67		
52	ACP-FLS10-PFE-125		6093		✓		195	✓				18-9-67	
53	ACP-FLS10-PFE-126		6095		✓		195	✓				18-9-67	
54	ACP-FLS10-PFE-127	Ocean Wing 22	6097		✓		195	✓				18-9-67	
55	ACP-FLS10-PFE-128		6099		✓		195	✓				18-9-67	
56	ACP-FLS10-PFE-129		6101		✓		195	✓				18-9-67	
57	ACP-FLS10-PFE-130	Ocean Wing 23	6103		✓		195	✓				18-9-67	
58	ACP-FLS10-PFE-131		6105		✓		195	✓				18-9-67	
59	ACP-FLS10-PFE-132		6107		✓		195	✓				18-9-67	
60	ACP-FLS10-PFE-133	Ocean Wing 24	6109		✓		195	✓				18-9-67	
61	ACP-FLS10-PFE-134		6112		✓		195	✓				18-9-67	
62	ACP-FLS10-PFE-135		6114		✓		195	✓				18-9-67	
63	ACP-FLS10-PFE-136	Ocean Wing 25	6116		✓		195	✓				18-9-67	
64	ACP-FLS10-PFE-137		6118		✓		195	✓				18-9-67	
65	ACP-FLS10-PFE-138		6120		✓		195	✓				18-9-67	
66	ACP-FLS10-PFE-139	Ocean Wing 26	6121		✓		195	✓				18-9-67	
67	ACP-FLS10-PFE-140		6123		✓		195	✓				18-9-67	
68	ACP-FLS10-PFE-141		6124		✓		195	✓				18-9-67	
69	ACP-FLS10-PFE-142	Ocean Wing 27	6126		✓		195	✓				18-9-67	
70	ACP-FLS10-PFE-143		6127		✓		195	✓				18-9-67	
71	ACP-FLS10-PFE-144		6128		✓		195	✓				18-9-67	
72	ACP-FLS10-PFE-145	Ocean Wing 28	6129		✓		195	✓				18-9-67	
73	ACP-FLS10-PFE-146		6130		✓		195	✓				18-9-67	
74	ACP-FLS10-PFE-147		6131		✓		195	✓				18-9-67	
75	ACP-FLS10-PFE-148	Ocean Wing 29	6132		✓		195	✓				18-9-67	
76	ACP-FLS10-PFE-149		6133		✓		195	✓				18-9-67	
77	ACP-FLS10-PFE-150		6134		✓		195	✓				18-9-67	
		Ocean Wing 30											
		Ocean Wing 31											
		Ocean Wing 32											

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal				
78	ACP-FLS10-PFE-151	Ocean Wing 33	6135		✓		195	✓		<div></div>	22-9-67		
79	ACP-FLS10-PFE-152		6136			✓		195	✓			22-9-67	
80	ACP-FLS10-PFE-153	Ocean Wing 34	6137		✓		195	✓			22-9-67		
81	ACP-FLS10-PFE-154		6138			✓		195	✓			22-9-67	
82	ACP-FLS10-PFE-155	Ocean Wing 35	6139		✓		195	✓			22-9-67		
83	ACP-FLS10-PFE-156		6141			✓		195	✓			19-9-67	
84	ACP-FLS10-PFE-157	Ocean Wing 36	6142		✓		195	✓			19-9-67		
85	ACP-FLS10-PFE-158		6144			✓		195	✓			19-9-67	
86	ACP-FLS10-PFE-159	Ocean Wing 37	6145		✓		195	✓			18-9-67		
87	ACP-FLS10-PFE-160		6147			✓		195	✓			18-9-67	
88	ACP-FLS10-PFE-161	Ocean Wing 38	6148		✓		195	✓			18-9-67		
89	ACP-FLS10-PFE-162		6149			✓		195	✓			18-9-67	
90	ACP-FLS10-PFE-163	Ocean Wing 39	6200		✓		195	✓			18-9-67		
91	ACP-FLS10-PFE-164		6200			✓		195	✓			18-9-67	
92	ACP-FLS10-PFE-165	Ocean Wing 40	6203		✓		195	✓			18-9-67		
93	ACP-FLS10-PFE-166		6205			✓		195	✓			18-9-67	
94	ACP-FLS10-PFE-167	Ocean Wing 41	6206		✓		195	✓			18-9-67		
95	ACP-FLS10-PFE-168		6208			✓		195	✓			18-9-67	
96	ACP-FLS10-PFE-169	Ocean Wing 42	6209		✓		195	✓			18-9-67		
97	ACP-FLS10-PFE-170		6211			✓		195	✓			18-9-67	
98	ACP-FLS10-PFE-171	Ocean Wing 43	6212		✓		195	✓			18-9-67		
99	ACP-FLS10-PFE-172		6215			✓		195	✓			18-9-67	
100	ACP-FLS10-PFE-173	Ocean Wing 44	6216		✓		195	✓			18-9-67		
101	ACP-FLS10-PFE-174		6218			✓		195	✓			18-9-67	
102	ACP-FLS10-PFE-175	Ocean Wing 45	6219		✓		195	✓			18-9-67		
103	ACP-FLS10-PFE-176		6221			✓		195	✓			18-9-67	
104	ACP-FLS10-PFE-177	Ocean Wing 46	6223		✓		195	✓			18-9-67		
105	ACP-FLS10-PFE-178		6224			✓		195	✓			18-9-67	

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark	
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal					
106	ACP-FLS10-PFE-179	Ocean Wing 47	6225		✓			195	✓				18-9-67	
107	ACP-FLS10-PFE-180		6227			✓			195	✓				18-9-67
108	ACP-FLS10-PFE-181	Ocean Wing 48	6228		✓			195	✓				18-9-67	
109	ACP-FLS10-PFE-182		6230			✓			195	✓				18-9-67
110	ACP-FLS10-PFE-183	Ocean Wing 49	6231		✓			195	✓				18-9-67	
111	ACP-FLS10-PFE-184		6233			✓			195	✓				18-9-67
112	ACP-FLS10-PFE-185	Ocean Wing 50	6234		✓			195	✓				18-9-67	
113	ACP-FLS10-PFE-186		6236			✓			195	✓				18-9-67
114	ACP-FLS10-PFE-187	ARP	H/K 1		✓			195	✓				18-9-67	
115	ACP-FLS10-PFE-188	ARP	MDB 4		✓			195	✓				18-9-67	
116	ACP-FLS10-PFE-189	ARP	Club House 1		✓			195	✓				17-9-67	
117	ACP-FLS10-PFE-190	ARP	Club House 2		✓			195	✓				18-9-67	
118	ACP-FLS10-PFE-191	ARP	Club House 3		✓			195	✓				18-9-67	
119	ACP-FLS10-PFE-192	ARP	Gas Club House		✓			195	✓				18-9-67	
120	ACP-FLS10-PFE-193	ARP	EE Club House		✓			195	✓				18-9-67	
121	ACP-FLS10-PFE-194	ARP	H/K 2		✓			195	✓				18-9-67	
122	ACP-FLS10-PFE-195	ARP	Fire pump1		✓			195	✓				18-9-67	
123	ACP-FLS10-PFE-196	ARP	Fire pump2		✓			195	✓				18-9-67	
124	ACP-FLS10-PFE-197	ARP	Genarator 2		✓			195	✓				18-9-67	
125	ACP-FLS10-PFE-198	ARP	H/K 3		✓			195	✓				18-9-67	
126	ACP-FLS10-PFE-199	ARP	Staff toilet A7		✓			195	✓				18-9-67	
127	ACP-FLS10-PFE-207	ARP			✓			195	✓				18-9-67	

Acknowledge by

Fire-Life Safety T

Engineering Department

FLS - 10 : Portable Fire Extinguishers

10-02 Record of monthly inspection of all Portable Fire Extinguishers.

Month: SEPTEMBER Year: 2020

Item no.	FLS CODE	Area		Fire Extinguisher					Date	Remark
		Section	Location	Type of	Chemical	Physical	Abnormal	Status		
1	ACP-FLS10-PFE-001	Floor 1/1	1101	Dry	Halotron	Wet chemical	Normal	OK	1915	
2	ACP-FLS10-PFE-002	Floor 1/2	1206					OK	1916	
3	ACP-FLS10-PFE-003	Floor 2/1	2101					OK	1916	
4	ACP-FLS10-PFE-004	Floor 2/2	2204					OK	1916	
5	ACP-FLS10-PFE-005	Floor 3/1	3101					OK	1916	
6	ACP-FLS10-PFE-006	Floor 3/2	3201					OK	1916	
7	ACP-FLS10-PFE-007	Floor 4/1	4101					OK	1916	
8	ACP-FLS10-PFE-008	Floor 4/2	4205					OK	1916	
9	ACP-FLS10-PFE-009	Floor 4/3	4305					OK	1916	
10	ACP-FLS10-PFE-010	Building4	EE Room					OK	1916	
11	ACP-FLS10-PFE-011	Building5	5105					OK	1916	
12	ACP-FLS10-PFE-012		Corridor FL.1					OK	1916	
13	ACP-FLS10-PFE-013	Building7	Store FL.2					OK	1916	
14	ACP-FLS10-PFE-014		Store FL.3					OK	1916	
15	ACP-FLS10-PFE-015		Front of spa reception					OK	1916	
16	ACP-FLS10-PFE-016		Spa Reception					OK	1916	
17	ACP-FLS10-PFE-017	Spa	Spa Sala 1					OK	1916	
18	ACP-FLS10-PFE-018		Spa Sala 2					OK	1916	
19	ACP-FLS10-PFE-019		Spa Sala 3					OK	1916	
20	ACP-FLS10-PFE-020		Spa Sala 4					OK	1916	
21	ACP-FLS10-PFE-021	Fitness	Fitness room					OK	1916	
22	ACP-FLS10-PFE-022	Lift	Service Room					OK	1916	
23	ACP-FLS10-PFE-023	Lagritta	In The Kitchen					OK	1916	
24	ACP-FLS10-PFE-024	Lagritta	In The Kitchen					OK	1916	

Ite m no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark	
		Section	Location	Type of			Physical		Gauge					
				Dry	Halotron	Chemical	Normal	Abnormal						
25	ACP-FLS10-PFE-025	Lagritta Bar	Enteance		✓			✓		OK	19		19-10-24	
26	ACP-FLS10-PFE-026	Main Store	In Store		✓			✓		OK	19		19-10-24	
27	ACP-FLS10-PFE-027	Building 1	In Garden Room		✓			✓		OK	19		19-10-24	
28	ACP-FLS10-PFE-028	Building 1	In Florist Room		✓			✓		OK	19		19-10-24	
29	ACP-FLS10-PFE-029	Garbage	The Room		✓			✓		OK	19		19-10-24	
30	ACP-FLS10-PFE-030	Garbage	The Room		✓			✓		OK	19		19-10-24	
31	ACP-FLS10-PFE-031	Staff Canteen	In The Kitchen		✓			✓		OK	19		19-10-24	
32	ACP-FLS10-PFE-032	Staff Canteen	In The Kitchen		✓			✓		OK	19		19-10-24	
33	ACP-FLS10-PFE-033	Staff Canteen	Station Gas		✓		✓	✓		OK	19		19-10-24	
34	ACP-FLS10-PFE-034	Staff Canteen	In The Kitchen				✓		✓		19		19-10-24	
35	ACP-FLS10-PFE-035	Male Locker	In Staff Toilets		✓			✓		OK	19		19-10-24	
36	ACP-FLS10-PFE-036	Female Locker	In Staff Toilets		✓			✓		OK	19		19-10-24	
37	ACP-FLS10-PFE-037	HR. Room	In HR. Room		✓			✓		OK	19		19-10-24	
38	ACP-FLS10-PFE-038	MDB3	Out HR. Room		✓			✓		OK	19		19-10-24	
39	ACP-FLS10-PFE-039	Lagritta Pool	Lagritta Pool		✓			✓		OK	19		19-10-24	
40	ACP-FLS10-PFE-040	Lobby	Entrance (OPR)		✓			✓		OK	19		19-10-24	
41	ACP-FLS10-PFE-041	Store bell	In The Room		✓			✓		OK	19		19-10-24	
42	ACP-FLS10-PFE-042	Executive Offices	Door Offices		✓			✓		OK	19		19-10-24	
43	ACP-FLS10-PFE-043	Lagritta Station Gas	Lobby	✓				✓		OK	19		19-10-24	
44	ACP-FLS10-PFE-044	Lagritta Station Gas	Lobby	✓				✓		OK	19		19-10-24	
45	ACP-FLS10-PFE-045	Security No.1	Enteance		✓					OK	19		19-10-24	
46	ACP-FLS10-PFE-046	Security No.2	Lobby		✓					OK	19		19-10-24	
47	ACP-FLS10-PFE-047	Security No.3	Time Kepper		✓					OK	19		19-10-24	
48	ACP-FLS10-PFE-048	Accounting	In The Room		✓			✓		OK	19		19-10-24	
49	ACP-FLS10-PFE-049	Main Kitchen	Entrance		✓			✓		OK	19		19-10-24	
50	ACP-FLS10-PFE-050	Main Kitchen	Entrance		✓			✓		OK	19		19-10-24	
51	ACP-FLS10-PFE-051	Main Kitchen	Out The Room		✓			✓		OK	19		19-10-24	
52	ACP-FLS10-PFE-052	Main Kitchen	In The Room				✓		✓		19		19-10-24	
53	ACP-FLS10-PFE-053	House Keeping	In The Room		✓			✓		OK	19		19-10-24	
54	ACP-FLS10-PFE-054	Generator MDB 1	Entrance		✓				✓	OK	19		19-10-24	
55	ACP-FLS10-PFE-055	Generator MDB 1	In The Room		✓				✓	OK	19		19-10-24	

Ite m no.	FLS CODE	Area		Fire Extinguisher								Checked by	Date	Remark	
				Type of Chemical			Physical		Gauge						
		Section	Location	Dry	Chemical		Normal	Abnormal	Status	Pressure					
					Halotron	Wet chemical									
56	ACP-FLS10-PFE-056	GM House	Entrance		✓										
57	ACP-FLS10-PFE-057	Laundry	Up The Stairs		✓		✓			OK	19		19-10-24		
58	ACP-FLS10-PFE-058	Laundry	Station		✓		✓			OK	19		19-10-24		
60	ACP-FLS10-PFE-060	Laundry	Station		✓		✓			OK	19		19-10-24		
61	ACP-FLS10-PFE-061	Boiler room	In the room		✓		✓			OK	19		19-10-24		
62	ACP-FLS10-PFE-062	Eng. Work Shop	Tools Room		✓		✓			OK	19		19-10-24		
63	ACP-FLS10-PFE-063	Eng. Work Shop	MDB Room		✓		✓			OK	19		19-10-24		
64	ACP-FLS10-PFE-064	Eng. Work Shop	Painter Room							OK	19		19-10-24		
65	ACP-FLS10-PFE-065	Oil Station	Desel Tank		✓	✓				OK	19		19-10-24		
66	ACP-FLS10-PFE-066	Walkway Rim talay			✓		✓			OK	19		19-10-24		
67	ACP-FLS10-PFE-067	Voyagerlounge			✓		✓			OK	19		19-10-24		
68	ACP-FLS10-PFE-068	Gas Station	Laundry		✓		✓			OK	19		19-10-24		
69	ACP-FLS10-PFE-069	Mortorbike Garage1			✓		✓			OK	19		19-10-24		
70	ACP-FLS10-PFE-070	Mortorbike Garage2			✓		✓			OK	19		19-10-24		
71	ACP-FLS10-PFE-071	Rimtalay pump room			✓		✓			OK	19		19-10-24		
72	ACP-FLS10-PFE-072	Kidclub			✓		✓			OK	19		19-10-24		
73	ACP-FLS10-PFE-073	Fire Training			✓		✓			OK	19		19-10-24		
74	ACP-FLS10-PFE-200	PABX room			✓		✓			OK	19		19-10-24		
74	ACP-FLS10-PFE-200	PABX room			✓		✓			OK	19		19-10-24		
75	ACP-FLS10-PFE-201	EE room B.2			✓		✓			OK	19		19-10-24		
76	ACP-FLS10-PFE-202	Pantry smurt bar 1			✓		✓			OK	19		19-10-24		
77	ACP-FLS10-PFE-203	Pantry smurt bar 2			✓		✓			OK	19		19-10-24		
78	ACP-FLS10-PFE-204	Idea room Station Gas			✓		✓			OK	19		19-10-24		
79	ACP-FLS10-PFE-205	Sport Center			✓		✓			OK	19		19-10-24		
80	ACP-FLS10-PFE-206	Sport Center			✓		✓			OK	19		19-10-24		

Acknowledge by: [Redacted]

Approved by: [Redacted]

Fire-Life Safety T [Redacted]

Heads of Department [Redacted]

Engineering Department

FLS - 10 : Portable Fire Extinguishers

10-02 Record of monthly inspection of all Portable Fire Extinguishers.

Month: 03-03-2024 Year: 2024


Item No.	FLS CODE	Area		Extinguisher (Dry chemical)				Physical		Checked	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abn			
1	ACP-FLS10-PFE-074	Ocean Wing 1	6000		✓		195	✓			28-10-67	
2	ACP-FLS10-PFE-075		6002		✓		195	✓			28-10-67	
3	ACP-FLS10-PFE-076		6004		✓		195	✓			28-10-67	
4	ACP-FLS10-PFE-077	Ocean Wing 2	6006		✓		195	✓			28-10-67	
5	ACP-FLS10-PFE-078		6008		✓		195	✓			28-10-67	
6	ACP-FLS10-PFE-079		6010		✓		195	✓			28-10-67	
7	ACP-FLS10-PFE-080	Ocean Wing 3	6012		✓		195	✓			28-10-67	
8	ACP-FLS10-PFE-081		6015		✓		195	✓			28-10-67	
9	ACP-FLS10-PFE-082		6016		✓		195	✓			28-10-67	
10	ACP-FLS10-PFE-083	Ocean Wing 4	6017		✓		195	✓			28-10-67	
11	ACP-FLS10-PFE-084		6020		✓		195	✓			28-10-67	
12	ACP-FLS10-PFE-085	Ocean Wing 5	6021		✓		195	✓			28-10-67	
13	ACP-FLS10-PFE-086		6023		✓		195	✓			28-10-67	
14	ACP-FLS10-PFE-087	Ocean Wing 6	6024		✓		195	✓			28-10-67	
15	ACP-FLS10-PFE-088		6026		✓		195	✓			28-10-67	
16	ACP-FLS10-PFE-089	Ocean Wing 7	6028		✓		195	✓			28-10-67	
17	ACP-FLS10-PFE-090		6031		✓		195	✓			28-10-67	
18	ACP-FLS10-PFE-091	Ocean Wing 8	6032		✓		195	✓			28-10-67	
19	ACP-FLS10-PFE-092		6035		✓		195	✓			28-10-67	
20	ACP-FLS10-PFE-093		6036		✓		195	✓			28-10-67	
21	ACP-FLS10-PFE-094	Ocean Wing 9	6038		✓		195	✓			28-10-67	
22	ACP-FLS10-PFE-095		6040		✓		195	✓			28-10-67	

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark		
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal						
23	ACP-FLS10-PFE-096	Ocean Wing 10	6042		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
24	ACP-FLS10-PFE-097		6044		✓				195	✓				28-10-67	
25	ACP-FLS10-PFE-098		6046		✓				195	✓				28-10-67	
26	ACP-FLS10-PFE-099	Ocean Wing 11	6048		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
27	ACP-FLS10-PFE-100		6050		✓				195	✓				28-10-67	
28	ACP-FLS10-PFE-101		6052		✓				195	✓				28-10-67	
29	ACP-FLS10-PFE-102	Ocean Wing 12	6053		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
30	ACP-FLS10-PFE-103		6055		✓				195	✓				28-10-67	
31	ACP-FLS10-PFE-104		6057		✓				195	✓				28-10-67	
32	ACP-FLS10-PFE-105	Ocean Wing 13	6058		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
33	ACP-FLS10-PFE-106		6060		✓				195	✓				28-10-67	
34	ACP-FLS10-PFE-107		6062		✓				195	✓				28-10-67	
35	ACP-FLS10-PFE-108	Ocean Wing 14	6063		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
36	ACP-FLS10-PFE-109		6066		✓				195	✓				28-10-67	
37	ACP-FLS10-PFE-110		6067		✓				195	✓				28-10-67	
38	ACP-FLS10-PFE-111	Ocean Wing 15	6069		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
39	ACP-FLS10-PFE-112		6071		✓				195	✓				28-10-67	
40	ACP-FLS10-PFE-113		6073		✓				195	✓				28-10-67	
41	ACP-FLS10-PFE-114	Ocean Wing 17	6075		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
42	ACP-FLS10-PFE-115		6077		✓				195	✓				28-10-67	
43	ACP-FLS10-PFE-116		6079		✓				195	✓				28-10-67	
44	ACP-FLS10-PFE-117	Ocean Wing 18	6081		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
45	ACP-FLS10-PFE-118		6083		✓				195	✓				28-10-67	
46	ACP-FLS10-PFE-119		6086		✓				195	✓				28-10-67	
47	ACP-FLS10-PFE-120	Ocean Wing 19	6085		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		
48	ACP-FLS10-PFE-121		6090		✓				195	✓				28-10-67	
49	ACP-FLS10-PFE-122		6089		✓				195	✓				28-10-67	
50	ACP-FLS10-PFE-123	Ocean Wing 20	6087		✓			195	✓		[REDACTED]	[REDACTED]	28-10-67		

[illegible]

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal				
78	ACP-FLS10-PFE-151	Ocean Wing 33	6135		✓		195	✓			20-10-67		
79	ACP-FLS10-PFE-152		6136		✓		195	✓			20-10-67		
80	ACP-FLS10-PFE-153	Ocean Wing 34	6137		✓		195	✓			20-10-67		
81	ACP-FLS10-PFE-154		6138		✓		195	✓			20-10-67		
82	ACP-FLS10-PFE-155	Ocean Wing 35	6139		✓		195	✓			20-10-67		
83	ACP-FLS10-PFE-156		6141		✓		195	✓			20-10-67		
84	ACP-FLS10-PFE-157	Ocean Wing 36	6142		✓		195	✓			20-10-67		
85	ACP-FLS10-PFE-158		6144		✓		195	✓			20-10-67		
86	ACP-FLS10-PFE-159	Ocean Wing 37	6145		✓		195	✓			20-10-67		
87	ACP-FLS10-PFE-160		6147		✓		195	✓			20-10-67		
88	ACP-FLS10-PFE-161	Ocean Wing 38	6148		✓		195	✓			20-10-67		
89	ACP-FLS10-PFE-162		6149		✓		195	✓			20-10-67		
90	ACP-FLS10-PFE-163	Ocean Wing 39	6200		✓		195	✓			20-10-67		
91	ACP-FLS10-PFE-164		6200		✓		195	✓			20-10-67		
92	ACP-FLS10-PFE-165	Ocean Wing 40	6203		✓		195	✓			20-10-67		
93	ACP-FLS10-PFE-166		6205		✓		195	✓			20-10-67		
94	ACP-FLS10-PFE-167	Ocean Wing 41	6206		✓		195	✓			20-10-67		
95	ACP-FLS10-PFE-168		6208		✓		195	✓			20-10-67		
96	ACP-FLS10-PFE-169	Ocean Wing 42	6209		✓		195	✓			20-10-67		
97	ACP-FLS10-PFE-170		6211		✓		195	✓			20-10-67		
98	ACP-FLS10-PFE-171	Ocean Wing 43	6212		✓		195	✓			20-10-67		
99	ACP-FLS10-PFE-172		6215		✓		195	✓			20-10-67		
100	ACP-FLS10-PFE-173	Ocean Wing 44	6216		✓		195	✓			20-10-67		
101	ACP-FLS10-PFE-174		6218		✓		195	✓			20-10-67		
102	ACP-FLS10-PFE-175	Ocean Wing 45	6219		✓		195	✓			20-10-67		
103	ACP-FLS10-PFE-176		6221		✓		195	✓			20-10-67		
104	ACP-FLS10-PFE-177	Ocean Wing 46	6223		✓		195	✓			20-10-67		
105	ACP-FLS10-PFE-178		6224		✓		195	✓			20-10-67		

Item No.	FLS CODE	Area		Extinguisher (Dry chemical)					Physical		Checked By	Date	Remark
		Section	Location	Recharged	Normal	Over recharged	Pressure	Normal	Abnormal				
106	ACP-FLS10-PFE-179	Ocean Wing 47	6225		✓			195	✓			20-10-67	
107	ACP-FLS10-PFE-180		6227		✓				195	✓			20-10-67
108	ACP-FLS10-PFE-181	Ocean Wing 48	6228		✓			195	✓			20-10-67	
109	ACP-FLS10-PFE-182		6230		✓				195	✓			20-10-67
110	ACP-FLS10-PFE-183	Ocean Wing 49	6231		✓			195	✓			20-10-67	
111	ACP-FLS10-PFE-184		6233		✓				195	✓			20-10-67
112	ACP-FLS10-PFE-185	Ocean Wing 50	6234		✓			195	✓			20-10-67	
113	ACP-FLS10-PFE-186		6236		✓				195	✓			20-10-67
114	ACP-FLS10-PFE-187	ARP	H/K 1		✓			195	✓			20-10-67	
115	ACP-FLS10-PFE-188	ARP	MDB 4		✓			195	✓			20-10-67	
116	ACP-FLS10-PFE-189	ARP	Club House 1		✓			195	✓			8-10-67	
117	ACP-FLS10-PFE-190	ARP	Club House 2		✓			195	✓			8-10-67	
118	ACP-FLS10-PFE-191	ARP	Club House 3		✓			195	✓			8-10-67	
119	ACP-FLS10-PFE-192	ARP	Gas Club House		✓			195	✓		8-10-67		
120	ACP-FLS10-PFE-193	ARP	EE Club House		✓			195	✓		8-10-67		
121	ACP-FLS10-PFE-194	ARP	H/K 2		✓			195	✓		8-10-67		
122	ACP-FLS10-PFE-195	ARP	Fire pump1		✓			195	✓		20-10-67		
123	ACP-FLS10-PFE-196	ARP	Fire pump2		✓			195	✓		20-10-67		
124	ACP-FLS10-PFE-197	ARP	Genarator 2		✓			195	✓		20-10-67		
125	ACP-FLS10-PFE-198	ARP	H/K 3		✓			195	✓		20-10-67		
126	ACP-FLS10-PFE-199	ARP	Staff toilet A7		✓			195	✓		20-10-67		
127	ACP-FLS10-PFE-207	ARP	Transformer 4		✓			195	✓		20-10-67		

Acknowledge by: 
Fire-Life Safety

Approved by:
Heads of Department



Engineering Department

FLS - 10 : Portable Fire Extinguishers

10-02 Record of monthly inspection of all Portable Fire Extinguishers.

Month: November Year: 2024

Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
				Type of Chemical		Physical		Gauge					
		Section	Location	Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure			
1	ACP-PFE-001	Floor 1/1	1101		✓		✓		OK	145 PSI		19-11-24	
2	ACP-PFE-002	Floor 1/2	1206		✓		✓		OK	145 PSI		19-11-24	
3	ACP-PFE-003	Floor 2/1	2101		✓		✓		OK	145 PSI		19-11-24	
4	ACP-PFE-004	Floor 2/2	2204		✓		✓		OK	145 PSI		19-11-24	
5	ACP-PFE-005	Floor 3/1	3101		✓		✓		OK	145 PSI		19-11-24	
6	ACP-PFE-006	Floor 3/2	3201		✓		✓		OK	145 PSI		19-11-24	
7	ACP-PFE-007	Floor 4/1	4101		✓		✓		OK	145 PSI		19-11-24	
8	ACP-PFE-008	Floor 4/2	4205		✓		✓		OK	145 PSI		19-11-24	
9	ACP-PFE-009	Floor 4/3	4305		✓		✓		OK	145 PSI		19-11-24	
10	ACP-PFE-010	Building4	EE Room		✓		✓		OK	145 PSI		19-11-24	
11	ACP-PFE-011	Building5	5105		✓		✓		OK	145 PSI		19-11-24	
12	ACP-PFE-012	Building5	5205		✓		✓		OK	145 PSI		19-11-24	
13	ACP-PFE-013	Building5	5305		✓		✓		OK	145 PSI		19-11-24	
14	ACP-PFE-014	Building7	Corridor B7FL1		✓		✓		OK	145 PSI		19-11-24	
15	ACP-PFE-015	Building7	Store B7FL 2		✓		✓		OK	145 PSI		19-11-24	
16	ACP-PFE-016	Building7	Store B7FL 3		✓		✓		OK	145 PSI		19-11-24	
17	ACP-PFE-017	Building7	7107		✓		✓		OK	145 PSI		19-11-24	
18	ACP-PFE-018	Building7	7123		✓		✓		OK	145 PSI		19-11-24	
19	ACP-PFE-019	Building7	7207		✓		✓		OK	145 PSI		19-11-24	
20	ACP-PFE-020	Building7	7223		✓		✓		OK	145 PSI		19-11-24	
21	ACP-PFE-021	Building7	7307		✓		✓		OK	145 PSI		19-11-24	
22	ACP-PFE-022	Building7	7323		✓		✓		OK	145 PSI		19-11-24	
23	ACP-PFE-023	Lagritta	La Gritta Kitchen			✓	✓		OK	145 PSI		19-11-24	
24	ACP-PFE-024	Lagritta	La Gritta Kitchen		✓		✓		OK	145 PSI		19-11-24	
25	ACP-PFE-025	Lagritta Bar	La Gritta bar		✓		✓		OK	145 PSI		19-11-24	
26	ACP-PFE-026	Main Store	Main Store		✓		✓		OK	145 PSI		19-11-24	

Ite m no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark	
		Section	Location	Type of Chemical		Physical		Gauge						
				Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure				
27	ACP-PFE-027	Building 1	In Garden Room	/			/			OK	195 PSI		19-11-24	
28	ACP-PFE-028	Building 1	In Florist Room	/			/			OK	195 PSI		19-11-24	
29	ACP-PFE-029	Garbage	The Room	/			/			OK	195 PSI		19-11-24	
30	ACP-PFE-030	Garbage	The Room	/			/			OK	195 PSI		19-11-24	
31	ACP-PFE-031	Staff Canteen	In The Kitchen	/			/			OK	195 PSI		19-11-24	
32	ACP-PFE-032	Staff Canteen	In The Kitchen	/			/			OK	195 PSI		19-11-24	
33	ACP-PFE-033	Staff Canteen	In The Kitchen	/			/			OK	195 PSI		19-11-24	
34	ACP-PFE-034	Staff Canteen	Station Gas	/			/			OK	195 PSI		19-11-24	
35	ACP-PFE-035	Male Locker	In Staff Toilets	/			/			OK	195 PSI		19-11-24	
36	ACP-PFE-036	Female Locker	In Staff Toilets	/			/			OK	195 PSI		19-11-24	
37	ACP-PFE-037	HR. Room	In HR. Room	/			/			OK	195 PSI		19-11-24	
38	ACP-PFE-038	MDB3	Out HR. Room	/			/			OK	195 PSI		19-11-24	
39	ACP-PFE-039	Lagritta Pool	Lagritta Pool	/			/			OK	195 PSI		19-11-24	
40	ACP-PFE-040	Lobby	Entrance (OPR)	/			/			OK	195 PSI		19-11-24	
41	ACP-PFE-041	Store bell	In The Room	/			/			OK	195 PSI		19-11-24	
42	ACP-PFE-042	Executive Offices	Door Offices	/			/			OK	195 PSI		19-11-24	
43	ACP-PFE-043	Lagritta Station Gas	Lobby	/			/			OK	195 PSI		19-11-24	
44	ACP-PFE-044	Lagritta Station Gas	Lobby	/			/			OK	195 PSI		19-11-24	
45	ACP-PFE-045	Secueity No.1	Enteance	/			/			OK	195 PSI		19-11-24	
46	ACP-PFE-046	Secueity No.2	Lobby	/			/			OK	195 PSI		19-11-24	
47	ACP-PFE-047	Secueity No.3	Time Kepper	/			/			OK	195 PSI		19-11-24	
48	ACP-PFE-048	Accounting	In The Room	/			/			OK	195 PSI		19-11-24	
49	ACP-PFE-049	Main Kitchen	Entrance	/			/			OK	195 PSI		19-11-24	
50	ACP-PFE-050	Main Kitchen	Entrance	/			/		✓	OK	195 PSI		19-11-24	
51	ACP-PFE-051	Main Kitchen	Out The Room	/			/			OK	195 PSI		19-11-24	
52	ACP-PFE-052	Main Kitchen	In The Room	/		/	/		✓	OK	170 PSI		19-11-24	
53	ACP-PFE-053	House Keeping	In The Room	✓			/			OK	195 PSI		19-11-24	
54	ACP-PFE-054	Generator MDB 1	Entrance			/				OK	195 PSI		19-11-24	
55	ACP-PFE-055	Generator MDB 1	In The Room	✓			✓			OK	195 PSI		19-11-24	
56	ACP-PFE-056	Laundry	Up The Stairs	✓			✓			OK	195 PSI		19-11-24	
57	ACP-PFE-057	Laundry	station	✓			✓			OK	195 PSI		19-11-24	
58	ACP-PFE-058	Laundry	Station	✓			✓			OK	195 PSI		19-11-24	
59	ACP-PFE-059	Laundry	Station	✓			✓			OK	195 PSI		19-11-24	

Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
				Type of Chemical			Physical		Gauge				
		Section	Location	Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure			
60	ACP-PFE-060	Laundry	Station		/		✓		OK	195 PSI	14-11-24		
61	ACP-PFE-061	Boiler room	In the room		/		✓		OK	195 PSI	14-11-24		
62	ACP-PFE-062	Eng. Work Shop	Tools Room		/		/		OK	195 PSI	11-11-24		
63	ACP-PFE-063	Eng. Work Shop	MDB Room		✓		✓		OK	195 PSI	12-11-24		
64	ACP-PFE-064	Eng. Work Shop	Painter Room		✓		✓		OK	195 PSI	17-11-24		
65	ACP-PFE-065	Oil Station	Desel Tank			/	✓		OK	195 PSI	16-11-24		
66	ACP-PFE-066	Walkway Rim talay			✓		✓		OK	195 PSI	12-11-24		
67	ACP-PFE-067	Voyagerlounge			/		✓		OK	195 PSI	14-11-24		
68	ACP-PFE-068	Gas Station	Laundry		✓		✓		OK	195 PSI	14-11-24		
69	ACP-PFE-069	Mortorbike Garage1			✓		✓		OK	195 PSI	14-11-24		
70	ACP-PFE-070	Mortorbike Garage2			✓		✓		OK	195 PSI	16-11-24		
71	ACP-PFE-071	Rimtalay pump room			✓		✓		OK	195 PSI	12-11-24		
72	ACP-PFE-072	Kidclub			✓		✓		OK	195 PSI	14-11-24		
73	ACP-PFE-073	Fire Training			✓		✓		OK	195 PSI	14-11-24		
74	ACP-PFE-074	PABX room			✓		✓		OK	195 PSI	12-11-24		
75	ACP-PFE-075	EE room B.2			✓		✓		OK	195 PSI	12-11-24		
76	ACP-PFE-076	Pantry smurt bar 1			✓		✓		OK	195 PSI	14-11-24		
77	ACP-PFE-077	Pantry smurt bar 2			✓		✓		OK	195 PSI	14-11-24		
78	ACP-PFE-078	Idea room Station Gas			✓		✓		OK	195 PSI	16-11-24		
79	ACP-PFE-079	Sport Center			✓		✓		OK	195 PSI	16-11-24		
80	ACP-PFE-080	Sport Center			✓		✓		OK	195 PSI	14-11-24		
81	ACP-PFE-081	Server Room			✓		✓		OK	195 PSI	14-11-24		
82	ACP-PFE-082		Front Spa				✓		OK	195 PSI	14-11-24		
83	ACP-PFE-083		Spa Reception		✓		✓		OK	195 PSI	14-11-24		
84	ACP-PFE-084		Spa Sala 1		✓		✓		OK	195 PSI	16-11-24		
85	ACP-PFE-085		Spa Sala 2		✓		✓		OK	195 PSI	16-11-24		
86	ACP-PFE-086		Spa Sala 3		✓		✓		OK	195 PSI	16-11-24		
87	ACP-PFE-087		Spa Sala 4		✓		✓		OK	195 PSI	16-11-24		
88	ACP-PFE-088	Fitness			✓		✓		OK	195 PSI	19-11-24		

Ite m no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
				Type of Chemical			Physical		Gauge				
		Section	Location	Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure			
89	ACP-PFE-089	Lift			✓		/		OK	195 PSI	<div></div>	17-11-24	
90	ACP-PFE-090	GM House			✓		/		OK	195 PSI		16-11-24	
91	ACP-PFE-091	Jetty 1			✓		/		OK	195 PSI		16-11-24	
92	ACP-PFE-092	Jetty 2			✓		/		OK	195 PSI		16-11-24	

Acknowledge by:

Fire-Life Safety Teamleader

Approved by:

Heads of Department

Engineering Department

FLS - 10 : Portable Fire Extinguishers

10-02 Record of monthly inspection of all Portable Fire Extinguishers.


Month: December Year: 2024

Ite m no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
		Section	Location	Type of Chemical			Physical		Gauge				
				Dry	Halotron	Wet chemical	Normal	Abnormal	Status Pressure				
1	ACP-PFE-001	Floor 1/1	1101		✓		✓				✓	10/12/24	
2	ACP-PFE-002	Floor 1/2	1206		✓		✓				✓	10/12/24	
3	ACP-PFE-003	Floor 2/1	2101		✓		✓				✓	15/12/24	
4	ACP-PFE-004	Floor 2/2	2204		✓		✓				✓	15/12/24	
5	ACP-PFE-005	Floor 3/1	3101		✓		✓				✓	15/12/24	
6	ACP-PFE-006	Floor 3/2	3201		✓		✓				✓	15/12/24	
7	ACP-PFE-007	Floor 4/1	4101		✓		✓				✓	15/12/24	
8	ACP-PFE-008	Floor 4/2	4205		✓		✓				✓	15/12/24	
9	ACP-PFE-009	Floor 4/3	4305		✓		✓				✓	15/12/24	
10	ACP-PFE-010	Building4	EE Room		✓		✓				✓	15/12/24	
11	ACP-PFE-011	Building5	5105		✓		✓				✓	15/12/24	
12	ACP-PFE-012	Building5	5205		✓		✓				✓	15/12/24	
13	ACP-PFE-013	Building5	5305		✓		✓				✓	15/12/24	
14	ACP-PFE-014	Building7	Coridor B7FL1		✓		✓				✓	15/12/24	
15	ACP-PFE-015	Building7	Store B7FL 2		✓		✓				✓	15/12/24	
16	ACP-PFE-016	Building7	Store B7FL 3		✓		✓				✓	15/12/24	
17	ACP-PFE-017	Building7	7107		✓		✓				✓	15/12/24	
18	ACP-PFE-018	Building7	7123		✓		✓				✓	15/12/24	
19	ACP-PFE-019	Building7	7207		✓		✓				✓	15/12/24	
20	ACP-PFE-020	Building7	7223		✓		✓				✓	15/12/24	
21	ACP-PFE-021	Building7	7307		✓		✓				✓	15/12/24	
22	ACP-PFE-022	Building7	7323		✓		✓				✓	15/12/24	
23	ACP-PFE-023	Lagritta	La Gritta Kitchen		✓		✓				✓	15/12/24	
24	ACP-PFE-024	Lagritta	La Gritta Kitchen			✓					✓	15/12/24	
25	ACP-PFE-025	Lagritta Bar	La Gritta bar		✓		✓				✓	15/12/24	
26	ACP-PFE-026	Main Store	Main Store		✓		✓				✓	15/12/24	

Item no.	FLS CODE	Area		Fire Extinguisher								Checked by	Date	Remark
				Type of Chemical			Physical		Gauge					
		Section	Location	Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure				
27	ACP-PFE-027	Building 1	In Garden Room		✓		✓			✓		15/12/24		
28	ACP-PFE-028	Building 1	In Florist Room		✓		✓			✓		15/12/24		
29	ACP-PFE-029	Garbage	The Room		✓		✓			✓		15/12/24		
30	ACP-PFE-030	Garbage	The Room		✓		✓			✓		15/12/24		
31	ACP-PFE-031	Staff Canteen	In The Kitchen		✓		✓			✓		15/12/24		
32	ACP-PFE-032	Staff Canteen	In The Kitchen		✓		✓			✓		15/12/24		
33	ACP-PFE-033	Staff Canteen	In The Kitchen		✓		✓			✓		15/12/24		
34	ACP-PFE-034	Staff Canteen	Station Gas		✓		✓			✓		15/12/24		
35	ACP-PFE-035	Male Locker	In Staff Toilets		✓		✓			✓		15/12/24		
36	ACP-PFE-036	Female Locker	In Staff Toilets		✓		✓			✓		15/12/24		
37	ACP-PFE-037	HR. Room	In HR. Room		✓		✓			✓		15/12/24		
38	ACP-PFE-038	MDB3	Out HR. Room		✓		✓			✓		15/12/24		
39	ACP-PFE-039	Lagritta Pool	Lagritta Pool		✓		✓			✓		15/12/24		
40	ACP-PFE-040	Lobby	Entrance (OPR)		✓		✓			✓		15/12/24		
41	ACP-PFE-041	Store bell	In The Room		✓		✓			✓		15/12/24		
42	ACP-PFE-042	Executive Offices	Door Offices		✓		✓			✓		15/12/24		
43	ACP-PFE-043	Lagitta Station Gas	Lobby	✓			✓			✓		15/12/24		
44	ACP-PFE-044	Lagitta Station Gas	Lobby	✓			✓			✓		15/12/24		
45	ACP-PFE-045	Security No.1	Enteance	✓			✓			✓		15/12/24		
46	ACP-PFE-046	Security No.2	Lobby		✓		✓			✓		15/12/24		
47	ACP-PFE-047	Security No.3	Time Kepper		✓		✓			✓		15/12/24		
48	ACP-PFE-048	Accounting	In The Room		✓		✓			✓		15/12/24		
49	ACP-PFE-049	Main Kitchen	Entrance		✓		✓			✓		15/12/24		
50	ACP-PFE-050	Main Kitchen	Entrance		✓		✓			✓		15/12/24		
51	ACP-PFE-051	Main Kitchen	Out The Room		✓		✓			✓		15/12/24		
52	ACP-PFE-052	Main Kitchen	In The Room			✓	✓			✓		15/12/24		
53	ACP-PFE-053	House Keeping	In The Room		✓		✓			✓		15/12/24		
54	ACP-PFE-054	Generator MDB 1	Entrance			✓	✓			✓		15/12/24		
55	ACP-PFE-055	Generator MDB 1	In The Room		✓		✓			✓		15/12/24		
56	ACP-PFE-056	Laundry	Up The Stairs		✓		✓			✓		15/12/24		
57	ACP-PFE-057	Laundry	station		✓		✓			✓		15/12/24		
58	ACP-PFE-058	Laundry	Station		✓		✓			✓		15/12/24		
59	ACP-PFE-059	Laundry	Station		✓		✓			✓		15/12/24		

Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
				Type of Chemical			Physical		Gauge				
		Section	Location	Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure			
60	ACP-PFE-060	Laundry	Station		✓		✓			✓		15/12/24	
61	ACP-PFE-061	Boiler room	In the room		✓		✓			✓		15/12/24	
62	ACP-PFE-062	Eng. Work Shop	Tools Room		✓		✓			✓		15/12/24	
63	ACP-PFE-063	Eng. Work Shop	MDB Room		✓		✓			✓		15/12/24	
64	ACP-PFE-064	Eng. Work Shop	Painter Room		✓		✓			✓		15/12/24	
65	ACP-PFE-065	Oil Station	Desel Tank			✓	✓			✓		15/12/24	
66	ACP-PFE-066	Walkway Rim talay			✓		✓			✓		15/12/24	
67	ACP-PFE-067	Voyagerlounge			✓		✓			✓		15/12/24	
68	ACP-PFE-068	Gas Station	Laundry		✓		✓			✓		15/12/24	
69	ACP-PFE-069	Mortorbike Garage1			✓		✓			✓		15/12/24	
70	ACP-PFE-070	Mortorbike Garage2			✓		✓			✓		15/12/24	
71	ACP-PFE-071	Rimtalay pump room			✓		✓			✓		15/12/24	
72	ACP-PFE-072	Kidclub			✓		✓			✓		15/12/24	
73	ACP-PFE-073	Fire Training			✓		✓			✓		15/12/24	
74	ACP-PFE-074	PABX room			✓		✓			✓		15/12/24	
75	ACP-PFE-075	EE room B.2			✓		✓			✓		15/12/24	
76	ACP-PFE-076	Pantry smurt bar 1			✓		✓			✓		15/12/24	
77	ACP-PFE-077	Pantry smurt bar 2			✓		✓			✓		15/12/24	
78	ACP-PFE-078	Idea room Station Gas			✓		✓			✓		15/12/24	
79	ACP-PFE-079	Sport Center			✓		✓			✓		15/12/24	
80	ACP-PFE-080	Sport Center			✓		✓			✓		15/12/24	
81	ACP-PFE-081	Server Room			✓		✓			✓		15/12/24	
82	ACP-PFE-082	SPA	Front Spa		✓		✓			✓		15/12/24	
83	ACP-PFE-083		Spa Reception		✓		✓			✓		15/12/24	
84	ACP-PFE-084		Spa Sala 1		✓		✓			✓		15/12/24	
85	ACP-PFE-085		Spa Sala 2		✓		✓			✓		15/12/24	
86	ACP-PFE-086		Spa Sala 3		✓		✓			✓		15/12/24	
87	ACP-PFE-087		Spa Sala 4		✓		✓			✓		15/12/24	
88	ACP-PFE-088	Fitness			✓		✓			✓		15/12/24	

Item no.	FLS CODE	Area		Fire Extinguisher							Checked by	Date	Remark
				Type of Chemical			Physical		Gauge				
		Section	Location	Dry	Halotron	Wet chemical	Normal	Abnormal	Status	Pressure			
89	ACP-PFE-089	Lift			✓		✓			✓		15/12/24	
90	ACP-PFE-090	GM House			✓		✓			✓		15/12/24	
91	ACP-PFE-091	Jetty 1			✓		✓			✓		15/12/24	
92	ACP-PFE-092	Jetty 2			✓		✓			✓		15/12/24	
93	ACP-PFE-093	Gas Station	Laundry		✓		✓			✓			

Acknowledge by: 

Approved by:

Fire-Life Safety Teamleader

Heads of Department

