

เอกสารแนบ 4

เอกสารผลการตรวจวัดคุณภาพสิ่งแวดล้อม

ANALYSIS REPORT

CUSTOMER NAME : สุขุมวิท พลัส คอนโดมิเนียม
ADDRESS : 1414 ซอย สุขุมวิท พลัส 1 แขวงพระโขนง เขตคลองเตย กรุงเทพมหานคร 10110.
SAMPLING LOCATION : บ่อพักน้ำเสีย (ตึก A)
SAMPLING METHOD : GRAB
SAMPLING CONDITION : NORMAL
CHARACTERISTICS OF WATER : เหลืองขุ่น มีตะกอน มีกลิ่น
SAMPLING DATE : SEPTEMBER 10, 2024
SAMPLING TIME : 12:30
SAMPLING BY : นายพีรพล ถวิลหวัง
REPORT NO. : RN240912282
SAMPLING SOURCE : WASTEWATER
RECEIVED DATE : SEPTEMBER 10, 2024
ANALYTICAL DATE : SEPTEMBER 10-20, 2024
REPORT DATE : SEPTEMBER 23, 2024

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH	-	Electrometric (SM: 4500-H ⁺ B.)	7.2 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Azide Modification (SM: 4500-O C, 5210 B.)	40.0	2.0	-
Suspended Solids	mg/l	Suspended Solids Dried at 103-105 °C (SM: 2540 D.)	56.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	<5.0	1.4	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	7.5 x 10 ⁴	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)



(MR TAWATCHAI CHONGVUTICHAJ)
LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except in full, without written approval of Laboratory.***

ANALYSIS REPORT

CUSTOMER NAME : สุขุมวิท พลัส คอนโดมิเนียม
ADDRESS : 1414 ซอย สุขุมวิท พลัส 1 แขวงพระโขนง เขตคลองเตย กรุงเทพมหานคร 10110.
SAMPLING LOCATION : บ่อน้ำใส (ตึก A)
SAMPLING METHOD : GRAB
SAMPLING CONDITION : NORMAL
CHARACTERISTICS OF WATER : เหลืองใส มีตะกอน มีกลิ่น
SAMPLING DATE : SEPTEMBER 10, 2024
SAMPLING TIME : 12:30
SAMPLING BY : นายพีรพล ถวิลหวัง

REPORT NO. : RN240912283
SAMPLING SOURCE : WASTEWATER
RECEIVED DATE : SEPTEMBER 10, 2024
ANALYTICAL DATE : SEPTEMBER 10-20, 2024
REPORT DATE : SEPTEMBER 23, 2024

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH	-	Electrometric (SM: 4500-H ⁺ B.)	7.0 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Azide Modification (SM: 4500-O C, 5210 B.)	12.5	2.0	≤30
Suspended Solids	mg/l	Suspended Solids Dried at 103-105 °C (SM: 2540 D.)	28.0	-	≤40
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	Not Detected	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	2.3 x 10 ⁴	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

(MR TAWATCHAI CHONGVUTICHAJ)
LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except in full, without written approval of Laboratory.***

ANALYSIS REPORT

CUSTOMER NAME : สุขุมวิท พลัส คอนโดมิเนียม
ADDRESS : 1414 ซอย สุขุมวิท พลัส 1 แขวงพระโขนง เขตคลองเตย กรุงเทพมหานคร 10110.
SAMPLING LOCATION : บ่อพักน้ำเสีย (ตึก B)
SAMPLING METHOD : GRAB
SAMPLING CONDITION : NORMAL
CHARACTERISTICS OF WATER : เหลือสูง มีตะกอน มีกลิ่น
SAMPLING DATE : SEPTEMBER 10, 2024
SAMPLING TIME : 12:30
SAMPLING BY : นายพีรพล ถวิลหวัง

REPORT NO. : RN240912284
SAMPLING SOURCE : WASTEWATER
RECEIVED DATE : SEPTEMBER 10, 2024
ANALYTICAL DATE : SEPTEMBER 10-20, 2024
REPORT DATE : SEPTEMBER 23, 2024

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH	-	Electrometric (SM: 4500-H ⁺ B.)	7.0 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Azide Modification (SM: 4500-O C, 5210 B.)	36.0	2.0	-
Suspended Solids	mg/l	Suspended Solids Dried at 103-105 °C (SM: 2540 D.)	62.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	<5.0	1.4	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	4.6 x 10 ⁵	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

(MR TAWATCHAI CHONGVUTICHAJ)
LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except in full, without written approval of Laboratory.***

ANALYSIS REPORT

CUSTOMER NAME : สุขุมวิท พลัส คอนโดเนียม
ADDRESS : 1414 ซอย สุขุมวิท พลัส 1 แขวงพระโขนง เขตคลองเตย กรุงเทพมหานคร 10110.
SAMPLING LOCATION : บ่อน้ำใส (ตึก B)
SAMPLING METHOD : GRAB
SAMPLING CONDITION : NORMAL
CHARACTERISTICS OF WATER : เหลืองขุ่น มีตะกอน มีกลิ่น
SAMPLING DATE : SEPTEMBER 10, 2024
SAMPLING TIME : 12:30
SAMPLING BY : นายพีรพล ฤทธิหวัง

REPORT NO. : RN240912285
SAMPLING SOURCE : WASTEWATER
RECEIVED DATE : SEPTEMBER 10, 2024
ANALYTICAL DATE : SEPTEMBER 10-20, 2024
REPORT DATE : SEPTEMBER 23, 2024

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH	-	Electrometric (SM: 4500-H ⁺ B.)	6.6 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Azide Modification (SM: 4500-O C, 5210 B.)	21.0	2.0	≤30
Suspended Solids	mg/l	Suspended Solids Dried at 103-105 °C (SM: 2540 D.)	92.0	-	≤40
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	Not Detected	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	2.3 x 10 ⁴	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

(MR TAWATCHAI CHONGVUTICHAJ)

LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except in full, without written approval of Laboratory.***

เอกสารแนบ 5

หนังสือรับรองห้องปฏิบัติการวิเคราะห์เอกชน



๑๑ กันยายน ๒๕๖๗

เรื่อง ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

เรียน กรรมการผู้จัดการ บริษัท โอกลา เทสต์ติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน
ลงวันที่ ๑๕ กรกฎาคม ๒๕๖๗

สิ่งที่ส่งมาด้วย เอกสารแนบท้ายหนังสือรับต่ออายุขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท โอกลา เทสต์ติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด จำนวน ๑ แผ่น

ตามคำขอที่อ้างถึง บริษัท โอกลา เทสต์ติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด ขอต่ออายุหนังสือ
รับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๒๑๙ สถานที่ตั้งเลขที่ ๖๓/๑๓ ซอยเพชรเกษม ๗
แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพมหานคร ต่อกรมโรงงานอุตสาหกรรม ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้บริษัท โอกลา เทสต์ติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน โดยมีองค์ประกอบดังนี้

ก. ผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน

- | | |
|---------------------------|----------------------------|
| ๑) นายธวัชชัย จงวุฒิชัย | ทะเบียนเลขที่ ว-๒๑๙-ค-๐๐๐๑ |
| ๒) นางสาวปนัดดา พันธกะจับ | ทะเบียนเลขที่ ว-๒๑๙-ค-๐๐๐๒ |
| ๓) นางสาวจามจุรี คำปุย | ทะเบียนเลขที่ ว-๒๑๙-ค-๐๐๐๓ |

ข. เจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน

- | | |
|-------------------------------|----------------------------|
| ๑) นางสาวนิจินาท มะติยาภักดิ์ | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๑ |
| ๒) นางสาวภาณุชนารถ เชื้อวชาญ | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๒ |
| ๓) นางสาวธิดารัตน์ กลัดตลาด | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๓ |
| ๔) นางสาวเบญจพร อินแก้ว | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๔ |
| ๕) นางสาววันวิสา หวังแวกลาง | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๕ |
| ๖) นางสาวรัตตชา ศรีปราสาท | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๖ |
| ๗) นายปริญญญา กล้าน้อย | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๗ |
| ๘) นายโกวิท บุพา | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๘ |
| ๙) นายพีรพล ถวิลหวัง | ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๙ |

ค. ขอบข่ายชนิดสารมลพิษที่ได้รับขึ้นทะเบียนให้วิเคราะห์ในน้ำ/น้ำเสีย และอากาศเสียตามสิ่งที่ส่งมาด้วย

หนังสือฉบับนี้จะหมดอายุในวันที่ ๑๕ สิงหาคม ๒๕๖๑ หากประสงค์จะต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ให้ยื่นคำขอต่ออายุพร้อมเอกสารประกอบคำขอต่อกรมโรงงานอุตสาหกรรมภายใน ๖๐ วัน ก่อนวันสิ้นอายุของหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ



(นายพรยศ กลั่นกรอง)

รองอธิบดี ปฏิบัติราชการแทน

อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน

กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ

โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕

โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙

ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th



เอกสารแนบท้ายหนังสือรับต่ออายุขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด เลขทะเบียน ว-๒๑๙

ที่ ออก ๐๓๑๐(๑)/ ๙๒๔ ๖

ลงวันที่ ๑๑ กันยายน ๒๕๖๗

ขอขยายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรมจำนวน ๑๔ รายการ

น้ำ/น้ำเสีย จำนวน 9 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Biochemical Oxygen Demand	1) 5-Day BOD Test, Azide Modification Method ^[2] 2) 5-Day BOD Test, Membrane Electrode Method ^[2]
2	Free Chlorine	Iodometric Method ^[2]
3	Oil & Grease	Liquid-Liquid, Partition Gravimetric Method ^[2]
4	pH	Electrometric Method ^[2]
5	Sulfide	Iodometric Method ^[2]
6	Temperature	Laboratory and Field Methods ^[2]
7	Total Dissolved Solids	Dried at 180 °C ^[2]
8	Total Kjeldahl Nitrogen	Macro-Kjeldahl Method ^[2]
9	Total Suspended Solids	Dried from 103 to 105 °C ^[2]

อากาศเสีย (ปล่องระบาย) จำนวน 5 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Carbon Monoxide	Instrument Analyzer Method ^[3]
2	Opacity	Ringelmann's Method ^[1]
3	Oxides of Nitrogen	Instrument Analyzer Method ^[3]
4	Sulfur Dioxide	Instrument Analyzer Method ^[3]
5	Total Suspended Particulate	Isokinetic Sampling, Gravimetric Method ^[3]

เอกสารอ้างอิง

1. กระทรวงอุตสาหกรรม. ประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนดค่าปริมาณเขม่าควันที่เจือปนในอากาศที่ระบายออกจากปล่องของหม้อน้ำของโรงงาน พ.ศ. 2549. ราชกิจจานุเบกษา. 4 ธันวาคม 2549. เล่มที่ 123 ตอนพิเศษ 125 ง.

2. APHA, AWWA, WEF. **Standard Methods for the Examination of Water and Wastewater.** 24th ed. Washington, DC: APHA, 2023.

3. United States Environmental Protection Agency. **Standard of Performance for New Stationary Source.** 40 CFR 60. Appendix A, 2019.

เอกสารแนบ 6

เอกสารสอบเทียบเครื่องมือที่ใช้ในการวิเคราะห์



Certificate of Calibration

Certificate No.: WK2402-300-865

Page 1 of 2

Customer : OKLA TESTING & CONSULTING SERVICE CO., LTD.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand.

Instrument	: Dissolved Oxygen	Ambient Temperature	: (25.0 ± 2) °C
Manufacturer	: HANNA	Humidity	: (50.0 ± 15) %RH
Model	: HI5421	Received Date	: 27-Feb-24
Serial No.	: 04240005101	Calibrated Date	: 27-Feb-24
Identity No.	: KC1A11T8H	Issued Date	: 27-Feb-24
Range	: See to data	Calibrated Location	: In Lab
Resolution	: See to data		
Calibration Method	: CP-WK-C03		

Reference standard instruments :

<u>Instrument</u>	<u>Serial No.</u>	<u>Certificate No.</u>	<u>Due Date</u>	<u>Traceability to</u>
Zero Oxygen Solution	HI7040L	S0115/20	30-Aug-25	NIST
DO Meter	874477	WK2305-300-241	25-May-24	WK Electric Co.,Ltd.
Digital Thermometer	WK-CT-025	WK2402-300-25	25-Feb-25	WK Electric Co.,Ltd.

NIST : National Institute of Standard and Technology.

This result calibrate was found accurate as shown on date place of calibrate only

This certificate is traceability to th International System of Unit (SI)

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2$, providing a level of confidence approximately 95 %

Calibrated by : Mr. Usa Phuangphiphat

Approved by :

Mr. Ratchadawut Rungravee

Authorized Signatory

This certificate may not be reproduced except in full unless permission for the reproduction has been obtained in writing from the laboratory.



Calibration Results

Certificate No. : WK2402-300-865

Page 2 of 2

Calibration Result of the Accuracy

Function : Dissolved Oxygen Measurement at 25 °C

Resolution : 0.01 mg/L

Unit : mg/L

STD Solution	UUC Reading		Error	Uncertainty (± mg/L)
	Before Adjustment	After Adjustment		
0.00	0.32	0.00	0.00	0.15
8.40	9.15	8.37	-0.03	0.33
8.70	9.01	8.65	-0.05	0.33
9.00	9.24	8.92	-0.08	0.33

() Without Adjustment (X) After Adjustment

This certificate may not be reproduced except in full unless permission for the reproduction has been obtained in writing from the laboratory.

**** End of Certificate****


Certificate No. : HIT-2410-0320

Page : 1 of 2

CERTIFICATE OF CALIBRATION

Equipment :	pH/mV and EC/TDS/Salinity/Resistivity Meter		
Meter Model :	HI5521-02	Serial No. :	04160019101
Probe Model :	HI1131B	Serial No. :	094430BN
Resolution (pH) :	0.01	Resolution (mV) :	0.1
Manufacturer :	Hanna Instruments	Made in :	Romania
Condition As-Received :	Used Product	Reference :	RE240370
Ambient Temperature :	(25 ± 2) °C	Relative Humidity :	(50 ± 15) % RH
Customer name :	Okla Testing & Consulting Service Co., Ltd. 67/35-36, 3RD Floor, Phetkasem 7/1 Road, Wat Tha Pra, Bangkok Yai, Bangkok 10600 Thailand		
Received date :	28 February 2024		
Calibrate date :	4 March 2024		
Issue date :	5 March 2024		
Calibrated Location :	Hanna Instruments (Thailand) Ltd.		
Calibration Procedure :	This calibrator was conducted by using in-house: calibration procedure CP-01, CP-02 by using certified reference material (CRM)		

Calibrated by : ☒ Mr. Pichit Petthong
☐ Mr. Channarong Soinak

Approved by : 
Mr. Anan Suwanchaisakul

Authorized Signatory



This certificate was certified only for the instrument we calibrated.

This result of calibration was found accurate on date and place of calibration only.

** This certificate may not be reproduced other than in full, except with the prior written **

approval of the head of Hanna Instrument (Thailand)

Condition of this calibration result

1. Reference Standard Instruments : This certification is traceable to the international unit of unit maintained through:

Instruments	Model	Serial No.	Certificate No.	Traceable
Documenting Process Calibrator	Fluke 753	43160061	LF24-0014	Measuretronix Limited.
Thermometer with sensor	HI98509	39643D	23T1453	Technology Promotion Association (Thailand-Japan).
Digital Thermo-Hygrometer	HT-771SD	AI.07155	24H41	

2. Reference Standard Materials : pH calibration standard traceable thru CPA chem Ltd.

Buffer Solution	Manufacture	Certified Value	Lot Number	Exp. date
pH 4.0	CPA chem	$4.008 \pm 0.006 @ 25^{\circ}\text{C}$	898494	3 June 2024
pH 7.0	CPA chem	$6.985 \pm 0.007 @ 25^{\circ}\text{C}$	898500	28 May 2024
pH 10.0	CPA chem	$10.011 \pm 0.012 @ 25^{\circ}\text{C}$	898502	24 May 2024

Calibration Result :

1. Performing standard curve by Simulator at: -177.5, 0.0, 177.5 mV

(Measurement Electrical Potential) After Adjust Result.

Unit Under Calibration	Nominal Value	Standard Voltage Input	Actual Reading		Uncertainty of Measurement (\pm mV)
	pH	mV	pH	mV	
pH Meter S/N 04160019101	4.01	177.5	4.01	177.5	0.097
	7.01	0.0	7.01	0.0	0.058
	10.01	-177.5	10.01	-177.5	0.097

2. Performing three buffer standard curve by using buffer nominal : pH 4,7,10 After Adjustment.

Unit Under Calibration	Standard pH Buffer Solution	Actual Reading (pH)	Actual Reading (mV)	Uncertainty of Measurement (\pm pH)
pH Electrode S/N 094430BN	4.008	4.02	159.3	0.010
	6.985	6.99	-13.6	0.011
	10.011	10.04	-187.9	0.014

The report uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2$, providing a level of confidence of approximately 95%

** End of certificate **



JIRANATEE ASSOCIATES CO.,LTD.

Jiranatee Associates Co.,Ltd
63/14-15, 67/35-36
Petchkasem 7,7/1, Rd. Watthapra, Bangkokyai,
Bangkok 10600 (Thailand)
Tel: +6608680812
Mobile: +66863999453
E-mail: jnac-calibration@jiranatee.com
Web site: www.jiranatee.com

Accredited calibration laboratory
ISO/IEC 17025:2017
NSC-TISI-TIS 17025
CALIBRATION 0367

Temperature measurement laboratory
Calibration services department.



CERTIFICATE OF CALIBRATION

Certificate No. : CDT-116-67

Page 1 of 2 Pages

MEASUREMENT ITEM : Digital Thermometer with Temperature Sensor
MANUFACTURER : EUTECH
MODEL/TYPE : ECO SCAN TEMPS
SERIAL NUMBER : 816366
ID NUMBER : -
CONDITION AS-RECEIVED : Used item
CUSTOMER : OKLA Testing and Consulting Service Co.,Ltd.
67/35-36 Floor 3, Soi Petchkasem 7/1,
Petchkasem Rd, Watthapra, Bangkokyai, Bangkok 10600.

RECEIVED DATE : 01 Jul 2024
MEASUREMENT DATE : 03 Jul 2024
ISSUE DATE : 04 Jul 2024

ENVIRONMENTAL CONDITIONS:

Ambient condition in the laboratory are as follow:

Temperature : 23.0 ± 3.0 °C
Relative Humidity : 55.0 ± 15.0 %RH

NOTED: The certificate is valid only to the item calibrated on date and place of calibration.

TABULATION OF RESULTS:

The table on next page give the measured values.

Calibration procedure:

The temperature calibration was done by In-House calibration method as WI-CL-001 according to comparison method with standard digital temperature indicator and standard temperature probe. The temperature scale use was based on ITS-90.

Traceability:

The measurement results are traceable to the international system of units (SI) through National Institute of Metrology Thailand (NIMT) Certificate number: TT-0047-24, Certificate number: ER-0101-23

Reference Used During Calibration:

1. Standard Temperature Probe
Model: STS-100 A500, Serial No.: 667682-09,
Due date: 26 Mar 2025
2. Digital Temperature Indicator
Model: DTI-1000-A MK II, Serial No.: 671407-00591 Due date: 14 Sep 2024

Uncertainty of Measurement:

The reported uncertainty of measurement is based on the standard uncertainty multiplied by a coverage factor $k=2$, Which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty has been determined in accordance with the GUM 'Evaluation of measurement data - Guide to the expression of uncertainty in measurement'

Calibrated by:

- ☐ Mr. Sorawit Thachalad
☒ Miss Jittraporn Lertsomphol
☐ Miss Ruangrumpai Phoommit



Approved signatory



Mr. Parinya Booncharoen
Calibration Department Manager



JIRANATEE ASSOCIATES CO.,LTD.

Continuation of Certificate of Calibration Number CDT-116-67

Page 2 of 2 Pages

Result of Calibration: ☒ Without Adjustment ☐ With Adjustment

Calibration Range: 20 °C to 30 °C

Function:

Table 3: This equipment was connected with Thermocouple sensor type K.
Dimension: Diameter 3 mm. Length 116 mm.

<u>Immersion Depth</u> (mm)	<u>Standard Reading</u> (°C)	<u>UUC Reading</u> (°C)	<u>Error</u> (°C)	<u>Uncertainty</u> (°C)
110	20.047	20.1	0.0	0.26
110	25.043	25.0	0.0	0.26
110	30.034	30.0	0.0	0.26

UUC*: Unit Under Calibration

End of Certificate of Calibration



Certificate of Calibration

Certificate No. : 67-200069-1

Page : 1 of 2

Submitted by : Okla Testing&Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Electronic Balance
Manufacturer : Sartorius Model : BSA224S-CW
Serial No. : 35790699
Capacity : 200 g Resolution : 0.0001 g

Environment : On site calibration was carried out at the Laboratory Environmental, Okla
Testing&Consulting Service Co.,Ltd.

Ambient Temperature : (28.4 to 28.5) °C

Relative Humidity : (49.4 to 51.1) %

Air Pressure : 1012.0 mbar

Date of Received : 26 February 2024

Date of Calibration : 26 February 2024

Date of Issue : 27 February 2024

Calibrated by : Akaradath Thippichai

Calibration Method : In-house method CAL-M2001 based on UKAS Publication ref : LAB 14
Edition 7 - November 2022

Reference Standard Instruments : This certification is traceable to the International System of Units

Standard Weights

ID No.	Cert. No.	Due Date	Traceability
E261-E264	C02232088	08 Nov 2024	National Institute of Metrology (Thailand), (NIMT)

Approved by :

(Surachai Promthong)

Laboratory Manager

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-200069-1

Page : 2 of 2

Result of Calibration : Without Adjustment

UUC Condition As-Received : Good

Departure of indication from nominal value

Nominal Value (g)	Correction (g)	Uncertainty \pm (g)
0.01	0.0000	0.00011
0.05	0.0000	0.00011
0.1	0.0000	0.00011
0.2	0.0000	0.00011
0.5	0.0000	0.00011
1	0.0000	0.00011
10	0.0000	0.00011
50	0.0000	0.00014
100	0.0000	0.00020
150	0.0001	0.00038
200	0.0002	0.00038

This result of calibration was found accurate as shown on date and place of calibration only.


This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$, providing a level of confidence of approximately 95%

Eccentric error

Load test : 50 g

A B C D E

-0.0001 0.0001 0.0001 0.0000 0.0000 g



Repeatability

Load test : 200 g

Stdev. : 0.00000 g

- o0o -



Certificate of Calibration

Certificate No. : 67-400117-2

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co., Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Temperature controlled enclosure (Oven)

Manufacturer : KWF

Model : S0V70B

Range : N/A °C

Resolution : 0.1 °C

Serial No. : KWF2021021902

ID No. : OKLA-LAB-013/170621

Environment : On site calibration was carried out at the Laboratory,
Okla Testing & Consulting Service Co., Ltd.

Ambient Temperature : (32.0 to 33.0) °C

Relative Humidity : (50 to 55) %

Line Voltage : (221.0 to 223.0) V

Date of Received : 26 February 2024

Date of Calibration : 26 February 2024

Date of Issue : 29 February 2024

Calibrated by : Permpon Chanpu

Calibration Method : CAL-M4004, TLAS G-20

The temperature scale used was based on ITS-90

Reference Standard Instruments : This certification is traceable to the International System of Units
Standard Digital Thermometer with Thermocouple probe

ID No.	Cert. No.	Due Date	Traceability
400029 & 400032	66-400594-1	27 Apr 2024	National Institute of Metrology Thailand (NIMT)

Approved by :



(Surachai Promthong)

Laboratory Manager

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-400117-2


Page : 2 of 2

Result of Calibration : Without Adjustment

UUC Condition As-Received : Good

Function : Temperature measurement

This instrument was setting air ventilation at position 0 (close)

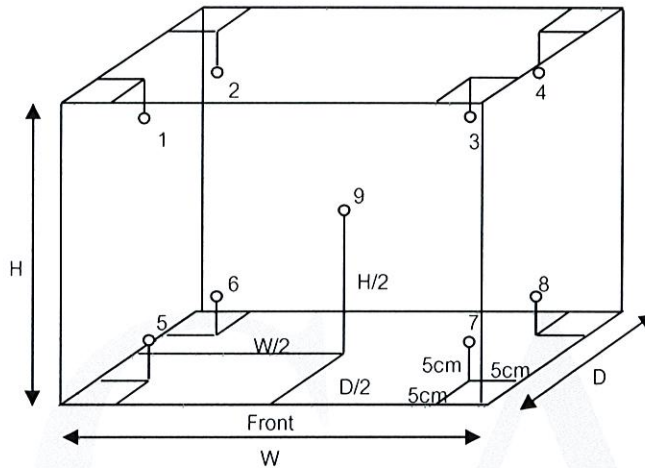

Test Point (° C)	Setting Temperature (° C)	Indicating Temperature (° C)	Measured Temperature (° C) @ Sensor No.									Uncertainty (± ° C)
			1	2	3	4	5	6	7	8	9	
104.0	102.5	102.5	106.4	105.0	105.2	106.1	103.0	104.0	103.4	105.4	104.0	0.94
140.0	139.5	139.5	144.1	142.2	142.4	143.7	138.5	139.7	139.3	142.4	140.2	1.3
160.0	159.5	159.5	164.3	162.4	162.6	163.8	158.6	159.8	159.3	162.5	160.3	1.3
180.0	179.5	179.5	186.2	183.7	183.8	185.7	174.7	180.1	179.4	183.7	180.3	1.7

Test Point (° C)	Setting Temperature (° C)	Indicating Temperature (° C)	Measured Uniformity (° C)	Measured Stability (° C)	Overall Variation (° C)
104.0	102.5	102.5	2.6	0.3	3.8
140.0	139.5	139.5	4.1	0.4	6.1
160.0	159.5	159.5	4.1	0.4	6.2
180.0	179.5	179.5	6.0	0.6	12.0

Remark The uncertainty is not combine uniformity of the air chamber

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2$, providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-400117-1

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co., Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Temperature controlled enclosure (Incubator)

Manufacturer : S-Cool

Model : SM 61 M

Range : N/A °C

Resolution : 0.1 °C

Serial No. : 18021147

ID No. : OKLA-LAB-011/190

Environment : On site calibration was carried out at the Laboratory,
Okla Testing & Consulting Service Co., Ltd.

Ambient Temperature : (32.0 to 33.0) °C

Relative Humidity : (50 to 55) %

Line Voltage : (221.0 to 223.0) V

Date of Received : 26 February 2024

Date of Calibration : 26 February 2024

Date of Issue : 29 February 2024

Calibrated by : Kittisak Kokaeo

Calibration Method : CAL-M4004, TLAS G-20

The temperature scale used was based on ITS-90

Reference Standard Instruments : This certification is traceable to the International System of Units
Standard Digital Thermometer with RTD Probe

ID No.	Cert. No.	Due Date	Traceability
400046 & 400047	67-400047-2	26 Jul 2024	National Institute of Metrology Thailand (NIMT)

Approved by :

(Surachai Promthong)

Laboratory Manager

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-400117-1


Page : 2 of 2

Result of Calibration : Without Adjustment

UUC Condition As-Received : Good

Function : Temperature measurement

This instrument was setting air ventilation at position 0 (close)

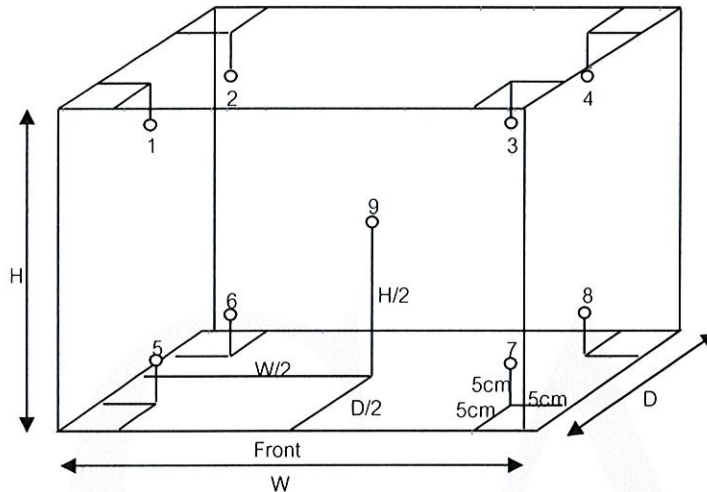

Test Point (°C)	Setting Temperature (°C)	Indicating Temperature (°C)	Measured Temperature (°C) @ Sensor No.									Uncertainty (± °C)
			1	2	3	4	5	6	7	8	9	
20.0	20.0	20.0	20.46	20.25	19.60	19.58	19.84	19.64	19.45	19.59	20.01	0.34

Test Point (°C)	Setting Temperature (°C)	Indicating Temperature (°C)	Measured Uniformity (°C)	Measured Stability (°C)	Overall Variation (°C)
20.0	20.0	20.0	0.589	0.073	1.129

Remark The uncertainty is not combine uniformity of the air chamber

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2$, providing a level of confidence of approximately 95%

- o0o -



Certificate No. : J048-TC24021201

Page : 1 of 3

Certificate of Calibration

Customer : Okla Testing & Consulting Service Co., Ltd.

Address : 67/35-36, 3rd Floor, Phetkasem 7/1 Rd.,
Watthapra, Bangkokyai, BKK. 10600

Equipment : Refrigerator

Manufacturer : SANDEN

Model : SPB-0500

Serial No. : SPB0500-231007454

ID No. : -

Resolution : 0.1 °C

Location of Calibration : Central Laboratory FL.3

Reference Job No. : JB24048

Received Request Date : 12 February 2024

Calibrated by : Pawut Wongnarakornkul

Date of Calibration : 12 February 2024

Approved by :

☒ Mr. Pairat Chobna

☐ Mr. Sarawut Panpet

Date of Issue : 13 February 2024

The uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval the Megafil Co.,Ltd.

Calibration Report

Equipment	: Refrigerator	Manufacturer	: SANDEN
Model	: SPB-0500	Serial No	: SPB0500-231007454
Environment	: Ambient Temperature	(24.3 to 24.9) °C	
	Relative Humidity	(45.3 to 51.9) %	
	Line Voltage	(226 to 228) V _{ac}	

Detail of this calibration result. :

1. This instrument was calibrated by insert 9 standards Resistance Thermometer Detector, in to the chamber, under no load condition in according to TLAS G-20-1/02-08 (E).
2. The temperature scale used was based on ITS-90.
3. Reference standards instrument :

Instrument	Model	Serial No./ID No.	Certificate No.	Due Date
Data Acquisition Switch unit	34972A	MY49010832	QR23-2679	15 November 2024
Resistance Thermometer Detector	100 ohm	RTD505(01 to 10)	QR23-2679	15 November 2024

4. This certificate was certified only for the instrument we calibrated.
5. The measured values in this report refer to the time of examination.
6. This certificate is traceable to SI Unit through Quality Reborn Co.,Ltd.
NSC - ONSC accredited no. Calibration 0292
7. Condition of calibrated item : Good

UUC Description :

Operation time 5 Hour 00 Minute Calibration point 2.0, 4.0, 6.0 °C

The air ventilation of the instrument was set at position.

Fresh Air Damper

<input type="checkbox"/>	Open	Position	<input type="checkbox"/>	Min	<input type="checkbox"/>	Medium	<input type="checkbox"/>	Max
<input type="checkbox"/>	Close							
<input checked="" type="checkbox"/>	X	Not Available						

8 Result of calibration :


(X) Without adjustment () After adjustment

Result of Calibration

Page : 3 of 3

Sensor installation at nine locations as show in figure.

Chamber capacity (W x H x D) : (0.55 x 1.61 x 0.42) m : 0.37 m³

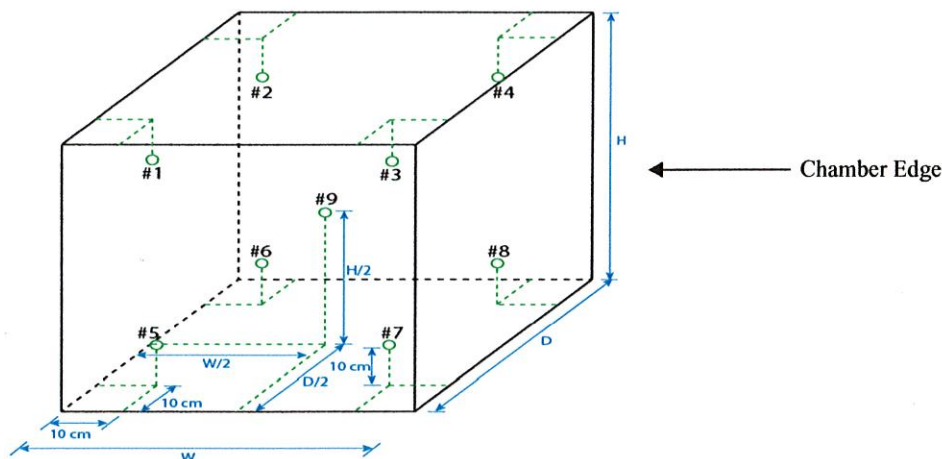

Position	1	2	3	4	5	6	7	8	9
Ref. Std/ID No.:	RTD50501	RTD50502	RTD50503	RTD50504	RTD50505	RTD50506	RTD50507	RTD50508	RTD50509

Temperature distribution

Cal. Point (°C)	Setting Temperature (°C)	Indicating Temperature (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF)									Uncertainty (± °C)
			1	2	3	4	5	6	7	8	9	
2.0	2.0	2.0	2.03	1.26	1.94	1.31	3.06	2.95	2.21	2.15	2.17	0.44
4.0	4.0	4.0	3.96	3.22	3.84	3.31	5.05	4.91	4.19	4.18	4.14	0.44
6.0	6.0	6.0	5.85	5.16	5.88	5.32	7.07	6.91	6.18	6.24	6.10	0.44

Chamber performance

Cal. Point (°C)	Setting Temperature (°C)	Indicating Temperature (°C)			Measured Uniformity (°C)	Measured Stability (± °C)	Overall Variation (°C)
		Min	Max	Average			
2.0	2.0	2.0	2.0	2.0	1.07	0.19	2.06
4.0	4.0	4.0	4.0	4.0	1.09	0.22	2.04
6.0	6.0	6.0	6.0	6.0	0.98	0.24	2.18

Note: The quoted uncertainty include Stability and 20% of Uniformity.

Stability = One-half of the greatest maximum difference of measured temperatures at any one sensor.

Uniformity = The maximum difference of measured temperatures at any sensors and measured temperature at the reference location which are observed at the same time.

Overall Variation = The Difference of the maximum and minimum measured temperatures throughout observation.

This reported uncertainty of measurment was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$, providing a level of confidence of approximately 95%.

- End of Certificate -

Certificate of Calibration

Certificate No. : 67-400117-4

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co., Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Water Bath

Manufacturer : LabTech

Model : LWB-222A

Range : N/A °C

Resolution : 0.01 °C

Serial No. : BCCLJ23001C

ID No. : OKLA-LAB-008/122011

Environment : On site calibration was carried out at the Laboratory,
Okla Testing & Consulting Service Co., Ltd.

Ambient Temperature : (32.0 to 33.0) °C

Relative Humidity : (50 to 55) %

Line Voltage : (221.0 to 223.0) V

Date of Received : 26 February 2024

Date of Calibration : 26 February 2024

Date of Issue : 29 February 2024

Calibrated by : Permpoon Chanpu

Calibration Method : This instrument was calibrated by In-house method CAL-M4006 based on ASTM E715-80
The temperature scale used was based on ITS-90

Reference Standard Instruments : This certification is traceable to the International System of Units
Standard Digital Thermometer with RTD probe

ID No.	Cert. No.	Due Date	Traceability
400029 & 400043	66-400593-1	25 Apr 2024	National Institute of Metrology Thailand (NIMT)

Approved by :



(Surachai Promthong)

Laboratory Manager

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration


Certificate No. : 67-400117-4

Page : 2 of 2

Result of Calibration : Without Adjustment

UUC Condition As-Received : Good

Function : Temperature measurement

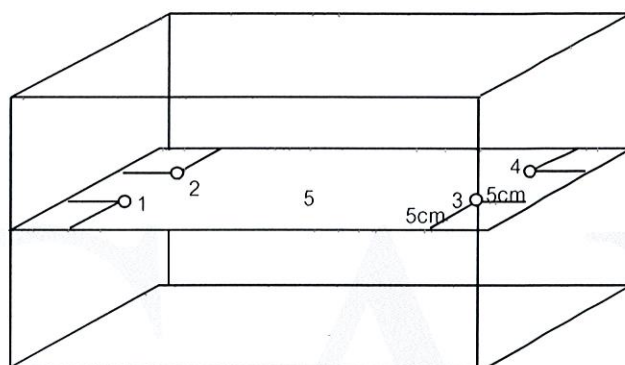

Front

Test Point (° C)	Setting Temperature (° C)	Indicating Temperature (° C)	Measured Temperature (° C) @ Sensor					Uncertainty (± ° C)	Measured Uniformity (° C)	Measured Stability (° C)
			No.							
			1	2	3	4	5			
60	As Mark 60	-	60.02	59.97	60.02	59.95	60.05	0.53	0.69	0.40

Remark The uncertainty is not combine uniformity of the water bath

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2$, providing a level of confidence of approximately 95%

- o0o -





JIRANATEE ASSOCIATES CO.,LTD.

Jiranatee Associates Co.,Ltd
63/14-15, 67/35-36
Petchkasem 7,7/1, Rd. Watthapra, Bangkokyai,
Bangkok 10600 (Thailand)
Tel: +6608680812
Mobile: +66863999453
E-mail: jnac-calibration@jiranatee.com
Web site: www.jiranatee.com

Accredited calibration laboratory
ISO/IEC 17025:2017
NSC-TISI-TIS 17025
CALIBRATION 0367

Relative humidity and Air Temperature measurement laboratory
Calibration services department.

CERTIFICATE OF CALIBRATION

Certificate No. : CRT-008-67

Page 1 of 2 Pages

MEASUREMENT ITEM : Digital Thermo Hygrometer
MANUFACTURER : KEPLER Instrument
MODEL/TYPE : KTH-02
SERIAL NUMBER : 234011889
ID NUMBER : -
CONDITION AS-RECEIVED : Used item
CUSTOMER : Okla Testing and consulting services Co., Ltd.
67/35-36, 3rd Fl, Phetkasem soi 7/1, Wat Thapra,
Bangkokyai, Bangkok, Thailand 10600.

RECEIVED DATE : 15 May 2024
MEASUREMENT DATE : 17 May 2024
ISSUE DATE : 20 May 2024

ENVIRONMENTAL CONDITIONS:

Ambient condition in the laboratory are as follow:

Temperature	: 23.0 ± 3.0	°C
Relative Humidity	: 55.0 ± 15.0	%RH

NOTED: The certificate is valid only to the item calibrated on date and place of calibration.

TABULATION OF RESULTS:

The table on next page give the measured values.

Calibration procedure:

The Relative humidity and Air Temperature calibration was done by In-House calibration method as WI-CL-009 and WI-CL-010 according to comparison method with Standard Chilled Mirror hygrometer with Temperature sensor and standard Humidity generator chamber.

Traceability:

The measurements are traceable to the international system of units (SI) through National Institute of Metrology Thailand (NIMT). Certificate number: TH-0079-23 and through Jiranatee Associates Co., Ltd. Certificate number: CDT-001-67.

Uncertainty of Measurement:

The reported uncertainty of measurement is based on the standard uncertainty multiplied by a coverage factor $k=2$, Which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty has been determined in accordance with the GUM 'Evaluation of measurement data - Guide to the expression of uncertainty in measurement'

Calibrated by:

- ☐ Mr. Sorawit Thachalad
☒ Miss Jittraporn Lertsomphol
☐ Miss Ruangrumpai Phoommit



Approved signatory:

Mr. Parinya Booncharoen
Calibration Department Manager



JIRANATEE ASSOCIATES CO.,LTD.

Continuation of Certificate of Calibration Number: CRT-008-67

Page 2 of 2 Pages

Measurement Results:

The results of calibration and associated measurement uncertainties are reported in the table below.

Result of Calibration: ☒ Without Adjustment ☐ With Adjustment

Table 1: The results of calibration of relative humidity at 23 °C are reported in table below.

Calibration Range: 35%RH to 70%RH

<u>Air Temperature</u> (°C)	<u>Standard Reading</u> (%RH)	<u>UUC Reading</u> (%RH)	<u>Error</u> (%RH)	<u>Uncertainty</u> ±(%RH)
22.95	34.70	38	3	1.0
22.96	45.03	46	1	1.2
22.96	60.44	60	0	1.5
22.95	70.95	68	-3	1.7

UUC*: Unit Under Calibration

End of Certificate of Calibration





JIRANATEE ASSOCIATES CO.,LTD.

Jiranatee Associates Co.,Ltd
63/14-15, 67/35-36
Petchkasem 7,7/1, Rd. Watthapra, Bangkokyai,
Bangkok 10600 (Thailand)
Tel: +6608680812
Mobile: +66863999453
E-mail: jnac-calibration@jiranatee.com
Web site: www.jiranatee.com

Accredited calibration laboratory
ISO/IEC 17025:2017
NSC-TISI-TIS 17025
CALIBRATION 0367

Relative humidity and Air Temperature measurement laboratory
Calibration services department.

CERTIFICATE OF CALIBRATION

Certificate No. : CRT-011-67

Page 1 of 2 Pages

MEASUREMENT ITEM : Digital Thermo Hygrometer
MANUFACTURER : KEPLER Instrument
MODEL/TYPE : KTH-02
SERIAL NUMBER : 234011890
ID NUMBER : -
CONDITION AS-RECEIVED : Used item
CUSTOMER : Okla Testing and consulting services Co., Ltd.
67/35-36, 3rd Fl, Phetkasem soi 7/1, Wat Thapra,
Bangkokyai, Bangkok, Thailand 10600.

RECEIVED DATE : 20 May 2024
MEASUREMENT DATE : 21 May 2024
ISSUE DATE : 22 May 2024

ENVIRONMENTAL CONDITIONS:

Ambient condition in the laboratory are as follow:

Temperature	: 23.0 ± 3.0	°C
Relative Humidity	: 55.0 ± 15.0	%RH

NOTED: The certificate is valid only to the item calibrated on date and place of calibration.

TABULATION OF RESULTS:

The table on next page give the measured values.

Calibration procedure:

The Relative humidity and Air Temperature calibration was done by In-House calibration method as WI-CL-009 and WI-CL-010 according to comparison method with Standard Chilled Mirror hygrometer with Temperature sensor and standard Humidity generator chamber.

Traceability:

The measurements are traceable to the international system of units (SI) through National Institute of Metrology Thailand (NIMT). Certificate number: TH-0079-23 and through Jiranatee Associates Co., Ltd. Certificate number: CDT-001-67.

Uncertainty of Measurement:

The reported uncertainty of measurement is based on the standard uncertainty multiplied by a coverage factor $k=2$, Which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty has been determined in accordance with the GUM 'Evaluation of measurement data - Guide to the expression of uncertainty in measurement'

Calibrated by:

- ☐ Mr. Sorawit Thachalad
☒ Miss Jittraporn Lertsomphol
☐ Miss Ruangrumpai Phoommit



Approved signator

Mr. Parinya Booncharoen
Calibration Department Manager



JIRANATEE ASSOCIATES CO.,LTD.

Continuation of Certificate of Calibration Number: CRT-011-67

Page 2 of 2 Pages

Measurement Results:

The results of calibration and associated measurement uncertainties are reported in the table below.

Result of Calibration: ☒ Without Adjustment ☐ With Adjustment

Table 1: The results of calibration of relative humidity at 23 °C are reported in table below.
Calibration Range: 35%RH to 70%RH

<u>Air Temperature</u> (°C)	<u>Standard Reading</u> (%RH)	<u>UUC Reading</u> (%RH)	<u>Error</u> (%RH)	<u>Uncertainty</u> ± (%RH)
22.95	34.55	37	2	1.0
22.96	44.86	46	1	1.2
22.95	60.42	61	1	1.5
22.95	71.14	69	-2	1.7

UUC*: Unit Under Calibration

End of Certificate of Calibration



Certificate of Calibration

Certificate No. : 67-300115-14

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Burette
Manufacturer : ISOLAB Class : A
Capacity : 25 ml Graduation : 0.05 ml
ID No. : BU25/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1011.8 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Wipa Tovadee

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241003	66-200388-2	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-14

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 38.85 sec.

Nominal Volume (ml)	Measuring Volume (ml)
5	5.0020
15	14.9767
25	24.9836

Uncertainty of measurement with in \pm 0.0066 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-12

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.

67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,

Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Cylinder

Manufacturer : DURAN

Class : A

Capacity : 100 ml

Graduation : 1 ml

ID No. : CY100/01

Environment : Ambient Temperature : (20 ± 3) °C

Relative Humidity : (50 ± 10) %

Air Pressure : 1011.1 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241002	66-200388-1	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-12

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
50	50.07
100	100.13

Uncertainty of measurement with in \pm 0.063 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-11

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.

67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Cylinder

Manufacturer : FAVORIT

Class : A

Capacity : 50 ml

Graduation : 1 ml

ID No. : CY50/01

Environment : Ambient Temperature : (20 ± 3) °C

Relative Humidity : (50 ± 10) %

Air Pressure : 1005.8 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

<u>ID No.</u>	<u>Cert. No.</u>	<u>Due Date</u>	<u>Traceability</u>
241002	66-200388-1	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-11

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
30	30.24
50	50.27

Uncertainty of measurement with in \pm 0.054 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-13

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Cylinder
Manufacturer : BOROSIL Class : A
Capacity : 500 ml Graduation : 5 ml
ID No. : CY500/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1005.7 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Arcerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241002	66-200388-1	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-13

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
250	248.94
500	499.25

Uncertainty of measurement with in \pm 0.12 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-1

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Measuring Pipette

Manufacturer : GLASSCO

Class : A

Capacity : 1 ml

Graduation : 0.01 ml

ID No. : MP1/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1007.4 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Arcerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	66-200388-4	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-1

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 5.89 sec.

Nominal Volume (ml)	Measuring Volume (ml)
0.1	0.1010
0.5	0.4988
1	1.0004

Uncertainty of measurement with in \pm 0.0026 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-2

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.

67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,

Wattthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Measuring Pipette

Manufacturer : GLASSCO

Class : A

Capacity : 5 ml

Graduation : 0.05 ml

ID No. : MP5/01

Environment : Ambient Temperature : (20 ± 3) °C

Relative Humidity : (50 ± 10) %

Air Pressure : 1007.4 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Arcerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.

Cert. No.

Due Date

Traceability

241005

66-200388-4

02 Jun 2024

National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-2

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 9.75 sec.

Nominal Volume (ml)	Measuring Volume (ml)
0.5	0.5023
2.5	2.4847
5	4.9835

Uncertainty of measurement with in \pm 0.0027 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-3

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Measuring Pipette

Manufacturer : GLASSCO

Class : A

Capacity : 10 ml

Graduation : 0.1 ml

ID No. : MP10/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1007.2 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Arcerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	66-200388-4	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-3

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 11.11 sec.

Nominal Volume (ml)	Measuring Volume (ml)
1	1.0010
5	4.9790
10	9.9759

Uncertainty of measurement with in \pm 0.0039 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-6

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Pipette
Manufacturer : GLASSCO Class : A
Capacity : 20 ml
ID No. : VP20/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1007.6 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Arcerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	66-200388-4	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-6

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 15.28 sec.

Nominal Volume (ml)	Measuring Volume (ml)
20	20.0063

Uncertainty of measurement with in \pm 0.0064 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-8

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Wattthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Flask

Manufacturer : SCI

Class : A

Capacity : 100 ml

ID No. : VF100/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1005.8 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Arcerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	66-200388-4	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-8

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
100	99.983

Uncertainty of measurement with in \pm 0.018 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- o0o -



Certificate of Calibration

Certificate No. : 67-300115-9

Page : 1 of 2

Submitted by : Okla Testing & Consulting Service Co.,Ltd.

67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,

Wattapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Flask

Manufacturer : BOROSIL

Class : A

Capacity : 500 ml

ID No. : VF500/01

Environment : Ambient Temperature : (20 ± 3) °C

Relative Humidity : (50 ± 10) %

Air Pressure : 1006.0 mbar.

Date of Received : 26 February 2024

Date of Calibration : 02 March 2024

Date of Issue : 02 March 2024

Calibrated by : Arcerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

<u>ID No.</u>	<u>Cert. No.</u>	<u>Due Date</u>	<u>Traceability</u>
241002	66-200388-1	02 Jun 2024	National Institute of Metrology (Thailand) (NIMT)

Approved by :

(Wipa Tovadee)

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 67-300115-9

Page : 2 of 2

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
500	499.92

Uncertainty of measurement with in \pm 0.075 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2.00$,
providing a level of confidence of approximately 95%

- oOo -

