


LOG SHEET FOR FIRE ALARM CONTROL PANEL					Ref No : JLL-OP-EE-006		
					Rev. Date : 31/01/2015		
Building : AIA EAST GATEWAY					Month : 11.11. Year : 67		
Date	Main Control Panel				Recorded by (Technician)	Verified by (Sr. Technician)	Remark
	Trouble "Point"	Disabled "Point"	Supervisory "Point"	Monitor/Security "Point"			
1							
2							
3							
4							
5							
6							
7							
8							
9							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							
31							


Comment : _____

BSE : [REDACTED]


1 1 8 1 67

LOG SHEET FOR FIRE ALARM CONTROL PANEL					Ref No : JLL-OP-EE-006		
					Rev. Date : 31/01/2015		
Building : AIA EAST GATEWAY					Month : 12 Year : 67		
Date	Main Control Panel				Recorded by (Technician)	Verified by (Sr. Technician)	Remark
	Trouble "Point"	Disabled "Point"	Supervisory "Point"	Monitor/Security "Point"			
1	-	-	-	-			
2	-	-	-	-			
3	-	-	-	-			
4	-	-	-	-			
5	-	-	-	-			
6	-	-	-	-			
7	-	-	-	-			
8	-	-	-	-			
9	-	-	-	-			
10	-	-	-	-			
11	-	-	-	-			
12	-	-	-	-			
13	-	-	-	-			
14	-	-	-	-			
15	-	-	-	-			
16	-	-	-	-			
17	-	-	-	-			
18	-	-	-	-			
19	-	-	-	-			
20	-	-	-	-			
21	-	-	-	-			
22	-	-	-	-			
23	-	-	-	-			
24	-	-	-	-			
25	-	-	-	-			
26	-	-	-	-			
27	-	-	-	-			
28	-	-	-	-			
29	-	-	-	-			
30	-	-	-	-			
31	-	-	-	-			


Comment : _____

BSE : 

21 9 124

LOG SHEET FOR FIRE ALARM CONTROL PANEL					Ref No : JLL-OP-EE-006		
					Rev. Date : 31/01/2015		
Building : AIA EAST GATEWAY					Month : 5/1/15 Year : 69		
Date	Main Control Panel				Recorded by (Technician)	Verified by (Sr. Technician)	Remark
	Trouble "Point"	Disabled "Point"	Supervisory "Point"	Monitor/Security "Point"			
1		—	—	—			
2		—	—	—			
3		—	—	—			
4		—	—	—			
5		—	—	—			
6		—	—	—			
7		—	—	—			
8		—	—	—			
9		—	—	—			
10		—	—	—			
11		—	—	—			
12		—	—	—			
13		—	—	—			
14		—	—	—			
15		—	—	—			
16		—	—	—			
17		—	—	—			
18		—	—	—			
19		—	—	—			
20		—	—	—			
21		—	—	—			
22		—	—	—			
23		—	—	—			
24		—	—	—			
25		—	—	—			
26		—	—	—			
27		—	—	—			
28		—	—	—			
29		—	—	—			
30		—	—	—			
31		—	—	—			

Comment : _____

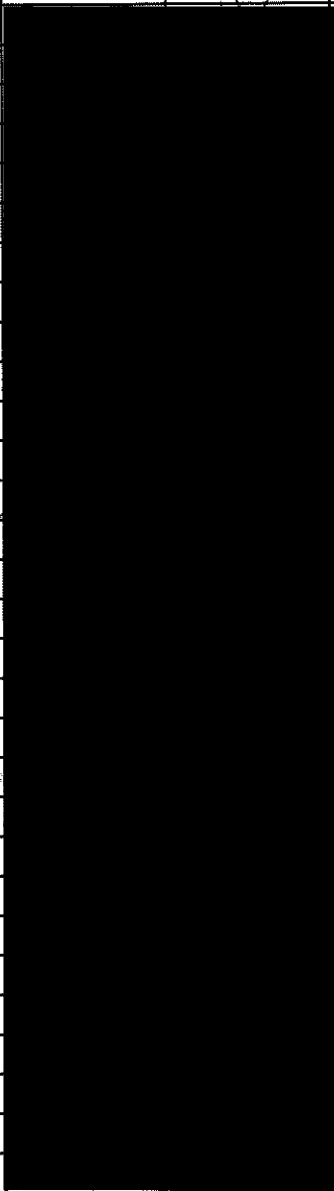
BSE : 
 21 10 14

LOG SHEET FOR FIRE ALARM CONTROL PANEL					Ref No : JLL-OP-EE-006		
					Rev. Date : 31/01/2015		
Building : AIA EAST GATEWAY					Month : 02/2015 Year : 2567		
Date	Main Control Panel				Recorded by (Technician)	Verified by (Sr. Technician)	Remark
	Trouble "Point"	Disabled "Point"	Supervisory "Point"	Monitor/Security "Point"			
1	/	/	/	/			
2	/	/	/	/			
3	/	/	/	/			
4	/	/	/	/			
5	/	/	/	/			
6	/	/	/	/			
7	/	/	/	/			
8	/	/	/	/			
9	/	/	/	/			
10	/	/	/	/			
11	/	/	/	/			
12	/	/	/	/			
13	/	/	/	/			
14	/	/	/	/			
15	/	/	/	/			
16	/	/	/	/			
17	/	/	/	/			
18	/	/	/	/			
19	/	/	/	/			
20	/	/	/	/			
21	/	/	/	/			
22	/	/	/	/			
23	/	/	/	/			
24	/	/	/	/			
25	/	/	/	/			
26	/	/	/	/			
27	/	/	/	/			
28	/	/	/	/			
29	/	/	/	/			
30	/	/	/	/			
31	/	/	/	/			


Comment : _____


BSE : [Signature]

41/11/15


LOG SHEET FOR FIRE ALARM CONTROL PANEL					Ref No : JLL-OP-EE-006		
					Rev. Date : 31/01/2015		
Building : AIA EAST GATEWAY					Month : Nov Year : 67		
Date	Main Control Panel				Recorded by (Technician)	Verified by (Sr. Technician)	Remark
	Trouble "Point"	Disabled "Point"	Supervisory "Point"	Monitor/Security "Point"			
1	/	-	/	-			
2	/	-	/	-			
3	/	-	/	-			
4	/	-	/	-			
5	/	-	/	-			
6	/	-	/	-			
7	/	-	/	-			
8	/	-	/	-			
9	/	-	/	-			
10	/	-	/	-			
11	/	-	/	-			
12	/	-	/	-			
13	/	-	/	-			
14	/	-	/	-			
15	/	-	/	-			
16	/	-	/	-			
17	/	-	/	-			
18	/	-	/	-			
19	/	-	/	-			
20	/	-	/	-			
21	/	-	/	-			
22	/	-	/	-			
23	/	-	/	-			
24	/	-	/	-			
25	/	-	/	-			
26	/	-	/	-			
27	/	-	/	-			
28	/	-	/	-			
29	/	-	/	-			
30	/	-	/	-			
31	/	-	/	-			

Comment : _____

BSE : 
41 12 1 67

LOG SHEET FOR FIRE ALARM CONTROL PANEL					Ref No : JLL-OP-EE-006		
					Rev. Date : 31/01/2015		
Building : AIA EAST GATEWAY					Month : 01, Year : 67		
Date	Main Control Panel				Recorded by (Technician)	Verified by (Sr. Technician)	Remark
	Trouble "Point"	Disabled "Point"	Supervisory "Point"	Monitor/Security "Point"			
1	/	/	/	/			
2	/	/	/	/			
3	/	/	/	/			
4	/	/	/	/			
5	/	/	/	/			
6	/	/	/	/			
7	/	/	/	/			
8	/	/	/	/			
9	/	/	/	/			
10	/	/	/	/			
11	/	/	/	/			
12	/	/	/	/			
13	/	/	/	/			
14	/	/	/	/			
15	/	/	/	/			
16	/	/	/	/			
17	/	/	/	/			
18	/	/	/	/			
19	/	/	/	/			
20	/	/	/	/			
21	/	/	/	/			
22	/	/	/	/			
23	/	/	/	/			
24	/	/	/	/			
25	/	/	/	/			
26	/	/	/	/			
27	/	/	/	/			
28	/	/	/	/			
29	/	/	/	/			
30	/	/	/	/			
31	/	/	/	/			

Comment : _____

BSE : 
9 1 2016