

ภาคผนวก ข-6

บุคลากรควบคุมดูแลการจัดการน้ำเสียของโครงการ

นิติบุคคลอาคารชุด วีไอพี คอนโด กะตะ

ประกาศ

เรื่อง แต่งตั้งเจ้าหน้าที่ดูแลระบบบำบัดน้ำเสีย

เพื่อให้ระบบการบำบัดน้ำเสียของโครงการนิติบุคคลอาคารชุด วีไอพี คอนโด กะตะ เป็นไปอย่างมีประสิทธิภาพและได้มาตรฐานตามมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม อันจะก่อให้เกิดความสะดวกและเป็นสุขอนามัยแก่ผู้พักอาศัยในโครงการมากยิ่งขึ้น

นิติบุคคลอาคารชุด วีไอพี คอนโด กะตะ จึงจำเป็นต้องออกประกาศแต่งตั้งลูกจ้างของนิติบุคคลอาคารชุดฯ ในการควบคุมงานเกี่ยวกับการดูแลระบบบำบัดน้ำเสียของโครงการฯ ดังรายชื่อต่อไปนี้

1. นายเมธิญ ใจเย็น

2. นายธีรยุทธ สองพัง

โดยให้ผู้ควบคุมงานเกี่ยวกับการดูแลระบบบำบัดน้ำเสีย มีหน้าที่ดังนี้

1. ตรวจสอบการทำงานและดูแลระบบบำบัดน้ำเสียในอาคารที่ติดตั้งตามอาคารให้มีประสิทธิภาพใช้งานได้อย่างสม่ำเสมอ
2. จัดทำรายงานสรุปผลดำเนินงานของระบบบำบัดน้ำเสียประจำเดือนเพื่อรายงานต่อเจ้าพนักงานท้องถิ่นทุกเดือน
3. จัดให้มีการเก็บตัวอย่างน้ำทิ้งหลังจากบำบัดเพื่อรายงานต่อเจ้าหน้าที่ที่เกี่ยวข้อง ตามมาตรการติดตามตรวจสอบผลกระทบสิ่งแวดล้อม
4. ควบคุมดูแลและจัดให้มีการจัดการกากตะกอนของระบบบำบัดน้ำเสีย

ประกาศ ณ วันที่ 13 ธันวาคม 2566

(นายษณกร สุวรรณโชติ)

ผู้จัดการนิติบุคคลอาคารชุด วีไอพี คอนโด กะตะ

ภาคผนวก ข-7

เอกสารการสูบปากตะกอน

ในนาม บริษัท สุดาวรรณ เทพดิฉนังอสังหาริมทรัพย์ จำกัด
ที่ออกกรม
 มีอำนาจลงนาม

ภาคผนวก ข-8

เอกสารตรวจสอบและซ่อมบำรุงระบบไฟฟ้า

and Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 2/1/25

				DATE: 2/19/25			
Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual				
		Batteries Voltage	Over 24.5 Volts				
		Fuel level	Min.300 Liters				
		Total Engine Run Hrs.	HH-MM				
		Total number Of Starts	Number				
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	401/400/403	399/399/400		
		Ampreage R/S/T	Amp Meter/ACB display	228.59	367.59	274.22	
		KWH	KWH Meter	380.1	332.3	333.6	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.86	0.97	0.99	
		CAP Number Of Working	Number	1,8 Number	2,3	3	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digital Meter	402/401/409	406/406/409	400/400/402	
EMDB		Ampreage R/S/T	Digital Meter	32/35/30	33/39/58	16/19/32	
		KWH	Digital Meter	17065.5	17227.0	17321.9	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	78	40	40	
		A-Filter Tank Satus	Normal	Normal	Normal	Normal	
A-Transfer Pump General Status		Normal	Normal	Normal	Normal		
Transfer pump B Water Treatment		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Transfer Pump Pressure	Discharge Pressure Gauge	75	28	26	
		B-Filter Tank Satus	Normal	Normal	Normal	Normal	
Deep Well Pump			B-Transfer Pump General Status	Normal	Normal	Normal	
			Deep well control Status	Auto/Off/Manual			
	Ampreage		Amp Meter				
Raw Water	Raw water tank	Level in Raw Tank	CM.	190	184	179	
		PWA Valve	Open/Close	OPEN	open	open	
		PWA	Normal/Slow/Not Flow	slow	slow	slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Discharge Pressure	Discharge Pressure Gauge	56	57	54	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	213	220	222	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Discharge Pressure	Discharge Pressure Gauge	51	51	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	218	220	216	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 4/1/25

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	54.2	55	56	
		Pressure	IN/Out	36-47	34/46	34/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal		Normal	Normal	
		Honder Pressure PSI (High)	PSI		50	50	
		Low Pressure PSI (Low)	PSI		22	22	
		Emergency Shut Off Valve	Normal		Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock		Normal lock	Normal lock	
		Gas Leak Detector	Normal		Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	off	off	off	
	Parking Building B	A-WWT-Electric KWH	KWH Meter	456.8	459.4	467.5	
		B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	171.6	172.7	173.3	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	A-SSP-General Status	Normal	Normal	Normal	Normal	
		B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Overload	เกิน 60 วินาที ปิดเครื่อง
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	overload	Overload	Overload	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				

Checked By / Record By

Grand Kata VIP.

Engineer Department.

Cold/Freezer Cabinet Check lists & Consumption Record



DATE: 4/1/99

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	6.3	2.7	2.6	
2	CR-002	Freezer 4 Door-Upright		-18	-13.4	-11.8	-14.5	
3	CR-003	Freezer 4 Door-Upright		-18	-8.0	-14.3	-12.5	
4	CR-004	4 Door-Upright	Cold Kitchen	2	4.7	6.5	6.3	
5	CR-005	3 Door-Base		5	2.4	2.4	2.0	
6	CR-006	Ice-Cream Cabinet		-20	-24	-25	-24	
7	CR-007	2 Door-Upright	Kitchen	2	2.4	3.3	2.0	
8	CR-008	3 Door-Base	Hot Kitchen	5	5.1	6.6	5.0	
9	CR-009	3 Door-Base		5	4.1	4.1	3.9	
10	CR-010	3 Door-Base	Bar At Chaba	4	5.4	5.7	4.3	
11	CR-011	3 Door-Base		4	5.7	4.5	4.7	
12	CR-012	2 Door-Base	Restaurant	4	off	off	off	
13	CR-013	3 Door-Base	Pool Bar A	2	2.5	2.4		
14	CR-014	3 Door-Base	Pool Bar B	2	off	off	off	
15	CR-015	2 Door-Base		2	4.7	4.0	2.5	
16	ICE-001	Ice Machine	Kitchen	Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	off			

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item	Per Day	A 001'	B 002'	C 003'	A 005'	B 006'	C 007'
Time	000'	09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00	00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel in Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.

DATE: 11/01/95

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual				
		Batteries Voltage	Over 24.5 Volts				
		Fuel level	Min.300 Liters				
		Total Engine Run Hrs.	HH:MM				
		Total number Of Starts	Number				
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	100/400/400	401/400/402	402/402/405	
		Ampereage R/S/T	Amp Meter/ACB display	87.0.82	244.29	192.52	
		KWH	KWH Meter	563.1	365.3	366.7	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.93	0.96	0.94	
		CAP Number Of Working	Number	18	4.5	4	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digital Meter	403/403/405	403/403/407	404/404/410	
EMDB		Ampereage R/S/T	Digital Meter	10/44/14	36/35/49	11/14/33	
		KWH	Digital Meter	19393.9	19562.2	19657.0	
Transfer pump A Water Treatment		A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40	40	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
Transfer pump B Water Treatment		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Transfer Pump Pressure	Discharge Pressure Gauge	95	26	26	
Deep Well Pump		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual				
Raw Water	Raw water tank	Ampereage	Amp Meter				
		Deep Well General Status	Normal				
Raw Water	Raw water tank	Level in Raw Tank	CM.	190	185	191	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Slow	Slow	Slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	59	56	56	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	213	216	220	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	52	50	52	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM.	210	213	216	



DATE: 11/01/19

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	56	56	55	
		Pressure	IN/Out	35/47	34/46	35/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	91	90	30	
		Low Pressure PSI (Low)	PSI	90	22	24	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้องถัง)	Normal Lock	Normal Lock	Normal Lock	Normal Lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	off	off	off	
		A-WWT-Electric KWH	KWH Meter	510.2	513.6	515.9	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	192.2	190.3	191.1	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	A-SSP-General Status	Normal	Normal	Normal	Normal	
		B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	overload	overload	overload	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
	Basement B Parking Right Side (100Q)	B2-SSP-General Status	Normal				
		B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	overload	overload	overload	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement	IR-Pump Control Status	Auto/Off/Manual				
	Building B	IR-Inverter Status	Auto/Off/Manual				
	Near Garbage Room	IR- Discharge Pressure	Discharge Pressure Gauge				
	Room	IR-General Status	Normal				
Checked By / Record By							



Cold/Freezer Cabinet Check lists & Consumption Record

DATE: 11/01/19

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	4.9	3.8	3.5	
2	CR-002	Freezer 4 Door-Upright		-18	-11.1	-14.1	-15.3	
3	CR-003	Freezer 4 Door-Upright		-18	-11.9	-13.9	-12.3	
4	CR-004	4 Door-Upright	Cold Kitchen	2	18.8	off	off	
5	CR-005	3 Door-Base		5	9.8	3.6	4.0	
6	CR-006	Ice-Cream Cabinet		-20	-21	-22	-26	
7	CR-007	2 Door-Upright	Kitchen	2	3.5	4.7	3.0	
8	CR-008	3 Door-Base		5	4.5	6.4	5.3	
9	CR-009	3 Door-Base		5	3.5	2.3	2.0	
10	CR-010	3 Door-Base	Bar At Chaba Restaurant	4	5.5	6.7	5.5	
11	CR-011	3 Door-Base		4	6.0	4.7	6.4	
12	CR-012	2 Door-Base		4	off	off	off	
13	CR-013	3 Door-Base	Pool Bar A	2	off	2.2		
14	CR-014	3 Door-Base	Pool Bar B	2	off	off	off	
15	CR-015	2 Door-Base		2	off	2.7	3.5	
16	ICE-001	Ice Machine	Kitchen	Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	off	off	off	
Checked By / Recorded By								

ELECTRICITY RECORD							
High Voltage 33KV PEA Meter							
Item	Rate Code	Per Day	A 001'	B 002'	C 003'	A 005'	B 006'
Time	000'	09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00	00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD				
Main Meter In Come				
Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD		
Fuel In Daytank		
Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment



DATE: 18/1/18

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual				
		Batteries Voltage	Over 24.5 Volts	/	/	/	
		Fuel level	Min.300 Liters	/	/	/	
		Total Engine Run Hrs.	HH:MM	/	/	/	
		Total number Of Starts	Number	/	/	/	
MDB	MDB Room	Voltage R-S-T/T-R	Volt Meter	400/400/400	400/401/405	400/401/400	
		Amperage R/S/T	Amp Meter/ACB display	24.10 A	265.02	226.24	
		KWH	KWH Meter	395.6	397.7	398.8	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.90	0.91	0.97	
		CAP Number Of Working	Number	1,8	4,5	2	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
EMDB	EMDB Room	Voltage R-S-T/T-R	Digital Meter	401/401/403	404/404/403	401/400/403	
		Amperage R/S/T	Digital Meter	24/28/32	24/35/52	20/23/45	
		KWH	Digital Meter	21693.0	21851.0	21925.6	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40 psi	40	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	28 psi	28	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	/	/	/	
		Amperage	Amp Meter	/	/	/	
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal	/	/	/	
		Level in Raw Tank	CM.	190 cm	189	143	
		PWA Valve	Open/Close	Open	Open	Open	
Raw Water	Raw water tank	PWA	Normal/Slow/Not Flow	Slow	Slow	Slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	58 psi	54	55	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	229 cm.	213	216	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	50 psi	50	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	215 cm.	215	214	



DATE: 18/1/18

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	50	54	
		Pressure	IN/Out	36/46	35/47	34/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	30 psi	50	20	
		Low Pressure PSI (Low)	PSI	22 psi	22	24	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto off	off	off	
		A-WWT-Electric KWH	KWH Meter	564.5	567.7	569.3	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	207.1	208.3	208.6	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	overload	overload	overload	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual	/	/	/	
		B2-SSP-Pump 1 Status	Normal	/	/	/	
		B2-SSP-Pump 2 Status	Normal	/	/	/	
		B2-SSP-General Status	Normal	/	/	/	
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	overload	overload	overload	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual	/	/	/	
		IR-Inverter Status	Auto/Off/Manual	/	/	/	
		IR- Discharge Pressure	Discharge Pressure Gauge	/	/	/	
		IR-General Status	Normal	/	/	/	

Checked By : Record By

Grand Kata VIP.

Engineer Department.

Cold Freezer Cabinet Check lists & Consumption Record



DATE

19/01/19

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	8.5	3.7	2.1	
2	CR-002	Freezer 4 Door-Upright		-18	-18.9	DEF	-12.1	
3	CR-003	Freezer 4 Door-Upright		-18	DEF	-15.3	-14.9	
4	CR-004	4 Door-Upright	Cold Kitchen	2	8.5	OFF	OFF	77.20/100/100
5	CR-005	3 Door-Base		3	3.1	3.4	1.9	
6	CR-006	Ice-Cream Cabinet		-20	-25	-24	-25	
7	CR-007	2 Door-Upright	Kitchen	2	8.5	8.0	2.1	
8	CR-008	3 Door-Base	Hot Kitchen	5	7.0	6.7	5.6	
9	CR-009	3 Door-Base		5	8.7	4.1	3.6	
10	CR-010	3 Door-Base	Bar At Chaba	4	4.7	4.3	5.3	
11	CR-011	3 Door-Base	Restaurant	4	5.0	4.4	6.2	
12	CR-012	2 Door-Base		4	OFF	OFF	OFF	
13	CR-013	3 Door-Base	Pool Bar A	2	3.3	2.2		
14	CR-014	3 Door-Base	Pool Bar B	2	OFF	OFF	OFF	
15	CR-015	2 Door-Base		2	3.5	3.9	2.6	
16	ICE-001	Ice Machine	Kitchen	Normal	ON	ON	ON	
17	ICE-002	Ice Machine	Pool Bar B	Normal	OFF	OFF	OFF	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hour
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.

Engineer Department.

Daily Check lists.



DATE

25/1/88.

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.7	
		Fuel level	Min.300 Liters		120 L	120 L	
		Total Engine Run Hrs.	HH:MM	3h 7m	3h 7m	3h 7m	
		Total number Of Starts	Number	29 (S)	29 (S)	29 (S)	
MDB	MDB Room	Voltage R-S/S-T/T-R	Volt Meter	100/100/100	400/399/400	400/400/400	
		Amperage R/S/T	Amp Meter/ACB display	265.570	314.65	169.80	
		KWH	KWH Meter	487.9	430.0	431.7	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.93	0.97	0.96	
EMDB	EMDB Room	CAP Number Of Working	Number	7.8	6.7	1	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S/S-T/T-R	Digital Meter	401/400/403	400/399/403	402/401/404	
		Amperage R/S/T	Digital Meter	42/39/46	47/47/62	19/30/24	
		KWH	Digital Meter	22698.2	24466.1	24986.8	
Transfer pump A	Water Treatment	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	79 psi	78	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	78 Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B	Water Treatment	B-Transfer Pump Pressure	Discharge Pressure Gauge	76 psi	28	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	N			
		Amperage	Amp Meter				
Deep Well Pump	Room	Deep Well General Status	Normal				
Raw Water	Raw water tank	Level in Raw Tank	CM.	100	165	193	
		PWA Valve	Open/Close	open	open	open	
		PWA	Normal/Slow/Not Flow	Slow	slow	slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	58 psi	58	54	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	219	214	219	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	50 psi	48	52	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	230 cm	212	221	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 9/9/68

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	54	55	55	
		Pressure	IN/Out	36/46	34/46	35/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	80 PSI	90	20	
		Low Pressure PSI (Low)	PSI	22 PSI	22	20	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	off	off	off	
	Parking Building B	A-WWT-Electric KWH	KWH Meter	617.4	620.7	623.3	
		B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	overload	overload	overload	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	overload	overload	overload	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				

Checked By / Record By

Grand Kata VIP.
Engineer Department.



DATE: 9/9/68

Cold Freezer Cabinet Check lists & Consumption Record

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	5.5	4.4	2.8	
2	CR-002	Freezer 4 Door-Upright		-18	-13.4	6.6	-13.5	
3	CR-003	Freezer 4 Door-Upright		-18	-12.7	10.0	-17.5	
4	CR-004	4 Door-Upright	Cold Kitchen	2	Handwritten	Handwritten	Handwritten	
5	CR-005	3 Door-Base		5	2.5	2.4	3.7	
6	CR-006	Ice-Cream Cabinet		-20	-2.1	-2.5	-2.4	
7	CR-007	2 Door-Upright	Kitchen	2	3.2	2.6	2.9	
8	CR-008	3 Door-Base	Hot Kitchen	5	5.2	5.6	5.9	
9	CR-009	3 Door-Base		5	3.9	dF	2.9	
10	CR-010	3 Door-Base	Bar At Chaha	4	4.3	6.7	4.0	
11	CR-011	3 Door-Base	Restaurant	4	5.3	5.3	5.4	
12	CR-012	2 Door-Base		4	off	off	off	
13	CR-013	3 Door-Base	Pool Bar A	2	2.2	dF	2.0	
14	CR-014	3 Door-Base	Pool Bar B	2	off	off	off	
15	CR-015	2 Door-Base		2	2.4	dF	4.0	
16	ICE-001	Ice Machine	Kitchen	Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	off	off	off	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 53KV PEA Meter							
Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come				
Item	FWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment



DATE: 6/2/64

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.6	
		Fuel level	Min.300 Liters	115	115	115 L.	
		Total Engine Run Hrs.	HH-MM	3h 45m	3h 45m	3h 43m.	
		Total number Of Starts	Number	32 (5)	32 (8)	32 (6)	
MDB	MDB Room	Voltage R-S-T-T-R	Volt Meter	400/400/401	400/400/400	401/402/401	
		Amperage R/S/T	Amp Meter/ACB display	234.36	306.39 A	325.13 A	
		KWH	KWH Meter	494.1	496.4	498.9	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.96	0.96	0.99	
EMDB	EMDB Room	CAP Number Of Working	Number	1, 8	1, 8	1, 8	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-T-T-R	Digital Meter	402/401/403	401/404/400	400/403/400	
		Amperage R/S/T	Digital Meter	38/34/41	26/30/30	19/19/35	
		KWH	Digital Meter	29545.3	29718.4	29823.3	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	75	40 psi	40 psi	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	28	28 psi	28 psi	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual				
		Amperage	Amp Meter				
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal				
Raw Water	Raw water tank	Level in Raw Tank	CM.	190	190 cm.	190 cm	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Slow	Slow.	Slow.	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	57	58 psi	56 psi	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	201	218	213	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	54	52 psi	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	220	218	220	



DATE: 8/9/69

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	56	58	57	
		Pressure	IN/Out	34/46	34/46	34/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	Off	Off	Off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	90	90 PSI	20 PSI	
		Low Pressure PSI (Low)	PSI	22	22 PSI	22 PSI	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal/lock	Normal/lock	Normal/lock	
Waste Water Treatment	House Keeping Stored	Gas Leak Detector	Normal	Normal	Normal	Normal	
		A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Off	Off	Off	
		A-WWT-Electric KWH	KWH Meter	723.2	726.7	728.9	
Submersible Pump	Basement A Near Canteen	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	267.5	262.4	268.3	
Basement B	Basement B Parking Motorcycle	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
		B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
Basement B	Basement B Parking Left Side (3.7KW)	B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
Basement B	Basement B Parking Right Side (100Q)	B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
		B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	B3-SSP-General Status	Normal	Normal	Normal	Normal	
		IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				

Checked By / Record By:

Grand Kata VIP,
Engineer Department.



Cold/Freezer Cabinet Check lists & Consumption Record

DATE: 9/2/68

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	7.6	2.9		7.5m/2.9
2	CR-002	Freezer 4 Door-Upright		-18	-12.3	-12.7		
3	CR-003	Freezer 4 Door-Upright		-18	-11.4	-11.9		
4	CR-004	4 Door-Upright	Cold Kitchen	2	2.0	2.3	2.2	
5	CR-005	3 Door-Base		5	3.8	2.9		
6	CR-006	Ice-Cream Cabinet		-20	-2.4	-2.6		
7	CR-007	2 Door-Upright	Kitchen	2	2.4	3.3		
8	CR-008	3 Door-Base	Hot Kitchen	5	5.2	3.9		
9	CR-009	3 Door-Base		5	df	6.5		
10	CR-010	3 Door-Base		4	6.7	df		
11	CR-011	3 Door-Base	Bar At Chaba	4	6.0	6.2		
12	CR-012	2 Door-Base	Restaurant	4	off	off		
13	CR-013	3 Door-Base	Pool Bar A	2	df	3.0		
14	CR-014	3 Door-Base	Pool Bar B	2	df	3.0	df	
15	CR-015	2 Door-Base		2	df	3.5	df	
16	ICE-001	Ice Machine	Kitchen	Normal	ON	ON		
17	ICE-002	Ice Machine	Pool Bar B	Normal	OFF	ON	ON	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item	Rate	Per Day	A	B	C	A	B	C
Code	Time	000'	001'	002'	003'	005'	006'	007'
			09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00	00:00-24:00
Today								
Yesterday								
Total								

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours.
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP,
Engineer Department.
Daily Check lists.



DATE: 9/2/68

Equipment	Location	Description	Standand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.6	
		Fuel level	Min.300 Liters	115	230L.	230L.	
		Total Engine Run Hrs.	HH:MM	4h 0m	4h 0m	4h 0m	
		Total number Of Starts	Number	33 (5)	33 (5)	33 (5)	
MDB	MDB Room	Voltage R-S-T/T-R	Volt Meter	400/400/402	400/400/400	401/402/409	
		Ampreage R/S/T	Amp Meter/ACB display	292.35	194.400	202.17 h	
		KWH	KWH Meter	528.0	330.5	531.7	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.96	0.99	0.98	
		CAP Number Of Working	Number	2, 3	7	9	
EMDB		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T/T-R	Digital Meter	403/402/402	404/404/406	406/404/404	
		Ampreage R/S/T	Digital Meter	26/28/34	30/40/37	28/37/42	
		KWH	Digital Meter	32037.3	32218.7	32302.8	
Transfer pump A	Water Treatment	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40	40 psi	40 psi	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Transfer Pump Pressure	Discharge Pressure Gauge	28	28 psi	28 psi	
Transfer pump B	Water Treatment	B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual				
		Ampreage	Amp Meter				
Deep Well Pump		Deep Well General Status	Normal				
Raw Water	Raw water tank	Level in Raw Tank	CM.	169	164 cm	170 cm	
		PWA Valve	Open/Close	open	open	open	
		PWA	Normal/Slow/Not Flow	slow	slow	slow	
Booster pump	Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	55	58 psi	56 psi	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	200	212 cm	215	
Booster pump	Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	51	50 psi	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	220	219 cm	220	



DATE: 15/2/68

Equipment	Location	Description	Standard	09:00	17:00	01:00	Remark
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	51	56	
		Pressure	IN/Out	34/46	34/46	34/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	Off	Off	Off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	50	50	50	
		Low Pressure PSI (Low)	PSI	21	22	22	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้องถัง)	Normal Lock	Normal lock	Normal lock	Normal lock	
Waste Water Treatment	House Keeping Stored	Gas Leak Detector	Normal	Normal	Normal	Normal	
		A-WWT-General Status	Normal	Normal	Auto	Manual	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Off	Off	Off	
		A-WWT-Electric KWH	KWH Meter	776.1	790.1	791.5	
Submersible Pump	Basement A Near Canteen	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	279.6	280.7	281.4	
		B-WWT-General Status	Normal	Normal	Normal	Normal	
Basement B Parking Motorcycle	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
Basement B Parking Left Side (3.7KW)	Basement B Parking Left Side (3.7KW)	B2-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B2-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B2-SSP-General Status	Normal	Normal	Normal	Normal	
		B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
Basement B Parking Right Side (100Q)	Basement B Parking Right Side (100Q)	B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
		B4-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B4-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B4-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	B4-SSP-General Status	Normal	Normal	Normal	Normal	
		IR-Pump Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		IR-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		IR- Discharge Pressure	Discharge Pressure Gauge	Normal	Normal	Normal	
		IR-General Status	Normal	Normal	Normal	Normal	

Checked By / Record By



Cold Freezer Cabinet Check lists & Consumption Record

DATE: 15/2/68

NO.	Code ID	Name/Type	Location	Temp. Setting °C	09:00	17:00	01:00	Remark
1	CR-001	Chiller Room		2	3.9	5.6	2.8	
2	CR-002	Freezer 4 Door-Upright	Prepare Room	-18	-11.6	-12.8	-14.1	No Work
3	CR-003	Freezer 4 Door-Upright		-18	-14.8	-14.1	-9.4	
4	CR-004	4 Door-Upright		2	2.7	2.1	2.2	
5	CR-005	3 Door-Base	Cold Kitchen	5	2.7	2.2	2.2	
6	CR-006	Ice-Cream Cabinet		-20	-20	-24	-25	
7	CR-007	2 Door-Upright	Kitchen	2	2.4	3.1	2.5	
8	CR-008	3 Door-Base	Hot Kitchen	5	6.4	2.5	4.0	
9	CR-009	3 Door-Base		5	4.5	4.3	4.9	
10	CR-010	3 Door-Base	Bar At Chaba	4	5.0	5.0	2.5	
11	CR-011	3 Door-Base	Restaurant	4	5.3	2.2	2.5	
12	CR-012	2 Door-Base		4	Off	Off	Off	
13	CR-013	3 Door-Base	Pool Bar A	2	4.0	3.2	2.5	
14	CR-014	3 Door-Base	Pool Bar B	2	4.5	3.5	2.5	
15	CR-015	2 Door-Base		2	4.1	3.0	2.5	
16	ICE-001	Ice Machine	Kitchen	Normal	On	On	On	
17	ICE-002	Ice Machine	Pool Bar B	Normal	On	On	On	

Checked By / Recorded By

ELECTRICITY RECORD							
High Voltage 33KV PEA Meter							
Item	Rate Code	Per Day	A 001'	B 002'	C 003'	A 005'	B 006'
Time		000'	09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00
Today							
Yesterday							
Total							

WATER RECORD				
Main Meter In Come				
Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD		
Fuel In Daytank		
Item	Generator Fuel Level	Generator Running Hour
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment



DATE: 22/2/68

Equipment	Location	Description	Standrand	Time			Remark		
				09:00	17:00	01:00			
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto			
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.6			
		Fuel level	Min.300 Liters	230	230L	230L			
		Total Engine Run Hrs.	HH:MM	4h 15m	4h 15m	4h 15m			
		Total number Of Starts	Number	34 (S)	32(3)	32(3)			
MDB	MDB Room	Voltage R-S-T/T-R	Volt Meter	400/400/402	400/400/400	400/400/400			
		Ampreage R/S/T	Amp Meter/ACB display	259.94	325.97	329.26			
		KWH	KWH Meter	562.3	564.6	566.0			
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto			
		Power Factor (PF)	0.85-1.00	0.94	0.96	0.98			
		CAP Number Of Working	Number	1,2	0,6	5			
EMDB		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto			
		Voltage R-S-T/T-R	Digilat Meter	403/402/403	404/404/407	402/402/404			
		Ampreage R/S/T	Digilat Meter	46/40/44	36/43/59	20/20/32			
		KWH	Digilat Meter	34544.8	34717.8	34819.5			
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto			
		A-Transfer Pump Pressure	Discharge Pressure Gauge	78	78 psi	80 psi			
		A-Filter Tank Status	Normal	Normal	Normal	Normal			
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal			
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto			
		B-Transfer Pump Pressure	Discharge Pressure Gauge	28	28 psi	28 psi			
		B-Filter Tank Status	Normal	Normal	Normal	Normal			
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal			
		Deep Well Pump		Deep well control Status	Auto/Off/Manual		Auto	Auto	
				Ampreage	Amp Meter		2	2	
Deep Well General Status	Normal				Normal	Normal			
Raw Water	Raw water tank	Level in Raw Tank	CM.	191	188 cm	190 cm			
		PWA Valve	Open/Close	Open	Open	Open			
		PWA	Normal/Slow/Not Flow	Slow	Slow	Slow			
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto			
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto			
		A- Discharge Pressure	Discharge Pressure Gauge	57	58 psi	56 psi			
		A-Booster Pump General Status	Normal	Normal	Normal	Normal			
		A-Level in Cold Tank	CM.	223	215	215 cm			
Booster pump. Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto			
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto			
		B- Discharge Pressure	Discharge Pressure Gauge	52	52	50			
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	2/2/2 1		
		B-Level in Cold Tank	CM	222	220 cm	222 cm			



DATE: 22/2/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	56	56	
		Pressure	IN/Out	35/46	34/46	34/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	Off	Off	Off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	50	50 PSI	50 PSI	
		Low Pressure PSI (Low)	PSI	20	22 PSI	22 PSI	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal lock	Normal lock	Normal lock	
Gas Leak Detector	Normal	Normal	Normal	Normal			
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Off	Off	Off	
		A-WWT-Electric KWH	KWH Meter	829.2	832.6	834.6	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	297.6	298.7	299.2	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				
Checked By / Record By							

Grand Kata VIP.

Engineer Department.

Cold/Freezer Cabinet Check lists & Consumption Record



DATE:

22/2/95

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	2.7	2.0		
2	CR-002	Freezer 4 Door-Upright		-18	-10.7	11.4		
3	CR-003	Freezer 4 Door-Upright		-18	-13.1	16.5		
4	CR-004	4 Door-Upright	Cold Kitchen	2	2.5	5.3		
5	CR-005	3 Door-Base		5	2F	4.0		
6	CR-006	Ice-Cream Cabinet		-20	-23	-2.1		
7	CR-007	2 Door-Upright	Kitchen	2	2EF	13.4		Jungthakorn
8	CR-008	3 Door-Base		5	5.4	8F		
9	CR-009	3 Door-Base		5	2.2	3.8		
10	CR-010	3 Door-Base	Bar At Chaba	4	4.4	6.3		
11	CR-011	3 Door-Base		4	5.6	5.1		
12	CR-012	2 Door-Base		4	0FF	0FF		
13	CR-013	3 Door-Base	Pool Bar A	2	3.5	3.2		
14	CR-014	3 Door-Base		2	2.7	2.4	3.8	
15	CR-015	2 Door-Base		2	4.1	3.7	2.0	
16	ICE-001	Ice Machine	Kitchen	Normal	0Y	0Y		
17	ICE-002	Ice Machine	Pool Bar B	Normal	0Y	0Y		

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV FEA Meter

Item	Per Day	A 001'	B 002'	C 003'	A 005'	B 006'	C 007'
Rate Code Time	000'	09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00	00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.

DATE:

24/2/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6 V	27.6	27.6	
		Fuel level	Min.300 Liters	220 L	220 L	220	
		Total Engine Run Hrs.	HEMM	4h 30m	4h 30m	4h 30m	
		Total number Of Starts	Number	35 (S)	35 (S)	35 (S)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	400/400/401	400/400/400	400/400/400	
		Amperage R/S/T	Amp Meter/ACB display	264.06	309.24	456.11	
		KWH	KWH Meter	591.5	593.8	595.2	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.94	0.97	0.98	
EMDB	EMDB Room	CAP Number Of Working	Number	6.7	6.7	5	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digital Meter	401/401/404	402/405/407	402/407/405	
		Amperage R/S/T	Digital Meter	33/29/24	30/28/41	28/30/32	
		KWH	Digital Meter	36665.4	36843.4	36943.7	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40	70 psi	40 psi	
		A-Filter Tank Status	Normal	NORMAL	Normal	Normal	
		A-Transfer Pump General Status	Normal	NORMAL	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	74	28 psi	28 psi	
		B-Filter Tank Status	Normal	NORMAL	Normal	Normal	
		B-Transfer Pump General Status	Normal	NORMAL	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Auto	Auto	Auto	
		Amperage	Amp Meter	-	0	0	
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal	NORMAL	Normal	Normal	
		Level in Raw Tank	CM.	190	184	190	
		PWA Valve	Open/Close	open	open	open	
		PWA	Normal/Slow/Not Flow	slow	Slow	Slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	55	54 psi	56 psi	
		A-Booster Pump General Status	Normal	NORMAL	Normal	Normal	
		A-Level in Cold Tank	CM.	215	215	215	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	50	52	50	
		B-Booster Pump General Status	Normal	NORMAL	Normal	Normal	
		B-Level in Cold Tank	CM.	214	220	222	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 99/2/95

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	53	50°	55	
		Pressure	IN/Out	35/46	31/41	21/26	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	Off	Off	Off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Header Pressure PSI (High)	PSI	60	50 PSI	20 PSI	
		Low Pressure PSI (Low)	PSI	21	22 PSI	22 PSI	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้องถัง)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Off	Off	Off	
		A-WWT-Electric KWH	KWH Meter	574.6	877.8	879.9	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	312.7	313.8	312.5	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual	/	/	/	
		B2-SSP-Pump 1 Status	Normal	/	/	/	
		B2-SSP-Pump 2 Status	Normal	/	/	/	
		B2-SSP-General Status	Normal	/	/	/	
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
B3-SSP-Pump 1 Status		Normal	Normal	Normal	Normal		
B3-SSP-Pump 2 Status		Normal	Normal	Normal	Normal		
B3-SSP-General Status		Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual	/	/	/	
		IR-Inverter Status	Auto/Off/Manual	/	/	/	
		IR- Discharge Presture	Discharge Pressure Gauge	/	/	/	
		IR-General Status	Normal	/	/	/	
Checked By / Record By							

Grand Kata VIP.
Engineer Department.



Cold Freezer Cabinet Check lists & Consumption Record

DATE: 99/4/95

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	3.7	4.9		
2	CR-002	Freezer 4 Door-Upright		-18	-12.9	-14.1		
3	CR-003	Freezer 4 Door-Upright		-18	-16.6	-14.0		
4	CR-004	4 Door-Upright	Cold Kitchen	2	2.6	3.2		
5	CR-005	3 Door-Base		5	2.1	1.9		
6	CR-006	Ice-Cream Cabinet		-20	-22	-20		
7	CR-007	2 Door-Upright	Kitchen	2	DEF	2.0		
8	CR-008	3 Door-Base	Hot Kitchen	5	5.7	5.9		
9	CR-009	3 Door-Base		5	2.0	4.1		
10	CR-010	3 Door-Base		4	4.3	5.5		
11	CR-011	3 Door-Base	Bar At Chaba	4	4.5	4.2		
12	CR-012	2 Door-Base		4	Off	Off		
13	CR-013	3 Door-Base	Restaurant	2	3.0	3.0		
14	CR-014	3 Door-Base		2	2.6	2.4		
15	CR-015	2 Door-Base		2	4.1	3.0		
16	ICE-001	Ice Machine	Pool Bar A	Normal	On	On		
17	ICE-002	Ice Machine	Pool Bar B	Normal	On	On		
Checked By / Recorded By								

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item	Rate	Code	Time	Per Day	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today										
Yesterday										
Total										

WATER RECORD

Main Meter In Come

Item	FWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hour.
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 8/13/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6V	27.6V	27.6V	
		Fuel level	Min.300 Liters	220L	220L	220L	
		Total Engine Run Hrs.	HH:MM	4h 45m	4h 45m	4h 45m	
		Total number Of Starts	Number	36 (7)	36 (5)	36 (5)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	398/397/399	400/400/402	400/400/402	
		Amptage R/S/T	Amp Meter/ACB display	274.29	304.60	227.70	
		KWH	KWH Meter	631.4	632.7	635.4	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.99	0.96	0.99	
EMDB	EMDB Room	CAP Number Of Working	Number	2	1, 5	6	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digilat Meter	396/397/399	404/404/402	403/404/406	
		Amptage R/S/T	Digilat Meter	35/30/39	36/36/51	76/19/35	
		KWH	Digilat Meter	39382.7	39755.7	39574.8	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	10 Psi	40	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	74 Psi	74	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Auto	Auto	Auto	
		Amptage	Amp Meter	0	7	-	
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal	Normal	Normal	Normal	
Raw Water	Raw water tank	Level in Raw Tank	CM.	190 CM	190	194	
		PWA Valve	Open/Close	Open	open	open	
		PWA	Normal/Slow/Not Flow	slow	slow	slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Discharge Pressure	Discharge Pressure Gauge	54 Psi	55	54	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	216 CM	217	215	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Discharge Pressure	Discharge Pressure Gauge	50 Psi	48	50	Normal
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	217 CM	219	218	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 8/13/95

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	57	54	56	
		Pressure	IN/Out	34/47	35/47	35/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	10 Psi	90	20	
		Low Pressure PSI (Low)	PSI	22 Psi	22	19	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (Tiketok 303)	Normal Lock	Normal lock	Normal lock	Normal lock	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	off	off	off	
		A-WWT-Electric KWH	KWH Meter	995.1	938.0	941.0	
		B-WWT-General Status	Normal	Normal	Normal	Normal	
Submersible Pump	Basement A Near Canteen	B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	339.0	334.1	335.0	
		A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement B Parking Motorcycle	A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
		B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
Checked By / Record By	Basement B Parking Left Side (3.7KW)	B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
		IR-Pump Control Status	Auto/Off/Manual				
	Basement B Near Garbage Room	IR-Inverter Status	Auto/Off/Manual				
		IR-Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				

Grand Kata VIP.

Engineer Department.

Cold/Freezer Cabinet Check lists & Consumption Record



DATE: 8/3/25

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	7.5	2.3	2.3	Water 45/5
2	CR-002	Freezer 4 Door-Upright		-18	-13.7	-13.3	-14.3	
3	CR-003	Freezer 4 Door-Upright		-18	off	-16.5	-16.6	
4	CR-004	4 Door-Upright	Cold Kitchen	2	4.5	3.5	2.3	
5	CR-005	3 Door-Base		5	2.0	off	off	
6	CR-006	Ice-Cream Cabinet		-20	-22	-26	-25	
7	CR-007	2 Door-Upright	Kitchen	2	off	3.5	3.0	
8	CR-008	3 Door-Base		5	5.0	5.4	6.9	
9	CR-009	3 Door-Base	Hot Kitchen	5	2.3	5.4	2.3	
10	CR-010	3 Door-Base		4	4.7	4.4	4.2	
11	CR-011	3 Door-Base	Bar At Chaba	4	5.8	4.8	5.2	
12	CR-012	2 Door-Base		4	off	off	off	
13	CR-013	3 Door-Base	Pool Bar A	2	2.7	2.4	2.5	
14	CR-014	3 Door-Base		2	2.9	4.0	2.2	
15	CR-015	2 Door-Base	Pool Bar B	2	3.2	2.0	2.9	
16	ICE-001	Ice Machine		Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	on	on	on	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Items Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Items	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.

Engineer Department.

Daily Check lists.



DATE: 15/3/68

Equipment	Location	Description	Standand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6V	27.6V	27.6V	
		Fuel level	Min.300 Liters	195L	190L	190L	
		Total Engine Run Hrs.	HH:MM	7h 40m	7h 40m	7h 40m	
		Total number Of Starts	Number	37(5)	32(5)	37(5)	
MDB	MDB Room	Voltage R-S/S-T/T-R	Volt Meter	400/400/402	400/400/401	398/396/400	
		Amperage R/S/T	Amp Meter/ACB display	204.04A	306.52	199.94	
		KWH	KWH Meter	665.9	663.2	669.9	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.98	0.99	0.98	
EMDB	EMDB Room	CAP Number Of Working	Number	8	6,7	5	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S/S-T/T-R	Digital Meter	407/407/404	401/401/404	400/399/401	
		Amperage R/S/T	Digital Meter	88/25/42	34/42/60	15/16/36	
		KWH	Digital Meter	42100.8	42274.3	42391.6	
Transfer pump A	Water Treatment	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40Psi	79	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
Transfer pump B	Water Treatment	B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Transfer Pump Pressure	Discharge Pressure Gauge	28Psi	28	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
Deep Well Pump	Deep Well Pump	Deep well control Status	Auto/Off/Manual	Auto	Auto	Auto	
		Amperage	Amp Meter	0	-	7	
		Deep Well General Status	Normal	Normal	Normal	Normal	
Raw Water	Raw water tank	Level in Raw Tank	CM	190 CM	190	192	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	slow	slow	slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	56Psi	58	58	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM	218 CM	213	201	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	52 Psi	50	46	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	217 CM	222	223	

Equipment	Location	Description	Standand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	56	56	
		Pressure	IN/Out	35/47	35/47	35/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	0P21	60	15	
		Low Pressure PSI (Low)	PSI	21 P41	21	17	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้องถัง)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	off	off	off	
		A-WWT-Electric KWH	KWH Meter	988.0	990.9	993.6	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	351.0	352.1	353.0	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto		
	B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal		
	B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal		
	B3-SSP-General Status	Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
	Near Garbage Room	IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				
Checked By / Record By							

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	5.0	DEF	3.5	
2	CR-002	Freezer 4 Door-Upright		-18	-14.3	-12.0	-14.0	
3	CR-003	Freezer 4 Door-Upright		-18	-13.6	-15.4	-16.9	
4	CR-004	4 Door-Upright	Cold Kitchen	2	3.7	4.5	2.2	
5	CR-005	3 Door-Base		5	4.3	2.4	2.6	
6	CR-006	Ice-Cream Cabinet		-20	-25	-19	-23	มีของในตู้
7	CR-007	2 Door-Upright	Kitchen	2	6.1	2.3	2.6	
8	CR-008	3 Door-Base		5	5.3	5.6	4.9	
9	CR-009	3 Door-Base		5	4.1	2.6	2.4	
10	CR-010	3 Door-Base	Bar At Chaba	4	4.5	5.4	5.6	
11	CR-011	3 Door-Base		4	4.0	5.4	4.9	
12	CR-012	2 Door-Base		4	OFF	OFF	OFF	
13	CR-013	3 Door-Base	Pool Bar A	2	3.1	2.6		
14	CR-014	3 Door-Base		2	3.3	3.3	2.5	
15	CR-015	2 Door-Base		2	2.4	1.9	2.9	
16	ICE-001	Ice Machine	Kitchen	Normal	ON	ON	ON	
17	ICE-002	Ice Machine	Pool Bar B	Normal				
Checked By / Recorded By								

ELECTRICITY RECORD							
High Voltage 33KV PEA Meter							
Items Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD				
Main Meter In Come				
Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD		
Fuel In Daytank		
Item	Generator Fuel Level	Generator Running Hour
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 22 / 3 / 68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6V	27.6V	27.6V	
		Fuel level	Min.300 Liters	360L	360L	360L	
		Total Engine Run Hrs.	HH:MM	7h 55m	8h 24m	8h 24m	
		Total number Of Starts	Number	38(5)	39(5)	39(5)	
MDB	MDB Room	Voltage R-S-T/T-R	Volt Meter	398/398/400	402/402/405		
		Ampreage R/S/T	Amp Meter/ACB display	240.88A	310.47	199.42	
		KWH	KWH Meter	700.2	702.4	704.1	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.96	0.96	0.99	
EMDB	MDB Room	CAP Number Of Working	Number	5, 6	4, 5	2	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-T/T-R	Digilat Meter	400/400/402	401/402/403	407/407/409	
		Ampreage R/S/T	Digilat Meter	401/401/404	341/341/404	161/21/32	
		KWH	Digilat Meter	44567.2	44727.4	44847.7	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	80 Psi	40	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Transfer Pump Pressure	Discharge Pressure Gauge	28 Psi	25	25	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
Deep Well Pump	Transfer Pump Room	Deep well control Status	Auto/Off/Manual	Auto	Auto	Auto	
		Ampreage	Amp Meter	0	-	-	
		Deep Well General Status	Normal	Normal	Normal	Normal	
Raw Water	Raw water tank	Level in Raw Tank	CM.	190 cm	190	194	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Normal	Normal	Normal	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	57 Psi	58	58	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	214 cm	215	217	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	53 Psi	48	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	220 cm	214	214	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 22 / 3 / 68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	56°	36	58	off/start
		Pressure	IN/Out	35/47	35/47	35/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	90 Psi	90	20	
		Low Pressure PSI (Low)	PSI	22 Psi	22	21	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้องถัง)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1038.9	1041.6	1044.4	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	369.2	370.3	371.2	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
B3-SSP-Pump 1 Status		Normal	Normal	Normal	Normal		
B3-SSP-Pump 2 Status		Normal	Normal	Normal	Normal		
B3-SSP-General Status		Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
	Near Garbage Room	IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				
Checked By / Record By							

Grand Kata VIP.

Engineer Department.

Cold/Freezer Cabinet Check lists & Consumption Record



DATE:

22/3/68

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	3.5	2.5	2.6	
2	CR-002	Freezer 4 Door-Upright		-18	-13.8	-13.1	DEF	
3	CR-003	Freezer 4 Door-Upright		-18	-16.7	-17.9	DEF	
4	CR-004	4 Door-Upright	Cold Kitchen	2	8.5	9.1	4.9	
5	CR-005	3 Door-Base		5	2.4	4.0	2.6	
6	CR-006	Ice-Cream Cabinet		-20	-25	-25	-26	
7	CR-007	2 Door-Upright	Kitchen	2	5.4	3.6	DEF	
8	CR-008	3 Door-Base	Hot Kitchen	5	7.2	5.2	DF	
9	CR-009	3 Door-Base		5	2.1	3.5	DF	
10	CR-010	3 Door-Base		4	6.0	5.3	DF	
11	CR-011	3 Door-Base	Bar At Chabu Restaurant	4	5.7	5.5	DF	
12	CR-012	2 Door-Base		4	0.4	0.6	OFF	
13	CR-013	3 Door-Base		2	2.5	2.6		
14	CR-014	3 Door-Base	Pool Bar B	2	2.8	2.2	2.0	
15	CR-015	2 Door-Base		2	2.0	3.6	DF	
16	ICE-001	Ice Machine	Kitchen	Normal	ON	ON	ON	
17	ICE-002	Ice Machine	Pool Bar B	Normal	ON	ON	ON	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item	Per Day	A	B	C	A	B	C
Rate Code	000'	001'	002'	003'	005'	006'	007'
Time	00:00-09:00	09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00	00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.

Engineer Department.

Daily Check lists:



DATE: 29/3/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6V	27.6V	27.6V	
		Fuel level	Min.300 Liters	355L	355L	355L	
		Total Engine Run Hrs.	HH:MM	8h 50m	8h 50m	8h 50m	
		Total number Of Starts	Number	41 (S)	41 (S)	41 (S)	
MDB	MDB Room	Voltage R-S-T-T-R	Volt Meter	402/400/402	400/400/401	405/405/410	
		Amperage R/S/T	Amp Meter/ACB display	277.10A	296.49	195.11	
		KWH	KWH Meter	795.6	737.2	738.9	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.99	0.95	0.98	
EMDB	EMDB Room	CAP Number Of Working	Number	4	5.6	2	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-T-T-R	Digilat Meter	403/409/405	403/402/405	407/407/409	
		Amperage R/S/T	Digilat Meter	76/71/40	39/36/54	75/77/33	
		KWH	Digilat Meter	47102.2	47258.3	47380.7	
Transfer pump A	Water Treatment	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40 PSI	79	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B	Water Treatment	B-Transfer Pump Pressure	Discharge Pressure Gauge	28 PSI	74	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	off	off	off	
		Amperage	Amp Meter	-	-	-	
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal	off	-	-	
		Level in Raw Tank	CM.	190 CM	191	192	
		PWA Valve	Open/Close	open	open	open	
		PWA	Normal/Slow/Not Flow	slow	slow	slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	54 PSI	58	57	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	215 CM	213	218	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	48 PSI	52	49	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	218 CM	220	222	



DATE: 29/3/95

Equipment	Location	Description	Standard	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	54	57	
		Pressure	IN/Out	34/47	35/47	35/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	40 PSI	50	0	67M 62 PSI
		Low Pressure PSI (Low)	PSI	29 PSI	22	0	67M 22 PSI
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (Trống khóa)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1089.4	1092.1	1095.0	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	367.8	369.0	369.9	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual	/	/	/	
		B2-SSP-Pump 1 Status	Normal	/	/	/	
		B2-SSP-Pump 2 Status	Normal	/	/	/	
		B2-SSP-General Status	Normal	/	/	/	
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual	/	/	/	
		IR-Inverter Status	Auto/Off/Manual	/	/	/	
		IR- Discharge Pressure	Discharge Pressure Gauge	/	/	/	
		IR-General Status	Normal	/	/	/	

Checked By: Record By:



DATE: 29/3/95

Cold/Freezer Cabinet Check lists & Consumption Record

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	4.6	3.4	2.9	
2	CR-002	Freezer 4 Door-Upright		-18	-13.2	-11.2	DEF	
3	CR-003	Freezer 4 Door-Upright		-18	-16.0	-15.5	-17.1	
4	CR-004	4 Door-Upright	Cold Kitchen	2	4.6	10.3	7.6	
5	CR-005	3 Door-Base		5	2.3	4.4	3.2	
6	CR-006	Ice-Cream Cabinet		-20	-24	-27	-26	
7	CR-007	2 Door-Upright	Kitchen	2	2.4	DEF	DEF	
8	CR-008	3 Door-Base	Hot Kitchen	5	5.0	df	df	
9	CR-009	3 Door-Base		5	2.3	3.3	3.7	
10	CR-010	3 Door-Base		4	5.1	4.4	4.2	
11	CR-011	3 Door-Base	Bar At Chaba	4	4.2	6.2	df	
12	CR-012	2 Door-Base	Restaurant	4	off	off	off	
13	CR-013	3 Door-Base	Pool Bar A	2	2.6	2.2		
14	CR-014	3 Door-Base	Pool Bar B	2	2.4	df	3.0	
15	CR-015	2 Door-Base		2	3.3	2.3	df	
16	ICE-001	Ice Machine	Kitchen	Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	on	on	on	

Checked By / Recorded By

ELETRICITY RECORD

High Voltage 33KV PEA Meter

Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 4/4/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generitor Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.6	
		Fuel level	Min.300 Liters	360	355 L	355 L	
		Total Engine Run Hrs.	HH:MM	9h 0m	9h 5m	9h 5m	
		Total number Of Starts	Number	42 (5)	42 (5)	42 (5)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	400/400/400	400/400/402	400/400/402	
		Ampreage R/S/T	Amp Meter/ACB display	319.551	247.50	154.44	
		KWH	KWH Meter	762.2	766.5	768.1	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.97	0.93	0.96	
EMDB	MDB Room	CAP Number Of Working	Number	6.6	3.4	2	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digital Meter	405/405/407	403/403/408	404/403/405	
		Ampreage R/S/T	Digital Meter	35/39/13	31/39/54	14/20/34	
		KWH	Digital Meter	49226.2	49393.7	49505.5	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	80	40	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	25	26	26	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	off	off	off	
		Ampreage	Amp Meter	-	-	-	
Deep Well Pump	Transfer Pump Room	Deep Well General Status	Normal	Normal	-	-	
		Level in Raw Tank	CM.	190	190	191	
		PWA Valve	Open/Close	open	open	open	
		PWA	Normal/Slow/Not Flow	Normal	Normal	slow	
		A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Booster pump Building A	Roof Top Building A	A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	08	57	54	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	215 cm	216	222	
		B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Booster pump Building B	Roof Top Building B	B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	54	46	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	218	220	222	
		B-Level in Cold Tank	CM	218	220	222	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 4/4/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	54	56	57	
		Pressure	IN/Out	36/26	35/47	35/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Header Pressure PSI (High)	PSI	32	105	20	
		Low Pressure PSI (Low)	PSI	20	22	21	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (Tandem lock)	Normal Lock	Normal lock	Normal lock	Normal lock	
Waste Water Treatment	House Keeping Stored Parking Building B	Gas Leak Detector	Normal	Normal	Normal	Normal	
		A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1132.6	1135.4	1138.3	
Submersible Pump	Basement A Near Canteen Basement B Parking Motorcycle Basement B Parking Left Side (3.7KW) Basement B Parking Right Side (100Q)	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	203.9	405.5	405.9	
		A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
Irrigation Water Reuse	Basement Building B Near Garbage Room	A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
		B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
		B3-SSP-Control Status	Auto/Off/Manual	Purge	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
		IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				

Checked By: / Record By:

Grand Kata VIP.

Engineer Department.

Cold/Freezer Cabinet Check lists & Consumption Record



DATE: 4/4/68

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	4.8	6.1	2.7	
2	CR-002	Freezer 4 Door-Upright		-18	-18.4	-11.8	-9.3	
3	CR-003	Freezer 4 Door-Upright		-18	-18.9	-7.0	-13.8	
4	CR-004	4 Door-Upright	Cold Kitchen	2	14.1	2.7	4.3	
5	CR-005	3 Door-Base		5	14	3.7	2.0	
6	CR-006	Ice-Cream Cabinet		-20	-25	-25	-26	
7	CR-007	2 Door-Upright	Kitchen	2	3.1	3.2	4.1	
8	CR-008	3 Door-Base	Hot Kitchen	5	5.3	7.3	5.1	
9	CR-009	3 Door-Base		5	5.7	off	3.9	
10	CR-010	3 Door-Base	Bar At Chaba	4	6.1	4.2	5.3	
11	CR-011	3 Door-Base	Restaurant	4	4.9	4.2	5.8	
12	CR-012	2 Door-Base		4	off	off	off	
13	CR-013	3 Door-Base	Pool Bar A	2	3.2	4.0	2.6	
14	CR-014	3 Door-Base	Pool Bar B	2	3.0	4.1	2.6	
15	CR-015	2 Door-Base		2	2.6	3.9	1.9	
16	ICE-001	Ice Machine	Kitchen	Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	on	on	on	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.

Engineer Department.

Daily Check lists.



DATE: 12/04/25

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.7	27.6	
		Fuel level	Min. 500 Liters	355L	355L	355L	
		Total Engine Run Hrs.	HH:MM	9h 32m	9h 32m	9h 32m	
		Total number Of Starts	Number	44 (S)	44 (S)	44 (S)	
MDB	MDB Room	Voltage R-S-T-T-R	Volt Meter	400/400/400	402/402/405	405/405/410	
		Ampereage R/S/T	Amp Meter/ACB display	229.59	227.04	222.78	
		KWH	KWH Meter	802.8	505.0	806.7	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.91	0.97	0.99	
EMDB	EMDB Room	CAP Number Of Working	Number	6	2,3	7	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-T-T-R	Digital Meter	405/405/405	404/405/406	407/407/409	
		Ampereage R/S/T	Digital Meter	301.27/0.7	48/44/66	16/15/36	
		KWH	Digital Meter	5199.8-1	52167.5	52286.4	
Transfer pump A	Water Treatment	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	78	79	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B	Water Treatment	B-Transfer Pump Pressure	Discharge Pressure Gauge	58	28	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Off	Off	Off	
		Ampereage	Amp Meter	16/11/20/20	-	-	
Deep Well Pump		Deep Well General Status	Normal	-	-	-	
		Level in Raw Tank	CM.	196	191	192	
		PWA Valve	Open/Close	Open	Open	Open	
Booster pump	Roof Top Building A	PWA	Normal/Slow/Not Flow	Slow	Slow	Slow	
		A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	58	57	56	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
Booster pump	Roof Top Building B	A-Level in Cold Tank	CM.	215 cm	213	220	
		B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	59	49	53	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
Booster pump	Roof Top Building B	B-Level in Cold Tank	CM	220 cm	215	215	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE: 19/4/25

Equipment.	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	56	57	
		Pressure	IN/Out	34/0.6	35/47	35/47	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	60	60	75	
		Low Pressure PSI (Low)	PSI	22	22	18	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้องถัง)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1190.0	1192.9	1195.8	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	425.3	426.4	427.4	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	A-SSP-General Status	Normal	Normal	Normal	Normal	
		B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual	/	/	/	
		B2-SSP-Pump 1 Status	Normal	/	/	/	
		B2-SSP-Pump 2 Status	Normal	/	/	/	
	Basement B Parking Right Side (100Q)	B2-SSP-General Status	Normal	/	/	/	
		B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement	IR-Pump Control Status	Auto/Off/Manual	/	/	/	
	Building B	IR-Inverter Status	Auto/Off/Manual	/	/	/	
	Near Garbage Room	IR- Discharge Pressure	Discharge Pressure Gauge	/	/	/	
	Room	IR-General Status	Normal	/	/	/	

Checked By / Record By

Grand Kata VIP.
Engineer Department.



Cold/Freezer Cabinet Check lists & Consumption Record

DATE: 19/04/25

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	7.3	6.3	3.6	
2	CR-002	Freezer 4 Door-Upright		-18	-1.5	-10.8	-11.4	
3	CR-003	Freezer 4 Door-Upright		-18	-8.8	-12.3	-10.8	
4	CR-004	4 Door-Upright	Cold Kitchen	2	3.0	3.2	4.1	
5	CR-005	3 Door-Base		5	df	2.7	2.3	
6	CR-006	Ice-Cream Cabinet		-20	-0.9	-2.6	-2.4	
7	CR-007	2 Door-Upright	Kitchen	2	9.7	df	4.1	
8	CR-008	3 Door-Base	Hot Kitchen	5	5.3	df	7.1	
9	CR-009	3 Door-Base		5	4	4.1	3.9	
10	CR-010	3 Door-Base	Bar At Chaba Restaurant	4	6.6	df	5.7	
11	CR-011	3 Door-Base		4	1.0	df	6.2	
12	CR-012	2 Door-Base	Pool Bar A	4	df	df	df	
13	CR-013	3 Door-Base		2		2.7	2.9	
14	CR-014	3 Door-Base	Pool Bar B	2	3.5	df	2.3	
15	CR-015	2 Door-Base		2	3.9	2.2	3.2	
16	ICE-001	Ice Machine	Kitchen	Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	on	on	on	

Checked By / Recorded By

ELECTRICITY RECORD							
High Voltage 33KV PEA Meter							
Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD				
Main Meter In Come				
Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD		
Fuel In Daytank		
Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE :

19/4/68

Equipment.	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6 V	27.5 V	27.5 V	
		Fuel level	Min.300 Liters	350 L	350 L	350 L	
		Total Engine Run Hrs.	HH:MM	7h 4m	11h 4m	11h 4m	
		Total number Of Starts	Number	54 S	54 (S)	54 (S)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	400/400/400/400/402/402/405			
		Ampreage R/S/T	Amp Meter/ACB display	278.30	243.79	134.11	
		KWH	KWH Meter	839.5	839.7	841.6	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.97	0.99	0.98	
		CAP Number Of Working	Number	6, 7	2	7	
EMDB		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digilat Meter	401/401/403/403/402/403/405/404/406			
		Ampreage R/S/T	Digilat Meter	42/40/34	44/36/34	17/17/24	
		KWH	Digilat Meter	54490.9	54657.5	54744.5	
Transfer pump A Water Treatment		A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	50	78	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	76	28	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
Deep Well Pump		Deep well control Status	Auto/Off/Manual	off	off	off	
		Ampreage	Amp Meter	-	-	-	
		Deep Well General Status	Normal	-	-	-	
Raw Water	Raw water tank	Level in Raw Tank	CM.	190	178	175	
		PWA Valve	Open/Close	open	open	open	
		PWA	Normal/Slow/Not Flow	normal	slow	slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	58	69	57	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	220	215	219	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	50	50	52	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	slight
		B-Level in Cold Tank	CM	215	215	216	

Grand Kata VIP.
Engineer Department.
Daily Check lists.



DATE :

19/4/68

Equipment.	Location	Description	Standrand	Time			Remark	
				09:00	17:00	01:00		
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	55	56		
		Pressure	IN/Out	34-47	35/47	34/46		
		Heat pump General Status	Normal	Normal	Normal	Normal		
		Heat tank 1 status	Normal	off	off	off		
		Heat tank 2 status	Normal	Normal	Normal	Normal		
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal		
		Hotter Pressure PSI (High)	PSI	30	20	10		
		Low Pressure PSI (Low)	PSI	22	20	16		
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal		
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal Lock	Normal lock	Normal lock		
		Gas Leak Detector	Normal	Normal	Normal	Normal		
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal		
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto		
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto		
		A-WWT-Electric KWH	KWH Meter	1240.9	1243.6	1245.9		
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal		
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto		
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto		
		B-WWT-Electric KWH	KWH Meter	444.4	445.5	446.3		
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto		
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal		
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal		
		A-SSP-General Status	Normal	Normal	Normal	Normal		
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto		
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal		
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal		
			B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual	/	/	/		
		B2-SSP-Pump 1 Status	Normal	/	/	/		
		B2-SSP-Pump 2 Status	Normal	/	/	/		
		B2-SSP-General Status	Normal	/	/	/		
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto		
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal		
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal		
B3-SSP-General Status		Normal	Normal	Normal	Normal			
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual	/	/	/		
		IR-Inverter Status	Auto/Off/Manual	/	/	/		
		IR- Discharge Pressure	Discharge Pressure Gauge	/	/	/		
		IR-General Status	Normal	/	/	/		
Checked By / Record By								

Grand Kata VIP,

Engineer Department.

Cold Freezer Cabinet Check lists & Consumption Record



DATE:

19/4/18

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	6.8	6.5	2.2	
2	CR-002	Freezer 4 Door-Upright		-18	-12.8	-12.5	-13.3	
3	CR-003	Freezer 4 Door-Upright		-18	-17.6	-17.2	-16.5	
4	CR-004	4 Door-Upright	Cold Kitchen	2	3.9	3.5	2.7	
5	CR-005	3 Door-Base		5	3.3	3.1	2.7	
6	CR-006	Ice-Cream Cabinet		-20	-23	-24	-20	
7	CR-007	2 Door-Upright	Kitchen	2	3.0	5.2	3.3	
8	CR-008	3 Door-Base	Hot Kitchen	5	5.5	6.6	5.0	
9	CR-009	3 Door-Base		5	4.1	2.4	4.1	
10	CR-010	3 Door-Base	Bar At Chaba	4	5.7	5.8	5.0	
11	CR-011	3 Door-Base		4	5.3	5.5	6.1	
12	CR-012	2 Door-Base	Restaurant	4	2.7	0.7	0.7	
13	CR-013	3 Door-Base	Pool Bar A	2	2.0	3.1	3.8	
14	CR-014	3 Door-Base	Pool Bar B	2	3.7	3.3	2.0	
15	CR-015	2 Door-Base		2	2.7	4.1	4.1	
16	ICE-001	Ice Machine	Kitchen	Normal	0.1	0.1	0.1	
17	ICE-002	Ice Machine	Pool Bar B	Normal	0.1	0.1	0.1	

Checked By / Recorded By

ELETRICITY RECORD

High Voltage 33KV PEA Meter

Item	Per Day	A	B	C	A	B	C
Rate Code Time	000'	001'	002'	003'	005'	006'	007'
		09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00	00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hour
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.

DATE:

26/4/18

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.6	
		Fuel level	Min.300 Liters	350	850	850	
		Total Engine Run Hrs.	HH:MM	11h 34m	11h 34m	11h 34m	
		Total number Of Starts	Number	56 (S)	56 (S)	56 (S)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	40/40/40/40	40/40/40/40	40/40/40/40	
		Ampereage R/S/T	Amp Meter/ACB display	322.02	333.50	275.94	
		KWH	KWH Meter	872.7	874.6	875.8	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.99	0.97	0.94	
EMDB	EMDB Room	CAP Number Of Working	Number	3	12	6	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digital Meter	402/402/403	402/402/405	405/403/404	
		Ampereage R/S/T	Digital Meter	29/31/46	30/35/18	113/10/54	
		KWH	Digital Meter	56423.6	5714.3	5799.9	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40 psi	7.5 psi	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	7.5 psi	7.5 psi	99	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Off	Off	Off	
		Ampereage	Amp Meter	-	100/100		
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal	-	Normal	Normal	
Raw Water	Raw water tank	Level in Raw Tank	CM.	190	190 cm	190	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Normal	Slow	Slow	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	58	58	58	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	215	215 cm	215	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	52	56	52	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	219	217 cm	215 cm	



DATE: 26/4/69

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	47	51	47	
		Pressure	IN/Out	32/44	34/45	39/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Bonder Pressure PSI (High)	PSI	70	70	70	
		Low Pressure PSI (Low)	PSI	22	22	26	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้องถัง)	Normal Lock	Normal Lock	Normal Lock	Normal Lock	
Waste Water Treatment	House Keeping Stored	Gas Leak Detector	Normal	Normal	Normal	Normal	
		A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1291.9	1295.9	1296.9	
Submersible Pump	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	463.4	469.5	465.2	
Irrigation Water Reuse	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B2-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Right Side (100Q)	B2-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B2-SSP-General Status	Normal	Normal	Normal	Normal	
		B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Right Side (100Q)	B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		IR-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		IR- Discharge Pressure	Discharge Pressure Gauge	Auto	Auto	Auto	
		IR-General Status	Normal	Normal	Normal	Normal	

Checked By / Record By



DATE: 26/4/69

Cold/Freezer Cabinet Check lists & Consumption Record

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	2.8	4.8	2.5	
2	CR-002	Freezer 4 Door-Upright		-18	-18.2	-18.5	-18.7	
3	CR-003	Freezer 4 Door-Upright		-18	-18.6	-18.9	-18.7	
4	CR-004	4 Door-Upright	Cold Kitchen	2	2.4	3.1	2.9	
5	CR-005	3 Door-Base		5	2.4	3.4	2.5	
6	CR-006	Ice-Cream Cabinet		-20	-20.6	-20.6	-20.6	
7	CR-007	2 Door-Upright	Kitchen	2	2.4	7.0	5.1	
8	CR-008	3 Door-Base	Hot Kitchen	5	6.4	7.2	5.8	
9	CR-009	3 Door-Base		5	6.4	7.2	5.8	
10	CR-010	3 Door-Base		5	6.4	7.2	5.8	
11	CR-011	3 Door-Base	Bar At Chaba	4	4.4	4.4	4.4	
12	CR-012	2 Door-Base	Restaurant	4	4.4	4.4	4.4	
13	CR-013	3 Door-Base	Pool Bar A	2	2.0	2.0	2.0	
14	CR-014	3 Door-Base	Pool Bar B	2	2.0	2.0	2.0	
15	CR-015	2 Door-Base	Pool Bar B	2	2.0	2.0	2.0	
16	ICE-001	Ice Machine	Kitchen	Normal	On	On	On	
17	ICE-002	Ice Machine	Pool Bar B	Normal	On	On	On	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter							
Item	Rate Code	Per Day	A 001'	B 002'	C 003'	A 005'	B 006'
Time		000'	09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come				
Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank		
Item	Generator Fuel Level	Generator Running Hour
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Equipment.	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.1	
		Fuel level	Min.300 Liters	340 L.	345 L	345	
		Total Engine Run Hrs.	HH:MM	11h 39m	11h 39m	11h 49m	
		Total number Of Starts	Number	57 (5)	59 (5)	57	
MDH	MDB Room	Voltage R-S-S-T-T-R.	Volt Meter	240/240/240	240/240/240	240/240/240	
		Amperage R/S/T	Amp Meter/ACB display	318.03	244.45	238.1	
		KWH	KWH Meter	906.7	909.0	910.3	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.	0.94	0.99	
		CAP Number Of Working	Number	34	34	5	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
EMDB		Voltage R-S-S-T-T-R.	Digital Meter	240/240/240	240/240/240	240/240/240	
		Amperage R/S/T	Digital Meter	318.03	244.45	238.1	
		KWH	Digital Meter	906.7	909.0	910.3	
Transfer pump A Water Treatment		A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40	40	40	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment		B-Transfer Pump Pressure	Discharge Pressure Gauge	28	28	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Off	Off	Off	
Deep Well Pump		Amperage	Amp Meter	120/120	-	-	
		Deep Well General Status	Normal	Normal	-	-	
Raw Water	Raw water tank	Level in Raw Tank	CM.	191	190	190	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Slow	Normal	Normal	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	59	58	56	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	220	220	222	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	52	50	52	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	218	215	220	

Equipment.	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	46	54	52	
		Pressure	IN/Out	54/46	34/46	34/46	
		Heat pump General Status	Normal	Normal	Normal		
		Heat tank 1 status	Normal	Off	Off		
		Heat tank 2 status	Normal	Normal	Normal		
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Flender Pressure PSI (High)	PSI	80	80	80	
		Low Pressure PSI (Low)	PSI	88	22	22	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal Lock	Normal Lock	Normal Lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1345.7	1346.6	1344.5	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	482.7	483.9	484.6	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
B3-SSP-Pump 1 Status		Normal	Normal	Normal	Normal		
B3-SSP-Pump 2 Status		Normal	Normal	Normal	Normal		
B3-SSP-General Status		Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				
Checked By / Record By							

Grand Kata VIP.

Engineer Department.

Cold Freezer Cabinet Check lists & Consumption Record



DATE:

3/5/99

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	3.2	4.2	3.2	
2	CR-002	Freezer 4 Door-Upright		-18	19.5	9.2	-19.1	
3	CR-003	Freezer 4 Door-Upright		-18	-15.5	-13.1	-18.0	
4	CR-004	4 Door-Upright	Cold Kitchen	2	4.0	3.2	3.0	
5	CR-005	3 Door-Base		5	2.5	2.0	2.0	
6	CR-006	Ice-Cream Cabinet		-20	-22	-25	-25	
7	CR-007	2 Door-Upright	Kitchen	2	10.0 (high)	9.7	9.0	
8	CR-008	3 Door-Base	Hot Kitchen	5	3.5	3.6	2.7	
9	CR-009	3 Door-Base		5	2.8	6.0	0.8	
10	CR-010	3 Door-Base	Bar At Chaba	4	4.0	5.2	2.8	
11	CR-011	3 Door-Base	Restaurant	4	1.8	6.2	0.2	
12	CR-012	2 Door-Base		4	0.7	0.7	0.7	
13	CR-013	3 Door-Base	Pool Bar A	2	2.9	2.8		
14	CR-014	3 Door-Base	Pool Bar B	2	3.6	3.0	2.6	
15	CR-015	2 Door-Base		2	1.1	2.2	2.2	
16	ICE-001	Ice Machine	Kitchen	Normal	0n	0n	0n	
17	ICE-002	Ice Machine	Pool Bar B	Normal	0n	0n	0n	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 003' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.

DATE:

10/5/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selecter switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.5 V	27.6	27.6	
		Fuel level	Min 300 Liters	340 L	340 L	340 L	
		Total Engine Run Hrs.	HH-MM	12h 14m	12h 14m	12h 14m	
		Total number Of Starts	Number	59 (5)	59 (5)	59 (5)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	399/399/400	400/400/400	400/400/400	
		Amprage R-S-T	Amp Meter/ACB display	267.06	266.37	188.32	
		KWH	KWH Meter	947.4	940.4	944.8	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.99	0.99	0.97	
EMDB	EMDB Room	CAP Number Of Working	Number	1	1	1	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digilat Meter	400/400/400	400/400/400	400/400/400	
		Amprage R-S-T	Digilat Meter	40/29/39	38/30/36	30/32/39	
		KWH	Digilat Meter	61935.4	62090.6	62176.0	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	79	40	78	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	28	28	26	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Off	Off	Off	
		Amprage	Amp Meter	-	-	-	
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal	-	-	-	
Raw Water	Raw water tank	Level in Raw Tank	CM.	192	190	190	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Slow	Normal	Normal	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	58	58	56	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	217	215	218	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	57	57	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	218	220	218	



DATE: 10/5/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	51	52	53	
		Pressure	IN/Out	35/47	36/46	34/44	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	Off	Off	Off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	90	70	50	
		Low Pressure PSI (Low)	PSI	22	22	22	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1395.5	1399.7	1400.5	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	502.1	503.2	504.1	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B2-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B2-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement Building B	IR-Pump Control Status	Auto/Off/Manual	Auto	Auto	Auto	
	Near Garbage Room	IR-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		IR- Discharge Pressure	Discharge Pressure Gauge	Auto	Auto	Auto	
		IR-General Status	Normal	Normal	Normal	Normal	

Checked By / Record By



Cold-Freezer Cabinet Check lists & Consumption Record

DATE: 10/5/68

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	3.9	4.5		
2	CR-002	Freezer 4 Door-Upright		-18	-13.7	-9.5		
3	CR-003	Freezer 4 Door-Upright		-18	-15.4	-7.1		
4	CR-004	4 Door-Upright	Cold Kitchen	2	5.6	5.1		
5	CR-005	3 Door-Base		5	4.1	2F		
6	CR-006	Ice-Cream Cabinet		-20	-24	-25		
7	CR-007	2 Door-Upright	Kitchen	2	4.2	3.3		
8	CR-008	3 Door-Base	Hot Kitchen	5	0.4	0.7		ส่วนประกอบ
9	CR-009	3 Door-Base		5	4.0	4.7		
10	CR-010	3 Door-Base		4	6.7	5.4		
11	CR-011	3 Door-Base	Bar At Chaba	4	5.4	5.6		
12	CR-012	2 Door-Base	Restaurant	4	0.4	0.7		
13	CR-013	3 Door-Base	Pool Bar A	2	2.3	2F		
14	CR-014	3 Door-Base	Pool Bar B	2	2.5	8.0		
15	CR-015	2 Door-Base		2	3.2	3.1		
16	ICE-001	Ice Machine	Kitchen	Normal	0.1	0.1		
17	ICE-002	Ice Machine	Pool Bar B	Normal	0.1	0.1		

Checked By / Recorded By

ELECTRICITY RECORD							
High Voltage 33KV PEA Meter							
Item Rate Code	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD				
Main Meter In Come				
Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD		
Fuel In Daytank		
Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment



DATE: 17/5/25

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.1	27.6	27.6	
		Fuel level	Min.300 Liters	340 L.	340 L.	340 L.	
		Total Engine Run Hrs.	HH:MM	12h 09m	12h 35m	12h 35m	
		Total number Of Starts	Number	60 (5)	62 (5)	62 (5)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	400/400/400	400/400/400	400/400/400	
		Ampereage R/S/T	Amp Meter/ACB display	205.47	239.39	219.30	
		KWH	KWH Meter	974.9	976.8	976.7	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.99	0.97	0.99	
EMDB	EMDB Room	CAP Number Of Working	Number	6	223	1	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digital Meter	407/401/400	406/406/400	401/401/404	
		Ampereage R/S/T	Digital Meter	20/19/19.9	32/32/35	21/24/22	
		KWH	Digital Meter	64273.7	64415.7	64514.9	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40	40	75	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	28	28	28	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Off	Off	Off	
		Ampereage	Amp Meter	150/100	-	-	
Deep Well Pump	Transfer Pump Room	Deep Well General Status	Normal	Normal	-	-	
		Level in Raw Tank	CM.	190	191	190	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Normal	Normal	Normal	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	59	59	59	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	219	219	220	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	50	52	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	218	220	222	



DATE: 17/5/25

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	50	50	51	
		Pressure	IN/Out	37/ 50	34/44	36/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Hander Pressure PSI (High)	PSI	60	60	50	
		Low Pressure PSI (Low)	PSI	90	92	92	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal Lock	Normal Lock	Normal Lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1448.9	1450.4	1454.1	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	589.5	592.6	592.21	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto		
	B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal		
	B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal		
	B3-SSP-General Status	Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B Near Garbage Room	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				
Checked By / Record By							

Grand Kata VIP.

Engineer Department.

Cold Freezer Cabinet Check lists & Consumption Record



8501

DATE:

17/5/25

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	5.9	5.9	2.3	
2	CR-002	Freezer 4 Door-Upright		-18	-15.8	-8.5	-17.0	
3	CR-003	Freezer 4 Door-Upright		-18	-17.4	-13.2	-15.6	
4	CR-004	4 Door-Upright	Cold Kitchen	2	10.2	11.7	10.9	
5	CR-005	3 Door-Base		5	3.0	3.3	3.4	
6	CR-006	Ice-Cream Cabinet		-20	-2.2	-2.4	-2.5	
7	CR-007	2 Door-Upright	Kitchen	2	2.7	2.8	3.0	
8	CR-008	3 Door-Base		5	7.2	6.6	12.5	2
9	CR-009	3 Door-Base		5	3.2	3.0	3.6	
10	CR-010	3 Door-Base	Bar At Chahat Restaurant	4	5.3	4.9	3.0	
11	CR-011	3 Door-Base		4	6.0	2.0	2.8	
12	CR-012	2 Door-Base		4	2.7	0.7	0.8	
13	CR-013	3 Door-Base	Pool Bar A	2	3.9	2.4		
14	CR-014	3 Door-Base		2	2.1	3.0	1.8	
15	CR-015	2 Door-Base		2	0.0	3.2	2.8	
16	ICE-001	Ice Machine	Kitchen	Normal	0.0	0.0	0.0	
17	ICE-002	Ice Machine	Pool Bar B	Normal	0.0	0.0	0.0	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter in Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.
Engineer Department.
Daily Check lists.

DATE:

24/5/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.5 V	27.6	27.6	
		Fuel Level	Min.300 Liters.	330 L	330 L	330 L	
		Total Engine Run Hrs.	HH:MM	13 h 6 m	13 h 6 m	13 h 6 m	
		Total number Of Starts	Number	64 (5)	62 (5)	62 (5)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	396/396/400	200/200/200	200/200/200	
		Ampereage R/S/T	Amp Meter/ACB display	240.88	231.73	206.53	
		KWH	KWH Meter	7008.2	1010.2	1011.6	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.99	0.96	0.99	
EMDB	EMDB Room	CAP Number Of Working	Number	5	3	7.9	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digilat Meter	400/399/401	201/201/201	200/200/200	
		Ampereage R/S/T	Digilat Meter	41/36/47	33/34/51	19/19/20	
		KWH	Digilat Meter	66576.6	66723.7	66876.1	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40	20	20	
		A-Filter Tank Status	Normal	NORM	Normal	Normal	
		A-Transfer Pump General Status	Normal	NORMAL	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	28	28	76	
		B-Filter Tank Status	Normal	NORMAL	Normal	Normal	
		B-Transfer Pump General Status	Normal	NORMAL	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Off	Manual	Off	Water Back March
		Ampereage	Amp Meter	-	9	-	
Raw Water	Raw water tank	Deep Well General Status	Normal	-	Normal	-	
		Level in Raw Tank	CM.	191	184	190	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Slow	Normal	Normal	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	46	58	56	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	214	215	220	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	55	57	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	215	214	220	



DATE: 94/5/68

Equipment.	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	51	51	51	
		Pressure	IN/Out	35/47	32/44	32/46	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	20	20	20	
		Low Pressure PSI (Low)	PSI	17	22	22	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (Trình độ)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
	Stored	A-WWT-Electric KWH	KWH Meter	1502.1	1505.0	1506.9	
		B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	541.1	542.0	543.0	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual	/	/	/	
		B2-SSP-Pump 1 Status	Normal	/	/	/	
		B2-SSP-Pump 2 Status	Normal	/	/	/	
	Basement B Parking Right Side (100Q)	B2-SSP-General Status	Normal	/	/	/	
		B3-SSP-Control Status	Auto/Off/Manual	Manual	Auto	Auto	24/01/7
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B3-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B3-SSP-General Status	Normal	Normal	Normal	Normal	
Irrigation Water Reuse	Basement	IR-Pump Control Status	Auto/Off/Manual	/	/	/	
	Building B	IR-Inverter Status	Auto/Off/Manual	/	/	/	
	Near Garbage Room	IR- Discharge Pressure	Discharge Pressure Gauge	/	/	/	
	Room	IR-General Status	Normal	/	/	/	
Checked By / Record By							



DATE: 94/5/68

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	2.0	2.4		
2	CR-002	Freezer 4 Door-Upright		-18	-11.5	-15.4		
3	CR-003	Freezer 4 Door-Upright		-18	-11.6	-16.3		
4	CR-004	4 Door-Upright	Cold Kitchen	2	8.5	6.0		
5	CR-005	3 Door-Base		5	2.7	3.2		
6	CR-006	Ice-Cream Cabinet		-20	-2.7	-2.7		
7	CR-007	2 Door-Upright	Kitchen	2	4.9	3.0		
8	CR-008	3 Door-Base	Hot Kitchen	5	6.0	4.3		
9	CR-009	3 Door-Base		5	df	2.5		
10	CR-010	3 Door-Base		4	5.4	1.1		
11	CR-011	3 Door-Base	Bar At Chaba	4	6.7	0.5		
12	CR-012	2 Door-Base	Restaurant	4	off	off		
13	CR-013	3 Door-Base	Pool Bar A	2	3.1	3.2		
14	CR-014	3 Door-Base	Pool Bar B	2	3.4	3.0		
15	CR-015	2 Door-Base		2	df	2.1		
16	ICE-001	Ice Machine	Kitchen	Normal	on	on		
17	ICE-002	Ice Machine	Pool Bar B	Normal	on	on		
Checked By / Recorded By								

ELETRICITY RECORD

High Voltage 33KV PEA Meter

Item	Rate Code	Per Day	A 001'	B 002'	C 003'	A 005'	B 006'	C 007'
Time	000'	09:00-22:00	22:00-09:00	00:00-24:00	09:00-22:00	22:00-09:00	00:00-24:00	
Today								
Yesterday								
Total								

WATER RECORD

Main Meter In Come

Item	FWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours.
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment



DATE: 4-6-68

Equipment.	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6V	27.6	27.6V	
		Fuel level	Min 300 Liters	330L	330L	330L	
		Total Engine Run Hrs.	HH:MM	13h 36m	13h 36m	13h 36m	
		Total number Of Starts	Number	66(57)	66 S	66 (9)	
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	400/400/400	400/400/400	400/400/400	
		Ampereage R/S/T	Amp Meter/ ACB display	234.53A	334.29	213.23	
		KWH	KWH Meter	1060.9	1063.2	1064.5	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.96	0.97	0.99	
EMDB	EMDB Room	CAP Number Of Working	Number	1, 3	2, 5	4	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R-S-S-T-T-R	Digital Meter	401/401/403	400/403/405	401/404/409	
		Ampereage R/S/T	Digital Meter	74/26/40	49/37/33	19/30/23	
		KWH	Digital Meter	70252.4	70212.3	70504.9	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	40 Psi	40	78	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	28 Psi	76	88	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	off	Manual	off	12/10/11
		Ampereage	Amp Meter	-	7	-	
Deep Well Pump	Transfer Pump Room	Deep Well General Status	Normal	-	-	-	
Raw Water	Raw water tank	Level in Raw Tank	CM.	191 CM	190 CM	191	
		PWA Valve	Open/Close	Open	Open	Open	
		PWA	Normal/Slow/Not Flow	Slow	Normal	Normal	
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	58 Psi	58	56	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
		A-Level in Cold Tank	CM.	213 CM	215	218	
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Normal	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Normal	
		B- Discharge Pressure	Discharge Pressure Gauge	50 Psi	52	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
		B-Level in Cold Tank	CM	220 CM	218	220	



DATE: 4/6/89

Equipment.	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55/54	51	59	
		Pressure	IN/Out	35/47	34/44	36/48	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	50 Psi	70	20	
		Low Pressure PSI (Low)	PSI	22 Psi	22	22	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal Lock	Normal Lock	Normal Lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1585.2	1588.4	1590.6	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	572.0	573.3	574.1	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		B1-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
		B2-SSP-General Status	Normal				
	Basement B Parking Right Side (100Q)	B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
B3-SSP-Pump 1 Status		Normal	Normal	Normal	Normal		
B3-SSP-Pump 2 Status		Normal	Normal	Normal	Normal		
B3-SSP-General Status		Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B	IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
	Near Garbage Room	IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				
Checked By / Record By							

Grand Kata VIP.

Engineer Department.

Cold/Freezer Cabinet Check lists & Consumption Record



DATE

2/6/89

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	5.2	11.1	2.4	
2	CR-002	Freezer 4 Door-Upright		-18	-16.3	-16.3	-16.0	
3	CR-003	Freezer 4 Door-Upright		-18	-17.2	-16.3	-15.4	
4	CR-004	4 Door-Upright	Cold Kitchen	2	2.1	6.2	4.2	
5	CR-005	3 Door-Base		5	2.6	1.9	2.2	
6	CR-006	Ice-Cream Cabinet		-20	-2.1	-2.6	-2.4	
7	CR-007	2 Door-Upright	Kitchen	2	3.1	2.4	2.4	
8	CR-008	3 Door-Base	Hot Kitchen	5	5.3	5.6	5.9	
9	CR-009	3 Door-Base		5	4.1	2.1	3.1	
10	CR-010	3 Door-Base	Bar Al Chaba	4	6.1	5.9	5.9	
11	CR-011	3 Door-Base	Restaurant	4	4.8	4.9	4.9	
12	CR-012	2 Door-Base		4	4.2	off	off	
13	CR-013	3 Door-Base	Pool Bar A	2	3.4	3.2		
14	CR-014	3 Door-Base	Pool Bar B	2	4.0	3.5	3.2	
15	CR-015	2 Door-Base		2	4.1	3.2	2.7	
16	ICE-001	Ice Machine	Kitchen	Normal	on	on	on	
17	ICE-002	Ice Machine	Pool Bar B	Normal	on	on	on	

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item Rate Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-04:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-04:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

Grand Kata VIP.

Engineer Department.

Daily Check lists:



DATE: 11/06/95

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto	
		Batteries Voltage	Over 24.5 Volts	27.6	27.6	27.6	
		Fuel level	Min.300 Liters	390L	390L	390L	
		Total Engine Run Hrs.	HH:MM	14h 2m	14h 2m	14h 2m	
		Total number Of Starts	Number	69 (5)	69 (5)		
MDB	MDB Room	Voltage R/S/S-T/T-R	Volt Meter	100/100/100	100/100/100	100/100/100	
		Amperage R/S/T	Amp Meter/ACB display	258.54	284.66	162.96	
		KWH	KWH Meter	1094.7	1096.7	1099.1	
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto	
		Power Factor (PF)	0.85-1.00	0.94	0.94	0.95	
EMDB	EMDB Room	CAP Number Of Working	Number	3.9	8	7	
		A.T.S. Selector Status	Auto/Off/Manual	Auto	Auto	Auto	
		Voltage R/S/S-T/T-R	Digital Meter	100/100/100	100/100/100	100/100/100	
		Amperage R/S/T	Digital Meter	41/53/10	37/37/12	14/25/26	
		KWH	Digital Meter	796.9	7274.1	72839.4	
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Transfer Pump Pressure	Discharge Pressure Gauge	10	10	10	
		A-Filter Tank Status	Normal	Normal	Normal	Normal	
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Transfer pump B Water Treatment	Transfer Pump Room	B-Transfer Pump Pressure	Discharge Pressure Gauge	10	10	10	
		B-Filter Tank Status	Normal	Normal	Normal	Normal	
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal	
		Deep well control Status	Auto/Off/Manual	Off	Off	Off	
		Amperage	Amp Meter	16/100	-	-	
Deep Well Pump	Deep Well Pump	Deep Well General Status	Normal	Normal	-	-	
		Level in Raw Tank	CM.	190	190	190	
		PWA Valve	Open/Close	Open	Open	Open	
Raw Water	Raw water tank	PWA	Normal/Slow/Not Flow	Normal	Normal	Normal	
	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		A- Discharge Pressure	Discharge Pressure Gauge	56	58	56	
		A-Booster Pump General Status	Normal	Normal	Normal	Normal	
Booster pump Building A	Roof Top Building A	A-Level in Cold Tank	CM.	215	215	218	
	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto	
		B- Discharge Pressure	Discharge Pressure Gauge	56	52	50	
		B-Booster Pump General Status	Normal	Normal	Normal	Normal	
Booster pump Building B	Roof Top Building B	B-Level in Cold Tank	CM	217	220	216	

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55	52	54	
		Pressure	IN/Out	39/ 48	34 / 46	36 / 42	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	Off	Off	Off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	5	15	10	
		Low Pressure PSI (Low)	PSI	19	22	26	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (โซ่คล้อง)	Normal Lock	Normal Lock	Normal Lock	Normal Lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1633.1	1641.1	1648.2	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
	Basement B Parking Right Side (100Q)	B2-SSP-General Status	Normal				
		B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B3-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
B3-SSP-Pump 2 Status		Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B Near Garbage Room	B3-SSP-General Status	Normal	Normal	Normal	Normal	
		IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
		IR-General Status	Normal				
Checked By / Record By							

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	22	3.8		
2	CR-002	Freezer 4 Door-Upright		-18	-16.7	-16.8		
3	CR-003	Freezer 4 Door-Upright		-18	-17.7	-18.2		
4	CR-004	4 Door-Upright	Cold Kitchen	2	4.1	8.2		
5	CR-005	3 Door-Base		5	2.9	8.0		
6	CR-006	Ice-Cream Cabinet		-20	Not Running	-25		
7	CR-007	2 Door-Upright	Kitchen	2	9.6	9.4		
8	CR-008	3 Door-Base		5	5.3	5.4		
9	CR-009	3 Door-Base		5	2.6	9.6		
10	CR-010	3 Door-Base	Bar At Chaba	4	6.9	8.9		
11	CR-011	3 Door-Base	Restaurant	4	5.1	5.4		
12	CR-012	2 Door-Base		4	0.3	0.4		
13	CR-013	3 Door-Base	Pool Bar A	2	4.0	9.2		
14	CR-014	3 Door-Base	Pool Bar B	2	6.1	8.4		
15	CR-015	2 Door-Base		2	5.1	5.1		
16	ICE-001	Ice Machine	Kitchen	Normal	On	On		
17	ICE-002	Ice Machine	Pool Bar B	Normal	On	On		
Checked By / Recorded By								

ELECTRICITY RECORD							
High Voltage 33KV PEA Meter							
Item Rate Code Time	Per Day 000'	A 001' 09:00-12:00	B 002' 12:00-09:00	C 003' 00:00-24:00	A 005' 09:00-12:00	B 006' 12:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD				
Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD		
Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment



DATE: 18/6/68

Equipment	Location	Description	Standrand	Time			Remark	
				09:00	17:00	01:00		
Generator	Generator Room	Selector switch status	Auto/Manual	Auto	Auto	Auto		
		Batteries Voltage	Over 24.5 Volts	27.6V	27.6 V	27.6 V		
		Fuel level	Min.300 Liters	320L	320L.	320 L		
		Total Engine Run Hrs.	HH:MM	14h 17m	14 h 17m	14 h 17m		
		Total number Of Starts	Number	69 (S)	69 (S)	69 (S)		
MDB	MDB Room	Voltage R-S-S-T-T-R	Volt Meter	400/400/400	400/400/400	400/400/400		
		Ampreage R/S/T	Amp Meter/ACB display	287.29A	250.66	196.10		
		KWH	KWH Meter	1128.9	1181.3	1182.7		
		CAP. Bank Selector Switch	Auto/Off/Manual	Auto	Auto	Auto		
		Power Factor (PF)	0.85-1.00	0.96	0.95	0.98		
	CAP Number Of Working	Number	3,4	1,2	6			
	A.T.S. Selector Switch	Auto/Off/Manual	Auto	Auto	Auto			
	EMDB	Voltage R-S-S-T-T-R	Digital Meter	403/403/403	403/403/403	403/403/403		
		Amperage R/S/T	Digital Meter	39/39/40	35/30/40	32/20/45		
KWH		Digital Meter	14989.9	75161.0	75252.0			
Transfer pump A Water Treatment	Transfer Pump Room	A-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto		
		A-Transfer Pump Pressure	Discharge Pressure Gauge	30 Psi	40	40		
		A-Filter Tank Satus	Normal	Normal	Normal	Normal		
		A-Transfer Pump General Status	Normal	Normal	Normal	Normal		
		B-Transfer Pump Status	Auto/Off/Manual	Auto	Auto	Auto		
		B-Transfer Pump Pressure	Discharge Pressure Gauge	28 Psi	28	28		
		B-Filter Tank Satus	Normal	Normal	Normal	Normal		
		B-Transfer Pump General Status	Normal	Normal	Normal	Normal		
		Deep Well Pump	Deep well control Status	Auto/Off/Manual	off	Normal	off	
			Amperage	Amp Meter	-	6.5	-	
Deep Well General Status	Normal		-	Normal	-			
Raw Water	Raw water tank	Level in Raw Tank	CM.	190 CM	190	191		
		PWA Valve	Open/Close	Open	Open	Open		
		PWA	Normal/Slow/Not Flow	Normal	Normal	Normal		
Booster pump Building A	Roof Top Building A	A-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto		
		A-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto		
		A- Discharge Pressure	Discharge Pressure Gauge	217 Psi	258	256		
		A-Booster Pump General Status	Normal	Normal	Normal	Normal		
		A-Level in Cold Tank	CM.	55 CM	215	218		
Booster pump Building B	Roof Top Building B	B-Booster Pump Status	Auto/Off/Manual	Auto	Auto	Auto		
		B-Inverter Status	Auto/Off/Manual	Auto	Auto	Auto		
		B- Discharge Pressure	Discharge Pressure Gauge	50 Psi	50	50		
		B-Booster Pump General Status	Normal	Normal	Normal	Normal		
		B-Level in Cold Tank	CM	220 CM	218	220		



DATE: 18/6/68

Equipment	Location	Description	Standrand	Time			Remark
				09:00	17:00	01:00	
Hot Water System	Back Side Kitchen	Temperature	55 °C	55 / 52	54	52	
		Pressure	IN/Out	32 / 47	32 / 46	36 / 48	
		Heat pump General Status	Normal	Normal	Normal	Normal	
		Heat tank 1 status	Normal	off	off	off	
		Heat tank 2 status	Normal	Normal	Normal	Normal	
Gas System	Gas Station Back Side Kitchen	General Status	Normal	Normal	Normal	Normal	
		Honder Pressure PSI (High)	PSI	50 PSI	60	20	
		Low Pressure PSI (Low)	PSI	21 PSI	22	22	
		Emergency Shut Off Valve	Normal	Normal	Normal	Normal	
		Chains Lock (14400451)	Normal Lock	Normal lock	Normal lock	Normal lock	
		Gas Leak Detector	Normal	Normal	Normal	Normal	
Waste Water Treatment	House Keeping Stored	A-WWT-General Status	Normal	Normal	Normal	Normal	
		A-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-WWT-Electric KWH	KWH Meter	1699.9	1694.4	1696.5	
	Parking Building B	B-WWT-General Status	Normal	Normal	Normal	Normal	
		B-WWT-Ejector Pump	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Air Pump Status	Auto/Off/Manual	Auto	Auto	Auto	
		B-WWT-Electric KWH	KWH Meter	617.5	612.7	613.0	
Submersible Pump	Basement A Near Canteen	A-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		A-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		A-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
		A-SSP-General Status	Normal	Normal	Normal	Normal	
	Basement B Parking Motorcycle	B1-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
		B1-SSP-Pump 1 Status	Normal	Normal	Normal	Normal	
		B1-SSP-Pump 2 Status	Normal	Normal	Normal	Normal	
	Basement B Parking Left Side (3.7KW)	B1-SSP-General Status	Normal	Normal	Normal	Normal	
		B2-SSP-Control Status	Auto/Off/Manual				
		B2-SSP-Pump 1 Status	Normal				
		B2-SSP-Pump 2 Status	Normal				
	Basement B Parking Right Side (100Q)	B2-SSP-General Status	Normal				
		B3-SSP-Control Status	Auto/Off/Manual	Auto	Auto	Auto	
B3-SSP-Pump 1 Status		Normal	Normal	Normal	Normal		
B3-SSP-Pump 2 Status		Normal	Normal	Normal	Normal		
Irrigation Water Reuse	Basement Building B Near Garbage Room	B3-SSP-General Status	Normal	Normal	Normal	Normal	
		IR-Pump Control Status	Auto/Off/Manual				
		IR-Inverter Status	Auto/Off/Manual				
		IR- Discharge Pressure	Discharge Pressure Gauge				
	Room	IR-General Status	Normal				
Checked By / Record By							

Grand Kaia VIP.

Engineer Department.

Cold Freezer Cabinet Check lists & Consumption Record



DATE: 18/6/68

NO.	Code ID	Name/Type	Location	Temp. Setting °C	Time			Remark
					09:00	17:00	01:00	
1	CR-001	Chiller Room	Prepare Room	2	7.9	6.4		
2	CR-002	Freezer 4 Door-Upright		-18	-13.7	-15.2		
3	CR-003	Freezer 4 Door-Upright		-18	-16.2	-14.6		
4	CR-004	4 Door-Upright	Cold Kitchen	2	5.7	6.0		
5	CR-005	3 Door-Base		5	4.0	2.2		
6	CR-006	Ice-Cream Cabinet		-20	-2.6	-2.0		
7	CR-007	2 Door-Upright	Kitchen	2	3.5	2.3		
8	CR-008	3 Door-Base	Hot Kitchen	5	6.0	5.1		
9	CR-009	3 Door-Base		5	4.0	3.6		
10	CR-010	3 Door-Base	Bar Al Chaba	4	4.3	6.2		
11	CR-011	3 Door-Base	Restaurant	4	6.2	2.1		
12	CR-012	2 Door-Base		4	0.1	0.1		
13	CR-013	3 Door-Base	Pool Bar A	2	2.6	2.4		
14	CR-014	3 Door-Base	Pool Bar B	2	3.4	3.4		
15	CR-015	2 Door-Base		2	2.4	3.0		
16	ICE-001	Ice Machine	Kitchen	Normal	on	on		
17	ICE-002	Ice Machine	Pool Bar B	Normal	on	on		

Checked By / Recorded By

ELECTRICITY RECORD

High Voltage 33KV PEA Meter

Item Date Code Time	Per Day 000'	A 001' 09:00-22:00	B 002' 22:00-09:00	C 003' 00:00-24:00	A 005' 09:00-22:00	B 006' 22:00-09:00	C 007' 00:00-24:00
Today							
Yesterday							
Total							

WATER RECORD

Main Meter In Come

Item	PWA	Deep Well	Water Truck	Total
Today				
Yesterday				
Total				

FUEL RECORD

Fuel In Daytank

Item	Generator Fuel Level	Generator Running Hours
Today		
Yesterday		
Total		

Recorded By

Acknowledged By

Other Comment

ภาคผนวก ข-9

ระบบป้องกันและแจ้งเตือนอัคคีภัย

และเอกสารการตรวจสอบอุปกรณ์ป้องกันและเตือนอัคคีภัย

คำนำ

รายงานตรวจเช็คระบบ FIRE ALARM

(แบบสุ่มทดสอบ) : ครั้งที่ 2/2567

บริษัท แกรนด์ กะตะ วิไอพี จำกัด

58/147 หมู่ที่ 6 ต.ราไวย์ อ.เมือง จ.ภูเก็ต 83130

เบอร์โทร : 076-510-993

ตรวจเช็คโดย

บริษัท เอส.ที.เอส.ซิสเต็ม แอนด์ เอ็นจิเนียริง จำกัด

997 ถ.ศรีนคร ต.ตลาดเหนือ อ.เมืองภูเก็ต จ.ภูเก็ต 83000

เบอร์โทร : 076-364-131 | อีเมล : stssystemphuket@gmail.com

อัคคีภัยก่อให้เกิดความสูญเสียทั้งชีวิตและทรัพย์สิน สาเหตุส่วนใหญ่มาจากขณะที่เริ่มเกิดเหตุเพลิงไหม้ จะไม่มีคนอยู่ในบริเวณที่เกิดเหตุ หรือเกิดในบริเวณที่ไม่มีคนเห็น หรือจุดดับสายตา ซึ่งกว่าจะรู้ตัวเพลิงก็ลุกลาม จนเกินกำลังที่จะแก้ไขได้ทันเหตุการณ์ ดังนั้นจึงจำเป็นต้องมีระบบสัญญาณเตือนอัคคีภัยติดตั้งไว้ภายในตัวอาคารเพื่อให้สามารถรับรู้เหตุการณ์ รวมถึงอุปกรณ์ช่วยในการดับเพลิงขนาดเล็ก อาทิ ถังดับเพลิงทั่วไป หรือถังดับเพลิงสารเคมีเฉพาะ อยู่ภายในอาคารจะทำการสกัดการลุกลามของไฟได้ล่วงหน้าก่อนที่ไฟจะลุกลามจนควบคุมไม่ได้

รายงานฉบับนี้จัดทำขึ้นเพื่อประกอบการตรวจเช็คและทดสอบระบบสัญญาณเตือนแจ้งเหตุเพลิงไหม้ (Fire Alarm System)

ขอบเขตการตรวจเช็คและทดสอบโดยได้ปฏิบัติงานตรวจสอบอุปกรณ์ประกอบระบบแจ้งเหตุเพลิงไหม้ ทั้งหมด อาทิเช่น อุปกรณ์ตรวจจับควัน (Smoke Detector) , อุปกรณ์ตรวจจับความร้อน (Heat Detector) , อุปกรณ์แจ้งเหตุด้วยมือ (Manual Station) , อุปกรณ์แสดงพื้นที่เกิดเหตุ (ANN.) และตู้ Fire Alarm Control Panel (FCP) นั้นอยู่ในสถานะพร้อมใช้งานหรือไม่ และนำเสนอผลการตรวจสอบเป็นรายงานต่อผู้ควบคุมงาน

บริษัท เอส.ที.เอส.ซิสเต็ม แอนด์ เอ็นจิเนียริง จำกัด

คณะผู้จัดทำ

ระบบสัญญาณเตือนอัคคีภัย (Fire Alarm System)

อัคคีภัยก่อให้เกิดความสูญเสียทั้งชีวิตและทรัพย์สิน สาเหตุส่วนใหญ่มาจากขณะที่เริ่มเกิดเพลิงไหม้จะไม่มีใครอยู่หรือเกิดในบริเวณที่ไม่มีคนเห็น กว่าจะรู้ตัวเพลิงก็ลุกลามจนเกินกำลังที่คนไม่กี่คนหรืออุปกรณ์ดับเพลิงขนาดเล็กที่มีอยู่ภายในอาคารจะทำการสกัดไฟได้ ดังนั้นจึงจำเป็นต้องมีระบบสัญญาณเตือนอัคคีภัยติดตั้งไว้ในอาคาร เพื่อให้สามารถรับรู้เหตุการณ์ล่วงหน้าก่อนที่ไฟจะลุกลามจนควบคุมไม่ได้

ส่วนประกอบของระบบสัญญาณเตือนอัคคีภัย


1. แผงควบคุม (Fire Alarm Control Panel)

เป็นส่วนควบคุมและตรวจสอบการทำงานของอุปกรณ์และส่วนต่างๆในระบบทั้งหมด จะประกอบด้วย วงจรควบคุมและรับสัญญาณจากอุปกรณ์เริ่มสัญญาณ , วงจรทดสอบการทำงาน , วงจรป้องกันระบบ , วงจรสัญญาณแจ้งการทำงานในสภาวะปกติและภาวะขัดข้อง เช่น สายไฟจากอุปกรณ์ตรวจจับขาด , แบตเตอรี่ต่ำ หรือไฟจ่ายตู้แผงควบคุมโดนตัดขาด เป็นต้น ตู้แผงควบคุม (FCP) จะมีสัญญาณไฟและเสียงแสดงสภาวะต่างๆบนหน้าตู้



2. ตู้แผงภาพโชว์จุดเกิดเหตุ (Graphic Annunciator)

หลังจากอุปกรณ์เริ่มสัญญาณทำงานโดยส่งสัญญาณมายังตู้ควบคุม (FCP) แล้ว FCP จะส่งสัญญาณมาที่ภาพกราฟฟิกเพื่อให้เราทราบตำแหน่งของอุปกรณ์

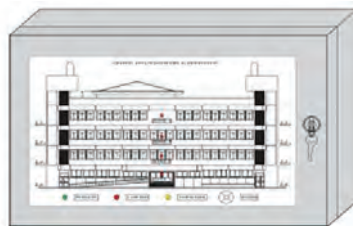

- ดิโวลท์ LAMP TEST สำหรับทดสอบภาพ
- ดิโวลท์ STOP BUZZER สำหรับปิดเสียง ดิโวลท์
- LED สำหรับแจ้งเตือน
- LAMP POWER ON แสดงการทำงานระบบปกติ
- BUZZER ดิโวลท์

3. อุปกรณ์ตรวจจับควันชนิดโฟโตอิเล็กตริก (Photoelectric Smoke Detector)

เหมาะสำหรับใช้ตรวจจับสัญญาณควันในระยะที่มีอนุภาคของควันที่ใหญ่ขึ้น Photoelectric Smoke Detector ทำงานโดยใช้หลักการสะท้อนของแสง เมื่อมีควันเข้ามาในตัวตรวจจับควันจะไปกระทบกับแสงที่ออกมาจาก Photoemitter ซึ่งไม่ได้ส่งตรงไปยังอุปกรณ์รับแสง Photo receptor แต่แสงดังกล่าวบางส่วนจะสะท้อนอนุภาคควันและหักเหเข้าไปที่ Photo receptor ทำให้วงจรตรวจจับของตัวตรวจจับควันส่งสัญญาณแจ้ง Alarm



4. อุปกรณ์ตรวจจับความร้อนชนิดจับอัตราการเพิ่มของอุณหภูมิ (Rate-of-Rise Heat Detector)

อุปกรณ์ชนิดนี้จะทำงานเมื่อมีอัตราการเพิ่มของอุณหภูมิเปลี่ยนแปลงไปตั้งแต่ 10 องศาเซลเซียส ใน 1 นาที ส่วนลักษณะการทำงาน อากาศในส่วนด้านบนของส่วนรับความร้อนเมื่อถูกความร้อน จะขยายตัวอย่างรวดเร็วมาจากอากาศที่ขยายไม่สามารถเล็ดลอดออกมาในช่องระบายได้ ทำให้เกิดความดันสูงมากขึ้นและไปดันแผ่นไดอะแฟรมให้ขาดจนแตกแตกกัน ทำให้อุปกรณ์ตรวจจับความร้อนนี้ส่งสัญญาณไปยังตู้ควบคุม

5. อุปกรณ์แจ้งเหตุด้วยมือ (Manual Station)

สถานีแจ้งสัญญาณเตือนอัคคีภัยแบบใช้มือกด (Manual Push Station) เริ่มทำงานโดยอาศัยการกระตุ้นจากบุคคล โดยการดึงหรือทุบกระจกให้แตก อุปกรณ์แจ้งเหตุด้วยมือปกติจะมีเครื่องหมายแสดงไว้ให้มองเห็นและเข้าใจง่าย การปรับตั้งค่าใหม่หลังจากใช้งานแล้วจะทำได้โดยการไขกุญแจหรือเปลี่ยนกระดกใหม่



6. อุปกรณ์แจ้งสัญญาณด้วยเสียง (Audible Alarm Devices)

หลังจากอุปกรณ์เริ่มสัญญาณทำงาน โดยส่งสัญญาณมายังตู้ควบคุม (FCP) แล้ว ตู้ FCP จึงส่งสัญญาณออกมา โดยผ่านอุปกรณ์กระดิ่งเพื่อให้ผู้อยู่อาศัย , ผู้รับผิดชอบ หรือเจ้าหน้าที่ดับเพลิงได้ทราบว่ามีเหตุเพลิงไหม้เกิดขึ้น



บริษัท เอส ที เอส ซิสเต็ม แอนด์ เอ็นจิเนียริง จำกัด (สาขาสถานใหญ่)
 เลขที่ ๑๓๓/๑๖๖ หมู่ ๑๖ ต.บ้านใหม่ อ.บ้านใหม่ จ.ชลบุรี
 โทร : ๐๘๔-๖๖๖-๔๖๖๖๑ | อีเมล : sales@sts-engineering.com
 เลขประจำตัวผู้เสียภาษี : ๐๙๖๐๙๖๖๐๒๐๑

Project : บจก.แกรนด์ กะตะ วิลโลฟ

System : Fire Alarm System : WILL-FF-516

Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.

Date : 20-21 March 2025

Preventive Maintenance

Check List Report

ครั้งที่ 2

1. ตู้ Fire Alarm Control Panel (FCP)

1.1 Fire Alarm Control Panel (FCP : BUILDING A&B)

Brand FCP : WILL Model FCP : FF-516

System : ☒ Conventional Zone 16 Zone
☐ Semi-Multiplexer Loop

1.2 สถานะตู้ FCP ขณะถึงหน้างาน

ตู้ FCP ☒ เปิดระบบ
 ตู้ FCP ☐ ปิดระบบ สาเหตุที่ปิด : _____
 แจ้ง Alarm ☒ ไม่มี Alarm จำนวน : _____
 แจ้ง Alarm ☐ มี Alarm จำนวน : _____
 ตู้ FCP ☒ ไม่มี Fault
 แจ้ง Trouble ☐ มี Fault จำนวน : _____

1.3 การทำงานของ Fire Alarm Control Panel (FCP)

No.	Check the current condition of the cabinet.	Inspection Results / ผลการตรวจเช็ค		Remark
ลำดับ	ตรวจสอบสภาพตู้ปัจจุบัน	OK	NOT	หมายเหตุ
1	ตรวจสอบฟังก์ชันการทำงานตู้			
	- สวิตช์ปิดเสียงตู้	✓		
	- สวิตช์ปิดเสียงกระดิ่ง	✓		
	- หลอดแสดงผล Alarm	✓		
	- หลอดแสดงผล Trouble	✓		
	- เสียง Buzzer ของตู้ FCP	✓		
2	ตรวจสอบ Charger Battery & Battery			
	- ตรวจสอบสภาพ Battery	✓		
	- แรงดัน : Charger 24.00 Vdc.	✓		
	- แรงดัน : Battery 24.00 Vdc.	✓		
	- ตรวจสอบขณะดับไฟ Main 220 Vac.	✓		
3	การทำงานของอุปกรณ์แจ้งเหตุเพลิงไหม้			
	- อุปกรณ์หน่วงเวลาก่อนแจ้งเหตุ (Timer)			
	- ระบบแจ้งเหตุเฉพาะโซนที่เกิดเหตุ (Ring By Zone)			ไม่รองรับ
	- ระบบแจ้งเหตุระหว่างชั้นและชั้นที่เกิดเหตุ (Sandwiches)			ไม่รองรับ
	- ระบบแจ้งเหตุพร้อมกันทุกโซนที่มี (General Alarm)	✓		
4	รายการตรวจเช็คอื่นๆ (โปรดระบุ)			
	- ทำความสะอาดตู้ FCP	✓		
	- Terminal และจุดเชื่อมต่อต่างๆ			
5	Zone Detector & Bell			
	- ตรวจสอบจำนวน Zone Detector : 16 Zone	✓		
	- ตรวจสอบจำนวน Zone Bell : 16 Zone	✓		
6	การทำงานของ Power Supply			
	- แรงดัน : Charger 24.00 Vdc.	✓		
	- แรงดัน : Battery 24.00 Vdc.	✓		
7	รายการตรวจเช็คอื่นๆ (โปรดระบุ)			

Project : บจก.แกรนด์ กระตะ วิโอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell						
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ เสีย	Remark หมายเหตุ
Building A - Ground						
	ห้อง Server	Smoke	✓			
	Lobby	Smoke				
	เคาเตอร์ Lobby	Smoke	✓			
	ออฟฟิศหัวหน้า	Smoke	✓			
	ห้องเก็บของออฟฟิศ 1	Smoke				
	ออฟฟิศ FO	Smoke		✗		ไม่ Alarm
	หน้าลิฟท์ - FL.1	Smoke	✓			
	ST01 - FL.1 / ST02	Smoke	✓			
	หน้าลิฟท์ - FL.2	Smoke				
	หน้าลิฟท์	Manual				
	หน้าห้อง 1211	Smoke				
	ห้องครัว	Smoke	✓			
	หน้าห้องน้ำหลัง Lobby	Smoke	✓			
Building A - Floor 2						
1201	ห้องนั่งเล่น	Smoke	✓		✓	
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
	Living	Smoke	✓		✓	
1202	ห้องนอนใหญ่	Smoke	✓		✓	
	ห้องนอนเตียงคู่	Smoke				
	ห้องครัว	Smoke	✓		✓	
1203	Living	Smoke	✓		✓	
	ห้องนอนใหญ่	Smoke	✓		✓	
	ห้องครัว	Smoke	✓		✓	
1204	ห้องนอนใหญ่	Smoke	✓		✓	Alarm แต่ไฟ LED ไม่ติด
	ห้องครัว	Smoke	✓		✓	Alarm แต่ไฟ LED ไม่ติด
1205	ห้องนอนใหญ่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
	ห้องครัว	Smoke				
1206	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
1207	ห้องนอนใหญ่	Smoke	✓		✓	
	ห้องครัว	Smoke	✓		✓	
1208	ห้องนอนใหญ่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
1209	ห้องครัว	Smoke				
	ห้องนอนใหญ่	Smoke	✓		✓	
	ห้องครัว	Smoke	✓		✓	

Project : บจก.แกรนด์ กระตะ วิโอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell						
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ เสีย	Remark หมายเหตุ
Building A - Floor 2 (ต่อ)						
1210	ห้องนอนใหญ่	Smoke	✓		✓	
	ห้องครัว	Smoke	✓		✓	
1211	ห้องนอนใหญ่	Smoke	✓			
	ห้องนอนเตียงคู่	Smoke		✗		Smoke อาจจะเสียหรือสายมีปัญหา
	ห้องครัว	Smoke	✓			
1212	ห้องนั่งเล่น	Smoke				
	ห้องนอนเตียงคู่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
1213	ห้องนอนเตียงคู่	Smoke				
	ห้องครัว	Smoke				
	บันไดหนีไฟ - FL.2	Smoke	✓			
1214	ST01 - FL.2	Smoke	✓			
	หน้า ST2	Manual	✓			
1215	ทางเดิน 1204	Smoke	✓			
Building A - Floor 3						
1301	ห้องนอนใหญ่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
1302	ห้องครัว	Smoke				
	ห้องนอนใหญ่	Smoke				
1303	ห้องนอนใหญ่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
1304	ห้องครัว	Smoke				
	ห้องนอนใหญ่	Smoke				
1305	ห้องนอนเตียงคู่	Smoke				
	ห้องครัว	Smoke				
1306	ห้องนอนใหญ่	Smoke				
	ห้องนอนเตียงคู่	Smoke				
1307	ห้องครัว	Smoke				
	ห้องนอนใหญ่	Smoke				
1308	ห้องนอนเตียงคู่	Smoke				
	ห้องครัว	Smoke				
1309	ห้องนอนใหญ่	Smoke				
	ห้องนอน	Smoke				

Project : บจก.แกรนด์ กระตะ วิโอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell							
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	เสีย	Remark หมายเหตุ
Building A - Floor 3 (ต่อ)							
1309	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1310	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1311	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1312	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องครัว	Smoke	✓		✓		
1313	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องครัว	Smoke	✓		✓		
1314	ห้องครัว	Smoke					
	ห้องนอน	Smoke					
1315	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1316	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1317	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1318	ห้องนอนใหญ่	Smoke	✓		✗		Alarm แต่ไฟ LED ไม่ติด
	ห้องนอนเล็ก	Smoke	✓		✗		Alarm แต่ไฟ LED ไม่ติด
	ห้องครัว	Smoke	✓		✗		Alarm แต่ไฟ LED ไม่ติด
	ห้องนั่งเล่น	Smoke	✓		✓		
1319	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✗		Alarm แต่ไฟ LED ไม่ติด
	ห้องครัว	Smoke	✓		✓		
	หน้าลิฟท์ - Fl.3	Smoke					
	หน้าลิฟท์ - Fl.3	Manual					
	ทางเดินหน้าห้อง 1308	Smoke	✓				
	ทางเดินหน้าห้อง 1309	Smoke					
	ทางเดินหน้าห้อง 1313	Smoke					
	ST02 - Fl.3	Smoke					
	บันไดหนีไฟ - Fl.3	Smoke	✓				

Project : บจก.แกรนด์ กระตะ วิโอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell							
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	เสีย	Remark หมายเหตุ
Building A - Floor 3 (ต่อ)							
	หน้าห้อง 1317	Smoke					
	หน้าห้อง 1319	Smoke	✓				
Building A - Floor 4							
1401	ห้องนั่งเล่น	Smoke					
	ห้องนอน	Smoke					
1402	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1403	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1404	ห้องครัว	Smoke					
	ห้องนอนใหญ่	Smoke					
1405	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1406	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1407	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1408	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1409	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องครัว	Smoke	✓		✓		
1410	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องครัว	Smoke	✓		✓		
1411	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1412	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องครัว	Smoke	✓		✓		
1413	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องครัว	Smoke	✓		✓		

Project : บจก.แกรนด์ กระตะ วีไอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell

Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	เสีย	Remark หมายเหตุ
Building A - Floor 4 (ต่อ)							
1414	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1415	ห้องนั่งเล่น	Smoke					
	ห้องนอน	Smoke					
	ห้องนอนใหญ่	Smoke	✓		✓		
1416	ห้องนอนเตียงคู่	Smoke	✓		✓		
	ห้องครัว	Smoke	✓		✓		
	ห้องนั่งเล่น	Smoke					
1417	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องนั่งเล่น	Smoke					
1418	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องนั่งเล่น	Smoke					
1419/4	ห้องนั่งเล่น	Smoke	✓				
	ห้องนอนใหญ่	Smoke	✓				
	ห้องนอนเตียงคู่	Smoke	✓				
	ห้องนอนเล็ก	Smoke	✓				
1419/5	ห้องนั่งเล่น	Smoke	✓				
	ห้องนอนใหญ่	Smoke	✓				
	ห้องนอนเตียงคู่	Smoke	✓				
	ห้องนอนเล็ก	Smoke	✓				
	หน้าห้อง 1409	Smoke	✓				
	หน้าห้อง 1412	Smoke					
	หน้าห้อง 1414	Smoke					
	หน้าห้อง 1416	Smoke	✓				
	หน้าห้อง 1417	Smoke					
	หน้าห้อง 1419	Smoke					
	หน้าบันไดหนีไฟ - Fl.2	Manual	✓				
	ST01 - Fl.4	Smoke					
	หน้าลิฟท์ - Fl.4	Smoke					
	หน้าลิฟท์ - Fl.4	Manual					
	หน้าบันไดหนีไฟ - Fl.4	Smoke					
	ST01 - Fl.4	Smoke	✓				
	หน้าลิฟท์ - Fl.4	Smoke	✓				
Building A - Floor 5							
1501	ห้องนอนใหญ่	Smoke	✓			✗	Alarm แต่ไฟ LED ไม่ติด
	ห้องครัว	Smoke	✓			✗	Alarm แต่ไฟ LED ไม่ติด

Project : บจก.แกรนด์ กระตะ วีไอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell

Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	เสีย	Remark หมายเหตุ
Building A - Floor 5 (ต่อ)							
1502	ห้องนั่งเล่น	Smoke					
	ห้องนอน	Smoke					
	ห้องนั่งเล่น	Smoke					
1503	ห้องนอน	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1504	ห้องครัว	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1505	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	ห้องครัว	Smoke					
1506	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1507	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1508	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
	หน้าห้อง 1501	Smoke	✓				
	หน้าห้อง 1506	Smoke					
	บันไดหนีไฟ 3 - Fl.5	Smoke	✓				
	หน้าลิฟท์ - Fl.5	Manual					
	หน้าพิตเนส	Manual					
	ห้องน้ำหญิง - Fl.5	Smoke					
	ห้องน้ำชาย - Fl.5	Smoke					
	พิตเนส	Smoke					
	ST01 - Fl.6	Smoke					
	หน้าลิฟท์ - Fl.6	Smoke					
	หน้าลิฟท์ - Fl.6	Manual					
Building A - Floor 6							
1601	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเตียงคู่	Smoke					
1602	ห้องนั่งเล่น	Smoke					
	ห้องนอน	Smoke					
	ห้องนั่งเล่น	Smoke					
1603	ห้องนอนใหญ่	Smoke	✓			✓	
	ห้องนอนเตียงคู่	Smoke	✓			✓	
	ห้องนอนใหญ่	Smoke	✓			✓	

Project : บจก.แกรนด์ กะตะ วิลโลพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell

Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	Remote Lamp เสีย	Remark หมายเหตุ
Building A - Floor 6 (ต่อ)							
1604	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
1605	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
1606	ห้องนอนเดี่ยวคู่	Smoke					
	ห้องนั่งเล่น	Smoke					
1607	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
1608	ห้องนั่งเล่น	Smoke					
	ห้องนอนเดี่ยว	Smoke					
1608	ห้องนอนใหญ่	Smoke					
	ห้องนอนเดี่ยวคู่	Smoke					
	หน้าห้อง 1605	Smoke					
	หน้าห้อง 1608	Smoke					
	บันไดหนีไฟ	Smoke	✓				
	ST01 - Fl.6	Smoke					
	หน้าลิฟท์ - Fl.6	Smoke	✓				
	หน้าลิฟท์ - Fl.6	Manual		✗			เสีย
Building A - Floor 7							
1701	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
1702	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
1703/7	ห้องนั่งเล่น	Smoke	✓				
	ห้องนอนใหญ่	Smoke	✓				
1703/8	ห้องนั่งเล่น	Smoke	✓				
	ห้องนอนเล็ก	Smoke	✓				
1704	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					

Project : บจก.แกรนด์ กะตะ วิลโลพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell

Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	Remote Lamp เสีย	Remark หมายเหตุ
Building A - Floor 7 (ต่อ)							
1705	ห้องนั่งเล่น 1	Smoke					
	ห้องนั่งเล่น 2	Smoke					
	ห้องนอนใหญ่ 1	Smoke					
	ห้องนอนใหญ่ 2	Smoke					
	ห้องนอน	Smoke					
	ห้องนอนเล็ก 1	Smoke					
	ห้องนอนเล็ก 2	Smoke					
	ห้องครัว 1	Smoke					
	ห้องครัว 2	Smoke					
	หน้าห้อง 1704	Smoke					
	หน้าห้อง 1705	Smoke					
	บันไดหนีไฟ - Fl.7	Smoke					
	ST01 - Fl.8	Smoke					
	หน้าลิฟท์ - Fl.7	Smoke	✓				
	หน้าห้อง 1703/8	Manual					
Building A - Floor 8							
	ห้องประชุม	Smoke					
		Smoke					
		Smoke					
		Smoke					
		Smoke					
		Smoke					
Building B - Floor 1							
2101	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2102	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2103	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2104	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2105	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					

Project : บจก.แกรนด์ กระตะ วีไอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell							
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	Remote Lamp เสีย	Remark หมายเหตุ
Building B - Floor 1 (ต่อ)							
2106	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2107	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2108	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2109	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
2110	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2111	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2112	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2113	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2114	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2115	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2116	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke		✗			เสีย
	ห้องนอนเล็ก	Smoke	✓		✓		
	ทางเดินหน้าห้อง 2107	Smoke					
	หน้าห้อง 2113	Manual					
	หน้าห้อง 2106	Manual					
	หน้าห้อง 2101	Manual	✓				
	หน้าห้อง 2113	Bell		✗			ตั้งบ้าง-ไม่ตั้งบ้าง
	บันได ST01 - Fl.1	Smoke					
	หน้าลิฟท์	Smoke					
	ห้องคอนโทรล	Smoke					
Building B - Floor 2							
2201	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					

Project : บจก.แกรนด์ กระตะ วีไอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell							
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ	Remote Lamp เสีย	Remark หมายเหตุ
Building B - Floor 2 (ต่อ)							
2202	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2203	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2204	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2205	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2206	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2207	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2208	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2209	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke					
2210	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2211	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2212	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2213	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke					
2214	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					

Project : บจก.แกรนด์ กระตะ วิโอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell							
Room No.	Area	Type	Normal	Waste	Remote Lamp	Remark	
ห้อง	พื้นที่ตรวจเช็ค	ชนิดอุปกรณ์	ปกติ	เสีย	ปกติ	เสีย	หมายเหตุ
Building B - Floor 2 (ต่อ)							
2215	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2216	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2217	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2218	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2219	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2220	ห้องนั่งเล่น	Smoke					
	ห้องนอน	Smoke					
	หน้าห้อง 2208	Smoke					
	หน้าห้อง 2209	Smoke					
	หน้าห้อง 2207	Manual					
	หน้าห้อง 2202	Manual					
	หน้าห้อง 2220	Manual					
	บันได ST01 - Fl.2	Smoke	✓				
	หน้าลิฟท์	Smoke	✓				
Building B - Floor 3							
2301	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2302	ห้องนั่งเล่น	Smoke					
	ห้องนอน	Smoke					
	ห้องนั่งเล่น	Smoke					
2303	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2304	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2305	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke					

Project : บจก.แกรนด์ กระตะ วิโอพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell							
Room No.	Area	Type	Normal	Waste	Remote Lamp	Remark	
ห้อง	พื้นที่ตรวจเช็ค	ชนิดอุปกรณ์	ปกติ	เสีย	ปกติ	เสีย	หมายเหตุ
Building B - Floor 3 (ต่อ)							
2306	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
2307	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2308	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke	✓		✓		
2309	ห้องนั่งเล่น	Smoke	✓		✓		
	ห้องนอนใหญ่	Smoke	✓		✓		
	ห้องนอนเล็ก	Smoke					
2310	ห้องนั่งเล่น	Smoke					
	ห้องนอน	Smoke					
	ห้องนั่งเล่น	Smoke					
2311	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2312	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2313	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2314	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2315	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2316	ห้องนอน	Smoke					
	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
2317	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2318	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					
	ห้องนั่งเล่น	Smoke					
2319	ห้องนั่งเล่น	Smoke					
	ห้องนอนใหญ่	Smoke					
	ห้องนอนเล็ก	Smoke					

Project : บจก.แกรนด์ กะตะ วิลโลพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.

Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell						
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ เสีย	Remark หมายเหตุ
Building B - Floor 3 (ต่อ)						
2320	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2321	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
	บันไดหนีไฟ	Smoke	✓			
	หน้าห้อง 2311	Smoke				
	หน้าห้อง 2316	Smoke				
	หน้าห้อง 2321	Manual				
	หน้าห้อง 2303	Manual				
	หน้าห้อง 2308	Manual				
	บันได ST01 - FL3	Smoke	✓			
Building B - Floor 4						
2401	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2402	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2403	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2404	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2405	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2406	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2407	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2408	ห้องนั่งเล่น	Smoke	✓		✓	
	ห้องนอนใหญ่	Smoke	✓		✓	
	ห้องนอนเล็ก	Smoke	✓		✓	

Project : บจก.แกรนด์ กะตะ วิลโลพี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.

Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell						
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ เสีย	Remark หมายเหตุ
Building B - Floor 4 (ต่อ)						
2409	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
	ห้องนั่งเล่น	Smoke				
2410	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2411	ห้องนั่งเล่น	Smoke	✓		✓	
	ห้องนอนใหญ่	Smoke	✓		✓	
2412	ห้องนั่งเล่น	Smoke	✓		✓	
	ห้องนอน	Smoke	✓		✓	
2413	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2414	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2415	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2416	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2417	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
2418	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
	ห้องทำงาน	Smoke				
2419	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
	ห้องทำงาน	Smoke				
2420	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
	ห้องทำงาน	Smoke				
2421	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
	ห้องทำงาน	Smoke				
	หน้าห้อง 2408	Manual	✓			
	หน้าห้อง 2403	Manual				
	หน้าห้อง 2421	Manual				

Project : บจก.แกรนด์ กะตะ วิลโลฟี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell						
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ เสีย	Remark หมายเหตุ
Building B - Floor 4 (ต่อ)						
	ST02 - Fl.4	Smoke	✓			
	ST02 - Fl.3	Smoke	✓			
Building B - Floor 5						
2501	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2502	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2503	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2504	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2505	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2506	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2507	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2508	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2509	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				
2510	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2511	ห้องนั่งเล่น	Smoke	✓		✓	
	ห้องนอนใหญ่	Smoke	✓		✓	
2512	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
2513	ห้องนั่งเล่น	Smoke				
	ห้องนอน	Smoke				

Project : บจก.แกรนด์ กะตะ วิลโลฟี
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.
 Date : 20-21 March 2025
 Preventive Maintenance
 Check List Report
 ครั้งที่ 2

2. ตารางตรวจเช็คค่าอุปกรณ์ Smoke Detector และ Bell						
Room No. ห้อง	Area พื้นที่ตรวจเช็ค	Type ชนิดอุปกรณ์	Normal ปกติ	Waste เสีย	Remote Lamp ปกติ เสีย	Remark หมายเหตุ
Building B - Floor 5 (ต่อ)						
2514	ห้องนั่งเล่น	Smoke	✓		✓	
	ห้องนอนใหญ่	Smoke	✓		✓	
2515	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2516	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2517	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2518	ห้องนั่งเล่น	Smoke				
	ห้องนอนใหญ่	Smoke				
	ห้องนอนเล็ก	Smoke				
2519	ห้องนั่งเล่น	Smoke	✓		✓	
	ห้องนอนใหญ่	Smoke	✓		✓	
	หน้าห้อง 2415	Smoke				
	หน้าห้อง 2507	Smoke				
	หน้าห้อง 2516	Smoke				
	หน้าลิฟท์ - Fl.5	Smoke				
	ST01	Smoke	✓			
	ST02	Smoke				
	ST03	Smoke				
	ST04	Smoke				
	ST05	Smoke				
	ห้องปั๊มขึ้นดาดฟ้า	Smoke				
	ห้องช่าง	Smoke				
	หน้าลิฟท์	Smoke	✓			
	หน้าห้องยะ	Manual				
	หน้าห้อง 2519	Manual	✓			
	หน้าห้อง 2501	Manual	✓			
	หน้าห้อง 2506	Manual				

Project : บจก.แกรนด์ กะตะ วิโอที
 System : Fire Alarm System : WILL-FF-516
 Check by : S.T.S.SYSTEM & ENGINEERING CO.,LTD.

Date : 20-21 March 2025

Preventive Maintenance

Check List Report

ครั้งที่ 2

3. ตู้ Graphic Annunciator

3.1 Graphic Annunciator (GNN.)

บอร์ด ANN. : ☒ Conventional Zone : _____ Zone
☐ Semi-Multiplexer : _____ Loop

3.2 สถานะตู้ FCP ขณะถึงหน้างาน

ตู้ GNN. ☒ เปิดระบบ
☐ ปิดระบบ สาเหตุที่ปิด : _____
 ตู้ GNN. ☒ ไม่มี Alarm
 แจ้ง Alarm ☐ มี Alarm จำนวน : _____
 ตู้ GNN. ☒ ไม่มี Fault
 แจ้ง Fault ☐ มี Fault จำนวน : _____

3.3 การทำงานของ Graphic Annunciator (GNN.)

No.	Check the current condition of the cabinet.	Inspection Results / ผลการตรวจเช็ค		Remark
ลำดับ	ตรวจสอบสภาพตู้ปัจจุบัน	OK	NOT	หมายเหตุ
1	ตรวจสอบฟังก์ชันการทำงานตู้			
	- สวิตช์ปิดเสียงตู้	✓		
	- สวิตช์ปิดเสียงกระดิ่ง	✓		
	- หลอดแสดงไฟ Alarm	✓		
	- หลอดแสดงไฟ Trouble	✓		
	- เสียง Buzzer ของตู้ GNN.	✓		
2	ตรวจสอบ Charger Battery & Battery			
	- ตรวจแรงดัน Power ที่จ่ายบอร์ดตู้ GNN. : 24 Vdc.	✓		
3	รายการตรวจเช็คอื่นๆ (ไม่ประกอบ)			
	- ทำความสะอาดตู้ GNN.	✓		
	- Terminal ต่างๆ	✓		
4	Zone Detector & Bell			
	- ตรวจสอบจำนวน Zone Detector : 16 Zone			
	- ตรวจสอบจำนวน Zone Bell : 1 Zone			

ภาคผนวก ข-10


เอกสารการตรวจสอบการระบายอากาศ



ภาคผนวก ข-11

การพิจารณารับคนในท้องถิ่นเพื่อเข้าทำงาน

จังหวัด	จำนวน	
กทม.	1	1%
กระบี่	1	1%
ขอนแก่น	1	1%
ตรัง	12	16%
นครศรีฯ	5	7%
บุรีรัมย์	1	1%
พังงา	6	8%
พัทลุง	5	7%
ภูเก็ต	26	36%
ร้อยเอ็ด	1	1%
ระนอง	1	1%
สงขลา	5	7%
สตูล	2	3%
สระบุรี	1	1%
สุราษฎร์ธานี	3	4%
อุดรธานี	1	1%
อุบลราชธานี	1	1%
	73	97%

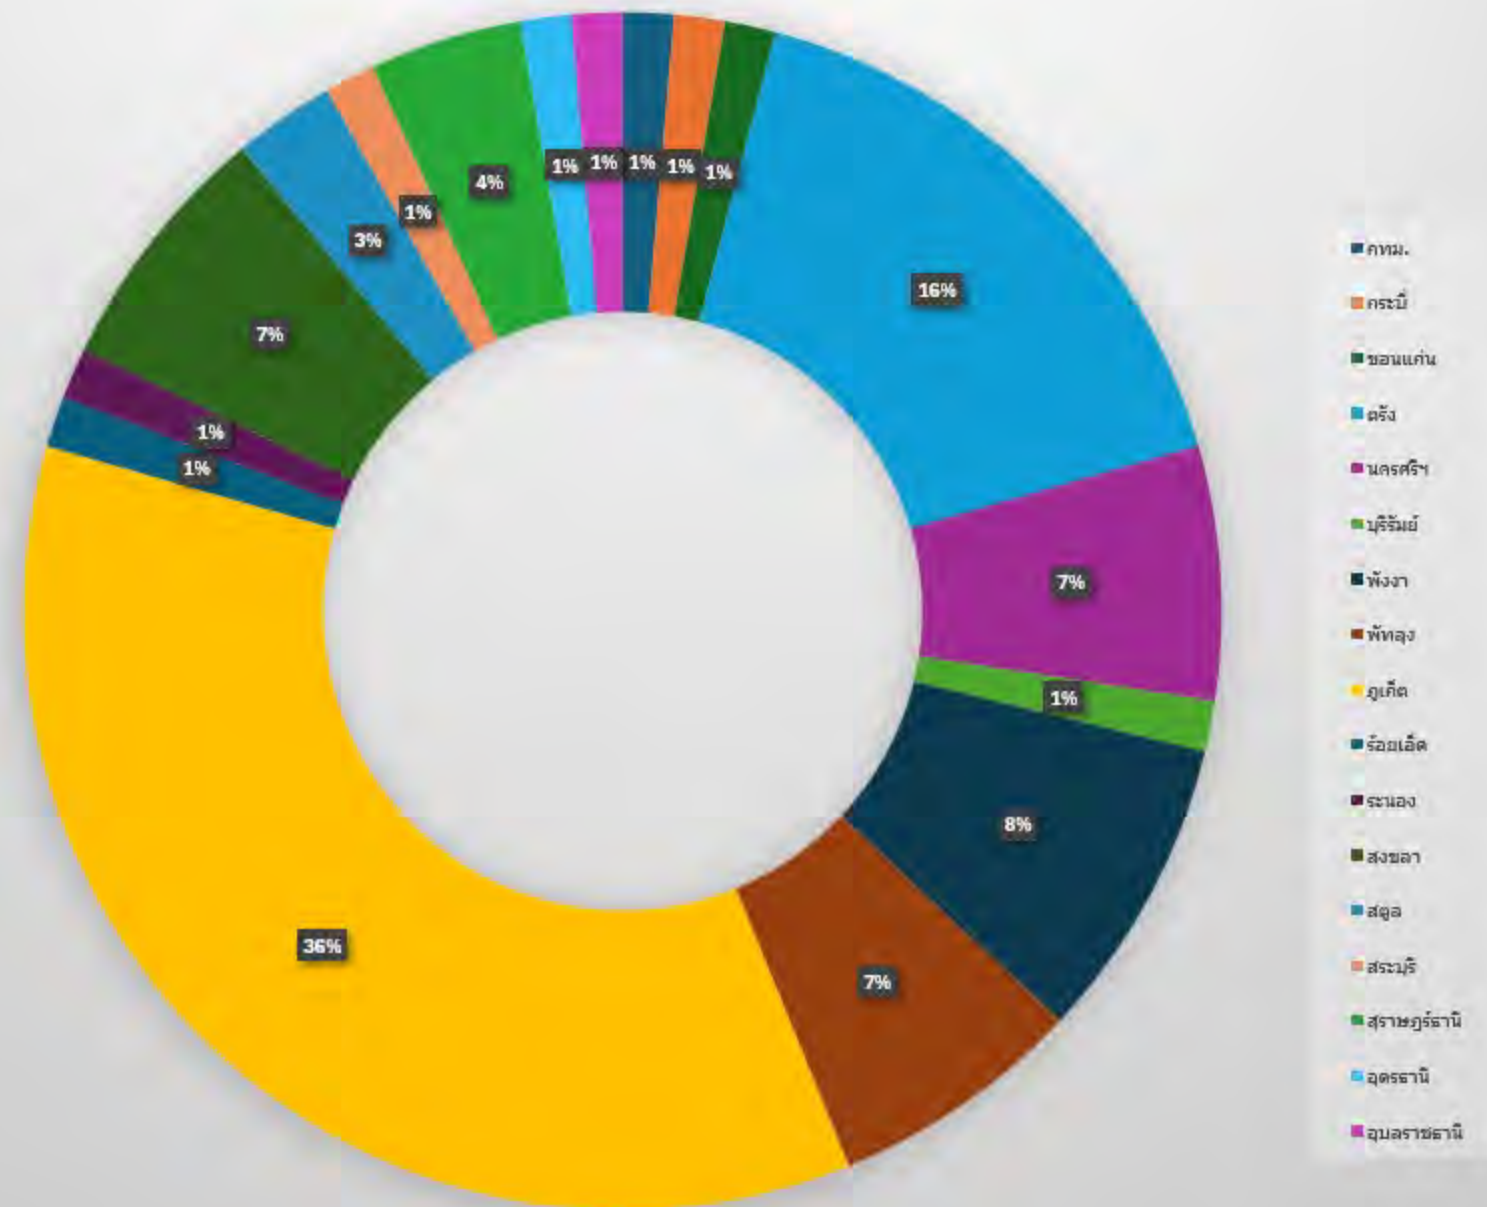

ภาคผนวก ข-12

เอกสารแต่งตั้งเจ้าหน้าที่รับเรื่องร้องเรียน

นิตินุคคลอาคารชุด วีไอพี คอนโด กะตะ

ประกาศ

เรื่อง แต่งตั้งเจ้าหน้าที่รับแจ้งเรื่องร้องเรียน/ร้องทุกข์

ด้วยโครงการนิตินุคคลอาคารชุด วีไอพี คอนโด กะตะ เป็นโครงการพักอาศัยที่มีผู้อยู่อาศัยในอาคารชุดร่วมกันเป็นจำนวนมาก ทางนิตินุคคลอาคารชุดฯ จึงมีความตั้งใจที่จะพัฒนาชีวิตความเป็นอยู่ของผู้พักอาศัยและประชาชนที่พักอาศัยอยู่บริเวณข้างเคียง ให้มีคุณภาพชีวิตที่ดีและไม่ก่อให้เกิดความเดือดร้อนใจแก่ผู้พักอาศัยในอาคารชุดและประชาชนที่พักอาศัยข้างเคียง โดยการจัดให้มีการรับเรื่องร้องเรียน/ร้องทุกข์จากผู้พักอาศัยในอาคารชุดและประชาชนที่พักอาศัยบริเวณข้างเคียง เพื่อจะหาวิธีการปรับปรุง และดำเนินการแก้ไขปัญหาต่างๆ ได้อย่างรวดเร็วต่อไป

เพื่อให้การดำเนินการดังกล่าว เป็นไปด้วยความเรียบร้อย มีประสิทธิภาพ และสนองความต้องการของผู้พักอาศัยในอาคารชุดและประชาชนที่พักอาศัยบริเวณข้างเคียงได้อย่างแท้จริง ทางนิตินุคคลอาคารชุด วีไอพี คอนโด กะตะ จึงขอแต่งตั้งผู้รับผิดชอบเรื่องร้องเรียน/ร้องทุกข์ ดังรายชื่อต่อไปนี้

นางสาวโชติกา สอนสำโรง

โดยให้มีหน้าที่ดังนี้

- 1.จัดทำรายการรับเรื่องร้องเรียน/ร้องทุกข์ รับแจ้งเรื่องร้องเรียน/ร้องทุกข์ และส่งเรื่องร้องเรียน/ร้องทุกข์ให้กับผู้ที่เกี่ยวข้องที่ต้องรับผิดชอบดำเนินการหาวิธีการปรับปรุงแก้ไขปัญหาดังกล่าวโดยเร็ว
- 2.ติดตามผลการดำเนินงานของผู้ที่เกี่ยวข้องที่ต้องรับผิดชอบ
- 3.ประสานกับผู้ที่เกี่ยวข้องที่ต้องรับผิดชอบเพื่อดำเนินการแจ้งผลการดำเนินงานให้กับผู้พักอาศัยในอาคารชุดและประชาชนที่พักอาศัยอยู่บริเวณข้างเคียงทราบ

ประกาศ ณ วันที่

กุมภาพันธ์ พ.ศ. 2567

(นายสมกร สุวรรณโชติ)

ผู้จัดการนิตินุคคลอาคารชุด วีไอพี คอนโด กะตะ

ภาคผนวก ข-13

ระเบียบการพักอาศัย

ข้อกำหนดของที่พักร
แกรนด์ ทัศะ วีไอพี ทัศะบิษ

เช็คอิน

ตั้งแต่ 14:00 น. ถึง 00:00 น.

เมื่อเช็คอิน ผู้เข้าพักต้องแสดงเอกสารประจำตัวที่มีภาพถ่ายและบัตรเครดิตร

เช็คเอาท์

ตั้งแต่ 07:00 น. ถึง 12:00 น.

เงินประกันความเสียหาย (รับคืนได้)

ท่านจะต้องมัดจำเงินประกันความเสียหาย THB 3000 เมื่อเช็คอิน โดยจะชำระเป็นเงินสด ท่านจะได้รับเงินประกันความเสียหายคืนเมื่อเช็คเอาท์ ท่านจะได้รับเงินประกันความเสียหายคืนเต็มจำนวนเป็นเงินสด โดยยอดเงินจะขึ้นอยู่กับผลการตรวจสอบความเสียหายของที่พักร

นโยบายผู้เข้าพักเด็กและเตียง

นโยบายเกี่ยวกับผู้เข้าพักเด็ก

เด็กทุกวัยสามารถเข้าพักได้

เด็กอายุ 12 ปีขึ้นไปจะถูกเรียกชำระเงินในอัตราเดียวกับผู้ใหญ่ที่ที่พักรนี้

หากต้องการข้อมูลที่ต้องการของราคาและจำนวนผู้เข้าพัก โปรดระบุจำนวนและอายุเด็กในกลุ่มที่เดินทางกับท่านลงในการค้นหา

นโยบายเกี่ยวกับเปลเด็กและเตียงเสริม

0 - 2 ปี เปลเด็ก (เมื่อแจ้งความประสงค์) ฟรี

7 - 11 ปี เตียงเสริม (เมื่อแจ้งความประสงค์) THB 500 ต่อเด็ก 1 ท่าน ต่อคืน

12 ปีขึ้นไป เตียงเสริม (เมื่อแจ้งความประสงค์) THB 1,000 ต่อท่าน ต่อคืน

ราคาของเปลเด็กและเตียงเสริมไม่รวมอยู่ในราคารวม และท่านจำเป็นต้องจ่ายแยกต่างหากระหว่างเข้าพัก

จำนวนเตียงเสริมและเปลเด็กที่สามารถใช้บริการได้จะขึ้นอยู่กับตัวเลือกที่ท่านเลือก โปรดตรวจสอบตัวเลือกของท่านเพื่อดูข้อมูลเพิ่มเติม

การให้บริการเปลเด็กและเตียงเสริมทั้งหมดขึ้นอยู่กับความพร้อมให้บริการ

มีข้อจำกัดด้านอายุ

ผู้ที่ทำการเช็คอินต้องมีอายุอย่างน้อย 18 ปี

สัตว์เลี้ยง

ไม่อนุญาตให้นำสัตว์เลี้ยงเข้าพัก

วิธีชำระเงินที่รองรับ



แกรนด์ ทัศะ วีไอพี ทัศะบิษ รับบัตรเครดิตเหล่านีในการชำระค่าใช้จ่าย และสงวนสิทธิ์ในการสงวนยอดเงินส่วนหนึ่งของท่านชั่วคราวก่อนเช็คอิน

House rules

Grand Kata VIP - Kata Beach

Check-in

From 2:00 PM to 12:00 AM

Guests are required to show a photo ID and credit card at check-in

Check-out

From 7:00 AM to 12:00 PM

Refundable damage deposit

A damage deposit of THB 3000 is required on arrival. That's about 86.21USD. This will be collected as a cash payment. You should be reimbursed on check-out. Your deposit will be refunded in full, in cash, subject to an inspection of the property.

Children & Beds

Child policies

Children of all ages are welcome.

Children 12 and above will be charged as adults at this property.

To see correct prices and occupancy info, add the number and ages of children in your group to your search.

Crib and extra bed policies

0 - 2 years Crib upon request Free

7 - 11 years Extra bed upon request THB 500 per child, per night

12+ years Extra bed upon request THB 1,000 per person, per night

Prices for cribs and extra beds aren't included in the total price. They'll have to be paid for separately during your stay.

The number of extra beds and cribs allowed depends on the option you choose. Check your selected option for more info.

All cribs and extra beds are subject to availability.

Age restriction

The minimum age for check-in is 18

Pets

Pets are not allowed.

Accepted payment methods



Grand Kata VIP - Kata Beach accepts these cards and reserves the right to temporarily hold an amount prior to arrival.

住宿规定

卡塔海滩格兰德卡塔VIP酒店可接受特别要求

入住时间

14:00 - 0:00

客人须在办理入住时出示带照片的身份证件和信用卡

退房时间

7:00 - 12:00

可退还损毁押金

到店时需支付损毁押金：THB 3000。（约合86.21USD。）该押金将以现金形式收取。退房时此押金将返还给你。住宿场所经检查如无任何损坏，此押金将以现金形式全额返还。

儿童及加床政策

一般儿童政策

欢迎任何年龄的儿童入住

年满12岁的儿童入住该住宿将按成人收费。

如需查看确切价格和入住信息，请在搜索条件中添加同行儿童人数和年龄。

婴儿床和加床政策

0 - 2岁 婴儿床（按需提供） 免费

7 - 11岁 加床（按需提供） 每名儿童每晚需THB 500

12岁以上 加床（按需提供） 每人每晚THB 1,000

婴儿床和加床价格不包含在总价内，需到店另行支付。

允许的加床和婴儿床数量取决于您的选项。请查看所选房型获取更多信息。

所有婴儿床及加床需视供应情况而定。

年龄限制

入住办理人需年满18岁

宠物

不允许携带宠物入住。

住宿接受的付款方式



卡塔海滩格兰德卡塔VIP酒店接受上述银行卡付款并有权在您抵达之前进行预授权。

Условия размещения

Grand Kata VIP - Kata Beach

Заезд

С 14:00 до 00:00

При регистрации заезда необходимо предъявить удостоверение личности с фотографией и кредитную карту.

Отъезд

С 07:00 до 12:00

Возвращаемый страховой залог

При заезде необходимо оплатить страховой залог в размере THB 3000. Это около 86.21 USD. Платеж производится наличными. Вы получите внесенную сумму во время регистрации отъезда. После проверки состояния объекта размещения залог будет полностью возвращен вам наличными.

Кровати для детей

Правила размещения детей

Разрешается проживание детей любого возраста.

В этом объекте размещения за детей в возрасте 12 лет и старше будет взиматься оплата как за взрослых гостей.

Чтобы увидеть точные цены и информацию о наличии мест, при поиске укажите количество детей в вашей группе и их возраст.

Правила установки детских кроваток и дополнительных кроватей

От 0 до 2 лет Детская кроватка по запросу Бесплатно

От 7 до 11 лет Дополнительная кровать по запросу THB 500 за ребенка за ночь

От 12 лет Дополнительная кровать по запросу THB 1 000 за человека за ночь

Размещение на детских кроватках и дополнительных кроватях не входит в общую стоимость бронирования и оплачивается отдельно во время проживания.

Допустимое количество дополнительных кроватей и детских кроваток зависит от выбранного варианта. Проверьте условия.

Детские кроватки и дополнительные кровати предоставляются при наличии возможности.


Возрастное ограничение

Минимальный допустимый возраст для заезда: 18 лет


Домашние животные

Размещение с домашними животными не допускается.

Принимаемые способы оплаты



Grand Kata VIP - Kata Beach принимает эти карты и оставляет за собой право предварительного блокирования средств на карте до вашего приезда.

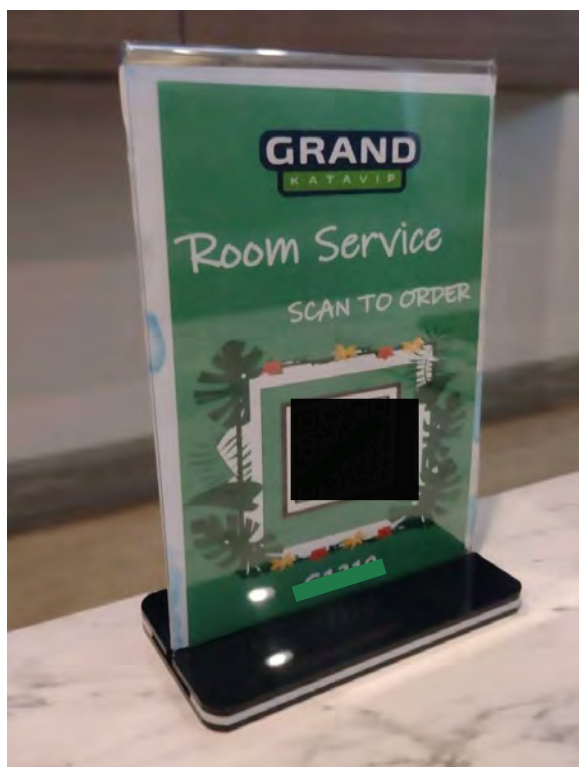

กฎการเข้าพักในแอปพลิเคชัน



Details

House rules

Grand Kata VIP - Kata Beach

Check-in

From 2:00 PM to 12:00 AM

Guests are required to show a photo ID and credit card at check-in.

Check-out

From 7:00 AM to 12:00 PM

Refundable damage deposit

A damage deposit of THB 3000 is required on arrival. That's about 8621USD. This will be collected as a cash payment. You should be reimbursed on check-out. Your deposit will be refunded in full, in cash, subject to an inspection of the property.

Children & Beds

Child policies

Children of all ages are welcome.

Children 12 and above will be charged as adults at this property.

To see correct prices and occupancy info, add the number and ages of children in your group to your search.

Crib and extra bed policies

0 - 2 years Crib upon request Free

7 - 11 years Extra bed upon request THB 500 per child, per night

12+ years Extra bed upon request THB 1,000 per person, per night

Prices for cribs and extra beds aren't included in the total price. They'll have to be paid for separately during your stay.

The number of extra beds and cribs allowed depends on the option you choose. Check your selected option for more info.

All cribs and extra beds are subject to availability.

Age restriction

The minimum age for check-in is 18

Pets

Pets are not allowed.


Accepted payment methods



Grand Kata VIP - Kata Beach accepts these cards and reserves the right to temporarily hold an amount prior to arrival.

Hotel Facilities

MORE >

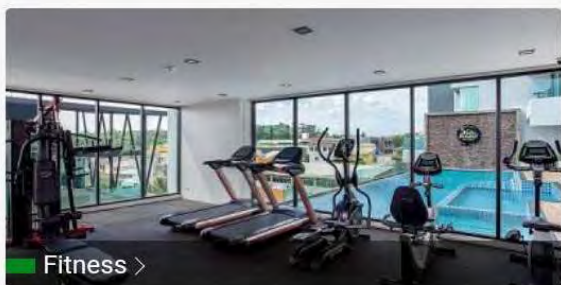

Fitness >



Swimming Pool >

Others

MORE >



House Rules >



Damage >

Powered by **Hotelink**



ภาคผนวก ข-14

แบบบันทึกการตรวจสอบการทำงานของระบบกล้องโทรทัศน์วงจรปิด

		Number :		GKT-IT-03		Date of check :		6 มกราคม 2025		
		Title : Check list		Check list		The work time :		AM		
		Report type :		Daily report.		Job By Name :		Dochakorn (IT)		
			CCTV SYSTEM				/ OK - V Need repair X Repair Complete			
IT Equipment/Code		Up Link	Location	STANDARD OPERATIONAL PROCEDURE (SOP) OF SERVICE						
				Cleaning All	DVR recording	Signal Camera image	Data backup	Fixing if find something wrong	Soft ware connection	Maintenance Score & Comment
Additont Job	CCTV		SERVER ROOM							
SPECIAL CHECKING PROGRESS										
	DVR1	-	Server room	-	-	-	-	-	-	-
1	CH1	-	-	-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	-	-	-	-	-	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-

	DVR2		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	V	V	V	-	V	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-
	DVR3		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-	-	-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	V	V	V	-	V	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-

	DVR4		FLoor1 Building B	-	-	-	-	-	/	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	V	V	V	-	V	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	V	V	V	-	V	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-
	DVR5		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	V	V	V	-	V	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-
	DVR6		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-

		Number :		GKT-IT-03		Date of check :		6 กุมภาพันธ์ 2025		
		Title : Check list		Check list		The work time :		AM		
		Report type :		Daily report.		Job By Name :		Dachakorn (IT)		
			CCTV SYSTEM				/ Ok V Need repair X Repair Complete			
IT Equipment/Code		Up Link	Location	STANDARD OPERATIONAL PROCEDURE (SOP) OF SERVICE						
				Cleaning All	DVR recording	Signal Camera image	Data backup	Fixing if find something wrong	Soft ware connection	Maintenance Score & Comment
Additont Job	CCTV		SERVER ROOM							
SPECIAL CHECKING PROGRESS										
	DVR1	-	Server room	-	-	-	-	-	-	-
1	CH1	-	-	-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	-	-	-	-	-	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-

	DVR2		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	V	V	V	-	V	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	V	V	V	-	V	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-
	DVR3		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-	-	-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	V	V	V	-	V	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-

	DVR4		FLoor1 Building B	-	-	-	-	-	/	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	V	V	V	-	V	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	V	V	V	-	V	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-
	DVR5		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	V	V	V	-	V	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	V	V	V	-	V	-
	DVR6		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-

		Number :		GKT-IT-03		Date of check :		6 มีนาคม 2025		
		Title : Check list		Check list		The work time :		AM		
		Report type :		Daily report.		Job By Name :		D [REDACTED]		
			CCTV SYSTEM				/ Ok V Need repair X Repair Complete			
IT Equipment/Code		Up Link	Location	STANDARD OPERATIONAL PROCEDURE (SOP) OF SERVICE						
				Cleaning All	DVR recording	Signal Camera image	Data backup	Fixing if find something wrong	Soft ware connection	Maintenance Score & Comment
Additont Job	CCTV		SERVER ROOM							
SPECIAL CHECKING PROGRESS										
	DVR1	-	Server room	-	-	-	-	-	-	-
1	CH1	-	-	-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	-	-	-	-	-	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-

	DVR2		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-
	DVR3		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-	-	-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	V	V	V	-	V	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-

	DVR4		FLoor1 Building B	-	-	-	-	-	/	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	V	V	V	-	V	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	V	V	V	-	V	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-
	DVR5		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	V	V	V	-	V	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	V	V	V	-	V	-
	DVR6		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-

		Number :		GKT-IT-03		Date of check :		6 เมษายน 2025		
		Title : Check list		Check list		The work time :		AM		
		Report type :		Daily report.		Job By Name :		Doichakorn (IT)		
			CCTV SYSTEM				/ OK - V Need repair X Repair Complete			
IT Equipment/Code		Up Link	Location	STANDARD OPERATIONAL PROCEDURE (SOP) OF SERVICE						
				Cleaning All	DVR recording	Signal Camera image	Data backup	Fixing if find something wrong	Soft ware connection	Maintenance Score & Comment
Additont Job	CCTV		SERVER ROOM							
SPECIAL CHECKING PROGRESS										
	DVR1	-	Server room	-	-	-	-	-	-	-
1	CH1	-	-	-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	-	-	-	-	-	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-

	DVR2		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	V	V	V	-	V	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-
	DVR3		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-	-	-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	V	V	V	-	V	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-

	DVR4		FLoor1 Building B	-	-	-	-	-	/	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	V	V	V	-	V	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	V	V	V	-	V	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-
	DVR5		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	V	V	V	-	V	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	X	X	X	-	X	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	V	V	V	-	V	-
	DVR6		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-

		Number :		GKT-IT-03		Date of check :		6 พฤษภาคม 2025		
		Title : Check list		Check list		The work time :		AM		
		Report type :		Daily report.		Job By Name :		Dachakorn (IT)		
			CCTV SYSTEM				/ Ok V Need repair X Repair Complete			
IT Equipment/Code		Up Link	Location	STANDARD OPERATIONAL PROCEDURE (SOP) OF SERVICE						
				Cleaning All	DVR recording	Signal Camera image	Data backup	Fixing if find something wrong	Soft ware connection	Maintenance Score & Comment
Additont Job	CCTV		SERVER ROOM							
SPECIAL CHECKING PROGRESS										
	DVR1	-	Server room	-	-	-	-	-	-	-
1	CH1	-	-	-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	-	-	-	-	-	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-

	DVR2		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	X	X	X	-	X	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-
	DVR3		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-	-	-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	V	V	V	-	V	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-

	DVR4		FLoor1 Building B	-	-	-	-	-	/	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	V	V	V	-	V	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	V	V	V	-	V	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-
	DVR5		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	V	V	V	-	V	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	V	V	V	-	V	-
	DVR6		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-

		Number :		GKT-IT-03		Date of check :		6 มิถุนายน 2025		
		Title : Check list		Check list		The work time :		AM		
		Report type :		Daily report.		Job By Name :		Dochakorn (IT)		
			CCTV SYSTEM				/ Ok V Need repair X Repair Complete			
IT Equipment/Code		Up Link	Location	STANDARD OPERATIONAL PROCEDURE (SOP) OF SERVICE						
				Cleaning All	DVR recording	Signal Camera image	Data backup	Fixing if find something wrong	Soft ware connection	Maintenance Score & Comment
Additont Job	CCTV		SERVER ROOM							
SPECIAL CHECKING PROGRESS										
	DVR1	-	Server room	-	-	-	-	-	-	-
1	CH1	-	-	-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	-	-	-	-	-	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-

	DVR2		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	-	-	-	-	-	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	/	/	/	-	/	-
	DVR3		Server Room	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-	-	-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	V	V	V	-	V	-
6	CH6	-		-	V	V	V	-	V	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-

	DVR4		FLoor1 Building B	-	-	-	-	-	/	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	V	V	V	-	V	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	V	V	V	-	V	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	-	-	-	-	-	-
	DVR5		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	V	V	V	-	V	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-
5	CH5	-		-	/	/	/	-	/	-
6	CH6	-		-	/	/	/	-	/	-
7	CH7	-		-	/	/	/	-	/	-
8	CH8	-		-	/	/	/	-	/	-
9	CH9	-		-	/	/	/	-	/	-
10	CH10	-		-	/	/	/	-	/	-
11	CH11	-		-	/	/	/	-	/	-
12	CH12	-		-	/	/	/	-	/	-
13	CH13	-		-	/	/	/	-	/	-
14	CH14	-		-	/	/	/	-	/	-
15	CH15	-		-	/	/	/	-	/	-
16	CH16	-		-	V	V	V	-	V	-
	DVR6		FLoor1 Building B	-	-	-	-	-	-	-
1	CH1	-		-	/	/	/	-	/	-
2	CH2	-		-	/	/	/	-	/	-
3	CH3	-		-	/	/	/	-	/	-
4	CH4	-		-	/	/	/	-	/	-

ภาคผนวก ข-15

แผนการฉีดพ่นยา

มกราคม 2568
สถานที่ให้บริการ
โรงแรม แกรนด์ อะคาดี วีโอพี
58/147 หมู่ 6 ต.ราไวย์ อ.เมือง จ.ภูเก็ต 83130
ผู้ติดต่อ
เจนกอบบ้าน
โทร
076-510-993

บริษัทฯ เรียนให้ท่านทราบว่า บริษัทฯ จะส่งพนักงานเข้าให้บริการตามสัญญาการจัด ปลวก,มด,แมลงสาบ,หนู,ยุง รายละเอียดดังต่อไปนี้

วันที่	พื้นที่	รายละเอียดการให้บริการ
04-ม.ค.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงสาบ (มด, แมลงสาบ)
14.00 น.	อาคาร 2 หลัง	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
	รอบนอก	ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		3 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
18-ม.ค.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงสาบ (ปลวก Bio)
14.00 น.	อาคาร 2 หลัง	- ตรวจเช็คภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	- หากพบปลวกภายในพื้นที่ จะทำการติดตั้งกล่องเหยื่อปลวก ทันที
	รอบนอก	2 การให้บริการป้องกันกำจัด แมลงสาบ (มด, แมลงสาบ)
		สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
		3 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		4 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
กลางคืน	ห้องอาหาร	1 การให้บริการป้องกันกำจัด แมลงสาบ (มด, แมลงสาบ)
13-ม.ค.-68	ห้องครัว	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
21.00 น.	แคนทีน	ใช้เจลกำจัดในพื้นที่ที่เป็นจุดเสี่ยงไม่สามารถสเปรย์เคมีได้
		2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม

จึงเรียนมาเพื่อทราบ และหากท่านมีความประสงค์ จะเปลี่ยนแปลงแก้ไข ประการใด โปรดแจ้งให้บริษัทฯ ทราบ
อย่างน้อย 2 วัน โทร. 076-604392 (หากมีสัตว์เลี้ยง, เด็กเล็ก, คนชรา โปรดแจ้งพนักงานทุกครั้ง)

กุมภาพันธ์ 2568

สาขาที่ให้บริการ

โรงแรม แกรนด์ กระตะ วิโอพี

58/147 หมู่ 6 ต.ราไวย์ อ.เมือง จ.ภูเก็ต 83130

ผู้ติดต่อ

แทนกนกบ้าน

โทร

076-510-993

บริษัทฯ เรียนให้ท่านทราบว่า บริษัทฯ จะส่งพนักงานเข้าให้บริการตามสัญญาการจัด ปลวก,มด,แมลงสาบ,หนู,ยุง รายละเอียดดังต่อไปนี้

วันที่	พื้นที่	รายละเอียดการให้บริการ
01-ก.พ.-68	ห้องพัก 161 ห้อง, อาคาร 2 หลัง ออฟฟิศ รอบนอก	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ) สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
14.00 น.		2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู) ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม ภายนอก ติดตั้งกล่องเหยื่อหนู 3 การให้บริการป้องกันกำจัด แมลงบิน (ยุง) ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
15-ก.พ.-68	ห้องพัก 161 ห้อง, อาคาร 2 หลัง ออฟฟิศ รอบนอก	1 การให้บริการป้องกันกำจัด แมลงคลาน (ปลวก Bio) - ตรวจเช็คภายใน และ นอกอาคารที่สามารถเข้าไปทำได้ - หากพบปลวกภายในพื้นที่ จะทำการติดตั้งกล่องเหยื่อปลวก ทันที
14.00 น.		2 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ) สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้ 3 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู) ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม ภายนอก ติดตั้งกล่องเหยื่อหนู 4 การให้บริการป้องกันกำจัด แมลงบิน (ยุง) ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
กลางคืน	ห้องอาหาร	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ) สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
10-ก.พ.-68	ห้องครัว	ใช้เจลกำจัดในพื้นที่ที่เป็นจุดเสี่ยงไม่สามารถสเปรย์เคมีได้
21.00 น.	แคนทีน	2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู) ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม

จึงเรียนมาเพื่อทราบ และหากท่านมีความประสงค์ จะเปลี่ยนแปลงแก้ไข ประการใด โปรดแจ้งให้บริษัทฯ ทราบ
อย่างน้อย 2 วัน โทร. 076-604392 (หากมีสัปดาห์เลี้ยง, เด็กเล็ก, คนชรา โปรดแจ้งพนักงานทุกครั้ง)

คุณธวัชชัย แทนกนกมา หัวหน้างานฝ่ายบริการ สาขาภูเก็ต โทร. 061-405-4253

มีนาคม 2568
สถานที่ให้บริการ
โรงแรม แกรนด์ อะตอม วีโอพี
58/147 หมู่ 6 ต.ราไวย์ อ.เมือง จ.ภูเก็ต 83130
ผู้ติดต่อ
นายณัฏฐ์ นาน
โทร
076-510-993

บริษัทฯ เรียนให้ท่านทราบว่า บริษัทฯ จะส่งพนักงานเข้าให้บริการตามสัญญาการจัด ปลวก,มด,แมลงสาบ,หนู,ยุง รายละเอียดดังต่อไปนี้

วันที่	พื้นที่	รายละเอียดการให้บริการ
01-มี.ค.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงสาบ (มด, แมลงสาบ)
14.00 น.	อาคาร 2 หลัง	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
	รอบนอก	ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		3 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
15-มี.ค.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงสาบ (ปลวก Bio)
14.00 น.	อาคาร 2 หลัง	- ตรวจเช็คภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	- หากพบปลวกภายในพื้นที่ จะทำการติดตั้งกล่องเหยื่อปลวก ทันที
	รอบนอก	2 การให้บริการป้องกันกำจัด แมลงสาบ (มด, แมลงสาบ)
		สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
		3 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		4 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
กลางคืน	ห้องอาหาร	1 การให้บริการป้องกันกำจัด แมลงสาบ (มด, แมลงสาบ)
07-มี.ค.-68	ห้องครัว	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
21.00 น.	แดนดิน	ใช้เจลกำจัดในพื้นที่ที่เป็นจุดเสี่ยงไม่สามารถสเปรย์เคมีได้
		2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม

จึงเรียนมาเพื่อทราบ และหากท่านมีความประสงค์ จะเปลี่ยนแปลงแก้ไข ประการใด โปรดแจ้งให้บริษัทฯ ทราบ
อย่างน้อย 2 วัน โทร. 076-604392 (หากมีสัตว์เลี้ยง, เด็กเล็ก, คนชรา โปรดแจ้งพนักงานทุกครั้ง)

คุณธวัชชัย เกษมธรรมา หัวหน้างานฝ่ายบริการ สาขาภูเก็ต โทร. 061-405-4253

เมษายน 2568

สถานที่ให้บริการ

โรงแรม แกรนด์ อะคาดี วีไอพี

58/147 หมู่ 6 ต.ราไวย์ อ.เมือง จ.ภูเก็ต 83130

ผู้ติดต่อ

แผนกแม่บ้าน

โทร

076-510-993

บริษัทฯ เรียนให้ท่านทราบว่า บริษัทฯ จะส่งพนักงานเข้าให้บริการตามสัญญาการจัด ปลวก,มด,แมลงสาบ,หนู,ยุง รายละเอียดดังต่อไปนี้

วันที่	พื้นที่	รายละเอียดการให้บริการ
05-เม.ย.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
14.00 น.	อาคาร 2 หลัง	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
	รอบนอก	ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก คัดตักกล่องเหยื่อหนู
		3 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
19-เม.ย.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงคลาน (ปลวก Bio)
14.00 น.	อาคาร 2 หลัง	- ตรวจเช็คภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	- หากพบปลวกภายในพื้นที่ จะทำการคัดตักกล่องเหยื่อปลวก ทันที
	รอบนอก	2 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
		สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
		3 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก คัดตักกล่องเหยื่อหนู
		4 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
กลางคืน	ห้องอาหาร	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
04-เม.ย.-68	ห้องครัว	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
21.00 น.	แคนทีน	ใช้เจลกำจัดในพื้นที่ที่เป็นจุดเสี่ยงไม่สามารถสเปรย์เคมีได้
		2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม

จึงเรียนมาเพื่อทราบ และหากท่านมีความประสงค์ จะเปลี่ยนแปลงแก้ไข ประการใด โปรดแจ้งให้บริษัทฯ ทราบ
อย่างน้อย 2 วัน โทร. 076-604392 (หากมีสัตว์เลี้ยง, เด็กเล็ก, คนชรา โปรดแจ้งพนักงานทุกครั้ง)

พฤษภาคม 2568

สถานที่ให้บริการ

โรงแรม แกรนด์ กะตะ วิลโลพี

58/147 หมู่ 6 ต.ราไวย์ อ.เมือง จ.ภูเก็ต 83130

ผู้ติดต่อ

[Redacted Name]

โทร

076-510-993

บริษัทฯ เรียนให้ท่านทราบว่า บริษัทฯ จะส่งพนักงานเข้าให้บริการตามสัญญาการจัด ปลวก,มด,แมลงสาบ,หนู,ยุง รายละเอียดดังต่อไปนี้

วันที่	พื้นที่	รายละเอียดการให้บริการ
03-พ.ค.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
14.00 น.	อาคาร 2 หลัง	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
	รอบนอก	ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		3 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
17-พ.ค.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงคลาน (ปลวก Bio)
14.00 น.	อาคาร 2 หลัง	- ตรวจเช็คภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	- หากพบปลวกภายในพื้นที่ จะทำการติดตั้งกล่องเหยื่อปลวก ทันที
	รอบนอก	2 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
		สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
		3 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		4 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
กลางคืน	ห้องอาหาร	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
02-พ.ค.-68	ห้องครัว	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
21.00 น.	แคนทิน	ใช้เจลกำจัดในพื้นที่ที่เป็นจุดเสี่ยงไม่สามารถสเปรย์เคมีได้
		2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม

จึงเรียนมาเพื่อทราบ และหากท่านมีความประสงค์ จะเปลี่ยนแปลงแก้ไข ประการใด โปรดแจ้งให้บริษัทฯ ทราบ
อย่างน้อย 2 วัน โทร. 076-604392 (หากมีสัปดาห์เต็ม, เด็กเล็ก, คนชรา โปรดแจ้งพนักงานทุกครั้ง)

ด้วยอำนาจแห่งความเชื่อใจและความไว้วางใจของนาย [Redacted Name] โทร. 076-105-5555

มิถุนายน 2568

สถานที่ให้บริการ

โรงแรม แกรนด์ กะตะ วิลโลพี

58/147 หมู่ 6 ต.ราไวย์ อ.เมือง จ.ภูเก็ต 83130

ผู้ติดต่อ

แทนกนกบ้าน

โทร

076-510-993

บริษัทฯ เรียนให้ท่านทราบว่า บริษัทฯ จะส่งพนักงานเข้าให้บริการตามสัญญาการจัด ปลวก,มด,แมลงสาบ,หนู,ยุง รายละเอียดดังต่อไปนี้

วันที่	พื้นที่	รายละเอียดการให้บริการ
7-มิ.ย.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
14.00 น.	อาคาร 2 หลัง	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
	รอบนอก	ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		3 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
21-มิ.ย.-68	ห้องพัก 161 ห้อง,	1 การให้บริการป้องกันกำจัด แมลงคลาน (ปลวก Bio)
14.00 น.	อาคาร 2 หลัง	- ตรวจเช็คภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
	ออฟฟิศ	- หากพบปลวกภายในพื้นที่ จะทำการติดตั้งกล่องเหยื่อปลวก ทันที
	รอบนอก	2 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
		สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
		3 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม
		ภายนอก ติดตั้งกล่องเหยื่อหนู
		4 การให้บริการป้องกันกำจัด แมลงบิน (ยุง)
		ภายนอก พ่นหมอกควัน เพื่อกำจัดยุง
		หากพบแหล่งน้ำขังที่มีความเสี่ยงเกิดลูกน้ำ ให้ใช้เหยื่อกำจัดลูกน้ำ
กลางคืน	ห้องอาหาร	1 การให้บริการป้องกันกำจัด แมลงคลาน (มด, แมลงสาบ)
6-มิ.ย.-68	ห้องครัว	สเปรย์เคมีภายใน และ นอกอาคารที่สามารถเข้าไปทำได้
21.00 น.	แคนทีน	ใช้เจลกำจัดในพื้นที่ที่เป็นจุดเสี่ยงไม่สามารถสเปรย์เคมีได้
		2 การให้บริการป้องกันกำจัด สัตว์รบกวน (หนู)
		ภายใน วางกระดานกาว หรือ กรง ตามความเหมาะสม

จึงเรียนมาเพื่อทราบ และหากท่านมีความประสงค์ จะเปลี่ยนแปลงแก้ไข ประการใด โปรดแจ้งให้บริษัทฯ ทราบ
อย่างน้อย 2 วัน โทร. 076-604392 (หากมีสัตว์เลี้ยง, เด็กเล็ก, คนชรา โปรดแจ้งพนักงานทุกครั้ง)

ภาคผนวก ข-16

เอกสารการบันทึกค่าความเป็นกรด-ด่าง และคลอรีน

Month : January 25

วันที่	สภาพ กระเบื้องปู	การ เข้มข้นของ เกลือ	ระดับน้ำ ในถังพัก	แรงดันถึง กรองที่ 1	แรงดันถึง กรองที่ 2	ตะกั่ว หน้าบ่ม	การ	การ	การ	การ	การทำงาน	สภาพ ห้องบ่ม	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	หมายเหตุ
							ทำงานบ่ม ที่ 1	ทำงานบ่ม ที่ 2	ทำงาน เป็นจากซ์	ทำงานบ่ม น้ำกล	เครื่อง ผลิตเกลือ										
1	OK	33	70%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	0.3	6.8	เติม CL 1 ลิตร	ชว. 26	1.5	6.8		
2	OK	0	70%	10	10	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม CL 1 ลิตร	ชว. 26	3.0	6.8		
3	OK	0	70%	11	12	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2	เติม PH	ชว. 26	1.0	7.5		
4	OK	0	80%	11	12	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม CL 1 ลิตร	ชว. 26	0.3	6.8		
5	OK	33	80%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	1.6	6.8	เติม CL 1/4 ลิตร	ชว. 26				
6	OK	33	90%	12	13	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8		ชว. 26				
7	OK	0	90%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	2.5	6.8	เติม CL	ชว. 26	0.0	6.8	CL ก่อน 10 ลิตร	
8	OK	0	90%	10	10	OK	OK	OK	Auto	off	OK	OK	OK	0.3	6.8	เติม CL PH	ชว. 26	0.0	6.8		
9	OK	0	80%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม CL PH, 1 ลิตร	ชว. 26	0.0	6.8	เติม CL 1 ลิตร	
10	OK	0	70%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	2.5	6.8	เติม CL PH, 1 ลิตร	ชว. 26	0.3	6.8	เติม CL 1 ลิตร	
11	OK	0	70%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม PH	ชว. 26	1.0	6.8	เติม CL 1 ลิตร	
12	OK	0	70%	12	11	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม CL PH	ชว. 26	1.0	6.8	เติม CL 1 ลิตร	
13	OK	0	90%	18	18	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม CL PH, 1 ลิตร	ชว. 26	0.3	6.8	เติม CL 1 ลิตร	
14	OK	0	80%	12	13	OK	OK	OK	Auto	off	OK	OK	OK	3.0	6.8	เติม CL PH	ชว. 26	1.0	6.8		
15	OK	0	50%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	1.0	6.8	เติม CL PH, 1 ลิตร	ชว. 26	1.0	6.8		
16	OK	0	100%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	1.0	6.8	เติม CL PH, 1 ลิตร	ชว. 26	1.5	7.2		
17	OK	0	100%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม PH	ชว. 26	0.3	6.8	เติม CL 1 ลิตร	
18	OK	0	100%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม PH	ชว. 26	0.3	6.8	เติม CL 2 ลิตร	
19	OK	0	100%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม CL	ชว. 26	0.0	6.8	เติม CL 2 ลิตร	
20	OK	0	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	3.0	6.8	เติม PH	ชว. 26	1.0	6.8	เติม CL 1 ลิตร	
21	OK	0	100%	12	13	OK	OK	OK	Auto	off	OK	OK	OK	2.5	6.8	เติม PH	ชว. 26	0.0	6.8	เติม CL 1 ลิตร	
22	OK	0	90%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	2.5	6.8	เติม PH	ชว. 26	0.5	6.8	เติม CL 1 ลิตร	
23	OK	0	40%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	0.3	6.8	เติม CL PH, 1 ลิตร	ชว. 26	1.0	7.2	เติม CL 1 ลิตร	
24	OK	0	80%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	6.8	เติม PH	ชว. 26	1.0	7.2		
25	OK	0	80%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	0.2	6.8	เติม CL	ชว. 26	1.5	7.2		
26	OK	0	100%	10	9	OK	OK	OK	Auto	off	OK	OK	OK	0.5	6.8	เติม CL 1 ลิตร	ชว. 26	1.5	7.2		
27	OK	0	100%	12	14	OK	OK	OK	Auto	off	OK	OK	OK	0.5	6.8	เติม CL 1/3, 1 ลิตร	ชว. 26	1.0	7.2	เติม CL 1 ลิตร	
28	OK	0	100%	12	14	OK	OK	OK	Auto	off	OK	OK	OK	2.0	7.2	เติม CL	ชว. 26	0.3	6.8		
29	OK	0	100%	12	14	OK	OK	OK	Auto	off	OK	OK	OK	0	7.2	เติม CL	ชว. 26	1.0	7.2		
30	OK	0	100%	12	14	OK	OK	OK	Auto	off	OK	OK	OK	0.2	6.8	เติม PH	ชว. 26	3.0	7.2		
31	OK	0	100%	12	14	OK	OK	OK	Auto	off	OK	OK	OK	1.0	6.8	เติม PH	ชว. 26	0.0	7.2	เติม CL 1 ลิตร	

Month : January 25
 รอบนำย(เปิดสระ)

วันที่	สภาพสระ ทั่วไป	รอบเช้า(เปิดสระ)										ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	หมายเหตุ
		ความ เข้มข้นของ เกลือ	ระดับน้ำใน ถังพัก	แรงดันถึง กรอง	ตะกอนหน้า บ่ม	การทำงาน บ่ม	การ ทำงานเป็น จากชุด	การกรอง เครื่องคิด กลอรีน	การวัด คลอรีน	สภาพห้อง บ่ม										
1	OK	30	90%	23	OK	OK	OK	OK	OK	OK		1.5	7.2		2/26	1.5	7.2	เติมเกลือ 5 กก. (50 ลิ)		
2	OK	33	90%	22	OK	OK	OK	OK	OK	OK		1.0	7.6	เพิ่ม CL 1 ถึง 6 ลิ	2/26	1.5	7.6			
3	OK	33	90%	22	OK	OK	OK	OK	OK	OK		1.5	7.6		2/27	1.5	7.6			
4	OK	37	90%	22	OK	OK	OK	OK	OK	OK		1.0	7.6	เพิ่ม CL	2/27	0.5	7.6			
5	OK	33	90%	23	OK	OK	OK	OK	OK	OK		3.0	7.6	ลดคลอรีน	2/27					
6	OK	33	90%	22	OK	OK	OK	OK	OK	OK		3.0	7.6		2/26					
7	OK	33	90%	25	OK	OK	OK	OK	OK	OK		2.5	7.6		2/26	1.0	7.2			
8	OK	33	90%	22	OK	OK	OK	OK	OK	OK		2.0	7.6	ลดคลอรีน	2/26	1.0	7.2			
9	OK	33	90%	22	OK	OK	OK	OK	OK	OK		1.5	7.6		2/26	1.0	7.2			
10	OK	33	90%	22	OK	OK	OK	OK	OK	OK		0.3	7.2	เพิ่มคลอรีน 1 ลิ	2/26	1.5	7.2			
11	OK	33	90%	22	OK	OK	OK	OK	OK	OK		1.5	7.6		2/27	1.5	6.8			
12	OK	33	90%	22	OK	OK	OK	OK	OK	OK		1.5	6.8	ลดคลอรีน, เพิ่มค่า PH	2/26	1.5	6.8			
13	OK	33	90%	23	OK	OK	OK	OK	OK	OK		1.5	6.8		2/26	1.5	6.8			
14	OK	30	90%	22	OK	OK	OK	OK	OK	OK		1.5	6.8	เพิ่มค่า PH	2/26	1.0	6.8			
15	OK	29	90%	22	OK	OK	OK	OK	OK	OK		1.0	7.2	เพิ่มคลอรีน 1/3 ของ 2 ลิ	2/26	1.0	6.8			
16	OK	30	90%	23	OK	OK	OK	OK	OK	OK		2.0	7.2	ลดคลอรีน	2/26	1.5	7.2			
17	OK	30	90%	23	OK	OK	OK	OK	OK	OK		1.5	6.8	เพิ่มค่า PH	2/27	1.0	7.2			
18	OK	30	90%	23	OK	OK	OK	OK	OK	OK		1.5	6.8	เพิ่มค่า PH	2/27	1.5	7.2			
19	OK	30	90%	23	OK	OK	OK	OK	OK	OK		1.5	6.8	เพิ่มค่า PH	2/27	0.5	6.8	เพิ่ม CL ดริบ 1 ลิ		
20	OK	29	80%	23	OK	OK	OK	OK	OK	OK		2.5	6.8	เพิ่มค่า PH, ลดคลอรีน	2/26	1.5	6.8			
21	OK	29	80%	22	OK	OK	OK	OK	OK	OK		2.5	6.8	เพิ่มค่า PH	2/26	1.0	6.8			
22	OK	28	90%	23	OK	OK	OK	OK	OK	OK		1.5	6.8	เพิ่มค่า PH	2/26	0.5	6.8	เพิ่ม CL 1 ลิ 90%		
23	OK	28	90%	22	OK	OK	OK	OK	OK	OK		1.5	7.2	ลดคลอรีน	2/26	1.5	7.2			
24	OK	28	90%	22	OK	OK	OK	OK	OK	OK		3.0	6.8	เพิ่มค่า PH	2/27	1.5	7.2			
25	OK	28	90%	22	OK	OK	OK	OK	OK	OK		1.5	6.8	เพิ่มค่า PH	2/27	0.5	7.2			
26	OK	27	90%	23	OK	OK	OK	OK	OK	OK		1.0	7.2	เพิ่ม CL 1/3 ของ 2 ลิ, เพิ่มค่า PH	2/26	1.5	7.2			
27	OK	27	100%	23	OK	OK	OK	OK	OK	OK		1.5	7.2	เพิ่มค่า PH	2/26	1.5	7.2			
28	OK	27	100%	22	OK	OK	OK	OK	OK	OK		2.0	7.2	เพิ่มค่า PH	2/26	1.0	7.2			
29	OK	27	100%	22	OK	OK	OK	OK	OK	OK		1.0	7.2	เพิ่ม CL 1 ลิ 5 ลิ	2/26	1.0	7.2			
30	OK	27	100%	22	OK	OK	OK	OK	OK	OK		1.5	6.8	เพิ่มค่า PH	2/27	0.5	7.2	เพิ่ม CL 2 ลิ 3 ลิ		
31	OK	27	100%	22	OK	OK	OK	OK	OK	OK		3.0	7.8		2/27	3.0	7.2			

วันที่	รอบเช้า(เปิดสระ)												รอบบ่าย(เปิดสระ)						หมายเหตุ		
	สภาพ กระเบื้องปู	ความ เข้มข้นของ เกลือ	ระดับน้ำ ในถังพัก	แรงดันถัง กรองที่ 1	แรงดันถัง กรองที่ 2	ตะกร้า หน้าปั๊ม	การ ทำงานปั๊ม ที่ 1	การ ทำงานปั๊ม ที่ 2	การ ทำงาน ปั๊มจุกช่อง	การ ทำงาน น้ำตก	การ ทำงาน พัดลมกรอง	การ รวบเข็ม	สภาพ ห้องปั๊ม	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL		ค่า PH	การปรับสภาพน้ำ
1	OK	33	100%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	3.0	7.6	เติม PH	ขำจ	0.5	7.2	เติม CL 2 ส่วน 3	
2	OK	33	100%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	3.0	7.6	เติม PH	ขำจ	1.0	6.4	เติม CL 1 ส่วน 3 กว	
3	OK	33	100%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	3.0	7.6	ทำน้ำยาสี 0.10 ส่วน	ขำจ				
4	OK	33	100%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	3.0	7.8	เติม PH	ขำจ	0.0	7.2		
5	OK	33	100%	12	14	OK	OK	OK	OK	OK	OK	OK	OK	0.0	7.2	เติม PH, ทรายในถัง	ขำจ	2.0	7.2		
6	OK	33	40%	7	8	OK	OK	OK	OK	OK	OK	OK	OK	0.5	7.2	ทรายในถัง 1/2 ของถัง	ขำจ	1.5	7.2		
7	OK	33	40%	7	8	OK	OK	OK	OK	OK	OK	OK	OK	0.5	7.2	เติม CL	ขำจ	0.5	6.8	เติม CL 1/2 กว	
8	OK	33	80%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	1.0	7.2		ขำจ	4.0	7.2	เติม CL	
9	OK	33	80%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	0.2	7.2	เติม CL	ขำจ	-	-		
10	OK	33	80%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	1.5	6.8	เติม PH	ขำจ	0.5	7.6	เติม CL ทรายในถัง	
11	OK	33	80%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	1.5	7.6		ขำจ	3.0	7.6	เติม CL ทรายในถัง	
12	OK	33	30%	10	11	OK	OK	OK	OK	OK	OK	OK	OK	1.0	7.8	เติม PH ทราย	ขำจ	0.3	7.6	เติม CL 1/2 ของถัง	
13	OK	33	100%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	2.5	7.2	ทรายในถัง	ขำจ	1.5	7.6	เติม CL 1/2 ของถัง	
14	OK	33	80%	8	8	OK	OK	OK	OK	OK	OK	OK	OK	0.3	7.2	เติม CL 10%	ขำจ	3.0	7.6		
15	OK	33	80%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	1.0	6.8	เติม PH ทรายในถัง	ขำจ	3.0	7.2		
16	OK	33	80%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	3.0	7.6		ขำจ	1.5	7.2		
17	OK	33	80%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	1.5	7.6	ทรายในถัง	ขำจ	1.5	7.2		
18	OK	33	80%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	1.5	7.6		ขำจ	0.3	7.2	เติม CL 2 ส่วน 3 กว	
19	OK	33	80%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	2.5	7.2	ทรายในถัง	ขำจ	1.5	7.2		
20	OK	33	100%	11	11	OK	OK	OK	OK	OK	OK	OK	OK	0.3	7.2	เติมทรายในถัง 4 ส่วน	ขำจ	1.0	7.2		
21	OK	33	70%	18	18	OK	OK	OK	OK	OK	OK	OK	OK	0.3	7.2		ขำจ	0	7.2	เติม CL 1/2 กว	
22	OK	33	80%	18	18	OK	OK	OK	OK	OK	OK	OK	OK	3.0	7.2		ขำจ	1.0	7.2		
23	OK	33	80%	11	12	OK	OK	OK	OK	OK	OK	OK	OK	0.0	7.2	เติม CL ทรายในถัง	ขำจ	3.0	7.2		
24	OK	33	100%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	1.0	7.2	เติม CL 1/2 ของถัง	ขำจ	1.5	7.2		
25	OK	33	100%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	0.5	7.2	เติม CL	ขำจ	1.5	7.2		
26	OK	33	100%	11	12	OK	OK	OK	OK	OK	OK	OK	OK	0.3	7.2	เติม CL ทรายในถัง, ทราย	ขำจ	0.5	7.2		
27	OK	33	100%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	0.0	7.2	เติม CL ทรายในถัง	ขำจ	1.5	7.2		
28	OK	33	100%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	1.5	7.2		ขำจ	1.5	7.2		
29	OK	33	100%	11	10	OK	OK	OK	OK	OK	OK	OK	OK	0.2	7.2	เติม CL	ขำจ				
30																					
31																					

ไม่ใส่ทรายในถัง

ไม่ใส่ทรายในถัง

ไม่ใส่ทรายในถัง

ไม่ใส่ทรายในถัง

Month :

วันที่	สภาพสระ ทั่วไป	ความ เข้มข้นของ เกลือ	ระดับน้ำใน ถังพัก	แรงดันถัง กรอง	ตะกอนน้ำ ปริ่ม	การทำงาน ปริ่ม	การ ทำงานเป็น ปกติ	รอบเช้า(เปิดสระ)			ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	หมายเหตุ
								การล้าง เครื่องผลิต คลอรีน	การวัด คลอรีน	สภาพห้อง ปริ่ม									
1	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.6	เติม PH	2/2	0.5	7.2	เติม CL 2 ส่วน 3 ถัง		
2	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.6	เติม PH	2/2	1.5	7.2			
3	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	6.8		2/2					
4	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	6.8	เติม PH	2/2	3.0	6.8			
5	OK	24	100%	24	OK	OK	OK	OK	OK	OK	1.5	7.2		2/2	2.0	6.8			
6	OK	23	100%	22	OK	OK	OK	OK	OK	OK	1.5	7.2		2/2	1.0	7.2			
7	OK	23	100%	28	OK	OK	OK	OK	OK	OK	1.0	8.8	เติม PH	2/2	1.0	7.2			
8	OK	23	100%	28	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	0.3	7.2	เติม CL 3 ถัง		
9	OK	23	100%	28	OK	OK	OK	OK	OK	OK	3.0	7.6	เติมน้ำยา	2/2	-	-			ไม่ใส่น้ำยา
10	OK	23	100%	28	OK	OK	OK	OK	OK	OK	0.5	6.8	เติม CL 10%	2/2	1.5	7.6	ใส่กรดเกลือของถังกรอง		
11	OK	23	100%	28	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	0.3	7.2	เติม CL 3 ถัง		
12	OK	22	100%	28	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	0.5	7.8	เติม CL 3 / 1 ถัง 8 มอน		
13	OK	33	100%	28	OK	OK	OK	OK	OK	OK	3.0	7.8	ค่า PH 8	2/2	2.0	7.6			
14	OK	33	100%	25	OK	OK	OK	OK	OK	OK	1.5	7.2		2/2	1.5	7.8	เติมกรดเกลือ 3 L.		
15	OK	33	80%	25	OK	OK	OK	OK	OK	OK	0.5	7.2	เติม CL	2/2	3.0	7.2			
16	OK	33	80%	25	OK	OK	OK	OK	OK	OK	3.0	7.6	เติม CL	2/2	1.5	7.2			
17	OK	33	80%	25	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	0.3	7.2	เติม CL 2 ส่วน 3 ถัง		
18	OK	33	80%	25	OK	OK	OK	OK	OK	OK	7.0	7.6	เติมน้ำยา	2/2	0.5	7.2	เติม CL 1 ส่วน 3 ถัง		
19	OK	30	80%	24	OK	OK	OK	OK	OK	OK	2.0	7.6		2/2	0.3	7.2			
20	OK	29	80%	22	OK	OK	OK	OK	OK	OK	1.0	7.2	ใส่กรดเกลือ	2/2	1.0	7.2			
21	OK	28	100%	22	OK	OK	OK	OK	OK	OK	1.5	7.2		2/2	1.0	6.8			
22	OK	30	100%	22	OK	OK	OK	OK	OK	OK	0.5	7.2	เติม/เกลือ 5 ถัง	2/2	3.0	7.6			
23	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.2		2/2	3.0	7.2			
24	OK	33	100%	22	OK	OK	OK	OK	OK	OK	2.0	7.6	เติม/เกลือ, ค่าความเค็ม	2/2	2.0	7.2			
25	OK	33	100%	22	OK	OK	OK	OK	OK	OK	1.5	7.2		2/2	2.0	7.2			
26	OK	30	100%	24	OK	OK	OK	OK	OK	OK	1.5	7.2		2/2	0.5	7.6			
27	OK	33	100%	21	OK	OK	OK	OK	OK	OK	7.0	7.6	เติม/เกลือ, ค่าความเค็ม	2/2	3.0	7.6			
28	OK	33	100%	21	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	2.0	7.2			
29	OK	33	100%	21	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	2.0	7.2			
30	OK	33	100%	21	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	2.0	7.2			
31	OK	33	100%	21	OK	OK	OK	OK	OK	OK	3.0	7.6		2/2	2.0	7.2			

มีนาคม 68

Month: 1/3/68

วันที่	สภาพ สระทั่วไป	การ เข้าน้ำของ เกลือ	ระดับน้ำ ในถังพัก	แรงดันถัง กรองที่ 1	แรงดันถัง กรองที่ 2	ตรวจ หน้าบ่ม	รอบเช้า(เปิดสระ)						สภาพ ห้องบ่ม	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	หมายเหตุ
							การทำงาน ที่ 1	การทำงาน ที่ 2	ทำงาน บ่มจากชุด	ทำงาน น้ำตก	การทำงาน เครื่อง ผลิตคลอรีน	การวิ่ง										
1	OK	33	100%	11	10	OK	OK	off	OK	off	OK	OK	OK	1.5	7.2	เติม PH	ว.ว	1.0	7.2			
2	OK	33	100%	11		OK	OK	off	OK	off	OK	OK	OK	0.0	7.6	เติม CL	ว.ว	0.3	7.2	เติม CL ครึ่งถัง		
3																		1.0	7.2	เติม CL 1 ส่วน 3 ถัง		
4	OK	33	100%	4	6	OK	OK	off	Auto	off	OK	OK	OK	2.0	7.2		ว.ว	1.5	7.2			
5	OK	33	90%	5	6	OK	OK	off	Auto	off	OK	OK	OK	0.3	7.2	เติม CL 1/2 ถัง	ว.ว	2.0	7.2			
6	OK	33	100%	5	6	OK	OK	off	Auto	off	OK	OK	OK	0.3	7.2	เติม CL 1/2 ถัง	ว.ว	1.5	7.2			
7	OK	33	100%	7	6	OK	OK	off	Auto	off	OK	OK	OK	0.5	6.8		ว.ว	1.0	7.2			
8	OK	33	100%	7	6	OK	OK	off	Auto	off	OK	OK	OK	0	7.2	เติม CL 1/2 ถัง	ว.ว	1.5	7.2			
9	OK	33	100%	7	6	OK	OK	off	Auto	off	OK	OK	OK	3.0	7.2		ว.ว	1.0	7.2			
10	OK	33	100%	11	10	OK	OK	off	Auto	off	OK	OK	OK	2.2	7.2	พักเวลา 10:00-11:00	ว.ว	3.0	7.2			
11	OK	33	100%	15	14	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2		ว.ว	1.5	7.2	พักเวลา 11:00-12:00		
12	OK	33	100%	13	12	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2	พักเวลา 12:00-13:00	ว.ว	0.5	7.2			
13	OK	33	100%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	2.0	7.2		ว.ว	1.0	6.4	เติม CL 1 ส่วน 3 ถัง		
14	OK	33	100%	15	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2		ว.ว	1.5	7.2			
15	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	0	7.2	เติม CL 1/2 ถัง	ว.ว	3.0	7.2			
16	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม CL ครึ่งถัง	ว.ว	1.5	7.2			
17	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	1.5	7.2	เติม PH	ว.ว	1.5	7.2			
18	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	0.3	6.8		ว.ว	1.5	7.2			
19	OK	33	100%	14	15	OK	OK	OK	Auto	off	OK	OK	OK	0	7.2	เติม CL 1/2 ถัง + 100%	ว.ว					
20	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2	พักเวลา 13:00-14:00	ว.ว	3.0	7.2			
21	OK	33	100%	14	15	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2		ว.ว	1.0	7.2	เติม CL 1 ส่วน 3		
22	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	6.8	พักเวลา	ว.ว	1.5	7.2			
23	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2	เติม CL	ว.ว	3.0	7.2			
24	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม PH	ว.ว	1.5	7.2			
25	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	0.3	7.2	เติม CL 1/2 ถัง	ว.ว	2.5	7.2	พักเวลา 14:00-15:00		
26	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	2.0	7.2	พักเวลา 15:00-16:00	ว.ว					
27	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2	เติม CL ครึ่งถัง + 100%	ว.ว	3.0	7.2			
28	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม CL 1/2 ถัง	ว.ว	1.5	7.2			
29	OK	33	100%	13	12	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2	พักเวลา	ว.ว	1.5	7.2			
30	OK	33	100%	13	12	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2	เติม CL	ว.ว	3.0	6.4			
31	OK	33	100%	13	12	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2		ว.ว	1.0	7.2			

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

จุดตรวจ

Grand Kata VIP.

Engineer Depratment.

Swimming Pool Check Lists.

Building B.

Month :

1 / 3 / 68

รอบบ่าย(เปิดสระ)

วันที่	สภาพสระ ทั่วไป	การ เก็บขึ้นของ เกลือ	ระดับน้ำใน ถังพัก	แรงดันถัง กรอง	ค่าความเป็น กรด/ด่าง	การทำงาน ปั๊ม	การ ทำงานเป็น จากชุด	การกรอง เครื่องผลิต คลอรีน	การรีไซเคิล	สภาพห้อง ปั๊ม	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	หมายเหตุ
1	OK	33	90%	21	OK	OK	OK	OK	OK	OK	3.0	7.2	เติม PH	ชว	1.5	7.2		ชว	ไม่มีหมายเหตุ
2	OK	33	90%	21	OK	OK	OK	OK	OK	OK	1.5	7.6	เติม 0.05% / ชว	ชว	0.5	7.2	เติม CL 2 ส่วน 3 ถัง	ชว	
3															1.0	7.2	เติม CL 1 ส่วน 3 ถัง	ชว	
4	OK	33	100%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม 10% 10 ลิตร	ชว	1.5	7.2		ชว	
5	OK	33	100%	22	OK	OK	Auto	OK	OK	OK	1.0	7.2	Back Wash หัวกรอง	ชว	1.0	7.2		ชว	
6	OK	33	90%	22	OK	OK	Auto	OK	OK	OK	0.3	7.2	เติม CL 1 ส่วน 3 ถัง	ชว	3.0	7.2		ชว	เปิดสระ
7	OK	33	90%	20	OK	OK	Auto	OK	OK	OK	3.0	7.2	ทำความสะอาด-หัวกรอง	ชว	3.0	7.2		ชว	
8	OK	33	90%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2		ชว	1.5	7.2		ชว	
9	OK	33	90%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2		ชว	3.0	7.2		ชว	
10	OK	33	90%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2		ชว	1.5	7.2		ชว	
11	OK	31	90%	23	OK	OK	Auto	OK	OK	OK	3.0	7.6	Back Wash หัวกรอง	ชว	2.0	7.6		ชว	
12	OK	29	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.6		ชว	1.5	7.6		ชว	
13	OK	30	100%	24	OK	OK	Auto	OK	OK	OK	1.0	7.8	เติมเกลือ 10 ลิตร	ชว	3.0	7.2		ชว	เปิดสระ
14	OK	30	90%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม CL 10 ลิตร	ชว	3.0	7.2		ชว	
15	OK	30	90%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2		ชว	3.0	7.2		ชว	
16	OK	30	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.2	เติม 10 ลิตร	ชว	1.5	7.2		ชว	
17															1.5	7.2		ชว	
18	OK	36	100%	24	OK	OK	OK	OK	OK	OK	6.8	2.0		ชว	1.5	7.2		ชว	เปิดสระ
19	OK	38	60%	24	OK	OK	OK	OK	OK	OK	1.0	7.2	ทำความสะอาด-หัวกรอง	ชว				ชว	
20	OK	38	100%	24	OK	OK	OK	OK	OK	OK	3.0	7.2		ชว	3.0	7.2		ชว	
21	OK	37	60%	24	OK	OK	OK	OK	OK	OK	3.0	7.2		ชว	3.0	6.8		ชว	
22	OK	26	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.2		ชว	3.0	6.8		ชว	
23	OK	26	50%	22	OK	OK	OK	OK	OK	OK	3.0	7.2	เติม PH	ชว	1.5	7.2		ชว	
24	OK	26	70%	22	OK	OK	OK	OK	OK	OK	3.0	7.2	เติม PH	ชว	1.5	7.2		ชว	
25	OK	22	100%	22	OK	OK	OK	OK	OK	OK	2.0	7.2		ชว	2.0	7.2		ชว	
26	OK	22	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.2		ชว				ชว	
27	OK	24	100%	22	OK	OK	OK	OK	OK	OK	1.5	7.2	เติมเกลือ 3 ลิตร CL 10 ลิตร	ชว	1.5	7.2		ชว	
28	OK	24	70%	22	OK	OK	OK	OK	OK	OK	3.0	7.2	ทำความสะอาด	ชว	1.5	7.2		ชว	
29	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.2		ชว	3.0	7.2		ชว	
30	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.2	ทำความสะอาด	ชว	3.0	7.2		ชว	
31	OK	33	100%	22	OK	OK	OK	OK	OK	OK	3.0	7.2		ชว	1.5	6.8		ชว	

Month : 621978425 68

Month :

รอบเช้า(เปิดสระ)															รอบบ่าย(เปิดสระ)					หมายเหตุ	
วันที่	สภาพ ตรวจทั่วไป	ความ เข้มข้นของ เกลือ	ระดับน้ำ ในถังพัก	แรงดันถัง กรองที่ 1	แรงดันถัง กรองที่ 2	ตะกั่ว หน้าปั๊ม	การ ทำงานปั๊ม ที่ 1	การ ทำงานปั๊ม ที่ 2	การ ทำงานห บีมจากชุดซี	การ ทำงานปั๊ม น้ำตก	การทำงาน ผลิตคลอรีน	การวัดซีม	สภาพ ห้องปั๊ม	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL	ค่า PH		การปรับสภาพน้ำ
1	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	3.0	7.2		ผู้วิห.	2.0	7.2		
2	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	0.3	7.2	เติม CL 2 ลิตร	ผู้วิห.	2.5	7.2	ยังไม่มาก	ผู้วิห.
3	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.5	7.2		ผู้วิห.	3.0	7.2		
4	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.5	7.2	จุดลง	ผู้วิห.	1.0	7.2	เติม CL 1 ลิตร 3 ลิตร	
5	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.5	7.2		ผู้วิห.	0.5	7.2	เติม CL 1 ลิตร 3 ลิตร	
6	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	2.0	7.2	จุดลง	ผู้วิห.	0.5	7.2	เติม CL 2 ลิตร 3 ลิตร	
7	ok	33	50%	10	8	ok	ok	ok	Auto off	ok	ok	ok	ok	3.0	7.2		ผู้วิห.	3.0	7.2		
8	ok	33	100%	12	11	ok	ok	ok	Auto off	ok	ok	ok	ok	1.0	7.2	เติม CL 1/3 ลิตร	ผู้วิห.	1.5	7.2		
9	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	0.5	7.2	จุดลง	ผู้วิห.	2.0	7.2	เติม CL 1 ลิตร 3 ลิตร	
10	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	2.5	7.2	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	0.5	7.2	เติม CL 2 ลิตร 3 ลิตร	
11	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.5	7.6	จุดลง	ผู้วิห.	1.5	7.2		
12	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.5	7.6	จุดลง	ผู้วิห.	1.0	7.2	เติม CL 1 ลิตร 3 ลิตร	
13	ok	33	50%	12	13	ok	ok	ok	Auto off	ok	ok	ok	ok	2.0	7.2		ผู้วิห.	1.0	7.2	เติม CL 2 ลิตร 3 ลิตร	
14	ok	33	100%	12	14	ok	ok	ok	Auto off	ok	ok	ok	ok	1.5	7.2	จุดลง	ผู้วิห.	0.3	7.2	เติม CL 2 ลิตร 3 ลิตร	
15	ok	33	80%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	3.0	7.2	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	0.5	7.2	เติม CL 2 ลิตร 3 ลิตร	
16	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	0.0	7.2	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	1.0	7.2	เติม CL 1 ลิตร 3 ลิตร	
17	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	2.5	7.2	เติม CL 1 ลิตร 3 ลิตร	ผู้วิห.	0.5	7.2	เติม CL 1 ลิตร 3 ลิตร	
18	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.5	7.2		ผู้วิห.	1.5	7.2		
19	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	0.2	7.2	เติม CL 1 ลิตร 3 ลิตร	ผู้วิห.	1.0	7.2	เติม CL 1 ลิตร 3 ลิตร	
20	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	2.0	7.2	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	0.3	7.2	เติม CL 2 ลิตร 3 ลิตร	
21	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	3.0	7.2	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	0.5	6.6	เติม CL 2 ลิตร 3 ลิตร	
22	ok	33	60%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	2.0	7.2	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	1.0	7.2	เติม CL 2 ลิตร 3 ลิตร	
23	ok	33	80%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	0.0	7.6	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	2.5	7.2	เติม CL 2 ลิตร 3 ลิตร	
24	ok	33	80%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	2.5	7.6	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	1.5	7.6	เติม CL 2 ลิตร 3 ลิตร	
25	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.0	7.2	เติม CL	ผู้วิห.	3.0	7.2		
26	ok	33	100%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	3.0	8.8		ผู้วิห.	1.0	7.2		
27	ok	33	70%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	0.0	7.2	เติม CL 2 ลิตร 3 ลิตร	ผู้วิห.	1.5	7.2		
28	ok	33	80%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	1.0	7.2	เติม CL	ผู้วิห.	1.0	6.8	เติม CL 1.0% 8.8 ลิตร	
29	ok	33	50%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	2.5	7.2		ผู้วิห.	1.0	6.8		
30	ok	33	80%	12	12	ok	ok	ok	Auto off	ok	ok	ok	ok	0.5	6.8		ผู้วิห.				
31																					

Month : 621714 2568

รอบบ่าย(ปิดสระ)

วันที่	สภาพสระทั่วไป	รอบเช้า(เปิดสระ)										รอบบ่าย(เปิดสระ)					หมายเหตุ	
		ความเข้มข้นของเกลือ	ระดับน้ำในถังพัก	แรงสับถังกรอง	ตะกร้าหน้าบีม	การทำงานของบีม	การทำงานของจากชุดซี	การทำงานของจากถังรีน	การรวบเข็ม	สภาพห้องบีม	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL	ค่า PH		การปรับสภาพน้ำ
1	ok	33	100%	22	ok	ok	Auto	ok	ok	ok	3.0	7.2		ผู้ตรวจ	2.0	7.2	น้ำใสแล้ว	
2	ok	33	90%	22	ok	ok	Auto	ok	ok	ok	3.0	7.2		ผู้ตรวจ	3.0	7.2		
3	ok	33	70%	22	ok	ok	Auto	ok	ok	ok	3.0	7.2	ดูอาการ	ผู้ตรวจ	3.0	7.2		
4	OK	33	70%	22	OK	OK	Auto	OK	OK	OK	3.0	7.6		ผู้ตรวจ	1.5	7.2		
5	ok	33	70%	22	ok	ok	Auto	ok	ok	ok	3.0	7.6			3.0	6.8		
6	OK	29	80%	24	ok	ok	Auto	OK	OK	OK	3.0	6.8	เติมค่า PH	ผู้ตรวจ	3.0	6.8		
7	OK	29	70%	24	ok	ok	Auto	OK	OK	OK	3.0	7.2	ดูอาการ	ผู้ตรวจ	3.0	6.8		
8	OK	25	100%	23	ok	ok	Auto	OK	OK	OK	3.0	7.2	น้ำใสแล้ว	ผู้ตรวจ	3.0	6.8		
9	OK	25	100%	22	OK	ok	Auto	OK	OK	OK	3.0	7.2	เติมค่า PH	ผู้ตรวจ	3.0	7.2		
10	OK	25	100%	22	OK	OK	Auto	OK	OK	OK	1.5	7.2	ดูอาการ	ผู้ตรวจ	1.0	7.2	เติม CL 1 ส่วน 3 ถัง	
11	OK	22	100%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2		ผู้ตรวจ	3.0	6.8		
12	OK	25	100%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2	น้ำใสแล้ว	ผู้ตรวจ	1.5	7.2		
13	OK	23	100%	24	OK	OK	Auto	OK	OK	OK	1.5	7.2	ดูอาการ	ผู้ตรวจ	0.5	7.2	เติม CL 2 ส่วน 3 ถัง	
14	OK	22	100%	22	OK	OK	Auto	OK	OK	OK	3.0	7.6		ผู้ตรวจ	1.5	7.2		
15	OK	22	100%	22	OK	OK	Auto	OK	OK	OK	2.0	7.2	เติมค่า PH	ผู้ตรวจ	1.5	7.2		
16	OK	22	100%	22	OK	OK	Auto	OK	OK	OK	1.0	7.2	เติม CL 1 ส่วน 3 ถัง	ผู้ตรวจ	1.5	7.2		
17	OK	22	100%	22	OK	OK	Auto	OK	OK	OK	2.0	7.2	น้ำใสแล้ว	ผู้ตรวจ	1.0	6.8	เติม CL 1 ส่วน 3 ถัง	
18	OK	22	100%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH	ผู้ตรวจ	0.5	6.8	เติม CL 1 ส่วน 3 ถัง	
19	OK	22	100%	22	OK	OK	Auto	OK	OK	OK	3.0	7.2		ผู้ตรวจ	1.0	7.2		
20	OK	29	80%	24	OK	OK	Auto	OK	OK	OK	1.0	7.2		ผู้ตรวจ	0.3	7.2	เติม CL 2 ส่วน 3 ถัง	
21	OK	19	80%	20	OK	OK	Auto	OK	OK	OK	3.0	7.2	ดูอาการ	ผู้ตรวจ	1.0	6.8	เติม CL 1 ส่วน 3 ถัง	
22	OK	16	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2		ผู้ตรวจ	1.5	7.2	เติม CL 10% น้ำดื่ม	
23	OK	18	80%	24	OK	OK	Auto	OK	OK	OK	3.5	7.2		ผู้ตรวจ	1.5	7.2		
24	OK	16	80%	24	OK	OK	Auto	OK	OK	OK	1.5	7.2	ดูอาการ	ผู้ตรวจ	0.5	7.2	เติม CL 2 ส่วน 3 ถัง	
25	OK	16	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.6		ผู้ตรวจ	1.5	7.2		
26	OK	16	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.6		ผู้ตรวจ	1.0	7.2		
27	OK	16	80%	24	OK	OK	Auto	OK	OK	OK	2.0	7.2	ดูอาการ	ผู้ตรวจ	1.0	7.2		
28	OK	16	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.6		ผู้ตรวจ	1.0	7.2	เติม CL 10% น้ำดื่ม	
29	OK	14	80%	24	OK	OK	Auto	OK	OK	OK	1.5	7.2		ผู้ตรวจ	0.5	6.8	เติม CL 10% น้ำดื่ม	
30	OK	14	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2		ผู้ตรวจ				
31																		

Month : พฤษภาคม ๖๕

วันที่	รอบเช้า(เปิดสระ)													รอบบ่าย(ปิดสระ)					หมายเหตุ		
	สภาพสระทั่วไป	ความเข้มข้นของเกลือ	ระดับน้ำในถังพัก	แรงดันถึงกรองที่ 1	แรงดันถึงกรองที่ 2	กะกรื่อน้ำขึ้น	การทำงานที่ 1	การทำงานที่ 2	การทำงานที่ 3 จากตู้ซี	การทำงานที่ 4 จากตู้	เครื่องผลิตคลอรีน	การรวบเข็ม	สภาพห้องเก็บ	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ	ค่า CL		ค่า PH	การปรับสภาพน้ำ
1	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	1.0	6.8	เติม CL 1 ส่วน 3 กว	ชว.ชบ	2.0	7.2	ตัวโมบาว	ชว.ชบ
2	OK	33	95%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8		ชว.ชบ	0.5	7.2		ชว.ชบ
3	OK	33	95%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	0.3	7.2	เติม CL 2 ส่วน 3 กว	ชว.ชบ	1.0	7.2		ชว.ชบ
4	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม CL 3 ส่วน 10 กว	ชว.ชบ	0.5	7.2		ชว.ชบ
5	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม CL	ชว.ชบ	0.5	7.2		ชว.ชบ
6	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	0.5	6.8	เติม CL + PH	ชว.ชบ	2.0	6.8		ชว.ชบ
7	OK	33	100%	13	13	OK	OK	OK	Auto	off	OK	OK	OK	2.0	7.2		ชว.ชบ	1.5	7.2		ชว.ชบ
8	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม PH 3 ส่วน 10 กว	ชว.ชบ	1.5	7.2		ชว.ชบ
9	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2	เติม PH	ชว.ชบ	2.0	7.2		ชว.ชบ
10	OK	0	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	0.3	7.2	เติม CL 1 ส่วน 3 กว	ชว.ชบ	3.0	7.2		ชว.ชบ
11	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	6.8	เติม PH 3 ส่วน 10 กว	ชว.ชบ	2.0	7.2		ชว.ชบ
12	OK	33	100%	12	13	OK	OK	OK	Auto	off	OK	OK	OK	1.5	1.8	เติม CL 1 ส่วน 3 กว	ชว.ชบ	3.0	7.2		ชว.ชบ
13	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	1.5	7.2	เติม CL 1 ส่วน 3 กว	ชว.ชบ	1.5	6.8		ชว.ชบ
14	OK	33	100%	19	19	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2	เติม CL 1 ส่วน 3 กว	ชว.ชบ	1.0	7.2		ชว.ชบ
15	OK	33	100%	13	13	OK	OK	OK	Auto	off	OK	OK	OK	0.5	7.2	เติม CL 1 ส่วน 3 กว	ชว.ชบ	2.0	7.2	เติม CL ก่อนนอน	ชว.ชบ
16	OK	33	100%	12	12	OK	OK	OK	Auto	off	OK	OK	OK	1.5	7.2		ชว.ชบ	3.0	7.2		ชว.ชบ
17	OK	33	100%	13	13	OK	OK	OK	Auto	off	OK	OK	OK	1.5	7.2		ชว.ชบ	2.0	7.2		ชว.ชบ
18	OK	33	100%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2		ชว.ชบ	2.5	7.2		ชว.ชบ
19	OK	33	80	12	12	OK	OK	OK	Auto	off	OK	OK	OK	1.5	7.2	เติม CL 1 ส่วน 3 กว	ชว.ชบ	1.5	7.2		ชว.ชบ
20	OK	33	80	13	12	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.6	เติม CL 1 ส่วน 3 กว	ชว.ชบ	2.5	7.2		ชว.ชบ
21	OK	33	80%	13	13	OK	OK	OK	Auto	off	OK	OK	OK	1.5	7.2		ชว.ชบ	1.5	7.2		ชว.ชบ
22	OK	33	80%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8	เติม PH 1 ส่วน 10 CL กว	ชว.ชบ	1.5	7.2		ชว.ชบ
23	OK	33	80%	14	14	OK	OK	OK	Auto	off	OK	OK	OK	1.5	7.2		ชว.ชบ	1.0	7.2		ชว.ชบ
24	OK	33	100%	16	16	OK	OK	OK	Auto	off	OK	OK	OK	0.5	6.8	เติม PH 1 ส่วน 10 CL กว	ชว.ชบ	3.0	7.2		ชว.ชบ
25	OK	33	100%	13	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2		ชว.ชบ	3.0	7.2		ชว.ชบ
26	OK	33	100%	13	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	6.8	เติม PH	ชว.ชบ	2.0	7.2		ชว.ชบ
27	OK	33	90%	13	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2	เติม CL 90% 5 กว	ชว.ชบ	1.5	7.2		ชว.ชบ
28	OK	33	90%	15	15	OK	OK	OK	Auto	off	OK	OK	OK	1.0	7.2		ชว.ชบ	0.3	7.2	เติม CL 2.5 ส่วน 3	ชว.ชบ
29	OK	33	90%	15	15	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8		ชว.ชบ				ชว.ชบ
30	OK	33	90%	12	13	OK	OK	OK	Auto	off	OK	OK	OK	1.5	6.8		ชว.ชบ	0.3	7.2	เติม CL ก่อนนอน	ชว.ชบ
31	OK	33	95%	13	14	OK	OK	OK	Auto	off	OK	OK	OK	3.0	7.2		ชว.ชบ	3.0	7.2		ชว.ชบ

Grand Kata VIP.

Engineer Department.

Swimming Pool Check Lists.

Building B.

Month : พฤษภาคม 66.

วันที่	รอบเช้า(ปีละครั้ง)										รอบบ่าย(ปีละครั้ง)					หมายเหตุ
	สภาพสระ ทั่วไป	ความ เข้มข้นของ เกลือ	ระดับน้ำใน ถังพัก	แรงดันถัง กรอง	ตะกอนน้ำ ที่ม	การทำงานของ ปั๊ม	การทำงานของ เครื่องผลิต คลอรีน	การทำงานของ เครื่องรีไซเคิล	การทำงานของ เครื่องรีไซเคิล	ค่า CL	ค่า PH	ค่า CL	ค่า PH	ค่า CL	ค่า PH	
1	OK	14	95%	24	OK	OK	Auto	OK	OK	OK	3.0	6.8	เติม CL 2 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
2	OK	25	95%	25	OK	OK	Auto	OK	OK	OK	1.5	6.8	เติม CL 1 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
3	OK	19	100%	25	OK	OK	Auto	OK	OK	OK	0.3	7.2	เติม CL 2 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
4	OK	0	100%	26	OK	OK	Auto	OK	OK	OK	0.5	6.8	เติม CL 1 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
5	OK	10	100%	22	OK	OK	Auto	OK	OK	OK	0.5	7.2	เติม CL 1 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
6	OK	10	100%	22	OK	OK	Auto	OK	OK	OK	0.3	7.6	เติม CL 1 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
7	OK	0	100%	25	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
8	OK	0	90%	24	OK	OK	Auto	OK	OK	OK	3.0	6.8	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
9	OK	10	90%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
10	OK	15	90%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
11	OK	15	90%	24	OK	OK	Auto	OK	OK	OK	1.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
12	OK	15	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.6	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
13	OK	0	80%	24	OK	OK	Auto	OK	OK	OK	1.5	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
14	OK	0	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
15	OK	0	80%	25	OK	OK	Auto	OK	OK	OK	1.5	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
16	OK	13	80%	25	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
17	OK	13	95%	25	OK	OK	Auto	OK	OK	OK	3.0	7.6	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
18	OK	27	80%	24	OK	OK	Auto	OK	OK	OK	1.5	7.6	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
19	OK	33	80%	24	OK	OK	Auto	OK	OK	OK	3.0	7.6	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
20	OK	0	70%	23	OK	OK	Auto	OK	OK	OK	3.0	7.6	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
21	OK	0	90%	24	OK	OK	Auto	OK	OK	OK	1.5	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
22	OK	0	90%	24	OK	OK	Auto	OK	OK	OK	1.0	7.6	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
23	OK	0	100%	24	OK	OK	Auto	OK	OK	OK	0.5	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
24	OK	29	100%	24	OK	OK	Auto	OK	OK	OK	1.5	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
25	OK	27	100%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
26	OK	22	100%	24	OK	OK	Auto	OK	OK	OK	3.0	6.8	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
27	OK	22	90%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
28	OK	0	90%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
29	OK	0	95%	24	OK	OK	Auto	OK	OK	OK	3.0	6.8	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
30	OK	0	95%	24	OK	OK	Auto	OK	OK	OK	3.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	
31	OK	26	95%	24	OK	OK	Auto	OK	OK	OK	1.0	7.2	เติม PH 5 ลิตร 3 กัง	เติม CL 1/3 ของถัง	เติม CL 1/3 ของถัง	

เฉลี่ย 5 กังต่อวัน

Month : มิถุนายน 2568

วันที่	รอบเช้า(เปิดสระ)													รอบบ่าย(ปิดสระ)					หมายเหตุ		
	สภาพสระทั่วไป	ความเข้มข้นของเกลือ	ระดับน้ำในถังพัก	แรงดันถังกรองที่ 1	แรงดันถังกรองที่ 2	ตะกั่วหน้าปั๊ม	การทำงานที่ 1	การทำงานที่ 2	การทำงานที่ 3 จากจุด	การทำงานที่ 4 จาก	เครื่องอิเล็กทรอนิกส์	การปรับ	สภาพห้องปั๊ม	ค่า CL	ค่า PH	การปรับสภาพน้ำ	ผู้ตรวจสอบ				
1	OK	33	80%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	1.5	7.2	ปกติ	พอ	0.5	6.6	เติม CL 1 ลิตร	
2	OK	33	80%	11	11	OK	OK	OK	Auto	Off	OK	OK	OK	3.0	7.2		พอ	1.5	6.6		
3	OK	33	60%	12	11	OK	OK	OK	Auto	Off	OK	OK	OK	1.5	7.2	เติมค่า PH	พอ	0.5	6.6	เติม CL 1 ลิตร	
4	OK	33	60%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	2.5	6.8	ปกติ, เติมน้ำ PH	พอ	3.0	7.2		
5	OK	37	60%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	1.5	7.2	น้ำใสกรวย	พอ	1.0	7.2	เติม CL 4 ลิตร	
6	OK	33	90%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	3.0	7.2	เติม PH	พอ	3.0	7.2		
7	OK	33	90%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	3.0	7.2	เติม PH	พอ	3.0	7.2		
8	OK	33	90%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	1.5	7.2	ปกติ, เติมน้ำ PH	พอ	1.5	7.2		
9	OK	33	90%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	1.0	7.2	เติม PH	พอ	2.0	7.2		
10	OK	37	100%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	3.0	7.2	ปกติ	พอ	3.0	6.6		
11	OK	33	90%	12	11	OK	OK	OK	Auto	Off	OK	OK	OK	1.5	7.2	น้ำใสกรวย	พอ	2.0	7.2		
12	OK	33	80%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	1.5	7.2	น้ำใสกรวย	พอ	0.0	7.2	เติม CL 2 ลิตร 3 ลิตร	
13	OK	33	80%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	3.0	7.2	เติม PH	พอ	3.0	7.2		
14	OK	33	80%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	3.0	7.6	เติม PH 1 ลิตร	พอ	1.0	6.6	เติม CL 1 ลิตร 3 ลิตร	
15	OK	33	80%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	3.0	7.6	เติม PH	พอ	1.5	7.2		
16	OK	33	10%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	0.5	6.8	ปกติ, เติมน้ำ PH, เติมน้ำ CL	พอ	1.5	7.2		
17	OK	33	60%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	1.0	7.2		พอ	1.5	7.2		
18	OK	33	60%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	0.3	7.2	เติม CL 1 ลิตร	พอ	1.5	7.2		
19	OK	37	60%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	1.0	7.2	เติม CL 1/3 ของน้ำ	พอ	1.5	7.2		
20	OK	33	60%	12	12	OK	OK	OK	Auto	Off	OK	OK	OK	0.5	7.2	ปกติ, เติมน้ำ CL 1/3	พอ				
21																					
22																					
23																					
24																					
25																					
26																					
27																					
28																					
29																					
30																					
31																					

ไม่ได้อยู่ในโซน 10 ตอน

Month :

[illegible]