

ภาคผนวก ง

ผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม



คุณภาพน้ำทิ้งของโครงการ



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668662 E 1529615 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/1
Sample Type : Wastewater
Sampling Date : 17 January 2025
Sampling Time : 03.45 p.m.
Received Date : 18 January 2025
Analytical Date : 18 - 29 January 2025
Report Date : 07 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	548
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	492
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	416
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.1
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	3.02
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	128
Sample Appearance		Black/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668673 E 1529627 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68006
Sample No. : W68006/2
Sample Type : Wastewater
Sampling Date : 17 January 2025
Sampling Time : 04.01 p.m.
Received Date : 18 January 2025
Analytical Date : 18 - 29 January 2025
Report Date : 07 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	6.9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	1,283
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	392
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	1,032
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.2
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	5.44
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	584
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668658 E 1529606 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/3
Sample Type : Wastewater
Sampling Date : 17 January 2025
Sampling Time : 03.54 p.m.
Received Date : 18 January 2025
Analytical Date : 18 - 29 January 2025
Report Date : 07 February 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	6.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	18.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	352	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	35.5	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.91	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	48.92	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668676 E 1529606 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/4
Sample Type : Wastewater
Sampling Date : 17 January 2025
Sampling Time : 04.07 p.m.
Received Date : 18 January 2025
Analytical Date : 18 - 29 January 2025
Report Date : 07 February 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	6.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	24.9	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	422	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	34.9	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.91	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	39.21	≤ 35
Sample Appearance		Yellow/ Turbid/ Sediment/ Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental
Quality Act, B.E. 2567 (2024). Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Analyst

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดตรวจวัดคุณภาพน้ำทั้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 668664 E 1529613 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/5
Sample Type : Wastewater
Sampling Date : 17 January 2025
Sampling Time : 04.11 p.m.
Received Date : 18 January 2025
Analytical Date : 18 - 29 January 2025
Report Date : 07 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	5.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	370	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	35.1	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.81	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	38.72	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668642 E 1529621 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68006
Sample No. : W68006/1
Sample Type : Wastewater
Sampling Date : 10 February 2025
Sampling Time : 02.10 p.m.
Received Date : 11 February 2025
Analytical Date : 11 – 24 February 2025
Report Date : 25 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	2107
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	184
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	125
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.01
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	99.84
Sample Appearance		Black/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668668 E 1529615 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/2
Sample Type : Wastewater
Sampling Date : 10 February 2025
Sampling Time : 02.26 p.m.
Received Date : 11 February 2025
Analytical Date : 11 – 24 February 2025
Report Date : 25 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.4 °C	-	Electrometric Method (4500-H ⁺ B)	6.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	4747
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	437
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	519
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	5.6
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	21.45
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	196
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668659 E 1529608 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/3
Sample Type : Wastewater
Sampling Date : 10 February 2025
Sampling Time : 01.58 p.m.
Received Date : 11 February 2025
Analytical Date : 11 – 24 February 2025
Report Date : 25 February 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.3 °C	-	Electrometric Method (4500-H ⁺ B)	6.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	12.1	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	418	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	17.3	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	22.76	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668666 E 1529610 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/4
Sample Type : Wastewater
Sampling Date : 10 February 2025
Sampling Time : 02.20 p.m.
Received Date : 11 February 2025
Analytical Date : 11 – 24 February 2025
Report Date : 25 February 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.9 °C	-	Electrometric Method (4500-H ⁺ B)	4.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	40.1	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	446	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	20.8	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	25.96	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental
Quality Act, B.E. 2567 (2024). Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดตรวจวัดคุณภาพน้ำที่ก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 668665 E 1529603 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/5
Sample Type : Wastewater
Sampling Date : 10 February 2025
Sampling Time : 02.37 p.m.
Received Date : 11 February 2025
Analytical Date : 11 – 24 February 2025
Report Date : 25 February 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.9 °C	-	Electrometric Method (4500-H ⁺ B)	4.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	38.8	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	458	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	18.8	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, part 4500-Norg B and part 4500-NH ₃ C	23.33	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo-197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668623 E 152935 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/1
Sample Type : Wastewater
Sampling Date : 10 March 2025
Sampling Time : 02.13 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 25 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	1175
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	312
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	135
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.3
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	2.85
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	95
Sample Appearance		Black/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

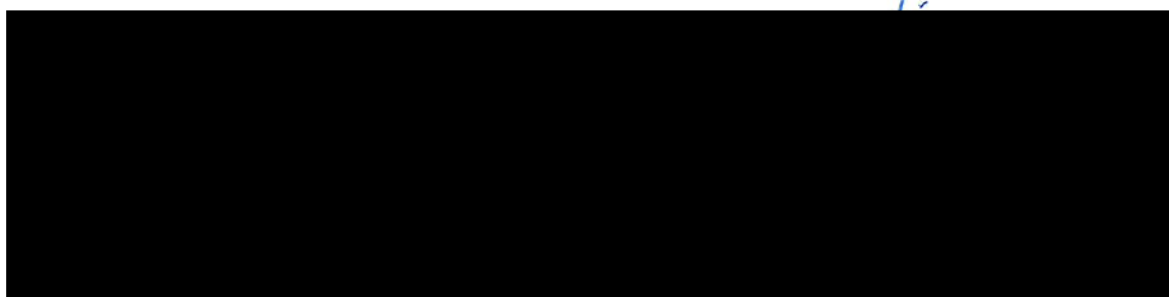

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668668 E 1529615 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/2
Sample Type : Wastewater
Sampling Date : 10 March 2025
Sampling Time : 02.35 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 25 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.8 °C	-	Electrometric Method (4500-H ⁺ B)	6.1
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	6030
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	1370
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	783
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	7.2
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	22.26
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	1,322
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.

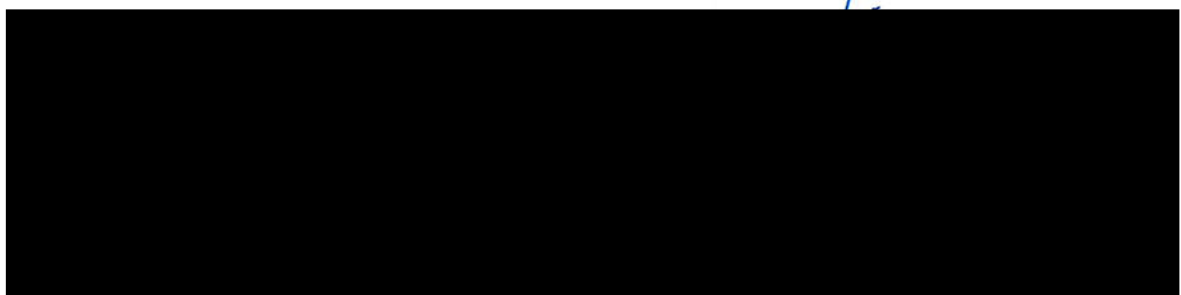

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668654 E 1529599 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/3
Sample Type : Wastewater
Sampling Date : 10 March 2025
Sampling Time : 02.10 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 25 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.6 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	12.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	484	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	15.5	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668675 E 1529619 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/4
Sample Type : Wastewater
Sampling Date : 10 March 2025
Sampling Time : 02.26 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 25 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.8 °C	-	Electrometric Method (4500-H ⁺ B)	4.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	32.1	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	462	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	14.4	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	8.4	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดตรวจวัดคุณภาพน้ำทั้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 668667 E 1529604 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/5
Sample Type : Wastewater
Sampling Date : 10 March 2025
Sampling Time : 02.46 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.5 °C	-	Electrometric Method (4500-H ⁺ B)	5.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	15.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	506	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	18.1	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	36	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668641 E 1529626 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/1
Sample Type : Wastewater
Sampling Date : 23 April 2025
Sampling Time : 03.46 p.m.
Received Date : 24 April 2025
Analytical Date : 24 April – 09 May 2025
Report Date : 09 May 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 26.1 °C	-	Electrometric Method (4500-H ⁺ B)	6.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	5025
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	721
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	1002
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	5.84
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	374
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

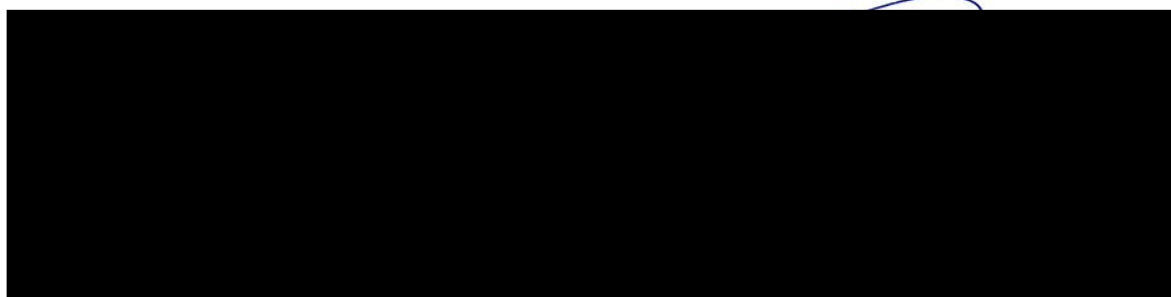

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668693 E 1529656 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/2
Sample Type : Wastewater
Sampling Date : 23 April 2025
Sampling Time : 03.43 p.m.
Received Date : 24 April 2025
Analytical Date : 24 April – 09 May 2025
Report Date : 09 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	337
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	376
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	43.2
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.21
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	56
Sample Appearance		White/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668668 E 1529609 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/3
Sample Type : Wastewater
Sampling Date : 23 April 2025
Sampling Time : 03.58 p.m.
Received Date : 24 April 2025
Analytical Date : 24 April – 09 May 2025
Report Date : 09 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.5 °C	-	Electrometric Method (4500-H ⁺ B)	6.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	14.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	406	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	26.3	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	3.1	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668654 E 1529611 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/4
Sample Type : Wastewater
Sampling Date : 23 April 2025
Sampling Time : 04.00 p.m.
Received Date : 24 April 2025
Analytical Date : 24 April – 09 May 2025
Report Date : 09 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.6 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	37.5	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	467	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	29.1	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	4.5	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดตรวจวัดคุณภาพน้ำทั้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 668664 E 1529602 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/5
Sample Type : Wastewater
Sampling Date : 23 April 2025
Sampling Time : 03.50 p.m.
Received Date : 24 April 2025
Analytical Date : 24 April – 09 May 2025
Report Date : 09 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.8 °C	-	Electrometric Method (4500-H ⁺ B)	6.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	457	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	15.6	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	3.9	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668642 E 1529621 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/1
Sample Type : Wastewater
Sampling Date : 21 May 2025
Sampling Time : 02.29 p.m.
Received Date : 22 May 2025
Analytical Date : 22 May – 06 June 2025
Report Date : 07 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	561
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	497
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test (5210 B), Azide Modification Method (4500-O C)	624
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.7
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	2.21
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	74
Sample Appearance		Black/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668668 E 1529615 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/2
Sample Type : Wastewater
Sampling Date : 21 May 2025
Sampling Time : 02.45 p.m.
Received Date : 22 May 2025
Analytical Date : 22 May – 06 June 2025
Report Date : 07 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.0 °C	-	Electrometric Method (4500-H ⁺ B)	6.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	1066
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	714
Biochemical Oxygen Demand *	mg/L	55 Day BOD Test (5210 B), Azide Modification Method (4500-O C)	334
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	5.8
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	5.54
Total Kjeldahl Nitrogen " 2/	mg/L	APHA:4500-Norg (B) ^{3/}	55
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668659 E 1529608 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/3
Sample Type : Wastewater
Sampling Date : 21 May 2025
Sampling Time : 02.59 p.m.
Received Date : 22 May 2025
Analytical Date : 22 May – 06 June 2025
Report Date : 07 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.9 °C	-	Electrometric Method (4500-H ⁺ B)	6.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	15.3	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	454	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-5 Day BOD Test (5210 B), Azide Modification Method (4500-O C) (4500-O G, 5210 B)	19.1	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	13	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคณาการชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668666 E 1529610 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/4
Sample Type : Wastewater
Sampling Date : 21 May 2025
Sampling Time : 03.14 p.m.
Received Date : 22 May 2025
Analytical Date : 22 May – 06 June 2025
Report Date : 07 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.9 °C	-	Electrometric Method (4500-H ⁺ B)	4.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	21.2	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	480	≤ 1,000
Biochemical Oxygen Demand *	mg/L	55 Day BOD Test (5210 B), Azide Modification Method (4500-O C) (4500-O G, 5210 B)	18.1	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	6.7	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดตรวจวัดคุณภาพน้ำทั้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 668665 E 1529603 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/5
Sample Type : Wastewater
Sampling Date : 21 May 2025
Sampling Time : 03.19 p.m.
Received Date : 22 May 2025
Analytical Date : 22 May – 06 June 2025
Report Date : 07 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.5 °C	-	Electrometric Method (4500-H ⁺ B)	5.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.9	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	382	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test (5210 B), Azide Modification Method (4500-O C)	15.6	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	3.9	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668642 E 1529621 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/1
Sample Type : Wastewater
Sampling Date : 25 June 2025
Sampling Time : 10.45 am.
Received Date : 26 June 2025
Analytical Date : 26 June – 04 July 2025
Report Date : 09 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	267
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	370
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	85.6
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.8
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.20
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	52
Sample Appearance		Grey/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668668 E 1529615 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/2
Sample Type : Wastewater
Sampling Date : 25 June 2025
Sampling Time : 10.57 a.m.
Received Date : 26 June 2025
Analytical Date : 26 June – 04 July 2025
Report Date : 09 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.6 °C	-	Electrometric Method (4500-H ⁺ B)	6.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	4,280
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	742
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	812
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	6.83
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	462
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย อาคาร 1
GPS. Coordinate : 47 P 668659 E 1529608 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/3
Sample Type : Wastewater
Sampling Date : 25 June 2025
Sampling Time : 10.41 a.m.
Received Date : 26 June 2025
Analytical Date : 26 June – 04 July 2025
Report Date : 09 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.1 °C	-	Electrometric Method (4500-H ⁺ B)	6.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.8	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	438	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C,5210 B)	12.9	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen " 2/	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



(Signature/Stamp area)

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดระบายน้ำออกจากกระบบบำบัดน้ำเสีย อาคาร 2
GPS. Coordinate : 47 P 668666 E 1529610 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/4
Sample Type : Wastewater
Sampling Date : 25 June 2025
Sampling Time : 10.51 a.m.
Received Date : 26 June 2025
Analytical Date : 26 June – 04 July 2025
Report Date : 09 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.2 °C	-	Electrometric Method (4500-H ⁺ B)	5.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	460	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	13.0	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	8.7	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : จุดตรวจวัดคุณภาพน้ำทิ้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 668665 E 1529603 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68006
Sample No. : W68006/5
Sample Type : Wastewater
Sampling Date : 25 June 2025
Sampling Time : 09.56 a.m.
Received Date : 26 June 2025
Analytical Date : 26 June – 04 July 2025
Report Date : 09 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	21.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	255	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	2.6	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



คุณภาพน้ำสระว่ายน้ำของโครงการ



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 668653 E 1529650 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/6
Sample Type : Swimming pool Water
Sampling Date : 17 January 2025
Sampling Time : 03.42 p.m.
Received Date : 18 January 2025
Analytical Date : 18 - 29 January 2025
Report Date : 30 January 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF., 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุศคลออาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 668662 E 1529638 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/7
Sample Type : Swimming pool Water
Sampling Date : 17 January 2025
Sampling Time : 03.42 p.m.
Received Date : 18 January 2025
Analytical Date : 18 - 29 January 2025
Report Date : 30 January 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 668658 E 1529644 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/6
Sample Type : Swimming pool Water
Sampling Date : 10 February 2025
Sampling Time : 01.52 p.m.
Received Date : 11 February 2025
Analytical Date : 11 – 24 February 2025
Report Date : 25 February 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF., 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 668664 E 1529650 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/7
Sample Type : Swimming pool Water
Sampling Date : 10 February 2025
Sampling Time : 01.53 p.m.
Received Date : 11 February 2025
Analytical Date : 11 – 24 February 2025
Report Date : 25 February 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 668654 E 1529628 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/6
Sample Type : Swimming pool Water
Sampling Date : 10 March 2025
Sampling Time : 02.05 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF., 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 668663 E 1529611 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/7
Sample Type : Swimming pool Water
Sampling Date : 10 March 2025
Sampling Time : 02.09 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

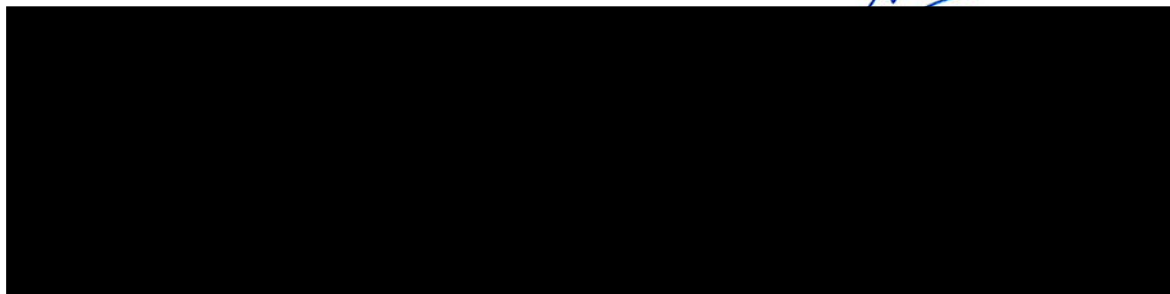ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 668647 E 1529631 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/6
Sample Type : Swimming pool Water
Sampling Date : 23 April 2025
Sampling Time : 03.42 p.m.
Received Date : 24 April 2025
Analytical Date : 24 April – 07 May 2025
Report Date : 08 May 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF., 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

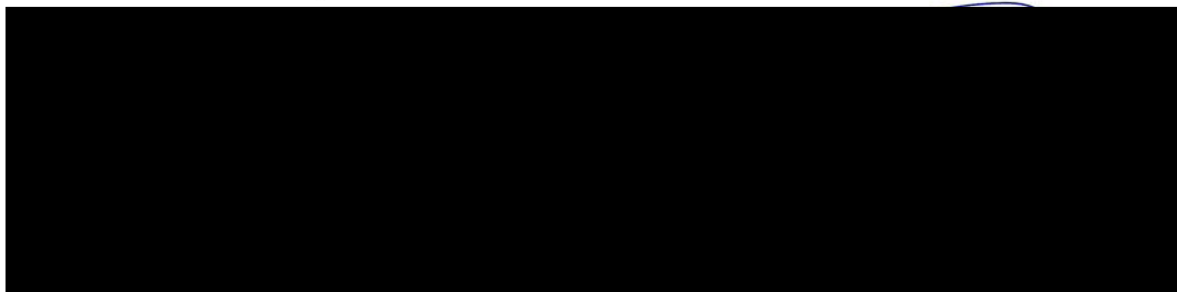

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 668661 E 1529617 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/7
Sample Type : Swimming pool Water
Sampling Date : 23 April 2025
Sampling Time : 03.41 p.m.
Received Date : 24 April 2025
Analytical Date : 24 April – 07 May 2025
Report Date : 08 May 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 668658 E 1529644 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/6
Sample Type : Swimming pool Water
Sampling Date : 21 May 2025
Sampling Time : 02.22 p.m.
Received Date : 22 May 2025
Analytical Date : 22 May – 04 June 2025
Report Date : 05 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF., 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 668664 E 1529650 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/7
Sample Type : Swimming pool Water
Sampling Date : 21 May 2025
Sampling Time : 02.20 p.m.
Received Date : 22 May 2025
Analytical Date : 22 May – 04 June 2025
Report Date : 05 June 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 668658 E 1529644 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/6
Sample Type : Swimming pool Water
Sampling Date : 25 June 2025
Sampling Time : 10.29 a.m.
Received Date : 26 June 2025
Analytical Date : 26 June – 04 July 2025
Report Date : 05 July 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF., 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

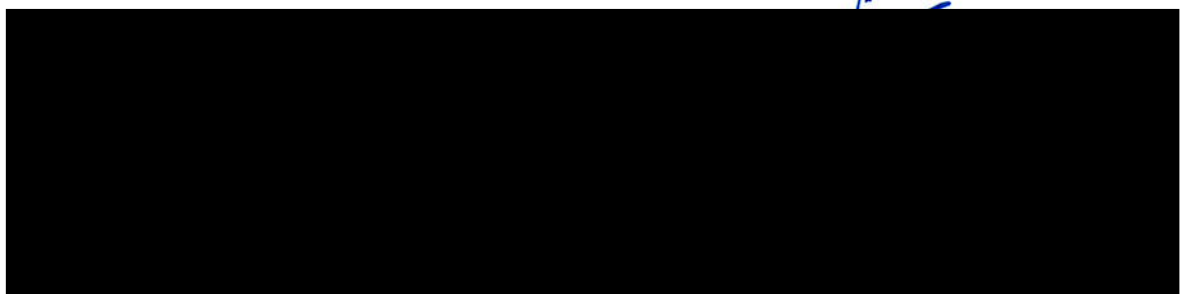

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด บลู พหลโยธิน 35
Project Name : โครงการ BLUE Phahon Yothin 35 (บลู พหลโยธิน 35)
Address Project : เลขที่ 38 ซอยวิภาวดีรังสิต 38 แขวงลาดยาว
 เขตจตุจักร กรุงเทพมหานคร 10900
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 668664 E 1529650 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68006
Sample No : W68006/7
Sample Type : Swimming pool Water
Sampling Date : 25 June 2025
Sampling Time : 10.29 a.m.
Received Date : 26 June 2025
Analytical Date : 26 June – 04 July 2025
Report Date : 05 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

