

ภาคผนวก ง

ผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม

- คุณภาพน้ำทิ้ง
- คุณภาพน้ำระว่ายน้ำ ชั้น 1
- คุณภาพน้ำระว่ายน้ำ ชั้น 21
- คุณภาพน้ำประปา



คุณภาพน้ำทิ้ง



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเอร์ โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตตหีบ
จังหวัดชลบุรี 20250
Sampling Point : น้ำก่อนเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706147 E 1422317 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68018
Sample No. : W68018/1
Sample Type : Wastewater
Sampling Date : 09 January 2025
Sampling Time : 03.16 p.m.
Received Date : 10 January 2025
Analytical Date : 10 – 30 January 2025
Report Date : 30 January 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	7.1
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	60.2
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	337
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	126
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.19
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 4500-Norg B and part 4500-NH ₃ C.	184
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo - 197.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเอร์ โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : น้ำหลังออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706172 E 1422334 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/2
Sample Type : Wastewater
Sampling Date : 09 January 2025
Sampling Time : 03.22 p.m.
Received Date : 10 January 2025
Analytical Date : 10 – 30 January 2025
Report Date : 30 January 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	29.5	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	325	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	57.6	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.69	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	Based on Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 4500-Norg B and part 4500-NH ₃ C.	63.57	≤ 35
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid /Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo - 197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : น้ำก่อนเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706141 E 1422320 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68018
Sample No. : W68018/1
Sample Type : Wastewater
Sampling Date : 03 February 2025
Sampling Time : 03.04 p.m.
Received Date : 04 February 2025
Analytical Date : 04 February – 04 March 2025
Report Date : 04 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 2.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	55.9
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	368
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	103
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.3
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.41
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	1.2
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 4500-Norg B and part 4500-NH ₃ C.	105
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo - 197.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียร่า โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : น้ำหลังออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706172 E 1422332 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/2
Sample Type : Wastewater
Sampling Date : 03 February 2025
Sampling Time : 03.11 p.m.
Received Date : 04 February 2025
Analytical Date : 04 February – 04 March 2025
Report Date : 04 March 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 2.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.3	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.4	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	434	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	42.2	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	Based on Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 4500-Norg B and part 4500-NH ₃ C.	55.84	≤ 35
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by SGS (Thailand) Limited, Environmental Laboratory (Rayong Branch) registration number Wo - 197.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : น้ำก่อนเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706150 E 1422319 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68018
Sample No. : W68018/1
Sample Type : Wastewater
Sampling Date : 10 March 2025
Sampling Time : 02.43 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 25 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	54.8
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	392
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	41.7
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.51
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	86
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/ Turbid/ Sediment/ Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : น้ำหลัออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706154 E 1422311 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/2
Sample Type : Wastewater
Sampling Date : 10 March 2025
Sampling Time : 02.50 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 25 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	13.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	362	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	45.2	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.1	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.63	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	74	≤ 35
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/ Turbid / Little Sediment/ Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : น้ำก่อนเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706162 E 1422298 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68018
Sample No. : W68018/1
Sample Type : Wastewater
Sampling Date : 03 April 2025
Sampling Time : 11.32 a.m.
Received Date : 04 April 2025
Analytical Date : 04 – 23 April 2025
Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 22.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	45.7
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	325
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	80.4
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.23
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	4.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	50
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : น้ำหลังออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706140 E 1422335 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/2
Sample Type : Wastewater
Sampling Date : 03 April 2025
Sampling Time : 11.37 a.m.
Received Date : 04 April 2025
Analytical Date : 04 – 23 April 2025
Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	8.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	306	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	45.3	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.96	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	63	≤ 35
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : น้ำก่อนเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706145 E 1422321 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68018
Sample No. : W68018/1
Sample Type : Wastewater
Sampling Date : 07 May 2025
Sampling Time : 11.18 a.m.
Received Date : 08 May 2025
Analytical Date : 08 – 22 May 2025
Report Date : 23 May 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	190
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	346
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	99.8
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.2
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.05
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	6.5
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	92
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Black/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA., AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : น้ำหลังออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706148 E 1422332 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/2
Sample Type : Wastewater
Sampling Date : 07 May 2025
Sampling Time : 11.23 a.m.
Received Date : 08 May 2025
Analytical Date : 08 – 22 May 2025
Report Date : 23 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.3	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	427	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	17.4	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	76	≤ 35
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : น้ำก่อนเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706157 E 1422305 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68018
Sample No. : W68018/1
Sample Type : Wastewater
Sampling Date : 04 June 2025
Sampling Time : 01.34 p.m.
Received Date : 05 June 2025
Analytical Date : 05 – 20 June 2025
Report Date : 21 June 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.4 °C	-	Electrometric Method (4500-H ⁺ B)	6.9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	202
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	533
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test (5210 B), Azide Modification (4500-O C)	38.0
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.6
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.48
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	5.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	79
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : น้ำหลังจากการระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 706157 E 1422327 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/2
Sample Type : Wastewater
Sampling Date : 04 June 2025
Sampling Time : 01.39 p.m.
Received Date : 05 June 2025
Analytical Date : 05 – 20 June 2025
Report Date : 21 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	8.9	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	351	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test (5210 B), Azide Modification (4500-O C)	14.3	≤ 30
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	57	≤ 35
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid /Little Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



คุณภาพน้ำสระว่ายน้ำ ชั้น 1



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนลึก)
GPS. Coordinate : 47 P 706099 E 1422309 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/4
Sample Type : Swimming pool Water
Sampling Date : 09 January 2025
Sampling Time : 03.04 p.m.
Received Date : 10 January 2025
Analytical Date : 10 – 17 January 2025
Report Date : 20 January 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria "	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria "	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.
Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนต้น)
GPS. Coordinate : 47 P 706114 E 1422308 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/5
Sample Type : Swimming pool Water
Sampling Date : 09 January 2025
Sampling Time : 03.03 p.m.
Received Date : 10 January 2025
Analytical Date : 10 – 17 January 2025
Report Date : 20 January 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนลึก)
GPS. Coordinate : 47 P 706111 E 1422304 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/4
Sample Type : Swimming pool Water
Sampling Date : 03 February 2025
Sampling Time : 02.59 p.m.
Received Date : 04 February 2025
Analytical Date : 04 – 13 February 2025
Report Date : 14 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนต้น)
GPS. Coordinate : 47 P 706078 E 1422295 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/5
Sample Type : Swimming pool Water
Sampling Date : 03 February 2025
Sampling Time : 03.00 p.m.
Received Date : 04 February 2025
Analytical Date : 04 – 13 February 2025
Report Date : 13 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนลึก)
GPS. Coordinate : 47 P 706113 E 1422317 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/4
Sample Type : Swimming pool Water
Sampling Date : 10 March 2025
Sampling Time : 02.29 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนต้น)
GPS. Coordinate : 47 P 706109 E 1422318 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/5
Sample Type : Swimming pool Water
Sampling Date : 10 March 2025
Sampling Time : 02.28 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนลึก)
GPS. Coordinate : 47 P 706115 E 1422398 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/4
Sample Type : Swimming pool Water
Sampling Date : 03 April 2025
Sampling Time : 11.21 a.m.
Received Date : 04 April 2025
Analytical Date : 04 – 23 April 2025
Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเอร์ โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนต้น)
GPS. Coordinate : 47 P 706113 E 1422311 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/5
Sample Type : Swimming pool Water
Sampling Date : 03 April 2025
Sampling Time : 11.22 a.m.
Received Date : 04 April 2025
Analytical Date : 04 – 23 April 2025
Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโค
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนลึก)
GPS. Coordinate : 47 P 706123 E 1422319 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/4
Sample Type : Swimming pool Water
Sampling Date : 07 May 2025
Sampling Time : 11.06 a.m.
Received Date : 08 May 2025
Analytical Date : 08 – 19 May 2025
Report Date : 20 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเอร์ โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนต้น)
GPS. Coordinate : 47 P 706108 E 1422316 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/5
Sample Type : Swimming pool Water
Sampling Date : 07 May 2025
Sampling Time : 11.07 a.m.
Received Date : 08 May 2025
Analytical Date : 08 – 19 May 2025
Report Date : 20 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
 Project Name : โครงการ The Riviera Monaco
 Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
 Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนลึก)
 GPS. Coordinate : 47 P 706113 E 1422318 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
 Sample No : W68018/4
 Sample Type : Swimming pool Water
 Sampling Date : 04 June 2025
 Sampling Time : 01.28 p.m.
 Received Date : 05 June 2025
 Analytical Date : 05 – 18 June 2025
 Report Date : 19 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 1 (ส่วนต้น)
GPS. Coordinate : 47 P 706119 E 1422319 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/5
Sample Type : Swimming pool Water
Sampling Date : 04 June 2025
Sampling Time : 01.27 p.m.
Received Date : 05 June 2025
Analytical Date : 05 – 18 June 2025
Report Date : 19 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



คุณภาพน้ำสระว่ายน้ำ ชั้น 21



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนลึก)
GPS. Coordinate : 47 P 706134 E 1422315 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/6
Sample Type : Swimming pool Water
Sampling Date : 09 January 2025
Sampling Time : 03.09 p.m.
Received Date : 10 January 2025
Analytical Date : 10 – 17 January 2025
Report Date : 20 January 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/ Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนต้น)
GPS. Coordinate : 47 P 706126 E 1422310 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/7
Sample Type : Swimming pool Water
Sampling Date : 09 January 2025
Sampling Time : 03.08 p.m.
Received Date : 10 January 2025
Analytical Date : 10 – 17 January 2025
Report Date : 20 January 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนลึก)
GPS. Coordinate : 47 P 706133 E 1422317 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/6
Sample Type : Swimming pool Water
Sampling Date : 03 February 2025
Sampling Time : 02.55 p.m.
Received Date : 04 February 2025
Analytical Date : 04 – 13 February 2025
Report Date : 14 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Total Coliform Bacteria		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนต้น)
GPS. Coordinate : 47 P 706111 E 1422307 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/7
Sample Type : Swimming pool Water
Sampling Date : 03 February 2025
Sampling Time : 02.57 p.m.
Received Date : 04 February 2025
Analytical Date : 04 – 13 February 2025
Report Date : 14 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนลึก)
GPS. Coordinate : 47 P 706135 E 1422313 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/6
Sample Type : Swimming pool Water
Sampling Date : 10 March 2025
Sampling Time : 02.17 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Total Coliform Bacteria		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

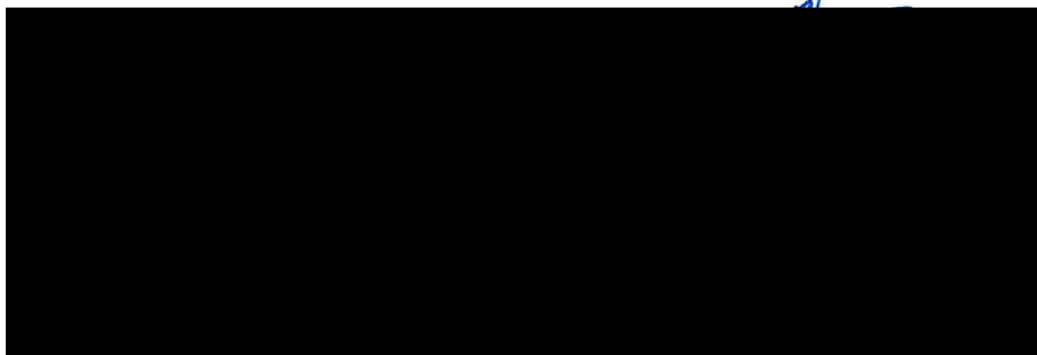

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคโลอาคารชุด เดอะ ริวีเยรา โมนาโค
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนต้น)
GPS. Coordinate : 47 P 706123 E 1422316 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/7
Sample Type : Swimming pool Water
Sampling Date : 10 March 2025
Sampling Time : 02.16 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนลึก)
GPS. Coordinate : 47 P 706127 E 1422317 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/6
Sample Type : Swimming pool Water
Sampling Date : 03 April 2025
Sampling Time : 11.26 a.m.
Received Date : 04 April 2025
Analytical Date : 04 – 23 April 2025
Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Total Coliform Bacteria		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนต้น)
GPS. Coordinate : 47 P 706125 E 1422321 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/7
Sample Type : Swimming pool Water
Sampling Date : 03 April 2025
Sampling Time : 11.25 a.m.
Received Date : 04 April 2025
Analytical Date : 04 – 23 April 2025
Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนลึก)
GPS. Coordinate : 47 P 706140 E 1422306 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/6
Sample Type : Swimming pool Water
Sampling Date : 07 May 2025
Sampling Time : 11.12 a.m.
Received Date : 08 May 2025
Analytical Date : 08 – 19 May 2025
Report Date : 20 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Total Coliform Bacteria		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเอร์ โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำชั้นที่ 21 (ส่วนต้น)
GPS. Coordinate : 47 P 706119 E 1422325 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/7
Sample Type : Swimming pool Water
Sampling Date : 07 May 2025
Sampling Time : 11.11 a.m.
Received Date : 08 May 2025
Analytical Date : 08 – 19 May 2025
Report Date : 20 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : สระว่ายน้ำ ชั้นที่ 21 (ส่วนเล็ก)
GPS. Coordinate : 47 P 706163 E 1422278 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/6
Sample Type : Swimming pool Water
Sampling Date : 04 June 2025
Sampling Time : 01.23 p.m.
Received Date : 05 June 2025
Analytical Date : 05 – 18 June 2025
Report Date : 19 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Total Coliform Bacteria		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยร์่า โมนาโค
 Project Name : โครงการ The Riviera Monaco
 Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
 Sampling Point : สระว่ายน้ำ ชั้นที่ 21 (ส่วนต้น)
 GPS. Coordinate : 47 P 706132 E 1422313 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
 Sample No : W68018/7
 Sample Type : Swimming pool Water
 Sampling Date : 04 June 2025
 Sampling Time : 01.21 p.m.
 Received Date : 05 June 2025
 Analytical Date : 05 – 18 June 2025
 Report Date : 19 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

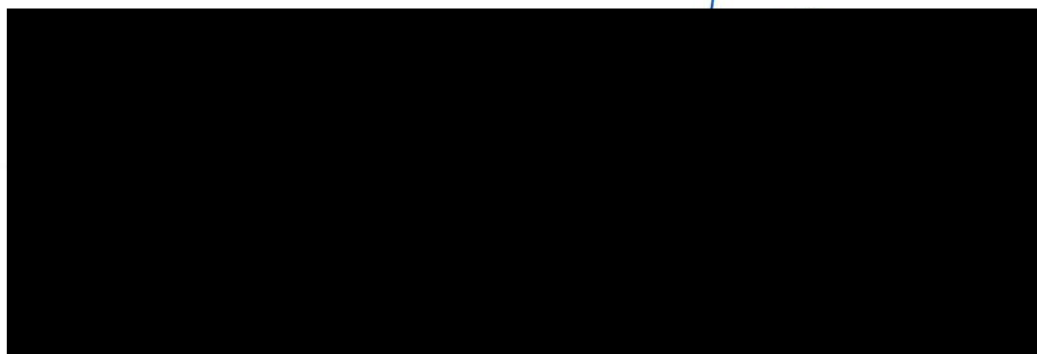

คุณภาพน้ำประปา



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ภายในพื้นที่โครงการ
GPS. Coordinate : 47 P 706157 E 1422320 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling


Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/3
Sample Type : Water Supply
Sampling Date : 09 January 2025
Sampling Time : 03.20 p.m.
Received Date : 10 January 2025
Analytical Date : 10 – 17 January 2025
Report Date : 20 January 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	146	≤ 500
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเอร์ โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
 จังหวัดชลบุรี 20250
Sampling Point : ภายในพื้นที่โครงการ
GPS. Coordinate : 47 P 706159 E 1422322 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling


Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/3
Sample Type : Water Supply
Sampling Date : 03 February 2025
Sampling Time : 03.02 p.m.
Received Date : 04 February 2025
Analytical Date : 04 – 13 February 2025
Report Date : 14 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	146	≤ 500
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ภายในพื้นที่โครงการ
GPS. Coordinate : 47 P N 706150 E 1422319 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/3
Sample Type : Water Supply
Sampling Date : 10 March 2025
Sampling Time : 02.48 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	99.0	≤ 500
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียร่า โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ภายในพื้นที่โครงการ
GPS. Coordinate : 47 P N 706157 E 1422307 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling


Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/3
Sample Type : Water Supply
Sampling Date : 03 April 2025
Sampling Time : 11.19 a.m.
Received Date : 04 April 2025
Analytical Date : 04 – 23 April 2025
Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	228	≤ 500
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโค
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ภายในพื้นที่โครงการ
GPS. Coordinate : 47 P 706151 E 1422326 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling


Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/3
Sample Type : Water Supply
Sampling Date : 07 May 2025
Sampling Time : 10.59 a.m.
Received Date : 08 May 2025
Analytical Date : 08 – 19 May 2025
Report Date : 20 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	174	≤ 500
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA., AWWA, WEF, 24th edition 2023.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียร่า โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ภายในพื้นที่โครงการ
GPS. Coordinate : 47 P 706155 E 1422324 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling


Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/3
Sample Type : Water Supply
Sampling Date : 04 June 2025
Sampling Time : 01.12 p.m.
Received Date : 05 June 2025
Analytical Date : 05 – 18 June 2025
Report Date : 19 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	207 ±	≤ 500
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criteria's of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ถังน้ำใช้ ชั้นใต้ดิน
GPS. Coordinate : 47 P 706151 E 1422347 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/8
Sample Type : Water Supply
Sampling Date : 10 March 2025
Sampling Time : 02.35 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
<i>Escherichia Coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ถังน้ำใช้ ชั้นดาดฟ้า
GPS. Coordinate : 47 P 706095 E 1422328 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68018
Sample No : W68018/9
Sample Type : Water Supply
Sampling Date : 10 March 2025
Sampling Time : 02.23 p.m.
Received Date : 11 March 2025
Analytical Date : 11 – 24 March 2025
Report Date : 25 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
<i>Escherichia Coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ถังน้ำใช้ ชั้นใต้ดิน
GPS. Coordinate : 47 P 706130 E 1422355 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/8
Sample Type : Water Supply
Sampling Date : 04 June 2025
Sampling Time : 01.30 p.m.
Received Date : 05 June 2025
Analytical Date : 05 – 18 June 2025
Report Date : 19 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
<i>Escherichia Coli</i> [*]	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criteria's of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โมนาโก
Project Name : โครงการ The Riviera Monaco
Address Project : เลขที่ 359 หมู่ที่ 1 ตำบลนาจอมเทียน อำเภอสัตหีบ
จังหวัดชลบุรี 20250
Sampling Point : ถังน้ำใช้ ชั้นดาดฟ้า
GPS. Coordinate : 47 P 706087 E 1422343 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68018
Sample No : W68018/9
Sample Type : Water Supply
Sampling Date : 04 June 2025
Sampling Time : 01.16 p.m.
Received Date : 05 June 2025
Analytical Date : 05 – 18 June 2025
Report Date : 19 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
<i>Escherichia Coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criteria's of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

