

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
Project Name : โครงการ THE RIVER
Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
แขวงคลองตันใหม่ เขตคลองสาน กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้าย อาคาร A
GPS. Coordinate : 47 P 663290 E 1517485 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling
inclinometer

Data Provided by Laboratory


Report No. : W68026
Sample No. : W68026/1
Sample Type : Wastewater
Sampling Date : 30 January 2025
Sampling Time : 10.45 a.m.
Received Date : 31 January 2025
Analytical Date : 31 January – 11 February 2025
Report Date : 12 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	43.5	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	6.2	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 1,600	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
Project Name : โครงการ THE RIVER
Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
แขวงคลองตันใหม่ เขตคลองสาน กรุงเทพมหานคร
Sampling Point : ป่อพักน้ำสุดท้าย อาคาร B
GPS. Coordinate : 47 P 663290 E 1517484 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68026
Sample No. : W68026/2
Sample Type : Wastewater
Sampling Date : 30 January 2025
Sampling Time : 10.39 a.m.
Received Date : 31 January 2025
Analytical Date : 31 January – 11 February 2025
Report Date : 12 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	6.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.6	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	1,600	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

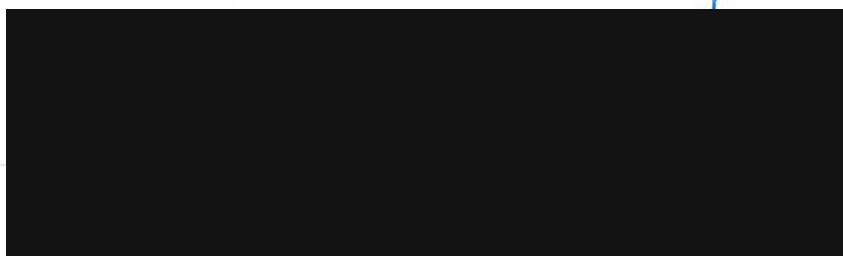

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
 Project Name : โครงการ THE RIVER
 Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
 แขวงคลองตันใต้ เขตคลองสาน กรุงเทพมหานคร
 Sampling Point : บ่อพักน้ำสุดท้าย อาคาร A
 GPS. Coordinate : 47 P 663291 E 1517488 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68026
 Sample No. : W68026/1
 Sample Type : Wastewater
 Sampling Date : 14 February 2025
 Sampling Time : 12.04 p.m.
 Received Date : 15 February 2025
 Analytical Date : 15 February – 03 March 2025
 Report Date : 04 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 26.4 °C	-	Electrometric Method (4500-H ⁺ B)	6.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	70.5	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.0	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 1,600	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

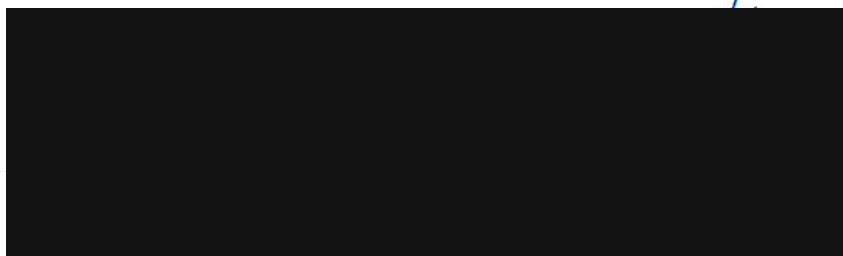

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
Project Name : โครงการ THE RIVER
Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
แขวงคลองตันใหม่ เขตคลองสาน กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้าย อาคาร B
GPS. Coordinate : 47 P 663288 E 1517487 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68026
Sample No. : W68026/2
Sample Type : Wastewater
Sampling Date : 14 February 2025
Sampling Time : 11.58 a.m.
Received Date : 15 February 2025
Analytical Date : 15 February – 03 March 2025
Report Date : 04 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.2 °C	-	Electrometric Method (4500-H ⁺ B)	6.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	43.7	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.6	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 1,600	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

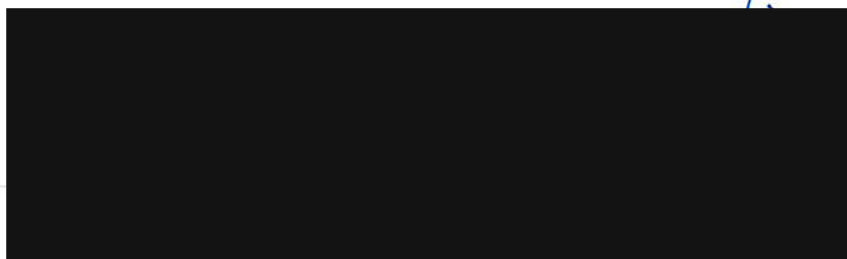



TNP ENVIRONMENT CO.,LTD.

เลขที่ 332/173 หมู่ 3 ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี 11110 โทรศัพท์: 02-156-8273

E-mail: tnp.envi@gmail.com เลขประจำตัวผู้เสียภาษี 0125560008957 สำนักงานใหญ่



NSC-TISI-TIS 17025

Testing 1679

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
Project Name : โครงการ THE RIVER
Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
แขวงคลองตันใหม่ เขตคลองสาน กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้าย อาคาร A
GPS. Coordinate : 47 P 663291 E 1517488 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68026
Sample No. : W68026/1
Sample Type : Wastewater
Sampling Date : 14 March 2025
Sampling Time : 11.25 a.m.
Received Date : 15 March 2025
Analytical Date : 15 – 26 March 2025
Report Date : 27 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.4 °C	-	Electrometric Method (4500-H ⁺ B)	6.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	22.1	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	18.4	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	1,600	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
 Project Name : โครงการ THE RIVER
 Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
 แขวงคลองตันใต้ เขตคลองสาน กรุงเทพมหานคร
 Sampling Point : บ่อพักน้ำสุดท้าย อาคาร B
 GPS. Coordinate : 47 P 663288 E 1517487 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68026
 Sample No. : W68026/2
 Sample Type : Wastewater
 Sampling Date : 14 March 2025
 Sampling Time : 11.20 a.m.
 Received Date : 15 March 2025
 Analytical Date : 15 – 26 March 2025
 Report Date : 27 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.2 °C	-	Electrometric Method (4500-H ⁺ B)	6.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	8.6	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	4.3	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	920	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

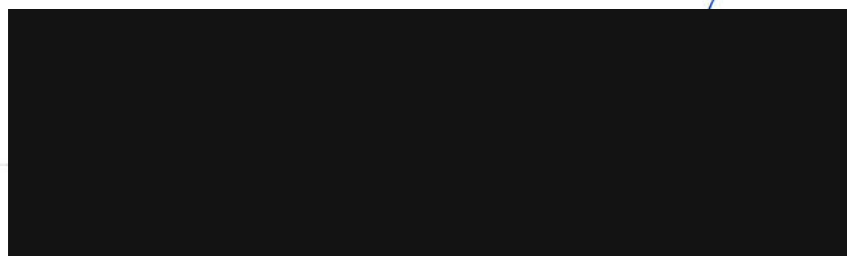

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
 Project Name : โครงการ THE RIVER
 Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
 แขวงคลองตันใหม่ เขตคลองสาน กรุงเทพมหานคร
 Sampling Point : บ่อพักน้ำสุดท้าย อาคาร A
 GPS. Coordinate : 47 P 663330 E 1517445 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68026
 Sample No. : W68026/1
 Sample Type : Wastewater
 Sampling Date : 04 April 2025
 Sampling Time : 01.25 p.m.
 Received Date : 07 April 2025
 Analytical Date : 07 – 23 April 2025
 Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.3 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	8.1	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	1,600	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
 Project Name : โครงการ THE RIVER
 Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
 แขวงคลองตันใหม่ เขตคลองสาน กรุงเทพมหานคร
 Sampling Point : ป่อพักน้ำสุดท้าย อาคาร B
 GPS. Coordinate : 47 P 663290 E 1517484 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68026
 Sample No. : W68026/2
 Sample Type : Wastewater
 Sampling Date : 04 April 2025
 Sampling Time : 01.17 p.m.
 Received Date : 07 April 2025
 Analytical Date : 07 – 23 April 2025
 Report Date : 24 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.6 °C	-	Electrometric Method (4500-H ⁺ B)	6.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	7.0	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	920	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
Project Name : โครงการ THE RIVER
Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
แขวงคลองตันใหม่ เขตคลองสาน กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้าย อาคาร A
GPS. Coordinate : 47 P 663298 E 1517449 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68026
Sample No. : W68026/1
Sample Type : Wastewater
Sampling Date : 12 May 2025
Sampling Time : 01.38 p.m.
Received Date : 13 May 2025
Analytical Date : 13 – 26 May 2025
Report Date : 27 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.6 °C	-	Electrometric Method (4500-H ⁺ B)	5.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	48.6	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	40.0	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
 Project Name : โครงการ THE RIVER
 Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
 แขวงคลองตันใต้ เขตคลองสาน กรุงเทพมหานคร
 Sampling Point : บ่อพักน้ำสุดท้าย อาคาร B
 GPS. Coordinate : 47 P 663292 E 1517484 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W68026
 Sample No. : W68026/2
 Sample Type : Wastewater
 Sampling Date : 12 May 2025
 Sampling Time : 01.32 p.m.
 Received Date : 13 May 2025
 Analytical Date : 13 – 26 May 2025
 Report Date : 27 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.5 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	16.8	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	13.5	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	24,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
 Project Name : โครงการ THE RIVER
 Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
 แขวงคลองตันใต้ เขตคลองสาน กรุงเทพมหานคร
 Sampling Point : บ่อพักน้ำสุดท้าย อาคาร B
 GPS. Coordinate : 47 P 663268 E 1517471 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68026
 Sample No. : W68026/2
 Sample Type : Wastewater
 Sampling Date : 04 June 2025
 Sampling Time : 11.24 a.m.
 Received Date : 05 June 2025
 Analytical Date : 05 – 20 June 2025
 Report Date : 23 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.8 °C	-	Electrometric Method (4500-H ⁺ B)	6.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.7	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification (4500-O C, 5210 B)	15.0	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	1,600	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวอร์
 Project Name : โครงการ THE RIVER
 Address Project : เลขที่ 110 ซอยเจริญนคร 13 ถนนเจริญนคร
 แขวงคลองตันใต้ เขตคลองสาน กรุงเทพมหานคร
 Sampling Point : บ่อพักน้ำสุดท้าย อาคาร A
 GPS. Coordinate : 47 P 663268 E 1517471 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68026
 Sample No. : W68026/1
 Sample Type : Wastewater
 Sampling Date : 04 June 2025
 Sampling Time : 11.33 a.m.
 Received Date : 05 June 2025
 Analytical Date : 05 – 20 June 2025
 Report Date : 23 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.5 °C	-	Electrometric Method (4500-H ⁺ B)	5.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	13.7	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification (4500-O C, 5210 B)	19.4	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	1,600	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

