

ภาคผนวก 7

เอกสารประกอบการติดตามมาตรการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม

ภาคผนวก 7-1

ผลการตรวจวัดคุณภาพสิ่งแวดล้อม

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอส เคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอส เคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนผ่านระบบบำบัด อาคาร B
GPS. Coordinate : 47 P 676742 E 1513798 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/1
Sample Type : Wastewater
Sampling Date : 31 January 2025
Sampling Time : 11.33 a.m.
Received Date : 01 February 2025
Analytical Date : 01 – 11 February 2025
Report Date : 13 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	50.0
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	43.5
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.




Miss Jarawee Aedee

Analyst



TNP ENVIRONMENT CO.,LTD.

บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด



Mr. Nattachai Triprawat

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : สุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งหลังผ่านระบบบำบัด อาคาร B
GPS. Coordinate : 47 P 676736 E 1513815 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/2
Sample Type : Wastewater
Sampling Date : 31 January 2025
Sampling Time : 11.28 a.m.
Received Date : 01 February 2025
Analytical Date : 01 – 11 February 2025
Report Date : 13 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	8.7	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	300	≤1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	18.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleble Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤20
Total Kjeldahl Nitrogen ^{* 2/}	mg/L	APHA:4500-Norg (B) ^{3/} part 4500-Norg B and part 4500-NH ₃ C	66	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	>160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.




Miss Jarawee Aedee

Analyst


TNP ENVIRONMENT CO.,LTD. Laboratory Manager

บริษัท ดีเอสเคป เอ็นโวลอปเมนต์ จำกัด



Mr. Nattachai Triprawat

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 676834 E 1513858 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/3
Sample Type : Wastewater
Sampling Date : 31 January 2025
Sampling Time : 11.47 a.m.
Received Date : 01 February 2025
Analytical Date : 01 – 11 February 2025
Report Date : 13 February 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	28.1	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	298	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	11.7	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	< 0.60	≤ 1.0
Settleble Solids*	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	31	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.




Miss Jarawee Aedee

Analyst



TNP ENVIRONMENT CO.,LTD.

บริษัท ทีเอ็นพี เอ็นvironment จำกัด



Mr. Nattachai Triprawat

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนผ่านระบบบำบัด อาคาร D
GPS. Coordinate : 47 P 676762 E 1513745 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/1
Sample Type : Wastewater
Sampling Date : 24 February 2025
Sampling Time : 11.09 a.m.
Received Date : 25 February 2025
Analytical Date : 25 February – 07 March 2025
Report Date : 10 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 22.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	29.9
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	38.4
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.




Miss Jarawee Aedee

Analyst



TNP ENVIRONMENT CO.,LTD.

บริษัท ทีเอ็นพีเอ็นไวรอนเมนต์ จำกัด



Mr.Nattachai Triprawat

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : สุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งหลังผ่านระบบบำบัด อาคาร D
GPS. Coordinate : 47 P 676750 E 1513765 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/2
Sample Type : Wastewater
Sampling Date : 24 February 2025
Sampling Time : 11.11 a.m.
Received Date : 25 February 2025
Analytical Date : 25 February – 13 March 2025
Report Date : 14 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	15.1	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	318	≤1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	16.3	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	< 0.60	≤ 1.0
Settleble Solids *	mL/L	Imhoff Cone (2540 F)	0.2	-
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤20
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/} part 4500-Norg B and part 4500-NH ₃ C	22	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	>160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Miss Jarawee Aedee
Analyst



Mr. Nattachai Triprawat
Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 676840 E 1513861 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/3
Sample Type : Wastewater
Sampling Date : 24 February 2025
Sampling Time : 11.42 a.m.
Received Date : 25 February 2025
Analytical Date : 25 February – 13 March 2025
Report Date : 14 March 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	33.4	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	302	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	12.4	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleble Solids *	mL/L	Imhoff Cone (2540 F)	0.3	-
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Total Kjeldahl Nitrogen ^{* 2/}	mg/L	APHA:4500-Norg (B) ^{3/}	26	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.


^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Miss Jarawee Aedee
Analyst



TNP ENVIRONMENT CO.,LTD.
บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

Mr.Nattachai Triprawat
Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนผ่านระบบบำบัด อาคาร C
GPS. Coordinate : 47 P 676837 E 1513853 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/1
Sample Type : Wastewater
Sampling Date : 31 March 2025
Sampling Time : 03.45 p.m.
Received Date : 01 April 2025
Analytical Date : 01 – 18 April 2025
Report Date : 21 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 21.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	39.7
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	81.2
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Miss Jarawee Aedee

Analyst


TNP ENVIRONMENT CO.,LTD

บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด



Mr. Nuttachai Triprawat

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนนางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งหลังผ่านระบบบำบัด อาคาร C
GPS. Coordinate : 47 P 676752 E 1513771 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/2
Sample Type : Wastewater
Sampling Date : 31 March 2025
Sampling Time : 03.17 p.m.
Received Date : 01 April 2025
Analytical Date : 01 – 18 April 2025
Report Date : 21 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.4	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	357	≤1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	4.2	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.3	-
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤20
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	24	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	43,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Miss Jarawee Aedee

Analyst



TNP ENVIRONMENT CO.,LTD.

บริษัท ดีเอ็นอี เอ็นไวรอนเม้นท์ จำกัด



Mr. Nuttachai Triprawat

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47 P 676745 E 1513783 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/3
Sample Type : Wastewater
Sampling Date : 31 March 2025
Sampling Time : 03.12 p.m.
Received Date : 01 April 2025
Analytical Date : 01 – 18 April 2025
Report Date : 21 April 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	317	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	332	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	60.3	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.12	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	4.5	-
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.3	≤ 20
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	34	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Black/Turbid/Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.




Miss Jarawee Aedee

Analyst


TNP ENVIRONMENT CO.,LTD.

บริษัท ทีเอ็นพี เอ็นvironment คอ.,ลtd



Mr. Nuttachai Triprawat

Laboratory Manager



TNP ENVIRONMENT CO.,LTD.

เลขที่ 332/173 หมู่ 3 ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี 11110 โทรศัพท์: 02-156-8273

E-mail: tnp.envi@gmail.com เลขประจำตัวผู้เสียภาษี 0125560008957 สำนักงานใหญ่



NSC-TISI-TIS 17025

Testing 1679

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนผ่านระบบบำบัด อาคาร F
GPS. Coordinate : 47P 676783 E 1513652 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/1
Sample Type : Wastewater
Sampling Date : 24 April 2025
Sampling Time : 01.18 p.m.
Received Date : 25 April 2025
Analytical Date : 25 April – 09 May 2025
Report Date : 12 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.6
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	10.2
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	50.8
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.


Miss Jarawee Aedee
Analyst


Mr. Nuttachai Triprawat
Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งหลังผ่านระบบบำบัด อาคาร F
GPS. Coordinate : 47P 676772 E 1513666 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/2
Sample Type : Wastewater
Sampling Date : 24 April 2025
Sampling Time : 01.21 p.m.
Received Date : 25 April 2025
Analytical Date : 25 April – 09 May 2025
Report Date : 12 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5 - 9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	10.4	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	402	≤1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.6	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.79	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.2	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	66	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	28,000	-
Sample Appearance		Yellow/Turbid/Sediment/ Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Miss Jarawee Aedee
Analyst



บริษัท ทีเอ็นพี เอ็นไวรอนเมนต์ จำกัด



Mr. Nuttachai Triprawat
Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47P 676841 E 1513854 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/3
Sample Type : Wastewater
Sampling Date : 24 April 2025
Sampling Time : 01.34 p.m.
Received Date : 25 April 2025
Analytical Date : 25 April – 09 May 2025
Report Date : 12 May 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	40.4	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	315	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.5	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	1.3	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	34	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	17,000	-
Sample Appearance		Yellow/Turbid/Sediment/ Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Miss Jarawee Aedee
Analyst



Mr. Nuttachai Triprawat
Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
 กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนผ่านระบบบำบัด อาคาร E
GPS. Coordinate : 47P 676772 E 1513702 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/1
Sample Type : Wastewater
Sampling Date : 26 May 2025
Sampling Time : 11.26 a.m.
Received Date : 27 May 2025
Analytical Date : 27 May – 11 June 2025
Report Date : 12 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	22.9
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification (4500-O C, 5210 B)	72.6
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.


 Miss Jarawee Aedee
 Analyst


TNP ENVIRONMENT CO.,LTD.
 บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด


 Mr. Nuttachai Triprawat
 Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งหลังผ่านระบบบำบัด อาคาร E
GPS. Coordinate : 47P 676774 E 1513682 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/2
Sample Type : Wastewater
Sampling Date : 26 May 2025
Sampling Time : 11.30 a.m.
Received Date : 27 May 2025
Analytical Date : 27 May – 11 June 2025
Report Date : 12 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5 - 9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	10.4	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	172	≤1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification (4500-O C, 5210 B)	15.4	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	1.5	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	57	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

Miss Jarawee Aedee

Analyst



Mr. Nuttachai Triprawat

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งก่อนระบายออกจากโครงการ
GPS. Coordinate : 47P 676832 E 1513856 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/3
Sample Type : Wastewater
Sampling Date : 26 May 2025
Sampling Time : 11.38 a.m.
Received Date : 27 May 2025
Analytical Date : 27 May – 11 June 2025
Report Date : 12 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.9	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	188	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification (4500-O C, 5210 B)	13.6	≤ 20
Fat, Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	20	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

Miss Jarawee Aedee

Analyst



Mr. Nuttachai Triprawat

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
 Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
 Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
 กรุงเทพมหานคร 10260
 Sampling Point : น้ำทิ้งก่อนผ่านระบบบำบัด อาคาร A
 GPS. Coordinate : 47P 676731 E 1513825 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
 Sample No. : E68004/1
 Sample Type : Wastewater
 Sampling Date : 11 June 2025
 Sampling Time : 03.02 p.m.
 Received Date : 12 June 2025
 Analytical Date : 12 – 26 June 2025
 Report Date : 27 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	25.3
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	62.8
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.


 Miss Jarawee Aedee
 Analyst



 Mr. Nuttachai Trilprawat
 Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนียม
Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนียม
Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
กรุงเทพมหานคร 10260
Sampling Point : น้ำทิ้งหลังผ่านระบบบำบัด อาคาร A
GPS. Coordinate : 47P 676729 E 1513840 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
Sample No. : E68004/2
Sample Type : Wastewater
Sampling Date : 11 June 2025
Sampling Time : 02.57 p.m.
Received Date : 12 June 2025
Analytical Date : 12 – 26 June 2025
Report Date : 27 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5 - 9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	338	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	11.8	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	79	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

Miss Jarawee Aede
Analyst


TNP ENVIRONMENT CO.,LTD.
บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

Mr. Nuttachai Triprawat
Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดี เอสเคป คอนโด มิเนี่ยม
 Project Name : โครงการอาคารชุด ดี เอสเคป คอนโด มิเนี่ยม
 Address Project : ซอยสุขุมวิท 101/1 ถนนบางจาก เขตพระโขนง
 กรุงเทพมหานคร 10260
 Sampling Point : น้ำทิ้งก่อนระบายออกจากโครงการ
 GPS. Coordinate : 47P 676833 E 1513850 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : E68004
 Sample No. : E68004/3
 Sample Type : Wastewater
 Sampling Date : 11 June 2025
 Sampling Time : 03.12 p.m.
 Received Date : 12 June 2025
 Analytical Date : 12 – 26 June 2025
 Report Date : 27 June 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	13.6	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	459	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	10.6	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.3	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	69	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

^{3/} Standard Method for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Miss Jarawee Aedee
Analyst



Mr. Nuttachal Triprawat
Laboratory Manager

ภาคผนวก 7-2

กฎหมายที่เกี่ยวข้อง

ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม
เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด
พ.ศ. ๒๕๖๗

โดยที่เป็นการสมควรปรับปรุงการกำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ให้เหมาะสมตามความก้าวหน้าในทางวิทยาศาสตร์ เทคโนโลยี และความเปลี่ยนแปลงทางเศรษฐกิจ สังคม ของประเทศ และให้สอดคล้องกับสภาพการณ์ปัจจุบัน

อาศัยอำนาจตามความในมาตรา ๕๕ แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. ๒๕๓๕ รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม โดยคำแนะนำของคณะกรรมการควบคุมมลพิษ และโดยความเห็นชอบของคณะกรรมการสิ่งแวดล้อมแห่งชาติ จึงออกประกาศไว้ ดังต่อไปนี้

ข้อ ๑ ให้ยกเลิกประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด ฉบับลงวันที่ ๗ พฤศจิกายน พ.ศ. ๒๕๔๘

ข้อ ๒ ในประกาศนี้

“อาคาร” หมายความว่า อาคารที่ก่อสร้างขึ้น ไม่ว่าจะมียลักษณะเป็นอาคารหลังเดียวหรือเป็นกลุ่มของอาคารซึ่งตั้งอยู่ภายในพื้นที่ซึ่งเป็นบริเวณเดียวกัน และไม่จะมีท่อระบายน้ำท่อเดียวหรือมีหลายท่อที่เชื่อมติดต่อกันระหว่างอาคารหรือไม่ก็ตาม

“น้ำทิ้ง” หมายความว่า น้ำที่เกิดจากกิจกรรมของอาคารที่ระบายหรือจะระบายลงสู่แหล่งน้ำสาธารณะหรือออกสู่สิ่งแวดล้อม

ข้อ ๓ ให้แบ่งอาคาร ออกเป็น ๓ ชนิด คือ

ชนิดที่ ๑ อาคารอยู่อาศัย หมายถึง อาคารที่มีวัตถุประสงค์ให้เป็นที่พักอาศัยของบุคคล ทั้งการอยู่อาศัยอย่างถาวรหรือชั่วคราว ได้แก่

(๑) อาคารชุด ตามกฎหมายว่าด้วยอาคารชุด

(๒) หอพัก ตามกฎหมายว่าด้วยหอพัก

(๓) หอพัก ห้องเช่า ห้องแบ่งเช่า หรือกิจการอื่นในทำนองเดียวกันตามกฎหมายว่าด้วยการสาธารณสุข

(๔) สถานรับเลี้ยงเด็ก ตามกฎหมายว่าด้วยคุ้มครองเด็ก

(๕) สถานดูแลผู้สูงอายุหรือผู้มีภาวะพึ่งพิง ตามกฎหมายว่าด้วยสถานประกอบการเพื่อสุขภาพ

(๖) ที่พักอาศัยสำหรับลูกจ้างประเภทกิจกรรมก่อสร้าง ตามกฎหมายว่าด้วยการคุ้มครองแรงงาน

ชนิดที่ ๒ อาคารพาณิชยกรรม หมายถึง อาคารที่ใช้ประโยชน์ในการพาณิชยกรรม หรือบริการธุรกิจ อย่างเดียวหรือหลายอย่าง ได้แก่

(๑) โรงแรม ตามกฎหมายว่าด้วยโรงแรม

- (๒) ศูนย์การค้าหรือห้างสรรพสินค้า
 (๓) ตลาด ตามกฎหมายว่าด้วยการสาธารณสุข
 (๔) สถานบริการประเภทสถานอาบน้ำ นวดหรืออบตัว ตามกฎหมายว่าด้วยสถานบริการ
 (๕) ภัตตาคารหรือร้านอาหาร
 (๖) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ หรือองค์การระหว่างประเทศและของเอกชน
 (๗) อาคารโรงเรียนเอกชน ตามกฎหมายว่าด้วยโรงเรียนเอกชน โรงเรียนของทางราชการ อาคารสถาบันอุดมศึกษาของเอกชน ตามกฎหมายว่าด้วยสถาบันอุดมศึกษาของเอกชนและสถาบันอุดมศึกษาของทางราชการ

ชนิดที่ ๓ อาคารสถานพยาบาล หมายถึง สถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาล ประเภทที่รับผู้ป่วยไว้ค้างคืน

ข้อ ๔ ให้แบ่งขนาดของอาคาร ออกเป็น ๔ ประเภท ดังต่อไปนี้

ประเภทอาคาร	หน่วย	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
๑. อาคารอยู่อาศัย					
อาคารชุด	ห้องชุด	ตั้งแต่ ๕๐๐ ขึ้นไป	ตั้งแต่ ๑๐๐ แต่ไม่ถึง ๕๐๐	ไม่ถึง ๑๐๐	-
หอพัก	ห้อง	-	ตั้งแต่ ๒๕๐ ขึ้นไป	ตั้งแต่ ๕๐ แต่ไม่ถึง ๒๕๐	ไม่ถึง ๕๐
หอพัก ห้องเช่า ห้องแบ่งเช่า หรือกิจการอื่นในทำนอง เดียวกัน ตามกฎหมาย ว่าด้วยการสาธารณสุข	ห้อง	-	ตั้งแต่ ๒๕๐ ขึ้นไป	ตั้งแต่ ๕๐ แต่ไม่ถึง ๒๕๐	ไม่ถึง ๕๐
สถานรับเลี้ยงเด็ก	-	-	-	-	ทุกขนาด
สถานดูแลผู้สูงอายุหรือ ผู้มีภาวะพึ่งพิง	-	-	-	-	ทุกขนาด
ที่พักอาศัยสำหรับลูกจ้าง ประเภทกิจกรรมก่อสร้าง	-	-	-	-	ทุกขนาด
๒. อาคารพาณิชย์					
โรงแรม	ห้อง	ตั้งแต่ ๒๐๐ ขึ้นไป	ตั้งแต่ ๖๐ แต่ไม่ถึง ๒๐๐	ไม่ถึง ๖๐	-
สถานบริการประเภท สถานอาบน้ำ นวดหรืออบตัว	ตาราง เมตร	-	ตั้งแต่ ๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๑,๐๐๐ แต่ไม่ถึง ๕,๐๐๐	ไม่ถึง ๑,๐๐๐
โรงเรียนเอกชน โรงเรียนของ ทางราชการ สถาบันอุดมศึกษา ของเอกชนหรือสถาบัน อุดมศึกษาของทางราชการ		ตั้งแต่ ๒๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๒๕,๐๐๐	-	ไม่ถึง ๕,๐๐๐

ประเภทอาคาร	หน่วย	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
อาคารที่ทำการของทาง ราชการ รัฐวิสาหกิจ หรือ องค์การระหว่างประเทศและ ของเอกชน		ตั้งแต่ ๕๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๑๐,๐๐๐ แต่ไม่ถึง ๕๕,๐๐๐	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๑๐,๐๐๐	ไม่ถึง ๕,๐๐๐
ศูนย์การค้า หรือห้างสรรพสินค้า		ตั้งแต่ ๒๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๒๕,๐๐๐	-	ไม่ถึง ๕,๐๐๐
ตลาด		ตั้งแต่ ๒,๕๐๐ ขึ้นไป	ตั้งแต่ ๑,๕๐๐ แต่ไม่ถึง ๒,๕๐๐	ตั้งแต่ ๑,๐๐๐ แต่ไม่ถึง ๑,๕๐๐	ไม่ถึง ๑,๐๐๐
ภัตตาคารหรือร้านอาหาร		ตั้งแต่ ๒,๕๐๐ ขึ้นไป	ตั้งแต่ ๕๐๐ แต่ไม่ถึง ๒,๕๐๐	ตั้งแต่ ๒๕๐ แต่ไม่ถึง ๕๐๐	ไม่ถึง ๒๕๐
๓. อาคารสถานพยาบาล	เตียง	ตั้งแต่ ๓๐ ขึ้นไป	ตั้งแต่ ๑๐ แต่ไม่ถึง ๓๐	-	ไม่ถึง ๑๐

ข้อ ๕ กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารไว้ ดังต่อไปนี้

พารามิเตอร์	ค่ามาตรฐาน			
	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
๑. ความเป็นกรดและด่าง (pH)	๕.๕ - ๙.๐	๕.๕ - ๙.๐	๕.๕ - ๙.๐	๕.๕ - ๙.๐
๒. บีโอดี (Biochemical Oxygen Demand)	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๓๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร สำหรับอาคารอยู่อาศัย
				ไม่เกิน ๑๐๐ มิลลิกรัมต่อลิตร สำหรับอาคารพาณิชย์ และอาคารสถานพยาบาล
๓. ของแข็งแขวนลอยทั้งหมด (Total Suspended Solids)	ไม่เกิน ๓๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๖๐ มิลลิกรัมต่อลิตร
๔. ของแข็งละลายน้ำทั้งหมด (Total Dissolved Solids)	ไม่เกิน ๑,๐๐๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑,๐๐๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑,๓๐๐ มิลลิกรัมต่อลิตร	-

พารามิเตอร์	ค่ามาตรฐาน			
	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
	สำหรับอาคารอยู่ อาศัยและอาคาร พาณิชย์	สำหรับอาคารอยู่ อาศัยและอาคาร พาณิชย์	สำหรับอาคารอยู่ อาศัยและอาคาร พาณิชย์	
	เพิ่มขึ้นจาก ปริมาณในน้ำใช้ ปกติไม่เกิน ๑,๐๐๐ สำหรับอาคาร สถานพยาบาล	เพิ่มขึ้นจาก ปริมาณในน้ำใช้ ปกติไม่เกิน ๑,๐๐๐ สำหรับอาคาร สถานพยาบาล	-	-
๕. ซัลไฟด์ (Sulfide)	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	-
๖. ทีเคเอ็น (Total Kjeldahl Nitrogen)	ไม่เกิน ๓๕ มิลลิกรัมต่อลิตร	ไม่เกิน ๓๕ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	-
๗. น้ำมันและไขมัน (Oil and Grease)	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร สำหรับอาคารอยู่อาศัย
				ไม่เกิน ๕๐ มิลลิกรัม ต่อลิตร สำหรับอาคาร พาณิชย์และอาคาร สถานพยาบาล
๘. แบคทีเรียกลุ่มโคลิฟอร์มทั้งหมด (Total Coliform Bacteria) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๕,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	ไม่เกิน ๕,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	-	-
๙. แบคทีเรียกลุ่มฟีคอลโคลิฟอร์ม (Fecal Coliform Bacteria) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๑,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	ไม่เกิน ๑,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	-	-
๑๐. คลอรีนอิสระ (Free Chlorine) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	-	-

ข้อ ๖ การตรวจสอบมาตรฐานควบคุมการระบายน้ำทั้งจากอาคารให้ใช้วิธีการ ดังต่อไปนี้

๖.๑ ความเป็นกรดและด่าง ให้ใช้เครื่องวัดความเป็นกรดและด่างของน้ำ (pH Meter) ที่มีความละเอียดไม่ต่ำกว่า ๐.๑ หน่วย

๖.๒ บีโอดี ให้ใช้วิธีบ่มตัวอย่างที่อุณหภูมิ ๒๐ องศาเซลเซียส เป็นเวลา ๕ วันติดต่อกัน และหาค่าออกซิเจนละลายด้วยวิธีเอไซด์มอดิฟิเคชัน (Azide Modification) หรือวิธีเมมเบรนอิเล็กโทรด (Membrane Electrode) หรือวิธีออปติคัลโพรบ (Optical Probe)

๖.๓ ของแข็งแขวนลอยทั้งหมด ให้ใช้วิธีการกรองผ่านกระดาษกรองใยแก้ว (Glass Fiber Filter) และอบแห้งที่อุณหภูมิ ตั้งแต่ ๑๐๓ ถึง ๑๐๕ องศาเซลเซียส เป็นเวลาอย่างน้อย ๑ ชั่วโมง

๖.๔ ของแข็งละลายน้ำทั้งหมด ให้ใช้วิธีระเหยตัวอย่างที่กรองผ่านกระดาษกรองใยแก้ว (Glass Fiber Filter) และอบแห้งที่อุณหภูมิ ๑๘๐ องศาเซลเซียส เป็นเวลาอย่างน้อย ๑ ชั่วโมง

๖.๕ ซัลไฟด์ ให้ใช้วิธีไอโอดิเมทริก (Iodometric Method) หรือวิธีเมทิลีนบลู (Methylene Blue Method)

๖.๖ ทีเคเอ็น ให้ใช้วิธีเจลดาล์ (Kjeldahl)

๖.๗ น้ำมันและไขมัน ให้ใช้วิธีสกัดด้วยตัวทำละลายแล้วแยกหาน้ำมันและไขมัน

๖.๘ แบคทีเรียกลุ่มโคลิฟอร์มทั้งหมดและแบคทีเรียกลุ่มฟิคอลโคลิฟอร์ม ให้ใช้วิธีมัลติเพิล ทิวบ์ เฟอร์เมนเทชัน เทคนิค (Multiple Tube Fermentation Technique)

๖.๙ คลอรีนอิสระ ให้ใช้วิธีไทเทรต (Titrimetric method) หรือวิธีเทียบสี (Colorimetric method) หรือวิธีไอโอดิเมทริก อิเล็กโทรด (Iodometric Electrode Technique)

ข้อ ๗ การคิดคำนวณขนาดของอาคารตามข้อ ๔ ให้เป็นไปตามวิธีการที่คณะกรรมการควบคุมมลพิษกำหนด โดยประกาศในราชกิจจานุเบกษา

ข้อ ๘ การตรวจสอบค่ามาตรฐานน้ำทั้งตามข้อ ๖ ต้องเป็นไปตามคู่มือวิเคราะห์น้ำและน้ำเสียของสมาคมวิศวกรรมสิ่งแวดล้อมแห่งประเทศไทย หรือ Standard Methods for the Examination of Water and Wastewater ซึ่ง American Public Health Association, American Water Works Association และ Water Environment Federation ของประเทศสหรัฐอเมริกากำหนดฉบับล่าสุด หรือตามที่คณะกรรมการควบคุมมลพิษประกาศในราชกิจจานุเบกษา

ข้อ ๙ การเก็บตัวอย่างน้ำทั้งเพื่อการตรวจสอบมาตรฐานควบคุมการระบายน้ำทั้งตามข้อ ๕ ให้เป็น ดังต่อไปนี้

๙.๑ ให้เก็บในจุดระบายทิ้งลงสู่แหล่งน้ำสาธารณะหรือออกสู่สิ่งแวดล้อมหรือจุดอื่นที่สามารถใช้เป็นตัวแทนของน้ำทั้งที่ระบายออกจากอาคาร ในกรณีมีการระบายทิ้งหลายจุดให้เก็บทุกจุด

๙.๒ วิธีการเก็บตัวอย่างน้ำทั้ง ณ จุดเก็บตัวอย่างตามข้อ ๙.๑ ให้เก็บแบบจ้วง (Grab Sampling)

ข้อ ๑๐ ประกาศนี้ให้ใช้บังคับตั้งแต่วันถัดจากวันประกาศในราชกิจจานุเบกษาเป็นต้นไป

ประกาศ ณ วันที่ ๒๘ มิถุนายน พ.ศ. ๒๕๖๗

พลตำรวจเอก พัชรวาท วงษ์สุวรรณ

รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

ภาคผนวก 7-3

เอกสารชี้แนะทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน



ที่ อก ๐๓๑๐(๑)/ ๑๖๕๕

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๕๐๐

๒ ๓ กุมภาพันธ์ ๒๕๖๓

เรื่อง ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

เรียน กรรมการผู้จัดการ บริษัท ทีเอ็นพี เอ็นไวรอนเมนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน
ลงวันที่ ๑๙ ธันวาคม ๒๕๖๖

สิ่งที่ส่งมาด้วย เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท ทีเอ็นพี เอ็นไวรอนเมนท์ จำกัด จำนวน ๒ แผ่น

ตามหนังสือที่อ้างถึง บริษัท ทีเอ็นพี เอ็นไวรอนเมนท์ จำกัด ขอต่ออายุหนังสือรับขึ้นทะเบียน
ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๓๑๘ สถานที่ตั้งเลขที่ ๓๓๒/๑๗๓ หมู่ที่ ๓ ตำบลบางรักพัฒนา
อำเภอบางบัวทอง จังหวัดนนทบุรี ต่อกรมโรงงานอุตสาหกรรม นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้บริษัท ทีเอ็นพี เอ็นไวรอนเมนท์ จำกัด ต่ออายุหนังสือ
รับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน โดยมีองค์ประกอบดังนี้

ก. ผู้ควบคุมดูแลห้องปฏิบัติการวิเคราะห์

- | | |
|----------------------------|----------------------------|
| ๑) นายณัฐชัย ไตรประวัติ | ทะเบียนเลขที่ ว-๓๑๘-ค-๐๐๐๒ |
| ๒) นางสาวเบญจวรรณ ประสารยา | ทะเบียนเลขที่ ว-๓๑๘-ค-๐๐๐๓ |
| ๓) นายไวยหาร ทองเกลี้ยง | ทะเบียนเลขที่ ว-๓๑๘-ค-๐๐๐๔ |
| ๔) นางสาววิไลรักษ์ ไชยสา | ทะเบียนเลขที่ ว-๓๑๘-ค-๐๐๐๕ |
| ๕) นางสาวอนุสรุา แก้วขจร | ทะเบียนเลขที่ ว-๓๑๘-ค-๐๐๐๖ |

ข. เจ้าหน้าที่ประจำห้องปฏิบัติการวิเคราะห์

- | | |
|-----------------------------|----------------------------|
| ๑) นางสาวอภิญญา มะลียทิพย์ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๓ |
| ๒) นายณัฐพล แซ่หลี่ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๖ |
| ๓) นางสาวนภัสสร จำนงภักดี | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๗ |
| ๔) นางสาววิลาวัลย์ สมสาย | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๘ |
| ๕) นางสาวณัฐธิดา พิมพ์พงษ์ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๙ |
| ๖) นางสาวอัญชลี สีชัย | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๐ |
| ๗) นางสาววัชรินทร์ กลิ่นขำ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๓ |
| ๘) นางสาวจารวี อิติ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๕ |
| ๙) นางสาวอัญชลี ผลวิสุทธิ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๖ |
| ๑๐) นางสาวอมรรัตน์ กันเจียก | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๗ |
| ๑๑) นางสาววริศา จินดารัตน์ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๘ |
| ๑๒) นางสาววิมลวรรณ แก่นวงษ์ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๙ |

๑๓) นางสาวจริยา...

๑๓) นางสาวจริยา อิติ	ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๐
๑๔) นายอดิเทพ ชูพันธุ์	ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๑
๑๕) นายศุภเสกข์ แซ่อึ้ง	ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๒
๑๖) นายวุธ รัศมีทัต	ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๓
๑๗) ว่าที่ร้อยตรีพงศกร บุญมา	ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๔
๑๘) นายวุฒิชัย วงศ์ศรี	ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๕
๑๙) นางสาวฐิติภรณ์ แยกกลีจ	ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๖

ค. ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนให้วิเคราะห์ในน้ำเสีย น้ำใต้ดิน อากาศเสีย และ
สิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว ตามสิ่งที่ส่งมาด้วย

หนังสือฉบับนี้จะหมดอายุในวันที่ ๑๔ มกราคม ๒๕๗๐ หากประสงค์จะต่ออายุหนังสือ
รับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน สามารถยื่นคำขอผ่านระบบอิเล็กทรอนิกส์ได้ที่หน้าเว็บไซต์
กรมโรงงานอุตสาหกรรม

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ



(นายศิระ จันทรเจ็ด)

นักวิทยาศาสตร์เชี่ยวชาญ รักษาราชการแทน
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน

กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ

โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕

โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙

ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th



เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

บริษัท ทีเอ็นที เอ็นไวรอนเม้นท์ จำกัด

เลขทะเบียน ว-๓๑๘

ที่ อก ๐๓๑๐(๑)/ ๑๖๕๕

ลงวันที่ ๒๓ กุมภาพันธ์ ๒๕๖๗

ขอขยายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม จำนวน ๑๑ รายการ

น้ำเสีย จำนวน 7 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Biochemical Oxygen Demand	1) 5-Day BOD Test, Azide Modification Method ^[2] 2) 5-Day BOD Test, Membrane Electrode Method ^[2]
2	Oil & Grease	Liquid-Liquid, Partition-Gravimetric Method ^[2]
3	pH	Electrometric Method ^[2]
4	Sulfide	Iodometric Method ^[2]
5	Temperature	Laboratory and Field Methods ^[2]
6	Total Dissolved Solids	Dried at 180 °C ^[2]
7	Total Suspended Solids	Dried from 103 to 105 °C ^[2]

น้ำใต้ดิน จำนวน 1 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	pH	Electrometric Method ^[2]

อากาศเสีย (ปล่องระบาย) จำนวน 2 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Opacity	Ringelmann's Method ^[1]
2	Total Suspended Particulate	Isokinetic Sampling, Gravimetric Method ^[3]

สิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว จำนวน 1 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	pH	Electrometric Method ^[4,5]

3กค๗

เอกสารอ้างอิง...

เอกสารอ้างอิง

1. กระทรวงอุตสาหกรรม. ประกาศกระทรวงอุตสาหกรรม, พ.ศ. 2549. เรื่อง กำหนดค่าปริมาณเขม่าควันที่เจือปนในอากาศที่ระบายออกจากปล่องของหม้อน้ำโรงสีข้าวที่ใช้แก๊สเป็นเชื้อเพลิง.

ราชกิจจานุเบกษา. 4 ธันวาคม 2549. เล่มที่ 123 ตอนพิเศษ 125ง.

2. APHA, AWWA, WEF. **Standard Methods for the Examination of Water and Wastewater**. 24th ed. Washington, DC: APHA, 2023.

3. United States Environmental Protection Agency. **Standards of Performance for New Stationary Sources**. 40 CFR 60. Appendix A, 2023.

4. United States Environmental Protection Agency. Test Methods for Evaluating Solid Waste Physical/Chemical Methods. **pH Electrometric Measurement**. SW-846 Method 9040C, 2004.

5. United States Environmental Protection Agency. Test Methods for Evaluating Solid Waste Physical/Chemical Methods. **Soil and Waste pH**. SW-846 Method 9045D, 2004. 



๒๓ กันยายน ๒๕๖๗

เรื่อง เปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน
ลงวันที่ ๒๖ กรกฎาคม ๒๕๖๗

สิ่งที่ส่งมาด้วย เอกสารแนบท้ายหนังสือเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์
บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด จำนวน ๑ แผ่น

ตามคำขอที่อ้างถึง บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน
เลขทะเบียน ว-๓๑๘ สถานที่ตั้งเลขที่ ๓๓๒/๑๗๓ หมู่ที่ ๓ ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี
ขอเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์ ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

ก. ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๖ ราย

- | | |
|-----------------------------|----------------------------|
| ๑) นางสาวอภิญญา มะลัทธิพิย์ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๓ |
| ๒) นางสาววิลาวัลย์ สมสาย | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๘ |
| ๓) นางสาวอัญชลี สีชัย | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๐ |
| ๔) นางสาววัชรินทร์ กลิ่นขำ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๓ |
| ๕) นางสาวอัญชลี ผลวิสุทธิ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๖ |
| ๖) นายอดิเทพ ชูพันธุ์ | ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๑ |

ข. ให้เพิ่มขอบข่ายสารมลพิษที่วิเคราะห์ในน้ำ/น้ำเสีย ตามสิ่งที่ส่งมาด้วย

อนึ่ง หนังสือฉบับนี้จะหมดอายุพร้อมหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
คือในวันที่ ๑๔ มกราคม ๒๕๗๐ ทั้งนี้สามารถยื่นคำขอผ่านระบบอิเล็กทรอนิกส์ได้ที่หน้าเว็บไซต์กรมโรงงาน
อุตสาหกรรม

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายพรยศ กลั่นกรอง)

รองอธิบดี ปฏิบัติราชการแทน
อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน

กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ

โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕

โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙

ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th



“อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว”



เอกสารแนบท้ายหนังสือเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์

บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

เลขทะเบียน ว-๓๑๘

ที่ อก ๐๓๑๐(๑)/ ๙๖๖๘

ลงวันที่ ๒๓ กันยายน ๒๕๖๗

ขอขยายสารมลพิษที่ได้รับการขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม จำนวน ๓ รายการ

น้ำ/น้ำเสีย จำนวน 3 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Chemical Oxygen Demand	Closed Reflux, Titrimetric Method
2	Chromium (VI)	Colorimetric Method
3	Free Chlorine	Iodometric Method

เอกสารอ้างอิง

APHA, AWWA, WEF. **Standard Methods for the Examination of Water and Wastewater.**
24th ed. Washington DC: APHA Press; 2023.

ที่ อก ๐๓๑๐(๑)/ ๑๒๑๐ ๙



กรมโรงงานอุตสาหกรรม

ถนนพระรามที่ ๖ แขวงทุ่งพญาไท

เขตราชเทวี กรุงเทพฯ ๑๐๕๐๐

๙ ธันวาคม ๒๕๖๗

เรื่อง ยกเลิกบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน
ลงวันที่ ๒๑ พฤศจิกายน ๒๕๖๗

ตามคำขอที่อ้างถึง บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน
เลขทะเบียน ว-๓๑๘ สถานที่ตั้งเลขที่ ๓๓๒/๑๗๓ หมู่ที่ ๓ ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี
ขอยกเลิกบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

๑. ให้ยกเลิกผู้ควบคุมดูแลห้องปฏิบัติการวิเคราะห์ จำนวน ๒ ราย

๑) นางสาววิไลรักษ์ ไชยสา

ทะเบียนเลขที่ ว-๓๑๘-ค-๐๐๐๕

๒) นางสาวอนุสรุา แก้วขจร

ทะเบียนเลขที่ ว-๓๑๘-ค-๐๐๐๖

๒. ให้ยกเลิกเจ้าหน้าที่ประจำห้องปฏิบัติการวิเคราะห์ จำนวน ๔ ราย

๑) นางสาวณัฐธิดา พิมพ์พงษ์

ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๐๙

๒) นางสาวอมรรัตน์ กันเจียก

ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๗

๓) นางสาววาริตา จินดารัตน์

ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๑๘

๔) นางสาวจริยา อีดี

ทะเบียนเลขที่ ว-๓๑๘-จ-๐๐๒๐

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายธีรทัศน์ อิศรางกูร ณ อยุธยา)

รองอธิบดี ปฏิบัติราชการแทน

อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน

กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ

โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕

โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙

ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th



“อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว”





ใบรับรองเลขที่ 23-LB0055
(Certificate No.)

ใบรับรองระบบงาน (Certificate of Accreditation)

อาศัยอำนาจตามความในพระราชบัญญัติการมาตรฐานแห่งชาติ พ.ศ. ๒๕๕๑
(By Virtue of National Standardization Act B.E. 2551 (2008))

เลขาธิการสำนักงานมาตรฐานผลิตภัณฑ์อุตสาหกรรม
(Secretary-General, Thai Industrial Standards Institute)

ออกใบรับรองฉบับนี้ให้
(Issues this certificate to)

บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด
(TNP ENVIRONMENT CO.,LTD.)

ตั้งอยู่เลขที่
(Address)

๓๓๒/๑๗๓ หมู่ที่ ๓ ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี
332/173 Moo 3, Bang Rak Phatthana, Bang Bua Thong, Nonthaburi

ได้รับการรับรองความสามารถ
(Certificate of competence)

ตามมาตรฐานเลขที่ มอก. ๑๗๐๒๕ - ๒๕๖๑
(Standard No. TIS 17025-2561 (2018) (ISO/IEC 17025: 2017))

ข้อกำหนดทั่วไปว่าด้วยความสามารถของ ห้องปฏิบัติการทดสอบและห้องปฏิบัติการสอบเทียบ
General requirements for the competence of testing and calibration laboratories

หมายเลขการรับรองที่ ทดสอบ ๑๖๗๙
(Accreditation No. Testing 1679)

โดยมีรายละเอียดสาขาและขอบข่ายที่ได้ใบรับรอง แสดงไว้ใน QR CODE และ www.tisi.go.th
(Details of the scheme and scope of the certificate are shown in QR CODE and www.tisi.go.th)

ออกให้ ณ วันที่ ๒๘ ธันวาคม พ.ศ. ๒๕๖๕
(Issue date : 28 December B.E. 2565 (2022))

(นายเอกนิติ รมยานนท์)

รองเลขาธิการสำนักงานมาตรฐานผลิตภัณฑ์อุตสาหกรรม
ปฏิบัติราชการแทน
เลขาธิการสำนักงานมาตรฐานผลิตภัณฑ์อุตสาหกรรม



e1328e0a



รายละเอียดสาขาและขอบข่ายใบรับรองห้องปฏิบัติการ

(Scope of Accreditation for Testing)

ใบรับรองเลขที่ 23-LB0055

(Certification No.23-LB0055)



ชื่อห้องปฏิบัติการ

(Laboratory Name)

บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

(TNP ENVIRONMENT CO.,LTD.)

หมายเลขการรับรองที่

(Accreditation No.)

ทดสอบ 1679

(Testing 1679)

ฉบับที่ 02

(Issue No. 02)

ออกให้ตั้งแต่วันที่ 18 พฤศจิกายน พ.ศ. 2567

(Valid from)

(18 November B.E. 2567 (2024))

ถึงวันที่ 18 ธันวาคม พ.ศ. 2570

(Until)

(18 December B.E. 2570 (2027))

สถานภาพห้องปฏิบัติการ

(Laboratory status)

☒ ถาวร

(Permanent)

☐ นอกสถานที่

(Site)

☐ ชั่วคราว

(Temporary)

☐ เคลื่อนที่

(Mobile)

☐ หลายสถานที่

(Multisite)

สาขาการทดสอบ (Field of Testing)	รายการทดสอบ (Parameter)	วิธีทดสอบ (Test Method)
<p>สาขาสิ่งแวดล้อม (environmental field)</p> <p>น้ำและน้ำเสีย (water and wastewater)</p>	<p>- pH 2.0 to 10.0</p> <p>- Total suspended solids (TSS) 5.0 mg/L to 20 000 mg/L</p> <p>- Total dissolved solids (TDS) 10 mg/L to 20 000 mg/L</p> <p>- Total solids (TS) 10 mg/L to 20 000 mg/L</p> <p>- Chemical Oxygen Demand (COD) 10 mg/L to 10 000 mg/L</p>	<p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 4500-H⁺ B</p> <p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 2540 D</p> <p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 2540 C</p> <p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 2540 B</p> <p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 5220 C</p>

กระทรวงอุตสาหกรรมสำนักงานมาตรฐานผลิตภัณฑ์อุตสาหกรรม

(Ministry of Industry, Thai Industrial Standards Institute)

รายละเอียดสาขาและขอบข่ายใบรับรองห้องปฏิบัติการ

(Scope of Accreditation for Testing)

ใบรับรองเลขที่ 23-LB0055

(Certification No. 23-LB0055)



ฉบับที่ 02

(Issue No. 02)

ออกให้ตั้งแต่วันที่ 18 พฤศจิกายน พ.ศ. 2567

(Valid from)

(18 November B.E. 2567 (2024))

ถึงวันที่ 18 ธันวาคม พ.ศ. 2570

(Until)

(18 December B.E. 2570 (2027))

สถานภาพห้องปฏิบัติการ

(Laboratory status)

☒ ถาวร

(Permanent)

☐ นอกสถานที่

(Site)

☐ ชั่วคราว

(Temporary)

☐ เคลื่อนที่

(Mobile)

☐ หลายสถานที่

(Multisite)

สาขาการทดสอบ (Field of Testing)	รายการทดสอบ (Parameter)	วิธีทดสอบ (Test Method)
<p>สาขาสังแวดล้อม (environmental field)</p> <p>น้ำและน้ำเสีย (ต่อ) (water and wastewater) ((Cont.))</p>	<p>- Total hardness 1 mg/L to 10 000 mg/L (expressed as CaCO₃)</p>	<p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 2340 C</p>
<p>สาขาโคคภัณฑ์ (consumer products field)</p> <p>น้ำดื่ม (drinking water)</p>	<p>- pH 2.0 to 10.0</p> <p>- Total dissolved solids (TDS) 10 mg/L to 20 000 mg/L</p> <p>- Total solids (TS) 10 mg/L to 20 000 mg/L</p> <p>- Total hardness 1 mg/L to 10 000 mg/L (expressed as CaCO₃)</p>	<p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 4500-H⁺ B</p> <p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 2540 C</p> <p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 2540 B</p> <p>- Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023, part 2340 C</p>

กระทรวงอุตสาหกรรมสำนักงานมาตรฐานผลิตภัณฑ์อุตสาหกรรม

(Ministry of Industry, Thai Industrial Standards Institute)

Certificate of Registration

QUALITY MANAGEMENT SYSTEM - ISO 9001:2015

This is to certify that:

TNP ENVIRONMENT Co., Ltd.
332/173 Moo 3,
Bangrukphattana,
Bangbuangtong,
Nonthaburi
11110
Thailand

บริษัท ทีเอ็นพี เอ็นไวรอนเมนต์ จำกัด
332/173 หมู่ 3,
ตำบลบางรักพัฒนา
อำเภอบางบัวทอง
จังหวัดนนทบุรี
11110
ประเทศไทย

Holds Certificate Number:

FS 749573

and operates a Quality Management System which complies with the requirements of ISO 9001:2015 for the following scope:

The provision of water quality, ambient air quality, noise level, vibration level monitoring services and monitoring report.

ให้บริการติดตามตรวจสอบคุณภาพน้ำ, คุณภาพอากาศในบรรยากาศทั่วไป, ระดับเสียง, ความสั่นสะเทือนและจัดทำรายงานผลการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม



For and on behalf of BSI:

Chris Cheung, Head of Compliance & Risk - Asia Pacific

Original Registration Date: 2021-09-25

Effective Date: 2021-09-25

Latest Revision Date: 2021-09-25

Expiry Date: 2024-09-24

Page: 1 of 1



...making excellence a habit.™

This certificate was issued electronically and remains the property of BSI and is bound by the conditions of contract.

An electronic certificate can be authenticated [online](https://www.bsi-global.com/ClientDirectory).

Printed copies can be validated at www.bsi-global.com/ClientDirectory or telephone +66(2) 2944889-92.

Further clarifications regarding the scope of this certificate and the applicability of ISO 9001:2015 requirements may be obtained by consulting the organization.

This certificate is valid only if provided original copies are in complete set.



ที่ อก ๐๓๑๐(๑)/ ๕๓๖๒

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๕๐๐

๐๕ มิถุนายน ๒๕๖๗

เรื่อง ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกซน

เรียน กรรมการผู้จัดการ บริษัท เอ็นไวรอนเม้นท์ แอนด์ แลบลอราตอรี จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกซน
ลงวันที่ ๑๐ เมษายน ๒๕๖๗

สิ่งที่ส่งมาด้วย เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกซน
บริษัท เอ็นไวรอนเม้นท์ แอนด์ แลบลอราตอรี จำกัด จำนวน ๒ แผ่น

ตามคำขอที่อ้างถึง บริษัท เอ็นไวรอนเม้นท์ แอนด์ แลบลอราตอรี จำกัด ขอต่ออายุหนังสือรับขึ้น
ทะเบียนห้องปฏิบัติการวิเคราะห์เอกซน เลขทะเบียน ว-๐๒๙ สถานที่ตั้งเลขที่ ๔๐ ซอยเลี้ยวเมืองนนทบุรี ๑๓
ตำบลตลาดขวัญ อำเภอเมืองนนทบุรี จังหวัดนนทบุรี ต่อกรมโรงงานอุตสาหกรรม นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้บริษัท เอ็นไวรอนเม้นท์ แอนด์ แลบลอราตอรี จำกัด ต่ออายุ
หนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกซน โดยมีองค์ประกอบดังนี้

ก. ผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกซน

- | | |
|---------------------------|----------------------------|
| ๑) นายวิริยะ มีสงฆ์ | ทะเบียนเลขที่ ว-๐๒๙-ค-๐๐๐๑ |
| ๒) นางสาวอลิสา ทรงสวัสดิ์ | ทะเบียนเลขที่ ว-๐๒๙-ค-๐๐๐๒ |
| ๓) นางสาวอุไร ศรีเนตร | ทะเบียนเลขที่ ว-๐๒๙-ค-๐๐๐๓ |
| ๔) นายพิสิษฐ์ บุญนาค | ทะเบียนเลขที่ ว-๐๒๙-ค-๐๐๐๔ |

ข. เจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกซน

- | | |
|-------------------------------|----------------------------|
| ๑) นางสาวเย็นฤดี พันธุ์แก้ว | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๑ |
| ๒) นางสาวเสาวณีย์ เมืองทา | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๒ |
| ๓) นางสาวพัชรภรณ์ แจ่มดา | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๓ |
| ๔) นางสาวพัคสนีย์ กิ่งทอง | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๔ |
| ๕) นางสาวพัชรดา เกษามา | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๕ |
| ๖) นางสาวฐิติมา บัวระพา | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๖ |
| ๗) นางสาวพัชรี โตสกุล | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๗ |
| ๘) นางสาวฐิติกา อยู่เย็น | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๘ |
| ๙) นางสาวกัญญารัตน์ สืบสาย | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๐๙ |
| ๑๐) นางสาวธมลวรรณ แจ่มกระจ่าง | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๑๐ |
| ๑๑) นางสาวมนทิตา เศรษฐรักษ์ | ทะเบียนเลขที่ ว-๐๒๙-จ-๐๐๑๑ |

ค. ขอบข่ายชนิดสารมลพิษที่ได้รับขึ้นทะเบียนให้วิเคราะห์ในน้ำ/น้ำเสีย ตามสิ่งที่ส่งมาด้วย

หนังสือฉบับนี้จะหมดอายุในวันที่ ๑๘ เมษายน ๒๕๖๑ หากประสงค์จะต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ให้ยื่นคำขอต่ออายุพร้อมเอกสารประกอบคำขอต่อกรมโรงงานอุตสาหกรรมภายใน ๖๐ วัน ก่อนวันสิ้นอายุของหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ



(นายพริษฐ์ ภาณุภรณ์)

รองอธิบดี ปฏิบัติราชการแทน

อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน

กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ

โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕

โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙

ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th



เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

บริษัท เอ็นไวรอนเม้นท์ แอนด์ แลบลอราตอรี จำกัด

เลขทะเบียน ว-๐๒๙

ที่ อก ๐๓๑๐(๑)/ ๕๓๖๒

ลงวันที่ ๐๔ มิถุนายน ๒๕๖๗

ขอขยายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม จำนวน ๒๖ รายการ

น้ำ/น้ำเสีย จำนวน 26 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Arsenic	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method ^[2]
2	Barium	2) Digestion, Inductively Coupled Plasma Method ^[2]
3	Biochemical Oxygen Demand	Digestion, Inductively Coupled Plasma Method ^[2]
4	Cadmium	1) 5-Day BOD Test, Azide Modification Method ^[2]
5	Chemical Oxygen Demand	2) 5-Day BOD Test, Membrane Electrode Method ^[2]
6	Color	1) Digestion, Direct Air-Acetylene Flame Method ^[2]
7	Copper	2) Digestion, Inductively Coupled Plasma Method ^[2]
8	Cyanide	1) Digestion, Direct Air-Acetylene Flame Method ^[2]
9	Formaldehyde	2) Digestion, Inductively Coupled Plasma Method ^[2]
10	Free Chlorine	Closed Reflux, Titrimetric Method ^[2]
11	Hexavalent Chromium	ADMI Weighted-Ordinate Spectrophotometric Method ^[2]
12	Lead	1) Digestion, Direct Air-Acetylene Flame Method ^[2]
13	Manganese	2) Digestion, Inductively Coupled Plasma Method ^[2]
14	Mercury	1) Digestion, Direct Air-Acetylene Flame Method ^[2]
15	Nickel	2) Digestion, Inductively Coupled Plasma Method ^[2]
16	Oil & Grease	Digestion, Cold-Vapor Atomic Absorption Spectrometric Method ^[2]
17	pH	1) Digestion, Direct Air-Acetylene Flame Method ^[2]
18	Phenols	2) Digestion, Inductively Coupled Plasma Method ^[2]
		1) Liquid-Liquid, Partition-Gravimetric Method ^[2]
		2) Soxhlet Extraction Method ^[2]
		Electrometric Method ^[2]
		Distillation, Direct Photometric Method ^[2]

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
19	Selenium	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method ^[2]
20	Sulfide	2) Digestion, Inductively Coupled Plasma Method ^[2] 1) Iodometric Method ^[2] 2) Methylene Blue Method ^[2]
21	Temperature	Laboratory and Field Methods ^[2]
22	Total Dissolved Solids	Dried at 180 °C ^[2]
23	Total Kjeldahl Nitrogen	Macro-Kjeldahl Method ^[2]
24	Total Suspended Solids	Dried at 103-105 °C ^[2]
25	Trivalent Chromium	1) Digestion, Direct Air-Acetylene Flame Method; Colorimetric Method; Calculation ^[2] 2) Digestion, Inductively Coupled Plasma Method; Colorimetric Method; Calculation ^[2]
26	Zinc	1) Digestion, Direct Air-Acetylene Flame Method ^[2] 2) Digestion, Inductively Coupled Plasma Method ^[2]

เอกสารอ้างอิง

1. สมาคมวิศวกรรมสิ่งแวดล้อมแห่งประเทศไทย. คู่มือวิเคราะห์น้ำเสีย. พิมพ์ครั้งที่ 4. กรุงเทพฯ: เรือนแก้วการพิมพ์, 2547.
2. APHA, AWWA, WEF. Standard Methods for the Examination of Water and Wastewater. 23rd ed. Washington, DC: APHA, 2017.

ภาคผนวก 7-4

เอกสารสอบเทียบเครื่องมือวิเคราะห์

Certificate No.: T/O 660198

Date of issue : 11-Oct-2023

Equipment Description : Refrigerator
Equipment Model : P1010
Equipment Serial No. : P1010-1020-0005
I.D. No. or Control No. : TNP.LAB.01
Manufacturer : Entech Industrial Solution Co.,Ltd.
Customer Name : TNP ENVIRONMENT CO.,LTD.
Customer Address : 332/173 Moo. 3 Tambon Bang Rak Phatthana, Amphoe Bang Bua Thong,
Nonthaburi 11110
Total pages of certificate : 2 pages
Instrument Receiving Date : 9-Oct-2023
Receiving No. : O-230230
Environmental Conditions : All of the measurement were carried out in the working area
Temperature : (25 ± 15) °C
Humidity : (55 ± 30) % RH
Voltage : (220 ± 22) VAC
Calibration Place : 332/173 Moo. 3 Tambon Bang Rak Phatthana, Amphoe Bang Bua Thong,
Nonthaburi 11110
Calibration Procedure No. : This instrument was calibrated by comparison of reference radiation source standard
according to calibration work instration no WI-CL-18-C

The calibration certificate expended uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor k , which for a normal distribution corresponds to a coverage probability of approximately 95%

*The standard uncertainty of measurement has been determined in accordance with M 3003
The expression uncertainty and confidence in measurement.*

This certificate is applied only to item under test environmental condition.

*This calibration certificate may not be reproduced other than in full except with the permission of the issuing laboratory.
Calibration certificates without signature and seal are not valid.*

This calibration certificate documents are traceability to national standards, which realize the unit of measurement according to the International system of units (SI).

Date of Calibration : 9-Oct-2023



Mr. Kittipong Kaewsai
Calibration Engineer



Ms. Nongluck Wongsettee
Technical Manager

Certificate No. : T/O 660198


The Reference Standard Instrument :-

Instrument	Model	Serial No.	Cert No.	
1) Data logger with RTD Probe	Agilent 34972A	MY41187730	PSL-T 0651-1/66	21-Apr-2024
		MY60008352	PSL-T 0651-3/66	21-Apr-2024

Measured room conditions

Temperature :	Minimum: 30.8 °C	Maximum: 31.9 °C
Humidity :	Minimum: 50.7 %RH	Maximum: 57.2 %RH
Voltage :	Minimum: 219.8 VAC	Maximum: 223.4 VAC
Fresh Air Setting:	off	

Sensor Position :

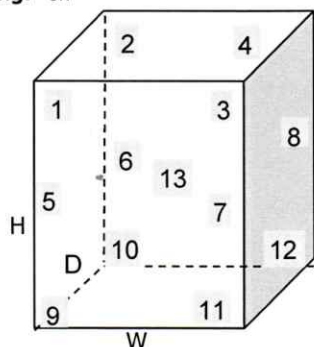

Working Space of chamber :

(Inside Dimensions) W x D x H : 1560 mm x 500 mm x 1380 mm

Sensor Installation Details :

- Sensor Number 1 to 12 installed approximately 50 mm From each wall.
- Sensor Number 13 installed approximately geometric of the chamber.

Results : The measurement results of the calibration were reported in the table below.

(*) Without adjustment

() After adjustment

UUC* Setting	UUC* Reading	Temperature Reading of Standard Sensor								
(°C)	(°C)	Sensor Position								
		1	2	3	4	5	6	7	8	9
		4.02	4.35	4.01	4.20	4.37	4.22	4.17	4.39	4.05
		Sensor Position								
		10	11	12	13					
		4.29	4.30	4.28	4.19					

UUC* Setting	UUC* Reading	Temperature Uniformity	Temperature Stability	Overall Variation	Uncertainty of Measurement	Coverage Factor K
(°C)	(°C)	(°C)	(± °C)	(°C)	(± °C)	
4.0	4.1	1.19	1.08	2.47	1.5	2

UUC* = Unit Under Calibration

Remark :-

- Temperature reading of Standard Sensors shown in the table were taken from the average of Standard reading at each position.
- Temperature Uniformity was calculated from the difference between the maximum and minimum of actual temperature reading from all reference sensors at the same time.
- Temperature Stability was calculated from the maximum stability of nine positions, and formula of Stability is $[(\text{Maximum Temperature Value} - \text{Minimum Temperature Value}) / 2]$
- Overall Variation was calculated from the difference between the maximum and minimum measured temperature throughout observation time.

End of Report

CERTIFICATE OF CALIBRATION

FOR

NOMENCLATURE : pH METER
MANUFACTURER : HORIBA
MODEL / TYPE : LAQUA-PH1100/9615S
SERIAL NO. : B80A0042/9X0B0575
CLID. NO. : 272001452
JOB CONTROL NO. : 230911100397

CUSTOMER : TNP ENVIRONMENT CO., LTD.
332/173 MOO 3 TAMBON BANG RAK PHATTANA,
AMPHOE BANG BUA THONG, NONTABURI 11110

DATE OF RECEIVED : 11 September 2023

DATE OF ISSUED : 14 September 2023

Report of calibration screening must not be taken in part. Except complete. Without the approval of the Calibration Laboratory Co., Ltd.

Calibrated By : Sukgasem Seehanart
Calibration Engineer



Approved By : Mongkol Yotsoontorn
Authorized Signatory
14 September 2023



This Calibration Certificate documents the traceability to national standards, which realize the units of measurement according to
the International System of Units (SI)

Certificate No. Q23100397

F3-011-04/01-12

page 1 of 3



@clccalibration

REPORT OF CALIBRATION

FOR

NOMENCLATURE : pH METER
MANUFACTURER : HORIBA
MODEL / TYPE : LAQUA-PH1100/9615S
SERIAL NO. : B80A0042/9X0B0575
DATE OF CALIBRATION : 12 September 2023

ENVIRONMENT CONDITIONS :

Temperature : $(25 \pm 2.5) ^\circ\text{C}$

Relative Humidity : $(50 \pm 15) \% \text{ RH}$

PROCEDURE USED :

This instrument was calibrated under procedure No. **CLC-CPCH-01**. The calibration was performed by direct measurement with Certified Reference Material (CRM).

REFERENCE STANDARD USED :

1. pH Standard Solution, NIMT TRM CODE TRM-S-2003, TRM CODE TRM-S-2007.
2. pH Standard Solution, Control Company Catalog Number 06664263,11784256, Lot Number CC752722.

TRACEABILITY :

1. The measurements are traceable to International System of Units (SI) , through National Institute of Metrology (Thailand).
Lot Number. 040822 , 230822. Due Date 26 April 2024.
2. The measurements are traceable to International System of Units (SI) , through Control Company.
Certificate No. 4288-13355261 , Due Date 06 May 2024.

UNCERTAINTY :

The reported expanded uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor complies with the table which for a normal distribution corresponds to a coverage probability of approximately 95 %.

It has been evaluated according to the "Evaluation of the Uncertainty of Measurement in Calibration (EA-4/02 M:2022)"

Certificate No. Q23100397

F3-011-04/01-12

page 2 of 3





CLC
Accredited
ISO/IEC 17025

CALIBRATION LABORATORY Co., LTD.

2/10-11,14,55 Soi Prasert Manukit 29 Yaek 4, Prasert Manukit Rd., Ladphrao, Bangkok 10230
Tel. 02-578-0353-4 Fax: 02-578-2672 www.cal-laboratory.com E-mail:sale@cal-laboratory.com



CONDITION OF CALIBRATION ITEM : GOOD

MEASUREMENT RESULTS : (X) without adjustment () adjustment

The table in the following gives the calibration results and associated measurement uncertainties of pH meter.

CALIBRATION DATA

pH METER RESULT @ 25 °C

Standard pH Buffer Solution (pH)	pH Meter Reading (pH)	pH Meter Reading (mV)	Correction (pH)	Uncertainty of pH Measurement (\pm pH)	k Factor
4.003	4.01	150.2	-0.007	0.010	2,00
7.000	7.00	-26.1	0.000	0.015	2,06
10.003	10.01	-187.1	-0.007	0.016	2,05

Technical Note. Setting function CAL 3 point (4,7,10).

The Scope of Accredited ANAB Certificate No. ACDM-2814 Version 008 Page 2,3 of 54

This report is valid for the above stated instrument/s only.

CLC

End of Certificate

Certificate No. Q23100397

F3-011-04/01-12

page 3 of 3



@clccalibration

CERTIFICATE OF CALIBRATION

FOR

NOMENCLATURE : DIGITAL THERMO-HYGROMETER
MANUFACTURER : EXTECH INSTRUMENTS
MODEL / TYPE : 445814
SERIAL NO. : PONPE5816745
CLID. NO. : 232303263
JOB CONTROL NO. : 230911100396

CUSTOMER : TNP ENVIRONMENT CO., LTD.
332/173 MOO 3 TAMBON BANG RAK PHATTANA,
AMPHOE BANG BUA THONG, NONTABURI 11110

DATE OF RECEIVED : 11 September 2023

DATE OF ISSUED : 15 September 2023

Report of calibration screening must not be taken in part. Except complete. Without the approval of the Calibration Laboratory Co., Ltd.

Calibrated By :

Oranut Kamchatphai

Calibration Engineer



Approved By :

Mongkol Yotsoontorn

Authorized Signatory

15 September 2023



This Calibration Certificate documents the traceability to national standards, which realize the units of measurement according to the
International System of Units (SI)

Certificate No. Q23100396

F3-011-04/01-12

page 1 of 3



@clccalibration

REPORT OF CALIBRATION

FOR

NOMENCLATURE : **DIGITAL THERMO-HYGROMETER**
MANUFACTURER : **EXTECH INSTRUMENTS**
MODEL / TYPE : **445814**
SERIAL NO. : **PONPE5816745**
DATE OF CALIBRATION : **13 September 2023**

ENVIRONMENT CONDITIONS :

Temperature : $(23 \pm 2) ^\circ\text{C}$

Relative Humidity : $(55 \pm 10) \% \text{RH}$

PROCEDURE USED :

This instrument was calibrated under procedure No. **CLC-CPTH-11**. The calibration was performed by using Chilled Mirror Hygrometer and Temperature & Humidity Chamber which maintained by the Calibration Laboratory Co., Ltd.

REFERENCE STANDARD USED :

Chilled Mirror Hygrometer, Edgetech Model Dew Master S/N. 36151.

Temperature & Humidity Chamber, PGC Model 9141-5114 S/N.0802282.

TRACEABILITY :

The measurements are traceable to International System of Units (SI) , through Thunder Scientific Corporation.

Certificate No. 21028, Due Date 09 December 2023.

UNCERTAINTY :

The reported expanded uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor $k = 2,00$ which for a normal distribution corresponds to a coverage probability of approximately 95 %.

It has been evaluated according to the "Evaluation of the Uncertainty of Measurement in Calibration (EA-4/02 M:2022)"

Certificate No. Q23100396

F3-011-04/01-12

page 2 of 3



@clccalibration

CONDITION OF CALIBRATION ITEM : GOOD

MEASUREMENT RESULTS : (X) without adjustment () adjustment

The table in the following gives the calibration results and associated measurement uncertainties of the measuring digital thermo-hygrometer.

CALIBRATION DATA

1. CORRECTION OF TEMPERATURE

Test point (° C)	Actual Temperature (° C)	DUC Reading (° C)	Correction (° C)	Uncertainty ± (° C)
20.0	20.01	19.9	+0.11	0.27
25.0	25.01	25.2	-0.19	

2. CORRECTION OF HUMIDITY

STD Temperature (° C)	STD Reading (%RH)	DUC Reading (%RH)	Correction (%RH)	Uncertainty ± (%RH)
25	50.0	47	+3.0	0.8

Note. The Scope of Accredited ANAB Certificate No. ACDM-2814 Version 008 Page 49 of 54

This report is valid for the above stated instrument/s only.

End of Certificate

Certificate No. Q23100396

F3-011-04/01-12

page 3 of 3



@clccalibration

Certificate of Calibration

Certificate No. : 67-400049-1

Page : 1 of 2

Submitted by : TNP Environment Co., Ltd.
332/173 Moo 3 Bang Rak Phatthana, Bang Bua Thong, Nonthaburi 11110

Equipment : Liquid in Glass Thermometer

Manufacturer :	SK	Model :	N/A
Range :	0 °C to 200 °C	Resolution :	1 °C
Serial No. :	N/A	Immersion :	Total
ID No. :	TNP.LAB.12		

Environment :

Ambient Temperature :	(23 ± 2) °C
Relative Humidity :	(50 ± 15) %
Line Voltage :	(220 ± 22) VAC

Date of Received : 26 January 2024

Date of Calibration : 01 February to 02 February 2024

Date of Issue : 02 February 2024

Calibrated by : Chortip Samchusri

Calibration Method : This instrument was calibrated by In-house method comparison technique CAL-M4001 based on ASTM E77-07 by compared with PRT in the liquid bath at the constant controlled temperature.

The temperature scale used was based on ITS-90

Reference Standard Instruments : This certification is traceable to the International System of Units

1. Platinum Resistance Thermometer (PRT)

<u>ID No.</u>	<u>Cert. No.</u>	<u>Due Date</u>	<u>Traceability</u>
400001	TT-0016-22	07 Feb 2024	National Institute of Metrology Thailand (NIMT)

2. Standard Digital Thermometer

<u>ID No.</u>	<u>Cert. No.</u>	<u>Due Date</u>	<u>Traceability</u>
400003	23E1866	01 Jun 2025	National Institute of Metrology Thailand (NIMT)
400004	23E1866	01 Jun 2025	National Institute of Metrology Thailand (NIMT)

Approved by :

(Surachai Promthong)

Laboratory Manager



Certificate of Calibration

Certificate No. : 67-400049-1

Page : 2 of 2

Result of Calibration : Without Adjustment

UUC Condition As-Received : Good

Function : Temperature measurement

Ice point check : UUC* reading 0 ° C Standard reading 0.8789 ° C

Standard Reading (° C)	UUC Reading (° C)	Correction (° C)	Uncertainty (± ° C)
21.2064	20	1.2	0.31
31.3084	30	1.3	0.31

Remark

UUC : Unit Under Calibration

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2$, providing a level of confidence of approximately 95%

- o0o -



Certificate no: H/T 670338

Date of issue : 21-Mar-24

Instrument description : Thermo-Hygrometer
Instrument model : Extech 445815
Instrument serial no. : PONPE5899554
ID no. or control no. : TNP.LAB.21
Manufacturer : Extech Instruments
Probe description : -
Probe model : -
Probe serial : -
Customer name : TNP ENVIRONMENT CO.,LTD.
Customer address : 332/173 Moo 3 Tambon Bang Rak Phatthana, Amphoe Bang Bua Thong, Nonthaburi 11110

Total pages of certificate : 2 Pages
Receiving no. : L-241004-1
Receiving date. : 08-Mar-24
Parameter of calibration : Temperature Calibration
Condition of UUC. : Used
Ambient condition : All of the Measurement were carried out the stabilized laboratory
Temperature : 23 ± 5 °C
Humidity : 55 ± 15 %RH
Calibration place : 17/121 Soi Ngamwongwan 47 Yaek 48, Toongsonghong, Laksi, Bangkok 10210
Calibration procedure no. : This instrument was calibrated by comparison of indication with the Standard Thermo- hygrometer according to calibration Work Instruction no .WI-CL-11-C

The calibration certificate expanded uncertainty of measurement is stated as the standard uncertainty of measurent Multiplied by coverage factor $k=2$, which for a normal distribution corresponds to a coverage probability of approximately 95%.

This certificate is applied only to item under test Environmental condition.

This Calibration Certificate may not be reporduced other than in full except with the permission of the issuing laboratory. Calibration certificates without signature and seal not valid.

This calibration certificate documents are tracebility to national standards, which realize measurement according to the International System of Units (SI).

Date of calibration : 20-Mar-24



Mr. Peerawat Thongbai

Calibration Technician



Mrs. Nongluck Wongsettee

Technical Manager

Certificate no: H/T 670338

Standard references

Standard	Reference No.	Vendor	Due Date
ARALAB 300ECP,Fitoclima	S2023070040-001	MIT	07-Jul-24
Thermo HygroPalm HP 23-A	SG-H-00579/66	Success Gateway	16-Aug-24

Measured room conditions

Temperature : 22.1 °C

Humidity : 55.9 %RH

Pressure : 1019.3 mbar

Calibration results (Without Adjustment)

Reference temperature : - °C

Parameter of standard	Standard values	Mean of UUC.	Error	Uncertainty (±)
Temperature (°C)	19.97	20.1	0.13	0.50
Temperature (°C)	25.02	25.2	0.18	0.50
Temperature (°C)	29.99	30.2	0.21	0.50

Remark : -

End of Report

Certificate no: H 670285

Date of issue : 21-Mar-24

Instrument description : Thermo-Hygrometer
Instrument model : Extech 445815
Instrument serial no. : PONPE5899554
ID no. or control no. : TNP.LAB.21
Manufacturer : Extech Instruments
Probe description : -
Probe model : -
Probe serial : -
Customer name : TNP ENVIRONMENT CO.,LTD.
Customer address : 332/173 Moo 3 Tambon Bang Rak Phatthana, Amphoe Bang Bua Thong, Nonthaburi 11110

Total pages of certificate : 2 Pages
Receiving no. : L-241004
Receiving date. : 08-Mar-24
Parameter of calibration : Humidity Calibration
Condition of UUC. : Used
Ambient condition : All of the Measurement were carried out the stabilized laboratory
Temperature : 23 ± 5 °C
Humidity : 55 ± 15 %RH
Calibration place : 17/121 Soi Ngamwongwan 47 Yaek 48, Toongsonghong, Laksi, Bangkok 10210

Calibration procedure no. : This instrument was calibrated by comparison of indication with the Standard Thermo- hygrometer according to calibration Work Instruction no .WI-CL-11-C

The calibration certificate expanded uncertainty of measurement is stated as the standard uncertainty of measurent Multiplied by coverage factor $k=2$, which for a normal distribution corresponds to a coverage probability of approximately 95%.

This certificate is applied only to item under test Environmental condition.

This Calibration Certificate may not be reporduced other than in full except with the permission of the issuing laboratory. Calibration certificates without signature and seal not valid.

This calibration certificate documents are tracebility to national standards, which realize measurement according to the International System of Units (SI).

Date of calibration : 19-Mar-24



Mr. Peerawat Thongbai

Calibration Technician



Mrs. Nongluck Wongsettee

Technical Manager

Certificate no: H 670285

Standard references

Standard	Reference No.	Vendor	Due Date
Thermo HygroPalm HP 23-A	SG-H-00579/66	Success Gateway	16-Aug-24
Hydrogen 2-XL	Performance	Entech	24-Mar-24

Measured room conditions

Temperature : 22.7 °C Humidity : 56.7 %RH Pressure : 1013.3 mbar.

Calibration results (Without Adjustment)

Reference temperature : 25.0 °C

Parameter of standard	Standard values	Mean of UUC.	Error	Uncertainty (±)
Humidity (%RH)	35.09	31	-4.09	1.3
Humidity (%RH)	50.03	48	-2.03	1.5
Humidity (%RH)	64.97	68	3.03	1.5

Remark : -

End of Report

Certificate of Calibration

Certificate No. : 66-400687-1

Page : 1 of 2

Submitted by : TNP Environment Co., Ltd.
332/173 Moo 3 Bang Rak Phatthana, Bang Bua Thong, Nonthaburi 11110

Equipment : Air Chamber (Oven)
Manufacturer : Memmert Model : UF75
Range : N/A °C Resolution : 0.1 °C
Serial No. : B320.0251 ID No. : N/A

Environment : On site calibration was carried out at the Laboratory, TNP Environment Co., Ltd.
Ambient Temperature : (27.0 to 28.0) °C
Relative Humidity : (45 to 50) %
Line Voltage : (228.0 to 230.0) V

Date of Received : 11 December 2023

Date of Calibration : 11 December 2023

Date of Issue : 14 December 2023

Calibrated by : Permpon Chanpu

Calibration Method : CAL-M4004, TLAS G-20

The temperature scale used was based on ITS-90

Reference Standard Instruments : This certification is traceable to the International System of Units
Standard Digital Thermometer with Thermocouple probe

ID No.	Cert. No.	Due Date	Traceability
400046 & 400023	66-400547-1	04 Apr 2024	National Institute of Metrology Thailand (NIMT)

Approved by :



(Surachai Promthong)

Laboratory Manager

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.



Certificate of Calibration

Certificate No. : 66-400687-1


Page : 2 of 2

Result of Calibration : Without Adjustment

UUC Condition As-Received : Good

Function : Temperature measurement

This instrument was setting air ventilation at position 0 (close)

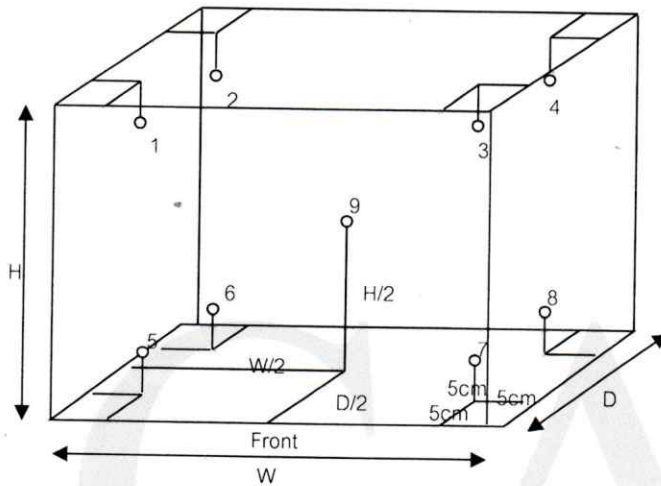

Inside of Chamber

W = 0.40 m

D = 0.33 m

H = 0.56 m

Capacity = 0.07 m³

Test Point (°C)	Setting Temperature (°C)	Indicating Temperature (°C)	Measured Temperature (°C) @ Sensor No.									Uncertainty (± °C)
			1	2	3	4	5	6	7	8	9	
85.0	85.0	85.0	85.3	85.1	85.2	85.1	85.0	84.8	84.7	84.7	85.0	0.64
104.0	104.0	104.0	104.3	104.2	104.3	104.1	104.0	103.8	103.7	103.7	104.0	0.69
180.0	180.0	180.0	179.5	179.9	180.0	179.8	179.9	179.4	178.9	179.4	180.0	0.95

Test Point (°C)	Setting Temperature (°C)	Indicating Temperature (°C)	Measured Uniformity (°C)	Measured Stability (°C)	Overall Variation (°C)
85.0	85.0	85.0	0.4	0.1	0.8
104.0	104.0	104.0	0.4	0.1	0.8
180.0	180.0	180.0	1.4	0.3	1.6

Remark The uncertainty is not combine uniformity of the air chamber

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor $k = 2$, providing a level of confidence of approximately 95%

- o0o -

Handwritten signature





ID LINE : IEC17025



Certificate of Calibration

Certificate Number : SPR23110535-2

Page : 1 of 3

Customer : TNP ENVIRONMENT CO.,LTD.

332/173 Moo.3, Bang Rak Phatthana, Bang Bua Thong, Nonthaburi
11110

Equipment Name : Water Quality Meter

Manufacturer : Digicon

Model : WA-48SD

Serial Number : T.075714

ID. Number : TNP-LAB-46

Environmental Conditions

Ambient Temperature : $23^{\circ}\text{C} \pm 2^{\circ}\text{C}$

Relative Humidity : $50\% \pm 15\%$

Location of Calibration : In-Lab

Calibration Procedure : SP-CPC-04-01,
SP-CPC-04-02,

Method of Calibration : SP-CPC-04-11

Received Date : 30 Nov 2023

Calibration Date : 19 Jan 2024

Recommend Due Date : 19 Jan 2025

Date of Issue : 20 Jan 2024

This certifies that the above instrument was calibrated in compliance with the calibration system requirement of ISO/IEC 17025:2017 in accordance with reference procedure. Standards used to perform this calibration are certified by to NIST or equivalent, National metrology institute, Natural physical constants, consensus standards. The result reported herein apply only to the calibration of the item described above as received. Our decision rule is to contact the customer if the item pass and fail calibration when the results include the uncertainties and the customer must determine if the results meets their needs.

The calibration certificate shall not be reproduced except in full, without written approval of SP Metrology System (Thailand).

Calibrated by : Mr.Sarawut Khitmai

Calibration Officer

Approved by :

(Mr.Prayoon Topart)

Authorized Signatory



ID LINE : IEC17025



Calibration Report

Certificate Number : SPR23110535-2

Page : 2 of 3

Reference Standards

Equipment Name	Model	Serial No.	Certificate No.	Due. Date
Zero Oxygen Solution	HI7040L	Lot S0027-23 _	21C31	21 Mar 2028
Standard pH Solution	PH016.L5	Lot No.882984	61267077	20 Mar 2024
Standard pH Solution	PH107.L5	Lot No.882985	61275614	13 Apr 2024
Standard pH Solution	PH020.L5	Lot No.882986	61268050	20 Mar 2024
Conductivity Standard 84 uS/cm	CS84M0S.L5	Lot No.882987	61247444	20 Mar 2024
Conductivity Standard 1413 uS/cm	CS1413M0S.L5	Lot No.882988	61267992	20 Mar 2024
Conductivity Standard 12880 uS/cm	CS1288P1S.L5	Lot No.882989	61247253	20 Mar 2024
Sodium Chloride Standard Solution	RM003461L25	Lot No.841770	97756699	23 Sep 2024

Traceability

This certification is traceable to the International System of Unit maintained at :
HANNA - Hanna Instruments (Thailand) Ltd.

C.P.A. Chem - ANAB#AT-1836 (ISO/IEC 17025:2017) and ANAB#AR-1835 (ISO/IEC
17034:2016)



ID LINE : IEC17025



Result of Calibration

Certificate No. : SPR23110535-2

Page : 3 of 3

pH Measurement @ 25 °C

Unit : pH

Standard Solution	UUC Reading	Error	Uncertainty (±)
4.008	3.98	-0.028	0.014
6.984	7.01	0.026	0.012
10.011	10.02	0.009	0.018

Conductivity Measurement @ 25 °C

Standard Solution	UUC Reading	Error	Uncertainty (±)
84 µS/cm	84.6 µS/cm	0.6 µS/cm	0.60 µS/cm
1.413 mS/cm	1.415 mS/cm	0.002 mS/cm	0.0082 mS/cm
12.88 mS/cm	12.89 mS/cm	0.01 mS/cm	0.075 mS/cm

* Dissolved Oxygen Permanance Test

Unit : mg/L

Actual Standard	UUC Reading	Error	Uncertainty (±)
0.0	0.0	0.0	0.13
5.0	4.9	-0.1	0.13
8.3	8.2	-0.1	0.13

Salinity Measurement

Unit : % Salinity

Actual Standard	UUC Reading	Error	Uncertainty (±)
5.0269	5.04	0.0131	0.015

Note:

The result of calibration was found accurate as show on date and place of calibration only.
This Certificate is not certified for any commercial transaction.
Calibration Marked (*) "Not ANAB Accredited " in this Certificate have been included for completeness.

Measurement Uncertainty

The reported uncertainty of measurement is the expanded uncertainty obtained by multiplying the standard uncertainty with the coverage factor $k = 2$, providing a level of confidence approximately 95%.

- End of Certificate -



TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484



Certificate of Calibration

Cert.No.: 24CG774

Page.: 1 of 2

Equipment : Burette

Capacity : 50 mL

Serial No. : -

ID. No. : BUR-005

Manufacturer : Witeg

Made in : Germany

Submitted by : Environment & Laboratory Co.,Ltd.
40 Soi Liangmueangnonthaburi 13
Talat Kwan, Mueang, Nonthaburi 11000

Ambient Temperature : (20 ± 2.5) °C

Relative Humidity : (50 ± 10) %

Barometric Pressure : 760 mmHg

Calibration Procedure : ASTM E 542 - 01

Calibrated by : Natcha Chayingcheiw

Approved by :

Approved Signatory

- () Ponpan Paipim
(✓) Srisuda Khamtha
() Sa-ngeunkam Wongsu

Issue Date :

20 February 2024

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written
Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.



Equipment : Burette
Received Date : 16 February 2024
Condition As-Received : Used Item
Calibration Date : 20 February 2024
Reference : 2402-0505DC-6

Cert.No.: 24CG774
Page.: 2 of 2

Condition of this result of calibration

1. Reference Standard Instruments :

<u>Instruments</u>	<u>Model</u>	<u>Serial No.</u>	<u>ID. No.</u>	<u>Certificate No.</u>	<u>Traceability</u>	<u>Due date</u>
1) Balance	XP205DR	1126143764	140RC004	23MM538	TPA	15 Sep 2024
2) Thermo-Hygrograph	THDX-CE	00016540	140EC001	23H1275	TPA	09 June 2024
3) Thermometer	-	0834181	140EC005	23I948	TPA	10 Aug 2024

This certification is traceable to SI Unit

2. The certificate is valid only to the item calibrated on date and place of calibration.
3. True value is converted to true volume at the standard temperature of 20 °C

Calibration result :

Nominal capacity (mL)	Reading (mL)	Uncertainty (± mL)	k Factor
50	49.9765	0.010	2.00

Remark mL = cm³

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k , providing a level of confidence of approximately 95 %.

-o0o-

