

ภาคผนวก 2.4

บันทึกการตรวจสอบประสิทธิภาพ  
ระบบแจ้งเตือนและป้องกันอัคคีภัย

NOVOTEL		Smoke Detector Testing In Guest Room (2025)																							
BANGKOK FUTURE PARK BANGKOK																									
Floor 3		Floor 4		Floor 5		Floor 6		Floor 7		Floor 8		Floor 9		Floor 10		Floor 11									
307	KGB	401	KGB	22-Mar-25	501	KGB	05-Apr-25	601	KGB	15-Mar-25	701	KGB	14-Apr-25	801	KGB		901	KGB	12-Mar-25	1001	KGB		1101	KGB	17-Jun-68
308	TWB	402	TWB	21-Mar-25	502	TWB	03-Apr-25	602	TWB		702	TWB	27-Jan-25	802	TWB		902	TWB	12-Mar-25	1002	TWB		1102	TWB	04-Feb-25
309	KGE	403	KGB		503	KGB	05-Apr-25	603	KGB	06-Mar-25	703	KGB	28-Feb-25	803	KGB		903	KGB	01-Jun-25	1003	KGB	12-Apr-25	1103	KGB	18-Mar-25
310	KGE	404	TWB	21-Mar-25	504	TWB	05-Apr-25	604	TWB	15-Mar-25	704	TWB	28-Feb-25	804	TWB		904	TWB	11-Mar-25	1004	TWB		1104	TWB	24-Feb-25
311	TWB	405	KGB		505	KGB	05-Apr-25	605	KGB		705	KGB	12-Mar-25	805	KGB	14-Jun-68	905	KGB	14-Mar-25	1005	KGB		1105	KGB	22-Mar-25
312	KGB	406	TWB		506	TWB	30-Jan-25	606	TWB		706	TWB	10-Mar-25	806	TWB		906	TWB	08-Jun-25	1006	TWB		1106	TWB	
314	TWB	407	KGB		507	KGB	05-Apr-25	607	KGB	04-Apr-25	707	KGB	29-Mar-25	807	KGB	26-May-25	907	KGB		1007	KGB		1107	KGB	30-Jan-25
315	KGB	408	TWB		508	TWB	30-Jan-25	608	TWB	22-Mar-25	708	TWB	14-Apr-25	808	TWB		908	TWB	28-Mar-25	1008	TWB	17-Jun-68	1108	TWB	24-Feb-25
316	TWB	409	KGE	28-Jan-25	509	KGE	27-Feb-25	609	KGE	09-Mar-25	709	KGE	14-Apr-25	809	KGE		909	KGE		1009	KGE		1109	KGE	18-Mar-25
317	KGB	410	KGE	06-Feb-25	510	KGE	03-Feb-25	610	KGE	27-Feb-25	710	KGE	14-Apr-25	810	KGE	08-Jun-25	910	KGE	24-Mar-25	1010	KGE	27-Mar-25	1110	KGE	08-Mar-25
318	TWB	411	TWB	06-Feb-25	511	TWB	14-Mar-25	611	TWB	09-Jun-25	711	TWB	11-Mar-25	811	TWB	23-Mar-25	911	TWB	24-Mar-25	1011	TWB	13-Mar-25	1111	TWB	
319	TWB	412	TWB	29-Mar-25	512	TWB	03-Feb-25	612	TWB	15-Mar-25	712	TWB	28-Jan-25	812	TWB	17-Jun-68	912	TWB	28-Mar-25	1012	TWB	12-Apr-25	1112	TWB	
320	TWB	414	TWB	29-Mar-25	514	TWB	31-Jan-25	614	TWB	30-Mar-25	714	TWB	11-Mar-25	814	TWB		914	TWB	24-Mar-25	1014	TWB		1114	TWB	18-Mar-25
321	STDO	415	TWB		515	TWB	28-Jan-25	615	TWB		715	TWB	13-Apr-25	815	TWB	01-Apr-25	915	TWB		1015	TWB		1115	TWB	23-Mar-25
322	TWB	416	TWB	04-Apr-25	516	TWB	05-Apr-25	616	TWB		716	TWB	26-Feb-25	816	TWB		916	TWB	13-Mar-25	1016	TWB		1116	TWB	22-Mar-25
323**	STDO	417	TWB		517	TWB	03-Apr-25	617	TWB		717	TWB	16-Mar-25	817	TWB		917	TWB	31-Mar-25	1017	TWB	26-May-25	1117	TWB	24-Feb-25
324	TWB	418	TWB		518	TWB	02-Apr-25	618	TWB		718	TWB	16-Mar-25	818	TWB		918	TWB	15-Apr-25	1018	TWB	15-Apr-25	1118	TWB	13-Mar-25
325	STDO	419	TWB		519	TWB	03-Apr-25	619	TWB	26-May-25	719	TWB	16-Mar-25	819	TWB		919	TWB	14-Mar-25	1019	TWB	09-Jun-25	1119	TWB	
326	KGB	420	TWB	06-Feb-25	520	TWB	05-Apr-25	620	TWB		720	TWB	14-Apr-25	820	TWB	28-Mar-25	920	TWB	27-Mar-25	1020	TWB	27-Mar-25	1120	TWB	
327	TWA	421	KGB	12-Mar-25	521	KGB	23-Mar-25	621	KGB		721	KGB	03-Apr-25	821	KGB	14-Apr-25	921	KGB	31-Mar-25	1021	KGB		1121	KGB	
328	KGA	422	TWB	30-Mar-25	522	TWB	05-Apr-25	622	TWB		722	TWB	10-Mar-25	822	TWB	09-Jun-25	922	TWB	05-Feb-25	1022	TWB	15-Mar-25	1122	TWB	10-Mar-25
Total	14	423	KGB	06-Feb-25	523	KGB	13-Mar-25	623	KGB		723	KGB	04-Mar-25	823	KGB	05-Feb-25	923	KGB	03-Mar-25	1023	KGB	25-Feb-25	1127	KGB	04-Feb-25
Update 17/06/2025		424	TWB		524	TWB	03-Apr-25	624	TWB	21-Mar-25	724	TWB	27-Jan-25	824	TWB	27-Jan-25	924	TWB	28-Mar-25	1024	TWB		1128	TWB	08-Mar-25

บันทึกหลักฐานการตรวจสอบและบำรุงรักษาอุปกรณ์เตือนภัยและป้องกันอัคคีภัย

**NOVOTEL**  
BANGKOK PULHILL (NEW NOVOTEL)

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 26/6/68  
LOCATION : 1001, 1014

**NOVOTEL**  
BANGKOK PULHILL (NEW NOVOTEL)

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 29/6/68  
LOCATION : 111

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / ข้อสังเกต 1001 = SDZ 10-79 1014 = SDZ 10-61				
Operation By		Chief Engineer		

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / ข้อสังเกต 111 = SDZ 134				
Operation By		Chief Engineer		

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 7/6/68

LOCATION ..... 906 .....

LOCATION ..... 906.....

[illegible]

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manrual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Hmane position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / 備註		906 : SDZ9-99		



**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 1/0/68  
LOCATION: 611, 922, 1099

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / หมายเหตุ 611-SPZ 6-22 921-SPZ 3-96 1011-SPZ 10-57				

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE : 30/6/19  
LOCATION : 906

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	

Comment / หมายเหตุ 906 = SPZ8-113

Operator By

Checked By

Chief Engineer

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE : 17/6/19  
LOCATION : 817, 1008, 1101

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	

Comment / หมายเหตุ 812 - SPZ - 103  
1008 - SPZ - 68  
1101 - SPZ - 122

Operator By

Checked By

Chief Engineer

DATE: 98-6-68  
LOCATION: 415, 406, 320

LOCATION 1017-619-317  
407

\_\_\_\_\_

Downloaded from <http://ajphaphysocpharm.sagepub.com> at 11:01 11 November 2014

DATE: 2/4/68  
LOCATION: 308, 314, 518

DATE: 4/14/69  
LOCATION: 607 - 416 - 211

[illegible]

Chief Engineer

Recheck By

Operation By

**Chief Engineer**

[illegible]

Operation By

Recheck By

**Chief Engineer**

DATE: 10/4/68  
LOCATION: Corridor

DATE : 10/4/60  
LOCATION : 525

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Hence position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	
Comment / Signature		SD25-99 SD25-109		
		SD25-91		
		SD25-97		
		SD25-96		
		SD25-123		
		SD25-119		
		SD25-115		
				Chief Engineer
Operation By		Redneck By		

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	✓	
2.	Heat Detector	✓	—	
3.	Smoke Detector	—	✓	
4.	Pull Manual Call Point	—	✓	
5.	Strobe Light	—	✓	
6.	Horn and Strobe Speaker	—	✓	
7.	Alarm buzzer	—	✓	
8.	Zone Indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	✓	
11.	Fine Ventilation System Automatic Close	—	✓	
12.	Gas Protection Valve Automatic Close	—	✓	
13.	Pressurize Fan System Automatic Open	—	✓	
14.	Smoke Fan System Automatic Open	—	✓	
15.	Air condition : AHU and OAU System Automatic Close	—	✓	
16.	Telephone jack	—	✓	
17.	Sounder base	✓	—	
18.	Fire work control program	✓	—	
Comment / 備註		5255DZ - 126		

Operation By

Redcheck By

Chief Engineer

DATE : 10/4/69  
LOCATION 501-503-504-505  
507-516-518-520-529

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	
Comment / หมายเหตุ 501=SDZ 5 - 120				
503=SDZ 5 - 117				
504=SDZ 5 - 116				
505=SDZ 5 - 114				
507=SDZ 5 - 111				
516=SDZ 5 - 102				
518=SDZ 5 - 98				
520=SDZ 5 - 96				
529=SDZ 5 - 99				
Operation By				
Recheck By				
Chief Engineer				

DATE : 12/4/68  
LOCATION 1003-1012

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	
Comment / หมายเหตุ 1003 = SDZ 10 -				
1012 = SDZ 10 - 63				
Operation By				
Recheck By				
Chief Engineer				

DATE: 13/4/68  
LOCATION: 715-716

DATE: 14/4/68  
LOCATION 921-701-708  
709-710-720-727

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	✓	
2.	Heat Detector	—	✓	
3.	Smoke Detector	✓	—	
4.	Pull Manual Call Point	—	—	
5.	Stroke Light	—	—	
6.	Horn and Stroke Speaker	—	—	
7.	Alarm buzzer	—	—	
8.	Zone indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	✓	
11.	Fire Ventilation System Automatic Close	—	✓	
12.	Gas Protection Valve Automatic Close	—	✓	
13.	Pressurize Fan System Automatic Open	—	✓	
14.	Smoke Fan System Automatic Open	—	✓	
15.	Air condition : AHU and OAU System Automatic Close	—	✓	
16.	Telephone jack	—	✓	
17.	Sounder base	✓	—	
18.	Fire work control program	✓	—	
Comment / 備註 715 = SD27-60 716 = SD27-61				

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / #of item	921 = SDZ A - 97 701 = SDZ 7 - 78 709 = SDZ 7 - 69 709 = SDZ 7 - 67 710 = SDZ 7 - 65 710 = SDZ 7 - 56 721 = SDZ 7 - 55			

DATE : 14/4/68  
LOCATION : 715

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / หมายเหตุ 715 : HDZ7 - 84				

DATE : 28-3-67  
LOCATION : 914, 914, 914, 914

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / หมายเหตุ 914 = SDZ 9 - 01.0				
914 = SDZ 9 - 10				
914 = SDZ 9 - 01.9				



DATE : 27/3/18  
LOCATION 1010-1025-  
1027-910-329

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	

Comment / ڤېڤاڤان  
1010 = SPZ 10 - 65  
1010 = SPZ 10 - 56  
1027 = SPZ 10 - 49  
910 = SPZ 9 - 14  
329 = SPZ 3 - 5

Operator By

Recorder By

Chief Engineer

DATE : 26/3/2018  
LOCATION 227-723-  
725

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	

Comment / ڤېڤاڤان  
227 = SPZ 3 - 13  
723 = SPZ 3 - 47  
725 = SPZ 3 - 56

Operator By

Recorder By

Chief Engineer



DATE: 8/3/68  
LOCATION: 1128-1110

DATE: 4/2/08  
LOCATION: 609

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	
Comment / Remark 179 = S D 2 11 - 98 110 = S D 2 11 - 109				

Operation By
Resched By
Chief Engineer

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / Signature: SPZ 6 - 25				

DATE: 10/13/68  
LOCATION: 703, 706  
722, 1122

DATE: 9/25/88  
LOCATION: A27

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / Remark		703 SDZ7-75		
		706 SDZ7-71		
		711 SDZ7-54		
		712 SDZ7-99		

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	—	
2.	Heat Detector	✓	—	
3.	Smoke Detector	—	—	
4.	Pull Manual Call Point	—	—	
5.	Strobe Light	—	—	
6.	Horn and Strobe Speaker	—	—	
7.	Alarm buzzer	—	—	
8.	Zone Indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	—	
11.	Fire Ventilation System Automatic Close	—	—	
12.	Gas Protection Valve Automatic Close	—	—	
13.	Pressurize Fan System Automatic Open	—	—	
14.	Smoke Fan System Automatic Open	—	—	
15.	Air condition : AHU and OAU System Automatic Close	—	—	
16.	Telephone jack	—	—	
17.	Sounder base	✓	—	
18.	Fire work control program	✓	—	
Comment / หมายเหตุ ๑๒:๕๒๔-๕๕				

Operation By

Chief Engineer

Recheck By

DATE: 12/3/60  
LOCATION: 705, 901  
902

DATE: 15/03/04  
LOCATION: 0104, 610, 0022  
5826

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	✓	
2.	Heat Detector	—	✓	
3.	Smoke Detector	✓	—	
4.	Pull Manual Call Point	—	✓	
5.	Strobe Light	—	✓	
6.	Horn and Strobe Speaker	—	✓	
7.	Alarm buzzer	—	✓	
8.	Zone indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	✓	
11.	Fire Ventilation System Automatic Close	—	✓	
12.	Gas Protection Valve Automatic Close	—	✓	
13.	Pressure Fan System Automatic Open	—	✓	
14.	Smoke Fan System Automatic Open	—	✓	
15.	Air condition : AHU and OAU System Automatic Close	—	✓	
16.	Telephone jack	—	✓	
17.	Sounder base	✓	—	
18.	Fire work control program	✓	—	
Comments / Signature 7035SDZ7 - 72 9015SDZ9 - 36 9025SDZ9 - 34				

[illegible]

**PREVENTIVE MAINTENANCE : FIRE ALARM**

**PREVENTIVE MAINTENANCE : FIRE ALARM**

**NOVOTEL**

**LOVOTEN**  
BANGKOK FUTURE PARK BANGSUET

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 16/2/68  
LOCATION: 717-718  
719-315

DATE: 10/31/81  
LOCATION: 1103-1109  
1114-311

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air conditioner : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	
Comment / Remark		717-SDZ7-59 718-9DZ7-58 719-SDZ7-57 515-SDZ3-19		

Operation By \_\_\_\_\_ Redcheck By \_\_\_\_\_ Chief Engineer

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / #item		1109 = SD 2 = 119		
		1109 = SD 2 = 111		
		1114 = SD 2 = 106		
		211 = SD 2 = 22		

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 14-3-66  
LOCATION : 919, 927, 999, 905, 511

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comments / หมายเหตุ				
919 = SDZ - 15				
927 = SDZ - 6				
999 = SDZ - 5				
905 = SDZ - 20				
511 = SDZ - 106				
Operation By				
Redeek By				
Chief Engineer				

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 11/3/68  
LOCATION : 904, 711, 714, 723

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comments / หมายเหตุ				
904, SDZ 9 - 22				
711 = SDZ - 66				
714 = SDZ - 62				
723 = SDZ - 53				
Operation By				
Redeek By				
Chief Engineer				

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 81-3-68  
LOCATION: 402, 404, 624

[illegible][illegible]



**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 6/3/68  
LOCATION: 603

603

[illegible]

628 = 592 6-05

Comment / ข้อเสนอแนะ

Operation By

Recheck By

**Chief Engineer**

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	✓	
2.	Heat Detector	—	✓	
3.	Smoke Detector	✓	—	
4.	Pull Manual Call Point	—	✓	
5.	Strobe Light	—	✓	
6.	Horn and Strobe Speaker	—	✓	
7.	Alarm buzzer	—	✓	
8.	Zone indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	✓	
11.	Fire Ventilation System Automatic Close	—	✓	
12.	Gas Protection Valve Automatic Close	—	✓	
13.	Pressurize Fan System Automatic Open	—	✓	
14.	Smoke Fan System Automatic Open	—	✓	
15.	Air condition : AHU and OAU System Automatic Close	—	✓	
16.	Telephone jack	—	✓	
17.	Sounder base	✓	—	
18.	Fire work control program	✓	—	
Comments / 備註事項 603 = SDZ 6-33				

Operation By

Chief Engineer

603 = 5DZ6-33

Comment / ข้อสังเกต

Operation By

Recheck By

**Chief Engineer**

FORM  
DATE: 4/3/68  
LOCATION: 723, 912

RM  
DATE: 3/3/68  
LOCATION 923

Item	Description	Result		Remark
		Date	Not	
1.	Beam Detector	✓	✓	
2.	Hem Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / Remark 723-SD27-53 723-SD28-5				

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Stroke Light	✓	✓	
6.	Horn and Stroke Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment / 備註				

923-SDZ9-11

Operation By

Resched By

Chief Engineer

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 23/3/68  
LOCATION :

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	

Comment / หมายเหตุ  
319 = SDZ 3 - 16  
521 = SDZ 5 - 97  
115 = SDZ 11 - 105  
911 = SDZ 9 - 166

Operation By

Check By

Chief Engineer

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 29/3/69  
LOCATION : 412 - 414  
614 - 307

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	

Comment / หมายเหตุ  
412 = SDZ 4 - 63  
414 = SDZ 4 - 69  
614 = SDZ 6 - 20  
307 = SDZ 7 - 69

Operation By

Check By

Chief Engineer

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 31/3/18  
LOCATION : 324-312  
917-921

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatics Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	

324-312-310  
312-312-311  
917-312-317  
917-312-313

Comment / Remark

Operation By

Checked By

Chief Engineer

PREVENTIVE MAINTENANCE : FIRE ALARM

DATE : 30/3/18  
LOCATION : 319-422  
312

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	

319-312-315  
312-312-312  
422-312-314

Comment / Remark

Operation By

Checked By

Chief Engineer

DATE: 4/2/68  
LOCATION 502-517  
519-524-721

DATE: 010668  
LOCATION: 410, 411, 420  
420

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	✓	
2.	Heat Detector	—	✓	
3.	Smoke Detector	✓	—	
4.	Pull Manual Call Point	—	✓	
5.	Strobe Light	—	✓	
6.	Horn and Strobe Speaker	—	✓	
7.	Alarm buzzer	—	✓	
8.	Zone indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	✓	
11.	Fire Ventilation System Automatic Close	—	✓	
12.	Gas Protection Valve Automatic Close	—	✓	
13.	Pressurize Fan System Automatic Open	—	✓	
14.	Smoke Fan System Automatic Open	—	✓	
15.	Air condition : AHU and OAU System Automatic Close	—	✓	
16.	Telephone jack	—	✓	
17.	Sounder base	✓	—	
18.	Fire work control program	✓	—	
Comment : 502=SDZ 5-118				
517=SDZ 5-161				
519=SDZ 5-99				
524=SDZ 5-94				
727=SDZ 7-55				

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓		
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition - AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	
Commen / 備註 <i>413 24 26 27 28 29 30 31</i>				
<i>410-SD24-63</i> <i>409-SD26-64</i> <i>420-SD26-55b</i> <i>423-SD24-53</i>				
<div style="background-color: black; height: 40px; width: 100%;"></div>				
Operation By		Redeek By		
		Chief Engineer		

DATE: 24/02/23  
LOCATION: 1104-1109  
1117

DATE: 27/11/68  
LOCATION: 509

[illegible]

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation Systems Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurizer Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program.	✓	-	
Comment : 509 - SDZ 3-109				
Operation By _____ Redcheck By _____ Chief Engineer				

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 28-2-68

DATE: 27/2/64

LOCATION ..... 704

LOCATION .....610

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air conditioner : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
Comment : 4/6/2014 704 SDZ - 74				

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	✓	
2.	Heat Detector	-	✓	
3.	Smoke Detector	✓	-	
4.	Pull Manual Call Point	-	✓	
5.	Strobe Light	-	✓	
6.	Horn and Strobe Speaker	-	✓	
7.	Alarm buzzer	-	✓	
8.	Zone Indicator panel	✓	-	
9.	Graphic Zone Display Panel	✓	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	✓	
11.	Fire Ventilation System Automatic Close	-	✓	
12.	Gas Protection Valve Automatic Close	-	✓	
13.	Pressurize Fan System Automatic Open	-	✓	
14.	Smoke Fan System Automatic Open	-	✓	
15.	Air condition : AHU and OAU System Automatic Close	-	✓	
16.	Telephone jack	-	✓	
17.	Sounder base	✓	-	
18.	Fire work control program	✓	-	
Comment / Remark 610-5026-23				

DATE: A/2/68  
LOCATION: A27, 1102, 1127

DATE: 03-Feb-25  
LOCATION: 510, 509, 512

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	✓	
2.	Heat Detector	—	✓	
3.	Smoke Detector	✓	—	
4.	Pull Manual Call Point	—	✓	
5.	Strobe Light	—	✓	
6.	Horn and Strobe Speaker	—	✓	
7.	Alarm buzzer	—	✓	
8.	Zone indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	✓	
11.	Fire Ventilation System Automatic Close	—	✓	
12.	Gas Protection Valve Automatic Close	—	✓	
13.	Pressurize Fan System Automatic Open	—	✓	
14.	Smoke Fan System Automatic Open	—	✓	
15.	Air condition : AHU and OAU System Automatic Close	—	✓	
16.	Telephone jack	—	✓	
17.	Sounder base	—	✓	
18.	Fire work control program	✓	—	
Comment / 備註		107 = SDZ A - 49 1102 = SDZ M - 120 1127 = SDZ 11 - 99		

[illegible]



DATE : 5-2-68

LOCATION : 3-16-883,992

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	

996 = SD23-18  
823 = SD28-75  
992 = SD29-12

Comment / หมายเหตุ

DATE : 05/2/88

LOCATION : 1023

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone Indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurize Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	

1023-SD210-53

Comment / หมายเหตุ

(K-1)

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 26/4/68

LOCATION 716-225

[illegible]

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	—	✓	
2.	Heat Detector	—	✓	
3.	Smoke Detector	—	✓	
4.	Pull Manual Call Point	—	✓	
5.	Stroke Light	—	✓	
6.	Horn and Stroke Speaker	—	✓	
7.	Alarm buzzer	—	✓	
8.	Zone Indicator panel	✓	—	
9.	Graphic Zone Display Panel	✓	—	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	—	✓	
11.	Fire Ventilation System Automatic Close	—	✓	
12.	Gas Protection Valve Automatic Close	—	✓	
13.	Pressurize Fan System Automatic Open	—	✓	
14.	Smoke Fan System Automatic Open	—	✓	
15.	Air condition : AHU and OAU System Automatic Close	—	✓	
16.	Telephone jack	—	✓	
17.	Sounder base	✓	—	
18.	Fire work control program	✓	—	
Comment / 備註		716 - SDZ 7 - 60 915 - SDZ 8 - 93 915 - SDZ 8 - 92		

Operation By

Redcheck By

Chief Engineer

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 29-Jan-85  
LOCATION: 311, 525 (Liv)  
505 (Bed Room) 427

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	✓	✓	
2.	Heat Detector	✓	✓	
3.	Smoke Detector	✓	✓	
4.	Pull Manual Call Point	✓	✓	
5.	Strobe Light	✓	✓	
6.	Horn and Strobe Speaker	✓	✓	
7.	Alarm buzzer	✓	✓	
8.	Zone indicator panel	✓	✓	
9.	Graphic Zone Display Panel	✓	✓	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	✓	✓	
11.	Fire Ventilation System Automatic Close	✓	✓	
12.	Gas Protection Valve Automatic Close	✓	✓	
13.	Pressurizer Fan System Automatic Open	✓	✓	
14.	Smoke Fan System Automatic Open	✓	✓	
15.	Air condition : AHU and OAU System Automatic Close	✓	✓	
16.	Telephone jack	✓	✓	
17.	Sounder base	✓	✓	
18.	Fire work control program	✓	✓	
<p>Comment / หมายเหตุ</p> <p>311 z S/D23 - 22</p> <p>327 z S/D23 - 48</p> <p>525 (Living Room) z S/D25 - 93</p> <p>525 (Bed Room) z S/D25 - 92</p>				

**PREVENTIVE MAINTENANCE : FIRE ALARM**

DATE: 30-JAN-75  
LOCATION: 506, 508, 107

Item	Description	Result		Remark
		Done	Not	
1.	Beam Detector	-	/	
2.	Heat Detector	/	-	
3.	Smoke Detector	-	/	
4.	Pull Manual Call Point	-	/	
5.	Strobe Light	-	/	
6.	Horn and Strobe Speaker	-	/	
7.	Alarm buzzer	-	/	
8.	Zone Indicator panel	/	-	
9.	Graphic Zone Display Panel	/	-	
10.	Lift Protection Automatic Shut Down Stand by Ground floor (Home position)	-	/	
11.	Fire Ventilation System Automatic Close	-	/	
12.	Gas Protection Valve Automatic Close	-	/	
13.	Pressurize Fan System Automatic Open	-	/	
14.	Smoke Fan System Automatic Open	-	/	
15.	Air condition : AHU and OAU System Automatic Close	-	/	
16.	Telephone jack	-	/	
17.	Sounder base	/	-	1109
18.	Fire work control program	/	-	1109
<p>506 = SD25-113</p> <p>508 = SD25-110</p> <p>1109 = SD211-113 (1109 Sounder base)</p>				

3<sup>rd</sup> – 2024 Preventive Maintenance for  
Fire Alarm System

โรงแรมโกลด์เวล กรุ๊ป เทพ ฟิวเจอร์พาร์ค รังสิต

21/04/2025 - 03/05/2025

by



**Magpie Blazetech Co., Ltd**

Tel.02-9346267. www.magpiez.com

*Authorized Distributors*

**“Notifier”** Fire Alarm Product

**“Ansul”** Fire Suppression Product

**MAGPIE BLAZETECH CO., LTD.**

526-528 Soi Ladprao 94 (Parijamthra) Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2934-6267-9 Fax: 0-2934-6270 e-mail: magpiez@ksc.th.com



**INSPECTION AND TEST OF FIRE ALARM SYSTEM**

**TABLE OF CONTENTS**

SECTION	DESCRIPTION
1	Summary of Defect
2	List Of Equipments
3	Report Of Inspection & Testing
4	System Tests Record
5	Picture Report
6	Appendix

บันทึกการปฏิบัติงานการตรวจพบและหาเหตุ (SUMMARY THE PROBLEM OF TESTING RECORD)

Summary Device Tests Record of Fire Alarm System

Build.	Add.	Location	Type of Device	Result of Testing	Request	Status	Remark
โครงการบ้าน พักอาศัย บ้านเลขที่ 10 หมู่ 10		ห้อง Security	Battery 12V/4Ah	Battery (FCP) อุปกรณ์แจ้งเตือน	อุปกรณ์ทั้ง	Battery อุปกรณ์แจ้งเตือน	
	LOT0082	1 st FLOOR	Smoke (PHOTO)	Disable	Disable	อุปกรณ์ทั้ง	
	LOT0083	1 st FLOOR	Smoke (PHOTO)	Disable	Disable	อุปกรณ์ทั้ง	
	LOT0084	1 st FLOOR	Smoke (PHOTO)	Disable	Disable	อุปกรณ์ทั้ง	
	LOT0085	1 st FLOOR	Smoke (PHOTO)	Disable	Disable	อุปกรณ์ทั้ง	
	LOT0086	1 st FLOOR	Smoke (PHOTO)	Disable	Disable	อุปกรณ์ทั้ง	
	LOT0116	1 st FLOOR	Smoke (PHOTO)	Disable	Disable	อุปกรณ์ทั้ง	
	LOT0121	1 st FLOOR	Smoke (PHOTO)	Disable	Disable	อุปกรณ์ทั้ง	
	LOT0082	STAIR 2 Roof Floor	Smoke (PHOTO)	อุปกรณ์ LED ANN โฉง	อุปกรณ์ทั้ง	อุปกรณ์ LED ANN โฉง	
	LOT0047	ห้อง 1028 ชั้น 10	Smoke (PHOTO)	อุปกรณ์ LED ANN โฉง	อุปกรณ์ทั้ง	อุปกรณ์ LED ANN โฉง	
	LOT0073	ทางเดิน ชั้น 10	Smoke (PHOTO)	อุปกรณ์ LED ANN โฉง	อุปกรณ์ทั้ง	อุปกรณ์ LED ANN โฉง	
	LOT0048	ROOF FLOOR	Manual	อุปกรณ์ LED ANN โฉง	อุปกรณ์ทั้ง	อุปกรณ์ LED ANN โฉง	

SECTION 1

Summary Defect

# MAGPIE BLAZETECH CO., LTD.

526-528 Soi Ladprao 94 (Pangnamlert), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6267-9 Fax : 0-2934-6270 e-mail : magpiez@k-sc.th.com



## List Of Equipment Fire Alarm System

Project : โรงแรมไมะเทลา กรุงเทพมหานคร พิจาเจริญทรัพย์ศรีสัต

Model	Brand	Description	Approved	Total	Remark
NFS2-3030	NOTIFIER	NFS2-3030, 5 Loop, Intelligent Addressable Fire Alarm Control Panel.	UL/FM	1 Set	
	Local	Computer Graphic		1 Set	
	Local	Graphic Annunciator		2 Set	
FMM-1	NOTIFIER	Monitor Module	UL/FM	0 Pcs.	
FCM-1	NOTIFIER	Control Module	UL/FM	55 Pcs.	
FMM-101	NOTIFIER	Mini/Dual Monitor Module	UL/FM	41 Pcs.	
FRM-1	NOTIFIER	Relay Module	UL/FM	35 Pcs.	
FSP-951	NOTIFIER	Addressable Photo Smoke Detector	UL/FM	594 Pcs	
FST-951H	NOTIFIER	Addressable Heat Detector High Temp	UL/FM	39 Pcs.	
NBG-12LX	NOTIFIER	Addressable Manual Pull Station	UL/FM	49 Pcs.	
	System Sensor	Strobe Light	UL/FM	19 Pcs.	
SPCWL	System Sensor	Speaker	UL/FM	19 Pcs.	

## SECTION 2

### List of Equipment

# MAGPIE BLAZETECH CO., LTD.

526-528 Soi Ladprao 94, (Panjamit), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6267-9 Fax : 0-2934-6270 e-mail : magpiez@ksc.th.com



## Report of Inspection & Testing of Fire Alarm System

<b>Name of project</b> : โรงแรมไม่วาเทล กรุงเทพมหานคร ครั้งที่ 3/4 2567	
<b>Name of property</b> : PREVENTIVE MAINTENANCE FIRE ALARM SYSTEM	
<b>Location</b> : รังสิต	<b>Tel.</b> : <b>Fax.</b> :
<b>Name of authority</b> : อุณวิวัฒน์ อู๋บัพพัญ์	<b>Position.</b> : <b>Tel.</b> : 089-169-3438 <b>Fax.</b> :
<b>Inspector name</b> : นายปฏิภาณ บรรลือทรัพย์ <b>Position.</b> : Project Engineer	
<b>Name of company</b> : บริษัท แมคพาย บลิตซ์เทค จำกัด	
<b>Address</b> : 223/5 ซ.รามคำแหง 21 (นวมศิริ) ถ.รามคำแหง แขวงพลับพลา เขตวังทองหลาง กรุงเทพมหานคร 10310	
<b>Date</b> : 21/04/2025 - 03/05/2025	<b>Tel.</b> : <b>Fax.</b> : <b>Time.</b> : 09.00 ถึง 17.00
<b>Type of system</b> : FIRE ALARM SYSTEM <b>Brand</b> : "NOTIFIER" <b>Model</b> : NFS2-3030	
<b>Type of wiring</b> : <input checked="" type="checkbox"/> Class A : <input type="checkbox"/> Class B : <input type="checkbox"/> Other :	
<b>Number of circuit</b> : 5 LOOP	
<b>Inspection frequency</b> : <input type="checkbox"/> Monthly : <input type="checkbox"/> Quarterly : <input type="checkbox"/> Annually : <input checked="" type="checkbox"/> Other : PM FIRE ALARM	
<b>Description</b> : ทำการทดสอบการทำงานของระบบสัญญาณแจ้งเหตุเพลิงไหม้ ครั้งที่ 3 - 4 2567	
(1) ทำความสะอาดตู้ FCP พร้อมทำการตรวจเช็ค Power Supply 220 VAC, 485, Power Supply 24 VDC, Charger, Battery ใช้งานได้ตามปกติ	
(2) ทำการทดสอบอุปกรณ์ระบบแจ้งเหตุเพลิงไหม้ ชั้น 1 - ชั้น Roof	
(3) ทำการทดสอบ Smoke, Heat, Manual และหลังทดสอบได้ให้ความสะอาดอุปกรณ์	
(4) อุปกรณ์ที่ใช้การทดสอบ สามารถใช้งานได้ตามปกติ สัญญาณส่งมาถึงควบคุมและคอมพิวเตอร์	
<b>Comment</b>	
(1) แบตเตอรี่ (FCP) อายุเกินการใช้งาน 12v70Ah	
<b>Inspector's</b> : ปฏิภาณ บรรลือทรัพย์ <b>Owner / Designated</b> : <b>Date</b> : 3 พฤษภาคม 2568	

Doc No:DF-EN-17 rev.1

Eff:Date 25 JUL 2023

## SECTION 3

### Report of Inspection & Testing

Report of Inspection & Testing of Fire Alarm System





**MAGPIE BLAZETECH CO., LTD.**

526-528 Soi Ladprao 94 (Parijmitr), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2059-0440-6 Fax : 0-2059-0447 e-mail :

**System Tests Record of Fire Alarm System**

**SYSTEM POWER SUPPLIES**

Page \_\_\_ of \_\_\_

Location ( Panel Number ) : โรงแม่เหล็กไฟฟ้า พิวเจอร์พาร์ค รังสิต

Primary ( Main ) : Nominal Voltage

Secondary ( Standby ) : 220 VAC , Amps

Type Battery : 24 VDC Storage Battery: 70 , Amp-Hr. Rating

Circuit Breaker NO. : N/A ☐ Dry Cell ☐ Nickel-Cadmium ☒ Sealed Lead-Acid

**SYSTEM TESTS AND INSPECTIONS** NFS2-3030E

**TYPE**

LCD Monitor ☒

Acknowledge ☐

Signal Silence ☐

System Reset ☐

Drill ☒

Safety Button ☒

Lamps/LEDs ☒

Keyboard ☐

Buzzer ☐

Battery Ram ☐

**Computer Workstation**

TYPE

Program On-life ☒

NCM-W ☐

LED Monitor ☒

Keyboard + Mouse ☒

Backup And Clear History DataBase ☐

**Signal Loop Circuit**

TYPE

Loop1(LCM-320) ☒

Loop2(LCM-320) ☒

Loop3(LCM-320) ☒

Loop4(LCM-320) ☒

Loop5(LCM-320) ☒

**SECTION 4**  
**System Tests Record**

TYPE	VISUAL	FUNCTIONAL	COMMENT
LCD Monitor	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Pass
Acknowledge	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Signal Silence	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
System Reset	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Drill	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Pass
Safety Button	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Lamps/LEDs	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Keyboard	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Buzzer	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Battery Ram	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Pass

TYPE	VISUAL	FUNCTIONAL	COMMENT
Program On-life	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
NCM-W	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Pass
LED Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Keyboard + Mouse	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Backup And Clear History DataBase	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Pass

TYPE	VISUAL	FUNCTIONAL	COMMENT
Loop1(LCM-320)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Loop2(LCM-320)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Loop3(LCM-320)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Loop4(LCM-320)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
Loop5(LCM-320)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass



## System Tests Record of Fire Alarm System

## SYSTEM POWER SUPPLIES

Page\_\_of\_\_

Location ( Panel Number ) :  
โรงพยาบาลโนเวเทล กรุงเทพมหานคร พิวเจอร์พาร์ค รังสิต

Primary ( Main ): Nominal Voltage

220 VAC

Amps

Secondary ( Standby ) :

24 VDC

storage

Type Battery ☐

100

Nickel-C

Circuit Breaker NO.

1

Other

## SYSTEM TESTS AND INSPECTIONS

NFS2-3030E

## POWER SUPPLY

TYPE	VISUAL	FUNCTIONAL	COMMENT
AMPS-24E	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
AMPS-24E	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Pass
AA-120E	<input type="checkbox"/>	<input type="checkbox"/>	
AA-120E	<input type="checkbox"/>	<input type="checkbox"/>	

## SECONDARY POWER

TYPE	VISUAL	FUNCTIONAL	COMMENT
Battery Condition	<input type="checkbox"/>	<input checked="" type="checkbox"/>	(27.9 VDC) อุปกรณ์การใช้งาน
Load Voltage	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Discharge Test	<input type="checkbox"/>	<input checked="" type="checkbox"/>	27.6 VDC

## INTERFACE EQUIPMENT

1. Lift	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
2. Access Control	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
3. D SIM	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
4. Water Mist	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
	<input type="checkbox"/>	<input type="checkbox"/>	

### Remark

---

---

---

---

---

## SECTION 5

## Device Tests Record & Inspection



**MAGPIE BLAZETECH CO., LTD.**  
526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2534-6267/9 Fax: 0-2534-6270 e-mail: mpb-eng03@magpiez.com

**Device Tests Record of Fire Alarm System for**  
**โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567**

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
LOOP 1: DETECTOR												
FLOOR 1	1	56		SDZ1-56	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	57		SDZ1-57	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	58		SDZ1-58	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	59		SDZ1-59	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	60		SDZ1-60	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	61		SDZ1-61	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	62		SDZ1-62	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	63		SDZ1-63	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	64		SDZ1-64	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	65		SDZ1-65	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	66		SDZ1-66	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	67		SDZ1-67	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	68		SDZ1-68	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	69		SDZ1-69	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	70		SDZ1-70	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	71		SDZ1-71	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	72		SDZ1-72	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	73		SDZ1-73	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	74		SDZ1-74	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	75		SDZ1-75	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	76		SDZ1-76	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	77		SDZ1-77	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	78		SDZ1-78	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	79		SDZ1-79	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	80		SDZ1-80	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	81		SDZ1-81	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	82		SDZ1-82	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Disable
FLOOR 1	1	83		SDZ1-83	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Disable
FLOOR 1	1	84		SDZ1-84	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Disable
FLOOR 1	1	85		SDZ1-85	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Disable
FLOOR 1	1	86		SDZ1-86	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Disable
FLOOR 1	1	87		SDZ1-87	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	88		SDZ1-88	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	89		SDZ1-89	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	90		SDZ1-90	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	91		SDZ1-91	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	92		SDZ1-92	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	93		SDZ1-93	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	94		SDZ1-94	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	95		SDZ1-95	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	96		SDZ1-96	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	97		SDZ1-97	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	98		SDZ1-98	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	99		SDZ1-99	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	100		SDZ1-100	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	101		SDZ1-101	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	102		SDZ1-102	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	103		SDZ1-103	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	104		SDZ1-104	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	105		SDZ1-105	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	106		SDZ1-106	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	107		SDZ1-107	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	108		SDZ1-108	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	109		SDZ1-109	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	110		SDZ1-110	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	111		SDZ1-111	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



**MAGPIE BLAZETECH CO., LTD.**  
526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2534-6267/9 Fax: 0-2534-6270 e-mail: mpb-eng03@magpiez.com

**Device Tests Record of Fire Alarm System for**  
**โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567**

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
LOOP 1: DETECTOR												
FLOOR 1	1	1		SDZ1-1	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	2		SDZ1-2	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	3		SDZ1-3	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	4		SDZ1-4	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	6		SDZ1-5	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	7		SDZ1-6	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	8		SDZ1-7	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	9		SDZ1-8	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	10		SDZ1-10	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	11		SDZ1-11	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	12		SDZ1-12	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	13		SDZ1-13	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	14		SDZ1-14	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	15		SDZ1-15	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	16		SDZ1-16	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	17		SDZ1-17	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	18		SDZ1-18	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	19		SDZ1-19	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	20		SDZ1-20	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	21		SDZ1-21	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	22		SDZ1-22	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	23		SDZ1-23	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	24		SDZ1-24	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	25		SDZ1-25	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	26		SDZ1-26	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	27		SDZ1-27	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	28		SDZ1-28	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	29		SDZ1-29	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	30		SDZ1-30	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	31		SDZ1-31	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	32		SDZ1-32	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	33		SDZ1-33	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	34		SDZ1-34	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	35		SDZ1-35	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	36		SDZ1-36	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	37		SDZ1-37	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	38		SDZ1-38	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	39		SDZ1-39	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	40		SDZ1-40	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	41		SDZ1-41	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	42		SDZ1-42	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	43		SDZ1-43	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	44		SDZ1-44	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	45		SDZ1-45	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	46		SDZ1-46	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	47		SDZ1-47	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	48		SDZ1-48	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	49		SDZ1-49	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	50		SDZ1-50	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	51		SDZ1-51	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	52		SDZ1-52	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	53		SDZ1-53	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	54		SDZ1-54	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	55		SDZ1-55	1st. FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



**MAGPIE BLAZETECH CO., LTD.**  
526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2634-4267/9 Fax: 0-2634-4270 e-mail: mpb-eng03@magpiez.com

**Device Tests Record of Fire Alarm System for**  
**โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567**

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 1	1	18		TEL ST 3	STAIR 3	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	19		TEL ST 4	STAIR 4	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	20		TEL FIRE MAIN LIFT	FAH	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	21		AUTO DOOR 1	1st. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	22		AUTO DOOR 2	1st. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	23		AUTO DOOR 3	1st. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	24		KEY F.L. 1	1st. FLOOR	MINIUDAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	25		FLOOR SWITCH	1st. FLOOR	MINIUDAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	26		SUPERVISORY	1st. FLOOR	MINIUDAL MONITOR	Track Superv	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	27		KEY F.M.L	1st. FLOOR	MINIUDAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	28		GAS	1st. FLOOR	MINIUDAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	31		MDZ-31	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	32		MDZ-32	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	33		MDZ-33	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	34		MDZ-34	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	35		MDZ-35	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	36		MDZ-36	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	37		MDZ-37	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	38		MDZ-38	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	39		MDZ-39	1st. FLOOR	MANUAL STATION	Push Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	155		Module LO1M165	1st. FLOOR	PS MON	Power Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	156		Module LO1M166	1st. FLOOR	PS MON	Power Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	157		Module LO1M167	1st. FLOOR	PS MON	Power Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	158		Module LO1M168	1st. FLOOR	PS MON	Power Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	159		Module LO1M169	1st. FLOOR	PS MON	Power Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
LOOP 2 DETECTOR												
FLOOR 2	2	1		SDZ2-1	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	2		SDZ2-2	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	3		SDZ2-3	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	4		SDZ2-4	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	5		SDZ2-5	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	6		SDZ2-6	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	7		SDZ2-7	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	8		SDZ2-8	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	9		SDZ2-9	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	10		SDZ2-10	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	11		SDZ2-11	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	12		SDZ2-12	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	13		SDZ2-13	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	14		SDZ2-14	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	15		SDZ2-15	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	16		SDZ2-16	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	17		SDZ2-17	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	18		SDZ2-18	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	19		SDZ2-19	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	20		SDZ2-20	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	21		SDZ2-21	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	22		SDZ2-22	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	23		SDZ2-23	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	24		SDZ2-24	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	25		SDZ2-25	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	26		SDZ2-26	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	27		SDZ2-27	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	28		SDZ2-28	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	29		SDZ2-29	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	30		SDZ2-30	2nd. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



**MAGPIE BLAZETECH CO., LTD.**  
526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2634-4267/9 Fax: 0-2634-4270 e-mail: mpb-eng03@magpiez.com

**Device Tests Record of Fire Alarm System for**  
**โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567**

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 1	1	112		SDZ-112	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	113		SDZ-113	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	114		SDZ-114	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	115		SDZ-115	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	116		SDZ-116	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Disable
FLOOR 1	1	117		SDZ-117	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	118		SDZ-118	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	119		SDZ-119	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	120		SDZ-120	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	121		SDZ-121	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Disable
FLOOR 1	1	122		SDZ-122	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	123		SDZ-123	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	124		SDZ-124	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	125		SDZ-125	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	126		SDZ-126	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	127		SDZ-127	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	128		SDZ-128	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	129		SDZ-129	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	130		HDZ-130	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	131		HDZ-131	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	132		HDZ-132	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	133		HDZ-133	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	134		HDZ-134	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	135		HDZ-135	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	136		HDZ-136	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	137		HDZ-137	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	138		HDZ-138	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	139		HDZ-139	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	140		HDZ-140	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	141		HDZ-141	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	142		HDZ-142	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	143		HDZ-143	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	144		HDZ-144	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	145		HDZ-145	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	146		HDZ-146	1st. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	147		SDZ-147	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	148		SDZ-148	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	149		SDZ-149	1st. FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
LOOP 1: MODULE												
FLOOR 1	1	1		STZ 1 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	2		STZ 2 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	3		STZ 3 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	4		STZ 4 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	5		STZ 5 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	6		STZ 6 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	7		STZ 7 FIRE MAIN LIFT	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	8		SPZ 1 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	9		SPZ 2 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	10		STZ 3 FL. 1	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	11		SPZ 2 FL. 2	STAIR 2	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	12		SPZ 3 FL. 3	STAIR 3	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	13		SPZ 2 FL. 4	STAIR 4	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	14		SPZ 2 FIRE MAIN LIFT	1st. FLOOR	CONTROL	Smoke Chk	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	15		TEL FL. 1	1st. FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	16		TEL ST 1	1st. FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 1	1	17		TEL ST 2	STAIR 2	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



## Device Tests Record of Fire Alarm System for

โรงแรมนิภาภาต กรุงเทพ พิวเจอร์ทาวน์ครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 2	2	31		SDZ2-31	2nd FLOOR	PHOTO	Smoke(Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	32		SDZ2-32	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	33		SDZ2-33	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	34		SDZ2-34	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	35		SDZ2-35	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	36		SDZ2-36	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	37		SDZ2-37	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	38		SDZ2-38	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	39		SDZ2-39	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	40		SDZ2-40	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	41		SDZ2-41	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	42		SDZ2-42	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	43		SDZ2-43	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	44		SDZ2-44	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	45		SDZ2-45	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	46		SDZ2-46	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	47		SDZ2-47	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	48		SDZ2-48	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	49		SDZ2-49	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	50		SDZ2-50	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	51		SDZ2-51	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	52		SDZ2-52	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	53		SDZ2-53	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	54		SDZ2-54	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	55		SDZ2-55	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	56		SDZ2-56	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	57		SDZ2-57	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	58		SDZ2-58	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	59		SDZ2-59	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	60		SDZ2-60	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	61		SDZ2-61	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	62		SDZ2-62	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	63		SDZ2-63	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	64		SDZ2-64	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	65		SDZ2-65	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	66		SDZ2-66	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	67		SDZ2-67	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	68		SDZ2-68	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	69		SDZ2-69	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	70		SDZ2-70	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	71		SDZ2-71	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	72		SDZ2-72	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	73		SDZ2-73	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	74		SDZ2-74	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	75		SDZ2-75	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	76		SDZ2-76	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	77		SDZ2-77	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	78		SDZ2-78	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	79		SDZ2-79	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	80		SDZ2-80	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	81		SDZ2-81	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	82		SDZ2-82	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	LED ANN LIGHT
FLOOR 2	2	83		SDZ2-83	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	84		SDZ2-84	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	85		SDZ2-85	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	86		SDZ2-86	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



## Device Tests Record of Fire Alarm System for

โรงแรมนิภาภาต กรุงเทพ พิวเจอร์ทาวน์ครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 2	2	87		SDZ2-87	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	90		SDZ2-90	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	91		SDZ2-91	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	92		SDZ2-92	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	93		SDZ2-93	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	94		SDZ2-94	2nd FLOOR	PHOTO	Smoke(Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	95		HDZ2-95	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	96		HDZ2-96	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	97		HDZ2-97	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	98		HDZ2-98	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	99		HDZ2-99	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	100		HDZ2-100	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	101		HDZ2-101	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	102		HDZ2-102	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	103		HDZ2-103	2nd FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	104		1st FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	105		2nd FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	106		3rd FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	107		4th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	108		5th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	109		6th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	110		7th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	111		8th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	112		9th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	113		10th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	114		11th FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	115		Roof FLOOR	STAR 1	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	116		1st FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	117		2nd FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	118		3rd FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	119		4th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	120		5th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	121		6th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	122		7th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	123		8th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	124		9th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	125		10th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	126		11th FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	127		Roof FLOOR	STAR 2	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	128		1st FLOOR	STAR 3	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	129		2nd FLOOR	STAR 3	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	130		3rd FLOOR	STAR 3	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	131		4th FLOOR	STAR 3	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	132		2nd FLOOR	STAR 4	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	133		1st FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	134		2nd FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	135		3rd FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	136		4th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	137		5th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	138		6th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	139		7th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	140		8th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	141		9th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	142		10th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	143		11th FLOOR	STAR TAIL	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	

LOOP 2: MODULE

MAGPIE BLAZETECH CO., LTD.

526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2534-4267/9 Fax: 0-2534-4270 e-mail: mpb-eng03@magpiez.com



Device Tests Record of Fire Alarm System for

โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 2	2	1	1	STZ 1 FL 2	2nd FLOOR	CONTROL	Smoke Ckt	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	2	2	STZ 2 FL 2	2nd FLOOR	CONTROL	Smoke Ckt	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	3	3	SPZ 1 FL 2	2nd FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	4	4	SPZ 2 FL 2	2nd FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	5	5	TEL FL 2	2nd FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	6	6	UNANI	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	7	7	GAS	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	8	8	COZ 1	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	9	9	COZ 2	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	10	10	SMOKE EXHAUST 1	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	11	11	SMOKE EXHAUST 2	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	12	12	PF-2/1	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	13	13	PF-2/1	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	14	14	EXHAUST FAN 1	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	15	15	EXHAUST FAN 2	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	16	16	EXHAUST FAN 3	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	17	17	EXHAUST FAN 4	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	18	18	EXHAUST FAN 5	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	19	19	EXHAUST FAN 6	2nd FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	20	20	KEY FL 2	2nd FLOOR	MANUAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	21	21	FIRE SWITCH	2nd FLOOR	MANUAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	22	22	SUPERVISORY	2nd FLOOR	MANUAL MONITOR	Track Superv	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	23	23	NZ 1	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	24	24	NZ 2	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	25	25	GAS	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	31	31	MOZ2-31	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	32	32	MOZ2-32	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	33	33	MOZ2-33	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	34	34	MOZ2-34	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	35	35	MOZ2-35	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	36	36	MOZ2-36	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	37	37	MOZ2-37	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	38	38	MOZ2-38	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	39	39	MOZ2-39	2nd FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	40	40	1st FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	41	41	2nd FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	42	42	3rd FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	43	43	4th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	44	44	5th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	45	45	6th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	46	46	7th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	47	47	8th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	48	48	9th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	49	49	10th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 2	2	50	50	11th FLOOR	PHL	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
LOOP 2 DETECTOR												
FLOOR 3	3	1	1	SDZ3-1	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	2	2	SDZ3-2	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	3	3	SDZ3-3	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	4	4	SDZ3-4	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	5	5	SDZ3-5	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	6	6	SDZ3-6	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	7	7	SDZ3-7	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	8	8	SDZ3-8	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	9	9	SDZ3-9	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	10	10	SDZ3-10	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	

MAGPIE BLAZETECH CO., LTD.

526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2534-4267/9 Fax: 0-2534-4270 e-mail: mpb-eng03@magpiez.com



Device Tests Record of Fire Alarm System for

โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 3	3	11	11	SDZ3-11	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	12	12	SDZ3-12	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	13	13	SDZ3-13	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	14	14	SDZ3-14	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	15	15	SDZ3-15	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	16	16	SDZ3-16	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	17	17	SDZ3-17	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	18	18	SDZ3-18	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	19	19	SDZ3-19	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	20	20	SDZ3-20	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	21	21	SDZ3-21	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	22	22	SDZ3-22	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	23	23	SDZ3-23	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	24	24	SDZ3-24	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	25	25	SDZ3-25	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	26	26	SDZ3-26	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	27	27	SDZ3-27	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	28	28	SDZ3-28	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	29	29	SDZ3-29	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	30	30	SDZ3-30	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	31	31	SDZ3-31	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	32	32	SDZ3-32	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	33	33	SDZ3-33	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	34	34	SDZ3-34	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	35	35	SDZ3-35	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	36	36	SDZ3-36	3rd FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	37	37	HDZ3-37	3rd FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	38	38	HDZ3-38	3rd FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	39	39	HDZ3-39	3rd FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	40	40	HDZ3-40	3rd FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	41	41	HDZ3-41	3rd FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	42	42	HDZ3-42	3rd FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	43	43	SDZ4-43	4th FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	44	44	SDZ4-44	4th FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	45	45	SDZ4-45	4th FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	46	46	SDZ4-46	4th FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	47	47	SDZ4-47	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	48	48	SDZ4-48	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	49	49	SDZ4-49	4th FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	50	50	SDZ4-50	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	51	51	SDZ4-51	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	52	52	SDZ4-52	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	53	53	SDZ4-53	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	54	54	SDZ4-54	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	55	55	SDZ4-55	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	56	56	SDZ4-56	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	57	57	SDZ4-57	4th FLOOR	ACCLIMATE	Smoke Acclim	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



## Device Tests Record of Fire Alarm System for

โรงแรมนิภาลาด กรุงเทพมหานคร พิกัดอาคารดับเพลิงครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 4	3	67		SDZ-67	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	68		SDZ-68	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	69		SDZ-69	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	70		SDZ-70	4th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	71		SDZ-71	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	72		SDZ-72	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	73		SDZ-73	4th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	74		SDZ-74	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	75		SDZ-75	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	76		SDZ-76	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	77		SDZ-77	4th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	78		SDZ-78	4th. FLOOR	ACCLIMATE	Smoke Accin	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	79		SDZ-79	4th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	80		SDZ-80	4th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	81		SDZ-81	4th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	82		SDZ-82	4th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	84		MDZ-84	4th. FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	86		SDZ-86	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	87		SDZ-87	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	88		SDZ-88	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	89		SDZ-89	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	90		SDZ-90	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	91		SDZ-91	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	92		SDZ-92	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	93		SDZ-93	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	94		SDZ-94	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	96		SDZ-96	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	97		SDZ-97	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	98		SDZ-98	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	99		SDZ-99	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	100		SDZ-100	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	101		SDZ-101	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	102		SDZ-102	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	103		SDZ-103	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	104		SDZ-104	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	105		SDZ-105	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	106		SDZ-106	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	107		SDZ-107	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	108		SDZ-108	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	109		SDZ-109	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	110		SDZ-110	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	111		SDZ-111	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	112		SDZ-112	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	113		SDZ-113	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	114		SDZ-114	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	115		SDZ-115	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	116		SDZ-116	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	117		SDZ-117	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	118		SDZ-118	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	119		SDZ-119	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	120		SDZ-120	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	121		SDZ-121	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	122		SDZ-122	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	123		SDZ-123	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



## Device Tests Record of Fire Alarm System for

โรงแรมนิภาลาด กรุงเทพมหานคร พิกัดอาคารดับเพลิงครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 5	3	124		SDZ-124	5th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	126		HDZ-126	5th. FLOOR	HEAT	Heat(Fixed)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
LOOP 3: MODULE												
FLOOR 3	3	1		STZ FL 3	3rd. FLOOR	CONTROL	Smoke Ckt	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	2		SPZ FL 3	3rd. FLOOR	CONTROL	Speaker	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	3		TEL FL 3	3rd. FLOOR	CONTROL	Telephone	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	4		UNAN	3rd. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	5		EXHAUST FAN 1	3rd. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	6		EXHAUST FAN 2	3rd. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	7		EXHAUST FAN 3	3rd. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	8		EXHAUST FAN 4	3rd. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	9		EXHAUST FAN 5	3rd. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	10		EXHAUST FAN 6	3rd. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	11		KEY FL 2	3rd. FLOOR	MINIUDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	12		FLOE SWITCH	3rd. FLOOR	MINIUDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	13		SUPERVISORY	3rd. FLOOR	MINIUDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	14		STZ FL 4	4th. FLOOR	CONTROL	Smoke Ckt	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	15		SPZ FL 4	4th. FLOOR	CONTROL	Speaker	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	16		TEL FL 4	4th. FLOOR	CONTROL	Telephone	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	17		UNAN	4th. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	18		KEY FL 4	4th. FLOOR	MINIUDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	19		FLOE SWITCH	4th. FLOOR	MINIUDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	20		SUPERVISORY	4th. FLOOR	MINIUDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	21		STZ FL 5	5th. FLOOR	CONTROL	Smoke Ckt	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	22		SPZ FL 5	5th. FLOOR	CONTROL	Speaker	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	23		TEL FL 5	5th. FLOOR	CONTROL	Telephone	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	24		UNAN	5th. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	25		KEY FL 5	5th. FLOOR	MINIUDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	26		FLOE SWITCH	5th. FLOOR	MINIUDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	27		SUPERVISORY	5th. FLOOR	MINIUDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	31		MDZ-31	3rd. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 3	3	32		MDZ-32	3rd. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	33		MDZ-33	4th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 4	3	34		MDZ-34	4th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	35		MDZ-35	5th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 5	3	36		MDZ-36	5th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
LOOP 4: DETECTOR												
FLOOR 6	4	1		SDZ-1	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	2		SDZ-2	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	3		SDZ-3	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	4		SDZ-4	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	5		SDZ-5	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	6		SDZ-6	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	7		SDZ-7	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	8		SDZ-8	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	9		SDZ-9	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	10		SDZ-10	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	11		SDZ-11	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	12		SDZ-12	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	13		SDZ-13	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	14		SDZ-14	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	15		SDZ-15	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	16		SDZ-16	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	17		SDZ-17	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	18		SDZ-18	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	19		SDZ-19	6th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	

**MAGPIE BLAZETECH CO., LTD.**

526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2534-8267/9 Fax: 0-2534-8270 e-mail: mpd-eng03@magpiez.com



**Device Tests Record of Fire Alarm System for**

โรงแรมนิเวศกุล กรุงเทพมหานคร พิกัดอาคารชุดครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 6	4	20		SD26-20	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	21		SD26-21	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	22		SD26-22	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	23		SD26-23	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	24		SD26-24	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	25		SD26-25	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	26		SD26-26	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	27		SD26-27	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	28		SD26-28	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	29		SD26-29	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	30		SD26-30	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	31		SD26-31	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	32		SD26-32	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	33		SD26-33	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	34		SD26-34	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	35		SD26-35	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	36		SD26-36	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	37		SD26-37	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	38		SD26-38	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	39		SD26-39	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	40		SD26-40	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	42		HD26-42	8th. FLOOR	HEAT	Heat(Press)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	43		SD27-43	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	44		SD27-44	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	45		SD27-45	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	46		SD27-46	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	47		SD27-47	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	48		SD27-48	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	49		SD27-49	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	50		SD27-50	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	51		SD27-51	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	52		SD27-52	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	53		SD27-53	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	54		SD27-54	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	55		SD27-55	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	56		SD27-56	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	57		SD27-57	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	58		SD27-58	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	59		SD27-59	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	60		SD27-60	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	61		SD27-61	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	62		SD27-62	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	63		SD27-63	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	64		SD27-64	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	65		SD27-65	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	66		SD27-66	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	67		SD27-67	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	68		SD27-68	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	69		SD27-69	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	70		SD27-70	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	71		SD27-71	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	72		SD27-72	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	73		SD27-73	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	74		SD27-74	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	75		SD27-75	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	76		SD27-76	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	

**MAGPIE BLAZETECH CO., LTD.**

526-528 Soi Ladprao 94 (Pangmat), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel: 0-2534-8267/9 Fax: 0-2534-8270 e-mail: mpd-eng03@magpiez.com



**Device Tests Record of Fire Alarm System for**

โรงแรมนิเวศกุล กรุงเทพมหานคร พิกัดอาคารชุดครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add Device	Type of Con Device	Visual	NAL	PASS	FAULT	Remark
FLOOR 7	4	77		SD27-77	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	78		SD27-78	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	79		SD27-79	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	80		SD27-80	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	81		SD27-81	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	82		SD27-82	7th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	84		HD27-84	7th. FLOOR	HEAT	Heat(Press)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	85		SD28-85	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	86		SD28-86	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	87		SD28-87	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	88		SD28-88	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	89		SD28-89	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	90		SD28-90	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	91		SD28-91	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	92		SD28-92	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	93		SD28-93	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	94		SD28-94	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	95		SD28-95	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	96		SD28-96	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	97		SD28-97	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	98		SD28-98	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	99		SD28-99	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	100		SD28-100	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	101		SD28-101	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	102		SD28-102	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	103		SD28-103	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	104		SD28-104	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	105		SD28-105	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	106		SD28-106	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	107		SD28-107	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	108		SD28-108	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	109		SD28-109	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	110		SD28-110	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	111		SD28-111	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	112		SD28-112	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	113		SD28-113	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	114		SD28-114	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	115		SD28-115	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	116		SD28-116	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	117		SD28-117	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	118		SD28-118	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	119		SD28-119	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	120		SD28-120	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	121		SD28-121	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	122		SD28-122	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	123		SD28-123	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	124		SD28-124	8th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	126		HD28-126	8th. FLOOR	HEAT	Heat(Press)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
LOOP 4, MODULE												
FLOOR 6	4	1		SPZ FL 6	6th. FLOOR	CONTROL	Smoke CH	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	2		SPZ FL 6	6th. FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	3		TEL FL 6	6th. FLOOR	CONTROL	Telephone	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	4		UNAN	6th. FLOOR	RELAY	Relay	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	5		KEY FL 6	6th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	6		FLOE SWITCH	6th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	7		SUPERVISORY	6th. FLOOR	MINIDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	





Device Tests Record of Fire Alarm System for

โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 7	4	8		STZ FL 7	7th. FLOOR	CONTROL	Smoke Ctl	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	9		SPZ FL 7	7th. FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	10		TEL FL 7	7th. FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	11		UNIN	7th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	12		KEY FL 7	7th. FLOOR	MINIDUAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	13		FIRE SWITCH	7th. FLOOR	MINIDUAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	14		SUPERVISORY	7th. FLOOR	MINIDUAL MONITOR	Track Superv	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	15		STZ FL 8	8th. FLOOR	CONTROL	Smoke Ctl	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	16		SPZ FL 8	8th. FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	17		TEL FL 8	8th. FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	18		UNIN	8th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	19		KEY FL 8	8th. FLOOR	MINIDUAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	20		FIRE SWITCH	8th. FLOOR	MINIDUAL MONITOR	Monitor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	21		SUPERVISORY	8th. FLOOR	MINIDUAL MONITOR	Track Superv	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	31		M02Z-31	6th. FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 6	4	32		M02Z-32	6th. FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	33		M02Z-33	7th. FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 7	4	34		M02Z-34	7th. FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	35		M02Z-35	8th. FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 8	4	36		M02Z-36	8th. FLOOR	MANUAL STATION	Pull Station	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
LOOP 8 DETECTOR												
FLOOR 9	5	1		SDZ9-1	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	2		SDZ9-2	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	3		SDZ9-3	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	4		SDZ9-4	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	5		SDZ9-5	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	6		SDZ9-6	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	7		SDZ9-7	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	8		SDZ9-8	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	9		SDZ9-9	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	10		SDZ9-10	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	11		SDZ9-11	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	12		SDZ9-12	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	13		SDZ9-13	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	14		SDZ9-14	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	15		SDZ9-15	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	16		SDZ9-16	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	17		SDZ9-17	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	18		SDZ9-18	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	19		SDZ9-19	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	20		SDZ9-20	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	21		SDZ9-21	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	22		SDZ9-22	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	23		SDZ9-23	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	24		SDZ9-24	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	25		SDZ9-25	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	26		SDZ9-26	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	27		SDZ9-27	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	28		SDZ9-28	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	29		SDZ9-29	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	30		SDZ9-30	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	31		SDZ9-31	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	32		SDZ9-32	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	33		SDZ9-33	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	34		SDZ9-34	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	35		SDZ9-35	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



Device Tests Record of Fire Alarm System for

โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con. Device	Visual	INCHTR	PASS	FAULT	Remark
FLOOR 9	5	36		SDZ9-36	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		37		SDZ9-37	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		38		SDZ9-38	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		39		SDZ9-39	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		40		SDZ9-40	9th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		42		HDZ9-42	9th. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		43		SDZ10-43	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		44		SDZ10-44	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		45		SDZ10-45	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		46		SDZ10-46	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		47		SDZ10-47	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	LED ANN Light
		48		SDZ10-48	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	49		SDZ10-49	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		50		SDZ10-50	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		51		SDZ10-51	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		52		SDZ10-52	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		53		SDZ10-53	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		54		SDZ10-54	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		55		SDZ10-55	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		56		SDZ10-56	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		57		SDZ10-57	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		58		SDZ10-58	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		59		SDZ10-59	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		60		SDZ10-60	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	61		SDZ10-61	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		62		SDZ10-62	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		63		SDZ10-63	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		64		SDZ10-64	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		65		SDZ10-65	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		66		SDZ10-66	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		67		SDZ10-67	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		68		SDZ10-68	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		69		SDZ10-69	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		70		SDZ10-70	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		71		SDZ10-71	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		72		SDZ10-72	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	LED ANN Light
FLOOR 10	5	73		SDZ10-73	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		74		SDZ10-74	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		75		SDZ10-75	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		76		SDZ10-76	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		77		SDZ10-77	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		78		SDZ10-78	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		79		SDZ10-79	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		80		SDZ10-80	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		81		SDZ10-81	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		82		SDZ10-82	10th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		84		HDZ10-84	10th. FLOOR	HEAT	Heat(Fixed)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		FLOOR 11	5	85		SDZ11-85	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
86				SDZ11-86	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
87				SDZ11-87	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
88				SDZ11-88	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
89				SDZ11-89	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
90				SDZ11-90	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
91				SDZ11-91	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
92				SDZ11-92	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
93				SDZ11-93	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
94				SDZ11-94	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
95				SDZ11-95	11th. FLOOR	PHOTO	Smoke (Photo)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



Device Tests Record of Fire Alarm System for

โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567

Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 11	5	94		SDZ11-94	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	95		SDZ11-95	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	96		SDZ11-96	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	97		SDZ11-97	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	98		SDZ11-98	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	99		SDZ11-99	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	100		SDZ11-100	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	101		SDZ11-101	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	102		SDZ11-102	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	103		SDZ11-103	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	104		SDZ11-104	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	105		SDZ11-105	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	106		SDZ11-106	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	107		SDZ11-107	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	108		SDZ11-108	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	109		SDZ11-109	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	110		SDZ11-110	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	111		SDZ11-111	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	112		SDZ11-112	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	113		SDZ11-113	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	114		SDZ11-114	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	115		SDZ11-115	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	116		SDZ11-116	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	117		SDZ11-117	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	118		SDZ11-118	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	119		SDZ11-119	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	120		SDZ11-120	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	121		SDZ11-121	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	122		SDZ11-122	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	123		SDZ11-123	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	124		SDZ11-124	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	125		SDZ11-125	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	126		SDZ11-126	11th. FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	127		HDZ11-127	11th. FLOOR	HEAT	Heat (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	128		SDZR-128	Roof FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	129		SDZR-129	Roof FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	130		SDZR-130	Roof FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	131		SDZR-131	Roof FLOOR	PHOTO	Smoke (Photo)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	

LOOP 5: MODULE

FLOOR 9	5	1		STZ FL 9	9th. FLOOR	CONTROL	Stroke Ckt	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	2		SPZ FL 9	9th. FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	3		TEL FL 9	9th. FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	4		UNAN	9th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	5		KEY FL 9	9th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	6		ROSE SWITCH	9th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	7		SUPERVISORY	9th. FLOOR	MINIDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	8		STZ FL 10	10th. FLOOR	CONTROL	Stroke Ckt	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	9		SPZ FL 10	10th. FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	10		TEL FL 10	10th. FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	11		UNAN	10th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	12		KEY FL 10	10th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	13		ROSE SWITCH	10th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	14		SUPERVISORY	10th. FLOOR	MINIDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	15		STZ FL 11	11th. FLOOR	CONTROL	Stroke Ckt	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	16		SPZ FL 11	11th. FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	17		TEL FL 11	11th. FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	



Device Tests Record of Fire Alarm System for

โรงแรมนิเวศกุล กรุงเทพมหานครครั้งที่ 3/4 ปี 2567


Floor	Loop No.	Add. No.	Zone No.	Custom Label	Location	Type of Add. Device	Type of Con Device	Visual	Infrared	PASS	FAULT	Remark
FLOOR 11	5	18		UNAN	11th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	19		EXHAUST FAN 1	11th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	20		LIFT 1	11th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	21		LIFT 2	11th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	22		LIFT 3	11th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	23		LIFT 4	11th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	24		LIFT 5	11th. FLOOR	RELAY	Relay	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	25		KEY FL 11	11th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	26		FLORE SWITCH	11th. FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	27		SUPERVISORY	11th. FLOOR	MINIDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	28		STZ FL ROOF	Roof FLOOR	CONTROL	Stroke Ckt	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	29		SPZ FL ROOF	Roof FLOOR	CONTROL	Speaker	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	30		TEL FL ROOF	Roof FLOOR	CONTROL	Telephone	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	31		KEY FL ROOF	Roof FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	32		FLORE SWITCH	Roof FLOOR	MINIDUAL MONITOR	Monitor	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	33		SUPERVISORY	Roof FLOOR	MINIDUAL MONITOR	Track Superv	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	41		MDZ9-41	9th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 9	5	42		MDZ9-42	9th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	43		MDZ10-43	10th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 10	5	44		MDZ10-44	10th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	45		MDZ11-45	11th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR 11	5	46		MDZ11-46	11th. FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	47		MDZ9-47	Roof FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
FLOOR ROOF	5	48		MDZ9-48	Roof FLOOR	MANUAL STATION	Pull Station	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	LED ANN LIGHT

SECTION 6


Picture Report

MAGPIE BLAZETECH CO., LTD.  
536-528 Soi Ladprao 94 (Pantama), Ladprao Road,  
Wangphonglang, Bangkok 10310  
Tel : 0-2934-6287-9 Fax : 0-2934-6270 e-mail : magpie@bc.th.com


Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 34 ปี 2567

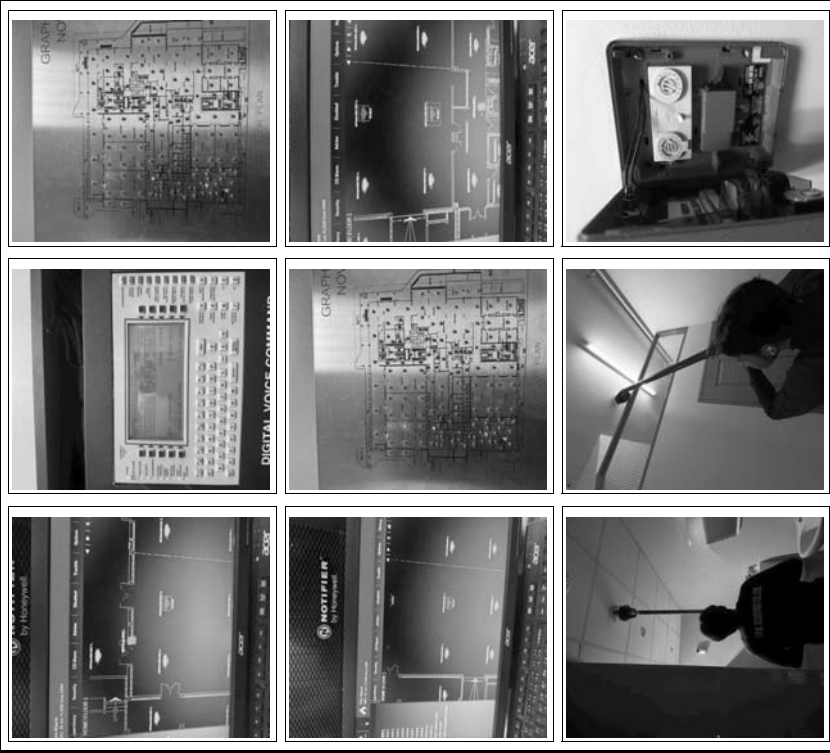

Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

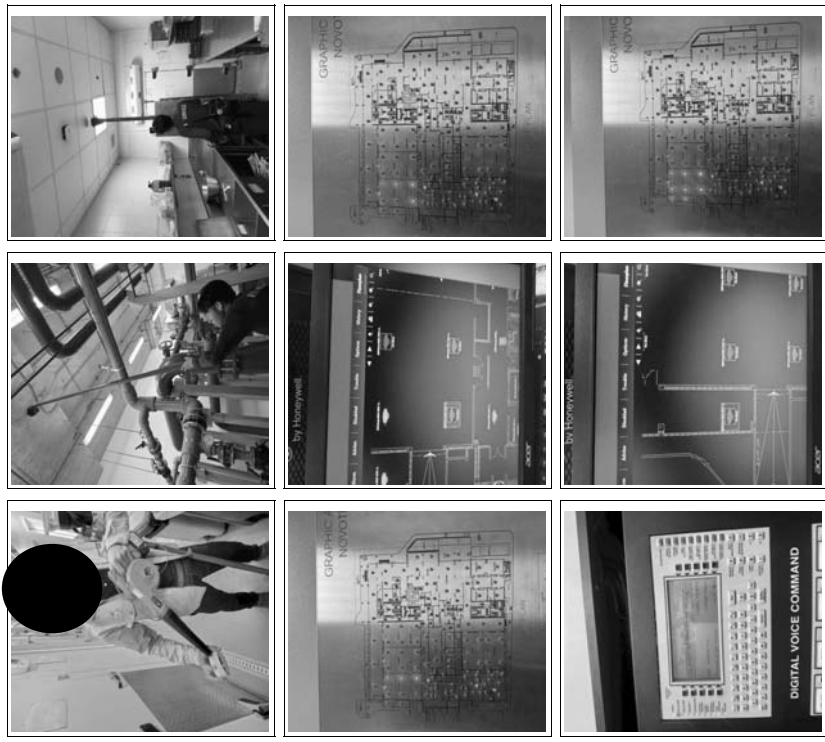


Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

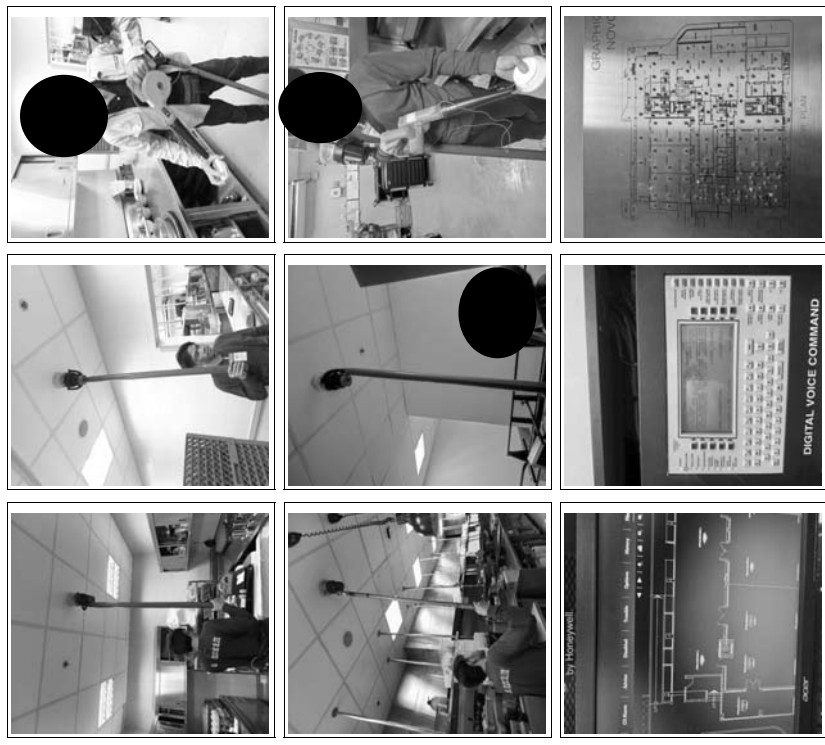


Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567




Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

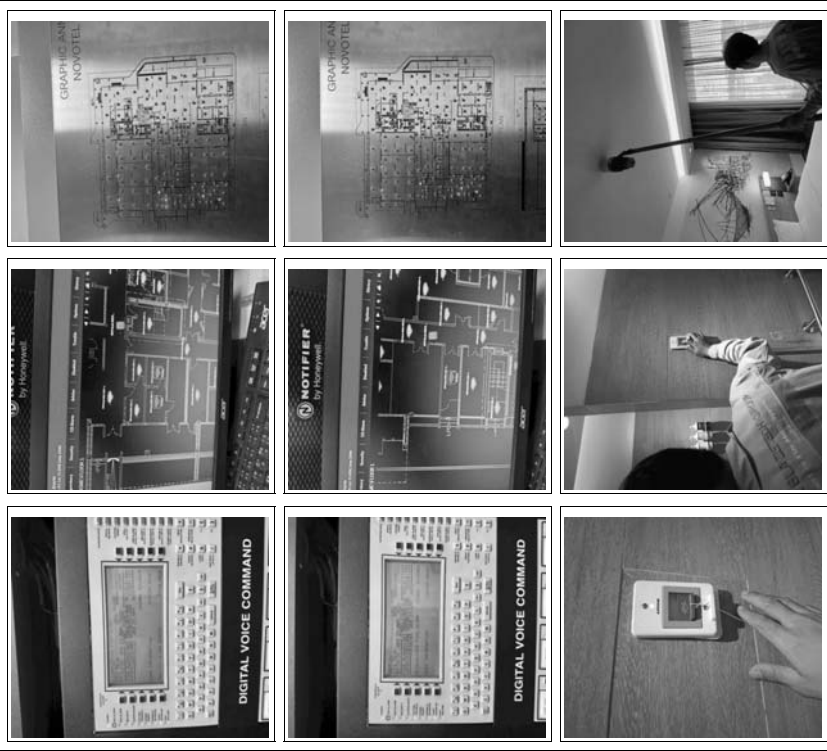

Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

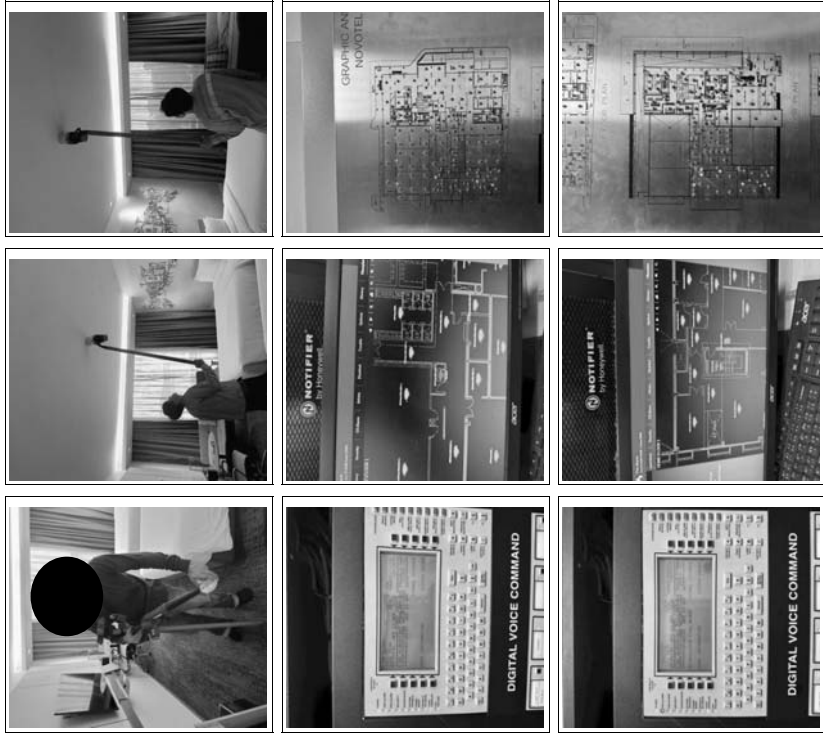


Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

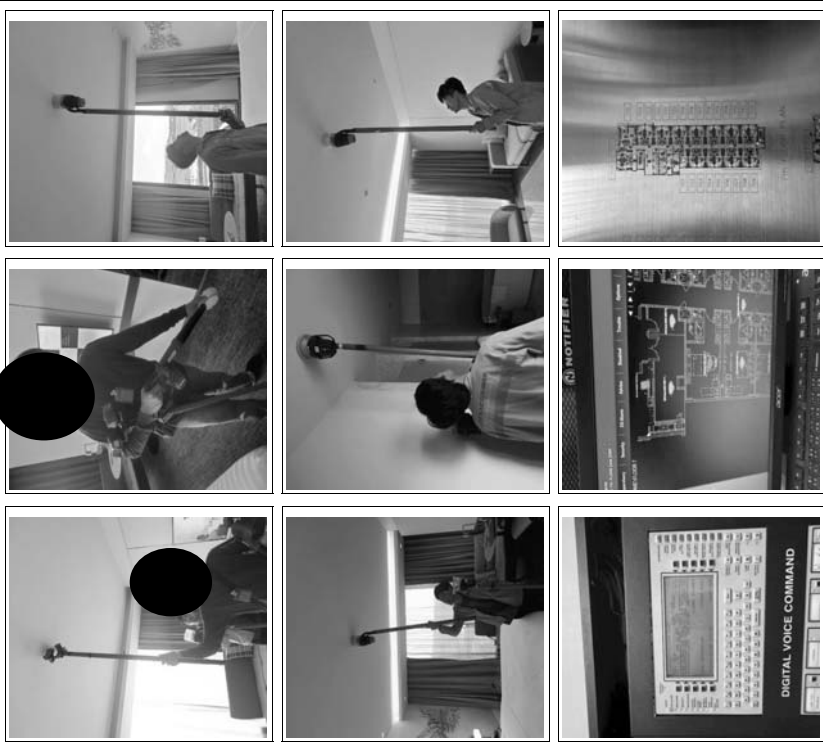

**MAGPIE BLAZETECH CO., LTD.**

536-528 Soi Ladprao 94 (Bangjume), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6277-9 Fax : 0-2934-6270 e-mail : magpie@we.th.com


**Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567**

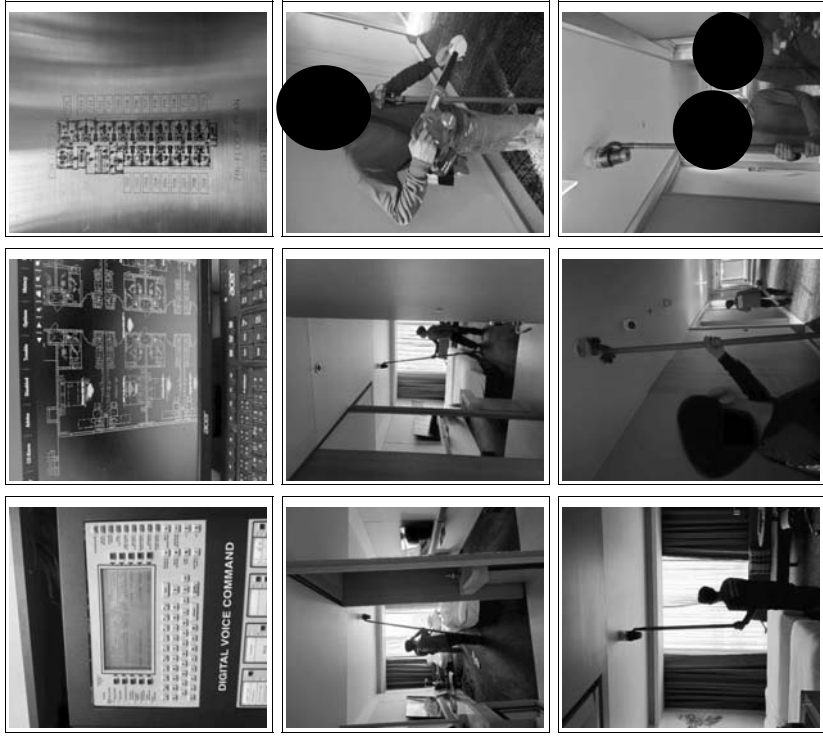

**MAGPIE BLAZETECH CO., LTD.**

536-528 Soi Ladprao 94 (Bangjume), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6277-9 Fax : 0-2934-6270 e-mail : magpie@we.th.com


**Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567**

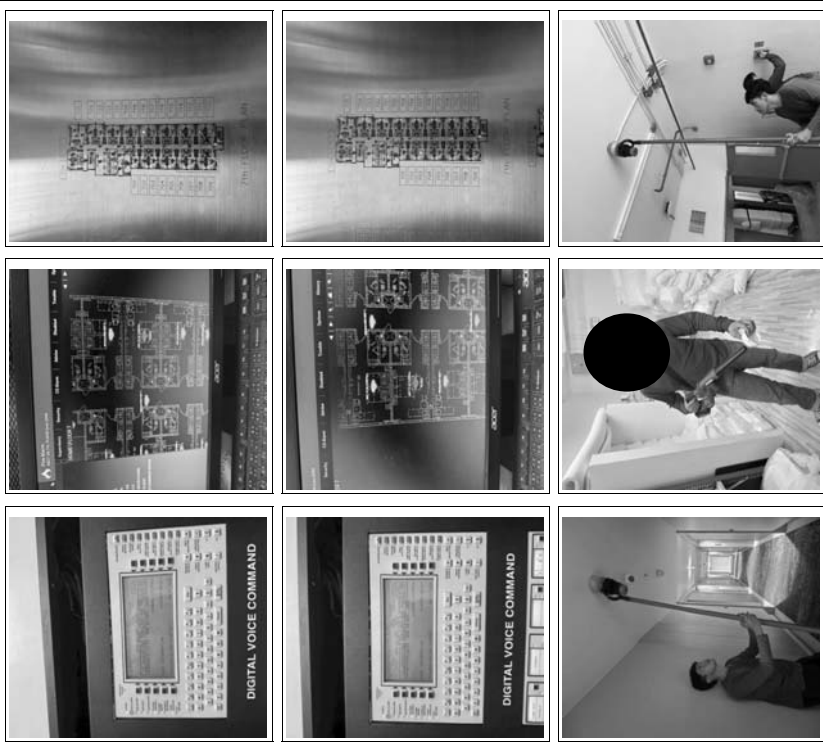

**MAGPIE BLAZETECH CO., LTD.**

536-528 Soi Ladprao 94 (Pangrarn), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6207-9 Fax : 0-2934-6270 e-mail : magpie@ec.th.com


**Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567**

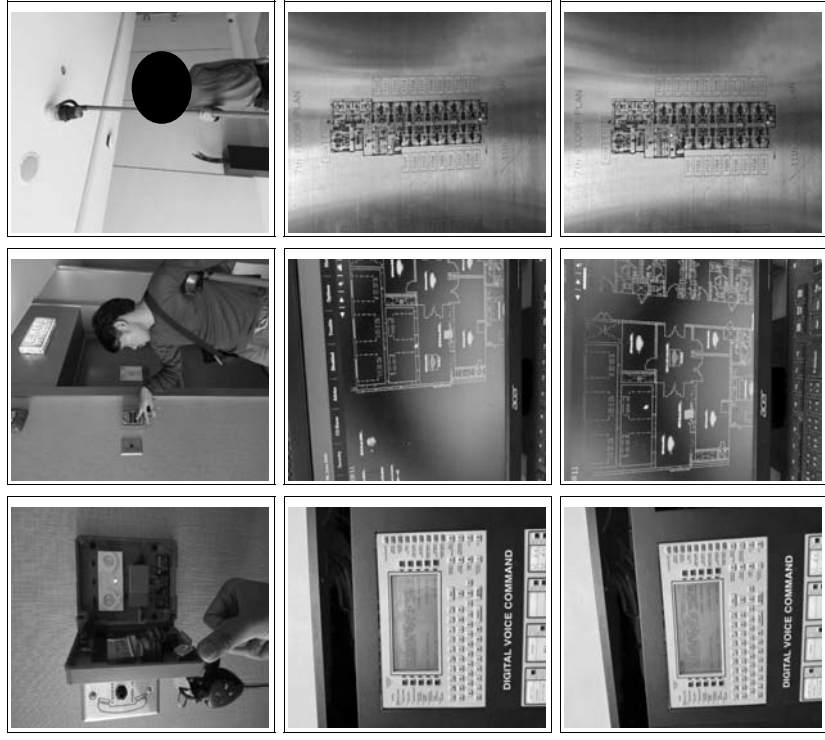

**MAGPIE BLAZETECH CO., LTD.**


536-528 Soi Ladprao 94 (Pangrarn), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6207-9 Fax : 0-2934-6270 e-mail : magpie@ec.th.com

**Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567**

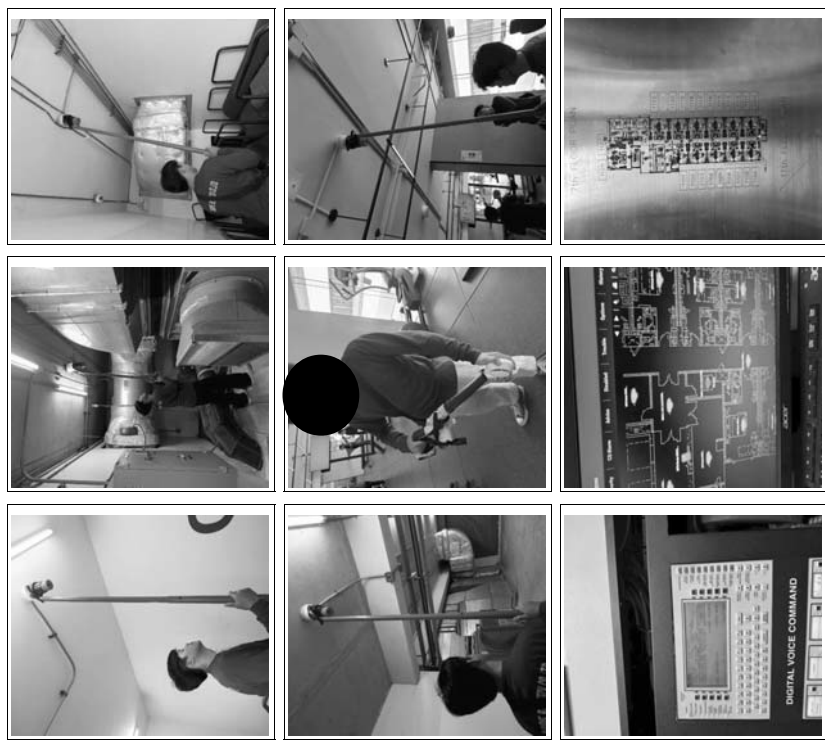





Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

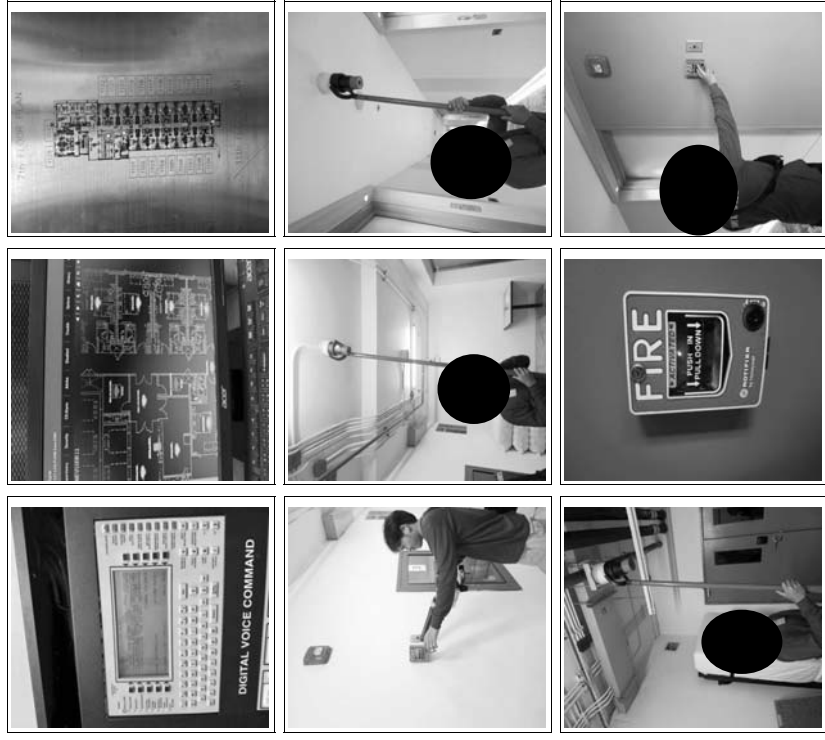


Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

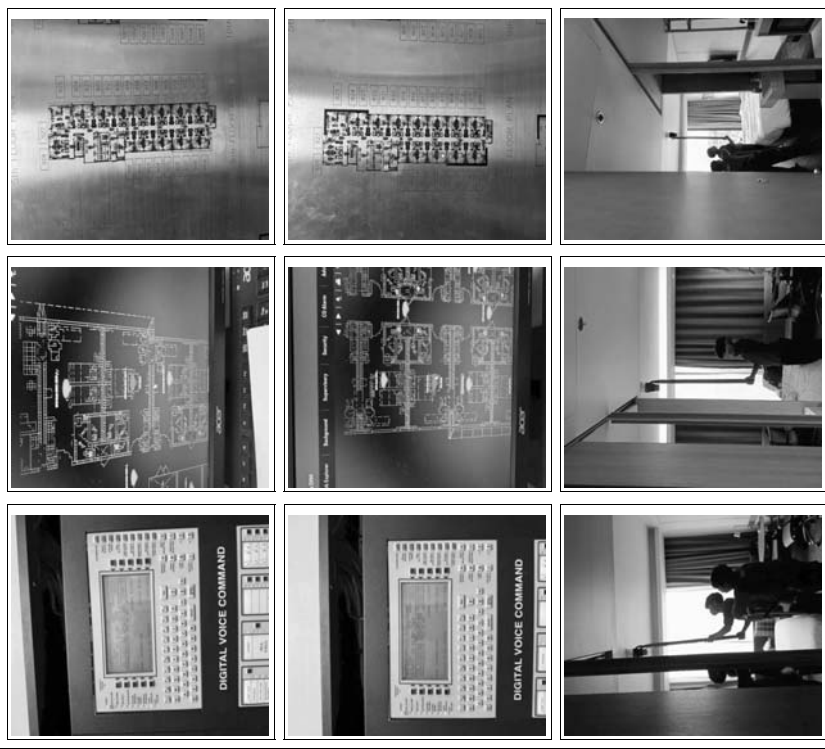

Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

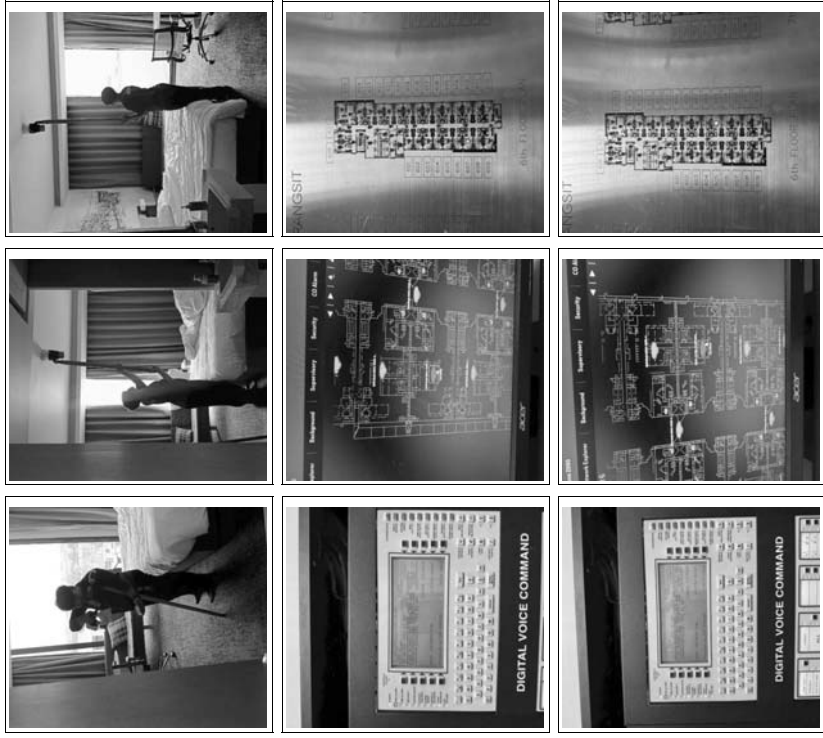

Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567

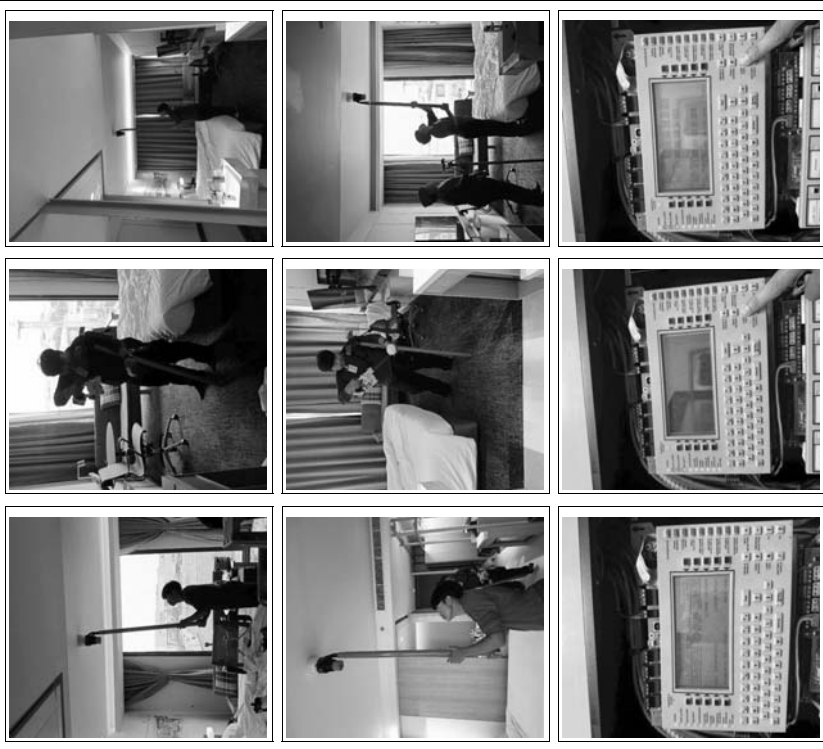

**MAGPIE BLAZETECH CO., LTD.**

526-528 Soi Ladprao 94 (Pangrarn), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6277-9 Fax : 0-2934-6270 e-mail : magpie@wctt.com


**Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567**



**MAGPIE BLAZETECH CO., LTD.**

526-528 Soi Ladprao 94 (Pangrarn), Ladprao Road,  
Wangthonglang, Bangkok 10310  
Tel : 0-2934-6277-9 Fax : 0-2934-6270 e-mail : magpie@wctt.com

**Picture of Inspection and Testing for Fire Alarm System ครั้งที่ 3/4 ปี 2567**

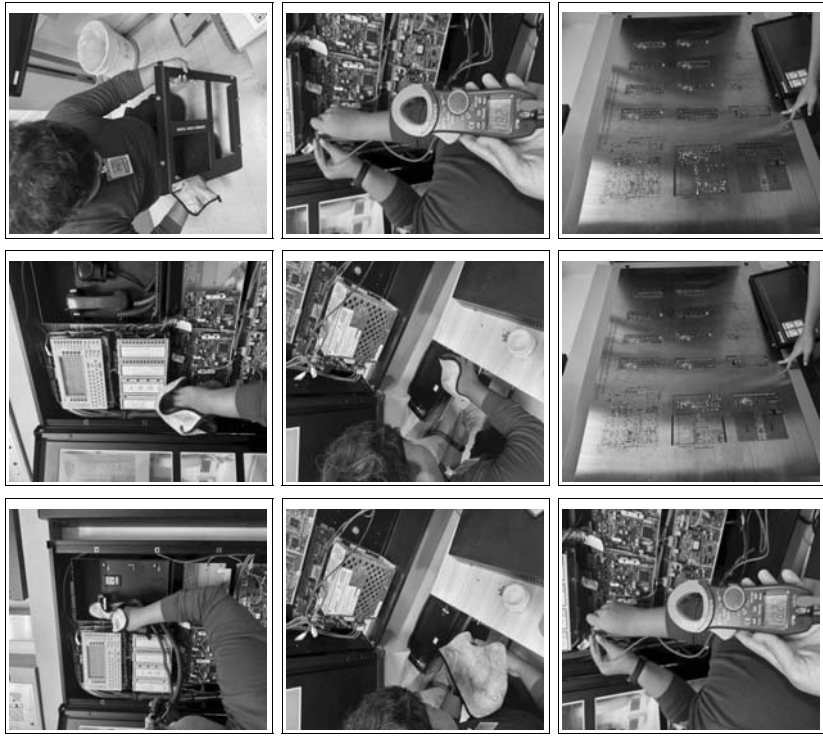

Inspector : s บัญชีกรมธรรม์  
Date 3 พฤษภาคม 2568

Owner / Designated :  
Date :

## SECTION 7

### Floor Plan

ว.2.4-55



**MAGPIE BLAZETECH CO., LTD.**  
**MAGPIE BLAZETECH GROUP CO., LTD.**  
 526-528 Soi Laphrao 94(Panjanth), Laphrao Rd, Phabpla, Wanghonglang, Bangkok 10310  
 Tel. 0-2059-0440-46 Fax. 0-2059-0447  
 E-mail : magpie@ksc.th.com, E-mail : ansul@magpie.com www.magpie.com

☐ Fire Alarm System

☐ Fire Suppression Systems for Restaurants "ANSUL"

เลขที่ 349

เลขที่ 17407

### Service Report

Report NO : .....	Date 28/11/18 - 2/12/18	Time In .....	Time Out .....
Name of project : PM Fire Alarm	ณ 3/4	12452/สุวิมล 2 ชั้น	
Name of property : .....			
Location : 349/1	Tel : .....	Fax : .....	
Name of authority : .....	Position : .....	Tel : .....	Fax : .....
Type of system : Fire Alarm	Brand : Not fire	Model : NF-3010	
Type of wiring : <input type="checkbox"/> Class A : <input type="checkbox"/> Class B : <input type="checkbox"/> Other : .....			
Number of circuit : 5	Loop		
Inspection frequency : <input type="checkbox"/> Monthly A : <input type="checkbox"/> Quarterly : <input type="checkbox"/> Annually : <input type="checkbox"/> Other : .....			
Description : .....	- ตรวจสอบระบบสัญญาณแจ้งภัย 1 - Roof		
.....	- ตรวจสอบ Smoke, Heat, Manual		
.....	- ตรวจสอบสายสัญญาณ 24 VDC, Loop, 485, Battery		
.....	- ตรวจสอบตู้ควบคุมสัญญาณแจ้งภัย 2 - 1st ANN		
.....	- ตรวจสอบสัญญาณแจ้งภัย 2 - 1st ANN		
.....	1. 1010082 2. 1010083 3. 1010084 4. 1010085		
.....	5. 1010086 6. 1010116 7. 1010121		
Faultiest : .....	- พบสายสัญญาณขาด		
.....	- พบสาย LED สัญญาณ ANN 1st ANN 4 90		
.....	1. 1010082 2. 1010083 3. 1010084 4. 1010085		
.....	3. 1010085 4. 1010086 5. 1010087 6. 1010088		
.....	- พบสายสัญญาณขาด 1. 1010082 2. 1010083		
.....			
.....			
JOB STATUS : <input type="checkbox"/> Incomplete <input type="checkbox"/> Complete <input type="checkbox"/> Other : .....			
Inspector's Initial : .....	Owner / Designated rep. Initial : .....		
Date : 2/12/18	Date : .....		

Doc.No : DF-EN-12 Rev.0

Report of Inspection & Testing of Fire Alarm System

Expire Date : 15 JUL 2022

Device Maintenance Reports

Node Address : 1 : (NFS2-3030)  
Panel Version : 27

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Device Maintenance: Detectors		Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
S/LC Loop													
1	1	Smoke (Photo)	SDZ1-1	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	2	Smoke (Photo)	SDZ1-2	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	3	Smoke (Photo)	SDZ1-3	1st. FLOOR	56	4	0	0	N/A	8	8	8	8
1	4	Smoke (Photo)	SDZ1-4	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	5	Smoke (Photo)	SDZ1-5	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	6	Smoke (Photo)	SDZ1-6	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	7	Smoke (Photo)	SDZ1-7	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	8	Smoke (Photo)	SDZ1-8	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	9	Smoke (Photo)	SDZ1-9	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	10	Smoke (Photo)	SDZ1-10	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	11	Smoke (Photo)	SDZ1-11	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	12	Smoke (Photo)	SDZ1-12	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	13	Smoke (Photo)	SDZ1-13	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	14	Smoke (Photo)	SDZ1-14	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	15	Smoke (Photo)	SDZ1-15	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	16	Smoke (Photo)	SDZ1-16	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	17	Smoke (Photo)	SDZ1-17	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	18	Smoke (Photo)	SDZ1-18	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	19	Smoke (Photo)	SDZ1-19	1st. FLOOR	35	4	0	0	N/A	8	8	8	8
1	20	Smoke (Photo)	SDZ1-20	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	21	Smoke (Photo)	SDZ1-21	1st. FLOOR	35	6	0	0	N/A	8	8	8	8
1	22	Smoke (Photo)	SDZ1-22	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	23	Smoke (Photo)	SDZ1-23	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	24	Smoke (Photo)	SDZ1-24	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	25	Smoke (Photo)	SDZ1-25	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	26	Smoke (Photo)	SDZ1-26	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	27	Smoke (Photo)	SDZ1-27	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	28	Smoke (Photo)	SDZ1-28	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	29	Smoke (Photo)	SDZ1-29	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	30	Smoke (Photo)	SDZ1-30	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	31	Smoke (Photo)	SDZ1-31	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	32	Smoke (Photo)	SDZ1-32	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	33	Smoke (Photo)	SDZ1-33	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	34	Smoke (Photo)	SDZ1-34	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	35	Smoke (Photo)	SDZ1-35	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	36	Smoke (Photo)	SDZ1-36	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	37	Smoke (Photo)	SDZ1-37	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	38	Smoke (Photo)	SDZ1-38	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	39	Smoke (Photo)	SDZ1-39	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	40	Smoke (Photo)	SDZ1-40	1st. FLOOR	35	0	0	0	N/A	8	8	8	8

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address : 1 : (NFS2-3030)  
Panel Version : 27

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

		Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
S/LC Loop													
1	41	Smoke (Photo)	SDZ1-41	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	42	Smoke (Photo)	SDZ1-42	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	43	Smoke (Photo)	SDZ1-43	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	44	Smoke (Photo)	SDZ1-44	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	45	Smoke (Photo)	SDZ1-45	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	46	Smoke (Photo)	SDZ1-46	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	47	Smoke (Photo)	SDZ1-47	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	48	Smoke (Photo)	SDZ1-48	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	49	Smoke (Photo)	SDZ1-49	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	50	Smoke (Photo)	SDZ1-50	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	51	Smoke (Photo)	SDZ1-51	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	52	Smoke (Photo)	SDZ1-52	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	53	Smoke (Photo)	SDZ1-53	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	54	Smoke (Photo)	SDZ1-54	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	55	Smoke (Photo)	SDZ1-55	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	56	Smoke (Photo)	SDZ1-56	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	57	Smoke (Photo)	SDZ1-57	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	58	Smoke (Photo)	SDZ1-58	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	59	Smoke (Photo)	SDZ1-59	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	60	Smoke (Photo)	SDZ1-60	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	61	Smoke (Photo)	SDZ1-61	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	62	Smoke (Photo)	SDZ1-62	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	63	Smoke (Photo)	SDZ1-63	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	64	Smoke (Photo)	SDZ1-64	1st. FLOOR	35	2	0	0	N/A	8	8	8	8
1	65	Smoke (Photo)	SDZ1-65	1st. FLOOR	35	2	0	0	N/A	8	8	8	8
1	66	Smoke (Photo)	SDZ1-66	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	67	Smoke (Photo)	SDZ1-67	1st. FLOOR	35	2	0	0	N/A	8	8	8	8
1	68	Smoke (Photo)	SDZ1-68	1st. FLOOR	35	2	0	0	N/A	8	8	8	8
1	69	Smoke (Photo)	SDZ1-69	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	70	Smoke (Photo)	SDZ1-70	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	71	Smoke (Photo)	SDZ1-71	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	72	Smoke (Photo)	SDZ1-72	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	73	Smoke (Photo)	SDZ1-73	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	74	Smoke (Photo)	SDZ1-74	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	75	Smoke (Photo)	SDZ1-75	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	76	Smoke (Photo)	SDZ1-76	1st. FLOOR	35	5	0	0	N/A	8	8	8	8
1	77	Smoke (Photo)	SDZ1-77	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	78	Smoke (Photo)	SDZ1-78	1st. FLOOR	35	1	0	0	N/A	8	8	8	8
1	79	Smoke (Photo)	SDZ1-79	1st. FLOOR	35	0	0	0	N/A	8	8	8	8
1	80	Smoke (Photo)	SDZ1-80	1st. FLOOR	35	5	0	0	N/A	8	8	8	8
1	81	Smoke (Photo)	SDZ1-81	1st. FLOOR	35	5	0	0	N/A	8	8	8	8

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports												
Node Address : 1 : (NFS2-3030) Panel Version: Z7												
03 May 2025 14:24:14 Active Project : Novotel Rungat 3-5-68												
SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
1	82	Smoke (Photo)	SDZ1-82	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	83	Smoke (Photo)	SDZ1-83	1st. FLOOR	35	5	0	0	N/A	8	8	8
1	84	Smoke (Photo)	SDZ1-84	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	85	Smoke (Photo)	SDZ1-85	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	86	Smoke (Photo)	SDZ1-86	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	87	Smoke (Photo)	SDZ1-87	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	88	Smoke (Photo)	SDZ1-88	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	89	Smoke (Photo)	SDZ1-89	1st. FLOOR	35	2	0	0	N/A	8	8	8
1	90	Smoke (Photo)	SDZ1-90	1st. FLOOR	35	2	0	0	N/A	8	8	8
1	91	Smoke (Photo)	SDZ1-91	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	92	Smoke (Photo)	SDZ1-92	1st. FLOOR	35	19	0	0	N/A	8	8	8
1	93	Smoke (Photo)	SDZ1-93	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	94	Smoke (Photo)	SDZ1-94	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	95	Smoke (Photo)	SDZ1-95	1st. FLOOR	35	2	0	0	N/A	8	8	8
1	96	Smoke (Photo)	SDZ1-96	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	97	Smoke (Photo)	SDZ1-97	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	98	Smoke (Photo)	SDZ1-98	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	99	Smoke (Photo)	SDZ1-99	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	100	Smoke (Photo)	SDZ1-100	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	101	Smoke (Photo)	SDZ1-101	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	102	Smoke (Photo)	SDZ1-102	1st. FLOOR	35	1	0	0	N/A	8	8	8
1	103	Smoke (Photo)	SDZ1-103	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	104	Smoke (Photo)	SDZ1-104	1st. FLOOR	35	1	0	0	N/A	8	8	8
1	105	Smoke (Photo)	SDZ1-105	1st. FLOOR	35	3	0	0	N/A	8	8	8
1	106	Smoke (Photo)	SDZ1-106	1st. FLOOR	35	23	0	0	N/A	8	8	8
1	107	Smoke (Photo)	SDZ1-107	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	108	Smoke (Photo)	SDZ1-108	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	109	Smoke (Photo)	SDZ1-109	1st. FLOOR	35	5	0	0	N/A	8	8	8
1	110	Smoke (Photo)	SDZ1-110	1st. FLOOR	35	21	0	0	N/A	8	8	8
1	111	Smoke (Photo)	SDZ1-111	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	112	Smoke (Photo)	SDZ1-112	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	113	Smoke (Photo)	SDZ1-113	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	114	Smoke (Photo)	SDZ1-114	1st. FLOOR	35	1	0	0	N/A	8	8	8

Device Maintenance Reports												
Node Address : 1 : (NFS2-3030) Panel Version: Z7												
03 May 2025 14:24:14 Active Project : Novotel Rungat 3-5-68												
SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
1	115	Smoke (Photo)	SDZ1-115	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	116	Smoke (Photo)	SDZ1-116	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	117	Smoke (Photo)	SDZ1-117	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	118	Smoke (Photo)	SDZ1-118	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	119	Smoke (Photo)	SDZ1-119	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	120	Smoke (Photo)	SDZ1-120	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	121	Smoke (Photo)	SDZ1-121	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	122	Smoke (Photo)	SDZ1-122	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	123	Smoke (Photo)	SDZ1-123	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	124	Smoke (Photo)	SDZ1-124	1st. FLOOR	35	1	0	0	N/A	8	8	8
1	125	Smoke (Photo)	SDZ1-125	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	126	Smoke (Photo)	SDZ1-126	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	127	Smoke (Photo)	SDZ1-127	1st. FLOOR	35	6	0	0	N/A	8	8	8
1	128	Smoke (Photo)	SDZ1-128	1st. FLOOR	35	4	0	0	N/A	8	8	8
1	129	Smoke (Photo)	SDZ1-129	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	130	Heat (Fixed)	HDZ1-130	1st. FLOOR	0	49	0	45	0	N/A	Fixed	N/A
1	131	Heat (Fixed)	HDZ1-131	1st. FLOOR	0	49	0	45	0	N/A	Fixed	N/A
1	132	Heat (Fixed)	HDZ1-132	1st. FLOOR	0	47	0	43	0	N/A	Fixed	N/A
1	133	Heat (Fixed)	HDZ1-133	1st. FLOOR	0	49	0	43	0	N/A	Fixed	N/A
1	134	Heat (Fixed)	HDZ1-134	1st. FLOOR	0	49	0	43	0	N/A	Fixed	N/A
1	135	Heat (Fixed)	HDZ1-135	1st. FLOOR	0	47	0	43	0	N/A	Fixed	N/A
1	136	Heat (Fixed)	HDZ1-136	1st. FLOOR	0	87	50	0	N/A	Fixed	N/A	N/A
1	137	Heat (Fixed)	HDZ1-137	1st. FLOOR	0	59	54	0	N/A	Fixed	N/A	N/A
1	138	Heat (Fixed)	HDZ1-138	1st. FLOOR	0	56	52	0	N/A	Fixed	N/A	N/A
1	139	Heat (Fixed)	HDZ1-139	1st. FLOOR	0	49	47	0	N/A	Fixed	N/A	N/A
1	140	Heat (Fixed)	HDZ1-140	1st. FLOOR	0	49	47	0	N/A	Fixed	N/A	N/A

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Slt Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
1	141	Heat (Fixed)	HDZ1-141	1st. FLOOR	0	66	59	0	N/A	Fixed	N/A	N/A
1	142	Heat (Fixed)	HDZ1-142	1st. FLOOR	0	66	59	0	N/A	Fixed	N/A	N/A
1	143	Heat (Fixed)	HDZ1-143	1st. FLOOR	0	43	43	0	N/A	Fixed	N/A	N/A
1	144	Heat (Fixed)	FDZ1-144	1st. FLOOR	0	45	42	0	N/A	Fixed	N/A	N/A
1	145	Heat (Fixed)	FDZ1-145	1st. FLOOR	0	45	42	0	N/A	Fixed	N/A	N/A
1	146	Heat (Fixed)	HDZ1-146	1st. FLOOR	0	43	42	0	N/A	Fixed	N/A	N/A
1	147	Smoke (Photo)	SDZ1-147	1st. FLOOR	35	1	0	0	N/A	8	8	8
1	148	Smoke (Photo)	SDZ1-148	1st. FLOOR	35	0	0	0	N/A	8	8	8
1	149	Smoke (Photo)	SDZ1-149	1st. FLOOR	35	0	0	0	N/A	8	8	8
2	1	Smoke (Photo)	SDZ2-1	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	2	Smoke (Photo)	SDZ2-2	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	3	Smoke (Photo)	SDZ2-3	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	4	Smoke (Photo)	SDZ2-4	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	5	Smoke (Photo)	SDZ2-5	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	6	Smoke (Photo)	SDZ2-6	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	7	Smoke (Photo)	SDZ2-7	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	8	Smoke (Photo)	SDZ2-8	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	9	Smoke (Photo)	SDZ2-9	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	10	Smoke (Photo)	SDZ2-10	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	11	Smoke (Photo)	SDZ2-11	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	12	Smoke (Photo)	SDZ2-12	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	13	Smoke (Photo)	SDZ2-13	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	14	Smoke (Photo)	SDZ2-14	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	15	Smoke (Photo)	SDZ2-15	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	16	Smoke (Photo)	SDZ2-16	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	17	Smoke (Photo)	SDZ2-17	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	18	Smoke (Photo)	SDZ2-18	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	19	Smoke (Photo)	SDZ2-19	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	20	Smoke (Photo)	SDZ2-20	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	21	Smoke (Photo)	SDZ2-21	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	22	Smoke (Photo)	SDZ2-22	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	23	Smoke (Photo)	SDZ2-23	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	24	Smoke (Photo)	SDZ2-24	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	25	Smoke (Photo)	SDZ2-25	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	26	Smoke (Photo)	SDZ2-26	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	27	Smoke (Photo)	SDZ2-27	2nd. FLOOR	35	1	0	0	N/A	8	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Slt Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
2	28	Smoke (Photo)	SDZ2-28	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	29	Smoke (Photo)	SDZ2-29	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	30	Smoke (Photo)	SDZ2-30	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	31	Smoke (Photo)	SDZ2-31	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	32	Smoke (Photo)	SDZ2-32	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	33	Smoke (Photo)	SDZ2-33	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	34	Smoke (Photo)	SDZ2-34	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	35	Smoke (Photo)	SDZ2-35	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	36	Smoke (Photo)	SDZ2-36	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	37	Smoke (Photo)	SDZ2-37	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	38	Smoke (Photo)	SDZ2-38	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	39	Smoke (Photo)	SDZ2-39	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	40	Smoke (Photo)	SDZ2-40	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	41	Smoke (Photo)	SDZ2-41	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	42	Smoke (Photo)	SDZ2-42	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	43	Smoke (Photo)	SDZ2-43	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	44	Smoke (Photo)	SDZ2-44	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	45	Smoke (Photo)	SDZ2-45	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	46	Smoke (Photo)	SDZ2-46	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	47	Smoke (Photo)	SDZ2-47	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	48	Smoke (Photo)	SDZ2-48	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	49	Smoke (Photo)	SDZ2-49	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	50	Smoke (Photo)	SDZ2-50	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	51	Smoke (Photo)	SDZ2-51	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	52	Smoke (Photo)	SDZ2-52	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	53	Smoke (Photo)	SDZ2-53	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	54	Smoke (Photo)	SDZ2-54	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	55	Smoke (Photo)	SDZ2-55	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	56	Smoke (Photo)	SDZ2-56	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	57	Smoke (Photo)	SDZ2-57	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	58	Smoke (Photo)	SDZ2-58	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	59	Smoke (Photo)	SDZ2-59	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	60	Smoke (Photo)	SDZ2-60	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	61	Smoke (Photo)	SDZ2-61	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	62	Smoke (Photo)	SDZ2-62	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	63	Smoke (Photo)	SDZ2-63	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	64	Smoke (Photo)	SDZ2-64	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	65	Smoke (Photo)	SDZ2-65	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	66	Smoke (Photo)	SDZ2-66	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	67	Smoke (Photo)	SDZ2-67	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	68	Smoke (Photo)	SDZ2-68	2nd. FLOOR	35	0	0	0	N/A	8	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

Node Address : 1 : (NFS2-3030)  
Panel Version: Z7

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
2	69	Smoke (Photo)	SDZ2-69	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	70	Smoke (Photo)	SDZ2-70	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	71	Smoke (Photo)	SDZ2-71	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	72	Smoke (Photo)	SDZ2-72	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	73	Smoke (Photo)	SDZ2-73	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	74	Smoke (Photo)	SDZ2-74	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	75	Smoke (Photo)	SDZ2-75	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	76	Smoke (Photo)	SDZ2-76	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	77	Smoke (Photo)	SDZ2-77	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	78	Smoke (Photo)	SDZ2-78	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	79	Smoke (Photo)	SDZ2-79	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	80	Smoke (Photo)	SDZ2-80	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	81	Smoke (Photo)	SDZ2-81	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	82	Smoke (Photo)	SDZ2-82	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	83	Smoke (Photo)	SDZ2-83	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	84	Smoke (Photo)	SDZ2-84	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	85	Smoke (Photo)	SDZ2-85	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	86	Smoke (Photo)	SDZ2-86	2nd. FLOOR	35	0	0	0	N/A	8	8	8
2	87	Smoke (Photo)	SDZ2-87	2nd. FLOOR	35	1	0	0	N/A	8	8	8
2	90	Smoke (Photo)	SDZ3-90	3rd. FLOOR	35	0	0	0	N/A	8	8	8
2	91	Smoke (Photo)	SDZ3-91	3rd. FLOOR	35	1	0	0	N/A	8	8	8
2	92	Smoke (Photo)	SDZ3-92	3rd. FLOOR	35	0	0	0	N/A	8	8	8
2	93	Smoke (Photo)	SDZ3-93	3rd. FLOOR	35	0	0	0	N/A	8	8	8
2	94	Smoke (Photo)	SDZ3-94	3rd. FLOOR	35	0	0	0	N/A	8	8	8
2	95	Heat (Fixed)	HDZ2-95	2nd. FLOOR	0	47	42	0	N/A	Fixed	N/A	N/A
2	96	Heat (Fixed)	HDZ2-96	2nd. FLOOR	0	47	36	0	N/A	Fixed	N/A	N/A
2	97	Heat (Fixed)	HDZ2-97	2nd. FLOOR	0	49	38	0	N/A	Fixed	N/A	N/A
2	98	Heat (Fixed)	HDZ2-98	2nd. FLOOR	0	45	36	0	N/A	Fixed	N/A	N/A
2	99	Heat (Fixed)	HDZ2-99	2nd. FLOOR	0	47	38	0	N/A	Fixed	N/A	N/A
2	100	Heat (Fixed)	HDZ2-100	2nd. FLOOR	0	45	36	0	N/A	Fixed	N/A	N/A
2	101	Heat (Fixed)	HDZ2-101	2nd. FLOOR	0	50	38	0	N/A	Fixed	N/A	N/A
2	102	Heat (Fixed)	HDZ2-102	2nd. FLOOR	0	63	43	0	N/A	Fixed	N/A	N/A
2	103	Heat (Fixed)	HDZ2-103	2nd. FLOOR	0	56	45	0	N/A	Fixed	N/A	N/A
2	104	Smoke (Photo)	1st.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	105	Smoke (Photo)	2nd.FLOOR STAIR 1	2nd.FLOOR STAIR 1	35	0	0	0	N/A	8	8	8
2	106	Smoke (Photo)	3rd. FLOOR	STAIR 1	35	0	0	0	N/A	8	8	8
2	107	Smoke (Photo)	4th.FLOOR STAIR 1	4th.FLOOR STAIR 1	35	0	0	0	N/A	8	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

Node Address : 1 : (NFS2-3030)  
Panel Version: Z7

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
2	108	Smoke (Photo)	5th.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	109	Smoke (Photo)	6th.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	110	Smoke (Photo)	7th.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	111	Smoke (Photo)	8th.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	112	Smoke (Photo)	9th.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	113	Smoke (Photo)	10th.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	114	Smoke (Photo)	11th.FLOOR STAIR 1	STAIR 1	35	0	0	0	N/A	8	8	8
2	115	Smoke (Photo)	ROOF FLOOR	STAIR 1	35	1	0	0	N/A	8	8	8
2	116	Smoke (Photo)	1st.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	117	Smoke (Photo)	2nd.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	118	Smoke (Photo)	3rd. FLOOR	STAIR 2	35	0	0	0	N/A	8	8	8
2	119	Smoke (Photo)	4th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	120	Smoke (Photo)	5th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	121	Smoke (Photo)	6th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	122	Smoke (Photo)	7th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	123	Smoke (Photo)	8th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	124	Smoke (Photo)	9th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	125	Smoke (Photo)	10th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	126	Smoke (Photo)	11th.FLOOR STAIR 2	STAIR 2	35	0	0	0	N/A	8	8	8
2	127	Smoke (Photo)	ROOF FLOOR	STAIR 2	35	11	0	0	N/A	8	8	8
2	128	Smoke (Photo)	1st.FLOOR STAIR 3	STAIR 3	35	0	0	0	N/A	8	8	8
2	129	Smoke (Photo)	2nd.FLOOR STAIR 3	STAIR 3	35	0	0	0	N/A	8	8	8
2	130	Smoke (Photo)	3rd. FLOOR	STAIR 3	35	0	0	0	N/A	8	8	8
2	131	Smoke (Photo)	1st.FLOOR STAIR 4	STAIR 4	35	1	0	1	N/A	8	8	8
2	132	Smoke (Photo)	2nd.FLOOR STAIR 4	STAIR 4	35	0	0	0	N/A	8	8	8
2	133	Smoke (Photo)	1st.FLOOR STAIR FILL	STAIR FILL	35	0	0	0	N/A	8	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.



Device Maintenance Reports												
Node Address: 1: (NFS2-3030) Panel Version: 27												
03 May 2025 14:24:14 Active Project: Novotel Rungat 3-5-68												
SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
2	134 Smoke (Photo)	2nd FLOOR	STAIR TML	35	1	0	0	N/A	8	8	8	8
2	135 Smoke (Photo)	3rd FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
2	136 Smoke (Photo)	4th FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
2	137 Smoke (Photo)	5th FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
2	138 Smoke (Photo)	6th FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
2	139 Smoke (Photo)	7th FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
2	140 Smoke (Photo)	8th FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
2	141 Smoke (Photo)	9th FLOOR	STAIR TML	35	1	0	0	N/A	8	8	8	8
2	142 Smoke (Photo)	10th FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
2	143 Smoke (Photo)	11th FLOOR	STAIR TML	35	0	0	0	N/A	8	8	8	8
3	1 Smoke (Photo)	SDZ3-1	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	2 Smoke (Photo)	SDZ3-2	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	3 Smoke (Photo)	SDZ3-3	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	4 Smoke (Photo)	SDZ3-4	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	5 Smoke (Photo)	SDZ3-5	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	6 Smoke (Photo)	SDZ3-6	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	7 Smoke (Photo)	SDZ3-7	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	8 Smoke (Photo)	SDZ3-8	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	9 Smoke (Photo)	SDZ3-9	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	10 Smoke (Photo)	SDZ3-10	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	11 Smoke (Photo)	SDZ3-11	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	12 Smoke (Photo)	SDZ3-12	3rd FLOOR	35	1	0	0	N/A	8	8	8	8
3	13 Smoke (Photo)	SDZ3-13	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	14 Smoke (Photo)	SDZ3-14	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	15 Smoke (Photo)	SDZ3-15	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	16 Smoke (Photo)	SDZ3-16	3rd FLOOR	35	1	0	0	N/A	8	8	8	8
3	17 Smoke (Photo)	SDZ3-17	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	18 Smoke (Photo)	SDZ3-18	3rd FLOOR	35	1	0	0	N/A	8	8	8	8
3	19 Smoke (Photo)	SDZ3-19	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	20 Smoke (Photo)	SDZ3-20	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	21 Smoke (Photo)	SDZ3-21	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	22 Smoke (Photo)	SDZ3-22	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	23 Smoke (Photo)	SDZ3-23	3rd FLOOR	36	2	0	0	N/A	8	8	8	8
3	24 Smoke (Photo)	SDZ3-24	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	25 Smoke (Photo)	SDZ3-25	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	26 Smoke (Photo)	SDZ3-26	3rd FLOOR	35	1	0	0	N/A	8	8	8	8

This Report is compliant with NFPA-72 2007 Edition.

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

Device Maintenance Reports												
Node Address: 1: (NFS2-3030) Panel Version: 27												
03 May 2025 14:24:14 Active Project: Novotel Rungat 3-5-68												
SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
3	27 Smoke (Photo)	SDZ3-27	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	28 Smoke (Photo)	SDZ3-28	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	29 Smoke (Photo)	SDZ3-29	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	30 Smoke (Photo)	SDZ3-30	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	31 Smoke (Photo)	SDZ3-31	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	32 Smoke (Photo)	SDZ3-32	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	33 Smoke (Photo)	SDZ3-33	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	34 Smoke (Photo)	SDZ3-34	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	35 Smoke (Photo)	SDZ3-35	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	36 Smoke (Photo)	SDZ3-36	3rd FLOOR	35	0	0	0	N/A	8	8	8	8
3	37 Heat (Fixed)	HDZ3-37	3rd FLOOR	0	57	52	0	N/A	Fixed	N/A	N/A	N/A
3	38 Heat (Fixed)	HDZ3-38	3rd FLOOR	0	59	56	0	N/A	Fixed	N/A	N/A	N/A
3	39 Heat (Fixed)	HDZ3-39	3rd FLOOR	0	57	54	0	N/A	Fixed	N/A	N/A	N/A
3	40 Heat (Fixed)	HDZ3-40	3rd FLOOR	0	61	57	0	N/A	Fixed	N/A	N/A	N/A
3	41 Heat (Fixed)	HDZ3-41	3rd FLOOR	0	100	49	0	N/A	Fixed	N/A	N/A	N/A
3	42 Heat (Fixed)	HDZ3-42	3rd FLOOR	0	54	54	0	N/A	Fixed	N/A	N/A	N/A
3	43 Smoke (Photo)	SDZ4-43	4th FLOOR	35	0	0	0	N/A	8	8	8	8
3	44 Smoke (Photo)	SDZ4-44	4th FLOOR	35	0	0	0	N/A	8	8	8	8
3	45 Smoke (Photo)	SDZ4-45	4th FLOOR	35	0	0	0	N/A	8	8	8	8
3	46 Smoke (Photo)	SDZ4-46	4th FLOOR	35	0	0	0	N/A	8	8	8	8
3	47 Smoke Acclim	SDZ4-47	4th FLOOR	3	0	0	0	N/A	8	8	8	8
3	48 Smoke Acclim	SDZ4-48	4th FLOOR	2	0	0	0	N/A	8	8	8	8
3	49 Smoke (Photo)	SDZ4-49	4th FLOOR	35	0	0	0	N/A	8	8	8	8
3	50 Smoke Acclim	SDZ4-50	4th FLOOR	5	0	0	0	N/A	8	8	8	8
3	51 Smoke Acclim	SDZ4-51	4th FLOOR	5	0	1	N/A	8	8	8	8	8
3	52 Smoke Acclim	SDZ4-52	4th FLOOR	6	0	0	0	N/A	8	8	8	8
3	53 Smoke Acclim	SDZ4-53	4th FLOOR	1	0	0	0	N/A	8	8	8	8
3	54 Smoke Acclim	SDZ4-54	4th FLOOR	2	0	0	0	N/A	8	8	8	8
3	55 Smoke Acclim	SDZ4-55	4th FLOOR	3	0	0	0	N/A	8	8	8	8
3	56 Smoke Acclim	SDZ4-56	4th FLOOR	1	0	0	0	N/A	8	8	8	8
3	57 Smoke Acclim	SDZ4-57	4th FLOOR	1	0	0	0	N/A	8	8	8	8
3	58 Smoke Acclim	SDZ4-58	4th FLOOR	2	0	0	0	N/A	8	8	8	8
3	59 Smoke Acclim	SDZ4-59	4th FLOOR	2	0	0	0	N/A	8	8	8	8
3	60 Smoke Acclim	SDZ4-60	4th FLOOR	0	0	0	0	N/A	8	8	8	8
3	61 Smoke Acclim	SDZ4-61	4th FLOOR	2	0	0	0	N/A	8	8	8	8
3	62 Smoke Acclim	SDZ4-62	4th FLOOR	0	0	0	0	N/A	8	8	8	8
3	63 Smoke Acclim	SDZ4-63	4th FLOOR	0	0	0	0	N/A	8	8	8	8
3	64 Smoke Acclim	SDZ4-64	4th FLOOR	1	0	0	0	N/A	8	8	8	8
3	65 Smoke Acclim	SDZ4-65	4th FLOOR	4	0	0	0	N/A	8	8	8	8
3	66 Smoke (Photo)	SDZ4-66	4th FLOOR	35	0	0	0	N/A	8	8	8	8
3	67 Smoke Acclim	SDZ4-67	4th FLOOR	1	0	0	0	N/A	8	8	8	8

This Report is compliant with NFPA-72 2007 Edition.

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: 27

03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
3	68	Smoke Acclim	SD24-68	4th. FLOOR	4	0	0	0	0	N/A	8	8
3	69	Smoke Acclim	SD24-69	4th. FLOOR	1	0	0	0	0	N/A	8	8
3	70	Smoke (Photo)	SD24-70	4th. FLOOR	35	0	0	0	0	N/A	8	8
3	71	Smoke Acclim	SD24-71	4th. FLOOR	1	0	0	0	0	N/A	8	8
3	72	Smoke Acclim	SD24-72	4th. FLOOR	1	0	0	0	0	N/A	8	8
3	73	Smoke (Photo)	SD24-73	4th. FLOOR	35	0	0	0	0	N/A	8	8
3	74	Smoke Acclim	SD24-74	4th. FLOOR	3	0	0	0	0	N/A	8	8
3	75	Smoke Acclim	SD24-75	4th. FLOOR	1	0	0	0	0	N/A	8	8
3	76	Smoke Acclim	SD24-76	4th. FLOOR	3	0	0	0	0	N/A	8	8
3	77	Smoke (Photo)	SD24-77	4th. FLOOR	35	0	0	0	0	N/A	8	8
3	78	Smoke Acclim	SD24-78	4th. FLOOR	3	0	0	0	0	N/A	8	8
3	79	Smoke (Photo)	SD24-79	4th. FLOOR	35	0	0	0	0	N/A	8	8
3	80	Smoke (Photo)	SD24-80	4th. FLOOR	35	0	0	0	0	N/A	8	8
3	81	Smoke (Photo)	SD24-81	4th. FLOOR	35	0	0	0	0	N/A	8	8
3	82	Smoke (Photo)	SD24-82	4th. FLOOR	35	0	0	0	0	N/A	8	8
3	84	Heat (Fixed)	HD24-84	5th. FLOOR	0	89	42	0	0	N/A	Fixed	N/A
3	85	Smoke (Photo)	SD25-85	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	86	Smoke (Photo)	SD25-86	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	87	Smoke (Photo)	SD25-87	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	88	Smoke (Photo)	SD25-88	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	89	Smoke (Photo)	SD25-89	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	90	Smoke (Photo)	SD25-90	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	91	Smoke (Photo)	SD25-91	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	92	Smoke (Photo)	SD25-92	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	93	Smoke (Photo)	SD25-93	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	94	Smoke (Photo)	SD25-94	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	95	Smoke (Photo)	SD25-95	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	96	Smoke (Photo)	SD25-96	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	97	Smoke (Photo)	SD25-97	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	98	Smoke (Photo)	SD25-98	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	99	Smoke (Photo)	SD25-99	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	100	Smoke (Photo)	SD25-100	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	101	Smoke (Photo)	SD25-101	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	102	Smoke (Photo)	SD25-102	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	103	Smoke (Photo)	SD25-103	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	104	Smoke (Photo)	SD25-104	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	105	Smoke (Photo)	SD25-105	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	106	Smoke (Photo)	SD25-106	5th. FLOOR	35	0	0	0	0	N/A	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: 27

03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
3	107	Smoke (Photo)	SD25-107	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	108	Smoke (Photo)	SD25-108	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	109	Smoke (Photo)	SD25-109	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	110	Smoke (Photo)	SD25-110	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	111	Smoke (Photo)	SD25-111	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	112	Smoke (Photo)	SD25-112	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	113	Smoke (Photo)	SD25-113	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	114	Smoke (Photo)	SD25-114	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	115	Smoke (Photo)	SD25-115	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	116	Smoke (Photo)	SD25-116	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	117	Smoke (Photo)	SD25-117	5th. FLOOR	35	1	0	0	0	N/A	8	8
3	118	Smoke (Photo)	SD25-118	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	119	Smoke (Photo)	SD25-119	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	120	Smoke (Photo)	SD25-120	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	121	Smoke (Photo)	SD25-121	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	122	Smoke (Photo)	SD25-122	5th. FLOOR	35	2	0	0	0	N/A	8	8
3	123	Smoke (Photo)	SD25-123	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	124	Smoke (Photo)	SD25-124	5th. FLOOR	35	0	0	0	0	N/A	8	8
3	126	Heat (Fixed)	HD25-126	5th. FLOOR	0	89	45	0	0	N/A	Fixed	N/A
4	1	Smoke (Photo)	SD26-1	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	2	Smoke (Photo)	SD26-2	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	3	Smoke (Photo)	SD26-3	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	4	Smoke (Photo)	SD26-4	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	5	Smoke (Photo)	SD26-5	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	6	Smoke (Photo)	SD26-6	6th. FLOOR	35	1	0	0	0	N/A	8	8
4	7	Smoke (Photo)	SD26-7	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	8	Smoke (Photo)	SD26-8	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	9	Smoke (Photo)	SD26-9	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	10	Smoke (Photo)	SD26-10	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	11	Smoke (Photo)	SD26-11	6th. FLOOR	35	0	0	0	0	N/A	8	8
4	12	Smoke (Photo)	SD26-12	6th. FLOOR	35	0	0	0	0	N/A	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
4	13	Smoke (Photo)	SD26-13	6th. FLOOR	35	1	0	0	N/A	8	8	8
4	14	Smoke (Photo)	SD26-14	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	15	Smoke (Photo)	SD26-15	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	16	Smoke (Photo)	SD26-16	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	17	Smoke (Photo)	SD26-17	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	18	Smoke (Photo)	SD26-18	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	19	Smoke (Photo)	SD26-19	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	20	Smoke (Photo)	SD26-20	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	21	Smoke (Photo)	SD26-21	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	22	Smoke (Photo)	SD26-22	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	23	Smoke (Photo)	SD26-23	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	24	Smoke (Photo)	SD26-24	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	25	Smoke (Photo)	SD26-25	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	26	Smoke (Photo)	SD26-26	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	27	Smoke (Photo)	SD26-27	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	28	Smoke (Photo)	SD26-28	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	29	Smoke (Photo)	SD26-29	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	30	Smoke (Photo)	SD26-30	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	31	Smoke (Photo)	SD26-31	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	32	Smoke (Photo)	SD26-32	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	33	Smoke (Photo)	SD26-33	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	34	Smoke (Photo)	SD26-34	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	35	Smoke (Photo)	SD26-35	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	36	Smoke (Photo)	SD26-36	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	37	Smoke (Photo)	SD26-37	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	38	Smoke (Photo)	SD26-38	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	39	Smoke (Photo)	SD26-39	6th. FLOOR	35	0	0	0	N/A	8	8	8
4	40	Smoke (Photo)	SD26-40	6th. FLOOR	35	1	0	0	N/A	8	8	8
4	42	Heat (Fixed)	HD26-42	6th. FLOOR	0	92	47	0	N/A	Fixed	N/A	N/A
4	43	Smoke (Photo)	SD27-43	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	44	Smoke (Photo)	SD27-44	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	45	Smoke (Photo)	SD27-45	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	46	Smoke (Photo)	SD27-46	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	47	Smoke (Photo)	SD27-47	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	48	Smoke (Photo)	SD27-48	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	49	Smoke (Photo)	SD27-49	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	50	Smoke (Photo)	SD27-50	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	51	Smoke (Photo)	SD27-51	7th. FLOOR	35	7	0	0	N/A	8	8	8
4	52	Smoke (Photo)	SD27-52	7th. FLOOR	35	1	0	0	N/A	8	8	8
4	53	Smoke (Photo)	SD27-53	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	54	Smoke (Photo)	SD27-54	7th. FLOOR	35	2	0	0	N/A	8	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
4	55	Smoke (Photo)	SDZ7-55	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	56	Smoke (Photo)	SDZ7-56	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	57	Smoke (Photo)	SDZ7-57	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	58	Smoke (Photo)	SDZ7-58	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	59	Smoke (Photo)	SDZ7-59	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	60	Smoke (Photo)	SDZ7-60	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	61	Smoke (Photo)	SDZ7-61	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	62	Smoke (Photo)	SDZ7-62	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	63	Smoke (Photo)	SDZ7-63	7th. FLOOR	35	1	0	0	N/A	8	8	8
4	64	Smoke (Photo)	SDZ7-64	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	65	Smoke (Photo)	SDZ7-65	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	66	Smoke (Photo)	SDZ7-66	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	67	Smoke (Photo)	SDZ7-67	7th. FLOOR	35	1	0	0	N/A	8	8	8
4	68	Smoke (Photo)	SDZ7-68	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	69	Smoke (Photo)	SDZ7-69	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	70	Smoke (Photo)	SDZ7-70	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	71	Smoke (Photo)	SDZ7-71	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	72	Smoke (Photo)	SDZ7-72	7th. FLOOR	35	1	0	0	N/A	8	8	8
4	73	Smoke (Photo)	SDZ7-73	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	74	Smoke (Photo)	SDZ7-74	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	75	Smoke (Photo)	SDZ7-75	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	76	Smoke (Photo)	SDZ7-76	7th. FLOOR	35	1	0	0	N/A	8	8	8
4	77	Smoke (Photo)	SDZ7-77	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	78	Smoke (Photo)	SDZ7-78	7th. FLOOR	36	1	0	0	N/A	8	8	8
4	79	Smoke (Photo)	SDZ7-79	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	80	Smoke (Photo)	SDZ7-80	7th. FLOOR	35	1	0	0	N/A	8	8	8
4	81	Smoke (Photo)	SDZ7-81	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	82	Smoke (Photo)	SDZ7-82	7th. FLOOR	35	0	0	0	N/A	8	8	8
4	84	Heat (Fixed)	HDZ7-84	7th. FLOOR	0	94	49	0	N/A	Fixed	N/A	N/A
4	85	Smoke (Photo)	SDZ8-85	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	86	Smoke (Photo)	SDZ8-86	8th. FLOOR	35	1	0	0	N/A	8	8	8
4	87	Smoke (Photo)	SDZ8-87	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	88	Smoke (Photo)	SDZ8-88	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	89	Smoke (Photo)	SDZ8-89	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	90	Smoke (Photo)	SDZ8-90	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	91	Smoke (Photo)	SDZ8-91	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	92	Smoke (Photo)	SDZ8-92	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	93	Smoke (Photo)	SDZ8-93	8th. FLOOR	35	2	0	0	N/A	8	8	8
4	94	Smoke (Photo)	SDZ8-94	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	95	Smoke (Photo)	SDZ8-95	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	96	Smoke (Photo)	SDZ8-96	8th. FLOOR	35	0	0	0	N/A	8	8	8

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NF52-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project: Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
4	97	Smoke (Photo)	SDZ8-97	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	98	Smoke (Photo)	SDZ8-98	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	99	Smoke (Photo)	SDZ8-99	8th. FLOOR	35	1	0	0	N/A	8	8	8
4	100	Smoke (Photo)	SDZ8-100	8th. FLOOR	35	1	0	0	N/A	8	8	8
4	101	Smoke (Photo)	SDZ8-101	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	102	Smoke (Photo)	SDZ8-102	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	103	Smoke (Photo)	SDZ8-103	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	104	Smoke (Photo)	SDZ8-104	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	105	Smoke (Photo)	SDZ8-105	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	106	Smoke (Photo)	SDZ8-106	8th. FLOOR	35	3	0	0	N/A	8	8	8
4	107	Smoke (Photo)	SDZ8-107	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	108	Smoke (Photo)	SDZ8-108	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	109	Smoke (Photo)	SDZ8-109	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	110	Smoke (Photo)	SDZ8-110	8th. FLOOR	35	1	0	0	N/A	8	8	8
4	111	Smoke (Photo)	SDZ8-111	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	112	Smoke (Photo)	SDZ8-112	8th. FLOOR	35	1	0	0	N/A	8	8	8
4	113	Smoke (Photo)	SDZ8-113	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	114	Smoke (Photo)	SDZ8-114	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	115	Smoke (Photo)	SDZ8-115	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	116	Smoke (Photo)	SDZ8-116	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	117	Smoke (Photo)	SDZ8-117	8th. FLOOR	35	1	0	0	N/A	8	8	8
4	118	Smoke (Photo)	SDZ8-118	8th. FLOOR	35	1	0	0	N/A	8	8	8
4	119	Smoke (Photo)	SDZ8-119	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	120	Smoke (Photo)	SDZ8-120	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	121	Smoke (Photo)	SDZ8-121	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	122	Smoke (Photo)	SDZ8-122	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	123	Smoke (Photo)	SDZ8-123	8th. FLOOR	35	0	0	0	N/A	8	8	8
4	124	Smoke (Photo)	SDZ8-124	8th. FLOOR	35	0	0	0	N/A	8	8	8

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NF52-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project: Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
4	126	Heat (Fixed)	HDZ8-126	8th. FLOOR	0	98	47	0	N/A	Fixed	N/A	N/A
5	1	Smoke (Photo)	SDZ9-1	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	2	Smoke (Photo)	SDZ9-2	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	3	Smoke (Photo)	SDZ9-3	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	4	Smoke (Photo)	SDZ9-4	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	5	Smoke (Photo)	SDZ9-5	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	6	Smoke (Photo)	SDZ9-6	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	7	Smoke (Photo)	SDZ9-7	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	8	Smoke (Photo)	SDZ9-8	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	9	Smoke (Photo)	SDZ9-9	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	10	Smoke (Photo)	SDZ9-10	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	11	Smoke (Photo)	SDZ9-11	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	12	Smoke (Photo)	SDZ9-12	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	13	Smoke (Photo)	SDZ9-13	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	14	Smoke (Photo)	SDZ9-14	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	15	Smoke (Photo)	SDZ9-15	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	16	Smoke (Photo)	SDZ9-16	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	17	Smoke (Photo)	SDZ9-17	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	18	Smoke (Photo)	SDZ9-18	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	19	Smoke (Photo)	SDZ9-19	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	20	Smoke (Photo)	SDZ9-20	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	21	Smoke (Photo)	SDZ9-21	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	22	Smoke (Photo)	SDZ9-22	9th. FLOOR	35	1	0	0	N/A	8	8	8
5	23	Smoke (Photo)	SDZ9-23	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	24	Smoke (Photo)	SDZ9-24	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	25	Smoke (Photo)	SDZ9-25	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	26	Smoke (Photo)	SDZ9-26	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	27	Smoke (Photo)	SDZ9-27	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	28	Smoke (Photo)	SDZ9-28	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	29	Smoke (Photo)	SDZ9-29	9th. FLOOR	35	1	0	0	N/A	8	8	8
5	30	Smoke (Photo)	SDZ9-30	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	31	Smoke (Photo)	SDZ9-31	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	32	Smoke (Photo)	SDZ9-32	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	33	Smoke (Photo)	SDZ9-33	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	34	Smoke (Photo)	SDZ9-34	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	35	Smoke (Photo)	SDZ9-35	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	36	Smoke (Photo)	SDZ9-36	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	37	Smoke (Photo)	SDZ9-37	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	38	Smoke (Photo)	SDZ9-38	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	39	Smoke (Photo)	SDZ9-39	9th. FLOOR	35	0	0	0	N/A	8	8	8
5	40	Smoke (Photo)	SDZ9-40	9th. FLOOR	35	1	0	0	N/A	8	8	8

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
5	42	Heat (Fixed)	HDZ10-42	9th FLOOR	0	84	50	0	N/A	Fixed	N/A	
5	43	Smoke (Photo)	SDZ10-43	10th FLOOR	35	0	0	0	N/A	8	8	
5	44	Smoke (Photo)	SDZ10-44	10th FLOOR	35	0	0	0	N/A	8	8	
5	45	Smoke (Photo)	SDZ10-45	10th FLOOR	35	0	0	0	N/A	8	8	
5	46	Smoke (Photo)	SDZ10-46	10th FLOOR	35	0	0	0	N/A	8	8	
5	47	Smoke (Photo)	SDZ10-47	10th FLOOR	35	0	0	0	N/A	8	8	
5	48	Smoke (Photo)	SDZ10-48	10th FLOOR	35	0	0	0	N/A	8	8	
5	49	Smoke (Photo)	SDZ10-49	10th FLOOR	35	1	0	0	N/A	8	8	
5	50	Smoke (Photo)	SDZ10-50	10th FLOOR	35	0	0	0	N/A	8	8	
5	51	Smoke (Photo)	SDZ10-51	10th FLOOR	35	0	0	0	N/A	8	8	
5	52	Smoke (Photo)	SDZ10-52	10th FLOOR	35	1	0	0	N/A	8	8	
5	53	Smoke (Photo)	SDZ10-53	10th FLOOR	35	0	0	0	N/A	8	8	
5	54	Smoke (Photo)	SDZ10-54	10th FLOOR	35	0	0	0	N/A	8	8	
5	55	Smoke (Photo)	SDZ10-55	10th FLOOR	35	0	0	0	N/A	8	8	
5	56	Smoke (Photo)	SDZ10-56	10th FLOOR	35	0	0	0	N/A	8	8	
5	57	Smoke (Photo)	SDZ10-57	10th FLOOR	35	0	0	0	N/A	8	8	
5	58	Smoke (Photo)	SDZ10-58	10th FLOOR	35	0	0	0	N/A	8	8	
5	59	Smoke (Photo)	SDZ10-59	10th FLOOR	35	0	0	0	N/A	8	8	
5	60	Smoke (Photo)	SDZ10-60	10th FLOOR	35	0	0	0	N/A	8	8	
5	61	Smoke (Photo)	SDZ10-61	10th FLOOR	35	0	0	0	N/A	8	8	
5	62	Smoke (Photo)	SDZ10-62	10th FLOOR	35	0	0	0	N/A	8	8	
5	63	Smoke (Photo)	SDZ10-63	10th FLOOR	35	0	0	0	N/A	8	8	
5	64	Smoke (Photo)	SDZ10-64	10th FLOOR	35	0	0	0	N/A	8	8	
5	65	Smoke (Photo)	SDZ10-65	10th FLOOR	35	0	0	0	N/A	8	8	
5	66	Smoke (Photo)	SDZ10-66	10th FLOOR	37	1	0	0	N/A	8	8	
5	67	Smoke (Photo)	SDZ10-67	10th FLOOR	35	0	0	0	N/A	8	8	
5	68	Smoke (Photo)	SDZ10-68	10th FLOOR	35	0	0	0	N/A	8	8	

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7

03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
5	69	Smoke (Photo)	SDZ10-69	10th FLOOR	35	0	0	0	N/A	8	8	
5	70	Smoke (Photo)	SDZ10-70	10th FLOOR	35	0	0	0	N/A	8	8	
5	71	Smoke (Photo)	SDZ10-71	10th FLOOR	35	0	0	0	N/A	8	8	
5	72	Smoke (Photo)	SDZ10-72	10th FLOOR	35	1	0	0	N/A	8	8	
5	73	Smoke (Photo)	SDZ10-73	10th FLOOR	35	0	0	0	N/A	8	8	
5	74	Smoke (Photo)	SDZ10-74	10th FLOOR	35	0	0	0	N/A	8	8	
5	75	Smoke (Photo)	SDZ10-75	10th FLOOR	35	0	0	0	N/A	8	8	
5	76	Smoke (Photo)	SDZ10-76	10th FLOOR	35	0	0	0	N/A	8	8	
5	77	Smoke (Photo)	SDZ10-77	10th FLOOR	35	0	0	0	N/A	8	8	
5	78	Smoke (Photo)	SDZ10-78	10th FLOOR	35	0	0	0	N/A	8	8	
5	79	Smoke (Photo)	SDZ10-79	10th FLOOR	35	0	0	0	N/A	8	8	
5	80	Smoke (Photo)	SDZ10-80	10th FLOOR	35	1	0	0	N/A	8	8	
5	81	Smoke (Photo)	SDZ10-81	10th FLOOR	35	0	0	0	N/A	8	8	
5	82	Smoke (Photo)	SDZ10-82	10th FLOOR	35	0	0	0	N/A	8	8	
5	84	Heat (Fixed)	HDZ10-84	10th FLOOR	0	63	47	0	N/A	Fixed	N/A	
5	85	Smoke (Photo)	SDZ11-85	11th FLOOR	35	0	0	0	N/A	8	8	
5	86	Smoke (Photo)	SDZ11-86	11th FLOOR	35	0	0	0	N/A	8	8	
5	87	Smoke (Photo)	SDZ11-87	11th FLOOR	35	1	0	0	N/A	8	8	
5	88	Smoke (Photo)	SDZ11-88	11th FLOOR	35	1	0	0	N/A	8	8	
5	89	Smoke (Photo)	SDZ11-89	11th FLOOR	35	0	0	0	N/A	8	8	
5	90	Smoke (Photo)	SDZ11-90	11th FLOOR	35	8	0	0	N/A	8	8	
5	91	Smoke (Photo)	SDZ11-91	11th FLOOR	35	0	0	0	N/A	8	8	
5	92	Smoke (Photo)	SDZ11-92	11th FLOOR	35	0	0	0	N/A	8	8	
5	93	Smoke (Photo)	SDZ11-93	11th FLOOR	35	0	0	0	N/A	8	8	
5	94	Smoke (Photo)	SDZ11-94	11th FLOOR	35	0	0	0	N/A	8	8	
5	95	Smoke (Photo)	SDZ11-95	11th FLOOR	35	0	0	0	N/A	8	8	

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7  
03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
5	96	Smoke (Photo)	SDZ11-96	11th FLOOR	35	0	0	0	N/A	8	8	8
5	97	Smoke (Photo)	SDZ11-97	11th FLOOR	35	0	0	0	N/A	8	8	8
5	98	Smoke (Photo)	SDZ11-98	11th FLOOR	35	0	0	0	N/A	8	8	8
5	99	Smoke (Photo)	SDZ11-99	11th FLOOR	35	0	0	0	N/A	8	8	8
5	100	Smoke (Photo)	SDZ11-100	11th FLOOR	35	1	0	0	N/A	8	8	8
5	101	Smoke (Photo)	SDZ11-101	11th FLOOR	35	0	0	0	N/A	8	8	8
5	102	Smoke (Photo)	SDZ11-102	11th FLOOR	35	0	0	0	N/A	8	8	8
5	103	Smoke (Photo)	SDZ11-103	11th FLOOR	35	1	0	0	N/A	8	8	8
5	104	Smoke (Photo)	SDZ11-104	11th FLOOR	35	0	0	0	N/A	8	8	8
5	105	Smoke (Photo)	SDZ11-105	11th FLOOR	35	2	0	0	N/A	8	8	8
5	106	Smoke (Photo)	SDZ11-106	11th FLOOR	35	0	0	0	N/A	8	8	8
5	107	Smoke (Photo)	SDZ11-107	11th FLOOR	35	0	0	0	N/A	8	8	8
5	108	Smoke (Photo)	SDZ11-108	11th FLOOR	35	0	0	0	N/A	8	8	8
5	109	Smoke (Photo)	SDZ11-109	11th FLOOR	35	0	0	0	N/A	8	8	8
5	110	Smoke (Photo)	SDZ11-110	11th FLOOR	35	0	0	0	N/A	8	8	8
5	111	Smoke (Photo)	SDZ11-111	11th FLOOR	35	0	0	0	N/A	8	8	8
5	112	Smoke (Photo)	SDZ11-112	11th FLOOR	35	0	0	0	N/A	8	8	8
5	113	Smoke (Photo)	SDZ11-113	11th FLOOR	35	0	0	0	N/A	8	8	8
5	114	Smoke (Photo)	SDZ11-114	11th FLOOR	35	1	0	0	N/A	8	8	8
5	115	Smoke (Photo)	SDZ11-115	11th FLOOR	35	0	0	0	N/A	8	8	8
5	116	Smoke (Photo)	SDZ11-116	11th FLOOR	35	0	0	0	N/A	8	8	8
5	117	Smoke (Photo)	SDZ11-117	11th FLOOR	35	1	0	0	N/A	8	8	8
5	118	Smoke (Photo)	SDZ11-118	11th FLOOR	35	1	0	0	N/A	8	8	8
5	119	Smoke (Photo)	SDZ11-119	11th FLOOR	35	0	0	0	N/A	8	8	8
5	120	Smoke (Photo)	SDZ11-120	11th FLOOR	35	0	0	0	N/A	8	8	8
5	121	Smoke (Photo)	SDZ11-121	11th FLOOR	35	1	0	0	N/A	8	8	8

This Report is compliant with NFPA-72 2007 Edition.

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)  
Panel Version: Z7  
03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Type/Code Label	Custom Label	Extended Label	Drift %	Peak %	Alarm %	Pre-Alarm %	Battery Life	Alarm Level	Active Sensitivity	Pre-Alarm Level
5	122	Smoke (Photo)	SDZ11-122	11th FLOOR	35	0	0	0	N/A	8	8	8
5	123	Smoke (Photo)	SDZ11-123	11th FLOOR	35	0	0	0	N/A	8	8	8
5	124	Smoke (Photo)	SDZ11-124	11th FLOOR	35	0	0	0	N/A	8	8	8
5	125	Smoke (Photo)	SDZ11-125	11th FLOOR	35	0	0	0	N/A	8	8	8
5	126	Smoke (Photo)	SDZ11-126	11th FLOOR	35	0	0	0	N/A	8	8	8
5	127	Heat (Fixed)	HDZ11-12	11th FLOOR	0	89	59	0	N/A	Fixed	N/A	N/A
5	128	Smoke (Photo)	SDZR-128	ROOF FLOOR	35	0	0	0	N/A	8	8	8
5	129	Smoke (Photo)	SDZR-129	ROOF FLOOR	35	0	0	0	N/A	8	8	8
5	130	Smoke (Photo)	SDZR-130	ROOF FLOOR	35	0	0	0	N/A	8	8	8
5	131	Smoke (Photo)	SDZR-131	ROOF FLOOR	35	0	0	0	N/A	8	8	8

Device Maintenance: Detectors-Part2

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance	CO-State	CO-Concentration	Trouble Status	Functional Maintenance	Date
1	1	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025	22/04/2025
1	2	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025	22/04/2025
1	3	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025	22/04/2025
1	4	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025	22/04/2025
1	5	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025	22/04/2025
1	6	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025	22/04/2025
1	7	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	21/04/2025	21/04/2025
1	8	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	21/04/2025	21/04/2025
1	9	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	21/04/2025	21/04/2025
1	10	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025	22/04/2025
1	11	2.12 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	21/04/2025	21/04/2025

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Note Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
1	12	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	13	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	14	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	15	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	Untested
1	16	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	17	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	18	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	19	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
1	20	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	21	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	22	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	23	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	24	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	25	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	26	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	27	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	28	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	29	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	30	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	31	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	32	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	33	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	34	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	35	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	36	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Note Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
1	37	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	38	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	39	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	40	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	41	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	42	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	43	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	44	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	45	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	46	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	47	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	48	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	49	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	50	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	51	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	52	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	53	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
1	54	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	55	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	56	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	57	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	58	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	59	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	60	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	61	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Note Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
1	62	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
1	63	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	64	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	65	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
1	66	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	67	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/03/2025
1	68	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	69	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
1	70	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	71	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	72	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	73	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	74	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	75	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	76	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	77	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	78	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	79	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	80	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	81	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	82	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	27/03/2025
1	83	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	05/04/2025
1	84	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	27/03/2025
1	85	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	86	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Note Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
1	87	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	88	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	89	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	90	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	91	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	92	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	93	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	94	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	95	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	96	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	97	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	98	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	99	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	100	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	101	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	102	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	103	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	104	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	105	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	106	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	107	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	108	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	109	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	110	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	111	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.



Device Maintenance Reports

Node Address: 11 (NFS2-3030)  
Panel Version: 27

03 May 2025 14:24:14  
Active Project: Novolite Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Active Sensitivity	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
1	112	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	113	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	114	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	115	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	116	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/03/2023
1	117	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	118	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	119	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	120	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	121	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	04/08/2023
1	122	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	123	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	124	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	125	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	126	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	127	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	128	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	129	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	130	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	131	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	132	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	133	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	134	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	135	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	136	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 11 (NFS2-3030)  
Panel Version: 27

03 May 2025 14:24:14  
Active Project: Novolite Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Active Sensitivity	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
1	137	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	138	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	139	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	140	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	141	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	142	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	143	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	144	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	145	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	146	135°F	N/A	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
1	147	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	148	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
1	149	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	21/04/2025
2	1	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	2	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	3	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	4	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	5	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	6	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	7	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	8	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	9	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	10	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	11	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	12	2.12	1.33 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NFS2-3030)  
Panel Version: 27  
03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
2	13	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	14	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	15	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	16	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	17	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	18	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	19	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	20	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	21	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	22	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	23	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	24	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	25	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	26	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	27	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	28	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	29	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	30	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	31	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	32	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
2	33	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
2	34	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	35	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	36	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	37	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NFS2-3030)  
Panel Version: 27  
03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
2	38	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	39	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	40	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	41	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	42	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	43	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	44	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	45	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	46	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	47	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	48	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	49	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	50	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	51	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	52	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	53	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	54	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	55	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	56	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	57	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	58	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	59	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	60	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	61	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	62	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NFS2-3030)  
Panel Version: 27  
03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
2	63	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	64	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	65	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	66	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	67	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	68	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	69	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	70	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	71	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	72	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	73	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	74	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	75	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	76	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	77	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	78	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	79	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	80	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	81	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	82	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	83	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	84	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	85	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	86	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	87	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NFS2-3030)  
Panel Version: 27  
03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
2	90	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	91	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	92	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	93	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	94	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	95	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	96	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	97	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	98	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	99	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	100	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	101	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	102	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	103	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	104	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025
2	105	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	23/04/2025
2	106	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	107	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	108	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	109	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	110	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
2	111	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
2	112	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
2	113	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
2	114	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
2	115	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
2	116	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33	Occupied	No	N/A	N/A	N/A	N/A	Pass	22/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NFS2-3030)  
Panel Version: 2.7  
03 May 2025 14:24:14  
Active Project: Novofire Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
2	117	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	118	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	119	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	120	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	121	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	122	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	123	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
2	124	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
2	125	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
2	126	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
2	127	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
2	128	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
2	129	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	130	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	131	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
2	132	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	133	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	22/04/2025
2	134	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	23/04/2025
2	135	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	136	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	137	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	138	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	139	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
2	140	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
2	141	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NFS2-3030)  
Panel Version: 2.7  
03 May 2025 14:24:14  
Active Project: Novofire Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
2	142	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
2	143	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
3	1	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	2	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	3	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	4	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	5	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	6	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	7	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	8	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	9	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	10	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	11	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	12	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	13	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	14	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	15	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	16	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	17	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
3	18	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	19	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	20	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	21	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
3	22	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	23	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1; (NFS2-3030)  
Panel Version: 27  
03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
3	24	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	25	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	26	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	27	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	28	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	29	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	30	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	31	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	32	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	33	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
3	34	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	35	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	36	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	37	135°F	N/A		Occupied	Yes	N/A	N/A	N/A	Pass	30/04/2025
3	38	135°F	N/A		Occupied	Yes	N/A	N/A	N/A	Pass	30/04/2025
3	39	135°F	N/A		Occupied	Yes	N/A	N/A	N/A	Pass	30/04/2025
3	40	135°F	N/A		Occupied	Yes	N/A	N/A	N/A	Pass	30/04/2025
3	41	135°F	N/A		Occupied	Yes	N/A	N/A	N/A	Pass	30/04/2025
3	42	135°F	N/A		Occupied	Yes	N/A	N/A	N/A	Pass	30/04/2025
3	43	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	44	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	45	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	46	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	47	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	48	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	49	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	50	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	51	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1; (NFS2-3030)  
Panel Version: 27  
03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
3	52	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	53	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	54	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	55	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	30/04/2025
3	56	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	57	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	58	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	59	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	02/05/2025
3	60	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	29/04/2025
3	61	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	29/04/2025
3	62	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	63	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	64	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	65	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	02/05/2025
3	66	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	67	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	02/05/2025
3	68	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	69	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	70	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	71	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	72	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025
3	73	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	74	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	29/04/2025
3	75	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	29/04/2025
3	76	4 %Obs/R2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	28/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novell Rungat 3-5-68

Node Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
3	77	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	78	4 %Obs/Ft2-3	%Obs/Ft	%Obs/Ft	Occupied	Yes	N/A	N/A	N/A	Pass	29/04/2025
3	79	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	80	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	14/03/2023
3	81	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	82	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	84	135 °F	N/A	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	85	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	86	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	87	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	88	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	89	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
3	90	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	91	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	92	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	93	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	94	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	95	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
3	96	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	97	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
3	98	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
3	99	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	100	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	101	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	102	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	103	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novell Rungat 3-5-68

Node Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
3	104	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	105	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	106	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	107	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	108	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	109	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	110	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	111	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	112	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	113	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	114	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	115	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	116	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
3	117	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
3	118	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
3	119	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	120	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	121	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	122	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	123	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	124	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
3	126	135 °F	N/A	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	1	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	2	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	3	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Node Address : 1 : (NFS2-3030)  
Panel Version : 27

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
4	4	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	5	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	6	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	7	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	8	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	9	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	10	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	11	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	12	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	13	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	14	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	15	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	16	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	17	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	18	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	19	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	20	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	21	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	22	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	23	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	24	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	25	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	26	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	27	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	28	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Node Address : 1 : (NFS2-3030)  
Panel Version : 27

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
4	29	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	30	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	31	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	32	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	33	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	34	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	35	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	36	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	37	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	38	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	39	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	40	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	42	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	43	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	44	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	45	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	46	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	47	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	48	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	49	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	50	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	51	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	52	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	53	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	54	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	55	2.12	1.33	1.33	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 11 (NFS2-3030)  
Panel Version: 27

03 May 2025 14:24:14  
Active Project: Novofire Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
4	56	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	57	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	58	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	59	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	60	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	61	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	62	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	63	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	64	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	65	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	66	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	67	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	68	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	69	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	70	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	71	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	72	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	73	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	74	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	75	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	76	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	77	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	78	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	79	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	80	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 11 (NFS2-3030)  
Panel Version: 27

03 May 2025 14:24:14  
Active Project: Novofire Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
4	81	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	82	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	84	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	85	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	86	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	87	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	88	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	89	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	90	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	91	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	92	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	93	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	94	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	95	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	96	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	97	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	98	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	99	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	24/05/2024
4	100	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	101	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	102	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	103	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	104	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	105	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
4	106	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	107	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025

Notifier, Inc. <https://www.securityandfire.honeywell.com/notifier/en-us>

This Report is compliant with NFPA-72 2007 Edition.



Device Maintenance Reports

Node Address: 1: (NFS2-3030)  
Panel Version: 27

03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
4	108	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	109	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
4	110	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	111	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	112	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	113	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	114	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
4	115	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	116	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	117	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
4	118	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	119	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	120	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	121	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	122	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	123	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	124	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
4	126	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	1	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	2	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	3	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	4	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	5	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	6	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	7	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1: (NFS2-3030)

03 May 2025 14:24:14  
Active Project: Novell Rungat 3-5-68

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
5	8	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	9	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	10	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	11	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	12	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	13	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
5	14	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
5	15	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	16	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	17	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	18	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	19	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	20	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	21	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
5	22	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	23	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	24	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	25	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	26	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	27	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	28	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	29	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	30	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	31	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	32	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Note Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
5	33	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	03/05/2025
5	34	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	35	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	36	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	37	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	38	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	39	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	40	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	42	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	43	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	44	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	45	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	46	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	47	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	48	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	49	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	50	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	51	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	52	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	53	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	54	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	55	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	56	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	57	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	58	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	59	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

03 May 2025 14:24:14  
Active Project : Novofir Rungat 3-5-68

Note Address : 1 : (NFS2-3030)  
Panel Version: 27

SLC Loop	Device Address	Active Sensitivity	Alarm Level Value	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
5	60	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	61	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	62	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	63	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	64	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	65	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	66	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	67	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	68	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	69	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	70	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	71	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	72	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	73	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	74	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	75	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	76	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	77	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	78	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	02/05/2025
5	79	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	80	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/03/2023
5	81	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	82	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	84	135 °F	N/A	N/A	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	85	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	86	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address: 1 : (NFS2-3030)

Panel Version: 27

03 May 2025 14:24:14

Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
5 87	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
5 88	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 89	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 90	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
5 91	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 92	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 93	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 94	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 95	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 96	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 97	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 98	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 99	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	02/05/2025
5 100	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 101	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 102	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
5 103	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 104	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 105	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 106	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	30/04/2025
5 107	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
5 108	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
5 109	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025
5 110	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	29/04/2025
5 111	2.12	1.33	%Obs/Ft	Occupied	No	N/A	N/A	N/A	N/A	Pass	28/04/2025

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports

Node Address : 1 : (NFS2-3030)  
Panel Version : 27

03 May 2025 14:24:14  
Active Project : Novotel Rungat 3-5-68

SLC Loop	Device Address	Alarm Level Value	Active Sensitivity	Pre-Alarm Level Value	Occupancy State	Magnet Test	CO-Maintenance Date	CO-State	CO-Concentration (ppm)	Trouble Status	Functional Maintenance Date
5	112	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	113	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	114	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	115	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	116	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	117	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	118	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	119	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	28/04/2025
5	120	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	121	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	122	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	30/04/2025
5	123	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	124	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	125	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	126	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	127	135 °F	N/A		Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	128	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	129	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	130	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025
5	131	2.12 %Obs/Ft	1.33 %Obs/Ft	1.33 %Obs/Ft	Occupied	No	N/A	N/A	N/A	Pass	29/04/2025

Device Maintenance Modules

SLC Loop	Device Address	Type	Code	Label	Custom Label	Extended Label	Functional Maintenance Date	Battery Life	Trouble Status
1	1	Strobe Ckt	STZ 1	FL-1		1st. FLOOR	16/12/2024	N/A	Pass
1	2	Strobe Ckt	STZ 2	FL-1		1st. FLOOR	16/12/2024	N/A	Pass
1	3	Strobe Ckt	STZ ST1			STAIR 1	16/12/2024	N/A	Pass
1	4	Strobe Ckt	STZ ST2			STAIR 2	16/12/2024	N/A	Pass
1	5	Strobe Ckt	STZ ST3			STAIR 3	16/12/2024	N/A	Pass
1	6	Strobe Ckt	STZ ST4			STAIR 4	16/12/2024	N/A	Pass

Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us

This Report is compliant with NFPA-72 2007 Edition.

Device Maintenance Reports						
Node Address: 1: (NFS2-3030) Panel Version: 27						
03 May 2025 14:24:14 Active Protection Normal Alarm: 3-5-58						
SIC Loop	DeviceAddress	TypeCode Label	ExtendedLabel	Functional Maintenance Date	Battery Life	Trouble Status
1	7	STZ Fire MAN LIFT	FML	16/12/2024	N/A	Pass
1	8	SPZ 1 FL-1	1st. FLOOR	16/12/2024	N/A	Pass
1	9	SPZ 2 FL-1	1st. FLOOR	16/12/2024	N/A	Pass
1	10	SPZ ST1	STAIR 1	16/12/2024	N/A	Pass
1	11	SPZ ST2	STAIR 2	16/12/2024	N/A	Pass
1	12	SPZ ST3	STAIR 3	16/12/2024	N/A	Pass
1	13	SPZ ST4	STAIR 4	16/12/2024	N/A	Pass
1	14	SPZ FIRE MAN LIFT	FML	16/12/2024	N/A	Pass
1	15	TEL FL-1	1st. FLOOR	24/04/2025	N/A	Pass
1	16	TEL ST1	STAIR 1	23/04/2025	N/A	Pass
1	17	TEL ST2	STAIR 2	23/04/2025	N/A	Pass
1	18	TEL ST3	STAIR 3	23/04/2025	N/A	Pass
1	19	TEL ST4	STAIR 4	07/09/2021	N/A	Pass
1	20	TEL FIRE MAN LIFT	FML	07/09/2021	N/A	Pass
1	21	AUTO DOOR 1	1st. FLOOR	16/12/2024	N/A	Pass
1	22	AUTO DOOR 2	1st. FLOOR	16/12/2024	N/A	Pass
1	23	AUTO DOOR 3	1st. FLOOR	16/12/2024	N/A	Pass
1	24	KEY FL-1	1st. FLOOR	14/12/2021	N/A	Pass
1	25	FLOW SWITCH	1st. FLOOR	31/07/2021	N/A	Pass
1	26	SUPERVISORY	1st. FLOOR	13/06/2024	N/A	Pass
1	27	KEY FML	1st. FLOOR	07/09/2021	N/A	Pass
1	28	GAS	1st. FLOOR	07/02/2022	N/A	Pass
1	31	MDZ1-31	1st. FLOOR	21/04/2025	N/A	Pass
1	32	MDZ1-32	1st. FLOOR	21/04/2025	N/A	Pass
1	33	MDZ1-33	1st. FLOOR	21/04/2025	N/A	Pass
1	34	MDZ1-34	1st. FLOOR	21/04/2025	N/A	Pass
1	35	MDZ1-35	1st. FLOOR	21/04/2025	N/A	Pass
1	36	MDZ1-36	1st. FLOOR	21/04/2025	N/A	Pass
1	37	MDZ1-37	1st. FLOOR	22/04/2025	N/A	Pass
1	38	MDZ1-38	1st. FLOOR	22/04/2025	N/A	Pass
1	39	MDZ1-39	1st. FLOOR	22/04/2025	N/A	Pass
1	155	Power Monitr	Module L01M155	27/03/2025	N/A	Pass
1	156	Power Monitr	Module L01M156	16/04/2025	N/A	Pass
1	157	Power Monitr	Module L01M157	27/03/2025	N/A	Pass
1	158	Power Monitr	Module L01M158	30/04/2025	N/A	Pass
1	159	Power Monitr	Module L01M159	27/03/2025	N/A	Pass
2	1	STZ 1 FL-2	2nd. FLOOR	16/12/2024	N/A	Pass
2	2	STZ 2 FL-2	2nd. FLOOR	16/12/2024	N/A	Pass
2	3	SPZ 3 FL-2	2nd. FLOOR	16/12/2024	N/A	Pass
2	4	TEL FL-2	2nd. FLOOR	12/10/2021	N/A	Pass
2	5	LINEN	2nd. FLOOR	16/12/2024	N/A	Pass
2	6	RELAY	2nd. FLOOR	16/12/2024	N/A	Pass
2	7	GAS	2nd. FLOOR	16/12/2024	N/A	Pass
2	8	CO2.1	2nd. FLOOR	16/12/2024	N/A	Pass
2	9	CO2.2	2nd. FLOOR	16/12/2024	N/A	Pass
Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us						
This Report is compliant with NFPA-72 2007 Edition.						

Device Maintenance Reports						
Node Address: 1: (NFS2-3030) Panel Version: 27						
03 May 2025 14:24:14 Active Protection Normal Alarm: 3-5-58						
SIC Loop	DeviceAddress	TypeCode Label	ExtendedLabel	Functional Maintenance Date	Battery Life	Trouble Status
2	10	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	11	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	12	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	13	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	14	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	15	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	16	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	17	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	18	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	19	Relay	2nd. FLOOR	16/12/2024	N/A	Pass
2	20	Monitor	2nd. FLOOR	07/09/2021	N/A	Pass
2	21	Monitor	2nd. FLOOR	29/01/2022	N/A	Pass
2	22	Track Superv	2nd. FLOOR	29/01/2022	N/A	Pass
2	23	Monitor	2nd. FLOOR	Untested	N/A	Pass
2	24	Monitor	2nd. FLOOR	Untested	N/A	Pass
2	25	Monitor	2nd. FLOOR	Untested	N/A	Pass
2	31	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	32	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	33	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	34	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	35	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	36	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	37	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	38	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	39	Pull Station	3rd. FLOOR	30/04/2025	N/A	Pass
2	40	Pull Station	FML	22/04/2025	N/A	Pass
2	41	Pull Station	2nd. FLOOR	23/04/2025	N/A	Pass
2	42	Pull Station	FML	30/04/2025	N/A	Pass
2	43	Pull Station	FML	30/04/2025	N/A	Pass
2	44	Pull Station	FML	30/04/2025	N/A	Pass
2	45	Pull Station	FML	30/04/2025	N/A	Pass
2	46	Pull Station	FML	30/04/2025	N/A	Pass
2	47	Pull Station	FML	29/04/2025	N/A	Pass
2	48	Pull Station	FML	29/04/2025	N/A	Pass
2	49	Pull Station	FML	28/04/2025	N/A	Pass
2	50	Pull Station	FML	29/04/2025	N/A	Pass
3	1	Strobe Ckt	3rd. FLOOR	16/12/2024	N/A	Pass
3	2	Speaker	3rd. FLOOR	16/12/2024	N/A	Pass
3	3	Telephone	3rd. FLOOR	07/09/2021	N/A	Pass
3	4	Relay	3rd. FLOOR	16/12/2024	N/A	Pass
3	5	Relay	3rd. FLOOR	16/12/2024	N/A	Pass
3	6	Relay	3rd. FLOOR	16/12/2024	N/A	Pass
3	7	Relay	3rd. FLOOR	16/12/2024	N/A	Pass
3	8	Relay	3rd. FLOOR	16/12/2024	N/A	Pass
3	9	Relay	3rd. FLOOR	16/12/2024	N/A	Pass
Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us						
This Report is compliant with NFPA-72 2007 Edition.						

Device Maintenance Reports						
Node Address: 11 (NFS2-3030) Panel Version: 27						
03 May 2025 14:24:14 Active Protection Normal Alarm: 3-5-68						
SIC Loop	DeviceAddress	TypeCode Label	ExtendedLabel	Functional Maintenance Date	Battery Life	Trouble Status
3	10	Relay	EXHAUST FAN 6	16/12/2024	N/A	Pass
3	11	Monitor	KEY FL.3	07/09/2021	N/A	Pass
3	12	Monitor	FLOW SWITCH	26/12/2024	N/A	Pass
3	13	Track Superv	SUPERVISORY	26/12/2024	N/A	Pass
3	14	Strobe Ckt	STZ FL.4	16/12/2024	N/A	Pass
3	15	Speaker	SPZ FL.4	16/12/2024	N/A	Pass
3	16	Telephone	TEL FL.4	22/06/2022	N/A	Pass
3	17	Relay	LINEN	16/12/2024	N/A	Pass
3	18	Monitor	KEY FL.4	07/09/2021	N/A	Pass
3	19	Monitor	FLOW SWITCH	31/07/2021	N/A	Pass
3	20	Track Superv	SUPERVISORY	25/03/2023	N/A	Pass
3	21	Strobe Ckt	STZ FL.5	20/04/2025	N/A	Pass
3	22	Speaker	SPZ FL.5	20/04/2025	N/A	Pass
3	23	Telephone	TEL FL.5	05/01/2025	N/A	Pass
3	24	Relay	LINEN	16/12/2024	N/A	Pass
3	25	Monitor	KEY FL.5	07/09/2021	N/A	Pass
3	26	Monitor	FLOW SWITCH	26/12/2024	N/A	Pass
3	27	Track Superv	SUPERVISORY	26/12/2024	N/A	Pass
3	31	Pull Station	MDZ3-31	30/04/2025	N/A	Pass
3	32	Pull Station	MDZ3-32	30/04/2025	N/A	Pass
3	33	Pull Station	MDZ4-33	30/04/2025	N/A	Pass
3	34	Pull Station	MDZ4-34	30/04/2025	N/A	Pass
3	35	Pull Station	MDZ5-35	30/04/2025	N/A	Pass
3	36	Pull Station	MDZ5-36	30/04/2025	N/A	Pass
4	1	Strobe Ckt	STZ FL.6	20/04/2025	N/A	Pass
4	2	Speaker	SPZ FL.6	20/04/2025	N/A	Pass
4	3	Telephone	TEL FL.6	11/04/2024	N/A	Pass
4	4	Relay	LINEN	16/12/2024	N/A	Pass
4	5	Monitor	KEY FL.6	07/09/2021	N/A	Pass
4	6	Monitor	FLOW SWITCH	20/04/2025	N/A	Pass
4	7	Track Superv	SUPERVISORY	20/04/2025	N/A	Pass
4	8	Strobe Ckt	STZ FL.7	20/04/2025	N/A	Pass
4	9	Speaker	SPZ FL.7	20/04/2025	N/A	Pass
4	10	Telephone	TEL FL.7	20/07/2025	N/A	Pass
4	11	Relay	LINEN	16/12/2024	N/A	Pass
4	12	Monitor	KEY FL.7	07/09/2021	N/A	Pass
4	13	Monitor	FLOW SWITCH	02/08/2021	N/A	Pass
4	14	Track Superv	SUPERVISORY	30/09/2023	N/A	Pass
4	15	Strobe Ckt	STZ FL.8	16/12/2024	N/A	Pass
4	16	Speaker	SPZ FL.8	16/12/2024	N/A	Pass
4	17	Telephone	TEL FL.8	17/05/2024	N/A	Pass
4	18	Relay	LINEN	16/12/2024	N/A	Pass
4	19	Monitor	KEY FL.8	07/09/2021	N/A	Pass
4	20	Monitor	FLOW SWITCH	02/08/2021	N/A	Pass
4	21	Track Superv	SUPERVISORY	11/09/2023	N/A	Pass
Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us						
This Report is compliant with NFPA-72 2007 Edition.						

Device Maintenance Reports						
Node Address: 11 (NFS2-3030) Panel Version: 27						
03 May 2025 14:24:14 Active Protection Normal Alarm: 3-5-68						
SIC Loop	DeviceAddress	TypeCode Label	Custom Label	ExtendedLabel	Functional Maintenance Date	Battery Life
4	31	Pull Station	MDZ6-31	6th. FLOOR	30/04/2025	N/A
4	32	Pull Station	MDZ6-32	6th. FLOOR	30/04/2025	N/A
4	33	Pull Station	MDZ7-33	7th. FLOOR	30/04/2025	N/A
4	34	Pull Station	MDZ7-34	7th. FLOOR	30/04/2025	N/A
4	35	Pull Station	MDZ8-35	8th. FLOOR	29/04/2025	N/A
4	36	Pull Station	MDZ8-36	8th. FLOOR	29/04/2025	N/A
5	1	Strobe Ckt	STZ FL.9	9th. FLOOR	16/12/2024	N/A
5	2	Speaker	SPZ FL.9	9th. FLOOR	16/12/2024	N/A
5	3	Telephone	TEL FL.9	9th. FLOOR	12/03/2023	N/A
5	4	Relay	LINEN	9th. FLOOR	16/12/2024	N/A
5	5	Monitor	KEY FL.9	9th. FLOOR	07/09/2021	N/A
5	6	Monitor	FLOW SWITCH	9th. FLOOR	26/12/2024	N/A
5	7	Track Superv	SUPERVISORY	9th. FLOOR	30/01/2025	N/A
5	8	Strobe Ckt	STZ FL.10	10th. FLOOR	16/12/2024	N/A
5	9	Speaker	SPZ FL.10	10th. FLOOR	16/12/2024	N/A
5	10	Telephone	TEL FL.10	10th. FLOOR	07/09/2021	N/A
5	11	Relay	LINEN	10th. FLOOR	16/12/2024	N/A
5	12	Monitor	KEY FL.10	10th. FLOOR	07/09/2021	N/A
5	13	Monitor	FLOW SWITCH	10th. FLOOR	31/07/2021	N/A
5	14	Track Superv	SUPERVISORY	10th. FLOOR	23/09/2023	N/A
5	15	Strobe Ckt	STZ FL.11	11th. FLOOR	16/12/2024	N/A
5	16	Speaker	SPZ FL.11	11th. FLOOR	16/12/2024	N/A
5	17	Telephone	TEL FL.11	11th. FLOOR	07/09/2021	N/A
5	18	Relay	LINEN	11th. FLOOR	16/12/2024	N/A
5	19	Relay	EXHAUST FAN 1	11th. FLOOR	16/12/2024	N/A
5	20	Relay	LIFT 1	11th. FLOOR	16/12/2024	N/A
5	21	Relay	LIFT 2	11th. FLOOR	16/12/2024	N/A
5	22	Relay	LIFT 3	11th. FLOOR	16/12/2024	N/A
5	23	Relay	LIFT 4	11th. FLOOR	16/12/2024	N/A
5	24	Relay	LIFT 5	11th. FLOOR	16/12/2024	N/A
5	25	Monitor	KEY FL.11	11th. FLOOR	Untested	N/A
5	26	Monitor	FLOW SWITCH	11th. FLOOR	31/07/2021	N/A
5	27	Track Superv	SUPERVISORY	11th. FLOOR	10/05/2023	N/A
5	28	Strobe Ckt	STZ FL.ROOF	ROOF FLOOR	16/12/2024	N/A
5	29	Speaker	SPZ FL.ROOF	ROOF FLOOR	16/12/2024	N/A
5	30	Telephone	TEL FL.ROOF	ROOF FLOOR	26/07/2021	N/A
5	31	Monitor	KEY FL.ROOF	ROOF FLOOR	Untested	N/A
5	32	Monitor	FLOW SWITCH	ROOF FLOOR	24/04/2022	N/A
5	33	Track Superv	SUPERVISORY	ROOF FLOOR	24/04/2022	N/A
5	41	Pull Station	MDZ9-41	9th. FLOOR	29/04/2025	N/A
5	42	Pull Station	MDZ9-42	9th. FLOOR	29/04/2025	N/A
5	43	Pull Station	MDZ10-43	10th. FLOOR	29/04/2025	N/A
5	44	Pull Station	MDZ10-44	10th. FLOOR	29/04/2025	N/A
5	45	Pull Station	MDZ11-45	11th. FLOOR	Untested	N/A
5	46	Pull Station	MDZ11-46	11th. FLOOR	29/04/2025	N/A
Notifier, Inc.https://www.securityandfire.honeywell.com/notifier/en-us						
This Report is compliant with NFPA-72 2007 Edition.						

Device Maintenance Reports						
Node Address: 1; (NFS2-3030)		03 May 2025 14:24:14 Active Period: No Trouble Reported 3.5.68				
SLC Loop	Device Address	Type Code Label	Custom Label	Extended Label	Functional Maintenance Date	Battery Life Trouble Status
5	47	Pull Station	MDZR-47	ROOF FLOOR	29/04/2025	N/A
5	48	Pull Station	MDZR-48	ROOF FLOOR	29/04/2025	N/A
						Pass
						Pass
Notifier, Inc. <a href="https://www.securityandfire.honeywell.com/notifier/en-us">https://www.securityandfire.honeywell.com/notifier/en-us</a>						
This Report is compliant with NFPA-72 2007 Edition.						

ภาคผนวก 2.5

เอกสารประชาสัมพันธ์ให้ความรู้การคัดแยกมูลฝอย

วิธีการ 3 ใช้ ( 3R ) เพื่อจัดการขยะ

## Recycle : R ที่สาม

### แปรรูปใช้ใหม่

เป็นการนำวัสดุที่สามารถนำกลับมาใช้ใหม่ได้ เช่น แก้ว อะลูมิเนียม เหล็ก พลาสติก นำมาแปรรูปและผลิตภัณฑ์ต่างๆ

### ตัวอย่าง RECQLE เช่น

1. การนำกล่องเครื่องดื่มยูเอชทีมาใช้ทำหลังคา



2. นำกระดาษใช้แล้วแปรรูปเป็นเยื่อกระดาษเพื่อทำเป็นส่วนผสมในการผลิตเป็นกระดาษใหม่



3. นำเศษแก้วเก่ามาหลอมเพื่อขึ้นรูปเป็นแก้วใบใหม่



4. การหลอมขวด PET เป็นเม็ดพลาสติกที่เป็นเส้นใยนำมาผลิตเป็นพรม เสื่อ



# NOVOTEL

BANGKOK FUTURE PARK RANGSIT

## ขยะมูลฝอยและการจัดการ



### ความหมายของ "ขยะ"

1. ขยะย่อยสลาย หรือ มูลฝอยย่อยสลาย

คือขยะที่เน่าเสียและย่อยสลายได้เร็ว นำมาหมักทำปุ๋ยได้ เช่น เศษผัก เปลือกผลไม้ เศษอาหาร ใบไม้ เศษเนื้อสัตว์ เป็นต้น

2. ขยะรีไซเคิล หรือ มูลฝอยที่ใช้ได้

คือ ของเสียบรรจุภัณฑ์ หรือวัสดุเหลือใช้ ซึ่งนำกลับมาใช้ประโยชน์ได้ เช่น กระดาษแก้ว

3. ขยะทั่วไป หรือ มูลฝอยทั่วไป

คือ ขยะประเภทอื่นนอกเหนือจากขยะย่อยสลาย ขยะรีไซเคิลและขยะอันตราย มีลักษณะที่ย่อยสลายยากและไม่คุ้มค่า



วิธีการ 3 ใช้ ( 3R ) เพื่อจัดการขยะ

## Recycle : R แรก

### ใช้น้อย

สามารถทำได้ง่ายๆ โดยใช้ทรัพยากรที่มีอยู่อย่างพอเพียงใช้เท่าที่จำเป็นใช้ผลิตภัณฑ์ให้เหมาะสมกับงานและเป็นมิตรต่อสิ่งแวดล้อมง่ายต่อการกำจัดไม่ใช้อย่างฟุ่มเฟือย

### ตัวอย่าง RECQLE เช่น

1. ใช้กระดาษหรือถุงผ้าแทนการใช้ถุงพลาสติกซึ่งใช้เวลา 450 ปีในการย่อยสลาย

2. ใช้แก้ว ส่วนตัวแทนการใช้แก้วพลาสติกหรือแก้วที่ใช้ครั้งเดียวทิ้ง

3. ใช้กล่องใส่อาหารแทนการใช้กล่องโฟมย่อยสลายยาก



วิธีการ 3 ใช้ ( 3R ) เพื่อจัดการขยะ

## Recycle : R ที่สอง

### ใช้ซ้ำ

เป็นการนำสิ่งต่างๆ ที่ใช้งานไปแล้วนำกลับมาใช้อีก ลดการใช้ทรัพยากรรวมทั้งลดปริมาณขยะมูลฝอยอีกด้วย

### ตัวอย่าง RECQLE เช่น

1. ทำสิ่งประดิษฐ์จากวัสดุเหลือใช้



2. ใช้กระดาษสองหน้าช่วยชีวิตต้นไม้

3. ใช้ถ่านไฟฉายแบบชาร์จใหม่ได้ (RECHARGEABLE BATTERY)

4. บริจาคสิ่งของ เสื้อผ้า ให้กับผู้ที่มีความจำเป็น

5. ขายสินค้ามือสอง เช่น หนังสือ เสื้อผ้า รองเท้า เป็นการเพิ่มรายได้แล้วยังลดปริมาณขยะ



ภาคผนวก 2.6  
หลักฐานการจัดการสรว่ายน้ำโครงการ

ภาคผนวก 2.6.1

หลักฐานการจัดตั้งเจ้าหน้าที่ดูแลระวายน้

## BANGKOK FUTURE PARK RANGSIT

## BANGKOK FUTURE PARK RANGSIT

## Working Roster

BANGKOK FUTURE PARK RANGSIT

PH = Public Hot Shift Code >>>>>	51= 05:00-15:30	59= 09:00-19:00	67= 13:00-23:00	75= 17:00-03:00	83= 21:00-07:00	91= 01:00-11:00
VC = Vacation	52= 05:00-15:30	60= 09:00-19:30	68= 13:00-23:30	76= 17:30-03:30	84= 21:30-07:30	92= 01:30-11:30
WO = Without Pay	53= 06:00-16:00	61= 10:00-20:00	69= 14:00-24:00	77= 18:00-04:00	85= 22:00-08:00	93= 02:00-12:00
CD = Change Day Off	54= 06:00-16:30	62= 10:30-20:30	70= 14:30-24:30	78= 18:30-04:30	86= 22:30-08:30	94= 02:30-12:30
OT = Over Time	55= 07:00-17:00	63= 11:00-21:00	71= 15:00-01:00	79= 19:00-05:00	87= 23:00-09:00	95= 03:00-13:00
MAT = Maternity	56= 07:30-17:30	64= 11:30-21:30	72= 15:30-01:30	80= 19:30-05:30	88= 23:30-09:30	96= 03:30-13:30
DF = Day Off	57= 08:00-18:00	65= 12:00-22:00	73= 16:00-02:00	81= 20:00-06:00	89= 24:00-10:00	97= 04:00-14:00
T = Training	58= 08:30-18:30	66= 12:30-22:30	74= 16:30-02:30	82= 20:30-06:30	90= 24:30-10:30	98= 04:30-14:30

Prepared by :..... Wattana J. ....  
(.....)

Approved by :.....Wattana J.....  
Department Head/Date

Approved by : .....  
Talent & Culture Department/Date

## Working Roster

BANGKOK FUTURE PARK RANGSIT

PH = Public Hot Shift Code >>>>>>	51- 05:00-15:00	59- 09:00-19:00	67- 13:00-23:00	75- 17:00-03:00	83- 21:00-07:00	91- 01:00-11:00
CA = Vacation	52- 05:30-15:30	60- 09:30-19:30	68- 13:30-23:30	76- 17:30-03:30	84- 21:30-07:30	92- 01:30-11:30
WO = Without Pay	53- 06:00-16:00	61- 10:00-20:00	69- 14:00-24:00	77- 18:00-04:00	85- 22:00-08:00	93- 02:00-12:00
CDO = Change Day Off	54- 06:30-16:30	62- 10:30-20:30	70- 14:30-24:30	78- 18:30-04:30	86- 22:30-08:30	94- 02:30-12:30
OT = Over Time	55- 07:00-17:00	63- 11:00-21:00	71- 15:00-01:00	79- 19:00-05:00	87- 23:00-09:00	95- 03:00-13:00
MAT = Maternity	56- 07:30-17:30	64- 11:30-21:30	72- 15:30-01:30	80- 19:30-05:30	88- 23:30-09:30	96- 03:30-13:30
T = Day Off	57- 08:00-18:00	65- 12:00-22:00	73- 16:00-02:00	81- 20:00-06:00	89- 24:00-10:00	97- 04:00-14:00
T = Training	58- 08:30-18:30	66- 12:30-22:30	74- 16:30-02:30	82- 20:30-06:30	90- 24:30-10:30	98- 04:30-14:30

Prepared by :..... Wattana J. ....

Approved by :.....Wattana I .....

Approved by : .....

## Working Roster

BANGKOK FUTURE PARK RANGSIT

PH = Public Hot Shift Code >>>>>	51= 05:00-15:30	59= 09:00-19:00	67= 13:00-23:00	75= 17:00-03:00	83= 21:00-07:00	91= 01:00-11:00
VC = Vacation	52= 05:00-15:30	60= 09:00-19:30	68= 13:00-23:30	76= 17:30-03:30	84= 21:30-07:30	92= 01:30-11:30
WO = Without Pay	53= 06:00-16:00	61= 10:00-20:00	69= 14:00-24:00	77= 18:00-04:00	85= 22:00-08:00	93= 02:00-12:00
CD = Change Day Off	54= 06:00-16:30	62= 10:30-20:30	70= 14:30-24:30	78= 18:30-04:30	86= 22:30-08:30	94= 02:30-12:30
OT = Over Time	55= 07:00-17:00	63= 11:00-21:00	71= 15:00-01:00	79= 19:00-05:00	87= 23:00-09:00	95= 03:00-13:00
MAT = Maternity	56= 07:30-17:30	64= 11:30-21:30	72= 15:30-01:30	80= 19:30-05:30	88= 23:30-09:30	96= 03:30-13:30
DF = Day Off	57= 08:00-18:00	65= 12:00-22:00	73= 16:00-02:00	81= 20:00-06:00	89= 24:00-10:00	97= 04:00-14:00
T = Training	58= 08:30-18:30	66= 12:30-22:30	74= 16:30-02:30	82= 20:30-06:30	90= 24:30-10:30	98= 04:30-14:30

Approved by : .....  
Talent & Culture Department/Date

## Working Roster

BANGKOK FUTURE PARK RANGSIT

PH = Public Hot Shift Code >>>>>>	51= 05:00-15:30	59= 09:00-19:00	67= 13:00-23:30	75= 17:00-03:00	83= 21:00-07:30	91= 01:00-11:00
VC = Vacation	52= 05:00-15:30	60= 09:30-19:30	68= 13:30-23:30	76= 17:30-03:30	84= 21:30-07:30	92= 01:30-11:30
WO = Without Pay	53= 06:00-16:00	61= 10:00-20:00	69= 14:00-24:00	77= 18:00-04:00	85= 22:00-08:00	93= 02:00-12:00
CDO = Change Day Off	54= 06:30-16:30	62= 10:30-20:30	70= 14:30-24:30	78= 18:30-04:30	86= 22:30-08:30	94= 02:30-12:30
OT = Over Time	55= 07:00-17:00	63= 11:00-21:00	71= 15:00-01:00	79= 19:00-05:00	87= 23:00-09:00	95= 03:00-13:00
MAT = Maternity	56= 07:30-17:30	64= 11:30-21:30	72= 15:30-01:30	80= 19:30-05:30	88= 23:30-09:30	96= 03:30-13:30
DF = Day Off	57= 08:00-18:00	65= 12:00-22:00	73= 16:00-02:00	81= 20:00-06:00	89= 24:00-10:00	97= 04:00-14:00
T = Training	58= 08:30-18:30	66= 12:30-22:30	74= 16:30-02:30	82= 20:30-06:30	90= 24:30-10:30	98= 04:30-14:30

Approved by : .....  
Talent & Culture Department/Date

ภาคผนวก 2.6.2

บันทึกการตรวจสอบระบบกรองสระว่ายน้ำ

SWIMMING POOL LOG SHEET : DAILY

Date 31/1/68

Description		Morning 9:30	Afternoon 2:00	Night 03:40
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	-
	No.2	10	-	10
	No.3	10	-	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	9.5	9.2	9.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	on	-
		No.2	-	off
		No.3	-	on
	Volume System Control [Display 0-100 ]	No.1	-	off
		No.2	22	19
		No.3	35	33
Surge Tank	Water Level [ High , Medium , Low ]	High	H1	medium
Operation By				

Remark ...

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 30/1/25

Description		Morning 9:00	Afternoon 2:00	Night 03:00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	10
	No.2	-	-	10
	No.3	-	-	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	9.2	9.2	9.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	off
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100 ]	No.1	-	off
		No.2	-	22
		No.3	-	35
Surge Tank	Water Level [ High , Medium , Low ]	High	H1	medium
Operation By				

Remark ...

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 09/11/25

Description		Morning <u>09:30</u>	Afternoon <u>15:00</u>	Night <u>21:00</u>
Pump Operating	Status [ Run , Off ]	No.1	-	-
		No.2	-	On
		No.3	-	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	40	40
		No.2	40	40
		No.3	40	40
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.2	7.2	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	OFF
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	92	94
		No.3	86	95
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	Medium
Operation By		[Signature]		

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 09/11/25

Description		Morning <u>09:30</u>	Afternoon <u>15:00</u>	Night <u>21:00</u>
Pump Operating	Status [ Run , Off ]	No.1	-	-
		No.2	-	On
		No.3	On	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	40	40
		No.2	40	40
		No.3	40	40
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.2	7.2	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	OFF
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	92	94
		No.3	86	95
Surge Tank	Water Level [ High , Medium , Low ]	[Signature]	[Signature]	[Signature]
Operation By		[Signature]		

Remark .....

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 29/11/68

Description		Morning <u>9:30</u>	Afternoon <u>14:30</u>	Night <u>01:30</u>
Pump Operating	Status [ Run, Off ]	No.1	-	-
		No.2	-	-
		No.3	on	ON
				on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	10	10
		No.2	10	10
		No.3	10	10
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	
	PH	7.5	7.6	
Chemical Additional ( kg )	Chlorine	-	-	
	Soda Ash	-	-	
	Sodium Bi-Sulphate Acid	-	-	
	Salt	-	-	
	Aluminium Sulphate	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	on	OFF
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	20	21
		No.3	85	85
Surge Tank	Water Level [ High, Medium, Low ]	High	Mid	medium
Operation By				

Remark .....

Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 25/1/69

Description		Morning <u>9:30</u>	Afternoon <u>14:00</u>	Night <u>01:00</u>
Pump Operating	Status [ Run, Off ]	No.1	-	-
		No.2	-	on
		No.3	on	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	10	10
		No.2	10	10
		No.3	10	10
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	
	PH	7.5	7.5	
Chemical Additional ( kg )	Chlorine	-	-	
	Soda Ash	-	-	
	Sodium Bi-Sulphate Acid	-	-	
	Salt	-	-	
	Aluminium Sulphate	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	on	on
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	21
		No.2	20	25
		No.3	85	85
Surge Tank	Water Level [ High, Medium, Low ]	High	Mid	Mid
Operation By				

Remark .....

Recheck By ..... Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 25/1/69

Description		Morning 09.00	Afternoon 18.00	Evening 09.00
Pump Operating	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	ON	-
	Status [Run, Off]			
Sand Filter System Pressure	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
	Pressure Gauge Out [Psi]			
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Pump			
Back Wash (10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
	Chlorine			
	Soda Ash			
Chemical Additional (kg)	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
	Status [On, Off]			
Salt Chlorinator	No.1	ON	ON	-
	No.2	-	-	-
	No.3	-	-	-
	Volume System Control [Display 0-100]			
Surge Tank	No.1	92	92	-
	No.2	95	85	-
	No.3	95	85	-
	Water Level [High, Medium, Low]			
Operation By				

Remarks

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 24/1/69

Description		Morning 09.30	Afternoon 18.00	Evening 09.00
Pump Operating	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	-	ON
	Status [Run, Off]			
Sand Filter System Pressure	No.1	10	-	10
	No.2	10	-	10
	No.3	10	-	10
	Pressure Gauge Out [Psi]			
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Pump			
Back Wash (10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.6
	Chlorine			
	Soda Ash			
Chemical Additional (kg)	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
	Status [On, Off]			
Salt Chlorinator	No.1	ON	-	OFF
	No.2	-	-	ON
	No.3	-	-	ON
	Volume System Control [Display 0-100]			
Surge Tank	No.1	99	-	92
	No.2	95	-	85
	No.3	95	-	85
	Water Level [High, Medium, Low]			
Operation By				

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 23/1/68

Description		Morning 9:30	Afternoon 11:00	Evening 6:30
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	On	-	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	10
	No.2	10	-	10
	No.3	10	-	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	Off
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100]	No.1	-	Off
		No.2	10	29
		No.3	95	95
Surge Tank	Water Level [ High , Medium , Low ]	High	Hi	medium
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 22/1/68

Description		Morning 9:30	Afternoon 11:00	Evening 6:30
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	NO	on	On
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	Off
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100]	No.1	-	Off
		No.2	20	19
		No.3	45	45
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	Medium
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 21/1/68

Description		Morning 09.00	Afternoon 14.00	Evening 18.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	on	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	4.5	7.5	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	100 kg. 50 kg.
Salt Chlorinator	Status [ On,Off ]	No.1	on	off
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100]	No.1	-	off
		No.2	13	99
		No.3	85	95
Surge Tank	Water Level [ High , Medium , Low ]	High	HP	medium
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 20/1/68

Description		Morning 09.00	Afternoon 14.00	Evening 18.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	on	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	4.5	7.5	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	on	off
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100]	No.1	-	off
		No.2	29	91
		No.3	46	85
Surge Tank	Water Level [ High , Medium , Low ]	High	HP	medium
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 19/1/69

Description		Morning 09.00	Afternoon 15.00	Night 04.00	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	on	-	
	No.3	on	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	6.5	7.5	7.5	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	on	on	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100]	No.1	-	-	-
		No.2	21	19	-
		No.3	85	85	-
Surge Tank	Water Level [ High , Medium , Low ]	H			
Operation By		[Signature]			

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 18/1/68

Description		Morning 09.00	Afternoon 15.00	Night 04.00	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	on	-	
	No.3	on	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	4.5	7.5	7.5	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	on	on	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100]	No.1	-	-	-
		No.2	19	99	-
		No.3	95	95	-
Surge Tank	Water Level [ High , Medium , Low ]	H			
Operation By		[Signature]			

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 14/11/68

Description		Morning 09:00	Afternoon 10:00	Night 11:10
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	10
	No.2	10	-	-
	No.3	10	-	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	on	off
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100]	No.1	-	off
		No.2	22	25
		No.3	25	25
Surge Tank	Water Level [ High , Medium , Low ]	High	HI	medium
Operation By				

Remark .....

Recheck By ..... Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 16/11/68

Description		Morning 09:00	Afternoon 11:00	Night 11:10
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	10
	No.2	10	-	-
	No.3	10	-	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	on	off
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	21	-
		No.3	25	-
Surge Tank	Water Level [ High , Medium , Low ]	High	HI	medium
Operation By				

Remark .....

Recheck By ..... Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 13/1/18

Description		Morning 09.00	Afternoon 14.00	Night 16.30	
Pump Operationing	Status [Run, Off]				
	No.1	1	1	1	
	No.2	1	ON	1	
	No.3	ON	1	ON	
Sand Filter System Pressure	Pressure Gauge Out [Psi]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Back Wash (10 min.)	Filter				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.5	7.5	7.5	
Chemical Additional (kg)	Chlorine	1	1	1	
	Soda Ash	1	1	1	
	Sodium Bi-Sulphate Acid	1	1	1	
	Salt	1	1	1	
	Aluminium Sulphate	1	1	1	
Salt Chlorinator	Status [On,Off]	No.1	ON	ON	OFF
		No.2	1	1	ON
		No.3	1	1	ON
	Volume System Control [Display 0-100]	No.1	1	1	OFF
		No.2	1	1	1.5
		No.3	1	1	1.5
Surge Tank	Water Level [High, Medium, Low]	High	High	medium	
Operation By					

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 14/1/18

Description		Morning 09.00	Afternoon 14.00	Night 16.30	
Pump Operationing	Status [Run, Off]				
	No.1	1	1	1	
	No.2	1	ON	1	
	No.3	ON	1	ON	
Sand Filter System Pressure	Pressure Gauge Out [Psi]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Back Wash (10 min.)	Filter				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.5	7.5	7.5	
Chemical Additional (kg)	Chlorine	1	1	1	
	Soda Ash	1	1	1	
	Sodium Bi-Sulphate Acid	1	1	1	
	Salt	1	1	1	
	Aluminium Sulphate	1	1	1	
Salt Chlorinator	Status [On,Off]	No.1	ON	ON	OFF
		No.2	1	1	ON
		No.3	1	1	ON
	Volume System Control [Display 0-100]	No.1	1	1	OFF
		No.2	1	1	1.5
		No.3	1	1	1.5
Surge Tank	Water Level [High, Medium, Low]	High	High	medium	
Operation By					

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date

10/11/69

Description		Morning 08.00	Afternoon 14.00	Night 06.00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	On	-	On	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.5	7.5	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	On	ON	OFF
		No.2	-	-	On
		No.3	-	-	On
	Volume System Control [Display 0-100 ]	No.1	18	18	19
		No.2	18	18	19
		No.3	18	18	19
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High	
Operation By					

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date

12/1/69

Description		Morning 08.00	Afternoon 14.00	Night 03.00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	ON	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.5	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	18	18	19
		No.2	18	18	19
		No.3	18	18	19
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High	
Operation By					

Remark

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 11/1/67

Description		Morning <u>08:00</u>	Afternoon <u>13:00</u>	Night <u>01:00</u>
Pump Operationing	Status [Run, Off]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	On	On	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	On	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	On	On
		No.2	89	100
		No.3	95	96
Surge Tank	Water Level [High, Medium, Low]	High	M	H
Operation By				

Recheck By [Signature] Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 10/1/68

Description		Morning <u>08:00</u>	Afternoon <u>13:00</u>	Night <u>01:00</u>
Pump Operationing	Status [Run, Off]			
	No.1	-	-	-
	No.2	-	On	-
	No.3	On	-	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	On	-
		No.2	-	-
		No.3	-	On
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	19	10
		No.3	95	95
Surge Tank	Water Level [High, Medium, Low]			H
Operation By				

Recheck By [Signature] Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 09/01/58

Description		Morning 08:00	Afternoon 11:00	Evening 06:00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	ON	-	on	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	-	10	
	No.2	-	-	-	
	No.3	10	-	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.1	7.6	
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	-	-	OFF
		No.2	ON	-	on
		No.3	ON	-	on
	Volume System Control [Display 0-100]	No.1	-	-	OFF
		No.2	15	-	25
		No.3	95	-	95
Surge Tank	Water Level [ High , Midium , Low ]	Mid	Hi	midium	
Operation By					

Remarks

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 9 / 1 / 2015

Description		Morning 08:00	Afternoon 12:00	Evening 07:00	
Pump Operationing	Status [ Run , Off ]				
	No.1	ON	-	-	
	No.2	-	-	on	
	No.3	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.5	7.6	
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	-	OFF
		No.2	-	-	on
		No.3	-	-	on
	Volume System Control [Display 0-100]	No.1	-	-	OFF
		No.2	25	25	19
		No.3	95	85	95
Surge Tank	Water Level [ High , Midium , Low ]			midium	
Operation By					

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 7/7/68

Description		Morning 08.00	Afternoon 12.00	Evening 06.00
Pump Operationing	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	-	-
	Status [ Run, Off ]			
Sand Filter System Pressure	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
	Pressure Gauge Out [ Psi ]			
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Pump			
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On, Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	75	95
		No.2	95	95
		No.3	95	95
Surge Tank	Water Level [ High, Medium, Low ]	H	H	H
Operation By				

Recheck By

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 6/7/68

Description		Morning 08.00	Afternoon 12.00	Evening 06.00
Pump Operationing	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	-	-
	Status [ Run, Off ]			
Sand Filter System Pressure	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
	Pressure Gauge Out [ Psi ]			
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Pump			
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On, Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	75	95
		No.2	95	95
		No.3	95	95
Surge Tank	Water Level [ High, Medium, Low ]	H	H	H
Operation By				

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 5/1/64

Description		Morning 09.00	Afternoon 15.00	Status [Run, Off]
Pump Operationing	No.1	-	-	-
	No.2	-	on	-
	No.3	on	-	on
Sand Filter System Pressure	No.1	10	10	10
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	75 kg
	Salt	-	-	-
	Aluminium Sulphate	-	on	off
Salt Chlorinator	Status [ On,Off ]	No.1	on	on
		No.2	-	on
		No.3	-	off
	Volume System Control [Display 0-100 ]	No.1	on	19
		No.2	2.2	45
		No.3	9.5	41
Surge Tank	Water Level [ High, Midium, Low ]	High	Low	Medium
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 4/1/85

Description		Morning 09.00	Afternoon 15.00	Status [Run, Off]
Pump Operationing	No.1	-	-	-
	No.2	-	on	-
	No.3	on	-	on
Sand Filter System Pressure	No.1	-	10	10
	No.2	-	-	-
	No.3	-	10	10
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	on	off
Salt Chlorinator	Status [ On,Off ]	No.1	-	on
		No.2	-	on
		No.3	40	on
	Volume System Control [Display 0-100 ]	No.1	-	off
		No.2	6.5	19
		No.3	8.5	46
Surge Tank	Water Level [ High, Midium, Low ]	High	Low	Medium
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 9/1/25

Description		Morning 7:00	Afternoon 16:30	Evening 05:00
Pump Operationing	No.1	-	On	-
	No.2	-	On	-
	No.3	-	On	-
Sand Filter System Pressure	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	Off	-
		No.2	On	-
		No.3	On	-
	Volume System Control [Display 0-100 ]	No.1	Off	-
		No.2	65	-
		No.3	85	41
Surge Tank	Water Level [ High , Midium , Low ]	[Redacted]		
Operation By		[Redacted]		

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 2/1/28

Description		Morning 09:00	Afternoon 16:30	Evening 03:00
Pump Operationing	No.1	-	On	-
	No.2	-	On	-
	No.3	On	-	-
Sand Filter System Pressure	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.6	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	-
		No.2	On	-
		No.3	On	-
	Volume System Control [Display 0-100 ]	No.1	Off	-
		No.2	74	65
		No.3	85	41
Surge Tank	Water Level [ High , Midium , Low ]	[Redacted]		
Operation By		[Redacted]		

Remark

Recheck By

Chief Engineer

Description		Morning 09.00	Afternoon 16.00	Night 03.00
Pump Operationing	Status [Run, Off]			
	No.1	1	-	-
	No.2	1	00	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	10	10	-
	No.2	1	-	-
Strainers Cleaning	Pump			
	No.1	1	-	-
	No.2	1	-	-
Back Wash (10 min.)	Filter			
	No.1	1	-	-
	No.2	1	-	-
Chlorine & PH Test Results (Test kit manual)	CL	7.5	7.5	7.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	73	73
		No.2	95	95
		No.3	45	41
Surge Tank	Water Level [High, Midium, Low]	Mid	Mid	Mid
Operation By				

Remark

Recheck By

Chief Engineer

Description		Morning 09.00	Afternoon 21.00	Night 06.40
Pump Operationing	Status [Run, Off]			
	No.1	1	-	-
	No.2	1	-	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	1	-	-
	No.2	1	-	-
Strainers Cleaning	Pump			
	No.1	1	-	-
	No.2	1	-	-
Back Wash (10 min.)	Filter			
	No.1	1	-	-
	No.2	1	-	-
Chlorine & PH Test Results (Test kit manual)	CL	7.5	7.5	7.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	OFF
		No.2	ON	ON
		No.3	ON	ON
	Volume System Control [Display 0-100]	No.1	72	72
		No.2	85	85
		No.3	45	45
Surge Tank	Water Level [High, Midium, Low]	Mid	Mid	Mid
Operation By				

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 22/2/68

Description		Morning <u>9.00</u>	Afternoon <u>13.00</u>	Night <u>06.00</u>
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	ON	-
	No.3	ON	-	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	10	10	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	90	OFF
		No.2	93	95
		No.3	93	95
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	midium
Operation By		[Signature]		

Remark .....  
 Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 26/2/25

Description		Morning <u>09.00</u>	Afternoon <u>13.00</u>	Night <u>01.00</u>
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	10	10
	No.2	10	10	10
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	40 mm
	No.2	-	-	40 mm
	No.3	-	-	40 mm
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.5	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	7.5 kg
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	-	OFF
		No.2	93	94
		No.3	95	95
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	midium
Operation By		[Signature]		

Remark .....  
 Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 29/2/68

Description		Morning <u>9:00</u>	Afternoon <u>17:00</u>	Night <u>02:00</u>	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	ON	-	ON	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.4	7.4	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	OFF
		No.2	-	-	ON
		No.3	-	-	ON
	Volume System Control [Display 0-100 ]	No.1	-	-	OFF
		No.2	70	20	23
		No.3	75	25	25
Surge Tank	Water Level [ High , Midium , Low ]	High	Hi	midium	
Operation By					

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 04/2/25

Description		Morning <u>08:00</u>	Afternoon <u>17:00</u>	Night <u>02:00</u>	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	ON	ON	-	
	No.3	-	-	ON	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	-	10	-	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.4	7.5	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	OFF
		No.2	-	-	ON
		No.3	-	-	ON
	Volume System Control [Display 0-100 ]	No.1	-	-	OFF
		No.2	20	20	23
		No.3	25	25	25
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	midium	
Operation By					

Rem

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 20/10/68

Description		Morning <u>09.00</u>	Afternoon <u>17.00</u>	Night <u>00.00</u>	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	On	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ # ]				
	No.1	10	10	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.9	7.5	1.5	
	PH	9.4	7.4	7.2	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	On	On	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	68	20	-
		No.2	95	95	-
		No.3	-	-	-
Surge Tank	Water Level [ High , Medium , Low ]	High	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 22/10/68

Description		Morning <u>09.00</u>	Afternoon <u>17.00</u>	Night <u>00.00</u>	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	On	ON	-	
	No.3	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	-	-	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.2	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	On	ON	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-	-
		No.2	91	20	-
		No.3	90	95	-
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 21/2/25

Description		Morning <u>09.00</u>	Afternoon <u>11.00</u>	Night <u>01.00</u>	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	On	-	On	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	-	-	
	No.2	10	-	-	
	No.3	10	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.4	7.4	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	35 kg	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	On	-	OFF
		No.2	-	-	On
		No.3	-	-	On
	Volume System Control [Display 0-100 ]	No.1	-	-	OFF
		No.2	18	-	33
		No.3	85	-	93
Surge Tank	Water Level [ High , Midium , Low ]	High	H1	midium	
Operation By					

Remark .....  
 Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 20/2/25

Description		Morning <u>09.00</u>	Afternoon <u>01.00</u>	Night <u>01.00</u>	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	On	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.4	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	-	-	OFF
		No.2	-	-	19
		No.3	-	-	45
	Volume System Control [Display 0-100 ]	No.1	-	-	OFF
		No.2	-	-	On
		No.3	-	-	On
Surge Tank	Water Level [ High , Midium , Low ]	H1	H1	midium	
Operation By					

Remark .....  
 Recheck By ..... Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 19/1/68

Description		Morning 9.00	Afternoon 19.00	Night 02.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	ON	ON	ON
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	19	19
		No.3	83	83
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High
Operation By				

Remark ..

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 18/02/68

Description		Morning 9.00	Afternoon 19.00	Night 02.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	ON	-
	No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.4	7.4	7.4
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	18	19
		No.3	89	85
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High
Operation By				

Remark ..

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 17/2/68

Description		Morning 9:30	Afternoon 14:00	Night 03:00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	ON	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.9	1.5	1.5	
	PH	7.4	7.5	7.4	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	14	27	-
		No.2	95	95	-
		No.3	95	95	-
Surge Tank	Water Level [ High , Midium , Low ]	Midium	Hi	Hi	
Operation By					

Remark ๑๓ ๕๕-๐๗/๐๓/๖๘ ๑๗๐๑๔๕๑๗๐ , ๑๗๐๑๔๕๑๗๐ ๑๗๐๑๔๕๑๗๐ ๑๗๐๑๔๕๑๗๐

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 18/2/68

Description		Morning 9:30	Afternoon 18:00	Night 03:00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	ON	ON	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	15	15	-	
	No.2	-	-	-	
	No.3	15	15	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.2	7.2	7.2	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	-
		No.2	ON	ON	-
		No.3	ON	ON	-
	Volume System Control [Display 0-100 ]	No.1	15	15	-
		No.2	95	95	-
		No.3	95	95	-
Surge Tank	Water Level [ High , Midium , Low ]	Midium	Hi	Hi	
Operation By					

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 15/2/64

Description		Morning 08.00	Afternoon 19.00	Night 00.00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	ON	NO	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	16	-	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	9.5	1.5	1.5	
	PH	7.6	7.6	7.2	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	-	NO	-
		No.2	ON	-	-
		No.3	ON	-	-
	Volume System Control [Display 0-100 ]	No.1	-	NO	-
		No.2	15	8.9	-
		No.3	85	8.3	-
Surge Tank	Water Level [ High , Medium , Low ]	Mid	Mid	HI	
Operation By					

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 16/02/64

Description		Morning 09.00	Afternoon 11.00	Night 03.00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	ON	NO	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	10	-	
	No.3	10	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.3	1.5	1.5	
	PH	7.4	7.6	7.2	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	NO	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-	-
		No.2	81	81	-
		No.3	80	87	-
Surge Tank	Water Level [ High , Medium , Low ]	Medium	Mid	HI	
Operation By					

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 13/2/69

Description		Morning 09:00	Afternoon 12:00	Night 06:00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	-	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	-
	No.2	-	-	10
	No.3	10	-	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	-	OFF
		No.2	-	21
		No.3	-	95
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Midium
Operation By		[Signature]		

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 13/2/69

Description		Morning 09:30	Afternoon 12:00	Night 06:00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	ON	-
	No.3	ON	-	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	-
	No.2	-	10	10
	No.3	10	-	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	-	OFF
		No.2	19	22
		No.3	95	45
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Midium
Operation By		[Signature]		

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 11/2/68

Description		Morning 9:10	Afternoon 13:30	Night 06:40	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	on	-	
	No.3	on	-	on	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	-	-	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	9.4	7.5	8.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	on	on	off
		No.2	-	-	on
		No.3	-	-	on
	Volume System Control [Display 0-100 ]	No.1	-	-	off
		No.2	92	91	19
		No.3	95	95	95
Surge Tank	Water Level [ High , Medium , Low ]	medium	high	medium	
Operation By					

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 10/2/25

Description		Morning 09:00	Afternoon 14:00	Night 06:40
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	on	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	19	-	-
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	9.4	7.5	8.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	on	off
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100 ]	No.1	-	off
		No.2	91	19
		No.3	95	95
Surge Tank	Water Level [ High , Medium , Low ]			
Operation By				

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 09/02/68

Description		Morning <u>07.10</u>	Afternoon <u>15.00</u>	Night <u>02.00</u>	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	ON	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	-	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	9.2	7.6	7.4	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-	-
		No.2	19	21	-
		No.3	85	26	-
Surge Tank	Water Level [ High , Medium , Low ]	High	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 09/12/68

Description		Morning <u>07.10</u>	Afternoon <u>15.00</u>	Night <u>02.00</u>	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	ON	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	-	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	9.2	7.6	7.4	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-	-
		No.2	22	20	-
		No.3	85	26	-
Surge Tank	Water Level [ High , Medium , Low ]	High	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 4/1/16

Description		Morning <u>07:30</u>	Afternoon <u>10:00</u>	Night <u>06:00</u>	
Pump Operationing	Status [Run, Off]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	On	-	On	
Sand Filter System Pressure	Pressure Gauge Out [Psi]				
	No.1	10	-	-	
	No.2	10	-	-	
	No.3	10	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.2	7.2	7.6	
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	Off	
Salt Chlorinator	Status [On,Off]	No.1	On	-	Off
		No.2	-	-	On
		No.3	-	-	On
	Volume System Control [Display 0-100]	No.1	-	-	Off
		No.2	10	-	47
		No.3	85	-	47
Surge Tank	Water Level [High, Midium, Low]	High	High	Midium	
Operation By					

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 6/2/15

Description		Morning <u>07:30</u>	Afternoon <u>10:00</u>	Night <u>06:00</u>	
Pump Operationing	Status [Run, Off]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	On	
Sand Filter System Pressure	Pressure Gauge Out [Psi]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.2	7.6	
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	Off	
Salt Chlorinator	Status [On,Off]	No.1	-	-	Off
		No.2	-	-	On
		No.3	-	-	On
	Volume System Control [Display 0-100]	No.1	-	-	Off
		No.2	-	-	14
		No.3	-	-	95
Surge Tank	Water Level [High, Midium, Low]	High	High	Midium	
Operation By					

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 5-2-68

Description		Morning 9.00	Afternoon 14.00	Night 01.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	on	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	-
	No.2	10	10	10
	No.3	16	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.0	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	on	on
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	49	49
		No.2	49	49
		No.3	49	49
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	medium
Operation By		[Signature]		

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 11/2/68

Description		Morning 9.00	Afternoon 14.00	Night 01.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	on	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	-
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.2	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	on	on
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	49	49
		No.2	49	49
		No.3	49	49
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	medium
Operation By		[Signature]		

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 9/12/69

Description		Morning <u>9:30</u>	Afternoon <u>15:00</u>	Night <u>06:00</u>	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	On	-	
	No.3	-	-	On	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	9.2	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	On	On	Off
		No.2	-	-	On
		No.3	-	-	On
	Volume System Control [Display 0-100 ]	No.1	-	-	Off
		No.2	19	21	23
		No.3	95	95	95
Surge Tank	Water Level [ High , Medium , Low ]	High	High	Medium	
Operation By					

Remark .....

Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 2/12/69

Description		Morning <u>09:30</u>	Afternoon <u>15:00</u>	Night <u>03:00</u>	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	On	-	
	No.3	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	9.5	7.6	7.2	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	On	On	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-	-
		No.2	21	98	-
		No.3	85	65	-
Surge Tank	Water Level [ High , Medium , Low ]	High	High	High	
Operation By					

Remark .....

Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 01/02/68

Description		Morning <u>07.00</u>	Afternoon <u>12.00</u>	Night <u>03.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	-	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.2
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	Ab	-
		No.2	-	-
		No.3	0.5	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	4.5	2.2
		No.3	8.2	2.2
Surge Tank	Water Level [ High , Midium , Low ]	[Redacted]		
Operation By		[Redacted]		

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 31/09/68

Description		Morning <u>08.00</u>	Afternoon <u>16.00</u>	Night <u>03.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High , Midium , Low ]	[Redacted]		
Operation By		[Redacted]		

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 10/2/25

Description		Morning 09:00	Afternoon 16:00	Night 01:00
Pump Operationing	Status [Run, Off]			-
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	NO	ON
Sand Filter System Pressure	Pressure Gauge Out [Psi]			-
	No.1	-	70	-
	No.2	10	10	10
	No.3	0	-	10
Strainers Cleaning	Pump			-
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			-
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	OFF
		No.2	ON	ON
		No.3	ON	ON
	Volume System Control [Display 0-100]	No.1	22 OFF	OFF
		No.2	22	25
		No.3	26	25
Surge Tank	Water Level [High, Medium, Low]	Mid	Mid	Mid
Operation By				

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 19/3/25

Description		Morning 09:00	Afternoon 12:00	Night 01:00
Pump Operationing	Status [Run, Off]			-
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	ON	ON
Sand Filter System Pressure	Pressure Gauge Out [Psi]			-
	No.1	-	-	-
	No.2	10	10	10
	No.3	0	10	10
Strainers Cleaning	Pump			-
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			-
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	OFF
		No.2	ON	ON
		No.3	OFF	ON
	Volume System Control [Display 0-100]	No.1	OFF	OFF
		No.2	22	24
		No.3	23	24
Surge Tank	Water Level [High, Medium, Low]	Mid	Mid	Mid
Operation By				

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 28/3/25

Description		Morning <u>09.00</u>	Afternoon <u>15.40</u>	Night <u>04.00</u>
Pump Operating	No.1	ON	ON	ON
	No.2	ON	ON	ON
	No.3	ON	ON	ON
	Status [ Run, Off ]			
Sand Filter System Pressure	No.1	10	10	10
	No.2	10	10	10
	No.3	10	10	10
	Pressure Gauge Out [ Psi ]			
Strainers Cleaning	No.1	—	—	—
	No.2	—	—	—
	No.3	—	—	—
	Pump			
Back Wash ( 10 min.)	No.1	—	—	—
	No.2	—	—	—
	No.3	—	—	—
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Addition (kg)	Chlorine	—	—	—
	Soda Ash	—	—	—
	Sodium Bi-Sulphate Acid	—	—	—
	Salt	—	—	—
	Aluminium Sulphate	—	—	—
Salt Chlorinator	Status [ On, Off ]	No.1	OFF	OFF
		No.2	ON	ON
		No.3	ON	ON
	Volume System Control [Display 0-100]	No.1	OFF	OFF
		No.2	92	92
		No.3	85	85
Surge Tank	Water Level [ High, Medium, Low ]	H		
Operation By				

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 27/3/25

Description		Morning <u>09.00</u>	Afternoon <u>17.00</u>	Night <u>03.00</u>
Pump Operating	No.1	ON	ON	ON
	No.2	ON	ON	ON
	No.3	ON	ON	ON
	Status [ Run, Off ]			
Sand Filter System Pressure	No.1	10	10	10
	No.2	10	10	10
	No.3	10	10	10
	Pressure Gauge Out [ Psi ]			
Strainers Cleaning	No.1	—	—	—
	No.2	—	—	—
	No.3	—	—	—
	Pump			
Back Wash ( 10 min.)	No.1	—	—	—
	No.2	—	—	—
	No.3	—	—	—
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Addition (kg)	Chlorine	—	—	—
	Soda Ash	—	—	—
	Sodium Bi-Sulphate Acid	—	—	—
	Salt	—	—	—
	Aluminium Sulphate	—	—	—
Salt Chlorinator	Status [ On, Off ]	No.1	OFF	OFF
		No.2	ON	ON
		No.3	ON	ON
	Volume System Control [Display 0-100]	No.1	OFF	OFF
		No.2	92	92
		No.3	85	85
Surge Tank	Water Level [ High, Medium, Low ]	H		
Operation By				

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 26/07/68

Description		Morning <u>08:00</u>	Afternoon <u>15:00</u>	Night <u>03:00</u>
Pump Operationing	No.1	-	-	-
	No.2	-	ON	-
	No.3	-	-	-
Sand Filter System Pressure	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	-
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	91	91
		No.2	96	96
		No.3	96	96
Surge Tank	Water Level [High, Midium, Low]	H	H	H
Operation By				

Remark .....

Rescheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 05/09/68

Description		Morning <u>08:00</u>	Afternoon <u>12:00</u>	Night <u>01:00</u>
Pump Operationing	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	-
Sand Filter System Pressure	No.1	10	10	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	-
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	91	91
		No.2	96	96
		No.3	96	96
Surge Tank	Water Level [High, Midium, Low]	H	H	H
Operation By				

Remark .....

Rescheck By ..... Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 20/03/18

Description		Morning 09.00	Afternoon 15.00	Night 03.00
Pump Operationing	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	Cleaning	Cleaning
	No.3	-	-	Cleaning
Back Wash ( 10 min.)	Filter			
	No.1	-	-	Back wash.
	No.2	-	Back wash.	Back wash.
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.4	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	-
		No.2	ON (Man)	-
		No.3	ON (Man)	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	25	25
		No.3	45	35
Surge Tank	Water Level [ High, Midium, Low ]	Hi	Hi	Hi
Operation By				

Remark 1. 20/18:45 1. 2. 3. 4. 5. 6. 7. 8. 9. 10. 11. 12. 13. 14. 15. 16. 17. 18. 19. 20. 21. 22. 23. 24. 25. 26. 27. 28. 29. 30. 31. 32. 33. 34. 35. 36. 37. 38. 39. 40. 41. 42. 43. 44. 45. 46. 47. 48. 49. 50. 51. 52. 53. 54. 55. 56. 57. 58. 59. 60. 61. 62. 63. 64. 65. 66. 67. 68. 69. 70. 71. 72. 73. 74. 75. 76. 77. 78. 79. 80. 81. 82. 83. 84. 85. 86. 87. 88. 89. 90. 91. 92. 93. 94. 95. 96. 97. 98. 99. 100. 101. 102. 103. 104. 105. 106. 107. 108. 109. 110. 111. 112. 113. 114. 115. 116. 117. 118. 119. 120. 121. 122. 123. 124. 125. 126. 127. 128. 129. 130. 131. 132. 133. 134. 135. 136. 137. 138. 139. 140. 141. 142. 143. 144. 145. 146. 147. 148. 149. 150. 151. 152. 153. 154. 155. 156. 157. 158. 159. 160. 161. 162. 163. 164. 165. 166. 167. 168. 169. 170. 171. 172. 173. 174. 175. 176. 177. 178. 179. 180. 181. 182. 183. 184. 185. 186. 187. 188. 189. 190. 191. 192. 193. 194. 195. 196. 197. 198. 199. 200. 201. 202. 203. 204. 205. 206. 207. 208. 209. 210. 211. 212. 213. 214. 215. 216. 217. 218. 219. 220. 221. 222. 223. 224. 225. 226. 227. 228. 229. 230. 231. 232. 233. 234. 235. 236. 237. 238. 239. 240. 241. 242. 243. 244. 245. 246. 247. 248. 249. 250. 251. 252. 253. 254. 255. 256. 257. 258. 259. 260. 261. 262. 263. 264. 265. 266. 267. 268. 269. 270. 271. 272. 273. 274. 275. 276. 277. 278. 279. 280. 281. 282. 283. 284. 285. 286. 287. 288. 289. 290. 291. 292. 293. 294. 295. 296. 297. 298. 299. 300. 301. 302. 303. 304. 305. 306. 307. 308. 309. 310. 311. 312. 313. 314. 315. 316. 317. 318. 319. 320. 321. 322. 323. 324. 325. 326. 327. 328. 329. 330. 331. 332. 333. 334. 335. 336. 337. 338. 339. 340. 341. 342. 343. 344. 345. 346. 347. 348. 349. 350. 351. 352. 353. 354. 355. 356. 357. 358. 359. 360. 361. 362. 363. 364. 365. 366. 367. 368. 369. 370. 371. 372. 373. 374. 375. 376. 377. 378. 379. 380. 381. 382. 383. 384. 385. 386. 387. 388. 389. 390. 391. 392. 393. 394. 395. 396. 397. 398. 399. 400. 401. 402. 403. 404. 405. 406. 407. 408. 409. 410. 411. 412. 413. 414. 415. 416. 417. 418. 419. 420. 421. 422. 423. 424. 425. 426. 427. 428. 429. 430. 431. 432. 433. 434. 435. 436. 437. 438. 439. 440. 441. 442. 443. 444. 445. 446. 447. 448. 449. 450. 451. 452. 453. 454. 455. 456. 457. 458. 459. 460. 461. 462. 463. 464. 465. 466. 467. 468. 469. 470. 471. 472. 473. 474. 475. 476. 477. 478. 479. 480. 481. 482. 483. 484. 485. 486. 487. 488. 489. 490. 491. 492. 493. 494. 495. 496. 497. 498. 499. 500. 501. 502. 503. 504. 505. 506. 507. 508. 509. 510. 511. 512. 513. 514. 515. 516. 517. 518. 519. 520. 521. 522. 523. 524. 525. 526. 527. 528. 529. 530. 531. 532. 533. 534. 535. 536. 537. 538. 539. 540. 541. 542. 543. 544. 545. 546. 547. 548. 549. 550. 551. 552. 553. 554. 555. 556. 557. 558. 559. 560. 561. 562. 563. 564. 565. 566. 567. 568. 569. 570. 571. 572. 573. 574. 575. 576. 577. 578. 579. 580. 581. 582. 583. 584. 585. 586. 587. 588. 589. 590. 591. 592. 593. 594. 595. 596. 597. 598. 599. 600. 601. 602. 603. 604. 605. 606. 607. 608. 609. 610. 611. 612. 613. 614. 615. 616. 617. 618. 619. 620. 621. 622. 623. 624. 625. 626. 627. 628. 629. 630. 631. 632. 633. 634. 635. 636. 637. 638. 639. 640. 641. 642. 643. 644. 645. 646. 647. 648. 649. 650. 651. 652. 653. 654. 655. 656. 657. 658. 659. 660. 661. 662. 663. 664. 665. 666. 667. 668. 669. 670. 671. 672. 673. 674. 675. 676. 677. 678. 679. 680. 681. 682. 683. 684. 685. 686. 687. 688. 689. 690. 691. 692. 693. 694. 695. 696. 697. 698. 699. 700. 701. 702. 703. 704. 705. 706. 707. 708. 709. 710. 711. 712. 713. 714. 715. 716. 717. 718. 719. 720. 721. 722. 723. 724. 725. 726. 727. 728. 729. 730. 731. 732. 733. 734. 735. 736. 737. 738. 739. 740. 741. 742. 743. 744. 745. 746. 747. 748. 749. 750. 751. 752. 753. 754. 755. 756. 757. 758. 759. 760. 761. 762. 763. 764. 765. 766. 767. 768. 769. 770. 771. 772. 773. 774. 775. 776. 777. 778. 779. 780. 781. 782. 783. 784. 785. 786. 787. 788. 789. 790. 791. 792. 793. 794. 795. 796. 797. 798. 799. 800. 801. 802. 803. 804. 805. 806. 807. 808. 809. 810. 811. 812. 813. 814. 815. 816. 817. 818. 819. 820. 821. 822. 823. 824. 825. 826. 827. 828. 829. 830. 831. 832. 833. 834. 835. 836. 837. 838. 839. 840. 841. 842. 843. 844. 845. 846. 847. 848. 849. 850. 851. 852. 853. 854. 855. 856. 857. 858. 859. 860. 861. 862. 863. 864. 865. 866. 867. 868. 869. 870. 871. 872. 873. 874. 875. 876. 877. 878. 879. 880. 881. 882. 883. 884. 885. 886. 887. 888. 889. 890. 891. 892. 893. 894. 895. 896. 897. 898. 899. 900. 901. 902. 903. 904. 905. 906. 907. 908. 909. 910. 911. 912. 913. 914. 915. 916. 917. 918. 919. 920. 921. 922. 923. 924. 925. 926. 927. 928. 929. 930. 931. 932. 933. 934. 935. 936. 937. 938. 939. 940. 941. 942. 943. 944. 945. 946. 947. 948. 949. 950. 951. 952. 953. 954. 955. 956. 957. 958. 959. 960. 961. 962. 963. 964. 965. 966. 967. 968. 969. 970. 971. 972. 973. 974. 975. 976. 977. 978. 979. 980. 981. 982. 983. 984. 985. 986. 987. 988. 989. 990. 991. 992. 993. 994. 995. 996. 997. 998. 999. 1000. 1001. 1002. 1003. 1004. 1005. 1006. 1007. 1008. 1009. 1010. 1011. 1012. 1013. 1014. 1015. 1016. 1017. 1018. 1019. 1020. 1021. 1022. 1023. 1024. 1025. 1026. 1027. 1028. 1029. 1030. 1031. 1032. 1033. 1034. 1035. 1036. 1037. 1038. 1039. 1040. 1041. 1042. 1043. 1044. 1045. 1046. 1047. 1048. 1049. 1050. 1051. 1052. 1053. 1054. 1055. 1056. 1057. 1058. 1059. 1060. 1061. 1062. 1063. 1064. 1065. 1066. 1067. 1068. 1069. 1070. 1071. 1072. 1073. 1074. 1075. 1076. 1077. 1078. 1079. 1080. 1081. 1082. 1083. 1084. 1085. 1086. 1087. 1088. 1089. 1090. 1091. 1092. 1093. 1094. 1095. 1096. 1097. 1098. 1099. 1100. 1101. 1102. 1103. 1104. 1105. 1106. 1107. 1108. 1109. 1110. 1111. 1112. 1113. 1114. 1115. 1116. 1117. 1118. 1119. 1120. 1121. 1122. 1123. 1124. 1125. 1126. 1127. 1128. 1129. 1130. 1131. 1132. 1133. 1134. 1135. 1136. 1137. 1138. 1139. 1140. 1141. 1142. 1143. 1144. 1145. 1146. 1147. 1148. 1149. 1150. 1151. 1152. 1153. 1154. 1155. 1156. 1157. 1158. 1159. 1160. 1161. 1162. 1163. 1164. 1165. 1166. 1167. 1168. 1169. 1170. 1171. 1172. 1173. 1174. 1175. 1176. 1177. 1178. 1179. 1180. 1181. 1182. 1183. 1184. 1185. 1186. 1187. 1188. 1189. 1190. 1191. 1192. 1193. 1194. 1195. 1196. 1197. 1198. 1199. 1200. 1201. 1202. 1203. 1204. 1205. 1206. 1207. 1208. 1209. 1210. 1211. 1212. 1213. 1214. 1215. 1216. 1217. 1218. 1219. 1220. 1221. 1222. 1223. 1224. 1225. 1226. 1227. 1228. 1229. 1230. 1231. 1232. 1233. 1234. 1235. 1236. 1237. 1238. 1239. 1240. 1241. 1242. 1243. 1244. 1245. 1246. 1247. 1248. 1249. 1250. 1251. 1252. 1253. 1254. 1255. 1256. 1257. 1258. 1259. 1260. 1261. 1262. 1263. 1264. 1265. 1266. 1267. 1268. 1269. 1270. 1271. 1272. 1273. 1274. 1275. 1276. 1277. 1278. 1279. 1280. 1281. 1282. 1283. 1284. 1285. 1286. 1287. 1288. 1289. 1290. 1291. 1292. 1293. 1294. 1295. 1296. 1297. 1298. 1299. 1300. 1301. 1302. 1303. 1304. 1305. 1306. 1307. 1308. 1309. 1310. 1311. 1312. 1313. 1314. 1315. 1316. 1317. 1318. 1319. 1320. 1321. 1322. 1323. 1324. 1325. 1326. 1327. 1328. 1329. 1330. 1331. 1332. 1333. 1334. 1335. 1336. 1337. 1338. 1339. 1340. 1341. 1342. 1343. 1344. 1345. 1346. 1347. 1348. 1349. 1350. 1351. 1352. 1353. 1354. 1355. 1356. 1357. 1358. 1359. 1360. 1361. 1362. 1363. 1364. 1365. 1366. 1367. 1368. 1369. 1370. 1371. 1372. 1373. 1374. 1375. 1376. 1377. 1378. 1379. 1380. 1381. 1382. 1383. 1384. 1385. 1386. 1387. 1388. 1389. 1390. 1391. 1392. 1393. 1394. 1395. 1396. 1397. 1398. 1399. 1400. 1401. 1402. 1403. 1404. 1405. 1406. 1407. 1408. 1409. 1410. 1411. 1412. 1413. 1414. 1415. 1416. 1417. 1418. 1419. 1420. 1421. 1422. 1423. 1424. 1425. 1426. 1427. 1428. 1429. 1430. 1431. 1432. 1433. 1434. 1435. 1436. 1437. 1438. 1439. 1440. 1441. 1442. 1443. 1444. 1445. 1446. 1447. 1448. 1449. 1450. 1451. 1452. 1453. 1454. 1455. 1456. 1457. 1458. 1459. 1460. 1461. 1462. 1463. 1464. 1465. 1466. 1467. 1468. 1469. 1470. 1471. 1472. 1473. 1474. 1475. 1476. 1477. 1478. 1479. 1480. 1481. 1482. 1483. 1484. 1485. 1486. 1487. 1488. 1489. 1490. 1491. 1492. 1493. 1494. 1495. 1496. 1497. 1498. 1499. 1500. 1501. 1502. 1503. 1504. 1505. 1506. 1507. 1508. 1509. 1510. 1511. 1512. 1513. 1514. 1515. 1516. 1517. 1518. 1519. 1520. 1521. 1522. 1523. 1524. 1525. 1526. 1527. 1528. 1529. 1530. 1531. 1532. 1533. 1534. 1535. 1536. 1537. 1538. 1539. 1540. 1541. 1542. 1543. 1544. 1545. 1546. 1547. 1548. 1549. 1550. 1551. 1552. 1553. 1554. 1555. 1556. 1557. 1558. 1559. 1560. 1561. 1562. 1563. 1564. 1565. 1566. 1567. 1568. 1569. 1570. 1571. 1572. 1573. 1574. 1575. 1576. 1577. 1578. 1579. 1580. 1581. 1582. 1583. 1584. 1585. 1586. 1587. 1588. 1589. 1590. 1591. 1592. 1593. 1594. 1595. 1596. 1597. 1598. 1599. 1600. 1601. 1602. 1603. 1604. 1605. 1606. 1607. 1608. 1609. 1610. 1611. 1612. 1613. 1614. 1615. 1616. 1617. 1618. 1619. 1620. 1621. 1622. 1623. 1624. 1625. 1626. 1627. 1628. 1629. 1630. 1631. 1632. 1633. 1634. 1635. 1636. 1637. 1638. 1639. 1640. 1641. 1642. 1643. 1644. 1645. 1646. 1647. 1648. 1649. 1650. 1651. 1652. 1653. 1654. 1655. 1656. 1657. 1658. 1659. 1660. 1661. 1662. 1663. 1664. 1665. 1666. 1667. 1668. 1669. 1670. 1671. 1672. 1673. 1674. 1675. 1676. 1677. 1678. 1679. 1680. 1681. 1682. 1683. 1684. 1685. 1686. 1687. 1688. 1689. 1690. 1691. 1692. 1693. 1694. 1695. 1696. 1697. 1698. 1699. 1700. 1701. 1702. 1703. 1704. 1705. 1706. 1707. 1708. 1709. 1710. 1711. 1712. 1713. 1714. 1715. 1716. 1717. 1718. 1719. 1720. 1721. 1722. 1723. 1724. 1725. 1726. 1727. 1728. 1729. 1730. 1731. 1732. 1733. 1734. 1735. 1736. 1737. 1738. 1739. 1740. 1741. 1742. 1743. 1744. 1745. 1746. 1747. 1748. 1749. 1750. 1751. 1752. 1753. 1754. 1755. 1756. 1757. 1758. 1759. 1760. 1761. 1762. 1763. 1764. 1765. 1766. 1767. 1768. 1769. 1770. 1771. 1772. 1773. 1774. 1775. 1776. 1777. 1778. 1779. 1780. 1781. 1782. 1783. 1784. 1785. 1786. 1787. 1788. 1789. 1790. 1791. 1792. 1793. 1794. 1795. 1796. 1797. 1798. 1799. 1800. 1801. 1802. 1803. 1804. 1805. 1806. 1807. 1808. 1809. 1810. 1811. 1812. 1813. 1814. 1815. 1816. 1817. 1818. 1819. 1820. 1821. 1822. 1823. 1824. 1825. 1826. 1827. 1828. 1829. 1830. 1831. 1832. 1833. 1834. 1835. 1836. 1837. 1838. 1839. 1840. 1841. 1842. 1843. 1844. 1845. 1846. 1847. 1848. 1849. 1850. 1851. 1852. 1853. 1854. 1855. 1856. 1857. 1858. 1859. 1860. 1861. 1862. 1863. 1864. 1865. 1866. 1867. 1868. 1869. 1870. 1871. 1872. 1873. 1874. 1875. 1876. 1877. 1878. 1879. 1880. 1881. 1882. 1883. 1884. 1885. 1886. 1887. 1888. 1889. 1890. 1891. 1892. 1893. 1894. 1895. 1896. 1897. 1898. 1899. 1900. 1901. 1902. 1903. 1904. 1905. 1906. 1907. 1908. 1909. 1910. 1911. 1912. 1913. 1914. 1915. 1916. 1917. 1918. 1919. 1920. 1921. 1922. 1923. 1924. 1925. 1926. 1927. 1928. 1929. 1930. 1931. 1932. 1933. 1934. 1935. 1936. 1937. 1938. 1939. 1940. 1941. 1942. 1943. 1944. 1945. 1946. 1947. 1948. 1949. 1950. 1951. 1952. 1953. 1954. 1955. 1956. 1957. 1958. 1959. 1960. 1961. 1962. 1963. 1964. 1965. 1966. 1967. 1968. 1969. 1970. 1971. 1972. 1973. 1974. 1975. 1976. 1977. 1978. 1979. 1980. 1981. 1982. 1983. 1984. 1985. 1986. 1987. 1988. 1989. 1990. 1991. 1992. 1993. 1994. 1995. 1996. 1997. 1998. 1999. 2000. 2001. 2002. 2003. 2004. 2005. 2006. 2007. 2008. 2009. 2010. 2011. 2012. 2013. 2014



NOVOTEL  
BANGKOK FUTURE MARK BANGKOK

SWIMMING POOL LOG SHEET : DAILY

Date: 22/3/18

NOVOTEL

SWIMMING POOL LOG SHEET : DAILY

Date: 22/3/18

Description		Morning	Afternoon	Night
Pump Operationing	No.1	1	1	1
	No.2	0.5	0.5	1
	No.3	1	1	1
	Status [ Run, Off ]	1	1	1
Sand Filter System Pressure	No.1	10	10	1
	No.2	10	10	1
	No.3	10	10	1
	Pressure Gauge Out [ Psi ]	0.5	0.5	0.5
Strainers Cleaning	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
	Filter	1	1	1
Back Wash ( 10 min.)	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
	CL	1.5	1.5	1.5
Chlorine & PH Test Results (Test kit manual)	PH	7.5	7.5	7.5
	Chlorine	1	1	1
Chemical Additional ( kg )	Soda Ash	1	1	1
	Sodium Bi-Sulphate Acid	1	1	1
	Salt	1	1	1
	Aluminium Sulphate	1	1	1
	Status [ On,Off ]	1	1	1
Salt Chlorinator	No.1	0.5	0.5	0.5
	No.2	0.5	0.5	0.5
	No.3	0.5	0.5	0.5
	No.1	0.5	0.5	0.5
	No.2	0.5	0.5	0.5
Surge Tank	Water Level [ High, Midium, Low ]	High	High	High
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 28/3/68

Description		Morning 09.00	Afternoon 12.00	Night 02.00
Pump Operating	No.1	1	1	1
	No.2	1	1	1
	No.3	ON	ON	1
	Status [Run, Off]			
Sand Filter System Pressure	No.1	10	10	10
	No.2	10	10	10
	No.3	1	1	1
	Pressure Gauge Out [Psi]			
Strainers Cleaning	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
	Pump			
Back Wash (10 min.)	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	1	1	1
	Soda Ash	1	1	1
	Sodium Bi-Sulphate Acid	1	1	1
	Salt	1	1	1
	Aluminium Sulphate	1	1	1
Salt Chlorinator	Status [On, Off]	No.1	ON	OFF
		No.2	1	ON
		No.3	1	ON
	Volume System Control [Display 0-100]	No.1	22	22
		No.2	22	22
		No.3	22	22
Surge Tank	Water Level [High, Medium, Low]	High	High	High
Operation By				

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 17/3/68

Description		Morning 09.00	Afternoon 12.00	Night 02.00
Pump Operating	No.1	1	1	1
	No.2	1	1	1
	No.3	ON	1	1
	Status [Run, Off]			
Sand Filter System Pressure	No.1	10	10	10
	No.2	10	10	10
	No.3	1	1	1
	Pressure Gauge Out [Psi]			
Strainers Cleaning	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
	Pump			
Back Wash (10 min.)	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
	Filter			
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	1	1	1
	Soda Ash	1	1	1
	Sodium Bi-Sulphate Acid	1	1	1
	Salt	1	1	1
	Aluminium Sulphate	1	1	1
Salt Chlorinator	Status [On, Off]	No.1	ON	1
		No.2	1	1
		No.3	1	1
	Volume System Control [Display 0-100]	No.1	22	22
		No.2	22	22
		No.3	22	22
Surge Tank	Water Level [High, Medium, Low]	High	High	High
Operation By				

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 18/07/23

Description		Morning <u>07.00</u>	Afternoon <u>18.00</u>	Night <u>00.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	ON	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	99	99
		No.3	96	96
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 17/12/23

Description		Morning <u>07.00</u>	Afternoon <u>18.00</u>	Night <u>00.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	ON	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	-
		No.2	-	-
		No.3	-	ON
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	99	99
		No.3	96	96
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 16/3/64

Description		Morning <u>08:00</u>	Afternoon <u>16:30</u>	Night <u>01:30</u>
Pump Operationing	Status [ Run , Off ]	No.1	-	-
		No.2	On	-
		No.3	On	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	10	10
		No.2	10	10
		No.3	-	-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	15	1.5	4.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	Off
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100]	No.1	-	Off
		No.2	20	20
		No.3	45	85
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	Medium
Operation By				

Remark .....  
 Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 15/03/64

Description		Morning <u>08:00</u>	Afternoon <u>16:00</u>	Night <u>01:30</u>
Pump Operationing	Status [ Run , Off ]	No.1	-	-
		No.2	-	-
		No.3	On	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	10	10
		No.2	10	10
		No.3	-	-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	10 min
		No.2	-	10 min
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	100 kg
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	Off
		No.2	-	On
		No.3	On	On
	Volume System Control [Display 0-100]	No.1	-	Off
		No.2	22	21
		No.3	25	25
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Mid	Medium
Operation By				

Remark .....  
 Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 10/03/19

Description		Morning <u>8.00</u>	Afternoon <u>18.40</u>	Night <u>03.00</u>
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	-	-
		No.3	On	On
Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	10	10
		No.2	10	10
		No.3	-	-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash (10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	-
		No.2	On	-
		No.3	On	-
	Volume System Control [Display 0-100]	No.1	OFF	-
		No.2	22	-
		No.3	85	-
Surge Tank	Water Level [High, Medium, Low]	Hi	Medium	Hi
Operation By				

Remark .....

Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 13/03/19

Description		Morning <u>8.00</u>	Afternoon <u>14.40</u>	Night <u>03.00</u>
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	On	On
		No.3	-	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	10	10
		No.2	10	10
		No.3	-	-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash (10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	-
		No.2	On	-
		No.3	On	-
	Volume System Control [Display 0-100]	No.1	OFF	-
		No.2	19	-
		No.3	95	-
Surge Tank	Water Level [High, Medium, Low]	Hi	Hi	Hi
Operation By				

Remark .....

Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 12/13/20

Description		Morning <u>08:40</u>	Afternoon <u>16:30</u>	Night <u>22:00</u>
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	-	-
		No.3	ON	ON
Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	-	-
		No.2	-	-
		No.3	-	-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash (10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.3	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	OFF
		No.2	ON	ON
		No.3	ON	ON
	Volume System Control [Display 0-100]	No.1	08	08
		No.2	87	81
		No.3	45	35
Surge Tank	Water Level [High, Medium, Low]	High	High	High
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 11/13/20

Description		Morning <u>08:00</u>	Afternoon <u>17:00</u>	Night <u>03:00</u>
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	-	-
		No.3	ON	ON
Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	10	10
		No.2	10	10
		No.3	-	-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash (10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.5	1.5
	PH	7.6	7.4	7.4
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	-
		No.2	-	-
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	80	65
		No.3	45	45
Surge Tank	Water Level [High, Medium, Low]	High	High	High
Operation By				

Remark .....

Recheck By

Chief Engineer

Description		Morning 07:00	Afternoon 16:00	Night 03:00	
Pump Operationing	Status [Run, Off]				
	No.1	—	—	—	
	No.2	—	—	—	
	No.3	ON	ON	—	
Sand Filter System Pressure	Pressure Gauge Out [Psi]				
	No.1	10	10	—	
	No.2	10	10	—	
	No.3	—	—	—	
Strainers Cleaning	Pump				
	No.1	—	—	—	
	No.2	—	—	—	
	No.3	—	—	—	
Back Wash (10 min.)	Filter				
	No.1	—	—	—	
	No.2	—	—	—	
	No.3	—	—	—	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.4	7.4	7.4	
Chemical Additional (kg)	Chlorine	—	—	—	
	Soda Ash	—	—	—	
	Sodium Bi-Sulphate Acid	—	—	—	
	Salt	—	—	—	
	Aluminium Sulphate	—	—	—	
Salt Chlorinator	Status [On,Off]	No.1	ON	NO	—
		No.2	—	—	—
		No.3	—	—	—
	Volume System Control [Display 0-100]	No.1	—	—	—
		No.2	20	25	—
		No.3	35	35	—
Surge Tank	Water Level [High, Medium, Low]	Hi	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer

Description		Morning 07:00	Afternoon 16:00	Night 06:00	
Pump Operationing	Status [Run, Off]				
	No.1	—	—	—	
	No.2	—	—	—	
	No.3	ON	NO	ON	
Sand Filter System Pressure	Pressure Gauge Out [Psi]				
	No.1	10	10	10	
	No.2	10	10	10	
	No.3	—	—	—	
Strainers Cleaning	Pump				
	No.1	—	—	—	
	No.2	—	—	—	
	No.3	—	—	—	
Back Wash (10 min.)	Filter				
	No.1	—	—	—	
	No.2	—	—	—	
	No.3	—	—	—	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.4	7.4	7.6	
Chemical Additional (kg)	Chlorine	—	—	—	
	Soda Ash	—	—	—	
	Sodium Bi-Sulphate Acid	—	—	—	
	Salt	—	—	—	
	Aluminium Sulphate	—	—	—	
Salt Chlorinator	Status [On,Off]	No.1	OFF	OFF	OFF
		No.2	ON	ON	ON
		No.3	ON	ON	ON
	Volume System Control [Display 0-100]	No.1	—	340	OFF
		No.2	72	72	22
		No.3	35	35	35
Surge Tank	Water Level [High, Medium, Low]	Hi	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 8/3/25

Description		Morning <u>09:00</u>	Afternoon <u>18:30</u>	Night <u>06:40</u>
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	-	-
		No.3	ON	-
				ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	10	10
		No.2	10	10
		No.3	-	-
				-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
				-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
				-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	70	19
		No.3	85	85
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 07/03/25

Description		Morning <u>09:00</u>	Afternoon <u>18:00</u>	Night <u>03:00</u>
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	ON	-
		No.3	-	-
				-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	10	10
		No.2	10	10
		No.3	-	-
				-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
				-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
				-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	21	91
		No.3	89	88
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi
Operation By				

Remark .....

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 06/09/68

Description		Morning <u>09.30</u>	Afternoon <u>18.00</u>	Night <u>03.00</u>	
Pump Operationing		Status [ Run , Off ]			
		No.1	-	-	-
		No.2	-	-	-
		No.3	ON	-	-
Sand Filter System Pressure		Pressure Gauge Out [ Psi ]			
		No.1	10	10	-
		No.2	10	10	-
		No.3	-	-	-
Strainers Cleaning		Pump			
		No.1	-	-	-
		No.2	-	-	-
		No.3	-	-	-
Back Wash ( 10 min.)		Filter			
		No.1	-	-	-
		No.2	-	-	-
		No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)		CL	1.5	1.5	1.5
		PH	7.6	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	OFF	ON	-
		No.2	ON	-	-
		No.3	ON	-	-
	Volume System Control [Display 0-100 ]	No.1	OFF	-	-
		No.2	29	23	-
		No.3	85	25	-
Surge Tank	Water Level [ High , Midium , Low ]	midium	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 5/3/68

Description		Morning <u>09.30</u>	Afternoon <u>18.00</u>	Night <u>03.00</u>	
Pump Operationing		Status [ Run , Off ]			
		No.1	-	-	-
		No.2	-	ON	-
		No.3	NOON	-	-
Sand Filter System Pressure		Pressure Gauge Out [ Psi ]			
		No.1	10	10	-
		No.2	10	10	-
		No.3	-	-	-
Strainers Cleaning		Pump			
		No.1	-	-	-
		No.2	-	-	-
		No.3	-	-	-
Back Wash ( 10 min.)		Filter			
		No.1	-	-	-
		No.2	-	-	-
		No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)		CL	1.5	1.5	1.5
		PH	7.4	7.4	7.4
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	NOON	ON	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-	-
		No.2	80	23	-
		No.3	85	25	-
Surge Tank	Water Level [ High , Midium , Low ]	High	Hi	Hi	
Operation By					

Rem

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 13/12/25

Description		Morning <u>09:00</u>	Afternoon <u>12:00</u>	Night <u>06:40</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	—	—	—
	No.2	—	—	—
	No.3	ON	ON	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	10	10	10
	No.3	—	—	—
Strainers Cleaning	Pump			
	No.1	—	—	—
	No.2	—	—	—
	No.3	—	—	—
Back Wash ( 10 min.)	Filter			
	No.1	—	10	—
	No.2	—	10	—
	No.3	—	—	—
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.4	7.4	7.6
Chemical Additional ( kg )	Chlorine	—	—	—
	Soda Ash	—	—	—
	Sodium Bi-Sulphate Acid	—	—	—
	Salt	—	—	—
	Aluminium Sulphate	—	—	—
Salt Chlorinator	Status [ On,Off ]	No.1	OFF	OFF
		No.2	ON	ON
		No.3	ON	ON
	Volume System Control [Display 0-100 ]	No.1	—	OFF
		No.2	25	25
		No.3	25	25
Surge Tank	Water Level [ High , Midium , Low ]	hi	hi	midium
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 13/12/25

Description		Morning <u>09:00</u>	Afternoon <u>12:00</u>	Night <u>06:40</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	—	—	—
	No.2	—	—	—
	No.3	ON	ON	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	10	10	10
	No.3	—	—	—
Strainers Cleaning	Pump			
	No.1	—	—	—
	No.2	—	—	—
	No.3	—	—	—
Back Wash ( 10 min.)	Filter			
	No.1	—	—	—
	No.2	—	—	—
	No.3	—	—	—
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.4	7.4	7.6
Chemical Additional ( kg )	Chlorine	—	—	—
	Soda Ash	—	—	—
	Sodium Bi-Sulphate Acid	—	—	—
	Salt	—	—	—
	Aluminium Sulphate	—	—	—
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	—	ON
		No.3	—	ON
	Volume System Control [Display 0-100 ]	No.1	—	OFF
		No.2	20	20
		No.3	25	25
Surge Tank	Water Level [ High , Midium , Low ]	hi	hi	midium
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 2/3/68

Description		Morning <u>08:00</u>	Afternoon <u>16:30</u>	Night <u>02:00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	NO	-
	No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)		CL <u>1.5</u>	1.5	1.5
		PH <u>7.4</u>	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	NO
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	20	25
		No.3	35	35
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 01/03/68

Description		Morning <u>08:00</u>	Afternoon <u>16:30</u>	Night <u>02:00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	NO	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)		CL <u>1.7</u>	1.5	1.5
		PH <u>7.5</u>	7.5	7.5
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	NO
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	20	20
		No.3	35	35
Surge Tank	Water Level [ High , Midium , Low ]	Mid	Mid	Hi
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 20/06/69

Description		Morning <u>07.00</u>	Afternoon <u>19.00</u>	Night <u>02.00</u>
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	ON	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	10	-
	No.2	-	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	2.5	2.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	-	100
		No.3	-	85
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High
Operation By				

Remark .....

Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 29/9/68

Description		Morning <u>07.00</u>	Afternoon <u>16.30</u>	Night <u>02.00</u>
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.6	1.6
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High
Operation By				

Remark .....

Recheck By ..... Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 28/4/68

Description		Morning 09.00	Afternoon 16.50	Night 20.15
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	On	-	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	-	-
	No.3	10	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.6	1.6
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	21	-
		No.3	45	-
Surge Tank	Water Level [ High , Midium , Low ]	High	-	-
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 29/4/68

Description		Morning 09.00	Afternoon 16.50	Night 01.10
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	10
	No.2	-	-	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	7 strainers - On
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	> Backwash 10 min
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	3 gms
Salt Chlorinator	Status [ On,Off ]	No.1	-	Off
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	Off
		No.2	-	19
		No.3	-	45
Surge Tank	Water Level [ High , Midium , Low ]	High	-	Midium
Operation By				

Remark

strainers no. 2, 3 on back wash filter no. 2, 3 on strainers pump no. 2, 3

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 26/4/25

Description		Morning <u>09.00</u>	Afternoon <u>16.30</u>	Night <u>02.20</u>
Pump Operationing	Status [Run, Off]			
	No.1	ON	ON	-
	No.2	-	ON	-
	No.3	-	-	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	10
	No.3	-	-	10
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	22	22
		No.3	85	85
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High
Operation By		[Signature]		

Remark ..... [Redacted]

Recheck By ..... [Signature] Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 25/4/25

Description		Morning <u>09.00</u>	Afternoon <u>16.30</u>	Night <u>01.00</u>
Pump Operationing	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	OFF	-
		No.2	ON	-
		No.3	ON	-
	Volume System Control [Display 0-100 ]	No.1	OFF	-
		No.2	22	22
		No.3	85	85
Surge Tank	Water Level [ High , Midium , Low ]	High	Midium	High
Operation By		[Signature]		

Remark ..... [Redacted]

Recheck By ..... [Signature]

**SWIMMING POOL LOG SHEET : DAILY**

Date 22/4/68

Description		Morning <u>07.06</u>	Afternoon <u>16.40</u>	Night <u>01.00</u>	
Pump Operating	Status [Run, Off]	No.1	-	-	
		No.2	-	ON	-
		No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	-	-	
		No.2	10	10	-
		No.3	10	10	-
Strainers Cleaning	Pump	No.1	-	-	
		No.2	-	-	-
		No.3	-	-	-
Back Wash (10 min.)	Filter	No.1	-	-	
		No.2	-	-	-
		No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [On,Off]	No.1	ON	OFF	
		No.2	-	ON	-
		No.3	-	ON	-
	Volume System Control [Display 0-100]	No.1	-	OFF	-
		No.2	22	22	-
		No.3	23	23	-
Surge Tank	Water Level [High, Midium, Low]	H	H	H	
Operation By		[Signature]			

Remark ..... [Redacted]

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 23/4/68

Description		Morning <u>07.00</u>	Afternoon <u>16.30</u>	Night <u>01.00</u>	
Pump Operating	Status [Run, Off]	No.1	-	-	
		No.2	-	ON	-
		No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	-	-	
		No.2	10	10	-
		No.3	10	10	-
Strainers Cleaning	Pump	No.1	-	-	
		No.2	-	-	-
		No.3	-	-	-
Back Wash (10 min.)	Filter	No.1	-	-	
		No.2	-	-	-
		No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [On,Off]	No.1	ON	ON	
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100]	No.1	-	-	-
		No.2	22	22	-
		No.3	23	23	-
Surge Tank	Water Level [High, Midium, Low]	H	H	H	
Operation By		[Signature]			

Remark ..... [Redacted]

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 22/4/68

Description		Morning <u>9.00</u>	Afternoon <u>16.00</u>	Night <u>02.00</u>
Pump Operating	Status [ Run , Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	<u>1.8</u>	<u>1.8</u>	<u>1.5</u>
	PH	<u>7.6</u>	<u>7.1</u>	<u>8.6</u>
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High , Midium , Low ]	<u>H1</u>	<u>H1</u>	<u>H1</u>
Operation By				

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 27/4/68

Description		Morning <u>09.00</u>	Afternoon <u>14.00</u>	Night <u>02.00</u>
Pump Operating	Status [ Run , Off ]	No.1	<u>ON</u>	-
		No.2	-	-
		No.3	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]	No.1	-	-
		No.2	<u>10</u>	<u>10</u>
		No.3	<u>10</u>	<u>10</u>
Strainers Cleaning	Pump	No.1	-	-
		No.2	-	-
		No.3	-	-
Back Wash ( 10 min.)	Filter	No.1	-	-
		No.2	-	-
		No.3	-	-
Chlorine & PH Test Results (Test kit manual)	CL	<u>1.5</u>	<u>1.5</u>	<u>1.5</u>
	PH	<u>7.6</u>	<u>7.6</u>	<u>8.6</u>
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	<u>ON</u>	<u>ON</u>
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	<u>22</u>	<u>23</u>
		No.3	<u>85</u>	<u>85</u>
Surge Tank	Water Level [ High , Midium , Low ]	<u>H1</u>	<u>H1</u>	<u>H1</u>
Operation By				

Remark

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 10/4/25

Description		Morning <u>08.00</u>	Afternoon <u>16.00</u>	Night <u>02.00</u>	
Pump Operationing	Status [Run, Off]				
	No.1	-	ON	-	
	No.2	ON	-	-	
	No.3	-	-	ON	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	-	-	-	
	No.2	10	10	10	
	No.3	10	10	10	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	0.5 kg	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	OFF
		No.2	-	-	ON
		No.3	-	-	ON
	Volume System Control [Display 0-100]	No.1	-	-	OFF
		No.2	21	21	22
		No.3	25	25	25
Surge Tank	Water Level [ High , Midium , Low ]	[Redacted]			
Operation By		<u>[Signature]</u>	<u>[Signature]</u>	<u>[Signature]</u>	

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 11/4/25

Description		Morning <u>09.00</u>	Afternoon <u>16.00</u>	Night <u>02.00</u>
Pump Operationing	Status [Run, Off]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	ON	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	10	10
	No.3	-	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	7.5 kg
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	-	OFF
		No.2	-	22
		No.3	-	25
Surge Tank	Water Level [ High , Midium , Low ]	[Redacted]		
Operation By		<u>[Signature]</u>	<u>[Signature]</u>	<u>[Signature]</u>

Remark

Recheck By

**SWIMMING POOL LOG SHEET : DAILY**

Date 19/4/25

Description		Morning <u>9.00</u>	Afternoon <u>14.00</u>	Night <u>19.00</u>
Pump Operationing	Status [Run, Off]			
	No.1	-	-	-
	No.2	on	on	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.5	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	-
		No.2	on	on
		No.3	on	-
	Volume System Control [Display 0-100]	No.1	OFF	-
		No.2	99	99
		No.3	99	99
Surge Tank	Water Level [High, Medium, Low]	Hi	Hi	Hi
Operation By		[Redacted]		

Remark ..... [Redacted]

Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 17/4/68

Description		Morning <u>09.00</u>	Afternoon <u>14.50</u>	Night <u>19.00</u>
Pump Operationing	Status [Run, Off]			
	No.1	-	-	-
	No.2	on	on	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.0	7.5	7.5
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	-
		No.2	on	on
		No.3	on	-
	Volume System Control [Display 0-100]	No.1	OFF	-
		No.2	99	99
		No.3	99	99
Surge Tank	Water Level [High, Medium, Low]	Hi	Hi	Hi
Operation By		[Redacted]		

Remark ..... [Redacted]

Recheck By ..... Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 16/4/68

Description		Morning 08.00	Afternoon 11.00	Night 02.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	-	-
	No.3	10	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.8	1.8
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	22	-
		No.3	25	-
Surge Tank	Water Level [ High , Midium , Low ]	H	H	H
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 15/08/68

Description		Morning 09.00	Afternoon 11.00	Night 03.00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.8	1.8
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High , Midium , Low ]	Low	M.H	H
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 16/12/14

Description		Morning 08.00	Afternoon 16.00	Night 02.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	-	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	-	-	-
	No.2	10	10	10
	No.3	10	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.6	1.5
	PH	7.5	7.5	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	OFF	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	27	-
		No.3	85	-
Surge Tank	Water Level [High, Medium, Low]	H1	H1	H1
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 17/12/14

Description		Morning 08.00	Afternoon 16.00	Night 02.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	ON
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	-	-	-
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	-	OFF
		No.2	27	27
		No.3	85	85
Surge Tank	Water Level [High, Medium, Low]	H1	H1	H1
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 19/4/25

Description		Morning 06.00	Afternoon 16.30	Night 06.30
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	ON
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	-	-	-
	No.2	10	10	10
	No.3	10	10	10
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100]	No.1	-	OFF
		No.2	91	91
		No.3	95	95
Surge Tank	Water Level [High, Medium, Low]	H	H	midium
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 11/4/25

Description		Morning 07.00	Afternoon 17.10	Night 02.00	
Pump Operating	Status [Run, Off]				
	No.1	-	-	-	
	No.2	ON	ON	-	
	No.3	-	-	OFF	
Sand Filter System Pressure	Pressure Gauge Out [Psi]				
	No.1	-	-	-	
	No.2	10	10	-	
	No.3	10	10	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash (10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional (kg)	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [On,Off]	No.1	OFF	-	
		No.2	ON	-	
		No.3	ON	-	
	Volume System Control [Display 0-100]	No.1	-	OFF	-
		No.2	90	99	-
		No.3	90	95	-
Surge Tank	Water Level [High, Medium, Low]		midium	H	
Operation By					

Remark

Recheck By

Chief Engineer

Description		Morning 09:00	Afternoon 15:40	Night 22:00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	on	-
	No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	7.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	22	22
		No.3	25	25
Surge Tank	Water Level [ High , Midium , Low ]	High	midium	High
Operation By				

Remark

Recheck By

Chief Engineer

Description		Morning 09:00	Afternoon 15:40	Night 02:00
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	on	on	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	7.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	off	off
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	21	21
		No.3	25	25
Surge Tank	Water Level [ High , Midium , Low ]	High	midium	High
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 8/4/68

Description		Morning 08.00	Afternoon 18.00	Night 02.00	
Pump Operationing	Status [Run, Off]				
	No.1	1	1	1	
	No.2	02	02	1	
	No.3	1	1	1	
Sand Filter System Pressure	Pressure Gauge Out [Pd]				
	No.1	1	1	1	
	No.2	10	10	1	
	No.3	10	10	1	
Strainers Cleaning	Pump				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Back Wash (10 min.)	Filter				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional (kg)	Chlorine	1	1	1	
	Soda Ash	1	1	1	
	Sodium Bi-Sulphate Acid	1	1	1	
	Salt	1	1	1	
	Aluminium Sulphate	1	1	1	
Salt Chlorinator	Status [On, Off]	No.1	02	02	1
		No.2	1	1	1
		No.3	1	1	1
	Volume System Control [Display 0-100]	No.1	1	1	1
		No.2	1	1	1
		No.3	1	1	1
Surge Tank	Water Level [High, Medium, Low]	1	1	1	
Operation By					

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 7/4/68

Description		Morning 08.00	Afternoon 16.00	Night 02.00	
Pump Operationing	Status [Run, Off]				
	No.1	1	1	1	
	No.2	02	02	1	
	No.3	1	1	1	
Sand Filter System Pressure	Pressure Gauge Out [Pd]				
	No.1	10	10	1	
	No.2	10	10	1	
	No.3	10	10	1	
Strainers Cleaning	Pump				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Back Wash (10 min.)	Filter				
	No.1	1	1	1	
	No.2	1	1	1	
	No.3	1	1	1	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional (kg)	Chlorine	1	1	1	
	Soda Ash	1	1	1	
	Sodium Bi-Sulphate Acid	1	1	1	
	Salt	1	1	1	
	Aluminium Sulphate	1	1	1	
Salt Chlorinator	Status [On, Off]	No.1	02	02	1
		No.2	1	1	1
		No.3	1	1	1
	Volume System Control [Display 0-100]	No.1	1	1	1
		No.2	1	1	1
		No.3	1	1	1
Surge Tank	Water Level [High, Medium, Low]	1	1	1	
Operation By					

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 6/4/68

Description		Morning 09:00	Afternoon 16:30	Night 01:00
Pump Operating	Status [ Run , Off ]			
	No.1	1	1	1
	No.2	1	1	1
	No.3	ON	1	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
Strainers Cleaning	Pump			
	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
Back Wash ( 10 min.)	Filter			
	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.5	7.6	7.1
Chemical Additional ( kg )	Chlorine	1	1	1
	Soda Ash	1	1	1
	Sodium Bi-Sulphate Acid	1	1	1
	Salt	1	1	1
	Aluminium Sulphate	1	1	1
Salt Chlorinator	Status [ On,Off ]	No.1	ON	1
		No.2	1	1
		No.3	1	1
	Volume System Control [Display 0-100 ]	No.1	1	1
		No.2	22	22
		No.3	25	25
Surge Tank	Water Level [ High , Medium , Low ]	1	1	1
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 05/04/68

Description		Morning 09:00	Afternoon 16:00	Night 22:00
Pump Operating	Status [ Run , Off ]			
	No.1	1	1	1
	No.2	1	1	1
	No.3	ON	ON	1
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
Strainers Cleaning	Pump			
	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
Back Wash ( 10 min.)	Filter			
	No.1	1	1	1
	No.2	1	1	1
	No.3	1	1	1
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.1	7.1
Chemical Additional ( kg )	Chlorine	1	1	1
	Soda Ash	1	1	1
	Sodium Bi-Sulphate Acid	1	1	1
	Salt	1	1	1
	Aluminium Sulphate	1	1	1
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	1	1
		No.3	1	1
	Volume System Control [Display 0-100 ]	No.1	1	1
		No.2	21	21
		No.3	25	25
Surge Tank	Water Level [ High , Medium , Low ]	1	1	1
Operation By				

Remark

Recheck By

Chief Engineer



SWIMMING POOL LOG SHEET : DAILY

Date 4/8/04

Description		Morning 09.00	Afternoon 16.30	Night 02.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	-	ON	-
	No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	22	22
		No.3	45	45
Surge Tank	Water Level [ High , Midium , Low ]	H	H	H
Operation By		[Signature]		

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 8/4/08

Description		Morning 09.00	Afternoon 16.30	Night 02.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	-	ON	-
	No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	10	-
	No.3	10	10	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	22	31
		No.3	45	45
Surge Tank	Water Level [ High , Midium , Low ]	H	H	H
Operation By		[Signature]		

Re

Recheck By


Chief Engineer

Description		Morning	Afternoon	Night
Pump Operationing	Status [ Run, Off ]			
	No.1	1	-	1
	No.2	1	-	1
	No.3	02	02	1
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	1	-	1
	No.2	10	10	1
	No.3	10	10	1
Strainers Cleaning	Pump			
	No.1	1	-	1
	No.2	1	-	✓
	No.3	1	-	✓
Back Wash ( 10 min.)	Filter			
	No.1	1	-	1
	No.2	1	-	✓
	No.3	1	-	✓
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	1	1	1
	Soda Ash	1	1	1
	Sodium Bi-Sulphate Acid	1	1	1
	Salt	1	1	1
	Aluminium Sulphate	1	1	1
Salt Chlorinator	Status [ On,Off ]	No.1	02	02
		No.2	1	1
		No.3	1	1
	Volume System Control [Display 0-100 ]	No.1	1	1
		No.2	32	32
		No.3	35	35
Surge Tank	Water Level [ High , Midium , Low ]	High	High	High
Operation By		S.M.C		

**Remark** התקנת חשמל ופיקודים, אינרציה, Back Wash. ע"י

Recheck By

**Chief Engineer**



SWIMMING POOL LOG SHEET : DAILY

Date 01/04/20

Description		Morning 08:00	Afternoon 12:00	Night 03:00	
Pump Operationing	Status [Run , Off]				
	No.1	✓	✓	✓	
	No.2	✓	✓	✓	
	No.3	On	✓	✓	
Sand Filter System Pressure	Pressure Gauge Out [ Pal ]				
	No.1	6	✓	✓	
	No.2	10	✓	✓	
	No.3	✓	✓	✓	
Strainers Cleaning	Pump				
	No.1	✓	✓	✓	
	No.2	✓	✓	✓	
	No.3	✓	✓	✓	
Back Wash ( 10 min.)	Filter				
	No.1	✓	✓	✓	
	No.2	✓	✓	✓	
	No.3	✓	✓	✓	
Chlorine & PH Test Results (Test kit manual)		CL	1.5	1.5	1.5
		PH	7.4	7.4	7.6
Chemical Additional ( kg )	Chlorine		✓	✓	✓
	Soda Ash		✓	✓	✓
	Sodium Bi-Sulphate Acid		✓	✓	✓
	Salt		✓	✓	✓
	Aluminium Sulphate		✓	✓	✓
Salt Chlorinator	Status [ On,Off ]	No.1	✓	✓	✓
		No.2	✓	✓	✓
		No.3	✓	✓	✓
	Volume System Control [Display 0-100 ]	No.1	✓	✓	✓
		No.2	✓	✓	✓
		No.3	✓	✓	✓
Surge Tank	Water Level [ High , Medium , Low ]		Hi	Hi	Hi
Operation By					

### Remark

Recheck By

**Chief Engineer**

**SWIMMING POOL LOG SHEET : DAILY**

Date 4/1-05-23

Description		Morning <u>9:00</u>	Afternoon <u>16:30</u>	Night <u>08:00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	10	10	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.1	7.6	7.1
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High , Medium , Low ]	High	High	High
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 20/5/25

Description		Morning <u>09:00</u>	Afternoon <u>17:00</u>	Night <u>22:00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	10	10	10
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	10	10	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	OFF
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	-	19
		No.3	-	45
Surge Tank	Water Level [ High , Medium , Low ]	High	High	Medium
Operation By				

Remark .....

Recheck By

Chief Engineer

Description		Morning 09.00	Afternoon 11.00	Night 01.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	-	-
	No.3	-	-	on
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	10	-	50
	No.2	10	-	70
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	OFF
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100]	No.1	10	OFF
		No.2	95	10
		No.3	95	95
Surge Tank	Water Level [High, Medium, Low]	Hi	Hi	Medium
Operation By				

Remark

Recheck By

Chief Engineer

Description		Morning 09.00	Afternoon 11.00	Night 01.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	on
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	10	10	70
	No.2	10	10	70
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	OFF
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100]	No.1	10	OFF
		No.2	95	10
		No.3	95	95
Surge Tank	Water Level [High, Medium, Low]	Hi	Hi	Medium
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 27/6/68

Description		Morning 8.30	Afternoon 16.30	Night 07.20	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	On	On	On	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	12	12	19	
	No.2	13	13	16	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.0	1.0	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	OFF	
Salt Chlorinator	Status [ On,Off ]	No.1	-	-	OFF
		No.2	On	On	On
		No.3	On	On	On
	Volume System Control [Display 0-100 ]	No.1	-	-	OFF
		No.2	17	19	19
		No.3	85	85	85
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi	
Operation By					

Remark .....  
Recheck By ..... Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 28/06/68

Description		Morning 09.00	Afternoon 16.00	Night 07.00	
Pump Operating	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	-	10	
	No.3	10	10	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	2.5	
	PH	7.6	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	OFF	
Salt Chlorinator	Status [ On,Off ]	No.1	-	-	OFF
		No.2	-	-	On
		No.3	-	-	On
	Volume System Control [Display 0-100 ]	No.1	-	-	OFF
		No.2	-	-	19
		No.3	-	-	85
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	medium	
Operation By					

Remark .....  
Recheck By ..... Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 28-8-25

Description		Morning <u>9.00</u>	Afternoon <u>16.30</u>	Night <u>02.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	ON	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	-
	No.2	-	-	-
	No.3	10	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	ON	-
	Volume System Control [Display 0-100 ]	No.1	10	-
		No.2	85	-
		No.3	-	-
Surge Tank	Water Level [ High , Midium , Low ]	HI	HI	HI
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 9/10/64

Description		Morning <u>9.00</u>	Afternoon <u>16.30</u>	Night <u>02.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	10	10	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	10	-	-
	No.3	10	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High , Midium , Low ]	HI	HI	HI
Operation By				

Remark .....

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 13/5/25

Description		Morning 9.00	Afternoon 12.00	Night 06.00
		Status [ Run , Off ]		
Pump Operating	No.1	-	-	-
	No.2	00	-	-
	No.3	-	-	On
		Pressure Gauge Out [ Psi ]		
Sand Filter System Pressure	No.1	10	-	10
	No.2	10	-	10
	No.3	-	-	-
		Pump		
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
		Filter		
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)		CL 1.7	1.5	1.5
		PH 7.5	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	100 Kg
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	OFF
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	19	19
		No.3	45	45
Surge Tank	Water Level [ High , Midium , Low ]	H	H	midium
Operation By				

Remark 13/5/25 100 kg. A 75.502

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 22/5/68

Description		Morning 09.00	Afternoon 21.00	Night 07.00
		Status [ Run , Off ]		
Pump Operating	No.1	1	-	-
	No.2	ON	-	-
	No.3	-	-	On
		Pressure Gauge Out [ Psi ]		
Sand Filter System Pressure	No.1	10	-	-
	No.2	10	-	-
	No.3	10	-	-
		Pump		
Strainers Cleaning	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
		Filter		
Back Wash ( 10 min.)	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)		CL 1.5	1.5	1.5
		PH 7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	19	19
		No.3	45	45
Surge Tank	Water Level [ High , Midium , Low ]	H	H	midium
Operation By				

Remark

## SWIMMING POOL LOG SHEET : DAILY

Date 21/5/68

Description		Morning 09:00	Afternoon 12:00	Night 09:00
Pump Operating	Status [ Run , Off ]			
	No.1	-	Off	-
	No.2	On	-	-
	No.3	-	On	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	13	15	13
	No.2	10	10	11
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	Off
		No.2	On	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	Off
		No.2	16	16
		No.3	95	95
Surge Tank	Water Level [ High , Midium , Low ]	High	High	Midium
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 23/05/68

Description		Morning 09:00	Afternoon 16:30	Night 09:15
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	10	10	10
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	10	10
	No.2	-	10	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	Off
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	Off
		No.2	-	17
		No.3	-	96
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Midium
Operation By				

Remark

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 19/05/18

Description		Morning <u>07.00</u>	Afternoon <u>17.00</u>	Night <u>01.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	10	10	10
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	OFF
		No.2	-	On
		No.3	-	On
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	-	15
		No.3	-	36
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	midium
Operation By				

Remark .....

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 19/05/18

Description		Morning <u>09.00</u>	Afternoon <u>16.00</u>	Night <u>01.00</u>
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	On	On	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	-
	No.2	10	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi
Operation By				

Remark .....

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 17.5-25

Description		Morning 9.00	Afternoon 16.00	Night 00.00	
Pump Operationing	Status [ Run , Off ]				
	No.1	1	-	-	
	No.2	ON	ON	-	
	No.3	-	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	10	-	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON	-
		No.2	-	-	-
		No.3	-	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-	-
		No.2	14	14	-
		No.3	95	95	-
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	Hi	
Operation By					

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 16/5/68

Description		Morning 9.00	Afternoon 17.00	Night 01.20
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	ON	-	-
	No.3	-	-	ON
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	90
	No.2	10	-	90
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	OFF	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	17	19
		No.3	95	95
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 15/5/68

Description		Morning 09.10	Afternoon 14.30	Night 19.10
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	ON	-	-
	No.3	-	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	10
	No.2	10	-	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	15	17
		No.3	25	23
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	midium
Operation By				

Remark .....  
 Recheck By ..... Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 14/5/68

Description		Morning 09.00	Afternoon 16.30	Night 01.30
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	ON	-	-
	No.3	-	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	-	10
	No.2	10	-	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	15	20
		No.3	25	25
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	Hi
Operation By				

Remark .....  
 Recheck By ..... Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 18-5-25

Description		Morning 16:00	Afternoon 16:30	Night 21:00	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	on	on	-	
	No.3	-	-	on	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	10	
	No.2	10	16	10	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash (10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	on	on	OFF
		No.2	-	-	on
		No.3	-	-	on
	Volume System Control [Display 0-100]	No.1	-	-	OFF
		No.2	91	19	45
		No.3	20	95	55
Surge Tank	Water Level [ High , Midium , Low ]	Hi	Hi	Hi	
Operation By					

Remark .....

Recheck By ..... Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 12-5-27

Description		Morning 9:00	Afternoon 16:30	Night 21:10
Pump Operationing	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	on	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.6	1.6
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	-	OFF
		No.2	-	on
		No.3	-	on
	Volume System Control [Display 0-100]	No.1	-	OFF
		No.2	-	45
		No.3	-	46
Surge Tank	Water Level [ High , Midium , Low ]	Hi	-	Hi
Operation By				

Remark .....

Recheck By ..... Chief Engineer

Description		Morning 08:00	Afternoon 16:00	Night 08:00
Pump Operating	Status [ Run, Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	On	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.6	1.8
	PH	7.6	7.6	7.8
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On, Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	-	-
		No.3	-	-
Surge Tank	Water Level [ High, Medium, Low ]	Hi	Hi	Hi
Operation By				

Remark

Recheck By

Chief Engineer

Description		Morning 08:00	Afternoon 16:00	Night 08:00
Pump Operating	Status [ Run, Off ]			
	No.1	-	-	-
	No.2	-	On	-
	No.3	On	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	10	-
	No.2	-	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	9.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On, Off ]	No.1	-	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	-	21
		No.3	-	98
Surge Tank	Water Level [ High, Medium, Low ]	Hi	Hi	Hi
Operation By				

Remark

Recheck By

SWIMMING POOL LOG SHEET : DAILY

Date 9/5/68

Description		Morning 09.00	Afternoon 14.00	Night 01.00
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	ON	ON
		No.3	ON	ON
	Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	10
No.2			10	10
No.3			-	-
Strainers Cleaning		Pump	No.1	-
	No.2		-	-
	No.3		-	-
	Back Wash (10 min.)	Filter	No.1	-
No.2			-	-
No.3			-	-
Chlorine & PH Test Results (Test kit manual)		CL	1.5	1.5
	PH	7.6	7.6	
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	75 kg
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On, Off]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	99	13
		No.3	85	85
Surge Tank	Water Level [High, Medium, Low]	H	H	H
Operation By				

Remark

Recheck By

Chief Engineer

SWIMMING POOL LOG SHEET : DAILY

Date 09/05/68

Description		Morning 09.00	Afternoon 14.00	Night 01.00
Pump Operationing	Status [Run, Off]	No.1	-	-
		No.2	-	-
		No.3	ON	ON
	Sand Filter System Pressure	Pressure Gauge Out [Psi]	No.1	-
No.2			10	10
No.3			10	10
Strainers Cleaning		Pump	No.1	-
	No.2		-	-
	No.3		-	-
	Back Wash (10 min.)	Filter	No.1	-
No.2			-	-
No.3			-	-
Chlorine & PH Test Results (Test kit manual)		CL	1.5	1.5
	PH	7.6	7.6	
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On, Off]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	99	13
		No.3	85	85
Surge Tank	Water Level [High, Medium, Low]	H	H	H
Operation By				

Remark

Recheck By

Chief Engineer

Description		Morning 09.00	Afternoon 14.00	Night 01.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	ON	-	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	-	10	-
	No.2	10	10	-
	No.3	10	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	94	94
		No.3	95	95
Surge Tank	Water Level [High, Medium, Low]	HI	HI	HI
Operation By				

Remark

Recheck By

Chief Engineer

Description		Morning 09.00	Afternoon 14.00	Night 03.00
Pump Operating	Status [Run, Off]			
	No.1	-	-	-
	No.2	-	ON	-
	No.3	-	ON	-
Sand Filter System Pressure	Pressure Gauge Out [Psi]			
	No.1	-	10	-
	No.2	-	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash (10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.6	1.5
	PH	7.6	7.6	7.6
Chemical Additional (kg)	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [On,Off]	No.1	ON	-
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100]	No.1	-	-
		No.2	94	94
		No.3	95	95
Surge Tank	Water Level [High, Medium, Low]	HI	HI	HI
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 5/5/68

Description		Morning	Afternoon	Night
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	ON	ON	-
	No.3	-	-	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	6	10	-
	No.2	6	10	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	ON
		No.2	-	-
		No.3	-	-
	Volume System Control [Display 0-100 ]	No.1	-	-
		No.2	100	100
		No.3	100	100
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	Hi
Operation By				

Remark

Recheck By

Chief Engineer

## SWIMMING POOL LOG SHEET : DAILY

Date 4/5/68

Description		Morning	Afternoon	Night
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	on
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	10	10	10
	No.2	6	10	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	ON	OFF
		No.2	-	ON
		No.3	-	ON
	Volume System Control [Display 0-100 ]	No.1	-	OFF
		No.2	-	10
		No.3	-	10
Surge Tank	Water Level [ High , Medium , Low ]	Hi	Hi	medium
Operation By				

Remark

Recheck By

Chief Engineer



**SWIMMING POOL LOG SHEET : DAILY**

Date 03/05/14

Description		Morning 07:00	Afternoon 19:00	Night 06:10
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	On	-
	No.3	-	-	On
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	15	10	10
	No.2	15	10	10
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	On	On
		No.2	-	-
		No.3	-	On
	Volume System Control [Display 0-100]	No.1	-	Off
		No.2	91	71
		No.3	45	45
Surge Tank	Water Level [ High , Medium , Low ]	High	High	Medium
Operation By				

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 04/05/14

Description		Morning 07:00	Afternoon 16:45	Night 05:00
Pump Operating	Status [ Run , Off ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	On	-
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Strainers Cleaning	Pump			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Back Wash ( 10 min.)	Filter			
	No.1	-	-	-
	No.2	-	-	-
	No.3	-	-	-
Chlorine & PH Test Results (Test kit manual)	CL	1.6	1.5	1.8
	PH	7.6	7.6	7.6
Chemical Additional ( kg )	Chlorine	-	-	-
	Soda Ash	-	-	-
	Sodium Bi-Sulphate Acid	-	-	-
	Salt	-	-	-
	Aluminium Sulphate	-	-	-
Salt Chlorinator	Status [ On,Off ]	No.1	Off	-
		No.2	19	On
		No.3	-	On
	Volume System Control [Display 0-100]	No.1	-	Off
		No.2	-	98
		No.3	-	45
Surge Tank	Water Level [ High , Medium , Low ]	High	High	High
Operation By				

Remark

Recheck By

Chief Engineer

**SWIMMING POOL LOG SHEET : DAILY**

Date 1/5/25

Description		Morning <u>08.45</u>	Afternoon <u>19.00</u>	Night <u>09.00</u>	
Pump Operationing	Status [ Run , Off ]				
	No.1	-	-	-	
	No.2	-	ON	-	
	No.3	ON	-	-	
Sand Filter System Pressure	Pressure Gauge Out [ Psi ]				
	No.1	10	10	-	
	No.2	10	10	-	
	No.3	-	-	-	
Strainers Cleaning	Pump				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Back Wash ( 10 min.)	Filter				
	No.1	-	-	-	
	No.2	-	-	-	
	No.3	-	-	-	
Chlorine & PH Test Results (Test kit manual)	CL	1.5	1.5	1.5	
	PH	7.6	7.6	7.6	
Chemical Additional ( kg )	Chlorine	-	-	-	
	Soda Ash	-	-	-	
	Sodium Bi-Sulphate Acid	-	-	-	
	Salt	-	-	-	
	Aluminium Sulphate	-	-	-	
Salt Chlorinator	Status [ On,Off ]	No.1	OFF	ON	-
		No.2	ON	-	-
		No.3	ON	-	-
	Volume System Control [Display 0-100]	No.1	OFF	-	-
		No.2	18	22	-
		No.3	85	45	-
Surge Tank	Water Level [ High , Midium , Low ]	midium	hi	Hi	
Operation By					

Remark .....

Recheck By

Chief Engineer

## ภาคผนวก 2.7

หลักฐานการจัดให้มีอุปกรณ์ไฟฟ้าประหยัดพลังงาน

QUOTATION

Date : 10 April 2023  
Ref : 0233051237P - G  
To : บริษัท ฟิวเจอร์ ฟิวเจอร์ จำกัด  
Attn : คุณนภ / แผนกช่าง  
Email : HB346-le2@accor.com  
Project : Novotel Bangkok Futurepark Rangsit - Guestroom

( Spare Part 10% = Tender + Additional )

Type	Description	Qty	Unit Price	Total Price
		Ter.	Barit	Barit
DL100 (all)	Bled DL601A Recessed adjustable downlight matt white color IP20 c/w Philip Master MR16 12V 7.5W 10Deg 2700K led & Remote Vossloh non dim 12V transformer	716	605.00	43,560.00
DL101 (all)	Bled DL601A Recessed adjustable downlight matt white color IP20 c/w Philip MR16 12V 7.5W 36Deg 2700K led & Remote Vossloh non dim 12V transformer	845	605.00	51,425.00
DL102 (all)	Bled DL808 Recessed fixeddownlight matt white color IP20 c/w 6W 36Deg 2700K CR190 & Remote non dim driver	233	625.00	14,375.00
DL103 (all)	Bled DL601A Recessed fixed downlight matt white color IP44 with glass diffuser c/w MR16 7.5W 36Deg 2700K CR190 lamp & Remote Vossloh 12V transformer	226	745.00	17,135.00
LE100 (all)	Bled 2835-180-14-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 14W/m 180leds 2700K CR880 24VDC led	586.5	270.00	15,930.00
LE101 (all)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 24W/m 120leds 2700K CR880 24VDC led	1867	280.00	52,360.00
LE102 (all)	Bled 2835-120-9-6-27-24-9-20 Recessed shelf light IP20 L 900mm with LS809 profile with frosted diffuser c/w 9 6W/m 120leds 2700K CR887 24VDC led	342.5	240.00	8,160.00
W100 (all)	Bled WA35125F Recessed wall light matt white color IP20 c/w 3W 2700K CR180 300mA led & Remote 300mA driver	153	980.00	14,700.00
รวม Power Supply ที่ใช้กับ Strip Light Type LE1xx				
	Remote 24VDC 15W power supply		325.00	
	Remote 24VDC 25W power supply		425.00	
	Remote 24VDC 35W power supply		455.00	
	Remote 24VDC 75W power supply		620.00	
	Remote 24VDC 100W power supply		676.00	
	Remote 24VDC 150W power supply		780.00	
	Remote 24VDC 200W power supply		1,040.00	
Total:				217,645.00
7% VAT:				15,235.15
Grand Total:				232,880.15

Remark : Type LE100, LE101, LE102 รับประกัน Power Supply ให้เวลา 3 ปี  
หากว่า วัสดุอุปกรณ์ไม่เพียงพอ ให้แจ้งบริษัทฯ Led Strip ที่ใช้ไม่ติดตะข

และ ราคาค่าบริการเปลี่ยนหลอดหลอด

QUOTATION

Date : 10 April 2023  
Ref : 0233051237P - F  
To : บริษัท ฟิวเจอร์ ฟิวเจอร์ จำกัด  
Attn : คุณนภ / แผนกช่าง  
Email : HB346-le2@accor.com  
Project : Novotel Future Rangsit - Façade

( Spare Part 10% = Tender + Additional )

Type	Description	Qty	Unit Price	Total Price
		Ter.	Barit	Barit
LE500 (all)	Facade Line DM1001-AS Surface Linear wall washer LED L1000mm with aluminium extrusion housing IP66 finish in dark grey c/w Lamp 20W 15° x 45° 3000K CR8-80 & Remote 24VDC power supply (Modify bracket center fitting L 200mm)	14	3,780.00	3,780.00
UP500 (all)	Shylon SL2128CC-12 recessed inground uplighter with stainless steel, tempered safety glass protection IP67 + Installation sleeve c/w Lamp LED 32W 3000K 80deg and Integral driver 220V	3	6,485.00	6,485.00
UP502 (all)	Shylon SL1140UF13 Surface Adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 30W 3000K 30Deg. CR8-80 and Integral driver 220V On/Off	14	4,220.00	8,440.00
UP503 (all)	Shylon SL1145FE-1 Surface Adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 10W 3000K 20Deg. CR8-80 and Integral driver 220V On/Off	12	2,915.00	2,915.00
UP504 (all)	Bled SL1145FE-1 Surface adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 10W 3000K 80deg. CR1>80 and Integral driver 220V On/Off	8	2,915.00	2,915.00
UP505 (all)	Shylon SL3220A-3 Surface LED window reveal luminaire with aluminium body glass protection IP67 finish in dark grey c/w Lamp 3W 3000K 2Deg x120Deg CR8-80 and Integral driver 220V On/Off	20	2,270.00	4,540.00
W500 (all)	Lipman LI-30022-T3-W30 Surface Wall mounted LED Asymmetric with aluminium body + glass protection IP65 Finish in Dark Grey color c/w Lamp LED 24-LED37W 3000K CR80-1268mm-4636mm beam angle 135x67Deg and Integral driver 220V on-off	8	11,645.00	11,645.00
W501 (all)	Shylon SL1140UF-E3 Surface Adjustable spotlight with aluminium body and glass protection IP67 finish in dark grey c/w 15W 3000K 12Deg. CR8-80 and Integral driver 220V On/Off	2	4,880.00	4,880.00
Sub-Total:				45,600.00
7% VAT:				3,192.00
Total:				48,792.00

Remark : ราคาค่าบริการเปลี่ยนหลอดหลอด ราคานี้รวมค่าติดตั้ง

Delivery : 6-8 Week from receipt of order confirmation; & or approval of sample(s) / drawing(s) & for confirmation of date of delivery, colour, dimensions, mounting. This excludes 2-4 weeks of summer holiday in Aug/Sept and 1 month year end holiday in December. This advice on delivery is only valid as at the date of this quotation, and is subject to our confirmation at the time of our receipt of your order confirmation.

1) It is valid only as at the date of this quotation. It is subject to our confirmation with the manufacturer upon receipt of official Purchase Order.

QUOTATION

Date : 10 April 2023  
Ref : 0233051/23/Ip - C&P  
To : บริษัท ฟิวเจอร์ ฟาอุร์พาร์ก จำกัด  
Attn : คุณกร / คุณนันทนา  
Email : H3346-1e2@accor.com  
Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300













( Spare Part 10% = Tender + Additional )

Type	Description	Qty	Unit Price	Total Price
		Ten.	Bar	Bar
DL200 (all)	<b>Corridor #200</b> Bled DL110.WH Recessed fixed downlight IP20 with honeycomb finish in matt black color c/w 6W 36deg 2700K CRI>90 575lm 220VDC led & Remote non-dim driver	181	63	244
DL201 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white color c/w Philip MR16 12V 7.5W 240deg 2700K led & Remote non-dim driver	131	14	145
DL202 (all)	Bled DL110.WH Recessed fixed downlight IP20 with honeycomb finish in matt black color c/w 6W 36deg 3000K CRI>90 575lm 220VDC led & Remote non-dim driver	21	6	27
LE200(all)	Bled 3528-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 14W/m 980lm 2700K CRI>80 24VDC led	361	242	602.8
LE201(all)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 24W/m 1800lm 2700K CRI>80 24VDC led	199	198.8	
LE202(all)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 24W/m 1800lm 2700K CRI>80 24VDC led	77	76.95	
Total : Corridor # 200				
DL300 (all)	<b>Public Area #300</b> Bled DL110.WH Recessed fixed downlight IP20 with honeycomb finish in matt white color c/w 6W 36deg 2700K CRI>90 575lm 220VDC led & Remote dal dimming driver	17	3	20
DL301 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Philip MR16 12V 7.5W 100deg 2700K CRI95 485lm led & Remote dal dimming driver	60	60	
DL302SP (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Sora MR16 CC 7.5W 100deg 2700K CRI95 485lm 12V led & Remote dal dimming driver	13	13	
DL302 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim with Spread lens c/w Philip MR16 12V 7.5W 10deg 2700K CRI95 485lm led & Remote dal dimming driver	8	8	
DL302SP (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim with Snap System 10deg-36deg c/w Sora MR16 CC 7.5W 100deg 2700K CRI95 485lm 12V led & Remote dal dimming driver	4	4	









Date : 10 April 2023  
Ref : 0233051/23/Ip - C&P  
To : บริษัท ฟิวเจอร์ ฟาอุร์พาร์ก จำกัด  
Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300

Type	Description	Qty	Unit Price	Total Price
		Ten.	Bar	Bar
DL303 (all)	Bled DL110.BK Recessed fixed downlight IP20 with honeycomb finish in matt black color c/w 6W 10deg 2700K CRI>90 575lm 220VDC led & Remote dal dimming driver	8	1	8
DL304 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Philip MR16 12V 7.5W 36deg 2700K CRI95 515lm led & Remote dal dimming driver (175 - 175ps Exclusive Lounge finish in matt black trim)	156	156	
DL304 (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt black trim c/w Philip MR16 12V 7.5W 36deg 2700K CRI95 515lm led & Remote dal dimming driver (Exclusive Lounge)	19	19	
DL304S (all)	Bled DL401 Recessed adjustable downlight IP20 finish in matt white trim c/w Philip MR16 12V 7.5W 36deg 2700K CRI95 515lm led & Remote 12VAC non-dim transformer	131	1	132
DL305 (all)	Bled DL401 Recessed adjustable downlight IP44 with glass diffuser finish in matt white color c/w Philip MR16 12V 7.5W 36deg 2700K CRI95 515lm led & Remote dal dimming driver	56	2	58
DL306 (all)	Bled Value 125 20641 Recessed fixed downlight IP44 with glass diffuser finish in matt white color c/w 25W 1760lm 36deg CRI90 2700K led & Remote dal dimming driver	169	33	202
DL304B (all)	Bled Value 125 20641 Recessed fixed downlight IP44 with glass diffuser finish in matt black color c/w 25W 1760lm 36deg CRI90 2700K led & Remote dal dimming driver	13	13	
DL307 (all)	Kozumi DD091-2820MM9027 Recessed downlight finish in matt white color c/w 28W 1836lm 20deg 2700K CRI90 led & Remote dal dimming driver	25	4	29
DL307B (all)	Kozumi DD091-2820MM9027 Recessed downlight finish in matt black color c/w 28W 1836lm 20deg 2700K CRI90 led & Remote dal dimming driver	7	7	
DL308 (all)	Tenda CLECI2R-B2715 Surface mounted spotlight with snoot aluminium body IP20 finish in matt black color c/w 12W 15x40deg 1080lm 2700K CRI>90 led & Remote 48VDC 100W driver & Dal dimming driver	12	12	
DL309 (all)	Bled AM- mini-D1 Recessed adjustable downlight c/w 2W 30Deg 2700K CRI90 led & Remote 500mA non-dim driver	23	23	
DL310 (all)	Bled KS3124 Surface Spotlight LED bled mount adjustable with aluminium body finish in matt white color c/w lamp LED COB 12W 2700K 700lm 15Deg & Remote non-dim driver	11	11	
DL311 (all)	Bled WCG6122W Recessed adjustable downlight IP44 with glass diffuser finish in matt white color c/w 10W 24Deg 2700K CRI>90 led & Remote dal dimming driver	5	5	

Date : 10 April 2023  
Ref : Q23305123Tp - C&P  
To : บริษัท ฟิวเจอร์ ปาร์ค จำกัด  
Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add				
DL312 (alt)	Acme Focus-B Recess adjustable downlight IP20 aluminium body finish in matt black color with honey comb c/w 12W 700lm 16Deg 2700K CRI80 led & Remote dali dimming driver	14			1	2,700.00	2,700.00
DL313 (alt)	Acme Focus-B Recess adjustable downlight IP20 aluminium body finish in matt black color with honey comb c/w 12W 670lm 25Deg 2700K CRI80 led & Remote dali dimming driver	14			1	2,700.00	2,700.00
DL314 (alt)	Acme Focus-B Recess adjustable downlight IP20 aluminium body finish in matt black color with honey comb & frosted sticker c/w 12W 640lm 36Deg 2700K CRI80 led & Remote dali dimming driver	3			1	2,950.00	2,950.00
DL315 (alt)	Aris CAC2M Surface mounted spotlight downlight aluminium body IP20 finish in Black color c/w Lamp Philips Master MR16 7W 10Deg 3000K CRI>90 12V	7			1	4,515.00	4,515.00
DL316 (alt)	Bled W68-005 Surface mounted spotlight downlight aluminium body IP20 with clear glass finish in Black color c/w Lamp Philips Master MR16 7W 10Deg 3000K CRI90 12V	1			1	2,500.00	2,500.00
LE300 (alt)	Bled 2835-120-9-6-27-24-9-20 Recessed shell light IP20 1900mm with LS809 profile c/w 9.6W/m 120leds 2700K CRI87 24VDC led	94.8	1.5		10	240.00	2,400.00
LE301 (alt)	Bled 2835-120-24-27-24-44 Flexible tape light IP44 with LS049 profile with frosted diffuser c/w 24W/m 120leds 2700K CRI80 24VDC led	923			92	280.00	25,760.00
LE303 (alt)	Bled 2216-120-9-6-27-24-20-9 Flexible led strip IP20 with LS049 aluminium profile with frosted diffuser c/w 9.6W/m 650lm 24VDC 2700K (Reception กระจกห้อง 5cm & Area ลิ้นชัก กระจก LS049)	139	2.5		14	240.00	3,360.00
LE303A (alt)	Bled 2216-120-14-27-24-44 Flexible tape light IP44 with LS049 aluminium profile with frosted diffuser c/w 14.4W/m 980lm 2700K CRI>80 24VDC led	216			22	270.00	5,940.00
LE303B (alt)	Bled 2216-60-4-8-27-24-20 Flexible led strip IP20 mounted on L048 aluminium profile with frosted diffuser c/w 4.8W/m 360lm 24VDC 2700K	16.4			2	215.00	430.00
LE304 (alt)	Line Decomint DM-1000AC Surface mounted linear uplighter IP20 finish in matt TBA color c/w 30W 2700K 15x35deg 24VDC led	6			1	3,780.00	3,780.00
	Remote 24VDC 150W power supply	2			1	780.00	780.00
	Remote SR-2302B Dali Interface dim	2			1	1,000.00	1,000.00
S300 (alt)	Bled KT 3321 Track mounted spotlight IP20 finish in matt white color c/w 25W 24Deg 2200m 2700K led & Remote dali dimming driver	120			12	2,215.00	26,580.00













Date : 10 April 2023  
Ref : Q23305123Tp - C&P  
To : บริษัท ฟิวเจอร์ ปาร์ค จำกัด  
Project : Novotel Bangkok Futurepark Rangsit - Public Area #200 , #300

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add				
S302 (alt)	Tenda MP-S108-WG30 Track spotlight finish in matt black color c/w 8W 38Deg 48VDC 640lm 2700K CRI>90 led & Remote dali dimming driver	4			1	2,310.00	2,310.00
S303 (alt)	Tenda MP-S108-WG30 Track spotlight finish in matt black color c/w 8W 15Deg 48VDC 640lm 2700K CRI>90 led & Remote dali dimming driver	30			3	2,310.00	6,930.00
T300 (alt)	Tenda Mpower MP-SUR-TRI08 Rod surface mounted track IP20 with suspension MP-KIT-SUS01 finish in matt black color <b>หมายเหตุ Tender 4M (ใช้จริง=12M, สั่งเป็น 30.2-20M, ลงรหัส=12M)</b>	12			1	3,970.00	3,970.00
T301 (alt)	Powergear Recessed track 3-Circuit finish white with L7000mm (Ballroom ใหญ่ 3 ห้อง = 12Set)	12			1	4,765.00	4,765.00
	Powergear Rod surface mounted track 3-Circuit finish white with L7000mm (Ballroom เล็ก 2 ห้อง = 8Set)	8			1	4,765.00	4,765.00
	<b>Remark</b> 1 Set = Track 3 Circuit 2Mx3 + 1Mx3 + Live-end 1 + Joint 3 + End cap 1 1 Room = 4Set ; (Total 5 Room = 20 Set)						
T302	Tenda SU-MT100 Rod surface mounted magnetic track with SUS-MTCON suspended kit with PCB-CON50 PCB connector and SU-MTAC end cap finish in matt black color <b>หมายเหตุ Tender 12M (ใช้จริง=32M, โยดส่งมาจาก T300=20M)</b>	12	20		3	5,150.00	15,450.00
UP300 (alt)	Bled CO29-01A Recessed inground uplight with Stainless Steel body and tempered glass protection IP67 finish in Stainless Steel color c/w 2.6W CRI90 2700K 150deg 24VDC led	17			2	1,190.00	2,380.00
W300 (alt)	Bled Karen PX-1900-GRI Surface wall light IP44 aluminium body finish in Gold color c/w Philip Master GU10 5W 395lm 36Deg 3000K CRI>90 220V led	7			1	1,190.00	1,190.00
Total : Public Area #300							230,730.00
<b>รายการ Power Supply ที่ใช้กับ Spotlight Type LE2xx-LE3xx</b>							
	Remote 24VDC 15W power supply					325.00	
	Remote 24VDC 25W power supply					425.00	
	Remote 24VDC 35W power supply					455.00	
	Remote 24VDC 75W power supply					620.00	
	Remote 24VDC 100W power supply					676.00	
	Remote 24VDC 150W power supply					780.00	
	Remote 24VDC 200W power supply					1,040.00	
<b>Remark</b> : Type UP300 ใช้ร่วมกับ Power Supply, เนื่องจากขนาด Wall ของหลอดไฟ ที่ใช้กับระบบ Led Strip ที่ใช้บนโต๊ะ-จอ และ กระจกใตกรเบอร์ดานบนโต๊ะจอ							Total : 288,610.00 7% VAT : 20,202.70
Grand Total :							308,932.70











QUOTATION

Date : 10 April 2023  
Ref : Q23305123Tp - L&S  
To : บริษัท ฟิวเจอร์ แลนด์สเคป จำกัด  
Attn : คุณก / คุณนพชา  
Email : Hb346-1e2@aor.com  
Project : Novotel Future Rangsit Landscape - Landscape & Swimming Pool

( Spare Part 10% = Tender + Additional )

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add Total				
B400 (alt)	Landscape & Swimming Pool Ligman AB-10001-W30-ND-01 Surface bollard Asymmetric 26x75x320cm with aluminum housing glass diffuser protection IP65 finish in TBA color c/w Led 11W 3000K 102x70deg 765lm CRI80 (Ground Floor & Spirit House)	12	12		1	13,670.00	13,670.00
DL400	Neko SSR5-9303513F-B-54 Recessed trimless fixed downlight LED with aluminum body cover diffuser IP54 finish in matt black color c/w Lamp LED COB 13W 3000K 900lm 35Deg 350mA and Remote Driver Nondim (Swimming Pool)	10	10		1	1,740.00	1,740.00
DL401 (alt)	Bled BernerS 30225-1SD Spotlight LED COB with aluminum body and glass protection IP65 with honeycomb + tree strap finish in matt black color c/w Lamp LED Cree COB 10W 631lm 3000K 150deg. Intergral Driver input 220V (Ground Floor)	11	11		1	2,275.00	2,275.00
DL402 (alt)	Bled LEGO-OUT-3 (6-Head) Recessed mini Linear LED with aluminum body cover glass protection IP65 finish in matt black color c/w Lamp 10W 36Deg. 2700K and Remote Driver 500mA Non-dim (Ground Floor)	29	29		3	3,780.00	11,340.00
DL402A (alt)	Bled LM-L291-27-100-N Recessed mini Linear LED L 291mm IP65 aluminum body and cover glassfinish in matt black color c/w Lamp 20W 1600lm 100Deg 2700K led and Remote Driver Non-dim (Ground Floor)	30	30		3	5,250.00	15,750.00
DL403 (alt)	Bled LM-L291-27-36D-N Recessed mini Linear LED L 291mm IP65 aluminum body and cover glassfinish in matt black color c/w Lamp 20W 1700lm 36Deg 2700K led and Remote Driver Non-dim (Ground Floor)	3	3		1	5,250.00	5,250.00
LE-400 (alt)	KPG C4TL0657 Recessed Linear Underwater LED L 250mm. with stainless steel 316 body & protection glass IP68 + Mounting Sleeve ABS 039# c/w Lamp 6x2W 3000K 45°735° CRI>85 12Vdc (Ground Floor)	3	3		1	8,125.00	8,125.00
LE-401 (alt)	Remote power supply LPV60-12Vdc IP67 Bled LY-NS-T1212-W27 Flexible neon light IP67 with aluminium profile c/w 10Wlm 484lm 2700K CRI>80 24VDC led (Ground Floor - Pizza Kitchen and Terrace & Swimming Pool)	1	1		1	600.00	
LE-401 (alt)	Remote power supply LRS200-24Vdc Bled LY-NS-T1212-W27 Flexible neon light IP67 with aluminium profile c/w 10Wlm 484lm 2700K CRI>80 24VDC led (Ground Floor)	78.2	78.2		8	806.00	6,448.00
LE-402 (alt)	Lime DM1001-AS Surface Linear wall washer LED L1000mm. with aluminum extrusion housing IP66 finish in dark grey color c/w Lamp 20W 15° x 45° 3000K CRI>80 (Modify bracket center fitting L100mm) (Ground Floor)	38	38		4	3,760.00	15,120.00
LE-403 (alt)	Remote power supply LRS200-24Vdc SP Conour Cont V LM10 Flexible vertical bending IP67 with CONT V LM10 SS PROFILE 1M c/w 12W 2700K 900m 24VDC led (Ground Floor)	5	5		1	1,040.00	1,040.00
LE-403 (alt)	Remote power supply LRS200-24Vdc SP Conour Cont V LM10 Flexible vertical bending IP67 with CONT V LM10 SS PROFILE 1M c/w 12W 2700K 900m 24VDC led (Ground Floor)	4	4		1	3,240.00	3,240.00

Date : 10 April 2023  
Ref : Q23305123Tp - L&S  
To : บริษัท ฟิวเจอร์ แลนด์สเคป จำกัด  
Project : Novotel Future Rangsit Landscape - Landscape & Swimming Pool

Type	Description	Qty		Picture	Spare 10%	Unit Price Baht	Total Price Baht
		Ten.	Add Total				
P400 (alt)	Stylon SL1137LFE-6 Pole Top Luminaire Adjustable Surface mounted led spotlight IP67 aluminum body with pole custom L 4000 finish in dark grey color c/w lamp 30w 10 x 70deg 3000K & intergal driver input 220V (Ground Floor)	30	30		3	17,685.00	53,055.00
UP400 (alt)	Bled SL1240S-1 Surface spotlight IP66 aluminum housing with protection tempered glass cover finish in matt black color c/w LED 1x10W Cree 3000K 30Deg (Ground Floor & Swimming Pool)	100	100		10	1,750.00	17,500.00
UP402 (alt)	Remote Power Supply LPV20-24Vdc IP67 Bled RB-IO23 Recessed inground uplighter with Honeycomb louver + housing box IP67 c/w 9W 150deg 3000K 24Vdc led (Ground Floor - Pizza Kitchen and Terrace & Swimming Pool)	9	9		1	1,945.00	1,945.00
UP403 (alt)	Remote power supply LPV35-24Vdc IP67 UL-25-W-COB-2500-EH Recessed inground uplight with stainless steel and protection glass protection IP67 with box housing c/w Cree COB 25W 2700K 110deg input 220V (Ground Floor)	2	2		1	535.00	535.00
UP404 (alt)	Bled-LOE051/H5 Recessed inground uplight LED with aluminum housing and stainless steel trim cover clear glass protection IP67 c/w Lamp LED Cree 1x3W 2700K 150deg 700mA and remote driver 700mA Nondim (Spirit House)	1	1		1	1,875.00	1,875.00
UP405 (alt)	Bled 30257 mini Spotlight LED with aluminum housing and cover glass protection finish in matt white c/w Lamp Cree 3W 3000K 10Deg 19lm and Remote driver (Spirit House)	10	10		1	2,250.00	2,250.00
W400 (alt)	Bled EL4024 Surface wall mounted with aluminium body IP65 finish in white color c/w Lamp Led 6W 3000K 120Deg led & intergal driver Input 220V (Ground Floor)	2	2		1	2,160.00	2,160.00
W400 (alt)	Bled EL4024 Surface wall mounted with aluminium body IP65 finish in dark grey color c/w Lamp Led 6W 3000K 120Deg led & intergal driver Input 220V (Swimming Pool)	8	8		1	2,160.00	2,160.00
Accessories	F4301000 Box for installation	8	8		1	520.00	520.00
W401	Bled LY-NS-T1212-W27 flexible neon light IP67 with aluminium profile c/w 10Wlm 484lm 2700K CRI>80 24VDC led (Swimming Pool)	28	28		3	696.00	2,088.00
W402 (alt)	Bled EL4008 Surface wall mounted down LED with aluminium body and glass protection IP65 finish in matt white color c/w lamp 9W Wide Flood 3000K and intergal driver 220V (Ground Floor)	8	8		1	1,945.00	1,945.00





HomePro (Future Park Rungsi) Branch 000133  
126 phahonyothin road, prachathipat, thanyaburi  
TH - 12130 PATHUM THANI

Purchase Order	
Order Number	32572198551934RFWEWE #020081
Order date	23.06.2023 09:04:00
Date of delivery	24.06.2023
Currency	Thai baht

**Invoice address**  
Pipat Development Co.,Ltd. (Branch 00001)  
Novotel Bangkok Future Park Rangsit  
VAT registration number: 0105562188928  
114 Pahonyothin Road, Prachathipat, Thanyaburi  
TH - 12130 Pathumthani

**Delivery address**  
Novotel Bangkok Future Park Rangsit  
Call 02-5202525 EXT 1708-1709  
114 Pahonyothin Road, Prachathipat, Thanyaburi  
TH - 12130 - Pathumthani  
Property Operation & Maintenance

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (packaging units)	Total
1	LED Light bulb, PHILIPS, cool daylight, 12W, E27 (21 - Property Operation & Maintenance) For public area APP325252318384533_3	99-452144	1 piece/unit / piece/unit	154.21 7%	3,000	462.62 495.00

Total value of order			THB	Net amount	Tax	Gross Amount
				462.62	32.38	495.00

Delivery information	-
Terms of delivery	
Terms of payment	
Digitally authorized by	GM - Pierre-Yves VIOU FC - Konate Charoensook Purchasing Assistant Mgr. - Haruethai Intrama Chief Engineer - Wattana Juiphan
Contact Buyer	Purchasing Assistant Mgr. - Haruethai Intrama 025202525 HB346-PU2@accor.com HB346-GL@accor.com Client number: <b>Tax registration number: 0105562188928</b>
Contact Supplier	
Terms and conditions	Tax registration number: 0107544000043

Kranes Co., Ltd (Head Office)  
324/9,11 Bangna Residence Tower, 1st Floor,  
Sanphawut Road, Bangna Nua, Bangna  
TH - 10260 Bangkok

Purchase Order	
Order Number	32572119347301REZMRW #018934
Order date	26.05.2023 14:44:00
Date of delivery	31.05.2023
Currency	Thai baht
Confirmed	-

**Invoice address**  
Pipat Development Co.,Ltd. (Branch 00001)  
Novotel Bangkok Future Park Rangsit  
VAT registration number: 010556218928  
T14 Paholyothin Road, Prachathipat, Thanyaburi  
TH - 12130 Pathumthani  
Property Operation & Maintenance

**Delivery address**  
Novotel Bangkok Future Park Rangsit  
Call 02-5202525 EXT 1708-1709  
T14 Paholyothin Road, Prachathipat, Thanyaburi  
TH - 12130 - Pathumthani  
Property Operation & Maintenance

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (packaging units)	Total
1	Light, panel, LED, Panel48, 48W, 6500K, 60x60cm (21 - Property Operation & Maintenance) Lighting for back office. APP32572315901863_3	Kranes1369	1 piece/unit / piece/unit	1020.00 7%	4.000	4'080.00 4'365.60

Total value of order		THB	Net amount	Tax	Gross Amount
			4'080.00	285.60	4'365.60

Delivery information	-
Terms of delivery	2 days after receive PO
Terms of payment	Credit 30 days/ For new customer and upcountry by cash only
Digitally authorized by	GM - Pierre-Yves VIOU FC - Konate Charoensook Purchasing Assistant Mgr. - Haruethai Intrama Chief Engineer - Wattana Juphan
Contact Buyer	Purchasing Assistant Mgr. - Haruethai Intrama 025202525 HB346-PU2@accor.com HB346-GL@accor.com Client number: 325721 Tax registration number: 010556218928
Contact Supplier	Khun Sudarat Payngam +66 2 744 8457 sales@kranes-tools.com Tax registration number: 0105547161097
Terms and conditions	-

Lighting & Equipment PL Co., Ltd.  
TH - 10400 Bangkok

Purchase Order	
Order Number	3257219959491REZDPE #018908
Order date	26.05.2023 08:12:00
Date of delivery	27.05.2023
Currency	Thai baht

**Invoice address**  
Pipat Development Co.,Ltd. (Branch 00001)  
Novotel Bangkok Future Park Rangsit  
VAT registration number: 010556218928  
T14 Paholyothin Road, Prachathipat, Thanyaburi  
TH - 12130 Pathumthani  
Property Operation & Maintenance

**Delivery address**  
Novotel Bangkok Future Park Rangsit  
Call 02-5202525 EXT 1708-1709  
T14 Paholyothin Road, Prachathipat, Thanyaburi  
TH - 12130 - Pathumthani  
Property Operation & Maintenance

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (packaging units)	Total
1	Light Bulb, LED ST64 FIM 5W WW E27 DIM L&E (21 - Property Operation & Maintenance) For spare parts of lights in front of Meeting room and Public area. APP32572316087079_3	99-669616	1 piece/unit / piece/unit	112.15 7%	10.000	1'121.50 1'200.01




Total value of order		THB	Net amount	Tax	Gross Amount
			1'121.50	78.51	1'200.01

Delivery information	-
Terms of delivery	
Terms of payment	
Digitally authorized by	GM - Pierre-Yves VIOU FC - Konate Charoensook Purchasing Assistant Mgr. - Haruethai Intrama Chief Engineer - Wattana Juphan
Contact Buyer	Purchasing Assistant Mgr. - Haruethai Intrama 025202525 HB346-PU2@accor.com HB346-GL@accor.com Client number: Tax registration number: 010556218928
Contact Supplier	02-2488133 Tax registration number:
Terms and conditions	-

# **HI-TEK®** สวิตช์แสงแดด Daylight sensor switch

สวิตช์แสงแดด HI-TEK เป็นอุปกรณ์ซึ่งจะควบคุมการเปิด-ปิดไฟอัตโนมัติ โดยจะเปิดอัตโนมัติเมื่อแสงแดดอ่อนลง และจะปิดอัตโนมัติเมื่อแสงแดดจ้า สามารถใช้กับหลอดไฟชนิดต่าง ๆ ได้ตั้งแต่ 3 โวลต์, 6 โวลต์ และ 10 โวลต์

HI-TEK DAYLIGHT SENSOR SWITCH is an easy and effective way to control light. It will switch light on at dusk and off at dawn.  
HI-TEK DAYLIGHT SENSOR SWITCH is available in 3A, 6A and 10A.  
It can be used to control all kinds of lamps including LED.

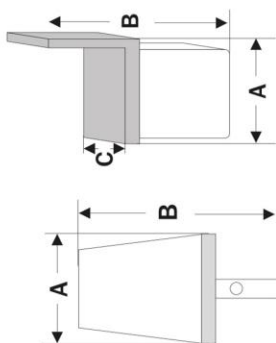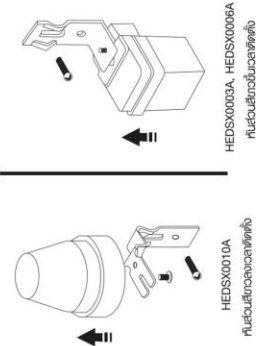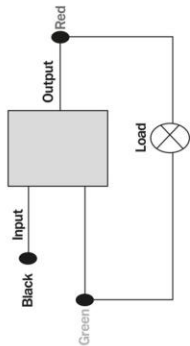

Model / รุ่น	Length / ยาว L-(mm)	Width / กว้าง W-(mm)	Height / สูง H-(mm)
HEDSX0003A	35	43	95
HEDSX0006A	35	43	95
HEDSX0010A	60	75	60

Model / รุ่น	Volt / โวลต์	Operating current (A) / กระแสไฟฟ้า (แอมป์)	Retail Price (Bath) / ราคาปลีก (บาท)
HEDSX0003A	220	3	205.-
HEDSX0006A	220	6	205.-
HEDSX0010A	220	10	285.-

\*จำนวนกล่องบรรจุ / Carton Packing (pcs) 50 กล่อง

## สวิตช์แสงแดด

ภาคผนวก 2.8  
หลักฐานการจัดให้มีการดูแลระบบปรับอากาศ  
ภายในโครงการ



# Filter Cleaning In Guest Room (2025)

Floor 3			Floor 4		Floor 5		Floor 6		Floor 7		Floor 8		Floor 9		Floor 10		Floor 11								
307	KCB		401	KCB	22-Mar-25	501	KCB	8-Apr-25	601	KCB	15-Mar-25	701	KCB	9-Apr-25	801	KCB	7-Jul-25	1001	KCB	12-Mar-25	1101	KCB	7-Jun-25	17-Jun-25	
308	TBR	2-Apr-25	402	TBR	3-May-25	502	TBR	3-Apr-25	602	TBR		702	TBR	27-Jan-25	802	TBR		902	TBR	12-Mar-25	1102	TBR	19-Jun-25	4-Feb-25	
309	KCB	2-May-25	403	KCB	6-May-25	503	KCB	6-Apr-25	603	KCB		703	KCB	10-Mar-25	803	KCB		903	KCB		1103	KCB		18-Mar-25	
310	KCB	30-Apr-25	404	TBR	21-Mar-25	504	TBR	5-Apr-25	604	TBR	15-Mar-25	704	TBR	9-Apr-25	804	TBR	4-May-25	904	TBR	8-Jun-25	1104	TBR	4-Jul-25	24-Feb-25	
311	TBR	29-Jan-25	405	KCB	3-May-25	505	KCB	5-Apr-25	605	KCB		705	KCB	12-Mar-25	805	KCB	30-Jun-25	905	KCB	8-Jun-25	1105	KCB	18-Apr-25	22-Mar-25	
312	KCB	27-Apr-25	406	TBR	28-Jun-25	506	TBR	30-Jun-25	606	TBR		706	TBR	10-Mar-25	806	TBR	30-Jun-25	906	TBR	8-Jun-25	1106	TBR	6-Jun-25	30-Apr-25	
314	TBR	2-Apr-25	407	KCB	18-Jun-25	507	KCB	7-Apr-25	607	KCB	24-May-25	707	KCB	29-Mar-25	807	KCB	26-May-25	907	KCB	1-Jul-25	1107	KCB		30-Jun-25	
315	KCB	27-Apr-25	408	TBR	27-Apr-25	508	TBR	30-Jun-25	608	TBR	8-Jun-25	708	TBR	9-Apr-25	808	TBR	22-May-25	908	TBR	8-Jun-25	1108	TBR	17-Jun-25	24-Feb-25	
316	TBR	5-Feb-25	409	KCB	28-Jan-25	509	KCB	3-Feb-25	609	KCB	17-May-25	709	KCB	10-Apr-25	809	KCB	20-Apr-25	909	KCB	18-Apr-25	1109	KCB	9-Jun-25	18-Mar-25	
317	KCB	26-May-25	410	KCB	6-Feb-25	510	KCB	3-Feb-25	610	KCB	19-Apr-25	710	KCB	10-Apr-25	810	KCB	10-Feb-25	910	KCB	24-Mar-25	1110	KCB	27-Mar-25		
318	TBR	23-Mar-25	411	TBR	6-Feb-25	511	TBR	31-Jan-25	611	TBR		711	TBR	11-Mar-25	811	TBR	24-Mar-25	911	TBR	1-May-25	1111	TBR	13-Mar-25		
319	TBR	2-May-25	412	TBR	20-Mar-25	512	TBR	3-Feb-25	612	TBR	15-Mar-25	712	TBR	28-Jan-25	812	TBR	17-Jun-25	912	TBR	28-Mar-25	1112	TBR	12-Apr-25	30-Jun-25	
320	TBR	20-Apr-25	414	TBR	20-Mar-25	514	TBR	31-Jan-25	614	TBR	30-Mar-25	714	TBR	11-Mar-25	814	TBR	5-May-25	914	TBR	24-Mar-25	1114	TBR	5-Jul-25	18-Mar-25	
321	BRCD	24-May-25	415	TBR	28-Jun-25	515	TBR	28-Jan-25	615	TBR		715	TBR	13-Apr-25	815	TBR	1-Apr-25	915	TBR	18-Apr-25	1115	TBR		23-Mar-25	
322	TBR	30-Mar-25	416	TBR	4-Apr-25	516	TBR	7-Apr-25	616	TBR	7-Jul-25	716	TBR	13-Apr-25	816	TBR	4-May-25	916	TBR	13-Mar-25	1116	TBR	4-Jul-25	22-Mar-25	
323**	BRCD	1-Jul-25	417	TBR	22-May-25	517	TBR	7-Apr-25	617	TBR	1-Jul-25	717	TBR	18-Mar-25	817	TBR		917	TBR	31-Mar-25	1117	TBR	5-Jul-25	24-Feb-25	
324	TBR	31-Mar-25	418	TBR	6-May-25	518	TBR	2-Apr-25	618	TBR	15-Jun-25	718	TBR	18-Mar-25	818	TBR	1-May-25	918	TBR		1118	TBR	15-Apr-25	30-Jun-25	
325	BRCD	28-Apr-25	419	TBR		519	TBR	8-Apr-25	619	TBR	18-Jun-25	719	TBR	18-Mar-25	819	TBR	10-Feb-25	919	TBR	14-Mar-25	1119	TBR	9-Jun-25	29-May-25	
326	KCB	28-Apr-25	420	TBR	6-Feb-25	520	TBR	8-Apr-25	620	TBR		720	TBR	14-Apr-25	820	TBR	2-May-25	920	TBR	19-Apr-25	1120	TBR	27-Mar-25	5-May-25	
327	TBR		421	KCB	4-Apr-25	521	KCB	23-Mar-25	621	KCB		721	KCB	14-Apr-25	821	KCB	10-Feb-25	921	KCB	31-Mar-25	1121	KCB			
328	KCB		422	TBR	30-Mar-25	522	TBR	8-Apr-25	622	TBR	28-Apr-25	722	TBR	10-Mar-25	822	TBR	9-Jun-25	922	TBR	5-Feb-25	1122	TBR	5-Jul-25	8-Jun-25	
Total	18	423	KCB	6-May-25	523	KCB	13-Mar-25	623	KCB	15-Jun-25	723	KCB	11-Mar-25	823	KCB	5-Feb-25	923	KCB		1023	KCB	1127	KCB	9-Jun-25	4-Feb-25
		424	TBR		524	TBR	3-Apr-25	624	TBR	21-Mar-25	724	TBR	27-Jan-25	824	TBR	27-Jun-25	924	TBR	28-Mar-25	1024	TBR	1128	TBR	6-Jun-25	
425		BRCA		525	BRCA	29-Jun-25	625	BRCA	6-Jul-25	725	BRCA	28-Mar-25	825	BRCA	7-May-25	925	BRCA		1025	BRCA	Total			19	
427**		TBR	4-Feb-25	527	TBR	31-Jan-25	627	TBR	22-May-25	727	TBR	29-Jan-25	827	TBR	1-Apr-25	927	TBR	14-Mar-25	1027	TBR	DONE		27-Mar-25	196	
428**		KCB	24-May-25	528	KCB	5-Apr-25	628	KCB	21-Mar-25	728	KCB	28-Mar-25	828	KCB	1-Apr-25	928	KCB	14-Mar-25	1028	KCB		Room Remain	15-Apr-25	30	
Total		23	Total	26	Total	18	Total	26	Total	23	Total	22	Total	21											
Update 07/07/2025																									

86.73 %

ภาคผนวก 2.9  
ข้อกำหนดและข้อปฏิบัติของผู้พักอาศัย  
ภายในโครงการ

## WELCOME TO NOVOTEL BANGKOK FUTURE PARK RANGSIT

### 1) THE HOTEL WILL BE HELD RESPONSIBLE FOR A LOSS OR DAMAGE OF GUEST'S PROPERTY AS FOLLOWING;

- 1.1 The loss or damage occurs in the hotel.
- 1.2 *Should the lost or damaged property following article 11 is cash, gold, bill of exchange, jewelry or other valuable items, the hotel shall be responsible for the maximum amount of 5,000.00 Thai Baht unless the guest does declare the value of item and deposit his/her property to the hotel.*

### 2) THE HOTEL SHALL NOT BE LIABLE FOR ANY LOSS OR DAMAGE RESULTING FROM;

- 2.1 A force majeure event.
- 2.2 An existing condition of the article.
- 2.3 A loss or damage caused from guest or his/her visitor.

### 1. โรงแรมรับผิดชอบทรัพย์สินของผู้เข้าพักกรณีเกิดการสูญหายหรือเสียหายดังนี้:

- 1.1 การสูญหายหรือเสียหายที่เกิดขึ้นในโรงแรม
- 1.2 หากทรัพย์สินสูญหายตามข้อ 1.1 เป็นประเภทเงิน ทอง สมบัติ ตัวเงิน ทรัพย์สิน หรือของมีค่าอื่นๆ โรงแรมรับผิดชอบไม่เกินวงเงิน 5,000.00 บาท เว้นแต่ผู้เข้าพักจะแจ้งมูลค่าและแจ้งรายการทรัพย์สินนี้ไว้กับโรงแรม

### 2. โรงแรมขอสงวนสิทธิ์ในความรับผิดชอบ หากความสูญหายหรือเสียหายดังกล่าวเกิดขึ้นเพราะเหตุดังต่อไปนี้

- 2.1 เหตุสุดวิสัย
- 2.2 เหตุแห่งสภาพของทรัพย์สินนั้นๆ
- 2.3 เป็นความรับผิดชอบของผู้เข้าพัก บริษัท หรือบุคคลที่ผู้เข้าพักให้การยอมรับ



## Welcome

Your health and safety is our priority. We've established **very strict cleaning protocol** across our hotels and particular care is taken when **cleaning and disinfecting guest rooms**.

If for any reason you feel unwell during your stay, please remain in your room and contact reception.

Our breakfast hours and food and drinks menus are available in your room.

**Before you leave**, please help us maintain sanitary measures by:

- putting all of your waste in the bin,
- putting your used towels in either the sink, the shower cubicle or bathtub,
- leaving the window open.


Please remember to maintain social distancing while you're in the hotel for the sake of your health and the safety of our staff and guests. Thank you. We hope you enjoy your stay with us.



Avoid touching surfaces as much as possible.




To contain the virus, please keep at least 1.5 meters from other people.



Only one person per lift at a time, please.



Please drop your room key-card in the box by reception when you check out.



Please pay by credit card.

Thank you.



## NOVOTEL BANGKOK FUTURE PARK RANGSIT HOTEL INFORMATION

Please note that TV screen damages  
are chargeable up to THB 20,000



## NOVOTEL BANGKOK FUTURE PARK RANGSIT HOTEL INFORMATION

Please note that TV screen damages  
are chargeable up to THB 20,000



# NOVOTEL NOVOTEL

BANGKOK FUTURE PARK RANGSIT

BANGKOK FUTURE PARK RANGSIT

### Safety Box instruction

#### Locking the safety box

- Close the safety box's door.
- Key in personal 4-6 digit numbers, eg. 123456.
- Press the "LOCK" button.
- Safety box display will show "LOCK" once it is locked successfully.

#### Opening the safety box

- Key in the same personal digits numbers, eg. 123456.
- Safety box will open accordingly.

### Safety Box instruction

#### Locking the safety box

- Close the safety box's door.
- Key in personal 4-6 digit numbers, eg. 123456.
- Press the "LOCK" button.
- Safety box display will show "LOCK" once it is locked successfully.

#### Opening the safety box

- Key in the same personal digits numbers, eg. 123456.
- Safety box will open accordingly.





NOVOTEL BANGKOK FUTURE PARK RANGSIT  
HOTEL INFORMATION



NOVOTEL BANGKOK FUTURE PARK RANGSIT  
HOTEL INFORMATION



ภาคผนวก 2.10  
รายงานการตรวจสอบอาคารประจำปี

Performax Building Service Co., Ltd  
24/4 Kasemsan 1, Param 1 Rd., Wangmai, Pratum Wan  
TH - 10330 Bangkok

Purchase Order	
Order Number	32572199163338TDITG9 #053923
Order date	09.04.2025 19:34:00
Date of delivery	11.04.2025
Currency	Thai baht

**Invoice address**  
Pipat Development Co.,Ltd. (Branch 00001)  
Novotel Bangkok Future Park Rangsit  
VAT registration number: 0105562188928  
114 Paholyothin Road, Prachathipat, Thanyaburi  
TH - 12130 Pathumthani

**Delivery address**  
Novotel Bangkok Future Park Rangsit  
Call 02-5202525 EXT 1708-1709  
114 Paholyothin Road, Prachathipat, Thanyaburi  
TH - 12130 - Pathumthani  
Property Operation & Maintenance

Position	Item name	Article no.	Order unit	Price per order unit	Quantity (order units)	Total
1	Annual Quality Building, Earthquake Check of 2025 (21 - Property Operation & Maintenance) for building inspection following earthquake 28 Mar 25 APP32571619439583_3	99-996940	1 piece/unit / piece/unit	25'000.00 7%	1.000	25'000.00 26'750.00

<b>Total value of order</b>		Amount(net)	25'000.00
		THB Tax	1'750.00
		Amount(gross)	26'750.00

Delivery information	-
Terms of delivery	
Terms of payment	
Digitally authorized by	GM - Pierre-Yves VIOU Cluster Director of Finance - Ginna Tongsalee Purchasing Assistant Mgr. - Haruethai Intarama Chief Engineer - Wattana Juiphan
Contact Buyer	Purchasing Assistant Mgr. - Haruethai Intarama 025202525 Haruethai.intarama@accor.com hb346-gl@accor.com Client number: <b>Tax registration number: 0105562188928</b>
Contact Supplier	081-6160704 performaxteam@gmail.com Tax registration number: 0105550038438
Terms and conditions	All Supplies have to concern about environmental, climate change and sustainability initiatives, including information about Green Key About the reduction in the use of resources , the use of cleaner and resource friendly alternatives ( including transportation) and the commitment to social standard



## ผลการสำรวจความเสียหายขั้นต้นหลังจากเหตุการณ์แผ่นดินไหว

วันที่ 6 เมษายน 2568  
เรื่อง แจ้งผลการสำรวจความเสียหายของโครงสร้างอาคาร จากเหตุการณ์แผ่นดินไหว วันที่ 28 มีนาคม 2568  
อาคาร โรงแรม โนโวเทล กรุงเทพฯ พิวเจอร์พาร์ค รังสิต

บริษัท เพอร์ฟอร์มแมกซ์ บิวติง เซอร์วิส จำกัด ซึ่งเป็นผู้ตรวจสอบอาคารประเภทนิติบุคคล เลขทะเบียน น. 0081/2550 ได้ดำเนินการสำรวจพื้นที่ของอาคาร โรงแรม โนโวเทล กรุงเทพฯ พิวเจอร์พาร์ค รังสิต เมื่อวันที่ 6 เมษายน 2568 ภายหลังเหตุการณ์แผ่นดินไหวที่เกิดขึ้นในวันที่ 28 มีนาคม 2568 โดยอ้างอิงตามคู่มือการสำรวจความเสียหายขั้นต้นของโครงสร้างอาคารหลังจากเหตุการณ์แผ่นดินไหวของกรมโยธาธิการและผังเมือง กระทรวงมหาดไทย พ.ศ. 2560

จากผลการตรวจสอบเบื้องต้น พบว่าอาคารไม่มีความเสียหายที่ส่งผลกระทบต่อความสามารถในการใช้งาน ซึ่งจัดอยู่ในระดับความเสียหายประเภทสีเขียว (อาคารสามารถใช้งานได้ตามปกติ) อย่างไรก็ตาม บริษัทฯ แนะนำให้มีการซ่อมแซมตำแหน่งที่มีความเสียหายตามหลักวิศวกรรมเพื่อป้องกันปัญหาที่อาจเกิดขึ้นในระยะยาว

ขอแสดงความนับถือ

(นายพนิต ศุกศิริลักษณ์)

บริษัท เพอร์ฟอร์มแมกซ์ บิวติง เซอร์วิส จำกัด

# อาคารสามารถใช้งานได้ตามปกติ

ชื่อและที่ตั้งอาคาร

โรงแรม โนวาเทล กรุงเทพมหานคร รังสิต

114 ถนนพหลโยธิน ตำบลประชาธิปัตย์

อำเภอธัญบุรี จังหวัดปทุมธานี 12130

หัวหน้าผู้ตรวจสอบ นายพนิต ศุภศิริลักษณ์

บจก. เพอร์ฟอร์มแมกซ์ บิวติง เซอร์วิส (น.0081/2550)

รับรองโดย นายวิฑิต ปานสุข วย 2638

วันที่ตรวจสอบ 6 เมษายน 2568

เบอร์โทรศัพท์ 081-616-0704

ลายมือชื่อ (ผู้ตรวจสอบ)

ลายมือชื่อ (ผู้วิศวกรโยธา)

ขอแนะนำในการปฏิบัติเพื่อความปลอดภัยในการใช้งานอาคารต่อไป

และความปลอดภัยต่อสาธารณะ

- เจ้าของอาคารควรเฝ้าระวังหากความเสียหายของอาคารมีการเปลี่ยนแปลงไปจากที่ผู้สำรวจตรวจพบ
- แจ้งเจ้าหน้าที่หากตรวจพบสิ่งที่ไม่ก่อให้เกิดอันตรายได้

ห้ามเคลื่อนย้ายหรือทำลายป้ายประกาศนี้

# เอกสารผู้ตรวจสอบและรับรอง

เลขที่ น.๐๐๘๓/๒๕๕๐ แบบ รท.๓



**หนังสือรับรองการขึ้นทะเบียนเป็นผู้ตรวจสอบ**  
หนังสือรับรองฉบับนี้ออกให้เพื่อแสดงว่า

บริษัท เพอร์ฟอรั่มแมกซ์ บิวติ่ง เซอร์วิส จำกัด

สำนักงานชื่อ	บริษัท เพอร์ฟอรั่มแมกซ์ บิวติ่ง เซอร์วิส จำกัด	ตั้งอยู่เลขที่	๔๔/๔
ครอบครัว/ซอย	เลขที่ ๓	ถนน	พหลโยธิน ๓
ตำบล/แขวง	วังใหม่	อำเภอ/เขต	ปทุมธานี
จังหวัด	ปทุมธานี	เขตการปกครอง	กรุงเทพมหานคร

ได้ขึ้นทะเบียนเป็น

ผู้ตรวจสอบวิชาชีพวิศวกรรมควบคุม

หนังสือรับรองฉบับนี้ให้ใช้ได้จนถึงวันที่

ออกให้ ณ วันที่

(นายพชรศักดิ์ ภิรมย์รัตน์)  
ประธานคณะกรรมการควบคุมอาคาร



**สถาปนิกวิศกร**

ตามพระราชบัญญัติวิศวกร พ.ศ. ๒๕๕๒

ใบอนุญาตฉบับนี้ให้ไว้เพื่อแสดงว่า

บริษัท เพอร์ฟอรั่มแมกซ์ บิวติ่ง เซอร์วิส จำกัด

ได้รับอนุญาตประกอบวิชาชีพวิศวกรรมควบคุม

เลขทะเบียน

ตั้งแต่วันที่ ๑๗ สิงหาคม ๒๕๕๘ ถึงวันที่ ๑๗ สิงหาคม ๒๕๖๘

(นายพชรศักดิ์ ภิรมย์รัตน์)  
นายกสภาวิศวกร



**ใบอนุญาตประกอบวิชาชีพวิศวกรรมควบคุม**  
Thai Professional Engineering License

เลขประจำตัวประชาชน (ID) [REDACTED]

นาย วิฑิต ปานสุข  
Title/Name Surname Mr. Withit Pansuk

เลขทะเบียน License No. [REDACTED]

ระดับ Senior Professional Engineer

สาขา Civil Engineering

วันออก 15 ก.ย. ๒๕๖๕

วันหมดอายุ 14 ก.ย. ๒๕๗๐

(นายวิฑิต ปานสุข)  
นายกสภาวิศวกร President

สำเนาถูกต้อง

  
นายวิฑิต ปานสุข