

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุศคลอาคารชุด แชนเดอร์วัน โพลี บางโพ
Project Name : โครงการ แชนเดอร์วัน โพลี บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 664390 E 1527539 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/3
Sample Type : Swimming pool Water
Sampling Date : 29 July 2025
Sampling Time : 10.40 a.m.
Received Date : 30 July 2025
Analytical Date : 30 July – 11 August 2025
Report Date : 13 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

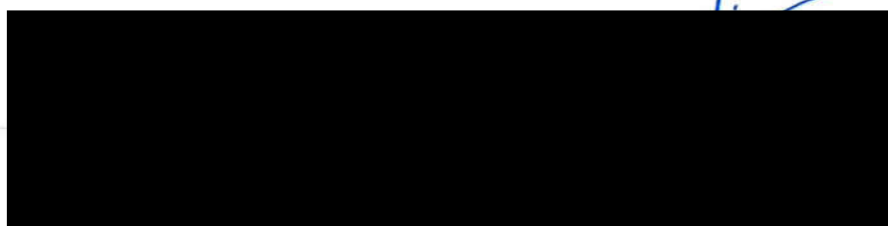

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชนเดอร์วัน โฟล์ว บางโพ
Project Name : โครงการ แชนเดอร์วัน โฟล์ว บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 664534 E 1527542 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/4
Sample Type : Swimming pool Water
Sampling Date : 29 July 2025
Sampling Time : 10.41 a.m.
Received Date : 30 July 2025
Analytical Date : 30 July – 11 August 2025
Report Date : 13 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

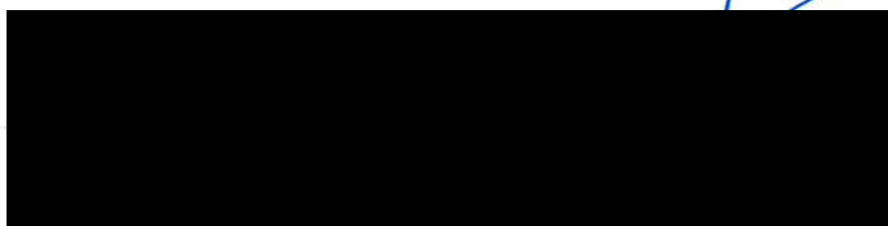

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชลเตอร์วัน โพลี บางโพ
Project Name : โครงการ แชลเตอร์วัน โพลี บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 664390 E 1527539 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/3
Sample Type : Swimming pool Water
Sampling Date : 26 August 2025
Sampling Time : 10.40 a.m.
Received Date : 27 August 2025
Analytical Date : 27 August – 05 September 2025
Report Date : 08 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

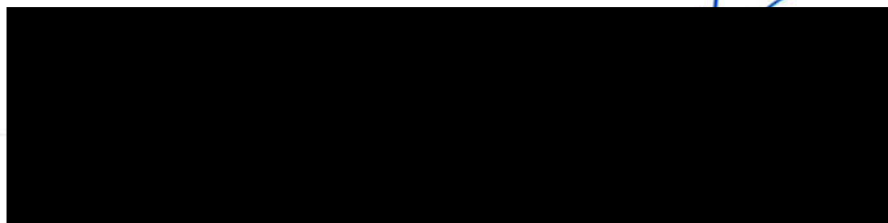

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชลเตอร์วัน โพลี บางโพ
 Project Name : โครงการ แชลเตอร์วัน โพลี บางโพ
 (Chapter One Flow Bangpo)
 Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
 เขตบางซื่อ กรุงเทพมหานคร 10800
 Sampling Point : สระว่ายน้ำส่วนต้น
 GPS. Coordinate : 47 P 664534 E 1527542 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
 Sample No : W68034/4
 Sample Type : Swimming pool Water
 Sampling Date : 26 August 2025
 Sampling Time : 10.41 a.m.
 Received Date : 27 August 2025
 Analytical Date : 27 August – 05 September 2025
 Report Date : 08 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

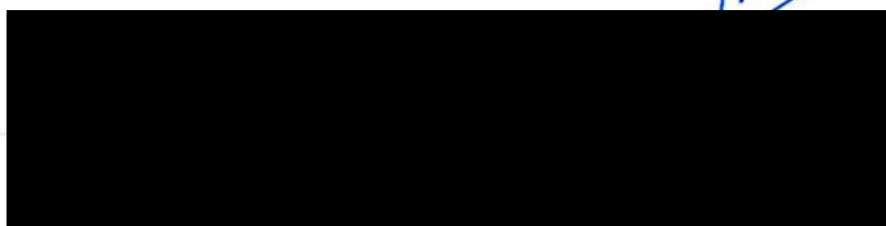

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชลเตอร์วัน โพลี บางโพ
Project Name : โครงการ แชลเตอร์วัน โพลี บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชาราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 664502 E 1527537 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/3
Sample Type : Swimming pool Water
Sampling Date : 30 September 2025
Sampling Time : 11.20 a.m.
Received Date : 01 October 2025
Analytical Date : 01 – 16 October 2025
Report Date : 17 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชลเตอร์วัน โพลี บางโพ
Project Name : โครงการ แชลเตอร์วัน โพลี บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 664482 E 1527536 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/4
Sample Type : Swimming pool Water
Sampling Date : 30 September 2025
Sampling Time : 11.25 a.m.
Received Date : 01 October 2025
Analytical Date : 01 – 16 October 2025
Report Date : 17 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชลเตอร์วัน โพลี บางโพ
Project Name : โครงการ แชลเตอร์วัน โพลี บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 664403 E 1527542 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/3
Sample Type : Swimming pool Water
Sampling Date : 16 October 2025
Sampling Time : 09.53 a.m.
Received Date : 17 October 2025
Analytical Date : 17 October – 06 November 2025
Report Date : 07 November 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุศคลอการชุด แชนเดอร์วัน โพล์ บางโพ
Project Name : โครงการ แชนเดอร์วัน โพล์ บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 664397 E 1527539 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/4
Sample Type : Swimming pool Water
Sampling Date : 16 October 2025
Sampling Time : 09.54 a.m.
Received Date : 17 October 2025
Analytical Date : 17 October – 06 November 2025
Report Date : 07 November 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แสปเตอร์วัน โพลีว บางโพ
Project Name : โครงการ แสปเตอร์วัน โพลีว บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชาราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 664404 E 1527539 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/3
Sample Type : Swimming pool Water
Sampling Date : 28 November 2025
Sampling Time : 10.35 a.m.
Received Date : 29 November 2025
Analytical Date : 29 November – 16 December 2025
Report Date : 17 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุคคณาการชุด แชนเดอร์วัน โพล์ บางโพ
Project Name : โครงการ แชนเดอร์วัน โพล์ บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 664411 E 1527532 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/4
Sample Type : Swimming pool Water
Sampling Date : 28 November 2025
Sampling Time : 10.34 a.m.
Received Date : 29 November 2025
Analytical Date : 29 November – 16 December 2025
Report Date : 17 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชลเตอร์วัน โพลีว บางโพ
Project Name : โครงการ แชลเตอร์วัน โพลีว บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 664402 E 1527547 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/3
Sample Type : Swimming pool Water
Sampling Date : 16 December 2025
Sampling Time : 09.54 a.m.
Received Date : 17 December 2025
Analytical Date : 17 - 25 December 2025
Report Date : 26 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

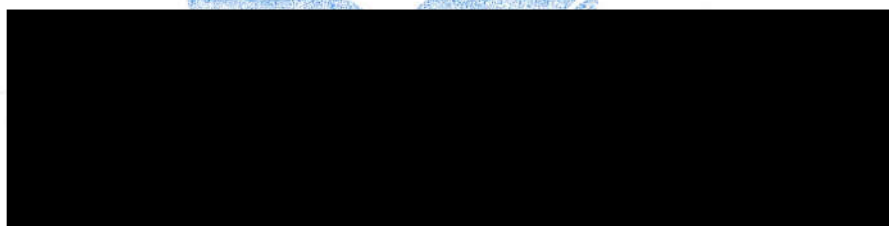

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด แชลเตอร์วัน โพลี บางโพ
Project Name : โครงการ แชลเตอร์วัน โพลี บางโพ
(Chapter One Flow Bangpo)
Address Project : เลขที่ 899 ถนนประชากรราษฎร์สาย 1 แขวงบางซื่อ
เขตบางซื่อ กรุงเทพมหานคร 10800
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 664379 E 1527516 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68034
Sample No : W68034/4
Sample Type : Swimming pool Water
Sampling Date : 16 December 2025
Sampling Time : 09.53 a.m.
Received Date : 17 December 2025
Analytical Date : 17 - 25 December 2025
Report Date : 26 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

