

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด นิมเบอร์วันแลนด์ อพาร์ทเมนต์
Project Name : โครงการอาคารพักอาศัย นิมเบอร์วันแลนด์ อพาร์ทเมนต์
Address Project : ถนนรามคำแหง 2 เขตประเวศ กรุงเทพมหานคร 10250
Sampling Point : จุดน้ำเสียเข้าระบบบำบัดน้ำเสียส่วนกลาง
GPS. Coordinate : 47 P 681742 E 1511532 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68062
Sample No. : W68062/1
Sample Type : Wastewater
Sampling Date : 28 August 2025
Sampling Time : 01.27 p.m.
Received Date : 29 August 2025
Analytical Date : 29 August – 10 September 2025
Report Date : 11 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.6
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	1,600
Total Kjeldahl Nitrogen ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	< 0.28
Sample Appearance		Yellow/Clear/Little Sediment/Odorless	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

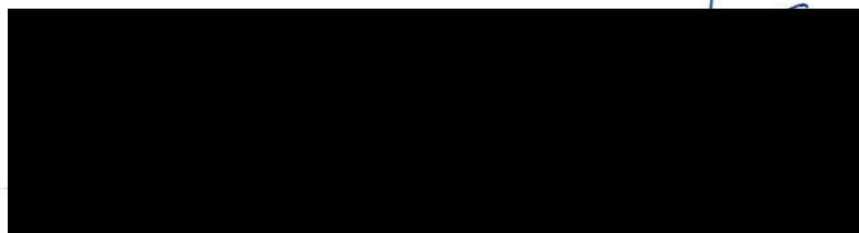

Analyst

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตบุศคลอการชุด นัมเบอร์วันแลนด์ อพาร์ทเมนต์
Project Name : โครงการอาคารพักอาศัย นัมเบอร์วันแลนด์ อพาร์ทเมนต์
Address Project : ถนนรามคำแหง 2 เขตประเวศ กรุงเทพมหานคร 10250
Sampling Point : จุดบ่อกักน้ำทิ้งที่ผ่านการบำบัดแล้ว
GPS. Coordinate : 47 P 681742 E 1511524 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68062
Sample No. : W68062/2
Sample Type : Wastewater
Sampling Date : 28 August 2025
Sampling Time : 01.33 p.m.
Received Date : 29 August 2025
Analytical Date : 29 August – 10 September 2025
Report Date : 11 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	240	-
Total Kjeldahl Nitrogen ^{*2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

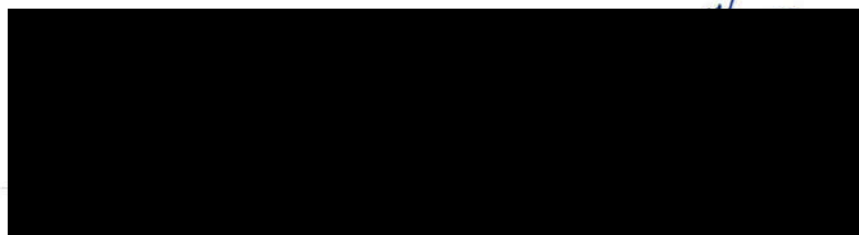

Analyst

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด นัมเบอร์วันแลนด์ อพาร์ทเมนต์
Project Name : โครงการอาคารพักอาศัย นัมเบอร์วันแลนด์ อพาร์ทเมนต์
Address Project : ถนนรามคำแหง 2 เขตประเวศ กรุงเทพมหานคร 10250
Sampling Point : จุดน้ำเสียเข้าระบบบำบัดน้ำเสียส่วนกลาง
GPS. Coordinate : 47 P 681747 E 1511530 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68062
Sample No. : W68062/1
Sample Type : Wastewater
Sampling Date : 15 December 2025
Sampling Time : 03.30 p.m.
Received Date : 16 December 2025
Analytical Date : 16 - 29 December 2025
Report Date : 05 January 2026


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	3.8
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	430
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28
Sample Appearance		Yellow/Clear/Little Sediment/Odorless	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด นัมเบอร์วันแลนด์ อพาร์ทเมนต์
 Project Name : โครงการอาคารพักอาศัย นัมเบอร์วันแลนด์ อพาร์ทเมนต์
 Address Project : ถนนรามคำแหง 2 เขตประเวศ กรุงเทพมหานคร 10250
 Sampling Point : จุดบ่อกักน้ำทิ้งที่ผ่านการบำบัดแล้ว
 GPS. Coordinate : 47 P 681742 E 1511526 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68062
 Sample No. : W68062/2
 Sample Type : Wastewater
 Sampling Date : 15 December 2025
 Sampling Time : 03.26 p.m.
 Received Date : 16 December 2025
 Analytical Date : 16 - 29 December 2025
 Report Date : 05 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	79	-
Total Kjeldahl Nitrogen *. ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

