

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
 เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อปรับสภาพน้ำเสีย
GPS. Coordinate : 47 P 673095 E 1516650 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/1
Sample Type : Wastewater
Sampling Date : 23 July 2025
Sampling Time : 03.14 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 26.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	42.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	378
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	30.8
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.21
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	1.0
Total Kjeldahl Nitrogen ^{2/}	mg/l.	APHA:4500-Norg (B) ^{3/}	63
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.

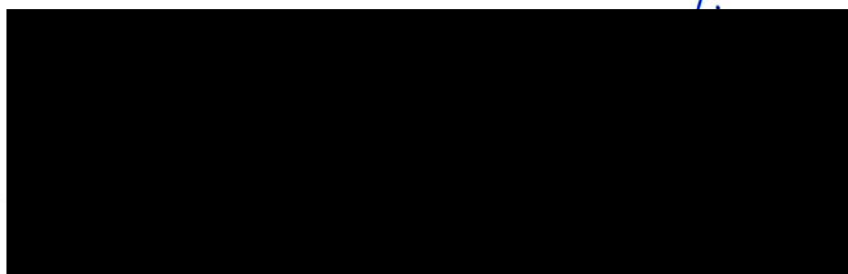

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
 เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อกักน้ำเวียนกลับ
GPS. Coordinate : 47 P 673094 E 1516620 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/2
Sample Type : Wastewater
Sampling Date : 23 July 2025
Sampling Time : 03.29 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 26.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	22.9	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	384	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	25.9	≤ 20
Oil and Grease *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 2.0	≤ 20
Sulfide *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	18	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

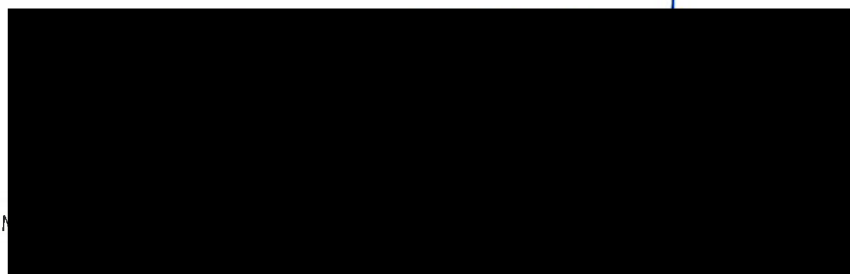

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
 เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อตรวจคุณภาพน้ำทิ้ง
GPS. Coordinate : 47 P 673076 E 1516603 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/3
Sample Type : Wastewater
Sampling Date : 23 July 2025
Sampling Time : 03.36 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.9 °C	-	Electrometric Method (4500-H ⁺ B)	6.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	26.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	322	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	27.0	≤ 20
Oil and Grease *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 2.0	≤ 20
Sulfide *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	14	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This Item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อปรับสภาพน้ำเสีย
GPS. Coordinate : 47 P 673068 E 1516654 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/1
Sample Type : Wastewater
Sampling Date : 21 August 2025
Sampling Time : 02.14 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 03 September 2025
Report Date : 04 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	51.2
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	326
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	50.6
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.8
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.70
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.9
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	52
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

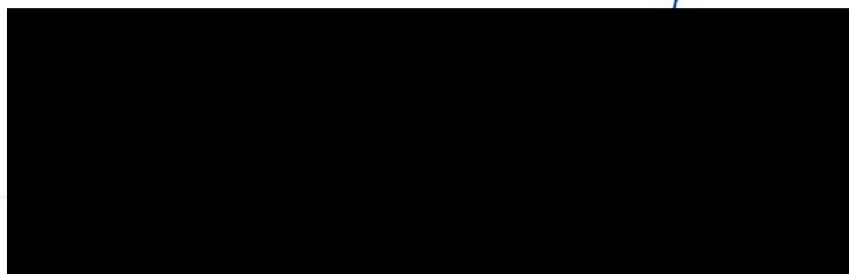

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อกักน้ำเวียนกลับ
GPS. Coordinate : 47 P 673079 E 1516630 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/2
Sample Type : Wastewater
Sampling Date : 21 August 2025
Sampling Time : 02.19 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 03 September 2025
Report Date : 04 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	16.9	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	380	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.9	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	12	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อตรวจคุณภาพน้ำทิ้ง
GPS. Coordinate : 47 P 673080 E 1516592 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/3
Sample Type : Wastewater
Sampling Date : 21 August 2025
Sampling Time : 02.23 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 03 September 2025
Report Date : 04 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.3	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	202	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	4.8	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{*2/}	mg/L	APHA:4500-Norg (B) ^{3/}	1.4	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	24,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	24,000	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

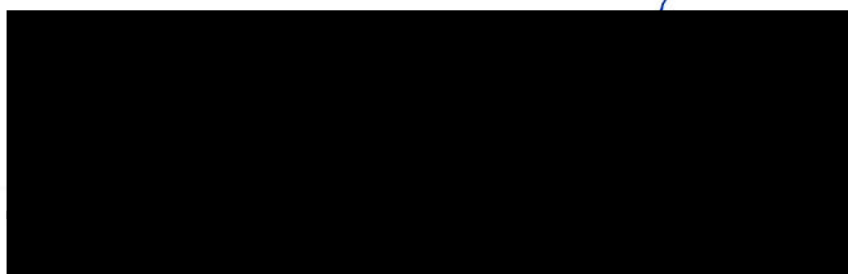

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อปรับสภาพน้ำเสีย
GPS. Coordinate : 47 P 673081 E 1516644 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/1
Sample Type : Wastewater
Sampling Date : 12 September 2025
Sampling Time : 10.53 a.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 22.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	46.5
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	354
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	39.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.7
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.21
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	41
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อกักน้ำเวียนกลับ
GPS. Coordinate : 47 P 673099 E 1516627 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/2
Sample Type : Wastewater
Sampling Date : 12 September 2025
Sampling Time : 10.56 a.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.8 °C	-	Electrometric Method (4500-H ⁺ B)	6.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	27.9	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	390	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	12.2	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.5	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	13	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	54,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	54,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : ป่อตรวจคุณภาพน้ำทิ้ง
GPS. Coordinate : 47 P 673077 E 1516608 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/3
Sample Type : Wastewater
Sampling Date : 12 September 2025
Sampling Time : 11.00 a.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.5 °C	-	Electrometric Method (4500-H ⁺ B)	6.3	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	28.3	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	352	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	9.8	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	9.5	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	35,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิตบุคคณาการชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อปรับสภาพน้ำเสีย
GPS. Coordinate : 47 P 673024 E 1516527 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/1
Sample Type : Wastewater
Sampling Date : 10 October 2025
Sampling Time : 10.49 a.m.
Received Date : 11 October 2025
Analytical Date : 11 - 27 October 2025
Report Date : 28 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	26.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	336
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	49.2
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.7
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.31
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	55
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อกักน้ำเวียนกลับ
GPS. Coordinate : 47 P 673084 E 1516591 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/2
Sample Type : Wastewater
Sampling Date : 10 October 2025
Sampling Time : 10.53 a.m.
Received Date : 11 October 2025
Analytical Date : 11 - 27 October 2025
Report Date : 28 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.2 °C	-	Electrometric Method (4500-H ⁺ B)	6.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	40.3	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	322	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	21.2	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.4	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	8.4	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	92,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อตรวจคุณภาพน้ำทิ้ง
GPS. Coordinate : 47 P 673072 E 1516552 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/3
Sample Type : Wastewater
Sampling Date : 10 October 2025
Sampling Time : 10.58 a.m.
Received Date : 11 October 2025
Analytical Date : 11 - 27 October 2025
Report Date : 28 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.3 °C	-	Electrometric Method (4500-H ⁺ B)	6.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	37.1	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	439	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	17.6	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.2	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	9.2	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อปรับสภาพน้ำเสีย
GPS. Coordinate : 47 P 673072 E 1516624 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/1
Sample Type : Wastewater
Sampling Date : 12 November 2025
Sampling Time : 11.17 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	27.2
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	384
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	82.3
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.2
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.81
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	56
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อกักน้ำเวียนกลับ
GPS. Coordinate : 47 P 673097 E 1516633 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/2
Sample Type : Wastewater
Sampling Date : 12 November 2025
Sampling Time : 11.22 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.8 °C	-	Electrometric Method (4500-H ⁺ B)	6.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	64.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	348	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	28.3	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.1	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	6.0	-
Total Kjeldahl Nitrogen ^{*, 2/}	mg/L	APHA:4500-Norg (B) ^{3/}	9.8	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	35,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อตรวจคุณภาพน้ำทิ้ง
GPS. Coordinate : 47 P 673075 E 1516616 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/3
Sample Type : Wastewater
Sampling Date : 12 November 2025
Sampling Time : 11.26 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.2 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	20.9	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	159	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	2.7	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	22,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	22,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อปรับสภาพน้ำเสีย
GPS. Coordinate : 47 P 673076 E 1516628 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/1
Sample Type : Wastewater
Sampling Date : 17 December 2025
Sampling Time : 03.04 p.m.
Received Date : 18 December 2025
Analytical Date : 18 December 2025 - 06 January 2026
Report Date : 09 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	92.5
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	342
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	90.9
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.8
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.10
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.5
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	64
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตบุศคลอการชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : บ่อกักน้ำเวียนกลับ
GPS. Coordinate : 47 P 673109 E 1516644 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/2
Sample Type : Wastewater
Sampling Date : 17 December 2025
Sampling Time : 03.09 p.m.
Received Date : 18 December 2025
Analytical Date : 18 December 2025 - 06 January 2026
Report Date : 09 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	38.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	370	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	26.9	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	15	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	92,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : ป้อมตรวจคุณภาพน้ำทิ้ง
GPS. Coordinate : 47 P 673072 E 1516584 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68027
Sample No. : W68027/3
Sample Type : Wastewater
Sampling Date : 17 December 2025
Sampling Time : 03.14 p.m.
Received Date : 18 December 2025
Analytical Date : 18 December 2025 - 06 January 2026
Report Date : 09 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.3	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	20.6	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	445	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	16.8	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	17	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	17,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตบุคคณาการชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
 เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673070 E 1516611 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/4
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 03.08 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

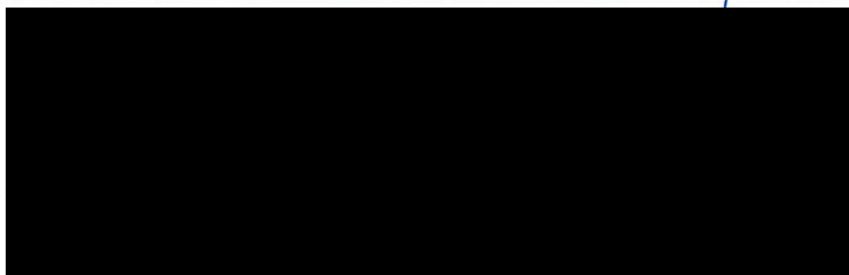

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
 เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673076 E 1516625 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/5
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 03.07 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

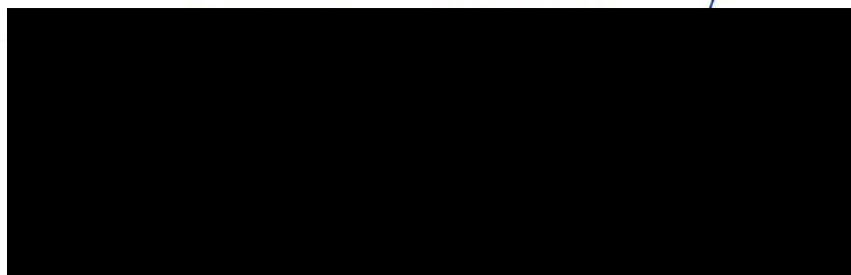

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673074 E 1516621 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/4
Sample Type : Swimming pool Water
Sampling Date : 21 August 2025
Sampling Time : 02.09 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 02 September 2025
Report Date : 03 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
 เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673069 E 1516596 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/5
Sample Type : Swimming pool Water
Sampling Date : 21 August 2025
Sampling Time : 02.08 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 02 September 2025
Report Date : 03 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 673051 E 1516632 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/4
Sample Type : Swimming pool Water
Sampling Date : 12 September 2025
Sampling Time : 10.48 a.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673074 E 1516618 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/5
Sample Type : Swimming pool Water
Sampling Date : 12 September 2025
Sampling Time : 10.49 a.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุศลาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673049 E 1516539 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/4
Sample Type : Swimming pool Water
Sampling Date : 10 October 2025
Sampling Time : 10.41 a.m.
Received Date : 11 October 2025
Analytical Date : 11 - 27 October 2025
Report Date : 28 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673056 E 1516509 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/5
Sample Type : Swimming pool Water
Sampling Date : 10 October 2025
Sampling Time : 10.42 a.m.
Received Date : 11 October 2025
Analytical Date : 11 - 27 October 2025
Report Date : 28 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{*/2}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{*/2}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุคคณาการชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673073 E 1516605 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/4
Sample Type : Swimming pool Water
Sampling Date : 12 November 2025
Sampling Time : 11.29 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673087 E 1516624 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/5
Sample Type : Swimming pool Water
Sampling Date : 12 November 2025
Sampling Time : 11.30 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673075 E 1516620 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/4
Sample Type : Swimming pool Water
Sampling Date : 17 December 2025
Sampling Time : 03.00 p.m.
Received Date : 18 December 2025
Analytical Date : 18 December 2025 - 05 January 2026
Report Date : 06 January 2026


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{*/2}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{*/2}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คอีสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK EAST
Address Project : เลขที่ 99 ซอยริมคลองพระโขนง แขวงพระโขนงเหนือ
เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673085 E 1516621 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68027
Sample No : W68027/5
Sample Type : Swimming pool Water
Sampling Date : 17 December 2025
Sampling Time : 02.59 p.m.
Received Date : 18 December 2025
Analytical Date : 18 December 2025 - 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

