

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 672202 E 1515684 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/1
Sample Type : Wastewater
Sampling Date : 15 July 2025
Sampling Time : 02.45 p.m.
Received Date : 16 July 2025
Analytical Date : 16 – 30 July 2025
Report Date : 30 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.9 °C	-	Electrometric Method (4500-H ⁺ B)	5.6	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	665	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	39.5	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	33.2	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA., AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



Analyst

นาย ทศพร เตชะรัตนกิจ

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : บ่อพักน้ำสุดท้ายของระบบระบายน้ำของโครงการ
GPS. Coordinate : 47 P 672143 E 1515649 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/2
Sample Type : Wastewater
Sampling Date : 15 July 2025
Sampling Time : 01.59 p.m.
Received Date : 16 July 2025
Analytical Date : 16 – 30 July 2025
Report Date : 30 July 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.4 °C	-	Electrometric Method (4500-H ⁺ B)	5.7	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	596	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	35.6	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	28.9	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

Analyst

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 672205 E 1515678 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/1
Sample Type : Wastewater
Sampling Date : 22 August 2025
Sampling Time : 12.09 p.m.
Received Date : 23 August 2025
Analytical Date : 23 August - 05 September 2025
Report Date : 08 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	6.0	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	448	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	24.7	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	32.2	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	4.2	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

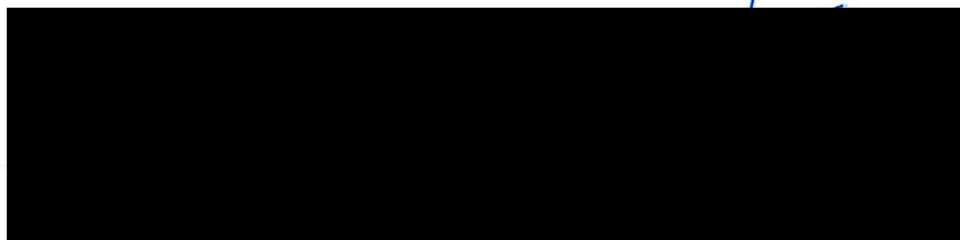

Analyst

Laboratory Manager

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : บ่อพักน้ำสุดท้ายของระบบระบายน้ำของโครงการ
GPS. Coordinate : 47 P 672154 E 1515658 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/2
Sample Type : Wastewater
Sampling Date : 22 August 2025
Sampling Time : 12.05 p.m.
Received Date : 23 August 2025
Analytical Date : 23 August - 05 September 2025
Report Date : 08 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	5.9	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	424	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	27.6	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	27.0	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	3.6	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

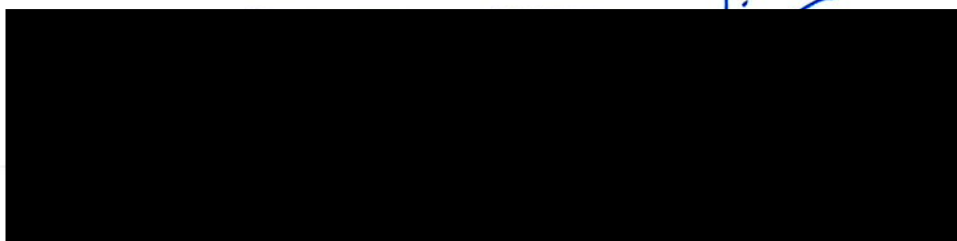

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 672129 E 1515650 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/1
Sample Type : Wastewater
Sampling Date : 04 September 2025
Sampling Time : 12.12 p.m.
Received Date : 05 September 2025
Analytical Date : 05 – 19 September 2025
Report Date : 22 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.2 °C	-	Electrometric Method (4500-H ⁺ B)	6.6	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	496	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	18.8	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	29.6	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	9.2	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : บ่อพักน้ำสุดท้ายของระบบระบายน้ำของโครงการ
GPS. Coordinate : 47 P 672199 E 1515684 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/2
Sample Type : Wastewater
Sampling Date : 04 September 2025
Sampling Time : 11.58 a.m.
Received Date : 05 September 2025
Analytical Date : 05 – 19 September 2025
Report Date : 22 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	6.5	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	314	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.3	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	21.8	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	8.4	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

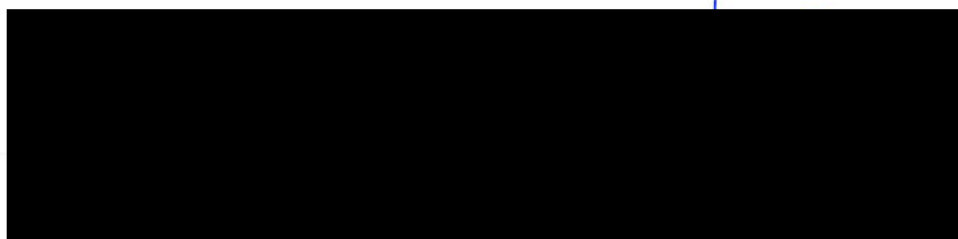

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 672138 E 1515647 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/1
Sample Type : Wastewater
Sampling Date : 16 October 2025
Sampling Time : 10.48 a.m.
Received Date : 17 October 2025
Analytical Date : 17 October - 06 November 2025
Report Date : 07 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.8 °C	-	Electrometric Method (4500-H ⁺ B)	6.2	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	378	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.0	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	22.1	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : บ่อพักน้ำสุดท้ายของระบบระบายน้ำของโครงการ
GPS. Coordinate : 47 P 672212 E 1515680 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/2
Sample Type : Wastewater
Sampling Date : 16 October 2025
Sampling Time : 10.54 a.m.
Received Date : 17 October 2025
Analytical Date : 17 October - 06 November 2025
Report Date : 07 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.5 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	376	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	20.3	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	16.9	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
 Project Name : โครงการ The Base Sukhumvit 50
 Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
 Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
 GPS. Coordinate : 47 P 672138 E 1515647 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
 Sample No. : W68031/1
 Sample Type : Wastewater
 Sampling Date : 20 November 2025
 Sampling Time : 02.32 p.m.
 Received Date : 21 November 2025
 Analytical Date : 21 November - 04 December 2025
 Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.4 °C	-	Electrometric Method (4500-H ⁺ B)	6.9	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	472	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	20.9	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	13.6	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{*,2/}	mg/L	APHA:4500-Norg (B) ^{3/}	7.6	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

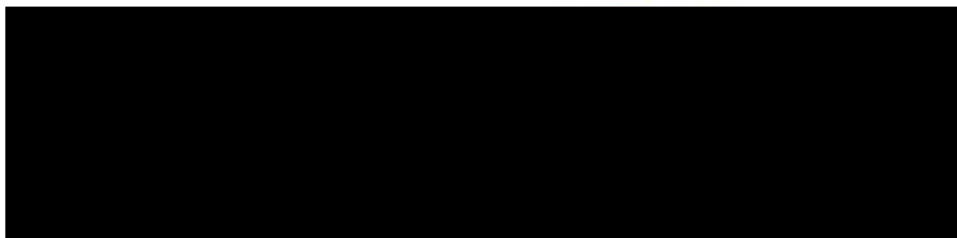

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : บ่อพักน้ำสุดท้ายของระบบระบายน้ำของโครงการ
GPS. Coordinate : 47 P 672212 E 1515680 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/2
Sample Type : Wastewater
Sampling Date : 20 November 2025
Sampling Time : 02.38 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November - 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.8 °C	-	Electrometric Method (4500-H ⁺ B)	6.8	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	436	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	21.6	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	12.7	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{*,2/}	mg/L	APHA:4500-Norg (B) ^{3/}	7.0	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

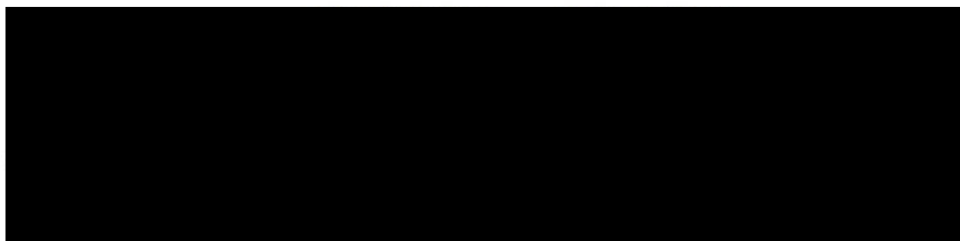

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 672140 E 1515654 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/1
Sample Type : Wastewater
Sampling Date : 16 December 2025
Sampling Time : 03.29 p.m.
Received Date : 17 December 2025
Analytical Date : 17 - 29 December 2025
Report Date : 05 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	6.7	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	588	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	22.1	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	34.6	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA., AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : บ่อพักน้ำสุดท้ายของระบบระบายน้ำของโครงการ
GPS. Coordinate : 47 P 672212 E 1515680 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68031
Sample No. : W68031/2
Sample Type : Wastewater
Sampling Date : 16 December 2025
Sampling Time : 03.24 p.m.
Received Date : 17 December 2025
Analytical Date : 17 - 29 December 2025
Report Date : 05 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.4. °C	-	Electrometric Method (4500-H ⁺ B)	6.3	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	553	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	26.2	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.1	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen ^{*,2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 672165 E 1515656 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/3
Sample Type : Swimming pool Water
Sampling Date : 15 July 2025
Sampling Time : 01.52 p.m.
Received Date : 16 July 2025
Analytical Date : 16 – 30 July 2025
Report Date : 30 July 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

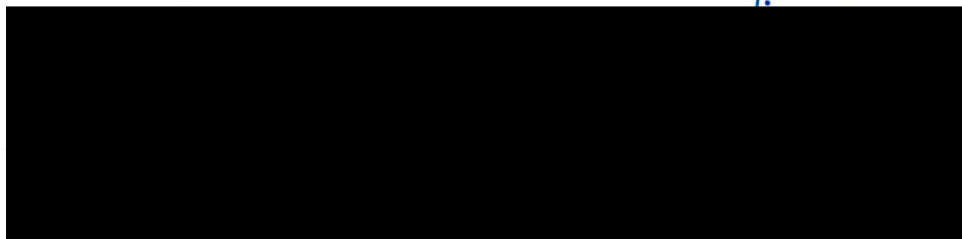

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุคคณาการชุด เดอะ เบส สุขุมวิท 50
 Project Name : โครงการ The Base Sukhumvit 50
 Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
 Sampling Point : สระว่ายน้ำส่วนต้น
 GPS. Coordinate : 47 P 672168 E 1515658 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
 Sample No : W68031/4
 Sample Type : Swimming pool Water
 Sampling Date : 15 July 2025
 Sampling Time : 01.53 p.m.
 Received Date : 16 July 2025
 Analytical Date : 16 – 30 July 2025
 Report Date : 30 July 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

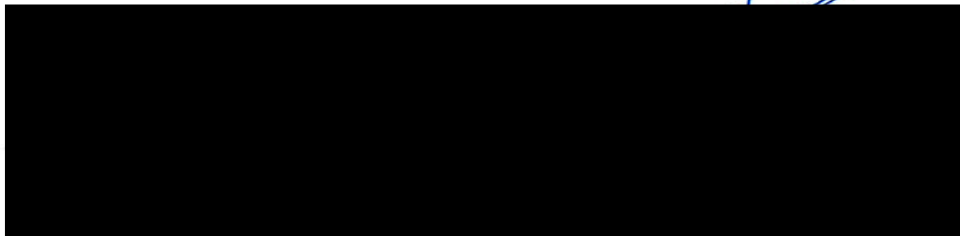

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 672158 E 1515669 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/3
Sample Type : Swimming pool Water
Sampling Date : 22 August 2025
Sampling Time : 11.59 a.m.
Received Date : 23 August 2025
Analytical Date : 23 August - 05 September 2025
Report Date : 08 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 672158 E 1515669 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/4
Sample Type : Swimming pool Water
Sampling Date : 22 August 2025
Sampling Time : 11.58 p.m.
Received Date : 23 August 2025
Analytical Date : 23 August - 05 September 2025
Report Date : 08 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

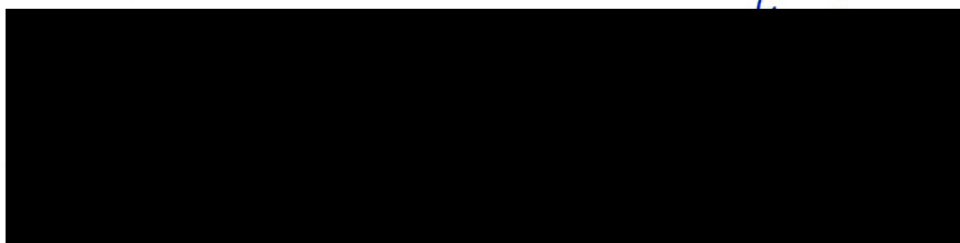

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 672167 E 1515672 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/3
Sample Type : Swimming pool Water
Sampling Date : 04 September 2025
Sampling Time : 11.53 a.m.
Received Date : 05 September 2025
Analytical Date : 05 – 19 September 2025
Report Date : 22 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
 Project Name : โครงการ The Base Sukhumvit 50
 Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
 Sampling Point : สระว่ายน้ำส่วนต้น
 GPS. Coordinate : 47 P 672167 E 1515677 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
 Sample No : W68031/4
 Sample Type : Swimming pool Water
 Sampling Date : 04 September 2025
 Sampling Time : 11.52 a.m.
 Received Date : 05 September 2025
 Analytical Date : 05 – 19 September 2025
 Report Date : 22 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

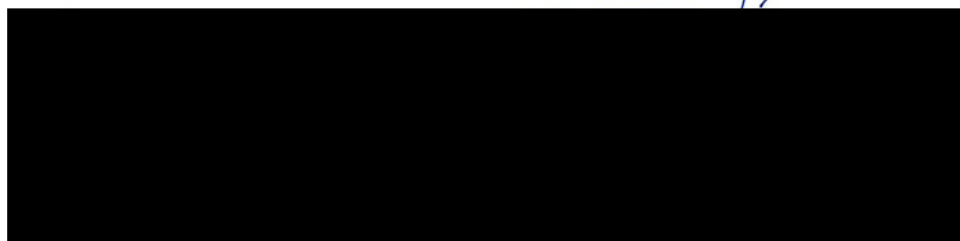

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 672159 E 1515674 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/3
Sample Type : Swimming pool Water
Sampling Date : 16 October 2025
Sampling Time : 10.58 a.m.
Received Date : 17 October 2025
Analytical Date : 17 October - 06 November 2025
Report Date : 07 November 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 672175 E 1515664 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/4
Sample Type : Swimming pool Water
Sampling Date : 16 October 2025
Sampling Time : 10.59 a.m.
Received Date : 17 October 2025
Analytical Date : 17 October - 06 November 2025
Report Date : 07 November 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
 Project Name : โครงการ The Base Sukhumvit 50
 Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
 Sampling Point : สระว่ายน้ำส่วนเล็ก
 GPS. Coordinate : 47 P 672159 E 1515674 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
 Sample No : W68031/3
 Sample Type : Swimming pool Water
 Sampling Date : 20 November 2025
 Sampling Time : 02.27 p.m.
 Received Date : 21 November 2025
 Analytical Date : 21 November - 04 December 2025
 Report Date : 08 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

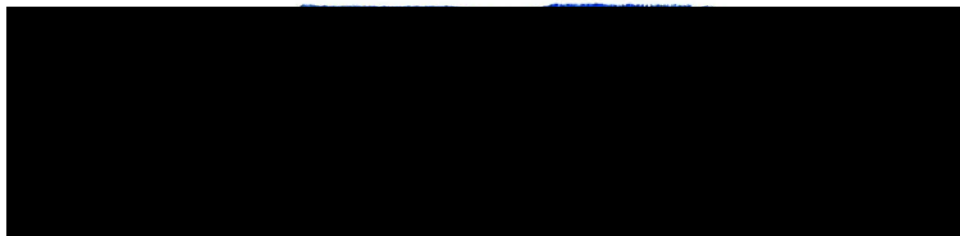

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 672175 E 1515664 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/4
Sample Type : Swimming pool Water
Sampling Date : 20 November 2025
Sampling Time : 02.28 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November - 04 December 2025
Report Date : 08 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *. ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *. ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

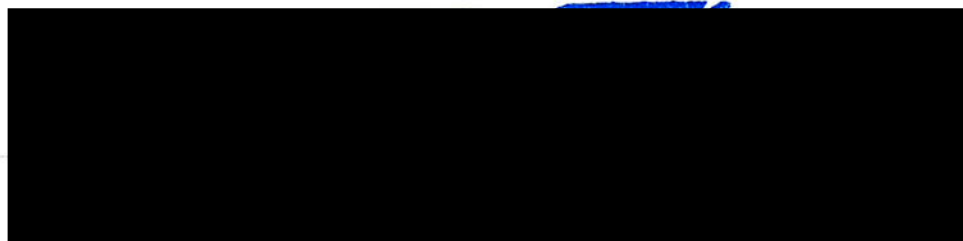

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 672165 E 1515659 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/3
Sample Type : Swimming pool Water
Sampling Date : 16 December 2025
Sampling Time : 03.22 p.m.
Received Date : 17 December 2025
Analytical Date : 17 - 25 December 2025
Report Date : 26 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส สุขุมวิท 50
Project Name : โครงการ The Base Sukhumvit 50
Address Project : เลขที่ 1198 ซอยเริ่มเจริญ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 672185 E 1515671 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68031
Sample No : W68031/4
Sample Type : Swimming pool Water
Sampling Date : 16 December 2025
Sampling Time : 03.21 p.m.
Received Date : 17 December 2025
Analytical Date : 17 - 25 December 2025
Report Date : 26 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by BUREAU VERITAS AQ LAB (THAILAND) COMPANY LIMITED. registration number Wo-313

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

