

ภาคผนวก ง

ผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม



คุณภาพน้ำทิ้ง



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 673048 E 1516528 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 01.59 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 05 August 2025
Report Date : 06 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673033 E 1516530 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/5
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 01.58 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 05 August 2025
Report Date : 06 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : คุณภาพน้ำทิ้งก่อนบำบัด (ปัสสาวะน้ำเสีย)
GPS. Coordinate : 47 P 673015 E 1516524 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/1
Sample Type : Wastewater
Sampling Date : 23 July 2025
Sampling Time : 02.07 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	242
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	404
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	78.9
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.6
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ²⁻ F)	1.21
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	7.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	71
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Black/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : คุณภาพน้ำทิ้งหลังการบำบัด (บ่อกักน้ำเวียนกลับ)
GPS. Coordinate : 47 P 673065 E 1516558 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/2
Sample Type : Wastewater
Sampling Date : 23 July 2025
Sampling Time : 02.20 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.3 °C	-	Electrometric Method (4500-H ⁺ B)	5.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	104	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	467	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	28.6	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.3	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	7.8	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : คุณภาพน้ำทั้งก่อนระบายออกนอกโครงการ
(บ่อตรวจคุณภาพน้ำทิ้ง)
GPS. Coordinate : 47 P 673072 E 1516541 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/3
Sample Type : Wastewater
Sampling Date : 23 July 2025
Sampling Time : 02.33 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 06 August 2025
Report Date : 07 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.4 °C	-	Electrometric Method (4500-H ⁺ B)	5.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	133	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	447	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	30.1	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.81	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	6.0	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	5.9	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673048 E 1516528 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 01.59 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 05 August 2025
Report Date : 06 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673033 E 1516530 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/5
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 01.58 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 05 August 2025
Report Date : 06 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนบำบัด (บ่อสูบน้ำเสีย)
GPS. Coordinate : 47 P 673022 E 1516521 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/1
Sample Type : Wastewater
Sampling Date : 21 August 2025
Sampling Time : 01.30 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 03 September 2025
Report Date : 04 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	45.8
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	280
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	65.1
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.8
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.80
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.6
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	56
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด (บ่อกักน้ำเวียนกลับ)
GPS. Coordinate : 47 P 673058 E 1516572 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/2
Sample Type : Wastewater
Sampling Date : 21 August 2025
Sampling Time : 01.36 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 03 September 2025
Report Date : 04 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.2 °C	-	Electrometric Method (4500-H ⁺ B)	6.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	57.3	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	394	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	28.2	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	17	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนระบายออกนอกโครงการ
(บ่อตรวจคุณภาพน้ำทิ้ง)
GPS. Coordinate : 47 P 673084 E 1516550 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/3
Sample Type : Wastewater
Sampling Date : 21 August 2025
Sampling Time : 01.46 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 03 September 2025
Report Date : 03 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	6.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	77.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	380	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	31.9	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	4.0	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	1.4	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673046 E 1516530 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 21 August 2025
Sampling Time : 01.52 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 02 September 2025
Report Date : 03 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673050 E 1516520 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/5
Sample Type : Swimming pool Water
Sampling Date : 21 August 2025
Sampling Time : 01.53 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 02 September 2025
Report Date : 2 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนบำบัด (บ่อสูบน้ำเสีย)
GPS. Coordinate : 47 P 673038 E 1516534 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/1
Sample Type : Wastewater
Sampling Date : 12 September 2025
Sampling Time : 01.05 p.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 22.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	30.7
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	278
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	94.8
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.35
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	46
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด (ปอกักน้ำเย็นกลับ)
GPS. Coordinate : 47 P 673059 E 1516551 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/2
Sample Type : Wastewater
Sampling Date : 12 September 2025
Sampling Time : 01.11 p.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.7 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	42.9	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	416	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	36.6	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	4.0	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	16	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนระบายออกนอกโครงการ
(ป๊อตตรวจคุณภาพน้ำทิ้ง)
GPS. Coordinate : 47 P 673089 E 1516560 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/3
Sample Type : Wastewater
Sampling Date : 12 September 2025
Sampling Time : 01.17 p.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.6 °C	-	Electrometric Method (4500-H ⁺ B)	6.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	71.1	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	410	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	41.1	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	4.0	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	12	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
 Project Name : โครงการ THE BASE PARK WEST
 Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
 แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
 Sampling Point : ค้างค้ำก่อนบำบัด (บ่อสูบน้ำเสีย)
 GPS. Coordinate : 47 P 673024 E 1516527 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
 Sample No. : W68067/1
 Sample Type : Wastewater
 Sampling Date : 10 October 2025
 Sampling Time : 11.26 a.m.
 Received Date : 11 October 2025
 Analytical Date : 11 – 31 October 2025
 Report Date : 03 November 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	97.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	313
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	54.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.6
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.11
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.4
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	56
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด (ปอกักน้ำเวียนกลับ)
GPS. Coordinate : 47 P 673109 E 1516644 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/2
Sample Type : Wastewater
Sampling Date : 10 October 2025
Sampling Time : 11.31 a.m.
Received Date : 11 October 2025
Analytical Date : 11 – 31 October 2025
Report Date : 03 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	8.3	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	288	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	11.7	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.3	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	23	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	54,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	54,000	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
 Project Name : โครงการ THE BASE PARK WEST
 Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
 แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
 Sampling Point : น้ำทิ้งก่อนระบายออกนอกโครงการ
 (บ่อตรวจคุณภาพน้ำทิ้ง)
 GPS. Coordinate : 47 P 673071 E 1516595 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
 Sample No. : W68067/3
 Sample Type : Wastewater
 Sampling Date : 10 October 2025
 Sampling Time : 11.40 a.m.
 Received Date : 11 October 2025
 Analytical Date : 11 – 31 October 2025
 Report Date : 03 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	17.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	174	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.5	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	92,000	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : คุณภาพน้ำทิ้งก่อนบำบัด (บ่อสูบน้ำเสีย)
GPS. Coordinate : 47 P 673022 E 1516532 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/1
Sample Type : Wastewater
Sampling Date : 12 November 2025
Sampling Time : 11.42 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	35.2
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	473
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	173
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.02
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	63
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : คุณภาพน้ำทิ้งหลังการบำบัด (บ่อกักน้ำเวียนกลับ)
GPS. Coordinate : 47 P 673035 E 1516569 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/2
Sample Type : Wastewater
Sampling Date : 12 November 2025
Sampling Time : 11.47 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.2 °C	-	Electrometric Method (4500-H ⁺ B)	7.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	20.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	448	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	22.4	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	20	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	35,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

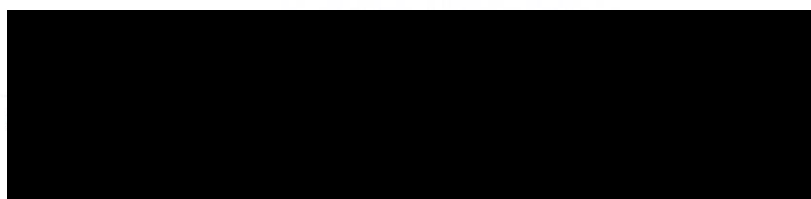

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : คุณภาพน้ำทั้งก่อนระบายออกนอกโครงการ
(บ่อตรวจคุณภาพน้ำทั้ง)
GPS. Coordinate : 47 P 673072 E 1516545 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/3
Sample Type : Wastewater
Sampling Date : 12 November 2025
Sampling Time : 11.55 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 01 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	21.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	135	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	35.1	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.2	-
Total Kjeldahl Nitrogen *, 2/	mg/L	APHA:4500-Norg (B) ^{3/}	4.2	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	92,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนบำบัด (ป่อสูบน้ำเสีย)
GPS. Coordinate : 47 P 673069 E 1516532 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/1
Sample Type : Wastewater
Sampling Date : 10 December 2025
Sampling Time : 01.54 p.m.
Received Date : 11 December 2025
Analytical Date : 11 – 24 December 2025
Report Date : 25 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	15.2
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	487
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	99.6
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.6
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.10
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.2
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	67
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

- Remark**
- ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
 - ^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
 - ^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.
 - * This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด (บ่อกักน้ำเวียนกลับ)
GPS. Coordinate : 47 P 673193 E 1516271 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/2
Sample Type : Wastewater
Sampling Date : 10 December 2025
Sampling Time : 02.00 p.m.
Received Date : 11 December 2025
Analytical Date : 11 – 24 December 2025
Report Date : 25 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	6.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	35.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	442	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	30.4	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	6.0	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	7.6	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

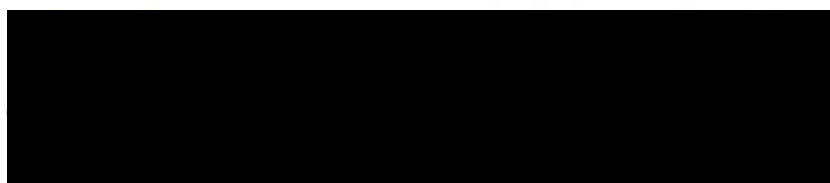

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนระบายออกนอกโครงการ
(บ่อตรวจคุณภาพน้ำทิ้ง)
GPS. Coordinate : 47 P 673062 E 1516561 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68067
Sample No. : W68067/3
Sample Type : Wastewater
Sampling Date : 10 December 2025
Sampling Time : 02.06 p.m.
Received Date : 11 December 2025
Analytical Date : 11 – 24 December 2025
Report Date : 25 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.4 °C	-	Electrometric Method (4500-H ⁺ B)	6.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	35.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	469	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	36.1	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	7.0	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	9.8	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



คุณภาพสระว่ายน้ำ



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673048 E 1516528 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 01.59 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 05 August 2025
Report Date : 06 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673033 E 1516530 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/5
Sample Type : Swimming pool Water
Sampling Date : 23 July 2025
Sampling Time : 01.58 p.m.
Received Date : 24 July 2025
Analytical Date : 24 July – 05 August 2025
Report Date : 06 August 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673046 E 1516530 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 21 August 2025
Sampling Time : 01.52 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 02 September 2025
Report Date : 03 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673050 E 1516520 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/5
Sample Type : Swimming pool Water
Sampling Date : 21 August 2025
Sampling Time : 01.53 p.m.
Received Date : 22 August 2025
Analytical Date : 22 August – 02 September 2025
Report Date : 2 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 673030 E 1516527 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 12 September 2025
Sampling Time : 01.22 p.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673052 E 1516554 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/5
Sample Type : Swimming pool Water
Sampling Date : 12 September 2025
Sampling Time : 01.23 p.m.
Received Date : 13 September 2025
Analytical Date : 13 – 29 September 2025
Report Date : 30 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 673075 E 1516620 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 10 October 2025
Sampling Time : 11.19 a.m.
Received Date : 11 October 2025
Analytical Date : 11 – 27 October 2025
Report Date : 28 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 673085 E 1516509 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/5
Sample Type : Swimming pool Water
Sampling Date : 10 October 2025
Sampling Time : 11.20 a.m.
Received Date : 11 October 2025
Analytical Date : 11 – 27 October 2025
Report Date : 28 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
Project Name : โครงการ THE BASE PARK WEST
Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
 แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 673029 E 1516540 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
Sample No : W68067/4
Sample Type : Swimming pool Water
Sampling Date : 12 November 2025
Sampling Time : 11.51 a.m.
Received Date : 13 November 2025
Analytical Date : 13 – 28 November 2025
Report Date : 02 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
 Project Name : โครงการ THE BASE PARK WEST
 Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
 แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
 Sampling Point : สระว่ายน้ำส่วนต้น
 GPS. Coordinate : 47 P 673054 E 15165 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
 Sample No : W68067/5
 Sample Type : Swimming pool Water
 Sampling Date : 12 November 2025
 Sampling Time : 11.52 a.m.
 Received Date : 13 November 2025
 Analytical Date : 13 – 28 November 2025
 Report Date : 02 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
 Project Name : โครงการ THE BASE PARK WEST
 Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
 แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
 Sampling Point : สระว่ายน้ำส่วนเล็ก
 GPS. Coordinate : 47 P 673055 E 1516518 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
 Sample No : W68067/4
 Sample Type : Swimming pool Water
 Sampling Date : 10 December 2025
 Sampling Time : 01.50 p.m.
 Received Date : 11 December 2025
 Analytical Date : 11 – 24 December 2025
 Report Date : 25 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ เบส พาร์คเวสต์ สุขุมวิท 77
 Project Name : โครงการ THE BASE PARK WEST
 Address Project : เลขที่ 11 ซอยริมคลองพระโขนง ถนนสุขุมวิท
 แขวงพระโขนงเหนือ เขตวัฒนา กรุงเทพมหานคร 10110
 Sampling Point : สระว่ายน้ำส่วนต้น
 GPS. Coordinate : 47 P 673047 E 1516523 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68067
 Sample No : W68067/5
 Sample Type : Swimming pool Water
 Sampling Date : 10 December 2025
 Sampling Time : 01.51 p.m.
 Received Date : 11 December 2025
 Analytical Date : 11 – 24 December 2025
 Report Date : 25 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

