

ภาคผนวก ง

ผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม

- ง1 คุณภาพน้ำทิ้ง
- ง2 คุณภาพน้ำระเหยน้ำ



ภาคผนวก ง1

คุณภาพน้ำทิ้ง



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchaprak-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656525 E 1519370 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/1

Sample Type : Wastewater

Sampling Date : 29 July 2025

Sampling Time : 10.28 a.m.

Received Date : 30 July 2025

Analytical Date : 30 July – 11 August 2025

Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 22.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	366
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	248
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	130
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.7
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.21
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	11
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	75
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Brown/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchaprak-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร A)
GPS. Coordinate : 47 P 656523 E 1519378 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W66023
Sample No : W68023/2
Sample Type : Wastewater
Sampling Date : 29 July 2025
Sampling Time : 10.22 a.m.
Received Date : 30 July 2025
Analytical Date : 30 July – 11 August 2025
Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.3	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	18.1	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	266	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	16.3	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids [*]	mL/L	Imhoff Cone (2540 F)	0.2	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	16	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแกว เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656585 E 1519395 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/3

Sample Type : Wastewater

Sampling Date : 29 July 2025

Sampling Time : 10.15 a.m.

Received Date : 30 July 2025

Analytical Date : 30 July – 11 August 2025

Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 22.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	94.5
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	272
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	65.7
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.6
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.01
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	3.5
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	56
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656573 E 1519401 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W66023

Sample No : W68023/4

Sample Type : Wastewater

Sampling Date : 29 July 2025

Sampling Time : 10.10 a.m.

Received Date : 30 July 2025

Analytical Date : 30 July – 11 August 2025

Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	12.4	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	264	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	14.2	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	49	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	54,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656524 E 1519293 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/5

Sample Type : Wastewater

Sampling Date : 29 July 2025

Sampling Time : 10.44 a.m.

Received Date : 30 July 2025

Analytical Date : 30 July – 11 August 2025

Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 22.2 °C	-	Electrometric Method (4500-H ⁺ B)	7.1
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	313
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	336
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	155
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	2.9
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.48
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	12
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	61
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656534 E 1519312 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/6

Sample Type : Wastewater

Sampling Date : 29 July 2025

Sampling Time : 10.37 a.m.

Received Date : 30 July 2025

Analytical Date : 30 July – 11 August 2025

Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	35.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	339	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	93.3	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.94	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	55	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : จุดพักน้ำเสียสุดท้าย

GPS. Coordinate : 47 P 656512 E 1519463 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/7

Sample Type : Wastewater

Sampling Date : 29 July 2025

Sampling Time : 10.03 a.m.

Received Date : 30 July 2025

Analytical Date : 30 July – 11 August 2025

Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 22.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	218	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	18.5	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	30	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
 ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
 กรุงเทพมหานคร 10160
Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร A)
GPS. Coordinate : 47 P 656523 E 1519373 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/1
Sample Type : Wastewater
Sampling Date : 20 August 2025
Sampling Time : 10.05 a.m.
Received Date : 21 August 2025
Analytical Date : 21 August – 03 September 2025
Report Date : 04 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	304
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	288
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	141
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.48
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	8.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	70
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแกว เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656535 E 1519388 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/2

Sample Type : Wastewater

Sampling Date : 20 August 2025

Sampling Time : 10.00 a.m.

Received Date : 21 August 2025

Analytical Date : 21 August – 03 September 2025

Report Date : 04 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	26.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	260	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	18.2	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	1.9	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	32	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแนว เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656580 E 1519391 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/3

Sample Type : Wastewater

Sampling Date : 26 August 2025

Sampling Time : 09.50 a.m.

Received Date : 27 August 2025

Analytical Date : 27 August – 05 September 2025

Report Date : 08 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 26.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	533
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	339
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	96.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.88
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	20
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	83
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Brown/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางนา เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656577 E 1519393 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/4

Sample Type : Wastewater

Sampling Date : 26 August 2025

Sampling Time : 09.45 a.m.

Received Date : 27 August 2025

Analytical Date : 27 August – 05 September 2025

Report Date : 08 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 26.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	45.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	314	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	24.5	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	19	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Sample Appearance		Yellow/Clear/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีสอร์ท
 ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
 กรุงเทพมหานคร 10160
Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร C)
GPS. Coordinate : 47 P 656532 E 1519311 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/5
Sample Type : Wastewater
Sampling Date : 20 August 2025
Sampling Time : 10.15 a.m.
Received Date : 21 August 2025
Analytical Date : 21 August – 03 September 2025
Report Date : 04 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	165
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	296
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	126
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.62
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	4.0
Total Kjeldahl Nitrogen * ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	64
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางนา เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656535 E 1519318 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/6

Sample Type : Wastewater

Sampling Date : 20 August 2025

Sampling Time : 10.10 a.m.

Received Date : 21 August 2025

Analytical Date : 21 August – 03 September 2025

Report Date : 04 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	29.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	258	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	72.2	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.21	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	58	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : จุดพักน้ำเสียสุดท้าย

GPS. Coordinate : 47 P 656515 E 1519473 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/7

Sample Type : Wastewater

Sampling Date : 20 August 2025

Sampling Time : 09.50 a.m.

Received Date : 21 August 2025

Analytical Date : 21 August – 03 September 2025

Report Date : 04 September 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	12.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	264	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	18.4	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids ^{2/}	mL/L	Imhoff Cone (2540 F)	0.3	-
Total Kjeldahl Nitrogen ^{2/}	mg/L N	APHA:4500-Norg (B) ^{3/}	27	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656523 E 1519373 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/1

Sample Type : Wastewater

Sampling Date : 23 September 2025

Sampling Time : 10.29 a.m.

Received Date : 24 September 2025

Analytical Date : 24 September – 07 October 2025

Report Date : 08 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	305
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	312
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	164
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.8
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.60
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	12
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	78
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ตึกคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแกว เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656535 E 1519388 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/2

Sample Type : Wastewater

Sampling Date : 23 September 2025

Sampling Time : 10.23 a.m.

Received Date : 24 September 2025

Analytical Date : 24 September – 07 October 2025

Report Date : 08 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.3	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	16.3	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	240	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	17.6	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	31	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656580 E 1519391 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/3

Sample Type : Wastewater

Sampling Date : 23 September 2025

Sampling Time : 09.43 a.m.

Received Date : 24 September 2025

Analytical Date : 24 September – 07 October 2025

Report Date : 08 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	2,936
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	264
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	185
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	3.60
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	500
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	742
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Brown/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656577 E 1519393 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/4

Sample Type : Wastewater

Sampling Date : 23 September 2025

Sampling Time : 09.38 a.m.

Received Date : 24 September 2025

Analytical Date : 24 September – 07 October 2025

Report Date : 08 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.1	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	31.6	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	198	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	32.5	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	20	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656532 E 1519311 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/5

Sample Type : Wastewater

Sampling Date : 23 September 2025

Sampling Time : 10.01 a.m.

Received Date : 24 September 2025

Analytical Date : 24 September – 07 October 2025

Report Date : 08 October 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.2 °C	-	Electrometric Method (4500-H ⁺ B)	7.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	366
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	312
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	158
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	5.7
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	2.40
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	22
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	109
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Brown/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656535 E 1519318 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/6

Sample Type : Wastewater

Sampling Date : 23 September 2025

Sampling Time : 09.56 a.m.

Received Date : 24 September 2025

Analytical Date : 24 September – 07 October 2025

Report Date : 08 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	26.5	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	316	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	93.4	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	2.7	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.80	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	0.2	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	54	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : จุดพักน้ำเสียสุดท้าย
GPS. Coordinate : 47 P 656515 E 1519473 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/7
Sample Type : Wastewater
Sampling Date : 23 September 2025
Sampling Time : 09.31 a.m.
Received Date : 24 September 2025
Analytical Date : 24 September – 07 October 2025
Report Date : 08 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	14.3	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	224	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	19.4	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids*	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	26	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



บริษัท ทีเอ็นพี เอ็นไวรอนเม้นท์ จำกัด

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
 ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
 กรุงเทพมหานคร 10160
Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร A)
GPS. Coordinate : 47 P 656529 E 1519372 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/1
Sample Type : Wastewater
Sampling Date : 21 October 2025
Sampling Time : 11.00 a.m.
Received Date : 22 October 2025
Analytical Date : 22 October – 07 November 2025
Report Date : 10 November 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 26.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	200
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	359
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	193
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.2
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.49
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	8.0
Total Kjeldahl Nitrogen *. ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	75
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656517 E 1519378 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/2

Sample Type : Wastewater

Sampling Date : 21 October 2025

Sampling Time : 10.55 a.m.

Received Date : 22 October 2025

Analytical Date : 22 October – 07 November 2025

Report Date : 10 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 26.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	17.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	229	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	18.2	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	32	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656588 E 1519394 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/3

Sample Type : Wastewater

Sampling Date : 21 October 2025

Sampling Time : 10.31 a.m.

Received Date : 22 October 2025

Analytical Date : 22 October – 07 November 2025

Report Date : 10 November 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	181
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	317
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	104
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.35
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	6.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	49
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656569 E 1519389 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/4

Sample Type : Wastewater

Sampling Date : 21 October 2025

Sampling Time : 10.27 a.m.

Received Date : 22 October 2025

Analytical Date : 22 October – 07 November 2025

Report Date : 10 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	19.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	314	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	38.4	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.3	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	22	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	22,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656530 E 1519305 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/5

Sample Type : Wastewater

Sampling Date : 21 October 2025

Sampling Time : 10.45 a.m.

Received Date : 22 October 2025

Analytical Date : 22 October – 07 November 2025

Report Date : 10 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	138
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	444
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	148
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.35
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	6.5
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	60
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางนาแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656510 E 1519307 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/6

Sample Type : Wastewater

Sampling Date : 21 October 2025

Sampling Time : 10.40 a.m.

Received Date : 22 October 2025

Analytical Date : 22 October – 07 November 2025

Report Date : 10 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	22.5	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	422	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	109	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	2.7	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	0.91	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	55	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุคคณาการชุด ตีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-จรัญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : จุดพักน้ำเสียสุดท้าย
GPS. Coordinate : 47 P 656505 E 1519467 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/7
Sample Type : Wastewater
Sampling Date : 21 October 2025
Sampling Time : 10.18 a.m.
Received Date : 22 October 2025
Analytical Date : 22 October – 07 November 2025
Report Date : 10 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 26.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	12.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	210	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	15.7	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	15	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุคคณาการชุด ตีคอนโด แคมปัส รีสอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656524 E 1519372 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/1

Sample Type : Wastewater

Sampling Date : 27 November 2025

Sampling Time : 11.53 a.m.

Received Date : 28 November 2025

Analytical Date : 28 November – 11 December 2025

Report Date : 12 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	210
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	410
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	222
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.90
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	8.0
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	67
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656543 E 1519383 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/2

Sample Type : Wastewater

Sampling Date : 27 November 2025

Sampling Time : 11.49 a.m.

Received Date : 28 November 2025

Analytical Date : 28 November – 11 December 2025

Report Date : 12 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 26.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	27.1	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	380	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	133	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	2.4	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.35	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 1.0	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	53	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
 ราชนฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชนฤกษ์ แขวงบางแกว เขตภาษีเจริญ
 กรุงเทพมหานคร 10160
Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร B)
GPS. Coordinate : 47 P 656590 E 1519390 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/3
Sample Type : Wastewater
Sampling Date : 27 November 2025
Sampling Time : 11.43 a.m.
Received Date : 28 November 2025
Analytical Date : 28 November – 11 December 2025
Report Date : 12 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 26.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	18.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	345
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	71.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.3
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.76
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 1.0
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	59
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Little Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ตึกคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656577 E 1519383 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/4

Sample Type : Wastewater

Sampling Date : 27 November 2025

Sampling Time : 11.40 a.m.

Received Date : 28 November 2025

Analytical Date : 28 November – 11 December 2025

Report Date : 12 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	17.6	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	300	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	31.5	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 1.0	-
Total Kjeldahl Nitrogen * ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตบุคคณาการชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656531 E 1519297 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/5

Sample Type : Wastewater

Sampling Date : 27 November 2025

Sampling Time : 12.02 p.m.

Received Date : 28 November 2025

Analytical Date : 28 November – 11 December 2025

Report Date : 12 December 2025


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	366
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	367
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	208
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	3.9
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.49
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	10.0
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	69
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656537 E 1519343 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/6

Sample Type : Wastewater

Sampling Date : 27 November 2025

Sampling Time : 11.58 a.m.

Received Date : 28 November 2025

Analytical Date : 28 November – 11 December 2025

Report Date : 12 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	42.5	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	387	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	138	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.35	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	54	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : จุดพักน้ำเสียสุดท้าย

GPS. Coordinate : 47 P 656515 E 1519462 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/7

Sample Type : Wastewater

Sampling Date : 27 November 2025

Sampling Time : 11.36 a.m.

Received Date : 28 November 2025

Analytical Date : 28 November – 11 December 2025

Report Date : 12 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	20.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	390	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	36.2	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.22	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 1.0	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	36	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ตีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแกว เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656525 E 1519367 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/1

Sample Type : Wastewater

Sampling Date : 18 December 2025

Sampling Time : 11.09 a.m.

Received Date : 19 December 2025

Analytical Date : 19 December 2025 – 07 January 2026

Report Date : 08 January 2026


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	194
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	419
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	228
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.63
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	4.1
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	115
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแกว เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร A)

GPS. Coordinate : 47 P 656494 E 1519374 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/2

Sample Type : Wastewater

Sampling Date : 18 December 2025

Sampling Time : 11.03 a.m.

Received Date : 19 December 2025

Analytical Date : 19 December 2025 – 07 January 2026

Report Date : 08 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	32.3	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	317	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	102	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	2.8	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.12	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	58	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-จรัญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656587 E 1519397 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/3

Sample Type : Wastewater

Sampling Date : 18 December 2025

Sampling Time : 11.20 a.m.

Received Date : 19 December 2025

Analytical Date : 19 December 2025 – 07 January 2026

Report Date : 08 January 2026


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	374
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	243
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	123
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	4.3
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.35
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	26
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	45
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุคคณาการชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร B)

GPS. Coordinate : 47 P 656575 E 1519395 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/4

Sample Type : Wastewater

Sampling Date : 18 December 2025

Sampling Time : 11.17 a.m.

Received Date : 19 December 2025

Analytical Date : 19 December 2025 – 07 January 2026

Report Date : 08 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	14.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	258	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	16.4	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	29	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	54,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024). , Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุคคณาการชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : ก่อนเข้าระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656532 E 1519301 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/5

Sample Type : Wastewater

Sampling Date : 18 December 2025

Sampling Time : 11.35 a.m.

Received Date : 19 December 2025

Analytical Date : 19 December 2025 – 07 January 2026

Report Date : 08 January 2026


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	96.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	365
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	187
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.1
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.49
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	63
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : หลังผ่านระบบบำบัดน้ำเสีย (อาคาร C)

GPS. Coordinate : 47 P 656534 E 1519311 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/6

Sample Type : Wastewater

Sampling Date : 18 December 2025

Sampling Time : 11.30 a.m.

Received Date : 19 December 2025

Analytical Date : 19 December 2025 – 07 January 2026

Report Date : 08 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	5.2	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	352	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	115	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	2.9	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ²⁻ F)	1.02	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	51	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดิคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13

Project Name : โครงการ dcondo Campus Resort Ratchaprak-Charan 13

Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160

Sampling Point : จุดพักน้ำเสียสุดท้าย

GPS. Coordinate : 47 P 656515 E 1519458 N

Sampling By : TNP ENVIRONMENT CO., LTD.

Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023

Sample No : W68023/7

Sample Type : Wastewater

Sampling Date : 18 December 2025

Sampling Time : 10.56 a.m.

Received Date : 19 December 2025

Analytical Date : 19 December 2025 – 07 January 2026

Report Date : 08 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	306	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	34.7	≤ 20
Oil and Grease *	mg/L	Liquid-liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen *, ^{2/}	mg/L	APHA:4500-Norg (B) ^{3/}	36	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024) Building type A

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{3/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 23rd edition 2017.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ภาคผนวก ง2
คุณภาพน้ำสระว่ายน้ำ



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : สระว่ายน้ำ
GPS. Coordinate : 47 P N 656554 E 1519363
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/8
Sample Type : Swimming pool Water
Sampling Date : 29 July 2025
Sampling Time : 09.50 a.m.
Received Date : 30 July 2025
Analytical Date : 30 July – 11 August 2025
Report Date : 13 August 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีซอร์ท
 ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
 กรุงเทพมหานคร 10160
Sampling Point : สระว่ายน้ำ
GPS. Coordinate : 47 P N 656586 E 1519369
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/8
Sample Type : Swimming pool Water
Sampling Date : 20 August 2025
Sampling Time : 09.44 a.m.
Received Date : 21 August 2025
Analytical Date : 21 August – 03 September 2025
Report Date : 04 September 2025


Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria*	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria*	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

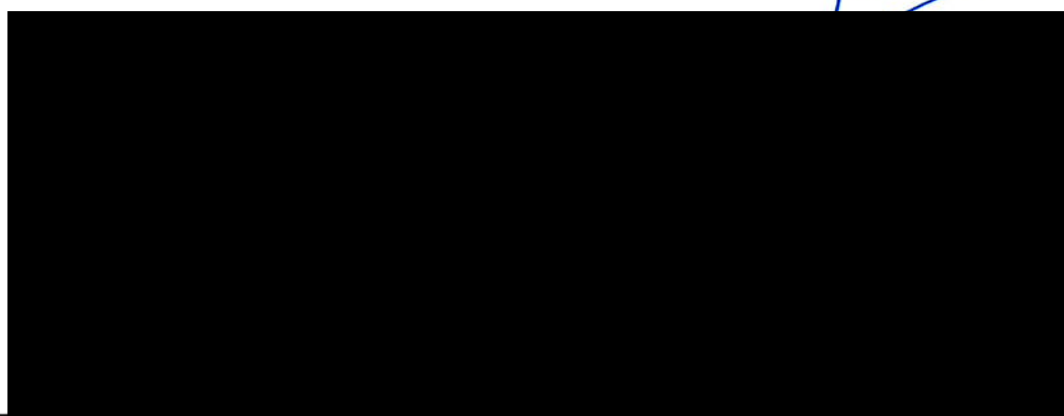

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ตีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruck-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางนา เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : สระว่ายน้ำ
GPS. Coordinate : 47 P N 656586 E 1519369
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/8
Sample Type : Swimming pool Water
Sampling Date : 23 September 2025
Sampling Time : 09.27 a.m.
Received Date : 24 September 2025
Analytical Date : 24 September – 07 October 2025
Report Date : 08 October 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> * ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคณาการชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : สระว่ายน้ำ
GPS. Coordinate : 47 P 656554 E 1519378 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/8
Sample Type : Swimming pool Water
Sampling Date : 21 October 2025
Sampling Time : 10.52 a.m.
Received Date : 22 October 2025
Analytical Date : 22 October – 06 November 2025
Report Date : 07 November 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีสอร์ท
ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแกว เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : สระว่ายน้ำ
GPS. Coordinate : 47 P 656535 E 1519367 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/8
Sample Type : Swimming pool Water
Sampling Date : 27 November 2025
Sampling Time : 12.07 p.m.
Received Date : 28 November 2025
Analytical Date : 28 November – 11 December 2025
Report Date : 12 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด ดีคอนโด แคมป์ส รีซอร์ท
ราชพฤกษ์-เจริญ 13
Project Name : โครงการ dcondo Campus Resort Ratchapruk-Charan 13
Address Project : เลขที่ 398 ถนนราชพฤกษ์ แขวงบางแวก เขตภาษีเจริญ
กรุงเทพมหานคร 10160
Sampling Point : สระว่ายน้ำ
GPS. Coordinate : 47 P 656543 N 1519358 E
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68023
Sample No : W68023/8
Sample Type : Swimming pool Water
Sampling Date : 18 December 2025
Sampling Time : 10.51 a.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 07 January 2026
Report Date : 08 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{2/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition 2023.

^{2/} Analyzed by Bureau Veritas AQ Lab (Thailand) Company Limited registration number Wo-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.