

ภาคผนวกที่ 2

ผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 16/07/2025 SAMPLING No. : 6807-758
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME : 11.01 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 16-31/07/2025 (MS. JUTAPORN JUTAMAST จ-176-จ-0006)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 16/07/2025
REPORTED DATE : 01/08/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
pH at 25 °C	-	Eletrometric Method	7.22	5.5 - 9.0
BOD ₅	mg/L	5-Day BOD Test, Azide modification Method	11.0	≤ 30
Total Suspended Solids	mg/L	Dried at 103-105 °C	9.0	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C	1,100	≤ 1,000
Total Kjeldahl Nitrogen	mg/L	Macro-Kjeldahl, Titrimetric Method	19.46	≤ 35

PHYSICAL APPEARANCE 1. Sample : yellowish, brown SS

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

Examined by .

(N

REPORTED ANALYSIS REFER TO SUBMITTED SAMPLES ONLY

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 16/07/2025 SAMPLING No. : 6807-758
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME : 11.01 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 16-31/07/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 16/07/2025
REPORTED DATE : 01/08/2025


PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
Grease & Oil	mg/L	Liquid-Liquid, Partition-Gravimetric Method	ND	≤ 20
Sulfide	mg/L as S ²⁻	Iodometric Method	0.07	≤ 1
Settleable Solids	mL/L	Volumetric Method	ND	-
Total Coliform Bacteria	MPN/100 mL	MPN Test Method	920,000	-

PHYSICAL APPEARANCE 1. Sample : yellowish, brown SS 2. Container : normal [PE 1.0 L]

STANDARD Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

REMARK 1) ND = Not Detected

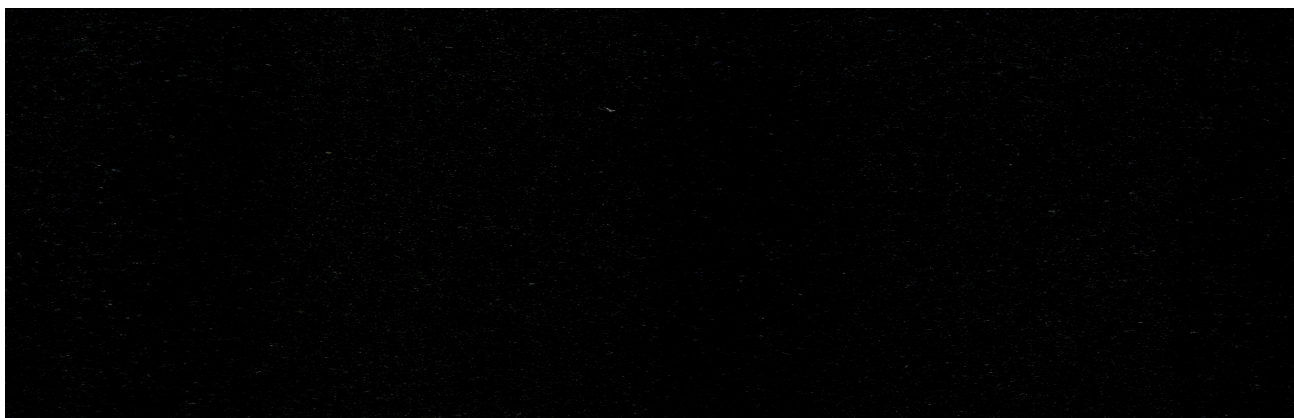

REPORTED ANALYSIS REFER TO SUMITTED SAMPLES ONLY

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER	: Erawan Phuket Co., Ltd.	ADDRESS	: 32 moo 5, T.Pakkok
SAMPLING SOURCE	: The Naka Island a Luxury Collection Resort & Spa		A.Thalang, Phuket
SAMPLING DATE	: 26/08/2025	SAMPLING No.	: 6808-1084
SAMPLING CONDITION	: Wastewater Treatment	SAMPLING TIME	: 07.44 AM
SAMPLING METHOD	: GRAB	SAMPLING BY	: STC
TESTED DATE	: 26/08/2025-08/09/2025	(MS. JUTAPORN JUTAMAST จ-176-จ-0006)	
FILE NAME	: Erawan Phuket Co., Ltd.	RECEIVED DATE	: 26/08/2025
		REPORTED DATE	: 09/09/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
pH at 25 °C	-	Eletrometric Method	7.09	5.5 - 9.0
BOD ₅	mg/L	5-Day BOD Test, Azide modification Method	19.0	≤ 30
Total Suspended Solids	mg/L	Dried at 103-105 °C (Part 2540D)	14	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (Part 2540C)	1,068	≤ 1,000
Total Kjeldahl Nitrogen	mg/L	Macro-Kjeldahl, Titrimetric Method	10.29	≤ 35

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD


Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

REMARK

1) Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023

Examined by

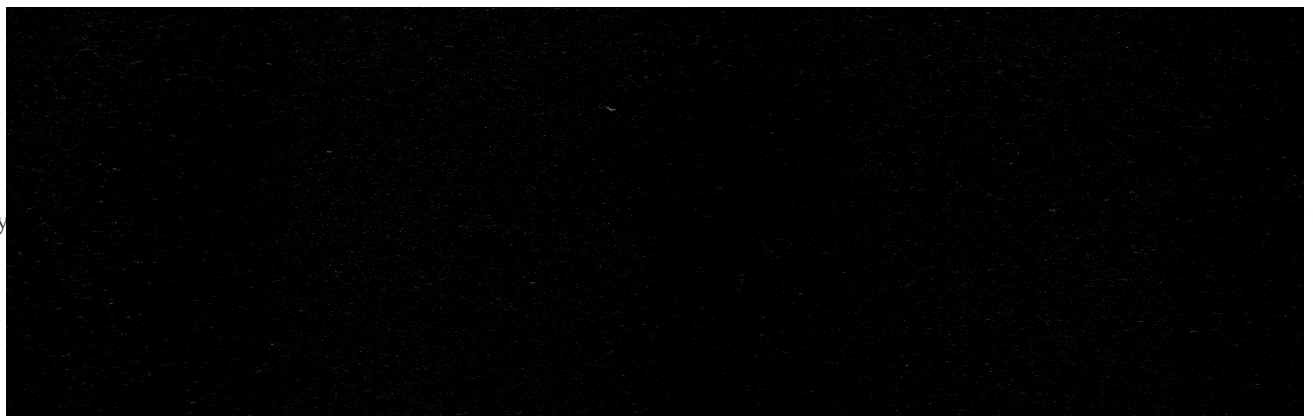

REPORTED ANALYSIS REFER TO SUBMITTED SAMPLES ONLY

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 26/08/2025 SAMPLING No. : 6808-1084
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME : 07.44 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 26/08/2025-08/09/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 26/08/2025
REPORTED DATE : 09/09/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
Grease & Oil	mg/L	Liquid-Liquid, Partition-Gravimetric Method	ND	≤ 20
Sulfide	mg/L as S ²⁻	Iodometric Method	0.13	≤ 1
Settleable Solids	mL/L	Volumetric Method	ND	-
Total Coliform Bacteria	MPN/100 mL	MPN Test Method	170,000	-

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD


Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

REMARK

1) Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023

2) ND = Not Detected

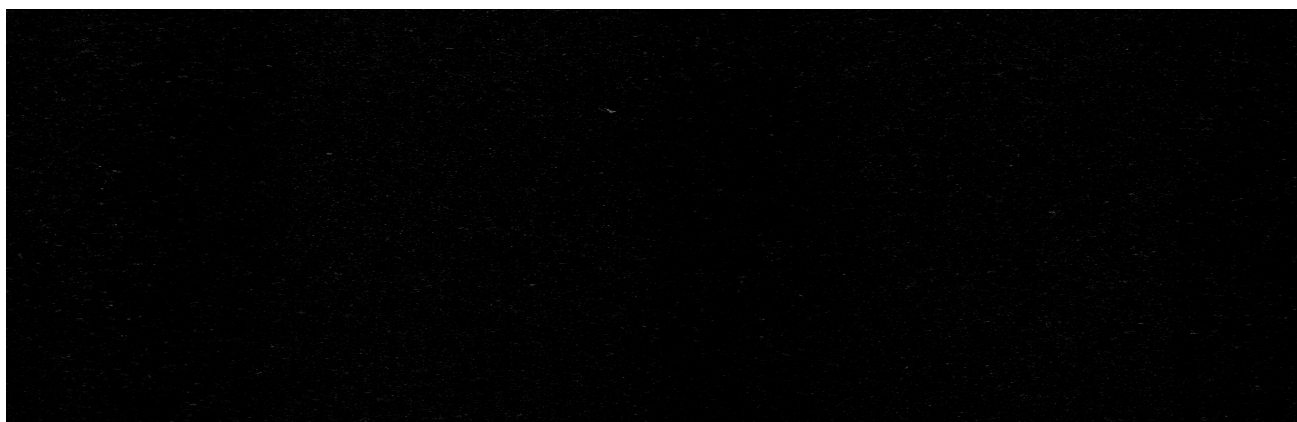

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 24/09/2025 SAMPLING No. : 6809-1026
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME : 11.05 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 24/09/2025-04/10/2025 (MS. JUTAPORN JUTAMAST จ-176-จ-0006)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 24/09/2025
REPORTED DATE : 06/10/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
pH at 25 °C	-	Eletrometric Method	6.77	5.5 - 9.0
BOD ₅	mg/L	5-Day BOD Test, Azide modification Method	7.0	≤ 30
Total Suspended Solids	mg/L	Dried at 103-105 °C (Part 2540D)	26	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (Part 2540C)	1,112	≤ 1,000
Total Kjeldahl Nitrogen	mg/L	Macro-Kjeldahl, Titrimetric Method	7.84	≤ 35

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS


2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

REMARK 1) Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023

Examined by

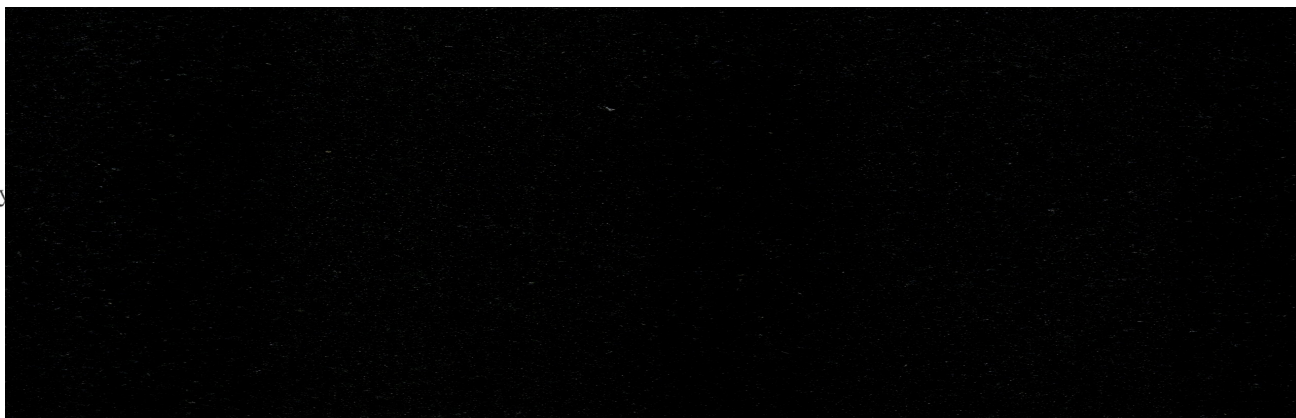

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER	: Erawan Phuket Co., Ltd.	ADDRESS	: 32 moo 5, T.Pakkok
SAMPLING SOURCE	: The Naka Island a Luxury Collection Resort & Spa		A.Thalang, Phuket
SAMPLING DATE	: 24/09/2025	SAMPLING No.	: 6809-1026
SAMPLING CONDITION	: Wastewater Treatment	SAMPLING TIME	: 11.05 AM
SAMPLING METHOD	: GRAB	SAMPLING BY	: STC
TESTED DATE	: 24/09/2025-04/10/2025		(MS. JUTAPORN JUTAMAST)
FILE NAME	: Erawan Phuket Co., Ltd.	RECEIVED DATE	: 24/09/2025
		REPORTED DATE	: 06/10/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
Grease & Oil	mg/L	Liquid-Liquid, Partition-Gravimetric Method	ND	≤ 20
Sulfide	mg/L as S ²⁻	Iodometric Method	0.13	≤ 1
Settleable Solids	mL/L	Volumetric Method	ND	-
Total Coliform Bacteria	MPN/100 mL	MPN Test Method	170,000	-

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS


2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

REMARK 1) Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023

2) ND = Not Detected

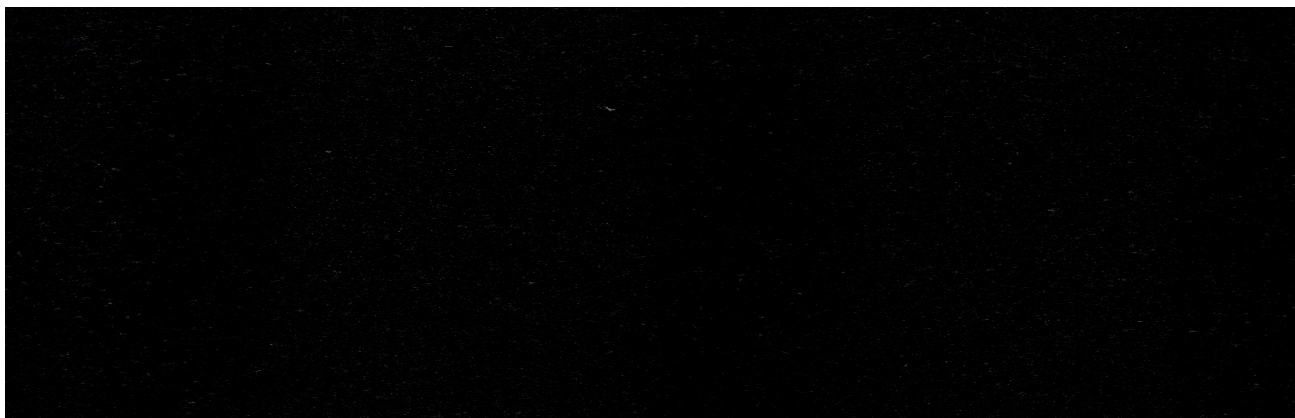

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 22/10/2025 SAMPLING No. : 6810-1093
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME : 11.23 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 22/10/2025-01/11/2025 (MS. JUTAPORN JUTAMAST ๖-176-๖-0006)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 22/10/2025
REPORTED DATE : 04/11/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
pH at 25 °C	-	Electrometric Method	6.61	5.5 - 9.0
BOD ₅	mg/L	5-Day BOD Test, Azide modification Method	27.0	≤ 30
Total Suspended Solids	mg/L	Dried at 103-105 °C (Part 2540D)	34	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (Part 2540C)	1,276	≤ 1,000
Total Kjeldahl Nitrogen	mg/L	Macro-Kjeldahl, Titrimetric Method	13.02	≤ 35

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD


Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

REMARK

1) Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

Examin

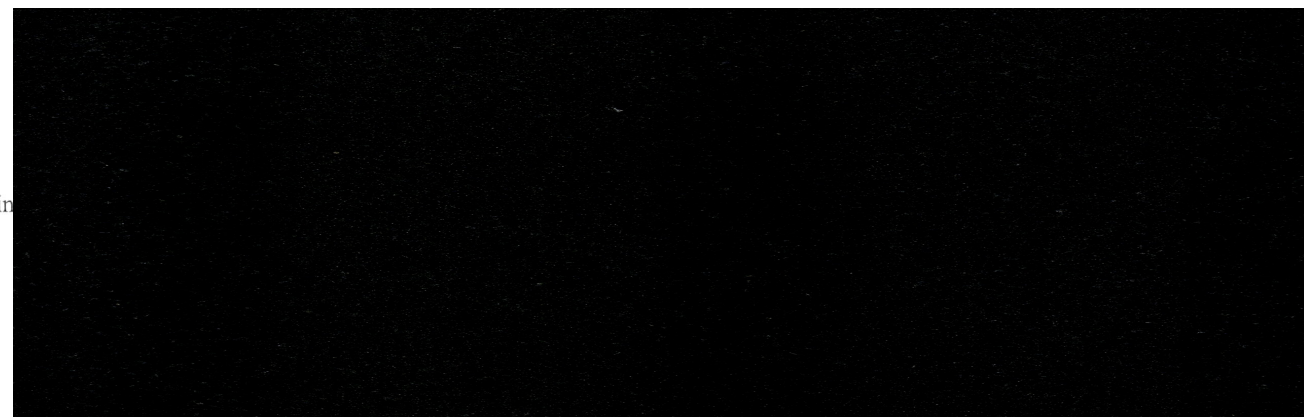

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 22/10/2025 SAMPLING No. : 6810-1093
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME : 11.23 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 22/10/2025-01/11/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 22/10/2025
REPORTED DATE : 04/11/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
Grease & Oil	mg/L	Liquid-Liquid, Partition-Gravimetric Method	1.0	≤ 20
Sulfide	mg/L as S ²⁻	Iodometric Method	0.20	≤ 1
Settleable Solids	mL/L	Volumetric Method	ND	-
Total Coliform Bacteria	MPN/100 mL	MPN Test Method	3,500,000	-

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

REMARK 1) Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023
2) ND = Not Detected

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE^{/3} : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE^{/3} : 21/11/2025 SAMPLING No. : 6811-1062
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME^{/3} : 08.26 AM
SAMPLING METHOD^{/3} : GRAB SAMPLING BY^{/3} : STC
TESTED DATE : 21/11/2025-09/12/2025 (MS. JUTAPORN JUTAMAST ๖-176-๑-0006)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 21/11/2025
REPORTED DATE : 11/12/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
pH at 25 °C ^{/1}	-	Eletrometric Method	7.48	5.5 - 9.0
BOD ₅ ^{/1}	mg/L	5-Day BOD Test, Azide modification Method	40.0	≤ 30
Total Suspended Solids	mg/L	Dried at 103-105 °C (Part 2540D)	177	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (Part 2540C)	818	≤ 1,000
Total Kjeldahl Nitrogen ^{/1}	mg/L	Macro-Kjeldahl, Titrimetric Method	23.38	≤ 35

PHYSICAL APPEARANCE 1. Sample : turbid, black SS, smelling

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD

Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

ANALYSIS METHOD

Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

REMARK

1. ^{/1} : Out of accredited scope by TISI (ISO/IEC 17025:2017)

2. ^{/2} : Out of accredited scope of private analysis laboratories ๖-176

Examin

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE^{/3} : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE^{/3} : 21/11/2025 SAMPLING No. : 6811-1062
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME^{/3} : 08.26 AM
SAMPLING METHOD^{/3} : GRAB SAMPLING BY^{/3} : STC
TESTED DATE : 21/11/2025-09/12/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 21/11/2025
REPORTED DATE : 11/12/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
Grease & Oil ^{/1}	mg/L	Liquid-Liquid, Partition-Gravimetric Method	5.0	≤ 20
Sulfide ^{/1}	mg/L as S ²⁻	Iodometric Method	1.80	≤ 1
Settleable Solids ^{/1,2}	mL/L	Volumetric Method	4.0	-
Total Coliform Bacteria ^{/1,2}	MPN/100 mL	MPN Test Method	9,200,000	-

PHYSICAL APPEARANCE 1. Sample : turbid, black SS, smelling

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD

Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

ANALYSIS METHOD

Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

REMARK

1. ^{/1} : Out of accredited scope by TISI (ISO/IEC 17025:2017)

2. ^{/2} : Out of accredited scope of private analysis laboratories 3.-176

3. ^{/3} : Information received from customer

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE^{/3} : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE^{/3} : 17/12/2025 SAMPLING No. : 6812-0946
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME^{/3} : 11.09 AM
SAMPLING METHOD^{/3} : GRAB SAMPLING BY^{/3} : STC
TESTED DATE : 17-25/12/2025 (MS. JUTAPORN JUTAMAST จ-176-จ-0006)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 17/12/2025
REPORTED DATE : 26/12/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
pH at 25 °C ^{/1}	-	Eletrometric Method	7.06	5.5 - 9.0
BOD ₅ ^{/1}	mg/L	5-Day BOD Test, Azide modification Method	108	≤ 30
Total Suspended Solids	mg/L	Dried at 103-105 °C (Part 2540D)	64	≤ 40
Total Dissolved Solids	mg/L	Dried at 180 °C (Part 2540C)	1,730	≤ 1,000
Total Kjeldahl Nitrogen ^{/1}	mg/L	Macro-Kjeldahl, Titrimetric Method	15.40	≤ 35

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS, smelling

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD

Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

ANALYSIS METHOD


Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

REMARK

1. ^{/1} : Out of accredited scope by TISI (ISO/IEC 17025:2017)

2. ^{/2} : Out of accredited scope of private analysis laboratories จ.-176

Exam

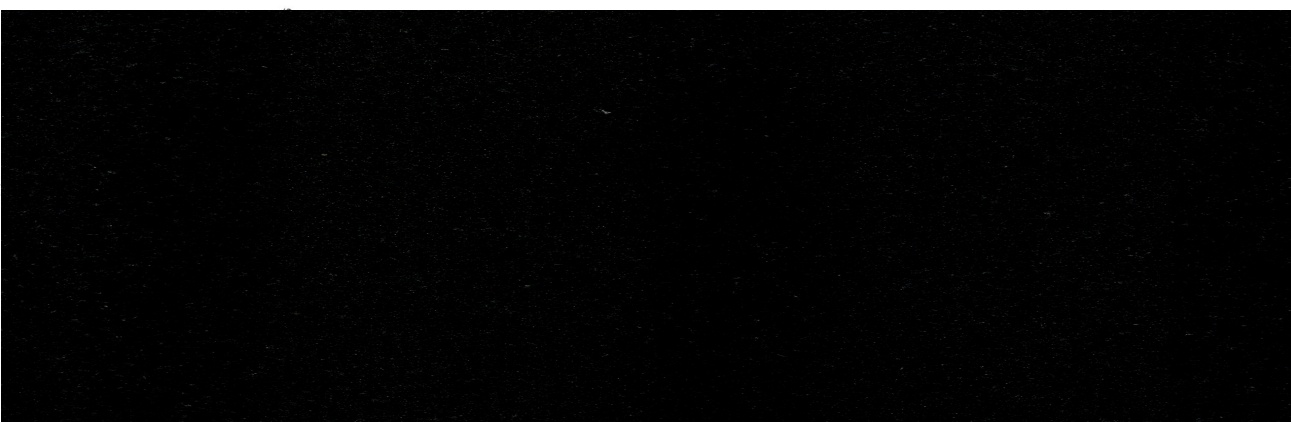

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE^{/3} : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE^{/3} : 17/12/2025 SAMPLING No. : 6812-0946
SAMPLING CONDITION : Wastewater Treatment SAMPLING TIME^{/3} : 11.09 AM
SAMPLING METHOD^{/3} : GRAB SAMPLING BY^{/3} : STC
TESTED DATE : 17-25/12/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 17/12/2025
REPORTED DATE : 26/12/2025

PARAMETER	UNIT	METHOD	RECYCLE WATER	STANDARD
Grease & Oil ^{/1}	mg/L	Liquid-Liquid, Partition-Gravimetric Method	1.0	≤ 20
Sulfide ^{/1}	mg/L as S ²⁻	Iodometric Method	0.40	≤ 1
Settleable Solids ^{/1,2}	mL/L	Volumetric Method	0.3	-
Total Coliform Bacteria ^{/1,2}	MPN/100 mL	MPN Test Method	2,400,000	-

PHYSICAL APPEARANCE 1. Sample : turbid, brown SS, smelling

2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD

Notification of the Ministry of Natural Resources and Environment B.E. 2567 (2024)

Subject : Standards for Controlling Wastewater from Certain Types and Sizes of Buildings (Type B)

ANALYSIS METHOD


Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

REMARK

1. ^{/1} : Out of accredited scope by TISI (ISO/IEC 17025:2017)

2. ^{/2} : Out of accredited scope of private analysis laboratories 3.-176

3. ^{/3} : Information received from customer

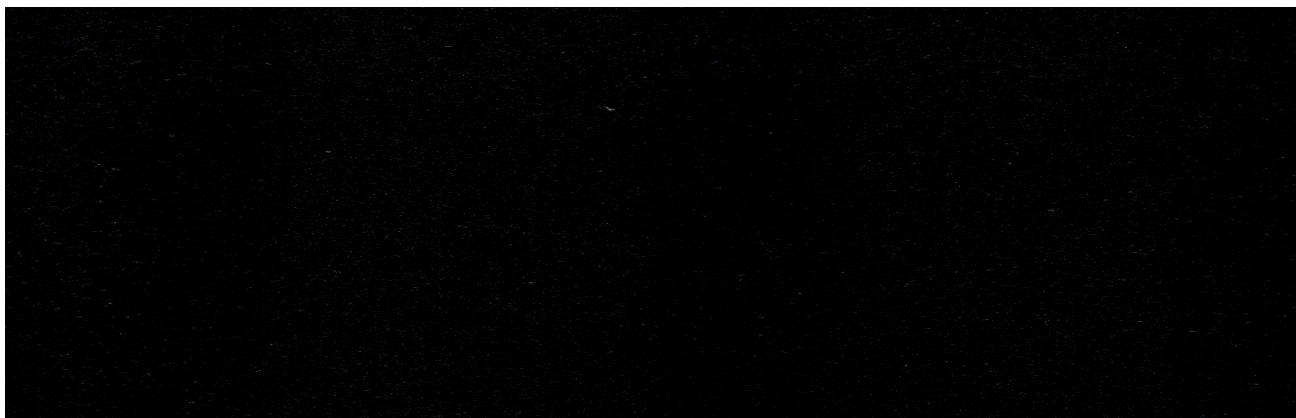

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER	: Erawan Phuket Co., Ltd.	ADDRESS	: 32 moo 5, T.Pakkok
SAMPLING SOURCE	: The Naka Island a Luxury Collection Resort & Spa		A.Thalang, Phuket
SAMPLING DATE	: 21/11/2025	SAMPLING No.	: 6811-1065
SAMPLING CONDITION	: Water	SAMPLING TIME	: 08.54 AM
SAMPLING METHOD	: GRAB	SAMPLING BY	: STC
TESTED DATE	: 21/11/2025-08/12/2025		(MS. JUTAPORN JUTAMAST จ-176-จ-0006)
FILE NAME	: Erawan Phuket Co., Ltd.	RECEIVED DATE	: 21/11/2025
		REPORTED DATE	: 11/12/2025


PARAMETER	UNIT	METHOD	Usage Water "Main Kitchen"	STANDARD
pH at 25 °C	-	Electrometric Method	7.32	6.5-8.5
Total Dissolved Solids	mg/L	Dried at 180 °C (Part 2540C)	747	≤ 600

PHYSICAL APPEARANCE 1. Sample : clear 2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Water Quality Standards of The Provincial Waterworks Authority 2024

ANALYSIS METHOD Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

Examined by

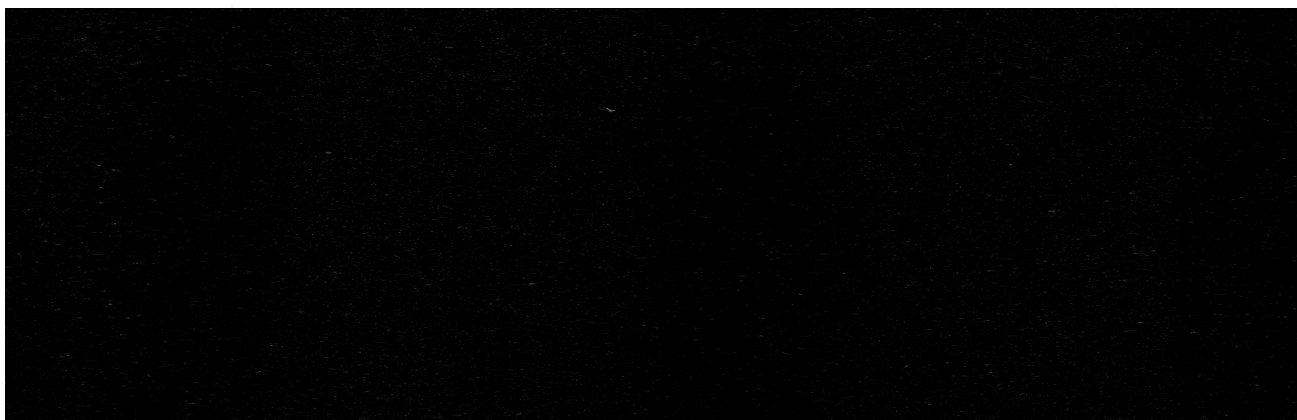

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 21/11/2025 SAMPLING No. : 6811-1065
SAMPLING CONDITION : Water SAMPLING TIME : 08.54 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 21/11/2025-08/12/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 21/11/2025
REPORTED DATE : 11/12/2025


PARAMETER	UNIT	METHOD	Usage Water "Main Kitchen"	STANDARD
Manganese	mg/L	Persulfate Method	ND	≤ 0.08
Iron	mg/L	Phenanthroline Method	ND	≤ 0.3
Chloride	mg/L	Argentometric Method	344.57	≤ 250
Hardness	mg/L as CaCO ₃	EDTA Titrimetric Method	106	≤ 300
Apparent color	Pt.Co	Spectrophotometric Method	ND	≤ 15
Turbidity	NTU	Nephelometric Method	0.37	≤ 4
Fluoride	mg/L	SPADNS Method	ND	≤ 0.7
Nitrate	mg/L	Cadmium Reduction Method	0.87	≤ 50

PHYSICAL APPEARANCE 1. Sample : clear 2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Water Quality Standards of The Provincial Waterworks Authority 2024

ANALYSIS METHOD Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

REMARK 1. ND = Not Detected

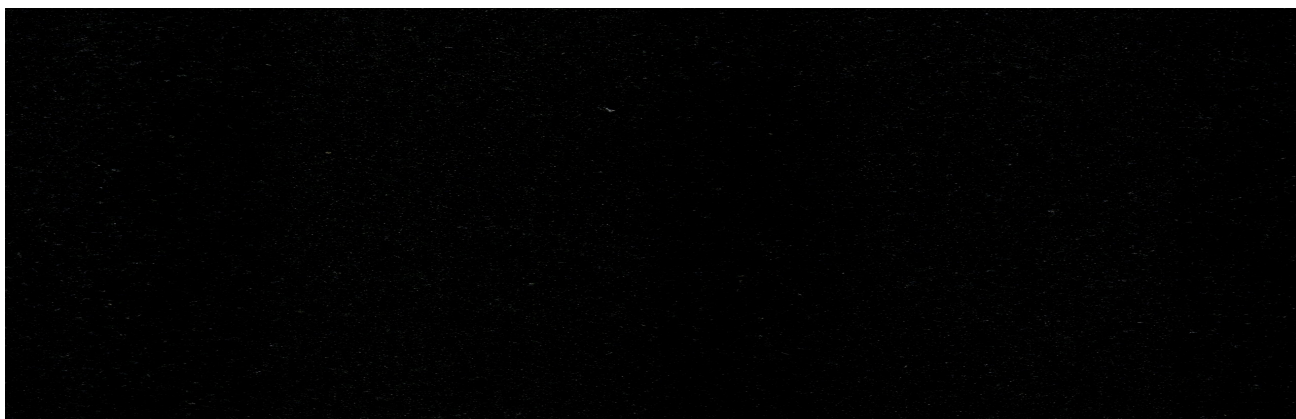

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY

Request No. 6811-0288



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 21/11/2025 SAMPLING No. : 6811-1065
SAMPLING CONDITION : Water SAMPLING TIME : 08.54 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 21/11/2025-08/12/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 21/11/2025
REPORTED DATE : 11/12/2025

PARAMETER	UNIT	METHOD	Usage Water "Main Kitchen"	STANDARD
Copper ^{1/}	mg/L	Digestion, Inductively coupled Plasma Method	ND	≤ 2
Zinc ^{1/}	mg/L	Digestion, Inductively coupled Plasma Method	ND	≤ 3
Lead ^{1/}	mg/L	Digestion, Inductively coupled Plasma Method	ND	≤ 0.01
Chromium ^{1/}	mg/L	Digestion, Inductively coupled Plasma Method	ND	≤ 0.05
Cadmium ^{1/}	mg/L	Digestion, Inductively coupled Plasma Method	ND	≤ 0.003
Arsenic ^{1/}	mg/L	Continuous Hydride Generation/AAS Method	ND	≤ 0.01
Mercury ^{1/}	mg/L	Cold Vapor Technique-AAS Method	ND	≤ 0.001
Sulfate ^{1/}	mg/L as SO ₄ ²⁻	Turbidimetric Method	30.20	≤ 250

PHYSICAL APPEARANCE 1. Sample : clear 2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Water Quality Standards of The Provincial Waterworks Authority 2024

ANALYSIS METHOD Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

REMARK 1. ^{1/} Tested by Eastern Thai Consulting 1992 Co.,Ltd. (Sriracha) : Registration No. ๓-003

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY

Request No. 6811-0288



TEST REPORT

CUSTOMER : Erawan Phuket Co., Ltd. ADDRESS : 32 moo 5, T.Pakkok
SAMPLING SOURCE : The Naka Island a Luxury Collection Resort & Spa A.Thalang, Phuket
SAMPLING DATE : 21/11/2025 SAMPLING No. : 6811-1065
SAMPLING CONDITION : Water SAMPLING TIME : 08.54 AM
SAMPLING METHOD : GRAB SAMPLING BY : STC
TESTED DATE : 21/11/2025-08/12/2025 (MS. JUTAPORN JUTAMAST)
FILE NAME : Erawan Phuket Co., Ltd. RECEIVED DATE : 21/11/2025
REPORTED DATE : 11/12/2025


PARAMETER	UNIT	METHOD	Usage Water "Main Kitchen"	STANDARD
Total coliform bacteria	in 100 mL	MPN Test Method	< 1.8	Not found
Escherichia Coli	in 100 mL	MPN Test Method	ND	Not found

PHYSICAL APPEARANCE 1. Sample : clear 2. Container : normal [PE 2.0 L (2 bottles), G 0.5 L]

STANDARD Water Quality Standards of The Provincial Waterworks Authority 2024

ANALYSIS METHOD Standard Methods for the Examination of Water and Wastewater, APHA, AWWA, WEF, 24th edition, 2023

REMARK
1. ND = Not Detected
2. Total coliform bacteria < 1.8 mean Not Detected

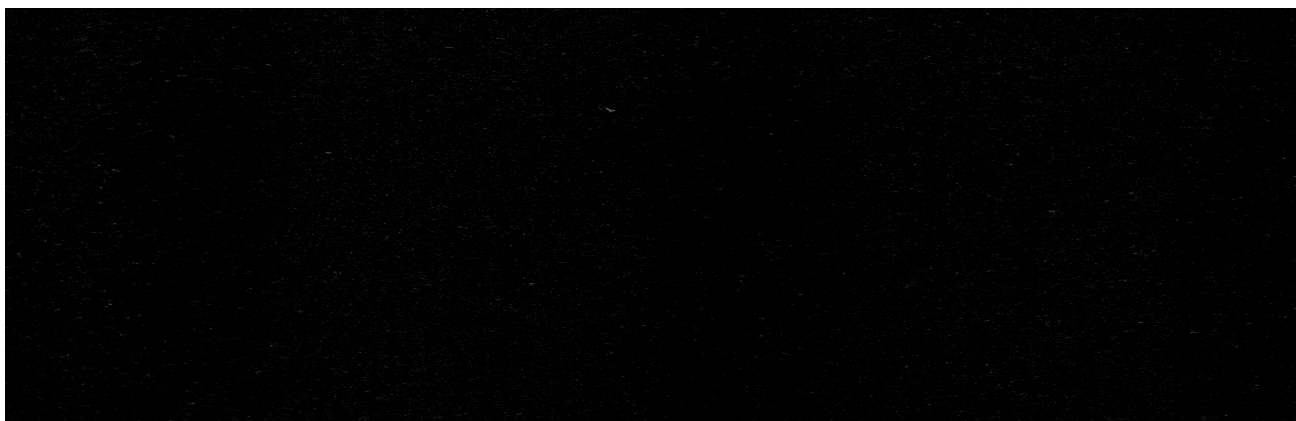

REPORTED ANALYSIS REFER TO SUBMITTED SAMPLES ONLY

THIS REPORT SHALL NOT REPRODUCED EXCEPT IN FULL WITHOUT THE WRITTEN APPROVAL LABORATORY