

ภาคผนวก ค
ใบรายงานผลการวิเคราะห์คุณภาพสิ่งแวดล้อม

- ค 1 รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า เดือนมกราคม พ.ศ. 2569
 - ค 2 รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า เดือนกุมภาพันธ์ พ.ศ. 2569
 - ค 3 รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า เดือนมีนาคม พ.ศ. 2569
 - ค 4 รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า เดือนเมษายน พ.ศ. 2569
 - ค 5 รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า เดือนพฤษภาคม พ.ศ. 2569
 - ค 6 รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า เดือนมิถุนายน พ.ศ. 2569
 - ค 7 รายงานผลการวิเคราะห์คุณภาพน้ำในหอฝิ่งเย็น เดือนมิถุนายน พ.ศ. 2569
 - ค 8 รายงานผลการวิเคราะห์คุณภาพน้ำประปา เดือนมิถุนายน พ.ศ. 2569
-

ภาคผนวก ค 1

รายงานผลการติดตามตรวจสอบคุณภาพสระว่ายน้ำ
เดือนมกราคม พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL

SAMPLING DATE : JANUARY 9, 2026

SAMPLING TIME : 16:10 HOUR

SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE

SAMPLING BY ° : MR SUKSAN BOONLEANG

ANALYZED BY : MISS BUSSAKORN MAJAI

RECEIVED DATE : JANUARY 9, 2026

ANALYTICAL DATE : JANUARY 9-16, 2026

ISSUE DATE : JANUARY 19, 2026

REPORT NO. : 2026-U003603

WORK NO. : 2025-006631

ANALYSIS NO. : T26AA360-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			SWIMMING POOL (SHALLOW ZONE) T26AA360-0001			
MICROBIOLOGY						
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1	-
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-	-
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR			
SEDIMENT			-			


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

.....



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 9, 2026
SAMPLING TIME : 16:10 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS BUSSAKORN MAJAI
RECEIVED DATE : JANUARY 9, 2026
ANALYTICAL DATE : JANUARY 9-12, 2026
ISSUE DATE : JANUARY 19, 2026
REPORT NO. : 2026-U003604
WORK NO. : 2025-006631
ANALYSIS NO. : T26AA360-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (SHALLOW ZONE) T26AA360-0001	
MICROBIOLOGY				
<i>Staphylococcus aureus</i>	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL

SAMPLING DATE : JANUARY 9, 2026

SAMPLING TIME : 16:05 HOUR

SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE

SAMPLING BY ^c : MR SUKSAN BOONLEANG

ANALYZED BY : MISS BUSSAKORN MAJAI

RECEIVED DATE : JANUARY 9, 2026

ANALYTICAL DATE : JANUARY 9-16, 2026

ISSUE DATE : JANUARY 19, 2026

REPORT NO. : 2026-U003605

WORK NO. : 2025-006631

ANALYSIS NO. : T26AA360-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			SWIMMING POOL (DEEP ZONE) T26AA360-0002			
MICROBIOLOGY						
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1	-
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-	-
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR			
SEDIMENT			-			

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 9, 2026
SAMPLING TIME : 16:05 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS BUSSAKORN MAJAI
RECEIVED DATE : JANUARY 9, 2026
ANALYTICAL DATE : JANUARY 9-12, 2026
ISSUE DATE : JANUARY 19, 2026
REPORT NO. : 2026-U003606
WORK NO. : 2025-006631
ANALYSIS NO. : T26AA360-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (DEEP ZONE) T26AA360-0002	
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ภาคผนวก ค 2

รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า
เดือนกุมภาพันธ์ พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 3, 2026
SAMPLING TIME : 14:45 HOUR
SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE
SAMPLING BY ° : MR SUKSAN BOONLEANG
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : FEBRUARY 3, 2026
ANALYTICAL DATE : FEBRUARY 3-9, 2026
ISSUE DATE : FEBRUARY 13, 2026
REPORT NO. : 2026-U010927
WORK NO. : 2025-006631
ANALYSIS NO. : T26AC079-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T26AC079-0001		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT


PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 3, 2026
SAMPLING TIME : 14:45 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS SUJIRA PRASERTSUKHO
RECEIVED DATE : FEBRUARY 3, 2026
ANALYTICAL DATE : FEBRUARY 3-9, 2026
ISSUE DATE : FEBRUARY 13, 2026
REPORT NO. : 2026-U010929
WORK NO. : 2025-006631
ANALYSIS NO. : T26AC079-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (SHALLOW ZONE) T26AC079-0001	
MICROBIOLOGY				
<i>Staphylococcus aureus</i>	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF . 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION				
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 3, 2026
SAMPLING TIME : 14:40 HOUR
SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE
SAMPLING BY ° : MR SUKSAN BOONLEANG
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : FEBRUARY 3, 2026
ANALYTICAL DATE : FEBRUARY 3-9, 2026
ISSUE DATE : FEBRUARY 13, 2026
REPORT NO. : 2026-U010930
WORK NO. : 2025-006631
ANALYSIS NO. : T26AC079-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T26AC079-0002		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		
			-		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

.....



ANALYSIS REPORT


PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 3, 2026
SAMPLING TIME : 14:40 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS SUJIRA PRASERTSUKHO
RECEIVED DATE : FEBRUARY 3, 2026
ANALYTICAL DATE : FEBRUARY 3-9, 2026
ISSUE DATE : FEBRUARY 13, 2026
REPORT NO. : 2026-U010932
WORK NO. : 2025-006631
ANALYSIS NO. : T26AC079-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (DEEP ZONE) T26AC079-0002	
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ภาคผนวก ค 3

รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า
เดือนมีนาคม พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 6, 2026
SAMPLING TIME : 15:45 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR SUKSAN BOONLEANG
ANALYZED BY : MISS BUSSAKORN MAJAI
RECEIVED DATE : MARCH 6, 2026
ANALYTICAL DATE : MARCH 6-12, 2026
ISSUE DATE : MARCH 19, 2026
REPORT NO. : 2026-U020258
WORK NO. : 2025-006631
ANALYSIS NO. : T26AE649-0001


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T26AE649-0001		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 6, 2026
SAMPLING TIME : 15:45 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MR RATCHATA THONGPIYAPOOM


RECEIVED DATE : MARCH 6, 2026
ANALYTICAL DATE : MARCH 6-9, 2026
ISSUE DATE : MARCH 19, 2026
REPORT NO. : 2026-U020260
WORK NO. : 2025-006631
ANALYSIS NO. : T26AE649-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (SHALLOW ZONE) T26AE649-0001	
MICROBIOLOGY				
<i>Staphylococcus aureus</i>	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 6, 2026
SAMPLING TIME : 15:40 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR SUKSAN BOONLEANG
ANALYZED BY : MISS BUSSAKORN MAJAI
RECEIVED DATE : MARCH 6, 2026
ANALYTICAL DATE : MARCH 6-12, 2026
ISSUE DATE : MARCH 19, 2026
REPORT NO. : 2026-U020262
WORK NO. : 2025-006631
ANALYSIS NO. : T26AE649-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T26AE649-0002		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 6, 2026
SAMPLING TIME : 15:40 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MR RATCHATA THONGPIYAPOOM


RECEIVED DATE : MARCH 6, 2026
ANALYTICAL DATE : MARCH 6-9, 2026
ISSUE DATE : MARCH 19, 2026
REPORT NO. : 2026-U020263
WORK NO. : 2025-006631
ANALYSIS NO. : T26AE649-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (DEEP ZONE) T26AE649-0002	
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ภาคผนวก ค 4

รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า
เดือนเมษายน พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL

SAMPLING DATE : APRIL 3, 2026

SAMPLING TIME : 14:35 HOUR

SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE

SAMPLING BY ^c : MR SUKSAN BOONLEANG

ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : APRIL 3, 2026

ANALYTICAL DATE : APRIL 3-10, 2026

ISSUE DATE : APRIL 20, 2026

REPORT NO. : 2026-U029967

WORK NO. : 2025-006631

ANALYSIS NO. : T26AH200-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T26AH200-0001		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 3, 2026
SAMPLING TIME : 14:35 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : APRIL 3, 2026
ANALYTICAL DATE : APRIL 3-10, 2026
ISSUE DATE : APRIL 20, 2026
REPORT NO. : 2026-U029968
WORK NO. : 2025-006631
ANALYSIS NO. : T26AH200-0001


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (SHALLOW ZONE) T26AH200-0001	
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

.....



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL

SAMPLING DATE : APRIL 3, 2026

SAMPLING TIME : 14:40 HOUR

SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE

SAMPLING BY ^c : MR SUKSAN BOONLEANG

ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : APRIL 3, 2026

ANALYTICAL DATE : APRIL 3-10, 2026

ISSUE DATE : APRIL 20, 2026

REPORT NO. : 2026-U029969

WORK NO. : 2025-006631

ANALYSIS NO. : T26AH200-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T26AH200-0002		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		


^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

.....



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL

SAMPLING DATE : APRIL 3, 2026

SAMPLING TIME : 14:40 HOUR

SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE

SAMPLING BY * : MR SUKSAN BOONLEANG

ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : APRIL 3, 2026

ANALYTICAL DATE : APRIL 3-10, 2026

ISSUE DATE : APRIL 20, 2026

REPORT NO. : 2026-U029970

WORK NO. : 2025-006631


ANALYSIS NO. : T26AH200-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (DEEP ZONE) T26AH200-0002	
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ภาคผนวก ค 5

รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า
เดือนพฤษภาคม พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 8, 2026
SAMPLING TIME : 11:25 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR SUKSAN BOONLEANG
ANALYZED BY : MR THEERAWAT BOONBUA
RECEIVED DATE : MAY 8, 2026
ANALYTICAL DATE : MAY 8-13, 2026
ISSUE DATE : MAY 21, 2026
REPORT NO. : 2026-U041256
WORK NO. : 2025-006631
ANALYSIS NO. : T26AJ915-0001


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T26AJ915-0001		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	23	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 8, 2026
SAMPLING TIME : 11:25 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : MAY 8, 2026
ANALYTICAL DATE : MAY 8-12, 2026
ISSUE DATE : MAY 21, 2026
REPORT NO. : 2026-U041257
WORK NO. : 2025-006631
ANALYSIS NO. : T26AJ915-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (SHALLOW ZONE) T26AJ915-0001	
MICROBIOLOGY				
<i>Staphylococcus aureus</i>	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 8, 2026
SAMPLING TIME : 11:20 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR SUKSAN BOONLEANG
ANALYZED BY : MR THEERAWAT BOONBUA
RECEIVED DATE : MAY 8, 2026
ANALYTICAL DATE : MAY 8-13, 2026
ISSUE DATE : MAY 21, 2026
REPORT NO. : 2026-U041258
WORK NO. : 2025-006631
ANALYSIS NO. : T26AJ915-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T26AJ915-0002		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^c	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT


PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 8, 2026
SAMPLING TIME : 11:20 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : MAY 8, 2026
ANALYTICAL DATE : MAY 8-12, 2026
ISSUE DATE : MAY 21, 2026
REPORT NO. : 2026-U041259
WORK NO. : 2025-006631
ANALYSIS NO. : T26AJ915-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (DEEP ZONE) T26AJ915-0002	
MICROBIOLOGY				
<i>Staphylococcus aureus</i>	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ภาคผนวก ค 6
รายงานผลการติดตามตรวจสอบคุณภาพน้ำสระว่ายนํ้า
เดือนมิถุนายน พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 8, 2026
SAMPLING TIME : 13:30 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR SUKSAN BOONLEANG
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : JUNE 8, 2026
ANALYTICAL DATE : JUNE 8-15, 2026
ISSUE DATE : JUNE 24, 2026
REPORT NO. : 2026-U055228
WORK NO. : 2025-006631
ANALYSIS NO. : T26AM525-0001


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (SHALLOW ZONE) T26AM525-0001		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^b	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT


PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 8, 2026
SAMPLING TIME : 13:30 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : JUNE 8, 2026
ANALYTICAL DATE : JUNE 8-15, 2026
ISSUE DATE : JUNE 24, 2026
REPORT NO. : 2026-U055229
WORK NO. : 2025-006631
ANALYSIS NO. : T26AM525-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (SHALLOW ZONE) T26AM525-0001	
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

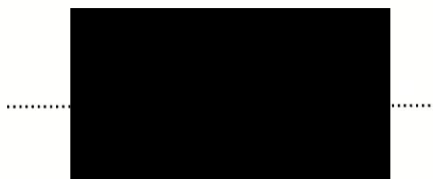

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 8, 2026
SAMPLING TIME : 13:35 HOUR
SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE
SAMPLING BY ^c : MR SUKSAN BOONLEANG
ANALYZED BY : MR THEERAWAT BOONBUA
RECEIVED DATE : JUNE 8, 2026
ANALYTICAL DATE : JUNE 8-15, 2026
ISSUE DATE : JUNE 24, 2026
REPORT NO. : 2026-U055231
WORK NO. : 2025-006631
ANALYSIS NO. : T26AM525-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			SWIMMING POOL (DEEP ZONE) T26AM525-0002		
MICROBIOLOGY					
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
<i>E. coli</i> ^b	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
<i>Pseudomonas aeruginosa</i> ^b	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -		

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR
OTHER SIMILAR BUSINESSES.



ANALYSIS REPORT


PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
RECEIVED DATE : JUNE 8, 2026
SAMPLING DATE : JUNE 8, 2026
ANALYTICAL DATE : JUNE 8-15, 2026
SAMPLING TIME : 13:35 HOUR
ISSUE DATE : JUNE 24, 2026
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
REPORT NO. : 2026-U055233
SAMPLING BY * : MR SUKSAN BOONLEANG
WORK NO. : 2025-006631
ANALYZED BY : MISS JITSAMON NGAMKANA
ANALYSIS NO. : T26AM525-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD
			SWIMMING POOL (DEEP ZONE) T26AM525-0002	
MICROBIOLOGY				
<i>Staphylococcus aureus</i>	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.



ภาคผนวก ค 7
รายงานผลการวิเคราะห์คุณภาพน้ำในหอฝิ่งเย็น
เดือนมิถุนายน พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : COOLING WATER

SAMPLING DATE : JUNE 8, 2026

SAMPLING TIME : 13:20 HOUR

SAMPLING METHOD ° : GRAB AND STERILE TECHNIQUE

SAMPLING BY ° : MR SUKSAN BOONLEANG

ANALYZED BY : MR THEERAWAT BOONBUA

RECEIVED DATE : JUNE 8, 2026

ANALYTICAL DATE : JUNE 8-16, 2026

ISSUE DATE : JUNE 24, 2026

REPORT NO. : 2026-U055235

WORK NO. : 2025-006631

ANALYSIS NO. : T26AM525-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			จุดที่ไหลเข้ามาเดิมในระบบ T26AM525-0003	
pH ^c	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500 -H ⁺ B AND 1060 B	7.2 (31.0°C)	-
RESIDUAL CHLORINE ^c	mg/L Cl ₂	MODIFIED DPD COLOURIMETRIC METHOD (AT SITE)	ND	0.1
MICROBIOLOGY				
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.8	1.8
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

ND : NOT DETECTED.

.....



ANALYSIS REPORT


PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 8, 2026
SAMPLING TIME : 13:20 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS CHATTRAPORN RATCHANET
RECEIVED DATE : JUNE 8, 2026
ANALYTICAL DATE : JUNE 8-16, 2026
ISSUE DATE : JUNE 24, 2026
REPORT NO. : 2026-U055237
WORK NO. : 2025-006631
ANALYSIS NO. : T26AM525-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			จุดที่ไหลเข้ามาเดิมในระบบ T26AM525-0003		
MICROBIOLOGY					
Legionella spp.	CFU/L	ISO 11731:2017-05 (E)	NOT DETECTED	NOT DETECTED	100
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : ANNOUNCEMENT OF THE DEPARTMENT OF HEALTH (THAILAND), PRACTICE FOR THE CONTROL OF LEGIONELLA BACTERIA IN COOLING TOWERS, JANUARY 8, 2001.

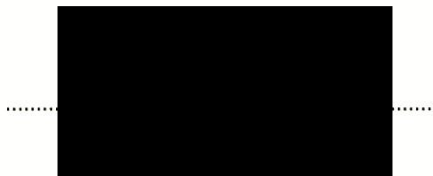

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : COOLING WATER

SAMPLING DATE : JUNE 8, 2026

SAMPLING TIME : 13:15 HOUR

SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE

SAMPLING BY ^c : MR SUKSAN BOONLEANG

ANALYZED BY : MR THEERAWAT BOONBUA

RECEIVED DATE : JUNE 8, 2026

ANALYTICAL DATE : JUNE 8-16, 2026

ISSUE DATE : JUNE 24, 2026

REPORT NO. : 2026-U055239

WORK NO. : 2025-006631

ANALYSIS NO. : T26AM525-0004


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ในอ่างรองรับน้ำ T26AM525-0004	
pH ^c	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500 -H ⁺ B AND 1060 B	8.7 (31.4°C)	-
RESIDUAL CHLORINE ^c	mg/L Cl ₂	MODIFIED DPD COLOURIMETRIC METHOD (AT SITE)	ND	0.1
MICROBIOLOGY				
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	2.0	1.8
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

ND : NOT DETECTED.

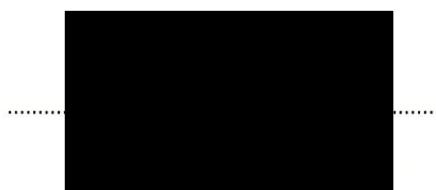

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 8, 2026
SAMPLING TIME : 13:15 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS CHATTRAPORN RATCHANET
RECEIVED DATE : JUNE 8, 2026
ANALYTICAL DATE : JUNE 8-16, 2026
ISSUE DATE : JUNE 24, 2026
REPORT NO. : 2026-U055241
WORK NO. : 2025-006631
ANALYSIS NO. : T26AM525-0004


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			ในอ่างรองรับน้ำ T26AM525-0004		
MICROBIOLOGY					
Legionella spp.	CFU/L	ISO 11731:2017-05 (E)	NOT DETECTED	NOT DETECTED	100
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : ANNOUNCEMENT OF THE DEPARTMENT OF HEALTH (THAILAND), PRACTICE FOR THE CONTROL OF LEGIONELLA BACTERIA IN COOLING TOWERS, JANUARY 8, 2001.

.....



ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569

CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED

ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK

CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com

SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG

SAMPLE TYPE : COOLING WATER

SAMPLING DATE : JUNE 8, 2026

SAMPLING TIME : 13:25 HOUR

SAMPLING METHOD ^c : GRAB AND STERILE TECHNIQUE

SAMPLING BY ^c : MR SUKSAN BOONLEANG

ANALYZED BY : MR THEERAWAT BOONBUA

RECEIVED DATE : JUNE 8, 2026

ANALYTICAL DATE : JUNE 8-16, 2026

ISSUE DATE : JUNE 24, 2026

REPORT NO. : 2026-U055244

WORK NO. : 2025-006631

ANALYSIS NO. : T26AM525-0005


PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	DETECTION LIMIT
			ท่อน้ำทิ้งจากหอผึ่งเย็น T26AM525-0005	
pH ^c	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500 -H ⁺ B AND 1060 B	8.5 (31.0°C)	-
RESIDUAL CHLORINE ^c	mg/L Cl ₂	MODIFIED DPD COLOURIMETRIC METHOD (AT SITE)	ND	0.1
MICROBIOLOGY				
TOTAL COLIFORMS ^b	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	33	1.8
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

ND : NOT DETECTED.



ANALYSIS REPORT


PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรฐานการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 8, 2026
SAMPLING TIME : 13:25 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MISS CHATTRAPORN RATCHANET
RECEIVED DATE : JUNE 8, 2026
ANALYTICAL DATE : JUNE 8-16, 2026
ISSUE DATE : JUNE 24, 2026
REPORT NO. : 2026-U055246
WORK NO. : 2025-006631
ANALYSIS NO. : T26AM525-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			หอน้ำทิ้งจากหอผึ่ง เป็น T26AM525-0005		
MICROBIOLOGY					
Legionella spp.	CFU/L	ISO 11731:2017-05 (E)	NOT DETECTED	NOT DETECTED	100
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : ANNOUNCEMENT OF THE DEPARTMENT OF HEALTH (THAILAND), PRACTICE FOR THE CONTROL OF LEGIONELLA BACTERIA IN COOLING TOWERS, JANUARY 8, 2001.

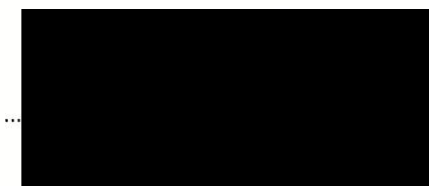

ภาคผนวก ค 8
รายงานผลการวิเคราะห์คุณภาพน้ำประปา
เดือนมิถุนายน พ.ศ. 2569

ANALYSIS REPORT

PROJECT NAME : การตรวจวัดคุณภาพสิ่งแวดล้อม และการตรวจสอบการปฏิบัติตามมาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม
โครงการ GRANDE CENTRE POINT SURAWONG ประจำปี 2569
CUSTOMER NAME : L&H HOTEL MANAGEMENT COMPANY LIMITED
ADDRESS : 299 SURAWONG ROAD, SURIYAWONG BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 082 996 5528 e-mail : sarayut.p@gcphotels.com
SAMPLING SOURCE : GRANDE CENTRE POINT SURAWONG
SAMPLE TYPE : WATER SUPPLY
SAMPLING DATE : JUNE 15, 2026
SAMPLING TIME : 14:30 HOUR
SAMPLING METHOD * : STERILE TECHNIQUE
SAMPLING BY * : MR SUKSAN BOONLEANG
ANALYZED BY : MR THEERAWAT BOONBUA
RECEIVED DATE : JUNE 15, 2026
ANALYTICAL DATE : JUNE 15-29, 2026
ISSUE DATE : JULY 6, 2026
REPORT NO. : 2026-U058857
WORK NO. : 2025-006631
ANALYSIS NO. : T26AN412-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT
			GUEST ROOM NO.1806 T26AN412-0001		
MICROBIOLOGY					
Legionella spp.	CFU/L	ISO 11731:2017-05 (E)	NOT DETECTED	NOT DETECTED	100
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : CRITERIA OF WATER SUPPLY QUALITY, NOTIFICATION OF THE METROPOLITAN WATERWORKS AUTHORITY,
B.E. 2565 (2022).

.....

