

ภาคผนวก ค

รายงานผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม

ภาคผนวก ค-1

รายงานผลการติดตามตรวจสอบ
คุณภาพอากาศในบรรยากาศโดยทั่วไป



Analysis Report (TSP&PM10)

Job No. : QT. A003/2026

Issued Date : 6 February 2026

REPORT No. AP002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพนเมือง (085-835-3701)
SAMPLE DESIGNATED AS Ambient Air Quality
SAMPLING LOCATION ชุมชนบ้านสูง (บ้านป่าคลองระบม) ม.3 ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(พิกัดจุดตรวจวัด 13° 41' 54.7" N, 101° 26' 32.3" E)
SAMPLING DATE 28 - 31 January 2026
ANALYSIS DATE 5 February 2026
ANALYTICAL METHOD Gravimetric Method

Sampling Date	Result ($\mu\text{g}/\text{m}^3$)	
	TSP	PM-10
28 - 29 January 2026	134	83
29 - 30 January 2026	149	64
30 - 31 January 2026	176	77
Standard ^{1/}	200	100

Remarks : Concentration of each gas in ambient is based on 1 atm and 25°C

Reference : ^{1/}Notification of the National Environment Board, B.E. 2569

Tested by น.นุญเกียรติ
Mr. Nuengruithai Obmalee
Environmental Scientist

Approved by น.ชิตตา
Ms. Thittaya Nanmuen
Laboratory Manager

- DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL
- REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY



Analysis Report (TSP&PM10)

Job No. : QT. A003/2026

Issued Date : 6 February 2026

REPORT No. AP002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพธิ์เมือง (085-835-3701)
SAMPLE DESIGNATED AS Ambient Air Quality
SAMPLING LOCATION ชุมชนบ้านเตาสดโยง ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(พิกัดจุดตรวจวัด 13° 43' 18.356'' N, 101° 29' 2.569'' E)
SAMPLING DATE 28 - 31 January 2026
ANALYSIS DATE 5 February 2026
ANALYTICAL METHOD Gravimetric Method

Sampling Date	Result ($\mu\text{g}/\text{m}^3$)	
	TSP	PM-10
28 - 29 January 2026	128	73
29 - 30 January 2026	130	67
30 - 31 January 2026	135	88
Standard ^{1/}	200	100

Remarks : Concentration of each gas in ambient is based on 1 atm and 25°C

Reference : ^{1/} Notification of the National Environment Board, B.E. 2569

Tested by ไกรวิทย์
Mr. Kaiwit Sangkaew
Environmental Scientist

Approved by กัทธ
Ms. Thittaya Nanmuen
Laboratory Manager

- DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL
- REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY



Analysis Report (WS-WD)

Job No. : QT. A003/2026

Issued Date : 4 February 2026

REPORT No. AW002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกฤษมา กุลโพธิ์เมือง (085-835-3701)
SAMPLING LOCATION ชุมชนบ้านสูง (บ้านป่าคลองระบม) ม.3 ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(13° 41' 54.7" N, 101° 26' 32.3" E)
SAMPLING DATE 28 - 31 January 2026
SAMPLE DESIGNATED AS Wind speed/Wind direction Sensor
ANALYTICAL METHOD Wind speed and direction recording meter/ISO

TIME	28 - 29 January 2026		29 - 30 January 2026		30 - 31 January 2026	
	WD	WS (m/s)	WD	WS (m/s)	WD	WS (m/s)
11.00 - 12.00	S	1.2	SSE	0.3	S	0.8
12.00 - 13.00	SSW	0.8	SE	0.8	SSW	0.9
13.00 - 14.00	SSW	0.6	SSW	1.9	SW	1.2
14.00 - 15.00	WSW	1.4	SSW	2.1	SW	1.2
15.00 - 16.00	SW	1.6	SW	1.8	SSW	0.9
16.00 - 17.00	SSW	1.6	WSW	1.7	WSW	0.8
17.00 - 18.00	WSW	1.9	W	2.3	WSW	2.1
18.00 - 19.00	WSW	2.0	W	2.1	WSW	2.0
19.00 - 20.00	WSW	2.1	WSW	1.5	WSW	2.4
20.00 - 21.00	WSW	1.4	SW	1.2	WSW	1.5
21.00 - 22.00	WSW	0.7	SSW	0.8	W	1.0
22.00 - 23.00	SW	0.8	SSW	0.3	S	0.6
23.00 - 00.00	SSW	0.2	SSW	0.2	S	0.3
00.00 - 01.00	SSW	0.3	S	0.4	S	0.6
01.00 - 02.00	SSW	0.1	S	0.4	SSW	0.8
02.00 - 03.00	SSW	0.1	SSE	0.1	S	0.5
03.00 - 04.00	SSW	0.1	SE	0.1	S	0.2
04.00 - 05.00	WSW	0.1	SW	0.1	SSW	0.1
05.00 - 06.00	SW	0.1	SSE	0.1	SE	0.1
06.00 - 07.00	SE	0.1	S	0.1	SE	0.1
07.00 - 08.00	SSW	0.1	SSW	0.1	SE	0.1
08.00 - 09.00	SSE	0.4	SSE	0.1	SE	0.3
09.00 - 10.00	SE	0.2	ESE	0.2	SW	0.2
10.00 - 11.00	S	0.3	SSE	0.6	S	0.2
Temp (oC)	28.0		25.9		27.0	
atm (mmHg)	760		760		760	
Air Condition	Fair		Fair		Fair	
ผังลมรายวัน (Wind Rose)						

Tested by จกต
Mr. Jakkree Inta
Environmental Scientist

Approved by Thorn
Ms. Thittaya Nanmuen
Laboratory Manager

- DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL
- REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY



Analysis Report (WS-WD)

Job No. : QT. A003/2026

Issued Date : 4 February 2026

REPORT No. AW002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพธิ์เมือง (085-835-3701)
SAMPLING LOCATION ชุมชนบ้านสูง (บ้านป่าคลองระบม) ม.3 ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(13° 41' 54.7" N, 101° 26' 32.3" E)
SAMPLING DATE 28 - 31 January 2026
SAMPLE DESIGNATED AS Wind speed/Wind direction Sensor
ANALYTICAL METHOD Wind speed and direction recording meter/ISO

ทิศทางลม	ความเร็วลม	ร้อยละความเร็วลม (%)				
		0.2 - 0.5 m/s	0.5 - 1.0 m/s	1.0 -1.5 m/s	1.5-2.0 m/s	> 2.0 m/s
N		-	-	-	-	-
NNE		-	-	-	-	-
NE		-	-	-	-	-
ENE		-	-	-	-	-
E		-	-	-	-	-
ESE		1.39	-	-	-	-
SE		2.78	1.39	-	-	-
SSE		2.78	1.39	-	-	-
S		8.33	5.56	1.39	-	-
SSW		5.56	8.33	-	2.78	1.39
SW		1.39	1.39	4.17	2.78	-
WSW		-	2.78	4.17	4.17	6.94
W		-	-	1.39	-	2.78
WNW		-	-	-	-	-
NW		-	-	-	-	-
NNW		-	-	-	-	-
CALM (<0.2 m/s)		25.0				

Tested by จักษ์
Mr. Jakkree Inta
Environmental Scientist

Approved by ทิชาน
Ms. Thittaya Nanmuen
Laboratory Manager

- DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL
- REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY




Analysis Report (WS-WD)

Job No. : QT. A003/2026

Issued Date : 4 February 2026

REPORT No. AW002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพธิ์เมือง (085-835-3701)
SAMPLING LOCATION ชุมชนบ้านสูง (บ้านป่าคลองระบม) ม.3 ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(13° 41' 54.7" N, 101° 26' 32.3" E)
SAMPLING DATE 28 - 31 January 2026
SAMPLE DESIGNATED AS Wind speed/Wind direction Sensor
ANALYTICAL METHOD Wind speed and direction recording meter/ISO

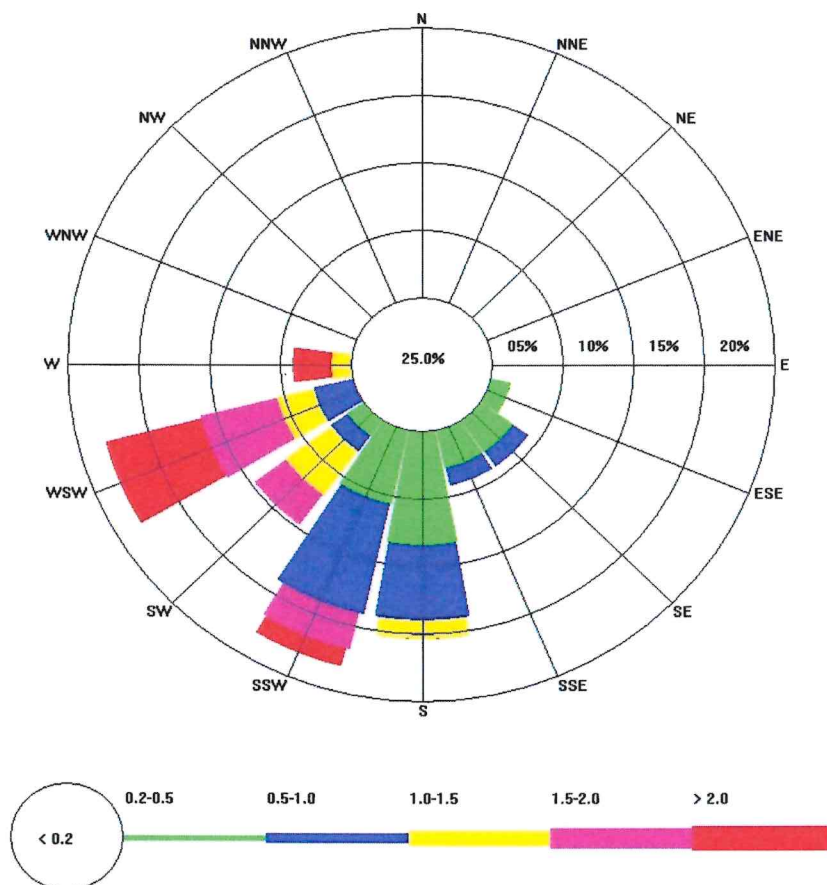

Tested by จกค
Mr. Jakkree Inta
Environmental Scientist

Approved by กชท
Ms. Thittaya Nanmuen
Laboratory Manager

• DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL

• REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY

Page 3 of 6

122 Moo. 2 Thatoom, Srimahaphote, Prachinburi, 25140 .TEL: 037-208-800 Ext.3838 FAX: 02-659-1430



Analysis Report (WS-WD)

Job No. : QT. A003/2026
Issued Date : 4 February 2026

REPORT No. AW002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพนเมือง (085-835-3701)
SAMPLING LOCATION ชุมชนบ้านเตาสดโยง ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(13° 43' 18.548" N , 101° 29' 02.569" E)
SAMPLING DATE 28 - 31 January 2026
SAMPLE DESIGNATED AS Wind speed/Wind direction Sensor
ANALYTICAL METHOD Wind speed and direction recording meter/ISO

TIME	28 - 29 January 2026		29 - 30 January 2026		30 - 31 January 2026	
	WD	WS (m/s)	WD	WS (m/s)	WD	WS (m/s)
10.00 - 11.00	E	1.9	E	2.3	ESE	0.4
11.00 - 12.00	E	2.7	ESE	2.5	NE	0.4
12.00 - 13.00	E	2.5	ESE	2.1	ESE	1.2
13.00 - 14.00	ESE	2.5	ESE	2.1	ENE	0.6
14.00 - 15.00	ESE	2.0	E	1.2	ESE	1.3
15.00 - 16.00	ESE	2.8	E	1.0	SSE	0.7
16.00 - 17.00	ESE	2.2	SE	1.7	E	0.9
17.00 - 18.00	ESE	1.9	ESE	1.2	NNE	0.2
18.00 - 19.00	ESE	0.9	NE	0.2	E	0.1
19.00 - 20.00	ESE	0.7	E	0.3	NNW	0.7
20.00 - 21.00	E	0.2	E	0.4	NW	0.4
21.00 - 22.00	E	0.3	W	0.2	WSW	0.2
22.00 - 23.00	E	0.8	E	0.3	SE	0.1
23.00 - 00.00	E	0.6	ESE	0.2	SE	0.4
00.00 - 01.00	NE	0.8	ESE	0.2	SSE	0.1
01.00 - 02.00	E	1.0	ENE	0.1	ESE	0.1
02.00 - 03.00	ESE	0.5	ESE	0.1	ENE	0.1
03.00 - 04.00	SE	0.4	ESE	0.4	ENE	0.6
04.00 - 05.00	E	0.2	NE	0.4	E	0.2
05.00 - 06.00	SE	0.4	ENE	0.8	SE	0.4
06.00 - 07.00	SE	1.3	ENE	0.8	SE	0.8
07.00 - 08.00	ESE	0.9	ESE	0.7	ESE	0.8
08.00 - 09.00	ESE	1.6	E	0.8	E	0.8
09.00 - 10.00	ESE	2.4	NE	0.8	NE	0.8
Temp (°C)	28.0		25.9		27.0	
atm (mmHg)	760		760		760	
Air Condition	Fair		Fair		Fair	
ผังลมรายวัน (Wind Rose)						

Tested by ไกรวิทย์
Mr. Kaiwit Sangkaew
Environmental Scientist

Approved by ทิฏฐยา
Ms. Thittaya Nanmuen
Laboratory Manager

- DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL
- REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY

Page 4 of 6



Analysis Report (WS-WD)

Job No. : QT. A003/2026
Issued Date : 4 February 2026

REPORT No. AW002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพนเมือง (085-835-3701)
SAMPLING LOCATION ชุมชนบ้านเตาหวดโยง ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(13° 43' 18.548" N , 101° 29' 02.569" E)
SAMPLING DATE 28 - 31 January 2026
SAMPLE DESIGNATED AS Wind speed/Wind direction Sensor
ANALYTICAL METHOD Wind speed and direction recording meter/ISO

ทิศทางลม	ร้อยละความเร็วลม (%)				
	0.2 - 0.5 m/s	0.5 - 1.0 m/s	1.0 -1.5 m/s	1.5-2.0 m/s	> 2.0 m/s
N	-	-	-	-	-
NNE	1.39	-	-	-	-
NE	4.17	4.17	-	-	-
ENE	-	5.56	-	-	-
E	9.72	6.94	4.17	1.39	4.17
ESE	5.56	8.33	4.17	2.78	11.11
SE	5.56	1.39	1.39	1.39	-
SSE	-	1.39	-	-	-
S	-	-	-	-	-
SSW	-	-	-	-	-
SW	-	-	-	-	-
WSW	1.39	-	-	-	-
W	1.39	-	-	-	-
WNW	-	-	-	-	-
NW	1.39	-	-	-	-
NNW	-	1.39	-	-	-
CALM (<0.2 m/s)	9.7				

Tested by


Mr. Kaiwit Sangkaew
Environmental Scientist

Approved by


Ms. Thittaya Nanmuen
Laboratory Manager

- DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL
- REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY

Page 5 of 6




Analysis Report (WS-WD)

Job No. : QT. A003/2026

Issued Date : 4 February 2026

REPORT No. AW002/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพนเมือง (085-835-3701)
SAMPLING LOCATION ชุมชนบ้านเตาสดโยง ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา
(13° 43' 18.548" N , 101° 29' 02.569" E)
SAMPLING DATE 28 - 31 January 2026
SAMPLE DESIGNATED AS Wind speed/Wind direction Sensor
ANALYTICAL METHOD Wind speed and direction recording meter/ISO

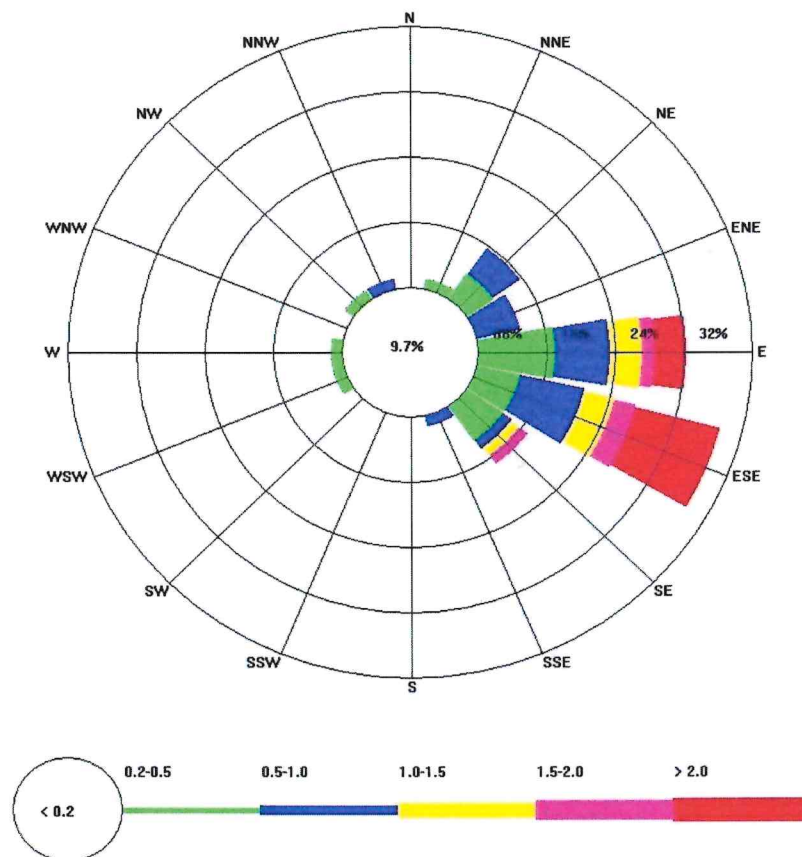

Tested by ไกรวิทย์
Mr. Kaiwit Sangkaew
Environmental Scientist

Approved by ทิษยา
Ms. Thittaya Nanmuen
Laboratory Manager

• DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL

• REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY

Page 6 of 6

122 Moo. 2 Thatoom, Srimahaphote, Prachinburi, 25140 .TEL: 037-208-800 Ext.3838 FAX: 02-659-1430

ภาคผนวก ค-2

รายงานผลการติดตามตรวจสอบ
คุณภาพอากาศจากปล่องระบาย

ANALYSIS REPORT

CUSTOMER NAME : NATIONAL POWER PLANT 3 COMPANY LIMITED (NPP3)
ADDRESS : 94/1 MOO 3 KHAO HIN SON PHANOM SARAKHAM CHACHOENGSAO 24120
CONTACT INFORMATION : TEL : 08 5835 3701 e-mail : kusuma_ku@npp.co.th
SAMPLING SOURCE : NATIONAL POWER PLANT 3 CO., LTD. (NPP3)
SAMPLE TYPE : STACK
SAMPLING DATE : JANUARY 30, 2026
SAMPLING TIME : 10:00-10:48 HOUR
SAMPLING BY : MR NOPPASIN THANUTHAMMARAT ๓-145-๓-0036
ANALYZED BY : MISS SUWAN KONGTHONG ๓-145-๓-0025

RECEIVED DATE : JANUARY 30, 2026
ANALYTICAL DATE : JANUARY 30-FEBRUARY 5, 2026
ISSUE DATE : FEBRUARY 9, 2026
REPORT NO. : 2026-U009631
WORK NO. : 2025-009856
ANALYSIS NO. : T26AB853-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	
			INLET ESP UNIT 4 (FOR EFFICIENCY CHECKING) T26AB853-0002	
			ACTUAL OXYGEN	7% OXYGEN
TOTAL SUSPENDED PARTICULATE	mg/m ³	ISOKINETIC, GRAVIMETRIC METHOD (US EPA METHOD 5)	2,018	2,723
SAMPLE CONDITION			COMPLETE	

DESCRIPTION	UNIT	RESULT
		INLET ESP UNIT 4 (FOR EFFICIENCY CHECKING) T26AB853-0002
AMBIENT PRESSURE	mmHg	757
AMBIENT TEMPERATURE	°C	36
STACK TEMPERATURE	°C	190.83
DIAMETER	m	2.18
GAS VELOCITY	m/s	13.42
FLOW RATE	Nm ³ /hr	154,949.61
OXYGEN	%	10.6
MOISTURE	%	15.68
CARBONDIOXIDE	%	11.42
VOLUME OF DRY GAS AT STP	m ³	0.945796

REMARK
 RESULT : REFERENCE CONDITION IS 25 DEGREE CELSIUS AT 1 ATMOSPHERE AND DRY BASIS.

Budsakorn ✓

(MISS BUDSAKORN LERDPANUMAS)
 LABORATORY SUPERVISOR
 ๓-145-๓-0011



ANALYSIS REPORT

CUSTOMER NAME : NATIONAL POWER PLANT 3 COMPANY LIMITED (NPP3)
ADDRESS : 94/1 MOO 3 KHAO HIN SON PHANOM SAKHAM CHACHOENGSAO 24120
CONTACT INFORMATION : TEL : 08 5835 3701 e-mail : kusuma_ku@npp.co.th
SAMPLING SOURCE : NATIONAL POWER PLANT 3 CO., LTD. (NPP3)
SAMPLE TYPE : STACK
SAMPLING DATE : JANUARY 30, 2026
SAMPLING TIME : 10:00-10:36 HOUR
SAMPLING BY : MR NOPPASIN THANUTHAMMARAT ๓-145-๓-0036
ANALYZED BY : MISS SUWAN KONGTHONG ๓-145-๓-0025

RECEIVED DATE : JANUARY 30, 2026
ANALYTICAL DATE : JANUARY 30-FEBRUARY 5, 2026
ISSUE DATE : FEBRUARY 9, 2026
REPORT NO. : 2026-U009621
WORK NO. : 2025-009856
ANALYSIS NO. : T26AB853-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	
			OUTLET ESP UNIT 4 T26AB853-0001	
			ACTUAL OXYGEN	7% OXYGEN
TOTAL SUSPENDED PARTICULATE	mg/m ³	ISOKINETIC, GRAVIMETRIC METHOD (US EPA METHOD 5)	30.9	44.8
SAMPLE CONDITION			COMPLETE	

DESCRIPTION	UNIT	RESULT
		OUTLET ESP UNIT 4 T26AB853-0001
AMBIENT PRESSURE	mmHg	754
AMBIENT TEMPERATURE	°C	31
STACK TEMPERATURE	°C	155
DIAMETER	m	2
GAS VELOCITY	m/s	15.77
FLOW RATE	Nm ³ /hr	107,499.77
OXYGEN	%	11.32
MOISTURE	%	12.52
CARBONDIOXIDE	%	7.97
VOLUME OF DRY GAS AT STP	m ³	0.970675

REMARK

RESULT : REFERENCE CONDITION IS 25 DEGREE CELSIUS AT 1 ATMOSPHERE AND DRY BASIS.

Budsakorn ✓

(MISS BUDDSAKORN LERDPANUMAS)
LABORATORY SUPERVISOR
๓-145-๓-0011



- PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
- THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.



ANALYSIS REPORT

CUSTOMER NAME : NATIONAL POWER PLANT 3 COMPANY LIMITED (NPP3)
ADDRESS : 94/1 MOO 3 KHAO HIN SON PHANOM SAKHAM CHACHOENGSAO 24120
CONTACT INFORMATION : TEL : 08 5835 3701 e-mail : kusuma_ku@npp.co.th
SAMPLING SOURCE : NATIONAL POWER PLANT 3 CO., LTD. (NPP3)
SAMPLE TYPE : STACK
SAMPLING DATE : JANUARY 30, 2026
SAMPLING TIME : 10:10-10:20 HOUR
SAMPLING BY : MR NOPPASIN THANUTHAMMARAT ๓-145-๓-0036
ANALYZED BY : MR NOPPASIN THANUTHAMMARAT ๓-145-๓-0036

RECEIVED DATE : JANUARY 30, 2026
ANALYTICAL DATE : JANUARY 30, 2026
ISSUE DATE : FEBRUARY 9, 2026
REPORT NO. : 2026-U009625
WORK NO. : 2025-009856
ANALYSIS NO. : T26AB853-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	
			OUTLET ESP UNIT 4 T26AB853-0001	
			ACTUAL OXYGEN	7% OXYGEN
SULPHUR DIOXIDE	ppm	U.S. EPA, CODE OF FEDERAL REGULATIONS, 40 CFR PART 60 APPENDIX A, METHOD 6C, JULY 2021	< 1	< 1
OXIDES OF NITROGEN AS NITROGEN DIOXIDE	ppm	U.S. EPA, CODE OF FEDERAL REGULATIONS, 40 CFR PART 60 APPENDIX A, METHOD 7E, JULY 2021	113	164
SAMPLE CONDITION			COMPLETE	

DESCRIPTION	UNIT	RESULT
		OUTLET ESP UNIT 4 T26AB853-0001
AMBIENT PRESSURE	mmHg	754
AMBIENT TEMPERATURE	°C	31
STACK TEMPERATURE	°C	155
DIAMETER	m	2
GAS VELOCITY	m/s	15.77
FLOW RATE	Nm³/hr	107,499.77
OXYGEN	%	11.32
MOISTURE	%	12.52
CARBONDIOXIDE	%	7.97
VOLUME OF DRY GAS AT STP	m³	0.970675

REMARK

RESULT : REFERENCE CONDITION IS 25 DEGREE CELSIUS AT 1 ATMOSPHERE AND DRY BASIS.

Nattawat

(MR NATTAWAT DANGSAWAT)
LABORATORY SUPERVISOR
๓-145-๓-0021



ANALYSIS REPORT

CUSTOMER NAME : NATIONAL POWER PLANT 3 COMPANY LIMITED (NPP3)
ADDRESS : 94/1 MOO 3 KHAO HIN SON PHANOM SAKHAM CHACHOENGSAO 24120
CONTACT INFORMATION : TEL : 08 5835 3701 e-mail : kusuma_ku@npp.co.th
MEASURING SOURCE : NATIONAL POWER PLANT 3 CO., LTD. (NPP3)
MEASURING TYPE : STACK
MEASURING DATE : JANUARY 30, 2026
MEASURING TIME : 10:30-11:00 HOUR
MEASURING METHOD : RINGELMANN'S METHOD
MEASURED BY : MR NOPPASIN THANUTHAMMARAT ๓-145-๓-0036
MR NATTHAPONG MOUNGCHAI ๓-145-๓-0045

RECEIVED DATE : JANUARY 30, 2026
ANALYTICAL DATE : JANUARY 30, 2026
ISSUE DATE : FEBRUARY 9, 2026
REPORT NO. : 2026-U009630
WORK NO. : 2025-009856
ANALYSIS NO. : T26AB853-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT
			OUTLET ESP UNIT 4 T26AB853-0001
OPACITY	%	RINGELMANN'S METHOD	5

Nattawat

(MR NATTAWAT DANGSAWAT)
LABORATORY SUPERVISOR
๓-145-๓-0021



ภาคผนวก ค-3

รายงานผลการติดตามตรวจสอบระดับเสียงโดยทั่วไป



Analysis Report (Leq 24 hr.)

Job No. : QT. A003/2026

Issued Date : 18 February 2026

REPORT No. ASL001/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (NPP3)
CONTACT NAME คุณกุสุมา กุลโพนเมือง (085-835-3701)
MEASURED PARAMETER Leq 24 & L90
MEASURED DATE 28 - 31 January 2026
MEASURED TIME 10.30 am - 10.30 am
MEASURED INSTRUMENT Sound Level Meter Model Aco Type 6236 No.5 Serial No.100146

Period	STATION : ชุมชนบ้านสูง ม.3 ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา Coordinates (พิกัดจุดตรวจวัด 13° 41' 54.7" N, 101° 26' 32.3" E)						Standard*
	Sound Level [dB(A)]						
	28 - 29 January 2026		29 - 30 January 2026		30 - 31 January 2026		
	Leq	L90	Leq	L90	Leq	L90	
10.30 - 11.30	59.5	51.3	54.8	51.8	54.5	52.0	-
11.30 - 12.30	56.4	51.6	55.2	52.0	53.7	52.1	-
12.30 - 13.30	54.5	51.9	55.4	52.1	53.4	51.8	-
13.30 - 14.30	54.5	52.0	54.3	52.0	54.3	52.0	-
14.30 - 15.30	54.4	52.3	53.8	52.0	55.5	52.0	-
15.30 - 16.30	55.7	52.4	54.5	52.3	55.0	52.6	-
16.30 - 17.30	57.9	52.5	57.2	52.2	58.3	52.6	-
17.30 - 18.30	54.5	52.2	55.9	52.6	56.7	52.7	-
18.30 - 19.30	56.5	52.3	54.5	52.7	55.3	52.7	-
19.30 - 20.30	54.2	52.6	54.4	52.8	57.8	53.1	-
20.30 - 21.30	53.8	52.7	54.3	53.0	55.0	53.6	-
21.30 - 22.30	53.8	52.8	54.9	53.3	54.5	53.5	-
22.30 - 23.30	54.2	52.9	55.1	53.0	54.4	53.5	-
23.30 - 00.30	54.2	53.0	53.5	53.0	54.3	53.7	-
00.30 - 01.30	53.7	53.0	53.8	52.3	54.6	53.7	-
01.30 - 02.30	54.3	53.0	53.6	53.1	54.8	54.0	-
02.30 - 03.30	54.7	53.0	54.2	53.0	54.7	53.7	-
03.30 - 04.30	54.5	53.1	54.0	53.1	54.9	53.8	-
04.30 - 05.30	55.4	53.2	55.4	53.2	55.6	54.0	-
05.30 - 06.30	58.3	53.9	57.3	53.7	59.6	54.5	-
06.30 - 07.30	58.6	54.0	58.3	53.9	58.6	54.4	-
07.30 - 08.30	57.2	53.0	57.7	53.6	58.3	54.0	-
08.30 - 09.30	58.6	52.0	54.9	52.7	55.7	53.3	-
09.30 - 10.30	57.2	51.4	55.6	52.9	55.6	52.6	-
Leq 24 hrs [dB(A)]	56.1	-	55.3	-	56.0	-	70
Lmax [dB(A)]	87.2	-	100.5	-	88.4	-	115

Reference : * Notification of the National Environment Board No.15, B.E. 2540 (1997).

* Notification of the Ministry of Industry, subject Standard of Noise Level from Factory Operation B.E. 2548 (2005).

Tested by
Mr. Jakkree Inta
Environmental Scientist

Approved by
Ms. Thittaya Nanmuen
Laboratory Manager

• DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL

• REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY

Page 1 of 1

ภาคผนวก ค-4

รายงานผลการติดตามตรวจสอบคุณภาพน้ำบ่อพักน้ำทิ้ง

รายงานผลการทดสอบคุณภาพน้ำ

รายงานเลขที่ : 2026/01/205

ชื่อลูกค้า : บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด

ที่อยู่ : 94/1 หมู่ 3 ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา 24120

ตัวอย่างเลขที่ : 2026/01/205

วันที่เก็บตัวอย่าง : 09/01/2026

เวลาเก็บตัวอย่าง : 14.26 น.

วันที่รับตัวอย่าง : 09/01/2026

สถานที่เก็บตัวอย่าง : บ่อ 7,000 m³

วันที่วิเคราะห์ : 9-16/01/2026

วิธีการเก็บตัวอย่าง : Grab

ชนิดตัวอย่าง : น้ำทิ้ง

พารามิเตอร์ที่ทดสอบ	หน่วย	วิธีทดสอบ	ผลการทดสอบ	Standard*
pH	-	Electrometric Method	8.1	5.5 - 9.0
Temperature	° C	Laboratory and Field Method	32.9	< 40
Total Suspended Solids	mg/L	Dried at 103-105 °C	14	≤ 50
Total Dissolved Solids	mg/L	Dried at 180 °C	275	≤ 3000
COD	mgO ₂ /L	Closed Reflux, Colorimetric Method	20	≤ 120
BOD	mg/L	5 -Day BOD Test,Azide Modification Method	2	≤ 20
Oil and Grease	mg/L	Liquid-Liquid,Partition-Gravimetric Method	< 4.0	≤ 5
Sulfide	mg/L	ZnS Precipitation,Iodometric Method	< 1	≤ 1
Total Kjeldahl Nitrogen	mg/L	Kjeldahl Method	< 10	≤ 100

ลักษณะตัวอย่าง : สีเหลือง ความขุ่นน้อย ตะกอนสีดำขนาดเล็ก แหวนลอย

หมายเหตุ : วิเคราะห์ตามมาตรฐาน Standard Methods for the Examination of Water and Wastewater ,
24th Edition,2023 ออกโดย APHA - AWWA - WEF.

: *อ้างอิงตามประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากโรงงาน
พ.ศ. 2560



อนุมัติโดย : 

(นางวีราภรณ์ ผลเจริญ)

ว-199-ค-0003

รายงานฉบับนี้รับรองเฉพาะตัวอย่างที่ได้ทำการทดสอบเท่านั้น ห้ามนำไปคัดลอกหรือรายงานผลเพียงบางส่วน โดยไม่ได้รับอนุญาตจากห้องปฏิบัติการเป็นลายลักษณ์อักษร

ANALYSIS REPORT

CUSTOMER NAME : NATIONAL POWER PLANT 3 COMPANY LIMITED (NPP3)
ADDRESS : 94/1 MOO 3 KHAO HIN SON PHANOM SARAKHAM CHACHOENGSAO 24120
CONTACT INFORMATION : TEL : 08 5835 3701 e-mail : kusuma_ku@npp.co.th
SAMPLING SOURCE : WASTEWATER TREATMENT PLANT
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JANUARY 9, 2026
SAMPLING TIME : 14:25 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR KRIDSANAPONG NAMTHIP
ANALYZED BY : MISS WANARIN SANON

RECEIVED DATE : JANUARY 9, 2026
ANALYTICAL DATE : JANUARY 9-15, 2026
ISSUE DATE : JANUARY 16, 2026
REPORT NO. : 2026-U003478
WORK NO. : 2025-009856
ANALYSIS NO. : T26AA363-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			บอผลงานเชื้อเพลิง T26AA363-0003			
ELECTRICAL CONDUCTIVITY ^b	μS/cm	ELECTRICAL CONDUCTIVITY METHOD (AT SITE) SM: PART 2510 B AND 1060 B	837 (32.9°C)	-	0.1	-
COLOUR (ORIGINAL pH) ^b	ADMI	ADMI WEIGHTED-ORDINATE SPECTROPHOTOMETRIC METHOD (SM: PART 2120 F)	12	≤ 300	-	10
COLOUR (pH 7.0) ^b	ADMI	ADMI WEIGHTED-ORDINATE SPECTROPHOTOMETRIC METHOD (SM: PART 2120 F)	12	≤ 300	-	10
TOTAL HARDNESS ^c	mg/L as CaCO ₃	EDTA TITRIMETRIC METHOD (SM: PART 2340 C)	81.7	-	1.0	4.0
NITRATE ^c	mg/L NO ₃ ⁻	CADMIUM REDUCTION METHOD (SM: PART 4500-NO ₃ E)	1.82	-	0.09	0.50
TOTAL KJELDAHL NITROGEN ^c	mg/L	SEMI-MICRO-KJELDAHL METHOD (SM: PART 4500-Norg C)	< 5.0	≤ 100	1.5	5.0
CHLORIDE ^c	mg/L Cl ⁻	ARGENTOMETRIC METHOD (SM: 4500 -Cl ⁻ B)	97.8	-	0.5	2.0
FLUORIDE ^a	mg/L F ⁻	ION-SELECTIVE ELECTRODE METHOD (SM: PART 4500-F C)	< 0.20	-	0.03	0.20
NON-CARBONATE HARDNESS ^c	mg/L as CaCO ₃	TITRATION, EDTA TITRIMETRIC (SM: PART 2320 B AND PART 2340 C) AND CALCULATION METHOD	0	-	-	-
PHOSPHATE ^c	mg/L PO ₄ ³⁻	ASCORBIC ACID METHOD (SM: PART 4500-P E)	1.65	-	0.03	0.15



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			บอกลานเชื้อเพลิง T26AA363-0003			
METALS						
TRIVALENT CHROMIUM ^c	mg/L Cr ³⁺	DIGESTION, DIRECT AIR-ACETYLENE FLAME METHOD; COLOURIMETRIC METHOD; CALCULATION (SM: PART 3030 E, PART 3111 B AND PART 3500-Cr B)	ND	≤ 0.75	0.010	-
IRON ^c	mg/L Fe	DIGESTION, DIRECT AIR-ACETYLENE FLAME METHOD (SM: PART 3030 E AND PART 3111 B)	0.216	-	0.005	0.100
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/CLEAR			
SEDIMENT			BROWN			

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : EFFLUENT STANDARD SET BY THE NOTIFICATION OF THE MINISTRY OF INDUSTRY.B.E. 2560 (2017).

ND : NOT DETECTED.

Bhuchonk p.

(MR BHUCHONK PANICHLERTUMPI)
LABORATORY SUPERVISOR

รายงานผลการทดสอบคุณภาพน้ำ

รายงานเลขที่ : 2026/05/310

ชื่อลูกค้า : บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด

ที่อยู่ : 94/1 หมู่ 3 ต.เขาหินซ้อน อ.พนมสารคาม จ.ฉะเชิงเทรา 24120

ตัวอย่างเลขที่ : 2026/05/310

วันที่เก็บตัวอย่าง : 07/05/2026

เวลาเก็บตัวอย่าง : 11.31 น.

วันที่รับตัวอย่าง : 07/05/2026

สถานที่เก็บตัวอย่าง : บ่อ 7,000 m³

วันที่วิเคราะห์ : 7-14/05/2026

วิธีการเก็บตัวอย่าง : Grab

ชนิดตัวอย่าง : น้ำทิ้ง

พารามิเตอร์ที่ทดสอบ	หน่วย	วิธีทดสอบ	ผลการทดสอบ	Standard*
pH	-	Electrometric Method	7.3	5.5 - 9.0
Temperature	° C	Laboratory and Field Method	36.0	< 40
Total Suspended Solids	mg/L	Dried at 103-105 °C	24	≤ 50
Total Dissolved Solids	mg/L	Dried at 180 °C	339	≤ 3000
COD	mgO ₂ /L	Closed Reflux, Colorimetric Method	42	≤ 120
BOD	mg/L	5 -Day BOD Test,Azide Modification Method	2	≤ 20
Oil and Grease	mg/L	Liquid-Liquid,Partition-Gravimetric Method	< 4.0	≤ 5
Sulfide	mg/L	ZnS Precipitation,Iodometric Method	< 1	≤ 1
Total Kjeldahl Nitrogen	mg/L	Kjeldahl Method	< 10	≤ 100

ลักษณะตัวอย่าง : สีขาว ความขุ่นน้อย ตะกอนสีดำขนาดเล็ก แขนวนลอย

หมายเหตุ : วิเคราะห์ตามมาตรฐาน Standard Methods for the Examination of Water and Wastewater , 24th Edition,2023 ออกโดย APHA - AWWA - WEF.

: *อ้างอิงตามประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากโรงงาน พ.ศ. 2560



อนุมัติโดย : 

(นางสาววิไลรัตน์ เกียรติธินชัย)

ว-199-ค-0001

รายงานฉบับนี้รับรองเฉพาะตัวอย่างที่ได้ทำการทดสอบเท่านั้น ห้ามนำไปคัดลอกหรือรายงานผลเพียงบางส่วน โดยไม่ได้รับอนุญาตจากห้องปฏิบัติการเป็นลายลักษณ์อักษร

ANALYSIS REPORT

CUSTOMER NAME	: NATIONAL POWER PLANT 3 COMPANY LIMITED (NPP3)	RECEIVED DATE	: MAY 8, 2026
ADDRESS	: 94/1 MOO 3 KHAO HIN SON PHANOM SARAKHAM CHACHOENGSAO 24120	ANALYTICAL DATE	: MAY 8-18, 2026
CONTACT INFORMATION	: TEL : 08 5835 3701 e-mail : kusuma_ku@npp.co.th	ISSUE DATE	: MAY 20, 2026
SAMPLING SOURCE	: WASTEWATER TREATMENT PLANT	REPORT NO.	: 2026-U040989
SAMPLE TYPE	: EFFLUENT	WORK NO.	: 2025-009856
SAMPLING DATE	: MAY 7, 2026	ANALYSIS NO.	: T26AJ744-0003
SAMPLING TIME	: 11:30 HOUR		
SAMPLING METHOD	: GRAB		
SAMPLING BY	: MR KRIDSANAPONG NAMTHIP		
ANALYZED BY	: MISS WANARIN SANON		

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			ปอแลนเชื้อเพลิง T26AJ744-0003			
ELECTRICAL CONDUCTIVITY ^b	µS/cm	ELECTRICAL CONDUCTIVITY METHOD (AT SITE) SM: PART 2510 B AND 1060 B	845 (36.0°C)	-	0.1	-
COLOUR (ORIGINAL pH) ^b	ADMI	ADMI WEIGHTED-ORDINATE SPECTROPHOTOMETRIC METHOD (SM: PART 2120 F)	14	≤ 300	-	10
COLOUR (pH 7.0) ^b	ADMI	ADMI WEIGHTED-ORDINATE SPECTROPHOTOMETRIC METHOD (SM: PART 2120 F)	13	≤ 300	-	10
TOTAL HARDNESS ^c	mg/L as CaCO ₃	EDTA TITRIMETRIC METHOD (SM: PART 2340 C)	95.6	-	1.0	4.0
NITRATE ^c	mg/L NO ₃ ⁻	CADMIUM REDUCTION METHOD (SM: PART 4500-NO ₃ ⁻ E)	< 0.50	-	0.09	0.50
TOTAL KJELDAHL NITROGEN ^c	mg/L	SEMI-MICRO-KJELDAHL METHOD (SM: PART 4500-Norg C)	< 5.0	≤ 100	1.5	5.0
CHLORIDE ^c	mg/L Cl ⁻	ARGENTOMETRIC METHOD (SM: 4500-Cl ⁻ B)	88.1	-	0.5	2.0
FLUORIDE ^a	mg/L F ⁻	ION-SELECTIVE ELECTRODE METHOD (SM: PART 4500-F ⁻ C)	< 0.20	-	0.03	0.20
NON-CARBONATE HARDNESS ^c	mg/L as CaCO ₃	TITRATION, EDTA TITRIMETRIC (SM: PART 2320 B AND PART 2340 C) AND CALCULATION METHOD	0	-	-	-
PHOSPHATE ^c	mg/L PO ₄ ³⁻	ASCORBIC ACID METHOD (SM: PART 4500-P E)	3.30	-	0.03	0.15



PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			ปอลานเชื้อเพลิง T26AJ744-0003			
METALS						
TRIVALENT CHROMIUM ^c	mg/L Cr ³⁺	DIGESTION, DIRECT AIR-ACETYLENE FLAME METHOD; COLOURIMETRIC METHOD; CALCULATION (SM: PART 3030 E, PART 3111 B AND PART 3500-Cr B)	ND	≤ 0.75	0.010	-
IRON ^c	mg/L Fe	DIGESTION, DIRECT AIR-ACETYLENE FLAME METHOD (SM: PART 3030 E AND PART 3111 B)	0.286	-	0.005	0.100
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/CLEAR			
SEDIMENT			BROWN			

^a : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

^b : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

^c : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24th EDITION, 2023.

REGULATORY STANDARD : EFFLUENT STANDARD SET BY THE NOTIFICATION OF THE MINISTRY OF INDUSTRY.B.E. 2560 (2017).

ND : NOT DETECTED.

Bhuchonk p.

(MR BHUCHONK PANICHLERTUMPI)
LABORATORY SUPERVISOR



ISO 9001
Quality
Management
Systems
CERTIFIED

ISO 14001
Environmental
Management
CERTIFIED

ISO 45001
Occupational
Health and Safety
Management
CERTIFIED

- PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
- THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

ภาคผนวก ค-5

รายงานผลการติดตามตรวจสอบระดับเสียงในพื้นที่ทำงาน



Analysis Report (Leq 8)

Job No. : QT. A003/2026

Issued Date : 18 February 2026

REPORT No. WS001/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (Unit 4)
CONTACT NAME คุณกุสุมา กุลโพธิ์เมือง (085-835-3701)
MEASURED PARAMETER Equivalent Sound Level 8 hours (Leq 8 hrs)
MEASURED DATE 29 January 2026
MEASURED TIME 5.30 pm - 11.30 pm
MEASURED INSTRUMENT Sound Level Meter Model Aco Type 6236 No.12 Serial No.192015

Location	Period	Sound Level [dB(A)]	
		Leq	Lmax
Air Compressor	1 st hour	91.6	92.5
	2 nd hour	91.0	92.3
	3 rd hour	89.3	91.2
	4 th hour	89.7	91.6
	5 th hour	89.7	90.5
	6 th hour	89.9	90.4
	7 th hour	89.9	91.2
	8 th hour	89.7	91.2
	Leq 8 hrs	90	
	Standard ^{1/}	85	

Reference : ^{1/} Announcement of Department of Labour Protection and Welfare, B.E.2561 (Time Weighted Average-TWA)

Tested by : จกตธ

Mr. Jakkree Inta
Environmental Scientist

Approved by : ทิศา

Ms. Thittaya Nanmuen
Laboratory Manager

• DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL

• REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY

Page 2 of 2

122 Moo. 2 Thatoom, Srimahaphote, Prachinburi, 25140 .TEL: 037-208-800 Ext.3838 FAX: 02-659-1430



Analysis Report (Leq 8)

Job No. : QT. A003/2026

Issued Date : 18 February 2026

REPORT No. WS001/2026
CUSTOMER NAME บริษัท เนชั่นแนล เพาเวอร์ แพลนท์ 3 จำกัด (Unit 4)
CONTACT NAME คุณกุสุมา กุลโพธิ์เมือง (085-835-3701)
MEASURED PARAMETER Equivalent Sound Level 8 hours (Leq 8 hrs)
MEASURED DATE 29 January 2026
MEASURED TIME 9.15 am - 5.15 pm
MEASURED INSTRUMENT Sound Level Meter Model Aco Type 6236 No.12 Serial No.192015

Location	Period	Sound Level [dB(A)]	
		Leq	Lmax
Turbine ชั้น 2	1 st hour	86.6	88.2
	2 nd hour	86.6	87.9
	3 rd hour	86.8	87.5
	4 th hour	86.7	87.6
	5 th hour	86.9	88.2
	6 th hour	86.8	88.6
	7 th hour	86.6	87.0
	8 th hour	86.5	87.2
	Leq 8 hrs	86	
	Standard ^{1/}	85	

Reference : ^{1/} Announcement of Department of Labour Protection and Welfare, B.E.2561 (Time Weighted Average-TWA)

Tested by : จกฐ

Mr. Jakkree Inta
Environmental Scientist

Approved by : กัฒน

Ms. Thittaya Nanmuen
Laboratory Manager

• DO NOT COPY PARTIAL OF THIS ANALYSIS REPORT WITHOUT OFFICIAL APPROVAL

• REPORTED ANALYSIS REFERS TO SUBMITTED SAMPLE ONLY

Page 1 of 2

122 Moo. 2 Thatoom, Srimahaphote, Prachinburi, 25140 .TEL: 037-208-800 Ext.3838 FAX: 02-659-1430