ภาคผนวก

ภาคผนวก 1

มาตรการป้องกันและแก้ไขผลกระทบสิ่งแวดล้อม

ภาคผนวก 2

จดทะเบียนอาคารชุด (อช.10)

(อ.ช.๑๐)

หนังสือสำคัญการจดทะเบียนอาคารชุด

สำนักงานที่ดินกรุงเทพมหานคร สาขาพระโขนง

วันที่ ๑๕ เดือน พฤศจิกายน พ.ศ.๒๕๕๕

หนังสือนี้ออกให้เพื่อแสดงว่าพนักงานเจ้าหน้าที่ได้รับจดทะเบียนอาคารชุดตามพระราชบัญญัติอาคารชุด พ.ศ. ๒๕๒๒ ตามคำขอของผู้มีกรรมสิทธิ์ในที่ดินและอาคาร ชื่อ บริษัท แสนสิริ จำกัด(มหาชน)

ทะเบียนเลขที่ ๓๑/๒๕๕๕ เมื่อวันที่ ๑๕ เดือน พฤศจิกายน พ.ศ. ๒๕๕๕ โดยมีรายการ ดังนี้

๑. ชื่ออาคารชุด " คีนน์ บาย แสนสิริ "

๒. โฉนดที่ดินเลขที่ ๓๗๑๖

ตำบล/แขวง คลองตัน(บางกะปิฝั่งใต้) อำเภอ/เขต คลองเตย(บางกะปิ)

จังหวัด กรุงเทพมหานคร

๓. จำนวนอาคาร ๑ หลัง

๔. จำนวนห้องชุด ๒๑๖ ห้องชุด

๕. บันทึกรายละเอียด(รายการทรัพย์ส่วนกลาง เฉพาะทรัพย์ส่วนกลางตามมาตรา ๑๕(๕), (๖), (๗))

- โถงรับแขก และห้องน้ำส่วนกลาง อยู่บริเวณชั้น ๑
- สระว่ายน้ำส่วนกลาง ,ห้องออกกำลังกาย, ห้องอบไอน้ำ อยู่บริเวณชั้น ๗
- ห้องพักขยะ ตั้งอยู่ชั้น ๘ ถึง ชั้น ๒๘
- ลิฟท์โดยสารจำนวน ๓ เครื่อง พร้อมระบบเครื่องจักร เครื่องกล อุปกรณ์ส่วนควบคุมด้วยระบบคอมพิวเตอร์ ,ลิฟท์หนีไฟจำนวน ๑ เครื่อง
- ระบบรักษาความปลอดภัย ระบบ CCTV/Access Card และระบบป้องกันฟ้าผ่า
- ระบบสัญญาณโทรทัศน์แบบเสาอากาศรวม
- ที่จอดรถภายในอาคารอยู่บริเวณชั้น ๑ - ๖ จำนวน ๑๔๘ คัน
- ป้อมยาม อยู่บริเวณหน้าโครงการ ,สวนส่วนกลาง
- ทรัพย์ส่วนกลางอื่นๆ ที่มีเพิ่มเติมในภายภาคหน้า ซึ่งมีไว้ใช้ร่วมกัน

๖. ทรัพย์ส่วนบุคคล

ห้องชุดเพื่ออยู่อาศัย	จำนวน ๒๑๖ ห้องชุด
ห้องชุดเพื่อประกอบการค้า	จำนวน - ห้องชุด
ที่จอดรถส่วนบุคคล	จำนวน - คัน

อื่นๆ

(ลงชื่อ) [redacted] พนักงานเจ้าหน้าที่

(นายณัฐทรงชัย วีระนาวิน)

ตำแหน่ง เจ้าพนักงานที่ดินกรุงเทพมหานคร สาขาพระโขนง

(น[redacted])

เจ้าพนักงานที่ดินชำนาญงาน

๓ ต.ค. ๒๕๖๒

หัวหน[redacted]

ภาคผนวก 3

- จดทะเบียนอาคารชุด (อช.13)
- รายการจดทะเบียนแต่งตั้ง/เปลี่ยนแปลงกรรมการนิติบุคคลอาคารชุด และเปลี่ยนแปลงผู้จัดการนิติบุคคลอาคารชุด (อช.12)

(อ.ช.๑๓)



หนังสือสำคัญการจดทะเบียนนิติบุคคลอาคารชุด

สำนักงานที่ดินกรุงเทพมหานคร สาขาพระโขนง
วันที่ ๒๗ เดือน พฤศจิกายน พ.ศ. ๒๕๕๕

หนังสือสำคัญฉบับนี้ออกให้เพื่อแสดงว่า พนักงานเจ้าหน้าที่ได้รับจดทะเบียนนิติบุคคลอาคารชุด ตามพระราชบัญญัติอาคารชุด พ.ศ. ๒๕๒๒ ทะเบียนเลขที่ ๒๘/๒๕๕๕ เมื่อวันที่ ๒๗ เดือน พฤศจิกายน พ.ศ. ๒๕๕๕ โดยมีรายการ ดังนี้

๑.ชื่อนิติบุคคลอาคารชุด "คีนน์ บาย แสนสิริ"

๒.มีวัตถุประสงค์นิติบุคคลอาคาชุดเป็นไปตามมาตรา ๓๓ แห่งพระราชบัญญัติอาคารชุด พ.ศ.๒๕๒๒ซึ่งบัญญัติว่า เพื่อจัดการและดูแลรักษาทรัพย์ส่วนกลางและให้มีอำนาจกระทำการใดๆ เพื่อประโยชน์ตามวัตถุประสงค์ดังกล่าว ทั้งนี้ตามมติของเจ้าของร่วมภายใต้บังคับแห่งพระราชบัญญัตินี้

๓.ที่ตั้งสำนักงานอยู่ที่ เลขที่ ๗๖๖ หมู่ที่ - ตรอก/ซอย -
ถนน สุขุมวิท ตำบล/แขวง คลองตัน อำเภอ/เขต คลองเตย
จังหวัด กรุงเทพมหานคร รหัสไปรษณีย์ ๑๐๑๑๐ โทรศัพท์

[redacted]

(ลงชื่อ) .....
(นายณัฐทรงชัย วรรณาวิน)
ตำแหน่ง เจ้าพนักงานที่ดินกรุงเทพมหานคร สาขาพระโขนง

[redacted]

[redacted]

รายการจดทะเบียนแต่งตั้ง / เปลี่ยนแปลงกรรมการนิติบุคคลอาคารชุด และเปลี่ยนแปลงผู้จัดการนิติบุคคลอาคารชุด

ลำดับ	ประเภท	อาคารชุด		นิติบุคคลอาคารชุด		ชื่อผู้พ้นจากตำแหน่ง	ชื่อผู้ได้รับแต่งตั้งใหม่	พนักงานเจ้าหน้าที่จดทะเบียน วัน เดือน ปี
		ชื่อ	ทะเบียนเลขที่	ชื่อ	ทะเบียนเลขที่			
๑๔๒	เปลี่ยนแปลงผู้จัดการ	ศินน์ นาย	๓๐/๒๕๕๕	ศินน์ นาย	๒๘/๒๕๕๕	บริษัท	ไนท์แฟรงค์ ชาร์เตอร์	
	นิติบุคคลอาคารชุด	แสนสิริ		แสนสิริ		(ประเทศไทย) จำกัด		
						โดยนางสาวนิ่มนวล นามสง่า		
๑๔๓	เปลี่ยนแปลงกรรมการ-	ริธึ่ม ลุมพินี 50	๒/๒๕๕๖	ริธึ่ม ลุมพินี 50	๑/๒๕๕๖	๑	นางสาวศรันย์รัชต์	
	นิติบุคคลอาคารชุด	"		"			ชยะธวัช	
				สำเนาถูกต้อง		๒.	นายเศรษ ชัตนาธาร	
						๓.	นางสาวธนกร	
				(นายณัฐวุธ ธารินี)			ธนอาศาสน์	
				เจ้าพนักงานที่ดินชำนาญงาน		๔.	นางสาวอมา ปิณฑยา	
				17 พย 2566		๕.	นางสุนันทา ลาศาสเลียด	
						๖.	นางสาวนพวรรณ	
							สุเสรีดำรง	

GA/aa/L025/2569

ทำที่ บริษัท ไนท์แฟรงค์ ชาร์เตอร์ (ประเทศไทย) จำกัด

27 เมษายน 2569

หนังสือแต่งตั้งผู้ดำเนินการแทนในฐานะผู้จัดการนิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

ด้วยบริษัท ไนท์แฟรงค์ ชาร์เตอร์ (ประเทศไทย) จำกัด ได้รับการแต่งตั้งให้ทำหน้าที่เป็นผู้จัดการนิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ ตั้งอยู่เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110

ดังนั้นบริษัทฯ จึงขอแต่งตั้ง นายชาญณรงค์ หวังเจริญ เป็นผู้ดำเนินการแทนในฐานะผู้จัดการนิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ ทั้งนี้ให้มีผลตั้งแต่วันที่ยื่นหนังสือฉบับนี้ต่อ สำนักงานที่ดินกรุงเทพมหานคร สาขาพระโขนง เป็นต้นไป

[redacted]

Knight Frank
Knight Frank Chartered (Thailand) Co.,Ltd.
บริษัท ไนท์แฟรงค์ ชาร์เตอร์ (ประเทศไทย) จำกัด

ลง [redacted] ารผู้มีอำนาจ

Knight Frank Chartered (Thailand) Co., Ltd.

T +66 (0)2 643 8223 F +66 (0)2 643 8224
33/4, The 9th Tower A, 31st Fl., Rama 9 Road, Huaykwang, Huaykwang, Bangkok 10310

www.knightfrank.co.th

Knight Frank Chartered (Thailand) Co., Ltd. is a limited liability partnership registered in Thailand with registered number 0105535104425.
Our registered office is 33/4, The 9th Tower A, 31st Fl., Rama 9 Road, Huaykwang, Huaykwang, Bangkok 10310 where you may look at a list of members names.

ภาคผนวก 4

- แบบบันทึกรายละเอียดของสถิติและข้อมูลซึ่งแสดงผลการทำงานของระบบบำบัดน้ำเสีย (แบบ ทส.1)
- รายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย (แบบ ทส. 2)


แบบ ทส. ๑

แบบบันทึกรายละเอียดของสถิติและข้อมูลซึ่งแสดงผลการทำงานของระบบบำบัดน้ำเสีย
ของแหล่งกำเนิดมลพิษ

แหล่งกำเนิดมลพิษตั้งอยู่เลขที่ 766 หมู่ที่ - ซอย - ถนน.สุขุมวิท แขวง/ตำบล คลองตัน เขต/อำเภอ คลองเตย จังหวัด กรุงเทพมหานคร โทรศัพท์ 02-661-2173-5 โทรสาร. 02-611-2176 นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ประกอบกิจการประเภท ห้องชุดพักอาศัย เท่านั้น

ใบอนุญาตเลขที่ _____ ออกให้โดย _____หมดอายุ _____

ซึ่งมีแผนผังแสดงการทำงานของระบบบำบัดน้ำเสีย ดังนี้

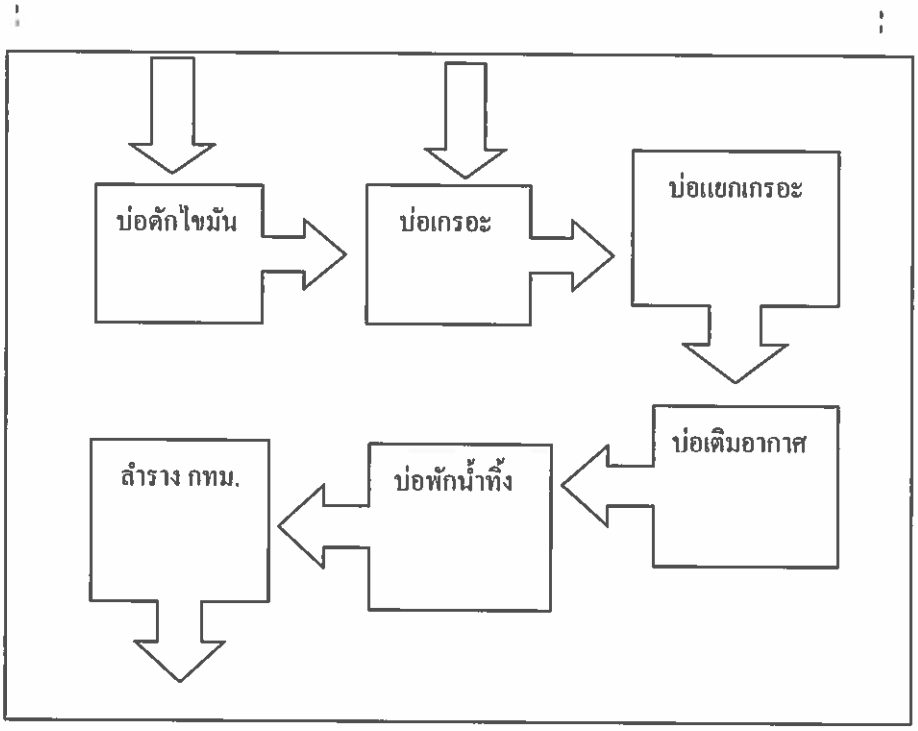


ได้จัดเก็บสถิติและข้อมูลแสดงผลการทำงานของระบบบำบัดน้ำเสียปรากฏตามตาราง ดังนี้

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน มกราคม 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่น ๆ (ระบุ)(ปกติ/ผิดปกติ)			
1	ไม่มีมิเตอร์	82	65.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
2	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
3	ไม่มีมิเตอร์	50	40.00	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
4	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
5	ไม่มีมิเตอร์	48	48.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
6	ไม่มีมิเตอร์	85	6.00	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
7	ไม่มีมิเตอร์	66	52.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
8	ไม่มีมิเตอร์	66	52.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
9	ไม่มีมิเตอร์	85	6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
10	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
11	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
12	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
13	ไม่มีมิเตอร์	65	52.00	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
14	ไม่มีมิเตอร์	62	49.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
15	ไม่มีมิเตอร์	49	39.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
16	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
17	ไม่มีมิเตอร์	49	39.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
18	ไม่มีมิเตอร์	63	50.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน มกราคม 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณ การใช้ไฟฟ้า ของระบบ บำบัด น้ำเสีย (หน่วย)	ปริมาณ น้ำใช้ ในทุกกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณ น้ำเสียที่ เข้าระบบ บำบัดน้ำ เสีย (ลบ.ม.)	การระบาย น้ำทิ้งจาก ระบบบำบัดน้ำ เสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหาอุปสรรค และแนวทาง แก้ไข	
						ระบบบำบัด น้ำเสีย (ปกติ/ ผิดปกติ)	เครื่องสูบน้ำ(ปกติ/ ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ ผิดปกติ)			
19	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
20	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
21	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
22	ไม่มีมิเตอร์	66	52.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
23	ไม่มีมิเตอร์	84	67.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
24	ไม่มีมิเตอร์	104	83.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
25	ไม่มีมิเตอร์	74	59.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
26	ไม่มีมิเตอร์	95	76.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
27	ไม่มีมิเตอร์	86	68.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
28	ไม่มีมิเตอร์	49	39.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
29	ไม่มีมิเตอร์	62	49.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
30	ไม่มีมิเตอร์	75	60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
31	ไม่มีมิเตอร์	58	46.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

หมายเหตุ ๑. ให้กรอกสถิติและข้อมูลเฉพาะในกรณีที่มีสถิติและข้อมูลนั้น ๆ ในแต่ละวัน

๒. ในกรณีระบบบำบัดน้ำเสียที่มีการติดตั้งเครื่องตรวจวัดคุณภาพน้ำทิ้งแบบอัตโนมัติให้แนบผลการตรวจวัดคุณภาพน้ำทิ้งทุกวันแยกตามพารามิเตอร์ที่ตรวจวัดและทำการสรุปผลเป็นสถิติและข้อมูลรายเดือน



ข้างต้นถูกต้องทุกประการ

ยผู้ควบคุมเหล่งกำเนิดมลพิษ

...

วบคุมระบบบำบัดน้ำเสีย




แบบ ทส. ๑

แบบบันทึกรายละเอียดของสถิติและข้อมูลซึ่งแสดงผลการทำงานของระบบบำบัดน้ำเสีย
ของแหล่งกำเนิดมลพิษ

แหล่งกำเนิดมลพิษตั้งอยู่เลขที่ 766 หมู่ที่ - ซอย - ถนน.สุขุมวิท แขวง/ตำบล คลองตัน เขต/อำเภอ คลองเตย จังหวัด กรุงเทพมหานคร โทรศัพท์ 02-661-2173-5 โทรสาร. 02-611-2176 นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ประกอบกิจการประเภท ห้องชุดพักอาศัย เท่านั้น

ใบอนุญาตเลขที่ _____ ออกให้โดย _____หมดอายุ _____

ซึ่งมีแผนผังแสดงการทำงานของระบบบำบัดน้ำเสีย ดังนี้

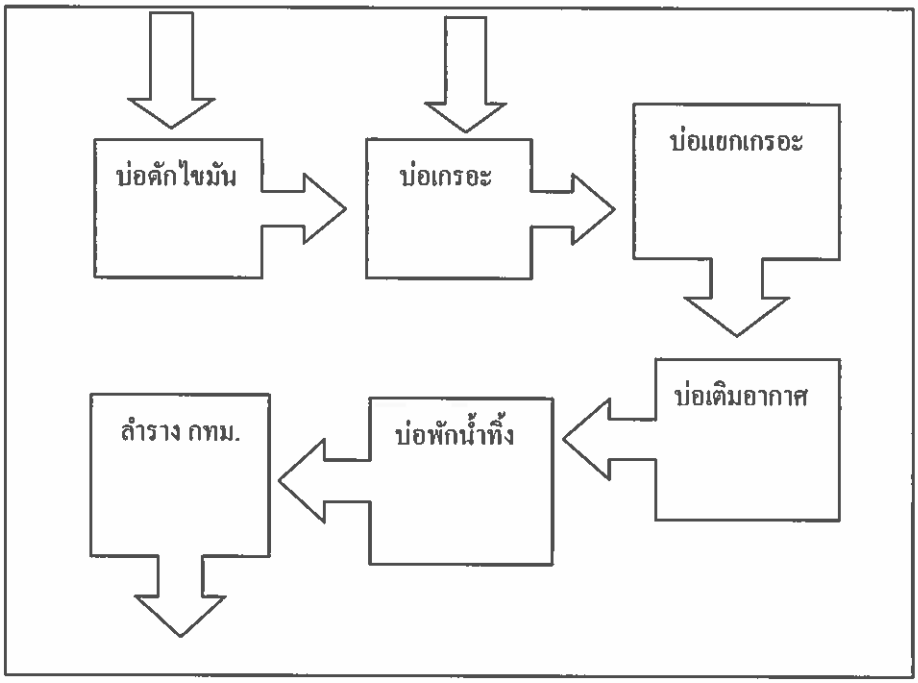

ได้จัดเก็บสถิติและข้อมูลแสดงผลการทำงานของระบบบำบัดน้ำเสียปรากฏตามตาราง ดังนี้

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน กุมภาพันธ์ 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณ การใช้ไฟฟ้า ของระบบ บำบัด น้ำเสีย (หน่วย)	ปริมาณ น้ำใช้ ในทุกกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณ น้ำเสียที่ เข้าระบบ บำบัดน้ำ เสีย (ลบ.ม.)	การระบาย น้ำทิ้งจาก ระบบบำบัดน้ำ เสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหาอุปสรรค และแนวทาง แก้ไข	
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ)(ปกติ/ ผิดปกติ)			
1	ไม่มีมิเตอร์	58	46.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
2	ไม่มีมิเตอร์	63	50.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
3	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
4	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
5	ไม่มีมิเตอร์	66	52.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
6	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
7	ไม่มีมิเตอร์	66	52.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
8	ไม่มีมิเตอร์	45	36	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
9	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
10	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
11	ไม่มีมิเตอร์	48	3.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
12	ไม่มีมิเตอร์	53	42.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
13	ไม่มีมิเตอร์	78	62.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
14	ไม่มีมิเตอร์	46	36.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
15	ไม่มีมิเตอร์	32	25.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
16	ไม่มีมิเตอร์	46	36.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
17	ไม่มีมิเตอร์	55	44.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
18	ไม่มีมิเตอร์	39	31.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน กุมภาพันธ์ 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในกุศกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ(ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
19	ไม่มีมิเตอร์	48	38.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
20	ไม่มีมิเตอร์	49	39.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
21	ไม่มีมิเตอร์	63	50.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
22	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
23	ไม่มีมิเตอร์	46	36.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
24	ไม่มีมิเตอร์	50	40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
25	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
26	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
27	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
28	ไม่มีมิเตอร์	48	38.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

หมายเหตุ ๑. ให้กรอกสถิติและข้อมูลเฉพาะในกรณีที่มีสถิติและข้อมูลนั้น ๆ ในแต่ละวัน

๒. ในกรณีระบบบำบัดน้ำเสียที่มีการติดตั้งเครื่องตรวจวัดคุณภาพน้ำทิ้งแบบอัตโนมัติให้แนบผลการตรวจวัดคุณภาพน้ำทิ้งทุกวันแยกตามพารามิเตอร์ที่ตรวจวัดและทำการสรุปผลเป็นสถิติและข้อมูลรายเดือน



นถูกต้องทุกประการ

อบครองแหล่งกำเนิดมลพิษ

ระบบบำบัดน้ำเสีย




แบบ ทส. ๑

แบบบันทึกรายละเอียดของสถิติและข้อมูลซึ่งแสดงผลการทำงานของระบบบำบัดน้ำเสีย
ของแหล่งกำเนิดมลพิษ

แหล่งกำเนิดมลพิษตั้งอยู่เลขที่ 766 หมู่ที่ - ซอย - ถนน.สุขุมวิท แขวง/ตำบล คลองตัน เขต/อำเภอ คลองเตย จังหวัด กรุงเทพมหานคร โทรศัพท์ 02-661-2173-5 โทรสาร. 02-611-2176 นิติบุคคลอาคารชุด ดีนน์ บาย แสนสิริ เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ประกอบกิจการประเภท ห้องชุดพักอาศัย เท่านั้น

ใบอนุญาตเลขที่ _____ ออกให้โดย _____หมดอายุ _____

ซึ่งมีแผนผังแสดงการทำงานของระบบบำบัดน้ำเสีย ดังนี้

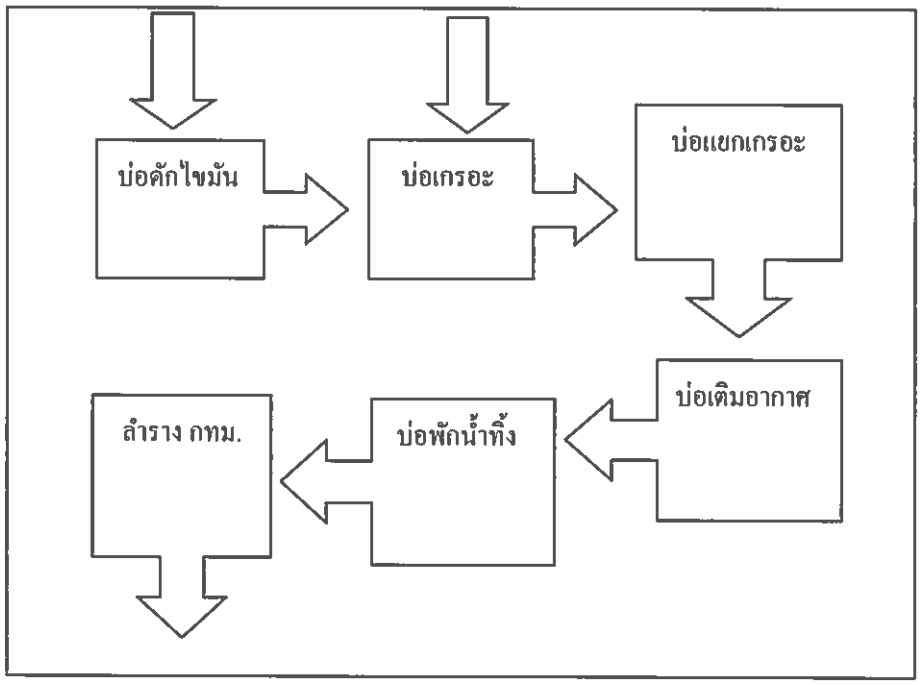

ได้จัดเก็บสถิติและข้อมูลแสดงผลการทำงานของระบบบำบัดน้ำเสียปรากฏตามตาราง ดังนี้

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน มีนาคม 2569														ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในกุลกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่น ๆ (ระบุ)(ปกติ/ผิดปกติ)			
1	ไม่มีมิเตอร์	48	38.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
2	ไม่มีมิเตอร์	59	47.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
3	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
4	ไม่มีมิเตอร์	51	40.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
5	ไม่มีมิเตอร์	45	36.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
6	ไม่มีมิเตอร์	45	36.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
7	ไม่มีมิเตอร์	48	8.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
8	ไม่มีมิเตอร์	86	68.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
9	ไม่มีมิเตอร์	124	101.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
10	ไม่มีมิเตอร์	108	86.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
11	ไม่มีมิเตอร์	121	96.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
12	ไม่มีมิเตอร์	112	9.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
13	ไม่มีมิเตอร์	48	38.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
14	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
15	ไม่มีมิเตอร์	45	36.00	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
16	ไม่มีมิเตอร์	106	48.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
17	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
18	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน มีนาคม 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ(ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
19	ไม่มีมิเตอร์	101	80.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
20	ไม่มีมิเตอร์	72	57.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
21	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
22	ไม่มีมิเตอร์	86	68.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
23	ไม่มีมิเตอร์	126	108.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
24	ไม่มีมิเตอร์	52	41.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
25	ไม่มีมิเตอร์	45	36.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
26	ไม่มีมิเตอร์	86	68.80	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
27	ไม่มีมิเตอร์	69	55.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
28	ไม่มีมิเตอร์	64	51.20	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
29	ไม่มีมิเตอร์	31	24.0	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
30	ไม่มีมิเตอร์	47	37.60	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
31	ไม่มีมิเตอร์	103	2.40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

หมายเหตุ ๑. ให้กรอกสถิติและข้อมูลเฉพาะในกรณีที่มีสถิติและข้อมูลนั้น ๆ ในแต่ละวัน

๒. ในกรณีระบบบำบัดน้ำเสียที่มีการติดตั้งเครื่องตรวจวัดคุณภาพน้ำทิ้งแบบอัตโนมัติให้แสดงผลการตรวจวัดคุณภาพน้ำทิ้งทุกวันแยกตามพารามิเตอร์ที่ตรวจวัดและทำการสรุปผลเป็นสถิติและข้อมูลรายเดือน



งทุกประการ

งแหล่งกำเนิดมลพิษ

บำบัดน้ำเสีย




แบบ ทส. ๑

แบบบันทึกรายละเอียดของสถิติและข้อมูลซึ่งแสดงผลการทำงานของระบบบำบัดน้ำเสีย
ของแหล่งกำเนิดมลพิษ

แหล่งกำเนิดมลพิษตั้งอยู่เลขที่ 766 หมู่ที่ - ซอย - ถนน.สุขุมวิท แขวง/ตำบล คลองตัน เขต/อำเภอ คลองเตย จังหวัด กรุงเทพมหานคร โทรศัพท์ 02-661-2173-5 โทรสาร. 02-611-2176 นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ประกอบกิจการประเภท ห้องชุดพักอาศัย เท่านั้น

ใบอนุญาตเลขที่ _____ ออกให้โดย _____หมดอายุ _____

ซึ่งมีแผนผังแสดงการทำงานของระบบบำบัดน้ำเสีย ดังนี้

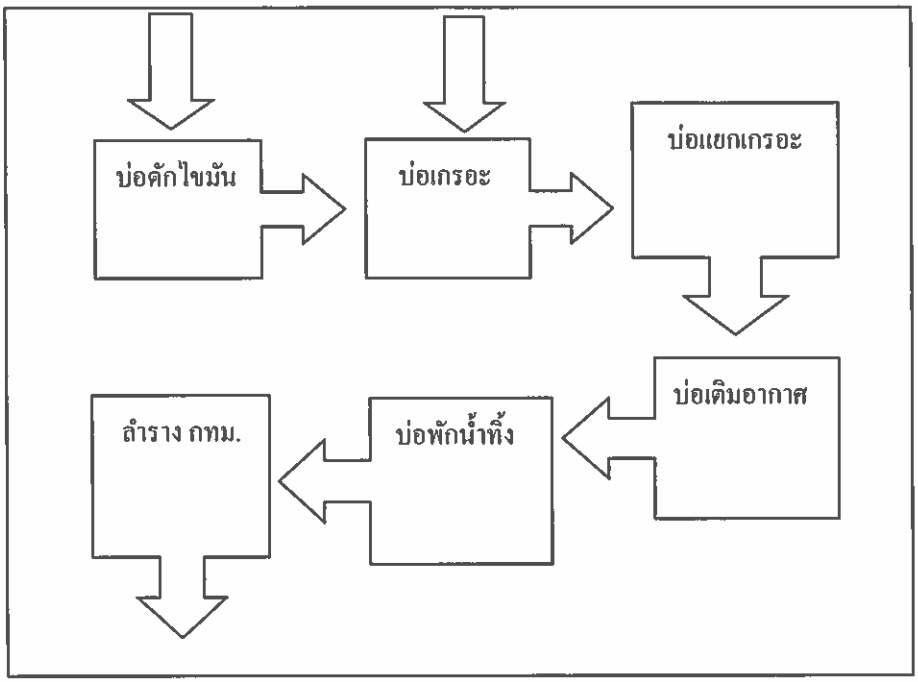

ได้จัดเก็บสถิติและข้อมูลแสดงผลการทำงานของระบบบำบัดน้ำเสียปรากฏตามตาราง ดังนี้

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน เมษายน 2569														ลายมือชื่อ ผู้บันทึก
	ปริมาณ การใช้ไฟฟ้า ของระบบ บำบัด น้ำเสีย (หน่วย)	ปริมาณ น้ำใช้ ในกุจกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณ น้ำเสียที่ เข้าระบบ บำบัดน้ำ เสีย (ลบ.ม.)	การระบาย น้ำทิ้งจาก ระบบบำบัดน้ำ เสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหาอุปสรรค และแนวทาง แก้ไข	
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่น ๆ (ระบุ)(ปกติ/ ผิดปกติ)			
1	ไม่มีมิเตอร์	127	101.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
2	ไม่มีมิเตอร์	133	106.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
3	ไม่มีมิเตอร์	125	100	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
4	ไม่มีมิเตอร์	90	72	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
5	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
6	ไม่มีมิเตอร์	83	66.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
7	ไม่มีมิเตอร์	72	57.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
8	ไม่มีมิเตอร์	85	86	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
9	ไม่มีมิเตอร์	124	99.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
10	ไม่มีมิเตอร์	50	40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
11	ไม่มีมิเตอร์	108	86.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
12	ไม่มีมิเตอร์	80	64	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
13	ไม่มีมิเตอร์	127	101.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
14	ไม่มีมิเตอร์	110	88	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
15	ไม่มีมิเตอร์	108	86.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
16	ไม่มีมิเตอร์	124	99.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
17	ไม่มีมิเตอร์	118	94.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
18	ไม่มีมิเตอร์	96	76.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน เมษายน 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ(ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
19	ไม่มีมิเตอร์	66	52.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
20	ไม่มีมิเตอร์	49	39.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
21	ไม่มีมิเตอร์	88	70.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
22	ไม่มีมิเตอร์	48	3.48	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
23	ไม่มีมิเตอร์	82	65.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
24	ไม่มีมิเตอร์	129	103.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
25	ไม่มีมิเตอร์	74	59.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
26	ไม่มีมิเตอร์	82	65.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
27	ไม่มีมิเตอร์	91	72.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
28	ไม่มีมิเตอร์	48	38.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
29	ไม่มีมิเตอร์	73	58.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
30	ไม่มีมิเตอร์	45	36	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

หมายเหตุ ๑. ให้กรอกสถิติและข้อมูลเฉพาะในกรณีที่มีสถิติและข้อมูลนั้น ๆ ในแต่ละวัน

๒. ในกรณีระบบบำบัดน้ำเสียที่มีการติดตั้งเครื่องตรวจวัดคุณภาพน้ำทิ้งแบบอัตโนมัติให้แนบผลการตรวจวัดคุณภาพน้ำทิ้งทุกวันแยกตามพารามิเตอร์ที่ตรวจวัดและทำการสรุปผลเป็นสถิติและข้อมูลรายเดือน



ระการ

งทำนิคมสหิน

น้ำเสีย




แบบ ทส. ๑

แบบบันทึกรายละเอียดของสถิติและข้อมูลซึ่งแสดงผลการทำงานของระบบบำบัดน้ำเสีย
ของแหล่งกำเนิดมลพิษ

แหล่งกำเนิดมลพิษตั้งอยู่เลขที่ 766 หมู่ที่ - ซอย - ถนน.สุขุมวิท แขวง/ตำบล คลองตัน เขต/อำเภอ คลองเตย จังหวัด กรุงเทพมหานคร โทรศัพท์ 02-661-2173-5 โทรสาร. 02-611-2176 นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ประกอบกิจการประเภท ห้องชุดพักอาศัย เท่านั้น

ใบอนุญาตเลขที่ _____ ออกให้โดย _____หมดอายุ _____

ซึ่งมีแผนผังแสดงการทำงานของระบบบำบัดน้ำเสีย ดังนี้

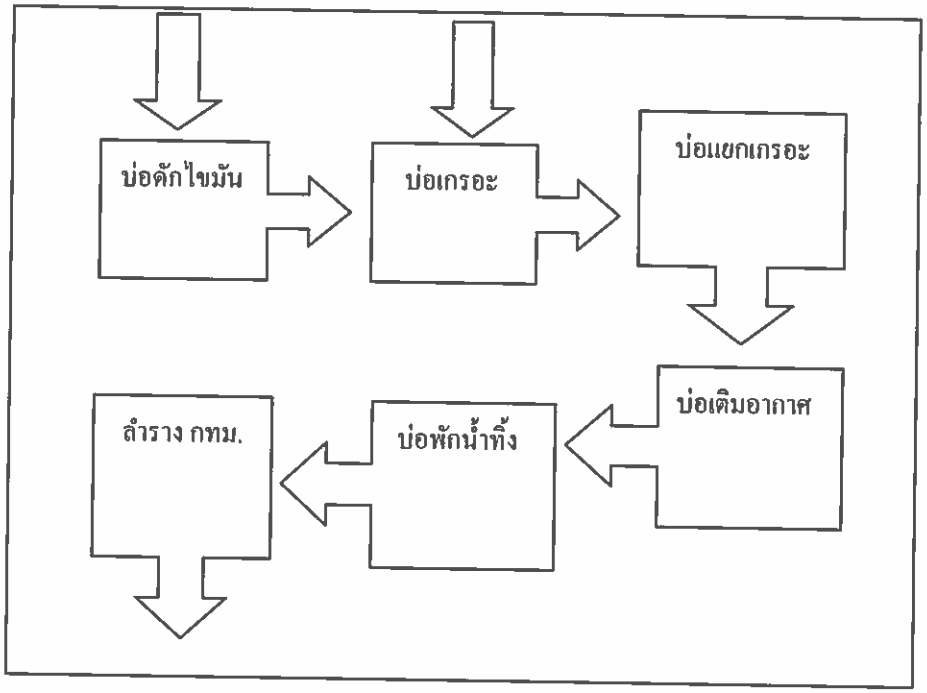

ได้จัดเก็บสถิติและข้อมูลแสดงผลการทำงานของระบบบำบัดน้ำเสียปรากฏตามตาราง ดังนี้

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน พฤษภาคม 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณ การใช้ไฟฟ้า ของระบบ บำบัด น้ำเสีย (หน่วย)	ปริมาณ น้ำใช้ ในกุญกิจกรรม ของ แหล่งกำเนิด มลพิษ (ลบ.ม.)	ปริมาณ น้ำเสียที่ เข้าระบบ บำบัดน้ำ เสีย (ลบ.ม.)	การระบาย น้ำทิ้งจาก ระบบบำบัดน้ำ เสีย (ระบาย/ ไม่ระบาย)	ปริมาณ สารเคมีหรือ สารสกัด ชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือ กิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอน ส่วนเกิน ที่เกิดขึ้นจาก ระบบบำบัด น้ำเสียที่นำไป กำจัด (ลบ.ม.)	ปัญหาอุปสรรค และแนวทาง แก้ไข	
						ระบบบำบัด น้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบ ตะกอน (ปกติ/ ผิดปกติ)	อื่นๆ (ระบุ)(ปกติ/ ผิดปกติ)			
1	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
2	ไม่มีมิเตอร์	91	72.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
3	ไม่มีมิเตอร์	120	96	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
4	ไม่มีมิเตอร์	115	92	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
5	ไม่มีมิเตอร์	79	63.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
6	ไม่มีมิเตอร์	85	68	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
7	ไม่มีมิเตอร์	66	52.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
8	ไม่มีมิเตอร์	84	67.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
9	ไม่มีมิเตอร์	83	66.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
10	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
11	ไม่มีมิเตอร์	87	69.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
12	ไม่มีมิเตอร์	52	41.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
13	ไม่มีมิเตอร์	46	36.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
14	ไม่มีมิเตอร์	46	36.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
15	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
16	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
17	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
18	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน พฤษภาคม 2569															ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ(ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
19	ไม่มีมิเตอร์	49	39.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
20	ไม่มีมิเตอร์	48	38.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
21	ไม่มีมิเตอร์	30	24	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
22	ไม่มีมิเตอร์	63	50.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
23	ไม่มีมิเตอร์	127	101.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
24	ไม่มีมิเตอร์	87	69.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
25	ไม่มีมิเตอร์	65	52	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
26	ไม่มีมิเตอร์	88	70.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
27	ไม่มีมิเตอร์	31	24.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
28	ไม่มีมิเตอร์	54	43.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
29	ไม่มีมิเตอร์	62	49.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
30	ไม่มีมิเตอร์	48	38.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
31	ไม่มีมิเตอร์	45	36	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

หมายเหตุ ๑. ให้กรอกสถิติและข้อมูลเฉพาะในกรณีที่มีสถิติและข้อมูลนั้น ๆ ในแต่ละวัน

๒. ในกรณีระบบบำบัดน้ำเสียที่มีการติดตั้งเครื่องตรวจวัดคุณภาพน้ำทิ้งแบบอัตโนมัติให้แนบผลการตรวจวัดคุณภาพน้ำทิ้งทุกวันแยกตามพารามิเตอร์ที่ตรวจวัดและทำการสรุปผลเป็นสถิติและข้อมูลรายเดือน






แบบ ทส. ๑

แบบบันทึกรายละเอียดของสถิติและข้อมูลซึ่งแสดงผลการทำงานของระบบบำบัดน้ำเสีย
ของแหล่งกำเนิดมลพิษ

แหล่งกำเนิดมลพิษตั้งอยู่เลขที่ 766 หมู่ที่ - ซอย - ถนน.สุขุมวิท แขวง/ตำบล คลองตัน เขต/อำเภอ คลองเตย จังหวัด กรุงเทพมหานคร โทรศัพท์ 02-661-2173-5 โทรสาร. 02-611-2176 นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ประกอบกิจการประเภท ห้องชุดพักอาศัย เท่านั้น

ใบอนุญาตเลขที่ _____ ออกให้โดย _____หมดอายุ _____

ซึ่งมีแผนผังแสดงการทำงานของระบบบำบัดน้ำเสีย ดังนี้

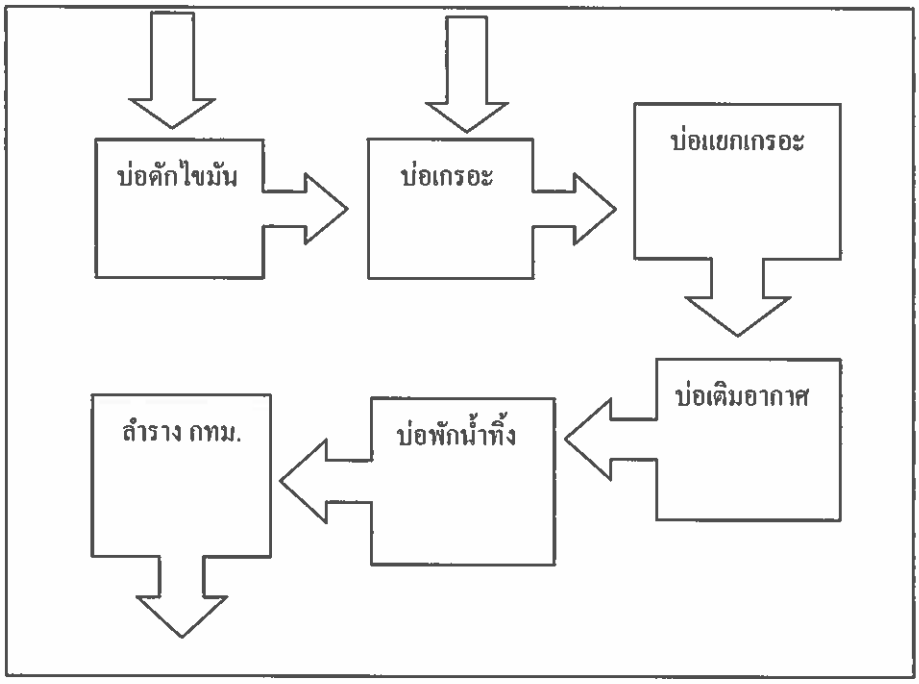

ได้จัดเก็บสถิติและข้อมูลแสดงผลการทำงานของระบบบำบัดน้ำเสียปรากฏตามตาราง ดังนี้

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน มิถุนายน 2569														ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ (ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ)(ปกติ/ผิดปกติ)			
1	ไม่มีมิเตอร์	31	24.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
2	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
3	ไม่มีมิเตอร์	46	36.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
4	ไม่มีมิเตอร์	46	36.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
5	ไม่มีมิเตอร์	46	36.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
6	ไม่มีมิเตอร์	58	46.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
7	ไม่มีมิเตอร์	37	29.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
8	ไม่มีมิเตอร์	40	32	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
9	ไม่มีมิเตอร์	30	24	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
10	ไม่มีมิเตอร์	37	29.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
11	ไม่มีมิเตอร์	40	32	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
12	ไม่มีมิเตอร์	29	23.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
13	ไม่มีมิเตอร์	30	24	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
14	ไม่มีมิเตอร์	63	50.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
15	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
16	ไม่มีมิเตอร์	104	83.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
17	ไม่มีมิเตอร์	129	103.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
18	ไม่มีมิเตอร์	103	82.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

วัน เดือน ปี	สถิติและข้อมูลที่เก็บจากแหล่งกำเนิดมลพิษ ประจำเดือน มิถุนายน 2569														ลายมือชื่อ ผู้บันทึก
	ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย)	ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.)	ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.)	การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย (ระบาย/ไม่ระบาย)	ปริมาณสารเคมีหรือสารสกัดชีวภาพที่ใช้ (ชื่อ/ปริมาณ) (ลิตรหรือกิโลกรัม)	การทำงานของระบบบำบัดน้ำเสีย							ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด (ลบ.ม.)	ปัญหาอุปสรรคและแนวทางแก้ไข	
						ระบบบำบัดน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องสูบน้ำ(ปกติ/ผิดปกติ)	เครื่องเติมอากาศ (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมน้ำเสีย (ปกติ/ผิดปกติ)	เครื่องกวน/ผสมสารเคมี (ปกติ/ผิดปกติ)	เครื่องสูบตะกอน (ปกติ/ผิดปกติ)	อื่นๆ (ระบุ) (ปกติ/ผิดปกติ)			
19	ไม่มีมิเตอร์	89	71.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
20	ไม่มีมิเตอร์	68	554.4	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
21	ไม่มีมิเตอร์	50	40	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
22	ไม่มีมิเตอร์	45	36	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
23	ไม่มีมิเตอร์	47	37.6	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
24	ไม่มีมิเตอร์	35	28	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
25	ไม่มีมิเตอร์	30	24	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
26	ไม่มีมิเตอร์	46	36.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
27	ไม่มีมิเตอร์	31	24.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
28	ไม่มีมิเตอร์	45	36	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
29	ไม่มีมิเตอร์	31	24.8	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		
30	ไม่มีมิเตอร์	44	35.2	ระบาย	-	ปกติ	ปกติ	ปกติ	ไม่มี	ไม่มี	ปกติ	-	-		

หมายเหตุ ๑. ให้กรอกสถิติและข้อมูลเฉพาะในกรณีที่มีสถิติและข้อมูลนั้น ๆ ในแต่ละวัน

๒. ในกรณีระบบบำบัดน้ำเสียที่มีการติดตั้งเครื่องตรวจวัดคุณภาพน้ำทิ้งแบบอัตโนมัติ ให้แนบผลการตรวจวัดคุณภาพน้ำทิ้งทุกวันแยกตามพารามิเตอร์ที่ตรวจวัดและทำการสรุปผลเป็นสถิติและข้อมูลรายเดือน



(ช่างเทคนิค ประจำอาคาร)



รายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย

ชื่อแหล่งกำเนิดมลพิษ : นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

แหล่งกำเนิดมลพิษ ตั้งอยู่เลขที่ : 766 หมู่ที่ : ซอย :

ถนน : สุขุมวิท แขวง/ตำบล : คลองเตย เขต/ตำบล : เขตคลองเตย

จังหวัด : กรุงเทพมหานคร โทรศัพท์ : 026612173-5 โทรสาร : 026612176

มี : เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ

ประกอบกิจการประเภท : อาคารชุด

ประเภทย่อย : ประเภท ข ตั้งแต่ 100 ห้องแต่ไม่ถึง 500 จำนวนห้อง : 216

สังกัด : อื่นๆ

ใบอนุญาตเลขที่ (ถ้ามี) : ออกให้โดย : หมดอายุ : วว/ดด/ปปปป

ในการนี้ ขอรายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย ของแหล่งกำเนิดมลพิษสำหรับ เดือน มกราคม พ.ศ. 2569 ตามที่ได้กำหนดในมาตรา 80 แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. 2535 ในฐานะ

ลงชื่อ คุณ สุภาศิณีย์ สรรคภิรมย์ เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ



2. ข้อมูลเกี่ยวกับระบบน้ำเสีย และแหล่งรองรับน้ำทิ้ง

(1) ประเภท / ชนิดของระบบบำบัดน้ำเสีย ความสามารถในการบำบัดน้ำเสีย

1. ระบบบำบัดน้ำเสียแบบแอกทิเวเต็ดสลัดจ์ (Activated Sludge Process) 45.00 ลบ.ม./วัน

(2) การทำงานของระบบบำบัดน้ำเสีย [X] แบบต่อเนื่อง 24 ชั่วโมง/วัน

[ ] แบบไม่ต่อเนื่อง (ระบุ)

(3) อุปกรณ์และเครื่องมือที่ใช้ในระบบบำบัดน้ำเสีย [X] เครื่องสูบน้ำ [X] ระบบเติมอากาศ

[ ] เครื่องกวน/ผสมน้ำเสีย [ ] เครื่องกวน/ผสมสารเคมี

[X] เครื่องสูบตะกอน [ ] อื่นๆ

[ ] อื่นๆ

[ ] อื่นๆ

(4) แหล่งรองรับน้ำทิ้ง (ระบุ) ลำลองสาธารณะ

(5) วิธีจัดการตะกอนที่เกิดขึ้นจากระบบบำบัดน้ำเสียและวิธีการกำจัด จัดจ้างสูบโดยเอกชน

3. สรุปผลการทำงานของระบบบำบัดน้ำเสียเป็นรายเดือน

(1) ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย) 205.000 หน่วย

(2) ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.) 2,066.000 ลบ.ม.

(3) ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.) 1,652.800 ลบ.ม.

(4) การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย [X] ระบายทุกวัน

[ ] ระบายบางวัน (ระบุจำนวนวันที่ระบาย) วัน

[ ] ไม่ระบายเลย

(5) ปริมาณสารเคมี หรือสารสกัดชีวภาพที่ใช้

	ปริมาณ	หน่วย
1.	0.000	กิโลกรัม

(6) การทำงานของระบบบำบัดน้ำเสีย

ระบบบำบัดน้ำเสีย	[X] ปกติ	[ ] ผิดปกติ
เครื่องสูบน้ำ	[X] ปกติ	[ ] ผิดปกติ
ระบบเติมอากาศ	[X] ปกติ	[ ] ผิดปกติ
เครื่องสูบตะกอน	[X] ปกติ	[ ] ผิดปกติ

(7) ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบนำบัดน้ำเสียที่นำไปกำจัด 0.00 กิโลกรัม

(8) ปัญหา อุปสรรค และแนวทางแก้ไข

คำเตือน ๑. เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ผู้ควบคุมระบบบำบัดน้ำเสีย หรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดไม่จัดเก็บสถิติ ข้อมูล หรือไม่ทำบันทึกหรือรายงานตามมาตรา ๘๐ ต้องระวางโทษจำคุกไม่เกินหนึ่งเดือน หรือปรับไม่เกินหนึ่งหมื่นบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๖

๒. ผู้ควบคุมระบบบำบัดน้ำเสียหรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดทำบันทึกหรือรายงานโดยแสดงข้อความอันเป็นเท็จ ต้องระวางโทษจำคุกไม่เกินหนึ่งปี หรือปรับไม่เกินหนึ่งแสนบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๗

รายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย

ชื่อแหล่งกำเนิดมลพิษ : นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

แหล่งกำเนิดมลพิษ ตั้งอยู่เลขที่ : 766 หมู่ที่ : ซอย :

ถนน : สุขุมวิท แขวง/ตำบล : คลองเตย เขต/ตำบล : เขตคลองเตย

จังหวัด : กรุงเทพมหานคร โทรศัพท์ : 026612173-5 โทรสาร : 026612176

มี : เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ

ประกอบกิจการประเภท : อาคารชุด


ประเภทย่อย : ประเภท ข ตั้งแต่ 100 ห้องแต่ไม่ถึง 500 จำนวนห้อง : 216

สังกัด : อื่นๆ :

ใบอนุญาตเลขที่ (ถ้ามี) : ออกให้โดย : หมดอายุ : วว/ดด/ปปปป

ในการนี้ ขอรายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย ของแหล่งกำเนิดมลพิษสำหรับ เดือน กุมภาพันธ์ พ.ศ. 2569 ตามที่ได้กำหนดในมาตรา 80 แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. 2535 ในฐานะ

ลงชื่อ สุภาศิณีย์ สรรคภิรมย์ เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ

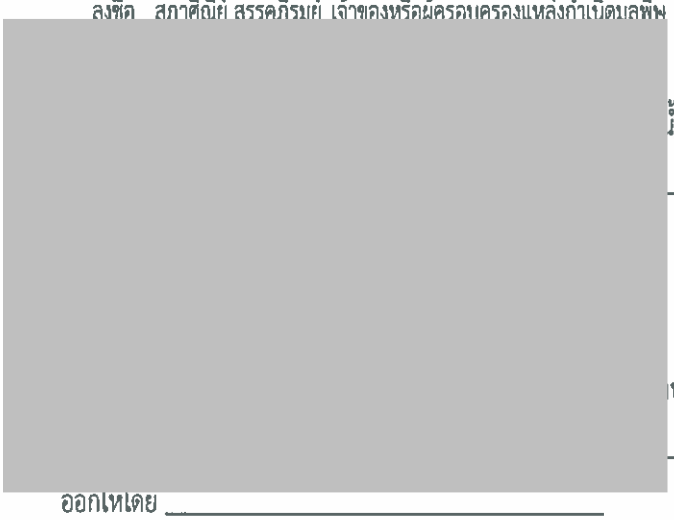

น้ำเสีย

_____

บัดน้ำเสีย

_____

ออกให้โดย _____

2. ข้อมูลเกี่ยวกับระบบน้ำเสีย และแหล่งรองรับน้ำทิ้ง

(1) ประเภท / ชนิดของระบบบำบัดน้ำเสีย — ความสามารถในการบำบัดน้ำเสีย

1. ระบบบำบัดน้ำเสียแบบแอกทิเวเต็ดสลัดจ์ (Activated Sludge Process) — 45.00 ลบ.ม./วัน

(2) การทำงานของระบบบำบัดน้ำเสีย

[X] แบบต่อเนื่อง 24 ชั่วโมง/วัน

[ ] แบบไม่ต่อเนื่อง (ระบุ)

(3) อุปกรณ์และเครื่องมือที่ใช้ในระบบบำบัดน้ำเสีย

[ ] เครื่องสูบน้ำ [ ] ระบบเติมอากาศ

[ ] เครื่องกวน/ผสมน้ำเสีย [ ] เครื่องกวน/ผสมสารเคมี

[ ] เครื่องสูบตะกอน [ ] อื่นๆ

[ ] อื่นๆ

[ ] อื่นๆ

(4) แหล่งรองรับน้ำทิ้ง (ระบุ) ลำลองสาธารณะ

(5) วิธีจัดการตะกอนที่เกิดขึ้นจากระบบบำบัดน้ำเสียและวิธีการกำจัด จัดจ้างสูบโดยเอกชน2016

3. สรุปผลการทำงานของระบบบำบัดน้ำเสียเป็นรายเดือน

(1) ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย) 2,016.000 หน่วย

(2) ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.) 1,536.000 ลบ.ม.

(3) ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.) 1,228.800 ลบ.ม.

(4) การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย [X] ระบายทุกวัน

[ ] ระบายบางวัน (ระบุจำนวนวันที่ระบาย) วัน

[ ] ไม่ระบายเลย

(5) ปริมาณสารเคมี หรือสารสกัดชีวภาพที่ใช้

	ปริมาณ หน่วย
1.	0.000 กิโลกรัม

(6) การทำงานของระบบบำบัดน้ำเสีย

ระบบบำบัดน้ำเสีย [X] ปกติ [ ] ผิดปกติ

(7) ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบนำบัดน้ำเสียที่นำไปกำจัด 0.00 กิโลกรัม

(8) ปัญหา อุปสรรค และแนวทางแก้ไข

คำเตือน ๑. เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ผู้ควบคุมระบบบำบัดน้ำเสีย หรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดไม่จัดเก็บสถิติ ข้อมูล หรือไม่ทำบันทึกหรือรายงาน ตามมาตรา ๘๐ ต้องระวางโทษจำคุกไม่เกินหนึ่งเดือน หรือปรับไม่เกินหนึ่งหมื่นบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๖

๒. ผู้ควบคุมระบบบำบัดน้ำเสียหรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดทำบันทึกหรือรายงาน โดยแสดงข้อความอันเป็นเท็จ ต้องระวางโทษจำคุกไม่เกินหนึ่งปี หรือปรับไม่เกิน หนึ่งแสนบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๗

รายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย

ชื่อแหล่งกำเนิดมลพิษ : นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

แหล่งกำเนิดมลพิษ ตั้งอยู่เลขที่ : 766 หมู่ที่ : ซอย :

ถนน : สุขุมวิท แขวง/ตำบล : คลองเตย เขต/อำเภอ : เขตคลองเตย จังหวัด :

กรุงเทพมหานคร โทรศัพท์ : 026612173-5 โทรสาร : 026612176

มี : เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ

ประกอบกิจการประเภท : อาคารชุด

ประเภทย่อย : ประเภท ข ตั้งแต่ 100 ห้องแต่ไม่ถึง 500 จำนวนห้อง : 216

สังกัด : อื่นๆ

ใบอนุญาตเลขที่ (ถ้ามี) : ออกให้โดย : หมดอายุ : วว/ดด/ปปปป

ในการนี้ ขอรายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย ของแหล่งกำเนิดมลพิษสำหรับ เดือน มีนาคม พ.ศ. 2569 ตามที่ได้กำหนดในมาตรา 80 แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. 2535 ในฐานะ

ลงชื่อ พิชัย ชินะชัชวารัตน์ เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ



ใบอนุ

ออ

ำเสีย ใบอนุญาตเลขที่ _

ออ

2. ข้อมูลเกี่ยวกับระบบน้ำเสีย และแหล่งรองรับน้ำทิ้ง

(1) ประเภท / ชนิดของระบบบำบัดน้ำเสีย — ความสามารถในการบำบัดน้ำเสีย

1. ระบบบำบัดน้ำเสียแบบแอกทิเวเต็ดสลัดจ์ (Activated Sludge Process) — 45.00 ลบ.ม./วัน

(2) การทำงานของระบบบำบัดน้ำเสีย

[X] แบบต่อเนื่อง 24 ชั่วโมง/วัน

[ ] แบบไม่ต่อเนื่อง (ระบุ)

(3) อุปกรณ์และเครื่องมือที่ใช้ในระบบบำบัดน้ำเสีย

[ ] เครื่องสูบน้ำ

[ ] เครื่องกวน/ผสมน้ำเสีย

[ ] เครื่องสูบตะกอน

[ ] ระบบเติมอากาศ

[ ] เครื่องกวน/ผสมสารเคมี

[ ] อื่นๆ

[ ] อื่นๆ

[ ] อื่นๆ

(4) แหล่งรองรับน้ำทิ้ง (ระบุ) ลำลองสาธารณะ

(5) วิธีจัดการตะกอนที่เกิดขึ้นจากระบบบำบัดน้ำเสียและวิธีการกำจัด จัดจ้างสูบโดยเอกชน

3. สรุปผลการทำงานของระบบบำบัดน้ำเสียเป็นรายเดือน

(1) ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย) 2,232.000 หน่วย

(2) ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.) 2,180.000 ลบ.ม.

(3) ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.) 1,744.000 ลบ.ม.

(4) การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย [X] ระบายทุกวัน

[ ] ระบายบางวัน (ระบุจำนวนวันที่ระบาย) วัน

[ ] ไม่ระบายเลย

(5) ปริมาณสารเคมี หรือสารสกัดชีวภาพที่ใช้

	ปริมาณ หน่วย
1.	0.000 กิโลกรัม

(6) การทำงานของระบบบำบัดน้ำเสีย

ระบบบำบัดน้ำเสีย [X] ปกติ [ ] ผิดปกติ

(7) ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด 0.00 กิโลกรัม

(8) ปัญหา อุปสรรค และแนวทางแก้ไข

คำเตือน ๑. เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ผู้ควบคุมระบบบำบัดน้ำเสีย หรือผู้รับจ้าง

ให้บริการบำบัดน้ำเสียผู้ใดไม่จัดเก็บสถิติ ข้อมูล หรือไม่ทำบันทึกหรือรายงาน ตามมาตรา ๘๐

ต้องระวางโทษจำคุกไม่เกินหนึ่งเดือน หรือปรับไม่เกินหนึ่งหมื่นบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๖

๒. ผู้ควบคุมระบบบำบัดน้ำเสียหรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดทำบันทึกหรือรายงาน โดยแสดงข้อความอันเป็นเท็จ

ต้องระวางโทษจำคุกไม่เกินหนึ่งปี หรือปรับไม่เกิน หนึ่งแสนบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๗

รายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย

ชื่อแหล่งกำเนิดมลพิษ : นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

แหล่งกำเนิดมลพิษ ตั้งอยู่เลขที่ : 766 หมู่ที่ : ซอย :

ถนน : สุขุมวิท แขวง/ตำบล : คลองเตย เขต/ตำบล : เขตคลองเตย จังหวัด :

กรุงเทพมหานคร โทรศัพท์ : 026612173-5 โทรสาร : 026612176

มี : เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ

ประกอบกิจการประเภท : อาคารชุด

ประเภทย่อย : ประเภท ข ตั้งแต่ 100 ห้องแต่ไม่ถึง 500 จำนวนห้อง : 216

สังกัด : อื่นๆ

ใบอนุญาตเลขที่ (ถ้ามี) : ออกให้โดย : หมดอายุ : วว/ดด/ปปปป

ในการนี้ ขอรายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย ของแหล่งกำเนิดมลพิษสำหรับ เดือน เมษายน พ.ศ. 2569 ตามที่ได้กำหนดในมาตรา 80 แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. 2535 ในฐานะ



เสีย

ใบ

ดน้ำเสีย ใบอนุญาตเลขที่ _

2. ข้อมูลเกี่ยวกับระบบน้ำเสีย และแหล่งรองรับน้ำทิ้ง

(1) ประเภท / ชนิดของระบบบำบัดน้ำเสีย — ความสามารถในการบำบัดน้ำเสีย

1. ระบบบำบัดน้ำเสียแบบแอกทิเวเต็ดสลัดจ์ (Activated Sludge Process) — 45.00 ลบ.ม./วัน

(2) การทำงานของระบบบำบัดน้ำเสีย

[X] แบบต่อเนื่อง 24 ชั่วโมง/วัน

[ ] แบบไม่ต่อเนื่อง (ระบุ)

(3) อุปกรณ์และเครื่องมือที่ใช้ในระบบบำบัดน้ำเสีย

[ ] เครื่องสูบน้ำ [ ] ระบบเติมอากาศ

[ ] เครื่องกวน/ผสมน้ำเสีย [ ] เครื่องกวน/ผสมสารเคมี

[ ] เครื่องสูบตะกอน [ ] อื่นๆ

[ ] อื่นๆ

[ ] อื่นๆ

(4) แหล่งรองรับน้ำทิ้ง (ระบุ) ลำลองสาธารณะ

(5) วิธีจัดการตะกอนที่เกิดขึ้นจากระบบบำบัดน้ำเสียและวิธีการกำจัด จัดจ้างสูบโดยเอกชน

3. สรุปผลการทำงานของระบบบำบัดน้ำเสียเป็นรายเดือน

(1) ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย) 2,160.000 หน่วย

(2) ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.) 2,702.000 ลบ.ม.

(3) ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.) 2,161.600 ลบ.ม.

(4) การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย [X] ระบายทุกวัน

[ ] ระบายบางวัน (ระบุจำนวนวันที่ระบาย) วัน

[ ] ไม่ระบายเลย

(5) ปริมาณสารเคมี หรือสารสกัดชีวภาพที่ใช้ ปริมาณ หน่วย

1. 0.000 กิโลกรัม

(6) การทำงานของระบบบำบัดน้ำเสีย

ระบบบำบัดน้ำเสีย [X] ปกติ [ ] ผิดปกติ

(7) ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด 0.00 กิโลกรัม

(8) ปัญหา อุปสรรค และแนวทางแก้ไข

คำเตือน ๑. เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ผู้ควบคุมระบบบำบัดน้ำเสีย หรือผู้รับจ้าง

ให้บริการบำบัดน้ำเสียผู้ใดไม่จัดเก็บสถิติ ข้อมูล หรือไม่ทำบันทึกหรือรายงาน ตามมาตรา ๘๐

ต้องระวางโทษจำคุกไม่เกินหนึ่งเดือน หรือปรับไม่เกินหนึ่งหมื่นบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๖

๒. ผู้ควบคุมระบบบำบัดน้ำเสียหรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดทำบันทึกหรือรายงาน โดยแสดงข้อความอันเป็นเท็จ

ต้องระวางโทษจำคุกไม่เกินหนึ่งปี หรือปรับไม่เกิน หนึ่งแสนบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๗

รายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย

ชื่อแหล่งกำเนิดมลพิษ : นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

แหล่งกำเนิดมลพิษ ตั้งอยู่เลขที่ : 766 หมู่ที่ : ซอย :

ถนน : สุขุมวิท แขวง/ตำบล : คลองเตย เขต/ตำบล : เขตคลองเตย

จังหวัด : กรุงเทพมหานคร โทรศัพท์ : 026612173-5 โทรสาร : 026612176

มี : เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ

ประกอบกิจการประเภท : อาคารชุด

ประเภทย่อย : ประเภท ข ตั้งแต่ 100 ห้องแต่ไม่ถึง 500 จำนวนห้อง : 216

สังกัด : อื่นๆ

ใบอนุญาตเลขที่ (ถ้ามี) : ออกให้โดย : หมดอายุ : วว/ดด/ปปปป

ในการนี้ ขอรายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย ของแหล่งกำเนิดมลพิษสำหรับ เดือน พฤษภาคม พ.ศ. 2569 ตามที่ได้กำหนดในมาตรา 80 แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. 2535 ในฐานะ



2. ข้อมูลเกี่ยวกับระบบน้ำเสีย และแหล่งรองรับน้ำทิ้ง

(1) ประเภท / ชนิดของระบบบำบัดน้ำเสีย ความสามารถในการบำบัดน้ำเสีย

1. ระบบบำบัดน้ำเสียแบบแอกทิเวเต็ดสลัดจ์ (Activated Sludge Process) 45.00 ลบ.ม./วัน

(2) การทำงานของระบบบำบัดน้ำเสีย [X] แบบต่อเนื่อง 24 ชั่วโมง/วัน

[ ] แบบไม่ต่อเนื่อง (ระบุ)

(3) อุปกรณ์และเครื่องมือที่ใช้ในระบบบำบัดน้ำเสีย [ ] เครื่องสูบน้ำ [ ] ระบบเติมอากาศ

[ ] เครื่องกวน/ผสมน้ำเสีย [ ] เครื่องกวน/ผสมสารเคมี

[ ] เครื่องสูบตะกอน [ ] อื่นๆ

[ ] อื่นๆ

[ ] อื่นๆ

(4) แหล่งรองรับน้ำทิ้ง (ระบุ) ลำลองสาธารณะ

(5) วิธีจัดการตะกอนที่เกิดขึ้นจากระบบบำบัดน้ำเสียและวิธีการกำจัด จัดจ้างสูบโดยเอกชน

3. สรุปผลการทำงานของระบบบำบัดน้ำเสียเป็นรายเดือน

(1) ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย) 2,232.000 หน่วย

(2) ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.) 2,049.000 ลบ.ม.

(3) ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.) 1,639.200 ลบ.ม.

(4) การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย [X] ระบายทุกวัน

[ ] ระบายบางวัน (ระบุจำนวนวันที่ระบาย) วัน

[ ] ไม่ระบายเลย

(5) ปริมาณสารเคมี หรือสารสกัดชีวภาพที่ใช้

	ปริมาณ	หน่วย
1.	0.000	กิโลกรัม

(6) การทำงานของระบบบำบัดน้ำเสีย

ระบบบำบัดน้ำเสีย [X] ปกติ [ ] ผิดปกติ

(7) ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบนำบัดน้ำเสียที่นำไปกำจัด 0.00 กิโลกรัม

(8) ปัญหา อุปสรรค และแนวทางแก้ไข

คำเตือน ๑. เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ผู้ควบคุมระบบบำบัดน้ำเสีย หรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดไม่จัดเก็บสถิติ ข้อมูล หรือไม่ทำบันทึกหรือรายงานตามมาตรา ๘๐ ต้องระวางโทษจำคุกไม่เกินหนึ่งเดือน หรือปรับไม่เกินหนึ่งหมื่นบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๖

๒. ผู้ควบคุมระบบบำบัดน้ำเสียหรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดทำบันทึกหรือรายงานโดยแสดงข้อความอันเป็นเท็จ ต้องระวางโทษจำคุกไม่เกินหนึ่งปี หรือปรับไม่เกินหนึ่งแสนบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๗

รายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย

ชื่อแหล่งกำเนิดมลพิษ : นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

แหล่งกำเนิดมลพิษ ตั้งอยู่เลขที่ : 766 หมู่ที่ : ซอย :

ถนน : สุขุมวิท แขวง/ตำบล : คลองเตย เขต/ตำบล : เขตคลองเตย

จังหวัด : กรุงเทพมหานคร โทรศัพท์ : 026612173-5 โทรสาร : 026612176

มี : เป็นเจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ

ประกอบกิจการประเภท : อาคารชุด

ประเภทย่อย : ประเภท ข ตั้งแต่ 100 ห้องแต่ไม่ถึง 500 จำนวนห้อง : 216

สังกัด : อื่นๆ

ใบอนุญาตเลขที่ (ถ้ามี) : ออกให้โดย : หมดอายุ : วว/ดด/ปปปป

ในการนี้ ขอรายงานสรุปผลการทำงานของระบบบำบัดน้ำเสีย ของแหล่งกำเนิดมลพิษสำหรับ เดือน มิถุนายน พ.ศ. 2569 ตามที่ได้กำหนดในมาตรา 80 แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. 2535 ในฐานะ

ลงชื่อ ...เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ



2. ข้อมูลเกี่ยวกับระบบน้ำเสีย และแหล่งรองรับน้ำทิ้ง

(1) ประเภท / ชนิดของระบบบำบัดน้ำเสีย ความสามารถในการบำบัดน้ำเสีย

1. ระบบบำบัดน้ำเสียแบบแอกทิเวเต็ดสลัดจ์ (Activated Sludge Process) 45.00 ลบ.ม./วัน

(2) การทำงานของระบบบำบัดน้ำเสีย [X] แบบต่อเนื่อง 24 ชั่วโมง/วัน

[ ] แบบไม่ต่อเนื่อง (ระบุ)

(3) อุปกรณ์และเครื่องมือที่ใช้ในระบบบำบัดน้ำเสีย [ ] เครื่องสูบน้ำ [ ] ระบบเติมอากาศ

[ ] เครื่องกวน/ผสมน้ำเสีย [ ] เครื่องกวน/ผสมสารเคมี

[ ] เครื่องสูบตะกอน [ ] อื่นๆ

[ ] อื่นๆ

[ ] อื่นๆ

(4) แหล่งรองรับน้ำทิ้ง (ระบุ) ลำลองสาธารณะ

(5) วิธีจัดการตะกอนที่เกิดขึ้นจากระบบบำบัดน้ำเสียและวิธีการกำจัด จัดจ้างสูบโดยเอกชน

3. สรุปผลการทำงานของระบบบำบัดน้ำเสียเป็นรายเดือน

(1) ปริมาณการใช้ไฟฟ้าของระบบบำบัดน้ำเสีย (หน่วย) 2,160.000 หน่วย

(2) ปริมาณน้ำใช้ในทุกกิจกรรมของแหล่งกำเนิดมลพิษ (ลบ.ม.) 1,524.000 ลบ.ม.

(3) ปริมาณน้ำเสียที่เข้าระบบบำบัดน้ำเสีย (ลบ.ม.) 1,219.200 ลบ.ม.

(4) การระบายน้ำทิ้งจากระบบบำบัดน้ำเสีย [X] ระบายทุกวัน

[ ] ระบายบางวัน (ระบุจำนวนวันที่ระบาย) วัน

[ ] ไม่ระบายเลย

(5) ปริมาณสารเคมี หรือสารสกัดชีวภาพที่ใช้

	ปริมาณ	หน่วย
1.	0.000	กิโลกรัม

(6) การทำงานของระบบบำบัดน้ำเสีย

ระบบบำบัดน้ำเสีย [X] ปกติ [ ] ผิดปกติ

(7) ปริมาณตะกอนส่วนเกินที่เกิดขึ้นจากระบบบำบัดน้ำเสียที่นำไปกำจัด 0.00 กิโลกรัม

(8) ปัญหา อุปสรรค และแนวทางแก้ไข

คำเตือน ๑. เจ้าของหรือผู้ครอบครองแหล่งกำเนิดมลพิษ ผู้ควบคุมระบบบำบัดน้ำเสีย หรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดไม่จัดเก็บสถิติ ข้อมูล หรือไม่ทำบันทึกหรือรายงานตามมาตรา ๘๐ ต้องระวางโทษจำคุกไม่เกินหนึ่งเดือน หรือปรับไม่เกินหนึ่งหมื่นบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๖

๒. ผู้ควบคุมระบบบำบัดน้ำเสียหรือผู้รับจ้างให้บริการบำบัดน้ำเสียผู้ใดทำบันทึกหรือรายงานโดยแสดงข้อความอันเป็นเท็จ ต้องระวางโทษจำคุกไม่เกินหนึ่งปี หรือปรับไม่เกินหนึ่งแสนบาท หรือทั้งจำทั้งปรับตามมาตรา ๑๐๗

ภาคผนวก 6

รายงานตรวจสอบวาล์ลลดแรงดัน

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มกราคม..... **Year/ปี** .....2569.... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	1	150	50	/	/	50	
2	1	150	50	/	/	50	
3	1	150	50	/	/	50	
4	1	150	50	/	/	50	
5	1	150	50	/	/	50	
6	1	150	50	/	/	50	
7	1	150	50	/	/	50	
8	1	150	50	/	/	50	
9	1	150	50	/	/	50	
10	1	150	50	/	/	50	
11	1	150	50	/	/	50	
12	1	150	50	/	/	50	
13	1	150	50	/	/	50	
14	1	150	50	/	/	50	
15	1	150	50	/	/	50	
16	1	150	50	/	/	50	
17	1	150	50	/	/	50	
18	1	150	50	/	/	50	
19	1	150	50	/	/	50	
20	1	150	50	/	/	50	
21	1	150	50	/	/	50	
22	1	150	50	/	/	50	
23	1	150	50	/	/	50	
24	1	150	50	/	/	50	
25	1	150	50	/	/	50	
26	1	150	50	/	/	50	
27	1	150	50	/	/	50	
28	1	150	50	/	/	50	
29	1	150	50	/	/	50	
30	1	150	50	/	/	50	
31	1	150	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มกราคม..... Year/ปี .....2569... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	7	100	50	/	/	50	
2	7	100	50	/	/	50	
3	7	100	50	/	/	50	
4	7	100	50	/	/	50	
5	7	100	50	/	/	50	
6	7	100	50	/	/	50	
7	7	100	50	/	/	50	
8	7	100	50	/	/	50	
9	7	100	50	/	/	50	
10	7	100	50	/	/	50	
11	7	100	50	/	/	50	
12	7	100	50	/	/	50	
13	7	100	50	/	/	50	
14	7	100	50	/	/	50	
15	7	100	50	/	/	50	
16	7	100	50	/	/	50	
17	7	100	50	/	/	50	
18	7	100	50	/	/	50	
19	7	100	50	/	/	50	
20	7	100	50	/	/	50	
21	7	100	50	/	/	50	
22	7	100	50	/	/	50	
23	7	100	50	/	/	50	
24	7	100	50	/	/	50	
25	7	100	50	/	/	50	
26	7	100	50	/	/	50	
27	7	100	50	/	/	50	
28	7	100	50	/	/	50	
29	7	100	50	/	/	50	
30	7	100	50	/	/	50	
31	7	100	50	/	/	50	

Checked By / ตรวจสอบโดย Verified By / ทบทวนตรวจสอบโดย

Signature / ...ร)

.....

Date / วันที่

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มกราคม..... . Year/ปี .....2569... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	12	90	50	✓	✓	90	
2	12	90	50	✓	✓	50	
3	12	90	50	✓	✓	50	
4	12	90	50	✓	✓	50	
5	12	90	50	✓	✓	50	
6	12	90	90	✓	✓	50	
7	12	90	50	✓	✓	50	
8	12	90	50	✓	✓	50	
9	12	90	50	✓	✓	50	
10	12	90	50	✓	✓	50	
11	12	90	50	✓	✓	50	
12	12	90	50	✓	✓	50	
13	12	90	50	✓	✓	50	
14	12	90	50	✓	✓	50	
15	12	90	50	✓	✓	50	
16	12	90	90	✓	✓	50	
17	12	90	50	✓	✓	50	
18	12	90	50	✓	✓	50	
19	12	90	50	✓	✓	50	
20	12	90	50	✓	✓	50	
21	12	90	50	✓	✓	50	
22	12	90	50	✓	✓	50	
23	12	90	50	✓	✓	50	
24	12	90	50	✓	✓	50	
25	12	90	50	✓	✓	50	
26	12	90	50	✓	✓	50	
27	12	90	50	✓	✓	50	
28	12	90	50	✓	✓	50	
29	12	90	50	✓	✓	50	
30	12	90	50	✓	✓	50	
31	12	90	50	✓	✓	50	

[redacted]

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มกราคม..... Year/ปี .....2569..... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	16	70	50	✓	✓	50	
2	16	70	50	✓	✓	50	
3	16	70	50	✓	✓	50	
4	16	70	50	✓	✓	50	
5	16	70	50	✓	✓	50	
6	16	70	70	✓	✓	50	
7	16	70	70	✓	✓	50	
8	16	70	50	✓	✓	50	
9	16	70	50	✓	✓	50	
10	16	70	50	✓	✓	50	
11	16	70	50	✓	✓	50	
12	16	70	50	✓	✓	50	
13	16	70	50	✓	✓	50	
14	16	70	50	✓	✓	50	
15	16	70	50	✓	✓	50	
16	16	70	50	✓	✓	50	
17	16	70	50	✓	✓	50	
18	16	70	50	✓	✓	50	
19	16	70	50	✓	✓	50	
20	16	70	50	✓	✓	50	
21	16	70	50	✓	✓	50	
22	16	70	50	✓	✓	50	
23	16	70	50	✓	✓	50	
24	16	70	50	✓	✓	50	
25	16	70	50	✓	✓	50	
26	16	70	50	✓	✓	50	
27	16	70	50	✓	✓	50	
28	16	70	50	✓	✓	50	
29	16	70	50	✓	✓	50	
30	16	70	50	✓	✓	50	
31	16	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	

Chec

Signa

.....

Date

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มกราคม..... **Year/ปี** .....2569..... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	20	50	50	/	/	50	
2	20	50	50	/	/	50	
3	20	50	50	/	/	50	
4	20	50	50	/	/	50	
5	20	50	50	/	/	50	
6	20	50	50	/	/	50	
7	20	50	50	/	/	50	
8	20	50	50	/	/	50	
9	20	50	50	/	/	50	
10	20	50	50	/	/	50	
11	20	50	50	/	/	50	
12	20	50	50	/	/	50	
13	20	50	50	/	/	50	
14	20	50	50	/	/	50	
15	20	50	50	/	/	50	
16	20	50	50	/	/	50	
17	20	50	50	/	/	50	
18	20	50	50	/	/	50	
19	20	50	50	/	/	50	
20	20	50	50	/	/	50	
21	20	50	50	/	/	50	
22	20	50	50	/	/	50	
23	20	50	50	/	/	50	
24	20	50	50	/	/	50	
25	20	50	50	/	/	50	
26	20	50	50	/	/	50	
27	20	50	50	/	/	50	
28	20	50	50	/	/	50	
29	20	50	50	/	/	50	
30	20	50	50	/	/	50	
31	20	50	50	/	/	50	

[redacted]คาร)

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....กุมภาพันธ์..... Year/ปี .....2569. Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	1	150	50	/	/	50	
2	1	150	50	/	/	50	
3	1	150	50	/	/	50	
4	1	150	50	/	/	50	
5	1	150	50	/	/	50	
6	1	150	50	/	/	50	
7	1	150	50	/	/	50	
8	1	150	50	/	/	50	
9	1	150	50	/	/	50	
10	1	150	50	/	/	50	
11	1	150	50	/	/	50	
12	1	150	50	/	/	50	
13	1	150	50	/	/	50	
14	1	150	50	/	/	50	
15	1	150	50	/	/	50	
16	1	150	50	/	/	50	
17	1	150	50	/	/	50	
18	1	150	50	/	/	50	
19	1	150	50	/	/	50	
20	1	150	50	/	/	50	
21	1	150	50	/	/	50	
22	1	150	50	/	/	50	
23	1	150	50	/	/	50	
24	1	150	50	/	/	50	
25	1	150	50	/	/	50	
26	1	150	50	/	/	50	
27	1	150	50	/	/	50	
28	1	150	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....กุมภาพันธ์..... Year/ปี .....2569 Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	7	100	50	/	/	/	
2	7	100	50	/	/	/	
3	7	100	50	/	/	/	
4	7	100	50	/	/	/	
5	7	100	50	/	/	/	
6	7	100	50	/	/	/	
7	7	100	50	/	/	/	
8	7	100	50	/	/	/	
9	7	100	50	/	/	/	
10	7	100	50	/	/	/	
11	7	100	50	/	/	50	
12	7	100	50	/	/	50	
13	7	100	50	/	/	50	
14	7	100	50	/	/	50	
15	7	100	50	/	/	50	
16	7	100	50	/	/	50	
17	7	100	50	/	/	50	
18	7	100	50	/	/	50	
19	7	100	50	/	/	50	
20	7	100	50	/	/	50	
21	7	100	50	/	/	50	
22	7	100	50	/	/	50	
23	7	100	50	/	/	50	
24	7	100	50	/	/	50	
25	7	100	50	/	/	50	
26	7	100	50	/	/	50	
27	7	100	50	/	/	50	
28	7	100	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....กุมภาพันธ์..... **Year/ปี** .....2569. **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	12	90	50	/	/	/	
2	12	90	50	/	/	/	
3	12	90	50	/	/	/	
4	12	90	50	/	/	/	
5	12	90	50	/	/	/	
6	12	90	50	/	/	/	
7	12	90	50	/	/	/	
8	12	90	50	/	/	/	
9	12	90	50	/	/	/	
10	12	90	50	/	/	/	
11	12	90	50	/	/	/	
12	12	90	50	/	/	/	
13	12	90	50	/	/	/	
14	12	90	50	/	/	/	
15	12	90	50	/	/	/	
16	12	90	50	/	/	/	
17	12	90	50	/	/	/	
18	12	90	50	/	/	/	
19	12	90	50	/	/	/	
20	12	90	50	/	/	/	
21	12	90	50	/	/	/	
22	12	90	50	/	/	/	
23	12	90	50	/	/	/	
24	12	90	50	/	/	/	
25	12	90	50	/	/	/	
26	12	90	50	/	/	/	
27	12	90	50	/	/	/	
28	12	90	50	/	/	/	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....กุมภาพันธ์..... **Year/ปี** .....2569.. **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	16	70	50	/	/	50	
2	16	70	50	/	/	50	
3	16	70	50	/	/	50	
4	16	70	50	/	/	50	
5	16	70	50	/	/	50	
6	16	70	50	/	/	50	
7	16	70	50	/	/	50	
8	16	70	50	/	/	50	
9	16	70	50	/	/	50	
10	16	70	50	/	/	50	
11	16	70	50	/	/	50	
12	16	70	50	/	/	50	
13	16	70	50	/	/	50	
14	16	70	50	/	/	50	
15	16	70	50	/	/	50	
16	16	70	50	/	/	50	
17	16	70	50	/	/	50	
18	16	70	50	/	/	50	
19	16	70	50	/	/	50	
20	16	70	50	/	/	50	
21	16	70	50	/	/	50	
22	16	70	50	/	/	50	
23	16	70	50	/	/	50	
24	16	70	50	/	/	50	
25	16	70	50	/	/	50	
26	16	70	50	/	/	50	
27	16	70	50	/	/	50	
28	16	70	50	/	/	50	

[redacted]

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....กุมภาพันธ์..... Year/ปี .....2569... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	20	50	50	/	/	50	
2	20	50	50	/	/	50	
3	20	50	50	/	/	50	
4	20	50	50	/	/	50	
5	20	50	50	/	/	50	
6	20	50	50	/	/	50	
7	20	50	50	/	/	50	
8	20	50	50	/	/	50	
9	20	50	50	/	/	50	
10	20	50	50	/	/	50	
11	20	50	50	/	/	50	
12	20	50	50	/	/	50	
13	20	50	50	/	/	50	
14	20	50	50	/	/	50	
15	20	50	50	/	/	50	
16	20	50	50	/	/	50	
17	20	50	50	/	/	50	
18	20	50	50	/	/	50	
19	20	50	50	/	/	50	
20	20	50	50	/	/	50	
21	20	50	50	/	/	50	
22	20	50	50	/	/	50	
23	20	50	50	/	/	50	
24	20	50	50	/	/	50	
25	20	50	50	/	/	50	
26	20	50	50	/	/	50	
27	20	50	50	/	/	50	
28	20	50	50	/	/		

[redacted]

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มีนาคม..... Year/ปี .....2569..... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	1	150	50	/	/	50	
2	1	150	50	/	/	50	
3	1	150	50	/	/	50	
4	1	150	50	/	/	50	
5	1	150	50	/	/	50	
6	1	150	50	/	/	50	
7	1	150	50	/	/	50	
8	1	150	50	/	/	50	
9	1	150	50	/	/	50	
10	1	150	50	/	/	50	
11	1	150	50	/	/	50	
12	1	150	50	/	/	50	
13	1	150	50	/	/	50	
14	1	150	50	/	/	50	
15	1	150	50	/	/	50	
16	1	150	50	/	/	50	
17	1	150	50	/	/	50	
18	1	150	50	/	/	50	
19	1	150	50	/	/	50	
20	1	150	50	/	/	50	
21	1	150	50	/	/	50	
22	1	150	50	/	/	50	
23	1	150	50	/	/	50	
24	1	150	50	/	/	50	
25	1	150	50	/	/	50	
26	1	150	50	/	/	50	
27	1	150	50	/	/	50	
28	1	150	50	/	/	50	
29	1	150	50	/	/	50	
30	1	150	50	/	/	50	
31	1	150	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มีนาคม..... Year/ปี .....2569.... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	7	100	50	/	/	50	
2	7	100	50	/	/	50	
3	7	100	50	/	/	50	
4	7	100	50	/	/	50	
5	7	100	50	/	/	50	
6	7	100	50	/	/	50	
7	7	100	50	/	/	50	
8	7	100	50	/	/	50	
9	7	100	50	/	/	50	
10	7	100	50	/	/	50	
11	7	100	50	/	/	50	
12	7	100	50	/	/	50	
13	7	100	50	/	/	50	
14	7	100	50	/	/	50	
15	7	100	50	/	/	50	
16	7	100	50	/	/	50	
17	7	100	50	/	/	50	
18	7	100	50	/	/	50	
19	7	100	50	/	/	50	
20	7	100	50	/	/	50	
21	7	100	50	/	/	50	
22	7	100	50	/	/	50	
23	7	100	50	/	/	50	
24	7	100	50	/	/	50	
25	7	100	50	/	/	50	
26	7	100	50	/	/	50	
27	7	100	50	/	/	50	
28	7	100	50	/	/	50	
29	7	100	50	/	/	50	
30	7	100	50	/	/	50	
31	7						

Knight Frank

Pressure Reducing Valve Daily Record

Date / วันที่ 1/4/65

Date / วันที่ .....

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....กุมภาพันธ์..... Year/ปี .....2569. Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	12	90	50	/	/	50	
2	12	90	50	/	/	50	
3	12	90	50	/	/	50	
4	12	90	50	/	/	50	
5	12	90	50	/	/	50	
6	12	90	50	/	/	50	
7	12	90	50	/	/	50	
8	12	90	50	/	/	50	
9	12	90	50	/	/	50	
10	12	90	50	/	/	50	
11	12	90	50	/	/	50	
12	12	90	50	/	/	50	
13	12	90	50	/	/	50	
14	12	90	50	/	/	50	
15	12	90	50	/	/	50	
16	12	90	50	/	/	50	
17	12	90	50	/	/	50	
18	12	90	50	/	/	50	
19	12	90	50	/	/	50	
20	12	90	50	/	/	50	
21	12	90	50	/	/	50	
22	12	90	50	/	/	50	
23	12	90	50	/	/	50	
24	12	90	50	/	/	50	
25	12	90	50	/	/	50	
26	12	90	50	/	/	50	
27	12	90	50	/	/	50	
28	12	90	50	/	/	50	
29	12	90	50	/	/	50	
30	12	90	50	/	/	50	
31	12						

Ch

Sig

.....

Knight Frank

Pressure Reducing Valve Daily Record

Date / วันที่ 1/4/67 Date / วันที่ .....

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มีนาคม..... Year/ปี .....2569..... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	16	70	50	✓	✓	50	
2	16	70	50	✓	✓	50	
3	16	70	50	✓	✓	50	
4	16	70	50	✓	✓	50	
5	16	70	50	✓	✓	50	
6	16	70	50	✓	✓	50	
7	16	70	50	✓	✓	50	
8	16	70	50	✓	✓	50	
9	16	70	50	✓	✓	50	
10	16	70	50	✓	✓	50	
11	16	70	50	✓	✓	50	
12	16	70	50	✓	✓	50	
13	16	70	50	✓	✓	50	
14	16	70	50	✓	✓	50	
15	16	70	50	✓	✓	50	
16	16	70	50	✓	✓	50	
17	16	70	50	✓	✓	50	
18	16	70	50	✓	✓	50	
19	16	70	50	✓	✓	50	
20	16	70	50	✓	✓	50	
21	16	70	50	✓	✓	50	
22	16	70	50	✓	✓	50	
23	16	70	50	✓	✓	50	
24	16	70	50	✓	✓	50	
25	16	70	50	✓	✓	50	
26	16	70	50	✓	✓	50	
27	16	70	50	✓	✓	50	
28	16	70	50	✓	✓	50	
29	16	70	50	✓	✓	50	
30	16	70	50	✓	✓	50	
31	16	70	50	✓	✓	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มีนาคม..... **Year/ปี** .....2569..... **Building /** อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	20	50	50	/	/	50	
2	20	50	50	/	/	50	
3	20	50	50	/	/	50	
4	20	50	50	/	/	50	
5	20	50	50	/	/	50	
6	20	50	50	/	/	50	
7	20	50	50	/	/	50	
8	20	50	50	/	/	50	
9	20	50	50	/	/	50	
10	20	50	50	/	/	50	
11	20	50	50	/	/	50	
12	20	50	50	/	/	50	
13	20	50	50	/	/	50	
14	20	50	50	/	/	50	
15	20	50	50	/	/	50	
16	20	50	50	/	/	50	
17	20	50	50	/	/	50	
18	20	50	50	/	/	50	
19	20	50	50	/	/	50	
20	20	50	50	/	/	50	
21	20	50	50	/	/	50	
22	20	50	50	/	/	50	
23	20	50	50	/	/	50	
24	20	50	50	/	/	50	
25	20	50	50	/	/	50	
26	20	50	50	/	/	50	
27	20	50	50	/	/	50	
28	20	50	50	/	/	50	
29	20	50	50	/	/	50	
30	20	50	50	/	/	50	
31	20	50	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....เมษายน..... **Year/ปี** .....2569..... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ต่างต่อนนาย)
1	1	140	50	/	/	50	
2	1	140	50	/	/	50	
3	1	140	50	/	/	50	
4	1	140	50	/	/	50	
5	1	150	50	/	/	50	
6	1	150	50	/	/	50	
7	1	150	50	/	/	50	
8	1	150	50	/	/	50	
9	1	150	50	/	/	50	
10	1	150	50	/	/	50	
11	1	150	50	/	/	50	
12	1	150	50	/	/	50	
13	1	150	50	/	/	50	
14	1	150	50	/	/	50	
15	1	150	50	/	/	50	
16	1	150	50	/	/	50	
17	1	150	50	/	/	50	
18	1	150	50	/	/	50	
19	1	150	50	/	/	50	
20	1	150	50	/	/	50	
21	1	150	50	/	/	50	
22	1	150	50	/	/	50	
23	1	150	50	/	/	50	
24	1	150	50	/	/	50	
25	1	150	50	/	/	50	
26	1	150	50	/	/	50	
27	1	150	50	/	/	50	
28	1	150	50	/	/	50	
29	1	150	50	/	/	50	
30	1	150	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....เมษายน..... **Year/ปี** .....2569... **Building /** อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	7	100	50	/	/	50	
2	7	100	50	/	/	50	
3	7	100	50	/	/	50	
4	7	100	50	/	/	50	
5	7	100	50	/	/	50	
6	7	100	50	/	/	50	
7	7	100	50	/	/	50	
8	7	100	50	/	/	50	
9	7	100	50	/	/	50	
10	7	100	50	/	/	50	
11	7	100	50	/	/	50	
12	7	100	50	/	/	50	
13	7	100	50	/	/	50	
14	7	100	50	/	/	50	
15	7	100	50	/	/	50	
16	7	100	50	/	/	50	
17	7	100	50	/	/	50	
18	7	100	50	/	/	50	
19	7	100	50	/	/	50	
20	7	100	50	/	/	50	
21	7	100	50	/	/	50	
22	7	100	50	/	/	50	
23	7	100	50	/	/	50	
24	7	100	50	/	/	50	
25	7	100	50	/	/	50	
26	7	100	50	/	/	50	
27	7	100	50	/	/	50	
28	7	100	50	/	/	50	
29	7	100	50	/	/	50	
30	7	100	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....เมษายน..... **Year/ปี** .....2569.... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	12	90	50	/	/	50	
2	12	90	50	/	/	50	
3	12	90	50	/	/	50	
4	12	90	50	/	/	50	
5	12	90	50	/	/	50	
6	12	90	50	/	/	50	
7	12	90	50	/	/	50	
8	12	90	50	/	/	50	
9	12	90	50	/	/	50	
10	12	90	50	/	/	50	
11	12	90	50	/	/	50	
12	12	90	50	/	/	50	
13	12	90	50	/	/	50	
14	12	90	50	/	/	50	
15	12	90	50	/	/	50	
16	12	90	50	/	/	50	
17	12	90	50	/	/	50	
18	12	90	50	/	/	50	
19	12	90	50	/	/	50	
20	12	90	50	/	/	50	
21	12	90	50	/	/	50	
22	12	90	50	/	/	50	
23	12	90	50	/	/	50	
24	12	90	50	/	/	50	
25	12	90	50	/	/	50	
26	12	90	50	/	/	50	
27	12	90	50	/	/	50	
28	12	90	50	/	/	50	
29	12	90	50	/	/	50	
30	12	90	50	/	/	50	

[redacted]

...าคาร)

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....เมษายน..... Year/ปี .....2569..... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	16	70	50	/	/	50	
2	16	70	50	/	/	50	
3	16	70	50	/	/	50	
4	16	70	50	/	/	50	
5	16	70	50	/	/	50	
6	16	70	50	/	/	50	
7	16	70	50	/	/	50	
8	16	70	50	/	/	50	
9	16	70	50	/	/	50	
10	16	70	50	/	/	50	
11	16	70	50		/	50	
12	16	70	50	/	/	50	
13	16	70	50	/	/	50	
14	16	70	50	/	/	50	
15	16	70	50	/	/	50	
16	16	70	50	/	/	50	
17	16	70	50	/	/	50	
18	16	70	50	/	/	50	
19	16	70	50	/	/	50	
20	16	70	50	/	/	50	
21	16	70	50	/	/	50	
22	16	70	50	/	/	50	
23	16	70	50	/	/	50	
24	16	70	50	/	/	50	
25	16	70	50	/	/	50	
26	16	70	50	/	/	50	
27	16	70	50	/	/	50	
28	16	70	50	/	/	50	
29	16	70	50	/	/	50	
30	16	70	50	/	/	50	

[redacted]

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....เมษายน..... **Year/ปี** .....2569..... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	20	50	50	/	/	50	
2	20	50	50	/	/	50	
3	20	50	50	/	/	50	
4	20	50	50	/	/	50	
5	20	50	50	/	/	50	
6	20	50	50	/	/	50	
7	20	50	50	/	/	50	
8	20	50	50	/	/	50	
9	20	50	50	/	/	50	
10	20	50	50	/	/	50	
11	20	50	50	/	/	50	
12	20	50	50	/	/	50	
13	20	50	50	/	/	50	
14	20	50	50	/	/	50	
15	20	50	50	/	/	50	
16	20	50	50	/	/	50	
17	20	50	50	/	/	50	
18	20	50	50	/	/	50	
19	20	50	50	/	/	50	
20	20	50	50	/	/	50	
21	20	50	50	/	/	50	
22	20	50	50	/	/	50	
23	20	50	50	/	/	50	
24	20	50	50	/	/	50	
25	20	50	50	/	/	50	
26	20	50	50	/	/	50	
27	20	50	50	/	/	50	
28	20	50	50	/	/	50	
29	20	50	50	/	/	50	
30	20	50	50	50	/	50	

Checked By

Signature / ล

.....

Date / วันที่ ..

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....พฤษภาคม..... **Year/ปี** .....2569. **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	1	150	50	/	/	50	
2	1	150	50	/	/	50	
3	1	150	50	/	/	50	
4	1	150	50	/	/	50	
5	1	150	50	/	/	50	
6	1	150	50	/	/	50	
7	1	150	50	/	/	50	
8	1	150	50	/	/	50	
9	1	150	50	/	/	50	
10	1	150	50	/	/	50	
11	1	150	50	/	/	50	
12	1	150	50	/	/	50	
13	1	150	50	/	/	50	
14	1	150	50	/	/	50	
15	1	150	50	/	/	50	
16	1	150	50	/	/	50	
17	1	150	50	/	/	50	
18	1	150	50	/	/	50	
19	1	150	50	/	/	50	
20	1	150	50	/	/	50	
21	1	150	50	/	/	50	
22	1	150	50	/	/	50	
23	1	150	50	/	/	50	
24	1	150	50	/	/	50	
25	1	150	50	/	/	50	
26	1	150	50	/	/	50	
27	1	150	50	/	/	50	
28	1	150	50	/	/	50	
29	1	150	50	/	/	50	
30	1	150	50	/	/	50	
31	1						

คาร)

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....พฤษภาคม..... Year/ปี .....2569 Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	7	100	50	✓	✓	50	
2	7	100	50	✓	✓	50	
3	7	100	50	✓	✓	50	
4	7	100	50	✓	✓	50	
5	7	100	50	✓	✓	50	
6	7	100	50	✓	✓	50	
7	7	100	50	✓	✓	50	
8	7	100	50	✓	✓	50	
9	7	100	50	✓	✓	50	
10	7	100	50	✓	✓	50	
11	7	100	60	✓	✓	50	
12	7	100	60	✓	✓	60	
13	7	100	60	✓	✓	50	
14	7	100	50	✓	✓	60	
15	7	100	60	✓	✓	60	
16	7	100	60	✓	✓	60	
17	7	100	50	✓	✓	50	
18	7	100	60	✓	✓	60	
19	7	100	50	✓	✓	60	
20	7	100	50	✓	✓	50	
21	7	100	50	✓	✓	50	
22	7	100	50	✓	✓	50	
23	7	100	50	✓	✓	50	
24	7	100	50	✓	✓	50	
25	7	100	50	✓	✓	50	
26	7	100	50	✓	✓	50	
27	7	100	50	✓	✓	50	
28	7	100	50	✓	✓	50	
29	7	100	50	✓	✓	50	
30	7	100	50	✓	✓	50	
31	7						

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....พฤษภาคม..... Year/ปี .....2569 Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	12	90	50	✓	✓	50	
2	12	90	50	✓	✓	50	
3	12	90	50	✓	✓	50	
4	12	90	50	✓	✓	50	
5	12	90	50	✓	✓	50	
6	12	90	50	✓	✓	50	
7	12	90	50	✓	✓	50	
8	12	90	50	✓	✓	50	
9	12	90	50	✓	✓	50	
10	12	90	50	✓	✓	50	
11	12	90	50	✓	✓	50	
12	12	90	50	✓	✓	50	
13	12	90	50	✓	✓	50	
14	12	90	50	✓	✓	50	
15	12	90	50	✓	✓	50	
16	12	90	50	✓	✓	50	
17	12	90	50	✓	✓	50	
18	12	90	50	✓	✓	50	
19	12	90	50	✓	✓	50	
20	12	90	50	✓	✓	50	
21	12	90	50	✓	✓	50	
22	12	90	50	✓	✓	50	
23	12	90	50	✓	✓	50	
24	12	90	50	✓	✓	50	
25	12	90	50	✓	✓	50	
26	12	90	50	✓	✓	50	
27	12	90	50	✓	✓	50	
28	12	90	50	✓	✓	50	
29	12	90	50	✓	✓	50	
30	12	90	50	✓	✓	50	
31							

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....พฤษภาคม..... Year/ปี .....2569.. Building / อ

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	
1	16	70	50	✓	✓	
2	16	70	50	✓	✓	
3	16	70	50	✓	✓	50
4	16	70	50	✓	✓	50
5	16	70	50	✓	✓	50
6	16	70	50	✓	✓	50
7	16	70	50	✓	✓	50
8	16	70	50	✓	✓	50
9	16	70	50	✓	✓	50
10	16	70	50	✓	✓	50
11	16	70	50	✓	✓	50
12	16	70	50	✓	✓	50
13	16	70	50	✓	✓	50
14	16	70	50	✓	✓	50
15	16	70	50	✓	✓	50
16	16	70	50	✓	✓	50
17	16	70	50	✓	✓	50
18	16	70	50	✓	✓	50
19	16	70	50	✓	✓	50
20	16	70	50	✓	✓	50
21	16	70	50	✓	✓	50
22	16	70	50	✓	✓	50
23	16	70	50	✓	✓	50
24	16	70	50	✓	✓	50
25	16	70	50	✓	✓	50
26	16	70	50	✓	✓	50
27	16	70	50	✓	✓	50
28	16	70	50	✓	✓	50
29	16	70	50	✓	✓	50
30	16	70	50	✓	✓	50
31	16	70	50	✓	✓	50

Checke

Signatu

.....

Date /

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....พฤษภาคม..... Year/ปี .....2569... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งได้ (PSI)	ผู้ตรวจสอบ
1	20	50	50	/	/	50	
2	20	50	50	/	/	50	
3	20	50	50	/	/	50	
4	20	50	50	/	/	50	
5	20	50	50	/	/	50	
6	20	50	50	/	/	50	
7	20	50	50	/	/	50	
8	20	50	50	/	/	50	
9	20	50	50	/	/	50	
10	20	50	50	/	/	50	
11	20	50	50	/	/	50	
12	20	50	50	/	/	50	
13	20	50	50	/	/	50	
14	20	50	50	/	/	50	
15	20	50	50	/	/	50	
16	20	50	50	/	/	50	
17	20	50	50	/	/	50	
18	20	50	50	/	/	50	
19	20	50	50	/	/	50	
20	20	50	50	/	/	50	
21	20	50	50	/	/	50	
22	20	50	50	/	/	50	
23	20	50	50	/	/	50	
24	20	50	50	/	/	50	
25	20	50	50	/	/	50	
26	20	50	50	/	/	50	
27	20	50	50	/	/	50	
28	20	50	50	/	/	50	
29	20	50	50	/	/	50	
30	20	50	50	/	/	50	
31	20	50	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มิถุนายน..... **Year/ปี** .....2569.... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	1	150	50	/	/	50	
2	1	150	50	/	/	50	
3	1	150	50	/	/	50	
4	1	150	50	/	/	50	
5	1	150	50	/	/	50	
6	1	150	50	/	/	50	
7	1	150	50	/	/	50	
8	1	150	50	/	/	50	
9	1	150	50	/	/	50	
10	1	150	50	/	/	50	
11	1	150	50	/	/	50	
12	1	150	50	/	/	50	
13	1	150	50	/	/	50	
14	1	150	50	/	/	50	
15	1	150	50	/	/	50	
16	1	150	50	/	/	50	
17	1	150	50	/	/	50	
18	1	150	50	/	/	50	
19	1	150	50	/	/	50	
20	1	150	50	/	/	50	
21	1	150	50	/	/	50	
22	1	150	50	/	/	50	
23	1	150	50	/	/	50	
24	1	150	50	/	/	50	
25	1	150	50	/	/	50	
26	1	150	50	/	/	50	
27	1	150	50	/	/	50	
28	1	150	50	/	/	50	
29	1	150	50	/	/	50	
30	1	150	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มิถุนายน..... Year/ปี .....2569.. Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	7	100	50	/	/	50	
2	7	100	50	/	/	50	
3	7	100	50	/	/	50	
4	7	100	50	/	/	50	
5	7	100	50	/	/	50	
6	7	100	50	/	/	50	
7	7	100	50	/	/	50	
8	7	100	50	/	/	50	
9	7	100	50	/	/	50	
10	7	100	50	/	/	50	
11	7	100	50	/	/	50	
12	7	100	50	/	/	50	
13	7	100	50	/	/	50	
14	7	100	50	/	/	50	
15	7	100	50	/	/	50	
16	7	100	50	/	/	50	
17	7	100	50	/	/	50	
18	7	100	50	/	/	50	
19	7	100	50	/	/	50	
20	7	100	50	/	/	50	
21	7	100	50	/	/	50	
22	7	100	50	/	/	50	
23	7	100	50	/	/	50	
24	7	100	50	/	/	50	
25	7	100	50	/	/	50	
26	7	100	50	/	/	50	
27	7	100	50	/	/	50	
28	7	100	50	/	/	50	
29	7	100	50	/	/	50	
30	7	100	50	/	/	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มิถุนายน..... Year/ปี .....2569... Building / อาคาร...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	12	90	50	✓	✓	50	
2	12	90	50	✓	✓	50	
3	12	90	50	✓	✓	50	
4	12	90	50	✓	✓	50	
5	12	90	50	✓	✓	50	
6	12	90	50	✓	✓	50	
7	12	90	50	✓	✓	50	
8	12	90	50	✓	✓	50	
9	12	90	50	✓	✓	50	
10	12	90	50	✓	✓	50	
11	12	90	50	✓	✓	50	
12	12	90	50	✓	✓	50	
13	12	90	50	✓	✓	50	
14	12	90	50	✓	✓	50	
15	12	90	50	✓	✓	50	
16	12	90	50	✓	✓	50	
17	12	90	50	✓	✓	50	
18	12	90	50	✓	✓	50	
19	12	90	50	✓	✓	50	
20	12	90	50	✓	✓	50	
21	12	90	50	✓	✓	50	
22	12	90	50	✓	✓	50	
23	12	90	50	✓	✓	50	
24	12	90	50	✓	✓	50	
25	12	90	50	✓	✓	50	
26	12	90	50	✓	✓	50	
27	12	90	50	✓	✓	50	
28	12	90	50	✓	✓	50	
29	12	90	50	✓	✓	50	
30	12	90	50	✓	✓	50	

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มิถุนายน..... **Year/ปี** .....2569.... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ
1	16	70	50	✓	✓	50	
2	16	70	50	✓	✓	50	
3	16	70	50	✓	✓	50	
4	16	70	50	✓	✓	50	
5	16	70	50	✓	✓	50	
6	16	70	50	✓	✓	50	
7	16	70	50	✓	✓	50	
8	16	70	50	✓	✓	50	
9	16	70	50	✓	✓	50	
10	16	70	50	✓	✓	50	
11	16	70	50	✓	✓	50	
12	16	70	50	✓	✓	50	
13	16	70	50	✓	✓	50	
14	16	70	50	✓	✓	50	
15	16	70	50	✓	✓	50	
16	16	70	50	✓	✓	50	
17	16	70	50	✓	✓	50	
18	16	70	50	✓	✓	50	
19	16	70	50	✓	✓	50	
20	16	70	50	✓	✓	50	
21	16	70	50	✓	✓	50	
22	16	70	50	✓	✓	50	
23	16	70	50	✓	✓	50	
24	16	70	50	✓	✓	50	
25	16	70	50	✓	✓	50	
26	16	70	50	✓	✓	50	
27	16	70	50	✓	✓	50	
28	16	70	50	✓	✓	50	
29	16	70	50	✓	✓	50	
30	16						

Knight Frank

Pressure Reducing Valve Daily Record

ใบรายงานตรวจสอบวาล์วลดแรงดันรายวันประจำเดือน

Month /เดือน.....มิถุนายน..... **Year/ปี** .....2569..... **Building / อาคาร**...คีนน์ บาย แสนสิริ...

Date วันที่	Floor ชั้น	แรงดันขาเข้า (PSI)	แรงดันขาออก (PSI)	ตรวจเช็ควาล์ว (By Pass)	ตรวจเช็คข้อต่อการรั่วซึม	แรงดันที่ตั้งไว้ (PSI)	ผู้ตรวจสอบ (ช่างซ่อมบำรุง)
1	20	50	50	/	/	50	
2	20	50	50	/	/	50	
3	20	50	50	/	/	50	
4	20	50	50	/	/	50	
5	20	50	50	/	/	50	
6	20	50	50	/	/	50	
7	20	50	50	/	/	50	
8	20	50	50	/	/	50	
9	20	50	50	/	/	50	
10	20	50	50	/	/	50	
11	20	50	50	/	/	50	
12	20	50	50	/	/	50	
13	20	50	50	/	/	50	
14	20	50	50	/	/	50	
15	20	50	50	/	/	50	
16	20	50	50	/	/	50	
17	20	50	50	/	/	50	
18	20	50	50	/	/	50	
19	20	50	50	/	/	50	
20	20	50	50	/	/	50	
21	20	50	50	/	/	50	
22	20	50	50	/	/	50	
23	20	50	50	/	/	50	
24	20	50	50	/	/	50	
25	20	50	50	/	/	50	
26	20	50	50	/	/	50	
27	20	50	50	/	/	50	
28	20	50	50	/	/	50	
29	20	50	50	/	/	50	
30	20	50	50	/	/	50	

[redacted]

โดย

การอาคาร)

.....

.....

ภาคผนวก 8

ผลการตรวจวัดคุณภาพสิ่งแวดล้อม

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS
TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN26010006
CHARACTERISTICS OF WATER	: น้ำตาล ขุ่น มีตะกอน มีกลิ่นเหม็นรุนแรง	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: JANUARY 06, 2026	RECEIVED DATE	: JANUARY 06, 2025
SAMPLING TIME	: 11:00	ANALYTICAL DATE	: JANUARY 06-15, 2025
SAMPLING BY	: นายพีรพล ถวิลหวัง	REPORT DATE	: JANUARY 16, 2025

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.1 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	58.1	2.0	-
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	312.0	-	-
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	78.0	-	-
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	-
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	38.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	4.6	1.4	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA LABORATORY ACCREDITATION BLA-DSS TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN26010007
CHARACTERISTICS OF WATER	: เหลือง ขุ่น มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: JANUARY 06, 2026	RECEIVED DATE	: JANUARY 06, 2025
SAMPLING TIME	: 11:00	ANALYTICAL DATE	: JANUARY 06-15, 2025
SAMPLING BY	: นายพีรพล ถวิลหวัง	REPORT DATE	: JANUARY 16, 2025

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.2 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	32.4	2.0	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	296.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	26.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	24.2	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	4.0	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	2.1×10^5	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS
TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: บ่อพักน้ำทิ้งสุดท้ายก่อนระบายออกสู่ท่อระบายน้ำสาธารณะ		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN26010008
CHARACTERISTICS OF WATER	: เหลือง ขุ่น ไม่มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: JANUARY 06, 2026	RECEIVED DATE	: JANUARY 06, 2025
SAMPLING TIME	: 11:00	ANALYTICAL DATE	: JANUARY 06-15, 2025
SAMPLING BY	: นายพีรพล ถวิลหวัง	REPORT DATE	: JANUARY 16, 2025

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.7 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	27.0	2.0	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	304.0	-	≤1,000
Total Suspended Solids	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	Not Detected	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	17.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	3.4	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	1.2×10^5	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA LABORATORY ACCREDITATION BLA-DSS TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260210223
CHARACTERISTICS OF WATER	: เหลือง ขุ่นเล็กน้อย มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: FEBRUARY 04, 2026	RECEIVED DATE	: FEBRUARY 04, 2026
SAMPLING TIME	: 13:00	ANALYTICAL DATE	: FEBRUARY 04-13, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: FEBRUARY 16, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.8 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Azide Modification (SM: 4500-O C, 5210 B.)	210.0	2.0	-
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	380.0	-	-
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	96.0	-	-
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	-
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	78.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	3.8	1.4	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260210224
CHARACTERISTICS OF WATER	: เหลือง ขุ่นเล็กน้อย มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: FEBRUARY 04, 2026	RECEIVED DATE	: FEBRUARY 04, 2026
SAMPLING TIME	: 13:00	ANALYTICAL DATE	: FEBRUARY 04-13, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: FEBRUARY 16, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.9 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Azide Modification (SM: 4500-O C, 5210 B.)	147.5	2.0	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	378.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	25.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	71.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	3.0	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark :
1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)
2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: บ่อพักน้ำทิ้งสุดท้ายก่อนระบายออกสู่ท่อระบายน้ำสาธารณะ		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260210225
CHARACTERISTICS OF WATER	: เหลือง ขุ่นเล็กน้อย มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: FEBRUARY 04, 2026	RECEIVED DATE	: FEBRUARY 04, 2026
SAMPLING TIME	: 13:00	ANALYTICAL DATE	: FEBRUARY 04-13, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: FEBRUARY 16, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	8.2 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Azide Modification (SM: 4500-O C, 5210 B.)	74.0	2.0	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	402.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	25.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	35.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	2.8	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260310495
CHARACTERISTICS OF WATER	: น้ำตาลเข้ม ขุ่นมาก มีตะกอนมาก มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: MARCH 06, 2026	RECEIVED DATE	: MARCH 06, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: MARCH 06-25, 2026
SAMPLING BY	: นายโกวิท บุหา	REPORT DATE	: MARCH 30, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.0 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	116.4	2.0	-
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	244.0	-	-
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	45.0	-	-
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	-
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	53.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	2.6	1.4	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS
TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260310496
CHARACTERISTICS OF WATER	: น้ำตาลอ่อน ขุ่นเล็กน้อย มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: MARCH 06, 2026	RECEIVED DATE	: MARCH 06, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: MARCH 06-25, 2026
SAMPLING BY	: นายโกวิท บุหา	REPORT DATE	: MARCH 30, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.1 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	12.0	2.0	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	264.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	22.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	23.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	3.0	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	960.0	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark :
1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)
2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA
LABORATORY ACCREDITATION BLA-DSS
TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: บ่อพักน้ำทิ้งสุดท้ายก่อนระบายออกสู่ท่อระบายน้ำสาธารณะ		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260310497
CHARACTERISTICS OF WATER	: น้ำตาลอ่อน ขุ่นเล็กน้อย มีตะกอน ไม่มีกลิ่น	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: MARCH 06, 2026	RECEIVED DATE	: MARCH 06, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: MARCH 06-25, 2026
SAMPLING BY	: นายโกวิท บุหา	REPORT DATE	: MARCH 30, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.5 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	11.1	2.0	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	260.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	12.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	21.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	1.8	1.4	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	960.0	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

(MR)
LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260410670
CHARACTERISTICS OF WATER	: น้ำตาลอ่อน ขุ่นเล็กน้อย มีตะกอน มีกลิ่นเหม็นรุนแรง	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: APRIL 2, 2026	RECEIVED DATE	: APRIL 2, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: APRIL 2-10, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: APRIL 17, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.0 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	226.0	-	-
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	170.0	-	-
Total Suspended Solids	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	4.0	-	-
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	-
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	128.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	3.4	-	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

(M

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260410671
CHARACTERISTICS OF WATER	: เหลือง ขุ่นเล็กน้อย มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: APRIL 2, 2026	RECEIVED DATE	: APRIL 2, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: APRIL 2-10, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: APRIL 17, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.2 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	117.0	-	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	159.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	17.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	44.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	3.0	-	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA LABORATORY ACCREDITATION BLA-DSS TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: บ่อพักน้ำทิ้งสุดท้ายก่อนระบายออกสู่ท่อระบายน้ำสาธารณะ		
SAMPLING METHOD	: GRAB		
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260410672
CHARACTERISTICS OF WATER	: เหลือง ขุ่นเล็กน้อย มีตะกอน ไม่มีกลิ่น	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: APRIL 2, 2026	RECEIVED DATE	: APRIL 2, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: APRIL 2-10, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: APRIL 17, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.2 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	111.5	-	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	168.0	-	≤1,000
Total Suspended Solids	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	8.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	42.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	2.2	-	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	1.1×10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

(MR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA LABORATORY ACCREDITATION BLA-DSS TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB	SAMPLE NO.	: 05060
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260590056
CHARACTERISTICS OF WATER	: เหลือง ขุ่นเล็กน้อย มีตะกอน มีกลิ่นเหม็นรุนแรง	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: MAY 8, 2026	RECEIVED DATE	: MAY 8, 2026
SAMPLING TIME	: 11:00	ANALYTICAL DATE	: MAY 8 - 14, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: MAY 15, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.1 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	229.0	-	-
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	148.0	-	-
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	19.0	-	-
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	-
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	82.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	2.2	-	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB	SAMPLE NO.	: 05061
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260590057
CHARACTERISTICS OF WATER	: เหลือง ขุ่นเล็กน้อย ไม่มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: MAY 8, 2026	RECEIVED DATE	: MAY 8, 2026
SAMPLING TIME	: 11:00	ANALYTICAL DATE	: MAY 8 - 14, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: MAY 15, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.1 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	57.6	-	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	166.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	14.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	34.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	1.4	-	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	2.1×10^5	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA LABORATORY ACCREDITATION BLA-DSS TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: บ่อพักน้ำทิ้งสุดท้ายก่อนระบายออกสู่ท่อระบายน้ำสาธารณะ		
SAMPLING METHOD	: GRAB	SAMPLE NO.	: 05062
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260590058
CHARACTERISTICS OF WATER	: น้ำตาล ขุ่นเล็กน้อย ไม่มีตะกอน ไม่มีกลิ่น	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: MAY 8, 2026	RECEIVED DATE	: MAY 8, 2026
SAMPLING TIME	: 11:00	ANALYTICAL DATE	: MAY 8 - 14, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: MAY 15, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.1 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	47.4	-	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	146.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	13.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	27.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	1.2	-	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	1.6 x 10^5	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

(MR TAWATCHAI CHONGVUTICHAI)

LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA
LABORATORY ACCREDITATION BLA-DSS
TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB	SAMPLE NO.	: 06047
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260690047
CHARACTERISTICS OF WATER	: เหลือง ขุ่น มีตะกอน มีกลิ่นเหม็นรุนแรง	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: JUNE 5, 2026	RECEIVED DATE	: JUNE 5, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: JUNE 5 - 11, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: JUNE 12, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.2 at 25°C	-	-
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	159.5	-	-
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	198.0	-	-
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	38.0	-	-
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	-
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	52.0	-	-
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	2.4	-	-
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)



*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย		
SAMPLING METHOD	: GRAB	SAMPLE NO.	: 06048
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260690048
CHARACTERISTICS OF WATER	: เหลือง ขุ่น มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: JUNE 5, 2026	RECEIVED DATE	: JUNE 5, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: JUNE 5 - 11, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: JUNE 12, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.3 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	139.0	-	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	204.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	35.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	48.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	1.4	-	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ห้องปฏิบัติการวิเคราะห์บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
63/13 เพชรเกษม ซอย 7 แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพฯ 10600
OKLA Tel: 0 2868 1246 Fax: 0 2868 0860 www.okla-testing.com J-NAC Group

ilac-MRA

LABORATORY ACCREDITATION BLA-DSS

TESTING No.0334

ANALYSIS REPORT

CUSTOMER NAME	: Keyne by Sansiri		
ADDRESS	: เลขที่ 766 ถนนสุขุมวิท แขวงคลองตัน เขตคลองเตย กรุงเทพมหานคร 10110.		
SAMPLING LOCATION	: บ่อพักน้ำทิ้งสุดท้ายก่อนระบายออกสู่ท่อระบายน้ำสาธารณะ		
SAMPLING METHOD	: GRAB	SAMPLE NO.	: 06049
SAMPLING CONDITION	: NORMAL	REPORT NO.	: RN260690049
CHARACTERISTICS OF WATER	: เหลือง ขุ่น มีตะกอน มีกลิ่นเหม็นเล็กน้อย	SAMPLING SOURCE	: WASTEWATER
SAMPLING DATE	: JUNE 5, 2026	RECEIVED DATE	: JUNE 5, 2026
SAMPLING TIME	: 13:30	ANALYTICAL DATE	: JUNE 5 - 11, 2026
SAMPLING BY	: นายปริญญา กล่ำน้อย	REPORT DATE	: JUNE 12, 2026

PARAMETER	UNIT	METHODS OF ANALYSIS	RESULT	MDL	STANDARD*
pH#	-	Electrometric (SM: 4500-H^+ B.)	7.4 at 25°C	-	5.5-9.0
Biochemical Oxygen Demand	mg/l	Membrane Electrode (SM: 4500-O G, 5210 B.)	125.0	-	≤30
Total Dissolved Solids#	mg/l	Total Dissolved Solids Dried at 180°C (SM: 2540 C.)	216.0	-	≤1,000
Total Suspended Solids#	mg/l	Total Suspended Solids Dried at 103-105°C (SM: 2540 D.)	43.0	-	≤40
Sulfide as H_2S	mg/l	Iodometric (SM: 4500-S^{2-} F.)	Not Detected	-	≤1.0
Total Kjeldahl Nitrogen	mg/l	Macro Kjeldahl (SM: 4500-N_{org}B)	45.0	-	≤35
Oil & Grease	mg/l	Liquid-Liquid Partition-Gravimetric (SM: 5520 B.)	0.8	-	≤20
Total Coliform Bacteria	MPN/100 ml	MPN Test	>2.4 x 10^6	-	-

SM : STANDARD METHODS FOR EXAMINATION OF WATER AND WASTEWATER 24th ED.,2023 (AWWA,APHA, WEF)

Remark : 1. *Notification of the Ministry of Natural Resources and Environment, dated June 28, B.E. 2567 (2024), which was published in the Royal Government Gazette, Vol. 141, Part 233D dated August 27, B.E. 2567 (2024) . (Category B)

2. #ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

(MR. PANYACHA CHONGYOTHA)

LABORATORY SUPERVISOR

*** Reported analysis refers to submitted sample only. Report analysis shall not be reproduced except infull, without written approval of Laboratory. ***

ภาคผนวก 9

เอกสารขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน



ที่ อก ๐๓๑๐(๑)/ ๙๒๔๖

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๑๑ กันยายน ๒๕๖๗

เรื่อง ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

เรียน กรรมการผู้จัดการ บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๑๕ กรกฎาคม ๒๕๖๗

สิ่งที่ส่งมาด้วย เอกสารแนบท้ายหนังสือรับต่ออายุขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด จำนวน ๑ แผ่น

ตามคำขอที่อ้างถึง บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด ขอต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๒๑๙ สถานที่ตั้งเลขที่ ๖๓/๑๓ ซอยเพชรเกษม ๗ แขวงวัดท่าพระ เขตบางกอกใหญ่ กรุงเทพมหานคร ต่อกรมโรงงานอุตสาหกรรม ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน โดยมีองค์ประกอบดังนี้

ก. ผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน

๑) นายธวัชชัย จงวุฒิชัย	ทะเบียนเลขที่ ว-๒๑๙-ค-๐๐๐๑
๒) นางสาวปนัดดา พันธ์กะจับ	ทะเบียนเลขที่ ว-๒๑๙-ค-๐๐๐๒
๓) นางสาวจามจุรี คำปุย	ทะเบียนเลขที่ ว-๒๑๙-ค-๐๐๐๓

ข. เจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน

๑) นางสาวนิจินาท มะติยาภักดิ์	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๑
๒) นางสาวภานุชนารถ เชี่ยวชาญ	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๒
๓) นางสาวธิดารัตน์ กลัดตลาด	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๓
๔) นางสาวเบญจพร อินแก้ว	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๔
๕) นางสาววันวิสา หวังแววกลาง	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๕
๖) นางสาวรัตตชา ศรีปราสาท	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๖
๗) นายปริญญา กล่ำน้อย	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๗
๘) นายโกวิท บุพา	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๘
๙) นายพีรพล ถวิลหวัง	ทะเบียนเลขที่ ว-๒๑๙-จ-๐๐๐๙

ค. ขอบข่ายชนิดสารมลพิษ...

ค. ขอบข่ายชนิดสารมลพิษที่ได้รับขึ้นทะเบียนให้วิเคราะห์ในน้ำ/น้ำเสีย และอากาศเสีย ตามสิ่งที่ส่งมาด้วย

หนังสือฉบับนี้จะหมดอายุในวันที่ ๑๕ สิงหาคม ๒๕๗๑ หากประสงค์จะต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ให้ยื่นคำขอต่ออายุพร้อมเอกสารประกอบคำขอต่อกรมโรงงานอุตสาหกรรม ภายใน ๖๐ วัน ก่อนวันสิ้นอายุของหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ



กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

เอกสารแนบท้ายหนังสือรับต่ออายุขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด เลขทะเบียน ว-๒๑๙
ที่ อก ๐๓๑๐(๑)/ ๙๒๔๖ ลงวันที่ ๑๑ กันยายน ๒๕๖๗

ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรมจำนวน ๑๔ รายการ

น้ำ/น้ำเสีย จำนวน 9 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Biochemical Oxygen Demand	1) 5-Day BOD Test, Azide Modification Method[2]
		2) 5-Day BOD Test, Membrane Electrode Method[2]
2	Free Chlorine	Iodometric Method[2]
3	Oil & Grease	Liquid-Liquid, Partition Gravimetric Method[2]
4	pH	Electrometric Method[2]
5	Sulfide	Iodometric Method[2]
6	Temperature	Laboratory and Field Methods[2]
7	Total Dissolved Solids	Dried at 180 °C[2]
8	Total Kjeldahl Nitrogen	Macro-Kjeldahl Method[2]
9	Total Suspended Solids	Dried from 103 to 105 °C[2]

อากาศเสีย (ปล่องระบาย) จำนวน 5 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Carbon Monoxide	Instrument Analyzer Method[3]
2	Opacity	Ringelmann's Method[1]
3	Oxides of Nitrogen	Instrument Analyzer Method[3]
4	Sulfur Dioxide	Instrument Analyzer Method[3]
5	Total Suspended Particulate	Isokinetic Sampling, Gravimetric Method[3]

เอกสารอ้างอิง

1. กระทรวงอุตสาหกรรม. ประกาศกระทรวงอุตสาหกรรม เรื่อง กำหนดค่าปริมาณเขม่าควันที่เจือปนในอากาศที่ระบายออกจากปล่องของหม้อน้ำของโรงงาน พ.ศ. 2549. **ราชกิจจานุเบกษา**. 4 ธันวาคม 2549. เล่มที่ 123 ตอนพิเศษ 125 ง.

2. APHA, AWWA, WEF. **Standard Methods for the Examination of Water and Wastewater.** 24th ed. Washington, DC: APHA, 2023.

3. United States Environmental Protection Agency. **Standard of Performance for New Stationary Source.** 40 CFR 60. Appendix A, 2019.



ที่ อว 0303/167

ใบรับรองความสามารถห้องปฏิบัติการทดสอบ

ใบรับรองฉบับนี้ให้ไว้เพื่อแสดงว่า

ห้องปฏิบัติการวิเคราะห์ บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด
เลขที่ 63/13 ซอยเพชรเกษม 7 แขวงวัดท่าพระ
เขตบางกอกใหญ่ กรุงเทพมหานคร 10600

ได้ผ่านการประเมินความสามารถห้องปฏิบัติการทดสอบตามมาตรฐาน ISO/IEC 17025 : 2017
และข้อกำหนด กฎระเบียบ และเงื่อนไขการรับรองความสามารถห้องปฏิบัติการทดสอบ
ของสำนักบริหารและรับรองห้องปฏิบัติการ กรมวิทยาศาสตร์บริการ

LABORATORY ACCREDITATION
BLA-DSS

หมายเลขการรับรองระบบงานที่ ทดสอบ - 0334

รายละเอียดการรับรองดังขอบข่ายการรับรองแนบท้าย

ออกให้ ณ วันที่ : ***10 มกราคม 2568***
หมดอายุ วันที่ :
ลงชื่อ :

ผู้อำนวยการสำนักบริหารและรับรองห้องปฏิบัติการ

สำนักบริหารและรับรองห้องปฏิบัติการ กรมวิทยาศาสตร์บริการ
กระทรวงการอุดมศึกษา วิทยาศาสตร์ วิจัยและนวัตกรรม

ขอบข่ายการรับรองความสามารถห้องปฏิบัติการทดสอบ

ชื่อห้องปฏิบัติการ : ห้องปฏิบัติการวิเคราะห์ บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด

สถานที่ตั้ง : เลขที่ 63/13 ซอยเพชรเกษม 7 แขวงวัดท่าพระ
เขตบางกอกใหญ่ กรุงเทพมหานคร 10600

หมายเลขการรับรองระบบงานที่ : ทดสอบ - 0334

สถานะของห้องปฏิบัติการ : ☑ ถาวร ☐ นอกสถานที่ ☐ ชั่วคราว ☐ เคลื่อนที่

ลำดับที่	วัสดุ / ผลิตภัณฑ์ที่ทดสอบ	รายการที่ทดสอบ / ช่วงของการทดสอบ	วิธีทดสอบ / เทคนิคที่ใช้
2	น้ำเสีย	- ความเป็นกรด-ด่าง 4.0 ถึง 10.0	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023, part 4500-H^+ B
		- สารแขวนลอยทั้งหมด ที่อุณหภูมิ 103 °C ถึง 105 °C 10 mg/L ถึง 2 000 mg/L	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023, part 2540 D
		- สารที่ละลายได้ทั้งหมด ที่อุณหภูมิ 180 °C 100 mg/L ถึง 5 000 mg/L	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023, part 2540 C

ออกให้ ณ วันที่ : 10 มกราคม 2568

ลงชื่อ : [redacted]

ผู้อำนวยการสำนักบริหารและรับรองห้องปฏิบัติการ

ออกครั้งแรก ณ วันที่ 10 มกราคม 2568 ฉบับที่ 1

ขอบข่ายการรับรองความสามารถห้องปฏิบัติการทดสอบ

ชื่อห้องปฏิบัติการ : ห้องปฏิบัติการวิเคราะห์ บริษัท โอกลา เทสติ้ง แอนด์ คอนซัลติ้ง เซอร์วิส จำกัด

สถานที่ตั้ง : เลขที่ 63/13 ซอยเพชรเกษม 7 แขวงวัดท่าพระ
เขตบางกอกใหญ่ กรุงเทพมหานคร 10600

หมายเลขการรับรองระบบงานที่ : ทดสอบ - 0334

สถานะของห้องปฏิบัติการ : ☑ ถาวร ☐ นอกสถานที่ ☐ ชั่วคราว ☐ เคลื่อนที่

ลำดับที่	วัสดุ / ผลิตภัณฑ์ที่ทดสอบ	รายการที่ทดสอบ / ช่วงของการทดสอบ	วิธีทดสอบ / เทคนิคที่ใช้
1	น้ำ	- ความเป็นกรด-ด่าง 6.0 ถึง 9.0	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023, part 4500-H^+ B
		- สารแขวนลอยทั้งหมด ที่อุณหภูมิ 103 °C ถึง 105 °C 10 mg/L ถึง 2 000 mg/L	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023, part 2540 D
		- สารที่ละลายได้ทั้งหมด ที่อุณหภูมิ 180 °C 100 mg/L ถึง 5 000 mg/L	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24th ed., 2023, part 2540 C

ออกครั้งแรก ณ วันที่ 10 มกราคม 2568 ฉบับที่ 1

JIRANATEE ASSOCIATES CO.,LTD.

Jiranatee Associates Co.,Ltd
63/14-15, 67/35-36
Petchkasem 7,7/1, Rd. Watthapra, Bangkokyai,
Bangkok 10600 (Thailand)
Tel: +6608680812
Mobile: +66863999453
E-mail: jnac-calibration@jiranatee.com
Web site: www.jiranatee.com

Accredited calibration laboratory
ISO/IEC 17025:2017
NSC-TISI-TIS 17025
CALIBRATION 0367

Temperature measurement laboratory
Calibration services department.

NSC – TISI – TIS 17025
CALIBRATION 0367

CERTIFICATE OF CALIBRATION

Certificate No. : **CDT-033-69**

MEASUREMENT ITEM	: Digital thermometer with sensor
MANUFACTURER	: Digicon
MODEL/TYPE	: DP-72
SERIAL NUMBER	: 425066647
ID NUMBER	: -
CONDITION AS-RECEIVED	: Used item
CUSTOMER	: OKLA Testing and Consulting Service Co., Ltd. 67/35-36 Floor 3, Soi Petchakasem 7/1, Petchakasem Rd, Watthapra, Bangkokyai, Bangkok 10600
RECEIVED DATE	: 19 Jan 2026
MEASUREMENT DATE	: 28-29 Jan 2026
ISSUE DATE	: 30 Jan 2026

ENVIRONMENTAL CONDITIONS:
Ambient condition in the laboratory are as follow:

Temperature	: 23.0 ± 3.0	°C
Relative Humidity	: 55.0 ± 15.0	%RH

NOTED: *The certificate is valid only to the item calibrated on date and place of calibration.*

TABULATION OF RESULTS:
The table on next page give the measured values.

Calibration procedure:
The temperature calibration was done by In-House calibration method as WI-CL-001 according to comparison method with standard digital temperature indicator and standard temperature probe. The temperature scale use was based on ITS-90.

Traceability:
The measurement results are traceable to the international system of units (SI) through National Institute of Metrology Thailand (NIMT) Certificate number: TT-1013-25, Certificate number: ER-0061-25.

Reference Used During Calibration:
1. Standard Temperature Probe
Model: STS-100 A500, Serial No.: 667682-09, Due date: 9 Apr 2026
2. Digital Temperature Indicator
Model: DTI-1000-A MK II, Serial No.: 671407-00591 Due date: 22 Apr 2026

Uncertainty of Measurement:
The reported uncertainty of measurement is based on the standard uncertainty multiplied by a coverage factor k=2, Which for a normal distribution corresponds to a coverage probability of approximately 95%. The standard uncertainty has been determined in accordance with the GUM 'Evaluation of measurement data - Guide to the expression of uncertainty in measurement'

Calibrated by:
☐ Mr. Sorawit Thachalad
☑ Miss Jittraporn Lertsomphol
☐ Miss Ruangrumpai Phoommit

JNAC JIRANATEE ASSOCIATES CO.,LTD.

Approved signatory:

Jiranatee Associates Co., Ltd.

THIS CERTIFICATE OF CALIBRATION MAY NOT BE REPRODUCED EXCEPT IN FULL UNLESS PERMISSION FOR REPRODUCTION HAS BEEN OBTAINED IN WRITING FROM THE LABORATORY

JIRANATEE ASSOCIATES CO.,LTD.

Continuation of Certificate of Calibration Number CDT-033-69

Result of Calibration: ☑ Without Adjustment ☐ With Adjustment

Calibration Range: 4 ˚C to 180 ˚C

Function:

Table 1: This equipment was connected with Thermocouple Type K Model: TP-01 S/N: 1280000607. Dimension: Diameter 1.50 mm. Length 1000 mm.

Immersion Depth (mm)	Standard Reading (˚C)	UUC Reading (˚C)	Error (˚C)	Uncertainty (˚C)
70	4.085	4.0	-0.1	0.26
70	20.058	19.9	-0.1	0.26
70	79.924	79.9	0.0	0.38
70	103.983	104.6	0.6	0.54
70	149.951	150.7	0.7	0.54
70	179.931	180.3	0.3	0.74

UUC*: Unit Under Calibration

*****End of Certificate of Calibration*****

JIRANATEE ASSOCIATES CO.,LTD.

Jiranatee Associates Co.,Ltd.

Hanna Instruments (Thailand) Ltd.

410/67-68 Soi Ratchadapisek 24, Ratchadapisek Rd., Samsen-nok,

Huaykwang, Bangkok 10310 Tel: 0-2541-4199 Fax: 0-2541-4198

ANSI National Accreditation Board ACCREDITED ISO/IEC 17025 CALIBRATION LABORATORY AC-3061

Certificate No. : C26020021

CERTIFICATE OF CALIBRATION

Equipment	:	pH/ORP and EC/TDS/Salinity/Resistivity		
Meter Model	:	HI5521-02	**Serial No.**	: 04160019101
Probe Model	:	HI7662-W	**Serial No.**	: 0615024N
Resolution	:	0.1 °C	**Temperature Range**	: (-20 to 120)°C
Manufacturer	:	Hanna Instruments	**Made in**	: Romania
Condition As-Received	:	Used Product	**Reference**	: RE260170
Ambient Temperature	:	(25 ± 2)°C	**Relative Humidity**	: (50 ± 15)%RH
Customer name	:	Okla Testing & Consulting Service Co., Ltd. 67/35-36, 3RD Floor, Phetkasem 7/1 Road, Wat Tha Pra, Bangkok Yai, Bangkok 10600 Thailand		
Received date	:	30 January 2026		
Calibrate date	:	4 February 2026		
Issue date	:	6 February 2026		
Calibrated Location	:	Hanna Instruments (Thailand) Ltd.		
Calibration Method	:	This calibrator was conducted by using in-house: calibration procedure CP-05 by using reference standard instruments.		

Calibrated by : Mr. Pichit Petthong

Approved by :

Authorized Signatory

Instruments (Thailand) Limited

This certificate was certified only for the instrument we calibrated. This result of calibration was found accurate on date and place of calibration only.

This certificate may not be reproduced other than in full, except with the prior written approval of the head of Hanna Instrument (Thailand) Ltd.

Condition of this calibration result :

1. Reference standard instrument : This certificate is traceable to the international system of units (SI Units)

Instrument	Model	Serial No.	Certificate No.	Traceable
Digital Thermo-Hygrometer	HT-771SD	AI.07155	26H106	Technology Promotion Association (Thailand-Japan)
Temperature Block Calibrator	CTC-155A	723705-01938	T26-0057	Unithai Group Co.,Ltd.

Calibration Result :

Function : Temperature Measurement

This equipment was connected with Temperature Sensor.

Nominal Value (°C)	Standard Setting (°C)	UUC Reading (°C)	Error (°C)	Uncertainty (± °C)
20	20.00	20.0	0.00	0.18
25	25.00	25.0	0.00	0.18
30	30.00	30.0	0.00	0.18

The report uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor *k=2* , providing a level of confidence of approximately 95%

** End of certificate **

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ilac-MRA ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Certificate of Calibration

Certificate No. : MT26-1559
Page : 1 of 2

Customer : OKLA Testing & Consulting Service Co.,Ltd.
Address : 67/35-36 3 Rd Floor, Soi Petchkasem 7/1, Thapra, Bangkok Yai, Bangkok 10600

Description : Refrigerator
Manufacturer : Sanden
Model : SPB0500
Serial No. : SPB0500-231007454
Identification No. : N/A
Calibration Place : Laboratory

Order No. : 0336/26
Received date : Jan 29, 2026
Calibration date : Jan 29, 2026
Environment Condition :
Temperature : (25+/-10) °C
Humidity : (50+/-30) %RH

Calibration Method : Calibration were conducted using In-house calibration procedure *CP-MT-006* According to comparison with LXI Data Acquisition Switch Unit with sensor. The calibration methods based on Euramet Calibration Guide No.20 - guidelines on the Calibration of Temperature and/or Humidity Controlled Enclosures.

Reference Standard Instruments :

Instrument	Model	Serial No.	Certificate No.	Due Date
LXI Data Acquisition Switch Unit with Sensor	34972A	MY57003222	MT25-5590	Jul 23, 2026

The effect that the result relate only to the items calibrated. It was found accurate as shown on date and place of calibration only.

Traceability : This measurement are traceable to the International System of Unit (SI), through National Institute of Metrology Thailand (NIMT)

The reported expanded uncertainty of measurement was based on standard uncertainty multiplied by coverage factor (k) = 2, providing a level of confidence of not less than 95%

CALIBRATION LABORATORY IMC INCTECH METROLOGICAL CENTER CO.,LTD.

Calibrated by : Mr.Kriengkrai Jomthaisong

Approved by :

Issue date :

This calibration certificate shall not be reproduced other than in full except with the prior written approval of Inctech Metrological Center Co.,Ltd


Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Function : Temperature measurement
Calibration point : 4 °C
Result : Without adjustment
Resolution : 1 °C

Calibration point	Temperature of UUC* at each position (°C)									Uncertainty of measurement
(°C)	Ch.1	Ch.2	Ch.3	Ch.4	Ch.5	Ch.6	Ch.7	Ch.8	Ch.9	(+/- °C)
4	4.756	5.042	4.964	4.852	4.949	4.889	4.954	4.858	4.816	0.66

Setting temperature (°C)	Indicating Temperature (°C)	Measured stability (+/- °C)	Measured uniformity (°C)	Overall variation (°C)
4.0	4.8 to 4.9	0.21	0.36	0.54

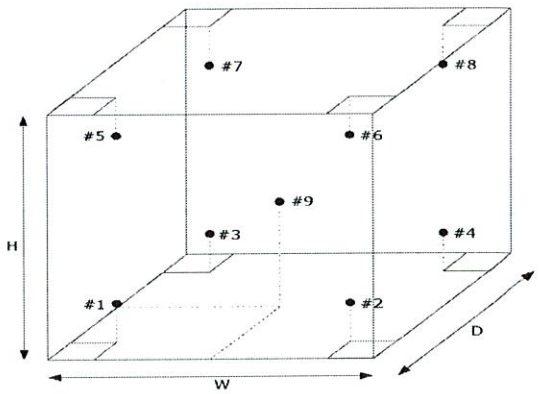

#1 Lower Left Front
#2 Lower Right Front
#3 Lower Left Rear
#4 Lower Right Rear
#5 Upper Left Front
#6 Upper Right Front
#7 Upper Left Rear
#8 Upper Right Rear
#9 Geometric Center

Front view

UUC* = Unit under calibration
Uniformity = Maximum and Minimum difference of measured temperature at any probes and the measured temperature at the reference and same time.
Overall Variation = Difference of temperature value between the maximum and minimum any time.
Stability = One half of the maximum difference of measured temperatures at any one probe.

-oOo-

Hanna Instruments (Thailand) Ltd.

410/67-68 Soi Ratchadapisek 24, Ratchadapisek Rd., Samsen-nok,

Huaykwang, Bangkok 10310 Tel: 0-2541-4199 Fax: 0-2541-4198

ANSI National Accreditation Board ACCREDITED ISO/IEC 17025 CALIBRATION LABORATORY AC-3061

Certificate No. : C26020019

CERTIFICATE OF CALIBRATION

Equipment	:	pH/ORP and EC/TDS/Salinity/Resistivity Meter		
Meter Model	:	HI5521-02	**Serial No.**	: 04160019101
Probe Model	:	HI1131B	**Serial No.**	: 11271C0N
Resolution (pH)	:	0.01 pH	**Resolution (mV)**	: 0.1 mV
Manufacturer	:	Hanna Instruments	**Made in**	: Romania
Condition As-Received	:	Used Product	**Reference**	: RE260169
Ambient Temperature	:	(25 ± 2)°C	**Relative Humidity**	: (50 ± 15)%RH
Customer name	:	Okla Testing & Consulting Service Co., Ltd. 67/35-36, 3RD Floor, Phetkasem 7/1 Road, Wat Tha Pra, Bangkok Yai, Bangkok 10600 Thailand		
Received date	:	30 January 2026		
Calibrate date	:	4 February 2026		
Issue date	:	6 February 2026		
Calibrated Location	:	Hanna Instruments (Thailand) Ltd.		
Calibration Method	:	This calibrator was conducted by using in-house: calibration procedure CP-01, CP-02 by using standard voltage calibrator and certified reference material (CRM).		

Calibrated by : Mr. Pichit Petthong

Approved by :

HANNA Instruments (Thailand) Limited

This certificate was certified only for the instrument we calibrated. This result of calibration was found accurate on date and place of calibration only.

This certificate may not be reproduced other than in full, except with the prior written approval of the head of Hanna Instrument (Thailand) Ltd.

Condition of this calibration result :

1. Reference standard instrument : This certificate is traceable to the international system of units (SI Units)

Instrument	Model	Serial No.	Certificate No.	Traceable
Thermometer with sensor	HI98509	39643D	25T1021	Technology Promotion Association (Thailand-Japan)
Digital Thermo-Hygrometer	HT-771SD	AI.07155	26H106	
Documenting Process Calibrator	Fluke 753	43160061	25E2838	

2. Reference Standard Materials: This certificate is traceable to the international system of units (SI Units)

Buffer Solution	Manufacture	Certified Value	Lot Number	Exp. date
pH 4.0	CPA chem Ltd.	4.007 ± 0.006@25°C	1086537	26 April 2026
pH 7.0	CPA chem Ltd.	6.988 ± 0.007@25°C	1138616	28 August 2026
pH 10.0	CPA chem Ltd.	10.011 ± 0.008@25°C	1086538	26 April 2026

Calibration Result :

1. Electrical Potential (without electrode) - DC Voltage measurement

Performing standard curve by Simulator at: (-177.5, 0.0, 177.5) mV

Unit Under Calibration	Nominal Value	Standard Voltage Input	Average Reading		Uncertainty
	(pH)	(mV)	(mV)	(pH)	(± mV)
Meter S/N: 04160019101	4.01	177.50	177.5	4.01	0.097
	7.01	0.00	0.0	7.01	0.058
	10.01	-177.50	-177.5	10.01	0.097

2. Performance of electrode system (with electrode)

Performing standard curve by using buffer nominal : pH (4,7,10)

Unit Under Calibration	Standard pH Buffer Solution	Average Reading		Error	Uncertainty
		(pH)	(mV)	(pH)	(± pH)
Electrode S/N: 11271C0N	4.007	4.00	165.5	-0.007	0.011
	6.988	6.98	-2.8	-0.008	0.010
	10.011	10.01	-166.1	-0.001	0.014

The report uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor *k=2* , providing a level of confidence of approximately 95%

** End of certificate **

Hanna Instruments (Thailand) Ltd.

410/67-68 Soi Ratchadapisek 24, Ratchadapisek Rd., Samsen-nok,

Huaykwang, Bangkok 10310 Tel: 0-2541-4199 Fax: 0-2541-4198

ANSI National Accreditation Board ACCREDITED ISO/IEC 17025 CALIBRATION LABORATORY AC-3061

Certificate No. : C26020020

CERTIFICATE OF CALIBRATION

Equipment	:	pH/ORP and EC/TDS/Salinity/Resistivity Meter		
Meter Model	:	HI5521-02	**Serial No.**	: 04160019101
Probe Model	:	HI76312	**Serial No.**	: 0614117M
Resolution (EC)	:	0.01 µS/cm	**Resolution (EC)**	: 0.001 mS/cm
Manufacturer	:	Hanna Instruments	**Made in**	: Romania
Condition As-Received	:	Used Product	**Reference**	: RE260169
Ambient Temperature	:	(25 ± 2)°C	**Relative Humidity**	: (50 ± 15)%RH
Customer name	:	Okla Testing & Consulting Service Co., Ltd. 67/35-36, 3RD Floor, Phetkasem 7/1 Road, Wat Tha Pra, Bangkok Yai, Bangkok 10600 Thailand		
Received date	:	30 January 2026		
Calibrate date	:	16 February 2026		
Issue date	:	17 February 2026		
Calibrated Location	:	Hanna Instruments (Thailand) Ltd.		
Calibration Method	:	This calibrator was conducted by using in-house: calibration procedure CP-03 by using certified reference material (CRM).		

Calibrated by : Mr. Pichit Petthong

Approved by :

Authorized Signatory

HANNA Instruments (Thailand) Limited

This certificate was certified only for the instrument we calibrated. This result of calibration was found accurate on date and place of calibration only.

This certificate may not be reproduced other than in full, except with the prior written approval of the head of Hanna Instrument (Thailand) Ltd.

Condition of this calibration result :

1. Reference standard instrument : This certificate is traceable to the international system of units (SI Units)

Instrument	Model	Serial No.	Certificate No.	Traceable
Thermometer with sensor	HI98509	39643D	25T1021	Technology Promotion Association (Thailand-Japan)
Digital Thermo-Hygrometer	HT-771SD	AI.07155	26H106	

2. Reference Standard Materials: This certificate is traceable to the international system of units (SI Units)

Buffer Solution	Manufacture	Certified Value	Lot Number	Exp. date
84 µS/cm	CPA chem Ltd.	84.003 ± 0.534@25°C	1086539	26 April 2026
1.413 mS/cm	CPA chem Ltd.	1.413 ± 0.0082@25°C	1086540	26 April 2026

Calibration Result :

Inspection the accuracy of the EC Meter by using the following certified reference material values.

Calibration result after adjustment at : 84 µS/cm, 1.413 mS/cm

Standard EC Buffer Solution		Unit Under Calibration Reading				Error		Uncertainty (±)	
		Before Adjustment		After Adjustment					
84.003	µS/cm	68.15	µS/cm	85.68	µS/cm	1.677	µS/cm	0.71	µS/cm
1.413	mS/cm	1.241	mS/cm	1.426	mS/cm	0.013	mS/cm	0.011	mS/cm

The report uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor *k=2* , providing a level of confidence of approximately 95%

** End of certificate **

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Certificate of Calibration

Certificate No. : MT26-1556
Page : 1 of 2

Customer : OKLA Testing & Consulting Service Co.,Ltd.
Address : 67/35-36 3 Rd Floor, Soi Petchkasem 7/1, Thapra, Bangkok Yai, Bangkok 10600

Description : Incubator
Manufacturer : ศรีอมร
Model : SM61M
Serial No. : 18021147
Identification No. : N/A
Calibration Place : Laboratory

Order No. : 0336/26
Received date : Jan 29, 2026
Calibration date : Jan 29, 2026
Environment Condition :
Temperature : (25+/-10) °C
Humidity : (50+/-30) %RH

Calibration Method : Calibration were conducted using In-house calibration procedure *CP-MT-006* According to comparison with LXI Data Acquisition Switch Unit with sensor. The calibration methods based on Euramet Calibration Guide No.20 - guidelines on the Calibration of Temperature and/or Humidity Controlled Enclosures.

Reference Standard Instruments :

Instrument	Model	Serial No.	Certificate No.	Due Date
LXI Data Acquisition Switch Unit with Sensor	34972A	MY57003222	MT25-5590	Jul 23, 2026

The effect that the result relate only to the items calibrated. It was found accurate as shown on date and place of calibration only.

Traceability : This measurement are traceable to the International System of Unit (SI), through National Institute of Metrology Thailand (NIMT)

The reported expanded uncertainty of measurement was based on standard uncertainty multiplied by coverage factor k = 2, providing a level of confidence of not less than 95%

CALIBRATION LABORATORY IMC INCTECH METROLOGICAL CENTER CO.,LTD.

Calibrated by : Mr.Kriengkrai Jomthaisong

Approved b

Issue dat

This calibration certificate shall not be reproduced other than in full except with the prior written approval of Inctech Metrological Center Co.,Ltd


Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Function : Temperature measurement
Calibration point : 20 °C
Result : Without adjustment
Resolution : 0.1 °C

Calibration point (°C)	Temperature of UUC* at each position (°C)									Uncertainty of measurement (+/- °C)
	Ch.1	Ch.2	Ch.3	Ch.4	Ch.5	Ch.6	Ch.7	Ch.8	Ch.9	
20	20.295	20.568	20.013	19.730	19.837	19.932	19.780	19.498	19.791	0.45

Setting temperature (°C)	Indicating Temperature (°C)	Measured stability (+/- °C)	Measured uniformity (°C)	Overall variation (°C)
20.0	20.0	0.32	0.90	1.7

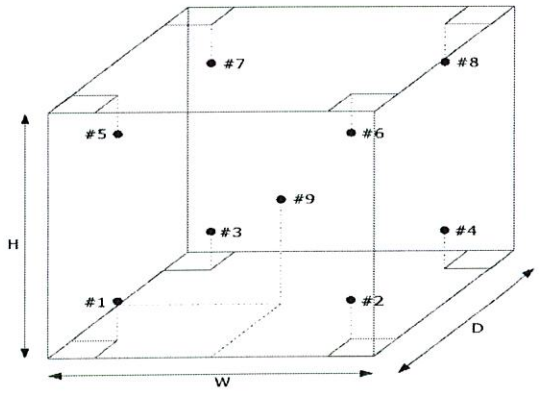

#1 Lower Left Front
#2 Lower Right Front
#3 Lower Left Rear
#4 Lower Right Rear
#5 Upper Left Front
#6 Upper Right Front
#7 Upper Left Rear
#8 Upper Right Rear
#9 Geometric Center

Front view

UUC* = Unit under calibration
Uniformity = Maximum and Minimum difference of measured temperature at any probes and the measured temperature at the reference and same time.
Overall Variation = Difference of temperature value between the maximum and minimum any time.
Stability = One half of the maximum difference of measured temperatures at any one probe.

-oOo-

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ilac-MRA A2LA ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Certificate of Calibration

Certificate No. : MT26-1558
Page : 1 of 2

Customer : OKLA Testing & Consulting Service Co.,Ltd.
Address : 67/35-36 3 Rd Floor, Soi Petchkasem 7/1, Thapra, Bangkok Yai, Bangkok 10600

Description : Hot Air Oven
Manufacturer : Labtech
Model : LDO-060E
Serial No. : DLCCCL0513C
Identification No. : N/A
Calibration Place : Laboratory

Order No. : 0336/26
Received date : Jan 29, 2026
Calibration date : Jan 29, 2026
Environment Condition :
Temperature : (25+/-10) °C
Humidity : (50+/-30) %RH

Calibration Method : Calibration were conducted using In-house calibration procedure *CP-MT-006* According to comparison with LXI Data Acquisition Switch Unit with sensor. The calibration methods based on Euramet Calibration Guide No.20 - guidelines on the Calibration of Temperature and/or Humidity Controlled Enclosures.

Reference Standard Instruments :

Instrument	Model	Serial No.	Certificate No.	Due Date
LXI Data Acquisition Switch Unit with Sensor	34972A	MY57003222	MT25-5590	Jul 23, 2026

The effect that the result relate only to the items calibrated. It was found accurate as shown on date and place of calibration only.

Traceability : This measurement are traceable to the International System of Unit (SI), through National Institute of Metrology Thailand (NIMT)

The reported expanded uncertainty of measurement was based on standard uncertainty multiplied by coverage factor (k) = 2, providing a level of confidence of not less than 95%

CALIBRATION LABORATORY IMC INCTECH METROLOGICAL CENTER CO.,LTD.

Calibrated by : Mr.Kriengkrai Jomthaisong

Approved

Issue d

This calibration certificate shall not be reproduced other than in full except with the prior written approval of Inctech Metrological Center Co.,Ltd


Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Function : Temperature measurement
Calibration point : 140, 160 °C
Result : Without adjustment
Resolution : 1 °C

Calibration point	Temperature of UUC* at each position (°C)									Uncertainty of measurement
(°C)	Ch.1	Ch.2	Ch.3	Ch.4	Ch.5	Ch.6	Ch.7	Ch.8	Ch.9	(+/- °C)
140	141.785	141.603	141.640	141.457	141.689	142.147	141.509	141.574	141.364	3.2
160	161.388	161.667	161.517	161.509	161.431	161.453	161.694	161.753	161.512	2.7

Setting temperature (°C)	Indicating Temperature (°C)	Measured stability (+/- °C)	Measured uniformity (°C)	Overall variation (°C)
140	140	2.7	2.2	5.4
160	160	2.2	2.2	4.9

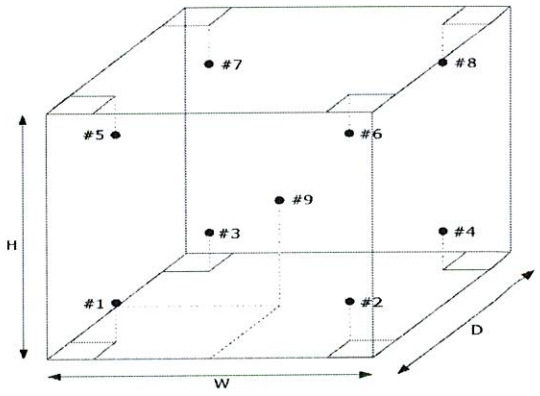

#1 Lower Left Front
#2 Lower Right Front
#3 Lower Left Rear
#4 Lower Right Rear
#5 Upper Left Front
#6 Upper Right Front
#7 Upper Left Rear
#8 Upper Right Rear
#9 Geometric Center

Front view

UUC* = Unit under calibration
Uniformity = Maximum and Minimum difference of measured temperature at any probes and the measured temperature at the reference and same time.
Overall Variation = Difference of temperature value between the maximum and minimum any time.
Stability = One half of the maximum difference of measured temperatures at any one probe.

-oOo-

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Certificate of Calibration

Certificate No. : MT26-1557
Page : 1 of 2

Customer : OKLA Testing & Consulting Service Co.,Ltd.
Address : 67/35-36 3 Rd Floor, Soi Petchkasem 7/1, Thapra, Bangkok Yai, Bangkok 10600

Description : Hot Air Oven
Manufacturer : KWF
Model : SOV70B
Serial No. : KWF2021021902
Identification No. : N/A
Calibration Place : Laboratory

Order No. : 0336/26
Received date : Jan 29, 2026
Calibration date : Jan 29, 2026
Environment Condition :
Temperature : (25+/-10) °C
Humidity : (50+/-30) %RH

Calibration Method : Calibration were conducted using In-house calibration procedure *CP-MT-006* According to comparison with LXI Data Acquisition Switch Unit with sensor. The calibration methods based on Euramet Calibration Guide No.20 - guidelines on the Calibration of Temperature and/or Humidity Controlled Enclosures.

Reference Standard Instruments :

Instrument	Model	Serial No.	Certificate No.	Due Date
LXI Data Acquisition Switch Unit with Sensor	34972A	MY57003222	MT25-5590	Jul 23, 2026

The effect that the result relate only to the items calibrated. It was found accurate as shown on date and place of calibration only.

Traceability : This measurement are traceable to the International System of Unit (SI), through National Institute of Metrology Thailand (NIMT)

The reported expanded uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of not less than 95%

CALIBRATION LABORATORY IMC INCTECH METROLOGICAL CENTER CO.,LTD.

Calibrated by : Mr.Kriengkrai Jomthaisong

Approved

Issue da

This calibration certificate shall not be reproduced other than in full except with the prior written approval of Inctech Metrological Center Co.,Ltd


Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Function : Temperature measurement
Calibration point : 80, 104, 180 °C
Result : Without adjustment
Resolution : 0.1 °C

Calibration point (°C)	Temperature of UUC* at each position (°C)									Uncertainty of measurement (+/- °C)
	Ch.1	Ch.2	Ch.3	Ch.4	Ch.5	Ch.6	Ch.7	Ch.8	Ch.9	
80	80.277	80.877	79.915	80.312	80.617	80.154	79.991	80.587	80.074	0.51
104	104.268	104.528	104.228	104.120	104.485	104.519	104.304	104.664	104.154	0.71
180	180.400	180.880	180.314	180.356	180.450	180.243	180.266	180.540	180.400	1.3

Setting temperature (°C)	Indicating Temperature (°C)	Measured stability (+/- °C)	Measured uniformity (°C)	Overall variation (°C)
80.0	79.9 to 80.1	0.35	1.1	1.5
104.0	104.0 to 104.2	0.56	0.81	1.5
180.0	180.0 to 180.2	1.1	1.2	2.1

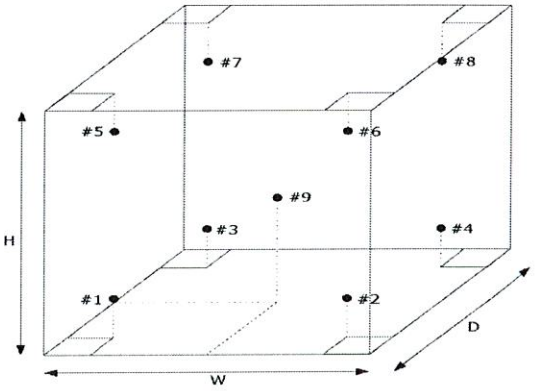

#1 Lower Left Front
#2 Lower Right Front
#3 Lower Left Rear
#4 Lower Right Rear
#5 Upper Left Front
#6 Upper Right Front
#7 Upper Left Rear
#8 Upper Right Rear
#9 Geometric Center

Front view

UUC* = Unit under calibration
Uniformity = Maximum and Minimum difference of measured temperature at any probes and the measured temperature at the reference and same time.
Overall Variation = Difference of temperature value between the maximum and minimum any time.
Stability = One half of the maximum difference of measured temperatures at any one probe.

-oOo-

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ilac-MRA ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Certificate of Calibration

Certificate No. : MM26-1194
Page : 1 of 3

Customer : Okla Testing & Consulting Service Co.,Ltd.
Address : 67/35-36 3 rd Floor, Soi Petchkasem 7/1, Thapra, Bangkok Yai, Bangkok 10600

Description : Electronic Balance
Manufacturer : Sartorius
Model : BSA224S-CW
Serial No. : 35790699
Identification No. : N/A
Calibration Place : Balance Room

Order No. : 0336/26
Received date : Jan 29, 2026
Calibration date : Jan 29, 2026
Environment Condition :
Temperature : (25+/-10) °C
Humidity : (50+/-30) %RH
Atm. Pressure : (1010+/-10) hPa

Calibration Method : Calibration were conducted using In-house calibration procedure *CP-MM-001*
According to comparison with Standard Weight Set E1.
The calibration methods based on UKAS - LAB 14 : 2022

Reference Standard Instruments :

Instrument	Model	Serial No.	Certificate No.	Due Date
Standard Weight Set	NC-001-0.2K-E1-ASS	0022	PL-512	Oct 10, 2026

The effect that the result relate only to the items calibrated. If was found accurate as shown on date and place of calibration only.

Traceability : This measurement are traceable to the International System of Unit (SI), through National Institute of Metrology Thailand (NIMT)

The reported expanded uncertainty of measurement was based on standard uncertainty multiplied by coverage factor k = 2, providing a level of confidence of not less than 95%

Calibrated by : Mr.Porntep Homchuay

Approved by

Issue date : Feb 02, 2026

This calibration certificate shall not be reproduced other than in full except with the prior written approval of Inctech Metrological Center Co.,Ltd


Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025


Calibration Result : Without Adjustment
Function : Repeatability
Maximum Capacity : 200 g
Resolution : 0.0001 g

Nominal Weight Value (g)	Instrument Deviation of Reading (g)
200	0.0000

Calibration Result : Without Adjustment
Function : Effect of Off Center Loading



Front
(X)



Front
( )

A Mass of 100 Was Placed to various Position on the pan.
The Weight Machine Reading Obtained is Given in The Tabel

Load	Measuring Positions						Maximum Different
	A	B	C	D	E	A	
(g)	(g)	(g)	(g)	(g)	(g)	(g)	(g)
100	99.9996	99.9995	99.9996	99.9996	99.9997	99.9996	0.0002

Calibration Result : Without Adjustment
Function : Effect of Tare

Nominal Tare Weight (g)	Standard Weight (g)		UUC* Reading (g)	UUC* Deviation (g)
	Tare		0.0000	0.0000
	At 20 %	20	19.9998	0.0002
	At 40 %	40	39.9998	0.0002
100	At 60 %	60	59.9997	0.0003
	At 80 %	80	79.9997	0.0003
	At 100 %	100	99.9996	0.0004

UUC* = Unit Under Calibration

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Calibration Result : Before Adjustment
Function : Departure of indication from nominal value

Standard Weight Value (g)	UUC* Reading (g)	UUC* Correction (g)	Uncertainty of Measurement (+/- g)
0.00000	0.0000	0.00000	0.000058
0.01000	0.0099	0.00010	0.000058
0.05000	0.0499	0.00007	0.000058
0.10000	0.1001	-0.00014	0.000058
0.20000	0.2001	-0.00014	0.000059
0.50000	0.5000	-0.00003	0.000059
1.00000	1.0000	-0.00003	0.000059
10.00001	10.0000	-0.00003	0.000064
49.99999	49.9998	0.00022	0.000090
99.99998	99.9996	0.00041	0.00014
149.99997	149.9991	0.00083	0.00027
199.99996	199.9991	0.00083	0.00027

UUC* = Unit Under Calibration

Calibration Result : After Adjustment

Standard Weight Value (g)	UUC* Reading (g)	UUC* Correction (g)	Uncertainty of Measurement (+/- g)
0.00000	0.0000	0.00000	0.000058
0.01000	0.0100	-0.00003	0.000058
0.05000	0.0500	0.00000	0.000058
0.10000	0.1000	0.00000	0.000058
0.20000	0.2000	-0.00003	0.000059
0.50000	0.5000	0.00000	0.000059
1.00000	1.0000	-0.00003	0.000059
10.00001	10.0000	-0.00001	0.000064
49.99999	50.0000	-0.00002	0.000090
99.99998	100.0000	0.00002	0.00014
149.99997	150.0000	0.00000	0.00027
199.99996	200.0000	0.00004	0.00027

UUC* = Unit Under Calibration

-oOo-

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ilac-MRA A2LA ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Certificate of Calibration

Certificate No. : MM26-1195
Page : 1 of 3

Customer : Okla Testing & Consulting Service Co.,Ltd.
Address : 67/35-36 3 rd Floor, Soi Petchkasem 7/1, Thapra, Bangkok Yai, Bangkok 10600

Description : Electronic Balance
Manufacturer : Mettler Toledo
Model : PL6001-S
Serial No. : 1230510473
Identification No. : N/A
Calibration Place : Balance Room

Order No. : 0336/26
Received date : Jan 29, 2026
Calibration date : Jan 29, 2026
Environment Condition :
Temperature : (25+/-10) °C
Humidity : (50+/-30) %RH
Atm. Pressure : (1010+/-10) hPa

Calibration Method : Calibration were conducted using In-house calibration procedure *CP-MM-001*
According to comparison with Standard Weight Set.
The calibration methods based on UKAS - LAB 14 : 2022

Reference Standard Instruments :

Instrument	Model	Serial No.	Certificate No.	Due Date
Standard Weight Set	50 mg - 2 kg	N/A	MM25-1949	May 22, 2026

The effect that the result relate only to the items calibrated. If was found accurate as shown on date and place of calibration only.

Traceability : This measurement are traceable to the International System of Unit (SI), through National Institute of Metrology Thailand (NIMT)

The reported expanded uncertainty of measurement was based on standard uncertainty multiplied by coverage factor k = 2, providing a level of confidence of not less than 95%

CALIBRATION LABORATORY

Calibrated by : Mr.Porntep Homchuay
Approved by :
Issue date : Feb 02, 2026

This calibration certificate shall not be reproduced other than in full except with the prior written approval of Inctech Metrological Center Co.,Ltd


Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025


Calibration Result : Without Adjustment
Function : Repeatability
Maximum Capacity : 6000 g
Resolution : 0.1 g

Nominal Weight Value (g)	Instrument Deviation of Reading (g)
6000	0.0

Calibration Result : Without Adjustment
Function : Effect of Off Center Loading



Front
(X)



Front
( )

A Mass of 2000 Was Placed to various Position on the pan.
The Weight Machine Reading Obtained is Given in The Tabel

Load	Measuring Positions						Maximum Different
	A	B	C	D	E	A	
(g)	(g)	(g)	(g)	(g)	(g)	(g)	(g)
2000	2000.0	2000.0	2000.0	2000.0	2000.0	2000.0	0.0

Calibration Result : Without Adjustment
Function : Effect of Tare

Nominal Tare Weight (g)	Standard Weight (g)		UUC* Reading (g)	UUC* Deviation (g)
	Tare		0.0	0.0
	At 20 %	600	600.0	0.0
	At 40 %	1200	1200.0	0.0
3000	At 60 %	1800	1800.0	0.0
	At 80 %	2400	2400.0	0.0
	At 100 %	3000	3000.0	0.0

UUC* = Unit Under Calibration

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Calibration Resu : Without Adjustment
Function : Departure of indication from nominal value

Standard Weight Value (g)	UUC* Reading (g)	UUC* Correction (g)	Uncertainty of Measurement (+/- g)
0	0.0	0.0	0.058
600	600.0	0.0	0.058
1200	1200.0	0.0	0.058
1800	1800.0	0.0	0.058
2400	2400.0	0.0	0.058
3000	3000.0	0.0	0.058
3600	3600.0	0.0	0.058
4200	4200.0	0.0	0.058
4800	4800.0	0.0	0.058
5400	5400.0	0.0	0.058
6000	6000.0	0.0	0.058

UUC* = Unit Under Calibration

-oOo-

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ilac-MRA ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Certificate of Calibration

Certificate No. : MM26-1196
Page : 1 of 3

Customer : Okla Testing & Consulting Service Co.,Ltd.
Address : 67/35-36 3 rd Floor, Soi Petchkasem 7/1, Thapra, Bangkok Yai, Bangkok 10600

Description : Electronic Balance
Manufacturer : Mettler Toledo
Model : PL3001-S
Serial No. : 1230040028
Identification No. : N/A
Calibration Place : Balance Room

Order No. : 0336/26
Received date : Jan 29, 2026
Calibration date : Jan 29, 2026
Environment Condition :
Temperature : (25+/-10) °C
Humidity : (50+/-30) %RH
Atm. Pressure : (1010+/-10) hPa

Calibration Method : Calibration were conducted using In-house calibration procedure *CP-MM-001*
According to comparison with Standard Weight Set.
The calibration methods based on UKAS - LAB 14 : 2022

Reference Standard Instruments :

Instrument	Model	Serial No.	Certificate No.	Due Date
Standard Weight Set	50 mg - 2 kg	N/A	MM25-1949	May 22, 2026

The effect that the result relate only to the items calibrated. If was found accurate as shown on date and place of calibration only.

Traceability : This measurement are traceable to the International System of Unit (SI), through National Institute of Metrology Thailand (NIMT)

The reported expanded uncertainty of measurement was based on standard uncertainty multiplied by coverage factor k = 2, providing a level of confidence of not less than 95%

CALIBRATION LABORATORY IMC

Calibrated by : Mr.Porntep Homchuay
Approved by :
Issue date :

This calibration certificate shall not be reproduced other than in full except with the prior written approval of Inctech Metrological Center Co.,Ltd


Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025


Calibration Result : Without Adjustment
Function : Repeatability
Maximum Capacity : 3100 g
Resolution : 0.1 g

Nominal Weight Value (g)	Instrument Deviation of Reading (g)
3000	0.0

Calibration Result : Without Adjustment
Function : Effect of Off Center Loading



Front
(X)



Front
( )

A Mass of 1000 Was Placed to various Position on the pan.
The Weight Machine Reading Obtained is Given in The Tabel

Load	Measuring Positions						Maximum Different
	A	B	C	D	E	A	
(g)	(g)	(g)	(g)	(g)	(g)	(g)	(g)
1000	999.9	999.9	999.9	999.9	999.9	999.9	0.0

Calibration Result : Without Adjustment
Function : Effect of Tare

Nominal Tare Weight (g)	Standard Weight (g)		UUC* Reading (g)	UUC* Deviation (g)
	Tare		0.0	0.0
	At 20 %	300	299.9	0.1
	At 40 %	600	599.9	0.1
1500	At 60 %	900	899.9	0.1
	At 80 %	1200	1199.9	0.1
	At 100 %	1500	1499.9	0.1

UUC* = Unit Under Calibration

Inctech Metrological Center Co.Ltd.
39/1 Soi 82, Sukhapiban 5 Rd., O ngoen,
Saimai, Bangkok 10220, Thailand
Tel. (662) 909-8820 (Auto 10 lines) www.imcinstrument.com

ACCREDITED
Calibration Cert. # 3884.01
ISO/IEC 17025

Calibration Resu : Without Adjustment
Function : Departure of indication from nominal value

Standard Weight Value (g)	UUC* Reading (g)	UUC* Correction (g)	Uncertainty of Measurement (+/- g)
0	0.0	0.0	0.058
300	299.9	0.1	0.058
600	599.9	0.1	0.058
900	899.9	0.1	0.058
1200	1199.9	0.1	0.058
1500	1499.9	0.1	0.058
1800	1799.9	0.1	0.058
2100	2099.8	0.2	0.058
2400	2399.8	0.2	0.058
2700	2699.8	0.2	0.058
3000	2999.7	0.3	0.058

UUC* = Unit Under Calibration

-oOo-

Hanna Instruments (Thailand) Ltd.

410/67-68 Soi Ratchadapisek 24, Ratchadapisek Rd., Samsen-nok,

Huaykwang, Bangkok 10310 Tel: 0-2541-4199 Fax: 0-2541-4198

ANSI National Accreditation Board ACCREDITED ISO/IEC 17025 CALIBRATION LABORATORY AC-3061

Certificate No. : C26020022

CERTIFICATE OF CALIBRATION

Equipment	:	Dissolved Oxygen and BOD Meter			
Meter Model	:	HI5421-02	**Serial No.**	:	04240005101
Probe Model	:	HI76483	**Serial No.**	:	KC1N66J5P
Manufacturer	:	Hanna Instruments	**Made in**	:	Romania
Condition As-Received	:	Used Product	**Resolution**	:	0.01 ppm (mg/L)
Ambient Temperature	:	(25 ± 2)°C	**Relative Humidity**	:	(50 ± 15)% RH
Reference	:	RE260168			
Customer name	:	Okla Testing & Consulting Service Co., Ltd. 67/35-36, 3RD Floor, Phetkasem 7/1 Road, Wat Tha Pra, Bangkok Yai, Bangkok 10600 Thailand			
Received date	:	30 January 2026			
Calibrate date	:	6 February 2026			
Issue date	:	9 February 2026			
Calibrated Location	:	Hanna Instruments (Thailand) Ltd.			
Calibration Procedure	:	This calibrator was conducted by using in-house: calibration procedure CP-11 by using certified reference material (CRM).			

Calibrated by : Mr. Pichit Petthong **Approved by :**

HANNA Instruments (Thailand) Limited

This certificate was certified only for the instrument we calibrated. This result of calibration was found accurate on date and place of calibration only.

This certificate may not be reproduced other than in full, except with the prior written approval of the head of Hanna Instrument (Thailand) Ltd.

Condition of this result of calibration :

1. Reference standard instrument : This certificate is traceable to the international system of units (SI Units)

Instrument	Model	Serial No.	Certificate No.	Traceable
Thermometer with sensor	HI98509	39643D	25T1021	Technology Promotion Association (Thailand-Japan)
Digital Thermo-Hygrometer	HT-771SD	AI.07155	26H106	

2. Reference standard materials: This certificate is traceable to the international system of units (SI Units)

Buffer Solution	Manufacture	Certified Value	Lot Number	Exp. date
Zero Oxygen Solution	Hanna Inc.	0.0 ± 0.1@25°C	S0121/25	August 2030

Calibration Result:

Dissolved Oxygen Measurement

Unit Under Calibration	Standard Buffer Solution	UUC Reading	Error	Uncertainty of Measurement (±)
DO Electrode	0.0 mg/L	0.00 mg/L	0.00 mg/L	N/A mg/L
S/N: KC1N66J5P	8.3 mg/L	8.30 mg/L	0.00 mg/L	0.33 mg/L

Remark : at 8.3 mg/L = Air Saturated.

The report uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor *k=2* , providing a level of confidence of approximately 95%

** End of certificate **

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-1** **Page : 1 of 2**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Burette
Manufacturer : ISOLAB Class : A
Capacity : 25 ml Graduation : 0.05 ml
ID No. : EM-MBR10002/17

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1010.5 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved b

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-1**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 49.07 sec.

Nominal Volume (ml)	Measuring Volume (ml)
5	4.9984
15	14.9932
25	24.9964

Uncertainty of measurement with in ± 0.0066 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-2**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Burette
Manufacturer : Witeg Class : A
Capacity : 100 ml Graduation : 0.2 ml
ID No. : EM-MBR10001/18

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1015.6 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-2**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 43.77 sec.

Nominal Volume (ml)	Measuring Volume (ml)
20	19.9961
60	59.9874
100	99.9963

Uncertainty of measurement with in ± 0.019 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-3**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Measuring Pipette
Manufacturer : GLASSCO Class : A
Capacity : 1 ml Graduation : 0.01 ml
ID No. : EM-MER01001/19

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1010.5 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by : _____

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-3**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 7.31 sec.

Nominal Volume (ml)	Measuring Volume (ml)
0.1	0.1014
0.5	0.4995
1	0.9908

Uncertainty of measurement with in ± 0.0026 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-4**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Measuring Pipette
Manufacturer : GLASSCO Class : A
Capacity : 5 ml Graduation : 0.05 ml
ID No. : EM-MER01001/18

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1010.5 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by :

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-4**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 9.39 sec.

Nominal Volume (ml)	Measuring Volume (ml)
0.5	0.5001
2.5	2.4840
5	4.9842

Uncertainty of measurement with in ± 0.0027 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-5**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Measuring Pipette
Manufacturer : GLASSCO Class : A
Capacity : 10 ml Graduation : 0.1 ml
ID No. : EM-MER01001/17

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1010.5 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by : _____

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-5**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 10.81 sec.

Nominal Volume (ml)	Measuring Volume (ml)
1	1.0008
5	4.9757
10	9.9777

Uncertainty of measurement with in ± 0.0039 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-6**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Pipette
Manufacturer : GLASSCO Class : A
Capacity : 5 ml
ID No. : EM-Mbro1051/17

Environment :

Ambient Temperature	:	(20 ± 3)	°C
Relative Humidity	:	(50 ± 10)	%
Air Pressure	:	1010.7	mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by :

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-6**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 12.56 sec.

Nominal Volume (ml)	Measuring Volume (ml)
5	4.9820

Uncertainty of measurement with in ± 0.0026 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-7**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Pipette
Manufacturer : GLASSCO Class : A
Capacity : 10 ml
ID No. : EM-Mbro1001/17

Environment :

Ambient Temperature	:	(20 ± 3)	°C
Relative Humidity	:	(50 ± 10)	%
Air Pressure	:	1010.7	mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-7**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 12.56 sec.

Nominal Volume (ml)	Measuring Volume (ml)
10	10.0044

Uncertainty of measurement with in ± 0.0038 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-8**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Pipette
Manufacturer : GLASSCO Class : A
Capacity : 20 ml
ID No. : EM-VPP20201/17

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1010.7 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-8**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 15.10 sec.

Nominal Volume (ml)	Measuring Volume (ml)
20	19.9816

Uncertainty of measurement with in ± 0.0064 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-9** **Page : 1 of 2**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Pipette
Manufacturer : BOROSIL Class : A
Capacity : 25 ml
ID No. : EM-VPP02501/17

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1010.7 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by :

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-9**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Delivery Time : 37.49 sec.

Nominal Volume (ml)	Measuring Volume (ml)
25	24.9902

Uncertainty of measurement with in ± 0.0066 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-13** **Page : 1 of 2**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Cylinder
Manufacturer : FAVORIT Class : A
Capacity : 50 ml Graduation : 1 ml
ID No. : CY50/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1011.1 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instrument : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241002	68-200620-1	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by :

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-13**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
50	50.38

Uncertainty of measurement with in ± 0.054 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-14** **Page : 1 of 2**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Cylinder
Manufacturer : DURAN Class : A
Capacity : 100 ml Graduation : 1 ml
ID No. : CY100/01

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1011.1 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instrument : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241002	68-200620-1	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved b

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-14**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
50	50.26
100	100.08

Uncertainty of measurement with in ± 0.063 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-15** **Page : 1 of 2**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Cylinder
Manufacturer : BOROSIL Class : A
Capacity : 500 ml Graduation : 5 ml
ID No. : 0334-58

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1011.1 mbar.

Date of Received : 22 January 2026
Date of Calibration : 29 January 2026
Date of Issue : 29 January 2026
Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instrument : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241002	68-200620-1	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by : [redacted]
Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-15**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
500	499.05

Uncertainty of measurement with in ± 0.12 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-10**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Flask
Manufacturer : SCI Class : A
Capacity : 100 ml
ID No. : EM-VPP02501/17

Environment :

Ambient Temperature	:	(20 ± 3)	°C
Relative Humidity	:	(50 ± 10)	%
Air Pressure	:	1011.1	mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241005	68-200260-4	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by :

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-10**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
100	99.991

Uncertainty of measurement with in ± 0.018 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-11**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Flask
Manufacturer : Borosil Class : A
Capacity : 500 ml
ID No. : EM-VPP02501/18

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1010.9 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241002	68-200620-1	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by :

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-11**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
500	499.99

Uncertainty of measurement with in ± 0.075 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

NSC-TISI-TIS17025
CALIBRATION 0030

Certificate of Calibration

Certificate No. : **69-300065-12** **Page : 1 of 2**

Submitted by : Okla Testing & Consulting Service Co.,Ltd.
67/35-36, 3rd Floor, Petchkasem 7/1, Petchkasem Rd.,
Watthapra, Bangkok Yai, Bangkok 10600 Thailand

Equipment : Volumetric Flask
Manufacturer : Borosil Class : A
Capacity : 1000 ml
ID No. : EM-VPP02501/20

Environment : Ambient Temperature : (20 ± 3) °C
Relative Humidity : (50 ± 10) %
Air Pressure : 1011.0 mbar.

Date of Received : 22 January 2026

Date of Calibration : 29 January 2026

Date of Issue : 29 January 2026

Calibrated by : Areerat Sombun

Calibration Method : In-house method CAL-M3001 based on ASTM E 542-22

Reference Standard Instruments : This certification is traceable to the International System of Units

Electronic Balance

ID No.	Cert. No.	Due Date	Traceability
241002	68-200620-1	02 Jun 2026	National Institute of Metrology (Thailand) (NIMT)

Approved by

Supervisor

The Uncertainties are for a confidence probability of approximately 95%

This cerificate may not be reproduced other than in full except with the prior written approval of the Calibratech Co.,Ltd.

CAL
Calibratech Co.,Ltd.
7/106-7 Moo 2, Sukhaprachasan 3 Rd., Bangpood, Pakkred, Nonthaburi 11120
Tel.(02) 964-6211 Fax.(02) 964-5155, e-mail : calibratech_cal@yahoo.com, calibratech_cal@hotmail.com

Certificate of Calibration

Certificate No. : **69-300065-12**

Result of Calibration : This result of true Volume is referred to standard temperature at 20 °C

UUC Condition As-Received : Good

Nominal Volume (ml)	Measuring Volume (ml)
1000	1000.00

Uncertainty of measurement with in ± 0.14 ml

This result of calibration was found accurate as shown on date and place of calibration only.

This reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k = 2.00 , providing a level of confidence of approximately 95%

- o0o -

ภาคผนวก 10

รายงานตรวจสอบสระว่ายน้ำ

Knight Frank

Swimming Pool Daily Checklist

ใบรายงานการตรวจสอบสระว่ายน้ำ

Sheet No. / แผ่นที่ 1

Month / เดือน มกราคม **Year / ปี** 2569

Building / อาคาร คีนน์ บาย แสนสิริ

Date วันที่	Time เวลา	Status Record บันทึกค่า		Adding / การเติม			Condition of Equipment / สภาพของอุปกรณ์							Recorded By บันทึกโดย	Checked By Tech. Sup. ตรวจสอบโดยหัวหน้าช่าง
							Pump Set ชุดปั๊มน้ำ		ปั๊มน้ำพุ	Pressure Tank แรงดันของถัง(.....PSI)		Filter Set ชุดไส้กรองน้ำ			
		CL. (1-1.5)	PH (7.2-7.6)	Chlorine คลอรีน (kg.)	Soda Ash โซดา-แอช (kg.)	ค่าเกลือ PPT กระสอบ	No...	No...	No...	No.....	No.....	No....	No....		
1	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
2	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
3	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
4	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
5	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
6	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
7	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
8	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
9	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
10	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
11	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
12	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
13	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
14	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
15	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
16	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
17	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
18	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
19	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
20	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
21	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
22	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
23	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
24	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
25	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
26	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
27	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
28	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
29	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
30	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
31	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
			รวม												

Remark / หมายเหตุ

Used within month / Remain (ปริมาณที่ใช้จริงในรอบเดือน / ยอดคงเหลือ)

Chlorine (คลอรีน) _____ Kg. Powder (สารกรอง) _____ Kg. / Litre Hydrochloric Acid (กรดเกลือ) _____ Kg.

Soda Ash (โซดา-แอช) _____ Kg. Sodium Bicarbonate (โซเดียมไบคาร์บอเนต) _____ Kg.

Note : Please Mark N/A if not applicable, / Normal, X Abnormal / กรุณาใส่ N/A ถ้าไม่มีข้อมูล, / ปกติ, X ไม่ปกติ

V

S)

D

F-ENG-PSW-001

Knight Frank

Swimming Pool Daily Checklist

ใบรายงานการตรวจสอบสระว่ายน้ำ

Sheet No. / แผ่นที่.1

Month / เดือน กุมภาพันธ์ Year / ปี 2569

Building / อาคาร คีนน์ บาย แสนสิริ

Date วันที่	Time เวลา	Status Record บันทึกค่า		Adding / การเติม			Condition of Equipment / สภาพของอุปกรณ์							Recorded By บันทึกโดย	Checked By Tech. Sup. ตรวจสอบโดยหัวหน้าช่าง
		CL.	PH	Chlorine คลอรีน	Soda Ash โซดา-แอช	ค่าเกลือ PPT	Pump Set ชุดปั๊มน้ำ		ปั๊มน้ำพุ	Pressure Tank แรงดันของถัง(.....PSI)		Filter Set ชุดไส้กรองน้ำ			
		(1-1.5)	(7.2-7.6)	(kg.)	(kg.)	กระสอบ	No...	No...	No...	No.....	No.....	No....	No....		
1	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
2	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
3	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
4	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
5	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
6	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
7	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
8	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
9	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
10	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
11	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
12	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
13	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
14	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
15	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
16	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
17	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
18	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
19	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
20	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
21	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
22	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
23	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
24	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
25	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
26	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
27	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
28	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
			รวม												

Remark / หมายเหตุ

Used within month / Remain (ปริมาณที่ใช้จริงในรอบเดือน / ยอดคงเหลือ)

Chlorine (คลอรีน) Kg. Powder (สารกรอง) Kg. / Litre Hydrochloric Acid (กรดเกลือ) Kg.

Soda Ash (โซดา-แอช) Kg. Sodium Bicarbonate (โซเดียมไบคาร์บอเนต)

Note : Please Mark N/A if not applicable, / Normal, X Abnormal / กรุณาใส่ N/A ถ้าไม่มีข้อมูล, / ปกติ, X ไม่ปกติ

Ve

Si ...คาร)

Da

F-ENG-PSW-001

Knight Frank

Swimming Pool Daily Checklist

ใบรายงานการตรวจสอบสระว่ายน้ำ

Sheet No. / แผ่นที่.1

Month / เดือน มีนาคม Year / ปี 2569

Building / อาคาร คีนน์ บาย แสนสิริ

Date วันที่	Time เวลา	Status Record บันทึกค่า		Adding / การเติม			Condition of Equipment / สภาพของอุปกรณ์							Recorded By บันทึก	Checked By Tech. Sup. ตรวจสอบโดย
		CL. (1-1.5)	PH (7.2-7.6)	Chlorine คลอรีน (kg.)	Soda Ash โซดา-แอช (kg.)	ค่าเกลือ PPT กระสอบ	Pump Set ชุดปั๊มน้ำ No...	No...	ปั๊มน้ำพุ No...	Pressure Tank แรงดันของถัง(.....PSI) No.....	No.....	Filter Set ชุดไส้กรองน้ำ No....	No....		
1	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
2	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
3	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
4	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
5	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
6	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
7	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
8	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
9	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
10	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
11	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
12	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
13	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
14	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
15	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
16	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
17	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
18	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
19	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
20	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
21	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
22	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
23	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
24	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
25	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
26	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
27	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
28	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
29	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
30	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
31	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
			รวม												

Remark / หมายเหตุ

Used within month / Remain (ปริมาณที่ใช้จริงในรอบเดือน / ยอดคงเหลือ)

Chlorine (คลอรีน) Kg. Powder (สารกรอง) Kg. / Litre Hydrochloric Acid (กรดเกลือ) Kg.

Soda Ash (โซดา-แอช) Kg. Sodium Bicarbonate (โซเดียมไบคาร์บอเนต) Kg.

Note : Please Mark N/A if not applicable, / Normal, X Abnormal / กรุณาใส่ N/A ถ้าไม่มีข้อมูล, / ปกติ, X ไม่ปกติ

Ve

Sig

....

Da

F-ENG-PSW-001

Knight Frank

Swimming Pool Daily Checklist

ใบรายงานการตรวจสอบสระว่ายน้ำ

Sheet No. / แผ่นที่ 1

Month / เดือน เมษายน Year / ปี 2569

Building / อาคาร คีนน์ บาย แสนสิริ

Date วันที่	Time เวลา	Status Record บันทึกค่า		Adding / การเติม			Condition of Equipment / สภาพของอุปกรณ์							Recorded By บันทึกโดย	Checked By Tech. Sup. ตรวจสอบโดยหัวหน้าช่าง
		CL.	PH	Chlorine คลอรีน	Soda Ash โซดา-แอช	ค่าเกลือ PPT	Pump Set ชุดปั๊มน้ำ		ปั๊มน้ำพุ	Pressure Tank แรงดันของถัง(.....PSI)		Filter Set ชุดไส้กรองน้ำ			
		(1-1.5)	(7.2-7.6)	(kg.)	(kg.)	กระสอบ	No...	No...	No...	No.....	No.....	No....	No....		
1	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
2	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
3	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
4	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
5	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
6	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
7	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
8	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
9	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
10	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
11	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
12	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
13	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
14	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
15	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
16	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
17	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
18	06:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
19	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
20	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
21	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
22	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
23	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
24	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
25	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
26	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
27	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
28	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
29	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
30	6:30	1.5	7.6	✓	✓	✓	✓	✓	✓	20	20	✓	✓		
			รวม												

Remark / หมายเหตุ

Used within month / Remain (ปริมาณที่ใช้จริงในรอบเดือน / ยอดคงเหลือ)

Chlorine (คลอรีน) Kg. Powder (สารกรอง) Kg. / Litre Hydrochloric Acid (กรดเกลือ) Kg.

Soda Ash (โซดา-แอช) Kg. Sodium Bicarbonate (โซเดียมไบคาร์บอเนต) Kg.

Note : Please Mark N/A if not applicable. / Normal, X Abnormal / กรุณาใส่ N/A ถ้าไม่มีข้อมูล, / ปกติ, X ไม่ปกติ

)

Knight Frank

Swimming Pool Daily Checklist

ใบรายงานการตรวจสอบสระว่ายน้ำ

Sheet No. / แผ่นที่ 1

Month / เดือน พฤษภาคม Year / ปี 2569

Building / อาคาร คีนน์ บาย แสนสิริ

Date วันที่	Time เวลา	Status Record บันทึกค่า		Adding / การเติม			Condition of Equipment / สภาพของอุปกรณ์							Recorded By บันทึก	Checked By Tech. Sup. ตรวจสอบโดย
		CL. (1-1.5)	PH (7.2-7.6)	Chlorine คลอรีน (kg.)	Soda Ash โซดา-แอช (kg.)	ค่าเกลือ PPT กระสอบ	Pump Set ชุดปั๊มน้ำ No...	No...	ปั๊มน้ำพุ No...	Pressure Tank แรงดันของถัง(.....PSI) No.....	No.....	Filter Set ชุดไส้กรองน้ำ No....	No.		
1	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
2	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
3	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
4	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
5	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
6	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
7	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
8	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
9	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
10	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
11	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
12	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
13	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
14	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
15	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
16	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
17	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
18	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
19	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
20	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
21	6:00	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
22	6:00	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
23	6:00	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
24	6:00	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
25	6:00	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
26	6:00	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
27	6:00	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
28	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
29	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
30	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
31	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
			รวม												

Remark / หมายเหตุ

Used within month / Remain (ปริมาณที่ใช้จริงในรอบเดือน / ยอดคงเหลือ)

Chlorine (คลอรีน) Kg. Powder (สารกรอง) Kg. / Litre Hydrochloric Acid (กรดเกลือ) Kg.

Soda Ash (โซดา-แอช) Kg. Sodium Bicarbonate (โซเดียมไบคาร์บอเนต) Kg.

Note : Please Mark N/A if not applicable. / Normal, X Abnormal / กรุณาใส่ N/A ถ้าไม่มีข้อมูล / ปกติ, X ไม่ปกติ

Ve

Si

Da

Knight Frank

Swimming Pool Daily Checklist

ใบรายงานการตรวจสอบสระว่ายน้ำ

Sheet No. / แผ่นที่.1

Month / เดือน มิถุนายน Year / ปี 2569

Building / อาคาร คีนน์ บาย แสนสิริ

Date วันที่	Time เวลา	Status Record บันทึกค่า		Adding / การเติม			Condition of Equipment / สภาพของอุปกรณ์							Recorded By บันทึกโดย	Checked By Tech. Sup. ตรวจสอบโดยหัวหน้าช่าง
							Pump Set ชุดปั๊มน้ำ		ปั๊มน้ำพุ	Pressure Tank แรงดันของถัง(.....PSI)		Filter Set ชุดไส้กรองน้ำ			
		CL. (1-1.5)	PH (7.2-7.6)	Chlorine คลอรีน (kg.)	Soda Ash โซดา-แอช (kg.)	ค่าเกลือ PPT กระสอบ	No...	No...	No...	No.....	No.....	No....	No....		
1	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
2	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
3	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
4	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
5	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
6	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
7	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
8	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
9	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
10	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
11	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
12	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
13	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
14	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
15	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
16	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
17	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
18	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
19	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
20	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
21	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
22	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
23	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
24	06:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
25	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
26	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
27	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
28	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
29	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
30	6:30	1.5	7.6	/	/	/	/	/	/	20	20	/	/		
			รวม												

Remark / หมายเหตุ

Used within month / Remain (ปริมาณที่ใช้จริงในรอบเดือน / ยอดคงเหลือ)

Chlorine (คลอรีน) _____ Kg. Powder (สารกรอง) _____ Kg. / Litre Hydrochloric Acid (กรดเกลือ) _____ Kg.

Soda Ash (โซดา-แอช) _____ Kg. Sodium Bicarbonate (โซเดียมไบคาร์บอเนต) _____ Kg.

Note : Please Mark N/A if not applicable, / Normal, X Abnormal / กรุณาใส่ N/A ถ้าไม่มีข้อมูล, / ปกติ, X ไม่ปกติ

ภาคผนวก 11

ตรวจสอบความมั่นคงของอาคาร

เลขที่ ๐๖๓๔/๒๕๖๘
รายงานผลการตรวจสอบใหญ่
ตามใบรับรองการตรวจสอบประจำปี ครั้งที่ ๔
เลขที่ ๔๐๑/๒๕๖๘ ลงวันที่ ๒๐ กุมภาพันธ์ ๒๕๖๘

แบบ ร.๑
ตามใบรับรองการตรวจสอบใหญ่เลขที่ ๒๒๒๙/๒๕๖๓
ลงวันที่ ๒ กรกฎาคม ๒๕๖๓

ใบรับรองการตรวจสอบอาคาร

ใบรับรองฉบับนี้ออกให้เพื่อแสดงว่า

อาคาร อาคารชุด คีนน์ บาย แสนสิริ

โดย นิติบุคคลอาคารชุด คีนน์ บาย แสนสิริ

ตั้งอยู่เลขที่ ๗๖๖ **หมู่ที่** -

ตรอก/ซอย - **ถนน** สุขุมวิท **ตำบล/แขวง** คลองตัน

อำเภอ/เขต คลองเตย **จังหวัด** กรุงเทพมหานคร **ได้ผ่านการตรวจสอบอาคาร ตามพระราชบัญญัติ ควบคุมอาคาร พ.ศ. ๒๕๒๒ แล้ว**

เจ้าพนักงานท้องถิ่นได้พิจารณาผลการตรวจสอบอาคาร ซึ่งทำการตรวจสอบโดยผู้ตรวจสอบชื่อ บริษัท ซี.บี.เอส. บิลดิ้ง อินสเปคชั่น จำกัด เลขทะเบียน น.๐๒๕๗/๒๕๕๘ ออกให้ ณ วันที่ ๑๗ มีนาคม ๒๕๖๘ **อาคารนี้มีสภาพปลอดภัยในการใช้งาน**

ออกให้ ณ วันที่ ๑๖ **เดือน** กันยายน **พ.ศ.** ๒๕๖๘

ใบรับรองฉบับนี้ให้ใช้ได้จนถึงวันที่ ๑ **เดือน** กรกฎาคม **พ.ศ.** ๒๕๖๙

คำเตือน

๑. ใบรับรองฉบับนี้เป็นการรับรองเฉพาะการตรวจสอบอาคาร มิได้เป็นการรับรองความถูกต้องการก่อสร้างอาคาร ดัดแปลงอาคาร หรือเคลื่อนย้ายอาคารแต่อย่างใด

๒. ให้จัดส่งรายงานผลการตรวจสอบอาคารภายใน ๓๐ วัน ก่อนใบรับรองการตรวจสอบอาคาร (แบบ ร.๑) จะมีระยะเวลาครบ ๑ ปี

([redacted])
ตำแหน่ง ผู้อำนวยการสำนักการโยธา
ปฏิบัติราชการแทนผู้ว่าราชการกรุงเทพมหานคร
เจ้าพนักงานท้องถิ่น

BID 471517860670508
(อ้างอิงเลขเดิม 9977D114F142)