

ภาคผนวก ณ.

เอกสารตรวจเช็คถังดับเพลิงและระบบป้องกันอัคคีภัย
ประจำเดือนมกราคมถึงมิถุนายน พ.ศ. 2569


เดือนมกราคม พ.ศ. 2569

รายงานการตรวจถังดับเพลิงประจำเดือน มกราคม 2569

Fire Extinguisher Inspection Reprot Summary

No.	Type	Year	Size	Quantity	Total	Operating condition		Remark
						Normal	Not normal	
1	Dry Chemical	2019	10 lbs.	87	87	84	3	ถังดับเพลิงทุกชนิดมีการใช้งานมานานแล้วมีถังของปี 2019 และ 2020 และยังไม่ผ่านการตรวจสอบที่กฎหมายกำหนด การทดสอบสภาพและแรงดันของถังจะต้องดำเนินการทุกๆ 5 ปีตามกฎหมายกำหนด
			15 lbs.	-				
		2020	10 lbs.	11	11	11		
			15 lbs.	-				
		2021	10 lbs.	12	12	10	2	
			15 lbs.	-				
		2022	10 lbs.	2	2	2		
			15 lbs.	-				
		2024	10 lbs.	8	8	8		
			15 lbs.	-				
1	CO2	2024	10 lbs.	-	8			
			15 lbs.	8		8		
1	Foam	2022	10 lbs.	-	1			
			15 lbs.	1		1		
Total				129	129	124	5	
Dry Chemical Total 120								รอนำไปเติมน้ำยาอยู่ที่ออฟฟิศ LP จำนวน 5 ถัง
CO2 Total 8								
Foam Total 1								
สำรวจที่ออฟฟิศ LP จำนวน - ถัง								

Reporter

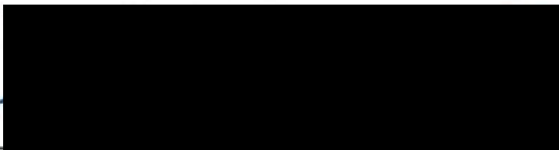

Loss Prevention Manager

Acknowledged

General Manager

Fire Extinguisher Inspection Reprot Summary

Building 1				year					Operating condition		Remark	
No.	Type		Size	Quantity	2019	2020	2021	2024		Normal		Not normal
1	Dry Chemical		10 lbs.	20	18	2	-	-		20	-	
			15 lbs.	-								
Total				20						-		
Building 2				year					Operating condition		Remark	
No.	Type		Size	Quantity	2019	2020	2021	2024		Normal		Not normal
1	Dry Chemical		10 lbs.	21	21	-	-	-		21	-	
			15 lbs.	-								
Total				22						-		
Building 3				year					Operating condition		Remark	
No.	Type		Size	Quantity	2019	2020	2021	2024		Normal		Not normal
1	Dry Chemical		10 lbs.	21	16	3	2	-		21	-	
			15 lbs.	-								
Total				21						-		
Building 4				year					Operating condition		Remark	
No.	Type		Size	Quantity	2019	2020	2021	2022	2024	Normal		Not normal
1	Dry Chemical		10 lbs.	21	14	5	2	1	1	23	-	
			15 lbs.	-								
Total				21						-		

Outer & Lobby				year						Operating condition		Remark
No.	Type		Size	Quantity	2019	2020	2021	2024		Normal	Not normal	
1	Dry Chemical		10 lbs.	10	7	1	2	-		10	1	รอสั่งเติมน้ำยา 1 ถัง อยู่ที่ ออฟฟิศ LP
			15 lbs.	-	-	-	-	-			-	
2	CO2		15 lbs.	-	-	-	-	5		5	-	
Total				15						15	1	
Basement				year						Operating condition		Remark
No.	Type		Size	Quantity	2019	2020	2021	2022	2024	Normal	Not normal	
1	Dry Chemical		10 lbs.	25	8		4	1	7	20	1	รอสั่งเติมน้ำยา 1 ถัง อยู่ที่ ออฟฟิศ LP
			15 lbs.	-	-	-	-	-				
2	CO2		15 lbs.	-	-	-	-	-	3	3		
3	Foam		15 lbs.	-	-	-	-	1		1		
Total										24	1	

Building 1

January 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	1	1	2019	FHC-01 (ครัวบัวหลวง)	DC	10 lbs.	/	/	/	/	X	
2	1	1	2019	FHC-02 (หน้าห้องน้ำหลัง)	DC	10 lbs.	/	/	/	/	X	
3	1	2	2019	FHC-01 (1224)	DC	10 lbs.	/	/	/	/	X	
4	1	2	2019	FHC-02 (1217)	DC	10 lbs.	/	/	/	/	X	
5	1	2	2019	FHC-03 (1202)	DC	10 lbs.	/	/	/	/	X	
6	1	3	2019	FHC-01 (1324)	DC	10 lbs.	/	/	/	/	X	
7	1	3	2019	FHC-02 (1317)	DC	10 lbs.	/	/	/	/	X	
8	1	3	2019	FHC-03 (1303)	DC	10 lbs.	/	/	/	/	X	
9	1	4	2019	FHC-01 (1424)	DC	10 lbs.	/	/	/	/	X	
10	1	4	2019	FHC-02 (1417)	DC	10 lbs.	/	/	/	/	X	
11	1	4	2019	FHC-03 (1403)	DC	10 lbs.	/	/	/	/	X	
12	1	5	2019	FHC-01 (1524)	DC	10 lbs.	/	/	/	/	X	
13	1	5	2019	FHC-02 (1517)	DC	10 lbs.	/	/	/	/	X	
14	1	5	2020	FHC-03 (1503)	DC	10 lbs.	/	/	/	/	X	
15	1	6	2020	FHC-01 (1624)	DC	10 lbs.	/	/	/	/	X	
16	1	6	2019	FHC-02 (1617)	DC	10 lbs.	/	/	/	/	X	
17	1	6	2019	FHC-03 (1603)	DC	10 lbs.	/	/	/	/	X	
18	1	7	2019	FHC-01 (1724)	DC	10 lbs.	/	/	/	/	X	
19	1	7	2019	FHC-02 (1717)	DC	10 lbs.	/	/	/	/	X	
20	1	7	2019	FHC-03 (1703)	DC	10 lbs.	/	/	/	/	X	

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs -	-	20 -	20 -	-	
2	CO2	-	-	-	-		
3	Foam	-	-	-	-		
Total				20	20	-	

Inspector

Acknowledged

...

Loss Prevention Officer

Loss Prevention Manager



WYNDHAM
JOMTIEN PATTAYA

[illegible]

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.		21	21		
2	CO2						
3	Foam						
Total				21	21		

Inspector

Acknowledged



Loss Prevention Officer



Loss Prevention Manager

[illegible]

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	-	21	21		
2	CO2						
3	Foam						
Total			21		21		

Inspector

Acknowledged



Loss Prevention Officer



Loss Prevention Manager

January 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/ Weight	Obstacle	
1	4	1	2020	FHC-01 (kid room)	DC	10 lbs.	/	/	/	/	X	
2	4	1	2019	FHC-02 (fitness room)	DC	10 lbs.	/	/	/	/	X	สนิมขึ้นก้นถัง
3	4	1	2019	FHC-03 (4105)	DC	10 lbs.	/	/	/	/	X	
4	4	2	2019	FHC-01 (4226)	DC	10 lbs.	/	/	/	/	X	
5	4	2	2019	FHC-02 (4219)	DC	10 lbs.	/	/	/	/	X	
6	4	2	2022	FHC-03 (4204)	DC	10 lbs.	/	/	/	/	X	
7	4	3	2019	FHC-01 (4326)	DC	10 lbs.	/	/	/	/	X	
8	4	3	2019	FHC-02 (4319)	DC	10 lbs.	/	/	/	/	X	
9	4	3	2019	FHC-03 (4304)	DC	10 lbs.	/	/	/	/	X	
10	4	4	2019	FHC-01 (4426)	DC	10 lbs.	/	/	/	/	X	
11	4	4	2020	FHC-02 (4419)	DC	10 lbs.	/	/	/	/	X	
12	4	4	2019	FHC-03 (4404)	DC	10 lbs.	/	/	/	/	X	
13	4	5	2019	FHC-01 (4526)	DC	10 lbs.	/	/	/	/	X	
14	4	5	2021	FHC-02 (4519)	DC	10 lbs.	/	/	/	/	X	
15	4	5	2019	FHC-03 (4504)	DC	10 lbs.	/	/	/	/	X	
16	4	6	2021	FHC-01 (4626)	DC	10 lbs.	/	/	/	/	X	
17	4	6	2020	FHC-02 (4619)	DC	10 lbs.	/	/	/	/	X	
18	4	6	2020	FHC-03 (4604)	DC	10 lbs.	/	/	/	/	X	
19	4	7	2020	FHC-01 (4726)	DC	10 lbs.	/	/	/	/	X	
20	4	7	2019	FHC-02 (4719)	DC	10 lbs.	/	/	/	/	X	
21	4	7	2019	FHC-03 (4704)	DC	10 lbs.	/	/	/	/	X	
22	4	BM	2019	FHC-01 (4010)	DC	10 lbs.	/	/	/	/	X	
23	4	BM	2024	Guest (4026)	DC	10 lbs.	/	/	/	/	X	

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs	-	23	23		
2	CO2	-	-	-	-		
3	Foam	-	-	-	-		
Total				23	23		

Inspector

Acknowledged

[Redacted Signature]

Loss Prevention Officer

[Redacted Signature]

Loss Prevention Manager



WYNDHAM
JOMTIEN PATTAYA

[illegible]

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity		Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.		9	8	1	อยู่ใกล้อาคาร LP รอติดตั้ง
2	CO2	15 lbs.		5	5	—	
3	Foam			—	—	—	
Total				14	14		

Inspector

Acknowledged

...

Loss Prevention Officer

Loss Prevention Manager

Basement

January 2026


No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/ Weight	Obstacle	
1		BM	2019	LD liner store	DC	10 lbs.	/	/	/	/	X	
2		BM	2019	FHC.B3.FB/01	DC	10 lbs.	/	/	/	/	X	
3		BM	2019	Walk way LP	DC	10 lbs.	/	/	/	/	X	
4		BM	2019	FHC.B3.FB/02	DC	10 lbs.	/	/	/	/	X	
5		BM	2019	FHC.B2.FB/02	DC	10 lbs.	/	/	/	/	X	
6		BM	2024	Front Store room	DC	15 lbs.	/	/	/	/	X	
7		BM	2021	Engineer Store	DC	10 lbs.	/	/	/	/	X	อยู่ท่อน้ำ LP
8		BM	2022	Engineer Office	DC	10 lbs.	/	/	/	/	X	
9		BM	2024	Front Staff Canteen	DC	15 lbs.	/	/	/	/	X	
10		BM	2021	FHC.B2.FB/01	DC	10 lbs.	/	/	/	/	X	
11		BM	2019	FHC.B2.FB/03	DC	10 lbs.	/	/	/	/	X	
12		BM	2021	FHC.B1.FB/03	DC	10 lbs.	/	/	/	/	X	
13		BM	2024	Kitchen canteen	Co2	15 lbs.	/	/	/	/	X	
14		BM	2024	Front MK office	DC	15 lbs.	/	/	/	/	X	
15		BM	2024	Front IT office	DC	15 lbs.	/	/	/	/	X	
16		BM	2024	IT Server	DC	15 lbs.	/	/	/	/	X	
17		BM	2024	IT Server	Co2	15 lbs.	/	/	/	/	X	
18		BM	2021	FHC.BL.FB/01	DC	10 lbs.	/	/	/	/	X	
19		BM	2019	FHC.BL.FB/02	DC	10 lbs.	/	/	/	/	X	
20		BM	2019	FHC.B1.FB/01	DC	10 lbs.	/	/	/	/	X	
21		BM	2021	FHC.B1.FB/02	DC	10 lbs.	/	/	/	/	X	
22		BM	2024	Kitcher 3	Co2	15 lbs.	/	/	/	/	X	
23		BM	2022	Kitcher 4	Foam	15 lbs.	/	/	/	/	X	
23		BM	2024	Front Fire Pump	DC	15 lbs.	/	/	/	/	X	
25		BM	2024	Corridor	DC	15 lbs.	/	/	/	/	X	

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity		Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.		21	20	1	จุดเติมน้ำยาอยู่ห้อง LP
2	CO2	15 lbs.		3	3	—	
3	Foam	1		1	1	—	
Total				25	21	1	
Dry Chemical ปี 2019 จำนวน 8 ถัง ปี 2021 จำนวน 4 ถัง ปี 2022 จำนวน 1 ถัง ปี 2024 จำนวน 7 ถัง			CO2 ปี 2024 จำนวน 3 ถัง			Foam ปี 2022 จำนวน 1 ถัง	
ถ้ำรองที่ออฟฟิศ LP จำนวน - ถัง							

Inspector

Acknowledged

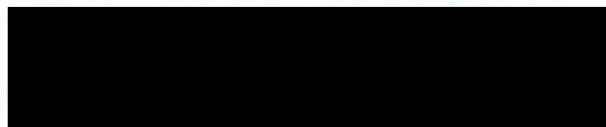

Loss Prevention Officer

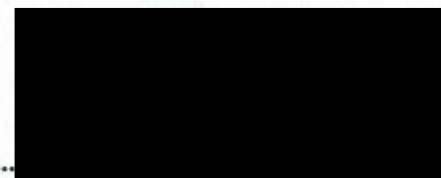

Loss Prevention Manager


เดือนกุมภาพันธ์ พ.ศ. 2569

รายงานการตรวจถังดับเพลิงประจำเดือน กุมภาพันธ์ 2569

Fire Extinguisher Inspection Reprot Summary

No.	Type	Year	Size	Quantity	Total	Operating condition		Remark
						Normal	Not normal	
1	Dry Chemical	2019	10 lbs.	87	87	85	3	ถังดับเพลิงทุกชนิดมีการใช้งานมานานแล้วมีถังของปี 2019 และ 2020 และยังไม่ผ่านการตรวจสอบที่กฎหมายกำหนด การทดสอบสภาพและแรงดันของถังจะต้องดำเนินการทุกๆ 5 ปีตามกฎหมายกำหนด
			15 lbs.	-				
		2020	10 lbs.	11	11	10	2	
			15 lbs.	-				
		2021	10 lbs.	10	10	10		
			15 lbs.	-				
		2022	10 lbs.	2	2	2		
			15 lbs.	-				
		2024	10 lbs.	1	8	8		
			15 lbs.	7				
1	CO2	2024	10 lbs.	-	8			
			15 lbs.	8		8		
1	Foam	2022	10 lbs.	-	1			
			15 lbs.	1		1		
Total				127	127	124	5	
Dry Chemical Total 118								รอนำไปเติมน้ำยาอยู่ที่ออฟฟิศ LP จำนวน 5 ถัง
CO2 Total 8								
Foam Total 1								
สำรองที่ออฟฟิศ LP จำนวน - ถัง				-				

Reporter

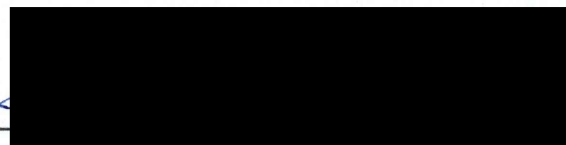

Loss Prevention Manager

Acknowledged

General Manager

Fire Extinguisher Inspection Reprot Summary

Building 1			year						Operating condition		Remark	
No.	Type	Size	Quantity	2019	2020	2021	2024		Normal	Not normal		
1	Dry Chemical	10 lbs.	20	18	2	-	-		20	-		
		15 lbs.	-									
Totel			20						20	-		
Building 2			year						Operating condition		Remark	
No.	Type	Size	Quantity	2019	2020	2021	2024		Normal	Not normal		
1	Dry Chemical	10 lbs.	21	21	-	-	-		21	-		
		15 lbs.	-									
Totel			21						21	-		
Building 3			year						Operating condition		Remark	
No.	Type	Size	Quantity	2019	2020	2021	2024		Normal	Not normal		
1	Dry Chemical	10 lbs.	21	16	3	2	-		21	-		
		15 lbs.	-									
Totel			21						21	-		
Building 4			year						Operating condition		Remark	
No.	Type		Size	Quantity	2019	2020	2021	2022	2024	Normal		Not normal
1	Dry Chemical		10 lbs.	23	15	4	2	1	1	23	-	
			15 lbs.	-								
Totel			23						23	-		

Outer & Lobby			year						Operating condition		Remark
No.	Type	Size	Quantity	2019	2020	2021	2024		Normal	Not normal	
1	Dry Chemical	10 lbs.	10	7	1	2	-		9	1	รอสั่งเติมน้ำยา 1 ถัง อยู่ที่ ออฟฟิศ LP
		15 lbs.	-	-	-	-	-			-	
2	CO2	15 lbs.	5	-	-	-	5		5	-	
Total			15						14	1	
Basement			year						Operating condition		Remark
No.	Type	Size	Quantity	2019	2020	2021	2022	2024	Normal	Not normal	
1	Dry Chemical	10 lbs.	16	10	1	4	1	-	14	2	รอสั่งเติมน้ำยา 2 ถัง อยู่ที่ ออฟฟิศ LP
		15 lbs.	7	-	-	-	-	7	7		
2	CO2	15 lbs.	3	-	-	-	-	3	3		
3	Foam	15 lbs.	1	-	-	-	1		1		
Total			27						25	2	

February 2026

Building 1



No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	1	1	2019	FHC-01 (ครัวบัวหลวง)	DC	10 lbs.	✓	✓	✓	✓		
2	1	1	2019	FHC-02 (หน้าห้องน้ำหลัง)	DC	10 lbs.	✓	✓	✓	✓		
3	1	2	2019	FHC-01 (1224)	DC	10 lbs.	✓	✓	✓	✓		
4	1	2	2019	FHC-02 (1217)	DC	10 lbs.	✓	✓	✓	✓		
5	1	2	2019	FHC-03 (1202)	DC	10 lbs.	✓	✓	✓	✓		
6	1	3	2019	FHC-01 (1324)	DC	10 lbs.	✓	✓	✓	✓		
7	1	3	2019	FHC-02 (1317)	DC	10 lbs.	✓	✓	✓	✓		
8	1	3	2019	FHC-03 (1303)	DC	10 lbs.	✓	✓	✓	✓		
9	1	4	2019	FHC-01 (1424)	DC	10 lbs.	✓	✓	✓	✓		
10	1	4	2019	FHC-02 (1417)	DC	10 lbs.	✓	✓	✓	✓		
11	1	4	2019	FHC-03 (1403)	DC	10 lbs.	✓	✓	✓	✓		
12	1	5	2019	FHC-01 (1524)	DC	10 lbs.	✓	✓	✓	✓		
13	1	5	2019	FHC-02 (1517)	DC	10 lbs.	✓	✓	✓	✓		
14	1	5	2020	FHC-03 (1503)	DC	10 lbs.	✓	✓	✓	✓		
15	1	6	2020	FHC-01 (1624)	DC	10 lbs.	✓	✓	✓	✓		
16	1	6	2019	FHC-02 (1617)	DC	10 lbs.	✓	✓	✓	✓		
17	1	6	2019	FHC-03 (1603)	DC	10 lbs.	✓	✓	✓	✓		
18	1	7	2019	FHC-01 (1724)	DC	10 lbs.	✓	✓	✓	✓		
19	1	7	2019	FHC-02 (1717)	DC	10 lbs.	✓	✓	✓	✓		
20	1	7	2019	FHC-03 (1703)	DC	10 lbs.	✓	✓	✓	✓		

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.		20	20		
2	CO2	-					
3	Foam	-					
Total			20				

cter

Acknowledged



Loss Prevention Officer

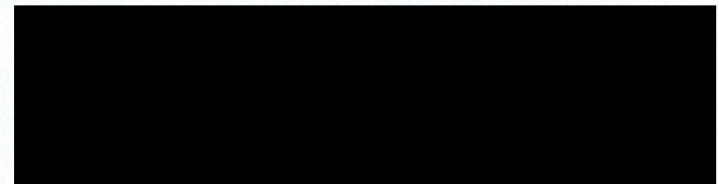

Loss Prevention Manager

February 2026

Building 2



No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	2	1	2019	FHC-01 (หน้าลิฟต์พนักงาน)	DC	10 lbs.	/	/	/	/		
2	2	1	2019	FHC-02 (หน้าห้องน้ำหลัง)	DC	10 lbs.	/	/	/	/		
3	2	1	2019	Kitchen (ในครัวลิลาวิ)	DC	10 lbs.	/	/	/	/		
4	2	2	2019	FHC-01 (2224)	DC	10 lbs.	/	/	/	/		
5	2	2	2019	FHC-02 (2217)	DC	10 lbs.	/	/	/	/		
6	2	2	2019	FHC-03 (2202)	DC	10 lbs.	/	/	/	/		
7	2	3	2019	FHC-01 (2324)	DC	10 lbs.	/	/	/	/		
8	2	3	2019	FHC-02 (2317)	DC	10 lbs.	/	/	/	/		
9	2	3	2019	FHC-03 (2303)	DC	10 lbs.	/	/	/	/		
10	2	4	2019	FHC-01 (2424)	DC	10 lbs.	/	/	/	/		
11	2	4	2019	FHC-02 (2417)	DC	10 lbs.	/	/	/	/		
12	2	4	2019	FHC-03 (2403)	DC	10 lbs.	/	/	/	/		
13	2	5	2019	FHC-01 (2524)	DC	10 lbs.	/	/	/	/		
14	2	5	2019	FHC-02 (2517)	DC	10 lbs.	/	/	/	/		
15	2	5	2019	FHC-03 (2503)	DC	10 lbs.	/	/	/	/		
16	2	6	2019	FHC-01 (2624)	DC	10 lbs.	/	/	/	/		
17	2	6	2019	FHC-02 (2617)	DC	10 lbs.	/	/	/	/		
18	2	6	2019	FHC-03 (2603)	DC	10 lbs.	/	/	/	/		
19	2	7	2019	FHC-01 (2724)	DC	10 lbs.	/	/	/	/		
20	2	7	2019	FHC-02 (2717)	DC	10 lbs.	/	/	/	/		
21	2	7	2019	FHC-03 (2703)	DC	10 lbs.	/	/	/	/		

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.		21	21		
2	CO2	-					
3	Foam	-					
Total				21	21		

Inspector

Acknowledged



Loss Prevention Officer

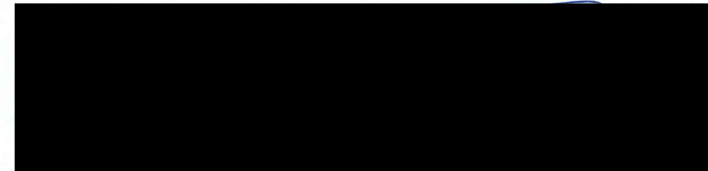

Loss Prevention Manager


Building	Details of Fire Extinguisher					Inspection Criteria					Details
	Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/ Weight	Obstacle	
3	1	2019	FHC-01 (3112)	DC	10 lbs.	✓	✓	✓	✓		
3	1	2019	FHC-02 (3119)	DC	10 lbs.	✓	✓	✓	✓		
3	1	2019	FHC-03 (3105)	DC	10 lbs.	✓	✓	✓	✓		
3	2	2019	FHC-01 (3226)	DC	10 lbs.	✓	✓	✓	✓		
3	2	2019	FHC-02 (3219)	DC	10 lbs.	✓	✓	✓	✓		
3	2	2019	FHC-03 (3204)	DC	10 lbs.	✓	✓	✓	✓		
3	3	2019	FHC-01 (3326)	DC	10 lbs.	✓	✓	✓	✓		
3	3	2019	FHC-02 (3319)	DC	10 lbs.	✓	✓	✓	✓		
3	3	2019	FHC-03 (3304)	DC	10 lbs.	✓	✓	✓	✓		
3	4	2019	FHC-01 (3426)	DC	10 lbs.	✓	✓	✓	✓		
3	4	2020	FHC-02 (3419)	DC	10 lbs.	✓	✓	✓	✓		
3	4	2019	FHC-03 (3404)	DC	10 lbs.	✓	✓	✓	✓		
3	5	2019	FHC-01 (3526)	DC	10 lbs.	✓	✓	✓	✓		
3	5	2021	FHC-02 (3519)	DC	10 lbs.	✓	✓	✓	✓		
3	5	2019	FHC-03 (3504)	DC	10 lbs.	✓	✓	✓	✓		
3	6	2021	FHC-01 (3626)	DC	10 lbs.	✓	✓	✓	✓		
3	6	2020	FHC-02 (3619)	DC	10 lbs.	✓	✓	✓	✓		
3	6	2020	FHC-03 (3604)	DC	10 lbs.	✓	✓	✓	✓		
3	7	2019	FHC-01 (3726)	DC	10 lbs.	✓	✓	✓	✓		
3	7	2019	FHC-02 (3719)	DC	10 lbs.	✓	✓	✓	✓		
3	7	2019	FHC-03 (3704)	DC	10 lbs.	✓	✓	✓	✓		

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	21	21	✓		
2	CO2	-					
3	Foam	-					
Total							

cter

Acknowledged

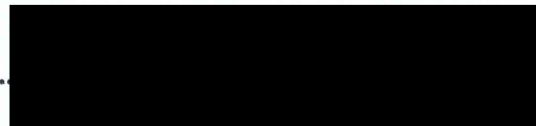

Loss Prevention Officer

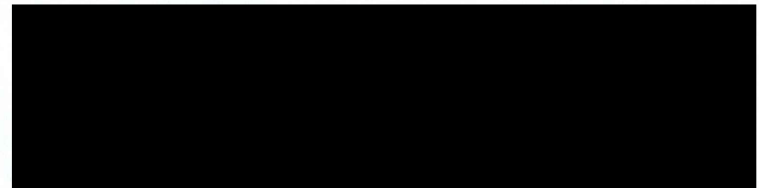

Loss Prevention Manager

Building 4

February 2026



No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/ Weight	Obstacle	
1	4	1	2020	FHC-01 (kid room)	DC	10 lbs.	/	/	/	/		
2	4	1	2019	FHC-02 (fitness room)	DC	10 lbs.	/	/	/	/		สนิมขึ้นก้นถัง
3	4	1	2019	FHC-03 (4105)	DC	10 lbs.	/	/	/	/		
4	4	2	2019	FHC-01 (4226)	DC	10 lbs.	/	/	/	/		
5	4	2	2019	FHC-02 (4219)	DC	10 lbs.	/	/	/	/		
6	4	2	2022	FHC-03 (4204)	DC	10 lbs.	/	/	/	/		
7	4	3	2019	FHC-01 (4326)	DC	10 lbs.	/	/	/	/		
8	4	3	2019	FHC-02 (4319)	DC	10 lbs.	/	/	/	/		
9	4	3	2019	FHC-03 (4304)	DC	10 lbs.	/	/	/	/		
10	4	4	2019	FHC-01 (4426)	DC	10 lbs.	/	/	/	/		
11	4	4	2020	FHC-02 (4419)	DC	10 lbs.	/	/	/	/		
12	4	4	2019	FHC-03 (4404)	DC	10 lbs.	/	/	/	/		
13	4	5	2019	FHC-01 (4526)	DC	10 lbs.	/	/	/	/		
14	4	5	2021	FHC-02 (4519)	DC	10 lbs.	/	/	/	/		
15	4	5	2019	FHC-03 (4504)	DC	10 lbs.	/	/	/	/		
16	4	6	2021	FHC-01 (4626)	DC	10 lbs.	/	/	/	/		
17	4	6	2020	FHC-02 (4619)	DC	10 lbs.	/	/	/	/		
18	4	6	2020 2019	FHC-03 (4604)	DC	10 lbs.	/	/	/	/		
19	4	7	2020	FHC-01 (4726)	DC	10 lbs.	/	/	/	/		
20	4	7	2019	FHC-02 (4719)	DC	10 lbs.	/	/	/	/		
21	4	7	2019	FHC-03 (4704)	DC	10 lbs.	/	/	/	/		
22	4	BM	2019	FHC-01 (4010)	DC	10 lbs.	/	/	/	/		
23	4	BM	2024	Guest (4026)	DC	10 lbs.	/	/	/	/		

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	—	23	✓	—	
2	CO2	-					
3	Foam	-					
Total							

Inspector

Acknowledged

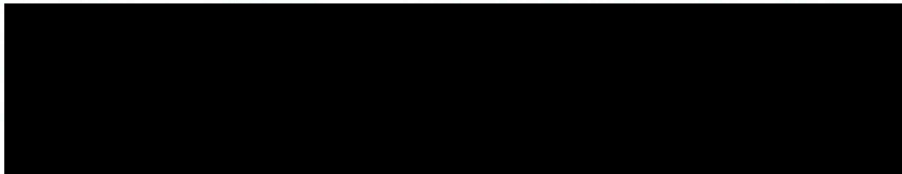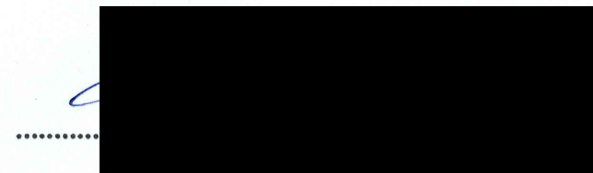Loss Prevention Manager

Building	Details of Fire Extinguisher					Inspection Criteria					Details
	Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
	BM	2019	LD liner store	DC	10 lbs.	/	/	/	/		
	BM	2019	FHC.B3.FB/01	DC	10 lbs.	/	/	/	/		
	BM	2019	Walk way LP	DC	10 lbs.	/	/	/	/		
	BM	2019	FHC.B3.FB/02	DC	10 lbs.	/	/	/	/		
	BM	2019	FHC.B2.FB/02	DC	10 lbs.	/	/	/	/		
	BM	2024	Front Store room	DC	15 lbs.	/	/	/	/		
	BM	2019	Engineer Store	DC	10 lbs.						อยู่ที่ออฟฟิศ LP รอเติมน้ำยา
	BM	2022	Engineer Office	DC	10 lbs.	/	/	/	/		
	BM	2024	Front Staff Canteen	DC	15 lbs.	/	/	/	/		
	BM	2021	FHC.B2.FB/01	DC	10 lbs.	/	/	/	/		
	BM	2019	FHC.B2.FB/03	DC	10 lbs.	/	/	/	/		
	BM	2021	FHC.B1.FB/03	DC	10 lbs.	/	/	/	/		
	BM	2024	Kitchen canteen	Co2	15 lbs.	/	/	/	/		
	BM	2024	Front MK office	DC	15 lbs.	/	/	/	/		
	BM	2024	Front IT office	DC	15 lbs.	/	/	/	/		
	BM	2024	IT Server	DC	15 lbs.	/	/	/	/		
	BM	2024	IT Server	Co2	15 lbs.	/	/	/	/		
	BM	2021	FHC.BL.FB/01	DC	10 lbs.	/	/	/	/		
	BM	2019	FHC.BL.FB/02	DC	10 lbs.	/	/	/	/		
	BM	2019	FHC.B1.FB/01	DC	10 lbs.	/	/	/	/		
	BM	2021	FHC.B1.FB/02	DC	10 lbs.	/	/	/	/		
	BM	2024	Kitcher 3	Co2	15 lbs.	/	/	/	/		
	BM	2022	Kitcher 4	Foam	15 lbs.	/	/	/	/		
	BM	2024	Front Fire Pump	DC	15 lbs.	/	/	/	/		
	BM	2024	Corridor	DC	15 lbs.	/	/	/	/		
		2019	FHC.B3.FB/03	DC	10 lbs.						อยู่ที่ออฟฟิศ LP รอเติมน้ำยา
		2020	FHC.B4.FB/02	DC	10 lbs.	/	/	/	/		

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.		21	20	1	
2	CO2	15 lbs.		3	3		
3	Foam	1		1	1		
Total				25	24	1	

cter

Acknowledged



Loss Prevention Officer

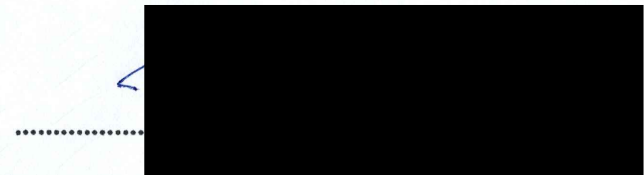

Loss Prevention Manager


[illegible]

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity		Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.			9	1	
2	CO2	15 lbs.			5		
3	Foam						
Total					14	1	

Inspector

Acknowledged

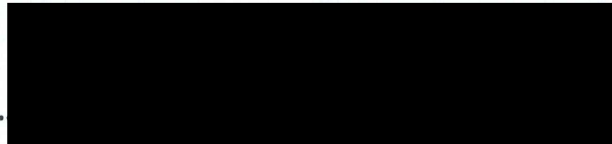.. 

Loss Prevention Officer

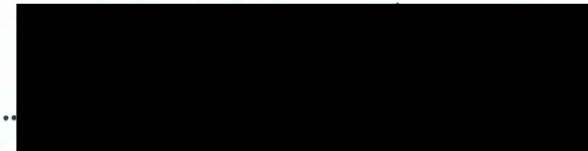.. 

Loss Prevention Manager

เดือนมีนาคม พ.ศ. 2569

Fire Extinguisher Inspection Reprot Summary of March 2026

Fire Extinguisher Inspection Outer & Lobby&Basement					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	18	15	3
	2020	10 lbs.	2	2	
	2021	10 lbs.	6	6	
	2022	10 lbs.	1	1	
	2024	10 lbs.	-	0	
	2024	15 lbs.	7	7	
CO2	2024	15 lbs.	8	8	
Foam	2022	15 lbs.	1	1	
Total			43	40	3

Fire Extinguisher Inspection Building 1					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	18	18	
	2020	10 lbs.	2	2	
	2021	10 lbs.	-	0	
	2022	10 lbs.	-	0	
	2024	10 lbs.	-	0	
	2024	15 lbs.	-	0	
CO2		15 lbs.	-	0	
Foam		15 lbs.	-	0	
Total			20	20	0

Fire Extinguisher Inspection Building 2					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	21	21	
	2020	10 lbs.	-	0	
	2021	10 lbs.	-	0	
	2022	10 lbs.	-	0	
	2024	10 lbs.	-	0	
	2024	15 lbs.	-	0	
CO2		15 lbs.	-	0	
Foam		15 lbs.	-	0	
Total			21	21	0

Fire Extinguisher Inspection Building 3					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	16	16	
	2020	10 lbs.	3	3	
	2021	10 lbs.	2	2	
	2022	10 lbs.	-	0	
	2024	10 lbs.	-	0	
	2024	15 lbs.	-	0	
CO2		15 lbs.	-	0	
Foam		15 lbs.	-	0	
Total			21	21	0

Fire Extinguisher Inspection Building 4					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	15	15	
	2020	10 lbs.	4	4	
	2021	10 lbs.	2	2	
	2022	10 lbs.	1	1	
	2024	10 lbs.	-	0	
	2024	15 lbs.	1	1	
CO2		15 lbs.	-	0	
Foam		15 lbs.	-	0	
Total			23	23	0

Fire Extinguisher Inspection Reprot Summary					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	87	84	3
	2020	10 lbs.	11	11	
	2021	10 lbs.	10 ¹²	10	2 ตัวรอ3
	2022	10 lbs.	2	2	
	2024	10 lbs.	-	0	
	2024	15 lbs.	8	8	
CO2		15 lbs.	8	8	
Foam		15 lbs.	1	1	
Total			127 ¹²⁹	124	5
Dry Chemical			Total	120	
CO2			Total	8	
Foam			Total	1	
ตัวรอที่รอให้ใช้ LP			Total	0	

Remark

- 1.ตัวถังแห้งทุกชนิดมีการใช้งานมานานแล้วมีอายุของปี 2019 และ 2020 และยังไม่มีผ่านการตรวจสอบที่กฎหมายกำหนดการทดสอบสภาพและแรงดันจะถือว่า
- 2.ตัวถังแห้งทุกๆ 5 ปีตามกฎหมายกำหนด
- 3.ตัวถังแห้งที่เกินอายุที่ออกให้ใช้ LP จำนวน 5 ตัว

ผู้ตรวจเช็ค

[Redacted Signature]

LPO /LPS
29/3/69

ผู้รับรอง

[Redacted Signature]

31/3/69

ผู้รับทราบ

[Redacted Signature]

1/4/69

Building 1


March 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	1	1	2019	FHC-01 (ครัวบุรณศิริ)	DC	10 lbs.	✓	✓	✓	✓	□	
2	1	1	2019	FHC-02 (หน้าห้องน้ำแข็ง)	DC	10 lbs.	✓	✓	✓	✓	□	
3	1	2	2019	FHC-01 (1224)	DC	10 lbs.	✓	✓	✓	✓	□	
4	1	2	2019	FHC-02 (1217)	DC	10 lbs.	✓	✓	✓	✓	□	
5	1	2	2019	FHC-03 (1202)	DC	10 lbs.	✓	✓	✓	✓	□	
6	1	3	2019	FHC-01 (1324)	DC	10 lbs.	✓	✓	✓	✓	□	
7	1	3	2019	FHC-02 (1317)	DC	10 lbs.	✓	✓	✓	✓	□	
8	1	3	2019	FHC-03 (1303)	DC	10 lbs.	✓	✓	✓	✓	□	
9	1	4	2019	FHC-01 (1424)	DC	10 lbs.	✓	✓	✓	✓	□	
10	1	4	2019	FHC-02 (1417)	DC	10 lbs.	✓	✓	✓	✓	□	
11	1	4	2019	FHC-03 (1403)	DC	10 lbs.	✓	✓	✓	✓	□	
12	1	5	2019	FHC-01 (1524)	DC	10 lbs.	✓	✓	✓	✓	□	
13	1	5	2019	FHC-02 (1517)	DC	10 lbs.	✓	✓	✓	✓	□	
14	1	5	2020	FHC-03 (1503)	DC	10 lbs.	✓	✓	✓	✓	□	
15	1	6	2020	FHC-01 (1624)	DC	10 lbs.	✓	✓	✓	✓	□	
16	1	6	2019	FHC-02 (1617)	DC	10 lbs.	✓	✓	✓	✓	□	
17	1	6	2019	FHC-03 (1603)	DC	10 lbs.	✓	✓	✓	✓	□	
18	1	7	2019	FHC-01 (1724)	DC	10 lbs.	✓	✓	✓	✓	□	
19	1	7	2019	FHC-02 (1717)	DC	10 lbs.	✓	✓	✓	✓	□	
20	1	7	2019	FHC-03 (1703)	DC	10 lbs.	✓	✓	✓	✓	□	

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	20	20	20		
2	CO2	-					
3	Foam	-					
Total					20		

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

March 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	2	1	2019	FHC-01 (หน้าลิฟต์พนักงาน)	DC	10 lbs.	☒	☒	☒	☒	☐	
2	2	1	2019	FHC-02 (หน้าห้องน้ำหลัง)	DC	10 lbs.	☒	☒	☒	☒	☐	
3	2	1	2019	Kitchen (ในครัวลิ้งาวดี)	DC	10 lbs.	☒	☒	☒	☒	☐	
4	2	2	2019	FHC-01 (2224)	DC	10 lbs.	☒	☒	☒	☒	☐	
5	2	2	2019	FHC-02 (2217)	DC	10 lbs.	☒	☒	☒	☒	☐	
6	2	2	2019	FHC-03 (2202)	DC	10 lbs.	☒	☒	☒	☒	☐	
7	2	3	2019	FHC-01 (2324)	DC	10 lbs.	☒	☒	☒	☒	☐	
8	2	3	2019	FHC-02 (2317)	DC	10 lbs.	☒	☒	☒	☒	☐	
9	2	3	2019	FHC-03 (2303)	DC	10 lbs.	☒	☒	☒	☒	☐	
10	2	4	2019	FHC-01 (2424)	DC	10 lbs.	☒	☒	☒	☒	☐	
11	2	4	2019	FHC-02 (2417)	DC	10 lbs.	☒	☒	☒	☒	☐	
12	2	4	2019	FHC-03 (2403)	DC	10 lbs.	☒	☒	☒	☒	☐	
13	2	5	2019	FHC-01 (2524)	DC	10 lbs.	☒	☒	☒	☒	☐	
14	2	5	2019	FHC-02 (2517)	DC	10 lbs.	☒	☒	☒	☒	☐	
15	2	5	2019	FHC-03 (2503)	DC	10 lbs.	☒	☒	☒	☒	☐	
16	2	6	2019	FHC-01 (2624)	DC	10 lbs.	☒	☒	☒	☒	☐	
17	2	6	2019	FHC-02 (2617)	DC	10 lbs.	☒	☒	☒	☒	☐	
18	2	6	2019	FHC-03 (2603)	DC	10 lbs.	☒	☒	☒	☒	☐	
19	2	7	2019	FHC-01 (2724)	DC	10 lbs.	☒	☒	☒	☒	☐	
20	2	7	2019	FHC-02 (2717)	DC	10 lbs.	☒	☒	☒	☒	☐	
21	2	7	2019	FHC-03 (2703)	DC	10 lbs.	☒	☒	☒	☒	☐	

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	21	21	21		
2	CO2	-					
3	Foam	-					
Total					21		

ผู้ตรวจเช็ค

[Redacted Signature]

LPO/LPS

ผู้รับทราบ

[Redacted Signature]

LPM

March 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	3	1	2019	FHC-01 (3112)	DC	10 lbs.	☒	☒	☒	☒	☐	
2	3	1	2019	FHC-02 (3119)	DC	10 lbs.	☒	☒	☒	☒	☐	
3	3	1	2019	FHC-03 (3105)	DC	10 lbs.	☒	☒	☒	☒	☐	
4	3	2	2019	FHC-01 (3226)	DC	10 lbs.	☒	☒	☒	☒	☐	
5	3	2	2019	FHC-02 (3219)	DC	10 lbs.	☒	☒	☒	☒	☐	
6	3	2	2019	FHC-03 (3204)	DC	10 lbs.	☒	☒	☒	☒	☐	
7	3	3	2019	FHC-01 (3326)	DC	10 lbs.	☒	☒	☒	☒	☐	
8	3	3	2019	FHC-02 (3319)	DC	10 lbs.	☒	☒	☒	☒	☐	
9	3	3	2019	FHC-03 (3304)	DC	10 lbs.	☒	☒	☒	☒	☐	
10	3	4	2019	FHC-01 (3426)	DC	10 lbs.	☒	☒	☒	☒	☐	
11	3	4	2020	FHC-02 (3419)	DC	10 lbs.	☒	☒	☒	☒	☐	
12	3	4	2019	FHC-03 (3404)	DC	10 lbs.	☒	☒	☒	☒	☐	
13	3	5	2019	FHC-01 (3526)	DC	10 lbs.	☒	☒	☒	☒	☐	
14	3	5	2021	FHC-02 (3519)	DC	10 lbs.	☒	☒	☒	☒	☐	
15	3	5	2019	FHC-03 (3504)	DC	10 lbs.	☒	☒	☒	☒	☐	
16	3	6	2021	FHC-01 (3626)	DC	10 lbs.	☒	☒	☒	☒	☐	
17	3	6	2020	FHC-02 (3619)	DC	10 lbs.	☒	☒	☒	☒	☐	
18	3	6	2020	FHC-03 (3604)	DC	10 lbs.	☒	☒	☒	☒	☐	
19	3	7	2019	FHC-01 (3726)	DC	10 lbs.	☒	☒	☒	☒	☐	
20	3	7	2019	FHC-02 (3719)	DC	10 lbs.	☒	☒	☒	☒	☐	
21	3	7	2019	FHC-03 (3704)	DC	10 lbs.	☒	☒	☒	☒	☐	

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	21	21	21		
2	CO2	-					
3	Foam	-					
Total					21		

ผู้ตรวจเช็ค

ผู้รับทราบ

[Redacted Signature]

LPO/LPS

[Redacted Signature]

LPM


March 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	4	1	2020	FHC-01 (kid room)	DC	10 lbs.	✓	✓	✓	✓	□	
2	4	1	2019	FHC-02 (fitness room)	DC	10 lbs.	✓	✓	✓	✓	□	สนับสนุนกับถัง
3	4	1	2019	FHC-03 (4105)	DC	10 lbs.	✓	✓	✓	✓	□	
4	4	2	2019	FHC-01 (4226)	DC	10 lbs.	✓	✓	✓	✓	□	
5	4	2	2019	FHC-02 (4219)	DC	10 lbs.	✓	✓	✓	✓	□	
6	4	2	2022	FHC-03 (4204)	DC	10 lbs.	✓	✓	✓	✓	□	
7	4	3	2019	FHC-01 (4326)	DC	10 lbs.	✓	✓	✓	✓	□	
8	4	3	2019	FHC-02 (4319)	DC	10 lbs.	✓	✓	✓	✓	□	
9	4	3	2019	FHC-03 (4304)	DC	10 lbs.	✓	✓	✓	✓	□	
10	4	4	2019	FHC-01 (4426)	DC	10 lbs.	✓	✓	✓	✓	□	
11	4	4	2020	FHC-02 (4419)	DC	10 lbs.	✓	✓	✓	✓	□	
12	4	4	2019	FHC-03 (4404)	DC	10 lbs.	✓	✓	✓	✓	□	
13	4	5	2019	FHC-01 (4526)	DC	10 lbs.	✓	✓	✓	✓	□	
14	4	5	2021	FHC-02 (4519)	DC	10 lbs.	✓	✓	✓	✓	□	
15	4	5	2019	FHC-03 (4504)	DC	10 lbs.	✓	✓	✓	✓	□	
16	4	6	2021	FHC-01 (4626)	DC	10 lbs.	✓	✓	✓	✓	□	
17	4	6	2020	FHC-02 (4619)	DC	10 lbs.	✓	✓	✓	✓	□	
18	4	6	2020	FHC-03 (4604)	DC	10 lbs.	✓	✓	✓	✓	□	
19	4	7	2020	FHC-01 (4726)	DC	10 lbs.	✓	✓	✓	✓	□	
20	4	7	2019	FHC-02 (4719)	DC	10 lbs.	✓	✓	✓	✓	□	
21	4	7	2019	FHC-03 (4704)	DC	10 lbs.	✓	✓	✓	✓	□	
22	4	BM	2019	FHC-01 (4010)	DC	10 lbs.	✓	✓	✓	✓	□	
23	4	BM	2024	Guest (4026)	DC	10 lbs.	✓	✓	✓	✓	□	

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	23	23	23		
2	CO2	-					
3	Foam	-					
Total					23		

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

WYNDHAM[®]
JOMTIEN PATTAYA




WYNDHAM[®]
JOMTIEN PATTAYA

[illegible]

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	10	10	9	1	ถังดับเพลิง Dry Chemical ได้อาคาร 3-1 อยู่ ระหว่างทำการการเสนอเติมน้ำยา
2	CO2	15 lbs.	5	5	5		
3	Foam						
Totel					14	1	

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

March 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1		BM	2019	LD liner store	DR	10 lbs.	☒	☒	☒	☒	☐	
2		BM	2019	FHC.B3.FB/01	DR	10 lbs.	☒	☒	☒	☒	☐	
3		BM	2019	Walk way LP	DR	10 lbs.	☒	☒	☒	☒	☐	
4		BM	2019	FHC.B3.FB/04	DR	10 lbs.	☒	☒	☒	☒	☐	
5		BM	2019	FHC.B3.FB/02	DR	10 lbs.	☒	☒	☒	☒	☐	
6		BM	2019	FHC.B2.FB/02	DR	10 lbs.	☒	☒	☒	☒	☐	
7		BM	2024	Front Store room	DR	15 lbs.	☒	☒	☒	☒	☐	
8		BM	2019	Engineer Store	DR	10 lbs.	☐	☐	☐	☐	☐	อยู่ที่ยอดฟลิซ LP รอเติมน้ำยา
9		BM	2022	Engineer Office	DR	10 lbs.	☒	☒	☒	☒	☐	
10		BM	2024	Front Staff Canteen	DR	15 lbs.	☒	☒	☒	☒	☐	
11		BM	2021	FHC.B2.FB/01	DR	10 lbs.	☒	☒	☒	☒	☐	
12		BM	2019	FHC.B2.FB/03	DR	10 lbs.	☒	☒	☒	☒	☐	
13		BM	2021	FHC.B1.FB/03	DR	10 lbs.	☒	☒	☒	☒	☐	
14		BM	2024	Kitchen canteen	Co2	15 lbs.	☒	☒	☒	☒	☐	
15		BM	2024	Front MK office	DR	15 lbs.	☒	☒	☒	☒	☐	
16		BM	2024	Front IT office	DR	15 lbs.	☒	☒	☒	☒	☐	
17		BM	2024	IT Server	DR	15 lbs.	☒	☒	☒	☒	☐	
18		BM	2024	IT Server	Co2	15 lbs.	☒	☒	☒	☒	☐	
19		BM	2021	FHC.BL.FB/01	DR	10 lbs.	☒	☒	☒	☒	☐	
20		BM	2019	FHC.BL.FB/02	DR	10 lbs.	☒	☒	☒	☒	☐	
21		BM	2019	FHC.B1.FB/01	DR	10 lbs.	☒	☒	☒	☒	☐	
22		BM	2021	FHC.B1.FB/02	DR	10 lbs.	☒	☒	☒	☒	☐	
23		BM	2024	Kitcher 3	Co2	15 lbs.	☒	☒	☒	☒	☐	
24		BM	2022	Kitcher 4	Foam	15 lbs.	☒	☒	☒	☒	☐	
25		BM	2024	Front Fire Pump	DR	15 lbs.	☒	☒	☒	☒	☐	
26		BM	2024	Corridor	DR	15 lbs.	☒	☒	☒	☒	☐	
27		BM	2019	FHC.B3.FB/03	DR	10 lbs.	☐	☐	☐	☐	☐	อยู่ที่ยอดฟลิซ LP รอเติมน้ำยา
28		BM	2020	FHC.B4.FB/02	DR	10 lbs.	☒	☒	☒	☒	☐	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	17	17	15	2	ถังดับเพลิง Dry Chemical อยู่ระหว่างรอการ เสนอคืนน้ำยา
2	Dry Chemical	15 lbs.	7	7	7		
3	CO2	15 lbs.	3	3	3		
	Foam	15 lbs.	1	1	1		
Total					26	2	

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

เดือนเมษายน พ.ศ. 2569

April 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	1	1	2026	FHC-01 (ครัวภัทลวง)	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
2	1	1	2019	FHC-02 (พื้นที่จอดรถ)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	1	2	2019	FHC-01 (1224)	DC	10 lbs.	✓	✓	✓	✓	✓	
4	1	2	2019	FHC-02 (1217)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	1	2	2019	FHC-03 (1202)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	1	3	2019	FHC-01 (1324)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	1	3	2019	FHC-02 (1317)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	1	3	2019	FHC-03 (1303)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	1	4	2019	FHC-01 (1424)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	1	4	2019	FHC-02 (1417)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	1	4	2019	FHC-03 (1403)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	1	5	2019	FHC-01 (1524)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	1	5	2019	FHC-02 (1517)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	1	5	2020	FHC-03 (1503)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	1	6	2020	FHC-01 (1624)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	1	6	2019	FHC-02 (1617)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	1	6	2019	FHC-03 (1603)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	1	7	2019	FHC-01 (1724)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	1	7	2019	FHC-02 (1717)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	1	7	2019	FHC-03 (1703)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	19	19	19	-	
2	CO2	-	-	-	-	-	
3	Foam	-	-	-	-	-	
4	Power Soft	10 lbs.	1	1	1	-	
Total			20		20	-	

ผู้ตรวจเช็ค

ผู้รับทราบ

LPO/LPS

LPM

April 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	2	1	2019	FHC-01 (หน้าลิฟต์พนักงาน)	DC	10 lbs.	✓	✓	✓	✓	✓	
2	2	1	2019	FHC-02 (หน้าห้องแม่เหล็ก)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	2	1	2026	Kitchen (ในครัวลิฟต์)	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
4	2	2	2019	FHC-01 (2224)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	2	2	2019	FHC-02 (2217)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	2	2	2019	FHC-03 (2202)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	2	3	2019	FHC-01 (2324)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	2	3	2019	FHC-02 (2317)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	2	3	2019	FHC-03 (2303)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	2	4	2019	FHC-01 (2424)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	2	4	2019	FHC-02 (2417)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	2	4	2019	FHC-03 (2403)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	2	5	2019	FHC-01 (2524)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	2	5	2019	FHC-02 (2517)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	2	5	2019	FHC-03 (2503)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	2	6	2019	FHC-01 (2624)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	2	6	2019	FHC-02 (2617)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	2	6	2019	FHC-03 (2603)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	2	7	2019	FHC-01 (2724)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	2	7	2019	FHC-02 (2717)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	2	7	2019	FHC-03 (2703)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	20	20	20	-	
2	CO2	-	-	-	-	-	
3	Foam	-	-	-	-	-	
4	Power Soft	10 lbs.	1	1	1	-	
Total			21		21	-	

ผู้ตรวจเช็ค

ผู้รับทราบ



LPM

April 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	3	1	2019	FHC-01 (3112)	DC	10 lbs.	✓	✓	✓	✓	✓	
2	3	1	2019	FHC-02 (3119)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	3	1	2019	FHC-03 (3105)	DC	10 lbs.	✓	✓	✓	✓	✓	
4	3	2	2019	FHC-01 (3226)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	3	2	2019	FHC-02 (3219)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	3	2	2019	FHC-03 (3204)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	3	3	2019	FHC-01 (3326)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	3	3	2019	FHC-02 (3319)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	3	3	2019	FHC-03 (3304)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	3	4	2019	FHC-01 (3426)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	3	4	2020	FHC-02 (3419)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	3	4	2019	FHC-03 (3404)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	3	5	2019	FHC-01 (3526)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	3	5	2021	FHC-02 (3519)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	3	5	2019	FHC-03 (3504)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	3	6	2021	FHC-01 (3626)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	3	6	2020	FHC-02 (3619)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	3	6	2020	FHC-03 (3604)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	3	7	2019	FHC-01 (3726)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	3	7	2019	FHC-02 (3719)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	3	7	2019	FHC-03 (3704)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Report Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	21	21	21	-	
2	CO2	-	-	-	-	-	
3	Foam	-	-	-	-	-	
Total			21		21	-	

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

April 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	4	1	2020	FHC-01 (kid room)	DC	10 lbs.	✓	✓	✓	✓	✓	สนับสนุนกับถัง
2	4	1	2019	FHC-02 (fitness room)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	4	1	2019	FHC-03 (4105)	DC	10 lbs.	✓	✓	✓	✓	✓	
4	4	2	2019	FHC-01 (4226)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	4	2	2019	FHC-02 (4219)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	4	2	2022	FHC-03 (4204)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	4	3	2019	FHC-01 (4326)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	4	3	2019	FHC-02 (4319)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	4	3	2019	FHC-03 (4304)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	4	4	2019	FHC-01 (4426)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	4	4	2020	FHC-02 (4419)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	4	4	2019	FHC-03 (4404)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	4	5	2019	FHC-01 (4526)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	4	5	2021	FHC-02 (4519)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	4	5	2019	FHC-03 (4504)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	4	6	2021	FHC-01 (4626)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	4	6	2020	FHC-02 (4619)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	4	6	2020	FHC-03 (4604)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	4	7	2020	FHC-01 (4726)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	4	7	2019	FHC-02 (4719)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	4	7	2019	FHC-03 (4704)	DC	10 lbs.	✓	✓	✓	✓	✓	
22	4	BM	2019	FHC-01 (4010)	DC	10 lbs.	✓	✓	✓	✓	✓	
23	4	BM	2024	Guest (4026)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Reptot Summary

No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	23	23	23		
2	CO2	-					
3	Foam	-					
Total			23		23		

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

April 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	OT3	OT	2020	ได้อาคาร 3-1	DC	10 lbs.	✓	✓	✓	✓	☐	
2	OT3	OT	2021	ได้อาคาร 3-2	DC	10 lbs.	✓	✓	✓	✓	☐	
3	OT4	OT	2019	Staff Parking - 1	DC	10 lbs.	✓	✓	✓	✓	☐	
4	OT4	OT	2019	Staff Parking - 2	DC	10 lbs.	✓	✓	✓	✓	☐	
5	OT	OT	2024	Gas Station - 1	Co2	15 lbs.	✓	✓	✓	✓	☐	
6	OT	OT	2024	Gas Station - 2	Co2	15 lbs.	✓	✓	✓	✓	☐	
7	OT	OT	2024	Bualuang	Co2	15 lbs.	✓	✓	✓	✓	☐	
8	OT	OT	2024	Bualuang	Co2	15 lbs.	✓	✓	✓	✓	☐	
9	Lb	3	2019	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
10	Lb	3	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
11	Lb	3	2024	Siam Tulip	Co2	15 lbs.	✓	✓	✓	✓	☐	
12	Lb	3	2026	ครัว	Power Soft	10 lbs.	✓	✓	✓	✓	☐	
13	Lb	2	2021	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
14	Lb	2	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
15	Lb	1	2019	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
16	Lb	1	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
17	Lb	1	2026	office FO	Power Soft	10 lbs.	✓	✓	✓	✓	☐	

Fire Extinguisher Inspection Reptot Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	10	10	10	-	
2	CO2	15 lbs.	5	5	5	-	
3	Foam	-					
4	Power Soft	10 lbs.	2	2	2	-	
Total					17	-	

ผู้ตรวจเช็ค

ผู้รับทราบ



LPO/LPS



LPM

April 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1		BM	2019	LD liner store	DC	10 lbs.	☒	☒	☒	☒	☐	
2		BM	2019	FHC.B3.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
3		BM	2026	Walk way LP	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
4		BM	2019	FHC.B3.FB/04	DC	10 lbs.	☒	☒	☒	☒	☐	
5		BM	2019	FHC.B3.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
6		BM	2019	FHC.B2.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
7		BM	2024	Front Store room	DC	15 lbs.	☒	☒	☒	☒	☐	
8		BM	2022	Engineer Office	DC	10 lbs.	☒	☒	☒	☒	☐	
9		BM	2024	Front Staff Canteen	DC	15 lbs.	☒	☒	☒	☒	☐	
10		BM	2021	FHC.B2.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
11		BM	2019	FHC.B2.FB/03	DC	10 lbs.	☒	☒	☒	☒	☐	
12		BM	2021	FHC.B1.FB/03	DC	10 lbs.	☒	☒	☒	☒	☐	
13		BM	2026	Kitchen canteen	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
14		BM	2024	office ACC	Co2	15 lbs.	☒	☒	☒	☒	☐	
15		BM	2024	Front MK office	DC	15 lbs.	☒	☒	☒	☒	☐	
16		BM	2024	Front IT office	DC	15 lbs.	☒	☒	☒	☒	☐	
17		BM	2024	IT Server	Co2	15 lbs.	☒	☒	☒	☒	☐	
18		BM	2021	FHC.BL.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
19		BM	2019	FHC.BL.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
20		BM	2019	FHC.B1.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
21		BM	2021	FHC.B1.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
22		BM	2024	Main Kitcher	Co2	15 lbs.	☒	☒	☒	☒	☐	
23		BM	2022	Main Kitcher	Foam	15 lbs.	☒	☒	☒	☒	☐	
24		BM	2026	Main Kitcher	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
25		BM	2026	Main Kitcher	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
26		BM	2024	Front Fire Pump	DC	15 lbs.	☒	☒	☒	☒	☐	
27		BM	2024	Corridor	DC	15 lbs.	☒	☒	☒	☒	☐	
28		BM	2019	FHC.B3.FB/03	DC	10 lbs.	☒	☒	☒	☒	☐	
29		BM	2020	FHC.B4.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Total	Operating condition		Remark
					Normal	Not normal	
1	Dry Chemical	10 lbs.	15	15	15	-	
2	Dry Chemical	15 lbs.	6	6	6	-	
3	CO2	15 lbs.	3	3	3	-	
4	Foam	15 lbs.	1	1	1	-	
5	Power Soft	10 lbs.	4	4	4	-	
Total			29		29	-	

ผู้ตรวจเช็ค



LPO/LFS

ผู้รับทราบ



LPM

Fire Extinguisher Inspection Reprot Summary of April 2026

Fire Extinguisher Inspection Outer & Lobby&Basement					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	16	16	
	2020	10 lbs.	2	2	
	2021	10 lbs.	6	6	
	2022	10 lbs.	1	1	
	2024	10 lbs.	-	-	
	2024	15 lbs.	6	6	
CO2	2024	15 lbs.	8	8	
Foam	2022	15 lbs.	1	1	
Power Soft	2026	10 lbs.	6	6	
Total			46	46	

Fire Extinguisher Inspection Building 1					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	17	17	
	2020	10 lbs.	2	2	
	2021	10 lbs.	-	-	
	2022	10 lbs.	-	-	
	2024	10 lbs.	-	-	
	2024	15 lbs.	-	-	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	1	1	
Total			20	20	

Fire Extinguisher Inspection Building 2					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	20	20	
	2020	10 lbs.	-	-	
	2021	10 lbs.	-	-	
	2022	10 lbs.	-	-	
	2024	10 lbs.	-	-	
	2024	15 lbs.	-	-	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	1	1	
Total			21	21	

Fire Extinguisher Inspection Building 3					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	16	16	
	2020	10 lbs.	3	3	
	2021	10 lbs.	2	2	
	2022	10 lbs.	-	-	
	2024	10 lbs.	-	-	
	2024	15 lbs.	-	-	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	-	-	
Total			21	21	

Fire Extinguisher Inspection Building 4					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	14	14	
	2020	10 lbs.	5	5	
	2021	10 lbs.	2	2	
	2022	10 lbs.	1	1	
	2024	10 lbs.	-	-	
	2024	15 lbs.	1	1	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	-	-	
Total			23	23	

Fire Extinguisher Inspection Reprot Summary					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	83	83	
	2020	10 lbs.	12	12	
	2021	10 lbs.	10	10	
	2022	10 lbs.	2	2	
	2024	10 lbs.	-	0	
	2024	15 lbs.	8	8	
CO2		15 lbs.	8	8	
Foam		15 lbs.	1	1	
Power Soft	2026	10 lbs.	8	8	
Total			132	132	
Dry Chemical			Total	115	
CO2			Total	8	
Foam			Total	1	
Power Soft			Total	8	
Total all				132	

Remark
1.ถังดับเพลิงทุกชนิดมีการใช้งานมานานแล้วมีถังของปี 2019 และ 2020 และยังไม่ได้รับการตรวจสอบที่กฎหมายกำหนดการทดสอบสภาพและแรงดันของถังจะต้อง ดำเนินการทุกๆ 5 ปีตามกฎหมายกำหนด 2.รายการเสนอเติมน้ำยาของผู้ถือฟิค LP จำนวน 5 ถัง

สำรอง				
	Quantity	Normal	Not normal	Total
Dry Chemical	7	2	5	7
Power Soft	2	2	0	2
Total				9

ผู้ตรวจเช็ค

.....22...../.....4...../.....69.....

ผู้รับรอง

.....22...../.....4...../.....69.....

ผู้

LPM

.....22...../.....4...../.....69.....

เดือนพฤษภาคม พ.ศ. 2569

Fire Extinguisher Inspection Reprot Summary of May 2026

Fire Extinguisher Inspection Outer & Lobby&Basement					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	16	16	
	2020	10 lbs.	2	2	
	2021	10 lbs.	6	6	
	2022	10 lbs.	1	1	
	2024	10 lbs.	-	-	
	2024	15 lbs.	6	6	
CO2	2024	15 lbs.	8	8	
Foam	2022	15 lbs.	1	1	
Power Soft	2026	10 lbs.	6	6	
Total			46	46	

Fire Extinguisher Inspection Building 1					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	17	17	
	2020	10 lbs.	2	2	
	2021	10 lbs.	-	-	
	2022	10 lbs.	-	-	
	2024	10 lbs.	-	-	
	2024	15 lbs.	-	-	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	1	1	
Total			20	20	

Fire Extinguisher Inspection Building 2					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	20	20	
	2020	10 lbs.	-	-	
	2021	10 lbs.	-	-	
	2022	10 lbs.	-	-	
	2024	10 lbs.	-	-	
	2024	15 lbs.	-	-	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	1	1	
Total			21	21	

Fire Extinguisher Inspection Building 3					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	16	16	
	2020	10 lbs.	3	3	
	2021	10 lbs.	2	2	
	2022	10 lbs.	-	-	
	2024	10 lbs.	-	-	
	2024	15 lbs.	-	-	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	-	-	
Total			21	21	

Fire Extinguisher Inspection Building 4					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	14	14	
	2020	10 lbs.	5	5	
	2021	10 lbs.	2	2	
	2022	10 lbs.	1	1	
	2024	10 lbs.	-	-	
	2024	15 lbs.	1	1	
CO2		15 lbs.	-	-	
Foam		15 lbs.	-	-	
Power Soft	2026	10 lbs.	-	-	
Total			23	23	

Fire Extinguisher Inspection Reprot Summary					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	83	83	
	2020	10 lbs.	12	12	
	2021	10 lbs.	10	10	
	2022	10 lbs.	2	2	
	2024	10 lbs.	-	-	
	2024	15 lbs.	8	8	
CO2		15 lbs.	8	8	
Foam		15 lbs.	1	1	
Power Soft	2026	10 lbs.	8	8	
Total			132	132	
Dry Chemical			Total	115	
CO2			Total	8	
Foam			Total	1	
Power Soft			Total	8	
Total all				132	

Remark
1.ถึงคัมเพลิงทุกชนิดมีการใช้งานมานานแล้วมีถึงของปี 2019 และ 2020 และยังไม่ผ่านการตรวจสอบที่กฎหมายกำหนดการทดสอบสภาพและแรงดันของถังจะต้องดำเนินการทุกๆ 5 ปีตามกฎหมายกำหนด
2.รายการเสนอเติมน้ำยาอยู่ที่ออฟฟิศ LP จำนวน 5 ถัง

สำรวจ				
	Quantity	Normal	Not normal	Total
Dry Chemical	7	2	5	7
Power Soft	1	1	0	1
Total				8

ผู้ตรวจเช็ค




.....20...../.....5...../.....69.....

ผู้รับรอง

จป.วิชาชีพ
...../...../.....

ณ.52

ผู้รับทราบ

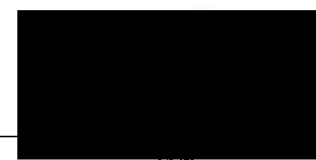

.....20...../.....5...../.....69.....

May 2026


No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1	1	1	2026	FHC-01 (ครัวภัทลวง)	Power Soft	10 lbs.	✓	✓	✓	✓	□	
2	1	1	2019	FHC-02 (พื้นที่จอดรถ)	DC	10 lbs.	✓	✓	✓	✓	□	
3	1	2	2019	FHC-01 (1224)	DC	10 lbs.	✓	✓	✓	✓	□	
4	1	2	2019	FHC-02 (1217)	DC	10 lbs.	✓	✓	✓	✓	□	
5	1	2	2019	FHC-03 (1202)	DC	10 lbs.	✓	✓	✓	✓	□	
6	1	3	2019	FHC-01 (1324)	DC	10 lbs.	✓	✓	✓	✓	□	
7	1	3	2019	FHC-02 (1317)	DC	10 lbs.	✓	✓	✓	✓	□	
8	1	3	2019	FHC-03 (1303)	DC	10 lbs.	✓	✓	✓	✓	□	
9	1	4	2019	FHC-01 (1424)	DC	10 lbs.	✓	✓	✓	✓	□	
10	1	4	2019	FHC-02 (1417)	DC	10 lbs.	✓	✓	✓	✓	□	
11	1	4	2019	FHC-03 (1403)	DC	10 lbs.	✓	✓	✓	✓	□	
12	1	5	2019	FHC-01 (1524)	DC	10 lbs.	✓	✓	✓	✓	□	
13	1	5	2019	FHC-02 (1517)	DC	10 lbs.	✓	✓	✓	✓	□	
14	1	5	2020	FHC-03 (1503)	DC	10 lbs.	✓	✓	✓	✓	□	
15	1	6	2020	FHC-01 (1624)	DC	10 lbs.	✓	✓	✓	✓	□	
16	1	6	2019	FHC-02 (1617)	DC	10 lbs.	✓	✓	✓	✓	□	
17	1	6	2019	FHC-03 (1603)	DC	10 lbs.	✓	✓	✓	✓	□	
18	1	7	2019	FHC-01 (1724)	DC	10 lbs.	✓	✓	✓	✓	□	
19	1	7	2019	FHC-02 (1717)	DC	10 lbs.	✓	✓	✓	✓	□	
20	1	7	2019	FHC-03 (1703)	DC	10 lbs.	✓	✓	✓	✓	□	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	19	19		
2	CO2	-	-	-		
3	Foam	-	-	-		
4	Power Soft	10 lbs.	1	1		
Total			20	20		

ผู้ตรวจเช็ค

ผู้รับทราบ



LPM

May 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	2	1	2019	FHC-01 (หน้าลิฟต์พนักงาน)	DC	10 lbs.	✓	✓	✓	✓	✓	
2	2	1	2019	FHC-02 (หน้าห้องแม่เหล็ก)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	2	1	2026	Kitchen (ในครัวลิฟต์)	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
4	2	2	2019	FHC-01 (2224)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	2	2	2019	FHC-02 (2217)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	2	2	2019	FHC-03 (2202)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	2	3	2019	FHC-01 (2324)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	2	3	2019	FHC-02 (2317)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	2	3	2019	FHC-03 (2303)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	2	4	2019	FHC-01 (2424)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	2	4	2019	FHC-02 (2417)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	2	4	2019	FHC-03 (2403)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	2	5	2019	FHC-01 (2524)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	2	5	2019	FHC-02 (2517)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	2	5	2019	FHC-03 (2503)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	2	6	2019	FHC-01 (2624)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	2	6	2019	FHC-02 (2617)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	2	6	2019	FHC-03 (2603)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	2	7	2019	FHC-01 (2724)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	2	7	2019	FHC-02 (2717)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	2	7	2019	FHC-03 (2703)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	20	20		
2	CO2	-	-	-		
3	Foam	-	-	-		
4	Power Soft	10 lbs.	1	1		
Total			21	21		

ผู้ตรวจเช็ค

ผู้รับทราบ




May 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	3	1	2019	FHC-01 (3112)	DC	10 lbs.	✓	✓	✓	✓	✓	
2	3	1	2019	FHC-02 (3119)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	3	1	2019	FHC-03 (3105)	DC	10 lbs.	✓	✓	✓	✓	✓	
4	3	2	2019	FHC-01 (3226)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	3	2	2019	FHC-02 (3219)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	3	2	2019	FHC-03 (3204)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	3	3	2019	FHC-01 (3326)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	3	3	2019	FHC-02 (3319)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	3	3	2019	FHC-03 (3304)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	3	4	2019	FHC-01 (3426)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	3	4	2020	FHC-02 (3419)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	3	4	2019	FHC-03 (3404)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	3	5	2019	FHC-01 (3526)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	3	5	2021	FHC-02 (3519)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	3	5	2019	FHC-03 (3504)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	3	6	2021	FHC-01 (3626)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	3	6	2020	FHC-02 (3619)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	3	6	2020	FHC-03 (3604)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	3	7	2019	FHC-01 (3726)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	3	7	2019	FHC-02 (3719)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	3	7	2019	FHC-03 (3704)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary


No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	21	21		
2	CO2	-	-	-		
3	Foam	-	-	-		
Total			21	21		

ผู้ตรวจเช็ค

ผู้รับทราบ



LPO/LPS



May 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	4	1	2020	FHC-01 (kid room)	DC	10 lbs.	✓	✓	✓	✓	✓	สถานีเก็บถัง
2	4	1	2019	FHC-02 (fitness room)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	4	1	2019	FHC-03 (4105)	DC	10 lbs.	✓	✓	✓	✓	✓	
4	4	2	2019	FHC-01 (4226)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	4	2	2019	FHC-02 (4219)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	4	2	2022	FHC-03 (4204)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	4	3	2019	FHC-01 (4326)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	4	3	2019	FHC-02 (4319)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	4	3	2019	FHC-03 (4304)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	4	4	2019	FHC-01 (4426)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	4	4	2020	FHC-02 (4419)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	4	4	2019	FHC-03 (4404)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	4	5	2019	FHC-01 (4526)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	4	5	2021	FHC-02 (4519)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	4	5	2019	FHC-03 (4504)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	4	6	2021	FHC-01 (4626)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	4	6	2020	FHC-02 (4619)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	4	6	2020	FHC-03 (4604)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	4	7	2020	FHC-01 (4726)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	4	7	2019	FHC-02 (4719)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	4	7	2019	FHC-03 (4704)	DC	10 lbs.	✓	✓	✓	✓	✓	
22	4	BM	2019	FHC-01 (4010)	DC	10 lbs.	✓	✓	✓	✓	✓	
23	4	BM	2024	Guest (4026)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	23	23		
2	CO2	-	-	-		
3	Foam	-	-	-		
Total			23	23		

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

May 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	OT3	OT	2020	ได้อาคาร 3-1	DC	10 lbs.	✓	✓	✓	✓	☐	
2	OT3	OT	2021	ได้อาคาร 3-2	DC	10 lbs.	✓	✓	✓	✓	☐	
3	OT4	OT	2019	Staff Parking - 1	DC	10 lbs.	✓	✓	✓	✓	☐	
4	OT4	OT	2019	Staff Parking - 2	DC	10 lbs.	✓	✓	✓	✓	☐	
5	OT	OT	2024	Gas Station - 1	Co2	15 lbs.	✓	✓	✓	✓	☐	
6	OT	OT	2024	Gas Station - 2	Co2	15 lbs.	✓	✓	✓	✓	☐	
7	OT	OT	2024	Bualuang	Co2	15 lbs.	✓	✓	✓	✓	☐	
8	OT	OT	2024	Bualuang	Co2	15 lbs.	✓	✓	✓	✓	☐	
9	Lb	3	2019	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
10	Lb	3	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
11	Lb	3	2024	Siam Tulip	Co2	15 lbs.	✓	✓	✓	✓	☐	
12	Lb	3	2026	ครัว	Power Soft	10 lbs.	✓	✓	✓	✓	☐	
13	Lb	2	2021	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
14	Lb	2	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
15	Lb	1	2019	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
16	Lb	1	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
17	Lb	1	2026	office FO	Power Soft	10 lbs.	✓	✓	✓	✓	☐	

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	10	10		
2	CO2	15 lbs.	5	5		
3	Foam	-	-	-		
4	Power Soft	10 lbs.	2	2		
Total			17	17		

ผู้ตรวจเช็ค

ผู้รับทราบ



LPM



LPM

May 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1		BM	2019	LD liner store	DC	10 lbs.	☒	☒	☒	☒	☐	
2		BM	2019	FHC.B3.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
3		BM	2026	Walk way LP	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
4		BM	2019	FHC.B3.FB/04	DC	10 lbs.	☒	☒	☒	☒	☐	
5		BM	2019	FHC.B3.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
6		BM	2019	FHC.B2.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
7		BM	2024	Front Store room	DC	15 lbs.	☒	☒	☒	☒	☐	
8		BM	2022	Engineer Office	DC	10 lbs.	☒	☒	☒	☒	☐	
9		BM	2024	Front Staff Canteen	DC	15 lbs.	☒	☒	☒	☒	☐	
10		BM	2021	FHC.B2.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
11		BM	2019	FHC.B2.FB/03	DC	10 lbs.	☒	☒	☒	☒	☐	
12		BM	2021	FHC.B1.FB/03	DC	10 lbs.	☒	☒	☒	☒	☐	
13		BM	2026	Kitchen canteen	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
14		BM	2024	office ACC	Co2	15 lbs.	☒	☒	☒	☒	☐	
15		BM	2024	Front MK office	DC	15 lbs.	☒	☒	☒	☒	☐	
16		BM	2024	Front IT office	DC	15 lbs.	☒	☒	☒	☒	☐	
17		BM	2024	IT Server	Co2	15 lbs.	☒	☒	☒	☒	☐	
18		BM	2021	FHC.BL.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
19		BM	2019	FHC.BL.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
20		BM	2019	FHC.B1.FB/01	DC	10 lbs.	☒	☒	☒	☒	☐	
21		BM	2021	FHC.B1.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	
22		BM	2024	Main Kitcher	Co2	15 lbs.	☒	☒	☒	☒	☐	
23		BM	2022	Main Kitcher	Foam	15 lbs.	☒	☒	☒	☒	☐	
24		BM	2026	Main Kitcher	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
25		BM	2026	Main Kitcher	Power Soft	10 lbs.	☒	☒	☒	☒	☐	
26		BM	2024	Front Fire Pump	DC	15 lbs.	☒	☒	☒	☒	☐	
27		BM	2024	Corridor	DC	15 lbs.	☒	☒	☒	☒	☐	
28		BM	2019	FHC.B3.FB/03	DC	10 lbs.	☒	☒	☒	☒	☐	
29		BM	2020	FHC.B4.FB/02	DC	10 lbs.	☒	☒	☒	☒	☐	

Fire Extinguisher Inspection Reprot Summary


No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	15	15		
2	Dry Chemical	15 lbs.	6	6		
3	CO2	15 lbs.	3	3		
4	Foam	15 lbs.	1	1		
5	Power Soft	10 lbs.	4	4		
Totel			29	29		

ผู้ตรวจเช็ค



LPO/LFS

ผู้รับทราบ



LPM

เดือนมิถุนายน พ.ศ. 2569

Fire Extinguisher Inspection Rept Summary of June 2026

Fire Extinguisher Inspection Outer & Lobby&Basement					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	17	17	-
	2020	10 lbs.	2	2	-
	2021	10 lbs.	6	6	-
	2022	10 lbs.	1	1	-
	2024	10 lbs.	-	-	-
	2024	15 lbs.	7	7	-
CO2	2024	15 lbs.	8	8	-
Foam	2022	15 lbs.	1	1	-
Power Soft	2026	10 lbs.	6	6	-
Total			48	48	-

Fire Extinguisher Inspection Building 1					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	17	17	-
	2020	10 lbs.	2	2	-
	2021	10 lbs.	-	-	-
	2022	10 lbs.	-	-	-
	2024	10 lbs.	-	-	-
	2024	15 lbs.	-	-	-
CO2		15 lbs.	-	-	-
Foam		15 lbs.	-	-	-
Power Soft	2026	10 lbs.	1	1	-
Total			20	20	-

Fire Extinguisher Inspection Building 2					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	20	20	-
	2020	10 lbs.	-	-	-
	2021	10 lbs.	-	-	-
	2022	10 lbs.	-	-	-
	2024	10 lbs.	-	-	-
	2024	15 lbs.	-	-	-
CO2		15 lbs.	-	-	-
Foam		15 lbs.	-	-	-
Power Soft	2026	10 lbs.	1	1	-
Total			21	21	-

Fire Extinguisher Inspection Building 3					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	16	16	-
	2020	10 lbs.	3	3	-
	2021	10 lbs.	2	2	-
	2022	10 lbs.	-	-	-
	2024	10 lbs.	-	-	-
	2024	15 lbs.	-	-	-
CO2		15 lbs.	-	-	-
Foam		15 lbs.	-	-	-
Power Soft	2026	10 lbs.	-	-	-
Total			21	21	-

Fire Extinguisher Inspection Building 4					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	14	14	-
	2020	10 lbs.	5	5	-
	2021	10 lbs.	2	2	-
	2022	10 lbs.	1	1	-
	2024	10 lbs.	-	-	-
	2024	15 lbs.	1	1	-
CO2		15 lbs.	-	-	-
Foam		15 lbs.	-	-	-
Power Soft	2026	10 lbs.	-	-	-
Total			23	23	-

Fire Extinguisher Inspection Rept Summary					
Type	Year	Size	Quantity	Operating condition	
				Normal	Not normal
Dry Chemical	2019	10 lbs.	84	84	-
	2020	10 lbs.	12	12	-
	2021	10 lbs.	10	10	-
	2022	10 lbs.	2	2	-
	2024	10 lbs.	-	0	-
	2024	15 lbs.	8	8	-
CO2		15 lbs.	8	8	-
Foam		15 lbs.	1	1	-
Power Soft	2026	10 lbs.	8	8	-
Total			133	133	-
Dry Chemical			Total	116	
CO2			Total	8	
Foam			Total	1	
Power Soft			Total	8	
Total all				133	

Remark
1.ถึงคัมเพลิงทุกชนิดมีการใช้งานมานานแล้วมีถึงของปี 2019 และ 2020 และยังไม่ผ่านการตรวจสอบที่กฎหมายกำหนดการทดสอบสภาพและแรงดันของถังจะต้องดำเนินการทุกๆ 5 ปีตามกฎหมายที่กำหนด
2.รายการเสนอเติมน้ำยาอยู่ที่ออฟฟิศ LP จำนวน 5 ถัง

สำรวจ				
	Quantity	Normal	Not normal	Total
Dry Chemical	5	0	5	5
Power Soft	1	1	0	1
Total				6

ผู้ตรวจเช็ค

[Redacted Signature]

LPG/LPS
26/6/69

ผู้รับรอง

จป.วิชาชีพ
...../...../.....

ณ.59

ผู้รับทราบ

[Redacted Signature]

LPM
26/6/69

June 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	1	1	2026	FHC-01 (ครัวภัทลวง)	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
2	1	1	2019	FHC-02 (พื้นที่จอดรถ)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	1	2	2019	FHC-01 (1224)	DC	10 lbs.	✓	✓	✓	✓	✓	
4	1	2	2019	FHC-02 (1217)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	1	2	2019	FHC-03 (1202)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	1	3	2019	FHC-01 (1324)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	1	3	2019	FHC-02 (1317)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	1	3	2019	FHC-03 (1303)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	1	4	2019	FHC-01 (1424)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	1	4	2019	FHC-02 (1417)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	1	4	2019	FHC-03 (1403)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	1	5	2019	FHC-01 (1524)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	1	5	2019	FHC-02 (1517)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	1	5	2020	FHC-03 (1503)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	1	6	2020	FHC-01 (1624)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	1	6	2019	FHC-02 (1617)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	1	6	2019	FHC-03 (1603)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	1	7	2019	FHC-01 (1724)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	1	7	2019	FHC-02 (1717)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	1	7	2019	FHC-03 (1703)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary


No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	19	19	-	
2	CO2	-	-	-	-	
3	Foam	-	-	-	-	
4	Power Soft	10 lbs.	1	1	-	
Total			20	20	-	

ผู้ตรวจเช็ค

ผู้รับทราบ



LPO/LPS



LPM

June 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	2	1	2019	FHC-01 (หน้าลิฟต์พนักงาน)	DC	10 lbs.	✓	✓	✓	✓	✓	
2	2	1	2019	FHC-02 (หน้าห้องแม่เหล็ก)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	2	1	2026	Kitchen (ในครัวลิฟต์)	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
4	2	2	2019	FHC-01 (2224)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	2	2	2019	FHC-02 (2217)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	2	2	2019	FHC-03 (2202)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	2	3	2019	FHC-01 (2324)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	2	3	2019	FHC-02 (2317)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	2	3	2019	FHC-03 (2303)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	2	4	2019	FHC-01 (2424)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	2	4	2019	FHC-02 (2417)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	2	4	2019	FHC-03 (2403)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	2	5	2019	FHC-01 (2524)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	2	5	2019	FHC-02 (2517)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	2	5	2019	FHC-03 (2503)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	2	6	2019	FHC-01 (2624)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	2	6	2019	FHC-02 (2617)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	2	6	2019	FHC-03 (2603)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	2	7	2019	FHC-01 (2724)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	2	7	2019	FHC-02 (2717)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	2	7	2019	FHC-03 (2703)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	20	20	-	
2	CO2	-	-	-	-	
3	Foam	-	-	-	-	
4	Power Soft	10 lbs.	1	1	-	
Total			21	21	-	

ผู้ตรวจเช็ค

ผู้รับทราบ

LPO/LPS

LPM

June 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	3	1	2019	FHC-01 (3112)	DC	10 lbs.	✓	✓	✓	✓	✓	
2	3	1	2019	FHC-02 (3119)	DC	10 lbs.	✓	✓	✓	✓	✓	
3	3	1	2019	FHC-03 (3105)	DC	10 lbs.	✓	✓	✓	✓	✓	
4	3	2	2019	FHC-01 (3226)	DC	10 lbs.	✓	✓	✓	✓	✓	
5	3	2	2019	FHC-02 (3219)	DC	10 lbs.	✓	✓	✓	✓	✓	
6	3	2	2019	FHC-03 (3204)	DC	10 lbs.	✓	✓	✓	✓	✓	
7	3	3	2019	FHC-01 (3326)	DC	10 lbs.	✓	✓	✓	✓	✓	
8	3	3	2019	FHC-02 (3319)	DC	10 lbs.	✓	✓	✓	✓	✓	
9	3	3	2019	FHC-03 (3304)	DC	10 lbs.	✓	✓	✓	✓	✓	
10	3	4	2019	FHC-01 (3426)	DC	10 lbs.	✓	✓	✓	✓	✓	
11	3	4	2020	FHC-02 (3419)	DC	10 lbs.	✓	✓	✓	✓	✓	
12	3	4	2019	FHC-03 (3404)	DC	10 lbs.	✓	✓	✓	✓	✓	
13	3	5	2019	FHC-01 (3526)	DC	10 lbs.	✓	✓	✓	✓	✓	
14	3	5	2021	FHC-02 (3519)	DC	10 lbs.	✓	✓	✓	✓	✓	
15	3	5	2019	FHC-03 (3504)	DC	10 lbs.	✓	✓	✓	✓	✓	
16	3	6	2021	FHC-01 (3626)	DC	10 lbs.	✓	✓	✓	✓	✓	
17	3	6	2020	FHC-02 (3619)	DC	10 lbs.	✓	✓	✓	✓	✓	
18	3	6	2020	FHC-03 (3604)	DC	10 lbs.	✓	✓	✓	✓	✓	
19	3	7	2019	FHC-01 (3726)	DC	10 lbs.	✓	✓	✓	✓	✓	
20	3	7	2019	FHC-02 (3719)	DC	10 lbs.	✓	✓	✓	✓	✓	
21	3	7	2019	FHC-03 (3704)	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Rept Summary

No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	21	21	-	
2	CO2	-	-	-	-	
3	Foam	-	-	-	-	
Total			21	21	-	

ผู้ตรวจเช็ค



LPO/LPS

ผู้รับทราบ



LPM

June 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detacke	
1	4	1	2020	FHC-01 (kid room)	DC	10 lbs.	✓	✓	✓	✓	□	สถานีขึ้นบันได
2	4	1	2019	FHC-02 (fitness room)	DC	10 lbs.	✓	✓	✓	✓	□	
3	4	1	2019	FHC-03 (4105)	DC	10 lbs.	✓	✓	✓	✓	□	
4	4	2	2019	FHC-01 (4226)	DC	10 lbs.	✓	✓	✓	✓	□	
5	4	2	2019	FHC-02 (4219)	DC	10 lbs.	✓	✓	✓	✓	□	
6	4	2	2022	FHC-03 (4204)	DC	10 lbs.	✓	✓	✓	✓	□	
7	4	3	2019	FHC-01 (4326)	DC	10 lbs.	✓	✓	✓	✓	□	
8	4	3	2019	FHC-02 (4319)	DC	10 lbs.	✓	✓	✓	✓	□	
9	4	3	2019	FHC-03 (4304)	DC	10 lbs.	✓	✓	✓	✓	□	
10	4	4	2019	FHC-01 (4426)	DC	10 lbs.	✓	✓	✓	✓	□	
11	4	4	2020	FHC-02 (4419)	DC	10 lbs.	✓	✓	✓	✓	□	
12	4	4	2019	FHC-03 (4404)	DC	10 lbs.	✓	✓	✓	✓	□	
13	4	5	2019	FHC-01 (4526)	DC	10 lbs.	✓	✓	✓	✓	□	
14	4	5	2021	FHC-02 (4519)	DC	10 lbs.	✓	✓	✓	✓	□	
15	4	5	2019	FHC-03 (4504)	DC	10 lbs.	✓	✓	✓	✓	□	
16	4	6	2021	FHC-01 (4626)	DC	10 lbs.	✓	✓	✓	✓	□	
17	4	6	2020	FHC-02 (4619)	DC	10 lbs.	✓	✓	✓	✓	□	
18	4	6	2020	FHC-03 (4604)	DC	10 lbs.	✓	✓	✓	✓	□	
19	4	7	2020	FHC-01 (4726)	DC	10 lbs.	✓	✓	✓	✓	□	
20	4	7	2019	FHC-02 (4719)	DC	10 lbs.	✓	✓	✓	✓	□	
21	4	7	2019	FHC-03 (4704)	DC	10 lbs.	✓	✓	✓	✓	□	
22	4	BM	2019	FHC-01 (4010)	DC	10 lbs.	✓	✓	✓	✓	□	
23	4	BM	2024	Guest (4026)	DC	10 lbs.	✓	✓	✓	✓	□	

Fire Extinguisher Inspection Reprot Summary

No.	Type	Size	Quantity	Operating condition		Remark
				Normal		
1	Dry Chemical	10 lbs.	23	23	-	สถานีขึ้นบันได
2	CO2	-	-	-	-	
3	Foam	-	-	-	-	
Total			23	23	-	

ผู้ตรวจเช็ค

ผู้รับทราบ


 LFO/LPS


 LPM

June 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Detache	
1	OT3	OT	2020	ได้อาคาร 3-1	DC	10 lbs.	✓	✓	✓	✓	☐	
2	OT3	OT	2021	ได้อาคาร 3-2	DC	10 lbs.	✓	✓	✓	✓	☐	
3	OT4	OT	2019	Staff Parking - 1	DC	10 lbs.	✓	✓	✓	✓	☐	
4	OT4	OT	2019	Staff Parking - 2	DC	10 lbs.	✓	✓	✓	✓	☐	
5	OT	OT	2024	Gas Station - 1	Co2	15 lbs.	✓	✓	✓	✓	☐	
6	OT	OT	2024	Gas Station - 2	Co2	15 lbs.	✓	✓	✓	✓	☐	
7	OT	OT	2024	Bualuang	Co2	15 lbs.	✓	✓	✓	✓	☐	
8	OT	OT	2024	Bualuang	Co2	15 lbs.	✓	✓	✓	✓	☐	
9	Lb	3	2019	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
10	Lb	3	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
11	Lb	3	2024	Siam Tulip	Co2	15 lbs.	✓	✓	✓	✓	☐	
12	Lb	3	2026	ครัว	Power Soft	10 lbs.	✓	✓	✓	✓	☐	
13	Lb	2	2021	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
14	Lb	2	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
15	Lb	1	2019	FHC1	DC	10 lbs.	✓	✓	✓	✓	☐	
16	Lb	1	2019	FHC2	DC	10 lbs.	✓	✓	✓	✓	☐	
17	Lb	1	2026	office FO	Power Soft	10 lbs.	✓	✓	✓	✓	☐	

Fire Extinguisher Inspection Reptot Summary


No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	10	10	-	
2	CO2	15 lbs.	5	5	-	
3	Foam	-	-	-	-	
4	Power Soft	10 lbs.	2	2	-	
Total			17	17	-	

ผู้ตรวจเช็ค

ผู้รับทราบ



LPO/LPS



LPM

June 2026

No.	Building	Details of Fire Extinguisher					Inspection Criteria					Details
		Floor	Year	Location	Type	Size	Hose	Lever	Cylinder	Pressure Gauge/Weight	Obstacle	
1		BM	2019	LD liner store	DC	10 lbs.	✓	✓	✓	✓	✓	
2		BM	2019	FHC.B3.FB/01	DC	10 lbs.	✓	✓	✓	✓	✓	
3		BM	2026	Walk way LP	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
4		BM	2019	FHC.B3.FB/04	DC	10 lbs.	✓	✓	✓	✓	✓	
5		BM	2019	FHC.B3.FB/02	DC	10 lbs.	✓	✓	✓	✓	✓	
6		BM	2019	FHC.B2.FB/02	DC	10 lbs.	✓	✓	✓	✓	✓	
7		BM	2024	Front Store room	DC	15 lbs.	✓	✓	✓	✓	✓	
8		BM	2022	Engineer Office	DC	10 lbs.	✓	✓	✓	✓	✓	
9		BM	2024	Front Staff Canteen	DC	15 lbs.	✓	✓	✓	✓	✓	
10		BM	2021	FHC.B2.FB/01	DC	10 lbs.	✓	✓	✓	✓	✓	
11		BM	2019	FHC.B2.FB/03	DC	10 lbs.	✓	✓	✓	✓	✓	
12		BM	2021	FHC.B1.FB/03	DC	10 lbs.	✓	✓	✓	✓	✓	
13		BM	2026	Kitchen canteen	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
14		BM	2024	office ACC	Co2	15 lbs.	✓	✓	✓	✓	✓	
15		BM	2024	Front MK office	DC	15 lbs.	✓	✓	✓	✓	✓	
16		BM	2024	Front IT office	DC	15 lbs.	✓	✓	✓	✓	✓	
17		BM	2024	IT Server	Co2	15 lbs.	✓	✓	✓	✓	✓	
18		BM	2021	FHC.B1.FB/01	DC	10 lbs.	✓	✓	✓	✓	✓	
19		BM	2019	หลังคาอาคาร 1	DC	10 lbs.	✓	✓	✓	✓	✓	
20		BM	2024	ชุดทางเดินห้องเครื่องปรับอากาศ	DC	15 lbs.	✓	✓	✓	✓	✓	
21		BM	2019	FHC.B1.FB/02	DC	10 lbs.	✓	✓	✓	✓	✓	
22		BM	2019	FHC.B1.FB/01	DC	10 lbs.	✓	✓	✓	✓	✓	
23		BM	2021	FHC.B1.FB/02	DC	10 lbs.	✓	✓	✓	✓	✓	
24		BM	2024	Main Kitchen	Co2	15 lbs.	✓	✓	✓	✓	✓	
25		BM	2022	Main Kitchen	Foam	15 lbs.	✓	✓	✓	✓	✓	
26		BM	2026	Main Kitchen	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
27		BM	2026	Main Kitchen	Power Soft	10 lbs.	✓	✓	✓	✓	✓	
28		BM	2024	Front Fire Pump	DC	15 lbs.	✓	✓	✓	✓	✓	
29		BM	2024	Corridor	DC	15 lbs.	✓	✓	✓	✓	✓	
30		BM	2019	FHC.B3.FB/03	DC	10 lbs.	✓	✓	✓	✓	✓	
31		BM	2020	FHC.B4.FB/02	DC	10 lbs.	✓	✓	✓	✓	✓	

Fire Extinguisher Inspection Reptot Summary


No.	Type	Size	Quantity	Operating condition		Remark
				Normal	Not normal	
1	Dry Chemical	10 lbs.	16	16	-	
2	Dry Chemical	15 lbs.	7	7	-	
3	CO2	15 lbs.	3	3	-	
4	Foam	15 lbs.	1	1	-	
5	Power Soft	10 lbs.	4	4	-	
Totel			31	31	-	

ผู้ตรวจเช็ค

ผู้รับทราบ



LPO/LPS



LPM

ภาคผนวก ญ.

ใบเสร็จชำระเงินค่าสิ่งปลูก
ประจำปี พ.ศ. 2569

เล่มที่.....

เลขที่.....

顧客 寶號
CUSTOMER

บริษัท วัฒนาอินทผลูน จำกัด แอ้งง้า จำกัด

DATE _____

07/01/69

เดบิประจำตัวบัญชีภาษี TAXPAPERS LD.

ที่อยู่ 住址
ADDRESS

๓๕๕,๕๕๕/๑ ส.๑ ส.๑๐๑๐๑๐๑๐๑ ส.๑๐๑๐๑๐๑๐๑ ๑.๕๕๕๕ ๒๐๒๕๐ ๐๑๐๕๕๕๐๔๗๔๗๔

[illegible]

ผู้รับเงิน 收銀人
COLLECTOR.

ขอขอบคุณท่านที่อุทิศตน



เลขที่.....

บิลเงินสด
CASH SALE

วันที่ 01/05/69
Date

นาม.....
Customer

ที่อยู่..

Address

Address				
จำนวน Quantity	รายการ Description	หน่วยละ Unit Price	จำนวนเงิน Amount	
1	ไข่ไก่	3000	3,000	
บาท Baht	รวมเงิน Total	3000	3,000	

ผู้รับเงิน.....
Salesmans Ree

ทำการดุดบ่อปฏิกูลตามรอบ วันที่ 7/1/69
ดุดทั้งหมด 4 เทียว 5 บ่อ

