

คุณภาพน้ำทิ้ง



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : ส่วนแยกกาก (น้ำเสียก่อนการบำบัด)
GPS. Coordinate : 47 P 673240 E 1519606 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/1
Sample Type : Wastewater
Sampling Date : 15 January 2026
Sampling Time : 01.30 p.m.
Received Date : 16 January 2026
Analytical Date : 16 - 28 January 2026
Report Date : 29 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pHat 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	40.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	271
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	23.3
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	3.40
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	920
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	540
Sample Appearance		Yellow/Turbid/Sediment/Odorless	

- Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

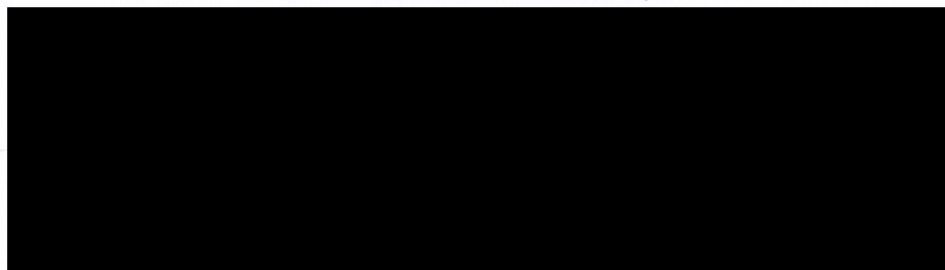

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : บ่อพักน้ำสุดท้ายก่อนปล่อยออกสู่ถนนสาธารณะ
ด้านหน้าโครงการ (น้ำเสียหลังการบำบัด)
GPS. Coordinate : 47 P 673210 E 1519602 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/2
Sample Type : Wastewater
Sampling Date : 15 January 2026
Sampling Time : 01.40 p.m.
Received Date : 16 January 2026
Analytical Date : 16 - 28 January 2026
Report Date : 29 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	292	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{*, 3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	540	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	350	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

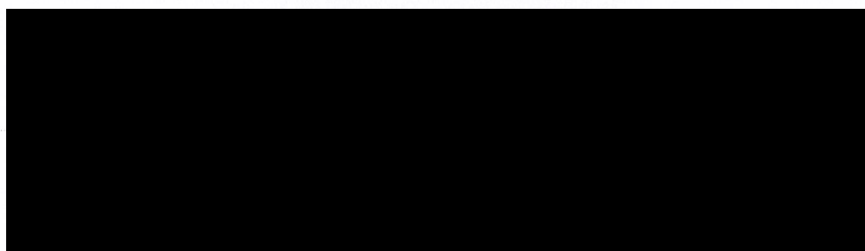

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : ส่วนแยกกาก (น้ำเสียก่อนการบำบัด)
GPS. Coordinate : 47 P 673243 E 1519611 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/1
Sample Type : Wastewater
Sampling Date : 12 February 2026
Sampling Time : 02.10 p.m.
Received Date : 13 February 2026
Analytical Date : 13 - 25 February 2026
Report Date : 26 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.1
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	45.4
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	308
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	14.2
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.8
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	2.12
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	1,600
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	920
Sample Appearance		Yellow/Turbid/Sediment/Odorless	

- Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

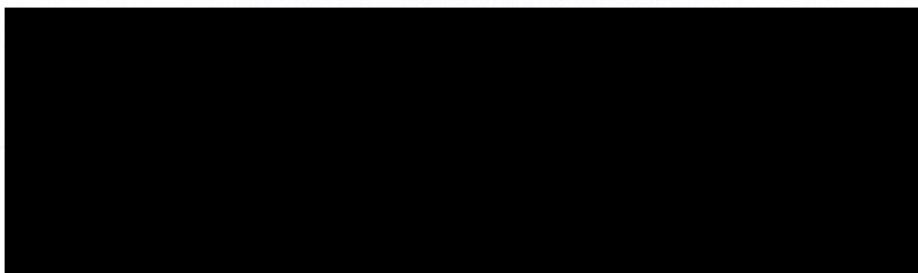

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกรมย์
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกรมย์
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : บ่อพักน้ำสุดท้ายก่อนปล่อยออกสู่ถนนสาธารณะ
ด้านหน้าโครงการ (น้ำเสียหลังการบำบัด)
GPS. Coordinate : 47 P 673196 E 1519598 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Report No. : W69098
Sample No. : W69098/2
Sample Type : Wastewater
Sampling Date : 12 February 2026
Sampling Time : 02.20 p.m.
Received Date : 13 February 2026
Analytical Date : 13 - 25 February 2026
Report Date : 26 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.9	5.5-9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	5.9	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	321	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	920	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	540	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

Mis

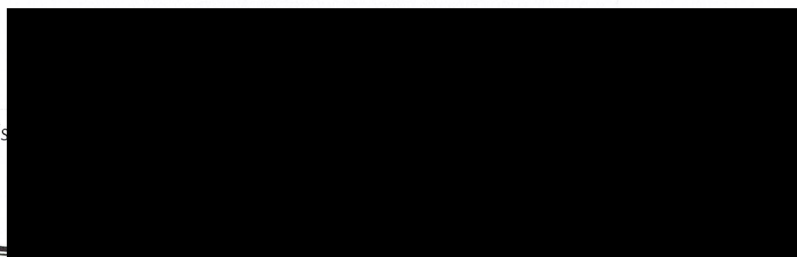

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : ส่วนแยกกาก (น้ำเสียก่อนการบำบัด)
GPS. Coordinate : 47 P 673242 E 1519612 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/1
Sample Type : Wastewater
Sampling Date : 17 March 2026
Sampling Time : 01.25 p.m.
Received Date : 18 March 2026
Analytical Date : 18 - 30 March 2026
Report Date : 31 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.7 °C	-	Electrometric Method (4500-H ⁺ B)	6.8
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	36.3
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	304
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	23.1
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.6
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	3.37
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	540
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	540
Sample Appearance		Yellow/Turbid/Sediment/Odorless	

- Remark** ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

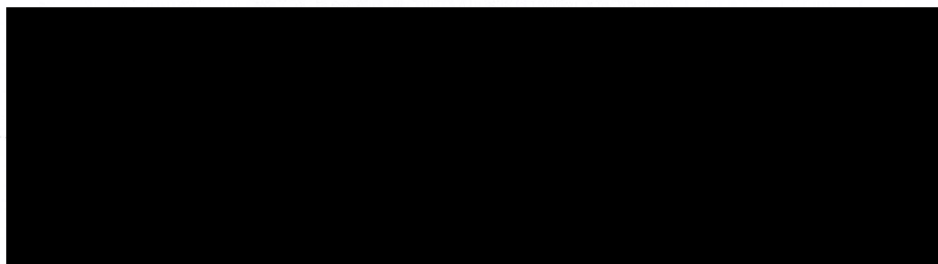

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : บ่อพักน้ำสุดท้ายก่อนปล่อยออกสู่ถนนสาธารณะ
ด้านหน้าโครงการ (น้ำเสียหลังการบำบัด)
GPS. Coordinate : 47 P 673196 E 1519598 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/2
Sample Type : Wastewater
Sampling Date : 17 March 2026
Sampling Time : 01.35 p.m.
Received Date : 18 March 2026
Analytical Date : 18 - 30 March 2026
Report Date : 31 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	286	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	540	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	350	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

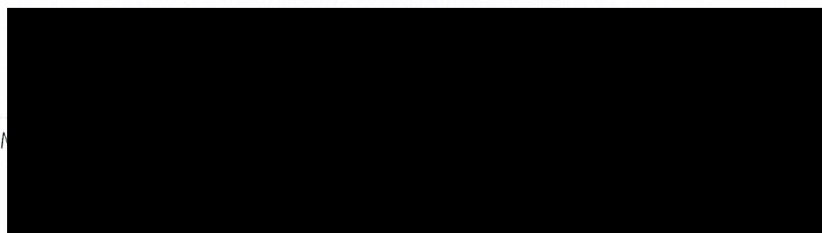

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : ส่วนแยกกาก (น้ำเสียก่อนการบำบัด)
GPS. Coordinate : 47 P 673250 E 1519625 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/1
Sample Type : Wastewater
Sampling Date : 08 April 2026
Sampling Time : 03.00 p.m.
Received Date : 09 April 2026
Analytical Date : 09 - 21 April 2026
Report Date : 22 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	48.1
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	262
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	16.5
	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.1
Oil and Grease *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Sulfide *	mL/L	Imhoff Cone (2540 F)	< 0.1
Settleable Solids *	mg/L	APHA:4500-Norg (B) ^{2/}	2.41
Total Kjeldahl Nitrogen *, ^{3/}	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	540
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	540
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless	

- Remark**
- ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
 - ^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
 - ^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
 - * This item is out the scope ISO/IEC 17025:2017 Accreditation.

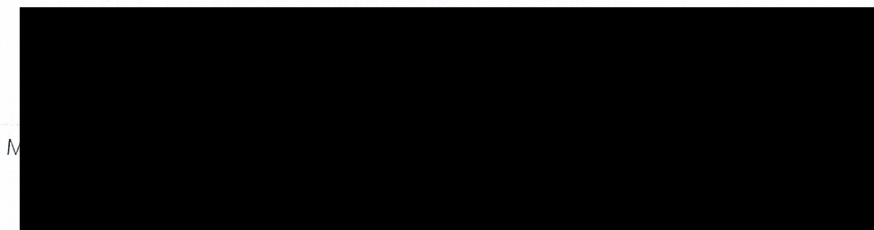

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : บ่อพักน้ำสุดท้ายก่อนปล่อยออกสู่ถนนสาธารณะ
ด้านหน้าโครงการ (น้ำเสียหลังการบำบัด)
GPS. Coordinate : 47 P 673204 E 1519602 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/2
Sample Type : Wastewater
Sampling Date : 08 April 2026
Sampling Time : 03.10 p.m.
Received Date : 09 April 2026
Analytical Date : 09 - 21 April 2026
Report Date : 22 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.1	5.5-9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	259	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, 3/	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	350	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	350	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

M

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : ส่วนแยกกาก (น้ำเสียก่อนการบำบัด)
GPS. Coordinate : 47 P 673250 E 1519625 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/1
Sample Type : Wastewater
Sampling Date : 14 May 2026
Sampling Time : 01.40 p.m.
Received Date : 15 May 2026
Analytical Date : 15 - 25 May 2026
Report Date : 26 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	41.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	310
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	24.2
	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.3
Oil and Grease *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Sulfide *	mL/L	Imhoff Cone (2540 F)	< 0.1
Settleable Solids *	mg/L	APHA:4500-Norg (B) ^{2/}	3.53
Total Kjeldahl Nitrogen *, ^{3/}	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	920
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	920
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless	

- Remark**
- ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
 - ^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
 - ^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
 - * This item is out the scope ISO/IEC 17025:2017 Accreditation.

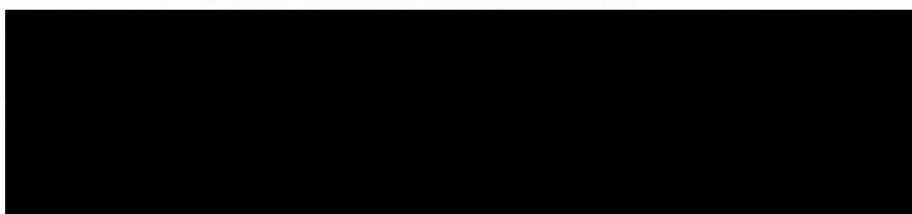

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : บ่อพักน้ำสุดท้ายก่อนปล่อยออกสู่ถนนสาธารณะ
ด้านหน้าโครงการ (น้ำเสียหลังการบำบัด)
GPS. Coordinate : 47 P 673194 E 1519594 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/2
Sample Type : Wastewater
Sampling Date : 14 May 2026
Sampling Time : 01.50 p.m.
Received Date : 15 May 2026
Analytical Date : 15 - 25 May 2026
Report Date : 26 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	296	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5 Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	920	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	540	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

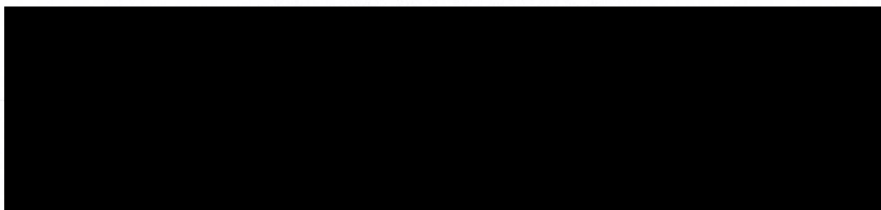

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : ส่วนแยกกาก (น้ำเสียก่อนการบำบัด)
GPS. Coordinate : 47 P 673252 E 1519624 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/1
Sample Type : Wastewater
Sampling Date : 17 June 2026
Sampling Time : 10.28 a.m.
Received Date : 18 June 2026
Analytical Date : 18 - 30 June 2026
Report Date : 01 July 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	40.8
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	242
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.6
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.5
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1
Total Kjeldahl Nitrogen ^{*, 3/}	mg/L	APHA:4500-Norg (B) ^{2/}	2.86
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	920
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	540
Sample Appearance		Yellow/Turbid/Sediment/Odorless	

- Remark**
- ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

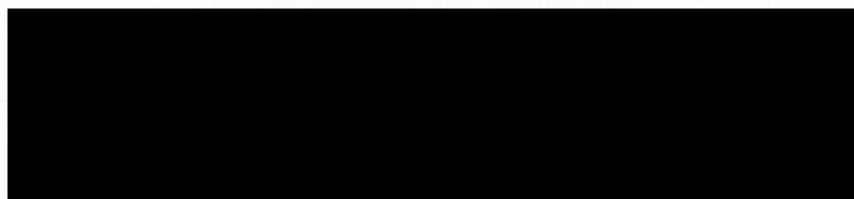

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ทรี พัฒนาการ-เอกมัย
Project Name : โครงการ เดอะ ทรี พัฒนาการ-เอกมัย
Address Project : เลขที่ 89 ถนนพัฒนาการ (ตรงข้ามซอยพัฒนาการ 4)
แขวงสวนหลวง เขตสวนหลวง กรุงเทพมหานคร 10250
Sampling Point : บ่อพักน้ำสุดท้ายก่อนปล่อยออกสู่ถนนสาธารณะ
ด้านหน้าโครงการ (น้ำเสียหลังการบำบัด)
GPS. Coordinate : 47 P 673191 E 1519595 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69098
Sample No. : W69098/2
Sample Type : Wastewater
Sampling Date : 17 June 2026
Sampling Time : 10.24 a.m.
Received Date : 18 June 2026
Analytical Date : 18 - 30 June 2026
Report Date : 01 July 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	247	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	540	-
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	350	-
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

