ภาคผนวก ค
ใบรายงานผลวิเคราะห์คุณภาพน้ำ



ภาคผนวก ค-1

ใบรายงานผลวิเคราะห์คุณภาพน้ำทิ้ง



United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JANUARY 29, 2026
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB
SAMPLING BY : MR PEERAPAT BANYATSIN
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JANUARY 29, 2026
ANALYTICAL DATE : JANUARY 29 - FEBRUARY 4, 2026
ISSUE DATE : FEBRUARY 5, 2026
REPORT NO. : 2026-U009095
WORK NO. : 2025-010721
ANALYSIS NO. : T26AB776-0001 - T26AB776-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 11:00 HOUR 1/ T26AB776-0001	2 10:35 HOUR 1/ T26AB776-0002			
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.4 (30.3°C)	6.9 (30.3°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	86.1	12.2	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	76.9	9.8	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	380	246	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	0.93	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	69.5	< 5.0	≤ 35	1.5	5.0

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 11:00 HOUR 1/ T26AB776-0001	2 10:35 HOUR 1/ T26AB776-0002			
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	25	< 3	≤ 20	-	3
SAMPLE CONDITION							
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/CLEAR			
SEDIMENT			BROWN	BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

RESULT 1 : น้ำก่อนการบำบัด

RESULT 2 : น้ำหลังการบำบัด

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

2026-U009095

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JANUARY 29, 2026
SAMPLING TIME : 10:25 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR PEERAPAT BANYATSIN
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JANUARY 29, 2026
ANALYTICAL DATE : JANUARY 29 - FEBRUARY 4, 2026
ISSUE DATE : FEBRUARY 5, 2026
REPORT NO. : 2026-U009096
WORK NO. : 2025-010721
ANALYSIS NO. : T26AB776-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT ปอดรวจคุณภาพน้ำก่อนออกสู่ภายนอกโครงการ T26AB776-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.0 (30.2°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	8.3	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	7.8	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	225	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	< 5.0	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/CLEAR			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

NSC -TISI -TIS 17025
TESTING 0207
LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : FEBRUARY 5, 2026
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB
SAMPLING BY : MR ACHITA SAENGJAN
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : FEBRUARY 6, 2026
ANALYTICAL DATE : FEBRUARY 6-13, 2026
ISSUE DATE : FEBRUARY 16, 2026
REPORT NO. : 2026-U011674
WORK NO. : 2025-010721
ANALYSIS NO. : T26AC327-0001 - T26AC327-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 14:50 HOUR 1/ T26AC327-0001	2 15:00 HOUR 1/ T26AC327-0002			
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.2 (32.7°C)	6.4 (35.9°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	107	58.5	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	245	34.3	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	302	336	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	1.4	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	68.9	12.9	≤ 35	1.5	5.0

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
TESTING
No. 0063

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 14:50 HOUR 1/ T26AC327-0001	2 15:00 HOUR 1/ T26AC327-0002			
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	25	< 3	≤ 20	-	3
SAMPLE CONDITION							
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID			
SEDIMENT			BROWN	BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

RESULT 1 : น้ำก่อนการบำบัด

RESULT 2 : น้ำหลังการบำบัด

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

2026-U011674

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : FEBRUARY 5, 2026
SAMPLING TIME : 15:20 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR ACHITA SAENGJAN
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : FEBRUARY 6, 2026
ANALYTICAL DATE : FEBRUARY 6-13, 2026
ISSUE DATE : FEBRUARY 16, 2026
REPORT NO. : 2026-U011675
WORK NO. : 2025-010721
ANALYSIS NO. : T26AC327-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT บ่อตรวจคุณภาพน้ำก่อนออกสู่ภายนอกโครงการ T26AC327-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.8 (29.3°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	19.5	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	27.0	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	638	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	32.6	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MARCH 5, 2026
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB
SAMPLING BY : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MARCH 5, 2026
ANALYTICAL DATE : MARCH 5-12, 2026
ISSUE DATE : MARCH 12, 2026
REPORT NO. : 2026-U018931
WORK NO. : 2025-010721
ANALYSIS NO. : T26AE452-0001 - T26AE452-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 13:30 HOUR 1/ T26AE452-0001	2 13:15 HOUR 1/ T26AE452-0002			
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.1 (31.8°C)	6.7 (37.2°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	157	6.3	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	183	9.7	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	322	390	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	67.5	11.5	≤ 35	1.5	5.0

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 13:30 HOUR 1/ T26AE452-0001	2 13:15 HOUR 1/ T26AE452-0002			
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	84	< 3	≤ 20	-	3
SAMPLE CONDITION							
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/CLEAR			
SEDIMENT			BROWN	BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

RESULT 1 : น้ำก่อนการบำบัด

RESULT 2 : น้ำหลังการบำบัด

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

2026-U018931

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MARCH 5, 2026
SAMPLING TIME : 13:20 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MARCH 5, 2026
ANALYTICAL DATE : MARCH 5-12, 2026
ISSUE DATE : MARCH 12, 2026
REPORT NO. : 2026-U018949
WORK NO. : 2025-010721
ANALYSIS NO. : T26AE452-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT บ่อตรวจคุณภาพน้ำก่อนออกสู่ภายนอกโครงการ T26AE452-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.6 (31.7°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	8.1	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	9.4	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	634	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	22.3	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/CLEAR			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025
TESTING 0207
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : APRIL 8, 2026
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : APRIL 8, 2026
ANALYTICAL DATE : APRIL 8-20, 2026
ISSUE DATE : APRIL 21, 2026
REPORT NO. : 2026-U030874
WORK NO. : 2025-010721
ANALYSIS NO. : T26AH609-0001 - T26AH609-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 11:27 HOUR 1/ T26AH609-0001	2 11:22 HOUR 1/ T26AH609-0002			
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.5 (32.2°C)	6.4 (36.7°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	29.8	27.0	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	25.0	20.6	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	321	403	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	65.1	11.9	≤ 35	1.5	5.0

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025 TESTING 0207

LABORATORY ACCREDITATION BLA-DSS TESTING No. 0063

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 11:27 HOUR 1/ T26AH609-0001	2 11:22 HOUR 1/ T26AH609-0002			
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	11	< 3	≤ 20	-	3
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 YELLOW/TURBID BROWN	 YELLOW/TURBID BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

RESULT 1 : น้ำก่อนการบำบัด

RESULT 2 : น้ำหลังการบำบัด

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025
TESTING 0207
LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : APRIL 8, 2026
SAMPLING TIME : 11:17 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : APRIL 8, 2026
ANALYTICAL DATE : APRIL 8-20, 2026
ISSUE DATE : APRIL 21, 2026
REPORT NO. : 2026-U030875
WORK NO. : 2025-010721
ANALYSIS NO. : T26AH609-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT บ่อตรวจคุณภาพน้ำก่อนออกสู่ภายนอกโครงการ T26AH609-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	6.5 (36.5°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	24.2	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	22.3	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	398	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	11.7	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MAY 7, 2026
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MAY 7, 2026
ANALYTICAL DATE : MAY 7-15, 2026
ISSUE DATE : MAY 15, 2026
REPORT NO. : 2026-U039658
WORK NO. : 2025-010721
ANALYSIS NO. : T26AJ705-0001 - T26AJ705-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 11:25 HOUR 1/ T26AJ705-0001	2 11:20 HOUR 1/ T26AJ705-0002			
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.5 (31.6°C)	6.8 (36.2°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	58.4	8.6	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	106	14.9	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	318	370	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	69.0	16.9	≤ 35	1.5	5.0

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION
BLA-DSS
TESTING
No. 0063

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 11:25 HOUR 1/ T26AJ705-0001	2 11:20 HOUR 1/ T26AJ705-0002			
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	8	< 3	≤ 20	-	3
SAMPLE CONDITION							
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID			
SEDIMENT			BROWN	BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

RESULT 1 : น้ำก่อนการบำบัด

RESULT 2 : น้ำหลังการบำบัด

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Piyapat S.

(MRS PIYAPAT SUTTAMANUTWONG)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

2026-U039658

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MAY 7, 2026
SAMPLING TIME : 11:15 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MAY 7, 2026
ANALYTICAL DATE : MAY 7-15, 2026
ISSUE DATE : MAY 15, 2026
REPORT NO. : 2026-U039659
WORK NO. : 2025-010721
ANALYSIS NO. : T26AJ705-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT บ่อตรวจคุณภาพน้ำก่อนออกสู่ภายนอกโครงการ T26AJ705-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H+ B AND 1060 B	6.9 (35.7°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	9.6	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	9.1	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	369	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	17.1	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Piyapat S.

(MRS PIYAPAT SUTTAMANUTWONG)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025 TESTING 0207

LABORATORY ACCREDITATION BLA-DSS TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JUNE 5, 2026
SAMPLING TIME : 1/
SAMPLING METHOD : GRAB
SAMPLING BY : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JUNE 5, 2026
ANALYTICAL DATE : JUNE 5-16, 2026
ISSUE DATE : JUNE 16, 2026
REPORT NO. : 2026-U051644
WORK NO. : 2025-010721
ANALYSIS NO. : T26AM347-0001 - T26AM347-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 14:10 HOUR 1/ T26AM347-0001	2 13:55 HOUR 1/ T26AM347-0002			
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.4 (32.2°C)	6.6 (38.2°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	79.2	52.5	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	52.4	20.6	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	385	427	≤ 1,000	-	25
SULPHIDE[c]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	5.9	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	67.4	13.3	≤ 35	1.5	5.0

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025 TESTING 0207

LABORATORY ACCREDITATION BLA-DSS TESTING No. 0063

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT		REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
			1 14:10 HOUR 1/ T26AM347-0001	2 13:55 HOUR 1/ T26AM347-0002			
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	12	< 3	≤ 20	-	3
SAMPLE CONDITION							
WATER'S COLOUR/TURBID			YELLOW/TURBID	YELLOW/TURBID			
SEDIMENT			BROWN	BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

RESULT 1 : น้ำก่อนการบำบัด

RESULT 2 : น้ำหลังการบำบัด

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

2026-U051644

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JUNE 5, 2026
SAMPLING TIME : 13:50 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JUNE 5, 2026
ANALYTICAL DATE : JUNE 5-16, 2026
ISSUE DATE : JUNE 16, 2026
REPORT NO. : 2026-U051645
WORK NO. : 2025-010721
ANALYSIS NO. : T26AM347-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT บ่อตรวจคุณภาพน้ำก่อนออกสู่ภายนอกโครงการ T26AM347-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	6.6 (38.0°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	43.6	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	21.7	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	458	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	15.5	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

ภาคผนวก ค-2

ใบรายงานผลวิเคราะห์คุณภาพน้ำสระว่ายน้ำ



United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 29, 2026
SAMPLING TIME : 10:50 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR PEERAPAT BANYATSIN
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : JANUARY 29, 2026
ANALYTICAL DATE : JANUARY 29 - FEBRUARY 3, 2026
ISSUE DATE : FEBRUARY 6, 2026
REPORT NO. : 2026-U009097
WORK NO. : 2025-010721
ANALYSIS NO. : T26AB776-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AB776-0004	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 29, 2026
SAMPLING TIME : 10:50 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR PEERAPAT BANYATSIN
ANALYZED BY : MISS BUSSAKORN MAJAI
RECEIVED DATE : JANUARY 29, 2026
ANALYTICAL DATE : JANUARY 29 - FEBRUARY 1, 2026
ISSUE DATE : FEBRUARY 6, 2026
REPORT NO. : 2026-U009098
WORK NO. : 2025-010721
ANALYSIS NO. : T26AB776-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AB776-0004	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 29, 2026
SAMPLING TIME : 10:45 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR PEERAPAT BANYATSIN
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : JANUARY 29, 2026
ANALYTICAL DATE : JANUARY 29 - FEBRUARY 5, 2026
ISSUE DATE : FEBRUARY 6, 2026
REPORT NO. : 2026-U009099
WORK NO. : 2025-010721
ANALYSIS NO. : T26AB776-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนดื้น T26AB776-0005	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	5.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	3.6	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	DETECTED	NOT DETECTED	-
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR		
SEDIMENT			-		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JANUARY 29, 2026
SAMPLING TIME : 10:45 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR PEERAPAT BANYATSIN
ANALYZED BY : MISS BUSSAKORN MAJAI

RECEIVED DATE : JANUARY 29, 2026
ANALYTICAL DATE : JANUARY 29 - FEBRUARY 1, 2026
ISSUE DATE : FEBRUARY 6, 2026
REPORT NO. : 2026-U009100
WORK NO. : 2025-010721
ANALYSIS NO. : T26AB776-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AB776-0005	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 5, 2026
SAMPLING TIME : 15:05 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR ACHITA SAENGJAN
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : FEBRUARY 6, 2026
ANALYTICAL DATE : FEBRUARY 6-10, 2026
ISSUE DATE : FEBRUARY 16, 2026
REPORT NO. : 2026-U011676
WORK NO. : 2025-010721
ANALYSIS NO. : T26AC327-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AC327-0004	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME	: PARK ORIJIN CHULA-SAMYAN		
ADDRESS	: 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500		
CONTACT INFORMATION	: TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th		
SAMPLING SOURCE	: PARK ORIJIN CHULA-SAMYAN		
SAMPLE TYPE	: WATER SAMPLE FROM SWIMMING POOL	**RECEIVED DATE**	: FEBRUARY 6, 2026
SAMPLING DATE	: FEBRUARY 5, 2026	**ANALYTICAL DATE**	: FEBRUARY 6-9, 2026
SAMPLING TIME	: 15:05 HOUR	**ISSUE DATE**	: FEBRUARY 16, 2026
SAMPLING METHOD *	: GRAB AND STERILE TECHNIQUE	**REPORT NO.**	: 2026-U011677
SAMPLING BY *	: MR ACHITA SAENGJAN	**WORK NO.**	: 2025-010721
ANALYZED BY	: MISS JITSAMON NGAMKANA	**ANALYSIS NO.**	: T26AC327-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AC327-0004	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION				
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR	
SEDIMENT			-	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 5, 2026
SAMPLING TIME : 15:10 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR ACHITA SAENGJAN
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : FEBRUARY 6, 2026
ANALYTICAL DATE : FEBRUARY 6-10, 2026
ISSUE DATE : FEBRUARY 16, 2026
REPORT NO. : 2026-U011678
WORK NO. : 2025-010721
ANALYSIS NO. : T26AC327-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนตื้น T26AC327-0005	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

- PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
- THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : FEBRUARY 5, 2026
SAMPLING TIME : 15:10 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR ACHITA SAENGJAN
ANALYZED BY : MISS JITSAMON NGAMKANA
RECEIVED DATE : FEBRUARY 6, 2026
ANALYTICAL DATE : FEBRUARY 6-9, 2026
ISSUE DATE : FEBRUARY 16, 2026
REPORT NO. : 2026-U011679
WORK NO. : 2025-010721
ANALYSIS NO. : T26AC327-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึ้น T26AC327-0005	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 5, 2026
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS BUSSAKORN MAJAI
RECEIVED DATE : MARCH 5, 2026
ANALYTICAL DATE : MARCH 5-10, 2026
ISSUE DATE : MARCH 13, 2026
REPORT NO. : 2026-U018954
WORK NO. : 2025-010721
ANALYSIS NO. : T26AE452-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AE452-0004	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.
REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.
< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME	: PARK ORIJIN CHULA-SAMYAN		
ADDRESS	: 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500		
CONTACT INFORMATION	: TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th		
SAMPLING SOURCE	: PARK ORIJIN CHULA-SAMYAN		
SAMPLE TYPE	: WATER SAMPLE FROM SWIMMING POOL	**RECEIVED DATE**	: MARCH 5, 2026
SAMPLING DATE	: MARCH 5, 2026	**ANALYTICAL DATE**	: MARCH 5-8, 2026
SAMPLING TIME	: 13:40 HOUR	**ISSUE DATE**	: MARCH 13, 2026
SAMPLING METHOD *	: GRAB AND STERILE TECHNIQUE	**REPORT NO.**	: 2026-U018955
SAMPLING BY *	: MR PHATSAWUT THOSAKOON	**WORK NO.**	: 2025-010721
ANALYZED BY	: MISS BUSSAKORN MAJAI	**ANALYSIS NO.**	: T26AE452-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AE452-0004	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 5, 2026
SAMPLING TIME : 13:45 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS BUSSAKORN MAJAI

RECEIVED DATE : MARCH 5, 2026
ANALYTICAL DATE : MARCH 5-10, 2026
ISSUE DATE : MARCH 13, 2026
REPORT NO. : 2026-U019015
WORK NO. : 2025-010721
ANALYSIS NO. : T26AE452-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนดื้น T26AE452-0005	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.
REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.
< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MARCH 5, 2026
SAMPLING TIME : 13:45 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS BUSSAKORN MAJAI
RECEIVED DATE : MARCH 5, 2026
ANALYTICAL DATE : MARCH 5-8, 2026
ISSUE DATE : MARCH 13, 2026
REPORT NO. : 2026-U019016
WORK NO. : 2025-010721
ANALYSIS NO. : T26AE452-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึ้น T26AE452-0005	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

- PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
- THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 8, 2026
SAMPLING TIME : 11:05 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS SUJIRA PRASERTSUKHO
RECEIVED DATE : APRIL 8, 2026
ANALYTICAL DATE : APRIL 8-16, 2026
ISSUE DATE : APRIL 21, 2026
REPORT NO. : 2026-U030876
WORK NO. : 2025-010721
ANALYSIS NO. : T26AH609-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AH609-0004	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 8, 2026
SAMPLING TIME : 11:05 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR WEERAYUT MOKKAEW
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : APRIL 8, 2026
ANALYTICAL DATE : APRIL 8-13, 2026
ISSUE DATE : APRIL 21, 2026
REPORT NO. : 2026-U030877
WORK NO. : 2025-010721
ANALYSIS NO. : T26AH609-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AH609-0004	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 8, 2026
SAMPLING TIME : 11:07 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR WEERAYUT MOKKAEW
ANALYZED BY : MISS SUJIRA PRASERTSUKHO
RECEIVED DATE : APRIL 8, 2026
ANALYTICAL DATE : APRIL 8-16, 2026
ISSUE DATE : APRIL 21, 2026
REPORT NO. : 2026-U030878
WORK NO. : 2025-010721
ANALYSIS NO. : T26AH609-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนตื้น T26AH609-0005	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : APRIL 8, 2026
SAMPLING TIME : 11:07 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR WEERAYUT MOKKAEW
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : APRIL 8, 2026
ANALYTICAL DATE : APRIL 8-13, 2026
ISSUE DATE : APRIL 21, 2026
REPORT NO. : 2026-U030879
WORK NO. : 2025-010721
ANALYSIS NO. : T26AH609-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนตื้น T26AH609-0005	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 7, 2026
SAMPLING TIME : 11:40 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS SUJIRA PRASERTSUKHO

RECEIVED DATE : MAY 7, 2026
ANALYTICAL DATE : MAY 7-12, 2026
ISSUE DATE : MAY 15, 2026
REPORT NO. : 2026-U039660
WORK NO. : 2025-010721
ANALYSIS NO. : T26AJ705-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AJ705-0004	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME	: PARK ORIJIN CHULA-SAMYAN		
ADDRESS	: 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500		
CONTACT INFORMATION	: TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th		
SAMPLING SOURCE	: PARK ORIJIN CHULA-SAMYAN		
SAMPLE TYPE	: WATER SAMPLE FROM SWIMMING POOL	**RECEIVED DATE**	: MAY 7, 2026
SAMPLING DATE	: MAY 7, 2026	**ANALYTICAL DATE**	: MAY 7-12, 2026
SAMPLING TIME	: 11:40 HOUR	**ISSUE DATE**	: MAY 15, 2026
SAMPLING METHOD *	: GRAB AND STERILE TECHNIQUE	**REPORT NO.**	: 2026-U039661
SAMPLING BY *	: MR SITTHIPOL PROMPOCHENBOON	**WORK NO.**	: 2025-010721
ANALYZED BY	: MISS JITSAMON NGAMKANA	**ANALYSIS NO.**	: T26AJ705-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AJ705-0004	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : MAY 7, 2026
SAMPLING TIME : 11:35 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS SUJIRA PRASERTSUKHO

RECEIVED DATE : MAY 7, 2026
ANALYTICAL DATE : MAY 7-12, 2026
ISSUE DATE : MAY 15, 2026
REPORT NO. : 2026-U039662
WORK NO. : 2025-010721
ANALYSIS NO. : T26AJ705-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนตื้น T26AJ705-0005	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[c]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME	: PARK ORIJIN CHULA-SAMYAN		
ADDRESS	: 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500		
CONTACT INFORMATION	: TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th		
SAMPLING SOURCE	: PARK ORIJIN CHULA-SAMYAN		
SAMPLE TYPE	: WATER SAMPLE FROM SWIMMING POOL	**RECEIVED DATE**	: MAY 7, 2026
SAMPLING DATE	: MAY 7, 2026	**ANALYTICAL DATE**	: MAY 7-12, 2026
SAMPLING TIME	: 11:35 HOUR	**ISSUE DATE**	: MAY 15, 2026
SAMPLING METHOD *	: GRAB AND STERILE TECHNIQUE	**REPORT NO.**	: 2026-U039663
SAMPLING BY *	: MR SITTHIPOL PROMPOCHENBOON	**WORK NO.**	: 2025-010721
ANALYZED BY	: MISS JITSAMON NGAMKANA	**ANALYSIS NO.**	: T26AJ705-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนตื้น T26AJ705-0005	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 5, 2026
SAMPLING TIME : 13:35 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS SUJIRA PRASERTSUKHO
RECEIVED DATE : JUNE 5, 2026
ANALYTICAL DATE : JUNE 5-11, 2026
ISSUE DATE : JUNE 17, 2026
REPORT NO. : 2026-U051646
WORK NO. : 2025-010721
ANALYSIS NO. : T26AM347-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AM347-0004	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[b]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.
REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.
< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 5, 2026
SAMPLING TIME : 13:35 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR PHATSAWUT THOSAKOON
ANALYZED BY : MR THANAPOL GESAMOON

RECEIVED DATE : JUNE 5, 2026
ANALYTICAL DATE : JUNE 5-11, 2026
ISSUE DATE : JUNE 17, 2026
REPORT NO. : 2026-U051647
WORK NO. : 2025-010721
ANALYSIS NO. : T26AM347-0004

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนลึก T26AM347-0004	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION				
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR	
SEDIMENT			-	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 5, 2026
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR PHATSAWUT THOSAKOON
ANALYZED BY : MISS SUJIRA PRASERTSUKHO

RECEIVED DATE : JUNE 5, 2026
ANALYTICAL DATE : JUNE 5-11, 2026
ISSUE DATE : JUNE 17, 2026
REPORT NO. : 2026-U051648
WORK NO. : 2025-010721
ANALYSIS NO. : T26AM347-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนดื้น T26AM347-0005	REGULATORY STANDARD	DETECTION LIMIT
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	< 1.1	< 10	1.1
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	< 1.1	NOT DETECTED	1.1
E. coli[b]	/100 mL	FLUOROGENIC SUBSTRATE TEST (SM: PART 9221 D AND F)	NOT DETECTED	NOT DETECTED	-
Pseudomonas aeruginosa[b]	/100 mL	MEMBRANE FILTER TECHNIQUE FOR PSEUDOMONAS AERUGINOSA (SM: PART 9213 E)	NOT DETECTED	NOT DETECTED	-
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

< 1.1 : LESS THAN 1.1 MPN/100 mL MEANS NOT DETECTED.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : PARK ORIJIN CHULA-SAMYAN
ADDRESS : 168 RAMA 4 MAHA PHRUETTHARAM BANG RAK BANGKOK 10500
CONTACT INFORMATION : TEL : 09 5232 4751 e-mail : titirat.n@primo.co.th
SAMPLING SOURCE : PARK ORIJIN CHULA-SAMYAN
SAMPLE TYPE : WATER SAMPLE FROM SWIMMING POOL
SAMPLING DATE : JUNE 5, 2026
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD * : GRAB AND STERILE TECHNIQUE
SAMPLING BY * : MR PHATSAWUT THOSAKOON
ANALYZED BY : MR THANAPOL GESAMOON

RECEIVED DATE : JUNE 5, 2026
ANALYTICAL DATE : JUNE 5-11, 2026
ISSUE DATE : JUNE 17, 2026
REPORT NO. : 2026-U051649
WORK NO. : 2025-010721
ANALYSIS NO. : T26AM347-0005

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT สระว่ายน้ำ ส่วนดื้น T26AM347-0005	REGULATORY STANDARD
MICROBIOLOGY				
Staphylococcus aureus	/100 mL	STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER. APHA, AWWA, WEF. 24th EDITION, 2023. PART 9213 B.	NOT DETECTED	NOT DETECTED
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

REGULATORY STANDARD : RECOMMENDATIONS OF PUBLIC HEALTH COMMITTEE NO. 1/2550; CONTROL OF SWIMMING POOLS BUSINESSES OR OTHER SIMILAR BUSINESSES.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

ภาคผนวก ง

มาตรฐาน



ภาคผนวก ง-1

ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม
เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร
ลงวันที่ 7 พฤศจิกายน 2548 ประกาศในราชกิจจานุเบกษา
เล่มที่ 122 ตอนที่ 125ง วันที่ 29 ธันวาคม 2548



ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้ง
จากอาคารบางประเภทและบางขนาด

โดยที่ได้มีการปฏิรูประบบราชการโดยให้มีการจัดตั้งกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อมขึ้นมา และให้โอนภารกิจของกระทรวงวิทยาศาสตร์ เทคโนโลยีและสิ่งแวดล้อม ในส่วนที่เกี่ยวข้องกับพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. ๒๕๓๕ ไปเป็นของกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม ประกอบกับเป็นการสมควรให้คณะกรรมการควบคุมมลพิษเป็นผู้พิจารณาเห็นชอบกับวิธีการตรวจหาค่ามาตรฐานการระบายน้ำทิ้ง นอกเหนือจากวิธีการที่กำหนดไว้แทนกรมควบคุมมลพิษ จึงสมควรแก้ไขปรับปรุงประกาศกระทรวงวิทยาศาสตร์ เทคโนโลยีและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด

อาศัยอำนาจตามความในมาตรา ๕๕ แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. ๒๕๓๕ แก้ไขโดยมาตรา ๑๑๔ แห่งพระราชกฤษฎีกาแก้ไขบทบัญญัติให้สอดคล้องกับการโอนอำนาจหน้าที่ของส่วนราชการ ให้เป็นไปตามพระราชบัญญัติปรับปรุงกระทรวง ทบวง กรม พ.ศ. ๒๕๔๕ พ.ศ. ๒๕๔๕ อันเป็นพระราชบัญญัติที่มีบทบัญญัติบางประการเกี่ยวกับการจำกัดสิทธิและเสรีภาพของบุคคล ซึ่งมาตรา ๒๙ ประกอบกับมาตรา ๓๕ มาตรา ๔๘ มาตรา ๕๐ และมาตรา ๕๑ ของรัฐธรรมนูญแห่งราชอาณาจักรไทยบัญญัติให้กระทำได้ โดยอาศัยอำนาจตามบทบัญญัติแห่งกฎหมาย รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม โดยคำแนะนำของคณะกรรมการควบคุมมลพิษ และโดยความเห็นชอบของคณะกรรมการสิ่งแวดล้อมแห่งชาติ จึงออกประกาศไว้ ดังต่อไปนี้

ข้อ ๑ ให้ยกเลิกประกาศกระทรวงวิทยาศาสตร์ เทคโนโลยีและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด ลงวันที่ ๑๐ มกราคม พ.ศ. ๒๕๓๗

ข้อ ๒ ในประกาศนี้

“อาคาร” หมายความว่า อาคารที่ก่อสร้างขึ้น ไม่ว่าจะมีลักษณะเป็นอาคารหลังเดียว หรือเป็นกลุ่มของอาคารซึ่งตั้งอยู่ภายในพื้นที่ซึ่งเป็นบริเวณเดียวกัน และไม่ว่าจะมีท่อระบายน้ำท่อเดียว หรือมีหลายท่อที่เชื่อมติดต่อกันระหว่างอาคารหรือไม่ก็ตาม ซึ่งได้แก่

(๑) อาคารชุด ตามกฎหมายว่าด้วยอาคารชุด

(๒) โรงแรม ตามกฎหมายว่าด้วยโรงแรม

(๓) หอพัก ตามกฎหมายว่าด้วยหอพัก

(๔) สถานบริการประเภทสถานอาบน้ำ นวดหรืออบตัว ซึ่งมีผู้ให้บริการแก่ลูกค้า ตามกฎหมายว่าด้วยสถานบริการ

(๕) โรงพยาบาลของทางราชการหรือสถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาล

(๖) อาคารโรงเรียนเอกชน ตามกฎหมายว่าด้วยโรงเรียนเอกชน โรงเรียนของทางราชการ อาคารสถาบันอุดมศึกษาของเอกชน ตามกฎหมายว่าด้วยสถาบันอุดมศึกษาของเอกชนและสถาบันอุดมศึกษาของทางราชการ

(๗) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ หรือองค์การระหว่างประเทศและของเอกชน

(๘) อาคารของศูนย์การค้าหรือห้างสรรพสินค้า

(๙) ตลาด ตามกฎหมายว่าด้วยการสาธารณสุข แต่ไม่รวมถึง ท่าเทียบเรือประมง สะพานปลา หรือกิจการแพปลา

(๑๐) ภัตตาคารหรือร้านอาหาร

“น้ำทิ้ง” หมายความว่า น้ำเสียที่ผ่านระบบบำบัดน้ำเสียแล้วจนเป็นไปตามมาตรฐานควบคุมการระบายน้ำทิ้งตามที่กำหนดไว้ในประกาศนี้

ข้อ ๓ ให้แบ่งประเภทของอาคารตามข้อ ๒ ออกเป็น ๕ ประเภท คือ

(๑) อาคารประเภท ก.

(๒) อาคารประเภท ข.

(๓) อาคารประเภท ค.

(๔) อาคารประเภท ง.

(๕) อาคารประเภท จ.

ข้อ ๔ อาคารประเภท ก. หมายความถึง อาคารดังต่อไปนี้

(๑) อาคารชุดที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๕๐๐ ห้องนอนขึ้นไป

(๒) โรงแรมที่มีจำนวนห้องสำหรับใช้เป็นห้องพักรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๒๐๐ ห้องขึ้นไป

(๓) โรงพยาบาลของทางราชการ รัฐวิสาหกิจหรือสถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาลที่มีเตียงสำหรับผู้ป่วยไว้ค้างคืนรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๓๐ เตียงขึ้นไป

(๔) อาคารโรงเรียนเอกชน โรงเรียนของทางราชการ สถาบันอุดมศึกษาของเอกชน หรือสถาบันอุดมศึกษาของทางราชการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒๕,๐๐๐ ตารางเมตรขึ้นไป

(๕) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ องค์การระหว่างประเทศ หรือของเอกชนที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕๕,๐๐๐ ตารางเมตรขึ้นไป

(๖) อาคารของศูนย์การค้าหรือห้างสรรพสินค้าที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒๕,๐๐๐ ตารางเมตรขึ้นไป

(๗) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒,๕๐๐ ตารางเมตรขึ้นไป

(๘) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒,๕๐๐ ตารางเมตรขึ้นไป

ข้อ ๕ อาคารประเภท ข. หมายความถึง อาคารดังต่อไปนี้

(๑) อาคารชุดที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๑๐๐ ห้องนอน แต่ไม่ถึง ๕๐๐ ห้องนอน

(๒) โรงแรมที่มีจำนวนห้องสำหรับใช้เป็นห้องพักรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๖๐ ห้อง แต่ไม่ถึง ๒๐๐ ห้อง

(๓) หอพักที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๒๕๐ ห้องขึ้นไป

(๔) สถานบริการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตรขึ้นไป

(๕) โรงพยาบาลของทางราชการ รัฐวิสาหกิจ หรือสถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาลที่มีเตียงสำหรับผู้ป่วยไว้ค้างคืนรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑๐ เตียง แต่ไม่ถึง ๓๐ เตียง

(๖) อาคารโรงเรียนเอกชน โรงเรียนของทางราชการ สถาบันอุดมศึกษาของเอกชน หรือสถาบันอุดมศึกษาของทางราชการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตร แต่ไม่ถึง ๒๕,๐๐๐ ตารางเมตร

(๗) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ องค์การระหว่างประเทศ หรือของเอกชนที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑๐,๐๐๐ ตารางเมตร แต่ไม่ถึง ๕๕,๐๐๐ ตารางเมตร

(๘) อาคารของศูนย์การค้าหรือห้างสรรพสินค้าที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตร แต่ไม่ถึง ๒๕,๐๐๐ ตารางเมตร

(๙) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑,๕๐๐ ตารางเมตร แต่ไม่ถึง ๒,๕๐๐ ตารางเมตร

(๑๐) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕๐๐ ตารางเมตร แต่ไม่ถึง ๒,๕๐๐ ตารางเมตร

ข้อ ๖ อาคารประเภท ค. หมายความถึง อาคารดังต่อไปนี้

(๑) อาคารชุดที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารไม่ถึง ๑๐๐ ห้องนอน

(๒) โรงแรมที่มีจำนวนห้องสำหรับใช้เป็นห้องพักรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารไม่ถึง ๖๐ ห้อง

(๓) หอพักที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๕๐ ห้อง แต่ไม่ถึง ๒๕๐ ห้อง

(๔) สถานบริการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๑,๐๐๐ ตารางเมตร แต่ไม่ถึง ๕,๐๐๐ ตารางเมตร

(๕) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ องค์การระหว่างประเทศ หรือของเอกชนที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตร แต่ไม่ถึง ๑๐,๐๐๐ ตารางเมตร

(๖) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑,๐๐๐ ตารางเมตร แต่ไม่ถึง ๑,๕๐๐ ตารางเมตร

(๗) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๒๕๐ ตารางเมตร แต่ไม่ถึง ๕๐๐ ตารางเมตร

ข้อ ๗ อาคารประเภท ง. หมายความถึง อาคารดังต่อไปนี้

(๑) หอพักที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๑๐ ห้อง แต่ไม่ถึง ๕๐ ห้อง

(๒) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๕๐๐ ตารางเมตร แต่ไม่ถึง ๑,๐๐๐ ตารางเมตร

(๓) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๑๐๐ ตารางเมตร แต่ไม่ถึง ๒๕๐ ตารางเมตร

ข้อ ๘ อาคารประเภท จ. หมายความถึง ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นไม่ถึง ๑๐๐ ตารางเมตร

ข้อ ๙ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ก. ต้องมีค่าดังต่อไปนี้

(๑) ความเป็นกรดและด่าง (PH) ต้องมีค่าระหว่าง ๕-๙

(๒) บีโอดี (BOD) ต้องมีค่าไม่เกิน ๒๐ มิลลิกรัมต่อลิตร

(๓) สารแขวนลอย (Suspended Solids) ต้องมีค่าไม่เกิน ๓๐ มิลลิกรัมต่อลิตร

(๔) ซัลไฟด์ (Sulfide) ต้องมีค่าไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร

(๕) สารที่ละลายได้ทั้งหมด (Total Dissolved Solids) ต้องมีค่าเพิ่มขึ้นจากปริมาณสารละลายในน้ำใช้ตามปกติไม่เกิน ๕๐๐ มิลลิกรัมต่อลิตร

(๖) ตะกอนหนัก (Settleable Solids) ต้องมีค่าไม่เกิน ๐.๕ มิลลิลิตรต่อลิตร

(๗) น้ำมันและไขมัน (Fat Oil and Grease) ต้องมีค่าไม่เกิน ๒๐ มิลลิกรัมต่อลิตร

(๘) ทีเคเอ็น (TKN) ต้องมีค่าไม่เกิน ๓๕ มิลลิกรัมต่อลิตร

ข้อ ๑๐ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ข. ต้องเป็นไปตามข้อ ๙ เว้นแต่

(๑) บีโอดี ต้องมีค่าไม่เกิน ๓๐ มิลลิกรัมต่อลิตร

(๒) สารแขวนลอย ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

ข้อ ๑๑ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ค. ต้องเป็นไปตามข้อ ๙ เว้นแต่

(๑) บีโอดี ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

(๒) สารแขวนลอย ต้องมีค่าไม่เกิน ๕๐ มิลลิกรัมต่อลิตร

(๓) ซัลไฟด์ ต้องมีค่าไม่เกิน ๓.๐ มิลลิกรัมต่อลิตร

(๔) ค่าทีเคเอ็น ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

ข้อ ๑๒ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ง. ต้องเป็นไปตามข้อ ๙ เว้นแต่

(๑) บีโอดี ต้องมีค่าไม่เกิน ๕๐ มิลลิกรัมต่อลิตร

(๒) สารแขวนลอย ต้องมีค่าไม่เกิน ๕๐ มิลลิกรัมต่อลิตร

(๓) ซัลไฟด์ ต้องมีค่าไม่เกิน ๔.๐ มิลลิกรัมต่อลิตร

(๔) ค่าทีเคเอ็น ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

ข้อ ๑๓ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท จ. ต้องมีค่าดังต่อไปนี้

(๑) ความเป็นกรดและด่างต้องมีค่าระหว่าง ๕-๙

(๒) บีโอดี ต้องมีค่าไม่เกิน ๒๐๐ มิลลิกรัมต่อลิตร

(๓) สารแขวนลอย ต้องมีค่าไม่เกิน ๖๐ มิลลิกรัมต่อลิตร

(๔) น้ำมันและไขมัน ต้องมีค่าไม่เกิน ๑๐๐ มิลลิกรัมต่อลิตร

ข้อ ๑๔ การตรวจสอบมาตรฐานการระบายน้ำทิ้งจากอาคาร ให้ใช้วิธีการดังต่อไปนี้

(๑) การตรวจสอบค่าความเป็นกรดและด่างให้กระทำโดยใช้เครื่องวัดความเป็นกรดและด่างของน้ำ (PH Meter)

(๒) การตรวจสอบค่าบีโอดีให้กระทำโดยใช้วิธีการอะไซด์โมดิฟิเคชั่น (Azide Modification) ที่อุณหภูมิ ๒๐ องศาเซลเซียส เป็นเวลา ๕ วัน ติดต่อกันหรือวิธีการอื่นที่คณะกรรมการควบคุมมลพิษให้ความเห็นชอบ

(๓) การตรวจสอบค่าสารแขวนลอยให้กระทำโดยใช้วิธีการกรองผ่านกระดาษกรองใยแก้ว (Glass Fibre Filter Disc)

(๔) การตรวจสอบค่าซัลไฟด์ให้กระทำโดยใช้วิธีการไตเตรท (Titrate)

(๕) การตรวจสอบค่าสารที่ละลายได้ทั้งหมดให้กระทำโดยใช้วิธีการระเหยแห้งระหว่างอุณหภูมิ ๑๐๓ องศาเซลเซียส ถึงอุณหภูมิ ๑๐๕ องศาเซลเซียส ในเวลา ๑ ชั่วโมง

(๖) การตรวจสอบค่าตะกอนหนักให้กระทำโดยใช้วิธีการกรวยอิมฮอฟฟ์ (Imhoff cone) ขนาดบรรจุ ๑,๐๐๐ ลูกบาศก์เซนติเมตร ในเวลา ๑ ชั่วโมง

(๗) การตรวจสอบค่าน้ำมันและไขมันให้กระทำโดยใช้วิธีการสกัดด้วยตัวทำละลาย แล้วแยกหาน้ำหนักของน้ำมันและไขมัน

(๘) การตรวจสอบค่าทีเคเอ็นให้กระทำโดยใช้วิธีการเจลดาห์ล (Kjeldahl)

ข้อ ๑๕ การคิดคำนวณพื้นที่ใช้สอย จำนวนอาคารและจำนวนห้องของอาคาร หรือกลุ่มของอาคารให้เป็นไปตามวิธีการที่คณะกรรมการควบคุมมลพิษกำหนด โดยประกาศในราชกิจจานุเบกษา

ข้อ ๑๖ วิธีการเก็บตัวอย่างน้ำ ความถี่ และระยะเวลาในการเก็บตัวอย่างน้ำ ให้เป็นไปตามที่คณะกรรมการควบคุมมลพิษกำหนด โดยประกาศในราชกิจจานุเบกษา

ข้อ ๑๗ ประกาศนี้ให้ใช้บังคับตั้งแต่วันถัดจากวันประกาศในราชกิจจานุเบกษาเป็นต้นไป

ประกาศ ณ วันที่ ๗ พฤศจิกายน พ.ศ. ๒๕๔๘

ยงยุทธ ติยะไพรัช

รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

ภาคผนวก ง-2

ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม
เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด พ.ศ. 2567 ประกาศในราชกิจจานุเบกษา
เล่มที่ 141 ตอนที่ 233 ง วันที่ 27 สิงหาคม พ.ศ. 2567



ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด

พ.ศ. ๒๕๖๗

โดยที่เป็นการสมควรปรับปรุงการกำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ให้เหมาะสมตามความก้าวหน้าในทางวิทยาศาสตร์ เทคโนโลยี และความเปลี่ยนแปลงทางเศรษฐกิจ สังคม ของประเทศ และให้สอดคล้องกับสภาพการณ์ปัจจุบัน

อาศัยอำนาจตามความในมาตรา ๕๕ แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. ๒๕๓๕ รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม โดยคำแนะนำของคณะกรรมการควบคุมมลพิษ และโดยความเห็นชอบของคณะกรรมการสิ่งแวดล้อมแห่งชาติ จึงออกประกาศไว้ ดังต่อไปนี้

ข้อ ๑ ให้ยกเลิกประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด ฉบับลงวันที่ ๗ พฤศจิกายน พ.ศ. ๒๕๔๘

ข้อ ๒ ในประกาศนี้

“อาคาร” หมายความว่า อาคารที่ก่อสร้างขึ้น ไม่ว่าจะมีลักษณะเป็นอาคารหลังเดียวหรือเป็นกลุ่มของอาคารซึ่งตั้งอยู่ภายในพื้นที่ซึ่งเป็นบริเวณเดียวกัน และไม่ว่าจะมีท่อระบายน้ำท่อเดียวหรือมีหลายท่อที่เชื่อมติดต่อกันระหว่างอาคารหรือไม่ก็ตาม

“น้ำทิ้ง” หมายความว่า น้ำที่เกิดจากกิจกรรมของอาคารที่ระบายหรือจะระบายลงสู่แหล่งน้ำสาธารณะหรือออกสู่สิ่งแวดล้อม

ข้อ ๓ ให้แบ่งอาคาร ออกเป็น ๓ ชนิด คือ

ชนิดที่ ๑ อาคารอยู่อาศัย หมายถึง อาคารที่มีวัตถุประสงค์ให้เป็นที่พักอาศัยของบุคคลทั้งการอยู่อาศัยอย่างถาวรหรือชั่วคราว ได้แก่

(๑) อาคารชุด ตามกฎหมายว่าด้วยอาคารชุด

(๒) หอพัก ตามกฎหมายว่าด้วยหอพัก

(๓) หอพัก ห้องเช่า ห้องแบ่งเช่า หรือกิจการอื่นในทำนองเดียวกันตามกฎหมายว่าด้วยการสาธารณสุข

(๔) สถานรับเลี้ยงเด็ก ตามกฎหมายว่าด้วยคุ้มครองเด็ก

(๕) สถานดูแลผู้สูงอายุหรือผู้มีภาวะพึ่งพิง ตามกฎหมายว่าด้วยสถานประกอบการเพื่อสุขภาพ

(๖) ที่พักอาศัยสำหรับลูกจ้างประเภทกิจกรรมก่อสร้าง ตามกฎหมายว่าการคุ้มครองแรงงาน

ชนิดที่ ๒ อาคารพาณิชย์ หมายถึง อาคารที่ใช้ประโยชน์ในการพาณิชยกรรม หรือบริการธุรกิจอย่างเดียวหรือหลายอย่าง ได้แก่

(๑) โรงแรม ตามกฎหมายว่าด้วยโรงแรม

(๒) ศูนย์การค้าหรือห้างสรรพสินค้า

(๓) ตลาด ตามกฎหมายว่าด้วยการสาธารณสุข

(๔) สถานบริการประเภทสถานอาบน้ำ นวดหรืออบตัว ตามกฎหมายว่าด้วยสถานบริการ

(๕) ภัตตาคารหรือร้านอาหาร

(๖) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ หรือองค์การระหว่างประเทศและของเอกชน

(๗) อาคารโรงเรียนเอกชน ตามกฎหมายว่าด้วยโรงเรียนเอกชน โรงเรียนของทางราชการ อาคารสถาบันอุดมศึกษาของเอกชน ตามกฎหมายว่าด้วยสถาบันอุดมศึกษาของเอกชนและสถาบันอุดมศึกษาของทางราชการ

ชนิดที่ ๓ อาคารสถานพยาบาล หมายถึง สถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาล ประเภทที่รับผู้ป่วยไว้ค้างคืน

ข้อ ๔ ให้แบ่งขนาดของอาคาร ออกเป็น ๔ ประเภท ดังต่อไปนี้

ประเภทอาคาร	หน่วย	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
๑. อาคารอยู่อาศัย					
อาคารชุด	ห้องชุด	ตั้งแต่ ๕๐๐ ขึ้นไป	ตั้งแต่ ๑๐๐ แต่ไม่ถึง ๕๐๐	ไม่ถึง ๑๐๐	-
หอพัก	ห้อง	-	ตั้งแต่ ๒๕๐ ขึ้นไป	ตั้งแต่ ๕๐ แต่ไม่ถึง ๒๕๐	ไม่ถึง ๕๐
หอพัก ห้องเช่า ห้องแบ่งเช่า หรือกิจการอื่นในทำนองเดียวกัน ตามกฎหมายว่าด้วยการสาธารณสุข	ห้อง	-	ตั้งแต่ ๒๕๐ ขึ้นไป	ตั้งแต่ ๕๐ แต่ไม่ถึง ๒๕๐	ไม่ถึง ๕๐
สถานรับเลี้ยงเด็ก	-	-	-	-	ทุกขนาด
สถานดูแลผู้สูงอายุหรือผู้มีภาวะพึ่งพิง	-	-	-	-	ทุกขนาด
ที่พักอาศัยสำหรับลูกจ้างประเภทกิจกรรมก่อสร้าง	-	-	-	-	ทุกขนาด
๒. อาคารพาณิชย์					
โรงแรม	ห้อง	ตั้งแต่ ๒๐๐ ขึ้นไป	ตั้งแต่ ๖๐ แต่ไม่ถึง ๒๐๐	ไม่ถึง ๖๐	-
สถานบริการประเภทสถานอาบน้ำ นวดหรืออบตัว	ตารางเมตร	-	ตั้งแต่ ๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๑,๐๐๐ แต่ไม่ถึง ๕,๐๐๐	ไม่ถึง ๑,๐๐๐
โรงเรียนเอกชน โรงเรียนของทางราชการ สถาบันอุดมศึกษาของเอกชนหรือสถาบันอุดมศึกษาของทางราชการ		ตั้งแต่ ๒๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๒๕,๐๐๐	-	ไม่ถึง ๕,๐๐๐

ประเภทอาคาร	หน่วย	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ หรือองค์การระหว่างประเทศและของเอกชน		ตั้งแต่ ๕๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๑๐,๐๐๐ แต่ไม่ถึง ๕๕,๐๐๐	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๑๐,๐๐๐	ไม่ถึง ๕,๐๐๐
ศูนย์การค้า หรือห้างสรรพสินค้า		ตั้งแต่ ๒๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๒๕,๐๐๐	-	ไม่ถึง ๕,๐๐๐
ตลาด		ตั้งแต่ ๒,๕๐๐ ขึ้นไป	ตั้งแต่ ๑,๕๐๐ แต่ไม่ถึง ๒,๕๐๐	ตั้งแต่ ๑,๐๐๐ แต่ไม่ถึง ๑,๕๐๐	ไม่ถึง ๑,๐๐๐
ภัตตาคารหรือร้านอาหาร		ตั้งแต่ ๒,๕๐๐ ขึ้นไป	ตั้งแต่ ๕๐๐ แต่ไม่ถึง ๒,๕๐๐	ตั้งแต่ ๒๕๐ แต่ไม่ถึง ๕๐๐	ไม่ถึง ๒๕๐
๓. อาคารสถานพยาบาล	เตียง	ตั้งแต่ ๓๐ ขึ้นไป	ตั้งแต่ ๑๐ แต่ไม่ถึง ๓๐	-	ไม่ถึง ๑๐

ข้อ ๕ กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารไว้ ดังต่อไปนี้

พารามิเตอร์	ค่ามาตรฐาน			
	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
๑. ความเป็นกรดและด่าง (pH)	๕.๕ - ๙.๐	๕.๕ - ๙.๐	๕.๕ - ๙.๐	๕.๕ - ๙.๐
๒. บีโอดี (Biochemical Oxygen Demand)	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๓๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร สำหรับอาคารอยู่อาศัย ไม่เกิน ๑๐๐ มิลลิกรัมต่อลิตร สำหรับอาคารพาณิชย์และอาคารสถานพยาบาล
๓. ของแข็งแขวนลอยทั้งหมด (Total Suspended Solids)	ไม่เกิน ๓๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๖๐ มิลลิกรัมต่อลิตร
๔. ของแข็งละลายน้ำทั้งหมด (Total Dissolved Solids)	ไม่เกิน ๑,๐๐๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑,๐๐๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑,๓๐๐ มิลลิกรัมต่อลิตร	-

พารามิเตอร์	ค่ามาตรฐาน			
	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
	สำหรับอาคารอยู่อาศัยและอาคารพาณิชย์	สำหรับอาคารอยู่อาศัยและอาคารพาณิชย์	สำหรับอาคารอยู่อาศัยและอาคารพาณิชย์	
	เพิ่มขึ้นจากปริมาณในน้ำใช้ปกติไม่เกิน ๑,๐๐๐ สำหรับอาคารสถานพยาบาล	เพิ่มขึ้นจากปริมาณในน้ำใช้ปกติไม่เกิน ๑,๐๐๐ สำหรับอาคารสถานพยาบาล	-	-
๕. ซัลไฟด์ (Sulfide)	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	-
๖. ทีเคเอ็น (Total Kjeldahl Nitrogen)	ไม่เกิน ๓๕ มิลลิกรัมต่อลิตร	ไม่เกิน ๓๕ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	-
๗. น้ำมันและไขมัน (Oil and Grease)	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร สำหรับอาคารอยู่อาศัย ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร สำหรับอาคารพาณิชย์และอาคารสถานพยาบาล
๘ แบคทีเรียกลุ่มโคลิฟอร์มทั้งหมด (Total Coliform Bacteria) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๕,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิกรัม)	ไม่เกิน ๕,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิกรัม)	-	-
๙ แบคทีเรียกลุ่มฟีคอลโคลิฟอร์ม (Fecal Coliform Bacteria) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๑,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิกรัม)	ไม่เกิน ๑,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิกรัม)	-	-
๑๐. คลอรีนอิสระ (Free Chlorine) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	-	-

ข้อ ๖ การตรวจสอบมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารให้ใช้วิธีการ ดังต่อไปนี้

๖.๑ ความเป็นกรดและด่าง ให้ใช้เครื่องวัดความเป็นกรดและด่างของน้ำ (pH Meter) ที่มีความละเอียดไม่ต่ำกว่า ๐.๑ หน่วย

๖.๒ บีโอดี ให้ใช้วิธีบ่มตัวอย่างที่อุณหภูมิ ๒๐ องศาเซลเซียส เป็นเวลา ๕ วันติดต่อกัน และหาค่าออกซิเจนละลายด้วยวิธีเอไซด์มอดิฟิเคชัน (Azide Modification) หรือวิธีเมมเบรนอิเล็กโทรด (Membrane Electrode) หรือวิธีออปติกคอลโพรบ (Optical Probe)

๖.๓ ของแข็งแขวนลอยทั้งหมด ให้ใช้วิธีกรองผ่านกระดาษกรองใยแก้ว (Glass Fiber Filter) และอบแห้งที่อุณหภูมิ ตั้งแต่ ๑๐๓ ถึง ๑๐๕ องศาเซลเซียส เป็นเวลาอย่างน้อย ๑ ชั่วโมง

๖.๔ ของแข็งละลายน้ำทั้งหมด ให้ใช้วิธีระเหยตัวอย่างที่กรองผ่านกระดาษกรองใยแก้ว (Glass Fiber Filter) และอบแห้งที่อุณหภูมิ ๑๘๐ องศาเซลเซียส เป็นเวลาอย่างน้อย ๑ ชั่วโมง

๖.๕ ซัลไฟด์ ให้ใช้วิธีไอโอโดเมทริก (Iodometric Method) หรือวิธีเมทิลีนบลู (Methylene Blue Method)

๖.๖ ทีเคเอ็น ให้ใช้วิธีเจลดาห์ล (Kjeldahl)

๖.๗ น้ำมันและไขมัน ให้ใช้วิธีสกัดด้วยตัวทำละลายแล้วแยกหาน้ำหนักของน้ำมันและไขมัน

๖.๘ แบคทีเรียกลุ่มโคลิฟอร์มทั้งหมดและแบคทีเรียกลุ่มฟีคอลโคลิฟอร์ม ให้ใช้วิธีมัลติเพิล ทิวบ์ เฟอร์เมนเทชัน เทคนิค (Multiple Tube Fermentation Technique)

๖.๙ คลอรีนอิสระ ให้ใช้วิธีไทเทรต (Titrimetric method) หรือวิธีเทียบสี (Colorimetric method) หรือวิธีไอโอโดเมทริก อิเล็กโทรด (Iodometric Electrode Technique)

ข้อ ๗ การคิดคำนวณขนาดของอาคารตามข้อ ๔ ให้เป็นไปตามวิธีการที่คณะกรรมการควบคุมมลพิษกำหนด โดยประกาศในราชกิจจานุเบกษา

ข้อ ๘ การตรวจสอบค่ามาตรฐานน้ำทิ้งตามข้อ ๖ ต้องเป็นไปตามคู่มือวิเคราะห์น้ำและน้ำเสียของสมาคมวิศวกรรมสิ่งแวดล้อมแห่งประเทศไทย หรือ Standard Methods for the Examination of Water and Wastewater ซึ่ง American Public Health Association, American Water Works Association และ Water Environment Federation ของประเทศสหรัฐอเมริกากำหนดฉบับล่าสุด หรือตามที่คณะกรรมการควบคุมมลพิษประกาศในราชกิจจานุเบกษา

ข้อ ๙ การเก็บตัวอย่างน้ำทิ้งเพื่อการตรวจสอบมาตรฐานควบคุมการระบายน้ำทิ้งตามข้อ ๕ ให้เป็น ดังต่อไปนี้

๙.๑ ให้เก็บในจุดระบายทิ้งลงสู่แหล่งน้ำสาธารณะหรือออกสู่สิ่งแวดล้อมหรือจุดอื่นที่สามารถใช้เป็นตัวแทนของน้ำทิ้งที่ระบายออกจากอาคาร ในกรณีมีการระบายทิ้งหลายจุดให้เก็บทุกจุด

๙.๒ วิธีการเก็บตัวอย่างน้ำทิ้ง ณ จุดเก็บตัวอย่างตามข้อ ๙.๑ ให้เก็บแบบจ้วง (Grab Sampling)

ข้อ ๑๐ ประกาศนี้ให้ใช้บังคับตั้งแต่วันถัดจากวันประกาศในราชกิจจานุเบกษาเป็นต้นไป

ประกาศ ณ วันที่ ๒๘ มิถุนายน พ.ศ. ๒๕๖๗
พลตำรวจเอก พัชรวาท วงษ์สุวรรณ
รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

ภาคผนวก ง-3

มาตรฐานตามคำแนะนำของคณะกรรมการสาธารณสุข
ฉบับที่ 1/2550 เรื่อง การควบคุมการประกอบกิจการ
สระว่ายน้ำ หรือกิจการอื่น ๆ ในทำนองเดียวกัน



คำแนะนำของคณะกรรมการสาธารณสุข

ฉบับที่ 1 / 2550

เรื่อง การควบคุมการประกอบกิจการสระว่ายน้ำ หรือกิจการอื่นๆ ในทำนองเดียวกัน

****

การประกอบกิจการสระว่ายน้ำ หรือกิจการอื่นๆ ในทำนองเดียวกัน เป็นกิจการที่ถูกควบคุมในลักษณะที่เป็นกิจการที่เป็นอันตรายต่อสุขภาพ ตามมาตรา 31 แห่งพระราชบัญญัติการสาธารณสุข พ.ศ. 2535 ซึ่งการประกอบกิจการนี้เป็นแหล่งที่ผู้ใช้บริการเข้ามาชุมนุมอยู่รวมกันในสระว่ายน้ำ สวนน้ำ สวนสนุกที่มีลักษณะเช่นเดียวกับสระว่ายน้ำ อันอาจก่อให้เกิดผลกระทบต่อสุขภาพของประชาชน เนื่องจากมีการก่อสร้างสระว่ายน้ำ หรือกิจการอื่นๆ ในทำนองเดียวกันเพิ่มมากขึ้น ทั้งสโมสร สมาคม สถานศึกษา สวนสนุก และชุมชนในท้องถิ่นทั่วไป ซึ่งถ้าสระว่ายน้ำเหล่านี้ขาดการดูแลและบำรุงรักษาตามหลักสุขาภิบาล การอนามัยสิ่งแวดล้อม การดูแลคุณภาพน้ำ รวมทั้งมาตรการด้านความปลอดภัยอย่างถูกต้อง สระว่ายน้ำอาจกลายเป็นแหล่งแพร่เชื้อโรคต่างๆ ได้ เช่น โรคเยื่อตาอักเสบ หูอักเสบ โรคผิวหนัง โรคระบบทางเดินหายใจ โรคระบบทางเดินอาหาร รวมทั้งโรคไม่ติดเชื้อต่างๆ อันมีผลมาจากการใช้สารเคมี เช่น อาการผิวหนังเนื่องจากแพ้สารเคมี อาการเจ็บคอ ไอ แน่นหน้าอก อาการคลื่นไส้อาเจียน เนื่องจากแพ้สารเคมี นอกจากนั้นยังรวมถึงอุบัติเหตุต่างๆ ด้วย

อาศัยอำนาจตามความในมาตรา 10(3) แห่งพระราชบัญญัติการสาธารณสุข พ.ศ. 2535คณะกรรมการสาธารณสุขจึงได้มีมติในคราวการประชุมครั้งที่ 43-3/2549 เมื่อวันที่ 27 มิถุนายน 2549 เห็นชอบให้ออกคำแนะนำแก่ราชการส่วนท้องถิ่นในการออกข้อกำหนดท้องถิ่นเกี่ยวกับหลักเกณฑ์ในการควบคุมกำกับดูแลการประกอบกิจการสระว่ายน้ำหรือกิจการอื่นในทำนองเดียวกัน ดังต่อไปนี้

ข้อ 1 กรณีที่ในเขตราชการส่วนท้องถิ่นใด มีการประกอบกิจการสระว่ายน้ำและกิจการอื่นในทำนองเดียวกัน ราชการส่วนท้องถิ่นนั้นอาจออกข้อกำหนดของท้องถิ่นกำหนดให้กิจการดังกล่าว เป็นกิจการที่ต้องควบคุมในท้องถิ่นนั้นได้ ตามมาตรา 32 (1) แห่งพระราชบัญญัติการสาธารณสุข พ.ศ. 2535

ข้อ 2 เพื่อประโยชน์ในการควบคุมหรือกำกับดูแลสถานประกอบกิจการสระว่ายน้ำหรือกิจการอื่นๆ ในทำนองเดียวกัน ราชการส่วนท้องถิ่นอาจพิจารณาออกข้อกำหนดของท้องถิ่น กำหนดหลักเกณฑ์ และเงื่อนไขทั่วไป ให้ผู้ดำเนินกิจการปฏิบัติเกี่ยวกับสภาพหรือสุขลักษณะของสถานที่ที่ใช้ในการประกอบกิจการ และมาตรการป้องกันอันตรายต่อสุขภาพ ตามมาตรา 32(2) แห่งพระราชบัญญัติการสาธารณสุข พ.ศ. 2535 ตามหลักเกณฑ์ด้านสุขลักษณะในการควบคุมการประกอบกิจการสระว่ายน้ำ หรือกิจการอื่นๆ ในทำนองเดียวกันที่แนบมาพร้อมนี้

ข้อ 3 กรณีที่ราชการส่วนท้องถิ่นใดออกข้อกำหนดของท้องถิ่นว่าด้วยการประกอบกิจการสระว่ายน้ำ หรือกิจการอื่นๆ ในทำนองเดียวกัน ควรจัดให้มีการประชาสัมพันธ์ และประชุมชี้แจงข้อกำหนดของท้องถิ่นดังกล่าวเพื่อให้ผู้ประกอบกิจการได้ทราบโดยทั่วกันด้วย ทั้งนี้เพื่อประโยชน์ในการบังคับใช้ต่อไป

ให้ไว้ ณ วันที่ 20 มกราคม 2550

(นายปราชญ์ บุณยวงศ์วิโรจน์)
ปลัดกระทรวงสาธารณสุข

หลักเกณฑ์ด้านสุขลักษณะ
ในการควบคุมการประกอบกิจการสระว่ายน้ำ หรือกิจการอื่นๆในทำนองเดียวกัน

****

คำแนะนำนี้ให้ใช้กับกิจการสระว่ายน้ำที่เป็นบริการสาธารณะ(Public swimming pool) เช่น กิจการสระว่ายน้ำที่ให้บริการแก่ประชาชนโดยทั่วไป ซึ่งรวมถึงสระว่ายน้ำที่เป็นสวนน้ำ สวนสนุกที่มีลักษณะเช่นเดียวกับสระว่ายน้ำที่ให้บริการในลักษณะเพื่อการค้า และสระว่ายน้ำที่เปิดให้บริการสาธารณะที่มิใช่การค้าแต่เพื่อสวัสดิการ เช่น สระว่ายน้ำที่ราชการส่วนท้องถิ่นจัดไว้เพื่อสาธารณะประโยชน์ รวมทั้ง สระว่ายน้ำที่เป็นของสโมสรของโรงงานที่บริการเฉพาะพนักงาน หรือหน่วยงานองค์กรที่บริการในกลุ่มเฉพาะ ยกเว้นสระว่ายน้ำส่วนบุคคลหรือที่มิได้ให้บริการแก่สาธารณะ

1. สถานที่ตั้ง

1.1 สถานที่ตั้ง ควรห่างจากแหล่งซึ่งอาจทำให้เกิดการปนเปื้อนน้ำในสระว่ายน้ำ เช่น สถานที่เลี้ยงสัตว์ สถานที่ทิ้งหรือรวบรวมมูลฝอย เป็นต้น

1.2 ควรมีรั้วหรือกำแพงเพื่อสุขอนามัยและความปลอดภัยของผู้ใช้บริการ และเพื่อป้องกันไม่ให้บุคคลภายนอกที่ไม่ได้รับอนุญาตไปใช้สระว่ายน้ำ ในช่วงที่ไม่เปิดให้บริการ รวมทั้งป้องกันสัตว์เข้ามาในบริเวณสระว่ายน้ำ

1.3 สถานที่ตั้งและบริเวณของสระว่ายน้ำ รวมทั้งระบบสาธารณูปโภคต้องอยู่ในที่น้ำท่วมไม่ถึง พื้นดินแข็งแรงไม่ทรุดง่าย อยู่ในบริเวณที่มีไฟฟ้า และน้ำประปาเพียงพอ มีทางเข้าออกสะดวก

2. สระว่ายน้ำและอาคารประกอบ

2.1 โครงสร้างสระว่ายน้ำ ควรสร้างด้วยคอนกรีตเสริมเหล็ก หรือวัสดุที่มีความมั่นคงแข็งแรง น้ำซึมไม่ได้ ผนังเรียบ อยู่ในสภาพดี และทำความสะอาดง่าย

2.2 ต้องมีรางระบายน้ำล้นมีฝาปิดรอบสระว่ายน้ำ มีความกว้าง 30-40 เซนติเมตร ไม่เป็นสนิม แข็งแรง ทำความสะอาดง่าย อยู่ในสภาพดี และไม่มีน้ำล้นออกจากราง

2.3 ต้องมีอุปกรณ์ เครื่องมือสำหรับใช้ทำความสะอาดสระว่ายน้ำ ได้แก่ เครื่องดูดตะกอน แปรงขัดสระชนิดลวดทองเหลืองและพลาสติก รวมทั้งตะแกรงช้อนวัสดุเขวนลอย

2.4 ต้องมีที่ว่างสำหรับใช้เป็นทางเดินรอบสระว่ายน้ำ มีความกว้างไม่น้อยกว่า 1.20 เมตร ไม่ลื่น ไม่มีน้ำขัง ทำความสะอาดง่าย

2.5 กรณีที่สระว่ายน้ำใดมีการใช้ระบบการไหลเวียนน้ำเป็นแบบระบบสกิมเมอร์ ควรต้องมีข้อกำหนดเกี่ยวกับการป้องกันอันตรายจากระบบนี้ด้วย

2.6 ความลึกของน้ำ มีป้ายบอกความลึกหรือเลขบอกระดับความลึกที่สามารถมองเห็นได้ชัดเจน ในกรณีที่สระว่ายน้ำนั้นมีความลึกตั้งแต่ 1.5 เมตรขึ้นไป โดยมีตัวเลขแสดงความลึกเป็นระยะๆ อย่างน้อย 3 ระยะ

2.7 ต้องจัดให้มีแสงสว่างเพียงพอทั่วบริเวณสระว่ายน้ำ เพื่อให้มองเห็นได้ชัดเจน ในกรณีที่มีการเปิดใช้สระในเวลากลางคืน

2.8 อาคารประกอบทำด้วยวัสดุมั่นคงแข็งแรง พื้นเรียบ ไม่ลื่นไม่ดูดซึมน้ำ ทำความสะอาดง่าย พื้นลาดเอียงเล็กน้อยเพื่อการระบายน้ำที่ดี

2.9 พื้น ควรทำด้วยวัสดุแข็งแรง เรียบ ไม่ดูดซึมน้ำ ทำความสะอาดง่าย ไม่ลื่น อยู่ในสภาพดี

2.10 จัดให้มีห้องเปลี่ยนเสื้อผ้า ตู้เก็บสิ่งของ ที่วางหรือเก็บรองเท้า สำหรับผู้ใช้บริการในบริเวณทางเข้าสระว่ายน้ำ และมีจำนวนเพียงพอ

2.11 จัดให้มีอ่างล้างมือ บริเวณล้างตัวก่อนลงสระ และที่ล้างเท้า ทางเข้าบริเวณสระว่ายน้ำ และเติมคลอรีนลงในที่ล้างเท้าเพื่อป้องกันการติดเชื้อ

2.12 มีการรักษาความสะอาดรอบอาคารประกอบและพื้นที่โดยรอบอย่างสม่ำเสมอ

2.13 ดูแลมิให้มีการนำสัตว์ทุกชนิดเข้าไปในบริเวณสระว่ายน้ำ หรืออาคารประกอบ

3. ข้อปฏิบัติสำหรับผู้ประกอบกิจการ

3.1 จัดให้มีผู้ควบคุมดูแล ซึ่งผ่านการฝึกอบรมการดูแลคุณภาพน้ำในสระว่ายน้ำตามหลักสุขาภิบาลสิ่งแวดล้อม เพื่อให้มีความรู้เกี่ยวกับการควบคุมคุณภาพน้ำ และการดูแลรักษาสระว่ายน้ำ

3.2. ต้องมีเจ้าหน้าที่ความปลอดภัยประจำสระ (Life guard) อย่างน้อย 1 คน ต่อผู้ใช้บริการไม่เกิน 100 คน กรณีที่เกิน 100 คน เศษของ 100 คน ให้คิดเป็น 100 คน และต้องเป็นผู้ที่มีความชำนาญในการว่ายน้ำและผ่านการอบรมการช่วยชีวิตคนจมน้ำ สามารถให้การปฐมพยาบาลได้ โดยต้องอยู่ประจำสระว่ายน้ำตลอดเวลาที่เปิดบริการ

3.3 ต้องมีการจัดการและควบคุมคุณภาพน้ำให้อยู่ในเกณฑ์มาตรฐาน ดังนี้

3.3.1 ค่าความเป็นกรด-ด่าง (pH)	7.2 – 8.4
3.3.2 คลอรีนอิสระ (Free chlorine)	0.6– 1.0 ส่วนในล้านส่วน
3.3.3 คลอรีนที่รวมกับสารอื่น (Combined chlorine)	0.5 -1.0 ส่วนในล้านส่วน
3.3.4 ค่าความเป็นด่าง (Alkalinity)	80 – 100 ส่วนในล้านส่วน
3.3.5 ความกระด้าง (Calcium hardness)	250 -600 ส่วนในล้านส่วน
3.3.6 กรดไซยานูริก (Cyanuric acid)	30-60 ส่วนในล้านส่วน
3.3.7 คลอไรด์ (Chloride)	ไม่เกิน 600 ส่วนในล้านส่วน

3.3.8 แอมโมเนีย (Ammonia) ไม่เกิน 20 ส่วนในล้านส่วน

3.3.9 ไนเตรท (Nitrate) ไม่เกิน 50 ส่วนในล้านส่วน

3.3.10 โคลิฟอร์มทั้งหมด (Total Coliform Bacteria) น้อยกว่า 10 ต่อน้ำ 100 มิลลิลิตร โดยวิธีเอ็มพีเอ็น(Most Probable Numbers)ในอัตราส่วน 100 มิลลิลิตร

3.3.11 ตรวจไม่พบฟีคอลโคลิฟอร์ม (Fecal coliform)

3.3.12 ตรวจไม่พบจุลินทรีย์หรือตัวบ่งชี้จุลินทรีย์ที่ทำให้เกิดโรค (ได้แก่*Escherichia coli Staphylococcus aureus Pseudomonas aeruginosa*)

3.4 จัดให้มีการเก็บตัวอย่างเพื่อตรวจวิเคราะห์คุณภาพน้ำ ตามเกณฑ์มาตรฐานดังนี้

3.4.1 การเก็บตัวอย่างต้องทำอย่างน้อย 2 จุด โดยเก็บจากส่วนลึกและส่วนตื้น ขณะที่มีผู้ใช้สระว่ายน้ำมากที่สุด

3.4.2 ตรวจวิเคราะห์ปริมาณคลอรีนอิสระคงเหลือ และค่าความเป็นกรด-ด่าง อย่างน้อยวันละ 2 ครั้ง ก่อนเปิดและหลังปิดบริการ หากมีผู้ใช้บริการเป็นจำนวนมาก หรือเป็นวันที่มีแสงแดดจัดควรตรวจสอบปริมาณคลอรีน และค่าความเป็นกรด-ด่างในระหว่างวันด้วย กรณีใช้คลอรีนชนิดกรดไตรคลอโรไอโซไซยานูริค ต้องตรวจหาค่ากรดไซยานูริคด้วย

3.4.3 ตรวจวิเคราะห์ปริมาณโคลิฟอร์มทั้งหมด (Total Coliform Bacteria) และฟีคอลโคลิฟอร์ม (Fecal coliform) อย่างน้อยเดือนละ 1 ครั้ง

3.4.4 ตรวจวิเคราะห์คุณภาพน้ำทางเคมี และชีวภาพ ตามเกณฑ์มาตรฐานตามที่กำหนดในข้อ 3.3 ครบทุกข้อมูล อย่างน้อยปีละ 1 ครั้ง เพื่อประกอบการพิจารณาขอหรือต่อใบอนุญาต

3.5 จัดหาเครื่องมือสำหรับตรวจวิเคราะห์คุณภาพน้ำไว้ประจำ รวมทั้งบันทึกผลการตรวจวิเคราะห์ และข้อมูลอื่นที่จำเป็น ดังนี้

3.5.1 เครื่องมือที่ใช้ตรวจวิเคราะห์ปริมาณคลอรีน ต้องสามารถตรวจวิเคราะห์ได้ในช่วง 0.2 – 2 ส่วนในล้านส่วน

3.5.2 เครื่องมือที่ใช้ตรวจวิเคราะห์ค่าความเป็นกรด-ด่าง ต้องสามารถตรวจวัดได้อย่างน้อยช่วง 3-9 และสามารถอ่านค่าได้ช่วงละ 1

3.5.3 มีการบันทึกข้อมูลจำนวนผู้ใช้สระว่ายน้ำในแต่ละวัน แยกเพศและอายุ ระยะเวลาที่ใช้สระว่ายน้ำ

3.6 ต้องจัดให้มีป้ายแสดงข้อปฏิบัติสำหรับผู้ใช้บริการติดไว้ในบริเวณสระว่ายน้ำ ให้มองเห็นชัดเจน และควรมีข้อความอย่างน้อยดังนี้

3.6.1 ต้องสวมชุดว่ายน้ำที่สะอาด

3.6.2 ต้องชำระล้างร่างกายก่อนลงสระทุกครั้ง

3.6.3 ผู้ที่เป็นโรคตาแดง โรคผิวหนัง เป็นหวัด หูน้ำหนวก หรือโรคติดต่ออื่นๆ ห้ามลงเล่นในสระว่ายน้ำ

3.6.4 ห้ามนำสัตว์เลี้ยงเข้ามาในบริเวณสระว่ายน้ำ

3.6.5 ห้ามปัสสาวะ บ้วนน้ำลาย หรือสั่งน้ำมูกลงในน้ำ

3.6.6 ห้ามทำสระว่ายน้ำสกปรก

3.6.7 จำนวนผู้ใช้บริการมากที่สุด ที่สระว่ายน้ำสามารถรองรับได้

3.6.8 วิธีการปฐมพยาบาลช่วยคนจมน้ำ

3.7 ต้องดูแลบำรุงรักษาเครื่องกรองน้ำตามระยะเวลาที่สมควรเพื่อให้ทำงานได้เต็มประสิทธิภาพ

4. การจัดการเกี่ยวกับสารเคมี

4.1 สถานที่เก็บสารเคมี ต้องมีป้ายระบุว่า "สถานที่เก็บสารเคมีอันตราย" และ "ห้ามเข้า" มีการระบายอากาศดี และมีการป้องกันน้ำซึมเข้าภาชนะบรรจุสารเคมี และมีการจัดเก็บสารเคมีเป็นไปตามกฎหมายที่เกี่ยวข้อง

4.2 สารเคมีที่ใช้ต้องมีฉลากระบุชื่อสารเคมี ส่วนผสม หรือส่วนประกอบที่เป็นอันตราย วิธีการใช้และวิธีการปฐมพยาบาลในกรณีฉุกเฉิน หรือตามที่กฎหมายอื่นกำหนด

4.3 ในการใช้สารเคมีต้องปฏิบัติตามที่ระบุไว้ในฉลาก และไม่นำสารเคมีหมดอายุมาใช้ ในกรณีที่ไม่มีระบบการเติมสารเคมีแบบอัตโนมัติให้เติมสารเคมีลงในสระว่ายน้ำในขณะที่ปิดบริการแล้ว

4.4 สถานที่ทำงานที่เกี่ยวข้องกับการใช้สารเคมี ต้องมีแสงสว่างเพียงพอ เพื่อป้องกันการเกิดอุบัติเหตุอันเนื่องจากพนักงานไม่สามารถมองเห็นสิ่งต่าง ๆ ได้อย่างชัดเจน ค่ามาตรฐานแสงสว่างในบริเวณต่างๆ ควรเป็นดังนี้

- ห้องสูบจ่ายสารเคมีไม่น้อยกว่า 100 ลักซ์
- ห้องเครื่องกรองน้ำไม่น้อยกว่า 50 ลักซ์
- ห้องหรือสถานที่เก็บสารเคมีไม่น้อยกว่า 50 ลักซ์

4.5 ต้องมีมาตรการในการป้องกันการสัมผัสสารเคมีของคนงาน เช่น กำหนดขั้นตอนการทำงานที่ปลอดภัย จัดหาอุปกรณ์ป้องกันอันตรายส่วนบุคคลที่เหมาะสมให้คนงาน รวมทั้งประเมินการสัมผัสสารเคมีอันตรายของคนงานที่ทำหน้าที่เติมสารเคมี และมีผลไว้ให้เจ้าหน้าที่ตรวจสอบอย่างน้อยปีละหนึ่งครั้ง

4.6 ในขณะทำงานกับสารเคมี ให้ผู้ปฏิบัติงานสวมอุปกรณ์ป้องกันอันตรายส่วนบุคคลที่เหมาะสม เช่น สวมหน้ากาก และสวมถุงมือในขณะปฏิบัติเกี่ยวกับสารเคมี เป็นต้น

4.7 ห้ามสูบบุหรี่ ดื่มน้ำหรือรับประทานอาหารในห้องจัดเก็บสารเคมี

4.8 ดูแลความสะอาดอย่างสม่ำเสมอ หากสารเคมีหกรั่วไหล ต้องทำความสะอาดทันที

5. การจัดการสิ่งปฏิกูล น้ำเสีย และมูลฝอย

5.1. จัดให้มีห้องน้ำ ห้องส้วม และการบำบัดสิ่งปฏิกูลดังนี้

5.1.1 มีห้องน้ำ ห้องส้วมแยกจากกัน โดยมีแบบและจำนวนตามที่กำหนดในกฎหมายว่าด้วยการควบคุมอาคารและกฎหมายอื่นที่เกี่ยวข้อง

5.1.2 ลักษณะของห้องส้วม การบำบัด และการกำจัดสิ่งปฏิกูลต้องถูกต้องตามหลักสุขาภิบาล

5.1.3 ต้องดูแลรักษาความสะอาดของห้องน้ำและห้องส้วมเป็นประจำทุกวันที่เปิดให้บริการ

5.1.4 ภายในห้องน้ำควรมีวัสดุอุปกรณ์ตามความจำเป็นและเหมาะสม

5.2 มีการบำบัดน้ำเสียให้มีคุณภาพได้มาตรฐานก่อนระบายสู่ท่อระบายน้ำสาธารณะ ซึ่งส่วนประกอบของระบบการจัดการน้ำเสีย ประกอบด้วย

5.2.1 ตะแกรงดักมูลฝอย สำหรับดักเศษมูลฝอยจากน้ำเสีย

5.2.2 ระบบรวบรวมน้ำเสีย น้ำจากส่วนต่างๆของอาคาร ไหลมารวมกันที่ถังรวบรวมน้ำเพื่อรอการบำบัด น้ำที่ล้นออกจากบ่อรวบรวมนี้จะไหลเข้าสู่บ่อบำบัด

5.2.4 ระบบบำบัดน้ำเสียต้องมีวิธีการบำบัดน้ำเสียที่เหมาะสม ไม่ก่อให้เกิดเหตุเดือดร้อนรำคาญและเป็นอันตรายต่อสุขภาพของชุมชน

5.2.5 รางระบายน้ำทิ้ง รางหรือท่อสำหรับระบายน้ำทิ้ง ควรมีตะแกรงวางปิดรางเพื่อกรองเศษผงต่างๆ และป้องกันหนู นอกจากนี้ทางเปิดของท่อระบายน้ำออกสู่ท่อสาธารณะควรมีตะแกรงปิดเพื่อป้องกันหนูด้วย

5.3 จัดให้มีการจัดการมูลฝอยดังนี้

5.3.1 ควรมีการคัดแยกมูลฝอยและมีภาชนะรองรับมูลฝอยแยกตามประเภท

5.3.2 มีภาชนะรองรับมูลฝอยที่เพียงพอตามหลักสุขาภิบาล

5.3.3 ล้างทำความสะอาดภาชนะรองรับมูลฝอยและบริเวณที่วางภาชนะอยู่เสมอ

5.3.4 รวบรวมมูลฝอยจากภาชนะรองรับมูลฝอยไปยังที่พักมูลฝอยรวม หรือนำไปกำจัดทุกวัน โดยเฉพาะมูลฝอยที่เน่าเสียได้ง่าย

5.3.5 กำจัดมูลฝอยด้วยวิธีที่ถูกต้องตามหลักสุขาภิบาล และเป็นไปตามข้อกำหนดท้องถิ่น

5.3.6 ดูแลมิให้เกิดการทิ้งมูลฝอยเกลื่อนกลาดภายในสถานประกอบกิจการและบริเวณโดยรอบ

6. การสุขาภิบาลอาหารและน้ำดื่ม

6.1 ในกรณีมีการจำหน่ายอาหาร ต้องปฏิบัติตามหลักสุขาภิบาลอาหาร และตามข้อกำหนดของท้องถิ่น

6.2 ต้องมีน้ำดื่มที่ได้คุณภาพตามมาตรฐานน้ำดื่มไว้บริการอย่างเพียงพอ

6.3 ลักษณะการนำน้ำมาดื่ม ต้องไม่ก่อให้เกิดความสกปรกหรือการปนเปื้อน เช่น ใช้ระบบน้ำกด ใช้แก้วส่วนตัว ใช้แก้วกระดาษที่ใช้ครั้งเดียวแล้วทิ้ง และใช้แก้วส่วนกลางที่ใช้ดื่มเพียงครั้งเดียว แล้วนำไปล้างทำความสะอาดก่อนนำมาใช้ใหม่ เป็นต้น ทั้งนี้ให้จัดทำป้ายหรือมีข้อความการปฏิบัติไว้ด้วย

7. การป้องกันควบคุมสัตว์และแมลงนำโรค

7.1 ภายในสถานประกอบกิจการไม่ควรมีหนู แมลงวัน และแมลงสาบ

7.2 ต้องมีการป้องกัน ควบคุม กำจัดสัตว์และแมลงนำโรคโดยเฉพาะหนู แมลงวัน และแมลงสาบอย่างถูกต้องตามหลักสุขาภิบาล

8. การดูแลสุขภาพและความปลอดภัย

8.1 ต้องกำหนดให้มีผู้ดูแลมาด้วย กรณีที่นำเด็กอายุต่ำกว่า 10 ปี ที่ยังว่ายน้ำไม่เป็นและผู้สูงอายุที่ไม่สามารถดูแลตัวเองได้มาใช้บริการสระว่ายน้ำ

8.2 จัดให้มีอุปกรณ์ช่วยชีวิต ดังนี้

8.2.1 โฟมช่วยชีวิต อย่างน้อย 2 อัน

8.2.2 ห่วงชูชีพ ขนาดเส้นผ่าศูนย์กลางภายใน 15 นิ้ว หรือทุ่นลอย ผูกไว้กับเชือกยาวไม่น้อยกว่าความกว้างของสระว่ายน้ำ อย่างน้อย 2 อัน

8.2.3 ไม้ช่วยชีวิต หรือวัตถุอื่นใด มีความยาวไม่น้อยกว่า 3.5 เมตร น้ำหนักเบา อย่างน้อย 1 อัน และต้องวางไว้ที่ปลายลู่ส่วนลึกของสระว่ายน้ำ

8.2.4 เครื่องช่วยหายใจ สำหรับผู้ใหญ่ และสำหรับเด็ก อย่างละ 1 ชุด

8.2.5 ห้องปฐมพยาบาลพร้อมชุดปฐมพยาบาลที่พร้อมใช้งานได้ตลอดเวลาไว้ประจำสระว่ายน้ำและอยู่ในบริเวณที่ใกล้ที่สุด

8.3 มีอุปกรณ์สื่อสารที่สามารถติดต่อบุคคลหรือสถานที่สำคัญๆ เช่น โรงพยาบาล และสถานีตำรวจ เพื่อขอความช่วยเหลือเมื่อเกิดเหตุฉุกเฉินต่างๆ เช่น เพลิงไหม้ หรือมีคนจมน้ำ และต้องปิดประกาศหมายเลขโทรศัพท์ของสถานที่ดังกล่าวไว้ในที่เห็นได้ชัดเจนและเป็นข้อมูลปัจจุบันอยู่เสมอ

9. เหตุรำคาญ

มีการควบคุมมิให้เกิดเหตุรำคาญ ซึ่งมาจากกิจกรรมการดำเนินการต่างๆ

****

ภาคผนวก จ
เอกสารสอบเทียบเครื่องมือ



List of Instrument Certificates for Environmental Quality Analysis

No.	Instrument/Equipment	Parameter	Manufacturer	Model/Serial No.	Calibrator	Certification No.	Date of Calibration	Due date of Calibration*
1	Analytical Balance	FAT OIL AND GREASE	Mettler Toledo	AB204-S/FACT / 1129361010	United Analyst and Engineering Consultant Co., Ltd.	260318-1-BL007-26	3/4/2026	2/4/2027
2	Analytical Balance	TOTAL DISSOLVED SOLIDS	Mettler Toledo	XSR205DU / C210685394	United Analyst and Engineering Consultant.Co.,Ltd (UAE)	260311-2-BL001-26	12/3/2026	11/3/2027
3	Analytical Balance	TOTAL SUSPENDED SOLIDS	Mettler Toledo	XSR205DU / C009071872	United Analyst and Engineering Consultant. Co., Ltd. (UAE)	260311-2-BL002-26	12/3/2026	11/3/2027
4	BOD Incubator	BIOCHEMICAL OXYGEN DEMAND	ARCO	UC4-1320 / 1021	Technology Promotion Association (Thailand-Japan)	25TM1001	7/7/2025	6/7/2026
5	DO Meter	BIOCHEMICAL OXYGEN DEMAND	YSI	5100 / 11B 101863	Technology Promotion Association (Thailand-Japan)	26TW50	2/3/2026	1/3/2027
6	Digestion Units	TOTAL KJELDAHL NITROGEN	FOSS Analytical Co.,Ltd (China)	DT2508/2520 / 91905060	FOSS South East Asia	15257	12/2/2026	11/2/2027
7	Hot Air Oven	TOTAL DISSOLVED SOLIDS TOTAL SUSPENDED SOLIDS	Memmert	UF55 / B212.0411	National food intitute ministry of Industry	2602300 001 01	11/3/2026	11/3/2027
8	Cooled Incubator	ESCHERICHIA COLI FECAL COLIFORM BACTERIA TOTAL COLIFORM BACTERIA	Binder	KB400 / WTB20200000015535	National Food Institute, Ministry of Industry, Thailand	2602303-006-01	11/3/2026	10/3/2027
9	Incubator	PSEUDOMONAS AERUGINOSA	MEMMERT	IN75 / D317.0307	National Food Institute Ministry of Industry	2602303-005-01	11/3/2026	10/3/2027
10	Incubator	STAPHYLOCOCCUS AUREUS	Memmert	IPP260 / V615.0187	National Food Institute, Ministry of Industry, Thailand	2602303 001 01	11/3/2026	10/3/2027
11	Kjeltec Distillation Unit	TOTAL KJELDAHL NITROGEN	FOSS	KT9 / 91905393	FOSS South East Asia	15256	12/2/2026	11/2/2027
12	pH Meter	pH	Horiba	LAQUA-PH210 / HA0A0005	technology promotion association (thailand-japan	25CH1433	11/12/2025	10/12/2026
13	Water Bath	FECAL COLIFORM BACTERIA	Memmert	WNE 14 / L416.0612	Technology Promotion Association (Thailand-Japan)	26TM194	2/2/2026	1/2/2027

Due Date of Calibration* : Based on the annual calibration plan. At least 1 time per year.

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

Certificate of Calibration

Certificate No.: 260318-1-BL007-26
Code No.: BL007-26
Page: 1 of 3

Customer Name:	United Analyst and Engineering Consultant Co., Ltd.
Address:	3 Soi Udom suk 41, Sukhumvit Rd., Bang Chak, Phar Khanong, Bangkok 10260
Equipment:	Electronic Balance
Manufacturer:	Mettler Toledo
Model:	AB204-S/FACT
Serial No.:	1129361010
Asset No. :	UAE.WAS.002/2552
Building :	UAE No.3 Floor : 1 Room : 107
Received Date:	April 2, 2026
Date of Calibation :	April 3, 2026

Calibration Conditions:					
	Temperature	*start*	21.9 °C	*end*	22.1 °C
	Humidity	*start*	60.6 %	*end*	60.1 %
	Pressure	*start*	756.6 mmHg	*end*	755.1 mmHg

Calibrated by: Thanachat Chatpahol

Approved by: Suwit Chotnok Signature:

Issued Date: April 7, 2026

Note : 1) The Uncertainties are for a confidence probability of approximately 95%
2) This Certificate is valid only to the item calibrated on date and place of calibration.
3) This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation Scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the United Analyst and Engineering Consultant Co.,Ltd. (UAE)

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	AB204-S/FACT	Readability:	0.0001 g
Serial No.:	1129361010	ID No.:	UAE.WAS.002/2552
Max. Capacity:	220 g		
Calibration Date:	April 3, 2026		
Condition As-Received:	In Condition		

Condition of Equipment:

Condition of This Result of Calibration:

1. Calibration Method: This instrument was calibrated by method UAE.CP.CAL.006 In-House Method based on UKAS Lab 14 : 2022
2. Reference Standrads:

Reference Standard:	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Standard Weight Class E2 (OIML)	1 mg to 1 kg	C510641605	METTLER TOLEDO GmbH	C510641605	Mettler-Toledo	3-Mar-27

Instrument	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	SUCCESS	SG-H-00992/68	Success Gateway	26-Nov-26
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	TPA	25P4464	TPA	18-Dec-26

3. This certification is traceable to SI Unit
4. This certification was certified only for the indtrument we calibrated
5. This result of calibration wae found accurate as show on date and place of calibration only.
6. Through the reference standard laboratory of Mettler-Toledo GmbH C510641605, SAS accreditation number SCS 0032


Calibraton Result:

1. Repeatability of Reading:

Nominal Value (g)	Standard Deviation of Reading (g)
200*	0.00010

2. Eccentric or off-center loading

A mass of 100 g was placed and moved to various position on pan
The Balance reading obtained is given in the table.

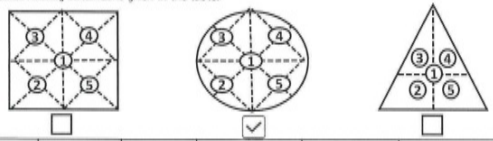

1 (g)	2 (g)	3 (g)	4 (g)	5 (g)	Maximum Difference (g)
100.0025	100.0022	100.0022	100.0029	100.0030	0.0005

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	AB204-S/FACT	Readability:	0.0001 g
Serial No.:	1129361010	ID No.:	UAE.WAS.002/2552
Max. Capacity:	220 g		
Calibration Date:	April 3, 2026		

Calibraton Result: (Continued)
Calibraton Range: 0 - 200 g
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value:

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.0000	0.0000	0.17	2.37
0.01	0.0100005	0.0099	0.0001	0.17	2.32
0.05	0.0500003	0.0499	0.0001	0.17	2.32
0.1	0.1000083	0.0999	0.0001	0.17	2.32
0.5	0.5000121	0.5000	0.0000	0.17	2.32
1.0	1.0000119	1.0000	0.0000	0.17	2.32
10.0	10.000033	10.0003	-0.0003	0.17	2.32
40.0	40.000054	40.0010	-0.0010	0.18	2.23
50.0	50.000037	50.0013	-0.0012	0.18	2.23
80.0	80.000098	80.0020	-0.0019	0.19	2.11
100.0	100.000042	100.0025	-0.0024	0.20	2.10
120.0	120.000068	120.0028	-0.0027	0.22	2.06
150.0	150.000079	150.0035	-0.0035	0.24	2.04
160.0	160.000112	160.0036	-0.0035	0.25	2.03
200.0	200.000146	200.0049	-0.0047	0.28	2.00

4. Effect of Tare test:

Tare Load (g)	Test Load (g)	Indication (g)	Correction (g)
100	20.000028	20.0004	-0.0003
	40.000054	40.0009	-0.0008
	60.000070	60.0013	-0.0012
	80.000098	80.0017	-0.0016
	100.000042	100.0021	-0.0021

Remark: -
The report uncertainty of measurment was based on standard uncertainty multiplied by coverage factor k, providing a level of confidence of approximetely 95%

o---o-End-o---o

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

Certificate of Calibration

Customer Name: United Analyst and Engineering Consultant Co., Ltd.
Address: 3 Soi Udom suk 41, Sukhumvit Rd., Bang Chak, Phar Khanong, Bangkok 10260

Equipment:	Electronic Balance
Manufacturer:	Mettler Toledo
Model:	XSR205DU
Serial No.:	C210685394
Asset No. :	UAE.WAO.010/2565

Building : UAE number 3 Floor : 2 Room : 208

Received Date:	March 11, 2026			
Date of Calibation :	March 12, 2026			
Calibration Conditions:	Temperature	23.0 °C	to	23.6 °C
	Humidity	51.5 %	to	54.4 %
	Pressure	755.7 mmHg	to	757.9 mmHg

Calibrated by: Thanachat Chatpahol

Approved by: Suwit Chotnok Signature:

Issued Date: March 16, 2026

Note : 1) The Uncertainties are for a confidence probability of approximately 95%
2) This Certificate is valid only to the item calibrated on date and place of calibration.
3) This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation Scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the United Analyst and Engineering Consultant Co.,Ltd. (UAE)

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025 CALIBRATION 0416

Equipment: Electronic Balance
Model: XSR205DU
Serial No.: C210685394
Max. Capacity: 81 g / 220 g
Calibration Date: March 12, 2026
Condition As-Received: In Condition

Manufacturer: Mettler Toledo
Readability: 0 to 81 (g): 0.01 mg , > 80 to 200 (g) : 0.1 mg
ID No.: UAE.WAO.010/2565

Condition of Equipment:

Condition of This Result of Calibration:

1. Calibration Method: This instrument was calibrated by method UAE.CP.CAL.006 In-House Method based on UKAS Lab 14 : 2022

2. Reference Standrads:

Reference Standard:	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Standard Weight Class E2 (OIML)	1 mg to 1 kg	C510641605	METTLER TOLEDO GmbH	C510641605	METTLER TOLEDO GmbH	3-Mar-27
Standard Weight Class E2 (OIML)	1 mg to 1 kg	B749109122	AMARC	25-009359	AMARC	21-Jan-27

Instrument	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	SUCCESS	SG-H-00992/68	Success Gateway	26-Nov-26
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	TPA	25P4464	TPA	18-Dec-26

3. This certification is traceable to SI Unit
4. This certification was certified only for the indtrument we calibrated
5. This result of calibration wae found accurate as show on date and place of calibration only.
6. Through the reference standard laboratory of Mettler-Toledo GmbH C510641605, SAS accreditation number SCS 0032
7. Through the reference standard laboratory of AMARC 25-009359, TISI accreditation number 0152


Calibraton Result:

1. Repeatability of Reading:

Nominal Value (g)	Standard Deviation of Reading (g)
80	0.000019
200*	0.000055

2. Eccentric or off-center loading

A mass of 100 g was placed and moved to various position on pan
The Balance reading obtained is given in the table.

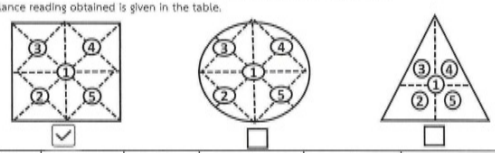

1 (g)	2 (g)	3 (g)	4 (g)	5 (g)	Maximum Difference (g)
100.0002	100.0002	100.0003	100.0004	100.0003	0.0001

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025 CALIBRATION 0416

Equipment: Electronic Balance
Model: XSR205DU
Serial No.: C210685394
Max. Capacity: 81 g / 220 g
Calibration Date: March 12, 2026

Manufacturer: Mettler Toledo
Readability: 0 to 81 (g): 0.01 mg , > 80 to 200 (g) : 0.1 mg
ID No.: UAE.WAO.010/2565

Calibraton Result: (Continued)
Calibraton Range: 0 to 80 (g)
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value: (Range: 0 to 81 (g) ; Resolution: 0.00001 g)

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.00000	0.00000	0.032	2.65
0.001	0.0010020	0.00101	0.00000	0.032	2.65
0.005	0.0050025	0.00501	-0.00001	0.032	2.65
0.01	0.0100005	0.01001	-0.00001	0.032	2.65
0.05	0.0500003	0.05001	-0.00001	0.032	2.65
0.10	0.1000083	0.10000	0.00001	0.033	2.65
0.50	0.5000121	0.50001	0.00000	0.033	2.65
1	1.0000119	1.00003	-0.00002	0.032	2.52
2	2.0000125	2.00003	-0.00002	0.033	2.52
5	5.0000146	5.00003	-0.00002	0.033	2.32
10	10.0000330	10.00006	-0.00003	0.034	2.21
20	20.000028	20.00006	-0.00003	0.041	2.07
30	30.000061	30.00017	-0.00011	0.055	2.00
40	40.000054	40.00021	-0.00016	0.066	2.00
50	50.000037	50.00023	-0.00019	0.068	2.00
60	60.000070	60.00029	-0.00022	0.084	2.00
80	80.000098	80.00039	-0.00030	0.12	2.00

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
CALIBRATION 0416

Certificate No.: 260311-2-BL001-26
Code No.: BL001-26

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	XSR205DU	Readability:	0 to 81 (g): 0.01 mg , > 80 to 200 (g) : 0.1 mg
Serial No.:	C210685394	ID No.:	UAE.WAO.010/2565
Max. Capacity:	81 g / 220 g		
Calibration Date:	March 12, 2026		

Calibraton Result: (Continued)
Calibraton Range: > 81 to 200 (g)
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value: (Range: > 81 - 220 (g) ; Resolution: 0.0001 g)

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.0000	0.0000	0.032	2.65
90	90.0000910	90.0004	-0.0003	0.16	2.00
100	100.0000420	100.0003	-0.0003	0.16	2.00
110	110.0000750	110.0004	-0.0003	0.18	2.00
120	120.0000680	120.0004	-0.0003	0.19	2.00
130	130.0001010	130.0005	-0.0004	0.20	2.00
140	140.0000960	140.0004	-0.0003	0.21	2.00
150	150.0000790	150.0005	-0.0004	0.22	2.00
160	160.0001120	160.0004	-0.0003	0.23	2.00
170	170.0001050	170.0003	-0.0002	0.24	2.00
200	200.0001460	200.0001	0.0000	0.26	2.00

4. Effect of Tare test:

Tare Load (g)	Test Load (g)	Indication (g)	Correction (g)
100	20.000028	20.0001	0.0000
	40.000054	40.0001	0.0000
	60.000070	60.0000	0.0001
	80.000098	80.0000	0.0001
	100.000109	100.0000	0.0001

Remark: -
The report uncertainty of measurment was based on standard uncertainty multiplied by coverage factor k, providing a level of confidence of approximetely 95%

o---o-End-o---o

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
CALIBRATION 0416

Certificate of Calibration

Certificate No.: 260311-2-BL002-26
Code No.: BL002-26

Customer Name: United Analyst and Engineering Consultant Co., Ltd.
Address: 3 Soi Udom suk 41, Sukhumvit Rd., Bang Chak, Phar Khanong, Bangkok 10260

Equipment:	Electronic Balance
Manufacturer:	Mettler Toledo
Model:	XSR205DU
Serial No.:	C009071872
Asset No. :	UAE.WAO.012/2563

Building : UAE number 3 Floor : 2 Room : 208

Received Date:	March 11, 2026			
Date of Calibation :	March 12, 2026			
Calibration Conditions:	Temperature	23.8 °C	to	24.1 °C
	Humidity	50.0 %	to	59.0 %
	Pressure	755.5 mmHg	to	755.6 mmHg

Calibrated by: Thanachat Chatpahol
Approved by: Suwit Chotnok Signature:

Issued Date: March 16, 2026

Note : 1) The Uncertainties are for a confidence probability of approximately 95%
2) This Certificate is valid only to the item calibrated on date and place of calibration.
3) This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation Scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the United Analyst and Engineering Consultant Co.,Ltd. (UAE)

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

Equipment: Electronic Balance
Model: XSR205DU
Serial No.: C009071872
Max. Capacity: 81 g / 220 g
Calibration Date: March 12, 2026
Condition As-Received: In Condition

Manufacturer: Mettler Toledo
Readability: 0 to 81 (g): 0.01 mg > 80 to 200 (g) : 01 mg
ID No.: UAE.WAO.012/2563

Condition of Equipment:

Condition of This Result of Calibration:

1. Calibration Method: This instrument was calibrated by method UAE.CP.CAL.006 In-House Method based on UKAS Lab 14 : 2022

2. Reference Standrads:

Reference Standard:	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Standard Weight Class E2 (OIML)	1 mg to 1 kg	C510641605	METTLER TOLEDO GmbH	C510641605	Mettler-Toledo GmbH	3-Mar-27
Standard Weight Class E2 (OIML)	1 mg to 1 kg	8749109122	AMARC	25-009359	Mettler-Toledo	21-Jan-27

Instrument	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	SUCCESS	SG-H-00992/68	Success Gateway	26-Nov-26
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	TPA	25P4464	TPA	18-Dec-26

3. This certification is traceable to SI Unit
4. This certification was certified only for the instrument we calibrated
5. This result of calibration wae found accurate as show on date and place of calibration only.
6. Through the reference standard laboratory of Mettler-Toledo GmbH C510641605, SAS accreditation number SCS 0032
7. Through the reference standard laboratory of AMARC 25-009359, TISI accreditation number 0152


Calibraton Result:

1. Repeatability of Reading:

Nominal Value (g)	Standard Deviation of Reading (g)
80	0.000008
200*	0.000045

2. Eccentric or off-center loading

A mass of 100 g was placed and moved to various position on pan
The Balance reading obtained is given in the table.

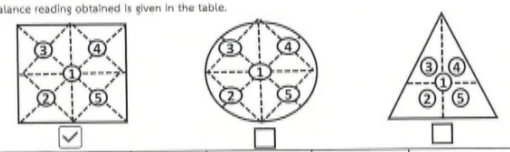

1 (g)	2 (g)	3 (g)	4 (g)	5 (g)	Maximum Difference (g)
100.0000	100.0000	100.0000	100.0000	100.0000	0.0000

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

Equipment: Electronic Balance
Model: XSR205DU
Serial No.: C009071872
Max. Capacity: 81 g / 220 g
Calibration Date: March 12, 2026

Manufacturer: Mettler Toledo
Readability: 0 to 81 (g): 0.01 mg > 80 to 200 (g) : 01 mg
ID No.: UAE.WAO.012/2563

Calibraton Result: (Continued)
Calibraton Range: 0 to 80 (g)
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value: (Range: 0 to 81 (g) ; Resolution: 0.00001 g)

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.0000	0.0000	0.015	2.25
0.001	0.0010020	0.0010	0.00000	0.015	2.23
0.005	0.0050025	0.0050	-0.00002	0.015	2.23
0.01	0.0100005	0.0100	-0.00002	0.015	2.23
0.05	0.0500003	0.0500	-0.00001	0.015	2.21
0.10	0.1000083	0.1000	-0.00001	0.015	2.20
0.50	0.5000121	0.5000	-0.00002	0.016	2.15
1	1.0000119	1.0000	0.00000	0.016	2.12
2	2.0000125	2.0000	-0.00001	0.017	2.09
5	5.0000146	5.0000	-0.00002	0.020	2.05
10	10.0000330	10.0001	-0.00002	0.023	2.00
20	20.000028	20.0001	-0.00005	0.033	2.00
30	30.000061	30.0001	-0.00004	0.051	2.00
40	40.000054	40.0001	-0.00004	0.063	2.00
50	50.000037	50.0001	-0.00005	0.064	2.00
60	60.000070	60.0001	-0.00004	0.081	2.00
80	80.000098	80.0001	-0.00001	0.11	2.00

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025 CALIBRATION 0416

Certificate No.: 260311-2-BL002-26
Code No.: BL002-26

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	XSR205DU	Readability:	0 to 81 (g): 0.01 mg > 80 to 200 (g) : 01 mg
Serial No.:	C009071872	ID No.:	UAE.WAO.012/2563
Max. Capacity:	81 g / 220 g		
Calibration Date:	March 12, 2026		

Calibraton Result: (Continued)
Calibraton Range: > 80 to 200 (g)
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value: (Range: > 80 to 200 (g) ; Resolution: 0.0001 g)

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.0000	0.0000	0.02	2.25
90	90.0000910	90.0000	0.0000	0.16	2.00
100	100.0000420	100.0000	0.0000	0.16	2.00
110	110.0000750	110.0000	0.0000	0.17	2.00
120	120.0000680	120.0000	0.0001	0.18	2.00
130	130.0001010	130.0000	0.0000	0.20	2.00
140	140.0000960	140.0003	0.0001	0.21	2.00
150	150.0000790	150.0003	0.0001	0.21	2.00
160	160.0001120	160.0003	0.0001	0.23	2.00
170	170.0001050	170.0003	-0.0002	0.24	2.00
200	200.0001460	200.0004	-0.0002	0.26	2.00

4. Effect of Tare test:

Tare Load (g)	Test Load (g)	Indication (g)	Correction (g)
100	20.000028	20.0000	0.0000
	40.000054	40.0002	-0.0001
	60.000070	60.0002	-0.0001
	80.000098	80.0002	-0.0001
	100.000042	100.0003	-0.0002

Remark:
The report uncertainty of measurment was based on standard uncertainty multiplied by coverage factor k, providing a level of confidence of approximetely 95%

o---o-End-o---o

เอกสารไม่ควบคุม

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

NSC-TISI-TIS17025 CALIBRATION 0008

Certificate of Calibration

Cert. No.: 25TM1001

Equipment : BOD Incubator
Manufacturer : ARCO
Model : UC4-1320
Serial No. : -
ID No. : UAE.WAO.018/2559
Submitted by : United Analyst and Engineering Consultant Co.,Ltd.
3 Soi Udomsuk 41, Sukhumvit Road,
Bangchak, Phrakhanong,
Bangkok 10260
Location : Lab Floor 2

Received Order : 07 July 2025
Calibration Date : 07 July 2025
Ambient Temperature : (26 ± 10) °C
Relative Humidity : (50 ± 30) %
AC Line Voltage : (220 ± 22) V

Calibrated by : Man Pattanapongpaiboon

Approved by : Kunchit

Approved Signatory

( ) Chakrit Waewwanjua
( ) Suwit Imjai
(✓) Kunchit Promprat

Issue Date : 17 July 2025

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Equipment : BOD Incubator
Condition As-Received : Used Item
Reference : 2507-0146OC-2

Cert. No.: 25TM1001

Procedure Used :-

Calibration were conducted using calibration procedure CP-OT02 based on TLAS G-20 according to direct measurement method with Data Acquisition which connected with Resistance Temperature Detector (RTD).

The temperature scale used was based on ITS-90.

Condition of this result of calibration

1. Reference standard instrument:-


Instrument	Serial No.	Cert. No.	Traceable	Due Date
1) Data Acquisition	MY59003411	24LM192	TPA	24 Dec 2025

2. This certificate is valid only to the item calibrated on date and place of calibration.
3. This measurement result is traceable to the International System of Unit maintained through :

Remark : TPA : Technology Promotion Association (Thailand - Japan)

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Fresh air setting : Not Available

Environment during calibration		
	Beginning	Finished
Temp. (°C)	28	28
REL.Humid. (%)	54	57
AC Supply (Volt)	224	226

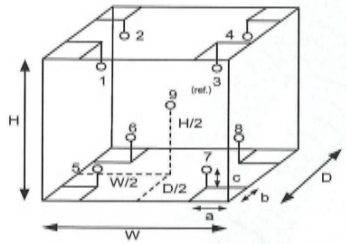

Position :	Ref. Std. ID No.:
1	25-20RTD-2/1
2	25-20RTD-2/2
3	25-20RTD-2/3
4	20RTD-2/4
5	20RTD-2/5
6	20RTD-2/6
7	20RTD-2/7
8	20RTD-2/8
9 (ref.)	20RTD-2/9

Probe Installation Details :

a =	10	cm
b =	10	cm
c =	10	cm

Dimension of Chamber :

D =	0.62	m
W =	1.2	m
H =	1.2	m
Capacity =	0.89	m^3

เอกสารไม่ควบคุม

Equipment : BOD Incubator
Condition As-Received : Used Item
Reference : 2507-0146OC-2

Cert. No.: 25TM1001

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Fresh air setting : Not Available

Calibration Point (°C)	UUC* Setting (°C)	UUC* Reading (°C)	Temperature stability (± °C)	Temperature uniformity (°C)	Overall Variation (°C)	Coverage Factor *k*
20.0	20.0	19.9	0.18	0.60	0.83	2

Calibration Point (°C)	Measured Temperature (°C) Position									Uncertainty (±°C)
	1	2	3	4	5	6	7	8	9 (ref.)	
20.0	20.202	19.900	20.390	20.077	20.111	20.044	20.275	20.173	19.835	0.38

Average* : The average of 30 values in each position.
Temperature stability : One-half of the greatest maximum difference of measured temperature at any one sensor.
Temperature uniformity : The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time or at as close an observation time as possible to determine the temperature pattern or homogeneity within the chamber under steady-state conditions.
Overall Variation : The Difference of the maximum and minimum measured temperatures throughout observation.
UUC* : Unit Under Calibration
Note : The reported uncertainty of measurement was included stability and excluded uniformity .

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor ***k***, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3 : EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL. 0-2717-3000 FAX. 0-2719-9484

Certificate of Testing

Equipment :	DO Meter
Manufacturer :	YSI
Model :	5100
Serial No. :	11B 101863
ID No. :	UAE.WAO.004/2554
Received Date :	27 February 2026
Test Date :	02 March 2026
Reference :	2602-0915DSC-1
Submitted by :	United Analyst and Engineering Consultant Co.,Ltd. 3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Laboratory Condition :	Temperature (25 ± 5) °C Humidity (50 ± 20) %
Test Procedure :	In - house method : CP-CH9 by Comparison Technique with Azide Modification Method
Tested by :	Walalak Sirithean
Approved by :	Saithip Approved Signatory

( ) Chakrit Waewwanjua
( ) Ponpan Paipim
(✓) Saithip Meangmai

Issue Date : 03 March 2026

เอกสารไม่ควบคุม

Condition of this result of calibration

1. Reference Standard Instruments :
   This measurement result is traceable to the International System of Unit through the reference standards laboratory of Industrial Calibration Center, Technology Promotion Association (Thailand-Japan).

Instruments	ID No.	Certificate No.	Due Date
1. Burette	130BU10	25CG1126	18 Mar 2027
2. Balance	110RC001	25MM316	02 July 2026

2. Standard Material :-

Material	Manufacturer	Lot.No.	Assay
Sodium Thiosulfate 5-Hydrate AR	KEMAUS	2203162447	99.6%

Result : **Dissolved Oxygen Meter Adjustment With Air 100 %**
Dissolved Oxygen Probe No.: 24F100202

Titration Method (Azide Modification Method) (mg/L)	DO Meter Reading (mg/L)	Standard Deviation (mg/L)
8.20	8.20	0.0084

This report was certified only for the instrument we tested.It is allowable to use for study Intend to use for advertising and referral purpose is prohibited.This report may not be reproduced other in full, without written approval of the laboratory

-o0o-

เอกสารไม่ควบคุม

FOSS

Customer Service Report

FOSS South East Asia
3388 Sirinrat Building, 25th – 26th Floor, Unit No. 3388/90,
Rama IV Road, Klongton , Klongtoey, Bangkok, Thailand 10110

Report No.:	15257

Date:	Feb 12, 2026	Customer:	UAE
Job No.:	14590	Address:	Bangkok
Instrument:	DT2520	Serial:	91905060

	Travel To Customer (Hrs)		Labour (Hrs)		Travel From Customer (Hrs)	
Start	-		13.30	1.5	-	
Finish	-	-	15.00		-	-

Job Type						
Application		Special		Standard		
Distributor		Courtesy Visit		Installation		In House	
Digital Service		PMA Approval Check		Quote		PM	X
Internal		Warranty -		Repair		HC Visit	
Training		Sales Support		Investigate		Others	

PMA Type						
	Smartcare		Smartcare Pro		Fosscare	X
	Smartcare Advance		Fosscare Pro		N/A	

Details of Work / Test

- PM
- Visual Check
  - + No leak - ok
  - + No damage - ok
- Change PM kit x 1 Set - ok
- Function Check
  - + Quick mode
    - + Set Temp / Timer - ok
    - + Run - ok
  - heating - ok
  - Lift UP/down - ok
- Clean x20 pcs with Grind head

Instrument Ready for Use	OK		Not OK*	
		X		

Part No:	Batch	Description	Q'ty
60079730	29.09.2025	FOSS PM kit, Digestor 20 per, 12 month	1

I confirm this report is accurate and complete

Signed FOSS		Signed Customer	
Name:	Anna Patchara Jakkrasiw	Name	
Tel:		Tel:	
Email:		Email:	

*Remark:

เอกสารไม่ควบคุม

Please scan QR code

nfi national food institute ministry of industry
สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสถาบันอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602300-001-01

Equipment:	CHAMBER (Hot Air Oven)		
Manufacturer:	MEMMERT	Customer Name:	UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Model:	UF55	Address:	3 Soi Udomsuk 41, Sukhumvit Road,
Serial No.:	B212.0411		Bangchack, Prakhanong, Bangkok 10260
ID No.:	UAE.WAO.005/2556		
Order No.:	2602300		
Operation No.:	2602300-001		
Date of Receipt:	11 March 2026		
Date of Calibration:	11 March 2026		

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014. based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	34972A RTD	MY59002902 CH#201-209/ RTD#201-209	2502797-002-01	3 May 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by: Mr.Manas Somsak, Specialist

Approved by: (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 18 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545

เอกสารไม่ควบคุม

nfi.or.th

สถาบันพัฒนาอุตสาหกรรมเพื่อการเกษตร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602300-001-01

Calibration Condition:

Equipment: CHAMBER (Hot Air Oven)
UUC* Resolution: 0.1 °C
Condition of the item: Normal & Good
Without adjustment / As Found
- Time of record 1 hour 9 minute / point

Place of Calibration: Laboratory
UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.

Environment Conditions: Ambient Temperature (29.8 ± 1.0) °C
Relative Humidity (47.8 ± 4) %
Line Voltage (222 ± 3) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
104.0	104.22	103.87	103.90	104.17	103.56	103.58	104.22	104.17	104.00	0.53
120.0	120.21	119.76	119.86	120.18	119.53	119.58	120.24	120.20	119.96	0.73
180.0	180.27	179.37	179.73	180.31	178.91	179.13	180.35	180.25	179.84	0.90

Table 2 : Reporting of Characterization Results


UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
104.0	104.0	104.0	104.0	0.05	0.44	0.75
120.0	120.0	120.0	120.0	0.06	0.43	0.79
180.0	180.0	180.0	180.0	0.07	0.93	1.56

Note
- UUC* : Unit Under Calibration
-The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	-	Open	- Position
	X	Close	100% Fan speed
	-	Not Available	

Dimension of inside chamber and sensor installation location (cm)					
W x H x D	40	x	40	x	33
a x b x c	10	x	10	x	10

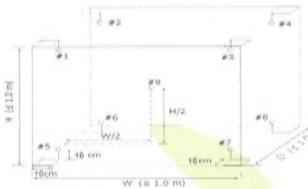

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สถาบันพัฒนาอุตสาหกรรมเพื่อการเกษตร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-006-01

Equipment: CHAMBER (Incubator)
Manufacturer: BINDER
Model: KB 400
Serial No.: 20200000015535
ID No.: UAE.MIC.018/2564
Order No.: 2602303
Operation No.: 2602303-006
Date of Receipt: 11 March 2026
Date of Calibration: 11 March 2026

Customer Name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road, Bangchack, Prakhanong, Bangkok 10260

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014, based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	DAQ973A RTD	MY59008964 CH#201-209/ RTD#201-209	2502244-001-01	29 March 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by: Mr.Nuttapol Niyomchat
Specialist

Approved by: (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 19 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุดสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุดสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-006-01

Calibration Condition:

Equipment:	CHAMBER (Incubator)	**Place of Calibration:**	Microbiology Laboratory
UUC* Resolution:	0.1 °C		UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD
Condition of the item:	Normal & Good	**Environment Conditions:**	Ambient Temperature (17.2 ± 1) °C
	Without adjustment / As Found		Relative Humidity (51.5 ± 4) %
	- Time of record 1 hour 9 minute / point		Line Voltage (229 ± 2) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
35.0	34.78	34.86	34.81	34.83	35.22	35.21	35.22	35.12	34.83	0.28

Table 2 : Reporting of Characterization Results


UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
35.0	35.0	35.0	35.0	0.034	0.39	0.52

Note

- UUC* : Unit Under Calibration
- The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	-	Open	- Position
	X	Close	100% Fan speed
	-	Not Available	
Dimension of inside chamber and sensor installation location (cm)			
W x H x D	65 x 125 x 48		
a x b x c	10 x 10 x 10		

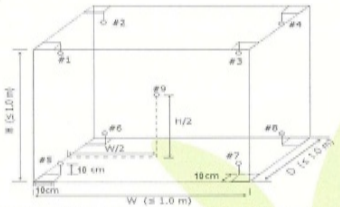

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel. +66(0) 2422 8688 Fax +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุดสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุดสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-005-01

Equipment:	CHAMBER (Incubator)		
Manufacturer:	MEMMERT	**Customer Name:**	UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Model:	IN75	**Address:**	3 Soi Udomsuk 41, Sukhumvit Road,
Serial No.:	D317.0307		Bangchack, Prakhanong, Bangkok 10260
ID No.:	UAE.MIC.023/2561		
Order No.:	2602303		
Operation No.:	2602303-005		
Date of Receipt:	11 March 2026		
Date of Calibration:	11 March 2026		

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014, based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	34972A RTD	MY59003377 CH#201-209/ RTD#201-209	2601300-001-01	10 January 2027	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by	Mr.Manas Somsak Specialist	**Approved by**	(Mr.Pheraphat Tuanjit) Manager, Division of Calibration Laboratory Responsible for the Technical Management Team
Date of Issue:	18 March 2026		

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel. +66(0) 2422 8688 Fax +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุดสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุดสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0081

Calibration Certificate

Certificate No.: 2602303-005-01

Calibration Condition:

Equipment:	CHAMBER (Incubator)	Place of Calibration:	Microbiology Laboratory (302)
UUC* Resolution:	0.1 °C		UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD
Condition of the item:	Normal & Good	Environment Conditions:	Ambient Temperature (23.5 ± 1) °C
	Without adjustment / As Found		Relative Humidity (59.1 ± 3) %
	- Time of record 1 hour 9 minute / point		Line Voltage (223 ± 3) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF)									Measurement Uncertainty (±°C)
	Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	
41.5	41.84	41.85	41.80	41.76	40.96	41.18	41.12	41.32	41.33	0.29

Table 2 : Reporting of Characterization Results

UUC* Setting (°C)	UUC* Reading (°C)			Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
	Max	Min	Average			
41.5	41.5	41.5	41.5	0.06	0.52	0.96

Note

- UUC* : Unit Under Calibration

-The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).

- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.


- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.

- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	-	Open	-	Position
	X	Close	-	Fan speed
	-	Not Available		

Dimension of inside chamber and sensor installation location (cm)					
W x H x D	40	x	56	x	33
a x b x c	10	x	10	x	10

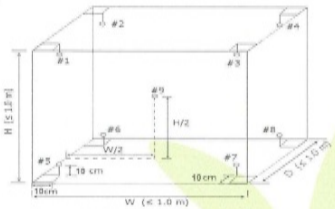

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel +66(0) 2422 8688 Fax +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุดสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุดสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0081

Calibration Certificate

Certificate No.: 2602303-001-01

Equipment:	CHAMBER (Incubator)		
Manufacturer:	MEMMERT	Customer Name:	UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Model:	IPP260	Address:	3 Soi Udomsuk 41, Sukhumvit Road,
Serial No.:	V615.0187		Bangchack, Prakhanong, Bangkok 10260
ID No.:	UAE.MIC.003/2559		
Order No.:	2602303		
Operation No.:	2602303-001		
Date of Receipt:	11 March 2026		
Date of Calibration:	11 March 2026		

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014. based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	DAQ973A RTD	MY59008964 CH#101-109/ RTD#101-109	2502244-001-01	29 March 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by	Mr.Nuttapol Niyomchat Specialist	Approved by	(Mr.Pheraphat Tuanjit) Manager, Division of Calibration Laboratory Responsible for the Technical Management Team
Date of Issue:	19 March 2026		

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel +66(0) 2422 8688 Fax +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

nfi
national food institute
ministry of industry

สุดสาหกรรมพัฒนาอุตสาหกรรมเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA

THAILAND
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-001-01

Calibration Condition:

Equipment: CHAMBER (Incubator)
UUC* Resolution: 0.1 °C
Condition of the item: Normal & Good
Without adjustment / As Found
- Time of record 1 hour 9 minute / point

Place of Calibration: Microbiology Laboratory
UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD
Environment Conditions: Ambient Temperature (17.2 ± 1) °C
Relative Humidity (51.5 ± 4) %
Line Voltage (229 ± 2) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
35.0	35.01	34.94	35.20	35.15	35.26	34.99	34.79	34.83	35.02	0.28

Table 2 : Reporting of Characterization Results


UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
35.0	35.0	35.0	35.0	0.069	0.24	0.53

Note
- UUC* : Unit Under Calibration
-The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	-	Open	- Position
	X	Close	100% Fan speed
	-	Not Available	

Dimension of inside chamber and sensor installation location (cm)				
W x H x D	64	x 80	x	50
a x b x c	10	x 10	x	10

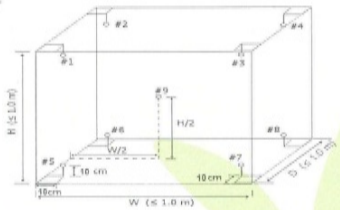

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor k = 2, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่เรือ เขตบางพลัด กรุงเทพมหานคร
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

FOSS

Customer Service Report

FOSS South East Asia
3388 Sirinrat Building, 25th – 26th Floor, Unit No. 3388/90,
Rama IV Road, Klongton , Klongtoey, Bangkok, Thailand 10110

Report No.:	15256		
Date:	Feb 12, 2026	Customer:	UAE
Job No.:	14589	Address:	Bangkok
Instrument:	kt9 Distillator	Serial:	9191053093

	Travel To Customer (Hrs)		Labour (Hrs)		Travel From Customer (Hrs)	
Start	08.00	1.5	09.30	4		
Finish	09.30		13.30			

Job Type						
Application		Special		Standard		
Distributor		Courtesy Visit		Installation	In House	
Digital Service		PMA Approval Check		Quote	PM	X
Internal		Warranty -		Repair	HC Visit	
Training		Sales Support		Investigate	Others	

PMA Type						
	Smartcare		Smartcare Pro		Fosscare	X
	Smartcare Advance		Fosscare Pro		N/A	

Details of Work / Test

- PM -
- Visual check
  + No leak -ok
  + No damage -ok
- change PM kit x1 Set -ok
- Function check
  + Dilution -ok
  + Alkali -ok
  + Receiver - Not Use
  + Steam Down -ok

Instrument Ready for Use	OK	X	Not OK*	

Part No:	Batch	Description	Q'ty
60100196	17.03.2025	PM kit kjeltec q Distillator	1

I confirm this report is accurate and complete

Signed FOSS		Signed Customer	
Name:	Anamika Patchara Jokhark	Name	
Tel:		Tel:	0614504094
Email:		Email:	Pitiya.Sukwan34@gmail.com

*Remark:

เอกสารไม่ควบคุม

Please scan QR code

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

NSC-TISI-TIS17025
CALIBRATION 0008

Certificate of Calibration

Cert.No.: 25CH1433
Page.: 1 of 3

Equipment :	pH Meter
Manufacturer :	Horiba
Model :	LAQUA-PH210
Serial No. :	HA0A0005
ID No. :	UAE.EFM.004/2563(EFM.pH.04/63)
Condition As-Received:	Used Item
Received Date :	09 December 2025
Calibration Date :	11 December 2025
Reference :	2512-0243WSC-2
Submitted by :	United Analyst and Engineering Consultant Co.,Ltd. 3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Ambient Temperature :	(25 ± 2.5) °C
Relative Humidity :	(50 ± 15) %
Calibration Procedure :	In - house method : - CP-CH5 by direct measurement with DC voltage standard and direct measurement with certified reference material (CRM) - CP-CH8 by comparison with temperature standard
Calibrated by :	Warakorn Lerngagtrakul
Approved by :	_____ Approved Signatory

(✓) Chakrit Waewwanjua
( ) Ponpan Paipim
( ) Saithip Meangmai

Issue Date : 12 December 2025

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Condition of this calibration result

1. Reference Standard Instrument

Instrument	Serial No.	ID No.	Cert. No.	Due Date
1) Document Process Calibrator	54030049	130RC116	25E2743	25 Aug 2026
2) Ref. Standard Thermometer	4982054	110RC044	25I708	03 July 2026

- This measurement result is traceable to SI throught Technology Promotion Association (Thailand - Japan)

2. Certified Reference Materials :The measurement results are traceable to SI through Hach Lenge GmbH Ltd., Deutsche Akkreditierungsstelle, Accredited No.D-RM-15184-01-00
:The measurement results are traceable to SI through CPA chem Ltd., ANSI-ASQ National Accreditation Board, Accredited No. AR-1835

Buffer Solution	Manufacturer	Lot No.	Exp. date
pH 4.007	CPA chem	1114384	12 June 2027
pH 6.999	Hach Lenge GmbH	C03273	13 May 2027
pH 10.010	CPA chem	1114385	08 June 2026

3. This certificate is valid only to the item calibrated on date and place of calibration.

Calibration Results

Function : mV Measurement

Performing standard curve by Document Process Calibrator at pH (4,7)(7,10)

Unit Under Calibration	Nominal Value	Standard Voltage Input	Actual Reading		Uncertainty of Measurement	Coverage factor
	pH	mV	mV	pH	(±mV)	*k*
pH Meter	4.00	177.48	177.4	4.01	0.058	2.00
S/N.: HA0A0005	7.00	0.00	0.1	7.00	0.058	2.00
	7.00	0.00	0.1	7.00	0.058	2.00
	10.00	-177.48	-177.2	10.01	0.058	2.00

เอกสารไม่ควบคุม

Calibration Results

Function : pH Measurement

Performing three buffers standard curve by using buffer nominal pH (4,7)(7,10)

Unit Under Calibration	Standard pH Buffer Solution	Actual pH Reading	Actual mV Reading (mV)	Uncertainty of pH Measurement (±)	Coverage factor *k*
pH Electrode	4.007	4.01	175.4	0.0085	2.05
S/N.: -	6.999	7.00	-0.3	0.0095	2.00
	6.999	7.01	-0.5	0.0096	2.00
	10.010	10.01	-170.6	0.0092	2.00

Function : Temperature Measurement

(*) Without adjustment

This equipment was connected with Temperature Probe;

- Model : -
- Serial No. : -

Dimension of probe

- Length : 112 mm.
- Diameter : 16 mm.
- Immersion Depth : 100 mm.

Calibration Point (°C)	Standard Temperature (°C)	UUC* Reading (°C)	Error (°C)	Uncertainty of measurement (± °C)	Coverage factor *k*
15.0	15.002	15.0	-0.002	0.13	2.00
30.0	30.002	30.0	-0.002	0.13	2.00
45.0	45.003	45.0	-0.003	0.13	2.00

Remark - UUC* = Unit Under Calibration

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor *k*, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

ilac-MRA

NSC-TISI-TIS17025 CALIBRATION 0008

Certificate of Calibration

Cert. No.: 26TM194
Page : 1 of 3

Equipment : Water Bath

Manufacturer : Memmert

Model : WNE 14

Serial No. : L416.0612

ID No. : MIC.003/2560

Submitted by : United Analyst and Engineering Consultant Co.,Ltd.
3 Soi Udomsuk 41, Sukhumvit Road,
Bangchak, Phrakhanong,
Bangkok 10260

Location : Microbiology Laboratory (302)

Received Order : 02 February 2026
Calibration Date : 02 February 2026
Ambient Temperature : (26 ± 10) °C
Relative Humidity : (50 ± 30) %
AC Line Voltage : (220 ± 22) V

Calibrated by : Krisda Malee

Approved by : Kunchit

Approved Signatory

( ) Chakrit Waewwanjua
( ) Suwit Imjai
(✓) Kunchit Promprat

Issue Date : 17 February 2026

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Procedure Used :-

Calibration were conducted using in-house calibration procedure CP-OT04 Based on ASTM E715 according to direct measurement method with Data Acquisition which connected with Industrial Platinum Resistance Thermometer (IPRT).

The temperature scale used was based on ITS-90.

Condition of this result of calibration

1. Reference standard instrument:-


Instrument	Serial No.	Cert. No.	Traceable	Due Date
1) Data Acquisition	MY57013711	25LM117	TPA	17 Jul 2026

2. This certificate is valid only to the item calibrated on date and place of calibration.
3. This measurement result is traceable to the International System of Unit maintained through :

Remark : TPA : Technology Promotion Association (Thailand - Japan)

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Heat transfer medium used : Water

	Environmental		AC Voltage Supply
	(°C)	(%R.H.)	(Volt)
Beginning of Calibration	25	52	221
Finished of Calibration	24	51	220

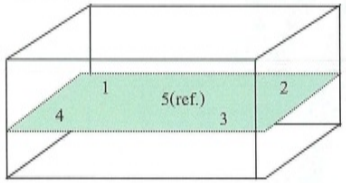

Front

Position :	Ref. Std. ID No.:
1	4803988-001
2	4803988-002
3	4803988-003
4	4803988-004
5(ref.)	4803988-005

เอกสารไม่ควบคุม

Calibration point (°C)	UUC* Setting (°C)	UUC* Reading (°C)	Average* Standard Reading (°C) Position					Uncertainty (± °C)
			1	2	3	4	5 (ref.)	
44.5	44.6	44.6	44.518	44.463	44.472	44.508	44.521	0.15

Calibration point (°C)	Uniformity (°C)	Stability (± °C)	Coverage Factor *k*
44.5	0.11	0.044	2

Average* : The average of 30 values in each position.
Uniformity : The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time or at as close an observation time as possible to determine the temperature pattern or homogeneity within the chamber under steady-state conditions.
Stability : One-half of the greatest maximum difference of measured temperature at any one probe.
UUC* : Unit Under Calibration
Note : The reported uncertainty of measurement was included stability and excluded uniformity.

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor ***k***, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

List of Instruments Certification for Air & Noise Quality Analysis

No.	Instrument/Equipment	Parameter	Manufacturer	Model/Serial No.	Calibrator	Certification No.	Date of Calibration	Due date of Calibration	Remark
Water									
1	pH Meter	pH	YSI	pH100A JC03335	Technology Promotion Association (Thailand-Japan)	26CH64	15 Jan 26	14 Jan 27	-

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

NSC-TISI-TIS17025
CALIBRATION 0008

Certificate of Calibration

Cert.No.: 26CH64
Page.: 1 of 3

Equipment :	pH Meter
Manufacturer :	EcoSence
Model :	pH100A
Serial No. :	JC03335
ID No. :	UAE.EFM.062/2562(ENV.pH.02/62)
Condition As-Received:	Used Item
Received Date :	14 January 2026
Calibration Date :	15 January 2026
Reference :	2601-0395WSC-1
Submitted by :	United Analyst and Engineering Consultant Co.,Ltd. 3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Ambient Temperature :	(25 ± 2.5) °C
Relative Humidity :	(50 ± 15) %
Calibration Procedure :	In - house method : - CP-CH5 by direct measurement with DC voltage standard and direct measurement with certified reference material (CRM) - CP-CH8 by comparison with temperature standard
Calibrated by :	Warakorn Lerngagtrakul
Approved by :	_____ Approved Signatory

( ) Chakrit Waewwanjua
( ) Ponpan Paipim
(✓) Saithip Meangmai

Issue Date : 16 January 2026

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Condition of this calibration result

1. Reference Standard Instrument

Instrument	Serial No.	ID No.	Cert. No.	Due Date
1) Document Process Calibrator	54030049	130RC116	25E2743	25 Aug 2026
2) Ref. Standard Thermometer	4982054	110RC044	25I708	03 July 2026

- This measurement result is traceable to SI throught Technology Promotion Association (Thailand - Japan)

2. Certified Reference Materials : The measurement results are traceable to SI through CPA chem Ltd., ANSI-ASQ National Accreditation Board, Accredited No. AR-1835
:The measurement results are traceable to SI through Hach Lenge GmbH Ltd., Deutsche Akkreditierungsstelle, Accredited No.D-RM-15184-01-00

Buffer Solution	Manufacturer	Lot No.	Exp. date
pH 4.008	CPA chem	1150491	30 Oct 2027
pH 7.000	Hach Lenge GmbH	C03319	17 Oct 2027
pH 10.010	CPA chem	1135355	16 Aug 2026

3. This certificate is valid only to the item calibrated on date and place of calibration.

Calibration Results

Function : mV Measurement

Performing standard curve by Document Process Calibrator at pH (4,7)(7,10)

Unit Under Calibration	Nominal Value	Standard Voltage Input	Actual Reading		Uncertainty of Measurement	Coverage factor
	pH	mV	mV	pH	(±mV)	*k*
pH Meter	4.00	177.48	177	4.01	0.58	2.00
S/N.: JC03335	7.00	0.00	0	7.00	0.58	2.00
	7.00	0.00	0	7.00	0.58	2.00
	10.00	-177.48	-177	10.01	0.58	2.00

เอกสารไม่ควบคุม

Calibration Results

Function : pH Measurement

Performing three buffers standard curve by using buffer nominal pH (4,7)(7,10)

Unit Under Calibration	Standard pH Buffer Solution	Actual pH Reading	Actual mV Reading (mV)	Uncertainty of pH Measurement (±)	Coverage factor *k*
pH Electrode	4.008	4.01	169	0.0044	2.00
S/N.: 240904SIA605377	7.000	7.00	-6	0.0095	2.00
	7.000	6.99	-6	0.0092	2.00
	10.010	10.01	-181	0.0095	2.00

Function : Temperature Measurement

(*) Without adjustment

This equipment was connected with Temperature Probe;

- Model : -
- Serial No. : 240904SIA605377

Dimension of probe

- Length : 110 mm.
- Diameter : 12 mm.
- Immersion Depth : 100 mm.

Calibration Point (°C)	Standard Temperature (°C)	UUC* Reading (°C)	Error (°C)	Uncertainty of measurement (± °C)	Coverage factor *k*
15.0	15.002	15.1	0.098	0.13	2.00
30.0	30.003	30.1	0.097	0.13	2.00
45.0	45.001	45.0	-0.001	0.13	2.00

Remark - UUC* = Unit Under Calibration

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor *k*, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

ภาคผนวก ฉ
หนังสืออนุญาตขึ้นทะเบียน
ห้องปฏิบัติการวิเคราะห์เอกชน



ที่ อก ๐๓๑๐(๑)/ ๓๗๗๘

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๑๐ มิถุนายน ๒๕๖๙

เรื่อง เปลี่ยนแปลงบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๒๙ พฤษภาคม ๒๕๖๙

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอเปลี่ยนแปลงบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

๑. ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๙ ราย

๑) นายณัฐพงศ์ เมืองชัย	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๐๔๕
๒) นายณัฏฐชัย พรหมอารักษ์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๐๔๖
๓) นายคุณานนท์ ฤทธาคณานนท์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๑๒๓
๔) นางสาวบุณยาพร บุญถนอมศรี	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๑๖๓

๒. ให้เพิ่มเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๒๔ ราย

๑) นายเจษฎา มาศประสิทธิ์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๐
๒) นางสาวนฤมล ยินดี	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๓
๓) นายสุรชัย บุพศิริ	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๖
๔) นางสาวปิยพร วรดี	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๓
๕) นางสาวสิริกันยา สุรจิต	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๔
๖) นางสาววทันยา วิเชียรผลา	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๕
๗) นายธนดล แก้วประสงค์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๖
๘) นายวิทิต สงแสง	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๗
๙) นางสาวดวงกมล ศรีดา	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๘
๑๐) นายภูฤทธิ์ ลีล้าน	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๙
๑๑) นายคณิน หนองหว้า	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๔๐
๑๒) นายต้นน้ำ สังข์นคร	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๔๒
๑๓) นายวัชรพงษ์ วราศรี	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๔๓
๑๔) นายจักรพงษ์ สัตย์สาร	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๔๔
๑๕) นายประชัย โพธิ์ทอง	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๔๔
๑๖) นายชนะพันธ์ อภินพหิรัณย์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๔๕

๑๗) นายกมลไท...

๑๗) นายกมลไท ชัยสิริสมบัติ	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๕๖
๑๘) นายธเนศ ทรัพย์ธำรงค์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๕๗
๑๙) นางสาวภัทรสุดา สุธรรมมา	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๕๘
๒๐) นางสาวสุนันทา สมรูป	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๕๙
๒๑) นางสาวมนรดา มั่นศาสตร์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๐
๒๒) นางสาวรัชนีภรณ์ สาระพันธ์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๓
๒๓) นายธนวิชย์ บุญเอก	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๒
๒๔) นางสาวอาทิตยา เล็กน้อย	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๓๓

อนึ่ง หนังสือฉบับนี้จะสิ้นอายุพร้อมหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายศิระ จันทร์เฉิด)
นักวิทยาศาสตร์เชี่ยวชาญ ปรึกษาราชการแทน
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๒๒ ต่อ ๒๒๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๒๒ ต่อ ๒๒๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
สำเนาถูกต้อง

"อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

ที่ อก ๐๓๑๐(๑)/ ๓๗๓๘

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๕ มีนาคม ๒๕๖๙

เรื่อง เปลี่ยนแปลงบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๓๐ กุมภาพันธ์ ๒๕๖๙

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอเปลี่ยนแปลงบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

๑. ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔ ราย

๑) นายพีรณัฐ เจริญผล	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๐๐๓
๒) นายเจษฎา ช่วยตรึก	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๑๒๗
๓) นายศุภกร สวนศรี	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๑๓๔
๔) นางสาวณัฐกฤตา พลนิกรกิจ	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๑๔๐

๒. ให้เพิ่มเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๙ ราย

๑) นายเกียรติศักดิ์ ทำทอง	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๑
๒) นางสาวธนภร แฉะกระโทก	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๒
๓) นางสาวรยา ปรีดี	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๓
๔) นางสาวญาณินดา แข่มเล็ก	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๔
๕) นางสาวนัสพร การงานดี	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๕
๖) นายธนากร เชื้อมาก	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๖
๗) นางสาวพัชรินทร์ แพรกทอง	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๗
๘) นางสาวนรินทร รินทราช	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๘
๙) นางสาวชญานี เมินกระโทก	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๒๐๙

อนึ่ง หนังสือฉบับนี้จะสิ้นอายุพร้อมหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นางสาวปัทมวรรณ คุณประเสริฐ)
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๒๒ ต่อ ๒๒๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๒๒ ต่อ ๒๒๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
สำเนาถูกต้อง

"อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

ที่ อก ๐๓๑๐(๑)/ ๘๓๐๒

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๘ ตุลาคม ๒๕๖๘

เรื่อง ยกเลิกบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๒๕ กันยายน ๒๕๖๘

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอยกเลิกบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๓ ราย ได้แก่

๑) นางสาวอาริยา ทรารมย์	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๐๖๗
๒) นางสาวศรีเพชร ทองขาว	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๑๓๗
๓) นางสาวปรียา แดนชนบ	ทะเบียนเลขที่ ว-๑๔๕-๑-๐๑๖๔

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นางสาวปัทมวรรณ คุณประเสริฐ)
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๒๒ ต่อ ๒๒๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๒๒ ต่อ ๒๒๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
สำเนาถูกต้อง

"อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

ที่ อก ๐๓๑๐(๑)/ ๖๙๗ ๓

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๒๕ สิงหาคม ๒๕๖๘

เรื่อง ยกเลิกบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๗ สิงหาคม ๒๕๖๘

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๓ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอยกเลิกบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๕ ราย ได้แก่

๑) นายคณิสิน พงษ์อิศรานุพร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๔
๒) นายธีรวัฒน์ ธรรมสุวรรณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๘
๓) นายอาทิตย์ ตาภา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๒
๔) นางสาวกมลชนก ปุนคำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๒
๕) นายวีระพงษ์ แสงทำนิ้ง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๘

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายศิระ จันทร์เฉิด)
นักวิทยาศาสตร์ชำนาญวิทยาการแทน
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๐๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

สำเนาถูกต้อง

Green Industry "อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

ที่ อก ๐๓๑๐(๑)/ ๕๖๙๓

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๗ กรกฎาคม ๒๕๖๘

เรื่อง เปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๙ พฤษภาคม ๒๕๖๘

สิ่งที่ส่งมาด้วย เอกสารแนบท้ายหนังสือเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด จำนวน ๒ แผ่น

ตามหนังสือที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๓ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์ ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

๑. ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๓ ราย

๑) นายสุขสันต์ พันสิงห์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓
๒) นางสาวสุภัสสรา เอี่ยนเจิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๙
๓) นางสาวชามันตา กีมาคม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๖

๒. ให้เพิ่มผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๑ ราย

นายสุขสันต์ พันสิงห์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๗

๓. ให้เพิ่มขอบข่ายสารมลพิษที่วิเคราะห์ในน้ำใต้ดิน อากาศเสีย และดิน ตามสิ่งที่ส่งมาด้วย

อนึ่ง หนังสือฉบับนี้จะหมดอายุพร้อมหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายประสม คำรงพงษ์)
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๐๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

สำเนาถูกต้อง

Green Industry "อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

เอกสารแนบท้ายหนังสือเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๕๖๙๓ ลงวันที่ ๐๗ กรกฎาคม ๒๕๖๘

ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม จำนวน ๑๑ รายการ

น้ำใต้ดิน จำนวน 4 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Aluminum	Digestion, Inductively Coupled Plasma Method[1]
2	Copper	1) Digestion, Flame Atomic Absorption Spectrometric Method[1] 2) Digestion, Inductively Coupled Plasma Method[1]
3	Iron	1) Digestion, Flame Atomic Absorption Spectrometric Method[1] 2) Digestion, Inductively Coupled Plasma Method[1]
4	Molybdenum	Digestion, Inductively Coupled Plasma Method[1]

อากาศเสีย (ปล่องระบาย) จำนวน 1 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Oxides of Nitrogen	Absorption Sampling, Ion Chromatographic Method[2]

ดิน จำนวน 6 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Aluminum	Digestion, Inductively Coupled Plasma Method[3,5]
2	Copper	1) Digestion, Flame Atomic Absorption Spectrometric Method[3,6] 2) Digestion, Inductively Coupled Plasma Method[3,5]
3	Iron	1) Digestion, Flame Atomic Absorption Spectrometric Method[3,6] 2) Digestion, Inductively Coupled Plasma Method[3,5]
4	Molybdenum	Digestion, Inductively Coupled Plasma Method[3,6]
5	pH	Electrometric Method[8]
6	TPH (C_5-C_8)	Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[4,7]

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

สำเนาถูกต้อง

เอกสารอ้างอิง

1. APHA, AWWA, WEF. Standard Methods for the Examination of Water and Wastewater. 24th ed. Washington, DC: APHA, 2023.

2. United States Environmental Protection Agency. Standards of Performance for New Stationary Sources. 40 CFR 60. Appendix A, 2023.

3. United States...

3. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Acid Digestion of Sediments, Sludges, and Soils. SW-846 Method 3050B, 1996.

4. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Volatile Organic Compounds in Various Sample Matrices Using Equilibrium Headspace Analysis. SW-846 Method 5021A, 2014.

5. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Inductively Coupled Plasma-Optical Emission Spectrometry. SW-846 Method 6010D, 2018.

6. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Flame Atomic Absorption Spectrophotometry. SW-846 Method 7000B, 2007.

7. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Volatile Organic Compounds by Gas Chromatography/ Mass Spectrometry. SW-846 Method 8260D, 2018.

8. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Soil and Waste pH. SW-846 Method 9045D, 2004.

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

สำเนาถูกต้อง

ที่ อก ๐๓๑๐(๑)/ ๑๔๙๑

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๒๔ กุมภาพันธ์ ๒๕๖๘

เรื่อง ยกเลิกบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๑๘ กุมภาพันธ์ ๒๕๖๘

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอยกเลิกบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๓ ราย ได้แก่

๑) นายอภิสิทธิ์ ศรีคงแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๔
๒) นางสาวนันธิดา พรมกวยถ้ำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๐
๓) นายภูวดล เป็งมา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๔

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

จงสรางกูร

(นายธีรทัศน์ อิศรางกูร ณ อยุธยา)
รองอธิบดี ปฏิบัติราชการแทน
อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๑๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

สำเนาถูกต้อง

ที่ อก ๐๓๑๐(๑)/ ๑๐๘๙

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๗ กุมภาพันธ์ ๒๕๖๘

เรื่อง ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๓ ธันวาคม ๒๕๖๗

สิ่งที่ส่งมาด้วย ๑. รายชื่อผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔๐ ราย
๒. รายชื่อเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๑๔๑ ราย
๓. ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ขอต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ต่อกรมโรงงานอุตสาหกรรม นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน โดยมีองค์ประกอบดังนี้

ก. ผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔๐ ราย ตามสิ่งที่ส่งมาด้วย ๑
ข. เจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๑๔๑ ราย ตามสิ่งที่ส่งมาด้วย ๒
ค. ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนให้วิเคราะห์ในน้ำ/น้ำเสีย น้ำใต้ดิน อากาศเสีย สิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และดิน ตามสิ่งที่ส่งมาด้วย ๓

หนังสือฉบับนี้จะหมดอายุในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒ หากประสงค์จะต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ให้ยื่นคำขอต่ออายุพร้อมเอกสารประกอบคำขอต่อกรมโรงงานอุตสาหกรรมภายใน ๖๐ วัน ก่อนวันสิ้นอายุของหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

จงสรางกูร

(นายธีรทัศน์ อิศรางกูร ณ อยุธยา)
รองอธิบดี ปฏิบัติราชการแทน
อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๓๑๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

สำเนาถูกต้อง

สิ่งที่ส่งมาด้วย ๑

เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๑๐๘๙ ลงวันที่ ๐๗ กุมภาพันธ์ ๒๕๖๘

ก. ผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔๐ ราย

๑) นางสาวกฤชวรรณ ภัทรธีรกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๑
๒) นายนรงค์ ฉิมพาลี	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๒
๓) นางสาวนันทิตา บุญไสย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๓
๔) นางปิยะพัชร์ สุทธมนัสวงษ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๔
๕) นางสาวเบญจวรรณ วิริโยทัย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๖
๖) นายนพรัตน์ วงศ์อนุรักษ์ชัย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๗
๗) นางสาวฉวีวรรณ บุญลา	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๘
๘) นายสุวิทย์ จอดนอก	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๙
๙) นางสาวโชติภา สมบรรณ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๐
๑๐) นางสาวบุษกร เลิศภาณุมาศ	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๑
๑๑) นางสาววิไลลักษณ์ ศรีสุข	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๒
๑๒) นายศิลา บรรจงใจรักษ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๔
๑๓) นายปฏิกรณ์ คณะนา	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๕
๑๔) นายธีรวัฒน์ ชมมิ่ง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๖
๑๕) นางสาวศิริพร ศรีประดิษฐ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๗
๑๖) นางสาวสาวิตรี วิรัง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๘
๑๗) นางสาวนพวรรณ อุรารักษ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๙
๑๘) นายภูชงค์ พานิชย์เลิศอำไพ	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๐
๑๙) นายณัฐวัฒน์ แคงสวัสดิ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๑
๒๐) นายเอกรัตน์ ปณะคามินทร์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๒
๒๑) นางสาวนิศารัตน์ ศรีสกุลสิทธิโชค	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๓
๒๒) นางสาวเจตจรินทร์ ทำสะอาด	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๔
๒๓) นางสาวสุวรรณ คงทอง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๕
๒๔) นางสาววรกร พัดสองชั้น	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๖
๒๕) นายวีรยุทธ โมกแก้ว	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๗
๒๖) นายวัชรพงษ์ เทพดนตรี	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๘
๒๗) นายอนุศาสน์ สวยดี	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๙
๒๘) นายกรวิทย์ เจี่ยศิริสกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๐
๒๙) นายสุทธิระ อรุณจันทร์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๓
๓๐) นางสาวทัตนีย์ อ่อนคำ	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๔
๓๑) นางพริ้มพรรณ กอนสิน	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๕
๓๒) นายศุภณัฐ์ คุณธนกาญจน์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๖
๓๓) นางสาวศิริภาพร เหมือนเง่	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๗
๓๔) นางศิวานัส ชำนิล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๘
๓๕) นางสาวพรรนิภา ธีระจินดาชล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๙

๑๓๖) นายนาเคนทร์...

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

สำเนาถูกต้อง

๓๖) นายนาเคนทร์ พันธุ์ชิราติกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๐
๓๗) นายกานต์พงศ์ บุญพวง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๓
๓๘) นางสุธรรมา แก้วช้อนอก	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๒
๓๙) นางสาวรสริน ไทยเชษฐ์พิพัฒกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๓
๔๐) นางมานิดา แย้มใย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๔

ตามที่

เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๑ ๐ ๘ ๙ ลงวันที่ ๐๗ กุมภาพันธ์ ๒๕๖๘

ข. เจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๑๔๑ ราย

๑) นายสุรสันต์ พันสิงห์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑
๒) นายพีรณัฐ เจริญผล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓
๓) นางสาววิไลลักษณ์ เกไธสง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๔
๔) นายสมชาติ อุทุมรัตน์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๕
๕) นางสาวปรมาภรณ์ ทองแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๖
๖) นางสาวกัลยา สมพงษ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๗
๗) นางสาววรรณี สายบุญเรือน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๙
๘) นายกฤษณพงษ์ นามทิพย์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๑
๙) นางสาวอาภรณ์ อ่อนคง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๒
๑๐) นายกิตติศักดิ์ ทรงจำรัส	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๓
๑๑) นางสาวอักษรินทร์ บุญคง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๔
๑๒) นางสาวพรพิมล แว่นทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๕
๑๓) นายอภิวิชญ์ ห่วงที	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๗
๑๔) นายมานิตย์ ปานโชติ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๘
๑๕) นายทศพร ธนะพิรุหน์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๑๙
๑๖) นางสาวกัลยาณี โยธา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๐
๑๗) นางสาวเกวลี สุขรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๓
๑๘) นางสาวชมชนัญ อภิพิทย์ปกา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๒
๑๙) นายศิรพัชร จงผดุงเกียรติ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๓
๒๐) นางสาวสุภาวดี อินยาศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๔
๒๑) นายพงศ์เทพ เหล่าขจร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๕
๒๒) นายขวัญชัย พันทุกข์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๖
๒๓) นางสาวพัชจิรา คดีพิศาล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๗
๒๔) นางสาวเมวิกา เสือคำจันทร์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๘
๒๕) นายพีระพัฒน์ บัญญัติศิลป์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๒๒
๒๖) นายชัชวาลย์ เสื่อนล่อง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๓๔
๒๗) นายนภสินธุ์ ธนูธรรมรัตน์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๓๖
๒๘) นายกันนิกร ระโส	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๓๗
๒๙) นายปริญญา กลมเกลียว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๓๙
๓๐) นายธีรวัจน์ มาตรโพธิ์ศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๐
๓๑) นายบุญญฤทธิ์ ก้อนสิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๔
๓๒) นายพรรษวุฒิ โถวสกุล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๓
๓๓) นายอชิตะ แสงจันทร์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๕
๓๔) ว่าที่ร้อยตรีณัฐพงศ์ เมืองขัย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๕
๓๕) นายธนัท เลิศประเสริฐ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๖

ต่อหน้า ๒

๓๖) นางสาวนิภาพร จันทเขตต์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๗
๓๗) นายรณภพ ภู่ตระกูลพัฒนา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๙
๓๘) นายสมพงศ์ สกุลไทย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๓
๓๙) นายสุริยัน นิธิเชิดชูวงศ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๒
๔๐) นายยัษฎาวุธ ยนศิริ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๓
๔๑) นายเอกวุฒิ เสนอใจ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๔
๔๒) นายสุรสันต์ บุญเลี้ยง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๕
๔๓) นายธนเดช หวานเสนาะ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๖
๔๔) นายอภิสิทธิ์ ศรีคงแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๘
๔๕) ว่าที่ร้อยตรีอุทัย แก้วรากมุข	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๐
๔๖) นางสาววนารินทร์ สานนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๑
๔๗) นายศุภกร รินวงศ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๒
๔๘) นางสาวจินตสุภา เปลี่ยนศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๕
๔๙) นางสาวเนตรนภา กมลบูรณ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๖
๕๐) นางสาวอารียา ทรารมย์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๗
๕๑) นายจิรวัฒน์ สุขเกษม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๘
๕๒) นายกิตพงษ์ สอนชัยภูมิ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๙
๕๓) นายจุมพล สวนเพชร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๐
๕๔) นางสาวพัชราภรณ์ แสงฟ้า	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๑
๕๕) นายรัตนชัย เหล่ามา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๒
๕๖) นายอิทธิพงษ์ ศรวิเศษ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๓
๕๗) นางสาวกรณิการ์ สำสีหา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๔
๕๘) นางสาวณัฐชา พรหมศิริ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๙
๕๙) นายนภสิทธิ์ ศรีพิมพ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๘๕
๖๐) นางสาวลักษิกา จันทรสุข	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๘๖
๖๑) นายศักดิ์ศิรนต์ นุ่มนิ่ม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๘๙
๖๒) นายวรพงษ์ นนทจันทร์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๐
๖๓) นางสาวขนาภา มาคะมาตร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๒
๖๔) นายณัฐชัย พรหมอารักษ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๖
๖๕) นายชนินทร์ พานแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๗
๖๖) นายปรัชชาพล โสภา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๘
๖๗) นายวัชรินทร์ แสนงาม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๙
๖๘) นายอาทิตย์ อุดมผล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๐
๖๙) นายอิทธิเดช ไชยบุญ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๔
๗๐) นายคณิติน พงษ์อิศรานุพร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๔
๗๑) นายเสฏฐวุฒิ เอมกลิ่นบัว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๖
๗๒) นางสาวนาตาชา แหวนในเมือง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๙
๗๓) นางสาวพิมลวรรณ สิมมา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๐

ต่อหน้า ๓

๗๔) นายนันทวัฒน์ วงค์คำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๑
๗๕) นายประพันธ์ยุทธ์ เผือกนาง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๒
๗๖) นางสาวสมิธฐา ล่าชิด	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๓
๗๗) นางสาวนภาพร ขึ้นนกขุ้ม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๔
๗๘) นางสาวเบญญา มอมุงคุณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๕
๗๙) นายธมรพล อมรลักษณ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๖
๘๐) นางสาวศรีเพชร ทองขาว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๗
๘๑) นางสาวณิชากร ศุภชาติโกรสร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๘
๘๒) นางสาววิมลวรรณ คำต้น	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๙
๘๓) นายคุณานนท์ อุทธาคณานนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๓
๘๔) นายชาญณรงค์ อำลอย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๔
๘๕) นางสาวจิตรมาส ศรีวรรณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๕
๘๖) นายสุจิต โปขันเงิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๖
๘๗) นายเจษฎา ช่วยตรึก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๗
๘๘) นายรชต เหมธุลิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๘
๘๙) นายสุรโชค หล่าไท	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๐
๙๐) นายชัย บัวสด	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๓
๙๑) นางสาวอรญา ประสานศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๒
๙๒) นายนพดล เนียมนิยม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๓
๙๓) นายศุภกร สวนศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๔
๙๔) นายคณพล ศิลานนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๕
๙๕) นายโชคชัย พุ่มไสว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๖
๙๖) นายธีรวัฒน์ ธรรมสุวรรณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๘
๙๗) นายนัทธพงศ์ ชะชุนทด	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๙
๙๘) นางสาวณัฐกฤตา พลนิกรกิจ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๐
๙๙) นางสาวชไมพร ทองบูรณ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๑
๑๐๐) นางสาวพรชิตา ขจรเดชัยยุทธ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๒
๑๐๑) นางสาวเพ็ญพิชชา รอดทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๕
๑๐๒) นางสาวเณัชชา แสงสว่าง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๖
๑๐๓) นายกีรติ สีอาจ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๗
๑๐๔) นายดนุพร คงศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๘
๑๐๕) นางสาวสุภัสสรา เฉี่ยนเงิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๙
๑๐๖) นางสาวพรรณทิพา อะไนนาม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๐
๑๐๗) นายอนันต์ มุดอ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๑
๑๐๘) นางสาวพรพิมล ประชาพันธ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๒
๑๐๙) นายวีรภัทร บุญญาธิ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๓
๑๑๐) นางสาวณัฐชา แถวภาพ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๔
๑๑๑) นายสิทธิพล พร้อมพอชื่นบุญ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๖
๑๑๒) นางสาวนนท์หิชา กลิ่นหนู	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๘

ต่อหน้า ๔

๑๑๓) นางสาวปิติยา ชูเชิดเชื้อ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๐
๑๑๔) นางสาวลัดดาวัลย์ ไพลี่พันธ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๓
๑๑๕) นายอาทิตย์ ดาภา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๒
๑๑๖) นางสาวบุญยาพร บุญถนอมศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๓
๑๑๗) นางสาวพัชราวรรณ จันธิบุตร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๔
๑๑๘) นางสาวนฤภร ไล้บ้านกวย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๕
๑๑๙) นางสาวปรีณา แดนขนบ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๗
๑๒๐) นางสาวนันธิดา พรมกวยถ้ำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๐
๑๒๑) นางสาวกมลชนก ปุนคำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๒
๑๒๒) นางสาวปาริฉัตร ทองใบ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๔
๑๒๓) นายชัยวัฒน์ จันละคร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๖
๑๒๔) นางสาวกัลยา สิงห์แก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๘
๑๒๕) นางสาวอารีนา มะตีเย๊าะ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๔
๑๒๖) นายฐาปกรณ์ อนุรา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๕
๑๒๗) นางสาวชามันตา กิมาคม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๖
๑๒๘) นายธนบดินทร์ ยาเหลี่ยม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๗
๑๒๙) นายวีระพงษ์ แสงท่านั่ง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๘
๑๓๐) นางสาวปิยะณัฐชยา สำเภาพงษ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๙
๑๓๑) นางสาวนภัสสร ศรีสถาน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๐
๑๓๒) นางสาวจุรีย์รัตน์ โสแหน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๓
๑๓๓) นายธีรวัฒน์ พรหมลา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๒
๑๓๔) นายธนวิชช์ ปลั่งกลาง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๓
๑๓๕) นายณภัทร เตมียบุตร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๔
๑๓๖) นางสาวจิดาภา ฤาชา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๕
๑๓๗) นางสาวสุมณฑาทิพย์ สังข์ทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๖
๑๓๘) นางสาวชาริสา บาบุญ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๗
๑๓๙) นายภูวดล เบ็งมา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๘
๑๔๐) ว่าที่ร้อยตรีรณฤทธ ประทุมเขตต์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๙
๑๔๑) นายธนุศร พลสำโรง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๐

ต่อหน้า ๕

เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๓ ๐ ๘ ๙ ลงวันที่ ๐๗ กุมภาพันธ์ ๒๕๖๘

ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม จำนวน ๓๕๗ รายการ

น้ำ/น้ำเสีย จำนวน 46 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Aldrin	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
2	Arsenic	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
3	Barium	Digestion, Inductively Coupled Plasma Method[4]
4	α-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
5	β-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
6	δ-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
7	γ-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
8	Biochemical Oxygen Demand	1) 5-Day BOD Test, Azide Modification Method[4] 2) 5-Day BOD Test, Membrane Electrode Method[4]
9	Cadmium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
10	Chemical Oxygen Demand	1) Closed Reflux, Titrimetric Method[4] 2) Closed Reflux, Colorimetric Method[4] 3) Open Reflux, Titrimetric Method[4]
11	Chlordane	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
12	Chromium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
13	Color	ADMI Weighted-Ordinate Spectrophotometric Method[4]
14	Copper	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
15	Cyanide	1) Distillation, Colorimetric Method[4] 2) Total Cyanide after Distillation, by Flow Injection Analysis Method[4]
16	o,p'-DDT	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
17	4,4'-DDD	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
18	4,4'-DDE	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
19	4,4'-DDT	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
20	Dieldrin	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
21	Endosulfan I	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
22	Endosulfan II	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
23	Endosulfan sulfate	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
24	Endrin	Liquid-Liquid Extraction, Gas Chromatographic Method[4]

ต่อหน้าที่ ๒

25 Endrin aldehyde...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
25	Endrin aldehyde	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
26	Formaldehyde	Distillation, Colorimetric Method[2]
27	Free Chlorine	1) Iodometric Method[4] 2) DPD Ferrous Titrimetric Method[4]
28	Heptachlor	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
29	Heptachlor Epoxide	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
30	Hexavalent Chromium	Colorimetric Method[4]
31	Lead	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
32	Manganese	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
33	Mercury	Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[4]
34	Methoxychlor	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
35	Nickel	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
36	Oil & Grease	1) Liquid-Liquid, Partition-Gravimetric Method[4] 2) Soxhlet Extraction Method[4]
37	pH	Electrometric Method[4]
38	Phenols	1) Distillation, Chloroform Extraction Method[4] 2) Distillation, Direct Photometric Method[4]
39	Selenium	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
40	Sulfide	1) Iodometric Method[4] 2) Methylene Blue Method[4]
41	Temperature	Laboratory and Field Methods[4]
42	Total Dissolved Solids	Dried at 180 °C[4]
43	Total Kjeldahl Nitrogen	Semi-Micro-Kjeldahl Method[4]
44	Total Suspended Solids	Dried from 103 to 105 °C[4]
45	Trivalent Chromium	1) Digestion, Direct Air-Acetylene Flame Method; Colorimetric Method; Calculation[4] 2) Digestion, Inductively Coupled Plasma Method; Colorimetric Method; Calculation[4]
46	Zinc	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]

ต่อหน้าที่ ๓

น้ำใต้ดิน...

น้ำใต้ดิน จำนวน 126 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Acenaphthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
2	Acetone	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
3	Aldrin	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
4	Anthracene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
5	Antimony	Digestion, Inductively Coupled Plasma Method[4]
6	Arsenic	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
7	Atrazine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
8	Barium	Digestion, Inductively Coupled Plasma Method[4]
9	Benz(a)anthracene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
10	Benzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
11	Benzo(b)fluoranthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
12	Benzo(k)fluoranthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
13	Benzoic acid	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

ต่อหน้าที่ ๔

14 Benzo(a)pyrene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
14	Benzo(a)pyrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
15	Benzo(g,h,i)perylene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
16	Beryllium	Digestion, Inductively Coupled Plasma Method[4]
17	Bis(2-chloroethyl)ether	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
18	Bis(2-ethylhexyl)phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
19	Bromodichloromethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
20	Bromoform	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
21	Butanol	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
22	Butyl benzyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
23	Cadmium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Electrothermal Atomic Absorption Spectrometric Method[4] 3) Digestion, Inductively Coupled Plasma Method[4]
24	Carbazole	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
25	Carbon disulfide	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
26	Carbon tetrachloride	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
27	Chlordane	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
28	p-Chloroaniline	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

ต่อหน้าที่ ๕

29 Chlorobenzene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
29	Chlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
30	Chlorodibromomethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
31	Chloroform	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
32	2-Chlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
33	Chromium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
34	Chromium (III)	1) Digestion, Direct Air-Acetylene Flame Method; Colorimetric Method; Calculation[4] 2) Digestion, Inductively Coupled Plasma Method; Colorimetric Method; Calculation[4]
35	Chromium (VI)	Colorimetric Method[4]
36	Chrysene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
37	Cyanide	Distillation, Colorimetric Method[4]
38	2,4-D	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
39	DDD	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
40	DDE	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
41	DDT	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
42	Dibenz(a,h)anthracene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

43 Di-n-butyl phthalate...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
43	Di-n-butyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
44	1,2-Dichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
45	1,3-Dichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
46	1,4-Dichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
47	3,3′-Dichlorobenzidine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
48	1,1-Dichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
49	1,2-Dichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
50	1,1-Dichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
51	cis-1,2-Dichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
52	trans-1,2-Dichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
53	2,4-Dichlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
54	1,2-Dichloropropane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
55	1,3-Dichloropropane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
56	1,3-Dichloropropene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
57	Dieldrin	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
58	Diethyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
59	2,4-Dimethylphenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
60	2,4-Dinitrophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

61 2,4-Dinitrotoluene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
61	2,4-Dinitrotoluene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
62	2,6-Dinitrotoluene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
63	Di-n-Octyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
64	Endosulfan	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
65	Endrin	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
66	Ethylbenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
67	Fluoranthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
68	Fluorene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
69	Heptachlor	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
70	Heptachlor epoxide	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
71	Hexachlorobenzene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
72	Hexachloro-1,3-butadiene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
73	n-Hexane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]

74 α-HCH...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
74	α-HCH	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
75	β-HCH	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
76	γ-HCH	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
77	Hexachlorocyclopentadiene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
78	Hexachloroethane	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
79	Indeno(1,2,3-cd)pyrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
80	Isophorone	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
81	Lead	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Electrothermal Atomic Absorption Spectrometric Method[4] 3) Digestion, Inductively Coupled Plasma Method[4]
82	Manganese	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
83	Mercury	Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[4]
84	Methanol	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
85	Methoxychlor	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
86	Methyl bromide	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]

87 Methylene chloride...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
87	Methylene chloride	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
88	2-Methylphenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
89	2-Methylnaphthalene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
90	Methyl tert-butyl ether	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
91	Naphthalene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
92	Nickel	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
93	Nitrobenzene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
94	N-Nitrosodiphenylamine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
95	N-Nitrosodi-n-propylamine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
96	Polychlorinated Biphenyls - PCB 1016 - PCB 1221 - PCB 1232 - PCB-1242 - PCB-1248 - PCB-1254 - PCB-1260	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
97	Pentachlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
98	pH	Electrometric Method[4]
99	Phenanthrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

100 Phenol...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
100	Phenol	1) Distillation, Chloroform Extraction Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
101	Pyrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
102	Selenium	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
103	Silver	Digestion, Inductively Coupled Plasma Method[4]
104	Styrene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
105	1,1,2,2-Tetrachloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
106	Tetrachloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
107	Toluene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
108	Toxaphene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
109	TPH (C_5 - C_8)	1) Purge and Trap, Gas Chromatographic Method[12,22] 2) Purge and Trap, Gas Chromatographic/Mass spectrometric Method[12,27]
110	TPH ($C_{>8}$ – C_{16})	Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[9,22]
111	TPH ($C_{>16}$ – C_{35})	Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[9,22]
112	1,2,4-Trichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
113	1,1,1-Trichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
114	1,1,2-Trichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
115	Trichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]

116 2,4,5-Trichlorophenol...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
116	2,4,5-Trichlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
117	2,4,6-Trichlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
118	1,3,5-Trimethylbenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
119	Vanadium	Digestion, Inductively Coupled Plasma Method[4]
120	Vinyl acetate	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
121	Vinyl chloride	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
122	m-Xylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
123	o-Xylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
124	p-Xylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
125	Xylene (Total)	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
126	Zinc	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]

อากาศเสีย (ปล่องระบาย) จำนวน 25 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Antimony	Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
2	Arsenic	1) Isokinetic Sampling, Digestion, Hydride Generation/ Atomic Absorption Spectrometric Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
3	Cadmium	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
4	Carbon Monoxide	Instrumental Analyzer Method[5]
5	Chlorine	Isokinetic Sampling, Ion Chromatographic Method[5]
6	Chromium	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5]

Chromium (ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
6	Chromium (ต่อ)	2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
7	Cobalt	Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
8	Copper	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
9	Cresol	Absorption Sampling, Gas Chromatographic Method[5]
10	Dioxins/Furans	Isokinetic Sampling[5]
11	Hydrogen Chloride	Isokinetic Sampling, Ion Chromatographic Method[5]
12	Hydrogen Fluoride	Isokinetic Sampling, Ion Chromatographic Method[5]
13	Hydrogen Sulfide	Absorption Sampling, Iodometric Method[5]
14	Lead	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
15	Manganese	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
16	Mercury	Isokinetic Sampling, Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[5]
17	Nickel	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
18	Opacity	Ringelmann's Method[1]
19	Oxides of Nitrogen	1) Absorption Sampling, Phenoldisulfonic acid Method[5] 2) Instrumental Analyzer Method[5]
20	Selenium	1) Isokinetic Sampling, Digestion, Hydride Generation/ Atomic Absorption Spectrometric Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
21	Sulfur Dioxide	1) Absorption Sampling, Barium-Thorin Titrimetric Method[5] 2) Instrumental Analyzer Method[5]
22	Sulfuric Acid	Isokinetic Sampling, Barium-Thorin Titrimetric Method[5]

23 Total Suspended Particulate...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
23	Total Suspended Particulate	Isokinetic Sampling, Gravimetric Method[5]
24	Vanadium	Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
25	Xylene	1) Bag Sampling, Gas Chromatographic Method[5] 2) Adsorption Sampling, Gas Chromatographic Method[5]

สิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว จำนวน 35 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Aldrin	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
2	Antimony	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
3	Arsenic	1) Waste Extraction, Digestion, Hydride Generation/ Atomic Absorption Spectrometric Method[3,6,14] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,14] 4) Digestion, Inductively Coupled Plasma Method[7,14]
4	Barium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
5	Beryllium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
6	Cadmium	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
7	Chlordane	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]

8 Chromium...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
8	Chromium	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
9	Chromium (III)	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method; Waste Extraction, Colorimetric Method; Calculation[3,6,15,17] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method; Waste Extraction, Colorimetric Method; Calculation[3,6,14,17] 3) Digestion, Flame Atomic Absorption Spectrometric Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,15,17] 4) Digestion, Inductively Coupled Plasma Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,14,17]
10	Chromium (VI)	1) Waste Extraction, Colorimetric Method[3,17] 2) Alkaline Digestion, Colorimetric Method[8,17]
11	Cobalt	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
12	Copper	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
13	2,4-D	1) Waste Extraction, Gas Chromatographic Method[3,26] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,26]
14	DDD	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]

15 DDE...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
15	DDE	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
16	DDT	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
17	Dieldrin	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
18	Endrin	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
19	Heptachlor	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
20	Lead	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
21	Lindane	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
22	Mercury	1) Waste Extraction, Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[3,19] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[19] 4) Digestion, Inductively Coupled Plasma Method[7,14]

Mercury (ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
22	Mercury (ต่อ)	5) Thermal Decomposition Amalgamation and Atomic Absorption Spectrometric Method[20]
23	Methoxychlor	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
24	Molybdenum	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
25	Nickel	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
26	Polychlorinated Biphenyls - Aroclor 1016 - Aroclor 1221 - Aroclor 1232 - Aroclor 1242 - Aroclor 1248 - Aroclor 1254 - Aroclor 1260 - 2-Chlorobiphenyl - 2,3-Dichlorobiphenyl - 2,2',5-Trichlorobiphenyl - 2,4',5-Trichlorobiphenyl - 2,2',3,5'-Tetrachlorobiphenyl - 2,2',5,5'-Tetrachlorobiphenyl - 2,3',4,4'-Tetrachlorobiphenyl - 2,2',3,4,5'-Pentachlorobiphenyl - 2,2',4,5,5'-Pentachlorobiphenyl - 2,3,3',4',6-Pentachlorobiphenyl	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,26] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,24]

Polychlorinated Biphenyls(ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
	Polychlorinated Biphenyls(ต่อ) - 2,2',3,4,4',5'-Hexachlorobiphenyl - 2,2',3,4,5,5'-Hexachlorobiphenyl - 2,2',3,5,5',6-Hexachlorobiphenyl - 2,2',4,4',5,5'-Hexachlorobiphenyl - 2,2',3,3',4,4',5-Heptachlorobiphenyl - 2,2',3,4,4',5,5'-Heptachlorobiphenyl - 2,2',3,4,4',5',6-Heptachlorobiphenyl - 2,2',3,4',5,5',6-Heptachlorobiphenyl - 2,2',3,3',4,4',5,5',6-Nonachlorobiphenyl	
27	Pentachlorophenol	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[3,9,28] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
28	pH	Electrometric Method[31,32]
29	Selenium	1) Waste Extraction, Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[3,6,21] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,16] 3) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,21] 4) Digestion, Inductively Coupled Plasma Method[7,16]
30	Silver	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,16] 2) Digestion, Inductively Coupled Plasma Method[7,16]
31	Thallium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,16] 2) Digestion, Inductively Coupled Plasma Method[7,16]

32 Toxaphene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
32	Toxaphene	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
33	Trichloroethylene	1) Waste Extraction, Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[3,12,27] 2) Waste Extraction, Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[3,11,27] 3) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 4) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
34	Vanadium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,16] 2) Digestion, Inductively Coupled Plasma Method[7,16]
35	Zinc	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,16] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,16]

ดิน จำนวน 125 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Acenaphthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
2	Acetone	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
3	Aldrin	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
4	Anthracene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]

Anthracene (ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
4	Anthracene (ต่อ)	2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
5	Antimony	Digestion, Inductively Coupled Plasma Method[7,14]
6	Arsenic	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,16] 2) Digestion, Inductively Coupled Plasma Method[7,14]
7	Atrazine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
8	Barium	Digestion, Inductively Coupled Plasma Method[7,16]
9	Benz(a)anthracene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
10	Benzene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
11	Benzo(b)fluoranthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
12	Benzo(k)fluoranthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
13	Benzoic acid	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
14	Benzo(a)pyrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
15	Benzo(g,h,i)perylene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
16	Beryllium	Digestion, Inductively Coupled Plasma Method[7,16]

17 Bis(2-chloroethyl)ether...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
17	Bis(2-chloroethyl)ether	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
18	Bis(2-ethylhexyl)phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
19	Bromodichloromethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
20	Bromoform	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
21	Butanol	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
22	Butyl benzyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
23	Cadmium	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,16]
24	Carbazole	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
25	Carbon disulfide	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
26	Carbon tetrachloride	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
27	Chlordane	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
28	p-Chloroaniline	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
29	Chlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
30	Chlorodibromomethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
31	Chloroform	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
32	2-Chlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]

33 Chromium...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
33	Chromium	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15]
		2) Digestion, Inductively Coupled Plasma Method[7,14]
34	Chromium (III)	1) Digestion, Flame Atomic Absorption Spectrometric Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,15,17]
		2) Digestion, Inductively Coupled Plasma Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,14,17]
35	Chromium (VI)	Alkaline Digestion, Colorimetric Method[8,17]
36	Chrysene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
37	Cyanide	Extraction, Distillation, Colorimetric Method[29,30]
38	2,4-D	Ultrasonic Extraction, Gas Chromatographic Method[26]
39	DDD	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
40	DDE	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
41	DDT	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
42	Dibenz(a,h)anthracene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
43	Di-n-butyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
44	1,2-Dichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
45	1,3-Dichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
46	1,4-Dichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
47	3,3'-Dichlorobenzidine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
48	1,1-Dichloroethane	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
		2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
49	1,2-Dichloroethane	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
		2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
50	1,1-Dichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
		2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
51	cis-1,2-Dichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
		2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
52	trans-1,2-Dichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
		2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
53	2,4-Dichlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
54	1,2-Dichloropropane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
55	1,3-Dichloropropane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
56	1,3-Dichloropropene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
57	Dieldrin	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
58	Diethyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
59	2,4-Dimethylphenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
60	2,4-Dinitrophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
61	2,4-Dinitrotoluene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
62	2,6-Dinitrotoluene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
63	Di-n-Octyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
64	Endosulfan	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
65	Endrin	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
66	Ethylbenzene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
		2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
67	Fluoranthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
68	Fluorene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
69	Heptachlor	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,26]
70	Heptachlor epoxide	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
70	Heptachlor epoxide (ต่อ)	2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
71	Hexachlorobenzene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
72	Hexachloro-1,3-butadiene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
73	n-Hexane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
74	α-HCH	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
75	β-HCH	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
76	γ-HCH	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
77	Hexachlorocyclopentadiene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
78	Hexachloroethane	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
79	Indeno(1,2,3-cd)pyrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]
		2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
80	Isophorone	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
81	Lead	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15]
		2) Digestion, Inductively Coupled Plasma Method[7,14]
82	Manganese	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15]
		2) Digestion, Inductively Coupled Plasma Method[7,14]

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
83	Mercury	1) Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[19] 2) Thermal Decomposition Amalgamation and Atomic Absorption Spectrometric Method[20]
84	Methanol	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
85	Methoxychlor	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
86	Methyl bromide	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
87	Methylene chloride	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
88	2-Methylphenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
89	2-Methylnaphthalene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
90	Methyl tert-butyl ether	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
91	Naphthalene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
92	Nickel	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,14]
93	Nitrobenzene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
94	N-Nitrosodiphenylamine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
95	N-Nitrosodi-n-propylamine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
96	Polychlorinated Biphenyls - Aroclor 1016	1) Ultrasonic Extraction, Gas Chromatographic Method[10,24]

Polychlorinated Biphenyls(ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
96	Polychlorinated Biphenyls(ต่อ) - Aroclor 1221 - Aroclor 1232 - Aroclor 1242 - Aroclor 1248 - Aroclor 1254	2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
	- Aroclor 1260 Polychlorinated Biphenyls - 2-Chlorobiphenyl - 2,3-Dichlorobiphenyl - 2,2',5-Trichlorobiphenyl - 2,4',5-Trichlorobiphenyl - 2,2',3,5'-Tetrachlorobiphenyl - 2,2',5,5'-Tetrachlorobiphenyl - 2,3',4,4'-Tetrachlorobiphenyl - 2,2',3,4,5'-Pentachlorobiphenyl - 2,2',4,5,5'-Pentachlorobiphenyl - 2,3,3',4',6-Pentachlorobiphenyl - 2,2',3,4,4',5'-Hexachlorobiphenyl - 2,2',3,4,5,5'-Hexachlorobiphenyl - 2,2',3,5,5',6-Hexachlorobiphenyl - 2,2',4,4',5,5'-Hexachlorobiphenyl - 2,2',3,3',4,4',5-Heptachlorobiphenyl - 2,2',3,4,4',5,5'-Heptachlorobiphenyl - 2,2',3,4,4',5',6-Heptachlorobiphenyl - 2,2',3,4',5,5',6-Heptachlorobiphenyl - 2,2',3,3',4,4',5,5',6-Nonachlorobiphenyl	Ultrasonic Extraction, Gas Chromatographic Method[10,24]

97 Pentachlorophenol...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
97	Pentachlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
98	Phenanthrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
99	Phenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
100	Pyrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
101	Selenium	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,21] 2) Digestion, Inductively Coupled Plasma Method[7,14]
102	Silver	Digestion, Inductively Coupled Plasma Method[7,14]
103	Styrene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
104	1,1,2,2-Tetrachloroethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
105	Tetrachloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
106	Toluene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
107	Toxaphene	Ultrasonic Extraction, Gas Chromatographic Method[10,23]
108	TPH (C_5-C_8)	1) Purge and Trap, Gas Chromatographic Method[13,22] 2) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
109	TPH (C_{9}-C_{16})	Ultrasonic Extraction, Gas Chromatographic Method[10,22]
110	TPH ($C_{>16}$-C_{35})	Ultrasonic Extraction, Gas Chromatographic Method[10,22]

111 1,2,4-Trichlorobenzene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
111	1,2,4-Trichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
112	1,1,1-Trichloroethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
113	1,1,2-Trichloroethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
114	Trichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
115	2,4,5-Trichlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
116	2,4,6-Trichlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
117	1,3,5-Trimethylbenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
118	Vanadium	Digestion, Inductively Coupled Plasma Method[7,14]
119	Vinyl acetate	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
120	Vinyl chloride	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
121	m-Xylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
122	o-Xylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
123	p-Xylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
124	Xylene (Total)	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]

125 Zinc...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
125	Zinc	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,14]

เอกสารอ้างอิง

1. กระทรวงอุตสาหกรรม. ประกาศกระทรวงอุตสาหกรรม, พ.ศ. 2549. เรื่อง กำหนดค่าปริมาณเขม่าควันที่เจือปนในอากาศที่ระบายออกจากปล่องของหม้อน้ำโรงสีข้าวที่ใช้แกลบเป็นเชื้อเพลิง. ราชกิจจานุเบกษา. 4 ธันวาคม 2549. เล่มที่ 123 ตอนพิเศษ 125ง.

2. สมาคมวิศวกรรมสิ่งแวดล้อมแห่งประเทศไทย. คู่มือวิเคราะห์น้ำเสีย. พิมพ์ครั้งที่ 4. กรุงเทพฯ: เรือนแก้วการพิมพ์, 2547.

3. กระทรวงอุตสาหกรรม. ประกาศกระทรวงอุตสาหกรรม, พ.ศ. 2566. เรื่อง การจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว. ราชกิจจานุเบกษา. 31 พฤษภาคม 2566. เล่มที่ 140 ตอนพิเศษ 126 ง.

4. APHA, AWWA, WEF. Standard Methods for the Examination of Water and Wastewater. 24th ed. Washington, DC: APHA, 2023.

5. United States Environmental Protection Agency. Standards of Performance for New Stationary Sources. 40 CFR 60. Appendix A, 2020.

6. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. SW-846, 2014.

7. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Acid Digestion of Sediments, Sludges, and Soils. SW-846 Method 3050B, 1996.

8. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Alkaline Digestion for Hexavalent Chromium. SW-846 Method 3060A, 1996.

9. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste 3. Physical/Chemical Methods. Separatory Funnel Liquid-Liquid Extraction. SW-846 Method 3510C, 1996.

10. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Ultrasonic Extraction. SW-846 Method 3550C, 2007.

11. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Volatile Organic Compounds in Various Sample Matrices Using Equilibrium Headspace Analysis. SW-846 Method 5021A, 2014.

12. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Purge and Trap for Aqueous Samples. SW-846 Method 5030C, 2003.

13. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Closed System Purge and Trap and Extraction for Volatile Organics in Soil and Waste Sample. SW-846 Method 5035A, 2000.

14. United States...

14. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Inductively Coupled Plasma-Optical Emission Spectrometry. SW-846 Method 6010D, 2014.

15. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Flame Atomic Absorption Spectrophotometry. SW-846 Method 7000B, 2007.

16. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Arsenic (Atomic Absorption, Gaseous Hydride). SW-846 Method 7061A, 1992.

17. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Chromium, Hexavalent (Colorimetric). SW-846 Method 7196A, 1992.

18. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Mercury in Liquid Waste (Manual Cold Vapor Technique). SW-846 Method 7470A, 1994.

19. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Mercury in Solid or Semisolid Waste (Manual Cold-Vapor Technique). SW-846 Method 7471B, 1998.

20. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Mercury in Solids and Solutions by Thermal Decomposition, Amalgamation, and Atomic Absorption Spectrophotometry. SW-846 Method 7473, 2007.

21. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Selenium (Atomic Absorption, Borohydride Reduction). SW-846 Method 7742, 1994.

22. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Nonhalogenated Organics Using GC/FID. SW-846 Method 8015D, 2003.

23. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Organochlorine Pesticides by Gas Chromatography. SW-846 Method 8081B, 2007.

24. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Polychlorinated Biphenyls (PCBs) by Gas Chromatography. SW-846 Method 8082A, 2007.

25. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Organochlorine Pesticides by Gas Chromatography. SW-846 Method 8081B, 2007.

26. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Chlorinated Herbicides by GC Using Methylation or Pentafluorobenzylation Derivertization. SW-846 Method 8151A, 1996.

27. United States...

27. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Volatile Organic Compounds by Gas Chromatography/ Mass Spectrometry. SW-846 Method 8260D, 2018.

28. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Semivolatile Organic Compounds by Gas Chromatography/Mass Spectrometry. SW-846 Method 8270E, 2018.

29. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Cyanide Extraction Procedure for Solids and Oils. SW-846 Method 9013A, 2014.

30. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Cyanide in Waters and Extracts using Titrimetric and Manual Spectrophotometric Procedures. SW-846 Method 9014, 2014.

31. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. pH Electrometric Measurement. SW-846 Method 9040C, 2004.

32. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. Soil and Waste pH. SW-846 Method 9045D, 2004.

UAE

UNITED ANALYST AND ENGINEERING
CONSULTANT COMPANY LIMITED

บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด
3 ซอยอุดมสุข 41 ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพฯ 10260
โทรศัพท์ 0-2763-2828 E-MAIL ADDRESS : UAE@UAECONSULTANT.COM