ภาคผนวก ค
ใบรายงานผลการวิเคราะห์คุณภาพสิ่งแวดล้อม

ค-1 รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง เดือนมกราคม พ.ศ. 2569

ค-2 รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง เดือนกุมภาพันธ์ พ.ศ. 2569

ค-3 รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง เดือนมีนาคม พ.ศ. 2569

ค-4 รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง เดือนเมษายน พ.ศ. 2569

ค-5 รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง เดือนพฤษภาคม พ.ศ. 2569

ค-6 รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง เดือนมิถุนายน พ.ศ. 2569

ค-7 รายงานผลการติดตามตรวจสอบคุณภาพน้ำหล่อเย็น

SINGHA COMPLEX

ภาคผนวก ค-1

รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง

เดือนมกราคม พ.ศ. 2569

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JANUARY 26, 2026
SAMPLING TIME : 12:00 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JANUARY 26, 2026
ANALYTICAL DATE : JANUARY 26 - FEBRUARY 2, 2026
ISSUE DATE : FEBRUARY 3, 2026
REPORT NO. : 2026-U008151
WORK NO. : 2025-000405
ANALYSIS NO. : T26AB480-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AB480-0001	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	8.7 (27.3°C)	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	177	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	288	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	417	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	119	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	14	-	3
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			YELLOW/TURBID BROWN		

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Wilailak Srisuk.
(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JANUARY 26, 2026
SAMPLING TIME : 12:00 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : JANUARY 26, 2026
ANALYTICAL DATE : JANUARY 26 - FEBRUARY 1, 2026
ISSUE DATE : FEBRUARY 4, 2026
REPORT NO. : 2026-U008269
WORK NO. : 2025-001734
ANALYSIS NO. : T26AB481-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AB481-0001	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	30.0	0.1
MICROBIOLOGY				
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	1.8
SAMPLE CONDITION				
WATER'S COLOUR/TURBID			YELLOW/TURBID	
SEDIMENT			WHITE	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JANUARY 26, 2026
SAMPLING TIME : 11:15 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JANUARY 26, 2026
ANALYTICAL DATE : JANUARY 26 - FEBRUARY 2, 2026
ISSUE DATE : FEBRUARY 3, 2026
REPORT NO. : 2026-U008153
WORK NO. : 2025-000405
ANALYSIS NO. : T26AB480-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AB480-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.2 (27.5°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	34.2	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	34.9	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	368	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	48.7	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JANUARY 26, 2026
SAMPLING TIME : 11:15 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : JANUARY 26, 2026
ANALYTICAL DATE : JANUARY 26 - FEBRUARY 1, 2026
ISSUE DATE : FEBRUARY 4, 2026
REPORT NO. : 2026-U008271
WORK NO. : 2025-001734
ANALYSIS NO. : T26AB481-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการปาบัด T26AB481-0003	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	< 0.1	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/CLEAR		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025
TESTING 0207
LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JANUARY 26, 2026
SAMPLING TIME : 11:25 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JANUARY 26, 2026
ANALYTICAL DATE : JANUARY 26 - FEBRUARY 2, 2026
ISSUE DATE : FEBRUARY 3, 2026
REPORT NO. : 2026-U008152
WORK NO. : 2025-000405
ANALYSIS NO. : T26AB480-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AB480-0002	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.3 (27.6°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	26.2	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	33.0	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	314	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	50.1	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JANUARY 26, 2026
SAMPLING TIME : 11:25 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM
RECEIVED DATE : JANUARY 26, 2026
ANALYTICAL DATE : JANUARY 26 - FEBRUARY 1, 2026
ISSUE DATE : FEBRUARY 4, 2026
REPORT NO. : 2026-U008270
WORK NO. : 2025-001734
ANALYSIS NO. : T26AB481-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AB481-0002	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	< 0.1	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/CLEAR		
SEDIMENT			WHITE		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

SINGHA COMPLEX

ภาคผนวก ค-2

รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง

เดือนกุมภาพันธ์ พ.ศ. 2569

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : FEBRUARY 23, 2026
SAMPLING TIME : 11:20 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : FEBRUARY 23, 2026
ANALYTICAL DATE : FEBRUARY 23-MARCH 2, 2026
ISSUE DATE : MARCH 4, 2026
REPORT NO. : 2026-U016655
WORK NO. : 2025-000405
ANALYSIS NO. : T26AD686-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AD686-0001	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	8.6 (28.4°C)	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	228	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	170	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	413	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	112	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	24	-	3
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 YELLOW/TURBID BROWN		

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Wilailak Srisuk.
(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : FEBRUARY 23, 2026
SAMPLING TIME : 11:20 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : FEBRUARY 23, 2026
ANALYTICAL DATE : FEBRUARY 23-MARCH 1, 2026
ISSUE DATE : MARCH 5, 2026
REPORT NO. : 2026-U016838
WORK NO. : 2025-001734
ANALYSIS NO. : T26AD687-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AD687-0001	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	21.0	0.1
MICROBIOLOGY				
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	1.8
SAMPLE CONDITION				
WATER'S COLOUR/TURBID			YELLOW/TURBID	
SEDIMENT			WHITE	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION
BLA-DSS
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : FEBRUARY 23, 2026
SAMPLING TIME : 11:00 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : FEBRUARY 23, 2026
ANALYTICAL DATE : FEBRUARY 23-MARCH 2, 2026
ISSUE DATE : MARCH 4, 2026
REPORT NO. : 2026-U016657
WORK NO. : 2025-000405
ANALYSIS NO. : T26AD686-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AD686-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.2 (29.3°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	20.3	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	18.0	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	402	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	40.2	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.
(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : FEBRUARY 23, 2026
SAMPLING TIME : 11:00 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : FEBRUARY 23, 2026
ANALYTICAL DATE : FEBRUARY 23-MARCH 1, 2026
ISSUE DATE : MARCH 5, 2026
REPORT NO. : 2026-U016840
WORK NO. : 2025-001734
ANALYSIS NO. : T26AD687-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AD687-0003	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	< 0.1	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	92,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	92,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/CLEAR		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION
BLA-DSS
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : FEBRUARY 23, 2026
SAMPLING TIME : 10:50 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : FEBRUARY 23, 2026
ANALYTICAL DATE : FEBRUARY 23-MARCH 2, 2026
ISSUE DATE : MARCH 4, 2026
REPORT NO. : 2026-U016656
WORK NO. : 2025-000405
ANALYSIS NO. : T26AD686-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AD686-0002	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.2 (29.5°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	16.8	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	14.4	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	426	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	44.8	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.
(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : FEBRUARY 23, 2026
SAMPLING TIME : 10:50 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : FEBRUARY 23, 2026
ANALYTICAL DATE : FEBRUARY 23-MARCH 1, 2026
ISSUE DATE : MARCH 5, 2026
REPORT NO. : 2026-U016839
WORK NO. : 2025-001734
ANALYSIS NO. : T26AD687-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AD687-0002	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	< 0.1	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	35,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	35,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/CLEAR		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

SINGHA COMPLEX

ภาคผนวก ค-3

รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง

เดือนมีนาคม พ.ศ. 2569

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MARCH 30, 2026
SAMPLING TIME : 11:20 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MARCH 30, 2026
ANALYTICAL DATE : MARCH 30-APRIL 7, 2026
ISSUE DATE : APRIL 8, 2026
REPORT NO. : 2026-U027304
WORK NO. : 2025-000405
ANALYSIS NO. : T26AG696-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AG696-0001	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	8.6 (29.7°C)	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	242	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	185	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	442	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	120	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	17	-	3
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MARCH 30, 2026
SAMPLING TIME : 11:20 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : MARCH 30, 2026
ANALYTICAL DATE : MARCH 30-APRIL 7, 2026
ISSUE DATE : APRIL 9, 2026
REPORT NO. : 2026-U027639
WORK NO. : 2025-001734
ANALYSIS NO. : T26AG697-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AG697-0001	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	30.0	0.1
MICROBIOLOGY				
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	1.8
SAMPLE CONDITION				
WATER'S COLOUR/TURBID			YELLOW/TURBID	
SEDIMENT			BROWN	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MARCH 30, 2026
SAMPLING TIME : 11:00 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MARCH 30, 2026
ANALYTICAL DATE : MARCH 30-APRIL 7, 2026
ISSUE DATE : APRIL 8, 2026
REPORT NO. : 2026-U027310
WORK NO. : 2025-000405
ANALYSIS NO. : T26AG696-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AG696-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	6.7 (30.4°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	16.5	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	17.8	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	404	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	27.2	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MARCH 30, 2026
SAMPLING TIME : 11:00 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : MARCH 30, 2026
ANALYTICAL DATE : MARCH 30-APRIL 7, 2026
ISSUE DATE : APRIL 9, 2026
REPORT NO. : 2026-U027641
WORK NO. : 2025-001734
ANALYSIS NO. : T26AG697-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AG697-0003	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	< 0.1	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	160,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	92,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MARCH 30, 2026
SAMPLING TIME : 10:50 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MARCH 30, 2026
ANALYTICAL DATE : MARCH 30-APRIL 7, 2026
ISSUE DATE : APRIL 8, 2026
REPORT NO. : 2026-U027306
WORK NO. : 2025-000405
ANALYSIS NO. : T26AG696-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AG696-0002	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H+ B AND 1060 B	6.9 (30.5°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	13.5	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	14.2	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	365	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	26.0	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MARCH 30, 2026
SAMPLING TIME : 10:50 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : MARCH 30, 2026
ANALYTICAL DATE : MARCH 30-APRIL 7, 2026
ISSUE DATE : APRIL 9, 2026
REPORT NO. : 2026-U027640
WORK NO. : 2025-001734
ANALYSIS NO. : T26AG697-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AG697-0002	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	< 0.1	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	24,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	24,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

SINGHA COMPLEX

ภาคผนวก ค-4

รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง

เดือนเมษายน พ.ศ. 2569

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025 TESTING 0207

LABORATORY ACCREDITATION BLA-DSS TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : APRIL 27, 2026
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : APRIL 27, 2026
ANALYTICAL DATE : APRIL 27-MAY 7, 2026
ISSUE DATE : MAY 7, 2026
REPORT NO. : 2026-U036431
WORK NO. : 2025-000405
ANALYSIS NO. : T26AI833-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AI833-0001	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	8.5 (30.9°C)	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	222	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	148	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	348	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	115	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	12	-	3
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED ISO 14001 Environmental Management CERTIFIED ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : APRIL 27, 2026
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : APRIL 27, 2026
ANALYTICAL DATE : APRIL 27-MAY 6, 2026
ISSUE DATE : MAY 11, 2026
REPORT NO. : 2026-U037210
WORK NO. : 2025-001734
ANALYSIS NO. : T26AI834-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AI834-0001	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	15.0	0.1
MICROBIOLOGY				
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	1.8
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 YELLOW/TURBID BROWN	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : APRIL 27, 2026
SAMPLING TIME : 14:00 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : APRIL 27, 2026
ANALYTICAL DATE : APRIL 27-MAY 7, 2026
ISSUE DATE : MAY 7, 2026
REPORT NO. : 2026-U036435
WORK NO. : 2025-000405
ANALYSIS NO. : T26AI833-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AI833-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H+ B AND 1060 B	7.2 (31.3°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	76.0	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	56.3	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	310	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	29.0	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : APRIL 27, 2026
SAMPLING TIME : 14:00 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : APRIL 27, 2026
ANALYTICAL DATE : APRIL 27-MAY 6, 2026
ISSUE DATE : MAY 11, 2026
REPORT NO. : 2026-U037213
WORK NO. : 2025-001734
ANALYSIS NO. : T26AI834-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AI834-0003	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	1.0	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207
TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : APRIL 27, 2026
SAMPLING TIME : 13:50 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : APRIL 27, 2026
ANALYTICAL DATE : APRIL 27-MAY 7, 2026
ISSUE DATE : MAY 7, 2026
REPORT NO. : 2026-U036432
WORK NO. : 2025-000405
ANALYSIS NO. : T26AI833-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AI833-0002	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	6.9 (31.0°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	40.7	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	37.0	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	294	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	24.0	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.
(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : APRIL 27, 2026
SAMPLING TIME : 13:50 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR RATCHATA THONGPIYAPOOM

RECEIVED DATE : APRIL 27, 2026
ANALYTICAL DATE : APRIL 27-MAY 6, 2026
ISSUE DATE : MAY 11, 2026
REPORT NO. : 2026-U037212
WORK NO. : 2025-001734
ANALYSIS NO. : T26AI834-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AI834-0002	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	0.2	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

SINGHA COMPLEX

ภาคผนวก ค-5

รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง

เดือนพฤษภาคม พ.ศ. 2569

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MAY 27, 2026
SAMPLING TIME : 10:30 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM
RECEIVED DATE : MAY 27, 2026
ANALYTICAL DATE : MAY 27-JUNE 4, 2026
ISSUE DATE : JUNE 8, 2026
REPORT NO. : 2026-U047822
WORK NO. : 2025-000405
ANALYSIS NO. : T26AL549-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AL549-0001	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	8.5 (29.7°C)	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	210	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	283	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	389	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	2.1	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	101	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	18	-	3
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 YELLOW/TURBID BROWN		

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : MAY 27, 2026
SAMPLING TIME : 10:30 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : MAY 27, 2026
ANALYTICAL DATE : MAY 27-JUNE 3, 2026
ISSUE DATE : JUNE 11, 2026
REPORT NO. : 2026-U049096
WORK NO. : 2025-001734
ANALYSIS NO. : T26AL548-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AL548-0001	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	23.0	0.1
MICROBIOLOGY				
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	1.8
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 YELLOW/TURBID BROWN	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MAY 27, 2026
SAMPLING TIME : 11:30 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MAY 27, 2026
ANALYTICAL DATE : MAY 27-JUNE 4, 2026
ISSUE DATE : JUNE 8, 2026
REPORT NO. : 2026-U047824
WORK NO. : 2025-000405
ANALYSIS NO. : T26AL549-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AL549-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H+ B AND 1060 B	7.0 (31.3°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD,(SM: PART 5210 B AND PART 4500-O G)	36.0	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	44.4	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	356	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	39.5	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

bsi ISO 9001 Quality Management Systems CERTIFIED | ISO 14001 Environmental Management CERTIFIED | ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MAY 27, 2026
SAMPLING TIME : 11:30 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : MAY 27, 2026
ANALYTICAL DATE : MAY 27-JUNE 3, 2026
ISSUE DATE : JUNE 11, 2026
REPORT NO. : 2026-U049098
WORK NO. : 2025-001734
ANALYSIS NO. : T26AL548-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AL548-0003	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	0.5	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	160,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	160,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING

SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MAY 27, 2026
SAMPLING TIME : 11:10 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : MAY 27, 2026
ANALYTICAL DATE : MAY 27-JUNE 4, 2026
ISSUE DATE : JUNE 8, 2026
REPORT NO. : 2026-U047823
WORK NO. : 2025-000405
ANALYSIS NO. : T26AL549-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AL549-0002	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	7.1 (31.2°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	33.4	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	27.3	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	362	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	42.7	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : MAY 27, 2026
SAMPLING TIME : 11:10 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS CHATTRAPORN RATCHANET

RECEIVED DATE : MAY 27, 2026
ANALYTICAL DATE : MAY 27-JUNE 3, 2026
ISSUE DATE : JUNE 11, 2026
REPORT NO. : 2026-U049097
WORK NO. : 2025-001734
ANALYSIS NO. : T26AL548-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AL548-0002	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	0.1	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	24,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	24,000	-	1.8
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 YELLOW/CLEAR BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001 Quality Management Systems CERTIFIED
ISO 14001 Environmental Management CERTIFIED
ISO 45001 Occupational Health and Safety Management CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

SINGHA COMPLEX

ภาคผนวก ค-6

รายงานผลการติดตามตรวจสอบคุณภาพน้ำทิ้ง

เดือนมิถุนายน พ.ศ. 2569

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 14:30 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM
RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-30, 2026
ISSUE DATE : JUNE 30, 2026
REPORT NO. : 2026-U057802
WORK NO. : 2025-000405
ANALYSIS NO. : T26AO072-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26AO072-0001	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	8.3 (29.9°C)	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	151	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	190	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	456	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	1.8	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	106	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	15	-	3
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : WASTEWATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 14:30 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-28, 2026
ISSUE DATE : JULY 3, 2026
REPORT NO. : 2026-U058666
WORK NO. : 2025-001734
ANALYSIS NO. : T26A0071-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเสียก่อนการบำบัด T26A0071-0001	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	15.0	0.1
MICROBIOLOGY				
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	>160,000	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	>160,000	1.8
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 YELLOW/TURBID BROWN	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

TESTING
No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 14:10 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-30, 2026
ISSUE DATE : JUNE 30, 2026
REPORT NO. : 2026-U057804
WORK NO. : 2025-000405
ANALYSIS NO. : T26A0072-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26A0072-0003	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H+ B AND 1060 B	7.0 (31.0°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	87.8	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	70.8	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	402	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	19.4	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 14:00 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-28, 2026
ISSUE DATE : JULY 3, 2026
REPORT NO. : 2026-U058667
WORK NO. : 2025-001734
ANALYSIS NO. : T26AO071-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26AO071-0002	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	1.5	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B AND C)	92,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221 B, C AND E)	92,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
TESTING 0207

LABORATORY ACCREDITATION BLA-DSS
TESTING No. 0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 14:00 HOUR
SAMPLING METHOD : GRAB
SAMPLING BY : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS NAPAPORN KHUNNOKKHUM

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-30, 2026
ISSUE DATE : JUNE 30, 2026
REPORT NO. : 2026-U057803
WORK NO. : 2025-000405
ANALYSIS NO. : T26A0072-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งก่อนระบายออกสู่ภายนอกโครงการ T26A0072-0002	REGULATORY STANDARD	DETECTION LIMIT	LIMIT OF QUANTITATION (LOQ)
pH[a]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500-H^+ B AND 1060 B	6.8 (31.3°C)	5.5-9.0	-	-
BIOCHEMICAL OXYGEN DEMAND[a]	mg/L	MEMBRANE ELECTRODE METHOD (SM: PART 5210 B AND PART 4500-O G)	28.0	≤ 20	-	2.0
TOTAL SUSPENDED SOLIDS[a]	mg/L	TOTAL SUSPENDED SOLIDS DRIED FROM 103 TO 105 °C (SM: PART 2540 D)	38.5	≤ 30	-	5.0
TOTAL DISSOLVED SOLIDS[b]	mg/L	TOTAL DISSOLVED SOLIDS DRIED AT 180 °C (SM: PART 2540 C)	409	≤ 1,000	-	25
SULPHIDE[b]	mg/L	IODOMETRIC METHOD (SM: PART 4500-S^{2-} F)	< 0.50	≤ 1.0	-	0.50
TOTAL KJELDAHL NITROGEN[b]	mg/L	IN-HOUSE METHOD: UAE.TP.WAS.001 (KJELDAHL METHOD); SM: PART 4500-Norg C	15.8	≤ 35	1.5	5.0
OIL AND GREASE[a]	mg/L	LIQUID-LIQUID, PARTITION-GRAVIMETRIC METHOD (SM: PART 5520 B)	< 3	≤ 20	-	3
SAMPLE CONDITION						
WATER'S COLOUR/TURBID			YELLOW/TURBID			
SEDIMENT			BROWN			

[a] : ISO/IEC 17025 ACCREDITED BY THAI INDUSTRIAL STANDARDS INSTITUTE (TISI)
[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Wilailak Srisuk.

(MISS WILAILAK SRISUK)
LABORATORY SUPERVISOR

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : EFFLUENT
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 14:10 HOUR
SAMPLING METHOD [c] : GRAB, GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-28, 2026
ISSUE DATE : JULY 3, 2026
REPORT NO. : 2026-U058668
WORK NO. : 2025-001734
ANALYSIS NO. : T26AO071-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำทิ้งหลังการบำบัด T26AO071-0003	REGULATORY STANDARD	DETECTION LIMIT
SETTLEABLE SOLIDS[c]	mL/L	IMHOFF CONE (SM: PART 2540 F)	4.0	-	0.1
MICROBIOLOGY					
TOTAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221B AND C)	>160,000	-	1.8
FAECAL COLIFORMS[b]	MPN/100 mL	MULTIPLE-TUBE FERMENTATION TECHNIQUE (SM: PART 9221B, C AND E)	>160,000	-	1.8
SAMPLE CONDITION					
WATER'S COLOUR/TURBID			YELLOW/TURBID		
SEDIMENT			BROWN		

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

REGULATORY STANDARD : RANGE OR MAXIMUM PERMITTED VALUE FOR BUILDING EFFLUENT STANDARDS CLASS A, NOTIFICATION OF THE MINISTRY OF RESOURCES AND ENVIRONMENT, PUBLISHED IN THE ROYAL GOVERNMENT GAZETTE, VOL 141, PART 233 D, DATED AUGUST 27, 2024.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

SINGHA COMPLEX

ภาคผนวก ค-7

รายงานผลการติดตามตรวจสอบคุณภาพน้ำหล่อเย็น

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 13:20 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-26, 2026
ISSUE DATE : JULY 10, 2026
REPORT NO. : 2026-U061602
WORK NO. : 2025-000403
ANALYSIS NO. : T26AO070-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำในถาด T26AO070-0001	DETECTION LIMIT
pH[c]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500 -H^+ B AND 1060 B	8.6 (30.2°C)	-
MICROBIOLOGY				
TOTAL BACTERIA[b]	CFU/mL	STANDARD PLATE COUNT (SM: PART 9215 B)	$2.2x10^5$	1
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 13:30 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-26, 2026
ISSUE DATE : JULY 10, 2026
REPORT NO. : 2026-U061603
WORK NO. : 2025-000403
ANALYSIS NO. : T26AO070-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเติมเข้าระบบ T26AO070-0002	DETECTION LIMIT
pH[c]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500 -H^+ B AND 1060 B	8.0 (31.7°C)	-
MICROBIOLOGY				
TOTAL BACTERIA[b]	CFU/mL	STANDARD PLATE COUNT (SM: PART 9215 B)	8	1
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

TESTING
No.0063

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD [c] : GRAB AND STERILE TECHNIQUE
SAMPLING BY [c] : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MISS JITSAMON NGAMKANA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-26, 2026
ISSUE DATE : JULY 10, 2026
REPORT NO. : 2026-U061604
WORK NO. : 2025-000403
ANALYSIS NO. : T26AO070-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT ท่อน้ำทิ้ง T26AO070-0003	DETECTION LIMIT
pH[c]	-	ELECTROMETRIC METHOD (AT SITE) SM: PART 4500 -H^+ B AND 1060 B	8.4 (29.6°C)	-
MICROBIOLOGY				
TOTAL BACTERIA[b]	CFU/mL	STANDARD PLATE COUNT (SM: PART 9215 B)	2.0×10^5	1
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

[b] : ISO/IEC 17025 ACCREDITED BY DEPARTMENT OF SCIENCE SERVICE (DSS)
[c] : VERIFIED BY OWN LABORATORY QUALITY SYSTEM, BUT NOT IN SCOPE OF ACCREDITATION

SM : STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER, APHA, AWWA, WEF, 24 th EDITION, 2023.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 13:20 HOUR
SAMPLING METHOD * : STERILE TECHNIQUE
SAMPLING BY * : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR THEERAWAT BOONBUA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-29, 2026
ISSUE DATE : JULY 10, 2026
REPORT NO. : 2026-U061605
WORK NO. : 2025-000403
ANALYSIS NO. : T26AO070-0001

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำในถาด T26AO070-0001	DETECTION LIMIT
MICROBIOLOGY				
Legionella spp.	CFU/L	ISO 11731:2017-05 (E)	NOT DETECTED	100
SAMPLE CONDITION				
WATER'S COLOUR/TURBID			COLOURLESS/CLEAR	
SEDIMENT			-	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

Chaweewan B.
(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 13:30 HOUR
SAMPLING METHOD * : STERILE TECHNIQUE
SAMPLING BY * : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR THEERAWAT BOONBUA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-29, 2026
ISSUE DATE : JULY 10, 2026
REPORT NO. : 2026-U061606
WORK NO. : 2025-000403
ANALYSIS NO. : T26AO070-0002

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT น้ำเติมเข้าระบบ T26AO070-0002	DETECTION LIMIT
MICROBIOLOGY				
Legionella spp.	CFU/L	ISO 11731:2017-05 (E)	NOT DETECTED	100
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

ISO/IEC 17025
Accreditation No. 1349/65

ANALYSIS REPORT

CUSTOMER NAME : SINGHA PROPERTY DEVELOPMENT CO., LTD.
ADDRESS : 1788 SINGHA COMPLEX, 14TH FLOOR NEW PHETCHABURI RD. BANG KAPI HUAI KHWANG BANGKOK 10310
CONTACT INFORMATION : TEL : 08 1560 5406 e-mail : pruchaya.p@singhaestate.co.th
SAMPLING SOURCE : SINGHA COMPLEX BUILDING
SAMPLE TYPE : COOLING WATER
SAMPLING DATE : JUNE 22, 2026
SAMPLING TIME : 13:40 HOUR
SAMPLING METHOD * : STERILE TECHNIQUE
SAMPLING BY * : MR SITTHIPOL PROMPOCHENBOON
ANALYZED BY : MR THEERAWAT BOONBUA

RECEIVED DATE : JUNE 22, 2026
ANALYTICAL DATE : JUNE 22-29, 2026
ISSUE DATE : JULY 10, 2026
REPORT NO. : 2026-U061607
WORK NO. : 2025-000403
ANALYSIS NO. : T26AO070-0003

PARAMETER	UNIT	METHOD OF ANALYSIS	RESULT ท่อน้ำทิ้ง T26AO070-0003	DETECTION LIMIT
MICROBIOLOGY				
Legionella spp.	CFU/L	ISO 11731:2017-05 (E)	NOT DETECTED	100
SAMPLE CONDITION WATER'S COLOUR/TURBID SEDIMENT			 COLOURLESS/CLEAR -	

THE LABORATORY HAS BEEN ACCEPTED AS AN ACCREDITED LABORATORY COMPLYING WITH THE ISO/IEC 17025.

* : TEST METHOD ARE NOT COVERED COMPLYING WITH THE ISO/IEC 17025, VERIFIED BY OWN LABORATORY QUALITY SYSTEM.

Chaweewan B.

(MISS CHAWEEWAN BOONLA)
LABORATORY SUPERVISOR

ISO 9001:2015 CERTIFIED
ISO 14001:2015 CERTIFIED
ISO 45001:2018 CERTIFIED

• PROHIBITED TO PARTIALLY COPY ANALYSIS REPORT PRIOR TO WRITTEN PERMISSION BY THE LABORATORY.
• THIS ANALYSIS REPORT APPROVES ONLY FOR THE SAMPLES AS RECEIVED.

- End of Analysis Report -

ภาคผนวก ง
กฎหมายที่เกี่ยวข้อง

ง-1 ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด ลงวันที่ 7 พฤศจิกายน 2548 ประกาศในราชกิจจานุเบกษา เล่มที่ 122 ตอนที่ 125ง วันที่ 29 ธันวาคม 2548 (อาคารประเภท ก)

ง-2 ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด พ.ศ. 2567 ประกาศในราชกิจจานุเบกษา เล่ม 141 ตอนพิเศษ 233ง ลงวันที่ 27 สิงหาคม พ.ศ. 2568 (อาคารประเภท ก)

ง-3 ประกาศกรมอนามัย เรื่อง ข้อปฏิบัติการควบคุมเชื้อลิจีโอเนลลาในหอผึ่งเย็นของอาคารในประเทศไทย

SINGHA COMPLEX

ภาคผนวก ง-1

ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม
เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภท
และบางขนาด ลงวันที่ 7 พฤศจิกายน 2548 ประกาศในราชกิจจานุเบกษา
เล่มที่ 122 ตอนที่ 125ง วันที่ 29 ธันวาคม 2548 (อาคารประเภท ก)

ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด

โดยที่ได้มีการปฏิรูประบบราชการโดยให้มีการจัดตั้งกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อมขึ้นมา และให้โอนภารกิจของกระทรวงวิทยาศาสตร์ เทคโนโลยีและสิ่งแวดล้อม ในส่วนที่เกี่ยวข้องกับพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. ๒๕๓๕ ไปเป็นของกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม ประกอบกับเป็นการสมควรให้คณะกรรมการควบคุมมลพิษเป็นผู้พิจารณาเห็นชอบกับวิธีการตรวจหาค่ามาตรฐานการระบายน้ำทิ้ง นอกเหนือจากวิธีการที่กำหนดไว้แทนกรมควบคุมมลพิษ จึงสมควรแก้ไขปรับปรุงประกาศกระทรวงวิทยาศาสตร์ เทคโนโลยีและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด

อาศัยอำนาจตามความในมาตรา ๕๕ แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. ๒๕๓๕ แก้ไขโดยมาตรา ๑๑๔ แห่งพระราชกฤษฎีกาแก้ไขบทบัญญัติให้สอดคล้องกับการโอนอำนาจหน้าที่ของส่วนราชการ ให้เป็นไปตามพระราชบัญญัติปรับปรุงกระทรวง ทบวง กรม พ.ศ. ๒๕๔๕ พ.ศ. ๒๕๔๕ อันเป็นพระราชบัญญัติที่มีบทบัญญัติบางประการเกี่ยวกับการจำกัดสิทธิและเสรีภาพของบุคคล ซึ่งมาตรา ๒๙ ประกอบกับมาตรา ๓๕ มาตรา ๔๘ มาตรา ๕๐ และมาตรา ๕๑ ของรัฐธรรมนูญแห่งราชอาณาจักรไทยบัญญัติให้กระทำได้ โดยอาศัยอำนาจตามบทบัญญัติแห่งกฎหมายรัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม โดยคำแนะนำของคณะกรรมการควบคุมมลพิษและโดยความเห็นชอบของคณะกรรมการสิ่งแวดล้อมแห่งชาติ จึงออกประกาศไว้ ดังต่อไปนี้

ข้อ ๑ ให้ยกเลิกประกาศกระทรวงวิทยาศาสตร์ เทคโนโลยีและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด ลงวันที่ ๑๐ มกราคม พ.ศ. ๒๕๓๗

ข้อ ๒ ในประกาศนี้

“อาคาร” หมายความว่า อาคารที่ก่อสร้างขึ้น ไม่ว่าจะมีลักษณะเป็นอาคารหลังเดียว หรือเป็นกลุ่มของอาคารซึ่งตั้งอยู่ภายในพื้นที่ซึ่งเป็นบริเวณเดียวกัน และไม่ว่าจะมีท่อระบายน้ำท่อเดียว หรือมีหลายท่อที่เชื่อมติดต่อกันระหว่างอาคารหรือไม่ก็ตาม ซึ่งได้แก่

(๑) อาคารชุด ตามกฎหมายว่าด้วยอาคารชุด

(๒) โรงแรม ตามกฎหมายว่าด้วยโรงแรม

(๓) หอพัก ตามกฎหมายว่าด้วยหอพัก

(๔) สถานบริการประเภทสถานอาบน้ำ นวดหรืออบตัว ซึ่งมีผู้ให้บริการแก่ลูกค้า ตามกฎหมายว่าด้วยสถานบริการ

(๕) โรงพยาบาลของทางราชการหรือสถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาล

(๖) อาคารโรงเรียนเอกชน ตามกฎหมายว่าด้วยโรงเรียนเอกชน โรงเรียนของทางราชการ อาคารสถาบันอุดมศึกษาของเอกชน ตามกฎหมายว่าด้วยสถาบันอุดมศึกษาของเอกชนและสถาบันอุดมศึกษาของทางราชการ

(๗) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ หรือองค์การระหว่างประเทศและของเอกชน

(๘) อาคารของศูนย์การค้าหรือห้างสรรพสินค้า

(๙) ตลาด ตามกฎหมายว่าด้วยการสาธารณสุข แต่ไม่รวมถึง ท่าเทียบเรือประมง สะพานปลา หรือกิจการแพปลา

(๑๐) ภัตตาคารหรือร้านอาหาร

“น้ำทิ้ง” หมายความว่า น้ำเสียที่ผ่านระบบบำบัดน้ำเสียแล้วจนเป็นไปตามมาตรฐานควบคุมการระบายน้ำทิ้งตามที่กำหนดไว้ในประกาศนี้

ข้อ ๓ ให้แบ่งประเภทของอาคารตามข้อ ๒ ออกเป็น ๕ ประเภท คือ

(๑) อาคารประเภท ก.

(๒) อาคารประเภท ข.

(๓) อาคารประเภท ค.

(๔) อาคารประเภท ง.

(๕) อาคารประเภท จ.

ข้อ ๔ อาคารประเภท ก. หมายความถึง อาคารดังต่อไปนี้

(๑) อาคารชุดที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๕๐๐ ห้องนอนขึ้นไป

(๒) โรงแรมที่มีจำนวนห้องสำหรับใช้เป็นห้องพักรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๒๐๐ ห้องขึ้นไป

(๓) โรงพยาบาลของทางราชการ รัฐวิสาหกิจหรือสถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาลที่มีเตียงสำหรับผู้ป่วยไว้ค้างคืนรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๓๐ เตียงขึ้นไป

(๔) อาคารโรงเรียนเอกชน โรงเรียนของทางราชการ สถาบันอุดมศึกษาของเอกชน หรือสถาบันอุดมศึกษาของทางราชการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒๕,๐๐๐ ตารางเมตรขึ้นไป

(๕) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ องค์การระหว่างประเทศ หรือของเอกชนที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕๕,๐๐๐ ตารางเมตรขึ้นไป

(๖) อาคารของศูนย์การค้าหรือห้างสรรพสินค้าที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒๕,๐๐๐ ตารางเมตรขึ้นไป

(๗) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒,๕๐๐ ตารางเมตรขึ้นไป

(๘) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๒,๕๐๐ ตารางเมตรขึ้นไป

ข้อ ๕ อาคารประเภท ข. หมายความถึง อาคารดังต่อไปนี้

(๑) อาคารชุดที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๑๐๐ ห้องนอน แต่ไม่ถึง ๕๐๐ ห้องนอน

(๒) โรงแรมที่มีจำนวนห้องสำหรับใช้เป็นห้องพักรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๖๐ ห้อง แต่ไม่ถึง ๒๐๐ ห้อง

(๓) หอพักที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๒๕๐ ห้องขึ้นไป

(๔) สถานบริการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตรขึ้นไป

(๕) โรงพยาบาลของทางราชการ รัฐวิสาหกิจ หรือสถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาลที่มีเตียงสำหรับผู้ป่วยไว้ค้างคืนรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑๐ เตียง แต่ไม่ถึง ๓๐ เตียง

(๖) อาคารโรงเรียนเอกชน โรงเรียนของทางราชการ สถาบันอุดมศึกษาของเอกชน หรือสถาบันอุดมศึกษาของทางราชการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตร แต่ไม่ถึง ๒๕,๐๐๐ ตารางเมตร

(๗) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ องค์การระหว่างประเทศ หรือของเอกชน ที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑๐,๐๐๐ ตารางเมตร แต่ไม่ถึง ๕๕,๐๐๐ ตารางเมตร

(๘) อาคารของศูนย์การค้าหรือห้างสรรพสินค้าที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตร แต่ไม่ถึง ๒๕,๐๐๐ ตารางเมตร

(๙) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑,๕๐๐ ตารางเมตร แต่ไม่ถึง ๒,๕๐๐ ตารางเมตร

(๑๐) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคาร ตั้งแต่ ๕๐๐ ตารางเมตร แต่ไม่ถึง ๒,๕๐๐ ตารางเมตร

ข้อ ๖ อาคารประเภท ค. หมายความถึง อาคารดังต่อไปนี้

(๑) อาคารชุดที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคาร ไม่ถึง ๑๐๐ ห้องนอน

(๒) โรงแรมที่มีจำนวนห้องสำหรับใช้เป็นห้องพักรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคาร ไม่ถึง ๖๐ ห้อง

(๓) หอพักที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคาร ตั้งแต่ ๕๐ ห้อง แต่ไม่ถึง ๒๕๐ ห้อง

(๔) สถานบริการที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๑,๐๐๐ ตารางเมตร แต่ไม่ถึง ๕,๐๐๐ ตารางเมตร

(๕) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ องค์การระหว่างประเทศ หรือของเอกชน ที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๕,๐๐๐ ตารางเมตร แต่ไม่ถึง ๑๐,๐๐๐ ตารางเมตร

(๖) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคารหรือกลุ่มของอาคารตั้งแต่ ๑,๐๐๐ ตารางเมตร แต่ไม่ถึง ๑,๕๐๐ ตารางเมตร

(๗) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคาร ตั้งแต่ ๒๕๐ ตารางเมตร แต่ไม่ถึง ๕๐๐ ตารางเมตร

ข้อ ๗ อาคารประเภท ง. หมายความถึง อาคารดังต่อไปนี้

(๑) หอพักที่มีจำนวนห้องสำหรับใช้เป็นที่อยู่อาศัยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคาร ตั้งแต่ ๑๐ ห้อง แต่ไม่ถึง ๕๐ ห้อง

(๒) ตลาดที่มีพื้นที่ใช้สอยรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคารตั้งแต่ ๕๐๐ ตารางเมตร แต่ไม่ถึง ๑,๐๐๐ ตารางเมตร

(๓) ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นของอาคาร หรือกลุ่มของอาคาร ตั้งแต่ ๑๐๐ ตารางเมตร แต่ไม่ถึง ๒๕๐ ตารางเมตร

ข้อ ๘ อาคารประเภท จ. หมายความถึง ภัตตาคารหรือร้านอาหารที่มีพื้นที่ให้บริการรวมกันทุกชั้นไม่ถึง ๑๐๐ ตารางเมตร

ข้อ ๙ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ก. ต้องมีค่าดังต่อไปนี้

(๑) ความเป็นกรดและด่าง (PH) ต้องมีค่าระหว่าง ๕-๙

(๒) บีโอดี (BOD) ต้องมีค่าไม่เกิน ๒๐ มิลลิกรัมต่อลิตร

(๓) สารแขวนลอย (Suspended Solids) ต้องมีค่าไม่เกิน ๓๐ มิลลิกรัมต่อลิตร

(๔) ซัลไฟด์ (Sulfide) ต้องมีค่าไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร

(๕) สารที่ละลายได้ทั้งหมด (Total Dissolved Solids) ต้องมีค่าเพิ่มขึ้นจากปริมาณสารละลายในน้ำใช้ตามปกติไม่เกิน ๕๐๐ มิลลิกรัมต่อลิตร

(๖) ตะกอนหนัก (Settleable Solids) ต้องมีค่าไม่เกิน ๐.๕ มิลลิลิตรต่อลิตร

(๗) น้ำมันและไขมัน (Fat Oil and Grease) ต้องมีค่าไม่เกิน ๒๐ มิลลิกรัมต่อลิตร

(๘) ทีเคเอ็น (TKN) ต้องมีค่าไม่เกิน ๓๕ มิลลิกรัมต่อลิตร

ข้อ ๑๐ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ข. ต้องเป็นไปตามข้อ ๙ เว้นแต่

(๑) บีโอดี ต้องมีค่าไม่เกิน ๓๐ มิลลิกรัมต่อลิตร

(๒) สารแขวนลอย ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

ข้อ ๑๑ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ค. ต้องเป็นไปตามข้อ ๙ เว้นแต่

(๑) บีโอดี ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

(๒) สารแขวนลอย ต้องมีค่าไม่เกิน ๕๐ มิลลิกรัมต่อลิตร

(๓) ซัลไฟด์ ต้องมีค่าไม่เกิน ๓.๐ มิลลิกรัมต่อลิตร

(๔) ค่าทีเคเอ็น ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

ข้อ ๑๒ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท ง. ต้องเป็นไปตามข้อ ๙ เว้นแต่

(๑) บีโอดี ต้องมีค่าไม่เกิน ๕๐ มิลลิกรัมต่อลิตร

(๒) สารแขวนลอย ต้องมีค่าไม่เกิน ๕๐ มิลลิกรัมต่อลิตร

(๓) ซัลไฟด์ ต้องมีค่าไม่เกิน ๔.๐ มิลลิกรัมต่อลิตร

(๔) ค่าทีเคเอ็น ต้องมีค่าไม่เกิน ๔๐ มิลลิกรัมต่อลิตร

ข้อ ๑๓ มาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ประเภท จ. ต้องมีค่าดังต่อไปนี้

(๑) ความเป็นกรดและด่างต้องมีค่าระหว่าง ๕-๙

(๒) บีโอดี ต้องมีค่าไม่เกิน ๒๐๐ มิลลิกรัมต่อลิตร

(๓) สารแขวนลอย ต้องมีค่าไม่เกิน ๖๐ มิลลิกรัมต่อลิตร

(๔) น้ำมันและไขมัน ต้องมีค่าไม่เกิน ๑๐๐ มิลลิกรัมต่อลิตร

ข้อ ๑๔ การตรวจสอบมาตรฐานการระบายน้ำทิ้งจากอาคาร ให้ใช้วิธีการดังต่อไปนี้

(๑) การตรวจสอบค่าความเป็นกรดและด่างให้กระทำโดยใช้เครื่องวัดความเป็นกรดและด่างของน้ำ (PH Meter)

(๒) การตรวจสอบค่าบีโอดีให้กระทำโดยใช้วิธีการอะไซด์โมดิฟิเคชั่น (Azide Modification) ที่อุณหภูมิ ๒๐ องศาเซลเซียส เป็นเวลา ๕ วัน ติดต่อกันหรือวิธีการอื่นที่คณะกรรมการควบคุมมลพิษให้ความเห็นชอบ

(๓) การตรวจสอบค่าสารแขวนลอยให้กระทำโดยใช้วิธีการกรองผ่านกระดาษกรองใยแก้ว (Glass Fibre Filter Disc)

(๔) การตรวจสอบค่าซัลไฟด์ให้กระทำโดยใช้วิธีการไตเตรท (Titrate)

(๕) การตรวจสอบค่าสารที่ละลายได้ทั้งหมดให้กระทำโดยใช้วิธีการระเหยแห้งระหว่างอุณหภูมิ ๑๐๓ องศาเซลเซียส ถึงอุณหภูมิ ๑๐๕ องศาเซลเซียส ในเวลา ๑ ชั่วโมง

(๖) การตรวจสอบค่าตะกอนหนักให้กระทำโดยใช้วิธีการกรวยอิมฮอฟฟ์ (Imhoff cone) ขนาดบรรจุ ๑,๐๐๐ ลูกบาศก์เซนติเมตร ในเวลา ๑ ชั่วโมง

(๗) การตรวจสอบค่าน้ำมันและไขมันให้กระทำโดยใช้วิธีการสกัดด้วยตัวทำละลาย แล้วแยกหาน้ำหนักของน้ำมันและไขมัน

(๘) การตรวจสอบค่าทีเคเอ็นให้กระทำโดยใช้วิธีการเจลดาห์ล (Kjeldahl)

ข้อ ๑๕ การคิดคำนวณพื้นที่ใช้สอย จำนวนอาคารและจำนวนห้องของอาคาร หรือกลุ่มของอาคาร ให้เป็นไปตามวิธีการที่คณะกรรมการควบคุมมลพิษกำหนด โดยประกาศในราชกิจจานุเบกษา

ข้อ ๑๖ วิธีการเก็บตัวอย่างน้ำ ความถี่ และระยะเวลาในการเก็บตัวอย่างน้ำ ให้เป็นไปตามที่คณะกรรมการควบคุมมลพิษกำหนด โดยประกาศในราชกิจจานุเบกษา

ข้อ ๑๗ ประกาศนี้ให้ใช้บังคับตั้งแต่วันถัดจากวันประกาศในราชกิจจานุเบกษาเป็นต้นไป

ประกาศ ณ วันที่ ๗ พฤศจิกายน พ.ศ. ๒๕๔๘

ยงยุทธ ติยะไพรัช

รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

SINGHA COMPLEX

ภาคผนวก ง-2

ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม
เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภท
และบางขนาด พ.ศ. 2567 ประกาศในราชกิจจานุเบกษา
เล่ม 141 ตอนพิเศษ 233ง ลงวันที่ 27 สิงหาคม พ.ศ. 2568
(อาคารประเภท ก)

ประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด

พ.ศ. ๒๕๖๗

โดยที่เป็นการสมควรปรับปรุงการกำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคาร ให้เหมาะสมตามความก้าวหน้าในทางวิทยาศาสตร์ เทคโนโลยี และความเปลี่ยนแปลงทางเศรษฐกิจ สังคม ของประเทศ และให้สอดคล้องกับสภาพการณ์ปัจจุบัน

อาศัยอำนาจตามความในมาตรา ๕๕ แห่งพระราชบัญญัติส่งเสริมและรักษาคุณภาพสิ่งแวดล้อมแห่งชาติ พ.ศ. ๒๕๓๕ รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม โดยคำแนะนำของคณะกรรมการควบคุมมลพิษ และโดยความเห็นชอบของคณะกรรมการสิ่งแวดล้อมแห่งชาติ จึงออกประกาศไว้ ดังต่อไปนี้

ข้อ ๑ ให้ยกเลิกประกาศกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม เรื่อง กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารบางประเภทและบางขนาด ฉบับลงวันที่ ๗ พฤศจิกายน พ.ศ. ๒๕๔๘

ข้อ ๒ ในประกาศนี้

“อาคาร” หมายความว่า อาคารที่ก่อสร้างขึ้น ไม่ว่าจะมีลักษณะเป็นอาคารหลังเดียวหรือเป็นกลุ่มของอาคารซึ่งตั้งอยู่ภายในพื้นที่ซึ่งเป็นบริเวณเดียวกัน และไม่ว่าจะมีท่อระบายน้ำท่อเดียวหรือมีหลายท่อที่เชื่อมติดต่อกันระหว่างอาคารหรือไม่ก็ตาม

“น้ำทิ้ง” หมายความว่า น้ำที่เกิดจากกิจกรรมของอาคารที่ระบายหรือจะระบายลงสู่แหล่งน้ำสาธารณะหรือออกสู่สิ่งแวดล้อม

ข้อ ๓ ให้แบ่งอาคาร ออกเป็น ๓ ชนิด คือ

ชนิดที่ ๑ อาคารอยู่อาศัย หมายถึง อาคารที่มีวัตถุประสงค์ให้เป็นที่พักอาศัยของบุคคลทั้งการอยู่อาศัยอย่างถาวรหรือชั่วคราว ได้แก่

(๑) อาคารชุด ตามกฎหมายว่าด้วยอาคารชุด

(๒) หอพัก ตามกฎหมายว่าด้วยหอพัก

(๓) หอพัก ห้องเช่า ห้องแบ่งเช่า หรือกิจการอื่นในทำนองเดียวกันตามกฎหมายว่าด้วยการสาธารณสุข

(๔) สถานรับเลี้ยงเด็ก ตามกฎหมายว่าด้วยคุ้มครองเด็ก

(๕) สถานดูแลผู้สูงอายุหรือผู้มีภาวะพึ่งพิง ตามกฎหมายว่าด้วยสถานประกอบการเพื่อสุขภาพ

(๖) ที่พักอาศัยสำหรับลูกจ้างประเภทกิจกรรมก่อสร้าง ตามกฎหมายว่าการคุ้มครองแรงงาน

ชนิดที่ ๒ อาคารพาณิชย์ หมายถึง อาคารที่ใช้ประโยชน์ในการพาณิชยกรรม หรือบริการธุรกิจอย่างเดียวหรือหลายอย่าง ได้แก่

(๑) โรงแรม ตามกฎหมายว่าด้วยโรงแรม

(๒) ศูนย์การค้าหรือห้างสรรพสินค้า

(๓) ตลาด ตามกฎหมายว่าด้วยการสาธารณสุข

(๔) สถานบริการประเภทสถานอาบน้ำ นวดหรืออบตัว ตามกฎหมายว่าด้วยสถานบริการ

(๕) ภัตตาคารหรือร้านอาหาร

(๖) อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ หรือองค์การระหว่างประเทศและของเอกชน

(๗) อาคารโรงเรียนเอกชน ตามกฎหมายว่าด้วยโรงเรียนเอกชน โรงเรียนของทางราชการ อาคารสถาบันอุดมศึกษาของเอกชน ตามกฎหมายว่าด้วยสถาบันอุดมศึกษาของเอกชนและสถาบันอุดมศึกษาของทางราชการ

ชนิดที่ ๓ อาคารสถานพยาบาล หมายถึง สถานพยาบาล ตามกฎหมายว่าด้วยสถานพยาบาล ประเภทที่รับผู้ป่วยไว้ค้างคืน

ข้อ ๔ ให้แบ่งขนาดของอาคาร ออกเป็น ๔ ประเภท ดังต่อไปนี้

ประเภทอาคาร	หน่วย	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
๑. อาคารอยู่อาศัย					
อาคารชุด	ห้องชุด	ตั้งแต่ ๕๐๐ ขึ้นไป	ตั้งแต่ ๑๐๐ แต่ไม่ถึง ๕๐๐	ไม่ถึง ๑๐๐	-
หอพัก	ห้อง	-	ตั้งแต่ ๒๕๐ ขึ้นไป	ตั้งแต่ ๕๐ แต่ไม่ถึง ๒๕๐	ไม่ถึง ๕๐
หอพัก ห้องเช่า ห้องแบ่งเช่า หรือกิจการอื่นในทำนองเดียวกัน ตามกฎหมายว่าด้วยการสาธารณสุข	ห้อง	-	ตั้งแต่ ๒๕๐ ขึ้นไป	ตั้งแต่ ๕๐ แต่ไม่ถึง ๒๕๐	ไม่ถึง ๕๐
สถานรับเลี้ยงเด็ก	-	-	-	-	ทุกขนาด
สถานดูแลผู้สูงอายุหรือผู้มีภาวะพึ่งพิง	-	-	-	-	ทุกขนาด
ที่พักอาศัยสำหรับลูกจ้างประเภทกิจกรรมก่อสร้าง	-	-	-	-	ทุกขนาด
๒. อาคารพาณิชย์					
โรงแรม	ห้อง	ตั้งแต่ ๒๐๐ ขึ้นไป	ตั้งแต่ ๖๐ แต่ไม่ถึง ๒๐๐	ไม่ถึง ๖๐	-
สถานบริการประเภทสถานอาบน้ำ นวดหรืออบตัว	ตารางเมตร	-	ตั้งแต่ ๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๑,๐๐๐ แต่ไม่ถึง ๕,๐๐๐	ไม่ถึง ๑,๐๐๐
โรงเรียนเอกชน โรงเรียนของทางราชการ สถาบันอุดมศึกษาของเอกชนหรือสถาบันอุดมศึกษาของทางราชการ		ตั้งแต่ ๒๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๒๕,๐๐๐	-	ไม่ถึง ๕,๐๐๐

ประเภทอาคาร	หน่วย	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
อาคารที่ทำการของทางราชการ รัฐวิสาหกิจ หรือองค์การระหว่างประเทศและของเอกชน		ตั้งแต่ ๕๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๑๐,๐๐๐ แต่ไม่ถึง ๕๕,๐๐๐	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๑๐,๐๐๐	ไม่ถึง ๕,๐๐๐
ศูนย์การค้า หรือห้างสรรพสินค้า		ตั้งแต่ ๒๕,๐๐๐ ขึ้นไป	ตั้งแต่ ๕,๐๐๐ แต่ไม่ถึง ๒๕,๐๐๐	-	ไม่ถึง ๕,๐๐๐
ตลาด		ตั้งแต่ ๒,๕๐๐ ขึ้นไป	ตั้งแต่ ๑,๕๐๐ แต่ไม่ถึง ๒,๕๐๐	ตั้งแต่ ๑,๐๐๐ แต่ไม่ถึง ๑,๕๐๐	ไม่ถึง ๑,๐๐๐
ภัตตาคารหรือร้านอาหาร		ตั้งแต่ ๒,๕๐๐ ขึ้นไป	ตั้งแต่ ๕๐๐ แต่ไม่ถึง ๒,๕๐๐	ตั้งแต่ ๒๕๐ แต่ไม่ถึง ๕๐๐	ไม่ถึง ๒๕๐
๓. อาคารสถานพยาบาล	เตียง	ตั้งแต่ ๓๐ ขึ้นไป	ตั้งแต่ ๑๐ แต่ไม่ถึง ๓๐	-	ไม่ถึง ๑๐

ข้อ ๕ กำหนดมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารไว้ ดังต่อไปนี้

พารามิเตอร์	ค่ามาตรฐาน			
	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
๑. ความเป็นกรดและด่าง (pH)	๕.๕ - ๙.๐	๕.๕ - ๙.๐	๕.๕ - ๙.๐	๕.๕ - ๙.๐
๒. บีโอดี (Biochemical Oxygen Demand)	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๓๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร สำหรับอาคารอยู่อาศัย ไม่เกิน ๑๐๐ มิลลิกรัมต่อลิตร สำหรับอาคารพาณิชย์และอาคารสถานพยาบาล
๓. ของแข็งแขวนลอยทั้งหมด (Total Suspended Solids)	ไม่เกิน ๓๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๖๐ มิลลิกรัมต่อลิตร
๔. ของแข็งละลายน้ำทั้งหมด (Total Dissolved Solids)	ไม่เกิน ๑,๐๐๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑,๐๐๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑,๓๐๐ มิลลิกรัมต่อลิตร	-

พารามิเตอร์	ค่ามาตรฐาน			
	อาคาร ประเภท ก.	อาคาร ประเภท ข.	อาคาร ประเภท ค.	อาคาร ประเภท ง.
	สำหรับอาคารอยู่อาศัยและอาคารพาณิชย์	สำหรับอาคารอยู่อาศัยและอาคารพาณิชย์	สำหรับอาคารอยู่อาศัยและอาคารพาณิชย์	
	เพิ่มขึ้นจากปริมาณในน้ำใช้ปกติไม่เกิน ๑,๐๐๐ สำหรับอาคารสถานพยาบาล	เพิ่มขึ้นจากปริมาณในน้ำใช้ปกติไม่เกิน ๑,๐๐๐ สำหรับอาคารสถานพยาบาล	-	-
๕. ซัลไฟด์ (Sulfide)	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	-
๖. ทีเคเอ็น (Total Kjeldahl Nitrogen)	ไม่เกิน ๓๕ มิลลิกรัมต่อลิตร	ไม่เกิน ๓๕ มิลลิกรัมต่อลิตร	ไม่เกิน ๔๐ มิลลิกรัมต่อลิตร	-
๗. น้ำมันและไขมัน (Oil and Grease)	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๒๐ มิลลิกรัมต่อลิตร สำหรับอาคารอยู่อาศัย ไม่เกิน ๕๐ มิลลิกรัมต่อลิตร สำหรับอาคารพาณิชย์และอาคารสถานพยาบาล
๘. แบคทีเรียกลุ่มโคลิฟอร์มทั้งหมด (Total Coliform Bacteria) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๕,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	ไม่เกิน ๕,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	-	-
๙. แบคทีเรียกลุ่มฟีคอลโคลิฟอร์ม (Fecal Coliform Bacteria) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๑,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	ไม่เกิน ๑,๐๐๐ (เอ็มพีเอ็นต่อ ๑๐๐ มิลลิลิตร)	-	-
๑๐. คลอรีนอิสระ (Free Chlorine) (สำหรับอาคารสถานพยาบาล)	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	ไม่เกิน ๑.๐ มิลลิกรัมต่อลิตร	-	-

ข้อ ๖ การตรวจสอบมาตรฐานควบคุมการระบายน้ำทิ้งจากอาคารให้ใช้วิธีการ ดังต่อไปนี้

๖.๑ ความเป็นกรดและด่าง ให้ใช้เครื่องวัดความเป็นกรดและด่างของน้ำ (pH Meter) ที่มีความละเอียดไม่ต่ำกว่า ๐.๑ หน่วย

๖.๒ บีโอดี ให้ใช้วิธีบ่มตัวอย่างที่อุณหภูมิ ๒๐ องศาเซลเซียส เป็นเวลา ๕ วันติดต่อกัน และหาค่าออกซิเจนละลายด้วยวิธีเอไซด์มอดิฟิเคชัน (Azide Modification) หรือวิธีเมมเบรนอิเล็กโทรด (Membrane Electrode) หรือวิธีออปติกคอลโพรบ (Optical Probe)

๖.๓ ของแข็งแขวนลอยทั้งหมด ให้ใช้วิธีกรองผ่านกระดาษกรองใยแก้ว (Glass Fiber Filter) และอบแห้งที่อุณหภูมิ ตั้งแต่ ๑๐๓ ถึง ๑๐๕ องศาเซลเซียส เป็นเวลาอย่างน้อย ๑ ชั่วโมง

๖.๔ ของแข็งละลายน้ำทั้งหมด ให้ใช้วิธีระเหยตัวอย่างที่กรองผ่านกระดาษกรองใยแก้ว (Glass Fiber Filter) และอบแห้งที่อุณหภูมิ ๑๘๐ องศาเซลเซียส เป็นเวลาอย่างน้อย ๑ ชั่วโมง

๖.๕ ซัลไฟด์ ให้ใช้วิธีไอโอโดเมทริก (Iodometric Method) หรือวิธีเมทิลีนบลู (Methylene Blue Method)

๖.๖ ทีเคเอ็น ให้ใช้วิธีเจลดาห์ล (Kjeldahl)

๖.๗ น้ำมันและไขมัน ให้ใช้วิธีสกัดด้วยตัวทำละลายแล้วแยกหาน้ำหนักของน้ำมันและไขมัน

๖.๘ แบคทีเรียกลุ่มโคลิฟอร์มทั้งหมดและแบคทีเรียกลุ่มฟีคอลโคลิฟอร์ม ให้ใช้วิธีมัลติเพิล ทิวบ์ เฟอร์เมนเทชัน เทคนิค (Multiple Tube Fermentation Technique)

๖.๙ คลอรีนอิสระ ให้ใช้วิธีไทเทรต (Titrimetric method) หรือวิธีเทียบสี (Colorimetric method) หรือวิธีไอโอโดเมทริก อิเล็กโทรด (Iodometric Electrode Technique)

ข้อ ๗ การคิดคำนวณขนาดของอาคารตามข้อ ๔ ให้เป็นไปตามวิธีการที่คณะกรรมการควบคุมมลพิษกำหนด โดยประกาศในราชกิจจานุเบกษา

ข้อ ๘ การตรวจสอบค่ามาตรฐานน้ำทิ้งตามข้อ ๖ ต้องเป็นไปตามคู่มือวิเคราะห์น้ำและน้ำเสียของสมาคมวิศวกรรมสิ่งแวดล้อมแห่งประเทศไทย หรือ Standard Methods for the Examination of Water and Wastewater ซึ่ง American Public Health Association, American Water Works Association และ Water Environment Federation ของประเทศสหรัฐอเมริกากำหนดฉบับล่าสุด หรือตามที่คณะกรรมการควบคุมมลพิษประกาศในราชกิจจานุเบกษา

ข้อ ๙ การเก็บตัวอย่างน้ำทิ้งเพื่อการตรวจสอบมาตรฐานควบคุมการระบายน้ำทิ้งตามข้อ ๕ ให้เป็น ดังต่อไปนี้

๙.๑ ให้เก็บในจุดระบายทิ้งลงสู่แหล่งน้ำสาธารณะหรือออกสู่สิ่งแวดล้อมหรือจุดอื่นที่สามารถใช้เป็นตัวแทนของน้ำทิ้งที่ระบายออกจากอาคาร ในกรณีมีการระบายทิ้งหลายจุดให้เก็บทุกจุด

๙.๒ วิธีการเก็บตัวอย่างน้ำทิ้ง ณ จุดเก็บตัวอย่างตามข้อ ๙.๑ ให้เก็บแบบจ้วง (Grab Sampling)

ข้อ ๑๐ ประกาศนี้ให้ใช้บังคับตั้งแต่วันถัดจากวันประกาศในราชกิจจานุเบกษาเป็นต้นไป

ประกาศ ณ วันที่ ๒๘ มิถุนายน พ.ศ. ๒๕๖๗
พลตำรวจเอก พัชรวาท วงษ์สุวรรณ
รัฐมนตรีว่าการกระทรวงทรัพยากรธรรมชาติและสิ่งแวดล้อม

SINGHA COMPLEX

ภาคผนวก ง-3

ประกาศกรมอนามัย เรื่อง ข้อปฏิบัติการควบคุมเชื้อลีจิโอเนลลา
ในหอผึ่งเย็นของอาคารในประเทศไทย



ประกาศกรมอนามัย
เรื่อง ข้อปฏิบัติการควบคุมเชื้อลีจิโอเนลลา
ในหอผึ่งเย็นของอาคารในประเทศไทย

โดยที่เป็นการสมควรกำหนดข้อปฏิบัติสำหรับควบคุมการแพร่ระบาดของเชื้อลีจิโอเนลลาในหอผึ่งเย็นของอาคารเพื่อเป็นประโยชน์ต่อการคุ้มครองสุขภาพอนามัยของประชาชนที่อยู่ในและนอกอาคาร กรมอนามัยจึงออกประกาศกำหนดข้อปฏิบัติการควบคุมเชื้อลีจิโอเนลลาในหอผึ่งเย็นของอาคารในประเทศไทยไว้โดยมีรายละเอียดดังนี้

ส่วนที่ ๑
บทนำ

ข้อ ๑ คำนำ

โรคลีเจียนแนร์ (Legionnaires' disease) เป็นโรคติดเชื้อจากแบคทีเรียในจีนัสลีจิโอเนลลาอย่างเฉียบพลันในทางเดินหายใจส่วนล่าง โดยกลุ่มคนที่มีความเสี่ยงต่อการติดเชื้อหรือเกิดโรคนี้ ได้แก่ ผู้สูงอายุ เช่น ผู้ที่ได้รับการปลูกถ่ายอวัยวะ ผู้ที่มีร่างกายอ่อนแอหรือกำลังอยู่ในระหว่างการรักษาโรคบางชนิด เช่น มะเร็ง เบาหวาน โรคไต และเอ็ชไอวี เป็นต้น ผู้ที่ดื่มสุราหรือสูบบุหรี่จัด และผู้ที่ได้รับการรักษาด้วยยาบางชนิด การติดเชื้อนี้อาจมีอันตรายร้ายแรงถึงขั้นเสียชีวิตได้ โดยโรคนี้มีสาเหตุมาจากการหายใจเอาละอองน้ำที่ปนเปื้อนเชื้อลีจิโอเนลลาซึ่งเจริญเติบโตได้ดีในหอผึ่งเย็นที่ไม่มีการดูแลบำรุงรักษาอย่างถูกต้องเข้าสู่ร่างกาย

ดังนั้น ข้อปฏิบัติการควบคุมเชื้อลีจิโอเนลลาในหอผึ่งเย็นของอาคารนี้ กำหนดขึ้นเพื่อลดอุบัติการณ์และลดความเสี่ยงต่อการระบาดของโรคลีเจียนแนร์ในประเทศไทย เพื่อเป็นแนวทางให้เจ้าหน้าที่ของรัฐ ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารที่ใช้หอผึ่งเย็น และภาคเอกชนที่เกี่ยวข้องกับการให้บริการและการบำรุงรักษาหอผึ่งเย็น ตลอดจนผู้ที่รับผิดชอบในการออกแบบ การปฏิบัติการและการดูแลรักษาอาคารได้ถือปฏิบัติ

ข้อ ๒ วัตถุประสงค์และการบังคับใช้

(๑) ข้อปฏิบัติฉบับนี้จัดทำขึ้นเพื่อเป็นแนวปฏิบัติสำหรับการป้องกันและควบคุมเชื้อลีจิโอเนลลาในหอผึ่งเย็นเพื่อลดการปนเปื้อนและความเสี่ยงต่อการระบาดของโรคลีเจียนแนร์

(๒) ข้อปฏิบัติฉบับนี้ให้ใช้บังคับกับหอผึ่งเย็นทุกชนิดที่ติดตั้งอยู่ในอาคาร

ข้อ ๓ คำนิยามในข้อปฏิบัตินี้มีดังนี้

" ละอองฝอย (Aerosol) " หมายถึง อนุภาคใดๆ ที่มีขนาดเล็กกว่า 10 ไมครอน

" การปรับภาวะอากาศ (Air-conditioning) " หมายถึง การควบคุมอุณหภูมิ ความชื้น การระบายอากาศ และการฟอกอากาศในบริเวณที่ต้องการให้อยู่ในเกณฑ์คุณภาพที่กำหนด

" ช่องดูดอากาศเข้า (Air intake) " หมายถึง ช่องเปิดใด ๆ ที่ดูดอากาศเข้าสู่ระบบส่งลมเย็นในอาคาร

" สาหร่าย (Algae) " หมายถึง พืชน้ำที่มีขนาดเล็กซึ่งต้องการแสงสว่างในการเจริญเติบโต

" สารชีวฆาต (Biocide) " หมายถึง สารเคมีที่มีประสิทธิภาพทำลายจุลินทรีย์หรือสิ่งมีชีวิตขนาดเล็ก

" น้ำที่ระบายออก (Bleed) " หมายถึง น้ำซึ่งถูกระบายออกจากระบบทำความเย็นอย่างช้า ๆ เพื่อควบคุมความเข้มข้นของสารละลายในน้ำ

"สะอาด" หมายถึง ปราศจากกากตะกอน เมือก สาหร่าย รา สนิม ตะกรัน ฝุ่น สิ่งสกปรก และสิ่งแปลกปลอมใด ๆ โดยการตรวจสอบด้วยตาเปล่า

" หอผึ่งเย็น (Cooling tower) " หมายถึง อุปกรณ์ที่ใช้ลดอุณหภูมิของน้ำโดยอาศัยหลักการระเหยความร้อนของละอองน้ำขณะผ่านอากาศ

" สารยับยั้งการกัดกร่อน (Corrosion inhibitors) " ได้แก่ สารเคมีที่ใช้ป้องกัน หรือชลอการกัดกร่อนของโลหะด้านที่สัมผัสกับน้ำ

" ท่อปลายตัน (Deadleg) " หมายถึง ท่อที่มีปลายปิดข้างหนึ่งหรือติดอยู่กับเครื่องอุปกรณ์ต่าง ๆ เช่น ลิ้น ก๊อก มาตร เป็นต้น

" ตัวกระจายสาร (Dispersant) " หมายถึง สารเคมีซึ่งเติมร่วมกับสารเคมีที่ใช้บำบัดน้ำเพื่อทำให้สารอินทรีย์ที่เกาะติดบริเวณพื้นผิวหน้าของโลหะหลุดออกมาและช่วยป้องกันการจับตัวเป็นก้อนของกากตะกอน

" การทำลายเชื้อ " หมายถึง การลดจำนวนจุลินทรีย์โดยใช้สารเคมีหรือวิธีการทางกายภาพ

" ละอองปลิว (Drift) " หมายถึง ละอองน้ำที่ล่องลอยออกจากช่องระบายลมของหอผึ่งเย็น

" อุปกรณ์กำจัดละอองปลิว (Drift eliminator) " หมายถึง แผงดักละอองน้ำที่ล่องลอยออกจากหอผึ่งเย็นทางช่องระบายลม

" ความสกปรก " หมายถึง การปนเปื้อนด้วยสิ่งมีชีวิตหรือการสะสมตะกอนดินบนผิวหน้าของวัตถุที่ใช้ในการถ่ายเทความร้อนอันเป็นสาเหตุให้เกิดการสูญเสียประสิทธิภาพในการทำงานของหอผึ่งเย็น

" ลีจิโอเนลลา (Legionella) " เป็นชื่อจีนัสของแบคทีเรียซึ่งพบได้ในแหล่งน้ำธรรมชาติ และระบบน้ำที่มนุษย์สร้างขึ้น และอาจก่อโรคได้โดยเฉพาะที่พบบ่อยคือ ลีจิโอเนลลา นิวโมฟิลา (*Legionella pneumophila*)

" โรคลีเจียนแนร์ (Legionnaires' disease) " เป็นโรคติดเชื้ออย่างฉับพลันจากแบคทีเรียกลุ่มลีจิโอเนลลา สปีชีส์ ซึ่งส่วนใหญ่เกิดจากลีจิโอเนลลา นิวโมฟิลา มักเกิดในผู้ชายสูงอายุโดยเฉพาะผู้ที่สูบบุหรี่

หรือผู้ที่ภูมิคุ้มกันบกพร่องเนื่องจากเป็นโรคบางชนิดหรือการใช้สารเคมี ทั้งนี้ในระยะแรกจะมีอาการคล้ายไข้หวัดใหญ่ ได้แก่ มีไข้เล็กน้อย ปวดศีรษะ ปวดกล้ามเนื้อและข้อต่อ หมดแรง อ่อนเพลีย และเบื่ออาหาร ต่อมาจะมีอาการคล้ายปอดอักเสบ ได้แก่ มีไข้สูง ไอแห้ง ๆ หรืออาจมีเสมหะ หายใจไม่สะดวก หนาวสั่นและเจ็บหน้าอก

" น้ำที่เติมชดเชย (Make-up water) " หมายถึง น้ำสะอาดที่เติมลงไปในหอผึ่งเย็นเพื่อทดแทนน้ำที่สูญเสียไปจากการระเหย การระบาย การรั่วไหลหรือเป็นละอองปลิว

" การระบาดของโรคลีเจียนแนร์ " หมายถึง การเกิดโรคตั้งแต่ ๑ รายขึ้นไป

" สารยับยั้งตะกรัน (Scale inhibitor) " หมายถึง สารเคมีที่เติมลงในน้ำเพื่อป้องกันการเกิดตะกรัน

" สารกำจัดตะกรัน (Descalants) " หมายถึง สารเคมีที่เติมลงไปในน้ำเพื่อใช้กำจัดตะกรัน

"อาคาร" หมายถึง

(๑) อาคารตามกฎหมายว่าด้วยอาคารชุด

(๒) อาคารกิจการที่เป็นอันตรายต่อสุขภาพตามกฎหมายว่าด้วยการสาธารณสุข

(๓) อาคารโรงพยาบาลของทางราชการหรือสถานพยาบาลตามกฎหมายว่าด้วยสถานพยาบาล

(๔) อาคารโรงงานอุตสาหกรรมตามกฎหมายว่าด้วยโรงงานหรือนิคมอุตสาหกรรม

(๕) อาคารโรงเรียนและสถาบันการศึกษาของทางราชการ และเอกชนตามกฎหมายว่าด้วยโรงเรียนราษฎร์ และกฎหมายว่าด้วยสถาบันอุดมศึกษาของทางราชการ

(๖) อาคารของศูนย์การค้าหรือห้างสรรพสินค้า

(๗) อาคารตามกฎหมายควบคุมอาคารหรือการสาธารณสุข

"พนักงานเจ้าหน้าที่" หมายถึง

(๑) เจ้าพนักงานท้องถิ่นหรือเจ้าพนักงานสาธารณสุข หรือผู้ซึ่งได้รับแต่งตั้งจากเจ้าพนักงานท้องถิ่นตามกฎหมายว่าด้วยการสาธารณสุข

(๒) ผู้ซึ่งรัฐมนตรีว่าการกระทรวงสาธารณสุขแต่งตั้งให้ปฏิบัติการตามกฎหมายสถานพยาบาล

(๓) เจ้าพนักงานสาธารณสุข หรือผู้ซึ่งรัฐมนตรีว่าการกระทรวงสาธารณสุขแต่งตั้งให้เป็นพนักงานเจ้าหน้าที่ปฏิบัติตามกฎหมายโรคติดต่อ

ข้อ ๔ หน้าที่ความรับผิดชอบ

(๑) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารที่มีการติดตั้งหอผึ่งเย็นมีหน้าที่ต้องปฏิบัติการดังต่อไปนี้

(ก) จัดทำแผนหรือโครงการควบคุมป้องกันโรคลีเจียนแนร์ประจำอาคารโดยอย่างน้อยต้องมีองค์ประกอบดังนี้

- การประเมินความเสี่ยงต่อสุขภาพของโรคลีเจียนแนร์จากหอผึ่งเย็นตามแบบฟอร์มรายการตรวจสอบเพื่อประเมินความเสี่ยงต่อการเกิดโรคลีเจียนแนร์ของหอผึ่งเย็นท้ายข้อปฏิบัตินี้

- การตรวจสอบติดตามประสิทธิภาพของโครงการหรือแผนปฏิบัติการ
- การจัดเก็บรวบรวมสถิติ ข้อมูล และจัดทำบันทึกรายละเอียดของกิจกรรมที่ได้ดำเนินการตามโครงการหรือแผนปฏิบัติการทั้งหมด

(ข) จัดให้มีและใช้มาตรการคุ้มครองความปลอดภัยแก่ผู้ควบคุม และบำรุงรักษาหอผึ่งเย็นของอาคารโดยผู้ควบคุมจะต้องผ่านการฝึกอบรมหลักสูตรผู้ควบคุมและบำรุงรักษาหอผึ่งเย็นด้านการป้องกันและควบคุมเชื้อลีจิโอเนลลาที่กรมอนามัยและกรมควบคุมโรคติดต่อร่วมกันกำหนด

(ค) จัดให้มีผู้ควบคุมและบำรุงรักษาหอผึ่งเย็นด้านการป้องกันและควบคุมเชื้อลีจิโอเนลลาที่มีความรู้ความสามารถและมีคุณวุฒิระดับปริญญาตรี ด้านวิทยาศาสตร์สุขาภิบาล อนามัยสิ่งแวดล้อม อาชีวอนามัย สาธารณสุขศาสตร์หรือสาขาอื่นๆ ที่มีประสบการณ์และความรู้ด้านการสาธารณสุข

ในกรณีที่ไม่สามารถจัดหาผู้ควบคุมและบำรุงรักษาหอผึ่งเย็นไว้เป็นการประจำได้ ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคาร อาจมอบหมายให้ บุคคลอื่นหรือผู้รับจ้าง ที่มีความชำนาญประสบการณ์และคุณวุฒิดังกล่าว รวมทั้งผ่านการฝึกอบรมหลักสูตรผู้ควบคุมและบำรุงรักษาหอผึ่งเย็นด้านการป้องกันและควบคุมเชื้อลีจิโอเนลลา เพื่อควบคุมและบำรุงรักษาหอผึ่งเย็นแทนได้

(๒) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารมีหน้าที่ต้องจดทะเบียนระบบผึ่งเย็นทุกระบบของอาคารกับพนักงานเจ้าหน้าที่ตามแบบฟอร์มการจดทะเบียนหอผึ่งเย็นท้ายข้อปฏิบัตินี้

(๓) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องจัดให้มีคู่มือคำแนะนำไว้ประจำระบบปรับภาวะอากาศทุกระบบ โดยคู่มือคำแนะนำอย่างน้อยต้องมีเนื้อหารายละเอียด ดังต่อไปนี้

(ก) แผนผังของระบบปรับภาวะอากาศ

(ข) วิธีการใช้งานของระบบ

(ค) ข้อควรระวังที่จำเป็น ซึ่งระบุวิธีการและความถี่ในการตรวจสอบสภาพของระบบรวมถึงขั้นตอนการปรับปรุงแก้ไขข้อบกพร่องต่าง ๆของระบบ

(ง) รายละเอียดของผู้จำหน่ายอุปกรณ์ระบบปรับภาวะอากาศ ที่อยู่และหมายเลขโทรศัพท์ที่ใช้ติดต่อ

(๔) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องปฏิบัติหรือแก้ไข หรือปรับปรุงให้ถูกต้องตามข้อปฏิบัติฉบับนี้ทุกประการ

ส่วนที่ ๒
หอผึ่งเย็น

ข้อ ๕ การออกแบบ และก่อสร้างหอผึ่งเย็นต้องปฏิบัติดังนี้

(๑) เพื่อทำให้เกิดความเสี่ยงต่อสุขภาพน้อยที่สุดต่อผู้อยู่ในอาคารและประชาชนทั่วไป การติดตั้งระบบผึ่งเย็นของอาคาร ต้องได้รับความเห็นชอบจากผู้อนุญาตตามกฎหมายที่เกี่ยวข้องก่อน

(๒) ระบบผึ่งเย็นควรได้รับการออกแบบ และก่อสร้างในลักษณะช่วยลดการแพร่กระจายของละอองปลิวจากระบบ และช่วยให้เกิดความสะดวก และปลอดภัยต่อการปฏิบัติงานการทำลายเชื้อและการทำความสะอาดเป็นประจำ

(๓) การออกแบบระบบผึ่งเย็น ควรมีลักษณะดังต่อไปนี้

(ก) ง่าย ใช้งานสะดวก ทั้งนี้ให้หลีกเลี่ยงการออกแบบอุปกรณ์ของระบบผึ่งเย็นที่เป็นท่อปลายตัน วง ห่วง และข้องอ

(ข) มีช่องทางเข้าไปบริเวณส่วนต่าง ๆของระบบได้โดยสะดวกเพื่อการตรวจสอบ การเก็บตัวอย่าง การทำความสะอาด การทำลายเชื้อ การซ่อมบำรุงและการปรับปรุงแก้ไข

(๔) หอผึ่งเย็นที่ติดตั้งใหม่หรือได้รับการปรับปรุงแก้ไขใหม่ต้องมีอุปกรณ์ที่จะช่วยลดการเกิดและการกระจายล่องลอยออกมาของละอองปลิว ดังต่อไปนี้

(ก) ระบบจ่ายน้ำภายในหอผึ่งเย็นที่มีการพ่นละอองปลิวออกจากหอผึ่งเย็นน้อยที่สุด

(ข) อุปกรณ์กำจัดละอองปลิวที่มีประสิทธิภาพสูงในการดักละอองปลิว

(ค) ผนังล้อมรอบด้านข้างเหนืออ่างรองรับน้ำในหอผึ่งเย็นเพื่อลดผลกระทบจากแรงลมภายนอกที่จะพัดพาละอองปลิวออกทางด้านข้างของหอผึ่งเย็นได้ โดยผนังดังกล่าวควรทึบแสงเพื่อป้องกันไม่ให้แสงแดดผ่านเข้าไปทำให้เกิดการเจริญเติบโตของสาหร่ายและเชื้ออิสิจิโอเนลลา

(๕) วัสดุที่ใช้ก่อสร้างหอผึ่งเย็นต้องไม่สึกกร่อนง่าย ต้องทนทานต่อสารเคมี เรียบ ไม่มีรูพรุน ทึบแสง และผ่านการทำลายเชื้อแล้ว รวมทั้งต้องไม่เป็นวัสดุที่จะเอื้ออำนวยต่อการเจริญเติบโต และการเพิ่มขยายตัวอย่างรวดเร็วของจุลินทรีย์ต่าง ๆได้

(๖) ระบบระบายน้ำทิ้ง ต้องอยู่ตำแหน่งล่างสุดของอ่างรองรับน้ำในหอผึ่งเย็น เพื่อให้สามารถระบายน้ำทั้งหมดในระบบผึ่งเย็น ได้ง่าย และสะดวก

ข้อ ๖ สถานที่ติดตั้งหอผึ่งเย็น ต้องมีลักษณะดังต่อไปนี้

(๑) ตำแหน่งที่ตั้งหอผึ่งเย็นต้องอยู่ห่างจากบริเวณต่อไปนี้ไม่น้อยกว่า ๕ เมตร โดยวัดจากฐานตั้งหอผึ่งเย็น

(ก) ทางลมเข้า (Air inlets) เพื่อระบาย และหมุนเวียนอากาศในอาคาร

(ข) พื้นที่ที่มีคนอยู่อาศัยและเปิดหน้าต่าง

(ค) ทางเท้า และบริเวณการจราจร

(ง) ที่หรือทางสาธารณะ

(จ) ช่องระบายอากาศทิ้งจากห้องครัว

(ฉ) ระบบส่งลมเย็นหรือบริเวณอื่นๆ ของระบบรวมทั้งช่องดูดอากาศเข้าของอาคารที่อาจมีสารอาหาร เหมาะสำหรับการเจริญเติบโตของเชื้ออิสิจิโอเนลลา

(ช) ถังเก็บกักหรือพักน้ำของอาคาร

ในกรณีที่เป็นอาคารเดิมที่ไม่มีการดัดแปลง รื้อถอนและเปลี่ยนแปลงการใช้อาคารซึ่งไม่สามารถติดตั้งหอผึ่งเย็นให้อยู่ห่างจากบริเวณดังกล่าวในระยะที่กำหนดได้ ต้องจัดให้มีมาตรการป้องกันการแพร่กระจายของละอองปลิวจากหอผึ่งเย็น

(๒) ในการกำหนดตำแหน่งที่ตั้งของหอผึ่งเย็น ต้องคำนึงถึงอิทธิพลจากผลกระทบของอาคารที่อยู่ใกล้เคียงทิศทางของกระแสลม และการพัดกระจายตัวของลมที่อยู่เหนืออาคารเหล่านี้ด้วย รวมทั้งหอผึ่งเย็นต้องติดตั้งอยู่ห่างและอยู่ได้ทิศทางลมจากช่องดูดอากาศเข้าของอาคารด้วย

ข้อ ๗ น้ำที่เติมชดเชย ในระบบหมุนเวียนน้ำต้องเป็นน้ำจากแหล่งน้ำเดียวกับที่ใช้ในหอผึ่งเย็น

ข้อ ๘ การระบายน้ำทิ้งจากหอผึ่งเย็น ต้องปฏิบัติดังต่อไปนี้

(๑) น้ำทิ้งจากหอผึ่งเย็นต้องมีคุณภาพได้มาตรฐานตามกฎหมายว่าด้วยโรงงาน

(๒) น้ำจากท่อส่งน้ำและน้ำทิ้งจากระบบปรับภาวะอากาศหรือระบายอากาศ ต้องระบายทิ้งลงสู่ท่อระบายที่มีอุปกรณ์หรือข้อต่อที่ป้องกันมิให้น้ำทิ้งไหลย้อนกลับเข้าสู่ระบบปรับภาวะอากาศหรือระบายอากาศ

ข้อ ๙ การทดสอบก่อนใช้งาน และการใช้งาน ระบบปรับภาวะอากาศต้องปฏิบัติดังต่อไปนี้

(๑) ระบบปรับภาวะอากาศของอาคารต้องมีคุณลักษณะ และการใช้งานเป็นไปตามกฎหมายว่าด้วยการควบคุมอาคาร

(๒) หอผึ่งเย็นต้องได้รับการทดสอบอย่างเหมาะสมก่อนใช้งาน เพื่อให้มั่นใจว่าสามารถทำงานได้อย่างมีประสิทธิภาพและปลอดภัย

(๓) ระบบปรับภาวะอากาศทั้งหมดภายในอาคารต้องอยู่ในสภาพสะอาดปราศจากสิ่งสกปรกก่อนใช้งาน

(๔) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องจัดให้มีมาตรการควบคุมความเสี่ยงต่อสุขภาพที่อาจเกิดขึ้นในระหว่างดำเนินการทดสอบก่อนใช้งาน การเริ่มต้นใช้งาน และในระหว่างการใช้งานตามปกติของระบบปรับภาวะอากาศ

(๕) การใช้งานหอผึ่งเย็นของอาคารต้องปฏิบัติดังต่อไปนี้

(ก) กรณีที่ใช้งานหอผึ่งเย็นสลับกันเป็นช่วง ๆ อย่างน้อยต้องเปิดใช้งานสัปดาห์ละครั้งและน้ำที่ใช้ในหอผึ่งเย็นต้องผ่านการบำบัด และตรวจสอบคุณภาพแล้ว

(ข) กรณีที่หยุดใช้งานหอผึ่งเย็นนานกว่า ๑ สัปดาห์ น้ำในหอผึ่งเย็นต้องผ่านการบำบัดด้วยสารชีวฆาตทันทีเมื่อมีการใช้งานหอผึ่งเย็นใหม่

(ค) กรณีที่หยุดใช้งานหอผึ่งเย็นนานกว่า ๑ เดือน ต้องระบายน้ำในหอผึ่งเย็นทิ้ง แล้วทำความสะอาด และทำลายเชื้อในหอผึ่งเย็นนั้น อย่างน้อยเดือนละ ๑ ครั้ง

(ง) กรณีที่หยุดใช้งานหอผึ่งเย็น โดยไม่มีกำหนด ต้องระบายน้ำในหอผึ่งเย็นทิ้ง โดยไม่ปล่อยให้มีน้ำขัง

ส่วนที่ ๓
การดูแลบำรุงรักษาและตรวจสอบเฝ้าระวังระบบผึ่งเย็น

ข้อ ๑๐ ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องดำเนินการและบำรุงรักษาระบบผึ่งเย็นดังต่อไปนี้

(๑) ซ่อมแซม ดูแล และบำรุงรักษาหอผึ่งเย็นให้อยู่ในสภาพที่ดีและสะอาดพร้อมที่จะใช้งานได้ตลอดเวลา

(๒) จัดหาคู่มือการบำรุงรักษาประจำระบบผึ่งเย็นทุกระบบ ซึ่งอย่างน้อยต้องประกอบด้วย

(ก) แผนผังโครงสร้างที่สมบูรณ์ของระบบการระบายอากาศและระบบผึ่งเย็น

(ข) วิธีการทำความสะอาด การทำลายเชื้อ และขั้นตอนการกำจัดสิ่งปนเปื้อนพร้อมทั้งคำแนะนำในการรื้อถอดส่วนประกอบ

(ค) วิธีการบำบัดน้ำในหอผึ่งเย็น

(ง) วิธีการปิด - เปิด และเดินเครื่อง

(๓) การบำรุงรักษาระบบผึ่งเย็นเป็นประจำต้องดำเนินการโดยผู้ที่มีความรู้ความสามารถ ความชำนาญและประสบการณ์ในการป้องกันอันตรายที่เกิดขึ้นจากการปฏิบัติงานได้

(๔) ตรวจตราความสะอาด ความสกปรก และกากตะกอนในหอผึ่งเย็นทุกเครื่องสัปดาห์ละครั้งโดยใช้สายตา

(๕) ต้องจัดทำและดำเนินการตามแผนการบำรุงรักษาหอผึ่งเย็นรวมถึงการทำความสะอาดการทำลายเชื้อและการบำบัดน้ำสำหรับหอผึ่งเย็นทุกเครื่อง เพื่อเป็นการป้องกันการเพิ่มจำนวนของเชื้ออิสิจิโอเนลลาและทำให้สารเคมีที่ใช้ในการบำบัดน้ำมีประสิทธิภาพสูงสุด

(๖) อาจนำเครื่องกรองน้ำ แสงอุลตร้าไวโอเลต ก๊าซโอโซนและอื่น ๆ มาใช้ช่วยในการบำรุงรักษาหอผึ่งเย็นได้ แต่ต้องไม่เป็นการนำมาใช้เพื่อทดแทนการทำความสะอาด การทำลายเชื้อและการบำบัดน้ำตามแผนการประจำในข้อ ๑๐(๕)

ข้อ ๑๑ การทำความสะอาดและการทำลายเชื้อ ในระบบผึ่งเย็นของอาคารต้องปฏิบัติ ดังนี้

(๑) การทำลายเชื้อ การทำความสะอาดและการกำจัดตะกอนในหอผึ่งเย็นโดยปกติทั่วไปต้องกระทำอย่างน้อย ๑ ครั้งภายใน ๖ เดือนหรือมากกว่าเมื่อจำเป็น

(๒) การทำความสะอาดและการทำลายเชื้อต้องกระทำในหอผึ่งเย็นที่มีสภาพ ดังต่อไปนี้

(ก) มีการปนเปื้อนในระหว่างการก่อสร้างจากฝุ่นหรือสารอินทรีย์ต่าง ๆ

(ข) หยุดใช้งานมานานกว่า ๑ เดือน

(ค) ถูกดัดแปลงแก้ไขทางกลไกหรือถอดชิ้นส่วนออกในลักษณะที่อาจทำให้หอผึ่งเย็นได้รับการปนเปื้อนได้

(ง) เมื่อสภาพแวดล้อมรอบหอผึ่งเย็นเต็มไปด้วยฝุ่นหรือไม่สามารถควบคุมคุณภาพน้ำได้หรือเมื่อหอผึ่งเย็นที่อยู่ใกล้เคียงกันเป็นแหล่งการระบาดของโรคลีเจียนแนร์

(จ) อื่นๆ ตามที่พนักงานเจ้าหน้าที่เห็นควร

(๓) ระบบเก็บกักน้ำพิเศษซึ่งต่อเชื่อมกับระบบผึ่งเย็น และมีลักษณะน้ำขังนิ่ง ต้องได้รับการทำความสะอาดและฆ่าเชื้อก่อนนำมาใช้งานในสภาพปกติ

(๔) การทำความสะอาดและทำลายเชื้อ ต้องปฏิบัติ ดังนี้

(ก) เติมคลอรีนครั้งแรกในน้ำในระบบผึ่งเย็นเพื่อให้มีคลอรีนอิสระตกค้าง (residual free chlorine) อยู่ในระดับ ๕ มิลลิกรัมต่อลิตร เพื่อลดความเสี่ยงต่อสุขภาพกับผู้ทำความสะอาด แล้วทำการหมุนเวียนน้ำพร้อม ๆ กับเติมตัวกระจายสารเพื่อเพิ่มประสิทธิภาพในการทำลายเชื้อโรคของคลอรีน โดยหมุนเวียนน้ำเป็นระยะเวลา ๖ ชั่วโมง ทำการรักษาปริมาณคลอรีนอิสระให้อยู่ในระดับไม่น้อยกว่า ๕ มิลลิกรัมต่อลิตรตลอดเวลา

ถ้าในกรณีที่ค่าความเป็นกรดด่าง (pH) ของน้ำมากกว่า ๘.๐ ปริมาณความเข้มข้นของคลอรีนอิสระตกค้างที่วัดได้ต้องอยู่ระหว่าง ๑๕ ถึง ๒๐ มิลลิกรัมต่อลิตรเป็นเวลา ๒ ชั่วโมง หรือใช้วิธีการระบายน้ำออกจากระบบอย่างเต็มที่เป็นเวลาหลาย ๆ ชั่วโมง เพื่อลดค่าความเป็นกรดด่างและปริมาณคลอรีนในระบบลง

(ข) ระบายน้ำทิ้งออกจากเส้นท่อและทำความสะอาดระบบจ่ายน้ำ บ่อสูบน้ำและหอผึ่งเย็นทำการล้างบริเวณหอรกทึบที่จะเข้าไปยังหอผึ่งเย็นและอุปกรณ์ต่าง ๆ สำหรับตะกรันและตะกอนอื่น ๆ ที่ไม่สามารถกำจัดออกไปได้ให้ใช้สารเคมีสำหรับกำจัดตะกรันที่ไม่ทำให้เกิดความเสียหายแก่หอผึ่งเย็นและเส้นท่อ

ให้หลีกเลี่ยงวิธีทำความสะอาดที่ก่อให้เกิดละอองน้ำล่องลอยมากเกินไป เช่น ระบบฉีดน้ำแรงดันสูง เป็นต้น หากไม่สามารถหลีกเลี่ยงได้ให้ปิดประตู หน้าต่าง และช่องลมที่อยู่ใกล้เคียงให้สนิทก่อนการทำความสะอาด

ผู้ที่ต้องฉีดน้ำด้วยระบบแรงดันสูงต้องได้รับการฝึกอบรมและต้องสวมอุปกรณ์ป้องกันอันตรายส่วนบุคคลตามข้อ ๑๙(๒) ในขณะปฏิบัติงานทุกครั้ง

(๕) เติมน้ำสะอาดและคลอรีนซ้ำเพื่อให้ระดับคลอรีนอิสระตกค้างไม่น้อยกว่า ๕ มิลลิกรัมต่อลิตร เป็นเวลา ๖ ชั่วโมง

(๖) ระบายและถ่ายเทน้ำทิ้ง แล้วเปลี่ยนถ่ายเติมน้ำสะอาด สารเคมีและสารชีวฆาตที่ใช้ในการบำบัดคุณภาพน้ำให้อยู่ในระดับเหมาะสมก่อนเปิดเดินเครื่องระบบ

(๗) ในระหว่างการทำความสะอาดและการทำลายเชื้อ ควรปิดพัดลมของหอผึ่งเย็นทุกครั้ง

(๘) โดยทั่วไปน้ำในหอผึ่งเย็นต้องมีปริมาณความเข้มข้นของคลอรีนอิสระตกค้างไม่น้อยกว่า ๑.๐ มิลลิกรัมต่อลิตรตลอดเวลา

ข้อ ๑๒ การบำบัดน้ำ ในระบบผึ่งเย็นของอาคารต้องปฏิบัติดังต่อไปนี้

(๑) เพื่อควบคุมเชื้อลิจิโอเนลลากรรมวิธีการบำบัดน้ำต้องลดหรือป้องกันการเกิดขึ้นของสิ่งต่าง ๆ ในระบบผึ่งเย็นดังต่อไปนี้

(ก) ตะกรัน และสิ่งที่เป็นผลผลิตจากการกัดกร่อน ซึ่งอาจจะเป็นแหล่งอาศัยและคุ้มครองเชื้อลิจิโอเนลลาในระบบ

(ข) ตะกอนซึ่งอาจไปลดประสิทธิภาพกรรมวิธีการบำบัดน้ำ

(ค) แบคทีเรียและจุลินทรีย์อื่น ๆ

(๒) ใช้สารชีวฆาตเพื่อควบคุมการเจริญเติบโตของตะไคร่ และสาหร่าย สำหรับกรณีที่มีการเจริญเติบโตของตะไคร่และสาหร่ายอย่างรวดเร็ว ให้ใช้สารทำความสะอาดที่มีฤทธิ์เป็นด่างกำจัดและทำให้แตกกระจายออกไปแล้วจึงขจัดล้างทำความสะอาดและเติมสารชีวฆาตซ้ำอีกครั้ง

(๓) ในการกำจัดตะกอนเลนอาจใช้ตัวกระจายสาร หรือสารเคมีที่ช่วยให้เกิดการรวมตัวก็ได้

(๔) สารเคมีที่ใช้ในการบำบัดน้ำต้องไม่มีฤทธิ์ที่เป็นผลเสียต่อวัสดุอุปกรณ์ที่เป็นอโทนะที่ใช้ในระบบเส้นท่อ เช่น ยาง และโลหะที่เคลือบสารอีพ็อกซีย์ป้องกันการกัดกร่อนเป็นต้น และต้องเหมาะสมเป็นกลางต่อวัสดุอุปกรณ์ที่ใช้ในงานระบบเส้นท่อ

(๕) การบรรจุ เก็บสะสมและควบคุมดูแลสารเคมีต้องปฏิบัติตามข้อกำหนดของกฎหมายที่เกี่ยวข้อง

ข้อ ๑๓ การใช้สารชีวฆาตต้องปฏิบัติดังต่อไปนี้

(๑) ต้องใช้สารชีวฆาตอย่างน้อย ๒ ชนิด โดยใส่สลับกันสัปดาห์ละครั้ง เพื่อป้องกัน อุบัติการณ์ดื้อสารเคมีของเชื้อจุลินทรีย์

(๒) ก่อนเริ่มดำเนินการบำบัดน้ำด้วยสารชีวฆาตต้องมั่นใจว่าระบบผึ่งเย็นอยู่ในสภาวะที่สะอาด

(๓) การป้องกันการปรับตัวเข้ากับสิ่งแวดล้อมของสิ่งมีชีวิตขนาดเล็ก ในระบบผึ่งเย็นต้องใช้สารชีวฆาตด้วยวิธีการเติมใส่เป็นครั้งๆ แบบไม่ต่อเนื่อง (Shot/Slug dose)และให้รวมถึงการเติมสารชีวฆาตใส่สลับอย่างรองรับน้ำของหอผึ่งเย็นโดยตรงเป็นระยะสลับกันด้วยวิธีแบบเดียวกัน

(๔) สารชีวฆาตที่ใช้ในการกำจัดและควบคุมการเจริญเติบโตของเชื้อลิจิโอเนลลา ต้องมีคุณสมบัติดังนี้

(ก) เป็นผลิตภัณฑ์ที่ได้มาตรฐานและได้รับการจดทะเบียนอย่างถูกต้อง โดยสารเคมีทุกชนิดที่ใช้ในการบำบัดน้ำต้องได้รับอนุญาตให้ใช้และปฏิบัติตามข้อกำหนดของหน่วยงานที่เกี่ยวข้อง

(ข) มีประสิทธิภาพที่เชื่อถือได้ในการทำลายเชื้อลิจิโอเนลลาและเชื้อจุลินทรีย์อื่น ๆ ได้กว้างขวางเมื่อใช้ในปริมาณหรือขนาดตามที่ผู้ผลิตหรือผู้จำหน่ายได้กำหนดหรือแนะนำไว้

(ค) สารชีวฆาตอื่นที่นำมาใช้ต้องมีส่วนช่วยสนับสนุน ให้สารชีวฆาตที่ใช้สำหรับทำลายเชื้อลิจิโอเนลลาทำงานอย่างมีประสิทธิภาพสมบูรณ์ยิ่งขึ้น และช่วยให้ระบบผึ่งเย็นปลอดจากภาวะใด ๆ ทางจุลชีววิทยา

(๑) ไม่รบกวนต่อวิธีการขับสูตรเพื่อจำแนกชนิดและประเภทของเชื้อลิจิโอเนลลา

(จ) เหมาะสมทั้งทางด้านกายภาพและเคมีกับน้ำที่ผ่านกรรมวิธีการบำบัดแล้ว

(๕) สารเคมีที่ใช้และผลิตภัณฑ์สุดท้าย (End-Products) ที่เกิดขึ้นภายหลังจากการบำบัดน้ำต้องสามารถย่อยสลายทางชีวภาพและเคมีได้ โดยก่อให้เกิดอันตรายต่อสุขภาพและสิ่งแวดล้อมน้อยที่สุด สำหรับในกรณีที่มีการระบายหรือเกิดอุบัติเหตุรั่วไหลของสารเคมีหรือผลิตภัณฑ์สุดท้ายลงสู่ระบบบำบัดน้ำ น้ำทิ้งจากระบบต้องผ่านการบำบัดคุณภาพน้ำก่อนระบายลงสู่แหล่งรองรับน้ำสาธารณะ

ข้อ ๑๔ การบันทึกข้อมูล ต้องปฏิบัติดังต่อไปนี้

(๑) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องจัดให้มีการบันทึกในสมุดบันทึกประจำหอผึ่งเย็นทุกเครื่อง พร้อมให้ข้อมูลที่ถูกต้องเพียงพอและสะดวกต่อการตรวจสอบขอดูของพนักงาน เจ้าหน้าที่ตลอดเวลา การบันทึกข้อมูลต้องครอบคลุมรายละเอียด ดังต่อไปนี้

(ก) รายละเอียดเกี่ยวกับหอผึ่งเย็น เช่น ที่ตั้ง แบบ รุ่น และขนาด เป็นต้น

(ข) ชื่อผู้บันทึกและเก็บรักษาสมุดบันทึกข้อมูล

(ค) ชื่อบุคคลหรือบริษัทที่รับผิดชอบในการประเมินความเสี่ยง แผนปฏิบัติการ การจัดมาตรการป้องกันและข้อควรระวัง

(ง) ชื่อบุคคลหรือบริษัทที่ดำเนินการบำบัดน้ำ

(จ) รายละเอียดในการบำรุงรักษา เช่น

- วันที่และผลในการตรวจคราเบื้องต้นโดยสายตา
- วันที่ทำความสะอาดและทำลายเชื้อ

- วันที่ทำการบำบัดน้ำด้วยสารเคมีและสารชีวฆาต
- วันที่ทำการเก็บตัวอย่างเพื่อตรวจสอบเฝ้าระวังคุณภาพน้ำและเชื้อลิจิโอเนลลา รวมทั้งวันที่รายงานผลการตรวจสอบ

(ฉ) รายละเอียดในการปรับปรุงแก้ไข และวันที่เริ่มดำเนินการ

(๒) การบันทึกข้อมูลตามข้อ ๑๔ (๑) ต้องมีลายเซ็นของผู้ปฏิบัติงานหรือผู้ที่รับผิดชอบรับรองกำกับว่าได้มีการดำเนินงานจริง

(๓) สมุดบันทึกต้องเก็บรักษาไว้อย่างน้อย ๒ ปี

ข้อ ๑๕ แผนการดำเนินงานเมื่อเกิดการระบาดของโรคลิเจียนแนร์ในอาคาร ต้องปฏิบัติดังต่อไปนี้

(๑) ถ้าปรากฏว่ามีหรือสงสัยว่าจะมีการระบาดของโรคลิเจียนแนร์เกิดขึ้นผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องแจ้งพนักงานเจ้าหน้าที่ทราบทันที

(๒) ในกรณีที่สงสัยว่ามีการระบาดของโรคลิเจียนแนร์อันเนื่องมาจากหอผึ่งเย็นของอาคารให้พนักงานเจ้าหน้าที่เรียกหรือขอดูเอกสารหรือหลักฐานจากผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือ ผู้ครอบครองอาคาร ดังนี้

(ก) แบบแปลนอาคารที่แสดงรายละเอียดชั้นต่าง ๆ ในอาคาร ที่ตั้งของหอผึ่งเย็น และช่องทางสำหรับอากาศภายนอกระบายเข้าสู่อาคาร

(ข) แผนผังวงจรของหอผึ่งเย็น

(ค) สมุดบันทึกประจำหอผึ่งเย็น

(ง) หอผึ่งเย็นที่สงสัยเป็นต้นเหตุของการระบาดของโรคต้องไม่มีการระบายน้ำทิ้งหรือทำลายเชื้อก่อนพนักงานเจ้าหน้าที่จะดำเนินการเก็บตัวอย่างน้ำส่งตรวจ

(จ) ข้อมูลอื่น ๆ ที่จำเป็นสำหรับการสอบสวนทางวิทยาการระบาด

(๓) เมื่อได้ข้นสูตรแน่ชัดแล้วว่าหอผึ่งเย็นใดเป็นต้นเหตุการระบาดของโรคลิเจียนแนร์ให้พนักงานเจ้าหน้าที่ออกคำสั่งให้ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารทำความสะอาดและทำลายเชื้อทันทีในหอผึ่งเย็นที่เกี่ยวข้องกับการระบาดของโรคตามขั้นตอน ดังนี้

เติมสารคลอรีนหรือสารประกอบคลอรีนลงในน้ำของระบบ เพื่อให้มีคลอรีนอิสระในน้ำอยู่ที่ระดับ ๒๐ - ๕๐ มิลลิกรัมต่อลิตร เป็นเวลานาน ๑ - ๒ ชั่วโมงพร้อมกับเติมตัวกระจายสารทางชีวภาพ (biodispersant) ทันทีหรือในเวลาเดียวกัน

(ก) หมุนเวียนน้ำในระบบโดยปิดพัดลมนานอย่างน้อย ๖ ชั่วโมง และรักษาระดับคลอรีนอิสระให้อยู่ต่ำสุดที่ ๑๐ มิลลิกรัมต่อลิตร คลอดเวลา

(ค) หลังจาก ๖ ชั่วโมงแล้วให้ขจัดคลอรีน (dechlorinate) และระบายน้ำออกจากระบบ

(ง) ทำความสะอาดหอผึ่งเย็น บ่อสูบน้ำ และระบบจ่ายน้ำ ทั้งนี้ผู้ปฏิบัติงาน จะต้องสวมใส่อุปกรณ์ป้องกันอันตรายส่วนบุคคลตามข้อ ๑๙(๒)

(จ) เติมน้ำ สะอาดใส่สารคลอรีนหรือสารประกอบคลอรีน

(ฉ) หมุนเวียนน้ำซึ่งมีคลอรีนอิสระที่ ๕ มิลลิกรัมต่อลิตร อีกครั้งในขณะปิดพัดลมเป็นเวลา ๖ ชั่วโมง หรือ ๑๐ มิลลิกรัมต่อลิตร เป็นเวลา ๑ ชั่วโมง

(ช) ขจัดคลอรีนและระบายน้ำออกจากระบบ

(ซ) เติมและหมุนเวียนน้ำสะอาดอีกครั้งแล้วเก็บตัวอย่างน้ำไปตรวจวิเคราะห์

(ฌ) เปิดใช้งานระบบผึ่งเย็นตามปกติใหม่

(ญ) โดยทั่วไปน้ำในหอผึ่งเย็นต้องมีปริมาณความเข้มข้นของคลอรีนอิสระตกค้างไม่น้อยกว่า ๑.๐ มิลลิกรัมต่อลิตรตลอดเวลา

ข้อ ๑๖ การเก็บตัวอย่างน้ำและการตรวจสอบเฝ้าระวังทางจุลชีววิทยา ต้องปฏิบัติดังต่อไปนี้

(๑) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องจัดให้มีและดำเนินการทดสอบหาเชื้อลิจิโอเนลลา และการตรวจนับแบคทีเรียทั้งหมดตามแผนเป็นประจำ เพื่อตรวจสอบประสิทธิภาพของระบบบำบัดน้ำ โดยให้มีการตรวจวัดทุกๆ ๓ เดือน สำหรับอาคารสถานพยาบาล และตรวจวัดทุกๆ ๖ เดือน สำหรับอาคารอื่นๆ

(๒) การเก็บตัวอย่างน้ำเพื่อการเฝ้าระวังทางจุลชีววิทยา ต้องปฏิบัติดังนี้

(ก) เก็บตัวอย่างน้ำก่อนมีการใช้สารชีวฆาต หรือเก็บตัวอย่างน้ำในขณะที่เปิดเดินเครื่องระบบและมีน้ำไหลเวียนในระบบแล้วอย่างน้อย ๑ ชั่วโมง

(ข) ในกรณีที่มีการทำลายเชื้อจะต้องเก็บตัวอย่างน้ำหลังจากการทำลายเชื้อแล้วไม่น้อยกว่า ๓ วัน

(ค) เก็บรักษาตัวอย่างน้ำไว้ที่อุณหภูมิ ๒-๘ องศาเซลเซียส หรือแช่เย็น และนำส่งเข้าห้องปฏิบัติเพื่อการตรวจวิเคราะห์ทันทีหรืออย่างช้าภายใน ๕ วัน

(ง) เก็บตัวอย่างน้ำ ณ จุดที่น้ำไหลเข้ามาเติมชดเชยในระบบ ในอย่างรองรับน้ำและท่อน้ำทิ้งจากหอผึ่งเย็นแต่ละเครื่องอย่างน้อย ๓ ตัวอย่าง

(๓) ห้องปฏิบัติการเอกชนที่ตรวจวิเคราะห์เชื้อลิจิโอเนลลาต้องได้รับการรับรองจากกรมวิทยาศาสตร์การแพทย์

(๔) ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องจัดส่งรายงานผลการตรวจสอบให้พนักงานเจ้าหน้าที่ หรือกรมอนามัยและกรมควบคุมโรคติดต่อ หน่วยงานละ ๑ ชุด ตามเวลาที่กำหนดใน ๑๖(๑) พร้อมกับข้อมูลที่บันทึกตามรายละเอียดในแบบบันทึกข้อมูลสำหรับการควบคุมเชื้อลิจิโอเนลลาในระบบผึ่งเย็นที่แนบท้ายข้อปฏิบัตินี้

(๕) การตรวจสอบเฝ้าระวังเชื้อลิจิโอเนลลาในหอผึ่งเย็นเป็นประจำต้องเป็นส่วนหนึ่งของแผนปฏิบัติที่ดีด้านการบำรุงรักษา การทำความสะอาด และการติดตามผลอย่างสม่ำเสมอ

ข้อ ๑๗ การแก้ไขการปนเปื้อนจากเชื้อลีจิโอเนลลา ต้องปฏิบัติ ดังต่อไปนี้

(๑) ในกรณีที่ตรวจพบเชื้อลีจิโอเนลลาในระบบผึ่งเย็นให้พนักงานเจ้าหน้าที่ออกหนังสือให้ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารต้องดำเนินการแก้ไขด้วยมาตรการต่างๆ ตามระดับการปนเปื้อนของเชื้อลีจิโอเนลลา ดังนี้

(ก) กรณีตรวจพบเชื้อลีจิโอเนลลา น้อยกว่า ๑๐๐,๐๐๐ ซี เอฟ ยู (Colony Forming Unit) ต่อลิตรให้ถือว่าการใช้มาตรการบำรุงรักษาอย่างเดียวไม่เพียงพอ ต้องแนะนำให้มีการแก้ไขเพิ่มเติมแผนการบำรุงรักษา การตรวจสอบเฝ้าระวังและการติดตามผลของระบบผึ่งเย็นให้ถูกต้องใหม่

(ข) กรณี ตรวจพบเชื้อลีจิโอเนลลา ตั้งแต่ ๑๐๐,๐๐๐ ถึงไม่มากกว่า ๑,๐๐๐,๐๐๐ ซี เอฟ ยู ต่อลิตร ให้ถือว่าอยู่ในสภาวะที่จะมีอันตรายเกิดขึ้นได้ ต้องออกหนังสือสั่งเตือนให้มีการประเมินผลวิธีการบำรุงรักษาใหม่ รวมทั้ง กระบวนการทำลายเชื้อในน้ำที่ใช้อยู่ การแก้ไขให้ถูกต้อง การตรวจสอบเฝ้าระวัง และการติดตามผล

(ค) กรณีตรวจพบเชื้อลีจิโอเนลลา ตั้งแต่ ๑,๐๐๐,๐๐๐ ซี เอฟ ยู ต่อลิตรขึ้นไป ให้ถือว่าอยู่ในสภาวะที่เป็นอันตรายร้ายแรง ต้องออกคำสั่งปิดระบบทันทีเพื่อกำจัดสิ่งปนเปื้อน ทำความสะอาด ทำลายเชื้อ ตรวจสอบเฝ้าระวังและติดตามผล

(๒) มาตรการแก้ไขใน ข้อ ๑๗ (๑) (ก) และ (ข) ต้องดำเนินการภายใน ๒๔ ชั่วโมง หลังจากได้รับรายงานการตรวจพบเชื้อ และภายหลังดำเนินการตามมาตรการดังกล่าวแล้วหากยังคงตรวจพบเชื้ออีกต้องแก้ไขซ้ำจนกระทั่งระบบผึ่งเย็นปราศจากการปนเปื้อน

(๓) ในกรณีที่ไม่ปฏิบัติตามคำแนะนำหรือคำสั่งเตือน และต่อมาในภายหลังตรวจพบว่ามีการปนเปื้อนจากเชื้อลีจิโอเนลลาอีก ให้พนักงานเจ้าหน้าที่ต้องสั่งปิดระบบทันที

ส่วนที่ ๔
ความปลอดภัยของผู้ปฏิบัติงาน

ข้อ ๑๘ การฝึกอบรม

บุคคลซึ่งมีหน้าที่ในการดูแลบำรุงรักษา การตรวจสอบเฝ้าระวัง การบำบัดน้ำ และการทำงานของระบบผึ่งเย็นต้องผ่านการฝึกอบรมตามหลักสูตรที่กรมอนามัยและกรมควบคุมโรคกำหนด

ข้อ ๑๙ ผู้ได้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคารหรือผู้ที่ได้รับมอบหมายตามข้อ ๔(๑) (ก) ต้องจัดให้มีและใช้มาตรการป้องกันอันตรายส่วนบุคคล ดังต่อไปนี้

(๑) ผู้ปฏิบัติงานซึ่งมีหน้าที่ในการบำรุงรักษาหอผึ่งเย็นต้องได้รับทราบถึงความเสี่ยงอันตรายของโรคลีเจียนแนร์ และได้รับคำแนะนำการใช้อุปกรณ์ป้องกันอันตรายส่วนบุคคลที่ถูกต้อง

(๒) ผู้ปฏิบัติงานต้องได้รับและใช้อุปกรณ์ป้องกันอันตรายส่วนบุคคลที่เหมาะสมตามประเภทของงานและลักษณะสภาวะอันตรายดังต่อไปนี้

(ก) งานตรวจสอบ สภาวะอันตราย ได้แก่ ละอองฝอย ซึ่งผู้ปฏิบัติงานต้องได้รับและใช้อุปกรณ์ป้องกันอันตรายส่วนบุคคลในขณะทำงาน ประกอบด้วยชุดหน้ากากสวมครึ่งหน้าที่สามารถกรองอนุภาคขนาดเล็กกว่า ๕ ไมครอนได้ พร้อมชุดแต่งกายทำงานทั่วไป

(ข) งานบำบัดน้ำ สภาวะอันตราย ได้แก่ ละอองฝอย และละอองสารเคมี ซึ่งผู้ปฏิบัติงานต้องได้รับและใช้อุปกรณ์ป้องกันอันตรายส่วนบุคคลในขณะทำงานประกอบด้วยชุดหน้ากากสวมครึ่งหน้า เช่นเดียวกับข้อ ๑๕ (๒) (ก) ถุงมือ รองเท้าครึ่งแข้งซึ่งทำจากวัสดุกันน้ำ และแว่นครอบตาทั้ง ๒ ข้าง

(ค) งานฉีดน้ำแรงดันสูง สภาวะอันตราย ได้แก่ ละอองฝอย ซึ่งผู้ปฏิบัติงานต้องได้รับและใช้อุปกรณ์ป้องกันอันตรายส่วนบุคคลในขณะทำงาน ประกอบด้วยชุดหน้ากากสวมครึ่งหน้า ชุดหมีแบบกันน้ำได้ ถุงมือและ รองเท้าครึ่งแข้งซึ่งทำจากวัสดุกันน้ำ และแว่นครอบตาทั้ง ๒ ข้าง

(ง) งานทำความสะอาดและบำบัดน้ำด้วยสารเคมีสภาวะอันตราย ได้แก่ ละอองสารเคมีผู้ปฏิบัติงานต้องได้รับและใช้อุปกรณ์ป้องกันอันตรายส่วนบุคคลในขณะทำงาน ประกอบด้วยชุดหน้ากากสวมเต็มหน้าที่มีตลับดูดซึมชนิดที่กันไอระเหยสารคลอรีนหรือสารเคมี ชุดหมีแบบกันน้ำได้ ถุงมือ และรองเท้าครึ่งแข้งซึ่งทำจากวัสดุกันน้ำ

(๓) เมื่อเกิดอุบัติเหตุสารเคมีหกรดผิวหนังต้องล้างด้วยน้ำสะอาดมาก ๆ ทันที

(๔) ผู้ปฏิบัติงานต้องปฏิบัติตนให้มีสุขลักษณะส่วนบุคคลตามมาตรฐาน รวมทั้งสถานที่ที่ปฏิบัติงานต้องมีอ่างล้างมือและห้องอาบน้ำอย่างเพียงพอ

(๕) ห้ามบริโภคอาหาร เครื่องดื่ม หรือสูบบุหรี่ ขณะปฏิบัติงานดูแลบำรุงรักษา

(๖) ต้องล้างและเช็ดมือให้แห้งก่อนบริโภคอาหาร เครื่องดื่มหรือสูบบุหรี่

(๗) ผู้ปฏิบัติงานที่ได้สัมผัสกับสารเคมีหรือสารอันตรายหรือได้รับมอบหมายให้ปฏิบัติงานตามข้อ ๑๑ และข้อ ๑๒ ต้องได้รับการตรวจสุขภาพตามข้อกำหนดของกฎหมายคุ้มครองแรงงาน

(๘) ในกรณีที่ผู้ปฏิบัติงานรู้สึกว่ามีอาการผิดปกติทางผิวหนัง ระบบการหายใจ และอื่นๆ เมื่อต้องสัมผัสกับสารเคมีหรือสารอันตราย ต้องได้รับการตรวจรักษาจากแพทย์ทันที

ประกาศ ณ วันที่

แบบฟอร์มรายการตรวจสอบเพื่อประเมินความเสี่ยงต่อการเกิดโรคลีเจียนแนร์ของหอผึ่งเย็น

(แบบฟอร์ม ๑ ชุด ใช้สำหรับหอผึ่งเย็น ๑ เครื่อง)

โปรดกาเครื่องหมาย " ✗ " ลงในช่อง ☐

๑. ที่ตั้งของอาคารที่ติดตั้งหอผึ่งเย็น	
๒. หมายเลขของหอผึ่งเย็น	
๓. การจดทะเบียนหอผึ่งเย็น	
๓.๑ หอผึ่งเย็นได้จดทะเบียนกับผู้อนุญาตหรือพนักงานเจ้าหน้าที่	[x] ใช่ [ ] ไม่ใช่
๔. น้ำที่ใช้และการระบายน้ำทิ้งของหอผึ่งเย็น	
๔.๑ น้ำที่ใช้เป็นน้ำสะอาดหรือน้ำประปา	[x] ใช่ [ ] ไม่ใช่
๔.๒ มีการระบายน้ำทิ้งจากหอผึ่งเย็นลงสู่ท่อหรือรางระบายน้ำสาธารณะ	[x] ใช่ [ ] ไม่ใช่
๕. ตำแหน่งที่ตั้งของหอผึ่งเย็น	
๕.๑ หอผึ่งเย็นตั้งอยู่ในบริเวณดังต่อไปนี้	
(๑) อยู่ใกล้กับช่องลมเข้าสู่ระบบการระบายอากาศหรือระบบปรับภาวะอากาศ	[ ] ใช่ [x] ไม่ใช่
(๒) อยู่ในตำแหน่งที่ลมจะพัดพาเอาละอองน้ำหรือละอองฝอยจากหอผึ่งเย็นเข้าสู่หน้าต่างของอาคารที่อยู่ใกล้เคียง	[ ] ใช่ [x] ไม่ใช่
๖. การเก็บบันทึกข้อมูลหอผึ่งเย็น	
๖.๑ มีการเก็บบันทึกข้อมูลสำหรับให้เจ้าพนักงานสาธารณสุข หรือเจ้าพนักงานท้องถิ่นตรวจสอบทุกเวลา	[x] ใช่ [ ] ไม่ใช่
๗. ลักษณะทั่วไปของหอผึ่งเย็น	
๗.๑ มีช่องทางสำหรับเข้าไปซ่อมบำรุงรักษาตามส่วนต่าง ๆ ของหอผึ่งเย็น	[x] ใช่ [ ] ไม่ใช่
๗.๒ มีช่องทางสำหรับเข้าไปเก็บตัวอย่างตามจุดต่าง ๆ ของหอผึ่งเย็น ดังต่อไปนี้	
(๑) อ่างรองรับน้ำ	[x] ใช่ [ ] ไม่ใช่
(๒) จุดน้ำล้น	[x] ใช่ [ ] ไม่ใช่

๗.๓ ลักษณะทางกายภาพทั่วไปของหอผึ่งเย็น	
(๑) ทำจากวัสดุธรรมชาติ เช่น ไม้ เป็นต้น	[ ] ใช่ [x] ไม่ใช่
(๒) สะอาด ไม่มีตะกรันและเมือก	[x] ใช่ [ ] ไม่ใช่
(๓) สะดวกและง่ายต่อการทำความสะอาดและทำลายเชื้อ	[x] ใช่ [ ] ไม่ใช่
๗.๔ ใช้แผ่นยางธรรมชาติเป็นวัสดุสำหรับเป็นตัวปกปิดหรือห่อหุ้มกันรั่ว	[ ] ใช่ [x] ไม่ใช่
๗.๕ ก่อให้เกิดละอองปลิวน้อย	[x] ใช่ [ ] ไม่ใช่
๗.๖ เมื่อระบบผึ่งเย็นเปิดเดินเครื่องเต็มกำลัง พบว่ามีละอองปลิวถูกปล่อยระบายออกมาจากหอผึ่งเย็น	[ ] ใช่ [x] ไม่ใช่
๗.๗ มีการใช้เครื่องกำจัดละอองปลิว (ถ้ามี)	[x] ใช่ [ ] ไม่ใช่
(๑) เครื่องกำจัดละอองปลิวได้รับการติดตั้งอย่างมั่นคงและปลอดภัย	[x] ใช่ [ ] ไม่ใช่
๘. การบำรุงรักษาหอผึ่งเย็น	
๘.๑ มีแผนปฏิบัติการซ่อมบำรุงรักษาหอผึ่งเย็นเป็นประจำ	[x] ใช่ [ ] ไม่ใช่
๘.๒ มีการทำความสะอาดและทำลายเชื้อในหอผึ่งเย็นและระบบการจ่ายน้ำปีละ ๒ครั้ง หรือตามช่วงเวลาที่กำหนด	[x] ใช่ [ ] ไม่ใช่
๙. การบำบัดน้ำ	
๙.๑ มีแผนการบำบัดน้ำ เพื่อควบคุมสิ่งต่าง ๆ ดังต่อไปนี้	
(๑) ตะกรัน	[x] ใช่ [ ] ไม่ใช่
(๒) เมือก	[x] ใช่ [ ] ไม่ใช่
(๓) การกัดกร่อน	[x] ใช่ [ ] ไม่ใช่
(๔) กากตะกอน/สาหร่าย	[x] ใช่ [ ] ไม่ใช่
(๕) จุลินทรีย์ต่าง ๆ (รวมทั้งเชื้อลีจิโอเนลลา)	[x] ใช่ [ ] ไม่ใช่
๙.๒ มีลักษณะของสิ่งต่างๆ ดังต่อไปนี้ปรากฏหรือพบเห็นภายในหอผึ่งเย็น	
(๑) การกัดกร่อน	[ ] ใช่ [x] ไม่ใช่
(๒) ความสกปรก	[ ] ใช่ [x] ไม่ใช่
(๓) ตินทราย ฟองของเหลว กากตะกอนหรือเมือก	[ ] ใช่ [x] ไม่ใช่
๙.๓ น้ำที่ใช้ผึ่งเย็นใสสะอาดและปราศจากฝ้า ตะกอนโคลนและฟองต่างๆ	[x] ใช่ [ ] ไม่ใช่

๑๐. การตรวจสอบเฝ้าระวัง		
๑๐.๑ มีการตรวจสอบเฝ้าระวังการบำบัดน้ำเป็นประจำ	[x] ใช่	[ ] ไม่ใช่
๑๐.๒ มีจำนวนแบคทีเรีย (Bacteria Count) มากกว่า ๑๐^{๕} CFU ต่อลิตร	[ ] ใช่	[x] ไม่ใช่
๑๐.๓ ตรวจพบเชื้อลีจิโอเนลลาในระบบผึ่งเย็นมากกว่า ๑๐๐ CFUต่อลิตร	[ ] ใช่	[x] ไม่ใช่
๑๐.๔ มีการส่งผลการตรวจสอบเฝ้าระวังทางจุลชีววิทยาให้หน่วยงานที่เกี่ยวข้องเป็นประจำ	[x] ใช่	[ ] ไม่ใช่

ประเมินโดย _____

( )

ตำแหน่ง_____

วันที่_____**เดือน**_____**พ.ศ.**_____

แบบฟอร์มการจดทะเบียนหอผึ่งเย็น

๑. อาคารที่ติดตั้งหอผึ่งเย็น

๑.๑ ชื่ออาคาร_____

๑.๒ ประเภทอาคาร_____

๑.๓ ที่ตั้งอาคาร

เลขที่_____ถนน_____

ตำบล_____อำเภอ_____จังหวัด_____

รหัสไปรษณีย์_____โทรศัพท์_____โทรสาร_____

๒. รายละเอียดของผู้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคาร

๒.๑ ชื่อ-นามสกุล/ หน่วยงาน_____

๒.๒ ที่อยู่

(๑) ที่พักอาศัย

เลขที่_____ถนน_____

ตำบล_____อำเภอ_____จังหวัด_____

รหัสไปรษณีย์_____โทรศัพท์_____โทรสาร_____

(๒) สถานที่ทำงาน

เลขที่_____ถนน_____

ตำบล_____อำเภอ_____จังหวัด_____

รหัสไปรษณีย์_____โทรศัพท์_____โทรสาร_____

๓. จำนวนหอผึ่งเย็นของอาคาร_____ เครื่อง

๔. รายละเอียดของหอผึ่งเย็นแต่ละเครื่อง

	หมายเลขหอผึ่งเย็น	ตำแหน่งและแผนผังที่ติดตั้ง
เครื่องที่ ๑	_____	_____
เครื่องที่ ๒	_____	_____
เครื่องที่ ๓	_____	_____
เครื่องที่ ๔	_____	_____
เครื่องที่ ๕	_____	_____

เครื่องที่ ๖	_____	_____
เครื่องที่ ๗	_____	_____
เครื่องที่ ๘	_____	_____
เครื่องที่ ๙	_____	_____
เครื่องที่ ๑๐	_____	_____

แบบบันทึกข้อมูล

สำหรับการควบคุมเชื้อลีจิโอเนลลาในระบบผึ่งเย็น

ประจำเดือน..... พ.ศ.....

๑. ชื่ออาคาร_____

ที่ตั้ง_____

๒. หอผึ่งเย็นหมายเลข_____ตำแหน่งที่ตั้ง_____

แบบ/ชนิด_____รุ่น_____ขนาด_____

๓. ข้อมูลการบำบัดด้วยสารชีวฆาตสำหรับเชื้อลีจิโอเนลลา

๓.๑ ชื่อสารชีวฆาตที่ใช้

(๑)_____

(๒)_____

(๓)_____

(๔)_____

๓.๒ ลักษณะการบำบัดน้ำด้วยสารชีวฆาต

บำบัดแบบต่อเนื่อง ระบุความถี่_____

บำบัดโดยใส่สารเคมีเป็นครั้งๆ แบบไม่ต่อเนื่อง (Shot/Slug does)

๔. การบันทึกข้อมูลการตรวจตราเบื้องต้นโดยสายตา

วันที่ตรวจตรา	ผลการตรวจตราเบื้องต้น	ชื่อและลายเซ็นผู้ตรวจตรา

๕. การบันทึกรายละ เอียดการทำความสะอาดและทำลายเชื้อในหอผึ่งเย็น

วันที่ดำเนินการ	รายละเอียดการทำความสะอาดและทำลายเชื้อในหอผึ่งเย็น	ชื่อและลายเซ็นผู้ดำเนินการ

๖. การบันทึกรายละเอียดการบำบัดน้ำด้วยสารเคมีและสารชีวฆาตในหอผึ่งเย็น

วันที่ทำการบำบัดน้ำ	รายละเอียดการบำบัดน้ำด้วยสารเคมีและสารชีวฆาตในหอผึ่งเย็น	ชื่อและลายเซ็นผู้ทำการบำบัด

๗. การบันทึกรายละเอียดผลการตรวจวัดและวิเคราะห์น้ำด้วยตัวอย่าง

วันที่เก็บตัวอย่างน้ำ	ผู้ทำการเก็บตัวอย่างน้ำ	จุดเก็บ	วันที่รายงานผล	ผลการตรวจวัดและวิเคราะห์				ห้องปฏิบัติการตรวจวิเคราะห์
				ค่าพลอร์รีนอิสระคงค้าง	ค่าความเป็นกรดเป็นด่าง	จำนวนเชื้อ แบคทีเรียทั้งหมด	จำนวนเชื้อ เชื้อลีเจียนเนลา	

๘. การบันทึกรายละเอียดการควบคุมดูแลบำรุงรักษาและปรับปรุงแก้ไขหอผึ่งเย็น

วันที่ดำเนินการ	รายละเอียดการควบคุมดูแลบำรุงรักษาและปรับปรุงแก้ไขหอผึ่งเย็น	ชื่อและลายเซ็นผู้ควบคุม

๙. การบันทึกรายละเอียดแผนหรือโครงการควบคุมโรคลีเจียนแนร์ประจำอาคาร

วันที่ดำเนินการ	รายละเอียดการดำเนินงานตามแผนหรือโครงการ	ผู้ควบคุมการปฏิบัติงาน

ภาคผนวก (ก)

แบบฟอร์มรายการตรวจสอบเพื่อประเมินความเสี่ยงต่อการเกิดโรคลีเจียนแนร์ของหอผึ่งเย็น

(แบบฟอร์ม ๑ ชุด ใช้สำหรับหอผึ่งเย็น ๑ เครื่อง)

โปรดกาเครื่องหมาย " ✗ " ลงในช่อง ☐

๑. ที่ตั้งของอาคารที่ติดตั้งหอผึ่งเย็น	
๒. หมายเลขของหอผึ่งเย็น	
๓. การจดทะเบียนหอผึ่งเย็น	
๓.๑ หอผึ่งเย็นได้จดทะเบียนกับผู้อนุญาตหรือพนักงานเจ้าหน้าที่	☒ **ใช่** ☐ **ไม่ใช่**
๔. น้ำที่ใช้และการระบายน้ำทิ้งของหอผึ่งเย็น	
๔.๑ น้ำที่ใช้เป็นน้ำสะอาดหรือน้ำประปา	☒ **ใช่** ☐ **ไม่ใช่**
๔.๒ มีการระบายน้ำทิ้งจากหอผึ่งเย็นลงสู่ท่อหรือรางระบายน้ำสาธารณะ	☒ **ใช่** ☐ **ไม่ใช่**
๕. ตำแหน่งที่ตั้งของหอผึ่งเย็น	
๕.๑ หอผึ่งเย็นตั้งอยู่ในบริเวณดังต่อไปนี้	
(๑) อยู่ใกล้กับช่องลมเข้าสู่ระบบการระบายอากาศหรือระบบปรับภาวะอากาศ	☐ **ใช่** ☒ **ไม่ใช่**
(๒) อยู่ในตำแหน่งที่ลมจะพัดพาเอาละอองน้ำหรือละอองฝอยจากหอผึ่งเย็นเข้าสู่หน้าต่างของอาคารที่อยู่ใกล้เคียง	☐ **ใช่** ☒ **ไม่ใช่**
๖. การเก็บบันทึกข้อมูลหอผึ่งเย็น	
๖.๑ มีการเก็บบันทึกข้อมูลสำหรับให้เจ้าพนักงานสาธารณสุข หรือเจ้าพนักงานท้องถิ่นตรวจสอบทุกเวลา	☒ **ใช่** ☐ **ไม่ใช่**
๗. ลักษณะทั่วไปของหอผึ่งเย็น	
๗.๑ มีช่องทางสำหรับเข้าไปซ่อมบำรุงรักษาตามส่วนต่าง ๆ ของหอผึ่งเย็น	☒ **ใช่** ☐ **ไม่ใช่**
๗.๒ มีช่องทางสำหรับเข้าไปเก็บตัวอย่างตามจุดต่าง ๆ ของหอผึ่งเย็นดังต่อไปนี้	
(๑) อ่างรองรับน้ำ	☒ **ใช่** ☐ **ไม่ใช่**
(๒) จุดน้ำล้น	☒ **ใช่** ☐ **ไม่ใช่**

๗.๓ ลักษณะทางกายภาพทั่วไปของหอผึ่งเย็น		
(๑) ทำจากวัสดุธรรมชาติ เช่น ไม้ เป็นต้น	☐ ใช่	☒ ไม่ใช่
(๒) สะอาด ไม่มีตะกรันและเมือก	☒ ใช่	☐ ไม่ใช่
(๓) สะดวกและง่ายต่อการทำความสะอาดและทำลายเชื้อ	☒ ใช่	☐ ไม่ใช่
๗.๔ ใช้แผ่นยางธรรมชาติเป็นวัสดุสำหรับเป็นตัวปกปิดหรือห่อหุ้มกันรั่ว	☐ ใช่	☒ ไม่ใช่
๗.๕ ก่อให้เกิดละอองปลิวน้อย	☒ ใช่	☐ ไม่ใช่
๗.๖ เมื่อระบบผึ่งเย็นเปิดเดินเครื่องเต็มกำลัง พบว่ามีละอองปลิวถูกปล่อยระบายออกมาจากหอผึ่งเย็น	☐ ใช่	☒ ไม่ใช่
๗.๗ มีการใช้เครื่องกำจัดละอองปลิว (ถ้ามี)	☒ ใช่	☐ ไม่ใช่
(๑) เครื่องกำจัดละอองปลิวได้รับการติดตั้งอย่างมั่นคงและปลอดภัย	☒ ใช่	☐ ไม่ใช่
๘. การบำรุงรักษาหอผึ่งเย็น		
๘.๑ มีแผนปฏิบัติการซ่อมบำรุงรักษาหอผึ่งเย็นเป็นประจำ	☒ ใช่	☐ ไม่ใช่
๘.๒ มีการทำความสะอาดและทำลายเชื้อในหอผึ่งเย็นและระบบการจ่ายน้ำปีละ ๒ครั้ง หรือตามช่วงเวลาที่กำหนด	☒ ใช่	☐ ไม่ใช่
๙. การบำบัดน้ำ		
๙.๑ มีแผนการบำบัดน้ำ เพื่อควบคุมสิ่งต่าง ๆ ดังต่อไปนี้		
(๑) ตะกรัน	☒ ใช่	☐ ไม่ใช่
(๒) เมือก	☒ ใช่	☐ ไม่ใช่
(๓) การกัดกร่อน	☒ ใช่	☐ ไม่ใช่
(๔) กากตะกอน/สาหร่าย	☒ ใช่	☐ ไม่ใช่
(๕) จุลินทรีย์ต่าง ๆ (รวมทั้งเชื้อลีจิโอเนลลา)	☒ ใช่	☐ ไม่ใช่
๙.๒ มีลักษณะของสิ่งต่างๆ ดังต่อไปนี้ปรากฏหรือพบเห็นภายในหอผึ่งเย็น	x	
(๑) การกัดกร่อน	☐ ใช่	☒ ไม่ใช่
(๒) ความสกปรก	☐ ใช่	☒ ไม่ใช่
(๓) ตินทราย ฟองของเหลว กากตะกอนหรือเมือก	☐ ใช่	☐ ไม่ใช่
๙.๓ น้ำที่ใช้ผึ่งเย็นใสสะอาดและปราศจากฝ้า ตะกอนโคลนและฟองต่างๆ	☒ ใช่	☐ ไม่ใช่

๑๐. การตรวจสอบเฝ้าระวัง		
๑๐.๑ มีการตรวจสอบเฝ้าระวังการบำบัดน้ำเป็นประจำ	☒ ใช่	☐ ไม่ใช่
๑๐.๒ มีจำนวนแบคทีเรีย (Bacteria Count) มากกว่า ๑๐^{๕} CFU ต่อลิตร	☐ ใช่	☒ ไม่ใช่
๑๐.๓ ตรวจพบเชื้อลีจิโอเนลลาในระบบผึ่งเย็นมากกว่า ๑๐๐ CFUต่อลิตร	☐ ใช่	☒ ไม่ใช่
๑๐.๔ มีการส่งผลการตรวจสอบเฝ้าระวังทางจุลชีววิทยาให้หน่วยงานที่เกี่ยวข้องเป็นประจำ	☒ ใช่	☐ ไม่ใช่

ประเมินโดย _____

( )

ตำแหน่ง_____

วันที่_____**เดือน**_____**พ.ศ.**_____

ภาคผนวก (ข)

แบบฟอร์มการจดทะเบียนหอผึ่งเย็น

๑. อาคารที่ติดตั้งหอผึ่งเย็น

๑.๑ ชื่ออาคาร_____

๑.๒ ประเภทอาคาร_____

๑.๓ ที่ตั้งอาคาร

เลขที่_____ถนน_____

ตำบล_____อำเภอ_____จังหวัด_____

รหัสไปรษณีย์_____โทรศัพท์_____โทรสาร_____

๒. รายละเอียดของผู้รับใบอนุญาต ผู้ดำเนินการ เจ้าของหรือผู้ครอบครองอาคาร

๒.๑ ชื่อ-นามสกุล/ หน่วยงาน_____

๒.๒ ที่อยู่

(๑) ที่พักอาศัย

เลขที่_____ถนน_____

ตำบล_____อำเภอ_____จังหวัด_____

รหัสไปรษณีย์_____โทรศัพท์_____โทรสาร_____

(๒) สถานที่ทำงาน

เลขที่_____ถนน_____

ตำบล_____อำเภอ_____จังหวัด_____

รหัสไปรษณีย์_____โทรศัพท์_____โทรสาร_____

๓. จำนวนหอผึ่งเย็นของอาคาร_____เครื่อง

๔. รายละเอียดของหอผึ่งเย็นแต่ละเครื่อง

	หมายเลขหอผึ่งเย็น	ตำแหน่งและแผนผังที่ติดตั้ง
เครื่องที่ ๑	_____	_____
เครื่องที่ ๒	_____	_____
เครื่องที่ ๓	_____	_____
เครื่องที่ ๔	_____	_____

เครื่องที่ ๕	_____	_____
เครื่องที่ ๖	_____	_____
เครื่องที่ ๗	_____	_____
เครื่องที่ ๘	_____	_____
เครื่องที่ ๙	_____	_____
เครื่องที่ ๑๐	_____	_____

ภาคผนวก (ค)

แบบฟอร์มสมุดบันทึกข้อมูล

สำหรับการควบคุมเชื้อลีจิโอเนลลาในระบบผึ่งเย็น

สมุดบันทึกข้อมูล

สำหรับการควบคุมเชื้อลีจิโอเนลลาในระบบผึ่งเย็น

ประจำเดือน..... พ.ศ.....

๑. ชื่ออาคาร_____

ที่ตั้ง_____

๒. หอผึ่งเย็นหมายเลข_____ตำแหน่งที่ตั้ง_____

แบบ/ชนิด_____รุ่น_____ขนาด_____

๓. ข้อมูลการบำบัดด้วยสารชีวฆาตสำหรับเชื้อลีจิโอเนลลา

๓.๑ ชื่อสารชีวฆาตที่ใช้

(๑)_____

(๒)_____

(๓)_____

(๔)_____

๓.๒ ลักษณะการบำบัดน้ำด้วยสารชีวฆาต

บำบัดแบบต่อเนื่อง ระบุความถี่_____

บำบัดโดยใส่สารเคมีเป็นครั้งๆ แบบไม่ต่อเนื่อง (Shot/Slug does)

๔. การบันทึกข้อมูลการตรวจตราเบื้องต้นโดยสายตา

วันที่ตรวจตรา	ผลการตรวจตราเบื้องต้น	ชื่อและลายเซ็นผู้ตรวจตรา

๕. การบันทึกรายละ เอียดการทำความสะอาดและทำลายเชื้อในหอผึ่งเย็น

วันที่ดำเนินการ	รายละเอียดการทำความสะอาดและทำลายเชื้อในหอผึ่งเย็น	ชื่อและลายเซ็นผู้ดำเนินการ

๖. การบันทึกรายละเอียดการบำบัดน้ำด้วยสารเคมีและสารชีวฆาตในหอผึ่งเย็น

วันที่ทำการบำบัดน้ำ	รายละเอียดการบำบัดน้ำด้วยสารเคมีและสารชีวฆาตในหอผึ่งเย็น	ชื่อและลายเซ็นผู้ทำการบำบัด

๗. การบันทึกรายละเอียดผลการตรวจวัดและวิเคราะห์น้ำตัวอย่าง

วันที่เก็บตัวอย่างน้ำ	ผู้ทำการเก็บตัวอย่างน้ำ	จุดเก็บ	วันที่รายงานผล	ผลการตรวจวัดและวิเคราะห์				ห้องปฏิบัติการตรวจวิเคราะห์
				ค่าคลอรีนอิสระคงค้าง	ค่าความเป็นกรดเป็นด่าง	เบคทีเรียทั้งหมด	สำนักเชื้อลิจิโอเนลลา	

๘. การบันทึกรายละเอียดการควบคุมดูแลบำรุงรักษาและปรับปรุงแก้ไขหอผึ่งเย็น

วันที่ดำเนินการ	รายละเอียดการควบคุมดูแลบำรุงรักษาและปรับปรุงแก้ไขหอผึ่งเย็น	ชื่อและลายเซ็นผู้ควบคุม

๙. การบันทึกรายละเอียดแผนหรือโครงการควบคุมโรคลีเจียนแนร์ประจำอาคาร

วันที่ดำเนินการ	รายละเอียดการดำเนินงานตามแผนหรือโครงการ	ผู้ควบคุมการปฏิบัติงาน

ภาคผนวก จ

เอกสารสอบเทียบเครื่องมือที่ใช้ในการตรวจวิเคราะห์

รายการใบรับรองสอบเทียบ/ทวนสอบ เครื่องมือหลักประจำห้องปฏิบัติการวิเคราะห์ สำหรับวิเคราะห์คุณภาพสิ่งแวดล้อม

No.	Instrument/Equipment	Parameter	Manufacturer	Model/Serial No.	Calibrator	Certification No.	Date of Calibration	Due date of Calibration*	Remark
เครื่องมือหลักประจำห้องปฏิบัติการวิเคราะห์คุณภาพน้ำ									
1	pH Meter		Mettler-Toledo	Seven Easy pH/ 1231155210	National Food Institute, Ministry of Industry, Thailand	2601956-001-01	23 Feb 26	22 Feb 27	-
2	Analytical Balance (Readability 0.01 mg)	ของแข็งแขวนลอยทั้งหมด (SS) ของแข็งละลายน้ำ (TDS)	Mettler-Toledo	XSR205DU / C210685394	United Analyst and Engineering Consultant Co., Ltd.	260311-2-BL001-26	12 Mar 26	11 Mar 27	-
3	Hot Air Oven		Memmert	UF55 / B212.0411	National Food Institute, Ministry of Industry, Thailand	2602300-001-01	11 Mar 26	10 Mar 27	-
4	Analytical Balance (Readability 0.1 mg)	น้ำมัน และไขมัน (Fat, Oil & Grease)	Mettler-Toledo	AB204-S / FACT 1129361010	United Analyst and Engineering Consultant Co., Ltd.	260318-1-BL007-26	3 Apr 26	2 Apr 27	-
5	BOD Incubator	บีโอดี(BOD)	Arco	UC4-1320 / (UAE.WAO.018/2559)	Technology Promotion Association (Thailand-Japan)	25TM1001	7 Jul 25	6 Jul 26	-
6	BOD Incubator		Arco	UC4-1320 / (UAE.WAO.018/2550)	Technology Promotion Association (Thailand-Japan)	25TM1002	7 Jul 25	6 Jul 26	-
7	Digestor Unit	ไนโตรเจนในรูปทีเคเอ็น (TKN)	FOSS TECATOR	KT9/ 91905393	FOSS South East Asia	14589	12 Feb 26	11 Feb 27	-
8	Distillation Unit (Kjeldahl Method)		FOSS TECATOR	DT2520/ 91905060	FOSS South East Asia	14590	12 Feb 26	11 Feb 27	-
9	Incubator	โคลิฟอร์มแบคทีเรีย (Coliform Bacteria) ฟีคอลโคลิฟอร์มแบคทีเรีย (Faecal Coliform Bacteria)	Binder	KB 400/ 20200000015535	National Food Institute, Ministry of Industry, Thailand	2602303-006-01	11 Mar 26	10 Mar 27	-
10	Incubator		Memmert	IPP 260 / V615.0187	National Food Institute, Ministry of Industry, Thailand	2602303-001-01	12 Mar 26	11 Mar 27	-

รายการใบรับรองสอบเทียบ/ทวนสอบ เครื่องมือหลักประจำห้องปฏิบัติการวิเคราะห์ สำหรับวิเคราะห์คุณภาพสิ่งแวดล้อม

No.	Instrument/Equipment	Parameter	Manufacturer	Model/Serial No.	Calibrator	Certification No.	Date of Calibration	Due date of Calibration*	Remark
เครื่องมือหลักประจำห้องปฏิบัติการวิเคราะห์คุณภาพน้ำ									
11	Water Bath		Memmert	WNE 14 / L414.1410	Technology Promotion Association (Thailand-Japan)	26TM444	16 Mar 26	15 Mar 27	-
12	Water Bath		Memmert	WNE 14 / L407.0756	Technology Promotion Association (Thailand-Japan)	25TM1037	7 Jul 25	6 Jul 26	-
13	Auto Clave		ALP	CL-40L / 808763	National Food Institute, Ministry of Industry, Thailand	2602303-007-01	11 Mar 26	10 Mar 27	-
14	Auto Clave		ALP	CL-40L / 807298	DKSH (Thailand) Ltd.	2504165-003-01	31 Jul 25	30 Jul 26	-

Due Date of Calibration* : Based on the annual calibration plan. At least 1 time per year.

รายการใบรับรองสอบเทียบ/ทวนสอบ เครื่องมือหลักประจำห้องปฏิบัติการวิเคราะห์ สำหรับวิเคราะห์คุณภาพสิ่งแวดล้อม

No.	Instrument/Equipment	Parameter	Manufacturer	Model/Serial No.	Calibrator	Certification No.	Date of Calibration	Due date of Calibration*	Remark
เครื่องมือหลักประจำห้องปฏิบัติการวิเคราะห์คุณภาพน้ำ									
1	pH Meter	ความเป็นกรดเป็นด่าง (pH)	Mettler-Toledo	Seven Easy pH / 1231155210	National Food Institute, Ministry of Industry, Thailand	2601956-001-01	23 Feb 26	22 Feb 27	-
2	pH Meter		Mettler-Toledo	Star A214 / X36836	Science Tech Co,.Ltd	ST018/26	20 May 26	19 May 27	-
3	Incubator	โคลิฟอร์มแบคทีเรีย (Coliform Bacteria) ฟีคอลโคลิฟอร์มแบคทีเรีย (Faecal Coliform Bacteria)	Binder	KB400 / 2602303-006	National Food Institute, Ministry of Industry, Thailand	2602303-006-01	11 Mar 26	10 Mar 27	-
4	Incubator		Memmert	IPP 260 / V615.0187	National Food Institute, Ministry of Industry, Thailand	2602303-001-01	11 Mar 26	10 Mar 27	-

Due Date of Calibration* : Based on the annual calibration plan. At least 1 time per year.

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-001-01
Page : 1 of 2

Equipment:	pH Meter
Manufacturer:	METTLER TOLEDO
Model:	SevenEasy pH
Serial No.:	1231155210
ID No.:	UAE.WAT.010/2553
Order No.:	2601956
Operation No.:	2601956-001
Date of Receipt:	20 February 2026
Date of Calibration:	23 February 2026

Customer name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road,
Bangchack, Prakhanong, Bangkok 10260

Metrological traceability:

1.Calibration Method W-CC-002 : In house method based on direct measurement by using standard voltage calibrator and certified reference material (CRM)

2. Reference Standards / Certified Reference Material

Instruments	Serial / ID No.	Manufacturer	Certificate No.	Due Date
2.1 DC Voltage Calibrator	2709007	Fluke	25E1753	22 May 2026
2.2 Digital Thermometer	2709007	Fluke	2600328-002-01	25 October 2026
2.3 Thermo-Hygro Meter	NFI.BTH 014/23	testo	2503232-014-01	10 June 2026
Certified Reference Material	**Lot. No.**	**Manufacturer**	**Ref N**	**Expire Date**
2.4 pH buffer 4.008 (Primary pH buffer Solution)	1016435	CPAchem	PH216.L5	25 July 2026
2.5 pH buffer 6.865 (Primary pH buffer Solution)	1016432	CPAchem	PH217.L5	25 July 2026
2.6 pH buffer 10.01 (Primary pH buffer Solution)	1088003	CPAchem	PH220.L5	18 March 2026
2.7 pH buffer 7.00 (Standard pH buffer Solution)	C03282	HACH LANGE GmbH	S11M004	11 June 2027

3. This certification is traceable to The International System of Unit (SI Unit)
3.1 Instruments No.2.1 through NSC-ONSC Laboratory Accredition of Calibration No.0008 (TPA)
3.2 Instruments No.2.2 and 2.3 through NSC-ONSC Laboratory Accredition of Calibration No.0061 (NFI)
3.3 Certified Reference Material No.2.4 to 2.6 traceable to CPAchem Ltd is accredited to ISO 17034 (ANSI accredited No. AR-1835)
3.4 Certified Reference Material No.2.7 traceable to Hach Lange GmbH is accredited to DIN EN ISO 17034 (DAkkS accredited No.D-RM-15184-01-00)
4. This certificate was certified only for the instrument we calibrated.
5. This result of calibration was found accurate as shown on date and place of calibration only.

Calibrated by Mr.Manas Somsak
Specialist

Approved by
(Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 2 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-001-01
Page : 2 of 2

Calibration Condition:

Place of Calibration :	Chemical Calibration Laboratory, National Food Institute		
Environment Condition:	Ambient Temperature (24.0 ± 0.2) °C	Relative Humidity:	(49.8 ± 2) %
Calibration Item Condition:	Used Item	Type:	Bench top
	Range: 0 - 14 pH	Resolution:	0.01 pH, 1 mV

Calibration results:

1. Calibration of pH Meter (Manual Temperature Compensation at 25 °C)

Nominal pH	DC Voltage Standard (mV)	Average Indicator Reading mV	Average Indicator Reading pH	Uncertainty (±mV)	Coverage Factor (k)
0	414.119	414	-0.01	0.58	2.00
2	295.813	296	1.99	0.58	2.00
4	177.463	178	4.00	0.58	2.00
6	59.159	59	6.00	0.58	2.00
7	0.000	0	7.00	0.58	2.00
8	-59.159	-59	8.00	0.58	2.00
10	-177.462	-177	10.00	0.58	2.00
12	-295.813	-296	12.00	0.58	2.00
14	-414.119	-414	14.00	0.58	2.00

2. Calibration of pH Meter with Electrode (Manual Temperature Compensation at 25 °C)

Equipment:	pH Electrode	Manufacturer:	METTLER TOLEDO	Model:	InLab Solids
Serial No.:	C507554932	ID.No.	N/A	Type:	Combined Electrode

Performance of Electrode system (Three-Point Calibration at pH 4, 7 and 9)

Certified Value @25 °C (pH)	Average Indicator Reading pH	Average Indicator Reading mV	Relative Slope (%)	Uncertainty (± pH)	Coverage Factor (k)
4.008	4.01	184	-	0.0071	2.00
7.000	7.00	8	99.5	0.0086	2.00
10.010	10.01	-166	97.7	0.0085	2.00
6.876	6.88	15	-	0.0071	2.00

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k= 2, providing a level of confidence of approximately 95 %.

---------- End of Report ----------

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

nfi national food institute ministry of industry
สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA

MRA THAILAND
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-002-01

Equipment:	Digital Thermometer with RTD (pH Meter)		
Manufacturer:	METTLER TOLEDO	**Customer Name:**	UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Model:	SevenEasy pH	**Address:**	3 Soi Udomsuk 41, Sukhumvit Road,
Serial No.:	1231155210		Bangchack, Prakhanong, Bangkok 10260
ID No.:	UAE.WAT.010/2553		
Order No.:	2601956		
Operation No.:	2601956-002		
Date of Receipt:	20 February 2026		
Date of Calibration:	23 February 2026		

Metrological traceability:

1. Calibration Method:
   - NFI Method W-TE-025 : based on comparison with a standard thermometer.
   - TM-CG01-TT01-V04: CALIBRATION OF DIGITAL THERMOMETER WITH TEMPERATURE SENSORS.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
2. Reference Standard Instrument:

Instrument	Model / Type	Serial No. / ID No.	Certificate No.	Due Date	Through
HANDHELD THERMOMETER	1523	2118154	PSL-T 0926/68	26-Jun-26	TISTR
Platinum Resistance Thermometer (PRT)	5627A	877332			

Support Equipment : - Low Temperature Bath (AMETEK RTC-187), Model: RTC-187C , S/N: 670930-00018

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by: Mr.Manas Somsak, Specialist

Approved by: (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 2 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

nfi national food institute ministry of industry
สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA
MRA THAILAND
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-002-01

Calibration Condition :

Equipment:	Digital Thermometer with RTD	**Place of Calibration:**	Chemical Calibration Laboratory
UUC* Resolution:	0.1 °C		National Food Institute
Condition of the item:	Normal & Good	**Environment Conditions:**	Ambient Temperature (23.1 ± 0.3) °C
	Without adjustment / AS FOUND		Relative Humidity (49.8 ± 2) %
			Line Voltage (220 ± 10) V.

Calibration results:

- Temperature Measurement Results

Calibration Point (°C)	Standard Thermometer Value (°C)	UUC* Reading Value (°C)	UUC* Correction Value (°C)	Measurement Uncertainty (± °C)
20	20.002	20.1	-0.1	0.098
25	25.001	25.1	-0.1	0.098
30	30.003	30.1	-0.1	0.098

Note

- UUC* : Unit Under Calibration
- The probe was immersed in a liquid bath or a dry bath to a minimum depth of 120 mm.
- Description of probe, model : N/A S/N : N/A

Dimension of probe : Diameter 4 mm. Length 120 mm. Sheath material: Plastic

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %

--------- End of Report ---------

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025
CALIBRATION 0416

Certificate of Calibration

Certificate No.: 260311-2-BL001-26
Code No.: BL001-26

Customer Name: United Analyst and Engineering Consultant Co., Ltd.
Address: 3 Soi Udom suk 41, Sukhumvit Rd., Bang Chak, Phar Khanong, Bangkok 10260

Equipment: Electronic Balance
Manufacturer: Mettler Toledo
Model: XSR205DU
Serial No.: C210685394
Asset No. : UAE.WAO.010/2565
Building : UAE number 3 Floor : 2 Room : 208

Received Date: March 11, 2026
Date of Calibation : March 12, 2026

Calibration Conditions:				
	Temperature	23.0 °C	to	23.6 °C
	Humidity	51.5 %	to	54.4 %
	Pressure	755.7 mmHg	to	757.9 mmHg

Calibrated by: Thanachat Chatpahol

Approved by: Suwit Chotnok Signature:

Issued Date: March 16, 2026

Note : 1) The Uncertainties are for a confidence probability of approximately 95%
2) This Certificate is valid only to the item calibrated on date and place of calibration.
3) This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation Scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the United Analyst and Engineering Consultant Co.,Ltd. (UAE)

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC-TISI-TIS 17025
CALIBRATION 0416

Equipment: Electronic Balance
Manufacturer: Mettler Toledo
Model: XSR205DU
Readability: 0 to 81 (g): 0.01 mg , > 80 to 200 (g) : 0.1 mg
Serial No.: C210685394
ID No.: UAE.WAO.010/2565
Max. Capacity: 81 g / 220 g
Calibration Date: March 12, 2026
Condition As-Received: In Condition

Condition of Equipment:

Condition of This Result of Calibration:

1. Calibration Method: This instrument was calibrated by method UAE.CP.CAL.006 In-House Method based on UKAS Lab 14 : 2022
2. Reference Standrads:

Reference Standard:	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Standard Weight Class E2 (OIML)	1 mg to 1 kg	C510641605	METTLER TOLEDO GmbH	C510641605	METTLER TOLEDO GmbH	3-Mar-27
Standard Weight Class E2 (OIML)	1 mg to 1 kg	B749109122	AMARC	25-009359	AMARC	21-Jan-27

Instrument	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	SUCCESS	SG-H-00992/68	Success Gateway	26-Nov-26
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	TPA	25P4464	TPA	18-Dec-26

3. This certification is traceable to SI Unit
4. This certification was certified only for the indtrument we calibrated
5. This result of calibration wae found accurate as show on date and place of calibration only.
6. Through the reference standard laboratory of Mettler-Toledo GmbH C510641605, SAS accreditation number SCS 0032
7. Through the reference standard laboratory of AMARC 25-009359, TISI accreditation number 0152


Calibraton Result:

1. Repeatability of Reading:

Nominal Value (g)	Standard Deviation of Reading (g)
80	0.000019
200*	0.000055

2. Eccentric or off-center loading

A mass of 100 g was placed and moved to various position on pan
The Balance reading obtained is given in the table.

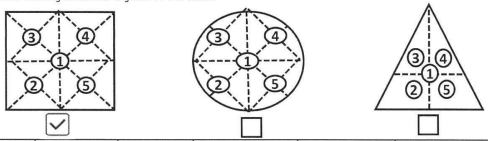

1 (g)	2 (g)	3 (g)	4 (g)	5 (g)	Maximum Difference (g)
100.0002	100.0002	100.0003	100.0004	100.0003	0.0001

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
CALIBRATION 0416

Certificate No.: 260311-2-BL001-26
Code No.: BL001-26

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	XSR205DU	Readability:	0 to 81 (g): 0.01 mg , > 80 to 200 (g) : 0.1 mg
Serial No.:	C210685394	ID No.:	UAE.WAO.010/2565
Max. Capacity:	81 g / 220 g		
Calibration Date:	March 12, 2026		

Calibraton Result: (Continued)
Calibraton Range: 0 to 80 (g)
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value: (Range: 0 to 81 (g) ; Resolution: 0.00001 g)

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.00000	0.00000	0.032	2.65
0.001	0.0010020	0.00101	0.00000	0.032	2.65
0.005	0.0050025	0.00501	-0.00001	0.032	2.65
0.01	0.0100005	0.01001	-0.00001	0.032	2.65
0.05	0.0500003	0.05001	-0.00001	0.032	2.65
0.10	0.1000083	0.10000	0.00001	0.033	2.65
0.50	0.5000121	0.50001	0.00000	0.033	2.65
1	1.0000119	1.00003	-0.00002	0.032	2.52
2	2.0000125	2.00003	-0.00002	0.033	2.52
5	5.0000146	5.00003	-0.00002	0.033	2.32
10	10.0000330	10.00006	-0.00003	0.034	2.21
20	20.000028	20.00006	-0.00003	0.041	2.07
30	30.000061	30.00017	-0.00011	0.055	2.00
40	40.000054	40.00021	-0.00016	0.066	2.00
50	50.000037	50.00023	-0.00019	0.068	2.00
60	60.000070	60.00029	-0.00022	0.084	2.00
80	80.000098	80.00039	-0.00030	0.12	2.00

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
CALIBRATION 0416

Certificate No.: 260311-2-BL001-26
Code No.: BL001-26

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	XSR205DU	Readability:	0 to 81 (g): 0.01 mg , > 80 to 200 (g) : 0.1 mg
Serial No.:	C210685394	ID No.:	UAE.WAO.010/2565
Max. Capacity:	81 g / 220 g		
Calibration Date:	March 12, 2026		

Calibraton Result: (Continued)
Calibraton Range: > 81 to 200 (g)
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value: (Range: > 81 - 220 (g) ; Resolution: 0.0001 g)

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.0000	0.0000	0.032	2.65
90	90.0000910	90.0004	-0.0003	0.16	2.00
100	100.0000420	100.0003	-0.0003	0.16	2.00
110	110.0000750	110.0004	-0.0003	0.18	2.00
120	120.0000680	120.0004	-0.0003	0.19	2.00
130	130.0001010	130.0005	-0.0004	0.20	2.00
140	140.0000960	140.0004	-0.0003	0.21	2.00
150	150.0000790	150.0005	-0.0004	0.22	2.00
160	160.0001120	160.0004	-0.0003	0.23	2.00
170	170.0001050	170.0003	-0.0002	0.24	2.00
200	200.0001460	200.0001	0.0000	0.26	2.00

4. Effect of Tare test:

Tare Load (g)	Test Load (g)	Indication (g)	Correction (g)
100	20.000028	20.0001	0.0000
	40.000054	40.0001	0.0000
	60.000070	60.0000	0.0001
	80.000098	80.0000	0.0001
	100.000109	100.0000	0.0001

Remark: -
The report uncertainty of measurment was based on standard uncertainty multiplied by coverage factor k, providing a level of confidence of approximetely 95%

o---o-End-o---o

เอกสารไม่ควบคุม

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
national food institute
ministry of industry
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA

THAILAND
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602300-001-01

Equipment:	CHAMBER (Hot Air Oven)
Manufacturer:	MEMMERT
Model:	UF55
Serial No.:	B212.0411
ID No.:	UAE.WAO.005/2556
Order No.:	2602300
Operation No.:	2602300-001
Date of Receipt:	11 March 2026
Date of Calibration:	11 March 2026

Customer Name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road, Bangchack, Prakhanong, Bangkok 10260

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014. based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	34972A RTD	MY59002902 CH#201-209/ RTD#201-209	2502797-002-01	3 May 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by Mr.Manas Somsak
Specialist

Approved by
(Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 18 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
national food institute
ministry of industry
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA
THAILAND
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602300-001-01

Calibration Condition:

Equipment:	CHAMBER (Hot Air Oven)	**Place of Calibration:**	Laboratory
UUC* Resolution:	0.1 °C		UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Condition of the item:	Normal & Good	**Environment Conditions:**	Ambient Temperature (29.8 ± 1.0) °C
	Without adjustment / As Found		Relative Humidity (47.8 ± 4) %
	- Time of record 1 hour 9 minute / point		Line Voltage (222 ± 3) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
104.0	104.22	103.87	103.90	104.17	103.56	103.58	104.22	104.17	104.00	0.53
120.0	120.21	119.76	119.86	120.18	119.53	119.58	120.24	120.20	119.96	0.73
180.0	180.27	179.37	179.73	180.31	178.91	179.13	180.35	180.25	179.84	0.90

Table 2 : Reporting of Characterization Results

UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
104.0	104.0	104.0	104.0	0.05	0.44	0.75
120.0	120.0	120.0	120.0	0.06	0.43	0.79
180.0	180.0	180.0	180.0	0.07	0.93	1.56


Note
- UUC* : Unit Under Calibration
-The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	-	Open	- Position
	X	Close	100% Fan speed
	-	Not Available	

Dimension of inside chamber and sensor installation location (cm)

W x H x D	40	x	40	x 33
a x b x c	10	x	10	x 10

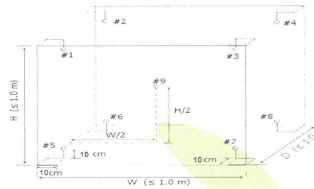

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %

--------- End of Report ---------

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025 CALIBRATION 0416

Certificate of Calibration

Certificate No.: 260318-1-BL007-26
Code No.: BL007-26
Page: 1 of 3

Customer Name:	United Analyst and Engineering Consultant Co., Ltd.
Address:	3 Soi Udom suk 41, Sukhumvit Rd., Bang Chak, Phar Khanong, Bangkok 10260
Equipment:	Electronic Balance
Manufacturer:	Mettler Toledo
Model:	AB204-S/FACT
Serial No.:	1129361010
Asset No. :	UAE.WAS.002/2552
Building :	UAE No.3 Floor : 1 Room : 107
Received Date:	April 2, 2026
Date of Calibation :	April 3, 2026

Calibration Conditions:

Temperature	*start*	21.9 °C	*end*	22.1 °C
Humidity	*start*	60.6 %	*end*	60.1 %
Pressure	*start*	756.6 mmHg	*end*	755.1 mmHg

Calibrated by: Thanachat Chatpahol

Approved by: Suwit Chotnok Signature:

Issued Date: April 7, 2026

Note : 1) The Uncertainties are for a confidence probability of approximately 95%

2) This Certificate is valid only to the item calibrated on date and place of calibration.

3) This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation Scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the United Analyst and Engineering Consultant Co.,Ltd. (UAE)

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025 CALIBRATION 0416

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	AB204-S/FACT	Readability:	0.0001 g
Serial No.:	1129361010	ID No.:	UAE.WAS.002/2552
Max. Capacity:	220 g		
Calibration Date:	April 3, 2026		
Condition As-Received:	In Condition		

Condition of Equipment:

Condition of This Result of Calibration:

1. Calibration Method: This instrument was calibrated by method UAE.CP.CAL.006 In-House Method based on UKAS Lab 14 : 2022

2. Reference Standrads:

Reference Standard:	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Standard Weight Class E2 (OIML)	1 mg to 1 kg	C510641605	METTLER TOLEDO GmbH	C510641605	Mettler-Toledo	3-Mar-27

Instrument	Model	Serial No.	Calibrated By	Certificate No.	Traceability	Due Date
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	SUCCESS	SG-H-00992/68	Success Gateway	26-Nov-26
Thermo-Hygro-Baro Meter	MHB-382SD	AK.46457	TPA	25P4464	TPA	18-Dec-26

3. This certification is traceable to SI Unit
4. This certification was certified only for the indtrument we calibrated
5. This result of calibration wae found accurate as show on date and place of calibration only.
6. Through the reference standard laboratory of Mettler-Toledo GmbH C510641605, SAS accreditation number SCS 0032

Calibraton Result:


1. Repeatability of Reading:

Nominal Value (g)	Standard Deviation of Reading (g)
200*	0.00010

2. Eccentric or off-center loading

A mass of 100 g was placed and moved to various position on pan

The Balance reading obtained is given in the table.

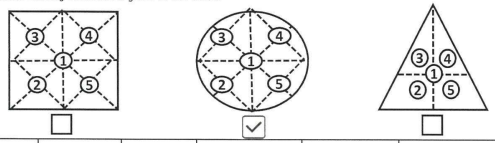

1 (g)	2 (g)	3 (g)	4 (g)	5 (g)	Maximum Difference (g)
100.0025	100.0022	100.0022	100.0029	100.0030	0.0005

เอกสารไม่ควบคุม

United Analyst and Engineering Consultant Co., Ltd.
3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Tel.0 2763 2828 Fax 0 2763 2800 www.uaeconsultant.com E-mail: uae@uaeconsultant.com

NSC -TISI -TIS 17025
CALIBRATION 0416

Certificate No.: 260318-1-BL007-26
Code No.: BL007-26

Equipment:	Electronic Balance	Manufacturer:	Mettler Toledo
Model:	AB204-S/FACT	Readability:	0.0001 g
Serial No.:	1129361010	ID No.:	UAE.WAS.002/2552
Max. Capacity:	220 g		
Calibration Date:	April 3, 2026		

Calibraton Result: (Continued)
Calibraton Range: 0 - 200 g
Calibraton Adjustment: Internal Calibration

3. Error of indication from nominal or conventional mass value:

Nominal Value (g)	Reference Value (g)	Indication (g)	Correction (g)	Uncertainty (± mg)	Coverage Factor k
Unload	0.0000000	0.0000	0.0000	0.17	2.37
0.01	0.0100005	0.0099	0.0001	0.17	2.32
0.05	0.0500003	0.0499	0.0001	0.17	2.32
0.1	0.1000083	0.0999	0.0001	0.17	2.32
0.5	0.5000121	0.5000	0.0000	0.17	2.32
1.0	1.0000119	1.0000	0.0000	0.17	2.32
10.0	10.000033	10.0003	-0.0003	0.17	2.32
40.0	40.000054	40.0010	-0.0010	0.18	2.23
50.0	50.000037	50.0013	-0.0012	0.18	2.23
80.0	80.000098	80.0020	-0.0019	0.19	2.11
100.0	100.000042	100.0025	-0.0024	0.20	2.10
120.0	120.000068	120.0028	-0.0027	0.22	2.06
150.0	150.000079	150.0035	-0.0035	0.24	2.04
160.0	160.000112	160.0036	-0.0035	0.25	2.03
200.0	200.000146	200.0049	-0.0047	0.28	2.00

4. Effect of Tare test:

Tare Load (g)	Test Load (g)	Indication (g)	Correction (g)
100	20.000028	20.0004	-0.0003
	40.000054	40.0009	-0.0008
	60.000070	60.0013	-0.0012
	80.000098	80.0017	-0.0016
	100.000042	100.0021	-0.0021

Remark: -
The report uncertainty of measurment was based on standard uncertainty multiplied by coverage factor k, providing a level of confidence of approximetely 95%

o---o-End-o---o

เอกสารไม่ควบคุม

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

NSC-TISI-TIS17025
CALIBRATION 0008

Certificate of Calibration

Cert. No.: 25TM1001

Equipment :	BOD Incubator
Manufacturer :	ARCO
Model :	UC4-1320
Serial No. :	-
ID No. :	UAE.WAO.018/2559
Submitted by :	United Analyst and Engineering Consultant Co.,Ltd. 3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Location :	Lab Floor 2
Received Order :	07 July 2025
Calibration Date :	07 July 2025
Ambient Temperature :	(26 ± 10) °C
Relative Humidity :	(50 ± 30) %
AC Line Voltage :	(220 ± 22) V
Calibrated by :	Man Pattanapongpaiboon
Approved by :	Kunchit Approved Signatory

( ) Chakrit Waewwanjua
( ) Suwit Imjai
(✓) Kunchit Promprat

Issue Date : 17 July 2025

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Equipment : BOD Incubator
Condition As-Received : Used Item
Reference : 2507-0146OC-2

Cert. No.: 25TM1001

Procedure Used :-

Calibration were conducted using calibration procedure CP-OT02 based on TLAS G-20 according to direct measurement method with Data Acquisition which connected with Resistance Temperature Detector (RTD).

The temperature scale used was based on ITS-90.

Condition of this result of calibration

1. Reference standard instrument:-


Instrument	Serial No.	Cert. No.	Traceable	Due Date
1) Data Acquisition	MY59003411	24LM192	TPA	24 Dec 2025

2. This certificate is valid only to the item calibrated on date and place of calibration.
3. This measurement result is traceable to the International System of Unit maintained through :

Remark : TPA : Technology Promotion Association (Thailand - Japan)

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Fresh air setting : Not Available

Environment during calibration		
	Beginning	Finished
Temp. (°C)	28	28
REL.Humid. (%)	54	57
AC Supply (Volt)	224	226

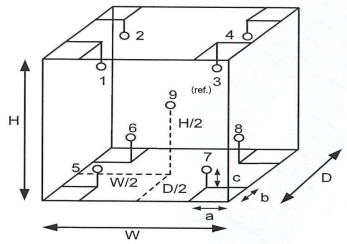

Position :	Ref. Std. ID No.:
1	25-20RTD-2/1
2	25-20RTD-2/2
3	25-20RTD-2/3
4	20RTD-2/4
5	20RTD-2/5
6	20RTD-2/6
7	20RTD-2/7
8	20RTD-2/8
9 (ref.)	20RTD-2/9

Probe Installation Details :

a =	10	cm
b =	10	cm
c =	10	cm

Dimension of Chamber :

D =	0.62	m
W =	1.2	m
H =	1.2	m
Capacity =	0.89	m^3

เอกสารไม่ควบคุม

Equipment : BOD Incubator
Condition As-Received : Used Item
Reference : 2507-0146OC-2

Cert. No.: 25TM1001

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Fresh air setting : Not Available

Calibration Point (°C)	UUC* Setting (°C)	UUC* Reading (°C)	Temperature stability (± °C)	Temperature uniformity (°C)	Overall Variation (°C)	Coverage Factor *k*
20.0	20.0	19.9	0.18	0.60	0.83	2

Calibration Point (°C)	Measured Temperature (°C) Position									Uncertainty (±°C)
	1	2	3	4	5	6	7	8	9 (ref.)	
20.0	20.202	19.900	20.390	20.077	20.111	20.044	20.275	20.173	19.835	0.38

Average* : The average of 30 values in each position.
Temperature stability : One-half of the greatest maximum difference of measured temperature at any one sensor.
Temperature uniformity : The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time or at as close an observation time as possible to determine the temperature pattern or homogeneity within the chamber under steady-state conditions.
Overall Variation : The Difference of the maximum and minimum measured temperatures throughout observation.
UUC* : Unit Under Calibration
Note : The reported uncertainty of measurement was included stability and excluded uniformity .

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor ***k***, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

NSC-TISI-TIS17025
CALIBRATION 0008

Certificate of Calibration

Cert. No.: 25TM1002
Page : 1 of 3

Equipment :	BOD Incubator
Manufacturer :	ARCO
Model :	UC4-1320
Serial No. :	-
ID No. :	UAE.WAO.002/2550
Submitted by :	United Analyst and Engineering Consultant Co.,Ltd. 3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Location :	Lab Floor 2
Received Order :	07 July 2025
Calibration Date :	07 July 2025
Ambient Temperature :	(26 ± 10) °C
Relative Humidity :	(50 ± 30) %
AC Line Voltage :	(220 ± 22) V
Calibrated by :	Man Pattanapongpaiboon
Approved by :	Kunchit Approved Signatory

( ) Chakrit Waewwanjua
( ) Suwit Imjai
(✓) Kunchit Promprat

Issue Date : 17 July 2025

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Equipment : BOD Incubator
Condition As-Received : Used Item
Reference : 2507-0146OC-3

Procedure Used :-

Calibration were conducted using calibration procedure CP-OT02 based on TLAS G-20 according to direct measurement method with Data Acquisition which connected with Resistance Temperature Detector (RTD).

The temperature scale used was based on ITS-90.

Condition of this result of calibration

1. Reference standard instrument:-


Instrument	Serial No.	Cert. No.	Traceable	Due Date
1) Data Acquisition	MY59003411	24LM192	TPA	24 Dec 2025

2. This certificate is valid only to the item calibrated on date and place of calibration.
3. This measurement result is traceable to the International System of Unit maintained through :

Remark : TPA : Technology Promotion Association (Thailand - Japan)

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Fresh air setting : Not Available

Environment during calibration		
	Beginning	Finished
Temp. (°C)	28	28
REL.Humid. (%)	57	58
AC Supply (Volt)	225	226

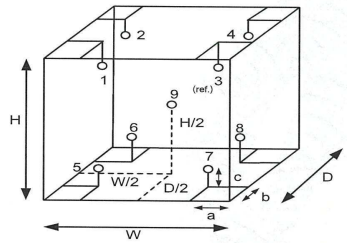

Position :	Ref. Std. ID No.:
1	25-20RTD-2/1
2	25-20RTD-2/2
3	25-20RTD-2/3
4	20RTD-2/4
5	20RTD-2/5
6	20RTD-2/6
7	20RTD-2/7
8	20RTD-2/8
9 (ref.)	20RTD-2/9

Probe Installation Details :

a =	10	cm
b =	10	cm
c =	10	cm

Dimension of Chamber :

D =	0.62	m
W =	1.2	m
H =	1.2	m
Capacity =	0.89	m^3

เอกสารไม่ควบคุม

Equipment : BOD Incubator
Condition As-Received : Used Item
Reference : 2507-0146OC-3
Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Fresh air setting : Not Available

Cert. No.: 25TM1002
Page : 3 of 3

Calibration Point (°C)	UUC* Setting (°C)	UUC* Reading (°C)	Temperature stability (± °C)	Temperature uniformity (°C)	Overall Variation (°C)	Coverage Factor *k*
20.0	20.0	19.8	0.48	0.46	1.2	2

Calibration Point (°C)	Measured Temperature (°C) Position									Uncertainty (±°C)
	1	2	3	4	5	6	7	8	9 (ref.)	
20.0	20.226	20.266	20.121	19.807	19.971	20.055	19.872	19.853	19.925	0.72

Average* : The average of 30 values in each position.
Temperature stability : One-half of the greatest maximum difference of measured temperature at any one sensor.
Temperature uniformity : The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time or at as close an observation time as possible to determine the temperature pattern or homogeneity within the chamber under steady-state conditions.
Overall Variation : The Difference of the maximum and minimum measured temperatures throughout observation.
UUC* : Unit Under Calibration
Note : The reported uncertainty of measurement was included stability and excluded uniformity .

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor ***k***, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

FOSS

Customer Service Report

FOSS South East Asia
3388 Sirinrat Building, 25th – 26th Floor, Unit No. 3388/90,
Rama IV Road, Klongton , Klongtoey, Bangkok, Thailand 10110

Report No.:	15256

Date:	Feb 12, 2026	Customer:	UAE
Job No.:	14589	Address:	Bangkok
Instrument:	kt9 Distillator	Serial:	919105393

	Travel To Customer (Hrs)		Labour (Hrs)		Travel From Customer (Hrs)	
Start	08.00	1.5	09.30	4	—	—
Finish	09.30		13.30		—	—

Job Type						
Application		Special		Standard		
Distributor		Courtesy Visit		Installation		In House	
Digital Service		PMA Approval Check		Quote		PM	X
Internal		Warranty -		Repair		HC Visit	
Training		Sales Support		Investigate		Others	

PMA Type	Smartcare		Smartcare Pro		Fosscare	X
	Smartcare Advance		Fosscare Pro		N/A	

Details of Work / Test
- PM -
- Visual Check
+ No leak - ok
+ No damage - ok
- change PM kit x1 Set - ok
- Function check
+ Dilution - ok
+ Alkal: - ok
+ Receiver - Not Use
+ Steam Drain - ok
-

Instrument Ready for Use	OK	X	Not OK*	

Part No:	Batch	Description	Q'ty
60100196	11.03.2025	PM kit kjeltec 9 Distillator	1

I confirm this report is accurate and complete

Signed FOSS		Signed Customer	
Name:	Anamika Patchara Jokhark	Name	
Tel:		Tel:	0614504094
Email:		Email:	Pitiya.Sukwansa@gmail.com

*Remark:

เอกสารไม่ควบคุม

Please scan QR code

FOSS

Customer Service Report

FOSS South East Asia
3388 Sirinrat Building, 25th – 26th Floor, Unit No. 3388/90,
Rama IV Road, Klongton , Klongtoey, Bangkok, Thailand 10110

Report No.:	15257

Date:	Feb 12, 2026	Customer:	UAE
Job No.:	14590	Address:	Bangkok
Instrument:	DT2520	Serial:	919050060

	Travel To Customer (Hrs)		Labour (Hrs)		Travel From Customer (Hrs)	
Start	–		13.30	1.5	–	
Finish	–	–	15.00		–	–

Job Type						
Application		**Special**		**Standard**		
Distributor		Courtesy Visit		Installation		In House	
Digital Service		PMA Approval Check		Quote		PM	X
Internal		Warranty - _____		Repair		HC Visit	
Training		Sales Support		Investigate		Others	

PMA Type						
	Smartcare		Smartcare Pro		Fosscare	X
	Smartcare Advance		Fosscare Pro		N/A	

Details of Work / Test

- PM
- Visual Check
  - + No leak – ok
  - + No damage – ok
- Change PM kit x 1 Set – ok
- Function Check
  - + Quick mode
    - + Set Temp / Timer – ok
    - + Run – ok
  - heating – ok
  - Lift UP/down – ok
- Clean x22 lids with Grind head

Instrument Ready for Use	OK	X	Not OK*	

Part No:	Batch	Description	Q'ty
60079730	29.09.2025	FOSS PM kit, Digestor 20 pcs / 12 month	1

I confirm this report is accurate and complete

Signed FOSS		Signed Customer	
Name:	Amnat Putchuea Jakkhasiv	Name	
Tel:		Tel:	
Email:		Email:	

*Remark:

เอกสารไม่ควบคุม

Please scan QR code

---

nfi national food institute ministry of industry
สถาบันอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-006-01
Page : 1 of 2

Equipment:	CHAMBER (Incubator)		
Manufacturer:	BINDER	Customer Name:	UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Model:	KB 400	Address:	3 Soi Udomsuk 41, Sukhumvit Road,
Serial No.:	20200000015535		Bangchack, Prakhanong, Bangkok 10260
ID No.:	UAE.MIC.018/2564		
Order No.:	2602303		
Operation No.:	2602303-006		
Date of Receipt:	11 March 2026		
Date of Calibration:	11 March 2026		

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014. based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	DAQ973A RTD	MY59008964 CH#201-209/ RTD#201-209	2502244-001-01	29 March 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by: Mr.Nuttapol Niyomchat, Specialist

Approved by: (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 19 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

nfi national food institute ministry of industry
อุตสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA

MAC THAILAND NSC-TISI-TIS 17025 CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-006-01

Calibration Condition:

Equipment:	CHAMBER (Incubator)	Place of Calibration:	Microbiology Laboratory
UUC* Resolution:	0.1 °C		UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD
Condition of the item:	Normal & Good	Environment Conditions:	Ambient Temperature (17.2 ± 1) °C
	Without adjustment / As Found		Relative Humidity (51.5 ± 4) %
	- Time of record 1 hour 9 minute / point		Line Voltage (229 ± 2) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
35.0	34.78	34.86	34.81	34.83	35.22	35.21	35.22	35.12	34.83	0.28

Table 2 : Reporting of Characterization Results

UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
35.0	35.0	35.0	35.0	0.034	0.39	0.52


Note

- UUC* : Unit Under Calibration
-The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	- Open	-	Position
	X Close	100%	Fan speed
	- Not Available		

Dimension of inside chamber and sensor installation location (cm)						
W x H x D	65	x	125	x	48	
a x b x c	10	x	10	x	10	

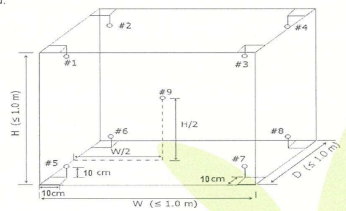

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

nfi national food institute ministry of industry
อุตสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA

MAC THAILAND NSC-TISI-TIS 17025 CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-001-01

Equipment:	CHAMBER (Incubator)		
Manufacturer:	MEMMERT	Customer Name:	UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Model:	IPP260	Address:	3 Soi Udomsuk 41, Sukhumvit Road,
Serial No.:	V615.0187		Bangchack, Prakhanong, Bangkok 10260
ID No.:	UAE.MIC.003/2559		
Order No.:	2602303		
Operation No.:	2602303-001		
Date of Receipt:	11 March 2026		
Date of Calibration:	11 March 2026		

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014. based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	DAQ973A RTD	MY59008964 CH#101-109/ RTD#101-109	2502244-001-01	29 March 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by: Mr.Nuttapol Niyomchat
Specialist

Approved by: (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 19 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุดสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุดสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-001-01

Calibration Condition:

Equipment: CHAMBER (Incubator)

UUC* Resolution: 0.1 °C

Condition of the item: Normal & Good

Without adjustment / As Found

- Time of record 1 hour 9 minute / point

Place of Calibration: Microbiology Laboratory

UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD

Environment Conditions: Ambient Temperature (17.2 ± 1) °C

Relative Humidity (51.5 ± 4) %

Line Voltage (229 ± 2) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
35.0	35.01	34.94	35.20	35.15	35.26	34.99	34.79	34.83	35.02	0.28

Table 2 : Reporting of Characterization Results

UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
35.0	35.0	35.0	35.0	0.069	0.24	0.53

Note

- UUC* : Unit Under Calibration

-The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).

- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.


- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.

- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	-	Open	- Position
	X	Close	100% Fan speed
	-	Not Available	

Dimension of inside chamber and sensor installation location (cm)					
W x H x D	64	x	80	x	50
a x b x c	10	x	10	x	10

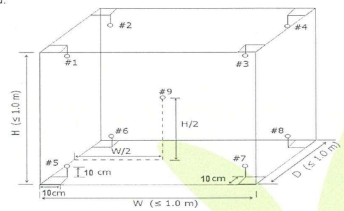

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

NSC-TISI-TIS17025
CALIBRATION 0008

Certificate of Calibration

Cert. No.: 26TM444

Equipment :	Water Bath
Manufacturer :	Memmert
Model :	WNE 14
Serial No. :	L414.1410
ID No. :	UAE.MIC.015/2565
Submitted by :	United Analyst and Engineering Consultant Co.,Ltd. 3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Location :	Microbiology Laboratory (302)
Received Order :	16 March 2026
Calibration Date :	16 March 2026
Ambient Temperature :	(26 ± 10) °C
Relative Humidity :	(50 ± 30) %
AC Line Voltage :	(220 ± 22) V
Calibrated by :	Tawatchai Pama
Approved by :	Kunchit Approved Signatory

( ) Chakrit Waewwanjua
( ) Suwit Imjai
(✓) Kunchit Promprat

Issue Date : 23 March 2026

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Equipment : Water Bath
Condition As-Received : Used Item
Reference : 2603-0427OC-3

Cert. No.: 26TM444
Page : 2 of 3

Procedure Used :-

Calibration were conducted using in-house calibration procedure CP-OT04 Based on ASTM E715 according to direct measurement method with Data Acquisition which connected with Industrial Platinum Resistance Thermometer (IPRT).

The temperature scale used was based on ITS-90.

Condition of this result of calibration

1. Reference standard instrument:-


Instrument	Serial No.	Cert. No.	Traceable	Due Date
1) Data Acquisition	MY59003411	25LM177	TPA	26 Dec 2026

2. This certificate is valid only to the item calibrated on date and place of calibration.
3. This measurement result is traceable to the International System of Unit maintained through :

Remark : TPA : Technology Promotion Association (Thailand - Japan)

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Heat transfer medium used : Water

	Environmental		AC Voltage Supply
	(°C)	(%R.H.)	(Volt)
Beginning of Calibration	26	67	231
Finished of Calibration	25	60	233

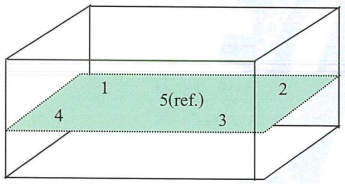

Front

Position :	Ref. Std. ID No.:
1	4804539-001
2	4804539-002
3	4804539-003
4	4804539-004
5(ref.)	4804539-005

เอกสารไม่ควบคุม

Equipment : Water Bath
Condition As-Received : Used Item
Reference : 2603-0427OC-3
Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source

Cert. No.: 26TM444
Page : 3 of 3

Calibration point (°C)	UUC* Setting (°C)	UUC* Reading (°C)	Average* Standard Reading (°C) Position					Uncertainty (± °C)
			1	2	3	4	5 (ref.)	
44.5	44.4	44.4	44.523	44.481	44.496	44.490	44.519	0.15

Calibration point (°C)	Uniformity (°C)	Stability (± °C)	Coverage Factor *k*
44.5	0.10	0.066	2

Average* : The average of 30 values in each position.
Uniformity : The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time or at as close an observation time as possible to determine the temperature pattern or homogeneity within the chamber under steady-state conditions.
Stability : One-half of the greatest maximum difference of measured temperature at any one probe.
UUC* : Unit Under Calibration
Note : The reported uncertainty of measurement was included stability and excluded uniformity.

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor ***k***, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)
CORPORATE SERVICES 3: EQUIPMENT CALIBRATION AND TESTING SERVICES
534/4 PATTANAKARN ROAD SOI 18, SUANLUANG, SUANLUANG BANGKOK 10250
TEL.0-2717-3000-29 FAX.0-2719-9484

ilac-MRA

NSC-TISI-TIS17025
CALIBRATION 0008

Certificate of Calibration

Cert. No.: 25TM1037
Page : 1 of 3

Equipment :	Water Bath
Manufacturer :	Memmert
Model :	WNB 14
Serial No. :	L407.0756
ID No. :	UAE.MIC.024/2550
Submitted by :	United Analyst and Engineering Consultant Co.,Ltd. 3 Soi Udomsuk 41, Sukhumvit Road, Bangchak, Phrakhanong, Bangkok 10260
Location :	Microbiology Laboratory
Received Order :	07 July 2025
Calibration Date :	07 - 08 July 2025
Ambient Temperature :	(26 ± 10) °C
Relative Humidity :	(50 ± 30) %
AC Line Voltage :	(220 ± 22) V
Calibrated by :	Tawatchai Pama
Approved by :	Kunchit Approved Signatory

( ) Chakrit Waewwanjua
( ) Suwit Imjai
(✓) Kunchit Promprat

Issue Date : 14 July 2025

The Uncertainties are for a confidence probability of approximately 95%

This certificate may not be reproduced other than in full, except with the prior written Approval of the head of Corporate Services 3 : Equipment Calibration and Testing Services.

เอกสารไม่ควบคุม

Equipment : Water Bath
Condition As-Received : Used Item
Reference : 2507-0147OC-2

Procedure Used :-

Calibration were conducted using in-house calibration procedure CP-OT04 Based on ASTM E715 according to direct measurement method with Data Acquisition which connected with Industrial Platinum Resistance Thermometer (IPRT).

The temperature scale used was based on ITS-90.

Condition of this result of calibration

1. Reference standard instrument:-


Instrument	Serial No.	Cert. No.	Traceable	Due Date
1) Data Acquisition	MY49023932	24LM119	TPA	27 Jul 2025

2. This certificate is valid only to the item calibrated on date and place of calibration.
3. This measurement result is traceable to the International System of Unit maintained through :

Remark : TPA : Technology Promotion Association (Thailand - Japan)

Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source
Heat transfer medium used : Water

	Environmental		AC Voltage Supply
	(°C)	(%R.H.)	(Volt)
Beginning of Calibration	27	78	228
Finished of Calibration	27	65	229

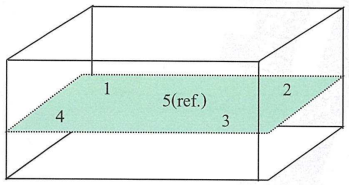

Front

Position :	Ref. Std. ID No.:
1	70RC207
2	70RC208
3	70RC209
4	70RC352
5(ref.)	70RC353

เอกสารไม่ควบคุม

Equipment : Water Bath
Condition As-Received : Used Item
Reference : 2507-0147OC-2
Result of Calibration :- (*) Without Adjustment
Function of UUC* : Temperature Source

Cert. No.: 25TM1037

Calibration point (°C)	UUC* Setting (°C)	UUC* Reading (°C)	Average* Standard Reading (°C) Position 1	2	3	4	5 (ref.)	Uncertainty (± °C)
44.5	45.3	45.3	44.491	44.464	44.480	44.497	44.485	0.15
45.0	45.8	45.8	44.959	44.936	44.957	44.970	44.957	0.15

Calibration point (°C)	Uniformity (°C)	Stability (± °C)	Coverage Factor *k*
44.5	0.071	0.049	2
45.0	0.080	0.053	2

Average* : The average of 30 values in each position.
Uniformity : The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time or at as close an observation time as possible to determine the temperature pattern or homogeneity within the chamber under steady-state conditions.
Stability : One-half of the greatest maximum difference of measured temperature at any one probe.
UUC* : Unit Under Calibration
Note : The reported uncertainty of measurement was included stability and excluded uniformity.

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor ***k***, providing a level of confidence of approximately 95 %.

-o0o-

เอกสารไม่ควบคุม

สถาบันอาหาร
national food institute
ministry of industry
สถาบันพัฒนาอุตสาหกรรมเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-007-01

Equipment: Autoclave
Manufacturer: ALP
Model: CL-40L
Serial No.: 808763
ID No.: UAE.MIC.026/2563
Order No.: 2602303
Operation No.: 2602303-007
Date of Receipt: 11 March 2026
Date of Calibration: 11 March 2026

Customer Name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road, Bangchack, Prakhanong, Bangkok 10260

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 3 standard data loggers with RTDs into its autoclave, in accordance with W-TE-018. based on BS 2646-1:2021, Autoclaves for sterilization in laboratories Part 1: Design, construction, safety and performance - specification.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with RTD (Data Logger)	HiTemp140-PT	S33753	2502245-002-01	22 March 2026	NATIONAL FOOD INSTITUTE
	HiTemp140	S25602	2601300-004-01	10 January 2027	NATIONAL FOOD INSTITUTE
	PRTemp140	R38546	2601300-003-01	10 January 2027	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by Mr.Nuttapol Niyomchat
Specialist

Approved by (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 19 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel. +66(0) 2422 8688 Fax. +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุดสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุดสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-007-01

Calibration Condition:

Equipment: Autoclave

Resolution: 0.1 °C

Condition of the item: Normal & Good

Without adjustment / As Found

- Setting program function sterilization STERILIZE/NORMAL

- Time of sterilizatior 15 Minute at 115.0, 121.0 °C

Place of Calibration: Room 301

UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.

Environment Conditions: Ambient Temperature (26.0 ± 1) °C

Relative Humidity (47.5 ± 3) %

Line Voltage (228.5 ± 4) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. Std.# 1	Std.# 2 (REF)	Std.# 3	Measurement Uncertainty (±°C)
115.0	115.29	115.33	115.37	0.64
121.0	121.17	121.18	121.06	0.64

Table 2 : Reporting of Characterization Results


UUC* Setting (°C)	Max	UUC* Reading (°C) Min	Average	MPa	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
115.0	115.1	114.9	115.0	0.08	0.23	0.53	0.51
121.0	121.1	120.9	121.0	0.12	0.24	0.67	0.67

Note

- UUC* : Unit Under Calibration
- The quoted uncertainty include " Stability " and " Loading effect (20% of Temp Uniformity)"
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of the maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Standard at position
Std #1 - Attached to the load temperature probe, within 20 mm.
Std #2 (REF) - In the upper half of the chamber.
Std #3 - In the chamber drain, within 100 mm.



The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %

--------- End of Report ---------

เอกสารไม่ควบคุม

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax +66(0) 2422 8545
nfi.or.th

สุดสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุดสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2504165-003-01
Client name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road,
Bangchack, Prakhanong, Bangkok 10260

Equipment: Autoclave
Manufacturer: ALP
Model: CL-40L
Serial No.: 807298
ID No.: UAE.MIC.019/2560
Order No.: 2504165
Operation No.: 2504165-003
Date of Receipt: 31 July 2025
Date of Calibration: 31 July 2025

Calibrated by Mr.Yothin Charoensuk
Scientist

Approved by (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 7 August 2025

The uncertainties are for a confidence probability of approximately 95 %.

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

เอกสารไม่ควบคุม

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax +66(0) 2422 8545
nfi.or.th

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center
national food institute ministry of industry

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Report

Certificate No.: 2504165-003-01

Equipment: Autoclave

Model: CL-40L Serial No.: 807298

Resolution: 1 °C ID No.: UAE.MIC.019/2560

Manufacturer: ALP

Date of Calibration: 31 July 2025

Location: Washing Room (301), UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.

Environment Condition: Ambient Temperature (29 ± 1) °C

Relative Humidity (64 ± 1) %

Line Voltage (225 ± 1) Volt

Condition of this results of Calibration:

1. This instrument was calibrated by insert 3 standard Data loggers with RTD into its autoclave and calibration according to W-TE-018 based on BS 2646-1:2021, Autoclaves for sterilization in laboratories Part 1: Design, construction, safety and performance - Specification.
   - The temperature scale used was based on ITS - 90.
   - All data show below were final values and the initial data may be obtained upon request.
2. Reference Standard Instrument :

Instrument	Model	Serial No.	Certificate No.	Due Date	Through
Digital Thermometer with RTD (Data Logger)	HiTemp140-PT	T20607	NC-25-03-18-168	11-Mar-26	MADGETECH, INC.
	HiTemp140-PT	T20610	NC-25-03-18-179	11-Mar-26	MADGETECH, INC.
	HiTemp140-PT	T20615	NC-25-03-18-175	11-Mar-26	MADGETECH, INC.

3. This certificate is traceable to International System of Units (SI Units).
4. This certificate was certified only for the instrument we calibrated.
5. This result of calibration was found accurate as shown on date and place of calibration only.
6. This standard does not apply to sterilizers or disinfectors used for medical, dental, pharmaceutical.
7. Condition of Calibrated item : Good

   UUC Description : Setting program function sterilization : STERILIZE/NORMAL

   Time of sterilization 15 Minute At 121 °C
8. Result of Calibration : [X] Without adjustment [ ] After adjustment

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center
national food institute ministry of industry

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Report

Certificate No.: 2504165-003-01

Equipment: Autoclave

Model: CL-40L Serial No.: 807298

Resolution: 1 °C ID No.: UAE.MIC.019/2560

Manufacturer: ALP

Date of Calibration: 31 July 2025

Calibration point: 121 °C

Calibration result:

Calibration Condition	Temperature (°C)	Relative Humidity (%)	Line Voltage (Volt)
Min	28.0	63	224
Max	30.0	65	226

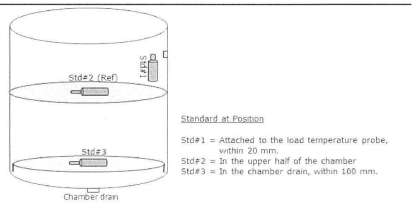


Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.2 is REF)			Uncertainty ± (°C)
	Std.# 1	Std.# 2 (Ref)	Std.# 3	
121	122.63	122.65	122.64	0.69

Table 2 : Reporting of Characterization Result

UUC* Setting (°C)	UUC* Reading				Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
	Min (°C)	Max (°C)	Average (°C)	MPa			
122	122	122	122	0.11	0.23	0.090	0.45

Note

The quoted uncertainty include " Stability " and " Loading effect (20% of Uniformity)"

UUC* = Unit Under Calibration

Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.

Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.

Overall Variation = The difference of the maximum and minimum measured temperatures througout observation time.

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor k= 2, providing a level of confidence of approximately 95 %.

--------- End ---------

F-CS-012 Revision: 01 Date: 20-04-65

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-001-01
Page : 1 of 2

Equipment:	pH Meter
Manufacturer:	METTLER TOLEDO
Model:	SevenEasy pH
Serial No.:	1231155210
ID No.:	UAE.WAT.010/2553
Order No.:	2601956
Operation No.:	2601956-001
Date of Receipt:	20 February 2026
Date of Calibration:	23 February 2026

Customer name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road,
Bangchack, Prakhanong, Bangkok 10260

Metrological traceability:

1.Calibration Method W-CC-002 : In house method based on direct measurement by using standard voltage calibrator and certified reference material (CRM)

2. Reference Standards / Certified Reference Material

Instruments	Serial / ID No.	Manufacturer	Certificate No.	Due Date
2.1 DC Voltage Calibrator	2709007	Fluke	25E1753	22 May 2026
2.2 Digital Thermometer	2709007	Fluke	2600328-002-01	25 October 2026
2.3 Thermo-Hygro Meter	NFI.BTH 014/23	testo	2503232-014-01	10 June 2026
Certified Reference Material	**Lot. No.**	**Manufacturer**	**Ref N**	**Expire Date**
2.4 pH buffer 4.008 (Primary pH buffer Solution)	1016435	CPAchem	PH216.L5	25 July 2026
2.5 pH buffer 6.865 (Primary pH buffer Solution)	1016432	CPAchem	PH217.L5	25 July 2026
2.6 pH buffer 10.01 (Primary pH buffer Solution)	1088003	CPAchem	PH220.L5	18 March 2026
2.7 pH buffer 7.00 (Standard pH buffer Solution)	C03282	HACH LANGE GmbH	S11M004	11 June 2027

3. This certification is traceable to The International System of Unit (SI Unit)
3.1 Instruments No.2.1 through NSC-ONSC Laboratory Accredition of Calibration No.0008 (TPA)
3.2 Instruments No.2.2 and 2.3 through NSC-ONSC Laboratory Accredition of Calibration No.0061 (NFI)
3.3 Certified Reference Material No.2.4 to 2.6 traceable to CPAchem Ltd is accredited to ISO 17034 (ANSI accredited No. AR-1835)
3.4 Certified Reference Material No.2.7 traceable to Hach Lange GmbH is accredited to DIN EN ISO 17034 (DAkkS accredited No.D-RM-15184-01-00)
4. This certificate was certified only for the instrument we calibrated.
5. This result of calibration was found accurate as shown on date and place of calibration only.

Calibrated by Mr.Manas Somsak
Specialist

Approved by
(Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 2 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-001-01
Page : 2 of 2

Calibration Condition:

Place of Calibration :	Chemical Calibration Laboratory, National Food Institute		
Environment Condition:	Ambient Temperature (24.0 ± 0.2) °C	Relative Humidity:	(49.8 ± 2) %
Calibration Item Condition:	Used Item	Type:	Bench top
	Range: 0 - 14 pH	Resolution:	0.01 pH, 1 mV

Calibration results:

1. Calibration of pH Meter (Manual Temperature Compensation at 25 °C)

Nominal pH	DC Voltage Standard (mV)	Average Indicator Reading mV	Average Indicator Reading pH	Uncertainty (±mV)	Coverage Factor (k)
0	414.119	414	-0.01	0.58	2.00
2	295.813	296	1.99	0.58	2.00
4	177.463	178	4.00	0.58	2.00
6	59.159	59	6.00	0.58	2.00
7	0.000	0	7.00	0.58	2.00
8	-59.159	-59	8.00	0.58	2.00
10	-177.462	-177	10.00	0.58	2.00
12	-295.813	-296	12.00	0.58	2.00
14	-414.119	-414	14.00	0.58	2.00

2. Calibration of pH Meter with Electrode (Manual Temperature Compensation at 25 °C)

Equipment: pH Electrode Manufacturer: METTLER TOLEDO Model: InLab Solids
Serial No.: C507554932 ID.No. N/A Type: Combined Electrode

Performance of Electrode system (Three-Point Calibration at pH 4, 7 and 9)

Certified Value @25 °C (pH)	Average Indicator Reading pH	Average Indicator Reading mV	Relative Slope (%)	Uncertainty (± pH)	Coverage Factor (k)
4.008	4.01	184	-	0.0071	2.00
7.000	7.00	8	99.5	0.0086	2.00
10.010	10.01	-166	97.7	0.0085	2.00
6.876	6.88	15	-	0.0071	2.00

The reported uncertainty of measurement was based on a standard uncertainty multiplied by a coverage factor k= 2, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

nfi national food institute ministry of industry
สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA

MRA THAILAND
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-002-01

Equipment:	Digital Thermometer with RTD (pH Meter)		
Manufacturer:	METTLER TOLEDO	**Customer Name:**	UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Model:	SevenEasy pH	**Address:**	3 Soi Udomsuk 41, Sukhumvit Road,
Serial No.:	1231155210		Bangchack, Prakhanong, Bangkok 10260
ID No.:	UAE.WAT.010/2553		
Order No.:	2601956		
Operation No.:	2601956-002		
Date of Receipt:	20 February 2026		
Date of Calibration:	23 February 2026		

Metrological traceability:

1. Calibration Method:
   - NFI Method W-TE-025 : based on comparison with a standard thermometer.
   - TM-CG01-TT01-V04: CALIBRATION OF DIGITAL THERMOMETER WITH TEMPERATURE SENSORS.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
2. Reference Standard Instrument:

Instrument	Model / Type	Serial No. / ID No.	Certificate No.	Due Date	Through
HANDHELD THERMOMETER	1523	2118154	PSL-T 0926/68	26-Jun-26	TISTR
Platinum Resistance Thermometer (PRT)	5627A	877332			

Support Equipment : - Low Temperature Bath (AMETEK RTC-187), Model: RTC-187C , S/N: 670930-00018

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by: Mr.Manas Somsak, Specialist

Approved by: (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 2 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

nfi national food institute ministry of industry
สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA
MRA THAILAND
NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2601956-002-01

Calibration Condition :

Equipment:	Digital Thermometer with RTD	**Place of Calibration:**	Chemical Calibration Laboratory
UUC* Resolution:	0.1 °C		National Food Institute
Condition of the item:	Normal & Good	**Environment Conditions:**	Ambient Temperature (23.1 ± 0.3) °C
	Without adjustment / AS FOUND		Relative Humidity (49.8 ± 2) %
			Line Voltage (220 ± 10) V.

Calibration results:

- Temperature Measurement Results

Calibration Point (°C)	Standard Thermometer Value (°C)	UUC* Reading Value (°C)	UUC* Correction Value (°C)	Measurement Uncertainty (± °C)
20	20.002	20.1	-0.1	0.098
25	25.001	25.1	-0.1	0.098
30	30.003	30.1	-0.1	0.098

Note

- UUC* : Unit Under Calibration
- The probe was immersed in a liquid bath or a dry bath to a minimum depth of 120 mm.
- Description of probe, model : N/A S/N : N/A

Dimension of probe : Diameter 4 mm. Length 120 mm. Sheath material: Plastic

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %

--------- End of Report ---------

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

SCIENCE TECH CO., LTD.

Head Office : 321/43 Nanglinchee Rd. Chongnondsee Yannawa Bangkok 10210 Thailand Tel. 0-2285-4101 Fax. 0-2285-4856 www.sciencetech.th.com
Science Tech Laboratory : 279/27-29 Soi Watpoman Sathupradit 19 Rd. Chongnondsee Yannawa Bangkok 10120 Tel. 0-2285-4101 Fax. 0-2285-4856

NSC-TISI-TIS 17025 CALIBRATION 0402

Job No. : J018/26 **Certificate No. : ST018/26**

Certificate of Calibration

Equipment :	pH/ISE Meter
Manufacturer :	Orion
Made in :	USA
Model :	STAR A214
Serial No. :	X36836
ID No. :	UAE.WAT.025/2560
Range :	0 to 14 pH
Resolution :	0.001 pH 0.1 mV
UUC Condition As-Received :	Good
Submitted by :	บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด 3 ซอยอุดมสุข 41 ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพฯ 10260
Ambient Temperature :	(25 ± 3) °C
Relative Humidity :	(50 ± 15)%
Calibration Procedure :	In - house method : WI-ST-LAB-7.2/I based on direct measurement by using standard voltage calibrator
Issue date :	Wednesday, May 20, 2026

Calibrateded by : Khannika Sangkham **Approved by :**

(Khannika Sangkham)
Laboratory manager

The uncertainties are for a confidence probability of approximately 95%

This certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation Scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other **than in full, except with the prior written approval of the Science Tech Laboratory.**

เอกสารไม่ควบคุม

Certificate of Calibration

Job No. : J018/26 **Certificate No. : ST018/26**

Received date : Friday, May 15, 2026

Calibration date : Monday, May 18, 2026

Condition of this calibration result

1 Reference standard instrument : Voltage calibrator Yokogawa 7651 S/N. 91H441999 Certificate No. 26E7
Due date 5 June 2026 TECHNOLOGY PROMOTION ASSOCIATION (THAILAND-JAPAN)

2 This certificate was certified only for the instrument we calibrated

3 This result of calibration was found accurate as shown on date and place of calibration only

Result of Calibration

Function : pH meter

Performing standard curve by Voltage Calibrator at pH (4,7,10)

Unit Under Calibration	Applied Voltage (mV)	Nominal Value (pH)	UUC Reading (mV)	Correction (mV)	Uncertainty (± mV)	k Factor
pH Meter	177.48	4	177.4	0.1	0.060	2.00
Model STAR A214	0.0	7	0.0	0.0	0.064	2.00
S/N. X36836	-177.48	10	-177.4	-0.1	0.078	2.00

This reported uncertainty of measurment was based on a standard uncertainty multiplied by a coverage factor k , providing a level of confidence of approximately 95%

-oooo- End of Certificate of Calibration -oooo-

เอกสารไม่ควบคุม

SCIENCE TECH CO., LTD.

Head Office : 321/43 Nanglinchee Rd. Chongnondsee Yannawa Bangkok 10120
Thailand Tel. 0-2285-4101 Fax. 0-2285-4856 www.sciencetech.th.com
Science Tech Laboratory : 279/27-29 Soi Watpoman Sathupradit 19 Rd.
Chongnondsee Yannawa Bangkok 10120 Tel. 0-2285-4101 Fax. 0-2285-4856

Certificate of Calibration

Equipment :	pH/ISE Meter
Manufacturer :	Orion
Made in :	USA.
Model :	STAR A214
Serial No. :	X36836
ID No. :	UAE.WAT.025/2560
Ion Selective Model :	9409BN
Serial No. :	ZW1-18420
Referance Electrode Model :	900100
Serial No. :	ZW1-16834
Range :	0 to 14 pH
Resolution :	0.001 pH 0.1 mV
Submitted by :	บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด 3 ซอยอุดมสุข 41 ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพฯ 10260
Ambient Temperature :	(25 ± 3) ºC
Relative Humidity :	(50 ± 15)%
Issue date :	Wednesday, May 20, 2026
Calibrateded by :	**Khannika Sangkham**

Approved by :

(Khannika Sangkham)
Laboratory manager

เอกสารไม่ควบคุม

Condition of this calibration result

1 Reference standard materials : Certified Fluoride standard reference solution (Directly measured by differential potentiometry with the aid of potassium fluoride "quasi without transference" against solutions prepared from primary reference materials from NIST)

2 This certificate was certified only for the instrument we calibrated

3 This result of calibration was found accurate as shown on date and place of calibration only

Result of Calibration

Function : pH/ISE Meter with Probe

Direct Measurement

First Standard concentrated	=	0.1	ppm
Secondary Standard concentrated	=	1	ppm
Tertiary Standard concentrated	=	10	ppm
Fourthly Standard concentrated	=	100	ppm
Slope	=	**-57.9**	mV/Dec.

Channel : 1

Unit Under Calibration	Standard Concentrated (ppm)	UUC Reading (ppm)	Correction (ppm)	Stdev (ppm)
Model :	0.1	0.107	-0.007	0.00
9409BN S/N. ZW1-18420	1	1.02	-0.02	0.01
900100 S/N. ZW1-16834	10	10.1	-0.1	-0.05
	100	100	0	0.46

-oo0oo-

เอกสารไม่ควบคุม

สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-006-01

Equipment:	CHAMBER (Incubator)
Manufacturer:	BINDER
Model:	KB 400
Serial No.:	20200000015535
ID No.:	UAE.MIC.018/2564
Order No.:	2602303
Operation No.:	2602303-006
Date of Receipt:	11 March 2026
Date of Calibration:	11 March 2026

Customer Name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road,
Bangchack, Prakhanong, Bangkok 10260

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014.
     based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	DAQ973A RTD	MY59008964 CH#201-209/ RTD#201-209	2502244-001-01	29 March 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by Mr.Nuttapol Niyomchat
Specialist

Approved by (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 19 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการอุตสาหกรรมอาหาร
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

NSC-TISI-TIS 17025
CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-006-01

Calibration Condition:

Equipment:	CHAMBER (Incubator)	**Place of Calibration:**	Microbiology Laboratory
UUC* Resolution:	0.1 °C		UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD
Condition of the item:	Normal & Good	**Environment Conditions:**	Ambient Temperature (17.2 ± 1) °C
	Without adjustment / As Found		Relative Humidity (51.5 ± 4) %
	- Time of record 1 hour 9 minute / point		Line Voltage (229 ± 2) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
35.0	34.78	34.86	34.81	34.83	35.22	35.21	35.22	35.12	34.83	0.28

Table 2 : Reporting of Characterization Results


UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
35.0	35.0	35.0	35.0	0.034	0.39	0.52

Note

- UUC* : Unit Under Calibration
- The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper:	-	Open	- Position
	X	Close	100% Fan speed
	-	Not Available	
Dimension of inside chamber and sensor installation location (cm)			
W x H x D	65 x 125 x 48		
a x b x c	10 x 10 x 10		

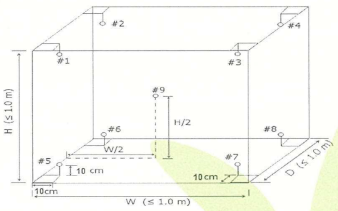

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุขสาหกรรมอาหาร
national food institute ministry of industry
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA

THAILAND NSC-TISI-TIS 17025 CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-001-01

Equipment:	CHAMBER (Incubator)
Manufacturer:	MEMMERT
Model:	IPP260
Serial No.:	V615.0187
ID No.:	UAE.MIC.003/2559
Order No.:	2602303
Operation No.:	2602303-001
Date of Receipt:	11 March 2026
Date of Calibration:	11 March 2026

Customer Name: UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD.
Address: 3 Soi Udomsuk 41, Sukhumvit Road, Bangchack, Prakhanong, Bangkok 10260

Metrological traceability:

1. Calibration Method:
   - This instrument was calibrated by inserting 9 standard thermometers into its chamber, in accordance with W-TE-014. based on TLAS G-20-1/02-08 (E): Guidelines for Calibration and Checks of Temperature Controlled Enclosures.
   - The temperature scale used in this laboratory is the International Temperature Scale of 1990 (ITS-90).
   - All data shown below are final values, and the initial data may be obtained upon request.
2. Reference Standard Instrument:

Instrument	Model/Type	Serial No./ID No.	Certificate No.	Due Date	Through
Digital Thermometer with sensor	DAQ973A RTD	MY59008964 CH#101-109/ RTD#101-109	2502244-001-01	29 March 2026	NATIONAL FOOD INSTITUTE

3. This certificate is traceable to the International System of Units (SI).
4. This certificate is valid only for the instrument that was calibrated.
5. The result of this calibration was found to be accurate only on the date and at the place of calibration shown.

Calibrated by Mr.Nuttapol Niyomchat
Specialist

Approved by (Mr.Pheraphat Tuanjit)
Manager, Division of Calibration Laboratory
Responsible for the Technical Management Team

Date of Issue: 19 March 2026

This Certificate is issued in accordance with the conditions of accreditation granted by the Thai Laboratory Accreditation scheme which has assessed the measurement capability of the laboratory and its traceability to recognized national standards and to the units of measurement realized at the corresponding national standards laboratory. This certificate may not be reproduced other than in full except with the prior written approval of the National Food Institute.

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

สุขสาหกรรมพัฒนามูลนิธิเพื่อสถาบันอาหาร
ศูนย์บริการห้องปฏิบัติการสุขสาหกรรมอาหาร
national food institute ministry of industry
Foundation for Industrial Development National Food Institute
Food Industrial Laboratory Service Center

ilac-MRA
THAILAND NSC-TISI-TIS 17025 CALIBRATION 0061

Calibration Certificate

Certificate No.: 2602303-001-01

Calibration Condition:

Equipment:	CHAMBER (Incubator)	**Place of Calibration:**	Microbiology Laboratory
UUC* Resolution:	0.1 °C		UNITED ANALYST AND ENGINEERING CONSULTANT CO.,LTD
Condition of the item:	Normal & Good	**Environment Conditions:**	Ambient Temperature (17.2 ± 1) °C
	Without adjustment / As Found		Relative Humidity (51.5 ± 4) %
	- Time of record 1 hour 9 minute / point		Line Voltage (229 ± 2) V.

Calibration Results:

Table1 : Reporting of Temperature

Calibration Point (°C)	Measured Temperature (°C) @ Sensor No. (Sensor No.9 is REF) Std.#1	Std.#2	Std.#3	Std.#4	Std.#5	Std.#6	Std.#7	Std.#8	Std.#9	Measurement Uncertainty (±°C)
35.0	35.01	34.94	35.20	35.15	35.26	34.99	34.79	34.83	35.02	0.28

Table 2 : Reporting of Characterization Results

UUC* Setting (°C)	UUC* Reading (°C) Max	Min	Average	Stability ± (°C)	Uniformity (°C)	Overall Variation (°C)
35.0	35.0	35.0	35.0	0.069	0.24	0.53


Note

- UUC* : Unit Under Calibration
- The quoted uncertainty includes contributions from 'Stability' and 'Loading Effect (20% of Temperature Uniformity).
- Stability = One-half of the greatest maximum difference of measured temperatures at any one sensors, for at least half an hour after reaching steady state.
- Uniformity = The maximum difference of measured temperatures at any sensors and the measured temperature at the reference location which are observed at the same time.
- Overall Variation = The difference of The maximum and minimum measured temperatures througout observation time.

For more information, details of the sensor installation should be reported.

Fresh air Damper	- Open	-	Position
	X Close	100%	Fan speed
	- Not Available		

Dimension of inside chamber and sensor installation location (cm)					
W x H x D	64	x	80	x	50
a x b x c	10	x	10	x	10

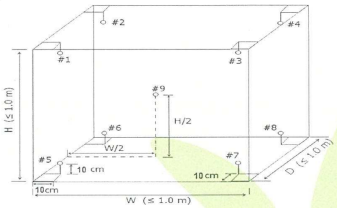

The report uncertainty of measurement was based on standard uncertainty multiplied by coverage factor $k = 2$, providing a level of confidence of approximately 95 %.

--------- End of Report ---------

F-CS-009 Revision: 02 Date: 01-10-68

2008 ซอยอรุณอมรินทร์ 36 ถนนอรุณอมรินทร์ แขวงบางยี่ขัน เขตบางพลัด กรุงเทพมหานคร 10700
2008 Soi 36, Arun Amarin Road, Bang Yi Khan Subdistrict, Bang Phlat District, Bangkok 10700, Thailand
Tel: +66(0) 2422 8688 Fax: +66(0) 2422 8545
nfi.or.th

เอกสารไม่ควบคุม

SINGHA COMPLEX

ภาคผนวก ฉ

หนังสือขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

ที่ อก ๐๓๑๐(๑)/ ๓๗๗๘ กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๑๐ มิถุนายน ๒๕๖๙

เรื่อง เปลี่ยนแปลงบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๒๙ พฤษภาคม ๒๕๖๙

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอเปลี่ยนแปลงบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

๑. ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔ รายชื่อ

๑) นายณัฐพงศ์ เมืองชัย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๕
๒) นายณัฏฐชัย พรหมอารักษ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๖
๓) นายคุณานนท์ ฤทธาคุณานนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๓
๔) นางสาวบุณยาพร บุญถนอมศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๓

๒. ให้เพิ่มเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๒๔ ราย

๑) นายเจษฎา มาศประสิทธิ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๐
๒) นางสาวนฤมล ยินดี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๑
๓) นายสุรชัย บุพศิริ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๒
๔) นางสาวปิยพร วรดี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๓
๕) นางสาวสิริกันยา สุรจิต	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๔
๖) นางสาววทันยา วิเชียรผลา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๕
๗) นายธนดล แก้วประสงค์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๖
๘) นายวิทิต สงแสง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๗
๙) นางสาวดวงกมล ศรีดา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๘
๑๐) นายภูวฤทธิ์ ลีล้าน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๑๙
๑๑) นายคณิน หนองหว้า	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๐
๑๒) นายต้นน้ำ สังข์นคร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๑
๑๓) นายวัชรพงษ์ วราศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๓
๑๔) นายจักรพงษ์ สัตย์สาร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๔
๑๕) นายประชัย ไพรี่ทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๔
๑๖) นายชนะพันธ์ อภินพหิรัณย์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๕

๑๗) นายกมลไท...

๑๗) นายกมลไท ชัยสิริสมบัติ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๖
๑๘) นายธนเศ ทรัพย์ธำรงค์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๗
๑๙) นางสาวภัทรสุดา สุธรรมมา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๘
๒๐) นางสาวสุนันทา สมรูป	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๒๙
๒๑) นางสาวมนรดา มั่นศาสตร์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๓๐
๒๒) นางสาวรัชนีภรณ์ สาระพันธ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๓๑
๒๓) นายธณวิชย์ บุญเอก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๓๒
๒๔) นางสาวอาทิตยา เล็กน้อย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๓๓

อนึ่ง หนังสือฉบับนี้จะสิ้นอายุพร้อมหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายศิระ จันทร์เฉิด)
นักวิทยาศาสตร์เชี่ยวชาญ รักษาราชการแทน
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
สำเนาถูกต้อง

ที่ อก ๐๓๑๐(๑)/ ๓๗๓๘ กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๕ มีนาคม ๒๕๖๙

เรื่อง เปลี่ยนแปลงบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๑๐ กุมภาพันธ์ ๒๕๖๙

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอเปลี่ยนแปลงบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

๑. ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔ ราย

๑) นายพีรณัฐ เจริญผล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓
๒) นายเจษฎา ช่วยตรึก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๗
๓) นายศุภกร สวนศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๓๓๔
๔) นางสาวณัฐกฤตา พลนิกรกิจ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๐

๒. ให้เพิ่มเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๙ ราย

๑) นายเกียรติศักดิ์ ทำทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๑
๒) นางสาวธนภร แฉะกระโทก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๒
๓) นางสาวรยา ปรีดี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๓
๔) นางสาวญาณินดา แช่มเล็ก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๔
๕) นางสาวนัสพร การงานดี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๕
๖) นายธนากร เชื้อมาก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๖
๗) นางสาวพัชรินทร์ แพรกทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๗
๘) นางสาวนรินทร รินทราช	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๘
๙) นางสาวชญานี เมินกระโทก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๙

อนึ่ง หนังสือฉบับนี้จะสิ้นอายุพร้อมหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นางสาวปัทมวรรณ คุณประเสริฐ)
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
สำเนาถูกต้อง

ที่ อก ๐๓๑๐(๑)/ ๘๓๐๒ กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๘ ตุลาคม ๒๕๖๘

เรื่อง ยกเลิกบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๒๕ กันยายน ๒๕๖๘

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอยกเลิกบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๓ ราย ได้แก่

๑) นางสาวอารียา ทรารมย์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๗
๒) นางสาวศรีเพชร ทองขาว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๗
๓) นางสาวปรีณา แดนชนบ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๙

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นางสาวปัทมวรรณ คุณประเสริฐ)
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED
สำเนาถูกต้อง

ที่ อก ๐๓๑๐(๑)/ ๖๙๗ ๓

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๒๕ สิงหาคม ๒๕๖๘

เรื่อง ยกเลิกบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๗ สิงหาคม ๒๕๖๘

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๓ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอยกเลิกบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๕ ราย ได้แก่

๑) นายคณิติน พงษ์อิศรานุพร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๔
๒) นายธีรวัฒน์ ธรรมสุวรรณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๘
๓) นายอาทิตย์ ตาภา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๒
๔) นางสาวกมลชนก ปุนคำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๒
๕) นายวีระพงษ์ แสงทำนิ้ง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๘

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายศิระ จันทร์เฉิด)
นักวิทยาศาสตร์เชี่ยวชาญ รักษาราชการแทน
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

Green Industry "อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

ที่ อก ๐๓๑๐(๑)/ ๕๖๙๑

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๗ กรกฎาคม ๒๕๖๘

เรื่อง เปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๙ พฤษภาคม ๒๕๖๘

สิ่งที่ส่งมาด้วย เอกสารแนบท้ายหนังสือเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด จำนวน ๒ แผ่น

ตามหนังสือที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๓ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์ ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว มีความเห็นดังนี้

๑. ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๓ ราย

๑) นายสุขสันต์ พันสิงห์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑
๒) นางสาวสุภัสสรา เอี่ยนเงิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๙
๓) นางสาวชามันดา กิมาคม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๖

๒. ให้เพิ่มผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๑ ราย

นายสุขสันต์ พันสิงห์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๗

๓. ให้เพิ่มขอบข่ายสารมลพิษที่วิเคราะห์ในน้ำใต้ดิน อากาศเสีย และดิน ตามสิ่งที่ส่งมาด้วย

อนึ่ง หนังสือฉบับนี้จะหมดอายุพร้อมหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

(นายประสม คำรงพงษ์)
ผู้อำนวยการกองวิจัยและเตือนภัยมลพิษโรงงาน
ปฏิบัติราชการแทนอธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๙๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

Green Industry "อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

เอกสารแนบท้ายหนังสือเปลี่ยนแปลงบุคลากรและสารมลพิษที่วิเคราะห์
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๕๖๙๑ ลงวันที่ ๐๗ กรกฎาคม ๒๕๖๘

ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม จำนวน ๑๑ รายการ

น้ำใต้ดิน จำนวน 4 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Aluminum	Digestion, Inductively Coupled Plasma Method[1]
2	Copper	1) Digestion, Flame Atomic Absorption Spectrometric Method[1] 2) Digestion, Inductively Coupled Plasma Method[1]
3	Iron	1) Digestion, Flame Atomic Absorption Spectrometric Method[1] 2) Digestion, Inductively Coupled Plasma Method[1]
4	Molybdenum	Digestion, Inductively Coupled Plasma Method[1]

อากาศเสีย (ปล่องระบาย) จำนวน 1 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Oxides of Nitrogen	Absorption Sampling, Ion Chromatographic Method[2]

ดิน จำนวน 6 รายการ

ลำดับที่	สารมลพิษ	วิธีวิเคราะห์
1	Aluminum	Digestion, Inductively Coupled Plasma Method[3,5]
2	Copper	1) Digestion, Flame Atomic Absorption Spectrometric Method[3,6] 2) Digestion, Inductively Coupled Plasma Method[3,5]
3	Iron	1) Digestion, Flame Atomic Absorption Spectrometric Method[3,6] 2) Digestion, Inductively Coupled Plasma Method[3,5]
4	Molybdenum	Digestion, Inductively Coupled Plasma Method[3,6]
5	pH	Electrometric Method[8]
6	TPH (C_5-C_8)	Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[4,7]

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

เอกสารอ้างอิง

1. APHA, AWWA, WEF. **Standard Methods for the Examination of Water and Wastewater.** 24th ed. Washington, DC: APHA, 2023.

2. United States Environmental Protection Agency. **Standards of Performance for New Stationary Sources.** 40 CFR 60. Appendix A, 2023.

3. United States...

3. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Acid Digestion of Sediments, Sludges, and Soils. SW-846 Method 3050B**, 1996.

4. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Volatile Organic Compounds in Various Sample Matrices Using Equilibrium Headspace Analysis. SW-846 Method 5021A**, 2014.

5. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Inductively Coupled Plasma-Optical Emission Spectrometry. SW-846 Method 6010D**, 2018.

6. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Flame Atomic Absorption Spectrophotometry. SW-846 Method 7000B**, 2007.

7. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Volatile Organic Compounds by Gas Chromatography/ Mass Spectrometry. SW-846 Method 8260D**, 2018.

8. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Soil and Waste pH. SW-846 Method 9045D**, 2004.

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

ที่ อก ๐๓๑๐(๑)/ ๑๔๙๑

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๒๔ กุมภาพันธ์ ๒๕๖๘

เรื่อง ยกเลิกบุคลากรของห้องปฏิบัติการวิเคราะห์

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๑๘ กุมภาพันธ์ ๒๕๖๘

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ขอยกเลิกบุคลากร ความละเอียดแจ้งแล้ว นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้ยกเลิกเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๓ ราย ได้แก่

๑) นายอภิสิทธิ์ ศรีคงแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๘
๒) นางสาวนันธิดา พรมกวยถ้ำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๐
๓) นายภูวดล เป็งมา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๘

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

จงสภากฤ

(นายธีรทัศน์ อิศรางกูร ณ อยุธยา)
รองอธิบดี ปฏิบัติราชการแทน
อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๑๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

Green Industry "อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

ที่ อก ๐๓๑๐(๑)/ ๑๐๘๙

กรมโรงงานอุตสาหกรรม
ถนนพระรามที่ ๖ แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพฯ ๑๐๔๐๐

๐๗ กุมภาพันธ์ ๒๕๖๘

เรื่อง ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

เรียน กรรมการผู้จัดการ บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด

อ้างถึง คำขอขึ้นทะเบียน/ต่ออายุ/เปลี่ยนแปลงบุคลากร และชนิดสารมลพิษของห้องปฏิบัติการวิเคราะห์เอกชน ลงวันที่ ๓ ธันวาคม ๒๕๖๗

สิ่งที่ส่งมาด้วย ๑. รายชื่อผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔๐ ราย
๒. รายชื่อเจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๑๔๑ ราย
๓. ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม

ตามคำขอที่อ้างถึง บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ขอต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน เลขทะเบียน ว-๑๔๕ สถานที่ตั้งเลขที่ ๓ ซอยอุดมสุข ๔๑ ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพมหานคร ต่อกรมโรงงานอุตสาหกรรม นั้น

กรมโรงงานอุตสาหกรรมพิจารณาแล้ว ให้บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด ต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน โดยมีองค์ประกอบดังนี้
ก. ผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔๐ ราย ตามสิ่งที่ส่งมาด้วย ๑
ข. เจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๑๔๑ ราย ตามสิ่งที่ส่งมาด้วย ๒
ค. ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนให้วิเคราะห์ในน้ำ/น้ำเสีย น้ำใต้ดิน อากาศเสีย สิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว และดิน ตามสิ่งที่ส่งมาด้วย ๓

หนังสือฉบับนี้จะหมดอายุในวันที่ ๒ กุมภาพันธ์ ๒๕๗๒ หากประสงค์จะต่ออายุหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน ให้ยื่นคำขอต่ออายุพร้อมเอกสารประกอบคำขอต่อกรมโรงงานอุตสาหกรรมภายใน ๖๐ วัน ก่อนวันสิ้นอายุของหนังสือรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน

จึงเรียนมาเพื่อทราบ

ขอแสดงความนับถือ

จงสภากฤ

(นายธีรทัศน์ อิศรางกูร ณ อยุธยา)
รองอธิบดี ปฏิบัติราชการแทน
อธิบดีกรมโรงงานอุตสาหกรรม

กองวิจัยและเตือนภัยมลพิษโรงงาน
กลุ่มมาตรฐานวิธีการวิเคราะห์ทดสอบมลพิษและทะเบียนห้องปฏิบัติการ
โทร. ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๐๓-๕
โทรสาร ๐ ๒๔๓๐ ๖๓๑๒ ต่อ ๒๑๑๙
ไปรษณีย์อิเล็กทรอนิกส์ saraban@diw.mail.go.th

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

Green Industry "อุตสาหกรรมก้าวไกล ประเทศไทยก้าวหน้า ร่วมกันพัฒนา อุตสาหกรรมสีเขียว"

สิ่งที่ส่งมาด้วย ๑

เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๑๐๘๙ ลงวันที่ ๐๗ กุมภาพันธ์ ๒๕๖๘

ก. ผู้ควบคุมห้องปฏิบัติการวิเคราะห์เอกชน จำนวน ๔๐ ราย

๑) นางสาวกฤชวรรณ ภัทรธีรกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๑
๒) นายนรงค์ ฉิมพาลี	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๒
๓) นางสาวนันทิตา บุญไสย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๓
๔) นางปิยะพัชร์ สุทธมนัสวงษ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๔
๕) นางสาวเบญจวรรณ วิริโยทัย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๖
๖) นายนพรัตน์ วงค์อนุรักษ์ชัย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๗
๗) นางสาวอวิวรรณ บุญลา	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๘
๘) นายสุวิทย์ จอดนอก	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๐๙
๙) นางสาวโชติภา สมบรรณ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๐
๑๐) นางสาวบุษกร เลิศภาณุมาศ	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๑
๑๑) นางสาววิไลลักษณ์ ศรีสุข	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๒
๑๒) นายศิลา บรรจงใจรักษ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๔
๑๓) นายปฏิกรณ์ คณะนา	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๕
๑๔) นายธีรวัฒน์ ขมมิ่ง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๖
๑๕) นางสาวศิริพร ศรีประดิษฐ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๗
๑๖) นางสาวสาวิตรี ริรัง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๘
๑๗) นางสาวนพวรรณ อุรารักษ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๑๙
๑๘) นายภูชงค์ พานิชย์เลิศอำไพ	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๐
๑๙) นายณัฐวัฒน์ แดงสวัสดิ์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๑
๒๐) นายเอกรัตน์ ปณะคามินทร์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๒
๒๑) นางสาวนิศารัตน์ ศรีสกุลสิทธิโชค	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๓
๒๒) นางสาวเจตจรินทร์ ทำสะอาด	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๔
๒๓) นางสาวสุวรรณ คงทอง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๕
๒๔) นางสาววรกร พัดสองชั้น	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๖
๒๕) นายวีรยุทธ โมกแก้ว	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๗
๒๖) นายวัชรพงษ์ เทพดนตรี	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๘
๒๗) นายอนุศาสน์ สวยดี	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๒๙
๒๘) นายกรวิทย์ เจี่ยศิริสกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๐
๒๙) นายสุทธีระ อรุณจันทร์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๓
๓๐) นางสาวทัศนีย์ อ่อนคำ	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๔
๓๑) นางพริ้มพรรณ กอนสิน	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๕
๓๒) นายศุภณัฐฐ์ คุณธนกาญจน์	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๖
๓๓) นางสาวศิริภาพร เหมือนเร่	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๗
๓๔) นางศิวานัส ขำนิล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๘
๓๕) นางสาวพรรนิภา ธีระจินดาชล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๓๙

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

๓๖) นายนาเคนทร์...

๓๖) นายนาเคนทร์ พันธุ์ชิชาติกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๐
๓๗) นายกานต์พงศ์ บุญพวง	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๑
๓๘) นางสุธรรมา แก้วข้อนอก	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๒
๓๙) นางสาวรสริน ไชยเชษฐ์พิพัฒกุล	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๓
๔๐) นางมานิดา แย้มไย	ทะเบียนเลขที่ ว-๑๔๕-ค-๐๐๔๔

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

ลิงที่ส่งมาด้วย ๒

เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกขน
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๑ ๐ ๘ ๙ ลงวันที่ ๐๗ กุมภาพันธ์ ๒๕๖๘

ข. เจ้าหน้าที่ห้องปฏิบัติการวิเคราะห์เอกขน จำนวน ๑๔๑ ราย

๑) นายสุชสันต์ พันสิงห์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑
๒) นายพีรณัฐ เจริญผล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓
๓) นางสาววิไลลักษณ์ เกไธสง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๔
๔) นายสมชาติ อุทุมรัตน์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๕
๕) นางสาวปรมาภรณ์ ทองแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๖
๖) นางสาวภัลยา สมพงษ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๗
๗) นางสาววรรณี สายบุญเรือน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๐
๘) นายกฤษณพงษ์ นามทิพย์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๑
๙) นางสาวอาภรณ์ อ่อนคง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๒
๑๐) นายกิตติศักดิ์ ทรงจำรัส	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๓
๑๑) นางสาวอักษรินทร์ บุญคง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๔
๑๒) นางสาวพรพิมล แว่นทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๕
๑๓) นายอภิวิชญ์ ท่วงที	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๗
๑๔) นายมานิตย์ ปานโชติ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๘
๑๕) นายทศพร ธนะพิรุนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๑๙
๑๖) นางสาวภัลยาณี โยธา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๐
๑๗) นางสาวเกวลี สุขรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๑
๑๘) นางสาวชมธนัญ อภิพัทธ์ปภา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๒
๑๙) นายศิรพัชร จงผดุงเกียรติ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๓
๒๐) นางสาวสุภาวดี อินยาศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๔
๒๑) นายพงศ์เทพ เหล่าขจร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๕
๒๒) นายขวัญชัย พันทุกข์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๖
๒๓) นางสาวพัชจิรา คดีพิศาล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๗
๒๔) นางสาวเมวิกา เสือคำจันทร์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๒๘
๒๕) นายพีระพัฒน์ บัญญัติศิลป์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓๒
๒๖) นายชัชวาลย์ เลื่อนล่อง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓๔
๒๗) นายนภสินธุ์ ธนูธรรมรัตน์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓๖
๒๘) นายกันนิกร ระโส	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓๗
๒๙) นายปริญญา กลมเกลียว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๐๓๙
๓๐) นายธีรวัจน์ มาตรไพร์ศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๐
๓๑) นายบุญญฤทธิ์ ก้อนสิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๒
๓๒) นายพรรษวุฒิ โถวสกุล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๓
๓๓) นายอชิตะ แสงจันทร์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๔
๓๔) ว่าที่ร้อยตรีณัฐพงศ์ เมืองชัย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๕
๓๕) นายธนัท เลิศประเสริฐ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๖

ต่อหน้า

๓๖) นางสาวนิภาพร...

๓๖) นางสาวนิภาพร จันทเขตต์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๗
๓๗) นายรณภพ ภู่ตระกูลพัฒนา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๔๙
๓๘) นายสมพงศ์ สกุลไทย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๑
๓๙) นายสุริยัน นิธิเชิดชูวงศ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๒
๔๐) นายอัษฎาวุธ ยนศิริ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๓
๔๑) นายเอกวุฒิ เสนอใจ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๔
๔๒) นายสุชสันต์ บุญเลี้ยง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๕
๔๓) นายธนเดช หวานเสนาะ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๖
๔๔) นายอภิสิทธิ์ ศรีคงแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๕๘
๔๕) ว่าที่ร้อยตรีอุทัย แก้วรากมุข	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๐
๔๖) นางสาววนารินทร์ สานนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๑
๔๗) นายศุภกร รินวงศ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๒
๔๘) นางสาวจินตสุภา เปลี่ยนศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๕
๔๙) นางสาวเนตรนภา กมลบูรณ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๖
๕๐) นางสาวอารียา ทรารมย์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๗
๕๑) นายจิรวัฒน์ สุขเกษม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๘
๕๒) นายกิติพงษ์ สอนชัยภูมิ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๖๙
๕๓) นายจุมพล สวนเพชร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๐
๕๔) นางสาวพัชราภรณ์ แสงฟ้า	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๑
๕๕) นายรัตนชัย เหล่ามา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๒
๕๖) นายอิทธิพงษ์ ศรวิเศษ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๓
๕๗) นางสาวกรรณิการ์ สำลีหา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๔
๕๘) นางสาวณัฐชา พรหมคีรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๗๙
๕๙) นายนภสิทธิ์ ศรีพิมพ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๘๕
๖๐) นางสาวลักษิกา จันทรสุข	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๘๖
๖๑) นายศักดิ์ศิลน์ นุ่มนิ่ม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๘๙
๖๒) นายวรพงษ์ นนทจันทร์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๐
๖๓) นางสาวชนาภา มาคะมาตร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๓
๖๔) นายณัฐชัย พรหมอารักษ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๖
๖๕) นายชนินทร์ พานแก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๗
๖๖) นายปรัชชาพล โสภา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๘
๖๗) นายวัชรินทร์ แสนงาม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๐๙๙
๖๘) นายอาทิตย์ อุดมผล	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๑
๖๙) นายอิทธิเดช ใจบุญ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๓
๗๐) นายคณิติน พงษ์อิศรานุพร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๔
๗๑) นายเสฏฐวุฒิ เอมกลิ่นบัว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๖
๗๒) นางสาวนาตาชา แหวนในเมือง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๐๙
๗๓) นางสาวพิมลวรรณ สิมมา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๐

ต่อหน้า

๗๔) นายนันทวัฒน์...

๗๔) นายนันทวัฒน์ วงศ์คำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๑
๗๕) นายประพันธ์ยุทธ์ เผือกนาง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๒
๗๖) นางสาวศมิษฐา ล่าชิต	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๓
๗๗) นางสาวนภาพร ขี้นนกขุ้ม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๔
๗๘) นางสาวเบญญา มอมุงคุณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๕
๗๙) นายอมรพล อมรลักษณ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๖
๘๐) นางสาวศรีเพชร ทองขาว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๗
๘๑) นางสาวณิชากร ศุภชาติโกรสร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๘
๘๒) นางสาววิมลวรรณ คำตัน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๑๙
๘๓) นายคุณานนท์ อุทธาคณานนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๓
๘๔) นายชาญณรงค์ อำลอย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๔
๘๕) นางสาวจิตรมาส ศรีวรรณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๕
๘๖) นายสุจิต โปขันเงิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๖
๘๗) นายเจษฎา ช่วยตรึก	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๗
๘๘) นายรชต เหมะธุลิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๒๘
๘๙) นายสุรโชค หล่าโท	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๐
๙๐) นายชัย บัวสด	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๑
๙๑) นางสาวอรญา ประสานศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๒
๙๒) นายนพดล เนียมนิยม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๓
๙๓) นายศุภกร สวนศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๔
๙๔) นายคณพล คิลานนท์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๕
๙๕) นายโชคชัย พุ่มไสว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๖
๙๖) นายธีรวัฒน์ ธรรมสุวรรณ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๘
๙๗) นายนัทธพงศ์ ชะชุนทด	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๓๙
๙๘) นางสาวณัฐกฤตา พลนิกรกิจ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๐
๙๙) นางสาวชไมพร ทองบูรณ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๑
๑๐๐) นางสาวพรชิตา ขจรเนติยุทธ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๒
๑๐๑) นางสาวเพ็ญพิชชา รอดทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๕
๑๐๒) นางสาวณัชชา แสงสว่าง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๖
๑๐๓) นายกีรติ สีอาจ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๗
๑๐๔) นายดนุพร คงศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๘
๑๐๕) นางสาวสุภัสสรา เลี่ยนเงิน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๔๙
๑๐๖) นางสาวพรรณทิพา อะโนนาม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๐
๑๐๗) นายอนันต์ มุดอ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๑
๑๐๘) นางสาวพรพิมล ประชาพันธุ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๒
๑๐๙) นายวีรภัทร บุญญาธิ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๓
๑๑๐) นางสาวณัฐชา แถวภาพ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๔
๑๑๑) นายสิทธิพล พร้อมพอชื่นบุญ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๖
๑๑๒) นางสาวนนท์ทิชา กลิ่นหนู	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๕๘

ต่อหน้า

๑๑๓) นางสาวปิติยา...

๑๑๓) นางสาวปิติยา ชูเชิดเชื้อ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๐
๑๑๔) นางสาวลัดดาวัลย์ โพธิ์พันธ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๑
๑๑๕) นายอาทิตย์ ดาภา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๒
๑๑๖) นางสาวบุญยาพร บุญถนอมศรี	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๓
๑๑๗) นางสาวพัชราวรรณ จันธิบุตร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๔
๑๑๘) นางสาวนฤภร ได้บ้านกวย	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๕
๑๑๙) นางสาวปวีณา แดนขนบ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๖๙
๑๒๐) นางสาวนันธิดา พรมกวยถ้ำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๐
๑๒๑) นางสาวกมลชนก ปุนคำ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๒
๑๒๒) นางสาวปาริฉัตร ทองใบ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๔
๑๒๓) นายชัยวัฒน์ จันละคร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๖
๑๒๔) นางสาวกัลยา สิงห์แก้ว	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๗๘
๑๒๕) นางสาวอารีนา มะดีเย๊าะ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๔
๑๒๖) นายฐาปกรณ์ อนุรา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๕
๑๒๗) นางสาวชามันตา กิมาคม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๖
๑๒๘) นายธนบดินทร์ ยาเหลี่ยม	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๗
๑๒๙) นายวีระพงษ์ แสงท่านั่ง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๘
๑๓๐) นางสาวปิยะณัฐชยา สำเภาพงษ์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๘๙
๑๓๑) นางสาวนภัสสร ศรีสถาน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๐
๑๓๒) นางสาวจุรีย์รัตน์ โสแหน	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๑
๑๓๓) นายธีรวัฒน์ พรหมลา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๒
๑๓๔) นายธนวิชช์ ปลั่งกลาง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๓
๑๓๕) นายณภัทร เตมียบุตร	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๔
๑๓๖) นางสาวจิดาภา ฤาชา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๕
๑๓๗) นางสาวสุมณฑาทิพย์ สังข์ทอง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๖
๑๓๘) นางสาวชาริสา บาบุญ	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๗
๑๓๙) นายภูวดล เบ็งมา	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๘
๑๔๐) ว่าที่ร้อยตรีรณยุทธ ประทุมเขตต์	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๑๙๙
๑๔๑) นายธนุศร พลสำโรง	ทะเบียนเลขที่ ว-๑๔๕-จ-๐๒๐๐

ต่อหน้า

เอกสารแนบท้ายหนังสือต่ออายุรับขึ้นทะเบียนห้องปฏิบัติการวิเคราะห์เอกชน
บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด เลขทะเบียน ว-๑๔๕
ที่ อก ๐๓๑๐(๑)/ ๓ ๐ ๘ ๙ ลงวันที่ ๐๗ กุมภาพันธ์ ๒๕๖๘

ขอบข่ายสารมลพิษที่ได้รับขึ้นทะเบียนจากกรมโรงงานอุตสาหกรรม จำนวน ๓๕๗ รายการ

น้ำ/น้ำเสีย จำนวน 46 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Aldrin	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
2	Arsenic	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
3	Barium	Digestion, Inductively Coupled Plasma Method[4]
4	α-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
5	β-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
6	δ-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
7	γ-BHC	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
8	Biochemical Oxygen Demand	1) 5-Day BOD Test, Azide Modification Method[4] 2) 5-Day BOD Test, Membrane Electrode Method[4]
9	Cadmium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
10	Chemical Oxygen Demand	1) Closed Reflux, Titrimetric Method[4] 2) Closed Reflux, Colorimetric Method[4] 3) Open Reflux, Titrimetric Method[4]
11	Chlordane	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
12	Chromium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
13	Color	ADMI Weighted-Ordinate Spectrophotometric Method[4]
14	Copper	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
15	Cyanide	1) Distillation, Colorimetric Method[4] 2) Total Cyanide after Distillation, by Flow Injection Analysis Method[4]
16	o,p'-DDT	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
17	4,4'-DDD	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
18	4,4'-DDE	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
19	4,4'-DDT	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
20	Dieldrin	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
21	Endosulfan I	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
22	Endosulfan II	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
23	Endosulfan sulfate	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
24	Endrin	Liquid-Liquid Extraction, Gas Chromatographic Method[4]

25 Endrin aldehyde...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
25	Endrin aldehyde	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
26	Formaldehyde	Distillation, Colorimetric Method[2]
27	Free Chlorine	1) Iodometric Method[4] 2) DPD Ferrous Titrimetric Method[4]
28	Heptachlor	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
29	Heptachlor Epoxide	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
30	Hexavalent Chromium	Colorimetric Method[4]
31	Lead	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
32	Manganese	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
33	Mercury	Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[4]
34	Methoxychlor	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
35	Nickel	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
36	Oil & Grease	1) Liquid-Liquid, Partition-Gravimetric Method[4] 2) Soxhlet Extraction Method[4]
37	pH	Electrometric Method[4]
38	Phenols	1) Distillation, Chloroform Extraction Method[4] 2) Distillation, Direct Photometric Method[4]
39	Selenium	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
40	Sulfide	1) Iodometric Method[4] 2) Methylene Blue Method[4]
41	Temperature	Laboratory and Field Methods[4]
42	Total Dissolved Solids	Dried at 180 °C[4]
43	Total Kjeldahl Nitrogen	Semi-Micro-Kjeldahl Method[4]
44	Total Suspended Solids	Dried from 103 to 105 °C[4]
45	Trivalent Chromium	1) Digestion, Direct Air-Acetylene Flame Method; Colorimetric Method; Calculation[4] 2) Digestion, Inductively Coupled Plasma Method; Colorimetric Method; Calculation[4]
46	Zinc	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]

น้ำใต้ดิน...

น้ำใต้ดิน จำนวน 126 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Acenaphthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
2	Acetone	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
3	Aldrin	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
4	Anthracene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
5	Antimony	Digestion, Inductively Coupled Plasma Method[4]
6	Arsenic	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
7	Atrazine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
8	Barium	Digestion, Inductively Coupled Plasma Method[4]
9	Benz(a)anthracene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
10	Benzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
11	Benzo(b)fluoranthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
12	Benzo(k)fluoranthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
13	Benzoic acid	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

14 Benzo(a)pyrene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
14	Benzo(a)pyrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
15	Benzo(g,h,i)perylene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
16	Beryllium	Digestion, Inductively Coupled Plasma Method[4]
17	Bis(2-chloroethyl)ether	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
18	Bis(2-ethylhexyl)phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
19	Bromodichloromethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
20	Bromoform	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
21	Butanol	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
22	Butyl benzyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
23	Cadmium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Electrothermal Atomic Absorption Spectrometric Method[4] 3) Digestion, Inductively Coupled Plasma Method[4]
24	Carbazole	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
25	Carbon disulfide	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
26	Carbon tetrachloride	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
27	Chlordane	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
28	p-Chloroaniline	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

29 Chlorobenzene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
29	Chlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
30	Chlorodibromomethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
31	Chloroform	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
32	2-Chlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
33	Chromium	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
34	Chromium (III)	1) Digestion, Direct Air-Acetylene Flame Method; Colorimetric Method; Calculation[4] 2) Digestion, Inductively Coupled Plasma Method; Colorimetric Method; Calculation[4]
35	Chromium (VI)	Colorimetric Method[4]
36	Chrysene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
37	Cyanide	Distillation, Colorimetric Method[4]
38	2,4-D	Liquid-Liquid Extraction, Gas Chromatographic Method[4]
39	DDD	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
40	DDE	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
41	DDT	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
42	Dibenz(a,h)anthracene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

43 Di-n-butyl phthalate...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
43	Di-n-butyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
44	1,2-Dichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
45	1,3-Dichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
46	1,4-Dichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
47	3,3′-Dichlorobenzidine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
48	1,1-Dichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
49	1,2-Dichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
50	1,1-Dichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
51	cis-1,2-Dichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
52	trans-1,2-Dichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
53	2,4-Dichlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
54	1,2-Dichloropropane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
55	1,3-Dichloropropane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
56	1,3-Dichloropropene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
57	Dieldrin	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
58	Diethyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
59	2,4-Dimethylphenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
60	2,4-Dinitrophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

61 2,4-Dinitrotoluene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
61	2,4-Dinitrotoluene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
62	2,6-Dinitrotoluene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
63	Di-n-Octyl phthalate	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
64	Endosulfan	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
65	Endrin	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
66	Ethylbenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
67	Fluoranthene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
68	Fluorene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
69	Heptachlor	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
70	Heptachlor epoxide	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
71	Hexachlorobenzene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
72	Hexachloro-1,3-butadiene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
73	n-Hexane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]

74 α-HCH...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
74	α-HCH	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
75	β-HCH	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
76	γ-HCH	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
77	Hexachlorocyclopentadiene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
78	Hexachloroethane	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
79	Indeno(1,2,3-cd)pyrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
80	Isophorone	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
81	Lead	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Electrothermal Atomic Absorption Spectrometric Method[4] 3) Digestion, Inductively Coupled Plasma Method[4]
82	Manganese	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
83	Mercury	Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[4]
84	Methanol	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
85	Methoxychlor	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
86	Methyl bromide	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]

87 Methylene chloride...

สำเนาถูกต้อง
LIMITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
87	Methylene chloride	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
88	2-Methylphenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
89	2-Methylnaphthalene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
90	Methyl tert-butyl ether	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
91	Naphthalene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
92	Nickel	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
93	Nitrobenzene	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
94	N-Nitrosodiphenylamine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
95	N-Nitrosodi-n-propylamine	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
96	Polychlorinated Biphenyls - PCB 1016 - PCB 1221 - PCB 1232 - PCB-1242 - PCB-1248 - PCB-1254 - PCB-1260	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
97	Pentachlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
98	pH	Electrometric Method[4]
99	Phenanthrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]

100 Phenol...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
100	Phenol	1) Distillation, Chloroform Extraction Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
101	Pyrene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
102	Selenium	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]
103	Silver	Digestion, Inductively Coupled Plasma Method[4]
104	Styrene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
105	1,1,2,2-Tetrachloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
106	Tetrachloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
107	Toluene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
108	Toxaphene	1) Liquid-Liquid Extraction, Gas Chromatographic Method[4] 2) Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
109	TPH (C_5 - C_8)	1) Purge and Trap, Gas Chromatographic Method[12,22] 2) Purge and Trap, Gas Chromatographic/Mass spectrometric Method[12,27]
110	TPH ($C_{>8}$ – C_{16})	Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[9,22]
111	TPH ($C_{>16}$ – C_{35})	Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[9,22]
112	1,2,4-Trichlorobenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
113	1,1,1-Trichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
114	1,1,2-Trichloroethane	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
115	Trichloroethylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]

116 2,4,5-Trichlorophenol...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
116	2,4,5-Trichlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
117	2,4,6-Trichlorophenol	Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[4]
118	1,3,5-Trimethylbenzene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
119	Vanadium	Digestion, Inductively Coupled Plasma Method[4]
120	Vinyl acetate	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
121	Vinyl chloride	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
122	m-Xylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
123	o-Xylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
124	p-Xylene	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
125	Xylene (Total)	Purge and Trap Gas Chromatographic/Mass Spectrometric Method[4]
126	Zinc	1) Digestion, Direct Air-Acetylene Flame Method[4] 2) Digestion, Inductively Coupled Plasma Method[4]

อากาศเสีย (ปล่องระบาย) จำนวน 25 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Antimony	Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
2	Arsenic	1) Isokinetic Sampling, Digestion, Hydride Generation/ Atomic Absorption Spectrometric Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
3	Cadmium	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
4	Carbon Monoxide	Instrumental Analyzer Method[5]
5	Chlorine	Isokinetic Sampling, Ion Chromatographic Method[5]
6	Chromium	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5]

Chromium (ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
6	Chromium (ต่อ)	2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
7	Cobalt	Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
8	Copper	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
9	Cresol	Absorption Sampling, Gas Chromatographic Method[5]
10	Dioxins/Furans	Isokinetic Sampling[5]
11	Hydrogen Chloride	Isokinetic Sampling, Ion Chromatographic Method[5]
12	Hydrogen Fluoride	Isokinetic Sampling, Ion Chromatographic Method[5]
13	Hydrogen Sulfide	Absorption Sampling, Iodometric Method[5]
14	Lead	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
15	Manganese	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
16	Mercury	Isokinetic Sampling, Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[5]
17	Nickel	1) Isokinetic Sampling, Digestion, Direct Air-Acetylene Flame Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
18	Opacity	Ringelmann's Method[1]
19	Oxides of Nitrogen	1) Absorption Sampling, Phenoldisulfonic acid Method[5] 2) Instrumental Analyzer Method[5]
20	Selenium	1) Isokinetic Sampling, Digestion, Hydride Generation/ Atomic Absorption Spectrometric Method[5] 2) Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
21	Sulfur Dioxide	1) Absorption Sampling, Barium-Thorin Titrimetric Method[5] 2) Instrumental Analyzer Method[5]
22	Sulfuric Acid	Isokinetic Sampling, Barium-Thorin Titrimetric Method[5]

23 Total Suspended Particulate...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
23	Total Suspended Particulate	Isokinetic Sampling, Gravimetric Method[5]
24	Vanadium	Isokinetic Sampling, Digestion, Inductively Coupled Plasma Method[5]
25	Xylene	1) Bag Sampling, Gas Chromatographic Method[5] 2) Adsorption Sampling, Gas Chromatographic Method[5]

สิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว จำนวน 35 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Aldrin	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
2	Antimony	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
3	Arsenic	1) Waste Extraction, Digestion, Hydride Generation/ Atomic Absorption Spectrometric Method[3,6,16] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,16] 4) Digestion, Inductively Coupled Plasma Method[7,14]
4	Barium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
5	Beryllium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
6	Cadmium	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
7	Chlordane	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]

8 Chromium...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
8	Chromium	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
9	Chromium (III)	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method; Waste Extraction, Colorimetric Method; Calculation[3,6,15,17] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method; Waste Extraction, Colorimetric Method; Calculation[3,6,14,17] 3) Digestion, Flame Atomic Absorption Spectrometric Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,15,17] 4) Digestion, Inductively Coupled Plasma Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,14,17]
10	Chromium (VI)	1) Waste Extraction, Colorimetric Method[3,17] 2) Alkaline Digestion, Colorimetric Method[8,17]
11	Cobalt	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
12	Copper	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
13	2,4-D	1) Waste Extraction, Gas Chromatographic Method[3,26] 2) Ultrasonic Extraction, Gas Chromatographic Method[26]
14	DDD	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]

15 DDE...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
15	DDE	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
16	DDT	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
17	Dieldrin	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
18	Endrin	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
19	Heptachlor	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
20	Lead	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
21	Lindane	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
22	Mercury	1) Waste Extraction, Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[3,19] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[19] 4) Digestion, Inductively Coupled Plasma Method[7,14]

Mercury (ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
22	Mercury (ต่อ)	5) Thermal Decomposition Amalgamation and Atomic Absorption Spectrometric Method[20]
23	Methoxychlor	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
24	Molybdenum	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
25	Nickel	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]
26	Polychlorinated Biphenyls - Aroclor 1016 - Aroclor 1221 - Aroclor 1232 - Aroclor 1242 - Aroclor 1248 - Aroclor 1254 - Aroclor 1260 - 2-Chlorobiphenyl - 2,3-Dichlorobiphenyl - 2,2',5-Trichlorobiphenyl - 2,4',5-Trichlorobiphenyl - 2,2',3,5'-Tetrachlorobiphenyl - 2,2',5,5'-Tetrachlorobiphenyl - 2,3',4,4'-Tetrachlorobiphenyl - 2,2',3,4,5'-Pentachlorobiphenyl - 2,2',4,5,5'-Pentachlorobiphenyl - 2,3,3',4',6-Pentachlorobiphenyl	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,24] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,24]

Polychlorinated Biphenyls(ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
	Polychlorinated Biphenyls(ต่อ) - 2,2',3,4,4',5'-Hexachlorobiphenyl - 2,2',3,4,5,5'-Hexachlorobiphenyl - 2,2',3,5,5',6-Hexachlorobiphenyl - 2,2',4,4',5,5'-Hexachlorobiphenyl - 2,2',3,3',4,4',5-Heptachlorobiphenyl - 2,2',3,4,4',5,5'-Heptachlorobiphenyl - 2,2',3,4,4',5',6-Heptachlorobiphenyl - 2,2',3,4',5,5',6-Heptachlorobiphenyl - 2,2',3,3',4,4',5,5',6-Nonachlorobiphenyl	
27	Pentachlorophenol	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic/Mass Spectrometric Method[3,9,28] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
28	pH	Electrometric Method[31,32]
29	Selenium	1) Waste Extraction, Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[3,6,21] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,21] 4) Digestion, Inductively Coupled Plasma Method[7,14]
30	Silver	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
31	Thallium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]

32 Toxaphene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
32	Toxaphene	1) Waste Extraction, Separatory Funnel Liquid-Liquid Extraction, Gas Chromatographic Method[3,9,23] 2) Ultrasonic Extraction, Gas Chromatographic Method[10,23]
33	Trichloroethylene	1) Waste Extraction, Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[3,12,27] 2) Waste Extraction, Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[3,11,27] 3) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 4) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
34	Vanadium	1) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 2) Digestion, Inductively Coupled Plasma Method[7,14]
35	Zinc	1) Waste Extraction, Digestion, Flame Atomic Absorption Spectrometric Method[3,6,15] 2) Waste Extraction, Digestion, Inductively Coupled Plasma Method[3,6,14] 3) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 4) Digestion, Inductively Coupled Plasma Method[7,14]

ดิน จำนวน 125 รายการ

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
1	Acenaphthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
2	Acetone	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
3	Aldrin	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
4	Anthracene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25]

Anthracene (ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
4	Anthracene (ต่อ)	2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
5	Antimony	Digestion, Inductively Coupled Plasma Method[7,14]
6	Arsenic	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,16] 2) Digestion, Inductively Coupled Plasma Method[7,14]
7	Atrazine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
8	Barium	Digestion, Inductively Coupled Plasma Method[7,14]
9	Benz(a)anthracene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
10	Benzene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
11	Benzo(b)fluoranthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
12	Benzo(k)fluoranthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
13	Benzoic acid	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
14	Benzo(a)pyrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
15	Benzo(g,h,i)perylene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
16	Beryllium	Digestion, Inductively Coupled Plasma Method[7,14]

17 Bis(2-chloroethyl)ether...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
17	Bis(2-chloroethyl)ether	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
18	Bis(2-ethylhexyl)phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
19	Bromodichloromethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
20	Bromoform	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
21	Butanol	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
22	Butyl benzyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
23	Cadmium	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,14]
24	Carbazole	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
25	Carbon disulfide	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
26	Carbon tetrachloride	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
27	Chlordane	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
28	p-Chloroaniline	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
29	Chlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
30	Chlorodibromomethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
31	Chloroform	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
32	2-Chlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]

33 Chromium...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
33	Chromium	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,14]
34	Chromium (III)	1) Digestion, Flame Atomic Absorption Spectrometric Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,15,17] 2) Digestion, Inductively Coupled Plasma Method; Alkaline Digestion, Colorimetric Method; Calculation[7,8,14,17]
35	Chromium (VI)	Alkaline Digestion, Colorimetric Method[8,17]
36	Chrysene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
37	Cyanide	Extraction, Distillation, Colorimetric Method[29,30]
38	2,4-D	Ultrasonic Extraction, Gas Chromatographic Method[26]
39	DDD	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
40	DDE	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
41	DDT	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
42	Dibenz(a,h)anthracene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
43	Di-n-butyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
44	1,2-Dichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]

45 1,3-Dichlorobenzene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
45	1,3-Dichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
46	1,4-Dichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
47	3,3'-Dichlorobenzidine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
48	1,1-Dichloroethane	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
49	1,2-Dichloroethane	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
50	1,1-Dichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
51	cis-1,2-Dichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
52	trans-1,2-Dichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
53	2,4-Dichlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
54	1,2-Dichloropropane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
55	1,3-Dichloropropane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
56	1,3-Dichloropropene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
57	Dieldrin	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]

58 Diethyl phthalate...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
58	Diethyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
59	2,4-Dimethylphenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
60	2,4-Dinitrophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
61	2,4-Dinitrotoluene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
62	2,6-Dinitrotoluene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
63	Di-n-Octyl phthalate	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
64	Endosulfan	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
65	Endrin	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
66	Ethylbenzene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
67	Fluoranthene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
68	Fluorene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
69	Heptachlor	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
70	Heptachlor epoxide	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23]

Heptachlor epoxide (ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
70	Heptachlor epoxide (ต่อ)	2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
71	Hexachlorobenzene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
72	Hexachloro-1,3-butadiene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
73	n-Hexane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
74	α-HCH	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
75	β-HCH	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
76	γ-HCH	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
77	Hexachlorocyclopentadiene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
78	Hexachloroethane	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
79	Indeno(1,2,3-cd)pyrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
80	Isophorone	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
81	Lead	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,14]
82	Manganese	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,14]

83 Mercury...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
83	Mercury	1) Digestion, Cold-Vapor Atomic Absorption Spectrometric Method[19] 2) Thermal Decomposition Amalgamation and Atomic Absorption Spectrometric Method[20]
84	Methanol	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
85	Methoxychlor	1) Ultrasonic Extraction, Gas Chromatographic Method[10,23] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
86	Methyl bromide	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
87	Methylene chloride	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method [11,27]
88	2-Methylphenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
89	2-Methylnaphthalene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
90	Methyl tert-butyl ether	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
91	Naphthalene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
92	Nickel	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,16]
93	Nitrobenzene	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
94	N-Nitrosodiphenylamine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
95	N-Nitrosodi-n-propylamine	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
96	Polychlorinated Biphenyls - Aroclor 1016	1) Ultrasonic Extraction, Gas Chromatographic Method[10,24]

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

Polychlorinated Biphenyls(ต่อ)...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
96	Polychlorinated Biphenyls(ต่อ) - Aroclor 1221 - Aroclor 1232 - Aroclor 1242 - Aroclor 1248 - Aroclor 1254	2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
	- Aroclor 1260 Polychlorinated Biphenyls - 2-Chlorobiphenyl - 2,3-Dichlorobiphenyl - 2,2',5-Trichlorobiphenyl - 2,4',5-Trichlorobiphenyl - 2,2',3,5'-Tetrachlorobiphenyl - 2,2',5,5'-Tetrachlorobiphenyl - 2,3',4,4'-Tetrachlorobiphenyl - 2,2',3,4,5'-Pentachlorobiphenyl - 2,2',4,5,5'-Pentachlorobiphenyl - 2,3,3',4',6-Pentachlorobiphenyl - 2,2',3,4,4',5'-Hexachlorobiphenyl - 2,2',3,4,5,5'-Hexachlorobiphenyl - 2,2',3,5,5',6-Hexachlorobiphenyl - 2,2',4,4',5,5'-Hexachlorobiphenyl - 2,2',3,3',4,4',5-Heptachlorobiphenyl - 2,2',3,4,4',5,5'-Heptachlorobiphenyl - 2,2',3,4,4',5',6-Heptachlorobiphenyl - 2,2',3,4',5,5',6-Heptachlorobiphenyl - 2,2',3,3',4,4',5,5',6-Nonachlorobiphenyl	Ultrasonic Extraction, Gas Chromatographic Method[10,24]

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

97 Pentachlorophenol...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
97	Pentachlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
98	Phenanthrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
99	Phenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
100	Pyrene	1) Ultrasonic Extraction, Gas Chromatographic Method[10,25] 2) Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
101	Selenium	1) Digestion, Hydride Generation/Atomic Absorption Spectrometric Method[7,21] 2) Digestion, Inductively Coupled Plasma Method[7,14]
102	Silver	Digestion, Inductively Coupled Plasma Method[7,14]
103	Styrene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
104	1,1,2,2-Tetrachloroethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
105	Tetrachloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
106	Toluene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
107	Toxaphene	Ultrasonic Extraction, Gas Chromatographic Method[10,23]
108	TPH (C_5-C_8)	1) Purge and Trap, Gas Chromatographic Method[13,22] 2) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
109	TPH (C_{98}-C_{16})	Ultrasonic Extraction, Gas Chromatographic Method[10,22]
110	TPH ($C_{>16}$-C_{35})	Ultrasonic Extraction, Gas Chromatographic Method[10,22]

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

111 1,2,4-Trichlorobenzene...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
111	1,2,4-Trichlorobenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
112	1,1,1-Trichloroethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
113	1,1,2-Trichloroethane	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
114	Trichloroethylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
115	2,4,5-Trichlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
116	2,4,6-Trichlorophenol	Ultrasonic Extraction, Gas Chromatographic/Mass Spectrometric Method[10,28]
117	1,3,5-Trimethylbenzene	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
118	Vanadium	Digestion, Inductively Coupled Plasma Method[7,16]
119	Vinyl acetate	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
120	Vinyl chloride	Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27]
121	m-Xylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
122	o-Xylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
123	p-Xylene	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]
124	Xylene (Total)	1) Purge and Trap, Gas Chromatographic/Mass Spectrometric Method[13,27] 2) Equilibrium Headspace, Gas Chromatographic/Mass Spectrometric Method[11,27]

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

125 Zinc...

ลำดับ	สารมลพิษ	วิธีวิเคราะห์
125	Zinc	1) Digestion, Flame Atomic Absorption Spectrometric Method[7,15] 2) Digestion, Inductively Coupled Plasma Method[7,14]

เอกสารอ้างอิง

1. กระทรวงอุตสาหกรรม. ประกาศกระทรวงอุตสาหกรรม, พ.ศ. 2549. เรื่อง กำหนดค่าปริมาณเขม่าควันที่เจือปนในอากาศที่ระบายออกจากปล่องของหม้อน้ำโรงสีข้าวที่ใช้แกลบเป็นเชื้อเพลิง. **ราชกิจจานุเบกษา.** 4 ธันวาคม 2549. เล่มที่ 123 ตอนพิเศษ 125ง.

2. สมาคมวิศวกรรมสิ่งแวดล้อมแห่งประเทศไทย. **คู่มือวิเคราะห์น้ำเสีย.** พิมพ์ครั้งที่ 4. กรุงเทพฯ: เรือนแก้วการพิมพ์, 2547.

3. กระทรวงอุตสาหกรรม. ประกาศกระทรวงอุตสาหกรรม, พ.ศ. 2566. เรื่อง การจัดการสิ่งปฏิกูลหรือวัสดุที่ไม่ใช้แล้ว. **ราชกิจจานุเบกษา.** 31 พฤษภาคม 2566. เล่มที่ 140 ตอนพิเศษ 126 ง.

4. APHA, AWWA, WEF. **Standard Methods for the Examination of Water and Wastewater.** 24th ed. Washington, DC: APHA, 2023.

5. United States Environmental Protection Agency. **Standards of Performance for New Stationary Sources.** 40 CFR 60. Appendix A, 2020.

6. United States Environmental Protection Agency. **Test Methods for Evaluation Solid Waste Physical/Chemical Methods. SW-846,** 2014.

7. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Acid Digestion of Sediments, Sludges, and Soils. SW-846 Method 3050B,** 1996.

8. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Alkaline Digestion for Hexavalent Chromium. SW-846 Method 3060A,** 1996.

9. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste 3. Physical/Chemical Methods. **Separatory Funnel Liquid-Liquid Extraction. SW-846 Method 3510C,** 1996.

10. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Ultrasonic Extraction. SW-846 Method 3550C,** 2007.

11. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Volatile Organic Compounds in Various Sample Matrices Using Equilibrium Headspace Analysis. SW-846 Method 5021A,** 2014.

12. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Purge-and-Trap for Aqueous Samples. SW-846 Method 5030C,** 2003.

13. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Closed System Purge and Trap and Extraction for Volatile Organics in Soil and Waste Sample. SW-846 Method 5035A,** 2000.

14. United States...

14. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Inductively Coupled Plasma-Optical Emission Spectrometry. SW-846 Method 6010D,** 2014.

15. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Flame Atomic Absorption Spectrophotometry. SW-846 Method 7000B,** 2007.

16. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Arsenic (Atomic Absorption, Gaseous Hydride). SW-846 Method 7061A,** 1992.

17. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Chromium, Hexavalent (Colorimetric). SW-846 Method 7196A,** 1992.

18. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Mercury in Liquid Waste (Manual Cold Vapor Technique). SW-846 Method 7470A,** 1994.

19. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Mercury in Solid or Semisolid Waste (Manual Cold-Vapor Technique). SW-846 Method 7471B,** 1998.

20. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Mercury in Solids and Solutions by Thermal Decomposition, Amalgamation, and Atomic Absorption Spectrophotometry. SW-846 Method 7473,** 2007.

21. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Selenium (Atomic Absorption, Borohydride Reduction). SW-846 Method 7742,** 1994.

22. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Nonhalogenated Organics Using GC/FID. SW-846 Method 8015D,** 2003.

23. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Organochlorine Pesticides by Gas Chromatography. SW-846 Method 8081B,** 2007.

24. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Polychlorinated Biphenyls (PCBs) by Gas Chromatography. SW-846 Method 8082A,** 2007.

25. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Organochlorine Pesticides by Gas Chromatography. SW-846 Method 8081B,** 2007.

26. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Chlorinated Herbicides by GC Using Methylation or Pentafluorobenzylation Derivertization. SW-846 Method 8151A,** 1996.

27. United States...

27. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Volatile Organic Compounds by Gas Chromatography/ Mass Spectrometry. SW-846 Method 8260D,** 2018.

28. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Semivolatile Organic Compounds by Gas Chromatography/Mass Spectrometry. SW-846 Method 8270E,** 2018.

29. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Cyanide Extraction Procedure for Solids and Oils. SW-846 Method 9013A,** 2014.

30. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Cyanide in Waters and Extracts using Titrimetric and Manual Spectrophotometric Procedures. SW-846 Method 9014,** 2014.

31. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **pH Electrometric Measurement. SW-846 Method 9040C,** 2004.

32. United States Environmental Protection Agency. Test Methods for Evaluation Solid Waste Physical/Chemical Methods. **Soil and Waste pH. SW-846 Method 9045D,** 2004.

UAE UNITED ANALYST AND ENGINEERING CONSULTANT COMPANY LIMITED สำเนาถูกต้อง

UNITED ANALYST AND ENGINEERING
CONSULTANT COMPANY LIMITED

บริษัท ยูไนเต็ด แอนนาลิสต์ แอนด์ เอ็นจิเนียริ่ง คอนซัลแตนท์ จำกัด
3 ซอยอุดมสุข 41 ถนนสุขุมวิท แขวงบางจาก เขตพระโขนง กรุงเทพฯ 10260
โทรศัพท์ 0 2763 2828 E-MAIL ADDRESS : UAE@UAECONSULTANT.COM