

ภาคผนวก ง

ผลการติดตามตรวจสอบคุณภาพสิ่งแวดล้อม



คุณภาพน้ำทิ้ง



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสนามจันทร์ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนการบำบัด
GPS. Coordinate : 47 P 671141 E 1516925 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/1
Sample Type : Wastewater
Sampling Date : 16 January 2026
Sampling Time : 10.29 a.m.
Received Date : 17 January 2026
Analytical Date : 17 January - 02 February 2026
Report Date : 03 February 2026


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 23.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	32.0
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	104
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.66
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	55
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

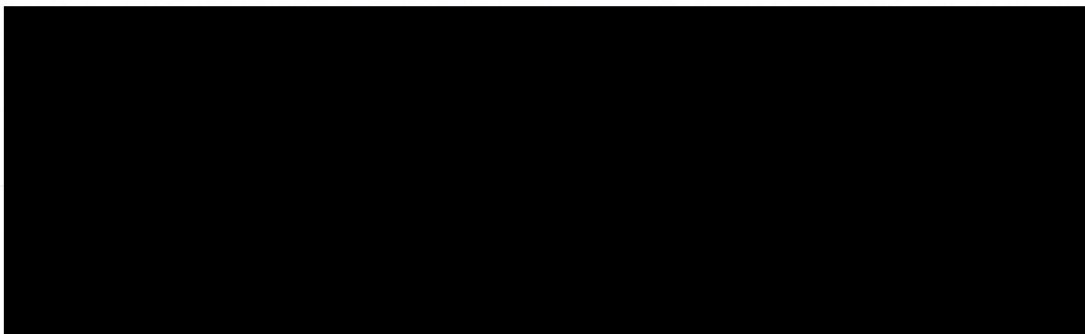

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด
GPS. Coordinate : 47 P 671142 E 1516911 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/2
Sample Type : Wastewater
Sampling Date : 16 January 2026
Sampling Time : 10.45 a.m.
Received Date : 17 January 2026
Analytical Date : 17 January - 02 February 2026
Report Date : 03 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 23.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	35.1	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	24.7	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	5.3	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	11,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

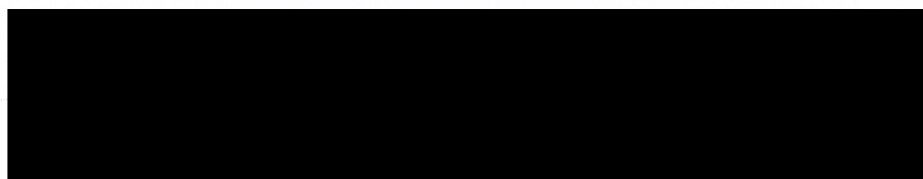

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนการบำบัด
GPS. Coordinate : 47 P 671154 E 1516918 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/1
Sample Type : Wastewater
Sampling Date : 18 February 2026
Sampling Time : 01.34 p.m.
Received Date : 19 February 2026
Analytical Date : 19 February – 09 March 2026
Report Date : 10 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	28.7
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	96.8
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.52
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	63
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด
GPS. Coordinate : 47 P 671145 E 1516913 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/2
Sample Type : Wastewater
Sampling Date : 18 February 2026
Sampling Time : 01.39 p.m.
Received Date : 19 February 2026
Analytical Date : 19 February – 09 March 2026
Report Date : 10 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.0	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	20.9	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	26.7	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะรूम สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนการบำบัด
GPS. Coordinate : 47 P 671143 E 1516913 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/1
Sample Type : Wastewater
Sampling Date : 27 March 2026
Sampling Time : 10.35 a.m.
Received Date : 28 March 2026
Analytical Date : 28 March – 10 April 2026
Report Date : 16 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	36.0
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	80.1
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.31
Total Kjeldahl Nitrogen *. ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	44
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.

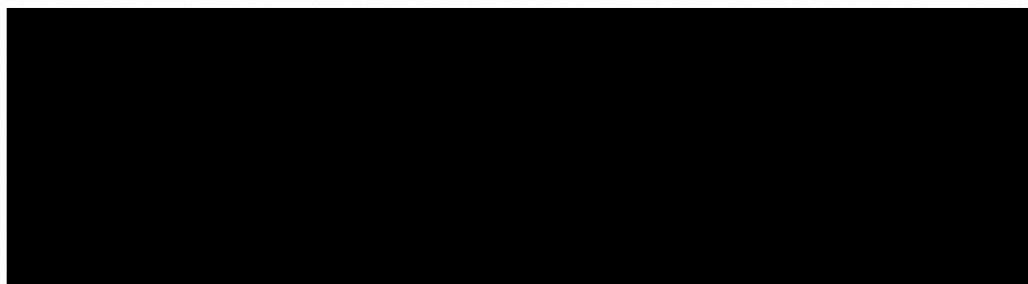



TNP ENVIRONMENT CO.,LTD.

เลขที่ 332/173 หมู่ 3 ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี 11110 โทรศัพท์: 02-156-8273

E-mail: tnp.envi@gmail.com เลขประจำตัวผู้เสียภาษี 0125560008957 สำนักงานใหญ่



NSC-TIS-TIS 17025

Testing 1679

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด
GPS. Coordinate : 47 P 671144 E 1516908 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/2
Sample Type : Wastewater
Sampling Date : 27 March 2026
Sampling Time : 10.32 a.m.
Received Date : 28 March 2026
Analytical Date : 28 March – 10 April 2026
Report Date : 16 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.0 °C	-	Electrometric Method (4500-H ⁺ B)	6.9	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	35.4	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	28.9	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen *. ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	35,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

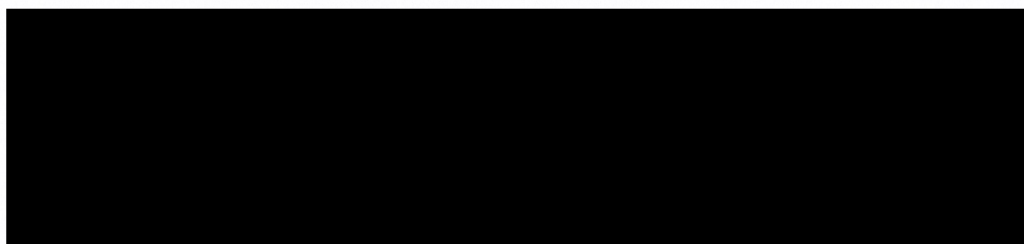

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนการบำบัด
GPS. Coordinate : 47 P 671141 E 1516909 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/1
Sample Type : Wastewater
Sampling Date : 23 April 2026
Sampling Time : 01.15 p.m.
Received Date : 24 April 2026
Analytical Date : 24 April – 07 May 2026
Report Date : 08 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.6
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	29.5
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	70.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.42
Total Kjeldahl Nitrogen * ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	56
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.

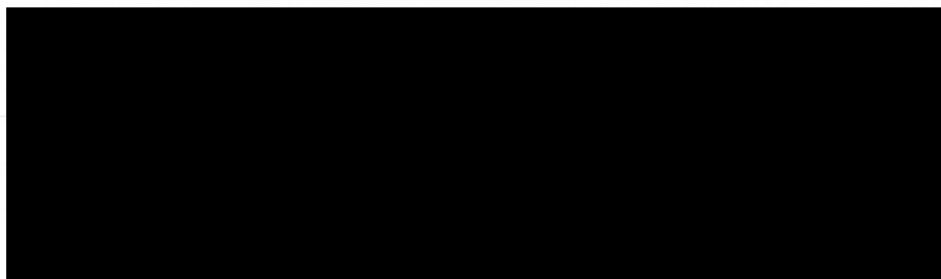

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด
GPS. Coordinate : 47 P 671147 E 1516915 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/2
Sample Type : Wastewater
Sampling Date : 23 April 2026
Sampling Time : 01.11 p.m.
Received Date : 24 April 2026
Analytical Date : 24 April – 07 May 2026
Report Date : 08 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.6 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	27.9	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	19.8	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 20
Total Kjeldahl Nitrogen *. ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	27	≤ 1.0
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	54,000	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนการบำบัด
GPS. Coordinate : 47 P 671147 E 1516905 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/1
Sample Type : Wastewater
Sampling Date : 14 May 2026
Sampling Time : 02.59 p.m.
Received Date : 15 May 2026
Analytical Date : 15 - 26 May 2026
Report Date : 27 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.1
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	22.8
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	75.4
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.3
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.71
Total Kjeldahl Nitrogen *, 3/	mg/L	APHA:4500-Norg (B) 2/	49
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

Mi

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานอินท์ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด
GPS. Coordinate : 47 P 671146 E 1516910 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/2
Sample Type : Wastewater
Sampling Date : 14 May 2026
Sampling Time : 02.55 p.m.
Received Date : 15 May 2026
Analytical Date : 15 - 26 May 2026
Report Date : 27 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.1	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	38.9	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	19.5	≤ 30
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	37	≤ 35
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	-
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

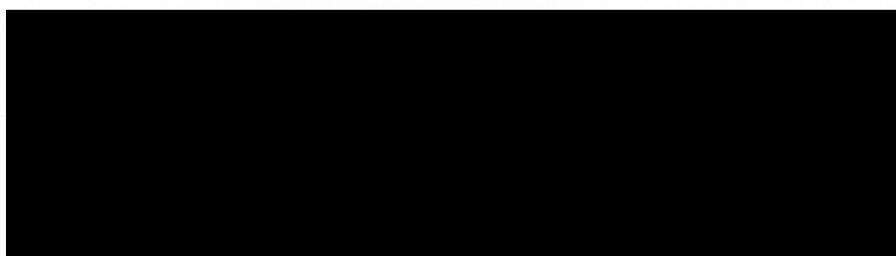

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งก่อนการบำบัด
GPS. Coordinate : 47 P 671142 E 1516912 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/1
Sample Type : Wastewater
Sampling Date : 18 June 2026
Sampling Time : 11.30 a.m.
Received Date : 19 June 2026
Analytical Date : 19 June - 01 July 2026
Report Date : 02 July 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	31.2
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	125
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.1
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	1.72
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	52
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	> 160,000
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะรูม สุขุมวิท 40
Project Name : โครงการ The Room Sukhumvit 40
Address Project : เลขที่ 9 ซอยสมานฉันท์ แขวงพระโขนงเหนือ
 เขตคลองเตย กรุงเทพมหานคร 10110
Sampling Point : น้ำทิ้งหลังการบำบัด
GPS. Coordinate : 47 P 671143 E 15169050 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69002
Sample No. : W69002/2
Sample Type : Wastewater
Sampling Date : 18 June 2026
Sampling Time : 11.34 a.m.
Received Date : 19 June 2026
Analytical Date : 19 June - 01 July 2026
Report Date : 02 July 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	29.7	≤ 40
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	19.9	≤ 30 ≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 1.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 35
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	-
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	92,000	5.5-9.0
Sample Appearance		Yellow/Turbid/Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type B.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co., Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

