

ภาคผนวก ง

ผลการติดตามคุณภาพสิ่งแวดล้อม



ภาคผนวก ง1

คุณภาพน้ำทิ้ง



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ที่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บริเวณบ่อดักไขมัน
GPS. Coordinate : 47 P 703676 E 1426189 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/1
Sample Type : Wastewater
Sampling Date : 27 February 2026
Sampling Time : 10.46 a.m.
Received Date : 28 February 2026
Analytical Date : 28 February - 23 March 2026
Report Date : 24 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	3,970
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	474
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	2,004
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	3.2
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	18.35
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	> 100
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	286
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บริเวณบ่อดักขยะ
GPS. Coordinate : 47 P 703615 E 1426192 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/2
Sample Type : Wastewater
Sampling Date : 27 February 2026
Sampling Time : 10.52 a.m.
Received Date : 28 February 2026
Analytical Date : 28 February – 23 March 2026
Report Date : 24 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	36.4	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	414	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	11.9	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	> 100	-
Total Kjeldahl Nitrogen ^{*, 3/}	mg/L	APHA:4500-Norg (B) ^{2/}	50	≤ 35
Sample Appearance		Yellow/Turbid/Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บริเวณบ่อดักไขมัน
GPS. Coordinate : 47 P 703674 E 1426181 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/1
Sample Type : Wastewater
Sampling Date : 10 March 2026
Sampling Time : 10.33 a.m.
Received Date : 11 March 2026
Analytical Date : 11 - 25 March 2026
Report Date : 26 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	644
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	506
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	382
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	8.17
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	18
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	135
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไตรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บริเวณบ่อดักขยะ
GPS. Coordinate : 47 P 703606 E 1426190 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/2
Sample Type : Wastewater
Sampling Date : 10 March 2026
Sampling Time : 10.40 a.m.
Received Date : 11 March 2026
Analytical Date : 11 - 25 March 2026
Report Date : 26 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	6.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	463	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, 3/	mg/L	APHA:4500-Norg (B) ^{2/}	16	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บ่อดักไขมัน
GPS. Coordinate : 47 P 703694 E 1426166 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/1
Sample Type : Wastewater
Sampling Date : 03 April 2026
Sampling Time : 02.59 p.m.
Received Date : 04 April 2026
Analytical Date : 04 – 24 April 2026
Report Date : 27 April 2026


Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	87.8
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	388
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	90.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	2.3
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.51
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	70
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียร่า โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บ่อดักขยะ
GPS. Coordinate : 47 P 703615 E 1426177 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/2
Sample Type : Wastewater
Sampling Date : 03 April 2026
Sampling Time : 03.04 p.m.
Received Date : 04 April 2026
Analytical Date : 04 – 24 April 2026
Report Date : 27 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.1 °C	-	Electrometric Method (4500-H ⁺ B)	6.8	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.8	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	390	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	19.4	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.4	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	20	≤ 35
Sample Appearance		Yellow/Turbid/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

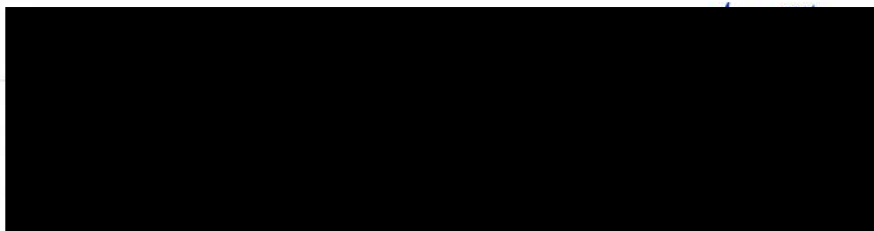

ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน 드라이브
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : ปอดักไขมัน
GPS. Coordinate : 47 P 703675 E 1426171 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/1
Sample Type : Wastewater
Sampling Date : 08 May 2026
Sampling Time : 10.49 a.m.
Received Date : 09 May 2026
Analytical Date : 09 - 21 May 2026
Report Date : 22 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	6.9
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	25.7
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	398
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	78.8
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	4.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	3.73
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.2
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	76
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บ่อดักขยะ
GPS. Coordinate : 47 P 703613 E 1426187 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling


Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/2
Sample Type : Wastewater
Sampling Date : 08 May 2026
Sampling Time : 10.57 a.m.
Received Date : 09 May 2026
Analytical Date : 09 - 21 May 2026
Report Date : 22 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.4 °C	-	Electrometric Method (4500-H ⁺ B)	6.2	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	404	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	15	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



00ANALYSIS REPORT

Data Provided by Customer


Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียร่า โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บ่อดักไขมัน
GPS. Coordinate : 47 P 703689 E 1426135 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/1
Sample Type : Wastewater
Sampling Date : 02 June 2026
Sampling Time : 11.37 a.m.
Received Date : 04 June 2026
Analytical Date : 04 – 19 June 2026
Report Date : 22 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.2 °C	-	Electrometric Method (4500-H ⁺ B)	7.2
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	21.1
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	398
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	45.4
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	4.4
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	1.52
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	2.0
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	66
Sample Appearance		Yellow/Turbid/Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : บ่อดักขยะ
GPS. Coordinate : 47 P 703616 E 1426192 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69064
Sample No. : W69064/2
Sample Type : Wastewater
Sampling Date : 02 June 2026
Sampling Time : 11.43 a.m.
Received Date : 04 June 2026
Analytical Date : 04 – 19 June 2026
Report Date : 22 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.0 °C	-	Electrometric Method (4500-H ⁺ B)	6.1	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	8.7	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	396	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	8.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	13	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ภาคผนวก ง2

คุณภาพน้ำสระว่ายน้ำ



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเอร์ โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำ ส่วนต้น
GPS. Coordinate : 47 P 703644 E 1426207 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/5
Sample Type : Swimming pool Water
Sampling Date : 27 February 2026
Sampling Time : 10.34 a.m.
Received Date : 28 February 2026
Analytical Date : 28 February - 23 March 2026
Report Date : 24 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำ ส่วนเล็ก
GPS. Coordinate : 47 P 703608 E 1426096 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/6
Sample Type : Swimming pool Water
Sampling Date : 27 February 2026
Sampling Time : 10.33 a.m.
Received Date : 28 February 2026
Analytical Date : 28 February - 23 March 2026
Report Date : 24 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.





TNP ENVIRONMENT CO.,LTD.

เลขที่ 332/173 หมู่ 3 ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี 11110 โทรศัพท์: 02-156-8273

E-mail: tnp.envi@gmail.com เลขประจำตัวผู้เสียภาษี 0125560008957 สำนักงานใหญ่



NSC-TIS-TIS 17025

Testing 1679

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิตินุศลอคารชุด เดอะ ริเวียรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 703636 E 1426203 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/3
Sample Type : Swimming pool Water
Sampling Date : 10 March 2026
Sampling Time : 10.26 a.m.
Received Date : 11 March 2026
Analytical Date : 11 - 25 March 2026
Report Date : 26 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

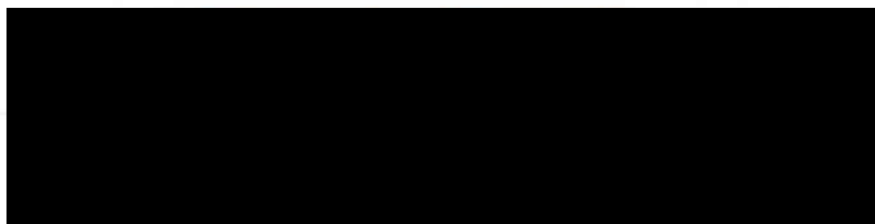

ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
 อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 703635 E 1426156 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/4
Sample Type : Swimming pool Water
Sampling Date : 10 March 2026
Sampling Time : 10.26 a.m.
Received Date : 11 March 2026
Analytical Date : 11 - 25 March 2026
Report Date : 26 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
 อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 703640 E 1426204 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/3
Sample Type : Swimming pool Water
Sampling Date : 03 April 2026
Sampling Time : 02.54 p.m.
Received Date : 04 April 2026
Analytical Date : 04 – 20 April 2026
Report Date : 21 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียร่า โอเชียน DRIVE
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
 อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 703647 E 1426191 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/4
Sample Type : Swimming pool Water
Sampling Date : 03 April 2026
Sampling Time : 02.54 p.m.
Received Date : 04 April 2026
Analytical Date : 04 – 20 April 2026
Report Date : 21 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไตรฟ
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 703622 E 1426177 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/5
Sample Type : Swimming pool Water
Sampling Date : 08 May 2026
Sampling Time : 10.37 a.m.
Received Date : 09 May 2026
Analytical Date : 09 - 21 May 2026
Report Date : 22 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนลึก
GPS. Coordinate : 47 P 703579 E 1426184 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/6
Sample Type : Swimming pool Water
Sampling Date : 08 May 2026
Sampling Time : 10.36 a.m.
Received Date : 09 May 2026
Analytical Date : 09 - 21 May 2026
Report Date : 22 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนต้น
GPS. Coordinate : 47 P 703638 E 1426212 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/3
Sample Type : Swimming pool Water
Sampling Date : 02 June 2026
Sampling Time : 11.31 a.m.
Received Date : 04 June 2026
Analytical Date : 04 – 19 June 2026
Report Date : 22 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : สระว่ายน้ำส่วนเล็ก
GPS. Coordinate : 47 P 703663 E 1426215 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69064
Sample No : W69064/4
Sample Type : Swimming pool Water
Sampling Date : 02 June 2026
Sampling Time : 11.31 a.m.
Received Date : 04 June 2026
Analytical Date : 04 – 19 June 2026
Report Date : 22 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

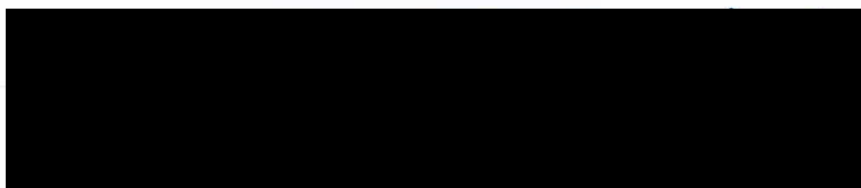

ภาคผนวก ง3

คุณภาพน้ำใช้



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : ดึงเก็บน้ำได้ดิน
GPS. Coordinate : 47 P 703685 E 1426208 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69064
Sample No : W69064/3
Sample Type : Water Supply
Sampling Date : 27 February 2026
Sampling Time : 10.40 a.m.
Received Date : 28 February 2026
Analytical Date : 28 February - 23 March 2026
Report Date : 24 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
True Color ^{*, 3/}	Pt-Co	APHA : 2120 B ^{2/}	< 5	≤ 15
Turbidity ^{*, 3/}	NTU	APHA : 2130 B ^{2/}	0.36	≤ 5.0
Odor [*]	-	Threshold Odor Test (2150 B)	Odorless	-
<i>Escherichia coli</i> [*]	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		


Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{*} This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไดรฟ์
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
 อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : ถังน้ำชั้นดาดฟ้า
GPS. Coordinate : 47 P 703715 E 1426185 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69064
Sample No : W69064/4
Sample Type : Water Supply
Sampling Date : 27 February 2026
Sampling Time : 10.25 a.m.
Received Date : 28 February 2026
Analytical Date : 28 February - 23 March 2026
Report Date : 24 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
True Color ^{*, 3/}	Pt-Co	APHA : 2120 B ^{2/}	< 5	≤ 15
Turbidity ^{*, 3/}	NTU	APHA : 2130 B ^{2/}	0.23	≤ 5.0
Odor [*]	-	Threshold Odor Test (2150 B)	Odorless	-
<i>Escherichia coli</i> [*]	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		


Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{*} This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริวีเยรา โอเชียน ไตรฟ
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
 อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : ถังน้ำใช้ ชั้นใต้ดิน
GPS. Coordinate : 47 P 703674 E 1426205 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69064
Sample No : W69064/3
Sample Type : Water Supply
Sampling Date : 08 May 2026
Sampling Time : 10.43 a.m.
Received Date : 09 May 2026
Analytical Date : 09 - 21 May 2026
Report Date : 22 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Color *	Pt-Co	Spectrophotometric Method (2120 C)	< 5	≤ 15
Turbidity *, ^{3/}	NTU	APHA : 2130 B ^{2/}	2.5	≤ 5.0
Odor *	-	Observation Method	Odorless	-
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		


Standard : The Department of Health, Criterias of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : นิติบุคคลอาคารชุด เดอะ ริเวียรา โอเชียน ไตรฟ
Project Name : โครงการอาคารชุด THE RIVIERA OCEAN DRIVE
Address Project : เลขที่ 593 หมู่ 12 ถนนจอมเทียนสาย 2 ตำบลหนองปรือ
อำเภอบางละมุง จังหวัดชลบุรี 20150
Sampling Point : ถังน้ำใช้ ชั้นดาดฟ้า
GPS. Coordinate : 47 P 703648 E 1426218 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69064
Sample No : W69064/4
Sample Type : Water Supply
Sampling Date : 08 May 2026
Sampling Time : 10.30 a.m.
Received Date : 09 May 2026
Analytical Date : 09 - 21 May 2026
Report Date : 22 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Color *	Pt-Co	Spectrophotometric Method (2120 C)	< 5	≤ 15
Turbidity ^{2/}	NTU	APHA : 2130 B ^{2/}	1.2	≤ 5.0
Odor *	-	Observation Method	Odorless	-
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : The Department of Health, Criteria of Supplied Drinkable Water Quality, B.E. 2563

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

