

ANALYSIS REPORT

Data Provided by Customer


Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681531 E 1528487 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68105
Sample No. : W68105/1
Sample Type : Wastewater
Sampling Date : 20 November 2025
Sampling Time : 01.40 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November – 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.5
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.1
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	331
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	8.6
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	6.9
Sample Appearance		Yellow/Clear/Little Sediment/Odorless	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681507 E 1528510 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68105
Sample No. : W68105/1
Sample Type : Wastewater
Sampling Date : 18 December 2025
Sampling Time : 02.33 p.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.4
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	327
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.3
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	9.6
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	6.4
Sample Appearance		Yellow/Clear/Little Sediment/Odorless	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681531 E 1528487 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/1
Sample Type : Wastewater
Sampling Date : 22 January 2026
Sampling Time : 10.12 a.m.
Received Date : 23 January 2026
Analytical Date : 23 January – 04 February 2026
Report Date : 05 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 27.7 °C	-	Electrometric Method (4500-H ⁺ B)	7.3
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	6.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	325
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	9.4
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1
Total Kjeldahl Nitrogen ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	7.2
Sample Appearance		Yellow/Clear/Little Sediment/Odorless	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681507 E 1528510 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/1
Sample Type : Wastewater
Sampling Date : 21 February 2026
Sampling Time : 03.18 p.m.
Received Date : 22 February 2026
Analytical Date : 22 February – 18 March 2026
Report Date : 19 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	364
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	11.7
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	9.5
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	10
Sample Appearance		Yellow/Clear/Little Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.

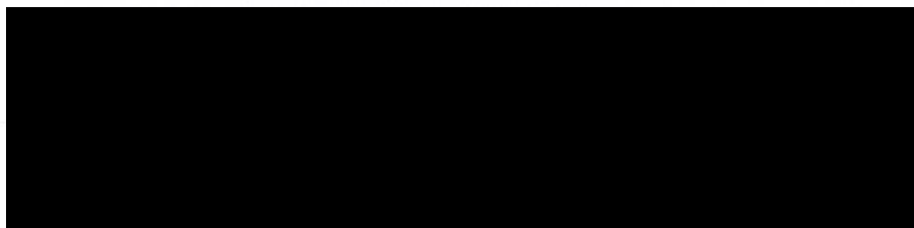

ANALYSIS REPORT

Data Provided by Customer


Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย
 GPS. Coordinate : 47 P 681531 E 1528487 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
 Sample No. : W69061/1
 Sample Type : Wastewater
 Sampling Date : 24 March 2026
 Sampling Time : 03.01 p.m.
 Received Date : 25 March 2026
 Analytical Date : 25 March - 03 April 2026
 Report Date : 06 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 25.3 °C	-	Electrometric Method (4500-H ⁺ B)	8.1
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	329
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.0
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrod Method (4500-O G, 5210 B)	< 2.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	7.0
Sample Appearance		Yellow/Clear/Little Sediment/Odorless	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : บริษัท ไชมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย
 GPS. Coordinate : 47 P 681509 E 1528515 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
 Sample No. : W69061/1
 Sample Type : Wastewater
 Sampling Date : 30 April 2026
 Sampling Time : 03.01 p.m.
 Received Date : 01 May 2026
 Analytical Date : 01 - 18 May 2026
 Report Date : 19 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.6
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	360
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	15.2
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	73.0
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	19
Sample Appearance		Yellow/Turbid/Little Sediment/Smelly	

- Remark
- ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
- ^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
- ^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
- * This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer


Customer Name : บริษัท โซมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : จุดรวบรวมน้ำเสียเข้าระบบบำบัดน้ำเสีย
 GPS. Coordinate : 47 P 681509 E 1528512 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
 Sample No. : W69061/1
 Sample Type : Wastewater
 Sampling Date : 28 May 2026
 Sampling Time : 02.40 p.m.
 Received Date : 29 May 2026
 Analytical Date : 29 May – 15 June 2026
 Report Date : 16 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.8
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	369
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.7
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	69.2
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	2.44
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	26
Sample Appearance		Yellow/Turbid/Little Sediment/Smelly	

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.
^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.
^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.
 * This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681532 E 1528537 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68105
Sample No. : W68105/2
Sample Type : Wastewater
Sampling Date : 20 November 2025
Sampling Time : 01.35 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November – 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	308	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	7.8	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681520 E 1528474 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68105
Sample No. : W68105/2
Sample Type : Wastewater
Sampling Date : 18 December 2025
Sampling Time : 02.26 p.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.0 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	313	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	8.1	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท โซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681532 E 1528537 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/2
Sample Type : Wastewater
Sampling Date : 22 January 2026
Sampling Time : 10.08 a.m.
Received Date : 23 January 2026
Analytical Date : 23 January – 04 February 2026
Report Date : 05 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.5	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	314	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O _G , 5210 B)	8.5	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



NALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท โซมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
 GPS. Coordinate : 47 P 681520 E 1528474 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
 Sample No. : W69061/2
 Sample Type : Wastewater
 Sampling Date : 21 February 2026
 Sampling Time : 03.34 p.m.
 Received Date : 22 February 2026
 Analytical Date : 22 February – 18 March 2026
 Report Date : 19 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.5 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	373	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	9.5	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	7.5	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.





TNP ENVIRONMENT CO.,LTD.

เลขที่ 332/173 หมู่ 3 ตำบลบางรักพัฒนา อำเภอบางบัวทอง จังหวัดนนทบุรี 11110 โทรศัพท์: 02-156-8273

E-mail: tnp.envi@gmail.com เลขประจำตัวผู้เสียภาษี 0125560008957 สำนักงานใหญ่

ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท โซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : จุดระบายน้ำออกจากกระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681532 E 1528537 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/2
Sample Type : Wastewater
Sampling Date : 24 March 2026
Sampling Time : 02.55 p.m.
Received Date : 25 March 2026
Analytical Date : 25 March - 03 April 2026
Report Date : 06 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.1 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	310	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไชมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681524 E 1528480 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/2
Sample Type : Wastewater
Sampling Date : 30 April 2026
Sampling Time : 03.18 p.m.
Received Date : 01 May 2026
Analytical Date : 01 - 18 May 2026
Report Date : 19 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.8	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	233	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไชมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
Sampling Point : จุดระบายน้ำออกจากระบบบำบัดน้ำเสีย
GPS. Coordinate : 47 P 681528 E 1528478 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/2
Sample Type : Wastewater
Sampling Date : 28 May 2026
Sampling Time : 02.30 p.m.
Received Date : 29 May 2026
Analytical Date : 29 May – 15 June 2026
Report Date : 16 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.3	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	362	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	9.6	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้ายก่อนระบายลงสู่ท่อระบายน้ำ
บนถนนการะจำยอม
GPS. Coordinate : 47 P 681503 E 1528546 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68105
Sample No. : W68105/3
Sample Type : Wastewater
Sampling Date : 20 November 2025
Sampling Time : 01.30 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November – 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	302	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	7.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen ^{2/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		

Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้ายก่อนระบายลงสู่ท่อระบายน้ำ
บนถนนการะจำยอม
GPS. Coordinate : 47 P 681494 E 1528530 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W68105
Sample No. : W68105/3
Sample Type : Wastewater
Sampling Date : 18 December 2025
Sampling Time : 02.22 p.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	312	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	7.1	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้ายก่อนระบายลงสู่ท่อระบายน้ำ
บนถนนการะจำยอม
GPS. Coordinate : 47 P 681503 E 1528546 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/3
Sample Type : Wastewater
Sampling Date : 22 January 2026
Sampling Time : 10.01 a.m.
Received Date : 23 January 2026
Analytical Date : 23 January – 04 February 2026
Report Date : 05 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.9 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	302	≤ 1,000
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	7.2	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้ายก่อนระบายลงสู่ท่อระบายน้ำ
บนถนนเกาะจำยอม
GPS. Coordinate : 47 P 681494 E 1528530 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/3
Sample Type : Wastewater
Sampling Date : 21 February 2026
Sampling Time : 03.07 p.m.
Received Date : 22 February 2026
Analytical Date : 22 February – 18 March 2026
Report Date : 19 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.2 °C	-	Electrometric Method (4500-H ⁺ B)	7.4	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	383	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	7.3	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O ₂ G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ₂ ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท โซมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : บ่อพักน้ำสุดท้ายก่อนระบายลงสู่ท่อระบายน้ำ
 บนถนนการะจำยอม
 GPS. Coordinate : 47 P 681503 E 1528546 N
 Sampling By : TNP ENVIRONMENT CO.,LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
 Sample No. : W69061/3
 Sample Type : Wastewater
 Sampling Date : 24 March 2026
 Sampling Time : 03.04 p.m.
 Received Date : 25 March 2026
 Analytical Date : 25 March - 03 April 2026
 Report Date : 06 April 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.8 °C	-	Electrometric Method (4500-H ⁺ B)	7.7	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	304	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Membrane Electrode Method (4500-O G, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024)., Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้ายก่อนระบายลงสู่ท่อระบายน้ำ
 บนถนนการะจำยอม
GPS. Coordinate : 47 P 681498 E 1528543 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/3
Sample Type : Wastewater
Sampling Date : 30 April 2026
Sampling Time : 03.09 p.m.
Received Date : 01 May 2026
Analytical Date : 01 - 18 May 2026
Report Date : 19 May 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 25.4 °C	-	Electrometric Method (4500-H ⁺ B)	7.6	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	252	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	19.8	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		White/Turbid/Little Sediment/Smelly		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท โซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันทนายาว เขตคันทนายาว
กรุงเทพมหานคร
Sampling Point : บ่อพักน้ำสุดท้ายก่อนระบายลงสู่ท่อระบายน้ำ
บนถนนการะจำยอม
GPS. Coordinate : 47 P 681498 E 1528541 N
Sampling By : TNP ENVIRONMENT CO.,LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Report No. : W69061
Sample No. : W69061/3
Sample Type : Wastewater
Sampling Date : 28 May 2026
Sampling Time : 02.46 p.m.
Received Date : 29 May 2026
Analytical Date : 29 May – 15 June 2026
Report Date : 16 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
pH at 24.3 °C	-	Electrometric Method (4500-H ⁺ B)	7.0	5.5-9.0
Total Dissolved Solids	mg/L	Dried at 180 °C (2540 C)	337	≤ 1,000
Total Suspended Solids	mg/L	Dried at 103-105 °C (2540 D)	< 5.0	≤ 30
Biochemical Oxygen Demand *	mg/L	5-Day BOD Test, Azide Modification Method (4500-O C, 5210 B)	< 2.0	≤ 20
Oil and Grease *	mg/L	Liquid-Liquid Partition Gravimetric Method (5520 B)	< 2.0	≤ 20
Sulfide *	mg/L	Iodometric Method (4500-S ²⁻ F)	< 0.60	≤ 1.0
Settleable Solids *	mL/L	Imhoff Cone (2540 F)	< 0.1	-
Total Kjeldahl Nitrogen *, ^{3/}	mg/L	APHA:4500-Norg (B) ^{2/}	< 0.28	≤ 35
Sample Appearance		Yellow/Clear/Little Sediment/Odorless		


Standard : Notification of the Ministry of Natural Resources and Environment, under Enhancement and Conservation of National Environmental Quality Act, B.E. 2567 (2024), Building type A.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนลึก)
GPS. Coordinate : 47 P 681496 E 1528501 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68105
Sample No : W68105/4
Sample Type : Swimming pool Water
Sampling Date : 20 November 2025
Sampling Time : 01.15 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November – 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนต้น)
GPS. Coordinate : 47 P 681500 E 1528481 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/5
Sample Type : Swimming pool Water
Sampling Date : 20 November 2025
Sampling Time : 01.15 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November – 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในท้องชุดเพื่อการพาณิชย์ (ส่วนลึก)
GPS. Coordinate : 47 P 681513 E 1528463 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/6
Sample Type : Swimming pool Water
Sampling Date : 20 November 2025
Sampling Time : 01.25 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November – 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในท้องชุดเพื่อการพาณิชย์ (ส่วนต้น)
GPS. Coordinate : 47 P 681523 E 1528438 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/7
Sample Type : Swimming pool Water
Sampling Date : 20 November 2025
Sampling Time : 01.25 p.m.
Received Date : 21 November 2025
Analytical Date : 21 November – 04 December 2025
Report Date : 08 December 2025

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนเล็ก)
GPS. Coordinate : 47 P 681496 E 1528501 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/4
Sample Type : Swimming pool Water
Sampling Date : 18 December 2025
Sampling Time : 02.10 p.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

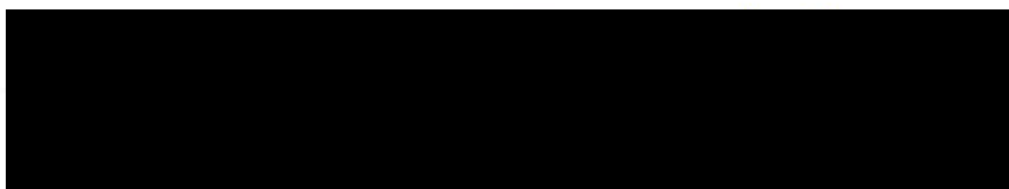

ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนต้น)
GPS. Coordinate : 47 P 681500 E 1528481 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/5
Sample Type : Swimming pool Water
Sampling Date : 18 December 2025
Sampling Time : 02.10 p.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท โซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในท้องชุดเพื่อการพาณิชย์ (ส่วนลึก)
GPS. Coordinate : 47 P 681513 E 1528463 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/6
Sample Type : Swimming pool Water
Sampling Date : 18 December 2025
Sampling Time : 02.15 p.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในท้องชุดเพื่อการพาณิชย์ (ส่วนต้น)
GPS. Coordinate : 47 P 681523 E 1528438 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/7
Sample Type : Swimming pool Water
Sampling Date : 18 December 2025
Sampling Time : 02.15 p.m.
Received Date : 19 December 2025
Analytical Date : 19 December 2025 – 05 January 2026
Report Date : 06 January 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนเล็ก)
 GPS. Coordinate : 47 P 681496 E 1528501 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W68105
 Sample No : W68105/4
 Sample Type : Swimming pool Water
 Sampling Date : 22 January 2026
 Sampling Time : 09.53 a.m.
 Received Date : 23 January 2026
 Analytical Date : 23 January – 04 February 2026
 Report Date : 05 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนต้น)
GPS. Coordinate : 47 P 681500 E 1528481 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/5
Sample Type : Swimming pool Water
Sampling Date : 22 January 2026
Sampling Time : 09.53 a.m.
Received Date : 23 January 2026
Analytical Date : 23 January – 04 February 2026
Report Date : 05 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

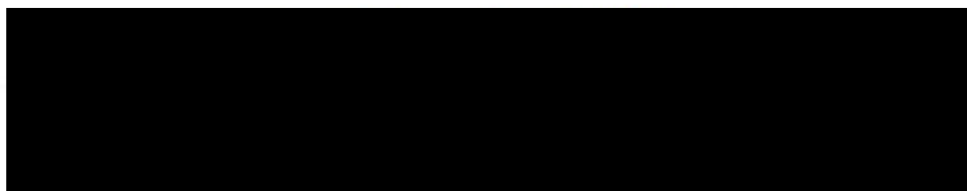

ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในท้องชุดเพื่อการพาณิชย์ (ส่วนลึก)
GPS. Coordinate : 47 P 681513 E 1528463 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
Sample No : W68105/6
Sample Type : Swimming pool Water
Sampling Date : 22 January 2026
Sampling Time : 09.55 a.m.
Received Date : 23 January 2026
Analytical Date : 23 January – 04 February 2026
Report Date : 05 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : สระว่ายน้ำที่ตั้งในท้องชุดเพื่อการพาณิชย์ (ส่วนต้น)
 GPS. Coordinate : 47 P 681523 E 1528438 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W68105
 Sample No : W68105/7
 Sample Type : Swimming pool Water
 Sampling Date : 22 January 2026
 Sampling Time : 09.55 a.m.
 Received Date : 23 January 2026
 Analytical Date : 23 January – 04 February 2026
 Report Date : 05 February 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไชมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนลึก)
GPS. Coordinate : 47 P 681496 E 1528501 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69061
Sample No : W69061/4
Sample Type : Swimming pool Water
Sampling Date : 21 February 2026
Sampling Time : 02.41 p.m.
Received Date : 22 February 2026
Analytical Date : 22 February – 18 March 2026
Report Date : 19 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนต้น)
GPS. Coordinate : 47 P 681500 E 1528481 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69061
Sample No : W69061/5
Sample Type : Swimming pool Water
Sampling Date : 21 February 2026
Sampling Time : 02.40 p.m.
Received Date : 22 February 2026
Analytical Date : 22 February – 18 March 2026
Report Date : 19 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไชมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในห้องชุดเพื่อการพาณิชย์ (ส่วนลึก)
GPS. Coordinate : 47 P 681513 E 1528463 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69061
Sample No : W69061/6
Sample Type : Swimming pool Water
Sampling Date : 21 February 2026
Sampling Time : 02.44 p.m.
Received Date : 22 February 2026
Analytical Date : 22 February – 18 March 2026
Report Date : 19 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
 Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
 (Landmark @ Grand Station B)
 Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
 กรุงเทพมหานคร
 Sampling Point : สระว่ายน้ำที่ตั้งในท้องชุดเพื่อการพาณิชย์ (ส่วนต้น)
 GPS. Coordinate : 47 P 681523 E 1528438 N
 Sampling By : TNP ENVIRONMENT CO., LTD.
 Sampling Method : Grab Sampling

Data Provided by Laboratory


Customer Code : W69061
 Sample No : W69061/7
 Sample Type : Swimming pool Water
 Sampling Date : 21 February 2026
 Sampling Time : 02.45 p.m.
 Received Date : 22 February 2026
 Analytical Date : 22 February – 18 March 2026
 Report Date : 19 March 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนลึก)
GPS. Coordinate : 47 P 681512 E 1528492 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69061
Sample No : W69061/4
Sample Type : Swimming pool Water
Sampling Date : 28 May 2026
Sampling Time : 03.09 p.m.
Received Date : 29 May 2026
Analytical Date : 29 May – 15 June 2026
Report Date : 16 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Calcium Hardness *	mg/Las CaCO ₃	EDTA Titrimetric Method (2340)	62.9	250-600
Alkalinity *	mg/Las CaCO ₃	Titrimetric Method (2320)	64.0	80-100
Chloride *	mg/L	Amperometric Titration Method (4500-CL D)	25.2	≤ 600
Combine Chlorine *	mg/L	Iodometric Method (4500-CL B)	0.9	0.5-1.0
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Cyanuric acid *, ^{3/}	mg/L	Colorimetric ^{2/}	6	30-60
N-Ammonia *, ^{3/}	mg/L	APHA:4500-NH ₃ (C) ^{2/}	< 0.14	≤ 20
Nitrate *, ^{3/}	mg/L	APHA:4500-NO ₃ (D) ^{2/}	0.7	≤ 50
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.


Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{4/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo.-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำส่วนกลาง (ส่วนต้น)
GPS. Coordinate : 47 P 681505 E 1528482 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69061
Sample No : W69061/5
Sample Type : Swimming pool Water
Sampling Date : 28 May 2026
Sampling Time : 03.08 p.m.
Received Date : 29 May 2026
Analytical Date : 29 May – 15 June 2026
Report Date : 16 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Calcium Hardness *	mg/Las CaCO ₃	EDTA Titrimetric Method (2340)	63.9	250-600
Alkalinity *	mg/Las CaCO ₃	Titrimetric Method (2320)	65.5	80-100
Chloride *	mg/L	Amperometric Titration Method (4500-CL D)	26.5	≤ 600
Combine Chlorine *	mg/L	Iodometric Method (4500-CL B)	0.9	0.5-1.0
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Cyanuric acid *, ^{3/}	mg/L	Colorimetric ^{2/}	6	30-60
N-Ammonia *, ^{3/}	mg/L	APHA:4500-NH ₃ (C) ^{2/}	< 0.14	≤ 20
Nitrate *, ^{3/}	mg/L	APHA:4500-NO ₃ (D) ^{2/}	0.6	≤ 50
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *, ^{4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *, ^{4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.


Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{4/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo.-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในท้องขุดเพื่อการพาณิชย์ (ส่วนลึก)
GPS. Coordinate : 47 P 681530 E 1528440 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69061
Sample No : W69061/6
Sample Type : Swimming pool Water
Sampling Date : 28 May 2026
Sampling Time : 03.06 p.m.
Received Date : 29 May 2026
Analytical Date : 29 May – 15 June 2026
Report Date : 16 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Calcium Hardness *	mg/Las CaCO ₃	EDTA Titrimetric Method (2340)	63.9	250-600
Alkalinity *	mg/Las CaCO ₃	Titrimetric Method (2320)	71.5	80-100
Chloride *	mg/L	Amperometric Titration Method (4500-Cl D)	16.8	≤ 600
Combine Chlorine *	mg/L	Iodometric Method (4500-Cl B)	0.9	0.5-1.0
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Cyanuric acid ^{*, 3/}	mg/L	Colorimetric ^{2/}	< 1.0	30-60
N-Ammonia ^{*, 3/}	mg/L	APHA:4500-NH ₃ (C) ^{2/}	0.34	≤ 20
Nitrate ^{*, 3/}	mg/L	APHA:4500-NO ₃ (D) ^{2/}	0.6	≤ 50
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> ^{*, 4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> ^{*, 4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.


Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{4/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo.-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.



ANALYSIS REPORT

Data Provided by Customer

Customer Name : บริษัท ไซมิส แอสเสท จำกัด (มหาชน)
Project Name : โครงการแลนด์มาร์ค แอท แกรนด์ สเตชั่น บี
(Landmark @ Grand Station B)
Address Project : ถนนรามอินทรา แขวงคันนายาว เขตคันนายาว
กรุงเทพมหานคร
Sampling Point : สระว่ายน้ำที่ตั้งในท้องขุดเพื่อการพาณิชย์ (ส่วนต้น)
GPS. Coordinate : 47 P 681523 E 1528434 N
Sampling By : TNP ENVIRONMENT CO., LTD.
Sampling Method : Grab Sampling

Data Provided by Laboratory

Customer Code : W69061
Sample No : W69061/7
Sample Type : Swimming pool Water
Sampling Date : 28 May 2026
Sampling Time : 03.05 p.m.
Received Date : 29 May 2026
Analytical Date : 29 May – 15 June 2026
Report Date : 16 June 2026

Parameter	Unit	Analytical Method ^{1/}	Result	Standard
Calcium Hardness *	mg/Las CaCO ₃	EDTA Titrimetric Method (2340)	67.8	250-600
Alkalinity *	mg/Las CaCO ₃	Titrimetric Method (2320)	77.5	80-100
Chloride *	mg/L	Amperometric Titration Method (4500-CL D)	17.7	≤ 600
Combine Chlorine *	mg/L	Iodometric Method (4500-CL B)	0.9	0.5-1.0
Total Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 B)	< 1.8	< 10
Fecal Coliform Bacteria *	MPN/100 mL	Multiple-Tube Fermentation Technique (9221 E)	Not Detected	Not Detected
Cyanuric acid *. ^{3/}	mg/L	Colorimetric ^{2/}	< 1.0	30-60
N-Ammonia *. ^{3/}	mg/L	APHA:4500-NH ₃ (C) ^{2/}	< 0.14	≤ 20
Nitrate *. ^{3/}	mg/L	APHA:4500-NO ₃ (D) ^{2/}	0.7	≤ 50
<i>Escherichia coli</i> *	/100 mL	Multiple-Tube Fermentation Technique (9221 F)	Not Detected	Not Detected
<i>Staphylococcus aureus</i> *. ^{4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater. APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 B	Not Detected	Not Detected
<i>Pseudomonas aeruginosa</i> *. ^{4/}	/100 mL	Standard Methods for the Examination of Water and Wastewater, APHA, AWWA & WEF, 24 th Edition, 2023, Part 9213 E	Not Detected	Not Detected
Sample Appearance		Clear/Odorless		

Standard : Public Health Commission Recommendation (No. 1) B.E. 2550 (2007), on the control of the operation swimming pools or other.

Remark ^{1/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 24th edition 2023.

^{2/} Standard Methods for the Examination of Water and Wastewater., APHA, AWWA, WEF, 23rd edition 2017.

^{3/} Analyzed by Environment & Laboratory Co.,Ltd. Registration number Wo-029.

^{4/} Analyzed by Bureau Veritas AQ Lab (Thailand) Limited registration number Wo.-313.

* This item is out the scope ISO/IEC 17025:2017 Accreditation.

